



FY2005 Long-Term Industry Trend Results


Automatic Scrams While Critical

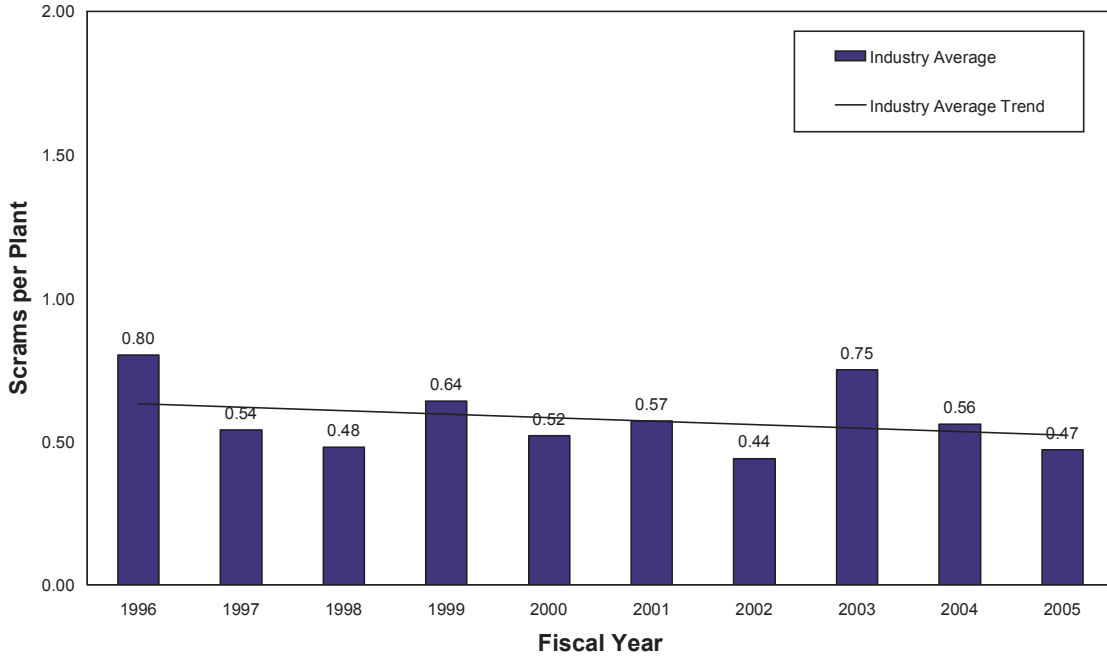


Safety System Actuations

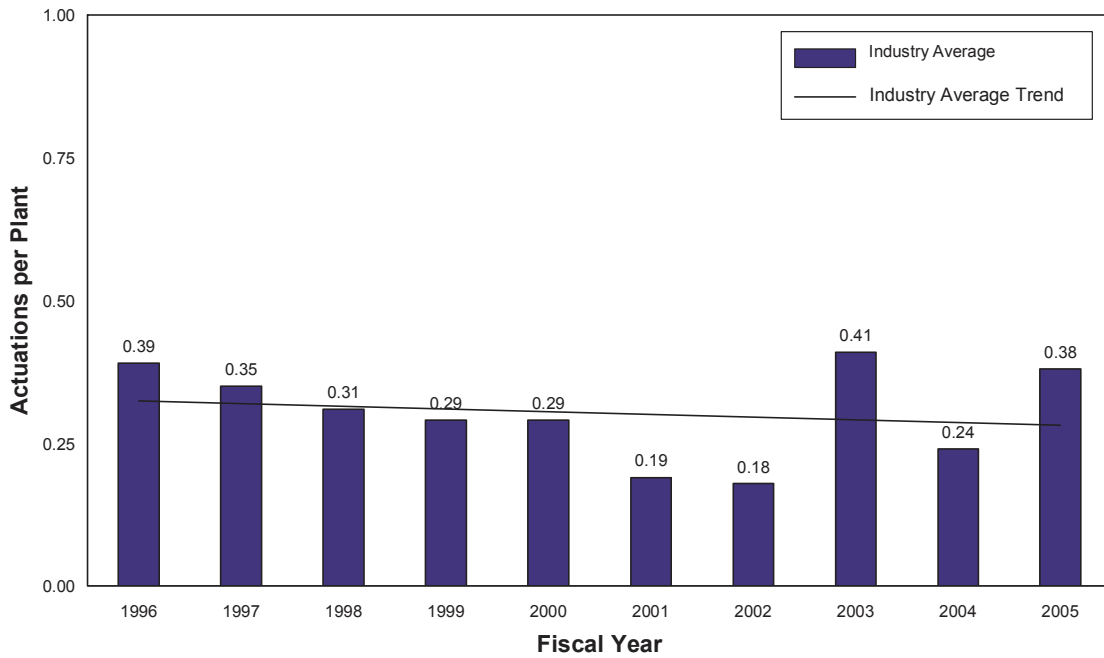


Significant Events

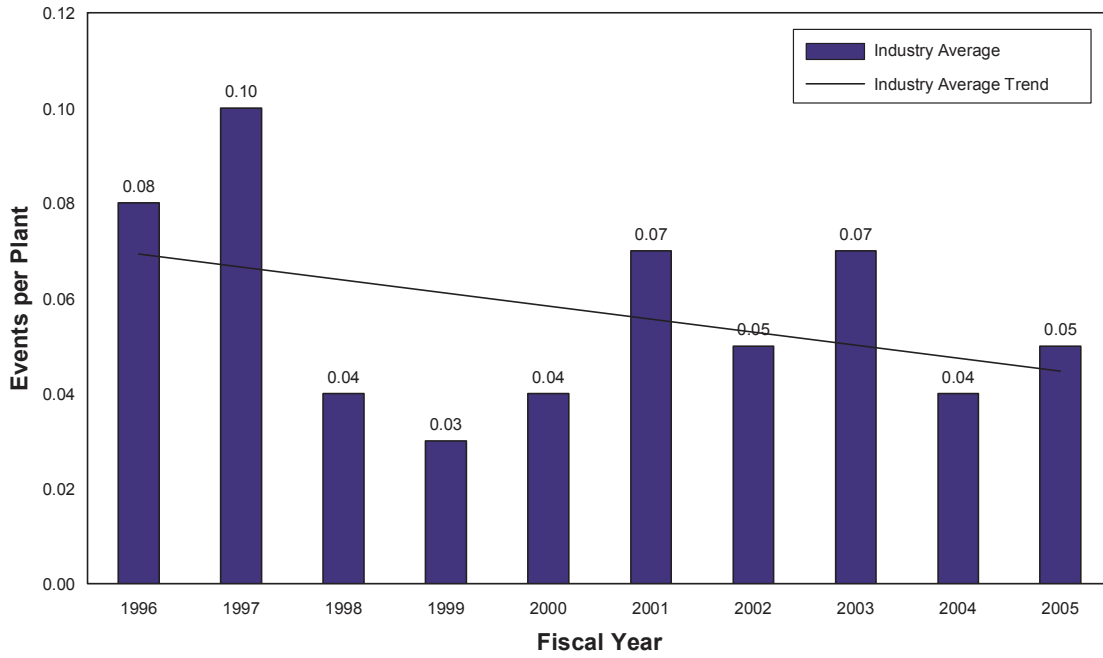


Safety System Failures

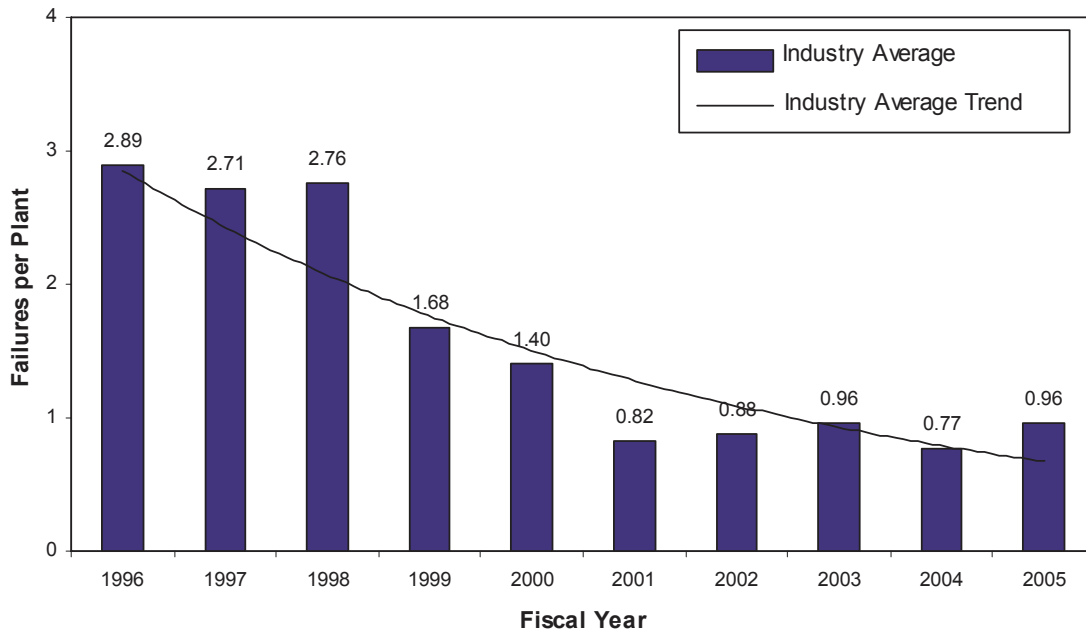


Forced Outage Rate (%)

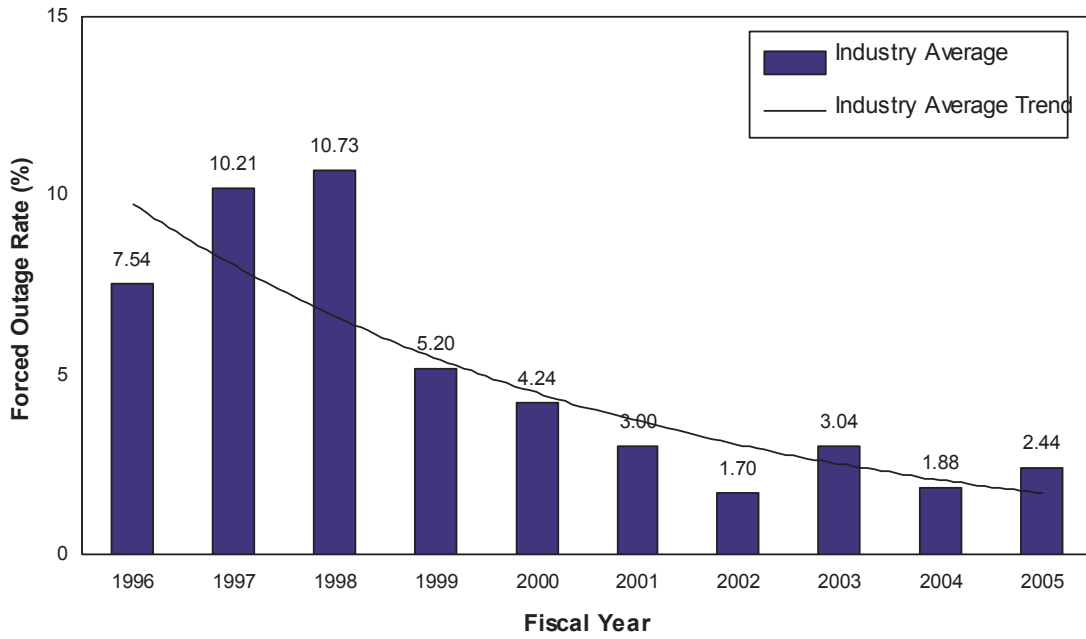


Equipment Forced Outages/ 1000 Commercial Critical Hours

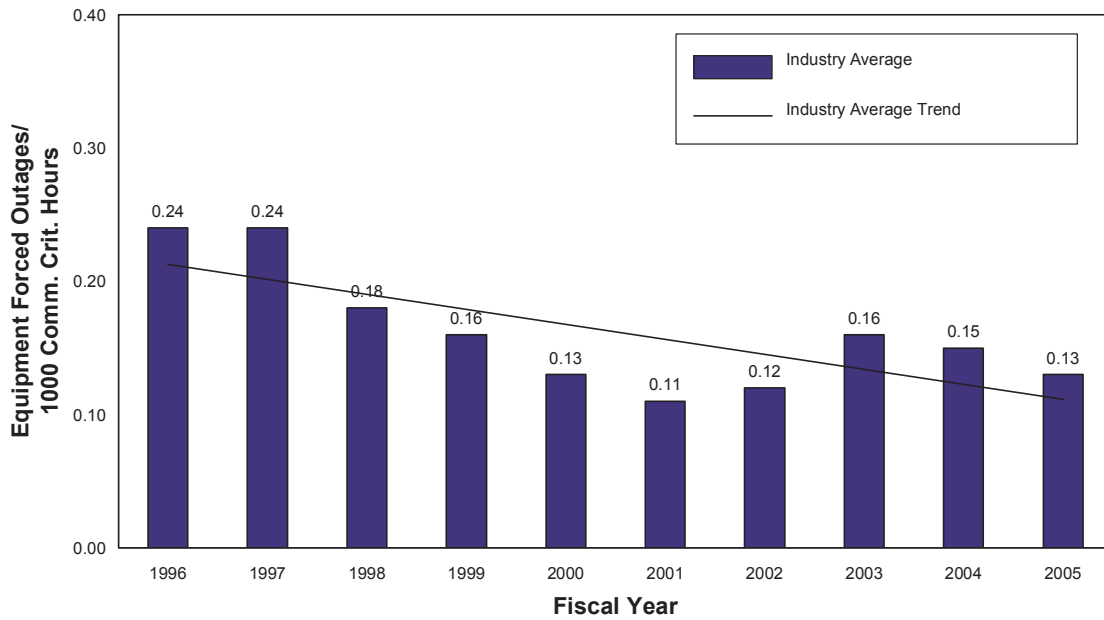


Collective Radiation Exposure

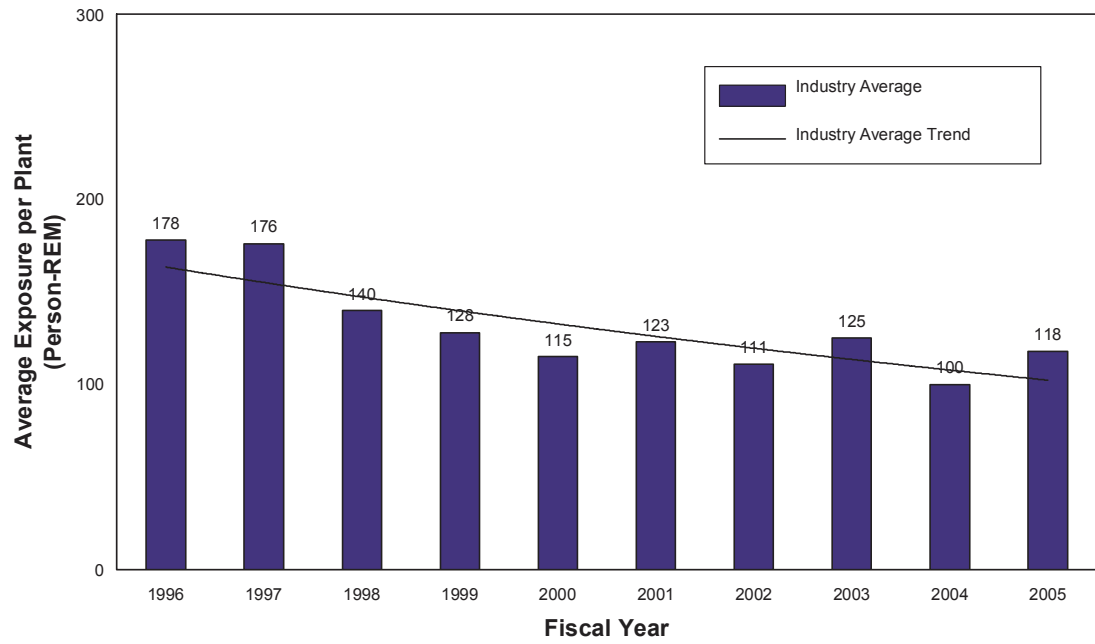


Unplanned Power Changes

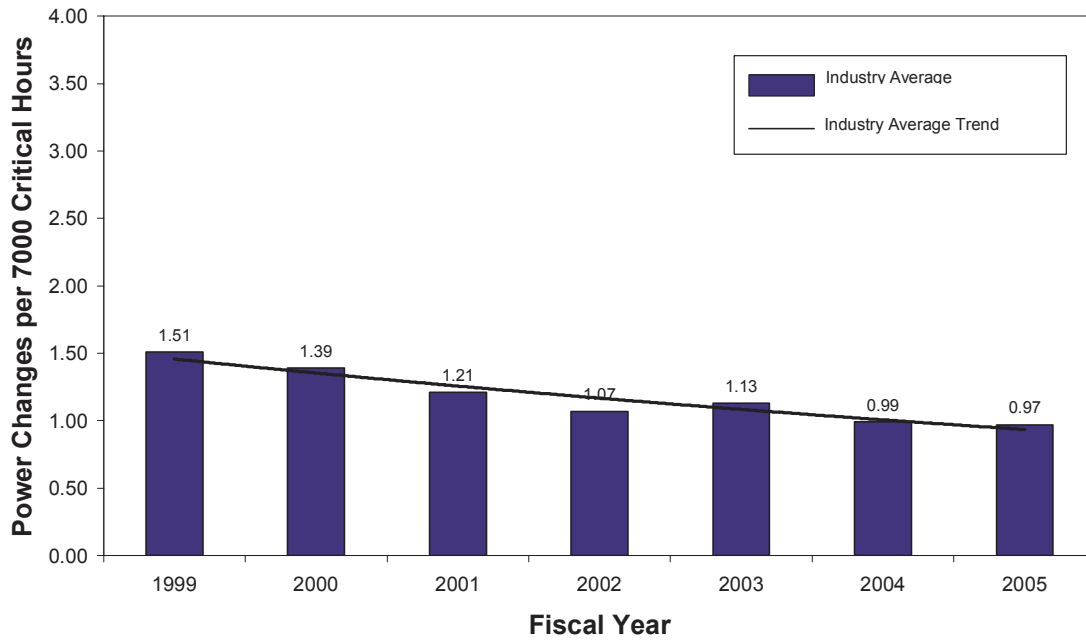


Reactor Coolant System Activity

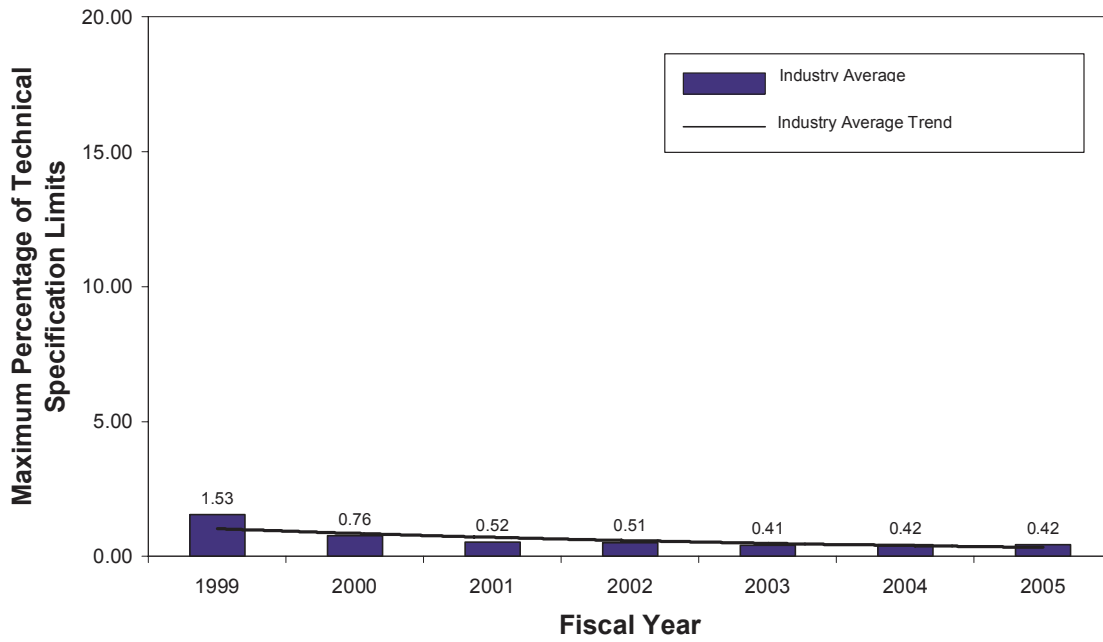


Reactor Coolant System Leakage

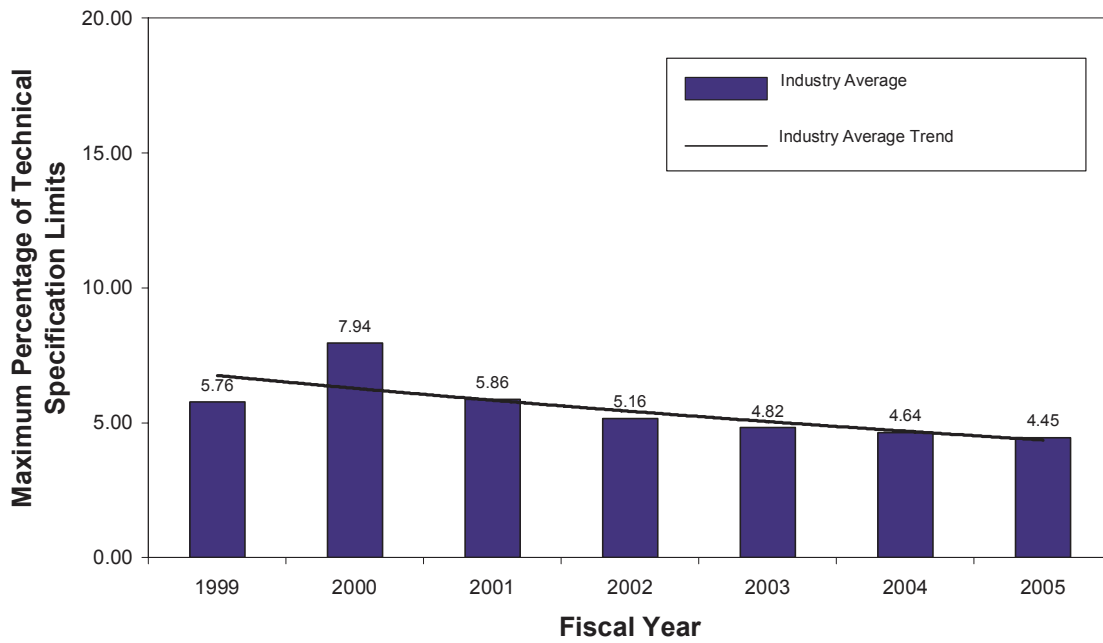

Drill/Exercise Performance


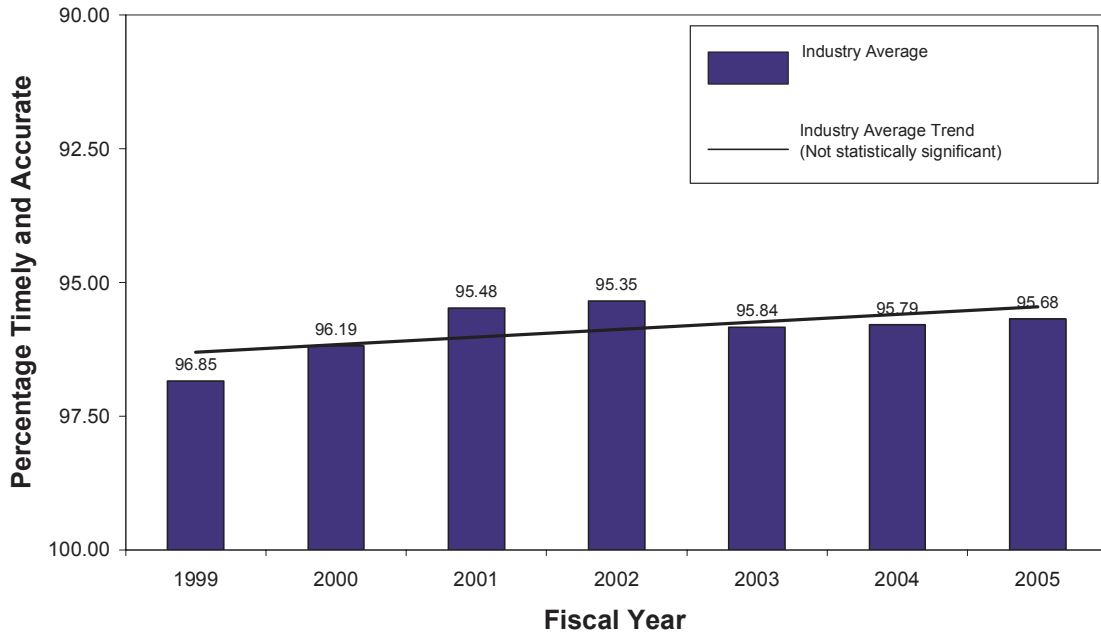


ERO Drill Participation

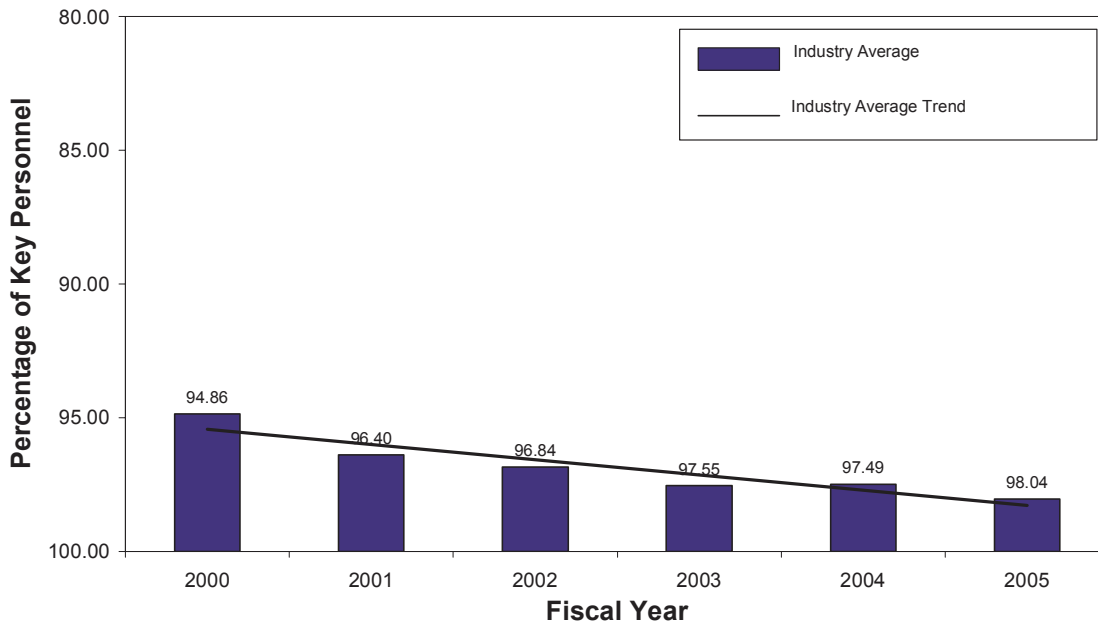

Note: Complete Fiscal Year 1999 Data not Available

Alert and Notification System Reliability

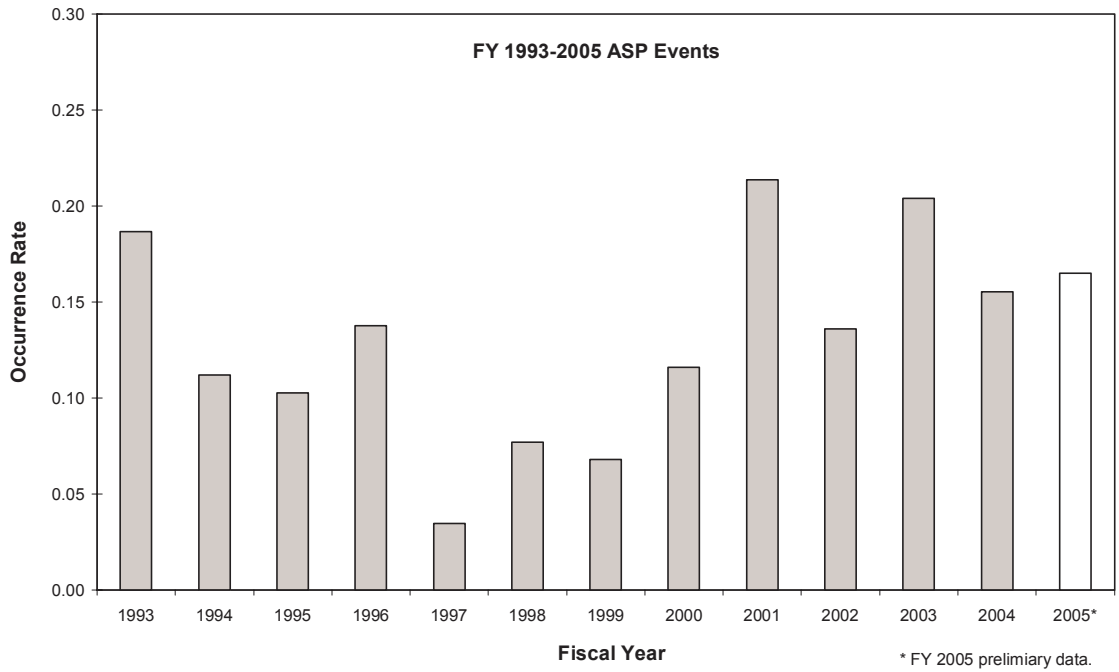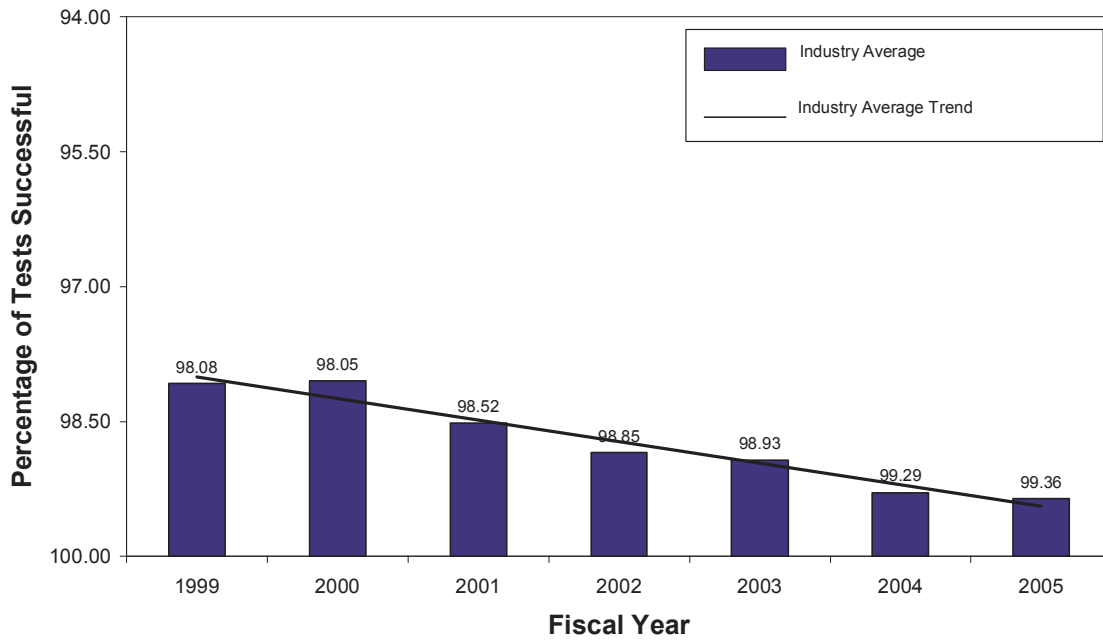

Total Precursors - occurrence rate by fiscal year. No trend line is shown because no trend was detected that was statistically significant.