

Appendix E

Applicant's Environmental Report

Operating License Renewal Stage

Indian Point Energy Center

Introduction

Entergy Nuclear Indian Point 2, LLC and Entergy Nuclear Indian Point 3, LLC (hereafter referred to as "Entergy") submits this Environmental Report (ER) in conjunction with the application to the U.S. Nuclear Regulatory Commission (NRC) to renew the operating licenses for Indian Point Units 2 and 3 (IP2 and IP3) for twenty years beyond the end of the current license terms. In compliance with applicable NRC requirements, this ER analyzes potential environmental impacts associated with renewal of the IP2 and IP3 Operating Licenses. This ER is designed to assist the NRC staff with the preparation of the IP2 and IP3 specific Supplemental Environmental Impact Statement (SEIS) required for license renewal.

The IP2 and IP3 ER is provided in accordance with 10 CFR 54.23, which requires license renewal applicants to submit a supplement to the ER that complies with the requirements of Subpart A of 10 CFR Part 51. This report also addresses the more detailed requirements of NRC environmental regulations in 10 CFR 51.45 and 10 CFR 51.53(c), as well as the intent of the National Environmental Policy Act (NEPA), 42 USC 4321 et seq. For major federal actions, NEPA requires federal agencies to prepare a detailed statement that evaluates environmental impacts, alternatives to the proposed action, and irreversible and irretrievable commitments of resources associated with implementation of the proposed action.

Entergy used Supplement 1 to Regulatory Guide 4.2, "Preparation of Supplemental Environmental Reports for Applications to Renew Nuclear Power Plant Operating Licenses," as guidance on the format and content of this ER. In addition, it utilized the Generic Environmental Impact Statement (GEIS) for License Renewal for Nuclear Plants (NUREG-1437) and Appendix B to 10 CFR Part 51 preparation of this report. The level of information provided on the various topics and issues in this ER are commensurate with the environmental significance of the particular topic or issue.

Based upon the evaluations discussed in this ER, Entergy concludes that the environmental impacts associated with renewal of the IP2 and IP3 Operating Licenses are small. No plant refurbishment activities have been identified as necessary to support the continued operation of IP2 and IP3 beyond the end of the existing operating license term. Ongoing plant operational and maintenance activities will be performed during the license renewal period for economic and operational reasons, but no significant environmental impacts associated with such activities are expected since established programs and procedures are in place to ensure that proper environmental screenings are conducted.

TABLE OF CONTENTS

1.0 PURPOSE AND NEED FOR THE PROPOSED ACTION	1-1
1.1 Environmental Report	1-1
1.2 Licensee and Ownership	1-1
2.0 SITE AND ENVIRONMENTAL INTERFACES	2-1
2.1 Location and Features	2-1
2.2 Aquatic and Riparian Ecological Communities	2-4
2.2.1 Physical and Chemical Environment	2-4
2.2.2 Plankton Communities	2-10
2.2.3 Macroinvertebrate Communities	2-11
2.2.4 Vascular Aquatic Plants	2-13
2.2.5 Fish Communities	2-13
2.3 Groundwater Resources	2-18
2.4 Terrestrial Habitats	2-19
2.4.1 State-Listed Critical or Important Habitats	2-22
2.4.2 Federal-Listed Critical or Important Habitats	2-23
2.5 Threatened or Endangered Species	2-23
2.6 Regional Demography	2-34
2.6.1 Regional Population	2-34
2.6.2 Minority and Low-Income Populations	2-40
2.6.2.1 Background	2-40
2.6.2.2 Minority Populations	2-40
2.6.2.3 Low-Income Populations	2-44
2.7 Taxes	2-45
2.8 Land Use Planning	2-47
2.8.1 Existing Land Use Trends	2-48
2.8.2 Future Land Use Trends	2-52
2.9 Housing	2-53
2.10 Social Services and Public Facilities	2-55
2.10.1 Public Water Supply	2-55
2.10.2 Transportation	2-59
2.10.2.1 Westchester and Putnam Counties	2-59
2.10.2.2 Rockland and Orange Counties	2-60
2.10.2.3 Dutchess County	2-60
2.10.3 Education	2-61
2.10.4 Transient Population	2-62
2.10.5 Migrant Farm Labor	2-62
2.10.6 Economy	2-63

2.10.6.1	Employment and Income	2-63
2.10.6.2	Unemployment	2-64
2.11	Meteorology and Air Quality	2-64
2.11.1	Meteorological System	2-66
2.11.1.1	Primary System	2-66
2.11.1.2	Backup Systems	2-67
2.11.2	Radiological Environmental Monitoring Program Air Sampling Program	2-67
2.12	Historic and Archaeological Resources	2-68
2.12.1	Prehistoric Era	2-69
2.12.2	Historic Era	2-70
2.12.3	Cultural Resource Properties	2-75
2.13	Related Federal Project Activities	2-81
2.14	References	2-82
3.0	THE PROPOSED ACTION	3-1
3.1	Description of the Proposed Action	3-1
3.2	General Plant Information	3-1
3.2.1	Reactor and Containment Systems	3-1
3.2.2	Cooling and Auxiliary Water Systems	3-2
3.2.2.1	Circulating Water System	3-2
3.2.2.2	Intake Structures	3-2
3.2.2.2.1	IP2	3-3
3.2.2.2.2	IP3	3-3
3.2.2.2.3	IP2 and IP3 Circulating System Operations	3-4
3.2.2.2.4	Service Water	3-4
3.2.2.3	Discharge Structures	3-5
3.2.3	Radioactive Waste Treatment Processes (Gaseous, Liquid, and Solid)	3-5
3.2.3.1	Liquid Waste Processing Systems and Effluent Controls	3-7
3.2.3.1.1	IP2	3-7
3.2.3.1.2	IP3	3-9
3.2.3.1.3	IP2 and IP3 Liquid Effluent Releases	3-11
3.2.3.2	Gaseous Waste Processing Systems and Effluent Controls	3-12
3.2.3.2.1	IP2	3-12
3.2.3.2.2	IP3	3-14
3.2.3.2.3	IP2 and IP3 Gaseous Effluent Releases	3-17
3.2.3.3	Solid Waste Processing	3-17
3.2.3.3.1	IP2 Facilities	3-18
3.2.3.3.2	IP3 Facilities	3-18
3.2.4	Transportation of Radioactive Materials	3-19
3.2.5	Nonradioactive Waste Systems	3-19
3.2.6	Maintenance, Inspection and Refueling Activities	3-22
3.2.7	Power Transmission Systems	3-22
3.3	Refurbishment Activities	3-23

3.4	Programs and Activities for Managing the Effects of Aging	3-24
3.5	Employment	3-24
3.6	References	3-36
4.0	ENVIRONMENTAL CONSEQUENCES OF PROPOSED ACTION	4-1
4.1	Water Use Conflicts	4-7
4.1.1	Description of Issue	4-7
4.1.2	Findings from Table B-1, Appendix B to Subpart A	4-7
4.1.3	Requirement [10 CFR 51.53(c)(3)(ii)(A)]	4-7
4.1.4	Analysis of Environmental Impact	4-7
4.2	Entrainment of Fish and Shellfish in Early Life Stages	4-7
4.2.1	Description of Issue	4-7
4.2.2	Findings from Table B-1, Appendix B to Subpart A	4-8
4.2.3	Requirement [10 CFR 51.53(c)(3)(ii)(B)]	4-8
4.2.4	Background	4-8
4.2.5	Analysis of Environmental Impact	4-8
4.2.5.1	Background	4-8
4.2.5.2	Entrainment Analysis	4-12
4.2.6	Conclusion	4-13
4.3	Impingement of Fish and Shellfish	4-13
4.3.1	Description of Issue	4-13
4.3.2	Findings from Table B-1, Appendix B to Subpart A	4-13
4.3.3	Requirement [10 CFR 51.53(c)(3)(ii)(B)]	4-13
4.3.4	Background	4-13
4.3.5	Analysis of Environmental Impact	4-14
4.3.5.1	Background	4-14
4.3.5.2	Impingement Analysis	4-17
4.3.6	Conclusion	4-19
4.4	Heat Shock	4-19
4.4.1	Description of Issue	4-19
4.4.2	Findings from Table B-1, Appendix B to Subpart A	4-19
4.4.3	Requirement [10 CFR 51.53(c)(3)(ii)(B)]	4-19
4.4.4	Background	4-19
4.4.5	Analysis of Environmental Impact	4-20
4.4.5.1	Background	4-20
4.4.5.2	Thermal Discharge Analysis	4-23
4.4.6	Conclusions	4-23
4.5	Groundwater Use Conflicts (Plants Using >100 gpm of Groundwater)	4-24
4.5.1	Description of Issue	4-24
4.5.2	Findings from Table B-1, Appendix B to Subpart A	4-24
4.5.3	Requirement [10 CFR 51.53(c)(3)(ii)(C)]	4-24
4.5.4	Analysis of Environmental Impact	4-24

4.6 Groundwater Use Conflicts (Plants Using Cooling Towers Withdrawing Make-Up Water from a Small River) 4-24

 4.6.1 Description of Issue 4-24

 4.6.2 Findings from Table B-1, Appendix B to Subpart A 4-24

 4.6.3 Requirement [10 CFR 51.53(c)(3)(ii)(A)] 4-25

 4.6.4 Analysis of Environmental Impact 4-25

4.7 Groundwater Use Conflicts (Plants Using Ranney Wells) 4-25

 4.7.1 Description of Issue 4-25

 4.7.2 Findings from Table B-1, Appendix B to Subpart A 4-25

 4.7.3 Requirement [10 CFR 51.53(c)(3)(ii)(C)] 4-25

 4.7.4 Analysis of Environmental Impact 4-25

4.8 Degradation of Groundwater Quality 4-26

 4.8.1 Description of Issue 4-26

 4.8.2 Findings from Table B-1, Appendix B to Subpart A 4-26

 4.8.3 Requirement [10 CFR 51.53(c)(3)(ii)(D)] 4-26

 4.8.4 Analysis of Environmental Impact 4-26

4.9 Impacts of Refurbishment on Terrestrial Resources 4-26

 4.9.1 Description of Issue 4-26

 4.9.2 Findings from Table B-1, Appendix B to Subpart A 4-26

 4.9.3 Requirement [10 CFR 51.53(c)(3)(ii)(E)] 4-26

 4.9.4 Analysis of Environmental Impact 4-26

4.10 Threatened or Endangered Species. 4-27

 4.10.1 Description of Issue 4-27

 4.10.2 Finding from Table B-1, Appendix B to Subpart A 4-27

 4.10.3 Requirement of 10 CFR 51.53(c)(3)(ii)(E) 4-27

 4.10.4 Background 4-27

 4.10.5 Analysis of Environmental Impact 4-27

 4.10.6 Conclusion 4-31

4.11 Air Quality During Refurbishment (Nonattainment and Maintenance Areas) 4-31

 4.11.1 Description of Issue 4-31

 4.11.2 Findings from Table B-1, Appendix B to Subpart A 4-32

 4.11.3 Requirement [10 CFR 51.53(c)(3)(ii)(F)] 4-32

 4.11.4 Analysis of Environmental Impact 4-32

4.12 Impact on Public Health of Microbiological Organisms 4-32

 4.12.1 Description of Issue 4-32

 4.12.2 Finding from Table B-1, Appendix B to Subpart A 4-32

 4.12.3 Requirement [10 CFR 51.53(c)(3)(ii)(G)] 4-32

 4.12.4 Background 4-33

 4.12.5 Analysis of Environmental Impact 4-33

4.13 Electromagnetic Fields - Acute Effects. 4-33

 4.13.1 Description of Issue 4-33

4.13.2 Findings from Table B-1, Subpart A, Appendix A	4-33
4.13.3 Requirements [10 CFR 51.53(c)(3)(ii)(H)]	4-34
4.13.4 Background	4-34
4.13.5 Analysis of Environmental Impact	4-34
4.13.6 Conclusion	4-35
4.14 Housing Impacts	4-35
4.14.1 Description of Issue	4-35
4.14.2 Findings from Table B-1, Appendix B to Subpart A	4-36
4.14.3 Requirement [10 CFR 51.53(c)(3)(ii)(I)]	4-36
4.14.4 Background	4-36
4.14.5 Analysis of Environmental Impact	4-36
4.14.6 Conclusion	4-37
4.15 Public Utilities; Public Water Supply Availability	4-37
4.15.1 Description of Issue	4-37
4.15.2 Findings from Table B-1, Appendix B to Subpart A	4-37
4.15.3 Requirement [10 CFR 51.53(c)(3)(ii)(I)]	4-37
4.15.4 Background	4-38
4.15.5 Analysis of Environmental Impact	4-38
4.15.6 Conclusion	4-39
4.16 Education Impacts from Refurbishment	4-39
4.16.1 Description of Issue	4-39
4.16.2 Findings from Table B-1, Appendix B to Subpart A	4-39
4.16.3 Requirement [10 CFR 51.53(c)(3)(ii)(I)]	4-39
4.16.4 Analysis of Environmental Impact	4-39
4.17 Offsite Land Use—Refurbishment	4-40
4.17.1 Description of Issue	4-40
4.17.2 Findings from Table B-1, Appendix B to Subpart A	4-40
4.17.3 Requirement [10 CFR 51.53(c)(3)(ii)(I)]	4-40
4.17.4 Analysis of Environmental Impact	4-40
4.18 Offsite Land Use—License Renewal Term	4-40
4.18.1 Description of Issue	4-40
4.18.2 Findings from Table B-1, Appendix B to Subpart A	4-40
4.18.3 Requirement [10 CFR 51.53(c)(3)(ii)(I)]	4-40
4.18.4 Background	4-40
4.18.5 Analysis of Environmental Impact	4-41
4.18.5.1 Population-Driven Land Use Changes	4-42
4.18.5.2 Tax-Driven Land Use Changes	4-42
4.18.6 Conclusion	4-42
4.19 Transportation	4-43
4.19.1 Description of Issue	4-43
4.19.2 Findings from Table B-1, Appendix B to Subpart A	4-43
4.19.3 Requirement [10 CFR 51.53(c)(3)(ii)(J)]	4-43

4.19.4	Background	4-43
4.19.5	Analysis of Environmental Impact	4-43
4.19.6	Conclusion	4-44
4.20	Historic and Archaeological Properties	4-44
4.20.1	Description of Issue	4-44
4.20.2	Finding from Table B-1, Appendix B to Subpart A	4-45
4.20.3	Requirement [10 CFR 51.53(c)(3)(ii)(K)]	4-45
4.20.4	Background	4-45
4.20.5	Analysis of Environmental Impact	4-45
4.20.6	Conclusion	4-47
4.21	Severe Accident Mitigation Alternatives	4-47
4.21.1	Description of Issue	4-47
4.21.2	Finding from Table B-1, Appendix B to Subpart A	4-47
4.21.3	Requirement [10 CFR 51.53(c)(3)(ii)(L)]	4-47
4.21.4	Background	4-47
4.21.5	Analysis of Environmental Impact	4-48
4.21.5.1	Establish the Baseline Impacts of a Severe Accident	4-50
4.21.5.1.1	The PSA Internal Events Model: Level 1 and Level 2 Analysis	4-51
4.21.5.1.2	The PSA External Events Model: Individual Plant Examination of External Events (IPEEE) Model	4-51
4.21.5.1.3	MACCS2 Model: Level 3 Analysis	4-52
4.21.5.1.4	Evaluation of Baseline Severe Accident Impacts Using the Regulatory Analysis Technical Evaluation Handbook Method	4-53
4.21.5.2	Identify SAMA Candidates	4-62
4.21.5.3	Preliminary Screening (Phase I)	4-62
4.21.5.4	Final Screening and Cost/Benefit Evaluation (Phase II)	4-63
4.21.5.5	Sensitivity Analyses	4-71
4.21.6	Conclusion	4-72
4.22	Environmental Justice	4-79
4.22.1	Description of Issue	4-79
4.22.2	Finding from Table B-1, Appendix B to Subpart A	4-79
4.22.3	Requirement	4-79
4.22.4	Background	4-79
4.22.5	Analysis	4-79
4.22.6	Conclusion	4-80
4.23	Cumulative Impacts	4-80
4.23.1	Cumulative Impacts on Aquatic Resources	4-80
4.23.2	Cumulative Impacts on Terrestrial Resources	4-83
4.23.3	Cumulative Radiological Impacts	4-85
4.23.4	Cumulative Socioeconomics Impacts	4-86
4.23.5	Cumulative Impacts on Groundwater Use and Quality	4-87
4.23.6	Conclusion	4-88
4.24	References	4-89

5.0 ASSESSMENT OF NEW AND SIGNIFICANT INFORMATION	5-1
5.1 New and Significant Information: Groundwater Contamination	5-2
5.2 References	5-6
6.0 SUMMARY OF LICENSE RENEWAL IMPACTS AND MITIGATING ACTIONS	6-1
6.1 License Renewal Impacts	6-1
6.2 Mitigation	6-1
6.2.1 Requirement [10 CFR 51.45(c)]	6-1
6.2.2 Entergy Response	6-1
6.3 Unavoidable Adverse Impacts	6-4
6.3.1 Requirement [10 CFR 51.45(b)(2)]	6-4
6.3.2 Entergy Response	6-5
6.4 Irreversible or Irrecoverable Resource Commitments	6-5
6.4.1 Requirement [10 CFR 51.45(b)(5)]	6-5
6.4.2 Entergy Response	6-5
6.5 Short-term Use Versus Long-term Productivity	6-6
6.5.1 Requirement [10 CFR 51.45(b)(4)]	6-6
6.5.2 Entergy Response	6-6
6.6 References	6-7
7.0 ALTERNATIVES CONSIDERED	7-1
7.1 Introduction	7-1
7.2 Proposed Action	7-1
7.3 No-Action Alternative	7-1
7.4 Decommissioning Impacts	7-2
7.5 Alternative Energy Sources	7-3
7.6 References	7-6
8.0 COMPARISON OF IMPACTS	8-1
8.1 Closed-Cycle Cooling Alternative	8-1
8.1.1 Environmental Impacts of the Closed-Cycle Cooling Alternative	8-8
8.1.1.1 Land Use	8-8
8.1.1.2 Ecology	8-9
8.1.1.2.1 Aquatic Ecology	8-9
8.1.1.2.2 Terrestrial Ecology	8-10
8.1.1.3 Water Use and Quality	8-11
8.1.1.3.1 Surface Water	8-11
8.1.1.3.2 Groundwater	8-12
8.1.1.4 Air Quality	8-13
8.1.1.5 Waste	8-13
8.1.1.6 Human Health	8-14

8.1.1.7	Socioeconomics	8-14
8.1.1.8	Aesthetics	8-15
8.1.1.9	Noise	8-16
8.1.1.10	Historic and Archaeological Resources	8-18
8.1.1.11	Conclusion	8-18
8.2	Comparison of Environmental Impacts for Reasonable Generation Alternatives.	8-20
8.2.1	Coal-Fired Generation	8-20
8.2.1.1	Closed-Cycle Cooling System	8-21
8.2.1.1.1	Land Use	8-21
8.2.1.1.2	Ecology	8-21
8.2.1.1.3	Water Use and Quality	8-22
8.2.1.1.4	Air Quality	8-22
8.2.1.1.5	Waste	8-23
8.2.1.1.6	Human Health	8-24
8.2.1.1.7	Socioeconomics	8-24
8.2.1.1.8	Aesthetics	8-25
8.2.1.1.9	Historic and Archaeological Resources	8-25
8.2.1.2	Once-Through Cooling System	8-31
8.2.2	Natural Gas-Fired Generation	8-32
8.2.2.1	Closed-Cycle Cooling System	8-32
8.2.2.1.1	Land Use	8-32
8.2.2.1.2	Ecology	8-35
8.2.2.1.3	Water Use and Quality	8-36
8.2.2.1.4	Air Quality	8-36
8.2.2.1.5	Waste	8-37
8.2.2.1.6	Human Health	8-37
8.2.2.1.7	Socioeconomics	8-38
8.2.2.1.8	Aesthetics	8-38
8.2.2.1.9	Historic and Archaeological Resources	8-39
8.2.2.2	Once-Through Cooling System	8-41
8.2.3	Nuclear Power Generation	8-43
8.2.3.1	Closed-Cycle Cooling System	8-43
8.2.3.1.1	Land Use	8-43
8.2.3.1.2	Ecology	8-44
8.2.3.1.3	Water Use and Quality	8-44
8.2.3.1.4	Air Quality	8-44
8.2.3.1.5	Waste	8-45
8.2.3.1.6	Human Health	8-45
8.2.3.1.7	Socioeconomics	8-45
8.2.3.1.8	Aesthetics	8-46
8.2.3.1.9	Historic and Archaeological Resources	8-46
8.2.3.2	Once-Through Cooling System	8-48
8.2.4	Purchased Electrical Power	8-49

8.3	Alternative Generation Not Within the Range of Reasonable Alternatives.	8-50
8.3.1	Wind	8-50
8.3.2	Solar	8-52
8.3.3	Hydropower	8-52
8.3.4	Geothermal	8-53
8.3.5	Wood Energy	8-53
8.3.6	Municipal Solid Waste	8-54
8.3.7	Other Biomass-Derived Fuels	8-54
8.3.8	Oil	8-54
8.3.9	Fuel Cells	8-55
8.3.10	Delayed Retirement	8-55
8.3.11	Utility-Sponsored Conservation	8-55
8.3.12	Combination of Alternatives	8-56
8.4	Proposed Action vs. No-Action.	8-57
8.4.1	Energy Replacement Feasibility.	8-57
8.4.2	Replacement and Siting Suitability Problems	8-58
8.4.3	Impacts.	8-58
8.4.3.1	Fish	8-58
8.4.3.2	Air Emissions	8-59
8.4.3.2.1	Carbon Dioxide Emissions and Global Warming	8-62
8.4.3.3	Socioeconomic Impact	8-63
8.5	Summary	8-66
8.6	References	8-68
9.0	STATUS OF COMPLIANCE	9-1
9.1	Requirement [10 CFR 51.45(d)]	9-1
9.2	Environmental Permits	9-1
9.3	Coastal Zone Management Program Compliance	9-1
9.4	Water Quality (401) Certification	9-2
9.5	Environmental Permits—Discussion of Compliance	9-2
9.6	References	9-14

LIST OF TABLES

Table 1-1	Environmental Report Responses to License Renewal Environmental Regulatory Requirements	1-2
Table 2-1	State Parks in Westchester, Rockland, Putnam, Orange, and Dutchess Counties	2-2
Table 2-2	Registered USGS Wells within One Mile of IP2 and IP3	2-19
Table 2-3	IP2 and IP3 Land Cover	2-21
Table 2-4	Federal and New York State Protected** Species	2-26
Table 2-5	State and County Population, 50-Mile Radius of IP2 and IP3.	2-36
Table 2-6	Putnam County (NY), Rockland County (NY), Orange County (NY), Westchester County (NY), and Dutchess County (NY) Population Growth, 1990–2035.	2-39
Table 2-7A	Minority Census Block Counts within 50-Mile Radius.	2-42
Table 2-7B	Minority Populations Evaluated Against Criterion	2-43
Table 2-8	Low-Income Population Criteria Using Two Geographic Areas	2-45
Table 2-9	Tax Distribution, 2003–2006	2-46
Table 2-10	Dutchess County (NY), Orange County (NY), Putnam County (NY), Rockland County (NY), and Westchester County (NY) Land Use 1992 Land Use Type (%)	2-50
Table 2-11	Dutchess County (NY), Orange County (NY), Putnam County (NY), Rockland County (NY), and Westchester County (NY) Housing Statistics, 1990–2000 . .	2-54
Table 2-12	Major Community Water Supply Systems Within the Area.	2-58

Table 2-13
 Average Annual Daily Traffic Counts on US 9 Near the Site, 1996-2004 2-60

Table 2-14
 Listed Historic Sites Located in the Vicinity (6-Mile Radius) of IP2 and IP3 2-75

Table 3-1
 Nonradioactive Waste Generation (Typical) 3-21

Table 3-2
 Employee Residence Information (June 2006) 3-24

Table 4-1
 Category 1 Issues Not Applicable to IP2 and IP3 4-2

Table 4-2
 Category 1 Issues Applicable to IP2 and IP3 4-3

Table 4-3
 Estimated Present Dollar Value Equivalent of Internal Events CDF at
 IP2 and IP3 4-62

Table 4-4
 IP2 Final SAMAs 4-74

Table 4-5
 IP3 Final SAMAs 4-77

Table 6-1
 Environmental Impacts Related to License Renewal at IP2 and IP3 6-2

Table 8-1
 Cumulative Sound Levels and Sensitive Receptors (dB(A)) 8-17

Table 8-2
 Summary of Environmental Impacts from Once-Through Cooling Compared to
 Closed-Cycle Cooling at Indian Point 8-19

Table 8-3
 Coal-Fired Alternative Emission Control Characteristics 8-26

Table 8-4
 Air Emissions from Coal-Fired Alternative 8-27

Table 8-5
 Solid Waste from Coal-Fired Alternative 8-28

Table 8-6
 Summary of Environmental Impacts from Coal-Fired Generation
 Using Closed-Cycle Cooling at an Alternate Greenfield Site 8-29

Table 8-7	Summary of Environmental Impacts from Coal-Fired Generation Using Once-Through Cooling at an Alternate Greenfield Site	8-31
Table 8-8	Gas-Fired Alternative Emission Control Characteristics	8-34
Table 8-9	Air Emissions from Gas-Fired Alternative	8-35
Table 8-10	Summary of Environmental Impacts from Gas-Fired Generation Using Closed-Cycle Cooling	8-40
Table 8-11	Summary of Environmental Impacts from Gas-Fired Generation Using Once-Through Cooling	8-42
Table 8-12	Summary of Environmental Impacts from Nuclear Power Generation Using Closed-Cycle Cooling at Alternate Greenfield Site	8-47
Table 8-13	Summary of Environmental Impacts from Nuclear Power Generation Using Once-Through Cooling at Alternate Greenfield Site	8-49
Table 8-14	Indicative New York State Air Emissions Impacts.	8-59
Table 8-15	Average Change in Market Energy Prices	8-66
Table 9-1	IP2 and IP3 Environmental Permits and Compliance Status	9-8
Table 9-2	Environmental Consultations Related to License Renewal.	9-13

LIST OF FIGURES

Section 2 Figures	2-93
Figure 3-1 Indian Point Facility	3-37
Figure 3-2 Indian Point Intake Structures	3-38
Figure 3-3 IP2 Cooling Water System	3-39
Figure 3-4 IP2 Intake System	3-40
Figure 3-5 IP3 Cooling Water System	3-41
Figure 3-6 IP3 Intake System	3-42
Figure 3-7 Indian Point Discharge Canal System	3-43
Figure 3-8 Indian Point Discharge Structure	3-44
Figure 3-9 IP2 Fish Return System	3-45
Figure 8-1 NO _x Emissions Under Base Case and License Renewal Scenarios	8-61
Figure 8-2 Total Economic Impact to the County by Scenario (\$ millions)	8-64
Figure 8-3 Total Economic Impact to the State by Scenario (\$ millions).	8-65

LIST OF ATTACHMENTS

- [Attachment A](#) Threatened and Endangered Species Correspondence
- [Attachment B](#) Historical and Archaeological Properties Correspondence
- [Attachment C](#) Clean Water Act Documentation
- [Attachment D](#) Coastal Management Program Consistency Determination
- [Attachment E](#) Severe Accident Mitigation Alternatives (SAMA) Analysis

ACRONYMS AND ABBREVIATIONS

AC	alternating current
ADV	atmospheric dump valve
AFW	auxiliary feedwater
ALARA	as low as reasonably achievable
AMSAC	Anticipated Transient without SCRAM mitigating system actuation circuitry
ASMFC	Atlantic State Marine Fisheries Commission
ANO-2	Arkansas Nuclear One - Unit 2
ASSS	alternate safe shutdown system
ATWS	anticipated transient without scram
BACT	best available control technology
BNL	Brookhaven National Laboratory
BSS	Beach Seine Survey
Btu	British thermal unit
°C	degrees Celsius
CAA	Clean Air Act
CaO	calcium oxide
CaSO ₄ 2H ₂ O	calcium sulfate dihydrate
cc	cubic centimeter
CCW	component cooling water
CDF	core damage frequency
CEQ	Council on Environmental Quality
CET	containment event tree
cfm	cubic feet per minute
CFR	Code of Federal Regulations
cfy	cubic feet per year
CHGEC	Central Hudson Gas & Electric Corporation

Acronyms and Abbreviations (continued)

Ci/ml	curies per milliliter
cm ²	square centimeter
CMR	conditional mortality rate
CNP	Cook Nuclear Plant
CO	carbon monoxide
CO ₂	carbon dioxide
COE	cost of enhancement
CSD	Central School District
Csi	cesium iodide
ConEdison	Consolidated Edison Company of New York, Inc.
CVCS	chemical and volume control system
CWA	Clean Water Act
CWIS	circulating intake water structure
DAW	dry active waste
dB(A)	decibel weighted
DEIS	Draft Environmental Impact Statement
DC	direct current
DCH	direct containment heating
DOE	U.S. Department of Energy
DOT	Department of Transportation
DPR	demonstration project reactor
EA	Environmental Assessment
ECL	Environmental Conservation Law
ECCS	emergency core cooling system
EDG	emergency diesel generator
EEL	Edison Electric Institute

Acronyms and Abbreviations (continued)

EIA	Energy Information Administration
EIS	Environmental Impact Statement
ENN	Entergy Nuclear Northeast
EPA	Environmental Protection Agency
EPRI	Electric Power Research Institute
EPZ	emergency planning zone
ESA	Endangered Species Act
ER	Environmental Report
ESBWR	Economic Simplified Boiling Water Reactor
ESRI	Environmental Systems Research Institute
°F	degrees Fahrenheit
FEMA	Federal Emergency Management Agency
FES	Final Environmental Statement
FEIS	Final Environmental Impact Statement
FIVE	fire induced vulnerability event
fps	feet per second
FSB	Fuel Storage Building
FSS	Fall Shoals Survey
ft	feet
ft ³	cubic feet
GE	General Electric
GEIS	Generic Environmental Impact Statement
GIS	Geographical Information System
gpd	gallons per day
gpm	gallons per minute
GSA	gamma spectroscopy analysis

Acronyms and Abbreviations (continued)

HEPA	high efficiency particulate air filters
HPME	high pressure melt ejection
HRA	human reliability analysis
HRSA	Hudson River Settlement Agreement
HVAC	heating, ventilating, and air conditioning
Hz	hertz
IP1	Indian Point Unit 1
IP2	Indian Point Unit 2
IP3	Indian Point Unit 3
IPE	Individual Plant Examination
IPEC	Indian Point Energy Center
IPEEE	Individual Plant Examination of External Events
ISFSI	independent spent fuel storage installation
ISFSSI	interim spent fuel storage slab installation
ISLOCA	interfacing system loss of coolant accident
ISO	International Standards Organization
IVSWS	Isolation Valve Seal Water System
kg	kilogram
KTONS	kilotons
km	kilometer
km ²	square kilometer
Kr	krypton
kV	kilovolts
kW	kilowatt
kWh	kilowatt-hour
lb	pound

Acronyms and Abbreviations (continued)

LERF	large early release frequency
LIOWP	Long Island Offshore Wind Park, LLC
LNG	liquefied natural gas
LOCA	loss of coolant accident
LOS	level of service
LRS	Longitudinal River Survey
LWR	light water reactor
m	meters
m ³	cubic meter
mA	milliamperes
MAAP	modular accident analysis program
MACCS2	Melcor Accident Consequences Code System 2
μc	microcuries
MCC	motor control center
MFTDS	Modular Fluidized Transfer Demineralization and Sluice System
mgd	million gallons per day
μg/l	micrograms/liter
mg/l	milligrams per liter
mgy	million gallons per year
mGy	milligray (a unit for absorbed dose)
mho	milliohm
ml	milliliter
mlw	mean low water
MM	million
MMS	Minerals Management Services
MMBtu	million British thermal unit

Acronyms and Abbreviations (continued)

MOV	motor-operated valve
mph	miles per hour
mrad	millirad
mrem	millirem
MSIV	main steam isolation valve
MSL	mean sea level
mSv	millisievert
MT	metric ton
MW	megawatt
MWD/MTU	megawatt-days per metric tonne
MWD/T	megawatt day/ton
MWe	megawatts, electric
MWh	megawatt, hour
MWt	megawatts, thermal
N-16	Nitrogen-16
NA	not applicable
NASS	National Agricultural Statistics Service
NCF	no containment failure
NEI	Nuclear Energy Institute
NEPA	National Environmental Policy Act
NESC	National Electrical Safety Code
NMFS	National Marine Fisheries Service
NNE	nitrogen to nuclear equipment
NO _x	nitrogen oxides
NPDES	National Pollutant Discharge Elimination System
NRC	Nuclear Regulatory Commission

Acronyms and Abbreviations (continued)

NRHP	National Register of Historic Places
NRR	(Office of) Nuclear Reactor Regulation
NSPS	New Source Performance Standard
NSR	New Source Review
NUREG	U.S. Nuclear Regulatory Commission Document
NWJWW	Northern Westchester Joint Water Works
NYOSPRHP	New York Office of State Parks, Recreation, and Historic Preservation
NYS	New York State
NYSDOS	New York State Department of State
NYCRR	New York Code of Rules and Regulations
NYNHP	New York Natural Heritage Program
NYPA	New York Power Authority
NYPSC	New York Public Service Commission
NYRHP	New York Register of Historic Places
NYSDEC	New York State Department of Environmental Conservation
NYSDOT	New York State Department of Transportation
NYSERDA	New York State Energy Research and Development Authority
ODCM	Offsite Dose Calculation Manual
OECR	offsite economic cost risk
OSGSF	Original Steam Generator Storage Facility
OL	Operating License
PAB	primary auxiliary building
PCB	polychlorinated biphenyl
PDR	population dose risk
PDS	plant damage states
PILOT	Payment-in-Lieu-of-Taxes
PJM	Pennsylvania - New Jersey - Maryland

Acronyms and Abbreviations (continued)

PM _{2.5}	particulates having diameter less than 2.5 microns
PM ₁₀	particulates having diameter less than 10 microns
PORV	pressure-operated relief valve
ppm	parts per million
PRA	probabilistic risk assessment
PSA	probabilistic safety assessment
PSD	prevention of significant deterioration
psig	pounds per square inch
PWR	pressurized water reactor
PWS	public water system
PYSL	post yolk-sac larvae
RAI	request for additional information
RCDT	reactor coolant drain tank
RCP	reactor coolant pump
RCS	reactor coolant system
rem	roentgen equivalent man
REMP	radiological environmental monitoring program
RHR	residual heat removal
RM	river mile
RMP	Risk Management Plan
ROI	region of interest
ROW	right-of-way
RHR	residual heat removal
RRW	risk reduction worth
RWST	refueling water storage tank
ry	reactor year

Acronyms and Abbreviations (continued)

S	sulfur
SAFSTOR	Safe Storage for Subsequent Decommissioning
SAMA	severe accident mitigation alternative
SAMDA	severe accident mitigation design alternative
SB	class B saline
SBO	station blackout
scfm	standard cubic foot per minute
SCDHEC	South Carolina Department of Health and Environmental Control
SCR	selective catalytic reduction
SEIS	Supplemental Environmental Impact Statement
SEQRA	State Environmental Quality Review Act
SFA	spent fuel assemblies
SFP	Spent Fuel Pool
SGTR	steam generator tube rupture
SHPO	State Historic Preservation Officer
SI	safety injection
SMSA	Standard Metropolitan Statistical Area
SO ₂	sulfur dioxide
SO _x	oxides of sulfur
SPDES	State Pollutant Discharge Elimination System
SPHINX	State Preservation Historical Information Network Exchange
TDEC	Tennessee Department of Environment and Conservation (Division of Radiological Health)
TDH	total design head
TSP	total suspended particulates
TVA	Tennessee Valley Authority
UWNY	United Water New York

Acronyms and Abbreviations (continued)

U.S.	United States
USAEC	U.S. Atomic Energy Commission
USC	United States Code
USCB	U.S. Census Bureau
USCOE	United States Corp of Engineers
USDA	U.S. Department of Agriculture
USFWS	U.S. Fish and Wildlife Service
USGS	U.S. Geological Survey
USWAG	Utility Solid Waste Activities Group
V	volts
WCCPPS	Weld Channel and Containment Penetration Pressurization System
WCDOH	Westchester County Department of Health
WDS	Waste Disposal System
WJWW	Westchester Joint Water Works
WOG	Westinghouse Owner's Group
Xe	xenon
yd ²	square yards
yr	year
YOY	young-of-year
YSL	yolk-sac-larvae

1.0 PURPOSE AND NEED FOR THE PROPOSED ACTION

For license renewal the NRC has adopted the following definition of purpose and need, stated in Section 1.3 of NUREG-1437, *Generic Environmental Impact Statement for License Renewal of Nuclear Power Plants*: "The purpose and need for the proposed action (renewal of an operating license) is to provide an option that allows for power generation capability beyond the term of a current nuclear power plant operating license to meet future system generating needs, as such needs may be determined by State, utility, and, where authorized, Federal (other than NRC) decision makers."

Nuclear power plants are licensed by the NRC to operate up to 40 years, and the licenses may be renewed [10 CFR 50.51] for periods up to 20 years. 10 CFR 54.17(c) states, "[a]n application for a renewed license may not be submitted to the Commission earlier than 20 years before the expiration of the operating license currently in effect."

The proposed action is to renew the operating licenses for IP2 and IP3 for a period of twenty (20) years beyond the current operating licenses' expiration dates. For IP2 (Facility Operating License DPR-26), the requested renewal would extend the existing license expiration date from midnight, September 28, 2013 until midnight, September 28, 2033. For IP3 (Facility Operating License DPR-64), the requested renewal would extend the existing license expiration date from midnight, December 12, 2015 to midnight, December 12, 2035.

1.1 Environmental Report

NRC regulation 10 CFR 51.53(c) requires that an applicant for license renewal submit with its application a separate document entitled, "Applicant's Environmental Report - Operating License Renewal Stage." This appendix to the IP2 and IP3 license renewal application fulfills that requirement.

Entergy has prepared [Table 1-1](#) to document, in checklist form, that the 10 CFR Part 51 requirements for information to be provided in an ER in support of a license renewal application have been met. The requirements regarding information to be included in an ER are codified at 10 CFR 51.45 and 51.53(c). Table 1-1 provides the 10 CFR 51 regulatory language and regulatory citation, along with the ER section(s) that satisfy the 10 CFR 51 requirements.

1.2 Licensee and Ownership

By NRC order dated September 6, 2001, Con Edison's ownership and operation of Indian Point IP1 and IP2 was transferred to Entergy Nuclear Indian Point 2, LLC, as the owner of IP1 and IP2, and Entergy Nuclear Operations, Inc. as the operator of IP2 and maintainer of IP1.

By NRC order dated November 9, 2000, New York Power Authority's (NYPA) ownership and operation of IP3 was transferred to Entergy Nuclear Indian Point 3, LLC, as the owner of Indian Point IP3, and Entergy Nuclear Operations, Inc. as the operator of IP3.

For the purposes of this ER, Entergy Nuclear Indian Point 2, LLC, Entergy Nuclear Indian Point 3, LLC, and Entergy Nuclear Operations, Inc., who are submitting this application to the NRC, are collectively referred to as "Entergy".

**Table 1-1
Environmental Report Responses to License Renewal
Environmental Regulatory Requirements**

Description	Requirement	ER Section(s)
<i>Environmental Reports - General Requirements [10 CFR 51.45]</i>		
Environmental report contains a description of the proposed action.	10 CFR 51.45(b)	3.0
Environmental report contains a statement of the purposes of the proposed action.	10 CFR 51.45(b)	1.0
Environmental report contains a description of the environment affected.	10 CFR 51.45(b)	2.0
Environmental report discusses the impact of the proposed action on the environment.	10 CFR 51.45(b)(1)	4.0
Environmental report discusses any adverse environmental effects which cannot be avoided should the proposal be implemented.	10 CFR 51.45(b)(2)	6.3
Environmental report discusses alternatives to the proposed action.	10 CFR 51.45(b)(3)	7.0 and 8.0
Environmental report discusses the relationship between local short-term uses of man's environment and the maintenance and enhancement of long-term productivity.	10 CFR 51.45(b)(4)	6.5
Environmental report discusses any irreversible and irretrievable commitments of resources which would be involved in the proposed action should it be implemented.	10 CFR 51.45(b)(5)	6.4
Environmental report includes an analysis that considers and balances the environmental effects of the proposed action, the environmental impacts of alternatives to the proposed action, and alternatives available for reducing or avoiding adverse environmental effects.	10 CFR 51.45(c)	4.0, 6.0, 7.0, and 8.0

**Table 1-1
Environmental Report Responses to License Renewal
Environmental Regulatory Requirements**

Description	Requirement	ER Section(s)
Environmental report lists all Federal permits, licenses, approvals and other entitlements which must be obtained in connection with the proposed action and describes the status of compliance with these requirements.	10 CFR 51.45(d)	9.0
<i>Environmental Reports - General Requirements [10 CFR 51.45]</i>		
Environmental report includes a discussion of the status of compliance with applicable environmental quality standards and requirements which have been imposed by Federal, State, regional, and local agencies having responsibility for environmental protection, including, but not limited to, applicable zoning and land-use regulations, and thermal and other water pollution limitations or requirements.	10 CFR 51.45(d)	9.0
The discussion of alternatives in the report includes a discussion of whether the alternatives will comply with such applicable environmental quality standards and requirements.	10 CFR 51.45(d)	8.0
The information submitted pursuant to 10 CFR 51.45 (b) through (d) should not be confined to information supporting the proposed action but should also include adverse information.	10 CFR 51.45(e)	4.0 and 6.3
<i>Operating License Renewal Stage [10 CFR 51.53(c)]</i>		
Environmental report description of the proposed action includes the applicant's plans to modify the facility or its administrative control procedures as described in accordance with § 54.21. The report must describe in detail the modifications directly affecting the environment or affecting plant effluents that affect the environment.	10 CFR 51.53(c)(2)	3.3 and 3.4
The environmental report must contain analyses of the environmental impacts of the proposed action, including the impacts of refurbishment activities, if any, associated with license renewal and the impacts of operation during the renewal term, for applicable Category 2 issues, as discussed below.	10 CFR 51.53(c)(3)(ii)	4.0

**Table 1-1
Environmental Report Responses to License Renewal
Environmental Regulatory Requirements**

Description	Requirement	ER Section(s)
<i>Plant utilizes cooling towers or cooling ponds and withdraws make-up water from a river whose annual flow rate is less than 3.15×10^{12} ft³/year (9×10^{10} m³/year)</i>		
Environmental report contains an assessment of the impact of the proposed action on the flow of the river.	10 CFR 51.53(c)(3)(ii)(A)	4.1 and 4.6
Environmental report contains an assessment of the impacts of the withdrawal of water from the river on alluvial aquifers during low flow.	10 CFR 51.53(c)(3)(ii)(A)	4.1 and 4.6
Related impacts on in-stream and riparian ecological communities are provided.	10 CFR 51.53(c)(3)(ii)(A)	4.1 and 4.6
<i>Plant utilizes once-through cooling or cooling pond heat dissipation systems</i>		
A copy of current Clean Water Act 316(b) determinations and, if necessary, a 316(a) variance in accordance with 40 CFR Part 125, or equivalent State permits and supporting documentation are provided, OR	10 CFR 51.53(c)(3)(ii)(B)	4.2, 4.3, and 4.4
Environmental report contains an assessment of the impact of the proposed action on fish and shellfish resources resulting from heat shock and impingement and entrainment.	10 CFR 51.53(c)(3)(ii)(B)	4.2, 4.3, and 4.4
<i>Plant uses Ranney wells or pumps more than 100 gallons (total onsite) of groundwater per minute</i>		
Environmental report contains an assessment of the impact of the proposed action on groundwater use.	10 CFR 51.53(c)(3)(ii)(C)	4.5 and 4.7
<i>Plant is located at an inland site and utilizes cooling ponds</i>		
Environmental report contains an assessment of the impact of the proposed action on groundwater quality.	10 CFR 51.53(c)(3)(ii)(D)	4.8
<i>All Plants</i>		
Environmental report contains an assessment of the impact of refurbishment and other license-renewal-related construction activities on important plant and animal habitats.	10 CFR 51.53(c)(3)(ii)(E)	4.9 and 4.10

**Table 1-1
Environmental Report Responses to License Renewal
Environmental Regulatory Requirements**

Description	Requirement	ER Section(s)
Environmental report contains an assessment of the impact of the proposed action on threatened or endangered species in accordance with the Endangered Species Act.	10 CFR 51.53(c)(3)(ii)(E)	4.9 and 4.10
<i>Plant is located in or near a Clean Air Act non-attainment or maintenance area</i>		
Environmental report contains an assessment of vehicle exhaust emissions anticipated at the time of peak refurbishment workforce in accordance with the Clean Air Act as amended.	10 CFR 51.53(c)(3)(ii)(F)	4.11
<i>Plant uses a cooling pond, lake, or canal or discharges into a river having an annual average flow rate of less than 3.15×10^{12} ft³/year (9×10^{10} m³/year)</i>		
Environmental report contains an assessment of the impact of the proposed action on public health from thermophilic organisms in the affected water.	10 CFR 51.53(c)(3)(ii)(G)	4.12
<i>Plants with transmission lines that were constructed for the specific purpose of connecting the plant to the transmission system</i>		
Materials demonstrating that transmission lines meet the recommendations of the National Electric Safety Code for preventing electric shock from induced currents are provided, OR	10 CFR 51.53(c)(3)(ii)(H)	4.13
Environmental report contains an assessment of the impact of the proposed action on the potential shock hazard from the transmission lines.	10 CFR 51.53(c)(3)(ii)(H)	4.13
<i>All Plants</i>		
Environmental report contains an assessment of the impact of the proposed action on housing availability.	10 CFR 51.53(c)(3)(ii)(I)	4.14
Environmental report contains an assessment of the impact of the proposed action on land-use.	10 CFR 51.53(c)(3)(ii)(I)	4.17 and 4.18
<i>All Plants</i>		
Environmental report contains an assessment of the impact of the proposed action on public schools (impacts from refurbishment activities only) within the vicinity of the plant.	10 CFR 51.53(c)(3)(ii)(I)	4.16

**Table 1-1
 Environmental Report Responses to License Renewal
 Environmental Regulatory Requirements**

Description	Requirement	ER Section(s)
Environmental report contains an assessment of the impact of population increases attributable to the proposed project on the public water supply.	10 CFR 51.53(c)(3)(ii)(I)	4.15
Environmental report contains an assessment of the impact of the proposed project on local transportation during periods of license renewal refurbishment activities and during the term of the renewed license.	10 CFR 51.53(c)(3)(ii)(J)	4.19
Environmental report contains an assessment as to whether any historic or archaeological properties will be affected by the proposed project.	10 CFR 51.53(c)(3)(ii)(K)	4.20
<i>Plants for which the staff has not previously considered severe accident mitigation alternatives for the applicant's plant in an environmental impact statement or related supplement or in an environmental assessment</i>		
Environmental report contains a consideration of alternatives to mitigate severe accidents.	10 CFR 51.53(c)(3)(ii)(L)	4.21
<i>All Plants</i>		
Environmental report must contain a consideration of alternatives for reducing adverse impacts for all Category 2 license renewal issues.	10 CFR 51.53(c)(3)(iii)	4.0 and 6.2
Environmental report must contain any new and significant information regarding the environmental impacts of license renewal of which the applicant is aware.	10 CFR 51.53(c)(3)(iv)	5.0

2.0 SITE AND ENVIRONMENTAL INTERFACES

2.1 Location and Features

IP2 and IP3 are located on the eastern bank of the Hudson River at Indian Point, in the Village of Buchanan, in upper Westchester County, New York. The site is owned by Entergy and contains facilities located on approximately 239 acres, bounded on the north, south, and east by privately-owned land and on the west by the Hudson River. IP2 and IP3 (see [Figure 3-1](#)) are located north and south, respectively, of IP1, which is in safe storage until subsequent decommissioning (SAFSTOR). The site is located about 24 miles north of the New York City boundary line. The nearest urban area within 6 miles of the site is the City of Peekskill, New York, which is located approximately 2.5 miles northeast of IP2 and IP3. The location of the site is shown in [Figure 2-1](#) and [Figure 2-2](#).

The general orientation of the site is northeast to southwest. One mile northwest of the site, Dunderberg Mountain lies on the western side of the Hudson River across from the City of Peekskill, New York. North of Dunderberg Mountain and the site, high grounds reaching an elevation of 800 feet form the eastern bank of the Hudson River. At this location the Hudson River makes a sharp turn to the northwest. To the east of the site, peaks are generally lower than those to the north and west. The Spitzenberg and Blue Mountains average about 600 feet in height and there is a weak, poorly-defined series of ridges that run in a north-northeast direction. To the west of the site, there are the Timp Mountains at an elevation of 846 feet. To the south of the site, elevations of 100 feet or less gradually slope toward the Village of Verplanck. South of the site the river makes another sharp bend to the southeast and then widens as it flows past the Village of Croton and the Town of Haverstraw. [Figure 2-6](#) shows topographic features of the site and the surrounding areas.

In 2000, the Village of Buchanan had a population of approximately 2,189, and the City of Peekskill, located 2.5 miles northeast, had a population of approximately 22,441. The largest town within 6 miles is Haverstraw, New York, located to the southwest on the western bank of the Hudson River, with a 2000 population of approximately 33,811 [[USCB 2000b](#)]. New York City, located approximately 24 miles south of the plant, is the largest city within 50 miles with a 2000 population of approximately 8,008,278. Areas adjacent to the station are primarily residential, large parks, and military installations. The Village of Croton-on-Hudson, New York, lies on the eastern bank of the Hudson River south of the Village of Buchanan. Approximately 90% of the area within 6 miles of the station is residential with the remainder occupied by commercial properties. There are no Native American lands within a 50-mile radius of IP2 and IP3 [[USCB 2000a](#)]. There are a number of local and county parks, golf courses, forest lands and wildlife refuges, and other public recreation lands within a 50-mile radius of IP2 and IP3. Major state and federal lands within a 6-mile and 50-mile radius of IP2 and IP3 are shown in [Figure 2-4](#) and [Figure 2-5](#). [Table 2-1](#) provides a list of all New York State parks in Westchester, Rockland, Putnam, Orange, and Dutchess Counties, the five primary counties closest to IP2 and IP3. [Figure 2-27](#) shows all state and county parks in Westchester County. In addition, West Point Military Academy is located 7.5 miles northwest of the site, Camp Smith, New York State National

Guard, is located 2.3 miles north of the site, and the Picatinny Arsenal is located 35.5 miles southwest of the site in New Jersey.

The immediate area around the station is completely enclosed by a fence with access to the station controlled at a security gate. The plant site can be accessed by road or from the Hudson River. Land access to the plant site is from Broadway (main entrance). The existing wharf is used to receive heavy equipment as needed, although access to the site from the river is controlled by site access procedures. The plant site is not served by railroad. The exclusion area, as defined by 10 CFR 100.3, surrounds the site as shown in [Figure 2-3](#). The nearest residences lie 0.25 miles beyond the site boundary to the southeast [ENN, Table 2-9].

The station as a whole can be seen from the river, but it is shielded from the land side by surrounding high ground and vegetation due to its position along the river in the Hudson River Valley. With the exception of Broadway, the site is shielded from view from the Village of Buchanan and the vicinity. The superheater stack for IP1 (334 ft tall), the IP2 and IP3 turbine buildings (each 134 ft tall), and reactor containment structures (each 250 ft tall) dominate the landscape of the site and can be seen from the Hudson River side of the site. The structures housing the turbine generator buildings and service facility have been designed with brick exterior to create an attractive appearance, the maximum extent possible, from the river side.

Noise from the site is detectable offsite. However, the Village of Buchanan has a sound ordinance (Chapter 211-23 of the Village Zoning Code) that limits allowable sound levels from a facility by octave band levels and is applicable at the property line of the sound generating facility. The combined octave band center frequencies equate to an overall level of 48 dB(A). An ambient noise level monitoring program was conducted in the vicinity of IP2 and IP3 between September 2001 and January 2002 which showed that the site meets the Village of Buchanan's sound ordinance. [Enercon, Section 4.2]

IP2 and IP3 features include the containment buildings, auxiliary buildings, turbine buildings, intake structures, discharge structure, switchyard, and associated transmission lines. [Figure 3-1](#) shows the general features of the IP2 and IP3 site. [Section 3.2](#) describes key features of IP2 and IP3, including reactor and containment systems, cooling and auxiliary water systems, radwaste systems, and transmission facilities.

**Table 2-1
 State Parks in Westchester, Rockland, Putnam,
 Orange, and Dutchess Counties**

State Parks ^a	Direction and Distance from IP2 and IP3 ^b	Location
Westchester County		
Franklin D. Roosevelt State Park	NE, 8.9 miles	Yorktown Heights, NY
Old Croton Aqueduct State Historic Park	SE, 18.3 miles	Dobbs Ferry, NY

**Table 2-1
 State Parks in Westchester, Rockland, Putnam,
 Orange, and Dutchess Counties (Continued)**

State Parks^a	Direction and Distance from IP2 and IP3^b	Location
Rockefeller State Park	SE, 12.62 miles	Tarrytown, NY
Rockland County		
Blauvelt State Park	S, 13.04 miles	Bear Mountain, NY
Haverstraw Beach State Park	SW, 4.18 miles	Haverstraw, NY
High Tor State Park	SW, 5.59 miles	New City, NY
Hook Mountain State Park	SW, 7.0 miles	Upper Nyack, NY
Nyack Beach State Park	SE, 10 miles	Upper Nyack, NY
Palisades State Park	SE, 19 miles	SE Rockland County, Border with NJ
Rockland Lake State Park	SE, 8.5 miles	Congers, NY
Rockwood Hall State Park	Extension of Rockefeller State Park	North Tarrytown, NY
Tall Man Mountain State Park	S, 16.5 miles	Bear Mountain, NY
Orange County		
Bear Mountain State Park (portion in Rockland County)	(closest point < 1 mile NW) NW, 3 miles	Bear Mountain, NY
Goose Pond Mountain State Park	NW, 16 miles	Bear Mountain, NY
Harriman State Park	(closest point < 1 mile NW) NW, 7 miles	Bear Mountain, NY
Highland Lakes State Park	NW, 24.5 miles	Bear Mountain, NY
Sterling Forest State Park	NW, 24 miles	Tuxedo, NY
Storm King State Park	NNW, 11 miles	Bear Mountain, NY
Putnam County		
Clarence Fahnestock Memorial State Park	NE, 12 miles	Carmel, NY
Hudson Highlands State Park	N, 12 miles	Beacon, NY
Dutchess County		

**Table 2-1
State Parks in Westchester, Rockland, Putnam,
Orange, and Dutchess Counties (Continued)**

State Parks ^a	Direction and Distance from IP2 and IP3 ^b	Location
Clermont State Historic Park	N, 56 miles	Germantown, NY
James Baird State Park	NNE, 30 miles	Pleasant Valley, NY
Margaret Lewis Norrie State Park	N, 39 miles	Staatsburg, NY
Mills Memorial State Park	N, 40 miles	Staatsburg, NY
Taconic State Park	NNE, 54 miles	Millerton, NY

- a. Source: [NYOSPRHP](#)
- b. Distances are approximate

2.2 Aquatic and Riparian Ecological Communities

2.2.1 Physical and Chemical Environment

The lower Hudson River is a 152-mile-long tidal estuary extending from the Battery at the southern tip of Manhattan Island in New York City to Troy Dam (immediately below the confluence of the Hudson River and its major tributary, the Mohawk River). The diversity and abundance of the plant and animal communities in the vicinity of the Indian Point site and within the Hudson River estuary as a whole are greatly affected by the physical and chemical environment, including a variety of human influences.

The Indian Point site is located on the eastern shore of the Hudson River at River Mile (RM) 43, approximately 43 miles from the river mouth at the Battery. The Hudson River in the vicinity of the Indian Point site is approximately 4,500 feet wide and 40 feet deep on average. Approximately 600 feet north and 300 feet offshore of the site, the river depth is nearly 80 feet. About 600 feet south of the discharge canal, and a comparable distance offshore, the depth of the river is less than 50 feet. [[CHGEC](#), Section IV.B.2.2.a]

The net downstream flows due to freshwater inflow have been reported to be in excess of 11,700,000 gallons per minute (gpm) 20% of the time, 6,800,000 gpm 40% of the time, 4,710,000 gpm 60% of the time, 3,100,000 gpm 80% of the time, and 1,800,000 gpm 98% of the time [[IP3 UFSAR](#), Section 2.5]. Flooding at the Indian Point site is historically non-existent, and flood stages are primarily influenced by tidal flows and secondarily by runoff. Tidal amplitude at the Indian Point site (RM 43) averages about 4 feet, and the highest recorded water elevation in the vicinity of the site was 7.4 feet above mean sea level (MSL) during a severe hurricane in November 1950 [[IP3 UFSAR](#), Section 2.5; [IP2 UFSAR](#), Section 2.5].

The flow of the Hudson River estuary is controlled more by tides than freshwater inflow from the surrounding watershed. Due to the estuary's low gradient (5 feet in 152 miles), it is tidal all the way upriver to Troy Dam (RM 152), where the tidal amplitude there averages 4.7 feet. Tidal flow past the Indian Point site is approximately 80 million gpm about 80% of the time, and the estimated flow 500 feet off the shoreline is about nine million gpm in a 500-600 foot wide section. [IP3 UFSAR, Section 2.5]

These large flows provide complete mixing of the site's discharge water. In addition, the discharge for IP2 and IP3 is designed to use the dilution characteristics of a large tidal flow and does not contravene regulatory limitations [IP2 UFSAR, Section 2.5].

The 1999 Draft Environmental Impact Statement (DEIS) generally classified two major habitats within the Hudson River estuary that were studied from 1974 through 1997: the brackish water portion extending from RM 1 (Battery) through RM 55 (Storm King Mountain, just north of West Point at RM 52), and the freshwater portion extending from RM 56 to the Troy Dam (RM 152) [CHGEC, Section V.D.1.b]. The Hudson River from Jones Point (RM 44) upstream to Storm King Mountain (RM 55) is a narrow, deep and turbulent area known as "The Highlands". The Highlands is a natural geological "bottleneck" separating the wide and slow flowing segments of the Hudson River to the north (Newburgh Bay) and south (Haverstraw Bay) into predominantly freshwater and brackish regions, respectively. Portions of these bays to the north and south of the Hudson highlands serve as nursery areas for freshwater and brackish species. The freshwater-saline water transition zone fluctuates seasonally and from year to year based on the volume of drainage basin freshwater flow from surface and groundwater discharge, with the transition zone reaching farther upriver during the summer months when freshwater inflows are the lowest. The Indian Point site is located within the area of the river generally considered brackish, at RM 43; although in the spring the water in the Hudson River at the site may be fresh water due to heavy spring runoff. [USFWS 1997]

The Hudson River can be more finely divided into four salinity habitat zones based on average annual salinities and the associated flora and fauna: the polyhaline (high salinity) zone from Manhattan (RM 1) north to the City of Yonkers (RM 19); the mesohaline (moderate salinity) zone from Yonkers north to the Town of Stony Point (RM 40); the oligohaline (low salinity) zone from the Town of Stony Point north to the Village of Wappingers Falls (RM 68); and the tidal freshwater zone from Wappingers Falls north to Troy Dam (RM 152). The boundaries of these salinity zones vary greatly with the season, with the salt front pushed approximately as far south as the Tappan Zee Bridge (RM 26) during spring periods of high freshwater inflows and brackish water extending approximately as far north as the City of Poughkeepsie (RM 75) during the summer period of typically low freshwater inflow. The Hudson River estuary has a very low gradient, dropping only 5 feet in elevation over the 152 miles between Troy Dam and the mouth of the river at New York City (Battery). The Hudson River estuary is a tidally dominated system with an average of only 10% of the total flow made up by freshwater inflows. [USFWS 1997]

Salinity influences the distribution and function of both plants and animals within the Hudson River estuary. The distribution of tidal marsh communities and plants in the Hudson River is influenced by surface water salinity. Freshwater tidal marsh communities generally occur north

of the cities of Newburgh and Beacon (RM 62) and brackish tidal marsh communities generally occur south of Newburgh and Beacon. Benthic communities also vary in distribution depending on bottom water salinity. A typically marine benthos dominated by marine worms and crustacea occurs beginning in Haverstraw Bay at the Town of Stony Point (RM 40) and extending south to the Battery, a mixture of freshwater and marine organisms occurs from Stony Point approximately as far north as Poughkeepsie (RM 75), and snails, clams, chironomid midges, and other insects typical of a freshwater community are present in the Hudson River Estuary north of Poughkeepsie all the way to the Troy Dam (RM 152). Coastal and estuarine fish species tolerate a wide range of salinities and may move throughout the entire Hudson River Estuary. Anadromous (migratory) fish species require different salinities at the different phases of their life cycles and seek the appropriate habitats within the Hudson River Estuary necessary for completing their life history requirements. [USFWS 1997]

The mid-estuary from the Town of Stony Point (RM 40) to the City of Poughkeepsie (RM 76) is generally the oligohaline (0.5 to 5 parts per thousand salinity) zone in the Hudson River, marking the seasonal inland extent of brackish water in the Hudson River, although the limits of this zone change with the amount of freshwater inflow. Indian Point (RM 43) is in this mid-estuary section, and so is Lovett Generating Station, which has a cooling water intake and thermal discharge on the west (opposite) shore approximately 1 mile south of the Indian Point (east) site. The mid-estuary begins north of Haverstraw and Tappan Zee Bays at the Town of Stony Point (RM 40). North of the City of Peekskill at RM 44, the river passes into the Hudson Highlands where it narrows to an average width of about 1,800 feet. The Hudson Highlands area of the river is a deep (49 to 197 feet) and turbulent mixing zone with little shoal area and steep rocky shorelines. The adjacent uplands are steep and forested, rising to heights of 1,200 feet to 1,400 feet above the Hudson River at Storm King Mountain (RM 55) with limited development. Moving upstream beyond the Hudson Highlands into the Town of Cornwall at RM 56, the Hudson River widens to an average width of 5,800 feet in an area called Newburgh Bay. The average mid-channel depth of Newburgh Bay is about 40 feet. There are wider shoal areas along the shoreline, especially on the eastern shore, supporting growth of submerged aquatic vegetation. The adjacent uplands are more gently sloping, with a mix of forested, agricultural, and developed land (residential, commercial, and industrial). North of the Village of Wappingers Falls (RM 67), the river narrows again and increases in depth to as much as 125 feet. Throughout the entire mid-estuary, there are railroads on both east and west shorelines, cutting off embayments and forming isolated wetlands with little water exchange with the river except through culverts. Several cities are located on this portion of the river, including Peekskill (RM 43), Newburgh (RM 60), and Poughkeepsie (RM 76). [USFWS 1997]

Water temperature in the Hudson River varies according to natural, north-temperate seasonal cycles, with the greatest rate of change occurring as the water warms from solar insolation during the spring and radiantly cools during the fall. The City of Poughkeepsie (RM 75) maintains a municipal potable water withdrawal near the river bottom and provides the best available long-term daily record of Hudson River water temperatures throughout the year. During the period 1951-1997, average annual temperatures measured daily at Poughkeepsie Water Works (RM 75) ranged from 52°F to 56.5°F, with an average temperature of approximately 54.3°F for the 47 year period. Minimum water temperatures in January and February average approximately 34°F

and maximum water temperatures in August average approximately 77°F. From April through June, temperatures increase at an average rate of 0.2°F per day, with temperatures falling at the same rate from mid-September through mid-December. [CHGEC, Section V.B.4]

The Hudson River is used by various industries including chemical companies; bulk petroleum storage facilities; paper and textile manufacturers; sand, gravel, and rock processors; power plants; and cement companies. The Hudson River is also widely used for recreational purposes, with sport fishing and boating being popular recreational activities in the lower Hudson valley. North (upstream) of the Hudson Highlands, the Hudson River is used by at least five municipalities as a source of potable water, including a major flood-skimming withdrawal at Chelsea (RM 67) supplying potable water into the New York City water supply system of reservoirs and aquaducts [CHGEC, Section V.A.9].

Eleven facilities each withdraw and/or discharge at least 50 million gallons of water a day (mgd) into the Hudson River estuary, including seven power generating stations utilizing the Hudson River to supply once-through cooling water, two wastewater treatment plants discharging secondarily treated effluent, an office complex, and a resource recovery plant [CHGEC, Section V.A.9.b]. The seven power generating stations are 59th Street Station at RM 7 (70 mgd), Bowline Point at RM 37 (912 mgd), Lovett at RM 42 (496 mgd), Indian Point at RM 43 (2,800 mgd), Danskammer Point at RM 66 (457 mgd), Roseton at RM 67 (926 mgd), and Bethlehem at RM 140 (515 mgd) [CHGEC, Section V.A.9.b]. The wastewater treatment facilities are Yonkers at RM 17 (92 mgd) and North River at RM 10 (170 mgd) [CHGEC, Section V.A.9.b]. The Empire State Plaza office complex at RM 146 (108 mgd) and Westchester Resource Recovery at RM 43 (55 mgd) are the other two facilities with permitted discharges of at least 50 mgd [CHGEC, Section V.A.9.b]. Additional intake of Hudson River water may occur at Chelsea Pumping Station (RM 67), located on the eastern bank of the river across from Roseton Generating Station. The pumping station was constructed in response to municipal water supply shortages and has only been used three times, delivering up to 100 mgd of Hudson River water into the Delaware Aqueduct during droughts for periods of 300 days during the 1966-1967 drought, 154 days in 1985, and two weeks in 1989 [CHGEC, Section V.A.9.c.i].

The lower Hudson River at the Indian Point site (RM 43) meets the criteria and designated uses of class SB (Class B saline) surface waters in New York [NYSDEC 2004b, Appendix A]. New York State's 2004 Section 305(b) Water Quality Report designates the uses for class SB saline surface waters as "Primary and secondary contact recreation and fishing. These waters shall be suitable for fish propagation and survival." The Hudson River in the vicinity of the site has long been classified as impaired, which according to the New York State Department of Environmental Conservation (NYSDEC), is a "water body with well documented water quality problems that result in precluded or impaired uses" [NYSDEC 2004b, Appendix B]. Commercial shellfishing (Class 2A) is excluded in Class SB surface waters, which occur in the vicinity of the site in the Hudson River. The Hudson Highlands just north of the Indian Point site (RM 44 through RM 56) is classified as a Significant Coastal Fish and Wildlife Habitat [CHGEC, Section IV.B.2.2.a].

Improvements in wastewater treatment in recent years have decreased the amount of raw sewage discharged into the river from treatment facilities and from combined sewage overflows,

reducing the amount of particulate organic matter and nitrogen available to the food chain. This is true throughout the estuary, but was particularly notable in the New York City area (RM 1 through RM 14) during the 1980s and especially in the early 1990s when three treatment plants went to full secondary treatment [CHGEC, Section V.D.1.a].

One of the most notorious water quality problems in the Lower Hudson River is the effect of toxic/contaminated sediment in the estuary of the Hudson River main stem. This contamination is primarily the result of historic polychlorinated biphenyl (PCB) discharges from the General Electric Company in the Upper Hudson River region near Glens Falls, N.Y, located about 20 miles upstream from the Troy Dam. Although the impairment of the Hudson River is primarily from sediments contaminated by PCBs, mercury, and cadmium, the river may also be impaired in some segments due to chlordane and other organics [NYSDEC 2004b, 303(d) list]. A 1998 United States Geological Survey (USGS) report on Hudson River Water Quality noted that organochlorine compounds, such as the pesticides chlordane and DDT (dichlorodiphenyltrichloroethane) and their degradation compounds have a long history of use in the Hudson River Basin. Although use of these compounds was banned in the 1970s, they persist in the stream-bottom sediments and biota of the basin. Contaminated sediments have a tendency to shift downstream during spates and other disturbances in upstream areas. Extensive fish consumption advisories were issued and restrictions were placed on recreational and commercial fishing in the Hudson River downstream of Hudson Falls in response to PCB contamination. This included a prohibition on the commercial harvesting of striped bass and restrictions on the consumption of blue crabs from the lower Hudson River. The entire main stem of the lower Hudson River-representing 100% of the estuary waters in the basin-is listed as having use (fish consumption) impairments due to toxic/contaminated sediment [NYSDEC 2004b, Appendix A]. Most agricultural and urban streams studied supported a smaller number of intolerant fish and macroinvertebrate species than would be expected in streams with undisturbed chemistry and habitat. Intolerant species were entirely absent or rare at these sites. Fish communities at highly urbanized sites were numerically dominated by a single fish species. [USGS 1998]

The Mohawk River is the primary tributary to the Hudson River, entering the river from the west at a location about 3 miles north of the Troy Dam (RM 152). The average annual freshwater discharge of the Mohawk River into the Hudson River at Albany (Cohoes) is about 5,740 cfs. All of the 63 tributaries entering the Hudson River Estuary south of the Troy Dam are small (<600 cfs) and collectively contribute less than 25% of the annual freshwater flow. Dams on most of these small mainstem tributaries have resulted in the removal of a great number of miles of suitable diadromous fish spawning habitat from the system. [USFWS 1997] Shapley and Morris noted the potentially serious impact of dams on tributaries of the Hudson, stating "The roughly 357 dams and other barriers on the 63 tributaries of the Hudson River estuary block what is called the stream continuum." Sections of these impounded streams become lake-like, retaining nutrients, trapping sediment, and provide increased surface area for atmospheric warming. Impounded water skimmed off of the surface during the summer may exceed the thermal tolerance of cold-water species such as trout in the free-flowing sections of the tributaries. Dissolved oxygen, at concentrations of 5 mg/l or above, is essential for fish and other aquatic life and has an inverse relationship with water temperature. Therefore, dissolved oxygen

concentrations decrease in warm impounded surface waters of tributaries, and water with lower dissolved oxygen concentrations subsequently flows downstream over the dam. [Shapley]

Transportation has had a major effect on the Hudson River. Railroad bed construction as early as the 1840s paralleled both east and west banks of the river, crossing all tributaries and isolating many of the tidal marsh complexes. Water exchange between these isolated wetlands and the main channel of the Hudson River Estuary is limited to small culverts installed primarily for drainage with little consideration for aquatic habitat. Maintenance and rebuilding of railroads, roads, and bridges along the Hudson River can adversely impact wetlands, rare plants, fish, and wildlife. Herbicide use along roads and railroads could destroy adjacent rare plant populations. Non-point source pollution in the form of runoff is also seen as a concern [USFWS 1997]. There is also some bank erosion due to recreational and commercial boat traffic between the Port of New York and the Port of Albany.

Dredging necessary to maintain a shipping channel in the Hudson River Estuary is a continuing concern because dredge material disposal options are limited. There is also an emerging need for disposal of spoils from dredging activities necessary to maintain the numerous ports and recreational marinas along the river between New York City and the Troy Dam. Many former or proposed dredge disposal sites, especially deepwater sites offshore and outside of the Hudson River basin, are not biologically suitable for dredge disposal. Deposition of dredged material on or adjacent to rare natural communities and plant populations can be a threat. [USFWS 1997] Materials resulting from the infrequent dredging operations at IP2 and IP3 are disposed of in upland disposal facilities and therefore pose no threat to Hudson River plant or animal communities.

To evaluate whether power generation has had an impact on the aquatic resources of the Hudson River Estuary (in addition to variation and changes due to the many natural and human influences discussed above) IP2 and IP3 and the other Hudson River power generating utilities have conducted annual aquatic studies in the Hudson River since 1974. These studies are collectively referred to as the Hudson River Utilities Monitoring Program and are further described below in Section 2.2.5. The results of these annual monitoring studies completed from 1974 through 1997 were reported in a 1999 DEIS completed on behalf of the Hudson River power generation utilities, and in a 2003 NYSDEC Final Environmental Impact Statement (FEIS) completed to evaluate the impacts to the Hudson River from State Pollutant Discharge Elimination System (SPDES) permit renewal [NYSDEC 2003]. Based on the reports summarized in the DEIS, studies completed since 1974 on behalf of the utilities (including IP2 and IP3) included sampling and evaluation of all trophic levels of the aquatic communities found in the Hudson River estuary. Key species, populations, and communities were defined and the dynamic nature of their interactions was described. During the 1980s, studies focused more closely on the individual fish species, particularly those adult and larval fish that use the estuary as spawning and nursery habitat and may be considered Representative Important Species for the purpose of evaluating entrainment and impingement impacts. As a supplement to the Hudson River Utilities Monitoring Program, extensive environmental studies were also conducted by the NYSDEC in the Hudson River estuary.

2.2.2 Plankton Communities

Bacterial communities in the Hudson River at Indian Point are important constituents of the biological community. These organisms are important in that they are responsible for the decomposition of organic matter, thereby providing the raw materials for growth of phytoplankton and other consumers higher in the food chain. Thus bacterial decomposition helps retain important materials in the aquatic ecosystem. Bacteria play an additional role by assimilating dissolved organic matter in the water. The bacteria themselves are food for particle-feeding zooplankton and thereby contribute organic carbon near the base of the food chain leading directly to production at higher trophic levels. Bacterial densities in the Hudson River near Indian Point have been observed to vary with the season. In the winter, the bacterial density may be as low as 1×10^6 per liter or less, while summertime densities may exceed 5×10^7 per liter. [USAEC, Section II.F.a]

Plankton is composed of both microscopic free-living plants (phytoplankton) and animals (zooplankton). Planktonic algae use energy from the sun and elemental nutrients in the water to produce carbon dioxide into the organic material of their cells. These organisms provide the basis for the food web of aquatic systems and are the principal food of most of the zooplankton and some fish species as well. [USAEC, Section II.F.b]

Studies of the phytoplankton community in the Hudson River in the vicinity of IP2 and IP3 showed three different spatial and temporal patterns of occurrence. Diatoms were the most abundant members of the phytoplankton community during periods of low water temperature (winter) and during turbulent water flows in the spring and fall. Green algae were the dominant members of the phytoplankton community during the periods of high water temperatures and low freshwater flows in the summer. Blue-green algae were the most abundant component of the phytoplankton community during late summer and early fall [CHGEC, Section V.D.1.c.i].

According to the IP2 Final Environmental Statement (FES) published in 1972, the dominant phytoplankton species at Indian Point throughout most of the year belong to the chain-forming diatom genus *Melosira* sp., with the radial colony-forming diatom *Asterionella* sp. as a secondary dominant form. The abundance of these two diatom genera varied from 5×10^5 to 6×10^6 per cubic meter of Hudson River water. As salinity increases in the summer in the vicinity of Indian Point due to lower freshwater flows, the phytoplankton species composition changes in favor of more salt-tolerant forms, such as the large, pennate, single-celled genus *Rhizosolenia* sp., the chain-forming genera *Chaetocerus* sp., and *Thalassiosira* sp. About 25 genera of algae (principally pennate diatoms) are present in the Indian Point area of the Hudson River at all times. Some variation in phytoplankton species composition across the river has been observed. However, when averaged for several months, there was little variability in the percentage composition of the major groups of phytoplankton across the river. Diatoms accounted for about 70 percent of the phytoplankton, green algae for about 23 percent, blue-green algae for about 5 percent, and all other divisions of phytoplankton contributed less than 1 percent. [USAEC, Section II.F.b]

The 1972 IP2 FES noted that the zooplankton is a diverse group of animals which provide an important trophic link in the food chain by consuming small forms of particulate organic carbon such as phytoplankton, bacteria, and organic detritus and assimilating these carbon sources into their larger body size (0.035 mm to 2.0 mm), which is more readily consumed by larger organisms. These larger organisms include larger zooplankters, benthic invertebrates, larval fish, and particle-feeding adults of several fish species that feed on zooplankton throughout their life cycle, such as bay anchovy. Studies of the zooplankton in the Hudson River from Haverstraw Bay to the City of Albany between April and December 1987-1989 revealed five dominant taxa, which included a copepod, a cladoceran, and three rotifers. The most abundant invertebrate prey of fish, based upon examination of 190 fish stomachs, was the amphipod *Gammarus*. Dipteran larvae and pupae, adult insects, and smaller crustaceans such as cladocerans, copepods, and ostracods were also important components of the stomach contents. Sizes of the invertebrates in the stomachs varied with the sizes and ages of the fish caught. [USAEC, Section II.F.c]

2.2.3 Macroinvertebrate Communities

An important component of the aquatic environment of estuarine ecosystems is the population of macroinvertebrates, which are small animals (retained on a 0.6 mm mesh sieve) without backbones that typically live near, on, or within the river substrate. Examples of macroinvertebrates are small clams and mussels (bivalves), snails, worms, crustaceans, and aquatic insects. In estuarine environments like the Hudson River Estuary, the macroinvertebrates serve as an important trophic component of the food web, converting non-living organic matter (detritus) and other macroinvertebrates into their tissues which are subsequently consumed by higher trophic levels such as fish. [USAEC, Section II.F.2.c(2)]

Little was known about the quantitative aspects of the macroinvertebrates in the Hudson River at the time of the original license application for IP2 and IP3. The IP2 FES reported that generally, this fauna appeared sparse both in the Indian Point area and throughout the lower part of the estuary. In deeper portions of the Hudson River north of Indian Point and through the Hudson Highlands, grab samples commonly contained no specimens of macrobenthos. Macroinvertebrates common in the Indian Point area prior to the startup of IP2 included *Balanus* sp. (barnacles), *Congeria* sp. (clams), polychaete worms, and *Gammarus* sp. (amphipods) [USAEC, Section II.F.2.c(2)].

The 1999 DEIS, however, reported more recent studies showing that the Hudson River estuary contains a high abundance of macroinvertebrates, consistent with the high turbidity and inputs of organic material into this ecosystem. The abundance of macroinvertebrates in the Hudson River estuary is greater than that reported for many inland freshwater lakes and rivers. The distribution of benthic macroinvertebrates throughout the Hudson River Estuary is primarily determined by their salinity tolerance along the gradient from brackish to freshwater proceeding from downstream to upstream. Polychaete worms are most abundant in brackish water areas, whereas oligochaete worms are most abundant in freshwater areas. In the Hudson River Estuary, epibenthic (living on the bottom) macroinvertebrates in brackish water areas are

typically dominated by mysid shrimp, especially the opossum shrimp (*Neomysis americana*). [CHGEC, Section V.D.1.c.iv]

Sampling conducted in the freshwater portion of the estuary north of the Hudson Highlands indicated that benthic macroinvertebrate densities were near the high end of the normal range compared to other large rivers. Collections in this stretch of the river (upriver from the Indian Point site) were dominated by *Limnodrilus hoffmeisteri*, a common tubificid worm. Epibenthic macroinvertebrates collected in the freshwater portion of the estuary (north of Newburgh, RM 60) were primarily small crustaceans, especially members of the amphipod genus *Gammarus*. Aquatic insect larvae were also collected in these upriver freshwater areas of the Hudson River Estuary. [CHGEC, Section V.D.1.c.iv]

The blue crab (*Callinectes sapidus*) is an abundant decapod crustacean in marine and brackish waters of the United States from Massachusetts to southern Texas, supporting important commercial fisheries in parts of its range. In the Hudson River, juvenile blue crabs are most abundant from August through October, depending on the location. Downriver studies reported peak abundance occurred in August; at upstream sites, Iona Marsh (approximately RM 48) and Moodna Creek (RM 57), peak abundance did not occur until September. Although no historical records of blue crab abundance in the Hudson River were available, impingement rates at Roseton, Bowline Point, and IP2 and IP3 prior to 1988 indicated that the numbers of blue crabs in the Hudson River were relatively low. Impingement rates from 1988 through 1997 varied substantially, but they were at least an order of magnitude higher than in previous years. Relatively mild winters in recent years may have resulted in higher survival of overwintering individuals. Alternatively, the improvement in water quality in the lower estuary may be related to the increase in blue crab abundance. Differences in abundance between male and female blue crabs in impingement collections reflect their migratory habits: after both sexes migrate upriver to lower salinity portions of the estuary to spawn, the males tend to remain in lower salinity waters while females migrate back to deeper, more saline water. [CHGEC, Section V.D.2.p]

During the 1990s a major change in the macroinvertebrate community occurred in the Hudson River Estuary. In 1991, the non-native zebra mussel (*Dreissena polymorpha*) was first identified in the freshwater portions of the Hudson River [IES; Strayer 1996; Strayer 1999]. Within 17 months of first being detected, the biomass of zebra mussels had exceeded that of all other heterotrophs (organisms that require a supply of organic matter or food from the environment, including bacteria, zooplankton, other macroinvertebrates, and fish) in the freshwater areas [Strayer 1996]. The huge and rapid population growth of the zebra mussel has corresponded with a substantial decrease in the abundance of phytoplankton and zooplankton in freshwater areas of the Hudson River because zebra mussels are filter feeders and strain/remove these organisms from the water while feeding [CHGEC, Section V.D.1.c.iv]. Biomass reduction has been estimated at 80 percent for phytoplankton and 70 percent for zooplankton following the invasion [Caraco 1997; Pace 1998]. The native pearly mussels of the Hudson River, which formerly numbered more than one billion, appear to be on the verge of disappearing from the river as a result of the zebra mussel invasion [IES]. Recent studies have shown that the zebra mussel invasion is associated with a decline in open-water shad and herring (pelagic particle feeders), while the littoral fish such as sunfish (benthic feeders) have prospered [IES].

Entergy performs a macrofouling monitoring program, via a contracted vendor, at the site, to identify the presence of the freshwater bivalve zebra mussels (*Dreissina polymorpha*), as well as their salt water version - dark false mussels (*Mytilopsis leucophaeata*). The monitoring program involves settling plates hung in the river at the IP3 intakes, as well as a number of sample boxes within the service water systems. On a monthly basis, sample plates are removed and replaced, with the removed plates taken to an offsite laboratory for evaluation. If any bivalves are found to be present, Entergy is notified by the laboratory within 24 hours and corrective actions are taken as necessary. This monitoring program allows Entergy to identify the presence of bivalves in the area that could potentially present a fouling problem in plant systems, as well as monitor the effectiveness of the program to prevent fouling. Both zebra and dark false mussels are found at the intakes usually from July throughout the rest of the year. The proportion of zebra to dark false mussels changes depending upon the salinity of the Hudson River in the area of the plants.

2.2.4 Vascular Aquatic Plants

Macrophytes (rooted aquatic plants) are important in the river's ecosystem as a source of organic matter and for their habitat value in providing shelter from predators to many fish species, especially as nurseries for the juvenile stage. Rooted aquatic plants in the Hudson River are found primarily within 100 yards of the shoreline and in the backwater marshes and wetlands cut off from the main river channel by the railroad beds. The variety of rooted vegetation is greater in the low saline areas of the river. The IP2 FES identified in Table A-II-1 the aquatic plants that were collected in the vicinity of IP2 and IP3 in the Hudson River. Vascular plants included *Chara* sp., *Eleocharis* sp. (spike rush), *Elodea* sp., *Myriophyllum* sp., *Najas flexilis*, *Nitella* sp., *Pontederia cordata* (pickerel weed), *Potamogeton crispus*, *Potamogeton pectinatus*, *Potamogeton perfoliatus*, *Potamogeton* sp., *Spartina* sp., *Trapa natans* (water chestnut), and *Vallisneria americana* [USAEC].

Discontinuation of a chemical control program for the introduced freshwater macrophyte species water chestnut in 1976 caused a major change in the vascular aquatic plant community in the Hudson River Estuary. Water chestnut was introduced into the upper Hudson River drainage in 1884 and became a pest in this stretch of the river by the 1930s. The NYSDEC began an eradication program using the herbicide 2,4-D, then discontinued the program in 1976. Since 1976, the water chestnut beds have expanded into dense stands in available habitat in the fresh and low salinity brackish areas of the estuary [CHGEC, Section V.D.1.c.ii]. As of 1999, the exotic water chestnut was the dominant form of rooted vegetation in shallow areas of the estuary upstream of Constitution Island (RM 53). Water chestnut beds in some areas are now so dense that they have adversely affected water circulation, lowered dissolved oxygen concentrations, and may be relatively void of fish [CHGEC, Section V.D.1.c.ii].

2.2.5 Fish Communities

An extensive monitoring program referred to as the Hudson River Utilities Monitoring Program has been conducted along the entire 152 miles of the Hudson River Estuary each year beginning in 1974, including the Longitudinal River Survey (LRS), the Beach Seine Survey (BSS), and the Fall Shoals Survey (FSS). An average of 2,950 LRS samples were collected per year during the

23-year period from 1974-1997, providing estimates of abundance of ichthyoplankton (fish eggs and larvae) during the spring and summer. An average of 1,600 BSS samples were collected per year in alternate weeks from mid-June through October of 1974-1997 to provide estimates of abundance for young-of-the-year (YOY) fish near the shore. An average of 1,570 FSS samples were collected per year on alternate weeks from the BSS during 1974-1997 to provide estimates of the abundance of YOY fish in offshore habitats. The annual numbers of samples described above for the LRS, BSS, and FSS represent the 1974-1997 period examined by the DEIS; these programs are still ongoing annually and represent one of the largest privately-funded environmental monitoring study ever conducted (if not the largest). In addition to the LRS, BSS, and FSS, which primarily target the early life stages of Hudson River fish species, other long-term studies have included impingement and entrainment monitoring programs at most of the power generating stations, and surveys of the pre-reproductive populations of striped bass (*Morone saxatilis*) annually since 1984, spawning adult Atlantic tomcod (*Microgadus tomcod*) since 1982, and spawning adult white perch (*Morone americana*) from 1971 through 1988. [CHGEC]

The Hudson River estuary is an important spawning and nursery area for a variety of fish species, including both year-round inhabitants and species that move into the estuary solely for the purpose of spawning. Based on the 1974-1997 Hudson River studies, over 200 fish species have been collected in the greater Hudson and Mohawk River system [CHGEC, Section V.D.1.c.v]. Fish species collected during these sampling efforts can be categorized into four major groups based on their life histories and general habitat requirements: marine species, freshwater species, estuarine species, and diadromous species.

Major anthropogenic or natural events or trends during 1974-1997 with potential significance to the fish communities of the estuary included increased cooling water withdrawals from the Hudson River for electric power generation, improvements in water quality resulting from improvements of wastewater treatment, substantial increases in area coverage by water chestnuts as a result of the cessation of herbicide treatments, invasion of tidal areas by zebra mussels, and an increase in the abundance of large striped bass as a result of restrictions in commercial and recreational harvests [CHGEC, Section V.D.3.i].

Striped bass is a keystone predator and one of the dominant fish species in the Hudson River. Striped bass have significant commercial and recreational fisheries, both within the Hudson River Estuary, and throughout the mid-Atlantic and New England states. Striped bass have been the subject of a successful recovery program administered by the Atlantic states and their resource agencies as directed by the Atlantic States Marine Fisheries Commission (ASMFC). Following declines in striped bass harvest and poor juvenile production during the 1970s, ASMFC developed and implemented a recovery plan for striped bass that resulted in the passage of the Atlantic Striped Bass Conservation Act of 1986. The management plan implemented increases in the size limits and moratoriums on both commercial and recreational fishing at times during the 1980s to sharply reduce striped bass harvests and protect spawning stocks. The striped bass abundance in the Hudson River Estuary and throughout the Atlantic states dramatically increased between the early 1980s and the early 1990s [CHGEC, Section V.D.1.a].

Atlantic sturgeon (*Acipenser oxyrinchus*) and shortnose sturgeon (*Acipenser brevirostrum*) are of particular interest in the Hudson River estuary. The shortnose sturgeon is protected as a federally endangered species under the Endangered Species Act. Strong YOY recruitment during 1986-1992 was followed by an increase in the shortnose sturgeon population in the Hudson River Estuary during the 1990s. This recovery was attributed to improved dissolved oxygen concentrations in summertime nursery habitat in the upper estuary (north of the Hudson Highlands) beginning in the 1970s. Shortnose sturgeon is further discussed in [Section 2.5](#) of this ER. The status of the Atlantic sturgeon is currently under review to determine whether listing as a threatened or endangered species under the Endangered Species Act is warranted. [[CHGEC](#), Section V.D.2.p].

Few larval or young sturgeons of either species were collected during 5-14 years of entrainment sampling at six power stations [[CHGEC](#), Section V.D.2.h]. A total of 907 Atlantic sturgeon and 63 shortnose sturgeon were collected at the six power stations during 15-27 years of impingement sampling during 1972-1998 (an average of 23.2 years sampled per plant; the totals do not include estimates for numbers impinged on non-sampling days). Most Atlantic sturgeon impingement at power plant intakes was in the winter. There was no seasonal pattern of impingement for shortnose sturgeon. Based on these data, the National Marine Fisheries Service (NMFS) concluded that future impingement rates due to incidental take at Roseton and Danskammer Point generating stations, even though higher than at Indian Point, are unlikely to jeopardize the continued recovery of the Hudson River shortnose sturgeon population. [[NMFS](#) 2000, Section 5.2.2]

The extensive nature of the LRS and BSS data permits a detailed characterization of the Hudson River fish fauna, as well as an examination of long-term trends at the community level. The DEIS emphasized an examination of long-term trends (1974-1997) primarily for the following two life stages of fish representative of impingement (YOY) and entrainment (PYSL). Of the PYSL collected by the LRS, most were marine species (29 taxa), followed by freshwater taxa, then estuarine and diadromous taxa. Marine larvae were largely restricted to brackish water and were dominated by bay anchovy (*Anchoa mitchilli*). The bay anchovy is a schooling species that is very abundant in inshore marine waters of the Atlantic coast of North America. Other common marine species collected as PYSL included weakfish (*Cynoscion regalis*), Atlantic menhaden (*Brevoortia tyrannus*), winter flounder (*Pseudopleuronectes americanus*), and Atlantic herring (*Clupea harengus*). Freshwater PYSL (20 taxa) were dominated by several members of the minnow family (Cyprinidae). Other freshwater taxa included yellow perch (*Perca flavescens*), sunfish (family Centrarchidae), and common carp (*Cyprinus carpio*). Estuarine PYSL (11 taxa) were dominated by white perch (*Morone americana*). Other common estuarine taxa collected included banded killifish (*Fundulus diaphanus*), inland silverside (*Menidia beryllina*), northern pipefish (*Syngnathus fuscus*), and Atlantic silverside (*Menidia menidia*). Diadromous PYSL (9 taxa) were dominated by striped bass and by "river herring," a taxonomic grouping of alewife (*Alosa pseudoharengus*) and blueback herring (*Alosa aestivalis*). The striped bass PYSL were most abundant in the middle portion of the estuary and river herring were found primarily farther upriver. Other diadromous taxa collected as PYSL included American shad (*Alosa sapidissima*) and rainbow smelt (*Osmerus mordax*). [[CHGEC](#), Section V.D.3.i]

During the 24-year monitoring period from 1974 to 1997, species richness and overall abundance of PYSL increased in most areas of the estuary. Analysis of the long-term trends in the larval fish community in both the marine brackish regions and the freshwater zone revealed an overall increase in the total number of taxa collected. Increases in overall abundance were due to increases in the abundance of larval striped bass in all areas of the estuary and increases in the abundance of larval bay anchovy in brackish areas. [CHGEC, Section V.D.3.i]

Of the YOY fish collected by the BSS, marine species (27 species) were collected primarily in brackish areas. Bay anchovy was the predominant species collected. Other common marine species collected as YOY included bluefish (*Pomatomus saltatrix*), Atlantic menhaden, winter flounder, and rough silverside (*Membras martinica*). Estuarine YOY (11 species) were dominated by white perch, banded killifish, and Atlantic silverside. White perch were found throughout the estuary, while Atlantic silversides were restricted to brackish zones and banded killifish were restricted to freshwater zones. Other common estuarine species collected included mummichog (*Fundulus heteroclitus*) and hogchoker (*Trinectes maculatus*). Freshwater species (33 species) were largely restricted to the freshwater zone and were dominated by spottail shiner (*Notropis hudsonius*) and tessellated darter (*Etheostoma olmstedi*). Other freshwater species commonly collected included Eastern silvery minnow (*Hybognathus regius*), goldfish (*Carassius auratus*), and pumpkinseed (*Lepomis gibbosus*). Diadromous species (9 species) were dominated by blueback herring in the freshwater and low salinity areas of the estuary. American shad were also relatively abundant. Areas of higher salinity brackish water were dominated by striped bass. Other diadromous species collected as YOY included alewife and Atlantic tomcod. [CHGEC, Section V.D.3.i, pg. V-163]

Of the yearling and older fish collected by the BSS, marine species (28 species) were collected primarily in brackish water areas, where collections were dominated by bay anchovy. Other common marine species collected as yearling and older fish included Atlantic menhaden, Atlantic needlefish (*Strongylura marina*), spot (*Leiostomus xanthurus*), and summer flounder (*Paralichthys dentatus*). Collections of yearling and older estuarine species (12 species) were dominated by white perch, banded killifish, and Atlantic silverside. White perch were found throughout the estuary while Atlantic silversides were restricted to brackish zones. Banded killifish collections were from freshwater zones. Other common estuarine species of yearling and older fish collected included mummichog and hogchoker. Freshwater yearling and older species (46 species) were largely restricted to the freshwater zone and were dominated by spottail shiner, golden shiner (*Notemigonus crysoleucas*), and pumpkinseed. Other commonly collected freshwater species included tessellated darter and redbreast sunfish (*Lepomis auritus*). Nine yearling and older diadromous species were collected during the BSS. The most abundant species were striped bass and American eel (*Anguilla rostrata*). [CHGEC, Section V.D.3.i]

Since submission of the DEIS, the IP2 and IP3, Roseton, and Bowline Point owners have continued to support fisheries studies to develop annual year-class reports outlining the results of the annual monitoring program for each year. These reports provide summaries of the raw data collected and annual estimates of the abundance (i.e., standing crop) of fish in the Hudson River, also providing summary comparisons with previous study results. The recent 2004 annual year-class report continues to confirm that the conclusions developed in the DEIS are still relevant and

supported [ASA]. The NYSDEC's FEIS noted a decline in bay anchovy abundance and suggested it was linked to power generation plant water intakes on the Hudson River [NYSDEC 2003]. Bay anchovy abundance showed an abrupt decline in abundance from 1995 to 2000, however this was considered inconsistent with the expected effects of cooling water withdrawals [Barnthouse]. More recent annual year-class reports indicate juvenile bay anchovy indices rebounded from 2000 to 2004, thus indicating its abundance has remained stable [ASA, Appendix D, Table D-5].

Overall, observations from the Hudson River Utilities Monitoring Program indicate that the fish community of the Hudson River estuary has experienced relatively small changes in species richness and diversity, although these measures have varied among regions of the river and among fish life stages during the 1974-1997 monitoring period. These changes are also discussed in Section 4 of this ER. Both the species and abundance of post yolk-sac larvae have increased slightly. The number and diversity of juvenile and older fish have decreased slightly. In the brackish region of the Hudson River, the decrease in richness and abundance may be due to an increase in salinity (lower freshwater flow) and consequent reduction in collection of freshwater fish species there. [CHGEC, Section V.D.3.ii]

The DEIS summarized and discussed aquatic conditions and fisheries studies conducted from 1974 to 1997. Subsequent to submission of the DEIS, the generators submitted to the NYSDEC, among other things, a review of the Hudson River data set by three leading fisheries biologists (Drs. Charles C. Coutant, Lawrence W. Barnthouse, and Webster Van Winkle), with a trend analysis of the relative abundance and diversity of the fish populations in the River [Barnthouse]. The express purpose of that report was to provide an even greater level of confidence to NYSDEC regarding the DEIS conclusion that no adverse impacts to fisheries have occurred or are likely to occur as a result of the operation of the cooling water intake structures of the various stations, including IP2 and IP3.

There have been two instances of 'fish kill' events at Indian Point. On October 29, 1997, operators performing routine rounds discovered a number (<40) dead fish floating in the discharge canal. The fish were determined to be adult gizzard shad and carp. Although neither species is threatened or endangered, nor considered recreationally or commercially important, this event was reported to the NRC as an unusual event as required by the Environmental Protection Plan contained in Appendix B to the IP2 and IP3 Operating Licenses. Investigations into plant operations, as well as water chemistry and temperature, did not reveal any causal factor for the fish mortality. Although the plant investigation, which was documented in IP3 DER-97-2586, did not determine the cause of the fish mortality, this was an isolated event which did not have any significant impact. A similar event occurred on May 4, 2000 when station personnel observed approximately 25 adult fish floating in the discharge canal. This event was also reported to the NRC as an unusual event as required by the Environmental Protection Plan contained in Appendix B to the IP2 and IP3 Operating Licenses. Again, an investigation was performed and documented in CR-IP3-2000-01061, but there was no indication that the fish mortality was in any way causally related to plant operations. No other such events have occurred.

2.3 Groundwater Resources

The site is on the eastern bank of the Hudson River. The river runs northeast to southwest at this point, but turns sharply northwest approximately 2 miles northeast of the plant. The western bank of the Hudson River is flanked by the steep, heavily-wooded slopes of the Dunderberg and West Mountains to the northwest (elevations 1,086 feet and 1,257 feet, respectively, above MSL) and Buckberg Mountain to the west-southwest (elevation 793 feet above MSL). These peaks extend to the west and gradually rise to slightly higher peaks.

The topography of the site ranges from approximately 145 feet MSL to approximately sea level at the Hudson River (see [Figure 2-6](#)). The containment floor elevation of the IP2 and IP3 containment structures is approximately 15 feet MSL. The site slopes generally toward the west, northwest, and toward the river. Surface drainage is toward the Hudson River.

The site is situated on the Upper Ordovician, Balmville Limestone formation with some limited areas of glacial till. The Balmville Limestone is a hard, dark gray, metamorphosed dolomitic limestone. Adjacent to the Balmville Limestone are schist and phyllite formations and the igneous intrusive rocks of the Cortland (mafic) Complex. [[USAEC](#), Section II.E.3]

Groundwater at the site occurs largely in the joints of the limestone rock. Jointing and fracturing in the limestone are irregular as is the porosity and permeability. Wells drilled into the limestone, and to a lesser extent in the schist and phyllite, yield a few gallons of water per minute. Locally, where the glacial till is thicker and more permeable than at the site, wells can be constructed which can yield several hundred gpm. [[USAEC](#), Section II.E.2]

Groundwater is encountered at the site primarily in bedrock fractures and along the jointing or bedding planes of the various rock strata. Thus, groundwater may be encountered at different elevations on the site, dependent upon location, ground surface elevation and the fracture or water bearing facies encountered. Investigations performed in 2005 and 2006 indicated groundwater may be encountered in monitoring wells at the site between three feet to more than 80 feet above MSL and generally is encountered between ten to more than 50 feet beneath the surface (see [Figure 2-7](#)). The groundwater is generally encountered nearer the ground surface near the river and is deeper beneath the surface toward the eastern part of the site. Bedrock dip is toward the River, and as such the direction of groundwater flow is toward the river. Based on the depth to bedrock and the higher elevation of the plant relative to the river, water entering the ground at the site will percolate to the river rather than enter any groundwater supply [[IP2 UFSAR](#), Sections 2.1 and 2.5]. The groundwater flow is indicated to be affected by the flow in the river and subject to the tidal effects of the Hudson River. Tidal effect is typically approximately 0.5 feet between low and high tides, but may swing as much as four to five feet under full moon and south wind conditions. It is believed that this tidal effect influences groundwater flow locally at the interface between the river and the bedrock, such that the river may provide some groundwater recharge, or impede the flow of groundwater into the river during high river flow or high tide. The highest recorded water elevation of the Hudson River at the site was 7.4 feet above MSL which occurred during an exceptionally severe hurricane in November 1950 [[IP2 UFSAR](#), Section 2.5].

Figure 2-7 presents the general potentiometric groundwater surface based on temporally averaged groundwater measurements (feet above MSL).

Within a one-mile radius of the site, there are seven USGS registered wells. These wells range in depth from 30 feet to 500 feet below land surface and, based on available information, are listed as unused, domestic use, and commercial use wells. One well is completed in the Sand and Gravel (glacial till) local aquifer, three wells in the Bedrock local aquifer, and three wells in the Basement Complex local aquifer [USGS 2006a]. Pumping rates available for these wells range from 4 gpm to 30 gpm [USGS 2006b]. Table 2-2 provides the location and available information regarding these wells. As noted, there are two out-of-service wells registered by the USGS on the plant site. The nearest off-site well is located approximately 500 feet east-northeast from the site property.

**Table 2-2
Registered USGS Wells within One Mile of IP2 and IP3**

USGS Registered Well ID	County	Well Depth (below land surface)	Approximate Distance to Site	Status	Capacity (gpm)	Primary Use ^a
WE 245	Westchester	100 ft.	On-site	Unused ^b	4	Domestic
WE 246	Westchester	193 ft.	On-site	Unused ^b	N/A	N/A
WE 244	Westchester	60 ft.	3,950 ft. ESE	N/A	30	Unused
WE 261	Westchester	500 ft.	500 ft. ENE	N/A	25	Unused
RO 307	Rockland	192 ft.	5,280 ft. E	N/A	N/A	Domestic
RO 313	Rockland	30 ft.	4,500 ft. NW	N/A	N/A	Domestic
RO 314	Rockland	110 ft.	5,280 ft. ENE	N/A	N/A	Commercial
N/A: Information not available						

a. USGS 2006b

b. IPEC 2006

The site does not utilize groundwater, either for plant operations or for potable water. Surface water from the Hudson River and city water supply the plant operational needs. Potable water is supplied to the site by the Village of Buchanan, NY Public Water Supply system. Wells located at the site are used for monitoring purposes only and are not equipped to withdraw water for plant operations or as a potable water source.

2.4 Terrestrial Habitats

The site system lies within the eastern deciduous forest biome of North America and more specifically, the oak-chestnut association. This large biome has two canopy levels with the main

canopy being dominated by a variety of oak species (*Quercus*) with smaller amounts of maple (*Acer*) and beech (*Fagus*). The sub-canopy layer is composed of smaller trees. The oak-chestnut association no longer exists in its original composition due to a chestnut blight in the early 20th century. The dominant climax species of the presettlement forest were American chestnut (*Castanea dentata*), chestnut oak (*Quercus prinus*), red oak (*Quercus rubra*), and several other oak species. All of these species, with the exception of the chestnut, continue to be important. Chestnut trees were removed from the oak-chestnut association due to a fungal blight that came to the United States from China near 1900. The fungus destroyed chestnut trees by killing the phloem (food conducting) layer in the trunks and was first reported in New York City in 1906. By 1920, the blight had killed 50 percent of the chestnut trees as far south as Maryland and continued to spread south and west. The loss of the American chestnut was important not only biologically, but also economically. It accounted for one-fourth of all the hardwood timber cut for lumber in the southern Appalachians and its wood was used for construction, furniture, telephone poles, and many other items including chemicals used in the tanning of leather. Today this association could be called the Oak Association, as oak predominantly replaced the chestnut and did not allow an invasion of new species. [Vankat 1992] Figure 2-28 provides illustration of the regional land use and vegetative cover within a 6-mile radius of Indian Point.

As discussed in the *Final Environmental Statement Related to the Operation of Indian Point 3*, a floral survey of the site and adjacent areas (2-mile radius of the site) indicated that dominant overstory species included white oak (*Q. alba*), red oak, eastern hemlock (*Tsuga canadensis*), and river birch (*Betula nigra*). Other dominant species included chestnut oak, shagbark hickory (*Carya ovata*), white pine (*Pinus strobus*), black oak (*Fraxinus nigra*), black cherry (*Prunus serotina*), and maple. Common understory species included yellow poplar (*Liriodendron tulipifera*), sassafras (*Sassafras albidum*), sumac (*Rhus* sp.), catalpa (*Catalpa bignonioides*), and various species typical of an eastern deciduous forest. [NRC 1975]

Land cover at the site includes mixed forest, and industrial and transportation cover types [USGS 2005]. Table 2-3 provides cover types and approximate percentage of area within the 239 acres of the site. Figure 2-29 illustrates the current land use and indication of land disturbance within the IP2 and IP3 exclusion zone. The northern portion of the site includes an 80-acre, well-developed mixed oak and eastern hemlock wooded area with a freshwater pond which was historically used for recreational purposes [USAEC, Section II.B; NRC 1975, Section II]. The transmission line corridor crosses the industrial portion of the site to the Buchanan Substation, located approximately 2,100 feet southeast of the reactors [NRC 1975]. The southern 10 acres of the 80-acre wooded area was recently disturbed for the construction of the Independent Spent Fuel Storage Installation pad. The NYSDEC 1997 Freshwater Wetlands Map indicates no

wetlands areas are identified within the site [NYSDEC 1997]. The nearest state designated wetlands is located 0.45 miles northeast of the site at Lents Cove, east of Broadway.

**Table 2-3
 IP2 and IP3 Land Cover^a**

Description	Percent
Open Water	1
Commercial/Industrial/Transportation	52
Deciduous Forest	3
Evergreen Forest	17
Mixed Forest	24
Urban/Recreational Grasses	3

a. U.S. Geological Survey (USGS) 1992, EROS Data Center, National Land Cover Data Set (NED) 30 meter

Mammals in the local area include white-tailed deer (*Odocoileus virginianus*), raccoon (*Procyon lotor*), American mink (*Mustela vison*), gray squirrel (*Sciurus carolinensis*), red squirrel (*Tamiasciurus hudsonicus*), eastern chipmunk (*Tamias striatus*), coyote (*Canis latrans*), red fox (*Vulpes vulpes*), grey fox (*Urocyon cinereoargenteus*), and a variety of mice and voles [NYSDEC 2005a]. Several species of snakes, turtles, salamanders, frogs, and toads also inhabit the local area [NYSDEC 1999].

Although there are no state or federal jurisdictional wetlands on the site, the open water of the Hudson River and its emergent wetland habitat supports a number of migrant waterfowl species, including mallard (*Anas platyrhynchos*), Canada goose (*Branta Canadensis*) American black duck (*Anas rubripes*), and wood duck (*Aix sponsa*). In addition, several species of woodpeckers, songbirds, herons, and raptors, such as osprey (*Pandion haliaetus*) and bald eagle (*Haliaeetus leucocephalus*), utilize the river areas near the site [NYSDEC 2005b]. Peregrine falcons (*Falco peregrinus*) are also found throughout much of the Hudson River Valley, including the vicinity of the site [NYSDEC 2006c].

Westchester County, where Indian Point is located, is in the path of the Atlantic Flyway, one of the primary migratory bird flight paths in North America. As a result of this location, Westchester County sees large numbers of migratory waterfowl, songbirds, and raptors every year.

A waterfowl count is conducted each January by members of the New York State Ornithological Association. In the 2004 survey, a total of 29,622 wintering waterfowl, comprised of 36 different species, were counted in Westchester County. The most numerous bird counted was the Canada goose, with 21,925 birds observed. The Mallard came in a distant second with 3,534 birds observed. [NYSOA]

From 2003-2006 there have been approximately six noted bird death incidents at the site. In 2003, remains of dead birds were removed from a roof drain and a dead pigeon was found on the dock area sidewalk across the alley from the cafeteria. These incidents were documented in Condition Reports CR-IP2-2003-1066 and CR-IP-2003-5322, respectively. In 2004, a dead pigeon was found outside the Unit 1 side of the security door and the incident was documented in Condition Report CR-IP3-2004-502. In 2005, two birds were found in the transformer yard and a dead pigeon was found in the vicinity of the IP3 plant vent. These incidents were documented in Condition Reports CR-IP3-2005-373 and CR-IP3-2005-2591, respectively. In 2006, a dead pigeon was noted in the IP2 Turbine Hall and the incident was documented in Condition Report CR-IP2-2006-03169. Although cause of deaths was unknown, none of these incidents triggered a report to a state or federal agency and review of condition reports since 2003 identified no definable trend.

There are no special species or endangered species on-site, although they could potentially transient the site. In addition, there have been no brush removal activities around wetlands or the shoreline of the Hudson River on the IP site. However, in the event that these events may occur in the future, Entergy has fleet procedural controls in place to ensure that the environmentally sensitive areas, if present, are adequately protected during site operations and project planning. These controls would ensure that appropriate local, state, and/or federal permits are obtained or modified as necessary, that threatened or endangered species are protected if present, and that other regulatory issues are adequately addressed if necessary.

Herbicide and pesticide usage occurs periodically at the site. Herbicides utilized for weed control and pesticides utilized for control of insects such as wasps, is hand-applied by vendors via sprayers. Sodium hypochlorite which is injected by station personnel into plant systems for chlorination purposes is also listed as a pesticide under New York State law. In accordance with NYSDEC 6 NYCRR Part 325, sodium hypochlorite usage at the site is controlled in accordance with IP2 Pesticide Application Business Registration 12696 and IP3 Pesticide Application Business Registration 13163. Vendor application of other herbicides and pesticides is also managed in accordance with 6 NYCRR Part 325.

Other than terrestrial monitoring associated with the sites' radiological environmental monitoring program described in the IP2 and IP3 ODCMs, there are no other terrestrial monitoring programs conducted at the site.

2.4.1 State-Listed Critical or Important Habitats

Entergy's review identified no state listed critical or important habitats in the vicinity of the site. The New York Natural Heritage Program (NYNHP) was contacted (see [Attachment A](#)) regarding any state listed critical or important habitats within a 50-mile radius of the site. Critical and important habitats are those areas managed by the state for species of interest. The NYNHP monitors endangered and threatened plants and animals, rare plants and animals, as well as significant ecological communities throughout the state. No designated critical and important habitats are located in the vicinity of the site based upon consultation with NYNHP.

2.4.2 Federal-Listed Critical or Important Habitats

As addressed in Section 2.5 below, four federally-listed threatened or endangered species potentially occur in the vicinity of the site [USFWS 2006a]. No critical habitat for the federally-listed species has been designated near the site, based on the USFWS Critical Habitat Portal and consultation with the NYSDEC and the United States Fish and Wildlife Service (USFWS) (see Attachment A) [USFWS 2006b].

2.5 Threatened or Endangered Species

Four animal species currently protected and two candidate species under the Endangered Species Act have geographic ranges which could possibly include the site. Federally protected and candidate species potentially represented include two fish, two mammals, one reptile, and one bird. These are the shortnose sturgeon, Atlantic sturgeon, Indiana bat (*Myotis sodalis*), New England cottontail rabbit (*Sylvilagus transitionalis*), bog turtle (*Clemmys muhlenbergii*), and bald eagle. Of these species, the Indiana bat and the shortnose sturgeon are listed as endangered, the bog turtle and bald eagle are listed as threatened, and the Atlantic sturgeon and the New England cottontail rabbit are listed as candidate species.

Bald eagles occur throughout virtually the entire area near the site. The bald eagle is known to nest along the Hudson River and has been seen near the site. In 1997, a nesting pair produced the first eaglet born along the Hudson River in more than 100 years near the Town/Village of Catskill, NY. In 2005, 12 pairs nested and 18 eaglets were fledged along the river [NYSDEC 2005c]. Bald eagles frequently winter along the Hudson River. Habitat for wintering bald eagles is generally described as large open waters, i.e., large rivers and lakes suitable for foraging. Habitat near the facility could possibly support wintering bald eagles because of the location of the site near the Hudson River.

Shortnose sturgeon inhabit rivers and estuaries, and prefers the nearshore marine, estuarine and riverine habitat of large river systems. Shortnose sturgeon, unlike other anadromous species in the region such as American shad or striped bass, do not appear to make long distance offshore migrations. Thus, shortnose sturgeon are more properly considered to be amphidromous in their migratory behavior by some investigators. There is a well established population of shortnose sturgeon in the Hudson River, and this species has been confirmed to be in the vicinity of Indian Point at various times during the year. The Hudson River population of shortnose sturgeon is reported to have grown 450% from about 10,000 fish in 1980 to as many as 55,000 by 1995 [Bain].

Shortnose sturgeon is the smallest of the three sturgeon species that occur in eastern North America, having a maximum known total length of 143 cm and weight of 23 kg. Maximum known age is 67 years for females, but males seldom exceed 30 years of age. Sex ratio among young adults is one to one, but changes to a predominance of females (4:1) for fish larger than 90 cm fork length. Males and females mature at the same length (45 to 55 cm fork length) throughout their range. However, age of maturation varies from north to south due to a slower growth rate in the north. Males may mature at age three to five from South Carolina to New York. Females exhibit a similar trend and mature at age six to seven from South Carolina to New York. Age of

first spawning in males occurs one to two years after maturity, but among females is delayed for up to 5 years. Approximate age of a female at first spawning is 11 years in the Hudson and Delaware Rivers. Shortnose sturgeon exhibit a punctuated iteroparous spawning pattern, meaning that both sexes spawn intermittently, about once every 2-11 years [Secor and Woodland]. Shortnose sturgeon typically spawn in the Hudson River during April and May. Adult shortnose sturgeon migrate upriver from their lower and mid-Hudson River overwintering areas to freshwater spawning sites in the river north of the Town/Village of Coxsackie (RM 123) [NYSDEC 2006b]. They are benthic feeders. Juveniles are believed to feed on benthic insects and crustaceans. Mollusks and large crustaceans are the primary food of adult shortnose sturgeon. While the shortnose sturgeon was rarely the target of a commercial fishery, it often was taken incidentally in the commercial fishery for Atlantic sturgeon. The USFWS believed the population level of the shortnose sturgeon had declined because of pollution and overfishing, both directly and incidentally in shad gillnets. [NMFS 2007]

Impingement on intake structures has been studied at Hudson River power plants since 1972. In 2000 NMFS stated that only 63 shortnose sturgeon have been collected in impingement samples from all six power plants on the Hudson River during a 26 year interval [NMFS 2000, Section 5]. The condition of some of the individuals collected during impingement sampling events (i.e., degree of decay) indicated that at least some of those collected were dead prior to collection. There was no seasonal pattern of impingement for shortnose sturgeon. Overall for the six electric power generation plants, the average impingement was 10.2 fish per year between 1972-1998, but 7.5 fish per year between 1989 - 1998. The NMFS estimated impingement at Indian Point to be approximately 0.8 per year each at IP2 and IP3 or 1.6 fish per year for the entire site since the installation of the Ristroph screens at the site in 1990 and 1991. By comparison, Roseton and Danskammer Point were estimated to impinge an average of approximately 1.5 and 4.4 shortnose sturgeon per year, respectively. [NMFS 2000, Section 5.2.2].

The Atlantic sturgeon is anadromous, migrating from salt water to spawn in freshwater. Spawning adults migrate upriver in spring, beginning in February-March in the south, April-May in the mid-Atlantic, and May-June in Canadian waters. In some areas, a small spawning migration may also occur in the fall. Spawning occurs in flowing water between the salt front and fall line of large rivers. Following spawning, males may remain in the river or lower estuary until the fall, females typically exit the rivers within four to six weeks. Adults forage on benthic invertebrates (mussels, worms, shrimp), live up to 60 years, reach lengths up to 14 feet, and weigh more than 800 pounds. Juveniles move downstream and inhabit brackish waters for a few months; at about 76-92 cm total length, they move into coastal waters. Age of female sexual maturity is thought to be between 15-30 years in the Hudson River. Tagging data indicate that immature Atlantic sturgeon travel widely once they emigrate from their natal rivers.

A large U.S. commercial fishery (100,000 - 250,000 lbs/yr) existed for the Atlantic sturgeon from the 1950s through the mid-1990s; the origin of the fishery dates back to colonial times. The Atlantic sturgeon is managed under a Fishery Management Plan implemented by the ASMFC; a coast-wide moratorium on the harvest of wild Atlantic sturgeon was implemented in late 1997/early 1998. This moratorium is to remain in effect until there are at least 20 protected year classes in each spawning stock (anticipated to take up to 40 or more years). The Atlantic

Sturgeon status review was completed in September 1998 in response to a petition, and it was scheduled to be updated in 2003. In 1998, NMFS and USFWS determined that Atlantic sturgeon did not warrant listing as threatened or endangered under the ESA. However, because of concerns regarding its status and uncertainties, NMFS retained this species on its candidate list. In April 2004 the Atlantic sturgeon was transferred to NMFS' species of concern list. The status review report was actually updated in 2005-06, and it is currently undergoing peer review. In October 2006, NMFS determined that any species for which NMFS has initiated an ESA status review that has been announced formally in the Federal Register will be considered a candidate species as well as a species of concern, adding Atlantic sturgeon back to the candidate species list again. [NMFS 2006]

Entergy received NMFS input on the presence of listed species in the vicinity of Indian Point in January 2007. Due to limited resources, the USFWS directed Entergy to their website to determine the occurrence of Federally-listed threatened and endangered species in the vicinity of the site. Both agencies have identified the shortnose sturgeon in the vicinity of Indian Point. NMFS has also mentioned the presence of the Atlantic sturgeon in the vicinity of Indian Point, which NMFS is considering as a Candidate Species, and has initiated a status review for threatened or endangered species listing.

NMFS indicated a potential for entrainment of Atlantic sturgeon larvae in the region in which Indian Point is located. NMFS noted sturgeon yolk sac larvae (YSL) and PYSL have been documented in the vicinity of Indian Point, but assumes the larvae in the lower river area (RM 48 to 110) are Atlantic sturgeon. NMFS also indicated the potential for impingement of shortnose sturgeon on the IP2 and IP3 intake screens. In its January 2007 letter, NMFS requested additional information from Entergy regarding the impacts of its intake and discharge on sturgeon species. In a March 2007 follow-up letter received from the NMFS as a result of discussions between Entergy and the NMFS, the agency clarified its position regarding sturgeon species entrainment and impingement, citing Section 7(a)(2) of the Endangered Species Act (ESA) which requires a Section 7 consultation for a federal action such as the renewal of an operating license. If it is determined through consultation between the NRC and NMFS that the action is not likely to adversely affect any listed species, then no additional measures are necessary. However, if it is determined that the action is likely to adversely affect any listed species, then a formal consultation resulting in the issuance of a Biological Opinion and accompanying Incidental Take Statement would be required (See [Attachment A](#)).

The impact on sturgeon is discussed in [Section 4.10.5](#) of this ER. Impacts on other fish and shell fish from current operations and during the license renewal stage are discussed in [Sections 4.2, 4.3, and 4.4](#) of this ER. However, as noted above, NMFS has previously stated in biological assessments involving the shortnose sturgeon that, overall, the intakes and discharges of Hudson River power plants are unlikely to jeopardize the recovery of the Hudson River shortnose sturgeon population.

The Indiana bat is described by the NYSDEC in the State of New York as having distribution limited to known wintering locations—caves and mines in which they hibernate. There are eight hibernacula currently known in Albany, Essex, Warren, Jefferson, Onondaga, and Ulster

Counties. It is certain that the summer range of this species extends well beyond these counties as the animals disperse to breeding areas and other habitats to feed and raise their young [NYSDEC 2006a]. However, there have been no sightings of the Indiana bat either onsite or within the vicinity of the site.

The bog turtle has historically been found in many counties throughout the State of New York, but extant populations are currently found in only six New York counties. There are historic records of the bog turtle being found in Westchester County, but it is unknown if there are any extant bog turtle populations in the county. The bog turtle prefers open-canopy wet meadows, sedge meadows, and calcareous fens. The known habitat in the Lake Plain region of the state includes large fens that may include various species of sedges, such as slender sedge (*Carex lasiocarpa*), bog buckbean (*Menyanthes trifoliata*), mosses (*Sphagnum* spp.), pitcher plants (*Sarracenia* sp.), scattered trees, and scattered shrubs. In the Hudson River Valley, bog turtle habitats may be isolated from other wetlands or they may exist as part of larger wetland complexes. [NYNHP 2006a] There have been no sightings of the bog turtle either onsite or within the vicinity of the site.

The State of New York also protects additional species as endangered, threatened, species of special concern, and, in the case of certain plants, rare. Table 2-4 lists federal species and state listed endangered, threatened, or species of special concern possibly occurring in Westchester County, where the site is located, or within 6 miles of the plant. State listed species include an additional nine animal species (five birds, three reptiles/amphibians, and one insect) and 156 plant species. None of these state listed species are known to occur on the site and are therefore not discussed in this ER. Species potentially within 6 miles of the IP site are noted with an asterisk in Table 2-4.

**Table 2-4
 Federal and New York State Protected** Species**

Scientific Name	Common Name	Federal Status	State Status
Reptiles and Amphibians			
<i>Carphophis amoenus</i>	Worm Snake*	-	SC
<i>Clemmys muhlenbergii</i>	Bog Turtle	T	E
<i>Crotalus horridus</i>	Timber Rattlesnake*	-	T
<i>Sceloporus undulatus</i>	Fence Lizard*	-	T
Birds			
<i>Circus cyaneus</i>	Northern Harrier	-	T
<i>Cistothorus platensis</i>	Sedge Wren	-	T
<i>Falco peregrinus</i>	Peregrine Falcon*	-	E

**Table 2-4
 Federal and New York State Protected** Species**

Scientific Name	Common Name	Federal Status	State Status
<i>Haliaeetus leucocephalus</i>	Bald Eagle*	T	T
<i>Ixobrychus exilis</i>	Least Bittern*	-	T
<i>Podilymbus podiceps</i>	Pied-billed Grebe*	-	T
Mammals			
<i>Myotis sodalis</i>	Indiana Bat	E	E
<i>Sylvilagus transitionalis</i>	New England Cottontail Rabbit	C	-
Fish			
<i>Acipenser oxyrinchus oxyrinchus</i>	Atlantic Sturgeon	C	-
<i>Acipenser brevirostrum</i>	Shortnose Sturgeon*	E	E
Insects			
<i>Tachopteryx thoreyi</i>	Gray Petaltail*	-	SC
Plants			
<i>Acalypha virginica</i>	Virginia Three-seeded Mercury	-	E
<i>Agastache nepetoides</i>	Yellow Giant-hyssop	-	T
<i>Ageratina aromatica</i> var. <i>aromatica</i>	Small White Snakeroot	-	E
<i>Agrimonia rostellata</i>	Woodland Agrimony*	-	T
<i>Amaranthus pumilus</i>	Seabeach Amaranth	-	E
<i>Aplectrum hyemale</i>	Puttyroot	-	E
<i>Arethusa bulbosa</i>	Dragon's Mouth Orchid	-	E
<i>Aristolochia serpentaria</i>	Virginia Snakeroot	-	E
<i>Asclepias variegata</i>	White Milkweed	-	E
<i>Asclepias viridiflora</i>	Green Milkweed	-	T
<i>Bidens beckii</i>	Water Marigold	-	T
<i>Bidens bidentoides</i>	Delmarva Beggar-ticks	-	R
<i>Bidens laevis</i>	Smooth Bur-marigold*	-	T
<i>Blephilia ciliata</i>	Downy Wood-mint	-	E

**Table 2-4
 Federal and New York State Protected** Species**

Scientific Name	Common Name	Federal Status	State Status
<i>Bolboschoenus maritimus</i> ssp. <i>paludosus</i>	Seaside Bulrush	-	E
<i>Bolboschoenus novae-angliae</i>	Saltmarsh Bulrush*	-	E
<i>Botrychium oneidense</i>	Blunt-lobe Grape Fern	-	E
<i>Bouteloua curtipendula</i> var. <i>curtipendula</i>	Side-oats Grama	-	E
<i>Callitriche terrestris</i>	Terrestrial Starwort*	-	T
<i>Cardamine longii</i>	Long's Bittercress*	-	T
<i>Carex abscondita</i>	Thicket Sedge	-	T
<i>Carex arcta</i>	Northern Clustered Sedge	-	E
<i>Carex bicknellii</i>	Bicknell's Sedge	-	T
<i>Carex conjuncta</i>	Soft Fox Sedge	-	E
<i>Carex cumulata</i>	Clustered Sedge*	-	T
<i>Carex davisii</i>	Davis' Sedge	-	T
<i>Carex hormathodes</i>	Marsh Straw Sedge*	-	T
<i>Carex lupuliformis</i>	False Hop Sedge*	-	R
<i>Carex mesochorea</i>	Midland Sedge*	-	E
<i>Carex mitchelliana</i>	Mitchell's Sedge	-	T
<i>Carex molesta</i>	Troublesome Sedge	-	T
<i>Carex nigromarginata</i>	Black-edge Sedge	-	E
<i>Carex retroflexa</i>	Reflexed Sedge	-	E
<i>Carex seorsa</i>	Weak Stellate Sedge	-	T
<i>Carex straminea</i>	Straw Sedge*	-	E
<i>Carex styloflexa</i>	Bent Sedge	-	E
<i>Carex typhina</i>	Cat-tail Sedge	-	T
<i>Carya laciniosa</i>	Big Shellbark Hickory	-	T

**Table 2-4
 Federal and New York State Protected** Species**

Scientific Name	Common Name	Federal Status	State Status
<i>Castilleja coccinea</i>	Scarlet Indian-paintbrush	-	E
<i>Ceratophyllum echinatum</i>	Prickly Hornwort	-	T
<i>Chamaelirium luteum</i>	Fairy Wand	-	T
<i>Cheilanthes lanosa</i>	Woolly Lip-fern	-	E
<i>Chenopodium berlandieri</i> var. <i>macrocalycium</i>	Large Calyx Goosefoot	-	E
<i>Chenopodium rubrum</i>	Red Pigweed	-	T
<i>Crassula aquatica</i>	Water Pigmyweed	-	E
<i>Crotalaria sagittalis</i>	Rattlebox	-	E
<i>Cyperus echinatus</i>	Globose Flatsedge	-	E
<i>Cyperus flavescens</i>	Yellow Flatsedge*	-	E
<i>Cyperus retrorsus</i> var. <i>retrorsus</i>	Retorse Flatsedge	-	E
<i>Cypripedium parviflorum</i> var. <i>parviflorum</i>	Small Yellow Ladyslipper	-	E
<i>Desmodium ciliare</i>	Little-leaf Tick-trefoil	-	T
<i>Desmodium humifusum</i>	Spreading Tick-trefoil	-	E
<i>Desmodium laevigatum</i>	Smooth Tick-trefoil	-	E
<i>Desmodium nuttallii</i>	Nuttall's Tick-trefoil	-	E
<i>Desmodium obtusum</i>	Stiff Tick-trefoil	-	E
<i>Desmodium pauciflorum</i>	Small-flowered Tick-trefoil	-	E
<i>Dichanthelium oligosanthes</i> var. <i>oligosanthes</i>	Few-flowered Panic Grass	-	E
<i>Digitaria filiformis</i>	Slender Crabgrass	-	T
<i>Diospyros virginiana</i>	Persimmon	-	T
<i>Draba reptans</i>	Carolina Whitlow-grass	-	T
<i>Eclipta prostrata</i>	False-daisy*	-	E
<i>Eleocharis equisetoides</i>	Knotted Spikerush	-	T

**Table 2-4
 Federal and New York State Protected** Species**

Scientific Name	Common Name	Federal Status	State Status
<i>Eleocharis ovata</i>	Blunt Spikerush	-	E
<i>Eleocharis quadrangulata</i>	Angled Spikerush	-	E
<i>Eleocharis tricostata</i>	Three-ribbed Spikerush	-	E
<i>Eleocharis tuberculosa</i>	Long-tubercled Spikerush	-	T
<i>Equisetum palustre</i>	Marsh Horsetail	-	T
<i>Equisetum pratense</i>	Meadow Horsetail	-	T
<i>Euonymus americanus</i>	American Strawberry-bush	-	E
<i>Fimbristylis castanea</i>	Marsh Fimbry	-	T
<i>Fuirena pumila</i>	Dwarf Umbrella-sedge	-	R
<i>Gamochaeta purpurea</i>	Purple Everlasting	-	E
<i>Geranium carolinianum</i> var. <i>sphaerospermum</i>	Carolina Cranesbill	-	T
<i>Geum vernum</i>	Spring Avens	-	E
<i>Geum virginianum</i>	Rough Avens	-	E
<i>Hottonia inflata</i>	Featherfoil	-	T
<i>Houstonia purpurea</i> var. <i>purpurea</i>	Purple Bluets	-	E
<i>Hylotelephium telephioides</i>	Live-forever	-	E
<i>Hypericum prolificum</i>	Shrubby St. John's-wort	-	T
<i>Iris prismatica</i>	Slender Blue Flag	-	T
<i>Jeffersonia diphylla</i>	Twin-leaf	-	T
<i>Lechea pulchella</i> var. <i>moniliformis</i>	Bead Pinweed	-	E
<i>lechea racemulose</i>	Illinois Pinweed	-	R
<i>Lechea tenuifolia</i>	Slender Pinweed	-	T
<i>Lemna perpusilla</i>	Minute Duckweed	-	E
<i>Lespedeza angustifolia</i>	Narrow-leaved Bush-clover	-	R
<i>Lespedeza repens</i>	Trailing Bush-clover	-	R

**Table 2-4
 Federal and New York State Protected** Species**

Scientific Name	Common Name	Federal Status	State Status
<i>Lespedeza stuevei</i>	Velvety Bush-clover	-	T
<i>Lespedeza violacea</i>	Violet Bush-clover	-	R
<i>Liatris scariosa</i> var. <i>novae-angliae</i>	Northern Blazing-star	-	T
<i>Lilaeopsis chinensis</i>	Eastern Grasswort	-	T
<i>Limosella australis</i>	Mudwort	-	R
<i>Linum striatum</i>	Stiff Yellow Flax	-	R
<i>Liparis lilifolia</i>	Large Twayblade	-	E
<i>Lipocarpa micrantha</i>	Dwarf Bulrush	-	E
<i>Listera convallarioides</i>	Broad-lipped Twayblade	-	E
<i>Ludwigia sphaerocarpa</i>	Globe-fruited Ludwigia	-	T
<i>Lycopus rubellus</i>	Gypsy-wort	-	E
<i>Lysimachia hybrida</i>	Lance-leaved Loosestrife	-	E
<i>Magnolia virginiana</i>	Sweetbay Magnolia	-	E
<i>Melanthium virginicum</i>	Virginia Bunchflower	-	E
<i>Mimus alatus</i>	Winged Monkeyflower	-	R
<i>Monarda clinopodia</i>	Basil-balm	-	E
<i>Oldenlandia uniflora</i>	Clustered Bluets	-	E
<i>Oligoneuron rigidum</i> var. <i>rigidum</i>	Stiff-leaf Goldenrod	-	T
<i>Onosmodium virginianum</i>	Virginia False Gromwell	-	E
<i>Orontium aquaticum</i>	Golden Club	-	T
<i>Oxalis violacea</i>	Violet Wood-sorrel	-	T
<i>Oxypolis rigidior</i>	Stiff Cowbane	-	E
<i>Panicum rigidulum</i> var. <i>elongatum</i>	Tall Flat Panic Grass	-	E
<i>Paspalum laeve</i>	Field Beadgrass	-	E
<i>Pinus virginiana</i>	Virginia Pine*	-	E
<i>Platanthera ciliaris</i>	Orange Fringed Orchid	-	E

**Table 2-4
 Federal and New York State Protected** Species**

Scientific Name	Common Name	Federal Status	State Status
<i>Platanthera hookeri</i>	Hooker's Orchid	-	E
<i>Podostemum ceratophyllum</i>	Riverweed*	-	T
<i>Polygala lutea</i>	Orange Milkwort	-	E
<i>Polygonum douglasii</i> ssp. <i>douglasii</i>	Douglas' Knotweed	-	T
<i>Polygonum erectum</i>	Erect Knotweed	-	E
<i>Polygonum glaucom</i>	Seabeach Knotweed		R
<i>Polygonum tenue</i>	Slender Knotweed	-	R
<i>Potamogeton diversifolius</i>	Water-thread Pondweed	-	E
<i>Potamogeton pulcher</i>	Spotted Pondweed*	-	T
<i>Pterospora andromedea</i>	Giant Pine-drops	-	E
<i>Pycnanthemum clinopodioides</i>	Basil Mountain-mint*	-	E
<i>Pycnanthemum muticum</i>	Blunt Mountain-mint	-	T
<i>Pycnanthemum torrei</i>	Torrey's Mountain-mint*	-	E
<i>Ranunculus micranthus</i>	Small-flowered Crowfoot*	-	T
<i>Rhynchospora scirpoides</i>	Long-Beaked Beakrush	-	R
<i>Sabatia angularis</i>	Rose-pink	-	E
<i>Sagittaria montevidensis</i> var. <i>spongiosa</i>	Spongy Arrowhead*	-	T
<i>Salvia lyrata</i>	Lyre-leaf Sage	-	E
<i>Scirpus georgianus</i>	Georgia Bulrush	-	E
<i>Scleria pauciflora</i> var. <i>caroliniana</i>	Few-flowered Nutrush	-	E
<i>Scutellaria integrifolia</i>	Hyssop-skullcap	-	E
<i>Sericocarpus linifolius</i>	Flax-leaf Whitetop	-	T
<i>Sisyrinchium mucronatum</i>	Michaux's Blue-eyed-grass	-	E
<i>Smilax pulverulenta</i>	Jacob's-ladder	-	E
<i>Solidago latissimifolia</i>	Coastal Goldenrod	-	E

**Table 2-4
 Federal and New York State Protected** Species**

Scientific Name	Common Name	Federal Status	State Status
<i>Solidago sempervirens</i> var. <i>mexicana</i>	Seaside Goldenrod	-	E
<i>Sporobolus clandestinus</i>	Rough Rush-grass	-	E
<i>Suaeda linearis</i>	Narrow-leaf Sea-blite	-	E
<i>Symphyotrichum boreale</i>	Northern Bog Aster	-	T
<i>Symphyotrichum subulatum</i> var. <i>subulatum</i>	Saltmarsh Aster*	-	T
<i>Trichomanes intricatum</i>	Appalachian Trichomanes	-	E
<i>Trichostema setaceum</i>	Tiny Blue-curls	-	E
<i>Tripsacum dactyloides</i>	Northern Gamma Grass	-	T
<i>Trollius laxus</i>	Spreading Globeflower	-	R
<i>Utricularia minor</i>	Lesser Bladderwort	-	T
<i>Utricularia radiata</i>	Small Floating Bladderwort*	-	T
<i>Veronicastrum virginicum</i>	Culver's-root	-	T
<i>Viburnum dentatum</i> var. <i>venosum</i>	Southern Arrowwood	-	T
<i>Viburnum nudum</i> var. <i>nudum</i>	Possum-haw	-	E
<i>Viola brittoniana</i>	Coast Violet	-	E
<i>Viola hirsutula</i>	Southern Wood Violet	-	E
<i>Viola primulifolia</i>	Primrose-leaf Violet	-	T
<i>Vitis vulpina</i>	Winter Grape	-	E

References: [NYSDEC 2005b](#)
[NYNHP 2006b](#)

* Plants and animals denoted by the NYNHP as being within 6 miles of the site.

** "Protected", in this instance only, refers to Threatened, Endangered, Species of Special Concern, and Rare (Plants). It does not include the New York state status of "protected".

E = endangered
 T = threatened
 SC = special concern
 R = rare
 C = candidate

2.6 Regional Demography

2.6.1 Regional Population

The *Generic Environmental Impact Statement for License Renewal of Nuclear Plants* (GEIS) presents a population characterization method that is based on two factors: "sparseness" and "proximity" [NRC 1996, Section C.1.4]. "Sparseness" measures population density and city size within 20 miles of a site and categorizes the demographic information as follows.

Demographic Categories Based on Sparseness	
Category	
Most sparse	1. Less than 40 persons per square mile and no community with 25,000 or more persons within 20 miles 2. 40 to 60 persons per square mile and no community with 25,000 or more persons within 20 miles 3. 60 to 120 persons per square mile or less than 60 persons per square mile with at least one community with 25,000 or more persons within 20 miles
Least sparse	4. Greater than or equal to 120 persons per square mile within 20 miles

[NRC 1996]

"Proximity" measures population density and city size within 50 miles and categorizes the demographic information as follows.

Demographic Categories Based on Sparseness	
Category	
Not in close proximity	1. No city with 100,000 or more persons and less than 50 persons per square mile within 50 miles 2. No city with 100,000 or more persons and between 50 and 190 persons per square mile within 50 miles 3. One or more cities with 100,000 or more persons and less than 190 persons per square mile within 50 miles
In close proximity	4. Greater than or equal to 190 persons per square mile within 50 miles

[NRC 1996]

The GEIS then uses the following matrix to rank the population in the vicinity of the plant as low, medium, or high.

GEIS Sparseness and Proximity Matrix					
		Proximity			
		1	2	3	4
Sparseness	1	1.1	1.2	1.3	1.4
	2	2.1	2.2	2.3	2.4
	3	3.1	3.2	3.3	3.4
	4	4.1	4.2	4.3	4.4



Low
Population
Area



Medium
Population
Area



High
Population
Area

[NRC 1996]

2000 census data from the U.S. Census Bureau (USCB) was used to determine demographic characteristics in the vicinity of the site. These data were processed at the state, county, and census block levels using ESRI ArcView® [ESRI 2005; [Census 2000 TIGER](#)] and Landview geographical information system (GIS) software [[Landview 6](#)].

The 2000 census data indicates that approximately 1,113,089 people live within a 20-mile radius of the site, which equates to a population density of 886 persons per square mile [[Landview 6](#)]. According to the GEIS sparseness index, the site is classified as Category 4 sparseness (having greater than or equal to 120 persons per square mile within 20 miles).

The 2000 census data indicates that approximately 16,791,654 people live within a 50-mile radius of the site, which equates to a population density of 2,138 persons per square mile [[Landview 6](#)]. According to the GEIS proximity index, the site is classified as Category 4 proximity (greater than or equal to 190 persons per square mile within 50 miles).

According to the GEIS sparseness and proximity matrix, the combination of sparseness Category 4 and proximity Category 4 results in the conclusion that the site is located in a "high" population area.

The area within 50 miles of the site includes twenty-eight counties from four states that are wholly or partially included within the 50-mile radius as shown in Table 2-5. According to the 2000 census, the total permanent population (not including transient populations) of these counties was approximately 19,939,233 as shown in Table 2-5. The total population (not including transients populations) within a 50-mile radius of the site was approximately 16,791,654 in 2000 [Census 2000 TIGER]

Since the license renewal period for IP3 would end in 2035, projected permanent populations for each county are shown in Table 2-5 through 2035, which includes the IP2 and IP3 license renewal periods. The total population (not including transient populations) of these counties is projected to be approximately 23,129,314 in 2035, an increase from the 2000 population of 19,939,233. The total population (including transient populations) within a 50-mile radius of the site is projected to be 19,228,712 in 2035. [Brown; Census 2000 TIGER; PPNJ; PPC; PPP].

**Table 2-5
State and County Population, 50-Mile Radius of IP2 and IP3**

State and County	2000 Population	2035 Projected Permanent Population
New York (14 Counties)	12,941,380	14,649,596
Suffolk	1,419,369	1,490,766
Rockland	286,753	278,799
Westchester	923,459	914,934
Richmond	443,728	662,838
Bronx	1,332,650	1,634,750
New York	1,537,195	1,570,657
Queens	2,229,379	3,024,717
Kings	2,465,326	2,618,418
Nassau	1,334,544	1,251,644
Orange	341,367	445,234
Ulster	177,749	222,655
Sullivan	73,966	94,055
Dutchess	280,150	319,391
Putnam	95,745	120,738

**Table 2-5
State and County Population, 50-Mile Radius of IP2 and IP3**

State and County	2000 Population	2035 Projected Permanent Population
Connecticut (3 Counties)	1,888,768	2,032,273
Fairfield	882,567	918,600
New Haven	824,008	896,364
Litchfield	182,193	217,309
New Jersey (10 counties)	5,062,783	6,344,008
Sussex	144,166	217,947
Bergen	884,118	1,089,428
Somerset	297,490	470,131
Middlesex	750,162	1,053,511
Passaic	489,049	553,404
Warren	102,437	156,074
Morris	470,212	653,201
Essex	793,633	868,715
Hudson	608,975	690,981
Union	522,541	590,616
Pennsylvania (1 County)	46,302	103,437
Pike	46,302	103,437
TOTAL POPULATION	19,939,233	23,129,314

Towns and Villages near the site include the Village of Buchanan, the Village of Croton, and the City of Peekskill, New York (Westchester County), and the Village of Haverstraw, New York (Rockland County). According to the 2000 census, the populations of these areas were 2,189; 7,606; 22,441; and 33,811, respectively [[Census 2000 TIGER](#)].

The five counties within New York nearest the site (Dutchess, Putnam, Rockland, Orange, and Westchester Counties) are of special significance in evaluation of demographic and economic impacts. The site is located in Westchester County, but is near the boundaries of Rockland County (across the Hudson River), Putnam County (to the north), and Orange County (northwest across the Hudson River). Dutchess County is located north of Putnam County, but, as of June

2006, has the distinction of being the county with the largest number of IP2 and IP3 employee residences (see [Table 3-2](#)). In 2004, Dutchess, Putnam, Rockland, Orange, and Westchester Counties had a combined total permanent population of 2,000,387 (refer to [Table 2-6](#)).

From 1990 to 2000, the average annual growth rates for these counties were 0.77 percent for Dutchess County, 0.54 percent for Westchester County, 0.77 percent for Rockland County, 1.32 percent for Putnam County, and 1.05 percent for Orange County. All counties had greater growth rates than the rate of New York State during the same period. From 1990 to 2000, the state-level average annual growth rate for the State of New York was 0.52 percent [[Census 2000 TIGER](#)].

[Table 2-6](#) shows estimated total populations and average annual growth rates between each census for the five counties with the greatest potential to be socioeconomically affected by license renewal activities at the site. Average annual growth rates for 2004 are based on comparison against 2000 population data, and rates for 2025 and 2035 are based on comparison against 2004 population data [[Census 2000 TIGER](#); [Brown](#)].

Table 2-6
Putnam County (NY), Rockland County (NY), Orange County (NY), Westchester County (NY), and Dutchess County (NY)
Population Growth, 1990–2035

Year	Putnam County (NY)		Rockland County (NY)		Orange County (NY)		Westchester County (NY)		Dutchess County (NY)	
	Population	Average Annual Growth %	Population	Average Annual Growth %	Population	Average Annual Growth %	Population	Average Annual Growth %	Population	Average Annual Growth %
1990 ^a	83,941	--	265,475	--	307,647	--	874,866	--	259,462	--
2000 ^a	95,745	1.32	286,753	0.77	341,367	1.05	923,459	0.54	280,150	0.77
2004 ^a	100,570	1.24	293,626	0.59	370,352	2.05	942,444	0.51	293,395	1.16
2025 ^b	113,917	0.60	288,593	-0.08	415,973	0.55	919,864	-0.12	309,007	0.25
2035 ^a	120,738	0.58	278,799	-0.34	445,234	0.68	914,934	-0.05	319,391	0.33

- a. [Census 2000 TIGER](#)
- b. [Brown](#); [Census 2000 TIGER](#)

2.6.2 Minority and Low-Income Populations

2.6.2.1 Background

The NRC performs environmental justice analyses utilizing a 50-mile radius around the plant as the environmental "impact site" and the four states individually when all or part of a block group is in those states as the "geographic area" for comparative analysis. This approach is presented below. Since the site is also located in close proximity to New Jersey, Connecticut, and Pennsylvania, an alternative approach is also addressed, which uses a combined geographic area of New Jersey, Connecticut, Pennsylvania, and New York. Both approaches were used for assessing minority and low-income population criteria.

NRC guidance suggests using the most recent USCB decennial census data. The 2000 census population data and TIGER/Line data for New York, New Jersey, Connecticut, and Pennsylvania were obtained from the USCB web site and processed using ESRI ArcView® GIS software [ESRI 2006]. Population data at the census block group level were used to identify the minority and low-income population data within a 50-mile radius of the site. A total of 13,126 census block groups were found in this area. The results were compiled and maps were produced showing the geographic location of minority and low-income populations in relation to the site. Information for these block groups was then reviewed with respect to the Nuclear Reactor Regulation criteria for minority and low-income populations [NRC 2004].

2.6.2.2 Minority Populations

The NRC Procedural Guidance for Performing Environmental Assessments and Considering Environmental Issues defines a "minority" population as American Indian or Alaskan Native, Asian, Native Hawaiian or Pacific Islander, Black, other, multi-racial, the aggregate of all minority races, or Hispanic ethnicity [NRC 2004, page D-8]. The guidance indicates that a minority population is considered to be present if either of the two following conditions exists.

- (1) The minority population in the census block group exceeds 50 percent.
- (2) The minority population is more than 20 percentage points greater in the census block group than it is in the minority percentage of the geographic area chosen for the comparative analysis.

The 2000 census indicates 32.1% of the population in New York, and 25.1% of the population for the four-state area were minority for all races combined, as shown in [Table 2-7B](#). Using the above criteria for identification of the presence of a minority population, when New York is used as the geographic area, any census block group with a combined minority population equal to or greater than 52.1% would be considered to be a "minority population" by the second criteria. However, since 52.1% exceeds the criteria of 50%, the first criteria (50%) would be used by default. When the four-state area is used as the geographic area, any block group with a combined minority population exceeding 45.1% would be considered to be a "minority population area" by criterion 2.

A four-state area was evaluated for minority population area within census block groups because the area within a 50-mile radius of IP2 and IP3 includes portions of New York, New Jersey, Connecticut, and Pennsylvania. Populations within each state were considered individually and as a four-state area.

[Table 2-7B](#) summarizes the minority populations by race in each state and in the four-state area as a whole. Table 2-7B provides the total population of the racial segment, its percentage when considered against the state population or four-state area, and the criteria percentage which would classify an area with a block group as a minority area of interest using criteria number 2 above. The resulting percentages and criteria are shown in [Table 2-7B](#). [Figures 2-8 through 2-23](#) reveal the areas within block groups within a 50-mile radius that exceed the criteria percentages for race categories defined in [Table 2-7B](#).

The minority population percentages of New York, New Jersey, Connecticut, and Pennsylvania were taken from the USCB data. A combined or aggregate population of the four-state area was calculated based on these state populations.

Each race was considered within each state and within the four-state area as a whole. In addition, an evaluation was completed that identified a percentage of the population where individuals could be classified in two or more racial categories (e.g., Black and American Indian/Alaska Native) for each state geographical area or for the four-state area as a whole. An evaluation was completed that identified a percentage of the population where all racial categories were combined for comparison against the state population or against the four-state population. Finally, an additional evaluation was completed to identify the percentage of the population where all racial categories were combined and added to the Hispanic population counts for each state geographical area and for the four-state geographical area as a whole (see [Table 2-7B](#)).

Because Hispanic is not considered to be a race by the USCB, Hispanics are already represented in the census defined race categories. Because Hispanics can be represented in the any race category, some white Hispanics not otherwise considered as minorities then become classified as a minority when categorized in the All Races Combined plus Hispanics category. Also, Hispanics that are of non-white racial background are included in both the racial group and the Hispanic group, and thereby double counted. The All Race Combined plus Hispanics category, however, results in the greatest chance of consideration of populations within a block group to be classified as minority.

Census block group data was then evaluated using the criteria shown in [Table 2-7B](#). The results of the evaluation are block group areas that are either flagged as not having a minority population or flagged as having a minority population(s). The percentage of block groups flagged as having a minority population are shown in [Table 2-7A](#). The resulting maps, [Figures 2-8 through 2-23](#) show the location of minority populations for each category.

The percentage of census block groups exceeding the All Races Combined minority population criteria was 37.28 percent when a four-state geographic area was used or 34.97 percent when each individual state was used as the geographic area. For the All Races Combined plus

Hispanic category, 45.48 percent of the block groups within the four-state geographic area contained a minority population, and 45.51 percent of the block groups within a 50-mile radius contained minority populations when each individual state was used. The minority population areas within block groups were significantly reduced when races are analyzed individually.

**Table 2-7A
 Minority Census Block Counts within 50-Mile Radius**

	Four State Combined Method		Individual State Method	
	Number of Block Groups with Identified Racial Category	% of Block Groups within 50 miles	Number of Block Groups with Identified Racial Category	% of Block Groups within 50 miles
Black	2817	21.46	2665	20.30
American Indian / Alaska Native	3	0.02	3	0.02
Asian	759	5.78	672	5.12
Native Hawaiian / other Pacific Islander	0	0.00	0	0.00
Two or More Races Combined	17	0.13	16	0.12
Other	1440	10.97	1171	8.92
All Races Combined	4893	37.28	4590	34.97
All Races Combined and Hispanic	5970	45.48	5973	45.51

Table 2-7B
Minority Populations Evaluated Against Criterion

	New York			New Jersey			Connecticut			Pennsylvania			Four-State Area		
	Total Population			Total Population			Total Population			Total Population			Total Population		
	18,976,457			8,414,350			3,405,565			12,281,054			43,077,426		
	Minority Population	%	Criterion	Count	%	Criterion	Count	%	Criterion	Count	%	Criterion	Count	%	Criterion
Black	3,225,998	17	37	1,211,666	14.4	34.4	340,557	10	34.4	10,328,366	10.5	34.4	30,286,554	13.0	33.0
American Indian / Alaska Native	170,788	0.9	20.9	50,486	0.6	20.6	23,839	0.7	20.7	49,124	0.4	20.4	294,237	0.6	20.7
Asian	1,176,540	6.2	26.2	521,690	6.2	26.2	95,356	2.8	22.8	245,621	2	22	2,039,207	4.3	24.3
Native Hawaiian / Other Pacific Islander	37,953	0.2	20.2	8,414	0.1	20.1	3,406	0.1	20.1	-	0	20	49,773	0.1	20.1
Two or More Races	588,270	3.1	23.1	210,359	2.5	22.5	74,922	2.2	22.2	147,373	1.2	21.2	1,020,924	2.3	22.3
All Races Combined	6,091,443	32.1	50.0	2,305,532	47.4	50.0	626,624	18.4	38.4	1,793,034	14.6	34.6	10,816,633	25.1	45.1
All Races Combined and Hispanic	9,791,852	61.6	50.0	3,702,314	44	50.0	1,004,642	29.5	49.5	2,308,838	18.8	38.8	16,807,646	39.0	50.0
Other	1,726,858	9.1	29.1	580,590	6.9	26.9	146,439	4.3	24.3	184,216	1.5	21.5	2,638,103	5.5	25.5

2.6.2.3 Low-Income Populations

NRC guidance defines "low-income" using USCB statistical poverty thresholds [NRC 2004, page D-8]. The guidance identifies an area as a low-income population area if the percentage of households below the poverty level is significantly greater (typically at least 20 percent) than the low-income household percentage in the area chosen for comparative analysis. As addressed above with minority populations, two alternative geographic areas (New York, New Jersey, Connecticut, and Pennsylvania individually and then all four states combined) were used in this analysis.

The 2000 census data indicate that 14.2 percent of the population of New York, 8.3 percent of the population of New Jersey, 7.6 percent of the population of Connecticut, 10.6 percent of the population of Pennsylvania, and 11.5 percent of the population within the four-state area was composed of low-income individuals as shown in [Table 2-8](#). When New York is used as the geographic area, any census block group within a 50-mile radius of the site with low-income population equal to or greater than 34.2 percent of the total block group population would be considered a "low-income population." Using these criteria for each state, 1,370 of the 13,126 census block groups (10.4 percent) within a 50-mile radius of the site have low-income population percentages which meet or exceed the percentages in [Table 2-8](#). Most of these census block groups are located 29 to 40 miles south of the site in the areas of Bronx, Queens, Kings, and New York counties in New York, and Passaic, Hudson, and Essex counties in New Jersey as shown in [Figure 2-24](#).

When the four-state combined area is used as the geographic area, any census block group within a 50-mile radius of the site with low-income populations equal to or greater than 31.5 percent of the total block group population would be considered a "low-income population." Using these criteria, 1,551 of the 13,126 census block groups (11.8 percent) within a 50-mile radius of the site have low-income population percentages which exceed 31.5 percent. Most of these census block groups are located 29 to 40 miles south of the site in the areas of Bronx, Queens, Kings, and New York counties in New York, and Passaic, Hudson, and Essex counties in New Jersey as shown in [Figure 2-25](#).

Table 2-8
Low-Income Population Criteria Using Two Geographic Areas

Geographic Area	Total Population	Number of Persons Below Poverty Level	Percentage of Persons Below Poverty Level	Percentage of Low-Income Criterion
New York	18,976,457	2,692,202	14.2%	34.2%
New Jersey	8,414,350	699,668	8.3%	28.3%
Connecticut	3,405,565	259,514	7.6%	27.6%
Pennsylvania	12,281,054	1,304,117	10.6%	30.6%
Four-State Area	43,077,426	4,955,501	11.5%	31.5%
Reference: Landview 6				

Overall, low-income populations within the 50-mile radius "impact site" were a small percentage of the overall population. The percentage of census block groups exceeding the low-income population criteria was 11.8 percent when a combined four-state geographic area was used or 10.4 percent when the individual states were used as the geographic area.

2.7 Taxes

Payment-in-lieu-of-taxes (PILOT) payments, property taxes, and other taxes from the site are paid directly to the Town of Cortlandt, the Village of Buchanan, and the Hendrick Hudson Central School District (see [Table 2-9](#)). The payments to the Town of Cortlandt are distributed to the Town of Cortlandt, Westchester County, the Verplanck Fire District, the Hendrick Hudson Central School District, and Lakeland Central Schools.

As shown in [Table 2-9](#), the site paid a combined \$21.2 million in PILOT payments, property taxes, and other taxes to Westchester County, the Town of Cortlandt, the Village of Buchanan, the Verplanck Fire District, and the Hendrick Hudson Central School District in 2005. PILOT payments, property taxes, and other taxes paid by the site account for a significant portion of revenues for these government agencies ([Table 2-9](#)). Approximately 70 percent of the PILOT payments go to the Hendrick Hudson Central School District (see [Table 2-9](#)). The remainder is divided between the Village of Buchanan, Westchester County, the Town of Cortlandt, and the Verplanck Fire District.

The Village of Buchanan is the principal local jurisdiction that receives direct revenue from the site. In fiscal year 2005, PILOT payments, property taxes, and other taxes from the site contributed about 39 percent of the Village of Buchanan's total revenue of \$5.08 million, which is used for police, fire, health, transportation, recreation, and other community services for over 2,100 residents [[NYSOSC](#)]. Additionally in fiscal year 2005, PILOT payments, property taxes,

and other taxes from the site contributed over 35% of the total revenue collected for the Hendrick Hudson Central School District, which serves 2,885 students.

A report by the Nuclear Energy Institute (NEI) concluded that the site, which is located near the Village of Buchanan, had an economic impact of \$763 million in 2002 in Westchester, Rockland, Orange, Putnam, and Dutchess counties [NEI]. Taxes and PILOT payments paid by the site have a positive impact on the fiscal condition of Westchester County, especially the school districts. Continued operation of the plant would provide a significant continuing source of tax revenues to the local community.

Entergy also pays approximately one million dollars per year to NYSERDA for lease of the discharge canal structure and underlying land [NYSERDA]. These are additional monies which Entergy contributes to the New York State economic base.

**Table 2-9
Tax Distribution, 2003–2006^a**

Taxes Paid To	Tax Recipients	Type of Tax	2003	2004	2005	2006
Town of Cortlandt	Westchester County, Town of Cortlandt, Verplanck Fire District	PILOT and Property Tax	5,023,579	4,659,642	3,773,590	3,748,804
Town of Cortlandt ^b	Hendrick Hudson Central School District (CSD)	PILOT	10,077,000	--	--	--
Hendrick Hudson CSD ^b	Hendrick Hudson Central School District (CSD)	PILOT	--	9,524,000	9,358,500	7,585,000
Hendrick Hudson CSD ^c	Hendrick Hudson Central School District (CSD)	PILOT	9,524,000	9,358,500	7,585,000	7,688,500
Town of Cortlandt ^b	Lakeland Central Schools	Property Tax	32,710	35,569	--	--
Town of Cortlandt ^c	Lakeland Central Schools	Property Tax	35,569	--	--	--
Town of Cortlandt ^c	Lakeland Central Schools and Hendrick Hudson CSD	Property Tax	--	190,099	277,337	314,297

**Table 2-9
Tax Distribution, 2003–2006^a**

Taxes Paid To	Tax Recipients	Type of Tax	2003	2004	2005	2006
Village of Buchanan ^d	Village of Buchanan	PILOT and Property Tax	2,271,753	2,184,044	1,984,680	2,023,151
New York State Department of Taxation and Finance	Westchester County	Sales Use	484,149	797,281	279,724	168,253
New York State Department of Taxation and Finance	State of New York	Sales Use	725,014	1,060,973	356,056	199,411
	Total		28,173,774	27,810,108	23,614,887	21,727,416

- a. Fiscal year, if not otherwise defined, extends from January 1st of indicated year through December 31st of the year.
- b. Fiscal year extends from July 1st of prior year through June 30th of the indicated year.
- c. Fiscal year extends from July 1st of indicated year through June 30th of the subsequent year.
- d. Fiscal year extends from June 1st of indicated year through May 31st of the subsequent year.

The energy market in the State of New York has been deregulated to encourage the development of competition of the production and sale of electricity. A study performed by the New York State Board of Real Property Services concluded that the value of many power generating plants is likely to decline in a deregulated market [SNY]. However, the expectation is that any new PILOT payments negotiated in the license renewal term should be similar to the payments shown in Table 2-9.

2.8 Land Use Planning

Land use planning focuses on Westchester, Rockland, Dutchess, Orange, and Putnam counties in New York, since the operation of the site and its associated tax base as well as employment is important to the economy of these counties. These counties are the major residences for the site employees that affect several facets of land use. Unlike the direct contributions to the Westchester County tax base, the surrounding counties still retain the benefits of increased property tax revenue and an expanded economy based on the 1,255 people employed by the site (as of June 2006).

2.8.1 Existing Land Use Trends

Westchester County occupies roughly 500 square miles (320,000 acres). Westchester County is hillier in the north with elevations ranging from approximately 984 feet above sea level at Bailey Mountain, to approximately sea level along the Hudson River that borders the western edge of the county [USGS 1999]. Approximately 9,917 acres were in agricultural land use as of 2002, and major agricultural land uses consist of woodland (48.84%), cropland (24.83%), pasture (12.81%), and other uses (13.53%) [USCB 2000c; USDA 2002e]. Other than agriculture, the U.S. Census does not define land uses within counties. The USGS National Land Cover Database does provide land use information, including, but not limited to, commercial/industrial and residential land use. Other land uses are provided from the most recent (1992 for New York) USGS database for Westchester County in Table 2-10 [USGS 1992]. As reflected in Table 2-10, residential land areas cover approximately 30.1 percent of the 320,000 acres in Westchester County, with approximately 3.1 percent being devoted to commercial/industrial/transportation uses.

Dutchess County occupies roughly 825 square miles (528,000 acres) [USCB 2000c]. Dutchess County's highest elevation is the summit of Brace Mountain, at 2,315 feet. The lowest elevation of the county is at sea level along the Hudson River, which is the county's western border [USGS 1999]. The largest category of land use in Dutchess County is agriculture. Evenly distributed throughout the county, land used for agriculture comprises 21.3% (112,339 acres) of the county's area [USDA 2002a]. Major agricultural land uses consist of cropland (52.75%), woodland (23.32%), pasture (11.12%), and other uses (12.81%) [USDA 2002a]. Other land uses are provided from the most recent (1992 for New York) USGS database for Dutchess County in Table 2-10 [USGS 1992]. As reflected in Table 2-10, residential land areas cover approximately 7.1 percent of the 528,000 acres in Dutchess County, with approximately 1.4 percent being devoted to commercial/industrial/transportation uses.

Dutchess County is distinctively different from its neighboring counties to the south in that it contains a combination of urban and rural settings rather than metropolitan areas. Currently Dutchess County is conserving open spaces such as farms while increasing the number of housing units available in order to have urban areas coexist with farms [GCR].

Orange County occupies roughly 839 square miles (536,960 acres). Orange County's highest elevation is Schunemunk Mountain, at 1,663 feet. The lowest elevation in the county is at sea level along the Hudson River, which creates the eastern county border [USGS 1999]. Approximately 107,977 acres are used for agricultural purposes, with major agricultural land uses consisting of cropland (65.53%), woodland (16.50%), pasture (8.99%), and other uses (8.98%) [USCB 2000c; USDA 2002b]. Other land uses provided from the most recent (1992 for New York) USGS data base for Orange County are shown in Table 2-10 [USGS 1992]. As reflected in Table 2-10, residential land areas cover approximately 7.5 percent of the 536,960 acres in Orange County, with approximately 1.7 percent being devoted to commercial/industrial/transportation uses.

Within Orange County three interstates intersect, which provide access to any area within the state of New York and across the United States. A by-product of the county's interstate road access is a clustering of industry and commercial development along the corridors. In the past two decades, "big box" retailers have altered shopping patterns, challenging efforts to reinvigorate commercial centers of traditional downtowns [OCCP]. Recently most new development has occurred in the southeastern corner of the county due to the access to major transportation corridors. Additionally, the largest land development in the southeastern part of the county is the United States Military Academy at West Point (Figure 2-2) [OCCP].

Putnam County occupies roughly 246 square miles (157,440 acres). Approximately 6,720 acres (4.3 percent) are in agricultural use, with major agricultural land uses consisting of woodland (59.87%), cropland (26.49%), and other uses (13.65%) [USCB 2000c; USDA 2002c]. Putnam County's highest elevation is Scofield Ridge, at approximately 1,545 feet. The lowest elevation in the county is at sea level along the Hudson River, which creates the western border [USGS 1999].

Putnam County is one of the fastest growing counties in New York [PC]. Due to the hilly topography covering the majority of the county, development has been prevented in the more rugged parts of the county. Additionally, there are many wetlands throughout the landscape. The most significant wetland in the county is the Great Swamp, which is a 4,200-acre wetland that has been delineated by the NYSDEC. Agricultural land use, undeveloped land, and forest land within the county has experienced a reduction. Residential land use occurs on large lot subdivisions or in rural areas. Industrial and commercial development can be found around the Villages and along the major transportation routes [PC]. Residential land use accounts for approximately 6.9 percent of the County's 157,440 acres, while only 1.1 percent is used for commercial/industrial/transportation purposes (see Table 2-10).

Rockland County occupies roughly 199 square miles (127,360 acres). Approximately 610 acres were in farm land use in 1997, with major agricultural land uses consisting of cropland (47.43%), woodland (31.92%), un-disclosable (18.37%), and other uses (2.29%) [USCB 2000c; USDA 2002d]. Rockland County's highest elevation is Rockhouse Mountain, at 1,280 feet. The lowest elevation of the county is at sea level along the Hudson River, which is the county's eastern border [USGS 1999].

The largest category of land use in Rockland County is state park land. Located in the north and west portions of the county, state park land encompass 30,000 acres or 23.6% of land use in the county [RCNY 2006]. Single-family residential area comprises 26% of land development whereas commercial and business development is comprised of 1.7% and is concentrated along major transportation corridors [RCNY 2001].

Westchester County occupies roughly 432 square miles (276,480 acres). According to the 2002 USDA Census of Agriculture County Profile, 129 farms were located in Westchester County, which is a 10% increase since 1997 [USDA 2002e]. Land acreage associated with farms increased 14% during this period with total acreage increasing from 8,681 acres to over 9,917 acres. The average size of farms also increased 4%, from 74 to 77 acres from 1997 to 2002.

Farming commodities include truck crops (melons, potatoes, and vegetables), berries, sod, and nursery products. The major crops in the county are hay and silage. The major farm commodities in Westchester County are nurseries and greenhouses. [USDA 2002e] As reflected in Table 2-10, residential land uses cover approximately 30.1 percent of the 276,480 acres in Westchester County, with approximately 3.1 percent being devoted to commercial/ transportation uses.

The Town of Cortlandt, located within Westchester County, encompasses 34.5 square miles (22,080 acres) [TOCNY 2006]. Land use is predominately residential zoning with half-acre to two-acre plots further protecting environmentally sensitive areas and open spaces [TOCNY 2004]. The town's growth was intentionally slowed over the past several decades, allowing the town's leaders to plan its development. Significant commercial development has taken place along major transportation corridors, as well as new community facilities within the area.

The Village of Buchanan is located within the Town of Cortlandt in Westchester County, New York and encompasses 1.4 square miles (896 acres) [VBNY 1998]. Land use in the Village has changed very little over the last 20 to 30 years. The Village of Buchanan recently began restoring older buildings to beautify the Village square [Miller]. The Village of Buchanan has zoning ordinances, subdivision ordinances, and a development review board [Miller].

**Table 2-10
Dutchess County (NY), Orange County (NY), Putnam County (NY),
Rockland County (NY), and Westchester County (NY) Land Use
1992 Land Use Type (%)**

DESCRIPTION	Putnam	Westchester	Rockland	Orange	Dutchess
Open Water	5.37433	4.10038	2.97018	2.12432	1.25066
Low Intensity Residential	5.60736	24.86982	31.67071	6.35610	5.72884
High Intensity Residential	1.27632	5.26930	5.63640	1.18909	1.35081
Commercial/Industrial/ Transportation	1.10678	3.12225	3.71102	1.70774	1.35554
Bare Rock/Sand Clay	0.00000	0.02296	0.00466	0.00000	0.00000
Quarries/Strip Mines/Gravel Pits	0.04057	0.07591	0.07638	0.08915	0.26937
Deciduous Forest	38.70785	13.11314	19.58748	31.37327	35.13230
Evergreen Forest	4.71496	8.16721	3.52290	3.35159	4.23283
Mixed Forest	34.38621	32.05603	27.81898	27.28232	27.13790
Pasture/Hay	3.36646	3.07115	0.34010	17.18076	16.45764
Row Crops	0.78436	0.56710	0.17219	5.53976	2.86614
Urban/Recreational Grasses	0.76144	3.62480	2.75737	1.38914	1.06345

Table 2-10
Dutchess County (NY), Orange County (NY), Putnam County (NY),
Rockland County (NY), and Westchester County (NY) Land Use
1992 Land Use Type (%)

Woody Wetlands	3.57529	1.70070	1.40142	2.29430	2.99986
Emergent Herbaceous Wetlands	0.29808	0.23926	0.33019	0.12244	0.15468
Total Percent	100.00000	100.00000	100.00000	100.00000	100.00000

Reference: [USGS](#) 1992

2.8.2 Future Land Use Trends

Urban sprawl and its associated conversion of forest and farmlands to commercial and residential development is an important issue in New York. Since 1992, land use and development have been regulated by the Open Space Conservation Plan and are enforced by the Quality Communities Task Force [NYSL]. Open space is land that is not intensively developed for residential, commercial, industrial, or institutional use [NYSL].

Dutchess County is planning to create developments in central locations by developing mass transit systems and waterways. Retail areas are planned to be centralized and within convenient walking distance from these transient terminals. Developments outside the primary growth areas are designed to blend into the natural landscape. In this way, Dutchess County hopes to maintain its open spaces and farming culture [PAD; GCR].

Rockland County has developed a budget line item that will allow for the acquisition of greenways in need of preservation. Many municipalities within the county are working together to utilize and improve the waterfront along the Hudson River. With innovative zoning solutions addressing the issue of housing and open space preservation, many municipalities within Rockland have encouraged open space preservation [RCNY 2001].

Orange County's Comprehensive Development Plan continues to recognize the importance of transportation hubs, interchanges, crossroads, and corridors linking these infrastructures with their historic centers [OCCP]. A challenge for the County is generated by the dynamic real estate market and the loss of open spaces. The county, along with civic organizations, is inventorying current open spaces and defining and recommending future open space needs. The county also plans to initiate a redevelopment program to assist with historically improving the city and villages within the county. With the growth of Orange County increasing, nontraditional zoning strategies will help maintain historical and open spaces throughout the county [OCCP].

Putnam County's development is integrated into the natural environment that enhances the views of the Hudson River [PC]. The county and municipalities within are working together by changing the zoning ordinances and subdivision regulations to preserve strategic historic structures and protect open spaces, while providing affordable housing and development throughout the county [PC].

Westchester County has incorporated money within its budget funds for open space preservation [NYLCV]. Residents have also approved several tax increases as well as certain bonds to help with open space preservation [WLT]. Since November 2000, fifteen Westchester cities, towns, and villages have set aside 35 million dollars for land preservation [WLT]. The long-range plan for the physical development of Westchester County concentrates on three distinct physical characteristics: centers, corridors, and open space [WCD].

The Town of Cortlandt, located within Westchester County, has had great success in maintaining open space and protecting its environment and natural resources. By revising its zoning codes, the town will be able to reduce the potential full build by 40% and control its growth and development [TOCNY 2004]. From 1992 to 2004, the Town of Cortlandt has increased open

space by 65% from 2,729 acres to 4,502 acres [TOCNY 2004]. The town also has made an effort to increase public access to the Hudson River waterfront and encourage historic preservation [TOCNY 2004].

2.9 Housing

As of June 2006, the site has a permanent staff of approximately 1,255 employees. Due to the significant population in the site vicinity, site employees generally reside within the 50-mile radius surrounding the station. The nearest five counties with employee residences are Dutchess, Orange, Putnam, Rockland, and Westchester Counties in the State of New York. The remainder of the employees lives in outlying counties, including some employees that live in New Jersey, Connecticut, Pennsylvania, and other states.

Between 1990 and 2000, the total population of the counties near the site has increased (Table 2-6). The population increased from 259,462 to 280,150 in Dutchess County, from 307,647 to 341,367 in Orange County, from 83,941 to 95,745 in Putnam County, from 265,475 to 286,753 in Rockland County, and from 874,866 to 923,459 in Westchester County. During this same period, the number of housing units increased at about the same pace as the population increase. In the five-county area near the site, total housing units increased approximately 6% as shown in Table 2-11. Total housing units increased from 97,632 to 106,103 in Dutchess County, from 110,814 to 122,754 in Orange County, from 31,898 to 35,030 in Putnam County, from 88,264 to 94,973 in Rockland County, and from 336,727 to 349,445 in Westchester County.

The vacancy rates in the five counties have changed from 1990 to 2000 as shown in Table 2-11. Putnam County had the highest vacancy rate of approximately 6.6% in 2000, a decrease of 44.5% since 1990. The vacancy rate in Dutchess County decreased from 8.3 to 6.2%, Orange County decreased from 8.4 to 6.5%, in Rockland County the rate decreased from 3.8% to 2.4%, and in Westchester County the rate dropped from 5.0% to about 3.5%.

The median home values for the five-county area increased between 1990 and 2000 as shown in Table 2-11. Values increased 3.4% in Dutchess County, 2.0% in Orange County, 6.1% in Putnam County, 11.7% in Rockland County, and 14.9% in Westchester County. In the 10-year period, the median monthly rent (contracted) increased in the five counties. Dutchess County increased by 17.8%, Orange County increased by 23%, Putnam County increased by 21%, Rockland County increased by 28.1%, and Westchester County increased by 44%.

Vacancy rates have decreased and the total number of new housing units has kept pace with the low to moderate growth in the area population. In all five of the nearest counties, home values and rental rates have shown moderate increases. Overall, the housing market in the surrounding area shows steady growth since 1990.

Table 2-11
Dutchess County (NY), Orange County (NY), Putnam County (NY),
Rockland County (NY), and Westchester County (NY) Housing Statistics, 1990–2000

	1990 ^a	2000 ^b	% Change
Dutchess County, NY			
Total Housing Units	97,632	106,103	8.7
Occupied Units	89,567	99,536	11.1
Vacant Units	8,065	6,567	(18.6)
Vacancy Rate (%)	8.3	6.2	(25.3)
Median House Value (\$)	149,200	154,200	3.4
Median Rent (\$/month)	600	707	17.8
Orange County, NY			
Total Housing Units	110,814	122,754	10.8
Occupied Units	101,506	114,788	13.1
Vacant Units	9,308	7,966	(14.4)
Vacancy Rate (%)	8.4	6.5	(22.6)
Median House Value (\$)	141,700	144,500	2.0
Median Rent (\$/month)	513	631	23.0
Putnam County, NY			
Total Housing Units	31,898	35,030	9.8
Occupied Units	28,094	32,703	16.4
Vacant Units	3,804	2,327	(38.8)
Vacancy Rate (%)	11.9	6.6	(44.5)
Median House Value (\$)	195,000	206,900	6.1
Median Rent (\$/month)	672	813	21.0
Rockland County, NY			
Total Housing Units	88,264	94,973	7.6
Occupied Units	84,874	92,675	9.2
Vacant Units	3,390	2,298	(32.2)

Table 2-11 (Continued)
**Dutchess County (NY), Orange County (NY), Putnam County (NY),
 Rockland County (NY), and Westchester County (NY) Housing Statistics, 1990–2000**

	1990 ^a	2000 ^b	% Change
Vacancy Rate(%)	3.8	2.4	(36.8)
Median House Value (\$)	217,100	242,500	11.7
Median Rent (\$/month)	633	811	28.1
Westchester, NY			
Total Housing Units	336,727	349,445	3.8
Occupied Units	320,030	337,142	5.3
Vacant Units	16,697	12,303	(26.3)
Vacancy Rate(%)	5.0	3.5	(30.0)
Median House Value (\$)	283,500	325,800	14.9
Median Rent (\$/month)	543	782	44.0

- a. BCWC
- b. NYLCV

2.10 Social Services and Public Facilities

2.10.1 Public Water Supply

The site is located in the northwest corner of Westchester County, New York, approximately four miles south of the Putnam County line and approximately four miles southeast of the Orange County line. Rockland County, New York, is located across the Hudson River to the west.

The site does not utilize a public-water system for plant circulating and service water purposes, but instead relies on surface water from the Hudson River. Potable water and process water is supplied to the site by the Village of Buchanan water supply system. Based on invoiced water bills, the site utilizes approximately 2,326,200 cubic feet or 17,400,000 gallons per month of potable water [VBNY 2006]. There are no identified restrictions on the supply of potable water from the Village of Buchanan. As discussed below, the Village of Buchanan obtains water from two sources, the City of Peekskill Public Water System (PWS) and the Montrose Improvement District. While the demand on the City of Peekskill PWS currently appears to be near the system design capacity, the contract with the Montrose Improvement District (now consolidated with the Northern Westchester Joint Water Works) will be able to provide adequate supply based on treatment capacity upgrades discussed below.

Public water supply systems (see [Table 2-12](#)) in the vicinity of the site include community and non-community (including non-transient non-community and transient non-community) systems. Community water systems within a 10-mile radius of the site include Westchester, Putnam, Orange, and Rockland County systems. Each of these county systems utilize both groundwater and surface water sources [[USEPA 2006b](#)]. Although outside the 10-mile radius, public water supply systems in Dutchess County were reviewed in this evaluation because Dutchess County provides residence to the largest percentage of site permanent full-time employees (42%). Approximately 57% of the Dutchess County community water systems, including the Poughkeepsie water supply system, obtain water from surface water sources which include the Hudson River [[USEPA 2006b](#)].

The Village of Buchanan purchases water from the City of Peekskill Public Water System (PWS) and the Montrose Improvement District. The City of Peekskill has two sources of water, both of which are surface waters. The City of Peekskill's year round major water source originates in the Town of Putnam Valley (Putnam County). The City of Peekskill's second source of water is an emergency source from a neighboring community, via the Catskill Aqueduct. Water is pumped to the Camp Field Reservoir in the City of Peekskill, where it is then filtered and treated. [[PWD](#)].

The Catskill Aqueduct obtains its water from the Ashokan and Schoharie Reservoirs. The Delaware Aqueduct obtains its water from the Rondout, Neversink, Pepaction, and Cannonsville reservoirs which then flows into the Kensico Reservoir [[WCDH](#)].

Eighty percent of the Town of Cortlandt water supply is purchased from the Montrose Improvement District, which treats raw water purchased from the New York City Catskill Aqueduct. Ten percent is purchased from the City of Peekskill, which filters and treats raw water pumped from the Peekskill Hollow Brook to the city's Camp Field Reservoir, and ten percent is purchased from the Town of Yorktown, which purchases water filtered and treated by the Westchester County-owned Amawalk treatment plant. [[CCWD](#)]

The Cortlandt Consolidated Water District has joined with the Yorktown and Montrose Improvement District in a new corporation known as the Northern Westchester Joint Water Works (NWJWW). The NWJWW has assumed ownership of the Amawalk treatment plant, which has been upgraded to 7 million gallons per day (gpd) capacity. A new NWJWW 7,000,000 gpd plant (Catskill water treatment plant) has been in operation since 2000. [[CCWD](#)]

Westchester Joint Water Works (WJWW) serves the municipalities of the Village/Town of Mamaroneck, Town/Village of Harrison, portions of the City of New Rochelle, and the City of Rye. WJWW, which has a capacity of 14,200,000 gpd and an average daily demand of 13,100,000 gpd, obtains its water from the Catskill and Delaware watersheds of the New York City water system, which includes the Delaware Aqueduct, Rye Lake (Delaware watershed), and the Kensico reservoir. [[WJWW](#)]

A majority of Rockland County uses groundwater to supply numerous small public water systems, most of which are supplied by a single well [[RWS](#)]. The large public water systems of Rockland County include United Water New York (UWNY), Nyack Village PWS, and Suffern Village PWS. [[RWS](#)]. UWNY provides water to approximately 267,000 residents from 53

groundwater wells drilled throughout the county, Lake DeForest, and the Letchworth reservoirs [UWNY]. UWNY's peak demand in 2006 was estimated at 47.5 million gpd and its peak supply at approximately 48.5 million gpd [RCDH].

The Poughkeepsies' Water Treatment Facility, which is owned and operated by the City and Town of Poughkeepsie, provides drinking water in Dutchess County to the City of Poughkeepsie, Town of Poughkeepsie, and Village of Wappingers Falls. The plant is located along and draws water from the Hudson River. The plant was built in 1962 and is currently rated at a maximum capacity of 16 million gpd. Average demand is reported to be approximately 8 million gpd. [PTWD]

The Village of Ossining Water System in Westchester County is supplied from two surface water sources: the Indian Brook Reservoir, located near Fowler Avenue and Reservoir Road, and the Croton Reservoir, which is part of the New York City Water System. The average blend of water is approximately 63 percent from the Croton Reservoir and 37 percent from the Indian Brook Reservoir. The System obtains its water from the Croton watershed in Putnam and Westchester Counties and serves approximately 30,000 people. The Village of Ossining Water System services an average daily demand of approximately 3.7 million gpd. [VOWS]

Many public water supply systems supply only small segments of the population. For example, Orange County has approximately 150 public water systems, but no major public water systems were identified within 10 miles of Indian Point [OCWD]. Groundwater is the primary source of both community and non-community water supply systems and serves 60 to 85 percent of the population in the area [NWWW; OCWD; PCWD; RCDW]. Large areas of Westchester, Putnam, Orange, Rockland, and Dutchess Counties are not served by community water supplies. Therefore, private water supplies rely primarily on groundwater sources. The groundwater quality in New York is generally good, but contamination can and does occur locally. Groundwater quality threats based on land use in Westchester County are illustrated in Figure 2-26. Major contaminants typically include bacteria, nitrates, and organic compounds [WCDP 2003].

The Village of Croton-on-Hudson public water system is supplied by a groundwater well system located downstream from the New Croton Dam and spillway. Groundwater is pumped from the well system directly into the distribution system. The system has a total storage capacity of 2.3 million gallons, and supplies approximately 7,600 people an average of 1.1 million gpd. [VCOH]

Within a one-mile radius of the site, there are seven USGS registered wells. These wells range in depth from 30 feet to 500 feet below land surface [USGS 2006a]. Available information indicated these wells are listed as unused, domestic use, and commercial use wells. Pumping rate information available for these wells range from 4 gpm to 30 gpm [USGS 2006b]. (See Table 2-12.)

**Table 2-12
Major Community Water Supply Systems Within the Area**

Public Water System (PWS)	County^a	Source	Capacity (gpd)	Demand (gpd)^b
Northern Westchester Joint Water Works ^c	Westchester	Surface	14,000,000	6,887,000
Peekskill, NY	Westchester	Surface	4,000,000	3,900,000
Croton-on-Hudson, NY	Westchester	Groundwater	2,300,000	1,100,000
Westchester Joint Water Works	Westchester	Surface	14,200,000	13,100,000
Ossining, NY	Westchester	Surface	6,000,000	3,700,000
Poughkeepsie, NY	Dutchess	Surface	16,000,000	8,870,000
United Water New York	Rockland	Groundwater and Surface	48,500,000	47,500,000
Village of Suffern	Rockland	Groundwater	4,000,000	2,000,000
Village of Nyack	Rockland	Surface	3,000,000	1,800,000

- a. Orange County is not included in this table as it is not a major water supplier for the area.
- b. Average daily demand. Information obtained from 2005 Annual Drinking Water Quality Report for each respective PWS [PWD; CCWD; VCOH; VOWS; WJWW; RCDH; VSDPW; VNWP]
- c. Includes the Cortlandt Consolidated Water District, Yorktown Improvement District, and the Montrose Improvement District [CCWD]

An estimated 85,000 residents north of Kensico Dam in Westchester County use groundwater as their primary water source. Exceptions are residents using surface water or aqueduct sources in Mt. Kisco, parts of the Town of Yorktown, much of the Town of Cortlandt, and most municipalities directly adjoining the Hudson River [WCDP 2003]. Approximately 15 percent of the residents of the Town of Cortlandt are estimated to use groundwater supplies [WCDP 2003, Table 2]. However as the Village of Buchanan, which supplies water to the site, purchases public drinking water from surface water supplies and the site does not utilize groundwater for cooling operations, service water, or potable water, the continued operation of the site is not expected to impact local groundwater supplies [USEPA 2006b]. As already discussed, the site utilizes surface water from the Hudson River for plant operations and the Village of Buchanan PWS supplies potable water and process water. Therefore, the operation of the site is not expected to affect the future demand on the public water supplies identified in Table 2-12.

2.10.2 Transportation

The area within a 6-mile radius of the site is bisected by the Hudson River, with the site located on the eastern side of the river in Westchester County, and with Putnam County located north of Westchester County. Rockland and Orange counties lie on the western side of the Hudson River. Rockland County borders the Hudson River due west of the site, with Orange County to the northwest. Several major highway routes serve as transportation corridors along either side of the Hudson River valley. Level of service (LOS) determinations are performed by the state for major highways, but not for smaller state routes or local roads. Transportation is addressed in the counties within the 6-mile radius of the site.

2.10.2.1 Westchester and Putnam Counties

Westchester County and Putnam County are located on the eastern side of the Hudson River. The primary highways in Westchester County include Interstate 684, US Highways 9, 6, and 202, and the Taconic State and Saw Mill Parkways (Figures 2-1 and 2-2). US Highway 9 runs north and south along the Hudson River Valley through both Westchester and Putnam County. Further east, the Taconic State Parkway also runs north and south through both counties. The Taconic State Parkway and the Saw Mill Parkway connect near Hawthorne, New York, southeast of the site. Interstate 684 runs north and south along the eastern side of Westchester County and connects to Interstate 84 in Putnam County. US Highway 6 runs east and west through the southern end of Putnam County and the northern portion of Westchester County. US 202 runs east and west across northern Westchester County. The Saw Mill Parkway extends northeast and southwest between US Highway 9 at Riverdale, New York, and Interstate 684. Additional highways within the two counties include State Highway Routes 117, 120, 129, 100, 139, and 301.

The nearest highway serving the site area is US Highway 9. Using local roads from US Highway 9, the site can be accessed from Broadway.

The New York State Department of Transportation (NYSDOT) provides traffic counts for major highways [NYSDOT]. A summary of the most current NYSDOT estimates for average annual daily traffic counts on Highway 9 north and south of the site is shown in Table 2-13.

**Table 2-13
Average Annual Daily Traffic Counts on US 9 Near the Site, 1996-2004**

Location	1996	1997	1999	2000	2002	2003	2004
US Highway 9 from Montrose crossing to Route 9A overlap ^a	No Data	No Data	38,500	No Data	42,700	49,900	50,500
US Highway 9 from Peekskill city line to Montrose crossing	No Data	13,100	No Data	12,200	No Data	11,600	11,800 ^b
US Highway 9 from Montrose crossing to Old Post Rd crossing	4,750	No Data	4,800	No Data	5,750	No Data	5,950 ^b

- a. Readings taken at a Continuous Count Station (accounts for seasonal and daily variation)
- b. NYSDOT projection from the latest year for which data was available.

2.10.2.2 Rockland and Orange Counties

Rockland County and Orange County are located on the western side of the Hudson River. The Palisades Interstate Parkway is the largest highway system in Rockland County, running north and south through the county, and connecting with US Highway 6 and US Highway 9W in southeastern Orange County (Figure 2-2). US Highway 9W runs north and south along the Hudson River and connects with Interstate 87 to the south at the Village of Nyack, New York. Interstate 87 travels north and south through Orange County, but loops toward the east across Rockland County, crosses the Hudson and intersects US Highway 9, the Saw Mill Parkway, and the Taconic State Parkway in Westchester County. US Highway 202 runs northeast and southwest through Rockland County till it meets US Highway 9W, and then crosses the Hudson River and runs easterly and intersects the Taconic State Parkway. Route 17 (future Interstate 86) runs northwest and southeast across Orange County to where it intersects Interstate 87, and turns south until it intersects State Highway Route 3 near New York City. Interstate 84 runs east and west through Orange County, crosses the Hudson River, and travels down Dutchess County, and into Putnam County where it meets Interstate 684. Major state highways within a 50-mile radius of the site west of the Hudson River include Route 94, Route 17, and Route 17A in Orange County.

2.10.2.3 Dutchess County

Dutchess County is located approximately thirteen miles north of the site, on the east side of the Hudson River. The major roads in this county are Interstate 84, US Highway 44, US Highway 9, Route 199 (Taconic State Parkway), and Route 22. Interstate 84 and US Highway 44 run east and west in the southern and central portions of the county, respectively. State Highway Route

199 (Taconic State Parkway), Route 22, and US Highway 9 run north and south in the central, eastern, and western portions of the county, respectively.

2.10.3 Education

The State of New York is divided into numerous school districts. School districts within 0.8 km (0.5 mile) of Indian Point are the Lakeland School District, Peekskill School District, Hendrick Hudson Central School District, and the Croton Harmon School District. Indian Point is located in the Hendrick Hudson Central School District.

The NRC's 1996 GEIS reported the Hendrick Hudson Central School District had the same number of schools before the construction of the plant. The local school administrator indicated that the construction and operations phases of Indian Point have not had an effect on schools in the district. An increase in enrollment was concurrent with the development of Indian Point. However, there was also a nationwide baby boom at this time, so this enrollment cannot be directly linked to the plant. [NRC 1996, Appendix C, C.4.4.4.1]

Local school officials in each of the school districts were interviewed by NRC representatives, and the overall finding was of insignificant impacts due to the construction or operation of the plant. The Croton Harmon director of pupil services indicated very little change since the construction of the plant. The Lakeland School District experienced substantial growth in the 1950s and 1960s, reaching a peak enrollment in 1973. Although this growth occurred at roughly the same time as the plant construction, the construction itself did not have a major effect on the district. The Lakeland School District has been more heavily influenced during operations by industry in the Poughkeepsie and Yorktown area as opposed to the operation of the plant. [NRC 1996, Appendix C, C.4.4.4.1]

The Hendrick Hudson Central School District is located at a scenic location along the Hudson River in suburban Westchester County approximately 45 miles north of Manhattan. The District includes Buchanan, Verplanck, Crugers, Montrose, and parts of Cortlandt Manor, Croton, and the City of Peekskill. The Hendrick Hudson district enrollment was reported to be approximately 2,832, with class sizes ranging from 18 to 21 students [HHSD]. The District's reported total general fund expense for 2005-06 was \$56,387,279 [NYSE 2006b]. The District reports an approximate cost per pupil of \$20,152 [HHSD]. In all, Westchester County has 40 school districts, with a total student enrollment of approximately 147,175. County wide, the county averaged approximately 13 pupils per teacher in 2003, with an average expenditure of \$14,837 per pupil [WCDP 2005a].

The Lakeland School District lies in the northwest corner of Westchester County and is the largest suburban district in the county. Its border pushes into Putnam County, then swings south almost to the City of Peekskill. District students live in six different towns: Yorktown, Cortlandt, and Somers in Westchester County and Carmel, Philipstown, and Putnam Valley in Putnam County. The district enrollment was reported to be approximately 6,200, with class sizes ranging from 19 to 24 students [NYSE 2006c]. The District's reported total general fund expense for 2005-06 was \$114,471,671 [NYSE 2006a].

The employees of Indian Point live primarily in Westchester, Dutchess, Rockland, Putnam, and Orange Counties in New York, so consideration is given to the education systems for these counties in addition to Westchester County. By contrast, total student enrollment in Dutchess County is approximately 46,000 in 38 private and parochial schools in 16 districts [Dutchess County]. Dutchess County reported the region's highest average pupils per teacher of 14.7, and an average expenditure per pupil of \$10,764 in 2003 [WCDP 2005a].

Putnam County reported a total student enrollment of 16,948 in six school districts [NYSE 2005b]. The county had approximately 13.7 pupils per teacher, with an average expenditure of \$13,523 per pupil [WCDP 2005a].

Rockland County student enrollment was 42,248 pupils in 9 school districts [NYSE 2005c]. Rockland County had 13 pupils per teacher, and an average expenditure of \$14,707 per pupil [WCDP 2005a].

Orange County had 66,020 pupils enrolled in 17 school districts [NYSE 2005a]. The student to teacher ratio was approximately 14.4, with an average expenditure per pupil of \$11,022 [WCDP 2005a].

2.10.4 Transient Population

State tourism agencies were contacted to obtain the most recent tourist (transient) information. County level geographical tourism data is not collected by states within 50-miles of IP2 and IP3. Connecticut and New Jersey collect this data only at the state level. New York breaks state level visitation numbers into five counties within the New York City metropolitan area (defined as Bronx, Kings, New York, Queens, and Richmond counties). The rest of New York State and Pennsylvania reports tourists per year at a regional level (The Pocono region, which includes Carbon, Monroe, Pike, and Wayne counties, is the relevant region).

To convert state visitation numbers into county visitation, the ratio of estimated 2004 county population to estimated 2004 state population was multiplied by the total number visitors in the state [USCB 2005, Table 2.2.1]. An estimated 41 million people visit the New York Metropolitan area each year, or approximately 112,329 people per day. In this ER, Entergy focused specifically on the five counties surrounding the plant, in which most IP2 and IP3 employees reside. An estimated 47,074 people visit Westchester, Rockland, Orange, Dutchess, and Putnam counties each day. Almost half of the estimated transients, 22,178 people per day, visit Westchester County, 6,904 people visit Dutchess County per day, 8,715 people visit Orange County per day, 2,367 people visit Putnam County per day, and 6,910 people visit Rockland County per day.

2.10.5 Migrant Farm Labor

Migrant farm labor was reviewed using the U.S. Department of Agriculture's National Agricultural Statistics Service (NASS) data for 2002. NASS only began reporting such data in 2002, which is the most recent data available. Actual migrant worker numbers are not directly reported. County level data on hired farm labor from NASS reported 18 of 194 farms hired migrant labor in Dutchess County, and one farm hiring only contract labor hired migrants. In Orange County, 69 of

349 farms hired migrant labor, with nine farms that hired only contract labor reported hiring migrant labor. Of the 27 farms in Putnam County that reported hiring farm labor, only one farm reported hiring migrant labor and it hired only contract labor. Twenty-one farms in Rockland County hired farm labor, but none reported hiring migrant labor. In Westchester County, 68 farms reported hired farm labor, and three farms hired migrant labor. [USDA 2002f]

A total of 4,493 hired labor workers were reported in the five counties, of which 2,489 were reported to work less than 150 days per year. The largest use of hired farm labor was in Orange County, with 2,572 total hired workers, of which 1,583 worked less than 150 days per year. As would be expected due to more urban populations, Westchester, Rockland, and Putnam counties reported the least number of hired farm workers. The census data does not provide a reasonable means of interpolating the number of migrant farm labor workers, but based on the available data more than half of hired farm labor worked less than 150 days per year, much of which could be migrant labor. However, most of all hired farm labor and consequently most of any migrant farm labor works beyond a six-mile radius of IP2 and IP3. [USDA 2002f]

2.10.6 Economy

2.10.6.1 Employment and Income

The economy most affected by IP2 and IP3 operations are the five counties immediately surrounding the plant where the majority of employees reside. These five counties include Westchester County wherein lies the plant, Rockland County, Putnam County, Orange County, and Dutchess County. Employment information at the IP2 and IP3 facility is provided in Section 3.5. Employment in Westchester County in 2004 was 391,438 [USCB 2004e] with service industries dominating total employment in the county at almost 57 percent (222,874 people employed).

The largest employer in Westchester County is IBM Corporation with approximately 7,475 employees scattered county-wide [Journal News]. The largest employers, after Entergy at Indian Point, within approximately 10 miles of the plant are the Lakeland Central School District with 1,037 employees, and the New York Correctional Department with 1,000 employees [WCDP 2004]. Wholesale and retail trade also plays an important role in the local economy with almost 19 percent of the local employment (73,879 employees) [USCB 2004e]. Construction and finance provide approximately 7 and 6 percent of the employment, respectively, while manufacturing provides only approximately 3.6 percent [USCB 2004e].

The annual payroll in Westchester County was reported to be approximately \$19.7 billion in 2004 [USCB 2004e]. Per capita personal income was \$55,557 in 2003 and exceeded most other areas except for Manhattan, New York, and Fairfield, Connecticut. The annual change in per capita income was 4.4 percent, exceeded in the region only by the increase of Manhattan. Among all counties in the United States, Westchester County has the sixth highest per capita income, which is 75 percent higher than the national average income per capita [WCDP 2005c].

Total employment in Rockland County in 2004 was 103,241 [USCB 2004d]. The largest single employment sector in 2004 was healthcare and social assistance (20,793 people), followed by

retail trade (15,027 people). Annual payroll reported for 2004 in Rockland County was \$3.8 billion. [USCB 2004d] Per capita income for Rockland County in 2003 was \$41,661 [WCDP 2005c].

Total employment in Putnam County in 2004 was 21,591 [USCB 2004c]. The largest single employment sector in 2004 was healthcare and social assistance (4,732 people), followed by retail trade (3,282 people). Annual payroll reported for 2004 in Putnam County was a little more than \$773 million. [USCB 2004c] Per capita income in 2003 for Putnam County was \$39,410 [WCDP 2005c].

Total employment in Orange County in 2004 was 103,420 [USCB 2004b]. The largest single employment sector in 2004 was retail trade (21,532 people), followed by healthcare and social assistance (18,293 people). Annual payroll reported for 2004 in Orange County was \$3.2 billion. [USCB 2004b] Per capita income for Orange County in 2003 was \$28,903 [WCDP 2005c].

Total employment in Dutchess County in 2004 was 98,683 [USCB 2004a]. The largest single employment sector in 2004 was healthcare and social assistance (18,317 people), followed by manufacturing (17,616 people) and retail trade (15,148 people). Annual payroll reported for 2004 in Dutchess County was \$3.8 billion. [USCB 2004a] Per capita income for Dutchess County in 2003 was \$32,635 [WCDP 2005c].

2.10.6.2 Unemployment

The unemployment rate in Westchester County is similar to Rockland and Putnam counties, but significantly lower than New York City and New York State as a whole. The unemployment rate for Westchester County was approximately 4.1 percent, compared to 5.8 percent for New York State as a whole [WCDP 2005b]. The unemployment in November 2006 was reported by the New York State Department of Labor, Division of Research and Statistics to be 16,500 workers, or approximately 3.4 percent of the labor force [NYS DL]. By comparison the unemployment rate for Putnam County in November 2006 was 3.0 percent, 3.5 percent in Rockland County, 3.4 percent in Dutchess County, and 3.8 percent in Orange County [NYS DL].

2.11 Meteorology and Air Quality

The site is located in the Village of Buchanan, New York, in Westchester County on the eastern bank of the Hudson River at approximately RM 43. The river bisects the area within a 6-mile radius of the site and geographically separates Westchester County from Rockland County to the west. The Hudson River flows northeast to southwest at the site, but turns sharply northwest approximately two miles northeast of the plant. The western bank of the Hudson River is flanked by the steep, heavily-wooded slopes of the Dunderberg and West Mountains to the northwest (elevations 1086 and 1257 feet above MSL, respectively) and Buckberg Mountain to the west-southwest (elevation 793 feet above MSL). These peaks extend to the west and gradually rise to slightly higher peaks.

Westchester County is mild in the summer and extremely cold in the winter. Based on previous climatological records for the Village of Buchanan, New York, area, mean daily maximum

temperatures range from about 27.6°F in winter to about 86.7°F in summer with mean daily minimum temperatures ranging from about 20.3°F in winter to about 71.5°F in summer [IPEC 2000-2004]. Precipitation averages 37.2 inches per year and is distributed rather evenly throughout the 12-month period, with the lowest amount falling in February and highest falling in May [IPEC 2000-2004]. Although the Village of Buchanan area is subjected to a wide range of snowfall amounting to as little as 20 inches or as much as 70 inches, Westchester County snowfall amounts typically average between approximately 25 to 55 inches per year [BCWC; NRCC].

There is an average of seven tornadoes in the state of New York every year [USDOC 2006a]. On average, 69 percent of all tornadoes are considered weak, with winds less than 110 miles per hour, 29 percent are considered strong, with winds of 111–205 miles per hour, and only 2 percent are considered violent, with winds above 206 miles per hour [NSSL]. According to the National Climatic Data Center, Westchester County has had a total of eight tornadoes since 1950, seven of which have been F1 or less [USDOC 2006b]. An additional tornado, rated as an F2 at its maximum intensity, but an F1 for most of its existence, struck the Westchester County area on July 12, 2006. This means that there is an average of one tornado in Westchester County every six years. Based upon this, the probability of a tornado striking the site is small.

Four states are located within a 50-mile radius of the site. These include Pennsylvania (eastern tip), Connecticut, New York, and New Jersey. The air quality non-attainment issues associated with the portions of these states located within a 50-mile radius are associated with ozone (8-hour standard) and particulate matter < 2.5 microns in diameter (PM_{2.5}). The portion of Pennsylvania (Pike County) located within the 50-mile radius is in attainment with the National Ambient Air Quality Standards. The entire States of New Jersey and Connecticut are designated non-attainment for ozone (8-hour standard). Several counties in Central and Southeastern New York within a 50-mile radius are also in non-attainment status for the 8-hour ozone standard [USEPA 2006a]. The New York City Metropolitan Area, which includes Westchester County and the site, is located in a severe non-attainment area for the 8-hour ozone standard.

The Connecticut counties of Fairfield and New Haven (wholly or partially within a 50-mile radius of the site) are designated as non-attainment for PM_{2.5}. Ten northern New Jersey counties (wholly or partially within the site's 50-mile radius) have also been designated as non-attainment for PM_{2.5}. Several counties in the New York City Standard Metropolitan Statistical Area (SMSA) (Bronx, Kings, Nassau, New York, Queens, Richmond, Rockland, Suffolk, Westchester counties), and Orange County are also designated as non-attainment for PM_{2.5}. Several counties in southeastern New York, including Westchester County, are also designated as being a severe non-attainment area.

There are no Class I areas designated by the National Park Service, USFWS, or the U.S. Forest Service within 50 miles of the site [NPS]. Class I areas, as defined in the Clean Air Act, are the following areas that were in existence as of August 7, 1977: national parks over 6,000 acres, national wilderness areas and national memorial parks over 5,000 acres, and international parks.

IP2 and IP3 state air permits, 3-5522-00011/00026 and 3-5522-000105/00009, respectively, regulate emissions from boilers, turbines, and generators. These permits have a NO_x cap of 25 tons per year per station which is controlled by engine run time and fuel use limits. IP2 and IP3 are not subject to the Risk Management Plan (RMP) requirements described in 40 CFR 68, as no RMP regulated chemicals stored on-site exceed the threshold values listed in 40 CFR 68.

2.11.1 Meteorological System

The meteorological measurement program consists of three instrumented towers, redundant power and ventilation systems, redundant communication systems, and a mini-computer processor/recorder. The meteorological measurement program complies with the acceptance criteria stated in Sections 2.3.3 and 17.2 of NUREG-75/087, Revision 1 (superseded by NUREG-0800, Rev. 2, July 1981) with the former section dealing with meteorological sensors and recorders and the latter dealing with the Quality Assurance Program. The meteorological measurements program consists of primary and backup systems. The accuracy of the meteorological sensor and recording systems meet the system specifications given in Section C.4 of proposed Revision 1 to Regulatory Guide 1.23. [IP3 UFSAR, Section 2.6.5]

2.11.1.1 Primary System

A 122-meter, instrumented tower is located on the site and provides the following:

- (1) wind direction and speed measurement at a minimum of two levels, one of which is representative of the 10-meter level;
- (2) standard deviations of wind direction fluctuations as calculated at all measured levels;
- (3) vertical temperature difference for two layers (122–10 meters and 60–10 meters);
- (4) ambient temperature measurements at the 10-meter level;
- (5) precipitation measurements near ground level; and
- (6) Pasquill stability classes as calculated from temperature difference. [IP3 UFSAR, Section 2.6.5]

To assure acceptable data recovery, the meteorological measurements system and associated controlled environmental housing is connected to a power supply system which has a redundant power source. A diesel generator has been installed to provide immediate power to the meteorological tower system in the event of a power outage. The generator becomes fully powered within 15 seconds after an automatic transfer switch is tripped. Various support systems include an uninterruptible power supply, dedicated ventilation systems, halon fire protection, and dedicated communications. [IP3 UFSAR, Section 2.6.5]

The meteorological data is transmitted simultaneously to two data loggers located at the Primary Tower site. One data logger transmits 15-minute average meteorological data to a computer to determine joint frequency distributions, and the second data logger transmits 15-minute average meteorological data to a computer located in the Buchanan Service Center, which provides the capability for accessing the meteorological data remotely. [IP3 UFSAR, Section 2.6.5]

Meteorological data can be transmitted simultaneously to the IP3 / IP2 emergency response organization and the NRC in a format designated by NUREG-0654/FEMA-REP-1. Fifteen minute averages of meteorological parameters covering the 12-hour period previous to a recall command is available upon interrogation of the system. [IP3 UFSAR, Section 2.6.5]

2.11.1.2 Backup Systems

In the event of a failure of the primary meteorological measurement system, a backup meteorological system is used at the Indian Point site. This system is independent of the primary system and consists of an instrumented meteorological tower (a backup tower located approximately 2700 feet north of the primary tower). The associated data acquisition system for the backup tower is located in the Emergency Operations Facility. The backup system provides measurements of the 10-meter level of wind direction and speed and an estimate of atmospheric stability (Pasquill category using sigma theta, which is a standard deviation of wind fluctuation). The backup system provides information in real-time mode. Changeover from the primary system to the backup system occurs automatically. In the event of a failure of the backup meteorological measurement system, a standby backup system exists at the 10-meter level of the Buchanan Service Center building roof. It also provides measurements of the 10-meter level of wind direction and speed and an estimate of atmospheric stability (Pasquill category using sigma theta, which is a standard deviation of wind fluctuations). The changeover from the backup system to the standby system also occurs automatically. [IP3 UFSAR, Section 2.6.5]

As in the case of the primary system, the backup meteorological measurements system and associated controlled environmental housing system is connected to a power system which is supplied from redundant power sources. [IP3 UFSAR, Section 2.6.5]

In addition to the backup meteorological measurements system, a backup communications line to the meteorological system is operational. During an interim period, the backup communications is provided via telephone lines routed through a telephone company central office separate from the primary circuits. [IP3 UFSAR, Section 2.6.5]

2.11.2 Radiological Environmental Monitoring Program Air Sampling Program

There are five radiological environmental monitoring program air sampling stations required by the ODCM. Three of the stations (A1–A3) are located close to the site boundary in different sectors with the highest calculated annual average ground-level D/Q at distances of 0.28–0.46 miles (SW, S, and SSW sectors); one station (A4) is located in the vicinity of a community having the highest calculated annual average ground level D/Q (SSW sector) at a distance of 0.88 miles (SSW sector); one control location station (A5) is located in a sector with the least prevalent wind direction at a distance of 20.7 miles (N sector). Although not required by the ODCM, there

are also four additional air sampling stations that have been established. These stations are located at distances from 1.6 to 6.36 miles in the WSW, NE, SW, and SSE sectors.

Each station collects airborne particulates using glass fiber filters (47 millimeter diameter) and radioiodine using charcoal cartridges (2 x 1 inch). The samplers run continuously and the charcoal cartridges and particulate filters are changed on a weekly basis. Sample volume is determined by use of calibrated gas flow meters located at the sample discharge. Gross beta analysis is performed on each particulate filter. Charcoal cartridges are analyzed for radioiodine using gamma spectral analysis. The particulate filters are composited monthly by location and analyzed for gamma-emitting radionuclides.

2.12 Historic and Archaeological Resources

The New York State Historic Preservation Office (SHPO) Environmental Review program is a planning process that helps protect New York's historic and cultural resources from the potential impacts of projects that are funded, licensed, or approved by state or federal agencies. Under Section 106 of the National Historic Preservation Act and Section 14.09 of the New York State Historic Preservation Act, the SHPO's role in the review process is to ensure that effects or impacts on eligible or listed properties are considered and avoided or mitigated during the project planning process. In addition, the SHPO advises local communities on local preservation environmental reviews, upon request, under the provisions of the State Environmental Quality Review Act [NYSHPA 2006a]. The Environmental Review Program includes the following.

- Section 106 of the National Historic Preservation Act of 1966. The New York SHPO reviews projects when a federal agency is involved with the project. It is the federal agency's responsibility to seek comments about the project from the SHPO.
- Section 14.09 of Article 14 of the Parks, Recreation and Historic Preservation Law, which was enacted by the New York State Historic Preservation Act of 1980 (Chapter 354 of the Laws of 1980). The SHPO reviews projects when a state agency is involved with the project. It is the state agency's responsibility to seek comments about the project from the SHPO.
- State Environmental Quality Review Act (SEQRA) - 6 NYCRR Part 617 of the New York State Environmental Conservation Law, establishes a set of uniform regulations by which all state, county, and local governmental agencies incorporate consideration of environmental impacts into their planning, review and decision-making processes. SEQRA applies to projects undertaken or permitted by county and local governments.

The New York SHPO is the primary contact for the two historic registers that track New York's historic resources. The National Register of Historic Places (NRHP) is the official federal listing of significant historic, architectural, and archaeological resources. The New York State Register of Historic Places (NYRHP) is the list of significant historic and prehistoric resources throughout New York.

The New York SHPO, the Mohawk Tribal Historic Preservation Officer (THPO), and the Mohican THPO were contacted in November 2006 for information related to any known archeological resources in the vicinity of IP2 and IP3. A letter was received in December 2006 from the NYSHPO stating that it was the SHPO's opinion that the renewal of IP2 and IP3 Operating Licenses would have No Adverse Effect upon cultural resources in or eligible for inclusion in the NRHP (see [Attachment B](#)). However, a response was not received from the Mohawk and Mohican THPOs.

2.12.1 Prehistoric Era

Paleo-Indian Period groups were the first prehistoric occupants of the Hudson River Basin. These occupations began after retreat of the last Wisconsin glacial front about 11,000 years ago. The American Indian groups of this period subsisted by hunting large mammals that lived in the area, but they also made use of small animals, fish, and plants. Because of possible over-hunting or changes in forage conditions due to climate change, populations of large mammals decreased in the Hudson Valley approximately 6,000-9,000 years ago. With these changes, the nomadic Paleo-Indian culture came to an end. [[CHGEC](#), Section V.A.6.a]

Archaeological evidence suggests that human occupation in the Hudson Valley did not occur again for another 4,000 years. In fact, the early Archaic Period occupations that followed the Paleo-Indian Period were confined to the southern edge of the Hudson Valley on Staten Island and in the Delaware Valley north of Water Gap. When this 4,000-year period concluded, prehistoric groups began to gradually reoccupy the Hudson Valley over a period of about 1,000 years. [[CHGEC](#), Section V.A.6.a]

At the beginning of the Woodland Period around 3,000 years ago, the use of clay pottery spread throughout the Hudson Valley, and this indicated that local prehistoric groups had attained a more sedentary way of life. Human subsistence during this period was focused on the hunting of small game, fishing, and gathering from populations of indigenous plants. Although hunting and gathering were still important, the Woodland Period was characterized by increasing dependence on cultivated squash, gourds, and maize. In time, maize would become the principal source of cultivated food. During the Woodland Period, it is estimated that 60,000 to 70,000 people occupied the Hudson Valley area. [[CHGEC](#), Section V.A.6.a]

Numerous prehistoric archaeological sites have been identified within a 6-mile radius of the site. The precise locations of these sites are state-restricted information that cannot be released to the public. However, the New York State SHPO has used existing survey information on prehistoric and historic archaeological sites to identify archaeologically sensitive areas and the information on these sensitive areas is stored in the New York State Historic Preservation Office Geographic Information System (GIS)-Public Access [[NYSHPO 2006a](#)]. These sensitive areas are broadly conceived spatial locations where archaeological sites are known to be present or are likely to be present. Within a 6-mile radius of the site, approximately 70 percent of the land has been officially designated as an archaeologically sensitive area. Large expanses of archaeologically sensitive land are located immediately to the south and east of the site. The GIS system does

not indicate such coverage for the land on the site, which is consistent with a location that is known to have been extensively disturbed by past construction.

2.12.2 Historic Era

Historic archaeological sites are the buried remains of ground surface occupations that occurred after the first Euroamerican exploration in the Hudson Valley area, which began with Henry Hudson in 1609 [CHGEC, Section V.A.6.a]. Up to around 1650, a band or small tribe of Indians, called the Kitchawank, lived on the east shore of the Hudson River between Croton and Anthony's Nose (across from Bear Mountain). Their principal village, Kitchawank, appears to have been at the mouth of the Croton River. The Kitchawak also occupied a small village at Peekskill, called Sackhoes. Although some historic archaeological sites represent very late Native Americans occupations, most tend to be Euroamerican homesteads, farmsteads, and industrial sites.

At the time of the first Euroamerican contact and exploration in the early 17th century, the Hudson-Mohawk basin was occupied primarily by the Algonquins, which consisted of the Delaware, Wappinger, Mohican, and Montauk tribes, along the lower Hudson River and the eastern end of the Mohawk River. [CHGEC, Section V.A.6.a]

Except for troop movements in the Revolutionary War, the Indian Point site has no historic significance. In 1777 the British landed at Lents Cove to raid the City of Peekskill. The nearest landmarks of consequence are St. Patrick's Church in Cortlandt, St. Peter's Church and Cemetery in the Village of Verplanck, and St. Mary's cemetery along Broadway in Buchanan. Stony Point Battle Reservation is on the western bank of the river two miles downstream. The Palisades Interstate Park is west of the Stony Point area on the western side of the river. The National Register of Historic Places (including designated National Historic Landmarks) and the Hudson River Valley Commission's preliminary inventory of historic resources list many buildings and sites within several miles of the Station, but none that are affected by it. Both Stony Point Battlefield and the Palisades Interstate Park are Registered National Historic Landmarks. [USAEC, Section II.D]

Around 1900, light farming and a brickyard owned by Charles Southard existed on or near Indian Point. Also at this time, dozens of steamboats, owned by numerous steamboat companies, traveled up and down the Hudson River on a daily basis. Steamboats had begun service on the river in the 1820s. During the heyday of steamboating, every landing along the approximately 143 miles of Hudson River from New York City to Albany was served by a steam-propelled vessel of some type. The last steamboat service was the Hudson River Day Liner (an offshoot of the original Hudson River Day Line company formed in 1863), which passed by the Indian Point site each day up until the mid 1980s.

Hudson River Day Line

LOCAL PASSENGER FARES

NEW YORK	TO	ALBANY
One Way	Excursion	One Way Excursion
\$.30	\$.50	New York..... \$2.50 \$4.00
.75	1.00	Yonkers..... 2.50 3.80
.75	1.00	Indian Point..... 2.15
.85	1.25	Bear Mountain..... 2.05
.90	1.25	West Point..... 1.95
1.25	1.75	Newburgh..... 1.75
1.50	2.50	Poughkeepsie..... 1.45
1.85	3.25	Kingston Point..... 1.00 *1.00
2.00	3.50	Catskill..... .70 *.75
2.50	4.00	Hudson..... .60 *.75
		Albany.....


Children between 5 and 12 years, half-fare. *One-day rate.

Railroad tickets from New York to Albany and from Albany to New York will be accepted.
 A few private parlors are available for families or parties traveling together.
 Through tickets are sold to points North, West and South.
 Excursion tickets are good for return during the season issued unless otherwise stated on contract.
 Stop-over on the Day Line Steamers will be allowed within limits of tickets on notice to the Purser.
 Unused tickets and unused portions of tickets of the Hudson River Day Line issue sold in 1933 may be redeemed upon presentation in person at West 42nd Street Pier Ticket Office, or City Ticket Office, 303 West 42nd Street, or by mail at the office of the General Passenger Agent, West 42nd Street Pier, New York.
 Passengers must claim their baggage before boarding the steamer—unclaimed baggage will not be put on board.
 A charge of fifty cents will be made for each baby carriage and twenty-five cents for each go-cart checked.
 Half adult passenger fare will be charged for dogs, and they must not be taken above the main deck.
 Coat room on main deck for valises, small packages, etc. Charge 5 cents.
 The Restaurant is on the main deck, aft, affording full view of the magnificent river scenery while dining. A la carte and table d'hote breakfast served from 8:00 to 9:30 A.M.; table d'hote dinner, \$1.00, served from 11 A.M. until 3 P.M. Also a la carte service in the afternoon after 3 P.M.
 Cafeteria, soda fountain, candy, cigar and news stands are conveniently situated in different parts of the steamers and are open all day.
 For additional information, General Folder and Travelogue of the Hudson River, address Hudson River Day Line, West 42nd Street Pier, New York (Tel. BRyant 9-9700); or 351 Broadway, Albany, N. Y. (Tel. ALbany 3-0107).

© 3405-250M PRINTED IN U.S.A.

TIME TABLE AND FARES

Hudson River Day Line

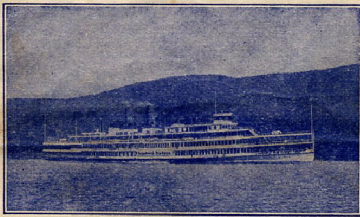

TIME TABLE SEASON

May 21 to October 15, 1933

STEAMERS

"Hendrick Hudson," "Alexander Hamilton,"
 "Robert Fulton," "DeWitt Clinton,"
 "Peter Stuyvesant," "Chauncey M. Depew"

Vacation Trips — One Day Outings

Through Railroad tickets are accepted from New York to Albany and from Albany to New York.
 Daily Excursions, New York or Yonkers to Indian Point, Bear Mountain, Newburgh and Poughkeepsie. Also from Albany to Hudson, Catskill and Kingston Point

West 42nd St. Pier New York City


Hudson River Day Line timetable from 1933. Indian Point Park was the second stop after leaving New York City.

In the 1920s, in order to add non-steamboat revenue to the Day Line company, the company considered having a park of its own that would attract some of the people who went to Bear Mountain and thereby have captive customers all day long.




This is the playground at Indian Point Park in 1924. Across the river is the laid-up fleet of World War I freighters.

The Day Line selected a site on the east side of the river below Peekskill and acquired 320 acres of park ground. Claiming that its property had been a meeting place for Indians, the Day Line called the park Indian Point, a name calculated to have an attractive ring for its younger passengers. Indian Point Park opened on June 26, 1923. Set in a less rugged terrain than Bear Mountain, there were facilities for picnicking, dining in a cafeteria, or swimming in the 100- by 150 foot-pool. There was a dance hall and a beer hall. A quarter got visitors into the park; a dime bought a ride in a speedboat. Indian Point drew more than 5000 people on the weekends and hundreds on weekdays.

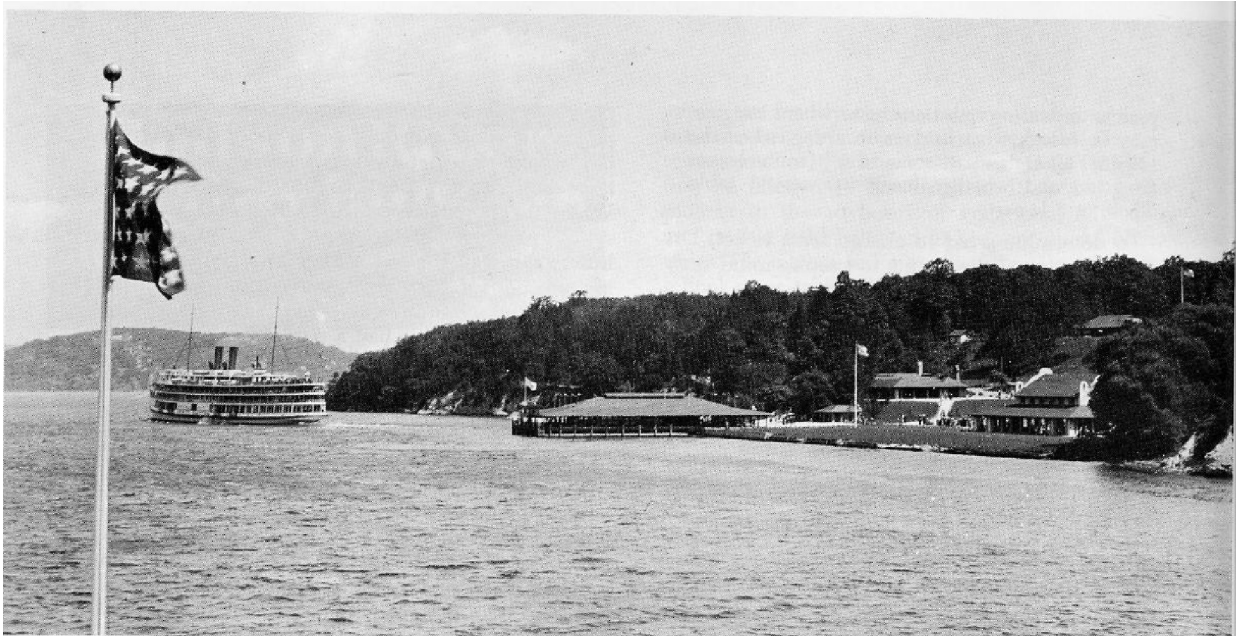

The steamship De Witt Clinton is shown departing the pier at Indian Point Park.

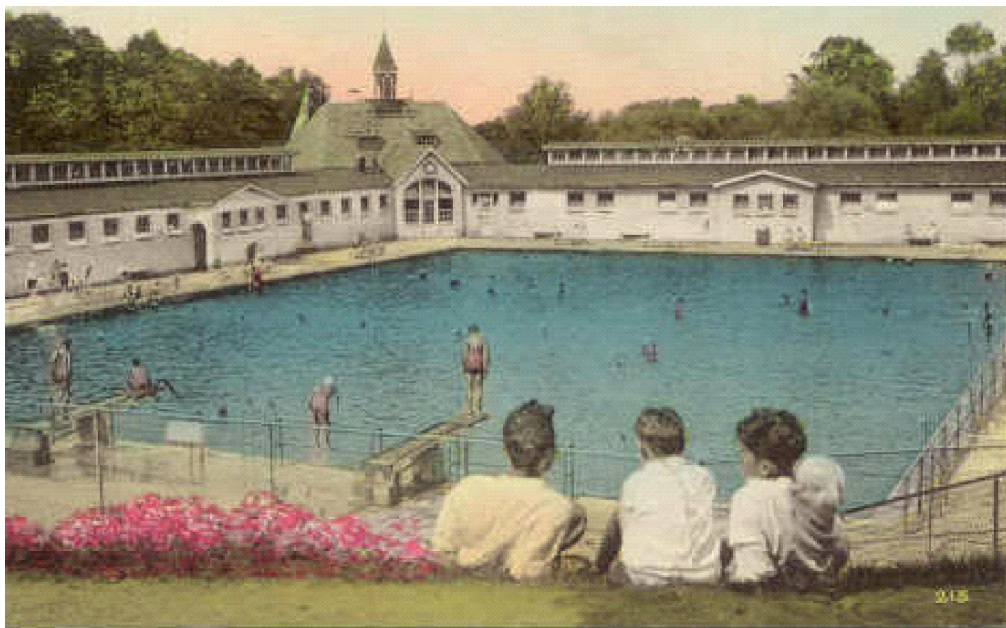

*Postcard view of the 100- x 150-ft pool at Indian Point Park.
Circa 1940*

After World War II, however, the popularity of the park began to decline as the use of the automobile broadened the choice of day trips and vacation spots. In 1949, the Hudson River Day Line, its steamboats, and certain landings were sold to another private company which continued to operate the steamboats. Indian Point Park was not purchased in the deal. In 1950, arrangements were made to allow the new "Day Line" to resume landing at the park. By the mid-50s the owner was looking to sell. The Consolidated Edison Company (Con Ed) was looking to buy.

Con Ed was struggling to meet the growing electricity needs of the mushrooming suburbs of Westchester County. Con Ed needed new plants, but was already weathering criticism over air pollution from its oil and coal plants. An answer was emerging in a promising new technology: atomic energy. Indian Point Park closed in 1956.



Construction of Indian Point 1

IP1 and its on-site support facilities were completed and ready for commercial operations by August 1962 [CHGEC, Section IV.B.2.a]. Construction activity at the site revealed no evidence of items having archaeological value. The IP2 FES stated that most of the sites at Indian Point spared by construction or other modern activities have been heavily molested by relic collectors over a very long period and relatively few have received attention from competent archaeologists [USAEC, Section II.D]. For many years before its acquisition by the original owners of Indian Point for construction of IP1, the site was a commercial amusement area operated by the

Hudson River Day Line and, presumably, was overrun by relic collectors. No other indication of important archaeological activity in the general area could be located. Thus, the Indian Point site probably contains no valuable prehistoric archaeological deposits.

2.12.3 Cultural Resource Properties

No prehistoric or historic sites eligible for listing on or already listed on the NRHP or the NYRHP are located on the site. Historic archaeological sites have been identified within a 6-mile radius of the site. Historic sites are areas of land that usually contain aboveground historic structures and objects such as old homes, barns, churches, cemeteries, business districts, and residential districts. The GIS for the NYSHPO shows no eligible or listed historic sites on the site or in the immediately surrounding area out to at least 1.5 miles. Therefore, no aboveground historic sites eligible for listing on or already listed on the NRHP or NYRHP are located on the site.

The State Preservation Historical Information Network Exchange (SPHINX) database, which is constructed and maintained by the NYSHPO, is used to store up-to-date information on New York aboveground historic sites that are eligible for listing or are already listed on the NRHP and NYRHP [NYSHPO 2006b]. The area within a 6-mile radius of the site covers portions of Westchester County, Putnam County, Orange County, and Rockland County. This four-county area has seen almost 400 years of Euroamerican history, the development of a large local population, and years of intensive historical survey work. As a result, the SPHINX database contains entries for many hundreds of individual historic sites and districts eligible for listing and already listed on the NRHP and NYRHP. Westchester County alone has 217 listed aboveground historic sites. Two of the closest listed historic sites to the site are the City of Peekskill Downtown Historic District, which is about 2 miles to the northeast, and Stony Point Battlefield, which is about 1.5 miles south of the site. Additional listed sites within a 6-mile radius of the site are provided in Table 2-14.

**Table 2-14
 Listed Historic Sites Located in the Vicinity (6-Mile Radius) of IP2 and IP3**

Site Name	Nearest City or Town	Listed NRHP	Listed NYRHP
Westchester County			
Standard House	City of Peekskill	Yes	Yes
Peekskill Freight Depot	City of Peekskill	Yes	Yes
Thomas Nelson House	City of Peekskill	Yes	Yes
Peekskill Presbyterian Church	City of Peekskill	Yes	Yes
Aaron Copland House	Town of Cortlandt	Yes	Yes

Table 2-14
Listed Historic Sites Located in the Vicinity (6-Mile Radius) of IP2 and IP3
(Continued)

Site Name	Nearest City or Town	Listed NRHP	Listed NYRHP
St. Peter's Episcopal Church	City of Peekskill	Yes	Yes
Isaac Young House	Town of New Castle	Yes	Yes
Peekskill Downtown Historic District	City of Peekskill	Yes	Yes
Old St. Peter's Church and Old Cemetery at Van Cortlandtville	Town of Cortlandt	Yes	Yes
Carrie Chapman Catt House	Town of New Castle	Yes	-
Ford Administration Building	City of Peekskill	Yes	-
Fort Hill-Nelson Avenue Historic District	City of Peekskill	Yes	-
St. Augustine's Episcopal Church	Village of Croton-on-Hudson	Yes	-
Old St. Peter's Church	Town of Cortlandt	Yes	Yes
Old Croton Dam; Site of New Croton Dam	Town of Cortlandt	Yes	Yes
Van Cortlandt Upper Manor House	Town of Cortlandt	Yes	Yes
Bear Mountain Bridge Road	Town of Cortlandt	Yes	Yes
Van Cortlandtville School (Common District School No. 10)	Town of Cortlandt	Yes	Yes
John Jones Homestead	Town of Cortlandt	Yes	Yes
Old Croton Aqueduct	Town of Cortlandt	Yes	Yes
Old Chappaqua Historic District	Town of New Castle	Yes	Yes
Chappaqua Railroad Depot and Depot Plaza	Town of New Castle	Yes	Yes
Church of Saint Mary the Virgin and Greely Grove	Town of New Castle	Yes	Yes
Greely House	Town of New Castle	Yes	Yes
Rehoboth	Town of New Castle	Yes	Yes
Sarles' Tavern-Granite House	Town of New Castle	Yes	Yes
Williams-DuBois House	Town of New Castle	Yes	Yes

Table 2-14
Listed Historic Sites Located in the Vicinity (6-Mile Radius) of IP2 and IP3
(Continued)

Site Name	Nearest City or Town	Listed NRHP	Listed NYRHP
Drum Hill High School	City of Peekskill	Yes	Yes
Beecher-McFadden Estate	City of Peekskill	Yes	Yes
Villa Loretto	City of Peekskill	Yes	Yes
United States Post Office-Peekskill	City of Peekskill	Yes	Yes
Van Cortlandt Manor	Village of Croton-on-Hudson	Yes	No
Croton North Railroad Station	Village of Croton-on-Hudson	Yes	Yes
St. Mary's Complex	City of Peekskill	Yes	-
St. Patrick's Church	Town of Cortlandt	Yes	-
Mount Florence	City of Peekskill	Yes	Yes
Quaker Bridge Road	Town of Cortlandt	Yes	-
Asbury United Methodist Church; Bethel Chapel and Cemetery	Village of Croton-on-Hudson	Yes	Yes
Rockland County			
Henry M. Peck House	Town of Haverstraw	Yes	Yes
Philadelphia Toboggan Company Carousel No. 15	Town of Clarkstown	Yes	Yes
Bear Mountain Inn	Town of Stony Point	Yes	Yes
H.R. Stevens House	Town of Clarkstown	Yes	Yes
Terneur-Hutton House	Town of Clarkstown	Yes	Yes
Blauvelt House	Town of Clarkstown	Yes	Yes
Commander	Town of Stony Point	Yes	Yes
Stony Point Battlefield	Town of Stony Point	Yes	Yes
Stony Point Lighthouse	Town of Stony Point	Yes	Yes
Homestead	Town of Haverstraw	Yes	Yes
Henry Garner Mansion	West Haverstraw	Yes	Yes

Table 2-14
Listed Historic Sites Located in the Vicinity (6-Mile Radius) of IP2 and IP3
(Continued)

Site Name	Nearest City or Town	Listed NRHP	Listed NYRHP
Fraser-Hoyer House	West Haverstraw	Yes	Yes
Rockland County Courthouse and Dutch Gardens	Town of Clarkstown	Yes	Yes
King's Daughters Public Library	Town of Haverstraw	Yes	Yes
Mount Moor African American Cemetery	Town of Clarkstown	Yes	Yes
Central Presbyterian Church	Town of Haverstraw	Yes	-
William H. Rose House	Town of Stony Point	Yes	Yes
Bear Mountain Bridge and Toll House	Town of Stony Point	Yes	Yes
United States Post Office-Haverstraw	Town of Haverstraw	Yes	Yes
Orange County			
St. Mark's Baptist Church	Village of Highland Falls	Yes	Yes
Fort Montgomery Site	Town of Highlands	Yes	Yes
Cragston Dependencies	Town of Highlands	Yes	No
St. Mark's Episcopal Church	Town of Highlands	Yes	No
Storm King Highway	Town of Highlands	Yes	No
U.S. Bullion Depository	Town of Highlands	Yes	No
U.S. Military Academy (West Point)	Town of Highlands	Yes	Yes
Center Street, House at 37	Village of Highland Falls	Yes	No
Church of the Holy Innocents and Rectory	Village of Highland Falls	Yes	No
First Presbyterian Church of Highland Falls	Village of Highland Falls	Yes	No
Highland Falls Railroad Depot	Village of Highland Falls	Yes	No
Highland Falls Village Hall	Village of Highland Falls	Yes	No

Table 2-14
Listed Historic Sites Located in the Vicinity (6-Mile Radius) of IP2 and IP3
(Continued)

Site Name	Nearest City or Town	Listed NRHP	Listed NYRHP
House at 116 Main Street	Village of Highland Falls	Yes	No
Parry House	Village of Highland Falls	Yes	No
Pine Terrace	Village of Highland Falls	Yes	No
The Squirrels	Village of Highland Falls	Yes	No
Stonihurst	Village of Highland Falls	Yes	No
Webb Lane House	Village of Highland Falls	Yes	No
Queensboro Ironworks Historic District	Town of Highlands	Yes	-
Bear Mountain State Park Historic District	Town of Highlands	Yes	Yes
Palisades Interstate Parkway	Town of Highlands	Yes	Yes
Putnam County			
Boscobel	Town of Philipstown	Yes	Yes
Castle Rock	Town of Philipstown	Yes	Yes
DeRham Farm	Town of Philipstown	Yes	Yes
Old Albany Post Road	Town of Philipstown	Yes	Yes
The Birches	Town of Philipstown	Yes	Yes
Eagle's Rest (Jacob Rupert Estate)	Town of Philipstown	Yes	Yes
Garrison Landing Historic District	Town of Philipstown	Yes	Yes
Garrison Union Free School	Town of Philipstown	Yes	Yes
Glenfields	Town of Philipstown	Yes	Yes
Hurst-Pierrepont Estate	Town of Philipstown	Yes	Yes
Mandeville House	Town of Philipstown	Yes	Yes

Table 2-14
Listed Historic Sites Located in the Vicinity (6-Mile Radius) of IP2 and IP3
(Continued)

Site Name	Nearest City or Town	Listed NRHP	Listed NYRHP
Montrest	Town of Philipstown	Yes	Yes
Moore House	Town of Philipstown	Yes	Yes
Normandy Grange	Town of Philipstown	Yes	Yes
Oulagisket	Town of Philipstown	Yes	Yes
Rock Lawn and Carriage House	Town of Philipstown	Yes	Yes
Walter Thompson House and Carriage House	Town of Philipstown	Yes	Yes
Walker House	Town of Philipstown	Yes	Yes
Wilson House	Town of Philipstown	Yes	Yes
Woodlawn (Malcolm Gordon School)	Town of Philipstown	Yes	Yes
Fair Lawn	Town of Philipstown	Yes	Yes
West Point Foundry	Town of Philipstown	Yes	Yes
Manitoga (Russell Wright Estate)	Town of Philipstown	Yes	Yes
Dick's Castle	Town of Philipstown	Yes	Yes
Plumbush	Town of Philipstown	Yes	Yes
St. Philips Church in the Highlands Complex	Town of Philipstown	Yes	Yes
Frederick Osborn House	Town of Philipstown	Yes	Yes
Indian Brook Road Historic District	Town of Philipstown	Yes	Yes
Garrison Grist Mill Historic District	Town of Philipstown	Yes	Yes
NYSHPO 2006b			

Note: - in table above indicates site may be proposed on state list, but approval of its listing has not yet occurred.

The proposed action upon which this ER is based is for the renewal of the IP2 and IP3 Operating Licenses, to extend to 2033 and 2035, respectively. As discussed in [Section 3](#), Entergy does not foresee a need for refurbishment during the license renewal period, nor is any major construction planned that will result in significant land disturbance.

A Phase IA Literature Review and Archeological Sensitivity Assessment was performed for the site property in November 2006. As a result of this review and assessment, the following was determined.

- Previously disturbed areas shown in [Figure 2-29](#) have been disturbed down to the bedrock layer. Therefore, no cultural resources would be expected.
- Cultural resources on the southern portion of the site property are unlikely to be present.
- Although the northern portion of the site property was subject to heavy surface mining during the latter nineteenth century, four potentially archeological sensitive areas were identified.

Entergy does not have plans for further development of the property in association with the application for license renewal. However, a fleet procedure is in place for management of cultural resources ahead of any future ground-disturbing activities at the plant. This procedure, which requires reviews, investigations and consultations as needed, ensures that existing or potentially existing cultural resources are adequately protected and assists Entergy in meeting state and federal expectations. [[Entergy](#)]

2.13 Related Federal Project Activities

During the preparation of this report, Entergy did not identify any known or reasonably foreseeable federal projects or other activities that could contribute to the cumulative environmental impacts of license renewal at the site.

2.14 References

- ASA Analysis & Communication, Inc. (ASA). 2004. Year Class Report for the Hudson River Estuary Monitoring Program. Prepared for Dynegy Roseton, LLC, Entergy Nuclear Indian Point 2, LLC, Entergy Nuclear Indian Point 3, LLC, and Mirant Bowline, LLC.
- Bain, M.B.; Haley, N.; Peterson, D.L.; Arend, K.A.; Mills, K.E.; and Sullivan, P.J. 2000. Shortnose Sturgeon in the Hudson River: An Endangered Species Recovery Story. Biology, Management, and Protection of Sturgeon Symposium Pre-Print. ERI, Palo Alto, CA.
- Barnthouse, L.W.; Coutant, C.C.; and VanWinkle, W. 2002. Status and Trends of Hudson River Fish Populations and Communities Since the 1970s: Evaluation of Evidence Concerning Impacts of Cooling Water Withdrawals. Unpublished.
- BCW (The Business Council of Westchester). 2001. Westchester County, NY Relocation Package, White Plains, NY. Accessed at <http://www.westchesterny.org/RelocationPackage.html> on May 31, 2006.
- Brown, W. Baseline Population Projections NYSIS Projects SEP02. 2002. New York Statistical Information System. Accessed at <http://www.nysis.cornell.edu/data.html> on April 4, 2006.
- Caraco, N.F.; Cole, J.J.; Raymond, P.A.; Strayer, D.L.; Pace, M.L.; Findlay, S.E.G.; and Fischer, D.T. 1997. Zebra Mussel Invasion in a Large, Turbid River: Phytoplankton Response to Increased Grazing. Institute of Ecosystem Studies.
- CCWD (Cortlandt Consolidated Water District) Annual Water Supply Statement, page 1. Accessed at www.townofcortlandt.com on July 15, 2006.
- Census 2000 TIGER/Line Shapefiles for Connecticut, New Jersey, New York, and Pennsylvania. [online] ESRI ArcData. Accessed at http://arcdata.esri.com/data/tiger2000/tiger_county.cfm?sfips=36 on May 12, 2005.
- CHGEC (Central Hudson Gas and Electric Corporation). 1999. Consolidated Edison Company of New York, Inc., New York Power Authority, and Southern Energy New York, Draft Environmental Impact Statement for State Pollutant Discharge Elimination System Permits for Bowline Point, Indian Point 2 and 3, and Roseton Steam Electric Generating Stations.
- Dutchess County. 2005. NY Online, Elementary and Secondary Schools, November 30, 2005. Accessed at <http://www.co.dutchess.ny.us/Schools/SCHesschools.htm> on December 14, 2006.
- Enercon Services, Inc. 2003. Economic and Environmental Impacts Associated with Conversion of Indian Point Units 2 and 3 to a Closed-Loop Condenser Cooling Water Configuration.
- ENN (Entergy Nuclear Northeast). 2007. Indian Point Units 1, 2, Offsite Dose Calculation Manual (ODCM), Revision 10.

Entergy. 2006. EN-EV-121, Cultural Resources Protection Plan, Revision 0.

ESRI (Environmental Systems Research Institute). 2005. Copyright 2005, All rights reserved. ArcGIS is a trademark, registered trademark, or service mark of ESRI in the US, the European Community, or certain other jurisdictions. www.esri.com.

ESRI (Environmental Systems Research Institute). 2006. Version 9.1.

GCR (Greenway Connections Report). 2006. Dutchess County New York. Accessed at <http://www.co.dutchess.ny.us/EnvironmentLandPres/ELPgreenwayguide.htm> on June 30, 2006.

HHSD (Hendrick Hudson School District). 2006. About the District. Accessed at http://www.henhudschools.org/district_profile/about_district.html on December 13, 2006.

IES (Institute of Ecosystem Studies). Undated. Zebra Mussels and the Hudson River. Accessed at http://www.ecostudies.org/people_sci_strayer_zebra_mussels.html, on April 3, 2006.

IP2 UFSAR. Indian Point Energy Center. Indian Point 2, Updated Final Safety Analysis Report.

IP3 UFSAR. Indian Point Energy Center. Indian Point 3, Updated Final Safety Analysis Report.

IPEC (Indian Point Energy Center). 2000-2004. Meteorological Tower Data, 2000-2004.

IPEC (Indian Point Energy Center). 2006. Telephonic correspondence from R. Schoenewe (Enercon) to D. Gray (Entergy) regarding the on-site USGS registered groundwater well, dated February 6, 2006.

Journal News. 2006. Westchester County's Major Employers, from Staff Reports, March 19, 2006. Accessed at <http://www.thejournalnews.com/apps/pbcs.dll/article?AID=/20060319/BUSINESS/603190302/1066/BUSINESS01> on December 23, 2006.

Landview 6. 2004. A Viewer for EPA, Census Bureau, and USGS Data and Maps.

Miller, Barbara (Building Inspector). Village of Buchanan. 2006. Phone conversation concerning land development in the Village of Buchanan on January 24, 2006.

NEI (Nuclear Energy Institute). 2004. Economic Benefits of Indian Point Energy Center: An Economic Impact Study by the Nuclear Energy Institute. Available at http://www.nei.org/documents/Economic_Benefits_Indian_Point.pdf. Accessed May 15, 2006.

NMFS (National Marine Fisheries Service). 2000. Environmental assessment of a permit for the incidental take of Shortnose sturgeon at the Roseton and Danskammer Point generating stations.

- NMFS (National Marine Fisheries Service). 2006. NOAA Fisheries, Office of Protected Resources, Marine and Anadromous Fish, Atlantic Sturgeon, Updated 10/18/2006, Accessed at <http://www.nmfs.noaa.gov/pr/species/fish/> on February 12, 2007.
- NMFS (National Marine Fisheries Service). 2007. NOAA Fisheries, Office of Protected Resources, Marine and Anadromous Fish, Shortnose Sturgeon. Accessed at <http://www.nmfs.noaa.gov/pr/species/fish/> on February 12, 2007.
- NPS (National Park Service). 2006. Explore Air. Class I Receptors. Accessed at <http://www2.nature.nps.gov/air/Maps/Receptors/index.cfm> on June 5, 2006.
- NRC (Nuclear Regulatory Commission). 1975. Final Environmental Statement Related to the Operation of Indian Point Unit No. 3, Docket No. 50-286, United States Nuclear Regulatory Commission, Office of Nuclear Reactor Regulation.
- NRC (Nuclear Regulatory Commission). 1996. Generic Environmental Impact Statement for License Renewal of Nuclear Plants (GEIS), Volumes 1 and 2, NUREG-1437, Washington, DC.
- NRC (Nuclear Regulatory Commission). 2004. Procedural Guidance for Preparing Environmental Assessments and Considering Environmental Issues. NRR Office Instruction No. LIC-203, Revision 1.
- NRCC (Northeast Regional Climate Center): New York Climate Office. 2006. The Climate of New York. Accessed at http://nysc.eas.cornell.edu/climate_of_ny.html on February 13, 2006.
- NSSL (National Severe Storm Laboratory). 2006. Tornadoes... Nature's Most Violent Storms.
- NWWW (Northern Westchester Water Works). 2006. Telephonic correspondence from R. Schoenewe (Enercon) to B. Leibowitz (Northern Westchester Water Works) regarding the Westchester County, NY Public Water Supply system, dated January 27, 2006.
- NYLCV (New York League of Conservation Voters, The). 2005. Westchester Chapter: 2005. Accessed at <http://www.nylcv.org/regions/westchester> on June 30, 2006.
- NYNHP (New York Natural Heritage Program). 2006a. Bog Turtle. Accessed at <http://www.acris.nynhp.org/guide.php?id=7507andpart=2> on July 10, 2006.
- NYNHP (New York Natural Heritage Program). 2006b. New York Natural Heritage Program Rare Plant Status Lists. May 2006.
- NYOSPRHP (New York Office of State Parks, Recreation, and Historic Preservation). 2006. Accessed at <http://nysparks.state.ny.us/parks/> in April 2006.
- NYSDEC (New York State Department of Environmental Conservation). 1997. New York State Freshwater Wetlands Map, Westchester County, Map 1 of 14, 1997. Accessed at <http://www.bagdonenvironmental.com/regmaps/Westchester/Peekskill.pdf>.

- NYSDEC (New York State Department of Environmental Conservation). 1999. Assessment of Reptile and Amphibian Species Richness and Distribution in New York, 1999. Accessed at <http://www.dec.state.ny.us/website/dfwmr/wildlife/herp/publications/specrichposter.html> on January 24, 2006.
- NYSDEC (New York State Department of Environmental Conservation). 2003. Final Environmental Impact Statement Concerning the Applications to Renew SPDES Permits for the Roseton 1 and 2, Bowline 1 and 2 and Indian Point 2 and 3 Electric Generating Stations, Orange, Rockland and Westchester Counties, Hudson River Power Plants FEIS. Accepted: June 25, 2003.
- NYSDEC (New York State Department of Environmental Conservation). 2004. New York State Section 305(b) Water Quality Report for 2004. Albany, NY.
- NYSDEC (New York State Department of Environmental Conservation). 2005a. Checklist of the Amphibians, Reptiles, Birds, and Mammals of New York, Including their Legal Status, 2005. Accessed at <http://www.dec.state.ny.us/website/dfwmr/wildlife/spplist.pdf> on January 17, 2006.
- NYSDEC (New York State Department of Environmental Conservation). 2005b. New York State Breeding Bird Atlas, 2000-2005. Accessed at <http://www.dec.state.ny.us/website/dfwmr/wildlife/bba/> <http://wwwapps.dec.state.ny.us/apps/BBAMap/index.cfm> on January 24, 2006.
- NYSDEC (New York State Department of Environmental Conservation). 2005c. New York State Bald Eagle Report, Albany, NY. Accessed at <http://www.dec.state.ny.us/website/dfwmr/wildlife/endspec/baea2005.pdf> on June 2, 2006.
- NYSDEC (New York State Department of Environmental Conservation). 2006a. Indiana bat fact sheet, Albany, NY. Accessed at <http://www.dec.state.ny.us/website/dfwmr/wildlife/endspec/inbafs.html> on January 19, 2006.
- NYSDEC (New York State Department of Environmental Conservation). 2006b. Shortnose sturgeon fact sheet, Albany, NY. Accessed at <http://www.dec.state.ny.us/website/dfwmr/wildlife/endspec/shnostur.html> on January 11, 2006.
- NYSDEC (New York State Department of Environmental Conservation). 2006c. Peregrine Falcon Fact Sheet. Accessed at <http://www.dec.state.ny.us/website/dfwmr/wildlife/endspec/pefafs.html> on January 17, 2006.
- NYSDEL (New York State Department of Labor). 2006. Division of Research and Statistics, Employed, Unemployed, and Rate of Unemployment by Place of Residence for New York State and Major Labor Areas. November 2006. Accessed at <http://www.labor.state.ny.us/workforceindustrydata/PressReleases/prtbur.txt> on December 26, 2006.

- NYSDOT (New York State Department Of Transportation). 2004. 2004 Traffic Data Report for New York State.
- NYSED (New York State Education Department). 2005a. Elementary, Middle, Secondary, and Continuing Education, New York State District Report Card Comprehensive Information Report, School Districts in Orange County, March 3, 2005. Accessed at http://www.emsc.nysed.gov/repcrd2004/links/c48_dist.shtml on December 13, 2006.
- NYSED (New York State Education Department). 2005b. Elementary, Middle, Secondary, and Continuing Education, New York State District Report Card Comprehensive Information Report, School Districts in Putnam County, March 3, 2005. Accessed at http://www.emsc.nysed.gov/repcrd2004/links/c48_dist.shtml on December 13, 2006.
- NYSED (New York State Education Department). 2005c. Elementary, Middle, Secondary, and Continuing Education, New York State District Report Card Comprehensive Information Report, School Districts in Rockland County, March 3, 2005. Accessed at http://www.emsc.nysed.gov/repcrd2004/links/c48_dist.shtml on December 13, 2006.
- NYSED (New York State Education Department). 2006a. Elementary, Middle, Secondary, and Continuing Education, New York State District Report Card Comprehensive Information Report, Lakeland School District, March 1, 2006. Accessed at <http://emsc32.nysed.gov/repcrd2005/cir/662401060000.pdf> on December 13, 2006.
- NYSED (New York State Education Department). 2006b. Operations and Management Services, HENDRICK HUDSON CSD (660203). Accessed at <http://www.nysed.gov/STATEAID/DIST/FM06/AOE/660203.HTML> on December 13, 2006.
- NYSED (New York State Education Department). 2006c. Operations and Management Services, Lakeland (662401). Accessed at <http://www.nysed.gov/stateaid/dist/FM06/AOE/662401.HTML> on December 13, 2006.
- NYSERDA (New York State Energy Research and Development Authority). 2007. Lease for Discharge Canal Structure.
- NYSHPO (New York State Historic Preservation Office). 2006a. New York State Historic Preservation Office Geographic Information System (GIS)-Public Access. System contains information and data from the State and National Registers of Historic Places GIS Database and Archaeological Sensitivity GIS Database (SHPO Archaeological Site Files and New York State Museum Archaeological Site Files). Accessed at <http://www.eprhp.state.ny.us/nr/main.asp>, June 2006.
- NYSHPO (New York State Historic Preservation Office). 2006b. State Preservation Historical Information Network Exchange (SPHINX), 2006. Accessed at <http://www.oprhp.state.ny.us/sphinx/login.asp> on June 2006.

- NYSL (New York State Library). 2004. New York: Local Open Space Planning Guide, 2004. Accessed at <http://www.nysl.nysed.gov/scandoclinks/ocm54975932.htm> on May 30, 2006.
- NYSOA (New York State Ornithological Association). 2004. Annual Waterfowl Count Report, January 2004. Accessed at <http://www.nybirds.org/ProjWaterfowl.htm> on January 3, 2007.
- NNYSOSC (New York State Office of the State Comptroller). 2007. Local Government Services and Economic Development. Accessed at http://www.osc.state.ny.us/localgov/datanstat/findata/index_choice.htm on March 6, 2007.
- OC (Orange County). 2003. Orange County Comprehensive Plan: Strategies for Quality Communities. Accessed at <http://www.orangecountygov.com/documentView.asp?docID=138> on May 30, 2006.
- OCWA (Orange County Water Authority). 2006. Telephonic correspondence from R. Schoenewe (Enercon) to J. Beaumont (Orange County Water Works) regarding the Orange County, NY Public Water Supply system. January 27, 2006.
- Pace, M.L., S.E.G. Findlay, and D. Fischer. 1998. Effects of an Invasive Bivalve on the Zooplankton Community of the Hudson River. Institute of Ecosystem Studies.
- PAD (Planning and Development). 2006. Divisions: Poughkeepsie-Dutchess County Transportation Council. 2006. Available at <http://www.co.dutchess.ny.us/CountyGov/Departments/Planning/PLpdctIndex.htm>. Accessed June 30, 2006.
- PC (Putnam County). 2003. Report on the Task Force on Vision 2010: Guiding Putnam into the Next Decade. Accessed at www.putnamcountyny.com/vision2010.html on May 30, 2006.
- PCWD (Putnam County Water Department). 2006. Telephonic correspondence from R. Schoenewe (Enercon) to E. Bartus (Putnam County Water Works) regarding the Putnam County, NY Public Water Supply System, dated January 27, 2006.
- PPC (Population Projections for Connecticut Municipalities). 1990-2020. Connecticut State Data Center (SDC). Accessed at <http://www.opm.state.ct.us/pdpd3/data/project.htm> on April 4, 2006.
- PPNJ (Population Projections New Jersey). 1990-2025. [online]. New Jersey Department of Labor and Workforce Development. Accessed at <http://www.wnjp.in.net/OneStopCareerCenter/LaborMarketInformation/Imi03/Sptab1.pdf> on April 4, 2006.
- PPP (Population Projections for Pennsylvania). 1990-2020. [online] Pennsylvania State Data Center. Accessed at http://pasdc.hbg.psu.edu/pasdc/Data_and_Information/Data/231a.html on April 4, 2006.
- PTWD (Poughkeepsie Townwide Water District). 2005. Annual Water Quality Report for Calendar Year 2005. Accessed at <http://www.townofpoughkeepsie.com/PoughkeepsieTWWD2005.pdf> on July 10, 2006.

- PWD (Peekskill Water Department, City of). 2005. Annual Drinking Water Quality Report for 2005, City of Peekskill - Water Department. Accessed at www.ci.peekskill.ny.us on June 30, 2006.
- RCDH (Rockland County Department of Health). 2006. Assessment of United Water New York Supply Accessed for New Projects, 2006 available at http://www.co.rockland.ny.us/health/pdf/SupplyDemandTracking_1.pdf on August 28, 2006.
- RCNY (Rockland County New York). 2001. Rockland County: River to Ridge, A Plan for the 21st Century: Rockland County New York. Accessed: <http://www.co.rockland.ny.us/planning/landuse/complan.htm> on May 30, 2006.
- RCNY (Rockland County New York). 2006. County of Rockland Open Space Guidelines, Rockland, NY. Accessed at <http://www.co.rockland.ny.us/Bull/openspace/OSGuidelines.htm> on July 7, 2006.
- RCWW (Rockland County Water Works). 2006. Telephonic correspondence from R. Schoenewe (Enercon) to D. Miller (Rockland County Water Works) regarding the Rockland County, NY Public Water Supply system, dated January 27, 2006.
- RWS (Rockland's Water Supply). 2006. Clearwater. Poughkeepsie, NY. Accessed at www.clearwater.org/sustainablewatershed/pdfs/miller.pdf on February 20, 2007.
- Secor, D.H., and R.J. Woodland. 2005. Final Report. Recovery and Status of Shortnose Sturgeon in the Hudson River. Univ. Maryland. Envir. Sci. Tech. Rep. Ser. No. TS-493-05-CBL.
- Shapley, D.; Morris, E. 2005. Poughkeepsie Journal, article "Dams damage river life, Environmentalists push to have defunct structures removed," July 3, 2005. Accessed at http://www.dcemc.org/fishkill/media/PoJo_07_03_05.htm on September 18, 2006.
- SNY (State of New York). 1999. State Board of Real Property Services, Divestiture of Electricity Generating Plants: Property Tax Implications, December 31, 1999.
- Strayer, D.L., J. Powell, P. Ambrose, L.C. Smith, M.L. Pace, and D.T. Fisher. 1996. Arrival, spread, and early dynamics of a zebra mussel (*Dreissena polymorpha*) population in the Hudson River estuary. *Can. J. Fish. Aquat. Sci.*, 53:1143-1149.
- Strayer, D.L., N.F. Caraco, J.J. Cole, S. Findlay and M.L. Pace. 1999. Transformation of Freshwater Ecosystems by Bivalves: A case study of zebra mussels in the Hudson River. *BioScience*. 49(1):19-27.
- TOCNY (Town of Cortlandt, New York). 2004. Comprehensive Master Plan, Town of Cortlandt, July 2004. Accessed at <http://www.townofcortlandt.com/> on May 30, 2006.
- TOCNY (Town of Cortlandt, New York). 2006. Town Profile. Accessed at <http://www.townofcortlandt.com/Cit-e-Access/webpage.cfm?TID=20&TPID=2564> on July 15, 2006.

- USAEC (U.S. Atomic Energy Commission). 1972. Final Environmental Statement Related to the Operation of Indian Point Nuclear Generating Plant Unit No. 2. Consolidated Edison Company of New York, Inc., Docket No. 50-247, September 1972.
- USCB (U.S. Census Bureau). 2000a. DP-1 Profile of General Demographic Characteristics, 2000. Data Set.
- USCB (U.S. Census Bureau). 2000b. State and County Quick Facts: Orange County, NY; Putnam County, NY; Rockland County, NY; Westchester County, NY.
- USCB (U.S. Census Bureau). 2000c. American Fact Finder, New York -- County - GCT-PH1. Census. Population, Housing Units, Area, and Density: 2000. Accessed at http://factfinder.census.gov/servlet/GCTTable?_bm=y&-geo_id=04000US36&_box_head_nbr=GCT-PH1&-ds_name=DEC_2000_SF1_U&-format=ST-2 on July 7, 2006.
- USCB (U.S. Census Bureau). 2004a. County Business Patterns (NAICS), Dutchess County, NY, Major Industry. Accessed at <http://censtats.census.gov/cgi-bin/cbpnaic/cbpsect.pl> on December 23, 2006.
- USCB (U.S. Census Bureau). 2004b. County Business Patterns (NAICS), Orange County, NY, Major Industry. Accessed at <http://censtats.census.gov/cgi-bin/cbpnaic/cbpsect.pl> on December 23, 2006.
- USCB (U.S. Census Bureau). 2004c. County Business Patterns (NAICS), Putnam County, NY, Major Industry. Accessed at <http://censtats.census.gov/cgi-bin/cbpnaic/cbpsect.pl> on December 23, 2006.
- USCB (U.S. Census Bureau). 2004d. County Business Patterns (NAICS), Rockland County, NY, Major Industry. Accessed at <http://censtats.census.gov/cgi-bin/cbpnaic/cbpsect.pl> on December 23, 2006.
- USCB (U.S. Census Bureau). 2004e. County Business Patterns (NAICS), Westchester County, NY, Major Industry. Accessed at <http://censtats.census.gov/cgi-bin/cbpnaic/cbpsect.pl> on December 23, 2006.
- USCB (U.S. Census Bureau). 2005. State and County Quick Facts. Accessed at <http://quickfacts.census.gov/qfd> on May 31, 2006.
- USDA (U.S. Department of Agriculture). 2002a. Dutchess County: 2002 Census of Agriculture County Profile. Accessed at <http://www.nass.usda.gov/census/census02/profiles/ny/> on May 15, 2005.
- USDA (U.S. Department of Agriculture). 2002b. Orange County: 2002 Census of Agriculture County Profile. Accessed at <http://www.nass.usda.gov/census/census02/profiles/ny/> on May 15, 2005.

- USDA (U.S. Department of Agriculture). 2002c. Putnam County: 2002 Census of Agriculture County Profile. Accessed at <http://www.nass.usda.gov/census/census02/profiles/ny/cp36079.PDF> on May 15, 2005.
- USDA (U.S. Department of Agriculture). 2002d. Rockland County: 2002 Census of Agriculture County Profile. Accessed at <http://www.nass.usda.gov/census/census02/profiles/ny/cp36087.PDF> on May 15, 2005.
- USDA (U.S. Department of Agriculture). 2002e. Westchester County: Farm Statistics. Accessed at <http://www.nass.usda.gov/census/census02/profiles/ny/cp36119.PDF> on May 15, 2006.
- USDA (U.S. Department of Agriculture). 2002f. National Agricultural Statistics Service (NASS), Chapter 2, Table 7. Hired Farm Labor - Workers and Payroll: 2002. Accessed on the internet at http://www.nass.usda.gov/census/census02/volume1/ny/st36_2_007_007.pdf.
- USDOC (U.S. Department of Commerce). 2006a. National Climatic Data Center, NOAA Satellite and Information Service, Tornado Climatology. Accessed at <http://www.ncdc.noaa.gov/oa/climate/severeweather/tornadoes.html> on August 28, 2006.
- USDOC (U.S. Department of Commerce). 2006b. National Climatic Data Center (NCDC), 2006 Westchester County Tornado Query Results. Accessed at <http://www4.ncdc.noaa.gov/cgi-win/wwwcgi.dll?wwevent~storms> on July 6, 2006.
- USEPA (U.S. Environmental Protection Agency). 2006a. Green Book. Accessed at <http://www.epa.gov/air/oaqps/greenbk/gnacs.html#NEW%20YORK> on June 5, 2006.
- USEPA (U.S. Environmental Protection Agency). 2006b. Safe Drinking Water Information System (SDWIS) database. Accessed at <http://oaspub.epa.gov> on January 24, 2006.
- USFWS (U.S. Fish and Wildlife Service). 1997. Significant Habitats and Habitat Complexes of The New York Bight Watershed. Hudson River Estuary, Habitat Complex 32, Lower Hudson River.
- USFWS (U.S. Fish and Wildlife Service). 2006a. Threatened and Endangered Species System, Listings by State and Territory. Accessed at http://ecos.fws.gov/tess_public on January 16, 2006.
- USFWS (U.S. Fish and Wildlife Service). 2006b. Critical Habitat Portal. Accessed at <http://criticalhabitat.fws.gov/> on January 17, 2006.
- USGS (U.S. Geological Survey). 1992. National Land Cover Database, "1992 NLCD Land Cover Layer." Accessed at <http://seamless.usgs.gov/website/seamless/Mapframe.htm> on September 15, 2006.
- USGS (U.S. Geological Survey). 1998. Water Quality in the Hudson River Basin, New York and Adjacent States, 1992-1995, Circular 1165, 1998.

- USGS (U.S. Geological Survey). 1999. EROS Data Center, National Elevation Data Set (NED) 1 Arc-sec. Accessed at <http://seamless.usgs.gov/> [coordinate boundaries: N: 42.09755, W: -74.81797, S: 40.8614, E: -73.46317] in May 2006.
- USGS (U.S. Geological Survey). 2005. Multi-Resolution Land Characteristics Consortium (MRLC) data viewer. Accessed at <http://gisdata.usgs.net/website/MRLC/> on January 17, 2006.
- USGS (U.S. Geological Survey). 2006a. Site Map for New York. Accessed at www.waterdata.usgs.gov/ny/nwis/nwismap.html on January 27, 2006.
- USGS (U.S. Geological Survey). 2006b. Troy, New York. Email correspondence dated February 3, 2006.
- UWNY (United Water New York). 2006. Annual Water Quality Report 2005. Accessed at <http://www.unitedwater.com/uwny/pdfs/dNY.pdf> on August 28, 2006.
- Vankat, John L. 1992. The Natural Vegetation of North America, An Introduction.
- VBNY (Village of Buchanan, New York). 1998. About Our Village. Accessed at <http://www.villageofbuchanan.com/> on July 7, 2006.
- VBNY (Village of Buchanan, New York). 2006. Buchanan Water Department, Entergy Nuclear Operations, March, April and May, 2006 Account Statements.
- VCOH (Village of Croton-on-Hudson). 2005. Annual Water Quality Report 2005. Accessed at http://Village.croton-on-hudson.ny.us/Public_Documents/CrotonHudsonNY_WebDocs/Water/CCReport2005.pdf on July 14, 2006.
- VNWP (Village of Nyack Water Plant). 2007. Phone contact with Mr. Mike Lagaglio, Superintendent. January 31, 2007.
- VOWS (Village of Ossining Water System). 2005. Annual Drinking Water report for 2005. Accessed at http://www.Village.ossining.ny.us/documents/wqr_2005.pdf on July 14, 2006.
- VSDPW (Village of Suffern Department of Public Works). 2007. Phone contact with Mr. Carl Rossi, Director. January 31, 2007.
- WCBH (Westchester County Board of Health). 2001. Comprehensive Mosquito-Borne Disease Surveillance and Control Plan, Draft Generic Environmental Impact Statement, Appendix 3.EI. Accessed at <http://www.westchestergov.com/hdbooklets/StingEIS/DGEISfiles/AppendixFiles/Appendix%203E.I%20Water%20Supply.pdf> on July 6, 2006.
- WCD (Westchester County Databook): History, Geography and Land Use. 2000. Accessed at <http://www.westchestergov.com/planning/research/main.htm> on May 31, 2006.

- WCDP (Westchester County Department of Planning). 2003. Northern Westchester County, Groundwater Conditions Summary, Data Gaps, and Program Recommendations Contract C-PL-02-71. Prepared by The Chazen Companies, April 2003.
- WCDP (Westchester County Department of Planning). 2004. Major Businesses and Employment Sites by Municipality. Accessed at <http://www.westchestergov.com/planning/research/MajorEmployers/MajEmpMun.pdf> on December 23, 2006.
- WCDP (Westchester County Department of Planning). 2005a. Databook Westchester County, Education, School Districts 2003. November 30, 2005.
- WCDP (Westchester County Department of Planning). 2005b. Databook Westchester County, November 2005, Labor Force. Accessed at <http://www.westchestergov.com/planning> on December 23, 2006.
- WCDP (Westchester County Department of Planning). 2005c. Databook Westchester County, November 2005, Income and Prices. Accessed at <http://www.westchestergov.com/planning> on December 23, 2006.
- WJWW (Westchester Joint Water Works). 2006. Annual Drinking Water Quality Report for 2005. Accessed at www.wjww.com on June 30, 2006.
- WLT (Westchester Land Trust). 2001. Westchester Open Space Alliance. Accessed at <http://www.westchesterlandtrust.org/Accomplishments/wosa.html> on June 30, 2006.

Go to [List of Section 2 Figures](#).

3.0 THE PROPOSED ACTION

3.1 Description of the Proposed Action

The proposed action is to renew the facility operating licenses for IP2 and IP3 for an additional twenty years beyond the expiration of the current operating licenses. For IP2 and IP3 (Facility Operating Licenses DPR-26 and DPR-64), the requested renewals would extend the license expiration dates from midnight September 28, 2013, to midnight September 28, 2033, and December 12, 2015, to midnight December 12, 2035, respectively.

There are no changes related to license renewal with respect to operation of IP2 and IP3 that would significantly affect the environment during the period of extended operation.

3.2 General Plant Information

The principal structures of IP2 and IP3 consist of two pressurized water reactors with containment structures (IP1 is deactivated and is in SAFSTOR), turbine buildings, auxiliary buildings, administrative building, training building, and intake structures [IP2 UFSAR, Section 1.2.2]. Figure 3-1 shows the general features of the facility. Figure 2-3 shows the exclusion zone. No residences are permitted within this exclusion zone.

3.2.1 Reactor and Containment Systems

The site utilizes pressurized water reactors in the nuclear steam supply system and a once-through circulating water system that withdraws cooling water from and discharges to the Hudson River. Westinghouse Electric Corporation supplied the nuclear steam supply system. Power generation during the license renewal term will consist of IP2 and IP3, with pressurized water reactors and turbine generators producing outputs of 3,216 and 3,216 megawatts-thermal (MWt), which are approximately 1,078 and 1,080 megawatts-electrical (MWe), respectively [PowerGEM]. IP2 achieved commercial operation in 1974 and IP3 became commercial in 1976.

Fuel for IP2 and IP3 is made of low-enrichment (< 5% by weight) uranium dioxide pellets stacked in pre-pressurized tubes made from zircaloy or ZIRLO, with welded end plugs that form sealed enclosures. Based on core design values, IP2 and IP3 operate at an individual rod average fuel burnup (burnup averaged over the length of a fuel rod) of no more than 62,000 MWD/MTU, which ensures that peak burnups remain within acceptable limits specified in Appendix B to Subpart A of 10 CFR Part 51 (Table B-1).

The engineered safety features for the plants have sufficient redundancy in component and power sources such that under the conditions of a hypothetical loss-of-coolant accident, the system can, even when operating with partial effectiveness, maintain the integrity of the containment and keep the public's exposure below the limits of 10 CFR 50.67. The containment system incorporates continuously pressurized and monitored penetrations, liner weld channels, and a seal water injection system that provides a highly reliable, essentially leak-tight barrier against the escape of radioactivity that might be released to the containment atmosphere. [IP2 UFSAR, Section 1.2.2.9; IP3 UFSAR, Section 1.2.2] The containment isolation control systems

for IP2 and IP3 automatically initiate closure of isolation valves to close off all potential leakage paths for radioactive material to the environs. Upon loss of power, the purge valves fail in the closed position [IP2 UFSAR Section 5.1.4.6; IP3 UFSAR, Section 5.1.4.6]. The containment for IP2 and IP3 is a reinforced concrete structure completely enclosing the reactor vessel.

3.2.2 Cooling and Auxiliary Water Systems

3.2.2.1 Circulating Water System

Hudson River water is used for the condenser circulating water for both IP2 and IP3. The circulating water systems for IP2 and IP3 include shoreline-situated intake structures consisting of seven bays (six for circulating water and one for service water) for each unit. River water flows under the floating debris skimmer wall into six separate screen wells. The water flows through Ristroph traveling screens where fish and debris are collected and returned to the river. Modified baskets employing bucket features collect and lift fish to be returned to the river. A representative scale illustration of the Ristroph screen structure for IP2 is provided in Figure 3-9. The Ristroph screens for IP3 are similar in design and construction. Additionally, the head section of the screen employs five (5) spray wash headers; three (3) low pressure fish sprays, and two (2) high pressure debris sprays for debris removal. Each screen well is provided with the ability to install stop logs to allow dewatering of any individual screen well for maintenance purposes. The water from each individual screenwell flows to a motor-driven, vertical, mixed flow condenser circulating water pump. [IP2 UFSAR, Section 10.2.4; IP3 UFSAR, Section 10.2.4]

For IP2, each of the six dual-speed condenser circulating water pumps provides 140,000 gpm and 21-ft total dynamic head when operating at 254 rpm and 84,000 gpm and 15-ft total dynamic head when operating at 187 rpm. Each pump is located in an individual pump well, thus tying a section of the condenser to an individual pump [IP2 UFSAR, Section 10.2.4]. For IP3, each of the six variable-speed condenser circulating water pumps provides 140,000 gpm at 29 ft total dynamic head when operating at 360 rpm [IP3 UFSAR, Section 10.2.4].

After moving through the condensers, cooling water from IP2 and IP3 flows downward from the discharge water boxes via six 96-inch diameter down pipes and exits beneath the water surface in a 40-foot wide discharge canal.

The discharge velocity in the canal is approximately 4.5 feet per second (fps) at full flow. Average transit time for cooling water ranges from 5.6 minutes (IP3) to 9.7 minutes (IP2). The cooling water from the canal is released into the Hudson River through an outfall structure located south of IP3, which was designed to enhance mixing of cooling water and river water to minimize thermal impact to the river at a discharge velocity of approximately 10 fps through 12 discharge ports across a length of 252 feet. [IP3 UFSAR, Section 9.6.1]

3.2.2.2 Intake Structures

The location and orientation of the Indian Point intake structures are illustrated in Figures 3-1 and 3-2.

3.2.2.2.1 IP2

The IP2 circulating water intake bays are each approximately 53 feet long and are independent of adjoining bays (see [Figure 3-3](#)). The bays are approximately 13.5 feet wide from the back wall to a point approximately 11 feet from the entrance; they then taper outward to a width of almost 15 feet at the entrance. The bottoms of the intakes are located at 27 feet below MSL ([Figure 3-4](#)). The equipment decks are at elevation 15 feet above MSL. An ice curtain wall that extends one foot below mean low water (mlw) is located at the entrance to each forebay and prevents floating debris as well as ice from entering the bay. At the time the Ristroph screens were installed, new coarse, bar screens were installed. A debris barrier wall that extends to a depth of four feet below MSL was attached to the face of the bar screen frame to reduce the potential for sticks and other large, floating debris to enter the intakes. [[CHGEC](#), Section IV.B.2.c]

IP2's two-speed circulating water pumps are designed to pump 140,000 gpm when operated at full speed and 84,000 gpm when operated at reduced speed (60% of full speed). When the pumps are operating at full flow, the intake water approach velocity is approximately one (1) fps; at reduced flow it is about 0.6 fps. [[CHGEC](#), Section IV.B.2.c]

The circulating water intake bays at IP2 have modified vertical Ristroph-type traveling water screens (see [Figures 3-3](#), [3-4](#), [3-5](#) and [3-9](#)). Design features incorporated into the machines were developed and tested in concert with the Hudson River Fishermen's Association [[CHGEC](#)]. Key fish-conserving components of the screens are screen basket lip troughs designed to retain water and minimize vortex stress, a high-pressure spray wash system for debris removal from the front side of the machine, a low-pressure spray wash system for fish removal from the rear side of the machine, and a fish sluice system for collection of the impinged fish for return to the river. The 0.25-by-0.5-inch clear opening slot mesh on the screen basket panels is smooth to minimize fish abrasion across the mesh into the collection sluice. The modified traveling screens consist of a series of panels attached to an endless chain designed to rotate continuously around an upper and lower sprocket shaft system. As baskets rotate out of the intake bay, impinged fish are retained in the water-filled rails and are carried over the headshaft, where they are washed out onto the mesh. A low-pressure wash system facilitates the transfer of fish to the fish collection sluice for return to the Hudson River. [[CHGEC](#), Section IV.B.2.c]

Fish are returned to the estuary through a 12-inch diameter pipe that extends 200 feet into the river on the north side of the IP2 intake structure. The pipe is partially buried in the river bottom, and discharges fish at a depth of 35 feet. The location of the discharge was selected after conducting dye and fish release studies to find a location that would minimize re-impingement. [[CHGEC](#), Section IV.B.2.c]

3.2.2.2.2 IP3

The IP3 intake consists of seven bays: six for circulating water and one for service water (see [Figure 3-5](#)). The bays do not extend out to the bar racks, but are served by a common plenum 12 feet wide and 120 feet long. Nine bar racks form its walls: seven for the west wall and one each for the north and south walls. Thus, the opening of each bay is located 12 feet behind the western bar racks. The circulating water bays are approximately 13.5 feet wide over their entire

length. The bottoms of the intakes are 27 feet below MSL (see [Figure 3-6](#)). The equipment deck and ice curtain wall are as described for IP2. At IP3, modified Ristroph screens are installed at the pump bay entrances from the common plenum. [[CHGEC](#), Section IV.B.2.c.ii]

IP3 has six variable-speed circulating water pumps. Flow rates generated by these pumps range from 140,000 gpm when operated at full speed to 64,000 gpm when operated at the lowest speed (46% of full speed). When the pumps are operating at full flow, the intake water approach velocity is approximately one (1) fps; at reduced flow it is about 0.6 fps. [[CHGEC](#), Section IV.B.2.c.ii]

The circulating water intake bays at IP3 are outfitted with modified vertical (Ristroph-type) traveling water screens. Design features incorporated into the machines were developed and tested in concert with the Hudson River Fishermen's Association [[CHGEC](#), Section IV.B.2.c.i]. Key components of these screens are identical to those installed at IP2. A fish return system discharges at the northwest corner of the station's cooling water discharge canal (See [Figure 3-9](#) for IP2 fish return system which is similar). [[CHGEC](#), Section IV.B.2.c.ii]

3.2.2.2.3 IP2 and IP3 Circulating System Operations

In accordance with the terms of an October 1997 Consent Order, Entergy uses its best reasonable efforts to operate IP2 and IP3's dual/variable speed pumps so as to keep the volume of river water drawn into the plants at the minimum required for efficient operation, with due regard to ambient river water temperature, plant operating status, and the need to meet water quality standards or other permit conditions.

3.2.2.2.4 Service Water

The primary function of the service water system is to provide river water as a cooling medium to those systems or components requiring heat removal for proper functioning during normal plant operation and abnormal plant conditions, such as the maximum credible accident condition. The secondary functions of the service water system are (1) to protect certain equipment from potential contamination from river water by providing cooling to intermediate freshwater systems as required, (2) to provide water for washing the traveling screens, and (3) to provide seal water for the main circulating water pumps [[CHGEC](#), Section IV.B.2.d].

IP2 is fitted with six identical vertical, centrifugal sump type pumps, each having a capacity of at least 5,000 gpm at 220-ft total design head (TDH) [[IP2 UFSAR](#), Section 9.6.1.2]. IP3 has six similar pumps located at its intake structure, each rated at 6,000 gpm and 195-ft TDH. In addition, there are three back-up service water pumps located on a platform over the discharge canal at IP3. [[IP3 UFSAR](#), Section 9.6.1]

Additional service water to the non-essential service water header for IP2 and spray wash water for the Ristroph screens at IP2 is provided through the IP1 river water intake structure. The IP1 intake ([Figure 3-2](#)) is outfitted with coarse bar screens at each of the four intake bays, which are arranged in two sets of two bays each. These were designed to provide two channels for screening water drawn in by each of the two circulating water pumps. A single 0.125-in. mesh-

outfitted dual-flow screen is located within the service water portion of each of the two intake bay sets. These dual-flow screens filter water drawn in by the single 16,000-gpm river water pump and the two 1500-gpm spray wash pumps in each of the two intake bay sets. The screens are washed automatically when head differentials exceed predetermined settings. Materials removed from the mesh are sluiced to the Hudson River. During normal operation only one of the two river water pumps and two of the spray wash pumps are in operation at any given time. [CHGEC, Section IV.B.2.d]

In IP2 and IP3, the service water intake bays (one service water bay per unit) are centrally located within each of the intake structures. Six service water pumps (5000 gpm/pump at IP2, and 6,000 gpm/pump at IP3) draw water from each of these bays for the operation of heat exchange equipment, such as turbine lubricating oil coolers and systems required for the safe shutdown of each unit. Two 6-ft-wide modified Ristroph screens have been installed within the service water bays at IP2 and IP3, as shown in Figures 3-3 and 3-5. The calculated average approach velocity at the entrance to the service water bays is about 0.2 fps when all six service water pumps are operating. [CHGEC, Section IV.B.2.d]

3.2.2.3 Discharge Structures

The cooling water from the condensers at IP2 and IP3 flows downward from the discharge water boxes via six 96-inch down pipes and exits beneath the surface of the water in the discharge canal (Figure 3-7). The discharge velocity in the 40-ft-wide discharge canal is approximately 4.5 fps at full flow. The average transit time for cooling water traveling from the IP2 intake to the outfall structure (Outfall 001) is 9.7 minutes; from IP3 it is 5.6 minutes. [CHGEC, Section IV.B.2.e]

The outfall or discharge structure for the IP2 and IP3 facility is designed to enhance mixing of cooling water and river water in such a way as to minimize thermal impact in the river. It can accommodate the combined cooling water flow from both IP2 and IP3 (about 1.75 million gpm, including service water). The cooling water from the discharge channel is released to the Hudson River via an outfall structure located south of IP3. The outfall structure, depicted schematically in Figure 3-8, consists of 12 submerged rectangular ports equipped with adjustable gates that are in line and parallel to the river axis. The ports, 4 feet high by 15 feet wide and spaced 21 feet apart (center to center), are submerged to a depth of 12 feet (center to surface) at mlw. The first upstream port is approximately 600 ft from the IP3 intake; the length of the total port section is approximately 252 feet. The discharge port gates can be adjusted mechanically to maintain a minimum hydraulic head differential of 1.75 feet across the outfall structure, which assures a discharge velocity of approximately 10 fps. [CHGEC, Section IV.B.2.e]

3.2.3 **Radioactive Waste Treatment Processes (Gaseous, Liquid, and Solid)**

The site uses liquid, gaseous, and solid waste processing systems to collect and treat, as needed, radioactive materials that are produced as a by-product of plant operations. Radioactive materials in liquid and gaseous effluents are reduced to levels as low as reasonably achievable. Radionuclides removed from the liquid and gaseous effluents are converted to a solid waste form for eventual disposal with other solid radioactive wastes in a licensed disposal facility.

The site waste processing systems meet the design objectives of 10 CFR Part 50, Appendix I, and control the processing, disposal, and release of radioactive liquid, gaseous, and solid wastes. Radioactive material in the reactor coolant is the source of most gaseous, liquid, and solid radioactive wastes in light water reactors. Radioactive fission products build up within the fuel as a consequence of the fission process. The fission products are contained within the sealed fuel rods; however, small quantities of radioactive materials may be transferred from the fuel elements to the reactor coolant under normal operating conditions. Neutron activation of materials in the primary coolant system also contributes to radionuclides in the coolant.

Radioactive fluids entering the Waste Disposal System (WDS) are collected in tanks until determination of subsequent treatment can be made. The fluids are sampled and analyzed to determine the quantity of radioactivity, with an isotopic breakdown, if necessary. Before any discharge, the fluids are processed as required and then released under controlled conditions. The system design and operation are characteristically directed toward minimizing releases to unrestricted areas. Discharge streams are appropriately monitored and safety features are incorporated to preclude excessive releases. Liquid wastes are processed to remove most of the radioactive materials prior to release. [IP2 UFSAR, Section 11.1.1, IP3 UFSAR, Section 11.1.1]

Radioactive gases are pumped by compressors through a manifold to one of the gas decay tanks where they are held a suitable period of time for decay. Cover gases in the nitrogen blanketing system are reused to minimize gaseous wastes. During normal operation, gases are discharged intermittently at a controlled rate from these tanks through the monitored plant vent. [IP2 UFSAR, Section 1.3.9]

Spent resins from the demineralizers and the filter cartridges are packaged and stored on-site until shipment off-site for disposal. All solid waste is placed in suitable containers and stored onsite until shipped off-site for disposal. [IP2 UFSAR, Section 11.1.1]

Reactor fuel assemblies that have exhausted a certain percentage of their fissile uranium content are referred to as spent fuel. Spent fuel assemblies are removed from the reactor core and replaced by fresh fuel during routine refueling outages, typically every 24 months. The spent fuel assemblies are then stored for a period of time in the spent fuel pool in the fuel storage building and may later be transferred to dry storage at an onsite interim spent fuel storage installation provided necessary regulatory approvals are obtained.

Storage of radioactive materials is regulated by the NRC under the Atomic Energy Act of 1954, and storage of hazardous wastes is regulated by the U.S. Environmental Protection Agency (EPA) under the Resource Conservation and Recovery Act of 1976.

As of 2006, site preparation work for a new Independent Spent Fuel Storage Installation (ISFSI) Facility had begun on the north end of the IPEC Site in an area which was previously undeveloped and outside the existing Protected Area. The ISFSI Facility will contain a 96' x 208' concrete storage pad, which will provide storage locations for 78 Holtec International HI-STORM 100S(B) Casks. The HI STORM Casks will be arranged in a 6 x 13 array with 75 storage locations allocated for the casks. The remaining three storage locations will remain empty.

3.2.3.1 Liquid Waste Processing Systems and Effluent Controls

3.2.3.1.1 IP2

During normal plant operation the WDS processes liquids from the following sources [IP2 UFSAR, Section 11.1.2.1.2].

- equipment drains
- chemical laboratory drains
- decontamination drains
- demineralizer regeneration
- floor drains/sumps
- steam generator blowdown
- excess CVCS effluent

The reactor coolant drain tank collects and transfers liquid drained from the following sources [IP2 UFSAR, Section 11.1.2.1.1].

- reactor coolant loops
- pressurizer relief tank
- reactor coolant pump secondary seals
- excess letdown during startup
- accumulator drains
- valve and reactor vessel flange leakoffs
- refueling canal drain
- containment spray header drain lines

The valve and reactor flange leakoff liquids flow to the reactor coolant drain tank and are discharged directly to the chemical and volume control system holdup tanks by the reactor coolant drain pumps, which are designed to operate automatically by a level controller in the tank. [IP2 UFSAR, Section 11.1.2.1.1]

Since the fluid pumped by the reactor coolant drain pumps is of high quality and can be reused, the discharge of these pumps will normally be routed to the holdup tanks of the chemical and volume control system. If the fluid is considered unsuitable for reuse, it will be sent to the waste holdup tank. The discharge of the reactor coolant drain pumps can also be routed to the refueling water storage tank. This path may be used when pumping down the containment refueling canal during return from refueling operations. In the event the reactor coolant drain pumps are unavailable, the contents of the reactor coolant drain tank or the pressurizer relief tank can be dumped to the containment sump. [IP2 UFSAR, Section 11.1.2.1.1]

The waste holdup tank serves as the collection point for liquid wastes. It collects fluid directly from the following sources [IP2 UFSAR, Section 11.1.2.1.1].

- reactor coolant drain tank pumps
- containment sump pumps

- holdup tank pit sump pump
- sump tank pump (from primary auxiliary building)
- spent regenerant chemicals from demineralizers
- equipment drains
- chemical drain tank pump
- relief valve discharge from the component cooling surge tank and the chemical and volume control system holdup tanks
- waste condensate pumps
- maintenance and operation building floor drains
- primary auxiliary building sump pumps

Where plant layout permits, waste liquids drain to the waste holdup tank by gravity flow. Other waste liquids, including floor drains, drain to the sump tank or to the primary auxiliary building sump. The liquid wastes are pumped to the waste holdup tank. The liquid waste holdup tank is processed by sending its contents to the IP1 waste collection system. [IP2 UFSAR, Section 11.1.2.1.1]

Capability exists to transfer the waste holdup tank contents to the waste condensate tank. If used, sampling indicates that the liquid is suitable for discharge and the waste liquid can be pumped from the waste holdup tank to the waste condensate tanks. There its activity can be determined for recording by isolation sampling and analyzing before it would be discharged through the radiation monitor to the condenser circulating water. [IP2 UFSAR, Section 11.1.2.1.1]

The IP1 waste collection system has four tanks with a capacity of 75,000 gallons each. From there the liquid can also be processed by use of sluiceable demineralizer vessels. [IP2 UFSAR, Section 11.1.2.1.1]

A portable demineralization system is being used in the IP1 Chemical System Building. The system employs a number of in-line ion exchanger resin beds and filters to remove radionuclides and chemicals as required from the waste stream. The demineralization/filtration system processes liquid waste from the IP1 waste collection tanks and discharges the clean water to the distillate storage tanks. [IP2 UFSAR, Section 11.1.2.1.1]

Spent resins from the portable system are sluiced from the vessels into a high integrity container, which is dewatered and then transported to the burial site without solidification. [IP2 UFSAR, Section 11.1.2.1.1]

Spent filters can also be placed in the high integrity container. The distillate produced by the demineralizer water processing is collected in two distillate storage tanks. Each storage tank is vented to the IP1 ventilation system. Normally one tank is filling while the other is sampled and discharged. When a distillate storage tank is ready for discharge, it is isolated and sampled to determine the allowable release rate. If the contents of the tank are not suitable for release, they are returned to waste collection tanks for reprocessing. If analysis confirms that the activity level is suitable for release, the distillate is discharged to the river. A radiation detector and high

radiation trip valve are provided in the release line to prevent an inadvertent release of activity at concentrations in excess of the setpoint derived from the technical specifications. In the event of primary-to secondary coolant leakage, the affected steam generator blowdown can be manually diverted to the support facilities secondary boiler blowdown purification system flash tank. [IP2 UFSAR, Section 11.1.2.1.1]

This system cools the blowdown and either stores it in the support facilities waste collection tanks or purifies it. The purification process consists of filtering and demineralizing the blowdown. The filters will remove undissolved material of 25 microns or greater. Mixed bed demineralizers, which utilize cation and anion resin, remove isotopic cations and anions, as well as nonradioactive chemical species. The effluents of the demineralizers are monitored and the specific activity is recorded. [IP2 UFSAR, Section 11.1.2.1.1] IP2's UFSAR Section 10.2.1 provides further discussion of the steam generator blowdown.

Also, in the event of primary-to-secondary leakage, potentially contaminated water that collects in secondary-side drains may be collected and routed to a collection point in the auxiliary boiler feedwater building for eventual processing. The path is an alternative to the normally used path to the drains collection tank. [IP2 UFSAR, Section 11.1.2.1.1]

3.2.3.1.2 IP3

The waste holdup system collects low-level, radioactive liquid waste from throughout the facility and holds the waste until such time that it can be processed. The system consists of three tanks: the 24,500 gallon waste holdup tank (No. 31), which is located in the waste holdup tank pit, and the two 62,000 gallon waste holdup tanks (Nos. 32 and 33), which are located in the liquid radwaste storage facility. Waste holdup tanks No. 32 and No. 33 are connected in parallel to tank No. 31 and are provided with a pumped recirculation/spraying system to minimize precipitation of particulates and the accumulation of crud. [IP3 UFSAR, Section 11.1.2.1]

The liquid radwaste storage facility, which houses waste holdup tanks No. 32 and No. 33, is an underground concrete structure 75' long x 39'-6" wide x 24'-7" high. The 62,000 gallon tanks are supported on concrete piers. A sump pit is located in one of the corners of the building. To service the water tanks, and to interconnect the building with the waste holdup tank pit, a system of platforms is provided. In addition, an opening of 2'-6" x 7'-6" through the waste holdup tank pit wall forms the entrance from the liquid radwaste storage facility to the waste holdup tank pit. An emergency exit is provided by two openings in the roof of the structure, which is protected by a concrete penthouse. The two buildings are separated by a minimum 3-inch joint filled with seismic filler. The seismic joint adequately insures that in a seismic event both structures will react independently. [IP3 UFSAR, Section 11.1.2.1]

The building is supported on hard rock. The foundation consists of a rigid 2-inch thick slab which is waterproofed. The waterproof membrane is laid upon a 4-inch concrete base. A 2-inch protection of concrete is placed over the waterproofing. The walls of the building, also waterproofed, consist of reinforced concrete. The 3-inch thick reinforced concrete roof was poured on a steel deck and beam system. [IP3 UFSAR, Section 11.1.2.1]

In the event that the holdup capacity of the liquid WDS is exceeded, water from the holdup tank can be pumped to a demineralization system. This system consists of a series of pressure vessels containing activated charcoal and anion, cation and macro-reticular resins, and a pump to deliver water to the monitor tanks of the chemical and volume control system. In addition, the waste holdup tank pits are provided with a submersible pump tied to the inlet to waste tank No. 31. [IP3 UFSAR, Section 11.1.2.1]

During normal plant operation the IP3 WDS processes liquids from the following sources [IP3 UFSAR, Section 11.1.2.1].

- equipment drains and leaks
- radioactive chemical laboratory drains
- decontamination drains
- demineralizer regeneration
- floor drains

The system also collects and transfers liquid drained from the following sources directly to the Chemical and Volume Control System (CVCS) for processing [IP3 UFSAR, Section 11.1.2.1].

- reactor coolant loops
- pressurizer relief tank
- reactor coolant pump secondary seals
- excess letdown during startup
- accumulators
- valve and reactor vessel flange leakoffs

The valve and reactor flange leakoff liquids flow to the reactor coolant drain tank (RCDT). The RCDT water can drain directly to the containment sump or can be discharged directly to the CVCS holdup tanks by the RCDT pumps. These pumps also return water from the refueling canal and cavity to the refueling water storage tank (RWST). To minimize contamination of the RWST, RCDT, and RCDT pumps resulting from refueling operations, a filter system has been provided for the refueling cavity return flow to the RWST. [IP3 UFSAR, Section 11.1.2.1]

Where plant layout permits, waste liquids drain to the waste holdup tanks by gravity flow. Other waste liquids, including floor drains, drain to the sump and/or sump tank and are discharged to the waste holdup tanks by pumps operated automatically by a level controller. [IP3 UFSAR, Section 11.1.2.1]

If the preliminary analysis by sampling indicates that the liquid is suitable for discharge, it can be pumped from the waste holdup tank to the monitor tanks of the CVCS. When one monitor tank is filled it is isolated, and the waste liquid is recirculated and sampled for radioactive and chemical analysis while the second tank is in service. If analysis confirms that the contents are suitable for discharge, the waste liquid contained in the monitor tank is pumped to the service water discharge; otherwise, it is returned to the waste holdup tanks for reprocessing. [IP3 UFSAR, Section 11.1.2.1]

Although the radiochemical analysis forms the basis for recording activity releases, the radiation monitor provides surveillance over the operation by preventing the discharge valve from opening if the liquid activity level exceeds that which can be safely discharged. [IP3 UFSAR, Section 11.1.2.1]

Liquids in the holdup tanks not suitable for discharge are processed through the liquid radwaste processing system skid. [IP3 UFSAR, Section 11.1.2.1]

3.2.3.1.3 IP2 and IP3 Liquid Effluent Releases

Sampling of the condenser inlet water and discharge water system is done continuously. Hudson River water samples are collected continuously from the intake structure (control location) and the discharge canal (indicator location), both of which are located on site. The sampling apparatus draws water from the intake structure and from the discharge canal and pumps it into respective containers. Each container has a volume which is approximately five gallons. One sample of inlet water and one sample of discharge water are taken, at a frequency specified by the Offsite Dose Calculation Manual (ODCM), from the containers. Each of these samples is approximately four liters (one gallon). These samples are composited for monthly gamma spectroscopy analysis (GSA) and for quarterly tritium analysis. [IP3 UFSAR, Section 11.1.2.1]

The liquid waste processing systems for IP2 were discussed in Section 3.2.3.1. Where IP2 plant layout permits, waste liquids drain to the waste holdup tank by gravity flow. Other IP2 waste liquids, including floor drains, drain to the IP2 sump tank or to the primary auxiliary building sump. The IP2 liquid wastes are pumped to the IP2 waste holdup tank. The liquid waste holdup tank is processed by sending its contents to the IP1 waste collection system. [IP2 UFSAR, Section 11.1.2.1]

The IP1 waste collection system has four tanks with a capacity of 75,000 gal each. From there the liquid can also be processed by use of sluiceable demineralizer vessels. A portable demineralization system is being used in the IP1 Chemical System Building. The system employs a number of in-line ion exchanger resin beds and filters to remove radionuclides and chemicals as required from the waste stream. The demineralization/filtration system processes liquid waste from the IP1 waste collection tanks and discharges the clean water to the distillate storage tanks. The distillate produced by the demineralizer water processing is collected in two distillate storage tanks. Each storage tank is vented to the IP1 ventilation system. Normally one tank is filling while the other is sampled and discharged. When a distillate storage tank is ready for discharge, it is isolated and sampled to determine the allowable release rate. If the contents of the tank are not suitable for release, they are returned to waste collection tanks for reprocessing. If analysis confirms that the activity level is suitable for release, the distillate is discharged to the river. [IP2 UFSAR, Section 11.1.2.1.1]

IP3 liquid waste processing systems were also discussed in Section 3.2.3.1. Where IP3 layout permits, waste liquids drain to the waste holdup tanks by gravity flow. Other waste liquids including floor drains drain to the sump and / or sump tank and are discharged to the waste holdup tanks by pumps operated automatically by a level controller. If the preliminary analysis by

sampling indicates that the liquid is suitable for discharge, it can be pumped from the waste holdup tank to the monitor tanks of the Chemical and Volume Control System. When one monitor tank is filled it is isolated, and the waste liquid is recirculated and sampled for radioactive and chemical analysis while the second tank is in service. If analysis confirms that the contents are suitable for discharge, the waste liquid contained in the monitor tank is pumped to the service water discharge; otherwise, it is returned to the waste holdup tanks for reprocessing. [IP3 UFSAR, Section 11.1.2.1].

Although the radiochemical analysis forms the basis for recording activity releases, the radiation monitor provides surveillance over the operation by preventing the discharge valve from opening if the liquid activity level exceeds that which can be safely discharged. Liquids in the holdup tanks not suitable for discharge are processed through the Liquid Radwaste Processing System skid. [IP3 UFSAR, Section 11.1.2.1]

Controls for limiting the release of radiological liquid effluents are described in the ODCM. Controls are based on (1) concentrations of radioactive materials in liquid effluents and projected dose or (2) dose commitment to a hypothetical member of the public. Concentrations of radioactive material that may be released in liquid effluents to unrestricted areas are limited to the concentration specified by 10 CFR Part 20 for radionuclides other than dissolved or entrained noble gases. The total concentration of dissolved or entrained noble gases in liquid releases is limited to 2×10^{-4} microcurie/ml [ENN 2007a, Section D 3.1.1; ENN 2007b, Section 2.3.1]. The ODCM dose limits during a calendar quarter are 0.015 mSv (1.5 mrem) to the total body and 0.05 mSv (5 mrem) to any organ [ENN 2007a, Section D 3.1.2; ENN 2007b, Section 2.3.2]. During the calendar year, the ODCM dose limits are 0.03 mSv (3 mrem) to the total body and 0.10 mSv (10 mrem) to any organ [ENN 2007a, Section D 3.1.2; ENN 2007b, Section 2.3.2]. Radioactive liquid wastes are subject to the sampling and analysis program described in the ODCM.

3.2.3.2 Gaseous Waste Processing Systems and Effluent Controls

3.2.3.2.1 IP2

During plant operations, gaseous waste will originate from the following sources [IP2 UFSAR, Section 11.1.2.1.2].

- degassing the reactor coolant and purging the volume control tank
- displacement of cover gases as liquid accumulates in various tanks
- equipment purging
- sampling operations and automatic gas analysis for hydrogen and oxygen in cover gases

During normal operation, the WDS supplies nitrogen and hydrogen to primary plant components. Two headers are provided, one for operation and one for backup. The pressure regulator in the operating header is set for 110 psig discharge and that in the backup header for 90 psig. When the operating header is exhausted, its discharge pressure will fall below 100 psig and an alarm will alert the operator. The second tank will come into service automatically at 90 psig to ensure a continuous supply of gas. After the exhausted header has been replaced, the operator

manually sets the operating pressure back to 110 psig and the backup pressure at 90 psig. This operation is identical for both the nitrogen supply and the hydrogen supply. [IP2 UFSAR, Section 11.1.2.1.2]

Most of the gas received by the WDS during normal operation is cover gas displaced from the chemical and volume control system holdup tanks as they fill with liquid. Since this gas must be replaced when the tanks are emptied during processing, facilities are provided to return gas from the decay tanks to the holdup tanks. A backup supply from the nitrogen header is provided for makeup if return flow from the gas decay tanks is not available. Since the hydrogen concentration may exceed the combustible limit during this type of operation, components discharging to the vent header system are restricted to those containing no air or aerated liquids, and the vent header itself is designed to operate at a slight positive pressure (0.5 psig minimum to 2.0 psig maximum) to prevent in-leakage. On the other hand, outleakage from the system is minimized by using Saunders patent diaphragm valves, bellows seals, self-contained pressure regulators, and soft-seated packless valves throughout the radioactive portions of the system. [IP2 UFSAR, Section 11.1.2.1.2]

Gases vented to the vent header flow to the waste gas compressor suction header. One of the two compressors is in continuous operation with the second unit instrumented to act as backup for peak load conditions. From the compressors, gas flows to one of the four large gas decay tanks. The control arrangement on the gas decay tank inlet header allows the operator to place one large tank in service and to select a second large tank for backup. When the tank in service becomes pressurized to a predetermined pressure, a pressure transmitter automatically opens the inlet valve to the backup tank, closes the inlet valve to the filled tank, and sounds an alarm to alert the operator of this event so that he may select a new backup tank. Pressure indicators are supplied to aid the operator in selecting the backup tank. Gas held in the decay tanks can either be returned to the chemical and volume control system holdup tanks, or discharged to the atmosphere if the activity concentration is suitable for release. Generally, the last tank to receive gas will be the first tank emptied back to the holdup tanks in order to permit the maximum decay time for the other tanks before releasing gas to the environment. However, the header arrangement at the tank inlet gives the operator freedom to fill, reuse, or discharge gas to the environment simultaneously without restriction by operation of the other tanks. [IP2 UFSAR, Section 11.1.2.1.2]

Six additional small gas decay tanks are supplied for use during degassing of the reactor coolant prior to a cold shutdown. The reactor coolant fission gas activity inventory is distributed equally among the six tanks through a common inlet header. A radiation monitor in the sample line to the gas analyzer checks the gas decay tank activity inventory each time a sample is taken for hydrogen-oxygen analysis. An alarm warns the operator when the inventory limit is approached so that another tank may be placed in service. [IP2 UFSAR, Section 11.1.2.1.2]

Before a tank can be emptied to the environment, its contents must be sampled and analyzed to verify sufficient decay and to provide a record of the activity to be released, and only then discharged to the plant vent at a controlled rate through a radiation monitor in the vent. Samples are taken manually by opening the isolation valve to the gas analyzer sample line and permitting

gas to flow to the gas analyzer where it can be collected in one of the sampling system gas sample vessels. After sampling, the isolation valve is closed. [IP2 UFSAR, Section 11.1.2.1.2]

During release, a trip valve in the discharge line is closed automatically by a high activity level indication in the plant vent. During operation, gas samples are drawn periodically from tanks discharging to the waste gas vent header, as well as from the particular large gas decay tank being filled at the time, and automatically analyzed to determine their hydrogen and oxygen content. The hydrogen analysis is for surveillance since the concentration range will vary considerably from tank to tank. There should be no significant oxygen content in any of the tanks, and an alarm will warn the operator if any sample shows 2% by volume of oxygen. This allows time to isolate the tank before the combustible limit is reached. Another tank is placed in service while the operator locates and eliminates the source of oxygen. Discharged gases are released from the plant vent and diluted in the atmosphere due to the turbulence in the wake of the containment building in addition to the effects of normal dispersion. [IP2 UFSAR, Section 11.1.2.1.2]

3.2.3.2.2 IP3

During plant operations, gaseous wastes originate from the following sources.

- degassing reactor coolant and purging the volume control tank
- displacement of cover gases as liquid accumulates in various tank
- equipment purging
- sampling operations and automatic gas analysis for hydrogen and oxygen in cover gases
- venting of actuating nitrogen for pressure control valves

During normal operation, the WDS supplies hydrogen from cylinders to primary plant components. Two headers are provided, one for operation, one for backup. The pressure regulator in the operating header is set for 100 psig and that in the backup header at 90 psig. When the operating header is exhausted, its discharge pressure will fall below 100 psig and an alarm will alert the operator. The second tank will come into service at 90 psig to ensure a continuous supply of gas. After the exhausted header has been replaced, the operator manually sets the operating pressure back to 100 psig and the backup pressure at 90 psig. [IP3 UFSAR, Section 11.1.2.1]

During normal operation, the WDS supplies primary plant components with nitrogen for various process functions. This system is identified as nitrogen to nuclear equipment (NNE). These process functions include cover gas, calibration gas, purge gas, and gas required for operation of level instrumentation. The only safety function of the NNE is providing high pressure charging gas for operation of the safety injection accumulators and power operated relief valves. [IP3 UFSAR, Section 11.1.2.1]

However, administrative controls and Technical Specifications ensure that these components maintain a minimum self-contained supply of gas at all times such that their accident mitigation functions can be implemented at any time without reliance on the main nitrogen supply system. The NNE also has the capability to cross-connect to the weld channel and containment

penetration pressurization system (WCCPPS) and the isolation valve seal water system (IVSWS) for the purpose of providing an alternative nitrogen supply to those systems when those systems' respective nitrogen supplies are depleted. Again, those activities are strictly controlled by administrative procedures. The NNE may be used in conjunction with the WCCPPS and/or IVSWS for post-accident recovery operations if available. The main nitrogen supply for the NNE is derived either from standard cylinders consisting of two banks of 18 cylinders each or from a nitrogen supply trailer via a truck fill connection. Either supply is directly through a common manifold and then either through a redundant backup regulator which reduces pressure for low-pressure gas services or through a redundant bypass for high pressure gas services. [IP3 UFSAR, Section 11.1.2.1]

The use of either supply source for nitrogen is acceptable and controlled by administrative procedures. When the nitrogen supply trailer is utilized, the isolation valves to the cylinders must be closed to ensure that the cylinders do not deplete with the trailer gas supply and thus be unavailable as a back-up gas source when the trailer supply expires. When the cylinders are in use, the nitrogen supply is divided into two independent headers/cylinder banks, one for operation and one for backup. The pressure regulator in the operating header is set for approximately 100 psig discharge and that in the backup at approximately 90 psig. [IP3 UFSAR, Section 11.1.2.1]

When the operating header is exhausted, the discharge pressure will fall below 100 psig and an alarm will alert the operator. The second header/cylinder bank will come into service automatically at approximately 90 psig to ensure a continuous supply of gas. After the exhausted cylinder bank has been replenished, the operator manually sets the operating pressure back to approximately 100 psig and the back up pressure at approximately 90 psig. This redundancy is not considered necessary for the trailer gas supply due to its much greater volume and ease of replacement. [IP3 UFSAR, Section 11.1.2.1]

Most of the gas received by the WDS during normal operation is cover gas displaced from the CVCS holdup tanks as they fill with liquid. Since this gas must be replaced when the tanks are emptied during processing, facilities are provided to return gas from the decay tanks to the holdup tanks. A backup supply from the nitrogen header is provided for makeup if return flow from the gas decay tanks is not available. Since the hydrogen concentration may exceed the combustible limit during this type of operation, components discharging to the vent header system are restricted to those containing no air or aerated liquids, and the vent header itself is designed to operate at a slight positive pressure (0.5 psig minimum to 4.0 psig maximum) to prevent in-leakage. On the other hand, out-leakage from the system is minimized by using diaphragm valves, bellows seals, self-contained pressure regulators and soft-seated packless valves throughout the radioactive portions of the system. [IP3 UFSAR, Section 11.1.2.1]

Gases vented to the vent header flow to the waste gas compressor suction header. To remove liquid waste buildup from the header, two valves permit draining into individual drain tanks. Any moisture present in the header will drain by gravity to these tanks. The drain valves on the tanks drain to the floor drain which directs the flow to the liquid WDS. One of the two compressors is in continuous operation with the second unit instrumented to act as backup for peak load

conditions. From the compressors, gas flows to one of the four large gas decay tanks. The control arrangement on the gas decay tank inlet header allows the operator to place one large tank in service and to select a second large tank for backup. When the tank in service becomes pressurized to 110 psig, a pressure transmitter automatically opens the inlet valve to the backup tank, closes the inlet valve to the filled tank, and sounds an alarm to alert the operator of this event so that he may select a new backup tank. Pressure indicators are supplied to aid the operator in selecting the backup tank. [IP3 UFSAR, Section 11.1.2.1]

Gas held in the decay tanks can either be returned to the CVCS holdup tanks, or discharged to the atmosphere if the activity concentration is suitable for release. Maximum decay time is allowed before releasing gas to the environment. However, the header arrangement at each tank inlet gives the operator freedom to fill, reuse or discharge gas to the environment without restricting operation of other tanks. [IP3 UFSAR, Section 11.1.2.1]

Six additional small gas decay tanks are supplied for use during degassing of the reactor coolant prior to a cold shutdown. The reactor coolant fission gas activity inventory is distributed equally among the six tanks through a common inlet header. With this arrangement, assuming one percent defective fuel rods, the activity inventory in any one tank will be less than 2.0×10^4 curies of equivalent Xe-133. [IP3 UFSAR, Section 11.1.2.1]

The total radioactivity content of any given gas decay tank is limited by the ODCM to 50,000 Ci (Xe-133 dose equivalent). This specification ensures that, following a postulated gas decay tank rupture, the radiation exposure at the site boundary would not exceed 500 mrem. To preclude exceeding the specification limit, the ODCM establishes a radioactivity concentration set point in the feed line to the waste gas compressors. A radiation monitor on the feed line monitors the concentration and would alarm if the ODCM set point is exceeded. This, in turn, would alert the operators for action to ensure that the total accumulated tank radioactivity does not exceed the specification limit. [IP3 UFSAR, Section 11.1.2.1]

Before a tank can be emptied to the environment, its contents must be sampled and analyzed to verify sufficient decay and to provide a record of the activity to be released, and only then discharged to the plant vent at a controlled rate through a radiation monitor in the vent. Samples are taken manually by opening the isolation valve to the gas analyzer sample line and permitting gas to flow to the gas analyzer where it can be collected in one of the sampling system gas sample vessels. After sampling, the isolation valve is closed. During release, a trip valve in the discharge line is closed automatically by a high activity level indication in the plant vent. [IP3 UFSAR, Section 11.1.2.1]

During operation, gas samples are drawn periodically from tanks discharging to the waste gas vent header, as well as from the particular large gas decay tank being filled at the time, and automatically analyzed to determine their hydrogen and oxygen content. The hydrogen analysis is for surveillance since the concentration range will vary considerably from tank to tank. There should be no significant oxygen content in any of the tanks, and an alarm will warn the operator if any sample shows 2% by volume of oxygen. This allows time to isolate the tank before the combustible limit is reached. Another tank is placed in service while the operator locates and

eliminates the source of oxygen. Discharged gases are released from the plant vent and diluted in the atmosphere due to the turbulence in the wake of the containment building in addition to the effects of normal dispersion. [IP3 UFSAR, Section 11.1.2.1]

When the reactor is in cold shutdown, the RCS (reactor coolant system) venting system discharges near the suction of the purge system. Vent connections are removed and the RCS venting points are capped off before the reactor is brought to hot shutdown. Liquid drains are routed to the liquid WDS. [IP3 UFSAR, Section 11.1.2.1]

A gas and particulate monitor is attached to the plant vent stack to analyze the amount of radiation contained in the gas effluent. [IP3 UFSAR, Section 11.1.2.1]

3.2.3.2.3 IP2 and IP3 Gaseous Effluent Releases

The site maintains gaseous releases within ODCM limits. The gaseous radwaste system is used to reduce radioactive materials in gaseous effluents before discharge to meet the dose design objectives in 10 CFR Part 50, Appendix I. In addition, the limits in the ODCM are designed to provide reasonable assurance that radioactive material discharged in gaseous effluents would not result in the exposure of a member of the public in an unrestricted area in excess of the limits specified in 10 CFR Part 20, Appendix B. The quantities of gaseous effluents released from the site are controlled by the administrative limits defined in the ODCM. The controls are specified for dose rate, dose due to noble gases, and dose due to radioiodine and radionuclides in particulate form. For noble gases, the dose rate limit at or beyond the site boundary is 5 mSv/yr (500 mrem/yr) to the total body, and 30 mSv/yr (3,000 mrem/yr) to the skin [ENN 2007a, Section D 3.2; ENN 2007b, Section 2.4.1]. For iodine and particulates with half-lives greater than 8 days, the limit is 15 mSv/yr (1,500 mrem/yr) to an organ [ENN 2007a, Section D 3.2.1; ENN 2007b, Section 2.4.1]. The limit for air dose due to noble gases released in gaseous effluents to areas at or beyond the site boundary during a calendar quarter is 0.05 milligray (5 mrad) for gamma radiation and 0.1 mGy (10 mrad) for beta radiation [ENN 2007a, Section D 3.2.2; ENN 2007b, Section 2.4.2]. For a calendar year, the limit is 0.1 mGy (10 mrad) for gamma radiation and 0.2 mGy (20 mrad) for beta radiation [ENN 2007a, Section D 3.2.2; ENN 2007b, Section 2.4.2]. The radioactive gaseous waste sampling and analysis program specifications provided in the ODCM address the gaseous release type, sampling frequency, minimum analysis frequency, type of activity analysis, and lower limit of detection.

3.2.3.3 Solid Waste Processing

Solid wastes consist of solidified waste liquid concentrates and sludges, spent resins and filters, and miscellaneous materials such as paper and glassware. Resin is normally stored in the spent resin storage tank for decay. Accumulated resin then moves from the storage to a high integrity container, which is dewatered and prepared for transportation in accordance with the process control program. Spent filters can be placed in the high integrity containers.

Miscellaneous solid waste such as paper, rags, and glassware are processed in accordance with the process control program. When possible, solid waste is sent to a licensed incineration and

volume reduction center, or to a material recovery center. This process is controlled by the process control program.

3.2.3.3.1 IP2 Facilities

The original steam generator storage facility (OSGSF) for IP2 is designed to contain contaminated materials and facilitate decontamination should such an action become necessary. Waterstops are used at all construction joints to prevent both the intrusion of water into the facility and the escape of contaminated water from the facility. The floor of the facility is sloped to provide adequate drainage to a sump. Protective coatings are applied to the floor slab and lower portion of the walls to ease decontamination, if required. A passive HEPA filter system is provided to allow venting of the OSGSF while containing any airborne contamination.

The OSGSF is a reinforced concrete structure measuring approximately 150 feet by 54 feet (not including the labyrinth entryways) and located on the eastern side of the plant, between Electrical Tower 3 and the Buchanan Service Center access road. This location is within the Owner Controlled Area outside the Protected Area.

This structure is constructed of cast-in-place concrete with a single-ply membrane roofing system. The walls of the OSGSF are 3'-0" thick and the roof tapers from 2'-6" in the center of the building to 2'-0" at the east and west walls. The slab is 3'-0" thick with a thickened perimeter that is 5'-0" thick. Personnel access doors with labyrinth entryways are provided at each end of the building to prevent radiation streaming through the door. The walls of the labyrinth entryway are 3'-0" thick with the roof over the labyrinth entryway tapered from 1'-2" to 1'-0". Two locked steel doors in each entryway provide access to the building after the pre-cast concrete blocks were put in place, one in the exterior wall opening and one in the labyrinth wall. Two locked steel doors secure the building and a security fence is installed around the perimeter of the facility. [IP2 UFSAR, Section 11.1.2.1.3]

IP1 contains radioactive waste processing facilities which provide waste processing services for both IP1 and IP2.

Sandblasters are available to remove fixed radioactivity from non-compressible items such as gas bottles, I-beams, angle irons, steel plates, and various tools and equipment. A very low volume of contaminated sand (grit) is being generated. This sand is used to fill voids in non-compactable waste containers. To further reduce solid waste volumes, a liquid abrasive bead decontamination unit, an ultrasonic unit, and a solvent degreaser unit were installed in 1985 to remove loose and fixed contamination from equipment. This equipment can then be reused in the controlled area or released for uncontrolled use. Also, offsite supercompaction and licensed incineration methods are available and used to reduce total burial volumes. [IP2 UFSAR, Section 11.1.3.3]

3.2.3.3.2 IP3 Facilities

Solid radioactive wastes in the form of dry activated waste (DAW) or solidified (or dewatered) resins may be stored in the IP3 interim radwaste storage facility prior to offsite shipment. The

facility is a non-safety, non-seismic concrete structure located west of the access road leading to the meteorological tower. Pursuant to Generic Letter 81-38, the facility was designed and constructed in accordance with Appendix A of NUREG-0800 to minimize impact of storage to the public and the environment. Adequate shielding is provided to limit the offsite doses to less than 5 mrem/year. In addition, the facility incorporates the ALARA methodology of Regulatory Guides 8.8 and 8.10. [IP3 UFSAR, Section 11.1.1]

The four steam generators originally installed in IP3 were replaced during the Cycle 6/7 refueling outage in 1989. These vessels (as well as one original primary system elbow which was also replaced) are internally contaminated and are currently stored on-site in the replaced steam generator storage facility. The above-ground reinforced concrete storage structure provides adequate shielding to limit offsite doses from direct radiation shine and "skyshine" to less than 5 mrem/year. Building contact dose rates are low enough to permit classification outside the building perimeter as an unrestricted area. The facility is classified as non-safety and non-seismic and is constructed of noncombustible materials. It is completely sealed with no provisions for ventilation; however, a locked locally alarmed labyrinth entrance is provided in order to permit periodic surveillance. The four original IP3 steam generators are stored completely intact, with all openings sealed with welded steel closure plates or bolted steel covers. The replaced primary elbow is also sealed at both ends with welded steel plates. On this basis, there will be no liquid or gaseous effluents released to the environment for the duration of storage of these components. The facility is designed to house the components until IP3 is decommissioned. [IP3 UFSAR, Section 11.1.1]

3.2.4 Transportation of Radioactive Materials

All solid waste is placed in suitable containers and stored on-site until shipped off-site for disposal. Monitoring and alarm instrumentation are provided for fuel and waste storage and handling areas to detect inadequate cooling and excessive radiation levels. Radiation monitors are provided to maintain surveillance over the release operation, but the permanent record of activity releases is provided by radiochemical analysis of known quantities of waste. [IP2 UFSAR, Section 11.2.1.2]

Site radioactive waste shipments are packaged in accordance with NRC and Department of Transportation (DOT) requirements. The type and quantities of solid radioactive waste generated at and shipped from the site vary from year to year, depending on plant activities. The site currently transports radioactive waste to the Studsvic facility in Irwin, Tennessee, the Race facility in Memphis, Tennessee, or the Duratek facility in Oak Ridge, Tennessee, where the wastes are further processed prior to being sent to the Barnwell facility in Barnwell County, South Carolina, or the Envirocare facility in Clive, Utah.

3.2.5 Nonradioactive Waste Systems

Nonradioactive waste is produced from plant maintenance, cleaning and operational processes. The majority of the wastes generated consists of nonhazardous waste oil and oily debris and result from operation and maintenance of oil-filled equipment. Universal wastes, such as spent fluorescent bulbs and batteries common to any industrial facility, comprise a majority of the

remaining waste volumes generated. Hazardous wastes routinely make up a small percentage of the total wastes generated, and include and consist of spent and off-specification (e.g., shelf-life expired) chemicals, laboratory chemical wastes, and occasional project specific wastes such as that generated as a result of repair work to a bulk acid storage tank.

Some amount of chemical and biocide wastes are produced from processes used to control the pH in the coolant, to control scale, to control corrosion, to regenerate resins, and to clean and defoul the condenser. These waste liquids are typically combined with cooling water discharges in accordance with the sites SPDES Permit NY-0004472.

Nonradioactive chemicals, paint, oil, fluorescent lamps, and other items that have either been used or exceeded their useful shelf-life are collected in central collection areas and managed in accordance with Entergy Nuclear fleet procedure EN-EV-106 (Waste Management Program). The materials are received in various forms and are packaged to meet all regulatory requirements prior to final disposition at an offsite facility licensed to receive and manage the material. Typical waste streams tracked by quantities at the facility, as shown in [Table 3-1](#), include waste oil, oily debris, glycol, lighting ballasts containing polychlorinated biphenyls, fluorescent lamps, batteries, and hazardous wastes (i.e., paints, lead abatement waste, broken lamps, off-specification and expired chemicals).

Programs that have been implemented at the facility to reduce waste generation are described in Entergy Nuclear's Waste Minimization Plan. This Plan, which also identifies waste streams (current and potential) generated at the facility, is used in conjunction with nuclear fleet procedures associated with waste minimization (EN-EV-104, Waste Minimization), waste management (EN-EV-106, Waste Management Program), chemical control (EN-EV-112, Chemical Control Program), and other site-specific procedures to minimize waste generation to the maximum extent practicable. [[Entergy 2004](#); [Entergy 2006a](#); [Entergy 2006b](#)]

Sanitary wastewater from all plant locations is transferred to the Village of Buchanan publicly owned treatment works (POTW) system where it is managed appropriately, except for a few isolated areas which have their own septic tanks which are pumped out by a septic company, as needed, and taken to an offsite facility for appropriate management. Although the sanitary wastewaters are nonradioactive, a radiation monitoring system is provided to continuously monitor the effluent from the protected area.

Nonradioactive gaseous effluents result primarily from testing of the emergency generators and boiler operations. Discharge of regulated pollutants is minimized by limiting fuel usage and hours

of operation in accordance with IP2 and IP3 air quality permits, 3-5522-00011/00026 and 3-5522-00105/00009, respectively.

**Table 3-1
 Nonradioactive Waste Generation (Typical)**

Waste Stream	2003	2004	2005	2006
Waste Oil	449,000	171,174	144,436	110,240
Oily Debris	18,900	13,600	11,000	11,200
Glycol	3,120	8,960	18,840	4,800
PCBs (Lighting Ballasts)	600	200	180	400
Universal Waste Lamps	6,390	5,602	7,001	8,671
Universal Waste Batteries	39,697	14,716	3,335	11,870
IP2 Hazardous Waste	1,283	1,040	778	10,722 ¹
IP3 Hazardous Waste	1,787	323	13,072 ²	84

1. Increased generation due to dispositions of expired and off-specification chemicals.
2. Increased generation affected by disposition of sulfuric acid sludge and off-specification sulfuric acid from a tank undergoing repairs.

3.2.6 Maintenance, Inspection and Refueling Activities

Various programs and activities currently at the site maintain, inspect, test, and monitor the performance of plant equipment. These programs and activities include, but are not limited to, those implemented to

- meet the requirements of 10 CFR Part 50, Appendix B (Quality Assurance), Appendix R (Fire Protection), Appendices G and H, Reactor Vessel Materials;
- meet the requirements of 10 CFR 50.55a, American Society of Mechanical Engineers, Boiler and Pressure Vessel Code, Section XI, In-service Inspection and Testing Requirements;
- meet the requirements of 10 CFR 50.65, the maintenance rule, and
- maintain water chemistry in accordance with EPRI guidelines.

Additional programs include those implemented to meet Technical Specification surveillance requirements, those implemented in response to NRC generic communications, and various periodic maintenance, testing, and inspection procedures necessary to manage the effects of aging on structures and components. Certain program activities are performed during the operation of the units, while others are performed during scheduled refueling outages.

3.2.7 Power Transmission Systems

The Consolidated Edison Company (ConEdison) transmission system provides two basic functions for the site: 1) it provides auxiliary power as needed for startup and normal shutdown and 2) it transmits the output power generated by IP2 and IP3. Each unit has two main transformers that increase turbine generator output from 22-kV to 345-kV. Power is delivered to the ConEdison transmission grid via two double-circuit 345-kV lines that connect the IP2 and IP3 main transformers to the Buchanan substation located across Broadway near the main entrance to the Indian Point facility. The IP2 line is referred to as feeder W95 and the IP3 line as feeder W96. Except for the point where they cross over Broadway, the lines are located within the site boundary, are approximately 2,000 feet in length, and were constructed using tubular-steel transmission poles. In addition to the two double-circuit 345-KV lines, the poles also carry 138-kV transmission lines that supply offsite power from the Buchanan substation into IP2 and IP3 (NRC, page IV-3). These lines are referred to as 95332 and 95331, respectively. The poles also carried the 138-kV output (line 95191) from IP1 before the line was retired in 1973.

The Buchanan Substation has two ring buses designated as North and South. The South ring bus distributes IP3 345-kV output to three 345-kV transmission lines. The Millwood East (W97) and Millwood West (W98) lines both interconnect to the Millwood Substation with ties to Pleasant Valley Substation, which is the interconnection point between ConEdison and Niagara Mohawk and Connecticut Light and Power System. The third line (Y88) crosses the Hudson River to the Ladentown Substation where it interconnects with the Pennsylvania-New Jersey-Maryland (PJM)

system. The North ring bus at the Buchanan substation distributes output from IP2 to 345-kV lines that connect to the Ramapo Substation (W94) and Eastview Substation (W93). The North ring bus also supplies power through a step-down transformer to the Buchanan 138-kV system (IP3 UFSAR, Section 8.2.1; IP2 UFSAR, Sections 8.1.2 and 8.2.1).

When IP2 and IP3 (and IP1) were constructed, power was transmitted beyond the Buchanan substation on existing transmission facilities (NRC, page III-3). However, the addition of transmission line segments beyond the Buchanan substation was briefly addressed in the FESs for both units (USAEC, page III-3; NRC, page IV-3). The IP2 FES noted the addition of two new lines within an existing 9.5-mile long right-of-way between the Buchanan and the Millwood substations. The voltage and purpose of the two additional lines were not addressed. Nevertheless, the AEC staff concluded that because these lines were added to existing structures within an existing right-of-way no adverse environmental impact would occur. The IP3 FES stated that power would be transmitted beyond Buchanan on existing transmission facilities, and the staff concluded that no additional impact would occur as a result of IP3 because these transmission lines had existed for several decades.

ConEdison serves electric customers throughout the five boroughs of New York City; Westchester, Orange, and Rockland Counties; and parts of New Jersey and Pennsylvania. ConEdison has bulk-power transmission interconnections with other electric power companies in the New York Power Pool and the PJM system. During the period when IP2 and IP3 were constructed, ConEdison was actively adding new generating sources and expanding the regional transmission network to provide more electric power to the metropolitan New York area. Several new transmission lines were added and the voltage of some existing lines was increased. Both the Buchanan substation and the interconnecting 138-kV and 345-kV transmission lines are part of a regional system that was planned, designed, and constructed independent of their connections with IP2 and IP3 (Con Edison). Con Edison has concluded that other than lines W95 and W96 that connect IP2 and IP3 to the Buchanan substation, no other transmission systems were specifically constructed to connect these units to the transmission grid.

3.3 Refurbishment Activities

10 CFR 51.53(c)(2) requires that a license renewal applicant's environmental report contain a description of the proposed action, including the applicant's plans to modify the facility or its administrative control procedures as described in accordance with Section 54.21 of this chapter. This report must describe in detail the modifications directly affecting the environment or affecting plant effluents that affect the environment.

The objective of the review required by 10 CFR 54.21 is to determine whether the detrimental effects of aging could preclude certain systems, structures, and components from performing in accordance with the current licensing basis, during the additional 20 years of operation requested in the license renewal application.

The evaluation of structures and components as required by 10 CFR 54.21 has been completed and is described in the body of the IP2 and IP3 License Renewal Application. This evaluation did not identify the need for refurbishment of structures or components for purposes of license

renewal and there are no such refurbishment activities planned at this time. Although routine plant operational and maintenance activities will be performed during the license renewal period, these activities are not refurbishments as described in Sections 2.4 and 3.1 of the GEIS and will be managed in accordance with appropriate Entergy programs and procedures.

3.4 Programs and Activities for Managing the Effects of Aging

The programs for managing the effects of aging structures and components at the site are described in the body of the license renewal application (see Appendix B of the IP2 and IP3 License Renewal Application). The evaluation of structures and components required by 10 CFR 54.21 identified some new activities necessary to continue operation of the site during the additional 20 years beyond the initial license term. These activities are described in the body of the license renewal application. The additional inspection activities are consistent with normal plant component inspections and therefore are not expected to cause significant environmental impact. The majority of the aging management programs are existing programs, some requiring modest modifications.

3.5 Employment

The non-outage work force at the site consists of approximately 1,255 persons (as of June 2006) (see [Table 3-2](#)). During refueling outages there are typically an additional 950 contractor employees on site. Refueling outages occur every 24 months for each unit, which results in an outage each year for one unit or the other. Entergy has no plans to add non-outage employees to support plant operations during the extended license period.

Refueling and maintenance outages typically last approximately 30 days. The number of workers required on-site for normal plant outages during the period of extended operation is expected to be consistent with the number of additional workers used for past outages at the site, which is approximately 950 temporary workers.

**Table 3-2
Employee Residence Information (June 2006)**

County, State, and City	Employees (Entergy and Baseline Contractors)
Bronx County (New York)	9
Bronx	9
Columbia County (New York)	4
Copake	1
Copake Falls	1
Elizaville	1
Kinderhook	1

Table 3-2 (Continued)
Employee Residence Information (June 2006)

County, State, and City	Employees (Entergy and Baseline Contractors)
Dutchess County (New York)	528
Beacon	58
Chelsea	2
Dover Plains	2
Fishkill	63
Glenham	2
Holmes	1
Hopewell Junction	86
Hughsonville	1
Hyde Park	7
La Grangeville	16
Millbrook	2
New Hamburg	1
Pawling	1
Pine Plains	2
Pleasant Valley	6
Poughkeepsie	92
Poughquag	16
Red Hook	2
Rhinebeck	1
Salt Point	3
Slate Hill	2
Staatsburg	3
Stormville	12
Tivoli	2
Verbank	1

Table 3-2 (Continued)
Employee Residence Information (June 2006)

County, State, and City	Employees (Entergy and Baseline Contractors)
Wappinger Falls	142
Wingdale	2
Greene County (New York)	1
Catskill	1
Kings County (New York)	6
Brooklyn	6
Monroe County (New York)	1
Rochester	1
Nassau County (New York)	12
Baldwin	1
Bethpage	1
Garden City	1
Greenvale	1
Hicksville	1
Jericho	1
Lynbrook	1
Massapequa	2
New Hyde Park	2
Port Washington	1
New York County (New York)	3
New York	3
Orange County (New York)	243
Circleville	2
Cornwall	14
Cornwall on Hudson	4
Ft Montgomery	1

Table 3-2 (Continued)
Employee Residence Information (June 2006)

County, State, and City	Employees (Entergy and Baseline Contractors)
Goshen	5
Hamptonburgh	1
Harriman	3
Highland	18
Highland Falls	7
Highland Mills	3
Maybrook	3
Middletown	23
Monroe	12
Montgomery	13
Mountainville	1
New Hampton	2
New Windsor	17
Newburgh	42
Otisville	1
Pine Bush	7
Port Jervis	3
Rock Tavern	1
Salisbury Mills	2
Sparrowbush	1
Thompson Ridge	2
Unionville	2
Walden	20
Walkill	19
Warwick	5
Washingtonville	9

Table 3-2 (Continued)
Employee Residence Information (June 2006)

County, State, and City	Employees (Entergy and Baseline Contractors)
Putnam County (New York)	78
Brewster	5
Carmel	13
Cold Spring	11
Garrison	9
Kent Lakes	1
Lake Peekskill	5
Mahopac	15
Nelsonville	1
Patterson	4
Putnam Valley	14
Queens County (New York)	13
Bayside	1
Bellerose	1
Flushing	1
Fresh Meadows	1
Jamaica	1
Kew Gardens	2
Queens Village	1
Richmond Hill	1
South Ozone Park	1
Springfield Gardens	1
Sunnyside	1
Whitestone	1
Rockland County (New York)	28
Garnerville	1

Table 3-2 (Continued)
Employee Residence Information (June 2006)

County, State, and City	Employees (Entergy and Baseline Contractors)
Montebello	1
Nanuet	1
New City	8
New Hempstead	1
Nyack	2
Palisades	1
Pearl River	2
Spring Valley	1
Stoney Point	5
Suffern	1
Thiells	1
West Haverstraw	2
West Nyack	1
Saratoga County (New York)	1
Saratoga Springs	1
Schenectady County (New York)	1
Schenectady	1
Steuben County (New York)	7
Campbell Hall	5
Greenwood Lake	2
Suffolk County (New York)	3
Bayshore	1
Hauppauge	1
Nesconset	1
Sullivan County (New York)	15
Bloomingburg	3

Table 3-2 (Continued)
Employee Residence Information (June 2006)

County, State, and City	Employees (Entergy and Baseline Contractors)
Grahamsville	2
Liberty	1
Monticello	1
Mountaindale	1
Roscoe	1
Summitville	1
Tomkins Cove	2
Wurtsboro	3
Ulster County (New York)	31
Accord	2
Clintondale	4
Gardiner	3
Kerhonkson	1
Kingston	2
Marlboro	5
Milton	5
New Paltz	4
Port Ewen	1
Saugerties	2
Spring Glen	1
West Hurley	1
Westchester County (New York)	206
Baldwin Place	4
Briarcliff Manor	3
Bronxville	1
Buchanan	20

Table 3-2 (Continued)
Employee Residence Information (June 2006)

County, State, and City	Employees (Entergy and Baseline Contractors)
Chester	2
Cortlandt Manor	28
Crompond	2
Croton on Hudson	7
Crugers	1
Dobbs Ferry	2
Eastchester	1
Elmsford	1
Goldens Bridge	1
Millwood	1
Mohegan Lake	3
Montrose	6
Mount Vernon	1
New Rochelle	3
Ossining	9
Peekskill	48
Pelham	1
Pleasantville	1
Port Chester	1
Scarsdale	3
Shrub Oak	4
Sleepy Hollow	1
Somers	3
Tarrytown	1
Valhalla	1
Verplanck	17

Table 3-2 (Continued)
Employee Residence Information (June 2006)

County, State, and City	Employees (Entergy and Baseline Contractors)
White Plains	7
Yonkers	9
Yorktown	2
Yorktown Heights	11
Cobb County (Georgia)	1
Marrietta	1
Fulton County (Georgia)	1
Atlanta	1
Fairfield County (Connecticut)	11
Bethel	1
Danbury	4
Greenwich	2
Newtown	1
Norwalk	1
Ridgefield	1
Stanford	1
Hartfield County (Connecticut)	1
Windsor Locks	1
Litchfield County (Connecticut)	1
New Milford	1
New Haven County (Connecticut)	1
Southbury	1
New London County (Connecticut)	2
Waterford	2
New Castle County (Delaware)	1
New Castle	1

Table 3-2 (Continued)
Employee Residence Information (June 2006)

County, State, and City	Employees (Entergy and Baseline Contractors)
Martin County (Florida)	1
Stuart	1
Montgomery County (Maryland)	1
Silver Spring	1
Cheshire County (New Hampshire)	1
Hinsdale	1
Bergen County (New Jersey)	17
Allendale	1
Fort Lee	1
Franklin Lakes	1
Hasbrouck Heights	1
Haworth	1
Ho Ho Kus	1
Lodi	1
Mahwah	2
New Milford	1
North Vale	1
Paramus	1
Park Ridge	1
Teaneck	1
Waldwick	1
Westwood	1
Wyckoff	1
Essex County (New Jersey)	3
Cedar Grove	1
Newark	1

Table 3-2 (Continued)
Employee Residence Information (June 2006)

County, State, and City	Employees (Entergy and Baseline Contractors)
Upper Montclair	1
Gloucester County (New Jersey)	1
Mantua	1
Hunterdon County (New Jersey)	1
Califon	1
Middlesex County (New Jersey)	3
East Brunswick	1
Edison	2
Morris County (New Jersey)	3
Flanders	1
Lincoln Park	2
Ocean County (New Jersey)	2
Forked River	1
Lavallette	1
Passaic County (New Jersey)	4
Clifton	2
Ringwood	1
Wayne	1
Sussex County (New Jersey)	1
Montague	1
Luzerne County (Pennsylvania)	1
Drums	1
Pike County (Pennsylvania)	2
Milford	2
Wayne County (Pennsylvania)	4
Honesdale	2

Table 3-2 (Continued)
Employee Residence Information (June 2006)

County, State, and City	Employees (Entergy and Baseline Contractors)
Lords Valley	2
Harris County (Texas)	1
Houston	1
TOTAL	1255

3.6 References

- CHGEC (Central Hudson Gas and Electric Corporation) Consolidated Edison Company of New York, Inc., New York Power Authority, and Southern Energy New York, Draft Environmental Impact Statement for State Pollutant Discharge Elimination System Permits for Bowline Point, Indian Point 2 and 3, and Roseton Steam Electric Generating Stations, 1999.
- Con Edison. 2007. Letter dated January 19, 2007 from J. McAvoy (Vice President, Con Edison) to F. Dacimo (Vice President, Entergy Nuclear Operations).
- ENN (Entergy Nuclear Northeast). 2007a. Indian Point Units 1, 2, Offsite Dose Calculation Manual (ODCM), Rev. 10, January 2007.
- ENN (Entergy Nuclear Northeast). 2007b. Indian Point Energy Center, Indian Point 3 Offsite Dose Calculation Manual (ODCM), Revision 18, January 2007.
- Entergy. 2004. EN-EV-104, Waste Minimization.
- Entergy. 2006a. EN-EV-106, Waste Management Program. August 7, 2006.
- Entergy. 2006b. EN-EV-112, Chemical Control Program. November 13, 2006.
- IP2 UFSAR. Indian Point Energy Center, Indian Point 2, Updated Final Safety Analysis Report.
- IP3 UFSAR. Indian Point Energy Center, Indian Point 3, Updated Final Safety Analysis Report
- NRC (U.S. Nuclear Regulatory Commission). 1975. Final Environmental Statement Related to the Operation of Indian Point Unit No. 3, Docket No. 50-286, U.S. Nuclear Regulatory Commission, Office of Nuclear Reactor Regulation.
- PowerGEM (Power Grid Engineering & Markets). 2004. System Reliability Impact Study: Extended Power Uprate of Indian Point Units 2 and 3.
- USAEC (U.S. Atomic Energy Commission). 1972. Final Environmental Statement Related to the Operation of Indian Point Unit No. 2, Docket No. 50-247, United States Atomic Energy Commission, Directorate of Licensing.

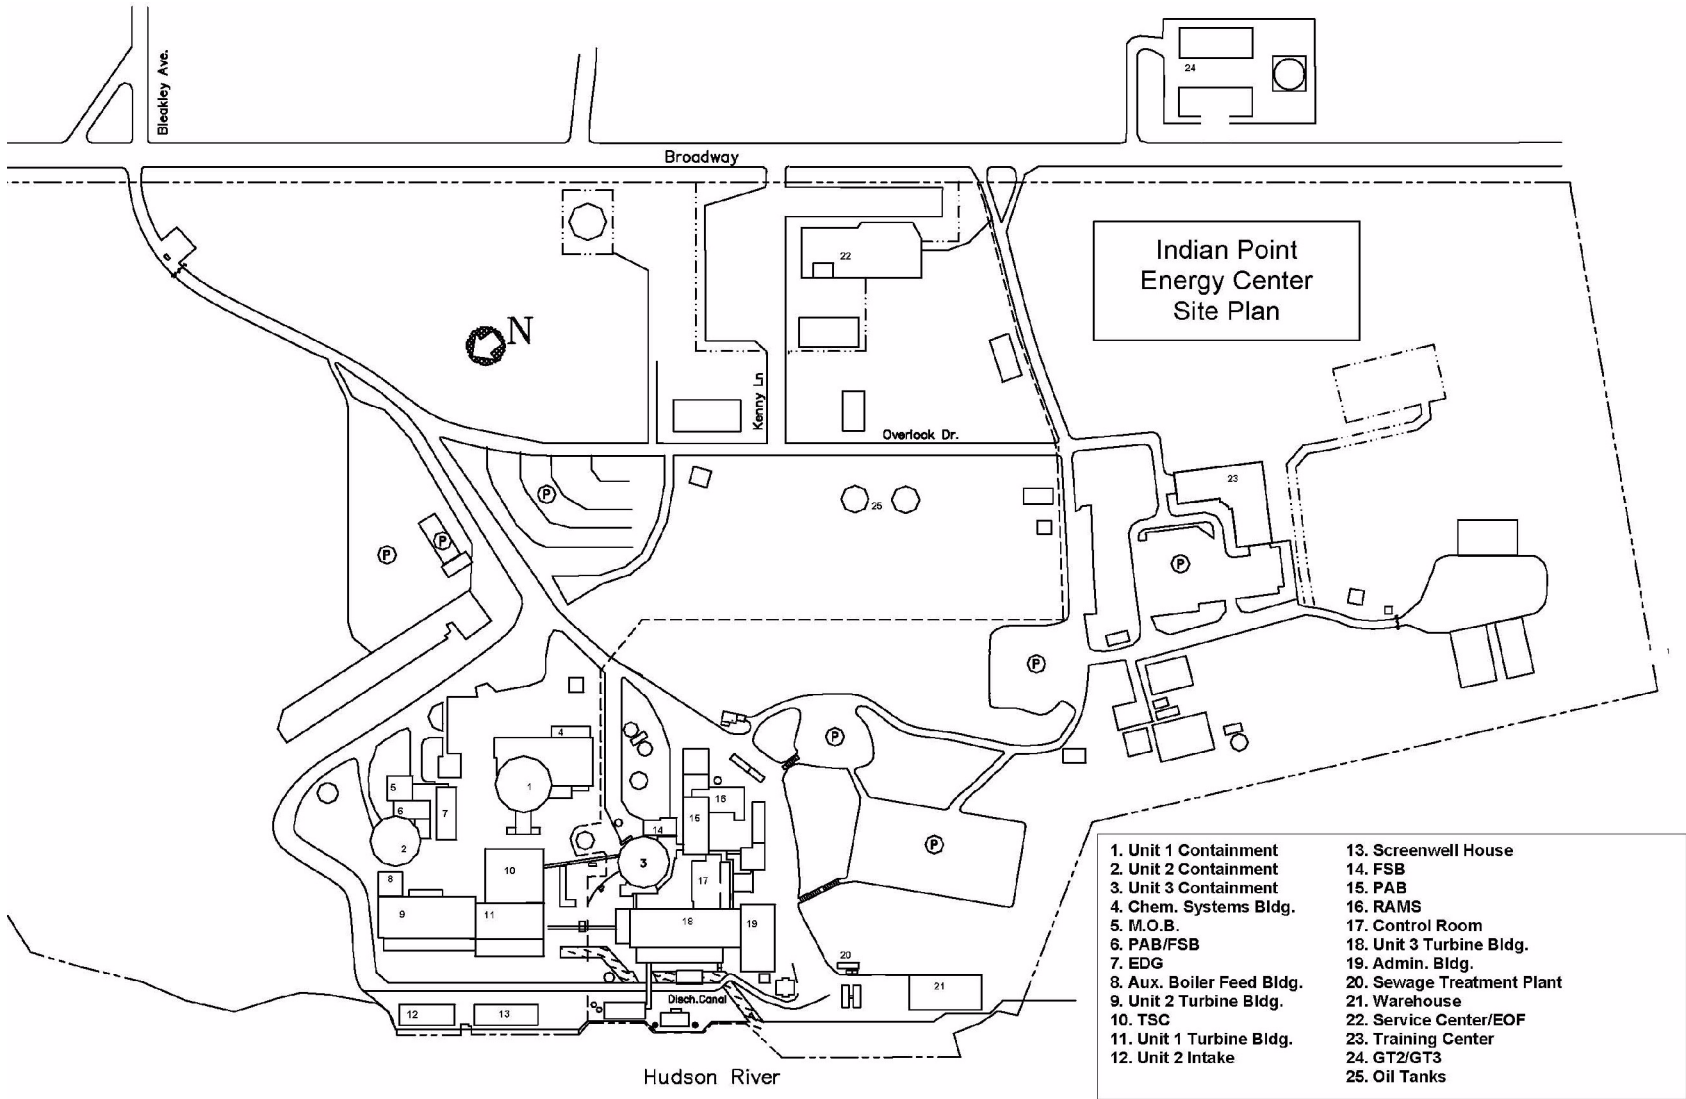


Figure 3-1
Indian Point Facility


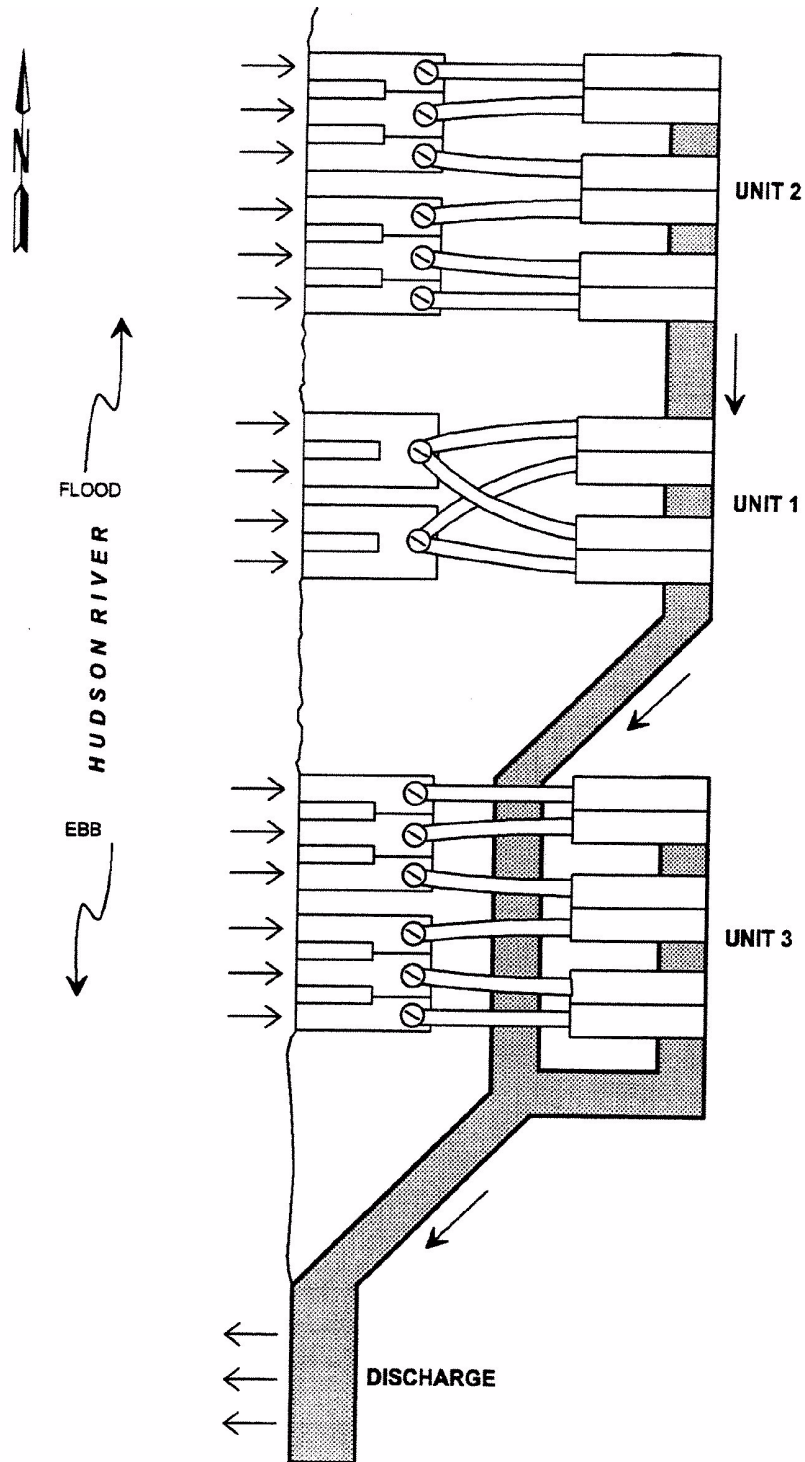


Figure 3-2
Indian Point Intake Structures

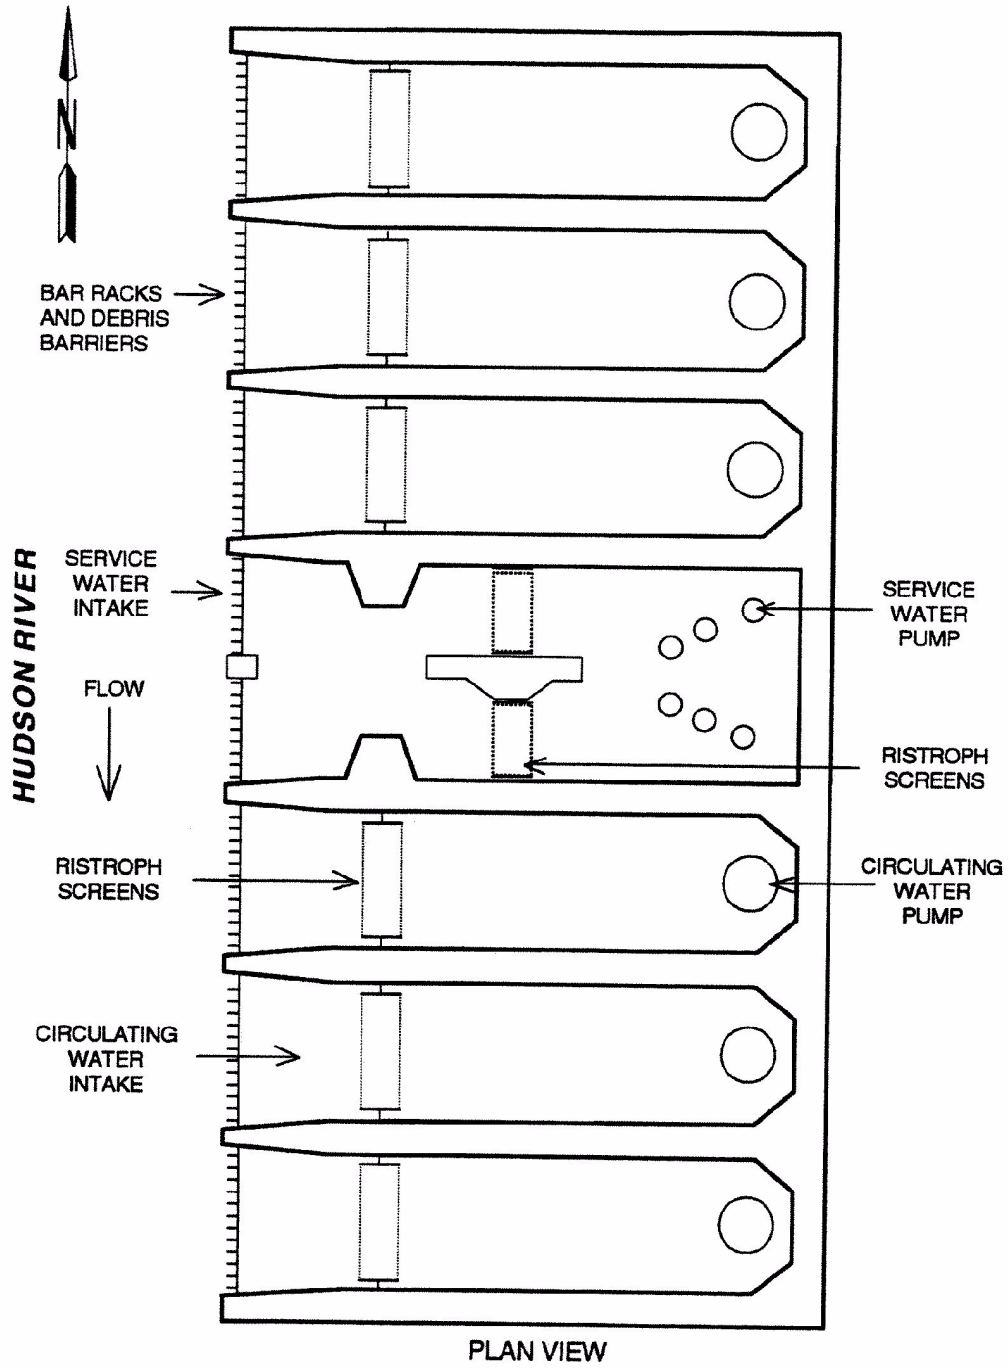

Source: CHGEC Section IV.B

Figure 3-3
IP2 Cooling Water System


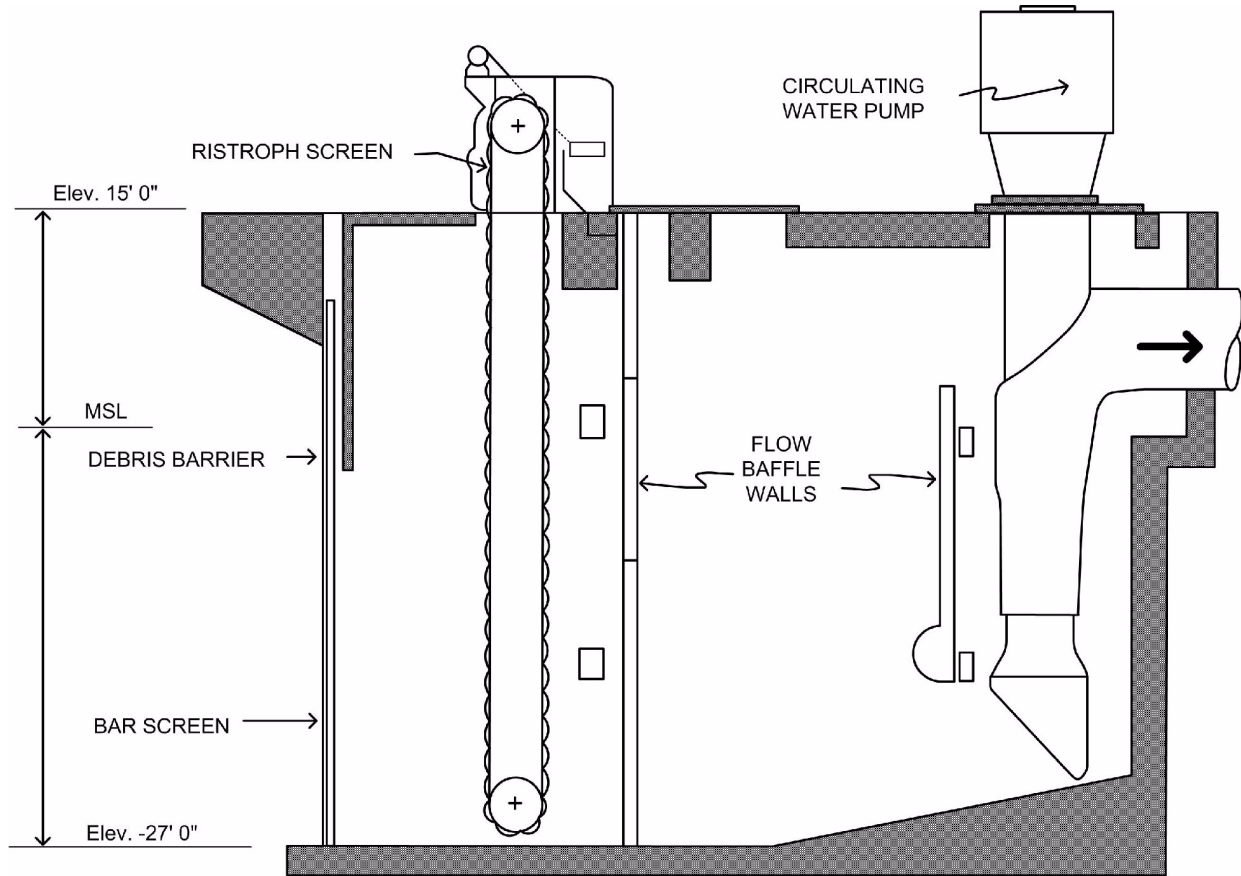


Figure 3-4
IP2 Intake System

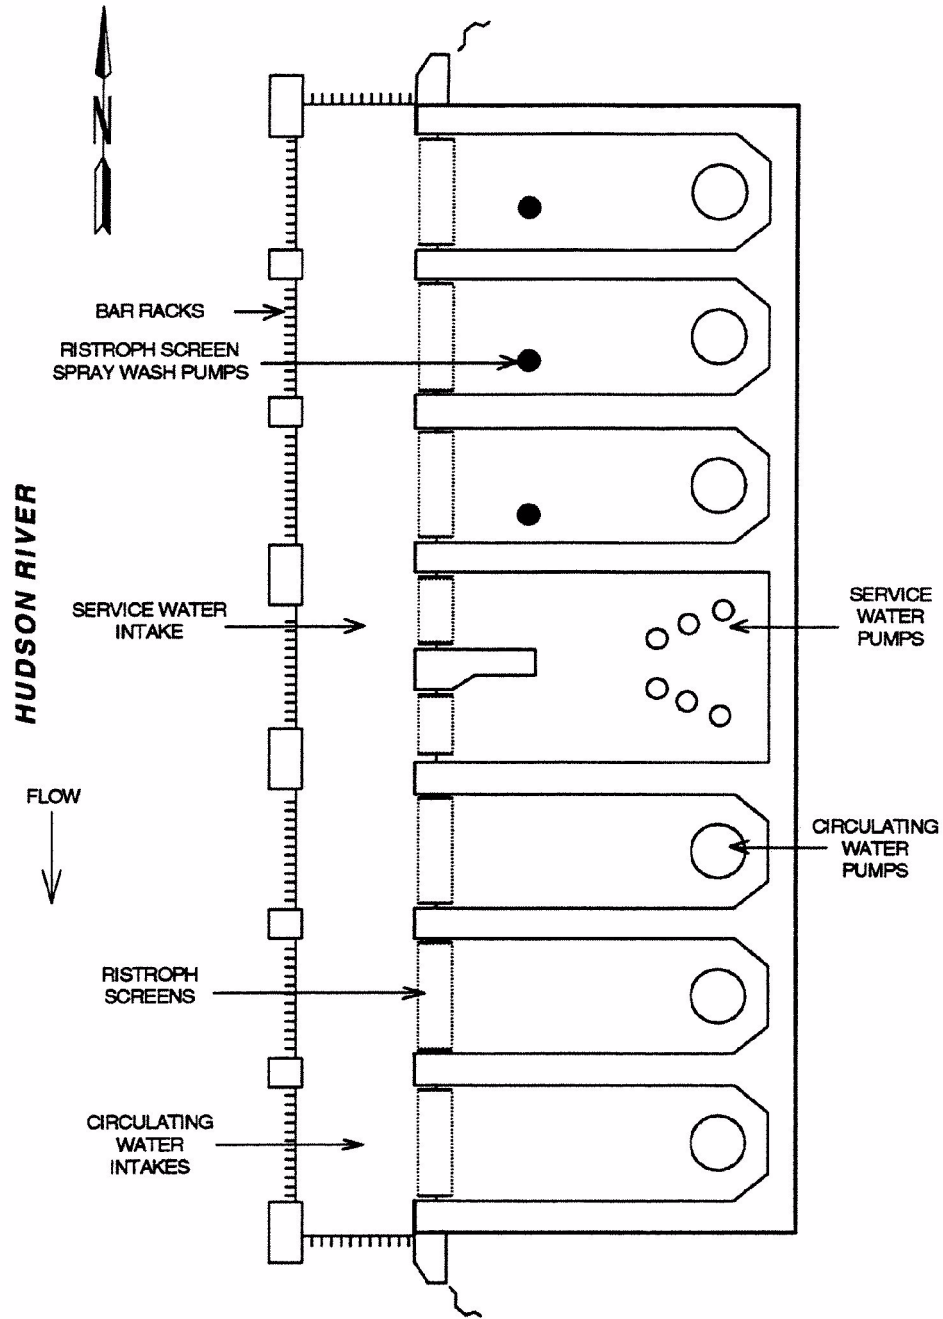

Source: CHGEC Section IV.B

Figure 3-5
IP3 Cooling Water System

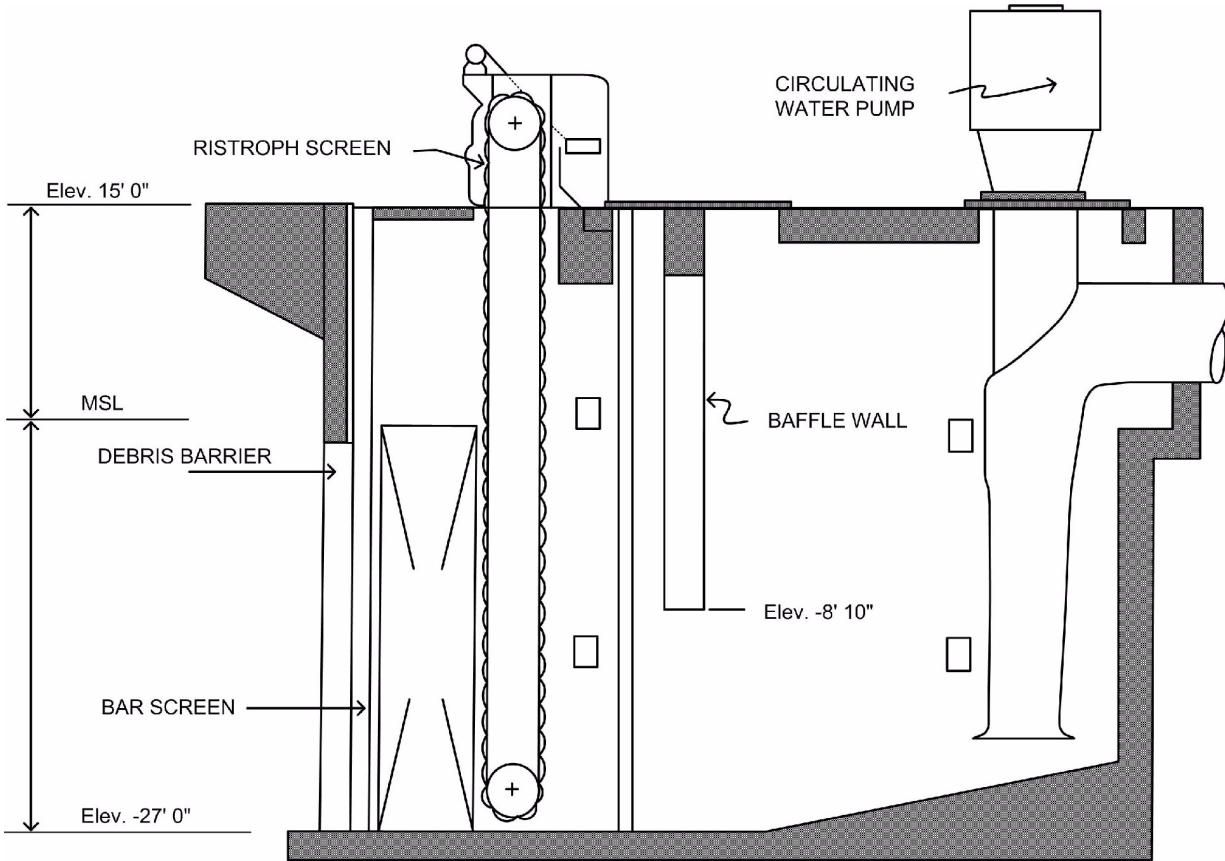


Figure 3-6
IP3 Intake System



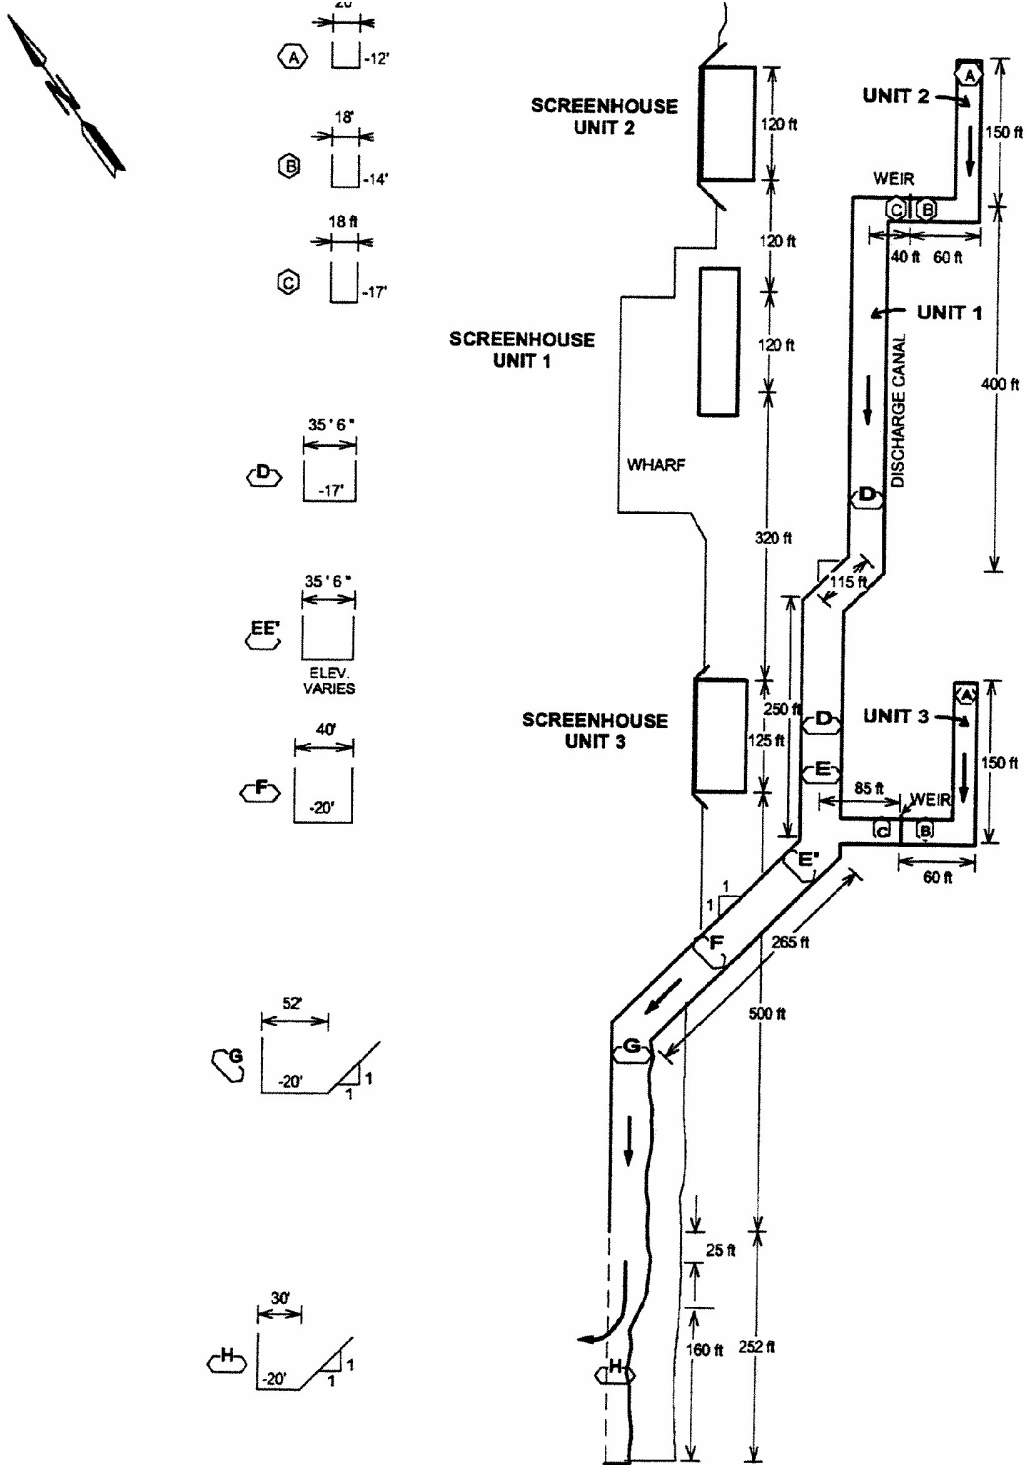


Figure 3-7
 Indian Point Discharge Canal System

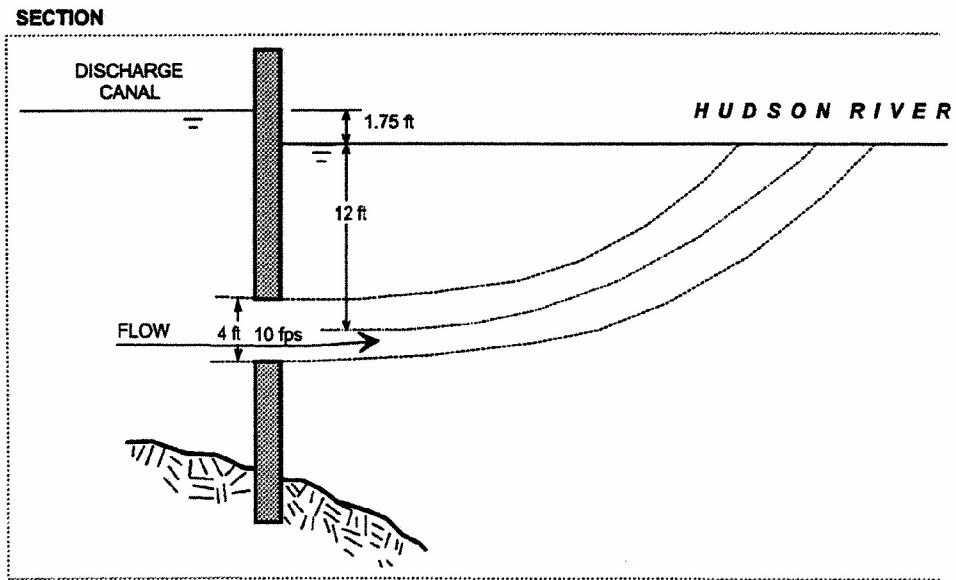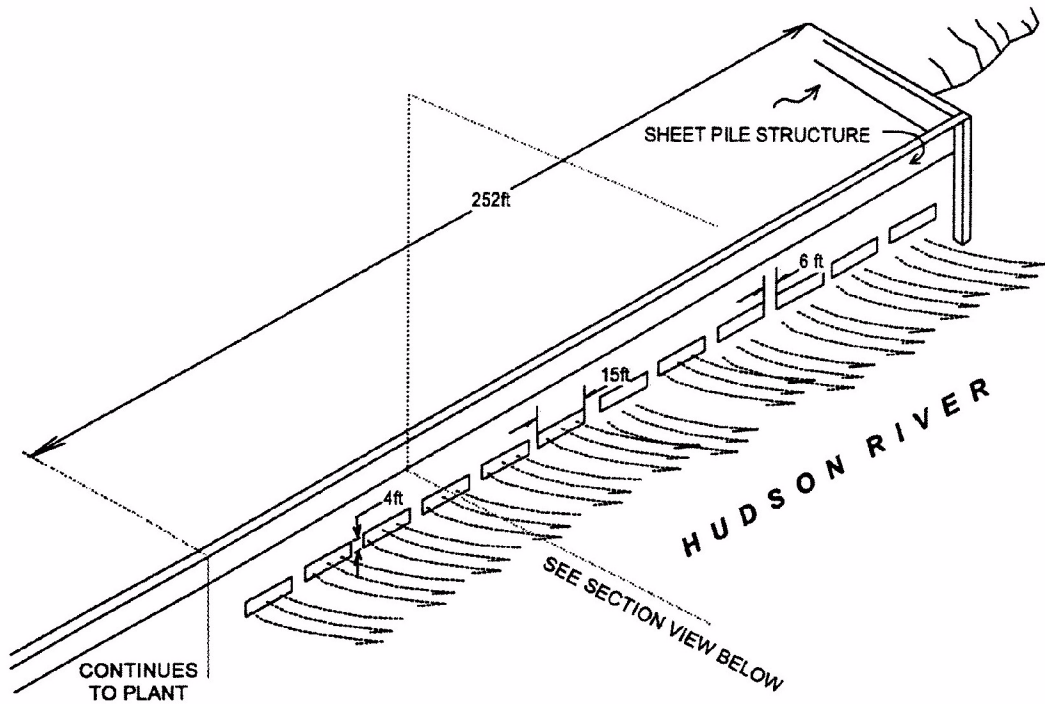

Source: CHGEC Section IV.B

Figure 3-8
Indian Point Discharge Structure

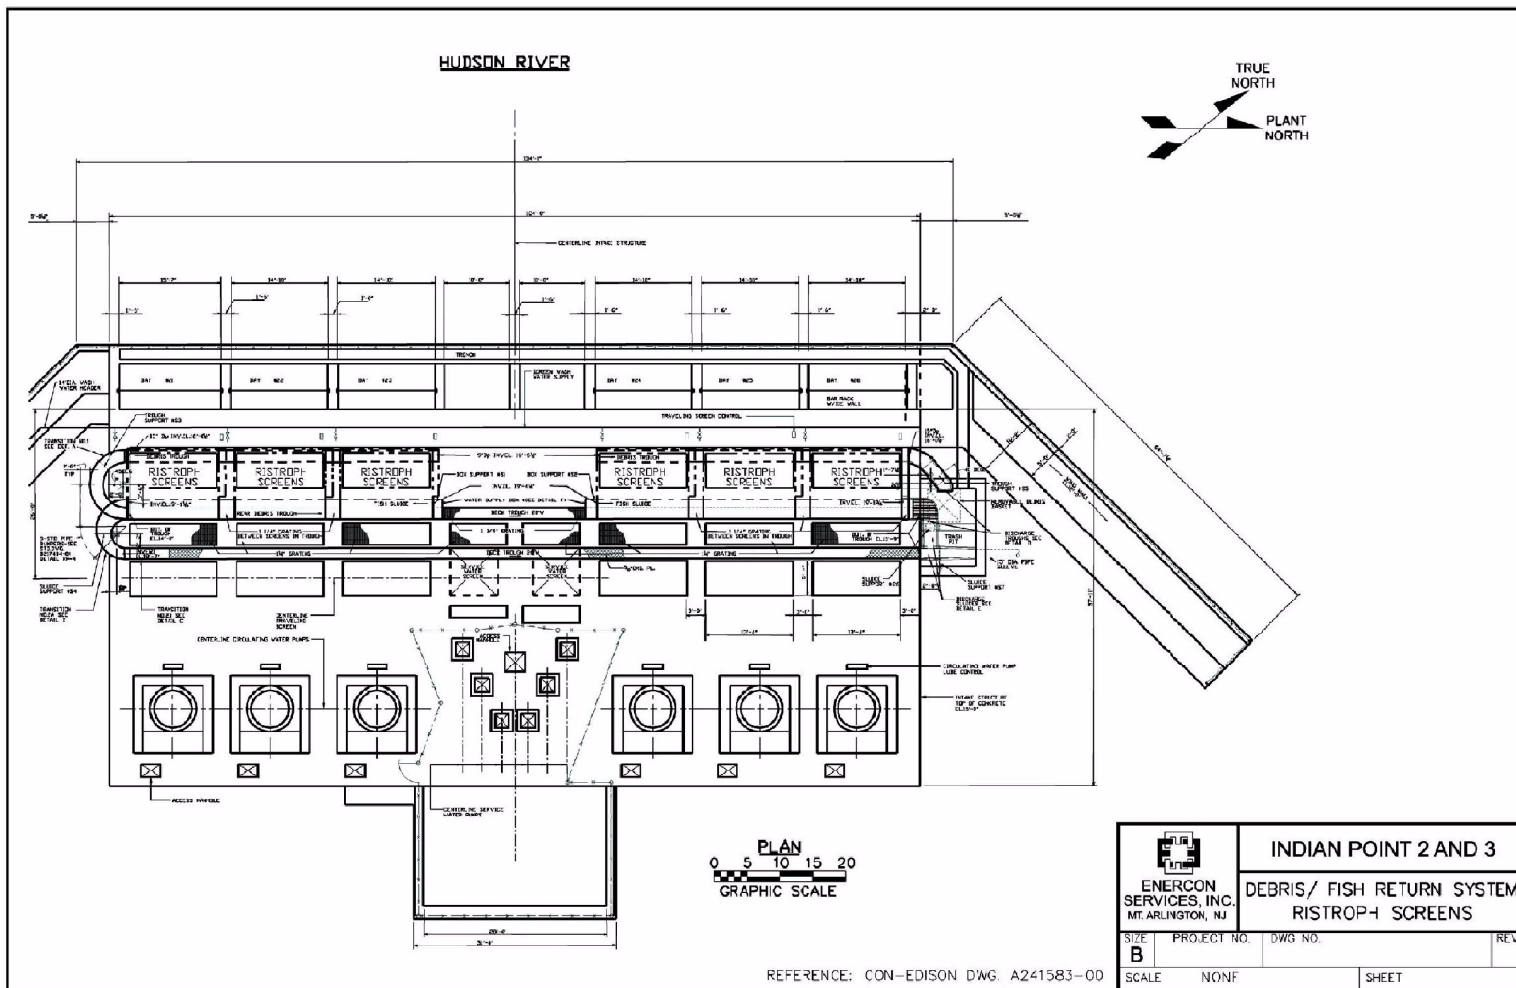


Figure 3-9
IP2 Fish Return System

4.0 ENVIRONMENTAL CONSEQUENCES OF PROPOSED ACTION

Discussion of GEIS Categories for Environmental Issues

The NRC has identified and analyzed 92 environmental issues that it considers to be associated with nuclear power plant license renewal and has designated the issues as Category 1, Category 2, or NA (not applicable). NRC designated an issue as Category 1 if the following criteria were met:

- the environmental impacts associated with the issue have been determined to apply either to all plants or, for some issues, to plants having a specific type of cooling system or other specified plant or site characteristic;
- a single significance level (i.e., small, moderate, or large) has been assigned to the impacts that would occur at any plant, regardless of which plant is being evaluated (except for collective offsite radiological impacts from the fuel cycle and from high-level waste and spent-fuel disposal); and
- mitigation of adverse impacts associated with the issue has been considered in the analysis, and it has been determined that additional plant-specific mitigation measures are likely to be not sufficiently beneficial to warrant implementation.

If the NRC concluded that one or more of the Category 1 criteria could not be met, NRC designated the issue Category 2. NRC requires plant-specific analysis for Category 2 issues. NRC designated two issues as NA, signifying that the categorization and impact definitions do not apply to these issues. NRC rules do not require analyses of Category 1 issues that NRC resolved using generic findings (10 CFR Part 51, Appendix B, Table B-1) as described in the GEIS [NRC 1996]. An applicant may reference the GEIS findings for Category 1 issues.

Category 1 License Renewal Issues

Entergy has determined that, of the 69 Category 1 issues, 19 are not applicable to the site because they apply to design or operational features that do not exist at the facility. In addition, because Entergy does not plan to conduct refurbishment activities, the NRC findings for the 7 Category 1 issues applicable to refurbishment do not apply. [Table 4-1](#) lists these 26 Category 1 issues and provides a brief explanation of why they are not applicable to the site. [Table 4-2](#) lists the 43 Category 1 issues applicable to the site. Entergy reviewed the NRC findings on these 43 issues and identified no new and significant information that would invalidate the findings for the site (see [Section 5](#)). Therefore, Entergy adopts by reference the NRC findings for these Category 1 issues.

**Table 4-1
Category 1 Issues Not Applicable to IP2 and IP3**

Surface Water Quality, Hydrology, and Use (for all plants)	
Impacts of refurbishment on surface water quality	No refurbishment activities planned.
Impacts of refurbishment on surface water use	No refurbishment activities planned.
Altered thermal stratification of lakes	The site is not located on a lake.
Eutrophication	IP2 and IP3 do not discharge to a lake
Discharge of sanitary wastes and minor chemical spills	The site does not discharge sanitary wastes to surface water.
Aquatic Ecology (for all plants)	
Refurbishment	No refurbishment activities planned.
Premature emergence of aquatic insects	Aquatic insects are primarily of concern in freshwater environments
Aquatic Ecology (for plants with cooling tower based heat dissipation systems)	
Entrainment of fish and shellfish in early life stages	The site does not use cooling towers.
Impingement of fish and shellfish	The site does not use cooling towers.
Heat shock	The site does not use cooling towers.
Groundwater Use and Quality	
Impacts of refurbishment on groundwater use and quality	No refurbishment activities planned.
Groundwater quality degradation (Ranney Wells)	The site does not use Ranney wells.
Groundwater quality degradation (saltwater intrusion)	The site does not use or withdraw groundwater.
Groundwater quality degradation (cooling ponds in salt marshes)	The site does not use cooling ponds.
Groundwater use conflicts (potable and service water; plants that use <100 gpm)	The site does not use or withdraw groundwater.
Human Health	
Radiation exposures to the public during refurbishment	No refurbishment activities planned.

**Table 4-1
 Category 1 Issues Not Applicable to IP2 and IP3
 (Continued)**

Occupational radiation exposures during refurbishment	No refurbishment activities planned.
Microbiological organisms (occupational health)	The site is not located on a small river.
Terrestrial Resources	
Cooling pond impacts on terrestrial resources	The site does not use cooling ponds.
Cooling tower impacts on crops and ornamental vegetation	The site does not use cooling towers.
Cooling tower impacts on native plants	The site does not use cooling towers.
Bird collisions with cooling towers	The site does not use natural draft towers.
Power line right-of-way management (cutting and herbicide application)	All power lines at the site exist on site property from plant to switchyard.
Floodplains and wetland on power line right-of-way	All power lines at the site exist on site property from plant to switchyard and none cross regulated floodplains or wetlands.
Socioeconomics	
Aesthetic impacts (refurbishment)	No refurbishment activities planned.
Land Use	
Power line right-of-way	All power lines at the site exist on site property from plant to switchyard.

**Table 4-2
 Category 1 Issues Applicable to IP2 and IP3**

Surface Water Quality, Hydrology, and Use (for all plants)
Water use conflicts (plants with once-through cooling systems)
Altered salinity gradients
Altered current patterns at intake and discharge structures
Temperature effects on sediment transport capacity
Scouring caused by discharged cooling water
Discharge of chlorine or other biocides

Table 4-2
Category 1 Issues Applicable to IP2 and IP3
(Continued)

Discharge of other metals in waste water
Aquatic Ecology (for all plants)
Accumulation of contaminants in sediments or biota
Entrainment of phytoplankton and zooplankton
Cold shock
Thermal plume barrier to migrating fish
Distribution of aquatic organisms
Gas supersaturation (gas bubble disease)
Low dissolved oxygen in the discharge
Losses from predation, parasitism, and disease among organisms exposed to sublethal stresses
Stimulation of nuisance organisms (e.g., shipworms)
Terrestrial Resources
Bird collision with power lines
Impacts of electromagnetic fields on flora and fauna (plants, agricultural crops, honeybees, wildlife, livestock)
Air Quality
Air quality effects of transmission lines
Land Use
Land use (license renewal period)
Human Health
Noise
Radiation exposures to public (license renewal term)
Occupational radiation exposures (license renewal term)
Socioeconomics
Public services: public safety, social services, and tourism and recreation
Public services, education (license renewal term)
Aesthetic impacts (license renewal term)
Aesthetic impacts of transmission lines (license renewal term)

**Table 4-2
 Category 1 Issues Applicable to IP2 and IP3
 (Continued)**

Postulated Accidents
Design basis accidents
Uranium Fuel Cycle and Waste Management
Offsite radiological impacts (individual effects from other than the disposal of spent fuel and high-level waste)
Offsite radiological impacts (collective effects)
Offsite radiological impacts (spent fuel and high-level waste disposal)
Non-radiological impacts of the uranium fuel cycle
Low-level waste storage and disposal
Mixed waste storage and disposal
On-site spent fuel
Nonradiological waste
Transportation
Decommissioning
Radiation doses
Waste management
Air quality
Water quality
Ecological resources
Socioeconomic impacts

Category 2 License Renewal Issues

NRC designated 21 issues as Category 2. Sections 4.1 through 4.21 address the Category 2 issues, beginning with a statement of the issue. As is the case with Category 1 issues, some Category 2 issues (6) apply to operational features that the site does not have. In addition, some Category 2 issues (4) apply only to refurbishment activities. If the issue does not apply to the site, the section explains the basis.

For the 11 Category 2 issues applicable to the site, the corresponding sections contain the required analyses. These analyses include conclusions regarding the significance of the impacts relative to renewal of the operating license for the site and, when applicable, discuss potential mitigative alternatives to the extent required. Entergy has identified the significance of the

impacts associated with each issue as SMALL, MODERATE, or LARGE consistent with the criteria that NRC established in 10 CFR Part 51, Appendix B, Table B-1, Footnote 3 as follows.

- **SMALL:** Environmental effects are not detectable or are so minor that they will neither destabilize nor noticeably alter any important attribute of the resource. For the purposes of assessing radiological impacts, the Commission has concluded that those impacts that do not exceed permissible levels in the Commission's regulations are considered small.
- **MODERATE:** Environmental effects are sufficient to alter noticeably, but not to destabilize, any important attributes of the resource.
- **LARGE:** Environmental effects are clearly noticeable and are sufficient to destabilize any important attributes of the resource.

In accordance with NEPA practice, Entergy considered ongoing and potential additional mitigation in proportion to the significance of the impact to be addressed (i.e., impacts that are small receive less mitigative consideration than impacts that are large).

"NA" License Renewal Issues

NRC determined that its categorization and impact-finding definitions did not apply to electromagnetic fields (chronic effect) and environmental justice. NRC noted that applicants currently do not need to submit information on chronic effects from electromagnetic fields (10 CFR Part 51, Appendix B, Table B-1, Footnote 5). For environmental justice, NRC does not require information from applicants, but noted that it would be addressed in individual license renewal reviews (10 CFR Part 51, Appendix B, Table B-1, Footnote 6). Entergy has included environmental justice demographic information in [Section 2.6.2](#).

Format of Category 2 Issue Review

The review and analysis for the Category 2 issues along with environmental justice and cumulative impacts are found in Sections 4.1 through 4.23. The format for the review of the Category 2 issues, Section 4.1 through 4.21, is described below.

- *Issue:* a brief statement of the issue.
- *Description of Issue:* a brief description of the issue.
- *Findings from Table B-1, Appendix B to Subpart A:* the findings for the issue from Table B-1—Summary of Findings on NEPA Issues for License Renewal of Nuclear Power Plants, Appendix B to Subpart A.
- *Requirement:* restatement of the requirement from 10 CFR 51.53(c)(3)(ii).
- *Background:* for issues applicable to the site, a background excerpt from the applicable section of the GEIS. The specific section of the GEIS is referenced for the convenience

of the reader. In most cases, background information is not provided for issues that are not applicable to the site.

- *Analysis of Environmental Impact*: an analysis of the environmental impact as required by 10 CFR 51.53(c)(3)(ii). The analysis takes into account information provided in the GEIS, Appendix B to Subpart A of 10 CFR Part 51, as well as current specific information.
- *Conclusion*: for issues applicable to the site, the conclusion of the analysis along with the consideration of mitigation alternatives as required by 10 CFR 51.45(c) and 10 CFR 51.53(c)(3)(iii).

4.1 Water Use Conflicts

4.1.1 Description of Issue

Water use conflicts (plants with cooling ponds or cooling towers using make-up water from a small river with low flow).

4.1.2 Findings from Table B-1, Appendix B to Subpart A

SMALL or MODERATE. The issue has been a concern at nuclear power plants with cooling ponds and at plants with cooling towers. Impacts on in-stream and riparian communities near these plants could be of moderate significance in some situations. See 10 CFR 51.53(c)(3)(ii)(A).

4.1.3 Requirement [10 CFR 51.53(c)(3)(ii)(A)]

If the applicant's plant utilizes cooling towers or cooling ponds and withdraws make-up water from a river whose annual flow rate is less than 3.15×10^{12} ft³/year (9×10^{10} m³/year), an assessment of the impact of the proposed action on the flow of the river and related impacts on instream and riparian ecological communities must be provided. The applicant shall also provide an assessment of the impacts of the withdrawal of water from the river on alluvial aquifers during low flow.

4.1.4 Analysis of Environmental Impact

The site does not utilize cooling towers or cooling ponds. IP2 and IP3 utilize once-through cooling systems. Therefore, this issue is not applicable to the site and further analysis is not required.

4.2 Entrainment of Fish and Shellfish in Early Life Stages

4.2.1 Description of Issue

Entrainment of fish and shellfish in early life stages (for all plants with once-through and cooling pond heat dissipation systems).

4.2.2 Findings from Table B-1, Appendix B to Subpart A

SMALL, MODERATE, or LARGE. The impacts of entrainment are small at many plants but may be moderate or even large at a few plants with once-through and cooling-pond cooling systems. Further, ongoing efforts in the vicinity of these plants to restore fish populations may increase the numbers of fish susceptible to intake effects during the license renewal period, such that entrainment studies conducted in support of the original license may no longer be valid. See 10 CFR 51.53(c)(3)(ii)(B).

4.2.3 Requirement [10 CFR 51.53(c)(3)(ii)(B)]

If the applicant's plant utilizes once-through cooling or cooling pond heat dissipation systems, the applicant shall provide a copy of current CWA 316(b) determinations and, if necessary, a 316(a) variance in accordance with 40 CFR 125, or equivalent state permits and supporting documentation. If the applicant cannot provide these documents, it shall assess the impact of the proposed action on fish and shellfish resources resulting from heat shock and impingement and entrainment.

4.2.4 Background

The impacts of fish and shellfish entrainment are small at many plants, but they may be moderate or even large at a few plants with once-through cooling systems. Further, ongoing restoration efforts may increase the numbers of fish susceptible to intake effects during the license renewal period, so that entrainment studies conducted in support of the original license may no longer be valid. [NRC 1996, Section 4.2.2.1.2]

4.2.5 Analysis of Environmental Impact

4.2.5.1 Background

The effects of entrainment on aquatic resources were considered by NRC and EPA, or an EPA-authorized state water quality permitting agency, at the time of original licensing, and are routinely reconsidered by the EPA, or the state, often times in the context of the renewals of National Pollutant Discharge Elimination System (NPDES) permits or updates of in-place 316(b) demonstrations. Further, the vast majority of existing nuclear stations, including those stations undergoing license renewal, currently are or in the future will be undergoing comprehensive 316(b) review as EPA develops final 316(b) regulations for existing facilities in response to the recent remand of that rule.

Entrainment and impingement in the Hudson River, particularly within the sphere of influence of Indian Point and other major Hudson River electric-generating facilities (of which there are several), have been continuously and extensively evaluated, and peer reviewed by leading fisheries biologists, since the original licensing of IP2. These studies, undertaken at an annual cost to the Hudson River facilities of \$2.0 million annually (in 1981 dollars), and performed at the direction and under the oversight of NYSDEC, have resulted in what William Sarbello, then of the NYSDEC, referred to in November 2000 as "probably, the best data set on the planet." [USEPA].

The IP2 FES concluded that the issuance of an operating permit for IP2 to former owner Consolidated Edison Company of New York, Inc. (ConEdison), should be subject to the conditions relating to 316(b) considerations: (1) once-through cooling would be permitted only until January 1, 1978; (2) evaluate the economic and environmental impacts of a new closed-cycle cooling system to determine a preferred system to install and submit this evaluation to the USAEC by July 1, 1973; (3) ConEdison should monitor the nature and extent of impingement and entrainment mortality; and (4) ConEdison should submit a plan of action for minimizing detrimental effects on aquatic biota by July 1, 1973 and implement the plan upon approval by the USAEC [USAEC]. These conditions, among others, were inserted by the NRC into the IP2 Operating License as Condition 2.E. A similar license condition was included in the IP3 Operating License issued to NYPA, the former owner of IP3. Consistent with these licensing conditions, ConEdison and NYPA submitted an Environmental Report in 1976 to the NRC in which various alternative closed-cycle cooling systems were evaluated for IP2 and IP3 from an economic and environmental standpoint. The time frame established in the FES and IP2 and IP3 license conditions was extended until May 1, 1982, and then rendered moot by the 1981 execution of the global settlement, known as the Hudson River Settlement Agreement (HRSA), arising out of the parallel United States Environmental Protection Agency (EPA) NPDES permitting process for IP2 and IP3, in which all parties agreed that closed-cycle cooling would not be implemented at that time.

In 1975, contemporaneous with ConEdison and NYPA's review of closed-cycle cooling systems, EPA initiated NPDES permitting proceedings for both stations, producing an initial draft permit (jointly held by IP2 and IP3 because of their shared discharge canal) that echoed the respective NRC licenses for these stations in requiring closed-cycle cooling. (EPA actually required closed-cycle cooling for all of the Hudson River facilities.) NYPA and ConEdison opposed these NPDES permit conditions, initiating a contested proceeding (with substantial collateral litigation). Consolidated adjudicatory hearings commenced in February 1977 before an EPA administrative law judge, and several years were engaged in the station owners' marshalling of evidence and witnesses. In July 1979, EPA's witnesses were called to the stand, and the owners of the various stations began cross-examination. The landmark Hudson River Settlement Agreement (HRSA) occurred at this time, resolving the need for further continued hearings or an EPA decision.

In particular, the ten-year HRSA, dated October 19, 1980, resolved the then-pending EPA permit proceeding relating to IP2 and IP3 and reflects the negotiated resolution among EPA, the NYSDEC, the former owners of the Hudson River facilities, including ConEdison and NYPA, and various environmental groups. As a result of the HRSA, both former owners, ConEdison and NYPA, submitted a license amendment request to the NRC for the removal of license condition 2.E that required the closed-cycle cooling system [HRSA]. License Amendment No. 71 removed Condition 2.E, for both IP2 and IP3, effective May 14, 1981 [NRC 1981]. In place of the cooling tower requirement, the HRSA included various technical, operational and restoration measures relating to the Hudson River facilities, including IP2 and IP3. These measures included, with respect to IP2 and IP3, the installation of dual or variable speed intake pumps, state-of-the-art Ristroph screens and fish-return systems, flow reduction obligations (facilitated by the pump retrofits) designed to minimize water use in a manner consistent with efficient station operation, and appropriate outage scheduling (including through an outage credit point system that

rewarded outages taken during potential entrainment periods). In addition, the development of a striped bass fish hatchery was made a joint requirement for all of the power generators party to the HRSA, as were certain other requirements [HRSA].

The new pumping systems were timely installed at IP3 and IP2. Ristroph screens and fish return systems were timely installed at IP3 and IP2 and completed in 1990 and 1991, respectively [IP2 UFSAR, Section 10.2.4; IP3 UFSAR Section 10.2.4]. IP2 has six two-speed circulating water pumps designed to pump 140,000 gpm at full speed and 84,000 gpm at reduced speed. IP3 has six variable-speed circulating water pumps designed to pump 140,000 gpm at full speed and 64,000 gpm at the lowest speed. Each unit has six service water pumps, IP3 rated at 6,000 gpm per each pump and IP2 at 5,000 gpm per each pump. There are three back-up service water pumps located on a platform at IP3 over the discharge channel. After moving through the condensers, cooling water from IP2 and IP3 flows downward from the discharge water boxes by way of six 96-inch down pipes, and exits under the water surface in a 40-foot-wide discharge canal.[CHGEC]

The owners use best reasonable efforts to operate the IP2 and IP3 dual and variable speed circulating pumps to keep the volume of river water drawn into the stations during the relevant entrainment period at the minimum required for efficient operation, considering ambient river water temperature, plant operating status, the need to meet water quality standards and other permit conditions. Flow rates are dependent upon intake water temperature, and typically peak between early May and late October. In addition, outages are scheduled, where reasonably practicable, in a manner sensitive to entrainment considerations, typically during the late spring entrainment period, with the result that only one unit is operating during that outage period each year. Further, extensive entrainment survival studies reflect a very high level of entrainment survival among certain species. [CHGEC, Section V.D]

The first SPDES permit was granted to both units in 1982, with the HRSA annexed as a permit condition for the duration of the HRSA. A SPDES permit renewal was granted in October 1987 by the NYSDEC [Attachment C], again during the lifespan of the HRSA. In 1992, a timely SPDES permit renewal application was submitted to the NYSDEC for both units, as a result of which the 1992 permit continues in effect under New York administrative law until a new permit is issued by NYSDEC. The HRSA, which was annexed to the 1982 SPDES Permit, expired after its 10-year term, but was replaced by four judicially approved consecutive Consent Orders, the first of which was executed in 1992, between the owners of IP2 and IP3, other Hudson River power generators, NYSDEC, and other stakeholders. Each of these Consent Orders effectively continued the HRSA terms and conditions, although without requiring outages at IP2 or IP3, or the continued operation of the striped bass hatchery (owing in part to the striped bass population proliferation over the period in question). The most recent Consent Order expired in 1998 [NYSDEC 1997a]. However, IP2 and IP3 voluntarily have agreed with NYSDEC to continue the activities required in the last Consent Decree. The submission of a timely and complete SPDES renewal application for IP2 and IP3 administratively continued the site's current SPDES permit under the New York State Administrative Procedure Act and the NYSDEC's implementing regulations.

In July 1992, NYSDEC requested that certain of the Hudson River power generators, including IP2 and IP3, submit an Environmental Impact Statement (EIS) under the New York SEQRA on the potential impacts of their requested SPDES permit renewals. In conjunction with the SPDES Permit applications for Indian Point, Roseton, and Bowline Point generation plants, these owners responded by providing a DEIS in 1993, and, after an extensive interim consultation with the NYSDEC, a revised DEIS in 1999 [CHGEC]. The NYSDEC accepted the DEIS as complete as a matter of New York administrative law, and issued its FEIS in 2003. In conjunction with litigation among the parties, NYSDEC subsequently determined that additional public involvement and response was needed before a final SPDES permit would be issued to IP1, IP2, and IP3 or any other of the Hudson River facilities addressed on a cumulative basis in the DEIS and FEIS [NYSDEC 2003b].

NYSDEC also issued a draft SPDES permit for IP1, IP2, and IP3 in 2003 that, among other conditions, requires the design and, if appropriate, the installation of closed-cycle cooling systems for IP2 and IP3 if the site seeks and receives from NRC license renewals for IP2 and IP3, and the NRC, among other regulators, reaches all appropriate feasibility and safety determinations [NYSDEC 2003a]. In particular, the draft SPDES permit fact sheet states: "This permit does not require the construction of cooling towers unless: (1) the applicant seeks to renew its NRC operating licenses, (2) the NRC approves extension of the licenses, and determines that the installation and operation of closed-cycle cooling is feasible and safe, and (3) all other necessary Federal approvals are obtained." [NYSDEC 2003c, Section IV.D.4]. The draft permit also requires that all applicable local approvals must be obtained before cooling towers will be required. The conditions of the draft permit are the subject of a contested adjudicatory proceeding currently pending before a two-judge panel of NYSDEC administrative law judges. As a matter of New York administrative law, the 1992 SPDES permit remains in full effect as administratively continued, pending issuance of the final SPDES permit currently subject to the adjudicatory process. With respect to that contested proceeding, the owners of IP2 and IP3 have taken the position that the mitigation measures currently implemented at IP2 and IP3 as a result of the HRSA and Consent Orders, as supported by ongoing Hudson River monitoring, are adequate in minimizing potential impacts from current operations and operations during the license renewal period. Nonetheless, additional measures may be established as the outcome of the SPDES process and would be incorporated into the SPDES permit for IP2 and IP3 that would be in place during the license renewal period.

In sum, the owners of IP2 and IP3, and the owners of other Hudson River generating stations, have conducted comprehensive Hudson River aquatic studies under the oversight and direction of NYSDEC since the 1970s. The results of these studies were reported in the 1999 DEIS and 2003 FEIS. Based on the reports summarized in the DEIS and FEIS, studies completed in the 1970s included sampling and evaluation of all trophic levels in the Hudson River estuary. Representative species, populations and communities were defined and evaluated. During the 1980s and 1990s, studies focused more closely on key fish species, particularly those adults and larvae that use the estuary as spawning habitat or represent commercial/recreational species, chiefly striped bass. Many of these studies have specifically addressed the potential impacts of cooling water intake structures to the macroinvertebrates, all appropriate fish life stages and fish populations. Entrainment mitigation measures have been implemented in accordance with the

HRSA and the four Consent Orders [NYSDEC 1997a]. Among the other measures discussed above, these mitigation measures have included installation of the dual and multi-speed cooling water intake pumps and minimizing cooling water withdrawal to only that required for efficient plant operation.

4.2.5.2 Entrainment Analysis

IP2 and IP3 are equipped with once-through heat dissipation systems that withdraw cooling water from and discharge to the Hudson River. The details of the IP2 and IP3 cooling systems, intake structures, and discharge systems are provided in Chapter 3 of this ER. IP2 and IP3 each have separate shoreline-situated intake structures consisting of seven bays (six for circulating water and one for service water). Additional service water and screen wash water is provided for IP2 from the IP1 intake structure.

As explained above, the 1999 DEIS submitted to the NYSDEC provides extensive descriptions of more than 23 years of Hudson River fisheries and habitat studies involving trends in representative species abundance, diversity, richness, and mortality rates, and therefore potential impacts from entrainment and impingement at once-through cooling water intakes. Specifically, the DEIS describes estimates of entrainment mortality integrated with estimates of the abundance of fish in certain portions of the River to derive the theoretical proportional reduction of the population of that age class, expressed as the conditional mortality rate (CMR), i.e., the mortality to the fraction of the river population caused by IP2 and IP3 entrainment if there were no other sources of mortality implicated [CHGEC, Section VI.B.1.b]. The estimated average annual CMR due to entrainment for American shad is 0.64%, for Atlantic tomcod is 12.04%, for bay anchovy is 10.38%, for river herring is 1.20%, for striped bass is 7.82%, and for white perch is 4.94% [CHGEC, Section V.D]. CMRs and discussion of models to define the CMRs are presented in the DEIS and its appendixes.

The diversity of species within the fish communities in the Hudson River ecosystem was generally affected by the ecosystem changes that affected water quality (the fish community in the brackish portion of the estuary) and habitat availability (the fish community in the freshwater portion of the estuary). The number of marine species entering the estuary increased when water quality increased in the New York City area. However, the diversity of YOY, yearling, and older fish in the lower portion of the estuary was more strongly affected (decreased) by the increase in the abundance of large striped bass. The number of freshwater species in the upper portion of the estuary decreased when the water chestnut populations recovered and achieved nuisance levels in the late 1970s and early 1980s. [CHGEC, Section V.D.4.c]

Subsequent to submission of the DEIS, the generators submitted to the NYSDEC, among other things, a review by three leading fisheries biologists, Drs. Charles C. Coutant, Lawrence W. Barnthouse, and Webster Van Winkle, of the Hudson River data set, with a trend analysis of the relative abundance and diversity of the fish populations in the River [Barnthouse]. The express purpose of that Report was to provide an even greater level of confidence to NYSDEC regarding the DEIS conclusion that no adverse impacts to fisheries have occurred or are likely to occur as a result of the operation of the cooling water intake structures of the various stations, including IP2

and IP3. In addition, since submission of the DEIS, the generators have continued to provide the annual year-class reports outlining the results of the annual monitoring program for the year in question, as well as all of the raw data collected and an estimate of the abundance (i.e., standing crop) of fish in the River during that period. This information continues to confirm the absence of any adverse impact on fisheries reasonably attributable to IP2 or IP3 [ASA].

4.2.6 Conclusion

More than 30 years of extensive fisheries studies of the Hudson River in the vicinity of IP2 and IP3 support current operations. The results of the studies performed from 1974 to 1997, the period of time covered in the DEIS, are referenced and summarized in the DEIS, and have not shown any negative trend in overall aquatic river species populations attributable to plant operations. Ongoing studies continue to support these conclusions [ASA]. In addition, current mitigation measures implemented through the HRSA and retained in the four Consent Orders, the current agreements with NYSDEC, and the outcome of the draft SPDES Permit proceeding, will ensure that entrainment impacts remain SMALL during the license renewal term. Therefore, withdrawal of water from the Hudson River for the purposes of once-through cooling at the site does not have any demonstrable negative effect on representative Hudson River fish populations, nor does it warrant further mitigation measures.

4.3 Impingement of Fish and Shellfish

4.3.1 Description of Issue

Impingement of fish and shellfish (for all plants with once-through and cooling pond heat dissipation systems).

4.3.2 Findings from Table B-1, Appendix B to Subpart A

SMALL, MODERATE, or LARGE. The impacts of impingement are small at many plants but may be moderate or even large at a few plants with once-through and cooling-pond cooling systems. See 10 CFR 51.53(c)(3)(ii)(B).

4.3.3 Requirement [10 CFR 51.53(c)(3)(ii)(B)]

If the applicant's plant utilizes once-through cooling or cooling pond heat dissipation systems, the applicant shall provide a copy of current Clean Water Act 316(b) determinations and, if necessary, a 316(a) variance in accordance with 40 CFR Part 125, or equivalent state permits and supporting documentation. If the applicant cannot provide these documents, it shall assess the impact of the proposed action on fish and shellfish resources resulting from heat shock and impingement and entrainment.

4.3.4 Background

Aquatic organisms that are drawn into the intake with the cooling water but are too large to pass through the debris screens may be impinged against the screens. Mortality of fish that are

impinged is high at many plants because impinged organisms are eventually suffocated by being held against the screen mesh, or are abraded, which can result in fatal infection. Impingement can affect large numbers of fish and invertebrates (crabs, shrimp, jellyfish, etc.). As with entrainment, operational monitoring and mitigative measures have allayed concerns about population-level effects at most plants, but impingement mortality continues to be an issue at others. Consultation with resource agencies revealed that impingement is a frequent concern at plants using once-through cooling, particularly where restoration of anadromous fish (fish that migrate from the sea to spawn in fresh water) may be affected. The impacts of impingement are small at many plants but may be moderate or even large at a few plants with once-through cooling systems. [NRC 1996, Section 4.2.2.1.3]

4.3.5 Analysis of Environmental Impact

4.3.5.1 Background

The effects of impingement on aquatic resources were considered by NRC and EPA, or an EPA-authorized state water quality permitting agency, at the time of original licensing, and are routinely reconsidered by the EPA, or the state, often times in the context of the renewals of NPDES permits or updates of in-place 316(b) demonstrations. Further, the vast majority of existing nuclear stations, including those stations undergoing license renewal, currently are or in the future will be undergoing comprehensive 316(b) review as EPA develops final 316(b) regulations for existing facilities in response to the recent remand of that rule.

Impingement in the Hudson River, particularly within the sphere of influence of Indian Point and other major Hudson River electric-generating facilities (of which there are several), has been continuously and extensively evaluated, and peer reviewed by leading fisheries biologists, since the original licensing of IP2. These studies, undertaken at an annual cost to the Hudson River facilities of \$2.0 million annually (in 1981 dollars), and performed at the direction and under the oversight of NYSDEC, have resulted in what William Sarbello, then of the NYSDEC, referred to in November 2000 as "probably, the best data set on the planet." [USEPA].

The IP2 FES concluded that the issuance of an operating permit for IP2 to former owner ConEdison should be subject to the conditions relating to 316(b) considerations: (1) once-through cooling would be permitted only until January 1, 1978; (2) evaluate the economic and environmental impacts of a new closed-cycle cooling system to determine a preferred system to install and submit this evaluation to the USAEC by July 1, 1973; (3) ConEdison should monitor the nature and extent of impingement and entrainment mortality; and (4) ConEdison should submit a plan of action for minimizing detrimental effects on aquatic biota by July 1, 1973, and implement the plan upon approval by the USAEC [USAEC, Section XI.C]. These conditions, among others, were inserted by the NRC into the IP2 Operating License as Condition 2.E. A similar license condition was included in the IP3 Operating License issued to NYPA, the former owner of IP3. Consistent with these licensing conditions, ConEdison and NYPA submitted an Environmental Report in 1976 to the NRC in which various alternative closed-cycle cooling systems were evaluated for IP2 and IP3 from an economic and environmental standpoint. The time frame established in the FES and IP2 and IP3 license conditions was extended until May 1,

1982, and then rendered moot by the 1981 execution of the global settlement, known as the HRSA, arising out of the parallel EPA NPDES permitting process for IP2 and IP3, in which all parties agreed that closed-cycle cooling would not be implemented at that time.

In 1975, contemporaneous with ConEdison and NYPA's review of closed-cycle cooling systems, EPA initiated NPDES permitting proceedings for both stations, producing an initial draft permit (jointly held by IP2 and IP3 because of their shared discharge canal) that echoed the respective NRC licenses for these stations in requiring closed-cycle cooling (EPA actually required closed-cycle cooling for all of the Hudson River facilities). NYPA and ConEdison opposed these NPDES permit conditions, initiating a contested proceeding (with substantial collateral litigation). Consolidated adjudicatory hearings commenced in February 1977 before an EPA administrative law judge, and several years were engaged in the station owners' marshalling of evidence and witnesses. In July 1979, EPA's witnesses were called to the stand, and the owners of the various stations began cross-examination. The landmark HRSA settlement occurred at this time, resolving the need for further continued hearings or an EPA decision.

In particular, the ten-year HRSA, dated October 19, 1980, resolved the then-pending EPA permit proceeding relating to IP2 and IP3 and reflects the negotiated resolution among EPA, the NYSDEC, the former owners of the Hudson River facilities, including ConEdison and NYPA, and various environmental groups. As a result of the HRSA, both former owners, ConEdison and NYPA, submitted a license amendment request to the NRC for the removal of license condition 2.E that required the closed-cycle cooling system [HRSA]. License Amendment No. 71 removed Condition 2.E, for both IP2 and IP3, effective May 14, 1981 [NRC 1981]. In place of the cooling tower requirement, the HRSA included various technical, operational and restoration measures relating to the Hudson River facilities, including IP2 and IP3. These measures included, with respect to IP2 and IP3, the installation of dual or variable speed intake pumps, state-of-the-art Ristroph screens and fish-return systems, flow reduction obligations (facilitated by the pump retrofits) designed to minimize water use in a manner consistent with efficient station operation, appropriate outage scheduling (including through an outage credit point system that rewarded outages taken during potential entrainment periods). In addition, the development of a striped bass fish hatchery was made a joint requirement for all of the power generators party to the HRSA, as were certain other requirements [HRSA].

The new pumping systems were timely installed at IP3 and IP2. Ristroph screens and fish return systems were timely installed at IP3 and IP2 and completed in 1990 and 1991, respectively. IP2 has six two-speed circulating water pumps designed to pump 140,000 gpm at full speed and 84,000 gpm at reduced speed. IP3 has six variable-speed circulating water pumps designed to pump 140,000 gpm at full speed and 64,000 gpm at the lowest speed. [IP2 UFSAR, Section 10.2.4; IP3 UFSAR Section 10.2.4] Each unit has six service water pumps, IP3 rated at 6,000 gpm for each pump and IP2 at 5,000 gpm for each pump. There are three back-up service water pumps located on a platform at IP3 over the discharge channel. After moving through the condensers, cooling water from IP2 and IP3 flows downward from the discharge water boxes by way of six 96-inch down pipes, and exits under the water surface in a 40-foot wide discharge canal. [CHGEC]

The owners use best reasonable efforts to operate the IP2 and IP3 dual and variable speed circulating pumps so as to keep the volume of River water drawn into the stations at the minimum required for efficient operation, considering ambient river water temperature, plant operating status, the need to meet water quality standards and other permit conditions. Flow rates are dependent upon intake water temperature, and typically peak between early May and late October. [CHGEC, Section VIII.B.2]

The first SPDES permit was granted to both units in 1982, with the HRSA annexed as a permit condition for the duration of the HRSA. A SPDES permit renewal was granted in October 1987 by the NYSDEC [Attachment C], again during the lifespan of the HRSA. In 1992, a timely SPDES permit renewal application was submitted to the NYSDEC for both units, as a result of which the 1992 permit continues in effect under New York administrative law until a new permit is issued by NYSDEC. The HRSA, which was annexed to the 1982 SPDES Permit, expired after its 10-year term, but was replaced by four judicially approved consecutive Consent Orders, the first of which was executed in 1992, between the owners of IP2 and IP3, other Hudson River power generators, NYSDEC, and other stakeholders. Each of these Consent Orders effectively continued the HRSA terms and conditions, although without requiring outages at IP2 or IP3, or the continued operation of the striped bass hatchery (owing in part to the striped bass population proliferation over the period in question). The most recent Consent Order expired in 1998 [NYSDEC 1997a]. However, IP2 and IP3 voluntarily have agreed with NYSDEC to continue the activities required in the last Consent Decree. The submission of a timely and complete SPDES renewal application for IP2 and IP3 administratively continued the site's current SPDES permit under the New York State Administrative Procedure Act and the NYSDEC's implementing regulations.

In July 1992, NYSDEC requested that certain of the Hudson River power generators, including IP2 and IP3, submit an EIS under the New York SEQRA on the potential impacts of their requested SPDES permit renewals. In conjunction with the SPDES Permit applications for Indian Point, Roseton, and Bowline Point generation plants, these owners responded by providing a DEIS in 1993, and, after an extensive interim consultation with the NYSDEC, a revised DEIS in 1999 [CHGEC]. The NYSDEC accepted the DEIS as complete as a matter of New York administrative law and issued its FEIS in 2003, but, in conjunction with litigation among the parties, subsequently determined that additional public involvement and response was needed before a FEIS would be issued to IP2 and IP3 or any other of the Hudson River facilities addressed on a cumulative basis in the DEIS and FEIS [NYSDEC 2003b].

NYSDEC also issued a draft SPDES permit for IP2 and IP3 in 2003 that, among other conditions, requires the design and, if appropriate, the installation of closed-cycle cooling systems for IP2 and IP3 if the site seeks and receives from NRC license renewals for IP2 and IP3, and the NRC, among other regulators, reaches all appropriate feasibility and safety determinations [NYSDEC 2003a]. In particular, the draft SPDES permit fact sheet states: "This permit does not require the construction of cooling towers unless: (1) the applicant seeks to renew its NRC operating licenses, (2) the NRC approves extension of the licenses, and determines that the installation and operation of closed-cycle cooling is feasible and safe, and (3) all other necessary Federal approvals are obtained." [NYSDEC 2003c, Section IV.D.4]. The draft permit also requires that all

applicable local approvals must be obtained before cooling towers will be required. The conditions of the draft permit are the subject of a contested adjudicatory proceeding currently pending before a two-judge panel of NYSDEC administrative law judges. As a matter of New York administrative law, the 1992 SPDES permit remains in full effect as administratively continued, pending issuance of the final SPDES permit currently subject to the adjudicatory process. With respect to that contested proceeding, the owners of IP2 and IP3 have taken the position that the mitigation measures currently implemented at IP2 and IP3 as a result of the HRSA and Consent Orders, as supported by ongoing Hudson River monitoring, are adequate in minimizing potential impacts from current operations and operations during the license renewal period. Nonetheless, additional measures may be established as the outcome of the SPDES process and would be incorporated into the SPDES permit for IP2 and IP3 that would be in place during any license renewal period.

In sum, the owners of IP2 and IP3, and the owners of other Hudson River generating stations, have conducted comprehensive Hudson River aquatic studies under the oversight and direction of NYSDEC since the 1970s. The results of these studies were reported in the 1999 DEIS and 2003 FEIS. Based on the reports summarized in the DEIS and FEIS, studies completed in the 1970s included sampling and evaluation of all trophic levels in the Hudson River estuary. Representative species, populations and communities were defined and evaluated. During the 1980s and 1990s, studies focused more closely on key fish species, particularly those adults and larvae that use the estuary as spawning habitat or represent commercial/recreational species, chiefly striped bass. Many of these studies have specifically addressed the potential impacts of cooling water intake structures to the macroinvertebrates, all appropriate fish life stages and fish populations [NYSDEC 1997a]. IP2 and IP3 has installed dual or variable speed intake pumps, state-of-the-art Ristroph screens and fish-return systems, flow reduction obligations (facilitated by the pump retrofits) designed to minimize water use in a manner consistent with efficient station operation.

4.3.5.2 Impingement Analysis

IP2 and IP3 are equipped with once-through heat dissipation systems that withdraw cooling water from and discharges to the Hudson River. The details of the IP2 and IP3 cooling systems, intake structures, and discharge systems are provided in Chapter 3 of this ER. IP2 and IP3 each have shoreline-situated intake structures consisting of seven bays (six for circulating water and one for service water). Additional service water and screen wash water is provided for IP2 from the IP1 intake structure.

As explained above, the 1999 DEIS submitted to the NYSDEC on behalf of SPDES Permit Applications for Indian Point, Roseton, and Bowline Point generation plants provides extensive descriptions of more than 23 years of Hudson River fisheries and habitat studies involving trends in key species abundance, diversity, richness, and mortality rates, and impacts from impingement at once-through cooling water intakes. Specifically, the DEIS describes sampling study results at Indian Point, and identified 88 species of fish in more than 20 years of impingement studies. However, 95% of the catch was composed of eight species, which were selected by the NYSDEC for more analysis. The CMR was used to define quantitative estimates of impingement

losses. The CMR uses monthly estimates of numbers of fish lost due to impingement in conjunction with estimates of the river population, during the same time period, to estimate the fraction of the river population lost due to IP2 and IP3 impingement if there were no other sources of mortality implicated. [CHGEC, Appendix VI-2-A]

CMR estimates of the numbers of fish lost to impingement integrated with estimates of the abundance of fish in the river were also presented in the DEIS as a percentage to estimate the proportional reduction of the population [CHGEC, Section VI.B.1.b]. CMRs and discussion of models to define the CMRs are presented in the DEIS and its appendixes [CHGEC, Section VI.2.A and B]. The estimated average annual CMR due to impingement for American shad is 0.0%, for Atlantic tomcod is 0.62%, for bay anchovy is 0.05%, for blueback herring is 0.22%, for alewife is 0.14%, for spottail shiner is 0.10%, for striped bass is 0.20%, and for white perch is 1.70% [CHGEC, Section V.D].

The diversity of species within the fish communities in the Hudson River ecosystem was generally affected by the ecosystem changes that affected water quality (the fish community in the brackish portion of the estuary) and habitat availability (the fish community in the freshwater portion of the estuary). The number of marine species entering the estuary increased when water quality increased in the New York City area. However, the diversity of YOY, yearling, and older fish in the lower portion of the estuary was more strongly affected (decreased) by the increase in the abundance of large striped bass. The number of freshwater species in the upper portion of the estuary decreased when the water chestnut populations recovered and achieved nuisance levels in the late 1970s and early 1980s. [CHGEC, Section V.D.4.c.]

It should be noted that the impingement percentages included data collected from 1981 to 1990, which was prior to installation of the Ristroph screens on the intakes for IP2 and IP3. Therefore, the impingement mortality during current operations and the license renewal period would be significantly less, based on the impingement mortality percentage estimates cited above and anticipating the continued use of the Ristroph screens and fish return systems installed. In the Fact Sheet to the draft permit, NYSDEC noted without objection that "[a]ccording to Entergy, this current design, along with seasonable flow reductions and generation outages..., attains an estimated 77% reduction in impingement mortality." [NYSDEC 2003c]

Subsequent to submission of the DEIS, the generators submitted to the NYSDEC, among other things, a review by three leading fisheries biologists, Drs. Charles C. Coutant, Lawrence W. Barnthouse and Webster Van Winkle, of the Hudson River data set, with a trend analysis of the relative abundance and diversity of the fish populations in the River [Barnthouse]. The express purpose of that Report was to provide an even greater level of confidence to NYSDEC regarding the DEIS conclusion that no adverse impacts to fisheries have occurred or are likely to occur as a result of the operation of the cooling water intake structures of the various stations, including IP2 and IP3. In addition, since submission of the DEIS, the generators have continued to provide the annual year-class reports outlining the results of the annual monitoring program for the year in question, as well as all of the raw data collected and an estimate of the abundance (i.e., standing crop) of fish in the River during that period. This information continues to confirm the absence of any adverse impact on fisheries reasonably attributable to IP2 or IP3 [ASA].

4.3.6 Conclusion

More than 30 years of extensive fisheries studies of the Hudson River in the vicinity of IP2 and IP3 support current operations. The results of the studies performed from 1974 to 1997, the period of time covered in the DEIS, are referenced and summarized in the DEIS, and have not shown any negative trend in overall aquatic river species populations attributable to plant operations. Ongoing studies continue to support these conclusions [ASA]. In addition, current mitigation measures implemented through the HRSA and retained in the four Consent Orders, the current agreements with NYSDEC, and the outcome of the draft SPDES Permit proceeding, will ensure that impingement impacts remain SMALL during the license renewal term. Therefore, withdrawal of water from the Hudson River for the purposes of once-through cooling at the site does not have any demonstrable negative effect on representative Hudson River fish populations, nor does it warrant further mitigation measures.

4.4 Heat Shock

4.4.1 Description of Issue

Heat Shock (for all plants with once through and cooling pond heat dissipation systems)

4.4.2 Findings from Table B-1, Appendix B to Subpart A

SMALL, MODERATE, OR LARGE. Because of continuing concerns about heat shock and the possible need to modify thermal discharges in response to changing environmental conditions, the impacts may be of moderate or large significance at some plants. See 10 CFR 51.53(c)(3)(ii)(B).

4.4.3 Requirement [10 CFR 51.53(c)(3)(ii)(B)]

If the applicant's plant utilizes once-through cooling or cooling pond heat dissipation systems, the applicant shall provide a copy of current Clean Water Act 316(b) determinations and, if necessary, a 316(a) variance in accordance with 40 CFR Part 125, or equivalent State permits and supporting documentation. If the applicant cannot provide these documents, it shall assess the impact of the proposed action on fish and shellfish resources resulting from heat shock....

4.4.4 Background

Based on the research literature, monitoring reports, and agency consultations, the potential for thermal discharges to cause thermal discharge effect mortalities is considered small for most plants. However, impacts may be moderate or even large at a few plants with once-through cooling systems. For example, thermal discharges at one plant are considered by the agencies to have damaged the benthic invertebrate and seagrass communities in the effluent mixing zone around the discharge canal; as a result, helper cooling towers have been installed to reduce the discharge temperatures. Conversely, at other plants it may become advantageous to increase the temperature of the discharge in order to reduce the volume of water pumped through the plants and thereby reduce entrainment and impingement effects. Because of continuing

concerns about thermal discharge effects and the possible need to modify thermal discharges in the future in response to changing environmental conditions, this is a Category 2 issue for plants with once-through cooling systems. [NRC 1996, Section 4.2.2.1.4]

4.4.5 Analysis of Environmental Impact

4.4.5.1 Background

New York State has developed mixing zone criteria and thermal discharge limits for steam-electric power plants. These limits are designed to protect the existence of a balanced indigenous population of shellfish, fish, and wildlife in the receiving water body. If the facility cannot meet the stated water quality standard criteria, the facility must submit data demonstrating that its actual discharge will ensure the protection and propagation of a balanced indigenous population of shellfish, fish, and wildlife. This demonstration is referred to as a 316(a) demonstration. The NPDES permit required for a power plant typically contains discharge temperature limits that are based on either state standards or 316(a) demonstrations.

The site holds SPDES permit NY-0004472 with effluent limitations, monitoring requirements, and other conditions that ensure that all discharges are in compliance with Title 8 of Article 17 of the Environmental Conservation Law (ECL) of New York State and the CWA, as amended (33 U.S.C. Section 1251 et seq.). In accordance with permit requirements, the site monitors discharge characteristics and reports the results to the NYSDEC. A copy of the current SPDES Permit is attached [[Attachment C](#)].

The site is equipped with a once-through heat dissipation system that withdraws cooling water from and discharges to the Hudson River. The details of the plant cooling systems, intake structures, and discharge systems are provided in [Section 3](#). IP2 and IP3 each have shoreline-situated intake structures consisting of seven bays (six for circulating water and one for service water). Additional service water and screen wash water is provided for IP2 from the IP1 intake structure.

IP2 has six two-speed circulating water pumps designed to pump 140,000 gpm at full speed and 84,000 gpm at reduced speed. IP3 has six variable-speed circulating water pumps designed to pump 140,000 gpm at full speed and 64,000 gpm at the lowest speed. Each unit has six service water pumps, IP3 rated at 6,000 gpm for each pump and IP2 at 5,000 gpm for each pump. There are three back-up service water pumps located on a platform at IP3 over the discharge channel. After moving through the condensers, cooling water from IP2 and IP3 flows downward from the discharge water boxes via six 96-inch downpipes and exits under the water surface in a 40-foot wide discharge canal.

The site uses best reasonable efforts to operate the IP2 and IP3 dual and variable speed circulating pumps so as to keep the volume of river water drawn into the plant at the minimum required for efficient operation, considering ambient river water temperature, plant operating status, and the need to meet thermal water quality standards and other permit conditions. Flow rates are dependent upon intake water temperature and typically peak between early May and late October.

Impacts due to thermal discharge have been studied and evaluated since the original licensing of IP2. The IP2 FES concluded that the issuance of an operating permit for IP2 should be subject to the following specified conditions: (1) once-through cooling would be permitted only until January 1, 1978, with a closed-cycle cooling system thereafter; (2) the site must evaluate the economic and environmental impacts of a new closed-cycle cooling system to determine a preferred system to install and submit this evaluation to the USAEC by July 1, 1973; (3) the required closed-cycle cooling system shall be designed, built, and put into operation no later than January 1, 1978; (4) ConEdison should monitor the nature and extent of impingement and entrainment mortality; (5) ConEdison should monitor concentrations of residual free and combined chlorine during each chlorination period and its effects on biota; (6) ConEdison should monitor dissolved oxygen in the discharge water and thermal plume; (7) ConEdison should monitor the size, shape, and locations of isotherms in the thermal plume; (8) ConEdison should monitor changes in aquatic life in the Hudson River from operation of the once-through cooling system; (9) ConEdison should submit a plan of action for minimizing detrimental effects on aquatic biota by July 1, 1973, and implement the plan upon approval by the USAEC [USAEC, Section XI.C]. These conditions were inserted by the NRC into the IP2 Operating License as Condition 2.E. Similar license conditions were subsequently included in the IP3 Operating License.

Former owners ConEdison and NYPA submitted an Environmental Report in 1976 to the NRC in which various alternative closed-cycle cooling systems were evaluated for IP2 and IP3 from an economic and environmental standpoint. In 1980, litigation concerning the operation of electric generating units on the Hudson River, including IP2 and IP3, resulted in the HRSA, which was negotiated between the NYSDEC, the former owners of the sites, and other parties to the litigation. As a result of the HRSA, both former owners, ConEdison and NYPA, submitted a license amendment request to the NRC for the removal of license condition 2.E that required the closed-cycle cooling system [HRSA]. License Amendment No. 71 removed Condition 2.E, for both IP2 and IP3, effective May 14, 1981 [NRC 1981]. In place of the cooling tower requirement, the HRSA included mitigation measures relating to IP2 and IP3 including seasonal outages, installation of dual or variable speed intake pumps, installation of angled screens to minimize impingement, and the development of a striped bass fish hatchery (this latter was made a joint requirement for all of the power generators party to the HRSA) [HRSA].

The first SPDES permit was granted to both units in 1982, with the HRSA annexed as a permit condition for the duration of the HRSA. An SPDES permit renewal was granted in October 1987 by the NYSDEC [Attachment C], again during the lifespan of the HRSA. In 1992, a timely SPDES permit renewal application was submitted to the NYSDEC for both units, as a result of which the 1992 permit continues in effect under New York administrative law until a new permit is issued by NYSDEC. The HRSA, which was annexed to the 1982 SPDES Permit, expired after its 10-year term, but was replaced by four judicially approved consecutive Consent Orders, the first of which was executed in 1992, between the owners of IP2 and IP3, other Hudson River power generators, NYSDEC, and other stakeholders [NYSDEC 1997a]. Each of these Consent Orders effectively continued the HRSA terms and conditions, although without requiring outages at IP2 or IP3, or the continued operation of the striped bass hatchery (owing in part to the striped bass population proliferation during the period in question). The consent orders did, however,

incorporate flow reduction requirements consisting of flow credits. The most recent Consent Order expired in 1998. However, IP2 and IP3 voluntarily have agreed with NYSDEC to continue the activities required in the last Consent Decree. The submission of a timely and complete SPDES renewal application for IP2 and IP3 administratively continued the site's current SPDES permit under the New York State Administrative Procedure Act and the NYSDEC's implementing regulations.

In July 1992, NYSDEC requested that certain of the Hudson River power generators, including IP2 and IP3, submit an EIS under the New York State SEQRA on the potential impacts of their requested SPDES permit renewals. In conjunction with the SPDES Permit applications for Indian Point, Roseton, and Bowline Point generation plants, these owners responded by providing a DEIS in 1993, and, after an extensive interim consultation with the NYSDEC, a revised DEIS in 1999 [CHGEC]. The NYSDEC accepted the DEIS as complete as a matter of New York administrative law, and issued its FEIS in 2003, but, in conjunction with litigation among the parties, subsequently determined that additional public involvement and response was needed before a final SPDES permit would be issued [NYSDEC 2003b] to IP2 and IP3 or any other of the Hudson River facilities addressed on a cumulative basis in the DEIS and FEIS.

NYSDEC also issued a draft SPDES permit for IP2 and IP3 in 2003 that, among other conditions, requires the design and, if appropriate, the installation of closed-cycle cooling systems for IP2 and IP3 if the site seeks and receives from NRC license renewals for IP2 and IP3, and the NRC, among other regulators, reaches all appropriate feasibility and safety determinations [NYSDEC 2003a]. In particular, the draft SPDES fact sheet states, "This permit does not require the construction of cooling towers unless: (1) the applicant seeks to renew its NRC operating licenses, (2) the NRC approves extension of the licenses, and determines that the installation and operation of closed-cycle cooling is feasible and safe, and (3) all other necessary Federal approvals are obtained." [NYSDEC 2003c]. The draft permit also requires that all applicable local approvals must be obtained before cooling towers will be required. The conditions of the draft permit are the subject of a contested adjudicatory proceeding currently pending before a two-judge panel of NYSDEC administrative law judges. As a matter of New York administrative law, the 1992 SPDES permit remains in full effect as administratively continued, pending issuance of the final SPDES permit currently subject to the adjudicatory process. With respect to that contested proceeding, the owners of IP2 and IP3 have taken the position that the mitigation measures currently implemented at IP2 and IP3 as a result of the HRSA and Consent Orders, as supported by ongoing Hudson River monitoring, are adequate in minimizing potential impacts from current operations and operations during the license renewal period. Nonetheless, additional measures may be established as the outcome of the SPDES process and would be incorporated into the SPDES permit for IP2 and IP3 that would be in place during any license renewal period.

The site and the other Hudson River power generating utilities have conducted Hudson River aquatic studies since the 1970s. The results of these studies were reported in the 1999 DEIS and 2003 FEIS. Based on the reports summarized in the DEIS and FEIS, studies completed in the 1970s included sampling and evaluation of all trophic levels in the Hudson River estuary. Key species, populations, and communities were defined. During the 1980s, studies focused

more closely on the fish species, particularly those adults and larvae that use the estuary as spawning and nursery habitat. As part of the Hudson River Utilities Monitoring Program, extensive environmental studies were conducted by the Hudson River utilities and the NYSDEC in the Hudson River estuary. Many of these studies have specifically addressed potential impacts to the macroinvertebrates, larval fish, adult fish, and anadromous fish populations. Thermal mitigation measures have been implemented in accordance with the HRSA and subsequent Consent Orders [NYSDEC 1997a]. Among others, these mitigation measures have included installation of the dual- and multi-speed cooling water intake pumps and minimizing cooling water withdrawal to only that required for efficient plant operation.

4.4.5.2 Thermal Discharge Analysis

Conditions established by the NYSDEC related to thermal discharge and included in the site's SPDES Permit NY-0004472 are as follows.

- The discharge temperature is not to exceed 110°F.
- Between April 15 and June 30, daily maximum temperature is not to exceed 93.2°F for more than 10 days a year.
- Between April 15 and June 30, daily average temperature is not to exceed 93.2°F for more than 15 days during the term of the permit.
- Twenty-two (22) inches of head differential is to be maintained between levels in the discharge canal and river height whenever site gross electrical output exceeds 600 MWe or river temperature exceeds 90°F.

These conditions, which the facility is in compliance with, were established by the NYSDEC to ensure the protection and propagation of a balanced indigenous population of shellfish, fish, and wildlife in the Hudson River.

The DEIS identifies the major potential biothermal effects as mortality from excess temperature, mortality from cold shock, blockage of migration, reduced growth or reproductive success. As discussed in the DEIS and sections above, the sites' discharges were designed, and are operated, to minimize potential adverse impacts. Studies conducted at the time of installation during the 1970s and since provide evidence that heat discharge from the sites' cooling systems does not cause appreciable harm or interfere with the maintenance of a balanced indigenous aquatic population. Conclusions regarding each of the major potential thermal biological effects are summarized in the DEIS [CHGEC, Section VI.B.4.c].

4.4.6 Conclusions

Pursuant to 10 CFR 51.53(c)(3)(ii)(B), cited above, the site holds an NYSDEC SPDES permit (NY-0004472) for discharge of cooling waters from IP2 and IP3 [NYSDEC 1987]. The Station is complying with this permit, including limits and conditions established by the NYSDEC for thermal discharges. As mentioned above, IP2 and IP3 entered into a fourth amended Consent

Order with NYSDEC in 1997 which provided that IP2 and IP3's owners would continue mitigation measures, such as the flow reductions timed to reduce impacts to certain fish species [NYSDEC 1997a]. Entergy and former site owner/operators ConEdison and NYPA have conducted extensive studies of the impacts of IP2 and IP3 operations, and the 30-year-plus dataset supports current IP2 and IP3 operations. Entergy concludes that continued operation in the manner required by the current SPDES permit and the associated agreement to continue implementation of the fourth Consent Decree ensures that thermal impacts will satisfy the requirements of CWA 316(a) and will thus remain SMALL during the license renewal term. Therefore, no further mitigation measures are warranted.

4.5 Groundwater Use Conflicts (Plants Using >100 gpm of Groundwater)

4.5.1 Description of Issue

Groundwater use conflicts (potable and service water and dewatering: plants that use >100 gpm).

4.5.2 Findings from Table B-1, Appendix B to Subpart A

SMALL, MODERATE, or LARGE. Plants that use more than 100 gpm may cause groundwater use conflicts with nearby groundwater users. See 10 CFR 51.53(c)(3)(ii)(C).

4.5.3 Requirement [10 CFR 51.53(c)(3)(ii)(C)]

If the applicant's plant uses Ranney wells or pumps more than 100 gallons (total onsite) of groundwater per minute, an assessment of the impact of the proposed action on groundwater use must be provided.

4.5.4 Analysis of Environmental Impact

Potable water is supplied by the Village of Buchanan, which purchases water from the City of Peekskill PWS and the NWJWW, and cooling and service water is taken from the Hudson River. Therefore, this issue is not applicable to the site and analysis is not required.

4.6 Groundwater Use Conflicts (Plants Using Cooling Towers Withdrawing Make-Up Water from a Small River)

4.6.1 Description of Issue

Groundwater use conflicts (plants using cooling towers withdrawing make-up water from a small river).

4.6.2 Findings from Table B-1, Appendix B to Subpart A

SMALL, MODERATE, or LARGE. Water use conflicts may result from surface water withdrawals from small water bodies during low flow conditions which may affect aquifer recharge, especially

if other groundwater or upstream surface water users come on line before the time of license renewal. See 10 CFR 51.53(c)(3)(ii)(A).

4.6.3 Requirement [10 CFR 51.53(c)(3)(ii)(A)]

If the applicant's plant utilizes cooling towers or cooling ponds and withdraws make-up water from a river whose annual flow rate is less than 3.15×10^{12} ft³/year (9×10^{10} m³/year), an assessment of the impact of the proposed action on the flow of the river and related impacts on in-stream and riparian ecological communities must be provided. The applicant shall also provide an assessment of the impacts of the withdrawal of water from the river on alluvial aquifers during low flow.

4.6.4 Analysis of Environmental Impact

The site, which withdraws water from an estuary of the Hudson River, does not utilize cooling towers or cooling ponds and does not withdraw water from a river whose annual flow rate is less than 3.15×10^{12} ft³/year (9×10^{10} m³/year). Therefore, this issue is not applicable to the site and further analysis is not required.

4.7 Groundwater Use Conflicts (Plants Using Ranney Wells)

4.7.1 Description of Issue

Groundwater use conflicts (plants using Ranney wells).

4.7.2 Findings from Table B-1, Appendix B to Subpart A

SMALL, MODERATE, or LARGE. Ranney wells can result in potential groundwater depression beyond the site boundary. Impacts of large groundwater withdrawal for cooling tower makeup at nuclear power plants using Ranney wells must be evaluated at the time of application for license renewal. See 10 CFR 51.53(c)(3)(ii)(C).

4.7.3 Requirement [10 CFR 51.53(c)(3)(ii)(C)]

If the applicant's plant uses Ranney wells or pumps more than 100 gallons (total on-site) of groundwater per minute, an assessment of the impact of the proposed action on groundwater use must be provided.

4.7.4 Analysis of Environmental Impact

The site, which utilizes cooling and service water taken directly from the Hudson River, does not utilize Ranney wells. Therefore, this issue is not applicable to the site and analysis is not required.

4.8 Degradation of Groundwater Quality

4.8.1 Description of Issue

Groundwater quality degradation (cooling ponds at inland sites).

4.8.2 Findings from Table B-1, Appendix B to Subpart A

SMALL, MODERATE, or LARGE. Sites with closed-cycle cooling ponds may degrade groundwater quality. For plants located inland, the quality of the groundwater in the vicinity of the ponds must be shown to be adequate to allow continuation of current uses. See 10 CFR 51.53(c)(3)(ii)(D).

4.8.3 Requirement [10 CFR 51.53(c)(3)(ii)(D)]

If the applicant's plant is located at an inland site and utilizes cooling ponds, an assessment of the impact of the proposed action on groundwater quality must be provided.

4.8.4 Analysis of Environmental Impact

The site, which is located in a coastal area, uses a once-through cooling system and does not utilize cooling ponds. Therefore, this issue is not applicable to the site and analysis is not required.

4.9 Impacts of Refurbishment on Terrestrial Resources

4.9.1 Description of Issue

Refurbishment impacts - Terrestrial Resources

4.9.2 Findings from Table B-1, Appendix B to Subpart A

SMALL, MODERATE, or LARGE. Refurbishment impacts are insignificant if no loss of important plant and animal habitat occurs. However, it cannot be known whether important plant and animal communities may be affected until the specific proposal is presented with the license renewal application. See 10 CFR 51.53(c)(3)(ii)(E).

4.9.3 Requirement [10 CFR 51.53(c)(3)(ii)(E)]

All license renewal applicants shall assess the impact of refurbishment and other license renewal related construction activities on important plant and animal habitats.

4.9.4 Analysis of Environmental Impact

As noted in [Section 3.3](#), there are no refurbishment activities required for IP2 and IP3 license renewal. Therefore this issue is not applicable to the site and no further analysis is required.

4.10 Threatened or Endangered Species

4.10.1 Description of Issue

Impacts from refurbishment and continued operations on threatened or endangered species.

4.10.2 Finding from Table B-1, Appendix B to Subpart A

SMALL, MODERATE, or LARGE. Generally, plant refurbishment and continued operation are not expected to adversely affect threatened or endangered species. However, consultation with appropriate agencies would be needed at the time of license renewal to determine whether threatened or endangered species are present and whether they would be adversely affected. See 10 CFR 51.53(c)(3)(ii)(E).

4.10.3 Requirement of 10 CFR 51.53(c)(3)(ii)(E)

All license renewal applicants shall assess the impact of refurbishment and other license renewal related construction activities on important plant and animal habitats. Additionally, the applicant shall assess the impact of the proposed action on threatened or endangered species in accordance with the Endangered Species Act.

4.10.4 Background

The NRC did not reach a conclusion about the significance of potential impacts to threatened and endangered species in the GEIS because (1) the significance of impacts on such species cannot be assessed without site- and project-specific information that will not be available until the time of license renewal and (2) additional species that are threatened with extinction and that may be adversely affected by plant operations may be identified between the present and the time of license renewal. [NRC 1996, Section 3.9]

4.10.5 Analysis of Environmental Impact

[Section 2.4](#) addresses issues related to critical and important habitats, wetlands, and unique natural areas. [Section 2.5](#) discusses threatened or endangered species that could occur within the vicinity of the site.

As discussed in [Section 3.3](#), Entergy has no plans to conduct refurbishment or construction activities at the site during the license renewal term. Therefore, there would be no refurbishment-related impacts to special-status species and no further analysis of refurbishment-related impacts is applicable.

Entergy contacted the USFWS, NMFS, and NYNHP for input on the presence of listed threatened or endangered species in the vicinity of Indian Point, and received input in December 2006 and January 2007. As stated in [Section 2.5](#), there are four federally protected animal species which may occur in the vicinity of the site: Indiana Bat, bog turtle, bald eagle, and shortnose sturgeon. Of the four species, only two, the shortnose sturgeon and the bald eagle, are confirmed as being present in the site area. There have been no sightings or knowledge of

local populations of either the Indiana Bat or the bog turtle either on-site or within the vicinity of the site. The USFWS also identified the New England Cottontail as a Candidate Species for listing in Westchester County [USFWS 2007]. NMFS listed the Atlantic sturgeon as a potential species for listing (See [Attachment A](#)) [NMFS 2007].

In recent years, the stretch of the Hudson from Kingston to Croton has been an increasingly popular bald eagle area, probably because sections of the river are kept open by discharges from power plants and railroad tracks provide an ample supply of dead animals (carrion) for scavenging eagles. Bald eagles have increased in total number, successful nesting pairs, and number of young produced. Alteration of the landscape required by bald eagles continues to be the biggest single threat to this species. Logging, developments of all kinds, and increasing demands for public use of all kinds (i.e. boating, canoe/kayak trails, personal watercraft, ATVs, hiking trails, etc.) are increasing at a tremendous rate that is not commensurate with protection of the landscape [NYSDEC 2005a]. Future continued bald eagle preservation for future generations will be tied to protection of habitat. There are no plans to alter operations, expand existing facilities, or acquire additional land in support of license renewal, therefore there are no anticipated potential impacts on nesting sites from continued site operations. Entergy has fleet procedural controls in place to ensure that threatened and endangered species are adequately protected if present, during site operations and project planning [Entergy].

The shortnose sturgeon is considered to be amphidromous, since they appear to spend most of their life in their natal river and only occasionally enter nearby coastal water. In the Hudson River, it spawns from April - May. Adult sturgeon migrate upriver from their mid-Hudson over-wintering areas to freshwater spawning sites north of Coxsackie [NMFS 2000].

NMFS indicated a potential for entrainment of Atlantic sturgeon larvae in the region in which Indian Point is located. NMFS noted sturgeon yolk sac larvae (YSL) and PYSL have been documented in the vicinity of Indian Point, but assumes the larvae in the lower river area (RM 48 to 110) are Atlantic sturgeon. As noted in Section 2.5 of this ER, the Atlantic sturgeon is not yet a listed threatened or endangered species, but is a species of concern. NMFS also indicated a potential for impingement of shortnose sturgeon on the IP2 and IP3 intake screens. In its January 2007 letter, NMFS requested additional information from Entergy regarding the impacts of its intake and discharge on sturgeon species. In a March 2007 follow-up letter received from the NMFS as a result of discussions between Entergy and NMFS, the agency clarified its position regarding sturgeon species entrainment and impingement, citing Section 7(a)(2) of the Endangered Species Act (ESA) which requires a Section 7 consultation for a federal action, such as the renewal of an operating license. If it is determined through consultation between the NRC and NMFS that the action is not likely to adversely affect any listed species, then no additional measures are necessary. However, it is determined that the action is likely to adversely affect any listed species, then a formal consultation resulting in the issuance of a Biological Opinion and accompanying Incidental Take Statement would be required. (See [Attachment A](#))

NMFS issued an Environmental Assessment (EA) in 2000 to address the issuance of an Incidental Take Permit pursuant to Section 10 of the Endangered Species Act (ESA) for the incidental take of shortnose sturgeon resulting from the operation of cooling water systems at two

existing power plants, the Roseton and Danskammer Point power plants, located on the Hudson River estuary. As part of its permit application, Central Hudson Gas & Electric Corporation (CHGEC) prepared a Conservation Plan that included minimization, monitoring, and adaptive management strategies to ensure that the continued operation of these two plants would not jeopardize the recovery of shortnose sturgeon in the Hudson River [ASA]. In its EA, NMFS evaluated the cumulative impacts of incidental take from all the Hudson River power plants, including Indian Point. [NMFS 2000, Section 1]

In its 2000 EA, NMFS noted the following:

- The population of shortnose sturgeon in the Hudson River estuary appears to have increased over the past few decades and the Estuary presently contains the largest discrete population of shortnose sturgeon reported anywhere. Recent studies have suggested a four-fold increase in population size since the 1970s. Available data appear to indicate that the population of shortnose sturgeon in the Hudson River estuary is healthy and that this species is reproducing and adding young fish to the Hudson population. [NMFS 2000, Section 4.5.3]
- Due to their life-history characteristics, the Hudson River population of shortnose sturgeon has low vulnerability to entrainment effects from operation of any of the six power plants. Shortnose sturgeon spawn in the northern most areas of the Estuary. In addition, shortnose sturgeon eggs are demersal and adhesive and, upon hatching, yolk-sac larvae and larvae seek cover on the bottom. As a result, the eggs and larvae of shortnose sturgeon are located primarily upstream of RM 110, well upriver of any of the six power plant intakes. [NMFS 2000, Section 5.21];
- NMFS noted that of the six Hudson River power plants, only the Bowline Point plant was located near a concentration of shortnose sturgeon. Based on the distribution of shortnose sturgeon concentration areas, juvenile and adult shortnose sturgeon are unlikely to frequent the area of the remaining five power plants and thus appear to have relatively low vulnerability to impingement at any of these power plants. Further, juvenile shortnose sturgeon prefer the deeper waters of channel areas, where they are found on the bottom. This deep benthic orientation, coupled with the fact that the intakes of these power plants are located along the shore, further reduces vulnerability to impingement at any of these five power plants. [NMFS 2000, Section 5.2.2]
- It is important to recognize that many impinged fish survive once returned to the Estuary such that lethal take will be considerably lower. Each of the Hudson River Utilities have conducted impingement viability studies at their respective intakes and have demonstrated that the majority of the species impinged have moderate to high survival rates. Hardier species are likely to exhibit extremely high survival after impingement. Shortnose sturgeon are relatively hardy and resistant to physical stresses similar to those encountered in power plant. During recent intensive trawling of the Estuary to study shortnose sturgeon, the sampling team from Cornell University collected and handled

more than 7,000 shortnose sturgeon without a single reported mortality. [NMFS 2000, Section 5.2.2]

- The NMFS estimated impingement at the site to be approximately 0.8 occurrences per year each at IP2 and IP3, or 1.6 fish per year, since the installation of the Ristroph screens at the site in 1990 and 1991. Based on the apparent rate of decay, some of those collected were dead prior to collection. By comparison, Roseton and Danskammer Point were estimated to impinge an average of approximately 1.5 and 4.4 shortnose sturgeon per year, respectively. Based on these data, the NMFS concluded that future impingement rates due to incidental take are unlikely to jeopardize the continued recovery of the Hudson River shortnose sturgeon population [NMFS 2000, Section 5.2.2].

In 1979 the NMFS biological opinion, issued prior to installation of the IP2 and IP3 Ristroph traveling screens and fish return systems, concluded that overall, the intakes and discharges of Hudson River power plants are unlikely to jeopardize the recovery of the Hudson River shortnose sturgeon population [Dadswell]. This opinion was validated by the results of the 2000 EA. Entergy believes that the installation of the Ristroph screens and fish return systems at the site minimizes or eliminates the potential for shortnose sturgeon impingement mortality and concurs with NMFS that the impact to the Hudson River shortnose sturgeon population is small [NMFS 2000].

In the NMFS 2007 response to Entergy's request for comment on listed species, the agency noted status review for the Atlantic sturgeon has been initiated and considers the species a Candidate Species. NMFS notes that a distribution of YSL and PYSL have been identified in the Hudson from RM 48 to RM 110 and assumes the lower river grouping are Atlantic sturgeon. As such, NMFS considers entrainment a significant concern for Atlantic sturgeon in this area of the river. However, the Atlantic sturgeon eggs are large, demersal, and adhesive, and attach within about 20 minutes to rocks, gravel, plants, roots, and other objects [CHGEC, Section V.D.2.h.i]. By the time their yolk sac is absorbed (about 9-10 days post hatch), the larvae clearly exhibit a predominantly benthic behavior, swimming on the bottom or near the bottom with increased scouring activity [CHGEC, Section V.D.2.h.i]. Thus, the potential impact from entrainment or impingement for the Atlantic sturgeon is SMALL and would be similar to that of the shortnose sturgeon discussed above.

During the environmental assessment for license renewal, the NYNHP was contacted for information regarding state listed threatened and endangered species and unique natural areas in the vicinity of the site. The NYNHP provided comment on species potentially occurring within a six-mile radius of the site, but did not identify adverse impacts to state protected animals or plants that would occur (See Attachment A).

Potential threatened and endangered state listed plants and animals which could occur in the vicinity of the site have been identified in Table 2-4. These state listed species are not addressed in this ER as the species are not known to occur on the site.

Entergy is not aware of any potential concerns regarding threatened or endangered species which could occur due to the site operations. Maintenance activities necessary to support license renewal would be limited to previously disturbed areas on-site and no additional land disturbance is anticipated in support of license renewal. In addition there are no plans to alter plant operations during the license renewal term which would effect threatened and endangered species.

During the environmental assessment for license renewal, the NYNHP was contacted for information regarding state listed threatened and endangered species and unique natural areas in the vicinity of the site. The NYNHP provided comment on species potentially occurring within a six-mile radius of the site, but did not identify adverse impacts to state protected animals or plants that would occur (See [Attachment A](#)).

In addition, based on consultation with state and federal fish and wildlife agencies (see [Attachment A](#)), no critical habitats have been designated on the site and no impacts are anticipated to threatened and endangered species during the license renewal period.

4.10.6 Conclusion

The continued operation of the site will not adversely impact any federally listed species which may exist on or pass through the site. Any maintenance activities necessary to support continued plant operations during the license renewal period would be limited to previously disturbed areas on-site and no additional land disturbance is anticipated in support of license renewal and there are no plans to alter plant operations which would affect the aquatic ecology. In addition, Entergy has fleet procedural controls in place to ensure that threatened and endangered terrestrial species are adequately protected, if present, during site operations and project planning [[Entergy](#)].

If it is determined through consultation between the NRC and NMFS that the action is likely to adversely affect listed sturgeon species, then a formal consultation resulting in the issuance of a Biological Opinion and accompanying Incidental Take Statement may be required. Beyond the potential for the Incidental Take Statement, and a potential for a Habitat Conservation Plan for sturgeon species, Entergy anticipates any future Biological Opinion would conclude that the Hudson River intake and discharge at IP2 and IP3 will not jeopardize the recovery of the Hudson River sturgeon populations, and therefore the impact on these species is also SMALL.

Therefore, Entergy concludes that impacts to threatened or endangered species from license renewal would be SMALL and does not warrant additional mitigation measures.

4.11 Air Quality During Refurbishment (Nonattainment and Maintenance Areas)

4.11.1 Description of Issue

Air quality during refurbishment (nonattainment and maintenance areas).

4.11.2 Findings from Table B-1, Appendix B to Subpart A

SMALL, MODERATE, or LARGE. Air quality impacts from plant refurbishment associated with license renewal are expected to be small. However, vehicle exhaust emissions could be cause for concern at locations in or near nonattainment or maintenance areas. The significance of the potential impact cannot be determined without considering the compliance status of each site and the number of workers expected to be employed during the outage. See 10 CFR 51.53(c)(3)(ii)(F).

4.11.3 Requirement [10 CFR 51.53(c)(3)(ii)(F)]

If the applicant's plant is located in or near a nonattainment or maintenance area, an assessment of vehicle exhaust emissions anticipated at the time of peak refurbishment workforce must be provided in accordance with the Clean Air Act as amended.

4.11.4 Analysis of Environmental Impact

The site is located within the New Jersey-New York-Connecticut Interstate Air Quality Control Region (40 CFR 81.13). As discussed in [Section 2.11](#), this area has been designated as a nonattainment area (40 CFR 81.333) for the 8-hour ozone standard (40 CFR 50.10) and the PM_{2.5} (40 CFR 50.7) standard, both promulgated by EPA in 1997.

Although emissions regulated under state air quality regulations would be protective of air quality standards, Entergy has no plans for refurbishment related to license renewal at IP2 and IP3 as discussed in [Section 3.3](#) of this ER. Therefore, this issue is not applicable to the site and analysis is not required.

4.12 Impact on Public Health of Microbiological Organisms

4.12.1 Description of Issue

Microbiological organisms (public health) (plants using lakes or canals, or cooling towers, or cooling ponds that discharge to a small river).

4.12.2 Finding from Table B-1, Appendix B to Subpart A

SMALL, MODERATE, or LARGE. These organisms are not expected to be a problem at most operating plants except possibly at plants using cooling ponds, lakes, or canals that discharge to small rivers. Without site-specific data, it is not possible to predict the effects generically. See 10 CFR 51.53(c)(3)(ii)(G).

4.12.3 Requirement [10 CFR 51.53(c)(3)(ii)(G)]

If the applicant's plant uses a cooling pond, lake, or canal or discharges into a river having an annual average flow rate of less than 3.15×10^{12} ft³/year (9×10^{10} m³/year), an assessment of

the impact of the proposed action on public health from thermophilic organisms in the affected water must be provided.

4.12.4 Background

Public health questions require additional consideration for the 25 plants using cooling ponds, lakes, canals, or small rivers because the operation of these plants may significantly enhance the presence of thermophilic organisms. The data for these sites are not now at hand and it is impossible to predict the level of thermophilic organism enhancement at a given site with current knowledge. Thus, the impacts are not known and are site-specific. Therefore, the magnitude of the potential public health impacts associated with thermal enhancement of *N. fowleri* cannot be determined generically [NRC 1996, Section 4.3.6].

4.12.5 Analysis of Environmental Impact

Although Indian Point is technically located on an estuary, and not a river, the net downstream flows due to surface runoff have been reported to be in excess of 11,700,000 gpm 20 percent of the time, 6,800,000 gpm 40 percent of the time, 4,710,000 gpm per minute 60 percent of the time, 3,100,000 gpm 80 percent of the time, and 1,800,000 gpm 98 percent of the time [IP2 UFSAR, Section 2.5]. Flow at Troy, New York, is gauged at the USGS station at Green Island and was reported in the DEIS. Based on calculations from Table V-7 of the DEIS, the average monthly freshwater flow at Green Island is approximately 12,643.5 cubic feet per second (cfs), or 3.99×10^{11} cubic feet per year (cfy) [CHGEC, Section V.B.3].

The flow of the Hudson River is controlled more by tides than by surface water runoff from the surrounding watershed. Tidal flow past the site is approximately 80 million gpm about 80 percent of the time, and the estimated flow 500 feet off the shore line is about nine million gpm in a 500-600 foot wide section [IP2 UFSAR, Section 2.5].

The site does not utilize a cooling pond, lake, or a canal. The 80 million gpm of tidal flow past the site is equivalent to 5.62×10^{12} cfy, which does not qualify as a small river. Therefore, this issue is not applicable to the site and further analysis is not required.

4.13 Electromagnetic Fields - Acute Effects

4.13.1 Description of Issue

Electromagnetic fields, acute effects (electric shock)

4.13.2 Findings from Table B-1, Subpart A, Appendix A

SMALL, MODERATE, or LARGE. Electric shock resulting from direct access to energized conductors or from induced charges in metallic structures has not been a problem at most operating plants and generally is not expected to be a problem during the license renewal term. However, site-specific review is required to determine the significance of the electrical shock potential at the site. See 10 CFR 51.53(c)(3)(ii)(H).

4.13.3 Requirements [10 CFR 51.53(c)3)(ii)(H)]

If the applicant's transmission lines that were constructed for the specific purpose of connecting the plant to the transmission system do not meet the recommendations of the National Electric Safety Code for preventing electric shock from induced currents, an assessment of the impact of the proposed action on the potential shock hazard from the transmission lines must be provided.

4.13.4 Background

The transmission line of concern is that between the plant switchyard and the intertie to the transmission system. With respect to shock safety issues and license renewal, three points must be made. First, in the licensing process for the earlier licensed nuclear plants, the issue of electrical shock safety was not addressed. Second, some plants that received operating licenses with a stated transmission line voltage may have chosen to upgrade the line voltage for reasons of efficiency, possibly without reanalysis of induction effects. Third, since the initial NEPA review for those utilities that evaluated potential shock situations under the provision of the NESC, land use may have changed, resulting in the need for reevaluation of this issue.

The electrical shock issue, which is generic to all types of electrical generating stations, including nuclear power plants, is of small significance for transmission lines that are operated in adherence with NESC. Without review of each nuclear plant's transmission line conformance with NESC criteria, it is not possible to determine the significance of the electrical shock potential. [NRC 1996, Sections 4.5.4 and 4.5.4.1]

4.13.5 Analysis of Environmental Impact

Objects near transmission lines can become electrically charged due to their immersion in the lines' electric field. This charge results in a current that flows through the object to the ground. The current is called "induced" because there is no direct connection between the line and the object. The induced current can also flow to the ground through the body of a person who touches the object. An object that is insulated from the ground can actually store an electrical charge, becoming what is called "capacitively charged." A person standing on the ground and touching a vehicle or a fence receives an electrical shock due to the discharge of the capacitive charge through the person's body to the ground. After the initial discharge, a steady-state current can develop, the magnitude of which depends on several factors, including the following:

- strength of the electric field which, in turn, depends on the voltage of the transmission line as well as its height and geometry;
- size of the object on the ground; and
- extent to which the object is grounded.

In 1977, the NESC adopted a provision that describes an additional criterion to establish minimum vertical clearances to the ground for electric lines having voltages exceeding 98-kV alternating current to ground. The clearance must limit the steady-state induced current to 5

milliamperes if the largest anticipated truck, vehicle, or equipment were short-circuited to ground. By way of comparison, the setting of ground fault circuit interrupters used in residential wiring (special breakers for outside circuits or those with outlets around water pipes) is 4 to 6 milliamperes.

As discussed in [Section 3.2.7](#) of this ER, the transmission lines that connect IP2 and IP3 to the transmission system are the lines that extend from the plant to the Buchanan Substation located across Broadway from the site. These lines include the 345-kV lines that transmit power from IP2 and IP3 and the 138-kV lines that provide offsite power from the Buchanan Substation to the stations. At the time IP2 and IP3 were acquired by Entergy, the 138-kV and 345-kV transmission lines between the plant and the Buchanan Substation met all applicable NESC vertical clearance requirements. Using methods described by EPRI, it was also demonstrated that these lines meet the more restrictive induced shock hazard limit of 4.5 mA required by New York Public Service Commission (NYPSC) [[Con Edison](#)].

No changes in the configuration or operation of these transmission lines have occurred since the ownership of these lines was transferred to Entergy. In addition, no significant changes have occurred in land use along the transmission line corridor between the plant and the Buchanan Substation. Therefore, these lines do not have the capacity to induce as much as 5 mA in a vehicle parked beneath the lines, which conforms to the NESC provisions for preventing electric shock from induced current.

Lines that connect IP2 and IP3 to the transmission grid at the Buchanan Substation meet the applicable vertical clearance requirements specified by the NESC for limiting the steady-state current due to electrostatic effects since these lines already meet the more restrictive induced shock hazard limit of 4.5 mA required by the NYPSC. Therefore, impacts due to the electrical shock potential for these lines is of SMALL significance and does not warrant further assessment or mitigation measures.

4.13.6 Conclusion

Lines that connect IP2 and IP3 to the transmission grid at the Buchanan substation meet the applicable vertical clearance requirements specified by NESC, and the clearance limits the steady-state current due to electrostatic effects to no more than 4.5 mA. Therefore, Entergy concludes that the electrical shock potential for these lines is of SMALL significance and does not warrant further assessment or mitigation measures.

4.14 Housing Impacts

4.14.1 Description of Issue

Housing Impacts.

4.14.2 Findings from Table B-1, Appendix B to Subpart A

SMALL, MODERATE, or LARGE. Housing impacts are expected to be of small significance at plants located in a medium or high population area and not in an area where growth control measures that limit housing development are in effect. Moderate or large housing impacts of the workforce associated with refurbishment may be associated with plants located in sparsely populated areas or in areas with growth control measures that limit housing development. See 10 CFR 51.53(c)(3)(ii)(I).

4.14.3 Requirement [10 CFR 51.53(c)(3)(ii)(I)]

An assessment of the impact of the proposed action on housing availability...(impacts from refurbishment activities only) within the vicinity of the plant must be provided.

4.14.4 Background

The impacts on housing are considered to be of small significance when a small and not easily discernible change in housing availability occurs, generally as a result of a very small demand increase or a very large housing market. Increases in rental rates or housing values in these areas would be expected to equal or slightly exceed the statewide inflation rate. No extraordinary construction or conversion of housing would occur where small impacts are foreseen.

The impacts on housing are considered to be of moderate significance when there is a discernible, but short-lived reduction in available housing units because of project-induced in-migration. The impacts on housing are considered to be of large significance when project-related demand for housing units would result in very limited housing availability and would increase rental rates and housing values well above normal inflationary increases in the state.

Moderate and large impacts are possible at sites located in rural and remote areas, at sites located in areas that have experienced extremely slow population growth (and thus slow or no growth in housing), or where growth control measures that limit housing development are in existence or have been recently lifted. [NRC 1996, Section 3.7.2]

4.14.5 Analysis of Environmental Impact

Supplement 1 to Regulatory Guide 4.2, provides the following guidance.

Section 4.14.1 states, "If there will be no refurbishment or if refurbishment involves no additional workers then there will be no impact on housing and no further analysis is required."

Section 4.14.2 states, "If additional workers are not anticipated there will be no impact on housing and no further analysis is required."

As of June 2006 the site had approximately 1,255 full time workers (Entergy employees and baseline contractors) during normal plant operations. The majority of these employees live within a five-county area surrounding the plant. As discussed in [Section 2.9](#), steady growth in the

housing market has occurred in the five county area near the site since 1990. In addition, vacancy rates have reduced, while the total number of new housing units has increased. This increase has kept pace with the low-to-moderate growth in the area population.

As noted in [Section 3.3](#), there are no refurbishment activities required for the site license renewal. Additionally, Entergy does not anticipate a need for additional full time workers during the license renewal period.

4.14.6 Conclusion

Although the State of New York has growth control measures in place under New York's Open Space Conservation Plan, which is enforced by the Quality Communities Task Force, Entergy concludes that the impact on housing from the continued operation of the site will be SMALL and further mitigation is not warranted. This conclusion is based on the following:

- IP2 and IP3 are located in a high population area (see [Section 2.6.2](#)).
- There are no refurbishment activities required for license renewal at the site (see [Section 3.3](#)).
- Entergy does not anticipate an increase in employment during the license renewal period (see [Section 3.5](#)).
- Vacancy rates and new housing units have kept pace with low to moderate growth in the area's population (see [Section 2.9](#)).
- The number of the site employees will continue to be a very small percentage of the population in the adjacent counties during the period of the renewed license (see [Sections 2.6.1](#) and [3.5](#)).

4.15 Public Utilities: Public Water Supply Availability

4.15.1 Description of Issue

Public Services (public utilities).

4.15.2 Findings from Table B-1, Appendix B to Subpart A

SMALL or MODERATE. An increased problem with water shortages at some sites may lead to impacts of moderate significance on public water supply availability. See 10 CFR 51.53(c)(3)(ii)(I).

4.15.3 Requirement [10 CFR 51.53(c)(3)(ii)(I)]

The applicant shall provide an assessment of the impact of population increases attributable to the proposed project on the public water supply.

4.15.4 Background

Impacts on public utility services are considered small if little or no change occurs in the utility's ability to respond to the level of demand and thus there is no need to add capital facilities. Impacts are considered moderate if overtaxing of facilities during peak demand periods occurs. Impacts are considered large if existing service levels (such as the quality of water and sewage treatment) are substantially degraded and additional capacity is needed to meet ongoing demands for services.

In general, small to moderate impacts to public utilities were observed as a result of the original construction of the case study plants. While most locales experienced an increase in the level of demand for services, they were able to accommodate this demand without significant disruption. Water service seems to have been the most affected public utility.

Public utility impacts at the case study sites during refurbishment are projected to range from small to moderate. The potentially small to moderate impact at Diablo Canyon is related to water availability (not processing capacity) and would occur only if a water shortage occurs at refurbishment time.

Because the case studies indicate that some public utilities may be overtaxed during peak periods, the impacts to public utilities would be moderate in some cases, although most sites would experience only small impacts [NRC 1996, Section 3.7.4.5].

4.15.5 Analysis of Environmental Impact

As noted in [Section 3.3](#), there are no refurbishment activities required for the renewal of the IP2 and IP3 site Operating Licenses. In addition, Entergy does not anticipate a need for additional workers during the license renewal period. Therefore, there will be no impact to public utilities from refurbishment activities or additional plant workers.

[Table 2-12](#) provides details on the major community water suppliers in the area surrounding the plant site. For all systems, the current system capacities are above the average daily demand on the respective water systems.

Plant operations during the license renewal period are not projected to cause a noticeable effect on the local water supply. The Village of Buchanan, which provides potable water to the site, purchases water from the City of Peekskill and Northern Westchester Joint Water Works (NWJWW) public water supply systems.

As discussed in [Section 2.10.1](#) of this ER, the site purchases approximately 2,326,200 cubic feet (ft³) or 17,400,000 gallons per month of potable and process water from the Village of Buchanan water system. The Village of Buchanan purchases water from the City of Peekskill PWS and the NWJWW.

The City of Peekskill has two sources of water, both of which are surface waters. The City of Peekskill's year round major water source originates in the Town of Putnam Valley. The second

water source is an emergency source from a neighboring community, via the Catskill Aqueduct, which is a major source for the New York City water system. The City of Peekskill's system uses the Catskill Aqueduct and NWJWW as alternative sources of water supply to meet peak summer loads. The NWJWW has assumed ownership of the Amawalk treatment plant, which has been upgraded to a 7,000,000 gpd capacity. A new NWJWW 7,000,000 gpd plant (Catskill water treatment plant) has been in operation since 2000. The City of Peekskill PWS supplies 4,000,000 gpd of reliable high-quality potable water to residential and industrial customers in the area, via water that is pumped to the Camp Field reservoir, where it is then filtered and treated.

In addition, a 1,500,000 gallon water storage tank is maintained on-site to add reliability to the site's makeup water system. Therefore, the City of Peekskill water system, which is the source of water for the Village of Buchanan, should be able to meet the site's water demand in the foreseeable future.

4.15.6 Conclusion

License renewal operations will not cause appreciable or a noticeable increased demand on the public water supply system. As noted in [Section 3.3](#), there are no refurbishment activities required for the site's license renewal. Entergy also does not anticipate a need for additional workers during the license renewal period and, as a result, the levels of water usage at the plant site should remain consistent with the current pattern of water usage. In addition, the Village of Buchanan, via the City of Peekskill and NWJWW water systems, has water sources that can meet the demand of residential and industrial customers in the area (see [Table 2-12](#)). Therefore, impacts to public water supplies will continue to be SMALL during the IP2 and IP3 Operating License renewal period. Further consideration of mitigation measures is not warranted.

4.16 Education Impacts from Refurbishment

4.16.1 Description of Issue

Public Services (effects of refurbishment activities upon local educational system).

4.16.2 Findings from Table B-1, Appendix B to Subpart A

SMALL or MODERATE. Most sites would experience impacts of small significance but larger impacts are possible depending on site- and project-specific factors. See 10 CFR 51.53(c)(3)(ii)(I).

4.16.3 Requirement [10 CFR 51.53(c)(3)(ii)(I)]

An assessment of the impact of the proposed action on ... public schools (impacts from refurbishment activities only) within the vicinity of the plant must be provided.

4.16.4 Analysis of Environmental Impact

As noted in [Section 3.3](#), there are no refurbishment activities required for IP2 and IP3 license renewal. Therefore this issue is not applicable to the site and no further analysis is required.

4.17 Offsite Land Use—Refurbishment

4.17.1 Description of Issue

Offsite Land Use (effects of refurbishment activities).

4.17.2 Findings from Table B-1, Appendix B to Subpart A

SMALL or MODERATE. Impacts may be of moderate significance at plants in low population areas. See 10 CFR 51.53(c)(3)(ii)(I).

4.17.3 Requirement [10 CFR 51.53(c)(3)(ii)(I)]

An assessment of the impact of the proposed action on... land-use...(impacts from refurbishment activities only) within the vicinity of the plant must be provided.

4.17.4 Analysis of Environmental Impact

As noted in [Section 3.3](#), there are no refurbishment activities required for IP2 and IP3 license renewal. Therefore, there will be no impacts from refurbishment activities and no further analysis is required.

4.18 Offsite Land Use—License Renewal Term

4.18.1 Description of Issue

Offsite Land Use (effects of license renewal).

4.18.2 Findings from Table B-1, Appendix B to Subpart A

SMALL, MODERATE, or LARGE. Significant changes in land-use may be associated with population and tax revenue changes resulting from license renewal. See 10 CFR 51.53(c)(3)(ii)(I).

4.18.3 Requirement [10 CFR 51.53(c)(3)(ii)(I)]

An assessment of the impact of the proposed action on ...land-use...(impacts from refurbishment activities only) within the vicinity of the plant must be provided.

4.18.4 Background

During the license renewal term, new land use impacts could result from plant-related population growth or from the use of tax payments from the plant by local government to provide public services that encourage development.

However, as noted in Regulatory Guide 4.2, Section 4.17.2, Table B-1 of 10 CFR Part 51 partially misstates the conclusion reached in Section 4.7.4.2 of NUREG-1437. NUREG-1437,

Section 4.7.4.2 concludes that "population-driven land use changes during the license renewal term at all nuclear plants will be small." Regulatory Guide 4.2 further states that "Until Table B-1 is changed, applicants only need cite NUREG-1437 to address population-induced land-use change during the license renewal term."

The assessment of new tax-driven land use impacts in the GEIS considered the following:

- (1) the size of the plant's tax payments relative to the community's total revenues,
- (2) the nature of the community's existing land use pattern, and
- (3) the extent to which the community already has public services in place to support and guide development.

In general, if the plant's tax payments are projected to be small relative to the community's total revenue, new tax-driven land use changes during the plant's license renewal term would be small, especially where the community has pre-established patterns of development and has provided adequate public services to support and guide development. If the plant's tax payments were projected to be medium to large relative to the community's total revenue, new tax-driven land use changes would be moderate.

This is most likely to be true where the community has no pre-established patterns of development (i.e., land use plans or controls) or has not provided adequate public services to support and guide development in the past, especially infrastructure that would allow industrial development. If the plant's tax payments are projected to be a dominant source of the community's total revenue, new tax-driven land use changes would be large. This would be especially true where the community has no pre-established pattern of development or has not provided adequate public services to support and guide development in the past.

Based on predictions for the case study plants, it is projected that all new population-driven land use changes during the license renewal term at all nuclear plants will be small because population growth caused by license renewal will represent a much smaller percentage of the local area's total population than has operations-related growth. In addition, any conflicts between offsite land use and nuclear plant operations are expected to be small. In contrast, it is projected that new tax-driven land use changes may be moderate at a number of sites and large at some others. Because land use changes may be perceived by some community members as adverse and by others as beneficial, the staff is unable to assess generically the potential significance of site-specific off-site land use impacts [NRC 1996, Section 4.7.4.2].

4.18.5 Analysis of Environmental Impact

The environmental impacts from this issue are from population-driven land use changes and from tax-driven land use changes.

4.18.5.1 Population-Driven Land Use Changes

Entergy agrees with the GEIS conclusion that new population-driven land use changes at the site during the license renewal term will be SMALL [NRC 1996, Section 4.7.4.2]. Entergy does not anticipate that additional workers will be employed at the site during the license renewal period. Therefore, there will be no adverse impact resulting from population driven land use changes associated with license renewal.

4.18.5.2 Tax-Driven Land Use Changes

All payments paid to local governments lie within Westchester County. Because there are no refurbishment activities and no new construction as a result of license renewal, no new sources of plant-related tax payments are expected that could significantly influence land use in Westchester County. During the license renewal term, however, new land-use impacts could result from the use by local governments of the tax revenue paid by Entergy for the assessed value of the site. As discussed in [Section 2.7](#), Entergy paid the Village of Buchanan, which is located within Westchester County, a total of approximately \$1.9 million in property taxes in 2005. In addition, the facility paid \$19.2 million in PILOT, property taxes, and other taxes to the Town of Cortlandt, Verplanck Fire District, Westchester County, and the Hendrick Hudson Central School District, and Lakeland School District.

Westchester County has experienced relatively low population growth (see Table 2-6) and limited land-use changes since 1992 (See Section 2.8). Although recent population growth is not directly related to the presence of the site, continued growth could be affected by the economic benefit of the plant on local schools, roads, and community services. Tax receipts from the site are a significant portion of revenue to local government. This revenue likely provides for a higher level of public infrastructure and services than would otherwise be possible. This enhances the county's attractiveness as a place to live and could contribute to overall growth of the area and the conversion of open space and woodlands to residential and commercial uses.

Although the taxes paid by the site represents a significant portion of local tax revenues, the impacts from tax driven off-site land use changes is expected to be small because the area around the site has

- pre-established land-use patterns of development that are anticipated to continue during the license renewal term and
- public services and regulatory controls are in place to support and guide land use and development.

4.18.6 Conclusion

Entergy agrees with the GEIS conclusion that new population-driven land use changes at the site during the license renewal term will be SMALL. Entergy does not anticipate that additional workers will be employed at the site during the license renewal period. Therefore, there will be no

adverse impact to the offsite land use from additional plant workers and mitigation measures are not warranted.

In addition, the impact to tax-driven land use changes from the continued payment of PILOT and property taxes from IP2 and IP3 is expected to be SMALL due to pre-established land use patterns and controls to guide land use development. Therefore, mitigation measures are not warranted.

4.19 Transportation

4.19.1 Description of Issue

Public services, Transportation

4.19.2 Findings from Table B-1, Appendix B to Subpart A

SMALL, MODERATE, or LARGE. Transportation impacts (level of service) of highway traffic generated during the term of the renewed license are generally expected to be of small significance. See 10 CFR 51.53(c)(3)(ii)(J).

4.19.3 Requirement [10 CFR 51.53(c)(3)(ii)(J)]

All applicants shall assess the impact of highway traffic generated by the proposed project on the level of service of local highways during periods of license renewal refurbishment activities and during the term of the renewed license.

4.19.4 Background

Transportation impacts would continue to be of small significance at all sites during operations and would be of small or moderate significance during scheduled refueling and maintenance outages. Because impacts are determined primarily by road conditions existing at the time of the project and cannot be easily forecasted, a site specific review will be necessary to determine whether impacts are likely to be small or moderate and whether mitigation measures may be warranted [NRC 1996, Section 4.7.3.2].

4.19.5 Analysis of Environmental Impact

As there are no refurbishment activities required for the license renewal period and no expected increase in total number of employees that will be on-site at IP2 and IP3 during the same period, impacts to transportation during the license renewal term would be similar to those experienced during current operations and would be dictated by the workers currently involved in plant operations. As of June 2006, the site employed 1,255 workers during normal operations (see [Section 3.5](#)). An additional 950 workers may be present at the facility during refueling outages.

Traffic volumes for the area were obtained from the Westchester County Public Works Department, Division of Traffic Engineering. A 2002 traffic count [[WCPWD](#)] provided traffic data along Broadway from Kings Ferry Road to Buchanan Village. Peak counts both northbound and

southbound occurred at 8:00 a.m., 11:00 a.m., and 5:00 p.m. during the count period with traffic counts ranging between 102 to 151 vehicles per hour during these time periods. Review of those counts on Broadway outside the plant entrances during the week of September 16, 2002, indicates traffic begins to increase at 6:00 a.m., is relatively stable throughout the day with the peaks cited above, before beginning to taper off after 8:00 p.m.

Traffic volume was slightly higher in the southbound direction than for the northbound direction. A daily average total of 1,746 vehicles per day use Broadway outside the plant for the northbound direction. This compares to an average of 1,837 vehicle counts per day in the southbound lane [WCPWD].

This count did not include temporary traffic increases due to annual outages at the site. The site generally schedules its outages in the spring, and may have an average of approximately 950 temporary workers on-site for the duration of the outage. Peak traffic during outages would be expected to be leaving and entering the site from 5:30 to 7:00 a.m. and from 6:30 to 8:00 p.m. Compensating measures, such as staggered shift starting and quitting times, have been taken by the site to account for the increased traffic flow during outages to maintain a reasonable level of service.

Traffic performance is generally defined in the qualitative term of level of service (LOS), which describes operational traffic conditions as perceived by motorists. New York performs LOS determinations for major highways, but does not perform such determinations for smaller state routes or local roads. Available traffic count information, as provided in [Table 2-13](#) of this ER, shows generally increasing traffic volumes on Route 9 and 9A, but is unrelated to traffic from Indian Point. License renewal activities are not expected to increase the volume of traffic or affect the current highway LOS around the site, including Bleakley Avenue, Broadway, and US Highway 9. Therefore, traffic patterns around the site are not anticipated to be affected by plant operations during the license renewal period.

4.19.6 Conclusion

As noted in [Section 3.3](#), there are no refurbishment activities required for IP2 and IP3 license renewal and no expected increases in the total number of employees that will be on-site during the license renewal period. Compensating measures, such as staggered shift starting and ending times, have been taken by the site to account for the increased traffic flow during outages to maintain a reasonable level of service. Therefore, impacts on local traffic will be SMALL and further mitigation measures are not warranted.

4.20 Historic and Archaeological Properties

4.20.1 Description of Issue

Historic and Archaeological Resources

4.20.2 Finding from Table B-1, Appendix B to Subpart A

SMALL, MODERATE, or LARGE. Generally plant refurbishment and continued operation are expected to have no more than small adverse impacts on historic and archaeological resources. However, the National Historic Preservation Act requires the federal agency to consult with the State Historic Preservation Officer (SHPO) to determine whether there are properties present that require protection. See 10 CFR 51.53 (c)(3)(ii)(K).

4.20.3 Requirement [10 CFR 51.53(c)(3)(ii)(K)]

All applicants shall assess whether any historic or archaeological properties will be affected by the proposed project.

4.20.4 Background

It is unlikely that moderate or large impacts to historic resources would occur at any site unless new facilities or service roads are constructed or new transmission lines are established.

The identification of historic resources and determination of possible impacts to them must be done on a site-specific basis through consultation with the SHPO. The site-specific nature of historic resources and the mandatory National Historic Preservation Act consultation process mean that the significance of impacts to historic resources and the appropriate mitigation measures to address those impacts cannot be determined generically [NRC 1996, Section 3.7.7].

4.20.5 Analysis of Environmental Impact

As discussed in [Section 3.3](#), there are no refurbishment activities required for the IP2 and IP3 license renewal. Therefore, no further analysis is required with respect to refurbishment activities.

No aboveground prehistoric or historic archaeological sites eligible for listing or listed on the NRHP or NYRHP are located on the site. In addition, Entergy has no plans to alter its operations on the site, expand existing facilities, or disturb additional land in support of license renewal. Therefore, renewal of the license would result in no adverse impacts to any archaeological sites.

Seventy percent of the land within a 6-mile radius of the site is classified as archaeologically sensitive, which means that NRHP-eligible and listed archaeological sites (prehistoric and historic) are present. Because these archaeological sites and their artifact contents are buried beneath soil, adverse impacts would occur only as a result of soil intrusive activities. Entergy has no plans to conduct such soil intrusive activities at any location outside of the site boundaries or outside its transmission line corridors under a renewed license (transmission lines extend only to the Buchanan Substation located due east across Broadway). Therefore, renewal of the license would result in no adverse impacts to archaeological sites located outside of the site.

No aboveground historic sites eligible for listing or listed on the NRHP or NYRHP are located within the current operational areas of the site. In addition, Entergy has no plans to alter its operations on the site, expand existing facilities, or disturb additional land in support of license renewal. Also the Phase 1A Survey discussed in Section 2.12 of this ER identified that the site had been previously heavily surface mined and that no cultural resources are expected to remain. Therefore, renewal of the license would result in no adverse impacts to such aboveground historical sites on the site or in its transmission line corridors.

Hundreds of eligible and listed aboveground historic sites are present in the vicinity (6-mile radius) of the site. Such historic properties are susceptible to any substantial force that could degrade their physical or historical integrity. Physical integrity refers to the structural condition (or soundness) of a historic property such as a house. The physical integrity of a historic site can be affected by the nearby operation of heavy equipment or by vibrations from the detonation of explosives. Historical integrity is the ability of a property to convey its significance to the public by virtue of its location, design, setting, materials, workmanship, feeling, and association (36 CFR 60.4). The historical integrity of a site can be adversely impacted by factors such as noise. It can also be degraded when an original and historically enhancing visual setting is intruded upon by more recent structures that detract from this setting and the historical feel of the property.

The Indian Point site was for many years a commercial amusement area operated by the Hudson River Day Line prior its acquisition by the original owners of Indian Point for construction of IP1. As discussed in [Section 2.12](#), construction activity at the site revealed no evidence of items having archaeological value. The IP2 Final Environmental Statement (FES) stated that most of the sites at Indian Point spared by construction or other modern activities have been heavily molested by relic collectors over a very long period and relatively few have received attention from competent archaeologists [[USAEC](#), Section II.D]. No other indication of important archaeological activity in the general area has been located. Thus, the Indian Point site probably contains no valuable prehistoric archaeological deposits.

IP2 and IP3 plant operations and associated transmission lines produce no intense vibrations or other substantial physical forces that would adversely impact historic properties located outside of the site property and transmission line corridors. In addition, IP2 and IP3 and the associated facilities produce little noise. Although it is highly visible on the Hudson River side, the site blends with developed areas to the west of the plant. The nearest historic property is located more than 1 mile from the site [[NYSHPO](#)]. As a result of the site's distance from historic properties and its location adjacent to a developed area, impacts on the physical and historical integrity of such sites would be expected to be small.

Although not anticipated, in the event that any excavation is required to be performed at the site, the ground disturbing activity would be reviewed in accordance with Entergy Nuclear fleet procedures EN-IS-112 (Trenching, Excavation and Ground Penetrating Activities) and EN-EV-121 (Cultural Resources Protection Plan). These procedures ensure that investigations and consultations are conducted as needed, and that existing or potentially existing cultural

resources are adequately protected in order to assist Entergy in meeting state and federal expectations.

4.20.6 Conclusion

No refurbishment activities are required for license renewal at IP2 and IP3. There are also no plans to alter operations, expand existing facilities, or disturb additional land in support of license renewal. In addition as discussed in [Section 4.20.5](#) above, no historic properties such as NRHP-eligible or listed archaeological sites or aboveground historical sites would be affected by operation of the plant during the license renewal period. Therefore, under a renewed license, the potential impacts on historic properties from continued operation of IP2 and IP3 would be SMALL and further mitigation measures are not warranted.

4.21 Severe Accident Mitigation Alternatives

4.21.1 Description of Issue

Severe accidents

4.21.2 Finding from Table B-1, Appendix B to Subpart A

SMALL. The probability weighted consequences of atmospheric releases, fallout onto open bodies of water, releases to ground water, and societal and economic impacts from severe accidents are small for all plants. However, alternatives to mitigate severe accidents must be considered for all plants that have not considered such alternatives. See 10 CFR 51.53(c)(3)(ii)(L).

4.21.3 Requirement [10 CFR 51.53(c)(3)(ii)(L)]

If the staff has not previously considered severe accident mitigation alternatives for the applicant's plant in an environmental impact statement or related supplement or in an environmental assessment, a consideration of alternatives to mitigate severe accidents must be provided.

4.21.4 Background

The staff concluded that the generic analysis summarized in the GEIS applies to all plants and that the probability-weighted consequences of atmospheric releases, fallout onto open bodies of water, releases to ground water, and societal and economic impacts of severe accidents are of small significance for all plants. However, not all plants have performed a site-specific analysis of measures that could mitigate severe accidents. Consequently, severe accidents are a Category 2 issue for plants that have not performed a site-specific consideration of severe accident mitigation and submitted that analysis for Commission review [[NRC 1996, Section 5.5.2.5](#)].

4.21.5 Analysis of Environmental Impact

The method used to perform the SAMA analysis was based on the handbook used by the NRC to analyze benefits and costs of its regulatory activities [NRC 1997].

Environmental impact statements and environmental reports are prepared using a sliding scale in which impacts of greater concern and mitigation measures of greater potential value receive more detailed analysis than impacts of less concern and mitigation measures of less potential value. Accordingly, Entergy used less detailed feasibility investigation and cost estimation techniques for SAMA candidates having disproportionately high costs and low benefits and more detailed evaluations for the most viable candidates.

The following is a brief outline of the approach taken in the SAMA analysis.

(1) Establish the Baseline Impacts of a Severe Accident

Severe accident impacts were evaluated in four areas:

- Off-site exposure costs: Monetary value of consequences (dose) to off-site population.

The Probabilistic Safety Assessment (PSA) model was used to determine total accident frequency (core damage frequency (CDF) and containment release frequency). The Melcor Accident Consequences Code System 2 (MACCS2) was used to convert release input to public dose. Dose was converted to present worth dollars (based on a valuation of \$2,000 per person-rem [NRC 1997] and a present worth discount rate of 7 percent).

- Off-site economic costs: Monetary value of damage to off-site property.

The PSA model was used to determine total accident frequency (CDF and containment release frequency). MACCS2 was used to convert release input to off-site property damage. Off-site property damage was converted to present worth dollars based on a discount rate of 7 percent.

- On-site exposure costs: Monetary value of dose to workers.

Best estimate occupational dose values were used for immediate and long-term dose. Dose was converted to present worth dollars (based on a valuation of \$2,000 per person-rem and a present worth discount rate of 7 percent).

- On-site economic costs: Monetary value of damage to on-site property.

Best estimate cleanup and decontamination costs were used. On-site property damage estimates were converted to present worth dollars based on a discount rate of 7%. It was assumed that, subsequent to a severe accident, the plant would be decommissioned rather than restored. Therefore replacement/refurbishment costs were not included in on-site costs. Replacement power costs were considered.

(2) Identify SAMA Candidates

Potential SAMA candidates were identified from the following sources (see Attachments [E.1](#) and [E.3](#) for reference details):

- Severe Accident Mitigation Design Alternative (SAMDA) analyses submitted in support of original licensing activities for other operating nuclear power plants and advanced light water reactor plants, including the evolutionary Westinghouse Advanced Pressurized Water Reactor (AP 600 and AP 1000) designs;
- SAMA analyses for other PWR plants;
- NRC and industry documentation discussing potential plant improvements;
- IP2 and IP3 Individual Plant Examination (IPE) of internal and external event reports and their updates. In these reports, several enhancements related to severe accident insights were recommended and implemented; and
- IP2 and IP3 PSA model risk significant contributors.

(3) Phase I: Preliminary Screening

Potential SAMA candidates for each unit were screened out if they modified features not applicable to the unit, if they had already been implemented at the unit, or if they were similar in nature and could be combined with another SAMA candidate to develop a more comprehensive or plant-specific SAMA candidate.

(4) Phase II: Final Screening and Cost Benefit Evaluation

The remaining SAMA candidates were evaluated individually to determine the benefits and costs of implementation, as follows.

- The total benefit of implementing a SAMA candidate was estimated in terms of averted consequences (benefits estimate).
 - The baseline PSA model was modified to reflect the maximum benefit of the improvement. Generally, the maximum benefit of a SAMA candidate was determined with a bounding modeling assumption. For example, if the objective of the SAMA candidate was to reduce the likelihood of a certain failure mode, then eliminating the failure mode from the PSA would bound the benefit, even though the SAMA candidate would not be expected to be 100% effective in eliminating the failure. The modified model was then used to produce a revised accident frequency.
 - Using the revised accident frequency, the method previously described for the four baseline severe accident impact areas was used to estimate the cost

associated with each impact area following implementation of the SAMA candidate.

- The benefit in terms of averted consequences for each SAMA candidate was then estimated by calculating the arithmetic difference between the total estimated cost associated with all four impact areas for the baseline plant design and the revised plant design following implementation of the SAMA candidate.
- The cost of implementing a SAMA was estimated by one of the following methods (cost estimate).
 - An estimate for a similar modification considered in a previously performed SAMA analysis was used. These estimates were developed in the past and no credit was taken for inflation when applying them to IP2 and IP3.
 - Engineering judgment on the cost associated with procedural changes, engineering analysis, testing, training and hardware modification was applied to formulate a conclusion regarding the economic viability of the SAMA candidate.

The detail of the cost estimate was commensurate with the benefit. If the benefit was low, it was not necessary to perform a detailed cost estimate to determine if the SAMA was cost beneficial.

(5) Sensitivity Analyses

Three sensitivity analyses were conducted to gauge the impact of key assumptions upon the analysis. The first sensitivity analysis was to investigate the sensitivity of assuming a 26-year period for remaining plant life for IP2 (i.e., six years on the original plant license plus the 20-year license renewal period), and a 28-year period for remaining plant life for IP3 (i.e., eight years on the original plant license plus the 20-year license renewal period). The second sensitivity analysis was to investigate the sensitivity of each analysis case to the discount rate of 3 percent. The third sensitivity analysis was to investigate impacts resulting from economic losses due to tourism and business, which were not included in the base case.

The SAMA analysis for IP2 and IP3 is presented in the following sections. Attachments [E.1](#), [E.2](#), [E.3](#), and [E.4](#) provide a more detailed discussion of the process presented above.

4.21.5.1 Establish the Baseline Impacts of a Severe Accident

A baseline for each unit was established to enable estimation of the risk reductions attributable to implementation of potential SAMA candidates. These severe accident risks were estimated using the IP2 and IP3 PSA models and the MACCS2 consequence analysis software code. The PSA models used for the SAMA analysis (IP2 PSA Revision 1, April 2007, and IP3 PSA Revision 2, April 2007) are internal events risk models.

4.21.5.1.1 The PSA Internal Events Model: Level 1 and Level 2 Analysis

The PSA models (Level 1 and Level 2) used for the SAMA analysis were the most recent internal events risk models for IP2 and IP3.

The IP2 PSA model is a complete updated version of the model used in the 1992 IPE and reflects the IP2 configuration and design as of December 2005. It uses component failure and unavailability data as of December 2005, and resolves all findings and observations from the industry peer reviews conducted in May 2002 and July 2005.

The IP3 PSA model is a complete updated version of the model used in the 1994 IPE and reflects the IP3 configuration and design as of December 2005. It uses component failure and unavailability data as of December 2005, and resolves all findings and observations from the industry peer review of the model conducted in January 2001.

Both the IP2 and IP3 PSA models adopt the small event tree / large fault tree approach and use the CAFTA code for quantifying CDF.

An uncertainty analysis associated with internal events CDF was performed. The ratio of the CDF at the 95th percent confidence level to the mean CDF is a factor of 2.10 for IP2 and 1.40 for IP3. This analysis is presented in Sections [E.1.1](#) and [E.3.1](#) of Attachment E.

The IP2 and IP3 Level 2 analysis uses a Containment Event Tree (CET) to analyze all core damage sequences identified in the Level 1 analysis. The CET evaluates systems, operator actions, and severe accident phenomena in order to characterize the magnitude and timing of radionuclide release. The result of the Level 2 analysis is a list of sequences involving radionuclide release, along with the frequency and magnitude/timing of release for each sequence.

4.21.5.1.2 The PSA External Events Model: Individual Plant Examination of External Events (IPEEE) Model

The IP2 and IP3 IPEEE models were reviewed and used for SAMA analysis. The seismic portion of the IPEEE was completed in conjunction with the Seismic Qualification Utility Group (SQUG) program. Both IP2 and IP3 performed a seismic Probabilistic Risk Assessment (PRA) following the guidance of NUREG-1407, *Procedural and Submittal Guidance for the Individual Plant Examination of External Events (IPEEE) for Severe Accident Vulnerabilities*, June 1991. A number of plant improvements were identified and, as described in NUREG-1742, *Perspectives Gained from the IPEEE Program*, Final Report, April 2002, these improvements were implemented.

The IP2 fire analysis was performed using the conservative EPRI Fire Induced Vulnerability Evaluation (FIVE) methodology for initial screening of fire zones. Unscreened fire zones were then analyzed in more detail using a fire PRA approach. The end result of IP2 IPEEE fire analysis identified the CDF for significant fire areas. A number of administrative procedures were revised to improve combustible and flammable material control.

The IP3 fire analysis was performed using the EPRI PRA Implementation Guide for quantitative screening of fire areas and for fire analysis of areas that did not screen. The fire analysis utilized the PSA internal event models to address fire induced initiators and equipment failure modes. A number of plant improvements were identified and are described in NUREG-1742, *Perspectives Gained from the IPEEE Program*, Final Report, April 2002. These improvements have been implemented. In addition, a number of administrative procedures were revised to improve combustible and flammable material control.

The IP2 and IP3 IPEEE submittals, in addition to the internal fires and seismic events, examined a number of other external hazards.

- High Winds and /Tornadoes
- External Flooding
- Ice, Hazardous Chemical, Transportation and Nearby Facility Incidents

In consequence of this external hazards evaluation, a number of plant modifications have been implemented at IP2, as identified in Table 4.1 of NUREG-1742, *Perspectives Gained from the IPEEE Program*, Final Report, April 2002. One high winds, floods and other external events related plant modification at IP3 has been proposed for Phase II evaluation (Phase II SAMA 053).

4.21.5.1.3 MACCS2 Model: Level 3 Analysis

A "Level 3" model was developed using the MACCS2 consequence analysis software code to estimate the hypothetical impacts of severe accidents on the surrounding environment and members of the public. The principal phenomena analyzed were atmospheric transport of radionuclides; mitigation actions (i.e., evacuation, condemnation of contaminated crops and milk) based on dose projection; dose accumulation by a number of pathways, including food and water ingestion; and economic costs. Input for the Level 3 analysis included the core radionuclide inventory, source terms from the IP2 and IP3 PSA models, site meteorological data, projected population distribution (within 50-mile radius) for the year 2034, emergency response evacuation modeling, and economic data. The MACCS2 input data are described in Sections [E.1.5](#) and [E.3.5](#) of Attachments E.1 and E.3.

4.21.5.1.4 Evaluation of Baseline Severe Accident Impacts Using the Regulatory Analysis Technical Evaluation Handbook Method

This section describes the method used for calculating the cost associated with each of the four impact areas for the baseline case (i.e., without SAMA implementation). This following analysis was used to establish the maximum benefit that a SAMA could achieve if it eliminated all risk due to IP2 or IP3 at-power internal events.

Off-site Exposure Costs

The Level 3 baseline analysis resulted in an annual off-site exposure risk of 22 person-rem for IP2 and 24.5 person-rem for IP3. This value was converted to its monetary equivalent (dollars) via application of the \$2,000 per person-rem conversion factor from the Regulatory Analysis Technical Evaluation Handbook [NRC 1997]. This monetary equivalent was then discounted to present value using the formula from the same source:

$$APE = (F_S D_{P_S} - F_A D_{P_A}) R \frac{1 - e^{-rt_f}}{r}$$

where,

APE = monetary value of accident risk avoided from population doses, after discounting;

R = monetary equivalent of unit dose, (\$/person-rem);

F = accident frequency (events/year);

D_P = population dose factor (person-rem/event);

S = status quo (current conditions);

A = after implementation of proposed action;

r = discount rate (%); and

t_f = license renewal period (years).

IP2

Using a 20-year license renewal period, a 7% discount rate, assuming F_A is zero, and the baseline CDF of 1.79E-05/ry resulted in the monetary equivalent value of \$473,568. This value is presented in [Table 4-3](#).

IP3

Using a 20-year license renewal period, a 7% discount rate, assuming F_A is zero, and the baseline CDF of 1.15E-05/ry resulted in the monetary equivalent value of \$527,382. This value is presented in [Table 4-3](#).

Off-site Economic Costs

The Level 3 baseline analysis resulted in an annual off-site economic risk monetary equivalent of \$44,900 for IP2 and \$52,800 for IP3. This value was discounted in the same manner as the public health risks in accordance with the following equation:

$$AOC = \left(F_S P_{D_S} - F_A P_{D_A} \right) \frac{1 - e^{-rt_f}}{r}$$

where

AOC = monetary value of risk avoided from off-site property damage, after discounting;

P_D = off-site property loss factor (\$/event);

F = accident frequency (events/year);

S = status quo (current conditions);

A = after implementation of proposed action;

r = discount rate (%); and

t_f = license renewal period (years).

Using previously defined values; the resulting monetary equivalent is \$483,254 for IP2 and \$568,281 for IP3. This value is presented in [Table 4-3](#).

On-site Exposure Costs

The values for occupational exposure associated with severe accidents were not derived from the PSA model, but from information in the *Regulatory Analysis Technical Evaluation Handbook* [NRC 1997]. The values for occupational exposure consist of "immediate dose" and "long-term dose." The best estimate value provided for immediate occupational dose is 3,300 person-rem, and long-term occupational dose is 20,000 person-rem (over a 10 year clean-up period). The following equations were used to estimate monetary equivalents.

Immediate Dose

$$W_{IO} = (F_S D_{IO_S} - F_A D_{IO_A}) R \frac{1 - e^{-rt_f}}{r} \quad (1)$$

where

W_{IO} = monetary value of accident risk avoided from immediate doses, after discounting;

IO = immediate occupational dose;

R = monetary equivalent of unit dose, (\$/person-rem);

F = accident frequency (events/year);

D_{IO} = immediate occupational dose (person-rem/event);

S = status quo (current conditions);

A = after implementation of proposed action;

r = discount rate (%); and

t_f = license renewal period (years).

The values used in the analysis were:

R = \$2,000/person-rem;

r = 0.07;

D_{IO} = 3,300 person-rem /accident; and

t_f = 20 years.

For the basis discount rate, assuming F_A is zero, the bounding monetary value of the immediate dose associated with accident risk is:

$$W_{IO} = (F_S D_{IO_S}) R \frac{1 - e^{-rt_f}}{r}$$

$$W_{IO} = 3300 \cdot F_S \cdot \$2000 \cdot \frac{1 - e^{-(0.07 \cdot 20)}}{0.07}$$

$$W_{IO} = (\$7.10 \times 10^7) F_S$$

IP2

For the baseline CDF, $1.79 \times 10^{-5}/\text{ry}$,

$$W_{IO} = \$1,272$$

IP3

For the baseline CDF, $1.15 \times 10^{-5}/\text{ry}$,

$$W_{IO} = \$817$$

Long Term Dose

$$W_{LTO} = (F_S D_{LTO_S} - F_A D_{LTO_A}) R \cdot \frac{1 - e^{-rt_f}}{r} \cdot \frac{1 - e^{-rm}}{rm} \quad (2)$$

where

W_{LTO} = monetary value of accident risk avoided long term doses, after discounting (\$);

LTO = long-term occupational dose;

m = years over which long-term doses accrue;

R = monetary equivalent of unit dose (\$/person-rem);

F = accident frequency (events/year);

D_{LTO} = long-term occupational dose (person-rem/event);

S = status quo (current conditions);

A = after implementation of proposed action;

r = discount rate (%); and

t_f = license renewal period (years).

The values used in the analysis were

R = \$2,000/person-rem;

r = 0.07;

D_{LTO} = 20,000 person-rem /accident;

m = 10 years; and

t_f = 20 years.

For the basis discount rate, assuming F_A is zero, the bounding monetary value of the long term dose associated with accident risk is:

$$W_{LTO} = (F_S D_{LTO_S}) R \cdot \frac{1 - e^{-rt_f}}{r} \cdot \frac{1 - e^{-rm}}{rm}$$

$$W_{LTO} = (F_S \times 20,000) \$2000 \cdot \frac{1 - e^{-0.07 \cdot 20}}{0.07} \cdot \frac{1 - e^{-0.07 \cdot 10}}{0.07 \cdot 10}$$

$$W_{LTO} = (\$3.10 \times 10^8) F_S$$

IP2

For the baseline CDF, 1.79×10^{-5} /ry,

$$W_{LTO} = \$5,542$$

IP3

For the baseline CDF, 1.15×10^{-5} /ry,

$$W_{LTO} = \$3,560$$

Total Occupational Exposures

Combining equations (1) and (2) above, using delta (Δ) to signify the difference in accident frequency resulting from the proposed actions, and using the above numerical values, the long-term accident related on-site (occupational) exposure avoided is:

$$AOE = \Delta W_{IO} + \Delta W_{LTO} \quad (\$)$$

where

AOE = on-site exposure avoided.

The bounding value for occupational exposure (AOE_B) is

IP2

$$AOE_B = W_{IO} + W_{LTO} = \$1,272 + \$5,542 = \$6,814.$$

IP3

$$AOE_B = W_{IO} + W_{LTO} = \$817 + \$3,560 = \$4,377.$$

The resulting monetary equivalent of \$6,814 for IP2 and \$4,377 for IP3 is presented in [Table 4-3](#).

On-site Economic Costs

Clean up/Decontamination

The total cost of clean up/decontamination of a power reactor facility subsequent to a severe accident is estimated in the *Regulatory Analysis Technical Evaluation Handbook* [NRC 1997] to be $\$1.5 \times 10^9$; this same value was adopted for these analyses. Considering a 10-year cleanup period, the present value of this cost is:

$$PV_{CD} = \left(\frac{C_{CD}}{m} \right) \left(\frac{1 - e^{-rm}}{r} \right)$$

where

PV_{CD} = present value of the cost of cleanup/decontamination;

CD = clean-up/decontamination;

C_{CD} = total cost of the cleanup/decontamination effort, (\$);

m = cleanup period (years); and

r = discount rate (%).

Based upon the values previously assumed,

$$PV_{CD} = \left(\frac{\$1.5E + 9}{10} \right) \left(\frac{1 - e^{-0.07 \cdot 10}}{0.07} \right)$$

$$PV_{CD} = \$1.08E + 9$$

This cost is integrated over the term of the proposed license renewal as follows:

$$U_{CD} = PV_{CD} \frac{1 - e^{-rt_f}}{r}$$

where,

U_{CD} = total cost of clean up/decontamination over the life of the plant.

Based upon the values previously assumed,

$$U_{CD} = \$1.16E + 10$$

Replacement Power Costs

Replacement power costs were estimated in accordance with the *Regulatory Analysis Technical Evaluation Handbook* [NRC 1997]. Since replacement power will be needed for the time period following a severe accident for the remainder of the expected generating plant life, long-term power replacement calculations have been used. The present value of replacement power was estimated as follows:

$$PV_{RP} = \left(\frac{\$1.2 \times 10^8}{r} \right) \left(1 - e^{-rt_f} \right)^2$$

where

PV_{RP} = present value of the cost of replacement power for a single event;

t_f = license renewal period (years); and

r = discount rate (%).

The $\$1.2 \times 10^8$ value has no intrinsic meaning, but is a substitute for a string of non-constant replacement power costs that occur over the lifetime of a "generic" reactor after an event. This equation was developed in the *Regulatory Analysis Technical Evaluation Handbook* [NRC 1997] for discount rates between 5% and 10% only.

Based upon the values previously assumed:

$$PV_{RP} = \left(\frac{\$1.2 \times 10^8}{r} \right) \left(1 - e^{-rt_f} \right)^2 = \left(\frac{\$1.2 \times 10^8}{0.07} \right) \left(1 - e^{-(0.07)20} \right)^2 = \$9.73 \times 10^8$$

To account for the entire lifetime of the facility, U_{RP} was then calculated from PV_{RP} as follows:

$$U_{RP} = \frac{PV_{RP}}{r} \left(1 - e^{-rt_f} \right)^2$$

where

U_{RP} = present value of the cost of replacement power over the remaining life;

t_f = license renewal period (years); and

r = discount rate (%).

Based upon the values previously assumed,

$$U_{RP} = \frac{PV_{RP}}{r} \left(1 - e^{-rt_f} \right)^2 = \frac{\$9.73 \times 10^8}{0.07} \left(1 - e^{(-0.07)(20)} \right)^2 = \$7.89 \times 10^9$$

Since net generation can be based on plant demands, a power level of 1071 MWe, which reflects typical gross generation levels, was used to conservatively bound the net generated power that would need to be replaced at either IP2 or IP3. After applying a correction factor to account for the difference in typical gross generation levels between IP2/IP3 and the generic reactor described in the *Regulatory Analysis Technical Evaluation Handbook* [NRC 1997] (i.e., 1071 MWe/910 MWe), the value of U_{RP} becomes 9.29×10^9 .

Total On-site Property Damage Costs

Combining the cleanup/decontamination and replacement power costs, using delta (ΔF) to signify the difference in accident frequency resulting from the proposed actions, and using the above numerical values, the best-estimate value of averted occupational exposure can be expressed as:

$$AOSC = \Delta F(U_{CD} + U_{RP}) = \Delta F(\$1.16 \times 10^{10} + \$9.29 \times 10^9) = \Delta F(\$2.09 \times 10^{10})$$

where

ΔF = difference in annual accident frequency resulting from the proposed action

IP2

For the baseline CDF, $1.79 \times 10^{-5}/\text{ry}$,

$$AOSC = \$374,303$$

IP3

For the baseline CDF, $1.15 \times 10^{-5}/\text{ry}$,

$$AOSC = \$240,475$$

The resulting monetary equivalent of \$374,303 for IP2 and \$240,475 for IP3 is presented in [Table 4-3](#).

**Table 4-3
 Estimated Present Dollar Value Equivalent of Internal Events CDF at
 IP2 and IP3**

Parameter	IP2 Present Dollar Value (\$)	IP3 Present Dollar Value (\$)
Off-site population dose	\$473,568	\$527,382
Off-site economic costs	\$483,254	\$568,281
On-site dose	\$6,814	\$4,377
On-site economic costs	\$374,303	\$240,475
Total	\$1,337,939	\$1,340,515

4.21.5.2 Identify SAMA Candidates

Based on a review of industry documents, an initial list of SAMA candidates was identified. Since IP2 and IP3 are typical pressurized water nuclear power reactors, considerable attention was paid to the SAMA candidates from SAMA analyses for other pressurized water plants. Attachments [E.2](#) and [E.4](#) list the specific documents from which SAMA candidates were initially gathered.

In addition to SAMA candidates identified from the review of industry documents, additional SAMA candidates were obtained from plant-specific sources, such as the IP2 and IP3 IPE and IPEEE. Several enhancements from the IP2 and IP3 IPE and IPEEE related to severe accident insights were recommended and implemented. These enhancements were included in the comprehensive list of SAMA candidates for IP2 and IP3 and were verified to have been implemented during preliminary screening.

In addition, the IP2 and IP3 updated PSA models were used to identify plant-specific modifications for inclusion in the comprehensive lists of SAMA candidates. The risk significant terms from the PSA level 1 and level 2 models were reviewed for similar failure modes and effects that could be addressed through a potential enhancement to the plant. The correlation between candidate SAMAs and the risk significant terms are listed in Tables [E.1-2](#) and [E.1-5](#) of Attachment E.1 for IP2, and Tables [E.3-2](#) and [E.3-5](#) of Attachment E.3 for IP3. The comprehensive lists contained a total of 231 SAMA candidates for IP2 and 237 SAMA candidates for IP3. The first step in the analysis of these candidates was to eliminate the non-viable SAMA candidates through preliminary screening.

4.21.5.3 Preliminary Screening (Phase I)

For each of the units, the purpose of the preliminary SAMA screening was to eliminate from further consideration enhancements that were not viable for implementation at the unit. Potential SAMA candidates were screened out if they modified features not applicable to the unit or if they

had already been implemented at the unit. In addition, where it was determined those SAMA candidates were potentially viable, but were similar in nature, they were combined to develop a more comprehensive or plant-specific SAMA candidate.

During this process, 163 of the 231 initial SAMA candidates were eliminated, leaving 68 SAMA candidates for IP2, and 175 of the 237 initial SAMA candidates were eliminated, leaving 62 SAMA candidates for IP3 for further analysis. The lists of original SAMA candidates and applicable screening criterion are available in on-site documentation.

4.21.5.4 Final Screening and Cost/Benefit Evaluation (Phase II)

A cost/benefit analysis was performed on the remaining SAMA candidates. The method for determining if a SAMA candidate was cost beneficial consisted of determining whether the benefit provided by implementation of the SAMA candidate exceeded the expected cost of enhancement (COE). The benefit was defined as the sum of the reduction in dollar equivalents for each severe accident impact area (off-site exposure, off-site economic costs, occupational exposure, and on-site economic costs). If the expected implementation cost exceeded the estimated benefit, the SAMA was not considered cost beneficial.

The result of implementation of each SAMA candidate would be a change in the severe accident risk (i.e., a change in frequency or consequence of severe accidents). The method of calculating the magnitude of these changes is straightforward. First, the severe accident risk after implementation of each SAMA candidate was estimated using the same method as for the baseline. The results of the Level 2 model were combined with the Level 3 model to calculate these post-SAMA risks. The results of the benefit analyses for the SAMA candidates are presented in [Table E.2-2](#) of Attachment E.2 for IP2 and [Table E.4-2](#) of Attachment E.4 for IP3.

Each SAMA evaluation was performed in a bounding fashion. Bounding evaluations were performed to address the generic nature of the initial SAMA concepts. Such bounding calculations overestimate the benefit and thus are conservative calculations. For example, one SAMA candidate suggested installing a digital feedwater upgrade system. The bounding calculation estimated the benefit of this improvement by total elimination of risk due to loss of feedwater event (see analysis in phase II [SAMA 41](#) of [Table E.2-2](#) for IP2, and phase II [SAMA 39](#) of [Table E.4-2](#) for IP3). Such a calculation obviously overestimated the benefit, but if the inflated benefit indicated that the SAMA is not cost beneficial, then the purpose of the analysis was satisfied.

As described above for the baseline, values for avoided public and occupational health risk were converted to a monetary equivalent (dollars) via application of the *Regulatory Analysis Technical Evaluation Handbook* [NRC 1997] conversion factor of \$2,000 per person-rem and discounted to present value. Values for avoided off-site economic costs were also discounted to present value. The formula for calculating net value for each SAMA was

$$\text{Net value} = (\text{APE} + \text{AOC} + \text{AOE} + \text{AOSC}) - \text{COE}$$

where,

- APE = value of averted public exposure (\$);
- AOC = value of averted off-site costs (\$);
- AOE = value of averted occupational exposure (\$);
- AOSC = value of averted on-site costs (\$); and
- COE = cost of enhancement (\$).

If the net value of a SAMA was negative, the cost of the enhancement was greater than the benefit and the SAMA was not cost beneficial.

The SAMA analysis considered that external events (including fires, seismic, and other external events) could lead to potentially significant risk contributions. To account for the risk contribution from external events, the cost of SAMA implementation was compared with a benefit value estimated by applying a multiplier to the internal events estimated benefit. This value is defined as the "baseline benefit." To account for uncertainties associated with the internal events CDF calculations, the cost of SAMA implementation was also compared with a benefit value estimated by applying an uncertainty multiplier to the internal events estimated benefit. This value is defined as the "baseline benefit with uncertainty." Development of the multipliers for IP2 and IP3 is described in the following paragraphs.

IP2

A multiplier of 3.8 was applied to the internal events estimated benefit to account for the impact from external events. The IPEEE analyses provided quantitative, but conservative, results. Therefore, the results were combined as described below to represent the total external events risk.

The IP2 Individual Plant Examination of External Events (IPEEE) concluded for external floods and other external events that no undue risks are present that might contribute to CDF with a predicted frequency in excess of $1.0E-06/\text{yr}$. As these events are not dominant contributors to external event risk and quantitative analysis of these events is not practical, they are considered negligible in estimation of the external events multiplier.

A high wind analysis was performed for the IP2 IPEEE. Conservative assumptions in the high wind PSA analysis included the following.

- Offsite power was assumed to be lost for all high wind events.
- Building frame failures were assumed to cause failure of all equipment within the building.
- Missile (high wind projectile) impact on a structure was assumed to cause failure of all equipment within that structure.

- Likelihood of missile (high wind projectile) strikes was assumed to be independent of the intensity of the hazard.
- Both onsite and offsite alternate power sources (gas turbines) were assumed to fail given failure of a more robust structure.

The core damage frequency contribution associated with high wind events was estimated to be 3.03×10^{-5} per year. As described above, this is a conservative value. In addition, plant changes, improved equipment performance data, and modeling improvements since the issuance of the IP2 IPEEE have demonstrated that the response of plant systems as modeled at that time was conservative. This can be seen from the reduction in internal events CDF from 2.85×10^{-5} per year at the time the IPEEE was developed to the present value of 1.79×10^{-5} per year. Although conservative, the wind risk contribution of 3.03×10^{-5} per year was used to determine the external event multiplier.

A seismic PSA analysis was performed for the seismic portion of the IP2 IPEEE. The seismic PSA analysis was a conservative analysis. Therefore, its results should not be compared directly with the best-estimate internal events results. Conservative assumptions in the seismic PSA analysis included the following.

- Sequences in the seismic PSA involving loss of off-site power were assumed to be unrecoverable. If off-site power was recovered following a seismic event, there would be many more systems available to maintain core cooling and containment integrity than were credited for those sequences.
- A single, conservative, surrogate element whose failure leads directly to core damage was used in the seismic risk quantification to model the most seismically rugged components.
- Seismic-induced ATWS was considered in the analysis, but no credit was included for manual scram or mitigation of ATWS using the boration system. This conservatively resulted in most seismic-induced ATWS events leading to consequential core damage.
- Redundant components were conservatively assumed to be completely correlated by treating them as if they were one component for the purpose of determining the probability of seismic induced failures.
- Several systems were assumed to be unavailable during a seismic event, including:
 - a. the city water system, which can be used to supply backup cooling to the charging pumps if CCW is lost, as an alternate source of suction to the AFW pumps and to provide alternate cooling to the RHR and SI pumps;

- b. the primary water system, which can also be used as a backup to CCW to supply cooling to the RHR and SI pumps; and
- c. the onsite and offsite gas turbine generators, which can provide alternate station power.
- No credit was taken for recovery of power through the alternate safe shutdown system (ASSS).
- Lawrence Livermore National Laboratory (LLNL) seismic hazard data was used. Use of EPRI seismic hazard data would result in a 10% reduction in overall seismic CDF.

The seismic CDF in the IPEEE was originally estimated to be 1.46×10^{-5} per year. As a result of an IPEEE recommendation, the CCW surge tank hold-down bolts were upgraded, reducing the seismic CDF to 1.06×10^{-5} per year. Although it remains conservative, the seismic risk contribution of 1.06×10^{-5} per year was used to determine the external event multiplier.

The conservative EPRI FIVE methodology was used for initial screening of fire zones in the IP2 IPEEE fire analysis. Unscreened fire zones were then analyzed in more detail using a fire PRA approach.

The sum of the resulting fire zone CDF values ([Table E.1-11](#)) is approximately 1.84×10^{-5} per year.

Conservative assumptions in the IP2 IPEEE fire analysis include the following.

- The frequency and severity of fires were generally conservatively overestimated in the generic IPEEE fire analysis methods. A revised NRC fire events database indicates a trend toward lower frequency and less severe fires. This trend reflects improved housekeeping, reduction in transient fire hazards, and other improved fire protection steps at utilities.
- Cable failure due to fire damage was assumed to arise from open circuits, hot short circuits, and short circuits to ground. In damaging a cable, the analysis addressed the ability of the fire to induce the conductor failure mode of concern. Hot shorts were conservatively assigned a probability of 0.1, which was applied to all single phase, AC control circuit or DC power and control circuit cases regardless of whether the wires were in the same multi-conductor.
- A plant trip was assumed for all fires, including those for which immediate operator actions are not specified in emergency response procedures.
- PORV block valves were assumed to be in the more limiting position (open or closed) to maximize the impact of the fire.

- The main feedwater and condensate systems were assumed to be unavailable in all scenarios, even when their power source was not impacted by the fire scenario. Use of these systems for recovery, following a failure of AFW, is addressed in current plant procedures.
- All sequences involving induced RCP seal LOCAs were assumed to lead to complete seal failure. Although casualty cables exist for powering ECCS pumps from the ASSS power source, the ASSS was assumed to be ineffective in mitigating induced LOCAs. The currently accepted RCP seal LOCA methodology is more detailed and provides sequences with varying leakage rates. Under that current methodology, a majority of seal LOCAs remain within the capability of a charging pump (which has hardwired ASSS transfer capability) to provide makeup.

As noted previously, plant changes, improved equipment performance data and modeling improvements since the issuance of the IP2 IPEEE have demonstrated that the response of plant systems as modeled at that time was conservative. This can be seen from the reduction in internal events CDF from 2.85×10^{-5} per year at the time the IPEEE was developed to the present value of 1.79×10^{-5} per year, a reduction factor of 1.6. Factoring in the additional conservatism in the fire analysis noted above, an overall reduction factor of 2 is reasonable. The IPEEE fire CDF value, reduced by a factor of two, is 9.20×10^{-6} per year.

The combination of the reduced high wind, seismic and fire CDF values results in an external events risk estimate of 5.01×10^{-5} per year, which is 2.80 times higher than the internal events CDF (1.79×10^{-5} per year). Since the external events contribution must be added to the internal events contribution, this justifies use of a multiplier of 3.80 on the averted cost estimates (for internal events) to represent the total SAMA benefits, accounting for both internal and external events. "Baseline benefit" values are estimated using this multiplier on the benefit estimates for internal events.

CDF uncertainty estimates resulted in a factor of 2.10 (Table E.1-3). Since $3.80 \times 2.10 = 7.98$, a multiplier of 8 provides a conservative upper bound estimate, accounting for both internal and external event impacts, with uncertainty. Therefore, "baseline benefit with uncertainty" values are estimated using this multiplier on the benefit estimates for internal events.

IP3

A multiplier of 5.52 was applied to the internal events estimated benefit to account for the impact from external events. The IPEEE analyses provided quantitative, but conservative results. Therefore, the results were combined as described below to represent the total external events risk.

The IP3 Individual Plant Examination of External Events (IPEEE) concluded for high winds, floods, and other external events that no undue risks are present that might contribute to CDF with a predicted frequency in excess of $1.0\text{E-}06/\text{yr}$. As these events are not dominant

contributors to external event risk and quantitative analysis of these events is not practical, they are considered negligible in estimation of the external events multiplier.

The IPEEE analyses using the fire PRA and seismic PSA provided quantitative, but conservative, results. Therefore, the results were combined as described below to represent the total external events risk.

A seismic PSA analysis was performed for the seismic portion of the IP3 IPEEE. The seismic PSA analysis is a conservative analysis. Therefore, its results should not be compared directly with the best-estimate internal events results. Conservative assumptions in the seismic PSA analysis included the following.

- Each of the sequences in the seismic PSA assumes unrecoverable loss of off-site power. If off-site power was maintained, or recovered, following a seismic event, there would be many more systems available to maintain core cooling and containment integrity than were credited in the analysis.
- Seismic events were assumed to induce a small loss of coolant accident (LOCA) in addition to a loss of offsite power.
- A single, conservative, surrogate element whose failure leads directly to core damage was used in the seismic risk quantification to model the most seismically rugged components.
- Redundant components were conservatively assumed to be completely correlated by treating them as if they were one component for the purpose of determining the probability of seismic induced failures.
- The ATWS event tree was conservatively simplified so that all conditions which lead to a failure to trip result in core damage, without the benefit of emergency boration or other mitigating systems.
- Because there is little industry experience with crew actions following seismic events, human actions were conservatively characterized.

The seismic CDF in the IPEEE was conservatively estimated to be 4.40×10^{-5} per year. As described above, this is a conservative value. The seismic PRA CDF has been re-evaluated to reflect updated random component failure probabilities and to model recovery of onsite power and local operation of the turbine-driven AFW pump. The updated seismic CDF is 2.65×10^{-5} per year. Although it remains conservative, the seismic risk contribution of 2.65×10^{-5} per year was used to determine the external event multiplier.

The EPRI Fire PRA Implementation Guide was followed for the IP3 IPEEE fire analysis. The EPRI Fire Induced Vulnerability Evaluation (FIVE) method was used for the initial screening, for

treatment of transient combustibles, and as the source of fire frequency data. The sum of the resulting fire zone CDF values (Table E.3-11) is approximately 5.58×10^{-5} per year.

Conservatisms in the IP3 IPEEE fire analysis include the following.

- The frequency and severity of fires were generally conservatively overestimated. A revised NRC fire events database indicates a trend toward lower frequency and less severe fires. This trend reflects improved housekeeping, reduction in transient fire hazards, and other improved fire protection steps at utilities.
- There is little industry experience with crew actions following fires. This led to conservative characterization of crew actions in the IPEEE fire analysis. Because CDF is strongly correlated with crew actions, this conservatism has a profound effect on fire results.
- Hot gas layer temperature timing calculations were based on simplified analyses (versus more detailed calculations such as GOTHIC or even COMPBURN) which are believed to result in more severe timing (i.e., shorter time to equipment failure).
- Heat and combustion products from a fire within a zone were assumed to be confined within the zone. Heat loss through separating zones was not considered; nor was heat loss through open equipment hatches, ladder ways, open doorways, or unsealed penetrations.
- Cable failure due to fire damage was assumed to arise from open circuits, hot shorts circuits, and short circuits to ground. In damaging a cable, the fire was always assumed to induce the conductor failure mode of concern.
- A plant trip was assumed for all fires, including those for which immediate operator actions are not specified in emergency response procedures.
- For several fire zones, a minimum heat requirement for target damage was estimated.
- Propagation of fires in cable spreading room trays and electrical tunnels was modeled using a maximum heat release rate. This results in a shorter time to damage than the five-minute delay using heat release rate scaling factors as a function of distance recommended in the EPRI fire PRA implementation guide.

Implementation of the IP3 IPEEE recommendations reduced the fire risk. The fire suppression system in the 480V switchgear room (fire zone 14) was restored to automatic actuation, and realignment and rerouting of the power feeds to the EDG exhaust fans and engine auxiliaries in emergency diesel generator room 31 (fire zone 10), emergency diesel generator room 32 (fire zone 10A) and emergency diesel generator room 33 (fire zone 102A) significantly reduce the respective fire zone's CDF. In addition, restoration of the 480V switchgear room fire suppression system to automatic actuation results in a similar reduction in the fire zone 14/37A multiple

compartment fire CDF. Consequently, the IPEEE fire CDF value was reduced from 5.58×10^{-5} to 2.55×10^{-5} per year. Although it remains conservative, the fire risk contribution of 2.55×10^{-5} per year was used to determine the external event multiplier.

Combining the reduced seismic and fire CDF values results in an external events risk estimate of 5.20×10^{-5} per year, which is 4.52 times higher than the internal events CDF (1.15×10^{-5} per year). Since the external events contribution must be added to the internal events contribution, this justifies use of a multiplier of 5.52 on the averted cost estimates (for internal events) to represent the total SAMA benefits for both internal and external events. "Baseline benefit" values are estimated using this multiplier on the benefit estimates for internal events.

CDF uncertainty estimates resulted in a factor of 1.40 (Table E.3-3). Since $5.52 \times 1.40 = 7.73$, a multiplier of 8 provides a conservative upper bound estimate, accounting for both internal and external event impacts, with uncertainty. Therefore, "baseline benefit with uncertainty" values are estimated using this multiplier on benefit estimates for internal events.

Cost of Enhancements

The expected COE of each SAMA was established from existing estimates of similar modifications combined with engineering judgment. Most of the cost estimates were developed from similar modifications considered in previous performed SAMA analyses. In particular, these cost-estimates were derived from the following major sources.

- ANO-2 SAMA Analysis
- Calvert Cliffs SAMA Analysis
- Donald C. Cook SAMA Analysis
- Fort Calhoun Unit 1 SAMA Analysis
- Joseph M. Farley SAMA Analysis
- McGuire SAMA Analysis

A number of additional conservatisms associated with implementation were included in the cost benefit analysis. The cost estimates for implementing the SAMAs did not include the cost of replacement power during extended outages required to implement the modifications, nor did they include contingency costs associated with unforeseen implementation obstacles. Estimates based on modifications that were implemented or estimated in the past were presented in terms of dollar values at the time of implementation and were not adjusted to present-day dollars.

Detailed cost estimates were often not required to make informed decisions regarding the economic viability of a potential plant enhancement when compared to attainable benefit. Implementation costs for several of the SAMA candidates were clearly in excess of the attainable benefit estimated from a particular analysis case. For less clear cases, engineering judgment was applied to determine if a more detailed cost estimate was necessary to formulate a conclusion regarding the economic viability of a particular SAMA. Plant-specific cost estimates were compared, where possible, to estimates developed and used at plants of similar design and vintage. Nonetheless, the cost of each candidate was conceptually estimated to the point where

conclusions regarding the economic viability of the proposed modification could be adequately gauged. The cost benefit comparison and disposition of each of the Phase II SAMA candidates is presented in [Table E.2-2](#) of Attachment E.2 for IP2 and [Table E.4-2](#) of Attachment E.4 for IP3.

4.21.5.5 Sensitivity Analyses

Three sensitivity analyses were conducted to gauge the impact of key assumptions upon the analysis. The first two considered varied extended plant life and discount rate, which are the main factors affecting present worth. The third evaluates impacts resulting from economic losses due to tourism and business, which were not included in the base case. A description of each follows.

Sensitivity Case 1: Years Remaining until End of Plant Life

The purpose of this sensitivity case was to investigate the sensitivity of assuming a 26-year period for remaining plant life for IP2 (i.e., six years on the original plant license plus the 20-year license renewal period), and a 28-year period for remaining plant life for IP3 (i.e., eight years on the original plant license plus the 20-year license renewal period). The 20-year license renewal period was used in the base case. The resultant monetary equivalent for internal event was calculated by using 26 and 28 years remaining until end of facility life to investigate the impact on each analysis case for IP2 and IP3, respectively.

Sensitivity Case 2: Conservative Discount Rate

The purpose of this sensitivity case was to investigate the sensitivity of each analysis case to the discount rate. The discount rate of 7% used in the base case analyses is conservative relative to corporate practices; nonetheless, a lower discount rate of 3% was assumed in this case to investigate the impact on each analysis case.

Sensitivity Case 3: Inclusion of Economic Losses due to Tourism and Business

The purpose of this sensitivity case was to investigate the sensitivity of each analysis case to the inclusion of economic losses due to tourism and business. The MACCS2 economic model used for the base case analysis did not consider such losses. While the base case assumed a loss of \$163,631/person in the affected region following a postulated severe accident, this sensitivity case assumed a loss of \$208,838/person. This increased the calculated offsite economic cost risk for the base case and for each SAMA under consideration. Since the benefit for each SAMA is estimated as the difference between the base case and the SAMA, the sensitivity case 3 benefit values (see table listed below) are the same or only slightly higher than the baseline benefit values.

The benefits estimated for each of these sensitivities are presented in [Table E.2-3](#) of Attachment E.2 for IP2 and [Table E.4-3](#) of Attachment E.4 for IP3.

4.21.6 Conclusion

IP2

This analysis addressed 231 SAMA candidates for mitigating severe accident impacts. Phase I screening eliminated 163 SAMA candidates from further consideration, based on either inapplicability to IP2 design, or features that had already been incorporated into current design, procedures and programs. During the Phase II cost/benefit evaluation of the remaining 68 SAMA candidates, an additional 61 SAMA candidates were eliminated because their cost was expected to exceed their benefit.

Seven Phase II SAMA candidates (i.e., 28, 44, 54, 56, 60, 61, and 65) presented in [Table 4-4](#) were found to be potentially cost beneficial for mitigating the consequences of a severe accident for IP2.

- A plant modification was recommended to provide a portable diesel-driven battery charger to improve DC power reliability.
- A plant modification was recommended to allow use of fire water as backup for steam generator inventory to increase the availability of steam generator water supply.
- A plant modification was recommended to install a flood alarm in the 480V AC switchgear room to mitigate the occurrence of internal floods inside the 480V AC switchgear room.
- A procedure modification was recommended to keep RHR heat exchanger discharge valves, MOVs 746 and 747, normally open. This procedure change would reduce the core damage frequency contribution from transients and LOCAs.
- A plant modification was recommended to provide added protection against flood propagation from stairwell 4 into the 480V AC switchgear room to reduce the core damage frequency contribution from flood sources within stairwell 4 adjacent to the 480V AC switchgear room.
- A plant modification was recommended to provide added protection against flood propagation from the deluge room into the 480V AC switchgear room to reduce the core damage frequency contribution from flood sources within the deluge room adjacent to the 480V AC switchgear room.
- A plant modification was recommended to upgrade the alternate safe shutdown system to allow timely restoration of reactor coolant pump seal injection and cooling from events that cause loss of power from the 480V AC vital buses.

IP3

This analysis addressed 237 SAMA candidates for mitigating severe accident impacts. Phase I screening eliminated 175 SAMA candidates from further consideration, based on either inapplicability to IP3 design, or features that had already been incorporated into current design, procedures and programs. During the Phase II cost benefit evaluation of the remaining 62 SAMA candidates, an additional 57 SAMA candidates were eliminated because their cost was expected to exceed their benefit.

Five Phase II SAMA candidates (i.e., 30, 52, 55, 61 and 62) presented in [Table 4-5](#) were found to be potentially cost beneficial for mitigating the consequences of a severe accident for IP3.

- A plant modification was recommended to provide a portable diesel-driven battery charger to improve DC power reliability.
- An engineering analysis was recommended to evaluate and proceduralize opening the city water supply valve for alternative AFW system pump suction to enhance the availability of AFW System.
- A plant modification was recommended to provide the capability of powering one safety injection pump or RHR pump using the Appendix R diesel (MCC 312A) to enhance RCS injection capability during events that cause loss of power from the 480V AC vital buses.
- A plant modification was recommended to upgrade the alternate safe shutdown system to allow timely restoration of reactor coolant pump seal injection and cooling from events that cause loss of power from the 480V AC vital buses.
- A plant modification was recommended to install a flood alarm in the 480V AC switchgear room to mitigate the occurrence of internal floods inside the 480V AC switchgear room.

The above SAMA candidates for IP2 and IP3 do not relate to adequately managing the effects of aging during the license renewal period. In addition, since the SAMA analysis is conservative and is not a complete engineering project cost-benefit analysis, it does not estimate all the benefits or all of the costs of a SAMA. For instance, it does not consider increases or decreases in maintenance or operation costs following SAMA implementation. Also, it does not consider the possible adverse consequences of the changes. Although not related to adequately managing the effects of aging during the period of extended operation, the above, potentially cost-beneficial SAMAs have been submitted for detailed engineering project cost-benefit analysis.

The IP2 and IP3 sensitivity studies indicated that the results of the analysis would not change for the conditions analyzed.

**Table 4-4
IP2 Final SAMAs**

Phase II SAMA ID	SAMA title	Result of potential enhancement	CDF Reduction	Off-site Dose Reduction	OECR Reduction	Baseline Benefit	Baseline Benefit With Uncertainty	Estimated Cost
028	Provide a portable diesel-driven battery charger	SAMA would improve DC power reliability.	4.79%	10.00%	9.13%	\$420,459	\$885,176	\$494,000
<p>Basis for Conclusion: The CDF contribution due to local operation of the turbine-driven AFW pump during SBO scenarios was eliminated to conservatively assess the benefit of this SAMA. The cost of implementing this SAMA was specifically estimated for IP2.</p>								
044	Use fire water system as backup for steam generator inventory	This SAMA would increase the availability of steam generator water supply.	33.00%	14.55%	13.36%	\$984,503	\$2,072,638	\$1,656,000
<p>Basis for Conclusion: The CDF contribution due to failure of the turbine-driven AFW pump and local operation of AFW during SBO were eliminated to conservatively assess the benefit of this SAMA. The cost of implementing this SAMA was specifically estimated for IP2.</p>								
054	Install flood alarm in the 480VAC switchgear room	This SAMA would reduce core damage frequency following switchgear room flooding.	19.97%	40.45%	38.31%	\$1,722,733	\$3,626,807	\$200,000
<p>Basis for Conclusion: The CDF contribution from reducing control building flooding initiator frequency by a factor of 3 was estimated to assess the potential impact of this SAMA. The cost of implementing this SAMA was specifically estimated for IP2.</p>								

**Table 4-4
IP2 Final SAMAs**

Phase II SAMA ID	SAMA title	Result of potential enhancement	CDF Reduction	Off-site Dose Reduction	OECR Reduction	Baseline Benefit	Baseline Benefit With Uncertainty	Estimated Cost
056	Keep RHR heat exchanger discharge MOVs 746 and 747 normally open	This SAMA would reduce the core damage frequency contribution from transients and LOCAs.	1.84%	0.45%	0.22%	\$44,633	\$93,964	\$82,000
<p>Basis for Conclusion: The probability of the RHR heat exchanger discharge MOVs 746 and 747 failing to open was eliminated to assess the benefit of this SAMA. The cost of implementing this SAMA was specifically estimated for IP2.</p>								
060	Provide added protection against flood propagation from stairwell 4 into the 480VAC switchgear room	This SAMA would reduce the core damage frequency contribution from flood sources within stairwell 4 adjacent to the 480VAC switchgear room	4.52%	9.09%	8.69%	\$387,828	\$816,481	\$216,000
<p>Basis for Conclusion: The CDF contribution due to an internal flood initiated from a break in fire protection piping in stairwell 4 was eliminated to conservatively assess the benefit of this SAMA. The cost of implementing this SAMA was specifically estimated for IP2.</p>								

**Table 4-4
IP2 Final SAMAs**

Phase II SAMA ID	SAMA title	Result of potential enhancement	CDF Reduction	Off-site Dose Reduction	OECR Reduction	Baseline Benefit	Baseline Benefit With Uncertainty	Estimated Cost
061	Provide added protection against flood propagation from the deluge room into the 480VAC switchgear room	This SAMA would reduce the core damage frequency contribution from flood sources within the deluge room adjacent to the 480VAC switchgear room	9.84%	20.00%	18.93%	\$853,187	\$1,796,183	\$192,000
<p>Basis for Conclusion: The CDF contribution due to an internal flood initiated from a break in 10-in fire protection piping in elevation 15-ft deluge room, adjacent to the 480VAC switchgear room was eliminated to conservatively assess the benefit of this SAMA. The cost of implementing this SAMA was specifically estimated for IP2.</p>								
065	Upgrade the ASSS to allow timely restoration of seal injection and cooling.	This SAMA would reduce the core damage frequency contribution from internal and external events that cause loss of power from the 480V vital buses (SBO, control building floods and fires)	19.97%	40.45%	38.31%	\$1,722,733	\$3,626,807	\$560,000
<p>Basis for Conclusion: The CDF contribution due to control building flooding initiators was eliminated to conservatively assess the benefit of this SAMA. The cost of implementing this SAMA was specifically estimated for IP2.</p>								

**Table 4-5
IP3 Final SAMAs**

Phase II SAMA ID	SAMA title	Result of potential Enhancement	CDF Reduction	Off-site Dose Reduction	OECR Reduction	Baseline Benefit	Baseline Benefit With Uncertainty	Estimated Cost
030	Provide a portable diesel-driven battery charger	SAMA would improve DC power reliability.	8.73%	6.94%	6.06%	\$509,643	\$738,613	\$494,000
<p>Basis for Conclusion: The time available to recover offsite power before local operation of AFW is required was changed from 2 hours to 24 hours during SBO scenarios to conservatively assess the benefit of this SAMA. In addition, internal floods that occur in the switchgear room were reduced (by 5 percent) to account for local operation of the turbine-driven AFW pump. The cost of implementing this SAMA was specifically estimated for IP3.</p>								
052	Open city water supply valve for alternative AFW pump suction	This SAMA would enhance the availability of AFW.	0.89%	0.82%	0.95%	\$65,223	\$94,526	\$50,000
<p>Basis for Conclusion: The CDF contribution from the loss of normal suction path to the AFW system was eliminated to conservatively assess the potential impact of this SAMA. The cost of implementing this SAMA was specifically estimated for IP3.</p>								
055	Provide the capability of powering one SI pump or RHR pump using the Appendix R bus (MCC 312A)	This SAMA would reduce the core damage frequency contribution from internal flooding scenarios.	16.48%	18.37%	16.48%	\$1,274,884	\$1,847,657	\$1,288,000
<p>Basis for Conclusion: The CDF contribution due to failure to align MCC 312A given loss of power from vital 480VAC buses due to control building floods was eliminated to conservatively assess the benefit of this SAMA. The cost of implementing this SAMA was specifically estimated for IP3.</p>								

**Table 4-5
 IP3 Final SAMAs**

Phase II SAMA ID	SAMA title	Result of potential Enhancement	CDF Reduction	Off-site Dose Reduction	OECR Reduction	Baseline Benefit	Baseline Benefit With Uncertainty	Estimated Cost
061	Upgrade the ASSS to allow timely restoration of seal injection and cooling.	This SAMA would reduce the core damage frequency contribution from internal and external events that cause loss of power from the 480V vital buses (SBO, control building floods and fires)	17.43%	19.59%	17.80%	\$1,365,046	\$1,978,328	\$560,000
<p>Basis for Conclusion: The CDF contribution due to control building flooding initiators was eliminated to conservatively assess the benefit of this SAMA. The cost of implementing this SAMA was specifically estimated for IP3.</p>								
062	Install flood alarm in the 480VAC switchgear room	This SAMA would reduce the core damage frequency contribution from flood sources in the 480VAC switchgear room	17.43%	19.59%	17.80%	\$1,365,046	\$1,978,328	\$196,800
<p>Basis for Conclusion: The CDF contribution due to control building flooding initiators was eliminated to conservatively assess the benefit of this SAMA. The cost of implementing this SAMA was specifically estimated for IP3.</p>								

4.22 Environmental Justice

4.22.1 Description of Issue

Environmental Justice

4.22.2 Finding from Table B-1, Appendix B to Subpart A

The need for and the content of an analysis of environmental justice will be addressed in plant-specific reviews.

4.22.3 Requirement

Other than the above referenced finding, there is no requirement concerning environmental justice in 10 CFR Part 51.

4.22.4 Background

The following background information is from Regulatory Guide 4.2.

Environmental justice was not reviewed in NUREG-1437. Executive Order 12898, "Federal Actions To Address Environmental Justice in Minority Populations and Low-Income Populations," issued on February 11, 1994, is designed to focus the attention of Federal agencies on the human health and environmental conditions in minority and low-income communities. The NRC Office of Nuclear Reactor Regulation is guided in its consideration of environmental justice by Appendix D, Environmental Justice and Flow Chart, to NRR Instruction No. LIC-203, Revision 1, Procedural Guidance for Preparing Environmental Assessments and Considering Environmental Issues," May 24, 2004. LIC-203 is revised periodically. The environmental justice review involves identifying off-site environmental impacts, their geographic locations, minority and low-income populations that may be affected, the significance of such effects, and whether they are disproportionately high and adverse compared to the population at large within the geographic area, and if so, what mitigative measures are available, and which will be implemented. The NRC staff will perform the environmental justice review to determine whether there will be disproportionately high human health and environmental effects on minority and low-income populations and report the review in its SEIS. The staff's review will be based on information provided in the ER and developed during the staff's site-specific scoping process.

The NRC's Office of Nuclear Reactor Regulation Office Instruction No. LIC-203 [NRC 2004] contains a procedure for incorporating environmental justice into the licensing process. Entergy used this process in conducting the review and analysis of this issue.

4.22.5 Analysis

The consideration of environmental justice is required to assure that federal programs and activities will not have "disproportionately high and adverse human health or environmental effects...on minority populations and low income populations..." Entergy's analyses of the Category 2 issues defined in 10 CFR 51.53(c)(3)(ii) determined that there were no adverse

impacts from the renewal of the IP2 and IP3 operating licenses. Thus, no disproportionate impact on minority or low-income populations would occur from the proposed action. Based on the review of these issues, no review for environmental justice is necessary. However, Entergy presents environmental justice demographic information in [Section 2.6.2](#) to assist the NRC in its review.

4.22.6 Conclusion

As part of its environmental assessment of this proposed action, Entergy has determined that no significant off-site environmental impacts will be created by the renewal of the IP2 and IP3 Operating Licenses. This conclusion is supported by the review performed of the Category 2 issues defined in 10 CFR 51.53(c)(3)(ii) presented in this ER.

As the NRR procedure recognizes, if no significant off-site impacts occur in connection with the proposed action, then no member of the public will be substantially affected. Therefore, there can be no disproportionately high and adverse impacts or effects on members of the public, including minority and low-income populations, resulting from the renewal of the IP2 and IP3 Operating Licenses.

4.23 Cumulative Impacts

Entergy considered potential cumulative impacts in its environmental analysis associated with IP2 and IP3 operations during the license renewal period. For the purposes of this analysis, past actions are those related to the resources at the time of plant licensing and construction, present actions are those related to the resources at the time of current operation of the power plant, and future actions are considered to be those that are reasonably foreseeable through the end of plant operation, which would include the 20-year license renewal term. The geographic area over which past, present and future actions would occur is dependent on the type of action considered and is described below for each impact area.

The impacts of the proposed action are combined with other past, present and reasonably foreseeable future actions regardless of what agency (Federal or non-Federal) or person undertakes such other actions. These combined impacts are defined as "cumulative" in 40 CFR 1508.7 and include individually minor, but collectively significant actions taking place over a period of time. It is possible that an impact that may be SMALL by itself could result in a MODERATE or LARGE impact when considered in combination with the impacts of other actions on the affected resource. Likewise, if a resource is regionally declining or imperiled, even a SMALL individual impact could be important if it contributes to or accelerates the overall resource decline.

4.23.1 Cumulative Impacts on Aquatic Resources

The geographic area considered for the analysis of cumulative impacts on aquatic resources focused on the Hudson-Mohawk River drainage basin, specifically on the portion of the Hudson River basin from the mouth of the Hudson River at the Battery (RM 0) to the Troy Dam (RM 154) at Albany. The Hudson River watershed is a major estuary, covered by the New York State

Coastal Management Program. The Hudson River's cultural and natural history has been studied and described by various individuals, organizations, institutions, and governmental agencies since the beginning of recorded history in America. The portion of the estuary with the greatest potential for cumulative impacts has been intensely studied jointly by the Hudson River Utility Systems and the NYSDEC over the past 30 plus years.

As noted by the NRC, large estuaries are influenced by a variety of factors that alter marine and estuarine food chains, species compositions, or species distributions that are ecologically, commercially, or recreationally important [NRC, 2006]. IP2 and IP3 are one of six electric power generating facilities withdrawing water from and discharging into the Hudson River. An overview of the environmental setting and the impacts of IP2 and IP3 station operations have been described throughout [Section 2](#) and Section 4, respectively. The aquatic ecological setting, described in [Section 2.2](#), discussed cumulative impacts on the lower Hudson from a number of causes.

The DEIS provided a regional environmental setting of the Hudson basin and noted that the Hudson River is used as a source of potable water as well as for waste disposal, transportation, and cooling by industry and municipalities. The Hudson River below Albany is used as a source of potable water by at least five municipalities and receives discharges greater than 50 mgd from 12 facilities. (This number assumes that the structure replacing the World Trade Center will also discharge greater than 50 mgd.) The six electric power generation facilities utilizing the Hudson River for cooling water supply are Bowline Point at RM 37, Lovett at RM 42, Indian Point at RM 43, Danskammer at RM 66, Roseton at RM 67, and Bethlehem at RM 140. Additional intake of Hudson River water may occur at Chelsea Pumping Station, located on the eastern bank of the river across from Roseton Units 1 and 2 Generating Station [[CHGEC](#), Section V.A.9.c.i].

As discussed below, impacts from IP2 and IP3 on aquatic resources have less impact than those associated with damming of the river or its tributaries, long-term land use changes, or other factors induced by climatic changes.

Although not related to IP2 and IP3 operations, both the USFWS and the NYSDEC have identified human activities that have had significant impacts on the Hudson and to its habitat for aquatic organisms and usages. The net effect of dams on most of the tributaries is the removal of a great number of miles of suitable anadromous fish spawning habitat from the system (see [Section 2.2](#)) [USFWS 1997]. Shapley and Morris noted the potentially serious impact of dams on tributaries of the Hudson stating, "The roughly 357 dams and other barriers on the 63 tributaries of the Hudson River estuary block what is called the stream continuum." Sections of streams become lake-like, changing the flow of nutrients, sediment, dissolved oxygen—even warmth. Dammed water heats up in the summer. Spilling downstream, it is often hot enough to shock cold-water species such as trout. Dissolved oxygen, which is essential for fish and other aquatic life, is also decreased as it flows downstream over the dam. [[Shapley](#)]

Transportation has had a major effect on the Hudson River. Railroad bed construction as early as the 1840s paralleled both banks of the river, crossing all tributaries and isolating many of the tidal marsh complexes. Maintenance and rebuilding of railroads, roads, and bridges along the

Hudson River could adversely impact wetlands, rare plants, fish, and wildlife. Herbicide use along roads and railroads could destroy adjacent rare plant populations. Non-point source pollution in the form of runoff is also seen as a concern. [USFWS 1997]

The entire main stem of the Lower Hudson River (representing 100% of the estuary waters in the basin) is listed as having use (fish consumption) impairments due to toxic/contaminated sediment [NYSDEC 2004, Appendix A]. Increased regulation of wastewater discharges have significantly improved the water quality of the Hudson, while invasive plants and species such as water chestnut and zebra mussels may have reduced the amount of dissolved oxygen and zooplankton, respectively. All of these factors have had impacts on the basin's aquatic ecology but are not associated with the current or future operations of IP2 and IP3. Changes in ecosystem structure and function may be the result of many factors, including the loss of wetland and marsh areas due to dredging or near-river development, and climatic changes that alter predator-prey relationships or species compositions [NRC 2006].

There are activities associated with IP2 and IP3 operations that may potentially produce a localized aquatic affect on the lower Hudson River during the license renewal term such as minimal maintenance dredging associated with the intake structures to facilitate water flow, entrainment of zooplankton and ichthyoplankton, impingement of fish and shellfish, storm water runoff, groundwater discharge, and temperature-related effects due to the cooling water discharge. Similar localized impacts may be associated with other cooling water or potable water intakes or discharges from the other electric power generation plants, as well as industrial or municipal facilities. These activities could produce cumulative impacts on the aquatic ecology within the basin.

The Hudson River Estuary is an important spawning and nursery area for a variety of fish species, including both year-round inhabitants as well as species that move into the estuary solely for the purpose of spawning. The Hudson River Utilities and NYSDEC identified 16 fish and one crab species of concern to describe temporal changes in abundance measures. These included bay anchovy (*Anchoa mitchilli*), weakfish (*Cynoscion regalis*), gizzard shad (*Dorosoma cepedianum*), spottail shiner (*Notropis hudsonius*), white catfish (*Ictalurus catus*), bluefish (*Pomatomus saltatrix*), white perch (*Morone americana*), hogchoker (*Trinectes maculates*), rainbow smelt (*Osmerus mordax*), Atlantic tomcod (*Microgadus tomcod*), alewife (*Alosa pseudoharengus*), blueback herring (*Alosa aestivalis*) striped bass (*Morone saxatilis*), American shad (*Alosa sapidissima*), Atlantic sturgeon (*Acipenser oxyrinchus*), shortnose sturgeon (*Acipenser brevirostrum*), and blue crab (*Callinectes sapidus*). [CHGEC, Section V.D.2]

During the 24-year monitoring period from 1974 to 1997, species richness and overall abundance of the larval fish community increased in most areas of the estuary. Analysis of the long-term trends in the larval fish community in both the marine brackish regions and the freshwater zone revealed an overall increase in the total number of taxa collected. Increases in overall abundance were due to increases in the abundance of larval striped bass in all areas of the estuary and increases in the abundance of larval bay anchovy in brackish areas. [CHGEC, Section V.D.3.i]

Overall, studies indicate the fish community of the Hudson River estuary has experienced small changes in species richness and diversity, between the regions of the river and fish life stages. These changes are also discussed in Sections 4.2 and 4.3. Ichthyoplankton (fish eggs and larvae) species have increased slightly. The number and diversity of juvenile and older fish have decreased slightly during the river monitoring program. In the brackish region of the Hudson River, the decrease in richness and abundance is indicated to be due to an increase in salinity and consequent reduction in collection of freshwater fish species. [CHGEC, Section V.D.3.ii]

The shortnose sturgeon is listed as a federally endangered species and a discussion of this species is included in Section 2.5. Overall for the six electric power generation plants, the average impingement was 10.2 occurrences per year from 1972 through 1998, but 7.5 occurrences per year from 1989 through 1998. Based on these data, the NMFS concluded that future impingement rates due to incidental take at Roseton and Danskammer Point generating stations, even though higher than at Indian Point, are unlikely to jeopardize the continued recovery of the Hudson River shortnose sturgeon population [NMFS 2000, Section 5.2.2]. NMFS also identified the Atlantic sturgeon as a candidate species. Ristroph traveling screens and fish return systems were installed at the IP2 and IP3 intake structures in the early 1990s that eliminated or minimized the potential impingement mortality of shortnose and Atlantic sturgeon.

Entergy has a program in place to identify onsite spills or releases, evaluate onsite groundwater impacts from current or past station operations, and mitigate the migration of any groundwater contamination in accordance with NRC and NYSDEC regulations. These groundwater monitoring and control efforts will assure minimal effects to offsite aquatic resources and very limited incremental impacts such that future station operations during the license renewal term would not pose a cumulative risk to the Hudson River basin resources.

The Hudson River estuary is controlled by many factors which may produce incremental impacts. However, more than 30 years of extensive fisheries studies of the Hudson River have been conducted in the vicinity of IP2 and IP3. The results of the studies performed from 1974 to 1997 have not shown any negative trend in overall aquatic river species populations attributable to plant operations. Ongoing studies continue to support these conclusions [ASA]. In addition, current mitigation measures implemented through the HRSA and retained in the four Consent Orders, the current agreements with NYSDEC, and the outcome of the draft SPDES Permit proceeding will ensure that aquatic impacts remain SMALL during the license renewal term. Therefore, further mitigation measures are not warranted.

4.23.2 Cumulative Impacts on Terrestrial Resources

Entergy evaluated cumulative impacts of past, current and future activities in the five-county geographic area in which the plant, its transmission corridors, and its employees reside: Westchester, Rockland, Putnam, Dutchess, and Orange counties. Terrestrial resource impacts might include those to upland and river valley habitats, wetlands, and land use. Entergy has evaluated the incremental impacts associated with the proposed action to renew the IP2 and IP3 Operating Licenses.

As stated in [Section 4.23.1](#), the environmental setting is described in [Section 2](#). The description of IP2 and IP3 facilities and operations are described in [Section 3](#), while analyses of impacts to various resources are described in this section of the ER ([Section 4](#)). The potential impacts of the various alternatives to the proposed action are discussed in [Section 8](#) of this ER. Again, the cultural and natural history of this area has been studied and described by various individuals, organizations, institutions, and governmental agencies since the beginning of recorded history in America.

Past land use changes include the construction of the IP1, IP2, and IP3 facilities and its associated transmission lines. While significant residential and commercial development changes have occurred in the area since the construction of IP2 and IP3, the five counties in this region all have controls on future development and land use (see [Section 2.8](#)). Since 1992, land use and development have been regulated by the Open Space Conservation Plan, which is enforced by the Quality Communities Task Force [[NYSL](#)]. Open space is land that is not intensively developed for residential, commercial, industrial, or institutional use [[NYSL](#)]. The New York Coastal Zone Management Program also regulates some actions involving terrestrial resources along the Hudson River, as do various other agencies including, but not limited to, the USCOE, the NYSDEC, and the USFWS.

The NYSDEC 1997 Freshwater Wetlands Map indicates no wetlands areas are identified within the site boundary [[NYSDEC 1997b](#)]. The nearest state designated wetlands are located 0.45 miles northeast of the site at Lents Cove, east of Broadway. Entergy has procedures in place to

- control potential impacts to any nearby wetlands;
- minimize potential impacts from land disturbance and impacts to potential cultural or historic resources;
- minimize or control spills; and
- ensure permits are in place to minimize impacts from stormwater runoff.

While Entergy does not control the transmission lines beyond the Buchanan Substation directly across Broadway (immediately east of the plant), the transmission line owner and operator (ConEdison) addresses impacts to the transmission line corridors in accordance with its vegetative management plan. None of the management procedures are expected to alter wetland or riverine hydrology or adversely affect vegetation characteristics of these habitats or other habitats.

Although there are no state or federal jurisdictional wetlands on site, the open water of the Hudson River and its emergent wetland habitat supports a number of migrant waterfowl species, including mallard (*Anas platyrhynchos*), Canada goose (*Branta canadensis*), American black duck (*Anas rubripes*), and wood duck (*Aix sponsa*). In addition, several species of woodpeckers, songbirds, herons, and raptors, such as osprey (*Pandion haliaetus*) and bald eagle (*Haliaeetus leucocephalus*), utilize the river areas near the site [[NYSDEC 2005b](#)]. Peregrine falcons (*Falco*

peregrinus) are also found throughout much of the Hudson River Valley, including the vicinity of the site [NYSDEC 2006].

The State and federally listed threatened or endangered terrestrial species and species of concern in Westchester County are cited in Table 2-4. There is no critical habitat designated in Westchester County where IP2 and IP3 are located. Of the listed threatened or endangered species that could potentially be affected by station or transmission line maintenance operations, the only species identified is the bald eagle.

Bald eagles occur throughout virtually the entire area near the site. The bald eagle is known to nest along the Hudson River and has occasionally been seen near the site. In 1997, a nesting pair produced the first eaglet born along the Hudson River in more than 100 years near the Town/Village of Catskill, NY. In 2005, 12 pairs nested and 18 eaglets were fledged along the river [NYSDEC 2005a]. Bald eagles frequently winter along the Hudson River. Habitat for wintering bald eagles is generally described as large open waters, i.e., large rivers and lakes suitable for foraging. Habitat near the facility could possibly support wintering bald eagles because of the location of the site near the Hudson River. However, none of the management procedures are expected to alter bald eagle habitat or interfere with wintering or nesting. Therefore, IP2 and IP3 are not expected to contribute to adverse cumulative impacts on this species.

Entergy has reviewed its potential incremental contributions to cumulative impacts on terrestrial resources resulting from continued operation of IP2 and IP3 and from the transmission lines that transmit electrical power to the electrical grid. Entergy has concluded that any potential impacts would be SMALL and further mitigation measures are not warranted.

4.23.3 Cumulative Radiological Impacts

The radiological dose limits for protection of the public and workers have been developed by the EPA and the NRC to address the cumulative impact of acute and long-term exposure to radiation and radioactive material. These dose limits are codified in 40 CFR Part 190 and 10 CFR Part 20. For the purpose of this analysis, the area within a 50-mile radius region of interest (ROI) around IP2 and IP3 was included. There are no other nuclear fuel cycle facilities within the 50-mile ROI. The Millstone Nuclear Power Station (Units 2 and 3) is located in Connecticut approximately 92 miles northeast of IP2 and IP3. However, a portion of the population within the IP2 and IP3 ROI is also within the 50-mile ROI for Millstone Power Station. Limerick Nuclear Generating Station is located in Pennsylvania, approximately 112 miles to the southwest of IP2 and IP3, and the Susquehanna Steam Electric Station is located approximately 110 miles west.

The owners of IP2 and IP3 have conducted radiological environmental monitoring programs around the site since 1958. The results of the operational Radiological Environmental Monitoring Program (REMP) are reported to the NRC in the IP2 and IP3 Annual Radiological Environmental Operating Reports. The REMP measures radiation and radioactive materials from all sources, including, but not limited to, IP2 and IP3 radioactive emissions, and thus considers cumulative radiological impacts. On the basis of an evaluation of REMP results, Entergy concludes that impacts of radiation exposure on the public and workers (occupational) from operation of IP2 and IP3 during the renewal term would be SMALL. With respect to the future, the REMP sampling

locations identified in the IP2 and IP3 ODCMs have not identified increasing levels or the accumulation of radioactivity in the environment over time. In addition, Entergy is not aware of any plans or proposals for new nuclear facilities in the vicinity of IP2 and IP3 that would potentially contribute to cumulative radiological impacts. The NRC and the State of New York would regulate any future actions in the vicinity of the site that could contribute to cumulative radiological impacts. Therefore, Entergy concludes that future cumulative radiological impacts would be SMALL and therefore mitigation measures are not warranted.

4.23.4 Cumulative Socioeconomics Impacts

The socioeconomic conditions involving housing, local public services, utilities, education, employment, transportation, and personal income were presented for Westchester, Rockland, Putnam, Dutchess, and Orange Counties in New York in [Section 2](#). The impacts of housing, local public services/ utilities, education, and transportation as measures of socioeconomic indicators for these counties were evaluated separately in Sections 4.14, 4.15, 4.16, and 4.19.

As noted in [Section 2.7](#), a report by the Nuclear Energy Institute (NEI) concluded that the site, which is located near the Village of Buchanan, had an economic impact of \$763 million in 2002 in Westchester, Rockland, Orange, Putnam, and Dutchess counties [[NEI](#)]. Taxes paid by the site have a positive impact on the fiscal condition of Westchester County, especially the Hendrick Hudson and Lakeland school districts. Continued operation of the plant through the license renewal term would provide a significant continuing source of tax revenues to the local community and beneficial economic impact to the surrounding counties and communities.

In addition, the continuance of the 2158 MWe base load electrical power generation capacity provided by IP2 and IP3 provides relatively low cost and environmentally clean power to the lower Hudson River and upper New York City metropolitan area. As discussed in [Section 2](#), the region is in non-attainment for ozone and particulates. As discussed in [Section 8](#), alternative power supplies would create a deficit of base-load electrical power generation capacity that would likely have to be replaced by fossil fuel power generation which would add to adverse air quality impacts, especially for particulates and greenhouse gases. Due to limitations of the current transmission systems, construction of alternative power generation capacity in other areas of the state would be impractical in the near-term and would transfer socioeconomic impacts to other locales.

When combined with the impact of other potential activities, such as likely residential development and population growth in the area surrounding the plant, socioeconomic impacts from IP2 and IP3 license renewal would not produce a noticeable incremental change in any adverse impact measures. Therefore, Entergy concludes that the socioeconomic impact from the renewal of the IP2 and IP3 Operating Licenses, in addition to the impacts of other potential economic activities in the area, would be SMALL compared to other contributors and therefore further mitigation measures are not warranted.

4.23.5 Cumulative Impacts on Groundwater Use and Quality

The area of analysis for cumulative impacts on groundwater would encompass wells primarily within Westchester County. The Hudson River and Rockland, Dutchess, Putnam, and Orange counties are also considered due to IP2 and IP3 employment impacts in these areas.

Groundwater at the IP2 and IP3 site generally flows west toward the Hudson River. As discussed in [Section 2.3](#), the site is situated on the Upper Ordovician, Balmville Limestone formation with some limited areas of glacial till. The Balmville Limestone is a hard, dark gray, metamorphosed dolomitic limestone. Adjacent to the Balmville Limestone are schist and phyllite formations and the igneous intrusive rocks of the Cortland (mafic) Complex. [USAEC, Section II.E.3]

Groundwater is encountered at the site primarily in bedrock fractures and along the jointing or bedding planes of the various rock strata. Thus, groundwater may be encountered at different elevations on the site, dependent upon location, ground surface elevation and the fracture or water-bearing facies encountered.

Groundwater contamination occurrences at the site have involved non-radiological (e.g., petroleum hydrocarbons) contaminants, and radionuclides. These have been reported to the NRC and NYSDEC, as appropriate, and investigations performed to delineate the area of subsurface impact. As a result of the non-radiological events, corrective actions and monitoring programs were implemented in coordination with the NYSDEC. Based on the results of these programs, NYSDEC has determined that no additional actions are necessary at this time.

Regarding the radiological contamination, the areal extent of groundwater impact remains primarily on the facility property, and various monitoring systems operate under NRC cognizance. The investigation of the radionuclide contamination of the groundwater began in 2005, and although the investigation is on-going, Entergy and the NRC have concluded that although there appears to be some level of contaminated groundwater that discharges to the Hudson River, these levels do not exceed the effluent or radiological dose criteria established by the NRC. Entergy plans to continue to investigate groundwater contamination mitigation methods to determine their feasibility, as deemed appropriate by the NRC. Even if it is determined that no remedial actions are warranted at this time, the contamination at the site will not contribute to offsite regional groundwater impacts.

The site does not utilize groundwater, either for plant operations or for potable water. Surface water from the Hudson River and city water (Village of Buchanan PWS) supply the plant operational and potable water needs. There are no plans to develop groundwater sources at the plant for current operations, nor for operations through the license renewal term since adequate public water supplies are available to support the continued operation of IP2 and IP3, considering the anticipated employment at the site.

Public water supply systems (see [Table 2-12](#)) in the vicinity of the site include community and non-community (including non-transient non-community and transient non-community) systems. Community water systems within Westchester, Putnam, Orange, Dutchess, and Rockland

counties utilize both groundwater and surface water sources. Compared to regional potable water sources, including groundwater withdrawals for potable water supply and incremental demand from offsite development and population increases in the region, the demand for potable water from the continued operation of IP2 and IP3 is inconsequential.

Based on the fact that there is adequate supply of potable water to meet the current and future demand, the fact that there is no planned increase in the employment at IP2 and IP3, and that there is adequate supply for short-term increases of temporary labor during refueling or any foreseeable construction activities at the site during the license renewal term, Entergy concludes that the cumulative impact on groundwater resources would be SMALL and mitigation measures are not warranted. On the basis of groundwater quality, Entergy also concludes that the cumulative impact on the quality of local groundwater resources would be SMALL and mitigation measures are not warranted.

4.23.6 Conclusion

Entergy considered the potential impacts from IP2 and IP3 operations during the license renewal term and other past, present, and future actions in the vicinity of the site. Entergy's conclusion is that the potential cumulative impacts resulting from IP2 and IP3 operations during the license renewal term would be SMALL. Therefore, further mitigation measures are not warranted.

4.24 References

- ASA Analysis & Communication, Inc. 2004. Year Class Report for the Hudson River Estuary Monitoring Program. Prepared for Dynegy Roseton, LLC, Entergy Nuclear Indian Point 2, LLC and Entergy Nuclear Indian Point 3, LLC. Mirant Bowline, LLC.
- Barnthouse, L.W., Coutant, C.C., and VanWinkle, W. 2002. Status and Trends of Hudson River Fish Populations and Communities Since the 1970s: Evaluation of Evidence Concerning Impacts of Cooling Water Withdrawals. Unpublished.
- CHGEC (Central Hudson Gas and Electric Corporation). 1999. Consolidated Edison Company of New York, Inc., New York Power Authority, and Southern Energy New York, Draft Environmental Impact Statement for State Pollutant Discharge Elimination System Permits for Bowline Point, Indian Point 2 and 3, and Roseton Steam Electric Generating Stations.
- ConEdison. (Consolidated Edison). 2007. Letter dated January 19, 2007 from J.McAvoy (Vice President, ConEdison) to F. Dacimo (Vice President, Entergy Nuclear Operations).
- Dadswell. 1979. Testimony of Dr. Michael J. Dadswell on Behalf of the National Marine Fisheries Service.
- Entergy. 2006. EN-EV-115, Environmental Reviews and Evaluations.
- HRSA (Hudson River Settlement Agreement). December 19, 1980.
- IP2 UFSAR. Indian Point Energy Center, Indian Point 2 Updated Final Safety Analysis Report.
- IP3 UFSAR. Indian Point Energy Center, Indian Point 3 Updated Final Safety Analysis Report.
- NEI (Nuclear Energy Institute). 2004. Economic Benefits of Indian Point Energy Center: An Economic Impact Study by the Nuclear Energy Institute. Available at http://www.nei.org/documents/Economic_Benefits_Indian_Point.pdf. Accessed May 15, 2006.
- NMFS (National Marine Fisheries Service). 2000. Environmental assessment of a permit for the incidental take of Shortnose sturgeon at the Roseton and Danskammer Point Generating Stations.
- NMFS (National Marine Fisheries Service). 2007. NMFS Office of Protected Resources, Marine and Anadromous Fish, Shortnose Sturgeon. Accessed at <http://www.nmfs.noaa.gov/pr/species/fish/> on February 12, 2007.
- NRC (U.S. Nuclear Regulatory Commission). 1981. Consolidated Edison Company of New York, Inc., Amendment To Facility Operating License. U.S. Nuclear Regulatory Commission, Docket Nos. 50-247 and 50-286.

- NRC (U.S. Nuclear Regulatory Commission). 1996. Generic Environmental Impact Statement for License Renewal of Nuclear Plants (GEIS), Volumes 1 and 2, NUREG-1437. Washington, DC.
- NRC (U.S. Nuclear Regulatory Commission). 1997. Regulatory Analysis Technical Evaluation Handbook, NUREG/BR-0184. Washington, DC. January 1997.
- NRC (U.S. Nuclear Regulatory Commission). 2004. Office of Nuclear Reactor Regulation. Procedural Guidance for Preparing Environmental Assessments and Considering Environmental Issues. NRR Office Instruction No. LIC-203, Appendix D.
- NRC (U.S. Nuclear Regulatory Commission). 2006. Generic Environmental Impact Statement for License Renewal of Nuclear Plants, NUREG-1437, Supplement 28, Regarding Oyster Creek Nuclear Generating Station, Draft Report for Comment. Office of Nuclear Reactor Regulation, Washington, DC.
- NYSDEC (New York State Department of Environmental Conservation). 1987. State Pollutant Discharge Elimination System (SPDES) Discharge Permit (NY-000-4472)—Indian Point Generating Station (Units 1 and 2 Con Ed) and (IP3 PASNY).
- NYSDEC (New York State Department of Environmental Conservation). 1997a. Fourth Amended Stipulation of Settlement and Judicial Consent Order, National Resources Defense Council, Inc. et. al. vs. New York State Department of Environmental Conservation and Consolidated Edison Company of New York, Inc, New York Power Authority, Orange and Rockland Utilities, Inc., and Central Hudson Gas and Electric Corp.
- NYSDEC (New York State Department of Environmental Conservation). 1997b. New York State Freshwater Wetlands Map, Westchester County, Map 1 of 14, 1997. Accessed at <http://www.bagdonenvironmental.com/regmaps/Westchester/Peekskill.pdf>.
- NYSDEC (New York State Department of Environmental Conservation). 2003a. Draft State Pollutant Discharge Elimination System (SPDES) Discharge Permit (NY-000-4472)—Entergy Nuclear Indian Point Units #2 and #3 LLC.
- NYSDEC (New York State Department of Environmental Conservation). 2003b. Final Environmental Impact Statement Concerning the Applications to Renew SPDES Permits for the Roseton 1 and 2, Bowline 1 and 2 and Indian Point 2 and 3 Electric Generating Stations, Orange, Rockland and Westchester Counties Hudson River Power Plants. FEIS Accepted: June 25, 2003.
- NYSDEC (New York State Department of Environmental Conservation). 2003c. Fact Sheet, New York State Pollutant Discharge Elimination System (SPDES) Draft Permit Renewal with Modification Indian Point Electric Generating Station, Buchanan, NY. November 2003 Indian Point Units 1, 2, and 3, SPDES #NY-0004472.

- NYSDEC (New York State Department of Environmental Conservation). 2004. New York State Section 305(b) Water Quality Report for 2004. Albany, NY.
- NYSDEC (New York State Department of Environmental Conservation). 2005a. New York State Bald Eagle Report, Albany, NY. Accessed at <http://www.dec.state.ny.us/website/dfwmr/wildlife/endspec/baea2005.pdf> on June 2, 2006.
- NYSDEC (New York State Department of Environmental Conservation). 2005b. New York State Breeding Bird Atlas, 2000-2005. Accessed at <http://www.dec.state.ny.us/website/dfwmr/wildlife/bba/> <http://wwwapps.dec.state.ny.us/apps/BBAMap/index.cfm> on January 24, 2006.
- NYSDEC (New York State Department of Environmental Conservation). 2006. Peregrine Falcon Fact Sheet. Accessed at <http://www.dec.state.ny.us/website/dfwmr/wildlife/endspec/pefafs.html> on January 17, 2006.
- NYSHPO (New York State Historic Preservation Office). 2006. New York State Historic Preservation Office Geographic Information System (GIS)—Public Access. System contains information and data from the State and National Registers of Historic Places GIS Database and Archaeological Sensitivity GIS Database (SHPO Archaeological Site Files and New York State Museum Archaeological Site Files). Accessed at <http://www.eprhp.state.ny.us/nr/main.asp> on June 6, 2006.
- NYSL (New York State Library). 2004. New York: Local Open Space Planning Guide, 2004. Accessed at <http://www.nysl.nysed.gov/scandoclinks/ocm54975932.htm> on May 30, 2006.
- Shapley, D.; Morris, E. Poughkeepsie Journal, article "Dams damage river life, Environmentalists push to have defunct structures removed," July 3, 2005. Accessed at http://www.dcemc.org/fishkill/media/PoJo_07_03_05.htm on September 18, 2006.
- USAEC (U.S. Atomic Energy Commission). 1972. Final Environmental Statement Related to the Operation of Indian Point Unit No. 2, Docket No. 50-247. United States Atomic Energy Commission, Directorate of Licensing.
- USEPA (U.S. Environmental Protection Agency). 2000. EPA Docket W-00-03, Comment 1.73, November 9, 2000, "Personal Comments of William Sarbello" at page 15 of 25 attached to November 9, 2000, letter from William Sarbello to Proposed Rule Comment Clerk re Docket No. W-00-03, Proposed Rule, National Pollutant Discharge Elimination System—Regulations Addressing Cooling Water Intake Structures for New Facilities, Federal Register Vol. 65, No. 155. August 10, 2000. p. 49060-49121.
- USFWS (U.S. Fish and Wildlife Service). 1997. Significant Habitats and Habitat Complexes of The New York Bight Watershed. Hudson River Estuary, Habitat Complex 32, Lower Hudson River.

USFWS (U.S. Fish and Wildlife Service). 2007. Federally Listed Endangered and Threatened Species and Candidate Species in New York (by County), Revised January 31, 2007. Accessed at <http://www.fws.gov/northeast/nyfo/es/ColistCurrent.pdf> on February 12, 2007.

WCPWD (Westchester County Public Works Department). 2002. Division of Traffic Engineering, Traffic Counts—Cortlandt, NY, Station ID 878552, Kings Ferry Road to Buchanan V/L. September 2002. Accessed at <http://www.westchestergov.com/dpw/Traffic%20Counts/cortlandtcounts.htm> on June 2, 2006.

5.0 ASSESSMENT OF NEW AND SIGNIFICANT INFORMATION

“The environmental report must contain any new and significant information regarding the environmental impacts of license renewal of which the applicant is aware.” [10 CFR 51.53(c)(3)(iv)]

The NRC has resolved most license renewal environmental issues generically and only requires an applicant to analyze those issues the NRC has not resolved generically. While NRC regulations do not require an applicant's environmental report to contain analyses of the impacts of those environmental issues that have been generically resolved [10 CFR 51.53(c)(3)(i)], the regulations do require that an applicant identify any new and significant information of which the applicant is aware. [10 CFR 51.53(c)(3)(iv)]

Entergy performed an analysis to identify the following:

- information that identifies a significant environmental issue not covered in the NRC's GEIS and codified in the regulation, or
- information not covered in the GEIS analyses that lead to an impact finding different from that codified in the regulation.

NRC does not specifically define the term "significant." For its review, Entergy used guidance available in Council on Environmental Quality (CEQ) regulations. The NEPA authorizes CEQ to establish implementing regulations for federal agency use. The NRC requires license renewal applicants to provide the NRC with input, in the form of an environmental report, that the NRC will use to meet NEPA requirements as they apply to license renewal (10 CFR 51.10).

CEQ guidance provides that federal agencies should prepare environmental impact statements for actions that would significantly affect the environment (40 CFR 1502.3), focus on significant environmental issues (40 CFR 1502.1), and eliminate from detailed study issues that are not significant [40 CFR 1501.7(a)(3)]. The CEQ guidance includes a lengthy definition of "significantly" that requires consideration of the context of the action and the intensity or severity of the impact(s) (40 CFR 1508.27). Entergy expects that MODERATE or LARGE impacts, as defined by NRC, would be significant. Chapter 4 presents the [NRC definitions](#) of SMALL, MODERATE, and LARGE impacts.

Entergy reviewed SEISs and associated environmental Requests for Additional Information (RAIs) with license renewal applications to determine if there were new issues identified for those plants that may be applicable to IP2 and IP3. In addition, state and federal regulatory agencies were consulted regarding new and significant information as it related to license renewal environmental matters. In addition, Entergy has an ongoing assessment process for identifying and evaluating new and significant information that may affect programs at the Entergy nuclear sites, including those related to license renewal matters.

This process is directed in a joint effort by the nuclear corporate support group and environmental focus group members composed of technical personnel from the Entergy Nuclear South and Entergy Nuclear Northeast sites. A summary of this process follows.

- Issues relative to environmental matters are identified as follows:
 - Participation in industry utility groups (i.e., EEI, EPRI, NEI, and USWAG);
 - Participation in non-utility groups (i.e., Institute of Hazardous Materials Management and National Registry of Environmental Professionals);
 - Periodic reviews of proposed regulatory changes;
 - Entergy Nuclear Environmental Focus Group meetings.
- If the issue is applicable to the nuclear sites, it is then further evaluated by the nuclear corporate support group and environmental focus group that consist of technical personnel involved in environmental compliance, environmental monitoring, environmental planning, natural resource management, and health and safety issues. Necessary changes are made to the program and implemented in accordance with site and corporate procedures.

Additional actions incorporated into this assessment process specifically for IP2 and IP3 license renewal include the following.

- Review of documents related to environmental issues at IP2 and IP3.
- Review of current site activities and interview site personnel.
- Review of internal procedures for reporting to the NRC events that could have environmental impacts.
- Credit for the oversight provided by inspections of plant facilities by state and federal regulatory agencies.
- Review of environmental issues associated with other license renewal activities.

As a result of this assessment Entergy identified one potential issue that could be classified as new information, but not necessarily significant. This issue is discussed in Section 5.1 below.

5.1 New and Significant Information: Groundwater Contamination

The NRC identified degradation of groundwater quality resulting from closed-cycle cooling ponds as a Category 2 issue. Because Indian Point does not use cooling ponds, this Category 2 issue does not apply to renewal of the IP2 and IP3 Operating Licenses. However, contamination of

onsite groundwater due to leaking plant structures, systems, or components could potentially occur and is currently being evaluated as a generic issue to the nuclear industry.

Recent groundwater contamination events at several nuclear power plants have received considerable attention. Although no adverse dose impacts have been identified related to these events, there is concern that under different circumstances than have occurred in cases thus far, undetected leakage could result in areas of groundwater contamination, migration of radioactivity to the unrestricted area, and unevaluated doses to members of the public.

The NRC evaluated impairment of groundwater quality in Section 4.8.2 of the GEIS (NUREG-1437), including impacts due to tritium. As stated in the GEIS, slightly elevated concentrations of tritium have been observed in groundwater adjacent to the Prairie Island plant on the Mississippi River in southern Minnesota. These elevated concentrations have not altered the current use of groundwater near the site. One offsite privately owned well at the Prairie Island plant has reported tritium concentrations ranging between 800 and 1000 pCi/L (dates of measurements are uncertain, but they are no more recent than 1991). By comparison, tritium concentrations in North American streams were about 10 pCi/L prior to the beginning of the nuclear age and about 4000 pCi/L at the end of large-scale atmospheric testing of nuclear weapons in 1963. Radioactive decay of tritium between 1963 and 1992 would produce a concentration of about 715 pCi/L. If tritium concentrations at Prairie Island were as high as 1000 pCi/L in 1992, then perhaps one-third of the tritium contamination found in local groundwater might be attributable to the Prairie Island plant and the balance would be attributable to atmospheric testing. Future radioactive decay of tritium would further reduce its overall concentration in groundwater. Natural decay and tritium release to the environment at Prairie Island might be expected to reach equilibrium eventually at around 300 pCi/L. This compares with a regulatory limit of 20,000 pCi/L in drinking water. [NRC 1996, Section 4.8.2]

In preparing Section 4.8.2 of the GEIS, the NRC reviewed data from appropriate FSARs and FESs pertaining to the operation of nuclear power plants. Sites having a potential impact on groundwater quality were identified; and appropriate state water-use permitting agency representatives and USGS personnel were interviewed by telephone for additional information. The NRC concluded that groundwater quality impacts are considered to be of small significance when the plant does not contribute to changes in groundwater quality that would preclude current and future uses of the groundwater. Hence, the contribution of plant operations (during the license renewal period) to the cumulative impacts of major activities on groundwater quality would be relatively small. [NRC 1996, Section 4.8.2]

The impacts of plant operations and groundwater quality were also reviewed by the NRC in the SEIS for the D.C. Cook Nuclear Plant (NUREG-1437, Supplement 20). Two permitted locations at the Cook Nuclear Plant (CNP) were considered where discharge occurs to groundwater. [NRC 2005, Section 4.7]

Tritium has been detected periodically in groundwater in monitoring wells at the CNP site. Although, the authorization to discharge to groundwater does not contain criteria for tritium,

monitoring routine analyses shows that no sample has exceeded the drinking water standard of 20,000 pCi/L. [NRC 2005, Section 4.7]

On the basis of this information, the staff concluded that although the impacts to groundwater quality that would result from continued disposal of wastewater to onsite absorption ponds and sewage lagoons during the license renewal period are considered a new issue, the impacts would be SMALL and, therefore, not significant. Further the NRC determined that mitigation at CNP is not warranted. [NRC 2005, Section 4.7]

Indian Point

At Indian Point, Entergy identified shrinkage cracks in the IP2 spent fuel building wall in August 2005 while excavating in the IP2 Fuel Storage Building (FSB) Loading Bay, adjacent to the south wall of the Spent Fuel Pool (SFP). Cracks in the wall of the SFP exhibited moisture, which upon analysis indicated that the material had the same radiological and chemical characteristics as SFP water. Upon completion of radiological analysis, Entergy determined that the crack exhibited some contamination, and informed the NRC resident inspector of its observation on September 1, 2005.

On September 29, 2005, a sample was taken from MW-111 located in the IP2 transformer yard. Results obtained on October 5, indicated the presence of 211,000 pCi/Liter of tritium. Other [nearby] sampling wells showed no detectable activity. A four-hour report was made as a courtesy notification the NRC and other governmental agencies and followup sampling of nearby wells was initiated. [IPEC]

Entergy has been conducting an assessment since the discovery utilizing a network of monitoring wells to assess and characterize groundwater movement and behavior relative to groundwater contamination at Indian Point. Thirty-six groundwater monitoring wells and test wells have been installed to date in response to the radionuclide releases, to delineate the extent of groundwater impacts, and to define the source(s). Full characterization of the impact to groundwater is continuing. Preliminary results indicate that tritium contaminated groundwater exists at the site. During the course of delineating the sources of tritium, Strontium-90, Cesium-137, and Nickel-63 have been detected in low concentrations in some onsite groundwater monitoring well samples. In addition, the IP1 spent fuel pool was identified as a potential source of the radionuclides in groundwater.

Based on the results of the preliminary hydrogeologic characterization of the site, Entergy has concluded that some contaminated groundwater has likely migrated to the Hudson River. This release pathway is now being monitored and is included in the site effluents offsite dose calculations. A description of the local groundwater conditions were discussed in [Section 2.3](#) of this ER. As discussed in [Section 2.3](#), the site does not utilize groundwater for any of its cooling water, service water, potable water needs, or for any other beneficial uses. As described in [Section 2.10.1](#) of this ER, IP2 and IP3 obtains its cooling and service water supplies from the Hudson River, and potable water supplies from the Village of Buchanan, New York Public Water System. The Village of Buchanan obtains its water from contracts with the City of Peekskill and the Montrose Improvement District (now joined with the NWJWW), which do not utilize

groundwater in the vicinity of Indian Point. This is expected to be true during the IP2 and IP3 license renewal term.

Based on samples from the site monitoring wells, survey analyses, annual rainfall recharge to groundwater, information determined from current hydrological assessment, and application of an estimated hydrological gradient to the Hudson River, a total body dose of $1.65\text{E-}3$ mrem/year is estimated to the maximally exposed individual. This represents 0.055% of the NRC limit of 3 mrem/year for liquid effluent releases [Entergy].

Based on currently available information and the sampling data that have been analyzed and assessed to date, the NRC and Entergy have not found any condition that indicates that occupational or public health and safety have been, or likely will be, affected by the current onsite groundwater contamination. This assessment is based on the fact that there is no drinking water pathway associated with groundwater or the Hudson River in the region surrounding Indian Point, and samples taken in support of the NRC-required Radiological Environmental Monitoring Program (REMP) continue to indicate no detectable plant related radioactivity in groundwater above safe drinking water standards beyond the site boundary. Samples taken include the offsite REMP sampling locations as defined in the IP2 and IP3 ODCMs, the local municipal drinking water reservoirs, and other groundwater monitoring wells located in the immediate vicinity of the plant.

Identified onsite release sources are now being monitored and any contaminated discharges documented as an effluent release in accordance with NRC regulatory requirements. Although the migration of contaminated groundwater to the Hudson River was considered an unmonitored release, it has now been incorporated into the site's effluent monitoring program and is documented in the Annual Radiological Effluents Release Report prepared in accordance with US NRC Regulatory Guide 1.21. While the hydrological site assessment and groundwater analysis allow conservative estimation of such a release to confirm that public health and safety is not adversely affected, efforts have been undertaken by Entergy to find the source(s), repair the condition, and restore the effluent control process as originally designed [NRC 2006]. An extensive hydrogeologic characterization project is currently being conducted at the Indian Point site to delineate discharges to groundwater and to define the measures most protective of the public. To date, results have shown that the IP1 fuel pool as a confirmed source of at least some of the tritium, as well as strontium, cesium, and nickel in the groundwater. Ongoing mitigation activities for this source include treatment of the fuel pool water via a decontamination system installed in August 2006. This source term reduction strategy is expected to reduce contaminants in the groundwater that result from Unit 1 pool leakage. A well near IP1 has shown reductions in concentration and additional trend data will continue to be collected to determine the long-term impact of the ongoing source term reduction. Planned future mitigation actions include continued decontamination of the pool water, as well as the eventual removal of all fuel from the pool to dry casks and the draining of the pool to remove any source of contamination. The long-term monitoring program will be used to determine the need for any additional remediation once groundwater trends are established. If warranted, a pumped treatment technology may be employed as a future mitigation measure.

Although the IP2 spent fuel pool was initially suspected to be the source of the onsite groundwater contamination, no leaks have been identified in the IP2 fuel pool liner and the contamination in that area is not consistent with active leakage. This would indicate that the contamination related to the IP2 fuel pool is the result of historical pool leakage in the 1990s which has since been repaired. Although the results of the ongoing monitoring program do not indicate that any mitigation is warranted at this time, Entergy has installed a pilot recovery well next to the IP2 pool and testing has been conducted to determine the efficacy of this remediation method, should future mitigation become warranted. The on-going long-term groundwater monitoring program will continue to be used to monitor the levels of contamination around the site. The results of this program, along with the final results of the site hydrogeologic characterization, will be used to determine the need for mitigation of this contamination on an ongoing basis.

The NRC has indicated in the CNP SEIS (NUREG-1437, Supplement 20) that the release of radionuclides to the groundwater is considered a new issue. Entergy has reviewed the available data and has concluded that the site conditions do not impact the onsite workforce. The radionuclide release is not anticipated to change environmental considerations, such as water usage, land usage, terrestrial or aquatic ecological conditions, or air quality, and is not expected to affect socioeconomic conditions, as a result of license renewal activities. In addition, no NRC dose limits have been exceeded and EPA drinking water limits are not applicable since no drinking water pathway exists. Although impacts to site groundwater quality have occurred, measures have and are being taken to control releases from the Spent Fuel Pools using waste management equipment and processes. Additional monitoring actions have been developed as part of the site's Groundwater Monitoring Program, and actions added to the existing REMP to monitor potential impacts of site operations throughout the license renewal term and to monitor potential impacts of site operations and waste and effluent management programs. On the basis of current information, Entergy concludes that although the existence of radionuclides in the groundwater during the license renewal period are potentially a new issue, the impacts of those radionuclides would be SMALL and not significant.

5.2 References

Entergy. 2007. Internal Memorandum. Annual Summary of Ground Water Dose Evaluation - 2006.

IPEC Condition Reports and Apparent Cause Evaluation in response to CR-IP2-2005-3986 and CR-IP2-2005-04151. 2005.

NRC (U.S. Nuclear Regulatory Commission). 1996. Generic Environmental Impact Statement for License Renewal of Nuclear Plants (GEIS), Volumes 1 and 2, NUREG-1437, Washington, DC.

NRC (U.S. Nuclear Regulatory Commission). 2005. Generic Environmental Impact Statement for License Renewal of Nuclear Plants, NUREG-1437, Supplement 20, Regarding D.C. Cook Nuclear Plant, Final Report. Office of Nuclear Reactor Regulation. Washington, DC.

NRC (U.S. Nuclear Regulatory Commission). 2006. Indian Point Nuclear Generating Unit 2 --
Special Inspection Report No. 05000247/2005011.

6.0 SUMMARY OF LICENSE RENEWAL IMPACTS AND MITIGATING ACTIONS

6.1 License Renewal Impacts

Entergy has reviewed the environmental impacts of renewing the IP2 and IP3 Operating Licenses and has concluded that all impacts would be SMALL and further mitigation measures are not warranted. This environmental report documents the basis for Entergy's conclusion. [Section 4](#) incorporates by reference NRC findings for the 43 Category 1 issues that apply to IP2 and IP3 (and for the two "NA" issues for which NRC came to no generic conclusion), all of which have environmental impacts that are SMALL. The remainder of Section 4 analyzes Category 2 issues, all of which are either not applicable or have impacts that would be SMALL. [Table 6-1](#) identifies the environmental impacts that IP2 and IP3 license renewal would have on resources associated with Category 2 issues.

6.2 Mitigation

6.2.1 Requirement [10 CFR 51.45(c)]

The report must contain a consideration of alternatives for reducing adverse impacts, as required by §51.45(c), for all Category 2 license renewal issues in Appendix B to subpart A of this part. No such consideration is required for Category 1 issues in Appendix B to subpart A of this part. [10 CFR 51.53(c)(3)(iii)]

6.2.2 Entergy Response

As discussed in Supplement 1 to Regulatory Guide 4.2, "Preparation of Supplemental Environmental Reports for Applications to Renew Nuclear Power Plant Operating Licenses," when adverse environmental effects are identified, 10 CFR 51.45(c) requires consideration of alternatives available to reduce or avoid these adverse effects. Furthermore, Supplement 1 states, "Mitigation alternatives are to be considered no matter how small the adverse impact; however, the extent of the consideration should be proportional to the significance of the impact" [NRC 2000].

As described in Section 6.1 and shown in Table 6-1, analysis of the Category 2 issues found the impacts to be small for the applicable issues. For these issues, the current permits, practices, and programs (e.g., radiological monitoring and environmental review programs) that mitigate the environmental impacts of plant operations are adequate. Therefore, this ER finds that no additional mitigation measures are sufficiently beneficial as to be warranted.

**Table 6-1
Environmental Impacts Related to License Renewal at IP2 and IP3**

Issue	Environmental Impact
Surface Water Quality, Hydrology and Use (for all plants)	
Water use conflicts (plants with cooling ponds or cooling towers using make-up water from a small river with low flow) [10 CFR 51.53(c)(3) (ii)(A)]	NONE. IP2 and IP3 are equipped with once-through cooling systems that utilize make-up water from an estuary on the Hudson River. IP2 and IP3 do not have or use cooling ponds or cooling towers. Consideration of mitigation is not required.
Aquatic Ecology (for all plants with once-through and cooling pond heat dissipation systems)	
Entrainment of fish and shellfish [10 CFR 51.53(c)(3)(ii)(B)]	SMALL. Historic and current studies have shown no negative trend in overall aquatic river species populations related to plant operations. Current mitigation measures implemented through the HRSA and fourth amended Consent Order, and the ongoing SPDES permitting process will ensure impacts remain SMALL. Further consideration of mitigation measures is not warranted.
Impingement of fish and shellfish [10 CFR 51.53(c)(3)(ii)(B)]	SMALL. Historic and current studies have shown no negative trend in overall aquatic river species populations related to plant operations. Current mitigation measures implemented through the HRSA and fourth amended Consent Order, and the ongoing SPDES permitting process will ensure impacts remain SMALL. Further consideration of mitigation measures is not warranted.
Heat shock [10 CFR 51.53(c)(3)(ii)(B)]	SMALL. Historic and current studies have shown no negative trend in overall aquatic river species populations related to plant operations. Current mitigation measures implemented through the HRSA and fourth amended Consent Order, and the ongoing SPDES permitting process will ensure impacts remain SMALL. Further consideration of mitigation measures is not warranted.
Ground-water Use and Quality	
Groundwater use conflicts (plants using > 100 gpm of groundwater) [10 CFR 51.53(c)(3)(ii)(C)]	NONE. There are no pumpable groundwater wells at the IP2 and IP3 site. Potable water is supplied by the Village of Buchanan with cooling and service water taken from the Hudson River estuary. Consideration of mitigation is not required.
Groundwater use conflicts (plants using cooling towers withdrawing make-up water from a small river) [10 CFR 51.53(c)(3)(ii)(A)]	NONE. IP2 and IP3 do not have or use cooling towers. The Station obtains cooling and service water from the Hudson River estuary and potable water from the Village of Buchanan. Consideration of mitigation is not required.
Groundwater use conflicts (Ranney Wells) [10 CFR 51.53(c)(3)(ii)(C)]	NONE. IP2 and IP3 do not have or use Ranney wells. Consideration of mitigation is not required.

Table 6-1 (Continued)
Environmental Impacts Related to License Renewal at IP2 and IP3

Issue	Environmental Impact
Degradation of groundwater quality [10 CFR 51.53(c)(3)(ii)(D)]	NONE. IP2 and IP3 do not have or utilize cooling ponds. IP2 and IP3 are equipped with once-through cooling systems. Consideration of mitigation is not required.
Terrestrial Resources	
Refurbishment impacts on terrestrial resources [10 CFR 51.53(c)(3)(ii)(E)]	NONE. No refurbishment activities have been identified. Consideration of mitigation is not required.
Threatened or Endangered Species (for all plants)	
Threatened or endangered species [10 CFR 51.53(c)(3)(ii)(E)]	SMALL. No refurbishment activities have been identified. No adverse impacts to threatened or endangered species were expected due to continued operations of IP2 and IP3. Further consideration of mitigation measures is not warranted.
Air Quality	
Air quality during refurbishment [10 CFR 51.53(c)(3)(ii)(F)]	NONE. No refurbishment activities have been identified. Consideration of mitigation is not required.
Human Health	
Microbiological (Thermophilic) Organisms [10 CFR 51.53(c)(3)(ii)(G)]	NONE. IP2 and IP3 are not located on a small river or small lake, and do not have or use cooling ponds. Further consideration of mitigation measures is not warranted.
Electromagnetic fields – Acute effects [10 CFR 51.53(c)(3)(ii)(H)]	SMALL. Transmission lines constructed to connect the plant to the transmission system meet the NESC® recommendations for preventing electric shock from induced currents. Further consideration of mitigation measures is not warranted.
Socioeconomics	
Housing impacts [10 CFR 51.53(c)(3)(ii)(I)]	SMALL. No refurbishment activities have been identified. Entergy does not anticipate an increase in employment during the period of extended operation. Therefore, no additional impacts to housing are expected due to continued operations of IP2 and IP3. Further consideration of mitigation measures is not warranted.

Table 6-1 (Continued)
Environmental Impacts Related to License Renewal at IP2 and IP3

Issue	Environmental Impact
Public utilities: public water supply availability [10 CFR 51.53(c)(3)(ii)(I)]	SMALL. No refurbishment activities have been identified and no additional workers anticipated during the period of extended operation. PWSs near IP2 and IP3 currently have adequate system capacity to meet demand of residential and industrial customers in the area. Further consideration of mitigation measures is not warranted.
Education impacts from refurbishment [10 CFR 51.53(c)(3)(ii)(I)]	NONE. No refurbishment activities have been identified. Consideration of mitigation is not required.
Offsite land use (effects of refurbishment activities) [10 CFR 51.53(c)(3)(ii)(I)]	NONE. No refurbishment activities have been identified. Consideration of mitigation is not required.
Offsite land use (effects of license renewal) [10 CFR 51.53(c)(3)(ii)(I)]	SMALL. The area around IP2 and IP3 has pre-established land patterns of development and has public services and regulatory controls in place to support and guide development. No additional workers are anticipated during the period of extended operation. Further consideration of mitigation measures is not warranted.
Local transportation impacts 10 CFR 51.53(c)(3)(ii)(J)]	SMALL. No refurbishment activities have been identified and no increases in total number of employees during the period of extended operation are expected. Further consideration of mitigation measures is not warranted.
Historic and archaeological properties [10 CFR 51.53(c)(3)(ii)(K)]	SMALL. No refurbishment activities have been identified and no archaeologically and historically sensitive areas are present on-site. Further consideration of mitigation measures is not warranted.
Postulated Accidents	
Severe accident mitigation alternatives [10 CFR 51.53(c)(3)(ii)(L)]	SMALL. No impact from continued operation. Potentially cost-effective SAMAs are not related to adequately managing the effects of aging during period of extended operation. Further consideration of mitigation measures is not warranted.

6.3 Unavoidable Adverse Impacts

6.3.1 Requirement [10 CFR 51.45(b)(2)]

The applicant's report shall discuss any adverse environmental effects which cannot be avoided upon implementation of the proposed project.

6.3.2 Entergy Response

Section 4 of this ER contains the results of Entergy's review and the analyses of the Category 2 issues as required by 10 CFR 51.53(c)(3)(ii). These reviews take into account the information that has been provided in the GEIS, Appendix B to Subpart A of 10 CFR Part 51, and information specific to IP2 and IP3.

An environmental review conducted at the license renewal stage differs from the review conducted in support of a construction permit because the facility is in existence at the license renewal stage and has operated for a number of years. As a result, adverse impacts associated with the initial construction have been avoided, have been mitigated, or have already occurred.

The environmental impacts to be evaluated for license renewal are those associated with refurbishment and continued operation during the renewal term. The review and analysis of Category 2 issues associated with refurbishment and continued operation of IP2 and IP3 did not identify any significant adverse environmental impacts. The evaluation of structures and components required by 10 CFR 54.21 has been completed. No plant refurbishment activities, outside the bounds of normal plant component replacement and inspections, have been identified to support continued operation of IP2 and IP3 beyond the end of the existing operating license. As a result of these reviews and analyses, Entergy is not aware of significant adverse environmental effects that cannot be avoided upon implementation of the proposed project.

6.4 Irreversible or Irretrievable Resource Commitments

6.4.1 Requirement [10 CFR 51.45(b)(5)]

The applicant's report shall discuss any irreversible and irretrievable commitments of resources which would be involved in the proposed action should it be implemented.

6.4.2 Entergy Response

The continued operation of IP2 and IP3 for the period of extended operation will result in irreversible and irretrievable resource commitments, including the following:

- nuclear fuel, which is consumed in the reactor and converted to radioactive waste;
- the land required to permanently store or dispose of spent nuclear fuel, low-level radioactive wastes generated as a result of plant operations, and sanitary wastes generated from normal industrial operations;
- elemental materials that will become radioactive;
- materials used for the normal industrial operations of IP2 and IP3 that cannot be recovered or recycled or that are consumed or reduced to unrecoverable forms.

Other than the above, there are no refurbishment activities or changes in operation of IP2 and IP3 during the period of extended operation that would irreversibly or irretrievably commit environmental components of land, water, and air.

However, the likely power generation alternatives if IP2 and IP3 cease operations on or before the expiration of the current operating licenses would require a commitment of resources for construction of the replacement plants as well as for fuel to run the plants.

6.5 Short-term Use Versus Long-term Productivity

6.5.1 Requirement [10 CFR 51.45(b)(4)]

The applicant's report shall discuss the relationship between local short-term uses of man's environment and the maintenance and enhancement of long-term productivity.

6.5.2 Entergy Response

The current balance between short-term use and long-term productivity of the environment at the site has remained relatively constant since IP2 and IP3 began operating in 1972 and 1975, respectively. The *Final Environmental Statement Related to the Operation of Indian Point Nuclear Generating Plant Unit No. 2* and the *Final Environmental Statement Related to the Operation of Indian Point Nuclear Generating Plant Unit No. 3* evaluated the relationship between the short-term uses of the environment and the maintenance and enhancement of the long-term productivity associated with the construction and operation of IP2 and IP3 [USAEC; NRC 1975]. The period of extended operation will not alter the short-term uses of the environment from the uses previously evaluated in the FES. The period of extended operation will postpone the availability of the site resources (land, air, water). Denial of the application to renew the IP2 and IP3 Operating Licenses would lead to the shutdown of the plants and would alter the balance in a manner that depends on the subsequent uses of the site. For example, the environmental consequences of turning the Indian Point site into a park or an industrial facility are quite different. However, extending operations will not adversely affect the long-term uses of the site.

There are no refurbishment activities or changes in operation of IP2 and IP3 planned for the period of extended operation that would alter the evaluation of the FES for the relationship between local short-term uses of man's environment and the maintenance and enhancement of long-term productivity of these resources.

6.6 References

NRC (U.S. Nuclear Regulatory Commission). 1975. Final Environmental Statement Related to the Operation of Indian Point Unit No. 3, Docket No. 50-286. United States Nuclear Regulatory Commission, Office of Nuclear Reactor Regulation.

NRC (U.S. Nuclear Regulatory Commission). 2000. Supplement 1 to Regulatory Guide 4.2, Preparation of Supplemental Environmental Reports for Applications to Renew Nuclear Power Plant Operating Licenses.

USAEC (U.S. Atomic Energy Commission). 1972. Final Environmental Statement Related to the Operation of Indian Point Unit No. 2, Docket No. 50-247. United States Atomic Energy Commission, Directorate of Licensing.

7.0 ALTERNATIVES CONSIDERED

7.1 Introduction

NRC regulations require that an applicant's environmental report discuss alternatives to a proposed action [10 CFR 51.45(b)(3)]. The intent of this review is to enable the Commission to consider the relative environmental consequences of the proposed action as compared to the environmental consequences of other activities that also meet the purpose of the proposed action and meet system generation needs. In addition, this review addresses the environmental consequences of taking no action [NRC 2002, Section 8.2]. The alternatives are discussed below.

7.2 Proposed Action

The site was constructed as a three-unit station, but IP1 has been shut down and is in SAFSTOR until it is decommissioned. A plan has been submitted for the eventual decommissioning of IP1. The proposed action is to renew the operating licenses for IP2 and IP3, which would provide the option for Entergy to continue to operate IP2 and IP3 through the 20-year period of extended operation. IP2 and IP3 utilize pressurized water reactors and turbine generators licensed for outputs of 3,216 and 3,216 MWt, and ratings of 1,078 and 1,080 MWe, respectively, for a combined total of 2,158 MWe.

The review of the environmental impacts required by 10 CFR 51.53(c)(3)(ii) is provided in [Section 4](#). Based on this review, Entergy concludes that the environmental impacts of IP2 and IP3 operations during the license renewal period would be small.

7.3 No-Action Alternative

The "no-action alternative" to the proposed action is not to renew the operating licenses for IP2 and IP3. In this alternative, it is expected that IP2 and IP3 will continue to operate up to the end of the existing operating license, at which time plant operation would cease and decommissioning would begin. Because IP2 and IP3 constitute a significant block of long-term base-load capacity, it is reasonable to assume that a decision not to renew the IP2 and IP3 licenses would necessitate the replacement of its approximately 2,158 gross MWe capacity with other sources of generation. The environmental impacts of the no-action alternative would be

- the environmental impacts from decommissioning IP2 and IP3, and
- the environmental impacts from a replacement power source or sources.

Environmental impacts associated with decommissioning are discussed in [Section 7.4](#). The environmental impacts associated with replacement power would be the impacts from the construction and operation of a source of replacement power at a new location (greenfield) or at the site (brownfield). The environmental impacts of these various types of replacement power are discussed in [Section 8](#) of this ER.

7.4 Decommissioning Impacts

A nuclear power plant licensee is required to submit decommissioning plans within two years following permanent cessation of operation of a unit or at least five years before expiration of the operating license, whichever occurs first, pursuant to the requirements of 10 CFR 50.54(b).

The GEIS defines decommissioning as the safe removal of a nuclear facility from service and the reduction of residual radioactivity to a level that permits release of the property for unrestricted use and termination of the license [NRC 1996, Section 7.1]. NRC-evaluated decommissioning options include immediate decontamination and dismantlement (DECON) and safe storage of the stabilized and defueled facility (SAFSTOR) for a period of time, followed by decontamination and dismantlement.

Regardless of the option chosen, decommissioning must be completed within a 60-year period. Under the no-action alternative, Entergy would continue operating IP2 and IP3 until the current licenses expire, then initiate decommissioning activities in accordance with NRC requirements. The GEIS describes decommissioning activities based on an evaluation of an example reactor (the "reference" reactor is the 1,155 MWe Washington Public Power Supply System's Columbia Nuclear Power Plant) [NRC 1996, Section 7.1]. This plant is similar in size when compared with either of IP2 or IP3 individually, although it is smaller than the combined size when IP2 or IP3 are considered as a whole. However the impacts from decommissioning both units are considered to be similar to the impacts cited for the Columbia Nuclear Power Plant.

As the GEIS notes, NRC has evaluated environmental impacts from decommissioning. NRC-evaluated impacts include occupational and public radiation dose; impacts of waste management; impacts to air and water quality; and ecological, economic, and socioeconomic impacts. NRC indicated in Section 4.3.8 of the *Final Generic Environmental Impact Statement on Decommissioning of Nuclear Facilities* [NRC 2002] that the environmental effects of greatest concern (i.e., radiation dose and releases to the environment) are substantially less than the same effects resulting from reactor operations. Entergy adopts by reference the NRC conclusions regarding environmental impacts of decommissioning.

Entergy notes that decommissioning activities and their impacts are not discriminators between the proposed action and the no-action alternative. Entergy will eventually have to decommission all units on the site; license renewal would only postpone decommissioning for a maximum of 20 years. NRC has established in the GEIS that the timing of decommissioning operations does not substantially influence their environmental impacts. Entergy adopts by reference the NRC findings (10 CFR Part 51, Appendix B, Table B-1, Decommissioning) to the effect that delaying decommissioning until after the renewal term would have small environmental impacts.

Entergy concludes that the decommissioning impacts under the no-action alternative would not be substantially different from those occurring following license renewal, as identified in the GEIS [NRC 2002, Section 8.4] and in the decommissioning generic environmental impact statement [NRC 2002, Section 6.0]. These impacts would be temporary and would occur at the same time as the impacts from meeting system generating needs.

7.5 Alternative Energy Sources

IP2 and IP3 are used for base-load generation. The GEIS states that coal-fired and gas-fired generation capacity are the feasible alternatives to nuclear power generating capacity, based on current (and expected) technological and cost factors. The following generation alternatives were considered in detail in this ER.

- Coal-fired generation at an alternate site ([Section 8.2.1](#)). Entergy did not consider coal-fired generation at the site since it was concluded that there was not enough land to build a comparable coal-fired unit and a coal yard. Based on Table 8.1 of the GEIS, it would take approximately 1.7 acres of land per MWe to construct a coal-fired plant. The site is situated on approximately 239 acres. Therefore, for the 2,040 MWe plant described in Section 8.2.1, a coal-fired plant would require approximately 3,468 acres of land.
- Natural gas-fired generation at the site and at an alternate site ([Section 8.2.2](#)). In order for a natural gas-fired unit to be constructed on-site, additional land would have to be acquired due to limited onsite acreage. The site is situated on approximately 239 acres. For the power block area only, the GEIS estimated that 110 acres are needed for a 1,000 MWe natural gas-fired facility [NRC 1996, Section 8.3.10]. Scaling up for the 2,040 MWe facility would indicate a land requirement of approximately 224 acres, which would not be inclusive of support facilities. In addition, new generation units would have to be constructed in a timely manner concurrent with decommissioning, so the entire site would not be available.
- Nuclear generation at an alternate site ([Section 8.2.3](#)). Entergy did not consider nuclear generation at the site since it was concluded that there was not enough land to build a new nuclear unit. Based on Table 8.1 of the GEIS, it would take approximately 0.5 to 1.0 acres of land per MWe to construct a new nuclear plant. The site is situated on 239 acres of which approximately 70 acres is not currently being utilized for plant operations. Therefore, the site acreage would be insufficient for locating the new nuclear generation facilities described in this analysis.

Entergy's experience indicates that, although customized unit sizes can be built, using standardized sizes is more economical. For example, a standard-sized gas-fired combined cycle plant has a net capacity of 408 MWe. This plant would consist of two 135-MWe gas combustion turbines and 135 MWe of heat recovery capacity. For comparability, Entergy set the net power of the hypothetical coal-fired unit equal to the hypothetical gas-fired plant. Together, five such coal- or gas-fired plants would provide close to the same capacity as IP2 and IP3 combined (2,158 MWe). Although these hypothetical coal- or gas-fired plants understates the impacts of replacing 2,158 MWe at IP2 and IP3 by approximately 5%, Entergy believes these differences are insignificant, and ensures against overstating environmental impacts from the alternatives.

These alternatives are presented (Sections [8.2.1](#), [8.2.2](#), and [8.2.3](#), respectively) as if such plants were constructed at the site (natural gas-fired only), using the existing water intake and discharge structures, switchyard, and transmission lines, or at an alternate location that could be

either a current industrial site or an undisturbed, pristine site requiring a new generating building and facilities, new switchyard, and at least some new transmission lines. In this ER, a "greenfield" site is assumed to be an undisturbed, pristine site.

Depending on the location of an alternative site, it might also be necessary to connect to the nearest gas pipeline (in the case of natural gas) or rail line (in the case of coal). The requirement for these additional facilities may increase the environmental impacts relative to those that would be experienced at the site.

The potential for using imported power is discussed in [Section 8.2.4](#). Imported power is considered feasible, but would result in the transfer of environmental impacts from the current region in New York to some other location in New York, another state, or a Canadian province. In addition, there is no assurance that the capacity or energy would be available during the required time frame.

As stated in NUREG-1437, Vol.1, Section 8.1, the "NRC has determined that a reasonable set of alternatives should be limited to analysis of single, discrete electric generation sources and only electric generation sources that are technically feasible and commercially viable" [NRC 1996]. Accordingly, the following alternatives were not considered as reasonable replacement base-load power generation. Although several of these alternatives could be considered in combination for replacement power generation at multiple sites, they do not generally provide base-load generation, and would entail greater environmental impacts.

- wind
- solar
- hydropower
- geothermal
- wood energy
- municipal solid waste
- other biomass-derived fuels
- oil
- fuel cells
- delayed retirement
- utility-sponsored conservation
- purchased/imported power
- combination of alternatives

These technologies were eliminated as possible replacement power alternatives for one or more of the following reasons.

- High land-use impacts. Some of the technologies listed above (wind, solar, and hydroelectric) would require a large area of land and would thus require a greenfield siting plan. This would result in a greater environmental impact than continued operation of IP2 and IP3.

- Low capacity factors. Some of the technologies identified above (wind, solar, and hydroelectric) are not capable of replacing the 2,158 MWe of power at high capacity factors. These generation technologies are used as peaking power sources, as opposed to base-load power sources, and for this reason are not reasonable alternatives.
- Geographic availability of the resource. Some of the technologies are not feasible because there is no feasible location in the area served by the site.
- Emerging technology. Some of the technologies have not been proven as reliable and cost-effective replacements for a large generation facility. Therefore, these technologies are typically used with smaller (lower MWe) generation facilities.
- Availability. There is no assurance of the availability of imported power.
- Lack of control over utility sponsored conservation programs. Entergy does not own or operate the transmission lines that are utilized to distribute electricity generated from the IP2 and IP3 facilities. Therefore, conservation programs are driven by the corporation that purchases and distributes the electricity.

7.6 References

NRC (U.S. Nuclear Regulatory Commission). 1996. NUREG-1437, Generic Environmental Statement for License Renewal of Nuclear Power Plants, Final Report. Washington, DC.

NRC (U.S. Nuclear Regulatory Commission). 2002. NUREG-0586, Supplement 1, Final Generic Environmental Impact Statement on Decommissioning of Nuclear Facilities Supplement 1, Regarding the Decommissioning of Nuclear Power Reactors. Washington, DC.

8.0 COMPARISON OF IMPACTS

The following key assumptions have been made in the review of alternative energy sources. These key assumptions are intended to simplify the evaluation, yet still allow the no-action alternative review to meet the intent of NEPA requirements and NRC environmental regulations.

- The goal of the proposed action (license renewal) is the production of approximately 2,158 MWe of base-load generation. Alternatives that do not meet this goal are not considered in detail.
- The time frames for the needed generation would be 2013–2033 for IP2 and 2015–2035 for IP3.
- Purchased power is not considered a reasonable alternative because there is no assurance that the capacity or energy would be available during the required time frame. See [Section 8.2.4](#).
- The total combined annual capacity factor of the site based on a five year average is 95%. The capacity factor is targeted to remain at or near this value throughout the plant's operating life.
- The environmental impacts of the continued utilization of once-through cooling for both IP2 and IP3 are considered as part of the proposed action. Closed-cycle cooling systems are considered in this section as an alternative to once-through cooling.
- All necessary Federal permits, licenses, approvals, and other entitlements would be obtained.

8.1 Closed-Cycle Cooling Alternative

A discussion of the potential environmental impacts of IP2 and IP3's once-through cooling systems is provided in Sections [4.2](#), [4.3](#), and [4.4](#). NYSDEC's draft SPDES permit proposed replacement of the existing once-through cooling systems with closed-cycle cooling systems, provided that NRC-issued license renewals are obtained for both stations, feasibility of the closed-cycle cooling system is demonstrated, safety is assured (as determined by NRC), and all necessary permits, authorizations, and approvals for the closed-cycle cooling systems can be obtained. The potential environmental impacts of implementing a closed-cycle cooling system alternative are evaluated in this section.

The site is currently equipped with an upgraded once-through heat dissipation system that withdraws cooling water from the Hudson River using state of the art Ristroph screens and fish return systems in conjunction with variable/dual speed pumps and operational measures to minimize entrainment and impingement, and then discharges back to the river. The details of the plants' cooling systems, intake structures, and discharge systems are provided in [Section 3](#) of this ER. IP2 and IP3 each have shoreline-situated intake structures consisting of seven bays (six

for circulating water and one for service water). Additional service water and screen wash water is provided for IP2 from the IP1 intake structure.

IP2 has six, two-speed, circulating water pumps designed to pump 140,000 gpm at full speed and 84,000 gpm at reduced speed. IP3 has six, variable-speed, circulating water pumps designed to pump 140,000 gpm at full speed and 64,000 gpm at the lowest speed. Each unit has six service water pumps, IP2 rated at 5,000 gpm per each pump and IP3 rated at 6,000 gpm per each pump. There are three back-up service water pumps located on a platform at IP3 over the discharge channel. [CHGEC, Section IV.D.2.c]

The circulating water intake bays at IP2 have modified vertical Ristroph-type traveling water screens. Design features incorporated into the machines were developed and tested in concert with the Hudson River Fishermen's Association. Key fish-conserving components of the screens are screen basket lip troughs designed to retain water and minimize vortex stress, a high-pressure spray wash system for debris removal from the front side of the machine, a low-pressure spray wash system for fish removal from the rear side of the machine, and a fish sluice system for collection of the impinged fish for return to the river. The 0.25-by-0.5-inch clear opening slot mesh on the screen basket panels is smooth to minimize fish abrasion across the mesh into the collection sluice. The modified traveling screens consist of a series of panels attached to an endless chain designed to rotate continuously around an upper and lower sprocket shaft system. As baskets rotate out of the intake bay, impinged fish are retained in the water-filled rails and are carried over the headshaft, where they are washed out onto the mesh. A low-pressure wash system facilitates the transfer of fish to the fish collection sluice for return to the Hudson River. [CHGEC, Section IV.B.2.c]

Fish are returned to the estuary through a 12-inch diameter pipe that extends 200 feet into the river on the north side of the IP2 intake structure. The pipe is partially buried in the river bottom, and discharges fish at a depth of 35 feet. The location of the discharge was selected after conducting dye and fish release studies to find a location that would minimize re-impingement. [CHGEC, Section IV.B.2.c] Key components of the IP3 screens are identical to those installed at IP2. At IP3 a fish return system discharges outside the NW corner of the discharge canal [CHGEC, Section IV.D.2.c].

After moving through the condensers, cooling water from IP2 and IP3 flows downward from the discharge water boxes by way of six 96-inch down pipes, and exits under the water surface in a 40-foot-wide discharge canal [CHGEC, Section IV.B.2.e]. The cooling water from the canal is released into the Hudson River. Typically, the temperature increase across the IP3 condenser at 360 rpm is in the range from 14.6°F to 18.0°F (8.1°C to 10°C) and at IP2 with all fast speed pumps from 17°F to 22°F (9.44°C to 12.22°C). Severe fouling due to debris in the Hudson River may cause the water temperature increase across the condensers to go as high as approximately 35°F (19.44°C). [IP2; IP3]

The Indian Point discharge structure is discussed in [Section 3.2.2.3](#). The outfall or discharge structure for the IP2 and IP3 facility is designed to enhance mixing of cooling water and river water in such a way as to minimize thermal impact in the river. The cooling water from the

discharge channel is released to the Hudson River via an outfall structure located south of IP3. The outfall structure, depicted schematically in [Figure 3-8](#), consists of 12 submerged rectangular ports equipped with adjustable gates that are in line and parallel to the river axis. The ports, 4 feet high by 15 feet wide and spaced 21 feet apart (center to center), are submerged to a depth of 12 feet (center to surface) at mlw. The first upstream port is approximately 600 feet from the IP3 intake; the length of the total port section is approximately 252 feet. The discharge port gates can be adjusted mechanically to maintain a minimum hydraulic head differential of 1.75 feet across the outfall structure, which assures a discharge velocity of approximately 10 fps. [[CHGEC](#), Section IV.B.2.e]

The permitting history for surface water discharges and cooling water intake structures is addressed in Sections [4.2](#) and [4.3](#). Briefly, former owners Consolidated Edison and NYPA submitted an Environmental Report in 1976 to the NRC in which various alternative closed-cycle cooling systems were evaluated from an economic and environmental standpoint. In 1980, the HRSA was negotiated between the USEPA, NYSDEC, and owners of several Hudson River facilities, including IP2 and IP3, among others. As a result of the HRSA, IP2 and IP3 each submitted license amendment requests to the NRC for the removal of the license condition 2.E that required the closed-cycle cooling system [[NRC 1981](#); [HRSA](#)]. IP2's License Amendment No. 71 removed Condition 2.E from IP2 (a similar license condition and amendment for IP3, License Amendment No. 37, was granted at the same time), effective May 14, 1981. Some of the measures in the HRSA included (1) equipment retrofitting, including installation of dual or variable speed intake pumps and of angled screens, with fish return systems to minimize impingement; (2) operational measures, including flow limitations and outages; (3) ongoing biological monitoring (a joint requirement of all of the power generators party to the HRSA); and (4) a striped bass fish hatchery (again, a joint requirement of all of the power generators party to the HRSA) [[HRSA](#)].

Surface-water discharges at Indian Point currently are regulated under the NYSDEC permit program. The current existing SPDES permit was renewed in 1987, although SPDES population impacts continued to be addressed in a 1998 judicially approved consent order (Order) between and among NYSDEC and the then-owners of IP2 and IP3, among others. Under this current permit and the Order, IP2 and IP3 use best reasonable efforts to operate so as to keep the volume of river water drawn into the plant at the minimum required for efficient operation, considering ambient River water temperature, station operating status and relevant permit conditions. Flow rates are dependent upon intake water temperature, and typically peak between early May and late October.

IP2 and IP3 owners submitted a timely SPDES permit renewal application in 1992 as discussed in [Section 9.2](#). Provisions of the Clean Water Act (CWA) and the New York Administrative Procedures Act provide that facilities, such as IP2 and IP3, may continue to operate under an existing SPDES permit after its technical expiration date, provided that the permittee makes a timely renewal application, as NYSDEC has confirmed IP2 and IP3 did. The NYSDEC issued a draft SPDES permit in 2003 that identified an alternative to the current once-through cooling water system under certain scenarios [[NYSDEC 2003c](#)]. The alternative contemplates replacement of the existing once-through cooling systems with closed-cycle cooling systems only

if the NRC operating licenses for IP2 and IP3 are extended by the NRC, appropriate safety, feasibility, and permitting/zoning demonstrations are made, and approvals are granted.

As noted above, the impacts of the installation of a close-cycle cooling system were evaluated in 1976. In addition, the site re-evaluated the closed-cycle cooling alternative in conjunction with its most recent permit application [Enercon]. The site will continue to evaluate this option in the pending adjudicatory proceeding before NYSDEC administrative law judges relating to that permitting effort. At this time, however, all available technical information confirms that retrofitting of facilities the size and configuration of IP2 and IP3 is untried and unproven. For this reason, substantial feasibility concerns exist, including with respect to the available acreage for the necessary equipment, the excavation required for the equipment, the ability to alter fundamental station equipment that is at the heart of the currently configured plants, and with respect to the pumping and piping capabilities required for such a retrofit. These factors are exacerbated by on-site easements for a major interstate natural gas pipeline. USEPA has concurred with respect to the lack of demonstrated feasibility or economical practicability of closed cycle cooling retrofits in some circumstances. [69 FR 41576: 41606].

As noted above, the first SPDES permit was granted to the site in 1982, with the HRSA conditions annexed to the permit. An SPDES permit renewal was granted in October 1987 by the NYSDEC (Attachment C). Ristroph screens and fish return systems were installed at IP3 and IP2 in 1990 and 1991, respectively. In 1992, the site owners submitted a timely SPDES permit renewal application to the NYSDEC. The HRSA, which was annexed to the 1982 issued SPDES Permit, expired with the permit and was replaced by four consecutive Consent Orders that were initially executed in 1992 between the owners of IP2 and IP3, other Hudson River power generators, NYSDEC, and other stakeholders [NYSDEC 1997]. The site's current SPDES permit has been extended under the New York State Administrative Procedure Act and the NYSDEC's implementing regulations since 1992.

In July 1992, NYSDEC requested that the Hudson River power generators prepare and submit an Environmental Impact Statement on the impacts of the SPDES permit renewal, to which the utilities responded with a DEIS in 1993, and a revised DEIS in 1999 [CHGEC]. The NYSDEC accepted the DEIS, but determined that additional public involvement and response was needed before the FEIS was issued [NYSDEC 2003c]. The NYSDEC issued its FEIS in 2003. NYSDEC also issued a draft SPDES permit in 2003 that among other conditions required the design and installation of closed-cycle cooling systems for IP2 and IP3, if the site seeks and is granted license renewal for these units [NYSDEC 2003c]. Entergy and other parties are contesting the terms of this permit before the agency's administrative law judges. However, the site considers mitigation measures currently implemented as a result of the HRSA and previous Consent Orders, supported by numerous Hudson River studies, and any measures established as the outcome of SPDES permit negotiations, to be adequate in minimizing impacts from current operations and operations during the license renewal period.

IP2 and IP3 and the other Hudson River power generating utilities have conducted Hudson River aquatic studies since the 1970s. The results of these studies were reported in the 1999 DEIS and 2003 FEIS. Based on the reports summarized in the DEIS and FEIS, studies completed in

the 1970s included sampling and evaluation of all trophic levels in the Hudson River estuary. Key species, populations, and communities were defined. During the 1980s, studies focused more closely on the fish species, particularly those adults and larvae that use the estuary as spawning and nursery habitat. As part of the Hudson River Utilities Monitoring Program, extensive environmental studies were conducted by the Hudson River utilities and the NYSDEC in the Hudson River estuary. Many of these studies have specifically addressed potential impacts to the macroinvertebrates, larval fish, adult fish, and anadromous fish populations. Entrainment mitigation measures have been implemented in accordance with the Fourth Amended Consent Order [NYSDEC 1997]. Among others, these mitigation measures have included installation of the dual and multi-speed cooling water intake pumps and minimization of cooling water withdrawal to only that required for efficient plant operation. Ristroph screens and fish return systems were installed on IP3 and IP2 in 1990 and 1991, respectively.

A discussion of the environmental impacts of IP2 and IP3's once-through cooling systems is provided in Sections 4.2, 4.3, and 4.4. Although the DEIS concludes that plant operations have not resulted in any negative trend in overall Hudson River aquatic species populations, NYSDEC's draft SPDES permit would require replacement of the existing once-through cooling systems with closed-cycle cooling systems if certain pre-conditions are met. The impacts of implementing a closed-cycle cooling system alternative are evaluated in this section.

As noted above, the impacts of the installation of a close-cycle cooling system were evaluated in 1976. In addition, the site re-evaluated the closed-cycle cooling alternative in 2003 [Enercon].

Although no method of waste heat dissipation could support IP2 and IP3 performance as well as the existing once-through cooling scheme, NYSDEC historically has asked the owners of IP2 and IP3 to evaluate other technology. Briefly, Entergy and its predecessors have evaluated, and NYSDEC has rejected, the following alternative technologies for heat dissipation.

- Evaporative ponds, spray ponds, or cooling canals—all require significantly more real estate to implement than exists at the site.
- Dry cooling towers, which rely totally on sensible heat transfer, lack the efficiency of wet or hybrid towers using evaporative cooling, and thus require a far greater surface area than is available at the site. Additionally, due to their lower efficiency, dry towers are not capable of supporting condenser temperatures necessary to be compatible with IP2 or IP3 turbine design and, therefore, are not a feasible technology.
- Natural draft cooling towers, while potentially feasible, would be 450 to 500 feet above ground-level with significant adverse aesthetic impacts in an important viewshed corridor, and raise plume-related and sound effects concerns. Indeed, in the original EPA permitting proceeding, New York State opposed natural draft cooling towers on aesthetic grounds.

- Mechanical draft wet cooling towers were rejected for a number of reasons, including, but not limited to, the dense water vapor plumes that compromise station operations and equipment, particularly over time, and which result in increased noise. [Enercon]

A hybrid, also referred to as a "wet/dry" or "plume abated" cooling tower, addresses many of the shortcomings of the tower types previously evaluated, particularly as applied to the Indian Point site. Basically, a hybrid tower is the combination of the wet tower, with its inherent cooling efficiency, and a dry heat exchanger section used to eliminate visible plumes in the majority of atmospheric conditions. After the plume leaves the lower "wet" section of the tower, it travels upward through a "dry" section where heated, relatively dry air is mixed with the plume in the proportions required to achieve a non-visible plume. Hybrid towers are slightly taller than comparable wet towers (typically about 70 feet elevation at the discharge versus 60 feet) due to the addition of the "dry" section, and may require a larger footprint. They are also appreciably more expensive, both in initial costs and in ongoing operating and maintenance costs. A potential exists for increased noise due to additional fans in the dry section, although attenuation to acceptable levels is possible, at increased capital and operating costs. [Enercon]

Because the site is heavily timbered, with rocky terrain and rapid elevation changes, a tower with a minimum footprint would be required to reduce overall excavation and clearing. A single round hybrid cooling tower for each unit would be required to best meet IP2 and IP3's performance needs and to minimize environmental impacts of the towers themselves. [Enercon]

The hybrid tower type would provide the minimum environmental impact of any currently available tower configuration. Feasibility remains uncertain, however, due to the lack of comparable conversions, the complexity of the engineering and to some extent to site-specific conditions. Thus, conversion to closed-loop cooling is extremely complex and expensive, in terms not only of initial direct capital costs, lost generating capacity during construction outages, and the de-rating of Station generating capacity, but also in parasitic energy losses and long-term operation and maintenance costs. Direct capital costs of the proposed conversion are based on a conceptual design. The site aesthetics, particularly from river-side view points, would be somewhat compromised by the addition of the towers, but much less so than by other alternatives. The effluent from the towers would increase salt deposition in the area of the site, but less so than other types of towers with higher effluent drift rates. Construction activities during the implementation phase would have a negative local impact from the associated increased traffic and noise, but would have restrictions to minimize the severity of their impact during construction.

The estimated direct capital cost (in 2003 dollars) is \$612,400,000, without any level of contingency. With customary cost of a performance bond and a 20% contingency, the engineering, procurement, and construction costs approach \$740,000,000. Since the changes to the condenser cooling systems involve the very heart of the plant, much of the conversion would need to be completed with both IP2 and IP3 in an extended forced outage. Although much of the blasting and excavation work and cooling tower erection could be done pre-outage, new circulating water pumping stations and changes to the Station's common discharge canal would force a major outage. Based on the conceptual construction schedule included in the 2003

evaluation, with as much work designated pre-outage or post-outage as possible, the forced outage duration would be expected to exceed 42 weeks. Again, this is an estimate without any level of contingency, and is likely greatly underestimated. [Enercon] This estimate is similar to the only existing estimate for a much smaller nuclear station that constructed cooling towers late in its original construction program, and therefore has been characterized by USEPA as a retrofit example; in that case, EPA concluded that the ten (10) month forced outage likely understated a more representative retrofit outage period [69 FR 41576: 41605].

New cooling towers would be large due to the required capacity. The outside diameter of each tower, including noise attenuators, would be approximately 560 feet. To provide construction access for tower erection and clearance for air intake, the excavation diameter for each tower would be approximately 700 feet. Height of the towers would be approximately 150 feet. The location for the IP2 tower is expected to be approximately 1,050 feet north of the IP2 reactor, just north of the independent spent fuel storage installation (ISFSI) location. The location of the IP3 tower is expected to be approximately 1,000 feet south of the IP3 reactor. The basin elevation of each tower is dictated by the required head for flow through the condenser, and preliminary analysis indicates an elevation of 31 feet MSL would be required. A detailed description of a round hybrid cooling tower conceptual design is presented in the 2003 cooling tower evaluation. [Enercon]

Based on the 2003 cooling tower evaluation, utilizing mechanical draft cooling towers instead of once-through cooling introduces significant additional electrical loads, termed "parasitic losses", that reduce Station output. Average annual parasitic losses have been estimated for hybrid towers that have "wet" and "dry" section fans, 44 in each section, and at 300 and 350 horsepower, respectively. Additionally, for the closed-loop configuration, circulating water pump horsepower is also increased. The net effect is an annual average parasitic loss of approximately 26 megawatts for each Unit. Lost generation, at maximum load conditions, would be approximately 47 megawatts for IP2 and approximately 27 megawatts for IP3, or a total of 74 megawatts. On an annual average basis, the effect is still significant at about 15 megawatts for IP2 and about 6 megawatts for IP3. [Enercon]

In evaluating the potential impacts of closed-cycle cooling for existing facilities in conjunction with the Phase II regulations for existing facilities, EPA determined "that the energy penalty associated with cooling towers, together with other factors, indicates that this technology is not the best technology available for existing facilities for minimizing adverse environmental impacts associated with [CWIS]" [69 FR 41576: 41605]. EPA also observed that this energy penalty not only may present electric-system impacts, but requires replacement power, the net effect of which would be more consumption of fossil fuel, which in turn increases air emissions [69 FR 41576: 41605].

Major negative impacts of closed-cycle cooling are systemic electric-system reliability and market pricing impacts, as well as the associated air quality impacts attributable to the use of replacement power. In conjunction with its permit renewal application, Entergy retained leading energy-system and economics experts to assess the electric-system impacts of closed-cycle conversion [NERA]. That report confirms that shutdown of IP2 and IP3 would result in

substantial reduction of electric-system reliability in New York State and reduction of New York State reserve margins. Reliability is a measure of the electric system's ability to serve needed demand without curtailments, among other options. Reserve margins are the measure chosen to ensure that installed reserves (that is, stations capable of operation) can meet expected demand with some margin of safety. Likewise, shutdown of IP2 and IP3 would increase New York State electricity consumer expenditures on electricity by more than \$3.0 billion in the estimated 3.5 year period evaluated in the report. Thus, the report concludes that IP2 and IP3 are essential to the New York State electric system. [NERA]

In addition, Entergy retained leading air quality experts to evaluate potential air emissions increases associated with prolonged outages or shutdown of IP2 and IP3 [TRC]. The TRC report demonstrates that replacement of IP2 and IP3 with existing generating facilities, as is to be expected for a construction outage or to replace parasitic losses, would result in substantial increases in regulated air pollutants, with corresponding potential effects and health hazards from those pollutants, particularly on the very young and old. As TRC noted, these increases would constitute a "major setback" in the area's air-quality goals. USEPA concurred at the federal level and identified air quality as one basis for its rejection of a nation-wide mandate for closed-cycle cooling at existing facilities [69 FR 41576: 41605]. In addition, while not addressed in the TRC report, carbon dioxide—a greenhouse gas and major contributor to climate change—is currently unregulated at the federal level. Replacement power would emit these pollutants, potentially contributing to climate change. New York State is currently considering regulations to control carbon dioxide emissions through an allowance/ cap-and-trade system in conjunction with the Regional Greenhouse Gas Initiative. Replacement of IP2 and IP3 non-emitting generation with emitting sources would increase the difficulty of making this system work. Other air-quality considerations are addressed in [Section 8.1.1.4](#).

8.1.1 Environmental Impacts of the Closed-Cycle Cooling Alternative

This section discusses the impacts that would occur if the site replaced its existing once-through cooling system with the closed-cycle cooling systems described in the reference [Enercon]. Although the use of linear hybrid mechanical-draft cooling towers would result in a substantial reduction of water withdrawn from the Hudson River, water consumption would increase due to evaporation loss. The assessment examines impacts related to both construction and operation of the linear hybrid mechanical-draft cooling system of the environmental impact categories as defined in the GEIS [NRC 1996].

8.1.1.1 Land Use

Due to the heavily timbered site, with rocky terrain and rapid elevation changes, a tower with a minimum footprint has been considered here to reduce overall excavation and clearing. A single round hybrid cooling tower for each unit was found to best meet the Station performance needs and minimize environmental impacts.

Construction and operation of the two hybrid towers would entail significant excavation of the currently timbered areas at the site. The base of each tower would be constructed on bedrock, at an elevation of about 30 feet above MSL. This would entail the removal of approximately two

million cubic yards of material, primarily rock, and would require a significant amount of blasting for excavation. Ultimately, approximately 40 acres of currently wooded land not previously disturbed would need to be cleared for the two cooling towers and new access roads. [Enercon]

The site is seriously constrained as a result of elevation changes and existing uses. Due to limited land availability, the proposed south cooling tower pad would be located in an area that is subject to a permanent right-of-way easement granted to the Algonquin Gas Transmission Company ("Algonquin") for constructing, maintaining and operating three natural gas pipelines (one 30-inch main and two 24-inch mains) that traverse the Indian Point site. These pipelines enter the eastern portion of the Indian Point site at a location on Broadway, between Bleakley Avenue and the Buchanan Substation, and cross the site in a westerly direction to the bank of the Hudson River. Algonquin's pipelines are used to supply natural gas to all of New England.

Under the terms of the easement, Algonquin is required to remove or relocate its pipelines upon the request of Entergy, provided that Entergy can furnish an appropriate substitute location on its land for the three pipelines. There has been no investigation into whether alternative pipeline locations at the IP2 or IP3 sites are feasible in light of pre-existing infrastructure, related plant structures, other site constraints, or are permissible from an environmental and regulatory perspective. Moreover, any relocation of the pipelines by Algonquin would require prior approval of the Federal Energy Regulatory Commission and other relevant permitting authorities, including NRC to the extent blasting is required in the construction of a new pipeline right-of-way. Difficulties associated with moving these pipelines are substantial, and include feasibility of relocation, safety and environmental impacts, permitting, cost, and coordination of third party activities. [Enercon]

Activities related to blasting, excavation, haul roads, cooling tower and piping construction, lay-down areas, and other construction related activities, resulting from cooling tower installation at IP2 and IP3 would result in MODERATE to LARGE land use impacts. Impacts to land-use from the existing site with once-through cooling during the license renewal period would be SMALL.

8.1.1.2 Ecology

8.1.1.2.1 Aquatic Ecology

Construction of the alternative closed-cycle cooling systems may create short-term, localized impacts on aquatic resources from site runoff. Clear cutting of the forest and subsequent excavation of the sites for the two cooling towers would alter the flow pattern of runoff from precipitation events. The volume of runoff potentially reaching the Hudson River would likely increase because of the lack of trees and vegetation to slow the transport of water. These can be mitigated, however, through the use of physical barriers (e.g., silt fences and hay bales) or sediment traps.

The closed-cycle cooling alternative would reduce entrainment and impingement losses when compared with the existing once-through cooling system. The highest water usage would be expected to occur during the summer when the system functions in full evaporative-mode cooling. Total cooling water flow from the Hudson River would amount to approximately 66,000

to 83,000 gpm (service and cooling tower makeup water) for IP2 and IP3, representing a 93-95% reduction in water use relative to the existing once-through system. However, of these flows, 6,000 gpm to 12,000 gpm would be consumed due to evaporation. [Enercon](#)]

Under the closed-cycle cooling alternative, most water discharged into the Hudson River would be unheated water. Thus, it would be likely that any thermal impacts would be confined to a small part of the discharge canal and the Hudson River.

Under the closed-cycle cooling alternative, evaporative cooling would result in the discharge of higher salinity water which may contain higher concentrations of biocides, minerals, trace metals, or other chemicals or constituents when compared with the discharge water characteristics associated with the existing once-through systems.

The impacts of the existing once-through cooling systems on aquatic resources would be SMALL. Operation of the closed-cycle cooling alternative would produce even fewer impacts upon the aquatic environment. Therefore, Entergy concludes that the aquatic ecological impacts from the construction and operation of the closed-cycle cooling alternative at IP2 and IP3 would be SMALL.

8.1.1.2.2 Terrestrial Ecology

The adverse impacts of clear-cutting 40 acres would be significant. Approximately 1000 feet of river bank would be deforested to allow excavation for the four large-diameter water pipes (two 120-inch diameter supply pipes and two 144-inch diameter pipes to each condenser) required for each tower. The excavation for the cooling towers would cut into the side of the hills to the immediate east of the Station. These tree-covered hills lie between the Station and the Villages of Buchanan and Verplanck and rise to an elevation of 130 to 145 feet. The base of the tower would be constructed on bedrock, at an elevation of about 30 feet above mean sea level. This would entail the removal of approximately two million cubic yards of material, primarily bedrock. Disposal of two million cubic yards of material would be problematic. To transport the material to an acceptable disposal site by truck, assuming six cubic yards per load, would entail over 300,000 round trips. The excavation would be expected to take 30 months to complete.

Clear-cutting of the forest and subsequent excavation of the sites for the two cooling towers would alter the flow pattern of runoff from precipitation events. The volume of runoff potentially reaching the Hudson River would likely increase because of the lack of trees and vegetation to hold and slow the transport of water. Standard techniques of control of runoff would need to be implemented, such as silt fences and grading, to control the flow of runoff during construction. Because the construction sites would be so close to the river, extra protective measures to prevent runoff carrying excess silt and contaminants, such as petroleum products, would be necessary. Temporary sediment retention basins might have to be constructed to prevent the increased silt load of the runoff from reaching the river. Truck and equipment washing areas would need to be equipped with impermeable basins to intercept petroleum contaminants. Dust from the construction site would need to be controlled by water sprays or, if necessary, other chemical dust suppression agents.

The obvious impacts include destruction of habitat for mammals that normally inhabit eastern hardwood forests, including raccoon, squirrels, opossum, and whitetail deer. A large portion of the area surrounding the site has been developed and the amount of undisturbed eastern deciduous hardwood forest in the vicinity is decreasing.

Impacts on terrestrial ecology would include localized habitat loss and fragmentation, reduced productivity, and reductions in biological diversity. During the construction period, less mobile wildlife could be adversely affected and some wildlife disturbance (such as to bald eagles) could occur from noise, and the presence of construction personnel, and due to cooling tower operation.

The potential physical impacts from a cooling tower plume arise primarily from the moisture content, which can cause icing and fogging during winter conditions; the salt content of the entrained moisture, which can damage vegetation; and the heat content, which could potentially degrade the site's heating, ventilating and air conditioning (HVAC) systems. Although a hybrid tower produces an invisible plume, the plume still exists. The potential adverse impacts from plume and salt drift are presented in the reference [Enercon].

The impacts of the existing once-through cooling systems on terrestrial resources would be SMALL. Operation of the closed-cycle cooling alternative would produce greater impacts upon the terrestrial environment than continued operation of the existing once-through cooling system. Therefore, Entergy concludes that the terrestrial ecological impacts from the construction and operation of the closed-cycle cooling alternative at IP2 and IP3 would be MODERATE.

8.1.1.3 Water Use and Quality

8.1.1.3.1 Surface Water

As discussed above, approximately 66,000 to 83,000 gpm (service and makeup water) would be withdrawn from the Hudson River for a hybrid cooling tower system, of which 6,000 gpm to 12,000 gpm would be consumed due to evaporation. Expressed in terms of gallons per day (gpd), 12,000 gpm amounts to 17,280,000 gpd or 9,540 acre-feet—a substantial river volume lost, as distinct from simply temporarily used (as once-through cooling allows). As noted in the reference, the combined once-through cooling water intake flow from the Hudson River for IP2 and IP3 ranges from approximately 919,000 gpm to 1,371,000 gpm, which is a small fraction of temporary use of the Hudson River flow [Enercon]. However, the tidal flows of the Hudson River were estimated to be 180,000 cfs [NRC 1979].

Potable water demand for workers may increase, but commonly used portable toilet facilities would lessen the overall water demand on-site of the worker population. If concrete was to be mixed on-site, water needs would be a short-lived demand on water resources. This water would likely come from the Village of Buchanan Water System, which, as discussed in [Section 2.10.1](#), has available capacities.

Construction of the closed-cycle cooling systems would require an NYSDEC permit for stormwater discharges from construction activities, in the form of a Construction General Permit.

In addition, a Stormwater Pollution Prevention Plan would be required. The use of silt fencing and other erosion-control practices during construction could minimize impacts on surface-water quality.

The major change in surface water quality impacts would result from increased concentrations of dissolved solids and salts in the plant effluent due to evaporation in the hybrid cooling tower system. Additionally, increased water treatment would be necessary due to the higher concentrations of dissolved solids, chemicals, and biological agents in the system resulting from constant recirculation of the condenser cooling water. The cooling towers would act as air washers as well as distilleries, constantly evaporating large quantities of water and leaving behind the non-volatile residues. The actual concentrations of these agents are wholly based on the cycles of concentration which would be used in the circulating water system.

With a closed-loop cooling system, water treatment requirements would be dramatically increased. The cooling tower fill would be subject to fouling, as would be the dry heat exchanger sections. Both the quantities and frequency of biocide injections must be increased significantly to maintain the tower fill in proper condition. Because of evaporation, the concentrations of dissolved and suspended solids in the circulating water would increase. These minerals would affect the operation and efficiency of the system because of scale deposits.

Makeup water would have to be treated to remove silt, suspended solids, biological material, and windblown debris. Makeup water may need lime softening, resulting in a sludge that requires disposal. Because of the warm environment in the closed-cycle system, biofouling organisms would be expected, and biocides, such as sodium hypochlorite, would be needed. Other chemicals, such as acids, dispersants, scale inhibitors, foam suppressants, and dechlorinators may be needed [NRC 1979; Enercon]. The use of biocides or any other chemicals would require SPDES permit modification and additional monitoring. Storage of additional chemicals at the facility could require revision to the Stations' Chemical Spill Prevention Plans.

The impacts of the existing once-through cooling systems on surface water would be SMALL. Operation of the closed-cycle cooling alternative would produce greater impacts upon the surface water quality due to evaporative loss and concentration of dissolved solids than continued operation of the existing once-through cooling system. However, Entergy concludes that the surface water impacts from the construction and operation of the closed-cycle cooling alternatives at IP2 and IP3 would be SMALL, which is consistent with the 1979 FES that concluded impacts on the Hudson River would be SMALL.

8.1.1.3.2 Groundwater

The site does not use groundwater for any water supply. Other than potential dewatering requirements during construction excavation, no impact on the groundwater from the existing once-through cooling systems and closed-cycle cooling alternative would be expected. Therefore, the overall impacts to groundwater from the existing once-through cooling systems or closed-cycle cooling alternative would be SMALL.

8.1.1.4 Air Quality

As noted above, the potential physical impacts from a tower plume arise primarily from the moisture content, which can cause icing and fogging during winter conditions; the salt content of the entrained moisture, which can damage vegetation; and the heat content, which could potentially degrade the site's HVAC systems [Enercon].

As discussed above, replacement of IP2 and IP3 power generation with replacement power, as would be expected for a construction outage or to replace parasitic losses, would result in substantial increases in regulated air pollutants, with corresponding potential effects and health hazards from those pollutants, particularly on the very young and old. In addition, carbon dioxide—a greenhouse gas and major contributor to climate change—is currently unregulated at the federal level or in New York State, with the result that replacement power would emit these pollutants, contributing to climate change. Other air-quality considerations are addressed below.

The predicted salt deposition from a single tower indicates up to 73 kg/km²/month would be emitted from the tower. The ambient natural local deposition rates would be measured at an annual rate of 16 µg/cm²/month, which is 160 kg/km²/month. The predicted combined salt deposition from operation of both cooling towers would be approximately 112 kg/km²/month in the region between the towers. [Enercon]

Construction of new cooling towers at the site would result in fugitive emissions during the construction process. Exhaust emissions would also come from vehicles and motorized equipment used during the construction process.

Westchester County is located in a non-attainment area for particulate emissions. An operating cooling tower could have significant air emissions associated with PM_{2.5} and PM₁₀. The hybrid closed-cycle cooling tower could require a Prevention of Significant Deterioration (PSD) construction permit and a Title V operating permit from the state, since the potential to emit PM₁₀ could exceed 250 tons per year. [NRC 2006].

The impacts of the existing once-through cooling systems on air quality are SMALL. On the basis of the above considerations, Entergy concludes that the direct and indirect impacts of the alternative closed-cycle cooling systems on air quality, particularly those related to increases in PM₁₀, which would result from salt drift, would be MODERATE.

8.1.1.5 Waste

Construction of cooling towers would entail disposal of two million cubic yards of material. To transport the material to an acceptable disposal site by truck, assuming six cubic yards per load, would entail over 300,000 round trips. The excavation would be expected to take 30 months to complete. This scenario would result in impacts due to noise and traffic volume to the Village of Buchanan and the surrounding communities. The alternative disposal scenario would be to transport the material by barge to a suitable disposal site.

Small amounts of biocides or other materials used in the cooling systems would be produced during operations. Some of this material would be released to the environment in the blowdown water released to the discharge canal and the Hudson River in accordance with IP2 and IP3's SPDES permit. Any other such waste would be managed and disposed of in accordance with applicable State regulations at approved offsite facilities.

Overall, waste impacts for the existing once-through cooling systems is SMALL. The waste impacts for the proposed closed-cycle cooling systems are considered MODERATE to LARGE.

8.1.1.6 Human Health

Human health impacts for an operating nuclear power plant are identified in 10 CFR Part 51 Subpart A, Appendix B, Table B-1. Overall, human health impacts from the existing once-through cooling systems and any closed-cycle cooling alternatives are considered SMALL (see [Section 8.2.3.1.6](#)) [NRC 1996].

8.1.1.7 Socioeconomics

Construction and operation of the closed-cycle cooling systems could result in adverse impacts on housing, public services, and traffic in the local area. Construction of the cooling towers would require an average workforce of 300 and could take an estimated 62 months. During the outage phase of the effort, the cooling tower construction workforce could peak at 600. It is anticipated that the majority of the workforce would be temporary. Only a small percentage may look for permanent residence in the area. For comparison purposes, a workforce of approximately 950 additional workers is on-site during a routine refueling outage.

As of June 2006 the site has approximately 1,255 full time workers (Entergy employees and baseline contractors) during normal plant operations. The majority of these employees live within a five-county area surrounding the plant. As discussed in [Section 2.9](#), steady growth in the housing market has occurred in the five-county area near the site since 1990. In addition, vacancy rates have reduced, while the total number of new housing units has increased. This increase has kept pace with the low-to-moderate growth in the area population. The increased construction workforce would add a temporary burden on area housing, which would be added to the temporary housing needs during outages.

A study of the logistics for construction of cooling towers has not been performed. However, adverse transportation impacts would be expected to be significant. Offsite disposal of the estimated two million cubic yards of excavation rock and debris would be expected to have a significant impact on local traffic during clearing of any cooling tower option at the site. As noted above, the excavation phase of construction would be expected to take at least 30 months to complete. In addition, to transport the material to an acceptable disposal site by truck, assuming six cubic yards per load, this disposal would entail over 300,000 round trips over the 30 months. Assuming seven days per week construction debris removal to offsite disposal, this would result in an estimated 370 truckloads per day, assuming six yard dump trucks would be used. This would amount to more than 740 entry/exits per day, or 74 per hour (10-hour day) to and from the site, in addition to existing site worker traffic, and in addition to any temporary worker traffic for

outages and/or tower construction. If construction were limited to weekdays, the number of loads would increase significantly to more than 530 round trips per day, or potentially more than 105 trucks per hour. Traffic in the area is heavy and the additional traffic from construction and site workers would cause increased traffic delays, particularly along the major routes, i.e., US Highways 9 and 9A.

Even if transport of construction debris and new equipment could be completed via barges on the Hudson River, the impact of a closed-cycle cooling system at the site would be significant. Assuming 1000-ton barges were used for excavation debris removal, at least five barges per day would have to be loaded and leave the site per day, with additional barge staging required for returning barges. Depending upon the ultimate disposal of waste, truck traffic offloading the barges could be transferred to another location, which could also be significant to that locale. Construction of loading facilities at the site to accommodate this type of activity could have adverse impacts on both aquatic and terrestrial ecological communities.

Socioeconomic impacts resulting from once-through cooling are SMALL. Socioeconomic impacts related to housing during the construction of cooling towers at the site would be SMALL. Socioeconomic impacts related to transportation during the construction of cooling towers at the site could be MODERATE to LARGE.

8.1.1.8 Aesthetics

When IP2 and IP3 were constructed, the goal was to maintain a low physical profile for the station relative to the Hudson River Valley through visual containment of structures within the confines of the surrounding forest-covered high ground [Enercon]. Construction of the cooling towers would require permanent modification of the terrain along the shore of the Hudson River. The cooling towers would be located approximately 200 to 300 feet from the bank of the Hudson River at an elevation of about 30 feet MSL. The cooling towers would be the largest structures on the site.

Each cooling tower would be approximately 165 feet tall, about the height of a 14-story building, sitting at an elevation of 30 feet MSL, for a total height of 195 feet. Each cooling tower would be approximately 525 feet in diameter. By comparison, the reactor containment structures are approximately 160 feet in diameter and 250 feet tall. The cooling towers would have a significant adverse aesthetic impact [Enercon, Attachment 2, page 2, Rendering]. An area approximately 700 feet in diameter would be excavated for each cooling tower. In addition, approximately 1,000 feet of river bank would be deforested to allow excavation for the four large diameter water pipes (two 120-inch diameter supply pipes and two 144-inch diameter pipes to each condenser) required for each cooling tower.

Views from the Hudson River, scenic overlooks on area highways, and Palisades Interstate State Park on the western shore would be impacted. The site is an industrial facility already visible from these vantage points. However, the addition of the two towers would make the entire facility more visible. The clear-cutting of the forest required for construction of the towers and to allow maximum airflow to the towers would remove a visual buffer from vantage points both up and down river. As many trees as possible would be left between the construction sites and the river.

In addition, upon completion of construction, trees would be planted between the cooling towers and the river bank to re-establish a visual buffer and help attenuate noise from the operation of the towers. The New York State Historic Preservation and Parks Office opposed cooling towers at IP2 and IP3 on aesthetic grounds and there is no indication that NYSHP will not oppose any future effort.

The excavation for the cooling towers would cut into the side of the hills to the immediate east of the site. These tree-covered hills lie between the site and the Villages of Buchanan and Verplanck and rise to an elevation of 130 to 145 feet, which would shield most of the towers from view. However, many of the residents may still be able to see the tops of the towers above the tree tops. Because of the nature of hybrid cooling towers, no plume would be visible during the daylight hours. However, at night the towers would be run in wet mode, resulting in a plume of water vapor that may obscure the night sky for some residents.

Aesthetic impacts from the existing once-through cooling systems are SMALL. Impacts to aesthetics from the closed-cycle cooling alternative could be MODERATE to LARGE.

8.1.1.9 Noise

An ambient noise level monitoring program was conducted in the vicinity of Indian Point 2 and Indian Point 3 between September 2001 and January 2002. Ambient noise levels were determined for seven representative sound receptor locations. The Village of Buchanan has a sound ordinance (Chapter 211-23 of the Village Zoning Code) that limits allowable sound levels from a facility by octave band levels and is applicable at the property line of the sound generating facility. The combined octave band center frequencies equate to an overall level of 48 dB(A). [Enercon, Section 4.2]

Hybrid cooling towers that could be installed at IP2 and IP3 would have to be equipped with sound attenuators. The resulting noise level was estimated to be 30 dB(A) at 2,750 feet, approximately 940 feet east of the intersection of Bleakley Avenue and Broadway. The sound level at the intersection of Bleakely Avenue and Broadway was calculated to be approximately 34 dB(A). This is less than the late night ambient noise levels at this location [Enercon, Table 4.2]. The sound level at the residence nearest the proposed location for the Unit 3 cooling tower was calculated to be approximately 31 dB(A). The Village of Buchanan Sound Standard of 48 dB(A) would be met at approximately 350 feet from each tower, well within IP2 and IP3 property boundaries. The cooling towers would be constructed in the side of a hill. The topography between the cooling towers and sensitive receptors would further attenuate the sound levels. Enercon's cooling tower evaluation, shown in Table 8-1, presents the calculated noise level at

sensitive receptors including existing background noise and the operational noise of both cooling towers. [Enercon]

**Table 8-1
Cumulative Sound Levels and Sensitive Receptors (dB(A))**

Receptor	Cooling Tower Noise Level ^a	Existing Daytime L₉₀ ^b	Total Daytime Noise Level	Existing Late Night L₉₀ ^b	Total Late Night Noise Level
Saint Patrick's Church	29	41	41	42	42
16 th St and Broadway	30	38	39	40	40
Pheasant's Run	30	36	37	36	37
Buchanan Town Hall	28	44	44	38	38
Bleakley Ave. and Broadway	33	45	45	38	39
Elementary School	30	36	37	36	37
Nearest Residence	31	38	39	40	41
Centerville Park	30	36	37	36	37
China Pier	29	51	51	No Data	No Data

- a. Both towers operating continuously
- b. L₉₀: the level of noise (dB(A)) exceeded for ninety percent of the time.

Source: Enercon, Table 4.4

Table 8-1 reveals that both cooling towers operating continuously would cause an increase in noise levels at sensitive receptors of 1 dB(A) or less. This increase would probably not be noticed by the residents of the Village of Buchanan. [Enercon, Section 4.2]

Noise impacts from the existing once-through cooling systems are SMALL. Assuming noise attenuation systems are added, impacts due to noise from the closed-cycle cooling alternative would be SMALL.

8.1.1.10 Historic and Archaeological Resources

Before construction of cooling towers site, studies would be needed to identify, evaluate, and address mitigation of the potential impacts of construction on cultural resources. The studies would be needed for areas of potential disturbance at the proposed plant site and along associated corridors where new construction would occur (e.g., roads, transmission corridors, rail lines, or other rights-of-way). Historic and archaeological resource impacts from the existing once-through cooling systems are SMALL. Impacts from the closed-cycle alternative can generally be effectively managed and as such are considered SMALL.

8.1.1.11 Conclusion

Entergy has evaluated and compared the retrofitting of IP2 and IP3 with closed-cooling cycle cooling towers to current once-through cooling operations and has determined that current operations would result in smaller environmental impacts. [Table 8-2](#) provides a comparison of impacts between the proposed action to continue the use of once-through cooling (described in [Section 4](#)), and those impacts anticipated if closed-cycle cooling systems were to be constructed for IP2 and IP3 (described above).

Table 8-2
Summary of Environmental Impacts from Once-Through Cooling Compared to
Closed-Cycle Cooling at Indian Point

Impact Category	Once-Through Cooling Impact	Closed-Cycle Cooling Impact
Land Use	SMALL	MODERATE to LARGE
Ecology <ul style="list-style-type: none"> • Aquatic Ecology • Terrestrial Ecology 	SMALL SMALL	SMALL MODERATE
Water Use and Quality <ul style="list-style-type: none"> • Surface Water • Groundwater 	SMALL SMALL	SMALL SMALL
Air Quality	SMALL	MODERATE
Waste	SMALL	MODERATE to LARGE
Human Health	SMALL	SMALL
Socioeconomics <ul style="list-style-type: none"> • Population Driven Land-Use • Transportation 	SMALL SMALL	SMALL MODERATE to LARGE
Aesthetics	SMALL	MODERATE to LARGE
Noise	SMALL	SMALL
Historic and Archaeological Resources	SMALL	SMALL

8.2 Comparison of Environmental Impacts for Reasonable Generation Alternatives

As stated in the GEIS, the "NRC has determined that a reasonable set of alternatives should be limited to analysis of single, discrete electric generation sources and only electric generation sources that are technically feasible and commercially viable" [NRC 1996, Section 8.1]. A discussion is provided below of the supply side alternative energy technologies that Entergy could utilize if the IP2 and IP3 Operating Licenses were not renewed. These alternatives are within the range of alternatives capable of meeting the goal of approximately 2,040 gross MWe as base-load generation analyzed in this report (i.e., approximate replacement power for the site).

Conventional coal-fired and natural gas-fired combined cycle and advanced light-water reactor are currently available conventional base-load technologies considered to replace site generation upon its termination of operation. These sources are considered viable alternatives based upon current Entergy planning strategies.

The environmental impacts discussed in this chapter are for the construction and operation of these generation facilities. Impacts are evaluated for a greenfield case (building on a new, pristine condition site) and a brownfield case (constructing new generation on the existing site, with exception of coal-fired and advanced light water reactor units).

As discussed below, the continued operation of IP2 and IP3 for the period of extended operation would result in less environmental impact than that of the replacement power option that could be obtained from other reasonable generating sources. In addition, the current transmission system constraints in New York State would preclude transmission of power from Northern and Western New York State to elsewhere within the state [National].

8.2.1 Coal-Fired Generation

NRC evaluated coal-fired generation alternatives in each of the plant-specific Supplements to the GEIS. For the V. C. Summer pressurized water reactor, NRC analyzed two 408 MWe coal-fired generation capacity plants [NRC 2004, Section 8.2.1]. Entergy has reviewed the NRC analysis and believes it to be sound. In defining the site coal-fired alternative, Entergy has used site-specific fuel and input data and has scaled from the NRC analysis to evaluate a 2,040 MWe coal-fired plant that would be close to the MWe power produced by the IP2 and IP3 plants (2,158 MWe). Although the hypothetical coal-fired plant understates the impacts of replacing 2,158 MWe by approximately 5 percent, Entergy believes these differences are insignificant and ensures against overstating the environmental impacts.

The coal-fired alternative that Entergy has defined would be located at an alternative site. Tables 8-3 through 8-5 present the basic coal-fired alternative emission control characteristics, emission estimates and waste generation volumes. Entergy based its emission control technology and percent control assumptions on alternatives that the EPA has identified as being available for minimizing emissions [USEPA 1998, Section 1.1]. For the purposes of analysis, it is assumed that coal and lime (calcium hydroxide) could be delivered either by rail or barge to a newly-constructed receiving dock on the site.

8.2.1.1 Closed-Cycle Cooling System

The following sections discuss the overall impacts at an alternate greenfield site of the coal-fired generating system using a closed-cycle cooling system with cooling towers. The magnitude of impacts for the alternative site would depend on the location of the particular site selected. The site currently uses once-through cooling systems. For the purposes of comparison with an alternative site, it is assumed that the replacement coal-fired plant sited at an alternative site also would use a closed-cycle cooling system.

The environmental impacts of building a coal-fired generation facility with a closed-cycle cooling system at an alternative site are summarized in [Table 8-6](#).

8.2.1.1.1 Land Use

Based on Table 8.1 of the GEIS, it is estimated that it would take approximately 1.7 acres of land per MWe to construct a coal-fired plant. Therefore, for the 2,040 MWe plant evaluated in this analysis, it would take approximately 3,468 acres of land (5.4 mi²). This could result in a considerable loss of natural habitat or agricultural land for the plant site alone, excluding that required for mining and other fuel-cycle impacts.

Additional land might also be needed for transmission lines and rail lines, depending on the location of the site relative to the nearest inter-tie connection and rail spur. Depending on the transmission line routing and nearest rail line, these alternatives could result in MODERATE to LARGE land use impacts.

Land-use changes would occur off-site in an undetermined coal-mining area to supply coal for the plant. In the GEIS, analysts estimated that approximately 22 acres of land per MWe would be affected for mining the coal and disposing of the waste to support a coal-fired plant during its operational life [NRC 1996]. Therefore, for the 2,040 MWe plant utilized in this analysis, approximately 44,880 acres (70 mi²) of land could be affected. Partially offsetting this offsite land use would be the elimination of the need for uranium mining and processing to supply fuel for IP2 and IP3. In the GEIS, the staff estimated that approximately one acre per MWe would be affected by mining and processing the uranium during the operating life of a nuclear power plant [NRC 1996]. Therefore, for the 2,040 MWe plant considered in this analysis, uranium mining would affect approximately 2,040 acres of land.

Overall, land use impacts of a coal-fired generating unit with a closed-cycle cooling system located at an alternate site are considered to be MODERATE to LARGE.

8.2.1.1.2 Ecology

Constructing a coal-fired plant at an alternate site could alter ecological resources because of the need to convert roughly 3,468 acres of land to use for a plant, coal storage, and ash and scrubber sludge disposal. However, some or all of this land might already have been previously disturbed.

Coal-fired generation at an alternative site would introduce construction impacts and new incremental operational impacts. Even assuming siting at a previously disturbed area, the impacts would alter the ecology. Impacts could include wildlife habitat loss, reduced productivity, habitat fragmentation, and a local reduction in biological diversity.

Use of cooling system makeup water from a nearby surface water body could have adverse impacts on aquatic resources. If needed, construction and maintenance of an electric power transmission line and a rail spur would have ecological impacts. There would be some impact on terrestrial ecology from water drift from the cooling towers. Overall, the ecological impacts of constructing a coal-fired plant with a closed-cycle cooling system at an alternate site are considered to be MODERATE to LARGE.

8.2.1.1.3 Water Use and Quality

Surface Water: Cooling water at an alternate site would likely be withdrawn from a surface water body and would be regulated by a permit. Depending on the water source, the impacts of water use for cooling system makeup water and the effects on water quality caused by cooling tower blowdown could have noticeable impacts. Therefore, the impacts of a new coal-fired plant utilizing a closed-cycle cooling system at an alternate site are considered SMALL to MODERATE.

Groundwater: Impacts of groundwater withdrawal would be SMALL if only used for potable water. If groundwater is used to supply makeup water, then the impacts could be MODERATE to LARGE. Therefore, groundwater impacts from a coal-fired plant on the aquifer would be site-specific and dependent on aquifer recharge and other withdrawals. The overall impacts would be SMALL to LARGE.

8.2.1.1.4 Air Quality

Air quality impacts of coal-fired generation are considerably different from those of nuclear power. A coal-fired plant emits oxides of sulfur (SO_x), nitrogen oxides (NO_x), particulate matter, and carbon monoxide, all of which are regulated pollutants. As already stated, Entergy has assumed a plant design that would minimize air emissions through a combination of boiler technology and post-combustion pollutant removal. Entergy estimates the coal-fired alternative emissions to be as follows (from [Table 8-4](#)).

Oxides of sulfur = 6,284 tons per year

Oxides of nitrogen = 1,476 tons per year

Carbon monoxide = 1,476 tons per year

Particulates:

Total suspended particulates = 210 tons per year

PM₁₀ (particulates having a diameter of less than 10 microns) = 48 tons per year

The acid rain requirements of the Clean Air Act amendments capped the nation's SO_x emissions from power plants. Under the Clean Air Act amendments, each company with fossil-fuel-fired units was allocated SO_x allowances. To be in compliance with the Act, the companies must hold enough allowances to cover their annual SO_x emissions. Entergy would have to purchase allowances to cover its SO_x emissions. It is also likely that Entergy would be required to purchase NO_x emission allowances under New York State's program to comply with the National Ambient Air Quality Standards.

Since emissions exceed the 250 tons/year (SO_x, NO_x, and CO) major source definition under the PSD new-source construction and under the Title V operating permit regulations of the CAA, the coal-fired alternative would require a PSD construction permit and Title V operating permit.

NRC did not quantify coal-fired emissions in the GEIS, but implied that air impacts would be substantial. NRC noted that adverse human health effects from coal combustion have led to important federal legislation in recent years and that public health risks, such as cancer and emphysema, have been associated with coal combustion. NRC also mentioned global warming and acid rain as potential impacts. Entergy concludes that federal legislation and large-scale concerns, such as global warming and acid rain, are indications of concerns about destabilizing important attributes of air resources. However, SO_x emission allowances, NO_x emission offsets, low NO_x burners with overfire air and selective catalytic reduction, fabric filters or electrostatic precipitators, and scrubbers are provided as mitigation measures. As such, Entergy concludes that the coal-fired alternative would have MODERATE impacts on air quality. The emission of "greenhouse" gases would be significantly greater than for the existing IP2 and IP3 emissions or for a greenfield site nuclear plant.

8.2.1.1.5 Waste

Entergy concurs with the GEIS assessment that the coal-fired alternative would generate substantial solid waste. The coal-fired plant would annually consume approximately 5,905,938 tons of coal having an ash content of 7.11%. After combustion, 99.9% of this ash (approximately 419,492 tons per year) would be collected and disposed of at either an on-site or off-site landfill. In addition, approximately 342,489 tons of scrubber waste would be disposed of each year. Entergy estimates that ash and scrubber waste disposal over a 40-year plant life would require approximately 402 acres. The amount of land needed for final disposal of ash may be less, dependant upon the availability of local recycling options for the ash. [Table 8-5](#) shows how Entergy calculated ash and scrubber waste volumes. While only half this waste volume and land use would be attributable to the 20-year license renewal period alternative, the total numbers are pertinent as a cumulative impact.

Entergy believes that, with proper siting coupled with current waste management and monitoring practices, waste disposal would not destabilize any resources. Some wooded terrestrial habitat would be dedicated to the waste site. However, after closure of the waste site and revegetation, the land would be available for other uses. For these reasons, Entergy believes that waste disposal for the coal-fired alternative would have MODERATE impacts.

8.2.1.1.6 Human Health

Coal-fired power generation introduces worker risk from coal and limestone mining, worker and public risk from coal and lime/limestone transportation, worker and public risk from disposal of coal combustion wastes, and public risk from inhalation of stack emissions. Emission impacts can be widespread and health risk is difficult to quantify. The coal alternative also introduces the risk of coal pile fires and attendant inhalation risk.

The NRC stated in the GEIS that there could be human health impacts (cancer and emphysema) from inhalation of toxins and particulates from a coal-fired plant, but the GEIS does not identify the significance of these impacts [NRC 1996]. In addition, the discharges of uranium and thorium from coal-fired plants can potentially produce radiological doses in excess of those arising from nuclear power plant operations [Gabbard].

Regulatory agencies, including the EPA and State agencies, set air emission standards and requirements based on human health impacts. These agencies also impose site-specific emission limits as needed to protect human health. EPA has recently concluded that certain segments of the U.S. population (e.g., the developing fetus and subsistence fish-eating populations) are believed to be at potential risk of adverse health effects due to mercury exposures from sources such as coal-fired power plants. However, in the absence of more quantitative data, human health impacts from radiological doses and inhaling toxins and particulates generated by a coal-fired plant at an alternate site are considered to be SMALL.

8.2.1.1.7 Socioeconomics

The peak workforce is estimated to range from 1.2 to 2.5 additional workers per MWe during the construction period, based on estimates given in Table 8.1 of the GEIS. For the 2,040 MWe plant utilized in this analysis, it would take approximately ten years to construct the plant (assuming the coal fired units were built in parallel) with a total workforce ranging from approximately 2,448 to 5,100 workers.

Communities around the new site would have to absorb the impacts of a large, temporary work force (up to approximately 5,100 workers at the peak of construction) and a permanent work force of approximately 0.25 workers per MWe based on Table 8.2 of the GEIS or approximately a total of 510 total workers for the 2,040 MWe plant utilized in this analysis.

In the GEIS, the staff stated that socioeconomic impacts at a rural site would be larger than at an urban site, because more of the peak construction workforce would need to move to the area to work. Alternate sites would need to be analyzed on a case-by-case basis. Therefore, socioeconomic impacts at an isolated rural site could be LARGE.

Transportation related impacts associated with commuting construction workers at an alternate site would be site dependent, but could be MODERATE to LARGE.

Transportation impacts related to commuting of plant operating personnel would also be site dependent, but can be characterized as SMALL to MODERATE.

At most alternate sites, coal and lime would be delivered by rail, although barge delivery is feasible for a location on navigable waters. Transportation impacts would depend upon the site location. Socioeconomic impacts associated with rail transportation would be MODERATE to LARGE. Transportation from barge delivery of coal and lime/limestone would have SMALL socioeconomic impacts.

8.2.1.1.8 Aesthetics

Alternative site locations could reduce the aesthetic impact of coal-fired generation if siting were in an area that was already industrialized. In such a case, however, the introduction of tall stacks and cooling towers would probably still have a MODERATE incremental impact. Locating at other, largely undeveloped sites could show a LARGE impact.

There would also be an aesthetic impact if construction of a new transmission line and/or rail spur were needed. Noise impacts associated with rail delivery of coal and lime/limestone would be most significant for residents living in the vicinity of the facility and along the rail route. Although noise from passing trains significantly raises noise levels near the rail corridor, the noises would be of short duration. In a more suburban location, the impacts are considered MODERATE. This is due to the frequency of train transport, the fact that many people are likely to be within hearing distance of the rail route, and the impacts of noise on residents in the vicinity of the facility and the rail line. At a more rural location, the impacts could be SMALL. Noise and light from the plant would be detectable off-site. Overall, the aesthetic impacts associated with locating at an alternative site can be categorized as SMALL to LARGE, depending on the characteristics of the alternative site.

8.2.1.1.9 Historic and Archaeological Resources

Before construction at an alternate site, studies would be needed to identify, evaluate, and address mitigation of the potential impacts of new plant construction on cultural resources. The studies would be needed for areas of potential disturbance at the proposed plant site and along associated corridors where new construction would occur (e.g., roads, transmission corridors, rail lines, or other rights-of-way). Historic and archaeological resource impacts can generally be effectively managed and as such are considered SMALL.

**Table 8-3
Coal-Fired Alternative Emission Control Characteristics**

Characteristic	Basis
Unit size = 408 MW ISO rating net ^a	Chosen as a reasonable plant for approximating IP2 and IP3.
Unit size = 430 MW ISO rating gross ^a	Chosen as a reasonable plant for approximating IP2 and IP3.
Number of units = 5	Close to IP2 and IP3's MWe generating capacity.
Boiler type = tangentially fired, dry-bottom	Minimizes nitrogen oxide emissions [USEPA 1998, Table 1.1-3]
Fuel type = bituminous, pulverized coal	Typical for coal used in New York [USDOE 2001, Table 4]
Fuel heating value = 13,117 Btu/lb	2000 value for coal used in New York [USDOE 2001, Table 4]
Fuel ash content by weight = 7.11%	2000 value for coal used in New York [USDOE 2001, Table 22]
Fuel sulfur content by weight = 1.12%	2000 value for coal used in New York [USDOE 2001, Table 22]
Uncontrolled NO _x emission = 10 lb/ton Uncontrolled CO emission = 0.5 lb/ton	Typical for pulverized coal, tangentially fired, dry-bottom, NSPS [USEPA 1998, Table 1.1-3]
Heat rate = 10,200 Btu/kWh	Typical for coal-fired, single-cycle steam turbines [USDOE 2002a, page 110]
Capacity factor = 0.85	Typical for newer large coal-fired units
NO _x control = low NO _x burners, overfire air and selective catalytic reduction (95% reduction)	Best available and widely demonstrated for minimizing NO _x emissions [USEPA 1998, Table 1.1-2]
Particulate control = fabric filters (baghouse - 99.9% removal efficiency)	Best available for minimizing particulate emissions [USEPA 1998, pp. 1.1-6 and 1.1-7]
SO _x control = Wet scrubber – lime (95% removal efficiency)	Best available for minimizing SO _x emissions [USEPA 1998, Table 1.1-1]
<p style="margin-left: 40px;">Btu = British thermal unit ISO rating = International Standards Organization rating at standard atmospheric conditions of 59°F, 60% relative humidity, and 14.696 pounds of atmospheric pressure per square inch kWh = kilowatt-hour NSPS = New Source Performance Standard lb = pound MW = megawatt NO_x = nitrogen oxides SO_x = oxides of sulfur</p>	

a. The difference between "net" and "gross" is electricity consumed by auxiliary equipment and environmental control devices [USDOE 2002a, page 109].

**Table 8-4
Air Emissions from Coal-Fired Alternative**

Parameter	Calculation	Result
Annual coal consumption	$5 \text{ units} \times \frac{408 \text{ MW}}{\text{unit}} \times \frac{10,200 \text{ Btu}}{\text{kW} \times \text{hr}} \times \frac{1,000 \text{ kW}}{\text{MW}} \times \frac{\text{lb}}{13,117 \text{ Btu}} \times \frac{24 \text{ hr}}{\text{day}} \times \frac{365 \text{ day}}{\text{yr}} \times \frac{\text{ton}}{2,000 \text{ lb}} \times 0.85$	5,905,938 tons of coal per year
SO _x ^{a,b}	$\frac{5,908,938 \text{ tons}}{\text{yr}} \times \frac{1.12\% \times 38 \text{ lb}}{\text{ton}} \times \frac{\text{ton}}{2,000 \text{ lb}} \times \frac{100 - 95}{100}$	6,284 tons SO _x per year
NO _x ^{b,c}	$\frac{5,905,938 \text{ tons}}{\text{yr}} \times \frac{10 \text{ lb}}{\text{ton}} \times \frac{\text{ton}}{2,000 \text{ lb}} \times \frac{100 - 95}{100}$	1,476 tons NO _x per year
CO ^b	$\frac{5,905,938 \text{ tons}}{\text{yr}} \times \frac{0.5 \text{ lb}}{\text{ton}} \times \frac{\text{ton}}{2,000 \text{ lb}}$	1,476 tons CO per year
TSP ^d	$\frac{5,905,938 \text{ tons}}{\text{yr}} \times \frac{7.11\% \times 10 \text{ lb}}{\text{ton}} \times \frac{\text{ton}}{2,000 \text{ lb}} \times \frac{100 - 99.9}{100}$	210 tons TSP per year
PM ₁₀ ^d	$\frac{5,905,938 \text{ tons}}{\text{yr}} \times \frac{7.11\% \times 2.3 \text{ lb}}{\text{ton}} \times \frac{\text{ton}}{2,000 \text{ lb}} \times \frac{100 - 99.9}{100}$	48 tons PM ₁₀ per year
CO = carbon monoxide NO _x = nitrogen oxides PM ₁₀ = particulates having diameter less than 10 microns SO _x = oxides of sulfur TSP = total suspended particulates		

- a. USEPA 1998, Table 1.1-1
- b. USEPA 1998, Table 1.1-3
- c. USEPA 1998, Table 1.1-2
- d. USEPA 1998, Table 1.1-4

**Table 8-5
Solid Waste from Coal-Fired Alternative**

Parameter	Calculation	Result
Annual SO _x generated ^a	$\frac{5,905,938 \text{ tons Coal}}{\text{yr}} \times \frac{1.12 \text{ tons}}{100 \text{ tons Coal}} \times \frac{64.1 \text{ tons SO}_2}{32.1 \text{ tons S}}$	132,087 tons of SO _x per year
Annual SO _x removed	$\frac{132,087 \text{ tons SO}_2}{\text{yr}} \times \frac{95}{100}$	125,483 tons of SO _x per year
Annual ash generated	$\frac{5,905,938 \text{ tons Coal}}{\text{yr}} \times \frac{7.11 \text{ tons ash}}{100 \text{ tons Coal}} \times \frac{99.9}{100}$	419,492 tons of ash per year
Annual lime consumption ^b	$\frac{132,087 \text{ tons SO}_2}{\text{yr}} \times \frac{56.1 \text{ tons CaO}}{64.1 \text{ tons SO}_2}$	115,602 tons of CaO per year
Calcium sulfate ^c	$\frac{125,483 \text{ tons SO}_2}{\text{yr}} \times \frac{172 \text{ tons CaSO}_4 \cdot 2\text{H}_2\text{O}}{64.1 \text{ tons SO}_2}$	336,709 tons of CaSO ₄ ·2H ₂ O per year
Annual scrubber waste ^d	$\frac{115,602 \text{ tons CaO}}{\text{yr}} \times \frac{100 - 95}{100} + 336,709 \text{ tons CaSO}_4 \cdot 2\text{H}_2\text{O}$	342,489 tons of scrubber waste per year
Total volume of scrubber waste ^e	$\frac{342,489 \text{ tons}}{\text{yr}} \times 40 \text{ yr} \times \frac{2,000 \text{ lb}}{\text{ton}} \times \frac{\text{ft}^3}{144.8 \text{ lb}}$	189,220,442 ft ³ of scrubber waste
Total volume of ash ^f	$\frac{419,492 \text{ tons}}{\text{yr}} \times 40 \text{ yr} \times \frac{2,000 \text{ lb}}{\text{ton}} \times \frac{\text{ft}^3}{100 \text{ lb}}$	335,593,600 ft ³ of ash
Total volume of solid waste	189,220,442 ft ³ + 335,593,600 ft ³	524,814,042 ft ³ of solid waste
Waste pile area (acres)	$\frac{524,814,042 \text{ ft}^3}{30 \text{ ft}} \times \frac{\text{acre}}{43,560 \text{ ft}^2}$	402 acres of solid waste 30 ft high
Waste pile area (ft x ft square)	$\sqrt{524,814,042 \text{ ft}^3 / 30 \text{ ft}}$	4,183 ft by ft square of solid waste, 30 ft high
<p>Based on annual coal consumption of 5,905,938 tons per year (see Table 8-4).</p> <p>S = sulfur SO₂ = sulfur dioxide SO_x = oxides of sulfur CaO = calcium oxide (lime) CaSO₄·2H₂O = calcium sulfate dihydrate</p>		

- a. Calculations assume 100% combustion of coal.
- b. Lime consumption is based on total SO₂ generated.
- c. Calcium sulfate generation is based on total SO₂ removed.
- d. Total scrubber waste includes scrubbing media carryover.
- e. Density of CaSO₄·2H₂O is 144.8 lb/ft³.
- f. Density of coal bottom ash is 100 lb/ft³ [FHA].

**Table 8-6
Summary of Environmental Impacts from Coal-Fired Generation
Using Closed-Cycle Cooling at an Alternate Greenfield Site**

Impact Category	Impact	Comments
Land Use	MODERATE to LARGE	Approximately 3,468 acre site with additional land for mining and disposal.
Ecology	MODERATE to LARGE	Impact will depend on ecology of site and need for additional transmission lines.
Water Use and Quality: - Surface Water - Groundwater	 SMALL to MODERATE SMALL to LARGE	 Impact will depend on volume and other characteristics of receiving water. Impact will depend on site characteristics and availability of groundwater.
Air Quality	MODERATE	SOx – 6,284 tons/yr – allowances required NOx – 1,476 tons/yr – allowances required Particulate – 210 tons/yr (filterable) – 48 tons/yr (unfilterable) Carbon monoxide – 1,476 tons/yr Trace amounts of mercury, arsenic, chromium, beryllium, and selenium
Waste	MODERATE	Total waste volume would be estimated around 524,814,042 ft ³ of ash and scrubber sludge.
Human Health	SMALL	Impacts considered minor.

Table 8-6 (Continued)
Summary of Environmental Impacts from Coal-Fired Generation
Using Closed-Cycle Cooling at an Alternate Greenfield Site

Impact Category	Impact	Comments
Socioeconomics	SMALL to LARGE	Communities would need to absorb impacts of a large, temporary total workforce (up to approximately 5,100 workers at the peak of construction) and a total permanent work force of approximately 510 workers. Impacts at a rural site would be larger. Transportation-related impacts associated with commuting construction workers would be site dependent.
Aesthetics	SMALL to LARGE	Could reduce aesthetic impact if siting is in an industrial area. Impact would be large if siting is largely in an undeveloped area.
Historic and Archaeological Resources	SMALL	Would necessitate cultural resource studies.

8.2.1.2 Once-Through Cooling System

The environmental impacts of constructing a coal-fired generation system at an alternate greenfield site using once-through cooling are similar to the impacts for a coal-fired plant using a closed-cycle cooling system. However, there are some environmental differences between the closed-cycle and once-through cooling systems. Table 8-7 summarizes the incremental differences.

**Table 8-7
Summary of Environmental Impacts from Coal-Fired Generation
Using Once-Through Cooling at an Alternate Greenfield Site**

Impact Category	Comments
Land Use	Compared with a closed-cycle cooling system, less land would be required because cooling towers and associated infrastructure not needed.
Ecology	Slightly reduced environmental impacts because there are no cooling towers; however, increased water withdrawal may impact aquatic resources.
Water Use and Quality: - Surface Water - Groundwater	Impact would depend on surface water body characteristics, volume of water withdrawn, and characteristics of the discharge. Impact would depend on site characteristics and availability of groundwater. It is unlikely that groundwater would be used for once-through cooling, but could be used for sanitary water.
Air Quality	No change.
Waste	No change.
Human Health	No change.
Socioeconomics	No change.
Aesthetics	Reduced aesthetic impact because cooling towers would not be used.
Historic and Archaeological Resources	Less land impacted.

8.2.2 Natural Gas-Fired Generation

Entergy has chosen to evaluate gas-fired generation, using combined-cycle turbines, because it has determined that the technology is mature, economical, and feasible. [Table 8-8](#) presents the basic gas-fired alternative characteristics and [Table 8-9](#) presents emission estimates.

NRC evaluated environmental impacts from gas-fired generation alternatives in the GEIS, focusing on combined-cycle plants. For the V. C. Summer pressurized water reactor, NRC analyzed two 408 MWe of gas-fired generation capacity [[NRC 2004](#), Section 8.2.1]. Entergy has reviewed the NRC analysis and believes it to be sound. In defining the gas-fired alternative, Entergy has used site-specific fuel and input data, and has scaled from the NRC analysis to five 408 MWe combined cycle gas-fired units for a total of 2,040 MWe that would be very close to the MWe power produced by IP2 and IP3 (2,158 MWe). Although the hypothetical gas-fired plant understates the impacts of replacing 2,158 MWe by approximately 5 percent, Entergy believes these differences are insignificant and ensures against overstating the environmental impacts.

8.2.2.1 Closed-Cycle Cooling System

The overall impacts of the natural-gas-generating system with a closed-cycle cooling system located at the site or an alternate site were evaluated. As noted in the evaluation of land use impacts below, the available land on-site is inadequate for construction of replacement power. Therefore, offsite brownfield and greenfield sites are evaluated, summarized in [Table 8-10](#), and discussed in the following sections. The magnitude of impacts at an alternate site will depend on the location of the particular site selected.

8.2.2.1.1 Land Use

The feasibility of peaking capacity was discussed in Entergy's Preliminary Scoping Statement filed with the New York Public Service Commission (NYPSC) on March 18, 2002, to construct a 330 MWe simple cycle plant. The plant was originally to be comprised of eight 45-MW aero-derivative gas turbines, later amended to two 165-MW GE 7FA industrial frame gas turbines. The plant was to utilize a five-acre parcel on the IP site outside of the "protected area" that houses the reactors. The plant would have tied into the Buchanan electric substation, less than 2,000 feet to the northeast [[Levitan](#)]. However, Entergy's evaluation of adding peaking capacity to the base-load capacity of IP2 and IP3 did not include replacement of the existing 2,158 MWe. As discussed below, replacement capacity would require the purchase of additional land off-site, and environmental impacts would be equivalent to a greenfield site.

Gas-fired generation at the site would require converting the existing industrial site to a gas plant. Almost all the converted land would be used for the power block. Additional land would be disturbed during pipeline construction. Some additional land would also be required for backup oil storage tanks. However, the existing 239 acres currently owned by Entergy at the site is not adequate for replacement gas-fired base-load generation capacity. The GEIS estimated that 110 acres are needed for a 1,000 MWe natural gas-fired facility [[NRC 1996](#), Section 8.3.10]. Scaling up for the 2,040 MWe facility would indicate a land requirement of approximately 224 acres, which is not currently available on-site. Therefore, additional land would have to be

purchased. If land adjacent to the site were available and used, the impact would probably be equivalent to the environmental impacts of a greenfield site in another area. Another offsite brownfield site could be selected, which may minimize environmental impacts. Construction and operation of replacement power at a brownfield site would require construction of a new cooling system, switchyard, offices, gas-transmission pipelines, and transmission line right(s)-of-way, but would minimize many environmental impacts. Gas-fired generation land use impacts at a brownfield site are considered to be SMALL to MODERATE; gas-fired generation at a greenfield site (or adjacent to the existing site) would be MODERATE to LARGE.

While the existing Algonquin main pipeline line may be adequate for a 330 MWe simple cycle plant that would operate in peaking mode during the summer season, a report prepared by Levitan and Associates, Inc. concluded that substantial and expensive site pipeline upgrades would probably be required to supply natural gas to a combined cycle plant throughout the winter heating season, November–March, and for the additional base-load capacity (i.e., greater than 330 MW) throughout the year. [[Levitan](#)]

**Table 8-8
Gas-Fired Alternative Emission Control Characteristics**

Characteristic	Basis
Unit size = 408 MW ISO rating net ^a Two 135 MW combustion turbines and a 138 MW heat recovery boiler	Manufacturer's standard size gas-fired combined cycle plant
Unit size = 424 MW ISO rating gross ^a Two 140.5 MW Combustion Turbines 143 MW Heat Recovery Boiler	Calculated based on 4% on-site power
Number of units = 5	Close to IP2 and IP3 MWe generating capacity.
Fuel type = natural gas	Assumed
Fuel heating value = 1,019 Btu/ft ³	2000 value for gas used in New York [USDOE 2001, Table 14]
Fuel sulfur content = 0.0034 lb/MMBtu	Used when sulfur content is not available [USEPA 2000, Table 3.1-2a]
NO _x control = selective catalytic reduction (SCR) with steam/water injection	Best available for minimizing NO _x emissions [USEPA 2000, Table 3.1 Database]
Fuel NO _x content = 0.0109 lb/MMBtu	Typical for large SCR-controlled gas-fired units with water injection [USEPA 2000 Table 3.1 Database]
Fuel CO content = 0.0023 lb/MMBtu	Typical for large SCR-controlled gas-fired units [USEPA 2000, Table 3.1]
Heat rate = 8,200 Btu/kWh	Typical for combined cycle gas-fired turbines [USDOE 2001, page 110]
Capacity factor = 0.85	Typical for large gas-fired base-load units (Entergy experience)

Btu = British thermal unit

ft³ = cubic foot

ISO rating = International Standards Organization rating at standard atmospheric conditions of 59°F, 60% relative humidity, and 14.696 pounds of atmospheric pressure per square inch

kWh = kilowatt-hour

MM = million

MW = megawatt

NO_x = nitrogen oxides

< = less than

SCR = selective catalytic reduction

- a. The difference between "net" and "gross" is electricity consumed by auxiliary equipment and environmental control devices [USDOE 2001, page 109].

**Table 8-9
Air Emissions from Gas-Fired Alternative**

Parameter	Calculation	Result
Annual gas consumption	$5 \text{ units} \times \frac{408 \text{ MW}}{\text{unit}} \times \frac{8,200 \text{ Btu}}{\text{kW} \times \text{hr}} \times \frac{1,000 \text{ kW}}{\text{MW}} \times 0.85 \times \frac{\text{ft}^3}{1,019 \text{ Btu}} \times \frac{24 \text{ hr}}{\text{day}} \times \frac{365 \text{ days}}{\text{yr}}$	122,234,237,500 ft ³ per year
Annual Btu input	$\frac{122,234,237,500 \text{ ft}^3}{\text{yr}} \times \frac{1,019 \text{ Btu}}{\text{ft}^3} \times \frac{\text{MMBtu}}{10^6 \text{ Btu}}$	124,556,688 MMBtu per year
SO _x ^a	$\frac{0.0034 \text{ lb}}{\text{MMBtu}} \times \frac{\text{ton}}{2,000 \text{ lb}} \times \frac{124,556,688 \text{ MMBtu}}{\text{yr}}$	212 tons SO _x per year
NO _x ^b	$\frac{0.0109 \text{ lb}}{\text{MMBtu}} \times \frac{\text{ton}}{2,000 \text{ lb}} \times \frac{124,556,688 \text{ MMBtu}}{\text{yr}}$	679 tons NO _x per year
CO ^b	$\frac{0.0023 \text{ lb}}{\text{MMBtu}} \times \frac{\text{ton}}{2,000 \text{ lb}} \times \frac{124,556,688 \text{ MMBtu}}{\text{yr}}$	143 tons CO per year
TSP ^a	$\frac{0.0019 \text{ lb}}{\text{MMBtu}} \times \frac{\text{ton}}{2,000 \text{ lb}} \times \frac{124,556,688 \text{ MMBtu}}{\text{yr}}$	118 tons filterable TSP per year
PM ₁₀ ^a	$\frac{118 \text{ tons TSP}}{\text{yr}}$	118 tons filterable PM ₁₀ per year
CO = carbon monoxide NO _x = oxides of nitrogen PM ₁₀ = particulates having diameter less than 10 microns SO _x = oxides of sulfur TSP = total suspended particulates		

- a. USEPA 2000, Table 3.1-2a
 b. USEPA 2000, Table 3.1-1

8.2.2.1.2 Ecology

Siting gas-fired generation at an offsite brownfield site would have MODERATE ecological impacts because the facility would be constructed partly on previously disturbed areas.

If additional land were available for purchase adjacent to the existing IP2 and IP3 site, ecological impacts may not be significantly different than for a greenfield site, even though there are existing Algonquin gas pipelines that traverse the site. According to a Preliminary Scoping Statement prepared by Entergy, the Algonquin 26-inch and 30-inch gas pipelines traverse the IP site, and the gas interconnection would extend less than 1,000 feet for a proposed gas-fired peaking plant. However, the Algonquin lines may not have sufficient capacity to supply the fuel

requirements cited in this analysis. Upgrades to this system would likely be required to obtain a sufficient and reliable fuel supply [Levitan]. Additional pipeline construction or upgrades might also be required at an alternative site. Habitat would be disturbed by such pipeline construction.

For brownfield and greenfield sites, the GEIS noted that land-dependent ecological impacts from construction would be SMALL unless site-specific factors indicate a particular sensitivity and that operational impact would be smaller than for other fossil fuel technologies of equal capacity. Therefore, in this case, the appropriate characterization of gas-fired generation ecological impacts is SMALL to MODERATE, depending on the area selected for replacement power construction and operations.

Construction at a greenfield site could alter the ecology of the site and could impact threatened and endangered species. These ecological impacts could be SMALL to MODERATE.

8.2.2.1.3 Water Use and Quality

Surface Water: If the plant could use the existing IP2 and IP3 intake and discharge structures as part of a closed-cycle cooling system (assuming the new plant were immediately adjacent to the existing site), the water quality impacts would continue to be SMALL. If a feasible brownfield site were available with existing surface water intake, the impact may also be SMALL.

Water quality impacts from sedimentation during construction is another land related impact that the GEIS categorized as SMALL. The GEIS also noted that operational water quality impacts would be similar to, or less than, those from other centralized generating technologies. The NRC has concluded that water quality impacts from coal-fired generation would be SMALL, and gas-fired alternative water usage would be less than that for coal-fired generation. Therefore, surface water impacts would remain SMALL.

For alternative greenfield sites, the impact on surface water would depend on the volume and other characteristics of the receiving body of water. The impacts would be SMALL.

Groundwater: For alternative brownfield or greenfield sites, the impact to the groundwater would depend on the site characteristics, including the amount of groundwater available. The impacts would range between SMALL to LARGE.

8.2.2.1.4 Air Quality

Natural gas is a relatively clean-burning fossil fuel; the gas-fired alternative would release similar types of emissions, but in lesser quantities, than the coal-fired alternative. Control technology for gas-fired turbines focuses on NO_x emissions. Entergy estimates the five plant gas-fired alternative emissions to be as follows (from Table 8-9):

Sulfur oxides = 212 tons per year

Oxides of nitrogen = 679 tons per year

Carbon monoxide = 143 tons per year

Filterable Particulates = 118 tons per year (all particulates are PM₁₀)

Since emissions exceed the 250 tons/year (NO_x) major source definition under the PSD new-source construction and under the Title V operating permit regulations of the CAA, the coal-fired alternative would require a PSD construction permit and Title V operating permit.

Regional air quality and Clean Air Act requirements also are applicable to the gas-fired generation alternative. NO_x effects on ozone levels, SO_x allowances, and NO_x emission offsets could all be issues of concern for gas-fired combustion. While gas-fired turbine emissions are less than coal-fired boiler emissions, and regulatory requirements are less stringent, the emissions are still substantial. Entergy concludes that emissions from the gas-fired alternative located near the site would noticeably alter local air quality, but would not destabilize regional resources. Westchester County is located in a non-attainment area for particulates, and a severe non-attainment area for ozone. Air quality impacts would therefore be MODERATE, but substantially smaller than those of coal-fired generation.

Siting the gas-fired plant elsewhere would not significantly change air quality impacts because the site could be in a greenfield area that is not a serious non-attainment area for ozone. In addition, the location could result in installing more or less stringent pollution control equipment to meet the regulations. Therefore, the impacts would be MODERATE. The emission of "greenhouse" gases would be significantly greater than for the existing IP2 and IP3 emissions, or for a greenfield site nuclear plant.

8.2.2.1.5 Waste

There are only small amounts of solid waste products (i.e., ash) from burning natural gas fuel. The GEIS concluded that waste generation from gas-fired technology would be minimal. Gas firing results in very few combustion by-products because of the clean nature of the fuel. Waste generation would generally be limited to typical office wastes, but other industrial waste would be generated from maintenance activities. This impact would be SMALL.

Siting the facility at a greenfield site would not alter the waste generation; therefore, the impacts would continue to be SMALL.

8.2.2.1.6 Human Health

The GEIS analysis mentions potential gas-fired alternative health risks (cancer and emphysema). The risk may be attributable to NO_x emissions that contribute to ozone formation, which in turn contributes to health risks. As discussed in [Section 8.2.1.1.6](#) for the coal-fired alternative, legislative and regulatory control of the nation's emissions and air quality are protective of human health, and the human health impacts from gas-fired generation would be SMALL.

Siting of the facility at a greenfield site would not alter the possible human health effects. Therefore, the impacts would be SMALL.

8.2.2.1.7 Socioeconomics

It is assumed that gas-fired construction would take place while IP2 and IP3 continue operation, with the replacement gas-fired plant construction completed at the time the existing plants halt operation. Construction of the gas-fired alternative would take much less time than constructing other plants. During the time of construction, the surrounding communities would experience demands on housing and public services that could have SMALL to MODERATE impacts. After construction, the communities would be impacted by the loss of jobs, construction workers would leave, and the IP2 and IP3 nuclear plant workforce would decline through a decommissioning period to a minimal maintenance size.

The GEIS concluded that socioeconomic impacts from constructing a gas-fired plant would not be very noticeable and that the small operational workforce would have the lowest socioeconomic impacts (local purchases and taxes) of nonrenewable technologies. Compared to the coal-fired alternative, the smaller size of the construction workforce, the shorter construction time-frame, and the smaller size of the operations workforce would reduce some of the socioeconomic impacts. For these reasons, the socioeconomic impacts, including but not limited to transportation, of gas-fired-generation would be SMALL to MODERATE.

Construction at another site would relocate some socioeconomic impacts, but would not eliminate them. The community around the site would still experience the impact of the loss of IP2 and IP3 operational jobs and the tax base. The communities around the new site would have to absorb the impacts of a temporary workforce and a small permanent workforce. Therefore, the impacts would be MODERATE to LARGE, based on net job and tax-base losses from IP2 and IP3 closure. This impact is about the same in the site area as in the no-action alternative (i.e., license renewal for IP2 and IP3 is not granted).

8.2.2.1.8 Aesthetics

The combustion turbines and heat-recovery boilers would be relatively low structures and would be screened from most offsite vantage points by intervening woodlands. The steam turbine building would be taller and, together with the exhaust stacks, could be visible off-site.

The GEIS analysis noted that land-related impacts, such as aesthetic impacts, would be small unless site-specific factors indicate a particular sensitivity. As in the case of the coal-fired alternative, aesthetic impacts from the gas-fired alternative would be noticeable. However, because the gas-fired structures are shorter than the coal-fired structures and more amenable to screening by vegetation, it was determined that the aesthetic resources would not be destabilized by the gas-fired alternative. For these reasons, aesthetic impacts from a gas-fired plant would be SMALL to MODERATE.

Alternative locations could reduce the aesthetic impact of gas-fired generation if siting was in an area that was already industrialized. In such a case, however, the introduction of the steam

generator building, stacks, and cooling tower plumes would probably still have a SMALL to MODERATE incremental impact.

Natural gas generation would introduce mechanical sources of noise that would be audible off-site. Sources contributing to total noise produced by plant operation are classified as continuous or intermittent. Continuous sources include the mechanical equipment associated with normal plant operations. Intermittent sources included the use of outside loudspeakers and the commuting of plant employees. However, it is expected that the plant would comply with all applicable noise ordinances and standards. Therefore, the noise impacts of a natural gas-fired plant at the site are considered to be SMALL.

At a greenfield site (or a site adjacent to the existing IP2 and IP3 site), these noise impacts would be SMALL to LARGE depending on the site.

8.2.2.1.9 Historic and Archaeological Resources

The GEIS analysis noted, as for the coal-fired alternative, that cultural resource impacts of the gas-fired alternative would be SMALL unless important site-specific resources were affected. Gas-fired alternative construction at any site would affect a smaller area than within the footprint of the coal-fired alternative. Construction at any offsite location could necessitate instituting cultural resource preservation measures, but impacts can generally be managed and maintained as SMALL. Cultural resource surveys would be required for the pipeline construction and other areas of ground disturbance associated with this alternative.

Table 8-10
Summary of Environmental Impacts from Gas-Fired Generation
Using Closed-Cycle Cooling

Impact Category	Brownfield Site		Site Adjacent to IP2 and IP3 or Greenfield Site	
	Impact	Comments	Impact	Comments
Land Use	SMALL to MODERATE	Approximately 224 acres required for power block. Possible additional acreage disturbed for pipeline construction.	MODERATE to LARGE	Approximately 224 acres required for site. Possible additional land disturbed for pipeline construction.
Ecology	SMALL to MODERATE	Constructed on land within IP2 and IP3 region. Possible habitat loss due to pipeline construction.	SMALL to MODERATE	Impact depends on location and ecology of site; potential habitat loss and fragmentation; reduced productivity and biological diversity.
Water Use and Quality - Surface Water	SMALL	Assumes use of existing intake and discharge structures and cooling system, otherwise same as greenfield site.	SMALL	Impact depends on volume and characteristics of receiving water body.
- Groundwater	SMALL to LARGE	Groundwater impacts would depend on uses and available supply.	SMALL to LARGE	Groundwater impacts would depend on uses and available supply.
Air Quality	MODERATE	Primarily nitrogen oxides. Impacts could be noticeable, but not destabilizing.	MODERATE	Primarily nitrogen oxides. Impacts could be noticeable, but not destabilizing.
Waste	SMALL	Small amount of ash produced.	SMALL	Small amount of ash produced.
Human Health	SMALL	Impacts considered minor.	SMALL	Impacts considered minor.

Table 8-10 (Continued)
Summary of Environmental Impacts from Gas-Fired Generation
Using Closed-Cycle Cooling

Impact Category	Brownfield Site		Site Adjacent to IP2 and IP3 or Greenfield Site	
	Impact	Comments	Impact	Comments
Socioeconomics	SMALL to MODERATE	Construction impacts would be relocated. Community near IP2 and IP3 site would still experience workforce reduction from current IP2 and IP3 workforce.	MODERATE to LARGE	Construction impacts would be relocated. Community near IP2 and IP3 site would experience workforce reduction.
Aesthetics	SMALL to MODERATE	Visual impact of stacks and equipment would be noticeable, but not as significant as coal option. If siting is in an industrial area, could reduce impact.	SMALL to LARGE	Offsite location could increase aesthetic impact.
Historic and Archaeological Resources	SMALL	Areas offsite would be affected.	SMALL	Offsite location would necessitate cultural resource studies.

8.2.2.2 Once-Through Cooling System

The environmental impacts of once-through cooling for an alternative brownfield or greenfield site to replace the 2,158 MWe base-load capacity of IP2 and IP3 are provided as a comparative analysis of impacts equivalent to the existing site. The environmental impacts of constructing a natural-gas-fired generation system at an alternate site using a once-through cooling system are similar to the impacts for a natural-gas-fired plant using closed-cycle cooling with cooling towers. However, there are some environmental differences between the closed-cycle and once-through cooling systems. [Table 8-11](#) summarizes the incremental differences.

**Table 8-11
Summary of Environmental Impacts from Gas-Fired Generation Using Once-Through Cooling**

Impact Category	Brownfield Site	Site Adjacent to IP2 and IP3 or Greenfield Site
	Comments	Comments
Land Use	Approximately 45 to 60 acres less land required because cooling towers and associated infrastructure are not needed.	Approximately 45 to 60 acres less land required because cooling towers and associated infrastructure are not needed.
Ecology	Less terrestrial habitat lost and cooling tower effects eliminated; Increased water withdrawal may result, and aquatic impact may be similar to or greater than current IP2 and IP3 site operations.	Impact would depend on ecology at the site. No impact to terrestrial ecology from cooling tower drift. Increased water withdrawal may result, and aquatic impact may be similar to or greater than current IP2 and IP3 site operations Thermal discharges could result in greater impacts to aquatic ecology.
Water Use and Quality - Surface Water - Groundwater	No discharge of cooling tower blowdown containing dissolved solids. Increased water withdrawal and more thermal load on receiving body of water. Groundwater impacts would depend on uses and available supply. It is unlikely that groundwater would be used for once-through cooling, but could be used for sanitary water.	No discharge of cooling tower blowdown containing dissolved solids. Increased water withdrawal and more thermal load on receiving body of water. Groundwater impacts would depend on uses and available supply. It is unlikely that groundwater would be used for once-through cooling, but could be used for sanitary water.
Air Quality	Minor reduction of impact due to particulate emissions from cooling towers.	Minor reduction of impact due to particulate emissions from cooling towers.
Aesthetics	Reduced aesthetic impact because cooling towers would not be used.	Reduced aesthetic impact because cooling towers would not be used.
Historic and Archaeological Resources	Less land affected.	Less land affected.
Waste	No change.	No change.
Human Health	No change.	No change.
Socioeconomics	No change.	No change.

8.2.3 Nuclear Power Generation

Since 1997, the NRC has certified four new standard designs for nuclear power plants under 10 CFR Part 52, Subpart B. These designs are the U.S. Advanced Boiling Water Reactor (10 CFR Part 52, Appendix A), the System 80+ Design (10 CFR Part 52, Appendix B), and the AP600 Design (10 CFR Part 52, Appendix C), and the AP1000 Design (10 CFR Part 52, Appendix D). All of these plants are light-water reactors. Currently, the NRC is reviewing the Design Certification application for the Economic Simplified Boiling Water Reactor (ESBWR). Finally, Title VI of the Energy Policy Act of 2005 includes several provisions to encourage the use of new nuclear power [USEPA 2005]. The nuclear power industry is also preparing combined construction and operating license applications for several new nuclear units. In addition, recent volatility of natural gas and electricity has made new nuclear power plant construction more attractive from a cost standpoint. Consequently, construction of a new nuclear power plant at an alternate site using closed-cycle and once-through cooling systems is considered in the following sections. It was assumed that the new reactor would have an initial operating term of 40 years.

8.2.3.1 Closed-Cycle Cooling System

The environmental impacts of constructing a nuclear power plant at an alternate site using closed-cycle cooling are summarized in [Table 8-12](#).

8.2.3.1.1 Land Use

Land use requirements at an alternate site would require land for the nuclear power plant plus the possible need for land for a new transmission line. In addition, it may be necessary to construct a rail spur to an alternate site to bring in equipment during construction.

Land use is discussed in the GEIS regarding replacement power utilizing new advanced Light Water Reactors (LWR). The environmental impacts of constructing an advanced LWR nuclear plant are expected to be equivalent to the impacts of building any large energy facility. Impacts could be moderated somewhat if the plant were built at a current nuclear plant site rather than at a greenfield site because the prevailing land use would be compatible at the former site. Thus, building a plant on a greenfield site would produce more severe impacts.

Advanced LWRs require perhaps 500 to 1000 acres excluding transmission lines, which could add hundreds to thousands of acres depending upon the distance of the plant from connecting transmission lines or load centers. Destruction of wildlife habitat would occur, and threatened and endangered species would require special consideration to avoid adverse impacts. Erosion, sedimentation, fugitive dust, aesthetic intrusions, and disturbance to cultural artifacts would tend to be proportional to the amount of land disturbed.

Construction of new nuclear generation facilities is not feasible on the existing 239 acres of the plant site. Thus, an appropriate brownfield or greenfield site would have to be identified that met appropriate siting requirements, including, but not limited to, water and public services availability, seismic parameters, population, and socioeconomic considerations. In addition, the selected brownfield or greenfield site would need to be located in southern New York to provide

power to the New York City metropolitan area due to the current limitations of the New York power grid.

Depending on transmission line routing, siting a new nuclear plant at an alternate site would result in MODERATE to LARGE land use impacts, and probably would be LARGE for a greenfield site.

8.2.3.1.2 Ecology

At an alternate site, there would be construction impacts and new incremental operational impacts. Even assuming siting at a previously disturbed area, the impacts would alter the ecology. Impacts could include wildlife habitat loss, reduced productivity, habitat fragmentation, and a local reduction in biological diversity. Use of cooling water from a nearby surface water body could have adverse aquatic resource impacts. Construction and maintenance of the transmission line would have ecological impacts. Overall, the ecological impacts at an alternate site would be MODERATE to LARGE.

8.2.3.1.3 Water Use and Quality

Surface Water: For a replacement reactor located at an alternate site, new intake structures would need to be constructed to provide water needs for the facility. Impacts would depend on the volume of water withdrawn for makeup, relative to the amount available from the intake source, and the characteristics of the surface water. Plant discharges would be regulated by the State of New York or other state jurisdiction. Some erosion and sedimentation may occur during construction. The impacts would be SMALL to MODERATE.

Groundwater: Use of groundwater for a nuclear power plant sited at an alternate site is a possibility. Groundwater withdrawal would require a permit from the local permitting authority. The impacts of such a withdrawal rate on an aquifer would be site-specific and dependent on aquifer recharge and other withdrawal rates from the aquifer. Therefore, the overall impacts would be SMALL to LARGE.

8.2.3.1.4 Air Quality

Construction of a new nuclear plant at an alternate site would result in particulate emissions during the construction process. Exhaust emissions would also come from vehicles and motorized equipment used during the construction process. An operating nuclear plant would have minor air emissions associated with diesel generators. These emissions would be regulated [NRC 2003, Section 8.2.3.1]. Emissions for a plant sited in New York would be regulated by the state. Overall, emissions and associated impacts are considered SMALL.

8.2.3.1.5 Waste

The NRC summarized environmental data associated with the uranium fuel cycle in Table S-3 of 10 CFR 51.51. The impacts shown in Table S-3 are representative of the impacts that would be associated with a replacement nuclear power plant built to one of the certified designs, sited at an alternate site. The impacts shown in Table S-3 are for a 1,000 MWe reactor which is approximately equal to one of the IP2 and IP3 nuclear power plants (IP2 and IP3 have a combined capacity of 2,158 gross MWe). The environmental impacts associated with transporting fuel and waste to and from a light-water cooled nuclear power reactor are summarized in Table S-4 of 10 CFR 51.52. The summary of NRC's findings on NEPA issues for license renewal of nuclear power plants in Table B-1 of 10 CFR Part 51 Subpart A, Appendix B, is also relevant, although not directly applicable, for consideration of environmental impacts associated with the operation of a replacement nuclear power plant [NRC 2003]. Overall, waste impacts are considered SMALL.

8.2.3.1.6 Human Health

Human health impacts for an operating nuclear power plant are identified in 10 CFR Part 51, Subpart A, Appendix B, Table B-1. Overall, human health impacts are considered SMALL.

8.2.3.1.7 Socioeconomics

For two 1,000 MWe reactors it is assumed that operating licenses could be obtained by the time IP2 and IP3 operating licenses expire. Construction would overlap with the first 1,000 MWe of new generation available to timely replace IP2 capacity in 2013 and the second 1,000 MWe unit would replace IP3 in 2015. The new reactors would be located on a common site with construction proceeding in parallel. Construction duration for each reactor would be approximately five years with a total duration of seven years (second unit would start two years after start of first unit). The total peak workforce could be approximately 5,000 workers.

It is also assumed that construction would take place at this alternate site while IP2 and IP3 continued operation until license expiration, at which time socioeconomic impacts would change for the existing site.

Construction of a replacement nuclear power plant at an alternate site would relocate some socioeconomic impacts, but would not eliminate them. The communities around IP2 and IP3 would still experience the impact of operational job loss (although potentially tempered by projected economic growth), and the communities around the new site would have to absorb the impacts of a large, temporary work force (approximately 5,000 workers at the peak of construction) and a permanent work force of approximately 1,356 workers. In the GEIS, the NRC noted that socioeconomic impacts at a rural site would be larger than at an urban site because more of the peak construction work force would need to move to the area to work. Alternate sites would need to be analyzed on a case-by-case basis. Socioeconomic impacts at rural sites could be LARGE.

The impacts of operating the nuclear alternative at the alternate site could be smaller or larger than those at the site, depending on how close the alternate site is to an economic center. These impacts are considered SMALL to LARGE, depending on the site.

During the seven-year construction period, up to approximately 5,000 construction workers could be working at the site. The addition of the construction workers could place significant traffic loads on existing highways. Such impacts would be MODERATE to LARGE. Transportation impacts related to commuting of plant operating personnel would be similar to current impacts associated with operation of IP2 and IP3 and are considered SMALL.

Transportation-related impacts associated with commuting workers at an alternate site are site dependent, but could be MODERATE to LARGE. Transportation impacts related to commuting of plant operating personnel would also be site dependent, but can be characterized as SMALL.

8.2.3.1.8 Aesthetics

At an alternate site, depending on placement, there would be an aesthetic impact from the buildings. There would also be a significant aesthetic impact associated with construction of a new transmission line to connect to other lines to enable delivery of electricity. Noise and light from the plant would be detectable off-site. The impact of noise and light would be mitigated if the plant is located in an industrial area adjacent to other power plants, in which case the impact could be SMALL. The impact could be MODERATE if a transmission line needs to be built to the alternate site. The impact could be LARGE if a greenfield site is selected.

8.2.3.1.9 Historic and Archaeological Resources

Before construction at an alternate site, studies would be needed to identify, evaluate, and address mitigation of the potential impacts of new plant construction on cultural resources. The studies would be needed for areas of potential disturbance at the proposed plant site and along associated corridors where new construction would occur (e.g., roads, transmission corridors, rail lines, or other rights-of-way). Historic and archaeological resource impacts can generally be effectively managed and as such are considered SMALL.

Table 8-12
Summary of Environmental Impacts from Nuclear Power Generation
Using Closed-Cycle Cooling at Alternate Greenfield Site

Impact Category	Alternative Greenfield Site	
	Impact	Comments
Land Use	MODERATE to LARGE	Could require as much as 1,000 to 2,000 acres for the plant and 2,000 acres for uranium mining.
Ecology	MODERATE to LARGE	Impact depends on location and ecology of the site, surface water body used for intake and discharge, and transmission line routes; potential habitat loss and fragmentation; reduced productivity and biological diversity.
Water Use and Quality - Surface Water - Groundwater	SMALL to MODERATE SMALL to LARGE	Impact will depend on the volume of water withdrawn and discharged and the characteristics of the surface water body. Groundwater impacts would depend on uses and available supply.
Air Quality	SMALL	Fugitive emissions and emissions from vehicles and equipment during construction. Small amount of emissions from diesel generators and possibly other sources during operation. Emissions are similar to current releases at the IP2 and IP3 site.
Waste	SMALL	Waste impacts for an operating nuclear power plant are set out in 10 CFR Part 51, Appendix B, Table B-1. Debris would be generated and removed during construction.
Human Health	SMALL	Human health impacts for an operating nuclear power plant are set out in 10 CFR Part 51, Appendix B, Table B-1.
Socioeconomics	SMALL to LARGE	Construction impacts depend on location. Impacts at a rural location could be LARGE. Surrounding community would experience loss of tax base and employment with MODERATE impacts. Transportation impacts associated with construction workers could be MODERATE to LARGE. Transportation impacts of commuting workers during operations would be SMALL.

Table 8-12 (Continued)
Summary of Environmental Impacts from Nuclear Power Generation
Using Closed-Cycle Cooling at Alternate Greenfield Site

Impact Category	Alternative Greenfield Site	
	Impact	Comments
Aesthetics	SMALL to LARGE	Impacts would depend on the characteristics of the alternate site. Impacts would be SMALL if the plant is located adjacent to an industrial area. New transmission lines would add to the impacts and could be MODERATE. If a greenfield site is selected, the impacts could be LARGE.
Historic and Archaeological Resources	SMALL	Potential impacts can be effectively managed.

8.2.3.2 Once-Through Cooling System

The environmental impacts of once-through cooling for an alternative brownfield or greenfield site to replace the 2,158 MWe base-load capacity of IP2 and IP3 are provided as a comparative analysis of impacts equivalent to the existing site. The environmental impacts of constructing a nuclear power plant that uses once-through cooling at an alternate site are similar to the impacts for a nuclear power plant using closed-cycle cooling with cooling towers. However, there are some differences in the environmental impacts between the closed-cycle and once-through cooling systems. In those impact categories related to land-area requirements, such as land use, terrestrial ecology, and cultural resources, the impacts are likely to be smaller if the site uses a once-through cooling system rather than a closed-cycle cooling system. However, the impacts of a plant with a once-through cooling system are likely to be greater than a plant with a closed-cycle cooling system in the areas of water use and aquatic ecology because of the need for greater quantities of cooling water. [Table 8-13](#) summarizes the incremental differences.

Table 8-13
Summary of Environmental Impacts from Nuclear Power Generation
Using Once-Through Cooling at Alternate Greenfield Site

Impact Category	Alternative Greenfield Site Impact
Land Use	Requires as much as 1,000 to 2,000 acres for the plant and 2,000 acres for uranium mining. 75 to 90 acres less land required because cooling towers and associated infrastructure are not needed.
Ecology	Impact would depend on ecology of the site. No impact to terrestrial ecology from cooling tower drift. Increased water withdrawal with possible greater impact to aquatic ecology.
Water Use and Quality - Surface Water	No discharge of cooling tower blowdown. Increased water withdrawal and more thermal load on the receiving body of water.
- Groundwater	No change.
Air Quality	No change.
Waste	No change.
Human Health	No change.
Socioeconomics	No change.
Aesthetics	Reduced aesthetic impact because cooling towers would not be used, but impacts could still be large if lengthy transmission line is required.
Historic and Archaeological Resources	Less land impacted.

8.2.4 Purchased Electrical Power

If available, purchased power from other sources could potentially obviate the need to renew the IP2 and IP3 Operating Licenses. "Purchased power" is power purchased and transmitted from electric generation plants that the applicant does not own and that are located elsewhere within the region, nation, Canada, or Mexico.

In theory, purchased power is a feasible alternative to IP2 and IP3 license renewal. There is no assurance, however, that sufficient capacity or energy would be available in the 2013 through 2035 time-frame to replace the 2,158 gross MWe base-load generation. For example, EIA projects that total gross U.S. imports of electricity from Canada and Mexico will gradually

increase from 38.4 billion kWh in year 2001 to 47.2 billion kWh in year 2010 and then gradually decrease to 28.94 billion kWh in year 2020 [USDOE 2004]. On balance, it appears unlikely that electricity imported from Canada or Mexico would be able to replace the IP2 and IP3 generating capacity. Failure to obtain a sufficient power source replacement might result in subsequent brownouts. In addition, purchased electrical power may require additional improvements in or addition to the existing transmission systems, which would incur additional environmental impacts.

More importantly, regardless of the technology used to generate purchased power, the generating technology would be one of those described in this ER and in the GEIS (probably coal, natural gas, nuclear, or hydroelectric). The GEIS description of other technology impacts is representative of imported power impacts related to IP2 and IP3 license renewal alternatives [NRC 2001, Section 8.2.3].

8.3 Alternative Generation Not Within the Range of Reasonable Alternatives

Other commonly known generation technologies considered are listed in the following paragraphs. However, these sources have been eliminated as reasonable alternatives to the proposed action because the generation of approximately 2,158 gross MWe of electricity as a base-load supply using these technologies is not technologically feasible. Failure to obtain a sufficient power source replacement might result in subsequent brownouts and power grid instability problems. In addition, the current transmission system constraints in New York State would preclude transmission of power from Northern and Western New York State to elsewhere within the state [National].

8.3.1 Wind

Wind power by itself is not suitable for large base-load capacity. As discussed in Section 8.3.1 of the GEIS, wind has a high degree of intermittency and average annual capacity factors for wind plants are relatively low (less than 30%). Wind power in conjunction with energy storage mechanisms, might serve as a means of providing base-load power. However, current energy storage technologies are too expensive for wind power to serve as a large base-load generator. [NRC 2005, Section 8.2.5.2]

Most of western New York is in wind power Class 2 or 3 regions (average wind speeds at 30-ft elevation of 9.8 to 12.5 mph) with a narrow band of Class 3 or 4 along the shore of Lake Ontario [Elliot]. Wind turbines are economical in wind power Classes 4 through 7 (average wind speeds of 16 to 20 mph) [USDOE 2006b]. Wind turbines typically operate at a 25 to 35 percent capacity factor, compared to 80 to 95 percent for a base-load plant [NPPC]. The largest commercially available wind turbines are in the range of 1 to 3 MWe. Therefore, from a practical perspective, the scale of this technology is too small to directly replace a power generating plant the size of IP2 and IP3 and the functionality is not equivalent.

There are Class 4 to 7 winds in offshore areas along the northeastern coast, including New York [Bailey]. The Department of Interior Mineral Management Service has received a request from Long Island Offshore Wind Park, LLC (LLOWP) for a lease, easement, or right-of-way to

construct and operate a wind energy facility in Federal waters off Long Island, 3.6 miles southwest of Jones Beach Island, in Nassau and Suffolk Counties, New York. The purpose of this project is to provide a utility-scale renewable energy facility providing power to the New York electrical grid. Forty wind turbine generators are proposed to generate 140 MW of electricity and deliver it to an existing substation near West Amityville by means of a buried transmission line. MMS is preparing an Environmental Impact Statement for the proposed project. The LIOWP proposal is for construction and operation of a wind energy facility on approximately 8 square miles of the OCS off Long Island [USDOJ]. The American Wind Energy Association reports as of July 2006 there are 280 megawatts of wind energy currently online or planned to be online in 2006, with an additional 235 megawatts planned including the LIOWP project, and a wind energy potential of 7,080 MWe in New York State [AWEA 2006b].

As of April 2005, there were approximately 48 MWe of grid-connected wind power facilities in New York State, with approximately 637 MWe of additional capacity in various stages of planning [AWEA 2005]. Statewide, the New York State Energy Research and Development Authority (NYSERDA) estimates that there is a potential for approximately 17,000 MWe of installed capacity, of which approximately 3,200 MWe would be available for the peak summer load [NYSERDA]. Access to many of the best wind power sites would require extensive road building, as well as clearing (for towers and blades) and leveling (for the tower bases and associated facilities) in steep terrain. In open, flat terrain, a utility-scale wind plant will require about 60 acres per megawatt of installed capacity. However, only 5% (3 acres) or less of this area is actually occupied by turbines, access roads, and other equipment—95% remains free for other compatible uses such as farming or ranching [AWEA 2006a]. Based on 60 acres per MWe, approximately 129,480 acres would be required, with 6,474 acres occupied by the turbines, access roads and other equipment, to replace the generation capacity of IP2 and IP3. This far exceeds the land available at the IP2 and IP3 site. Also, many of the best quality wind sites are on ridges and hilltops that could have greater archaeological sensitivity than surrounding areas. For these reasons development of large-scale, land-based wind power facilities are likely not only to be costly, but to have LARGE impacts on aesthetics, archaeological resources, land use, and terrestrial ecology.

The offshore wind speeds in Lake Ontario and along the Atlantic Coast are higher than those onshore and could thus support greater energy production than onshore facilities. However, it is very unlikely that offshore wind power facilities could replace the electrical output. Development of an offshore wind power facility could impact shipping lanes, may disrupt the aquatic ecology, and would be visible for many miles, resulting in considerable aesthetic impacts. These impacts could be MODERATE to LARGE.

Wind power could be included in a combination of alternatives to replace the IP2 and IP3 generation capacity of approximately 2,158 MWe. The environmental impacts of a large-scale wind farm are described in the GEIS [NRC 1996, Section 8.3.1]. The construction of roads, transmission lines, and turbine tower supports would result in short-term impacts, such as increases in erosion and sedimentation, and decreases in air quality from fugitive dust and equipment emissions. Construction in undeveloped areas would have the potential to disturb and impact cultural resources or habitat for sensitive species. During operation, some land near

wind turbines could be available for compatible uses such as agriculture. The continuing aesthetic impact would be considerable, and there is a potential for bird collisions with turbine blades. Wind farms generate very little waste and pose no human health risk other than from occupational injuries. Although most impacts associated with a wind farm are SMALL or can be mitigated, some impacts such as the continuing aesthetic impact and impacts to sensitive habitats could be LARGE, depending on the location.

8.3.2 Solar

The average capacity factor for this technology is estimated to be 25–40% annually. This technology has high capital costs and lacks base-load capability unless combined with natural gas backup. It requires very large energy-storage capabilities. Based upon solar energy resources, the most promising region of the country for this technology is the West. [NRC 2001, Section 8.2.4.2]

There are also substantial impacts to natural resources (wildlife habitat, land-use, and aesthetic impacts) from construction of solar-generating facilities. As stated in the GEIS, land requirements are high. Based on the land requirements of 14 acres for every one MWe generated, approximately 30,212 acres would be required to replace the 2,158 gross MWe produced by IP2 and IP3. There is not enough land for a solar energy system at the existing site, and environmental impacts at an alternate site would be LARGE.

The construction impacts would be similar to those associated with a large wind farm as discussed in Section 8.3.1. The operating facility would also have considerable aesthetic impact. Solar installations pose no human health risk other than from occupational injuries. The manufacturing process for constructing a large amount of photovoltaic cells would result in waste generation, but this waste generation has not been quantified. Some impacts, such as impacts to sensitive areas, loss of productive land, and the continuing aesthetic impact, could be LARGE, depending on the location.

8.3.3 Hydropower

New York State has a technical potential for 2,527 MWe of additional installed hydroelectric capacity by 2022, of which only 909 MWe represents peak summer capacity [NRC 2005, Section 8.2.5.4]. If all this capacity were developed, it would be insufficient to replace the approximately 2,158 MWe generating capacity (during the summer period) of IP2 and IP3. Moreover, as stated in Section 8.3.4 of the GEIS, hydropower's percentage of U.S. generating capacity is expected to decline because the facilities have become difficult to site as a result of public concern about flooding, destruction of natural habitat, and alteration of natural river courses. DOE/EIA states that potential sites for hydroelectric dams have already been largely established in the U.S. and environmental concerns are expected to prevent the development of any new sites in the future [USDOE 2002b].

The GEIS estimates that land requirements for hydroelectric power are approximately one million acres per 1,000 MWe. Replacement of the IP2 and IP3 generating capacity would therefore require flooding a substantial amount of land (2,158,000,000 acres). Due to the large land-use

and related environmental and ecological resource impacts associated with siting hydroelectric facilities large enough to replace IP2 and IP3, it can be concluded that local hydropower alone is not a feasible alternative to the renewal of the IP2 and IP3 Operating Licenses on its own. Any attempts to site hydroelectric facilities large enough to replace IP2 and IP3 would result in LARGE environmental impacts.

8.3.4 Geothermal

Geothermal has an average capacity factor of 90% and can be used for base-load power where available. However, as illustrated by Figure 8.4 in the GEIS, geothermal plants might be located in the western continental U.S., Alaska, and Hawaii where geothermal reservoirs are prevalent. This technology is not widely used as base-load generation due to the limited geographic availability of the resource and the immature status of the technology [NRC 2001, Section 8.2.4.4]. This technology is not applicable to the region where the replacement of approximately 2,158 gross MWe is needed. While this region possesses low-temperature resources suitable for geothermal heat pumps, it lacks sufficient resources to utilize other geothermal technologies.

8.3.5 Wood Energy

A wood-burning facility can provide base-load power and operate with an average annual capacity factor of around 70 to 80% and with 20 to 25% efficiency. The cost of the fuel required for this type of facility is highly variable and very site-specific. For example, the 53 MW McNeil Station (the largest wood-fired generator in the world when it came on line) was developed with great promise as an in-state generating source, a market for low-grade wood to aid Vermont forest management, insulation from volatile oil prices, and a significant employer generating other associated economic benefits [DPS]. However, since the plant opened in June 1984, McNeil's fuel price of about 3.5 cents/kWh was not competitive with the post-1986 regime of low oil prices [DPS]. Among the factors influencing costs are the environmental considerations and restrictions that are influenced by public perceptions, easy access to fuel sources, and environmental factors. In addition, the technology is expensive and inefficient. Current conditions still do not allow McNeil to operate as a base-load facility as originally envisioned, but instead gives its owners a price ceiling on the market prices they face [DPS].

Review of available literature indicates limited wood burning energy generation continues to be developed in the northeastern States. The New York Biomass Energy Project 7-MW wood-fired generation plant is being built in western New York [USDOE 2006a]. Interest and research is likely to continue in wood-fired electric power generation as the prices for oil and other fossil fuels rise. However, like other fossil fuel plants, greenhouse gases emissions and other emissions pose considerable obstacles to wood-fired electric power generation as a replacement for base-load capacity.

Estimates in the GEIS suggest that the overall level of construction impact per MW of installed capacity should be approximately the same as that for a coal-fired plant, although facilities using wood waste for fuel would be built at smaller scales [NRC 1996]. Like coal-fired plants, wood-waste plants require large areas for fuel storage and processing and involve the same type of combustion equipment. Because of uncertainties associated with obtaining sufficient wood and

wood waste to fuel a base load generating facility, ecological impacts of large-scale timber cutting (e.g., soil erosion and loss of wildlife habitat), and relatively low energy conversion efficiency, Entergy has determined that wood waste is not a feasible alternative to renewing the IP2 and IP3 Operating Licenses.

8.3.6 Municipal Solid Waste

The initial capital costs for this technology are much greater than the comparable steam-turbine technology found at wood-waste facilities. This is due to the need for specialized municipal solid waste-handling and waste-separation equipment and stricter environmental emissions controls. The decision to burn municipal waste to generate energy is usually driven by the need for an alternative to landfills rather than by energy considerations. High costs prevent this technology from being economically competitive. Thus, municipal solid waste generation is not a reasonable alternative. [NRC 2001, Section 8.2.4.6]

Currently, there are approximately 89 waste-to-energy plants operating in the United States. These plants generate approximately 2,500 MWe, or an average of approximately 28 MWe per plant [WTE]. Approximately 77 typical waste-to-energy plants would be required to replace the 2,158 gross MWe base load capacity of IP2 and IP3. Therefore, the generation of electricity from municipal solid waste would not be a feasible alternative to renewal of the IP2 and IP3 Operating Licenses.

8.3.7 Other Biomass-Derived Fuels

In addition to wood and municipal solid waste fuels, there are several other concepts for fueling electric generators, including burning energy crops, converting crops to a liquid fuel such as ethanol (ethanol is primarily used as a gasoline additive for automotive fuel), and gasifying energy crops (including wood waste). The GEIS points out that none of these technologies has progressed to the point of being competitive on a large scale or of being reliable enough to replace a base-load plant such as IP2 and IP3. For these reasons, such fuels do not offer a feasible alternative to renewing the IP2 and IP3 Operating Licenses. In addition, these systems have LARGE impacts on land use. [NRC 2001, Section 8.2.4.7]

8.3.8 Oil

Oil is not considered a stand-alone fuel because it is not cost-competitive when natural gas is available. The cost of an oil-fired operation is about eight times as expensive as a nuclear or coal-fired operation. In addition, future increases in oil prices are expected to make oil-fired generation increasingly more expensive than coal-fired generation. For these reasons, oil-fired generation is not a feasible alternative to renewing the IP2 and IP3 Operating Licenses, nor is it likely to be included in a mix with other resources, except as a back-up fuel. [NRC 2001, Section 8.2.4.8]

8.3.9 Fuel Cells

Phosphoric acid fuel cells are the most mature fuel-cell technology, but they are only in the initial stages of commercialization. Two-hundred turnkey plants have been installed in the U.S., Europe, and Japan. Recent estimates suggest that a company would have to produce 100 MWe of fuel-cell stacks annually to achieve a price of \$1,000 to \$1,500 per kilowatt. However, the current production capacity of all fuel-cell manufacturers only totals about 60 MW per year. The use of fuel cells for base-load capacity requires very large energy-storage devices that are not feasible for storage of sufficient electricity to meet the base-load generating requirements. This is a very expensive source of generation, which prevents it from being competitive. This technology also has a high land use impact, which, like wind technology, results in a LARGE impact to the natural environment. Approximately 75,530 acres of land (35 acres per MWe) would be required to generate 2,158 MWe of electricity. Therefore, fuel cells are not considered a feasible alternative to renewing the IP2 and IP3 Operating Licenses. [NRC 2001, Section 8.2.4.10]

As market acceptance and manufacturing capacity increase, natural-gas-fueled fuel cell plants in the 50- to 100-MW range are projected to become available. At the present time, however, fuel cells are not economically or technologically competitive with other alternatives for base-load electricity generation, and progress in market growth and cost reduction has been slower than alternatives anticipated [CSFCC 2003]. Fuel cells are, consequently, not a feasible alternative to renewal of the IP2 and IP3 Operating Licenses.

8.3.10 Delayed Retirement

Even without retiring any Entergy owned or non-Entergy owned generating units, it is expected that additional capacity will be required in the near future. Thus, even if substantial capacity were scheduled for retirement and could be delayed, some of the delayed retirement would be needed just to meet load growth.

IP2 and IP3 would be required, in part, to offset any actual retirements that occur. Delayed retirement of other Entergy or non-Entergy generation units is unlikely to displace the need for 2,158 MWe of capacity over the twenty years of extended operation and therefore would not be a feasible alternative to renewing the IP2 and IP3 Operating Licenses.

8.3.11 Utility-Sponsored Conservation

The concept of conservation as a resource does not meet the primary NRC criterion "that a reasonable set of alternatives should be limited to analysis of single, discrete electric generation sources and only electric generation sources that are technically feasible and commercially viable". Conservation is neither single, nor discrete, nor is it a source of generation. [NRC 2001, Section 8.2.4.12]

Since IP2 and IP3 operate in a deregulated environment, utility-sponsored conservation programs are driven by the corporation that purchases and distributes the power. Entergy's conservation programs are confined to those service territories associated with regulated plants

(i.e., Arkansas Nuclear One, Grand Gulf Nuclear Station, River Bend Station, Waterford 3). However, Entergy does have conservation programs as discussed below.

Energy Efficiency Programs at Entergy

Energy efficiency is an important environmental strategy since it lowers emissions by reducing energy consumption. Entergy has an ongoing partnership with Energy Star® - a government backed program helping businesses and individuals save money through better energy efficiency - to provide information and tools to customers to help them conserve energy.

In addition, Entergy has taken specific steps to increase energy efficiency across its' regulated service territory. Some examples are as follows:

- Mississippi's first Energy Star certified Habitat for Humanity home was built by Entergy.
- Entergy has worked to weatherize homes across its' regulated service territory through employee volunteer efforts in partnership with churches, schools and other agencies and through educational efforts that included training and informational events as well as the distribution of brochures.
- The New Orleans, Louisiana City Council has introduced a resolution that Entergy supports that will establish net metering for customer homes. Net metering will allow customers to invest in distributed renewable generation using energy for their use and selling excess back to the grid.
- Entergy continues to upgrade and promote the Ensign Web site, which includes energy efficiency calculators and related information.

The environmental impacts of an energy conservation program would be SMALL, but the potential to displace the entire generation at the site solely with conservation is not realistic. Therefore, the conservation option by itself is not considered a reasonable replacement for the IP2 and IP3 Operating License renewal alternative.

8.3.12 Combination of Alternatives

NRC indicated in the GEIS that, while many methods are available for generating electricity and a huge number of combinations or mixes can be assimilated to meet system needs, such expansive consideration would be too unwieldy given the purposes of the alternatives analysis. Therefore, NRC determined that a reasonable set of alternatives should be limited to analysis of single discrete electrical generation sources and only those electric generation technologies that are technically reasonable and commercially viable [NRC 1996, Section 8.1]. Consistent with the NRC determination, Entergy has not evaluated mixes of generating sources.

8.4 Proposed Action vs. No-Action

The proposed action is the renewal of the IP2 and IP3 Operating Licenses. The specific review of the eleven Category 2 environmental impacts, required by 10 CFR 51.53(c)(3)(ii), concluded that there would be no adverse impact to the environment from the continued operation of IP2 and IP3 through the period of extended operation. This section investigates the consequences of the early retirement of IP2 and IP3.

The no-action alternative to the proposed action is the decision not to renew the IP2 and IP3 Operating Licenses for the site. The environmental impacts of the no-action alternative would be the impacts associated with the construction and operation of alternative replacement electric power. In effect, the net environmental impacts would be transferred from the continued operation of the site to the environmental impacts associated with the construction and operation of a new generating facility. This new generating facility would almost certainly be constructed at a greenfield location due to the air impacts associated with constructing one of the viable technologies on the IP2 and IP3 site due to air quality non-attainment status and the lack of available land onsite. Therefore, the no-action alternative would have no net environmental benefits.

In the event that the IP2 and IP3 Operating Licenses are not renewed for an additional 20 years, then adverse impacts can be expected due to loss of tax revenues (see [Table 2-9](#)).

8.4.1 Energy Replacement Feasibility

According to a recently published report by the National Academies' National Research Council, concerning the early closure of IP2 and IP3, the committee concluded that it is technically feasible to replace the energy generated by New York's Indian Point nuclear power plant if it closes in coming years. However, political, regulatory, and financial hurdles would make doing so difficult. Given the time it takes to obtain a suitable site, navigate the regulatory issues and obtain permits, and then construct a power plant, new generating capacity may not be available until existing reserves are dangerously low. Forestalling a crisis may require extraordinary efforts on the part of policy makers and regulators. [[National](#), Summary and Findings]

The National Academies report indicates significant challenges exist just to supply projected increases in capacity demand, even if IP2 and IP3 Operating Licenses are renewed. Replacement for Indian Point would most likely consist of a portfolio of approaches, including investments in energy efficiency, transmission, and new generation. The National Academies committee that studied energy replacement concluded in that existing generation and transmission capacity could make little contribution to replacing Indian Point [[National](#), Chapter 3]. According to the report, shutdown would require new energy sources and reduced demand for electricity that add up to about 5000 megawatts—2000 to replace the lost production of Indian Point and the balance to meet projected increases in demand and to compensate for other possible power plant closings. [[National](#), Chapter 5]

The committee states that advanced natural-gas-fired combined-cycle plants are the generation option capable of making the biggest contribution at the lowest cost by 2015. But, although it

seems that sufficient gas might be available to replace Indian Point generating capacity, in fact all of the excess may well be committed some time before the plants shut down. The long-term gas supply picture is not encouraging unless resources such as liquefied natural gas (LNG) imports are increased, and LNG imports are uncertain with respect to timing, volumes, and locations for terminal facilities. All new generating capacity currently being built in New York State, over 2000 MW, is gas fired. As much as 1600 MW could be needed by 2010 to meet reliability requirements even without closing Indian Point. [National, Chapter 3]

With respect to socioeconomic and ecological costs, the report concluded that electricity from new plants would almost certain be more costly than that from Indian Point. In addition, to the extent that the reactors are replaced with plants that burn fossil fuel, emissions of carbon dioxide will be higher, complicating efforts by New York to reduce greenhouse gases under the Regional Greenhouse Gas Initiative. [National]

8.4.2 Replacement and Siting Suitability Problems

One generation replacement option would be for Entergy or another developer to build and operate a gas-fired simple cycle or combined cycle power plant at the IP2 and IP3 site. The feasibility of peaking capacity was discussed in Entergy's Preliminary Scoping Statement filed with the New York Public Service Commission (NYPSC) on March 18, 2002, to construct a 330 MWe simple cycle plant. The plant was originally to be comprised of eight 45-MW aero-derivative gas turbines, later amended to two 165-MW GE 7FA industrial frame gas turbines. The plant was to utilize a five-acre parcel on the site outside of the "protected area" that houses the reactors. The plant would have tied into the Buchanan electric substation, less than 2000 feet to the northeast [Levitan].

While the existing Algonquin main pipeline line may be adequate for a 330 MWe simple cycle plant that would operate in peaking mode during the summer season, a report prepared by Levitan and Associates, Inc. concluded that substantial and expensive site pipeline upgrades would probably be required to supply natural gas to a combined cycle plant throughout the winter heating season, November–March, and for the additional base load capacity (i.e., greater than 330 MW) throughout the year.

8.4.3 Impacts

The following sections describe ecological and socioeconomic impacts associated with retiring IP2 and IP3.

8.4.3.1 Fish

In December 1999, IP2 and IP3 filed a DEIS with the NYSDEC which formed the basis for an FEIS that was issued in June 2003. The NYSDEC issued a draft SPDES permit (#NY-0004472) under which Entergy would be required to implement a closed-cycle cooling system that would reduce the water intake from the Hudson River [Levitan]. The impacts of the closed-cycle cooling alternative were presented in Section 8.1. The impacts of entrainment and impingement were discussed in Sections 4.2 and 4.3, respectively. Based on extensive fisheries studies completed

for more than 30 years on the Hudson River estuary, the impacts of continued operation of IP2 and IP3 through the license renewal term is expected to be SMALL. Consequently, the impact on the Hudson River fisheries from a decision not to renew the operating license for IP2 and IP3 would also be expected to be SMALL.

8.4.3.2 Air Emissions

If IP2 and IP3 are retired, replacement generation (and generation to meet addition demand) would need to be constructed and brought online to make up for the energy deficit that would be produced by its retirement.

Levitan and Associates, Inc. roughly estimated air emissions in New York during two specific years, 2009 and 2016, to measure the impact of retiring IP2 and IP3. The retirement of IP2 and IP3 was projected to increase New York power plants emissions by approximately 4.0% - 4.3% in NO_x and 2.6% - 2.7% in SO₂ emissions (Table 8-14). These projections should be viewed as preliminary indicative estimates only [Levitan].


**Table 8-14
Indicative New York State Air Emissions Impacts**

Retirement Dates	Emission	Emissions with IP	Emissions without IP	Net Power Plant Increase	Net State – Wide Increase
2009 vs. 2013/15	NO _x	76.1 ktons	79.4 ktons	+ 3.3 ktons + 4.3%	+ 0.5%
	SO ₂	250.8 ktons	257.6 ktons	+6.8 ktons + 2.7%	+ 1.4%
2016 vs License Renewal	NO _x	82.3 ktons	85.6 ktons	+ 3.3 ktons + 4.0%	+ 0.5%
	SO ₂	268.5 ktons	275.6 ktons	+ 7.0 ktons + 2.6%	+ 1.4%

Source: [Levitan](#)

Levitan and Associates, Inc. made adjustments to the projected emission values to account for the staggered termination of IP2 and IP3. The estimates for emissions for the most likely replacement electric power generation are presented in Tables 8-4 and 8-9, for coal or natural gas, respectively. The Levitan report, as described above, estimates additional NO_x emissions at 3.3 kilotons or 3,637 tons per year if IP2 and IP3 were not to be granted license renewal.

Additional SO_x emissions were estimated at 7 kilotons, or 7,716 tons. As noted in [Table 8-4](#), the annual emission for only replacing the base-load generation capacity of IP2 and IP3 would be 6,284 tons per year of SO_x and 1,476 tons per year of NO_x. [Figure 8-1](#) shows the projected increase in NO_x emissions if IP2 is removed from service in 2013, and IP3 in 2015 [[Levitan](#)]. The pattern for SO₂ emissions would be similar.

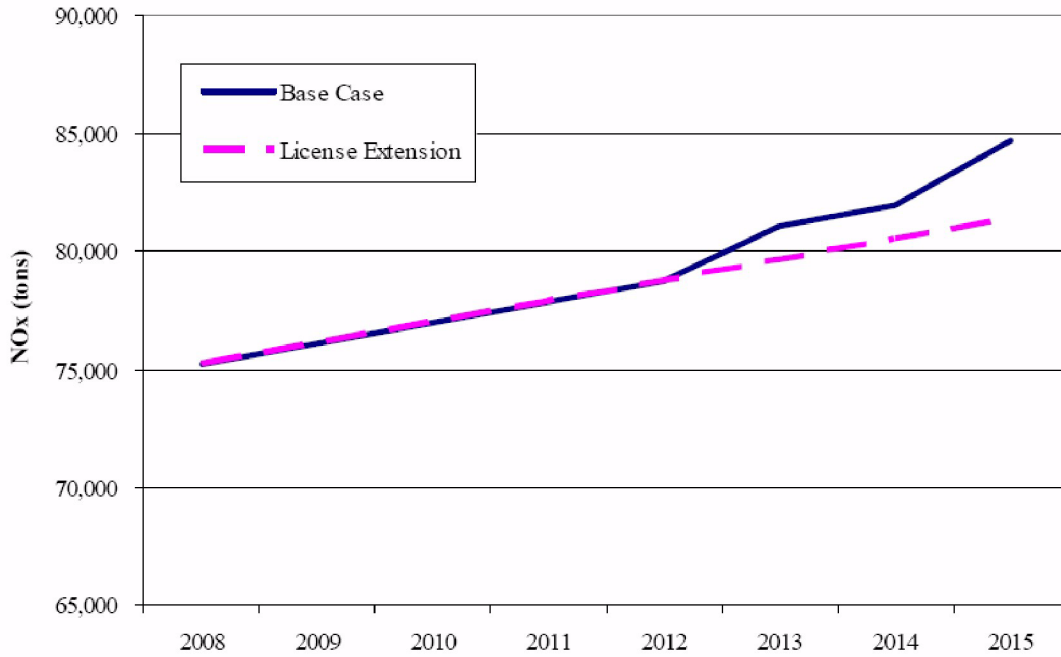

[Levitan]

Figure 8-1
NO_x Emissions Under Base Case and License Renewal Scenarios

8.4.3.2.1 Carbon Dioxide Emissions and Global Warming

Carbon Dioxide (CO₂) emissions are suspected to be a major contributor to anthropogenic greenhouse gas emissions and recent climate global warming. These emissions result from the efficiency of the technologies utilized to produce and deliver the energy and carbon content of the fuel being utilized. Based on the U.S. DOE report, "Voluntary Reporting of Greenhouse Gas Emission, Fuel and Energy Emission Coefficients," a comparison of the CO₂ content of various fuels is cited below.

Fuel	Pounds CO ₂ per Million Btu
Subbituminous Coal	212.7
Bituminous Coal	205.3
#6 Fuel Oil	173.9
Natural Gas	117.1
Nuclear	0
Renewable Sources	0

Estimates of CO₂ emissions are provided below that would result if other fuel technologies were utilized to supply the approximately 2,158 gross MWe of electricity that is currently being generated by IP2 and IP3. The technologies, fuels, and production efficiencies shown are based upon "greenfield plants" that have recently been permitted as having "Best Available Control Technology (BACT)" under the New Source Review (NSR) Permit program. In addition, estimates are also based on a 92% capacity factor, which is what the Entergy's northeast nuclear fleet achieved overall during 2004.

Technology	Fuel	Heat Rate (Btu/KWh)	Electricity (MWH/yr)	CO ₂ Emissions (MT/yr)
Pulverized Coal	Bituminous Coal	9,928	17,391,353	16,079,300
Pulverized Coal	Sub-bituminous Coal	9,700	17,391,353	16,276,175
Combined Cycle Gas Turbine	Natural Gas	6,814	17,391,353	6,294,705

The environmental impacts of the continued operation of IP2 and IP3, providing approximately 2,158 gross MWe of base-load power generation through 2035, are significantly smaller than impacts associated with the best case among reasonable alternatives. The continued operation of IP2 and IP3 would create significantly less environmental impact than the construction and operation of new base-load generation capacity.

8.4.3.3 Socioeconomic Impact

A significant negative impact of retiring IP2 and IP3 before their licenses expire in 2013 and 2015, respectively, would be a rise in market energy prices, even with the timely addition of replacement generation.

If IP2 and IP3 were retired, the short-term impacts would include loss of Payment-in-Lieu-of-Taxes (PILOT) for Westchester County and the other counties surrounding the site, due to loss of revenue to vendors and contractors, loss of employment, and secondary impacts. If IP2 and IP3 are not relicensed, higher energy prices, even with sufficient replacement capacity, would result for those in the southeastern New York area, where IP2 and IP3 provide 23 percent of current generation supply [National, Summary and Findings].

If the IP2 and IP3 licenses are extended, the local community would benefit from continued PILOT, employee compensation, and local spending, as well as from lower electric energy prices. Levitan and Associates, Inc. included a Base Case forecast of market energy prices assuming that IP2's and IP3's Operating Licenses would not be renewed, as well as forecasts for the alternative scenarios in which IP2 and IP3 are retired immediately, retired in 2008, and the licenses are renewed for twenty years.

Figures 8-2 and 8-3 show the year-to-year trend of benefits and costs for four scenarios at the County and State level. The graphs show the total benefits and costs of the specific scenarios, not the relative benefits and costs against the base case assumption of 2013 and 2015 retirement and no on-site replacement generation [Levitan].

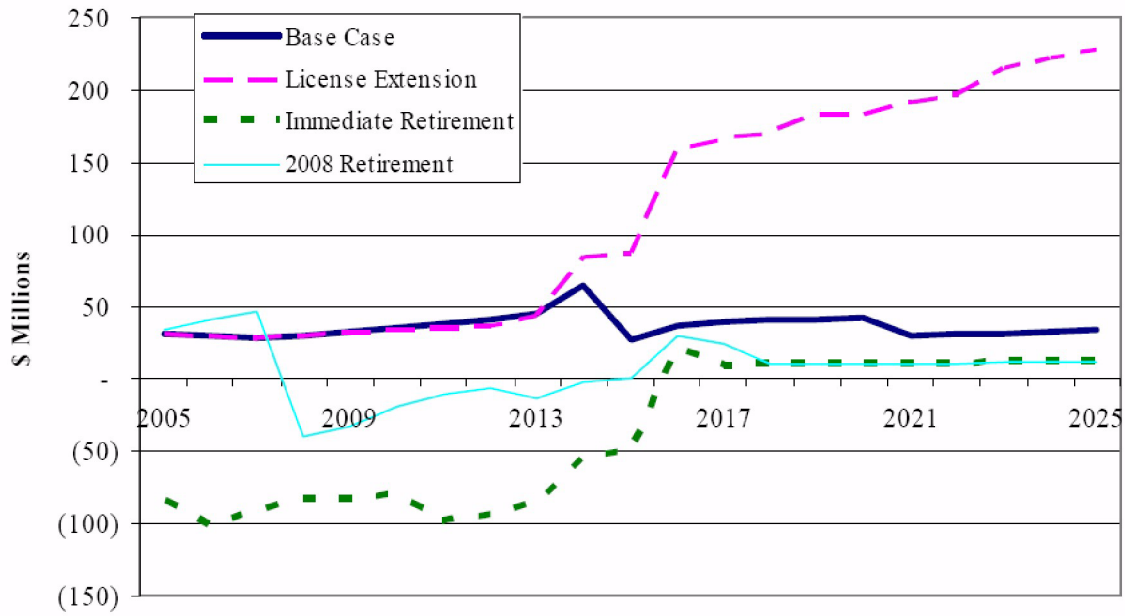


Figure 8-2
Total Economic Impact to the County by Scenario (\$ millions)

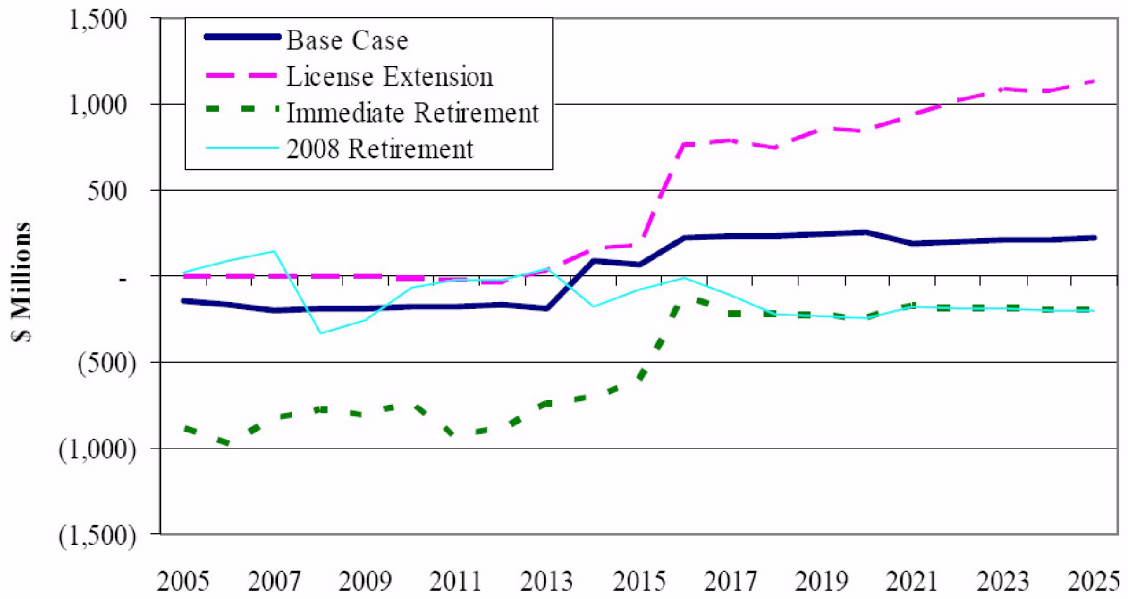


Figure 8-3
Total Economic Impact to the State by Scenario (\$ millions)

Table 8-15 describes changes to regional spot market energy prices that Levitan and Associates, Inc. forecasted using MarketSym if IP2 and IP3 were retired in 2005, in 2008, or have their licenses extended. Values represent percentage changes against the Base Case of IP2 and IP3 retirement in 2013 and 2015 [[Levitan](#)].

**Table 8-15
Average Change in Market Energy Prices**

Region	NYISO Zone(s)	2005 Retirement	2008 Retirement	License Renewal
Westchester County	GHI	11.3%	8.4%	- 7.5%
New York City	J	4.5%	3.8%	- 2.9%
Albany	F	7.6%	6.5%	- 3.7%
Western NY	A-E	0.1%	0.6%	-0.2%
Long Island	K	4.3%	3.9%	-3.1%

Source: [Levitan](#)

If IP2 and IP3 are retired in 2008 and developers have sufficient notice to install replacement generation, market energy prices in Westchester County are projected to increase by 8.4% on average through 2015. If the IP2 and IP3 Operating Licenses are extended so that 2,158 MW of replacement generation is not required, market energy prices in Westchester County are projected to decrease 7.5% on average from 2013 through the term of the license renewal.

The *Joint DOE-Electric Power Research Institute Strategic Research and Development Plan to Optimize U.S. Nuclear Power Plants* stated "... nuclear energy was one of the prominent energy technologies that could contribute to alleviate global climate change and also help in other energy challenges including reducing dependence on imported oil, diversifying the U.S. domestic electricity supply system, expanding U.S. exports of energy technologies, and reducing air and water pollution." The Department of Energy agreed with this perspective and stated "...it is important to maintain the operation of the current fleet of nuclear power plants throughout their safe and economic lifetimes" [[USDOE 1998](#)]. The renewal of the IP2 and IP3 Operating Licenses is consistent with these goals.

8.5 Summary

The proposed action is the renewal of the IP2 and IP3 Operating Licenses. The proposed action would provide the continued availability of approximately 2,158 gross MWe of base-load power generation through 2033 - 2035.

The environmental impacts of the proposed action (the continued operation of IP2 and IP3) have been compared to the environmental impacts from the no-action alternative (the construction and

operation of other reasonable sources of electric generation). The environmental impacts of the continued operation of IP2 and IP3, providing approximately 2,158 gross MWe of base-load power generation through 2033 - 2035, are superior to impacts associated with the best case among reasonable alternatives. The continued operation of IP2 and IP3 would create significantly less environmental impact than the construction and operation of new base-load generation capacity, including construction and operation of closed-cycle cooling towers at the existing site.

Finally, the continued operation of IP2 and IP3 will have a significant positive economic impact on the communities surrounding the station. Positive impacts include, but are not limited to, reduced local unemployment, significant contributions to local property tax revenue, economic support of southeastern New York, and lower energy costs.

8.6 References

- 69 FR 41576. Environmental Protection Agency 40 CFR Parts 9, 122 et al. National Pollutant Discharge Elimination System—Final Regulations to Establish Requirements for Cooling Water Intake Structures at Phase II Existing Facilities; Final Rule. July 9, 2004.
- AWEA (American Wind Energy Association). 2005. Wind Project Data Base. Accessed at <http://www.awea.org/projects/newyork.html> on November 21, 2005.
- AWEA (American Wind Energy Association). 2006a. Resources, Wind Web Tutorial, Wind Energy and the Environment. Accessed at http://www.awea.org/faq/wwt_environment.html#Will%20a%20wind%20project%20interfere%20with%20radar on July 8, 2006.
- AWEA (American Wind Energy Association). 2006b. New York State Wind Energy Development, Accessed at <http://www.awea.org/projects/newyork.html> on July 26, 2006.
- Bailey, B. 2004. Offshore Wind Energy: Status, Issues, and Comparisons with U.S. On-Land Development Potential in Coastal Areas. AWS Truewind, LLC.
- CHGEC (Central Hudson Gas and Electric Corporation). 1999. Consolidated Edison Company of New York, Inc., New York Power Authority, and Southern Energy New York. Draft Environmental Impact Statement for State Pollutant Discharge Elimination System Permits for Bowline Point, Indian Point 2 and 3, and Roseton Steam Electric Generating Stations.
- CSFCC (California Stationary Fuel Cell Collaborative). 2003. California Stationary Fuel Cell Collaborative). White Paper Summary of Interviews with Stationary Fuel Cell Manufacturers. Accessed at <http://stationaryfuelcells.org/Documents/PDFdocs/IndustrySurveyReport.pdf> on July 6, 2006.
- DPS (Department of Public Service) Vermont Electric Plan. 2005. Vermont Electric Plan 2005. January 19, 2005. Vermont Department of Public Service, Montpelier, VT.
- Elliott, D.L., C.G. Holladay, W.R. Barchet, H.P. Foote, and W.F. Sandusky, Wind Energy Resource Atlas of the United States, DOE/CH 10093-4, U.S. Department of Energy, Washington, DC, 1986. Accessed at <http://rredc.nrel.gov/wind/pubs/atlas/titlepg.html> on November 21, 2005.
- Enercon Services, Inc. 2003. Economic and Environmental Impacts Associated with Conversion of Indian Point Units 2 and 3 to a Closed-Loop Condenser Cooling Water Configuration.
- FHA (Federal Highway Administration). 2000. User Guidelines for Waste and Byproduct Materials in Pavement Construction, Coal Bottom Ash/Boiler Slag. Accessed at <http://tfhrc.gov/hnr20/recycle/waste/cbabs1.htm> on July 10, 2006.

- Gabbard, A. 1993. Coal Combustion: Nuclear Resource or Danger, Oak Ridge National Laboratory Review. Oak Ridge National Laboratory: Oak Ridge, Tennessee. Accessed at <http://www.ornl.gov/info/ornlreview/rev26-34/text/colmain.html> on July 10, 2006.
- HRSA (Hudson River Settlement Agreement). 1980. Settlement Agreement.
- IP2. 2006. Condenser Delta Ts.
- IP3. 2006. Condenser Delta Ts.
- Levitan and Associates, Inc. 2005. Indian Point Retirement Options, Replacement Generation, Decommissioning / Spent Fuel Issues, and Local Economic / Rate Impacts. Prepared for The County of Westchester and The County of Westchester Public Utility Service Agency.
- National Research Council. 2006. Alternatives to the Indian Point Energy Center for Meeting New York Electric Power Needs Committee on Alternatives to Indian Point for Meeting Energy Needs. National Research Council ISBN: 0-309-10172-7, 376.
- NERA (National Economic Research Associates) and GE Services, Inc. 2002. Electricity System Impacts of Nuclear Shutdown Alternatives.
- NPPC (Northwest Power Planning Council). 2000. Northwest Power Supply Adequacy/Reliability Study Phase I Report. Accessed at <http://www.nwcouncil.org/library/2000/2000-4.pdf> on November 21, 2005.
- NRC (U.S. Nuclear Regulatory Commission). 1979. Final Environmental Statement Related To Selection Of The Preferred Closed Cycle Cooling system at Indian Point Units No. 3, Consolidated Edison Company of New York, Inc. Power Authority of the State of New York. NUREG-0574, Office of Nuclear Reactor Regulation, Washington, DC.
- NRC (U.S. Nuclear Regulatory Commission). 1981. Consolidated Edison Company of New York, Inc. (Con Edison). Amendment To Facility Operating License. U.S. Nuclear Regulatory Commission, Docket Nos. 50-247 and 50-286.
- NRC (U.S. Nuclear Regulatory Commission). 1996. NUREG-1437, Generic Environmental Statement for License Renewal of Nuclear Power Plants, Final Report. Washington, DC.
- NRC (U.S. Nuclear Regulatory Commission). 2001. NUREG-1437, Supplement 3, Generic Environmental Impact Statement for License Renewal of Nuclear Plants—Arkansas Nuclear One, Unit 1. Office of Nuclear Reactor Regulation, Washington, DC.
- NRC (U.S. Nuclear Regulatory Commission). 2003. NUREG-1437, Supplement 10, Generic Environmental Impact Statement for License Renewal of Nuclear Plants—Peach Bottom Atomic Power Station, Units 2 and 3. Office of Nuclear Reactor Regulation, Washington, DC.

- NRC (U.S. Nuclear Regulatory Commission). 2004. NUREG-1437, Supplement 15, Generic Environmental Impact Statement for License Renewal of Nuclear Plants—Virgil C. Summer Nuclear Station. Office of Nuclear Reactor Regulations, Washington, DC.
- NRC (U.S. Nuclear Regulatory Commission). 2005. NUREG-1437, Supplement 24, Generic Environmental Impact Statement for License Renewal of Nuclear Plants, Regarding Nine Mile Point Nuclear Station, Units 1 and 2, Draft Report for Comment. Office of Nuclear Reactor Regulation, Washington, DC.
- NRC (U.S. Nuclear Regulatory Commission). 2006. NUREG-1437, Supplement 28, Generic Environmental Impact Statement for License Renewal of Nuclear Plants Regarding Oyster Creek Nuclear Generating Station, Washington, DC.
- NYSDEC (New York State Department of Environmental Conservation). 1997. Fourth Amended Stipulation of Settlement and Judicial Consent Order, National Resources Defense Council, Inc. et. al. vs. New York State Department of Environmental Conservation and Consolidated Edison Company of New York, Inc, New York Power Authority, Orange and Rockland Utilities, Inc., and Central Hudson Gas and Electric Corp. October 1997.
- NYSDEC (New York State Department of Environmental Conservation). 2003. SPDES Permit Fact Sheet and Summary of Proposed Permit Changes: Wastewater Data, Receiving Water Data, and Permit Limit Derivation, Attachment A in Fact Sheet: New York State Pollutant Discharge Elimination System (SPDES), Draft Permit Renewal with Modification, Indian Point Electric Generating Station. Buchanan, NY.
- NYSERDA (New York State Energy Research and Development Authority). 2002. 2002 State Energy Plan and Final Environmental Impact Statement. Accessed at <http://www.nysERDA.org/sep.html> on November 21, 2005.
- TRC Environmental Corp. 2002. Entergy Nuclear Indian Point 2, LLC, and Entergy Nuclear Indian Point 3, LLC, Emissions Avoidance Study, revised August 2002.
- USDOE (U.S. Department of Energy)-Electric Power Research Institute. 1998. Joint DOE-EPRI Strategic Research and Development Plan to Optimize U.S. Nuclear Power Plants, Volume 1.
- USDOE (U.S. Department of Energy). 2001. Energy Information Administration, Cost and Quality of Fuels for Electric Utility Plants 2000 Tables, DOE/EIA-0191(00). Accessed at <http://tonto.eia.doe.gov/FTPROOT/electricity/019100.pdf> on November 21, 2005.
- USDOE (U.S. Department of Energy). 2002a. Energy Information Administration, "Electric Power Annual 2000, Volume II," DOE/EIA-0348(00)/2, November 2002. Accessed at <http://tonto.eia.doe.gov/FTPROOT/electricity/0348002.pdf> on November 22, 2005.
- USDOE (U.S. Department of Energy). 2002b. Energy Information Administration, International Energy Outlook 2002, DOE/EIA-0484 (2002), Washington, DC, 2002. Accessed at [http://www.eia.doe.gov/pub/pdf/internationalV0484\(2002\).pdf](http://www.eia.doe.gov/pub/pdf/internationalV0484(2002).pdf) on November 21, 2005.

- USDOE (U.S. Department of Energy). 2004. Energy Information Administration. Annual Energy Outlook 2004 with Projections to 2025. DOE/EIS-0383, Washington, DC.
- USDOE (U.S. Department of Energy). 2006a. Energy Efficiency and Renewable Energy, EERE State Partnerships and Activities. Accessed at http://www.eere.energy.gov/states/state_news_detail.cfm/news_id=10056/state=NH?print on June 7, 2006.
- USDOE (U.S. Department of Energy). 2006b. U.S. Wind Energy Resource Map. Accessed at http://www1.eere.energy.gov/windandhydro/wind_potential.html on July 11, 2006.
- USDOI (U.S. Department of Interior). 2006. Minerals Management Service, Federal Register Notice of intent to prepare an Environmental Impact Statement (EIS), invitation for participation by cooperating agencies, and scoping period, Outer Continental Shelf, Headquarters, Long Island Offshore Wind Park Development, FR117-71, pg. 35293, June 19, 2006.
- USEPA (U.S. Environmental Protection Agency). 1998. Air Pollutant Emission Factors. Vol. 1, Stationary Point Sources and Area Sources. Section 1.1, Bituminous and Subbituminous Coal Combustion. AP-42. September 1998. Accessed at <http://www.epa.gov/ttn/chief/ap42/ch01/index.html> on July 10, 2006.
- USEPA (U.S. Environmental Protection Agency). 2000. Air Pollutant Emission Factors. Vol. 1, Stationary Point Sources and Area Sources, Section 3.1, Stationary Gas Turbines for Electricity Generation, AP-42, April 2000. Accessed at <http://www.epa.gov/ttn/chief/ap42/ch03>.
- USEPA (U.S. Environmental Protection Agency). 2005. Title VI Energy Policy Act of 2005. Accessed at http://www.epa.gov/OUST/fedlaws/publ_109-058.pdf on July 8, 2006.
- WTE (Waste-To-Energy). Integrated Waste Services Association. 2004. About Waste to Energy. Accessed at <http://www.wte.org/waste.html> on July 6, 2006.

9.0 STATUS OF COMPLIANCE

9.1 Requirement [10 CFR 51.45(d)]

"The environmental report shall list all Federal permits, licenses, approvals, and other entitlements which must be obtained in connection with the proposed action and shall describe the status of compliance with these requirements. The environmental report shall also include a discussion of the status of compliance with applicable environmental quality standards and requirements including, but not limited to, applicable zoning and land-use regulations, and thermal and other water pollution limitations or requirements which have been imposed by Federal, State, regional, and local agencies having responsibility for environmental protection. The discussion of alternatives in the report shall include a discussion of whether the alternatives will comply with such applicable environmental quality standards and requirements."

9.2 Environmental Permits

[Table 9-1](#) provides a list of the environmental permits held by IP2 and IP3 and the compliance status of these permits. These permits will be in place as appropriate throughout the period of extended operation given their respective renewal schedules. In addition, [Table 9-2](#) lists environmental consultations related to the renewal of the IP2 and IP3 Operating Licenses.

9.3 Coastal Zone Management Program Compliance

The Federal Coastal Zone Management Act (16 USC 1451 et seq.) imposes requirements on applicants for a federal license to conduct an activity that could affect a state's coastal zone. The Act requires the applicant to certify to the licensing agency that the proposed activity would be consistent with the state's federally approved coastal zone management program (16 USC 1456(c)(3)(A)). The National Oceanic and Atmospheric Administration has promulgated implementing regulations that indicate that the requirement is applicable to renewal of federal licenses for activities not previously reviewed by the state (15 CFR 930.51(b)(1)). The regulation requires that the license applicant provide its certification to the federal licensing agency and a copy to the applicable state agency (15 CFR 930.57(a)).

The NRC's office of Nuclear Reactor Regulation has issued guidance to its staff regarding compliance with the Act. This guidance acknowledges that New York has an approved coastal zone management program [[NRC 2004](#)]. The IP2 and IP3 site, located in Westchester County, is within the New York coastal zone.

The NRC is expected to issue the draft SEIS for IP2 and IP3 in early 2008. At that time, Entergy will submit an application for a Coastal Zone Consistency Certification (see [Attachment D](#)) to the NYSDOS which will include a copy of the License Renewal Application for IP2 and IP3 and a copy of the draft SEIS in fulfillment of the regulatory requirement for submitting a copy of the coastal zone consistency certification to the appropriate state agency.

9.4 Water Quality (401) Certification

Federal CWA, Section 401, requires an applicant for a federal license to conduct an activity that might result in a discharge into navigable waters to provide the licensing agency a certification from the state that the discharge will comply with applicable CWA requirements (33 USC 1341). The NYSDEC issued a Section 401 State Water Quality Certification for IP1 and IP2 on December 7, 1970 and IP3 on May 2, 1975 (provided in [Attachment C](#)). The NRC has indicated in its GEIS that issuance of an NPDES permit implies continued certification by the state [NRC 1996, Section 4.2.1.1]. The EPA granted New York State the authority to issue NPDES permits under its own program, the New York State SPDES program. [Attachment C](#) contains the SPDES permit that authorizes plant discharges at IP2 and IP3. Consistent with the GEIS, Entergy is providing a copy of its SPDES permit as evidence of a state water quality (401) certification.

NYSDEC has taken the position that it will require submission of an application for a new state water quality (401) certification in conjunction with the license renewal application, rather than relying on the SPDES permit as evidence of continued certification [[Merchant](#)]. To initiate the approval process, Entergy will file the Joint Application for Permit with the NYSDEC for the water quality certification at a date determined by the NYSDEC.

As identified in [Table 9-1](#), the SPDES permit for discharges at the site expired on October 1, 1992. However in accordance with the New York State Administrative Procedures Act, Entergy filed a timely SPDES permit renewal application 180 days prior to the current permit's expiration date on April 3, 1992. Therefore, the SPDES permit has been administratively continued.

9.5 Environmental Permits—Discussion of Compliance

General

IP2 and IP3 have established control measures in place to ensure compliance with its environmental permits, including monitoring, reporting, and operating within specified limits. Chemistry personnel are primarily responsible for monitoring and ensuring that the site complies with its environmental permits and applicable regulations. Sampling results are submitted to appropriate agencies.

Water Quality

As identified in [Table 9-1](#), the SPDES permit (NY-0004472) for discharges at the site expired on October 1, 1992. However, in accordance with the New York State Administrative Procedures Act, Entergy filed a timely SPDES permit renewal application 180 days prior to the current permit's expiration date on April 3, 1992. Therefore, the SPDES permit has been administratively continued. Compliance with the SPDES Permits over previous years has been excellent. For example, there has never even been an exceedance relative to thermal discharge limits as identified in the Station's SPDES permit. In addition, compliance with the other SPDES permits listed in [Table 9-1](#) has been favorable over the last three years (2004-2006), with any deviations or potential violations properly addressed and reported in accordance with either the conditions outlined in the permit or as recommended by the regulatory agency.

Potable water for the site is supplied by the Village of Buchanan. Sanitary wastewaters from all plant locations are transferred to the Village of Buchanan publicly owned treatment works (POTW) system where it is managed appropriately, except for a few isolated areas which have their own septic tanks which are pumped out by a septic company, as needed, and taken to an offsite facility for appropriate management. Although sanitary wastewaters at the site are nonradioactive, a radiation monitoring system is provided to continuously monitor the effluent from the protected area.

The EPA's Oil Pollution Prevention Rule became effective January 10, 1974 and was published under the authority of Section 311(j)(1)(C) of the Federal Water Pollution Control Act (Clean Water Act). The regulation has been published in 40 CFR 112 and facilities subject to the rule must prepare and implement a Spill Prevention, Control, and Countermeasure (SPCC) Plan to prevent any discharge of oil into or upon navigable waters of the United States or adjoining shorelines. IP2 and IP3 are subject to this rule and have written SPCC Plans that identify and describe the procedures, materials, equipment and facilities that are utilized at the stations to minimize the frequency and severity of oil spills in order to meet the requirements of this rule.

Due to a variety of historical operational events, there have been a number of instances where petroleum contamination has been detected in the groundwater. As a result of these events, IP2 and IP3 implemented corrective action and monitoring programs in coordination with the NYSDEC. Based on the results of these programs, NYSDEC has determined that no additional actions are necessary at this time.

Air Quality

The station has permits to operate boilers, emergency diesel generators, gas turbines, and vapor extractors as shown in [Table 9-1](#). Operation of these air emission sources is maintained within the operating limits established in the station's Air Permits, issued by NYSDEC and Westchester County Department of Health. For purposes of the Clean Air Act, IP2 and IP3 are considered minor air emission sources and are reflected as such in the air permits.

Solid Waste

As a generator of both low-level and high-level radioactive wastes, IP2 and IP3 are subject to and comply with provisions and requirements of the Low-Level Radioactive Waste Policy Amendment Act of 1985 and the Nuclear Waste Policy Act of 1982, as subsequently amended, and the Nuclear Waste Policy Act of 1982.

IP2 and IP3 occasionally generate both hazardous and mixed wastes. Therefore, they are subject to and comply with the provisions of the Resource Conservation and Recovery Act and amendments, as well as the NYSDEC regulatory requirements as set forth in 6 NYCRR Parts 371-376.

Although the EPA final Hazardous and Solid Waste Act Permits for IP2 and IP3 for accumulation and temporary onsite storage of mixed waste for greater than 90 days have expired, these permits have been administratively extended by letter. IP2 and IP3 are currently operating under

the conditional exemption for low-level mixed waste storage and disposal per 6 NYCRR Part 374-1.9. IP3's NYSDEC Part 373 Permit for the storage of mixed waste (NYD095503746) was allowed to expire in September 2006, and Entergy has requested that NYSDEC terminate the IP2 Hazardous Waste Part 373 Permit NYD991304411 upon its scheduled expiration date of February 27, 2007. However, NYSDEC has indicated that it is considering converting the Hazardous Waste Part 373 Permit into a Corrective Action Permit relative to the current groundwater investigation program. Since Entergy submitted a permit renewal application in the form of a request for a Corrective Action Permit at NYSDEC's direction, the Hazardous Waste Part 373 Permit has been administratively continued and the Corrective Action Permit Application is currently under review. Although some radioactive solvent wastes are being accumulated in a satellite area, no mixed wastes are currently being stored on-site at IP3. At IP2, various crates, high-integrity containers, and 55-gallon drums containing PCB mixed wastes are being stored in Unit 1 until such time as the radioactive waste processing vendor can obtain the necessary permits and approvals to accept these wastes.

Emergency Planning and Community Right-to-Know

IP2 and IP3 comply with the Emergency Planning and Community Right-to-Know Act that requires the submittal of an emergency and hazardous chemical inventory report (Tier II) to the Local Emergency Planning Commission, the State Emergency Response Commission, and the local fire department. These reports are submitted to these agencies annually. However, IP2 and IP3 are not subject to the Risk Management Plan (RMP) requirements described in 40 CFR 68 since no threshold quantities of a regulated substance are exceeded.

Hazardous Materials

There are several stationary bulk petroleum and chemical storage tanks located on-site. The IP2 and IP3 stationary bulk chemical storage tanks are registered with the NYSDEC via Hazardous Substance Bulk Storage Registration Certificates, and management of bulk chemicals is in accordance with the Chemical Spill Plans required under NYSDEC's Chemical Bulk Storage Regulations. Bulk petroleum storage tanks for IP2 are registered with NYSDEC via the Major Oil Storage Facility License and for IP3 are registered with the Westchester County Department of Health via the Petroleum Bulk Storage Registration Certificate (refer to [Table 9-1](#)). In addition, the IP2 and IP3 Spill Prevention, Control and Countermeasures Plans also include all bulk oil storage tanks, including oil-filled operational and electrical equipment located on-site.

Herbicide and pesticide usage occurs periodically at the site. Herbicides utilized for weed control and pesticides utilized for control of insects such as wasps, is hand-applied by vendors via sprayers. Sodium hypochlorite which is injected by station personnel into plant systems for chlorination purposes is also listed as a pesticide under New York State law. In accordance with NYSDEC 6 NYCRR Part 325, sodium hypochlorite usage at the site is controlled in accordance with IP2 Pesticide Application Business Registration 12696 and IP3 Pesticide Application Business Registration 13163. Vendor application of other herbicides and pesticides is also managed in accordance with 6 NYCRR Part 325.

The Toxic Substances Control Act (TSCA) of 1976 regulates polychlorinated biphenyls (PCBs) and asbestos, both of which are present at IP2 and IP3. Entergy is in compliance with the PCB and asbestos regulations applicable to the IP2 and IP3 facilities.

IP2 and IP3 are also subject to the hazardous substance release and reporting provisions of the Comprehensive Environmental Response, Compensation, and Liability Act (CERCLA) of 1980, as subsequently amended. Any release of reportable quantities of listed hazardous substances to the environment requires a report to the National Response Center and subsequent written follow-up. IP2 and IP3 are also subject to hazardous material release reporting requirements of New York State in accordance with the NYSDEC's Petroleum Bulk Storage and Chemical Bulk Storage program requirements in accordance with New York State's Environmental Conservation Law Articles 17 and 40 and 6 NYCRR Parts 595 and 613.

Herbicide and pesticide usage occurs periodically at the site. Herbicides utilized for weed control and pesticides utilized for control of insects such as wasps, is hand-applied by vendors via sprayers. Sodium hypochlorite which is injected by station personnel into plant systems for chlorination purposes is also listed as a pesticide under New York State law. In accordance with NYSDEC 6 NYCRR Part 325, sodium hypochlorite usage at the site is controlled in accordance with IP2 Pesticide Application Business Registration 12696 and IP3 Pesticide Application Business Registration 13163. Vendor application of other herbicides and pesticides is also managed in accordance with 6 NYCRR Part 325.

The Toxic Substances Control Act (TSCA) of 1976 regulates polychlorinated biphenyls (PCBs) and asbestos, both of which are present at IP2 and IP3. In New York State, PCBs are also regulated by NYSDEC as a hazardous waste and asbestos management is regulated by the NYS Department of Labor. Entergy is in compliance with the PCB and asbestos regulations applicable to the IP2 and IP3 facilities.

IP2 and IP3 are also subject to the hazardous substance release and reporting provisions of the Comprehensive Environmental Response, Compensation, and Liability Act (CERCLA) of 1980, as subsequently amended. Any release of reportable quantities of listed hazardous substances to the environment requires a report to the National Response Center and subsequent written follow-up. IP2 and IP3 are also subject to hazardous material release reporting requirements of New York State in accordance with the NYSDEC's Petroleum Bulk Storage and Chemical Bulk Storage program requirements in accordance with New York State's Environmental Conservation Law Articles 17 and 40 and 6 NYCRR Parts 595 and 613.

Biological

Potential impacts on federal- and state-listed species were considered in Entergy's review and analysis and impacts determined to be SMALL. However, per Section 7 of the Endangered Species Act, a more structured consultation process with the USFWS and NMFS will be initiated by the NRC. In addition, the consultation requirements of Section 305(b) of the Magnuson-Stevens Fishery Conservation and Management Act, as amended by the National Marine Fisheries Service Sustainable Fisheries Act of 1996, provide that Federal agencies must consult with the Secretary of Commerce on all actions or proposed actions authorized, funded, or

undertaken by the agency that may adversely affect essential fish habitat. Therefore, the NRC staff will also initiate an essential fish habitat consultation with the NMFS.

Zoning Related Codes (Village of Buchanan, New York)

The 239 acres occupied by the Indian Point site lie entirely within the Village of Buchanan corporate limits. As such, the zoning codes such as those related to construction, wetlands and noise that are applicable to IP2 and IP3 are defined in the Village of Buchanan Village Zoning Code. The Indian Point site is currently in compliance with the applicable Village of Buchanan zoning codes.

Wetlands

As discussed in Section 2.4 of this ER, there are no state or federal jurisdictional wetlands on the site. However, the Village of Buchanan has a wetland's law (Chapter 203) that requires a permit prior to conducting certain activities upon any wetland, water body or watercourse or within a hundred (100) feet of the boundary of any wetland, water body or watercourse. The site is subject to this law and complies with the requirements when site activities as defined in the law occur.

Noise

As discussed in Section 2.1 of this ER, the Village of Buchanan has a sound ordinance (Chapter 211 - 223 of the Village Zoning Code) that limits allowable sound levels from a facility by octave band levels and is applicable at the property line of the sound generating facility. Although noise is detectable off-site, IP2 and IP3 are in compliance with this sound ordinance.

Air Navigation

Coordination with the Federal Aviation Administration (FAA) is required when it becomes necessary to ensure that the highest structures associated with the project do not impair the safety of aviation. Submission of a letter of notification (with accompanying maps and project description) to the FAA would result in a written response from the FAA certifying that no hazard exists or recommending project changes and/or the installation of warning devices such as lighting.

The site elevation is dominated by the 334-foot high IP1 superheater stack and 400-foot high primary meteorological tower, which are equipped with FAA lighting systems. There are no plans at this time to build any new structures during the license renewal periods; therefore, no new notifications to the FAA are required.

Health and Safety

The federal Occupational Safety and Health Administration (OSHA) governs the occupational safety and health of the construction workers and the operational staffs. These requirements are incorporated into the sites occupational health and safety practices. Entergy complies with

OSHA requirements and as discussed in Section 4.13.5 of this ER, Entergy complies with requirements of the NESC.

Environmental Reviews

Entergy has fleet procedural controls in place to ensure that environmentally sensitive areas, if present, are adequately protected during site operations and project planning [Entergy]. These controls, which encompass nonradiological program areas such as air, stormwater, SPDES, spill prevention, and waste, consist of the following:

- required review and documentation process prior to engaging in additional construction or operational activities that may result in an environmental impact or change conditions set forth in an existing permit, and
- required review for protection of either existing or potentially existing cultural resources.

These measures ensure that appropriate local, state, and/or federal permits are obtained or modified as necessary, that cultural resources and threatened and endangered species are protected if present, and that other regulatory issues are adequately addressed if necessary.

**Table 9-1
 IP2 and IP3 Environmental Permits and Compliance Status**

Agency	Authority	Requirement	Number	Expiration Date	Authorized Activity
NRC	Atomic Energy Act, 10 CFR 50	IP1 License to Possess	DPR-5	September 28, 2013	Maintain IP1 in SAFSTOR condition.
NRC	Atomic Energy Act, 10 CFR 50	IP2 License to Operate	DPR-26	September 28, 2013	Operation of IP2.
NRC	Atomic Energy Act, 10 CFR 50	IP3 License to Operate	DPR-64	December 12, 2015	Operation of IP3.
DOT	49 CFR 107, Subpart G	IP2 DOT Hazardous Materials Certificate of Registration	0627065520610Q	June 30, 2009	Radioactive and hazardous materials shipments.
DOT	49 CFR 107, Subpart G	IP3 DOT Hazardous Materials Certificate of Registration	0627065520690Q	June 30, 2009	Radioactive and hazardous materials shipments.
NYSDEC	6 NYCRR Part 325	IP2 Pesticide Application Business Registration	12696	April 30, 2009	Pesticide application.
NYSDEC	6 NYCRR Part 325	IP3 Pesticide Application Business Registration	13163	April 30, 2009	Pesticide application.
NYSDEC	6 NYCRR Parts 704 and 750	IP1, 2, and 3 SPDES Permit	NY 000 4472	October 1, 1992 ¹	Discharge of wastewaters and stormwaters to waters of the State.
NYSDEC	6 NYCRR Part 704	Simulator Transformer Vault SPDES Permit	NY 025 0414	March 1, 2008	Discharge of wastewaters to waters of the State.
NYSDEC	6 NYCRR Part 704	Tank Farm SPDES Permit	NY 025 1135	February 1, 2010	Discharge of wastewaters to waters of the State.

Table 9-1 (Continued)
IP2 and IP3 Environmental Permits and Compliance Status

Agency	Authority	Requirement	Number	Expiration Date	Authorized Activity
NYSDEC	6 NYCRR Part 704	Buchanan Gas Turbine SPDES Permit	NY 022 4826	March 1, 2008	Discharge of wastewaters to waters of the State.
NYSDEC	6 NYCRR Part 750	ISFSI Stormwater SPDES General Permit for Construction Activities	NYR 10H166	Not Applicable	Stormwater Discharge during Construction of the Dry Fuel Cask Storage.
NYSDEC	6 NYCRR Parts 200 and 201	IP2 Air Permit	3-5522-00011/00026	Not Applicable	Operation of air emission sources (boilers, turbines, and generators).
NYSDEC	6 NYCRR Parts 200 and 201	IP3 Air Permit	3/5522-00105/00009	Not Applicable	Operation of air emission sources (boilers, turbines, and generators).
WCDOH	Chapter 873, Article XIII, Section 873.1306.1 of the Laws of Westchester County	IP2 Gas Turbine 1 Air Permit	#00021	December 31, 2006 ²	Operation of an air contamination source
WCDOH	Chapter 873, Article XIII, Section 873.1306.1 of the Laws of Westchester County	IP2 Gas Turbine 2 Air Permit	#00022	December 31, 2006 ²	Operation of an air contamination source
WCDOH	Chapter 873, Article XIII, Section 873.1306.1 of the Laws of Westchester County	IP2 Gas Turbine 3 Air Permit	#00023	December 31, 2006 ²	Operation of an air contamination source

Table 9-1 (Continued)
IP2 and IP3 Environmental Permits and Compliance Status

Agency	Authority	Requirement	Number	Expiration Date	Authorized Activity
WCDOH	Chapter 873, Article XIII, Section 873.1306.1 of the Laws of Westchester County	IP2 Boiler Permit	52-4493	Not Applicable	Operation of an air contamination source
WCDOH	Chapter 873, Article XIII, Section 873.1306.1 of the Laws of Westchester County	IP2 Vapor Extractor Air Permit	52-5682	December 31, 2006 ²	Operation of an air contamination source
WCDOH	Chapter 873, Article XIII, Section 873.1306.1 of the Laws of Westchester County	IP3 Boiler Permit	52-6497	Not Applicable	Operation of an air contamination source
WCDOH	Chapter 873, Article XIII, Section 873.1306.1 of the Laws of Westchester County	IP3 Training Center Boiler Permit	52-6498	Not Applicable	Operation of an air contamination source
WCDOH	Chapter 873, Article XIII, Section 873.1306.1 of the Laws of Westchester County	IP3 Vapor Extractor Air Permit	-- ³	-- ³	Operation of an air contamination source
NYSDEC	6 NYCRR Part 596	IP2 Hazardous Substance Bulk Storage Registration Certificate	3-000107	September 4, 2007	Onsite bulk storage of hazardous substances.
NYSDEC	6 NYCRR Part 596	IP3 Hazardous Substance Bulk Storage Registration Certificate	3-000071	August 16, 2008	Onsite bulk storage of hazardous substances.

Table 9-1 (Continued)
IP2 and IP3 Environmental Permits and Compliance Status

Agency	Authority	Requirement	Number	Expiration Date	Authorized Activity
NYSDEC	6 NYCRR Part 610	IP2 Major Oil Storage Facility	3-2140	-- ¹	Onsite bulk storage of > 400K gallons of petroleum products.
WCDOH	Westchester County Sanitary Code, Article XXV	IP3 Petroleum Bulk Storage Registration Certificate	3-166367	September 7, 2010	Onsite bulk storage of petroleum products.
NYSDEC	6 NYCRR Part 372	IP2 Hazardous Waste Generator Identification	NYD000765073	Not Applicable	Hazardous waste generation
NYSDEC	6 NYCRR Part 372	IP3 Hazardous Waste Generator Identification	NYD000765073	Not Applicable	Hazardous waste generation
NYSDEC	6 NYCRR Part 373	IP2 Hazardous Waste Part 373 Permit	NYD991304411	February 28, 2007 ¹	Accumulation and temporary onsite storage of mixed waste for > 90 days.
EPA	40 CFR 264	IP2 Hazardous Solid Waste Amendment Permit	NYD991304411	October 14, 2002 ⁴	Accumulation and temporary onsite storage of mixed waste for > 90 days.
EPA	40 CFR 264	IP3 Hazardous Solid Waste Amendment Permit	NYD085503746	October 17, 2001 ⁴	Accumulation and temporary onsite storage of mixed waste for > 90 days.
SCDHEC	Act No. 429 of 1980, South Carolina Radioactive Waste Transportation and Disposal Act	IP2 Radioactive Waste Transport Permit	0019-31-07	December 31, 2007	Transportation of radioactive waste into the State of South Carolina
		IP3 Radioactive Waste Transport Permit	0072-31-07	December 31, 2007	

Table 9-1 (Continued)
IP2 and IP3 Environmental Permits and Compliance Status

Agency	Authority	Requirement	Number	Expiration Date	Authorized Activity
TDEC	Tennessee Department of Environment and Conservation Regulations	IP2 Radioactive Waste-License-for-Delivery	T-NY-010-L07	December 31, 2007	Shipment of radioactive material into Tennessee to a disposal/processing facility
		IP3 Radioactive Waste-License-for-Delivery	T-NY-005-L07	December 31, 2007	
DOT: U.S. Department of Transportation EPA: Environmental Protection Agency NRC: U.S. Nuclear Regulatory Commission NYSDEC: New York State Department of Environmental Conservation SCDHEC: South Carolina Department of Health and Environmental Control TDEC: Tennessee Department of Environment and Conservation (Division of Radiological Health) WCDOH: Westchester County Department of Health					

1. Timely renewal application was submitted; therefore, permit is administratively continued under New York State Administrative Procedures Act.
2. Timely renewal application was submitted; therefore permit is administratively continued by WCDOH.
3. Application has been submitted to WCDOH, but a permit has not yet been issued.
4. Permit has been administratively continued based on conditional mixed waste exemption.

**Table 9-2
 Environmental Consultations Related to License Renewal**

Agency	Authority	Activity Covered
U.S. Fish and Wildlife Service and National Marine Fisheries Service	Endangered Species Act Section 7 (16 USC 1636)	Requires federal agency issuing a license to consult with USFWS and NMFS.
New York Natural Heritage Program	Endangered Species Act Section 7 (16 USC 1636)	Requires federal agency issuing a license to consult with the fish and wildlife agency at the state level.
New York State Office of Parks, Recreation, and Historic Preservation	National Historic Preservation Act Section 106	Requires federal agency issuing a license to consider cultural impacts and consult with SHPO.
New York State Department of State	Federal Coastal Zone Management Act (16 USC 1451 et seq.)	Requires an applicant to provide certification to the federal agency issuing the license that license renewal would be consistent with the federally-approved state coastal zone management program.
New York State Department of Environmental Conservation	Clean Water Act, Section 401 (33 USC 1341)	Requires New York State certification that discharge would comply with state water quality standards

9.6 References

Entergy. 2006. EN-EV-115, Environmental Reviews and Evaluations.

Merchant, K. 2002. New York State Department of Environmental Conservation, Memorandum from K. Merchant, New York State Department of Environmental Conservation to NYSDEC RG&E Ginna Group, dated September 17, 2002.

NRC (U.S. Nuclear Regulatory Commission). 1996. NUREG-1437, Generic Environmental Statement for License Renewal of Nuclear Power Plants, Final Report, May 1996.

NRC (U.S. Nuclear Regulatory Commission). 2004. Procedural Guidance for Preparing Environmental Assessments and Considering Environmental Issues. NRR Office Instruction No. LIC-203, Revision 1.