Dominion Nuclear Connecticut, Inc.

Millstone Power Station Rope Ferry Road Waterford, CT 06385

U.S. Nuclear Regulatory Commission Attention: Document Control Desk

Washington, DC 20555



APR 2 3 2007

Serial No. 07-0245 MPS Lic/GJC R0

Docket Nos. 50-245

50-336

50-423 License Nos. DPR-21

DPR-65

NPF-49

DOMINION NUCLEAR CONNECTICUT, INC. MILLSTONE POWER STATION UNITS 1, 2, AND 3 2006 ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

This letter transmits the Annual Radiological Environmental Operating Report for the Millstone Power Station, for the period January 2006 through December 2006. This satisfies the provisions of Section 5.7.2 of Millstone Power Station Unit 1 Permanently Defueled Technical Specifications (PDTS), and Sections 6.9.1.6a and 6.9.1.3 of the Millstone Power Station Units 2 and 3 Technical Specifications, respectively.

If you have any questions or require additional information, please contact Mr. David W. Dodson at (860) 447-1791, extension 2346.

Very truly yours,

Site Vice President - Millstone

IE25 MMS801 Attachments:

1

Commitments made in this letter: None.

cc: U.S. Nuclear Regulatory Commission Region I 475 Allendale Road King of Prussia, PA 19406-1415

Mr. J. A. Golla
Project Manager Millstone Unit 1
U.S. Nuclear Regulatory Commission
Mail Stop 012H2
One White Flint North
11555 Rockville Pike
Rockville, MD 20852-2738

Mr. R. J. Prince NRC Inspector U.S. Nuclear Regulatory Commission Region I 475 Allendale Road King of Prussia, PA 19406-1415

Mr. V. Nerses Senior Project Manager U.S. Nuclear Regulatory Commission One White Flint North 11555 Rockville Pike Mail Stop 8C2 Rockville, MD 20852-2738

Mr. S. M. Schneider NRC Senior Resident Inspector Millstone Power Station

Serial No. 07-0245 2006 Annual Radiological Environmental Operating Report Page 3 of 3

(2copies)
Director
Bureau of Air Management
Monitoring & Radiation Division
Department of Environmental Protection
79 Elm Street
Hartford, CT 06106-5127

Serial No. 07-0245 Docket Nos. 50-245

50-336

50-423 License Nos. DPR-21

DPR-65

NPF-49

ATTACHMENT 1

2006 ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

MILLSTONE POWER STATION UNITS 1, 2, AND 3 DOMINION NUCLEAR CONNECTICUT, INC. (DNC)

Millstone Power Station

2006

Radiological Environmental Operating Report

January 1, 2006 – December 31, 2006



Dominion Nuclear Connecticut, Inc.

Unit	License	Docket
1	DPR-21	50-245
2	DPR-65	50-336
3	NPF-49	50-423



ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

MILLSTONE POWER STATION

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

2006


MILLSTONE UNIT 1, DOCKET NO. 50-245 MILLSTONE UNIT 2, DOCKET NO. 50-336 MILLSTONE UNIT 3, DOCKET NO. 50-423

By the

Dominion Nuclear Connecticut, Inc. Waterford, Connecticut

~ TABLE OF CONTENTS ~

EXE	ECUTI	VE SUMMARYi
1.	INTF	RODUCTION1-1
	1.1	Overview 1-1
	1.2	Radiation and Radioactivity1-1
	1.3	Sources of Radiation1-2
	1.4	Nuclear Reactor Operations1-3
	1.5	Radioactive Effluent Control 1-8
	1.6	Radiological Impact on Humans 1-11
2.	PRO	GRAM DESCRIPTION2-1
	2.1	Sampling Schedule and Locations2-1
	2.2	Samples Collected During Report Period2-7
3.	RADI	OCHEMICAL RESULTS3-1
	3.1	Summary Table
	3.2	Data Tables
4.	DISC	USSION OF RESULTS4-1
	4.1	Gamma Exposure Rate (Table 1)4-1
	4.2	Air Particulate Gross Beta Radioactivity (Table 2)4-3
	4.3	Airborne Iodine (Table 3)4-3
	4.4	Air Particulate Gamma (Table 4A-D)
	4.5	Air Particulate Strontium (Table 5)4-5
	4.6	Soil (Table 6)
	4.7	Cow Milk (Table 7)4-5
	4.8	Goat Milk (Table 8)
	4.9	Pasture Grass and Feed (Table 9)
	4.10	
	4.11	(
		Fruits and Vegetables (Table 12)
		Broad Leaf Vegetation (Table 13)
		Seawater (Table 14)
	4 15	Bottom Sediment (Table 15)
		Aquatic Flora (Table 16)
		Fish (Tables 17A and 17B) 4-10
	7.17	4.17.1 Flounder (Table 17A)
		4.17.2 Fish - Other (Table 17B)
	<i>1</i> 18	Mussels (Table 18)
		Oysters (Table 19)
		Clams (Table 20) 4-12
		· · · · · · · · · · · · · · · · · · ·
		Scallops (Table 21)
_		Lobsters (Table 22)4-12
5.		SITE DOSE EQUIVALENT COMMITMENTS
6.		USSION
7.	KEF	FRENCES
۸	> \	V.A. LAND HOE OFNOLIO FOR 2000
		X A - LAND USE CENSUS FOR 2006
		X B - DNC QA PROGRAMB-1 X C - SUMMARY OF INTERLABORATORY COMPARISONS
		ハ ∪ = OOIVIIVIAN OF INTENEADONATOR OOIVIEARIOUNO

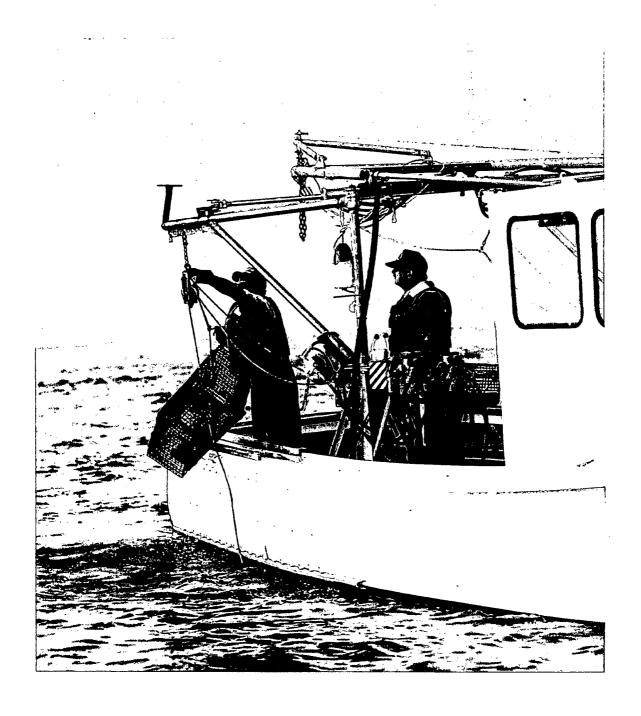

EXECUTIVE SUMMARY

INTRODUCTION

This report summarizes the results of the Radiological Environmental Monitoring Program (REMP) conducted in the vicinity of Millstone Power Station (MPS) during the period from January 1 to December 31, 2006. This document has been prepared in accordance with the requirements of Millstone Unit 2 and 3 Technical Specifications.

The REMP has been established to monitor the radiation and radioactivity released to the environment as a result of Millstone Station's operation. This program, initiated in April 1967, includes the collection, analysis, and evaluation of radiological data in order to assess the impact of Millstone Station on the environment and on the general public.

SAMPLING AND ANALYSIS

The environmental sampling media collected in the vicinity of MPS and at distant locations included air particulate filters, charcoal cartridges, soil, goat milk, pasture grass, hay, well water, broadleaf vegetation, fruits, vegetables, seawater, bottom sediment, aquatic flora, fish, mussels, oysters, clams and lobster.

During 2006, there were 1094 samples collected from the atmospheric, aquatic, and terrestrial environments. In addition, 175 exposure measurements were obtained using environmental thermoluminescent dosimeters (TLDs).

A small number of inadvertent issues were encountered in 2006 in the collection of environmental samples in accordance with the Millstone Radiological Effluent Monitoring and Offsite Dose Calculation Manual (REMODCM). One of 160 required TLDs was unaccounted for during the quarterly retrieval process. The pole to which the missing TLD was attached was removed by CL&P and could not be found. Additional TLDs were collected to provide the information to assess ambient radiation levels in the vicinity of Millstone Station. Equipment failures and power outages resulted in a small number of instances in which lower than normal sampling volumes were collected at the airborne monitioring stations. In no cases were sampling outages of a duration to not yield a sample. All 416 air particulate and charcoal cartridges were collected and analyzed as required. A full description of all discrepancies encountered with the environmental monitoring program is presented in the Notes for the Data Tables of this report.

There were 1340 analyses performed on the environmental media samples. The AREVA-NP Environmental Laboratory of Westboro, MA, performed these analyses. Samples were analyzed as required by the Millstone REMODCM.

LAND USE CENSUS

The annual land use census in the vicinity of Millstone Station was conducted as required by the Millstone REMODCM between July 15 and December 31, 2006. Although only vegetable gardens having an area of more than 500 square feet need to be identified, due to the difficulty of measuring individual gardens, all gardens identified by a drive-by survey are listed in Appendix A. No new milk or meat animals were located during the census. Millstone also performs monthly broad leaf sampling that may be used in lieu of the garden census.

RADIOLOGICAL IMPACT TO THE ENVIRONMENT

Most samples collected as part of the Millstone REMP continued to contain detectable amounts of naturally-occurring and man-made radioactive materials. No station effects were detected in terrestrial media. Offsite ambient radiation measurements using environmental TLDs beyond the site boundary ranged between 46 and 78 milliRoentgens per year. The range of ambient radiation levels observed with the TLDs is consistent with natural background radiation levels for Connecticut.

Monitoring of the aquatic environment in the area of the discharge indicated the presence of the following station related radionuclides: Cobalt-60, Silver-110m, and Tritium. The predominant radioactivity was from non-plant related sources, such as fallout from nuclear weapons tests and naturally occurring radionuclides.

RADIOLOGICAL IMPACT TO THE GENERAL PUBLIC

During 2006, radiation doses to the general public as a result of Millstone Station's operation continued to be well below the federal limits and much less than the dose due to other sources of man-made (e.g., X-rays, medical) and naturally-occurring (e.g., cosmic, radon) radiation.

The calculated total body dose to the maximally exposed member of the general public from radioactive effluents and ambient radiation resulting from MPS operations for 2006 was about 0.24 mrem for the year. This conservative estimate is well below the EPA's annual dose limit to any member of the general public and is a fraction of a percent of the typical dose received from natural and man-made radiation.

CONCLUSIONS

The 2006 Radiological Environmental Monitoring Program for Millstone Station resulted in the collection and analysis of over a thousand environmental samples and measurements. The data obtained were used to determine the impact of Millstone Station's operation on the environment and on the general public.

An evaluation of direct radiation measurements, environmental sample analyses, and dose calculations indicates all applicable federal criteria were met. Furthermore, radiation levels and resulting doses were a small fraction of those attributed to natural and man-made background radiation.

Based on this information, there is no significant radiological impact on the environment or on the general public due to Millstone Station's operation.

1. INTRODUCTION

This section provides an overview of the Millstone Power Station Radiological Environmental Monitoring Program. It also includes background information to allow a reader to have an informed understanding of radiation and nuclear power operation.

1.1 Overview

The Radiological Environmental Monitoring Program for 2006 performed by Dominion Nuclear Company for Millstone Nuclear Power Station (MPS) is discussed in this report. Since the operation of a nuclear power plant results in the release of small amounts of radioactivity and low levels of radiation, the Nuclear Regulatory Commission (NRC) requires a program to be established to monitor radiation and radioactivity in the environment (Reference 1). This report, published annually per Millstone Station's Technical Specifications (section 6.9.1.6 for Unit 2 and Section 6.9.1.3 for Unit 3), summarizes the results of measurements of radiation and radioactivity in the environment in the vicinity of the Millstone Station and at distant locations during the period January 1 to December 31, 2006.

The Radiological Environmental Monitoring Program consists of taking radiation measurements and collecting samples from the environment, analyzing them for radioactivity content, and interpreting the results. With emphasis on the critical radiation exposure pathways to humans, samples from the aquatic, atmospheric, and terrestrial environments are collected. These samples include, but are not limited to: air, soil, goat milk, pasture grass, hay, well water, broadleaf vegetation, fruits, vegetables, seawater, bottom sediment, aquatic flora, fish, mussels, oysters, clams and lobster. Thermoluminescent dosimeters (TLDs) are placed in the environment to measure gamma radiation levels. The TLDs are processed and the environmental samples are analyzed to measure the very low levels of radiation and radioactivity present in the environment as a result of MPS operation and other natural and man-made sources. These results are reviewed by MPS's radiological staff and have been reported semiannually or annually to the Nuclear Regulatory Commission and others for over 30 years.

In order to more fully understand how a nuclear power plant impacts humans and the environment, background information on radiation and radioactivity, natural and manmade sources of radiation, reactor operations, radioactive effluent controls, and radiological impact on humans is provided. It is believed that this information will assist the reader in understanding the radiological impact on the environment and humans from the operation of Millstone Station.

1.2 Radiation and Radioactivity

All matter is made of atoms. An atom is the smallest part into which matter can be broken down and still maintain all its chemical properties. Nuclear radiation is energy, in the form of waves or particles that is given off by unstable, radioactive atoms.

Radioactive material exists naturally and has always been a part of our environment. The earth's crust, for example, contains radioactive uranium, radium, thorium, and potassium. Some radioactivity is a result of nuclear weapons testing. Examples of radioactive fallout that is normally present in environmental samples are cesium-137 and strontium-90. Some examples of radioactive materials released from a nuclear power plant are cesium-137, iodine-131, strontium-90, and cobalt-60.

Radiation is measured in units of millirem, much like temperature is measured in degrees. A millirem (mrem) is a measure of the biological effect of the energy deposited in tissue. The natural and man-made radiation dose received in one year by the average American is 300 to 400 mrem (References 2, 3, 4,5).

Radioactivity is measured in curies. A curie is that amount of radioactive material needed to produce 37,000,000,000 nuclear disintegrations per second. This is an extremely large amount of radioactivity in comparison to environmental radioactivity. That is why radioactivity in the environment is measured in picocuries. One picocurie (pCi) is equal to one trillionth of a curie.

1.3 Sources of Radiation

As mentioned previously, naturally occurring radioactivity has always been a part of our environment. Table 1.3 shows the sources and doses of radiation from natural and man-made sources.

Table 1.3

Radiation Sources and Corresponding Doses

NATUF	RAL	MAN-MADE			
Source	Radiation Dose (millirem/year)	Source	Radiation Dose (millirem/year)		
Cosmic/cosmogenic	28	Medical/Dental X-Rays	39		
Internal (in the body)	40	Nuclear Medicine	14		
Terrestrial *	16	Consumer Products	10		
Radon/Thoron	200	Weapons Fallout	1		
		Nuclear Power Plants	1		
Approximate Total	284	Approximate Total	60		

^{*} Atlantic and Gulf Costal Plain

Cosmic radiation from the sun and outer space penetrates the earth's atmosphere and continuously bombards us with rays and charged particles. Some of this cosmic radiation interacts with gases and particles in the atmosphere, making them radioactive in turn. These radioactive byproducts from cosmic ray bombardment are referred to as cosmogenic radionuclides. Isotopes such as beryllium-7 and carbon-14 are formed in this way. Exposure to cosmic and cosmogenic sources of radioactivity results in about 30 mrem of radiation dose per year.

Additionally, natural radioactivity is in our body and in the food we eat (about 40 millirem/yr), the ground we walk on (about 30 millirem/yr) and the air we breathe (about 200 millirem/yr). The majority of a person's annual dose results from exposure to radon and thoron in the air we breathe. These gases and their radioactive decay products arise from the decay of naturally occurring uranium, thorium and radium in the soil and building products such as brick, stone, and concrete. Radon and thoron levels vary greatly with location, primarily due to changes in the concentration of uranium and thorium in the soil. Residents at some locations in Colorado, New York, Pennsylvania, New Jersey and even Connecticut have a higher annual dose as a result of higher levels of radon/thoron gases in these areas. In total, these various sources of naturally-occurring radiation and radioactivity contribute to a total dose of about 300 mrem per year.

In addition to natural radiation, we are normally exposed to radiation from a number of man-made sources. The single largest doses from man-made sources result from therapeutic and diagnostic applications of x-rays and radiopharmaceuticals. The annual dose to an individual in the U.S. from medical and dental exposure is about 50 mrem. Consumer products, such as televisions and smoke detectors, contribute about 10 mrem/yr. Much smaller doses result from weapons fallout (less than 1 mrem/yr) and nuclear power plants (less than 1 mrem/yr). Typically, the average person in the United States receives about 60 mrem per year from man-made sources.

1.4 Nuclear Reactor Operations

Millstone Station generates about 2000 megawatts of electricity at full power, which provides approximately one-half of the power consumed in the State of Connecticut. Unit 2 and Unit 3 are pressurized water reactors (Unit 1, which is permanently shutdown, was a boiling water reactor). The nuclear station is located on an approximate 500-acre site about 5 kilometers (three miles) west of New London, CT. Commercial operation of Unit 2 began in December 1975 and Unit 3 in May 1986.

Millstone Station was operational during most of 2006, with the exception of a Unit 2 refueling outage, which was performed between October 7 and November 19. The resulting monthly capacity factors are presented in Table 1.4.

Nuclear-generated electricity is produced by many of the same techniques used for conventional oil and coal-generated electricity. Both systems use heat to boil water to produce steam. The steam turns a turbine, which turns a generator, producing electricity. In both cases, the steam passes through a condenser where it changes back into water and recirculates back through the system. The cooling water source for Millstone Station is the Niantic Bay.

The key difference between nuclear power and conventional power is the source of heat used to boil the water. Conventional plants burn fossil fuels in a boiler, while nuclear plants make use of uranium in a nuclear reactor.

TABLE 1.4

MPS OPERATING CAPACITY FACTOR DURING 2006
(Based on rated reactor thermal power)

Month	Unit 2 Percent Capacity	Unit 3 Percent Capacity
January	99.7%	100.4%
February	88.9%	100.4%
March	99.6%	100.7%
April	70.1%	100.5%
May	99.5%	100.5%
June	99.7%	99.8%
July	99.1%	98.9%
August	98.9%	98.6%
September	99.0%	99.2%
October	18.2%	97.7%
November	35.5%	99.6%
December	99.7%	99.7%
Annual Average	84.0%	99.6%

Inside the reactor, a nuclear reaction called fission takes place. Particles, called neutrons, strike the nucleus of a uranium-235 atom, causing it to split into fragments called radioactive fission products. The splitting of the atoms releases both heat and more neutrons. The newly-released neutrons then collide with and split other uranium atoms, thus making more heat and releasing even more neutrons, and on and on until the uranium fuel is depleted or spent. This process is called a chain reaction.

The operation of a nuclear reactor results in the release of small amounts of radioactivity and low levels of radiation. The radioactivity originates from two major sources, radioactive fission products and radioactive activation products.

Radioactive fission products, as illustrated in Figure 1.4-1 (Reference 6), originate from the fissioning of the nuclear fuel. These fission products get into the reactor coolant from their release by minute amounts of uranium on the outside surfaces of the fuel cladding, by diffusion through the fuel pellets and cladding and, on occasion, through defects or failures in the fuel cladding. These fission products circulate along with the reactor coolant water and will deposit on the internal surfaces of pipes and equipment. The radioactive fission products on the pipes and equipment emit radiation. Examples of some fission products are krypton-85 (Kr-85), strontium-90 (Sr-90), iodine-131 (I-131), xenon-133 (Xe-133), and cesium-137 (Cs-137).

Nuclear Fission

Fission is the splitting of the uranium-235 atom by a neutron to release heat and more neutrons, creating a chain reaction. Radiation and fission products are by-products of the process.

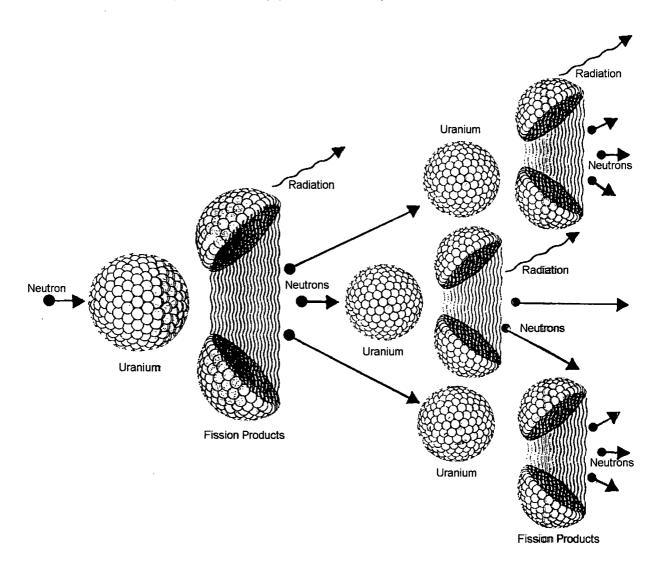


Figure 1.4-1
Radioactive Fission Product Formation

Radioactive activation products (see Figure 1.4-2), on the other hand, originate from two sources. The first is by neutron bombardment of the hydrogen, oxygen and other gas (helium, argon, nitrogen) molecules in the reactor cooling water. The second is a result of the fact that the internals of any piping system or component are subject to minute yet constant corrosion from the reactor cooling water. These minute metallic particles (for example: nickel, iron, cobalt, or magnesium) are transported through the reactor core into the fuel region, where neutrons may react with the nuclei of these particles, producing radioactive products. So, activation products are nothing more than ordinary naturally-occurring atoms that are made unstable or radioactive by neutron bombardment. These activation products circulate along with the reactor coolant water and will deposit on the internal surfaces of pipes and equipment. The radioactive activation products on the pipes and equipment emit radiation. Examples of some activation products are manganese-54 (Mn-54), iron-59 (Fe-59), cobalt-60 (Co-60), and zinc-65 (Zn-65).

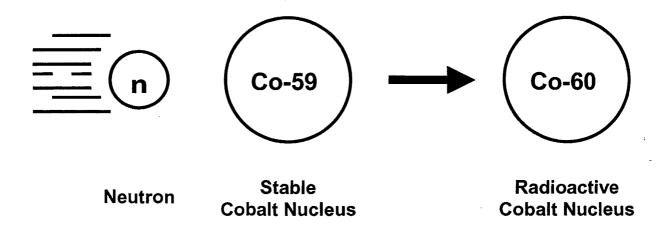


Figure 1.4-2
Radioactive Activation Product Formation

At Millstone Nuclear Power Station there are five independent protective barriers that confine these radioactive materials. These five barriers, which are shown in Figure 1.4-3 (Reference 6), are:

- fuel pellets;
- fuel cladding;
- reactor vessel and piping;
- primary containment and,
- secondary containment (enclosure building).

SIMPLIFIED DIAGRAM OF A PRESSURIZED WATER REACTOR

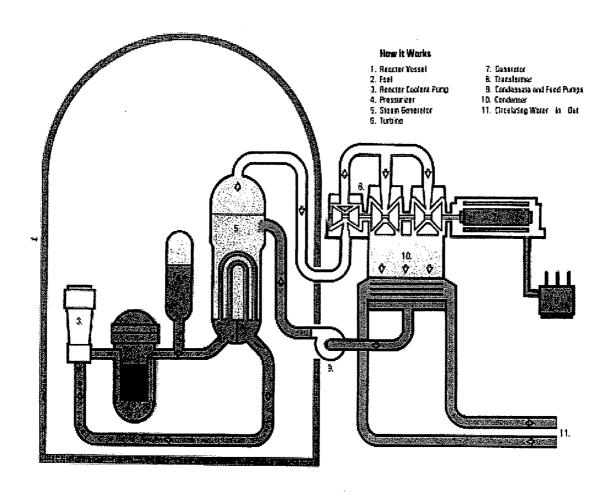


Figure 1.4-3

The ceramic uranium fuel pellets provide the first barrier. Most of the radioactive fission products are either physically trapped or chemically bound between the uranium atoms, where they will remain. However, a few fission products that are volatile or gaseous may diffuse through the fuel pellets into small gaps between the pellets and the fuel cladding.

The second barrier, the fuel cladding, consists of zirconium alloy tubes that confine the fuel pellets. The small gaps between the fuel and the cladding contain the noble gases and volatile iodines that are types of radioactive fission products. This radioactivity can diffuse to a small extent through the fuel cladding into the reactor coolant water.

The third barrier consists of the reactor pressure vessel, steel piping and equipment that confine the reactor cooling water. The reactor pressure vessel, which holds the reactor fuel, is typically a steel tank 40 feet high by 14 feet in diameter with walls about five to nine inches thick. These vessels and associated piping provide containment for radioactivity in the primary coolant and the reactor core. However, during the course of operations and maintenance, small amounts of radioactive fission and activation products can escape through valve leaks or upon breaching of the primary coolant system for maintenance.

The fourth barrier is the primary containment. It is a cylindrical enclosure with approximately five-foot thick steel reinforced concrete walls lined by steel on the inside. Small amounts of radioactivity may be released from primary containment during operation to maintain proper containment pressure and during maintenance and refueling outages.

The fifth barrier is the secondary containment or enclosure building. The enclosure building is a steel building that surrounds the primary containment. This barrier is an additional safety feature at Millstone's reactor units to contain radioactivity that may escape from the primary containment. This enclosure building is equipped with a filtered ventilation system that is used when needed to reduce the radioactivity that escapes from the primary containment.

The five barriers confine most of the radioactive fission and activation products. However, small amounts of radioactivity do escape via mechanical failures and maintenance on valves, piping, and equipment associated with the reactor cooling water system. The small amounts of radioactive liquids and gases that do escape the various containment systems are further controlled by the liquid purification and ventilation filtration systems. Also, prior to a release to the environment, control systems exist to collect and purify the radioactive effluents in order to reduce releases to the environment to as low as is reasonably achievable. The control of radioactive effluents at Millstone Station will be discussed in more detail in the next section.

1.5 Radioactive Effluent Control

The small amounts of radioactive liquids and gases that might escape the first two barriers are purified in the liquid and gaseous waste treatment systems, then monitored for radioactivity, and released only if the radioactivity levels are below the federal release limits.

Radioactivity released from the liquid effluent system to the environment is limited, controlled, and monitored by a variety of systems and procedures which include:

- reactor water cleanup system;
- liquid radwaste treatment system;
- sampling and analysis of the liquid radwaste tanks; and,
- liquid waste effluent discharge radioactivity monitor.

The purpose of the reactor water cleanup system is to continuously purify the reactor cooling water by removing radioactive atoms and non-radioactive impurities that may become activated by neutron bombardment. A portion of the reactor coolant water is diverted from the primary coolant system and is directed through ion exchange resins where radioactive elements, dissolved and suspended in the water, are removed through chemical processes. The net effect is a substantial reduction of the radioactive material that is present in the primary coolant water and consequently the amount of radioactive material that might escape from the system.

Reactor cooling water that might escape the primary cooling system and other radioactive water sources are collected in floor and equipment drains. These drains direct this radioactive liquid waste to large holdup tanks. The liquid waste collected in the tanks is purified again using the liquid radwaste treatment system, which consists of a filter and ion exchange resins.

Processing of liquid radioactive waste results in large reductions of radioactive liquids discharged into Niantic Bay. Wastes processed through liquid radwaste treatment can be purified and when necessary the processed liquid is re-used in plant systems.

Prior to release, the radioactivity in the liquid radwaste tank is sampled and analyzed to determine if the level of radioactivity is below the release limits and to quantify the total amount of radioactive liquid effluent that would be released. If the levels are below the federal release limits, the tank is drained to the liquid effluent discharge header.

This liquid waste effluent discharge line is provided with a shielded radioactivity monitor. This detector is connected to a radiation level meter and a recorder in the Control Room. The radiation alarm is set so that the detector will alarm before radioactivity levels exceed the release limits. The liquid effluent discharge header has an isolation valve. If an alarm is received, the liquid effluent discharge valve will automatically close, thereby terminating the release to the Niantic Bay and preventing any liquid radioactivity from being released that may exceed the release limits. An audible alarm notifies the Control Room operator that this has occurred.

Some liquid waste sources, which have a low potential for containing radioactivity, and/or may contain very low levels of contamination, may be discharged directly to the Long Island Sound. One such source of liquid is the turbine building sump. However, periodic representative samples are collected for analysis of radioactivity content to track the amounts of radioactivity being discharged.

Another means for adjusting liquid effluent concentrations to below federal limits is by mixing plant cooling water from the condenser with the liquid effluents in the discharge canal. This larger volume of cooling water further dilutes the radioactivity levels far below the release concentration limits.

The preceding discussion illustrates that many controls exist to reduce the radioactive liquid effluents released to the Niantic Bay to as far below the release limits as is reasonably achievable.

Radioactive releases from the radioactive gaseous effluent system to the environment are limited, controlled, and monitored by a variety of systems and procedures which include:

- containment building ventilation system;
- containment building vent effluent radioactivity monitor;
- sampling and analysis of containment building vent and purge effluents;
- process gas treatment system;
- auxiliary building (and engineered safeguards and fuel building for Unit 3) ventilation system;
- stack and vent effluent radioactivity monitors;
- sampling and analysis of stack and vent effluents;
- process radiation monitors; and
- steam jet air ejector (SJAE) monitor

The primary sources of gaseous radioactive waste are degassing of the primary coolant, gaseous liquid drains, and gaseous vents. Additional sources of gaseous waste activity include ventilation air released from the auxiliary building and purging and venting of the containment building. The radiation level meter and recorders for the effluent radioactivity monitors are located in the Control Room. The plant process computer aids in tracking the monitor readings. To supplement the information continuously provided by the detector, air samples are taken periodically from the containment, stack and vents. These samples are analyzed to quantify the total amount of tritium and radioactive gaseous and particulate effluents released.

Gases from the primary coolant are held up in waste gas decay tanks for decay at Unit 2. Gaseous waste at Unit 3 is purified through a process gas system, consisting of a high high-efficiency particulate air filters and charcoal adsorber beds. Gases from periodic venting of the Unit 2 containment are released through a similar process system (Enclosure Building Filtration System) while gases from the Unit 3 containment vacuum pumps are released without treatment. If necessary, Unit 3 containment air can be filtered by an internal particulate and charcoal treatment system. Containment purges (purge is the forced ventilation process while containment vents are pressure releases) for Unit 2 are filtered by high-efficiency particulate filters while at Unit 3 these are not normally filtered. If necessary particulate and charcoal filters can be used for these purges.

The auxiliary building ventilation system provides for ventilation of the auxiliary building and enclosure building (and service building and contiguous areas, waste disposal building, and fuel building for Unit 3, for Unit 2 these are all part of the auxiliary building). Normally, the air from the ventilation of these areas will exhaust through the ventilation vent (which has a particulate filter for Unit 2). If exhaust from these areas reaches a predetermined level, the ventilation flow can be diverted by operator control to a particulate and charcoal filtration system.

Therefore, for both liquid and gaseous releases, radioactive effluent control systems exist to collect and purify the radioactive effluents in order to reduce releases to the environment to as low as is reasonably achievable. The effluents are always monitored, sampled and analyzed to make sure that radioactivity levels are below the release limits. If the release limits are being approached, isolation valves in some of the waste effluent lines will automatically shut to stop the release, or Control Room operators can implement procedures to ensure that federal regulatory limits are always met.

1.6 Radiological Impact on Humans

The final step in the effluent control process is the determination of the radiological dose impact to humans and comparison with the federal dose limits to the public. This step is performed in three stages. As mentioned previously, the purpose of continuous radiation monitoring and periodic sampling and analysis is to measure the quantities of radioactivity being released to determine compliance with the radioactivity release limits. This is the first stage for assessing releases to the environment.

The second stage is calculations of the dose impact to the general public from Millstone Station's radioactive effluents are performed. The purpose of these calculations is to periodically assess the doses to the general public resulting from radioactive effluents to ensure that these doses are being maintained as far below the federal dose limits as is reasonably achievable. This is the second stage for assessing releases to the environment.

The types and quantities of radioactive liquid and gaseous effluents released from Millstone Station during each given year are reported to the Nuclear Regulatory Commission annually in the Radiological Effluent Release Report (RERR). Similar to this report, the RERR is submitted annually to the Nuclear Regulatory Commission. Section 5 of this report discusses the detailed dose calculations from the RERR and provides a comparison to REMP dose calculations. The liquid and gaseous effluents were well below the federal release limits and were a small percentage of the MPS REMODCM effluent control limits.

The measurements of the physical and chemical nature of the effluents are used to determine how the radionuclides will interact with the environment and how they can result in radiation exposure to humans. The environmental interaction mechanisms depend upon factors such as the hydrological (water) and meteorological (atmospheric) characteristics in the area. Information on the water flow, wind speed, wind direction, and atmospheric mixing characteristics are used to estimate how radioactivity will distribute and disperse in the ocean and the atmosphere.

The most important type of information that is used to evaluate the radiological impact on humans is data on the use of the environment. Information on fish and shellfish consumption, boating usage, beach usage, locations of cows and goats, locations of residences, locations of gardens, drinking water supplies, and other usage information are utilized to estimate the amount of radiation and radioactivity received by the general public.

The radiation exposure pathway to humans is the path radioactivity takes from its release point at Millstone Station to its effect on man.

There are three major pathways in which liquid effluents affect humans:

- external radiation from liquid effluents that deposit and accumulate on the shoreline;
- external radiation from immersion in ocean water containing radioactive liquids; and,
- internal radiation from consumption of fish and shellfish containing radioactivity absorbed from the liquid effluents.

There are six major ways in which gaseous effluents affect humans:

- external radiation from an airborne plume of radioactivity;
- internal radiation from inhalation of airborne radioactivity;
- external radiation from deposition of radioactive effluents on soil;
- ambient (direct) radiation from contained sources at the power plant;
- internal radiation from consumption of vegetation containing radioactivity deposited on the vegetation from airborne deposition and absorbed from the soil due to ground deposition of radioactive effluents; and,
- internal radiation from consumption of milk and meat containing radioactivity deposited on forage that is eaten by cattle and other livestock.

In addition, ambient (direct) radiation emitted from contained sources of radioactivity at MPS contributes to radiation exposure in the vicinity of the plant. Small amounts of ambient radiation result from low-level radioactive waste being processed and stored at the site prior to shipping and disposal. Also, the operation of an ISFSI (Independent Spent Fuel Storage Installation, operation began in 2005) results in very small amounts of direct radiation at the site boundary.

The radiological dose impact on humans is based both on effluent analyses and modeling and on direct measurements of radiation and radioactivity in the environment. When MPS-related radioactivity is detected in samples that represent a plausible exposure pathway, the resulting dose from such exposure is assessed (see Sections 4 and 5). However, the operation of Millstone Power Station results in releases of only small amounts of radioactivity, and, as a result of dilution in the atmosphere and ocean, even the most sensitive radioactivity measurement and analysis techniques cannot usually detect these tiny amounts of radioactivity above that which is naturally present in the environment. Therefore, radiation doses are calculated using radioactive effluent release data and computerized dose calculations that are based on conservative NRCrecommended models that tend to result in over-estimates of the resulting dose. These computerized dose calculations are performed by Dominion Nuclear personnel. These computer codes use the guidelines and methodology set forth by the NRC in Regulatory Guide 1.109 (Reference 7). The dose calculations are documented and described in detail in the Millstone Nuclear Power Station's Radiological Effluent Monitoring and Offsite Dose Calculation Manual (Reference 8), which has been reviewed by the NRC.

It should be emphasized that because of the conservative assumptions made in the computer code calculations, the maximum hypothetical dose to an individual is considerably higher than the dose that would actually be received by a real individual.

After dose calculations are performed, the results are compared to the federal dose limits for the public. The two federal agencies that are charged with the responsibility of protecting the public from radiation and radioactivity are the Nuclear Regulatory Commission (NRC) and The Environmental Protection Agency (EPA).

The NRC, in 10CFR 20.1301 (Reference 9) limits the levels of radiation to unrestricted areas resulting from the possession or use of radioactive materials such that they limit any individual to a dose of:

less than or equal to 100 mrem per year to the total body.

In addition to this dose limit, the NRC has established design objectives for nuclear plant licensees. Conformance to these guidelines ensures that nuclear power reactor effluents are maintained as far below the legal limits as is reasonably achievable.

The NRC, in 10CFR 50 Appendix I (Reference 10) establishes design objectives for the dose to a member of the general public from radioactive material in liquid effluents released to unrestricted areas to be limited to:

- less than or equal to 3 mrem per year to the total body; and,
- less than or equal to 10 mrem per year to any organ.

The air dose due to release of noble gases in gaseous effluents is restricted to:

- less than or equal to 10 mrad per year for gamma radiation; and,
- less than or equal to 20 mrad per year for beta radiation.

The dose to a member of the general public from iodine-131, tritium, and all particulate radionuclides with half-lives greater than 8 days in gaseous effluents is limited to:

• less than or equal to 15 mrem per year to any organ.

The EPA, in 40CFR190.10 Subpart B (Reference 11), sets forth the environmental standards for the uranium fuel cycle. During normal operation, the annual dose to any member of the public, at or beyond the site boundary, from the entire uranium fuel cycle shall be limited to:

- less than or equal to 25 mrem per year to the total body;
- less than or equal to 75 mrem per year to the thyroid; and,
- less than or equal to 25 mrem per year to any other organ.

The summary of the 2006 radiological impact for Millstone Station and comparison with the EPA dose limits and Appendix I guidelines is presented in Section 5 of this report.

The third stage of assessing releases to the environment is the Radiological Environmental Monitoring Program (REMP). The description and results of the REMP at Millstone Power Station during 2006 is discussed in Sections 2 through 4 of this report.

2. PROGRAM DESCRIPTION

2.1 Sampling Schedule and Locations

The sample locations and the sample types and frequency of analysis are given in Tables 2-1 and 2-2 and Figures 2.1 and 2.2. The program as described on Table 2-2 only lists the required samples as specified in the Radiological Effluent Monitoring and Offsite Dose Calculation Manual. However, in order to identify the locations of the extra samples, all locations (both required and extra) are listed in Table 2-1 and shown on the figures.

Table 2-1 Environmental Monitoring Program Sampling Types and Locations

Location		Direction & Distance	
Number*	Location Name	From Release Point**	Sample Types
1-1	On-site - Old Millstone Rd.	0.6 Mi, NNW	TLD, Air Particulate, Iodine,
			Vegetation
2-1	On-site - Weather Shack	0.3 Mi, S	TLD, Air Particulate, Iodine
3-1	On-site - Bird Sanctuary	0.3 Mi, NE	TLD, Air Particulate, Iodine,
			Soil
4-1	On-site - Albacore Drive	1.0 Mi, N	TLD, Air Particulate, Iodine,
			Soil
5-I	MP3 Discharge	0.1 Mi, SSE	TLD
6-I	Quarry Discharge	0.3 Mi, SSE	TLD
7-I	Environmental Lab Dock	0.3 Mi, SE	TLD
8-I	Environmental Lab	0.3 Mi, SE	TLD
9-1	Bay Point Beach	0.4 Mi, W	TLD
10-l	Pleasure Beach	1.2 Mi, E	TLD, Air Particulate, Iodine,
			Vegetation
11-1	New London Country Club	1.6 Mi, ENE	TLD, Air Particulate, Iodine
12-C	Fisher's Island, NY	8.0 Mi, ESE	TLD
13-C	Mystic, CT	11.5 Mi, ENE	TLD
14-C	Ledyard, CT	12.0 Mi, NE	TLD, Soil
15-C	Norwich, CT	14.0 Mi, N	TLD, Air Particulate, Iodine
16-C	Old Lyme, CT	8.8 Mi, W	TLD
17-1	Site Boundary	0.5 Mi, NE	Vegetation
21-1	Goat Location #1	2.0 Mi, N	Milk
22-l	Goat Location #2	2.7 Mi, NE	Milk
24-C	Goat Location #4	29.0 Mi, NNW	Milk -
25-I	Within 10 Miles	Within 10 Miles	Fruits & Vegetables
26-C	Beyond 10 Miles	Beyond 10 Miles	Fruits & Vegetables
27-I	Niantic	1.7 Mi, WNW	TLD, Air Particulate, Iodine
28-I	Two Tree Island	0.8 Mi, SSE	Mussels
29-1	West Jordan Cove	0.4 Mi, NNE	Clams
30-1	Niantic Shoals	1.5 Mi, NNW	Mussels
31-I	Niantic Shoals	1.8 Mi, NW	Bottom Sediment, Oysters
31-X	Niantic Shoals	1.8 Mi, NW	Scallops
32-l	Vicinity of Discharge	< 0.1 Mi	Bottom Sediment, Oysters,
			Lobster, Fish, Seawater
32-X	Vicinity of Discharge	< 0.1 Mi	Fucus
33-1	Seaside Point	1.8 Mi, ESE	Bottom Sediment
33-X	Seaside Point	1.8 Mi, ESE	Fucus
34-1	Thames River Yacht Club	4.0 Mi, ENE	Bottom Sediment
34-X	Thames River Yacht club	4.0 Mi, ENE	Oysters
35-1	Niantic Bay	0.3 Mi, WNW	Lobster, Fish
35-X	Niantic Bay	0.3 Mi, WNW	Bottom Sediment, Clams,
			Fucus
36-1	Black Point	3.0 Mi, WSW	Oysters
36-X	Black Point	3.0 Mi, WSW	Bottom Sediment, Fucus

^{*}Key: I - Indicator C - Control X - Extra - sample not required by REMODCM

^{**}The release points are the MP1 stack for terrestrial locations and the quarry cut for aquatic locations.

Location Number*	Location Name	Direction & Distance From Release Point**	Sample Types
37-C	Giant's Neck	3.5 Mi, WSW	
37-0	Giant's Neck	3.5 1411, 44.544	Bottom Sediment, Oysters Seawater
37-X	Giant's Neck	3.5 Mi, WSW	Lobster
	Waterford Shellfish Bed #1		Clams
38-1		1.0 Mi, NW	
39-X	Jordon Cove Bar	0.8 Mi, NE	Bottom Sediment, Clams
40-X	Outonma		Fucus Figh Overtors
40-A 41-I	Quarry Myrock Avenue	3.2 Mi, ENE	Fish, Oysters TLD
41-I 42-I	Billow Road		TLD
		2.4 Mi, WSW	TLD
43-I	Black Point	2.6 Mi, SW	
44-1	Onsite - Schoolhouse	0.1 Mi, NNE	TLD
45-1	Onsite Access Road	0.5 Mi, NNW	TLD
46-l	Old Lyme - Hillcrest Ave.	4.6 Mi, WSW	TLD
47-1	East Lyme - W. Main St.	4.5 Mi, W	TLD
48-1	East Lyme - Corey Rd.	3.4 Mi, WNW	TLD
49-1	East Lyme - Society Rd.	3.6 Mi, NW	TLD
50-l	East Lyme - Manwaring Rd.	2.1 Mi, W	TLD
51-l	East Lyme - Smith Ave.	1.5 Mi, NW	TLD
52-l	Waterford - River Rd.	1.1 Mi, NNW	TLD
53-I	Waterford - Gardiners Wood Rd.	1.4 Mi, NNE	TLD
55-1	Waterford - Magonk Point	1.8 Mi, ESE	TLD
56-1	New London - Mott Ave.	3.7 Mi, E	TLD
57-I	New London - Ocean Ave.	3.6 Mi, ENE	TLD
59-l	Waterford -Miner Ave.	3.4 Mi, NNE	TLD
60-1	Waterford - Parkway South	4.0 Mi, N	TLD
61-I	Waterford - Boston Post Rd.	4.3 Mi, NNW	TLD
62-I	East Lyme - Columbus Ave.	1.9 Mi, WNW	TLD
63-I	Waterford - Jordon Cove Rd.	0.8 Mi, NE	TLD
64-I	Waterford - Shore Rd.	1.1 Mi, ENE	TLD
65-l	Waterford - Bank St.	3.2 Mi, NE	TLD
66-X	NAP Parking Lot - Fitness		TLD
	Center		
67-X	Golden Spur	4.7 Mi, NNW	Bottom Sediment
68-Z	Ram Island	9.6 Mi., ESE	Oysters
69-X	Pleasure Beach	0.8 Mi, E	Bottom Sediment
71-I	Onsite Well	Onsite	Well Water
72-I	Onsite Well	Onsite	Well Water
73-X	Site Switchyard Fence	0.3 Mi, N	TLD
74-X	Ball Field Foul Pole	0.6 Mi, N	TLD
75-X	Waterford – Windward Way &	0.5 Mi, NE	TLD
76-X	Shotgun Onsite Well - ISFSI Control	Up-gradient of ISFSI	Well Water
77-X	Onsite Well - ISFSI Indicator	Down-gradient of ISFSI	Well Water
78-X	Onsite Well - ISFSI Indicator	Down-gradient of ISFSI	Well Water
79-X	Onsite Well	Onsite	Well Water
80-X	Onsite Well	Onsite	Well Water
81-X	Onsite Well	Onsite	Well Water
90-C	Thames River	4 Mi, E	Fucus

*Key: I - Indicator C - Control X or Z - Extra - sample not required

^{**}The release points are the MP1 stack for terrestrial locations and the quarry cut for aquatic locations.

Table 2-2 Required Sampling Frequency & Type of Analysis

	Exposure Pathway and/or Sample	No. of .ocations	Sampling & Collection Frequency	Type of Analysis
1.	Gamma Dose - Environmental TLD	40 ^a	Quarterly	Gamma Dose - Quarterly
2.	Airborne Particulate	8	Continuous sampler - weekly filter change	Gross Beta - Weekly Gamma Spectrum - Quarterly on composite (by location), and on individual sample if gross beta is greater than 10 times the mean of the weekly control station's gross beta results
3.	Airborne lodine	8	Continuous sampler - weekly canister change	I-131 - Weekly
4.	Vegetation	5	One sample near middle and one near end of growing season	Gamma Isotopic on each sample
5.	Milk	3	Semimonthly when animals are on pasture; monthly at other times.	Gamma Isotopic and I-131 on each sample; Sr-89 and Sr-90 on quarterly composite
5a.	Pasture Grass	3	Sample as necessary to substitute for unavailable milk	Gamma Isotopic and I-131 on each sample
6.	Sea Water	2	Continuous sampler with a monthly collection at indicator location. Quarterly at control location - Composite of 6 weekly grab samples.	Gamma Isotopic and Tritium on each sample.
6a.	Well Water	2	Semiannual	Gamma Isotopic and Tritium on each sample
7.	Bottom Sediment	5	Semiannual	Gamma Isotopic on each sample
7a.	Soil	3	Annually	Gamma Isotopic on each sample
8.	Fin Fish-Flounder and one other type of edible fin fish	2	Quarterly	Gamma Isotopic on each sample
9.	Mussels (edible portion)	2	Quarterly	Gamma Isotopic on each sample
10.	Oysters (edible portion)	4	Quarterly	Gamma Isotopic on each sample
11.	Clams (edible portion)	2	Quarterly	Gamma Isotopic on each sample
12.	Lobster (edible portion)	2	Quarterly	Gamma Isotopic on each sample

⁽a) Two or more TLDs or TLD with two or more elements per location.

Figure 2.1 Millstone Sampling Locations 67 Miles See Figure 2.1-2 Long Island Sound TLD Monitoring (only) TLD and Air Monitoring (particulates & iodine) Terrestrial Monitoring (milk, grass, fruit & vebetables, soil, or leaves) Aquatic Monitoring (seawater, sediment, flora, fish, mussel, oyster, clam, or lobster)

2-5

Figure 2.2 Millstone Sampling Locations (Within 2 miles) N Niantic River L Niantic Bay Outer Jordan Cove Twotree Island Channel 0.5 Miles TLD Monitoring (only) TLD and Air Monitoring (particulates & iodine) Terrestrial Monitoring (milk, grass, fruit & vegetables, soil, or leaves) Aquatic Monitoring (seawater, sediment, flora, fish, mussel, oyster, clam, or lobster)

2.2 Samples Collected During Report Period

The following table summarizes the number of samples of each type collected and analyzed during 2006:

Sample Type	Number of Technical Specification Required Samples	Number of Technical Specification Required Samples <u>Analyzed</u>	Number of Extra Samples <u>Analyzed</u>
Gamma Exposure (Environmental TLD)	160	159 ¹	16
Air Particulates	424	424	0
Air Iodine	424	424	0
Soil	3	3	0
Goat Milk	54	14 ²	0
Pasture Grass	Variable ³	40	7
Fruit and Vegetables	8	8	1
Broad Leaf Vegetation	6	6	15
Sea Water	16	16	0
Well Water	4	4	15
Bottom Sediment	. 10	10	10
Aquatic Flora	0	0	22
Fish	16	13 ⁴	2
Mussels	8	8	0
Oysters	16	15 ⁵	8
Clams	8	8	9
Lobster	8	8	4
Total All Types	1,165	1,160	109

One TLD was missing since utility pole to which it was attached was replaced
 Pasture grass sampled as necessary to substitute for unavailable milk. Hay or grain was substituted when grass was not available.

³ Depends upon availability of goat milk samples

⁴ Due to sample unavailability, not all required fish samples could be obtained

⁵ Due to broken cage, one oyster sample could not be obtained

3. RADIOCHEMICAL RESULTS

3.1 Summary Table

In accordance with the Radiological Effluent Monitoring and Offsite Dose Calculation Manual (REMODCM), Section I.F.1, a summary table of the radiochemical results has been prepared and is presented in Table 3-1.

The mean and range recorded are based only upon detectable measurements. The parentheses indicate the fraction of the measurements that are considered above the detection limit for each individual analysis.

A more detailed analysis of the data is given in Section 4.0 where a discussion of the variations in the data explains many aspects that are not evident in the Summary Table because of the basic limitation of data summaries. The data summaries include the extra 'X' samples collected throughout the year. These samples are taken to enhance the monitoring program, or are the results of special studies.

Page 1 of 16

Medium or Pathway	Anal	Analysis		Indicator * Locations		Location with Highest Mean			Non- Routine
Sampled (Units)	Туре	Total No	LLD	Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measure- ments
TLD (uR/hr)	Gamma Dose	175	-	7.94 (156/156) (4.4-11.6)	08	0.3 mi SE	11.4 (4/4) (11-11.6)	8.47 (19/19) (5.94-10.6)	
AP Gross Beta (1e-3 pCi/m3)	Gross Beta	424	10	18 (369/371) (4.5-34.5)	15-C	14.0 mi N	18.3 (53/53) (6.1-33.5)	18.3 (53/53) (6.1-33.5)	
Air Iodine (1e-3 pCi/m3)	I-131	424	70	(0/371)	-	-	< LLD	(0/53)	
AP Gamma (1e-3 pCi/m3)	Ba-140	32	-	(0/28)	-	-	< LLD	(0/4)	
	Be-7	32	-	105 (25/28) (69-140)	03	0.3 mi NE	117 (4/4) (96-139)	94.8 (4/4) (77-129)	
	Ce-141	32	-	(0/28)	-	•	< LLD	(0/4)	
	Ce-144	32	-	(0/28)	-	-	< LLD	(0/4)	
	Co-58	32	-	(0/28)	-	-	< LLD	(0/4)	
	Co-60	32	-	(0/28)	-	-	< LLD	(0/4)	
	Cr-51	32	-	(0/28)	-	-	< LLD	(0/4)	
,	Cs-134	32	50	(0/28)	-	-	< LLD	(0/4)	
•	Cs-137	32	60	(0/28)	-	-	< LLD	(0/4)	طن
	Mn-54	32	-	(0/28)	-	-	< LLD	(0/4)	
	Nb-95	32	-	(0/28)	-	-	< LLD	(0/4)	
	Ru-103	32	-	(0/28)	-	-	< LLD	(0/4)	
	Ru-106	32	-	(0/28)	-	-	< LLD	(0/4)	
	Zr-95	32	-	(0/28)	-	-	< LLD	(0/4)	

Page 2 of 16

Medium or Pathway	Analy	Analysis		Indicator Locations	Locat	ion with Hig	hest Mean	Control Locations	Non- Routine
Sampled (Units)	Туре	Total No	LLD	Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measure- ments
Soil (pCi/g dry)	Be-7	3	-	(0/2)	-	-	< LLD	(0/1)	
	Ce-141	3	-	(0/2)	-	-	< LLD	(0/1)	
	Ce-144	3	-	(0/2)	-	-	< LLD	(0/1)	
	Co-58	3	-	(0/2)	-	-	< LLD	(0/1)	
	Co-60	3	-	(0/2)	-	-	< LLD	(0/1)	
	Cr-51	3	-	(0/2)	-	-	< LLD	(0/1)	
	Cs-134	3	0.15	(0/2)	-	-	< LLD	(0/1)	
	Cs-137	3	0.18	0.587 (2/2) (0.542-0.631)	14-C	12.0 mi NE	1.12 (1/1) (1.12-1.12)	1.12 (1/1) (1.12-1.12)	
	Fe-59	3	-	(0/2)	-	-	< LLD	(0/1)	
	K-40	3	-	11.2 (2/2) (10.9-11.5)	14-C	12.0 mi NE	12.7 (1/1) (12.7-12.7)	12.7 (1/1) (12.7-12.7)	
	Mn-54	3	-	(0/2)	-	-	< LLD	(0/1)	
	Nb-95	3	-	(0/2)	-	-	< LLD	(0/1)	<u></u>
	Ru-103	3	-	(0/2)	-	-	< LTD	(0/1)	
	Ru-106	3	-	(0/2)	-	-	< LLD	(0/1)	
	Sb-125	3	-	(0/2)	-	-	< LLD	(0/1)	
	Th-228	3	-	0.83 (2/2) (0.66-1)	14-C	12.0 mi NE	1.3 (1/1) (1.3-1.3)	1.3 (1/1) (1.3-1.3)	
	Zn-65	3	-	(0/2)	-	-	< LLD	(0/1)	
	Zr-95	3	-	(0/2)	-	-	< LLD	(0/1)	

Page 3 of 16

Medium or Pathway	Anal	Analysis		Indicator Locations	Locat	ion with Hig	hest Mean	Control Locations	Non- Routine
Sampled (Units)	Туре	Total No	LLD	Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measure- ments
Goat Milk (pCi/L)	Ba-140	14	70	(0/6)	-	-	< LLD	(0/8)	
	C s-134	14	15	(0/6)	-	-	< LLD	(0/8)	
	Cs-137	14	18	8.55 (2/6) (7.7-9.4)	24-C	29.0 mi NNW	12.9 (1/8) (12.9-12.9)	12.9 (1/8) (12.9-12.9)	
	I-131	14	1	(0/6)	-	-	< LLD	(0/8)	
	K-40	14	-	1298 (6/6) (950-1820)	24-C	29.0 mi NNW	1685 (8/8) (1380-1890)	1685 (8/8) (1380-1890)	
	La-140	14	25	(0/6)	-	-	< LLD	(0/8)	
	Sr-89	4	-	(0/2)	-	-	< LLD	(0/2)	
·	Sr-90	4	-	(0/2)	-	-	< LLD	(0/2)	-
Pasture Grass (Hay) (pCi/g wet)	Ba-140	47	-	(0/35)	-	-	< LLD	(0/12)	
· .	Be-7	47	-	1.6 (24/35) (0.26-3.08)	24-C	29.0 mi NNW	2.16 (7/12) (0.8-3.74)	2.16 (7/12) (0.8-3.74)	
	Ce-141	47	-	(0/35)	-	-	< LLD	(0/12)	
	Ce-144	47	-	(0/35)	-		< LLD	(0/12)	±
	Co-58	47	-	(0/35)	-	-	< LLD	(0/12)	
	Co-60	47	-	(0/35)	-	-	< LLD	(0/12)	
	Cr-51	47	-	(0/35)	-	-	< LLD	(0/12)	
	Cs-134	47	0.06	(0/35)	-	-	< LLD	(0/12)	
	Cs-137	47	0.08	0.02 (2/35) (0.02-0.02)	24-C	29.0 mi NNW	0.063 (1/12) (0.063-0.063)	0.063 (1/12) (0.063-0.063))
	Fe-59	47	-	(0/35)	- 3-4	-	< LLD	(0/12)	

Page 4 of 16

Medium or Pathway	Anal	Analysis		Indicator Locations	Locat	ion with Hig	hest Mean	Control Locations	Non- Routine
Sampled (Units)	Туре	Total No	LLD	Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measure- ments
Pasture Grass (Hay) (pCi/g wet)	I-131	47	0.06	(0/35)	-	-	< LLD	(0/12)	
	K-40	47	-	6.77 (35/35) (2.69-20)	24-C	29.0 mi NNW	7.92 (12/12) (4.15-15)	7.92 (12/12) (4.15-15)	
	La-140	47	-	(0/35)	-	-	< LLD	(0/12)	
•	Mn-54	47	-	(0/35)	-	-	< LLD	(0/12)	
	Nb-95	47	-	(0/35)	-	-	< LLD	(0/12)	
	Ru-103	47	-	(0/35)	-	-	< LLD	(0/12)	
	Ru-106	47	-	(0/35)	-	-	< LLD	(0/12)	
	Sb-125	47	-	(0/35)	-	-	< LLD	(0/12)	
	Th-228	47	-	0.105 (1/35) (0.105-0.105)	22	2.7 mi NE	0.105 (1/20) (0.105-0.105)	(0/12)	
	Zn-65	47	-	(0/35)	-	-	< LLD	(0/12)	
	Zr-95	47	-	(0/35)	-	-	< LLD	(0/12)	
Well Water (pCi/L)	Ba-140	19	60	(0/19)	-	-	< LLD	(0/0)	ı c
	Be-7	19	-	(0/19)	-	-	< LLD	(0/0)	
	Co-58	19	15	(0/19)	-	-	< LLD	(0/0)	
	Co-60	19	15	(0/19)	-	-	< LLD	(0/0)	
	Cr-51	19	-	(0/19)	-	-	< LTD	(0/0)	
	Cs-134	19	15	(0/19)	-	-	< LLD	(0/0)	
	Cs-137	19	18	(0/19)	- 3-5	-	< LLD	(0/0)	

Page 5 of 16

Medium or Pathway Sampled (Units)	Analy	Analysis		Indicator Locations	Location with Highest Mean		hest Mean	Control Locations	Non- Routine
	Туре	Total No	LLD	Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measure- ments
Well Water (pCi/L)	Fe-59	19	30	(0/19)	-	-	< LLD	(0/0)	
	H-3	19	2000	(0/19)	-	-	< LLD	(0/0)	
	I-131	19	15	(0/19)	-	-	< LLD	(0/0)	
	K-40	19	-	(0/19)	-	-	< LLD	(0/0)	
	La-140	19	15	(0/19)	-	-	< LLD	(0/0)	
	Mn-54	19	15	(0/19)	-	-	< LLD	(0/0)	
	Nb-95	19	15	(0/19)	-	-	< LLD	(0/0)	
	Ru-103	19	-	(0/19)	-	-	< LLD	(0/0)	
	Ru-106	19	-	(0/19)	-	-	< LLD	(0/0)	
	Sb-125	19	-	(0/19)	-	-	< LLD	(0/0)	
	Th-228	19	-	(0/19)	-	-	< LLD	(0/0)	
Fruits & Vegetables (pCi/g wet)	Zn-65	19	30	(0/19)	-	-	< LLD	(0/0)	<u>ت</u>
	Zr-95	19	30	(0/19)	-	-	< LLD	(0/0)	
	Ba-140	9	-	(0/5)	-	-	< LLD	(0/4)	
	Be-7	9	-	0.415 (1/5) (0.415-0.415)	25	10- mi	0.415 (1/5) (0.415-0.415)	(0/4)	
	Ce-141	9	-	(0/5)	-	-	< LLD	(0/4)	
	Ce-144	9	-	(0/5)	-	-	< LLD	(0/4)	
	Co-58	9	-	(0/5)	- 3-6	-	< LLD	(0/4)	

Page 6 of 16

Medium or Pathway	Analy	rsis	*	Indicator Locations	Locat	ion with Hig	hest Mean	Control Locations	Non- Routine
Sampled (Units)	Туре	Total No	LLD	Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measure- ments
Fruits & Vegetables (pCi/g wet)	Co-60	9	-	(0/5)	-	-	< LLD	(0/4)	·
	Cr-51	9	-	(0/5)	-	-	< LLD	(0/4)	
	Cs-134	9	0.06	(0/5)	-	-	< LLD	(0/4)	
	Cs-137	9	0.08	0.039 (1/5) (0.039-0.039)	25	10- mi	0.039 (1/5) (0.039-0.039)	(0/4)	
	Fe-59	9	-	(0/5)	-	-	< LLD	(0/4)	•
	I-131	9	0.06	(0/5)	-	-	< LLD	(0/4)	
	K-40	9	-	2.25 (5/5) (0.69-4.21)	26-C	10+ mi	2.31 (4/4) (0.82-4.74)	2.31 (4/4) (0.82-4.74)	
	La-140	9	-	(0/5)	-	-	< LLD	(0/4)	
	Mn-54	9	-	(0/5)	-	-	< LLD	(0/4)	
	Nb-95	9	-	(0/5)	-	-	< LLD	(0/4)	
	Ru-103	9	-	(0/5)	-	-	< LLD	(0/4)	
	Ru-106	9	-	(0/5)	-	-	< LLD	(0/4)	<u></u>
	Sb-125	9	-	(0/5)	-	-	< LLD	(0/4)	
	Th-228	9	-	(0/5)	-	-	< LLD	(0/4)	
	Zn-65	9	-	(0/5)	-	-	< LLD	(0/4)	
	Zr-95	9	-	(0/5)	-	-	< LLD	(0/4)	

Page 7 of 16

Medium or Pathway	Analy	sis	*	Indicator Locations				Control Locations	Non- Routine
Sampled (Units)	Туре	Total No	LLD	Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measure- ments
Broadleaf Vegetation (pCi/g wet)	Ba-140	21	-	(0/21)	-	_	<lld< td=""><td>(0/0)</td><td></td></lld<>	(0/0)	
-	Be-7	21	-	1.62 (18/21) (0.71-6.11)	17	0.5 mi NE	2.03 (7/7) (0.78-6.11)	(0/0)	
	Ce-141	21	-	(0/21)	-	-	< LLD	(0/0)	
	Ce-144	21	-	(0/21)	-	-	< LLD	(0/0)	
	Co-58	21	-	(0/21)	-	-	< LLD	(0/0)	
·	Co-60	21	-	(0/21)	-	-	< LLD	(0/0)	
	Cr-51	21	-	(0/21)	-	-	< LLD	(0/0)	
	Cs-134	21	0.06	(0/21)	-	-	< LLD	(0/0)	
	Cs-137	21	0.08	0.182 (1/21) (0.182-0.182)	17	0.5 mi NE	0.182 (1/7) (0.182-0.182)	(0/0)	
	Fe-59	21	-	(0/21)	-	-	< LLD	(0/0)	
·	I-131	21	0.06	(0/21)	-	-	< LLD	(0/0)	
	K-40	21	-	3.55 (21/21) (2.08-4.15)	01	0.6 mi NNW	3.77 (7/7) (3.46-4.15)	(0/0)	-
	La-140	21	-	(0/21)	-	-	< LLD	(0/0)	
	Mn-54	21	-	(0/21)	-	-	< LLD	(0/0)	
	Nb-95	21	-	(0/21)	-	-	< LLD	(0/0)	
	Ru-103	21	-	(0/21)	-	-	< LLD	(0/0)	
	Ru-106	21	~	(0/21)	-	-	< LLD	(0/0)	
	Sb-125	21	-	(0/21)	- 3-8	-	< LLD	(0/0)	

Page 8 of 16

Medium or Pathway	Analy	/sis	*	Indicator Locations	Locat	ion with Hig	hest Mean	Control Locations	Non- Routine
Sampled (Units)	Туре	Total No	LLD	Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measure- ments
Broadleaf Vegetation (pCi/g wet)	Th-228	21	-	0.248 (3/21) (0.134-0.37)	17	0.5 mi NE	0.248 (3/7) (0.134-0.37)	(0/0)	
	Zn-65	21	-	(0/21)	-	-	< LLD	(0/0)	
·	Zr-95	21	-	(0/21)	-	-	< LLD	(0/0)	
Sea Water (pCi/L)	Ba-140	16	60	(0/12)	-	-	< LLD	(0/4)	
	Be-7	16	-	(0/12)	-	-	< LLD	(0/4)	
	Co-58	16	15	(0/12)	-	-	< LTD	(0/4)	
	Co-60	16	15	(0/12)	-	-	< LLD	(0/4)	
	Cr-51	16	-	(0/12)	-	-	< LLD	(0/4)	
	Cs-134	16	15	(0/12)	-	-	< LLD	(0/4)	
	Cs-137	16	18	(0/12)	-	-	< LTD	(0/4)	
	Fe-59	16	30	(0/12)	-	-	< LLD	(0/4)	
	H-3	16	2000	489 (7/12) (290-770)	32		489 (7/12) (290-770)	(0/4)	<u>.</u>
	I-131	16	15	(0/12)	-	-	< LLD	(0/4)	
	K-40	16	-	277 (12/12) (226-338)	32		277 (12/12) (226-338)	246 (4/4) (209-276)	
	La-140	16	15	(0/12)	-	-	< LLD	(0/4)	
	Mn-54	16	15	(0/12)	-	-	< LLD	(0/4)	
	Nb-95	16	15	(0/12)	-	-	< TTD	(0/4)	
	Ru-103	16	-	(0/12)	- 3-9	-	< LLD	(0/4)	

Page 9 of 16

Medium or Pathway	Analy	sis	*	Indicator Locations	Locati	ion with Hig	hest Mean	Control Locations	Non- Routine
Sampled (Units)	Туре	Total No	LLD	Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measure- ments
Sea Water (pCi/L)	Ru-106	16	_	(0/12)	-	-	< LLD	(0/4)	
	Sb-125	16	-	(0/12)	-	-	< LLD	(0/4)	
	Th-228	16	-	(0/12)	-	-	< LLD	(0/4)	
	Zn-65	16	30	(0/12)	-	-	< LLD	(0/4)	
	Zr-95	16	30	(0/12)	-	-	< LLD	(0/4)	
Bottom Sediment (pCi/g dry)	Ag-110m	20	-	(0/18)	-	-	< LLD	(0/2)	
(peng diy)	Be-7	20	-	(0/18)	-	-	< LLD	(0/2)	
	Co-58	20	-	(0/18)	-	-	< LLD	(0/2)	-
	Co-60	20	-	0.097 (1/18) (0.097-0.097)	39-X	0.8 mi NE	0.097 (1/2) (0.097-0.097)	(0/2)	
	Cr-51	20	-	(0/18)	-	-	< LLD	(0/2)	
	Cs-134	20	0.15	(0/18)	-	-	< LLD	(0/2)	
	Cs-137	20	0.18	0.141 (4/18) (0.096-0.183)	39-X	0.8 mi NE	0.142 (2/2) (0.109-0.174)	(0/2)	<u>ت</u>
	Fe-59	20	-	(0/18)	-	-	< LLD	(0/2)	
	I-131	20	-	(0/18)	-	-	< LLD	(0/2)	
	K-40	20	-	15 (18/18) (11.1-19.5)	39-X	0.8 mi NE	17.3 (2/2) (15.1-19.5)	14.3 (2/2) (13.2-15.4)	
	Mn-54	20	-	(0/18)	-	-	< LLD	(0/2)	
	Nb-95	20	-	(0/18)	-	-	< LLD	(0/2)	
	Ru-103	20	-	(0/18)	-	-	< LLD	(0/2)	
	Ru-106	20	-	(0/18)	3-10 -	-	< LLD	(0/2)	

Medium or Pathway	Analy	sis	*	Indicator Locations	Locati	on with Hig	hest Mean	Control Locations	Non- Routine
Sampled (Units)	Type	Total No	LLD	Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measure- ments
Bottom Sediment (pCi/g dry)	Sb-125	20	-	(0/18)	.	-	< LLD	(0/2)	
	Th-228	20	-	1.07 (15/18) (0.191-3.32)	31	1.8 mi NW	2.1 (2/2) (0.87-3.32)	0.394 (2/2) (0.348-0.44)	
	Zn-65	20	-	(0/18)	-	-	< LLD	(0/2)	
	Zr-95	20	-	(0/18)	-	-	< LLD	(0/2)	
Aquatic Flora (pCi/g wet)	Ag-110m	22	-	(0/20)	-	-	< LLD	(0/2)	
	Be-7	22	-	0.141 (4/20) (0.084-0.246)	35-X	0.3 mi WNW	0.246 (1/4) (0.246-0.246)	0.186 (1/2) (0.186-0.186)	
	Co-58	22	-	(0/20)	-	-	< LLD	(0/2)	
	Co-60	22	-	(0/20)	-	-	< LLD	(0/2)	
	Cr-51	22	-	(0/20)	-	-	< LLD	(0/2)	
	Cs-134	22	-	(0/20)	-	-	< LLD	(0/2)	
	Cs-137	22	-	(0/20)	-	-	< LLD	(0/2)	
	Fe-59	22	-	(0/20)	-	-	< TTD	(0/2)	÷
	I-131	22	-	0.029 (4/20) (0.018-0.05)	90-C	4.2 mi ENE	0.107 (2/2) (0.072-0.142)	0.107 (2/2) (0.072-0.142)	
	K-40	22	-	5.78 (20/20) (3.71-10.3)	90-C	4.2 mi ENE	8.29 (2/2) (6.43-10.1)	8.29 (2/2) (6.43-10.1)	
	Mn-54	22	-	(0/20)	-	-	< LLD	(0/2)	
	Nb-95	22	-	(0/20)	-	-	< LLD	(0/2)	
	Ru-103	22	-	(0/20)	-	-	< TTD	(0/2)	
	Ru-106	22	-	(0/20)	-	-	< LLD	(0/2)	
	Sb-125	22	-	(0/20)	3-11 -	-	< LLD	(0/2)	

Medium or Pathway	Analy	sis	*	Indicator Location with Highest Mean Locations			hest Mean	Control Locations	Non- Routine
Sampled (Units)	Туре	Total No	LLD	Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measure- ments
Aquatic Flora (pCi/g wet)	Th-228	22	-	0.051 (3/20) (0.04-0.06)	90-C	4.2 mi ENE	0.079 (2/2) (0.06-0.098)	0.079 (2/2) (0.06-0.098)	
	Zn-65	22	-	(0/20)	-	-	< LLD	(0/2)	
	Zr-95	22	-	(0/20)	-	-	< LLD	(0/2)	
Fish-Flounder (pCi/g wet)	Ag-110m	6	-	(0/6)	-	-	< LLD	(0/0)	
	Be-7	6	-	(0/6)	-	-	< LLD	(0/0)	
	Co-58	6	0.13	(0/6)	-	. -	< LLD	(0/0)	
	Co-60	6	0.13	(0/6)	-	-	< LLD	(0/0)	
	Cr-51	6	-	(0/6)	-	-	< LLD	(0/0)	
	Cs-134	6	0.13	(0/6)	-	-	< LLD	(0/0)	
	Cs-137	6	0.15	(0/6)	-	-	< LLD	(0/0)	
	Fe-59	6	0.26	(0/6)	-	-	< LLD	(0/0)	
·	I-131	6	-	(0/6)	-	-	< LLD	(0/0)	<u></u>
	K-40	6	-	3.8 (6/6) (2.91-4.69)	32		4.12 (3/3) (3.7-4.69)	(0/0)	
	Mn-54	6	0.13	(0/6)	-	-	< LLD	(0/0)	
	Nb-95	6	-	(0/6)	-	-	< LLD	(0/0)	
	Ru-103	6	-	(0/6)	-	-	< LLD	(0/0)	
	Ru-106	6	-	(0/6)	-	-	< LLD	(0/0)	
	Sb-125	6	-	(0/6)	- .	-	< LLD	(0/0)	
	Th-228	6	•	(0/6)	3-12 -	-	< LLD	(0/0)	

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

DOCKETS 50-245, 50-336 & 50-

Medium or Pathway	Analy	sis	*	Indicator Locations	Locati	on with Hig	hest Mean	Control Locations	Non- Routine
Sampled (Units)	Туре	Total No	LLD	Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measure- ments
Fish-Flounder (pCi/g wet)	Zn-65	6	0.26	(0/6)		-	< LLD	(0/0)	-
u 5 /	Zr-95	6	-	(0/6)	-	-	< LLD	(0/0)	
Fish-Other (pCi/g wet)	Ag-110m	9	-	(0/9)	-	-	< LLD	(0/0)	
	Be-7	9	-	(0/9)	-	-	< LLD	(0/0)	
	Co-58	9	0.13	(0/9)	-	-	< LLD	(0/0)	
	Co-60	9	0.13	(0/9)	-	-	< LLD	(0/0)	
	Cr-51	9	-	(0/9)	-	-	< LLD	(0/0)	
	Cs-134	9	0.13	(0/9)	-	-	< LLD	(0/0)	
•	Cs-137	9	0.15	(0/9)	-	-	< LLD	(0/0)	
	Fe-59	9	0.26	(0/9)	-	-	< LLD	(0/0)	
	I-131	9	-	(0/9)	-	-	< LLD	(0/0)	
	K-40	9	-	3.77 (9/9) (2.96-4.34)	35	0.3 mi WNW	4.18 (3/3) (4.1-4.34)	(0/0)	<u>.</u>
	Mn-54	9	0.13	(0/9)	-	-	< LLD	(0/0)	
	Nb-95	9	-	(0/9)	-	-	< LLD	(0/0)	
	Ru-103	9	-	(0/9)	-	-	< LLD	(0/0)	
	Ru-106	9	-	(0/9)	-	-	< LLD	(0/0)	
	Sb-125	9	-	(0/9)	-	-	< LLD	(0/0)	
	Th-228	9	- .	(0/9)	-	-	< LLD	(0/0)	
	Zn-65	9	0.26	(0/9)	3-13	-	< LLD	(0/0)	

Medium or Pathway	Analy	rsis	*	Indicator Locations	Locati	Location with Highest Mean			Non- Routine
Sampled (Units)	Туре	Total No	LLD	Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measure- ments
Fish-Other (pCi/g wet)	Zr-95	9	-	(0/9)	-	-	< LLD	(0/0)	
Mussels (pCi/g wet)	Ag-110m	8	-	(0/8)	-	-	< LLD	(0/0)	
	Be-7	8	-	(0/8)	-	. -	< LLD	(0/0)	
	Co-58	8	0.13	(0/8)	-	-	< LLD	(0/0)	
	Co-60	8	0.13	(0/8)	-	-	< LLD	(0/0)	
	Cr-51	8	-	(0/8)	-	-	< LLD	(0/0)	
	Cs-134	8	0.13	(0/8)	-	-	< LLD	(0/0)	
	Cs-137	8	0.15	(0/8)	-	-	< LLD	(0/0)	
	Fe-59	8	0.26	(0/8)	-	-	< LLD	(0/0)	
	I-131	8	-	(0/8)		-	< LLD	(0/0)	
	K-40	8	-	1.77 (8/8) (1.47-2.12)	28	0.8 mi SSE	1.8 (4/4) (1.56-2.12)	(0/0)	
	Mn-54	8	0.13	(0/8)	-	-	< LLD	(0/0)	.1
	Nb-95	8	-	(0/8)	-	-	< LLD	(0/0)	
	Ru-103	8	-	(0/8)	-	-	< LLD	(0/0)	
	Ru-106	8	-	(0/8)	-	-	< LLD	(0/0)	
	Sb-125	8	-	(0/8)	-	-	< LLD	(0/0)	
	Th-228	8	-	(0/8)	-	-	< LLD	(0/0)	
	Zn-65	8	0.26	(0/8)	-	-	< LLD	(0/0)	
	Zr-95	8	-	(0/8)	3-14	-	< LLD	(0/0)	

Medium or Pathway	Analys	sis	*	Indicator Locations	Locatio	on with Hig	hest Mean	Control Locations	Non- Routine
Sampled (Units)	Туре	Total No	LLD	Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measure- ments
Oysters (pCi/g wet)	Ag-110m	23	-	0.068 (5/19) (0.046-0.091)	40-X		0.072 (3/4) (0.061-0.091)	(0/4)	
	Be-7	23	-	(0/19)	-	-	< LLD	(0/4)	
	Co-58	23	0.13	(0/19)	-	-	< LLD	(0/4)	
	Co-60	23	0.13	(0/19)	-	-	< LLD	(0/4)	
	Cr-51	23	-	(0/19)	-	-	< LLD	(0/4)	
	Cs-134	23	0.13	(0/19)	-	-	< LLD	(0/4)	
	Cs-137	23	0.15	(0/19)	-	-	< LTD	(0/4)	
	Fe-59	23 .	0.26	(0/19)	-	-	< LLD	(0/4)	
	I-131	23	-	(0/19)	-	-	< LLD	(0/4)	
	K-40	23	-	1.9 (18/19) (0.99-2.42)	34-X	4.0 mi ENE	2.12 (4/4) (1.86-2.4)	2.02 (4/4) (1.87-2.34)	
	Mn-54	23	0.13	(0/19)	-	-	< LTD	(0/4)	
	Nb-95	23	-	(0/19)	-	-	< LLD	(0/4)	شد
	Ru-103	23	-	(0/19)	-	-	< LLD	(0/4)	
	Ru-106	23	-	(0/19)	-	-	< LLD	(0/4)	
	Sb-125	23	-	(0/19)	-	-	< LLD	(0/4)	
	Th-228	23	-	(0/19)	-	-	< LTD	(0/4)	
	Zn-65	23	0.26	(0/19)	-	-	< LLD	(0/4)	
	Zr-95	23	-	(0/19)	-	-	< LLD	(0/4)	

Medium or Pathway	Analy	sis	*	Indicator Locations	Locati	ion with Hig	hest Mean	Control Locations	Non- Routine
Sampled (Units)	Туре	Total No	LLD	Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measure- ments
Clams (pCi/g wet)	Ag-110m	17	-	(0/17)	-	-	< LLD	(0/0)	
	Be-7	17	-	(0/17)	-	-	< LLD	(0/0)	
	Co-58	17	0.13	(0/17)	-	-	< LLD	(0/0)	
	Co-60	17	0.13	(0/17)	-	-	< LLD	(0/0)	
	Cr-51	17	-	(0/17)	-	-	< LLD	(0/0)	
	Cs-134	17	0.13	(0/17)	-	-	< LLD	(0/0)	
	Cs-137	17	0.15	(0/17)	-	-	< LLD	(0/0)	
	Fe-59	17	0.26	(0/17)	-	-	< LLD	(0/0)	•
	I-131	17	-	(0/17)	-	-	< LLD	(0/0)	
	K-40	17	-	2.18 (17/17) (1.48-5.46)	39-X	0.8 mi NE	2.85 (4/4) (1.48-5.46)	(0/0)	
	Mn-54	17	0.13	(0/17)	-	-	< LLD	(0/0)	
	Nb-95	17	-	(0/17)	~	-	< LLD	(0/0)	<u></u>
	Ru-103	17	-	(0/17)	-	-	< LLD	(0/0)	
	Ru-106	17	-	(0/17)	-	-	< LLD	(0/0)	
	Sb-125	17	-	(0/17)	-	-	< LLD	(0/0)	
	Th-228	17	-	(0/17)	-	-	< LLD	(0/0)	
	Zn-65	17	0.26	(0/17)	-	-	< LLD	(0/0)	
	Zr-95	17	-	(0/17)	-	-	< LLD	(0/0)	

Medium or Pathway	Analy	sis	*	Indicator Locations	Locati	on with Hig	hest Mean	Control Locations	Non- Routine
Sampled (Units)	Туре	Total No	LLD	Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measure- ments
Lobsters (Crabs) (pCi/g wet)	Ag-110m	12	-	(0/12)	•	-	< LLD	(0/0)	
	Be-7	12	-	(0/12)	-	-	< LLD	(0/0)	
	Co-58	12	0.13	(0/12)	-	-	< LLD	(0/0)	
	Co-60	12	0.13	(0/12)	-	-	< LLD	(0/0)	
	Cr-51	12	-	(0/12)	-	-	< LLD	(0/0)	
	Cs-134	12	0.13	(0/12)	-	-	< LLD	(0/0)	
	Cs-137	12	0.15	(0/12)	-	-	< LLD	(0/0)	
	Fe-59	12	0.26	(0/12)		-	< LLD	(0/0)	
	I-131	12	-	(0/12)	-	•	< LLD	(0/0)	
	K-40	12	-	2.44 (12/12) (2.05-3.66)	35	0.3 mi WNW	2.71 (4/4) (2.17-3.66)	(0/0)	
	Mn-54	12	0.13	(0/12)	-	-	< LLD	(0/0)	
	Nb-95	12	-	(0/12)	-	-	< LLD	(0/0)	-
	Ru-103	12	-	(0/12)	-	-	< LLD	(0/0)	
	Ru-106	12	-	(0/12)	-	-	< LLD	(0/0)	
	Sb-125	12	-	(0/12)	-	-	< LLD	(0/0)	
	Th-228	12	-	(0/12)	-	-	< LLD	(0/0)	
	Zn-65	12	0.26	(0/12)	-	-	< LLD	(0/0)	
	Zr-95	12	-	(0/12)	-	-	< LLD	(0/0)	

NOTES FOR TABLE 3-1

* For gamma measurements the Minimum Detectable Level (MDL) ~ the Lower Limit of Detection (LLD) / 2.33. For all others, MDL = 2 x (the standard deviation of the background). These MDLs are based on the absence of large amounts of interfering activity (excluding naturally occurring radionuclides). Deviations by factors of 3 to 4 can occur.

The LLD at a confidence level of 95% is the smallest concentration of radioactive material in a sample that will be detected with a 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{4.66 S_b}{E * V * 2.22 * Y * \exp(-\lambda \Delta t)}$$

where,

- LLD is the lower limit of detection as defined above (as pCi per unit mass or volume)
- S_b is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute)
- E is the counting efficiency (as counts per transformation)
- V is the sample size (in units of mass or volume)
- 2.22 is the number of transformation per minute per picoCurie
 - Y is the fractional radiochemical yield (when applicable)
 - Δ is the radioactive decay constant for the particular radionuclide
 - λt is the elapsed time between sample collection (or end of the sample collection period) and time of counting

The LLD is defined as a priori (before the fact) limit representing the capability of a measurement system and not an a posteriori (after the fact) limit for a particular measurement.

Analyses shall be performed in such a manner that the stated LLDs will be achieved under routine conditions. Occasionally background fluctuations, unavoidably small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these a priori LLDs unachievable. In such cases, the contributing factors will be identified and described in the Annual Radiological Environmental Operating Report. As shown in the equation above, for composite samples taken over a period of time, the LLD is decayed to the end of the sample period.

- ** LLD for leafy vegetables.
- *** LLD from the end of the sample period.

3.2 <u>Data Tables</u>

The data reported in this section are strictly counting statistics. The reported error is two times the standard deviation (2σ) of the net activity. Unless otherwise noted, the overall error (counting, sample size, chemistry, errors, etc.) is estimated to be 2 to 5 times that listed. Results are considered positive when the measured value exceeds 1.5 times the listed 2σ error (i.e., the measured value exceeds 3σ).

Because of counting statistics, negative values, zeros and numbers below the Minimum Detectable Level (MDL) are statistically valid pieces of data. For the purposes of this report, in order to indicate any background biases, all the valid data are presented. This practice was recommended by Health and Safety Laboratory (HASL) ("Reporting of Analytical Results from HASL," letter by Leo B. Higginbotham), NUREG 0475 and NUREG/CR-4007 (Sept. 1984). In instances where zeros are listed after significant digits, this is an artifact of the computer data-handling program.

Data are given according to sample type as indicated below.

- 1. Gamma Exposure Rate
- 2. Air Particulates, Gross Beta Radioactivity
- 3. Air Particulates, Weekly I-131
- 4. Air Particulates, Quantitative Gamma Spectra
- 5. Air Particulates, Quarterly Strontium*
- 6. Soil
- 7. Milk Dairy Farms*
- 8. Milk Goat Farms
- 9. Pasture Grass
- 10. Well Water
- 11. Reservoir Water*
- 12. Fruits & Vegetables
- 13. Broad Leaf Vegetation
- 14. Seawater
- 15. Bottom Sediment
- 16. Aquatic Flora
- 17. Fin Fish
- 18. Mussels
- 19. Oysters
- 20. Clams
- 21. Scallops*
- 22. Lobster (and Crabs)
- * This type of sampling or analysis was not performed; therefore there is no table.

Table 1, Quarterly TLD Gamma Exposure Rate (uR/hr)

Location Number	First Quarter	Second Quarter	Third Quarter	Fourth Quarter	Average ± 2 s.d.
01	8.28 ± 0.31	8.71 ± 0.20	8.41 ± 0.35	8.08 ± 0.24	8.37 ± 0.46
02	10.27 ± 0.53	10.37 ± 0.40	10.01 ± 0.35	9.84 ± 0.45	10.12 ± 0.42
03	7.00 ± 0.28	6.90 ± 0.34	6.42 ± 0.29	6.95 ± 0.25	6.82 ± 0.46
04	8.42 ± 0.20	8.61 ± 0.20	7.95 ± 0.42	8.59 ± 0.25	8.39 ± 0.53
05	9.73 ± 0.31	9.73 ± 0.50	9.14 ± 0.43	9.42 ± 0.28	9.51 ± 0.49
06	8.69 ± 0.20	8.79 ± 0.26	7.91 ± 0.38	8.31 ± 0.23	8.43 ± 0.69
07	5.24 ± 0.18	5.25 ± 0.25	4.40 ± 0.31	4.88 ± 0.17	4.94 ± 0.69
08	11.62 ± 0.35	11.63 ± 0.26	11.30 ± 0.92	11.03 ± 0.52	11.40 ± 0.50
09	9.23 ± 0.19	9.61 ± 0.57	9.21 ± 0.36	9.38 ± 0.29	9.36 ± 0.32
10	10.29 ± 0.26	10.72 ± 0.33	9.79 ± 0.32	9.77 ± 0.43	10.14 ± 0.79
11	7.19 ± 0.26	7.15 ± 0.32	6.65 ± 0.29	7.02 ± 0.25	7.00 ± 0.43
12-C	7.34 ± 0.29	7.75 ± 0.17	7.03 ± 0.33	7.47 ± 0.30	7.40 ± 0.52
13-C	10.57 ± 0.29	10.53 ± 0.27	10.14 ± 0.35	9.96 ± 0.38	10.30 ± 0.52
14-C	9.84 ± 0.44	10.27 ± 0.47	9.39 ± 0.48	10.09 ± 0.33	9.90 ± 0.66
15-C	7.89 ± 0.28	8.24 ± 0.27	7.82 ± 0.31	7.89 ± 0.20	7.96 ± 0.33
16-C	A	6.72 ± 0.26	6.04 ± 0.30	5.94 ± 0.23	6.23 ± 0.69
27	8.97 ± 0.53	8.94 ± 0.37	8.45 ± 0.38	8.80 ± 0.22	8.79 ± 0.41
41	6.82 ± 0.36	6.79 ± 0.21	6.79 ± 0.59	6.82 ± 0.29	6.81 ± 0.03
42	7.99 ± 0.27	8.05 ± 0.31	7.82 ± 0.47	7.71 ± 0.19	7.89 ± 0.27
43	6.85 ± 0.23	7.16 ± 0.27	6.34 ± 0.29	6.93 ± 0.22	6.82 ± 0.60
44	8.24 ± 0.29	8.21 ± 0.49	8.13 ± 0.52	8.81 ± 0.39	8.35 ± 0.54
45	7.08 ± 0.23	7.37 ± 0.19	7.16 ± 0.28	7.63 ± 0.32	7.31 ± 0.43
46	8.01 ± 0.28	8.71 ± 0.35	7.29 ± 0.38	8.15 ± 0.26	8.04 ± 1.01
47	7.73 ± 0.31	7.74 ± 0.47	7.43 ± 0.27	7.79 ± 0.38	7.67 ± 0.28
48	9.68 ± 0.27	9.65 ± 0.25	9.56 ± 0.30	9.33 ± 0.41	9.56 ± 0.27
49	7.18 ± 0.22	7.29 ± 0.28	6.77 ± 0.23	6.96 ± 0.20	7.05 ± 0.40
50	7.91 ± 0.23	8.01 ± 0.28	7.52 ± 0.29	7.59 ± 0.26	7.76 ± 0.41
51	6.52 ± 0.17	6.42 ± 0.28	6.45 ± 0.41	6.22 ± 0.18	6.40 ± 0.22
52	7.22 ± 0.18	7.21 ± 0.16	6.96 ± 0.48	7.22 ± 0.30	7.15 ± 0.22
53	7.79 ± 0.17	7.79 ± 0.28	7.27 ± 0.46	7.50 ± 0.25	7.59 ± 0.44
55	7.83 ± 0.58	9.97 ± 1.04	7.53 ± 0.36	7.66 ± 0.27	8.25 ± 2.00
56	6.86 ± 0.42	6.88 ± 0.24	6.39 ± 0.22	6.55 ± 0.30	6.67 ± 0.42
57	7.43 ± 0.36	7.75 ± 0.28	7.25 ± 0.37	7.22 ± 0.23	7.41 ± 0.42
59	8.02 ± 0.25	8.22 ± 0.26	7.91 ± 0.26	7.85 ± 0.27	8.00 ± 0.28
60	6.94 ± 0.18	7.09 ± 0.27	7.00 ± 0.36	6.68 ± 0.20	6.93 ± 0.31
61	7.34 ± 0.25	7.69 ± 0.23	7.34 ± 0.35	7.56 ± 0.20	7.48 ± 0.30
62	8.50 ± 0.18	8.83 ± 0.21	7.95 ± 0.27	8.06 ± 0.31	8.34 ± 0.70
63	8.79 ± 0.31	9.29 ± 0.24	8.63 ± 0.29	8.54 ± 0.33	8.81 ± 0.58
64	7.57 ± 0.18	7.66 ± 0.16	6.96 ± 0.30	7.50 ± 0.26	7.42 ± 0.55
65	8.00 ± 0.26	8.10 ± 0.23	7.54 ± 0.33	7.76 ± 0.25	7.85 ± 0.43
66-X	7.11 ± 0.16	7.20 ± 0.23	6.82 ± 0.23	6.94 ± 0.40	7.02 ± 0.29
73-X	9.75 ± 0.60	9.55 ± 0.27	9.15 ± 0.42	9.34 ± 0.24	9.45 ± 0.45

Table 1, Quarterly TLD Gamma Exposure Rate (uR/hr)

Page 2 of 2

Location Number	First Quarter	Second Quarter	Third Quarter	Fourth Quarter	Average ± 2 s.d.
74-X	7.41 ± 0.33	7.93 ± 0.19	7.54 ± 0.25	7.57 ± 0.19	7.61 ± 0.39
75-X	7.20 ± 0.17	7.28 ± 0.28	6.68 ± 0.22	6.55 ± 0.34	6.93 ± 0.63

 $\mathbf{Qtr} \ \mathbf{Avg} \pm \mathbf{2} \ \mathbf{sd}$

 16.1 ± 10.8

 16.7 ± 9.1

Table 2, Air Particulate Gross Beta Radioactivity (1e-3 pCi/m3)

$\begin{array}{cccccccccccccccccccccccccccccccccccc$	Collection Date			Locations			
1226 - 01/01	JANUARY	01	02	03	04	10	11
01/02 - 01/08	12/26 - 01/01						
01/09 - 01/15							
01/16-01/22							16.0 ± 4.2
01/23 - 01/29							14.7 ± 4.1
10						16.9 ± 3.9	18.6 ± 4.4
02/06 - 02/12	FEBRUARY	01	02	. 03	04	10	11
02/06 - 02/12	01/30 - 02/05	15.4 ± 3.9	12.8 ± 3.9	16.4 ± 3.7	14.5 ± 3.5	14.9 ± 3.8	13.6 ± 4.2
02/13 - 02/19							14.4 ± 4.4
02/20 - 02/26							25.4 ± 4.9
01 02 05 04 10 11 02/27 - 03/05 19.5 ± 4.1 18.7 ± 4.2 19.6 ± 3.8 16.7 ± 3.5 17.9 ± 3.9 22.2 ± 4. 03/06 - 03/12 11.2 ± 4.0 12.2 ± 4.2 17.0 ± 3.9 15.7 ± 3.6 16.3 ± 4.0 15.6 ± 4. 03/13 - 03/19 14.5 ± 4.2 14.6 ± 4.2 16.6 ± 3.9 18.6 ± 3.7 15.6 ± 4.0 14.8 ± 4. 03/20 - 03/26 10.2 ± 3.6 11.0 ± 3.7 12.4 ± 3.4 11.9 ± 3.2 9.1 ± 3.0 11.1 ± 3. Qtr Avg ± 2 sd 16.4 ± 9.8 16.8 ± 11.5 17.3 ± 8.9 16.8 ± 8.8 17.2 ± 10.0 17.2 ± 9. JANUARY 15-C 27 12/26 - 01/01 12.0 ± 3.6 12.3 ± 4.2 01/02 - 01/08 20.1 ± 3.9 14.0 ± 4.1 01/09 - 01/15 15.5 ± 3.6 17.6 ± 4.2 01/16 - 01/22 13.0 ± 3.6 14.2 ± 4.1 01/23 - 01/29 13.8 ± 3.6 20.3 ± 4.4 FEBRUARY 15-C 27 01/30 - 02/05 15.7 ± 3.7 14.0 ± 3.8 02/06 - 02/12 10.1 ± 3.7 14.4 ± 3.9 02/13 - 02/19 22.4 ± 4.2 23.4 ± 4.3 02/20 - 02/26 31.1 ± 4.4 27.4 ± 4.4 MARCH 15-C 27 02/27 - 03/05 15.4 ± 3.6 16.4 ± 3.9 03/06 - 03/12 14.6 ± 3.9 18.6 ± 4.3 03/13 - 03/19 14.6 ± 3.9 12.7 ± 4.0	02/20 - 02/26	28.9 ± 4.7	31.4 ± 4.8	28.5 ± 4.3	29.5 ± 3.9	29.4 ± 4.4	28.4 ± 4.9
02/27 - 03/05	MARCH	01	02	03	04	10	11
03/06 - 03/12	02/27 - 03/05						22.2 ± 4.5
03/13 - 03/19							15.6 ± 4.6
03/20 - 03/26							14.8 ± 4.6
JANUARY 15-C 12/26 - 01/01 12.0 ± 3.6 12.3 ± 4.2 01/02 - 01/08 20.1 ± 3.9 14.0 ± 4.1 01/09 - 01/15 15.5 ± 3.6 17.6 ± 4.2 01/16 - 01/22 13.0 ± 3.6 14.2 ± 4.1 01/23 - 01/29 13.8 ± 3.6 20.3 ± 4.4 FEBRUARY 15-C 27 01/30 - 02/05 15.7 ± 3.7 14.0 ± 3.8 02/06 - 02/12 10.1 ± 3.7 14.4 ± 3.9 02/13 - 02/26 31.1 ± 4.4 27.4 ± 4.4 MARCH 15-C 27 02/27 - 03/05 15.4 ± 3.6 16.4 ± 3.9 03/06 - 03/12 14.6 ± 3.9 18.6 ± 4.3 03/13 - 03/19 14.6 ± 3.9 12.7 ± 4.0							11.1 ± 3.1
12/26 - 01/01	$Qtr Avg \pm 2 sd$	16.4 ± 9.8	16.8 ± 11.5	17.3 ± 8.9	16.8 ± 8.8	17.2 ± 10.0	17.2 ± 9.8
12/26 - 01/01	TANHADV						-
$\begin{array}{cccccccccccccccccccccccccccccccccccc$	JANUAKI	15-C	27				
$\begin{array}{cccccccccccccccccccccccccccccccccccc$	12/26 - 01/01	12.0 ± 3.6	12.3 ± 4.2				
$\begin{array}{cccccccccccccccccccccccccccccccccccc$	01/02 - 01/08	20.1 ± 3.9	14.0 ± 4.1				
01/23 - 01/29	01/09 - 01/15	15.5 ± 3.6	17.6 ± 4.2				
FEBRUARY 15-C 27 $01/30 - 02/05$ 15.7 ± 3.7 14.0 ± 3.8 $02/06 - 02/12$ 10.1 ± 3.7 14.4 ± 3.9 $02/13 - 02/19$ 22.4 ± 4.2 23.4 ± 4.3 $02/20 - 02/26$ 31.1 ± 4.4 27.4 ± 4.4 MARCH 15-C 27 $02/27 - 03/05$ 15.4 ± 3.6 16.4 ± 3.9 $03/06 - 03/12$ 14.6 ± 3.9 18.6 ± 4.3 $03/13 - 03/19$ 14.6 ± 3.9 12.7 ± 4.0	01/16 - 01/22	13.0 ± 3.6	14.2 ± 4.1				
15-C 27 01/30 - 02/05 15.7 \pm 3.7 14.0 \pm 3.8 02/06 - 02/12 10.1 \pm 3.7 14.4 \pm 3.9 02/13 - 02/19 22.4 \pm 4.2 23.4 \pm 4.3 02/20 - 02/26 31.1 \pm 4.4 27.4 \pm 4.4 MARCH 15-C 27 02/27 - 03/05 15.4 \pm 3.6 16.4 \pm 3.9 03/06 - 03/12 14.6 \pm 3.9 18.6 \pm 4.3 03/13 - 03/19 14.6 \pm 3.9 12.7 \pm 4.0	01/23 - 01/29	13.8 ± 3.6	20.3 ± 4.4				
02/06 - 02/12	FEBRUARY	15-C	27				
$02/13 - 02/19$ 22.4 ± 4.2 23.4 ± 4.3 $02/20 - 02/26$ 31.1 ± 4.4 27.4 ± 4.4 MARCH 15-C 27 $02/27 - 03/05$ 15.4 ± 3.6 16.4 ± 3.9 $03/06 - 03/12$ 14.6 ± 3.9 18.6 ± 4.3 $03/13 - 03/19$ 14.6 ± 3.9 12.7 ± 4.0	01/30 - 02/05	15.7 ± 3.7	14.0 ± 3.8				
$02/13 - 02/19$ 22.4 ± 4.2 23.4 ± 4.3 $02/20 - 02/26$ 31.1 ± 4.4 27.4 ± 4.4 MARCH 15-C 27 $02/27 - 03/05$ 15.4 ± 3.6 16.4 ± 3.9 $03/06 - 03/12$ 14.6 ± 3.9 18.6 ± 4.3 $03/13 - 03/19$ 14.6 ± 3.9 12.7 ± 4.0					-		غنب
MARCH 15-C 27 02/27 - 03/05 15.4 ± 3.6 16.4 ± 3.9 03/06 - 03/12 14.6 ± 3.9 18.6 ± 4.3 03/13 - 03/19 14.6 ± 3.9 12.7 ± 4.0	02/13 - 02/19	22.4 ± 4.2	23.4 ± 4.3				
02/27 - 03/05	02/20 - 02/26	31.1 ± 4.4	27.4 ± 4.4				
$02/27 - 03/05$ 15.4 ± 3.6 16.4 ± 3.9 $03/06 - 03/12$ 14.6 ± 3.9 18.6 ± 4.3 $03/13 - 03/19$ 14.6 ± 3.9 12.7 ± 4.0	MARCH	15-C	27				
$03/06 - 03/12$ 14.6 ± 3.9 18.6 ± 4.3 $03/13 - 03/19$ 14.6 ± 3.9 12.7 ± 4.0	02/27 - 03/05						
$03/13 - 03/19$ 14.6 ± 3.9 12.7 ± 4.0							
			11.2 ± 3.6				

 $Qtr\ Avg \pm 2\ sd$

 15.8 ± 11.0

 14.4 ± 10.8

Table 2, Air Particulate Gross Beta Radioactivity (1e-3 pCi/m3)

Page 2 of 4

Collection Date			Locations			
APRIL	01	02	03	04	10	11
03/27 - 04/02	25.2 ± 4.7	23.5 ± 4.5	21.6 ± 4.0	25.9 ± 4.1	26.5 ± 3.9	25.6 ± 4.1
04/03 - 04/09	15.9 ± 4.0	16.6 ± 4.1	19.8 ± 3.8	15.7 ± 3.4	15.0 ± 3.3	18.1 ± 3.3
04/10 - 04/16	17.6 ± 4.4	11.7 ± 4.0	14.1 ± 3.7	15.7 ± 3.6	11.2 ± 3.5	15.2 ± 3.4
04/17 - 04/23	11.5 ± 4.0	8.7 ± 3.8	7.8 ± 3.3	11.3 ± 3.3	8.9 ± 3.4	9.2 ± 3.1
04/24 - 04/30	12.3 ± 3.6	14.8 ± 3.7	14.5 ± 3.8	15.1 ± 3.7	14.8 ± 3.8	11.0 ± 3.4
<u>MAY</u>	01	02	03	04	10	11
05/01 - 05/07	15.0 ± 3.5	10.7 ± 3.2	14.4 ± 3.5	13.6 ± 3.4	14.0 ± 3.5	13.3 ± 3.3
05/08 - 05/14	5.7 ± 3.2	4.1 ± 2.9	5.0 ± 3.2	4.5 ± 3.0	5.6 ± 3.2	5.5 ± 3.1
05/15 - 05/21	10.8 ± 3.3	8.8 ± 3.1	10.5 ± 3.4	10.1 ± 3.2	13.2 ± 3.5	9.4 ± 3.2
05/22 - 05/28	23.9 ± 3.4	19.9 ± 3.1	22.8 ± 3.3	22.2 ± 3.2	17.2 ± 4.4 C	23.0 ± 3.3
JUNE -	01	02	03	04	10	11
05/29 - 06/04	13.2 ± 3.9	26.5 ± 8.9 D	14.7 ± 3.9	13.9 ± 3.6	13.9 ± 3.7	11.5 ± 3.6
06/05 - 06/11	5.8 ± 3.2	8.5 ± 4.2 E	7.5 ± 3.2	4.6 ± 2.9	5.3 ± 3.1	6.8 ± 3.2
06/12 - 06/18	17.9 ± 4.0	19.1 ± 3.8	14.0 ± 3.7	20.5 ± 3.8	20.2 ± 4.0	19.5 ± 4.0
06/19 - 06/25	13.4 ± 3.7	17.1 ± 3.7	12.4 ± 3.5	16.1 ± 3.5	17.7 ± 3.8	16.0 ± 3.8
Qtr Avg ± 2 sd	14.5 ± 11.2	15.5 ± 11.5	13.8 ± 10.3	14.6 ± 11.9	14.1 ± 11.1	14.2 ± 11.
APRIL	15.0	27				
	15-C	27				
03/27 - 04/02	25.1 ± 4.3	24.7 ± 4.5				
04/03 - 04/09	15.6 ± 3.7	18.6 ± 4.0				
04/10 - 04/16	15.1 ± 3.9	14.4 ± 4.0				
04/17 - 04/23 04/24 - 04/30	13.4 ± 3.7 17.5 ± 4.1	10.7 ± 3.8 11.4 ± 6.0 B				
MAY	15 C	27				
0.5/01 0.5/05	15-C					
05/01 - 05/07	11.4 ± 3.5	13.2 ± 3.4				<u>~</u>
05/08 - 05/14	7.6 ± 3.4	4.1 ± 3.0				
05/15 - 05/21	14.0 ± 3.7	8.7 ± 3.2				
05/22 - 05/28	20.2 ± 3.4	21.9 ± 3.3				
<u>JUNE</u>	15-C	27				
05/29 - 06/04	14.6 ± 4.0	10.3 ± 3.5				
06/05 - 06/11	6.1 ± 3.3	5.6 ± 3.0				
06/12 - 06/18	24.8 ± 4.3	18.5 ± 3.8				
06/19 - 06/25	19.5 ± 4.0	15.2 ± 3.6				

 $\mathbf{Qtr} \ \mathbf{Avg} \pm \mathbf{2} \ \mathbf{sd}$

 20.3 ± 8.7

 19.3 ± 8.2

Table 2, Air Particulate Gross Beta Radioactivity (1e-3 pCi/m3)

Page 3 of 4

Collection Date			Locations			
JULY_	01	02	02	0.4	10	11
	01	02	03	04		11
06/26 - 07/02	22.9 ± 5.3	22.9 ± 5.0	23.1 ± 5.1	22.2 ± 4.8	22.9 ± 5.0	$23.9 \pm 5.$
07/03 - 07/09	19.0 ± 4.5	15.5 ± 4.0	20.5 ± 4.3	17.4 ± 4.0	21.2 ± 4.4	$22.8 \pm 4.$
07/10 - 07/16	21.1 ± 4.1	19.4 ± 3.9	21.0 ± 3.9	20.2 ± 3.6	19.3 ± 3.9	$22.1 \pm 4.$
07/17 - 07/23	17.2 ± 4.1	15.6 ± 4.6 F	18.9 ± 3.9	18.5 ± 3.6	21.1 ± 4.0	$19.7 \pm 4.$
07/24 - 07/30	25.1 ± 4.4	22.6 ± 3.9	22.9 ± 4.2	24.4 ± 3.9	21.2 ± 4.2	$28.9 \pm 4.$
<u>AUGUST</u>	01	02	03	04	10	11
07/31 - 08/06	27.5 ± 4.8	18.0 ± 4.0	27.5 ± 4.5	31.7 ± 4.4	27.5 ± 4.4	24.6 ± 4
08/07 - 08/13	21.5 ± 4.5	19.1 ± 3.9	21.1 ± 4.1	23.4 ± 4.1	21.5 ± 4.1	$23.0 \pm 4.$
08/14 - 08/20	19.9 ± 4.5	17.0 ± 3.9	19.5 ± 4.1	19.7 ± 4.0	18.9 ± 4.0	$18.0 \pm 3.$
08/21 - 08/27	21.9 ± 3.8	19.0 ± 3.8	20.4 ± 3.9	22.3 ± 3.9	21.4 ± 3.9	$20.0 \pm 3.$
SEPTEMBER	- 01	02	03	04	10	11
08/28 - 09/03	10.1 ± 3.2	6.5 ± 3.2	10.6 ± 3.5	8.8 ± 3.2	7.9 ± 3.3	8.8 ± 3.2
09/04 - 09/10	10.1 ± 3.2 20.3 ± 3.9	19.9 ± 4.1	10.0 ± 3.3 21.4 ± 4.2	20.8 ± 4.0	7.9 ± 3.3 21.1 ± 4.1	6.6 ± 3.2 $19.3 \pm 3.$
09/11 - 09/17					16.8 ± 2.9	
09/11 - 09/17	18.4 ± 3.0 19.8 ± 4.4	16.3 ± 4.2 F 17.1 ± 4.4	17.1 ± 3.2 21.8 ± 4.8	19.4 ± 3.0 18.4 ± 4.2	19.5 ± 4.6	$15.9 \pm 3.$
						$22.9 \pm 4.$
$Qtr Avg \pm 2 sd$	20.4 ± 8.0	17.6 ± 7.8	20.4 ± 7.4	20.6 ± 9.8	20.0 ± 8.5	20.8 ± 9.4
JULY						
	15-C	27				
06/26 - 07/02	21.7 ± 5.3	22.0 ± 4.9				
07/03 - 07/09	17.3 ± 4.4	20.0 ± 4.2				
07/10 - 07/16	21.0 ± 4.0	16.2 ± 3.6				
07/17 - 07/23	19.2 ± 4.1	20.1 ± 3.9				
07/24 - 07/30	25.3 ± 4.5	21.0 ± 3.9				
AUGUST	15-C	27				
07/31 - 08/06	24.8 ± 4.6	26.1 ± 4.3				
08/07 - 08/13	21.6 ± 4.2	20.5 ± 3.8				
08/14 - 08/20	21.2 ± 4.3	20.7 ± 3.9				
08/21 - 08/27	20.2 ± 4.0	21.3 ± 3.8				
<u>SEPTEMBER</u>	- 15-C	27 ·				
08/28 - 09/03	7.0 ± 3.4	8.0 ± 3.2				
09/04 - 09/10	7.0 ± 3.4 22.8 ± 4.4					
09/11 - 09/17	22.8 ± 4.4 20.2 ± 3.4	21.3 ± 4.0 15.5 ± 2.9				
09/11 - 09/17	20.2 ± 3.4 22.2 ± 4.9	13.3 ± 2.9 18.7 ± 4.4				
53, 10 · G3/24	22.2 ± 7.3	10.7 4 7.7				

 18.3 ± 12.1

Ann Avg ± 2 sd

 17.8 ± 11.6

Table 2, Air Particulate Gross Beta Radioactivity (1e-3 pCi/m3)

Page 4 of 4

Collection Date			Locations			
OCTOBER				0.4	10	
	01	02	03	04	10	11
09/25 - 10/01	12.1 ± 3.6	14.6 ± 3.8	13.5 ± 3.9	18.3 ± 3.8	17.2 ± 4.0	19.7 ± 4.0
10/02 - 10/08	19.8 ± 3.7	18.1 ± 3.8	20.0 ± 4.0	21.6 ± 3.8	22.0 ± 4.0	21.9 ± 3.9
10/09 - 10/15	24.0 ± 5.6	17.8 ± 5.3	25.8 ± 6.0	23.0 ± 5.4	23.5 ± 5.9	23.3 ± 5.7
10/16 - 10/22	18.2 ± 3.9	20.4 ± 4.1	18.1 ± 4.0	21.4 ± 3.9	18.9 ± 4.0	21.8 ± 4.1
10/23 - 10/29	8.0 ± 3.2	9.3 ± 3.2	7.0 ± 3.1	11.4 ± 3.3	10.8 ± 3.6	10.5 ± 3.5
NOVEMBER	01	02	03	04	10	11
10/30 - 11/05	26.6 ± 4.1	26.0 ± 4.1	27.9 ± 4.1	26.2 ± 4.0	28.8 ± 4.4	28.0 ± 4.3
11/06 - 11/12	15.0 ± 3.7	16.2 ± 3.7	18.2 ± 3.9	18.5 ± 3.7	20.5 ± 4.3	17.1 ± 4.0
11/13 - 11/19	9.1 ± 3.4	10.3 ± 3.1	8.6 ± 3.2	9.1 ± 3.2	11.4 ± 3.7	11.5 ± 3.6
11/20 - 11/26	21.0 ± 3.9	16.6 ± 3.4	22.0 ± 3.9	22.5 ± 3.8	21.3 ± 4.2	18.9 ± 4.0
		•				
DECEMBER	01	02	03	04	10	11
11/27 - 12/03	27.8 ± 4.0	25.2 ± 3.6	25.5 ± 3.9	29.8 ± 3.9	23.4 ± 4.1	22.3 ± 4.0
12/04 - 12/10	33.8 ± 4.4	34.5 ± 4.1	31.0 ± 4.2	33.3 ± 4.9	33.2 ± 4.7	33.8 ± 4.5
12/11 - 12/17	31.8 ± 4.3	25.8 ± 3.8	28.3 ± 4.1	28.5 ± 4.8	23.8 ± 4.3	28.1 ± 4.4
12/18 - 12/24	18.1 ± 3.9	18.9 ± 3.5	17.3 ± 3.8	19.5 ± 4.5	18.3 ± 3.8	16.5 ± 3.9
12/25 - 12/31	18.5 ± 3.8	14.6 ± 3.2	15.5 ± 3.6	13.6 ± 4.1	18.6 ± 3.6	20.5 ± 4.0
	20.3 ± 15.2	19.2 ± 13.1	19.9 ± 14.1	21.2 ± 13.3	20.8 ± 11.4	21.0 ± 12.1
$Qtr Avg \pm 2 sd$						
Ann Avg ± 2 sd	17.9 ± 12.5	17.3 ± 11.5	17.9 ± 11.8	18.3 ± 12.4	18.1 ± 11.6	18.3 ± 12.2
OCTOBER	15-C	27				
00/25 10/01						
09/25 - 10/01	16.7 ± 4.1	15.4 ± 3.7				
10/02 - 10/08 10/09 - 10/15	23.6 ± 4.2	22.1 ± 3.8				
10/16 - 10/22	22.4 ± 5.9 23.8 ± 4.4	22.2 ± 5.4 18.4 ± 3.8				
10/13 - 10/22	10.7 ± 3.7	7.7 ± 3.1				
10/23 - 10/29	10.7 ± 3.7	7.7 ± 3.1	4			
NOVEMBER	15-C	27				
10/30 - 11/05	28.4 ± 4.6	29.4 ± 4.2				
11/06 - 11/12	16.2 ± 4.3	14.6 ± 3.8				
11/13 - 11/19	10.5 ± 3.7	11.7 ± 3.4				
11/20 - 11/26	23.4 ± 4.4	20.8 ± 3.9				
DECEMBER	15-C	27				
11/27 - 12/03	24.4 ± 4.3	27.8 ± 4.1				
12/04 - 12/10	33.5 ± 4.8	31.9 ± 4.3				
12/11 - 12/17	28.9 ± 4.7	25.5 ± 4.1				
12/18 - 12/24	13.9 ± 4.1	20.8 ± 4.0				
12/25 - 12/31	16.9 ± 4.1	14.5 ± 3.6				
Qtr Avg ± 2 sd	21.0 ± 13.4	20.2 ± 13.5				

Table 3, Airborne Iodine I-131 (1e-3 pCi/m3)

Collection Date			Locations			
JANUARY						
	01	02	03	04	10	11
12/26 - 01/01	6 ± 15	1 ± 23	0 ± 21	-2 ± 16	0 ± 18	13 ± 19
01/02 - 01/08	-5 ± 17	0 ± 16	10 ± 16	8 ± 16	5 ± 15	-2 ± 20
01/09 - 01/15	0 ± 15	-12 ± 16	-3 ± 16	-1 ± 15	3 ± 15	-2 ± 17
01/16 - 01/22	-20 ± 19	-13 ± 18	7 ± 14	2 ± 16	12 ± 16	14 ± 20
01/23 - 01/29	15 ± 20	-16 ± 17	-32 ± 18	8 ± 14	13 ± 22	4 ± 21
FEBRUARY	-					
·	01	02	03	04	10	11
01/30 - 02/05	2 ± 29	4 ± 23	-4 ± 24	22 ± 26	8 ± 23	-2 ± 31
02/06 - 02/12	4 ± 16	0 ± 20	15 ± 17	-6 ± 16	3 ± 15	2 ± 20
02/13 - 02/19	-14 ± 27	-5 ± 21	-17 ± 25	6 ± 24	-9 ± 25	6 ± 23
02/20 - 02/26	13 ± 22	2 ± 21	9 ± 24	22 ± 23	2 ± 28	14 ± 28
MARCH						
	01	02	03	04	10	11
02/27 - 03/05	-31 ± 22	10 ± 21	13 ± 20	-3 ± 14	-19 ± 17	3 ± 22
03/06 - 03/12	14 ± 20	2 ± 16	-8 ± 16	-4 ± 13	-2 ± 17	2 ± 19
03/13 - 03/19	2 ± 29	11 ± 24	14 ± 25	18 ± 26	-17 ± 21	5 ± 25
03/20 - 03/26	6 ± 24	-7 ± 24	-8 ± 24	-2 ± 20	-27 ± 23	20 ± 23
JANUARY						
	15-C	27				
12/26 - 01/01	-1 ± 21	0 ± 21				
01/02 - 01/08	-5 ± 18	6 ± 20				
01/09 - 01/15	-11 ± 18	9 ± 18				
01/16 - 01/22	10 ± 19	-7 ± 19				
01/23 - 01/29	1 ± 16	5 ± 19				
FEBRUARY			-			
	15-C	27				
01/30 - 02/05	-2 ± 22	10 ± 23				
02/06 - 02/12	-5 ± 20	3 ± 20				
02/13 - 02/19	7 ± 27	-18 ± 22				
02/20 - 02/26	-11 ± 23	-7 ± 26				<u></u>
MARCH				•		
	15-C	27				
02/27 - 03/05	4 ± 20	-6 ± 16				
03/06 - 03/12	-10 ± 16	12 ± 21				
03/13 - 03/19	7 ± 27	-3 ± 23				
03/20 - 03/26	2 ± 27	-11 ± 22				

06/19 - 06/25

 24 ± 28

 -1 ± 31

Table 3, Airborne Iodine I-131 (1e-3 pCi/m3)

Page 2 of 4

Collection Date			Locations			
APRIL						
	01	02	03	04	10	11
03/27 - 04/02	4 ± 20	9 ± 21	17 ± 19	-17 ± 19	-7 ± 17	6 ± 17
04/03 - 04/09	16 ± 17	7 ± 17	6 ± 17	12 ± 15	-18 ± 14	-6 ± 14
04/10 - 04/16	-10 ± 23	-18 ± 20	-18 ± 20	-11 ± 17	-21 ± 19	1 ± 19
04/17 - 04/23	2 ± 24	-12 ± 23	-4 ± 22	5 ± 17	-3 ± 23	7 ± 20
04/24 - 04/30	0 ± 15	0 ± 15	1 ± 18	2 ± 15	15 ± 15	-2 ± 20
MAY						
	01	02	03	04	10	11
05/01 - 05/07	2 ± 15	6 ± 14	-5 ± 16	-5 ± 15	5 ± 14	0 ± 16
05/08 - 05/14	10 ± 18	9 ± 21	4 ± 21	5 ± 20	-13 ± 21	7 ± 18
05/15 - 05/21	11 ± 15	-13 ± 15	10 ± 19	-7 ± 19	-1 ± 17	7 ± 15
05/22 - 05/28	-10 ± 22	2 ± 20	8 ± 22	1 ± 17	-5 ± 19 C	5 ± 19
JUNE						
	01	02	03	04	10	11
05/29 - 06/04	-14 ± 27	15 ± 37 D	0 ± 22	-7 ± 22	-3 ± 26	-33 ± 22
06/05 - 06/11	-7 ± 22	6 ± 22 E	9 ± 18	-6 ± 20	-1 ± 20	2 ± 21
06/12 - 06/18	-1 ± 26	4 ± 25	-17 ± 22	28 ± 25	14 ± 25	-24 ± 27
06/19 - 06/25	26 ± 27	-37 ± 27	2 ± 26	-11 ± 21	0 ± 21	-12 ± 25
<u>APRIL</u>		-				
	15-C	27				
03/27 - 04/02	-22 ± 16	10 ± 19				
04/03 - 04/09	7 ± 15	15 ± 20				
04/10 - 04/16	6 ± 16	-24 ± 17				
04/17 - 04/23	-2 ± 24	2 ± 24				
04/24 - 04/30	-14 ± 18	-16 ± 19 B				
MAY						
	15-C	27				
05/01 - 05/07	-10 ± 21	8 ± 22				مثده
05/08 - 05/14	0 ± 23	5 ± 19				
05/15 - 05/21	8 ± 18	-11 ± 18				
05/22 - 05/28	-12 ± 19	-5 ± 22				
JUNE						
-	15-C	27				
05/29 - 06/04	24 ± 29	17 ± 33				
06/05 - 06/11	-12 ± 19	11 ± 20				
06/12 - 06/18	-2 ± 19	6 ± 25				

Table 3, Airborne Iodine I-131 (1e-3 pCi/m3)

Page 3 of 4

Collection Date			Locations			
JULY						
<u> </u>	01	02	03	04	10	11
06/26 - 07/02	-2 ± 14	-12 ± 15	3 ± 11			
07/03 - 07/09	-2 ± 14 -11 ± 22	7 ± 23	13 ± 21	1 ± 15 8 ± 17	-2 ± 16 7 ± 21	-3 ± 16
07/10 - 07/16	-2 ± 18	9 ± 18	-11 ± 19	-3 ± 17	-9 ± 19	1 ± 19 -11 ± 20
07/17 - 07/23	-6 ± 28	-5 ± 29 F	5 ± 27	0 ± 25	6 ± 24	0 ± 29
07/24 - 07/30	-5 ± 16	-6 ± 14	-3 ± 16	-6 ± 12	0 ± 24 0 ± 15	0 ± 29 2 ± 17
		•	, 5 = 10	0 = 12	0215	2 - 17
AUGUST						
	01	02	03	04	10	11
07/31 - 08/06	4 ± 22	3 ± 20	22 ± 22	-6 ± 23	-5 ± 18	-16 ± 19
08/07 - 08/13	2 ± 23	5 ± 25	-5 ± 19	-5 ± 19	-8 ± 23	-11 ± 18
08/14 - 08/20	14 ± 26	-4 ± 21 F	-4 ± 22	1 ± 19	-2 ± 22	9 ± 20
08/21 - 08/27	-20 ± 20	10 ± 22	13 ± 18	-1 ± 21	12 ± 14	2 ± 13
SEPTEMBE	<u>R</u>					
	01	02	03	04	10	11
08/28 - 09/03	-6 ± 17	4 ± 22	15 ± 20	-3 ± 15	2 ± 20	2 ± 19
09/04 - 09/10	-6 ± 18	9 ± 18	6 ± 19	-17 ± 16	9 ± 18	-6 ± 19
09/11 - 09/17	12 ± 21	-8 ± 21	5 ± 21	-4 ± 23	-11 ± 19	0 ± 26
09/18 - 09/24	8 ± 19	-5 ± 19	20 ± 18	-13 ± 15	-2 ± 17	-2 ± 19
JULY						-
	15-C	27				
06/26 - 07/02	10 ± 17	-9 ± 17				
07/03 - 07/09	-6 ± 19	18 ± 21				
07/10 - 07/16	-7 ± 19	5 ± 19				
07/17 - 07/23	2 ± 27	10 ± 27				
07/24 - 07/30	0 ± 18	-13 ± 18				
AUGUST						
HOGOSI	15-C	27				
07/21 00/07						
07/31 - 08/06	1 ± 21	-2 ± 21		-		
08/07 - 08/13 08/14 - 08/20	12 ± 22 -5 ± 19	-1 ± 19				
08/21 - 08/27	-3 ± 19 -8 ± 17	6 ± 16 5 ± 16				
		3 ± 10				
SEPTEMBER						
	15-C	27				
08/28 - 09/03	9 ± 19	7 ± 18				
09/04 - 09/10	5 ± 20	6 ± 18				
09/11 - 09/17	10 ± 29	12 ± 22				
09/18 - 09/24	13 ± 19	21 ± 21				

Table 3, Airborne Iodine I-131 (1e-3 pCi/m3)

Page 4 of 4

Collection Date			Locations			
OCTOBER						
<u> </u>	01	02	03	04	10	11
09/25 - 10/01	-9 ± 22	2 ± 24	17 ± 27	-13 ± 24	0 ± 22	5 ± 22
10/02 - 10/08	-3 ± 15	0 ± 15	-10 ± 16	-6 ± 19	-9 ± 15	-3 ± 14
10/09 - 10/15	-2 ± 19	20 ± 23	-5 ± 24	14 ± 22	8 ± 26	13 ± 26
10/16 - 10/22	2 ± 19	-7 ± 19	-14 ± 24	10 ± 20	7 ± 20	2 ± 23
10/23 - 10/29	-14 ± 21	-8 ± 16	4 ± 16	-12 ± 16	-11 ± 28	0 ± 23
NOVEMBER	<u>R</u>					
	01	02	03	. 04	10	11
10/30 - 11/05	-13 ± 18	-7 ± 24	-4 ± 22	2 ± 23	2 ± 26	0 ± 24
11/06 - 11/12	15 ± 20	6 ± 20	2 ± 24	-8 ± 21	2 ± 25	-20 ± 24
11/13 - 11/19	2 ± 22	-19 ± 19	13 ± 22	0 ± 20	5 ± 23	-16 ± 23
11/20 - 11/26	4 ± 23	4 ± 17	-10 ± 23	18 ± 20	-16 ± 25	-20 ± 23
DECEMBER	2	•				
	01	02	03	04	10	11
11/27 - 12/03	2 ± 16	9 ± 14	-3 ± 15	3 ± 15	-2 ± 18	2 ± 18
12/04 - 12/10	3 ± 16	-1 ± 12	-7 ± 15	-9 ± 16	-7 ± 20	-6 ± 15
12/11 - 12/17	-8 ± 28	-1 ± 18	-8 ± 26	7 ± 25	5 ± 26	-9 ± 23
12/18 - 12/24	-3 ± 25	5 ± 27	-3 ± 26	-19 ± 32	-18 ± 25	0 ± 28
12/25 - 12/31	-8 ± 20	-9 ± 20	10 ± 21	-5 ± 25	14 ± 22	2 ± 18
OCTOBER						
	15-C	27				
09/25 - 10/01	-8 ± 21	-5 ± 26				
10/02 - 10/08	4 ± 17	-5 ± 12				
10/09 - 10/15	-19 ± 27	7 ± 24				
10/16 - 10/22	-3 ± 27	2 ± 22				
10/23 - 10/29	2 ± 23	12 ± 20				
NOVEMBER	<u>ર</u>					
	15-C	27				-
10/30 - 11/05	-3 ± 22	7 ± 21				
11/06 - 11/12	3 ± 26	-4 ± 25				
11/13 - 11/19	-7 ± 23	-13 ± 21				
11/20 - 11/26	2 ± 25	9 ± 23				
DECEMBER	<u>L</u>					
	15-C	27				
11/27 - 12/03	10 ± 19	10 ± 19				
12/04 - 12/10	-3 ± 17	0 ± 13			•	
12/11 - 12/17	-7 ± 21	-2 ± 19				
12/18 - 12/24	-12 ± 20	-11 ± 18				
12/25 - 12/31	-5 ± 19	-4 ± 21				

Page 1 of 1

Table 4-A, Air Particulates Gamma Spectra - Quarter 1 (1e-3 pCi/m3)

Location	Isotope							
	Ba-140	B e-7	Ce-141	Ce-144	Co-58	Co-60	Cr-51	
01	-10.0 ± 15.0	91.0 ± 28.0	0.4 ± 2.2	-0.6 ± 3.2	0.3 ± 1.2	-0.2 ± 0.8	-2.0 ± 23.0	
02	0.0 ± 16.0	107.0 ± 29.0	-0.4 ± 1.5	-0.3 ± 2.1	0.2 ± 0.9	0.9 ± 0.8	-7.0 ± 17.0	
03	-4.0 ± 16.0	96.0 ± 25.0	0.8 ± 2.1	-2.1 ± 2.3	0.5 ± 1.0	0.5 ± 0.6	15.0 ± 17.0	
04	11.0 ± 11.0	107.0 ± 23.0	-1.9 ± 1.6	-0.2 ± 2.3	-1.1 ± 1.1	0.4 ± 0.8	-3.0 ± 14.0	
10	0.0 ± 11.0	107.0 ± 28.0	-1.1 ± 2.1	0.9 ± 3.1	0.4 ± 1.3	-0.4 ± 1.4	10.0 ± 24.0	
11	-6.0 ± 13.0	87.0 ± 27.0	0.4 ± 2.1	-2.3 ± 3.0	0.1 ± 1.1	0.4 ± 1.0	-20.0 ± 23.0	
15-C	-7.0 ± 10.0	77.0 ± 24.0	-0.4 ± 2.0	-0.9 ± 2.3	1.8 ± 1.4	-1.0 ± 0.9	-6.0 ± 24.0	
27	14.0 ± 20.0	84.0 ± 29.0	-1.1 ± 2.5	-0.8 ± 3.5	-0.2 ± 1.7	0.6 ± 1.3	6.0 ± 18.0	
	Cs-134	Cs-137	Mn-54	Nb-95	Ru-103	Ru-106	Zr-95	
01	0.5 ± 0.9	0.7 ± 0.8	0.3 ± 0.7	1.2 ± 1.9	0.7 ± 2.0	-0.7 ± 6.2	-1.0 ± 1.6	
02	-0.1 ± 0.7	0.5 ± 0.5	0.2 ± 0.9	-0.4 ± 1.8	0.0 ± 1.3	4.4 ± 6.3	-2.6 ± 2.6	
03	-0.2 ± 0.6	-0.1 ± 0.6	-0.6 ± 1.0	-1.2 ± 1.6	0.7 ± 1.2	1.3 ± 6.8	2.5 ± 2.8	
04	0.8 ± 0.7	0.0 ± 0.5	0.0 ± 0.5	-1.5 ± 2.0	0.7 ± 1.3	-0.6 ± 4.6	-0.8 ± 1.9	
10	-0.8 ± 0.9	0.0 ± 0.7	0.2 ± 1.0	0.7 ± 1.8	-0.5 ± 1.5	2.4 ± 8.2	1.7 ± 2.3	
11	-0.2 ± 0.6	0.2 ± 0.7	0.4 ± 0.8	0.3 ± 2.6	0.7 ± 1.0	-6.0 ± 10.0	0.3 ± 2.5	
15-C	0.3 ± 0.7	-0.1 ± 0.8	0.1 ± 0.6	-1.6 ± 1.7	-0.7 ± 1.1	-3.9 ± 6.0	-0.1 ± 2.2	
27	0.7 ± 0.7	-0.1 ± 0.9	0.5 ± 0.8	0.2 ± 2.2	0.3 ± 2.0	-3.8 ± 8.4	-1.2 ± 2.2	

Table 4-B, Air Particulates Gamma Spectra - Quarter 2 (1e-3 pCi/m3)

Location		Isotope						
	Ba-140	Be-7	Ce-141	Ce-144	Co-58	Co-60	Cr-51	
01	9.0 ± 22.0	80.0 ± 36.0	-0.5 ± 3.9	-0.4 ± 5.8	-0.3 ± 2.0	-0.3 ± 0.9	-22.0 ± 36.0	
02	5.0 ± 16.0	95.0 ± 37.0	1.7 ± 4.5	6.1 ± 5.7	1.6 ± 1.9	-0.1 ± 1.5	30.0 ± 33.0	
03	-4.0 ± 26.0	98.0 ± 37.0	0.1 ± 4.1	-4.3 ± 5.7	0.6 ± 1.5	0.6 ± 1.0	-18.0 ± 31.0	
04	-8.0 ± 20.0	69.0 ± 33.0	-0.1 ± 3.6	-1.1 ± 5.4	0.4 ± 1.6	0.5 ± 1.3	-20.0 ± 30.0	
10	-13.0 ± 15.0	90.0 ± 34.0	1.6 ± 4.7	0.4 ± 5.5	0.2 ± 1.8	-0.3 ± 0.8	3.0 ± 38.0	
11	-16.0 ± 20.0	97.0 ± 34.0	-1.2 ± 3.9	1.5 ± 4.2	-1.1 ± 1.2	1.2 ± 1.3	-11.0 ± 32.0	
15-C	13.0 ± 20.0	79.0 ± 31.0	0.4 ± 4.2	-2.9 ± 5.9	0.7 ± 1.5	-1.3 ± 1.2	6.0 ± 33.0	
27	-4.0 ± 15.0	139.0 ± 39.0	1.9 ± 3.8	-0.4 ± 5.7	-0.9 ± 1.6	0.2 ± 1.1	0.0 ± 33.0	
	Cs-134	Cs-137	Mn-54	Nb-95	Ru-103	Ru-106	Zr-95	
01	0.4 ± 0.9	-0.1 ± 1.0	0.0 ± 1.2	2.7 ± 3.4	0.3 ± 2.4	1.0 ± 12.0	-1.2 ± 2.8	
02	0.7 ± 1.3	0.1 ± 0.9	0.0 ± 1.2	-1.6 ± 3.3	0.7 ± 1.4	-3.0 ± 12.0	1.8 ± 3.1	
03	0.1 ± 0.9	0.7 ± 1.2	-0.2 ± 1.5	-2.9 ± 2.2	-0.3 ± 2.6	0.0 ± 10.0	-1.9 ± 2.9	
04	-0.2 ± 1.0	-0.4 ± 1.1	-0.6 ± 1.0	-0.6 ± 2.3	-0.3 ± 2.2	-10.0 ± 13.0	-0.6 ± 2.7	
10	0.5 ± 1.1	0.0 ± 1.0	-0.2 ± 1.1	1.3 ± 3.5	-1.6 ± 2.6	1.0 ± 11.0	2.0 ± 2.3	
11	0.0 ± 0.6	-0.3 ± 1.0	0.3 ± 1.2	0.3 ± 2.6	0.0 ± 2.1	7.0 ± 8.0	-0.6 ± 2.4	
15-C	-0.2 ± 1.1	0.5 ± 1.1	0.2 ± 1.4	-0.1 ± 3.3	-0.3 ± 2.4	4.5 ± 9.9	1.7 ± 2.6	
27	0.0 ± 1.1	-0.4 ± 0.9	0.9 ± 1.3	-1.3 ± 3.6	-0.7 ± 3.0	-0.9 ± 8.3	-0.2 ± 2.8	

Table 4-C, Air Particulates Gamma Spectra - Quarter 3 (1e-3 pCi/m3)

Location				Isotope			
	Ba-140	Be-7	Ce-141	Ce-144	Co-58	Co-60	Cr-51
01	0.0 ± 19.0	124.0 ± 34.0	0.4 ± 3.9	-2.8 ± 5.2	0.5 ± 1.8	-0.4 ± 0.9	-5.0 ± 34.0
02	-16.0 ± 22.0	94.0 ± 30.0	1.1 ± 4.1	2.2 ± 4.6	0.2 ± 1.5	0.3 ± 0.8	-17.0 ± 35.0
03	0.0 ± 22.0	139.0 ± 33.0	-1.3 ± 4.0	-2.4 ± 4.5	1.5 ± 1.6	0.1 ± 0.7	16.0 ± 30.0
04	11.0 ± 16.0	140.0 ± 31.0	2.4 ± 4.0	-4.0 ± 4.4	-0.7 ± 1.4	0.1 ± 1.0	-7.0 ± 32.0
10	8.0 ± 21.0	128.0 ± 33.0	-0.2 ± 3.8	5.3 ± 4.2	0.5 ± 1.2	-0.1 ± 1.0	-12.0 ± 32.0
11	4.0 ± 13.0	120.0 ± 30.0	2.2 ± 4.3	-0.8 ± 4.1	-0.4 ± 1.7	-0.3 ± 1.1	25.0 ± 31.0
15-C	4.0 ± 18.0	129.0 ± 34.0	3.2 ± 4.5	-2.0 ± 4.9	0.4 ± 1.4	0.1 ± 0.9	-3.0 ± 34.0
27	11.0 ± 19.0	134.0 ± 31.0	-0.6 ± 3.8	-2.0 ± 4.1	-0.2 ± 1.4	0.0 ± 0.6	-5.0 ± 27.0
	Cs-134	Cs-137	Mn-54	Nb-95	Ru-103	Ru-106	Zr-95
01	-0.1 ± 0.8	1.0 ± 0.8	0.2 ± 0.9	1.4 ± 3.0	0.2 ± 2.2	-0.5 ± 8.6	-0.4 ± 2.5
02	0.8 ± 0.8	-0.4 ± 0.7	0.5 ± 1.1	-0.9 ± 3.2	-0.2 ± 2.5	4.4 ± 8.7	0.8 ± 3.1
03	0.4 ± 0.9	0.5 ± 0.8	0.1 ± 0.8	-0.5 ± 2.1	-2.1 ± 2.6	-2.5 ± 8.9	4.1 ± 3.1
04	0.3 ± 1.0	-0.5 ± 0.9	0.2 ± 0.7	-1.6 ± 2.1	0.4 ± 1.8	-2.9 ± 9.7	0.0 ± 2.4
10	-0.3 ± 1.0	0.3 ± 0.9	-0.2 ± 0.9	-2.0 ± 2.3	0.7 ± 2.6	-1.6 ± 9.0	-0.3 ± 2.6
11	-0.6 ± 1.0	0.3 ± 0.6	-0.1 ± 1.0	-0.2 ± 3.1	3.3 ± 2.7	3.2 ± 8.6	-2.4 ± 2.2
15-C	-0.2 ± 1.0	0.9 ± 1.0	0.0 ± 0.8	-1.3 ± 3.2	0.7 ± 2.3	-10.7 ± 9.6	1.1 ± 2.8
27	-0.2 ± 0.9	-0.4 ± 0.9	-0.4 ± 1.1	0.5 ± 3.2	-1.4 ± 1.9	-7.3 ± 9.5	2.0 ± 3.1

Table 4-D, Air Particulates Gamma Spectra - Quarter 4 (1e-3 pCi/m3)

Location				Isotope			
	Ba-140	Be-7	Ce-141	Ce-144	Co-58	Co-60	Cr-51
01	80.0 ± 110.0	58.0 ± 42.0	5.2 ± 8.5	0.4 ± 5.2	1.7 ± 2.6	0.1 ± 1.5	-67.0 ± 80.0
02	20.0 ± 110.0	102.0 ± 44.0	2.8 ± 7.8	0.0 ± 5.5	1.4 ± 1.9	-0.6 ± 1.4	32.0 ± 69.0
03	-26.0 ± 88.0	135.0 ± 50.0	6.9 ± 8.4	-2.4 ± 6.0	0.1 ± 1.7	0.6 ± 1.2	27.0 ± 71.0
04	80.0 ± 130.0	42.0 ± 45.0	1.3 ± 7.4	-0.4 ± 5.9	-2.5 ± 1.8	0.4 ± 1.1	-13.0 ± 63.0
10	-50.0 ± 150.0	92.0 ± 49.0	3.2 ± 8.9	1.3 ± 5.5	-1.9 ± 2.4	-0.3 ± 0.9	-7.0 ± 83.0
11	-50.0 ± 110.0	58.0 ± 39.0	-7.5 ± 8.7	2.5 ± 6.4	-1.7 ± 2.9	-1.0 ± 1.0	-56.0 ± 93.0
15-C	-30.0 ± 100.0	94.0 ± 49.0	3.3 ± 9.0	-0.9 ± 5.9	-0.8 ± 2.9	-0.1 ± 1.4	-61.0 ± 80.0
27	30.0 ± 110.0	93.0 ± 46.0	1.3 ± 9.1	1.2 ± 5.0	-2.4 ± 2.0	-0.1 ± 1.1	40.0 ± 65.0
	Cs-134	Cs-137	Mn-54	Nb-95	Ru-103	Ru-106	Zr-95
01	0.2 ± 0.9	0.3 ± 0.8	-0.2 ± 1.1	-3.4 ± 6.6	2.8 ± 3.3	3.1 ± 9.3	-1.3 ± 4.8
02	0.0 ± 1.1	-0.3 ± 1.1	-0.8 ± 1.1	-5.8 ± 5.2	-1.6 ± 3.5	2.7 ± 9.6	1.0 ± 3.6
03	-0.2 ± 1.1	-0.4 ± 1.0	-0.2 ± 1.3	-1.1 ± 6.1	1.7 ± 4.8	-1.3 ± 9.9	0.3 ± 3.1
04	-0.3 ± 0.8	-0.3 ± 1.0	0.9 ± 1.2	-3.8 ± 7.9	0.6 ± 4.3	4.6 ± 8.8	3.6 ± 4.3
10	-0.7 ± 1.1	0.5 ± 0.9	0.0 ± 0.9	-4.2 ± 8.1	0.6 ± 4.6	-4.0 ± 11.0	-1.6 ± 4.0
11	-0.1 ± 1.0	0.6 ± 1.0	-0.2 ± 1.1	-1.9 ± 6.6	-1.7 ± 4.5	-2.5 ± 9.0	-0.3 ± 3.9
15-C	0.9 ± 1.4	-0.8 ± 1.2	0.2 ± 1.2	1.6 ± 7.2	-0.6 ± 4.8	8.0 ± 13.0	0.6 ± 4.9
27	-0.2 ± 1.2	0.3 ± 0.9	0.2 ± 0.8	-3.6 ± 5.7	0.0 ± 3.5	-3.7 ± 8.2	-1.2 ± 4.8
11 15-C	-0.1 ± 1.0 0.9 ± 1.4	0.6 ± 1.0 -0.8 \pm 1.2	-0.2 ± 1.1 0.2 ± 1.2	-1.9 ± 6.6 1.6 ± 7.2	-1.7 ± 4.5 -0.6 ± 4.8	-2.5 ± 9.0 8.0 ± 13.0	-0.3 ± 3 0.6 ± 4

Table 6, Soil (pCi/g Dry)

Location	Collection Date			Isotope			
03		Be-7	Ce-141	Ce-144	Co-58	Co-60	Cr-51
	05/05/06	0.06 ± 0.30	0.00 ± 0.05	0.10 ± 0.20	-0.03 ± 0.04	-0.04 ± 0.05	-0.01 ± 0.33
		Cs-134	Cs-137	Fe-59	K-40	Mn-54	Nb-95
	05/05/06	0.02 ± 0.04	0.63 ± 0.10	-0.01 ± 0.08	10.90 ± 1.50	-0.02 ± 0.04	0.00 ± 0.05
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	05/05/06	0.00 ± 0.03	0.12 ± 0.36	0.04 ± 0.10	0.66 ± 0.20	-0.01 ± 0.11	-0.03 ± 0.06
04		Be-7	Ce-141	Ce-144	Co-58	Co-60	Cr-51
	05/05/06	0.27 ± 0.31	-0.02 ± 0.05	0.19 ± 0.22	-0.02 ± 0.04	0.01 ± 0.04	0.26 ± 0.33
		Cs-134	Cs-137	Fe-59	K-40	Mn-54	Nb-95
	05/05/06	-0.01 ± 0.03	0.54 ± 0.08	0.07 ± 0.08	11.50 ± 1.30	0.01 ± 0.04	-0.01 ± 0.06
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	05/05/06	0.04 ± 0.04	0.00 ± 0.37	0.02 ± 0.09	1.00 ± 0.17	-0.03 ± 0.17	-0.01 ± 0.06
14-C		Be-7	Ce-141	Ce-144	Co-58	Co-60	Cr-51
	05/05/06	0.03 ± 0.35	-0.03 ± 0.07	0.00 ± 0.25	-0.03 ± 0.04	-0.01 ± 0.03	-0.08 ± 0.34
		Cs-134	Cs-137	Fe-59	K-40	Mn-54	Nb-95
	05/05/06	0.00 ± 0.04	1.12 ± 0.11	-0.05 ± 0.07	12.70 ± 1.30	0.01 ± 0.04	-0.02 ± 0.04
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	05/05/06	-0.01 ± 0.04	-0.13 ± 0.32	-0.08 ± 0.12	1.30 ± 0.18	0.00 ± 0.17	-0.02 ± 0.05

Table 7, Cow Milk

No data collected during 2006

Table 8, Goat Milk (pCi/L)

Location	Collection Date			Isotope			
21		Ba-140	Cs-134	Cs-137	I-131	K-40	La-140
	05/10/06	-0.70 ± 5.40	1.80 ± 4.10	3.40 ± 4.30	0.02 ± 0.21	1820.00 ± 150.00	-0.80 ± 6.20
	05/24/06	3.30 ± 4.60	1.40 ± 3.90	9.40 ± 4.80	0.15 ± 0.26	1280.00 ± 120.00	3.80 ± 5.30
	06/14/06	1.10 ± 6.60	1.10 ± 4.30	3.30 ± 4.20	-0.11 ± 0.04	1470.00 ± 160.00	1.30 ± 7.60
	06/28/06	0.50 ± 7.00	2.50 ± 4.10	5.70 ± 4.40	0.08 ± 0.27	1320.00 ± 120.00	0.60 ± 8.10
	07/26/06	-2.20 ± 5.10	2.20 ± 3.80	-2.00 ± 4.70	-0.04 ± 0.02	950.00 ± 130.00	-2.50 ± 5.90
	08/23/06	-3.00 ± 5.50	0.30 ± 3.30	7.70 ± 4.40	0.01 ± 0.31	950.00 ± 98.00	-3.50 ± 6.40
		Sr-89	Sr-90				
	06/28/06	0.80 ± 5.70	0.90 ± 1.10				
	08/23/06	-2.80 ± 5.20	0.70 ± 1.10				
24-C		Ba-140	Cs-134	Cs-137	I-131	K-40	La-140
	04/26/06	-4.50 ± 6.00	-3.10 ± 4.70	4.20 ± 4.30	0.02 ± 0.16	1750.00 ± 160.00	-5.20 ± 6.90
	04/20/00	7.60 ± 7.10	1.00 ± 5.90	2.80 ± 5.50	-0.02 ± 0.10	1600.00 ± 100.00	8.80 ± 8.20
	06/28/06	4.30 ± 7.40	0.50 ± 4.30	5.90 ± 4.20	0.07 ± 0.03	1710.00 ± 160.00	4.90 ± 8.60
	07/12/06	2.90 ± 6.90	-2.80 ± 5.30	4.00 ± 4.70	-0.04 ± 0.02	1600.00 ± 210.00	3.30 ± 7.90
	07/26/06	-1.00 ± 6.60	-1.70 ± 4.20	2.60 ± 4.20	-0.05 ± 0.02	1380.00 ± 140.00	-1.10 ± 7.60
	08/09/06	-1.30 ± 4.20	0.40 ± 3.60	7.50 ± 5.30	0.45 ± 0.55	1860.00 ± 140.00	-1.50 ± 4.90
	08/23/06	2.10 ± 5.40	-0.30 ± 3.60	12.90 ± 4.80	-0.07 ± 0.02	1890.00 ± 130.00	2.40 ± 6.30
	10/11/06	-2.30 ± 5.30	1.20 ± 3.80	4.70 ± 5.30	-0.06 ± 0.02	1690.00 ± 150.00	-2.70 ± 6.20
		Sr-89	Sr-90				
	06/28/06	-2.50 ± 4.00	0.84 ± 0.79				
	08/23/06	4.60 ± 5.70	0.10 ± 1.10				

Location	Collection Date			Isotope			
21	Ва	a-140	B e-7	Ce-141	Ce-144	Co-58	Co-60
	01/11/06 -0.004 ±	0.027.6	-0.280 ± 0.220	0.007 ± 0.038	-0.070 ± 0.130	0.005 ± 0.027	-0.028 ± 0.042
	$01/11/06 - 0.004 \pm 02/15/06 - 0.021 \pm$		-0.280 ± 0.220 -0.010 ± 0.200	-0.007 ± 0.038 -0.015 ± 0.043	0.000 ± 0.120	0.003 ± 0.027 0.004 ± 0.030	0.028 ± 0.042 0.022 ± 0.028
	$03/22/06 - 0.021 \pm 03/22/06 - 0.025 \pm$		0.230 ± 0.210	-0.015 ± 0.045 -0.005 ± 0.030	0.000 ± 0.120 0.070 ± 0.110	0.004 ± 0.030 0.008 ± 0.025	-0.018 ± 0.032
	04/12/06 -0.005 ±		0.120 ± 0.190	-0.044 ± 0.031	0.076 ± 0.110 0.036 ± 0.099	-0.003 ± 0.023	0.004 ± 0.037
	04/26/06 0.008 ±		-0.040 ± 0.300	-0.032 ± 0.044	0.000 ± 0.000	-0.007 ± 0.024 -0.006 ± 0.034	-0.021 ± 0.037
	07/12/06 -0.024		0.410 ± 0.340	-0.013 ± 0.042	-0.010 ± 0.130	0.006 ± 0.034 0.006 ± 0.033	0.021 ± 0.037 0.019 ± 0.043
	08/09/06 -0.013		0.190 ± 0.190	0.018 ± 0.022	0.050 ± 0.071	-0.005 ± 0.016	0.000 ± 0.024
	08/23/06 -0.044		0.270 ± 0.200	-0.006 ± 0.023	0.007 ± 0.077	-0.008 ± 0.020	0.000 ± 0.026
	09/06/06 -0.027	± 0.021	0.860 ± 0.130	-0.010 ± 0.013	0.015 ± 0.039	0.005 ± 0.009	-0.012 ± 0.012
	09/20/06 -0.011 :		1.640 ± 0.200	0.005 ± 0.009	-0.019 ± 0.033	-0.003 ± 0.009	0.006 ± 0.012
		± 0.029	0.900 ± 0.180	0.002 ± 0.015	-0.027 ± 0.043	-0.009 ± 0.015	0.008 ± 0.014
		± 0.065	2.150 ± 0.400	-0.017 ± 0.030	-0.003 ± 0.087	0.002 ± 0.020	-0.012 ± 0.028
	11/15/06 -0.034		2.670 ± 0.360	-0.010 ± 0.031	0.069 ± 0.071	-0.005 ± 0.018	0.000 ± 0.014
		± 0.032	2.780 ± 0.260	-0.007 ± 0.021	-0.040 ± 0.060	-0.003 ± 0.014	-0.004 ± 0.012
	12/13/06 -0.020 ±	0.100 G	1.600 ± 0.340	-0.054 ± 0.060	0.030 ± 0.100	0.004 ± 0.026	0.017 ± 0.025
	C	r-51	Cs-134	Cs-137	Fe-59	I-131	K-40
	01/11/06 0.020 =	± 0.250	0.002 ± 0.031	-0.018 ± 0.033	-0.018 ± 0.069	-0.003 ± 0.001	8.800 ± 1.100
		± 0.310	-0.015 ± 0.024	-0.015 ± 0.021	0.024 ± 0.078	-0.002 ± 0.001	10.300 ± 1.000
		± 0.210	-0.002 ± 0.027	-0.006 ± 0.028	0.032 ± 0.061	0.003 ± 0.009	9.100 ± 1.000
		± 0.220	0.027 ± 0.027	-0.004 ± 0.025	-0.017 ± 0.054	0.005 ± 0.010	8.700 ± 0.930
		± 0.290	0.006 ± 0.030	0.005 ± 0.027	0.042 ± 0.084	-0.008 ± 0.014	9.300 ± 1.300
		± 0.280	0.006 ± 0.032	0.012 ± 0.032	0.034 ± 0.077	0.012 ± 0.021	6.300 ± 1.100
		± 0.140 ± 0.150	0.027 ± 0.019 0.005 ± 0.020	0.006 ± 0.018 0.023 ± 0.022	-0.010 ± 0.039	-0.001 ± 0.017 0.000 ± 0.018	5.640 ± 0.640
		± 0.130 ± 0.090	0.003 ± 0.020 0.003 ± 0.010	0.023 ± 0.022 0.011 ± 0.010	0.025 ± 0.053 0.007 ± 0.021	-0.000 ± 0.018 -0.008 ± 0.003	3.510 ± 0.670 4.090 ± 0.300
	09/20/06 -0.032 :		0.003 ± 0.010 0.008 ± 0.009	0.001 ± 0.010 0.002 ± 0.008	-0.007 ± 0.021	0.005 ± 0.005	3.870 ± 0.300
		± 0.110	0.000 ± 0.005 0.001 ± 0.014	0.002 ± 0.003 0.020 ± 0.013	0.007 ± 0.025 0.008 ± 0.036	0.005 ± 0.016 0.005 ± 0.014	4.760 ± 0.520
		± 0.220	0.007 ± 0.020	-0.010 ± 0.021	0.000 ± 0.054	0.002 ± 0.016	6.240 ± 0.820
	11/15/06 -0.040 :		-0.002 ± 0.015	0.003 ± 0.015	-0.018 ± 0.043	0.016 ± 0.027	4.440 ± 0.550
	11/29/06 -0.020 :	± 0.150	-0.013 ± 0.021	-0.004 ± 0.012	0.008 ± 0.032	-0.004 ± 0.001	5.380 ± 0.430
	12/13/06 0.130 =	± 0.340	-0.017 ± 0.026	0.030 ± 0.033	-0.085 ± 0.070	-0.020 ± 0.270	20.010 ± 0.840
	L	ı-140	Mn-54	Nb-95	Ru-103	Ru-106	Sb-125
	01/11/06 -0.005		0.017 ± 0.028	0.009 ± 0.046	-0.002 ± 0.024	0.080 ± 0.240	-0.007 ± 0.068
	02/15/06 -0.024	± 0.090	0.002 ± 0.025	-0.033 ± 0.039	0.000 ± 0.032	-0.010 ± 0.240	0.000 ± 0.058
	03/22/06 -0.029		0.017 ± 0.023	-0.012 ± 0.029	-0.026 ± 0.022	0.060 ± 0.240	-0.004 ± 0.065
	04/12/06 -0.005		0.003 ± 0.022	0.004 ± 0.024	0.007 ± 0.023	0.010 ± 0.210	0.003 ± 0.058
	04/26/06 0.009 =		-0.006 ± 0.031	-0.017 ± 0.035	0.022 ± 0.038	-0.260 ± 0.270	0.000 ± 0.075
	07/12/06 -0.027 :		-0.008 ± 0.032	-0.003 ± 0.039	0.023 ± 0.030	-0.040 ± 0.300	-0.050 ± 0.074
	08/09/06 -0.015 = 08/23/06 -0.050 =		0.006 ± 0.016	-0.003 ± 0.018	-0.007 ± 0.017	0.020 ± 0.150	-0.060 ± 0.043
	09/06/06 -0.031		-0.007 ± 0.018 0.001 ± 0.009	-0.014 ± 0.025 0.004 ± 0.011	0.002 ± 0.020 -0.003 \pm 0.009	0.000 ± 0.160 0.013 ± 0.085	0.003 ± 0.041 0.004 ± 0.021
	09/20/06 -0.013		-0.006 ± 0.009	0.004 ± 0.011 0.010 ± 0.009	0.003 ± 0.009 0.003 ± 0.007	-0.013 ± 0.063	0.004 ± 0.021 0.011 ± 0.022
	10/11/06 0.011		-0.000 ± 0.008	-0.005 ± 0.009	0.003 ± 0.007 0.005 ± 0.013	-0.013 ± 0.008 -0.010 ± 0.110	0.011 ± 0.022 0.010 ± 0.032
	10/25/06 0.000 =		0.000 ± 0.014 0.004 ± 0.020	-0.009 ± 0.010 -0.019 ± 0.030	0.003 ± 0.013 0.004 ± 0.023	-0.010 ± 0.110 -0.130 ± 0.200	-0.023 ± 0.050
	11/15/06 -0.039		0.023 ± 0.016	-0.015 ± 0.036 -0.005 ± 0.025	0.004 ± 0.023 0.013 ± 0.020	-0.130 ± 0.200 -0.070 ± 0.150	-0.025 ± 0.036
	11/29/06 0.005		0.003 ± 0.011	-0.003 ± 0.017	-0.002 ± 0.016	-0.030 ± 0.110	-0.002 ± 0.029
	12/13/06 -0.030 =	± 0.120	0.021 ± 0.023	0.006 ± 0.036	0.005 ± 0.030	-0.140 ± 0.220	-0.013 ± 0.056

Page 2 of 4

Location	Collection Date			Isotope			
21		Th-228	Zn-65	Zr-95			
	01/11/06	0.010 ± 0.110	0.057 ± 0.070	-0.032 ± 0.047			
	02/15/06	0.035 ± 0.099	-0.005 ± 0.054	-0.011 ± 0.054			
	03/22/06	0.006 ± 0.099	0.014 ± 0.062	0.011 ± 0.039			
	04/12/06 04/26/06	0.010 ± 0.096 -0.080 ± 0.110	0.008 ± 0.057 -0.025 ± 0.072	-0.008 ± 0.038 0.000 ± 0.055			
	07/12/06	0.140 ± 0.110	-0.023 ± 0.072 -0.038 ± 0.067	0.026 ± 0.058			
	08/09/06	0.048 ± 0.069	-0.015 ± 0.043	-0.028 ± 0.029			
	08/23/06	-0.029 ± 0.062	-0.047 ± 0.049	-0.013 ± 0.034			
	09/06/06	0.019 ± 0.045	-0.010 ± 0.022	-0.007 ± 0.017	•		
	09/20/06	0.033 ± 0.036	-0.020 ± 0.028	-0.011 ± 0.015			
	10/11/06 10/25/06	0.064 ± 0.050 0.000 ± 0.100	0.045 ± 0.061 -0.029 \pm 0.067	0.013 ± 0.027 -0.008 \pm 0.041			
	11/15/06	-0.005 ± 0.065	-0.029 ± 0.007 -0.033 ± 0.039	-0.008 ± 0.041 -0.046 ± 0.032			
	11/29/06	0.033 ± 0.056	0.002 ± 0.035	0.015 ± 0.026			
	12/13/06	0.117 ± 0.082	-0.001 ± 0.059	0.037 ± 0.048			
22		Ba-140	Be-7	Ce-141	Ce-144	Co-58	Co-60
	01/11/06	-0.022 ± 0.037 G	0.210 ± 0.200	0.028 ± 0.041	0.020 ± 0.120	-0.021 ± 0.030	0.020 ± 0.033
		-0.022 ± 0.037 G -0.130 ± 0.110 G	0.210 ± 0.200 0.130 ± 0.320	0.028 ± 0.041 0.012 ± 0.054	0.020 ± 0.120 0.090 ± 0.120	0.021 ± 0.030 0.014 ± 0.034	0.020 ± 0.033 0.012 ± 0.032
		$-0.019 \pm 0.042 \mathrm{G}$	0.950 ± 0.320	-0.034 ± 0.047	0.070 ± 0.140	0.014 ± 0.030	0.027 ± 0.032
		$0.025 \pm 0.059 \text{ G}$	1.120 ± 0.280	-0.004 ± 0.024	-0.014 ± 0.083	-0.007 ± 0.028	0.046 ± 0.033
		-0.022 ± 0.051 G	3.050 ± 0.340	-0.011 ± 0.023	-0.074 ± 0.080	-0.007 ± 0.026	0.009 ± 0.028
		-0.004 ± 0.033	0.260 ± 0.170	-0.011 ± 0.020	-0.068 ± 0.072	0.006 ± 0.017	0.025 ± 0.032
		-0.024 ± 0.035 -0.030 ± 0.120	0.850 ± 0.330 0.780 ± 0.430	-0.013 ± 0.024 -0.009 ± 0.044	-0.087 ± 0.092 -0.020 ± 0.100	0.008 ± 0.022 -0.013 \pm 0.032	0.020 ± 0.034 0.012 ± 0.032
		-0.030 ± 0.120 -0.023 ± 0.093	1.230 ± 0.360	0.012 ± 0.028	-0.020 ± 0.100 -0.023 ± 0.083	-0.013 ± 0.032 -0.028 ± 0.030	0.012 ± 0.032 0.000 ± 0.030
		-0.025 ± 0.044	0.510 ± 0.300	0.009 ± 0.032	0.010 ± 0.120	-0.013 ± 0.028	0.030 ± 0.027
		0.018 ± 0.068	0.980 ± 0.340	-0.029 ± 0.025	0.023 ± 0.083	0.000 ± 0.031	0.020 ± 0.031
		-0.009 ± 0.027	1.800 ± 0.290	0.007 ± 0.028	0.042 ± 0.084	-0.005 ± 0.019	-0.006 ± 0.024
		-0.018 ± 0.050 -0.009 ± 0.024	0.760 ± 0.370 1.710 ± 0.160	-0.009 ± 0.034 0.009 ± 0.012	0.070 ± 0.110	0.006 ± 0.023 -0.002 \pm 0.011	-0.012 ± 0.035 -0.002 ± 0.012
	09/20/06		3.080 ± 0.190	0.009 ± 0.012 0.001 ± 0.008	-0.019 ± 0.032 -0.011 ± 0.028	-0.002 ± 0.011 -0.009 ± 0.007	0.002 ± 0.012 0.002 ± 0.009
		-0.025 ± 0.040	1.240 ± 0.260	0.001 ± 0.003 0.004 ± 0.022	-0.011 ± 0.028 -0.014 ± 0.068	0.003 ± 0.007	-0.010 ± 0.023
		-0.040 ± 0.047	2.920 ± 0.280	0.010 ± 0.020	-0.013 ± 0.062	0.019 ± 0.017	-0.005 ± 0.020
		0.045 ± 0.070	2.670 ± 0.380	0.031 ± 0.041	0.045 ± 0.081	0.001 ± 0.020	0.013 ± 0.021
		$0.000 \pm 0.150 \mathrm{G}$	0.010 ± 0.270	0.009 ± 0.049	-0.051 ± 0.096	-0.010 ± 0.029	0.011 ± 0.022
	12/13/06	-0.051 ± 0.092 G	1.820 ± 0.220	-0.035 ± 0.043	0.021 ± 0.069	0.001 ± 0.018	-0.011 ± 0.015
		Cr-51	Cs-134	Cs-137	Fe-59	I-131	K-40
		-0.140 ± 0.230	-0.002 ± 0.032	0.008 ± 0.028	0.048 ± 0.062	0.006 ± 0.019	15.460 ± 0.880
		0.290 ± 0.400 -0.100 \pm 0.250	-0.002 ± 0.033 0.022 ± 0.033	-0.002 ± 0.027 0.023 ± 0.030	-0.003 ± 0.088 -0.012 ± 0.059	-0.002 ± 0.001 0.015 ± 0.025	10.440 ± 0.780 7.070 ± 0.750
		-0.030 ± 0.200	0.022 ± 0.033 0.003 ± 0.030	0.023 ± 0.030 0.024 ± 0.026	-0.012 ± 0.039 -0.012 ± 0.061	-0.003 ± 0.023	4.540 ± 0.680
		-0.190 ± 0.180	0.017 ± 0.028	0.024 ± 0.026 0.020 ± 0.024	-0.037 ± 0.005	0.012 ± 0.026	2.690 ± 0.550
		-0.020 ± 0.160	0.003 ± 0.023	-0.001 ± 0.020	-0.004 ± 0.046	-0.003 ± 0.001	5.040 ± 0.770
		-0.160 ± 0.170	0.020 ± 0.027	0.027 ± 0.032	-0.005 ± 0.050	-0.003 ± 0.001	5.650 ± 0.910
		-0.160 ± 0.290	-0.002 ± 0.026	0.037 ± 0.042	-0.092 ± 0.087	-0.005 ± 0.002	4.870 ± 0.920
	06/28/06 07/12/06	0.040 ± 0.250 -0.090 \pm 0.280	-0.016 ± 0.028 -0.009 ± 0.027	0.014 ± 0.024 0.013 ± 0.031	0.007 ± 0.067 0.024 ± 0.063	-0.002 ± 0.001 -0.003 ± 0.001	4.270 ± 0.830 5.630 ± 0.930
	07/12/06	0.020 ± 0.280 0.020 ± 0.220	0.009 ± 0.027 0.008 ± 0.031	0.013 ± 0.031 0.000 ± 0.028	0.024 ± 0.065 0.014 ± 0.055	0.003 ± 0.001 0.004 ± 0.018	3.810 ± 0.860
	08/09/06	0.020 ± 0.220 0.050 ± 0.170	-0.003 ± 0.031	0.000 ± 0.028 0.011 ± 0.019	-0.005 ± 0.041	-0.009 ± 0.016	4.920 ± 0.610
	08/23/06	0.020 ± 0.220	0.010 ± 0.026	-0.014 ± 0.029	0.040 ± 0.061	0.010 ± 0.024	4.360 ± 0.740
	09/06/06	-0.036 ± 0.079	0.006 ± 0.011	0.004 ± 0.010	0.000 ± 0.026	0.001 ± 0.015	4.430 ± 0.370

Page 3 of 4

Location	Collection Date		-	Isotope			
22		Cr-51	Cs-134	Cs-137	Fe-59	I-131	K-40
	09/20/06	-0.013 ± 0.053	-0.001 ± 0.007	0.020 ± 0.010	-0.002 ± 0.016	0.006 ± 0.017	4.610 ± 0.330
	10/11/06	0.150 ± 0.160	-0.003 ± 0.018	-0.001 ± 0.019	-0.033 ± 0.046	0.006 ± 0.015	5.320 ± 0.600
	10/25/06	0.060 ± 0.140	0.015 ± 0.017	0.003 ± 0.015	0.024 ± 0.039	-0.005 ± 0.002	5.570 ± 0.530
	11/15/06	-0.060 ± 0.250	0.009 ± 0.018	0.006 ± 0.018	0.007 ± 0.051	-0.002 ± 0.015	3.700 ± 0.530
	11/29/06		0.010 ± 0.033	-0.023 ± 0.021	0.056 ± 0.078	-0.060 ± 0.480	15.240 ± 0.680
	12/13/06	0.060 ± 0.240	-0.009 ± 0.020	0.023 ± 0.017	0.000 ± 0.044	0.100 ± 0.260	8.930 ± 0.420
		La-140	Mn-54	Nb-95	Ru-103	Ru-106	Sb-125
		-0.025 ± 0.043	-0.005 ± 0.028	-0.058 ± 0.036	0.003 ± 0.028	-0.050 ± 0.260	-0.010 ± 0.066
		-0.150 ± 0.130	0.003 ± 0.030	0.034 ± 0.045	0.048 ± 0.042	-0.040 ± 0.270	0.001 ± 0.068
		-0.022 ± 0.048	0.008 ± 0.030	0.034 ± 0.033	-0.015 ± 0.032	0.120 ± 0.290	-0.040 ± 0.072
	04/12/06	0.029 ± 0.068	-0.020 ± 0.027	-0.052 ± 0.037	0.021 ± 0.028	-0.210 ± 0.220	-0.003 ± 0.063
	04/26/06		-0.003 ± 0.024	-0.018 ± 0.035	-0.005 ± 0.024	0.050 ± 0.190	0.006 ± 0.057
	05/10/06	-0.005 ± 0.038 -0.028 ± 0.040	0.001 ± 0.017 -0.008 \pm 0.020	-0.014 ± 0.020 0.002 ± 0.023	-0.005 ± 0.017 -0.014 ± 0.021	0.040 ± 0.180 -0.090 \pm 0.190	0.006 ± 0.042 0.000 ± 0.043
	05/24/06		0.008 ± 0.020 0.002 ± 0.028	-0.002 ± 0.023 -0.008 ± 0.049	-0.014 ± 0.021 -0.002 ± 0.037	-0.090 ± 0.190 -0.070 ± 0.220	0.000 ± 0.043 0.016 ± 0.065
	06/28/06		0.002 ± 0.023 0.019 ± 0.027	0.003 ± 0.049 0.007 ± 0.034	0.030 ± 0.029	-0.120 ± 0.180	-0.036 ± 0.003
		-0.030 ± 0.110 -0.028 ± 0.051	0.019 ± 0.027 0.000 ± 0.027	0.020 ± 0.032	0.030 ± 0.025 0.009 ± 0.025	0.060 ± 0.220	0.009 ± 0.056
	07/26/06	0.020 ± 0.031 0.021 ± 0.078	0.018 ± 0.021	0.020 ± 0.032 0.006 ± 0.038	-0.030 ± 0.023	-0.170 ± 0.220	-0.065 ± 0.063
		-0.010 ± 0.032	-0.018 ± 0.018	0.023 ± 0.024	0.005 ± 0.021	-0.030 ± 0.170	0.008 ± 0.045
	08/23/06		-0.005 ± 0.029	0.010 ± 0.032	0.005 ± 0.025	0.190 ± 0.250	0.014 ± 0.060
	09/06/06	-0.010 ± 0.027	0.001 ± 0.009	-0.001 ± 0.015	-0.006 ± 0.009	-0.073 ± 0.082	-0.001 ± 0.023
	09/20/06	0.003 ± 0.011	0.002 ± 0.007	0.003 ± 0.008	-0.006 ± 0.007	0.015 ± 0.056	-0.002 ± 0.015
		-0.029 ± 0.046	-0.007 ± 0.017	0.021 ± 0.021	-0.006 ± 0.017	-0.190 ± 0.160	-0.015 ± 0.039
	10/25/06		0.002 ± 0.016	0.006 ± 0.020	0.007 ± 0.016	-0.010 ± 0.130	0.020 ± 0.036
	11/15/06	0.051 ± 0.081	0.007 ± 0.016	0.029 ± 0.031	-0.007 ± 0.023	0.010 ± 0.160	-0.033 ± 0.039
	11/29/06	0.000 ± 0.180	-0.009 ± 0.023	0.005 ± 0.043	0.004 ± 0.037	-0.050 ± 0.210	0.034 ± 0.053
	12/13/06	-0.060 ± 0.110	-0.004 ± 0.015	0.000 ± 0.026	-0.009 ± 0.021	-0.060 ± 0.140	-0.022 ± 0.036
		Th-228	Zn-65	Zr-95			
	01/11/06	0.000 ± 0.140	0.016 ± 0.097	0.002 ± 0.049			
	02/15/06	-0.110 ± 0.140	-0.043 ± 0.073	0.056 ± 0.065			
	03/22/06	0.040 ± 0.170	-0.058 ± 0.073	0.003 ± 0.052			
	04/12/06	0.110 ± 0.100	-0.014 ± 0.060	-0.008 ± 0.048	-		<u></u>
	04/26/06 05/10/06	0.010 ± 0.120 -0.011 \pm 0.079	-0.020 ± 0.100 -0.043 ± 0.047	0.041 ± 0.045 0.020 ± 0.031	·		
	05/10/06	0.011 ± 0.079 0.018 ± 0.093	0.043 ± 0.047 0.042 ± 0.051	-0.020 ± 0.031 -0.020 ± 0.036			
	05/24/06		-0.042 ± 0.031 -0.024 ± 0.073	0.020 ± 0.030 0.011 ± 0.065			
		-0.020 ± 0.033 -0.006 ± 0.087	0.036 ± 0.054	-0.027 ± 0.045			
	07/12/06	0.090 ± 0.100	-0.016 ± 0.064	0.040 ± 0.048			
	07/26/06	-0.020 ± 0.100	-0.026 ± 0.078	0.006 ± 0.048			
	08/09/06	0.060 ± 0.110	0.002 ± 0.089	-0.007 ± 0.035			
	08/23/06	0.050 ± 0.100	-0.019 ± 0.056	-0.060 ± 0.044			
	09/06/06	0.041 ± 0.051	-0.009 ± 0.025	0.007 ± 0.017			
	09/20/06	0.040 ± 0.033	-0.008 ± 0.018	-0.009 ± 0.012			
	10/11/06	0.018 ± 0.089	0.000 ± 0.042	-0.003 ± 0.037			
	10/25/06	0.006 ± 0.072	0.013 ± 0.039	0.016 ± 0.031			
	11/15/06	0.098 ± 0.083	0.011 ± 0.043	0.018 ± 0.036			
	11/29/06	0.010 ± 0.120	-0.049 ± 0.055	0.024 ± 0.053	•		
	12/13/06	0.105 ± 0.061	0.056 ± 0.059	0.015 ± 0.032			
				-			

Page 4 of 4

Location	Collection Date			Isotope			
24-C		Ba-140	Be-7	Ce-141	Ce-144	Co-58	Co-60
	01/11/06	$0.007 \pm 0.038 \text{ G}$	0.800 ± 0.270	0.010 ± 0.036	-0.110 ± 0.110	0.001 ± 0.023	0.014 ± 0.025
		$0.010 \pm 0.120 G$	-0.110 ± 0.260	0.008 ± 0.043	-0.100 ± 0.110	0.012 ± 0.034	0.017 ± 0.040
		$0.022 \pm 0.040 \text{ G}$	0.030 ± 0.220	-0.003 ± 0.037	-0.090 ± 0.130	0.006 ± 0.026	0.005 ± 0.029
		-0.009 ± 0.045 G	0.070 ± 0.210	-0.009 ± 0.040	-0.090 ± 0.110	-0.008 ± 0.027 -0.021 ± 0.021	-0.006 ± 0.030
		-0.008 ± 0.028 0.018 ± 0.029	0.250 ± 0.200 0.330 ± 0.260	-0.001 ± 0.020 -0.005 ± 0.024	0.049 ± 0.073 0.033 ± 0.089	-0.021 ± 0.021 -0.012 ± 0.025	0.000 ± 0.025 0.009 ± 0.036
		-0.018 ± 0.029	1.360 ± 0.140	-0.003 ± 0.024 -0.014 ± 0.016	-0.033 ± 0.039 -0.031 ± 0.032	-0.012 ± 0.023 -0.006 ± 0.009	0.009 ± 0.030 0.002 ± 0.012
	09/20/06		1.170 ± 0.160	-0.001 ± 0.008	-0.013 ± 0.029	0.004 ± 0.008	-0.003 ± 0.013
	10/25/06		3.740 ± 0.570	-0.013 ± 0.040	0.070 ± 0.110	-0.013 ± 0.032	0.028 ± 0.030
	11/15/06	0.055 ± 0.086	2.320 ± 0.400	0.006 ± 0.025	-0.033 ± 0.072	-0.005 ± 0.024	0.002 ± 0.021
	11/29/06		3.220 ± 0.400	-0.009 ± 0.026	-0.046 ± 0.072	-0.007 ± 0.021	-0.012 ± 0.023
	12/13/06	-0.090 ± 0.130 G	2.500 ± 0.440	0.035 ± 0.057	-0.120 ± 0.130	-0.037 ± 0.034	-0.015 ± 0.029
		Cr-51	Cs-134	Cs-137	Fe-59	I-131	K-40
	01/11/06	0.040 ± 0.220	-0.004 ± 0.028	0.014 ± 0.034	0.047 ± 0.048	0.002 ± 0.015	7.690 ± 0.640
	02/15/06	0.200 ± 0.290	0.004 ± 0.030	0.052 ± 0.037	-0.072 ± 0.085	-0.004 ± 0.001	13.190 ± 0.910
	03/22/06	0.150 ± 0.240 -0.040 ± 0.240	-0.005 ± 0.031 0.000 ± 0.028	0.025 ± 0.038 0.063 ± 0.039	0.010 ± 0.055 0.012 ± 0.060	0.010 ± 0.019 0.003 ± 0.012	12.050 ± 0.810 15.030 ± 0.830
		-0.040 ± 0.240 -0.010 ± 0.130	0.000 ± 0.028 0.007 ± 0.023	-0.012 ± 0.039	-0.012 ± 0.060 -0.019 ± 0.044	-0.003 ± 0.012 -0.003 ± 0.001	5.960 ± 0.840
		-0.010 ± 0.130 -0.080 ± 0.140	0.007 ± 0.023 0.025 ± 0.027	0.006 ± 0.019	0.029 ± 0.056	-0.003 ± 0.001 -0.003 ± 0.001	6.000 ± 0.040
	09/06/06	0.049 ± 0.078	0.009 ± 0.009	-0.007 ± 0.009	-0.004 ± 0.022	-0.007 ± 0.002	4.550 ± 0.320
	09/20/06		0.000 ± 0.009	0.014 ± 0.009	0.002 ± 0.017	-0.002 ± 0.001	4.150 ± 0.420
	10/25/06		0.002 ± 0.030	-0.012 ± 0.025	-0.007 ± 0.076	-0.006 ± 0.002	6.200 ± 1.000
	11/15/06	0.110 ± 0.200	0.002 ± 0.019	0.003 ± 0.015	-0.011 ± 0.052	-0.012 ± 0.004	4.180 ± 0.690
	11/29/06 12/13/06	0.190 ± 0.200 -0.630 ± 0.420	-0.010 ± 0.021 -0.011 ± 0.032	-0.017 ± 0.017 0.052 ± 0.041	0.020 ± 0.050 0.054 ± 0.085	0.010 ± 0.020 0.160 ± 0.300	4.460 ± 0.650 11.550 ± 0.800
		La-140	Mn-54	Nb-95	Ru-103	Ru-106	Sb-125
	01/11/06	0.008 ± 0.044	0.013 ± 0.023	-0.003 ± 0.026	-0.001 ± 0.023	-0.120 ± 0.230	0.034 ± 0.062
	02/15/06	0.010 ± 0.140	0.019 ± 0.029 0.000 ± 0.030	0.018 ± 0.056	0.002 ± 0.036	0.120 ± 0.230 0.100 ± 0.240	0.034 ± 0.002 0.022 ± 0.065
	03/22/06	0.025 ± 0.046	0.012 ± 0.026	0.001 ± 0.029	-0.030 ± 0.025	-0.160 ± 0.250	0.029 ± 0.071
	04/12/06		-0.003 ± 0.027	0.003 ± 0.038	-0.009 ± 0.029	-0.050 ± 0.250	-0.002 ± 0.061
		-0.009 ± 0.032	-0.007 ± 0.022	-0.011 ± 0.023	0.000 ± 0.017	0.060 ± 0.160	0.016 ± 0.046
		0.021 ± 0.033 -0.021 \pm 0.023	0.009 ± 0.020	0.001 ± 0.025	0.004 ± 0.018 -0.001 ± 0.010	0.020 ± 0.170	0.038 ± 0.051
		0.0021 ± 0.023 0.002 ± 0.008	0.003 ± 0.008 0.007 ± 0.009	0.001 ± 0.010 0.001 ± 0.010	0.000 ± 0.007	0.006 ± 0.080 0.010 ± 0.064	0.007 ± 0.020 0.000 ± 0.019
		-0.020 ± 0.120	0.017 ± 0.028	-0.026 ± 0.041	-0.034 ± 0.031	0.070 ± 0.004	0.024 ± 0.062
		0.064 ± 0.099	0.000 ± 0.019	0.002 ± 0.029	0.009 ± 0.025	-0.120 ± 0.150	0.009 ± 0.038
		0.042 ± 0.069	0.011 ± 0.019	-0.014 ± 0.032	0.004 ± 0.020	-0.090 ± 0.160	-0.005 ± 0.043
	12/13/06	-0.100 ± 0.140	-0.006 ± 0.029	0.031 ± 0.046	0.020 ± 0.036	0.360 ± 0.260	0.048 ± 0.071
		Th-228	Zn-65	Zr-95			
		0.100 ± 0.130	-0.035 ± 0.058	-0.005 ± 0.043			
	02/15/06		0.050 ± 0.066	-0.021 ± 0.060			
	03/22/06	0.094 ± 0.088	-0.085 ± 0.065	-0.022 ± 0.047			
	04/12/06 05/10/06		0.006 ± 0.063 0.031 ± 0.056	0.014 ± 0.047 0.025 ± 0.037			
	05/24/06		-0.031 ± 0.036 -0.012 ± 0.056	0.023 ± 0.037 0.021 ± 0.046			
	09/06/06	0.037 ± 0.044	0.008 ± 0.022	-0.010 ± 0.015			
	09/20/06	0.033 ± 0.038	-0.018 ± 0.022	-0.008 ± 0.017			
	10/25/06	0.100 ± 0.120	-0.035 ± 0.073	-0.020 ± 0.040			
	11/15/06 11/29/06	0.060 ± 0.063 0.009 ± 0.073	0.034 ± 0.047 -0.014 ± 0.052	0.045 ± 0.043 -0.012 \pm 0.038			
	12/13/06	0.009 ± 0.073 0.040 ± 0.150	0.130 ± 0.110	-0.012 ± 0.038 -0.012 ± 0.058			
	, 15, 00						

Table 10, Well Water (pCi/L)

Location	Collection Date			Isotope			
71		Ba-140	Be- 7	Co-58	Co-60	Cr-51	Cs-134
	03/16/06	-0.6 ± 4.9	-6.0 ± 21.0	-1.5 ± 2.4	0.4 ± 3.0	12.0 ± 24.0	0.0 ± 2.7
	06/14/06	4.5 ± 6.7	12.0 ± 43.0	-0.4 ± 4.2	-0.6 ± 4.2	2.0 ± 36.0	0.8 ± 4.3
	09/19/06	-1.3 ± 6.0	-5.0 ± 32.0	-5.1 ± 3.9	-2.1 ± 4.1	-18.0 ± 41.0	0.6 ± 4.4
	12/20/06	1.9 ± 4.3	-1.0 ± 23.0	0.7 ± 2.4	-0.9 ± 2.3	-7.0 ± 24.0	1.1 ± 3.0
		Cs-137	Fe-59	H-3	I-131	K-40	La-140
	03/16/06	0.4 ± 2.5	-5.2 ± 5.5	120.0 ± 940.0	-4.6 ± 5.6	-15.0 ± 36.0	-0.7 ± 5.6
	06/14/06	1.1 ± 3.9	-6.0 ± 10.0	-440.0 ± 850.0	0.9 ± 8.2	-3.0 ± 54.0	5.2 ± 7.7
	09/19/06	1.4 ± 4.3	-3.5 ± 8.1	10.0 ± 980.0	0.7 ± 7.8	54.0 ± 59.0	-1.5 ± 6.9
	12/20/06	0.6 ± 2.6	-6.3 ± 5.4	190.0 ± 870.0	-2.6 ± 5.5	-2.0 ± 34.0	2.2 ± 4.9
		Mn-54	Nb-95	Ru-103	Ru-106	Sb-125	Th-228
	03/16/06	1.3 ± 2.5	-4.3 ± 2.9	-2.9 ± 2.6	2.0 ± 24.0	-6.0 ± 6.0	3.0 ± 12.0
	06/14/06	-6.8 ± 4.5	1.1 ± 4.6	-1.5 ± 4.4	0.0 ± 39.0	4.0 ± 11.0	-3.0 ± 16.0
	09/19/06	0.6 ± 3.4	1.0 ± 4.3	-1.5 ± 4.2	-16.0 ± 37.0	-6.0 ± 12.0	12.0 ± 13.0
	12/20/06	-0.6 ± 2.4	-0.2 ± 3.0	1.4 ± 2.6	4.0 ± 26.0	-1.9 ± 6.9	-3.5 ± 9.4
		Zn-65	Zr-95			2	
	03/16/06	1.4 ± 5.4	2.5 ± 4.2				
	06/14/06	-7.5 ± 9.2	2.4 ± 7.5				
	09/19/06	8.0 ± 14.0	3.6 ± 7.1				
	12/20/06	8.4 ± 9.9	-0.2 ± 4.6				
72		Ba-140	Be- 7	Co-58	Co-60	Cr-51	Cs-134
	03/16/06	1.0 ± 5.2	20.0 ± 20.0	-0.7 ± 2.5	-1.3 ± 3.1	-17.0 ± 23.0	-2.0 ± 2.5
	06/14/06	-0.5 ± 5.8	-3.0 ± 34.0	-3.1 ± 3.3	3.7 ± 4.6	8.0 ± 39.0	1.7 ± 3.7
	09/18/06	-3.2 ± 4.2	-11.0 ± 18.0	1.0 ± 2.5	0.7 ± 2.5	8.0 ± 21.0	-0.2 ± 2.7
	12/01/06	1.7 ± 4.2	31.0 ± 22.0	-0.6 ± 2.5	0.4 ± 2.8	8.0 ± 25.0	0.4 ± 2.8
	12/19/06	4.5 ± 4.3	30.0 ± 22.0	0.3 ± 2.7	-0.6 ± 2.7	-2.0 ± 24.0	0.1 ± 2.8
		Cs-137	Fe-59	H-3	I-131	K-40	La-140
	03/16/06	-1.0 ± 2.5	1.9 ± 5.5	-450.0 ± 930.0	-2.4 ± 6.1	18.0 ± 44.0	1.2 ± 6.0
	06/14/06	-0.2 ± 4.0	3.6 ± 7.5	-310.0 ± 860.0	1.8 ± 7.3	13.0 ± 49.0	-0.6 ± 6.6
	09/18/06	1.6 ± 2.2	-1.0 ± 4.8	220.0 ± 990.0	-0.3 ± 4.5	-11.0 ± 35.0	-3.7 ± 4.8
	12/01/06	-1.6 ± 2.6	4.3 ± 5.7	100.0 ± 860.0	0.8 ± 5.7	5.0 ± 44.0	1.9 ± 4.8
	12/19/06	0.1 ± 2.4	-0.6 ± 4.8	570.0 ± 880.0	-1.4 ± 4.9	27.0 ± 49.0	5.2 ± 4.9
		Mn-54	Nb-95	Ru-103	Ru-106	Sb-125	Th-228
	03/16/06	1.1 ± 2.3	-0.6 ± 3.0	0.6 ± 2.5	10.0 ± 24.0	-1.1 ± 6.3	4.0 ± 11.0
	06/14/06	-0.9 ± 4.1	0.3 ± 3.7	-1.2 ± 3.8	-17.0 ± 37.0	2.0 ± 10.0	8.0 ± 17.0
	09/18/06	0.5 ± 2.2	2.7 ± 2.6	-0.1 ± 2.7	-9.0 ± 22.0	0.2 ± 5.8	6.0 ± 11.0
	12/01/06 12/19/06	0.4 ± 2.5 -0.5 \pm 2.9	-0.1 ± 3.1 -0.5 ± 3.1	-1.5 ± 3.2	9.0 ± 25.0	-3.2 ± 6.6 -5.9 ± 6.5	4.8 ± 9.3 -5.2 ± 9.9
	12/19/00			-3.8 ± 4.1	-1.0 ± 24.0	-3.9 ± 0.3	-3.2 ± 9.9
		Zn-65	Zr-95				
	03/16/06	-1.8 ± 5.6	0.2 ± 4.4				
	06/14/06	-11.9 ± 9.6	2.7 ± 5.8				
	09/18/06 12/01/06	-0.7 ± 7.7	1.6 ± 4.2				
	12/01/06	-1.9 ± 6.2	0.2 ± 5.0				
	12/19/06	-7.4 ± 6.7	-3.1 ± 4.6				

Table 10, Well Water (pCi/L)

Page 2 of 4

Location	Collection Date			Isotope			
76-X		Ba-140	Be-7	Co-58	.Co-60	Cr-51	Cs-134
	06/14/06	2.8 ± 5.7	30.0 ± 34.0	-0.7 ± 3.8	1.0 ± 4.4	-9.0 ± 35.0	-0.7 ± 4.9
	09/18/06	2.3 ± 3.9	-3.0 ± 20.0	-2.0 ± 2.4	0.8 ± 3.0	-7.0 ± 19.0	-0.9 ± 2.7
		Cs-137	Fe-59	H-3	I-131	K-40	La-140
	06/14/06	-0.3 ± 4.4	-4.0 ± 10.0	-430.0 ± 850.0	2.0 ± 7.1	-5.0 ± 54.0	3.3 ± 6.5
	09/18/06	-0.8 ± 2.3	2.1 ± 5.0	-640.0 ± 950.0	-0.8 ± 3.9	-5.0 ± 41.0	2.6 ± 4.5
		Mn-54	Nb-95	Ru-103	Ru-106	Sb-125	Th-228
	06/14/06	0.9 ± 4.3	-6.1 ± 4.6	-2.6 ± 4.2	38.0 ± 39.0	2.0 ± 10.0	-2.0 ± 15.0
	09/18/06	-0.7 ± 2.4	1.6 ± 2.9	-1.3 ± 2.5	9.0 ± 20.0	-5.2 ± 5.8	-1.0 ± 11.0
		Zn-65	Zr-95				
	06/14/06	-14.0 ± 10.0	-1.1 ± 7.1				
	09/18/06	-2.4 ± 5.5	-1.4 ± 4.8				
7 7-X		Ba-140	Be-7	Co-58	Co-60	Cr-51	Cs-134
	12/31/06	I					
		Cs-137	Fe-59	Н-3	I-131	K-40	La-140
		Mn-54	Nb-95	Ru-103	Ru-106	Sb-125	Th-228
		Zn-65	Zr-95				
78-X		Ba-140	Be-7	Co-58	Co-60	Cr-51	Cs-134
	06/14/06 09/18/06	-1.3 ± 4.0 -1.6 ± 3.5	3.0 ± 25.0 1.0 ± 19.0	0.8 ± 2.4 1.3 ± 2.2	0.2 ± 2.7 0.6 ± 2.0	-5.0 ± 25.0 23.0 ± 20.0	-1.4 ± 3.0 -0.8 ± 2.4
		Cs-137	Fe-59	Н-3	I-131	K-40	La-140
	06/14/06 09/18/06	0.2 ± 2.8 -1.4 ± 2.2	-3.2 ± 5.9 1.1 ± 4.4	-430.0 ± 840.0 -570.0 ± 970.0	1.4 ± 5.5 -3.9 ± 4.4	31.0 ± 44.0 7.0 ± 35.0	-1.5 ± 4.7 -1.8 ± 4.1
		Mn-54	Nb-95	Ru-103	Ru-106	Sb-125	Th-228
	06/14/06 09/18/06	-0.7 ± 2.5 -0.1 ± 2.1	-0.3 ± 3.1 -3.7 ± 2.7	-4.9 ± 3.2 -1.8 ± 2.3	10.0 ± 28.0 -5.0 \pm 21.0	5.1 ± 7.3 2.7 ± 5.6	1.0 ± 10.0 6.4 ± 8.4
		Zn-65	Zr-95				
	06/14/06 09/18/06	-5.4 ± 5.9 1.6 ± 9.0	-2.1 ± 4.5 -0.9 ± 3.8				

Table 10, Well Water (pCi/L)

Page 3 of 4

Location	Collection Date			Isotope			- 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1
79		Ba-140	Be-7	Co-58	Co-60	Cr-51	Cs-134
	06/13/06	0.5 ± 4.6	6.0 ± 35.0	-1.8 ± 3.6	0.8 ± 3.5	-20.0 ± 32.0	1.2 ± 4.1
	09/18/06	0.0 ± 5.1	-20.0 ± 23.0	-4.2 ± 3.3	1.5 ± 3.3	13.0 ± 22.0	-2.7 ± 3.2
	12/20/06	4.4 ± 6.8	-5.0 ± 35.0	-4.5 ± 4.4	1.5 ± 5.1	-13.0 ± 34.0	2.7 ± 5.0
		Cs-137	Fe-59	H-3	I-131	K-40	La-140
•	06/13/06	0.5 ± 3.6	-4.8 ± 7.5	30.0 ± 860.0	2.7 ± 7.1	11.0 ± 56.0	0.6 ± 5.3
	09/18/06	0.7 ± 2.7	6.5 ± 6.1	-370.0 ± 960.0	-1.1 ± 4.7	19.0 ± 26.0	0.0 ± 5.9
	12/20/06	-3.3 ± 4.4	6.0 ± 9.9	170.0 ± 880.0	0.5 ± 6.3	78.0 ± 61.0	5.1 ± 7.8
		Mn-54	Nb-95	Ru-103	Ru-106	Sb-125	Th-228
	06/13/06	0.4 ± 3.5	-1.6 ± 4.3	-2.2 ± 4.2	13.0 ± 34.0	0.5 ± 9.0	1.0 ± 13.0
	09/18/06	1.5 ± 2.7	0.6 ± 5.2	-2.5 ± 2.9	-15.0 ± 23.0	-0.3 ± 7.4	-9.0 ± 11.0
	12/20/06	1.6 ± 3.9	-5.1 ± 5.3	1.7 ± 4.2	0.0 ± 37.0	1.0 ± 12.0	-10.0 ± 16.0
		Zn-65	Zr-95				
	06/13/06	8.0 ± 15.0	5.1 ± 6.9				
	09/18/06	6.0 ± 13.0	-3.3 ± 5.3				
	12/20/06	-2.0 ± 13.0	3.2 ± 7.9				
80		Ba-140	Be-7	Co-58	Co-60	Cr-51	Cs-134
	09/21/06 12/19/06	-1.5 ± 4.6 -0.3 ± 3.3	-11.0 ± 22.0 0.0 ± 18.0	-0.3 ± 2.5 -3.1 ± 2.0	1.6 ± 2.3 0.8 ± 2.0	-4.0 ± 26.0 -2.0 ± 21.0	1.1 ± 2.8 3.2 ± 2.2
		Cs-137	Fe-59	Н-3	I-131	K-40	La-140
	09/21/06	-3.2 ± 2.3	3.6 ± 5.8	30.0 ± 980.0	-0.9 ± 6.4	7.0 ± 36.0	-1.7 ± 5.3
	12/19/06	3.1 ± 3.4	-2.6 ± 4.3	-220.0 ± 880.0	-0.7 ± 4.1	21.0 ± 26.0	-0.4 ± 3.7
		Mn-54	Nb-95	Ru-103	Ru-106	Sb-125	Th-228
	09/21/06 12/19/06	-1.5 ± 2.4 -2.2 ± 1.9	2.6 ± 3.1 3.2 ± 3.6	-0.9 ± 3.1 0.1 ± 2.3	6.0 ± 22.0 1.0 ± 19.0	-0.4 ± 6.2 5.3 ± 5.4	-9.0 ± 10.0 6.2 ± 7.6
		Zn-65	Zr-95				
	09/21/06 12/19/06	6.0 ± 9.5 2.2 ± 8.1	-1.6 ± 4.3 -0.8 ± 3.5				
81		Ba-140	Be-7	Co-58	Co-60	Cr-51	Cs-134
	12/19/06	-1.1 ± 3.3	12.0 ± 16.0	0.1 ± 1.9	-0.7 ± 2.2	1.0 ± 19.0	0.7 ± 2.1
		Cs-137	Fe-59	Н-3	I-131	K-40	La-140
	12/19/06	-0.8 ± 1.9	-0.3 ± 4.0	0.088 ± 0.0	-3.9 ± 4.1	21.0 ± 33.0	-1.3 ± 3.8
		Mn-54	Nb-95	Ru-103	Ru-106	Sb-125	Th-228
	12/19/06	1.6 ± 1.9	-1.3 ± 3.7	-0.8 ± 2.1	2.0 ± 17.0	-2.2 ± 5.0	8.3 ± 7.3

Table 10, Well Water (pCi/L)

Page 4 of 4

Location	Collection Date			Isotope
81		Z n-65	Zr-95	
	12/19/06	-0.2 ± 8.6	-3.9 ± 3.6	

Table 11, Reservoir Water

No data collected during 2006

Table 12, Fruits & Vegetables (pCi/g Wet)

Location	Collection Date	Sample Type			Isotope		
25			Ba-140	Be-7	Ce-141	Ce-144	Co-58
	06/21/06	LETTUCE	-0.015 ± 0.027	0.070 ± 0.150	-0.004 ± 0.016	0.056 ± 0.068	-0.014 ± 0.017
	06/21/06	STRAWBERRIES		0.110 ± 0.140	0.019 ± 0.023	0.059 ± 0.087	0.000 ± 0.012
	09/06/06	APPLES	0.010 ± 0.024	0.010 ± 0.110	0.014 ± 0.018	-0.017 ± 0.051	0.007 ± 0.015
	09/06/06	KALE	0.003 ± 0.023	0.090 ± 0.160	-0.007 ± 0.023	0.012 ± 0.088	0.001 ± 0.014
	10/25/06	RHUBARB	-0.007 ± 0.021	0.415 ± 0.090	-0.019 ± 0.016	0.010 ± 0.028	0.003 ± 0.007
			Co-60	Cr-51	Cs-134	Cs-137	Fe-59
	06/21/06	LETTUCE	-0.006 ± 0.022	-0.050 ± 0.110	0.001 ± 0.016	0.007 ± 0.015	-0.023 ± 0.038
	06/21/06	STRAWBERRIES		0.110 ± 0.140	-0.005 ± 0.017	0.005 ± 0.016	-0.007 ± 0.032
	09/06/06	APPLES	0.018 ± 0.017	-0.010 ± 0.110	0.026 ± 0.020	0.010 ± 0.013	-0.011 ± 0.034
	09/06/06	KALE	-0.002 ± 0.024	-0.130 ± 0.140	0.005 ± 0.018	-0.003 ± 0.019	0.003 ± 0.031
	10/25/06	RHUBARB	0.005 ± 0.005	0.015 ± 0.075	0.000 ± 0.011	0.039 ± 0.009	-0.007 ± 0.014
	06/01/06	T POWER LOSS	I-131	K-40	La-140	Mn-54	Nb-95
	06/21/06	LETTUCE STRAWBERRIES	0.014 ± 0.021	1.810 ± 0.500	-0.018 ± 0.031	0.004 ± 0.018 -0.004 \pm 0.014	0.004 ± 0.017
	06/21/06 09/06/06	APPLES	-0.002 ± 0.027 -0.001 ± 0.020	0.940 ± 0.380 0.690 ± 0.320	-0.019 ± 0.025 0.012 ± 0.028	-0.004 ± 0.014 -0.005 ± 0.017	0.002 ± 0.015 0.000 ± 0.017
	09/06/06		-0.001 ± 0.020 -0.023 ± 0.026	0.690 ± 0.320 3.580 ± 0.590	0.012 ± 0.028 0.003 ± 0.027	-0.003 ± 0.017 -0.003 ± 0.018	0.000 ± 0.017 0.003 ± 0.019
	10/25/06	KALE RHUBARB	-0.023 ± 0.026 -0.021 ± 0.034	4.210 ± 0.210	-0.003 ± 0.027 -0.008 ± 0.024	-0.003 ± 0.018 -0.001 ± 0.007	-0.003 ± 0.019 -0.002 ± 0.009
	10/23/00	KHUBAKB			-0.008 ± 0.024		-0.002 ± 0.009
			Ru-103	Ru-106	Sb-125	Th-228	Zn-65
	06/21/06	LETTUCE	-0.004 ± 0.014	-0.050 ± 0.120	0.023 ± 0.039	-0.039 ± 0.053	-0.024 ± 0.040
	06/21/06	STRAWBERRIES		0.000 ± 0.140	0.014 ± 0.043	0.006 ± 0.062	0.017 ± 0.036
	09/06/06	APPLES	-0.002 ± 0.014	-0.060 ± 0.130	-0.014 ± 0.036	0.002 ± 0.052	-0.035 ± 0.034
	09/06/06	KALE	0.000 ± 0.016	0.040 ± 0.160	-0.023 ± 0.041	0.006 ± 0.077	0.043 ± 0.039
	10/25/06	RHUBARB	0.000 ± 0.008	0.007 ± 0.064	0.014 ± 0.016	0.002 ± 0.040	-0.015 ± 0.016
	06/21/06	LETTUCE	$Zr-95$ -0.015 ± 0.030		•		
	06/21/06	STRAWBERRIES					
	09/06/06	APPLES	-0.004 ± 0.025 -0.017 ± 0.030				
	09/06/06	KALE	-0.007 ± 0.030 -0.008 ± 0.030				
	10/25/06	RHUBARB	-0.017 ± 0.013				
		•		•			
26-C			Ba-140	Be-7	Ce-141	Ce-144	.Co-58
	06/21/06	LETTUCE	-0.012 ± 0.019	0.010 ± 0.120	-0.008 ± 0.022	-0.086 ± 0.078	0.003 ± 0.015
	06/21/06	STRAWBERRIES	-0.004 ± 0.032	0.010 ± 0.130	-0.008 ± 0.022	0.016 ± 0.082	0.005 ± 0.018
	09/06/06	PEACHES	0.019 ± 0.018	0.040 ± 0.096	-0.004 ± 0.018	-0.092 ± 0.066	-0.006 ± 0.011
	09/06/06	SWISS CHARD	0.008 ± 0.021	0.180 ± 0.230	-0.001 ± 0.024	-0.057 ± 0.082	-0.007 ± 0.020
			Co-60	Cr-51	Cs-134	Cs-137	Fe-59
	06/21/06	LETTUCE	-0.007 ± 0.021	0.060 ± 0.140	-0.009 ± 0.017	-0.008 ± 0.016	-0.009 ± 0.035
	06/21/06	STRAWBERRIES		0.060 ± 0.140	-0.001 ± 0.019	0.015 ± 0.018	-0.009 ± 0.039
	09/06/06	PEACHES	-0.005 ± 0.012	0.080 ± 0.110	0.007 ± 0.012	0.004 ± 0.014	0.002 ± 0.028
	09/06/06	SWISS CHARD	0.010 ± 0.027	-0.100 ± 0.150	0.006 ± 0.018	0.008 ± 0.019	0.008 ± 0.039
	06/01/06	I Davin Ion	I-131	K-40	La-140	Mn-54	Nb-95
,	06/21/06	LETTUCE	-0.012 ± 0.027	2.020 ± 0.450	-0.013 ± 0.021	0.003 ± 0.016	-0.001 ± 0.016
	06/21/06	STRAWBERRIES		0.820 ± 0.430	-0.005 ± 0.037	-0.002 ± 0.017	0.019 ± 0.021
	09/06/06	PEACHES SWICE CHARD	0.004 ± 0.019	1.650 ± 0.330	0.022 ± 0.021	-0.002 ± 0.013	-0.011 ± 0.013
	09/06/06	SWISS CHARD	-0.003 ± 0.025	4.740 ± 0.750	0.009 ± 0.025	0.013 ± 0.019	0.007 ± 0.018
			Ru-103	Ru-106	Sb-125	Th-228	Zn-65
	06/21/06	LETTUCE	0.002 ± 0.019	0.130 ± 0.140	-0.011 ± 0.040	0.023 ± 0.063	0.027 ± 0.039
	06/21/06	STRAWBERRIES	0.006 ± 0.017	0.000 ± 0.140	0.038 ± 0.044	0.013 ± 0.081	-0.009 ± 0.037

Table 12, Fruits & Vegetables (pCi/g Wet)

Location	Collection Date	Sample Type	Isotope					
26-C	09/06/06 09/06/06	PEACHES SWISS CHARD	Ru-103 0.002 ± 0.012 -0.017 ± 0.016	$\mathbf{Ru-106} \\ 0.090 \pm 0.130 \\ 0.120 \pm 0.160$	Sb-125 -0.001 ± 0.032 -0.006 ± 0.046			
	06/21/06 06/21/06 09/06/06 09/06/06	LETTUCE STRAWBERRIES PEACHES SWISS CHARD	Zr-95 -0.010 ± 0.027 5 0.000 ± 0.034 -0.011 ± 0.024 -0.007 ± 0.036					

Table 13, Broadleaf Vegetation (pCi/g Wet)

Location	Collection Date			Isotope .			
01		Ba-140	Be- 7	Ce-141	Ce-144	Co-58	Co-60
	04/13/06	Н					
	05/18/06	0.011 ± 0.014	1.460 ± 0.270	0.019 ± 0.020	0.012 ± 0.076	-0.001 ± 0.016	-0.001 ± 0.019
	06/21/06		0.860 ± 0.390	0.020 ± 0.041	-0.061 ± 0.099	0.017 ± 0.036	0.008 ± 0.034
	07/26/06	0.023 ± 0.042	0.900 ± 0.310	-0.014 ± 0.035	0.050 ± 0.110	0.000 ± 0.021	-0.012 ± 0.023
	08/22/06		0.710 ± 0.350	-0.020 ± 0.033	0.090 ± 0.110	-0.001 ± 0.025	0.002 ± 0.029
	09/26/06 10/17/06	0.020 ± 0.064 0.062 ± 0.062	2.630 ± 0.530 2.470 ± 0.440	-0.032 ± 0.046 -0.059 ± 0.037	-0.010 ± 0.120 -0.020 ± 0.110	0.007 ± 0.026 -0.002 \pm 0.024	-0.014 ± 0.020 0.007 ± 0.022
	11/07/06		0.870 ± 0.440	-0.039 ± 0.037 -0.028 ± 0.024	-0.020 ± 0.110 -0.020 ± 0.048	-0.002 ± 0.024 -0.005 ± 0.013	0.007 ± 0.022 0.008 ± 0.015
		Cr-51	Cs-134	Cs-137	Fe-59	I-131	K-40
	05/18/06	0.140 ± 0.130	0.003 ± 0.020	0.011 ± 0.016	0.020 ± 0.031	-0.013 ± 0.020	3.530 ± 0.580
	06/21/06	0.060 ± 0.260	0.000 ± 0.027	0.014 ± 0.031	0.076 ± 0.080	0.060 ± 0.120	3.960 ± 0.970
	07/26/06		0.011 ± 0.024	-0.008 ± 0.023	0.048 ± 0.051	0.028 ± 0.062	3.950 ± 0.640
	08/22/06	0.070 ± 0.250	-0.007 ± 0.029	-0.013 ± 0.026	-0.010 ± 0.067	0.056 ± 0.084	4.150 ± 0.740
	09/26/06	0.100 ± 0.310	0.013 ± 0.028	0.020 ± 0.030	0.033 ± 0.071	0.150 ± 0.160	3.460 ± 0.720
	10/17/06		-0.009 ± 0.024	-0.001 ± 0.025	-0.027 ± 0.063	0.000 ± 0.015	3.730 ± 0.650
	11/07/06	0.071 ± 0.098	0.009 ± 0.014	0.010 ± 0.012	-0.018 ± 0.030	-0.008 ± 0.030	3.640 ± 0.370
		La-140	Mn-54	Nb-95	Ru-103	Ru-106	Sb-125
	05/18/06	0.013 ± 0.016	0.003 ± 0.015	0.009 ± 0.017	-0.008 ± 0.017	-0.070 ± 0.120	0.028 ± 0.037
	06/21/06		0.035 ± 0.032	-0.003 ± 0.043	0.009 ± 0.034	-0.140 ± 0.200	-0.045 ± 0.064
	07/26/06	0.027 ± 0.049	-0.004 ± 0.020	0.000 ± 0.029	-0.021 ± 0.023	0.050 ± 0.190	-0.049 ± 0.051
	08/22/06		-0.012 ± 0.026	-0.019 ± 0.026	0.006 ± 0.025	0.250 ± 0.210	-0.013 ± 0.059
	09/26/06	0.023 ± 0.074	0.002 ± 0.026	-0.020 ± 0.036	-0.005 ± 0.031	-0.240 ± 0.250	0.000 ± 0.062
	10/17/06	0.072 ± 0.071	-0.005 ± 0.023	-0.023 ± 0.029	0.003 ± 0.026	0.010 ± 0.220	-0.020 ± 0.061
	11/07/06		0.005 ± 0.013	-0.001 ± 0.016	-0.002 ± 0.012	-0.020 ± 0.100	0.016 ± 0.028
		Th-228	Zn-65	Zr-95			
	05/18/06	0.017 ± 0.063	-0.002 ± 0.038	-0.032 ± 0.029			
	06/21/06	0.080 ± 0.110	-0.008 ± 0.060	0.016 ± 0.062			
	07/26/06	0.041 ± 0.079	0.024 ± 0.089	0.003 ± 0.040			
	08/22/06	0.070 ± 0.130	-0.022 ± 0.053	-0.017 ± 0.045			
	09/26/06	0.060 ± 0.110	-0.089 ± 0.085	0.013 ± 0.052			<u> </u>
	10/17/06	0.080 ± 0.093	-0.012 ± 0.059	0.003 ± 0.042			
	11/07/06	0.052 ± 0.066	-0.020 ± 0.029	0.008 ± 0.024			
10		Ba-140	Be- 7	Ce-141	Ce-144	Co-58	Co-60
	04/13/06	Н					
	05/18/06		0.860 ± 0.290	-0.010 ± 0.021	-0.008 ± 0.083	-0.008 ± 0.019	-0.017 ± 0.020
	06/21/06	-0.018 ± 0.057	0.300 ± 0.380	-0.017 ± 0.051	0.070 ± 0.150	-0.008 ± 0.029	-0.015 ± 0.030
	07/26/06	0.025 ± 0.044	0.320 ± 0.290	0.006 ± 0.032	-0.010 ± 0.099	-0.004 ± 0.022	-0.001 ± 0.030
		-0.014 ± 0.046	0.320 ± 0.270	0.003 ± 0.028	0.001 ± 0.090	-0.014 ± 0.027	-0.024 ± 0.037
		-0.039 ± 0.052	1.520 ± 0.200	-0.017 ± 0.029	-0.016 ± 0.045	0.005 ± 0.012	0.009 ± 0.012
	10/17/06		1.570 ± 0.280	0.018 ± 0.026	0.016 ± 0.074	-0.008 ± 0.020	-0.014 ± 0.019
	11/07/06	0.000 ± 0.051	1.000 ± 0.270	-0.014 ± 0.024	-0.008 ± 0.062	0.002 ± 0.022	0.011 ± 0.022
		Cr-51	Cs-134	Cs-137	Fe-59	I-131	K-40
	05/18/06	0.030 ± 0.150	0.000 ± 0.022	0.021 ± 0.023	-0.025 ± 0.043	0.011 ± 0.025	3.010 ± 0.800
	06/21/06	0.130 ± 0.360	0.001 ± 0.030	0.007 ± 0.031	-0.029 ± 0.072	0.040 ± 0.140	3.760 ± 0.970
	07/26/06		-0.006 ± 0.026	0.004 ± 0.026	0.026 ± 0.048	-0.056 ± 0.077	3.590 ± 0.790
	08/22/06	0.000 ± 0.250	-0.004 ± 0.027	0.009 ± 0.026	0.017 ± 0.062	0.000 ± 0.078	3.990 ± 0.770

Table 13, Broadleaf Vegetation (pCi/g Wet)

Location	Collection Date			Isotope			-
10		Cr-51	Cs-134	Cs-137	Fe-59	I-131	K-40
		$ \begin{array}{c} -0.270 \pm 0.200 \\ -0.110 \pm 0.200 \\ 0.130 \pm 0.160 \end{array}$	0.008 ± 0.012 -0.019 ± 0.017 -0.015 ± 0.022	0.012 ± 0.011 0.003 ± 0.019 0.020 ± 0.021	0.006 ± 0.033 -0.010 \pm 0.046 0.012 ± 0.052	$\begin{array}{c} -0.060 \pm 0.094 \\ 0.010 \pm 0.023 \\ 0.025 \pm 0.045 \end{array}$	4.030 ± 0.370 3.360 ± 0.490 3.200 ± 0.610
		La-140	Mn-54	Nb-95	Ru-103	Ru-106	Sb-125
		$\begin{array}{c} 0.003 \pm 0.034 \\ -0.021 \pm 0.065 \\ 0.029 \pm 0.051 \\ -0.017 \pm 0.052 \\ -0.045 \pm 0.060 \\ 0.013 \pm 0.095 \\ 0.000 \pm 0.059 \end{array}$	$\begin{array}{c} -0.001 \pm 0.022 \\ 0.000 \pm 0.035 \\ 0.015 \pm 0.025 \\ 0.017 \pm 0.025 \\ 0.001 \pm 0.011 \\ -0.029 \pm 0.018 \\ 0.005 \pm 0.019 \end{array}$	$\begin{array}{c} -0.006 \pm 0.025 \\ 0.039 \pm 0.043 \\ -0.004 \pm 0.024 \\ -0.027 \pm 0.028 \\ 0.003 \pm 0.017 \\ 0.008 \pm 0.027 \\ 0.003 \pm 0.026 \end{array}$	$\begin{array}{c} 0.013 \pm 0.020 \\ -0.017 \pm 0.027 \\ 0.015 \pm 0.023 \\ 0.000 \pm 0.025 \\ -0.010 \pm 0.015 \\ 0.017 \pm 0.019 \\ 0.003 \pm 0.016 \end{array}$	$\begin{array}{c} 0.040 \pm 0.210 \\ -0.030 \pm 0.260 \\ -0.080 \pm 0.240 \\ -0.140 \pm 0.250 \\ 0.000 \pm 0.110 \\ 0.150 \pm 0.150 \\ 0.060 \pm 0.170 \end{array}$	$\begin{array}{c} \text{-}0.027 \pm 0.046 \\ \text{-}0.060 \pm 0.072 \\ \text{-}0.013 \pm 0.052 \\ \text{-}0.007 \pm 0.053 \\ \text{-}0.006 \pm 0.025 \\ \text{-}0.001 \pm 0.045 \\ 0.028 \pm 0.042 \end{array}$
		Th-228	Zn-65	Zr-95			
	06/21/06 07/26/06	$\begin{array}{c} -0.001 \pm 0.099 \\ 0.011 \pm 0.092 \\ 0.020 \pm 0.110 \\ -0.010 \pm 0.100 \\ 0.059 \pm 0.043 \\ 0.089 \pm 0.064 \\ 0.050 \pm 0.110 \\ \end{array}$	$\begin{array}{c} -0.026 \pm 0.055 \\ -0.005 \pm 0.056 \\ 0.000 \pm 0.066 \\ -0.031 \pm 0.064 \\ 0.014 \pm 0.027 \\ -0.037 \pm 0.038 \\ 0.012 \pm 0.045 \end{array}$	$\begin{array}{c} -0.023 \pm 0.047 \\ 0.022 \pm 0.060 \\ 0.022 \pm 0.050 \\ 0.034 \pm 0.045 \\ -0.003 \pm 0.023 \\ -0.006 \pm 0.025 \\ -0.031 \pm 0.035 \end{array}$			
17		Ba-140	Be- 7	Ce-141	Ce-144	Co-58	Co-60
	09/26/06 10/17/06	$\begin{array}{c} H \\ 0.002 \pm 0.024 \\ 0.060 \pm 0.110 \\ -0.009 \pm 0.040 \\ -0.048 \pm 0.071 \\ 0.004 \pm 0.034 \\ -0.021 \pm 0.076 \\ -0.005 \pm 0.036 \end{array}$	1.190 ± 0.280 0.780 ± 0.400 0.860 ± 0.480 1.000 ± 0.350 2.490 ± 0.200 1.790 ± 0.290 6.110 ± 0.340	-0.002 ± 0.021 -0.027 ± 0.041 0.000 ± 0.042 -0.004 ± 0.035 0.015 ± 0.018 0.005 ± 0.027 0.009 ± 0.024	-0.055 ± 0.066 -0.020 ± 0.120 0.010 ± 0.140 0.020 ± 0.079 -0.004 ± 0.043 0.063 ± 0.059 -0.026 ± 0.082	$\begin{array}{c} 0.001 \pm 0.018 \\ -0.009 \pm 0.043 \\ 0.012 \pm 0.032 \\ 0.012 \pm 0.026 \\ -0.003 \pm 0.010 \\ -0.013 \pm 0.023 \\ -0.007 \pm 0.017 \end{array}$	0.008 ± 0.027 0.004 ± 0.039 -0.002 ± 0.037 0.008 ± 0.029 -0.001 ± 0.009 0.015 ± 0.021 0.010 ± 0.017
		Cr-51	Cs-134	Cs-137	Fe-59	I-131	K-40
		$\begin{array}{c} 0.000 \pm 0.130 \\ -0.120 \pm 0.310 \\ -0.050 \pm 0.300 \\ 0.000 \pm 0.220 \\ 0.080 \pm 0.130 \\ 0.030 \pm 0.190 \\ 0.010 \pm 0.180 \end{array}$	$\begin{array}{c} 0.003 \pm 0.021 \\ 0.013 \pm 0.032 \\ -0.014 \pm 0.028 \\ -0.007 \pm 0.030 \\ 0.011 \pm 0.010 \\ -0.008 \pm 0.022 \\ 0.004 \pm 0.017 \end{array}$	$\begin{array}{c} 0.003 \pm 0.020 \\ 0.009 \pm 0.032 \\ -0.023 \pm 0.038 \\ 0.015 \pm 0.027 \\ -0.003 \pm 0.008 \\ 0.023 \pm 0.018 \\ 0.182 \pm 0.028 \end{array}$	$\begin{array}{c} 0.014 \pm 0.035 \\ 0.019 \pm 0.085 \\ -0.049 \pm 0.073 \\ -0.006 \pm 0.066 \\ 0.008 \pm 0.025 \\ 0.024 \pm 0.047 \\ 0.000 \pm 0.037 \end{array}$	$\begin{array}{c} 0.013 \pm 0.021 \\ -0.050 \pm 0.130 \\ -0.016 \pm 0.092 \\ 0.028 \pm 0.071 \\ 0.030 \pm 0.079 \\ -0.008 \pm 0.003 \\ -0.002 \pm 0.054 \end{array}$	3.990 ± 0.780 3.010 ± 0.810 2.460 ± 0.740 3.850 ± 0.780 4.000 ± 0.290 3.720 ± 0.490 2.080 ± 0.340
		La-140	Mn-54	Nb-95	Ru-103	Ru-106	Sb-125
	09/26/06 10/17/06	0.002 ± 0.028 0.070 ± 0.120 -0.010 ± 0.046 -0.055 ± 0.082 0.004 ± 0.040 -0.024 ± 0.087 -0.005 ± 0.041	$\begin{array}{c} 0.003 \pm 0.022 \\ -0.007 \pm 0.027 \\ 0.005 \pm 0.036 \\ -0.013 \pm 0.027 \\ -0.001 \pm 0.009 \\ 0.004 \pm 0.019 \\ -0.001 \pm 0.016 \end{array}$	$\begin{array}{c} -0.002 \pm 0.022 \\ 0.006 \pm 0.043 \\ -0.019 \pm 0.034 \\ -0.004 \pm 0.039 \\ 0.012 \pm 0.013 \\ 0.005 \pm 0.025 \\ 0.003 \pm 0.020 \end{array}$	$\begin{array}{c} 0.006 \pm 0.019 \\ 0.018 \pm 0.035 \\ 0.000 \pm 0.032 \\ -0.005 \pm 0.028 \\ 0.001 \pm 0.012 \\ 0.010 \pm 0.022 \\ -0.002 \pm 0.018 \end{array}$	$\begin{array}{c} -0.040 \pm 0.170 \\ -0.090 \pm 0.280 \\ 0.030 \pm 0.290 \\ 0.050 \pm 0.240 \\ -0.049 \pm 0.090 \\ 0.030 \pm 0.140 \\ 0.000 \pm 0.160 \end{array}$	$\begin{array}{c} 0.013 \pm 0.045 \\ 0.028 \pm 0.076 \\ -0.010 \pm 0.075 \\ -0.044 \pm 0.062 \\ 0.009 \pm 0.021 \\ 0.045 \pm 0.044 \\ -0.028 \pm 0.043 \end{array}$

Table 13, Broadleaf Vegetation (pCi/g Wet)

Page 3 of :3

Location	Collection Date			Isotope	
17		Th-228	Zn-65	Zr-95	
	05/18/06	0.072 ± 0.089	-0.019 ± 0.054	-0.011 ± 0.036	
	06/21/06	0.090 ± 0.150	-0.033 ± 0.062	-0.051 ± 0.062	
	07/26/06	0.370 ± 0.190	-0.092 ± 0.085	0.022 ± 0.059	
	08/22/06	0.240 ± 0.110	-0.065 ± 0.069	0.026 ± 0.059	
	09/26/06	0.043 ± 0.046	-0.003 ± 0.021	0.008 ± 0.018	
	10/17/06	0.052 ± 0.098	0.010 ± 0.046	-0.004 ± 0.039	
	11/07/06	0.134 ± 0.082	0.021 ± 0.060	0.009 ± 0.029	

Table 14, Sea Water (pCi/L)

Location	Collection Date			Isotope			
32		Ba-140	Be- 7	Co-58	Co-60	Cr-51	Cs-134
	01/31/06	0.0 ± 4.8	18.0 ± 30.0	-2.3 ± 3.5	2.5 ± 3.3	-13.0 ± 32.0	-1.3 ± 3.9
	02/28/06	0.9 ± 5.6	-8.0 ± 26.0	0.4 ± 3.3	1.5 ± 3.6	-5.0 ± 31.0	-3.3 ± 4.1
	03/28/06	3.2 ± 6.7	-7.0 ± 30.0	-2.8 ± 3.7	2.5 ± 4.3	7.0 ± 28.0	-0.7 ± 4.4
	04/25/06	0.0 ± 5.9	-18.0 ± 40.0	-4.1 ± 4.0	-3.2 ± 4.1	21.0 ± 36.0	0.3 ± 3.8
	05/30/06	-1.3 ± 5.8	-29.0 ± 32.0	0.6 ± 4.0	0.8 ± 4.4	31.0 ± 34.0	0.3 ± 4.0
	06/27/06	0.0 ± 6.0	14.0 ± 25.0	3.0 ± 3.2	-0.7 ± 3.2	-2.0 ± 29.0	0.5 ± 2.9
	07/25/06	-0.9 ± 5.0	-10.0 ± 19.0	1.1 ± 2.5	0.5 ± 2.1	1.0 ± 24.0	-0.9 ± 2.0
	08/29/06	-1.9 ± 5.0	4.0 ± 22.0	-1.9 ± 2.5	-0.7 ± 2.5	-8.0 ± 25.0	-1.7 ± 2.9
	09/26/06	-1.9 ± 3.6	-3.0 ± 20.0	0.6 ± 2.2	0.1 ± 2.4	-11.0 ± 21.0	0.1 ± 2.5
	10/31/06 11/28/06	-2.9 ± 3.7	10.0 ± 25.0	-0.7 ± 3.0	2.0 ± 3.1	-5.0 ± 26.0	-2.2 ± 3.5
	12/26/06	-3.5 ± 6.0 2.1 ± 5.5	14.0 ± 27.0 7.0 ± 25.0	-2.5 ± 3.2 0.7 ± 3.1	4.6 ± 4.2 2.3 ± 3.9	31.0 ± 32.0 14.0 ± 25.0	-0.1 ± 3.6 -0.3 ± 3.6
		Cs-137	Fe-59	H-3	I-131	K-40	La-140
	01/31/06	-2.1 ± 3.1	1.9 ± 7.4	50.0 ± 120.0	0.3 ± 6.3	274.0 ± 72.0	0.0 ± 5.5
	02/28/06	-2.2 ± 3.4	-3.8 ± 7.8	540.0 ± 160.0	-3.4 ± 6.2	229.0 ± 78.0	1.0 ± 6.4
	03/28/06	-0.4 ± 3.5	3.5 ± 7.3	770.0 ± 190.0	-3.3 ± 6.4	263.0 ± 88.0	3.7 ± 7.7
	04/25/06	0.6 ± 3.6	1.9 ± 9.5	550.0 ± 180.0	-4.4 ± 6.9	316.0 ± 82.0	0.0 ± 6.8
	05/30/06	-2.3 ± 3.5	0.9 ± 8.2	190.0 ± 170.0	-2.2 ± 7.5	288.0 ± 88.0	-1.5 ± 6.7
•	06/27/06	-1.1 ± 2.4	1.5 ± 7.0	90.0 ± 170.0	0.0 ± 8.0	226.0 ± 72.0	0.0 ± 6.9
	07/25/06	0.0 ± 2.0	2.1 ± 4.9	50.0 ± 180.0	0.7 ± 8.0	259.0 ± 53.0	-1.0 ± 5.8
	08/29/06	2.9 ± 2.6	3.5 ± 5.7	350.0 ± 180.0	-4.2 ± 5.6	338.0 ± 60.0	-2.2 ± 5.8
	09/26/06	0.2 ± 2.1	0.6 ± 4.4	190.0 ± 990.0	-0.1 ± 5.1	268.0 ± 48.0	-2.2 ± 4.1
	10/31/06	0.0 ± 2.7	-0.9 ± 6.2	270.0 ± 900.0	5.0 ± 5.4	299.0 ± 63.0	-3.3 ± 4.2
	11/28/06 12/26/06	-1.3 ± 3.7 -1.4 ± 3.1	1.2 ± 7.6 1.7 ± 7.3	$290.0 \pm 180.0 \\ 550.0 \pm 170.0$	-1.4 ± 6.2 0.9 ± 5.1	330.0 ± 86.0 236.0 ± 75.0	-4.1 ± 6.9 2.5 ± 6.3
		Mn-54	Nb-95	Ru-103	Ru-106	Sb-125	Th-228
	01/31/06	3.7 ± 3.0	-2.8 ± 3.7	-0.1 ± 3.5	5.0 ± 33.0	-0.8 ± 9.1	-13.0 ± 12.0
	02/28/06	-0.6 ± 3.3	0.0 ± 4.2	-0.9 ± 3.8	-10.0 ± 33.0	-0.8 ± 9.0	1.0 ± 12.0
	03/28/06	2.3 ± 3.6	0.0 ± 4.6	1.1 ± 4.2	20.0 ± 30.0	-0.4 ± 9.7	5.0 ± 14.0
	04/25/06	-1.2 ± 3.8	0.3 ± 4.8	-0.8 ± 4.4	11.0 ± 32.0	4.8 ± 9.5	-4.0 ± 15.0
	05/30/06	-1.7 ± 4.1	-1.7 ± 5.1	-3.1 ± 4.6	-7.0 ± 40.0	-4.6 ± 8.8	1.0 ± 14.0
	06/27/06	-0.7 ± 2.7	-1.7 ± 3.3	-3.5 ± 3.3	0.0 ± 24.0	-2.7 ± 7.1	-4.2 ± 9.5
	07/25/06	1.0 ± 1.9	1.8 ± 2.9	-1.8 ± 2.7	5.0 ± 20.0	2.3 ± 5.2	-3.4 ± 7.1
	08/29/06	-0.3 ± 2.4	0.1 ± 2.9	-0.2 ± 2.6	-19.0 ± 24.0	0.3 ± 7.2	3.0 ± 10.0
	09/26/06 10/31/06	-1.3 ± 2.1 -0.1 ± 2.9	0.3 ± 2.5 -1.2 ± 3.1	-2.4 ± 2.5 -1.0 ± 3.3	-12.0 ± 19.0 39.0 ± 28.0	5.4 ± 5.6 4.9 ± 7.4	-7.7 ± 8.5 8.0 ± 10.0
	11/28/06	-0.1 ± 2.9 -3.7 ± 3.1	-1.2 ± 3.1 -0.7 ± 3.7	-0.6 ± 3.4	-21.0 ± 34.0	-0.6 ± 8.7	12.0 ± 13.0
	12/26/06	-0.4 ± 3.2	-0.2 ± 4.0	-1.7 ± 3.1	-6.0 ± 27.0	-4.9 ± 7.4	3.0 ± 12.0
		Zn-65	Zr-95				
	01/31/06	-3.7 ± 7.5	-0.7 ± 6.1				
	02/28/06	13.0 ± 13.0	3.2 ± 6.1				
	03/28/06	-3.0 ± 7.7	-0.4 ± 7.2				
	04/25/06	4.0 ± 16.0	1.7 ± 6.3				
	05/30/06	2.0 ± 10.0	3.6 ± 6.9				
	06/27/06	2.8 ± 6.3	5.8 ± 5.4				
	07/25/06	-3.0 ± 5.4	0.5 ± 4.1			,	
	08/29/06	-4.4 ± 5.8	-0.7 ± 4.2	•			
	09/26/06	-5.1 ± 6.7	1.3 ± 3.8	•			
	10/31/06	0.0 ± 6.7	-1.3 ± 4.2				
	11/28/06	-4.3 ± 8.0	-1.3 ± 5.9				
	12/26/06	-3.0 ± 7.0	0.5 ± 5.4				

Table 14, Sea Water (pCi/L)

Location	Collection Date			Isotope			
37-C		Ba-140	Be-7	Co-58	Co-60	Cr-51	Cs-134
	02/28/06	0.2 ± 5.3	-16.0 ± 28.0	-2.6 ± 3.2	-2.1 ± 3.4	6.0 ± 33.0	1.1 ± 3.9
	06/06/06	-3.2 ± 4.6	-10.0 ± 21.0	-1.9 ± 2.6	0.0 ± 3.7	13.0 ± 23.0	-3.0 ± 2.8
	09/05/06	1.4 ± 5.2	-5.0 ± 21.0	-2.8 ± 2.8	-1.9 ± 3.2	-1.0 ± 24.0	3.6 ± 3.0
	12/05/06	3.5 ± 4.2	22.0 ± 23.0	0.6 ± 2.4	2.1 ± 2.5	5.0 ± 23.0	0.5 ± 2.7
		Cs-137	Fe-59	H-3	I-131	K-40	La-140
	02/28/06	2.1 ± 3.2	3.3 ± 6.1	-70.0 ± 150.0	-7.2 ± 6.2	209.0 ± 66.0	0.2 ± 6.1
	06/06/06	1.2 ± 2.9	-0.7 ± 6.6	-300.0 ± 860.0	0.3 ± 4.9	262.0 ± 66.0	-3.7 ± 5.2
	09/05/06	-0.7 ± 3.1	-0.4 ± 6.8	-320.0 ± 770.0	-2.2 ± 4.7	276.0 ± 64.0	1.6 ± 5.9
	12/05/06	-0.9 ± 2.4	-4.4 ± 5.5	310.0 ± 860.0	-3.7 ± 5.2	235.0 ± 50.0	4.0 ± 4.9
		Mn-54	Nb-95	Ru-103	Ru-106	Sb-125	Th-228
	02/28/06	-0.6 ± 3.3	0.2 ± 3.5	-0.5 ± 3.3	11.0 ± 29.0	-1.8 ± 9.3	1.0 ± 11.0
	06/06/06	-2.3 ± 2.6	2.9 ± 2.8	-1.7 ± 2.6	18.0 ± 25.0	-7.1 ± 6.4	13.0 ± 12.0
	09/05/06	-0.7 ± 2.6	-2.1 ± 3.2	0.1 ± 2.8	-1.0 ± 25.0	3.4 ± 7.3	6.0 ± 13.0
	12/05/06	2.3 ± 2.3	-1.1 ± 2.7	-1.6 ± 2.8	-2.0 ± 23.0	3.6 ± 6.0	2.0 ± 11.0
		Zn-65	Zr-95				
	02/28/06	-7.5 ± 8.3	0.3 ± 5.3				,
	06/06/06	-4.7 ± 6.9	-1.8 ± 4.6				
	09/05/06	1.8 ± 8.9	2.7 ± 4.9				
	12/05/06	-5.0 ± 6.1	-0.2 ± 4.2				

Table 15, Bottom Sediment (pCi/g Dry)

Location	Collection Date			Isotope	12,47,474		
29		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
		$\begin{array}{c} -0.011 \pm 0.029 \\ -0.005 \pm 0.036 \end{array}$	0.010 ± 0.180 0.050 ± 0.260	$\begin{array}{c} -0.016 \pm 0.018 \\ 0.010 \pm 0.031 \end{array}$	0.006 ± 0.021 0.024 ± 0.029	-0.150 ± 0.220 -0.100 ± 0.340	0.047 ± 0.089 0.011 ± 0.044
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	04/26/06 10/17/06	0.028 ± 0.028 0.011 ± 0.029	-0.041 ± 0.053 -0.030 ± 0.073	-0.005 ± 0.053 -0.010 ± 0.170	13.880 ± 0.920 16.930 ± 0.970	-0.008 ± 0.024 -0.004 ± 0.028	0.000 ± 0.027 -0.012 \pm 0.043
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	04/26/06 10/17/06	$\begin{array}{c} 0.016 \pm 0.021 \\ \text{-}0.007 \pm 0.036 \end{array}$	$-0.040 \pm 0.190 \\ 0.040 \pm 0.250$	$-0.014 \pm 0.058 \\ -0.004 \pm 0.070$	1.043 ± 0.096 1.200 ± 0.110	$-0.070 \pm 0.110 \\ -0.080 \pm 0.120$	0.041 ± 0.040 -0.010 ± 0.058
31		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
		-0.032 ± 0.039 -0.004 ± 0.033	0.260 ± 0.280 0.100 ± 0.230	-0.014 ± 0.026 -0.017 ± 0.026	-0.009 ± 0.030 -0.005 ± 0.021	0.010 ± 0.350 0.060 ± 0.260	$\begin{array}{c} 0.019 \pm 0.029 \\ 0.005 \pm 0.024 \end{array}$
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	04/27/06 11/07/06	$\begin{array}{c} 0.026 \pm 0.034 \\ -0.003 \pm 0.026 \end{array}$	-0.031 ± 0.064 0.017 ± 0.064	$\begin{array}{c} 0.064 \pm 0.094 \\ 0.022 \pm 0.077 \end{array}$	11.100 ± 0.900 17.700 ± 1.100	-0.002 ± 0.049 -0.007 ± 0.028	-0.005 ± 0.040 -0.002 ± 0.034
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	04/27/06 11/07/06	$0.011 \pm 0.036 \\ 0.006 \pm 0.029$	0.040 ± 0.290 -0.060 ± 0.240	-0.025 ± 0.079 -0.003 ± 0.060	3.320 ± 0.160 0.870 ± 0.110	0.060 ± 0.130 0.070 ± 0.100	-0.024 ± 0.076 0.048 ± 0.051
32		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	04/26/06 10/17/06	-0.027 ± 0.033 0.018 ± 0.055	0.000 ± 0.220 0.050 ± 0.390	0.011 ± 0.027 -0.023 ± 0.036	-0.011 ± 0.032 0.010 ± 0.042	0.000 ± 0.240 0.220 ± 0.460	-0.008 ± 0.021 0.016 ± 0.039
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	04/26/06 10/17/06	$\begin{array}{c} 0.004 \pm 0.028 \\ \text{-}0.029 \pm 0.042 \end{array}$	$\begin{array}{c} 0.038 \pm 0.071 \\ 0.000 \pm 0.110 \end{array}$	0.004 ± 0.054 -0.130 ± 0.350	12.700 ± 1.300 14.600 ± 1.400	0.013 ± 0.028 -0.005 \pm 0.035	0.007 ± 0.042 -0.052 ± 0.060
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
		$-0.009 \pm 0.027 \\ -0.043 \pm 0.044$	0.060 ± 0.220 -0.160 ± 0.350	$\begin{array}{c} 0.007 \pm 0.072 \\ 0.011 \pm 0.087 \end{array}$	0.660 ± 0.130 0.950 ± 0.160	$-0.020 \pm 0.140 \\ 0.050 \pm 0.170$	-0.024 ± 0.049 0.019 ± 0.075
33		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	04/26/06 11/03/06	0.016 ± 0.039 -0.008 \pm 0.031	0.050 ± 0.210 0.160 ± 0.230	0.008 ± 0.026 -0.011 \pm 0.025	-0.009 ± 0.025 -0.003 ± 0.022	0.030 ± 0.240 -0.100 \pm 0.320	-0.009 ± 0.036 0.021 ± 0.027
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	04/26/06 11/03/06	$\begin{array}{c} 0.000 \pm 0.032 \\ \text{-}0.007 \pm 0.026 \end{array}$	-0.039 ± 0.065 -0.032 ± 0.059	0.003 ± 0.062 0.090 ± 0.100	16.700 ± 1.400 12.130 ± 0.880	-0.015 ± 0.021 0.009 ± 0.024	0.011 ± 0.032 -0.001 \pm 0.043

Table 15, Bottom Sediment (pCi/g Dry)

Location	Collection Date			Isotope			
33		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	04/26/06 11/03/06	0.006 ± 0.024 -0.010 \pm 0.026	$-0.070 \pm 0.240 \\ 0.030 \pm 0.190$	0.086 ± 0.061 0.020 ± 0.062	0.340 ± 0.100 0.880 ± 0.100	-0.033 ± 0.081 -0.060 ± 0.110	0.003 ± 0.038 -0.012 \pm 0.048
34		Ag-110m	B e-7	Co-58	Co-60	Cr-51	Cs-134
		-0.022 ± 0.031 -0.007 ± 0.031	0.090 ± 0.170 0.230 ± 0.210	0.007 ± 0.024 -0.038 \pm 0.031	0.002 ± 0.026 0.008 ± 0.027	-0.050 ± 0.160 0.080 ± 0.230	-0.003 ± 0.018 0.003 ± 0.020
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	04/26/06 11/03/06	0.025 ± 0.024 0.011 ± 0.021	-0.033 ± 0.059 -0.011 ± 0.081	0.054 ± 0.046 -0.028 \pm 0.095	15.100 ± 1.300 15.200 ± 1.300	-0.021 ± 0.024 0.028 ± 0.028	-0.011 ± 0.031 -0.017 ± 0.036
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
		-0.005 ± 0.016 -0.027 ± 0.027	-0.100 ± 0.170 -0.050 ± 0.180	-0.033 ± 0.051 -0.021 ± 0.058	0.086 ± 0.096 0.100 ± 0.140	-0.018 ± 0.066 0.030 ± 0.120	-0.011 ± 0.036 0.007 ± 0.044
35-X		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	04/26/06 10/17/06	0.010 ± 0.040 0.000 ± 0.050	0.270 ± 0.260 0.320 ± 0.380	-0.025 ± 0.034 -0.014 ± 0.040	0.013 ± 0.038 -0.002 ± 0.038	0.130 ± 0.310 0.180 ± 0.520	0.031 ± 0.030 0.026 ± 0.038
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	04/26/06 10/17/06	0.041 ± 0.040 0.011 ± 0.040	0.031 ± 0.079 0.030 ± 0.110	0.019 ± 0.077 0.210 ± 0.360	11.800 ± 1.400 16.200 ± 1.400	$\begin{array}{c} 0.026 \pm 0.034 \\ 0.000 \pm 0.038 \end{array}$	-0.039 ± 0.046 0.007 ± 0.069
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	04/26/06 10/17/06	0.024 ± 0.033 0.007 ± 0.054	0.020 ± 0.330 -0.060 \pm 0.350	-0.052 ± 0.081 -0.078 ± 0.086	0.770 ± 0.140 0.870 ± 0.160	$-0.040 \pm 0.160 \\ -0.050 \pm 0.180$	-0.002 ± 0.052 0.036 ± 0.078
				-			<u></u>
37-C		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
		-0.034 ± 0.028 -0.003 ± 0.041	0.100 ± 0.180 -0.060 ± 0.210	0.005 ± 0.023 0.036 ± 0.030	0.001 ± 0.026 - 0.012 ± 0.025	0.050 ± 0.170 -0.110 ± 0.270	$0.010 \pm 0.017 \\ 0.018 \pm 0.036$
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	04/27/06 11/07/06	0.027 ± 0.019 0.030 ± 0.031	0.000 ± 0.057 0.033 ± 0.076	0.034 ± 0.043 0.014 ± 0.079	15.400 ± 1.100 13.200 ± 1.300	-0.002 ± 0.021 0.013 ± 0.028	0.011 ± 0.025 -0.018 \pm 0.032
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	04/27/06 11/07/06	0.012 ± 0.021 0.000 ± 0.032	0.060 ± 0.150 0.070 ± 0.230	0.019 ± 0.045 -0.012 ± 0.061	0.348 ± 0.084 0.440 ± 0.120	-0.078 ± 0.060 -0.036 ± 0.073	-0.035 ± 0.034 -0.047 ± 0.045

Table 15, Bottom Sediment (pCi/g Dry)

Page 3 of 3

Location	Collection Date			Isotope		<u> </u>	
39-X		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
		-0.003 ± 0.038 -0.031 ± 0.062	0.010 ± 0.270 -0.260 \pm 0.530	-0.024 ± 0.029 0.003 ± 0.055	0.014 ± 0.042 0.097 ± 0.047	0.230 ± 0.290 0.990 ± 0.700	-0.002 ± 0.029 0.034 ± 0.049
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	04/26/06 10/17/06	0.174 ± 0.057 0.109 ± 0.062	0.043 ± 0.079 -0.050 ± 0.120	0.062 ± 0.078 0.380 ± 0.460	15.100 ± 1.400 19.500 ± 1.700	$\begin{array}{c} 0.006 \pm 0.032 \\ 0.000 \pm 0.046 \end{array}$	-0.030 ± 0.037 -0.058 ± 0.074
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	04/26/06 10/17/06	0.004 ± 0.035 0.000 ± 0.064	$-0.180 \pm 0.270 \\ 0.060 \pm 0.430$	$\begin{array}{c} 0.040 \pm 0.070 \\ 0.160 \pm 0.120 \end{array}$	0.570 ± 0.140 0.960 ± 0.200	$-0.040 \pm 0.150 \\ 0.070 \pm 0.220$	$-0.018 \pm 0.045 \\ -0.010 \pm 0.098$
67-X		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	04/26/06 11/03/06	$\begin{array}{c} 0.014 \pm 0.052 \\ 0.006 \pm 0.031 \end{array}$	-0.050 ± 0.340 0.280 ± 0.250	-0.035 ± 0.048 -0.017 ± 0.029	0.047 ± 0.049 0.016 ± 0.022	-0.060 ± 0.360 -0.130 ± 0.330	$\begin{array}{c} -0.026 \pm 0.040 \\ 0.005 \pm 0.024 \end{array}$
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	04/26/06 11/03/06	0.183 ± 0.089 0.096 ± 0.038	-0.100 ± 0.110 0.011 ± 0.065	-0.036 ± 0.080 -0.070 ± 0.130	14.100 ± 1.800 16.830 ± 0.970	0.040 ± 0.045 0.009 ± 0.027	-0.033 ± 0.067 -0.035 ± 0.041
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	04/26/06 11/03/06	$\begin{array}{c} -0.026 \pm 0.044 \\ 0.009 \pm 0.034 \end{array}$	$-0.030 \pm 0.370 \\ 0.130 \pm 0.220$	$0.030 \pm 0.110 \\ 0.034 \pm 0.069$	1.600 ± 0.200 1.820 ± 0.120	0.020 ± 0.240 -0.040 ± 0.120	-0.029 ± 0.087 0.032 ± 0.054
69-X		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	04/26/06 11/03/06	-0.008 ± 0.037 0.024 ± 0.022	0.090 ± 0.180 0.030 ± 0.180	-0.005 ± 0.022 -0.007 ± 0.020	-0.001 ± 0.029 0.005 ± 0.018	$\begin{array}{c} 0.180 \pm 0.220 \\ 0.110 \pm 0.220 \end{array}$	-0.004 ± 0.021 0.034 ± 0.056
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	04/26/06 11/03/06	$\begin{array}{c} 0.008 \pm 0.027 \\ 0.009 \pm 0.018 \end{array}$	-0.026 ± 0.069 0.009 ± 0.050	-0.010 ± 0.045 -0.008 ± 0.085	15.400 ± 1.300 15.450 ± 0.860	-0.007 ± 0.025 0.002 ± 0.017	0.003 ± 0.025 -0.033 \pm 0.025
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
		$\begin{array}{c} -0.017 \pm 0.022 \\ -0.006 \pm 0.019 \end{array}$	0.000 ± 0.200 -0.010 ± 0.160	$-0.025 \pm 0.059 \\ 0.050 \pm 0.048$	0.140 ± 0.130 0.191 ± 0.071	0.000 ± 0.071 0.080 ± 0.085	-0.015 ± 0.032 -0.022 ± 0.029

Table 16, Aquatic Flora - Fucus (pCi/g Dry)

Location	Collection Date			Isotope			
29		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	02/07/06 05/17/06 08/08/06 11/20/06	-0.020 ± 0.016	0.117 ± 0.060 0.080 ± 0.110 0.060 ± 0.110 0.140 ± 0.110	0.000 ± 0.005 -0.003 ± 0.012 -0.005 ± 0.014 -0.004 ± 0.012	0.004 ± 0.009 0.007 ± 0.020 -0.008 ± 0.022 -0.004 ± 0.014	0.012 ± 0.040 0.006 ± 0.094 -0.060 ± 0.110 0.010 ± 0.110	0.002 ± 0.006 -0.004 ± 0.015 0.001 ± 0.017 -0.002 ± 0.014
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	02/07/06 05/17/06 08/08/06 11/20/06		$\begin{array}{c} -0.005 \pm 0.014 \\ 0.000 \pm 0.031 \\ -0.013 \pm 0.030 \\ -0.026 \pm 0.032 \end{array}$	$\begin{array}{c} 0.019 \pm 0.012 \\ 0.002 \pm 0.017 \\ -0.005 \pm 0.023 \\ 0.028 \pm 0.022 \end{array}$	4.860 ± 0.300 4.360 ± 0.600 6.690 ± 0.670 6.810 ± 0.540	0.003 ± 0.005 -0.009 ± 0.014 -0.002 ± 0.013 0.006 ± 0.012	-0.004 ± 0.005 0.007 ± 0.013 -0.006 ± 0.015 -0.001 ± 0.012
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
,	02/07/06 05/17/06 08/08/06 11/20/06	$\begin{array}{c} 0.002 \pm 0.005 \\ 0.006 \pm 0.010 \\ -0.011 \pm 0.016 \\ -0.004 \pm 0.011 \end{array}$	$\begin{array}{c} -0.005 \pm 0.047 \\ 0.010 \pm 0.120 \\ -0.040 \pm 0.130 \\ -0.040 \pm 0.110 \end{array}$	$\begin{array}{c} -0.007 \pm 0.011 \\ -0.005 \pm 0.032 \\ -0.017 \pm 0.029 \\ -0.001 \pm 0.033 \end{array}$	$\begin{array}{c} 0.023 \pm 0.022 \\ -0.035 \pm 0.064 \\ 0.005 \pm 0.059 \\ 0.042 \pm 0.050 \end{array}$	$\begin{array}{c} 0.002 \pm 0.015 \\ -0.009 \pm 0.026 \\ -0.006 \pm 0.034 \\ 0.012 \pm 0.030 \end{array}$	$\begin{array}{c} -0.008 \pm 0.009 \\ -0.005 \pm 0.020 \\ 0.004 \pm 0.028 \\ 0.001 \pm 0.022 \end{array}$
32-X		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	08/08/06	0.001 ± 0.002 -0.001 ± 0.013 -0.004 ± 0.017 -0.002 ± 0.025	0.084 ± 0.020 0.072 ± 0.085 0.078 ± 0.088 0.120 ± 0.130	$\begin{array}{c} -0.001 \pm 0.002 \\ 0.009 \pm 0.011 \\ -0.003 \pm 0.011 \\ 0.014 \pm 0.017 \end{array}$	$ \begin{array}{c} -0.001 \pm 0.002 \\ 0.003 \pm 0.016 \\ 0.001 \pm 0.016 \\ 0.007 \pm 0.025 \end{array} $	$\begin{array}{c} -0.007 \pm 0.018 \\ 0.044 \pm 0.059 \\ 0.019 \pm 0.086 \\ -0.010 \pm 0.120 \end{array}$	0.001 ± 0.002 -0.007 \pm 0.012 0.008 ± 0.013 -0.001 \pm 0.020
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	02/07/06 05/17/06 08/08/06 11/20/06	$\begin{array}{c} -0.001 \pm 0.002 \\ 0.007 \pm 0.009 \\ 0.012 \pm 0.013 \\ 0.011 \pm 0.018 \end{array}$	0.000 ± 0.005 -0.003 ± 0.027 0.009 ± 0.027 0.004 ± 0.046	0.029 ± 0.011 0.006 ± 0.011 0.013 ± 0.018 0.050 ± 0.031	5.793 ± 0.085 4.220 ± 0.560 5.820 ± 0.530 6.920 ± 0.820	$\begin{array}{c} -0.002 \pm 0.002 \\ 0.005 \pm 0.008 \\ -0.010 \pm 0.012 \\ 0.013 \pm 0.018 \end{array}$	$\begin{array}{c} 0.001 \pm 0.003 \\ -0.002 \pm 0.012 \\ -0.003 \pm 0.012 \\ 0.006 \pm 0.020 \end{array}$
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	05/17/06 08/08/06	$\begin{array}{c} 0.000 \pm 0.002 \\ -0.003 \pm 0.009 \\ -0.002 \pm 0.010 \\ 0.013 \pm 0.018 \end{array}$	0.000 ± 0.014 0.025 ± 0.087 0.060 ± 0.100 -0.060 ± 0.130	$\begin{array}{c} -0.001 \pm 0.004 \\ 0.002 \pm 0.025 \\ -0.003 \pm 0.025 \\ -0.018 \pm 0.046 \end{array}$	$\begin{array}{c} 0.040 \pm 0.005 \\ 0.036 \pm 0.043 \\ 0.059 \pm 0.053 \\ 0.053 \pm 0.077 \end{array}$	$\begin{array}{c} 0.003 \pm 0.008 \\ \text{-}0.003 \pm 0.033 \\ \text{-}0.031 \pm 0.030 \\ 0.007 \pm 0.041 \end{array}$	0.002 ± 0.003 0.004 ± 0.021 0.013 ± 0.020 0.008 ± 0.033
33-X		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
		$\begin{array}{c} -0.001 \pm 0.012 \\ -0.004 \pm 0.007 \\ 0.009 \pm 0.019 \\ 0.005 \pm 0.028 \end{array}$	0.092 ± 0.090 0.060 ± 0.042 0.067 ± 0.098 0.170 ± 0.170	$\begin{array}{c} -0.001 \pm 0.007 \\ -0.002 \pm 0.005 \\ -0.001 \pm 0.013 \\ 0.005 \pm 0.022 \end{array}$	$ \begin{array}{c} -0.002 \pm 0.013 \\ -0.003 \pm 0.007 \\ 0.002 \pm 0.016 \\ 0.002 \pm 0.023 \end{array} $	-0.010 ± 0.058 0.012 ± 0.039 -0.050 ± 0.100 0.030 ± 0.170	$\begin{array}{c} 0.007 \pm 0.008 \\ 0.003 \pm 0.006 \\ 0.006 \pm 0.016 \\ -0.010 \pm 0.021 \end{array}$
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	02/08/06 05/17/06 08/09/06 11/21/06	$\begin{array}{c} 0.009 \pm 0.008 \\ 0.003 \pm 0.005 \\ -0.017 \pm 0.013 \\ 0.017 \pm 0.021 \end{array}$	-0.001 ± 0.022 0.006 ± 0.013 0.017 ± 0.027 -0.012 ± 0.044	0.009 ± 0.011 0.009 ± 0.009 0.011 ± 0.019 0.030 ± 0.029	6.710 ± 0.470 4.040 ± 0.240 6.000 ± 0.550 7.220 ± 0.880	$\begin{array}{c} -0.001 \pm 0.008 \\ 0.001 \pm 0.006 \\ 0.002 \pm 0.014 \\ 0.000 \pm 0.019 \end{array}$	$\begin{array}{c} 0.006 \pm 0.009 \\ -0.004 \pm 0.005 \\ 0.001 \pm 0.015 \\ -0.012 \pm 0.020 \end{array}$

Table 16, Aquatic Flora - Fucus (pCi/g Dry)

Location	Collection Date		-	Isotope			<u> </u>
33-X		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	02/08/06 05/17/06 08/09/06 11/21/06	$\begin{array}{c} 0.004 \pm 0.007 \\ -0.003 \pm 0.005 \\ 0.007 \pm 0.013 \\ -0.012 \pm 0.016 \end{array}$	$ \begin{array}{l} -0.039 \pm 0.070 \\ -0.011 \pm 0.047 \\ 0.010 \pm 0.110 \\ 0.040 \pm 0.180 \end{array} $	$\begin{array}{c} 0.000 \pm 0.016 \\ 0.003 \pm 0.011 \\ 0.002 \pm 0.028 \\ 0.015 \pm 0.041 \end{array}$	0.040 ± 0.033 0.021 ± 0.020 0.017 ± 0.059 0.036 ± 0.089	$\begin{array}{c} 0.004 \pm 0.023 \\ -0.004 \pm 0.013 \\ 0.036 \pm 0.045 \\ -0.016 \pm 0.050 \end{array}$	$\begin{array}{c} 0.005 \pm 0.012 \\ 0.010 \pm 0.009 \\ 0.015 \pm 0.024 \\ -0.014 \pm 0.032 \end{array}$
35-X		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	05/17/06 08/08/06	$\begin{array}{c} -0.002 \pm 0.009 \\ -0.001 \pm 0.014 \\ -0.005 \pm 0.026 \\ -0.009 \pm 0.023 \end{array}$	0.246 ± 0.072 0.082 ± 0.085 0.150 ± 0.160 0.140 ± 0.140	$ \begin{array}{c} -0.002 \pm 0.005 \\ -0.005 \pm 0.012 \\ 0.002 \pm 0.019 \\ -0.002 \pm 0.015 \end{array} $	-0.002 ± 0.008 0.000 ± 0.013 -0.001 ± 0.028 0.003 ± 0.020	$\begin{array}{c} -0.036 \pm 0.043 \\ 0.017 \pm 0.078 \\ 0.020 \pm 0.150 \\ 0.200 \pm 0.140 \end{array}$	$\begin{array}{c} 0.000 \pm 0.006 \\ \text{-}0.001 \pm 0.012 \\ 0.009 \pm 0.016 \\ \text{-}0.010 \pm 0.016 \end{array}$
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	02/08/06 05/17/06 08/08/06 11/21/06	$\begin{array}{c} 0.004 \pm 0.006 \\ 0.008 \pm 0.009 \\ 0.013 \pm 0.021 \\ 0.006 \pm 0.018 \end{array}$	-0.004 ± 0.014 -0.024 ± 0.017 0.055 ± 0.046 -0.015 ± 0.036	0.013 ± 0.012 0.016 ± 0.015 0.024 ± 0.033 0.025 ± 0.025	5.810 ± 0.320 3.950 ± 0.450 10.340 ± 0.990 6.080 ± 0.640	0.007 ± 0.006 -0.002 ± 0.011 -0.008 ± 0.019 -0.005 ± 0.016	$\begin{array}{c} \text{-0.003} \pm 0.006 \\ 0.000 \pm 0.011 \\ \text{-0.008} \pm 0.017 \\ \text{-0.002} \pm 0.016 \end{array}$
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	02/08/06 05/17/06 08/08/06 11/21/06	0.004 ± 0.009	$\begin{array}{c} -0.025 \pm 0.049 \\ 0.053 \pm 0.088 \\ 0.110 \pm 0.170 \\ 0.110 \pm 0.160 \end{array}$	-0.002 ± 0.013 -0.003 ± 0.023 -0.016 ± 0.039 -0.002 ± 0.041	0.060 ± 0.021 0.018 ± 0.039 0.070 ± 0.100 0.023 ± 0.074	-0.008 ± 0.016 0.012 ± 0.026 -0.028 ± 0.051 -0.018 ± 0.036	$\begin{array}{c} 0.003 \pm 0.011 \\ -0.004 \pm 0.020 \\ 0.031 \pm 0.028 \\ 0.017 \pm 0.029 \end{array}$
36-X		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
		0.001 ± 0.007 0.003 ± 0.013 -0.002 ± 0.014 -0.014 ± 0.018	0.118 ± 0.061 0.080 ± 0.080 -0.057 ± 0.093 0.100 ± 0.120	-0.002 ± 0.005 0.001 ± 0.009 0.001 ± 0.010 0.005 ± 0.014	$ \begin{array}{c} -0.003 \pm 0.007 \\ 0.008 \pm 0.014 \\ -0.003 \pm 0.013 \\ -0.006 \pm 0.016 \end{array} $	$ \begin{array}{c} -0.004 \pm 0.043 \\ 0.031 \pm 0.067 \\ 0.034 \pm 0.087 \\ -0.090 \pm 0.130 \end{array} $	$\begin{array}{c} -0.003 \pm 0.006 \\ 0.007 \pm 0.011 \\ 0.009 \pm 0.011 \\ -0.006 \pm 0.017 \end{array}$
		Cs-137	Fe-59	I-131	K-40	Mn-54	NБ-95
	02/08/06 05/17/06 08/09/06 11/20/06	$\begin{array}{c} 0.002 \pm 0.006 \\ 0.001 \pm 0.009 \\ 0.004 \pm 0.011 \\ 0.013 \pm 0.015 \end{array}$	$\begin{array}{c} -0.004 \pm 0.013 \\ 0.009 \pm 0.024 \\ -0.005 \pm 0.026 \\ -0.022 \pm 0.031 \end{array}$	$\begin{array}{c} 0.018 \pm 0.010 \\ 0.011 \pm 0.015 \\ 0.010 \pm 0.017 \\ 0.015 \pm 0.029 \end{array}$	5.690 ± 0.290 4.110 ± 0.430 3.710 ± 0.450 6.550 ± 0.600	$\begin{array}{c} -0.004 \pm 0.005 \\ 0.004 \pm 0.009 \\ -0.001 \pm 0.010 \\ 0.001 \pm 0.013 \end{array}$	$\begin{array}{c} -0.006 \pm 0.006 \\ 0.007 \pm 0.011 \\ 0.002 \pm 0.012 \\ -0.007 \pm 0.014 \end{array}$
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	05/17/06 08/09/06	$\begin{array}{c} -0.002 \pm 0.004 \\ -0.004 \pm 0.009 \\ 0.010 \pm 0.010 \\ -0.008 \pm 0.014 \end{array}$	$\begin{array}{c} 0.038 \pm 0.043 \\ 0.000 \pm 0.081 \\ 0.007 \pm 0.089 \\ 0.060 \pm 0.130 \end{array}$	0.005 ± 0.012 0.000 ± 0.023 -0.020 ± 0.027 0.002 ± 0.035	0.053 ± 0.024 0.027 ± 0.038 -0.003 ± 0.041 0.073 ± 0.058	-0.014 ± 0.016 0.012 ± 0.023 -0.028 ± 0.030 -0.001 ± 0.039	$\begin{array}{c} 0.001 \pm 0.009 \\ 0.014 \pm 0.016 \\ 0.004 \pm 0.018 \\ -0.003 \pm 0.024 \end{array}$
90-C		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
		-0.007 ± 0.013 -0.004 ± 0.021	0.186 ± 0.095 0.080 ± 0.130	-0.002 ± 0.009 0.015 ± 0.017	0.000 ± 0.016 0.006 ± 0.019	-0.029 ± 0.075 -0.100 ± 0.110	$\begin{array}{c} 0.009 \pm 0.011 \\ 0.004 \pm 0.021 \end{array}$

Table 16, Aquatic Flora - Fucus (pCi/g Dry)

Page 3 of 3

Location	Collection Date	l sotope							
90-C		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95		
	08/09/06 11/21/06	0.012 ± 0.009 -0.001 ± 0.016	0.009 ± 0.024 -0.011 ± 0.036	0.072 ± 0.022 0.142 ± 0.038	10.140 ± 0.550 6.430 ± 0.690	-0.003 ± 0.010 -0.011 ± 0.018	-0.007 ± 0.010 -0.009 ± 0.018		
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95		
	08/09/06 11/21/06	-0.003 ± 0.010 -0.012 ± 0.013	-0.006 ± 0.079 -0.110 ± 0.140	0.007 ± 0.019 0.000 ± 0.034	0.060 ± 0.038 0.098 ± 0.061	-0.021 ± 0.029 -0.040 ± 0.039	0.012 ± 0.017 -0.004 ± 0.027		

Table 17-A, Fish - Flounder (pCi/g Dry)

Location	Collection Date			Isotope			
32		Ag-110m	Be- 7	Co-58	Co-60	Cr-51	Cs-134
	03/30/06	J					
		-0.023 ± 0.039	0.020 ± 0.260	0.024 ± 0.025	-0.005 ± 0.030	-0.100 ± 0.270	-0.013 ± 0.030
		-0.014 ± 0.034	0.190 ± 0.280	-0.020 ± 0.027	-0.010 ± 0.040	-0.080 ± 0.250	-0.003 ± 0.026
	10/03/06	-0.027 ± 0.033	0.010 ± 0.200	-0.002 ± 0.024	0.009 ± 0.028	0.190 ± 0.250	0.012 ± 0.026
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	05/31/06	0.011 ± 0.033	-0.017 ± 0.061	-0.020 ± 0.052	4.690 ± 0.790	0.035 ± 0.028	-0.021 ± 0.030
	07/12/06	0.003 ± 0.042	0.023 ± 0.099	0.029 ± 0.053	3.700 ± 1.100	0.009 ± 0.038	0.018 ± 0.038
	10/03/06	-0.001 ± 0.026	-0.025 ± 0.058	0.004 ± 0.082	3.960 ± 0.610	0.006 ± 0.023	-0.011 ± 0.029
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	05/31/06	0.004 ± 0.028	-0.090 ± 0.270	-0.044 ± 0.081	0.000 ± 0.120	-0.014 ± 0.066	0.003 ± 0.046
	07/12/06		-0.040 ± 0.290	-0.028 ± 0.082	0.020 ± 0.140	0.047 ± 0.089	-0.003 ± 0.047
	10/03/06	-0.002 ± 0.025	-0.210 ± 0.250	-0.033 ± 0.061	-0.007 ± 0.094	0.024 ± 0.062	-0.006 ± 0.045
35		Ag-110m	Be- 7	Co-58	Co-60	Cr-51	Cs-134
	03/30/06	Ţ					
	04/17/06	0.007 ± 0.031	0.000 ± 0.170	-0.006 ± 0.025	0.006 ± 0.030	0.000 ± 0.190	0.001 ± 0.027
	07/12/06	0.011 ± 0.032	-0.160 ± 0.220	-0.008 ± 0.027	-0.003 ± 0.030	-0.020 ± 0.260	0.008 ± 0.030
	11/15/06	-0.007 ± 0.015	0.004 ± 0.085	-0.008 ± 0.011	0.002 ± 0.012	-0.011 ± 0.097	0.008 ± 0.013
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	04/17/06	0.020 ± 0.019	0.044 ± 0.055	-0.029 ± 0.057	2.910 ± 0.850	-0.016 ± 0.019	-0.016 ± 0.026
		-0.002 ± 0.035	0.038 ± 0.054	0.000 ± 0.047	3.700 ± 1.000	0.004 ± 0.026	0.010 ± 0.025
	11/15/06	-0.003 ± 0.011	-0.021 ± 0.025	0.005 ± 0.019	3.840 ± 0.400	0.012 ± 0.011	0.016 ± 0.013
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	04/17/06	-0.006 ± 0.021	0.030 ± 0.190	0.000 ± 0.061	-0.040 ± 0.096	-0.013 ± 0.053	0.001 ± 0.035
		-0.007 ± 0.021	-0.160 ± 0.330	-0.031 ± 0.075	-0.010 ± 0.110	-0.029 ± 0.052	-0.007 ± 0.049
	11/15/06	-0.004 ± 0.012	-0.050 ± 0.110	0.008 ± 0.028	0.008 ± 0.044	-0.024 ± 0.030	-0.003 ± 0.020

Table 17-B, Fish - Other (pCi/g Dry)

Location	Collection Date	Sample Type			Isotope		
32			Ag-110m	Be- 7	Co-58	Co-60	Cr-51
	03/30/06 06/06/06 08/28/06 10/31/06 12/18/06	FISH-OTHER TAUTOG TAUTOG TAUTOG STRIPED BASS	$ K \\ 0.036 \pm 0.036 \\ 0.034 \pm 0.033 \\ 0.000 \pm 0.010 \\ 0.001 \pm 0.008 $	0.030 ± 0.230 -0.050 ± 0.200 0.038 ± 0.054 -0.030 ± 0.046	0.015 ± 0.025 0.019 ± 0.019 -0.012 ± 0.007 0.001 ± 0.006	-0.011 ± 0.030 -0.006 ± 0.023 0.005 ± 0.007 0.004 ± 0.007	-0.010 ± 0.200 0.060 ± 0.220 -0.041 ± 0.063 0.028 ± 0.048
			Cs-134	Cs-137	Fe-59	I-131	K-40
	06/06/06 08/28/06 10/31/06 12/18/06	TAUTOG TAUTOG TAUTOG STRIPED BASS	-0.018 ± 0.032 0.002 ± 0.018 -0.002 ± 0.007 -0.003 ± 0.006	0.019 ± 0.031 0.004 ± 0.026 0.000 ± 0.007 0.006 ± 0.006	$\begin{array}{c} 0.051 \pm 0.068 \\ -0.006 \pm 0.052 \\ -0.004 \pm 0.017 \\ 0.006 \pm 0.015 \end{array}$	0.008 ± 0.039 0.010 ± 0.055 -0.004 ± 0.019 0.002 ± 0.016	2.960 ± 0.940 3.680 ± 0.770 3.770 ± 0.240 3.620 ± 0.220
	0.510.510.5	T 4 1 TO C	Mn-54	Nb-95	Ru-103	Ru-106	Sb-125
	06/06/06 08/28/06 10/31/06 12/18/06	TAUTOG TAUTOG TAUTOG STRIPED BASS	-0.004 ± 0.030 -0.014 ± 0.025 -0.003 ± 0.007 -0.001 ± 0.005	0.006 ± 0.029 0.018 ± 0.027 0.008 ± 0.008 0.004 ± 0.008	-0.006 ± 0.026 -0.024 ± 0.025 0.004 ± 0.007 -0.001 ± 0.006	0.160 ± 0.190 0.130 ± 0.220 0.042 ± 0.062 0.026 ± 0.046	-0.007 ± 0.077 0.005 ± 0.060 -0.005 ± 0.015 -0.005 ± 0.013
			Th-228	Zn-65	Zr-95		
	06/06/06 08/28/06 10/31/06 12/18/06	TAUTOG TAUTOG TAUTOG STRIPED BASS	-0.040 ± 0.100 -0.072 ± 0.092 -0.009 ± 0.034 0.014 ± 0.035	$\begin{array}{c} -0.010 \pm 0.061 \\ 0.006 \pm 0.071 \\ -0.003 \pm 0.016 \\ -0.006 \pm 0.014 \end{array}$	0.012 ± 0.037 0.035 ± 0.041 -0.010 ± 0.012 0.003 ± 0.013		
35			Ag-110m	B e-7	Co-58	Co-60	Cr-51
33	03/30/06 06/06/06 08/24/06 10/04/06	FISH-OTHER TAUTOG STRIPED BASS TAUTOG	$\begin{array}{c} & \text{K} \\ \text{K} \\ \text{-0.003} \pm 0.043 \\ \text{-0.020} \pm 0.032 \\ 0.007 \pm 0.019 \end{array}$	-0.030 ± 0.310 0.190 ± 0.190 0.000 ± 0.120	0.011 ± 0.035 0.006 ± 0.025 -0.005 ± 0.015	0.048 ± 0.042 0.021 ± 0.027 -0.011 ± 0.016	0.190 ± 0.360 -0.070 ± 0.200 -0.030 ± 0.150
	06/06/06 08/24/06 10/04/06	TAUTOG STRIPED BASS TAUTOG	$Cs-134$ -0.001 ± 0.034 -0.003 ± 0.022 -0.002 ± 0.016		$ \begin{aligned} & \textbf{Fe-59} \\ & 0.054 \pm 0.071 \\ & 0.023 \pm 0.055 \\ & 0.007 \pm 0.036 \end{aligned} $	$I-131 \\ 0.010 \pm 0.110 \\ -0.067 \pm 0.082 \\ 0.009 \pm 0.044$	$K-40$ 4.340 ± 0.930 4.100 ± 0.830 4.100 ± 0.510
	06/06/06 08/24/06 10/04/06	TAUTOG STRIPED BASS TAUTOG	$\begin{array}{c} \textbf{Mn-54} \\ 0.011 \pm 0.037 \\ 0.008 \pm 0.022 \\ 0.002 \pm 0.016 \end{array}$	Nb-95. -0.016 ± 0.039 -0.015 ± 0.032 -0.001 ± 0.021	$\mathbf{Ru-103} \\ -0.006 \pm 0.038 \\ 0.012 \pm 0.027 \\ 0.001 \pm 0.017$	$\mathbf{Ru-106} \\ -0.150 \pm 0.310 \\ 0.040 \pm 0.180 \\ 0.030 \pm 0.140$	Sb-125 0.004 ± 0.082 -0.029 ± 0.057 -0.020 ± 0.036
	06/06/06 08/24/06 10/04/06	TAUTOG STRIPED BASS TAUTOG	$Th-228$ 0.010 ± 0.150 0.008 ± 0.086 -0.038 ± 0.057	$ \mathbf{Zn-65} \\ -0.033 \pm 0.073 \\ 0.027 \pm 0.061 \\ 0.009 \pm 0.033 $	Zr-95 0.035 ± 0.060 0.037 ± 0.043 0.013 ± 0.027		
40-X	03/08/06 06/19/06	STRIPED BASS STRIPED BASS	Ag-110m 0.007 ± 0.020 -0.013 ± 0.023	$\begin{array}{c} \textbf{Be-7} \\ 0.020 \pm 0.150 \\ 0.000 \pm 0.130 \end{array}$		$Co-60$ 0.010 ± 0.022 -0.014 ± 0.019	Cr-51 -0.090 ± 0.130 -0.010 ± 0.160
	03/08/06 06/19/06	STRIPED BASS STRIPED BASS			$\mathbf{Fe-59} \\ -0.008 \pm 0.037 \\ -0.006 \pm 0.042$	$I-131 \\ 0.021 \pm 0.039 \\ -0.016 \pm 0.030$	$K-40$ 3.610 ± 0.600 3.730 ± 0.540

Table 17-B, Fish - Other (pCi/g Dry)

Location	Collection Date	Sample Type		Isotope				
40-X	03/08/06 06/19/06	STRIPED BASS STRIPED BASS	Mn-54 0.002 ± 0.015 -0.007 ± 0.017	Nb-95 -0.015 ± 0.019 0.005 ± 0.018	$\mathbf{Ru-103} \\ 0.001 \pm 0.017 \\ 0.001 \pm 0.016$	$\mathbf{Ru-106} \\ -0.020 \pm 0.120 \\ 0.000 \pm 0.140$	Sb-125 0.003 ± 0.039 -0.016 ± 0.039	
	03/08/06 06/19/06	STRIPED BASS STRIPED BASS	$\begin{array}{c} \textbf{Th-228} \\ 0.015 \pm 0.060 \\ \textbf{-0.016} \pm 0.061 \end{array}$	$ Zn-65 $ -0.012 ± 0.041 0.001 ± 0.039	$Zr-95$ -0.015 ± 0.030 0.010 ± 0.028			

Table 18, Mussels (pCi/g Dry)

Location	Collection Date			Isotope			**************************************
28		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	03/23/06	-0.006 ± 0.029	0.120 ± 0.160	-0.002 ± 0.022	-0.016 ± 0.021	0.040 ± 0.200	0.021 ± 0.023
	05/24/06	-0.003 ± 0.028	0.180 ± 0.200	0.004 ± 0.020	0.004 ± 0.025	0.010 ± 0.170	0.021 ± 0.020
		-0.006 ± 0.017	0.080 ± 0.100	-0.008 ± 0.012	0.003 ± 0.016	-0.100 ± 0.110	0.005 ± 0.012
	12/18/06	-0.012 ± 0.019	0.090 ± 0.130	-0.006 ± 0.013	0.009 ± 0.013	-0.070 ± 0.160	-0.009 ± 0.015
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	03/23/06	0.005 ± 0.023	0.028 ± 0.048	0.012 ± 0.057	1.790 ± 0.540	-0.021 ± 0.025	0.016 ± 0.027
	05/24/06	0.006 ± 0.024	0.009 ± 0.040	-0.017 ± 0.038	1.560 ± 0.500	-0.004 ± 0.018	0.000 ± 0.021
	07/10/06	-0.009 ± 0.013	0.000 ± 0.024	0.005 ± 0.028	2.120 ± 0.350	-0.002 ± 0.011	-0.012 ± 0.015
	12/18/06	0.010 ± 0.014	0.022 ± 0.029	0.021 ± 0.050	1.730 ± 0.360	0.004 ± 0.014	0.008 ± 0.016
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	03/23/06	0.000 ± 0.022	-0.080 ± 0.190	0.004 ± 0.057	0.047 ± 0.092	0.018 ± 0.041	0.004 ± 0.040
	05/24/06	-0.002 ± 0.017	0.060 ± 0.190	0.034 ± 0.054	0.064 ± 0.077	-0.034 ± 0.046	0.007 ± 0.037
		-0.001 ± 0.013	-0.010 ± 0.130	-0.003 ± 0.027	0.007 ± 0.054	-0.002 ± 0.030	-0.014 ± 0.021
	12/18/06	-0.004 ± 0.015	-0.010 ± 0.120	0.029 ± 0.035	0.023 ± 0.057	-0.007 ± 0.030	-0.004 ± 0.026
30		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	03/22/06	0.009 ± 0.030	0.070 ± 0.210	-0.017 ± 0.021	0.004 ± 0.019	0.020 ± 0.210	0.004 ± 0.019
	05/22/06	0.009 ± 0.030 0.026 ± 0.025	0.070 ± 0.210 0.110 ± 0.180	-0.007 ± 0.021 -0.004 ± 0.017	-0.004 ± 0.019 -0.007 ± 0.021	-0.040 ± 0.160	0.004 ± 0.019 0.004 ± 0.022
		-0.013 ± 0.020	0.080 ± 0.130	0.000 ± 0.017	-0.007 ± 0.021 -0.006 ± 0.020	0.050 ± 0.100	-0.010 ± 0.022
		-0.003 ± 0.010	0.093 ± 0.068	-0.001 ± 0.007	-0.006 ± 0.009	0.022 ± 0.074	-0.009 ± 0.007
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	03/22/06	-0.004 ± 0.022	-0.023 ± 0.047	0.036 ± 0.063	1.750 ± 0.550	-0.002 ± 0.025	0.010 ± 0.021
	06/19/06	-0.027 ± 0.022	0.022 ± 0.037	-0.001 ± 0.042	1.840 ± 0.500	0.008 ± 0.018	-0.004 ± 0.019
	08/08/06	0.001 ± 0.016	-0.015 ± 0.039	0.001 ± 0.021	1.900 ± 0.470	-0.005 ± 0.017	-0.010 ± 0.020
	11/30/06	0.006 ± 0.008	-0.009 ± 0.018	0.008 ± 0.024	1.470 ± 0.190	-0.005 ± 0.007	-0.001 ± 0.008
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr- 95
	03/22/06	0.005 ± 0.018	0.140 ± 0.190	-0.023 ± 0.058	0.072 ± 0.079	-0.005 ± 0.046	0.008 ± 0.035
	06/19/06	-0.011 ± 0.018	-0.050 ± 0.170	0.001 ± 0.053	0.071 ± 0.072	-0.006 ± 0.046	0.007 ± 0.031
	08/08/06	0.006 ± 0.014	0.130 ± 0.140	-0.011 ± 0.038	-0.001 ± 0.073	-0.023 ± 0.045	-0.012 ± 0.030
	11/30/06	0.001 ± 0.008	-0.028 ± 0.065	-0.004 ± 0.017	-0.003 ± 0.034	-0.012 ± 0.017	0.015 ± 0.014

Table 19, Oysters (pCi/g Dry)

Location	Collection Date		-	Isotope			
31		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	03/09/06 06/12/06 09/27/06	0.000 ± 0.025 0.005 ± 0.039 0.013 ± 0.027	-0.080 ± 0.130 0.070 ± 0.220 -0.010 ± 0.170 -0.040 ± 0.130	0.007 ± 0.017 -0.016 ± 0.025 -0.005 ± 0.021 -0.007 ± 0.015	0.001 ± 0.019 0.011 ± 0.029 0.017 ± 0.019	-0.020 ± 0.160 0.100 ± 0.230 -0.100 ± 0.170 -0.040 ± 0.110	0.005 ± 0.015 -0.008 ± 0.022 0.002 ± 0.019 -0.003 ± 0.016
	11/30/06	-0.011 ± 0.017 Cs-137	-0.040 ± 0.130 Fe-59	I-131	0.014 ± 0.017 K-40	-0.040 ± 0.110 Mn-54	-0.003 ± 0.010 Nb-95
	06/12/06 09/27/06	$\begin{array}{c} -0.007 \pm 0.018 \\ 0.017 \pm 0.023 \\ -0.020 \pm 0.021 \\ -0.001 \pm 0.013 \end{array}$	$\begin{array}{c} -0.025 \pm 0.041 \\ -0.024 \pm 0.049 \\ 0.002 \pm 0.029 \\ 0.007 \pm 0.037 \end{array}$	0.000 ± 0.047 0.000 ± 0.045 0.000 ± 0.031 -0.010 ± 0.035	1.390 ± 0.390 2.340 ± 0.750 1.700 ± 0.460 1.580 ± 0.390	$ \begin{array}{c} -0.008 \pm 0.016 \\ -0.010 \pm 0.022 \\ -0.005 \pm 0.019 \\ 0.008 \pm 0.014 \end{array} $	$\begin{array}{c} 0.011 \pm 0.019 \\ 0.037 \pm 0.030 \\ -0.009 \pm 0.022 \\ -0.003 \pm 0.020 \end{array}$
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	09/27/06	0.000 ± 0.018 -0.011 ± 0.024 0.005 ± 0.017 -0.012 ± 0.014	$\begin{array}{c} -0.030 \pm 0.170 \\ -0.080 \pm 0.270 \\ -0.040 \pm 0.180 \\ -0.060 \pm 0.120 \end{array}$	$ \begin{array}{c} -0.026 \pm 0.038 \\ -0.019 \pm 0.062 \\ 0.004 \pm 0.049 \\ 0.007 \pm 0.033 \end{array} $	-0.016 ± 0.068 0.036 ± 0.097 -0.043 ± 0.074 0.010 ± 0.053	$\begin{array}{c} \text{-0.017} \pm 0.032 \\ 0.000 \pm 0.046 \\ \text{-0.063} \pm 0.054 \\ \text{-0.013} \pm 0.032 \end{array}$	$\begin{array}{c} 0.004 \pm 0.030 \\ 0.011 \pm 0.043 \\ 0.009 \pm 0.033 \\ -0.004 \pm 0.030 \end{array}$
32		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	03/07/06 06/13/06 09/27/06 12/13/06	$\begin{array}{c} 0.019 \pm 0.022 \\ 0.077 \pm 0.034 \\ 0.046 \pm 0.018 \\ 0.061 \pm 0.044 \end{array}$	$\begin{array}{c} 0.050 \pm 0.140 \\ 0.020 \pm 0.180 \\ -0.130 \pm 0.130 \\ 0.110 \pm 0.200 \end{array}$	$\begin{array}{c} -0.001 \pm 0.021 \\ 0.003 \pm 0.026 \\ -0.002 \pm 0.015 \\ -0.013 \pm 0.031 \end{array}$	$\begin{array}{c} 0.004 \pm 0.018 \\ -0.004 \pm 0.030 \\ -0.009 \pm 0.018 \\ 0.004 \pm 0.034 \end{array}$	$\begin{array}{c} 0.030 \pm 0.160 \\ 0.000 \pm 0.190 \\ 0.080 \pm 0.110 \\ -0.080 \pm 0.220 \end{array}$	$\begin{array}{c} -0.006 \pm 0.020 \\ 0.000 \pm 0.027 \\ 0.005 \pm 0.017 \\ 0.014 \pm 0.038 \end{array}$
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	06/13/06 09/27/06	$ \begin{array}{c} -0.010 \pm 0.017 \\ -0.046 \pm 0.080 \\ -0.013 \pm 0.044 \\ -0.023 \pm 0.032 \end{array} $	$\begin{array}{c} -0.026 \pm 0.045 \\ -0.039 \pm 0.041 \\ 0.003 \pm 0.027 \\ 0.011 \pm 0.066 \end{array}$	$\begin{array}{c} 0.020 \pm 0.047 \\ 0.028 \pm 0.047 \\ -0.005 \pm 0.023 \\ -0.036 \pm 0.052 \end{array}$	2.050 ± 0.480 1.750 ± 0.750 2.250 ± 0.470 0.910 ± 0.620	$\begin{array}{c} -0.006 \pm 0.019 \\ 0.000 \pm 0.024 \\ 0.003 \pm 0.013 \\ 0.006 \pm 0.025 \end{array}$	-0.009 ± 0.023 0.053 ± 0.037 -0.015 ± 0.019 -0.006 ± 0.039
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	06/13/06 09/27/06	$\begin{array}{c} -0.011 \pm 0.020 \\ -0.027 \pm 0.024 \\ -0.007 \pm 0.015 \\ 0.000 \pm 0.030 \end{array}$	-0.050 ± 0.140 0.050 ± 0.210 -0.010 ± 0.150 -0.190 ± 0.270	$\begin{array}{c} 0.025 \pm 0.043 \\ 0.017 \pm 0.053 \\ -0.025 \pm 0.040 \\ -0.015 \pm 0.067 \end{array}$	0.040 ± 0.068 0.059 ± 0.088 -0.021 ± 0.053 -0.012 ± 0.068	0.086 ± 0.074 0.024 ± 0.053 0.009 ± 0.039 -0.063 ± 0.052	$\begin{array}{c} -0.022 \pm 0.032 \\ 0.015 \pm 0.053 \\ 0.000 \pm 0.025 \\ 0.034 \pm 0.048 \end{array}$
34-X		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	06/12/06 09/27/06	$\begin{array}{c} -0.021 \pm 0.024 \\ -0.017 \pm 0.043 \\ 0.003 \pm 0.029 \\ 0.008 \pm 0.023 \end{array}$	$\begin{array}{c} 0.050 \pm 0.140 \\ 0.120 \pm 0.220 \\ 0.060 \pm 0.160 \\ 0.020 \pm 0.110 \end{array}$	$\begin{array}{c} -0.008 \pm 0.019 \\ 0.014 \pm 0.023 \\ -0.006 \pm 0.018 \\ -0.007 \pm 0.016 \end{array}$	$\begin{array}{c} 0.008 \pm 0.021 \\ 0.002 \pm 0.036 \\ 0.004 \pm 0.024 \\ 0.002 \pm 0.018 \end{array}$	$\begin{array}{c} -0.030 \pm 0.160 \\ 0.060 \pm 0.220 \\ -0.070 \pm 0.180 \\ -0.010 \pm 0.140 \end{array}$	$\begin{array}{c} -0.002 \pm 0.015 \\ 0.003 \pm 0.025 \\ -0.005 \pm 0.016 \\ -0.009 \pm 0.017 \end{array}$
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	06/12/06	$\begin{array}{c} -0.006 \pm 0.019 \\ -0.002 \pm 0.019 \\ 0.022 \pm 0.019 \\ 0.002 \pm 0.015 \end{array}$	$\begin{array}{c} 0.013 \pm 0.041 \\ 0.010 \pm 0.051 \\ 0.035 \pm 0.042 \\ 0.007 \pm 0.042 \end{array}$	$\begin{array}{c} 0.006 \pm 0.044 \\ 0.000 \pm 0.048 \\ 0.004 \pm 0.029 \\ -0.030 \pm 0.035 \end{array}$	$\begin{array}{c} 1.860 \pm 0.520 \\ 2.090 \pm 0.750 \\ 2.110 \pm 0.530 \\ 2.400 \pm 0.490 \end{array}$	$\begin{array}{c} -0.010 \pm 0.017 \\ 0.007 \pm 0.028 \\ 0.010 \pm 0.019 \\ 0.014 \pm 0.014 \end{array}$	$\begin{array}{c} 0.001 \pm 0.021 \\ -0.012 \pm 0.029 \\ 0.009 \pm 0.021 \\ 0.006 \pm 0.019 \end{array}$

Table 19, Oysters (pCi/g Dry)

Location	Collection Date			Isotope			
34-X		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	03/09/06 06/12/06 09/27/06 12/04/06		$ \begin{array}{c} -0.090 \pm 0.140 \\ -0.120 \pm 0.220 \\ 0.030 \pm 0.150 \\ -0.020 \pm 0.140 \end{array} $	$\begin{array}{c} 0.006 \pm 0.042 \\ -0.057 \pm 0.053 \\ -0.017 \pm 0.047 \\ 0.000 \pm 0.039 \end{array}$	$\begin{array}{c} 0.005 \pm 0.073 \\ 0.020 \pm 0.100 \\ -0.037 \pm 0.076 \\ 0.062 \pm 0.074 \end{array}$	$\begin{array}{c} -0.012 \pm 0.049 \\ 0.000 \pm 0.078 \\ 0.036 \pm 0.040 \\ -0.017 \pm 0.036 \end{array}$	-0.022 ± 0.031 -0.040 ± 0.041 0.011 ± 0.031 -0.005 ± 0.029
36		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	03/30/06 06/15/06 09/26/06 12/11/06	$L \\ -0.006 \pm 0.028 \\ 0.036 \pm 0.025 \\ 0.038 \pm 0.035$	-0.040 ± 0.140 -0.080 ± 0.130 -0.200 ± 0.220	-0.002 ± 0.018 0.010 ± 0.018 0.000 ± 0.022	0.011 ± 0.023 0.016 ± 0.022 0.008 ± 0.032	-0.030 ± 0.190 -0.030 ± 0.160 0.000 ± 0.270	0.005 ± 0.019 -0.005 ± 0.017 -0.002 ± 0.026
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	06/15/06 09/26/06 12/11/06	0.011 ± 0.022	-0.021 ± 0.043 0.013 ± 0.038 -0.015 ± 0.063	0.007 ± 0.030 0.000 ± 0.038 0.042 ± 0.092	1.360 ± 0.570 2.090 ± 0.540 1.750 ± 0.610	0.009 ± 0.021 0.001 ± 0.016 -0.009 ± 0.022	-0.001 ± 0.023 -0.003 ± 0.017 0.014 ± 0.029
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	06/15/06 09/26/06 12/11/06	$-0.013 \pm 0.017 \\ 0.002 \pm 0.019 \\ 0.005 \pm 0.025$	-0.090 ± 0.210 -0.070 ± 0.200 -0.200 ± 0.190	0.001 ± 0.059 -0.020 \pm 0.047 0.012 \pm 0.067	0.008 ± 0.072 -0.003 ± 0.076 0.027 ± 0.087	-0.058 ± 0.051 0.018 ± 0.035 -0.054 ± 0.069	$\begin{array}{c} 0.008 \pm 0.025 \\ 0.002 \pm 0.031 \\ 0.017 \pm 0.040 \end{array}$
37-C		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	03/08/06 06/15/06 09/26/06 12/11/06	$\begin{array}{c} 0.004 \pm 0.021 \\ 0.002 \pm 0.030 \\ 0.014 \pm 0.021 \\ 0.000 \pm 0.007 \end{array}$	$\begin{array}{c} -0.070 \pm 0.110 \\ -0.200 \pm 0.300 \\ 0.000 \pm 0.120 \\ -0.006 \pm 0.047 \end{array}$	0.014 ± 0.016 -0.014 ± 0.025 -0.014 ± 0.014 -0.002 ± 0.005	$\begin{array}{c} -0.005 \pm 0.015 \\ 0.000 \pm 0.035 \\ 0.008 \pm 0.018 \\ 0.001 \pm 0.005 \end{array}$	0.050 ± 0.140 0.170 ± 0.220 0.020 ± 0.140 0.046 ± 0.077	$\begin{array}{c} -0.009 \pm 0.014 \\ 0.010 \pm 0.031 \\ -0.004 \pm 0.019 \\ 0.006 \pm 0.005 \end{array}$
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	03/08/06 06/15/06 09/26/06 12/11/06	$\begin{array}{c} 0.006 \pm 0.015 \\ 0.015 \pm 0.027 \\ -0.001 \pm 0.015 \\ 0.002 \pm 0.005 \end{array}$	$ \begin{array}{c} -0.002 \pm 0.036 \\ 0.013 \pm 0.060 \\ -0.011 \pm 0.034 \\ 0.010 \pm 0.013 \end{array} $	$\begin{array}{c} 0.023 \pm 0.044 \\ 0.007 \pm 0.040 \\ -0.003 \pm 0.034 \\ -0.002 \pm 0.030 \end{array}$	1.870 ± 0.370 2.340 ± 0.980 1.870 ± 0.390 1.980 ± 0.140	0.008 ± 0.014 -0.010 ± 0.035 -0.015 ± 0.015 -0.002 ± 0.006	0.001 ± 0.015 0.000 ± 0.044 -0.006 ± 0.016 0.006 ± 0.007
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	03/08/06 06/15/06 09/26/06 12/11/06	$\begin{array}{c} 0.001 \pm 0.015 \\ 0.004 \pm 0.028 \\ -0.001 \pm 0.016 \\ 0.003 \pm 0.006 \end{array}$	0.050 ± 0.130 -0.040 ± 0.190 -0.030 ± 0.140 -0.017 ± 0.047	0.030 ± 0.035 0.000 ± 0.069 -0.005 ± 0.039 0.000 ± 0.013	-0.039 ± 0.051 -0.056 ± 0.067 -0.005 ± 0.053 0.007 ± 0.026	-0.014 ± 0.035 -0.042 ± 0.073 -0.037 ± 0.035 -0.001 ± 0.011	-0.009 ± 0.027 -0.008 ± 0.065 0.004 ± 0.030 0.003 ± 0.012
40-X		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	03/30/06 06/20/06 09/19/06 11/21/06	0.063 ± 0.024 0.024 ± 0.055 0.061 ± 0.020 0.091 ± 0.008	-0.090 ± 0.180 -0.200 ± 0.330 -0.050 ± 0.130 0.019 ± 0.055	$ \begin{array}{c} -0.002 \pm 0.022 \\ 0.000 \pm 0.041 \\ -0.007 \pm 0.014 \\ 0.007 \pm 0.006 \end{array} $	0.008 ± 0.023 0.002 ± 0.036 -0.001 ± 0.016 -0.004 ± 0.007	-0.010 ± 0.170 0.130 ± 0.330 0.100 ± 0.110 -0.047 ± 0.061	-0.019 ± 0.022 0.001 ± 0.035 -0.004 ± 0.016 0.003 ± 0.006

Table 19, Oysters (pCi/g Dry)

Page 3 of 3

Location	Collection Date	·		Isotope			<u> </u>
40-X		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-9 5
	03/30/06 06/20/06 09/19/06 11/21/06	$\begin{array}{c} -0.033 \pm 0.027 \\ -0.016 \pm 0.048 \\ -0.002 \pm 0.046 \\ 0.002 \pm 0.018 \end{array}$	$ \begin{array}{c} -0.017 \pm 0.029 \\ 0.016 \pm 0.079 \\ 0.020 \pm 0.032 \\ 0.005 \pm 0.014 \end{array} $	0.008 ± 0.032 -0.004 ± 0.071 0.004 ± 0.049 -0.009 ± 0.020	2.420 ± 0.560 0.990 ± 0.660 1.930 ± 0.380 2.060 ± 0.170	$ \begin{array}{c} -0.013 \pm 0.017 \\ 0.014 \pm 0.037 \\ -0.004 \pm 0.013 \\ 0.003 \pm 0.006 \end{array} $	$\begin{array}{c} 0.021 \pm 0.024 \\ -0.011 \pm 0.045 \\ 0.006 \pm 0.022 \\ -0.012 \pm 0.012 \end{array}$
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	03/30/06 06/20/06 09/19/06 11/21/06	-0.007 ± 0.036 -0.005 ± 0.017	$ \begin{array}{c} -0.110 \pm 0.200 \\ -0.130 \pm 0.340 \\ 0.000 \pm 0.110 \\ 0.002 \pm 0.062 \end{array} $	$ \begin{array}{c} -0.016 \pm 0.052 \\ 0.076 \pm 0.098 \\ 0.018 \pm 0.033 \\ -0.010 \pm 0.016 \end{array} $	$ \begin{array}{c} -0.013 \pm 0.070 \\ 0.030 \pm 0.140 \\ 0.057 \pm 0.069 \\ 0.017 \pm 0.032 \end{array} $	$\begin{array}{c} -0.004 \pm 0.037 \\ -0.065 \pm 0.085 \\ -0.023 \pm 0.038 \\ -0.007 \pm 0.014 \end{array}$	$\begin{array}{c} 0.013 \pm 0.039 \\ 0.000 \pm 0.066 \\ 0.006 \pm 0.026 \\ 0.002 \pm 0.011 \end{array}$

Table 20, Clams (pCi/g Dry)

Location	Collection Date			Isotope			
29		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	03/23/06 06/20/06 08/30/06	0.004 ± 0.036 0.000 ± 0.034 -0.016 ± 0.029	0.000 ± 0.210 -0.020 ± 0.170 0.110 ± 0.150	-0.008 ± 0.024 -0.013 ± 0.022 0.005 ± 0.018	-0.002 ± 0.022 0.012 ± 0.030 0.013 ± 0.021	-0.140 ± 0.210 0.140 ± 0.170 0.190 ± 0.220	0.006 ± 0.025 0.030 ± 0.029
	11/15/06	0.010 ± 0.029 0.006 ± 0.014	-0.110 ± 0.130 -0.106 ± 0.087	-0.003 ± 0.018 -0.004 ± 0.010	-0.002 ± 0.021	0.190 ± 0.220 0.039 ± 0.095	-0.008 ± 0.020 0.009 ± 0.011
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	03/23/06 06/20/06 08/30/06 11/15/06	0.014 ± 0.024 -0.002 ± 0.018 0.001 ± 0.016 0.000 ± 0.012	-0.007 ± 0.049 -0.007 ± 0.041 -0.007 ± 0.059 0.009 ± 0.022	-0.010 ± 0.060 -0.004 ± 0.040 -0.048 ± 0.059 0.008 ± 0.017	1.520 ± 0.650 2.030 ± 0.690 1.870 ± 0.600 2.090 ± 0.290	0.000 ± 0.020 0.008 ± 0.024 -0.005 ± 0.018 0.007 ± 0.011	-0.024 ± 0.027 0.010 ± 0.021 -0.002 ± 0.026 0.001 ± 0.010
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
		-0.005 ± 0.023	-0.060 ± 0.220	-0.067 ± 0.057	-0.003 ± 0.090	-0.039 ± 0.062	0.000 ± 0.038
	06/20/06 08/30/06 11/15/06	0.000 ± 0.021 -0.012 ± 0.022 0.001 ± 0.010	-0.030 ± 0.260 -0.200 ± 0.210 -0.038 ± 0.097	0.043 ± 0.061 0.005 ± 0.048 0.017 ± 0.028	0.002 ± 0.082 -0.039 ± 0.085 0.058 ± 0.040	$\begin{array}{c} 0.007 \pm 0.049 \\ -0.007 \pm 0.050 \\ -0.008 \pm 0.020 \end{array}$	0.010 ± 0.038 0.006 ± 0.037 0.003 ± 0.019
35-X		Ag-110m	B e-7	Co-58	Co-60	Cr-51	Cs-134
	03/23/06 06/20/06 09/19/06	-0.013 ± 0.035 0.003 ± 0.026 0.007 ± 0.030	-0.060 ± 0.150 -0.040 ± 0.160 -0.100 ± 0.190	0.011 ± 0.027 -0.007 ± 0.027 0.004 ± 0.023	0.000 ± 0.030 -0.020 \pm 0.022 -0.004 \pm 0.017	-0.060 ± 0.200 0.030 ± 0.170 0.050 ± 0.210	-0.007 ± 0.038 -0.010 ± 0.024 -0.013 ± 0.022
	11/15/06	0.007 ± 0.030 0.002 ± 0.022	0.020 ± 0.120	-0.007 ± 0.025	-0.004 ± 0.017 -0.002 ± 0.017	0.030 ± 0.210 0.100 ± 0.140	-0.003 ± 0.022 -0.003 ± 0.018
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	03/23/06 06/20/06 09/19/06 11/15/06	$\begin{array}{c} -0.012 \pm 0.019 \\ 0.014 \pm 0.025 \\ 0.022 \pm 0.019 \\ -0.009 \pm 0.016 \end{array}$	$\begin{array}{c} -0.009 \pm 0.071 \\ 0.000 \pm 0.049 \\ -0.037 \pm 0.056 \\ -0.018 \pm 0.035 \end{array}$	$\begin{array}{c} 0.042 \pm 0.044 \\ -0.006 \pm 0.035 \\ 0.022 \pm 0.076 \\ -0.004 \pm 0.028 \end{array}$	1.570 ± 0.650 2.190 ± 0.720 1.700 ± 0.630 1.690 ± 0.400	$\begin{array}{c} -0.008 \pm 0.029 \\ -0.008 \pm 0.017 \\ -0.006 \pm 0.024 \\ 0.008 \pm 0.017 \end{array}$	0.014 ± 0.022 0.010 ± 0.026 0.013 ± 0.028 0.005 ± 0.022
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	06/20/06 09/19/06	$\begin{array}{c} -0.016 \pm 0.025 \\ -0.025 \pm 0.020 \\ 0.002 \pm 0.022 \\ -0.008 \pm 0.018 \end{array}$	0.150 ± 0.200 -0.210 \pm 0.170 -0.160 \pm 0.210 0.060 ± 0.140	0.018 ± 0.059 -0.062 ± 0.058 -0.004 ± 0.055 -0.010 ± 0.036	-0.006 ± 0.084 0.000 ± 0.100 -0.034 ± 0.081 0.007 ± 0.055	$\begin{array}{c} -0.025 \pm 0.060 \\ -0.016 \pm 0.063 \\ -0.006 \pm 0.059 \\ 0.016 \pm 0.072 \end{array}$	-0.040 ± 0.054 0.014 ± 0.035 0.032 ± 0.044 0.002 ± 0.027
38		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	09/19/06	$\begin{array}{c} 0.005 \pm 0.037 \\ -0.029 \pm 0.030 \\ -0.004 \pm 0.037 \\ -0.005 \pm 0.021 \end{array}$	$\begin{array}{c} -0.070 \pm 0.200 \\ 0.020 \pm 0.160 \\ -0.020 \pm 0.180 \\ -0.030 \pm 0.130 \end{array}$	-0.004 ± 0.025 -0.017 ± 0.022 -0.011 ± 0.020 0.006 ± 0.018	-0.010 ± 0.040 0.024 ± 0.034 -0.026 ± 0.030 -0.005 ± 0.017	0.060 ± 0.230 0.130 ± 0.210 -0.020 ± 0.250 -0.090 ± 0.140	$\begin{array}{c} 0.011 \pm 0.027 \\ -0.027 \pm 0.027 \\ 0.017 \pm 0.025 \\ 0.000 \pm 0.017 \end{array}$
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	06/20/06 09/19/06	$\begin{array}{c} -0.023 \pm 0.022 \\ 0.004 \pm 0.021 \\ -0.020 \pm 0.022 \\ -0.002 \pm 0.017 \end{array}$	0.052 ± 0.070 -0.008 ± 0.060 -0.007 ± 0.053 0.028 ± 0.037	$ \begin{array}{c} -0.016 \pm 0.065 \\ 0.021 \pm 0.047 \\ 0.044 \pm 0.075 \\ -0.011 \pm 0.027 \end{array} $	2.210 ± 0.750 1.800 ± 0.690 2.230 ± 0.680 2.680 ± 0.450	0.005 ± 0.019 -0.001 ± 0.020 0.009 ± 0.014 0.005 ± 0.012	0.027 ± 0.022 -0.013 ± 0.027 -0.002 ± 0.029 -0.004 ± 0.013

Table 20, Clams (pCi/g Dry)

Location	Collection Date			Isotope			
38		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	03/23/06 06/20/06 09/19/06 11/15/06	0.006 ± 0.023 0.013 ± 0.026 -0.012 ± 0.028 0.003 ± 0.014	-0.040 ± 0.240 0.050 ± 0.230 0.000 ± 0.220 -0.070 ± 0.140	$\begin{array}{c} -0.012 \pm 0.063 \\ 0.000 \pm 0.060 \\ -0.020 \pm 0.061 \\ -0.003 \pm 0.041 \end{array}$	0.020 ± 0.120 0.051 ± 0.098 0.080 ± 0.110 0.008 ± 0.048	-0.051 ± 0.053 -0.025 ± 0.069 0.020 ± 0.062 0.005 ± 0.064	0.028 ± 0.043 -0.001 ± 0.040 -0.023 ± 0.040 0.000 ± 0.028
39-X		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	03/27/06 06/21/06 08/30/06 12/12/06	0.009 ± 0.022 -0.003 ± 0.029 0.013 ± 0.020 0.014 ± 0.028	0.150 ± 0.160 0.140 ± 0.160 0.050 ± 0.140 0.230 ± 0.230	0.005 ± 0.019 0.006 ± 0.020 -0.002 ± 0.013 -0.004 ± 0.025	-0.017 ± 0.022 0.014 ± 0.022 0.010 ± 0.018 0.002 ± 0.029	0.070 ± 0.140 -0.130 ± 0.180 -0.040 ± 0.150 -0.090 ± 0.280	-0.004 ± 0.022 0.018 ± 0.020 0.011 ± 0.015 0.004 ± 0.028
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
		0.004 ± 0.017 0.001 ± 0.017 -0.004 ± 0.015 -0.016 ± 0.033	$ \begin{array}{c} -0.016 \pm 0.045 \\ 0.021 \pm 0.043 \\ -0.007 \pm 0.034 \\ 0.000 \pm 0.059 \end{array} $	0.006 ± 0.025 0.016 ± 0.037 0.004 ± 0.041 -0.054 ± 0.089	1.480 ± 0.540 2.030 ± 0.560 5.460 ± 0.560 2.440 ± 0.720	0.002 ± 0.019 -0.017 ± 0.022 -0.002 ± 0.011 -0.010 ± 0.021	-0.030 ± 0.025 0.012 ± 0.021 -0.007 ± 0.018 0.001 ± 0.033
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	03/27/06 06/21/06 08/30/06 12/12/06	-0.003 ± 0.020 0.011 ± 0.020 -0.001 ± 0.014 0.018 ± 0.027	$\begin{array}{c} 0.030 \pm 0.170 \\ -0.070 \pm 0.190 \\ -0.030 \pm 0.130 \\ -0.080 \pm 0.270 \end{array}$	-0.020 ± 0.033 -0.030 ± 0.053 -0.002 ± 0.036 0.063 ± 0.069	$\begin{array}{c} -0.043 \pm 0.061 \\ 0.002 \pm 0.082 \\ 0.024 \pm 0.060 \\ 0.010 \pm 0.120 \end{array}$	$\begin{array}{c} -0.017 \pm 0.051 \\ 0.000 \pm 0.044 \\ -0.024 \pm 0.034 \\ 0.016 \pm 0.065 \end{array}$	-0.003 ± 0.040 -0.019 ± 0.034 -0.017 ± 0.028 0.028 ± 0.050
40-X		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	09/19/06	0.003 ± 0.032	-0.010 ± 0.170	0.004 ± 0.024	0.021 ± 0.026	-0.010 ± 0.210	-0.006 ± 0.024
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	09/19/06	-0.004 ± 0.020	-0.039 ± 0.051	-0.043 ± 0.063	2.070 ± 0.540	-0.006 ± 0.022	0.015 ± 0.028
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	09/19/06	-0.023 ± 0.025	-0.160 ± 0.200	-0.034 ± 0.052	-0.005 ± 0.067	-0.101 ± 0.056	0.029 ± 0.041

Table 21, Scallops

No data collected during 2006

Table 22, Lobsters (pCi/g Dry)

Location	Collection Date			Isotope			
32		Ag-110m	Be-7	Co-58	Co-60	Cr-51	Cs-134
	01/20/06 05/03/06 07/10/06 10/31/06	0.0031 ± 0.007 0.0038 ± 0.024 -0.020 ± 0.031 0.0031 ± 0.009	0.013 ± 0.041 -0.060 ± 0.130 -0.060 ± 0.200 -0.044 ± 0.055	0.001 ± 0.005 0.002 ± 0.017 -0.003 ± 0.019 0.001 ± 0.007	0.006 ± 0.006 0.005 ± 0.019 -0.016 ± 0.034 0.001 ± 0.007	0.040 ± 0.044 -0.080 \pm 0.140 0.080 \pm 0.220 0.002 \pm 0.069	0.003 ± 0.005 0.001 ± 0.020 0.039 ± 0.028 0.001 ± 0.007
		€s-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	01/20/06 05/03/06 07/10/06 10/31/06	-0.001 ± 0.005 -0.007 ± 0.020 0.0165 ± 0.024 0.006 ± 0.006	0.002 ± 0.011 0.003 ± 0.036 0.000 ± 0.053 -0.011 ± 0.016	$ \begin{array}{c} -0.001 \pm 0.009 \\ 0.029 \pm 0.029 \\ 0.037 \pm 0.053 \\ 0.008 \pm 0.021 \end{array} $	2.060 ± 0.150 2.320 ± 0.490 2.050 ± 0.650 2.440 ± 0.190	$\begin{array}{c} -0.002 \pm 0.005 \\ -0.016 \pm 0.016 \\ -0.008 \pm 0.023 \\ 0.005 \pm 0.007 \end{array}$	$\begin{array}{c} 0.008 \pm 0.006 \\ -0.006 \pm 0.017 \\ -0.018 \pm 0.023 \\ 0.000 \pm 0.009 \end{array}$
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	01/20/06 05/03/06 07/10/06 10/31/06	-0.00 4 ± 0.006 0.00 52 ± 0.017 -0.0 14 ± 0.025 0.00 60 ± 0.008	-0.011 ± 0.048 0.110 ± 0.160 -0.080 ± 0.210 0.034 ± 0.060	0.001 ± 0.012 0.005 ± 0.043 -0.011 ± 0.056 -0.011 ± 0.017	0.024 ± 0.020 0.055 ± 0.071 -0.093 ± 0.085 0.023 ± 0.033	-0.004 ± 0.013 -0.020 ± 0.044 0.014 ± 0.056 -0.008 ± 0.016	-0.003 ± 0.009 -0.001 ± 0.029 -0.008 ± 0.041 -0.002 ± 0.012
35		Ag-110m	Be- 7	Co-58	Co-60	Cr-51	Cs-134
	01/25/06 05/03/06 07/10/06 10/31/06	-0.014 ± 0.024 -0.018 ± 0.018 0.003 ± 0.027 0.002 ± 0.008	0.050 ± 0.150 0.050 ± 0.120 -0.020 ± 0.160 0.009 ± 0.057	$ \begin{array}{c} -0.001 \pm 0.019 \\ -0.010 \pm 0.021 \\ 0.008 \pm 0.022 \\ -0.001 \pm 0.006 \end{array} $	-0.011 ± 0.016 -0.010 ± 0.022 0.000 ± 0.025 -0.002 ± 0.006	-0.110 ± 0.130 0.010 ± 0.130 -0.020 ± 0.210 0.001 ± 0.070	$\begin{array}{c} 0.001 \pm 0.019 \\ 0.012 \pm 0.019 \\ 0.003 \pm 0.021 \\ 0.004 \pm 0.007 \end{array}$
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	01/25/06 05/03/06 07/10/06 10/31/06	0.00\(\pm4\) ± 0.016 0.00\(\pm4\) ± 0.017 -0.00\(\pm7\) ± 0.023 -0.00\(\pm2\) ± 0.007	0.005 ± 0.040 0.011 ± 0.039 0.050 ± 0.054 0.001 ± 0.014	0.002 ± 0.024 -0.015 ± 0.025 -0.008 ± 0.046 -0.014 ± 0.022	2.170 ± 0.610 2.510 ± 0.540 3.660 ± 0.730 2.510 ± 0.190	$\begin{array}{c} -0.006 \pm 0.022 \\ -0.008 \pm 0.017 \\ -0.010 \pm 0.022 \\ 0.005 \pm 0.006 \end{array}$	$\begin{array}{c} -0.013 \pm 0.021 \\ -0.001 \pm 0.015 \\ 0.023 \pm 0.031 \\ 0.008 \pm 0.008 \end{array}$
		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95
	05/03/06 07/10/06	0.006 ± 0.018 -0.023 ± 0.016 -0.018 ± 0.027 0.000 ± 0.007	-0.020 ± 0.160 0.040 ± 0.140 0.080 ± 0.230 -0.020 ± 0.059	-0.020 ± 0.039 0.039 ± 0.037 0.040 ± 0.044 -0.013 ± 0.016	-0.042 ± 0.070 -0.011 ± 0.068 0.035 ± 0.078 0.015 ± 0.031	$\begin{array}{c} 0.005 \pm 0.050 \\ -0.012 \pm 0.041 \\ -0.021 \pm 0.062 \\ -0.008 \pm 0.015 \end{array}$	0.001 ± 0.037 -0.013 ± 0.027 0.031 ± 0.039 0.004 ± 0.011
37-X		Ag-110m	Be- 7	Co-58	Co-60	Cr-51	Cs-134
	05/15/06 08/09/06	-0.002 ± 0.006 -0.011 ± 0.024 -0.005 ± 0.019 0.005 ± 0.012	-0.004 ± 0.042 -0.040 ± 0.160 0.040 ± 0.130 -0.036 ± 0.062	0.002 ± 0.005 -0.007 ± 0.017 0.001 ± 0.014 0.004 ± 0.007	-0.003 ± 0.005 0.007 ± 0.023 0.010 ± 0.024 0.002 ± 0.009	$\begin{array}{c} -0.061 \pm 0.048 \\ -0.080 \pm 0.160 \\ 0.020 \pm 0.130 \\ 0.000 \pm 0.066 \end{array}$	$\begin{array}{c} 0.004 \pm 0.006 \\ 0.006 \pm 0.016 \\ -0.011 \pm 0.017 \\ 0.003 \pm 0.009 \end{array}$
		Cs-137	Fe-59	I-131	K-40	Mn-54	Nb-95
	01/17/06 05/15/06 08/09/06 11/09/06	0.008 ± 0.006 0.010 ± 0.021 0.008 ± 0.018 0.007 ± 0.009	0.003 ± 0.011 0.019 ± 0.046 -0.008 ± 0.041 0.007 ± 0.018	$\begin{array}{c} 0.003 \pm 0.011 \\ -0.020 \pm 0.029 \\ 0.006 \pm 0.026 \\ 0.003 \pm 0.012 \end{array}$	2.360 ± 0.150 2.230 ± 0.560 2.230 ± 0.520 2.770 ± 0.270	-0.001 ± 0.005 -0.015 ± 0.025 0.006 ± 0.016 -0.005 ± 0.007	$ \begin{array}{c} -0.004 \pm 0.006 \\ 0.016 \pm 0.017 \\ 0.000 \pm 0.018 \\ 0.003 \pm 0.009 \end{array} $

Table 22, Lobsters (pCi/g Dry)

Location	Collection Date	Isotope						
37-X		Ru-103	Ru-106	Sb-125	Th-228	Zn-65	Zr-95	
	01/17/06	0.001 ± 0.005	-0.037 ± 0.045	0.007 ± 0.013	0.001 ± 0.026	0.014 ± 0.017	-0.002 ± 0.008	
	05/15/06	-0.014 ± 0.019	0.170 ± 0.160	-0.023 ± 0.050	-0.046 ± 0.079	0.000 ± 0.049	-0.007 ± 0.034	
	08/09/06	-0.015 ± 0.016	0.100 ± 0.170	0.003 ± 0.036	0.006 ± 0.068	-0.041 ± 0.040	0.014 ± 0.031	
	11/09/06	0.004 ± 0.007	-0.016 ± 0.075	0.003 ± 0.019	-0.008 ± 0.034	0.003 ± 0.021	0.000 ± 0.014	

NOTES FOR DATA TABLES

#	Collection Dates for Air Particulates and Iodines are listed as Monday – Sunday, however the typical change-out days are on Tuesdays			
Α	TLD at location 16C missing, pole was removed by CL&P (see CR-06-03493)			
В	Low volume (7745 cubic feet) caused by blown pump fuse and broken fuse holder (see CR-06-04356)			
С	Low volume (8725 cubic feet) caused by faulty surge suppressor (CR-06-05337)			
D	Low volume (980 cubic feet) caused by power outage (CR-06-05332)			
Е	Low volume (9706 cubic feet) caused power outage (CR-06-05332)			
F	Low volume caused by breaker trips (CR-06-08664)			
G	Non pasture grass sample (e.g., hay or other feed)			
Н	Not collected in April (locations 1, 10 & 17) since no sample available during that time			
1	Unable to obtain water at location 77X			
J	First Quarter flounder samples (locations 32 & 35) were not available			
	(typically scarce during this time of year)			
K	First Quarter fish-other sample (location 32 & 35) were not available			
	(typically scarce this time of year)			
L	First Quarter oyster sample at location 36 not available since winter storm			
	activity caused cage to break			

4. DISCUSSION OF RESULTS

This section summarizes the results of the analyses on the REMP (Radiological Environmental Monitoring Program) samples. DNC has carefully examined the data throughout the year and has presented in this section all cases where station related radioactivity could be detected. The results are compared with previous environmental surveillance data. Few impacts of the station operation on the environment were observed. Sub-sections contain a description of each particular media or potential exposure pathway.

Naturally occurring nuclides such as Be-7, K-40, and Th-228 were detected in numerous samples. Be-7, which is produced by cosmic processes, was observed predominantly in airborne and vegetation samples. Th-228 results were variable and are generally at levels higher than plant related radionuclides.

Cs-137 and Sr-90 were observed at levels similar to those of past years. The levels of Cs-137 and Sr-90 detected were the result of atmospheric nuclear weapons testing in the 1960's.

4.1 Gamma Exposure Rate (Table 1)

Gamma exposure rate is determined from the integrated exposure measured over a calendar quarter using $CaSO_4(Tm)$ Panasonic model UD-804 ASx thermoluminescent dosimeters (TLDs). In 2000, the TLDs (Victoreen glass bulb $CaF_2(Mn)$), which historically were used to measure radioactivity around Millstone for over 20 years, were replaced with the Panasonic TLDs.

The dosimeters are strategically placed at a number of on-site locations, as well as at inner and outer off-site locations. Starting in 2001, the collection of TLDs was changed from monthly to quarterly and additional measurement locations were incorporated into the REMP requirements listed in the REMODCM (Radiological Effluent Monitoring and Offsite Dose Calculation Manual). Three more locations were added in mid-2003 to prepare for monitoring the potential effect of ISFSI (Independent Spent Fuel Storage Installation – Dry Cask Storage). Two Dry Cask Containers were loaded in the first quarter 2005. Three more were loaded in mid 2006. The exposure rate measurements at these three locations remains unchanged from the background measurements listed in the last two annual reports (9.5 uR/hour at location 73X, 7.6 uR/hour at location 74X and 6.9 uR/hour at location 75X).


Table 1 lists the exposure rate measurements for all 44 monitored locations. Trends similar to those of past years are apparent. These measurements demonstrate the general variations in background radiation between the various on-site and off-site locations and include gamma exposure from all sources of radioactivity. For example, the Weather Shack (location 02), MP3 Discharge (location 05), Environmental Laboratory (location 08), Bay Point Beach (location 09), Pleasure Beach (location 10), Corey Road (location 48), and Site Switchyard Fence (location 73) experience higher exposure rates due to their proximity to granite beds and stonewalls. In addition, the Mystic (location 13C) and Ledyard (location 14C) control locations experience relatively higher background exposure rate than the other control locations at Norwich and Old Lyme (locations 15C and 16C). The only appreciable effect seen in the TLD data is that attributable to the variation in the background radiation that is consistent with previous years.

Figure 4.1-1 shows a historical trend of TLD exposure rate measurements, comparing an annual average of all indicator TLDs, an annual average of all control TLDs, and the annual average of the two most critical indicator locations which are used to represent the two closest site boundary residences in the North-northwest and Northeast directions. Examination of the average measurements since 1990, shows interesting site changes and site characteristics. For example, the average of all indicator locations for the period when Unit 1 was still in operation (through 1995) display the effects of N-16 BWR turbine building sky-shine to immediate areas onsite. As discussed in previous annual reports, the effects of sky-shine at onsite monitoring stations were increases as high as 6 uR/hr at certain onsite locations. Sky-shine decreased rapidly with distance and was indistinguishable from normal background measurements at even the nearest offsite monitoring stations. Also apparent in Figure 4.1-1 is the replacement of the historical Victoreen TLD monitoring system with the Panasonic system in year 2000. The difference in response between the two systems is very apparent, with the new Panasonic TLDs reading 15% to 20% lower. This lower response is consistent for all locations, including both indicator and control locations.

The figure also relates the difference in critical indicator locations 1 and 3 and the annual average of all indicator TLDs to the annual average of the control TLDs collected and measured during coincident periods throughout the year. As discussed earlier, the exposure measurements of many indicator locations onsite are influenced by natural background exposure differences caused by the many granite out-croppings typical of the Millstone area. As shown in Figure 4.1-1, the annual average at indicator locations 1 and 3 are slightly higher in gamma exposure rate than the average control gamma exposure rate. This difference is the result of the nearby granite.

Review of the individual quarterly data for all locations indicates that at locations 5 and 8, there seems to be an effect caused by storage of the Unit 2 replaced reactor head. Beginning in the second quarter of 2005, the dose rate in these areas increased by more than the typical variability for this type of measurement. As expected, this increase has shown a decreasing trend because of radioactive decay. The head was shipped offsite for disposal in the fourth quarter 2006; the measured levels at these two locations have returned to the levels measured prior to the head being placed in the storage area. The largest increase during the storage time interval time was at location 5, which is closer to the replaced reactor head storage area than location 8. Based upon the data, the increase in dose rate averaged approximately 0.8 uR/hour. This would equate to a dose of 10 mrem (for these six quarters). These locations are onsite; dose rates at the site boundary would be significantly less. These resulting site boundary doses are bounded by dose rates from other radwaste storage areas and are discussed in Section 5.

The second quarter result for location 55 (Magonk Point – 1.8 miles ESE) showed an unusual increase. Initial results indicated an approximate 30% increase. Investigation (CR-06-07330) indicated that the calibration factors for the TLD badge that were used at this location had changed; corrected results still indicated an approximate 15% increase which is occasionally seen for this type of measurement.

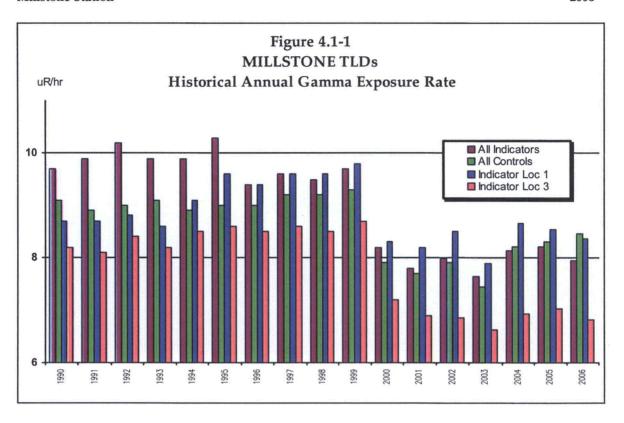



4.2 Air Particulate Gross Beta Radioactivity (Table 2)

Air is continuously sampled at seven inner ring (0 to 2 miles) locations and one control location (14 miles) and by passing it through glass fiber particulate filters. These samples are collected weekly and analyzed for gross beta radioactivity. Results are shown on Figure 4.2-1 and Table 2. Gross beta activity remained at levels similar to that seen over the last decade. Inner and control monitoring locations continue to show no significant variation in measured activities (see Figure 4.2-2). This indicates that any station contribution is not measurable.

4.3 Airborne Iodine (Table 3)

Charcoal cartridges are included at all of the air particulate monitoring stations for the collection of atmospheric iodine. These cartridges are analyzed on a weekly basis for I-131. No detectable levels of I-131 were seen in the 2006 charcoal samples.

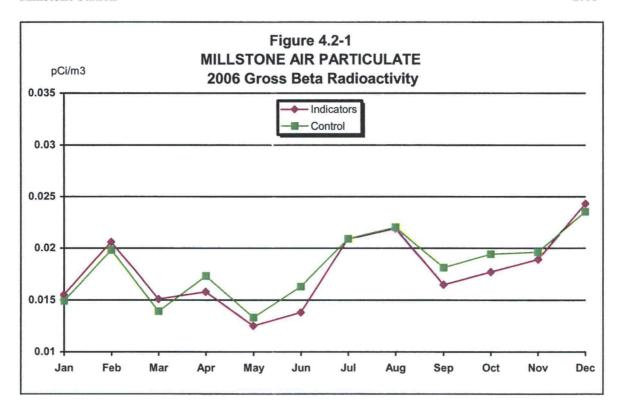

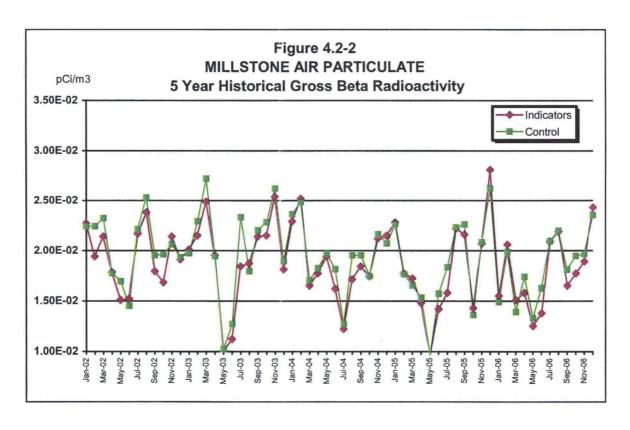

4.4 Air Particulate Gamma (Table 4A-D)

The air particulate samples that are utilized for the weekly gross beta analyses are composited quarterly and analyzed for gamma emitting isotopes. The results, as shown in Tables 4A - 4D, indicate the presence of naturally occurring Be-7, which is produced by cosmic radiation. No other positive results are seen. These analyses indicate the lack of station effects.

4.5 Air Particulate Strontium (Table 5)

Prior to 1989 Table 5 was used for listing the data for measurements of Sr-89 and Sr-90 in quarterly composite air particulate filters. The historical data indicated the lack of any detectable station related activity. Since these analyses are not listed in NUREG 1301, these measurements were discontinued. In the event of widespread station related contamination or other unusual events (such as the 1986 Chernobyl incident), these measurements could be made. Historically, when world events created conditions that caused detectable measurements of these nuclides, there was no difference noted between indicator and control locations. This further confirms that any of the detectable levels for these nuclides were not plant related.

4.6 Soil (Table 6)

Millstone resumed collection of soil as a required media type in 2001. Prior to 2001, it had not been sampled for over fifteen years. These samples were discontinued due to the fact that, previous sample results never indicated any station related detectable activity. Similarly, since 2001, no station detectable activity has been seen in these samples. The results of these samples, allows for the determination of baseline activity levels in soil. This is particularly important for Cs-137, since significant levels from past weapons testing fallout remain in the soil. Baseline levels should be useful in the future, when site characterization and decommissioning of the station become the focus during preparations for License termination. This media is collected annually from one control and two indicator locations.

4.7 Cow Milk (Table 7)

Typically, the most sensitive indicator of fission product existence in the terrestrial environment is radiological analysis of milk samples. Since milk is a widely consumed food, it is usually one of the most critical exposure pathways. Since 1996 all dairy (cow) farms close enough to Millstone to be considered an indicator location (i.e. conservatively within 10 miles since reference 15 specifies 5 miles) have ceased operation. Therefore, the sampling of cow milk has been discontinued until such time dairy activities resume. Each year the Land Use Census is used to identify locations of milk animals that should be included in the monitoring program. It is performed annually and is maintained by observations, door-to-door surveys and consulting with local agriculture authorities. The 2006 census can be seen in Appendix A. If a new dairy farm is identified close enough to Millstone to be considered an indicator location, the collection of cow milk will resume.

4.8 Goat Milk (Table 8)

When available, these samples are collected twice per month during grazing season and once per month during the rest of the year. Each sample is analyzed for I-131 and gamma emitting nuclides. Although not required by the REMODCM, samples from each location are composited quarterly and analyzed for Strontium.

Goat milk samples are typically a more sensitive indicator of fission products in the terrestrial environment than cow milk samples. It should be noted that the uptake of radionuclides in milk is dependent on a number of parameters. These include: metabolism of these animals, feeding habits, farming practices and feed type. Similar to previous years, Cs-137 and Sr-90 are observed in goat milk. During past weapons testing periods, samples taken at certain milk locations indicated higher uptake of fallout than others. This was especially apparent in past samples collected in the immediate area around Millstone (see previous Annual Operating Reports). One of these sites, located at 5.2 Mi. NNE of Millstone (previous location 22, sampled from 1994 through 2004), exhibited a trend of showing higher Sr-90 and Cs-137 concentrations than at some of the other locations (including ones closer to Millstone). The station and regulatory authorities have carefully reviewed past and present data. The presence of the Sr-90 and Cs-137 is the result of residual radioactivity deposited into the environment from the fallout of past nuclear weapons testing. The facts that lead to this conclusion are presented in Section 6.0. These facts include: effluent release totals for these isotopes show insufficient quantities to account for such measurements; Sr-89 and Cs-134 which are chemically similar and generally released in comparable quantities were not detected, and a trend since the early 1960's that shows a consistent declining presence of Cs-137 and Sr-90 in milk from Connecticut.

The 2006 results indicate no detectable I-131 in this media. In the 1970's and 1980's low levels of plant related I-131 were seen in some of these samples. However, for over 17 years, no plant related detectable levels of I-131 have been seen in goat milk samples. The only other occasions where I-131 was detected were fallout episodes from the Chinese Weapons Tests of the mid to late 1970's and Chernobyl.

Goat milk was unavailable at all locations both early and late in the year. Per requirements, pasture grass or feed is collected as a substitute when milk is not available (see 4.9. Pasture Grass and Feed).

4.9 Pasture Grass and Feed (Table 9)

When the routine milk samples are unavailable, samples of pasture grass are required as a replacement. These samples may also be taken to further investigate the levels of radioactivity in milk. During the winter months and early spring, insufficient growth often prohibits sampling of pasture grass. Feed (e.g., hay) is typically sampled whenever pasture grass is not available.

No station effects are noted in these samples. Cosmic produced Be-7 was observed in the majority of the pasture grass samples and many of the hay samples. Due to its relatively short half-life (52 days), it was not detected in the several of the "older" hay samples. Naturally occurring K-40 was a factor of two times higher in hay (compared to pasture grass). Similar to goat milk, the Cs-137 values at the indicator and control locations are comparable. This provides an indication that the levels observed are the result of residual weapons testing fallout

4.10 Well Water (Table 10)

These samples were discontinued in 1985, because no detectable station activity was ever observed in these samples. However, based upon lessons learned at other nuclear plants, including several undergoing decommissioning, sampling was resumed at several locations starting in the fourth quarter 2003. Three additional locations were added in 2005 to monitor potential leakage from ISFSI. Due to the heightened sensitivity on this potential pathway, three more locations were added in the fourth quarter of 2006. Consistent with the past data, there still has not been any station activity detected in any of these samples.

4.11 Reservoir Water (Table 11)

Reservoir water samples are special samples not required by the REMP. Previous data has shown the lack of detectable station activity in this media. This fact and the extremely unlikely possibility of observing routine station effluents in this media have resulted in discontinuing these samples. In the event of widespread station related contamination, these samples may be collected.

4.12 Fruits and Vegetables (Table 12)

Consistent with past years, this media did not show any station effects. Naturally occurring K-40 was detected in all samples.

4.13 Broad Leaf Vegetation (Table 13)

Consistent with past years, this media did not show any station effects. Most samples had detectable levels of cosmic produced Be-7, at levels consistent with previous years. Positive indications of Cs-137 were observed in one sample. This level is comparable to those observed in past years and is due to fallout.


This media can be an early and sensitive indicator of releases from the station for both unplanned releases and normal operations. Therefore, to enhance program-monitoring effectiveness, samples of broadleaf vegetation are collected monthly during the growing season, April - October, even though requirements are to collect this media twice a year.


4.14 Seawater (Table 14)

In the vicinity of discharge (location 32), seawater is normally sampled by using a continuous sampler. A technician collects an aliquot from this sampler on a weekly frequency and composites it for monthly analyses. In September 1999, Millstone increased the required analysis frequency for this composite sample to a monthly basis to increase monitoring effectiveness. For the Control Location, Giants Neck (location 37C), six weekly grab samples are obtained for quarterly compositing. In 2003, the LLD for H-3 (tritium) at the indicator location (32) was lowered by approximately a factor of four to further enhance monitoring effectiveness. This lower LLD was continued through 2006.

Naturally occurring K-40 was seen all but two of the samples. Measured plant related levels of H-3 in seawater from the immediate vicinity of discharge (location 32) were observed in 7 of the 12 samples. This sample is taken directly from liquid effluent flow prior to dilution into Long Island Sound. Dilution studies performed for this discharge have determined that a dilution factor of 3 is appropriate to estimate concentrations immediately outside the quarry within a near-field area.

Tritium builds up in the reactor coolant during each fuel cycle. It is generated during plant operation from fission and neutron reactions. Between 1992 and 2002, H-3 was not typically detected. However, due to the enhanced detection sensitivity, H-3 levels are now typically detectable. Figure 4.14-1 shows a thirteen-year trend of H-3 releases in the Millstone liquid effluents versus the measured environmental concentrations from the vicinity of discharge location. As can be noted from the figure, since the restart of Unit 3 in 1998 and Unit 2 in 1999, tritium releases in liquid effluents have risen to levels at, or above, those observed during the pre-shutdown period. The lower LLD enables a direct comparison of effluent monitoring to environmental monitoring for this exposure pathway. Figure 4.14-2 shows this comparison. This comparison is also more accurate than Figure 4.1-1 since it takes into account the dilution flow during each month. Dilution flow can change substantially during plant outages. By plotting the data monthly, the resolution of the comparison is further enhanced, although there can be slight discrepancies due to the REMP sample not necessarily being on the last day of each month.

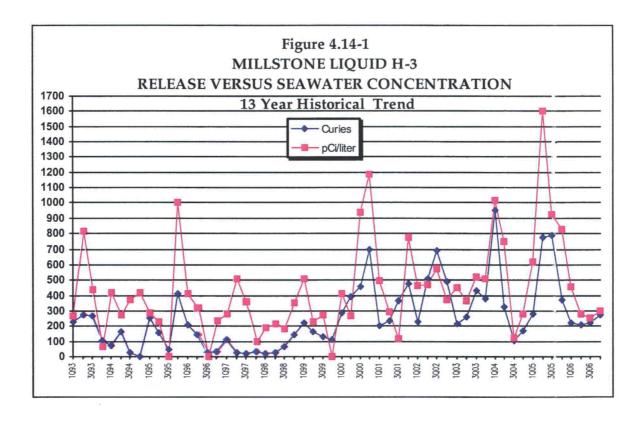

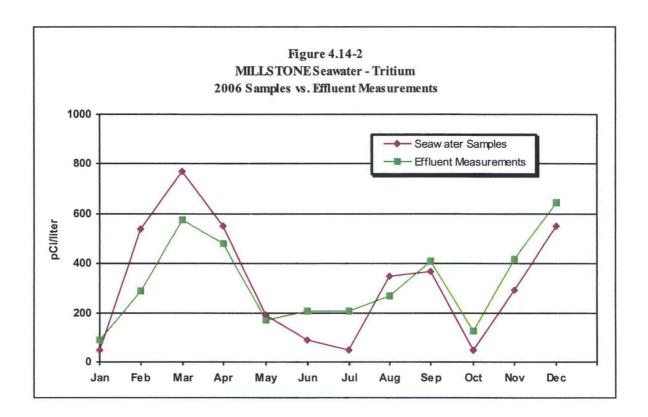

4.15 <u>Bottom Sediment (Table 15)</u>

Cs-137 was detected in the samples from Golden Spur (67X). This is typical for this location, since it is a fresh water area. The levels of Cs-137 at this location are comparable to those observed in past river water sediments taken from other areas of the Connecticut River. Because of the relative distance and direction of the Golden Spur location from the station and comparable levels seen at even much farther locations, the Cs-137 detected at Golden Spur is from weapons testing fallout.

Cs-137 was also detected in the extra samples from Jordon Cove Bar (39X). The levels at Jordan Cove Bar are similar to those at Golden Spur and likely exhibit some effect of the fresh water drainage from Jordan Brook. Although these levels may be the result of fallout, the samples from Jordan Cove Bar also indicated detectable quantities of Co-60. Therefore, some of this detectable Cs-137 in Jordan Cove may be the result of plant operation.

The levels of Co-60 in Jordan Cove are considered plant related activity. Similar levels were noted in 2004 and 2005 and somewhat lower levels in 2003. Prior to 2003, plant related activity has not been detected in bottom sediment for over a decade. The present levels are comparable to the levels observed in 1990. Bottom sediment is not a significant dose pathway to man, especially at areas not typically used by the public. Examinations of other aquatic media, including seafood, sampled from these locations (discussions that follow) do not show any detectable Co-60 or Cs-137. A new location was added near the closest public beach (location 69X). The data for this location did not indicate any plant related activity.

4.16 Aquatic Flora (Table 16)

Although sampling of this media is not required, it provides useful information since it a very sensitive indicator of station discharges. Low levels of activity (e.g., Mn-54, Co-58, Co-60, Zn-65, I-131 and Ag-110m) have been detected in the past. However, since 2000 levels have decreased to undetectable for all nuclides except for I-131. One positive measurement was noted in 2004, several in 2005 and several more this year. There has been a decrease in liquid releases from the station, which has caused most of these nuclides to become undetectable. However, seaweed has a significant bioaccumulation factor which makes it an extremely sensitive indicator of iodine in the environment.

Initial investigation of the positive measurement from the September 14, 2005 sample (CR-05-10353) indicated that the I-131 activity may have been caused by low levels in recent releases. Additional follow-up samples were taken on November 7, 2005, prior to a Unit 2 liquid discharge and on November 8, 2005 after a Unit 2 liquid discharge. These extra samples seemed to confirm the effect from a liquid discharge. The I-131 levels were quite low and are often hidden within the counting statistics. However, further follow-up in 2006 included sampling in the Thames River and at Rocky Neck to determine if there may have been other sources for the I-131. These extra samples indicated the most likely cause for the 2004 - 2006 positive I-131 results was outfall from wastewater (sewage) treatment plants. The usage of I-131 in medical treatments is becoming more common and it is not unusual for it to be in wastewater. The New London Waste Water Treatment Plant is located on the west side of the Thames River near Fort Trumbull. Groton has two wastewater treatment plants, one located across the Thames River (and slightly upstream) from the New London treatment plant and the other near Bluff Point. Note that the highest I-131 results are in the samples from the Thames River, which were taken near the outfall from the New London Waste Water Treatment Plant. There was no I-131 detected in any of the other aquatic (fish and shellfish) samples. No other station potentially related radioactivity was detected in aquatic flora in 2006.

4.17 Fish (Tables 17A and 17B)

4.17.1 Flounder (Table 17A)

The activity in Flounder is the same as that seen for the past decade. No activity was observed except for the naturally occurring nuclides.

4.17.2 Fish - Other (Table 17B)

The activity in other fish is the same as that seen for the past decade. No activity was observed in this media except for naturally occurring nuclides, including samples taken from within the quarry.

4.18 Mussels (Table 18)

Similar to the last several years, this sampling media showed no station related radioactivity at all locations.

4.19 Oysters (Table 19)

All locations, except for the quarry, utilize oysters stocked in trays. The oysters used for stocking these trays been obtained from location 68Z for the last several years. To confirm that the stocked oysters are not initially contaminated, the oysters from location 68Z have also been analyzed. The stocked trays are kept at most of the sampling areas to guarantee samples and facilitate sample collection. Native oysters are sampled at the guarry (location 40X), which is an extra location.

Station related Ag-110m was observed in two of the four samples from within the station discharge area (locations 32) and in three of the four samples from the Quarry (40X). Although location 32 is labeled as the vicinity of discharge, it has actually been located at the end of the quarry until last year when it was moved to a more accessible area in the middle of the quarry to address safety concerns. No station related activity was observed in samples from beyond the station discharge area.

For several previous years, high levels of Zn-65 were observed in oysters. This was caused by their high capacity for accumulating zinc. Studies have shown that oysters can accumulate as much as 50 times or more the amount of zinc compared to most other seafood (Wolfe, 1979). A remarkable correlation existed between the Zn-65 concentration measured in the native quarry oysters and the amount of Zn-65 discharged into the environment. However, since the permanent shutdown of Millstone Unit 1 in 1996, the amount of Zn-65 in liquid effluents has decreased to being undetectable in the station discharges. Starting in 2001, no Zn-65 has been released in liquid effluents and no Zn-65 has been detected in oysters. Figure 4.19-1, shows the historical trend that existed between Zn-65 releases and measured concentrations in quarry oysters. The decreasing trend in effluent radioactive releases is apparent in both the curies released and the measured concentrations in oysters.

Figure 4.19-2 shows a similar trend of Ag-110m concentration in quarry oysters compared to the liquid effluents discharged. Again, the correlation between Ag-110m discharged and the Ag-110m concentration measured in the native quarry oysters is apparent. The historical sensitivity between station measured effluent discharges of Zn-65 and Ag-110m when compared to environmental measured concentrations has provided a basis for Millstone to adjust the bioaccumulation factors for Zn-65 and Ag-110m used in the standard industry effluent dose consequence codes. Section 5 shows a comparison of the two dose methods. (i.e., dose from the station's measured radioactive discharges input into conservative models versus actual measurements of the concentrations of radioactivity in environmental media to calculate annual dose commitment from consumption).

Because no station activity was observed at locations beyond the station discharge area and since the two locations in the quarry are on-site and not available for public use, the actual concentration of the nuclides in oysters available for public consumption is much less. The near-field dilution factor for liquid discharges from the Millstone quarry discharge is a factor of 3. The dose consequence of the station related radioactivity via this pathway is discussed in Section 5.0

4.20 Clams (Table 20)


Occasionally this media indicates the presence of station related radioactivity. No station related radioactivity was observed in any of the clam samples taken in 2006.


4.21 Scallops (Table 21)

Scallops are not required by the REMP. However, attempts are made to sample this media to confirm station effects because scallops are available for public consumption. No scallop samples have been available for several years.

4.22 <u>Lobsters (Table 22)</u>

Like the last several years, no station related radioactivity was detected in this sample media in 2006.

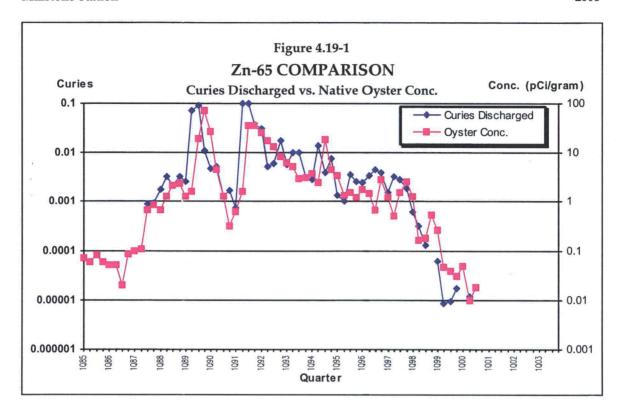

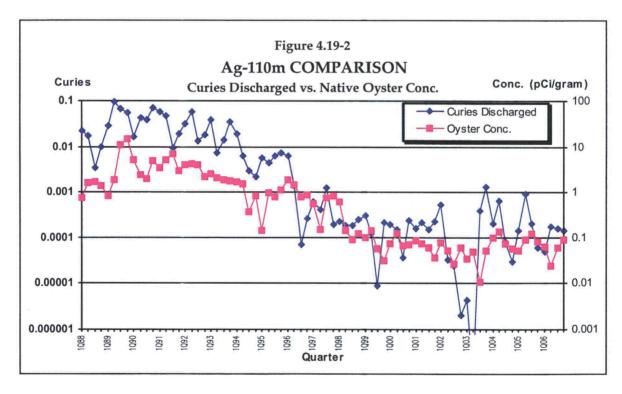

5. OFFSITE DOSE EQUIVALENT COMMITMENTS

The off-site dose consequences (dose equivalent commitments) of the station's radioactive liquid and airborne effluents have been evaluated using two methods.

The first method utilizes calculations of direct dose from sources onsite and the station's measured radioactive discharges as input parameters into conservative models to simulate the transport mechanism through the environment to man. This results in the calculation of the maximum dose consequences to individuals. The results of these computations have been submitted to the NRC in the Radioactive Effluent Release Report written in accordance with the Radiological Effluent Monitoring and Offsite Site Calculation Manual, Section I.F.2. This method, which is usually conservative (i.e., computes higher doses than that which actually occur), has the advantage of approximating an upper bound to the dose consequences. This is important in those cases where the actual dose consequence cannot be measured because they are so small as to be well below the capabilities of conventional monitoring techniques.

The second method utilizes the actual measurements of the concentrations of radioactivity in various environmental media (e.g., fish, shellfish) and then computes the dose consequences resulting from the consumption of these foods.

The results of both methods are compared in Table 5.1 for those pathways where a potential dose consequence exists and a comparison is possible. The doses presented in this table are calculated at the location of maximum effect from the station effluents for that pathway and for the critical age group. For example, the external gamma dose from gaseous effluents is calculated for the site boundary location which is not only the nearest but also has the greatest directional wind frequency and fish and shellfish doses are calculated assuming they are from an area within 500 feet of the station discharge.

Summarizing the data in Table 5.1:

MAXIMUM TOTAL INDIVIDUAL DOSES:

WHOLE BODY = 0.24 mrem

GI(LLI) = 0.022 mrem Thyroid = 0.071 mrem

The majority of the whole body dose is due to a conservative determination of dose (~0.22 mrem) to the nearest resident as a result of direct radiation from on-site radioactive waste operation/storage facilities and continuous occupancy. The GI(LLI) dose is essentially all attributable to the liquid pathway based upon Method 2. The thyroid dose is based upon conservative assessments using Method 1.

Since the maximum dose consequence to an individual is at the location of highest dose consequence, doses will be less for all other locations. The average whole body dose to an individual within 50 miles historically is on the order of 1000 times less than the maximum individual whole body dose.

In order to provide perspective on the doses in Table 5.1, the standards on the allowable maximum dose to an individual of the general public are given in 40CFR190 as 25 mrem whole body, 75 mrem thyroid, and 25 mrem to any other organ. These standards are a fraction of the normal background radiation dose of approximately 284 mrem per year and are designed to be inconsequential in regard to public health and safety. Since station related doses are even a smaller fraction of natural background, they have insignificant public health consequences. In fact, the station related doses to the maximum individual are less than 10% of the variation in natural background in Connecticut.

TABLE 5.1

COMPARISON OF DOSE CALCULATION METHODS

MILLSTONE POWER STATION

2006 Annual Dose (millirem)

				Method 2 ⁽¹⁾			
Pathway	Individual	Organ	Unit 1 (BWR)	Unit 2 (PWR)	Unit 3 (PWR)	Station Total	Station
Airborne Effluents							
1. External Gamma Dose (gamma air) ⁽⁸⁾	Max ⁽²⁾	Whole Body	0.0000	0.00379	0.00020	0.0040	ND ⁽³⁾
2. Whole Body Dose (internal and external)	Max ⁽²⁾	Whole Body	0.00098	0.0101	0.0123	0.023	ND
3. Inhalation, vegetables and goat milk	Max ⁽²⁾	Thyroid	0.00095	0.0581	0.0123	0.0714	ND
Direct Dose							
Nearest Residence	Max ⁽²⁾	Whole Body	N/A	N/A	N/A	~0.22 ⁽⁴⁾	ND ⁽⁵⁾

TABLE 5.1 (Cont.)

COMPARISON OF DOSE CALCULATION METHODS MILLSTONE POWER STATION

2006 Annual Dose (millirem)

	Max			Method 2 ⁽¹⁾			
Pathway	Individual	Organ	Unit 1 (BWR)	Unit 2 (PWR)	Unit 3 (PWR)	Station Total	Station
Liquid Effluents							
1. Fish	* Adult Teen Child	Whole Body "	0.000000 0.000000 0.000000	0.000222 0.000181 0.000164	0.000174 0.000149 0.000148	0.000396 0.000330 0.000313	ND ⁽³⁾
	* Adult Teen Child	GI(LLI) ⁽⁶⁾ "	0.00000 0.00000 0.00000	0.001457 0.001044 0.000431	0.000438 0.000326 0.000163	0.001895 0.001369 0.000594	ND
	Adult * Teen Child	Liver "	0.000000 0.000000 0.000000	0.000328 0.000301 0.000270	0.000310 0.000296 0.000275	0.000638 0.000598 0.000546	ND
2. Shellfish	* Adult Teen Child	Whole Body	0.000000 0.000000 0.000000	0.000117 0.000110 0.000125	0.000114 0.000112 0.000136	0.000231 0.000223 0.000261	0.000026 ⁽⁷⁾ 0.000027 0.000030
	* Adult Teen Child	GI(LLI)	0.000000 0.000000 0.000000	0.001346 0.000903 0.000359	0.000699 0.000502 0.000199	0.002045 0.001445 0.000558	0.0181 ⁽⁷⁾ 0.0124 0.0044
	Adult * Teen Child	Liver "	0.000000 0.000000 0.000000	0.000262 0.000266 0.000259	0.000316 0.000329 0.000330	0.00578 0.00595 0.00589	0.000044 ⁽⁷⁾ 0.000044 0.000037

Notes:

- 1. Except for direct dose, method 1 uses measured station discharges and meteorological data as input parameters to transport-to-man models that conservatively calculate dose to people; method 2 uses actual measured concentrations in environmental media to estimate the dose.
- 2. Maximum individual The maximum individual dose is the dose to the most critical age group at the location of maximum concentration of station related activity. The dose to the average individual is much less than the maximum individual dose.
- 3. ND Not Detectable No station related activity could be detected above natural background or above the minimum detectable level (MDL).
- 4. The dominant source of direct dose from the station is from storage and movement of radioactive waste. Storage of radioactive waste is allowed in several areas onsite. Operation of the storage facilities is limited by design to ensure that the maximum direct dose at the site boundary from each area does not exceed one millirem. Actual exposure throughout the year was maintained much less than this operational limit. Each facility is monitored onsite by the Radiation Protection Department using TLDs. The exposure measured for each facility TLD was corrected for distance to the nearest site boundary residence. The resultant exposure was conservatively multiplied by 1.5 to account for skyshine. These maximum estimated doses from each facility were summed for a cumulative site commitment of approximately 0.22 millirem. The whole body dose from airborne effluents was 0.023 and from liquid effluents was 0.00075. This results in a total estimated whole body dose to the maximum individual of 0.24 mrem (0.22 + 0.023 + 0.000715).
- 5. Measured dose was derived from monthly TLD readings. There are two residences that qualify as the closest residence; each has a TLD near enough to use as an estimate to each residence. The one with the highest average dose rate was used to estimate the direct dose to the closest residence. A background dose rate was subtracted. This background was derived from the average of the five control TLD locations. This method is very conservative assuming natural exposure influences, such as granite, are actually plant related exposure. This method provides a bounding high value. The exposure measurements of the select indicator locations are influenced by natural background exposure differences caused by the many granite out-croppings typical of the Millstone area. Historical data has shown that TLD sample locations in the vicinity of granite can be dramatically influenced by natural radioactivity contained within the granite.
- 6. GI (LLI) Gastrointestinal Tract Lower Large Intestine.
- 7. Based on measured levels in quarry oysters. A measured near field dilution factor of 3 was used to adjust for the fact that these oysters are on-site and inaccessible to the public. This factor adjusts the measured on-site concentration to that which could occur to a public accessible off-site location after dilution of the effluent by the Long Island Sound.
- 8. Based upon the conservatively assuming no correction for building shielding and occupancy.

6. DISCUSSION

The evaluation of the effects of station operation on the environment requires the careful consideration of many factors. Those factors depend upon the media being affected. They include station release rates, effluent dispersion, occurrence of nuclear weapons tests, seasonal variability of fallout, local environment, and locational variability of fallout. Additional factors affecting the uptake of radionuclides in milk include soil conditions (mineral content, pH, etc.), quality of fertilization, quality of land management (e.g., irrigation), pasturing habits of animals, and type of pasturage. Any of these factors could cause significant variations in the measured radioactivity. A failure to consider these factors could cause erroneous conclusions.

Consider, for example, the problem of deciphering the effect of station releases on the radioactivity measured in milk samples. This is an important issue because this product is widely consumed and several fission products readily concentrate in this media. Some of these fission products, such as I-131 and Sr-89 are relatively short-lived. Therefore they can result from either station effluents, nuclear weapons tests or nuclear incidents (e.g. Chernobyl). Sr-89's lifetime is longer than I-131's, therefore it will remain around for much longer periods of time. The even longer-lived fission products, Sr-90 and Cs-137, cause more of a concern. These isotopes are still remaining from the weapons testing era of the 1960's. This results in measurable amounts of Sr-90 and Cs-137 appearing in some milk samples. Distinguishing between this "background" of fallout activity and station effects is of prime interest for a Radiological Environmental Monitoring Program.

In reviewing the historical and present Sr-90 and Cs-137 measured in cow and goat milk in the areas around Millstone station, a casual observer could notice that in some cases the levels of these isotopes are higher at farms closer to the station than at those further away from the station. The station's effluents might at first appear to be responsible. However, the investigation of the following facts proves this conclusion wrong.

- (1) The stations accurately measure many fission products, including Sr-90 and Cs-137 in their releases. Based on these measurements and proven models developed by the Nuclear Regulatory Commission, concentrations in the environment can be calculated. These calculations (generally conservative, see Section 5.0) show that insufficient quantities of Sr-90 and Cs-137 have been released from the plants to yield the measured concentrations in milk.
- (2) Over the many years of station operation, Sr-89 has often been released in comparable quantity to Sr-90. Since they are chemically similar, comparable levels should have been detected in milk if the Sr-90 was station related. No station related Sr-89 has ever been detected in milk samples.
- (3) Similar to Sr-89, Cs-134 can be used as an indication of station related Cs-137. Although not as conclusive as Sr-89, the lack of any measurable Cs-134 in any of the milk samples suggests that the Cs-137 is not station related. This is further confirmed by the evaluation of the air particulate data. The only occurrences of detectable Cs-134 in milk resulted from the Chernobyl incident.
- (4) Dairy milk sampling in Connecticut began in the 1960's, several years prior to nuclear station operation. The highest levels of weapons fallout related Sr-90 and Cs-137 (see Figures 6-1 and 6-2), were measured in the years prior to station operation. Samples taken in the immediate station areas have always shown higher levels of weapons related fallout than samples taken from the Central Connecticut Region (CT Pooled Milk). Radioactivity levels of fallout related Sr-90 and Cs-137 have decreased significantly since the 1964 Nuclear Test Ban Treaty due to decay.

- (5) Local variability of Sr-90 and Cs-137 in milk is common throughout the United States. Due to the variability in soil conditions, pasturing methods, rainfall, etc., it is the rule rather than the exception. Therefore, it is not surprising that certain farms have higher levels of radioactivity than other farms. In fact, in the past there are some cases where the farms further from the station have higher Sr-90 and Cs-137 values than the farms that are closer to the station.
- (6) In the past when a goat farm operated near Millstone (2.0 Mi ENE), the highest levels of Sr-90 and Cs-137 were typically indicated. This same farm also experienced the highest levels of short-lived activity from the 1976 and 1977 Chinese Tests and the 1986 Chernobyl accident. This indicates that for some unknown reason this farm had the ability for higher reconcentration. Special studies performed at this and other farms failed to find any link to the station.

Based on these facts, the observation that the station effluents are responsible is obviously false. The cause must be one or more of the other variables.

Dominion has carefully examined the data throughout the years and has presented in this report all cases where station related radioactivity could be detected. An analysis of the potential exposure to the maximum individual from any station related activity has been performed and shows that in all cases the exposure is insignificant.

The Connecticut Department of Environmental Protection (DEP) performs an independent check on certain environmental program analyses. The results of their analyses are comparable to the results from this program's analyses. These comparisons can be used as a cross-reference to verify measured station activity. DEP performed a comprehensive review of all the historical Millstone data in 2006 (reference 17). It concluded that "the collective sampling in and around Millstone Power Station show expected levels of residual fallout from weapons testing and the Chernobyl event and are unrelated to the operation of the Millstone Power Station."


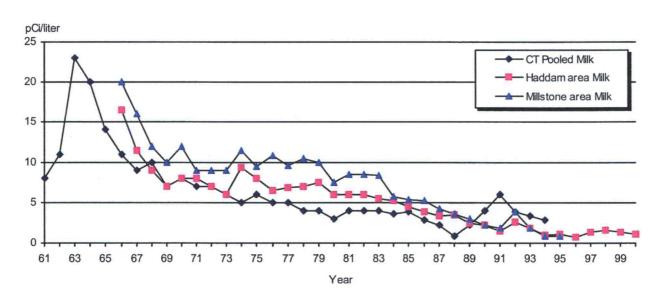


Figure 6-1 Strontium-90 in Milk

Figure 6-2 Cesium-137 in Milk

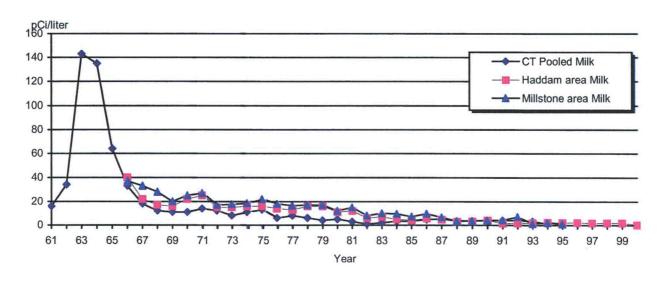

Dairy milk is no longer available in the Millstone area, Haddam Neck no longer collects milk, and CT Pooled milk has not been collected by the State of CT since 1994. Graphs provided to show historical trends.

CY Start-up occurred:

July 24, 1967

MP2 Start-up occurred:

December, 1975

MP1 Start-up occurred:

October 26, 1970

MP3 Start-up occurred:

January 23, 1986

7. REFERENCES

- 1) United States of America, Code of Federal Regulations, Title 10, Part 50, Appendix A Criteria 64.
- 2) Donald T. Oakley, "Natural Radiation Exposure in the United States." U. S. Environmental Protection Agency, ORP/SID 72-1, June 1972.
- 3) National Council on Radiation Protection and Measurements, Report No. 93, "lonizing Radiation Exposures of the Population of the United States," September 1987.
- 4) National Council on Radiation Protection and Measurements, Report No. 94, "Exposure of the Population of the United States and Canada from Natural Background Radiation," December 1987.
- 5) United States Nuclear Regulatory Commission, Regulatory Guide 8.29, "Instructions Concerning Risks from Occupational Radiation Exposure," Revision 0, July 1981.
- 6) Millstone Training Brochure.
- 7) United States Nuclear Regulatory Commission, Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977.
- 8) Millstone Power Station Radiological Effluent Monitoring and Offsite Dose Calculation Manual, Revision 025-02, December 2006.
- 9) United States of America, Code of Federal Regulations, Title 10, Part 20.1301.
- United States of America, Code of Federal Regulations, Title 10, Part 50, Appendix I.
- 11) United States of America, Code of Federal Regulations, Title 40, Part 190.
- 12) United States Nuclear Regulatory Commission, Regulatory Guide 4.1, "Program for Monitoring Radioactivity in the Environs of Nuclear Power Plants," Revision 1, April 1975.
- 13) ICN/Tracerlab, "Millstone Nuclear Power Station Pre-operational Environmental Radiation Survey Program, Quarterly Reports," April 1967 to June 1970.
- 14) International Commission of Radiological Protection, Publication No. 43, "Principles of Monitoring for the Radiation Protection of the Population," May 1984.
- 15) United States Nuclear Regulatory Commission, NUREG-1301, "Offsite Dose Calculation Manual Guidance: Standard Radiological Effluent Controls for Pressurized Water Reactors," April 1991.
- 16) United States Nuclear Regulatory Commission, Branch Technical Position, "An Acceptable Radiological Environmental Monitoring Program," Revision 1, November 1979.
- 17) Reassessment of Millstone Power Station's Environmental Monitoring Data, Connecticut Department of Environmental Protection, Division of Radiation, March 2006.

APPENDIX A

LAND USE CENSUS FOR 2006

TABLE A-1 **Dairy Cows Within 20 miles of Millstone Point-2006**

Direction	Distance	Location	# of Cows
N	14 Miles	Preston	60*
N	20 Miles	Norwich	220*
NNE	16 Miles	Preston	65*
NNE	16 Miles	Norwich	25*
NNE	16.5 Miles	Preston	55
NNE	17 Miles	Preston	126
NNE	19 Miles	Preston	50
NE	13.5 Miles	Ledyard	50
NE	18 Miles	Preston	50
NE	18 Miles	North Stonington	65
NE	19 Miles	North Stonington	49
ENE	17.3 Miles	North Stonington	280
ENE	20 Miles	North Stonington	330
WNW	10.5 Miles	Lyme	69
NW	10.4 Miles	Lyme	10**

Note: No cow farms on this list are used for sampling, all farms are greater than ten miles from plant.

^{*} unknown (based upon 2005 census)
** sheep

TABLE A-2

Dairy Goats Within 20 miles of Millstone Point- 2006

Direction	Distance	Sample Location	# of Goats
N	2.4 Miles	Waterford (LOCATION 21)	7/4*
N	20 Miles	North Franklin	2/2
NE	2.7 Miles	Waterford (LOCATION 22)	12/0
ENE	2 Miles	Waterford	1/0
ENE	13 Miles	Stonington	7/2
ENE	16.2 Miles	North Stonington	3/0
WNW	5.1 Miles	Niantic	**
WNW	18 Miles	Haddam	6/3
NW	17.3 Miles	East Haddam	6/2
NNW	12.3 Miles	Salem	12/6
NNW	18 Miles	Colchester	37/20
NNW	20.8 Miles	Colchester	6/3
NNW	29 Miles	Hebron (LOCATION 24)	7 0/26

Number of Goats/Number of Milkers

^{**} Unable To Contact As Of This Time

TABLE A-3
2006 Resident/Garden Survey

Downwind <u>Direction</u>	Distance to Closest Resident (meters)	Distance to Closest Garden (meters)
N	1500	1490
NNE	860	820
NE	790	800
ENE	1590	1620
E	1500	1670
ESE	1690	1990
SE	*	*
SSE	*	*
S	*	*
SSW	*	*
sw	3700	3840
WSW	3190	35500
W	2870	2950
WNW	2470	2740
NW	770	2180
NNW	740	1020
* * * * * * * * * * * * * * * * * * * *		

^{*} N/A - not applicable (over water sectors)

APPENDIX B

DNC QA PROGRAM

INTRODUCTION

Dominion Nuclear Connecticut (DNC) maintains an independent non-required quality assurance (QA) program as part of the radiological environmental monitoring program (REMP). The QA program consists of contractor appraisals and quality control samples. This independent program is applicable to all Dominion nuclear facilities because they share a joint contract with Framatome ANP DE&S Environmental Laboratory.

DNC QA PROGRAM

The DNC independent QA Program includes spikes of various sample media and duplicate samples. Sample spikes are a check on the accuracy of results of the contractor's radioanalyses. Duplicate samples tests the contractor's precision, or reproducibility of results, by comparing analytical results of split samples. The number and type of DNC QA Program quality control samples are defined in Millstone Nuclear Power Station Health Physics Operations Procedure REMP 1.4, "Quality Control of Radiological Environmental Monitoring Program." An investigation is conducted on any result or trend that does not satisfy acceptance criteria.

OTHER QA PROGRAMS

The DNC Independent QA Program is not the only QA Program which monitors REMP radioanalysis performance. Other programs include:

- 1. Contractor lab's internal QA program. In addition to the Millstone quality control samples, the radioanalysis contractor has its own quality control samples. In total, at least five percent of the contractor's sample analyses include quality control samples.
- 2. Contractor lab's interlaboratary comparison program with an independent third party, Analytics, Inc. Results of the Analytics intercomparison are contained in Appendix C. Primary contractor participation in an interlaboratory comparison program is required by station Technical Specifications. The Analytics comparison satisfies this requirement.
- 3. Contractor lab's participation in the National Institute of Standards and Technology (NIST) Measurement Assurance Program (MAP), the Environmental Resource Associates (ERA) Proficiency Test (PT) Program, the Department of Energy (DOE) Quality Assessment Program (QAP), and the Mixed Analyte performance Evaluation Program (MAPEP). The lab participates in these interlaboratory QA programs because of other clients' needs, not because of nuclear power station environmental sample analyses. However, some of these intercomparison samples are also applicable to nuclear power environmental samples.

O

Dominion Nuclear Connecticut, Inc. Report Millstone Station

1

44

.65 63 2006

RESULTS OF MILLSTONE QA PROGRAM FOR CONTRACTOR RADIOANALYSES

Criteria for passing QA sample analysis is that the result be within 20% of the known spike except in the case of Sr-89 or Sr-90 spikes in milk which have to be within 30% of the known spike. To allow more tolerance for lower activity spikes an alternate criterion may be used. If the two sigma error range of the analyzed result includes the known spike value the result passes.

The Millstone QA Program indicated that the contractor lab's environmental radiological analysis program was adequate in 2006. Results are shown on Table 2. All of the TLD spike tests satisfied the procedural criteria. Of the 50 individual nuclide analysis results on QA samples, 46 passed the acceptance criteria, a 92% success rate. Of the 4 failures, 3 were low by 26 – 34% and one was low by 47%. This is consistent with last year's results.

TABLE 1
2006 QUALITY CONTROL SAMPLES

<u>SAMPLE TYPE</u>	QC SAMPLES (Note 1)	ROUTINE SAMPLES
TLD Spike	16 (Note 2)	160
Milk - Strontium	2	12
Milk - Iodine	5	~30
Milk - Gamma	(Note 3)	~30
Pasture Grass/Hay – Gamma (Milk Substitute)	0	~30
Water - Gamma	4	28
Water - Tritium	4	28
Fish/Invertebrate - Gamma	4	80
Vegetation/Aquatic Flora/Sediment/Soil - Gamma	0	81
Air Particulate - Gross Beta	3	416
- lodine - Gamma	4 1	416 32

FOOTNOTE (Table 1):

- 1. All samples are spikes except fish/invertebrate which are duplicate oyster samples. Does not include January 2006 since those results were included in the 2005 report.
- 2. A set of four TLDs are spiked quarterly for readout during the routine quarterly readout.
- 3. Gamma in water QA spikes are treated as milk surrogates.

TABLE 2
RESULTS OF 2006 QUALITY CONTROL SAMPLE ANALYSES

SAMPLE TYPE	ANALYSES PASSED	ANALYSES FAILED
TLDSpike	16	<u> Y</u> 0
Milk - Strontium	4	0
Milk - Iodine	2	3 (Note 2)
Water - Gamma	20 (Note 1)	1
Water - Tritium	4	0
Oysters - Gamma	4	0
Air Particulate - Gross Beta	3	0
- lodine	4	0
- Gamma	5	0

TOTALS TLDs: 12 Individual Nuclides:

TLDs: 0 Individual Nuclides: 4

46

.

1.

FOOTNOTE (Table 2):

- 1. To provide a more detailed comparison of pass versus failure, each nuclide was considered for the gamma and strontium analyses.
- 2. These ranged from 26 to 34 percent low.

APPENDIX C

SUMMARY OF INTERLABORATORY COMPARISONS

Dominion Nuclear Connecticut, Inc. Report Millstone Station

INTRODUCTION

This appendix covers the Intercomparison Program of the AREVA-NP Environmental Laboratory as required by technical specifications for each Millstone unit. AREVA-NP uses QA/QC samples provided by Analytics, Inc to monitor the quality of analytical processing associated with the Radiological Environmental Monitoring Program (REMP). The suite of Analytics QA/QC samples are designed to be comparable with the pre-1996 US EPA Interlaboratory Cross-Check Program in terms of sample number, matrices, and nuclides. It was modified to more closely match the media mix presently being processed by AREVA-NP and includes:

- milk for gamma (10 nuclides) and low-level (LL) lodine-131 analyses once per quarter
- water for gamma (10 nuclides) and low-level (LL) lodine-131 analyses during the 1st and 3rd quarters
- water for Sr-89 and Sr-90 analyses during the 1st and 4th quarters
- water tritium analysis during the 2nd and 4th quarters
- air filter for gamma (9 nuclides) analyses during the 2nd quarter
- air filter for gross beta analysis during the 1st and 3rd quarters
- charcoal filter for I-131 during the 1st and 3rd quarters
- air filter for Sr-89 and Sr-90 analyses during the 2nd and 4th quarters

In addition to the Analytics Intercomparison Program, AREVA-NP also participates in other intercomparsion programs which include radionuclides and media similar to those required by the Millstone program. These programs are the National Institute of Standards and Technology (NIST) Measurement Assurance Program (MAP), the Environmental Resource Associates (ERA) Proficiency Test (PT) Program, the Department of Energy (DOE) Quality Assessment Program (QAP), and the Mixed Analyte Performance Evaluation Program (MAPEP).

RESULTS

Intercomparison program results are evaluated using AREVA-NP's internal bias acceptance criterion. The criterion is defined as within 25% of the known strontium value for samples containing both Sr-89 and Sr-90 and within 15% of the known value for other radionuclides, or within two sigma of the known value. Any sample analysis result which does not pass the criteria is investigated by AREVA-NP.

Analytics Intercomparison Program results are included on pages C-3 through C-6 for 2006. Since the Fourth Quarter Analytics results are not usually available until mid April, the previous year's results are listed. A total of 111 analysis results were obtained with 112 passing criteria, a 99% success rate.

AREVA NP ENVIRONMENTAL LABORATORY ANALYTICS RADIOLOGICAL ENVIRONMENTAL CROSS-CHECK PERFORMANCE EVALUATION

Sample	Quarter/	Sample			Reported	Known	Ratio E-LAB/
Number	Year	Media	Nuclide	Units	Value	Value	Analytics
E4836-162	4th/2005	Water	H-3	pCi/L	13700	13200	1.04
E4837-162	4th/2005	Water	Sr-89	pCi/L	80.3	91.4	0.88
E4837-162	4th/2005	Water	Sr-90	pCi/L	7.18	7.4	0.97
E4838-162	4th/2005	Filter	Gross Alpha	pCi	22.3	25.0	0.89
E4838-162	4th/2005	Filter	Gross Beta	pCi	146	136	1.07
E4839-162	4th/2005	Filter	Ce-141	pCi	122	131	0.93
E4839-162	4th/2005	Filter	Cr-51	pCi	113	113	1.00
E4839-162	4th/2005	Filter	Cs-134	pCi	48.0	51.0	0.94
E4839-162	4th/2005	Filter	Cs-137	pCi	111	111	1.00
E4839-162	4th/2005	Filter	Co-58	pCi	44.2	45.2	0.98
E4839-162	4th/2005	Filter	Mn-54	pCi	93.5	88.9	1.05
E4839-162	4th/2005	Filter	Fe-59	pCi	44.6	48.1	0.93
E4839-162	4th/2005	Filter	Zn-65	pCi	95.8	89.9	1.07
E4839-162	4th/2005	Filter	Co-60	pCi	59.1	64.6	0.91
E4840-162	4th/2005	Filter	Sr-89	pCi	103	121	0.85
E4840-162	4th/2005	Filter	Sr-90	pCi	9.05	9.70	0.93
E4841-162	4th/2005	Milk	I-131LL	pCi/L	72.4	74.6	0.97
E4841-162	4th/2005	Milk	I-131	pCi/L	74.1	74.6	0.99
E4841-162	4th/2005	Milk	Ce-141	pCi/L	217	224	0.97
E4841-162	4th/2005	Milk	Cr-51	pCi/L	190	193	0.98
E4841-162	4th/2005	Milk	Cs-134	pCi/L	86.4	87.3	0.99
E4841-162	4th/2005	Milk	Cs-137	pCi/L	187	189	0.99
E4841-162	4th/2005	Milk	Co-58	pCi/L	78.7	77.5	1.02
E4841-162	4th/2005	Milk	Mn-54	pCi/L	153	152	1.01
E4841-162	4th/2005	Milk	Fe-59	pCi/L	87.8	82.4	1.07
E4841-162	4th/2005	Milk	Zn-65	pCi/L	148	154	0.96
E4841-162	4th/2005	Milk	Co-60	pCi/L	106	111	0.95
E4879-162	4th/2005	Charcoal	I-131	pCi	68.4	72.0	0.95

AREVA NP ENVIRONMENTAL LABORATORY ANALYTICS ENVIRONMENTAL CROSS CHECK PROGRAM PERFORMANCE EVALUATION

						ere e	
6 1						V	Ratio
Sample Number	Quarter/- Year	Sample Media	Nuclide	Units	Reported Value	Known Value	E-LAB/ Analytics
E4884-162	1st/2006	Water	Gross Alpha	pCi/L	38.7	38.1	1.02
E4884-162	1st/2006	Water	Gross Beta	pCi/L	265	262	1.01
E4885-162	1st/2006	Water	I-131LL	pCi/L	65.8	67.4	0.98
E4885-162	1st/2006	Water	I-131	pCi/L	66.3	67.4	0.98
E4885-162	1st/2006	Water	Ce-141	pCi/L	83.0	86.8	0.96
E4885-162	1st/2006	Water	Cr-51	pCi/L	217	234	0.93
E4885-162	1st/2006	Water	Cs-134	pCi/L	91.9	101	0.91
E4885-162	1st/2006	Water	Cs-137	pCi/L	73.3	74.3	0.99
E4885-162	1st/2006	Water	Co-58	pCi/L	84.7	87.5	0.97
E4885-162	1st/2006	Water	Mn-54	pCi/L	74.7	78.1	0.96
E4885-162	1st/2006	Water	Fe-59	pCi/L	73.2	72.4	1.01
E4885-162	1st/2006	Water	Zn-65	pCi/L	146.7	148	0.99
E4885-162	1st/2006	Water	Co-60	pCi/L	102.5	107	0.96
E4886-162	1st/2006	Water	Sr-89	pCi/L	82.0	99.4	0.82
E4886-162	1st/2006	Water	Sr-90	pCi/L	10.2	10.8	0.94
E4887-162	1st/2006	Charcoal	I-131	pCi	84.3	84.8	0.99
E4888-162	1st/2006	Filter	Gross Alpha	pCi	13.5	14.2	0.95
E4888-162	1st/2006	Filter	Gross Beta	pCi	104.5	97.3	1.07
E4889-162	1st/2006	Milk	I-131LL	pCi/L	81.8	78.0	1.05
E4889-162	1st/2006	Milk	I-131	pCi/L	77.4	78.8	0.98
E4889-162	1st/2006	Milk	Ce-141	pCi/L	101	104	0.97
E4889-162	1st/2006	Milk	Cr-51	pCi/L	277	280	0.99
E4889-162	1st/2006	Milk	Cs-134	pCi/L	113.8	121	0.94
E4889-162	1st/2006	Milk	Cs-137	pCi/L	86.7	88.8	0.98
E4889-162	1st/2006	Milk	Co-58	pCi/L	100	105	0.95
E4889-162	1st/2006	Milk	Mn-54	pCi/L	94.6	93.3	1.01
E4889-162	1st/2006	Milk	Fe-59	pCi/L	90.7	86.6	1.05
E4889-162	1st/2006	Milk	Zn-65	pCi/L	172.2	176	0.98
E4889-162	1st/2006	Milk	Co-60	pCi/L	125.0	128	0.98
E4890-162	1st/2006	Milk	Sr-89	pCi/L	79.7	99.2	0.80
E4890-162	1st/2006	Milk	Sr-90	pCi/L	10.6	10.8	0.98

AREVA NP ENVIRONMENTAL LABORATORY ANALYTICS RADIOLOGICAL ENVIRONMENTAL CROSS-CHECK PERFORMANCE EVALUATION

-		-					Ratio
Sample Number	Quarter/ Year	Sample Media	Nuclide	Units	Reported Value	Known Value	E-LAB/ Analytics
E5013-162	2nd/2006	Water	H-3	pCi/L	5830	6000	0.97
E5014-162	2nd/2006	Filter	Gross Alpha	pCi	31.8	36.6	0.87
E5014-162	2nd/2006	Filter	Gross Beta	pCi	103.8	96.8	1.07
E5015-162	2nd/2006	Filter	Ce-141	pCi/L	91.6	92.8	0.99
E5015-162	2nd/2006	Filter	Cr-51	pCi/L	131.7	131	1.01
E5015-162	2nd/2006	Filter	Cs-134	pCi/L	60.5	63.9	0.95
E5015-162	2nd/2006	Filter	Cs-137	pCi/L	62.9	59.3	1.06
E5015-162	2nd/2006	Filter	Co-58	pCi/L	52.0	50.6	1.03
E5015-162	2nd/2006	Filter	Mn-54	pCi/L	74.5	73.9	1.01
E5015-162	2nd/2006	Filter	Fe-59	pCi/L	46.4	47.3	0.98
E5015-162	2nd/2006	Filter	Zn-65	pCi/L	93.4	93.6	1.00
E5015-162	2nd/2006	Filter	Co-60	pCi/L	63.0	65.0	0.97
E5016-162	2nd/2006	Filter	Sr-89	pCi/L	146.6	163	0.90
E5016-162	2nd/2006	Filter	Sr-90	pCi/L	7.01	12.3	0.57
E5017-162	2nd/2006	Milk	I-131LL	pCi/L	67.0	63.2	1.06
E5017-162	2nd/2006	Milk	I-131	pCi/L	62.0	63.2	0.98
E5017-162	2nd/2006	Milk	Ce-141	pCi/L	180.8	184	0.98
E5017-162	2nd/2006	Milk	Cr-51	pCi/L	248.0	259	0.96
E5017-162	2nd/2006	Milk	Cs-134	pCi/L	120.1	127	0.95
E5017-162	2nd/2006	Milk	Cs-137	pCi/L	117.3	117	1.00
E5017-162	2nd/2006	Milk	Co-58	pCi/L	97.3	100	0.97
E5017-162	2nd/2006	Milk	Mn-54	pCi/L	150.5	146	1.03
E5017-162	2nd/2006	Milk	Fe-59	pCi/L	95.4	93.6	1.02
E5017-162	2nd/2006	Milk	Zn-65	pCi/L	183.9	185	0.99
E5017-162	2nd/2006	Milk	Co-60	pCi/L	126.2	129	0.98

AREVA NP ENVIRONMENTAL LABORATORY ANALYTICS ENVIRONMENTAL CROSS CHECK PROGRAM PERFORMANCE EVALUATION

	6 4 4				5		Ratio
Sample Number	Quarter/ Year	Sample Media	Nuclide	Units	Reported Value	Known Value	E-LAB/ Analytics
E5090-162	3rd /2006		Gross Alpha	pCi/L	71.5	69.4	1.03
		Water	Gross Beta	pCi/L	253		0.93
E5090-162	3rd /2006	Water				273	
E5091-162	3rd /2006	Water	I-131LL	pCi/L	84.4	79.9	1.06
E5091-162	3rd /2006	Water	I-131	pCi/L	77.3	79.9	0.97
E5091-162	3rd /2006	Water	Ce-141	pCi/L	84.5	88.0	0.96
E5091-162	3rd /2006	Water	Cr-51	pCi/L	287	288	1.00
E5091-162	3rd /2006	Water	Cs-134	pCi/L	85.6	87.0	0.98
E5091-162	3rd /2006	Water	Cs-137	pCi/L	174	179	0.97
E5091-162	3rd /2006	Water	Co-58	pCi/L	108	112	0.96
E5091-162	3rd /2006	Water	Mn-54	pCi/L	116	115	1.01
E5091-162	3rd /2006	Water	Fe-59	pCi/L	47.0	44.7	1.05
E5091-162	3rd /2006	Water	Zn-65	pCi/L	146	148	0.99
E5091-162	3rd /2006	Water	Co-60	pCi/L	130	137	0.95
E5092-162	3rd /2006	Charcoal	I-131	pCi	88.3	91.1	0.97
E5093-162	3rd /2006	Filter	Gross Alpha	pCi	36.9	37.3	0.99
E5093-162	3rd /2006	Filter	Gross Beta	рСі	142	147	0.97
E5094-162	3rd /2006	Milk	I-131LL	pCi/L	79.9	73.8	1.08
E5094-162	3rd /2006	Milk	I-131	pCi/L	72.5	73.8	0.98
E5094-162	3rd /2006	Milk	Ce-141	pCi/L	85.5	86.0	0.99
E5094-162	3rd /2006	Milk	Cr-51	pCi/L	288	282	1.02
E5094-162	3rd /2006	Milk	Cs-134	pCi/L	84.8	85.0	1.00
E5094-162	3rd /2006	Milk	Cs-137	pCi/L	171	175	0.98
E5094-162	3rd /2006	Milk	Co-58	pCi/L	106	109	0.97
E5094-162	3rd /2006	Milk	Mn-54	pCi/L	112	113	0.99
E5094-162	3rd /2006	Milk	Fe-59	pCi/L	45.3	43.7	1.04
E5094-162	3rd /2006	Milk	Zn-65	pCi/L	146	145	1.01
E5094-162	3rd /2006	Milk	Co-60	pCi/L	129	134	0.96