



L-2007-053 10 CFR 50.36b

U. S. Nuclear Regulatory Commission Attn: Document Control Desk Washington, D.C. 20555-00001

Re:

Turkey Point Units 3 and 4 Docket Nos. 50-250 and 50-251

2006 Annual Radiological

Environmental Operating Report

Enclosed is the 2006 Annual Radiological Environmental Operating Report for Turkey Point Units 3 and 4, as required by Technical Specification 6.9.1.3.

Should there be any questions or comments regarding this information, please contact James W. Connolly at (305) 246-6632.

Sincerely,

William Jefferson, Jr.

Vice President

Turkey Point Nuclear Plant

SM

Enclosure

cc: Regional Administrator, Region II, USNRC

Senior Resident Inspector, USNRC, Turkey Point Plant

ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

TURKEY POINT PLANT

UNITS 3 & 4

LICENSE NOS. DPR-31, DPR-41

DOCKET NOS. 50-250, 50-251

Data Submitted by: Florida DOH

Prepared by: Per G B

Reviewed by:

TABLE OF CONTENTS

DESCRIPTION	<u>PAGE</u>
Introduction	1
Radiological Environmental Monitoring Program	1
Discussion and Interpretation of Results	4
Environmental Radiological Monitoring Program Annual Summary	TABLE 1
Deviations / Missing Data	TABLE 1A
Analyses with LLDs Above Required Detection Capabilities	TABLE 1B
Land Use Census	TABLE 2
Key to Sample Locations	ATTACHMENT A
Radiological Surveillance of Florida Power and Light Company's Turkey Point Site	ATTACHMENT B
First Quarter, 2006	
Second Quarter, 2006	
Third Quarter, 2006	
Fourth Quarter, 2006	•
Results from the Interlaboratory Comparison Program, 2006	ATTACHMENT C

EXECUTIVE SUMMARY

The data obtained through the Turkey Point Radiological Environmental Monitoring Program verifies that the levels of radiation and concentrations of radioactive materials in environmental samples are not increasing. These measurements verify that the dose or dose commitment to members of the public, due to operation of Turkey Point Units 3 & 4, during the surveillance year, is well within the limits established by 10 CFR 50, Appendix I. The sampling period was from January 1, 2006 to December 31, 2006.

Additionally, supplemental samples collected by the State of Florida, DOH, do not indicate adverse trends in the radiological environment.

I. INTRODUCTION

This report is submitted pursuant to Specification 6.9 of Turkey Point Units 3 & 4 Technical Specifications. The Annual Radiological Environmental Operating Report provides information, summaries and analytical results pertaining to the Radiological Environmental Monitoring Program for the calendar year indicated. This report covers surveillance activities described in the Offsite Dose Calculation Manual (ODCM) meeting the requirements of Unit 3 and Unit 4 Technical Specifications.

II. RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

A. Purpose

The purpose of the Radiological Environmental Monitoring Program is to provide representative measurements of radiation and of radioactive materials in those exposure pathways and for those radionuclides which lead to the highest potential radiation exposures of members of the public resulting from station operation. The Radiological Environmental Monitoring Program also supplements the radiological effluent monitoring program by verifying that the measurable concentrations of radioactive materials and levels of radiation are not higher than expected on the basis of the effluent measurements and the modeling of the environmental exposure pathways.

B. Program Description

The Radiological Environmental Monitoring Program (REMP) for the Turkey Point Plant is conducted pursuant to Control 5.1 of Turkey Point Unit 3 & 4 ODCM.

- 1. Sample Locations, Types and Frequencies:
 - a. Direct radiation gamma exposure rate is monitored continuously at 22 locations by thermoluminescent dosimeters (TLDs). TLDs are collected and analyzed quarterly.
 - b. Airborne radioiodine and particulate samplers are operated continuously at five locations. Samples are collected and analyzed weekly. Analyses include lodine-131, gross beta, and gamma isotopic measurements.
 - Surface water samples are collected from three locations. Samples are collected and analyzed monthly. Analyses include gamma isotopic and tritium measurements.

٦,

ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT TURKEY POINT PLANT – UNITS 3 & 4

- d. Shoreline sediment samples are collected from three locations coinciding with the locations for surface water samples. Samples are collected and analyzed semi-annually. Sediment samples are analyzed by gamma isotopic measurements.
- e. Fish and invertebrate samples are collected from two locations coinciding with two of the locations for surface water samples. Samples are collected and analyzed semi-annually. Fish and invertebrate samples are analyzed by gamma isotopic measurements.
- f. Broad leaf vegetation samples are collected from three locations. Samples are collected and analyzed monthly. Broad leaf vegetation samples are analyzed by gamma isotopic measurements.
- g. Ground Water, NEI Initiative: There were no ground water sampling locations in the REMP for 2006

Attachment A provides specific information pertaining to sample locations, types and frequencies.

2. Analytical Responsibility:

Radiological environmental monitoring for the Turkey Point Plant is conducted by the State of Florida, Department of Health (DOH). Samples are collected and analyzed by DOH personnel.

Samples are analyzed at the DOH Environmental Radiation Control Laboratory in Orlando, Florida.

C. Analytical Results

<u>Table 1, Environmental Radiological Monitoring Program Annual Summary</u> provides a summary for all specified samples collected during the referenced surveillance period. Deviations from the sample schedule, missing data and/or samples not meeting the specified "A PRIORI" LLD, if any, are noted and explained in Tables 1A and 1B respectively. Analysis data for all specified samples analyzed during the surveillance period is provided in Attachment B.

D. Land Use Census

A land use census out to a distance of 5 miles radius from the Turkey Point Plant is conducted annually to determine the location of the nearest milk animal, residence, and garden producing broad leaf vegetation, in each of the sixteen meteorological sectors. A summary of the land use census for the surveillance year is provided in <u>Table 2</u>, <u>Land Use Census Summary</u>.

 $\Omega = \{\chi, \Psi^{-1}(Y)\}$

ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT TURKEY POINT PLANT – UNITS 3 & 4

E. Interlaboratory Comparison Program

The intercomparison program consists of participating in the DOE Mixed Analyte Performance Evaluation Program (MAPEP).

This program provides similar testing (matrices, nuclides, and levels) as the former EPA Interlaboratory Comparison Program and is referred to as the Mixed Analyte Performance Evaluation Program (MAPEP).

The samples are analyzed using the methods applicable to the REMP (gamma spectroscopy, Gross Beta, and Tritium for water).

From the MAPEP handbook:

Acceptance criteria were developed from a review of precision and accuracy data compiled by other performance evaluation programs (PEPs), the analytical methods literature, from several MAPEP pilot studies, and from what is considered reasonable, acceptable, and achievable for routine analyses among the more experienced laboratories.

The results for nuclides associated with the REMP are listed in ATTACHMENT C, RESULTS FROM THE INTERLABORATORY COMPARISON PROGRAM.

ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT TURKEY POINT PLANT – UNITS 3 & 4

III. DISCUSSION AND INTERPRETATION OF RESULTS

A. Reporting of Results

The Annual Radiological Environmental Operating Report contains the summaries, interpretations and information required by Control 1.4 of ODCM. Table 1 provides a summary of the measurements made for the nuclides required by ODCM Table 5.1-2, for all samples specified by Table 5.1-1. In addition, summaries are provided for other nuclides identified in the specified samples, including those not related to station operation. These include nuclides such as K-40, Th-232, Ra-226, and Be-7 which are common in the Florida environment.

B. Interpretation of Results

1. Direct Radiation:

The results of direct radiation monitoring are consistent with past measurements for the specified locations.

The exposure rate data shows no indication of any trends attributed to effluents from the plant. The measured exposure rates are consistent with exposure rates that were observed during the pre-operational surveillance program. Direct radiation monitoring results are summarized in Table 1.

2. Air Particulates/Radioiodine:

The results for radioactive air particulate and radioiodine monitoring are consistent with past measurements and indicate no trends attributed to plant effluents. All samples for radioiodine yielded no detectable I-131. Gamma isotopic measurements yielded no indication of any nuclides attributed to station operation. The results for air particulate/radioiodine samples are consistent with measurements that were made during the pre-operational surveillance program. Air particulate and radioiodine monitoring results are summarized in Table 1.

3. Waterborne, Surface Water:

The results of radioactivity measurements in surface water samples are consistent with past measurements. Tritium was reported as present in 4 of the 36 surface water samples collected. These results are consistent with the known subsurface interchange that occurs between the closed cooling canal and its surrounding waters, and the pressure gradients caused by the flow of aquifer subsurface waters in South Florida. The highest reported tritium is less than 11% of the required detection level specified by ODCM Table 5.1-3.

4. Waterborne, Sediment:

The results are consistent with past measurements. Only cosmic-ray produced Be-7 and naturally occurring isotopes were identified.

ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT TURKEY POINT PLANT – UNITS 3 & 4

5. Waterborne, Food Products:

The results are consistent with past measurements; only naturally occurring radionuclides were detected.

6. Broad Leaf Vegetation

The results of radioactivity measurements are consistent with past measurements. Cs-137 was detected, as in the past, in samples collected from the indicator and control locations. The maximum concentration reported was less than 10% of the reporting level specified by ODCM Table 5.1-2. No other fission products were detected.

7. Land Use Census

There were no changes to the land use relative to last year's report.

No locations yielding a calculated dose or dose commitment greater than the values currently being calculated were identified by the land use census.

No locations yielding a calculated dose or dose commitment (via the same exposure pathway) 20% greater than locations currently being sampled in the radiological environmental monitoring program were identified by the land use census.

8. Interlaboratory Comparison Program

The State laboratory participated in MAPEP 15 and 16.

In MAPEP 15, the results Air Filter, Water and Vegetation matrices for those nuclides associated with nuclear power plant operation and using analytical methods used in the REMP are Acceptable. The Soil matrix had one warning in response to over-estimated U-238 results.

There was one not acceptable result; the lab reported an extremely low value for Cs-134 when there was none in the sample. The lab reported a false positive.

In MAPEP 16, the results for all matrices were acceptable. The warning associated with Co-57 in vegetation resulted from the lab reporting a 'zero' without a confidence interval (e.g., zero \pm .00x). The W flag was issued because the grading process did not get a response that fit the expected format. The evaluation process for a blank (i.e., un-spiked) expects some small number with a large error. The State lab reported just 0.00 (zero).

The results are listed in Attachment C.

C. Conclusions

The data obtained through the Turkey Point Plant Radiological Environmental Monitoring Program verifies that the levels of radiation and concentrations of radioactive materials in environmental samples, representing the highest potential exposure pathways to members of the public, are not being increased.

Additionally, supplemental to the ODCM program, sampling of the direct exposure, inhalation, and ingestion pathways, performed by DOH, does not show adverse trends in levels of radiation and radioactive materials in unrestricted areas. The measurements verify that the dose or dose commitment to members of the public, due to operation of Turkey Point Units 3 & 4, during the surveillance year, are well within "as low as reasonably achievable (ALARA)" criteria established by 10 CFR 50, Appendix I.

TABLE 1

ENVIRONMENTAL RADIOLOGICAL MONITORING PROGRAM ANNUAL SUMMARY Name of Facility <u>Turkey Point Units 3 & 4</u>, Docket No(s). <u>50-250 & 50-251</u>
Location of Facility <u>Miami-Dade, Florida</u>, Reporting Period <u>January 1 - December 31, 2006</u>
(County, State)

PATHWAY: DIRECT RADIATION SAMPLES COLLECTED: TLD

UNITS: micro-R/hr

			Location with High	nest Annual Mean	
			Name ^c	Mean (f) ^b	
Type and Total Number of Analyses Performed	Lower Limit of Detection ^a (LLD)	All Indicator Locations Mean (f) ^b Range	Distance & Range Direction ge	Control Locations Mean (f) ^b Range	
Exposure Rate, 88 ^d		5.4 (84/84) 3.9 – 8.2	NW-10 10 mi., NW	7.6 (4/4) 6.9 - 8.2	6.2 (4/4) 5.7 – 6.5

ENVIRONMENTAL RADIOLOGICAL MONITORING PROGRAM ANNUAL SUMMARY Name of Facility <u>Turkey Point Units 3 & 4</u>, Docket No(s). <u>50-250 & 50-251</u>
Location of Facility <u>Miami-Dade, Florida</u>, Reporting Period <u>January 1 - December 31, 2006</u>
(County, State)

PATHWAY: AIRBORNE

SAMPLES COLLECTED: RADIOIODINE AND PARTICULATES UNITS: pCi/m^3

			Location with Hig	hest Annual Mean	
			Name ^c	Mean (f) ^b	
Type and Total Number of Analyses Performed	Lower Limit of Detection ^a (LLD)	All Indicator Locations Mean (f) ^b Range	Distance & Direction	Range	Control Locations Mean (f) ^b Range
¹³¹ I, 260	0.024	< MDA			< MDA
Gross Beta, 260	0.0025	0.016 (208/208) 0.005 - 0.029	T-72 < 1 mi., WSW	0.017 (52/52) 0.006 - 0.029	0.016 (52/52) 0.004 - 0.027
Composite Gamma Isotopic, 20					
⁷ Be	0.0052	0.1862 (16/16) 0.1045 - 0.2326	T-72 < 1 mi., WSW	0.2066 (4/4) 0.1693 - 0.2326	0.2014 (4/4) 0.1429 - 0.2585
¹³⁴ Cs	0.00069	< MDA			< MDA
¹³⁷ Cs	0.00066	< MDA			< MDA
²¹⁰ Pb		0.0273 (10/16) 0.0123 - 0.0382	T-58 1 mi., NW	0.0318 (2/4) 0.0286 – 0.0350	0.0298 (2/4) 0.0265 – 0.0331

ENVIRONMENTAL RADIOLOGICAL MONITORING PROGRAM ANNUAL SUMMARY Name of Facility <u>Turkey Point Units 3 & 4</u>, Docket No(s). <u>50-250 & 50-251</u> Location of Facility <u>Miami-Dade, Florida</u>, Reporting Period <u>January 1 - December 31, 2006</u> (County, State)

PATHWAY: WATERBORNE

SAMPLES COLLECTED: SURFACE WATER

UNITS: pCi/L

			Location with Hig	hest Annual Mean	
		_	Name ^c	Mean (f) ^b	
Type and Total Number of Analyses Performed	Lower Limit of Detection ^a (LLD)	All Indicator Locations Mean (f) ^b Range	Distance & Direction	Range	Control Locations Mean (f) ^b Range
Tritium, 36	230	185 (4/24) 125 - 310	T-81 6 mi., S	185 (4/12) 125 - 310	<mda< td=""></mda<>
Gamma Isotopic, 36					
⁴⁰ K	60	311 (24/24) 198 - 419	T-81 6 mi., S	319 (12/12) 248 - 400	202 (12/12) 93 - 336
⁵⁴ Mn	4	< MDA			< MDA
⁵⁹ Fe	8	< MDA			< MDA
⁵⁸ Co	4	< MDA			< MDA
⁶⁰ Co	4	< MDA			< MDA
⁶⁵ Zn	8	< MDA			< MDA
⁹⁵ Zr-Nb	7	< MDA			< MDA
131	5	< MDA			< MDA
¹³⁴ Cs	5	< MDA			< MDA
¹³⁷ Cs	5	< MDA			< MDA
¹⁴⁰ Ba-La	11	< MDA			< MDA

ENVIRONMENTAL RADIOLOGICAL MONITORING PROGRAM ANNUAL SUMMARY Name of Facility <u>Turkey Point Units 3 & 4</u>, Docket No(s). <u>50-250 & 50-251</u> Location of Facility <u>Miami-Dade, Florida</u>, Reporting Period <u>January 1 - December 31, 2006</u> (County, State)

PATHWAY: WATERBORNE

SAMPLES COLLECTED: SHORELINE SEDIMENT

UNITS: pCi/kg, DRY

			Location with Highe Name ^c	st Annual Mean Mean (f) ^b	
Type and Total Number of Analyses Performed	Lower Limit of Detection ^a (LLD)	All Indicator Locations Mean (f) ^b Range	Distance & Direction	Range	Control Locations Mean (f) ^b Range
Gamma Isotopic, 6					
⁷ Be	100	157 (2/4) 154 - 159	T-81 6 mi., S	159 (1/2)	< MDA
⁴⁰ K	140	268 (2/4) 264 - 272	T-81 6 mi., S	268 (2/2) 264 - 272	148 (2/2) 111 - 184
²¹⁰ Pb		541 (3/4) 499 - 570	T-81 6 mi., S	562 (2/2) 550 - 570	< MDA
²²⁶ Ra	49	933 (4/4) 631 - 1500	T-42 < 1 mi., ENE	1066 (2/2) 631 - 1500	355 (1/2)
²³⁵ U		51 (1/4)	T-81 6 mi., S	56 (1/2)	< MDA
²³⁸ U		777 (2/4) 638 - 916	T-81 6 mi., S	916 (1/2)	< MDA
⁵⁸ Co	9	<mda< td=""><td></td><td></td><td>< MDA</td></mda<>			< MDA
⁶⁰ Co	12	<mda< td=""><td></td><td></td><td>< MDA</td></mda<>			< MDA
¹³⁴ Cs	14	<mda< td=""><td></td><td></td><td>< MDA</td></mda<>			< MDA
¹³⁷ Cs	12	<mda< td=""><td></td><td></td><td>< MDA</td></mda<>			< MDA

TABLE 1

ENVIRONMENTAL RADIOLOGICAL MONITORING PROGRAM ANNUAL SUMMARY Name of Facility <u>Turkey Point Units 3 & 4</u>, Docket No(s). <u>50-250 & 50-251</u>
Location of Facility <u>Miami-Dade, Florida</u>, Reporting Period <u>January 1 - December 31, 2006</u>
(County, State)

PATHWAY: INGESTION

SAMPLES COLLECTED: CRUSTACEA

UNITS: pCi/kg, WET

			Location with Hig	hest Annual Mean	
			Name ^c	Mean (f) ^b	
Type and Total Number of Analyses Performed Lower Limit of Detection ^a (LLD)	All Indicator Locations Mean (f) Range	Distance & Direction	Range	Control Locations Mean (f) ^b Range	
Gamma Isotopic, 3					
⁴⁰ K	130	2023 (2/2) 1899 - 2147	T-81 6 mi., S	2023 (2/2) 1899 - 2147	1276 (1/1)
²²⁶ Ra	20	502 (1/2)	T-81 6 mi., S	502 (1/2)	319 (1/1)
²²⁸ Ra		< MDA			48 (1/1)
⁵⁴ Mn	9	< MDA			< MDA
⁵⁹ Fe	16	< MDA			< MDA
⁵⁸ Co	9	< MDA			< MDA
⁶⁰ Co	19	< MDA			< MDA
⁶⁵ Zn	17	< MDA			< MDA
¹³⁴ Cs	9	< MDA			< MDA
¹³⁷ Cs	9	< MDA			< MDA

ENVIRONMENTAL RADIOLOGICAL MONITORING PROGRAM ANNUAL SUMMARY Name of Facility <u>Turkey Point Units 3 & 4</u>, Docket No(s). <u>50-250 & 50-251</u> Location of Facility <u>Miami-Dade, Florida</u>, Reporting Period <u>January 1 - December 31, 2006</u> (County, State)

PATHWAY: INGESTION

SAMPLES COLLECTED: FISH

UNITS: pCi/kg, WET

			Location with Hig	hest Annual Mean	
			_Name ^c	Mean (f) ^b	_
<i>7</i> 1	Lower Limit of Detection ^a (LLD)	All Indicator Locations Mean (f) Range	Distance & Direction	Range	Control Locations Mean (f) ^b Range
Gamma Isotopic, 4					
⁷ Be		<mda< td=""><td></td><td></td><td><mda< td=""></mda<></td></mda<>			<mda< td=""></mda<>
⁴⁰ K	130	2862 (2/2) 2602 - 3121	T-81 6 mi., S	2862 (2/2) 2602 - 3121	2488 (2/2) 2325 - 2651
⁵⁴ Mn	9	<mda< td=""><td></td><td></td><td><mda< td=""></mda<></td></mda<>			<mda< td=""></mda<>
⁻⁵⁹ Fe	16	<mda< td=""><td></td><td></td><td><mda< td=""></mda<></td></mda<>			<mda< td=""></mda<>
⁵⁸ Co	9	<mda< td=""><td></td><td></td><td><mda< td=""></mda<></td></mda<>			<mda< td=""></mda<>
⁶⁰ Co	10	<mda< td=""><td></td><td></td><td><mda< td=""></mda<></td></mda<>			<mda< td=""></mda<>
⁶⁵ Zn	17	<mda< td=""><td></td><td></td><td><mda< td=""></mda<></td></mda<>			<mda< td=""></mda<>
¹³⁴ Cs	9	<mda< td=""><td></td><td></td><td><mda< td=""></mda<></td></mda<>			<mda< td=""></mda<>
¹³⁷ Cs	9	<mda< td=""><td></td><td></td><td><mda< td=""></mda<></td></mda<>			<mda< td=""></mda<>
²²⁶ Ra	20	<mda< td=""><td></td><td></td><td><mda< td=""></mda<></td></mda<>			<mda< td=""></mda<>

TABLE 1

ENVIRONMENTAL RADIOLOGICAL MONITORING PROGRAM ANNUAL SUMMARY Name of Facility <u>Turkey Point Units 3 & 4</u>, Docket No(s). <u>50-250 & 50-251</u>
Location of Facility <u>Miami-Dade, Florida</u>, Reporting Period <u>January 1 - December 31, 2006</u>
(County, State)

PATHWAY: INGESTION

SAMPLES COLLECTED: BROAD LEAF VEGETATION

UNITS: pCi/kg, WET

			Location with Hig	hest Annual Mean	
			Name ^c	Mean (f) ^b	_
- ·	Lower Limit of Detection ^a (LLD)	All Indicator Locations Mean (f)Range	Distance & Direction	Range	Control Locations Mean (f) ^b Range
Gamma Isotopic, 36					
⁷ Be	71	1356 (24/24) 453 <i>-</i> 2661	T-40 3 mi., W	1428 (12/12) 453 - 2661	1259 (12/12) 606 - 2162
⁴⁰ K	100	4253 (24/24) 2564 - 6634	T-41 2 mi., W/NW	4839 (12/12) 2833 - 6634	3409 (12/12) 2818 - 4342
⁵⁸ Co	9	<mda< td=""><td></td><td></td><td><mda< td=""></mda<></td></mda<>			<mda< td=""></mda<>
⁶⁰ Co	10	<mda< td=""><td></td><td></td><td><mda< td=""></mda<></td></mda<>			<mda< td=""></mda<>
¹³¹	9	<mda< td=""><td></td><td></td><td><mda< td=""></mda<></td></mda<>			<mda< td=""></mda<>
¹³⁴ Cs	8	<mda< td=""><td></td><td></td><td><mda< td=""></mda<></td></mda<>			<mda< td=""></mda<>
¹³⁷ Cs	8	52 (19/24) 22 - 196	T-40 3 mi., W	56 (12/12) 22 - 196	28 (6/12) 23 - 36
²¹⁰ Pb		1800 (2/24) 1337 - 2264	T-41 2 mi., W/NW	2264 (1/12)	1881 (3/12) 877 - 3604
²²⁶ Ra		449 (6/24) 157 - 785	T-41 2 mi., W/NW	463 (3/12) 327 - 670	274 (3/12) 206 - 313

ENVIRONMENTAL RADIOLOGICAL MONITORING PROGRAM ANNUAL SUMMARY
Name of Facility <u>Turkey Point Units 3 & 4</u>, Docket No(s). <u>50-250 & 50-251</u>
Location of Facility <u>Miami-Dade, Florida</u>, Reporting Period <u>January 1 - December 31, 2006</u>
(County, State)

NOTES

- a. The LLD is an "a priori" lower limit of detection which establishes the smallest concentration of radioactive material in a sample that will yield a net count above system background that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a real signal.
 - LLDs in this column are at time of measurement. The MDAs reported in Attachment B for the individual samples have been corrected to the time of sample collection.
- b. Mean and range based upon detectable measurements only. Fraction of detectable measurements at specified locations is indicated in parentheses (f).
- c. Specific identifying information for each sample location is provided in Attachment A.
- d. Results were based upon the average net response of three elements in a TLD. (Thermoluminescent Dosimeter).

MDA refers to minimum detectable activity.

ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT TURKEY POINT PLANT – UNITS 3 & 4

TABLE 1A

DEVIATIONS / MISSING DATA

A) Pathway:

Airborne, Particulates & Radioiodine

Location:

T-64, 22 miles NNE

Dates:

28 Feb to 8 Mar 2006

Deviation:

Failure to provide continuous monitoring

Description of

Problem:

Air sampler pump failure.

Corrective

Replaced pump, verified sampling system as operating correctly.

Action:

B) Pathway:

Airborne, Particulates & Radioiodine

Location:

T-57, 4 miles NW

Dates:

7-14 Nov , 14-21 Nov, 13-19 Dec , 19-27 Dec 2006

Deviation:

Failure to provide continuous monitoring

Description of

Sporadic power faults caused less than continuous sampler operation;

Problem:

sampler does auto-restart upon power restoration.

Corrective Action:

Check, reset if needed, breaker, replaced sampler pump (suspected cause), verify equipment operable and operating. Upgrade power source to sampler system; planned completion in early 2007.

C) Pathway:

Airborne, Particulates & Radioiodine

Location:

T-51, 2 miles NNW

Dates:

6-13 Dec 2006

Deviation:

Problem:

Failure to provide continuous monitoring

Description of

Power failure at sampling station.

Corrective Action:

Restored power; verified sampling equipment operation.

D) Pathway:

Ingestion - seafood, crustaceans

Location:

T-67, 13 – 18 miles North (pathway Control Location)

Dates:

Second half-2006 (semi-annual sampling)

Deviation:

Failure to collect sample

Description of

Insufficient sample collected; half-life versus required LLD concerns

Problem:

precludes compositing a 6 month sample

Corrective Action:

No corrective action applicable.

TABLE 1B

ANALYSIS WITH LLDs ABOVE ODCM TABLE 5.1-3 DETECTION CAPABILITIES 1/1/2006 - 12/31/2006

The values specified in ODCM Table 5.1-3, Detection Capabilities, were achieved for all samples.

TABLE 2

LAND USE CENSUS

Distance to Nearest (a, b)

Sector	7/06 Milk (c) Animal	7/06 Residence (g)	7/06 Garden (d)
N	L (e)	2.0 / 354	L .
NNE	O (f)	0	0
NE	0	0	0
ENE	0	0	0
E	0	0	0
ESE	0	0	0
SE	0	0	0
SSE	0	0	0
S	L	L	Ĺ
SSW	L	L	L
SW	L	L	L
WSW	L	L	L
W	L	L	L`
WNW	L	3.7 / 302	4.5 / 303
NW	Ļ	3.7 / 311	4.2 / 323
NNW	L	4.4 / 333	4.6 / 327

TABLE 2

LAND USE CENSUS

NOTES

- a. All categories surveyed out to 5 miles radius from the Turkey Point Plant.
- b. The following format is used to denote the location:

distance (miles)/bearing (degrees)

For example, a residence located in the north sector at a distance of 2.0 miles bearing 354 degrees is recorded as 2.0 / 354.


- c. Potential milk animal locations.
- d. Gardens with an estimated growing area of 500 square feet or more.
- e. L denotes that the sector area is predominantly a land area unoccupied by the category type.
- f. O denotes that the sector area is predominantly an ocean area.
- g. Non-residential occupied buildings in these sectors include the following:

<u>Sector</u>	<u>Distance</u>	<u>Description</u>
N	1.9 / 349	24-hour Security Staff Building
NNW	1.9 / 349	Security booth at park entrance


ATTACHMENT A

KEY TO SAMPLE LOCATIONS

NEAR SITE SAMPLING LOCATIONS

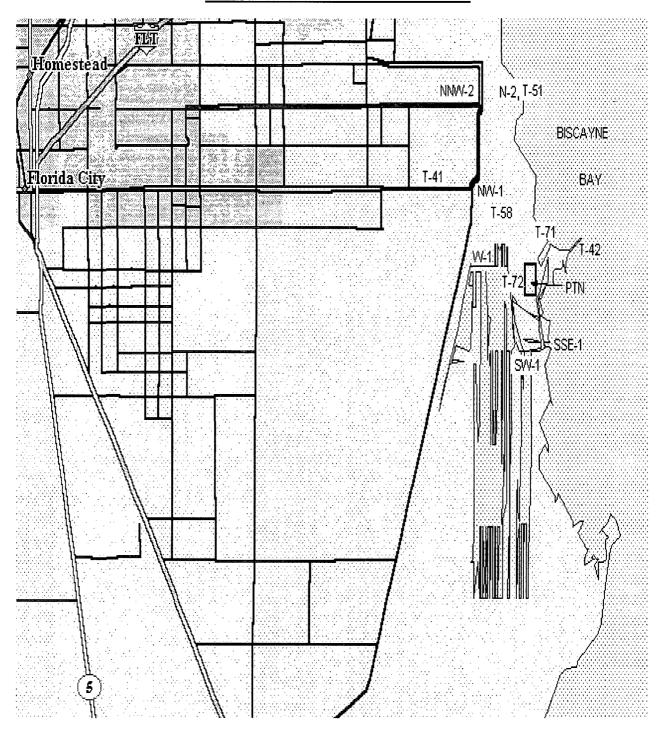

DISTANT REMP SAMPLING LOCATIONS

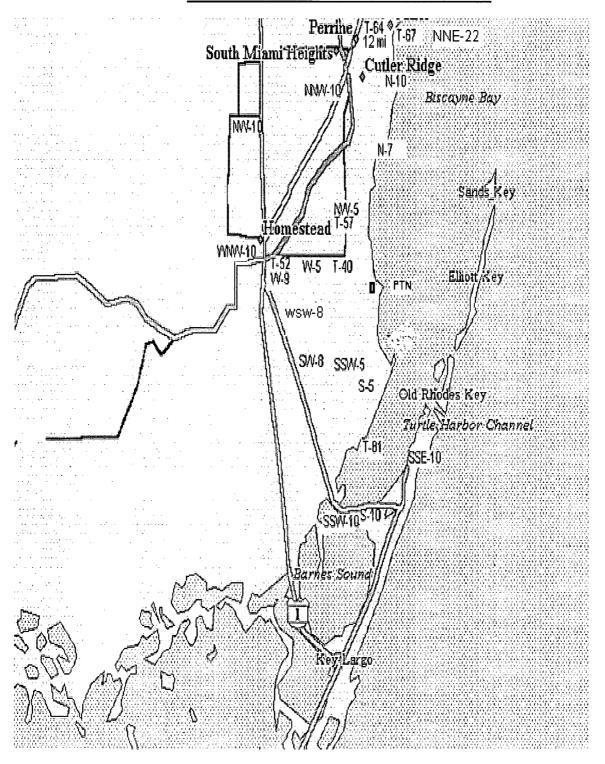

ATTACHMENT A

PAGE 1 OF 4

PATHWAY: DIRECT RADIATION SAMPLES COLLECTED: TLD

SAMPLE COLLECTION FREQUENCY: QUARTERLY

Location ^(a) Name	<u>Description</u>
N-2 N-7	Convey Point, Parking Area Black Point Marina Parking Lot
N-10 NNW-2	Old Cutler Rd. approx. 196th Street East End North Canal Road
NNW-10 NW-1	Bailes Road & U.S. #1 Turkey Point Entrance Road
NW-5 NW-10	Mowry Drive & 117th Avenue Newton Road, North of Coconut Palm Drive
WNW-10	Homestead Middle School
W-1 W-5	On-Site, North Side of Discharge Canal Palm Drive & Tallahassee Road
W-9 WSW-8	Card Sound Road, 0.6 mile from U.S. #1 Card Sound Road, 3.4 miles from U.S. #1
SW-1	On-Site near Land Utilization Offices
SW-8 SSW-5	Card Sound Road, 5 miles from U.S. #1 On-Site, Southwest Corner of Cooling Canals
SSW-10 S-5	Card Sound Road, west side of Toll Plaza On-Site, South East Corner of Cooling Canals
S-10 SSE-1	Card Sound Road at Steamboat Creek Turtle Point
SSE-10	Ocean Reef
Control NNE-22	Natoma Substation , 2475 SW 16 Ct.

^aThe location name is the direction sector - approximate distance (miles)

ATTACHMENT A

Page 2 of 4

PATHWAY: AIRBORNE

SAMPLES COLLECTED: RADIOIODINE AND PARTICULATES

SAMPLE COLLECTION FREQUENCY: WEEKLY

Location Name	Direction Sector	Approximate Distance <u>(miles)</u>	<u>Description</u>
T-51	NNW	2	Entrance Area to Biscayne National Park
T-57	NW	4	SW 107th Avenue at Mowry Canal
T-58	NW	1	Turkey Point Entrance Road
T-52	W	9	Supplemental location used to compensate, per ODCM, for temporary loss of T-57.
T-72	WSW	<1	Just before entrance to Land Utilization's access gate.
Control:			
T-64	NNE	22	Natoma Substation , 2475 SW 16 Ct.
Note			
		0.5	O di
T-71	NNE	0.5	On site "Red Barn" picnic area. This sampling station may be used as an alternate to T-51.

ATTACHMENT A

Page 3 of 4

PATHWAY: WATERBORNE

SAMPLES COLLECTED: SURFACE WATER (OCEAN) SAMPLE COLLECTION FREQUENCY: MONTHLY

Location Name	Direction Sector	Approximate Distance (miles)	<u>Description</u>
T-42	ENE	<1	Biscayne Bay at Turkey Point
T-81	S	6	Card Sound, near Mouth of Old Discharge Canal
Control:			
T-67	N, NNE	13-18	Near Biscayne Bay, Vicinity of Cutler Plant, North to Matheson Hammock Park

SAMPLES COLLECTED: SHORELINE SEDIMENT SAMPLE COLLECTION FREQUENCY: SEMI-ANNUALLY

Location Direction Approximate **Description** <u>Name</u> Sector Distance (miles) T-42 ENE <1 Biscayne Bay at Turkey Point T-81 S 6 Card Sound, near Mouth of Old Discharge Canal Control: T-67 N, NNE 13-18 Near Biscayne Bay, Vicinity of Cutler Plant, North to Matheson Hammock Park

ATTACHMENT A

Page 4 of 4

PATHWAY: INGESTION

SAMPLES COLLECTED: CRUSTACEA AND FISH

SAMPLE COLLECTION FREQUENCY: SEMI-ANNUALLY

Location <u>Name</u>	Direction Sector	Approximate Distance (miles)	<u>Description</u>
T-81	S	6	Card Sound Vicinity of Turkey Point Facility
Control:			
T-67	N, NNE	13-18	Near Biscayne Bay, Vicinity of Cutler Plant, North to Matheson Hammock Park

SAMPLES COLLECTED: BROAD LEAF VEGETATION SAMPLE COLLECTION FREQUENCY: MONTHLY

Location <u>Name</u>	Direction <u>Sector</u>	Approximate Distance (miles)	<u>Description</u>
T-40	W	3	South of Palm Dr. on S.W. 117th Street Extension
T-41	WNW	2	Palm Dr., West of Old Missile Site near Plant Site Boundary
Control:			
T-67	N, NNE	13-18	Near Biscayne Bay, Vicinity of Cutler Plant, North to Matheson Hammock Park

ATTACHMENT B

RADIOLOGICAL SURVEILLANCE OF FLORIDA POWER AND LIGHT COMPANY'S

TURKEY POINT SITE

2006

First Quarter, 2006

Second Quarter, 2006

Third Quarter, 2006

Fourth Quarter, 2006

TURKEY POINT SITE

Offsite Dose Calculation Manual Sampling

First Quarter, 2006

Sample Type	Collection Frequency	Locations Sampled	Number of <u>Samples</u>
1. Direct Radiation	Quarterly	22	22
2. Airborne			
2.a. Air Iodines	Weekly	5	65
2.b. Air Particulates	Weekly	5	65
3. Waterborne			
3.a. Surface Water	Monthly	3	9
3.b. Shoreline Sediment	Semiannually	3	3
4. Ingestion 4.a. Fish and Invertebrates			
4.a.1. Crustacea	Semiannually	2	0
4.a.2. Fish	Semiannually	2	0
4.b. Broadleaf Vegetation	Monthly	3	9

Total: 173

NOTE: Measurement results having magnitudes that are significantly above the background of the measurement system are reported as net values plus or minus a one-standard-deviation error term. Measurement results that are <u>not</u> significantly above background are reported as less than a Lower Limit of Detection (<LLD), which is an estimated upper limit (with at least 95% confidence) for the true activity in the sample.

The marine fauna listed in this report were collected in part, under Florida FWC SAL030.

1. DIRECT RADIATION - TLDs - (μR/hour)

Sample Site	Deployment 07-Dec-05 Collection 15-Mar-06	Sample Site	Deployment 07-Dec-05 Collection 15-Mar-06
N-2	5.9 ± 0.3	WSW-8	4.8 ± 0.4
N-7	5.1 ± 0.2		
N-10	5.5 ± 0.3	SW-1	4.7 ± 0.3
		SW-8	7.2 ± 1.1
NNW-2	5.5 ± 0.8		
NNW-10	5.9 ± 0.3	SSW-5	5.3 ± 0.3
		SSW-10	5.0 ± 0.3
NW-1	7.0 ± 0.3		
NW-5	5.0 ± 0.2	S-5	5.0 ± 0.4
NW-10	8.2 ± 0.5	S-10	6.0 ± 0.3
WNW-10	6.1 ± 0.4	SSE-1	5.1 ± 0.2
		SSE-10	5.8 ± 0.4
W-1	6.9 ± 0.3		
W-5	5.2 ± 0.3	NNE-22	6.5 ± 0.3
W-9	5.0 ± 0.2		

2.a. IODINE-131 IN WEEKLY AIR CARTRIDGES - (pCi/m3)

Collection	<u>T51</u>	T57	T58	T64	T72
Date					
05-Jan-06	<0.02	<0.02	<0.02	<0.02	<0.02
10-Jan-06	<0.03	<0.03	<0.03	<0.03	<0.03
17-Jan-06	<0.03	<0.03	<0.03	<0.03	<0.03
25-Jan-06	<0.01	<0.01	<0.01	<0.01	<0.01
02-Feb-06	<0.01	<0.01	<0.01	<0.01	<0.01
07-Feb-06	<0.03	<0.03	<0.03	<0.03	<0.03
16-Feb-06	<0.01	<0.01	<0.01	<0.01	<0.01
22-Feb-06	<0.01	<0.01	<0.01	<0.01	<0.01
28-Feb-06	<0.02	<0.02	<0.02	<0.02	<0.02
08-Mar-06	<0.01	<0.01	<0.01	<0.02(A)	<0.01
14-Mar-06	<0.02	<0.02	<0.02	<0.02	<0.02
21-Mar-06	<0.02	<0.02	<0.02	<0.02	<0.02
29-Mar-06	<0.02	<0.02	<0.02	<0.02	<0.02

⁽A) Pump failed, replaced. Run time est. at 137.5 out of 191.75 hrs.

2.b.1. AIR PARTICULATES - GROSS BETA - (pCi/m3)

Sam	ple	Sit	es
-----	-----	-----	----

Collection Date	T51	T57	T58	T64	T72
05-Jan-06	0.018 ± 0.002	0.017 ± 0.002	0.018 ± 0.002	0.024 ± 0.002	0.020 ± 0.002
10-Jan-06	0.023 ± 0.003	0.022 ± 0.003	0.016 ± 0.003	0.021 ± 0.003	0.027 ± 0.003
17-Jan-06	0.011 ± 0.002	0.011 ± 0.002	0.011 ± 0.002	0.013 ± 0.002	0.010 ± 0.002
25-Jan-06	0.014 ± 0.002	0.013 ± 0.002	0.014 ± 0.002	0.010 ± 0.002	0.016 ± 0.002
02-Feb-06	0.015 ± 0.002	0.015 ± 0.002	0.015 ± 0.002	0.017 ± 0.002	0.016 ± 0.002
07-Feb-06	0.012 ± 0.003	0.010 ± 0.002	0.008 ± 0.002	0.009 ± 0.002	0.011 ± 0.003
16-Feb-06	0.020 ± 0.002	0.021 ± 0.002	0.022 ± 0.002	0.017 ± 0.002	0.020 ± 0.002
22-Feb-06	0.011 ± 0.002	0.009 ± 0.002	0.011 ± 0.002	0.013 ± 0.002	0.015 ± 0.002
28-Feb-06	0.016 ± 0.002	0.018 ± 0.002	0.013 ± 0.002	0.015 ± 0.002	0.016 ± 0.002
08-Mar-06	0.021 ± 0.002	0.021 ± 0.002	0.019 ± 0.002	$0.022 \pm 0.003(A)$	0.023 ± 0.002
14-Mar-06	0.019 ± 0.002	0.018 ± 0.002	0.014 ± 0.002	0.015 ± 0.002	0.016 ± 0.002
21-Mar-06	0.018 ± 0.002	0.019 ± 0.002	0.021 ± 0.002	0.027 ± 0.003	0.022 ± 0.002
29-Mar-06	0.015 ± 0.002	0.017 ± 0.002	0.018 ± 0.002	0.015 ± 0.002	0.020 ± 0.002
Average:	0.016 ± 0.001	0.016 ± 0.001	0.015 ± 0.001	0.017 ± 0.001	0.018 ± 0.001
A) Pump fail	ed replaced Ru	in time est, at 13	7.5 out of 191.7	5 hrs	

⁽A) Pump failed, replaced. Run time est. at 137.5 out of 191.75 hrs.

2.b.2. AIR PARTICULATES GAMMA ANALYSIS OF QUARTERLY COMPOSITES (pCi/m³)

First Quarter, 2006

Sample Site	<u>Be-7</u>	<u>K-40</u>	<u>Cs-134</u>	<u>Cs-137</u>	<u>Pb-210</u>
T51	0.2142 ± 0.0175	<0.0270	<0.0017	<0.0013	<0.0629
T57	0.2064 ± 0.0181	<0.0294	<0.0016	<0.0008	<0.0554
T58	0.2191 ± 0.0128	<0.0156	<0.0013	<0.0010	0.0286 ± 0.0042
T64	0.2585 ± 0.0180	<0.0278	< 0.0014	<0.0011	<0.0545
T72	0.2326 ± 0.0134	<0.0156	< 0.0014	<0.0008	0.0217 ± 0.0034

3.a. SURFACE WATER - (pCi/L)

Sample <u>Site</u>	Collection Date	<u>H-3</u>	<u>K-40</u>	<u>Mn-54</u>	<u>Co-58</u>	<u>Fe-59</u>	<u>Co-60</u>	<u>Zn-65</u>	Zr-95 <u>Nb-95</u> (A)	<u>l-131</u>	<u>Cs-134</u>	<u>Cs-137</u>	Ba-140 <u>La-140</u> (B)
T42	17-Jan-06	<144	211 ± 35	<4	<4	<8	<5	<10	<7	<5	<4	<4	<6
	03-Feb-06	<155	383 ± 33	<3	<3	<7	<5	<9	<6	<5	<4	<4	<6
	15-Mar-06	<154	350 ± 24	<2	<3	<5	<3	<6	<4	<4	<3	<2	<4
T67	17-Jan-06	<144	211 ± 28	<4	<4	<6	<4	<9	<6	<4	<5	<3	<9
	03-Feb-06	<155	209 ± 27	<3	<3	<7	<4	<7	<6	<6	<4	<4	<5
	14-Mar-06	<154	136 ± 25	<3	<4	<6	<3	<8	<6	<5	<4	· <4	<7
T81	17-Jan-06	<144	248 ± 37	<4	<4	<6	<5	<7	<7	<4	<7	<4	<7
	07-Feb-06	173 ± 30	365 ± 33	<3	<3	<7	<5	<9	<7	<5	<4	<4	<8
	14-Mar-06	131 ± 29	315 ± 41	<3	<3	<8	<4	<8	<6	<5	<5	<4	<5

⁽A) These tabulated LLD values for Zr/Nb-95 are the higher of the individual parent or daughter LLDs.

⁽B) These tabulated LLD values are for Ba-140, either based on direct measurement of Ba-140 or based on ingrowth of La-140, whichever method yields the greater sensitivity for a given sample.

3.b. SHORELINE SEDIMENT - (pCi/kg, dry weight)

Sample <u>Site</u>	Collection <u>Date</u>	<u>Be-7</u>	<u>K-40</u>	<u>Co-58</u>	<u>Co-60</u>	<u>Cs-134</u>	<u>Cs-137</u>	<u>Pb-210</u>	<u>Ra-226</u>	<u>Th-232</u>	<u>Others</u>
T42	03-Feb-06	<127	<246	<15	<15	<19	<14	<1275	1500 ± 180	<57	<1047
T67	03-Feb-06	<103	184 ± 68	<10	<10	<13	<13	<812	<302	<50	<653
T81	07-Feb-06	<112	272 ± 75	<11	<12	<13	<11	555 ± 266	819 ± 157	<51	<687

4.a.1. CRUSTACEA - Blue Crab, (pCi/kg, wet weight)

Sample <u>Site</u>	Collection <u>Date</u>	K-40	<u>Mn-54</u>	<u>Co-58</u>	<u>Fe-59</u>	<u>Co-60</u>	<u>Zn-65</u>	<u>Cs-134</u>	<u>Cs-137</u>	<u>Ra-226</u>	<u>Ra-228</u>
T67	This sam	ple has not yet b	een colle	cted.							
T81	This sam	ple has not yet b	een collec	cted.							

4.a.2. FISH - Mixed Species - (pCi/kg, wet weight)

Sample	Collection									
<u>Site</u>	Date	K-40	<u>Mn-54</u>	<u>Co-58</u>	<u>Fe-59</u>	<u>Co-60</u>	<u>Zn-65</u>	<u>Cs-134</u> <u>Cs-137</u>	Ra-226	Ra-228
T67	This sample has not yet been collected.									
T81	This sample has not yet been collected.									

4.b. BROADLEAF VEGETATION - Brazilian Pepper - (pCi/kg, wet weight)

Sample Site	Collection Date	Be-7	K-40	<u> I-131</u>	<u>Cs-134</u>	<u>Cs-137</u>	Pb-210	Ra-226
T40	17-Jan-06	453 ± 67	6576 ± 281	<17	<20	41 ± 7	<2550	<379
	07-Feb-06	1304 ± 103	3149 ± 182	<12	<14	47 ± 7	<2256	<366
	14-Mar-06	631 ± 37	3367 ± 93	<7	<7	22 ± 4	<947	157 ± 65
T41	17-Jan-06	859 ± 97	3844 ± 247	<18	<22	<24	<2725	327 ± 160
	07-Feb-06	780 ± 91	6336 ± 262	<17	<22	<18	<2477	<376
	14-Mar-06	1083 ± 110	3969 ± 229	<18	<20	<24	<2379	670 ± 148
T67	17-Jan-06	729 ± 69	3399 ± 173	<12	<19	<12	<1397	<332
	03-Feb-06	757 ± 79	3938 ± 201	<18	<17	<15	<1972	313 ± 151
	14-Mar-06	1296 ± 37	3062 ± 85	<8	<7	23 ± 4	<940	206 ± 59

TURKEY POINT SITE

Offsite Dose Calculation Manual Sampling

Second Quarter, 2006

Sample Type	Collection	Locations	Number of
	Frequency	<u>Sampled</u>	<u>Samples</u>
1. Direct Radiation	Quarterly	22	22
Airborne 2.a. Air Iodines 2.b. Air Particulates	Weekly	5	65
	Weekly	5	65
3. Waterborne 3.a. Surface Water 3.b. Shoreline Sediment	Monthly Semiannually	3 0	9 0
4. Ingestion 4.a. Fish and Invertebrates 4.a.1. Crustacea 4.a.2. Fish 4.b. Broadleaf Vegetation	Semiannually	2	2
	Semiannually	2	2
	Monthly	3	9

Total: 174

NOTE: Measurement results having magnitudes that are significantly above the background of the measurement system are reported as net values plus or minus a one-standard-deviation error term. Measurement results that are <u>not</u> significantly above background and with greater than a 50% error term are reported as less than a Lower Limit of Detection (<LLD), which is an estimated upper limit (with at least 95% confidence) for the true activity in the sample.

The marine fauna listed in this report were collected in part, under Florida FWC SAL030.

1. DIRECT RADIATION - TLDs - (µR/hour)

Sample Site	Deployment 15-Mar-06 Collection 15-June-06	Sample Site	Deployment 15-Mar-06 Collection 15-June-06
N-2 ⁻	5.6 ± 0.2	WSW-8	5.3 ± 0.1
N-7	4.8 ± 0.2		
N-10	5.2 ± 0.2	SW-1	5.3 ± 0.2
•		SW-8	6.0 ± 0.2
NNW-2	4.5 ± 0.1		
NNW-10	5.6 ± 0.2	SSW-5	5.1 ± 0.1
		SSW-10	5.3 ± 0.3
NW-1	6.5 ± 0.2		•
NW-5	4.5 ± 0.3	S-5	4.9 ± 0.2
NW-10	7.9 ± 0.3	S-10	5.8 ± 0.1
WNW-10	6.6 ± 0.3	SSE-1	4.7 ± 0.2
	•	SSE-10	5.6 ± 0.2
W-1	6.6 ± 0.2		
W-5	5.7 ± 0.3	NNE-22	6.4 ± 0.5
W-9	4.9 ± 0.3		•

2.a. IODINE-131 IN WEEKLY AIR CARTRIDGES - (pCi/m3)

Collection					
<u>Date</u>	<u>T51</u>	<u>T57</u>	<u>T58</u>	<u>T64</u>	<u>T72</u>
04-Apr-06	<0.02	<0.02	<0.02	<0.02	<0.02
11-Apr-06	<0.02	<0.02	<0.02	<0.02	<0.02
18-Apr-06	<0.01	<0.01	<0.01	<0.01	<0.01
25-Apr-06	<0.01	<0.01	<0.01	<0.01	<0.01
02-May-06	<0.01	<0.01	<0.01	<0.01	<0.01
10-May-06	<0.02	<0.02	<0.02	<0.02	<0.02
16-May-06	<0.02	<0.02	<0.02	<0.02	<0.02
23-May-06	<0.02	<0.02	<0.02	<0.02	<0.02
30-May-06	<0.02	<0.02	<0.02	<0.02	<0.02
07-Jun-06	<0.01	<0.01	<0.01	<0.01	<0.01
14-Jun-06	<0.02	<0.02	<0.02	<0.02	<0.02
21-Jun-06	<0.02	<0.02	<0.02	<0.02	<0.02
27-Jun-06	<0.02	<0.02	<0.01	<0.02	< 0.02

2.b.1. AIR PARTICULATES - GROSS BETA - (pCi/m3)

Sample Site

CollectionDate	T51	T57	T58	T64	T72
04-Apr-06	0.021 ± 0.003	0.023 ± 0.003	0.020 ± 0.003	0.024 ± 0.003	0.020 ± 0.003
11-Apr-06	0.014 ± 0.002	0.010 ± 0.002	0.019 ± 0.002	0.018 ± 0.002	0.018 ± 0.002
18-Apr-06	0.013 ± 0.002	0.013 ± 0.002	0.015 ± 0.002	0.014 ± 0.002	0.012 ± 0.002
25-Apr-06	0.017 ± 0.002	0.018 ± 0.002	0.022 ± 0.002	0.015 ± 0.002	0.017 ± 0.002
02-May-06	0.016 ± 0.002	0.017 ± 0.002	0.019 ± 0.002	0.017 ± 0.002	0.014 ± 0.002
10-May-06	0.024 ± 0.002	0.023 ± 0.002	0.029 ± 0.002	0.026 ± 0.003	0.023 ± 0.002
16-May-06	0.019 ± 0.002	0.022 ± 0.003	0.020 ± 0.002	0.026 ± 0.003	0.023 ± 0.003
23-May-06	0.014 ± 0.002	0.018 ± 0.002	0.014 ± 0.002	0.012 ± 0.002	0.018 ± 0.002
30-May-06	0.009 ± 0.002	0.013 ± 0.002	0.012 ± 0.002	0.014 ± 0.002	0.009 ± 0.002
07-Jun-06	0.018 ± 0.002	0.021 ± 0.002	0.018 ± 0.002	0.017 ± 0.002	0.018 ± 0.002
14-Jun-06	0.022 ± 0.002	0.018 ± 0.002	0.020 ± 0.002	0.022 ± 0.002	0.024 ± 0.002
21-Jun-06	0.014 ± 0.002	0.020 ± 0.002	0.012 ± 0.002	0.016 ± 0.002	0.019 ± 0.002
27-Jun-06	0.010 ± 0.002	0.006 ± 0.002	0.009 ± 0.002	0.008 ± 0.002	0.010 ± 0.002
Average:	0.016 ± 0.001	0.017 ± 0.001	0.018 ± 0.001	0.017 ± 0.001	0.017 ± 0.001

2.b.2. AIR PARTICULATES GAMMA ANALYSIS OF QUARTERLY COMPOSITES (pCi/m³)

Second Quarter, 2006

Sample Site	<u>Be-7</u>	<u>K-40</u>	<u>Cs-134</u>	<u>Cs-137</u>	Pb-210
T51	0.1814 ± 0.0125	<0.0230	<0.0012	<0.0009	0.0324 ± 0.0036
T57	0.1881 ± 0.0128	<0.0159	< 0.0014	<0.0011	0.0279 ± 0.0040
T58	0.1970 ± 0.0139	<0.0229	<0.0011	<0.0004	0.0350 ± 0.0047
T64	0.2061 ± 0.0127	<0.0205	<0.0011	<0.0011	0.0265 ± 0.0034
T72	0.2225 ± 0.0158	<0.0251	<0.0025	<0.0012	<0.0591

3.a. SURFACE WATER - (pCi/L)

Sample <u>Site</u>	Collection <u>Date</u>	<u>H-3</u>	<u>K-40</u>	<u>Mn-54</u>	<u>Co-58</u>	<u>Fe-59</u>	<u>Co-60</u>	<u>Zn-65</u>	Zr-95 <u>Nb-95</u> (A)	<u>l-131</u>	<u>Cs-134</u>	<u>Cs-137</u>	Ba-140 <u>La-140</u> (B)
T42	11-Apr-06	<148	419 ± 36	<3	<3	<8	<4	<10	<5	<5	<4	<4	<8
	17-May-06	<144	375 ± 35	<4	<4	<6	<5	<8	<6	<5	<5	<4	<4
	13-Jun-06	<145	330 ± 35	<3	<4	<9	<4	<8	<7	<5	<4	<5	<5
T67	11-Apr-06	<148	328 ± 33	<3	<3	<8	<4	<7	<5	<4	<4	<3	<8
	16-May-06	<144	336 ± 30	<4	<3	<8	<4	<7	<6	<6	<5	<4	<6
	13-Jun-06	<145	119 ± 20	<2	<2	<5	<3	<4	<4	<3	<3	. <2	<4
T81	11-Apr-06	<146	333 ± 30	<3	<3	<6	<5	<8	<6	<4	<4	<4	<5
	17-May-06	<144	400 ± 35	<4	<4	<7	<4	<7	<6	<5	<4	<4	<5
	13-Jun-06	<145	331 ± 31	<3	<3	<7	<4	<8	<5	<5	<4	<4	<6

⁽A) These tabulated LLD values for Zr/Nb-95 are the higher of the individual parent or daughter LLDs.

⁽B) These tabulated LLD values are for Ba-140, either based on direct measurement of Ba-140 or based on ingrowth of La-140, whichever method yields the greater sensitivity for a given sample.

3.b. SHORELINE SEDIMENT - (pCi/kg, dry weight)

Sample Collection
Site Date Be-7 K-40 Co-58 Co-60 Cs-134 Cs-137 Pb-210 Ra-226 Th-232 U-238

These samples were previously collected.

4.a.1. CRUSTACEA - (pCi/kg, wet weight)

Sample <u>Site</u>	Collection <u>Date</u>	K-40	<u>Mn-54</u>	<u>Co-58</u>	<u>Fe-59</u>	<u>Co-60</u>	<u>Zn-65</u>	<u>Cs-134</u>	<u>Cs-137</u>	Ra-226	Ra-228
T67	25-May-06	1276 ± 65	<6	<7	<16	<7	<15	<7	<6	319 ± 48	48 ± 9
T81	28-Apr-06	1899 ± 245	<31	<26	<103	<32	<47	<36	<29	<648	<118

4.a.2. FISH - (pCi/kg, wet weight)

Sample <u>Site</u>	Collection <u>Date</u>	<u>K-40</u>	<u>Mn-54</u>	<u>Co-58</u>	<u>Fe-59</u>	<u>Co-60</u>	<u>Zn-65</u>	<u>Cs-134</u>	<u>Cs-137</u>	Ra-226	Ra-228
T67	13-Apr-06	2651 ± 260	<26	<45	<75	<36	<62	<31	<30	<490	<135
T81	27-Apr-06	3121 ± 289	<34	<29	<99	<30	<79	<30	<30	<538	<111

4.b. BROADLEAF VEGETATION - Brazilian Pepper - (pCi/kg, wet weight)

Sample Site	Collection Date	Be-7	K-40	<u>l-131</u>	Cs-134	<u>Cs-137</u>	Pb-210	Pb-212	Ra-226
T40	11-Apr-06	1946 ± 107	4301 ± 221	<17	<19	65 ± 11	<2073	<81	<337
	16-May-06	823 ± 46	3483 ± 99	<11	<8	36 ± 4	<1099	<38	<159
	13-Jun-06	1443 ± 90	3088 ± 180	<16	<18	196 ± 12	<2051	<72	785 ± 125
T41	11-Apr-06	1447 ± 106	5852 ± 236	<14	<16	47 ± 10	<2146	<74	<330
	16-May-06	812 ± 83	2833 ± 176	<23	<16	62 ± 10	<2281	<73	<314
	13-Jun-06	1100 ± 83	4699 ± 212	<14	<15	35 ± 6	<1894	<61	<293
T67	11-Apr-06	2162 ± 97	2860 ± 177	<16	<18	29 ± 8	<2394	<77	<339
	16-May-06	772 ± 66	3566 ± 176	<21	<16	25 ± 6	3604 ± 654	<73	303 ± 113
	13-Jun-06	606 ± 61	2818 ± 165	<13	<13	<14	<1672	<58	<262

TURKEY POINT SITE

Offsite Dose Calculation Manual Sampling

Third Quarter, 2006

Sample Type	Collection	Locations	Number of
	<u>Frequency</u>	<u>Sampled</u>	<u>Samples</u>
1. Direct Radiation	Quarterly	22	22
 2. Airborne 2.a. Air Iodines 2.b. Air Particulates 3. Waterborne 3.a. Surface Water 3.b. Shoreline Sediment 	Weekly	5	65
	Weekly	5	65
	Monthly	3	9
	Semiannually	3	3
4. Ingestion 4.a.Fish and Invertebrates 4.a.1. Crustacea 4.a.2. Fish 4.b. Broadleaf Vegetation	Semiannually Semiannually Monthly	2 2 3	0 0 9 Total: 173

NOTE: Measurement results having magnitudes that are significantly above the background of the measurement system are reported as net values plus or minus a one-standard-deviation error term. Measurement results that are <u>not</u> significantly above background and with greater than a 50% error term are reported as less than a Lower Limit of Detection (<LLD), which is an estimated upper limit (with at least 95% confidence) for the true activity in the sample.

The marine fauna listed in this report were collected in part, under Florida FWC SAL030.

1. DIRECT RADIATION - TLDs - (μ R/hour)

Sample Site	Deployment 15-Jun-06 Collection 13-Sep-06	Sample Site	Deployment 15-Jun-06 Collection 15-Sep-06
N-2	5.4 ± 0.4	WSW-8	4.6 ± 0.2
N-7	4.5 ± 0.2		
N-10	4.9 ± 0.3	SW-1	4.7 ± 0.3
		SW-8	5.2 ± 0.3
NNW-2	4.2 ± 0.2		
NNW-10	5.4 ± 0.4	SSW-5	4.2 ± 0.2
		SSW-10	4.7 ± 0.2
NW-1	6.0 ± 0.4		
NW-5	4.1 ± 0.2	S-5	4.6 ± 0.3
NW-10	6.9 ± 0.4	S-10	5.5 ± 0.3
WNW-10	5.7 ± 0.3	SSE-1	4.2 ± 0.2
		SSE-10	5.6 ± 0.4
W-1	6.0 ± 0.4		
W-5	4.9 ± 0.4	NNE-22	5.7 ± 0.4
W-9	4.2 ± 0.2		

2.a. IODINE-131 IN WEEKLY AIR CARTRIDGES - (pCi/m3)

Collection <u>Date</u>	<u>T51</u>	<u>T57</u>	<u>T58</u>	<u>T64</u>	<u>T72</u>
05-Jul-06	<0.01	<0.01	<0.01	<0.01	<0.01
11-Jul-06	<0.02	<0.02	<0.02	<0.02	<0.02
20-Jul-06	<0.01	<0.01	<0.01	<0.01	<0.01
25-Jul-06	<0.04	<0.04	<0.04	<0.04	<0.04
01-Aug-06	<0.02	<0.02	<0.02	<0.02	<0.02
08-Aug-06	<0.01	<0.01	<0.01	<0.01	<0.01
15-Aug-06	<0.02	<0.02	<0.02	<0.02	<0.02
23-Aug-06	<0.01	<0.01	<0.01	<0.01	<0.01
29-Aug-06	<0.04	<0.04	<0.03	<0.04	<0.04
06-Sep-06	<0.01	<0.01	<0.01	<0.01	<0.01
12-Sep-06	<0.02	<0.02	<0.02	<0.02	<0.02
19-Sep-06	<0.02	<0.02	<0.02	<0.02	<0.02
26-Sep-06	<0.02	<0.02	<0.02	<0.02	<0.02

2.b.1. AIR PARTICULATES - GROSS BETA - (pCi/m3)

Sample Site

Collection		Oam	pic Oito		
<u>Date</u>	<u>T51</u>	<u>T57</u>	<u>T58</u>	<u>T64</u>	<u>T72</u>
05-Jul-06	0.013 ± 0.002	0.008 ± 0.002	0.011 ± 0.002	0.010 ± 0.002	0.011 ± 0.002
11-Jul-06	0.013 ± 0.002	0.009 ± 0.002	0.012 ± 0.002	0.014 ± 0.002	0.012 ± 0.002
20-Jul-06	0.013 ± 0.002	0.012 ± 0.002	0.008 ± 0.001	0.010 ± 0.002	0.011 ± 0.002
25-Jul-06	0.012 ± 0.002	0.008 ± 0.002	0.014 ± 0.002	0.009 ± 0.002	0.013 ± 0.002
01-Aug-06	0.014 ± 0.002	0.017 ± 0.002	0.016 ± 0.002	0.016 ± 0.002	0.018 ± 0.002
08-Aug - 06	0.011 ± 0.002	0.014 ± 0.002	0.013 ± 0.002	0.021 ± 0.002	0.020 ± 0.002
15-Aug-06	0.016 ± 0.002	0.018 ± 0.002	0.017 ± 0.002	0.020 ± 0.002	0.019 ± 0.002
23-Aug-06	0.013 ± 0.002	0.010 ± 0.002	0.014 ± 0.002	0.012 ± 0.002	0.015 ± 0.002
29-Aug-06	0.013 ± 0.002	0.006 ± 0.002	0.010 ± 0.002	0.012 ± 0.002	0.011 ± 0.002
06-Sep-06	0.006 ± 0.002	0.005 ± 0.001	0.007 ± 0.002	0.007 ± 0.002	0.008 ± 0.002
12-Sep-06	0.011 ± 0.002	0.012 ± 0.002	0.014 ± 0.002	0.010 ± 0.002	0.015 ± 0.002
19-Sep-06	0.017 ± 0.002	0.018 ± 0.002	0.019 ± 0.002	0.016 ± 0.002	0.022 ± 0.002
26-Sep-06	0.017 ± 0.002	0.016 ± 0.002	0.019 ± 0.002	0.016 ± 0.002	0.015 ± 0.002
Average:	0.013 ± 0.001	0.012 ± 0.001	0.013 ± 0.001	0.013 ± 0.001	0.015 ± 0.001
viago.	5.5.0 ± 5.501	5.5.2 = 5.561	0.010 = 0.001	0.010 = 0.001	0.010 = 0.001

2.b.2. AIR PARTICULATES GAMMA ANALYSIS OF QUARTERLY COMPOSITES (pCi/m³)

Third Quarter, 2006

Sample Site	<u>Be-7</u>	<u>K-40</u>	<u>Cs-134</u>	<u>Cs-137</u>	<u>Pb-210</u>
T51	0.1045 ± 0.0101	<0.0147	<0.0013	<0.0009	0.0166 ± 0.0035
T57	0.1216 ± 0.0132	<0.0211	<0.0012	<0.0008	0.0123 ± 0.0051
T58	0.1303 ± 0.0147	<0.0210	<0.0018	<0.0014	<0.0473
T64	0.1429 ± 0.0165	<0.0277	<0.0018	<0.0009	<0.0556
T72	0.1693 ± 0.0136	<0.0264	<0.0019	<0.0013	<0.0514

3.a. SURFACE WATER - (pCi/L)

Sample <u>Site</u>	Collection <u>Date</u>	<u>H-3</u>	<u>K-40</u>	<u>Mn-54</u>	<u>Co-58</u>	Fe-59	<u>Co-60</u>	<u>Zn-65</u>	Zr-95 <u>Nb-95</u> (A)	<u>l-131</u>	<u>Cs-134</u>	<u>Cs-137</u>	Ba-140 <u>La-140</u> (B)
T42	12-Jul-06	<135	296 ± 23	<2	<2	<5	<3	<5	<4	<3	<3	<2	<4
	08-Aug-06	<140	314 ± 22	<2	<2	<5	<3	<5	<4	<4	<3	<2	<3
	13-Sep-06	<141	198 ± 29	<4	<3	<7	<4	<8	<6	<5	<4	<4	<6
T67	12-Jul-06	<135	287 ± 28	<4	<4	<7	<4	<7	<6	<5	<4	<3	<5
	08-Aug-06	<140	136 ± 22	<4	<4	<7	<4	<7	<6	<6	<4	<4	<5
	12-Sep-06	<141	241 ± 26	<3	<2	<6	<4	<6	<6	<5	<4	<3	<5
T81	12-Jul-06	310 ± 48	361 ± 17	<2	<2	<3	<2	<3	<3	<3	<2	<2	<2
	08-Aug-06	125 ± 46	326 ± 23	<2	<2	<5	<2	<5	<4	<4	<3	<2	<3
	12-Sep-06	<141	273 ± 25	<2	<3	<5	<3	<6	<6	<4	<4	<3	<5

⁽A) - These tabulated LLD values for Zr/Nb-95 are the higher of the individual parent or daughter LLDs.
(B) - These tabulated LLD values are for Ba-140, either based on direct measurement of Ba-140 or based on ingrowth of La-140, whichever method yields the greater sensitivity for a given sample.

3.b. SHORELINE SEDIMENT - (pCi/kg, dry weight)

Sample <u>Site</u>	Collection <u>Date</u>	<u>Be-7</u>	<u>K-40</u>	<u>Co-58</u>	<u>Co-60</u>	<u>Cs-134</u>	<u>Cs-137</u>	Pb-210	<u>Ra-226</u>	<u>Th-232</u>	<u>U-235</u>	<u>U-238</u>
T42	12-Jul-06	154 ± 44	<132	<8	<9	<10	<9	499 ± 231	631 ± 125	<43	49 ± 7	638 ± 216
T67	12-Jul-06	<73	111 ± 34	<6	<6	<7	<7	<373	355 ± 117	26 ± 8	<58	<283
T81	12-Jul-06	159 ± 31	264 ± 44	<7	<7	<8	<7	570 ± 155	782 ± 89	51 ± 11	56 ± 6	916 ± 152

4.a.1. CRUSTACEA - (pCi/kg, wet weight)

Sample <u>Site</u>	Collection <u>Date</u>	<u>K-40</u>	<u>Mn-54</u>	<u>Co-58</u>	<u>Fe-59</u>	<u>Co-60</u>	<u>Zn-65</u>	<u>Cs-134</u>	<u>Cs-137</u>	<u>Ra-226</u>	Ra-228	
T67	This samp	ole has not yet b	een collec	eted.								
T81	This samp	ole has not yet b	een collec	cted.								

4.a.2. FISH - (pCi/kg, wet weight)

Sample	Collection										
<u>Site</u>	Date	<u>K-40</u>	<u>Mn-54</u>	<u>Co-58</u>	<u>Fe-59</u>	<u>Co-60</u>	<u>Zn-65</u>	<u>Cs-134</u>	<u>Cs-137</u>	<u>Ra-226</u>	Ra-228
T67	This s	ample has n	ot yet bee	en collect	ed						
T81	This s	ample has n	ot yet bee	en collect	ed						

4.b. BROADLEAF VEGETATION - Brazilian Pepper - (pCi/kg, wet weight)

Sample Site	Collection Date	Be-7	<u>K-40</u>	<u>l-131</u>	<u>Cs-134</u>	<u>Cs-137</u>	Pb-210	Ra-226
T40	12-Jul-06	1660 ± 75	3284 ± 126	<16	<8	31 ± 5	<652	<194
	08-Aug-06	1192 ± 76	2564 ± 134	<15	<10	52 ± 6	<1558	360 ± 109
	12-Sep-06	2661 ± 109	2978 ± 175	<24	<15	35 ± 8	<2026	<309
T41	12-Jul-06	1701 ± 51	6282 ± 123	<11	. <9	<8	<499	<162
	08-Aug-06	1637 ± 114	6634 ± 286	<24	<20	23 ± 7	<2600	<365
	12-Sep-06	1669 ± 101	4805 ± 227	<23	<15	88 ± 8	<2299	<313
T67	12-Jul-06	1127 ± 63	3273 ± 121	<15	<10	<8	<571	<190
	08-Aug-06	1161 ± 87	3363 ± 139	<16	<11	<10	<711	<237
	12-Sep-06	1152 ± 66	3834 ± 151	<13	<12	<8	<624	<229

TURKEY POINT SITE

Offsite Dose Calculation Manual Specifications Sampling

Fourth Quarter, 2006

Sample Type	Collection Frequency	Locations Sampled	Number of <u>Samples</u>
1. Direct Radiation	Quarterly	22	22
2. Airborne			
2.a. Air Iodines	Weekly	5	65
2.b. Air Particulates	Weekly	5	65
3. Waterborne			•
3.a. Surface Water	Monthly	3	9
3.b. Shoreline Sediment	Semiannually	3	0
Ingestion 4.a. Fish and Invertebrates			
4.a.1. Crustacea	Semiannually	2	1
4.a.2. Fish	Semiannually	2	2
4.b. Broadleaf Vegetation	Monthly	3	9
			Total: 173

NOTE: Measurement results having magnitudes that are significantly above the background of the measurement system are reported as net values plus or minus a one-standard-deviation error term. Measurement results that are <u>not</u> significantly above background and with greater than a 50% error term are reported as less than a Lower Limit of Detection (<LLD), which is an estimated upper limit (with at least 95% confidence) for the true activity in the sample.

The marine fauna listed in this report were collected in part, under Florida FWC SAL030.

1. DIRECT RADIATION - TLDs - (µR/hour)

Sample Site	Deployment 13-Sep-06 Collection 06-Dec-06	Sample Site	Deployment 13-Sep-06 Collection 06-Dec-06
N-2	5.7 ± 0.4	WSW-8	4.8 ± 0.3
N-7	4.4 ± 0.3		
N-10	5.4 ± 0.3	SW-1	5.0 ± 0.3
		SW-8	5.4 ± 0.3
NNW-2	4.4 ± 0.3		
NNW-10	5.0 ± 0.3	SSW-5	4.8 ± 0.3
	•	SSW-10	4.9 ± 0.3
NW-1	6.3 ± 0.3		
NW-5	4.2 ± 0.3	S-5	4.9 ± 0.3
NW-10	7.2 ± 0.4	S-10	5.4 ± 0.4
WNW-10	5.8 ± 0.4	SSE-1	4.4 ± 0.2
		SSE-10	5.6 ± 0.6
W-1	5.9 ± 0.4		
W-5	4.6 ± 0.4	NNE-22	6.2 ± 0.3
W-9	3.9 ± 0.2		

2.a. IODINE-131 IN WEEKLY AIR CARTRIDGES - (pCi/m3)

Collection Date	T51	T57	T58	T64	T72
04-Oct-06	<0.02	<0.02	<0.02	<0.02	<0.02
11-Oct-06	<0.02	<0.03	<0.02	<0.02	<0.02
17-Oct-06	<0.01	<0.01	<0.01	<0.01	<0.01
24-Oct-06	<0.01	<0.01	<0.01	<0.01	<0.01
31-Oct-06	<0.02	<0.02	<0.02	<0.02	<0.02
07-Nov-06	<0.02	<0.02	<0.02	<0.02	<0.02
14-Nov-06	<0.02	<0.02(A)	<0.02	<0.02	< 0.02
21-Nov-06	<0.01	<0.04(B)	<0.01	<0.01	<0.01
28-Nov-06	<0.02	<0.02	<0.02	<0.02	<0.02
06-Dec-06	<0.02	<0.02	<0.02	<0.03	<0.03
13-Dec-06	<0.01(C)	<0.01	<0.01	<0.01	<0.01
19-Dec-06	<0.02	<0.03(D)	<0.01	<0.01	<0.01
27-Dec-06	<0.01	<0.01(E)	<0.01	<0.01	<0.01

⁽A) No power; GFI receptacle was reset; estimated run time 44.6 hours.

⁽B) No power; GFI receptacle was reset; pump replaced; estimated run time 19 hours.

⁽C) No power to the box; pump was still hot indicating power lost recently; experienced a normal run time of 172.417 hours; checked again on 12/15/06 at 1430 and estimated power was restored that morning at 0945.

⁽D) No power; GFI receptacle was reset; estimated run time 19 hours.

⁽E) No power; GFI receptacle was reset; estimated run time 158 hours.

2.b.1. AIR PARTICULATES - GROSS BETA - (pCi/m3)

Sample Sites

Collection Date	T51	T57	T58	T64	T72
04-Oct-06	0.014 ± 0.002	0.018 ± 0.002	0.015 ± 0.002	0.020 ± 0.002	0.019 ± 0.002
11-Oct-06	0.019 ± 0.002	0.017 ± 0.003	0.018 ± 0.002	0.018 ± 0.002	0.015 ± 0.002
17-Oct-06	0.019 ± 0.003	0.019 ± 0.002	0.021 ± 0.003	0.018 ± 0.002	0.021 ± 0.003
24-Oct-06	0.016 ± 0.002	0.017 ± 0.002	0.016 ± 0.002	0.020 ± 0.002	0.015 ± 0.002
31-Oct-06	0.025 ± 0.002	0.019 ± 0.002	0.024 ± 0.002	0.022 ± 0.002	0.022 ± 0.002
07-Nov-06	0.013 ± 0.002	0.015 ± 0.002	0.012 ± 0.002	0.015 ± 0.002	0.012 ± 0.002
14-Nov-06	0.025 ± 0.003	$0.015 \pm 0.006(A)$	0.021 ± 0.002	0.021 ± 0.002	0.029 ± 0.003
21-Nov-06	0.026 ± 0.003	$0.019 \pm 0.002(B)$	0.023 ± 0.003	0.024 ± 0.003	0.028 ± 0.003
28-Nov-06	0.008 ± 0.002	0.010 ± 0.002	0.009 ± 0.002	0.006 ± 0.002	0.013 ± 0.002
06-Dec-06	0.016 ± 0.002	0.013 ± 0.002	0.014 ± 0.002	0.014 ± 0.002	0.014 ± 0.002
13-Dec-06	$0.017 \pm 0.002(C)$	0.015 ± 0.002	0.019 ± 0.002	0.016 ± 0.002	0.016 ± 0.002
19-Dec-06	0.016 ± 0.003	0.006 ± 0.002(D)	0.007 ± 0.002	0.004 ± 0.002	0.006 ± 0.002
27-Dec-06	0.009 ± 0.002	$0.008 \pm 0.002(E)$	0.013 ± 0.002	0.014 ± 0.002	0.013 ± 0.002
Average:	0.017 ± 0.001	0.015 ± 0.001	0.016 ± 0.001	0.016 ± 0.001	0.017 ± 0.001

- (A) No power; GFI receptacle was reset; estimated run time 44.6 hours.
- (B) No power; GFI receptacle was reset; pump replaced; estimated run time 19 hours.
- (C) No power to the box; pump was still hot indicating power lost recently; experienced a normal run time of 172.417 hours; checked again on 12/15/06 at 1430 and estimated power was restored that morning at 0945.
- (D) No power; GFI receptacle was reset; estimated run time 19 hours.
- (E) No power; GFI receptacle was reset; estimated run time 158 hours.

2.b.2. AIR PARTICULATES - GAMMA ANALYSIS OF QUARTERLY COMPOSITES (pCi/m³)

Fourth Quarter, 2006

Sample Site	<u>Be-7</u>	<u>K-40</u>	<u>Cs-134</u>	<u>Cs-137</u>	Pb-210
T51	0.1807 ± 0.0123	<0.0181	<0.0009	<0.0010	0.0247 ± 0.0048
T57	0.2123 ± 0.0144	<0.0242	<0.0014	<0.0013	0.0357 ± 0.0047
T58	0.1971 ± 0.0155	<0.0274	<0.0017	<0.0013	<0.0562
T64	0.1980 ± 0.0127	<0.0186	<0.0010	<0.0009	0.0331 ± 0.0039
T72	0.2018 ± 0.0124	<0.0171	<0.0012	< 0.0007	0.0382 ± 0.0038

3.a. SURFACE WATER - (pCi/L)

Sample <u>Site</u>	Collection <u>Date</u>	<u>H-3</u>	<u>K-40</u>	<u>Mn-54</u>	<u>Co-58</u>	<u>Fe-59</u>	<u>Co-60</u>	<u>Zn-65</u>	Zr-95 <u>Nb-95</u> (A)	<u>l-131</u>	<u>Cs-134</u>	<u>Cs-137</u>	Ba-140 <u>La-140</u> (B)
T42	11-Oct-06	<146	214 ± 29	<3	<3	<7	<4	<9	<6	<5	<5	<4	<4
	14-Nov-06	<142	299 ± 31	<3	<4	<8	<4	<8	<5	<4	<3	<4	<7
	06-Dec-06	<143	254 ± 30	<4	<4	<6	<4	<7	<7	<5	<4	<4	<4
T67	11-Oct-06	<146	102 ± 29	<3	<4	<8	<4	<7	<6	<6	<4	<3	<6
	14-Nov-06	<142	93 ± 25	<4	<2	<7	<4	<9	<6	<5	<4	<3	<8
	05-Dec-06	<142	226 ± 29	<3	<3	<6	<4	<7	<6	<6	<4	<3	<3
T81	11-Oct-06	<146	264 ± 24	<2	<2	<5	<2	<4	<4	<3	<2	<2	<3
	14-Nov-06	<143	327 ± 45	<3	<3	<10	<5	<9	<9	<6	<6	<5	<7
	06-Dec-06	<143	285 ± 23	<2	<2	<4	<2	<4	<3	<3	<2	<2	<3

⁽A) - These tabulated LLD values for Zr/Nb-95 are the higher of the individual parent or daughter LLDs.

⁽B) - These tabulated LLD values are for Ba-140, either based on direct measurement of Ba-140 or based on ingrowth of La-140, whichever method yields the greater sensitivity for a given sample.

3.b. SHORELINE SEDIMENT - (pCi/kg, dry weight)

Sample Collection

Site Date Be-7 K-40 Co-58 Co-60 Cs-134 Cs-137 Pb-210 Ra-226 Th-232 U-238

These samples were previously collected.

4.a.1. CRUSTACEA - (pCi/kg, wet weight)

Sample	Collection										
<u>Site</u>	Date	<u>K-40</u>	<u>Mn-54</u>	<u>Co-58</u>	<u>Fe-59</u>	<u>Co-60</u>	<u>Zn-65</u>	<u>Cs-134</u>	<u>Cs-137</u>	Ra-226	Ra-228
T67	Unable to obta	ain any blue crab	s after nu	ımerous	attempts						
T81	31-Oct-06	2147 ± 201	<25	<32	<74	<32	<55	<30	<25	502 ± 220	<124

4.a.2. FISH - (pCi/kg, wet weight)

Sample	Collection										
<u>Site</u>	Date	<u>K-40</u>	<u>Mn-54</u>	<u>Co-58</u>	<u>Fe-59</u>	<u>Co-60</u>	<u>Zn-65</u>	<u>Cs-134</u>	<u>Cs-137</u>	Ra-226	Ra-228
T67	27-Oct-06	2325 ± 182	<18	<18	<61	<19	<39	<24	<16	<278	<66
T81	20-Oct-06	2602 ± 221	<24	<28	<66	<32	<66	<27	<27	<466	<115

4.b. BROADLEAF VEGETATION - Brazilian Pepper - (pCi/kg, wet weight)

Sample Site	Collection Date	Be-7	<u>K-40</u>	<u>l-131</u>	<u>Cs-134</u>	<u>Cs-137</u>	Pb-210	Pb-212	Ra-226
T40	11-Oct-06	1703 ± 46	3425 ± 90	<10	<8	36 ± 4	<962	<33	<145
	14-Nov-06	1429 ± 37	3915 ± 87	<9	<7	76 ± 4	<861	<28	<125
	06-Dec-06	1893 ± 47	3867 ± 98	<9	<7	29 ± 4	1337 ± 308	<33	<135
T41	11-Oct-06	1423 ± 87	4346 ± 206	<22	<19	<20	<2180	<79	<270
	14-Nov-06	1385 ± 90	5402 ± 207	<22	<14	32 ± 6	<1941	<69	393 ± 152
	06-Dec-06	1512 ± 97	3067 ± 168	<19	<15	34 ± 5	2264 ± 722	<70	<279
T67	11-Oct-06	2032 ± 41	3028 ± 62	<8	<5	23 ± 3	1161 ± 152	<35	<109
	14-Nov-06	1755 ± 36	3421 ± 60	<7	<4	36 ± 3	877 ± 154	<31	<100
	05-Dec-06	1563 ± 77	4342 ± 152	<19	<11	32 ± 6	<812	<82	<247

2006 ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT TURKEY POINT PLANT – UNITS 3 & 4

ATTACHMENT C

RESULTS FROM THE INTERLABORATORY

COMPARISON PROGRAM 2006

DEPARTMENT OF ENERGY

MAPEP 15, June 2006

MAPEP 16, December 2006

AND

2006 ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT TURKEY POINT PLANT – UNITS 3 & 4

427

DOF-MA		- חבטו	11 TC
I JL JH-1//A	PPP I	\ H = \ \	11 1 5

	Result	Ref.	Flag	Acceptance	
Radionuclide	Do/filtor	Value	(Evaluation)	Range	
Matrix: RdF Air Filter MN54	< MDA	None	Α	Not Applicable	
CO57	4.300	4.096	A	Not Applicable 2.87 – 5.32	
CO60					
	2.170	2.180	A	1.53 – 2.84	
ZN65 CS134	3.820	3.423	A	2.40 – 4.45	
	2.920	2.934	A	2.05 – 3.81	
CS137	2.580	2.531	A	1.77 – 3.29	
Am-241	0.100	0.093	A	0.07 – 0.12	
Pu-238	0.076	0.067	Α	0.05 - 0.09	
Matrix: GrF Air Filter E	3g/filter				
Gross Beta	0.444	0.481	Α	0.24 - 0.72	
Matrix: MaS Soil Bq/l	ka				
K40	601.47	604	Α	423 - 785	
MN54	348.23	346.77	Α	242.74 - 450.80	
CO57	669.5	656.29	Α	459.4 - 853.18	
CO60	428.93	447.1	Α	312.97 - 581.23	
ZN65	669.83	657.36	Α	460.15 - 854.57	
CS134	2.11	None	N		
CS137	335.37	339.69	Α	237.78 - 441.60	
U238	50.10	38.85	W	27.20 - 50.50	
AM241	59.02	57.08	Α	39.96 - 74.20	
Matrix: MaW Water I	3q/L				
H3	1039.3	952.01	Α	666.41 - 1,238	
MN54	328.47	315	Α	220.50 - 409.50	
CO57	162.17	166.12	Α	116.28 - 15.96	
CO60	154.50	153.5	Α	107.45 - 199.55	
ZN65	242.77	228.16	Α	159.71 - 296.61	
CS134	95.36	95.1	Α	66.57 - 123.63	
CS137	< MDA	None	Α	Not Applicable	
AM241	0.99	1.3	Α	0.91 - 1.69	
Matrix: RdV Vegetation	n Ba/sample				
MN54	5.76	6.247	Α	4.37 - 8.12	
CO57	8.89	8.578	A	6.00 - 11.15	
CO60	4.10	4.52	A	3.16 - 5.88	
ZN65	9.39	9.798	A	6.89 - 12.74	
CS134	< MDA	None	A	Not Applicable	
CS137	2.84	3.074	A	2.15 - 4.00	
Evaluation : A = Accep					
_ :					

2006 ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT **TURKEY POINT PLANT – UNITS 3 & 4**

DOE-MAPEP 16 RESULTS Result Ref. Acceptance Flag Radionuclide Value (Evaluation) Range Matrix: RdF Air Filter Bg/filter **MN54** 2.20 1.92 Α 1.10 - 2.05**CO57** 2.93 2.582 Α 1.81 - 3.36CO60 1.66 1.577 Α 1.10 - 2.05**ZN65** -0.0060 Α 0 ± 0.027 CS134 3.29 3.117 Α 2.20 - 4.09CS137 2.03 1.805 Α 1.26 - 2.35AM241 Α 0.10 - 0.190.16 0.142 Matrix: GrF Filter Bq/sample 0.39 0.18 - 0.54**Gross Beta** 0.359 Α Matrix: MaS Soil Bq/kg K40 622.13 604 423.00 - 785.00 Α **MN54** 625.4 594.25 Α 415.98 - 772.52 CO57 721.33 676.33 Α 473.43 - 879.23 CO60 2.698 1.98 Α None Listed **ZN65** 965.1 903.61 Α 632.53 - 1,175CS134 457.75 452.13 Α 316.49 - 587.77CS137 545.2 525.73 Α 368.01 - 683.45 Matrix: MaW Water Bq/L H3 469.59 428.85 Α 300.20 - 557.50**MN54** -0.05 0 Α 0 ± 0.11 CO57 212.2 213.08 Α 149.16 - 277.00CO60 48.54 33.20 - 61.8047.5 Α NI63 98.82 118.62 Α 83.03 - 154.21**ZN65** 190.9 176.37 Α 123.46 - 229.28**SR90** 17.7 15.69 Α 10.98 - 20.40CS134 113.57 112.82 Α 78.97 - 146.66CS137 202.80 196.14 Α 137.30 - 254.98Matrix: RdV Vegetation, Bq/sample: **MN54** 7.77 8.351 Α 5.85 - 10.86CO57 0.00 0 W 0 ± 0.01 CO60 5.26 5.806 Α 4.06 - 7.55**ZN65** 5.68 5.984 Α 4.19 - 7.78CS134 6.99 7.487 Α 5.24 - 9.73CS137 5.03 5.495 Α 3.85 - 7.14AM241 0.01 0 ± 0.03

Evaluation: A = Acceptable, W = Acceptable with Warning, N = Not Acceptable From the MAPEP handbook:

Acceptance criteria were developed from a review of precision and accuracy data compiled by other PEPs, the analytical methods literature, from several MAPEP pilot studies, and from what is considered reasonable. acceptable, and achievable for routine analyses among the more experienced laboratories.

74. . .