



**Luminant**

**Mike Blevins**  
Executive Vice President  
& Chief Nuclear Officer  
Mike.Blevins@Luminant.com

**Luminant Power**  
P O Box 1002  
6322 North FM 56  
Glen Rose, TX 76043

**T** 254 897 5209  
**C** 817 559 9085  
**F** 254 897 6652

CP-200800613  
Log # TXX-08073

Ref. # Tech. Spec. 5.6.2

April 24, 2008

U. S. Nuclear Regulatory Commission  
ATTN: Document Control Desk  
Washington, DC 20555

**SUBJECT: COMANCHE PEAK STEAM ELECTRIC STATION  
DOCKET NOS. 50-445 AND 50-446  
TRANSMITTAL OF YEAR 2007 RADIOLOGICAL ENVIRONMENTAL OPERATING  
REPORT**

Dear Sir or Madam:

Enclosed is the Annual Radiological Environmental Operating Report for the Comanche Peak Radiological Environmental Monitoring Program. This report is submitted pursuant to Section 5.6.2 of the Comanche Peak Units 1 and 2 Technical Specifications (Appendix A to Operating License Nos. NPF-87 and NPF-89). The report covers the period from January 1, 2007 through December 31, 2007 and summarizes the results of measurements and analysis of data obtained from samples collected during this interval.

If there are any questions regarding this report, please contact Bob Kidwell at (254) 897-5310 or Scott Bradley at (254) 897-5495.

Sincerely,

Luminant Generation Company LLC

Mike Blevins

By:

Fred W. Madden

Director, Oversight & Regulatory Affairs

A member of the STARS (Strategic Teaming and Resource Sharing) Alliance

Callaway · Comanche Peak · Diablo Canyon · Palo Verde · South Texas Project · Wolf Creek

LEAS  
NRR

Enclosure - Comanche Peak Annual Radiological Environmental Operating Report for 2007

c - E. E. Collins, Region IV  
B. K. Singal, NRR  
Resident Inspectors, Comanche Peak

**LUMINANT**  
**COMANCHE PEAK NUCLEAR POWER PLANT**

**ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING**  
**REPORT FOR 2007**

**JANUARY 1, 2007 through DECEMBER 31, 2007**

LUMINANT REVIEW and APPROVAL

CREATED BY: Bonnie Vaughan 3/31/08  
Bonnie Vaughan Date  
Radiation Protection Technician

REVIEWED BY: Andrew G. Caves 3/31/08  
Andrew Caves Date  
Sr. Nuclear Analyst

APPROVED BY: Scott E. Bradley 3/31/08  
Scott E. Bradley Date  
Health Physics Supervisor

# Table of Contents

<u>Section</u>	<u>Title</u>	
I.	Introduction	
A.	Site and Station Description	page 5
B.	Objectives and Overview of the CPNPP Radiological Environmental Monitoring Program	page 5
II.	Program Descriptions and Results	
A.	Sample Locations	page 7
	<u>Table 1 -- Comanche Peak Nuclear Power Plant Radiological Environmental Monitoring Program for 2007</u>	
	<u>Table 2 -- Key to Environmental Sampling Locations</u>	
B.	Direct Radiation Program	page 11
	Methods, Procedures and Result Summaries	
	Exceptions to the Program	
	<u>Table 3 -- 2007 Environmental Direct Radiation Results</u>	
	<u>Table 14 -- 2007 Environmental TLD Trend</u>	
C.	Airborne Program	page 15
	Methods, Procedures and Result Summaries	
	Exceptions to the Program	
	<u>Table 4 -- 2007 Environmental Airborne Particulate Gross Beta Results</u>	
	<u>Graph 1-- 2007 Environmental Air Sample Gross Beta Results – Maximum and Minimum</u>	
	<u>Table 5 -- 2007 Environmental Air Sample Iodine-131 Results</u>	
	<u>Table 6 -- 2007 Environmental Air Particulate Composite Gamma Isotopic Results</u>	

**D. Surface Water Program**

**page 22**

**Methods, Procedures and Result Summaries**

**Exceptions to the Program**

**Table 7 -- 2007 Environmental Surface Water Tritium and  
Gamma Isotopic Results**

**Graph 2-- 2007 Environmental Surface Water Tritium Results**

**E. Surface Drinking Water Program**

**page 26**

**Methods, Procedures and Result Summaries**

**Exceptions to the Program**

**Table 8 -- 2007 Environmental Surface Drinking Water Tritium,  
Gross Beta and Gamma Isotopic Results**

**Graph 3-- Squaw Creek Maximum Tritium Values**

**Graph 4-- 2007 Environmental Surface Drinking Water Tritium  
Results**

**Graph 5-- 2007 Environmental Surface Drinking Water Gross  
Beta Results**

**F. Groundwater Program**

**page 31**

**Methods, Procedures and Result Summaries**

**Exceptions to the Program**

**Table 9 -- 2007 Environmental Groundwater Tritium and Gamma  
Isotopic Results**

**G. Sediment Program**

**page 33**

**Methods, Procedures and Result Summaries**

**Exceptions to the Program**

**Table 10 -- 2007 Environmental Sediment Gamma Isotopic Results**

**H. Fish Program**

**page 35**

**Methods, Procedures and Result Summaries**

**Exceptions to the Program**

**Table 11 -- 2007 Environmental Fish Gamma Isotopic Results**

**I. Food Products Program** page 37

**Methods, Procedures and Result Summaries**

**Exceptions to the Program**

**Table 12 -- 2007 Environmental Food Products Gamma Isotopic Results**

**J. Broadleaf Program** page 39

**Methods, Procedures and Result Summaries**

**Exceptions to the Program**

**Table 13 -- 2007 Environmental Broadleaf Iodine-131 and Gamma Isotopic Results**

**K. Conclusions** page 41

**L. Inter Laboratory Comparison and Cross Check Program** page 41

**Appendix A Comanche Peak Nuclear Power Plant Land Use Census 2007**

page 44

## **I. Introduction**

Results of the Radiological Environmental Monitoring Program for the Comanche Peak Nuclear Power Plant (CPNPP) for the year 2007 are contained within this report. This report covers the period from January 1, 2007 through December 31, 2007 and summarizes the results of measurements and analysis of data obtained from environmental samples collected during this same timeframe.

### **A. Site and Station Description**

CPNPP consists of two pressurized water reactor units, each designed to operate at a power level of about 1150 megawatts (electrical). The Station is located on Squaw Creek reservoir in Somervell and Hood counties, about forty miles southwest of Fort Worth, Texas. Unit 1 received a low power operating license February 8, 1990 and achieved initial criticality on April 3, 1990. A full power license for Unit 1 was issued on April 17, 1990 and commercial operation was declared on August 13, 1990. Unit 2 achieved initial criticality on March 24, 1993 and synchronized to the electrical grid on April 9, 1993.

### **B. Objectives and Overviews of the CPNPP Radiological Environmental Monitoring Program**

The United States Nuclear Regulatory Commission (USNRC) regulations require that nuclear power plants be designed, constructed, and operated to keep levels of radioactive material in effluents to unrestricted areas as low as reasonably achievable (ALARA). To assure that these criteria are met, each license authorizing reactor operation includes technical specifications governing the release of radioactive effluents.

In-plant monitoring is used to assure that these predetermined release limits are not exceeded. However, as a precaution against unexpected and undefined processes that might allow undue accumulation of radioactivity in any sector of the environment, a program for monitoring the plant environs is also included.

Sampling locations were selected on the basis of local ecology, meteorology, physical characteristics of the region, and demographic and land use features of the site vicinity. The radiological environmental monitoring program was designed on the basis of the USNRC Branch Technical Position “An Acceptable Radiological Environmental Monitoring Program” on radiological environmental monitoring issued by the Radiological Assessment Branch, Revision 1 (November 1979), the CPSES Technical Specification “Comanche Peak Steam Electric Station Units 1 and 2 Technical Specifications” and the “CPSES Offsite Dose Calculation Manual” (ODCM).

In 2007, the Radiological Environmental Monitoring Program included the following:

- The measurement of ambient gamma radiation by thermoluminescent dosimetry;
- The determination of airborne gross beta, gamma emitters, and Iodine-131;
- The determination of tritium and gamma emitters in surface water;
- The determination of gross beta, tritium, Iodine-131, and gamma emitters in drinking water;
- The determination of tritium and gamma emitters in ground water;
- The determination of gamma emitters in sediment and fish;
- The determination of gamma emitters in food products and;
- The determination of gamma emitters and Iodine-131 in broadleaf vegetation.

The regulations governing the quantities of radioactivity in reactor effluents allow nuclear power plants to contribute, at most, only a small percentage increase above normal background radioactivity. Background levels at any one location are not constant but vary with time as they are influenced by external events such as cosmic ray bombardment, weapons test fallout, and seasonal variations. These levels also can vary spatially within relatively short distances reflecting variations in geological composition. To differentiate between background radiation levels and increases resulting from operation of CPNPP, the radiological surveys of the plant environs were divided into pre-operational and operational phases.

The pre-operational phase of the program provided a general characterization of the radiation levels and concentrations prevalent in these areas prior to plant operation along with an indication of the degree of natural variation to be expected. The operational phase of the program obtains data which, when considered along with the data obtained in the pre-operational phase, assists in the evaluation of the radiological impact of plant operation.

Pre-operational measurements were conducted at CPNPP from 1981 to 1989. These pre-operational measurements were performed to:

- Evaluate procedures, equipment, and techniques;
- Identify potentially important pathways to be monitored after plant operation;
- Measure background levels and the variations along potentially important pathways;
- Provide baseline data for statistical comparisons with future operational analytical results.



The operational Radiological Environmental Monitoring Program is conducted to:

- Verify that measurable concentrations of radioactive materials and levels of radiation are not higher than expected on the basis of the effluent measurements and modeling of the environmental exposure pathways;
- Verify the effectiveness of in-plant measures used for controlling the release of radioactive materials;
- Identify changes in the areas at and beyond the site boundary that may impact the principal pathways of exposure.

This report documents the seventeenth year of operational measurements and is submitted in accordance with the requirements of the CPSES Offsite Dose Calculation Manual, Part I, Administrative Control 6.9.1.3.

## II. Program Descriptions and Results

### A. Sample Locations

Within a radius of twenty miles of the CPNPP site there are seventy-two (72) sample locations included in the monitoring program for the year 2007. The number of sample points and the specific locations for the sample points were determined by considering locations where the highest off-site environmental concentrations have been predicted from plant effluent source terms, site hydrology, and site meteorological conditions. Other factors considered were applicable regulations, population distribution, and ease of access to sampling stations, availability of samples at desired locations, security and future program integrity. Additionally an annual land use census is conducted to identify changes in the areas surrounding the plant. If changes are identified that impact the principle pathways of exposure, appropriate changes to the radiological environmental monitoring program are implemented. A copy of the report "Comanche Peak Nuclear Power Plant Land Use Census 2007" is provided in Appendix A to this report.

Table 1 – Comanche Peak Nuclear Power Plant Radiological Environmental Monitoring Program for 2007 contains a brief outline of the current program. This table specifies the sample media type, the number of locations for each media type, the sector and distance identifier for each sample location, the sample frequency, the type of analysis required and the analytical frequency required.

Table 2 – Key To Environmental Sampling Locations provides a reference that links the sampling point designations used in procedures and forms to the appropriate physical sample location (sector and distance) and to the correct sample type. This cross-reference enhances the ability to review data and tie the data to the correct sample points and to ensure all samples are collected and analyzed as specified.

Currently there are no milk sample locations within ten miles of the CPNPP site and there are no milk sample locations within twenty miles that will participate in the environmental program. CPNPP already samples extra broadleaf locations as required due to no milk locations within the ten-mile radius therefore, no changes to the program are necessary. Milk sampling will be resumed if any future annual land use census determines a dairy has been established within the specified area.

**Table 1 – Comanche Peak Nuclear Power Plant Radiological Environmental Monitoring Program for 2007**

Media	Number of Locations	Identification by Sector and Distance (miles)	Sampling Frequency (a)	Analysis	Analytical Frequency (a)
Gamma Exposure	43	N-1.45; N-4.4; N-6.5; N-9.4; NNE-1.1; NNE-5.65; NE-1.7; NE-4.8; ENE-2.5; ENE-5.0; E-0.5; E-1.9; E-3.5; E-4.2; ESE-1.4; ESE-4.7; SE-1.3; SE-3.85; SE-4.6; SSE-1.3; SSE-4.4; SSE-4.5; S-1.5; S-4.2; SSW-1.1; SSW-4.4; SW-0.9; SW-4.8; SW-12.3; WSW-1.0; WSW-5.35; WSW-7.0; W-1.0; W-2.0; W-5.5; WNW-1.0; WNW-5.0; WNW-6.7; NW-1.0; NW-5.7; NW-9.9; NNW-1.35; NNW-4.6	Q, A	Thermoluminescent Dosimetry	Q, A
Air Particulate Air Iodine	8	N-9.4; E-3.5; SSE-4.5; SW-12.3; NW-1.0; N-1.45; SW/WSW-0.95; S/SSW-1.2	W	Gross Beta Gamma Isotopic Filter Gamma Isotopic Charcoal	W QC W
Surface Water	4	N-19.3; ESE-1.4; N-1.5; NE-7.4	M(b)	Gamma Isotopic Tritium	M QC
Surface Water/Drinking	2	NNW-0.1; N-9.9	M(c)	Gross Beta Gamma Isotopic Iodine-131 Tritium	M M M QC
Ground Water	5	SSE-4.6; W-1.2; WSW-0.1; N-9.8; N-1.45	Q	Gamma Isotopic Tritium	Q Q
Sediment	4	N-9.9; NNE-1.0; NE-7.4; SE-5.3	SA	Gamma Isotopic	SA
Fish	2	NNE-8.0; ENE-2.0	SA	Gamma Isotopic	SA
Food Products	1	ENE-9.0	MH	Gamma Isotopic Iodine-131	MH MH
Broadleaf Vegetation	3	N-1.45; SW-1.0; SW-13.5	M	Gamma Isotopic	M

(a) Frequency codes are: W-Weekly; M-Monthly; Q-Quarterly; QC-Quarterly Composite; MH-Monthly at Harvest; SA-Semiannual; A-Annual

(b) Surface water samples from Squaw Creek are monthly composites of weekly grab samples. Surface water samples from Lake Granbury are monthly grab samples.

(c) Surface water drinking samples are a monthly composite of weekly grab samples.

**Table 2**  
**Key To Environmental Sampling Locations**

<b>SAMPLING POINT</b>	<b>LOCATION (SECTOR-MILE)</b>	<b>SAMPLE TYPE*</b>	<b>SAMPLING POINT</b>	<b>LOCATION (SECTOR-MILE)</b>	<b>SAMPLE TYPE*</b>
A1	N-1.45	A	R29	SW-12.3	R
A2	N-9.4	A	R30	WSW-1.0	R
A3	E-3.5	A	R31	WSW-5.35	R
A4	SSE-4.5	A	R32	WSW-7.0	R
A5	S/SSW-1.2	A	R33	W-1.0	R
A6	SW-12.3	A	R34	W-2.0	R
A7	SW/WSW-0.95	A	R35	W-5.5	R
A8	NW-1.0	A	R36	WNW-1.0	R
R1	N-1.45	R	R37	WNW-5.0	R
R2	N-4.4	R	R38	WNW-6.7	R
R3	N-6.5	R	R39	NW-1.0	R
R4	N-9.4	R	R40	NW-5.7	R
R5	NNE-1.1	R	R41	NW-9.9	R
R6	NNE-5.65	R	R42	NNW-1.35	R
R7	NE-1.7	R	R43	NNW-4.6	R
R8	NE-4.8	R	SW1	N-1.5	SW
R9	ENE-2.5	R	SW2	N-9.9	SW/DW
R10	ENE-5.0	R	SW3	N-19.9	SW
R11	E-0.5	R	SW4	NE-7.4	SW
R12	E-1.9	R	SW5	ESE-1.4	SW
R13	E-3.5	R	SW6	NNW-0.1	SW/DW
R14	E-4.2	R	GW1	W-1.2	GW/DW
R15	ESE-1.4	R	GW2	WSW-0.1	GW/DW
R16	ESE-4.7	R	GW3	SSE-4.6	GW/DW
R17	SE-1.3	R	GW4	N-9.8	GW/DW
R18	SE-3.85	R	GW5	N-1.45	GW/DW
R19	SE-4.6	R	SS1	NNE-1.0	SS
R20	SSE-1.3	R	SS2	N-9.9	SS
R21	SSE-4.4	R	SS3	NE-7.4	SS
R22	SSE-4.5	R	SS4	SE-5.3	SS
R23	S-1.5	R	F1	ENE-2.0	F
R24	S-4.2	R	F2	NNE-8.0	F
R25	SSW-1.1	R	FP1	ENE-9.0	FP
R26	SSW-4.4	R	BL1	N-1.45	BL
R27	SW-0.9	R	BL2	SW-1.0	BL
R28	SW-4.8	R	BL3	SW-13.5	BL

**Sample Type\***

A – AIR SAMPLE

F – FISH

SS – SHORELINE SEDIMENT

SW – SURFACE WATER

DW – DRINKING WATER

GW – GROUND WATER

R – DIRECT RADIATION

FP – FOOD PRODUCT

BL – BROADLEAF VEGETATION

## B. Direct Radiation

Thermoluminescent dosimeters (TLDs) were used to determine the direct (ambient) radiation levels at the designated monitoring locations. The monitoring locations were chosen according to the criteria given in the USNRC Branch Technical Position on Radiation Monitoring (Revision 1, November 1979). The area around the station was divided into 16 radial sectors of 22-1/2 degrees each, corresponding to the cardinal points of the compass. TLDs were placed in each of these sectors. The thermoluminescent dosimeters were placed in two rings around the station. An inner ring was located as close as possible to the site boundary and an outer ring was located at a distance of 4 to 6 miles from the station. Eleven additional TLDs were located at points of special interest, including two control locations. For routine direct radiation measurements, two sets of the Panasonic CaSO<sub>4</sub>:Dy TLDs were used at each of the 43 monitoring locations. One set of TLDs was exchanged on a quarterly basis and a second set of TLDs was exchanged on a yearly basis. Additional sets of in-transit TLD's were used as control TLDs for the quarterly and annual TLDs.

The thermoluminescent dosimeters were processed on-site by CPNPP National Voluntary Laboratory Accreditation Program (NVLAP) Certified dosimetry personnel. Individual dosimeters were calibrated by exposure to an accurately known radiation field from a certified Cs-137 source. The year 2001 was the first year that CPNPP used the Panasonic TLD System to supply all the required direct radiation (ambient) monitoring. Dosimetry data for the year 2007 provided consistent results in support of the year 2001 dosimetry results previously obtained with the onsite dosimetry processing system.

D. C. Oakley's report "National Radiation Exposure in the United States", published in 1972, calculated a background radiation dose rate equivalent of 0.22 mr/day for the area surrounding Fort Worth, Texas. This calculated value varies widely with changes in location but represents an appropriate reference value to compare with actual measured TLD doses.

Using data from the pre-operational program for the two years prior to the startup of Unit 1, the quarterly TLDs averaged a calculated dose rate of 0.14 mr/day while the yearly TLDs averaged a calculated dose rate of 0.16 mr/day. The range of measured values from this same two-year period varied from a minimum of 0.11 mr/day to a maximum of 0.22 mr/day.

Table 3 – 2007 Environmental Direct Radiation Results contains the measured dose (mr) for each quarterly TLD from each of the 43 monitoring locations. The corresponding quarterly calculated dose rate (mr/day) values are listed as well. The statistical average doses (mr) and dose rate (mr/day) values for each set of quarterly TLDs is also displayed. Additionally, the table includes the total dose (mr) of all four quarters for each specific location. The table also includes the measured dose (mr) for

each annual TLD from each of the 43 monitoring locations. The corresponding annual calculated dose rate (mr/day) values are listed as well. The statistical annual average dose (mr) for the entire set of annual TLDs is reported along with the average dose rate (mr/day) for the entire set of annual TLDs.

**For the year 2007**, the statistical average dose rate of all the quarterly TLD's was **0.472** mr/day. The quarterly measured dose rates ranged from a minimum of **0.0061** mr/day to a maximum of **0.1042** mr/day. The statistical average dose rate of all the annual TLDs was **0.428** mr/day. The annual measured dose rates ranged from a minimum of **0.019** mr/day to a maximum of **0.242** mr/day. There was good agreement between the sum of the measured doses of the individual quarterly TLDs and the measured dose of the annual TLDs. The summation of the individual quarterly measured doses averaged **20.28** mr for all the forty three monitoring stations while the annual measured dose averaged **18.4** mr for all the monitoring stations.

Comparing the pre-operational data and operational data collected through the year 2007 did not produce any anomalies. The direct radiation dose data for 2007 was consistently lower than previous years of data during both the pre-operational program and the previous years of the operational program. The implementation of the Panasonic TLD system and the algorithms used to process the data from this new type TLDs accounts for the lower values as well as different type holders for the TLD's.

**During the year 2007, there were two exception to the Direct Radiation Program.**

All quarterly and annual TLDs were placed into the field at their proper locations and on the appropriate frequency. Collection of all TLDs occurred as specified with the exception of location R40 and R8.

For the second quarter of 2007, R40 was returned two days later and had a 99 day monitoring period and R8 was returned eleven days later and had a 110 day monitoring period.

For the third quarter of 2007 R8 had been placed in service eleven days late and only had a 71 day monitoring period.

These exceptions were due inclement weather and not being able to collect the TLD's at the scheduled time.

No abnormal quarterly results were obtained by either CPNPP or by the State of Texas, Bureau of Radiation Control.

**Table 3 -- 2007 Environmental Direct Radiation Results**  
(Units of mr dose and mr/day dose rate)

Location	1ST QTR Total	Average Mr/day	2ND QTR Total	Average mr/day	3RD QTR Total	Average mr/day	4TH QTR Total	Average mr/day	QTR Total	Annual Total	Average mr/day
N-1.45	3.900	0.0433	4.900	0.0505	3.900	0.0458	4.700	0.0516	17.4	15.9	0.0437
N-4.4	6.450	0.0717	6.750	0.0696	7.200	0.0851	7.200	0.0786	27.6	24.6	0.0678
N-6.5	5.300	0.0589	5.450	0.0562	4.800	0.0571	6.100	0.0670	21.65	20.6	0.0567
N-9.4	4.950	0.0550	4.900	0.0505	4.800	0.0571	6.000	0.0654	20.65	19.9	0.0547
NNE-1.1	0.550	0.0061	0.700	0.0072	0.900	0.0101	1.300	0.0143	3.45	3.3	0.0090
NNE-5.65	6.600	0.0733	5.800	0.0598	3.500	0.0411	6.100	0.0670	22.0	19.5	0.0537
NE-1.7	0.850	0.0094	0.600	0.0062	0.700	0.0077	1.300	0.0143	3.45	4.2	0.0116
NE-4.8	5.700	0.0633	6.650	0.0605	5.300	0.0746	6.900	0.0965	24.55	17.2	0.2423
ENE-2.5	7.050	0.0783	7.800	0.0804	6.500	0.0768	8.500	0.0934	29.85	24.1	0.0664
ENE-5.0	8.000	0.0889	9.450	0.0974	8.800	0.1042	9.500	0.1038	35.75	35.7	0.0982
E-0.5	6.600	0.0733	6.800	0.0701	6.300	0.0750	6.900	0.0753	26.6	26.9	0.0740
E-1.9	4.150	0.0461	3.350	0.0345	3.400	0.0405	4.000	0.0440	14.9	12.6	0.0346
E-3.5	8.400	0.0933	8.550	0.0881	8.700	0.1036	8.800	0.0967	34.45	33.4	0.0920
E-4.2	6.350	0.0706	6.750	0.0696	5.700	0.0679	7.200	0.0791	26.0	25.5	0.0702
ESE-1.4	4.000	0.0444	5.000	0.0515	5.000	0.0595	5.200	0.0566	19.2	16.8	0.0463
ESE-4.7	6.300	0.0700	6.650	0.0686	6.100	0.0726	6.900	0.0753	25.95	22.2	0.0610
SE-1.3	6.050	0.0672	5.900	0.0608	5.100	0.0607	7.300	0.0797	24.35	22.1	0.0607
SE-3.85	4.100	0.0456	5.100	0.0526	3.500	0.0411	4.400	0.0478	17.1	17.2	0.0474
SE-4.6	3.200	0.0356	4.050	0.0418	4.100	0.0488	4.500	0.0489	15.85	15.8	0.0435
SSE-1.3	4.800	0.0533	5.100	0.0526	4.500	0.0536	4.500	0.0489	18.9	18.8	0.0518
SSE-4.4	6.100	0.0678	6.150	0.0634	6.100	0.0720	6.200	0.0676	24.55	22.4	0.0616
SSE-4.5	4.700	0.0522	5.800	0.0598	5.100	0.0607	5.600	0.0615	21.2	19.9	0.0547
S-1.5	3.650	0.0406	3.050	0.0314	3.200	0.0381	4.200	0.0462	14.1	15.5	0.0426
S-4.2	4.500	0.0500	4.750	0.0490	3.700	0.0435	5.100	0.0555	18.05	16.6	0.0457
SSW-1.1	4.400	0.0489	5.300	0.0546	3.700	0.0435	5.800	0.0637	19.2	19.1	0.0525
SSW-4.8	4.450	0.0494	6.900	0.0711	5.600	0.0667	4.700	0.0516	21.65	18.9	0.0519
SW-0.9	4.300	0.0478	4.200	0.0433	4.900	0.0577	5.400	0.0588	18.8	18.2	0.0501
SW-4.8	4.950	0.0550	4.900	0.0505	3.700	0.0435	3.800	0.0412	17.35	14.8	0.0406
SW-12.3 Control	4.950	0.0550	5.450	0.0562	4.600	0.0548	5.300	0.0577	20.3	19.2	0.0529
WSW-1.0	6.700	0.0744	6.400	0.0660	5.000	0.0589	5.800	0.0637	23.9	18.6	0.0512
WSW-5.35	5.050	0.0561	5.150	0.0531	4.700	0.0560	6.000	0.0654	20.9	17.7	0.0486
WSW-7.0 Control	5.900	0.0656	6.450	0.0665	4.700	0.0554	7.200	0.0791	24.25	20.0	0.0550
W-1.0	3.650	0.0406	4.400	0.0454	2.800	0.0333	3.400	0.0368	14.25	9.1	0.0249
W-2.0	3.350	0.0372	3.200	0.0330	2.600	0.0310	2.600	0.0286	11.75	10.1	0.0278
W-5.5	4.050	0.0450	4.500	0.0464	2.300	0.0268	4.200	0.0456	15.05	14.4	0.0397
WNW-1.0	5.050	0.0561	7.200	0.0742	5.900	0.0696	6.700	0.0731	24.85	21.2	0.0583
WNW-5.0	5.500	0.0611	6.350	0.0655	3.600	0.0423	5.000	0.0549	20.45	19.7	0.0541
WNW-6.7	4.950	0.0550	5.900	0.0608	3.800	0.0446	5.700	0.0626	20.35	18.6	0.0511
NW-1.0	4.000	0.0444	4.400	0.0454	3.100	0.0369	4.800	0.0522	16.3	16.1	0.0442
NW-5.7	5.100	0.0567	5.900	0.0596	4.200	0.0494	6.800	0.0747	22.0	19.2	0.0529
NW-9.9	4.600	0.0511	4.950	0.0510	4.600	0.0542	5.900	0.0643	20.05	17.8	0.0490
NNW-1.35	1.150	0.0128	0.250	0.0026	2.000	0.0238	1.400	0.0154	4.8	0.7	0.0019
NNW-4.6	7.050	0.0783	6.600	0.0680	6.800	0.0810	7.700	0.0841	28.15	28.7	0.0789
<b>AVERAGES</b>	4.916	0.0546	5.312	0.0545	4.546	0.0541	5.502	0.0607	20.28	18.4	0.0553

Location	2001	2002	2003	2004	2005	2006	2007	% Diff 2007 to 2006	2001-2006 mR Avg	% Diff 2007 to Average
R1	19.55	16.75	19.60	18.9	20.1	18.85	15.85	-17%	18.96	-18%
R2	32.75	29.25	32.30	33.7	30.05	28.55	24.6	-15%	31.10	-23%
R3	22.65	19.60	24.15	23.2	23.25	21.1	20.6	-2%	22.33	-8%
R4	22.60	21.00	26.10	25.75	23.2	25.15	19.85	-24%	23.97	-19%
R5	N/A	15.40	19.05	21.9	4.95	6.9	3.25	-72%	13.64	-123%
R6	22.75	22.55	N/A	27.65	23.15	25.55	19.5	-27%	24.33	-22%
R7	17.40	16.95	18.25	18.7	8.4	5.4	4.2	-25%	14.18	-109%
R8	27.15	23.80	24.10	25.5	23.7	21.75	17.2	-23%	24.33	-34%
R9	35.90	28.50	30.30	32.6	29.2	25.65	24.1	-6%	30.36	-23%
R10	41.85	36.20	41.90	41	36	40.6	35.65	-13%	39.59	-10%
R11	29.80	22.75	26.15	29.45	25.65	29.5	26.85	-9%	27.22	-1%
R12	13.05	9.15	10.20	33.8	16	14.9	12.55	-17%	16.18	-25%
R13	39.90	31.30	55.40	37.25	35.25	36.85	33.4	-10%	39.33	-16%
R14	33.75	27.60	29.15	32.45	27.3	27.35	25.5	-7%	29.60	-15%
R15	21.30	16.95	20.55	21.5	17	21.5	16.8	-25%	19.80	-16%
R16	32.05	25.40	28.35	28.55	28.4	27.05	22.15	-20%	28.30	-24%
R17	28.25	27.00	29.45	31.3	28.85	28.1	22.05	-24%	28.83	-27%
R18	17.85	15.70	19.75	19.35	17.2	20.95	17.2	-20%	18.47	-7%
R19	20.25	21.70	21.85	20.7	18.95	18.75	15.8	-17%	20.37	-25%
R20	21.70	16.75	18.25	22.65	17.9	19.75	18.8	-5%	19.50	-4%
R21	21.75	21.15	25.15	24.25	22.15	23.25	22.35	-4%	22.95	-3%
R22	20.15	17.75	21.50	22	18.25	23.8	19.85	-18%	20.58	-4%
R23	17.95	18.95	16.60	18.85	17.3	16.85	15.45	-9%	17.75	-14%
R24	18.10	17.55	21.10	25.45	19.85	19.85	16.6	-18%	20.32	-20%
R25	17.20	19.00	17.30	19.5	22.65	23.35	19.05	-20%	19.83	-4%
R26	23.50	25.80	N/A	20.5	18.7	21.15	18.85	-12%	21.93	-15%
R27	N/A	22.30	18.50	22.55	16.15	19.35	18.2	-6%	19.77	-8%
R28	18.05	16.20	20.85	14	15.6	4.35	14.75	109%	14.84	-1%
R29	21.50	21.75	24.10	24.4	22.2	21.2	19.2	-10%	22.53	-16%
R30	N/A	25.45	22.45	28.35	23.3	25.05	18.6	-30%	24.92	-29%
R31	19.75	18.70	23.05	24.7	20.55	21.2	17.65	-18%	21.33	-19%
R32	22.20	25.60	26.65	25.1	27.8	27.45	19.95	-32%	25.80	-26%
R33	10.15	13.10	13.40	14.75	13.75	13.75	9.05	-41%	13.15	-37%
R34	21.15	11.90	13.70	13.9	13.4	14.85	10.1	-38%	14.82	-38%
R35	18.45	14.65	18.00	17.95	19.4	16.1	14.4	-11%	17.43	-19%
R36	24.95	25.50	25.60	28.55	26.5	26.2	21.15	-21%	26.22	-21%
R37	21.35	22.85	23.45	22.95	24.15	24.55	19.65	-22%	23.22	-17%
R38	22.00	21.10	23.65	23.1	20.1	22.95	18.55	-21%	22.15	-18%
R39	17.45	19.20	21.35	24.2	16.95	19.5	16.05	-19%	19.78	-21%
R40	23.75	19.20	23.45	20.9	24.45	22.6	19.2	-16%	22.39	-15%
R41	17.15	14.95	17.35	19.65	17.7	18.15	17.8	-2%	17.49	2%
R42	2.05	5.20	6.70	5.95	1.35	8	0.7	-168%	4.88	-150%
R43	29.45	23.95	30.40	30.9	24.95	28.1	28.65	2%	27.96	2%

R5 - All reading low, elements could have been wet  
R7 - All reading low, elements could have been wet  
R12 - Anomalous reading from 2004  
R28 - Missing 2nd issue (4/21/06 - 12/29/06)  
R42 - Location consistently low - bad statistics this low

Legend:

< 50% Lower
> 25% Higher



### C. Airborne Program

Air particulate and air iodine samples were collected each week from the eight monitoring locations described in Table 1 – Comanche Peak Nuclear Power Plant Radiological Monitoring Program for 2007. Each air particulate sample was collected by drawing air through a 47 millimeter-diameter glass-fiber filter. Air iodine was collected by drawing air through a TEDA impregnated charcoal cartridge which was connected in series behind the air particulate filter. Shipped to an independent laboratory, air particulate filters were analyzed weekly for gross beta activity and were composited quarterly for gamma spectrometry analysis. Charcoal cartridges were analyzed weekly for Iodine-131.

**For the year 2007**, a total of 416 air particulate filters were collected and analyzed for gross beta activity. The reported gross beta activity ranged from a minimum value of **2.90E-03 pCi/m<sup>3</sup>** to a maximum value of **1.01E-01 pCi/m<sup>3</sup>**. Table 4 – 2007 Environmental Airborne Particulate Gross Beta Results contains the reported values of all samples. There were no anomalies noted in the data reported for 2007 when compared to pre-operational and previous operational data. Graph 1 – 2007 Environmental Air Sample Gross Beta Results – Maximum and Minimum trends the weekly high and low gross beta values to show the seasonal variation of the results as well as providing indication of consistency between the individual monitoring locations.

A total of 416 charcoal cartridges were analyzed for airborne Iodine-131. **No Iodine-131 was detected** at any of the eight monitoring locations. Table 5 – 2007 Environmental Air Sample Iodine-131 Results contains the reported values of each Iodine-131 analysis, all of which are less than the required lower limit of detection (LLD).

All air particulate filters were collected and composited quarterly and then analyzed by gamma spectrometry. The gamma isotopic data is presented in Table 6 – 2007 Environmental Air Particulate Composite Gamma Isotopic Results. Typical of pre-operational and previous operational data results, the only radioactive nuclide identified in all the samples was cosmogenic Beryllium-7, a naturally occurring isotope.

During October 2007, CPNPP was notified by Areva NP Lab that gross beta data for air sample location A-7 was trending up. SMF-2007-002933 was created to document the event. EVAL-2007-002933-01 determined that this does not classify as an exception. Investigation shows that we have not reached a point where gamma spec is required per ODCM Table 3.12-1; notation 4. The levels reported were found to be normal cyclic events.

**During the year 2007 there were three exceptions to the Airborne Program.**

On sample collection date 2/27/07, Station A-7 and A-5 were found not running due to a windstorm that caused an interruption of power on a 25KV line. Smart form 2007-000682 was written. LLD for these samples was not met.

On sample collection date 7/3/07, Station A-1 was found not running due to a ground fault trip. Smart Form 2007-002128 was written. LLD for Station A-1 was not met.

On Sample collection date 7/31/07 Station A-1 was found not running due to a ground fault trip. Smart Form 2007-002376 was written. LLD for this sample was not met.

A review of all the State of Texas air sample data indicated no anomalies.

**Table 4 -- 2007 Environmental Airborne Particulate Gross Beta Results  
(Units of pCi/m3)**

Date	Location NW-1.0	SW/WSW-0.95	S/SSW-1.2	SW-12.3 Control	SSE-4.5	E-3.5	N-1.45	N-9.4 Control
01/02/2007	1.75E-02	2.59E-02	1.67E-02	2.60E-02	2.44E-02	2.55E-02	2.31E-02	2.71E-02
01/09/2007	2.67E-02	3.32E-02	2.61E-02	3.50E-02	3.20E-02	3.37E-02	2.76E-02	3.85E-02
01/16/2007	2.75E-02	1.85E-02	1.52E-02	2.76E-02	2.66E-02	3.38E-02	2.64E-02	3.47E-02
01/23/2007	3.98E-02	4.11E-02	4.41E-02	4.63E-02	4.13E-02	4.66E-02	4.46E-02	5.47E-02
01/30/2007	3.56E-02	4.33E-02	3.77E-02	3.98E-02	3.57E-02	3.43E-02	3.53E-02	4.85E-02
02/06/2007	3.21E-02	3.95E-02	3.78E-02	4.02E-02	3.05E-02	3.77E-02	3.46E-02	4.90E-02
02/13/2007	3.32E-02	4.18E-02	3.97E-02	4.43E-02	4.35E-02	4.50E-02	3.78E-02	4.96E-02
02/20/2007	1.60E-02	2.81E-02	2.39E-02	3.19E-02	3.17E-02	2.75E-02	2.81E-02	3.63E-02
02/27/2007	1.65E-02	2.85E-02	2.02E-02	3.27E-02	2.58E-02	2.23E-02	2.99E-02	3.17E-02
03/06/2007	2.61E-02	3.03E-02	2.33E-02	3.10E-02	2.48E-02	3.01E-02	3.36E-02	3.13E-02
03/13/2007	2.90E-03	4.04E-02	2.90E-02	3.73E-02	4.02E-02	3.07E-02	3.46E-02	3.09E-02
03/20/2007	2.51E-02	3.02E-02	1.79E-02	3.24E-02	2.90E-02	2.33E-02	3.14E-02	2.57E-02
03/27/2007	1.84e-02	2.42e-02	1.68e-02	1.98e-02	1.98e-02	1.98e-02	2.43e-02	2.11e-02
04/03/2007	1.98e-02	2.72e-02	1.6e-02	1.86e-02	1.85e-02	1.75e-02	2.34e-02	2.22e-02
04/10/2007	2.63e-02	3.52e-02	2.68e-02	3.32e-02	2.98e-02	2.61e-02	4.02e-02	3.12e-02
04/17/2007	1.73e-02	2.28e-02	2.0e-02	2.57e-02	1.75e-02	1.7e-02	2.81e-02	2.51e-02
04/24/2007	2.98e-02	3.2e-02	2.12e-02	2.73e-02	2.66e-02	2.09e-02	3.19e-02	2.83e-02
05/01/2007	2.12e-02	2.5e-02	1.72e-02	2.03e-02	2.36e-02	1.67e-02	2.88e-02	1.94e-02
05/08/2007	1.45e-02	1.94e-02	1.31e-02	1.63e-02	1.6e-02	1.66e-02	2.37e-02	2.17e-02
05/15/2007	1.48e-02	2.87e-02	2.31e-02	2.06e-02	1.85e-02	1.5e-02	2.22e-02	2.68e-02
05/22/2007	1.9e-02	3.32e-02	3.05e-02	2.95e-02	2.92e-02	2.58e-02	3.42e-02	2.75e-02
05/29/2007	1.37e-02	1.93e-02	2.19e-02	2.23e-02	1.61e-02	1.74e-02	2.14e-02	1.93e-02
06/05/2007	1.29e-02	2.17e-02	1.4e-02	1.71e-02	1.67e-02	1.16e-02	1.99e-02	1.72e-02
06/12/2007	2.89e-02	4.04e-02	2.75e-02	3.14e-02	3.8e-02	2.83e-02	3.66e-02	3.96e-02
06/19/2007	1.65e-02	2.13e-02	2.02e-02	2.36e-02	1.95e-02	1.61e-02	2.63e-02	2.37e-02
06/26/2007	2.16e-02	2.39e-02	2.61e-02	2.42e-02	3.15e-02	2.28e-02	2.64e-02	2.29e-02
07/03/2007	1.63e-02	1.75e-02	1.66e-02	2.23e-02	2.04e-02	1.65e-02	2.13e-02	1.74e-02
07/10/2007	2.37e-02	2.62e-02	1.86e-02	1.89e-02	2.18e-02	1.58e-02	2.54e-02	2.4e-02
07/17/2007	1.35e-02	1.37e-02	1.19e-02	1.41e-02	1.41e-02	1.17e-02	1.46e-02	1.39e-02
07/24/2007	1.81e-02	3.47e-02	1.83e-02	1.84e-02	1.33e-02	1.77e-02	1.53e-02	1.38e-02
07/31/2007	2.54e-02	4.01e-02	1.88e-02	2.76e-02	1.87e-02	2.24e-02	3.65e-02	2.22e-02
08/07/2007	3.24e-02	5.07e-02	2.49e-02	2.42e-02	2.03e-02	2.4e-02	2.59e-02	2.56e-02
08/14/2007	4.21e-02	8.7e-02	4.19e-02	4.77e-02	3.91e-02	4.51e-02	4.5e-02	4.05e-02
08/21/2007	3.28e-02	6.71e-02	3.8e-02	3.08e-02	3.53e-02	3.02e-02	3.62e-02	3.29e-02
08/28/2007	1.38e-02	3.01e-02	1.62e-02	1.66e-02	1.54e-02	1.37e-02	1.18e-02	1.39e-02
09/04/2007	4.06e-02	7.87e-02	3.83e-02	4.2e-02	3.03e-02	3.84e-02	3.89e-02	3.97e-02
09/11/2007	1.73e-02	3.0e-02	1.33e-02	1.64e-02	1.82e-02	1.68e-02	1.31e-02	1.98e-02
09/18/2007	4.48e-02	9.38e-02	4.76e-02	4.91e-02	4.46e-02	5.29e-02	4.78e-02	4.57e-02
09/25/2007	6.1e-02	1.01e-01	5.03e-02	5.72e-02	4.83e-02	5.43e-02	5.09e-02	5.05e-02
10/02/2007	3.1e-02	4.83e-02	2.69e-02	2.6e-02	2.34e-02	2.47e-02	2.75e-02	2.29e-02
10/09/2007	2.95e-02	5.5e-02	2.82e-02	2.84e-02	2.77e-02	3.25e-02	2.73e-02	2.86e-02
10/16/2007	4.76e-02	8.0e-02	4.32e-02	4.31e-02	3.27e-02	4.08e-02	3.59e-02	4.09e-02
10/23/2007	2.61e-02	2.72e-02	2.5e-02	2.78e-02	2.23e-02	3.33e-02	3.19e-02	2.72e-02
10/30/2007	2.93e-02	2.95e-02	3.12e-02	3.53e-02	2.13e-02	3.4e-02	3.12e-02	3.36e-02
11/06/2007	7.3e-02	7.06e-02	6.4e-02	8.67e-02	6.52e-02	7.36e-02	6.98e-02	6.77e-02
11/13/2007	5.51e-02	5.36e-02	4.95e-02	6.28e-02	4.76e-02	5.64e-02	5.14e-02	5.25e-02
11/20/2007	3.52e-02	3.82e-02	3.26e-02	3.68e-02	3.08e-02	3.63e-02	3.79e-02	3.36e-02
11/27/2007	3.87e-02	3.47e-02	3.61e-02	4.39e-02	3.62e-02	3.8e-02	4.18e-02	4.05e-02
12/04/2007	6.22e-02	6.02e-02	6.24e-02	6.64e-02	4.87e-02	5.68e-02	6.43e-02	5.91e-02
12/11/2007	5.07e-02	4.99e-02	4.73e-02	5.52e-02	4.18e-02	5.28e-02	5.27e-02	5.07e-02
12/18/2007	4.54e-02	3.42e-02	3.53e-02	4.6e-02	3.1e-02	3.92e-02	4.04e-02	4.34e-02
12/25/2007	5.32e-02	4.89e-02	4.13e-02	5.16e-02	4.48e-02	5.19e-02	4.63e-02	4.79e-02

Required LLD's 1.00E-02

Graph 1 -- 2007 Environmental Air Sample  
Gross Beta Results - Maximum and Minimum

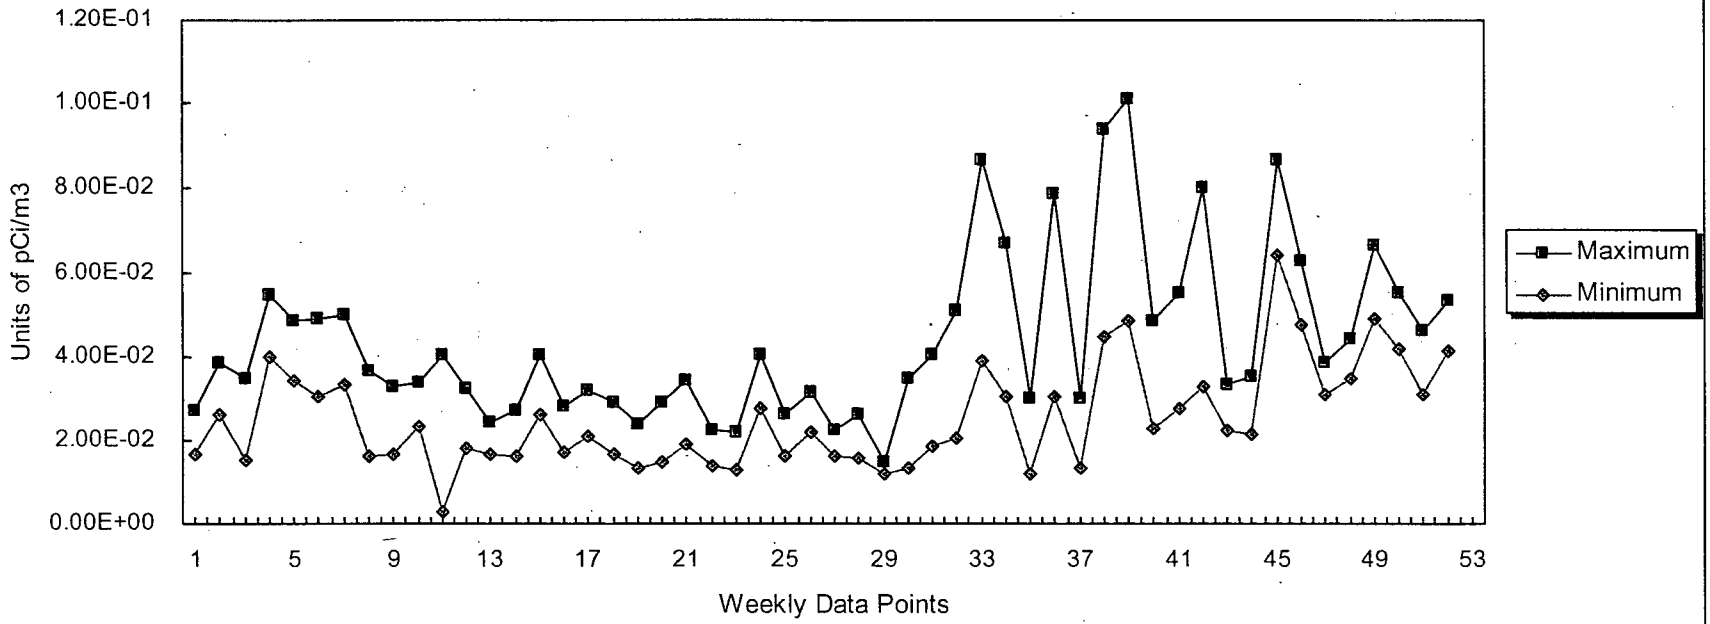


Table 5 -- 2007 Environmental Air Sample Iodine-131 Results  
(Units of pCi/m3)

Date	NW-1.0	SW/WSW-0.95	S/SSW-1.2	SW-12.3 Control	SSE-4.5	E-3.5	N-1.45	N-9.4 Control
01/02/2007	<4.8e-02	<4.6e-02	<4.2e-02	<4.2e-02	<4.4e-02	<4.2e-02	<5.1e-02	<3.5e-02
01/09/2007	<4.8e-02	<4.1e-02	<4.9e-02	<4.5e-02	<3.7e-02	<4.0e-02	<4.4e-02	<4.1e-02
01/16/2007	<3.1e-02	<4.0e-02	<4.7e-02	<3.6e-02	<3.8e-02	<4.1e-02	<4.1e-02	<4.7e-02
01/23/2007	<3.4e-02	<6.0e-02	<4.9e-02	<4.1e-02	<4.6e-02	<4.1e-02	<4.5e-02	<4.4e-02
01/30/2007	<5.4e-02	<5.2e-02	<6.3e-02	<6.7e-02	<5.9e-02	<6.3e-02	<6.7e-02	<5.1e-02
02/06/2007	<5.5e-02	<3.9e-02	<4.3e-02	<3.2e-02	<4.3e-02	<3.7e-02	<4.3e-02	<3.9e-02
02/13/2007	<3.8e-02	<4.6e-02	<4.3e-02	<4.0e-02	<4.4e-02	<5.1e-02	<4.3e-02	<4.1e-02
02/20/2007	<3.7e-02	<4.1e-02	<3.8e-02	<5.7e-02	<3.0e-02	<3.8e-02	<5.5e-02	<4.9e-02
02/27/2007	<4.0e-02	<6.4e-02	<6.4e-02	<3.1e-02	<3.6e-02	<4.2e-02	<4.0e-02	<3.5e-02
03/06/2007	<4.2e-02	<4.7e-02	<5.0e-02	<5.2e-02	<4.7e-02	<4.4e-02	<5.3e-02	<4.1e-02
03/13/2007	<5.5e-02	<4.4e-02	<4.0e-02	<4.4e-02	<4.4e-02	<4.3e-02	<3.7e-02	<4.6e-02
03/20/2007	<4.1e-02	<3.8e-02	<3.3e-02	<4.0e-02	<3.2e-02	<4.1e-02	<3.4e-02	<3.7e-02
03/27/2007	<3.8e-02	<3.8e-02	<3.8e-02	<4.0e-02	<4.2e-02	<5.0e-02	<5.0e-02	<4.4e-02
04/03/2007	<3.4e-02	<4.1e-02	<3.7e-02	<3.9e-02	<4.4e-02	<4.3e-02	<3.7e-02	<3.9e-02
04/10/2007	<4.4e-02	<4.3e-02	<4.3e-02	<3.8e-02	<4.1e-02	<3.8e-02	<5.8e-02	<3.3e-02
04/17/2007	<4.8e-02	<4.4e-02	<4.6e-02	<3.6e-02	<2.7e-02	<5.1e-02	<4.3e-02	<4.5e-02
04/24/2007	<4.1e-02	<5.2e-02	<3.0e-02	<3.9e-02	<4.8e-02	<4.0e-02	<3.3e-02	<4.7e-02
05/01/2007	<5.0e-02	<6.0e-02	<5.5e-02	<6.0e-02	<6.0e-02	<4.8e-02	<4.8e-02	<4.2e-02
05/08/2007	<4.8e-02	<4.5e-02	<4.3e-02	<3.0e-02	<3.6e-02	<4.9e-02	<5.5e-02	<3.9e-02
05/15/2007	<3.5e-02	<4.4e-02	<4.5e-02	<4.9e-02	<5.0e-02	<4.1e-02	<4.4e-02	<3.2e-02
05/22/2007	<4.4e-02	<3.4e-02	<4.7e-02	<4.3e-02	<4.6e-02	<4.0e-02	<3.8e-02	<3.0e-02
05/29/2007	<4.7e-02	<4.1e-02	<3.8e-02	<3.6e-02	<3.9e-02	<3.6e-02	<2.9e-02	<4.1e-02
06/05/2007	<4.4e-02	<4.1e-02	<4.3e-02	<4.4e-02	<4.1e-02	<4.4e-02	<4.1e-02	<4.3e-02
06/12/2007	<3.7e-02	<3.9e-02	<2.6e-02	<5.0e-02	<3.3e-02	<4.1e-02	<5.1e-02	<3.7e-02
06/19/2007	<5.2e-02	<4.3e-02	<4.5e-02	<4.9e-02	<4.0e-02	<4.9e-02	<3.6e-02	<3.0e-02
06/26/2007	<6.1e-02	<6.4e-02	<5.7e-02	<5.7e-02	<3.9e-02	<3.5e-02	<5.7e-02	<5.1e-02
07/03/2007	<6.1e-02	<7.0e-02	<6.8e-02	<6.8e-02	<6.1e-02	<5.1e-02	<4.5e-02	<4.6e-02
07/10/2007	<5.1e-02	<5.8e-02	<5.8e-02	<5.3e-02	<5.3e-02	<6.0e-02	<6.9e-02	<4.8e-02
07/17/2007	<3.7e-02	<3.5e-02	<4.0e-02	<3.7e-02	<4.2e-02	<4.1e-02	<4.4e-02	<4.1e-02
07/24/2007	<6.2e-02	<5.9e-02	<5.7e-02	<5.1e-02	<5.9e-02	<5.5e-02	<5.5e-02	<3.8e-02
07/31/2007	<5.9e-02	<5.5e-02	<5.1e-02	<6.6e-02	<6.6e-02	<6.9e-02	<5.6e-02	<4.1e-02
08/07/2007	<4.8e-02	<3.0e-02	<4.1e-02	<4.3e-02	<3.7e-02	<3.7e-02	<5.1e-02	<4.3e-02
08/14/2007	<4.0e-02	<4.0e-02	<3.8e-02	<3.8e-02	<3.7e-02	<3.7e-02	<3.5e-02	<4.5e-02
08/21/2007	<3.3e-02	<4.0e-02	<3.8e-02	<3.3e-02	<3.8e-02	<4.6e-02	<4.4e-02	<3.7e-02
08/28/2007	<4.5e-02	<4.3e-02	<4.3e-02	<4.1e-02	<4.4e-02	<4.0e-02	<4.0e-02	<3.0e-02
09/04/2007	<5.9e-02	<5.0e-02	<4.1e-02	<5.0e-02	<6.0e-02	<5.5e-02	<6.4e-02	<5.3e-02
09/11/2007	<4.0e-02	<4.2e-02	<3.6e-02	<3.9e-02	<4.3e-02	<3.4e-02	<3.7e-02	<4.0e-02
09/18/2007	<5.4e-02	<4.3e-02	<5.5e-02	<5.0e-02	<5.0e-02	<3.9e-02	<4.1e-02	<5.4e-02
09/25/2007	<5.4e-02	<6.5e-02	<6.9e-02	<5.3e-02	<6.5e-02	<5.0e-02	<6.5e-02	<6.9e-02
10/02/2007	<5.6e-02	<5.4e-02	<6.7e-02	<6.6e-02	<5.9e-02	<5.7e-02	<5.5e-02	<4.8e-02
10/09/2007	<4.0e-02	<4.8e-02	<4.6e-02	<5.4e-02	<5.1e-02	<4.5e-02	<4.6e-02	<4.5e-02
10/16/2007	<4.4e-02	<3.7e-02	<3.6e-02	<3.8e-02	<3.6e-02	<3.4e-02	<3.7e-02	<4.0e-02
10/23/2007	<3.7e-02	<3.7e-02	<5.0e-02	<4.8e-02	<3.7e-02	<4.1e-02	<4.7e-02	<3.7e-02
10/30/2007	<5.9e-02	<5.7e-02	<5.5e-02	<5.7e-02	<6.2e-02	<6.6e-02	<6.6e-02	<6.2e-02
11/06/2007	<6.2e-02	<5.5e-02	<4.3e-02	<5.0e-02	<5.1e-02	<4.8e-02	<3.9e-02	<5.4e-02
11/13/2007	<6.0e-02	<5.6e-02	<4.1e-02	<5.1e-02	<4.4e-02	<3.7e-02	<4.7e-02	<6.1e-02
11/20/2007	<5.5e-02	<6.1e-02	<6.3e-02	<4.6e-02	<4.6e-02	<6.1e-02	<6.4e-02	<6.1e-02
11/27/2007	<4.2E-02	<4.2E-02	<5.0E-02	<4.1E-02	<4.2E-02	<4.2E-02	<4.4E-02	<4.9E-02
12/04/2007	<5.6e-02	<5.1e-02	<5.4e-02	<4.3e-02	<4.8e-02	<4.8e-02	<4.9e-02	<5.2e-02
12/11/2007	<6.6e-02	<6.4e-02	<5.6e-02	<6.9e-02	<6.4e-02	<6.8e-02	<5.6e-02	<6.6e-02
12/18/2007	<5.0e-02	<5.1e-02	<5.5e-02	<6.8e-02	<5.9e-02	<6.1e-02	<5.1e-02	<5.3e-02
12/25/2007	<6.5e-02	<5.7e-02	<6.6e-02	<6.0e-02	<5.6e-02	<6.0e-02	<5.3e-02	<4.9e-02

Required LLD 7.00E-02

**Table 6 -- 2007 Environmental Air Particulate Composite Gamma Isotopic Results  
(Units of pCi/m3)**

	Location	NW-1.0	SW/WSW-0.95	SSW-1.2	SW-12.3	SSE-4.5	E-3.5	N-1.45	N-9.4		
	Nuclides				Control				Control		
Composite Dates 1ST QTR 01/02/07-03/27/07	Ba-140	<6.2e-02	<7.0e-02	<7.1e-02	<5.3e-02	<7.7e-02	<8.7e-02	<2.6e-02	<8.3e-02		
	Be-7	<b>1.37e-01</b>	<b>1.66e-01</b>	<b>1.38e-01</b>	<b>1.67e-01</b>	<b>1.19e-01</b>	<b>1.52e-01</b>	<b>1.69e-01</b>	<b>2.07e-01</b>		
	Co-57	<8.5e-04	<7.3e-04	<8.5e-04	<7.3e-04	<9.0e-04	<7.2e-04	<8.2e-04	<8.9e-04		
	Co-58	<3.0e-03	<2.6e-03	<4.1e-03	<3.3e-03	<3.8e-03	<2.5e-03	<3.6e-03	<2.9e-03		
	Co-60	<1.8e-03	<2.6e-03	<3.5e-03	<1.7e-03	<3.4e-03	<2.9e-03	<3.6e-03	<1.9e-03		
	Cs-134	<2.5e-03	<2.5e-03	<2.2e-03	<1.6e-03	<1.9e-03	<2.4e-03	<2.0e-03	<1.8e-03	Required LLD 5.0e-2	
	Cs-137	<2.1e-03	<1.8e-03	<1.2e-03	<1.5e-03	<2.7e-03	<1.0e-03	<2.2e-03	<1.4e-03	Required LLD 6.0e-2	
	Fe-59	<1.6e-02	<8.9e-03	<9.1e-03	<9.8e-03	<1.4e-02	<8.5e-03	<1.1e-02	<7.6e-03		
	K-40	<3.0e-02	<2.6e-02	<2.1e-02	<2.6e-02	<2.6e-02	<2.8e-02	<2.0e-02	<2.5e-02		
	La-140	<7.1e-02	<8.1e-02	<8.2e-02	<6.1e-02	<8.8e-02	<1.0e-01	<2.9e-02	<9.5e-02		
	Mn-54	<2.9e-03	<2.2e-03	<1.7e-03	<2.0e-03	<2.3e-03	<2.1e-03	<1.3e-03	<1.7e-03		
	Nb-95	<7.0e-03	<1.7e-03	<7.8e-03	<6.7e-03	<8.1e-03	<8.7e-03	<9.0e-03	<7.4e-03		
	Zn-65	<7.9e-03	<3.9e-03	<5.0e-03	<5.0e-03	<7.2e-03	<5.4e-03	<4.7e-03	<3.8e-03		
	Zr-95	<6.7e-03	<9.3e-03	<6.1e-03	<6.3e-03	<5.3e-03	<5.8e-03	<6.5e-03	<5.2e-03		
	2ND QTR 03/28/07-06/26/07	Ba-140	<3.1e-01	<4.0e-01	<4.6e-01	<3.1e-01	<1.2e-01	<5.1e-01	<1.2e-01	<3.1e-01	
		Be-7	<b>1.03e-01</b>	<b>1.79e-01</b>	<b>1.38e-01</b>	<b>2.0e-01</b>	<9.0e-02	<9.7e-02	<b>1.76e-01</b>	<b>1.82e-01</b>	
		Co-57	<2.6e-03	<1.9e-03	<2.2e-03	<2.0e-03	<1.9e-03	<2.5e-03	<1.8e-03	<2.0e-03	
Co-58		<7.4e-03	<1.0e-02	<1.1e-02	<8.6e-03	<7.4e-03	<5.9e-03	<7.9e-03	<2.3e-03		
Co-60		<4.2e-03	<6.3e-03	<4.2e-03	<4.2e-03	<4.2e-03	<5.4e-03	<5.8e-03	<4.2e-03		
Cs-134		<1.2e-03	<3.8e-03	<1.2e-03	<5.2e-03	<4.8e-03	<4.3e-03	<5.1e-03	<4.3e-03	Required LLD 5.0e-2	
Cs-137		<3.5e-03	<4.5e-03	<6.0e-03	<4.9e-03	<4.9e-03	<4.5e-03	<4.3e-03	<4.0e-03	Required LLD 6.0e-2	
Fe-59		<3.0e-02	<3.0e-02	<3.5e-02	<3.5e-02	<8.7e-03	<2.4e-02	<2.5e-02	<3.9e-02		
K-40		<7.7e-02	<5.8e-02	<5.1e-02	<4.3e-02	<5.8e-02	<5.1e-02	<6.1e-02	<5.1e-02		
La-140		<3.6e-01	<4.6e-01	<5.3e-01	<3.6e-01	<1.3e-01	<5.8e-01	<1.4e-01	<3.6e-01		
Mn-54		<4.4e-03	<3.0e-03	<6.0e-03	<5.3e-03	<3.8e-03	<5.3e-03	<5.2e-03	<4.8e-03		
Nb-95		<1.9e-02	<1.7e-02	<1.7e-02	<2.2e-02	<2.5e-02	<1.9e-02	<2.3e-02	<1.9e-02		
Zn-65		<3.2e-03	<1.1e-02	<8.6e-03	<1.3e-02	<1.1e-02	<8.6e-03	<9.2e-03	<1.1e-02		
Zr-95	<1.9e-02	<1.6e-02	<1.4e-02	<1.8e-02	<1.8e-02	<4.3e-03	<2.2e-02	<1.1e-02			

Table 6 – 2007 Environmental Air Particulate Composite Gamma Isotopic Results (continued)  
(Units of pCi/m<sup>3</sup>)

Location	NW-1.0	SW/WSW-0.95	SSW-1.2	SW-12.3	SSE-4.5	E-3.5	N-1.45	N-9.4			
Nuclides				Control				Control			
Composite Dates 3RD QTR 06/27/07-09/25/07	Ba-140	<1.2e-01	<1.7e-01	<5.5e-02	<1.5e-01	<9.5e-02	<2.1e-01	<1.5e-01	<1.4e-01		
	Be-7	<b>1.28e-01</b>	<b>3.5e-01</b>	<b>1.36e-01</b>	<b>1.72e-01</b>	<b>1.34e-01</b>	<b>1.56e-01</b>	<b>1.18e-01</b>	<b>1.21e-01</b>		
	Co-57	<1.2e-03	<1.5e-03	<1.1e-03	<1.2e-03	<1.1e-03	<1.2e-03	<2.2e-03	<2.1e-03		
	Co-58	<5.2e-03	<7.4e-03	<6.3e-03	<1.7e-03	<6.1e-03	<7.4e-03	<8.1e-03	<6.4e-03		
	Co-60	<3.5e-03	<4.5e-03	<1.4e-03	<3.9e-03	<3.0e-03	<4.5e-03	<1.6e-03	<5.4e-03		
	Cs-134	<2.3e-03	<5.0e-03	<4.2e-03	<4.1e-03	<6.8e-04	<5.0e-03	<4.1e-03	<3.7e-03	Required LLD 5.0e-2	
	Cs-137	<3.2e-03	<3.0e-03	<2.6e-03	<3.3e-03	<2.9e-03	<3.0e-03	<4.4e-03	<4.9e-03	Required LLD 6.0e-2	
	Fe-59	<4.1e-03	<2.9e-02	<1.7e-02	<2.1e-02	<4.1e-03	<7.2e-03	<3.0e-02	<1.9e-02		
	K-40	<3.5e-02	<6.2e-02	<3.3e-02	<3.3e-02	<2.5e-02	<3.5e-02	<6.0e-02	<3.8e-02		
	La-140	<1.2e-01	<1.7e-01	<5.5e-02	<1.5e-01	<9.5e-02	<2.1e-01	<1.7e-01	<1.6e-01		
	Mn-54	<2.7e-03	<4.2e-03	<2.8e-03	<3.6e-03	<2.3e-03	<1.1e-03	<3.4e-03	<4.5e-03		
	Nb-95	<9.3e-03	<1.4e-02	<1.4e-02	<1.2e-02	<1.0e-02	<1.1e-02	<1.9e-02	<1.2e-02		
	Zn-65	<7.6e-03	<8.6e-03	<1.4e-02	<1.1e-02	<6.6e-03	<1.3e-02	<3.3e-03	<1.2e-02		
	Zr-95	<5.8e-03	<1.0e-02	<3.0e-03	<3.1e-03	<9.5e-03	<1.9e-02	<1.3e-02	<1.8e-02		
	4TH QTR 09/26/07-12/25/07	Ba-140	<2.5e-01	<2.5e-01	<9.3e-02	<2.5e-01	<9.3e-02	<1.9e-01	<9.4e-02	<1.7e-01	
		Be-7	<b>2.04e-01</b>	<b>1.34e-01</b>	<b>1.27e-01</b>	<b>1.53e-01</b>	<b>1.3e-01</b>	<b>1.37e-01</b>	<b>2.38e-01</b>	<b>9.2e-02</b>	
		Co-57	<2.9e-03	<2.5e-03	<2.5e-03	<2.3e-03	<2.7e-03	<1.9e-03	<2.5e-03	<2.0e-03	
Co-58		<1.0e-02	<3.2e-03	<1.2e-02	<1.2e-02	<1.2e-02	<5.2e-03	<1.2e-02	<5.2e-03		
Co-60		<2.3e-03	<8.3e-03	<2.3e-03	<2.3e-03	<2.3e-03	<3.2e-03	<2.3e-03	<1.1e-03		
Cs-134		<1.8e-03	<1.8e-03	<4.6e-03	<5.7e-03	<4.6e-03	<4.0e-03	<4.6e-03	<3.7e-03	Required LLD 5.0e-2	
Cs-137		<5.3e-03	<1.4e-03	<4.2e-03	<7.0e-03	<4.2e-03	<2.1e-03	<6.3e-03	<3.8e-03	Required LLD 6.0e-2	
Fe-59		<3.1e-02	<4.5e-02	<4.6e-02	<1.1e-02	<1.1e-02	<1.6e-02	<1.2e-02	<1.6e-02		
K-40		<7.0e-02	<7.0e-02	<7.0e-02	<8.2e-02	<9.1e-02	<3.3e-02	<9.3e-02	<4.0e-02		
La-140		<2.9e-01	<2.9e-01	<1.1e-01	<2.9e-01	<1.1e-01	<2.2e-01	<1.1e-01	<1.9e-01		
Mn-54		<4.8e-03	<7.1e-03	<4.8e-03	<6.1e-03	<6.1e-03	<3.0e-03	<6.2e-03	<3.6e-03		
Nb-95		<2.6e-02	<2.3e-02	<2.6e-02	<3.0e-02	<1.9e-02	<1.3e-02	<2.6e-02	<1.4e-02		
Zn-65		<1.3e-02	<1.3e-02	<1.3e-02	<1.6e-02	<1.6e-02	<9.4e-03	<2.1e-02	<1.2e-02		
Zr-95	<2.4e-02	<1.9e-02	<1.9e-02	<1.9e-02	<1.5e-02	<1.1e-02	<1.5e-02	<1.1e-02			

#### D. Surface Water Program

Surface water monitoring stations are found at four locations as detailed in Table 1 – Comanche Peak Nuclear Power Plant Radiological Environmental Monitoring Program. Location N-1.5 provides samples representative of Squaw Creek reservoir surface water at a location beyond significant influence of the plant discharge. Location ESE-1.4 provides samples representative of discharges from Squaw Creek reservoir downstream to Squaw Creek and to Lake Granbury via an installed return line. [NOTE: The installed return line to Lake Granbury has never been used to send water back to Lake Granbury.] Location NE-7.4 provides samples of Lake Granbury surface water downstream of the discharge from the return line from Squaw Creek reservoir. A control sample is obtained from the Brazos River, upstream of Lake Granbury at location N-19.3. Surface water samples from Squaw Creek reservoir locations were collected weekly and composited for monthly gamma isotopic analysis. Samples from Lake Granbury locations were collected monthly and analyzed by gamma spectrometry. All surface water samples were also composited quarterly by location for tritium analysis.

**For the year 2007** all surface water samples were collected as required. Table 7 -- 2007 Environmental Surface Water Tritium and Gamma Isotopic Results contains the reported values. Forty-eight samples were analyzed by gamma spectrometry. All results for the required radionuclides were reported as less than the required LLDs. Sixteen quarterly composited samples were analyzed for tritium. The results of the reported tritium values for Squaw Creek reservoir were in line with expected concentrations. The tritium values ranged from a high of **1.43e+04** pCi/l to a low of **7.39e+03** pCi/l. The results from Lake Granbury were all less than the required LLDs as expected. The tritium concentration reported in Squaw Creek is well below the action level of **3.0e+4** pCi/l and is following the expected concentration variations based on fuel cycles, power histories and reservoir makeup due to rain and pump transfers from Lake Granbury. Graph 2 – 2007 Environmental Surface Water Tritium Results indicates the current results and the short-term trend of the tritium concentration in Squaw Creek reservoir. The tritium value varies only slightly and is leveling off which possibly indicates that equilibrium may have been reached or soon will be reached. Graph 3 – Squaw Creek Maximum Tritium Values trends the reservoir tritium concentration since it was first detected in 1990 after Unit 1 startup and is located on page 30. This long-term graph also indicates that equilibrium concentrations may have been obtained. **Squaw Creek reservoir tritium is a direct product of the operation of CPNPP and is the only consistent indicator detectable in the environment surrounding Comanche Peak.** There should not be any significant changes in the tritium concentrations in the near future and no action levels are anticipated. A review of pre-operational and operational data indicated the 2007 results were both expected and consistent with previous data and that no anomalies had occurred.




**For the year 2007, there were no exceptions to the Surface Water Program.**

Table 7 -- 2007 Environmental Surface Water Tritium and Gamma Isotopic Results  
(Units of pCi/l)

Date	Location	H-3	Nuclides													
			Ba-140	Be-7	Co-58	Co-60	Cs-134	Cs-137	Fe-59	I-131	K-40	La-140	Mn-54	Nb-95	Zn-65	Zr-95
01/30/07	ESE-1.4		<9.2e+00	<2.4e+01	<2.7e+00	<2.8e+00	<2.9e+00	<2.8e+00	<5.9e+00	<1.3e+01	<3.7e+01	<1.1e+01	<2.2e+00	<3.4e+00	<5.3e+00	<4.6e+00
02/27/07	ESE-1.4		<4.2e+00	<1.3e+01	<1.5e+00	<1.6e+00	<1.4e+00	<1.6e+00	<3.5e+00	<5.9e+00	<b>1.48e+01</b>	<4.8e+00	<1.5e+00	<2.8e+00	<4.7e+00	<2.6e+00
03/27/07	ESE-1.4	<b>1.34e+04</b>	<9.0e+00	<2.9e+01	<3.7e+00	<2.7e+00	<2.9e+00	<2.8e+00	<8.0e+00	<1.4e+01	<4.3e+01	<1.0e+01	<3.0e+00	<4.2e+00	<7.1e+00	<6.1e+00
04/24/07	ESE-1.4		<1.0e+01	<3.2e+01	<3.5e+00	<3.3e+00	<3.4e+00	<3.1e+00	<7.7e+00	<1.3e+01	<4.6e+01	<1.2e+01	<3.2e+00	<4.3e+00	<8.7e+00	<5.8e+00
05/29/07	ESE-1.4		<5.1e+00	<1.7e+01	<1.8e+00	<1.6e+00	<1.5e+00	<1.7e+00	<4.7e+00	<1.0e+01	<b>2.03e+01</b>	<5.9e+00	<1.6e+00	<2.4e+00	<5.4e+00	<3.2e+00
06/26/07	ESE-1.4	<b>1.23e+04</b>	<7.8e+00	<1.7e+01	<1.9e+00	<1.9e+00	<1.7e+00	<1.7e+00	<4.7e+00	<1.4e+01	<3.0e+01	<9.0e+00	<1.5e+00	<2.5e+00	<3.6e+00	<3.3e+00
07/31/07	ESE-1.4		<7.9e+00	<1.5e+01	<1.9e+00	<1.6e+00	<1.5e+00	<1.3e+00	<4.5e+00	<1.4e+01	<2.5e+01	<9.1e+00	<1.5e+00	<2.5e+00	<3.6e+00	<3.2e+00
08/28/07	ESE-1.4		<1.2e+01	<3.7e+01	<5.7e+00	<6.3e+00	<6.3e+00	<5.5e+00	<1.4e+01	<1.3e+01	<6.6e+01	<1.4e+01	<4.5e+00	<7.3e+00	<1.2e+01	<7.9e+00
09/25/07	ESE-1.4	<b>8.24e+03</b>	<8.9e+00	<2.3e+01	<2.5e+00	<2.3e+00	<2.4e+00	<2.2e+00	<5.7e+00	<9.5e+00	<4.0e+01	<1.0e+01	<2.7e+00	<3.4e+00	<5.2e+00	<4.6e+00
10/30/07	ESE-1.4		<7.9e+00	<2.5e+01	<2.5e+00	<2.1e+00	<2.2e+00	<1.9e+00	<5.6e+00	<1.3e+01	<3.4e+01	<7.9e+00	<2.2e+00	<2.9e+00	<5.6e+00	<4.2e+00
11/27/07	ESE-1.4		<1.1e+01	<3.1e+01	<4.1e+00	<3.7e+00	<3.9e+00	<2.9e+00	<9.8e+00	<1.5e+01	<b>2.9e+01</b>	<1.1e+01	<3.7e+00	<5.2e+00	<8.7e+00	<7.4e+00
12/25/07	ESE-1.4	<b>7.39e+03</b>	<9.7e+00	<2.3e+01	<2.3e+00	<2.4e+00	<2.4e+00	<2.4e+00	<6.4e+00	<1.3e+01	<3.8e+01	<9.7e+00	<2.4e+00	<3.7e+00	<7.0e+00	<5.9e+00
01/30/07	N-1.5		<9.1e+00	<2.6e+01	<2.9e+00	<3.2e+00	<2.8e+00	<2.2e+00	<6.7e+00	<1.2e+01	<b>2.3e+01</b>	<1.0e+01	<2.7e+00	<3.8e+00	<4.8e+00	<5.4e+00
02/27/07	N-1.5		<4.9e+00	<1.5e+01	<1.9e+00	<2.1e+00	<1.9e+00	<1.5e+00	<3.9e+00	<5.7e+00	<2.8e+01	<5.6e+00	<1.8e+00	<2.2e+00	<3.4e+00	<3.4e+00
03/27/07	N-1.5	<b>1.43e+04</b>	<9.3e+00	<2.9e+01	<3.1e+00	<3.1e+00	<3.1e+00	<3.2e+00	<1.0e+01	<1.4e+01	<4.8e+01	<1.1e+01	<3.4e+00	<4.7e+00	<7.6e+00	<5.4e+00
04/24/07	N-1.5		<1.0e+01	<3.5e+01	<4.0e+00	<4.0e+00	<4.1e+00	<3.6e+00	<1.0e+01	<1.4e+01	<4.8e+01	<1.2e+01	<4.1e+00	<4.2e+00	<8.6e+00	<5.5e+00
05/29/07	N-1.5		<5.5e+00	<1.7e+01	<1.9e+00	<2.0e+00	<1.8e+00	<1.8e+00	<5.1e+00	<1.2e+01	<2.7e+01	<6.3e+00	<1.8e+00	<2.6e+00	<4.3e+00	<3.4e+00
06/26/07	N-1.5	<b>1.34e+04</b>	<8.8e+00	<2.3e+01	<2.8e+00	<2.5e+00	<2.6e+00	<2.2e+00	<5.9e+00	<1.4e+01	<3.9e+01	<1.0e+01	<2.2e+00	<3.3e+00	<4.7e+00	<5.0e+00
07/31/07	N-1.5		<5.9e+00	<1.6e+01	<1.5e+00	<1.4e+00	<1.6e+00	<1.3e+00	<3.9e+00	<1.3e+01	<b>1.58e+01</b>	<6.8e+00	<1.3e+00	<2.1e+00	<3.2e+00	<2.8e+00
08/28/07	N-1.5		<1.2e+01	<5.0e+01	<6.2e+00	<8.6e+00	<7.4e+00	<4.9e+00	<1.9e+01	<1.4e+01	<9.7e+01	<1.4e+01	<6.4e+00	<9.0e+00	<1.3e+01	<1.1e+01
09/25/07	N-1.5	<b>8.03e+03</b>	<9.0e+00	<2.3e+01	<2.6e+00	<2.8e+00	<2.3e+00	<2.4e+00	<5.0e+00	<1.1e+01	<4.0e+01	<1.0e+01	<2.2e+00	<3.3e+00	<5.1e+00	<4.9e+00
10/30/07	N-1.5		<9.3e+00	<2.6e+01	<3.3e+00	<3.0e+00	<3.0e+00	<2.5e+00	<7.1e+00	<1.5e+01	<b>2.3e+01</b>	<9.3e+00	<2.4e+00	<6.3e+00	<1.2e+01	<5.4e+00
11/27/07	N-1.5		<1.1e+01	<3.1e+01	<3.1e+00	<3.2e+00	<3.2e+00	<3.6e+00	<8.7e+00	<1.4e+01	<b>3.2e+01</b>	<1.1e+01	<2.8e+00	<4.5e+00	<7.5e+00	<6.1e+00
12/25/07	N-1.5	<b>8.32e+03</b>	<8.1e+00	<2.6e+01	<2.8e+00	<2.6e+00	<2.7e+00	<2.2e+00	<6.4e+00	<1.4e+01	<b>4.0e+01</b>	<8.1e+00	<2.5e+00	<3.6e+00	<7.0e+00	<5.4e+00
01/30/07	NE-7.4		<1.1e+01	<7.7e+01	<8.3e+00	<8.5e+00	<9.6e+00	<7.8e+00	<1.8e+01	<1.3e+01	<9.8e+01	<1.2e+01	<7.9e+00	<9.5e+00	<2.8e+01	<1.3e+01
02/27/07	NE-7.4		<1.1e+01	<5.6e+01	<5.9e+00	<6.6e+00	<7.1e+00	<5.9e+00	<1.5e+01	<1.3e+01	<8.6e+01	<1.3e+01	<7.4e+00	<7.3e+00	<1.9e+01	<1.2e+01
03/27/07	NE-7.4	<b>&lt;1.5e+03</b>	<1.0e+01	<5.6e+01	<6.9e+00	<7.8e+00	<7.1e+00	<7.3e+00	<1.7e+01	<1.2e+01	<1.0e+02	<1.2e+01	<6.6e+00	<8.4e+00	<2.0e+01	<1.3e+01
04/24/07	NE-7.4		<1.2e+01	<5.7e+01	<8.1e+00	<6.6e+00	<7.5e+00	<9.8e+00	<1.5e+01	<1.3e+01	<1.1e+02	<1.4e+01	<8.6e+00	<8.2e+00	<1.7e+01	<1.3e+01
05/29/07	NE-7.4		<1.2e+01	<4.6e+01	<6.2e+00	<7.1e+00	<6.6e+00	<5.5e+00	<1.3e+01	<1.1e+01	<1.1e+02	<1.4e+01	<6.4e+00	<6.0e+00	<1.3e+01	<9.7e+00
06/26/07	NE-7.4	<b>&lt;1.3e+03</b>	<6.8e+00	<2.9e+01	<3.4e+00	<2.8e+00	<3.1e+00	<2.8e+00	<6.3e+00	<1.0e+01	<5.4e+01	<7.8e+00	<2.8e+00	<3.7e+00	<7.0e+00	<5.7e+00
07/31/07	NE-7.4		<1.2e+01	<5.9e+01	<7.5e+00	<9.3e+00	<9.2e+00	<7.6e+00	<1.4e+01	<1.2e+01	<1.0e+02	<1.4e+01	<6.9e+00	<7.6e+00	<1.8e+01	<1.3e+01
08/28/07	NE-7.4		<9.8e+00	<4.8e+01	<6.3e+00	<7.0e+00	<7.4e+00	<6.5e+00	<1.4e+01	<9.9e+00	<8.7e+01	<1.1e+01	<6.7e+00	<8.8e+00	<1.5e+01	<8.2e+00
09/25/07	NE-7.4	<b>&lt;1.4e+03</b>	<1.1e+01	<5.7e+01	<6.6e+00	<4.6e+00	<8.8e+00	<7.2e+00	<1.5e+01	<1.4e+01	<1.1e+02	<1.3e+01	<6.9e+00	<8.5e+00	<2.1e+01	<1.2e+01
10/30/07	NE-7.4		<9.7e+00	<5.9e+01	<7.3e+00	<8.2e+00	<6.8e+00	<7.7e+00	<1.3e+01	<1.2e+01	<1.0e+02	<9.7e+00	<7.2e+00	<7.9e+00	<2.5e+01	<1.3e+01
11/27/07	NE-7.4		<1.2e+01	<5.2e+01	<6.2e+00	<7.5e+00	<6.2e+00	<7.0e+00	<1.3e+01	<1.1e+01	<8.7e+01	<1.2e+01	<6.1e+00	<5.9e+00	<1.7e+01	<1.1e+01
12/25/07	NE-7.4	<b>&lt;1.3e+03</b>	<1.5e+01	<5.4e+01	<6.0e+00	<8.3e+00	<5.4e+00	<7.6e+00	<1.2e+01	<1.0e+01	<b>6.6e+01</b>	<1.5e+01	<6.1e+00	<6.4e+00	<1.7e+01	<1.1e+01
01/30/07	N-19.3		<1.1e+01	<5.5e+01	<6.9e+00	<7.9e+00	<7.4e+00	<7.4e+00	<1.6e+01	<1.2e+01	<9.8e+01	<1.3e+01	<6.9e+00	<8.5e+00	<1.8e+01	<1.3e+01
02/27/07	N-19.3		<8.5e+00	<5.4e+01	<7.2e+00	<7.0e+00	<6.3e+00	<6.3e+00	<1.3e+01	<1.1e+01	<8.5e+01	<9.8e+00	<6.5e+00	<8.6e+00	<2.4e+01	<1.1e+01
03/27/07	N-19.3	<b>&lt;1.5e+03</b>	<1.3e+01	<7.4e+01	<8.7e+00	<1.1e+01	<7.8e+00	<8.1e+00	<1.7e+01	<1.1e+01	<1.5e+02	<1.5e+01	<8.9e+00	<1.1e+01	<2.0e+01	<1.0e+01
04/24/07	N-19.3		<1.2e+01	<6.0e+01	<8.2e+00	<9.6e+00	<6.7e+00	<8.4e+00	<1.6e+01	<1.4e+01	<1.1e+02	<1.4e+01	<7.1e+00	<8.5e+00	<2.0e+01	<1.5e+01
05/29/07	N-19.3		<1.1e+01	<5.9e+01	<7.6e+00	<5.5e+00	<6.8e+00	<7.0e+00	<1.5e+01	<1.2e+01	<8.9e+01	<1.2e+01	<6.1e+00	<6.3e+00	<1.3e+01	<9.8e+00
06/26/07	N-19.3	<b>&lt;1.3e+03</b>	<9.5e+00	<3.8e+01	<4.5e+00	<5.0e+00	<4.5e+00	<4.3e+00	<1.1e+01	<1.1e+01	<8.3e+01	<1.1e+01	<4.5e+00	<5.1e+00	<9.4e+00	<8.2e+00
07/31/07	N-19.3		<9.1e+00	<4.8e+01	<6.6e+00	<6.5e+00	<7.5e+00	<6.1e+00	<1.3e+01	<9.2e+00	<1.0e+02	<1.0e+01	<7.2e+00	<6.4e+00	<1.6e+01	<1.3e+01
08/28/07	N-19.3		<6.0e+00	<5.4e+01	<5.3e+00	<8.1e+00	<5.9e+00	<6.9e+00	<1.9e+01	<1.2e+01	<8.9e+01	<6.9e+00	<4.8e+00	<5.7e+00	<1.6e+01	<1.1e+01
09/25/07	N-19.3	<b>&lt;1.4e+03</b>	<9.8e+00	<4.1e+01	<5.3e+00	<5.6e+00	<5.9e+00	<4.5e+00	<1.1e+01	<8.8e+00	<9.8e+01	<1.1e+01	<4.8e+00	<5.5e+00	<1.0e+01	<7.9e+00
10/30/07	N-19.3		<1.4e+01	<5.2e+01	<6.9e+00	<7.7e+00	<6.4e+00	<5.8e+00	<1.1e+01	<1.1e+01	<9.1e+01	<1.4e+01	<7.4e+00	<9.0e+00	<1.8e+01	<1.2e+01
11/27/07	N-19.3		<1.2e+01	<5.2e+01	<5.7e+00	<7.5e+00	<6.4e+00	<6.1e+00	<1.4e+01	<9.4e+00	<6.8e+01	<1.2e+01	<5.6e+00	<7.1e+00	<1.7e+01	<8.9e+00
12/25/07	N-19.3	<b>&lt;1.3e+03</b>	<1.3e+01	<5.5e+01	<7.2e+00	<6.8e+00	<8.5e+00	<6.7e+00	<1.6e+01	<1.4e+01	<9.0e+01	<1.3e+01	<7.6e+00	<9.5e+00	<1.6e+01	<1.2e+01
Required LLD's		<b>3.00e+03</b>	<b>1.50e+01</b>		<b>1.50e+01</b>	<b>1.50e+01</b>	<b>1.50e+01</b>	<b>1.80e+01</b>	<b>3.00e+01</b>	<b>1.50e+01</b>		<b>1.50e+01</b>	<b>1.50e+01</b>	<b>1.50e+01</b>	<b>3.00e+01</b>	<b>1.50e+01</b>
Reportable Level		<b>3.00e+04</b>	<b>2.00e+02</b>		<b>1.00e+03</b>	<b>3.00e+02</b>	<b>3.00e+01</b>	<b>5.00e+01</b>	<b>4.00e+02</b>	<b>2.00e+01</b>		<b>2.00e+02</b>	<b>1.00e+03</b>	<b>4.00e+02</b>	<b>3.00e+02</b>	<b>4.00e+01</b>

### Graph 2 -- 2007 Environmental Surface Water Tritium Results

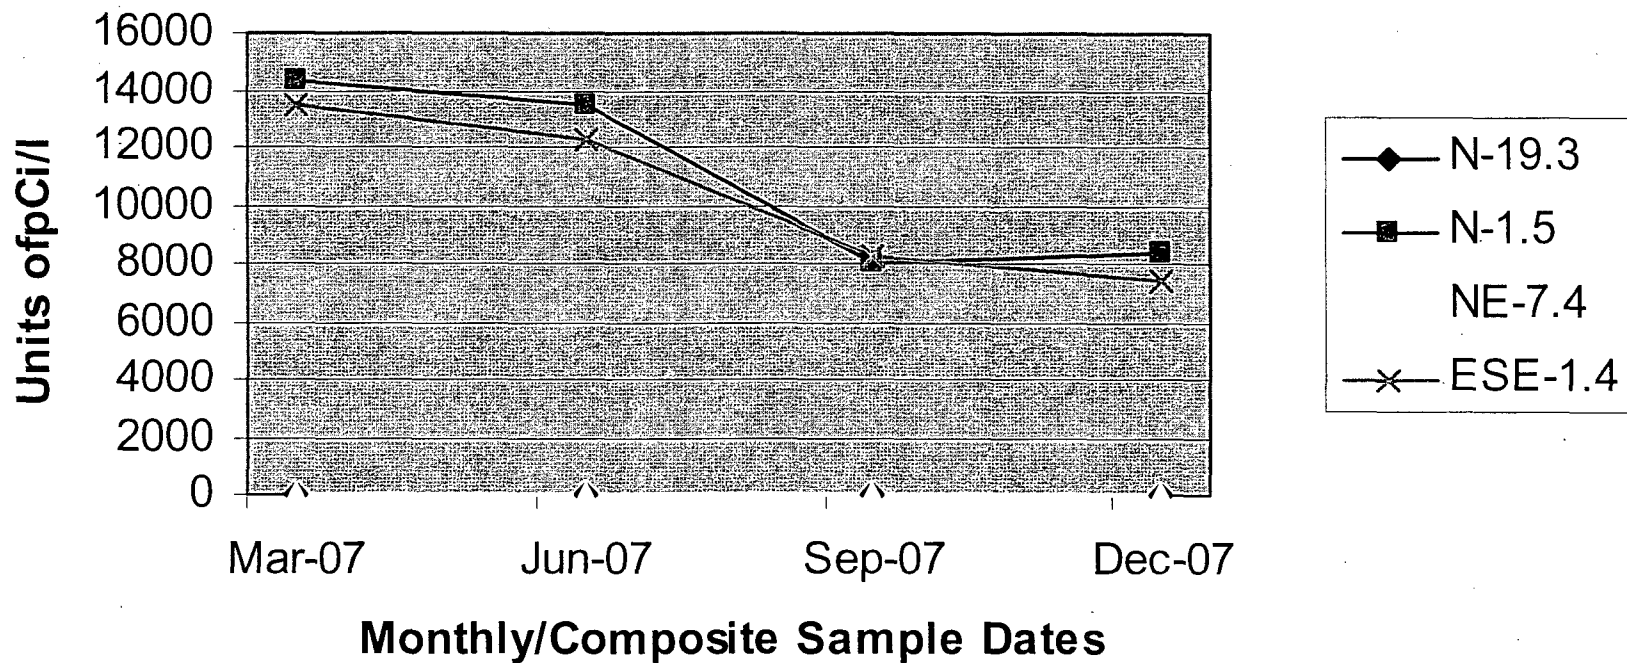

## E. Surface Drinking Water Program

Surface drinking water was collected at two monitoring locations. Table 1 -- Comanche Peak Nuclear Power Plant Radiological Environmental Monitoring Program for 2007 details the location and types of analysis required. Samples of water from Squaw Creek reservoir were collected at the monitoring location NNW-0.1 and analyzed at detection levels required for drinking water standards even though the water is not allowed to be used as potable water. Monitoring location N-9.9 was used as a surface drinking water location based on the proximity of the City of Granbury intake to the Granbury potable water system. All surface drinking water samples were collected weekly and then composited for Iodine-131 analysis, gamma isotopic analysis, and gross beta analysis on a monthly basis. Tritium analysis was performed on a quarterly basis.


**For the year 2007**, all samples were analyzed for gamma emitting radionuclides. The results are reported in Table 8 – Environmental Surface Drinking Water Tritium, Gross Beta and Gamma Isotopic Results. There were no gamma emitting radionuclides identified in any of the twenty-four composite samples. Tritium reported in Squaw Creek reservoir ranged from **8.28E+03 pCi/l to 1.25E+04 pCi/l** and **averaged 1.11E+04 pCi/l**. Tritium reported from all Lake Granbury water samples indicated less than the required LLD as expected. Graph 4 – 2007 Environmental Surface Drinking Water Tritium Results trends the results reported for the year 2007. Gross Beta results at the indicator location NNW-0.1 ranged from **1.81E+01 pCi/l to 3.18E+01 pCi/l** with an average of **2.75E+01 pCi/l**. Gross Beta results at the control location N-9.9 ranged from **5.6E+00 pCi/l to 1.73E+01 pCi/l** with an average of **1.21E+01 pCi/l**. Graph 5 – 2007 Environmental Surface Drinking Water Gross Beta Results trends the gross beta results for the two monitor locations and indicates no influence from Comanche Peak in the levels detected in the two different bodies of water. Past gross beta results for Lake Granbury have been as high as **83 pCi/l**. The gross beta results received are within values previously reported and there is no reportable level for gross beta so no action is required at this time.

**For the year 2007 there were no exceptions to the Surface Drinking Water Program.**


Table 8 -- 2007 Environmental Surface Drinking Water Tritium, Gross Beta and Gamma Isotopic Results  
(Units of pCi/l)

Date	Location	H-3	Gross Beta	Nuclides I-131	Ba-140	Co-58	Co-60	Cs-134	Cs-137	Fe-59	La-140	Mn-54	Nb-95	Zn-65	Zr-95
01/30/07	NNW-0.1		2.86e+01	<8.1e-01	<9.3e+00	<2.5e+00	<3.2e+00	<2.4e+00	<2.7e+00	<6.7e+00	<1.1e+01	<2.7e+00	<3.2e+00	<6.3e+00	<4.3e+00
02/27/07	NNW-0.1		3.14e+01	<7.3e-01	<5.2e+00	<2.1e+00	<2.0e+00	<2.0e+00	<1.9e+00	<4.7e+00	<6.0e+00	<2.1e+00	<2.5e+00	<8.0e+00	<3.6e+00
03/27/07	NNW-0.1	1.48e+04	3.16e+01	<8.6e-01	<8.3e+00	<3.6e+00	<2.7e+00	<3.52e+00	<3.3e+00	<6.9e+00	<9.5e+00	<3.0e+00	<3.5e+00	<7.5e+00	<5.4e+00
04/24/07	NNW-0.1		2.9e+01	<6.6e-01	<1.1e+01	<3.4e+00	<3.6e+00	<3.4e+00	<3.4e+00	<7.9e+00	<1.2e+01	<3.3e+00	<3.9e+00	<8.3e+00	<5.7e+00
05/29/07	NNW-0.1		2.91e+01	<7.5e-01	<9.3e+00	<2.6e+00	<3.0e+00	<2.2e+00	<2.6e+00	<5.8e+00	<1.1e+01	<2.3e+00	<3.1e+00	<5.4e+00	<4.5e+00
06/26/07	NNW-0.1	1.25e+04	2.8e+01	<1.7e-01	<7.6e+00	<2.1e+00	<1.9e+00	<2.0e+00	<1.6e+00	<4.7e+00	<8.8e+00	<1.9e+00	<2.8e+00	<3.4e+00	<3.6e+00
07/31/07	NNW-0.1		3.02e+01	<8.3e-01	<1.3e+01	<4.3e+00	<5.7e+00	<4.0e+00	<4.0e+00	<1.4e+01	<1.4e+01	<4.3e+00	<6.9e+00	<1.1e+01	<9.3e+00
08/28/07	NNW-0.1		1.86e+01	<7.7e-01	<1.3e+01	<5.6e+00	<6.0e+00	<5.3e+00	<5.5e+00	<1.2e+01	<1.5e+01	<4.2e+00	<6.5e+00	<1.2e+01	<9.8e+00
09/25/07	NNW-0.1	8.72e+03	2.7e+01	<6.3e-01	<9.3e+00	<3.0e+00	<3.2e+00	<2.4e+00	<2.0e+00	<6.7e+00	<1.1e+01	<2.3e+00	<3.2e+00	<5.4e+00	<5.4e+00
10/30/07	NNW-0.1		2.65e+01	<7.0e-01	<1.4e+01	<4.1e+00	<3.8e+00	<3.2e+00	<2.9e+00	<7.8e+00	<1.4e+01	<3.0e+00	<4.4e+00	<8.0e+00	<6.2e+00
11/27/07	NNW-0.1		3.18e+01	<6.1e-01	<1.3e+01	<3.4e+00	<3.6e+00	<3.1e+00	<3.4e+00	<7.6e+00	<1.3e+01	<3.7e+00	<4.2e+00	<7.6e+00	<7.2e+00
12/25/07	NNW-0.1	8.28e+03	1.81e+01	<6.4e-01	<1.2e+01	<5.1e+00	<3.4e+00	<4.0e+00	<4.0e+00	<1.1e+01	<1.2e+01	<3.1e+00	<5.1e+00	<1.0e+01	<7.6e+00
01/30/07	N-9.9		1.29e+01	<6.7e-01	<1.1e+01	<3.4e+00	<3.3e+00	<3.2e+00	<2.7e+00	<8.1e+00	<1.3e+01	<3.0e+00	<4.6e+00	<7.3e+00	<5.6e+00
02/27/07	N-9.9		1.65e+01	<6.8e-01	<3.3e+00	<1.4e+00	<1.5e+00	<1.4e+00	<1.3e+00	<3.3e+00	<3.8e+00	<1.5e+00	<1.7e+00	<4.1e+00	<2.6e+00
03/27/07	N-9.9	<1.5e+03	1.68e+01	<9.1e-01	<1.3e+01	<4.5e+00	<3.7e+00	<4.2e+00	<5.5e+00	<1.3e+01	<1.5e+01	<5.1e+00	<7.4e+00	<1.1e+01	<9.1e+00
04/24/07	N-9.9		5.6e+00	<6.1e-01	<1.3e+01	<4.0e+00	<4.8e+00	<4.3e+00	<3.7e+00	<9.7e+00	<1.5e+01	<4.5e+00	<5.2e+00	<9.7e+00	<7.4e+00
05/29/07	N-9.9		1.73e+01	<6.0e-01	<9.1e+00	<3.2e+00	<2.9e+00	<2.8e+00	<2.3e+00	<6.1e+00	<1.0e+01	<2.5e+00	<3.2e+00	<5.3e+00	<4.7e+00
06/26/07	N-9.9	<1.3e+03	1.04e+01	<1.9e-01	<1.1e+01	<3.4e+00	<3.0e+00	<3.0e+00	<3.0e+00	<7.3e+00	<1.3e+01	<2.8e+00	<4.2e+00	<6.8e+00	<5.8e+00
07/31/07	N-9.9		1.27e+01	<9.6e-01	<1.2e+01	<4.4e+00	<3.7e+00	<3.8e+00	<3.2e+00	<9.7e+00	<1.4e+01	<3.8e+00	<4.9e+00	<7.8e+00	<6.8e+00
08/28/07	N-9.9		1.03e+01	<7.4e-01	<1.3e+01	<6.0e+00	<5.6e+00	<5.7e+00	<5.4e+00	<1.2e+01	<1.5e+01	<5.1e+00	<6.4e+00	<1.2e+01	<7.9e+00
09/25/07	N-9.9	<1.3e+03	1.15e+01	<7.3e-01	<8.3e+00	<2.5e+00	<2.3e+00	<2.1e+00	<2.4e+00	<5.7e+00	<9.5e+00	<2.3e+00	<3.1e+00	<5.4e+00	<4.1e+00
10/30/07	N-9.9		1.18e+01	<8.7e-01	<1.3e+01	<2.8e+00	<3.3e+00	<3.4e+00	<2.5e+00	<7.8e+00	<1.3e+01	<3.4e+00	<4.8e+00	<7.2e+00	<6.7e+00
11/27/07	N-9.9		1.07e+01	<8.0e-01	<1.3e+01	<4.0e+00	<4.3e+00	<4.5e+00	<4.2e+00	<1.1e+01	<1.3e+01	<4.0e+00	<4.8e+00	<8.5e+00	<6.4e+00
12/25/07	N-9.9	<1.3e+03	8.6e+00	<5.8e-01	<9.3e+00	<3.9e+00	<3.8e+00	<3.4e+00	<3.0e+00	<8.0e+00	<9.3e+00	<3.0e+00	<4.6e+00	<9.5e+00	<6.2e+00
Required LLD's		2.00E+03	4.00E+00	1.00E+00	1.50E+01	1.50E+01	1.50E+01	1.50E+01	1.80E+01	3.00E+01	1.50E+01	1.50E+01	1.50E+01	3.00E+01	1.50E+01
Reportable Level		2.00E+04	None	2.00E+00	2.00E+02	1.00E+03	3.00E+02	3.00E+01	5.00E+01	4.00E+02	2.00E+02	1.00E+03	4.00E+02	3.00E+02	4.00E+02


**Graph 3 -- Squaw Creek Maximum Tritium Values**

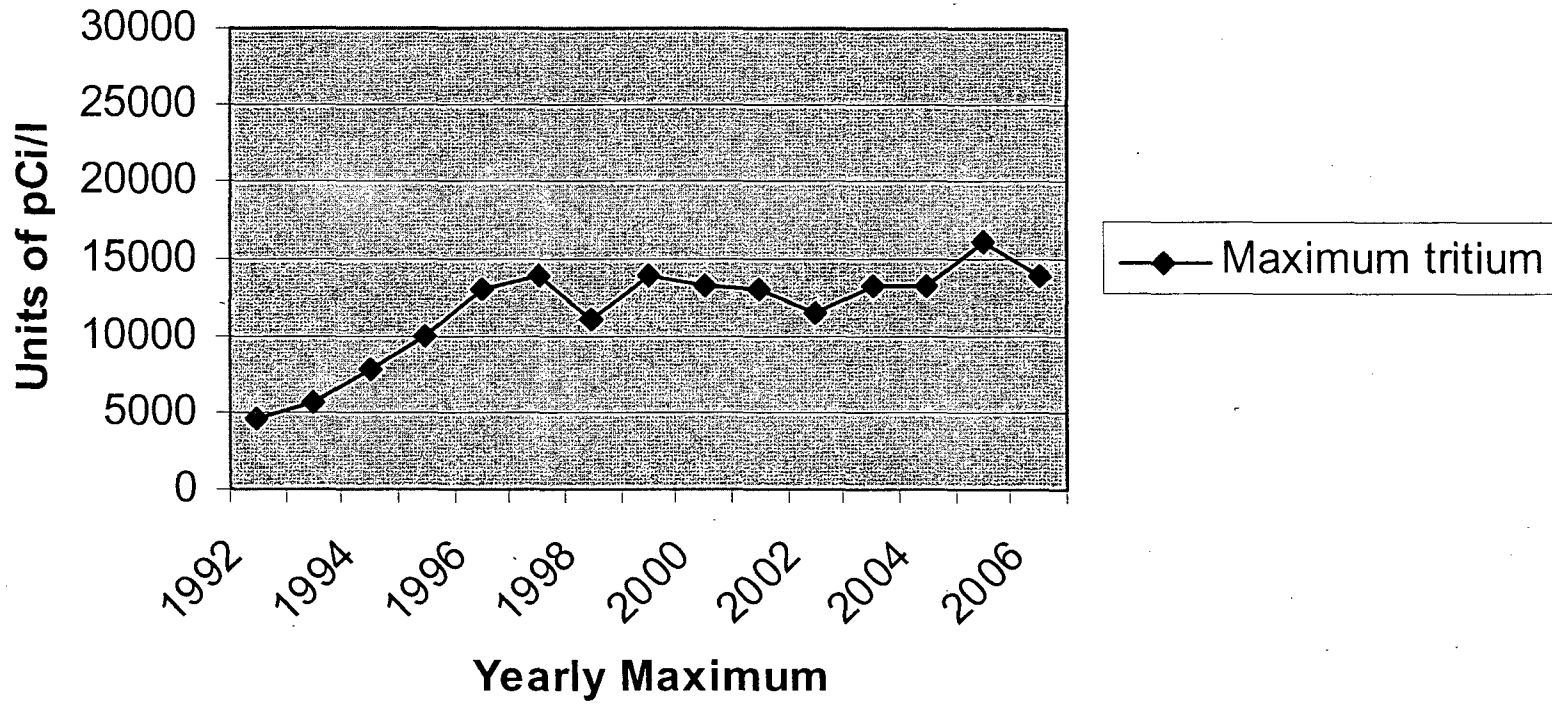

**Graph 4 -- 2007 Environmental Surface Drinking Water Tritium Results**

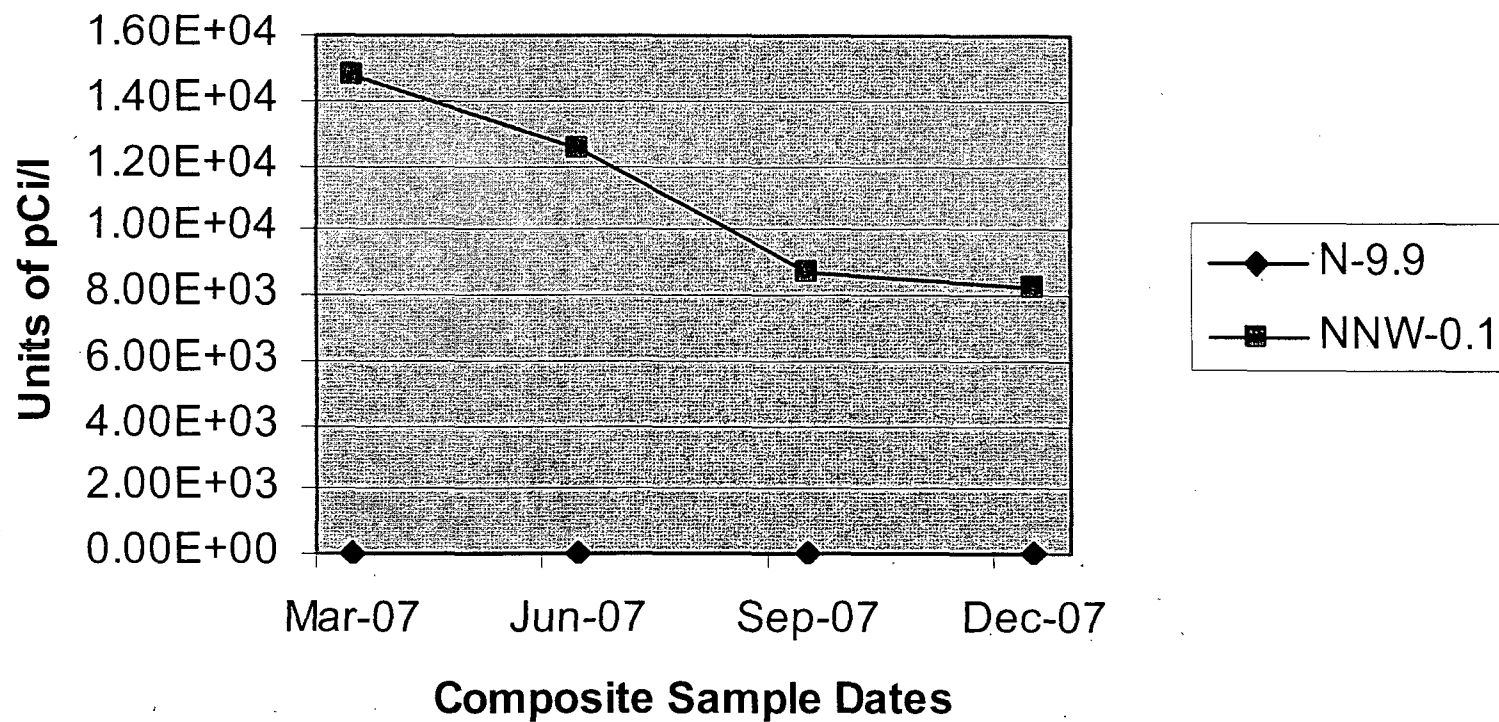

### Graph 5 -- 2007 Environmental Surface Drinking Water Gross Beta Results

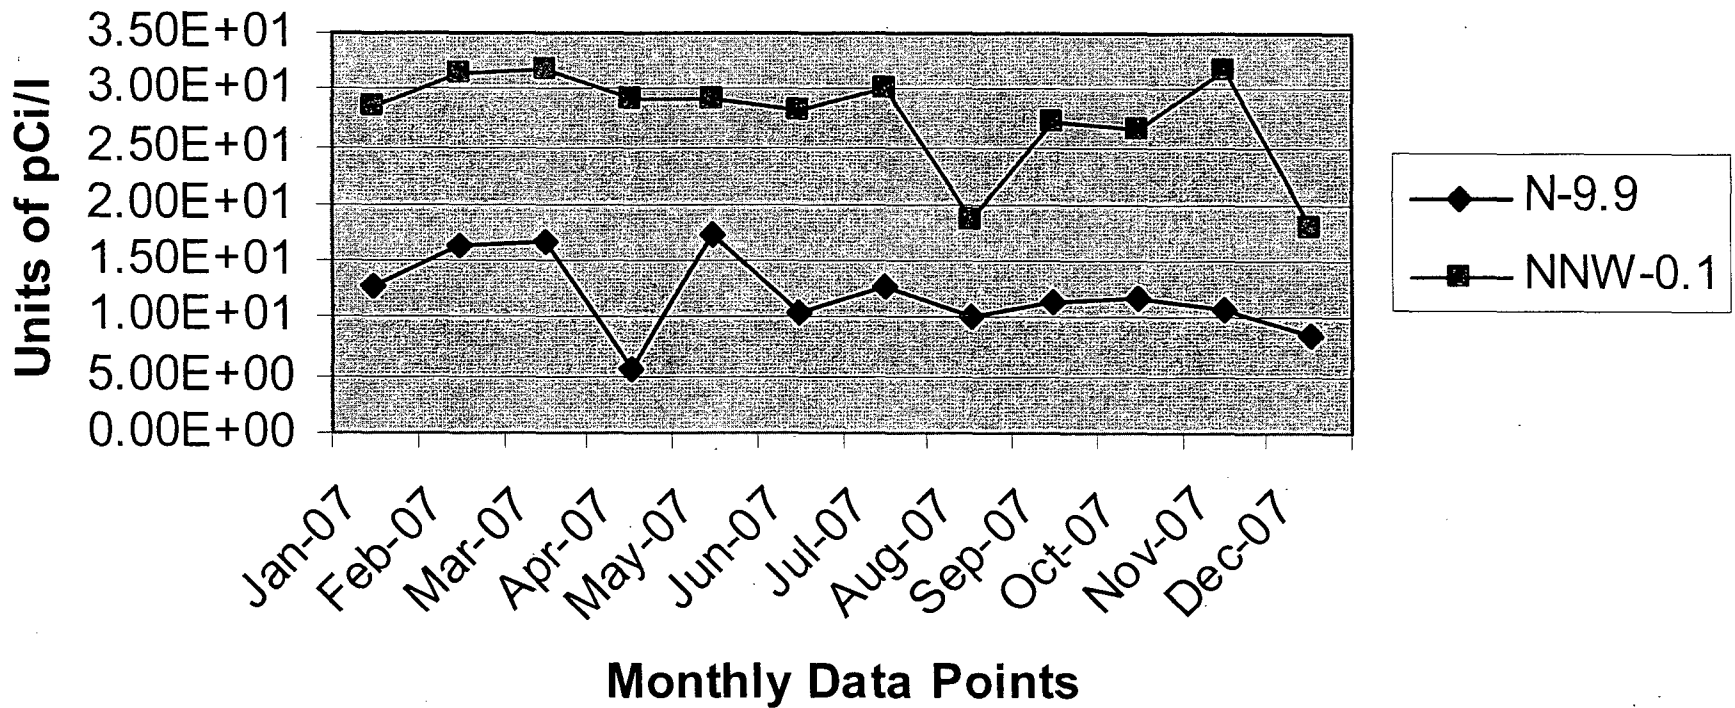



**F. Ground Water Program**

Table 1 – Comanche Peak Nuclear Power Plant Radiological Environmental Monitoring Program for 2007 specifies the five groundwater monitoring locations. Groundwater supplies in the site area are not affected by plant effluents and are sampled only to provide confirmation that groundwater is not affected by plant discharges. Groundwater samples were collected quarterly and analyzed for gamma isotopes and tritium at each location.

**For the year 2007** a total of twenty groundwater samples were collected from the five different monitoring locations. There were no radionuclides identified in any of the samples. All required LLDs were met for each required gamma emitting radionuclide. Tritium analysis was performed on twenty samples, all indicated less than the required LLD. Results for all the groundwater analyses are reported in Table 9 - 2007 Environmental Groundwater Tritium and Gamma Isotopic Results. These results confirm that plant discharges are having no effect on groundwater in the area surrounding Comanche Peak.

**For the year 2007, there were no exceptions to the Ground Water Program.**

**Table 9 -- 2007 Environmental Groundwater Tritium and Gamma Isotopic Results  
(Units of pCi/l)**

Date	Location	Nuclides												
		H-3	Ba-140	Co-58	Co-60	Cs-134	Cs-137	Fe-59	I-131	La-140	Mn-54	Nb-95	Zn-65	Zr-95
03/27/07	SSE-4.6	<1.3e+03	<1.2e+01	<6.8e+00	<7.8e+00	<5.4e+00	<7.1e+00	<1.3e+01	<1.2e+01	<1.4e+01	<6.5e+00	<6.4e+00	<1.8e+01	<1.0e+01
06/26/07	SSE-4.6	<1.3e+03	>1.1e+01	<6.3e+00	<6.3e+00	<5.3e+00	<5.0e+00	<1.2e+01	<1.3e+01	<1.3e+01	<6.1e+00	<6.3e+00	<1.2e+01	<1.1e+01
09/25/07	SSE-4.6	<1.3e+03	<1.2e+01	<5.9e+00	<7.6e+00	<6.3e+00	<5.2e+00	<1.4e+01	<9.4e+00	<1.3e+01	<6.2e+00	<6.1e+00	<1.3e+01	<1.2e+01
12/25/07	SSE-4.6	<1.3e+03	<1.4e+01	<7.6e+00	<7.8e+00	<8.0e+00	<6.7e+00	<1.5e+01	<1.1e+01	<1.4e+01	<5.8e+00	<6.7e+00	<1.7e+01	<1.1e+01
03/27/07	N-1.45	<1.3e+03	<1.3e+01	<7.2e+00	<8.8e+00	<7.6e+00	<6.8e+00	<1.3e+01	<8.4e+00	<1.5e+01	<6.4e+00	<7.3e+00	<1.5e+01	<1.1e+01
06/26/07	N-1.45	<1.3e+03	<6.6e+00	<2.4e+00	<1.9e+00	<1.7e+00	<1.8e+00	<5.3e+00	<1.0e+01	<7.6e+00	<2.0e+00	<2.9e+00	<4.5e+00	<4.2e+00
09/25/07	N-1.45	<1.3e+03	<1.1e+01	<6.1e+00	<6.9e+00	<7.1e+00	<5.7e+00	<1.4e+01	<1.1e+01	<1.2e+01	<5.5e+00	<6.4e+00	<1.6e+01	<1.1e+01
12/25/07	N-1.45	<1.3e+03	<1.2e+01	<5.9e+00	<6.0e+00	<6.7e+00	<6.1e+00	<1.3e+01	<1.1e+01	<1.2e+01	<5.5e+00	<5.6e+00	<1.4e+01	<8.3e+00
03/27/07	N-9.8	<1.3e+03	<1.2e+01	<6.7e+00	<7.9e+00	<7.3e+00	<8.3e+00	<1.6e+01	<1.2e+01	<1.3e+01	<6.3e+00	<6.6e+00	<1.8e+01	<1.2e+01
06/26/07	N-9.8	<1.3e+03	<1.2e+01	<5.3e+00	<5.1e+00	<5.9e+00	<4.8e+00	<1.1e+01	<1.5e+01	<1.4e+01	<4.9e+00	<5.8e+00	<1.1e+01	<9.4e+00
09/25/07	N-9.8	<1.3e+03	<1.1e+01	<7.3e+00	<6.4e+00	<7.8e+00	<6.8e+00	<1.7e+01	<1.2e+01	<1.2e+01	<7.1e+00	<9.1e+00	<1.5e+01	<1.4e+01
12/25/07	N-9.8	<1.3e+03	<1.2e+01	<5.2e+00	<6.6e+00	<6.2e+00	<4.4e+00	<1.1e+01	<7.4e+00	<1.2e+01	<4.7e+00	<6.2e+00	<1.6e+01	<9.7e+00
03/27/07	W-1.2	<1.3e+03	<9.8e+00	<5.7e+00	<5.8e+00	<6.3e+00	<7.0e+00	<1.0e+01	<1.0e+01	<1.1e+01	<5.9e+00	<7.7e+00	<2.5e+01	<1.2e+01
06/26/07	W-1.2	<1.3e+03	<6.1e+00	<2.8e+00	<2.9e+00	<2.8e+00	<2.5e+00	<6.1e+00	<1.0e+01	<7.0e+00	<2.6e+00	<3.3e+00	<6.2e+00	<5.2e+00
09/25/07	W-1.2	<1.3e+03	<8.7e+00	<7.7e+00	<7.1e+00	<7.2e+00	<5.8e+00	<1.2e+01	<1.2e+01	<1.0e+01	<5.8e+00	<8.1e+00	<1.2e+01	<1.2e+01
12/25/07	W-1.2	<1.3e+03	<1.2e+01	<6.4e+00	<7.1e+00	<6.1e+00	<4.8e+00	<1.2e+01	<1.1e+01	<1.2e+01	<5.4e+00	<6.8e+00	<1.8e+01	<1.0e+01
03/27/07	WSW-0.1	<1.3e+03	<1.2e+01	<4.6e+00	<6.3e+00	<5.8e+00	<5.7e+00	<1.2e+01	<8.1e+00	<1.3e+01	<5.6e+00	<5.6e+00	<1.4e+01	<1.2e+01
06/26/07	WSW-0.1	<1.3e+03	<6.3e+00	<3.0e+00	<2.9e+00	<2.7e+00	<2.8e+00	<6.6e+00	<1.0e+01	<7.3e+00	<2.7e+00	<3.3e+00	<6.5e+00	<5.0e+00
09/25/07	WSW-0.1	<1.3e+03	<1.2E+01	<6.9E+00	<7.5E+00	<6.2E+00	<5.6E+00	<1.5E+01	<1.0E+01	<1.4E+01	<6.1E+00	<7.1E+00	<1.3E+01	<1.3E+01
12/25/07	WSW-0.1	<1.3e+03	<1.3e+01	<4.8e+00	<8.5e+00	<6.5e+00	<6.0e+00	<1.4e+01	<9.8e+00	<1.3e+01	<5.7e+00	<5.8e+00	<1.8e+01	<1.1e+01
Required LLD's		3.00E+03	1.50E+01	1.50E+01	1.50E+01	1.50E+01	1.80E+01	3.00E+01	1.50E+01	1.50E+01	1.50E+01	1.50E+01	3.00E+01	1.50E+01
Reportable Levels		2.00E+04	2.00E+02	1.00E+03	3.00E+02	3.00E+01	5.00E+01	4.00E+02	2.00E+01	2.00E+02	1.00E+03	4.00E+02	3.00E+02	4.00E+02

G. **Sediment Program**

Shoreline sediments were collected at four different monitoring locations. One sample location is along the shore of Squaw Creek Reservoir, one sample location is on Squaw Creek down stream of the dam discharge and two locations are along Lake Granbury's shores. Each sample is collected on a six-month frequency and sent to the contract laboratory for analysis by gamma spectrometry.

The process of shoreline sedimentation is a complex evolution whereby potential radionuclides and stable elements may concentrate in the bottom sediment of particular bodies of water. The concentrations are effected by such things as colloidal particles combining with chelating agents and biological action of bacteria and other benthic organisms. Monitoring of the area shorelines provides one of the first and best indicators of radionuclide deposition.

**For the year 2007** results from the gamma isotopic analysis of shoreline sediments is reported in Table 10 – 2007 Environmental Sediment Gamma Isotopic Results. As expected and in agreement with previous results from both the pre-operational and operational programs, naturally occurring Potassium-40 was detected in all eight samples. Radioactive nuclides required to be analyzed for were performed and all but one sample indicated less than the required LLDs. During previous years, both pre-operational and operational, positive indications occasionally had been noted for Cesium-137 and during 2007 there was one positive Cesium-137 results reported. The results were above the required LLD. The only other positive value reported for 2007 was for naturally occurring Beryllium-7. As expected, there were no results in any sediment sample that indicated any direct influence from CPNPP discharges to the local environment.

**For the year 2007, there were no exceptions to the Sediment Program.**

**Table 10 -- 2007 Environmental Sediment Gamma Isotopic Results  
(Units of pCi/kg)**

Date	Location	Nuclides Ba-140	Be-7	Co-58	Co-60	Cs-134	Cs-137	Fe-59	I-131	K-40	La-140	Mn-54	Nb-95	Zn-65	Zr-95
01/09/07	SE-5.3	<9.2e+01	<b>3.82e+02</b>	<1.8e+01	<2.0e+01	<2.0e+01	<b>3.2e+01</b>	<3.8e+01	<2.9e+01	<b>4.89e+03</b>	<4.5e+01	<1.9e+01	<3.1e+01	<9.8e+01	<3.1e+01
01/09/07	NNE-1.0	<6.6e+01	<1.2e+02	<1.4e+01	<1.3e+01	<1.3e+01	<1.4e+01	<2.4e+01	<2.4e+01	<b>1.86e+03</b>	<3.5e+01	<1.4e+01	<2.8e+01	<6.7e+01	<2.9e+01
01/09/07	NE-7.4	<7.1e+01	<b>6.6e+01</b>	<1.4e+01	<1.2e+01	<6.1e+01	<1.2e+01	<2.6e+01	<2.3e+01	<b>1.66e+03</b>	<2.6e+01	<1.5e+01	<2.1e+01	<7.0e+01	<2.1e+01
01/09/07	N-9.9	<2.3e+01	<1.4e+02	<1.7e+01	<1.9e+01	<2.4e+01	<1.6e+01	<3.2e+01	<2.1e+01	<b>3.96e+03</b>	<2.7e+01	<1.7e+01	<1.8e+01	<7.5e+01	<2.6e+01
07/03/07	SE-5.3	<1.3e+02	<b>8.32e+02</b>	<2.0e+01	<1.9e+01	<6.5e+01	<b>3.89e+02</b>	<5.0e+01	<6.4e+01	<b>1.06e+04</b>	<7.6e+01	<1.7e+01	<3.4e+01	<8.6e+01	<3.3e+01
07/03/07	NNE-1.0	<1.7e+02	<b>1.45e+02</b>	<2.7e+01	<2.4e+01	<1.1e+02	<2.7e+01	<6.3e+01	<8.1e+01	<b>1.75e+03</b>	<7.2e+01	<2.2e+01	<3.7e+01	<1.3e+02	<4.0e+01
07/03/07	NE-7.4	<1.5e+02	<1.9e+02	<2.6e+01	<2.2e+01	<8.4e+01	<3.0e+01	<5.9e+01	<8.5e+01	<b>1.6e+03</b>	<1.0e+02	<2.3e+01	<3.5e+01	<8.1e+01	<4.2e+01
07/03/07	N-9.9	<2.0e+02	<2.5e+02	<3.1e+01	<3.6e+01	<1.2e+02	<3.1e+01	<6.7e+01	<8.3e+01	<b>1.10e+04</b>	<9.4e+01	<2.6e+01	<3.7e+01	<1.3e+02	<5.7e+01
Required LLD's Reportable Levels						1.50E+02 None	1.80E+02 None								

## Fish Program

Fish samples were collected at two locations during the year 2007. One monitoring location is an area approximately two miles east-northeast of the site on Squaw Creek Reservoir. The second location is on Lake Granbury approximately eight miles north-northeast of the site. Fish sampling is scheduled for the months of April and October. CPNPP personnel along with local State Game Wardens collect the fish from these areas. The fish are now caught using rods and reels to eliminate the killing of rough fish and extra game fish that is associated with the past method of using gill nets to obtain the required fish. The collected fish are frozen and shipped to the independent laboratory where the edible portions are analyzed for gamma emitting radionuclides. Due to increasing problems in obtaining fish samples through our current methods, we have contracted with an outside agency for future fish sample collection.

**For the year 2007**, the results of the analysis performed on the collected fish samples are reported in Table 11 -- 2007 Environmental Fish Gamma Isotopic Results. Catfish and bass samples were analyzed as indicated in the table. There were no positive results reported except for the expected Potassium-40, which is naturally occurring in all living organisms. All required radionuclide results were reported as less than the required LLDs. As a result of the fish-sampling program, there were no anomalies noted and no indication of any influence on the surrounding environment from Comanche Peak plant discharges.

**For the year 2007, there was one exception to the Fish Program.**

During the sampling period in April 2007, no fish were available from the Lake Granbury location. Smart Form 2007-001185 was written to address this issue.

No abnormal results were reported by CPNPP or by the State of Texas. As expected, Potassium-40 was the only positive isotope found.

**Table 11 -- 2007 Environmental Fish Gamma Isotopic Results  
(Units of pCi/kg wet)**

Date	Location	Nuclides Ba-140	Co-58	Co-60	Cs-134	Cs-137	Fe-59	I-131	K-40	La-140	Mn-54	Nb-95	Zn-65	Zr-95	Fish Type
04/03/2007	Squaw Creek	<7.9e+01	<4.7e+01	<3.5e+01	<6.2e+01	<3.4e+01	<1.3e+02	<8.2e+01	<b>1.92e+03</b>	<9.0e+01	<6.0e+01	<6.2e+01	<1.3e+02	<7.4e+01	<i>Catfish</i>
04/03/2007	Squaw Creek	<7.6e+01	<4.9e+01	<5.0e+01	<7.6e+01	<5.4e+01	<1.6e+02	<6.8e+01	<b>3.12e+03</b>	<8.8e+01	<5.8e+01	<6.3e+01	<1.3e+02	<9.5e+01	<i>Bass</i>
10/09/2007	Squaw Creek	<1.5e+02	<6.6e+01	<5.2e+01	<6.3e+01	<6.2e+01	<1.5e+02	<1.7e+02	<b>1.73e+03</b>	<1.8e+02	<4.8e+01	<6.5e+01	<1.5e+02	<1.1e+02	<i>Catfish</i>
10/09/2007	Squaw Creek	<6.9e+01	<5.2e+01	<4.4e+01	<2.7e+01	<4.0e+01	<1.1e+02	<1.2e+02	<b>2.65e+03</b>	<8.0e+01	<5.2e+01	<5.3e+01	<1.1e+02	<8.6e+01	<i>Bass</i>
04/03/2007	Lake Granbury	<6.7e+01	<4.6e+01	<7.5e+01	<5.5e+01	<5.3e+01	<6.3e+01	<9.6e+01	<b>3.78e+03</b>	<7.7e+01	<4.5e+01	<6.1e+01	<1.3e+02	<9.2e+01	<i>Catfish</i>
04/03/2007	Lake Granbury														<i>Bass</i>
11/13/2007	Lake Granbury	<1.3e+02	<4.1e+01	<4.9e+01	<5.2e+01	<4.7e+01	<1.3e+02	<1.4e+02	<b>2.4e+03</b>	<1.3e+02	<4.5e+01	<6.8e+01	<9.6e+01	<7.4e+01	<i>Catfish</i>
11/20/2007	Lake Granbury	<4.9e+01	<3.5e+01	<3.7e+01	<2.8e+01	<3.5e+01	<6.3e+01	<5.7e+01	<b>2.19e+03</b>	<4.9e+01	<3.6e+01	<3.5e+01	<8.6e+01	<5.6e+01	<i>Bass</i>
Required LLD's			1.30E+02	1.30E+02	1.30E+02	1.50E+02	2.60E+02				1.30E+02		2.60E+02		
Reportable Levels			3.00E+04	1.00E+04	1.00E+03	2.00E+03	1.00E+04				3.00E+04		2.00E+04		

**I. Food Products Program**

Food products (pecan) were collected at the time of harvest. The samples are obtained at monitoring location ENE-9.0 and are shipped to the contract laboratory for gamma isotopic analysis.

**For the year 2007**, results of the gamma isotopic analyses are reported in Table 12 -- 2007 Environmental Food Products Gamma Isotopic Results. Naturally occurring Potassium 40 was detected in the sample as expected, and there were no other gamma emitting radionuclides identified.

**For the year 2007**, there were no exceptions to the Food Products program.

**Table 12 -- 2007 Environmental Food Products Gamma Isotopic Results  
(Units of pCi/kg wet)**

Date	Location	Nuclides Ba-140	Food Type – Pecans												
			Be-7	Co-58	Co-60	Cs-134	Cs-137	Fe-59	I-131	K-40	La-140	Mn-54	Nb-95	Zn-65	Zr-95
11/13/07	ENE-9.0	<6.1e+01	<1.7e+02	<2.7e+01	<2.7e+01	<2.4e+01	<2.1e+01	<5.1e+01	<5.8e+01	3.77e+03	<6.1e+01	<2.6e+01	<2.8e+01	<5.8e+01	<3.6e+01
Required LLD's						6.00E+01	8.00E+01		6.00E+01						
Reportable Levels						1.00E+03	2.00E+03		1.00E+02						



## **J. Broadleaf Program**

Broadleaf sample collection is conducted in accordance with the requirements of the Radiological Environmental Monitoring Program. The program specifies the sampling based on the absence of milk monitoring locations. One broadleaf control location is located at SW-13.5 in the vicinity of the previous control milk location. The two indicator locations, N-1.45 and SW-1.0, are located near the site boundaries. The broadleaf samples consist of mainly native grasses and cedar leaves and are analyzed for Iodine-131 and gamma emitting isotopes.

**For the year 2007**, all but one radionuclide analysis met their required LLDs and there was no indication of gamma emitting radionuclides. There were no indications of Iodine-131 being detected. The naturally occurring radionuclide of Potassium-40 was found in 36 of 36 samples taken. The radionuclide Beryllium-7 was present in 35 of 36 samples.

**For the year 2007, there was one exception to the Broadleaf Program.**

Sample collected on 11/27/07 for location BL-1 did not meet LLD requirements for iodine analysis. Discussion with the offsite lab showed a delay in processing the sample which allowed for too long of a decay period. Smartform 2008-000612 was written.

**Table 13 -- 2007 Environmental Broadleaf Iodine-131 and Gamma Isotopic Results  
(Units of pCi/kg wet)**

Date	Location	Nuclides													
		I-131	Ba-140	Be-7	Co-58	Co-60	Cs-134	Cs-137	Fe-59	K-40	La-140	Mn-54	Nb-95	Zn-65	Zr-95
01/30/2007	N-1.45	<4.3e+01	<5.6e+01	<b>1.53e+03</b>	<3.2e+01	<3.3e+01	<3.5e+01	<3.7e+01	<9.2e+01	<b>2.78e+03</b>	<6.5e+01	<3.7e+01	<3.6e+01	<1.0e+02	<6.0e+01
02/27/2007	N-1.45	<4.0e+01	<4.1e+01	<b>1.49e+03</b>	<3.3e+01	<2.5e+01	<3.2e+01	<2.8e+01	<7.1e+01	<b>2.24e+03</b>	<4.7e+01	<3.3e+01	<3.8e+01	<9.0e+01	<4.9e+01
03/27/2007	N-1.45	<4.8e+01	<4.4e+01	<b>1.63e+03</b>	<4.7e+01	<4.2e+01	<4.3e+01	<3.2e+01	<8.4e+01	<b>1.67e+03</b>	<5.0e+01	<3.0e+01	<5.2e+01	<1.3e+02	<7.3e+01
04/24/2007	N-1.45	<4.3e+01	<8.1e+01	<b>7.25e+02</b>	<2.0e+01	<2.2e+01	<1.8e+01	<1.8e+01	<5.0e+01	<b>2.3e+03</b>	<9.3e+01	<1.6e+01	<2.3e+01	<4.5e+01	<3.1e+01
05/29/2007	N-1.45	<4.5e+01	<1.1e+02	<b>2.8e+03</b>	<5.9e+01	<4.5e+01	<4.2e+01	<3.3e+01	<9.3e+01	<b>1.5e+03</b>	<1.2e+02	<3.8e+01	<5.0e+01	<1.2e+02	<7.3e+01
06/26/2007	N-1.45	<2.4e+01	<9.1e+01	<b>2.41e+03</b>	<4.7e+01	<4.2e+01	<5.1e+01	<4.1e+01	<1.1e+02	<b>4.72e+03</b>	<1.0e+02	<4.1e+01	<6.8e+01	<1.0e+02	<9.1e+01
07/31/2007	N-1.45	<5.1e+01	<1.6e+02	<b>3.2e+03</b>	<5.7e+01	<7.4e+01	<5.8e+01	<5.7e+01	<1.7e+02	<b>3.11e+03</b>	<1.8e+02	<7.0e+01	<6.9e+01	<1.4e+02	<1.3e+02
08/28/2007	N-1.45	<4.7e+01	<6.5e+01	<b>2.12e+03</b>	<5.4e+01	<5.4e+01	<5.7e+01	<5.9e+01	<1.3e+02	<b>4.96e+03</b>	<7.5e+01	<5.5e+01	<6.0e+01	<1.5e+02	<9.3e+01
09/25/2007	N-1.45	<5.2e+01	<1.1e+02	<b>4.7e+02</b>	<5.3e+01	<4.4e+01	<4.5e+01	<4.1e+01	<7.9e+01	<b>2.52e+03</b>	<1.3e+02	<4.1e+01	<5.2e+01	<1.4e+02	<8.2e+01
10/30/2007	N-1.45	<4.7e+01	<1.3e+02	<b>8.5e+02</b>	<5.1e+01	<4.7e+01	<4.2e+01	<3.8e+01	<1.2e+02	<b>2.85e+03</b>	<1.3e+02	<4.8e+01	<4.7e+01	<1.0e+02	<6.8e+01
11/27/2007	N-1.45	<1.7e+02	<1.9e+02	<b>9.1e+02</b>	<6.6e+01	<7.0e+01	<5.0e+01	<5.4e+01	<1.6e+02	<b>1.22e+03</b>	<1.9e+02	<3.5e+01	<7.6e+01	<1.3e+02	<1.1e+02
12/25/2007	N-1.45	<5.2e+01	<1.1e+02	<b>9.2e+02</b>	<5.7e+01	<3.7e+01	<4.7e+01	<5.3e+01	<1.3e+02	<b>2.63e+03</b>	<1.1e+02	<4.0e+01	<5.9e+01	<1.4e+02	<1.0e+02
Control															
01/30/2007	SW-13.5	<4.1e+01	<7.4e+01	<b>5.39e+03</b>	<5.0e+01	<5.6e+01	<5.2e+01	<5.0e+01	<1.1e+02	<b>1.62e+04</b>	<8.5e+01	<4.6e+01	<5.0e+01	<1.7e+02	<8.6e+01
02/27/2007	SW-13.5	<1.6e+01	<9.3e+01	<b>1.19e+03</b>	<4.2e+01	<5.9e+01	<5.5e+01	<4.8e+01	<1.3e+02	<b>1.15e+04</b>	<1.1e+02	<5.3e+01	<6.0e+01	<1.3e+02	<8.3e+01
03/27/2007	SW-13.5	<4.8e+01	<7.9e+01	<b>1.04e+03</b>	<3.9e+01	<3.9e+01	<3.2e+01	<3.4e+01	<8.5e+01	<b>3.11e+03</b>	<9.1e+01	<3.6e+01	<4.5e+01	<1.8e+01	<6.3e+01
04/24/2007	SW-13.5	<3.9e+01	<8.9e+01	<b>6.7e+02</b>	<2.7e+01	<3.2e+01	<2.9e+01	<3.2e+01	<8.9e+01	<b>4.7e+03</b>	<1.0e+02	<2.9e+01	<3.9e+01	<7.1e+01	<5.6e+01
05/29/2007	SW-13.5	<4.9e+01	<1.3e+02	<b>1.25e+03</b>	<6.6e+01	<6.2e+01	<5.4e+01	<6.1e+01	<1.6e+02	<b>4.48e+03</b>	<1.5e+02	<5.4e+01	<7.0e+01	<1.8e+02	<8.9e+01
06/26/2007	SW-13.5	<2.5e+01	<9.3e+01	<b>3.06e+03</b>	<2.3e+01	<1.8e+01	<2.0e+01	<1.7e+01	<6.0e+01	<b>1.83e+03</b>	<1.1e+02	<1.9e+01	<3.4e+01	<4.8e+01	<4.1e+01
07/31/2007	SW-13.5	<5.0e+01	<9.7e+01	<b>3.19e+03</b>	<5.3e+01	<4.5e+01	<5.9e+01	<4.7e+01	<1.0e+02	<b>3.58e+03</b>	<1.1e+02	<4.7e+01	<5.0e+01	<1.4e+02	<8.9e+01
08/28/2007	SW-13.5	<4.6e+01	<6.7e+01	<b>4.2e+02</b>	<5.0e+01	<4.8e+01	<5.2e+01	<4.3e+01	<1.2e+02	<b>5.41e+03</b>	<7.7e+01	<4.7e+01	<5.6e+01	<1.3e+02	<7.6e+01
09/27/2007	SW-13.5	<4.5e+01	<1.3e+02	<5.8e+02	<5.6e+01	<6.1e+01	<5.8e+01	<6.0e+01	<1.6e+02	<b>4.71e+03</b>	<1.5e+02	<5.8e+01	<8.2e+01	<2.4e+02	<1.1e+02
10/30/2007	SW-13.5	<4.5e+01	<1.3e+02	<b>1.1e+03</b>	<4.8e+01	<5.2e+01	<5.3e+01	<4.5e+01	<1.3e+02	<b>2.12e+03</b>	<1.3e+02	<4.9e+01	<5.9e+01	<1.3e+02	<9.2e+01
11/27/2007	SW-13.5	<5.2e+01	<1.3e+02	<b>4.49e+03</b>	<5.4e+01	<5.1e+01	<5.2e+01	<5.3e+01	<1.2e+02	<b>5.19e+03</b>	<1.3e+02	<4.7e+01	<7.3e+01	<2.0e+02	<8.8e+01
12/25/2007	SW-13.5	<3.9e+01	<1.6e+02	<b>7.9e+02</b>	<6.2e+01	<5.6e+01	<5.9e+01	<5.8e+01	<1.4e+02	<b>7.83e+03</b>	<1.6e+02	<5.5e+01	<6.9e+01	<1.6e+02	<9.6e+01
01/30/2007	SW-1.0	<4.5e+01	<4.1e+01	<b>8.5e+02</b>	<3.8e+01	<3.8e+01	<3.9e+01	<3.9e+01	<6.6e+01	<b>2.36e+03</b>	<4.7e+01	<3.4e+01	<4.2e+01	<9.4e+01	<7.1e+01
02/27/2007	SW-1.0	<3.9e+01	<5.3e+01	<b>3.47e+03</b>	<4.1e+01	<5.1e+01	<5.0e+01	<4.2e+01	<1.1e+02	<b>6.18e+03</b>	<6.1e+01	<4.7e+01	<4.8e+01	<1.2e+02	<6.9e+01
03/27/2007	SW-1.0	<5.0e+01	<8.4e+01	<b>1.26e+03</b>	<2.7e+01	<3.4e+01	<3.1e+01	<3.5e+01	<8.0e+01	<b>2.42e+03</b>	<9.7e+01	<2.2e+01	<2.8e+01	<6.1e+01	<4.4e+01
04/24/2007	SW-1.0	<3.6e+01	<1.2e+02	<b>1.32e+03</b>	<4.2e+01	<4.0e+01	<4.2e+01	<3.3e+01	<1.0e+02	<b>4.61e+03</b>	<1.4e+02	<3.8e+01	<6.1e+01	<1.6e+02	<8.2e+01
05/29/2007	SW-1.0	<4.6e+01	<1.2e+02	<b>1.41e+03</b>	<5.2e+01	<3.8e+01	<4.7e+01	<4.6e+01	<9.3e+01	<b>2.65e+03</b>	<1.4e+02	<3.9e+01	<5.7e+01	<1.1e+02	<8.6e+01
06/26/2007	SW-1.0	<4.5e+01	<1.9e+02	<b>4.9e+03</b>	<6.8e+01	<5.9e+01	<6.0e+01	<5.4e+01	<1.7e+02	<b>1.19e+03</b>	<2.2e+02	<5.3e+01	<7.8e+01	<1.6e+02	<1.3e+02
07/31/2007	SW-1.0	<4.3e+01	<7.0e+01	<b>8.1e+02</b>	<4.6e+01	<5.0e+01	<4.9e+01	<4.1e+01	<1.2e+02	<b>3.96e+03</b>	<8.0e+01	<3.8e+01	<6.0e+01	<1.3e+02	<8.0e+01
08/28/2007	SW-1.0	<3.7e+01	<9.6e+01	<b>1.02e+03</b>	<5.1e+01	<5.6e+01	<5.2e+01	<5.8e+01	<1.3e+02	<b>3.24e+03</b>	<1.1e+02	<5.6e+01	<6.1e+01	<1.4e+02	<1.0e+02
09/27/2007	SW-1.0	<4.4e+01	<1.1e+02	<b>4.4e+02</b>	<4.5e+01	<6.1e+01	<5.0e+01	<5.0e+01	<1.0e+02	<b>1.46e+03</b>	<1.2e+02	<5.0e+01	<6.2e+01	<1.2e+02	<7.8e+01
10/30/2007	SW-1.0	<5.1e+01	<1.5e+02	<b>1.07e+03</b>	<5.7e+01	<4.3e+01	<4.7e+01	<3.9e+01	<1.1e+02	<b>3.68e+03</b>	<1.5e+02	<4.4e+01	<5.6e+01	<1.1e+02	<9.0e+01
11/27/2007	SW-1.0	<5.3e+01	<1.6e+02	<b>2.09e+03</b>	<5.0e+01	<4.2e+01	<5.7e+01	<4.6e+01	<1.3e+02	<b>2.19e+03</b>	<1.6e+02	<5.3e+01	<6.1e+01	<2.1e+02	<8.4e+01
12/25/2007	SW-1.0	<4.1e+01	<1.6e+02	<b>6.1e+02</b>	<6.4e+01	<6.5e+01	<5.9e+01	<4.8e+01	<1.5e+02	<b>2.71e+03</b>	<1.6e+02	<5.6e+01	<6.8e+01	<1.6e+02	<1.1e+02
Required LLD's		<b>6.00E+01</b>				<b>6.00E+01</b>				<b>8.00E+01</b>					
Reportable Levels		<b>1.00E+02</b>				<b>1.00E+03</b>				<b>2.00E+03</b>					

## K. Conclusions

**For the year 2007**, based on the results presented in this report and from comparisons with the pre-operational and operational program results from previous years, it can be concluded that the impact of Comanche Peak on the environment is very small. **The only indication directly attributable to Comanche Peak is the tritium detected in Squaw Creek reservoir.**

Gross beta trend indications concerning Squaw Creek Reservoir are consistent with previous values and do not indicate any increase due to influence from Comanche Peak. Future data will be evaluated as it is received and changes will be addressed as necessary.

The atmospheric environment was sampled for airborne particulate matter, radioiodine and direct radiation. The terrestrial environment was sampled using groundwater, surface drinking water, food products and broadleaf vegetation. The aquatic environment was sampled using surface water, fish and shoreline sediments. The analyses of all these samples provided results that were below the measurement detection limits, or were indicative of expected natural terrestrial and cosmogenic levels, except for the tritium in the water samples of Squaw Creek reservoir. **The tritium in Squaw Creek reservoir is reaching equilibrium and is expected to remain well below the reportable level.**

**There were no values reported during the year 2007 that exceeded any NRC reportable limit.**

## L. Inter Laboratory Comparison and Cross Check Program

Areva NP Environmental Laboratory is the independent contract laboratory that processes the radiological environmental monitoring samples collected by CPNPP. The contract laboratory is required to participate in an Interlaboratory Comparison Program in accordance with the ODCM Control 3.12.3. Areva NP participates in multiple programs to ensure all environmental media sent to them are analyzed to the proper standards.

Areva NP recently published "Semi-Annual Quality Assurance Status Report January-June 2007" and "Semi-Annual Quality Assurance Status Report July-December 2007" which included current interlaboratory comparison results and two year trends as appropriate. These reports explain the Quality Control Program used by Areva NP during their respective time periods. Interlaboratory and third party quality control programs included the Environmental Crosscheck Program administered by Analytics, Inc., the National Institute of Standards and Technology (NIST) Measurement Assurance Program (MAP), the Environmental Resource Associates (ERA) Proficiency Test (PT), the Department of Energy (DOE) Quality Assessment Program (QAP) and the Mixed Analyte Performance Evaluation Program (MAPEP). Areva NP also conducts an internal Quality

Control Program that includes QC functions such as instrumentation checks, blank samples, instrumentation backgrounds, duplicates, staff qualification analysis and process controls.

There was one external audit performed during the first semi-annual period. There were one internal audit during the first semi-annual reporting period.

Extensive details of the results of the various interlaboratory and cross check programs are contained in the reports mentioned above. A summary of each reporting period is reported below:

**During the first semi-annual reporting period**, there were 29 nuclides associated with various media types analyzed by means of the Laboratory's internal process control, DOE, ERA and Analytics quality control programs.

The Analytics Cross Check Program provided 175 individual environmental analyses for bias and 175 for precision. 100% fell within the Laboratory's acceptance criteria for bias and 100% were within tolerance limits for precision.

Of the 268 internal process control analyses evaluated for bias, 98.9% met Laboratory acceptance criteria. Also, 99.2% of the 130 results for precision were found acceptable.

All 64 QC charcoals evaluated during this period reported positive activity as expected and met the agreement criteria.

None of the 163 environmental analytical blanks analyzed reported positive activity greater than 3 times the standard deviation.

None of backgrounds processed reported activity above the 3 times the standard deviation limit.

The cumulative bias for the three programs evaluated to the internal Laboratory's performance criteria shows 99.3% of the 443 individual results fell within acceptance criteria for bias while 99.7% of the 305 analyses fell within the acceptance criteria for precision.

A review was performed of all Condition Reports (CR) listed in the report. Twelve CRs were closed during this period and 9 CRs were issued. No adverse trend can be detected and the Laboratory is pursuing resolution of all open CRs.

**During the second semi-annual reporting period**, there were 18 nuclides associated with various media types analyzed by means of the Laboratory's internal process control, DOE, ERA, IAEA and Analytics quality control programs.

The Analytics Cross Check Program provided 162 individual environmental analyses for bias and 162 for precision. 92% fell within the Laboratory's acceptance criteria for bias and 100% were within tolerance limits for precision.

Using the Laboratory's internal acceptance criteria as the basis of evaluation, 51 out of 54 of mean results came within agreement criteria. The three failures, gross alpha on an air filter, Cr-51 on an air filter and Ce-141 in milk, are documented on (CR) 08-01 and 08-02.

Of the 210 internal process control analyses evaluated for bias, 99.5% met Laboratory acceptance criteria. Also, 100% of the 22 results for precision were found acceptable.

All 65 QC charcoals evaluated during this period reported positive activity as expected. These results are posted in Table 7 of the Semi-annual report.

None of the 157 environmental analytical blanks analyzed reported positive activity greater than 3 times the standard deviation.

None of the backgrounds processed reported any activity above the 3 times the standard deviation limit.

All of the blind duplicates resulted in 100% of all paired measurements meeting the acceptance criteria.

The cumulative bias for the two programs evaluated to the internal Laboratory's performance criteria shows 96.2% of the 372 individual results fell within acceptance criteria for bias while 100% of the 184 analyses fell within the acceptance criteria for precision.

A review was performed of all Condition Reports (CR) listed in the report. Twelve CRs were closed during this period and 13 CRs were issued. No adverse trend can be detected and the Laboratory is pursuing resolution of all open CRs.

There was one internal audit during the second semi-annual reporting period.

The independent laboratory, Areva, satisfies the requirements of the ODCM by their participation in the inter-laboratory and cross check programs documented in their semi-annual reports.

**Appendix A**

**Comanche Peak Nuclear Power Plant  
Land Use Census  
2007**

**COPY**

## COMANCHE PEAK NUCLEAR POWER PLANT LAND USE CENSUS 2007

The Land Use Census identified receptors within a five (5) mile radius of the plant in each of the sixteen (16) meteorological sectors. The Land Use Census was conducted July 17, 18, and 19, 2007 and includes the following items:

1. Evaluation of the 2007 Land Use Census
2. Nearest Resident by Sector, Distance, X/Q and D/Q
3. Nearest Garden by Sector, Distance and D/Q
4. Nearest Milk Animal by Sector, Distance and D/Q
5. Population by Sector and Distance
6. Environmental Sample Locations Table
7. Environmental Monitoring Locations Map- 2 Mile Radius
8. Environmental Monitoring Locations Map- 20 Mile Radius\*
9. 5 Mile Sector and Road Map with Field Data\*

\*These maps are vaulted along with this census. Copies of this census will not contain a copy of these maps unless specifically requested.

## Evaluation of the 2007 Land Use Census

The results of the 2007 Land Use Census were reviewed for impact on the Radiological Environmental Monitoring Program (REMP). The specific areas reviewed, that could be affected by changes found in the land use census, were the sampling requirements for milk, broadleaf vegetation and food products.

Reviewing the milk sampling requirements from the ODCM Table 3.12-1 requires that samples are to be obtained from milking animals in three locations within a 5 km distance having the highest potential dose. If none are available, samples are acceptable from milking animals in locations 5 to 8 km distance where doses are calculated to be greater than 1 mrem per year. A sample is also required at a control location. There are currently no identified milking animals (cow or goat) within the specified distances therefore, there will be no milk sampled during the year 2007.

Since not all milk samples are available, the broadleaf vegetation sampling specified in ODCM Table 3.12-1 is being performed. Broadleaf sample requirements are such that samples of broadleaf vegetation are to be collected from each of two offsite locations of the highest predicted annual average D/Q if milk sampling is not performed at all the required locations. Currently, broadleaf vegetation samples are collected at two indicator locations (N - 1.45 and SW - 1.0) and one control location (SW - 13.5). These indicator locations are near the site boundary in sectors where broadleaf vegetation is available and D/Q is high. Therefore, no change to the broadleaf sampling program is required.

Food product sample requirements of ODCM Table 3.12-1 requires that one sample of each principal class of food product be collected from any area that is irrigated with water in which liquid plant waste has been discharged. Of the gardens identified in the land use census, no gardens are located in any area that irrigates with water in which liquid plant wastes are discharged. Currently, food products are sampled from one indicator location (ENE - 9.0) when in season. The indicator location for ENE-9.0 for pecans at time of harvest will be continued since it is a major source of food products sold to the public.

The 2007 Land Use Census did not identify any locations that are "available for sampling" and that would yield a calculated dose 20% greater than at the current sampling locations. However, the previous numbers for X/Q and D/Q were incorrectly calculated for location NNW for Nearest Resident by Sector and Distance. These numbers were re-calculated to ensure that there was not a dose greater than 20% at the new current location.



Calculated values for the associated X/Q and D/Q values for each controlling receptor location and pathway are included along with the receptor distances in the data tables of this land use census. The values used to determine potential dose due to radioactive effluent discharges are the highest calculated values based on annual average values. The annual average X/Q used for dose calculations is 3.30E-6, tritium X/Q is 4.36E-6, and the D/Q value is 3.34 E-8. All these values are conservative based on the 2007 Land Use Census data and therefore no changes are required in the dose calculation parameters as verified by the field data.

\* X/Q units are Sec/cubic meter      \* D/Q units are inverse square meters

Nearest Resident by Sector, Distance, X/Q and D/Q

Sector	Distance (Miles)	X/Q	D/Q
N	2.2	9.28E-07	5.32E-09
NNE	2.2	5.58E-07	2.90E-09
NE	2.2	3.92E-07	1.42E-09
ENE	2.4	2.58E-07	7.08E-10
E	2.4	3.02E-07	6.62E-10
ESE	2.0	4.7E-07	1.20E-09
SE	1.9	8.28E-07	3.38E-09
SSE	1.5	1.10E-06	6.60E-09
S	1.5	8.50E-07	5.20E-09
SSW	2.1	3.52E-07	1.56E-09
SW	1.1	1.40E-06	6.5E-09
WSW	1.0	1.80E-06	6.50E-09
W	1.6	7.64E-07	2.50E-09
WNW	2.8	4.07E-07	1.18E-09
NW	2.7	6.98E-07	2.24E-09
NNW	2.5	8.4E-07	3.6E-09

Note: The Annual Average X/Q used for dose calculations is 3.30E-06 sec/cubic meter.  
 The Tritium value X/Q used for dose calculations is 4.36E-06 sec/cubic meter.  
 The Annual Average D/Q used for dose calculations is 3.34E-08 inverse square meters.

Nearest Garden by Sector, Distance and D/Q

Sector	Distance (Miles)	D/Q
N	None	None
NNE	None	None
NE	None	None
ENE	None	None
E	None	None
ESE	None	None
SE	None	None
SSE	None	None
S	None	None
SSW	None	None
SW	None	None
WSW	None	None
W	None	None
WNW	None	None
NW	None	None
NNW	None	None

Nearest Milk Animal by Sector, Distance and D/Q

Sector	Distance (Miles)	D/Q
N	None	None
NNE	None	None
NE	None	None
ENE	None	None
E	None	None
ESE	None	None
SE	None	None
SSE	None	None
S	None	None
SSW	None	None
SW	None	None
WSW	None	None
W	None	None
WNW	None	None
NW	None	None
NNW	None	None

Population by Sector and Distance

Sector	0-1	1-2	2-3	3-4	4-5	Total
N	-	-	3	35	117	155
NNE	-	-	13	122	29	164
NE	-	-	122	152	309	583
ENE	-	-	152	5	21	178
E	-	-	109	21	35	165
ESE	-	3	64	120	189	376
SE	-	24	120	160	67	371
SSE	-	80	98	82	2173	2433
S	-	21	112	21	157	311
SSW	-	-	13	5	48	66
SW	-	96	3	72	37	208
WSW	-	311	5	5	-	321
W	-	56	13	21	24	114
WNW	-	-	5	45	109	159
NW	-	-	3	-	-	3
NNW	-	-	3	53	40	96
TOTAL	-	591	838	919	3355	5703

Based on an average of 2.66 residents per house, this average was obtained from North Central Texas Council of Governments for Hood and Somervell Counties and is derived from an average of residents per house of 2.57 and 2.74, respectively.

### Environmental Sample Locations Table

Sampling Point	Location	Sample Type*
A1	N-1.45 (Squaw Creek Park)	A
A2	N-9.4 (Granbury)	A
A3	E-3.5 (Children's Home)	A
A4	SSE-4.5 (Glen Rose)	A
A5	S/SSW-1.2	A
A6	SW-12.3 (CONTROL)	A
A7	SW/WSW-0.95	A
A8	NW-1.0	A
R1	N-1.45 (Squaw Creek Park)	R
R2	N-4.4	R
R3	N-6.5	R
R4	N-9.4 (Granbury)	R
R5	NNE-1.1	R
R6	NNE-5.65	R
R7	NE-1.7	R
R8	NE-4.8	R
R9	ENE-2.5	R
R10	ENE-5.0	R
R11	E-0.5	R
R12	E-1.9	R
R13	E-3.5 (Children's Home)	R
R14	E-4.2	R
R15	ESE-1.4	R
R16	ESE-4.7	R
R17	SE-1.3	R
R18	SE-3.85	R

Environmental Sample Locations Table (cont.)

Sampling Point	Location	Sample Type*
R19	SE-4.6	R
R20	SSE-1.3	R
R21	SSE-4.4 (Glen Rose)	R
R22	SSE-4.5 (Glen Rose)	R
R23	S-1.5	R
R24	S-4.2	R
R25	SSW-1.1	R
R26	SSW-4.4 (State Park)	R
R27	SW-0.9	R
R28	SW-4.8 (Girl Scout Camp)	R
R29	SW-12.3 (CONTROL)	R
R30	WSW-1.0	R
R31	WSW-5.35	R
R32	WSW-7.0 (CONTROL)	R
R33	W-1.0	R
R34	W-2.0	R
R35	W-5.5	R
R36	WNW-1.0	R
R37	WNW-5.0	R
R38	WNW-6.7	R
R39	NW-1.0	R
R40	NW-5.7	R
R41	NW-9.9 (Tolar)	R
R42	NNW-1.35	R
R43	NNW-4.6	R

Environmental Sample Locations Table (cont.)

Sampling Point	Location	Sample Type*
SW1	N-1.5 (Squaw Creek Reservoir Marina)	SW
SW2	N-9.9 (Lake Granbury)	SW/DW <sup>1</sup>
SW3	N-19.3 (CONTROL-Brazos River)	SW
SW4	NE-7.4 (Lake Granbury)	SW
SW5	ESE-1.4 (Squaw Creek Reservoir)	SW <sup>2</sup>
SW6	NNW-0.1 (Squaw Creek Reservoir)	SW/DW <sup>3</sup>
GW1	W-1.2 (NOSF Potable Water)	GW
GW2	WSW-0.1 (Plant Potable Water)	GW <sup>3,4</sup>
GW3	SSE-4.6 (Glen Rose)	GW <sup>4</sup>
GW4	N-9.8 (Granbury)	GW <sup>1,4</sup>
GW5	N-1.45 (Squaw Creek Park)	GW <sup>4</sup>
SS1	NNE-1.0 (Squaw Creek Reservoir)	SS
SS2	N-9.9 (Lake Granbury)	SS
SS3	NE-7.4 (Lake Granbury)	SS
SS4	SE-5.3 (Squaw Creek)	SS
F1	ENE-2.0 (Squaw Creek Reservoir)	F
F2	NNE-8.0 (Lake Granbury)	F
FP1	ENE-9.0 (Leonard Bros. Pecan Farm)	FP




Environmental Sample Locations Table (cont.)

Sampling Point	Location	Sample Type*
BL1	N-1.45	BL
BL2	SW-1.0	BL <sup>5</sup>
BL3	SW-13.5 (CONTROL)	BL <sup>5</sup>

\*Sample Type: A - Air Sample; R - Direct Radiation; SW - Surface Water; DW - Drinking Water; GW - Ground Water; SS - Shoreline Sediments; M - Milk; F - Fish; FP - Food Products; BL - Broadleaf Vegetation

- NOTES:
- 1) The municipal water system for the City of Granbury is supplied by surface water from Lake Granbury (location SW2) and ground water (location GW4). Each of these supplies is sampled. These samples are not required for compliance with Radiological Effluent Control 3/4.12.1, Table 3.12-1, because they are not affected by plant discharges.
  - 2) This sample (location SW6) is representative of discharges from Squaw Creek Reservoir both down Squaw Creek and to Lake Granbury via the return line to Lake Granbury if used.
  - 3) Plant potable water could be supplied by surface water from Squaw Creek Reservoir (location SW6) but is normally supplied by ground water from onsite wells (location GW2). Each of these possible sources of water are sampled.
  - 4) Ground water supplies in the plant site area are not affected by plant liquid effluents as discussed in CPSES FSAR Section 2.4.13 and are therefore not required to be monitored for radioactivity to meet the requirements of the Radiological Effluent Control 3/4.12.1, Table 3.12-1.
  - 5) Broadleaf sampling will be performed at the specified locations if milk samples are unavailable from any location.

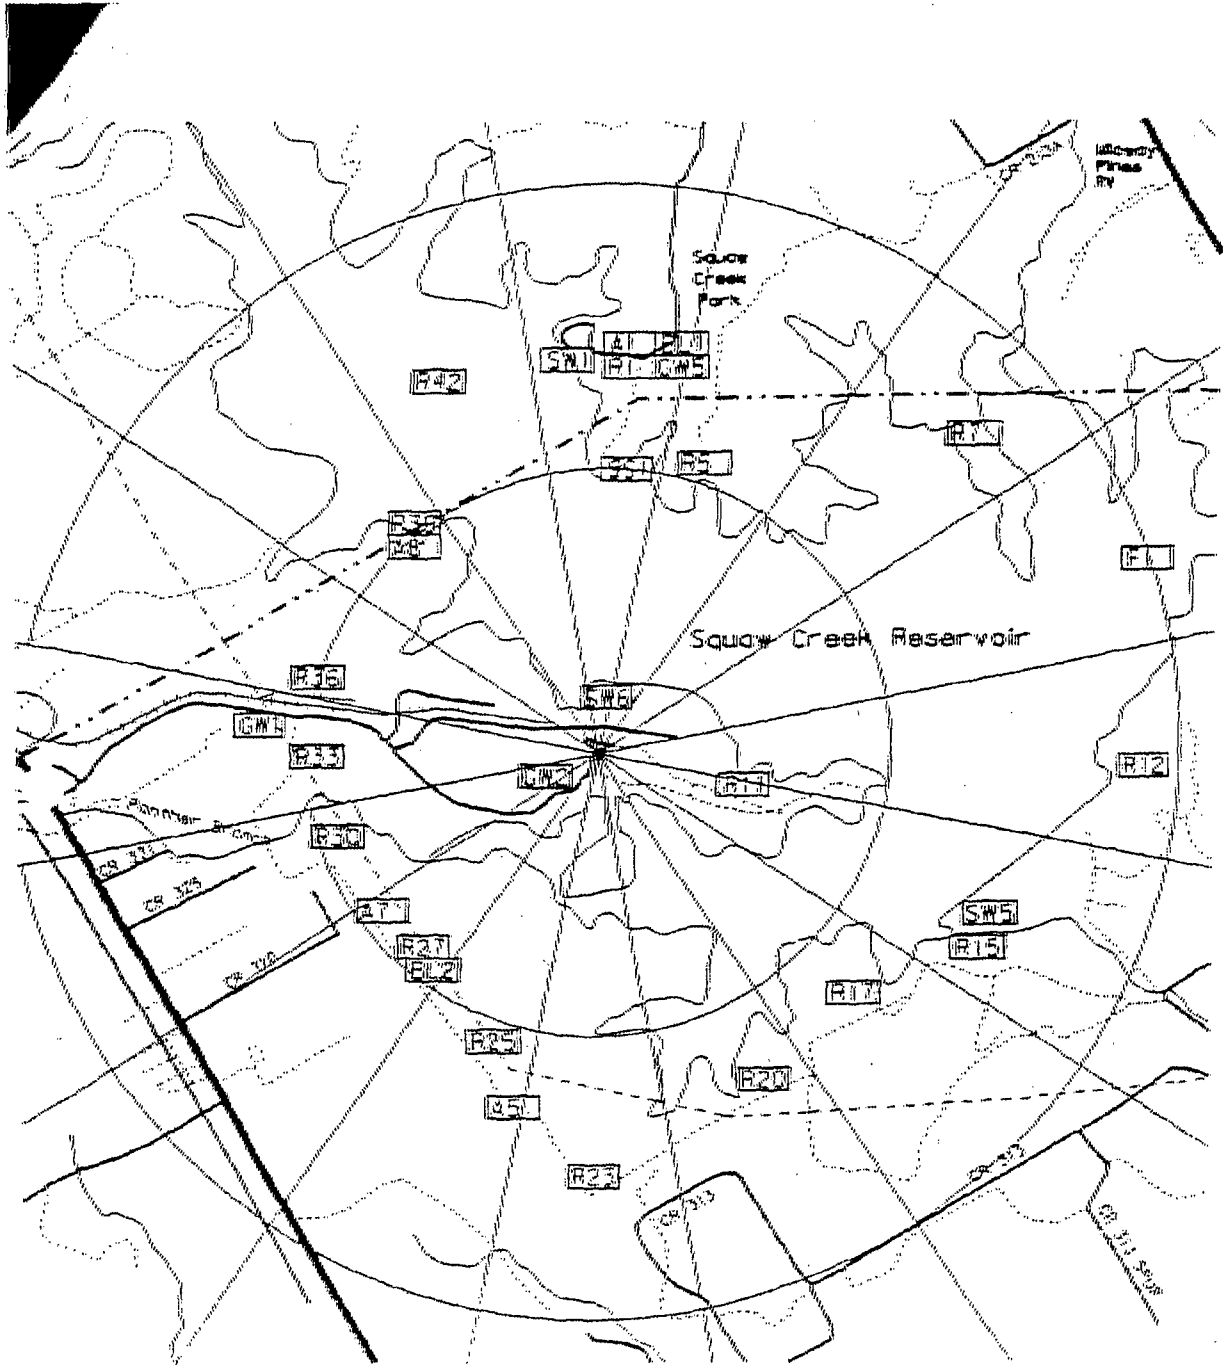

Environmental Sample Locations Map - 2 Mile Radius