

Attachment 2 to
ULNRC-05508

Attachment 2

APA-ZZ-01003
Offsite Dose Calculation Manual



CALLAWAY PLANT OFF-SITE DOSE CALCULATION MANUAL

OCTOBER 11, 2007



CALLAWAY PLANT
ADMINISTRATIVE PROCEDURE
APA-ZZ-01003
OFF-SITE DOSE CALCULATION MANUAL

Minor Revision

This procedure contains the following:

Pages	<u>1</u>	Through	<u>65</u>
Attachments	<u> </u>	Through	<u> </u>
Tables	<u> </u>	Through	<u> </u>
Figures	<u> </u>	Through	<u> </u>
Appendices	<u> </u>	Through	<u> </u>
Checkoff Lists	<u> </u>	Through	<u> </u>

This procedure has checkoff list(s) maintained in the mainframe computer.

Conversion of commitments to TRS reference/hidden text completed by Revision Number:

Non-T/S Commitments

Table of Contents

1	PURPOSE AND SCOPE	1
2	LIQUID EFFLUENTS	2
2.1	Liquid Effluent Monitors	2
2.2	Calculation Of Liquid Effluent Monitor Setpoints	4
2.3	Liquid Effluent Concentration Measurements	6
2.4	Dose Due To Liquid Effluents	6
2.4.1	THE MAXIMUM EXPOSED INDIVIDUAL.....	6
2.4.2	CALCULATION OF DOSE FROM LIQUID EFFLUENTS.....	7
2.4.3	SUMMARY, CALCULATION OF DOSE DUE TO LIQUID EFFLUENTS.....	8
2.5	Liquid Radwaste Treatment System.....	8
2.6	Dose Factors	8
3	GASEOUS EFFLUENTS	13
3.1	Gaseous Effluent Monitors	13
3.2	Gaseous Effluent Monitor Setpoints	14
3.2.1	TOTAL BODY DOSE RATE SETPOINT CALCULATIONS	15
3.2.2	SKIN DOSE RATE SETPOINT CALCULATION	16
3.3	Calculation Of Dose And Dose Rate From Gaseous Effluents.....	16
3.3.1.1	DOSE RATE FROM NOBLE GASES.....	16
3.3.1.2	DOSE RATE FROM RADIONUCLIDES OTHER THAN NOBLE GASES.....	17
3.3.2	DOSE DUE TO GASEOUS EFFLUENTS	18
3.3.2.1	AIR DOSE DUE TO NOBLE GASES	18
3.3.2.2	DOSE DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES	19
3.4	Gaseous Radwaste Treatment System.....	20
3.5	DOSE FACTORS	20
4	DOSE AND DOSE COMMITMENT FROM URANIUM FUEL CYCLE SOURCES.....	44
4.1	Calculation Of Dose And Dose Commitment From Uranium Fuel Cycle Sources.....	44
4.1.1	IDENTIFICATION OF THE MEMBER OF THE PUBLIC.....	44
4.1.2	TOTAL DOSE TO THE NEAREST RESIDENT	44

Table of Contents

4.1.3	TOTAL DOSE TO THE CRITICAL RECEPTOR WITHIN THE SITE BOUNDARY	45
5	RADIOLOGICAL ENVIRONMENTAL MONITORING	49
5.1	Description Of The Radiological Environmental Monitoring Program	49
5.2	Performance Testing Of Environmental Thermoluminescence Dosimeters	49
6	DETERMINATION OF ANNUAL AVERAGE AND SHORT TERM ATMOSPHERIC DISPERSION PARAMETERS	49
6.1	Atmospheric Dispersion Parameters	49
6.1.1	LONG-TERM DISPERSION ESTIMATES	49
6.1.2	DETERMINATION OF LONG-TERM DISPERSION ESTIMATES FOR SPECIAL RECEPTOR LOCATIONS.....	50
6.1.3	SHORT TERM DISPERSION ESTIMATES.....	50
6.2	Annual Meteorological Data Processing.....	51
7	REPORTING REQUIREMENTS.....	58
7.1	Annual Radiological Environmental Operating Report.....	58
7.2	Annual RADIOACTIVE Effluent Release Report	58
8	IMPLEMENTATION OF ODCM METHODOLOGY (COMN 2791).....	59
9	RADIOACTIVE EFFLUENT CONTROLS (REC)	60
10	ADMINISTRATIVE CONTROLS.....	61
10.1	Major Changes To Liquid And Gaseous Radwaste Treatment Systems.....	61
10.2	Changes To The Offsite Dose Calculation Manual (ODCM) (COMN 2815).....	61
11	REFERENCES.....	62

Table of Contents

FIGURES

FIGURE 4.1 47

TABLES

TABLE 2.1 9
 TABLE 2.2 12
 TABLE 3.1 21
 TABLE 3.2 22
 TABLE 3.3 - INHALATION PATHWAY 24
 TABLE 3.3 - MEAT PATHWAY 26
 TABLE 3.3 - GRASS-COW-MILK PATHWAY 28
 TABLE 3.3 - GRASS-GOAT-MILK PATHWAY 30
 TABLE 3.3 - VEGETATION PATHWAY 32
 TABLE 3.4 - INHALATION PATHWAY 34
 TABLE 3.4 - MEAT PATHWAY 36
 TABLE 3.4 - GRASS-COW-MILK PATHWAY 38
 TABLE 3.4 - GRASS-GOAT-MILK PATHWAY 40
 TABLE 3.4 - VEGETATION PATHWAY 42
 TABLE 6.1 52
 TABLE 6.2 53
 TABLE 6.3 54
 TABLE 6.4 55
 TABLE 6.5 56
 TABLE 6.6 57

RECORD OF REVISIONS

Rev. No. 0 Date: March 1983

Rev. No. 1 Date: November, 1983

Revised to support the current RETS' submittal and to incorporate NRC Staff comments.

Rev. No. 2 Date: March, 1984

Revised to incorporate NRC Staff comments

Rev. No. 3 Date: June, 1985

Revised to incorporate errata identified by ULNRC00803 and changes to the Environmental Monitoring Program. Incorporate results of 1984 Land Use Census.

Rev. No. 4 Date: February, 1987

Minor clarifications, incorporated 31-day projected dose methodology. Change in the utilization of areas within the Site Boundary.

Rev. No. 5 Date: January, 1988

Minor clarifications, revised descriptions of liquid and gaseous rad monitors, revised liquid setpoint methodology to incorporate monitor background, revised dose calculations for 40CFR190 requirements, Revised Table 6 and Figures 5.1A and 5.1B to refine descriptions of environmental TLD stations, incorporated description of environmental TLD testing required by Reg. Guide 4.13, revised Tables 1, 2, 4 and 5 to add additional nuclides, deleted redundant material from Chapter 6.

Rev. No. 6 Date: May, 1989

Revised methodology for calculating maximum permissible liquid effluent discharge rates and liquid effluent discharge rates and liquid effluent monitor setpoints, provided methodology for calculating liquid effluent monitors response correction factors, provided an enhanced description of controls on liquid monitor background limits, provided additional liquid and gaseous dose conversion factors and bioaccumulation factors (Tables 1, 2, 4 & 5), provided description of the use of the setpoint required by **Technical Specification 4.9.4.2** during Core Alterations, added discussion of gaseous and liquid monitor setpoint selection in the event that the sample contains no detectable activity, added minimum holdup requirements for Waste Gas Decay tanks, revised dispersion parameters and accompanying description Per **FSAR Change Notice 88-42**.

APA-ZZ-01003

Rev. No. 0 Date: August, 1989

Radiological Effluent Technical Specifications were moved from the Callaway Plant Technical Specifications to Section 9.0, Radioactive Effluent Controls, of the ODCM Per **NRC Generic Letter 89-01**. At the same time, in order to formalize control of the entire ODCM, it was converted to **APA-ZZ-01003, OFF-SITE DOSE CALCULATION MANUAL**.

Rev. No. 1 Date: October, 1990

Revise Action 41 of Table 9.2-A to allow continued purging for 24 hours Per Amendment 20 to operating license, issued 4/10/87.

RECORD OF REVISIONS

Rev. No. 2 Date: May, 1991

Section 2.4.2 - Changed gross alpha analysis frequency from "each batch" to a monthly composite Per Table 9.3-A, and the Callaway Plant NPDES permit (reissued March 15, 1991).

Rev. No. 3 Date: June, 1993

Deleted HF-RE-45 and LE-RE-59 as effluent monitors. Revised table numbering for consistency with those in Section 9.0, deleted redundant material, incorporated 1992 Land Use Census results, moved LLD description to Attachment 1, moved REC Bases to Attachment 2. Deleted reporting requirements for solid radwaste, which are described in **APA-ZZ-01011**, PROCESS CONTROL PROGRAM. Addressed compliance with 10 CFR 20.1301. Revised the dilution flow rate to allow values other than 5000 gpm, based on dilution flow monitor setpoint. Revised "MPC" terminology to "ECV". Added Action 46 to REC 9.2 to clarify actions for inoperable mid and high range WRGM Channels. Revised references to be consistent with the revised 10 CFR 20. Added Appendix A. Revised Action 41 of Rec 9.2 and the operability requirements of GT-RE-22/33. Incorporated the revised R_i values in Tables 3.2 and 3.3. Added Section 6.2 and Table 6.5.

Rev. No. 4 Date: September, 1994

Increased the minimum channels OPERABLE requirement of REC 9.2 for GT-RE-22 & 33 from 1 channel to 2 channels. Revised Action 41 and the Bases for REC 9.2 accordingly. Incorporated the operability requirements from **Tech Spec 3.9.9** into the Action statement for clarity. (**Refer to CARS 199401176**).

Rev. No. 5 Date: February, 1995

Removed the REMP station locations. Removed particulate nuclides with a half-life of less than 8 days from Tables 3.2-3.4 and removed C^{14} , P^{32} , Ni^{63} , Te^{125m} , and from Tables 2.1, 2.2, 3.2, 3.3, and 3.4. Changed the reporting frequency of the Effluent Release Report from semiannual to annual. Removed the meat, milk and vegetable pathway dispersion parameters from Tables 6.1, 6.2, and 6.3, and clarified the applicability of the dispersion parameters and dose locations in Table 6.4. Relocated REC 9.1 and 9.2 to the FSAR. Revised footnotes 3 and 7 of Table 16.11-4 to require additional sampling of the Unit Vent in the event of a reactor power transient, only if the Unit Vent noble gas activity increases by a factor of 3 or greater. Added Section 4.1.3.1.3 for determination of dose due to the on-site storage of low level radioactive waste.

Rev. No. 6 Date September, 1996

Section 2: Added dose factors (A_i) for Ag^{110m} , Np^{237} , Pu^{238} , $Pu^{239/240}$, Pu^{241} , Am^{241} , Cm^{242} , and $Cm^{234/244}$ to Table 2.1, and Bioaccumulation Factors (Bf_i) for Ag, Pu, Am, and Cm to Table 2.2 due to a change in the liquid radwaste treatment process. Revised the description of the methodology for performing the 31 day dose projection in Section 2.5. Revised the maximum allowable background for HB-RE-18.

Section 3: Eliminated Y^{91m} and Tc^{99m} from Table 3.4 (Meat Pathway) due to a half-life of < 8 days. Substituted the phrase "more restrictive" in lieu of "lesser" in Section 3.2. Revised the definition of F_a in equation 3.1. Added description of use of samples to verify dose rates in Section 3.3.1.2. Augmented the definition of q_i in Section 3.3.2.1. Edited equations 3.13 and 3.14 and added equation 3.15 to clarify dose calculations. Revised the methodology for performing the 31 day dose projection in Section 3.4.

Section 4: Strengthened the discussion of the reevaluation of assumptions in Section 4.1.3.

Section 6: Added new table 6.6 to describe the selection and use of dispersion parameters during the preparation of the Effluent Release Report. Updated Tables 6.1 and 6.2 to reference the 1995 Land Use Census. There were no changes in the receptor locations.

RECORD OF REVISIONS

Section 8: Replaced the reference to **HDP-ZZ-04500** to a more generic reference to the plant operating procedures, due to change in organizational structure and responsibilities.

Section 9: (1) Eliminated 9.0.1 and 9.0.2 due to redundancy with **Technical Specifications 3.0.1 and 3.0.2**; (2) Revised Table 9.3-A to incorporate sampling and analysis requirements for TRU nuclides in liquid effluents; (3) Eliminated sampling of Fuel Building Exhaust from Table 16.11-4 and the associated footnotes due to redundancy with Unit Vent sampling; revised the continuous sampling requirements for the gaseous batch release points consistent with plant design; revised the H³ analysis frequency for Purges from weekly to "prior to each purge"; and, (4) Revised the air sampling station location criteria on Table 9.11-A and footnote # 1, and eliminated footnote #3 in order to be less generic and more descriptive of the parameters used in determining the station locations (See **CARS 199502280**). Revised the location requirements for milk and vegetables. Revised description of use of baseline samples to trigger gamma isotopic analysis in footnote #4, revised requirement for location of downstream sample station in footnote #6. Revised Surveillance Requirement 9.10.2.1 to eliminate liquid effluents from the surveillance. (5) Revised REC 9.5 and REC 9.9 to eliminate exceptions for partially tested effluents being released in excess of the respective limit.

Section 11: Added reference 11.14.13.

Attachment 2: Revised the Bases for REC 9.10 to support the elimination of liquid effluents from Surveillance 9.10.2.1.

The remaining changes are editorial in nature and have no technical impact.

(This revision implements **CARS 199502055**, **CARS 199600167**, **CARS 199600961**, **CARS 199502280**, and **CARS 199600986**).

Rev. No. 7 Date February, 1997

Section 9: (1) REC 9.5, "Liquid Radwaste Treatment System", Action statement: Eliminated reference to **COMN 1161**, (2) Table 9.11-A, items 4a (milk) and 4c (vegetation): revised to required control stations in the least prevalent wind direction. (See **CARS 199700166**)

Appendix A: revised the discussion relative to the appropriate gross alpha Effluent Concentration Value.

Rev. No. 8 Date May, 1997

Section 1: The Purpose and Scope was revised to describe the split of the ODCM into two sections Per **FSAR Change Notice 95-058**. Section 2: Sections 2.2 and 2.3 were revised to clarify the use of nuclide-specific alpha activity vice gross alpha activity for setpoint determination. Section 2.5 was revised to delete the description of the Liquid Radwaste Treatment System. Section 6: Tables 6.1, 6.2, and 6.3 were revised to reflect the results of the 1996 Annual Land Use Census. Section 7: The reporting requirements for the Annual Radiological Environmental Operating Report and the Effluent Release Report were relocated to the FSAR Per **FSAR Change Notice 95-058**. Section 9: REC's and the supporting Attachments 1 and 2 were relocated to the FSAR Per **FSAR Change Notice 95-058**. Appendix A: Appendix A was deleted. Editorial changes were made throughout the ODCM reflecting the relocation of the REC's to the FSAR.

RECORD OF REVISIONS

Rev. No. 9 Date March, 1998

Section 2.5: Revised projected liquid dose calculation to use previous 31 day cumulative doses.

Section 3.1.1: Added GL-RE-202, Laundry Decon Facility Dryer Exhaust Monitor. Added action to be taken when the particulate and/or iodine grab sampler is not operable. Section 3.2: Added setpoint calculation for GL-RE-202.

Section 3.2.1 and 3.3.2.2: Changes were made to correct typographical errors and have no technical impact.

Section 3.4: Revised projected gas dose calculation to use previous 31 day cumulative doses.

Section 3.5: Removed the word secular from "secular equilibrium" since the equilibrium mode could be secular or transient depending on the isotope. Table 6.2: Added Laundry Decon Facility Dryer Exhaust to title of table since these will be the dispersion factors used for this release point.

Rev. No. 10 Date December 20, 1999

Section 3.1: Added explanation that GL-RE-202 only monitors particulate. Section 3.2: Changed Laundry Decon Facility Exhaust Monitor setpoint to less than or equal to 2000 cpm above equilibrium background with a maximum allowed background of 2000 cpm as calculated in HPCI 99-05. Tables 6.1, 6.2, 6.3: Updated values as calculated in HPCI 99-02. Section 5.1: Defined how REMP sample locations were determined. Removed reference to Plant Operating manual since it no longer exists.

Rev. No. 11 Date December 22, 1999

Changes required to go from old Technical Specifications to Improved Technical Specifications.

Technical Specification 4.9.4.2 changed to **FSAR 16.11.2.4.1**. **Technical Specification 6.8.4.F** changed to **FSAR 16.11.4**. **Technical Specification 6.8.1.F** changed to **Improved Technical Specification 5.4.1**. **Technical Specification 6.14** changed to **Improved Technical Specification 5.5.1**. **Technical Specification 6.8.4.E** changed to **Improved Technical Specification 5.5.4**. **Technical Specification 6.9.1.6** changed to **Improved Technical Specification 5.6.2**. **Technical Specification 6.9.1.7** changed to **Improved Technical Specification 5.6.3**. Changed name of Annual Radiological Effluent Release Report to Effluent Release Report as stated in ITS. Added liquid releases are limited to 10 times the Appendix B, Table 2, Column 2 limits Per **FSAR CN 98-041** supporting implementation of ITS.

Rev. No. 12 Date December 01, 2000

Section 2.1 and 2.2.1: Updated 10CFR20, Appendix B, Table II, Column 2 reference to the new 10CFR20 format. Corrected typo for "f", flow setpoint should be undiluted waste flow rate. Section 3.2.1: Corrected typo, default value for safety factor should be 0.1. Section 5.1: Updated crosscheck program used to EML since EPA program is no longer available. Section 6.2: Added vertical height of highest adjacent building used to perform concurrent year annual average atmospheric dispersion (X/Q) calculations and reference for this value. This information should be documented in the ODCM. Added responsibility for validation of meteorological data, since responsibility has changed from engineering to HPTS. Section 10.1.1: Revised to require a summary of Major Radwaste System changes to be included in the annual report. This was done to be consistent with **FSAR 16.11.5.2**. Several changes were made throughout the procedure to correct typographical errors and have no technical impact.

Rev. No. 13 Date September 19, 2002

Section 3.2: Revised to implement the approved OL 1218, Rev. 1; License Amendment no. 152 allowing equipment hatch and emergency air lock to remain open during refueling activities (FSAR CN-01-030 and CN-02-049). The amendment eliminated FSAR 16.11.2.4.1B and subsequently deleted the core alteration setpoint value 5.0 E-3 $\mu\text{Ci/cc}$ for Containment Purge Monitors GT-RE-22 and GT-RE-33. The alarm setpoints for the Containment Purge Monitors will be based on the methodology described in Section 3 of the ODCM.

RECORD OF REVISIONS

Rev. No. 14 Date June 17, 2003

Revised Table 2.1 (Ingestion Dose Commitment Factor for Adult Age Group) to include dose factors for Pr-144. (CARS 200303251). Revised Section 4.1.3.1 to adjust the Farmer's residence (critical receptor) from 3830 meters in the SE sector to 2897 meters in the NNW sector. The Farmer's residence (critical receptor) was changed in 2002 to a location directly across the street from the Nearest residence. For conservatism and ease in calculation, Table 6.1 and 6.2 were revised making the distances and dispersion parameters for the Farmer's residence (critical receptor) and the Nearest residence the same. Revised section 7.2 to reference Table 6.6. Revised section 10.2.2 to remove the requirement for QA department review of the ODCM for reach revision (CARS 200304509). Added a reference to 11.14.14, Calculation HPCI 03-004 (Rev. 0), "Calculation of Liquid Effluent Dose Commitment factor for Pr-144 (Ait) for the Adult Age Group", June, 2003.

Rev. No. 15 Date December 9, 2004

Reformatted references to FSAR-SP Chapter 16.11 in section 1, 2.1.1, 2.1.2, 2.2.1, 2.3, 2.4.2, 2.5, 2.6, 3.1, 3.2.1, 3.5, 5.1, 7.1, 7.2, and 9. References to Ni-63 were added to section 2.2.1 for the calculation of ECVSUM, section 2.3, and described in section 2.6 since it is an exception to non gamma emitters not listed in FSAR-SP Table 16.11-1. Ni-63 was added to the ODCM based on previous 10 CFR 61 sample results and 2nd quarter liquid composite analyses.

Consolidated references listed in section 2.4.2 and 2.6 for the site related ingestion dose commitment factors (A_{IT}) of Table 2.1 into HPCI 04-06, Revision 1. References to HPCIs 95-004 (Ref: 11.14.13) and 03-004 (Ref: 11.14.14) were deleted and replaced with HPCI 04-06, Revision 1 which is now listed as Ref: 11.14.13. Added Ni-63 and Sb-122 to Table 2.1- INGESTION DOSE COMMITMENT FACTOR (A_{IT}) FOR ADULT AGE GROUP. Revised the reference for Table 2.1 to 11.14.13.

Corrected a typo in section 3.1.2 referring to the Radwaste Building Vent system designator as GT vs. GH (CAR 200406851).

References 11.19 and 11.20 were deleted in section 4.1.3.1.1. Reference 11.18 was changed to MICROSSHIELD (Grove Engineering, Inc.) vs. ISOSHLD. Reference 11.24 in section 4.1.3.1.3 was corrected to 11.18.

Section 5.1 and 5.2 were revised to indicate that the Radiological Environmental Monitoring Program TLDs will be processed and provided by a vendor laboratory beginning in the first quarter of 2005. Section 5.2 was revised to delete reference 11.14.10 which refers to HPCI 88-08, "Performance Testing of the Environment TLD System at Callaway Plant", August 1989.

Reference 11.14.7 was corrected with HPCI 87-10 vs. 88-10. Revised Table 6.1, Note (c) to reference FSAR TABLE 2.3-83 vs. TABLE 2.3-82. Revised Table 6.1 and 6.2 Note (b) to reference data is from the 2002 Land Use Census.

Changed and/or corrected the Skin dose factor (L_i) units in Table 3.1 (Dose Factor for exposure to a Semi-Infinite Cloud of Noble Gases) to mrem/yr per $\mu\text{Ci}/\text{m}^3$. Revised section 3.3.1.2: Added units for the term BR in m^3/yr .

Removed paragraph in section 3.3.2.2 that describes actions for implementing the use of appropriate $R_{i,j}$ values. This paragraph was taken directly from section 5.3.1 of NUREG 0133, U.S. Nuclear Regulatory Commission, "Preparation of Radiological Effluent Technical Specification for Nuclear Power Plants", USNRC NUREG-0133, Washington, D.C. 20555, October, 1978. This paragraph does not apply since the use of pathways is already considered as described in sections 4.1.2 and 4.1.3.1.

RECORD OF REVISIONS

Revised note (c) of Table 6.1 to reference FSAR-SA Table 2.3-83. Revised note (a) from Table 6.1 to reference FSAR-SA Table 2.3-82. In addition, revised Note (b) from Table 6.1 to reference data taken from the 2002 Land Use Census. Revised Notes (a) and (c) from Table 6.2 to reference FSAR-SA Table 2.3-84 and 2.3-81 respectively.

Added a 0.95 conservatism factor to section 2.2.3 – Calculation of Liquid Effluent Monitor Setpoint. This will conservatively reduce the liquid monitor setpoint to further ensure the section 4.4.1 of NUREG 0133, U.S. Nuclear Regulatory Commission, "Preparation of Radiological Effluent Technical Specification for Nuclear Power Plants", USNRC NUREG-0133, Washington, D.C. 20555, October, 1978 which states the alarm and trip setpoints for each instrument channel listed in Table 3.3-11 should be provided and should correspond to a value(s) which represents a safe margin of assurance that the instantaneous liquid release limit of 10 CFR Part 20 is not exceeded.

A determination was made IAW T/S 5.5.1 that the associated changes with Revision 15 maintain the levels of radioactive effluent control required by 10 CFR 20.1302, 40 CFR 190, 10 CFR 50.36a, and 10 CFR 50 Appendix I, and not adversely impact the accuracy or reliability of effluent, dose, or setpoint calculations.

Rev. No. 16 Date December 1, 2005

Section 5.1 was revised to remove an invalid requirement that a third-party laboratory performing analysis specifically state the Interlaboratory Comparison (crosscheck) requirements for the Radiological Environmental Monitoring Program (REMP) contract lab. Reference 11.14.14 to Reg. Guide 4.15, Quality Assurance for Radiological Monitoring Programs (Normal Operations) – Effluent Streams and the Environment, was added to provide supporting documentation for contract lab Interlaboratory Comparison requirements. Additional information on REMP contract lab participation in Interlaboratory Comparisons was also added in section 5.1. (CAR 200500891)

Revised reference 11.14.7 by adding normalization and standardization factors for radionuclides listed in Table 2.1 of the ODCM that were not included in the original calculation.

Added section 4.1.3.1.4 to describe direct dose to a MEMBER OF THE PUBLIC from the Old Steam Generator Storage Facility (OSGSF).

Reworded step 4.1.2 to describe the sources of direct radiation from "outside storage tanks" to "storage of radioactive material".

Revised section 4.1.3.1.2 to include and describe direct dose calculations in support of Modification 03-1008, Equipment Hatch Platform and Missile Shield Modification. Reference 11.14.10 was added to reference direct dose calculation to the MEMBER OF THE PUBLIC from Modification 03-1008.

Revised section 4.1.3.1.3 to include and describe direct dose calculations from the Radwaste Yard RAM storage and Stores II. Reference 11.19 and 11.20 were added to reference direct dose calculations to the MEMBER OF THE PUBLIC from RAM storage at Stores II and the Radwaste Yard.

A determination was made IAW T/S 5.5.1 that the associated changes with Revision 16 maintain the levels of radioactive effluent control required by 10 CFR 20.1302, 40 CFR 190, 10 CFR 50.36a, and 10 CFR 50 Appendix I, and not adversely impact the accuracy or reliability of effluent, dose, or setpoint calculations.

RECORD OF REVISIONS

Rev. No. 17 Date March 14, 2007

Section 2.4.1 was revised Per CAR 200701309 to state that no potable water intakes exist within 10 miles of the plant discharge point. This is due to the fact that the Annual Land Use Census ensures no newly developed potable water intakes within 10 miles of the plant discharge Per FSAR-SP Chapter 16.11.4.2c.

Section 2.4.2 was revised to add reference 11.6.18 to CAR 200700053 which provides documentation of an evaluation of the site specific mixing factor for liquid effluents. Modification 06-0061 reconfigured the plant discharge terminus at the Missouri River. The modification was completed in January 2007.

Rev. No. 18 Date October 11, 2007

Revised Table 6.5 was revised to reflect upgrade/replacement of the primary meteorological tower instrumentation as per Modification Package 04-1020.

Section 2.4.2 was revised to remove the discussion of the nearest municipal potable water intake downstream from the liquid effluent discharge point as being located near the city of St. Louis, Missouri, approximately 78 miles downstream. Since the Land Use Census annually verifies no potable water intakes within 10 miles – this discussion was deemed inappropriate in describing methodology for calculating dose to the public from liquid effluents. In addition, the distance referenced as not having potable water intakes downstream of the plant discharge was changed for consistency with section 2.4.1 and the Land Use Census.

OFF-SITE DOSE CALCULATION MANUAL

1

PURPOSE AND SCOPE

The OFF-SITE DOSE CALCULATION MANUAL (ODCM) describes the methodology and parameters used in the calculation of off-site doses resulting from radioactive gaseous and liquid effluents, in the calculation of gaseous and liquid effluent monitoring Alarm/Trip Setpoints, and in the conduct of the Radiological Environmental Monitoring Program. The ODCM also contains the Radioactive Effluent Controls and Radiological Environmental Monitoring Program required by T/S AC 5.5.4 and FSAR-SP CHAPTER 16.11.4, and descriptions of the information that should be included in the Annual Radiological Environmental Operating and Effluent Release Reports required by T/S AC 5.6.2 and T/S AC 5.6.3.

Compliance with the Radiological Effluent Controls limits demonstrates compliance with the limits of 10 CFR 20.1301. (Ref. 11.1.1, 11.2.1, 11.23.3)

The ODCM consists of two parts: FSAR-SP CHAPTER 16.11 which contains the Radiological Effluent Controls (REC's), and APA-ZZ-01003, which contains the methodology and parameters used to implement the REC's.

2 LIQUID EFFLUENTS

2.1 LIQUID EFFLUENT MONITORS

Gross radioactivity monitors which provide for automatic termination of liquid effluent releases are present on the liquid effluent lines. Flow rate measurement devices are present on the liquid effluent lines and the discharge line (cooling tower blowdown). Setpoints, precautions, and limitations applicable to the operation of the Callaway Plant liquid effluent monitors are provided in the appropriate Plant Procedures. Setpoint values are calculated to assure that alarm and trip actions occur prior to exceeding ten times the Effluent Concentration Values (ECV) limits in 10 CFR Part 20 at the release point to the UNRESTRICTED AREA. The calculated alarm and trip action setpoints for the liquid effluent line monitors and flow measuring devices must satisfy the following equation:

$$\frac{cf}{F + f} \leq C$$

Where:

- C = The liquid effluent concentration value (ECV) implementing REC 16.11.1.1 for the site in ($\mu\text{Ci/ml}$).
- c = The setpoint, in ($\mu\text{Ci/ml}$), of the radioactivity monitor measuring the radioactivity concentration in the effluent line prior to dilution and subsequent release; the setpoint, which is inversely related to the volumetric flow of the effluent line and directly related to the volumetric flow of the dilution stream plus the effluent steam, represents a value, which, if exceeded, would result in concentrations exceeding ten times the values of 10 CFR Part 20 Appendix B, Table 2, Column 2, in the UNRESTRICTED AREA.
- f = The undiluted waste flow rate as measured at the radiation monitor location, in volume per unit time, but in the same units as F, below.
- F = The dilution water flow rate setpoint as measured prior to the release point, in volume per unit time. {If (F) is large compared to (f), then $F + f \cong F$ }.

(Ref. 11.8.1)

If no dilution is provided then $c \leq C$.

The radioactive liquid waste stream is diluted by the plant discharge line prior to entry into the Missouri River. Normally, the dilution flow is obtained from the cooling tower blowdown, but should this become unavailable, the plant water treatment facility supplies the necessary dilution flow via a bypass line. The limiting concentration which corresponds to the liquid radwaste effluent monitor setpoint is to be calculated using methodology from the expression above.

Thus, the expression for determining the setpoint of the liquid radwaste effluent line monitor becomes:

$$c \leq \frac{C(F + f)}{f} (\mu\text{Ci / ml}) \quad (2.2)$$

The alarm/trip setpoint calculations are based on the minimum dilution flow rate (corresponding to the dilution flow rate setpoint), the maximum effluent stream flow rate, and the actual isotopic analysis. Due to the possibility of a simultaneous release from more than one release pathway, a portion of the total site release limit is allocated to each pathway. The determination and usage of the allocation factor is discussed in Section 2.2. In the event the alarm/trip setpoint is reached, an evaluation will be performed using actual dilution and effluent flow values and actual isotopic analysis to ensure that REC 16.11.1.1 limits were not exceeded.

2.1.1 Continuous Liquid Effluent Monitors

The radiation detection monitor associated with continuous liquid effluent releases is (Ref. 11.6.1, 11.6.2):

<u>Monitor I.D.</u>	<u>Description</u>
BM-RE-52	Steam Generator Blowdown Discharge Monitor

The Steam Generator Blowdown discharge is not considered to be radioactive unless radioactivity has been detected by the associated effluent radiation monitor or by laboratory analysis. The sampling frequency, minimum analysis frequency, and type of analysis performed are Per **FSAR-SP TABLE 16.11-1**.

2.1.2 Radioactive Liquid Batch Release Effluent Monitors

The radiation monitor which is associated with the liquid effluent batch release system is (Ref. 11.6.4):

<u>Monitor I.D.</u>	<u>Description</u>
HB-RE-18	Liquid Radwaste Discharge Monitor

This effluent stream is normally considered to be radioactive. The sampling frequency, minimum analysis frequency, and the type of analysis performed are Per **FSAR-SP TABLE 16.11-1**.

2.2 CALCULATION OF LIQUID EFFLUENT MONITOR SETPOINTS

The dependence of the setpoint (c), on the radionuclide distribution, yields, calibration, and monitor parameters, requires that several variables be considered in setpoint calculations. (Ref. 11.8.1)

2.2.1 Calculation of the ECV Sum

The isotopic concentration of the release(s) being considered must be determined. This is obtained from the analyses required per FSAR-SP TABLE 16.11-1, and is used to calculate an ECV sum (ECVSUM):

$$ECVSUM = \left(\sum_{i = g, a, s, t, f} (C_i) / (ECV_i) \right) \quad (2.3)$$

Where:

- C_g = the concentration of each measured gamma emitting nuclide observed by gamma-ray spectroscopy of the waste sample.
- C_a^* = the concentration of Np^{237} , Pu^{238} , $Pu^{239/240}$, Pu^{241} , Am^{241} , Cm^{242} , & $Cm^{243/244}$, in the quarterly composite sample.
- C_s^* = the measured concentrations of Sr-89 and Sr-90 as determined by analysis of the quarterly composite sample.
- C_t = the measured concentration of H-3 in the waste sample.
- C_f^* = the measured concentration of Fe-55 & Ni-63 as determined by analysis of the quarterly composite sample.

ECV_g , ECV_s , ECV_a , ECV_f , ECV_t = are ten times the limiting concentrations of the appropriate radionuclides from 10 CFR 20, Appendix B, Table 2, Column 2. For dissolved or entrained noble gases, the concentration shall be limited to 2×10^{-4} μ Ci/ml total activity.

For the case $ECVSUM \leq 1$, the monitor tank effluent concentration meets the limits of REC 16.11.1.1 without dilution and the effluent may be released at any desired flow rate. If $ECVSUM > 1$ then dilution is required to ensure compliance with the concentration limits REC 16.11.1.1. If simultaneous releases are occurring or are anticipated, an allocation fraction, N, must be applied so that available dilution flow may be apportioned among simultaneous discharge pathways. The value of N may be any value between 0 and 1 for a particular discharge point, provided that the sum of the allocation fractions for all discharge points must be ≤ 1 .

2.2.2 Calculation of the Maximum Permissible Liquid Effluent Discharge Flowrate

The maximum permissible liquid effluent discharge flowrate is calculated by:

$$f_{max} \leq (F + f_p) (SF) (N) \div (ECVSUM) \quad (2.4)$$

Where:

- f_{max} = maximum permissible liquid effluent discharge flowrate, (in gallons/minute);
- f_p = the expected undiluted liquid effluent flowrate, in gpm.
- N = the allocation fraction which apportions dilution flow among simultaneous discharge pathways (see discussion above)
- SF = the safety factor; an administrative factor used to compensate for statistical fluctuations and errors of measurements. This factor also provides a margin of safety in the calculation of the maximum liquid effluent discharge flowrate (f_{max}). The value of SF should be ≤ 1 .

F & ECVSUM, are previously defined.

The dilution water supply is furnished with a flow monitor which isolates the liquid effluent discharge if the dilution flow rate falls below its setpoint value.

* Values for these concentrations are based on previous composite sample analyses as required by FSAR-SP Table 16.11-1.

In the event that f_{max} is less than f_p , then the value of f_{max} is substituted into the equation for f_p , and a new value of f_{max} is calculated. This substitution is performed for three iterations in order to calculate the correct value of f_{max} .

2.2.3

Calculation Of Liquid Effluent Monitor Setpoint

The liquid effluent monitors are NaI(Tl) based systems and respond primarily to gamma radiation. Accordingly, their setpoint is based on the total concentration of gamma emitting nuclides in the effluent:

$$c = (BKG + (\sum (C_g) \div SF))(0.95) = \mu\text{Ci/ml} \quad (2.5)$$

Where:

c = the monitor setpoint as previously defined, in ($\mu\text{Ci/ml}$);

BKG = the monitor background prior to discharge, in ($\mu\text{Ci/ml}$) adjusted for monitor response.

0.95 = Conservatism to ensure monitor trips prior to REC 16.11.1.1

($\sum (C_g)$ and SF are as previously defined.

The monitor's background is controlled at an appropriate limit to ensure adequate sensitivity. Utilizing the methodology of ANSI N13.10-1974 (Ref. 11.21), the background must be maintained at a value of less than or equal to $9\text{E-}6 \mu\text{Ci/ml}$ (relative to Cs-137) in order to detect a change of $4\text{E-}7 \mu\text{Ci/ml}$ of Cs-137. (Ref. 11.25).

In the event that there is no detectable gamma activity in the effluent or if the value of ($\sum(C_g) \div SF$) is less than the background of the monitor, then the monitor setpoint will be set at twice the current background of the monitor.

As previously stated, the monitor's response is dependent on the gamma emitting radionuclide distribution of the effluent. Accordingly, a new database conversion factor is calculated for each release based upon the results of the gamma spectrometric analysis of the effluent sample and the measured response of the monitor to National Institute of Standards and Technology (NIST) traceable calibration sources:

$$DBCF_C = \left(\sum (C_g) \right) \div (\text{CMR}) \times (\text{ECF}) \quad (2.6)$$

$DBCF_C$ = the monitor data base conversion factor which converts count rate into concentration ($\mu\text{Ci/ml}$);

CMR = the calculated response of the radiation monitor to the liquid effluent;

ECF = the conversion factor for Cs-137, which converts count rate into concentration ($\mu\text{Ci/ml}$).

C_g is as previously defined.

The new value of the $DBCF_C$ is calculated and entered into the monitor data base prior to each discharge. A more complete discussion of the derivation and calculation of the CMR is given in reference 11.14.7.

2.3

LIQUID EFFLUENT CONCENTRATION MEASUREMENTS

Liquid batch releases are discharged as a discrete volume and each release is authorized based upon the sample analysis and the dilution flow rate existing in the discharge line at the time of release. To assure representative sampling, each liquid monitor tank is isolated and thoroughly mixed by recirculation of tank contents prior to sample collection. The methods for mixing, sampling, and analyzing each batch are outlined in applicable plant procedures. The allowable release rate limit is calculated for each batch based upon the pre-release analysis, dilution flow-rate, and other procedural conditions, prior to authorization for release. The liquid effluent discharge is monitored prior to entering the dilution discharge line and will automatically be terminated if the pre-selected alarm/trip setpoint is exceeded. Concentrations are determined primarily from the gamma isotopic and H-3 analyses of the liquid batch sample. For Sr⁸⁹, Sr⁹⁰, Fe⁵⁵, Ni⁶³, Np²³⁷, Pu²³⁸, Pu^{239/240}, Pu²⁴¹, Am²⁴¹, Cm²⁴², & Cm^{243/244}, the measured concentrations from the previous quarterly composite analyses are used until laboratory results become available. Composite samples are collected for each batch release and analyzed in accordance with FSAR-SP TABLE 16.11-1. The dose from liquids discharged as continuous releases is calculated by utilizing the last measured values of samples in accordance with FSAR-SP TABLE 16.11-1.

2.4

DOSE DUE TO LIQUID EFFLUENTS

2.4.1

THE MAXIMUM EXPOSED INDIVIDUAL

The cumulative dose determination considers the dose contributions from the maximum exposed individual's consumption of fish and potable water, as appropriate. Normally, the adult is considered to be the maximum exposed individual. (Ref. 11.8.3)

The Callaway Plant's liquid effluents are discharged to the Missouri River. As there are no potable water intakes within 10 miles of the discharge point (Ref. 11.7.1, 11.6.6), this pathway does not require routine evaluation. Therefore, the dose contribution from fish consumption is expected to account for more than 95% of the total man-rem dose from discharges to the Missouri River. Dose from recreational activities is expected to contribute the additional 5%, which is considered to be negligible. (Ref. 11.6.7)

2.4.2

CALCULATION OF DOSE FROM LIQUID EFFLUENTS

The dose contributions for the total time period.

$$\sum_{l=1}^m \Delta t_l$$

are calculated at least once each 31 days and a cumulative summation of the total body and individual organ doses is maintained for each calendar quarter. Dose is calculated for all radionuclides identified in liquid effluents released to UNRESTRICTED AREAS using the following expression (Ref. 11.8.3):

$$D_{\tau} = \sum_i \left[A_{i\tau} \sum_{l=1}^m \Delta t_l C_{il} F_l \right] \quad (2.12)$$

Where:

D_{τ} = the cumulative dose commitment to the total body or any organ, τ , from the liquid effluents for the total period

$$\sum_{l=1}^m \Delta t_l$$

in mrem.

Δt_l = the length of the l the time period over which C_{il} and F_l are averaged for all liquid releases, in hours. Δt_l corresponds to the actual duration of the release(s).

C_{il} = the average measured concentration of radionuclide, i , in undiluted liquid effluent during time period Δt_l from any liquid release, in ($\mu\text{Ci/ml}$).

$A_{i\tau}$ = the site related ingestion dose commitment factor to the total body or any organ τ for each identified principal alpha, gamma and beta emitter listed in FSAR-SP TABLE 16.11-1, (in mrem/hr) per ($\mu\text{Ci/ml}$). The calculation of the $A_{i\tau}$ values given in Table 2.1 are detailed in Ref. 11.14.13.

F_l = the near field average dilution factor for C_{il} during any liquid effluent release:

$$F_l = \frac{f_{\max}}{(F + f_{\max}) 89.77}$$

Where:

f_{\max} = maximum undiluted effluent flow rate during the release

F = average dilution flow

89.77 = site specific applicable factor for the mixing effect of the discharge structure. (Ref. 11.5.1, 11.14.12, and 11.6.18)

The term C_{il} is the undiluted concentration of radioactive material in liquid waste at the common release point determined in accordance with REC 16.11.1.1, Table 16.11-1, "Radioactive Liquid Waste Sampling and Analysis Program". All dilution factors beyond the sample point(s) are included in the F_l term.

As there are currently no potable water intakes within 10 river miles of the discharge point, the drinking water pathway is not included in dose estimates to the maximally exposed individual. Should future potable water intakes be constructed within 10 river miles downstream of the discharge point, then this manual will be revised to include this pathway in dose estimates. (Ref. 11.6.6).

2.4.3

SUMMARY, CALCULATION OF DOSE DUE TO LIQUID EFFLUENTS

The dose contribution for the total time period

$$\sum_{t=1}^m \Delta t_t$$

is determined by calculation at least once per 31 days and a cumulative summation of the total body and organ doses is maintained for each calendar quarter. The projected dose contribution from liquid effluents for which radionuclide concentrations are determined by periodic composite and grab sample analysis, may be approximated by using the last measured value. Dose contributions are determined for all radionuclides identified in liquid effluents released to UNRESTRICTED AREAS. Nuclides which are not detected in the analyses are reported as "less than" the nuclide's Minimum Detectable Activity (MDA) and are not reported as being present at the Lower Level of Detection (LLD) level for that nuclide. The "less than" values are not used in the dose calculations.

2.5

LIQUID RADWASTE TREATMENT SYSTEM

The LIQUID RADWASTE TREATMENT SYSTEM is described in FSAR-SP CHAPTER 11.2.

The OPERABILITY of the LIQUID RADWASTE TREATMENT SYSTEM ensures this system will be available for use when liquids require treatment prior to their release to the environment. OPERABILITY is demonstrated through compliance with REC 16.11.1.1. and 16.11.1.2.

Projected doses due to liquid releases to UNRESTRICTED AREAS are determined each 31 days. The prior 31 day period is used to calculate compliance. This may be modified as appropriate to account for changes in radwaste treatment which may have a significant effect on the projected doses.

2.6

DOSE FACTORS

The dose conversion factors provided in Table 2.1 were derived from the appropriate dose conversion factors of Regulatory Guide 1.109, Table 2.2 and other sources as necessary (Ref: 11.14.13) Non-gamma emitting nuclides, other than those listed in FSAR-SP TABLE 16.11-1 and Ni-63 will not be considered.

TABLE 2.1

INGESTION DOSE COMMITMENT FACTOR (A_{it}) FOR ADULT AGE GROUP

<u>Nuclide</u>	(mrem/hr) per (μ Ci/ml)						
	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GI-LLI</u>
H-3	No Data	2.26E-01	2.26E-01	2.26E-01	2.26E-01	2.26E-01	2.26E-01
Be-7	1.31E-02	2.98E-02	1.45E-02	No Data	3.15E-02	No Data	5.17E+00
Na-24	4.07E+02	4.07E+02	4.07E+02	4.07E+02	4.07E+02	4.07E+02	4.07E+02
Cr-51	No Data	No Data	1.27E+00	7.61E-01	2.81E-01	1.69E+00	3.20E+02
Mn-54	No Data	4.38E+03	8.35E+02	No Data	1.30E+03	No Data	1.34E+04
Mn-56	No Data	1.10E+02	1.95E+01	No Data	1.40E+02	No Data	3.51E+03
Fe-55	6.58E+02	4.55E+02	1.06E+02	No Data	No Data	2.54E+02	2.61E+02
Fe-59	1.04E+03	2.44E+03	9.36E+02	No Data	No Data	6.82E+02	8.14E+03
Co-57	No Data	2.09E+01	3.48E+01	No Data	No Data	No Data	5.31E+02
Co-58	No Data	8.92E+01	2.00E+02	No Data	No Data	No Data	1.81E+03
Co-60	No Data	2.56E+02	5.65E+02	No Data	No Data	No Data	4.81E+03
Ni-63	3.11E+04	2.16E+03	1.04E+03	No Data	No Data	No Data	4.50E+02
Ni-65	1.26E+02	1.64E+01	7.49E+00	No Data	No Data	No Data	4.17E+02
Cu-64	No Data	9.97E+00	4.68E+00	No Data	2.51E+01	No Data	8.50E+02
Zn-65	2.32E+04	7.37E+04	3.33E+04	No Data	4.93E+04	No Data	4.64E+04
Zn-69	4.93E+01	9.43E+01	6.56E+00	No Data	6.13E+01	No Data	1.42E+01
Br-82	No Data	No Data	2.27E+03	No Data	No Data	No Data	2.60E+03
Br-83	No Data	No Data	4.04E+01	No Data	No Data	No Data	5.82E+01
Br-84	No Data	No Data	5.24E+01	No Data	No Data	No Data	4.11E-04
Br-85	No Data	No Data	2.15E+00	No Data	No Data	No Data	1.01E-15
Rb-86	No Data	1.01E+05	4.71E+04	No Data	No Data	No Data	1.99E+04
Rb-88	No Data	2.90E+02	1.54E+02	No Data	No Data	No Data	4.00E-09
Rb-89	No Data	1.92E+02	1.35E+02	No Data	No Data	No Data	1.12E-11
Sr-89	2.21E+04	No Data	6.35E+02	No Data	No Data	No Data	3.55E+03
Sr-90	5.44E+05	No Data	1.34E+05	No Data	No Data	No Data	1.57E+04
Sr-91	4.07E+02	No Data	1.64E+01	No Data	No Data	No Data	1.94E+03
Sr-92	1.54E+02	No Data	6.68E+00	No Data	No Data	No Data	3.06E+03
Y-90	5.76E-01	No Data	1.54E-02	No Data	No Data	No Data	6.10E+03
Y-91M	5.44E-03	No Data	2.11E-04	No Data	No Data	No Data	1.60E-02
Y-91	8.44E+00	No Data	2.26E-01	No Data	No Data	No Data	4.64E+03
Y-92	5.06E-02	No Data	1.48E-03	No Data	No Data	No Data	8.86E+02
Y-93	1.60E-01	No Data	4.43E-03	No Data	No Data	No Data	5.09E+03
Zr-95	2.40E-01	7.70E-02	5.21E-02	No Data	1.21E-01	No Data	2.44E+02
Zr-97	1.33E-02	2.68E-03	1.22E-03	No Data	4.04E-03	No Data	8.30E+02
Nb-95	4.47E+02	2.48E+02	1.34E+02	No Data	2.46E+02	No Data	1.51E+06
Mo-99	No Data	1.03E+02	1.96E+01	No Data	2.34E+02	No Data	2.39E+02
Tc-99M	8.87E-03	2.51E-02	3.19E-01	No Data	3.81E-01	1.23E-02	1.48E+01
Tc-101	9.12E-03	1.31E-02	1.29E-01	No Data	2.37E-01	6.72E-03	3.95E-14

TABLE 2.1 (Cont'd)

INGESTION DOSE COMMITMENT FACTOR (A_{it}) FOR ADULT AGE GROUP

<u>Nuclide</u>	(mrem/hr) per (μ Ci/ml)						
	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GI-LLI</u>
Ru-103	4.43E+00	No Data	1.91E+00	No Data	1.69E+01	No Data	5.17E+02
Ru-105	3.69E-01	No Data	1.46E-01	No Data	4.76E+00	No Data	2.26E+02
Ru-106	6.58E+01	No Data	8.33E+00	No Data	1.27E+02	No Data	4.26E+03
Cd-109	No Data	5.55E+02	1.94E+01	No Data	5.31E+02	No Data	5.60E+03
Ag-110m	8.85E-01	8.18E-01	4.86E-01	No Data	1.61E+00	No Data	3.34E+02
Sn-113	5.67E+04	1.61E+03	3.26E+03	9.19E+02	No Data	No Data	1.69E+05
Sb-122	5.48E-01	1.12E-02	1.66E-01	7.73E-03	No Data	2.94E-01	NoData
Sb-124	6.70E+00	1.27E-01	2.66E+00	1.63E-02	No Data	5.22E+00	1.90E+02
Sb-125	4.29E+00	4.79E-02	1.02E+00	4.36E-03	No Data	3.30E+00	4.72E+01
Te-127m	6.48E+03	2.32E+03	7.90E+02	1.66E+03	2.63E+04	No Data	2.17E+04
Te-127	1.05E+02	3.78E+01	2.28E+01	7.80E+01	4.29E+02	No Data	8.31E+03
Te-129M	1.10E+04	4.11E+03	1.74E+03	3.78E+03	4.60E+04	No Data	5.54E+04
Te-129	3.01E+01	1.13E+01	7.33E+00	2.31E+01	1.26E+02	No Data	2.27E+01
Te-131M	1.66E+03	8.10E+02	6.75E+02	1.28E+03	8.21E+03	No Data	8.04E+04
Te-131	1.89E+01	7.88E+00	5.96E+00	1.55E+01	8.26E+01	No Data	2.67E+00
Te-132	2.41E+03	1.56E+03	1.47E+03	1.72E+03	1.50E+04	No Data	7.38E+04
I-130	2.71E+01	8.01E+01	3.16E+01	6.79E+03	1.25E+02	No Data	6.89E+01
I-131	1.49E+02	2.14E+02	1.22E+02	7.00E+04	3.66E+02	No Data	5.64E+01
I-132	7.29E+00	1.95E+01	6.82E+00	6.82E+02	3.11E+01	No Data	3.66E+00
I-133	5.14E+01	8.87E+01	2.70E+01	1.30E+04	1.55E+02	No Data	7.97E+01
I-134	3.81E+00	1.03E+01	3.70E+00	1.79E+02	1.64E+01	No Data	9.01E-03
I-135	1.59E+01	4.17E+01	1.54E+01	2.75E+03	6.68E+01	No Data	4.70E+01
Cs-134	2.98E+05	7.09E+05	5.79E+05	No Data	2.29E+05	7.61E+04	1.24E+04
Cs-136	3.12E+04	1.23E+05	8.86E+04	No Data	6.85E+04	9.38E+03	1.40E+04
Cs-137	3.82E+05	5.22E+05	3.42E+05	No Data	1.77E+05	5.89E+04	1.01E+04
Cs-138	2.64E+02	5.22E+02	2.59E+02	No Data	3.84E+02	3.79E+01	2.23E-03
Ba-139	9.29E-01	6.62E-04	2.72E-02	No Data	6.19E-04	3.75E-04	1.65E+00
Ba-140	1.94E+02	2.44E-01	1.27E+01	No Data	8.30E-02	1.40E-01	4.00E+02
Ba-141	4.51E-01	3.41E-04	1.52E-02	No Data	3.17E-04	1.93E-04	2.13E-10
Ba-142	2.04E-01	2.10E-04	1.28E-02	No Data	1.77E-04	1.19E-04	2.87E-19
La-140	1.50E-01	7.54E-02	1.99E-02	No Data	No Data	No Data	5.54E+03
La-142	7.66E-03	3.48E-03	8.68E-04	No Data	No Data	No Data	2.54E+01
Ce-141	2.24E-02	1.52E-02	1.72E-03	No Data	7.04E-03	No Data	5.79E+01
Ce-143	3.95E-03	2.92E+00	3.23E-04	No Data	1.29E-03	No Data	1.09E+02
Ce-144	1.17E+00	4.88E-01	6.27E-02	No Data	2.90E-01	No Data	3.95E+02
Pr-143	5.51E-01	2.21E-01	2.73E-02	No Data	1.27E-01	No Data	2.41E+03
Pr-144	1.80E-03	7.48E-04	9.16E-05	No Data	4.22E-04	No Data	2.59E-10
Nd-147	3.76E-01	4.35E-01	2.60E-02	No Data	2.54E-01	No Data	2.09E+03
Eu-154	3.68E+01	4.52E+00	3.22E+00	No Data	2.17E+01	No Data	3.28E+03
Hf-181	4.00E-02	1.94E-01	1.80E-02	No Data	4.18E-02	No Data	2.21E+02
W-187	2.96E+02	2.47E+02	8.65E+01	No Data	No Data	No Data	8.10E+04

TABLE 2.1 (Cont'd)

INGESTION DOSE COMMITMENT FACTOR (A_{ir}) FOR ADULT AGE GROUP

<u>Nuclide</u>	(mrem/hr) per (μ Ci/ml)						
	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GI-LLI</u>
Np-237	3.28E+04	2.85E+03	1.33E+03	No Data	9.86E+03	No Data	1.90E+03
Np-239	2.85E-02	2.80E-03	1.54E-03	No Data	8.74E-03	No Data	5.75E+02
Pu-238	5.70E+03	8.03E+02	1.43E+02	No Data	6.13E+02	No Data	6.12E+02
Pu-239*	6.59E+03	8.88E+02	1.60E+02	No Data	6.80E+02	No Data	5.68E+02
Pu-241	1.38E+02	7.07E+00	2.78E+00	No Data	1.28E+01	No Data	1.17E+01
Am-241	4.90E+04	1.72E+04	3.24E+03	No Data	2.44E+04	No Data	4.44E+03
Cm-242	1.23E+03	1.26E+03	8.20E+01	No Data	3.72E+02	No Data	4.74E+03
Cm-243**	3.82E+04	1.44E+04	2.24E+03	No Data	1.05E+04	No Data	4.67E+03

*Includes Pu-240 contribution

**Includes Cm-244 contribution

TABLE 2.2
BIOACCUMULATION FACTOR (Bf_i)^(a)
 (pCi/kg) per (pCi/liter)

<u>Element</u>	<u>Bf_i</u> <u>Fish (Freshwater)</u>
H	9.0 E - 01
Be	2.0 E + 00
Na	1.0 E + 02
Cr	2.0 E + 02
Mn	4.0 E + 02
Fe	1.0 E + 02
Co	5.0 E + 01
Ni	1.0 E + 02
Cu	5.0 E + 01
Zn	2.0 E + 03
Br	4.2 E + 02
Rb	2.0 E + 03
Sr	3.0 E + 01
Y	2.5 E + 01
Zr	3.3 E + 00
Nb	3.0 E + 04
Mo	1.0 E + 01
Tc	1.5 E + 01
Ru	1.0 E + 01
Rh	1.0 E + 01
Ag	2.3 E + 00
Cd	2.0 E + 02
Sn	3.0 E + 03
Sb	1.0 E + 00
Te	4.0 E + 02
I	1.5 E + 01
Cs	2.0 E + 03
Ba	4.0 E + 00
La	2.5 E + 01
Ce	1.0 E + 00
Pr	2.5 E + 01
Nd	2.5 E + 01
Eu	2.5 E + 01
Hf	3.3 E + 00
W	1.2 E + 03
Np	1.0 E + 01
Pu	3.5 E + 00
Am	2.5 E + 01
Cm	2.5 E + 01

^(a) Values from Regulatory Guide 1.109, Rev. 1, Table A-1 and Reference 11.14.13.

3 GASEOUS EFFLUENTS

3.1 GASEOUS EFFLUENT MONITORS

Noble gas activity monitors are present on the containment building ventilation system, plant unit ventilation system, and radwaste building ventilation system.

The alarm/trip (alarm & trip) setpoint for any gaseous effluent radiation monitor is determined based on the instantaneous noble gas total body and skin dose rate limits of REC 16.11.2.1, at the SITE BOUNDARY location with the highest annual average X/Q value.

Each gaseous monitor channel is provided with a two level system which provides sequential alarms on increasing radioactivity levels. These setpoints are designated as alert setpoints and alarm/trip setpoints. (Ref. 11.6.3)

The radiation monitor alarm/trip setpoints for each release point are based on the radioactive noble gases in gaseous effluents. It is not considered practicable to apply instantaneous alarm/trip setpoints to integrating radiation monitors sensitive to radioiodines, radioactive materials in particulate form and radionuclides other than noble gases. The exception is GL-RE-202. The only effluent released from the Laundry Decon Facility Dryer Exhaust is in the particulate form. Conservative assumptions may be necessary in establishing setpoints to account for system variables, such as the measurement system efficiency and detection capabilities during normal, anticipated, and unusual operating conditions, variability in release flow and principal radionuclides, and the time lag between alarm/trip action and the final isolation of the radioactive effluent. (Ref. 11.8.5) **FSAR-SP TABLE 16.11-6** provides the instrument surveillance requirements, such as calibration, source checking, functional testing, and channel checking.

3.1.1 Continuous Release Gaseous Effluent Monitors

The radiation detection monitors associated with continuous gaseous effluent releases are (Ref. 11.6.8, 11.6.9):

<u>Monitor I.D.</u>	<u>Description</u>
GT-RE-21	Unit Vent
GH-RE-10	Radwaste Building Vent
GL-RE-202	Laundry Decon Facility Dryer Exhaust Monitor

Each of the above continuously monitors gaseous radioactivity concentrations downstream of the last point of potential influent, and therefore measures effluents and not inplant concentrations.

The unit vent monitor continuously monitors the effluent from the unit vent for gaseous radioactivity. The unit vent, via ventilation exhaust systems, continuously purges various tanks and sumps normally containing low-level radioactive aerated liquids that can potentially generate airborne activity. The exhaust systems which supply air to the unit vent are from the fuel building, auxiliary building, the access control area, the containment purge, and the condenser air discharge.

The unit vent monitor provides alarm functions only, and does not terminate releases from the unit vent.

The Radwaste Building ventilation effluent monitor continuously monitors for gaseous radioactivity in the effluent duct downstream of the exhaust filter and fans. The flow path provides ventilation exhaust for all parts of the building structure and components within the building and provides a discharge path for the waste gas decay tank release line. These components represent potential sources for the release of gaseous and air particulate and iodine activities in addition to the drainage sumps, tanks, and equipment purged by the waste processing system.

This monitor will isolate the waste gas decay tank discharge line upon a high gaseous radioactivity alarm.

The Laundry Decon Facility Dryer Exhaust Monitor continuously monitors the effluent of the dryer exhaust for particulate radioactivity during operation of the dryers. This effluent point is designed to release an insignificant quantity of radioactivity. The items to be placed in the dryers are typically washed before drying removing most of the radioactive material. The dryer effluent then passes through a HEPA filter before being sampled and released.

The Laundry Decon Facility Dryer Exhaust Monitor will secure the dryers and exhaust fans and isolate the dryer effluent upon a high radioactivity alarm or for a monitor failure.

The continuous Unit Vent and Radwaste Building Vent gaseous effluent monitor setpoints are established using the methodology described in Section 3.2. Since there are two continuous gaseous effluent release points, a fraction of the total dose rate limit (DRL) will be allocated to each release point. Neglecting the batch releases, the plant Unit Vent monitor has been allocated 0.7 DRL and the Radwaste Building Vent monitor has been allocated 0.3 DRL. These allocation factors may be changed as required to support plant operational needs, but shall not be allowed to exceed unity (i.e., 1.0). Therefore, a particular monitor reaching the setpoint would not necessarily mean the dose rate limit at the SITE BOUNDARY is being exceeded; the alarm only indicates that the specific release point is contributing a greater fraction of the dose rate limit than was allocated to the associated monitor, and will necessitate an evaluation of both systems.

For a loss of all isokinetic sampling and/or all heat tracing for the Unit Vent or Radwaste Building Vent grab samplers, one hour is allowed to restore a sampler to service. If sampling cannot be restored within one hour, all batch releases and ventilation not required for the operation of the plant should be secured. The best available sampling should be maintained during this period and normal sampling returned to service as soon as possible.

3.1.2

Batch Release Gaseous Monitors

The radiation monitors associated with batch release gaseous effluents are (Ref. 11.6.9, 11.6.10, 11.6.11):

<u>Monitor I.D.</u>	<u>Description</u>
GT-RE-22	Containment Purge System
GT-RE-33	
GH-RE-10	Radwaste Building Vent

The Containment Purge System continuously monitors the containment purge exhaust duct during purge operations for gaseous radioactivity. The primary purpose of these monitors is to isolate the containment purge system on high gaseous activity via the ESFAS.

The sample points are located outside the containment between the containment isolation dampers and the containment purge filter adsorber unit.

The Radwaste Building Vent monitor was previously described.

A pre-release isotopic analysis is performed for each batch release to determine the identity and quantity of the principal radionuclides. The alarm/trip setpoint(s) is adjusted accordingly to ensure that the limits of REC 16.11.2.1 are not exceeded.

3.2

GASEOUS EFFLUENT MONITOR SETPOINTS

The alarm/trip setpoint for Unit Vent and Radwaste Building Vent gaseous effluent monitors is determined based on the more restrictive of the total body dose rate (equation 3.1) and skin dose rate (equation 3.3), as calculated for the SITE BOUNDARY.

The alarm trip setpoint for the Laundry Decon Facility Exhaust Monitor is set to less than or equal to 2,000 cpm above equilibrium background. The maximum allowed background is 2,000 cpm as discussed in reference 11.27.

3.2.1

TOTAL BODY DOSE RATE SETPOINT CALCULATIONS

To ensure that the limits of REC 16.11.2.1 are met, the alarm/trip setpoint based on the total body dose rate is calculated according to:

$$S_{tb} \leq D_{tb} R_{tb} F_s F_a \quad (3.1)$$

Where:

- S_{tb} = the alarm/trip setpoint based on the total body dose rate ($\mu\text{Ci/cc}$).
- D_{tb} = REC 16.11.2.1 limit of 500 mrem/yr, conservatively interpreted as a continuous release over a one year period.
- F_s = the safety factor; a conservative factor used to compensate for statistical fluctuations and errors of measurement. (For example, $F_s = 0.5$ corresponds to a 100% variation.) Default value is $F_s = 0.1$.
- F_a = the allocation factor which will modify the required dilution factor such that simultaneous gaseous releases may be made without exceeding the limits of REC 16.11.2.1.
- R_{tb} = factor used to convert dose rate to the effluent concentration as measured by the effluent monitor, in ($\mu\text{Ci/cc}$) per (mrem/yr) to the total body, determined according to:

$$R_{tb} = C \div \left[\overline{X/Q} \sum_i K_i Q_i \right] \quad (3.2)$$

Where:

- C = monitor reading of a noble gas monitor corresponding to the sample radionuclide concentrations for the release. Concentrations are determined in accordance with **FSAR-SP TABLE 16.11-4**. The mixture of radionuclides determined via grab sampling of the effluent stream or source is correlated to a calibration factor to determine monitor response. The monitor response is based on concentrations, not release rate, and is in units of ($\mu\text{Ci/cc}$).
- $\overline{X/Q}$ = the highest calculated annual average relative concentration for any area at or beyond the SITE BOUNDARY in (sec/m^3). Refer to Tables 6.1, 6.2 and 6.4.
- K_i = the total body dose factor due to gamma emissions for each identified noble-gas radionuclide, in (mrem/yr) per ($\mu\text{Ci/m}^3$). (Table 3.1)
- Q_i = rate of release of noble gas radionuclide, i , in ($\mu\text{Ci/sec}$).

Q_i is calculated as the product of the ventilation path flow rate and the measured activity of the effluent stream as determined by sampling.

3.2.2

SKIN DOSE RATE SETPOINT CALCULATION

To ensure that the limits of REC 16.11.2.1 are met, the alarm/trip setpoint based on the skin dose rate is calculated according to:

$$S_s \leq D_s R_s F_s F_a \quad (3.3)$$

Where:

F_s and F_a are as previously defined.

S_s = the alarm/trip setpoint based on the skin dose rate.

D_s = REC 16.11.2.1 limit of 3000 mrem/yr, conservatively interpreted as a continuous release over a one year period.

R_s = factor used to convert dose rate to the effluent concentration as measured by the effluent monitor, in ($\mu\text{Ci/cc}$) per (mrem/yr) to the skin, determined according to:

$$R_s = C \div \left[(\overline{X/Q}) \sum_i (L_i + 1.1 M_i) Q_i \right] \quad (3.4)$$

Where:

L_i = the skin dose factor due to beta emissions for each identified noble gas radionuclide, in (mrem/yr) per ($\mu\text{Ci/m}^3$).

1.1 = conversion factor: 1 mrad air dose = 1.1 mrem skin dose.

M_i = the air dose factor due to gamma emissions for each identified noble gas radionuclide, in (mrad/yr) per ($\mu\text{Ci/m}^3$).

C , $(\overline{X/Q})$ and Q_i are previously defined.

3.3

CALCULATION OF DOSE AND DOSE RATE FROM GASEOUS EFFLUENTS

3.3.1

Dose Rate from Gaseous Effluents

The following methodology is applicable to the location (SITE BOUNDARY or beyond) characterized by the values of the parameter (X/Q) which results in the maximum total body or skin dose rate. In the event that the analysis indicates a different location for the total body and skin dose limitations, the location selected for consideration is that which minimizes the allowable release values. (Ref. 11.8.6)

The factors K_i , L_i , and M_i relate the radionuclide airborne concentrations to various dose rates, assuming a semi-infinite cloud model.

3.3.1.1

DOSE RATE FROM NOBLE GASES

The release rate limit for noble gases is determined according to the following general relationships (Ref. 11.8.6):

$$D_{tb} = \sum_i [K_i ((\overline{X/Q}) Q_i)] \leq 500 \text{ mrem / yr} \quad (3.5)$$

$$D_s = \sum_i [(L_i + 1.1 M_i) ((\overline{X/Q}) Q_i)] \leq 3000 \text{ mrem / yr} \quad (3.6)$$

Where:

Q_i = The release rate of noble gas radionuclides, i , in gaseous effluents, from all vent releases in ($\mu\text{Ci/sec}$).

1.1 = Units conversion factor; 1 mrad air dose = 1.1 mrem skin dose.

L_i , M_i , K_i , $(\overline{X/Q})$, D_{tb} and D_s are as previously identified.

3.3.1.2

DOSE RATE FROM RADIONUCLIDES OTHER THAN NOBLE GASES

The release rate limit for Iodine-131 and Iodine-133, for tritium, and for all radioactive materials in particulate form with half lives greater than 8 days is determined according to (Ref. 11.8.7):

$$D_o = \sum_i R_i \left[\overline{X/Q} \right] Q_i \leq 1500 \text{ mrem / yr} \quad (3.7)$$

Where:

D_o = Dose rate to any critical organ, in (mrem/yr).

R_i = Dose parameter for radionuclides other than noble gases for the **inhalation pathway** for the child, based on the critical organ, in (mrem/yr) per ($\mu\text{Ci}/\text{m}^3$).

Q_i = The release rate of radionuclides other than noble gases, i, in gaseous effluents, from all vent releases in ($\mu\text{Ci}/\text{sec}$).

$\overline{(X/Q)}$ is as previously defined.

The dose parameter (R_i) includes the internal dosimetry of radionuclide, i, and the receptor's breathing rate, which are functions of the receptor's age. The child age group has been selected as the limiting age group. All radiodines are assumed to be released in elemental form (ref. 11.8.7).

R_i values were calculated according to (Ref. 11.8.8):

$$R_i = K' (BR) \text{DFA}_i \quad (3.8)$$

Where:

K' = Units conversion factor: $1\text{E}06 \text{ pCi}/\mu\text{Ci}$

BR = The breathing rate. (Regulatory Guide 1.109, Table E-5). (m^3/yr)

DFA_i = The maximum organ inhalation dose factor for the ith radionuclide, in (mrem/pCi). The total body is considered as an organ in the selection of DFA_i . (Ref. 11.11.5 and 11.14.4)

The results of periodic tritium, iodine and particulate samples of the Unit Vent and Radwaste Vent are used to verify the dose rate limit was not exceeded for the period during which the samples or composite samples were obtained.

3.3.2 DOSE DUE TO GASEOUS EFFLUENTS

3.3.2.1 AIR DOSE DUE TO NOBLE GASES

The air dose at the SITE BOUNDARY due to noble gases is calculated according to the following methodology (Ref. 11.8.9):

During any calendar quarter, for gamma radiation:

$$D_g = 3.17E-08 \sum_i [M_i (\overline{X/Q}) q_i] \leq 5 \text{ mrad} \quad (3.9)$$

During any calendar quarter, for beta radiation:

$$D_b = 3.17E-08 \sum_i [N_i (\overline{X/Q}) q_i] \leq 10 \text{ mrad} \quad (3.10)$$

During any calendar year, for gamma radiation:

$$D_g = 3.17E-08 \sum_i [M_i (\overline{X/Q}) q_i] \leq 10 \text{ mrad} \quad (3.11)$$

During any calendar year, for beta radiation:

$$D_b = 3.17E-08 \sum_i [N_i (\overline{X/Q}) q_i] \leq 20 \text{ mrad} \quad (3.12)$$

Where:

D_g = Air dose in mrad, from gamma radiation due to noble gases released in gaseous effluent.

D_b = Air dose in mrad, from beta radiation due to noble gases released in gaseous effluents.

N_i = The air dose factor due to beta emissions for each identified noble gas radionuclide, i , in (mrad/yr) per ($\mu\text{Ci}/\text{m}^3$).

q_i = The releases of noble gas radionuclides, i , in gaseous effluents, for all gaseous releases in (μCi). Releases are cumulative over the calendar quarter or year as appropriate. q_i is calculated as the product of the ventilation flow rate and the measured activity of the effluent stream as determined by sampling.

$3.17E-08$ = The inverse of the number of seconds per year.

$\overline{X/Q}$ & M_i are as previously defined.

3.3.2.2

DOSE DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES

The dose to a MEMBER OF THE PUBLIC from Iodine-131 and 133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents released to areas at and beyond the SITE BOUNDARY, is calculated according to the following expressions:

During any calendar quarter:

$$\sum_j D_{i,j} \leq 7.5 \text{ mrem} \quad (3.13)$$

During any calendar year:

$$\sum_j D_{i,j} \leq 15 \text{ mrem} \quad (3.14)$$

For each pathway, j, (i.e., for inhalation, ground plane, meat, cow- milk, goat- milk, and vegetation) $D_{i,j}$ is calculated according to the expression:

$$D_{i,j} = 3.17\text{E-}8 \sum_i R_{i,i,j} [W_j q_i] \quad (3.15)$$

Where:

- $D_{i,j}$ = Dose in mrem, to a MEMBER OF THE PUBLIC from radionuclides other than noble gases, from pathway j, received by organ I (including total body).
- $R_{i,i,j}$ = The dose factor for each identified radionuclide, i, in $\text{m}^2(\text{mrem}/\text{yr})$ per $(\mu\text{Ci}/\text{sec})$ or (mrem/yr) per $(\mu\text{Ci}/\text{m}^3)$ as appropriate, for the pathway j, and exposed organ I, appropriate to the age group of the critical MEMBER OF THE PUBLIC receptor.
- W_j = $(\overline{X/Q})$ for the inhalation and tritium pathways, in (sec/m^3) . Refer to Tables 6.1, 6.2, and 6.4 for applicability.
- W_j = $(\overline{D/Q})$ for the food and ground plane pathways, in (meters^{-2}) . Refer to Tables 6.1, 6.2 and 6.4 for applicability.
- $(\overline{D/Q})$ = the average relative deposition of the effluent at or beyond the SITE BOUNDARY, considering depletion of the plume during transport.
- q_i = The releases of radioiodines, radioactive materials in particulate form, and radionuclides other than noble gases, i, in gaseous effluents, for all gaseous releases in (μCi) . Releases are cumulative over the calendar quarter or year as appropriate. q_i is calculated as the product of ventilation flow rate and the measured activity of the effluent stream as determined by sampling.
- $3.17 \text{ E-}08$ = The inverse of the number of seconds per year.

$\overline{X/Q}$ is as previously defined.

Although the annual average relative concentration $(\overline{X/Q})$ and the average relative deposition rate $(\overline{D/Q})$ are generally considered to be at the approximate receptor location in lieu of the SITE BOUNDARY for these calculations, it is acceptable to consider the ingestion, inhalation, and ground plane pathways to coexist at the location of the nearest residence with the highest value of $(\overline{X/Q})$. (Ref. 11.8.9) The Total Body dose from ground plane deposition is added to the dose for each individual organ. (Ref. 11.11.3)

3.4 GASEOUS RADWASTE TREATMENT SYSTEM

The gaseous radwaste treatment system and the ventilation exhaust system are available for use whenever gaseous effluents require treatment prior to being released to the environment. The gaseous radwaste treatment system is designed to allow for the retention of all gaseous fission products to be discharged from the reactor coolant system. The retention system consists of eight (8) waste gas decay tanks. Normally, waste gases will be retained for at least 60 days prior to discharge. These systems will provide reasonable assurance that the releases of radioactive materials in gaseous effluents will be kept ALARA:

The OPERABILITY of the gaseous radwaste treatment system ensures this system will be available for use when gases require treatment prior to their release to the environment. OPERABILITY is demonstrated through compliance with REC 16.11.2.1, 16.11.2.2, and 16.11.2.3.

Projected doses (gamma air, beta air, and organ dose) due to gaseous effluents at or beyond the SITE BOUNDARY are determined each 31 days. The prior 31 day period is used to calculate compliance. This may be modified as appropriate to account for changes in radwaste treatment which may have a significant effect on the projected doses.

3.5 DOSE FACTORS

The dose conversion factors provided in the following tables were derived from the appropriate dose conversion factors in Regulatory Guide 1.109 and other sources as necessary (Ref: 11.14.9 and 11.14.11). Per USNRC guidance, particulate nuclides with a half-life of less than 8 days are not considered (Ref: 11.24). Y-90, La-140, and Pr-144 are included because the parent half-life is greater than 8 days, and equilibrium is assumed. Non-gamma emitting nuclides not listed in FSAR-SP TABLE 16.11-4 are also not considered. (COMN 43121)

TABLE 3.1DOSE FACTOR FOR EXPOSURE TO A SEMI-INFINITE CLOUD OF NOBLE GASES

Radionuclide	Total Body Dose Factor	Skin Dose Factor	Gamma Air Dose Factor	Beta Air Dose Factor
	K_i (mrem/yr) per ($\mu\text{Ci}/\text{m}^3$)	L_i (mrem/yr) per ($\mu\text{Ci}/\text{m}^3$)	M_i (mrad/yr) per ($\mu\text{Ci}/\text{m}^3$)	N_i (mrad/yr) per ($\mu\text{Ci}/\text{m}^3$)
Kr-83m	7.56 E-02	----	1.93 E+01	2.88 E+02
Kr-85m	1.17E+03	1.46E+03	1.23 E+03	1.97 E+03
Kr-85	1.61 E+01	1.34 E+03	1.72 E+01	1.95 E+03
Kr-87	5.92 E+03	9.73 E+03	6.17 E+03	1.03 E+04
Kr-88	1.47 E+04	2.37 E+03	1.52 E+04	2.93 E+03
Kr-89	1.66 E+04	1.01 E+04	1.73 E+04	1.06 E+04
Kr-90	1.56 E+04	7.29 E+03	1.63 E+04	7.83 E+03
Xe-131m	9.15 E+01	4.76 E+02	1.56 E+02	1.11 E+03
Xe-133m	2.51 E+02	9.94 E+02	3.27 E+02	1.48 E+03
Xe-133	2.94 E+02	3.06 E+02	3.53 E+02	1.05 E+03
Xe-135m	3.12 E+03	7.11 E+02	3.36 E+03	7.39 E+02
Xe-135	1.81 E+03	1.86 E+03	1.92 E+03	2.46 E+03
Xe-137	1.42 E+03	1.22 E+04	1.51 E+03	1.27 E+04
Xe-138	8.83 E+03	4.13 E+03	9.21 E+03	4.75 E+03
Ar-41	8.84 E+03	2.69 E+03	9.30 E+03	3.28 E+03

TABLE 3.2
PATHWAY DOSE FACTORS (R_T) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES

<u>NUCLIDE</u>	<u>TOTAL BODY</u>	<u>SKIN</u>
Be-7	2.24E+07	3.21E+07
Cr-51	4.66E+06	5.51E+06
Mn-54	1.39E+09	1.63E+09
Fe-59	2.73E+08	3.21E+08
Co-57	2.98E+08	4.37E+08
Co-58	3.79E+08	4.44E+08
Co-60	2.15E+10	2.53E+10
Zn-65	7.47E+08	8.59E+08
Rb-86	8.99E+06	1.03E+07
Sr-89	2.16E+04	2.51E+04
Y-90	5.36E+06	6.32E+06
Y-91	1.07E+06	1.21E+06
Zr-95	2.45E+08	2.84E+08
Nb-95	2.50E+08	2.94E+08
Ru-103	1.08E+08	1.26E+08
Ru-106	4.22E+08	5.07E+08
Ag-110m	3.44E+09	4.01E+09
Cd-109	3.76E+07	1.54E+08
Sn-113	1.43E+07	4.09E+07
Sb-124	8.74E+08	1.23E+09
Sb-125	3.57E+09	5.19E+09
Te-127m	9.17E+04	1.08E+05
Te-129m	1.98E+07	2.31E+07

TABLE 3.2
PATHWAY DOSE FACTORS (R_f) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES

<u>NUCLIDE</u>	<u>TOTAL BODY</u>	<u>SKIN</u>
I-130	5.51E+06	6.69E+06
I-131	1.72E+07	2.09E+07
I-132	1.25E+06	1.47E+06
I-133	2.45E+06	2.98E+06
I-134	4.47E+05	5.31E+05
I-135	2.53E+06	2.95E+06
Cs-134	6.85E+09	8.00E+09
Cs-136	1.51E+08	1.71E+08
Cs-137	1.03E+10	1.20E+10
Ba-140	2.05E+07	2.35E+07
La-140	1.47E+08	1.66E+08
Ce-141	1.37E+07	1.54E+07
Ce-144	6.96E+07	8.04E+07
Pr-144	4.35E+07	5.00E+07
Nd-147	8.39E+06	1.01E+07
Eu-154	2.21E+10	3.15E+10
Hf-181	1.97E+08	2.82E+08

TABLE 3.3
CHILD PATHWAY DOSE FACTORS (R_f) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES

Inhalation Pathway
(mrem/yr) per ($\mu\text{Ci}/\text{m}^3$)

<u>Nuclide</u>	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GI-LLI</u>
H-3	ND	1.12E+03	1.12E+03	1.12E+03	1.12E+03	1.12E+03	1.12E+03
Be-7	8.47E+02	1.44E+03	9.25E+02	ND	ND	6.47E+04	2.55E+03
Cr-51	ND	ND	1.54E+02	8.55E+01	2.43E+01	1.70E+04	1.08E+03
Mn-54	ND	4.29E+04	9.51E+03	ND	1.00E+04	1.58E+06	2.29E+04
Fe-55	4.74E+04	2.52E+04	7.77E+03	ND	ND	1.11E+05	2.87E+03
Fe-59	2.07E+04	3.34E+04	1.67E+04	ND	ND	1.27E+06	7.07E+04
Co-57	ND	9.03E+02	1.07E+03	ND	ND	5.07E+05	1.32E+04
Co-58	ND	1.77E+03	3.16E+03	ND	ND	1.11E+06	3.44E+04
Co-60	ND	1.31E+04	2.26E+04	ND	ND	7.07E+06	9.62E+04
Zn-65	4.25E+04	1.13E+05	7.03E+04	ND	7.14E+04	9.95E+05	1.63E+04
Rb-86	ND	1.98E+05	1.14E+05	ND	ND	ND	7.99E+03
Sr-89	5.99E+05	ND	1.72E+04	ND	ND	2.16E+06	1.67E+05
Sr-90	1.01E+08	ND	6.44E+06	ND	ND	1.48E+07	3.43E+05
Y-90	4.11E+03	ND	1.11E+02	ND	ND	2.62E+05	2.68E+05
Y-91	9.14E+05	ND	2.44E+04	ND	ND	2.63E+06	1.84E+05
Zr-95	1.90E+05	4.18E+04	3.70E+04	ND	5.96E+04	2.23E+06	6.11E+04
Nb-95	2.35E+04	9.18E+03	6.55E+03	ND	8.62E+03	6.14E+05	3.70E+04
Ru-103	2.79E+03	ND	1.07E+03	ND	7.03E+03	6.62E+05	4.48E+04
Ru-106	1.36E+05	ND	1.69E+04	ND	1.84E+05	1.43E+07	4.29E+05
Ag-110m	1.69E+04	1.14E+04	9.14E+03	ND	2.12E+04	5.48E+06	1.00E+05
Cd-109	ND	5.48E+05	2.59E+04	ND	4.96E+05	1.05E+06	2.78E+04
Sn-113	1.13E+05	3.12E+03	8.62E+03	2.33E+03	ND	1.46E+06	2.26E+05
Sb-124	5.74E+04	7.40E+02	2.00E+04	1.26E+02	ND	3.24E+06	1.64E+05
Sb-125	9.84E+04	7.59E+02	2.07E+04	9.10E+01	ND	2.32E+06	4.03E+04
Te-127m	2.49E+04	8.55E+03	3.02E+03	6.07E+03	6.36E+04	1.48E+06	7.14E+04
Te-129m	1.92E+04	6.85E+03	3.04E+03	6.33E+03	5.03E+04	1.76E+06	1.82E+05

TABLE 3.3
CHILD PATHWAY DOSE FACTORS (R_f) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES

Inhalation Pathway
(mrem/yr) per ($\mu\text{Ci}/\text{m}^3$)

<u>Nuclide</u>	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GI-LLI</u>
I-130	8.18E+03	1.64E+04	8.44E+03	1.85E+06	2.45E+04	ND	5.11E+03
I-131	4.81E+04	4.81E+04	2.73E+04	1.62E+07	7.88E+04	ND	2.84E+03
I-132	2.12E+03	4.07E+03	1.88E+03	1.94E+05	6.25E+03	ND	3.20E+03
I-133	1.66E+04	2.03E+04	7.70E+03	3.85E+06	3.38E+04	ND	5.48E+03
I-134	1.17E+03	2.16E+03	9.95E+02	5.07E+04	3.30E+03	ND	9.55E+02
I-135	4.92E+03	8.73E+03	4.14E+03	7.92E+05	1.34E+04	ND	4.44E+03
Cs-134	6.51E+05	1.01E+06	2.25E+05	ND	3.30E+05	1.21E+05	3.85E+03
Cs-136	6.51E+04	1.71E+05	1.16E+05	ND	9.55E+04	1.45E+04	4.18E+03
Cs-137	9.07E+05	8.25E+05	1.28E+05	ND	2.82E+05	1.04E+05	3.62E+03
Ba-140	7.40E+04	6.48E+01	4.33E+03	ND	2.11E+01	1.74E+06	1.02E+05
La-140	6.44E+02	2.25E+02	7.55E+01	ND	ND	1.83E+05	2.26E+05
Ce-141	3.92E+04	1.95E+04	2.90E+03	ND	8.55E+03	5.44E+05	5.66E+04
Ce-144	6.77E+06	2.12E+06	3.61E+05	ND	1.17E+06	1.20E+07	3.89E+05
Pr-143	1.85E+04	5.55E+03	9.14E+02	ND	3.00E+03	4.33E+05	9.73E+04
Pr-144	5.96E-02	1.85E-02	3.00E-03	ND	9.77E-03	1.57E+03	1.97E+02
Nd-147	1.08E+04	8.73E+03	6.81E+02	ND	4.81E+03	3.28E+05	8.21E+04
Eu-154	1.01E+07	9.21E+05	8.40E+05	ND	4.03E+06	6.14E+06	1.10E+05
Hf-181	2.78E+04	1.01E+05	1.25E+04	ND	2.05E+04	1.06E+06	6.62E+04

TABLE 3.3
CHILD PATHWAY DOSE FACTORS (R_f) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES

Meat Pathway
(m²mrem/yr) per (μCi/sec)

<u>Nuclide</u>	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GI-LLI</u>
H-3	ND	2.34E+02	2.34E+02	2.34E+02	2.34E+02	2.34E+02	2.34E+02
Be-7	7.38E+03	1.26E+04	8.07E+03	0.00E+00	1.23E+04	0.00E+00	7.00E+05
Cr-51	0.00E+00	0.00E+00	8.80E+03	4.88E+03	1.33E+03	8.92E+03	4.67E+05
Mn-54	0.00E+00	8.02E+06	2.14E+06	0.00E+00	2.25E+06	0.00E+00	6.73E+06
Fe-55	4.58E+08	2.43E+08	7.52E+07	0.00E+00	0.00E+00	1.37E+08	4.50E+07
Fe-59	3.77E+08	6.10E+08	3.04E+08	0.00E+00	0.00E+00	1.77E+08	6.35E+08
Co-57	0.00E+00	5.92E+06	1.20E+07	0.00E+00	0.00E+00	0.00E+00	4.85E+07
Co-58	0.00E+00	1.64E+07	5.03E+07	0.00E+00	0.00E+00	0.00E+00	9.59E+07
Co-60	0.00E+00	6.94E+07	2.05E+08	0.00E+00	0.00E+00	0.00E+00	3.84E+08
Zn-65	3.76E+08	1.00E+09	6.23E+08	0.00E+00	6.31E+08	0.00E+00	1.76E+08
Rb-86	0.00E+00	5.77E+08	3.55E+08	0.00E+00	0.00E+00	0.00E+00	3.71E+07
Sr-89	4.82E+08	0.00E+00	1.38E+07	0.00E+00	0.00E+00	0.00E+00	1.87E+07
Sr-90	1.04E+10	0.00E+00	2.64E+09	0.00E+00	0.00E+00	0.00E+00	1.40E+08
Y-90	1.93E+05	0.00E+00	5.16E+03	0.00E+00	0.00E+00	0.00E+00	5.49E+08
Y-91	1.80E+06	0.00E+00	4.82E+04	0.00E+00	0.00E+00	0.00E+00	2.40E+08
Zr-95	2.67E+06	5.86E+05	5.22E+05	0.00E+00	8.39E+05	0.00E+00	6.11E+08
Nb-95	4.26E+06	1.66E+06	1.18E+06	0.00E+00	1.56E+06	0.00E+00	3.07E+09
Ru-103	1.55E+08	0.00E+00	5.96E+07	0.00E+00	3.90E+08	0.00E+00	4.01E+09
Ru-106	4.44E+09	0.00E+00	5.54E+08	0.00E+00	6.00E+09	0.00E+00	6.91E+10
Ag-110m	8.40E+06	5.67E+06	4.53E+06	0.00E+00	1.06E+07	0.00E+00	6.75E+08
Cd-109	0.00E+00	1.91E+06	8.84E+04	0.00E+00	1.70E+06	0.00E+00	6.18E+06
Sn-113	2.18E+09	4.48E+07	1.24E+08	3.31E+09	0.00E+00	0.00E+00	1.54E+09
Sb-124	2.93E+07	3.80E+05	1.03E+07	6.46E+04	0.00E+00	1.62E+07	1.83E+08
Sb-125	2.85E+07	2.20E+05	5.97E+06	2.64E+04	0.00E+00	1.59E+07	6.81E+07
Te-127m	1.78E+09	4.78E+08	2.11E+08	4.25E+08	5.07E+09	0.00E+00	1.44E+09
Te-129m	1.79E+09	5.00E+08	2.78E+08	5.78E+08	5.26E+09	0.00E+00	2.19E+09
I-130	3.06E-06	6.18E-06	3.18E-06	6.80E-04	9.23E-06	0.00E+00	2.89E-06

TABLE 3.3
CHILD PATHWAY DOSE FACTORS (R_I) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES

Meat Pathway
(m²mrem/yr) per (μCi/sec)

<u>Nuclide</u>	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GI-LLI</u>
I-131	1.66E+07	1.67E+07	9.47E+06	5.51E+09	2.74E+07	0.00E+00	1.48E+06
I-132	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
I-133	5.70E-01	7.05E-01	2.67E-01	1.31E+02	1.17E+00	0.00E+00	2.84E-01
I-134	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
I-135	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Cs-134	9.23E+08	1.51E+09	3.20E+08	0.00E+00	4.69E+08	1.68E+08	8.17E+06
Cs-136	1.62E+07	4.46E+07	2.89E+07	0.00E+00	2.38E+07	3.54E+06	1.57E+06
Cs-137	1.33E+09	1.28E+09	1.89E+08	0.00E+00	4.16E+08	1.50E+08	8.00E+06
Ba-140	4.39E+07	3.85E+04	2.56E+06	0.00E+00	1.25E+04	2.29E+04	2.22E+07
La-140	3.33E+02	1.17E+02	3.93E+01	0.00E+00	0.00E+00	0.00E+00	3.25E+06
Ce-141	2.22E+04	1.11E+04	1.65E+03	0.00E+00	4.86E+03	0.00E+00	1.38E+07
Ce-144	2.32E+06	7.27E+05	1.24E+05	0.00E+00	4.02E+05	0.00E+00	1.89E+08
Pr-143	3.34E+04	1.00E+04	1.66E+03	0.00E+00	5.43E+03	0.00E+00	3.61E+07
Pr-144	5.63E+02	1.74E+02	2.83E+01	0.00E+00	9.21E+01	0.00E+00	3.75E+05
Nd-147	1.17E+04	9.48E+03	7.34E+02	0.00E+00	5.20E+03	0.00E+00	1.50E+07
Eu-154	1.12E+07	1.01E+06	9.20E+05	0.00E+00	4.43E+06	0.00E+00	2.34E+08
Hf-181	4.77E+06	1.74E+07	2.15E+06	0.00E+00	3.53E+06	0.00E+00	6.41E+09

TABLE 3.3
CHILD PATHWAY DOSE FACTORS (R_f) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES

Grass-Cow-Milk Pathway
(m²mrem/yr) per (μCi/sec)

<u>Nuclide</u>	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GI-LLI</u>
H-3	0.00E+00	1.57E+03	1.57E+03	1.57E+03	1.57E+03	1.57E+03	1.57E+03
Be-7	7.50E+03	1.28E+04	8.20E+03	0.00E+00	1.25E+04	0.00E+00	7.12E+05
Cr-51	0.00E+00	0.00E+00	1.02E+05	5.66E+04	1.55E+04	1.03E+05	5.40E+06
Mn-54	0.00E+00	2.10E+07	5.59E+06	0.00E+00	5.89E+06	0.00E+00	1.76E+07
Fe-55	1.12E+08	5.94E+07	1.84E+07	0.00E+00	0.00E+00	3.36E+07	1.10E+07
Fe-59	1.20E+08	1.95E+08	9.70E+07	0.00E+00	0.00E+00	5.64E+07	2.03E+08
Co-57	0.00E+00	3.84E+06	7.78E+06	0.00E+00	0.00E+00	0.00E+00	3.15E+07
Co-58	0.00E+00	1.21E+07	3.72E+07	0.00E+00	0.00E+00	0.00E+00	7.08E+07
Co-60	0.00E+00	4.32E+07	1.27E+08	0.00E+00	0.00E+00	0.00E+00	2.39E+08
Zn-65	4.14E+09	1.10E+10	6.86E+09	0.00E+00	6.95E+09	0.00E+00	1.94E+09
Rb-86	0.00E+00	8.78E+09	5.40E+09	0.00E+00	0.00E+00	0.00E+00	5.65E+08
Sr-89	6.63E+09	0.00E+00	1.89E+08	0.00E+00	0.00E+00	0.00E+00	2.57E+08
Sr-90	1.12E+11	0.00E+00	2.84E+10	0.00E+00	0.00E+00	0.00E+00	1.51E+09
Y-90	3.38E+03	0.00E+00	9.05E+01	0.00E+00	0.00E+00	0.00E+00	9.62E+06
Y-91	3.91E+04	0.00E+00	1.04E+03	0.00E+00	0.00E+00	0.00E+00	5.20E+06
Zr-95	3.84E+03	8.43E+02	7.51E+02	0.00E+00	1.21E+03	0.00E+00	8.80E+05
Nb-95	3.72E+05	1.45E+05	1.03E+05	0.00E+00	1.36E+05	0.00E+00	2.68E+08
Ru-103	4.29E+03	0.00E+00	1.65E+03	0.00E+00	1.08E+04	0.00E+00	1.11E+05
Ru-106	9.25E+04	0.00E+00	1.15E+04	0.00E+00	1.25E+05	0.00E+00	1.44E+06
Ag-110m	2.09E+08	1.41E+08	1.13E+08	0.00E+00	2.63E+08	0.00E+00	1.68E+10
Cd-109	0.00E+00	3.86E+06	1.79E+05	0.00E+00	3.45E+06	0.00E+00	1.25E+07
Sn-113	6.11E+08	1.26E+07	3.48E+07	9.29E+08	0.00E+00	0.00E+00	4.32E+08
Sb-124	1.09E+08	1.41E+06	3.81E+07	2.40E+05	0.00E+00	6.03E+07	6.80E+08
Sb-125	8.71E+07	6.72E+05	1.83E+07	8.07E+04	0.00E+00	4.86E+07	2.08E+08
Te-127m	2.08E+08	5.61E+07	2.47E+07	4.98E+07	5.94E+08	0.00E+00	1.69E+08
Te-129m	2.72E+08	7.59E+07	4.22E+07	8.76E+07	7.98E+08	0.00E+00	3.31E+08

TABLE 3.3
CHILD PATHWAY DOSE FACTORS (R_f) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES

Grass-Cow-Milk Pathway
(m^2 mrem/yr) per (μ Ci/sec)

<u>Nuclide</u>	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>G-LLI</u>
I-130	1.73E+06	3.50E+06	1.80E+06	3.85E+08	5.23E+06	0.00E+00	1.64E+06
I-131	1.30E+09	1.31E+09	7.46E+08	4.34E+11	2.15E+09	0.00E+00	1.17E+08
I-132	6.92E-01	1.27E+00	5.85E-01	5.90E+01	1.95E+00	0.00E+00	1.50E+00
I-133	1.72E+07	2.13E+07	8.05E+06	3.95E+09	3.54E+07	0.00E+00	8.57E+06
I-134	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
I-135	5.41E+04	9.74E+04	4.61E+04	8.63E+06	1.49E+05	0.00E+00	7.42E+04
Cs-134	2.27E+10	3.72E+10	7.84E+09	0.00E+00	1.15E+10	4.14E+09	2.00E+08
Cs-136	1.01E+09	2.78E+09	1.80E+09	0.00E+00	1.48E+09	2.21E+08	9.78E+07
Cs-137	3.23E+10	3.09E+10	4.56E+09	0.00E+00	1.01E+10	3.62E+09	1.93E+08
Ba-140	1.17E+08	1.03E+05	6.84E+06	0.00E+00	3.34E+04	6.12E+04	5.94E+07
La-140	1.78E+02	6.23E+01	2.10E+01	0.00E+00	0.00E+00	0.00E+00	1.74E+06
Ce-141	2.19E+04	1.09E+04	1.62E+03	0.00E+00	4.79E+03	0.00E+00	1.36E+07
Ce-144	1.62E+06	5.09E+05	8.67E+04	0.00E+00	2.82E+05	0.00E+00	1.33E+08
Pr-143	7.19E+02	2.16E+02	3.57E+01	0.00E+00	1.17E+02	0.00E+00	7.76E+05
Pr-144	5.04E+00	1.56E+00	2.53E-01	0.00E+00	8.24E-01	0.00E+00	3.35E+03
Nd-147	4.45E+02	3.61E+02	2.79E+01	0.00E+00	1.98E+02	0.00E+00	5.71E+05
Eu-154	9.43E+04	8.48E+03	7.75E+03	0.00E+00	3.73E+04	0.00E+00	1.97E+06
Hf-181	6.44E+02	2.35E+03	2.91E+02	0.00E+00	4.76E+02	0.00E+00	8.66E+05

**TABLE 3.3
CHILD PATHWAY DOSE FACTORS (R_f) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES**

**Grass-Goat-Milk Pathway
(m²mrem/yr) per (μCi/sec)**

<u>Nuclide</u>	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GI-LLI</u>
H-3	0.00E+00	3.20E+03	3.20E+03	3.20E+03	3.20E+03	3.20E+03	3.20E+03
Be-7	9.00E+02	1.53E+03	9.84E+02	0.00E+00	1.50E+03	0.00E+00	8.55E+04
Cr-51	0.00E+00	0.00E+00	1.22E+04	6.79E+03	1.85E+03	1.24E+04	6.48E+05
Mn-54	0.00E+00	2.52E+06	6.71E+05	0.00E+00	7.06E+05	0.00E+00	2.11E+06
Fe-55	1.45E+06	7.72E+05	2.39E+05	0.00E+00	0.00E+00	4.36E+05	1.43E+05
Fe-59	1.56E+06	2.53E+06	1.26E+06	0.00E+00	0.00E+00	7.34E+05	2.64E+06
Co-57	0.00E+00	4.61E+05	9.33E+05	0.00E+00	0.00E+00	0.00E+00	3.78E+06
Co-58	0.00E+00	1.46E+06	4.46E+06	0.00E+00	0.00E+00	0.00E+00	8.50E+06
Co-60	0.00E+00	5.19E+06	1.53E+07	0.00E+00	0.00E+00	0.00E+00	2.87E+07
Zn-65	4.97E+08	1.32E+09	8.23E+08	0.00E+00	8.34E+08	0.00E+00	2.32E+08
Rb-86	0.00E+00	1.05E+09	6.48E+08	0.00E+00	0.00E+00	0.00E+00	6.78E+07
Sr-89	1.39E+10	0.00E+00	3.97E+08	0.00E+00	0.00E+00	0.00E+00	5.39E+08
Sr-90	2.35E+11	0.00E+00	5.95E+10	0.00E+00	0.00E+00	0.00E+00	3.16E+09
Y-90	4.06E+02	0.00E+00	1.09E+01	0.00E+00	0.00E+00	0.00E+00	1.15E+06
Y-91	4.69E+03	0.00E+00	1.25E+02	0.00E+00	0.00E+00	0.00E+00	6.25E+05
Zr-95	4.60E+02	1.01E+02	9.01E+01	0.00E+00	1.45E+02	0.00E+00	1.06E+05
Nb-95	4.46E+04	1.74E+04	1.24E+04	0.00E+00	1.63E+04	0.00E+00	3.21E+07
Ru-103	5.14E+02	0.00E+00	1.98E+02	0.00E+00	1.29E+03	0.00E+00	1.33E+04
Ru-106	1.11E+04	0.00E+00	1.38E+03	0.00E+00	1.50E+04	0.00E+00	1.73E+05
Ag-110m	2.51E+07	1.69E+07	1.35E+07	0.00E+00	3.15E+07	0.00E+00	2.01E+09
Cd-109	0.00E+00	4.64E+05	2.15E+04	0.00E+00	4.14E+05	0.00E+00	1.50E+06
Sn-113	7.33E+07	1.51E+06	4.18E+06	1.11E+08	0.00E+00	0.00E+00	5.18E+07
Sb-124	1.30E+07	1.69E+05	4.57E+06	2.88E+04	0.00E+00	7.24E+06	8.16E+07
Sb-125	1.05E+07	8.06E+04	2.19E+06	9.68E+03	0.00E+00	5.83E+06	2.50E+07
Te-127m	2.50E+07	6.73E+06	2.97E+06	5.98E+06	7.13E+07	0.00E+00	2.02E+07
Te-129m	3.26E+07	9.10E+06	5.06E+06	1.05E+07	9.57E+07	0.00E+00	3.98E+07
I-130	2.08E+06	4.20E+06	2.16E+06	4.62E+08	6.27E+06	0.00E+00	1.96E+06
I-131	1.57E+09	1.57E+09	8.95E+08	5.21E+11	2.58E+09	0.00E+00	1.40E+08
I-132	8.30E-01	1.53E+00	7.02E-01	7.08E+01	2.34E+00	0.00E+00	1.80E+00

TABLE 3.3
CHILD PATHWAY DOSE FACTORS (R_1) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES

Grass-Goat-Milk Pathway
(m^2 mrem/yr) per (μ Ci/sec)

<u>Nuclide</u>	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GI-LLI</u>
I-133	2.06E+07	2.55E+07	9.66E+06	4.74E+09	4.25E+07	0.00E+00	1.03E+07
I-134	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
I-135	6.49E+04	1.17E+05	5.53E+04	1.04E+07	1.79E+05	0.00E+00	8.90E+04
Cs-134	6.80E+10	1.12E+11	2.35E+10	0.00E+00	3.46E+10	1.24E+10	6.01E+08
Cs-136	3.04E+09	8.35E+09	5.40E+09	0.00E+00	4.45E+09	6.63E+08	2.93E+08
Cs-137	9.68E+10	9.27E+10	1.37E+10	0.00E+00	3.02E+10	1.09E+10	5.80E+08
Ba-140	1.41E+07	1.23E+04	8.21E+05	0.00E+00	4.01E+03	7.35E+03	7.13E+06
La-140	2.14E+01	7.47E+00	2.52E+00	0.00E+00	0.00E+00	0.00E+00	2.08E+05
Ce-141	2.63E+03	1.31E+03	1.95E+02	0.00E+00	5.75E+02	0.00E+00	1.63E+06
Ce-144	1.95E+05	6.11E+04	1.04E+04	0.00E+00	3.38E+04	0.00E+00	1.59E+07
Pr-143	8.63E+01	2.59E+01	4.28E+00	0.00E+00	1.40E+01	0.00E+00	9.31E+04
Pr-144	6.05E-01	1.87E-01	3.04E-02	0.00E+00	9.89E-02	0.00E+00	4.03E+02
Nd-147	5.34E+01	4.33E+01	3.35E+00	0.00E+00	2.37E+01	0.00E+00	6.85E+04
Eu-154	1.13E+04	1.02E+03	9.29E+02	0.00E+00	4.47E+03	0.00E+00	2.37E+05
Hf-181	7.73E+01	2.81E+02	3.49E+01	0.00E+00	5.72E+01	0.00E+00	1.04E+05

TABLE 3.3
CHILD PATHWAY DOSE FACTORS (R_f) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES

Vegetation Pathway
(m^2 mrem/yr) per (μ Ci/sec)

<u>Nuclide</u>	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>G-LLI</u>
H-3	ND	4.01E+03	4.01E+03	4.01E+03	4.01E+03	4.01E+03	4.01E+03
Be-7	3.38E+05	5.76E+05	3.70E+05	0.00E+00	5.65E+05	0.00E+00	3.21E+07
Cr-51	0.00E+00	0.00E+00	1.17E+05	6.50E+04	1.78E+04	1.19E+05	6.21E+06
Mn-54	0.00E+00	6.65E+08	1.77E+08	0.00E+00	1.86E+08	0.00E+00	5.58E+08
Fe-55	8.01E+08	4.25E+08	1.32E+08	0.00E+00	0.00E+00	2.40E+08	7.87E+07
Fe-59	3.98E+08	6.43E+08	3.20E+08	0.00E+00	0.00E+00	1.87E+08	6.70E+08
Co-57	0.00E+00	2.99E+07	6.04E+07	0.00E+00	0.00E+00	0.00E+00	2.45E+08
Co-58	0.00E+00	6.44E+07	1.97E+08	0.00E+00	0.00E+00	0.00E+00	3.76E+08
Co-60	0.00E+00	3.78E+08	1.12E+09	0.00E+00	0.00E+00	0.00E+00	2.10E+09
Zn-65	8.13E+08	2.17E+09	1.35E+09	0.00E+00	1.36E+09	0.00E+00	3.80E+08
Rb-86	0.00E+00	4.52E+08	2.78E+08	0.00E+00	0.00E+00	0.00E+00	2.91E+07
Sr-89	3.60E+10	0.00E+00	1.03E+09	0.00E+00	0.00E+00	0.00E+00	1.39E+09
Sr-90	1.24E+12	0.00E+00	3.15E+11	0.00E+00	0.00E+00	0.00E+00	1.67E+10
Y-90	3.01E+06	0.00E+00	8.04E+04	0.00E+00	0.00E+00	0.00E+00	8.56E+09
Y-91	1.86E+07	0.00E+00	4.99E+05	0.00E+00	0.00E+00	0.00E+00	2.48E+09
Zr-95	3.86E+06	8.48E+05	7.55E+05	0.00E+00	1.21E+06	0.00E+00	8.85E+08
Nb-95	7.48E+05	2.91E+05	2.08E+05	0.00E+00	2.74E+05	0.00E+00	5.39E+08
Ru-103	1.53E+07	0.00E+00	5.90E+06	0.00E+00	3.86E+07	0.00E+00	3.97E+08
Ru-106	7.45E+08	0.00E+00	9.30E+07	0.00E+00	1.01E+09	0.00E+00	1.16E+10
Ag-110m	3.21E+07	2.17E+07	1.73E+07	0.00E+00	4.04E+07	0.00E+00	2.58E+09
Cd-109	0.00E+00	2.45E+08	1.14E+07	0.00E+00	2.18E+08	0.00E+00	7.94E+08
Sn-113	1.58E+09	3.25E+07	9.00E+07	2.40E+09	0.00E+00	0.00E+00	1.12E+09
Sb-124	3.52E+08	4.57E+06	1.23E+08	7.77E+05	0.00E+00	1.95E+08	2.20E+09
Sb-125	4.99E+08	3.85E+06	1.05E+08	4.63E+05	0.00E+00	2.78E+08	1.19E+09
Te-127m	1.32E+09	3.56E+08	1.57E+08	3.16E+08	3.77E+09	0.00E+00	1.07E+09
Te-129m	8.41E+08	2.35E+08	1.31E+08	2.71E+08	2.47E+09	0.00E+00	1.03E+09
I-130	6.16E+05	1.24E+06	6.41E+05	1.37E+08	1.86E+06	0.00E+00	5.82E+05
I-131	1.43E+08	1.44E+08	8.17E+07	4.76E+10	2.36E+08	0.00E+00	1.28E+07

TABLE 3.3
CHILD PATHWAY DOSE FACTORS (R_f) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES

Vegetation Pathway
(m^2 mrem/yr) per (μ Ci/sec)

<u>Nuclide</u>	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GI-LLI</u>
I-132	9.23E+01	1.70E+02	7.80E+01	7.87E+03	2.60E+02	0.00E+00	2.00E+02
I-133	3.53E+06	4.37E+06	1.65E+06	8.12E+08	7.28E+06	0.00E+00	1.76E+06
I-134	1.56E-04	2.89E-04	1.33E-04	6.65E-03	4.42E-04	0.00E+00	1.92E-04
I-135	6.26E+04	1.13E+05	5.33E+04	9.98E+06	1.73E+05	0.00E+00	8.59E+04
Cs-134	1.60E+10	2.63E+10	5.55E+09	0.00E+00	8.15E+09	2.93E+09	1.42E+08
Cs-136	8.24E+07	2.27E+08	1.47E+08	0.00E+00	1.21E+08	1.80E+07	7.96E+06
Cs-137	2.39E+10	2.29E+10	3.38E+09	0.00E+00	7.46E+09	2.68E+09	1.43E+08
Ba-140	2.77E+08	2.43E+05	1.62E+07	0.00E+00	7.90E+04	1.45E+05	1.40E+08
La-140	3.36E+04	1.18E+04	3.96E+03	0.00E+00	0.00E+00	0.00E+00	3.28E+08
Ce-141	6.56E+05	3.27E+05	4.86E+04	0.00E+00	1.43E+05	0.00E+00	4.08E+08
Ce-144	1.27E+08	3.98E+07	6.78E+06	0.00E+00	2.21E+07	0.00E+00	1.04E+10
Pr-143	1.46E+05	4.37E+04	7.23E+03	0.00E+00	2.37E+04	0.00E+00	1.57E+08
Pr-144	7.88E+03	2.44E+03	3.97E+02	0.00E+00	1.29E+03	0.00E+00	5.25E+06
Nd-147	7.15E+04	5.79E+04	4.48E+03	0.00E+00	3.18E+04	0.00E+00	9.17E+07
Eu-154	1.66E+08	1.50E+07	1.37E+07	0.00E+00	6.57E+07	0.00E+00	3.48E+09
Hf-181	4.90E+05	1.79E+06	2.21E+05	0.00E+00	3.63E+05	0.00E+00	6.59E+08

**TABLE 3.4
ADULT PATHWAY DOSE FACTORS (R_f) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES**

<u>Nuclide</u>	<u>Inhalation Pathway</u> (mrem/yr) per (μCi/m ³)						
	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GI-LLI</u>
H-3	ND	1.26E+03	1.26E+03	1.26E+03	1.26E+03	1.26E+03	1.26E+03
Be-7	4.27E+02	9.68E+02	4.70E+02	ND	ND	4.21E+04	5.35E+03
Cr-51	ND	ND	1.00E+02	5.95E+01	2.28E+01	1.44E+04	3.32E+03
Mn-54	ND	3.96E+04	6.30E+03	ND	9.84E+03	1.40E+06	7.74E+04
Fe-55	2.46E+04	1.70E+04	3.94E+03	ND	ND	7.21E+04	6.03E+03
Fe-59	1.18E+04	2.78E+04	1.06E+04	ND	ND	1.02E+06	1.88E+05
Co-57	ND	6.92E+02	6.71E+02	ND	ND	3.70E+05	3.14E+04
Co-58	ND	1.58E+03	2.07E+03	ND	ND	9.28E+05	1.06E+05
Co-60	ND	1.15E+04	1.48E+04	ND	ND	5.97E+06	2.85E+05
Zn-65	3.24E+04	1.03E+05	4.66E+04	ND	6.90E+04	8.64E+05	5.34E+04
Rb-86	ND	1.35E+05	5.90E+04	ND	ND	ND	1.66E+04
Sr-89	3.04E+05	ND	8.72E+03	ND	ND	1.40E+06	3.50E+05
Sr-90	9.92E+07	ND	6.10E+06	ND	ND	9.60E+06	7.22E+05
Y-90	2.09E+03	ND	5.61E+01	ND	ND	1.70E+05	5.06E+05
Y-91	4.62E+05	ND	1.24E+04	ND	ND	1.70E+06	3.85E+05
Zr-95	1.07E+05	3.44E+04	2.33E+04	ND	5.42E+04	1.77E+06	1.50E+05
Nb-95	1.41E+04	7.82E+03	4.21E+03	ND	7.74E+03	5.05E+05	1.04E+05
Ru-103	1.53E+03	ND	6.58E+02	ND	5.83E+03	5.05E+05	1.10E+05
Ru-106	6.91E+04	ND	8.72E+03	ND	1.34E+05	9.36E+06	9.12E+05
Ag-110m	1.08E+04	1.00E+04	5.94E+03	ND	1.97E+04	4.63E+06	3.02E+05
Cd-109	ND	3.67E+05	1.31E+04	ND	3.57E+05	6.83E+05	5.82E+04
Sn-113	5.72E+04	2.18E+03	4.39E+03	1.24E+03	ND	9.44E+05	1.18E+05
Sb-124	3.12E+04	5.89E+02	1.24E+04	7.55E+01	ND	2.48E+06	4.06E+05
Sb-125	5.34E+04	5.95E+02	1.26E+04	5.40E+01	ND	1.74E+06	1.01E+05
Te-127m	1.26E+04	5.77E+03	1.57E+03	3.29E+03	4.58E+04	9.60E+05	1.50E+05
Te-129m	9.76E+03	4.67E+03	1.58E+03	3.44E+03	3.66E+04	1.16E+06	3.83E+05
I-130	4.58E+03	1.34E+04	5.28E+03	1.14E+06	2.09E+04	ND	7.69E+03
I-131	2.52E+04	3.58E+04	2.05E+04	1.19E+07	6.13E+04	ND	6.28E+03

TABLE 3.4
ADULT PATHWAY DOSE FACTORS (R_f) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES

Inhalation Pathway
(mrem/yr) per (μCi/m³)

<u>Nuclide</u>	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GLLI</u>
I-132	1.16E+03	3.26E+03	1.16E+03	1.14E+05	5.18E+03	ND	4.06E+02
I-133	8.64E+03	1.48E+04	4.52E+03	2.15E+06	2.58E+04	ND	8.88E+03
I-134	6.44E+02	1.73E+03	6.15E+02	2.98E+04	2.75E+03	ND	1.01E+00
I-135	2.68E+03	6.98E+03	2.57E+03	4.48E+05	1.11E+04	ND	5.25E+03
Cs-134	3.73E+05	8.48E+05	7.28E+05	ND	2.87E+05	9.76E+04	1.04E+04
Cs-136	3.90E+04	1.46E+05	1.10E+05	ND	8.56E+04	1.20E+04	1.17E+04
Cs-137	4.78E+05	6.21E+05	4.28E+05	ND	2.22E+05	7.52E+04	8.40E+03
Ba-140	3.90E+04	4.90E+01	2.57E+03	ND	1.67E+01	1.27E+06	2.18E+05
La-140	3.44E+02	1.74E+02	4.58E+01	ND	ND	1.36E+05	4.58E+05
Ce-141	1.99E+04	1.35E+04	1.53E+03	ND	6.26E+03	3.62E+05	1.20E+05
Ce-144	3.43E+06	1.43E+06	1.84E+05	ND	8.48E+05	7.78E+06	8.16E+05
Pr-143	9.36E+03	3.75E+03	4.64E+02	ND	2.16E+03	2.81E+05	2.00E+05
Pr-144	3.01E-02	1.25E-02	1.53E-03	ND	7.05E-03	1.02E+03	2.15E-08
Nd-147	5.27E+03	6.10E+03	3.65E+02	ND	3.56E+03	2.21E+05	1.73E+05
Eu-154	5.92E+06	7.28E+05	5.18E+05	ND	3.49E+06	4.67E+06	2.72E+05
Hf-181	1.41E+04	6.82E+04	6.32E+03	ND	1.48E+04	6.85E+05	1.39E+05

TABLE 3.4
ADULT PATHWAY DOSE FACTORS (R_D) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES

Meat Pathway
(m²mrem/yr) per (μCi/sec)

<u>Nuclide</u>	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GI-LI</u>
H-3	ND	3.25E+02	3.25E+02	3.25E+02	3.25E+02	3.25E+02	3.25E+02
Be-7	4.57E+03	1.04E+04	5.07E+03	ND	1.10E+04	ND	1.81E+06
Cr-51	ND	ND	7.04E+03	4.21E+03	1.55E+03	9.34E+03	1.77E+06
Mn-54	ND	9.17E+06	1.75E+06	ND	2.73E+06	ND	2.81E+07
Fe-55	2.93E+08	2.02E+08	4.72E+07	ND	ND	1.13E+08	1.16E+08
Fe-59	2.65E+08	6.24E+08	2.39E+08	ND	ND	1.74E+08	2.08E+09
Co-57	ND	5.63E+06	9.36E+06	ND	ND	ND	1.43E+08
Co-58	ND	1.82E+07	4.08E+07	ND	ND	ND	3.69E+08
Co-60	ND	7.51E+07	1.66E+08	ND	ND	ND	1.41E+09
Zn-65	3.56E+08	1.13E+09	5.11E+08	ND	7.57E+08	ND	7.13E+08
Rb-86	ND	4.87E+08	2.27E+08	ND	ND	ND	9.60E+07
Sr-89	3.01E+08	ND	8.65E+06	ND	ND	ND	4.83E+07
Sr-90	1.24E+10	ND	3.05E+09	ND	ND	ND	3.59E+08
Y-90	1.21E+05	ND	3.24E+03	ND	ND	ND	1.28E+09
Y-91	1.13E+06	ND	3.02E+04	ND	ND	ND	6.23E+08
Zr-95	1.87E+06	6.00E+05	4.06E+05	ND	9.42E+05	ND	1.90E+09
Nb-95	3.15E+06	1.75E+06	9.43E+05	ND	1.73E+06	ND	1.06E+10
Ru-103	1.05E+08	ND	4.53E+07	ND	4.01E+08	ND	1.23E+10
Ru-106	2.80E+09	ND	3.54E+08	ND	5.40E+09	ND	1.81E+11
Ag-110m	6.68E+06	6.18E+06	3.67E+06	ND	1.21E+07	ND	2.52E+09
Cd-109	ND	1.59E+06	5.55E+04	ND	1.52E+06	ND	1.60E+07
Sn-113	1.37E+09	3.88E+07	7.86E+07	2.22E+07	ND	ND	4.09E+09
Sb-124	1.98E+07	3.74E+05	7.84E+06	4.79E+04	ND	1.54E+07	5.61E+08
Sb-125	1.91E+07	2.13E+05	4.54E+06	1.94E+04	ND	1.47E+07	2.10E+08
Te-127m	1.11E+09	3.98E+08	1.36E+08	2.85E+08	4.53E+09	ND	3.74E+09
Te-129m	1.13E+09	4.23E+08	1.79E+08	3.89E+08	4.73E+09	ND	5.71E+09
I-130	2.12E-06	6.27E-06	2.47E-06	5.31E-04	9.78E-06	ND	5.40E-06
I-131	1.08E+07	1.54E+07	8.82E+06	5.04E+09	2.64E+07	ND	4.06E+06

**TABLE 3.4
ADULT PATHWAY DOSE FACTORS (R_f) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES**

**Meat Pathway
(m²mrem/yr) per (μCi/sec)**

<u>Nuclide</u>	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GILLI</u>
I-132	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	ND	0.00E+00
I-133	3.67E-01	6.39E-01	1.95E-01	9.38E+01	1.11E+00	ND	5.74E-01
I-134	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	ND	0.00E+00
I-135	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	ND	0.00E+00
Cs-134	6.57E+08	1.56E+09	1.28E+09	ND	5.06E+08	1.68E+08	2.74E+07
Cs-136	1.20E+07	4.76E+07	3.42E+07	ND	2.65E+07	3.63E+06	5.40E+06
Cs-137	8.71E+08	1.19E+09	7.81E+08	ND	4.04E+08	1.34E+08	2.31E+07
Ba-140	2.87E+07	3.61E+04	1.88E+06	ND	1.23E+04	2.07E+04	5.91E+07
La-140	2.21E+02	1.11E+02	2.94E+01	ND	ND	ND	8.18E+06
Ce-141	1.40E+04	9.49E+03	1.08E+03	ND	4.41E+03	ND	3.63E+07
Ce-144	1.46E+06	6.09E+05	7.82E+04	ND	3.61E+05	ND	4.92E+08
Pr-143	2.10E+04	8.40E+03	1.04E+03	ND	4.85E+03	ND	9.18E+07
Pr-144	3.52E+02	1.46E+02	1.79E+01	ND	8.24E+01	ND	5.06E-05
Nd-147	7.07E+03	8.17E+03	4.89E+02	ND	4.77E+03	ND	3.92E+07
Eu-154	8.02E+06	9.86E+05	7.01E+05	ND	4.72E+06	ND	7.14E+08
Hf-181	3.01E+06	1.46E+07	1.35E+06	ND	3.14E+06	ND	1.66E+10

TABLE 3.4
ADULT PATHWAY DOSE FACTORS (R_f) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES

Grass-Cow-Milk Pathway
(m²mrem/yr) per (μCi/sec)

<u>Nuclide</u>	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GI-LLI</u>
H-3	ND	7.63E+02	7.63E+02	7.63E+02	7.63E+02	7.63E+02	7.63E+02
Be-7	1.63E+03	3.72E+03	1.81E+03	ND	3.93E+03	ND	6.45E+05
Cr-51	ND	ND	2.86E+04	1.71E+04	6.30E+03	3.79E+04	7.19E+06
Mn-54	ND	8.42E+06	1.61E+06	ND	2.50E+06	ND	2.58E+07
Fe-55	2.51E+07	1.74E+07	4.05E+06	ND	ND	9.68E+06	9.96E+06
Fe-59	2.97E+07	6.98E+07	2.68E+07	ND	ND	1.95E+07	2.33E+08
Co-57	ND	1.28E+06	2.13E+06	ND	ND	ND	3.25E+07
Co-58	ND	4.72E+06	1.06E+07	ND	ND	ND	9.56E+07
Co-60	ND	1.64E+07	3.62E+07	ND	ND	ND	3.08E+08
Zn-65	1.37E+09	4.37E+09	1.97E+09	ND	2.92E+09	ND	2.75E+09
Rb-86	ND	2.60E+09	1.21E+09	ND	ND	ND	5.12E+08
Sr-89	1.45E+09	ND	4.17E+07	ND	ND	ND	2.33E+08
Sr-90	4.68E+10	ND	1.15E+10	ND	ND	ND	1.35E+09
Y-90	7.43E+02	ND	1.99E+01	ND	ND	ND	7.87E+06
Y-91	8.59E+03	ND	2.30E+02	ND	ND	ND	4.73E+06
Zr-95	9.44E+02	3.03E+02	2.05E+02	ND	4.75E+02	ND	9.59E+05
Nb-95	9.65E+04	5.37E+04	2.89E+04	ND	5.31E+04	ND	3.26E+08
Ru-103	1.02E+03	ND	4.39E+02	ND	3.89E+03	ND	1.19E+05
Ru-106	2.04E+04	ND	2.58E+03	ND	3.94E+04	ND	1.32E+06
Ag-110m	5.82E+07	5.39E+07	3.20E+07	ND	1.06E+08	ND	2.20E+10
Cd-109	ND	1.13E+06	3.95E+04	ND	1.08E+06	ND	1.14E+07
Sn-113	1.34E+08	3.81E+06	7.73E+06	2.18E+06	ND	ND	4.02E+08
Sb-124	2.57E+07	4.86E+05	1.02E+07	6.24E+04	ND	2.00E+07	7.31E+08
Sb-125	2.04E+07	2.28E+05	4.87E+06	2.08E+04	ND	1.58E+07	2.25E+08
Te-127m	4.58E+07	1.64E+07	5.58E+06	1.17E+07	1.86E+08	ND	1.54E+08
Te-129m	6.02E+07	2.25E+07	9.53E+06	2.07E+07	2.51E+08	ND	3.03E+08
I-130	4.21E+05	1.24E+06	4.91E+05	1.05E+08	1.94E+06	ND	1.07E+06
I-131	2.97E+08	4.25E+08	2.43E+08	1.39E+11	7.28E+08	ND	1.12E+08

TABLE 3.4
ADULT PATHWAY DOSE FACTORS (R_D) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES

Grass-Cow-Milk Pathway
(m²mrem/yr) per (μCi/sec)

<u>Nuclide</u>	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GLLI</u>
I-132	1.65E-01	4.42E-01	1.55E-01	1.55E+01	7.04E-01	ND	8.30E-02
I-133	3.88E+06	6.75E+06	2.06E+06	9.92E+08	1.18E+07	ND	6.07E+06
I-134	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	ND	0.00E+00
I-135	1.29E+04	3.37E+04	1.25E+04	2.23E+06	5.41E+04	ND	3.81E+04
Cs-134	5.65E+09	1.35E+10	1.10E+10	ND	4.35E+09	1.45E+09	2.35E+08
Cs-136	2.63E+08	1.04E+09	7.48E+08	ND	5.79E+08	7.93E+07	1.18E+08
Cs-137	7.38E+09	1.01E+10	6.61E+09	ND	3.43E+09	1.14E+09	1.95E+08
Ba-140	2.69E+07	3.38E+04	1.76E+06	ND	1.15E+04	1.93E+04	5.54E+07
La-140	4.14E+01	2.09E+01	5.51E+00	ND	ND	ND	1.53E+06
Ce-141	4.85E+03	3.28E+03	3.72E+02	ND	1.52E+03	ND	1.25E+07
Ce-144	3.58E+05	1.50E+05	1.92E+04	ND	8.87E+04	ND	1.21E+08
Pr-143	1.58E+02	6.34E+01	7.83E+00	ND	3.66E+01	ND	6.92E+05
Pr-144	1.10E+00	4.58E-01	5.61E-02	ND	2.58E-01	ND	1.59E-07
Nd-147	9.42E+01	1.09E+02	6.51E+00	ND	6.36E+01	ND	5.23E+05
Eu-154	2.37E+04	2.91E+03	2.07E+03	ND	1.39E+04	ND	2.11E+06
Hf-181	1.42E+02	6.92E+02	6.41E+01	ND	1.49E+02	ND	7.87E+05

TABLE 3.4
ADULT PATHWAY DOSE FACTORS (R_1) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES

Grass-Goat-Milk Pathway
(m^2 mrem/yr) per (μ Ci/sec)

<u>Nuclide</u>	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GI-LLI</u>
H-3	ND	1.56E+03	1.56E+03	1.56E+03	1.56E+03	1.56E+03	1.56E+03
Be-7	1.96E+02	4.47E+02	2.17E+02	ND	4.72E+02	ND	7.74E+04
Cr-51	ND	ND	3.43E+03	2.05E+03	7.56E+02	4.56E+03	8.63E+05
Mn-54	ND	1.01E+06	1.93E+05	ND	3.01E+05	ND	3.10E+06
Fe-55	3.27E+05	2.26E+05	5.26E+04	ND	ND	1.26E+05	1.30E+05
Fe-59	3.87E+05	9.08E+05	3.48E+05	ND	ND	2.54E+05	3.03E+06
Co-57	ND	1.54E+05	2.56E+05	ND	ND	ND	3.90E+06
Co-58	ND	5.66E+05	1.27E+06	ND	ND	ND	1.15E+07
Co-60	ND	1.97E+06	4.35E+06	ND	ND	ND	3.70E+07
Zn-65	1.65E+08	5.24E+08	2.37E+08	ND	3.51E+08	ND	3.30E+08
Rb-86	ND	3.12E+08	1.45E+08	ND	ND	ND	6.15E+07
Sr-89	3.05E+09	ND	8.75E+07	ND	ND	ND	4.89E+08
Sr-90	9.84E+10	ND	2.41E+10	ND	ND	ND	2.84E+09
Y-90	8.92E+01	ND	2.39E+00	ND	ND	ND	9.46E+05
Y-91	1.03E+03	ND	2.76E+01	ND	ND	ND	5.68E+05
Zr-95	1.13E+02	3.63E+01	2.46E+01	ND	5.70E+01	ND	1.15E+05
Nb-95	1.16E+04	6.45E+03	3.47E+03	ND	6.37E+03	ND	3.91E+07
Ru-103	1.22E+02	ND	5.27E+01	ND	4.67E+02	ND	1.43E+04
Ru-106	2.45E+03	ND	3.10E+02	ND	4.73E+03	ND	1.59E+05
Ag-110m	6.99E+06	6.47E+06	3.84E+06	ND	1.27E+07	ND	2.64E+09
Cd-109	ND	1.36E+05	4.74E+03	ND	1.30E+05	ND	1.37E+06
Sn-113	1.61E+07	4.58E+05	9.28E+05	2.62E+05	ND	ND	4.83E+07
Sb-124	3.09E+06	5.84E+04	1.23E+06	7.50E+03	ND	2.41E+06	8.78E+07
Sb-125	2.46E+06	2.74E+04	5.84E+05	2.50E+03	ND	1.89E+06	2.70E+07
Te-127m	5.50E+06	1.97E+06	6.70E+05	1.41E+06	2.23E+07	ND	1.84E+07
Te-129m	7.23E+06	2.70E+06	1.14E+06	2.48E+06	3.02E+07	ND	3.64E+07
I-130	5.05E+05	1.49E+06	5.88E+05	1.26E+08	2.32E+06	ND	1.28E+06
I-131	3.56E+08	5.09E+08	2.92E+08	1.67E+11	8.72E+08	ND	1.34E+08
I-132	1.98E-01	5.29E-01	1.85E-01	1.85E+01	8.43E-01	ND	9.95E-02

TABLE 3.4
ADULT PATHWAY DOSE FACTORS (R_f) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES

Grass-Goat-Milk Pathway
(m² mrem/yr) per (μCi/sec)

<u>Nuclide</u>	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GI-LLI</u>
I-133	4.65E+06	8.09E+06	2.47E+06	1.19E+09	1.41E+07	ND	7.27E+06
I-134	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	ND	0.00E+00
I-135	1.54E+04	4.04E+04	1.49E+04	2.67E+06	6.48E+04	ND	4.57E+04
Cs-134	1.70E+10	4.04E+10	3.30E+10	ND	1.31E+10	4.34E+09	7.07E+08
Cs-136	7.91E+08	3.12E+09	2.25E+09	ND	1.74E+09	2.38E+08	3.55E+08
Cs-137	2.22E+10	3.03E+10	1.99E+10	ND	1.03E+10	3.42E+09	5.87E+08
Ba-140	3.23E+06	4.06E+03	2.12E+05	ND	1.38E+03	2.32E+03	6.65E+06
La-140	4.97E+00	2.51E+00	6.62E-01	ND	ND	ND	1.84E+05
Ce-141	5.82E+02	3.94E+02	4.46E+01	ND	1.83E+02	ND	1.50E+06
Ce-144	4.30E+04	1.80E+04	2.31E+03	ND	1.07E+04	ND	1.45E+07
Pr-143	1.90E+01	7.61E+00	9.40E-01	ND	4.39E+00	ND	8.31E+04
Pr-144	1.33E-01	5.50E-02	6.74E-03	ND	3.10E-02	ND	1.91E-08
Nd-147	1.13E+01	1.31E+01	7.82E-01	ND	7.64E+00	ND	6.28E+04
Eu-154	2.84E+03	3.49E+02	2.49E+02	ND	1.67E+03	ND	2.53E+05
Hf-181	1.71E+01	8.31E+01	7.70E+00	ND	1.79E+01	ND	9.46E+04

TABLE 3.4
ADULT PATHWAY DOSE FACTORS (R_I) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES

Vegetation Pathway
(m²mrem/yr) per (μCi/sec)

<u>Nuclide</u>	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GI-LLI</u>
H-3	ND	2.26E+03	2.26E+03	2.26E+03	2.26E+03	2.26E+03	2.26E+03
Be-7	9.24E+04	2.11E+05	1.03E+05	ND	2.23E+05	ND	3.66E+07
Cr-51	ND	ND	4.64E+04	2.78E+04	1.02E+04	6.16E+04	1.17E+07
Mn-54	ND	3.13E+08	5.97E+07	ND	9.31E+07	ND	9.59E+08
Fe-55	2.10E+08	1.45E+08	3.38E+07	ND	ND	8.08E+07	8.31E+07
Fe-59	1.26E+08	2.96E+08	1.14E+08	ND	ND	8.28E+07	9.88E+08
Co-57	ND	1.17E+07	1.95E+07	ND	ND	ND	2.97E+08
Co-58	ND	3.07E+07	6.89E+07	ND	ND	ND	6.23E+08
Co-60	ND	1.67E+08	3.69E+08	ND	ND	ND	3.14E+09
Zn-65	3.17E+08	1.01E+09	4.56E+08	ND	6.75E+08	ND	6.36E+08
Rb-86	ND	2.19E+08	1.02E+08	ND	ND	ND	4.33E+07
Sr-89	9.97E+09	ND	2.86E+08	ND	ND	ND	1.60E+09
Sr-90	6.05E+11	ND	1.48E+11	ND	ND	ND	1.75E+10
Y-90	7.67E+05	ND	2.06E+04	ND	ND	ND	8.14E+09
Y-91	5.11E+06	ND	1.37E+05	ND	ND	ND	2.81E+09
Zr-95	1.17E+06	3.77E+05	2.55E+05	ND	5.91E+05	ND	1.19E+09
Nb-95	2.40E+05	1.34E+05	7.19E+04	ND	1.32E+05	ND	8.11E+08
Ru-103	4.77E+06	ND	2.06E+06	ND	1.82E+07	ND	5.57E+08
Ru-106	1.93E+08	ND	2.44E+07	ND	3.72E+08	ND	1.25E+10
Ag-110m	1.05E+07	9.75E+06	5.79E+06	ND	1.92E+07	ND	3.98E+09
Cd-109	0.00E+00	8.36E+07	2.92E+06	ND	8.00E+07	ND	8.43E+08
Sn-113	4.16E+08	1.18E+07	2.40E+07	6.75E+06	ND	ND	1.25E+09
Sb-124	1.04E+08	1.96E+06	4.11E+07	2.51E+05	ND	8.07E+07	2.94E+09
Sb-125	1.37E+08	1.53E+06	3.25E+07	1.39E+05	ND	1.05E+08	1.50E+09
Te-127m	3.49E+08	1.25E+08	4.26E+07	8.92E+07	1.42E+09	ND	1.17E+09
Te-129m	2.51E+08	9.38E+07	3.98E+07	8.64E+07	1.05E+09	ND	1.27E+09
I-130	3.93E+05	1.16E+06	4.57E+05	9.81E+07	1.81E+06	ND	9.97E+05
I-131	8.08E+07	1.16E+08	6.62E+07	3.79E+10	1.98E+08	ND	3.05E+07

TABLE 3.4
ADULT PATHWAY DOSE FACTORS (R_1) FOR RADIONUCLIDES
OTHER THAN NOBLE GASES

Vegetation Pathway
(m^2 mrem/yr) per (μ Ci/sec)

<u>Nuclide</u>	<u>Bone</u>	<u>Liver</u>	<u>Total Body</u>	<u>Thyroid</u>	<u>Kidney</u>	<u>Lung</u>	<u>GI-LLI</u>
I-132	5.77E+01	1.54E+02	5.40E+01	5.40E+03	2.46E+02	ND	2.90E+01
I-133	2.09E+06	3.63E+06	1.11E+06	5.33E+08	6.33E+06	ND	3.26E+06
I-134	9.69E-05	2.63E-04	9.42E-05	4.56E-03	4.19E-04	ND	2.30E-07
I-135	3.90E+04	1.02E+05	3.77E+04	6.74E+06	1.64E+05	ND	1.15E+05
Cs-134	4.67E+09	1.11E+10	9.08E+09	ND	3.59E+09	1.19E+09	1.94E+08
Cs-136	4.27E+07	1.69E+08	1.21E+08	ND	9.38E+07	1.29E+07	1.91E+07
Cs-137	6.36E+09	8.70E+09	5.70E+09	ND	2.95E+09	9.81E+08	1.68E+08
Ba-140	1.29E+08	1.61E+05	8.42E+06	ND	5.49E+04	9.24E+04	2.65E+08
La-140	1.58E+04	7.98E+03	2.11E+03	ND	ND	ND	5.86E+08
Ce-141	1.97E+05	1.33E+05	1.51E+04	ND	6.19E+04	ND	5.10E+08
Ce-144	3.29E+07	1.38E+07	1.77E+06	ND	8.16E+06	ND	1.11E+10
Pr-143	6.26E+04	2.51E+04	3.10E+03	ND	1.45E+04	ND	2.74E+08
Pr-144	2.03E+03	8.43E+02	1.03E+02	ND	4.75E+02	ND	2.92E-04
Nd-147	3.33E+04	3.85E+04	2.31E+03	ND	2.25E+04	ND	1.85E+08
Eu-154	4.85E+07	5.97E+06	4.25E+06	ND	2.86E+07	ND	4.32E+09
Hf-181	1.40E+05	6.82E+05	6.32E+04	ND	1.47E+05	ND	7.76E+08

4

DOSE AND DOSE COMMITMENT FROM URANIUM FUEL CYCLE SOURCES

4.1

CALCULATION OF DOSE AND DOSE COMMITMENT FROM URANIUM FUEL CYCLE SOURCES

The annual dose or dose commitment to a MEMBER OF THE PUBLIC for Uranium Fuel Cycle Sources is determined as:

- a) Dose to the total body and internal organs due to gamma ray exposure from submersion in a cloud of radioactive noble gases, ground plane exposure, and direct radiation from the Unit, onsite storage of low-level radioactive waste, and outside storage tanks;
- b) Dose to skin due to beta radiation from submersion in a cloud of radioactive noble gases, and ground plane exposure;
- c) Thyroid dose due to inhalation and ingestion of radioiodines; and
- d) Organ dose due to inhalation and ingestion of radioactive material.

It is assumed that total body dose from sources of gamma radiation irradiates internal body organs at the same numerical rate. (Ref. 11.12.5)

The dose from gaseous effluents is considered to be the summation of the dose at the individual's residence and the dose to the individual from activities within the SITE BOUNDARY.

Since the doses via liquid releases are very conservatively evaluated, there is reasonable assurance that no real individual will receive a significant dose from radioactive liquid release pathways. Therefore, only doses to individuals via airborne pathways and doses resulting from direct radiation are considered in determining compliance to 40 CFR 190 (Ref. 11.12.3).

There are no other Uranium Fuel Cycle Sources within 8km of the Callaway Plant.

4.1.1

IDENTIFICATION OF THE MEMBER OF THE PUBLIC

The MEMBER OF THE PUBLIC is considered to be a real individual, including all persons not occupationally associated with the Callaway Plant, but who may use portions of the plant site for recreational or other purposes not associated with the plant (Ref. 11.4 and 11.8.10).

Accordingly, it is necessary to characterize this individual with respect to his utilization of areas both within and at or beyond the SITE BOUNDARY and identify, as far as possible, major assumptions which could be reevaluated if necessary to demonstrate continued compliance with 40 CFR 190 through the use of more realistic assumptions (Ref. 11.12.3 and 11.12.4).

The evaluation of Total Dose from the Uranium Fuel Cycle should consider the dose to two Critical Receptors: a) The Nearest Resident, and b) The Critical Receptor within the SITE BOUNDARY.

4.1.2

TOTAL DOSE TO THE NEAREST RESIDENT

The dose to the Nearest Resident is due to plume exposure from noble gases, ground plane exposure, and inhalation and ingestion pathways. It is conservatively assumed that each ingestion pathway (meat, milk, and vegetation) exists at the location of the Nearest Resident.

It is assumed that direct radiation dose from operation of the Unit and storage of radioactive material, and dose from gaseous effluents due to activities within the SITE BOUNDARY, is negligible for the Nearest Resident. The total Dose from the Uranium Fuel Cycle to the Nearest Resident is calculated using the methodology discussed in Section 3, using concurrent meteorological data for the location of the Nearest Resident with the highest value of X/Q.

The location of the Nearest Resident in each meteorological sector is determined from the Annual Land Use Census conducted in accordance with the Requirements of REC 16.11.4.2.

4.1.3 TOTAL DOSE TO THE CRITICAL RECEPTOR WITHIN THE SITE BOUNDARY

The Union Electric Company has entered into an agreement with the State of Missouri Department of Conservation for management of the residual lands surrounding the Callaway Plant, including some areas within the SITE BOUNDARY. Under the terms of this agreement, certain areas have been opened to the public for low intensity recreational uses (hunting, hiking, sightseeing, etc.) but recreational use is excluded in an area immediately surrounding the plant site (refer to Figure 4.1). Much of the residual lands within the SITE BOUNDARY are leased to area farmers by the Department of Conservation to provide income to support management and development costs. Activities conducted under these leases are primarily comprised of farming (animal feed), grazing, and forestry (Ref. 11.7.2, 11.7.3, 11.13, and 11.13.1).

Based on the utilization of areas within the SITE BOUNDARY, it is reasonable to assume that the critical receptor within the SITE BOUNDARY is a farmer, and that his dose from activities within the SITE BOUNDARY is due to exposure incurred while conducting his farming activities. The current tenant has estimated that he spends approximately 1100 hours per year working in this area (Ref. 11.5.5). Occupancy of areas within the SITE BOUNDARY is assumed to be averaged over a period of one year.

Any reevaluation of assumptions should consider only real receptors and real pathways using realistic assumption, and should include a reevaluation of the occupancy period at the locations of real exposure (e.g. a real individual would not simultaneously exist at each point of maximum exposure).

4.1.3.1 Total Dose to the Farmer from Gaseous Effluents

The Total Dose to the farmer from gaseous effluents is calculated for the adult age group using the methodology discussed in Section 3, utilizing concurrent meteorological data at the farmer's residence and historical meteorological data from Table 6.1 for activities within the SITE BOUNDARY. These dispersion parameters were calculated by assuming that the farmer's time is equally distributed over the areas farmed within the SITE BOUNDARY, and already have the total occupancy of 1100 hours/year factored into their value (Ref. 11.5.6).

The residence of the current tenant is located at a distance of 2897 meters in the NNW sector. The gaseous effluents dose at the farmer's residence is due to plume exposure from Noble Gases and the ground plane, inhalation, and ingestion pathways. For conservatism, it is acceptable to assume that all of the ingestion pathways exist at this location.

It is assumed that food ingestion pathways do not exist within the SITE BOUNDARY, therefore the gaseous effluents dose within the SITE BOUNDARY is due to plume exposure from Noble Gases and the ground plane and inhalation pathways.

4.1.3.1.1 Direct Radiation Dose from Outside Storage Tanks

The Refueling Water Storage Tank (RWST) has the highest potential for receiving significant amounts of radioactive materials, and constitutes the only potentially significant source of direct radiation dose from outside storage tanks to a MEMBER OF THE PUBLIC (Ref. 11.6.14, 11.6.15, 11.6.16 and 11.6.17).

Direct radiation dose from the RWST to a MEMBER OF THE PUBLIC is determined at the nearest point of the Owner Controlled Area fence which is not obscured by significant plant structures, which is 450 meters from the RWST.

The RWST is a right circular cylinder approximately 12 meters in diameter, 14 meters in height with a capacity of approximately 1,514,000 liters (Ref. 11.6.17). The walls are of type 304 stainless steel and have an average thickness of .87 cm. (Ref. 11.14.1).

The direct radiation dose from the RWST is calculated based on the tank's average isotopic content and the parameters discussed above, considering buildup and attenuation within the volume source. Appropriate methodology for calculating the dose rate from a volume source is given in TID-7004, "Reactor Shielding Design Manual" (Ref. 11.17). The computer program MICROSIELD (Ref. 11.18) will normally be utilized to perform this calculation.

4.1.3.1.2 Direct Radiation Dose from the Reactor

The maximum direct radiation dose from the Unit to a MEMBER OF THE PUBLIC has been determined to be $7E-2$ mrad/calendar year, based on a point source of primary coolant N-16 in the steam generators. This source term was then projected onto the inside surface of the containment dome, taking credit for shielding provided by the containment dome and for distance attenuation. No credit was allowed for shielding by other structures or components within the Containment Building. The number of gammas per second was generated and then converted to a dose rate at the given distance by use of ANSI/ANS-6.6.1, "Calculation and Measurement of Direct and Scattered Gamma Radiation from LWR Nuclear Power Plant 1979", which considers attenuation and buildup in air. The final value is based on one unit operating at 100% Power. The distance was determined to be 367 meters, which is approximately the closest point of the boundary of the Owner Controlled Area fence which is not obscured by significant plant structures (Ref. 11.14.3).

The maximum direct radiation dose from the Unit to the farmer is thus approximately $9E-3$ mrad per year, assuming a maximum occupancy of 1100 hours per year.

Equipment Hatch Platform and Missile Shield Modification 03-1008 was completed in late 2005. HPCI 06-01 was generated using actual radiation survey data at 100% Reactor power in order to calculate direct radiation dose from the Unit as a result of the modification. The calculated direct radiation dose from the Unit to a MEMBER OF THE PUBLIC was determined to be $8.99E-06$ mrem per year. (Ref. 11.14.10)

4.1.3.1.3 Direct Radiation Dose From On-Site Storage Of Low Level Radioactive Waste

On-site storage for radioactive wastes is located in Stores II and Plant Southwest of the radwaste building in the Radwaste Yard. The Radwaste Yard consists of a concrete pad enclosed by a fence. The area is also bounded on two sides by the radwaste building and is partially bounded on a third side by the Discharge monitoring tanks dike system. The radioactive wastes are stored in this area using high integrity containers (HIC) inside Onsite Storage Containers (OSC) and LSA type storage containers. The HIC has the highest potential for containing significant amounts of radioactive material, and constitutes the most significant source of direct radiation from on-site radioactive waste storage

The HICs typically are right circular cylinders approximately 1.7 meters in diameter and 1.8 meters in height. The HICs are stored inside OSCs which typically are constructed of concrete with additional shielding as necessary to minimize external doses. The individual parameters (e.g., dimensions, shielding material, etc.) for each OSC will be accounted for in the calculations.

The direct radiation dose from the HICs is the summation of the individual calculated HIC doses based on the HIC isotopic contents and the OSC design parameters, considering buildup, attenuation, and shielding. Appropriate methodology for calculating the dose rate from the HICs is given in Safety Analysis Calculations ZZ-293 and ZZ-310. The computer program MICROSSHIELD (Ref. 11.18) will normally be utilized to perform this calculation.

Direct radiation dose from the HICs and the Radwaste yard (Ref. 11.20) to a MEMBER OF THE PUBLIC is determined at the nearest point of the Owner Controlled Area fence which is not obscured by significant plant structures.

Direct radiation dose from radioactive material storage at Stores II to a MEMBER OF THE PUBLIC is determined at the nearest point of the Owner Controlled Area fence which is not obscured by significant plant structures. (Ref. 11.19)


4.1.3.1.4

Direct Radiation Dose From On-Site Storage Of Steam Generators

The Old Steam Generator Storage Facility (OSGSF) was constructed to house steam generators following replacement in Refuel 14. The OSGSF building is located inside the Owner Controlled Area (OCA) Plant East of the cooling tower.

The OSGSF is constructed with 2' thick concrete walls and a 2' thick ceiling specifically designed for shielding of residual radioactivity in the steam generators.

Direct radiation dose from the OSGSF to a MEMBER OF THE PUBLIC is determined using radiation survey data at the nearest point of the Owner Controlled Area fence which is unobscured by significant plant structures. The distance was determined to be 420 feet.

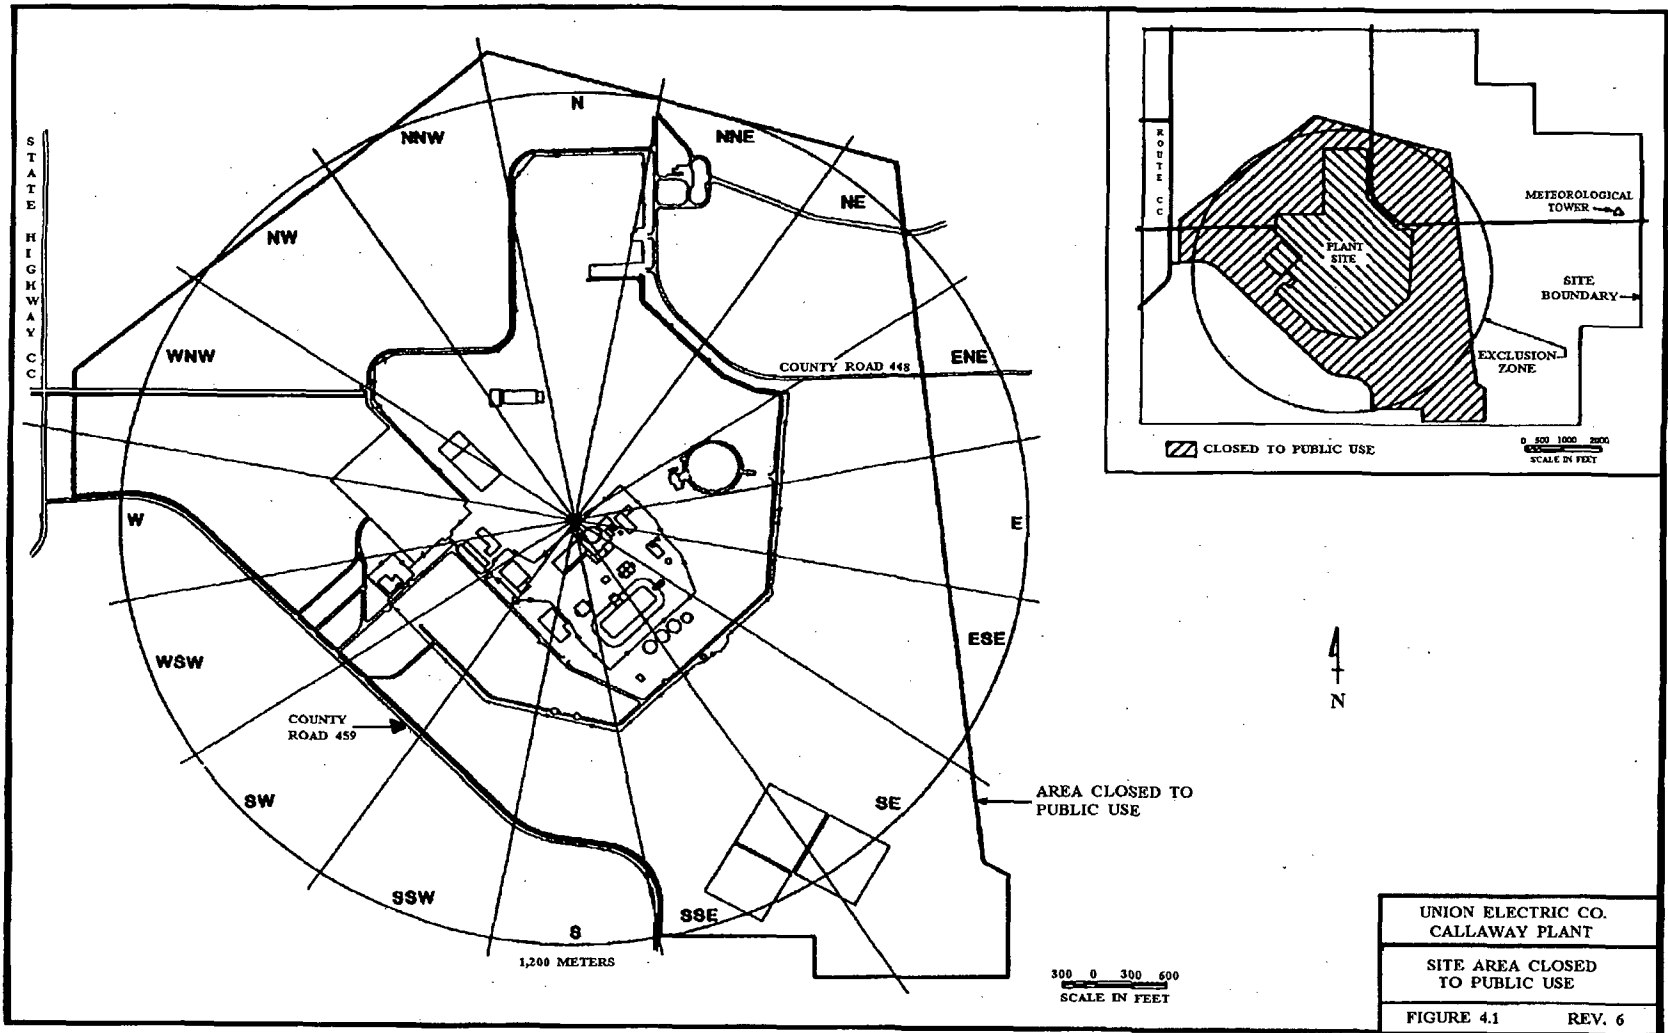

5 RADIOLOGICAL ENVIRONMENTAL MONITORING

5.1 DESCRIPTION OF THE RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

The Radiological Environmental Monitoring Program is intended to act as a background data base for preoperation and to supplement the radiological effluent release monitoring program during plant operation. Radiation exposure to the public from the various specific pathways and direct radiation can be adequately evaluated by this program.

Some deviations from the sampling frequency may be necessary due to seasonal unavailability, hazardous conditions, or other legitimate reasons. Efforts are made to obtain all required samples within the required time frame. Any deviation(s) in sampling frequency or location is documented in the Annual Radiological Environmental Operating Report.

REMP sampling locations that use meteorological sectors and or distance from the plant site were verified as described in reference 11.28.

Sampling, reporting, and analytical requirements are given in FSAR-SP TABLES 16.11-7, 16.11-8, and 16.11-9.

Airborne, waterborne, direct radiation, and ingestion samples collected under the monitoring program are analyzed by an independent, third-party laboratory. With the exception of direct radiation, the laboratory is required to participate in an Interlaboratory Analyses Program Per Reg. Guide 4.15 (REF 11.14.14). The laboratory participates in an Interlaboratory crosscheck program administered by Environmental Resources Associates (ERA), Mixed Analyte Performance Evaluation Program (MAPEP), or equivalent program. This participation includes all of the determinations (sample medium - radionuclide combination) that are both offered by ERA and/or MAPEP and included in the environmental monitoring program.

5.2 PERFORMANCE TESTING OF ENVIRONMENTAL THERMOLUMINESCENCE DOSIMETERS

Thermoluminescence Detectors (TLD's) used in the Radiological Environmental Monitoring Program are tested for accuracy and precision to demonstrate compliance with Regulatory Guide 4.13 (Ref. 11.16).

6 DETERMINATION OF ANNUAL AVERAGE AND SHORT TERM ATMOSPHERIC DISPERSION PARAMETERS

6.1 ATMOSPHERIC DISPERSION PARAMETERS

The values presented in Table 6.1 and Table 6.2 were determined through the analysis of on-site meteorological data collected during the three year period of May 4, 1973 to May 5, 1975 and March 16, 1978 to March 16, 1979.

6.1.1 LONG-TERM DISPERSION ESTIMATES

The variable trajectory plume segment atmospheric transport model MESODIF-II (NUREG/-CR-0523) and the straight-line Gaussian dispersion model XOQDOQ (NUREG/CR2919) were used for determination of the long-term atmospheric dispersion parameters. A more detailed discussion of the methodology and data utilized to calculate these parameters can be found elsewhere (Ref. 11.6.12).

The Unit Vent and Radwaste Building Vent releases are at elevations of 66.5 meters and 20 meters above grade, respectively. Both release points are within the building wake of the structures on which they are located, and the unit Vent is equipped with a rain cover which effectively eliminates the possibility of the exit velocity exceeding five times the horizontal wind speed. All gaseous releases are thus considered to be ground-level releases, and therefore no mixed mode or elevated release dispersion parameters were determined (Ref. 11.5.2).

6.1.2

DETERMINATION OF LONG-TERM DISPERSION ESTIMATES FOR SPECIAL RECEPTOR LOCATIONS

Calculations utilizing the PUFF model were performed for 22 standard distances to obtain the desired dispersion parameters. Dispersion parameters at the SITE BOUNDARY and at special receptor locations were estimated by logarithmic interpolation according to (Ref. 11.6.13):

$$X = X_1 (d/d_1)^B \quad (6.1)$$

Where:

$$B = \ln (X_2 / X_1) / \ln (d_2 / d_1).$$

X_1, X_2 = Atmospheric dispersion parameters at distance d_1 and d_2 , respectively, from the source.

The distances d_1 and d_2 were selected such that they satisfy the relationship.

$$d_1 < d < d_2$$

6.1.3

SHORT TERM DISPERSION ESTIMATES

Airborne releases are classified as short term if they are less than or equal to 500 hours during a calendar year and not more than 150 hours in any quarter. Short term dispersion estimates are determined by multiplying the appropriate long term dispersion estimate by a correction factor (Ref. 11.9.1 and 11.15.1):

$$F = (T_s / T_a)^S \quad (6.2)$$

Where:

T_s = The total number of hours of the short term release.

T_a = The total number of hours in the data collection period from which the long term diffusion estimate was determined (Refer to Section 6.1).

Values of the slope factor (S), are presented in Table 6.3.

Short term dispersion estimates are not applicable to short term releases which are sufficiently random in both time of day and duration (e.g., the short term release periods are not dependent solely on atmospheric conditions or time of day) to be represented by the annual average dispersion conditions (Ref. 11.8.1).

6.1.3.1 The Determination of the Slope Factor (S)

The general approach employed by subroutine PURGE of XOQDOQ (Ref. 11.15.1) was utilized to produce values of the slope of the (X/Q) curves for both the Radwaste Building Vent and the Unit Vent. However, instead of using approximation procedures to produce the 15 percentile (X/Q) values, the 15 percentile (X/Q) value for each release and at each location was determined by ranking all the 1-hour((X/Q)₁) values for that release and at that location in descending order. The (X/Q)₁ value which corresponded to the 15 percentile of all the calculated (X/Q) values within a sector was extracted for use in the intermittent release (X/Q) calculation.

The intermittent release (X/Q) curve was constructed using the calculated 15 percentile (X/Q)₁ and its corresponding annual average (X/Q)_a. A graphic representation of how the computational procedure works is illustrated by Figure 4.8 of reference 11.15.1. The straight line connecting these points represents (X/Q)₁ values for intermittent releases, ranging in duration from one hour to 8760 hours. The slope (S) of the curve is expressed as:

$$S = \frac{-\log \left((X/Q)_1 / (X/Q)_a \right)}{\log \left(T_a / T_1 \right)} \quad (6.3)$$

or

$$S = \frac{-(\log (X/Q)_1 - \log (X/Q)_a)}{\log T_a - \log T_1} \quad (6.4)$$

6.1.4 Atmospheric Dispersion Parameters for Farming Areas within the SITE BOUNDARY

The dispersion parameters for farming areas within the SITE BOUNDARY are intended for a narrow scope application: That of calculating the dose to the current farmer from gaseous effluents while he conducts farming activities within the SITE BOUNDARY.

For the purpose of these calculations, it was assumed that all of the farmer's time, approximately 1100 hours per year, is spent on croplands within the SITE BOUNDARY, and that his time is divided evenly over all of the croplands. Fractional acreage/time - weighted dispersion parameters were calculated for each plot as described in reference 11.5.6. The weighted dispersion parameters for each plot were then summed (according to type) in order to produce a composite value of the dispersion parameters which are presented in Tables 6.1 and 6.2. These dispersion parameters therefore represent the distributed activities of the farmer within the SITE BOUNDARY and his estimated occupancy period.

6.2 ANNUAL METEOROLOGICAL DATA PROCESSING

The annual atmospheric dispersion parameters utilized in the calculation of doses for demonstration of compliance with the numerical dose objectives of 10 CFR 50, Appendix I, are determined using computer codes and models consistent with XOQDOQ (Ref. 11.15). These codes have been validated and verified by a qualified meteorologist prior to implementation. Multiple sensors are utilized to ensure 90% valid data recovery for the wind speed, wind direction, and ambient air temperature parameters as required by Regulatory Guide 1.23. The selection hierarchy is presented in Table 6.5.

The vertical height of the highest adjacent building (V) used to perform concurrent year annual average atmospheric dispersion (X/Q) calculations is 169.16 meters (Ref. 11.29).

Meteorological Data is periodically verified to ensure valid data is being collected. Health Physics is responsible to ensure this review is performed.

TABLE 6.1
HIGHEST ANNUAL AVERAGE ATMOSPHERIC DISPERSION PARAMETERS
UNIT VENT

LOCATION (b)	SECTOR	DISTANCE (METERS)	X/Q (sec/m ³)	X/Q DECAYED/ UNDEPLETED (sec/m ³)	X/Q DECAYED/ DEPLETED (sec/m ³)	D/Q (m ⁻²)
SITE BOUNDARY(a)	NNW	2200	1.0E-6	9.9E-7	8.5E-7	4.3E-9
Nearest Residence (c) (d)	NNW	2897	6.7E-7	6.6E-7	5.6E-7	2.6E-9
Farmer's Residence(c) (f)	NNW	2897	6.7E-7	6.6E-7	5.6E-7	2.6E-9
Farming Areas within the Site Boundary (c) (e)	N/A	N/A	2.6E-7	2.6E-7	2.4E-7	1.3E-9

(a) Values given are from **FSAR-SA TABLE 2.3-82**

(b) Data from 2002 Land Use Census

(c) Values derived from **FSAR-SA TABLE 2.3-83**, using the methodology presented in Equation (6.1) (Ref. 11.5.6)

(d) All pathways are assumed to exist at the location of the nearest resident.

(e) These values were derived for a narrow scope application. Extreme caution should be exercised when determining their suitability for use in other applications.

(f) In 2002, the Farmer moved to a new location directly across the street from the nearest resident. For conservatism, the same dispersion parameters are used.

Building Shape Parameter (C) = 0.5 (Ref. 11.5.3)

Vertical Height of Highest Adjacent Building (V) = 66.45 meters (Ref. 11.5.3)

TABLE 6.2
HIGHEST ANNUAL AVERAGE ATMOSPHERIC DISPERSION PARAMETERS
RADWASTE VENT AND LAUNDRY DECON FACILITY DRYER EXHAUST

LOCATION (b)	SECTOR	DISTANCE (METERS)	X/Q (sec/m ³)	X/Q DECAYED/ UNDEPLETED (sec/m ³)	X/Q DECAYED/ DEPLETED (sec/m ³)	D/Q (m ⁻²)
SITE BOUNDARY(a)	NNW	2200	1.3E-6	1.3E-6	1.1E-6	4.3E-9
Nearest Residence (c) (d)	NNW	2897	8.5E-7	8.5E-7	7.1E-7	2.6E-9
Farmer's Residence(c)(f)	NNW	2897	8.5E-7	8.5E-7	7.1E-7	2.6E-9
Farming Areas Within Site Boundary (c) (e)	N/A	N/A	3.5E-7	3.5E-7	3.2E-7	1.3E-9

(a) Values given are from FSAR-SA TABLE 2.3-84,

(b) Data from 2002 Land Use Census

(c) Values derived from FSAR-SA TABLE 2.3-81, using the methodology presented in Equation (6.1) (Ref. 11.5.6)

(d) All pathways are assumed to exist at the location of the nearest resident.

(e) These values were derived for a narrow scope application. Extreme caution should be exercised when determining their suitability for use in other applications.

(f) In 2002, the farmer moved to a new location directly across the street from the nearest residence. For conservatism, the same dispersion parameters are used.

Building Shape Parameter (C) = 0.5 (Ref. 11.5.3)

Vertical Height of Highest Adjacent Building (V) = 19.96 meters (Ref. 11.5.3)

TABLE 6.3
SHORT DISPERSION PARAMETERS (a) (c)

Location (b)	Sector	Distance	Slope Factor(s)	
			Unit Vent	Radwaste Building Vent
Site Boundary	S	1300	-0.328	-0.320
Nearest Residence (d)	NNW	2897	-0.264	-0.268

- (a) Reference 11.5.3
- (b) Data from 1998 Land Use Census
- (c) Recirculation Factor = 1.0
- (d) All pathways are assumed to exist at the location of the nearest resident.

TABLE 6.4
APPLICATION OF ATMOSPHERIC DISPERSION PARAMETERS

<u>Dose Pathway</u>	<u>Dispersion Parameter</u>	<u>Controlling Age Group</u>	<u>Rec</u>	<u>Controlling Location</u>
Noble Gas, Beta Air & Gamma Air	X/Q, decayed/undepleted (2.26 day half-life)	N/A	16.11.2.2	Site Boundary
Noble Gas, Total Body & Skin	X/Q, decayed/undepleted (2.26 day half-life)	N/A	16.11.2.1	Site Boundary
Inhalation	X/Q, decayed/depleted (8 day half-life)	Child	16.11.2.1 16.11.2.3	Nearest Resident Site Boundary
Ground Plane Deposition	D/Q	N/A	16.11.2.3	Nearest Resident
Ingestion pathways	D/Q*	Child	16.11.2.3	Nearest Resident

* For H-3, X/Q, decayed/depleted is used instead of D/Q (Ref. 11.11.1).

TABLE 6.5

METEOROLOGICAL DATA SELECTION HIEARCHY

Parameter	Primary	First	Second	Third
		Alternate	Alternate	Alternate
Wind Speed	10m A	10m B	60m A	60m B
Wind Direction	10m A	10m B	60m A	60m B
Air Temperature	10m A	10m B		
Wind Variability	10m A	10m B	60m A	60m B
Temp Different	60-10m A	60-10m B		
Dewpoint/Relative Humidity	10m A	60m B		
Precipitation	1m			

(a) A indicates Alpha train meteorological instrumentation.

(b) B indicates Bravo train meteorological instrumentation.

Table 6.6

Application of Atmospheric Dispersion Parameters: Radioactive Effluent Release Report

Dose Pathway	Dispersion Parameter	Controlling Age Group	Dispersion Values	Controlling Location
Noble Gas, Beta Air & Gamma Air Dose	X/Q, decayed/undepleted (2.26 day half-life)	N/A	Concurrent	Site Boundary Nearest Resident
Noble Gas, Total Body & Skin Dose	X/Q, decayed/undepleted (2.26 day half-life)	N/A	Concurrent	Site Boundary Nearest Resident
			Concurrent Historical	Farmer's Residence Inside Site Boundary
Ground Plane Deposition Dose	D/Q	N/A	Concurrent	Site Boundary Nearest Resident
			Concurrent Historical	Farmer's Residence Inside Site Boundary
Inhalation Dose	X/Q, decayed/depleted (8 day half-life)	Child	Concurrent	Site Boundary Nearest Resident
		Adult	Concurrent Historical	Farmer's Residence Inside Site Boundary
Ingestion Dose Pathways	D/Q*	Child	Concurrent	Site Boundary Nearest Resident
		Adult	Concurrent Historical	Farmer's Residence Inside Site Boundary

* For H-3, X/Q, decayed/depleted is used instead of D/Q (Ref. 11.11.1).

7 REPORTING REQUIREMENTS

7.1 ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

The reporting requirements for the Annual Radiological Environmental Operating Report (AREOR) have been relocated to **FSAR-SP 16.11.5.1**.

7.2 ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT

The reporting requirements for the Annual Radioactive Effluent Release Report (ARERR) have been relocated to **FSAR-SP 16.11.5.2**. The application of atmospheric dispersion parameters in the report is presented in Table 6.6.

8

IMPLEMENTATION OF ODCM METHODOLOGY (COMN 2791)

The ODCM provides the mathematical relationships used to implement the Radioactive Effluent Controls. For routine effluent release and dose assessment, computer codes are utilized to implement the ODCM methodologies. These codes are evaluated in accordance with the requirements of plant operating procedures to ensure that they produce results consistent with the methodologies presented in the ODCM. Plant procedures implement the ODCM methodology.

9

RADIOACTIVE EFFLUENT CONTROLS (REC)

The Radioactive Effluent Controls have been relocated to **FSAR-SP CHAPTER 16.11**, "Offsite Dose Calculation Manual Radioactive Effluent Controls". The former ODCM REC numbers appear on each of the RECs in **FSAR-SP CHAPTER 16.11**, and may be used as a cross-reference between the previous and the current numbering system if necessary.

10 ADMINISTRATIVE CONTROLS

10.1 MAJOR CHANGES TO LIQUID AND GASEOUS RADWASTE TREATMENT SYSTEMS

10.1.1 Licensee-initiated major changes to the Radwaste Treatment Systems (liquid and gaseous):

- a. A summary of the change MUST be reported to the Commission in the Radioactive Effluent Release Report for the period in which the evaluation was reviewed by the On-Site Review Committee (ORC). On site documentation MUST contain:
- 1) A summary of the evaluation that led to the determination that the change could be made in accordance with 10 CFR 50.59;
 - 2) Sufficient detailed information to totally support the reason for the change without benefit of additional or supplemental information;
 - 3) A detailed description of the equipment, components and process involved and the interfaces with other plant systems;
 - 4) An evaluation of the change, which shows the predicted releases of radioactive materials in liquid and gaseous effluents that differ from those previously predicted in the License application and amendments thereto;
 - 5) An evaluation of the change, which shows the expected maximum exposures to a MEMBER OF THE PUBLIC in the UNRESTRICTED AREA and to the general population that differ from those previously estimated in the License application and amendments thereto;
 - 6) A comparison of the predicted releases of radioactive materials, in liquid and gaseous effluents, to the actual releases for the period prior to when the changes are to be made;
 - 7) An estimate of the exposure to plant operating personnel as a result of the change; and
 - 8) Documentation of the fact that the change was reviewed and found acceptable by the ORC.
- b. Changes to the Radwaste Treatment Systems Shall become effective upon review and approval by the ORC.

10.2 CHANGES TO THE OFFSITE DOSE CALCULATION MANUAL (ODCM) (COMN 2815)

10.2.1 All changes to the ODCM shall be completed pursuant to T/S AC 5.5.1 and approved Per APA-ZZ-00101, "Preparation, Review, Approval and Control of Procedures".

10.2.1.1 All changes shall be approved by the ORC prior to implementation.

10.2.2 Review for each revision of the ODCM must include the Health Physics Department.

10.2.3 A complete and legible copy of each revision of the ODCM that became effective during the last annual period shall be submitted as a part of, or concurrent with that years Radioactive Effluent Release Report pursuant to T/S AC 5.5.1.

- 11 REFERENCES
- 11.1 Title 10, "Energy", Chapter 1, Code of Federal Regulations, Part 20; U.S. Government Printing Office, Washington, D.C. 20402.
- 11.1.1 Statements of Consideration, Federal Register, Vol. 56, No. 98, Tuesday, May 21, 1991, Subpart D, page 23374.
- 11.2 Title 10, "Energy", Chapter 1, Code of Federal Regulations, Part 50, Appendix I; U.S. Government Printing Office, Washington, D.C. 20402.
- 11.2.1 10 CFR 50.36 a (b)
- 11.3 Title 40, "Protection of Environment", Chapter 1, Code of Federal Regulations, Part 190; U.S. Government Print Office, Washington, D.C. 20402.
- 11.4 U.S. Nuclear Regulatory Commission, "Technical Specifications Callaway Plant, Unit NO. 1", NUREG-1058 (Rev. 1), October 1984. Section 5.4.1
- 11.5 COMMUNICATIONS
- 11.5.1 Letter NEO-54, D. W. Capone to S. E. Miltenberger, dated January 5, 1983; Union Electric Company correspondence.
- 11.5.2 Letter BLUE 1285, "Callaway Annual Average X/Q and D/Q Values", J. H. Smith (Bechtel Power Corporation), to D. W. Capone (Union Electric Co.), dated February 27, 1984.
- 11.5.3 Letter BLUE 1232, "Callaway Annual Average X/Q Values and "S" Values", J. H. Smith (Bechtel Power Corporation) to D. W. Capone (Union Electric Co.), dated February 9, 1984.
- 11.5.4 Reference Deleted
- 11.5.5 Private Communication, H. C. Lindeman & B.F. Holderness, August 6, 1986
- 11.5.6 Calculation ZZ-67, "Annual Average Atmospheric Dispersion Parameters", April 1989.
- 11.6 Union Electric Company Callaway Plant, Unit 1, Final Safety Analysis Report.
- 11.6.1 Section 11.5.2.2.3.1
- 11.6.2 Section 11.5.2.2.3.4
- 11.6.3 Section 11.5.2.1.2
- 11.6.4 Section 11.5.2.2.3.2
- 11.6.5 Section 11.5.2.2.3.3
- 11.6.6 Section 11.2.3.3.4
- 11.6.7 Section 11.2.3.4.3
- 11.6.8 Section 11.5.2.3.3.1
- 11.6.9 Section 11.5.2.3.3.2
- 11.6.10 Section 11.5.2.3.2.3
- 11.6.11 Section 11.5.2.3.2.2
- 11.6.12 Section 2.3.5
- 11.6.13 Section 2.3.5.2.1.2
- 11.6.14 Section 9.2.6
- 11.6.15 Section 9.2.7.2.1
- 11.6.16 Section 6.3.2.2
- 11.6.17 Table 11.1-6
- 11.6.18 CAR 200700053 – Attachments: Phase 1 Final Draft

11.6.19	Deleted
11.6.20	Deleted
11.6.21	Deleted
11.6.22	Table 2.3-68
11.7	Union Electric Company Callaway Plant Environmental Report, Operating License Stage.
11.7.1	Table 2.1-19
11.7.2	Section 2.1.2.3
11.7.3	Section 2.1.3.3.4
11.7.4	Section 5.2.4.1
11.7.5	Table 2.1-19
11.8	U.S. Nuclear Regulatory Commission, "Preparation of Radiological Effluent Technical Specification for Nuclear Power Plants", USNRC NUREG-0133, Washington, D. C. 20555, October 1978.
11.8.1	Pages AA-1 through AA-3
11.8.2	Section 5.3.1.3
11.8.3	Section 4.3
11.8.4	Section 5.3.1.5
11.8.5	Section 5.1.1
11.8.6	Section 5.1.2
11.8.7	Section 5.2.1
11.8.8	Section 5.2.1.1
11.8.9	Section 5.3.1
11.8.10	Section 3.8
11.8.11	Section 3.3
11.9	U.S. Nuclear Regulatory Commission, "XOQDOQ, Program For the Meteorological Evaluation of Routine Effluent Releases at Nuclear Power Stations", USNRC NUREG-0324, Washington, D. C. 20555.
11.9.1	Pages 19-20 Subroutine PURGE
11.10	Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors", Revision 1, U. S. Nuclear Regulatory Commission, Washington, D. D. 20555, July, 1977.
11.10.1	Section c.1.b
11.10.2	Figures 7 through 10
11.10.3	Section c.4
11.11	Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purposes of Evaluating Compliance with 10 CFR Part 50, Appendix I", Revision 1, U. S. Nuclear Regulatory Commission, Washington, D. C. 20555, October 1977.
11.11.1	Appendix C, Section 3.a
11.11.2	Appendix E, Table E-15
11.11.3	Appendix C, Section 1
11.11.4	Appendix E, Table E-11

- 11.11.5 Appendix E, Table E-9
- 11.12 U. S. Nuclear Regulatory Commission, "Methods for Demonstrating LWR Compliance with the EPA Uranium Fuel Cycle Standard (40 CFR Part 190)", USNRC NUREG-0543, Washington, D. C. 20555, January 1980.
- 11.12.1 Section I, Page 2
- 11.12.2 Section IV, Page 8
- 11.12.3 Section IV, Page 9
- 11.12.4 Section III, Page 6
- 11.12.5 Section III, Page 8
- 11.13 Management Agreement for the Public Use of Lands, Union Electric Company and the State of Missouri Department of Conservation, December 21, 1982.
- 11.13.1 Exhibit A
- 11.14 MISCELLANEOUS REFERENCES
- 11.14.1 Drawing Number M-109-0007-06, Revision 5
- 11.14.2 Callaway Plant Annual Environmental Operating Report (updated annually)
- 11.14.3 UE Safety Analysis Calculation 87-001-00
- 11.14.4 Calculation ZZ-48, "Calculation of Inhalation and Ingestion Dose Commitment Factors for the Adult and Child", January, 1988
- 11.14.5 HPCI 89-02, "Calculation of ODCM Dose Commitment Factors", March, 1989
- 11.14.6 Deleted
- 11.14.7 HPCI 87-10, Rev. 1, "Methodology for Calculating the Response of Gross NaI(Tl) Monitors to Liquid Effluent Streams", April, 2005
- 11.14.8 Calculation ZZ-57, "Dose Factors for Eu-154", January, 1989
- 11.14.9 Calculation ZZ-78, Rev. 2, "ODCM Gaseous Pathway Dose Factors for Adult Age Group", July, 1992.
- 11.14.10 HPCI 06-01, Rev. 0, "Equipment Hatch Platform and Missile Shield Modification Direct Dose Calculation to the Member of the Public", January, 2006.
- 11.14.11 Calculation ZZ-250, Rev. 0, "ODCM Gaseous Pathway Dose Factors for Child Age Group and Ground Plane Dose Factors", September, 1992.
- 11.14.12 UOTH 83-58, "Documentation of ODCM Dose Factors and Parameters", February, 1983.
- 11.14.13 Calculation HPCI 04-06 (Rev. 1), "Calculation of Liquid Effluent Dose Commitment Factors (A_{id}) for the Adult Age Group", November, 2004.
- 11.14.14 Regulatory Guide 4.15, "Quality Assurance for Radiological Monitoring Programs (Normal Operations) – Effluent Streams and the Environment" (Revision 1), February 1979; USNRC, Washington, D. C. 20555
- 11.15 U. S. Nuclear Regulatory Commission, "XOQDOQ: Computer Program for the Meteorological Evaluation of Routine Effluent Releases at Nuclear Power Stations", USNRC NUREG/CR-2919, September 1982, Washington, D. C. 20555
- 11.15.1 Section 4, "Subroutine PURGE", pages 27 and 28
- 11.16 Regulatory Guide 4.13, "Performance, Testing, and procedural specifications for Thermoluminescence Dosimetry: Environmental Applications "(Revision 1), July 1977; USNRC, Washington, D. C. 20555
- 11.17 TID-7004, "Reactor Shielding Design Manual", Rockwell, Theodore, Ed; March 1956.
- 11.18 MICROSIELD, Grove Engineering Inc.

- 11.19 HPCI 05-09, "Radiological Environmental Monitoring Program (REMP) calculation of direct dose from RAM storage at Stores II".
- 11.20 HPCI 05-10, "Radiological Environmental Monitoring Program (REMP) calculation of direct dose from RAM storage in the Radwaste Yard".
- 11.21 ANSI N13.10-1974, "Specification & Performance of On-Site Instrumentation for Continuously Monitoring Radioactivity in Effluents"; September, 1974
- 11.22 Nuclear Regulatory Commission Generic Letter 89-01, "Guidance for the Implementation of Programmatic Controls for RETS in the Administrative Controls Section of Technical Specifications and the Relocation of Procedural Details of Current RETS to the Offsite Dose Calculation Manual or Process Control Program", January 1989
- 11.23 NRC Answers to 10 CFR 20 Implementation Questions
 - 11.23.1 Letter, F. J. Congel to J. F. Schmidt, dated December 9, 1991.
 - 11.23.2 Internal USNRC memo, F. J. Congel to V. L. Miller, et al, dated April 17, 1992.
 - 11.23.3 Letter, F. J. Congel to J. F. Schmidt, dated April 23, 1992.
 - 11.23.4 Letter, F. J. Congel to J. F. Schmidt, dated September 14, 1992.
 - 11.23.5 Letter, F. J. Congel to J. F. Schmidt, dated June 8, 1993.
- 11.24 USNRC Inspection Report 50-483/92002(DRSS) Section 5, page 5.
- 11.25 HPCI 96-005, "Calculation of Maximum Background Value for HB-RE-18".
- 11.26 EGG-PHY-9703, "Technical Evaluation Report for the evaluation of ODCM Revision 0 (May, 1990) Callaway Plant, Unit 1", transmitted via letter, Samuel J. Collins (USNRC) to D. F. Schnell (UE), dated July 12, 1996.
- 11.27 HPCI 99-005, "Calculation of Setpoint for GL-RE-202".
- 11.28 HPCI 99-001, "Documentation of REMP Procedure Changes".
- 11.29 "Technical Specifications for Callaway Plant Meteorological Data Software"

Attachment 3 to
ULNRC-05508

Attachment 3

Callaway FSAR
Standard Plant Chapter 16.11
Offsite Dose

16.11 OFFSITE DOSE CALCULATION MANUAL
(ODCM 9.0) RADIOACTIVE EFFLUENT CONTROLS

16.11.1 LIQUID EFFLUENT

16.11.1.1 LIQUID EFFLUENTS CONCENTRATION LIMITING CONDITION FOR
OPERATION

(ODCM 9.3.1)

The concentration of radioactive material released in liquid effluents to UNRESTRICTED AREAS (see Figure 16.11-1) shall be limited to 10 times the concentration values in Appendix B, Table 2, Column 2 to 10 CFR 20.1001-20.2402, for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the concentration shall be limited to 2×10^{-4} microCurie/ml total activity.

APPLICABILITY: At all times.

ACTION:

- a. With the concentration of radioactive material released in liquid effluents to UNRESTRICTED AREAS exceeding the above limits, immediately restore the concentration to within the above limits.
- b. The provisions of Sections 16.0.1.3 and 16.0.1.4 are not applicable.

16.11.1.1.1 SURVEILLANCE REQUIREMENTS

(ODCM 9.3.2)

16.11.1.1.1.a

Radioactive liquid wastes shall be sampled and analyzed according to the sampling and analysis program of Table 16.11-1.

16.11.1.1.1.b

The results of the radioactivity analysis shall be used in accordance with the methodology and parameters in the ODCM to assure that the concentrations at the point of release are maintained within the limits of Section 16.11.1.1.

16.11.1.1.2 BASES

This section is provided to ensure that the concentration of radioactive materials released in liquid waste effluents to UNRESTRICTED AREAS will be less than 10 times the concentration in Appendix B, Table 2, Column 2 to 10 CFR 20.1001-20.2402. This limitation provides additional assurance that the levels of radioactive materials in bodies

CALLAWAY - SP

of water in UNRESTRICTED AREAS will result in exposures within: (1) the Section II.A design objectives of Appendix I, 10 CFR Part 50, to a MEMBER OF THE PUBLIC, and (2) the limits of 10 CFR Part 20.1301 to the population. The concentration limit for dissolved or entrained noble gases is based upon the assumption that Xe-135 is the controlling radioisotope and its MPC in air (submersion) was converted to an equivalent concentration in water using the methods described in International Commission on Radiological Protection (ICRP) Publication 2.

The required detection capabilities for radioactive materials in liquid waste samples are tabulated in terms of the lower limits of detection (LLD's).

16.11.1.2 DOSE FROM LIQUID EFFLUENTS LIMITING CONDITION FOR
OPERATION

(ODCM 9.4.1)

The dose or dose commitment to a MEMBER OF THE PUBLIC from radioactive materials in liquid effluents released, from each unit, to UNRESTRICTED AREAS (see Figure 16.11-1) shall be limited:

- a. During any calendar quarter to less than or equal to 1.5 mrem to the whole body and to less than or equal to 5 mrem to any organ, and
- b. During any calendar year to less than or equal to 3 mrem to the whole body and to less than or equal to 10 mrem to any organ.

APPLICABILITY: At all times.

ACTION:

- a. With the calculated dose from the release of radioactive materials in liquid effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits. This Special Report shall also include: (1) the results of radiological analyses of the drinking water source, and (2) the radiological impact on finished drinking water supplies with regard to the requirements of 40 CFR Part 141, Clean Drinking Water Act.*
- b. The provisions of Sections 16.0.1.3 and 16.0.1.4 are not applicable.

16.11.1.2.1 SURVEILLANCE REQUIREMENTS

(ODCM 9.4.2)

Cumulative dose contributions from liquid effluents for the current calendar quarter and the current calendar year shall be determined in accordance with the methodology and parameters in the ODCM at least once per 31 days.

* The requirements of ACTION a.(1) and (2) are applicable only if drinking water supply is taken from the receiving water body within 3 miles of the plant discharge. In the case of river-sited plants this is 3 miles downstream only.

16.11.1.2.2 BASES

This section is provided to implement the requirements of Sections II.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Condition for Operation implements the guides set forth in Section II.A of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in liquid effluents to UNRESTRICTED AREAS will be kept "as low as is reasonably achievable".

Also, for fresh water sites with drinking water supplies that can be potentially affected by plant operations, there is reasonable assurance that the operation of the facility will not result in radionuclide concentrations in the finished drinking water that are in excess of the requirements of 40 CFR Part 141. The dose calculation methodology and parameters in the ODCM implement the requirements in Section III.A of Appendix I which specify that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The equations specified in the ODCM for calculating the doses due to the actual release rates of radioactive materials in liquid effluents are consistent with the methodology provided in Regulatory Guide 1.109, "Calculations of Annual Doses to Man from Routine Releases of Reactor Effluents with 10 CFR Part 50, Appendix I", Revision 1, October 1977 and Regulatory Guide 1.113, "Estimating Aquatic and Dispersion of Effluents from accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I", April 1977.

The reporting requirements of Action(a) implement the requirements of 10CFR20.2203.

16.11.1.3 RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION
LIMITING CONDITION FOR OPERATION

(ODCM 9.1.1)

The radioactive liquid effluent monitoring instrumentation channels shown in Table 16.11-2 shall be OPERABLE with their Alarm/Trip Setpoints set to ensure that the limits of Section 16.11.1.1 are not exceeded. The Alarm/Trip Setpoints of these channels shall be determined and adjusted in accordance with the methodology and parameters in the ODCM.

APPLICABILITY: At all times.

ACTION:

- a. With a radioactive liquid effluent monitoring instrumentation channel Alarm/Trip Setpoint less conservative than required by the above, immediately suspend the release of radioactive liquid effluents monitored by the affected channel, or declare the channel inoperable.
- b. With less than the minimum number of radioactive liquid effluent monitoring instrumentation channels OPERABLE, take the ACTION shown in Table 16.11-2. Restore the inoperable instrumentation to OPERABLE status within 30 days and, if unsuccessful, explain in the next Radioactive Effluent Release Report, pursuant to Technical Specification 5.6.3, why this inoperability was not corrected within the time specified.
- c. The provisions of Sections 16.0.1.3 and 16.0.1.4 are not applicable.

16.11.1.3.1 SURVEILLANCE REQUIREMENTS

(ODCM 9.1.2)

Each radioactive liquid effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION and CHANNEL OPERATIONAL TEST at the frequencies shown in Table 16.11-3.

16.11.1.3.2 BASES

The radioactive liquid effluent monitoring instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in liquid effluents during actual or potential releases of liquid effluents. The Alarm/Trip Setpoints for these instruments shall be calculated and adjusted in accordance with the methodology and parameters in the ODCM to ensure that the alarm/trip will occur prior to exceeding the limits of 10 CFR Part 20. The OPERABILITY and use of this instrumentation is

CALLAWAY - SP

consistent with the requirements of General Design Criteria 60, 63, and 64 of Appendix A to 10 CFR Part 50.

16.11.1.4 LIQUID RADWASTE TREATMENT SYSTEM LIMITING CONDITION FOR OPERATION

(ODCM 9.5.1)

The Liquid Radwaste Treatment System shall be OPERABLE and appropriate portions of the system shall be used to reduce releases of radioactivity when the projected doses due to the liquid effluent, from each unit, to UNRESTRICTED AREAS (see Figure 16.11-1) would exceed 0.06 mrem to the whole body or 0.2 mrem to any organ in a 31 day period.

APPLICABILITY: At all times.

ACTION:

- I. With radioactive liquid waste being discharged in excess of the above limits and the Liquid Radwaste Treatment Systems are not being fully utilized, prepare and submit to the Commission within 30 days a Special Report that includes the following information:
 - 1) Explanation of why liquid radwaste was being discharged without treatment, identification of any inoperable equipment or subsystems, and the reason for the inoperability.
 - 2) Action(s) taken to restore the inoperable equipment to OPERABLE status, and
 - 3) Summary description of action(s) taken to prevent a recurrence.
- II. The provisions of Sections 16.0.1.3 and 16.0.1.4 are not applicable.

16.11.1.4.1 SURVEILLANCE REQUIREMENTS

(ODCM 9.5.2)

16.11.1.4.1.a

Doses due to liquid releases from each unit to UNRESTRICTED AREAS shall be projected at least once per 31 days in accordance with the methodology and parameters in the ODCM.

16.11.1.4.1.b

The installed Liquid Radwaste Treatment System shall be considered OPERABLE by meeting Sections 16.11.1.1 and 16.11.1.2.

16.11.1.4.2 BASES

The OPERABILITY of the Liquid Radwaste Treatment System ensures that this system will be available for use whenever liquid effluents require treatment prior to release to the environment. The requirement that the appropriate portions of this system be used when specified provides assurance that the releases of radioactive materials in liquid effluents will be kept "as low as is reasonably achievable". This section implements the requirements of 10 CFR Part 50.36a, General Design Criterion 60 of Appendix A to 10 CFR Part 50 and the design objective given in Section II.D of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the Liquid Radwaste Treatment System were specified as a suitable fraction of the dose design objectives set forth in Section II.A of Appendix I, 10 CFR Part 50, for liquid effluents.

16.11.1.5 LIQUID HOLDUP TANKS
(3/4.11.1.4) LIMITING CONDITION FOR OPERATION

(3.11.1.4)

The quantity of radioactive material contained in each of the following unprotected outdoor tanks shall be limited to less than or equal to 150 Curies, excluding tritium and dissolved or entrained noble gases:

- a. Reactor Makeup Water Storage Tank,
- b. Refueling Water Storage Tank,
- c. Condensate Storage Tank, and
- d. Outside temporary tanks, excluding demineralizer vessels and the liner being used to solidify radioactive waste.

APPLICABILITY: At all times.

ACTION:

- a. With the quantity of radioactive material in any of the above listed tanks exceeding the above limit, immediately suspend all additions of radioactive material to the tank, within 48 hours reduce the tank contents to within the limit, and describe the events leading to this condition in the next Radioactive Effluent Release Report, pursuant to Technical Specification 5.6.3.
- b. The provisions of Sections 16.0.1.3 and 16.0.1.4 are not applicable.

16.11.1.5.1 SURVEILLANCE REQUIREMENTS

(4.11.1.4)

The quantity of radioactive material contained in each of the above listed tanks shall be determined to be within the above limit by analyzing a representative sample of the tank's contents at least once per 7 days when radioactive materials are being added and within 7 days following any addition of radioactive material to the tank. The provisions of Sections 16.0.2.2 and 16.0.2.3 are applicable, however the allowed surveillance interval extension beyond 25% shall not be exceeded. These tanks are also covered by Administrative Controls Section 5.5.12.

16.11.1.5.2 BASES

The tanks listed above include all those outdoor radwaste tanks that are not surrounded by liners, dikes, or walls capable of holding the tank contents and that do not have tank

CALLAWAY - SP

overflows and surrounding area drains connected to the Liquid Radwaste Treatment System.

Restricting the quantity of radioactive material contained in the specified tanks provides assurance that in the event of an uncontrolled release of the tanks' contents, the resulting concentrations would be less than the limits of 10 CFR Part 20.1-20.602, Appendix B, Table II, Column 2, (redesignated at 56FR23391, May 21, 1991) at the nearest potable water supply and the nearest surface water supply in an UNRESTRICTED AREA.

16.11.2 GASEOUS EFFLUENTS

16.11.2.1 GASEOUS EFFLUENTS DOSE RATE LIMITING CONDITION OF OPERATION

(ODCM 9.6.1)

The dose rate due to radioactive materials released in gaseous effluents from the site to areas at and beyond the SITE BOUNDARY (see Figure 16.11-2) shall be limited to the following:

- a. For noble gases: Less than or equal to 500 mrem/yr to the whole body and less than or equal to 3000 mrem/yr to the skin, and
- b. For Iodine-131 and 133, for tritium, and for all radionuclides in particulate form with half-lives greater than 8 days: Less than or equal to 1500 mrem/yr to any organ.

APPLICABILITY: At all times.

ACTION:

- a. With the dose rate(s) exceeding the above limits, immediately restore the release rate to within the above limit(s).
- b. The provisions of Sections 16.0.1.3 and 16.0.1.4 are not applicable.

16.11.2.1.1 SURVEILLANCE REQUIREMENTS

(ODCM 9.6.2)

16.11.2.1.1.a

The dose rate due to noble gases in gaseous effluents shall be determined to be within the above limits in accordance with the methodology and parameters in the ODCM.

16.11.2.1.1.b

The dose rate due to Iodine-131 and 133, tritium and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents shall be determined to be within the above limits in accordance with the methodology and parameters in the ODCM by obtaining representative samples and performing analyses in accordance with the sampling and analysis program specified in Table 16.11-4.

16.11.2.1.2 BASES

This section is provided to ensure that the dose at any time at and beyond the SITE BOUNDARY from gaseous effluents from all units on the site will be within the annual dose limits of 10 CFR Part 20 to UNRESTRICTED AREAS. The dose rate limits are the doses associated with the concentrations of 10 CFR Part 20.1-20.601, Appendix B, Table II, Column 1. These limits provide reasonable assurance that radioactive material discharged in gaseous effluents will not result in the exposure of a MEMBER OF THE PUBLIC in an UNRESTRICTED AREA, either within or outside the SITE BOUNDARY, to annual average concentrations exceeding the dose limits specified in 10 CFR Part 20 10 CFR 20.1301. For MEMBERS OF THE PUBLIC who may at times be within the SITE BOUNDARY, the occupancy of that MEMBER OF THE PUBLIC will usually be sufficiently low to compensate for any increase in the atmospheric diffusion factor above that for the SITE BOUNDARY. Examples of calculations for such MEMBERS OF THE PUBLIC, with the appropriate occupancy factors, shall be given in the ODCM. The specified release rate limits restrict, at all times, the corresponding gamma and beta dose rates above background to a MEMBER OF THE PUBLIC at or beyond the SITE BOUNDARY to less than or equal to 500 mrem/year to the whole body or to less than or equal to 3000 mrems/year to the skin. These release rate limits also restrict, at all times, the corresponding thyroid dose rate above background to a child via the inhalation pathway to less than or equal to 1500 mrems/year.

The required detection capabilities for radioactive materials in gaseous waste samples are tabulated in terms of the lower limits of detection (LLD's).

The requirement for additional sampling of the Unit Vent following a reactor power transient is provided to ensure that the licensee is aware of and properly accounts for any increases in the release of gaseous effluents due to spiking which may occur as a result of the power transient. Monitoring the Unit Vent for increased noble gas activity is appropriate because it is the release point for any increased activity which may result from the power transient.

Since the escape rate coefficients for the noble gas nuclides is equal to or greater than the escape rate coefficient for iodine and the particulate nuclides^{*,**}, it is reasonable to assume that the RCS spiking behavior of the noble gas nuclides is similar to that of the particulate and iodine nuclides. Considering the effects of iodine and particulate partitioning, plateout on plant and ventilation system surfaces, and the 99% efficiency of the Unit Vent HEPA filters and charcoal absorbers, it is reasonable to assume that the relative concentrations of the noble gas nuclides will be much greater than those of the

* Cohen, Paul, Water Coolant Technology of Power Reactors, Table 5.19, page 198. American Nuclear Society. 1980.

** NUREG-0772, "Technical Bases for Estimating Fission Product Behavior During LWR Accidents", Silberberg, M., editor, USNRC; Figure 4.3, page 4.22. June, 1981.

CALLAWAY - SP

iodine and particulate nuclides. Therefore, an increase in the iodine and particulate RCS activity is not an appropriate indicator of an increase in the Unit Vent activity, and it is appropriate to monitor the Unit Vent effluent activity as opposed to the RCS activity as an indicator of the need to perform post-transient sampling. In addition, it is appropriate to monitor the noble gas activity due to its relatively greater concentration in the Unit Vent.

16.11.2.2 DOSE - NOBLE GASES LIMITING CONDITION OF OPERATION

(ODCM 9.7.1)

The air dose due to noble gases released in gaseous effluents, from each unit, to areas at and beyond the SITE BOUNDARY (see Figure 16.11-2) shall be limited to the following:

During any calendar quarter: Less than or equal to 5 mrads for gamma radiation and less than or equal to 10 mrads for beta radiation, and

During any calendar year: Less than or equal to 10 mrads for gamma radiation and less than or equal to 20 mrads for beta radiation.

APPLICABILITY: At all times.

ACTION:

- a. With the calculated air dose from radioactive noble gases in gaseous effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits.
- b. The provisions of Sections 16.0.1.3 and 16.0.1.4 are not applicable.

16.11.2.2.1 SURVEILLANCE REQUIREMENTS

(ODCM 9.7.2)

Cumulative dose contributions for the current calendar quarter and current calendar year for noble gases shall be determined in accordance with the methodology and parameters in the ODCM at least once per 31 days.

16.11.2.2.2 BASES

This section is provided to implement the requirements of Sections II.B, III.A, and IV.A of Appendix I, 10 CFR Part 50. The Limiting Conditions for Operation implements the guides set forth in Section II.B of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in gaseous effluents to UNRESTRICTED AREAS will be kept "as low as is reasonably achievable".

The Surveillance Requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data such that the actual exposure of a MEMBER OF THE

CALLAWAY - SP

PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The dose calculation methodology and parameters established in the ODCM for calculating the doses due to the actual release rates of radioactive noble gases in gaseous effluents are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases on Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I", Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water Cooled Reactors", Revision 1, July 1977. The ODCM equations provided for determining the air doses at and beyond the SITE BOUNDARY are based upon the historical average atmospheric conditions.

The reporting requirements of Action(a) implement the requirements of 10CFR20.2203.

16.11.2.3 DOSE - IODINE-131 AND 133, TRITIUM, AND RADIOACTIVE MATERIAL
IN PARTICULATE FORM LIMITING CONDITION OF OPERATION

(ODCM 9.8.1)

The dose to a MEMBER OF THE PUBLIC from Iodine-131 and 133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents released, from each unit, to areas at and beyond the SITE BOUNDARY (see Figure 16.11-2) shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 7.5 mrems to any organ, and
- b. During any calendar year: Less than or equal to 15 mrems to any organ.

APPLICABILITY: At all times.

ACTION:

- a. With the calculated dose from the release of Iodine-131 and 133, tritium, and radionuclides in particulate form with half-lives greater than 8 days, in gaseous effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days a Special Report that identifies the cause(s) for exceeding the limits and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits.
- b. The provisions of Sections 16.0.1.3 and 16.0.1.4 are not applicable.

16.11.2.3.1 SURVEILLANCE REQUIREMENTS

(ODCM 9.8.2)

Cumulative dose contributions for the current calendar quarter and current calendar year for Iodine-131 and 133, tritium, and radionuclides in particulate form with half-lives greater than 8 days shall be determined in accordance with the methodology and parameters in the ODCM at least once per 31 days.

16.11.2.3.2 BASES

This section is provided to implement the requirements of Sections II.C, III.A, and IV.A of Appendix I, 10 CFR Part 50. The Limiting Conditions for Operation are the guides set forth in Section II.C of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the release of radioactive material in gaseous effluents to UNRESTRICTED AREAS will be kept "as low as reasonably achievable". The ODCM calculational methods specified in the Surveillance Requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix

CALLAWAY - SP

It be shown by calculational procedures based on models and data such that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The ODCM calculational methodology and parameters for calculating the doses due to the actual release rates of the subject materials are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I", Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water Cooled Reactors", Revision 1, July 1977. These equations also provide for determining the actual doses based upon the historical average atmospheric conditions. The release rate controls for Iodine-131, and 133, tritium, and radionuclides in particulate form with half-lives greater than 8 days are dependent upon the existing radionuclide pathways to man, in the areas at and beyond the SITE BOUNDARY. The pathways that were examined in the development of these calculations were: (1) individual inhalation of airborne radionuclides, (2) deposition of radionuclides onto green leafy vegetation with subsequent consumption by man, (3) deposition of radionuclides onto grassy areas where milk animals and meat-producing animals graze with consumption of the milk and meat by man, and (4) deposition on the ground with subsequent exposure of man.

The reporting requirements of Action(a) implement the requirements of 10CFR20.2203.

16.11.2.4 RADIOACTIVE GASEOUS EFFLUENT MONITORING
(3/4.3.3.10) INSTRUMENTATION LIMITING CONDITION FOR OPERATION

(ODCM 9.2.1)

The radioactive gaseous effluent monitoring instrumentation channels shown in Table 16.11-5 shall be OPERABLE with their Alarm/Trip Setpoints set to ensure that the limits of Section 16.11.2.1 are not exceeded. The Alarm/Trip Setpoints of these channels meeting Section 16.11.2.1 shall be determined and adjusted in accordance with the methodology and parameters in the ODCM.

APPLICABILITY: As shown in Table 16.11-5.

ACTION:

- a. With a radioactive gaseous effluent monitoring instrumentation channel Alarm/Trip Setpoint less conservative than required by the above, immediately declare the channel inoperable.
- b. With less than the minimum number of radioactive gaseous effluent monitoring instrumentation channels OPERABLE, take the ACTION shown in Table 16.11-5. Restore the inoperable instrumentation to OPERABLE status within the time specified in the ACTION, or explain in the next Radioactive Effluent Release Report, pursuant to Technical Specification 5.6.3, why this inoperability was not corrected within the time specified.
- c. The provisions of Sections 16.0.1.3 and 16.0.1.4 are not applicable.

16.11.2.4.1 SURVEILLANCE REQUIREMENTS

(ODCM 9.2.2)

Each radioactive gaseous effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION and CHANNEL OPERATIONAL TEST at the frequencies shown in Table 16.11-6.

16.11.2.4.2 BASES

The radioactive gaseous effluent monitoring instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in gaseous effluents during actual or potential releases of gaseous effluents. The Alarm/Trip Setpoints for these instruments shall be calculated and adjusted in accordance with the methodology and parameters in the ODCM to ensure that the alarm/trip will occur prior to exceeding the limits of 10 CFR Part 20. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63, and 64 of Appendix A to 10 CFR Part 50. The sensitivity of any noble gas activity monitor used to show

CALLAWAY - SP

compliance with the gaseous effluent release requirements of Section 16.11.2.1 shall be such that concentrations as low as $1 \times 10^{-6} \mu\text{Ci/cc}$ are measurable.

The monitors GT-RE-22 and GT-RE-33 are only required for automatic containment purge isolation in MODES 1 through 4. For plant conditions during CORE ALTERATIONS and during movement of irradiated fuel within containment, the function of the monitors is to alarm only and the trip signals for automatic actuation of CPIS may be bypassed. Based on the guidance provided in Regulatory Guide 1.97 concerning monitoring requirements for containment or purge effluent, the monitors GT-RE-22 and GT-RE-33 do not need to meet the single failure criterion for an Alarm function only during CORE ALTERATIONS or during movement of irradiated fuel in containment. One instrumentation channel at a minimum is required for the alarm only function during refueling activities.

16.11.2.5 GASEOUS RADWASTE TREATMENT SYSTEM LIMITING CONDITION
OF OPERATION

(ODCM 9.9.1)

The VENTILATION EXHAUST TREATMENT SYSTEM and the WASTE GAS HOLDUP SYSTEM shall be OPERABLE and appropriate portions of these systems shall be used to reduce releases of radioactivity when the projected doses in 31 days due to gaseous effluent releases, from each unit, to areas at and beyond the SITE BOUNDARY (see Figure 16.11-2) would exceed:

- a. 0.2 mrad to air from gamma radiation, or
- b. 0.4 mrad to air from beta radiation, or
- c. 0.3 mrem to any organ of a MEMBER OF THE PUBLIC.

APPLICABILITY: At all times

ACTION:

- I. With radioactive gaseous waste being discharged without treatment and in excess of the above limits, prepare and submit to the Commission within 30 days a Special Report that includes the following information:
 - 1) Identification of any inoperable equipment or subsystems, and the reason for the inoperability,
 - 2) Action(s) taken to restore the inoperable equipment to OPERABLE status, and
 - 3) Summary description of action(s) taken to prevent a recurrence.
- II. The provision of Sections 16.0.1.3 and 16.0.1.4 are not applicable.

16.11.2.5.1 SURVEILLANCE REQUIREMENTS

(ODCM 9.9.2)

16.11.2.5.1.a

Doses due to gaseous releases from each unit to areas at and beyond the SITE BOUNDARY shall be projected at least once per 31 days in accordance with the methodology and parameters in the ODCM.

16.11.2.5.1.b

The installed VENTILATION EXHAUST TREATMENT SYSTEM and the WASTE GAS HOLDUP SYSTEMS shall be considered OPERABLE by meeting Sections 16.11.2.1 and 16.11.2.2 or 16.11.2.3.

16.11.2.5.2 BASES

The OPERABILITY of the WASTE GAS HOLDUP SYSTEM and the VENTILATION EXHAUST TREATMENT SYSTEM ensures that the system will be available for use whenever gaseous effluents require treatment prior to release to the environment. The requirement that the appropriate portions of these systems be used, when specified, provides reasonable assurance that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable". This control implements the requirements of 10 CFR Part 50.36a, General Design Criterion 60 of Appendix A to 10 CFR Part 50, and the design objectives given in Section II.D of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the systems were specified as a suitable fraction of the dose design objectives set forth in Sections II.B and II.C of Appendix I, 10 CFR Part 50, for gaseous effluents.

16.11.2.6 EXPLOSIVE GAS MIXTURE LIMITING CONDITION FOR OPERATION

The concentration of oxygen in the WASTE GAS HOLDUP SYSTEM shall be limited to less than or equal to 3% by volume whenever the hydrogen concentration exceeds 4% by volume.

APPLICABILITY: At all times.

ACTION:

- a. With the concentration of oxygen in the WASTE GAS HOLDUP SYSTEM greater than 3% by volume but less than or equal to 4% by volume, reduce the oxygen concentration to the above limit within 48 hours.
- b. With the concentration of oxygen in the WASTE GAS HOLDUP SYSTEM greater than 4% by volume and the hydrogen concentration greater than 4% by volume, immediately suspend all additions of waste gases to the system and reduce the concentration on oxygen to less than or equal to 4% by volume, then take ACTION a. above.
- c. The provisions of Sections 16.0.1.3 and 16.0.1.4 are not applicable.

16.11.2.6.1 SURVEILLANCE REQUIREMENTS

The concentrations of hydrogen and oxygen in the WASTE GAS HOLDUP SYSTEM shall be determined to be within the above limits by continuously monitoring the waste gases in the WASTE GAS HOLDUP SYSTEM with the hydrogen and oxygen monitors required OPERABLE by Section 16.11.2.7. The provisions of Sections 16.0.2.2 and 16.0.2.3 are applicable, however the allowed surveillance interval extension beyond 25% shall not be exceeded. This system is also covered by Administrative Controls Section 5.5.12.

16.11.2.6.2 BASES

This specification is provided to ensure that the concentration of potentially explosive gas mixtures contained in the WASTE GAS HOLDUP SYSTEM is maintained below the flammability limits of hydrogen and oxygen. Automatic control features are included in the system to prevent the hydrogen and oxygen concentrations from reaching these flammability limits. These automatic control features include isolation of the source of hydrogen and/or oxygen. Maintaining the concentration of hydrogen and oxygen below their flammability limits provides assurance that the releases of radioactive materials will be controlled in conformance with the requirements of General Design Criterion 60 of Appendix A to 10 CFR Part 50.

16.11.2.7 WASTE GAS HOLDUP SYSTEM RECOMBINER EXPLOSIVE
GAS MONITORING INSTRUMENTATION LIMITING CONDITION FOR
OPERATION

At least one hydrogen and both the inlet and outlet oxygen explosive gas monitoring instrument channels for each WASTE GAS HOLDUP SYSTEM recombiner shall be OPERABLE with their Alarm/Trip Setpoints (with the exception of the "FEED H2 4%/ FEED O2 3%" and "FEED H2 4%/FEED O2 4%" alarms) set to ensure that the limits of Section 16.11.2.6 are not exceeded.

APPLICABILITY: During WASTE GAS HOLDUP SYSTEM operation.

ACTION:

- a. With an outlet oxygen monitor channel inoperable, operation of the system may continue provided grab samples are taken and analyzed at least once per 24 hours.
- b. With both oxygen or both hydrogen channels or both the inlet oxygen and inlet hydrogen monitor channels for one recombiner inoperable, suspend oxygen supply to the recombiner. Addition of waste gas to the system may continue provided grab samples are taken and analyzed at least; 1) once per 4 hours during mechanical or chemical degassing in preparation for plant shutdown and 2) once per 24 hours during other operations.
- c. With the inlet Oxygen analyzer inoperable, operation of the system may continue provided the inlet Hydrogen is maintained less than 4%. If inlet Hydrogen is greater than 4%, suspend oxygen to the recombiner. Addition of waste gas to the system may continue provided grab samples are taken and analyzed at least; 1) once per 4 hours during mechanical or chemical degassing operations in preparation for plant shutdown and 2) once per 24 hours during other operations.
- d. The provisions of Sections 16.0.1.3 and 16.0.1.4 are not applicable.

16.11.2.7.1 SURVEILLANCE REQUIREMENTS

The provisions of Sections 16.0.2.2 and 16.0.2.3 are applicable, however the allowed surveillance interval extension beyond 25% shall not be exceeded. This system is also covered by Administrative Controls Section 5.5.12.

Each waste gas holdup system recombiner explosive gas monitoring instrumentation channel shall be demonstrated OPERABLE by performance of:

- a. A CHANNEL CHECK at least once per 24 hours,

- b. Not used
- c. A CHANNEL CALIBRATION at least once per 92 days with the use of standard gas samples containing a nominal:
 - 1) One volume percent hydrogen, balance nitrogen and four volume percent hydrogen, balance nitrogen for the hydrogen monitor, and
 - 2) One volume percent oxygen, balance nitrogen, and four volume percent oxygen, balance nitrogen for the inlet oxygen monitor, and
 - 3) 10 ppm by volume oxygen, balance nitrogen and 80 ppm by volume oxygen, balance nitrogen for the outlet oxygen monitor.

16.11.2.7.2 BASES

Mechanical 'degassing operation' is defined as the transfer of gas from the Volume Control Tank (VCT) to the Waste Gas Holdup System when establishing a nitrogen blanket on the VCT in preparation for a plant shutdown. Chemical 'degassing operation' is the process of adding hydrogen peroxide to the RCS after the VCT hydrogen blanket has been replaced with nitrogen per the Mechanical degassification process and the RCS has been reduced to less than 180°F. Both Mechanical and Chemical degassification may lead to an explosive gas mixture in the Waste Gas Holdup System, thus requiring the more restrictive 4 hour sampling. Other operations require 24 hour sampling.

The "FEED H₂ 4%/FEED O₂ 3%" AND "FEED H₂ 4%/FEED O₂ 4%" alarms are not required to be OPERABLE. These alarms result from the combination of inlet Hydrogen and inlet Oxygen analyzer outputs while the FSAR only addresses OPERABILITY of each separate analyzer. Only the individual alarms and control functions associated with each analyzer are to be used to determine its operability. These alarms and control functions are sufficient to ensure that the requirements of Section 16.11.2.6 are not exceeded.

The CHANNEL CALIBRATION will include triggering the following alarms at the analyzer and verifying that the required control board annunciators and control functions actuate:

- 1) Feed Gas High H₂
- 2) HARC-1104 OAIC-1112 Hi Hi H₂/O₂ O₂ Shutdown
- 3) H₂ Reactor High Oxygen O₂ Limit
- 4) Product Gas High H₂

CALLAWAY - SP

- 5) Product Gas High Oxygen
- 6) Product Gas Hi Hi O₂ Shutdown

This will verify the OPERABILITY of the analyzers' output relays, all interposing relays, and the annunciators. Setpoint verification will consist of verifying that the correct setpoint values are entered in the analyzers' database.

16.11.2.8 GAS STORAGE TANKS LIMITING CONDITION FOR OPERATION

The quantity of radioactivity contained in each gas storage tank shall be limited to less than or equal to 2.5×10^5 Curies of noble gases (considered as Xe-133 equivalent).

APPLICABILITY: At all times.

ACTION:

- a. With the quantity of radioactive material in any gas storage tank exceeding the above limit, immediately suspend all additions of radioactive material to the tank and, within 48 hours, reduce the tank contents to within the limit, and describe the events leading to this condition in the next Radioactive Effluent Release Report, pursuant to Technical Specification 5.6.3.
- b. The provisions of Sections 16.0.1.3 and 16.0.1.4 are not applicable.

16.11.2.8.1 SURVEILLANCE REQUIREMENTS

The provisions of Sections 16.0.2.2 and 16.0.2.3 are applicable, however the allowed surveillance interval extension beyond 25% shall not be exceeded. This system is also covered by Administrative Controls Section 5.5.12.

The quantity of radioactive material contained in each gas storage tank shall be determined to be within the above limit at least once per 18 months.

16.11.2.8.2 BASES

The tanks included in this specification are those tanks for which the quantity of radioactivity contained is not limited directly or indirectly by another Technical Specification. Restricting the quantity of radioactivity contained in each gas storage tank provides assurance that in the event of an uncontrolled release of the tank's contents, the resulting whole body exposure to a MEMBER OF THE PUBLIC at the nearest SITE BOUNDARY will not exceed 0.5 rem. This is consistent with Standard Review Plan 11.3, Branch Technical Position ETSB 11-5, "Postulated Radioactive Releases Due to a Waste Gas System Leak or Failure," in NUREG-0800, July 1981. The determination of Xe-133 equivalent uses the effective dose conversion factors for air submersion listed in Table III.1 of EPA Federal Guidance Report No. 12, EPA-402-R-93-081, "External Exposure to Radionuclides in Air, Water, and Soil," 1993.

16.11.3 TOTAL DOSE

16.11.3.1 TOTAL DOSE LIMITING CONDITION FOR OPERATION

(ODCM 9.10.1)

The annual (calendar year) dose or dose commitment to any MEMBER OF THE PUBLIC due to releases of radioactivity and to radiation from uranium fuel cycle sources shall be limited to less than or equal to 25 mrem to the whole body or any organ, except the thyroid, which shall be limited to less than or equal to 75 mrem.

APPLICABILITY: At all times.

ACTION:

- a. With the calculated doses from the release of radioactive materials in gaseous effluents exceeding twice the limits of Section 16.11.2.2a, 16.11.2.2b, 16.11.2.3a, or 16.11.2.3b, calculations should be made including direct radiation contributions from the units and from outside storage tanks to determine whether the above limits of Section 16.11.3.1 have been exceeded. If such is the case, prepare and submit to the Commission within 30 days a Special Report that defines the corrective action to be taken to reduce subsequent release to prevent recurrence of exceeding the above limits and includes the schedule for achieving conformance with the above limits. This Special Report, as defined in 10 CFR 20.2203, shall include an analysis that estimates the radiation exposure (dose) to a MEMBER OF THE PUBLIC from uranium fuel cycle sources, including all effluent pathways and direct radiation, for the calendar year that includes the release(s) covered by this report. It shall also describe levels of radiation and concentrations of radioactive material involved, and the cause of the exposure levels or concentrations. If the estimated dose(s) exceeds the above limits, and if the release condition resulting in violation of 40 CFR Part 190 has not already been corrected, the Special Report shall include a request for a variance in accordance with the provisions of 40 CFR Part 190. Submittal of the report is considered a timely request, and a variance is granted until staff action on the request is complete.
- b. The provisions of Technical Specifications 16.0.1.3 and 16.0.1.4 are not applicable.

16.11.3.1.1 SURVEILLANCE REQUIREMENTS

(ODCM 9.10.2)

16.11.3.1.1.a

Cumulative dose contributions from gaseous effluents shall be determined in accordance with Sections 16.11.2.2.1, and 16.11.2.3.1, and in accordance with the methodology and parameters in the ODCM.

16.11.3.1.1.b

Cumulative dose contributions from direct radiation from the units and from radwaste storage tanks shall be determined in accordance with the methodology and parameters in the ODCM. This requirements is applicable only under conditions set forth in ACTION a. of Section 16.11.3.1.

16.11.3.1.2 BASES

This specification is provided to meet the dose limitations of 40 CFR Part 190 that have been incorporated into 10 CFR Part 20.1301. The control requires the preparation and submittal of a Special Report whenever the calculated doses due to releases of radioactivity and the radiation from uranium fuel cycle sources exceed 25 mrems to the whole body or any organ except the thyroid, which shall be limited to less than or equal to 75 mrems. For sites containing up to four reactors, it is highly unlikely that the resultant dose to a MEMBER OF THE PUBLIC will exceed the dose limits of 40 CFR Part 190 if the individual reactors remain within twice the dose design objectives of Appendix I, and if direct radiation doses from the reactor units and from outside storage tanks are kept small. The Special Report will describe a course of action that should result in the limitation of the annual dose to a MEMBER OF THE PUBLIC to within the 40 CFR Part 190 limits.

For the purposes of the Special Report, it may be assumed that the dose commitment to the MEMBER OF THE PUBLIC from other uranium fuel cycle sources is negligible, with the exception that dose contributions from other nuclear fuel cycle facilities at the same site or within a radius of 8 km must be considered. If the dose to any MEMBER OF THE PUBLIC is estimated to exceed the requirements of 40 CFR Part 190, the Special Report with a request for a variance (provided the release conditions resulting in violation of 40 CFR Part 190 have not already been corrected), in accordance with the provisions of 40 CFR Part 190.11 and 10 CFR 20.2203, is considered to be a timely request and fulfills the requirements of 40 CFR Part 190 until NRC staff action is completed. The variance only relates to 40 CFR Part 190, and does not apply in any way to the other requirements for dose limitation of 10 CFR Part 20, as addressed in Sections 16.11.1.1 and 16.11.2.1. An individual is not considered a MEMBER OF THE PUBLIC during any period in which he/she is engaged in carrying out any operation that is part of the nuclear fuel cycle.

There are three defined effluent release categories: 1.) Releases directly to the hydrosphere; 2.) noble gas releases to the atmosphere; 3.) radioiodine and particulate releases to the atmosphere. For each effluent release category, it is assumed in the dose calculations that an individual with the highest dose potential is the receptor. In general, the adult is considered to be the critical age group for liquid effluents, and the child age group is the most limiting for radioiodine and particulates in gaseous effluents.

CALLAWAY - SP

Thus, it is highly unlikely or impossible for the same individual to simultaneously receive the highest dose via all three effluent categories. For most reactor sites, it is also unlikely that all different potential dose pathways would contribute to the dose to a single real individual. Since it is difficult or impossible to continually determine actual food use patterns and critical age group, for calculational purposes, assumptions are made which tend to maximize doses. Any refinement in the assumptions would have the effect of reducing the estimated dose. For radionuclides released to the hydrosphere, the degree of overestimation in most situations is such that no individual will receive a significant dose. These conservative assumptions generally result in an overestimation of dose by one or two orders of magnitude. Since these assumptions are reflected in the Radiological Effluent Controls limiting radionuclide releases to design objective individual doses, no offsite individual is likely to actually receive a significant dose. Since the doses from liquid releases are very conservatively evaluated, there is reasonable assurance that no real individual will receive a significant dose from radioactive liquid release pathway. Therefore, only doses to individuals via airborne pathways and dose resulting from direct radiation need to be considered in determining potential compliance to 40 CFR 190*.

The reporting requirements of Action(a) implement the requirements of 10CFR20.2203.

* NUREG-0543, "Methods for Demonstrating LWR compliance with the EPA Uranium Fuel Cycle Standard (40 CFR 190)", Congel, F. J., Office of Nuclear Reactor Regulation, USNRC. January, 1980. pp. 5-8.

16.11.4 RADIOLOGICAL ENVIRONMENTAL MONITORING

16.11.4.1 MONITORING PROGRAM LIMITING CONDITION OF OPERATION

(ODCM 9.11.1)

The Radiological Environmental Monitoring Program shall be conducted as specified in Table 16.11-7.

APPLICABILITY: At all times.

ACTION:

- a. With the Radiological Environmental Monitoring Program not being conducted as specified in Table 16.11-7, prepare and submit to the Commission, in the Annual Radiological Environmental Operating Report required by Technical Specification 5.6.2, a description of the reasons for not conducting the program as required and the plans for preventing a recurrence.
- b. With the level of radioactivity as the result of plant effluents in an environmental sampling medium at a specified location exceeding the reporting levels of Table 16.11-8 when averaged over any calendar quarter, prepare and submit to the Commission within 30 days a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions to be taken to reduce radioactive effluents so that the potential annual dose* to a MEMBER OF THE PUBLIC is less than the calendar year limits of Sections 16.11.1.2, 16.11.2.2, or 16.11.2.3. When more than one of the radionuclides in Table 16.11-8 are detected in the sampling medium, this report shall be submitted if:

$$\frac{\text{concentration (1)}}{\text{reporting level (1)}} + \frac{\text{concentration (2)}}{\text{reporting (2)}} + \dots \geq 1.0$$

When radionuclides other than those in Table 16.11-8 are detected and are the result of plant effluents, this report shall be submitted if the potential annual dose* to A MEMBER OF THE PUBLIC from all radionuclides is equal to or greater than the calendar year limits of Sections 16.11.1.2, 16.11.2.2 or 16.11.2.3. This report is not required if the measured level of radioactivity was not the result of plant effluents; however, in such an event, the condition shall be reported and described in the Annual Radiological Environmental Operating Report, required by Technical Specification 5.6.2.

- c. With milk or fresh leafy vegetable samples unavailable from one or more of the sample locations required by Table 16.11-7, identify specific locations for

* The methodology and parameters used to estimate the potential annual dose to a MEMBER OF THE PUBLIC shall be indicated in this report.

obtaining replacement samples and add them within 30 days to the Radiological Environmental Monitoring Program*. The specific locations from which samples were unavailable may then be deleted from the monitoring program. In the next Annual Radiological Environmental Operating Report include the revised figure(s) and tables reflecting the new sample location(s) with supporting information identifying the cause of the unavailability of samples and justifying the selection of new location(s) for obtaining samples.

- d. When LLDs specified in Table 16.11-9 are unachievable due to uncontrollable circumstances, (such as background fluctuations, unavailable small sample sizes, the presence of interfering nuclides, etc.) the contributing factors shall be identified and described in the Annual Radiological Environmental Operating Report.
- e. The provisions of Sections 16.0.1.3 and 16.0.1.4 are not applicable.

16.11.4.1.1 SURVEILLANCE REQUIREMENTS

(ODCM 9.11.2)

The radiological environmental monitoring samples shall be collected pursuant to Table 16.11-7 and shall be analyzed pursuant to the requirements of Table 16.11-7 and the detection capabilities required by Table 16.11-9.

16.11.4.1.2 BASES

The Radiological Environmental Monitoring Program required by this REC provides representative measurements of radiation and of radioactive materials in those exposure pathways and for those radionuclides that lead to the highest potential radiation exposures of MEMBERS OF THE PUBLIC resulting from the station operation. This monitoring program implements Section IV.B.2 of Appendix I to 10 CFR Part 50 and thereby supplements the Radiological Effluent Monitoring Program by verifying that the measurable concentrations of radioactive materials and levels of radiation are not higher than expected on the basis of the effluent measurements and the modeling of the environmental exposure pathways. Guidance for this monitoring program is provided by the Radiological Assessment Branch Technical Position on Environmental Monitoring, Revision 1, November 1979. The initially specified monitoring program will be effective for at least the first 3 years of commercial operation. Following this period, program changes may be initiated based on operational experience.

The required detection capabilities for environmental sample analyses are tabulated in terms of the lower limits of detection (LLD's). The LLD's required by Table 16.11-9 are considered optimum for routine environmental measurements in industrial laboratories.

* Excluding short term or temporary unavailability.

16.11.4.2 LAND USE CENSUS LIMITING CONDITION OF OPERATION

(ODCM 9.12.1)

A Land Use Census shall be conducted and shall identify within a distance of 8 km (5 miles) the location in each of the 16 meteorological sectors of the nearest milk animal, the nearest residence and the nearest garden* of greater than 50m² (500 ft²) producing broad leaf vegetation. The Land Use Census shall identify water intakes constructed within 10 river miles downstream of the plant discharge point.

APPLICABILITY: At all times.

ACTION:

- a. With a Land Use Census identifying a location(s) that yields a calculated dose or dose commitment greater than the values currently being calculated by Section 16.11.2.3.1, identify the new location(s) in the next Radioactive Effluent Release Report, pursuant to Technical Specification 5.6.3.
- b. With a Land Use Census identifying a location(s) that yields a calculated dose or dose commitment (via the same exposure pathway) 20% greater than at a location from which samples are currently being obtained in accordance with Section 16.11.4.1, add the new location(s) within 30 days to the Radiological Environmental Monitoring Program except for vegetation samples which shall be added to the program before the next growing season. The sampling location(s), excluding the control station location, having the lowest calculated dose or dose commitment(s), via the same exposure pathway, may be deleted from this monitoring program after October 31 of the year in which this Land Use Census was conducted. In the next Annual Radiological Environmental Operating Report include the revised figure(s) and tables reflecting the new sample location(s) with information supporting the change in sample location.
- c. With a Land Use Census identifying a water intake within 10 river miles downstream of the plant discharge point, implement the appropriate waterborne or ingestion sampling required by Table 16.11-7.
- d. The provisions of Sections 16.0.1.3 and 16.0.1.4 are not applicable.

* Broad leaf vegetation sampling of at least three different kinds of vegetation may be performed at the SITE BOUNDARY in each to two different direction sectors with the highest predicted D/Q's in lieu of the garden census. Specifications for broad leaf vegetation sampling in Table 9.11-A, Part 4.c shall be followed, including analysis of control samples.

16.11.4.2.1 SURVEILLANCE REQUIREMENTS

(ODCM 9.12.2)

The Land Use Census shall be conducted during the growing season at least once per 12 months using that information which will provide the best results, such as, but not limited to, door-to-door survey, aerial survey, or by consulting local agriculture authorities and/or residents. The results of the Land Use Census shall be included in the Annual Radiological Environmental Operating Report pursuant to Technical Specification 5.6.2.

16.11.4.2.2 BASES

This specification is provided to ensure that changes in the use of areas at and beyond the SITE BOUNDARY are identified and that modifications to the Radiological Environmental Monitoring Program given in the ODCM are made if required by the results of this census. Information that will provide the best results, such as door-to-door survey, aerial survey, or consulting with local agricultural authorities, shall be used. This census satisfies the requirements of Section IV.B.3 of Appendix I to 10 CFR Part 50.

Restricting the census to gardens of greater than 50 m² provides assurance that significant exposure pathways via leafy vegetables will be identified and monitored since a garden of this size is the minimum required to produce the quantity (26 kg/year) of leafy vegetables assumed in Regulatory Guide 1.109 for consumption by a child. To determine this minimum garden size, the following assumptions were made: (1) 20% of the garden was used for growing broad leaf vegetation (i.e., similar to lettuce and cabbage), and (2) a vegetation yield of 2 kg/m².

16.11.4.3 INTERLABORATORY COMPARISON PROGRAM LIMITING CONDITION
OF OPERATION

(ODCM 9.13.1)

Analyses shall be performed on radioactive materials supplied as part of an Interlaboratory Comparison Program that has been approved by the USNRC.

APPLICABILITY: At all times.

ACTION:

- a. With analyses not being performed as required above, report the corrective actions taken to prevent a recurrence to the Commission in the Annual Radiological Environmental Operating Report pursuant to Technical Specification 5.6.2.
- b. The provisions of Sections 16.0.1.3 and 16.0.1.4 are not applicable.

16.11.4.3.1 SURVEILLANCE REQUIREMENTS

(ODCM 9.13.2)

The Interlaboratory Comparison Program shall be described in the plant procedures. A summary of the results obtained as part of the above required Interlaboratory Comparison Program shall be included in the Annual Radiological Environmental Operating Report pursuant to Technical Specification 5.6.2.

16.11.4.3.2 BASES

The requirement for participation in an approved Interlaboratory Comparison Program is provided to ensure that independent checks on the precision and accuracy of the measurements of radioactive material in environmental sample matrices are performed as part of the quality assurance program for environmental monitoring in order to demonstrate that the results are valid for the purpose of Section IV.B.2 of Appendix I to 10 CFR Part 50.

16.11.5 ADMINISTRATIVE CONTROLS

16.11.5.1 ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

(ODCM 7.1)

Routine Annual Radiological Environmental Operating Report covering the operation of the unit during the previous calendar year shall be submitted prior to May 1 of each year.

The Annual Radiological Environmental Operating Report shall include summaries, interpretations, and an analysis of trends of the results of the radiological environmental surveillance activities for the report period, including a comparison with preoperational studies, with operational controls and with previous environmental surveillance reports, and an assessment of the observed impacts of the plant operation on the environment. The reports shall include the results of Land Use Census required by Section 16.11.4.2. It shall also include a listing of new locations for environmental monitoring identified by the Land Use Census pursuant to Section 16.11.4.2.

The Annual Radiological Environmental Operating Report shall include the results of analysis of all radiological environmental samples and of all environmental radiation measurements taken during the period pursuant to Section 16.11.4.1, as well as summarized tabulated results of these analyses and measurements in the format of the table in the Radiological Assessment Branch Technical Position, Revision 1, November 1979. In the event that some individual results are not available for inclusion with the report, the report shall be submitted noting and explaining the reasons for the missing results. The missing data shall be submitted as soon as possible in a supplementary report. The reports shall also include the following: a summary description of the radiological environmental monitoring program; at least two legible maps* covering all sampling locations keyed to a table giving distances and directions from the midpoint between the two reactors; the results of licensee participation in the Interlaboratory Comparison Program and the corrective action being taken if the specified program is not being performed as required by Section 16.11.4.3; reasons for not conducting the Radiological Environmental Monitoring Program as required by Section 16.11.4.1 and discussion of all deviations from the sampling schedule of Table 16.11-7, discussion of environmental sample measurements that exceed the reporting levels of Table 16.11-8, but are not the result of the plant effluents, pursuant to Section 16.11.4.1; and discussion of all analyses in which the LLD required by Table 16.11-9 was not achievable.

16.11.5.1.1 BASES

The reporting requirement for the Annual Radiological Environmental Operating Report is provided to ensure compliance with Technical Specification 5.6.2. This requirement was relocated from the Offsite Dose Calculation Manual to FSAR Chapter 16.

* One map shall cover stations near the SITE BOUNDARY; a second shall include the more distant stations.

16.11.5.2 RADIOACTIVE EFFLUENT RELEASE REPORT

(ODCM 7.2)

Routine Radioactive Effluent Release Reports covering the operation of the unit during the previous calendar year shall be submitted prior to May 1 of each year.

The Radioactive Effluent Release Report shall include a summary of the quantities of radioactive liquid and gaseous effluents released from the unit as outlined in Regulatory Guide 1.21, "Measuring, Evaluating, and Reporting Radioactivity in Solid Wastes and Releases Gaseous Effluents from Light-Water-Cooled Nuclear Power Plants, "Revision 1, June 1974, with data summarized on a quarterly basis following the format of Appendix B thereof.

The Radioactive Effluent Release Report shall include an annual summary of hourly meteorological data collected over the previous calendar year. This annual summary may be either in the form of an hour-by-hour listing on magnetic tape of wind speed, wind direction, atmospheric stability, and precipitation (if measured), or in the form of joint frequency distribution of wind speed, wind direction, and atmospheric stability* .

This report shall also include an assessment of the radiation doses due to the radioactive liquid and gaseous effluents released from the unit during the previous calendar year. This report shall also include an assessment of the radiation doses from radioactive liquid and gaseous effluents to MEMBERS OF THE PUBLIC due to their activities inside the SITE BOUNDARY (Figures 16.11-1 and 16.11-2) during the report period using historical average atmospheric conditions. All assumptions used in making these assessments, i.e., specific activity, exposure time and location, shall be included in these reports. The meteorological conditions concurrent with the time of release of radioactive materials in gaseous effluents, as determined by sampling frequency and measurement, shall be used for determining the gaseous pathway doses. Assessment of radiation doses shall be performed in accordance with the methodology and parameters in the OFFSITE DOSE CALCULATION MANUAL (ODCM).

The Radioactive Effluent Release Report shall include an assessment of radiation doses to the most likely exposed MEMBER OF THE PUBLIC from reactor releases and other nearby uranium fuel cycle sources, including doses from primary effluent pathways and direct radiation, for the previous calendar year to show conformance with 40 CFR Part 190, "Environmental Radiation Protection Standards for Nuclear Power Operation." Doses to the MEMBER OF THE PUBLIC shall be calculated using the methodology and parameters of the ODCM.

* In lieu of submission with the Annual Radioactive Effluent Release Report, Union Electric has the option of retaining this summary of required meteorological data on site in a file that shall be provided to the NRC upon request.

The Radioactive Effluent Release Report shall include a list and description of unplanned releases from the site to UNRESTRICTED AREAS of radioactive materials in gaseous and liquid effluents made during the reporting period.

The Radioactive Effluent Release Report shall include a summary description of any major changes made during the year to any Liquid or Gaseous Treatment Systems, pursuant to Offsite Dose Calculation Manual. It shall also include a listing of new locations for dose calculations identified by the Land Use Census pursuant to Section 16.11.4.2.

Reporting requirements for changes to Solid Waste Treatment Systems are addressed in APA-ZZ-01011, PROCESS CONTROL PROGRAM (PCP).

The Radioactive Effluent Release Report shall also include the following information: An explanation as to why the inoperability of liquid or gaseous effluent monitoring instrumentation was not corrected within the time specified, and a description of the events leading the liquid holdup tanks or gas storage tanks exceeding the limits of Section 16.11.1.5 or 16.11.2.8.

The Radioactive Effluent Release Report shall include as part of or submitted concurrent with, a complete and legible copy of all revisions of the ODCM that occurred during the year pursuant of Technical Specification 5.5.1.

Solid Waste reporting is addressed in APA-ZZ-01011, PROCESS CONTROL PROGRAM (PCP).

16.11.5.2.1 BASES

The reporting requirement for the Radioactive Effluent Release Report is provided to ensure compliance with Technical Specification 5.6.3. This requirement was relocated from the Offsite Dose Calculation Manual to FSAR Chapter 16.

CALLAWAY - SP

TABLE 16.11-1 RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM

1. Discharge Monitor Tanks (Batch Release) (2)			
SAMPLING FREQUENCY(7)	MINIMUM ANALYSIS FREQUENCY	TYPE OF ACTIVITY ANALYSIS	LLD (1) ($\mu\text{Ci/ml}$)
Prior to Each Batch	Prior to Each Batch	Principal Gamma Emitters (3)	5E-7
		I-131	1E-6
		Dissolved and Entrained Gases (Gamma Emitters)	1E-5
	Monthly Composite (4)	Gross Alpha	1E-7
	Quarterly Composite (4)	Sr-89, Sr-90	5E-8
		Fe-55	1E-6
		Ni-63	5E-8
		Np-237	5E-9
		Pu-238	5E-9
		Pu-239/240	5E-9
		Pu-241	5E-7
		Am-241	5E-9
		Cm-242	5E-9
		Cm-243/244	5E-9

2. Steam Generator Blowdown (Continuous Release) (5)			
SAMPLING FREQUENCY(7)	MINIMUM ANALYSIS FREQUENCY	TYPE OF ACTIVITY ANALYSIS	LLD (1) ($\mu\text{Ci/ml}$)
Daily Grab Sample (6)	Daily	Principal Gamma Emitters (3)	5E-7
		I-131	1E-6
		Dissolved and Entrained Gases (Gamma Emitters)	1E-5
	Monthly Composite (4)	Gross Alpha	1E-7
	Quarterly Composite (4)	Sr-89, Sr-90	5E-8
		Fe-55	1E-6

TABLE NOTATIONS

- (1) The LLD is defined, for purposes of these specifications, as the smallest concentration of radioactive material in a sample that will yield a net count, above system background, that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system, which may include radiochemical separation:

$$\text{LLD} = \frac{4.66 S_b}{E \times V \times 2.22E6 \times Y \times \exp(-\lambda \Delta t)}$$

Where:

- LLD = the "a priori" lower limit of detection (microCuries per unit mass or volume),
- S_b = the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (counts per minute),
- E = the counting efficiency (counts per disintegration),
- V = the sample size (units of mass or volume),
- 2.22E6 = the number of disintegrations per minute per microCurie,
- Y = the fractional radiochemical yield, when applicable,
- λ = the radioactive decay constant for the particular radionuclide (sec⁻¹), and

CALLAWAY - SP

TABLE 16.11-1 (Sheet 2)

Δt = the elapsed time between the midpoint of the sample collection period, and the time of counting (sec). For batch releases, $\Delta t=0$.

Typical values of E, V, Y, and Δt should be used in the calculation.

It should be recognized that the LLD is defined as a "a priori" (before the fact) limit representing the capability of a measurement system and not as an "a posteriori" (after the fact) limit for a particular measurement. Analyses shall be performed in such a manner that the stated LLD's will be achieved under routine conditions.

- (2) A batch release is the discharge of liquid wastes of a discrete volume. Prior to sampling for analyses, each batch shall be isolated, and then thoroughly mixed by a method described in the ODCM to assure representative sampling.
- (3) The principal gamma emitters for which the LLD control applies include the following radionuclides: Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, Ce-141, and Ce-144. This list does not mean that only these nuclides are to be considered. Other gamma peaks that are identifiable, together with those of the above nuclides, shall also be analyzed and reported in the Radioactive Effluent Release Report pursuant to Technical Specification 5.6.3, in the format outlined in Regulatory Guide 1.21, Appendix B, Revision 1, June 1974.
- (4) A composite sample is one in which the quantity of liquid sampled is proportional to the quantity of liquid waste discharged and in which the method of sampling employed results in a specimen that is representative of the liquids released. Prior to analysis, all samples taken for the composite shall be thoroughly mixed in order for the composite samples to be representative of the effluent release.
- (5) A continuous release is the discharge of liquid wastes of a nondiscrete volume, e.g., from a volume of a system that has an input flow during the continuous release.
- (6) Samples shall be taken at the initiation of effluent flow and at least once per 24 hours thereafter while the release is occurring. To be representative of the liquid effluent, the sample volume shall be proportioned to the effluent stream discharge volume. The ratio of sample volume to effluent discharge volume shall be maintained constant for all samples taken for the composite sample.
- (7) Samples shall be representative of the effluent release.

CALLAWAY - SP

TABLE 16.11-2 RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION

	<u>INSTRUMENT</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>ACTION</u>
1.	Radioactivity Monitors Providing Alarm and Automatic Termination of Release		
a.	Liquid Radwaste Discharge Monitor (HB-RE-18)	1	31
b.	Steam Generator Blowdown Discharge Monitor (BM-RE-52)	1	32
2.	Flow Rate Measurement Devices		
a.	Liquid Radwaste Blowdown Discharge Line (HB-FE-2017)	1	34
b.	Steam Generator Blowdown Discharge Line (BM-FE-0054)	1	34
c.	Cooling Tower Blowdown and Bypass Flow Totalizer (FYDB1017A)	1	34
3.	Discharge Monitoring Tanks (DMT's) Level		
a.	DMT A(HB-LI-2004)	1	33
b.	DMT B(HB-LI-2005)	1	33

ACTION STATEMENTS

ACTION 31 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that prior to initiating a release:

- a. At least two independent samples are analyzed in accordance with Section 16.11.1.1.1, and
- b. At least two technically qualified members of the facility staff independently verify the release rate calculations and discharge line valving.

Otherwise, suspend release of radioactive effluents via this pathway.

TABLE 16.11-2 (Sheet 2)
ACTION STATEMENTS

ACTION 32 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided grab samples are analyzed for principal gamma emitters and I-131 at a lower limit of detection as specified in Table 16.11-1:

- a. At least once per 12 hours when the specific activity of the secondary coolant is greater than 0.01 micro-Curie/gram DOSE EQUIVALENT I-131, or
- b. At least once per 24 hours when the specific activity of the secondary coolant is less than or equal to 0.01 micro-Curie/gram DOSE EQUIVALENT I-131.

ACTION 33 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided the volume discharged is determined by alternate means.

ACTION 34 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided the flow rate is estimated at least once per 4 hours during actual releases. Pump performance curves generated in place may be used to estimate flow.

CALLAWAY - SP

TABLE 16.11-3 RADIOACTIVE LIQUID EFFLUENT MONITORING
INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL OPERATIONAL TEST</u>
1. Radioactivity Monitors Providing Alarm and Automatic Termination of Release				
a. Liquid Radwaste Discharge Monitor (HB-RE-18)	D	P	R(2)	Q(1)
b. Steam Generator Blowdown Discharge Monitor (BM-RE-52)	D	M	R(2)	Q(1)
2. Flow Rate Measurement Devices				
a. Liquid Radwaste Blowdown Discharge Line (HB-FE-2017)	D(3)	N.A.	R	N.A.
b. Steam Generator Blowdown Discharge Line (BM-FE-0054)	D(3)	N.A.	R	N.A.
c. Cooling Tower Blowdown and Bypass Flow Totalizer (FYDB1017A)	D(3)	N.A.	R	N.A.
3. Discharge Monitoring Tanks (DMT's) Level				
a. DMT A(HB-LI-2004)	Prior to release (4)	N.A.	R	N.A.
b. DMT B(HB-LI-2005)	Prior to release (4)	N.A.	R	N.A.

TABLE 16.11-3 (Sheet 2)

TABLE NOTATIONS

1. The CHANNEL OPERATIONAL TEST shall also demonstrate that automatic isolation of this pathway and control room alarm annunciation occur as appropriate if any of the following conditions exists:
 - a. Instrument indicates measured levels above the Alarm/Trip Setpoint (isolation and alarm), or
 - b. Circuit failure (alarm only), or
 - c. Instrument indicates a downscale failure (alarm only), or
 - d. Instrument controls not set in operate mode (alarm only).
2. The initial CHANNEL CALIBRATION shall be performed using one or more of the reference (gas or liquid and solid) standards obtained from the National Institute of Standards and Technology (NIST) or using standards that have been obtained from suppliers that participate in measurement assurance activities with NIST. These standards shall permit calibrating the system over its intended range of energy, measurement range, and establish monitor response to a solid calibration source. For subsequent CHANNEL CALIBRATION, NIST traceable standard (gas, liquid, or solid) may be used; or a gas, liquid, or solid source that has been calibrated by relating it to equipment that was previously (within 30 days) calibrated by the same geometry and type of source standard traceable to NIST.
3. CHANNEL CHECK shall consist of verifying indication of flow during periods of release. CHANNEL CHECK shall be made at least once per 24 hours on days on which continuous, periodic, or batch releases are made.
4. CHANNEL CHECK shall consist of verifying indication of tank level during periods of release. CHANNEL CHECK shall be made at least once per 24 hours on days on which continuous, periodic, or batch releases are made from the DMT.

CALLAWAY - SP

TABLE 16.11-4 RADIOACTIVE GASEOUS EFFLUENTS SAMPLING AND ANALYSIS PROGRAM

1. Waste Gas Decay Tank			
SAMPLING FREQUENCY (9)	MINIMUM ANALYSIS FREQUENCY	TYPE OF ACTIVITY ANALYSIS	LLD (1) ($\mu\text{Ci/ml}$)
Prior to each release- grab sample	Prior to each tank	Principal Gamma Emitters- particulate, iodine, noble gas (2)	1E-4
Continuous	See footnote 8		

2. Containment Purge or Vent			
SAMPLING FREQUENCY (9)	MINIMUM ANALYSIS FREQUENCY	TYPE OF ACTIVITY ANALYSIS	LLD (1) ($\mu\text{Ci/ml}$)
Prior to each release- grab sample	Prior to each release	Principal Gamma Emitters- particulate, iodine, noble gas (2) H-3(oxide)	1E-4 1E-6
Continuous	See footnote 8		

3. Unit Vent (3)			
SAMPLING FREQUENCY (9)	MINIMUM ANALYSIS FREQUENCY	TYPE OF ACTIVITY ANALYSIS	LLD (1) ($\mu\text{Ci/ml}$)
Monthly- grab sample (3)(4)	Monthly (3)(4)	Principal Gamma Emitters- noble gas (2) H-3(oxide)	1E-4 1E-6
Continuous (6)	Weekly (7)	I-131	1E-12
		I-133	1E-10
	Principal Gamma Emitters- particulate nuclides only (2)	1E-11	
	Monthly Composite	Gross Alpha	1E-11
	Quarterly Composite	Sr-89, Sr-90	1E-11

4. Radwaste Building Vent			
SAMPLING FREQUENCY (9)	MINIMUM ANALYSIS FREQUENCY	TYPE OF ACTIVITY ANALYSIS	LLD (1) ($\mu\text{Ci/ml}$)
Monthly- grab sample	Monthly	Principal Gamma Emitters- noble gas (2)	1E-4
Continuous (6)	Weekly (7)	I-131	1E-12
		I-133	1E-10
	Principal Gamma Emitters- particulate nuclides only (2)	1E-11	
	Monthly Composite	Gross Alpha	1E-11
	Quarterly Composite	Sr-89, Sr-90	1E-11

5. Laundry Decontamination Facility Dryer Exhaust			
SAMPLING FREQUENCY (9)	MINIMUM ANALYSIS FREQUENCY	TYPE OF ACTIVITY ANALYSIS	LLD (1) ($\mu\text{Ci/ml}$)
Continuous (6)	Weekly (7)	Principal Gamma Emitters- particulate nuclides only (2)	1E-11
	Monthly (10) Composite	Gross Alpha	1E-11
	Quarterly (10) Composite	Sr-89, Sr-90	1E-11

CALLAWAY - SP

TABLE 16.11-4 (Sheet 2)

6. Containment ILRT Depressurization (Post-test Vent)			
SAMPLING FREQUENCY (9)	MINIMUM ANALYSIS FREQUENCY	TYPE OF ACTIVITY ANALYSIS	LLD (1) ($\mu\text{Ci/ml}$)
Prior to each release- grab sample	Prior to each release	Principal Gamma Emitters- particulate, iodine, noble gas (2) H-3(oxide)	1E-4 1E-6

TABLE NOTATIONS

- (1) The LLD is defined, for purposes of these specifications, as the smallest concentration of radioactive material in a sample that will yield a net count, above system background, that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system, which may include radiochemical separation:

$$\text{LLD} = \frac{4.66 S_b}{E \times V \times 2.22E6 \times Y \times \exp(-\lambda\Delta t)}$$

Where:

- LLD = the "a priori" lower limit of detection (microCuries per unit mass or volume),
- S_b = the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (counts per minute),
- E = the counting efficiency (counts per disintegration),
- V = the sample size (units of mass or volume),
- 2.22E6 = the number of disintegrations per minute per microCurie,
- Y = the fractional radiochemical yield, when applicable,
- λ = the radioactive decay constant for the particular radionuclide (sec^{-1}), and
- Δt = the elapsed time between the midpoint of the sample collection period, and the time of counting (sec).

Typical values of E, V, Y, and Δt should be used in the calculation.

It should be recognized that the LLD is defined as a "a priori" (before the fact) limit representing the capability of a measurement system and not as an "a posteriori" (after the fact) limit for a particular measurement. Analyses shall be performed in such a manner that the stated LLD's will be achieved under routine conditions.

- (2) The principal gamma emitters for which the LLD specification applies include the following radionuclides: Kr-87, Kr-88, Xe-133, Xe-133m, Xe-135, and Xe-138 in noble gas releases and Mn-54, Fe-59, Co-58, Co-60, Zn-65, I-131, Cs-134, Cs-137, Ce-141, and Ce-144 in iodine and particulate releases. This list does not mean that only these nuclides are to be considered. Any nuclide which is identified in the sample and which is also listed in the ODCM gaseous effluents dose factor tables, shall be analyzed and reported in the Radioactive Effluent Release Report.
- (3) If the Unit Vent noble gas monitor (GT-RE-21B) shows that the effluent activity has increased (relative to the pre-transient activity) by more than a factor of 3 following a reactor shutdown, startup, or a thermal power change which exceeds 15% of the rated thermal power within a 1 hour period, samples shall be obtained and analyzed for noble gas, particulates and iodines. This sampling shall continue to be performed at least once per 24 hours for a period of 7 days or until the Unit Vent noble gas monitor no longer indicates a factor of 3 increase in Unit Vent noble gas activity, whichever comes first.
- (4) Tritium grab samples shall be taken and analyzed at least once per 24 hours when the refueling canal is flooded.
- (5) Deleted.
- (6) The ratio of the sample flow rate to the sampled stream flow rate shall be known for the time period covered by each dose or dose rate calculation made in accordance with Sections 16.11.2.1, 16.11.2.2, and 16.11.2.3.
- (7) Samples shall be changed at least once per 7 days and analyses shall be completed within 48 hours after changing, or removal from the sampler. When sampling is performed in accordance with footnote 3 (above), then the LLD may be increased by a factor of 10.
- (8) Continuous sampling of this batch release pathway is included in the continuous sampling performed for the corresponding continuous release pathway.
- (9) Samples shall be representative of the effluent release.
- (10) Required only if Mn-54, Fe-59, Co-58, Co-60, Zn-65, Cs-134, Cs-137, Ce-141, or Ce-144 are detected in principle gamma emitter analyses.

CALLAWAY - SP

TABLE 16.11-5 RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

<u>INSTRUMENT</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABILITY</u>	<u>ACTION</u>
1. Unit Vent System			
a. Noble Gas Activity Monitor - Providing Alarm (GT-RE-21)	1	At all times	40,46
b. Iodine Sampler	1	At all times	43
c. Particulate Sampler	1	At all times	43
d. Unit Vent Flow Rate	1	At all times	45
e. Particulate and Radioiodine Sampler Flow Rate Monitor	1	At all times	43
2. Containment Purge System			
a. Noble Gas Activity Monitor			
- Providing Alarm and Automatic Termination of Release (GT-RE-22, GT-RE-33)	2	MODES 1,2,3, and 4.	41
- Providing Alarm function only	1	During CORE ALTERATIONS or movement of irradiated fuel within the containment	42
b. Iodine Sampler	1	MODES 1,2,3,4 and during CORE ALTERATIONS or movement of irradiated fuel within the containment	43
c. Particulate Sampler	1	MODES 1,2,3,4 and during CORE ALTERATIONS or movement of irradiated fuel within the containment	43
d. Containment Purge Ventilation Flow Rate	N/A	N/A	N/A

CALLAWAY - SP

TABLE 16.11-5 (Sheet 2)

e. Particulate and Radioiodine Sampler Flow Rate Monitor	1	MODES 1,2,3,4 and during CORE ALTERATIONS or movement of irradiated fuel within the containment	43
3. Radwaste Building Vent System			
a. Noble Gas Activity Monitor-Providing Alarm and Automatic Termination of Release (GH-RE-10)	1	At all times	38,40
b. Iodine Sampler	1	At all times	43
c. Particulate Sampler	1	At all times	43
d. Radwaste Building Vent Flow Rate	N/A	N/A	N/A
e. Particulate and Radioiodine Sampler Flow Rate Monitor	1	At all times	43
4. Laundry Decontamination Facility Dryer Exhaust			
a. Particulate Monitor	1	When the dryers are operating	47
b. Particulate Monitor Flow Rate Meter	1	When the dryers are operating	47
c. Dryer Exhaust Ventilation Flow Rate	NA	NA	NA

ACTION STATEMENTS

ACTION 38 - With the number of low range channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, the contents of the tank(s) may be released to the environment for up to 14 days provided that prior to initiating the release:

- a. At least two independent samples of the tank's contents are analyzed, and
- b. At least two technically qualified members of the facility staff independently verify the release rate calculations and discharge valve lineup.

CALLAWAY - SP

TABLE 16.11-5 (Sheet 3)

Otherwise, suspend release of radioactive effluents via this pathway.

- ACTION 39 - Deleted.
- ACTION 40 - With the number of low range channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided grab samples are taken at least once per 12 hours and these samples are analyzed for radioactivity within 24 hours.
- ACTION 41 - With the number of channels OPERABLE one less than required by the Minimum Channels OPERABLE requirement, restore the affected channel to OPERABLE status within 4 hours. If the inoperable channel is not restored within 4 hours or with no channels OPERABLE, immediately suspend the release of radioactive effluents via this pathway (this Action must be completed whenever this default condition is entered).
- ACTION 42 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, and if the containment equipment hatch is open, then immediately suspend CORE ALTERATIONS and movement of irradiated fuel assemblies within containment. If the containment equipment hatch is not open, then suspend the release of radioactive effluents via this pathway or immediately suspend CORE ALTERATIONS and movement of irradiated fuel assemblies within containment.
- ACTION 43 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via the affected pathway may continue for up to 30 days provided samples are continuously collected with auxiliary sampling equipment as required in Table 16.11-4.
- ACTION 44 - Deleted.
- ACTION 45 - Flow rate for this system shall be based on fan status and operating curves or actual measurements.
- ACTION 46 - For midrange and high range channels only - with the number of OPERABLE channels less than required by the Minimum Channels OPERABLE requirement, take the action specified in Section 16.3.3.4, ACTION C.
- ACTION 47 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, immediately suspend the release of radioactive effluents via this pathway.

CALLAWAY - SP

TABLE 16.11-6 RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL OPERATIONAL TEST</u>	<u>MODES FOR WHICH SURVEILLANCE IS REQUIRED</u>
1. Unit Vent System					
a. Noble Gas Activity Monitor - Providing Alarm (GT-RE-21)	D	M	R(3)	Q(2)	At all times
b. Iodine Sampler	W	N.A.	N.A.	N.A.	At all times
c. Particulate Sampler	W	N.A.	N.A.	N.A.	At all times
d. Unit Vent Flow Rate	N.A.	N.A.	R(4)	Q	At all times
e. Particulate and Radioiodine Sampler Flow Rate Monitor	D	N.A.	R	Q	At all times
2. Containment Purge System					
a. Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release (GT-RE-22, GT-RE-33)	N.A.	P	N.A.	N.A.	MODES 1,2,3,4 and during CORE ALTERATIONS or movement of irradiated fuel within the containment
b. Iodine Sampler	W	N.A.	N.A.	N.A.	MODES 1,2,3,4 and during CORE ALTERATIONS or movement of irradiated fuel within the containment
c. Particulate Sampler	W	N.A.	N.A.	N.A.	MODES 1,2,3,4 and during CORE ALTERATIONS or movement of irradiated fuel within the containment
d. Containment Purge Ventilation Flow Rate	N.A.	N.A.	R(4)	N.A.	MODES 1,2,3,4 and during CORE ALTERATIONS or movement of irradiated fuel within the containment

CALLAWAY - SP

TABLE 16.11-6 (Sheet 2)

<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL OPERATIONAL TEST</u>	<u>MODES FOR WHICH SURVEILLANCE IS REQUIRED</u>
e. Particulate and Radioiodine Sampler Flow Rate Monitor	D	N.A.	R	N.A.	MODES 1,2,3,4 and during CORE ALTERATIONS or movement of irradiated fuel within the containment
3. Radwaste Building Vent System					
a. Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release (GH-RE-10)	D,P	M,P	R(3)	Q(1)	At all times
b. Iodine Sampler	W	N.A.	N.A.	N.A.	At all times
c. Particulate Sampler	W	N.A.	N.A.	N.A.	At all times
d. Radwaste Building Vent Flow Rate	N.A.	N.A.	R(4)	N.A.	At all times
e. Particulate and Radioiodine Sampler Flow Rate Monitor	D	N.A.	R	N.A.	At all times
4. Laundry Decontamination Facility Dryer Exhaust					
a. Particulate Monitor	NA	D	A	Q(5)	When the dryers are operating
b. Particulate Monitor Flow Rate Meter	D	NA	A	NA	When the dryers are operating
c. Dryer Exhaust Ventilation Flow Rate	NA	NA	R(4)	NA	When the dryers are operating

CALLAWAY - SP

TABLE 16.11-6 (Sheet 3)

1. The CHANNEL OPERATIONAL TEST shall also demonstrate that automatic isolation of this pathway and control room alarm annunciation occur as appropriate if any of the following conditions exists:
 - a. Instrument indicates measured levels above the Alarm/Trip Setpoint (isolation and alarm), or
 - b. Circuit failure (alarm only), or
 - c. Instrument indicates a downscale failure (alarm only), or
 - d. Instrument controls not set in operate mode (alarm only).
2. The CHANNEL OPERATIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exists:
 - a. Instrument indicates measured levels above the Alarm Setpoint, or
 - b. Circuit failure, or
 - c. Instrument indicates a downscale failure, or
 - d. Instrument controls not set in operate mode.
3. The initial CHANNEL CALIBRATION shall be performed using one or more of the reference (gas or liquid and solid) standards certified by the National Institute of Standards & Technology (NIST) or using standards that have been obtained from suppliers that participate in measurement assurance activities with NIST. These standards shall permit calibrating the system over its intended range of energy, measurement range, and establish monitor response to a solid calibration source. For subsequent CHANNEL CALIBRATION, NIST traceable standard (gas, liquid, or solid) may be used; or a gas, liquid, or solid source that has been calibrated by relating it to equipment that was previously (within 30 days) calibrated by the same geometry and type of source standard traceable to NIST.
4. If flow rate is determined by exhaust fan status and fan performance curves, the following surveillance operations shall be performed at least once per 18 months:
 - a. The specific vent flows by direct measurement, or
 - b. The differential pressure across the exhaust fan and vent flow established by the fan's "flow- ΔP " curve, or
 - c. The fan motor horsepower measured and vent flow established by the fan's "flow-horsepower" curve.
5. The CHANNEL OPERATIONAL TEST shall also demonstrate that automatic isolation of this pathway and the shutdown of the dryers occur as appropriate if any of the following conditions exists:
 - a. Instrument indicates measured levels above the Alarm/Trip Setpoint, or
 - b. Monitor failure.

CALLAWAY - SP

TABLE 16.11-7 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM'

EXPOSURE PATHWAY AND/OR SAMPLE	NUMBER OF REPRESENTATIVE SAMPLES AND SAMPLE LOCATIONS ⁽¹⁾	SAMPLING AND COLLECTION FREQUENCY	TYPE AND FREQUENCY OF ANALYSIS
1. Direct Radiation ⁽²⁾	<p>Forty routine monitoring stations either with two or more dosimeters or with one instrument for measuring and recording dose rate continuously, placed as follows:</p> <p>An inner ring of sixteen stations, one in each meteorological sector in the general area of the SITE BOUNDARY;</p> <p>An outer ring of stations, one in each meteorological sector in the 6- to 8-km (3 to 5 mile) range from the site; and</p> <p>Eight stations to be placed in special interest areas such as population centers, nearby residences, schools, and in one or two areas to serve as control stations.</p>	Quarterly	Gamma dose quarterly
2. Airborne Radioiodine and Particulates	<p>Samples from five locations;</p> <p>Three samples from close to the SITE BOUNDARY locations, in different sectors, with high calculated annual average ground level D/Qs.</p> <p>One sample from the vicinity of a community located near the plant with a high calculated annual average ground level D/Q.</p> <p>One sample from a location in the vicinity of Fulton, MO.</p>	Continuous sampler operation with sample collection weekly, or more frequently if required by dust loading.	<p><u>Radioiodine Canister:</u> I-131 analysis weekly.</p> <p><u>Particulate Sampler:</u> Gross beta radioactivity analysis following filter change⁽⁴⁾ and gamma isotopic analysis⁽⁵⁾ of composite (by location) quarterly.</p>
3. Waterborne			
a. Surface ⁽⁶⁾	<p>One sample upstream One sample downstream</p>	Composite sample over 1-month period ⁽⁷⁾ .	Gamma Isotopic ⁽⁵⁾ and tritium analysis monthly

CALLAWAY - SP

TABLE 16.11-7 (Sheet 2)

EXPOSURE PATHWAY AND/OR SAMPLE	NUMBER OF REPRESENTATIVE SAMPLES AND SAMPLE LOCATIONS ⁽¹⁾	SAMPLING AND COLLECTION FREQUENCY	TYPE AND FREQUENCY OF ANALYSIS
b. Ground	Samples from one or two sources, only if likely to be affected ⁽⁸⁾	Quarterly	Gamma Isotopic ⁽⁵⁾ and tritium analysis quarterly
As there are no ground water sources used for drinking or irrigation purposes in areas where the hydraulic gradient or recharge properties are suitable for contamination, the ground waterborne pathway is currently not included as part of the Callaway Plant Radiological Environmental Monitoring Program.			
c. Drinking	One sample of each of one to three of the nearest water supplies within 10 miles downstream that could be affected by its discharge.	Composite sample over 2-week period ⁽⁷⁾ when I-131 analysis is performed, monthly composite otherwise.	I-131 analysis on each composite when the dose calculated for the consumption of the water is greater than 1 mrem per year ⁽⁹⁾ . Composite for gross beta and gamma isotopic analyses ⁽⁵⁾ monthly. Composite for tritium analysis quarterly.
One sample from a control location.			
As there are no drinking water intakes within 10 miles downstream of the discharge point, the drinking water pathway is currently not included as part of the Callaway Plant Radiological Environmental Monitoring Program. Should the annual Land Use Census identify water intakes within 10 river miles downstream of the discharge point, the program will be revised to include this pathway.			
d. Sediment from shoreline	One sample from downstream area with existing or potential recreational value	Semiannually	Gamma isotopic analysis ⁽⁵⁾ semiannually

CALLAWAY - SP

TABLE 16.11-7 (Sheet 3)

EXPOSURE PATHWAY AND/OR SAMPLE	NUMBER OF REPRESENTATIVE SAMPLES AND SAMPLE LOCATIONS ⁽¹⁾	SAMPLING AND COLLECTION FREQUENCY	TYPE AND FREQUENCY OF ANALYSIS
4. Ingestion			
a. Milk	<p>Samples from milking animals in three different meteorological sectors within 5 km (3 mile) distance having the highest dose potential. If there are none, then one sample from milking animals in each of three different meteorological sectors between 5 to 8 km (3 to 5 mile) distance where doses are calculated to be greater than 1 mrem per yr.⁽⁹⁾</p> <p>One sample from milking animals at a control location, 15 to 30 km (10 to 20 mile) distance and in the least prevalent wind direction.</p>	Semimonthly when animals are on pasture, monthly at other times	Gamma isotopic ⁽⁵⁾ and I-131 analysis semimonthly when animals are on pasture; monthly at other times
<p>Due to the lack of milking animals which satisfy these requirements, the milk pathway is currently not included as part of the Callaway Plant Radiological Environmental Monitoring Program. Should the Annual Land Use Census identify the existence of milking animals in locations which satisfy these requirements, then the program will be revised to include this pathway.</p>			
b. Fish	<p>One sample of each commercially and recreationally important species in vicinity of plant discharge area.</p> <p>One sample of same species in areas not influenced by plant discharge.</p>	Sample in season, or semiannually if they are not seasonal	Gamma isotopic analysis ⁽⁵⁾ on edible portions
c. Food Products	One sample of each principal class of food products from any area that is irrigated by water in which liquid plant wastes have been discharged.	At time of harvest ⁽¹⁰⁾	Gamma isotopic analysis ⁽⁵⁾ on edible portion

As there are no areas irrigated by water in which liquid plant wastes have been discharged within 50 miles downstream of the discharge point, this sample type is not currently included as part of the Callaway Plant Radiological Environmental Monitoring Program. Should the annual Land Use Census identify irrigation water intakes within 10 river miles downstream of the discharge point, the program will be revised to include this sample type.

CALLAWAY - SP

TABLE 16.11-7 (Sheet 4)

EXPOSURE PATHWAY AND/OR SAMPLE	NUMBER OF REPRESENTATIVE SAMPLES AND SAMPLE LOCATIONS ⁽¹⁾	SAMPLING AND COLLECTION FREQUENCY	TYPE AND FREQUENCY OF ANALYSIS
c. Food Products	Samples of three different kinds of broad leaf vegetation if available grown nearest each of two different offsite locations of highest predicted annual average ground level D/Q if milk sampling is not performed	Monthly when available	Gamma isotopic ⁽⁵⁾ and I-131 analysis
	One sample of each of the similar broad leaf vegetation grown 15 to 30 km (10 to 20 mile) distant in the least prevalent wind direction if milk sampling is not performed	Monthly when available	Gamma isotopic ⁽⁵⁾ and I-131 analysis

TABLE NOTATIONS

- Specific parameters of distance and direction sector from the centerline of one unit, and additional description where pertinent, shall be provided for each and every sample location in Table 16.11-7 in a table and figure(s) in the appropriate plant procedures. Deviations are permitted from the required sampling schedule if specimens are unobtainable due to hazardous conditions, seasonal unavailability, malfunction of automatic sampling equipment, and other legitimate reasons. If specimens are unobtainable due to sampling equipment malfunction, every effort shall be made to complete corrective action prior to the end of the next sampling period. All deviations from the sampling schedule shall be documented in the Annual Radiological Environmental Operating Report pursuant to Technical Specification 5.6.2.

It is recognized that, at times, it may not be possible or practicable to continue to obtain samples of the media of choice at the most desired location or time. In these instances suitable specific alternative media and locations may be chosen for the particular pathway in question and appropriate substitutions made within 30 days in the Radiological Environmental Monitoring Program. Submit in the next Annual Radiological Environmental Operating Report documentation for a change including the revised figure(s) and table reflecting the new location(s) with supporting information identifying the cause of the unavailability of samples for that pathway and justifying the selection of the new location(s) for obtaining samples.

The selection of sample locations should consider accessibility of sample site, availability of power, wind direction frequency, sector population, equipment security, and the presence of potentially adverse environmental conditions (such as unusually dusty conditions, etc.).

- One or more instruments, such as a pressurized ion chamber, for measuring and recording dose rate continuously may be used in place of, or in addition to, integrating dosimeters. For the purposes of this table, a thermoluminescent dosimeter (TLD) is considered to be one phosphor; two or more phosphors in a packet are considered as two or more dosimeters. Film badges shall not be used as dosimeters for measuring direct radiation. The number of direct radiation monitoring stations may be reduced according to geographical limitations; e.g., at an ocean site, some sectors will be over water so that the number of dosimeters may be reduced accordingly. The frequency of analysis or readout for TLD systems will depend upon the characteristics of the specific system used and should be selected to obtain optimum dose information with minimal fading.
- Deleted.

CALLAWAY - SP

TABLE 16.11-7 (Sheet 5)

4. Airborne particulate sample filters shall be analyzed for gross beta radioactivity 24 hours or more after sampling to allow for radon and thoron daughter decay. If gross beta activity in air particulate samples is greater than an established baseline activity level, gamma isotopic analysis shall be performed on the individual samples.
5. Gamma isotopic analysis means the identification and quantification of gamma-emitting radionuclides that may be attributable to the effluents from the facility.
6. The "upstream sample" shall be taken at a distance beyond significant influence of the discharge. The "downstream" sample shall be taken in an area near the downstream edge of the mixing zone.
7. In this program, composite sample aliquots shall be collected at time intervals that are very short (e.g., hourly) relative to the compositing period (e.g., monthly) in order to assure obtaining a representative sample.
8. Groundwater samples shall be taken when this source is tapped for drinking or irrigation purposes in areas where the hydraulic gradient or recharge properties are suitable for contamination.
9. The dose shall be calculated for the maximum organ and age group, using the methodology and parameters in the ODCM.
10. If harvest occurs more than once a year, sampling shall be performed during each discrete harvest. If harvest occurs continuously, sampling shall be monthly. Attention shall be paid to including samples of tuberous and root food products.

CALLAWAY - SP

TABLE 16.11-8 REPORTING LEVELS FOR RADIOACTIVITY CONCENTRATIONS IN ENVIRONMENTAL SAMPLES

REPORTING LEVELS

ANALYSIS	WATER (pCi/ℓ) ^a	AIRBORNE PARTICULATE OR GASES (pCi/m ³)	FISH (pCi/kg, wet) ^b	MILK (pCi/ℓ) ^a	FOOD PRODUCTS pCi/kg, wet) ^b
H-3	20,000*				
Mn-54	1,000		30,000		
Fe-59	400		10,000		
Co-58	1,000		30,000		
Co-60	300		10,000		
Zn-65	300		20,000		
Zr-Nb-95**	400				
I-131	2	0.9		3	100
Cs-134	30	10	1,000	60	1,000
Cs-137	50	20	2,000	70	2,000
Ba-La-140**	200			300	

(a) Multiply the values in this table by 1E-9 to convert to units of μCi/ml.

(b) Multiply the values in this table by 1E-9 to convert to units of μCi/g.

* For drinking water samples. This is 40 CFR Part 141 value. For surface water samples, a value of 30,000 pCi/ℓ may be used.

** Total activity, parent plus daughter activity.

CALLAWAY - SP

TABLE 16.11-9 DETECTION CAPABILITIES FOR ENVIRONMENTAL SAMPLE ANALYSIS

LOWER LIMIT OF DETECTION (LLD) ⁽¹⁾, ⁽²⁾, ⁽³⁾

ANALYSIS	SURFACE WATER (pCi/l) ^a	DRINKING WATER (pCi/l) ^a	AIRBORNE PARTICULATE OR GASES (pCi/m ³)	FISH (pCi/kg, wet) ^b	MILK (pCi/l) ^a	FOOD PRODUCTS (pCi/kg, wet) ^b	SEDIMENT (pCi/kg, dry) ^b
Gross Beta	4	4	0.01				
H-3	3000	2000					
Mn-54	15	15		130			
Fe-59	30	30		260			
Co-58,60	15	15		130			
Zn-65	30	30		260			
Zr-Nb-95*	15	15					
I-131	1000	1	0.07		1	60	
Cs-134	15	15	0.05	130	15	60	150
Cs-137	18	18	0.06	150	18	80	180
Ba-La-140*	15	15			15		

(a) Multiply the values in this table by 1E-9 to convert to units of $\mu\text{Ci/ml}$.

(b) Multiply the values in this table by 1E-9 to convert to units of $\mu\text{Ci/g}$.

* Total activity, parent plus daughter activity.

CALLAWAY - SP

TABLE 16.11-9 (Sheet 2)

TABLE NOTATIONS

1. This list does not mean that only these nuclides are to be considered. Other peaks that are identifiable, together with those of the listed nuclides, shall also be analyzed and reported in the Annual Radiological Environmental Operating Report.
2. Required detection capabilities for thermoluminescent dosimeters used for environmental measurements shall be in accordance with the recommendations of Regulatory Guide 4.13, Revision 1, July 1977.
3. The LLD is defined, for purposes of these specifications, as the smallest concentration of radioactive material in a sample that will yield a net count, above system background, that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system, which may include radiochemical separation:

$$LLD = \frac{4.66S_b}{E \times V \times 2.22E6 \times Y \times \exp(-\lambda\Delta t)}$$

Where:

- LLD = the "a priori" lower limit of detection (microCuries per unit mass or volume),
- S_b = the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (counts per minute),
- E = the counting efficiency (counts per disintegration),
- V = the sample size (units of mass or volume),
- 2.22E6 = the number of disintegrations per minute per microCurie,
- Y = the fractional radiochemical yield, when applicable,
- λ = the radioactive decay constant for the particular radionuclide (sec^{-1}), and
- Δt = the elapsed time between the end of the sample collection period, and the time of counting (sec).

Typical values of E, V, Y, and Δt should be used in the calculation.

It should be recognized that the LLD is defined as a "a priori" (before the fact) limit representing the capability of a measurement system and not as an "a posteriori" (after the fact) limit for a particular measurement. Analyses shall be performed in such a manner that the stated LLD's will be achieved under routine conditions.