


FIRSTENERGY NUCLEAR OPERATING COMPANY

BEAVER VALLEY POWER STATION

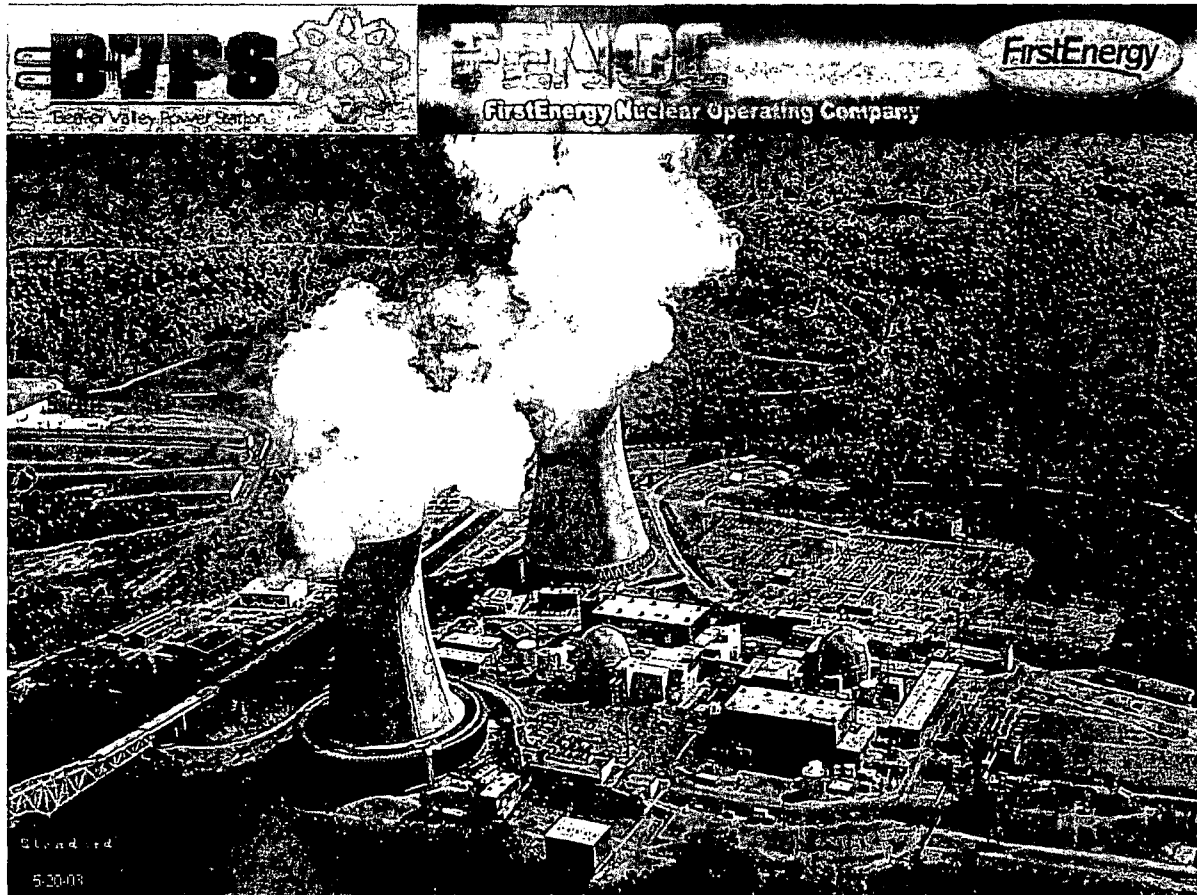

2008 RADIOACTIVE EFFLUENT RELEASE REPORT

AND

2008 ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

UNITS NO. 1 AND 2

LICENSES DPR-66 AND NPF-73

BEAVER VALLEY POWER STATION ENVIRONMENTAL & CHEMISTRY SECTION

Technical Report Approval:

2008 RADIOACTIVE EFFLUENT RELEASE REPORT

AND

2008 ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

UNITS NO. 1 AND 2

LICENSES DPR-66 AND NPF-73

Prepared by: Jennifer L. Powell-Campbell *J Powell-Campbell* Date: 04-03-09

Prepared by: Anthony T. Lonnett *A Lonnett* Date: 04-02-09

Reviewed by: Michael D. Banko III *[Signature]* Date: 4/07/09

Approved by: Donald J. Salera *Donald J Salera* Date: 4-9-09

Subject: **Beaver Valley Power Station, Unit Nos. 1 and 2**
BV-1 Docket No. 50-334, License No. DPR-66
BV-2 Docket No. 50-412, License No. NPF-73
Radioactive Effluent Release Report for 2008, and
Annual Radiological Environmental Operating Report for 2008

Distribution for Enclosures 1 - 3:

Original Report to:

U. S. Nuclear Regulatory Commission
Attention: Document Control Desk
Washington, DC 20555-0001

Copies of Report to Other USNRC:

U. S. Nuclear Regulatory Commission
Ms. N. S. Morgan, NRR Project Manager

U. S. Nuclear Regulatory Commission
Mr. D. L. Werkheiser, NRC Senior Resident Inspector

U. S. Nuclear Regulatory Commission
Mr. S. J. Collins, NRC Region I Administrator

Copies of Report to Other Agencies:

American Nuclear Insurers
95 Glastonbury Boulevard
Glastonbury, CT 06033

Department of Environmental Protection (5 copies)
Bureau of Radiation Protection & Toxicology
P.O. Box 2063
Harrisburg, PA 17120

Department of Environmental Protection (2 copies)
Southwest Regional Office
400 Waterfront Drive
Pittsburgh, PA 15222

INPO (Attn: Bill Nestel)
700 Galleria Parkway SE
Suite 100
Atlanta, GA 30339-5957

Distribution for Enclosures 1 - 3:

Page 2

Beaver County Cooperative Extension (Attn: JL Miller)
156 Cowpath Road
Aliquippa, PA 15001-5842

Hancock County Office of Emergency Services (Attn: JP Jones)
PO Box 884
New Cumberland, WV 20647

Ohio Department of Health (Attn: RL Suppes)
246 North High Street
Columbus, OH 43266-0288

Ohio Emergency Management Agency (Attn: Carol O'Claire)
2855 West Dublin Granville Road
Columbus, OH 43235

East Liverpool Water Authority (Attn: Keith Clark)
2220 Michigan Avenue
East Liverpool, OH 43920

ORSANCO (Attn: Jerry Schulte)
5735 Kellogg Avenue
Cincinnati, OH 45228

B. F. Jones Memorial Library
663 Franklin Avenue
Aliquippa, PA 15001

Mr. Robert Leidy, HP3
Bureau of Radiation Protection
Ohio Department of Health
Northeast District Office
161 South High Street, Suite 400
Akron, OH 44308-1612

Copies of Report for FENOC Addressees:

MD Banko, BVPS; Supervisor, Nuclear Chemistry Services (A-BV-A)
JL Powell-Campbell, BVPS; Chemistry RETS & REMP Administrator (A-BV-A) 15 copies
DJ Salera, BVPS; Manager, Site Chemistry (A-BV-A)
K Nevins, Akron; Sr. Nuclear Specialist, Fleet Licensing (A-GO-2) 2 copies
FA Cocivera, BVPS; Sr. Nuclear Specialist, Operations Oversight (A-BV-NCD3)
DV Steen, Akron; Vice President, Environmental (A-GO-13)
DW Jenkins, Akron; Sr. Attorney, Legal (A-GO-18)
M Hall, Akron; Vice President, Energy Policy (A-GO-18)
MJ Jirousek, Akron; Manager, Environmental Reporting & Performance (A-GO-13)
M Dues, Perry NPP RETS Administrator (A-PY-CCB125)
JP Balstad, Perry NPP REMP Administrator (A-PY-CCB125)
AM Percival, Davis-Besse RETS & REMP Administrator (A-DB-1041)
B Grob, Manager, Environmental, Inc.
RJ Dinello, Field Specialist, Environmental, Inc

BVPS Document Control, RTL A9.690E

BVRC - *Keywords: Radioactive Effluent Release Report,
Annual Radiological Environmental Operating Report*

Form 1/2-ENV-01.05.F01 (page 1 of 38), Rev 2

Beaver Valley Power Station - Units 1 & 2

2008 Radioactive Effluent Release Report

FirstEnergy Nuclear Operating Company
FENOC

Beaver Valley Power Station - Units 1 & 2
Unit 1 License No. DPR-66
Unit 2 License No. NPF-73

Radioactive Effluent Release Report
Calendar Year - 2008
Index

Title	Page	
Cover	i	
Index	ii	
Executive Summary - Report Submittal Requirements	iii	
Executive Summary - Liquid and Gaseous Effluent Control (Part 1 of 2)	iv	
Executive Summary - Liquid and Gaseous Effluent Control (Part 2 of 2)	v	
Executive Summary - Trends of Total Dose	vi	
Executive Summary - Trends of Liquid Release Activity (Fission and Activation Products)	vii	
Executive Summary - Trends of Liquid Release Activity (Tritium)	viii	
Executive Summary - Trends of Liquid Release Offsite Dose Projections	ix	
Executive Summary - Trends of Gaseous Release Activity (Fission and Activation Gas)	x	
Executive Summary - Trends of Gaseous Release Activity (Particulates and Radioiodines)	xi	
Executive Summary - Trends of Gaseous Release Activity (Tritium)	xii	
Executive Summary - Trends of Unit 1 Gaseous Release Offsite Dose Projections	xiii	
Executive Summary - Trends of Unit 2 Gaseous Release Offsite Dose Projections	xiv	
Results of Abnormal Releases	xv	
Results of Onsite Spills and Items Added to Decommissioning Files per 10CFR50.75(g)	xvi	
Results of Onsite Groundwater Monitoring Program	xvii	
Supplemental Information Page	1	
Table 1A	Gaseous Effluents - Summation Of All Releases	2
Table 1B-EB	Gaseous Effluents - Elevated Batch Releases	3
Table 1B-EC	Gaseous Effluents - Elevated Continuous Releases	4
Table 1C-GB1	Gaseous Effluents - Ground Level Batch Releases (Unit 1)	5
Table 1C-GC1	Gaseous Effluents - Ground Level Continuous Releases (Unit 1)	6
Table 1C-GB2	Gaseous Effluents - Ground Level Batch Releases (Unit 2)	7
Table 1C-GC2	Gaseous Effluents - Ground Level Continuous Releases (Unit 2)	8
Table 2A	Liquid Effluents - Summation Of All Releases	9
Table 2B-B	Liquid Effluents - Batch Releases	10
Table 2B-C	Liquid Effluents - Continuous Releases	11
Table 3A	Solid Waste And Irradiated Fuel Shipments (Part 1 of 3)	12
Table 3B	Solid Waste And Irradiated Fuel Shipments (Part 2 of 3)	13
Table 3C	Solid Waste And Irradiated Fuel Shipments (Part 3 of 3)	14
Table 4	Lower Limits Of Detectability	15
Table 5A	Assessment Of Radiation Doses (Unit 1)	16
Table 5B	Assessment Of Radiation Doses (Unit 2)	17
Table 6	Effluent Monitoring Instrumentation Channels Not Returned To Operable Status Within 30 Days	18
Table 7	Total Dose Commitments, Total Effective Dose Equivalents and Population Doses	19
Table 8	Offsite Dose Calculation Manual Surveillance Deficiencies	20
Table 9	Unit 1 and 2 Offsite Dose Calculation Manual Changes (Description)	21
Attachment 1	Part 1: Joint Frequency Distribution Tables (35 ft) Part 2: Joint Frequency Distribution Tables (150 ft) Part 3: Joint Frequency Distribution Tables (500 ft)	

Note: The Total Error values (%) listed in this report are documented in Calculation Package No. ERS-ATL-04-002

Radioactive Effluent Release Report

Calendar Year - 2008

Executive Summary - Report Submittal Requirements

Report Submittal and Requirements: The report was prepared and submitted in accordance with the requirements contained in the following documents:

BVPS Integrated Technical Specifications, Administrative Control 5.6.2

Offsite Dose Calculation Manual (ODCM) procedure 1/2-ODC-3.03, "*Controls for RETS and REMP Programs*", Attachment U, Control 6.9.3

BVPS procedure 1/2-ENV-01.05, "*Compliance with Regulatory Guide 1.21 and Technical Specifications*"

NUREG-1301, "*Offsite Dose Calculation Manual Guidance: Standard Radiological Effluent Controls for Pressurized Water Reactors, Generic Letter 89-01, Supplement No.1, April 1991*"

Regulatory Guide 1.21, "*Measuring Evaluating and Reporting Radioactivity in Solid Wastes and Releases of Radioactive Material in Liquid and Gaseous Effluents from Light-Water Cooled Nuclear Power Plants, Revision 1, June 1974*"

BVPS Condition Report No. CR08-38484, and BVPS-SAP Order Number 200197646-0500 are associated with reporting of the failure to change out weekly filter media on gaseous effluent pathway radiation monitors.

BVPS Condition Report No. CR08-49089, and BVPS-SAP Order Number 200197646-0680 are associated with reporting of the failure to obtain a grab sample when a gaseous effluent pathway radiation monitor was inoperable.

BVPS Condition Report No. CR08-50899, and BVPS-SAP Order Number 200197646-0700 are associated with reporting the failure to return a liquid effluent radiation monitor to service within 30 days.

BVPS Condition Report No. CR09-56073, and BVPS-SAP Order Number 200197646-0800 are associated with reporting the failure to return a gaseous effluent radiation monitor to service within 30 days.

Radioactive Effluent Release Report

Calendar Year - 2008

Executive Summary - Liquid and Gaseous Effluent Control (Part 1 of 2)

Onsite Groundwater Monitoring: Tritium results from two (2) of seventeen (17) wells were >2000 pCi/L, which are similar to results initially communicated in 2007. All gamma spectrometry analyses were <LLD. No adverse effect has been detected in offsite groundwater, drinking water and surface water.

Onsite Spills: There were no onsite spills >100 gallons.

Decommissioning File Update: There were no items added to the site decommissioning files in accordance with 10CFR50.75(g).

Abnormal Liquid Releases: There were no abnormal liquid releases.

Abnormal Gaseous Releases: There were no abnormal gaseous releases.

Liquid Radwaste Treatment System: The site operated via a shared Liquid Radwaste Treatment System, even though each Unit has its own ion-exchange vessels. Shared operation allowed either Unit to process liquid waste at the Unit of origin, or at the other Unit. Typically, when Unit 1 or 2 high level liquid waste was processed (e.g., coolant recovery waste) it was performed at Unit 1, because it has a carbon pre-conditioning filter.

Gaseous Radwaste Treatment System: The site operated via a shared Gaseous Radwaste Treatment System, even though each Unit has its own charcoal delay beds and storage/decay tanks. Shared operation allowed either Unit to process gaseous waste at the Unit of origin, or at the other Unit. Typically, when Unit 1 or 2 went to a shutdown condition, the gaseous waste was transferred for storage and decay at Unit 2, because Unit 2 has four (4) additional storage tanks.

Radioactive Effluent Release Report

Calendar Year - 2008

Executive Summary - Liquid and Gaseous Effluent Control (Part 2 of 2)

Lower Limits of Detectability (LLD): All a-priori calculated LLD met the minimum requirements specified in the ODCM.

Effluent Monitoring Channels Inoperable >30 Days: There were two (2) Effluent Monitoring Instrumentation Channels not returned to Operable status within 30 days. They are described in table 6

ODCM Surveillance Deficiencies: There were two ODCM Surveillance Deficiencies. They are described in table 8.

ODCM Changes: There were no changes made to the ODCM.

Meteorological Data Recovery: The Meteorological Data Recovery met the minimum requirement of at least 90%, as specified in Section 5 of Revision 1 to Regulatory Guide 1.23, Meteorological Monitoring Programs for Nuclear Power Plants.

Population Dose vs. Natural Background: The 0-50 mile total and average population doses were calculated using liquid and gaseous release quantities and real time meteorology. The average population dose is based on four (4) million people within 0-50 miles of the BVPS site. The following comparison to natural background radiation demonstrates that BVPS operations did not adversely affect the surrounding environment.


564 man-mrem = BVPS Total Population Dose for the year

0.0001365 mrem = BVPS Average Individual Dose for the year

296 mrem = Natural Background Individual Dose for the year. This dose value is documented as natural background radiation exposure for an individual in a year from the 1990 BEIR V Report.

Radioactive Effluent Release Report
Calendar Year - 2008
Executive Summary - Trends of Total Dose

Trends of Total Dose: The following graph provides a comparison of the ODCM dose projections from all facility releases and direct radiation exposures to show compliance with Member of the Public dose limits from 10 CFR 20.1301 and 40 CFR Part 190. *The graph reflects the results of the efforts to stabilize and reduce offsite dose.*

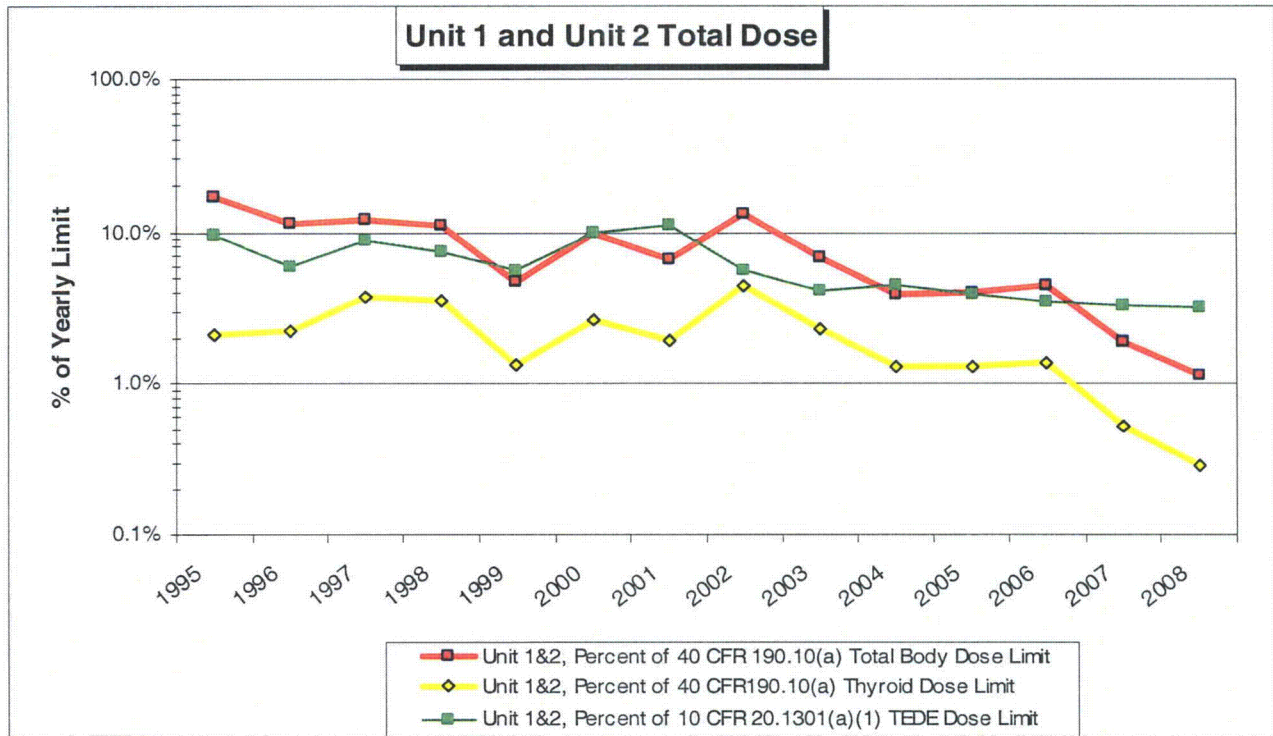


Radioactive Effluent Release Report

Calendar Year - 2008

Executive Summary - Trends of Liquid Release Activity (Fission and Activation Products)

Liquid Release Activity (Fission and Activation Products): The following graph provides a comparison of total liquid mixed fission and activation product (particulate) radioactivity discharged from the site from 1976 to present. The recent increases were due to efforts to reduce overall offsite dose. Specifically, discharging liquid radioactive inventory provided the benefit of reduced total offsite dose, due to reduction in evaporative losses from the fuel pools.

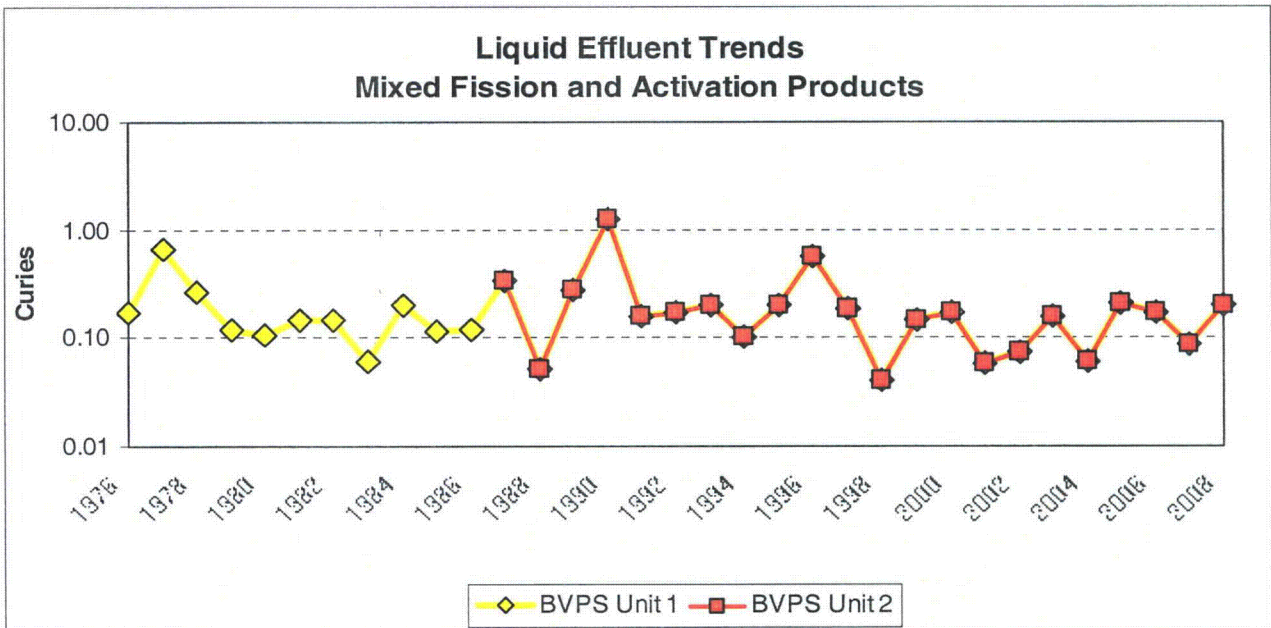


Radioactive Effluent Release Report

Calendar Year - 2008

Executive Summary - Trends of Liquid Release Activity (Tritium)

Liquid Release Activity (Tritium): The following graph provides a comparison of total liquid tritium radioactivity discharged from the site from 1976 to present. The recent increases were due to efforts to reduce overall offsite dose. Specifically, discharging liquid radioactive inventory provided the benefit of reduced total offsite dose, due to reduction in evaporative losses from the fuel pools.

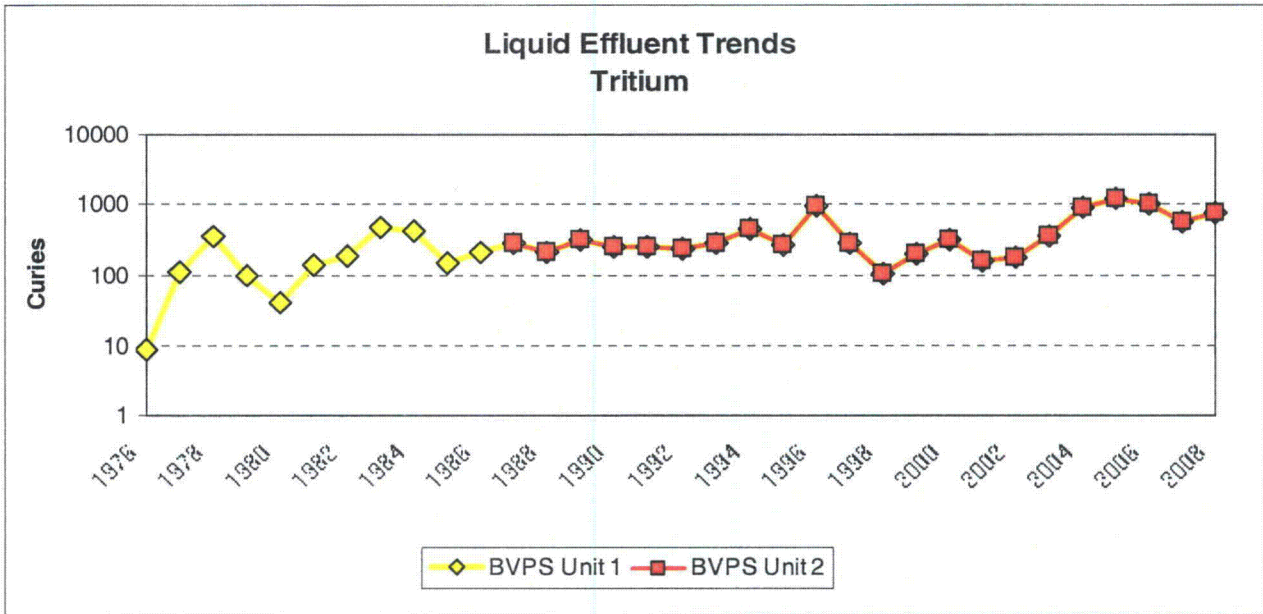


Radioactive Effluent Release Report

Calendar Year - 2008

Executive Summary - Trends of Liquid Release Offsite Dose Projections

Liquid Release Offsite Dose Projections: The following graph provides a comparison of liquid offsite dose projections that were calculated to the maximum individual per 10 CFR 50, Appendix I and the ODCM. The projections use ODCM default flow rates for the receiving water (Ohio River), and were performed prior to release authorization. *The recent increases were due to efforts to reduce overall offsite dose. Specifically, discharging liquid radioactive inventory provided the benefit of reduced total offsite dose, due to reduction in evaporative losses from the fuel pools.*

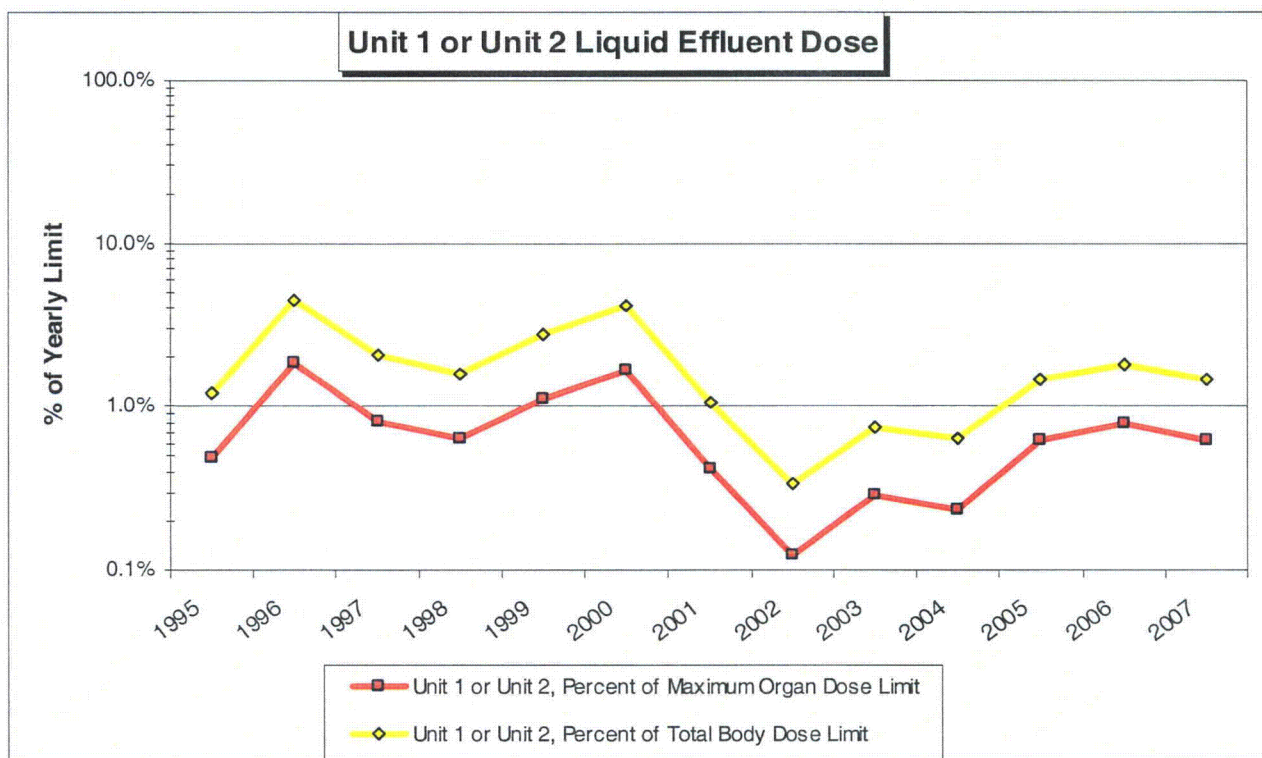


Radioactive Effluent Release Report

Calendar Year - 2008

Executive Summary - Trends of Gaseous Release Activity (Fission and Activation Gas)

Gaseous Release Activity (Fission and Activation Gas): The following graph provides a comparison of total gaseous fission and activation gas discharged from the site from 1976 to present. The steady decreases are due to extended hold-up periods of gas space prior to release.

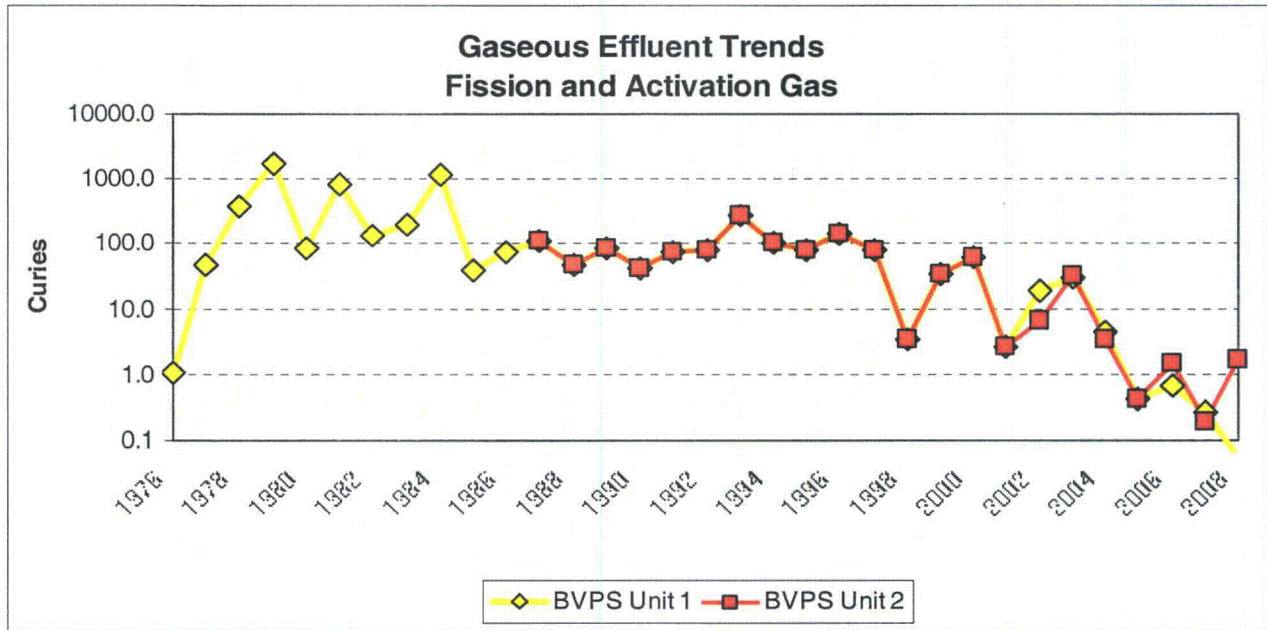


Radioactive Effluent Release Report

Calendar Year - 2008

Executive Summary - Trends of Gaseous Release Activity (Particulates and Radioiodines)

Gaseous Release Activity (Particulates and Radioiodines): The following graph provides a comparison of total gaseous particulates and radioiodines discharged from the site from 1976 to present. The recent increase at Unit 1 was due to identification of Co-58 in weekly effluent pathway samples during a refueling outage. The increase at Unit 2 was due to identification of Co-58 and Co-60 in weekly effluent pathway samples during a refueling outage and due to a planned release of the pressurizer gas space after the refueling outage.

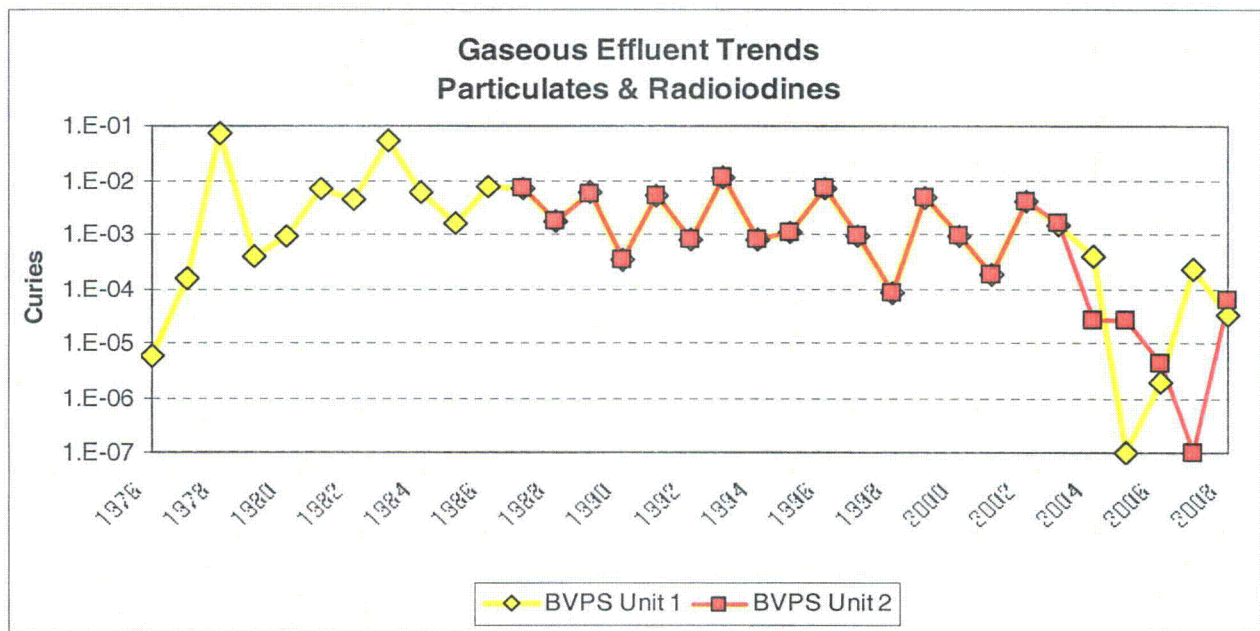


Radioactive Effluent Release Report

Calendar Year - 2008

Executive Summary - Trends of Gaseous Release Activity (Tritium)

Gaseous Release Activity (Tritium): The following graph provides a comparison of total gaseous tritium discharged from the site from 1976 to present. The recent decreases were due to efforts to reduce overall offsite dose. Specifically, discharging liquid radioactive inventory provided the benefit of reduced total offsite dose, due to reduction in evaporative losses from the fuel pools.

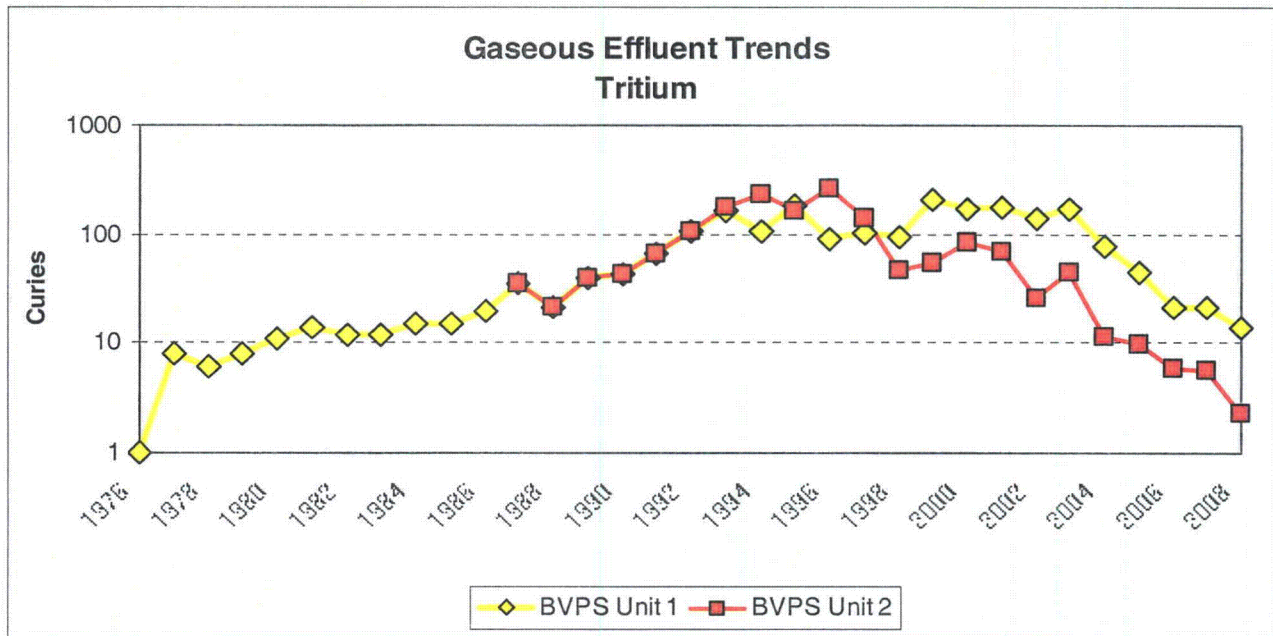


Radioactive Effluent Release Report

Calendar Year - 2008

Executive Summary - Trends of Unit 1 Gaseous Release Offsite Dose Projections

Unit 1 Gaseous Release Offsite Dose Projections: The following graph provides a comparison of Unit 1 gaseous offsite dose projections that were calculated to the maximum individual per 10 CFR 50, Appendix I and the ODCM. The projections use ODCM default meteorological parameters for the atmospheric conditions surrounding the plant site, and were performed prior to release authorization. **The steady decrease in highest organ dose was due to efforts to reduce overall offsite dose. Specifically, discharging liquid radioactive inventory provided the benefit of reduced total offsite dose, due to reduction in evaporative losses from the fuel pools.**

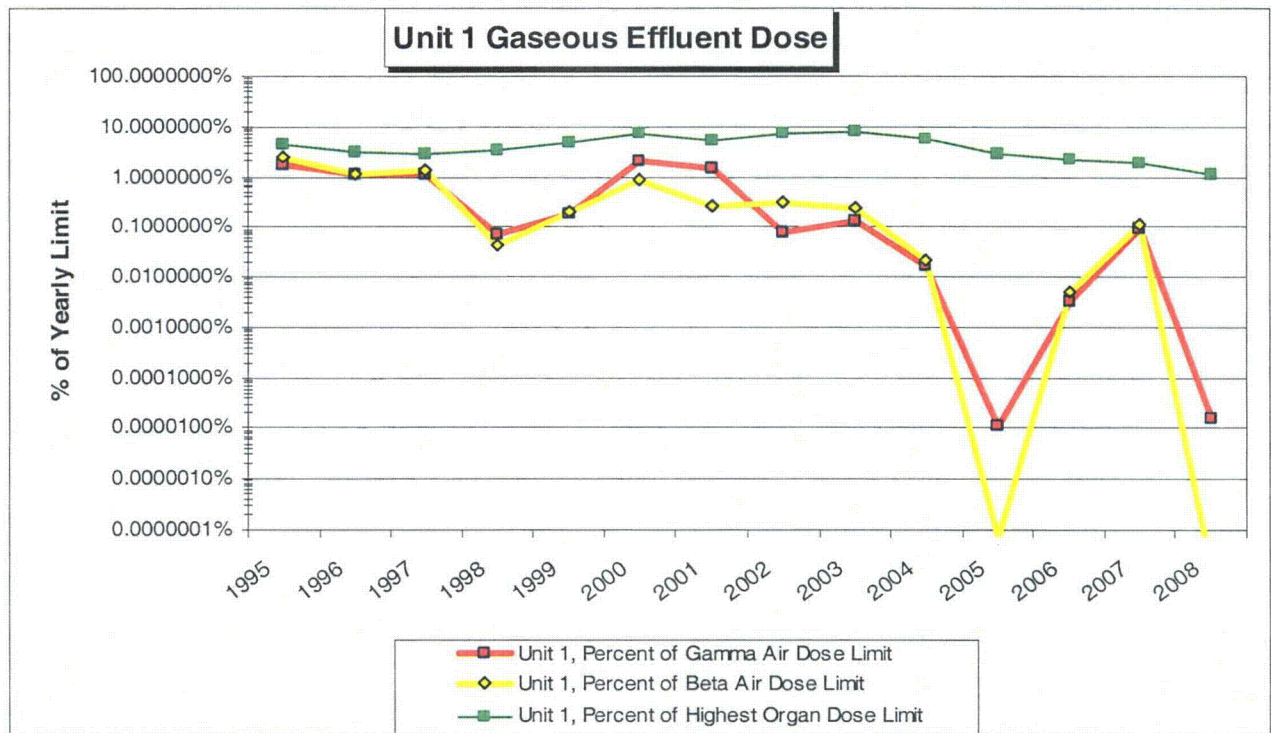


Radioactive Effluent Release Report

Calendar Year - 2008

Executive Summary - Trends of Unit 2 Gaseous Release Offsite Dose Projections

Unit 2 Gaseous Release Offsite Dose Projections: The following graph provides a comparison of Unit 2 gaseous offsite dose projections that were calculated to the maximum individual per 10 CFR 50, Appendix I and the ODCM. The projections use ODCM default meteorological parameters for the atmospheric conditions surrounding the plant site, and were performed prior to release authorization. **The steady decrease in highest organ dose were due to efforts to reduce overall offsite dose. Specifically, discharging liquid radioactive inventory provided the benefit of reduced total offsite dose, due to reduction in evaporative losses from the fuel pools.**

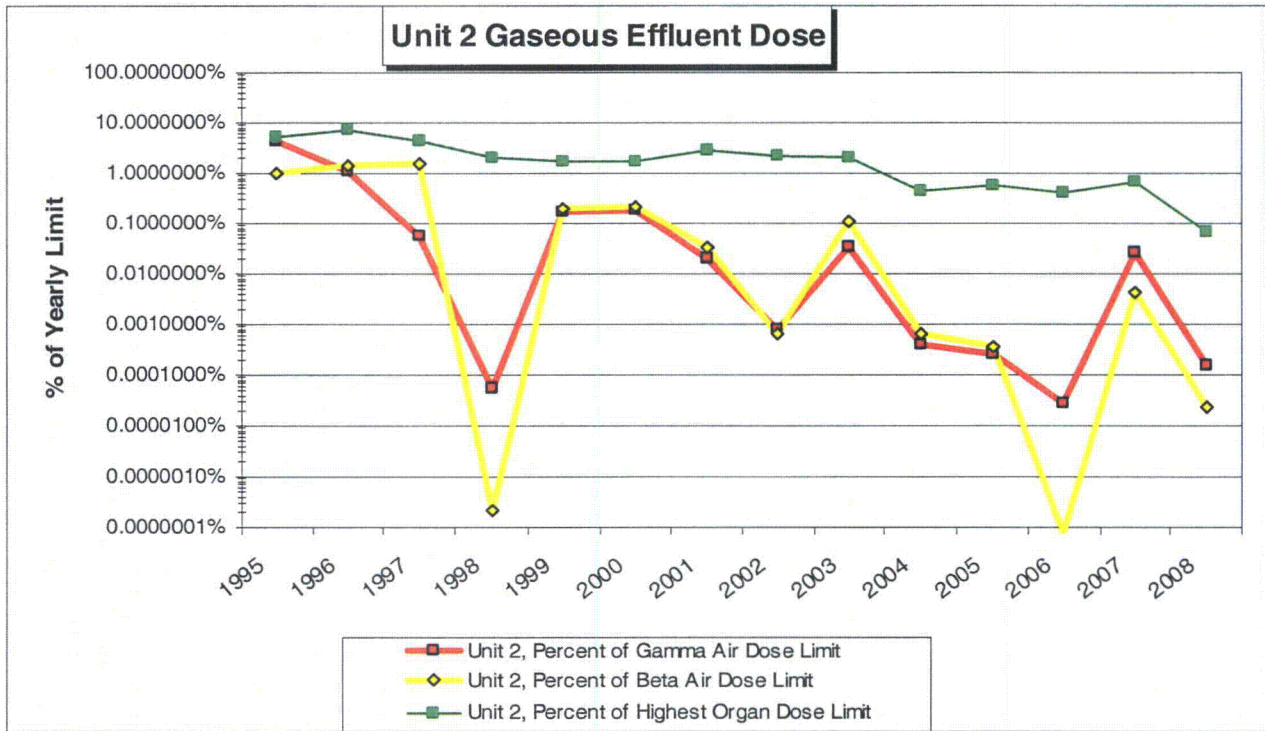

Radioactive Effluent Release Report
Calendar Year - 2008
Results of Abnormal Releases

Abnormal Liquid Releases: None

Abnormal Gas Releases: None

Radioactive Effluent Release Report

Calendar Year - 2008

Results of Onsite Spills and Items Added to Decommissioning Files per 10CFR50.75(g)

Summary of Onsite Spills (>100 gallons): None

Summary of Items added to Decommissioning Files per 10CFR50.75(g) Files: None

Radioactive Effluent Release Report

Calendar Year - 2008

Results of Onsite Groundwater Monitoring Program

Summary of Onsite Groundwater Samples

	2008 H-3 Maximum (pCi/L)	2008 H-3 Minimum (pCi/L)	2008 H-3 Average (pCi/L)	Typical H-3 LLD (pCi/L)	Required H-3 LLD (pCi/L)	Pre Operational Mean For H-3 (pCi/L)	Are Any H-3 Analyses Greater Than The Pre Operational Mean For H-3 ?	NEI and FENOC Communication Level For H-3 (pCi/L)	EPA Reporting Level For H-3 (pCi/L)
1st Quarter	13356	177	1782	<200	<2000	440	Yes	2000	20000
3rd Quarter	11501	144	1661	<200	<2000	440	Yes	2000	20000


Sample Summary: Seventeen (17) onsite monitoring wells were sampled during the year. Each of these wells was sampled two (2) times during the year, with exception of MW-12S & MW-12D, which were sampled three (3) times.

H-3 Summary: Results from twelve (12) wells were ≤ 440 pCi/L (BVPS pre-operational mean). Results from three (3) wells were > 440 pCi/L, but ≤ 2000 pCi/L. Results from two (2) wells (MW-12S & MW-12D) were > 2000 pCi/L, but $\leq 20,000$ pCi/L. Results from no wells were $> 20,000$ pCi/L. SINCE the NEI/FENOC communication level was reached for MW-12S & MW-12D during 2007, THEN notification to local, state & federal agencies was performed on 10/08/07. No additional wells reached the NEI/FENOC communication level during 2008. No adverse effect to the offsite environment has been detected at this time, because all offsite groundwater, drinking water and surface water samples were ≤ 440 pCi/L.

Principal Gamma Emitter Summary: Results showed $< \text{LLD}$ for all principal gamma emitters associated with Licensed Radioactive Material (LRM).

Gross Alpha & Gross Beta Summary: Baseline analyses were performed on fourteen (14) of the 3rd quarter samples. The Gross Alpha results ranged from $< \text{MDA}$ to 2.2 pCi/L, and the Gross Beta results ranged from 1.0 pCi/L to 5.6 pCi/L.

Fe-55, Ni-63, Sr-89 & Sr-90: Baseline analyses were performed on the 3rd quarter samples from MW-12S & MW-12D. The Fe 55 results were $< \text{LLD}$, the Ni-63 results were $< \text{LLD}$, the Sr-89 results were $< \text{LLD}$, and the Sr-90 results were $< \text{LLD}$.

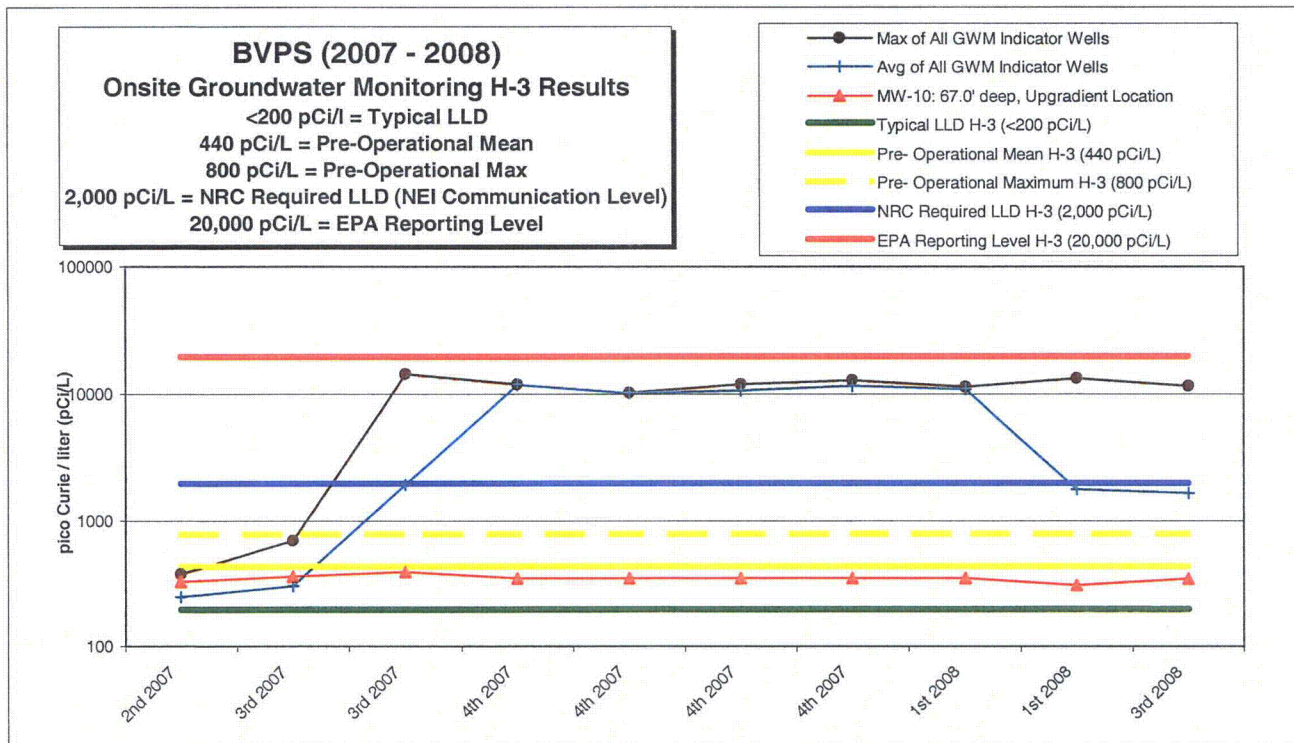

Radioactive Effluent Release Report

Calendar Year - 2008
 Supplemental Information Page

FACILITY: B.V.P.S. Units 1 and 2 **LICENSEE:** FENOC

1. Regulatory Limits	
a. Fission and activation gases:	Annual Unit 1 or 2 Dose: 10 mrad from Gamma, & 20 mrad from Beta
b. Iodines & particulates, half-lives > 8 days:	Annual Unit 1 or 2 Dose: 15 mrem to Any Organ
c. Liquid effluents:	Annual Unit 1 or 2 Dose: 3 mrem to Total Body, & 10 mrem to Any Organ

2. Maximum Permissible Concentrations Used in Determining Allowable Release Rates Or Concentrations	
a. Fission and activation gases:	Site Release Rate: 500 mrem/yr to Total Body, & 3000 mrem/yr to the Skin
b. Iodines & particulates, half-lives > 8 days:	Site Release Rate: 1500 mrem/yr to Any Organ
c. Liquid effluents:	Site Release Concentration: 10 times 10 CFR 20 Appendix B, Table 2, EC's

3. Average Energy (Not Applicable To The BVPS ODCM)

4. Measurements and Approximations of Total Radioactivity	
The methods used to measure or approximate the total radioactivity in effluents, and the methods used to determine radionuclide composition are as follows:	
a. Fission and activation gases:	Ge Gamma Spectrometry, Liquid Scintillation Counter
b. Iodines:	Ge Gamma Spectrometry
c. Particulates, half-lives > 8 days:	Ge Gamma Spectrometry, Proportional Counter
d. Liquid effluents:	Ge Gamma Spectrometry, Proportional Counter, Liquid Scintillation

5. Batch & Abnormal Release Information	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year
a. Liquid Batch Releases						
1. Number of batch releases		47	43	52	45	187
2. Total time period for batch releases	minutes	22139	16429	12242	15766	66576
3. Maximum time period for a batch release	minutes	2782	1628	1140	1080	2782
4. Average time period for batch releases	minutes	471	382	235	350	356
5. Minimum time period for a batch release	minutes	80	83	3	90	3
6. Average river flow during release periods	cuft/sec	85567	46300	15567	33933	45342
b. Gaseous Batch Releases						
1. Number of batch releases		11	22	10	9	52
2. Total time period for batch releases	minutes	5725	18209	3381	336	27651
3. Maximum time period for a batch release	minutes	3859	6610	2280	167	6610
4. Average time period for batch releases	minutes	520	828	338	37	532
5. Minimum time period for a batch release	minutes	52	1	167	2	1
c. Abnormal Liquid Releases						
1. Number of releases		NONE	NONE	NONE	NONE	NONE
2. Total activity released	Curies	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
d. Abnormal Gaseous Releases						
1. Number of releases		NONE	NONE	NONE	NONE	NONE
2. Total activity released	Curies	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00

Beaver Valley Power Station - Units 1 & 2

Enclosure 2, Page 2 of 21

Radioactive Effluent Release Report

Calendar Year - 2008

Table 1A

Gaseous Effluents - Summation Of All Releases

	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year	Total Error, %
A. Fission & Activation Gases							
1. Site Total release	CI	7.90E-02	1.67E+00	0.00E+00	0.00E+00	1.75E+00	26.5%
1a. Unit 1 Gases	CI	3.85E-02	1.81E-02	0.00E+00	0.00E+00	5.66E-02	
1b. Unit 2 Gases	CI	4.06E-02	1.65E+00	0.00E+00	0.00E+00	1.69E+00	
2. Average release rate for period	uCi/sec	1.00E-02	2.12E-01	0.00E+00	0.00E+00	5.55E-02	
3. Percent of applicable limit	%	N/A	N/A	N/A	N/A	N/A	
B. Iodines							
1. Site Total iodine - 131	CI	0.00E+00	1.17E-07	0.00E+00	0.00E+00	1.17E-07	28.3%
1a. Unit 1 iodine - 131	CI	0.00E+00	5.85E-08	0.00E+00	0.00E+00	5.85E-08	
1b. Unit 2 iodine - 131	CI	0.00E+00	5.85E-08	0.00E+00	0.00E+00	5.85E-08	
2. Average release rate for period	uCi/sec	0.00E+00	1.48E-08	0.00E+00	0.00E+00	3.71E-09	
3. Percent of applicable limit	%	N/A	N/A	N/A	N/A	N/A	
C. Particulates							
1. Particulates with half-lives > 8 days	CI	0.00E+00	9.38E-05	0.00E+00	0.00E+00	9.38E-05	30.0%
1a. Unit 1 Particulates	CI	0.00E+00	3.24E-05	0.00E+00	0.00E+00	3.24E-05	
1b. Unit 2 Particulates	CI	0.00E+00	6.14E-05	0.00E+00	0.00E+00	6.14E-05	
2. Average release rate for period	uCi/sec	0.00E+00	1.19E-05	0.00E+00	0.00E+00	2.98E-06	
3. Percent of applicable limit	%	N/A	N/A	N/A	N/A	N/A	
D. Gross Alpha							
1. Site Gross alpha radioactivity	CI	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	30.0%
1a. Unit 1 Gross alpha	CI	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	
1b. Unit 2 Gross alpha	CI	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	
2. Average release rate for period	uCi/sec	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	
3. Percent of applicable limit	%	N/A	N/A	N/A	N/A	N/A	
E. Tritium							
1. Site Total release	CI	4.21E+00	2.36E+00	5.96E+00	3.46E+00	1.60E+01	32.9%
1a. Unit 1 Tritium	CI	3.60E+00	1.80E+00	5.61E+00	2.67E+00	1.37E+01	
1b. Unit 2 Tritium	CI	6.05E-01	5.55E-01	3.45E-01	7.89E-01	2.29E+00	
2. Average release rate for period	uCi/sec	5.34E-01	2.99E-01	7.56E-01	4.39E-01	5.07E-01	
3. Percent of applicable limit	%	N/A	N/A	N/A	N/A	N/A	

N/A = Not Applicable

The amount of time (in seconds) used to calculate the release rates specified in A.2, B.2, C.2, D.2 and E.2 is the average amount of seconds per calendar quarter (7.88E+06 seconds).

Radioactive Effluent Release Report

Calendar Year - 2008

Table 1B-EB

Gaseous Effluents - Elevated Batch Releases

Nuclides released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year
1. Fission gases						
argon-41	Ci	LLD	LLD	LLD	LLD	LLD
krypton-85	Ci	LLD	LLD	LLD	LLD	LLD
krypton-85m	Ci	LLD	LLD	LLD	LLD	LLD
krypton-87	Ci	LLD	LLD	LLD	LLD	LLD
krypton-88	Ci	LLD	LLD	LLD	LLD	LLD
xenon-131m	Ci	LLD	LLD	LLD	LLD	LLD
xenon-133	Ci	LLD	4.99E-04	LLD	LLD	4.99E-04
xenon-133m	Ci	LLD	LLD	LLD	LLD	LLD
xenon-135	Ci	LLD	3.24E-05	LLD	LLD	3.24E-05
xenon-135m	Ci	LLD	LLD	LLD	LLD	LLD
xenon-138	Ci	LLD	LLD	LLD	LLD	LLD
unidentified	Ci	NONE	NONE	NONE	NONE	NONE
Total for period	Ci	ND	5.31E-04	ND	ND	5.31E-04
2. Iodines						
iodine-131	Ci	LLD	LLD	LLD	LLD	LLD
iodine-133	Ci	LLD	LLD	LLD	LLD	LLD
iodine-135	Ci	LLD	LLD	LLD	LLD	LLD
Total for period	Ci	ND	ND	ND	ND	ND
3. Particulates						
chromium-51	Ci	LLD	LLD	LLD	LLD	LLD
manganese-54	Ci	LLD	LLD	LLD	LLD	LLD
iron-59	Ci	LLD	LLD	LLD	LLD	LLD
cobalt-57	Ci	LLD	LLD	LLD	LLD	LLD
cobalt-58	Ci	LLD	1.52E-05	LLD	LLD	1.52E-05
cobalt-60	Ci	LLD	LLD	LLD	LLD	LLD
zinc-65	Ci	LLD	LLD	LLD	LLD	LLD
strontium-89	Ci	LLD	LLD	LLD	LLD	LLD
strontium-90	Ci	LLD	LLD	LLD	LLD	LLD
molybdenum-99	Ci	LLD	LLD	LLD	LLD	LLD
cesium-134	Ci	LLD	LLD	LLD	LLD	LLD
cesium-137	Ci	LLD	LLD	LLD	LLD	LLD
barium/lanthanum-140	Ci	LLD	LLD	LLD	LLD	LLD
cerium-141	Ci	LLD	LLD	LLD	LLD	LLD
cerium-144	Ci	LLD	LLD	LLD	LLD	LLD
unidentified	Ci	NONE	NONE	NONE	NONE	NONE
Total for period	Ci	ND	1.52E-05	ND	ND	1.52E-05

LLD = Below the Lower Limit of Detectability, in uCi/cc (Table 4).

ND = None Detected

Radioactive Effluent Release Report

Calendar Year - 2008

Table 1B-EC

Gaseous Effluents - Elevated Continuous Releases

Nuclides released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year
1. Fission gases						
argon-41	CI	LLD	3.57E-02	LLD	LLD	3.57E-02
krypton-85	CI	LLD	LLD	LLD	LLD	LLD
krypton-85m	CI	LLD	LLD	LLD	LLD	LLD
krypton-87	CI	LLD	LLD	LLD	LLD	LLD
krypton-88	CI	LLD	LLD	LLD	LLD	LLD
xenon-131m	CI	LLD	LLD	LLD	LLD	LLD
xenon-133	CI	7.69E-02	LLD	LLD	LLD	7.69E-02
xenon-133m	CI	LLD	LLD	LLD	LLD	LLD
xenon-135	CI	LLD	LLD	LLD	LLD	LLD
xenon-135m	CI	LLD	LLD	LLD	LLD	LLD
xenon-138	CI	LLD	LLD	LLD	LLD	LLD
unidentified	CI	NONE	NONE	NONE	NONE	NONE
Total for period	CI	7.69E-02	3.57E-02	ND	ND	1.13E-01
2. Iodines						
iodine-131	CI	LLD	1.17E-07	LLD	LLD	1.17E-07
iodine-133	CI	LLD	LLD	LLD	LLD	LLD
iodine-135	CI	LLD	LLD	LLD	LLD	LLD
Total for period	CI	ND	1.17E-07	ND	ND	1.17E-07
3. Particulates						
chromium-51	CI	LLD	LLD	LLD	LLD	LLD
manganese-54	CI	LLD	LLD	LLD	LLD	LLD
iron-59	CI	LLD	LLD	LLD	LLD	LLD
cobalt-57	CI	LLD	LLD	LLD	LLD	LLD
cobalt-58	CI	LLD	LLD	LLD	LLD	LLD
cobalt-60	CI	LLD	LLD	LLD	LLD	LLD
zinc-65	CI	LLD	LLD	LLD	LLD	LLD
strontium-89	CI	LLD	LLD	LLD	LLD	LLD
strontium-90	CI	LLD	LLD	LLD	LLD	LLD
molybdenum-99	CI	LLD	LLD	LLD	LLD	LLD
cesium-134	CI	LLD	LLD	LLD	LLD	LLD
cesium-137	CI	LLD	LLD	LLD	LLD	LLD
barium/lanthanum-140	CI	LLD	LLD	LLD	LLD	LLD
cerium-141	CI	LLD	LLD	LLD	LLD	LLD
cerium-144	CI	LLD	LLD	LLD	LLD	LLD
unidentified	CI	NONE	NONE	NONE	NONE	NONE
Total for period	CI	ND	ND	ND	ND	ND

LLD = Below the Lower Limit of Detectability, in uCi/cc (Table 4).

ND = None Detected

Beaver Valley Power Station - Unit 1

Radioactive Effluent Release Report

Calendar Year - 2008

Table 1C-GB1

Gaseous Effluents - Ground Level Batch Releases (Unit 1)

Nuclides released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year
1. Fission gases						
argon-41	CI	LLD	LLD	LLD	LLD	LLD
krypton-85	CI	LLD	LLD	LLD	LLD	LLD
krypton-85m	CI	LLD	LLD	LLD	LLD	LLD
krypton-87	CI	LLD	LLD	LLD	LLD	LLD
krypton-88	CI	LLD	LLD	LLD	LLD	LLD
xenon-131m	CI	LLD	LLD	LLD	LLD	LLD
xenon-133	CI	LLD	LLD	LLD	LLD	LLD
xenon-133m	CI	LLD	LLD	LLD	LLD	LLD
xenon-135	CI	LLD	LLD	LLD	LLD	LLD
xenon-135m	CI	LLD	LLD	LLD	LLD	LLD
xenon-138	CI	LLD	LLD	LLD	LLD	LLD
unidentified	CI	NONE	NONE	NONE	NONE	NONE
Total for period	CI	ND	ND	ND	ND	ND
2. Iodines						
iodine-131	CI	LLD	LLD	LLD	LLD	LLD
iodine-133	CI	LLD	LLD	LLD	LLD	LLD
iodine-135	CI	LLD	LLD	LLD	LLD	LLD
unidentified	CI	NONE	NONE	NONE	NONE	NONE
Total for period	CI	ND	ND	ND	ND	ND
3. Particulates						
chromium-51	CI	LLD	LLD	LLD	LLD	LLD
manganese-54	CI	LLD	LLD	LLD	LLD	LLD
iron-59	CI	LLD	LLD	LLD	LLD	LLD
cobalt-57	CI	LLD	LLD	LLD	LLD	LLD
cobalt-58	CI	LLD	LLD	LLD	LLD	LLD
cobalt-60	CI	LLD	LLD	LLD	LLD	LLD
zinc-65	CI	LLD	LLD	LLD	LLD	LLD
strontium-89	CI	LLD	LLD	LLD	LLD	LLD
strontium-90	CI	LLD	LLD	LLD	LLD	LLD
molybdenum-99	CI	LLD	LLD	LLD	LLD	LLD
cesium-134	CI	LLD	LLD	LLD	LLD	LLD
cesium-137	CI	LLD	LLD	LLD	LLD	LLD
barium/lanthanum-140	CI	LLD	LLD	LLD	LLD	LLD
cerium-141	CI	LLD	LLD	LLD	LLD	LLD
cerium-144	CI	LLD	LLD	LLD	LLD	LLD
unidentified	CI	NONE	NONE	NONE	NONE	NONE
Total for period	CI	ND	ND	ND	ND	ND

LLD = Below the Lower Limit of Detectability, in uCi/cc (Table 4).

ND = None Detected

Beaver Valley Power Station - Unit 1

Radioactive Effluent Release Report

Calendar Year - 2008

Table 1C-GC1

Gaseous Effluents - Ground Level Continuous Releases (Unit 1)

Nuclides released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year
1. Fission gases						
argon-41	CI	LLD	LLD	LLD	LLD	LLD
krypton-85	CI	LLD	LLD	LLD	LLD	LLD
krypton-85m	CI	LLD	LLD	LLD	LLD	LLD
krypton-87	CI	LLD	LLD	LLD	LLD	LLD
krypton-88	CI	LLD	LLD	LLD	LLD	LLD
xenon-131m	CI	LLD	LLD	LLD	LLD	LLD
xenon-133	CI	LLD	LLD	LLD	LLD	LLD
xenon-133m	CI	LLD	LLD	LLD	LLD	LLD
xenon-135	CI	LLD	LLD	LLD	LLD	LLD
xenon-135m	CI	LLD	LLD	LLD	LLD	LLD
xenon-138	CI	LLD	LLD	LLD	LLD	LLD
unidentified	CI	NONE	NONE	NONE	NONE	NONE
Total for period	CI	ND	ND	ND	ND	ND
2. Iodines						
iodine-131	CI	LLD	LLD	LLD	LLD	LLD
iodine-133	CI	LLD	LLD	LLD	LLD	LLD
iodine-135	CI	LLD	LLD	LLD	LLD	LLD
Total for period	CI	ND	ND	ND	ND	ND
3. Particulates						
chromium-51	CI	LLD	LLD	LLD	LLD	LLD
manganese-54	CI	LLD	LLD	LLD	LLD	LLD
iron-59	CI	LLD	LLD	LLD	LLD	LLD
cobalt-57	CI	LLD	LLD	LLD	LLD	LLD
cobalt-58	CI	LLD	2.48E-05	LLD	LLD	2.48E-05
cobalt-60	CI	LLD	LLD	LLD	LLD	LLD
zinc-65	CI	LLD	LLD	LLD	LLD	LLD
zirconium/niobium-95	CI	LLD	LLD	LLD	LLD	LLD
zirconium/niobium-97	CI	LLD	LLD	LLD	LLD	LLD
molybdenum-99	CI	LLD	LLD	LLD	LLD	LLD
cesium-134	CI	LLD	LLD	LLD	LLD	LLD
cesium-137	CI	LLD	LLD	LLD	LLD	LLD
barium/lanthanum-140	CI	LLD	LLD	LLD	LLD	LLD
cerium-141	CI	LLD	LLD	LLD	LLD	LLD
cerium-144	CI	LLD	LLD	LLD	LLD	LLD
unidentified	CI	NONE	NONE	NONE	NONE	NONE
Total for period	CI	ND	2.48E-05	ND	ND	2.48E-05

LLD = Below the Lower Limit of Detectability, in uCi/cc (Table 4).

ND = None Detected

Beaver Valley Power Station - Unit 2

Enclosure 2, Page 7 of 21

Radioactive Effluent Release Report

Calendar Year - 2008

Table 1C-GB2

Gaseous Effluents - Ground Level Batch Releases (Unit 2)

Nuclides released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year
1. Fission gases						
argon-41	CI	LLD	1.58E+00	LLD	LLD	1.58E+00
krypton-85	CI	LLD	LLD	LLD	LLD	LLD
krypton-85m	CI	LLD	3.23E-03	LLD	LLD	3.23E-03
krypton-87	CI	LLD	6.59E-03	LLD	LLD	6.59E-03
krypton-88	CI	LLD	8.43E-03	LLD	LLD	8.43E-03
xenon-131m	CI	LLD	LLD	LLD	LLD	LLD
xenon-133	CI	LLD	1.42E-02	LLD	LLD	1.42E-02
xenon-133m	CI	LLD	LLD	LLD	LLD	LLD
xenon-135	CI	LLD	2.01E-02	LLD	LLD	2.01E-02
xenon-135m	CI	LLD	LLD	LLD	LLD	LLD
xenon-138	CI	LLD	LLD	LLD	LLD	LLD
unidentified	CI	NONE	NONE	NONE	NONE	NONE
Total for period	CI	ND	1.63E+00	ND	ND	1.63E+00
2. Iodines						
iodine-131	CI	LLD	LLD	LLD	LLD	LLD
iodine-133	CI	LLD	LLD	LLD	LLD	LLD
iodine-135	CI	LLD	LLD	LLD	LLD	LLD
Total for period	CI	ND	ND	ND	ND	ND
3. Particulates						
beryllium-7	CI	LLD	LLD	LLD	LLD	LLD
chromium-51	CI	LLD	LLD	LLD	LLD	LLD
manganese-54	CI	LLD	LLD	LLD	LLD	LLD
iron-59	CI	LLD	LLD	LLD	LLD	LLD
cobalt-57	CI	LLD	LLD	LLD	LLD	LLD
cobalt-58	CI	LLD	1.38E-05	LLD	LLD	1.38E-05
cobalt-60	CI	LLD	9.17E-07	LLD	LLD	9.17E-07
zinc-65	CI	LLD	LLD	LLD	LLD	LLD
strontium-89	CI	LLD	LLD	LLD	LLD	LLD
strontium-90	CI	LLD	LLD	LLD	LLD	LLD
zirconium/niobium-97	CI	LLD	LLD	LLD	LLD	LLD
cesium-134	CI	LLD	LLD	LLD	LLD	LLD
cesium-137	CI	LLD	9.17E-07	LLD	LLD	9.17E-07
barium/lanthanum-140	CI	LLD	LLD	LLD	LLD	LLD
cerium-141	CI	LLD	LLD	LLD	LLD	LLD
cerium-144	CI	LLD	LLD	LLD	LLD	LLD
unidentified	CI	NONE	NONE	NONE	NONE	NONE
Total for period	CI	ND	1.56E-05	ND	ND	1.56E-05

LLD = Below the Lower Limit of Detectability, in uCi/cc (Table 4).

ND = None Detected

Beaver Valley Power Station - Unit 2

Enclosure 2, Page 8 of 21

Radioactive Effluent Release Report

Calendar Year - 2008

Table 1C-GC2

Gaseous Effluents - Ground Level Continuous Releases (Unit 2)

Nuclides released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year
1. Fission gases						
argon-41	CI	2.12E-03	LLD	LLD	LLD	2.12E-03
krypton-85	CI	LLD	LLD	LLD	LLD	LLD
krypton-85m	CI	LLD	LLD	LLD	LLD	LLD
krypton-87	CI	LLD	LLD	LLD	LLD	LLD
krypton-88	CI	LLD	LLD	LLD	LLD	LLD
xenon-131m	CI	LLD	LLD	LLD	LLD	LLD
xenon-133	CI	LLD	LLD	LLD	LLD	LLD
xenon-133m	CI	LLD	LLD	LLD	LLD	LLD
xenon-135	CI	LLD	LLD	LLD	LLD	LLD
xenon-135m	CI	LLD	LLD	LLD	LLD	LLD
xenon-138	CI	LLD	LLD	LLD	LLD	LLD
unidentified	CI	NONE	NONE	NONE	NONE	NONE
Total for period	CI	2.12E-03	ND	ND	ND	2.12E-03
2. Iodines						
iodine-131	CI	LLD	LLD	LLD	LLD	LLD
iodine-133	CI	LLD	LLD	LLD	LLD	LLD
iodine-135	CI	LLD	LLD	LLD	LLD	LLD
Total for period	CI	ND	ND	ND	ND	ND
3. Particulates						
chromium-51	CI	LLD	LLD	LLD	LLD	LLD
manganese-54	CI	LLD	LLD	LLD	LLD	LLD
iron-59	CI	LLD	LLD	LLD	LLD	LLD
cobalt-57	CI	LLD	LLD	LLD	LLD	LLD
cobalt-58	CI	LLD	3.82E-05	LLD	LLD	3.82E-05
cobalt-60	CI	LLD	LLD	LLD	LLD	LLD
zinc-65	CI	LLD	LLD	LLD	LLD	LLD
strontium-89	CI	LLD	LLD	LLD	LLD	LLD
strontium-90	CI	LLD	LLD	LLD	LLD	LLD
zirconium/niobium-95	CI	LLD	LLD	LLD	LLD	LLD
cesium-134	CI	LLD	LLD	LLD	LLD	LLD
cesium-137	CI	LLD	LLD	LLD	LLD	LLD
barium/lanthanum-140	CI	LLD	LLD	LLD	LLD	LLD
cerium-141	CI	LLD	LLD	LLD	LLD	LLD
cerium-144	CI	LLD	LLD	LLD	LLD	LLD
unidentified	CI	NONE	NONE	NONE	NONE	NONE
Total for period	CI	ND	3.82E-05	ND	ND	3.82E-05

LLD = Below the Lower Limit of Detectability, in uCi/cc (Table 4).

ND = None Detected

Beaver Valley Power Station - Units 1 & 2

Radioactive Effluent Release Report

Calendar Year - 2008

Table 2A

Liquid Effluents - Summation Of All Releases

	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year	Total Error, %
A. Fission & activation products							
1. Total release (excl. H-3, gas & alpha)	Ci	5.68E-02	6.76E-02	1.97E-01	7.64E-02	3.97E-01	26.1%
2. Average diluted concentration	uCi/ml	3.37E-08	5.47E-08	1.44E-07	4.97E-08	6.82E-08	
3. Percent of applicable limit	%	2.27E+00	2.70E+00	7.86E+00	3.06E+00	3.97E+00	
B. Tritium							
1. Total release	Ci	3.07E+02	5.00E+02	1.54E+02	5.42E+02	1.50E+03	25.0%
2. Average diluted concentration	uCi/ml	1.82E-04	4.05E-04	1.13E-04	3.52E-04	2.58E-04	
3. Percent of applicable limit	%	1.82E+00	4.05E+00	1.13E+00	3.52E+00	2.58E+00	
C. Dissolved and entrained gases							
1. Total release	Ci	4.98E-06	7.23E-05	9.58E-05	2.18E-03	2.35E-03	27.0%
2. Average diluted concentration	uCi/ml	2.95E-12	5.85E-11	7.04E-11	1.42E-09	4.04E-10	
3. Percent of applicable limit	%	1.48E-06	2.92E-05	3.52E-05	7.08E-04	2.02E-04	
D. Gross alpha radioactivity (total release)							
	Ci	LLD	LLD	LLD	LLD	LLD	28.9%
E. Volume of waste released (prior to dilution)							
	liters	2.34E+06	2.19E+06	2.41E+06	2.43E+06	9.37E+06	11.2%
F. Volume of dilution water used							
	liters	1.68E+09	1.23E+09	1.36E+09	1.54E+09	5.81E+09	22.9%

LLD = Below the Lower Limit of Detectability, in uCi/ml (Table 4)

A.3 is based on a historical PA-DEP guide of 10 Ci/yr

B.3 is based on a ODCM limit of 1.00E-2 uCi/ml

C.3 is based on a ODCM limit of 2.00E-04 uCi/ml

The values listed at F. are the volumes during actual liquid waste discharge periods. The total dilution volume for a continuous calendar quarter is approximately 1E+10 liters for BVPS-1 & 2 (ie.; ~ 22,800 gpm is the total dilution flowrate from the site)

Beaver Valley Power Station - Units 1 & 2

Radioactive Effluent Release Report

Calendar Year - 2008

Table 2B-B

Liquid Effluents - Batch Releases

Nuclides released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year
-------------------	------	-------------	-------------	-------------	-------------	---------------

1. Fission and activation products

beryllium-7	Ci	LLD	LLD	LLD	LLD	LLD
sodium-24	Ci	LLD	LLD	LLD	LLD	LLD
chromium-51	Ci	3.21E-04	2.97E-03	1.46E-03	LLD	4.75E-03
manganese-54	Ci	1.28E-04	4.54E-04	4.40E-04	3.34E-04	1.36E-03
iron-55	Ci	2.33E-02	8.31E-03	1.01E-01	3.02E-02	1.63E-01
iron-59	Ci	4.94E-04	8.58E-04	1.21E-03	1.64E-04	2.73E-03
cobalt-57	Ci	1.67E-05	9.14E-05	2.66E-04	2.56E-04	6.30E-04
cobalt-58	Ci	2.43E-03	3.48E-02	4.24E-02	2.13E-02	1.01E-01
cobalt-60	Ci	3.95E-03	3.41E-03	1.24E-02	9.99E-03	2.97E-02
zinc-65	Ci	1.95E-03	3.53E-04	6.02E-03	3.81E-03	1.21E-02
strontium-89	Ci	LLD	LLD	LLD	LLD	LLD
strontium-90	Ci	LLD	LLD	LLD	LLD	LLD
zirconium/niobium-95	Ci	5.84E-05	9.58E-05	3.78E-04	2.80E-04	8.12E-04
zirconium/niobium-97	Ci	8.16E-06	1.02E-05	7.42E-06	2.45E-05	5.03E-05
molybdenum-99/technetium-99m	Ci	LLD	LLD	LLD	LLD	LLD
tin-113	Ci	LLD	LLD	LLD	LLD	LLD
silver-110m	Ci	9.91E-04	1.42E-03	1.39E-03	1.04E-03	4.85E-03
antimony-122	Ci	LLD	4.72E-04	LLD	LLD	4.72E-04
antimony-124	Ci	1.41E-03	2.17E-03	7.96E-04	LLD	4.37E-03
antimony-125	Ci	2.14E-02	1.21E-02	2.85E-02	8.18E-03	7.01E-02
iodine-131	Ci	LLD	LLD	LLD	LLD	LLD
cesium-134	Ci	1.53E-05	4.71E-07	LLD	3.78E-05	5.36E-05
cesium-137	Ci	3.65E-04	6.42E-05	3.52E-04	8.35E-04	1.62E-03
barium/lanthanum-140	Ci	LLD	LLD	LLD	LLD	LLD
cerium-141	Ci	LLD	LLD	LLD	LLD	LLD
cerium-144	Ci	LLD	LLD	LLD	LLD	LLD
unidentified	Ci	NONE	NONE	NONE	NONE	NONE
Total for period	Ci	5.68E-02	6.76E-02	1.97E-01	7.64E-02	3.97E-01

2. Dissolved and entrained gases

krypton-85	Ci	LLD	LLD	LLD	1.73E-03	1.73E-03
xenon-133	Ci	4.98E-06	7.23E-05	9.58E-05	4.50E-04	6.23E-04
xenon-133m	Ci	LLD	LLD	LLD	LLD	LLD
xenon-135	Ci	LLD	LLD	LLD	LLD	LLD
unidentified	Ci	NONE	NONE	NONE	NONE	NONE
Total for period	Ci	4.98E-06	7.23E-05	9.58E-05	2.18E-03	2.35E-03

LLD = Below the Lower Limit of Detectability, in uCi/ml (Table 4)

Beaver Valley Power Station - Units 1 & 2

Enclosure 2, Page 11 of 21

Radioactive Effluent Release Report

Calendar Year - 2008

Table 2B-C

Liquid Effluents - Continuous Releases

Nuclides released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year
-------------------	------	-------------	-------------	-------------	-------------	---------------

1. Fission and activation products

beryllium-7	Cl	N/A	N/A	N/A	N/A	N/A
sodium-24	Cl	N/A	N/A	N/A	N/A	N/A
chromium-51	Cl	N/A	N/A	N/A	N/A	N/A
manganese-54	Cl	N/A	N/A	N/A	N/A	N/A
iron-55	Cl	N/A	N/A	N/A	N/A	N/A
iron-59	Cl	N/A	N/A	N/A	N/A	N/A
cobalt-57	Cl	N/A	N/A	N/A	N/A	N/A
cobalt-58	Cl	N/A	N/A	N/A	N/A	N/A
cobalt-60	Cl	N/A	N/A	N/A	N/A	N/A
zinc-65	Cl	N/A	N/A	N/A	N/A	N/A
strontium-89	Cl	N/A	N/A	N/A	N/A	N/A
strontium-90	Cl	N/A	N/A	N/A	N/A	N/A
zirconium/niobium-95	Cl	N/A	N/A	N/A	N/A	N/A
zirconium/niobium-97	Cl	N/A	N/A	N/A	N/A	N/A
molybdenum-99	Cl	N/A	N/A	N/A	N/A	N/A
technetium-99m	Cl	N/A	N/A	N/A	N/A	N/A
ruthenium-103	Cl	N/A	N/A	N/A	N/A	N/A
silver-110m	Cl	N/A	N/A	N/A	N/A	N/A
antimony-124	Cl	N/A	N/A	N/A	N/A	N/A
antimony-125	Cl	N/A	N/A	N/A	N/A	N/A
iodine-131	Cl	N/A	N/A	N/A	N/A	N/A
iodine-133	Cl	N/A	N/A	N/A	N/A	N/A
cesium-134	Cl	N/A	N/A	N/A	N/A	N/A
cesium-137	Cl	N/A	N/A	N/A	N/A	N/A
barium/lanthanum-140	Cl	N/A	N/A	N/A	N/A	N/A
cerium-141	Cl	N/A	N/A	N/A	N/A	N/A
cerium-144	Cl	N/A	N/A	N/A	N/A	N/A
unidentified	Cl	N/A	N/A	N/A	N/A	N/A
Total for period	Cl	N/A	N/A	N/A	N/A	N/A

2. Dissolved and entrained gases

argon-41	Cl	N/A	N/A	N/A	N/A	N/A
xenon-133	Cl	N/A	N/A	N/A	N/A	N/A
xenon-133m	Cl	N/A	N/A	N/A	N/A	N/A
xenon-135	Cl	N/A	N/A	N/A	N/A	N/A
unidentified	Cl	N/A	N/A	N/A	N/A	N/A
Total for period	Cl	N/A	N/A	N/A	N/A	N/A

N/A = Not Applicable (liquids not discharged in a continuous mode during this period)

Beaver Valley Power Station - Units 1 & 2

Radioactive Effluent Release Report

Calendar Year - 2008

Table 3A

Solid Waste And Irradiated Fuel Shipments (Part 1 of 3)

A. Solid Waste Shipped Offsite For Burial Or Disposal (Not irradiated fuel)			
1. Type of Waste (Spent resins, Filter Sludges, Evaporator Bottoms, Oil)	1st Half	2nd Half	Estimated Total Error
a. Volume Shipped	1.39E+01 m3	6.46E+00 m3	0.0% (1)
b. Volume Buried	6.29E-01 m3	1.80E-01 m3	0.0% (1)
c. Total Activity	1.30E+00 Ci	9.58E-01 Ci	30.0%
2. Estimate of Major Nuclide Composition by Type of Waste On This Table (2)	Percent (%)	Percent (%)	
H-3	12.70 %	0.69 %	
C-14	3.57 %	0.54 %	
Mn-54	0.59 %	2.24 %	
Fe-55	17.80 %	42.50 %	
Co-58	4.91 %	5.19 %	
Co-60	14.40 %	18.10 %	
Ni-59	0.29 %	0.21 %	
Ni-63	32.40 %	13.00 %	
Cs-134	0.21 %	0.00 %	
Cs-137	2.29 %	0.18 %	
Ce-144/Pr-144	0.02 %	0.96 %	
Pu-238	0.00 %	0.01 %	
Pu-241	0.09 %	0.05 %	
3. Number of Shipments	4	2	
a. Type of Container Used	LSA	3	1
	Type A	0	0
	Type B	0	0
	Large Quantity	0	0
b. Solidification Agent Used	Cement	0	0
	Urea Formaldehyde	0	0
	None	4	2
c. Mode of Transport	Truck	4	2
	Rail	0	0
d. Final Destination	Erwin, TN	2	0
	Oak Ridge, TN	2	2
e. Waste Class per 10 CFR Part 61	Class A	4	2
	Class B	0	0
	Class C	0	0
	> Class C	0	0

(1) Since container volumes are provided by the burial site, a calculational error of zero is assumed.

(2) Percent values for any nuclide that are <0.01 % are not shown on this table. Data is available upon request

Radioactive Effluent Release Report

Calendar Year - 2008

Table 3B

Solid Waste And Irradiated Fuel Shipments (Part 2 of 3)

A. Solid Waste Shipped Offsite For Burial Or Disposal (Not irradiated fuel)				
1. Type of Waste (Dry Compressible Waste, Contaminated Equipment, etc.)		1st Half	2nd Half	Estimated Total Error
a. Volume Shipped		4.71E+01 m3	1.48E+02 m3	0.0% (1)
b. Volume Buried		1.15E+02 m3	6.16E+01 m3	0.0% (1)
c. Total Activity		3.07E-01 Ci	3.89E-01 Ci	30.0%
2. Estimate of Major Nuclide Composition by Type of Waste On This Table (2)		Percent (%)	Percent (%)	
H-3		0.98 %	1.90 %	
C-14		0.47 %	0.91 %	
Cr-51		6.52 %	0.30 %	
Mn-54		1.45 %	2.12 %	
Fe-55		17.00 %	30.30 %	
Co-58		13.40 %	7.11 %	
Co-60		8.38 %	17.60 %	
Ni-59		0.15 %	1.68 %	
Ni-63		8.75 %	18.20 %	
Sr-90		0.07 %	0.02 %	
Nb-95		23.00 %	2.74 %	
Zr-95		15.00 %	5.86 %	
Tc-99		0.01 %	0.00 %	
Ag-110m		0.09 %	0.00 %	
Sb-125		0.72 %	1.38 %	
I-129		0.01 %	0.00 %	
Cs-134		0.08 %	0.04 %	
Cs-137		0.92 %	0.62 %	
Ce-144/Pr-144		0.24 %	0.32 %	
Pu-241		0.09 %	0.26 %	
3. Number of Shipments		8	4	
a. Type of Container Used	LSA	8	4	
	Type A	0	0	
	Type B	0	0	
	Large Quantity	0	0	
b. Solidification Agent Used	Cement	0	0	
	Urea Formaldehyde	0	0	
	None	8	4	
c. Mode of Transport	Truck	8	4	
	Rail	0	0	
	Other	0	0	
d. Final Destination	Oak Ridge, TN	8	4	
	Wampum, PA	0	0	
e. Waste Class per 10.CFR Part 61	Class A	8	4	
	Class B	0	0	
	Class C	0	0	
	> Class C	0	0	

(1) Since container volumes are provided by the burial site, a calculational error of zero is assumed.

(2) Percent values for any nuclide that are <0.01 % are not shown on this table. Data is available upon request.

Beaver Valley Power Station - Units 1 & 2

Radioactive Effluent Release Report

Calendar Year - 2008

Table 3C

Solid Waste And Irradiated Fuel Shipments (Part 3 of 3)

A. Solid Waste Shipped Offsite For Burial Or Disposal (Not irradiated fuel)			
1. Type of Waste (Irradiated components, Control Rods, etc)	1st Half	2nd Half	Estimated Total Error
a. Volume Shipped	0.00E+00 m3	0.00E+00 m3	0.0% (1)
b. Volume Buried	0.00E+00 m3	0.00E+00 m3	0.0% (1)
c. Total Activity	0.00E+00 Ci	0.00E+00 Ci	0.0%
2. Estimate of Major Nuclide Composition by Type of Waste On This Table (2)	Percent (%)	Percent (%)	
3. Number of Shipments	0	0	
a. Type of Container Used	LSA	0	0
	Type A	0	0
	Type B	0	0
	Large Quantity	0	0
b. Solidification Agent Used	Cement	0	0
	Urea Formaldehyde	0	0
	None	0	0
c. Mode of Transport	Truck	0	0
	Rail	0	0
	Other	0	0
d. Final Destination	Barnwell, SC	0	0
	Oak Ridge, TN	0	0
e. Waste Class per 10 CFR Part 61	Class A	0	0
	Class B	0	0
	Class C	0	0
	> Class C	0	0
B. No Irradiated Fuel Shipments			

(1) Since container volumes are provided by the burial site, a calculational error of zero is assumed.

(2) Percent values for any nuclide that are <0.01 % are not shown on this table. Data is available upon request.

Radioactive Effluent Release Report

Calendar Year - 2008

Table 4

Lower Limits Of Detectability (LLD)

Nuclide	RWDA-G 1000 cc Gas Grab Sample		RWDA-L 1000 ml Liquid Grab Sample		Filter Paper / Charcoal Continuous Effluent Sample	
	(3) Calculated LLD (uCi/cc)	ODCM Required LLD (uCi/cc)	(3) Calculated LLD (uCi/ml)	ODCM Required LLD (uCi/ml)	(3) Calculated (2) LLD (uCi/cc)	ODCM Required LLD (uCi/cc)
H-3	(4) 1.00E-06	1E-06	1.00E-06	1E-05	-----	-----
Na-24	7.17E-08	1E-04	1.54E-08	5E-07	1.55E-13	1E-11
Ar-41	1.54E-08	1E-04	3.32E-09	5E-07	-----	-----
Cr-51	6.78E-07	1E-04	1.55E-07	5E-07	5.98E-13	1E-11
Mn-54	6.71E-08	1E-04	1.45E-08	5E-07	1.00E-13	1E-11
Fe-55	-----	-----	(1) 1.00E-06	1E-06	-----	-----
Fe-59	1.83E-07	1E-04	3.94E-08	5E-07	2.26E-13	1E-11
Co-57	6.55E-08	1E-04	1.76E-08	5E-07	7.48E-14	1E-11
Co-58	9.87E-08	1E-04	2.13E-08	5E-07	1.27E-13	1E-11
Co-60	9.96E-08	1E-04	2.15E-08	5E-07	1.11E-13	1E-11
Zn-65	1.82E-07	1E-04	3.92E-08	5E-07	1.30E-13	1E-11
Kr-85	1.91E-05	1E-04	4.19E-06	1E-05	-----	-----
Kr-85m	7.65E-08	1E-04	1.96E-08	1E-05	-----	-----
Kr-87	1.32E-07	1E-04	2.96E-08	1E-05	-----	-----
Kr-88	2.20E-07	1E-04	5.36E-08	1E-05	-----	-----
Sr-89	-----	-----	(1) 5.00E-08	5E-08	(1) 1.00E-13	1E-11
Sr-90	-----	-----	(1) 5.00E-08	5E-08	(1) 1.00E-14	1E-11
Sr-92	1.14E-07	1E-04	2.44E-08	5E-07	3.18E-14	1E-11
Nb-95	8.26E-08	1E-04	1.79E-05	5E-07	7.60E-14	1E-11
Nb-97	2.79E-08	1E-04	6.04E-09	5E-07	8.27E-14	1E-11
Zr-95	1.12E-07	1E-04	2.41E-08	5E-07	1.66E-13	1E-11
Mo-99	5.75E-08	1E-04	1.49E-08	5E-07	7.53E-14	1E-11
Tc-99m	5.60E-08	1E-04	1.45E-08	5E-07	7.34E-14	1E-11
Ag-110m	2.89E-08	1E-04	6.28E-09	5E-07	8.59E-14	1E-11
Sb-124	6.33E-08	1E-04	1.38E-08	5E-07	1.08E-13	1E-11
Sb-125	2.00E-07	1E-04	4.45E-08	5E-07	2.40E-13	1E-11
I-131	7.37E-08	1E-04	1.67E-08	1E-06	1.10E-13	1E-12
I-133	9.04E-08	1E-04	1.98E-08	5E-07	8.46E-14	1E-10
I-135	2.86E-07	1E-04	6.17E-08	5E-07	1.01E-13	1E-11
Xe-131m	2.90E-06	1E-04	7.29E-07	1E-05	-----	-----
Xe-133	1.66E-07	1E-04	5.20E-08	1E-05	-----	-----
Xe-133m	5.18E-07	1E-04	1.23E-07	1E-05	-----	-----
Xe-135	7.98E-08	1E-04	1.89E-08	1E-05	-----	-----
Xe-135m	6.77E-08	1E-04	1.49E-08	1E-05	-----	-----
Xe-137	2.28E-07	1E-04	5.06E-08	1E-05	-----	-----
Xe-138	2.19E-07	1E-04	5.14E-08	1E-05	-----	-----
Cs-134	6.88E-08	1E-04	1.50E-08	5E-07	9.94E-14	1E-11
Cs-137	4.56E-08	1E-04	9.90E-09	5E-07	1.11E-13	1E-11
Ba-139	3.15E-07	1E-04	7.91E-08	5E-07	3.81E-13	1E-11
Ba-140	3.76E-07	1E-04	8.24E-08	5E-07	4.12E-13	1E-11
La-140	1.92E-08	1E-04	4.08E-09	5E-07	3.40E-14	1E-11
Ce-141	1.10E-07	1E-04	2.83E-08	5E-07	1.53E-13	1E-11
Ce-144	2.42E-06	1E-04	2.01E-07	5E-07	4.95E-13	1E-11
Gross Alpha	-----	-----	(1) 1.00E-07	1E-07	(1) 3.51E-15	1E-11

- (1) Sample analyses performed by a contractor laboratory.
- (2) These LLD calculations contain a default weekly continuous sample volume of 2.85E+8 cc. Therefore, grab sample LLD values reflect a different volume (ie; 10 cuft or 2.83E+5 cc).
- (3) The calculated LLD's, except those denoted by (1), are from a counter/detector calibration on 09/02/08. These values are typical for other counter/detectors used for effluent counting at BVPS.
- (4) Based on counting 50 ml of the water that was bubbled through a 20 liter air sample.

Beaver Valley Power Station - Unit 1

Enclosure 2, Page 16 of 21

Radioactive Effluent Release Report

Calendar Year - 2008

Table 5A

Assessment Of Radiation Doses

Unit 1 Liquid Effluents											
		1st Quarter		2nd Quarter		3rd Quarter		4th Quarter		Calendar Year	
Batch Releases		Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit
O R G A N (1)	Bone	7.69E-03	0.1538	1.39E-03	0.0278	6.85E-03	0.1370	1.40E-02	0.2800	2.99E-02	0.2993
	Liver	1.60E-02	0.3200	8.89E-03	0.1778	1.81E-02	0.3620	2.72E-02	0.5430	7.01E-02	0.7014
	Total Body	1.02E-02	0.6800	7.66E-03	0.5107	1.07E-02	0.7127	1.75E-02	1.1660	4.60E-02	1.5347
	Thyroid	2.32E-03	0.0464	5.92E-03	0.1184	2.61E-03	0.0522	3.05E-03	0.0610	1.39E-02	0.1390
	Kidney	8.64E-03	0.1728	7.36E-03	0.1472	1.12E-02	0.2240	1.38E-02	0.2760	4.10E-02	0.4100
	Lung	3.33E-03	0.0666	6.08E-03	0.1216	3.21E-03	0.0642	4.89E-03	0.0978	1.75E-02	0.1751
	GI-LLI	7.16E-03	0.1432	1.06E-02	0.2120	1.36E-02	0.2720	1.16E-02	0.2310	4.29E-02	0.4291

Unit 1 Gaseous Effluents											
		1st Quarter		2nd Quarter		3rd Quarter		4th Quarter		Calendar Year	
Batch & Continuous Releases		Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit
(2)	Gamma Air	2.89E-07	0.0000	1.36E-09	0.0000	1.30E-06	0.0000	0.00E+00	0.0000	1.59E-06	0.0000
(2)	Beta Air	1.36E-09	0.0000	6.80E-12	0.0000	1.95E-09	0.0000	0.00E+00	0.0000	3.32E-09	0.0000
O R G A N (3)	Bone	0.00E+00	0.0000	9.03E-06	0.0001	0.00E+00	0.0000	0.00E+00	0.0000	9.03E-06	0.0001
	Liver	9.81E-02	1.3080	3.90E-02	0.5200	1.93E-02	0.2573	2.25E-02	0.3000	1.79E-01	1.1927
	Total Body	9.81E-02	1.3080	3.90E-02	0.5200	1.93E-02	0.2573	2.25E-02	0.3000	1.79E-01	1.1927
	Thyroid	9.81E-02	1.3080	3.90E-02	0.5200	1.93E-02	0.2573	2.25E-02	0.3000	1.79E-01	1.1927
	Kidney	9.81E-02	1.3080	3.90E-02	0.5200	1.93E-02	0.2573	2.25E-02	0.3000	1.79E-01	1.1927
	Lung	9.81E-02	1.3080	3.90E-02	0.5200	1.93E-02	0.2573	2.25E-02	0.3000	1.79E-01	1.1927
	GI-LLI	9.81E-02	1.3080	3.90E-02	0.5200	1.93E-02	0.2573	2.25E-02	0.3000	1.79E-01	1.1927

(1) These doses are listed in mrem; they are calculated for the maximum individual for all batch liquid effluents

(2) These doses are listed in mrad; they are calculated at the site boundary for batch & continuous gaseous effluents (0.4 miles NW)

(3) These doses are listed in mrem; they are calculated for the most likely exposed real individual (child) via all real pathways at 0.89 miles NW.

Limits used for calculation of percent (%) are from ODCM procedure 1/2-ODC-3.03, Attachment H Control 3.11.1.2, Attachment L Control 3.11.2.2, and Attachment M Control 3.11.2.3 (considered to be the design objectives).

Radioactive Effluent Release Report

Calendar Year - 2008

Table 5B

Assessment Of Radiation Doses

		Unit 2 Liquid Effluents									
		1st Quarter		2nd Quarter		3rd Quarter		4th Quarter		Calendar Year	
Batch Releases		Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit
	O R G A N (1)	Bone	7.69E-03	0.1538	1.39E-03	0.0278	6.85E-03	0.1370	1.40E-02	0.2800	2.99E-02
Liver		1.60E-02	0.3200	8.89E-03	0.1778	1.81E-02	0.3620	2.72E-02	0.5430	7.01E-02	0.7014
Total Body		1.02E-02	0.6800	7.66E-03	0.5107	1.07E-02	0.7127	1.75E-02	1.1660	4.60E-02	1.5347
Thyroid		2.32E-03	0.0464	5.92E-03	0.1184	2.61E-03	0.0522	3.05E-03	0.0610	1.39E-02	0.1390
Kidney		8.64E-03	0.1728	7.36E-03	0.1472	1.12E-02	0.2240	1.38E-02	0.2760	4.10E-02	0.4100
Lung		3.33E-03	0.0666	6.08E-03	0.1216	3.21E-03	0.0642	4.89E-03	0.0978	1.75E-02	0.1751
GI-LLI		7.16E-03	0.1432	1.06E-02	0.2120	1.36E-02	0.2720	1.16E-02	0.2310	4.29E-02	0.4291

		Unit 2 Gaseous Effluents									
		1st Quarter		2nd Quarter		3rd Quarter		4th Quarter		Calendar Year	
Batch & Continuous Releases		Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit
	(2)	Gamma Air	2.89E-07	0.0000	1.34E-05	0.0003	1.30E-06	0.0000	0.00E+00	0.0000	1.50E-05
(2)	Beta Air	1.36E-09	0.0000	4.79E-06	0.0000	1.95E-09	0.0000	0.00E+00	0.0000	4.79E-06	0.0000
O R G A N (3)	Bone	0.00E+00	0.0000	3.97E-05	0.0005	0.00E+00	0.0000	0.00E+00	0.0000	3.97E-05	0.0003
	Liver	2.54E-03	0.0339	2.48E-03	0.0331	2.36E-03	0.0315	2.68E-03	0.0357	1.01E-02	0.0671
	Total Body	2.54E-03	0.0339	2.48E-03	0.0331	2.36E-03	0.0315	2.68E-03	0.0357	1.01E-02	0.0671
	Thyroid	2.54E-03	0.0339	2.48E-03	0.0331	2.36E-03	0.0315	2.68E-03	0.0357	1.01E-02	0.0671
	Kidney	2.54E-03	0.0339	2.48E-03	0.0331	2.36E-03	0.0315	2.68E-03	0.0357	1.01E-02	0.0671
	Lung	2.54E-03	0.0339	2.48E-03	0.0331	2.36E-03	0.0315	2.68E-03	0.0357	1.01E-02	0.0671
(3)	GI-LLI	2.54E-03	0.0339	2.48E-03	0.0331	2.36E-03	0.0315	2.68E-03	0.0357	1.01E-02	0.0671

(1) These doses are listed in mrem; they are calculated for the maximum individual for all batch liquid effluents

(2) These doses are listed in mrad; they are calculated at the site boundary for batch & continuous gaseous effluents (0.4 miles NW)

(3) These doses are listed in mrem; they are calculated for the most likely exposed real individual (child) via all real pathways at 0.89 miles NW.

Limits used for calculation of percent (%) are from ODCM procedure 1/2-ODC-3.03, Attachment H Control 3.11.1.2, Attachment L Control 3.11.2.2, and Attachment M Control 3.11.2.3 (considered to be the design objectives).

Beaver Valley Power Station - Units 1 & 2

Enclosure 2, Page 18 of 21

Radioactive Effluent Release Report

Calendar Year - 2008

Table 6

Effluent Monitoring Instrumentation Channels Not Returned To Operable Status Within 30 Days[RM-1DA-100] - Unit 1 Auxiliary Feed Pump Bay Drain Monitor

On 11/16/08 this monitor was removed from service to perform the eighteen (18) month calibration. The installed Model 843-32 detector failed calibration requirements, and several attempts to calibrate new detectors (that were located from old stock and other nuclear power plants) were also unsuccessful. The thirty (30) day criteria was exceeded due to performance of model 843-32 detectors that are no longer manufactured. An upgraded detector (Model 843-32R) was purchased (which required an updated calibration geometry), and subsequent changes were made to applicable engineering documents, calculation packages and procedures. The monitor was calibrated and returned to operable status on 02/05/09. This condition and associated Corrective Actions are detailed in BVPS Condition Report No. CR08-50435, CR08-50765, CR08-50899, CR09-52947, CR09-52964 and BVPS-SAP Order Number 200197646-0700.

As required by ODCM procedure 1/2-ODC-3.03, "Controls for RETS and REMP Programs", (as referenced in procedure Attachment E, Control 3.3.3.9, Table 3.3-12, Action 24), effluent releases via this pathway may continue provided grab samples are analyzed once per 12 hours. However, SINCE this liquid effluent pathway was diverted to the Tunnel Sump / Liquid Radwaste Treatment System on 11/16/08 (and remained diverted until the monitor was returned to operable status on 02/05/09), THEN there were no liquid releases through this effluent pathway. Therefore, grab sampling was not required.

[2RMO-RQ303] - Unit 2 Waste Gas Storage Vault Vent Noble Gas Activity Monitor

On 04/25/08 this monitor was removed from service due to a stuck check source. The thirty (30) day criteria was exceeded due to availability of replacement solenoid, and an apparent misinterpretation of the required due date to return the monitor to Operable status. This condition and associated Corrective Actions are detailed in BVPS Condition Report No. CR09-56073, and BVPS-SAP Order Number 200197646-0800.

As required by ODCM procedure 1/2-ODC-3.03, "Controls for RETS and REMP Programs", (as referenced in procedure Attachment F, Control 3.3.3.10, Table 3.3-13, Action 29), effluent releases via this pathway may continue provided grab samples are taken at least once per 12 hours and analyzed for gross radioactivity within 24 hours. A total of 102 grab samples were obtained and analyzed until the monitor was returned to operable status on 05/29/08. All gamma spectrometry analyses of these samples were less than LLD.

Radioactive Effluent Release Report

Calendar Year - 2008

Table 7

Total Dose Commitments, Total Effective Dose Equivalents and Population Doses

Total Dose Commitment From All Facility Releases To Members of the Public 40 CFR 190.10(a) Environmental Doses				
Organ	(1) Effluent Dose (mrem)	(2) Direct Radiation Dose (mrem)	Total Dose (mrem)	% of ODCM or 40 CFR 190 Limit
Bone	5.99E-02	0.00E+00	5.99E-02	0.24%
Liver	3.29E-01	0.00E+00	3.29E-01	1.32%
Total Body	2.81E-01	0.00E+00	2.81E-01	1.12%
Thyroid	2.17E-01	0.00E+00	2.17E-01	0.29%
Kidney	2.71E-01	0.00E+00	2.71E-01	1.08%
Lung	2.24E-01	0.00E+00	2.24E-01	0.90%
GI-LLI	2.75E-01	0.00E+00	2.75E-01	1.10%

(1) The cumulative dose contributions from liquid and gaseous effluents were determined in accordance with the applicable CONTROLS & SURVEILLANCE REQUIREMENTS listed in ODCM procedure 1/2-ODC-3.03. The dose commitment limits for 40 CFR 190 MEMBERS OF THE PUBLIC (ODCM 1/2-ODC-3.03 Control 3.11.4.1) are as follows:
 a) < or = 25 mrem / calendar year (for the total body, or any organ except the thyroid)
 b) < or = 75 mrem / calendar year (for the thyroid)

(2) The dose contribution listed for the total body is for Direct Radiation. This was calculated by comparing offsite TLD exposure at the ODCM controlling location (0.8 miles NW; Midland, PA) to TLD exposure at the REMP control location (16.5 miles SSW; Weirton, WV).

Compliance to 100 mrem Limit of 10 CFR 20.1301 For Total Effective Dose Equivalent

Pursuant to 10 CFR 20.1301(a)(1), the Total Effective Dose Equivalent from licensed operation to the maximum individual during the report period, is 0.00 mrem. This is a summation of Direct Radiation Exposure (calculated by comparing the maximum of all perimeter TLD exposures to TLD exposure at the REMP control location) plus Effluent Doses (calculated per the ODCM).

Members of the Public Doses Due To Their Activities Inside The Site Boundary

The radiation doses for MEMBER(S) OF THE PUBLIC due to their activities inside the site boundary are not greater than the doses listed in this table to show compliance with 40 CFR Part 190 or 10 CFR 20.1301. Evaluations have shown that exposure time for individuals not occupationally associated with the plant site is minimal in comparison to the exposure time considered for the dose calculation at or beyond the site boundary. Therefore, a separate assessment of radiation doses from radioactive effluents to MEMBER(S) OF THE PUBLIC, due to their activities inside the site boundary, is not necessary for this report period.

0-50 Mile Population Doses From Liquid and Gaseous Effluents

0-50 mile Total Population Dose from liquid and gaseous effluents = 546 man-mrem (Total Body)
 0-50 mile Average Population Dose from liquid and gaseous effluents = 0.0001365 man-mrem (Total Body)

Radioactive Effluent Release Report
Calendar Year - 2008
Table 8

Offsite Dose Calculation Manual Surveillance Deficiencies

Failure to Change-Out Weekly Filter Media on Gaseous Effluent Monitors

ODCM procedure 1/2-ODC-3.03 "Controls for RETS and REMP Programs", Attachment K, Surveillance Requirement 4.11.2.1.2, Table 4.11-2 requires weekly sampling (i.e.; change-out) of the particulate filter paper charcoal cartridge.

Contrary to this requirement, the DRMS filter media (for all five of the continuous gaseous effluent pathways) ran for a 14-day period (04/02/08 - 04/16/08) instead of the required 7-day period (04/02/08 - 04/09/08). SINCE this is a Surveillance Deficiency of ODCM procedure 1/2-ODC-3.03, Attachment K, Surveillance Requirement 4.11.2.1.2, Table 4.11-2, THEN annotation is required in the 2008 Radioactive Effluent Release Report per the reporting requirements of ODCM procedure 1/2-ODC-3.03, Attachment U, Control 6.9.3.

The five continuous gaseous effluent pathways that were not changed-out per the ODCM requirement are as follows:

- 1) VV-2, Unit 2 SLCRS Unfiltered Pathway [2HVS-RQ101]
- 2) CV-2, Unit 2 SLCRS Filtered Pathway [2HVS-RQ109]
- 3) DV-2, Unit 2 Decontamination Building Vent Pathway [2RMQ-RQ301]
- 4) WV-2, Unit 2 Waste Gas storage Vault Vent Pathway [2RMQ-RQ303]
- 5) CB-2, Unit 2 Condensate Polishing Building Vent Pathway [2HVL-RQ112]

There were no consequences to the health and safety of the public by failing to obtain the samples on the required date. Specifically, no samples were lost, and a follow-up review of the sample analyses provided assurance that the effluent activity of the short-lived radionuclide of interest (e.g.; I-131 with half-life = 8.04 days) was not underestimated as a result of exceeding the normal sample period. This condition and associated Corrective Actions are detailed in BVPS Condition Report No. CR08-38484, and BVPS-SAP Order Number 200197646-0500.

Failure to Obtain a Grab Sample From an Inoperable Gaseous Effluent Monitor

ODCM procedure 1/2-ODC-3.03 "Controls for RETS and REMP Programs", Attachment F, Control 3.3.3.10, Table 3.3-13, Action 29 requires that effluent releases may continue via this pathway provided grab samples are taken at least once per 12 hours.

Contrary to this requirement, a grab sample for the radiation monitor on Unit 2 Condensate Polishing Building Vent Pathway [2HVL-RQ112] was missed during the inoperable period. The timeline of the condition indicated that on 10/23/08 the monitor was declared inoperable and the required once per shift grab samples were initiated. On 11/06/08 at 1610 hours the monitor was prematurely declared operable following repair, valve line-ups and set point verifications and the ODCM actions listed above were prematurely exited. On 11/07/08 at 0430 hours it was noted that the operations surveillance associated with the monitor was overdue, and the monitor was again declared inoperable. In summary, since the monitor had been prematurely declared operable, then there was a failure to obtain a grab sample during an inoperable period.

Sampling resumed until the monitor was properly returned to operable status on 11/07/08. This condition and associated Corrective Actions are detailed in BVPS Condition Report No. CR08-49089, and BVPS-SAP Order Number 200197646-0680.

Radioactive Effluent Release Report

Calendar Year - 2008

Table 9

Unit 1 and 2 Offsite Dose Calculation Manual Changes (Description)

There were no changes made to the
Unit 1 and 2 Offsite Dose Calculation Manual
during this report period.

Beaver Valley Power Station - Units 1 & 2

Radioactive Effluent Release Report

Calendar Year - 2008
 Attachment 1
 Joint Frequency Distribution Tables

Attachment 1

As specified in the ODCM, an annual summary of hourly meteorological data (in the form of joint frequency distribution) is provided for the calendar year. In summary the joint frequency distributions for 2008 are similar to recent years. During 2008 there was a slight shift towards more unstable and correspondingly less neutral hours than in recent years. This was probably caused by a combination of normal year-to-year variation and a change in the nature of the ground around the tower from weeds and grass in previous years to just dirt in 2008. It should be returned to a more natural state in 2009.

Meteorological Data Recovery

The Meteorological Data Recovery for the calendar year met the minimum requirement of at-least 90% (as specified in Section 5 of Revision 1 to Regulatory Guide 1.23, Meteorological Monitoring Programs for Nuclear Power Plants). The actual Meteorological Data Recovery is shown in the following table:

PERCENT RECOVERY OF INDIVIDUAL METEOROLOGICAL PARAMETERS
99.5% = Wind Speed 35'
99.5% = Wind Speed 150'
97.6% = Wind Speed 500'
99.5% = Wind Direction 35'
99.5% = Wind Direction 150'
96.0% = Wind Direction 500'
99.5% = Delta Temperature (150' - 35') 1P
99.5% = Delta Temperature (500' - 35') 2P
99.5% = Temperature 35'
99.5% = Precipitation
99% = Average Recovery of Individual Meteorological Parameters
PERCENT RECOVERY OF COMPOSITE VARIABLES
99.5% = Wind Speed 35', Wind Direction 35', Delta Temperature 1P
99.5% = Wind Speed 150', Wind Direction 150', Delta Temperature 1P
97.7% = Wind Speed 500', Wind Direction 500', Delta Temperature 2P
99.2% = Average Recovery of Composite Variables

Attachment 1 Clarification

Hourly meteorological data is not provided for specific periods of Abnormal Gaseous Release during the calendar quarters (as indicated in Regulatory Guide 1.21), for the following reasons:

- 1) All routine Gaseous Releases for the calendar year were determined to be within design objectives, where as, the ODCM Dose Limits and the ODCM Dose Rate Limits are considered to be the design objectives.
- 2) There were no Abnormal Gaseous Releases during the calendar year.

For a copy of the hourly meteorological data during the calendar quarters, contact Ms. Jennifer Powell-Campbell at 724-682-4209.

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 1: Joint Frequency Distribution Tables (35ft)

Page 1 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record =

1/1/2008 00:00 - 12/31/2008 23:00

Elevation: Speed: SP35P

Direction: DI35P

Lapse: DT150-35

Stability Class A

Delta Temperature Extremely Unstable

Wind Speed (mph)

<u>Wind Direction</u>	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	<u>Total</u>
N	17	49	0	0	0	0	66
NNE	22	39	0	0	0	0	61
NE	15	20	0	0	0	0	35
ENE	19	36	0	0	0	0	55
E	6	23	0	0	0	0	29
ESE	18	33	0	0	0	0	51
SE	19	23	0	0	0	0	42
SSE	9	15	0	0	0	0	24
S	7	18	1	0	0	0	26
SSW	5	41	7	1	0	0	54
SW	14	73	30	1	0	0	118
WSW	21	139	40	3	0	0	203
W	20	182	33	1	0	0	236
WNW	24	101	21	3	0	0	149
NW	17	61	5	1	0	0	84
NNW	22	50	1	0	0	0	73
Total	255	903	138	10	0	0	1306

Calm Hours not Included above for :

Total Period

16

Variable Direction Hours for:

Total Period

0

Invalid Hours for:

Total Period

45

Valid Hours for this Stability Class for:

Total Period

1306

Total Hours for Period

8784

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 1: Joint Frequency Distribution Tables (35ft)

Page 2 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record =

1/1/2008 00:00 - 12/31/2008 23:00

Elevation: Speed: SP35P

Direction: DI35P

Lapse: DT150-35

Stability Class B

Delta Temperature Moderately Unstable

Wind Speed (mph)

Wind Direction	1 - 4	4 - 8	8 - 13	13 - 19	19 - 25	≥ 25	Total
N	2	8	0	0	0	0	10
NNE	7	5	0	0	0	0	12
NE	10	4	0	0	0	0	14
ENE	5	2	0	0	0	0	7
E	7	4	0	0	0	0	11
ESE	4	2	0	0	0	0	6
SE	1	1	0	0	0	0	2
SSE	3	0	0	0	0	0	3
S	2	2	0	0	0	0	4
SSW	3	1	1	0	0	0	5
SW	3	8	7	0	0	0	18
WSW	6	13	8	1	0	0	28
W	7	17	14	0	0	0	38
WNW	4	21	5	1	0	0	31
NW	7	15	1	0	0	0	23
NNW	6	17	0	0	0	0	23
Total	77	120	36	2	0	0	235

Calm Hours not Included above for :

Total Period

16

Variable Direction Hours for:

Total Period

0

Invalid Hours for:

Total Period

45

Valid Hours for this Stability Class for:

Total Period

235

Total Hours for Period

8784

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 1: Joint Frequency Distribution Tables (35ft)

Page 3 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record = 1/1/2008 00:00 - 12/31/2008 23:00
 Elevation: Speed: SP35P Direction: DI35P Lapse: DT150-35
 Stability Class C Delta Temperature Slightly Unstable

Wind Speed (mph)

<u>Wind Direction</u>	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>> 25</u>	<u>Total</u>
N	11	13	0	0	0	0	24
NNE	5	3	0	0	0	0	8
NE	12	3	0	0	0	0	15
ENE	12	4	0	0	0	0	16
E	3	3	0	0	0	0	6
ESE	5	1	0	0	0	0	6
SE	3	1	0	0	0	0	4
SSE	0	0	0	0	0	0	0
S	2	4	0	0	0	0	6
SSW	2	6	3	0	0	0	11
SW	4	14	6	0	0	0	24
WSW	12	20	3	1	0	0	36
W	12	16	13	0	0	0	41
WNW	7	12	6	0	0	0	25
NW	6	14	2	0	0	0	22
NNW	8	10	0	0	0	0	18
Total	104	124	33	1	0	0	262

Calm Hours not Included above for :	Total Period	16
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	45
Valid Hours for this Stability Class for:	Total Period	262
Total Hours for Period		8784

Enclosure 2, Attachment 1 (Part 1 of 3)

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 1: Joint Frequency Distribution Tables (35ft)

Page 4 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record = 1/1/2008 00:00 - 12/31/2008 23:00
 Elevation: Speed: SP35P Direction: DI35P Lapse: DT150-35
 Stability Class D Delta Temperature Neutral

Wind Speed (mph)

<u>Wind Direction</u>	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	<u>Total</u>
N	69	57	0	0	0	0	126
NNE	105	21	0	0	0	0	126
NE	89	16	0	0	0	0	105
ENE	112	60	0	0	0	0	172
E	76	30	0	0	0	0	106
ESE	30	4	0	0	0	0	34
SE	37	6	0	0	0	0	43
SSE	35	13	0	0	0	0	48
S	30	36	2	0	0	0	68
SSW	54	58	21	0	0	0	133
SW	58	175	108	4	1	0	346
WSW	70	221	135	21	2	0	449
W	70	270	126	11	0	0	477
WNW	75	177	24	0	0	0	276
NW	102	140	10	0	0	0	252
NNW	69	83	3	0	0	0	155
Total	1081	1367	429	36	3	0	2916

Calm Hours not Included above for :	Total Period	16
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	45
Valid Hours for this Stability Class for:	Total Period	2916
Total Hours for Period		8784

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 1: Joint Frequency Distribution Tables (35ft)

Page 5 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record =

1/1/2008 00:00 - 12/31/2008 23:00

Elevation: Speed: SP35P

Direction: DI35P

Lapse: DT150-35

Stability Class E

Delta Temperature Slightly Stable

Wind Speed (mph)

<u>Wind Direction</u>	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>> 25</u>	<u>Total</u>
N	49	14	0	0	0	0	63
NNE	66	5	0	0	0	0	71
NE	131	12	0	0	0	0	143
ENE	161	52	0	0	0	0	213
E	135	14	0	0	0	0	149
ESE	89	2	0	0	0	0	91
SE	117	1	0	0	0	0	118
SSE	98	14	0	0	0	0	112
S	173	60	8	0	0	0	241
SSW	156	109	13	2	0	0	280
SW	84	93	21	2	0	0	200
WSW	44	51	30	4	0	0	129
W	46	46	24	1	0	0	117
WNW	44	29	2	0	0	0	75
NW	72	25	0	0	0	0	97
NNW	57	7	0	0	0	0	64
Total	1522	534	98	9	0	0	2163

Calm Hours not Included above for :

Total Period 16

Variable Direction Hours for:

Total Period 0

Invalid Hours for:

Total Period 45

Valid Hours for this Stability Class for:

Total Period 2163

Total Hours for Period

8784

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 1: Joint Frequency Distribution Tables (35ft)

Page 6 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record = 1/1/2008 00:00 - 12/31/2008 23:00
 Elevation: Speed: SP35P Direction: DI35P Lapse: DT150-35
 Stability Class F Delta Temperature Moderately Stable

Wind Speed (mph)

Wind Direction	1 - 4	4 - 8	8 - 13	13 - 19	19 - 25	> 25	Total
N	10	0	0	0	0	0	10
NNE	19	1	0	0	0	0	20
NE	40	2	0	0	0	0	42
ENE	51	0	0	0	0	0	51
E	104	0	0	0	0	0	104
ESE	180	0	0	0	0	0	180
SE	243	0	0	0	0	0	243
SSE	174	0	0	0	0	0	174
S	126	7	0	0	0	0	133
SSW	69	14	0	0	0	0	83
SW	35	0	1	0	0	0	36
WSW	13	0	1	0	0	0	14
W	6	3	5	0	0	0	14
WNW	9	0	0	0	0	0	9
NW	11	1	0	0	0	0	12
NNW	9	1	0	0	0	0	10
Total	1099	29	7	0	0	0	1135

Calm Hours not Included above for :	Total Period	16
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	45
Valid Hours for this Stability Class for:	Total Period	1135
Total Hours for Period		8784

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 1: Joint Frequency Distribution Tables (35ft)

Page 7 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record =

1/1/2008 00:00 - 12/31/2008 23:00

Elevation: Speed: SP35P

Direction: DI35P

Lapse: DT150-35

Stability Class G

Delta Temperature Extremely Stable

Wind Speed (mph)

<u>Wind Direction</u>	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	<u>Total</u>
N	7	0	0	0	0	0	7
NNE	10	1	0	0	0	0	11
NE	11	0	0	0	0	0	11
ENE	29	0	0	0	0	0	29
E	69	1	0	0	0	0	70
ESE	134	0	0	0	0	0	134
SE	243	0	0	0	0	0	243
SSE	83	0	0	0	0	0	83
S	50	2	0	0	0	0	52
SSW	28	1	0	0	0	0	29
SW	10	1	0	0	0	0	11
WSW	13	0	0	0	0	0	13
W	1	0	0	0	0	0	1
WNW	2	0	0	0	0	0	2
NW	7	0	0	0	0	0	7
NNW	3	0	0	0	0	0	3
Total	700	6	0	0	0	0	706

Calm Hours not Included above for :

Total Period

16

Variable Direction Hours for:

Total Period

0

Invalid Hours for:

Total Period

45

Valid Hours for this Stability Class for:

Total Period

706

Total Hours for Period

8784

Enclosure 2, Attachment 1 (Part 1 of 3)

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 1: Joint Frequency Distribution Tables (35ft)

Page 8 of 8

Hours at Each Wind Speed and Direction

Summary of All Stability Classes

Total Period

Period of Record =

1/1/2008 00:00 - 12/31/2008 23:00

Elevation: Speed: SP35P

Direction: DI35P

Lapse: DT150-35

Delta Temperature

Wind Speed (mph)

<u>Wind Direction</u>	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	<u>Total</u>
N	165	141	0	0	0	0	306
NNE	234	75	0	0	0	0	309
NE	308	57	0	0	0	0	365
ENE	389	154	0	0	0	0	543
E	400	75	0	0	0	0	475
ESE	460	42	0	0	0	0	502
SE	663	32	0	0	0	0	695
SSE	402	42	0	0	0	0	444
S	390	129	11	0	0	0	530
SSW	317	230	45	3	0	0	595
SW	208	364	173	7	1	0	753
WSW	179	444	217	30	2	0	872
W	162	534	215	13	0	0	924
WNW	165	340	58	4	0	0	567
NW	222	256	18	1	0	0	497
NNW	174	168	4	0	0	0	346
Total	4838	3083	741	58	3	0	8723

Calm Hours not Included above for :

Total Period 16

Variable Direction Hours for:

Total Period 0

Invalid Hours for:

Total Period 45

Valid Hours for this Stability Class for:

Total Period 8723

Total Hours for Period

8784

Enclosure 2, Attachment 1 (Part 2 of 3)

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 2: Joint Frequency Distribution Tables (150ft)

Page 1 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record =

1/1/2008 00:00 - 12/31/2008 23:00

Elevation: Speed: SP150P

Direction: DI150P

Lapse: DT150-35

Stability Class A

Delta Temperature Extremely Unstable

Wind Speed (mph)

<u>Wind Direction</u>	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	<u>Total</u>
N	6	42	34	0	0	0	82
NNE	5	29	22	2	0	0	58
NE	5	18	6	1	0	0	30
ENE	2	30	23	0	0	0	55
E	0	28	16	0	0	0	44
ESE	1	17	24	3	0	0	45
SE	3	19	31	5	0	0	58
SSE	0	12	10	2	0	0	24
S	1	11	35	2	0	0	49
SSW	1	9	32	6	2	0	50
SW	9	20	48	11	1	0	89
WSW	14	40	65	10	2	0	131
W	14	92	115	48	10	3	282
WNW	9	55	65	45	3	1	178
NW	11	34	27	3	0	0	75
NNW	2	30	24	0	0	0	56
Total	83	486	577	138	18	4	1306

Calm Hours not Included above for :

Total Period 3

Variable Direction Hours for:

Total Period 0

Invalid Hours for:

Total Period 45

Valid Hours for this Stability Class for:

Total Period 1306

Total Hours for Period

8784

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 2: Joint Frequency Distribution Tables (150ft)

Page 2 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record = 1/1/2008 00:00 - 12/31/2008 23:00
 Elevation: Speed: SP150P Direction: DI150P Lapse: DT150-35
 Stability Class B Delta Temperature Moderately Unstable

Wind Speed (mph)

Wind Direction	1 - 4	4 - 8	8 - 13	13 - 19	19 - 25	≥ 25	Total
N	1	10	3	0	0	0	14
NNE	1	9	2	0	0	0	12
NE	1	5	1	0	0	0	7
ENE	0	10	3	1	0	0	14
E	1	5	2	1	0	0	9
ESE	1	3	2	0	0	0	6
SE	3	5	0	0	0	0	8
SSE	0	1	0	0	0	0	1
S	0	3	1	0	0	0	4
SSW	1	4	2	1	0	0	8
SW	3	3	6	3	0	0	15
WSW	4	5	6	2	1	0	18
W	1	10	12	17	7	0	47
WNW	2	7	13	10	1	0	33
NW	4	8	8	0	0	0	20
NNW	2	8	9	0	0	0	19
Total	25	96	70	35	9	0	235

Calm Hours not Included above for :	Total Period	3
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	45
Valid Hours for this Stability Class for:	Total Period	235
Total Hours for Period		8784

Beaver Valley Power Station – Units 1 & 2
Radioactive Effluent Release Report
 Calendar Year – 2008
 Attachment 1

Part 2: Joint Frequency Distribution Tables (150ft)
 Page 3 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record = 1/1/2008 00:00 - 12/31/2008 23:00
 Elevation: Speed: SP150P Direction: DI150P Lapse: DT150-35
 Stability Class C Delta Temperature Slightly Unstable

Wind Speed (mph)

<u>Wind Direction</u>	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	<u>Total</u>
N	2	9	9	0	0	0	20
NNE	2	9	3	0	0	0	14
NE	1	8	1	0	0	0	10
ENE	1	10	4	1	0	0	16
E	0	6	1	0	0	0	7
ESE	0	3	1	1	0	0	5
SE	0	6	1	0	0	0	7
SSE	1	1	2	0	0	0	4
S	0	1	7	0	0	0	8
SSW	1	6	5	1	0	0	13
SW	0	4	10	3	0	0	17
WSW	4	7	7	0	1	0	19
W	9	17	14	17	2	0	59
WNW	2	12	10	6	0	0	30
NW	1	8	8	1	0	0	18
NNW	2	8	5	0	0	0	15
Total	26	115	88	30	3	0	262

Calm Hours not Included above for :	Total Period	3
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	45
Valid Hours for this Stability Class for:	Total Period	262
Total Hours for Period		8784

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 2: Joint Frequency Distribution Tables (150ft)

Page 4 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record = 1/1/2008 00:00 - 12/31/2008 23:00
 Elevation: Speed: SP150P Direction: DI150P Lapse: DT150-35
 Stability Class D Delta Temperature Neutral

Wind Speed (mph)

<u>Wind Direction</u>	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	<u>Total</u>
N	36	82	25	0	0	0	143
NNE	33	63	20	1	0	0	117
NE	38	44	7	0	0	0	89
ENE	22	107	48	4	0	0	181
E	19	57	15	0	0	0	91
ESE	12	28	8	0	0	0	48
SE	16	26	8	0	0	0	50
SSE	9	24	14	0	0	0	47
S	12	38	38	3	0	0	91
SSW	7	36	60	12	0	0	115
SW	25	83	121	36	2	1	268
WSW	28	80	160	65	15	3	351
W	37	86	280	184	47	6	640
WNW	30	114	156	56	4	0	360
NW	27	92	53	6	0	0	178
NNW	30	88	27	2	0	0	147
Total	381	1048	1040	369	68	10	2916

Calm Hours not Included above for :	Total Period	3
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	45
Valid Hours for this Stability Class for:	Total Period	2916
Total Hours for Period		8784

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 2: Joint Frequency Distribution Tables (150ft)

Page 5 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record = 1/1/2008 00:00 - 12/31/2008 23:00
 Elevation: Speed: SP150P Direction: DI150P Lapse: DT150-35
 Stability Class E Delta Temperature Slightly Stable

Wind Speed (mph)

<u>Wind Direction</u>	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	<u>Total</u>
N	38	29	7	0	0	0	74
NNE	57	32	4	0	0	0	93
NE	76	77	3	0	0	0	156
ENE	61	141	40	1	0	0	243
E	46	51	18	0	0	0	115
ESE	19	29	12	0	0	0	60
SE	27	30	5	0	0	0	62
SSE	26	35	12	0	0	0	73
S	34	69	70	12	0	0	185
SSW	52	99	76	9	3	0	239
SW	71	75	71	9	2	0	228
WSW	47	58	39	11	3	0	158
W	28	65	39	42	7	2	183
WNW	18	94	45	4	0	0	161
NW	17	43	5	0	0	0	65
NNW	27	43	4	0	0	0	74
Total	644	970	450	88	15	2	2169

Calm Hours not Included above for :	Total Period	3
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	45
Valid Hours for this Stability Class for:	Total Period	2169
Total Hours for Period		8784

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 2: Joint Frequency Distribution Tables (150ft)

Page 6 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record =

1/1/2008 00:00 - 12/31/2008 23:00

Elevation: Speed: SP150P

Direction: DI150P

Lapse: DT150-35

Stability Class F

Delta Temperature Moderately Stable

Wind Speed (mph)

Wind Direction	1 - 4	4 - 8	8 - 13	13 - 19	19 - 25	≥ 25	Total
N	77	13	0	0	0	0	90
NNE	114	18	1	0	0	0	133
NE	112	55	0	0	0	0	167
ENE	56	54	10	0	0	0	120
E	26	17	0	0	0	0	43
ESE	12	13	1	0	0	0	26
SE	12	4	1	0	0	0	17
SSE	14	12	3	0	0	0	29
S	28	21	4	0	0	0	53
SSW	57	43	7	0	0	0	107
SW	86	49	10	1	0	0	146
WSW	48	26	1	0	0	0	75
W	23	15	1	4	2	0	45
WNW	12	17	1	0	0	0	30
NW	18	5	1	0	0	0	24
NNW	28	5	1	0	0	0	34
Total	723	367	42	5	2	0	1139

Calm Hours not Included above for :

Total Period 3

Variable Direction Hours for:

Total Period 0

Invalid Hours for:

Total Period 45

Valid Hours for this Stability Class for:

Total Period 1139

Total Hours for Period

8784

Beaver Valley Power Station - Units 1 & 2

Radioactive Effluent Release Report

Calendar Year - 2008

Attachment 1

Part 2: Joint Frequency Distribution Tables (150ft)

Page 7 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record =

1/1/2008 00:00 - 12/31/2008 23:00

Elevation: Speed: SP150P

Direction: DI150P

Lapse: DT150-35

Stability Class G

Delta Temperature Extremely Stable

Wind Speed (mph)

<u>Wind Direction</u>	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>> 25</u>	<u>Total</u>
N	32	3	0	0	0	0	35
NNE	93	38	0	0	0	0	131
NE	77	39	1	0	0	0	117
ENE	25	39	2	0	0	0	66
E	18	11	0	0	0	0	29
ESE	13	9	0	0	0	0	22
SE	10	4	0	0	0	0	14
SSE	6	12	0	0	0	0	18
S	11	26	2	0	0	0	39
SSW	39	40	5	0	0	0	84
SW	52	17	1	0	0	0	70
WSW	18	9	1	0	0	0	28
W	11	3	1	0	0	0	15
WNW	12	2	0	0	0	0	14
NW	15	4	0	0	0	0	19
NNW	7	1	0	0	0	0	8
Total	439	257	13	0	0	0	709

Calm Hours not Included above for :

Total Period 3

Variable Direction Hours for:

Total Period 0

Invalid Hours for:

Total Period 45

Valid Hours for this Stability Class for:

Total Period 709

Total Hours for Period

8784

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 2: Joint Frequency Distribution Tables (150ft)

Page 8 of 8

Hours at Each Wind Speed and Direction

Summary of All Stability Classes

Total Period

Period of Record =

1/1/2008 00:00 - 12/31/2008 23:00

Elevation: Speed: SP150P

Direction: DI150P

Lapse: DT150-35

Delta Temperature

Wind Speed (mph)

Wind Direction	1 - 4	4 - 8	8 - 13	13 - 19	19 - 25	≥ 25	Total
N	192	188	78	0	0	0	458
NNE	305	198	52	3	0	0	558
NE	310	246	19	1	0	0	576
ENE	167	391	130	7	0	0	695
E	110	175	52	1	0	0	338
ESE	58	102	48	4	0	0	212
SE	71	94	46	5	0	0	216
SSE	56	97	41	2	0	0	196
S	86	169	157	17	0	0	429
SSW	158	237	187	29	5	0	616
SW	246	251	267	63	5	1	833
WSW	163	225	279	88	22	3	780
W	123	288	462	312	75	11	1271
WNW	85	301	290	121	8	1	806
NW	93	194	102	10	0	0	399
NNW	98	183	70	2	0	0	353
Total	2321	3339	2280	665	115	16	8736

Calm Hours not Included above for :

Total Period 3

Variable Direction Hours for:

Total Period 0

Invalid Hours for:

Total Period 45

Valid Hours for this Stability Class for:

Total Period 8736

Total Hours for Period

8784

Enclosure 2, Attachment 1 (Part 3 of 3)

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 3: Joint Frequency Distribution Tables (500ft)

Page 1 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record = 1/1/2008 00:00 - 12/31/2008 23:00
 Elevation: Speed: SP500P Direction: DI500P Lapse: DT500-35
 Stability Class A Delta Temperature Extremely Unstable

Wind Speed (mph)

<u>Wind Direction</u>	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	<u>Total</u>
N	0	1	5	0	0	0	6
NNE	0	1	3	0	0	0	4
NE	0	1	3	0	0	0	4
ENE	0	2	2	0	0	0	4
E	0	0	3	0	0	0	3
ESE	0	0	7	0	0	0	7
SE	0	1	5	7	0	0	13
SSE	0	0	2	1	0	0	3
S	0	0	6	0	0	0	6
SSW	0	1	1	0	0	0	2
SW	0	2	1	0	0	0	3
WSW	0	0	1	0	0	0	1
W	0	3	3	2	1	0	9
WNW	0	5	4	3	3	0	15
NW	0	1	1	0	1	0	3
NNW	0	0	2	0	0	0	2
Total	0	18	49	13	5	0	85

Calm Hours not Included above for :	Total Period	4
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	522
Valid Hours for this Stability Class for:	Total Period	85
Total Hours for Period		8784

Enclosure 2, Attachment 1 (Part 3 of 3)

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 3: Joint Frequency Distribution Tables (500ft)

Page 2 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record =

1/1/2008 00:00 - 12/31/2008 23:00

Elevation: Speed: SP500P

Direction: DI500P

Lapse: DT500-35

Stability Class B

Delta Temperature Moderately Unstable

Wind Speed (mph)

<u>Wind Direction</u>	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	<u>Total</u>
N	0	2	8	0	0	0	10
NNE	0	1	3	0	0	0	4
NE	0	1	2	0	0	0	3
ENE	0	1	3	2	0	0	6
E	0	1	4	0	0	0	5
ESE	0	0	5	3	0	0	8
SE	0	0	7	2	1	0	10
SSE	0	0	1	2	0	0	3
S	0	0	1	0	0	0	1
SSW	0	0	1	3	0	0	4
SW	0	0	4	3	0	0	7
WSW	0	0	3	2	0	0	5
W	1	2	10	1	2	0	16
WNW	0	2	9	8	5	1	25
NW	0	2	6	2	0	0	10
NNW	0	2	5	1	0	0	8
Total	1	14	72	29	8	1	125

Calm Hours not Included above for :

Total Period 4

Variable Direction Hours for:

Total Period 0

Invalid Hours for:

Total Period 522

Valid Hours for this Stability Class for:

Total Period 125

Total Hours for Period

8784

Enclosure 2, Attachment 1 (Part 3 of 3)

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 3: Joint Frequency Distribution Tables (500ft)

Page 3 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record = 1/1/2008 00:00 - 12/31/2008 23:00
 Elevation: Speed: SP500P Direction: DI500P Lapse: DT500-35
 Stability Class C Delta Temperature Slightly Unstable

Wind Speed (mph)

<u>Wind Direction</u>	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	<u>Total</u>
N	0	3	13	3	0	0	19
NNE	0	2	5	1	0	0	8
NE	1	1	1	0	0	0	3
ENE	0	6	5	1	0	0	12
E	0	2	4	2	0	0	8
ESE	0	5	4	2	0	0	11
SE	0	1	6	2	1	0	10
SSE	0	1	2	0	0	0	3
S	0	0	0	3	0	0	3
SSW	0	1	9	2	2	0	14
SW	0	4	9	6	1	0	20
WSW	0	2	13	9	5	0	29
W	1	11	17	5	3	2	39
WNW	2	8	14	7	7	0	38
NW	0	3	7	2	0	0	12
NNW	0	1	4	1	0	0	6
Total	4	51	113	46	19	2	235

Calm Hours not Included above for :	Total Period	4
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	522
Valid Hours for this Stability Class for:	Total Period	235
Total Hours for Period		8784

Enclosure 2, Attachment 1 (Part 3 of 3)

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 3: Joint Frequency Distribution Tables (500ft)

Page 4 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record =

1/1/2008 00:00 - 12/31/2008 23:00

Elevation: Speed: SP500P

Direction: DI500P

Lapse: DT500-35

Stability Class D

Delta Temperature Neutral

Wind Speed (mph)

<u>Wind Direction</u>	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	<u>Total</u>
N	14	82	152	33	0	0	281
NNE	17	53	26	22	1	0	119
NE	17	42	19	11	1	0	90
ENE	15	46	54	35	3	0	153
E	14	71	105	18	1	0	209
ESE	15	81	85	33	4	0	218
SE	6	43	68	22	2	0	141
SSE	7	19	55	21	1	0	103
S	5	22	67	55	13	4	166
SSW	11	26	76	117	31	7	268
SW	10	34	146	216	53	6	465
WSW	14	52	133	196	52	38	485
W	19	67	220	343	203	62	914
WNW	10	48	205	216	61	23	563
NW	9	32	140	75	7	0	263
NNW	11	47	151	25	1	0	235
Total	194	765	1702	1438	434	140	4673

Calm Hours not Included above for :

Total Period 4

Variable Direction Hours for:

Total Period 0

Invalid Hours for:

Total Period 522

Valid Hours for this Stability Class for:

Total Period 4673

Total Hours for Period

8784

Enclosure 2, Attachment 1 (Part 3 of 3)

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 3: Joint Frequency Distribution Tables (500ft)

Page 5 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record = 1/1/2008 00:00 - 12/31/2008 23:00
 Elevation: Speed: SP500P Direction: DI500P Lapse: DT500-35
 Stability Class E Delta Temperature Slightly Stable

Wind Speed (mph)

<u>Wind Direction</u>	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	<u>Total</u>
N	15	16	29	14	1	0	75
NNE	13	19	18	8	0	0	58
NE	24	25	16	2	0	0	67
ENE	13	32	47	6	1	0	99
E	23	40	56	10	0	0	129
ESE	33	39	40	10	2	0	124
SE	29	30	44	25	7	1	136
SSE	16	24	39	15	8	1	103
S	21	26	50	68	25	3	193
SSW	11	12	58	86	33	6	206
SW	29	30	53	112	33	3	260
WSW	39	58	36	21	5	1	160
W	44	79	91	36	8	7	265
WNW	24	48	44	9	0	2	127
NW	24	19	26	6	0	0	75
NNW	14	22	17	8	0	0	61
Total	372	519	664	436	123	24	2138

Calm Hours not Included above for :	Total Period	4
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	522
Valid Hours for this Stability Class for:	Total Period	2138
Total Hours for Period		8784

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 3: Joint Frequency Distribution Tables (500ft)

Page 6 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record =

1/1/2008 00:00 - 12/31/2008 23:00

Elevation: Speed: SP500P

Direction: DI500P

Lapse: DT500-35

Stability Class F

Delta Temperature Moderately Stable

Wind Speed (mph)

Wind Direction	1 - 4	4 - 8	8 - 13	13 - 19	19 - 25	≥ 25	Total
N	10	4	6	2	0	0	22
NNE	8	9	2	0	0	0	19
NE	18	18	2	0	0	0	38
ENE	13	49	24	3	0	0	89
E	13	44	20	0	0	0	77
ESE	19	40	12	0	0	0	71
SE	18	31	11	5	0	0	65
SSE	19	29	11	6	0	0	65
S	16	20	42	20	0	0	98
SSW	15	20	24	21	1	0	81
SW	21	21	20	23	4	1	90
WSW	20	37	10	2	0	0	69
W	18	23	17	2	0	0	60
WNW	16	26	7	1	0	0	50
NW	12	7	4	1	0	0	24
NNW	6	3	1	0	0	0	10
Total	242	381	213	86	5	1	928

Calm Hours not Included above for :

Total Period 4

Variable Direction Hours for:

Total Period 0

Invalid Hours for:

Total Period 522

Valid Hours for this Stability Class for:

Total Period 928

Total Hours for Period

8784

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 3: Joint Frequency Distribution Tables (500ft)

Page 7 of 8

Hours at Each Wind Speed and Direction

Total Period

Period of Record = 1/1/2008 00:00 - 12/31/2008 23:00
 Elevation: Speed: SP500P Direction: DI500P Lapse: DT500-35
 Stability Class G Delta Temperature Extremely Stable

Wind Speed (mph)

<u>Wind Direction</u>	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	<u>Total</u>
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	1	0	0	0	0	0	1
ENE	0	0	0	0	0	0	0
E	1	4	0	0	0	0	5
ESE	2	3	1	0	0	0	6
SE	1	6	1	0	0	0	8
SSE	3	2	0	1	0	0	6
S	4	7	5	2	0	0	18
SSW	3	4	5	6	0	0	18
SW	3	0	1	0	0	0	4
WSW	2	1	0	0	0	0	3
W	2	1	0	0	0	0	3
WNW	1	1	0	0	0	0	2
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Total	23	29	13	9	0	0	74

Calm Hours not Included above for :	Total Period	4
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	522
Valid Hours for this Stability Class for:	Total Period	74
Total Hours for Period		8784

Beaver Valley Power Station – Units 1 & 2

Radioactive Effluent Release Report

Calendar Year – 2008

Attachment 1

Part 3: Joint Frequency Distribution Tables (500ft)

Page 8 of 8

Hours at Each Wind Speed and Direction

Summary of All Stability Classes

Total Period

Period of Record =

1/1/2008 00:00 - 12/31/2008 23:00

Elevation: Speed: SP500P

Direction: DI500P

Lapse: DT500-35

Delta Temperature

Wind Speed (mph)

<u>Wind Direction</u>	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>> 25</u>	<u>Total</u>
N	39	108	213	52	1	0	413
NNE	38	85	57	31	1	0	212
NE	61	88	43	13	1	0	206
ENE	41	136	135	47	4	0	363
E	51	162	192	30	1	0	436
ESE	69	168	154	48	6	0	445
SE	54	112	142	63	11	1	383
SSE	45	75	110	46	9	1	286
S	46	75	171	148	38	7	485
SSW	40	64	174	235	67	13	593
SW	63	91	234	360	91	10	849
WSW	75	150	196	230	62	39	752
W	85	186	358	389	217	71	1306
WNW	53	138	283	244	76	26	820
NW	45	64	184	86	8	0	387
NNW	31	75	180	35	1	0	322
Total	836	1777	2826	2057	594	168	8258

Calm Hours not Included above for :

Total Period 4

Variable Direction Hours for:

Total Period 0

Invalid Hours for:

Total Period 522

Valid Hours for this Stability Class for:

Total Period 8258

Total Hours for Period

8784

Beaver Valley Power Station - Units 1 & 2

2008 Annual Radiological Environmental Operating Report

FirstEnergy Nuclear Operating Company
FENOC

Beaver Valley Power Station - Units 1 & 2
Unit 1 License No. DPR-66
Unit 2 License No. NPF-73

SECTION 1 - INTRODUCTION

A. Radiation Fundamentals

Radiation is the conveyance of energy through space. For example, heat emanating from a stove is a form of radiation, as are light rays, microwaves, and radio waves. All matter consists of atoms, which are comprised of positively charged particles (protons), negatively charged particles (electrons), and non-charged/neutral particles (neutrons). The relatively large particles (protons and neutrons) are packed tightly together in a cluster at the center of the atom called the nucleus, while the smaller particles (electrons) orbit around the nucleus. In an electrically neutral atom, the negative charges of the electrons are balanced by the positive charges of the protons. Due to their dissimilar charges, the protons and electrons have a strong attraction for each other. This holds the atom together. Other attractive forces between the protons and neutrons keep the densely packed protons from repelling each other, and prevent the nucleus from breaking apart.

B. Radiation and Radioactivity

The following provides an alphabetical glossary of terms associated with radiation, radioactivity, and the radioactive decay process. The terms discussed include Alpha Particles, Beta Particles, Gamma Rays, Genetic Effects, Half-life, Ionization, Isotopes, Neutrons, Radiation, Radioactive Decay, Radionuclides and Somatic Effects.

Alpha Particles: Particulate and electromagnetic radiation each travel through matter differently because of their different properties. Alpha particles contain 2 protons and 2 neutrons, are relatively large, and carry an electrical charge of +2. Alpha particles are ejected from the nucleus of a radioactive atom at speeds ranging from 2,000 to 20,000 miles per second. However, due to its comparatively large size, an alpha particle usually does not travel very far before it loses most of its energy through collisions and interactions with other atoms. As a result, a sheet of paper or a few centimeters of air can easily stop alpha particles.

Beta Particles: Beta particles are very small, and comparatively fast particles, traveling at speeds near the speed of light (186,000 miles per second). Beta particles have an electrical charge of either +1 or -1. Because they are so small and have a low charge, they do not collide and interact as often as alpha particles, so they can travel farther. Beta particles can usually travel through several meters of air, but may be stopped by a thin piece of metal or wood.

Gamma Rays: Gamma rays are pure energy and travel at the speed of light. They have no measurable charge or mass, and generally travel much farther than alpha or beta particles before being absorbed. After repeated interactions, the gamma ray loses its energy and vanishes. The range of a gamma ray in air varies, depending on the ray's energy and interactions. Very high-energy gamma radiation can travel a considerable distance, where as, low energy gamma radiation may travel only a few feet in air. Lead is used as shielding material for gamma radiation because of its density. Several inches of Lead or concrete may be needed to effectively shield gamma rays.

Genetic Effects: The effects of ionizing radiation which are observed in the offspring of the exposed individual that could occur as a result of ionizing radiation interacting with the genes in the human cells.

Half-life: The length of time an atom remains radioactive is defined in terms of half-life, which is the amount of time required for a radioactive substance to lose half of its activity through the process of radioactive decay. Radionuclides that have infrequent emissions have a long half-life, where as, radionuclides that have more frequent emissions have a short half-life.

SECTION 1 - INTRODUCTION

Ionization: Through interactions with atoms, alpha, beta, and gamma radiation lose their energy. When these forms of radiation interact with any form of material, the energy they impart may cause atoms in that material to become **ions**, or charged particles. Normally, an atom has the same number of protons as electrons, thus, the number of positive and negative charges cancel, in which the atom is electrically neutral. When one or more electrons are removed, an ion is formed. Ionization is one of the processes that may result in damage to biological systems.


Isotopes: A group of identical atoms containing the same number of protons make up an element. In fact, the number of protons an atom contains determines its chemical identity. For instance, all atoms with one proton are hydrogen atoms, and all atoms with eight protons are oxygen atoms. However, the number of neutrons in the nucleus of an element may vary. Atoms with the same number of protons but different numbers of neutrons are called isotopes. Different isotopes of the same element have the same chemical properties, and many are stable or non-radioactive. An unstable or radioactive isotope of an element is called a radioisotope, a radioactive atom, or a radionuclide. Radionuclides usually contain an excess amount of energy in the nucleus. The excess energy is usually due to a surplus or deficit in the number of neutrons in the nucleus. Radionuclides such as Uranium-238, Beryllium-7 and Potassium-40 occur naturally. Others are man-made, such as Iodine-131, Cesium-137, and Cobalt-60.

Neutrons: Neutrons come from several sources, including the interactions of cosmic radiation with the earth's atmosphere and nuclear reactions within operating nuclear power reactors. However, neutrons are not of environmental concern since the neutron source at nuclear power stations is sealed within the containment building. Because neutrons have no charge, they are able to pass very close to the nuclei of the material through which they are traveling. As a result, neutrons may be captured by one of these nuclei or they may be deflected. When deflected, the neutron loses some of its energy. After a series of these deflections, the neutron has lost most of its energy. At this point, the neutron moves about as slowly as the atoms of the material through which it is traveling, and is called a thermal neutron. In comparison, fast neutrons are much more energetic than thermal neutrons and have greater potential for causing damage to the material through which they travel. Fast neutrons can have from 200 thousand to 200 million times the energy of thermal neutrons. Neutron shielding is designed to slow fast neutrons and absorb thermal neutrons. Neutron shielding materials commonly used to slow neutrons down are water or polyethylene. The shield is then completed with a material such as Cadmium, to absorb the now thermal neutrons. Concrete is also used to form an effective neutron shield because it contains water molecules, and can be easily molded around odd shapes.

Radiation: This is the conveyance of energy through space. For instance, heat emanating from a stove is a form of radiation, as are light rays, microwaves, and radio waves. Ionizing radiation is another type of radiation and has similar properties to those of the examples listed above. Ionizing radiation consists of both electromagnetic radiation and particulate radiation. Electromagnetic radiation is energy with no measurable mass that travels with a wave-like motion through space. Included in this category are gamma rays and X-rays. Particulate radiation consists of tiny, fast moving particles which, if unhindered, travel in a straight line through space. The three types of particulate radiation of concern to us are alpha particles, which are made up of 2 protons and 2 neutrons; beta particles, which are essentially free electrons; and neutrons. The properties of these types of radiation will be described more fully in the Range and Shielding section.

SECTION 1 - INTRODUCTION

Radioactive Decay: Radioactive atoms, over time, will reach a stable, non-radioactive state through a process known as radioactive decay, which is the release of energy from an atom through the emission of ionizing radiation. Radioactive atoms may decay directly to a stable state or may go through a series of decay stages, called a radioactive decay series, and produce several daughter products that eventually result in a stable atom. The loss of energy through radioactive decay may transform the atom into a chemically different element. For example, when Uranium-238 decays, it emits an alpha particle and, as a result, the atom loses 2 protons and 2 neutrons. Since the number of protons in the nucleus of an atom determines its chemical identity, then when the Uranium-238 atom loses the 2 protons and 2 neutrons, it is transformed into an atom of Thorium-234. Thorium-234 is one of the 14 successive daughter products of Uranium-238. Radon is another daughter product, and the decay series ends with stable Lead-206. The following example is part of a known radioactive decay series, called the Uranium series, which begins with Uranium-238 and ends with Lead-206. The information provided in the upper portion of each block is the isotope name, while the information provided in the lower portion of each block is the half-life.

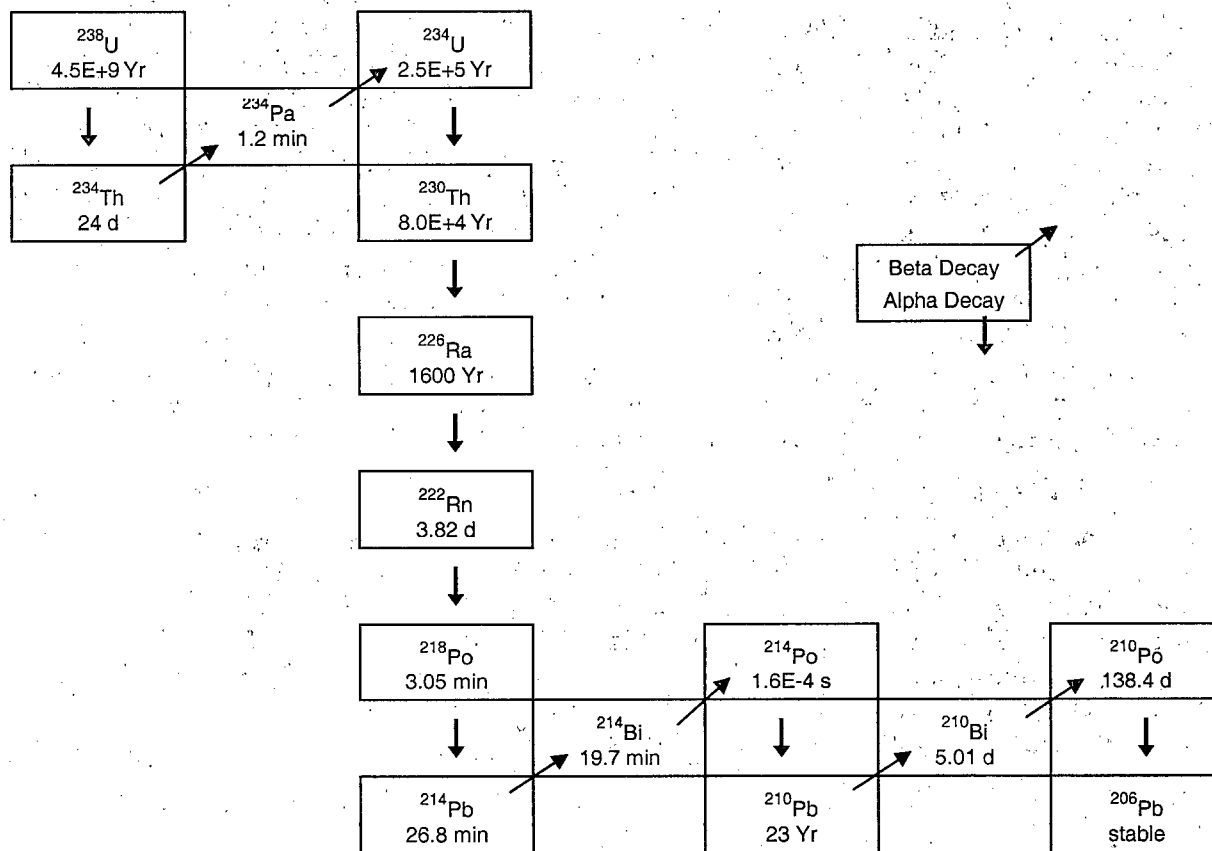

Radionuclides: See description for "isotopes".

Somatic Effects: The effects of ionizing radiation which develop in the directly exposed individual, including an unborn child. Somatic effects can be divided further into acute and chronic effects. Acute effects develop shortly after exposure to large amount of radiation. Chronic effects are a result of exposure to radiation over an extended period of time.

SECTION 1 - INTRODUCTION

C. Units of Measurement

Activity (Curie): This relates the number of atoms in a sample that disintegrate (decay) per unit of time. Each time an atom disintegrates, radiation is emitted. The curie (Ci) is the unit used to describe the activity of a material and indicates the rate at which the atoms of a radioactive substance are decaying. One curie indicates the disintegration of 37 billion atoms per second. A curie is a unit of activity, not a quantity of material. Thus, the amount of material required to produce one curie varies. A smaller unit of the curie is used when discussing the low concentrations of radioactivity detected in environmental samples. For instance, the picocurie (pCi) represents one trillionth of a curie.

Absorbed Dose (rad): This is a term used to describe the radiation energy absorbed by any material exposed to ionizing radiation, and can be used for both particulate and electromagnetic radiation. The rad is the unit used to measure the absorbed dose. It is defined as the energy of ionizing radiation deposited per gram of absorbing material (1 rad = 100 erg/gm). The rate of absorbed dose is usually given in rad/hr. The rad is not used to quantify biological damage caused by ionizing radiation.

Dose Equivalent (rem): Biological damage due to alpha, beta, gamma and neutron radiation may result from ionizing radiation. Some types of radiation, especially alpha particles which cause dense local ionization, can result in up to 20 times the amount of biological damage for the same energy imparted as do gamma or X-rays. Therefore, a quality factor must be applied to account for the different ionizing capabilities of various types of ionizing radiation. When the quality factor is multiplied by the absorbed dose (Rad), the result is the dose equivalent, which is an estimate of the possible biological damage resulting from exposure to a particular type of ionizing radiation. The dose equivalent is measured in rem. An example of this conversion from absorbed dose (rad) to dose equivalent (rem) uses the quality factor for alpha radiation, which is equal to 20. Thus, 1 Rad of alpha radiation = 20 rem. Since beta and gamma radiation each have a quality factor of 1, then 1 Rad of either beta or gamma radiation = 1 rem. Neutrons have a quality factor ranging from 2 to 10. In terms of radiation, the rem is a relatively large unit. Therefore, a smaller unit, the millirem, is often used, where as, one millirem (mrem) is equal to 1/1000 of a rem.

D. Lower Limit of Detection

The Lower Limit of Detection (LLD) for environmental samples is a calculated value that represents an a-priori (before-the-fact) limit for the smallest concentration (i.e.; pCi per unit mass or volume) of radioactive material in a sample that will be detected with 95% probability, and with 5% probability of falsely concluding that a blank observation represents a real signal. A calculated LLD must consider such analytical variables as standard deviation of the background counting rate, the counting efficiency, the sample size, the fractional radiochemical yield, the radioactive decay constant, and the elapsed time between sample collection and time of counting.

SECTION 1 - INTRODUCTION

E. Scope and Objectives of the REMP Program

The environmental program consists of environmental monitoring for radioactivity in the vicinity of BVPS. Environmental sampling and analyses include air, water, milk, vegetation, river sediments, fish, and ambient radiation levels in areas surrounding the site. The results of these media are assessed to determine impacts of the plant operation on the environment. The Annual Radiological Environmental Operating Report (AREOR) for BVPS summarizes the Radiological Environmental Monitoring Program (REMP) conducted by the FirstEnergy Nuclear Operating Company during the report period.

F. Description of the Beaver Valley Site

BVPS is located on the south bank of the Ohio River in the Borough of Shippingport, Beaver County, Pennsylvania, on a 453 acre tract of land. The site is approximately one mile from Midland, Pennsylvania; five miles from East Liverpool, Ohio; and twenty-five miles from Pittsburgh, Pennsylvania. Figure 1-1 shows the site location in relation to the principal population centers. Population density in the immediate vicinity of the site is relatively low. The population within a five mile radius of the plant is approximately 15,493 and the only area within the radius of concentrated population is the Borough of Midland, Pennsylvania, with a population of approximately 3,321.

The site lies in a valley along the Ohio River. It extends from the river (elevation 665 feet above sea level) to a ridge along the border south of the Beaver Valley Power Station at an elevation of 1,078 feet. Plant grade level is approximately 735 feet above sea level.

BVPS is on the Ohio River at river mile 34.8, at a location on the New Cumberland Pool that is 3.3 river miles downstream from Montgomery Lock and Dam, and 19.4 miles upstream from New Cumberland Lock and Dam. The Pennsylvania-Ohio-West Virginia border is located 5.2 river miles downstream from the site. The river flow is regulated by a series of dams and reservoirs on the Beaver, Allegheny, Monongahela and Ohio Rivers and their tributaries. During the report period, the Ohio River flow (as obtained from the Corps of Engineers – Water Resources Engineering) at the Wheeling Dam ranged from 8,800 cubic feet per second (minimum monthly average) to 107,400 cubic feet per second (maximum monthly average). The mean flow during the report period was 45,342 cubic feet per second.

Water temperature of the Ohio River typically varies from 34° Fahrenheit to 75° Fahrenheit. The minimum temperatures occur in January and/or February and maximum temperatures in July and/or August. Water quality in the Ohio River at the site location is affected primarily by the water quality of the Allegheny, Monongahela and Beaver rivers.

The climate of the area may be classified as humid continental. The predominant wind direction is typically from the southwest in summer and from the west southwest in winter. The National Climate Data Center (<http://www.ncdc.noaa.gov/oa/climate/research/cag3/v4.html>) indicates the following data for the Pittsburgh, PA area:

- The total annual precipitation during the report period was 39.248 inches
- The average mean temperature during the report period was 50.9° Fahrenheit

SECTION 1 - INTRODUCTION

The basic features of the Beaver Valley Power Station Units 1 and 2 are tabulated below:


	<u>Beaver Valley Unit 1</u>	<u>Beaver Valley Unit 2</u>
Licensed Power Level	2900 – megawatts thermal	2900 – megawatts thermal
Type of Power	PWR	PWR
No. of Reactor Coolant Loops	3	3
No. of Steam Generators & Type	3 - Vertical	3 - Vertical.
Steam Used by Main Turbine	Saturated	Saturated

The BVPS units utilize two separate systems (primary and secondary) for transferring heat from the source (the reactor) to the receiving component (turbine-generator). Because the two systems are isolated from each other, primary and secondary waters do not mix; therefore, radioactivity in the primary system water is normally isolated from the secondary system. Reactor coolant in the primary system is pumped through the reactor core and steam generators by means of reactor coolant pumps. Heat is given up from the primary system to the secondary system in the steam generators, where steam is formed and delivered to the main unit turbine, which drives the electrical generator. The steam is condensed after passing through the turbine, and returned to the steam generators to begin another steam/water cycle.

SECTION 1 - INTRODUCTION

Figure 1-1

Geographical Map and Principal Communities
in 50-mile Radius of the Beaver Valley Power Station

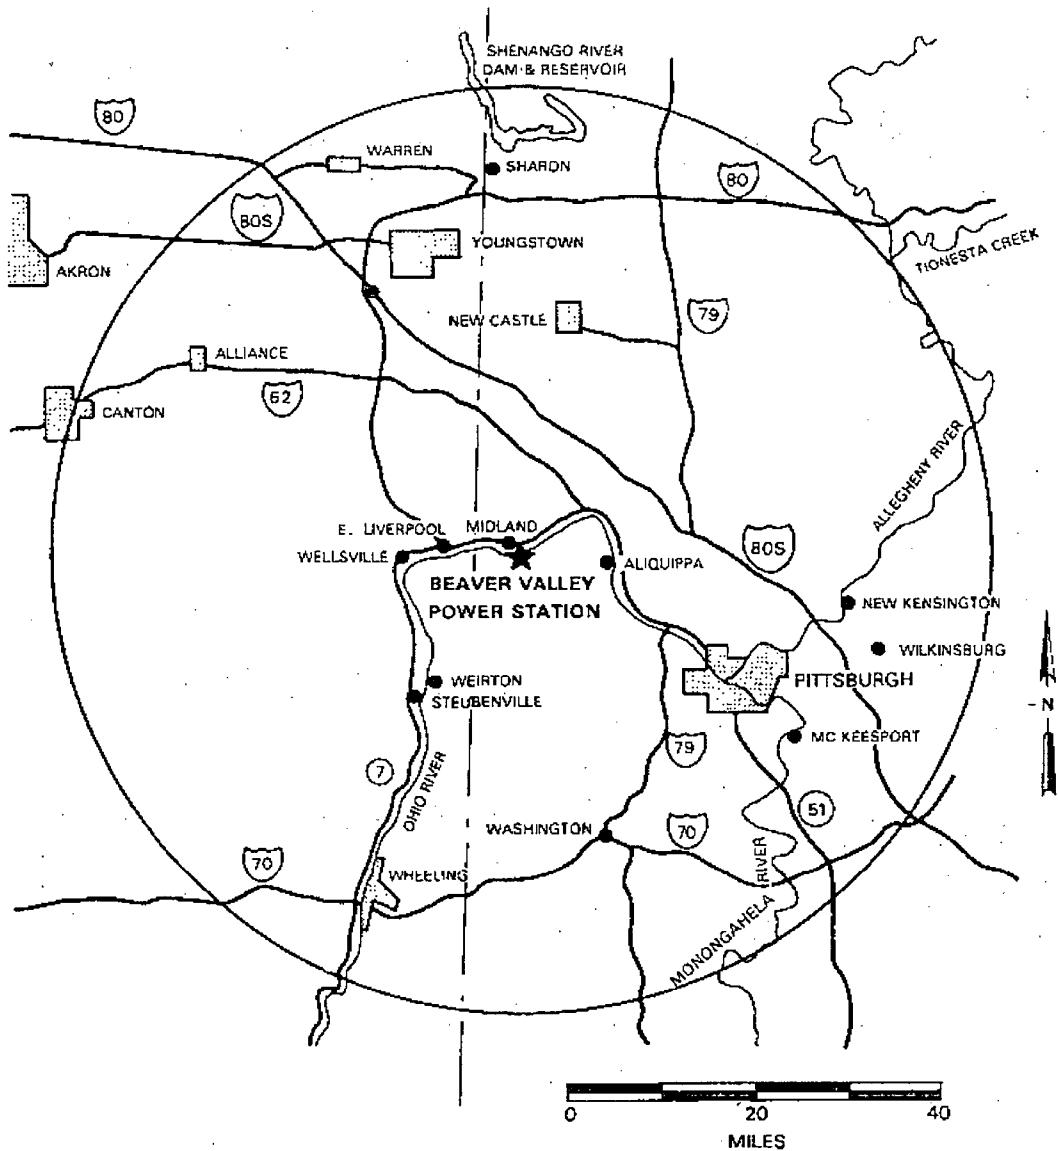

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

A. Environmental Radioactivity Monitoring Program

1. Program Description

The program consists of monitoring water, air, soil, river bottoms (sediment), feedstuff, vegetation, foodcrops, cow's milk, ambient radiation levels in areas surrounding the site, and aquatic life as summarized in Table 2-1. Further description of each portion of the program (Sampling Methods, Sample Analysis, Discussion and Results) are included in Sections 2-B through 2-I of this report.

2-B - Air Monitoring

2-C - Monitoring of Sediment and Soil

2-D - Monitoring of Feedstuff and Foodcrops

2-E - Monitoring of Local Cow and Goat Milk

2-F - Environmental Radiation Monitoring

2-G - Monitoring of Fish

2-H - Monitoring of Surface Water, Drinking Water, Groundwater and Precipitation

2-I - Estimates of Radiation Dose to Man

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Table 2-1

Operational Radiological Environmental Monitoring Program

Section	Sample Type	Sample Site No.	Sample Location	Sample Frequency	Sample Preparation / Analysis Frequency	Analysis
1	Air Particulate & Radionuclide	13	Hookstown, PA (Old Meyer Farm)	Continuous Sampling with Sample Collection at least weekly	Weekly - Air Particulate Weekly – Charcoal Quarterly Composite (c)	Gross Beta (b) Iodine-131 Gamma Scan
		27	Aliquippa, PA (Brunton Farm)			
		28	Sherman Farm			
		29B	Beaver, Pa (Friendship Ridge)			
		30	Shippingport, PA (Cook's Ferry Substation)			
		32	Midland, PA (North Substation)			
		46.1	Industry, PA (McKeel's Service - Rt. 68)			
		47	East Liverpool, OH (Water Department)			
		48 (a)	Weirton, WV (Water Tower - Collier Way)			
		51	Aliquippa, PA (Sheffield Substation)			
2	Direct Radiation	10	Shippingport, PA (Post Office)	Continuous (TLD)	Quarterly (i)	Gamma Dose
		13	Hookstown, PA (Old Meyer Farm)			
		14	Hookstown, PA			
		15	Georgetown, PA (Post Office)			
		27	Aliquippa, PA (Brunton Farm)			
		28	Sherman Farm			
		29B	Beaver, PA (Friendship Ridge)			
		30	Shippingport, PA (Cook's Ferry Substation)			
		32	Midland, PA (North Substation)			
		33-44	BVPS Site Perimeter Locations			
		45	Raccoon Township, PA (Christian House Baptist Chapel - Rt. 18)			
		45.1	Raccoon Township, PA (Kennedy's Corner)			
		46	Industry, PA (Midway Drive)			
		46.1	Industry, PA (McKeel's Service - Rt. 68)			
		47	East Liverpool, OH (Water Department)			
		48 (a)	Weirton, WV (Water Tower - Collier Way)			
		51	Aliquippa, PA (Sheffield Substation)			
		52-56	BVPS Site Perimeter Locations			
		59	236 Green Hill Road			
		60	Georgetown, PA (444 Hill Road)			
		70	Industry, PA (236 Engle Road)			
		71	Brighton Township, PA (First Western Bank)			
		72	Ohioview, PA (Lutheran Church – Rear)			
		73	618 Squirrel Run Road			
		74	Monaca, PA (37 Poplar Avenue – CCBC)			
		75	Aliquippa, PA (117 Holt Road)			
		76	Raccoon Township, PA (Elementary School)			
		77	Aliquippa, PA (3614 Green Garden Road)			
		78	Raccoon Township, PA (Municipal Building)			
		79	106 Rt. 151 - Ted McWilliams Auto Body			
		80	Raccoon Township, PA (Park Office -Rt. 18)			
		81	Millcreek United Presbyterian, Church			
		82	2697 Rt. 18			
		83	735 Mill Creek Road			
		84	Hancock County, WV (Senior Center)			
		85	2048 Rt. 30			
		86	East Liverpool, OH (1090 Ohio Avenue)			
		87	50103 Calcutta Smith's Ferry Road			
		88	Midland, PA (110 Summit Road)			
		89	Ohioville, PA (488 Smith Ferry Road)			
90	Midland, PA (6286 Tuscarawas Road)					
91	Pine Grove Road & Doyle Road					
92	Georgetown, PA (Georgetown Road Substation)					
93	104 Linden - Sunrise Hills					
94	Hookstown, PA (McCleary & Pole Cat Hollow Roads)					
95	Hookstown, PA (832 McCLeary Road)					
111-112	BVPS Site Perimeter Locations					

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Table 2-1

Operational Radiological Environmental Monitoring Program

Section	Sample Type	Sample Site No.	Sample Location	Sample Frequency	Sample Preparation / Analysis Frequency	Analysis
3	Surface Water	49a (a)	Industry, PA (Upstream of Montgomery Dam)	Weekly Grab Sample (h)	Weekly Sample from Site 49 only	Iodine-131
		2.1	Midland, PA (ATI Allegheny Ludlum)	Weekly Intermittent Composite Sample (h)	Monthly Composite of Weekly Sample (c)	Gamma Scan
		5	East Liverpool, OH (Water Department)	Daily Grab Sample Collected Weekly (h)	Quarterly Composite (c)	Tritium (H-3)
4	Groundwater	11 (a)	Shippingport, PA (Upstream)	Semi-Annual	Semi-Annual	Gamma Scan Tritium (H-3)
		14a	Hookstown, PA (Downstream)			
		15b	Georgetown, PA (Downstream)			
5	Drinking Water	4	Midland, PA (Water Department)	Intermittent (d) Sample Collected Weekly	Weekly Composite of Daily sample (d)	Iodine-131
		5	East Liverpool, OH (Water Department)		Monthly Composite (d) Quarterly Composite (d)	Gamma Scan Tritium (H-3)
6	Shoreline Sediment	2A	BVPS Outfall Vicinity	Semi-Annual	Semi-Annual	Gamma Scan
		49a (a)	Industry, PA (Upstream of Montgomery Dam)			
		50	New Cumberland, WV (Upstream of Dam)			
7	Milk	25	Hookstown, PA (Searight Farm)	Weekly (e)	Weekly Samples from Searight only	Weekly Iodine-131 from Searight only
		27a (k)	Aliquippa, PA (Brunton Farm)	Biweekly (f) When animals are on pasture; monthly at other times	All other samples & analyses are Biweekly during grazing, but Monthly during other times	Gamma Scan Iodine-131 Strontium-89 Strontium-90
		69 (k)	Aliquippa, PA (Collins Farm)			
		96 (a)	Burgettstown, PA (Windsheimer Farm)			
113 (k)	Hookstown, PA (Halstead Farm)					
114 (k)	Hookstown, PA (Moore Farm)					
8	Fish	2A	BVPS Outfall Vicinity	Semi-Annual	Composite of edible parts by species (g)	Gamma Scan on edible parts
		49a	Industry, PA (Upstream of Montgomery Dam)			
9	Food Products	10a	Shippingport, PA	Annual at Harvest if available	Composite of each sample species	Gamma Scan Iodine-131 on green leafy vegetables
		15a	Georgetown, PA			
		46a	Industry, PA			
		48a	Weirton, WV			
10	Feedstuff & Summer Forage	25	Hookstown, PA (Searight Farm)	Monthly	Monthly	Gamma Scan
11	Soil	13a	Hookstown, PA (Old Meyer Farm)	Every Three (3) Years (1997, 2000, 2003)	12 Core Samples 3" Deep (2" diameter at each location approx. 10' radius)	Gamma Scan
		22	South of BVPS, Transmission Lines			
		27b	Aliquippa, PA (Brunton Farm)			
		29A	Beaver, PA (Nicol Farm)			
		30a	Shippingport, PA (Cook's Ferry Substation)			
		32a	Midland, PA (North Substation)			
		46b	Industry, PA (Willows Inn - Rt. 68)			
		47a	East Liverpool, OH (Water Department)			
		48 (a)	Weirton WV (Water Tower - Collier Way)			
51a	Aliquippa, PA (Sheffield Substation)					
12	Precipitation	30	Shippingport, PA (Cook's Ferry Substation)	Weekly grab samples when available	Quarterly Composite (c)	Gamma Scan Tritium (H-3)
		47	East Liverpool, OH (Water Department)			
		48 (a)	Weirton WV (Water Tower - Collier Way)			

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Table 2-1

Operational Radiological Environmental Monitoring Program

Notes for Table 2-1

- (a) Control Sample Station: These Locations which are presumed to be outside the influence of plant effluents.
- (b) Particulate Samples are not counted within 24 hours after filter change. Perform Gamma isotopic analysis on each sample when gross beta is greater than 10 times the yearly mean of control samples.
- (c) Long-term composite samples are obtained from short-term composite samples at the specified locations.
- (d) Composite samples are collected at intervals not exceeding 2 hours.
- (e) Weekly milk sample from the Searight Dairy is analyzed for Iodine-131 only.
- (f) Milk samples are collected bi-weekly when animals are grazing. The milk samples are collected monthly at other times.
- (g) The fish samples contain whatever species are available.
IF adequate sample size is available, THEN the sample is separated according to species, and compositing will provide one sample of each species.
IF adequate sample size is not available, THEN separation by species is not practical. Therefore edible parts of all fish in the sample are mixed to provide one sample.
- (h) Composite samples are obtained by collecting an aliquot at intervals not exceeding 2 hours at location 2.1. The water treatment plant operator at location 5 obtains the weekly grab sample from the daily composite grab samples. For location 49a, the weekly grab sample is obtained by a field technician.
- (i) Two (2) TLDs are collected quarterly from each monitoring location.
- (k) ODCM procedure 1/2-ODC-3.03, Attachment Q, Table 3.12-1 requires three (3) dairies to be selected on basis of highest potential thyroid dose using milch census data. See Section 2-E of this report (Monitoring of Local Cows Milk) for specific locations sampled.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

2. Summary of Results

All results of this monitoring program are summarized in Table 2-2. This table is prepared in the format specified by the NRC via the Branch Technical Position in NUREG-1301, and in accordance with Beaver Valley Power Station Offsite Dose Calculation Manual. Summaries of results of analysis of each media are discussed in Sections 2-B through 2-H and an assessment of radiation doses are given in Section 2-I. Table 2-3 summarizes BVPS pre-operational ranges for the various sampling media during the years 1974 and 1975. Comparisons of pre-operational data with operational data indicate the ranges of values are generally in good agreement for both periods of time.

Activity detected was attributed to naturally occurring radionuclides, BVPS effluents, previous nuclear weapons tests or to the normal statistical fluctuation for activities near the Lower Limit of Detection (LLD).

The conclusion from all program data is that the operation of BVPS has resulted in no significant changes to the environment.

3. Quality Control Program

The Quality Control Program implemented by BVPS to assure reliable performance by the contractor and the supporting QC data are presented and discussed in Section 4 of this report.

4. Program Changes

There were no changes of significance to the sampling program during the report period.

SECTION 2 - ENVIRONMENTAL MONITORING PROGRAM

Table 2-2

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

Name of Facility: Beaver Valley Power Station Unit 1 and Unit 2

Docket No.: 50-334 / 50-412

Location of Facility: Beaver County, Pennsylvania

Reporting Period: Calendar Year - 2008

Medium: Air Particulate and Radioiodine

Unit of Measurement: (pico Curies / cubic meter)

Type and Total Number of Analysis Performed	Lower Limit of Detection LLD ^(a)	All Indicator Locations Mean (fraction) ^(b) Range ^(b)	Locations with Highest Annual Mean		Control Location		Number of Nonroutine Reported Measurements ^(c)
			Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	
Gross Beta 510	< 0.004	0.025 (459 / 459) 0.011 - 0.051	No. 47 East Liverpool, OH Water Department 4.88 miles WNW	0.026 (51 / 51) 0.013 - 0.045	No. 48 Weirton, WV Water Tower Collier Way 16.40 miles SSW	0.025 (51 / 51) 0.014 - 0.048	0
I-131 510	< 0.04	LLD (0 / 459)		LLD (0 / 459)		LLD (0 / 51)	0
Gamma 40							
Be-7	NA	0.081 (36 / 36) 0.550 - 0.101	No. 32 North Substation Midland 0.75 Miles NW	0.085 (4 / 4) 0.068 - 0.100	No. 48 Weirton, WV Water Tower Collier Way 16.40 miles SSW	0.081 (4 / 4) 0.067 - 0.098	NA
Co-60	< 0.0003	LLD (0 / 36)		LLD (0 / 36)		LLD (0 / 4)	0
Cs-134	< 0.0004	LLD (0 / 36)		LLD (0 / 36)		LLD (0 / 4)	0
Cs-137	< 0.0004	LLD (0 / 36)		LLD (0 / 36)		LLD (0 / 4)	0
Ba-La-140	< 0.0005	LLD (0 / 36)		LLD (0 / 36)		LLD (0 / 4)	0

^a Nominal Lower Limit of Detection

^b Mean and range based upon detectable measurements only.

Fraction of detectable measurements at specified locations is indicated in parentheses (fraction)

^c Nonroutine Reported Measurements (Reference: ODCM procedure 1/2-ODC-3.03, Attachment Q, Control 3.12.1)

NA = Not Applicable (Naturally Occurring Radionuclides Not required by ODCM)

SECTION 2 - ENVIRONMENTAL MONITORING PROGRAM

Table 2-2

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

Name of Facility: Beaver Valley Power Station Unit 1 and Unit 2

Docket No.: 50-334 / 50-412

Location of Facility: Beaver County, Pennsylvania

Reporting Period: Calendar Year - 2008

Medium: Drinking Water

Unit of Measurement: (pico Curies / liter)

Type and Total Number of Analysis Performed	Lower Limit of Detection LLD ^(a)	All Indicator Locations Mean (fraction) ^(b) Range ^(b)	Locations with Highest Annual Mean		Control Location		Number of Nonroutine Reported Measurements ^(c)
			Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	
I-131 156	< 0.5	0.650 (58 / 104) 0.300 - 2.000	No. 5 East Liverpool, OH Water Department 4.90 miles WNW	0.700 (33 / 52) 0.300 - 2.000	No. 49 Industry, PA Upstream of Montgomery Dam 4.92 miles NE	0.900 (42 / 52) 0.200 - 2.600	0
H-3 12	< 200	LLD (0 / 8)		LLD (0 / 4)		LLD (0 / 4)	0
Gamma 36							
Mn-54	< 5	LLD (0 / 24)		LLD (0 / 24)		LLD (0 / 12)	0
Fe-59	< 10	LLD (0 / 24)		LLD (0 / 24)		LLD (0 / 12)	0
Co-58	< 5	LLD (0 / 24)		LLD (0 / 24)		LLD (0 / 12)	0
Co-60	< 5	LLD (0 / 24)		LLD (0 / 24)		LLD (0 / 12)	0
Zn-65	< .10	LLD (0 / 24)		LLD (0 / 24)		LLD (0 / 12)	0
Zr-Nb-95	< 5	LLD (0 / 24)		LLD (0 / 24)		LLD (0 / 12)	0
Cs-134	< 5	LLD (0 / 24)		LLD (0 / 24)		LLD (0 / 12)	0
Cs-137	< 5	LLD (0 / 24)		LLD (0 / 24)		LLD (0 / 12)	0
Ba-La-140	< 15	LLD (0 / 24)		LLD (0 / 24)		LLD (0 / 12)	0

^a Nominal Lower Limit of Detection

^b Mean and range based upon detectable measurements only.

Fraction of detectable measurements at specified locations is indicated in parentheses (fraction)

^c Nonroutine Reported Measurements (Reference: ODCM procedure 1/2-ODC-3.03, Attachment Q, Control 3.12.1)

NA = Not Applicable (Naturally Occurring Radionuclides Not required by ODCM)

SECTION 2 - ENVIRONMENTAL MONITORING PROGRAM

Table 2-2

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

Name of Facility: Beaver Valley Power Station Unit 1 and Unit 2

Docket No.: 50-334 / 50-412

Location of Facility: Beaver County, Pennsylvania

Reporting Period: Calendar Year - 2008

Medium: Surface Water

Unit of Measurement: (pico Curies / liter)

Type and Total Number of Analysis Performed	Lower Limit of Detection LLD ^(a)	All Indicator Locations Mean (fraction) ^(b) Range ^(b)	Locations with Highest Annual Mean		Control Location		Number of Nonroutine Reported Measurements ^(c)
			Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	
I-131 52	< 0.5				No. 49 Industry, PA Upstream of Montgomery Dam 4.92 miles NE	0.900 (42 / 52) 0.200 - 2.600	0
H-3 12	< 200	LLD (0 / 8)		LLD (0 / 4)		LLD (0 / 4)	0
Gamma 36							
Mn-54	< 5	LLD (0 / 24)		LLD (0 / 24)		LLD (0 / 12)	0
Fe-59	< 10	LLD (0 / 24)		LLD (0 / 24)		LLD (0 / 12)	0
Co-58	< 5	LLD (0 / 24)		LLD (0 / 24)		LLD (0 / 12)	0
Co-60	< 5	LLD (0 / 24)		LLD (0 / 24)		LLD (0 / 12)	0
Zn-65	< 10	LLD (0 / 24)		LLD (0 / 24)		LLD (0 / 12)	0
Zr-Nb-95	< 5	LLD (0 / 24)		LLD (0 / 24)		LLD (0 / 12)	0
Cs-134	< 5	LLD (0 / 24)		LLD (0 / 24)		LLD (0 / 12)	0
Cs-137	< 5	LLD (0 / 24)		LLD (0 / 24)		LLD (0 / 12)	0
Ba-La-140	< 15	LLD (0 / 24)		LLD (0 / 24)		LLD (0 / 12)	0

^a Nominal Lower Limit of Detection

^b Mean and range based upon detectable measurements only.

Fraction of detectable measurements at specified locations is indicated in parentheses (fraction)

^c Nonroutine Reported Measurements (Reference: ODCM procedure 1/2-ODC-3.03, Attachment Q, Control 3.12.1)

NA = Not Applicable (Naturally Occurring Radionuclides Not required by ODCM)

SECTION 2 - ENVIRONMENTAL MONITORING PROGRAM

Table 2-2

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

Name of Facility: Beaver Valley Power Station Unit 1 and Unit 2

Docket No.: 50-334 / 50-412

Location of Facility: Beaver County, Pennsylvania

Reporting Period: Calendar Year - 2008

Medium: Ground Water

Unit of Measurement: (pico Curies / liter)

Type and Total Number of Analysis Performed	Lower Limit of Detection LLD ^(a)	All Indicator Locations Mean (fraction) ^(b) Range ^(b)	Locations with Highest Annual Mean		Control Location		Number of Nonroutine Reported Measurements ^(c)
			Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	
H-3 6	< 200	LLD (0 / 4)		LLD (0 / 4)	No. 11 Shippingport, PA Upstream 0.94 miles NE	LLD (0 / 2)	0
Gamma 6					No. 11 Shippingport, PA Upstream 0.94 miles NE		
Mn-54	< 5	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 2)	0
Fe-59	< 10	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 2)	0
Co-58	< 5	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 2)	0
Co-60	< 5	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 2)	0
Zn-65	< 10	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 2)	0
Zr-Nb-95	< 5	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 2)	0
Cs-134	< 5	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 2)	0
Cs-137	< 5	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 2)	0
Ba-La-140	< 15	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 2)	0

^a Nominal Lower Limit of Detection

^b Mean and range based upon detectable measurements only.

Fraction of detectable measurements at specified locations is indicated in parentheses (fraction)

^c Nonroutine Reported Measurements (Reference: ODCM procedure 1/2-ODC-3.03, Attachment Q, Control 3.12.1)

NA = Not Applicable (Naturally Occurring Radionuclides Not required by ODCM)

SECTION 2 - ENVIRONMENTAL MONITORING PROGRAM

Table 2-2

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

Name of Facility: Beaver Valley Power Station Unit 1 and Unit 2

Docket No.: 50-334 / 50-412

Location of Facility: Beaver County, Pennsylvania

Reporting Period: Calendar Year - 2008

Medium: Precipitation Water

Unit of Measurement: (pico Curies / liter)

Type and Total Number of Analysis Performed	Lower Limit of Detection LLD ^(a)	All Indicator Locations Mean (fraction) ^(b) Range ^(b)	Locations with Highest Annual Mean		Control Location		Number of Nonroutine Reported Measurements ^(c)
			Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	
H-3 12	< 200	486 (2 / 8) 182 - 790	No. 47 East Liverpool, OH Water Department 4.88 miles WNW	790 (1 / 4) 790 - 790	No. 48 Weirton, WV Water Tower Collier Way 16.40 miles SSW	LLD (0 / 4)	0
Gamma 12							
Mn-54	< 5	LLD (0 / 8)		LLD (0 / 8)		LLD (0 / 4)	0
Fe-59	< 10	LLD (0 / 8)		LLD (0 / 8)		LLD (0 / 4)	0
Co-58	< 5	LLD (0 / 8)		LLD (0 / 8)		LLD (0 / 4)	0
Co-60	< 5	LLD (0 / 8)		LLD (0 / 8)		LLD (0 / 4)	0
Zn-65	< 10	LLD (0 / 8)		LLD (0 / 8)		LLD (0 / 4)	0
Zr-Nb-95	< 5	LLD (0 / 8)		LLD (0 / 8)		LLD (0 / 4)	0
Cs-134	< 5	LLD (0 / 8)		LLD (0 / 8)		LLD (0 / 4)	0
Cs-137	< 5	LLD (0 / 8)		LLD (0 / 8)		LLD (0 / 4)	0
Ba-La-140	< 15	LLD (0 / 8)		LLD (0 / 8)		LLD (0 / 4)	0

^a Nominal Lower Limit of Detection

^b Mean and range based upon detectable measurements only.

Fraction of detectable measurements at specified locations is indicated in parentheses (fraction)

^c Nonroutine Reported Measurements (Reference: ODCM procedure 1/2-ODC-3.03, Attachment Q, Control 3.12.1)

NA = Not Applicable (Naturally Occurring Radionuclides Not required by ODCM)

SECTION 2 - ENVIRONMENTAL MONITORING PROGRAM

Table 2-2

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

Name of Facility: Beaver Valley Power Station Unit 1 and Unit 2

Docket No.: 50-334 / 50-412

Location of Facility: Beaver County, Pennsylvania

Reporting Period: Calendar Year - 2008

Medium: Milk

Unit of Measurement: (pico Curies / liter)

Type and Total Number of Analysis Performed	Lower Limit of Detection LLD ^(a)	All Indicator Locations Mean (fraction) ^(b) Range ^(b)	Locations with Highest Annual Mean		Control Location		Number of Nonroutine Reported Measurements ^(c)
			Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	
I-131 124	< 0.5	LLD (0 / 104)		LLD (0 / 104)	No. 96 Burgettstown, PA Windsheimer Farm 10.48 miles SSW	LLD (0 / 20)	0
Sr-89 92	< 2.0	LLD (0 / 72)		LLD (0 / 72)	No. 96 Burgettstown, PA Windsheimer Farm 10.48 miles SSW	LLD (0 / 20)	0
Sr-90 92	< 0.7	1.379 (66 / 72) 0.600 - 2.6	No. 25 Hookstown, PA Searight Farm 2.10 miles SSW	1.845 (20 / 20) 1.300 - 2.500	No. 96 Burgettstown, PA Windsheimer Farm 10.48 miles SSW	0.995 (19 / 20) 0.600 - 1.900	0
Gamma 92							
K-40	< NA	1416 (72 / 72) 1067 - 1746	No. 69 Alliquippa, PA Collings Farm 3.55 miles SE	1630 (12 / 12) 1489 - 1746	No. 96 Burgettstown, PA Windsheimer Farm 10.48 miles SSW	1361 (20 / 20) 1300 - 1507	NA
Mn-54	< 5	LLD (0 / 72)		LLD (0 / 72)		LLD (0 / 20)	0
Fe-59	< 10	LLD (0 / 72)		LLD (0 / 72)		LLD (0 / 20)	0
Co-58	< 5	LLD (0 / 72)		LLD (0 / 72)		LLD (0 / 20)	0
Co-60	< 5	LLD (0 / 72)		LLD (0 / 72)		LLD (0 / 20)	0
Zn-65	< 10	LLD (0 / 72)		LLD (0 / 72)		LLD (0 / 20)	0
Zr-Nb-95	< 5	LLD (0 / 72)		LLD (0 / 72)		LLD (0 / 20)	0
Cs-134	< 5	LLD (0 / 72)		LLD (0 / 72)		LLD (0 / 20)	0
Cs-137	< 5	LLD (0 / 72)		LLD (0 / 72)		LLD (0 / 20)	0
Ba-La-140	< 15	LLD (0 / 72)		LLD (0 / 72)		LLD (0 / 20)	0

^a Nominal Lower Limit of Detection

^b Mean and range based upon detectable measurements only.

Fraction of detectable measurements at specified locations is indicated in parentheses (fraction)

^c Nonroutine Reported Measurements (Reference: ODCM procedure 1/2-ODC-3.03, Attachment Q, Control 3.12.1)

NA = Not Applicable (Naturally Occurring Radionuclides Not required by ODCM)

SECTION 2 - ENVIRONMENTAL MONITORING PROGRAM

Table 2-2

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

Name of Facility: Beaver Valley Power Station Unit 1 and Unit 2

Docket No.: 50-334 / 50-412

Location of Facility: Beaver County, Pennsylvania

Reporting Period: Calendar Year - 2008

Medium: Fish

Unit of Measurement: (pico Curies / gram) Wet

Type and Total Number of Analysis Performed	Lower Limit of Detection LLD ^(a)	All Indicator Locations Mean (fraction) ^(b) Range ^(b)	Locations with Highest Annual Mean		Control Location		Number of Nonroutine Reported Measurements ^(c)
			Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	
Gamma							
Mn-54	< 0.05	LLD (0 /)		LLD (0 /)		LLD (0 /)	0
Fe-59	< 0.10	LLD (0 /)		LLD (0 /)		LLD (0 /)	0
Co-58	< 0.05	LLD (0 /)		LLD (0 /)		LLD (0 /)	0
Co-60	< 0.05	LLD (0 /)		LLD (0 /)		LLD (0 /)	0
Zn-65	< 0.10	LLD (0 /)		LLD (0 /)		LLD (0 /)	0
Zr-Nb-95	< 0.03	LLD (0 /)		LLD (0 /)		LLD (0 /)	0
Cs-134	< 0.05	LLD (0 /)		LLD (0 /)		LLD (0 /)	0
Cs-137	< 0.05	LLD (0 /)		LLD (0 /)		LLD (0 /)	0
Ba-La-140	< 0.07	LLD (0 /)		LLD (0 /)		LLD (0 /)	0

^a Nominal Lower Limit of Detection

^b Mean and range based upon detectable measurements only.

Fraction of detectable measurements at specified locations is indicated in parentheses (fraction)

^c Nonroutine Reported Measurements (Reference: ODCM procedure 1/2-ODC-3.03, Attachment Q, Control 3.12.1)

NA = Not Applicable (Naturally Occurring Radionuclides Not required by ODCM)

SECTION 2 - ENVIRONMENTAL MONITORING PROGRAM

Table 2-2

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

Name of Facility: Beaver Valley Power Station Unit 1 and Unit 2

Docket No.: 50-334 / 50-412

Location of Facility: Beaver County, Pennsylvania

Reporting Period: Calendar Year - 2008

Medium: Foodcrops

Unit of Measurement: (pico Curies / gram) Wet

Type and Total Number of Analysis Performed	Lower Limit of Detection LLD ^(a)	All Indicator Locations Mean (fraction) ^(b) Range ^(b)	Locations with Highest Annual Mean		Control Location		Number of Nonroutine Reported Measurements ^(c)
			Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	
I-131 5	< 0.06	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 1)	0
Gamma 5 K-40	NA	2.160 (4 / 4) 1.970 - 2.300	No. 15 Georgetown, PA 321 Third Street 3.7 miles WSW	2.300 (1 / 1) 2.300 - 2.300	No. 48a Weirton, WV Weirton Area 16.54 miles SSW	2.130 (1 / 1) 2.130 - 2.130	NA
Mn-54	< 0.05	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 1)	0
Fe-59	< 0.10	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 1)	0
Co-58	< 0.05	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 1)	0
Co-60	< 0.05	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 1)	0
Zn-65	< 0.10	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 1)	0
Zr-Nb-95	< 0.03	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 1)	0
Cs-134	< 0.05	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 1)	0
Cs-137	< 0.05	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 1)	0
Ba-La-140	< 0.07	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 1)	0

^a Nominal Lower Limit of Detection

^b Mean and range based upon detectable measurements only.

Fraction of detectable measurements at specified locations is indicated in parentheses (fraction)

^c Nonroutine Reported Measurements (Reference: ODCM procedure 1/2-ODC-3.03, Attachment Q, Control 3.12.1)

NA = Not Applicable (Naturally Occurring Radionuclides Not required by ODCM)

SECTION 2 - ENVIRONMENTAL MONITORING PROGRAM

Table 2-2

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

Name of Facility: Beaver Valley Power Station Unit 1 and Unit 2

Docket No.: 50-334 / 50-412

Location of Facility: Beaver County, Pennsylvania

Reporting Period: Calendar Year - 2008

Medium: Feedstuff

Unit of Measurement: (pico Curies / gram) Wet

Type and Total Number of Analysis Performed	Lower Limit of Detection LLD ^(a)	All Indicator Locations Mean (fraction) ^(b) Range ^(b)	Locations with Highest Annual Mean		Control Location		Number of Nonroutine Reported Measurements ^(c)
			Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	
Gamma 12							
Be-7	< NA	1.190 (5 / 12) 0.320 - 2.550	No. 25 Searight Farm 948 McCleary Road Hookstown, PA 2.10 miles SSW	1.190 (5 / 12) 0.320 - 2.550	No. 25 Searight Farm 948 McCleary Road Hookstown, PA 2.10 miles SSW	1.190 (5 / 12) 0.320 - 2.550	NA
K-40	< NA	11.04 (12 / 12) 7.38 - 15.05	No. 25 Searight Farm 948 McCleary Road Hookstown, PA 2.10 miles SSW	11.04 (12 / 12) 7.38 - 15.05	No. 25 Searight Farm 948 McCleary Road Hookstown, PA 2.10 miles SSW	11.04 (12 / 12) 7.38 - 15.05	NA
Mn-54	< 0.05	LLD (0 / 12)		LLD (0 / 12)		LLD (0 / 12)	0
Fe-59	< 0.10	LLD (0 / 12)		LLD (0 / 12)		LLD (0 / 12)	0
Co-58	< 0.05	LLD (0 / 12)		LLD (0 / 12)		LLD (0 / 12)	0
Co-60	< 0.05	LLD (0 / 12)		LLD (0 / 12)		LLD (0 / 12)	0
Zn-65	< 0.10	LLD (0 / 12)		LLD (0 / 12)		LLD (0 / 12)	0
Zr-Nb-95	< 0.03	LLD (0 / 12)		LLD (0 / 12)		LLD (0 / 12)	0
Ru-103	< 0.04	LLD (0 / 12)		LLD (0 / 12)		LLD (0 / 12)	0
I-131	< 0.06	LLD (0 / 12)		LLD (0 / 12)		LLD (0 / 12)	0
Cs-134	< 0.05	LLD (0 / 12)		LLD (0 / 12)		LLD (0 / 12)	0
Cs-137	< 0.05	LLD (0 / 12)		LLD (0 / 12)		LLD (0 / 12)	0
Ba-La-140	< 0.07	LLD (0 / 12)		LLD (0 / 12)		LLD (0 / 12)	0

^a Nominal Lower Limit of Detection

^b Mean and range based upon detectable measurements only.

Fraction of detectable measurements at specified locations is indicated in parentheses (fraction)

^c Nonroutine Reported Measurements (Reference: ODCM procedure 1/2-ODC-3.03, Attachment Q, Control 3.12.1)

NA = Not Applicable (Naturally Occurring Radionuclides Not required by ODCM)

SECTION 2 - ENVIRONMENTAL MONITORING PROGRAM

Table 2-2

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

Name of Facility: Beaver Valley Power Station Unit 1 and Unit 2

Docket No.: 50-334 / 50-412

Location of Facility: Beaver County, Pennsylvania

Reporting Period: Calendar Year - 2008

Medium: Sediment (page 1 of 2)

Unit of Measurement: (pico Curies / gram) Dry

Type and Total Number of Analysis Performed	Lower Limit of Detection LLD ^(a)	All Indicator Locations Mean (fraction) ^(b) Range ^(b)	Locations with Highest Annual Mean		Control Location		Number of Nonroutine Reported Measurements ^(c)
			Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	
Gamma 6							
K-40	NA	9.40 (4 / 4) 7.29 - 11.37	No. 2A BVPS Outfall Vicinity 0.31 miles WSW	10.14 (2 / 2) 8.90 - 11.37	No. 49a Industry, PA Upstream of Montgomery Dam 4.93 miles NE	9.48 (2 / 2) 9.77 - 9.91	NA
Mn-54	< 0.05	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 2)	0
Fe-59	< 0.10	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 2)	0
Co-58	< 0.05	0.08 (2 / 4) 0.08 - 0.08	No. 2A BVPS Outfall Vicinity 0.31 miles WSW	0.08 (2 / 2) 0.08 - 0.08	No. 49a Industry, PA Upstream of Montgomery Dam 4.93 miles NE	LLD (0 / 2)	0
Co-60	< 0.05	0.15 (2 / 4) 0.11 - 0.19	No. 2A BVPS Outfall Vicinity 0.31 miles WSW	0.15 (2 / 2) 0.11 - 0.19	No. 49a Industry, PA Upstream of Montgomery Dam 4.93 miles NE	LLD (0 / 2)	0
Zn-65	< 0.10	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 2)	0
Zr-95	< 0.03	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 2)	0
Nb-95	< 0.03	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 2)	0
Cs-134	< 0.05	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 2)	0
Cs-137	< 0.05	0.10 (2 / 4) 0.06 - 0.13	No. 2A BVPS Outfall Vicinity 0.31 miles WSW	0.10 (2 / 2) 0.06 - 0.13	No. 49a Industry, PA Upstream of Montgomery Dam 4.93 miles NE	0.08 (2 / 2) 0.08 - 0.08	0
Ba-La-140	< 0.07	LLD (0 / 4)		LLD (0 / 4)		LLD (0 / 2)	0
Tl-208	NA	0.31 (4 / 4) 0.23 - 0.39	No. 2A BVPS Outfall Vicinity 0.31 miles WSW	0.34 (2 / 2) 0.29 - 0.39	No. 49a Industry, PA Upstream of Montgomery Dam 4.93 miles NE	0.28 (2 / 2) 0.28 - 0.28	NA

SECTION 2 - ENVIRONMENTAL MONITORING PROGRAM

Table 2-2

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

Name of Facility: Beaver Valley Power Station Unit 1 and Unit 2

Docket No.: 50-334 / 50-412

Location of Facility: Beaver County, Pennsylvania

Reporting Period: Calendar Year - 2008

Medium: Sediment (page 2 of 2)

Unit of Measurement: (pico Curies / gram) Dry

Type and Total Number of Analysis Performed	Lower Limit of Detection LLD ^(a)	All Indicator Locations Mean (fraction) ^(b) Range ^(b)	Locations with Highest Annual Mean		Control Location		Number of Nonroutine Reported Measurements ^(c)
			Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	
Bi-214	NA	0.78 (4 / 4) 0.58 - 0.89	No. 2A BVPS Outfall Vicinity 0.31 miles WSW	0.83 (2 / 2) 0.77 - 0.89	No. 49a Industry, PA Upstream of Montgomery Dam 4.93 miles NE	0.72 (2 / 2) 0.69 - 0.75	NA
Pb-212	NA	1.17 (4 / 4) 0.94 - 1.34	No. 2A BVPS Outfall Vicinity 0.31 miles WSW	1.28 (2 / 2) 1.21 - 1.34	No. 49a Industry, PA Upstream of Montgomery Dam 5 miles NE	1.02 (2 / 2) 0.89 - 1.15	NA
Pb-214	NA	0.81 (4 / 4) 0.59 - 0.93	No. 2A BVPS Outfall Vicinity 0.31 miles WSW	0.87 (2 / 2) 0.81 - 0.93	No. 49a Industry, PA Upstream of Montgomery Dam 5 miles NE	0.79 (2 / 2) 0.74 - 0.84	NA
Ra-226	NA	1.67 (4 / 4) 1.09 - 2.12	No. 2A BVPS Outfall Vicinity 0.31 miles WSW	1.92 (2 / 2) 1.71 - 2.12	No. 49a Industry, PA Upstream of Montgomery Dam 5 miles NE	1.67 (2 / 2) 1.43 - 1.91	NA
Ac-228	NA	0.98 (4 / 4) 0.75 - 1.19	No. 2A BVPS Outfall Vicinity 0.31 miles WSW	1.07 (2 / 2) 0.95 - 1.19	No. 49a Industry, PA Upstream of Montgomery Dam 5 miles NE	0.96 (2 / 2) 0.90 - 1.01	NA

^a Nominal Lower Limit of Detection

^b Mean and range based upon detectable measurements only.

Fraction of detectable measurements at specified locations is indicated in parentheses (fraction)

^c Nonroutine Reported Measurements (Reference: ODCM procedure 1/2-ODC-3.03, Attachment Q, Control 3.12.1)

NA = Not Applicable (Naturally Occurring Radionuclides Not required by ODCM)

SECTION 2 - ENVIRONMENTAL MONITORING PROGRAM

Table 2-2

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

Name of Facility: Beaver Valley Power Station Unit 1 and Unit 2

Docket No.: 50-334 / 50-412

Location of Facility: Beaver County, Pennsylvania

Reporting Period: Calendar Year - 2008

Medium: Soil (page 1 of 2)

Unit of Measurement: (pico Curies / gram) Dry

Type and Total Number of Analysis Performed	Lower Limit of Detection LLD ^(a)	All Indicator Locations Mean (fraction) ^(b) Range ^(b)	Locations with Highest Annual Mean		Control Location		Number of Nonroutine Reported Measurements ^(c)
			Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	
Gamma							
<p>Note: Soil Sampling performed every three (3) years. Sampling was performed in 2006, and is next due in 2009.</p>							
K-40							
Mn-54							
Fe-59							
Co-58							
Co-60							
Zn-65							
Zr-95							
Nb-95							
Cs-134							
Cs-137							

SECTION 2 - ENVIRONMENTAL MONITORING PROGRAM

Table 2-2

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

Name of Facility: Beaver Valley Power Station Unit 1 and Unit 2

Docket No.: 50-334 / 50-412

Location of Facility: Beaver County, Pennsylvania

Reporting Period: Calendar Year - 2008

Medium: Soil (page 2 of 2)

Unit of Measurement: (pico Curies / gram) Dry

Type and Total Number of Analysis Performed	Lower Limit of Detection LLD ^(a)	All Indicator Locations Mean (fraction) ^(b) Range ^(b)	Locations with Highest Annual Mean		Control Location		Number of Nonroutine Reported Measurements ^(c)
			Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	
Note: Soil Sampling performed every three (3) years. Sampling was performed in 2006, and is next due in 2009.							
Ba-La-140							
Tl-208							
Bi-214							
Pb-212							
Pb-214							
Ra-226							
Ac-228							

^a Nominal Lower Limit of Detection

^b Mean and range based upon detectable measurements only.
 Fraction of detectable measurements at specified locations is indicated in parentheses (fraction)

^c Nonroutine Reported Measurements (Reference: ODCM procedure 1/2-ODC-3.03, Attachment Q, Control 3.12.1)

NA = Not Applicable (Naturally Occurring Radionuclides Not required by ODCM)

SECTION 2 - ENVIRONMENTAL MONITORING PROGRAM

Table 2-2

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

Name of Facility: Beaver Valley Power Station Unit 1 and Unit 2

Docket No.: 50-334 / 50-412

Location of Facility: Beaver County, Pennsylvania

Reporting Period: Calendar Year - 2006

Medium: External Radiation

Unit of Measurement: (mR / Quarter)

Type and Total Number of Analysis Performed	Lower Limit of Detection LLD ^(a)	All Indicator Locations Mean (fraction) ^(b) Range ^(b)	Locations with Highest Annual Mean		Control Location		Number of Nonroutine Reported Measurements ^(c)
			Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	Name Distance and Direction	Mean (fraction) ^(b) Range ^(b)	
Gamma 511	4.6	18.4 (503 / 503) 11.4 - 26.0	No. 112 BVPS Site Perimeter Location	23.0 (8 / 8) 20.0 - 25.4	No. 48 Weirton, WV Water Tower Collier Way 16.40 miles SSW	20.5 (8 / 8) 18.7 - 24.0	0

^a Nominal Lower Limit of Detection

^b Mean and range based upon detectable measurements only.

Fraction of detectable measurements at specified locations is indicated in parentheses (fraction)

^c Nonroutine Reported Measurements (Reference: ODCM procedure 1/2-ODC-3.03, Attachment Q, Control 3.12.1)

NA = Not Applicable (Naturally Occurring Radionuclides Not required by ODCM)

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Table 2-3

Pre-Operational Environmental Radiological Monitoring Program Summary

Name of Facility: Beaver Valley Power Station Docket No.: 50-334

Location of Facility: Beaver County, Pennsylvania Reporting Period: Calendar years 1974 - 1975

Medium or Pathway Sampled (Unit of Measurement)	Analysis and Total Number of Analysis Performed	Lower Limit of Detection (LLD)	All Indicator Locations Mean, (f) Range		
Sediments (pico Curie /gram) dry	Gross Alpha (0)	--	--	--	--
	Gross Beta (33)	1	18	(33/33)	5 - 30
	Sr-90 (0)	--	--	--	--
	U-234, 235, 238 (0)	--	--	--	--
	Gamma (33)	--	13	(33/33)	2 - 30
	K-40	1.5	13	(33/33)	2 - 30
	Cs-137	0.1	0.4	(21/33)	0.1 - 0.6
	Zr/Nb-95	0.05	0.8	(12/33)	0.2 - 3.2
	Ce-144	0.3	0.5	(3/33)	0.4 - 0.7
	Ru-106(a)	0.3	1.5	(3/33)	1.3 - 1.8
Others	--	--	< LLD	--	--
Foodcrops (pico Curie /gram) dry	Gamma (8)	--	--	--	--
	K-40	1	33	(8/8)	10 - 53
	Cs-137	0.1	0.2	(1/8)	--
	Zr/Nb-95	0.05	0.2	(1/8)	--
	Ru-106(a)	0.3	0.8	(1/8)	--
	Others	--	--	< LLD	--
Feedstuff (pico Curie /gram) dry	Gross Beta (80)	0.05	19	(80/80)	8 - 50
	Sr-89 (81)	0.025	0.2	(33/81)	0.04 - 0.93
	Sr-90 (81)	0.005	0.4	(78/81)	0.02 - 0.81
	Gamma (81)	--	--	--	--
	K-40	1	19	(75/81)	5 - 46
	Cs-137	0.1	0.5	(6/81)	0.2 - 1.6
	Ce-144	0.3	1.5	(5/81)	0.9 - 2.6
	Zr/Nb-95	0.05	0.8	(13/81)	0.2 - 1.8
	Ru-106(a)	0.3	1.4	(12/81)	0.6 - 2.3
	Others	--	--	< LLD	--
Soil - Template Samples - (pico Curie /gram) dry	Gross Alpha (0)	--	--	--	--
	Gross Beta (64)	1	22	(64/64)	14 - 32
	Sr-89 (64)	0.25	0.4	(1/64)	--
	Sr-90 (64)	0.05	0.3	(48/64)	0.1 - 1.3
	U-234, 235, 238 (0)	--	--	--	--
	Gamma (64)	--	--	--	--
	K-40	1.5	13	(63/64)	5 - 24
	Cs-137	0.1	1.5	(56/64)	0.1 - 6.8
	Ce-144	0.3	1.1	(7/64)	0.2 - 3
	Zr/Nb-95	0.05	0.3	(13/64)	0.1 - 2
	Ru-106(a)	0.3	1.1	(3/64)	0.5 - 2
	Others	--	--	< LLD	--

(f) Fraction of detectable measurements at specified location.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Table 2-3 (Continued)

Pre-Operational Environmental Radiological Monitoring Program Summary

Name of Facility: Beaver Valley Power Station Docket No.: 50-334

Location of Facility: Beaver County, Pennsylvania Reporting Period: Calendar years 1974 - 1975

Medium or Pathway Sampled (Unit of Measurement)	Analysis and Total Number of Analysis Performed	Lower Limit of Detection (LLD)	All Indicator Locations Mean, (f) Range
Soil - Core Samples - (pico Curie /gram) dry	Gross Alpha (0)	--	--
	Gross Beta (8)	1	21 (8/8) 16 - 28
	Sr-89 (8)	0.25	< LLD
	Sr-90 (8)	0.05	0.2 (5/8) 0.08 - 0.5
	Gamma (8)	--	--
	K-40	1.5	13 (8/8) 7 - 20
	Cs-137	0.1	1.2 (7/8) 0.2 - 2.4
	Co-60	0.1	0.2 (1/8) --
Others	--	< LLD	
Surface Water (pico Curie / liter)	Gross Alpha (40)	0.3	0.75 (5/40) 0.6 - 1.1
	Gross Beta (120)	0.6	4.4 (120/120) 2.5 - 11.4
	Gamma (1)	10 - 60	< LLD
	Tritium (121)	100	300 (120/121) 180 - 800
	Sr-89 (0)	--	--
	Sr-90 (0)	--	--
	C-14 (0)	--	--
Drinking Water (pico Curie / liter)	I-131 (0)	--	--
	Gross Alpha (50)	0.3	0.6 (4/50) 0.4 - 0.8
	Gross Beta (208)	0.6	3.8 (208/208) 2.3 - 6.4
	Gamma (0)	--	--
	Tritium (211)	100	310 (211/211) 130 - 1000
	C-14 (0)	--	--
	Sr-89 (0)	--	--
Sr-90 (0)	--	--	
Ground Water (pico Curie / liter)	Gross Alpha (19)	0.3	< LLD
	Gross Beta (76)	0.6	2.9 (73/75)(b) 1.3 - 8.0
	Tritium (81)	100	440 (77/81) 80 - 800
	Gamma (1)	10 - 60	< LLD
Air Particulates and Gaseous (pico Curie /cubic meter)	Gross Alpha (188)	0.001	0.003 (35/188) 0.002 - 0.004
	Gross Beta (927)	0.006	0.07 (927/927) 0.02 - 0.32
	Sr-89 (0)	--	--
	Sr-90 (0)	--	--
	I-131 (816)	0.04	0.08 (2/816) 0.07 - 0.08
	Gamma (197)	--	--
	Zr/Nb-95	0.005	0.04 (122/197) 0.01 - 0.16
	Ru-106	0.010	0.04 (50/197) 0.02 - 0.09
	Ce-141	0.010	0.02 (3/197) 0.01 - 0.04
	Ce-144	0.010	0.02 (44/197) 0.01 - 0.04
Others	--	< LLD	

(f) Fraction of detectable measurements at specified location.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Table 2-3 (Continued)

Pre-Operational Environmental Radiological Monitoring Program Summary

Name of Facility: Beaver Valley Power Station Docket No.: 50-334

Location of Facility: Beaver County, Pennsylvania Reporting Period: Calendar years 1974 - 1975

Medium or Pathway Sampled (Unit of Measurement)	Analysis and Total Number of Analysis Performed	Lower Limit of Detection (LLD)	All Indicator Locations Mean, (f) Range
Milk (pico Curie / liter)	I-131 (91)	0.25	0.6 (4/91) 0.3 - 0.8
	Sr-89 (134)	5	7 (4/134) 6 - 11
	Sr-90 (134)	1	5.3 (132/134) 1.5 - 12.8
	Gamma (134)	--	--
	Cs-137	10	13 (19/134) 11 - 16
	Others		< LLD
External Radiation (milli Roentgen / day)	γ - Monthly (599)	0.5 mR*	0.20 (599/599) 0.08 - 0.51
	γ - Quarterly (195)	0.5 mR*	0.20 (195/195) 0.11 - 0.38
	γ - Annual (48)	0.5 mR*	0.19 (48/48) 0.11 - 0.30
Fish (pico Curie / gram) wet	Gross Beta (17)	0.01	1.9 (15/17) 1.0 - 3.2
	Sr-90 (17)	0.005	0.14 (17/17) 0.02 - 0.50
	Gamma (17)	0.5	
	K-40	--	2.4 (17/17) 1.0 - 3.7
	Others	--	< LLD
<p>* LLD in units of mR - Lower end of useful integrated exposure detectability range for a passive radiation detector (TLD).</p> <p>(a) May include Ru-106, Ru-103, Be-7.</p> <p>(b) One outlier not included in mean. (Water taken from dried-up spring with high sediment and potassium content. Not considered typical groundwater sample).</p> <p>(f) Fraction of detectable measurements at specified location.</p>			

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

B. Air Monitoring

1. Characterization of Air and Meteorology

The air in the vicinity of the site contains pollutants typical for an industrial area. Air flow is generally from the southwest in summer and from the northwest in the winter.

2. Air Sampling Program and Analytical Techniques

a. Program

The air is sampled for gaseous radioiodine and radioactive particulates at each of ten (10) offsite air sampling stations. The locations of these stations are listed in Table 2-1 and shown on a map in Figure 2-1.

Samples are collected at each of these stations by continuously drawing two cubic feet per minute of atmosphere air through a glass fiber filter paper and a charcoal cartridge. The glass fiber filter paper is used for collection of airborne particulates, while the charcoal cartridge is used for collection of radioiodine. Samples are collected on a weekly basis.

The charcoal cartridge is used in the weekly analysis of airborne Iodine-131. The glass fiber filter papers are analyzed each week for gross beta, then composited by station each quarter for gamma spectrometry analysis. In order to reduce interference from short-lived naturally occurring radioactivity (e.g.; radon and thorium), the glass fiber filter papers are decayed prior to performing beta analysis in a low background counting system.

b. Procedures

Gross Beta Analysis of Filter Paper: Analysis is performed by placing the glass fiber filter paper from the weekly air sample in a 2 inch planchet and analyzing it in a low background, gas flow proportional counter.

Gamma Emitter Analysis of Filter Paper: Analysis is performed by stacking all of the glass fiber filter papers collected from each monitoring station during the quarter and scanning this composite on a high resolution germanium gamma spectrometer.

Iodine-131 Analysis of Charcoal Cartridge: Analysis is performed by a gamma scan of each charcoal cartridge.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

3. Results and Conclusions

A summary of data is presented in Table 2-2.

a. Airborne Radioactive Particulates

Gross Beta: A total of five-hundred-ten (510) weekly samples from ten (10) locations were analyzed for gross beta. Results were comparable to previous years. Figure 2-2 indicates the weekly average concentration of gross beta in air particulates.

During the period 05/19/08 - 05/27/08, the Gross Beta Results were unusually low. Specifically, the Gross Beta results for the ten (10) air particulate sample stations ranged from 0.011 - 0.014 pCi/cubic meter, where as the cumulative average ranged from 0.022 to 0.025 pCi/cubic meter. As noted, this condition existed at all nine (9) indicator locations and at the one (1) control location. This issue was discussed with the REMP Administrators at the other two FENOC sites (i.e.; Davis-Besse Nuclear Power Plant and the Perry Nuclear Power Plant), and they also noted similar decreases in Gross Beta results during this period. There is no consequence to unusually low sample results at the indicator and control locations. The cause is most likely due to cosmic phenomenon. This issue is documented in SAP Order 200197646-0640.

During the period 11/02/08 - 11/10/08, the Gross Beta Results were unusually high. Specifically, the Gross Beta results for all ten (10) air particulate sample stations ranged from 0.034 - 0.051 pCi/cubic meter, where as the cumulative average ranged from 0.024 to 0.026 pCi/cubic meter. As noted, this condition existed at all nine (9) indicator locations and at the one (1) control location. This issue was discussed with the REMP Administrators at the other two FENOC sites (i.e.; Davis-Besse Nuclear Power Plant and the Perry Nuclear Power Plant), and they also noted similar increases in Gross Beta results during this period. There is no consequence to unusually high sample results at the indicator and control locations. The cause is most likely due to cosmic phenomenon. This issue is documented in SAP Order 200197646-0640.

Gamma Spectrometry: The weekly air particulate samples were composited into forty (40) quarterly samples which were analyzed by gamma spectrometry. Naturally occurring Beryllium-7 was identified in thirty-six of thirty-six (36 of 36) indicator samples, and four of four (4 of 4) control samples. No other radionuclides were detected. A summary of the analysis results during the report period are listed in Table 2-2. A trend graph of analyses (including the pre-operational period through the report period) is shown on Figure 2-2.

Deviations from Required Sampling and Analysis Schedule: There were some deviations from the required airborne particulate sampling and analysis schedule during the report period. Specifically, during the sampling period of 02/25/08 - 03/03/08, the Air Particulate and Iodine Sampling Station at the Shippingport, PA Cooks Ferry Substation (Site No. 30, 0.43 miles ENE) was interrupted for 76 hours due to an undeterminable power loss. During the sampling period of 03/24/08 - 03/31/08, the Air Particulate and Iodine Sampling Station at East Liverpool, OH Water Department (Site No. 47, 4.88 miles WNW) was interrupted for 103 hours due to shattered vanes in the sample pump. During the sampling periods of 06/02/08 - 06/09/08, 06/16/08 - 06/23/08, and 06/30/08 - 07/05/08, the Air Particulate and Iodine Sampling Station at Hookstown, PA (Site No. 13, 1.49 miles SW) was interrupted for 23 hours, 58 hours and 45 hours, respectively due to power losses from blown fuses. After each

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

of the power losses, the fuses were replaced and the sample pumps were successfully restarted. The power loss condition was resolved on 07/07/08 by removing an extension cord not associated with BVPS-REMP air sampling equipment. During the sampling period of 09/02/08 - 09/08/08, the Air Particulate and Iodine Sampling Station at the Shippingport, PA Cooks Ferry Substation (Site No. 30, 0.43 miles ENE) was interrupted for 114 hours due to shattered vanes in the sample pump. All Air Particulate and Iodine Samples obtained for the sampling period of 09/02/08 - 09/08/08 were discarded by the shipper, because they were damaged during shipment. Although these are not missed samples (i.e., the samples were obtained), no sample analyses are available for this sample period. During the sampling periods 09/08/08 - 09/15/08, and 09/15/08 - 09/22/08, the nine (9) Air Particulate and Iodine Sampling Stations (Indicator Locations) were interrupted for various periods of time. The interruptions were all related to power outages caused by hurricane Ike thunderstorms that entered the area on 09/14/08. During this period, sampling was interrupted for periods from 12 hours to 72 hours. During the sampling period of 11/17/08 - 11/24/08, the Air Particulate and Iodine Sampling Station at the Midland, PA North Substation (Site No. 32, 0.75 miles NW) was interrupted for 93 hours due to shattered vanes in the sample pump. SINCE BVPS uses ten (10) airborne particulate sample stations versus five (5) required by the ODCM, THEN there was no consequence to interruption of sample collection during these periods. This condition is documented in SAP order 200197646-0490.

Summary: Based on the analytical results, the operation of BVPS did not contribute any measurable increase in air particulate radioactivity during the report period.

b. Airborne Radioiodine

Iodine-131: A total of five-hundred-ten (510) weekly charcoal filter samples were analyzed for Iodine-131. No detectable concentrations were present at any locations.


Deviations from Required Sampling and Analysis Schedule: The deviations are the same as described above for airborne particulates.

Summary: Based on analytical results, the operation of BVPS did not contribute any measurable increase in airborne radioiodine during the report period.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Figure 2-1

Environmental Monitoring Locations - Air Sampling Stations

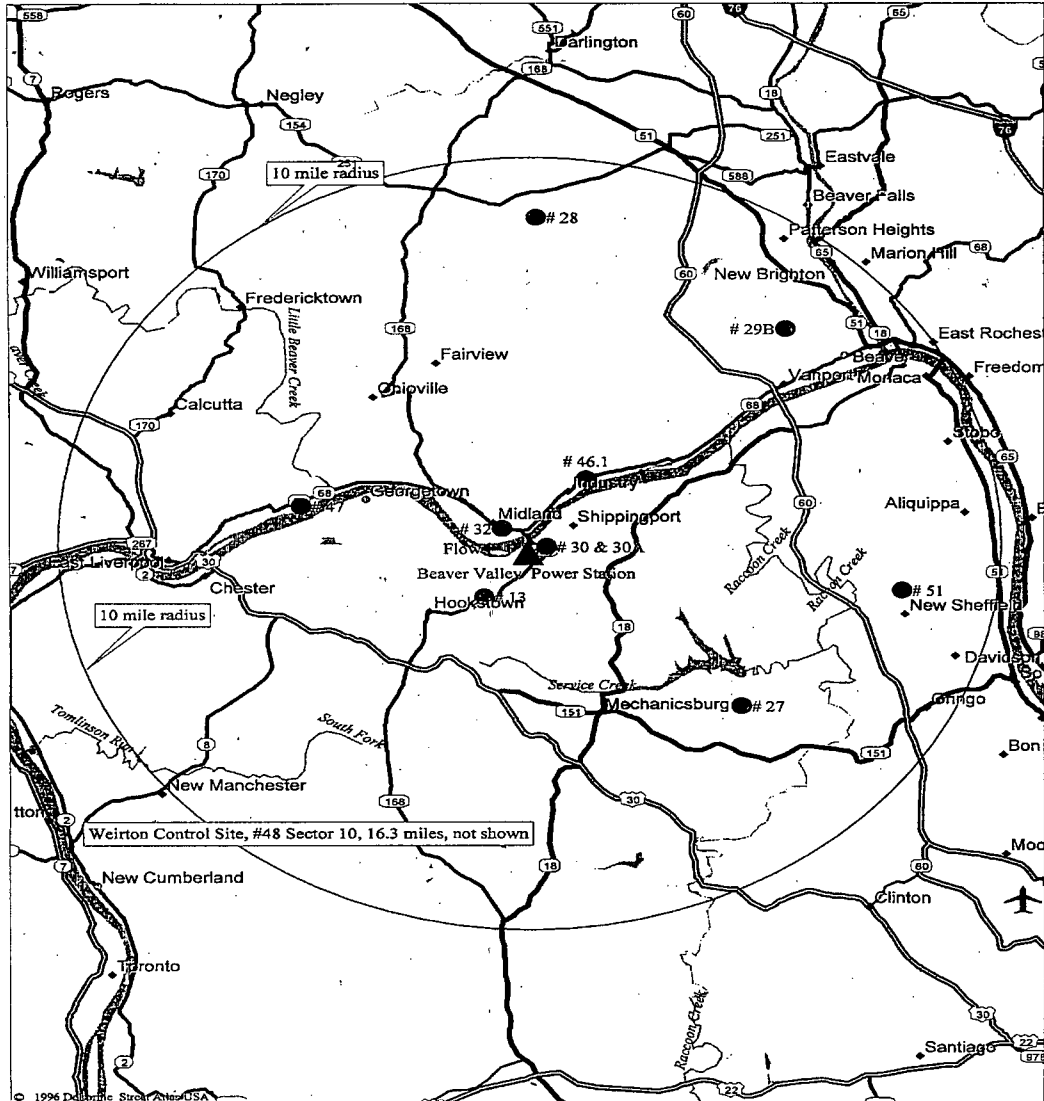


Sample Type	Site No.	Sector	Distance (miles)	Sample Point Description
Air Particulate & Radioiodine	13	11-SW	1.49	Hookstown, PA (Old Meyer Farm)
	27	7-SE	6.14	Aliquippa, Pa (Brunton Farm)
	28	1-N	8.60	Beaver Falls, PA (Sherman Farm)
	29B	3-NE	7.97	Beaver, PA (Friendship Ridge)
	30	4-ENE	0.43	Shippingport, PA (Cook's Ferry Substation)
	32	15-NW	0.75	Midland, PA (North Substation - Rt. 68)
		2-NNE		
	46.1	3-NE	2.28	Industry, PA (McKeels Service - Rt. 68)
	47	14-WNW	4.88	East Liverpool, OH (Water Department)
	48	10-SSW	16.40	Weirton, WV (Water Tower, Collier Way)
	51	5-E	8.00	Aliquippa, PA (Sheffield Substation)

SECTION 2 - ENVIRONMENTAL MONITORING PROGRAM

Figure 2-2

Graph of Annual Average Concentration: Gross Beta in Air Particulates

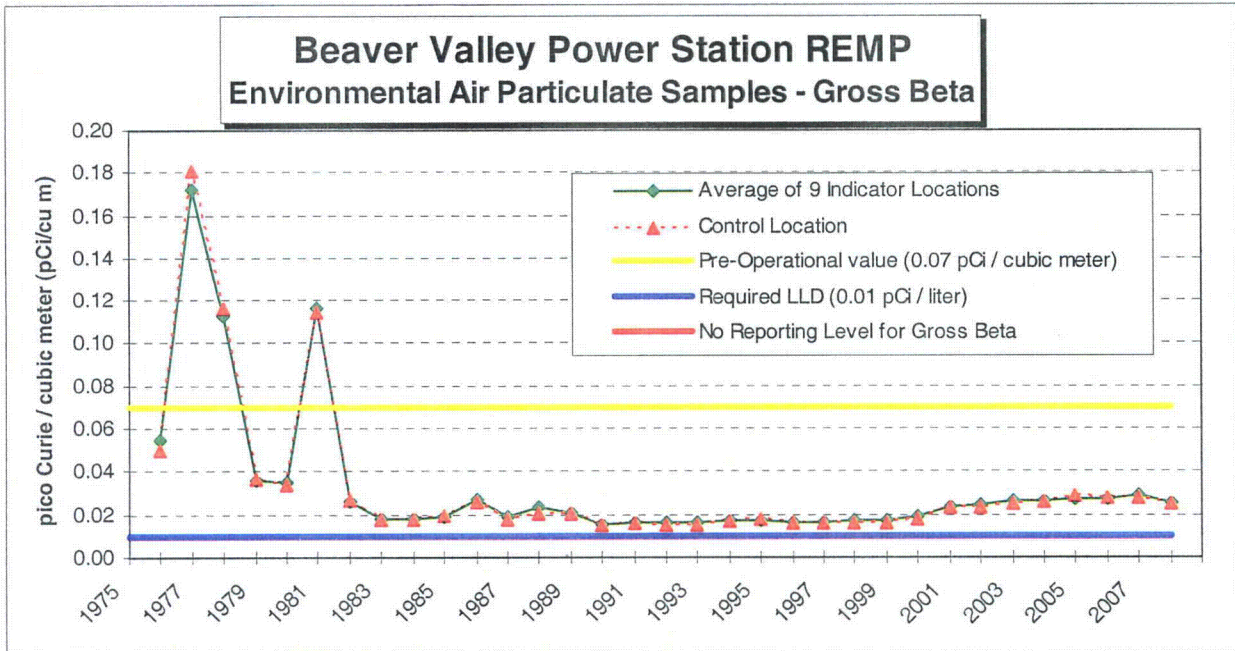

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

C. Monitoring of Shoreline Stream Sediment and Soil

1. Characterization of Shoreline Stream Sediment and Soil

The stream sediment (river bottoms) consists largely of sand and silt. Soil samples may vary from sand and silt to a heavy clay with variable amounts of organic material.

2. Sampling Program and Analytical Techniques

a. Program

Shoreline stream sediment were collected semi-annually above the Montgomery Dam, in the vicinity of the BVPS outfall structure, and above the New Cumberland Dam. A Ponar or Eckman dredge is used to collect the sample. The sampling locations are also listed in Table 2-1 and are shown in Figure 2-3.

Although not required by the ODCM, soil samples are collected every three years. They were collected at each of ten (10) locations during 2006 and are not due to be collected again until 2009. At each location, twelve (12) core samples (3" diameter by 2" deep) are gathered at prescribed points on a 10 foot radius circle. Each location is permanently marked with reference pins. Each set of samples is systematically selected by moving along the radius in such a manner as to assure representative undisturbed samples. Sampling locations are listed in Table 2-1 and are shown in Figure 2-3.

Shoreline stream sediment and soil are analyzed for gamma-emitting radionuclides.

b. Analytical Procedures

Gamma Emitter Analysis of Stream Sediment: Analysis is performed in a 300 ml plastic bottle, which is analyzed by gamma spectrometry.

Gamma Emitter Analysis of Soil: Although not required by the ODCM, analysis is performed in a 300 ml plastic bottle, which is analyzed by gamma spectrometry

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

3. Results and Conclusions

A summary of the analysis results during the report period are listed in Table 2-2. A trend graph of analyses (including the pre-operational period through the report period) is shown on Figure 2-4 and Figure 2-5.

a. Shoreline Stream Sediment

Gamma Spectrometry: A total of six (6) sediment samples were analyzed by gamma spectrometry during the report period. Naturally occurring Potassium-40, Thallium-208, Lead-212, Lead-214, Bismuth-214, Radium-226 and Actinium-228, were detected in four of four (4 of 4) indicator samples and two of two (2 of 2) control samples.

Cesium-137: This radionuclide was identified in two of four (2 of 4) indicator samples and two of two (2 of 2) control samples. The results were similar to previous years (current years range = 0.06 to 0.13 pico Curie / gram), and less than the pre-operational level of 0.4 pico Curie / gram. Also, SINCE Cesium-137 was identified at the control location (upstream), THEN it was not due to plant effluent releases and is most likely residual contamination due from previous nuclear weapons tests.

Cobalt-58: Radionuclide Cobalt-58 was identified in two of four (2 of 4) indicator samples and zero of two (0 of 2) control samples. The samples that indicated Cobalt-58 were obtained at the shore line of the main outfall facility. The results were similar to previous years (current years range = 0.08 to 0.08 pico Curie / gram), and this data is currently less than the pre-operational level of 0.098 pico Curie / gram.

Cobalt-60: Radionuclide Cobalt-60 was identified in two of four (2 of 4) indicator samples and zero of two (0 of 2) control samples. The samples that indicated Cobalt-60 were obtained at the shore line of the main outfall facility. The results were similar to previous years (current years range = 0.11 to 0.19 pico Curie / gram), and this data is currently less than the pre-operational level of 0.4 pico Curie / gram.

Deviations from Required Sampling and Analysis Schedule: There were no deviations from the required sediment sampling and analysis schedule during the report period.

Summary: The identification of Cobalt-58 and Cobalt-60 in the shoreline stream sediment near the main outfall facility is not unusual, because the plant discharges these radionuclides in liquid effluent releases. The analyses are consistent with discharge data of authorized liquid effluent releases, and all liquid effluent releases during the report period did not exceed the release limits set forth in the ODCM.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM


b. Soil

Although not required by the ODCM, soil is sampled every three years and was sampled in 2006. Soil sampling will be performed during calendar year 2009.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Figure 2-4


Graph of Annual Average Concentration: Cesium-137, Cobalt-58 & Cobalt-60 in Sediment

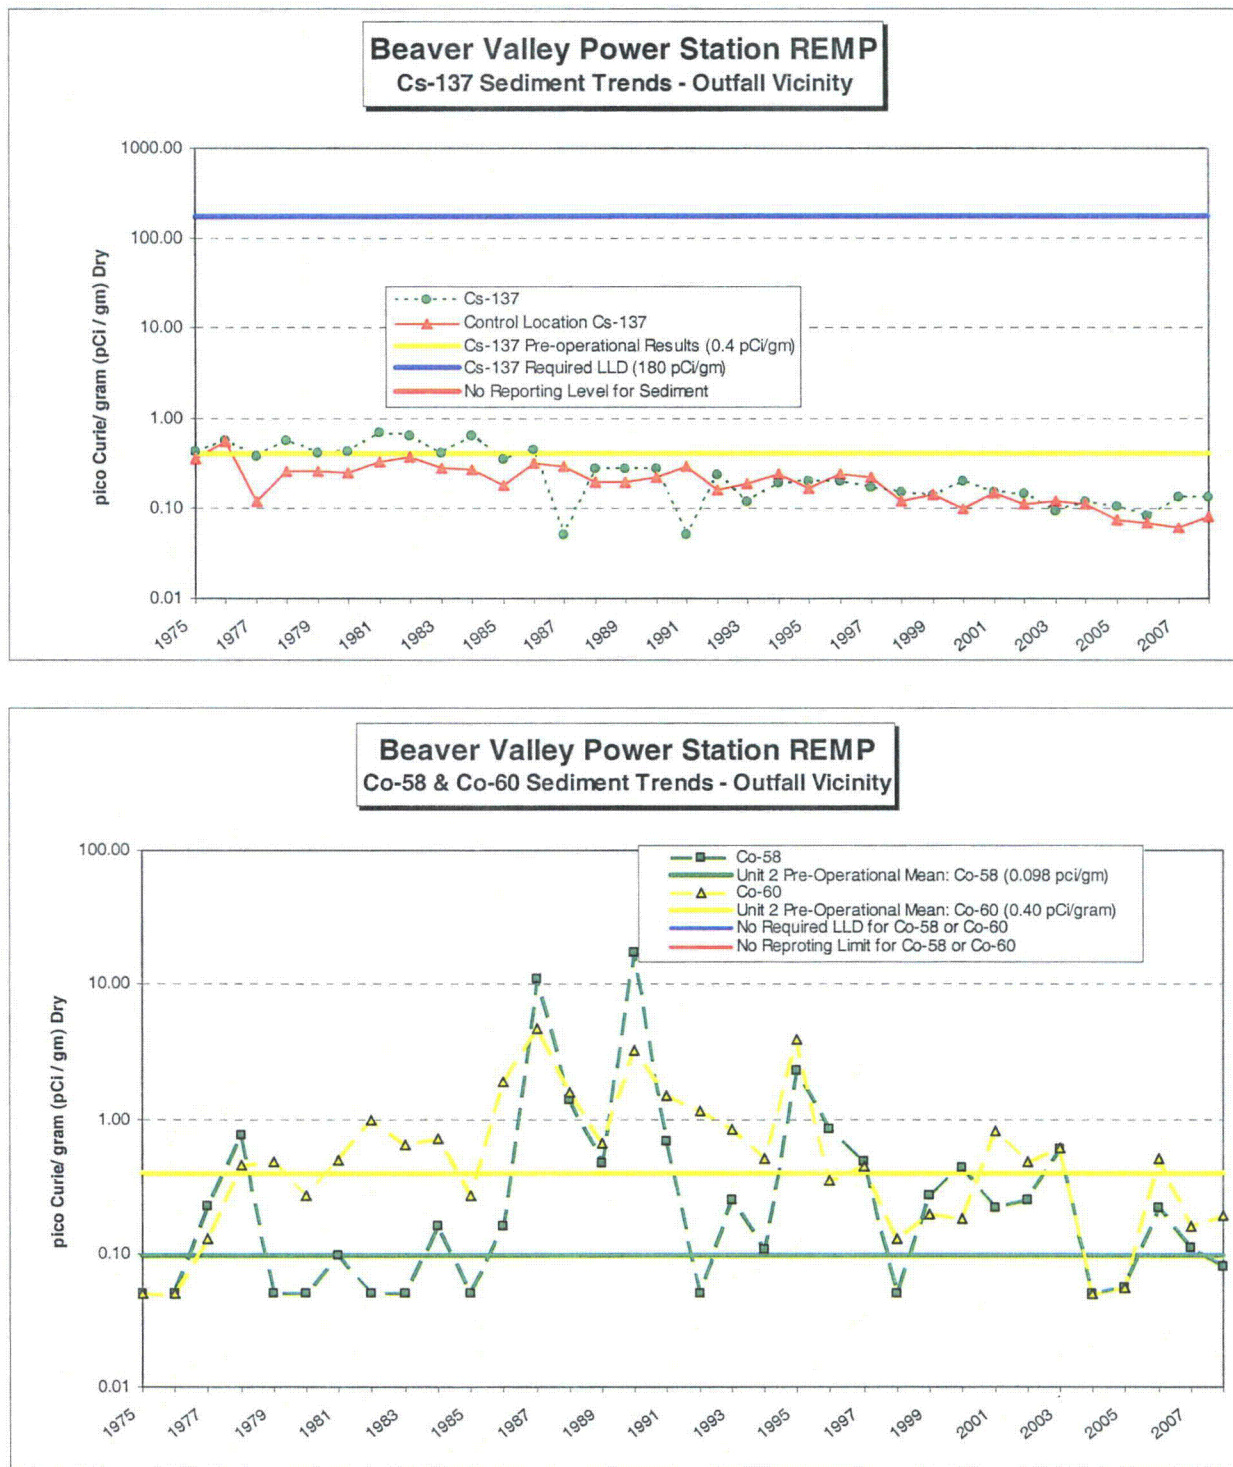

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Figure 2-5

Graph of Annual Average Concentration: Cesium-137 in Soil

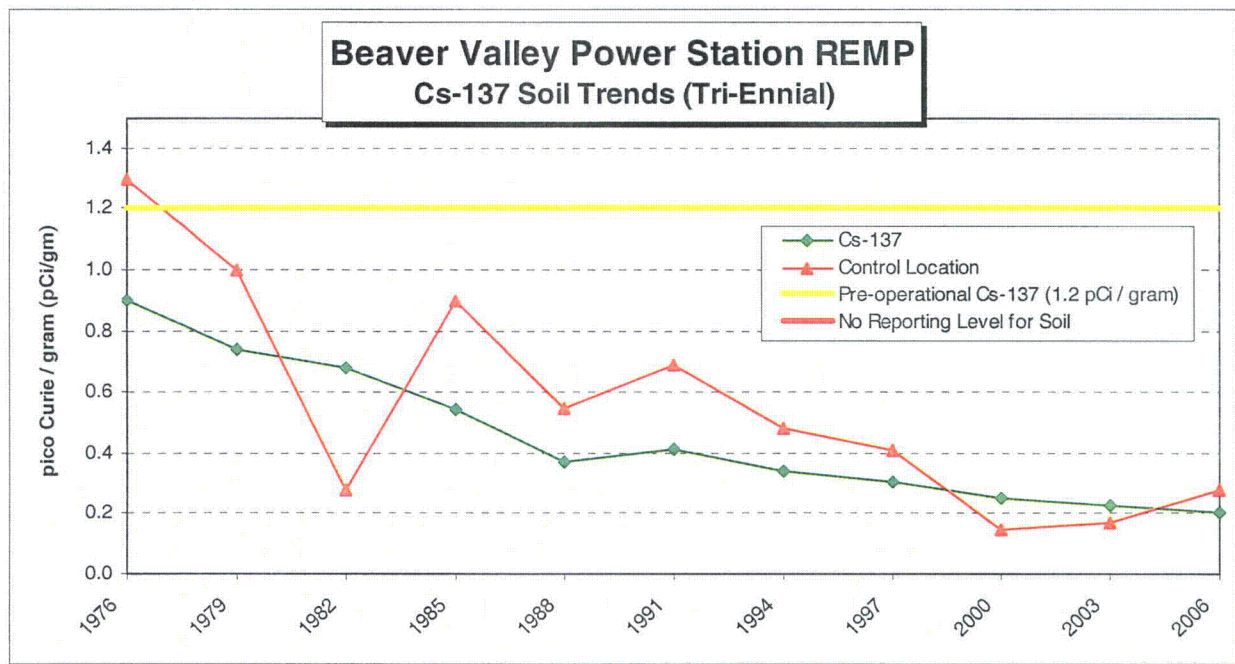

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

D. Monitoring of Feedstuff and Foodcrops

1. Characterization of Farm Products

According to the 2007 Census of Agriculture ⁽¹⁾, there were 824 farms in Beaver County. Total market value of production (Crops and Livestock) was \$15,187,000.00. Some of the principal sources of revenue (>\$50,000.00) are as follows:

Milk and Other Dairy Products from Cows	\$5,647,000.00
Nursery, Greenhouse, Floriculture and Sod	\$2,813,000.00
Grains, Oil Seeds, Dry Beans and Dry Peas	\$1,243,000.00
Other Crops and Hay	\$1,120,000.00
Vegetables, Melons, Potatoes and Sweet Potatoes	\$989,000.00
Fruits, Tree Nuts and Berries	\$449,000.00
Poultry and Eggs	\$327,000.00
Cut Christmas Trees, and Short Rotation Woody Crops	\$204,000.00
Horses, Ponies, Mules, Burros, and Donkeys	\$182,000.00
Sheep, Goats and their Products	\$90,000.00
Hogs & Pigs	Undisclosed Amount
Aquaculture	Undisclosed Amount
Cattle and Calves	Undisclosed Amount
Other Animals and Other Animal Products	Undisclosed Amount

(1) http://www.agcensus.usda.gov/Publications/2007/Online_Highlights/County_Profiles/Pennsylvania/index.asp

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

2. Sampling Program and Analytical Techniques

a. Program

Feedstuff: Although not required by the ODCM, representative samples of Feedstuff (cattle feed) are collected monthly from the nearest dairy farm (Searight Dairy). See Figure 2-6. Each sample is analyzed by gamma spectrometry.

Foodcrops (leafy vegetables): Foodcrops are collected at garden locations during the growing season. Leafy vegetables, (e.g.; cabbage) are obtained from Shippingport, Georgetown, and Industry, Pennsylvania. Samples are also obtained from the control location in Weirton, West Virginia. All samples are analyzed for gamma emitters by gamma spectrometry. Samples are also analyzed by radiochemical analysis for Iodine-131.

b. Procedures

Gamma Emitter Analysis of Foodcrops: Analysis is performed by scanning a dried, homogenized sample with a gamma spectrometry system. A high resolution germanium detector is utilized with this system. Samples of feedstuff and foodcrops are loaded into tare weight 300 or 150 ml plastic bottles or 1-liter Marinelli containers, weighed and the net weight of the sample is determined prior to scanning for gamma emitters.

Gamma Emitter Analysis of Feedstuff: Although not required by the ODCM, analysis is performed by scanning a dried, homogenized sample with a gamma spectrometry system. A high resolution germanium detector is utilized with this system. Samples of feedstuff and foodcrops are loaded into tare weight 300 or 150 ml plastic bottles or 1-liter Marinelli containers, weighed and the net weight of the sample is determined prior to scanning for gamma emitters.

Iodine-131 Analysis of Foodcrops: Analysis is performed by radiochemistry. A stable iodide carrier is added to a chopped sample, which is then leached with a sodium hydroxide solution, evaporated to dryness and fused in a muffle furnace. The melt is dissolved in water, filtered and treated with sodium hypochlorite. The iodate is then reduced to iodine with hydroxylamine hydrochloride and is extracted into toluene. It is then back-extracted as iodide into sodium bisulfite solution and is precipitated as palladium iodide. The precipitate is weighed for chemical yield and is mounted on a nylon planchet for low level beta counting.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

3. Results and Conclusions

A summary of the analysis results during the report period are listed in Table 2-2. A trend graph of analyses (including the pre-operational period through the report period) is shown on Figure 2-7.

a. Feedstuff

Gamma Spectrometry: Although not required by the ODCM, a total of twelve (12) samples were analyzed by gamma spectrometry. Naturally occurring Potassium-40 was identified in twelve of twelve (12 of 12) samples. Naturally occurring Beryllium-7 was found in five of twelve (5 of 12) samples.

Deviations from Required Sampling and Analysis Schedule: There were no deviations from the required feedstuff sampling and analysis schedule during the report period.

Summary: The data from the feedstuff analyses was consistent with previous data. Based on the analytical results, the operation of BVPS did not contribute any measurable increase in radioactivity in the feedstuff in the vicinity of the site during the report period.

b. Foodcrops

Iodine-131: A total of five (5) samples were analyzed for Iodine-131. No detectable concentrations were present in the four (4) indicator samples or the one (1) control sample.

Gamma Spectrometry: A total of five (5) samples were analyzed by gamma spectrometry. Naturally occurring Potassium-40 was identified in four of four (4 of 4) indicator samples and one of one (1 of 1) control samples. No other radionuclides were identified.


Deviations from Required Sampling and Analysis Schedule: There were no deviations from the required foodstuff sampling and analysis schedule during the report period.

Summary: The data from the foodcrops analyses was consistent with previous data. Based on the analytical results, the operation of BVPS did not contribute any measurable increase in radioactivity in the foodcrops in the vicinity of the site during the report period.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Figure 2-6

Environmental Monitoring Locations – Feedstuff and Foodcrops

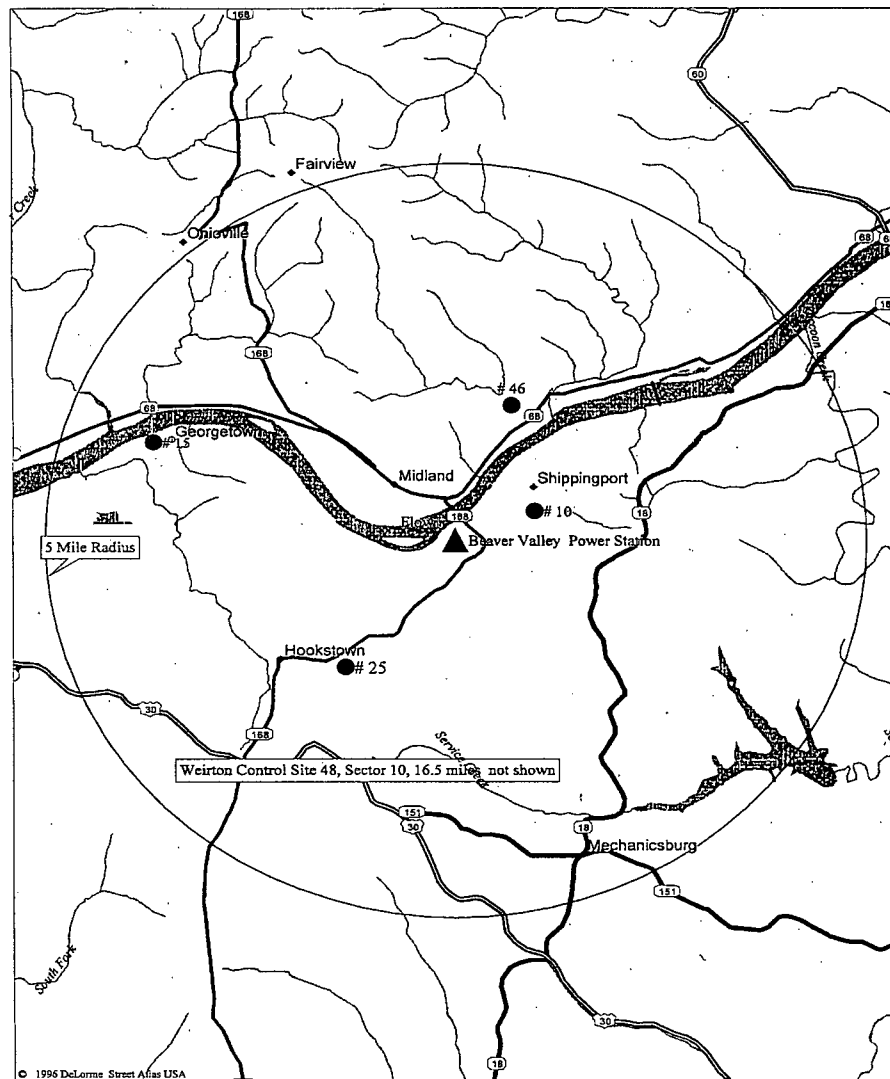


Sample Type	Site No.	Sector	Distance (miles)	Sample Point Description
Feed	25	10-SSW	2.10	Hookstown, PA (Searight Farm)
Food	10a	4-ENE	1.02	Shippingport, PA
	15a	14-WNW	3.55	Georgetown, PA
	46a	3-NE	3.39	Industry, PA
	48a	10-SSW	16.54	Weirton, WV

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Figure 2-7

Graph of Annual Average Concentration: Cesium-137 in Feedstuff and Foodcrops

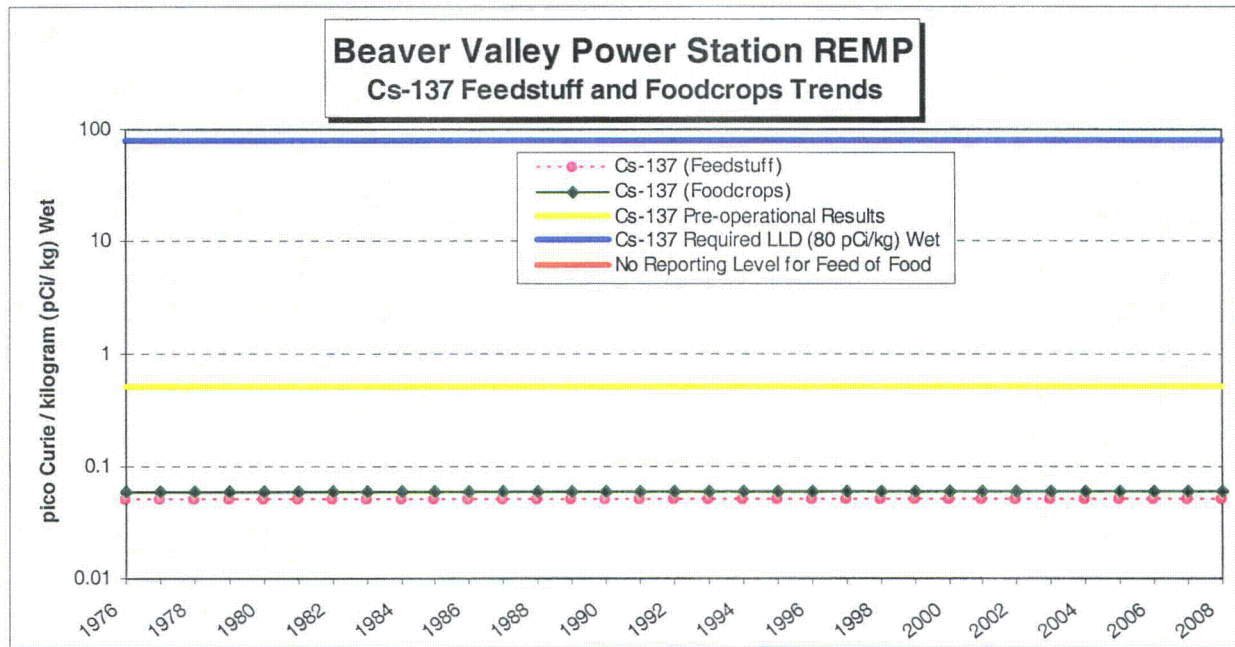

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

E. Monitoring of Local Cow and Goat Milk

1. Description - Milch Animal Locations

Samples of fresh milk are obtained from milch animals at locations and frequencies noted in Table 2-1. The milk is analyzed for its radioiodine content, gamma emitters, Strontium-89 and Strontium-90.

Detailed field surveys are performed during the grazing season to locate and enumerate milch animals within a five (5) mile radius of the site. Survey data for the most recent survey conducted is shown in Section 3, Land Use Census.

2. Sampling Program and Analytical Techniques

a. Program

Cow milk was collected from the two (2) reference dairy farms within a 10-mile radius of the BVPS. These milk samples were obtained at the Searight Dairy Farm (2.10 miles SSW) and the Brunton Dairy Farm (6.16 miles SE).

Cow milk and goat milk were also collected from two (2) other dairy farms within a 10-mile radius of the BVPS site. The goat milk samples obtained at the Collins Dairy Farm (3.55 miles SE) and the cow milk samples obtained at the Halstead Dairy Farm (5.08 miles SSW) were selected based on milch animal surveys and evaluations of meteorological data (i.e.; deposition parameters). They were added to the sampling program to ensure the highest potential milk pathway for radioiodine uptake is evaluated. The dairies are subject to change based upon availability of milk or when more recent data (milch animal census, and/or change in meteorological conditions) indicate other locations are more appropriate.

Cow milk was also collected from the one (1) control location dairy farm outside of the 10-mile radius. These milk samples were obtained at the Windsheimer Dairy Farm (10.48 miles SSW).

The cow milk sample from the Searight Dairy Farm (2.10 miles SSW) is collected and analyzed weekly for Iodine-131 using a method that ensures a high sensitivity. Samples from each of the other dairies are collected monthly when cows are indoors and bi-weekly when cows are grazing. The monthly and/or bi-weekly sample is analyzed for principle gamma emitters (including Cesium-137 by high resolution germanium gamma spectrometry), and Iodine-131 high sensitivity analysis. Although not required by the ODCM, the monthly and/or bi-weekly sample is also analyzed for Strontium-89, Strontium-90.

During the 2008 Land Use Census, it was determined that a new heard of doe goats is located at the Sullivan Farm (4.285 miles ESE), and the Ferry Farm (3.32 miles SE) has again obtained a doe goat. No goat milk samples were available from either of these locations during 2008, because, the goats were already dry at time of the Land Use Census. However, both locations may provide goat milk samples during 2009.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

The location of each is shown in Figure 2-8 and described below.

Site	Dairy	Approximate Number of Animals being Milked	Distance and Direction from Midpoint between Unit 1 and Unit 2 Reactor	Collection Period
25	Searight Dairy 948 McCleary Road Hookstown, PA	38 Cows	2.10 miles SSW	January thru December
27a	Brunton Dairy 3681 Ridge Road Aliquippa, PA	108 Cows	6.16 miles SE	January thru December
69*	Collins Dairy 289 Calhoun Road Aliquippa, PA	1 Goats	3.55 miles SE	March thru August
96	Windsheimer Dairy RD #11 Burgettstown, PA	75 Cows	10.48 miles SSW	January thru December
113*	Halstead Dairy 104 Tellish Drive Hookstown, PA	60 Cows	5.08 miles SSW	January thru December
102	Ferry Farm 227 Calhoun Rd Aliquippa, PA	1 Goat	3.32 miles SE	Not Applicable: No goat milk available during 2008
115	Sullivan Farm 198 Wilson Lane Aliquippa, PA	5 Goats	4.29 miles ESE	Not Applicable: No goat milk available during 2008
* Highest potential pathway dairies based on evaluation of deposition parameters				

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

b. Procedure

Iodine-131 Analysis of Milk: The milk samples are chemically prepared, and then analyzed with a low-level beta counting system.

Gamma Emitter Analysis of Milk: This is determined by gamma spectrometry analysis of a 1 liter Marinelli container of milk.

Strontium-90 Analysis of Milk: Although not required by the ODCM, the milk samples are prepared by adding a stable strontium carrier and evaporating to dryness, then ashing in a muffle furnace, followed by precipitating phosphates. Strontium is purified in all samples by the Argonne method using 3 grams of extraction material in a chromatographic column. Stable yttrium carrier is added and the sample is allowed to stand for a minimum of 5 days for the in-growth of Yttrium-90 (Y-90). Yttrium is then precipitated as hydroxide dissolved and re-precipitated as oxalate. The yttrium oxalate is mounted on a nylon planchet and is counted in a low-level beta counter to infer Strontium-90 activity.

Strontium-89 Analysis of Milk: Although not required by the ODCM, the Strontium-89 activity is determined by precipitating strontium carbonate (SrCO_3) from the sample after yttrium separation. This precipitate is mounted on a nylon planchet and is covered with an 80 mg/cm^2 aluminum absorber for low level beta counting. Chemical yields of strontium and yttrium are determined by gravimetric means.

3. Results and Conclusions

A summary of the analysis results during the report period are listed in Table 2-2. A trend graph of Iodine-131 and Strontium-90 analyses (including the pre-operational period through the report period) is shown on Figure 2-9.

- a. Strontium-89: Although not required by the ODCM, a total of ninety-two (92) milk samples were analyzed for Strontium-89 during the report period. Strontium-89 was not detected in any of the seventy-two (72) indicator samples, nor was it detected in any of the twenty (20) control samples.
- b. Strontium-90: Although not required by the ODCM, a total of ninety-two (92) milk samples were analyzed for Strontium-90 during the report period. Strontium-90 was detected in sixty-six of seventy-two (66 of 72) indicator samples and nineteen of twenty (19 of 20) control samples. The levels detected were attributable to previous nuclear weapons tests and are within the normally expected range.
- c. Gamma Spectrometry: A total of ninety-two (92) milk samples were analyzed by gamma spectrometry during the report period. Naturally occurring Potassium-40 was present in seventy-two of seventy-two (72 of 72) indicator samples and twenty of twenty (20 of 20) control samples. No other gamma-emitting radionuclides were identified during analysis.


SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

- d. Iodine-131: A total of one hundred twenty-four (124) milk samples were analyzed for Iodine-131 during the report period. Iodine-131 was not detected in any of the one hundred four (104) indicator samples, nor was it detected in any of the twenty (20) control samples. All analyses were less than the 0.5 pico Curie / liter LLD value.
- e. Deviations from Required Sampling and Analysis: The Bi-weekly Doe Goat milk sampling at the only Doe Goat Location (Site No. 69, 3.547 miles SE), as identified in the Land Use Census, were interrupted during 2008. Specifically, the Doe Goats at this location ceased production of milk in September 2008. Although the Doe Goats could not be sampled during that period, the minimum Bi-weekly milk sampling requirements of ODCM procedure 1/2-ODC-3.03, Attachment Q, Table 3.12-1 were still met. Specifically, SINCE only 4 Bi-Weekly Dairy Cow and/or Doe Goat locations are required to be sampled, THEN the minimum requirement was met with 4 Dairy Cow milk samples. Also, two (2) of the four (4) Bi-weekly milk samples obtained on 09/08/08 were discarded by the shipper, because they were damaged during shipment. Although the samples were obtained, no sample analyses for the Brunton Dairy (Site No. 27a, 6.16 miles SE) and the Windsheimer Dairy (Site No. 96, 10.48 miles SSW) were available for this Bi-weekly sample period. This condition is documented in SAP Order 200197646-0650.
- f. Summary: Based on all the analytical results and the comparison to pre-operational levels, the operation of BVPS did not contribute any measurable increase in radioactivity in the milk in the vicinity of the site during the report period.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Figure 2-8

Environmental Monitoring Locations - Milk

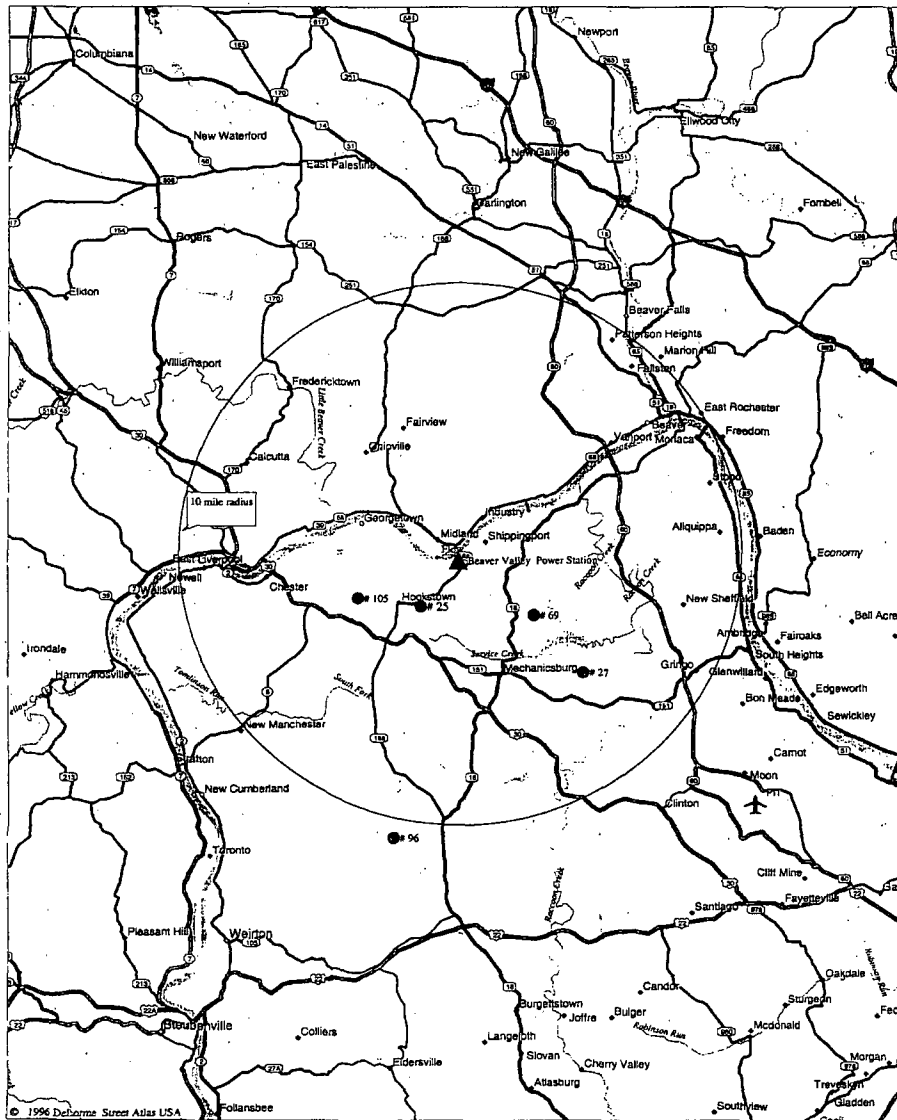



Sample Type	Site No.	Sector	Distance (miles)	Sample Point Description
Milk	25	10-SSW	2.10	Hookstown, PA (Searight Farm)
	27a	7-SE	6.16	Aliquippa, PA (Brunton Farm)
	69*	7-SE	3.55	Aliquippa, PA (Collins Farm)
	96	10-SSW	10.48	Burgettstown, PA (Windsheimer Farm)
	113*	10-SSW	5.08	Hookstown, PA (Halstead Farm)
	114*	11-SW	2.12	Hookstown, PA (Moore Farm)

* Dairies selected based on evaluation of deposition parameters

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Figure 2-9

Graph of Annual Average Concentration: Iodine-131 & Sr-90 in Milk

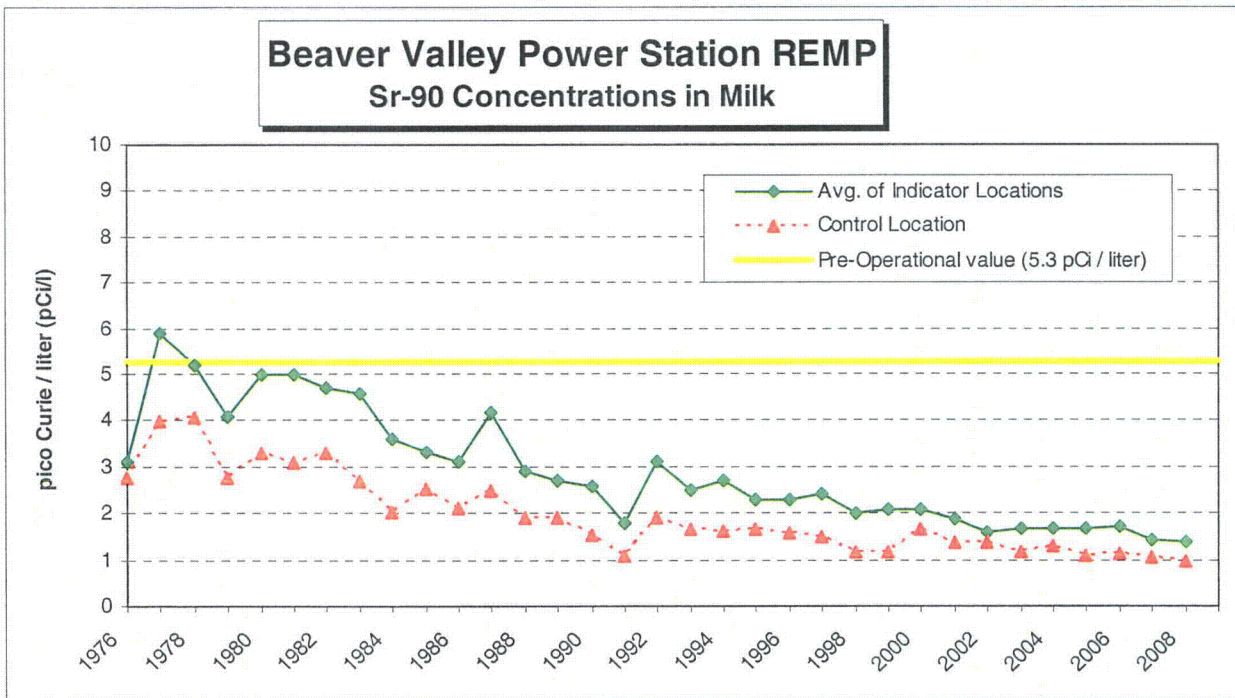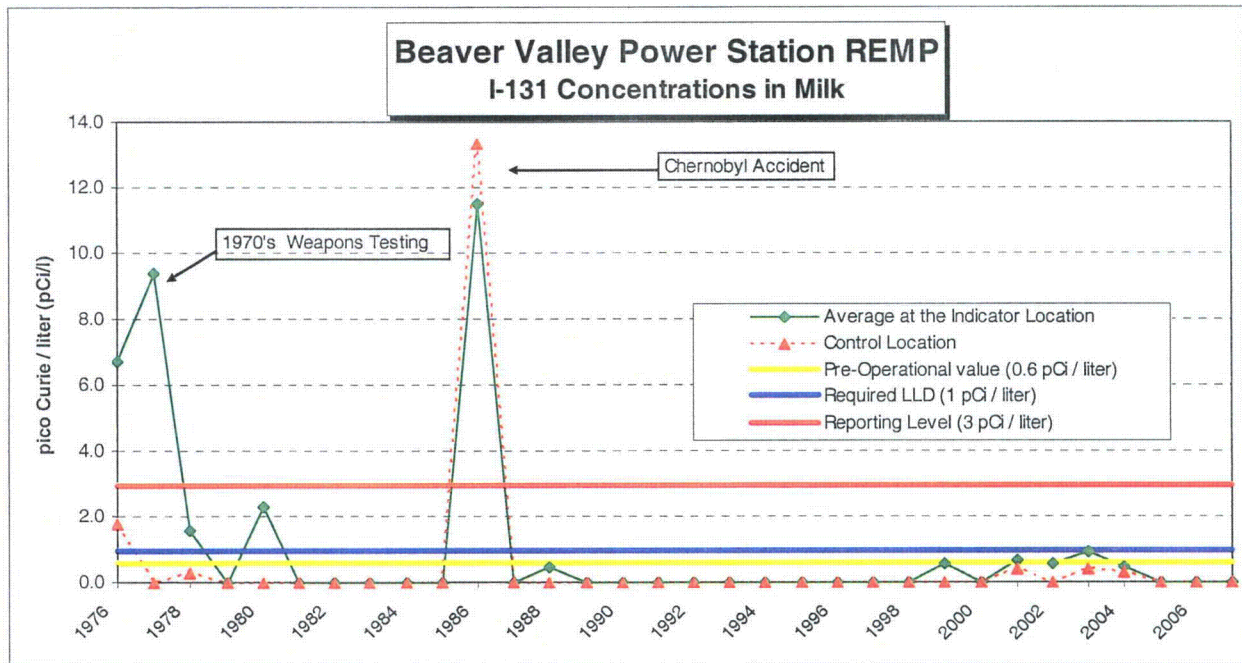

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

F. Environmental Radiation Monitoring

1. Description of Regional Background Radiation and Sources

Historical information for regional background was obtained from Reuter-Stokes instruments that were previously located within a five (5) mile radius of the BVPS site. Data is no longer available from these instruments, but historical data indicated that the background exposure rates ranged from 6 $\mu\text{R/hr}$ to 12 $\mu\text{R/hr}$.

The sources of background radiation are affected by the terrain in the vicinity of BVPS, where as, the local hills (i.e., with altitude variations of 300-400 feet) and densely wooded areas contribute to differences in background radiation level. Other sources (e.g., Radon) are affected by the geological features of the region, which are characterized by nearly flat-laying sedimentary beds of the Pennsylvania Age. For information, the local sedimentary beds of limestone alternate with sandstone and shale with abundant interbedded coal layers. Pleistocene glacial deposits partially cover the older sedimentary deposits in the northwest. Most of the region is underlain by shale, sandstone, and some coal beds of the Conemaugh Formation. Outcrops of sandstone, shale, and limestone of the Allegheny Formation exist within the Ohio River Valley and along major tributary streams.

2. Locations and Analytical Procedures

Ambient external radiation levels around the site were measured using thermoluminescent dosimeters (TLDs).

During the report period, there were a total of sixty-four (64) environmental TLD locations. This is comprised of forty-four (44) offsite locations, along with twenty (20) fence perimeter locations. The offsite TLD locations are plotted on Figure 2-10, but the fence perimeter locations are not plotted due to the large scale of the figure.

The TLDs were annealed at the Contractor Central Laboratory shortly before placing the TLDs in their field locations. The radiation dose accumulated in-transit between the Central Laboratory, the field location, and the Central Laboratory was corrected by transit controls maintained in lead shields at both the Central Laboratory and the field office. All dosimeters were exposed in the field for a calendar quarter, in a specific holder that contains two (2) TLDs at each location.

3. Results and Conclusions

A summary of the TLD results during the report period are listed in Table 2-2. A trend graph of analyses (including the pre-operational period through the report period) is shown on Figure 2-11.

TLD Analysis: During the report period, the average quarterly external exposure rate (as measured from TLD) was 18.4 mR at the sixty-four (64) indicator locations, and 20.5 mR at the Control location. This external exposure rate is comparable to previous years. As expected, there was some variation in external exposure rate among locations and seasons.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Adjustments to TLD Placement: In regards to operating experience at Clinton Power Station (OE26003), BVPS TLD sites were evaluated during 2008 against criteria established in ANSI N545-1975 (Performance, Testing, and Procedural Specifications for Thermoluminescence Dosimetry). As a result of this evaluation, several of the TLD sites were lowered and/or relocated to adjacent/nearby sites. For TLD sites that were relocated; (1) no changes were necessary to the distances specified in this and previous reports, and (2) no changes were necessary to the distances specified in the Offsite Dose Calculation Manual. In summary, the reported exposure results of all previous BVPS TLD data for the sixty-four (64) TLD sites are considered valid and do not require adjustment. Results of the evaluation were documented in SAP Order 200197646-0610 and letter NPD3NRE:0538.

TLD Trend Evaluation: As discussed in the 2007 report, the trends of the environmental TLD data during the period 2001 thru 2007 showed a small increase for the indicator locations, and a step (level) increase for the Control location. The increase was traced to a change made in late 2001 with regards to the environmental TLD field holders, which resulted in an increased sensitivity to natural background beta radiation. In summary, the increase in TLD data was consistent at all locations (including the control location), was most likely due to increased sensitivity to natural background beta radiation, and was not a consequence of BVPS gaseous effluent releases. This issue is documented in SAP Order No. 200197646-0400.


Deviations from Required Sampling and Analysis Schedule: There were no deviations from the required sampling schedule (i.e.; TLD change out frequency) and analysis schedule (i.e.; TLD processing frequency) during the report period.

Summary: The quarterly TLD external exposure rates are comparable to those of previous years, except for the increase described above in the TLD Trend Evaluation. There was no evidence of anomalies that could be attributed to the operation of BVPS. It should also be noted that the average external exposure rate at the indicator locations was less than average external exposure rate at the Control location. Based on all the analytical results and the comparison to pre-operational levels, the operation of BVPS did not contribute any measurable increase in external exposure in the vicinity of the site during the report period. The TLD exposure rates also confirm that changes from natural radiation levels, if any, are negligible.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Figure 2-10

Environmental Monitoring Locations - TLDs

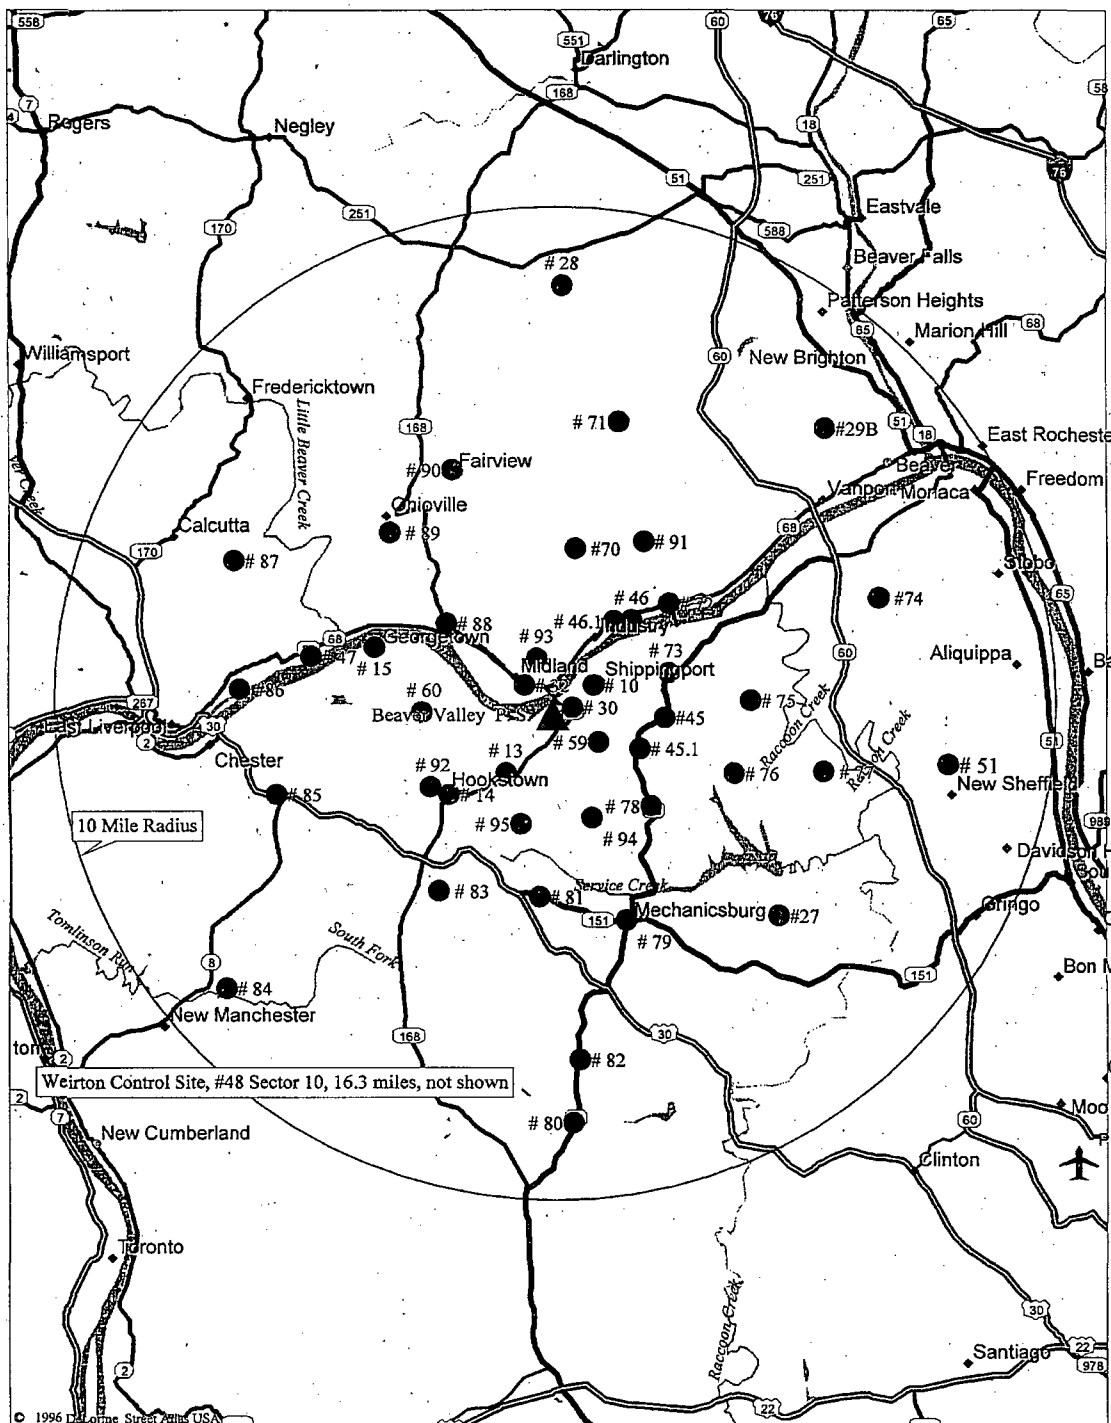

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Figure 2-10 (Continued)


TLD Locations

SOUTHEAST QUADRANT							
Site No.	Sector	Distance (miles)	Location	Site No.	Sector	Distance (miles)	Location
27	7-SE	6.14	Brunton Dairy Farm Aliquippa, PA	78	7-SE	2.72	Raccoon Twsp Municipal Building Raccoon Township, PA
45.1	6-ESE	1.92	Kennedy's Corners Raccoon Township, PA	79	8-SSE	4.46	106 State Route 151 Ted McWilliams Auto Body
51	5-E	8.00	Sheffield Substation Aliquippa, PA	80	9-S	8.27	Park Office, State Route 18 Raccoon Township, PA
59	6-ESE	0.99	236 Green Hill Road Aliquippa, PA	82	9-S	6.99	2697 State Route 18 Aliquippa, PA
76	6-ESE	3.80	Raccoon Elementary School Raccoon Township, PA	94	8-SSE	2.25	McCleary & Pole Cat Hollow Road Hookstown, PA
77	6-ESE	5.52	3614 Green Garden Road Aliquippa, PA				
NORTHWEST QUADRANT							
Site No.	Sector	Distance (miles)	Location	Site No.	Sector	Distance (miles)	Location
15	14-WNW	3.75	Post Office Georgetown, PA	87	14-WNW	7.04	50103 Calcutta Smith's Ferry Road
32	15-NW	0.75	North Substation Midland, PA	88	15-NW	2.74	110 Summit Road Midland, PA
47	14-WNW	4.88	Water Department East Liverpool, OH	89	15-NW	4.72	488 Smith's Ferry Road Ohioville, PA
60	13-W	2.51	444 Hill Road Georgetown, PA	90	16-NNW	5.20	6286 Tuscarawas Road Midland, PA
86	13-W	6.18	1090 Ohio Avenue East Liverpool, OH	93	16-NNW	1.10	104 Linden - Sunrise Hills Midland, PA
NORTHEAST QUADRANT							
Site No.	Sector	Distance (miles)	Location	Site No.	Sector	Distance (miles)	Location
10	3-NE 4-ENE	0.94	Post Office Shippingport, PA	70	1-N	3.36	236 Engle Road Industry, PA
28	1-N	8.60	Sherman Farm Beaver Falls, PA	71	2-NNE	6.01	First Western Bank Brighton Township, PA
29B	3-NE	7.97	Friendship Ridge Beaver, PA	72	3-NE	3.25	Ohioview Lutheran Church – Rear Industry, PA
30	4-ENE	0.43	Cook's Ferry Substation Shippingport, PA	73	4-ENE	2.48	618 Squirrel Run Road Industry, PA
45	5-E	2.19	Christian House Baptist Chapel, State Rte 18 Raccoon Township, PA	74	4-ENE	6.92	137 Poplar Avenue (CCBC) Monaca, PA
46	3-NE	2.49	Midway Drive Industry, PA	75	5-E	4.08	117 Holt Road Aliquippa, PA
46.1	2-NNE 3-NE	2.28	McKeel's Service, State Route 68 Industry, PA	91	2-NNE	3.89	Pine Grove Road & Doyle Road
SOUTHWEST QUADRANT							
Site No.	Sector	Distance (miles)	Location	Site No.	Sector	Distance (miles)	Location
13	11-SW	1.49	Old Meyer Farm Hookstown, PA	84	11-SW	8.35	Senior Center Hancock County, WV
14	11-SW	2.53	Hookstown, PA	85	12-WSW	5.73	2048 State Route 30
48	10-SSW	16.40	Collier Way Water Tower Weirton, WV	92	12-WSW	2.81	Georgetown Road Substation Georgetown, PA
81	9-S	3.69	Millcreek United Presbyterian Church	95	10-SSW	2.37	832 McCleary Road Hookstown, PA
83	10-SSW	4.26	735 Mill Creek Road				

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Figure 2-11

Graph of Annual Average Exposure: Direct Radiation in Environment

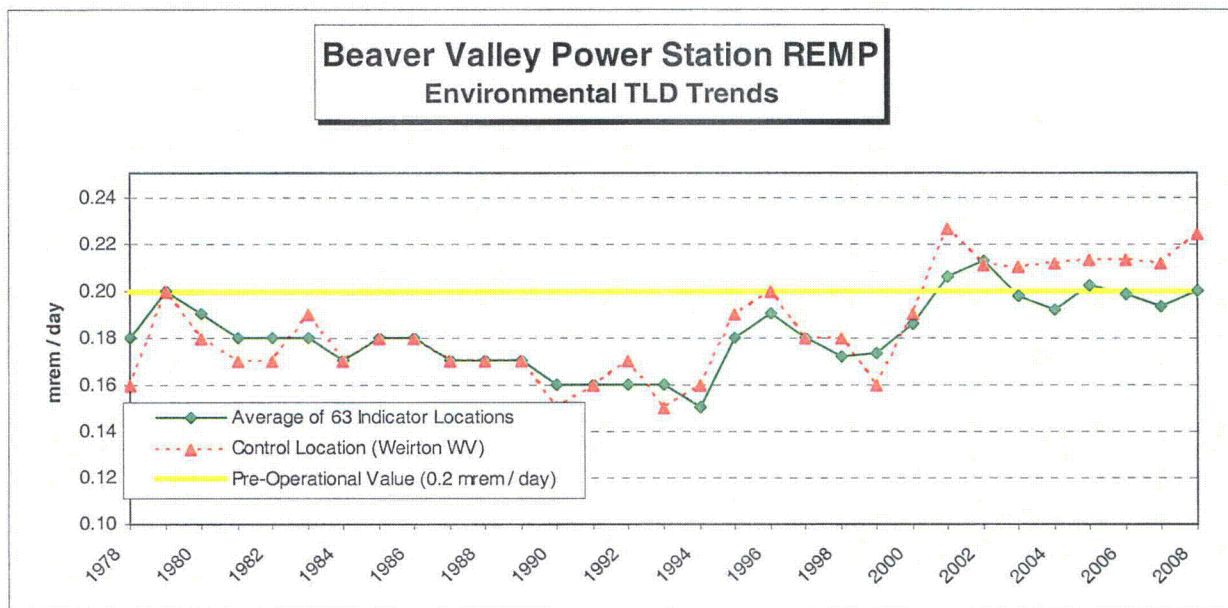

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

G. Monitoring of Fish

1. Description

During the report period, fish collected for the radiological monitoring program included carp, channel catfish, quillback, red horse and smallmouth bass.

2. Sampling Program and Analytical Techniques

a. Program

Fish samples are collected semi-annually in the New Cumberland pool of the Ohio River at the Beaver Valley effluent discharge point and upstream of the Montgomery Dam. The edible portion of each different species caught is analyzed by gamma spectroscopy. Fish sampling locations are shown in Figure 2-12.

b. Procedure

A sample is prepared in a standard tare weight 300 ml plastic bottle and scanned for gamma emitting nuclides with gamma spectrometry system which utilizes a high resolution germanium detector.

3. Results and Conclusions

A summary of the analysis results during the report period are listed in Table 2-2. A trend graph of analyses (including the pre-operational period through the report period) is shown on Figure 2-13.

Gamma Spectrometry: A total of nine (9) fish samples were analyzed by gamma spectrometry during the report period. Gamma emitting radionuclides were not detected in any of the four (4) indicator samples, nor were they detected in any of the five (5) control samples.


Deviations from Required Sampling and Analysis Schedule: There were no deviations from the required fish sampling and analysis schedule during the report period.

Summary: Based on the analytical results, the operation of BVPS did not contribute any measurable increase in radioactivity in the Ohio River fish population during the report period.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Figure 2-12

Environmental Monitoring Locations - Fish

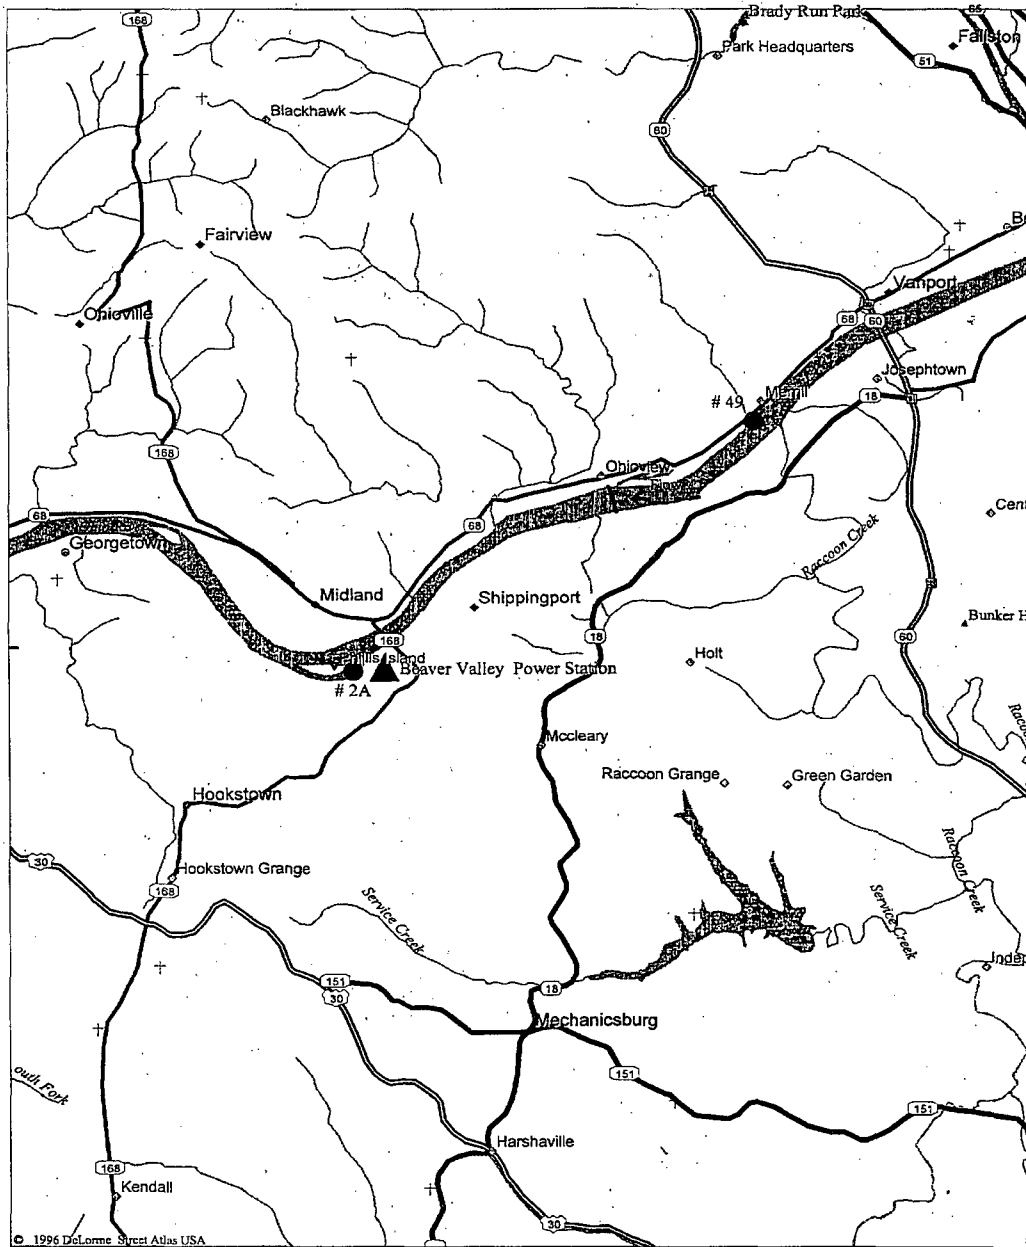


Sample Type	Site No.	Sector	Distance (miles)	Sample Point Description
Fish	2A	12-WSW	0.31	BVPS Outfall Vicinity
	49a	3-NE	4.93	Industry, PA (Upstream Montgomery Dam)

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Figure 2-13

Graph of Annual Average Concentration: Cesium-137 in Fish

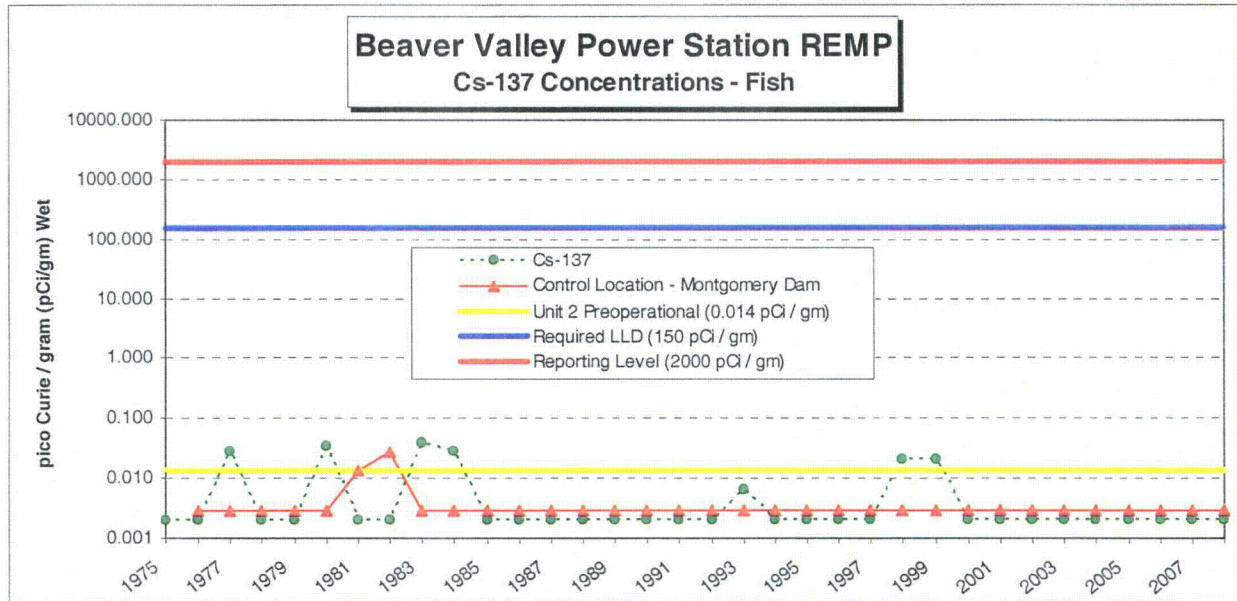

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

H. Monitoring of Surface Water, Drinking Water, Groundwater and Precipitation

1. Description of Water Sources

The Ohio River is the main body of water in the area. It is the main surface water supply for generation of drinking water in the area. The Beaver Valley Power Station obtains water from the Ohio River for plant make-up water and discharges water to the Ohio River via NPDES discharge points (e.g. cooling tower blowdown, liquid effluent releases, etc).

The Ohio River is the main surface water supply source for towns, municipalities and industries both upstream and downstream of the BVPS site. The nearest user of the Ohio River as a potable water source is Midland Borough Municipal Water Authority. The intake of the treatment plant is approximately 1.5 miles downstream and on the opposite side of the river. The next downstream user is East Liverpool, Ohio which is approximately 6 miles downstream. The heavy industries in Midland, as well as others downstream, also use river water for cooling purposes.

Groundwater occurs in large volumes in the gravel terraces which lie along the river, and diminishes considerably in the bedrock underlying the site. Normal well yields in the bedrock are less than 10 gallons per minute (gpm) with occasional wells yielding up to 60 gpm.

In general, the BVPS site experiences cool winters and moderately warm summers with ample annual precipitation evenly distributed throughout the year. The National Climate Data Center (<http://www.ncdc.noaa.gov/oa/climate/research/cag3/v4.html>) indicates the total annual precipitation during the report period for the Pittsburgh, PA area was 39.24 inches.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

2. Sampling and Analytical Techniques

a. Surface (Raw River) Water

The sampling program of river water includes three (3) sampling points along the Ohio River.

Raw water samples are collected daily at the East Liverpool (Ohio) Water Treatment Plant, sample location 5, [River Mile 41.2], and the made into a weekly composite sample. One automatic river water sampler is located at the ATI-Allegheny Ludlum (formerly J&L Steel) river water intake, sample location 2.1, [River Mile 36.2]. The automatic sampler takes a 20-40 ml sample every 15 minutes and samples are collected on a weekly basis. The weekly samples are then made into a monthly composite sample for each location. The monthly composite samples are analyzed for gamma emitters. In addition, a quarterly composite sample is prepared for each sample point from the monthly composites. Quarterly composites are analyzed for Hydrogen-3 (Tritium).

A weekly grab sample is taken upstream of the Montgomery Dam, sample location 49 [River Mile 29.6]. This upstream sample at the Montgomery Dam is the control sample. The weekly grab samples upstream of the Montgomery Dam are analyzed for Iodine-131. Weekly grab samples are then made into monthly composites are analyzed for gamma emitters. Quarterly composite are prepared from each of the monthly composites. The quarterly composites are analyzed for Tritium.

Locations of each sample point are shown in Figure 2-14.

b. Drinking Water (Public Supplies)

Drinking water (i.e.; treated water) is collected at both the Midland, PA Water Treating Plant, sample location 4, and East Liverpool, OH Water Treating Plant, sample location 5. An automatic sampler at each location collects 20-40 ml every 20 minutes, which is then made into a weekly composite sample. The weekly composite sample from each location is analyzed for Iodine-131. Monthly composites are made from the weekly samples and are analyzed by gamma spectrometry. In addition, a quarterly composite sample is prepared for each sample point from the monthly composites. Quarterly composites are analyzed for Tritium.

A weekly grab sample is taken upstream of the Montgomery Dam, sample location 49 [River Mile 29.6]. This upstream sample at the Montgomery Dam is the control sample. The weekly grab samples upstream of the Montgomery Dam are analyzed for Iodine-131. Weekly grab samples are then made into monthly composites are analyzed by gamma spectrometry. Quarterly composite are prepared from each of the monthly composites. The quarterly composites are analyzed for Tritium.

Locations of each sample point are shown in Figure 2-14.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

c. Groundwater

Although not required by the ODCM, semi-annual grab samples were collected from three (3) locations within four (4) miles of the site (see Figure 2-14). These locations are:

One (1) well in Shippingport, PA

One (1) well in Hookstown, PA

One (1) well in Georgetown, PA

Each ground water sample is analyzed for tritium and is analyzed by gamma spectrometry.

d. Precipitation

Although not required by the ODCM, precipitation is collected in Shippingport PA, East Liverpool OH, and Weirton WV. Precipitation, when available, is collected each week and then made into quarterly composite samples from the weekly samples. The quarterly composites are analyzed for Tritium and gamma emitters. Locations of each of the sample points are shown in Figure 2-14.

e. Procedures

Gamma Analysis of Drinking Water and Surface Water: The analysis is performed on water samples by placing one liter of the sample into a Marinelli container and analyzing the sample on a high resolution germanium gamma spectrometry system. Although not required by the ODCM, this analysis is also performed on Groundwater and Precipitation.

Tritium Analysis of Drinking Water and Surface Water: The Tritium is determined in water samples by liquid scintillation analysis. Although not required by the ODCM, this analysis is also performed on Surface Water, Groundwater and Precipitation.

Iodine-131 Analysis of Drinking Water: The sample is chemically prepared and analyzed with a low-level beta counting system. Although not required by the ODCM, this analysis is also performed on Surface Water.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

3. Results and Conclusions

A summary of the analysis results of water samples (surface water, drinking water, ground water and precipitation) during the report period are listed in Table 2-2. A trend graph of analyses (including the pre-operational period through the report period) is shown on Figures 2-15 through 2-18.

a. Surface Water

Tritium: A total of twelve (12) surface water samples were analyzed for Tritium during the report period. Tritium was not detected in any of the eight (8) indicator samples, nor was it detected in any of the four (4) control samples.

Gamma Spectrometry: A total of thirty-six (36) surface water samples were analyzed by gamma spectrometry during the report period. Gamma emitting radionuclides were not detected in any of the twenty-four (24) indicator samples, nor were they detected in any of the twelve (12) control samples.

Iodine-131: Although not required by the ODCM, a total of fifty-two (52) surface water control samples were analyzed for Iodine-131 using radiochemical methods during the report period. Iodine-131 was detected in forty-two of fifty-two (42 of 52) weekly control samples, of which three (3) analysis exceeded the reporting level of 2 pico Curie / liter. The results were similar to previous years, (current years range = 0.2 to 2.6 pico Curie / liter). The positive results were detected at the Control location, which is five (5) miles upstream (not influenced by BVPS operation). Identification of Iodine-131 during the report period was most likely due to medical diagnostic and treatment procedures from upstream facilities. This issue is documented in SAP Order 200197646-0440.

b. Drinking Water

Tritium: A total of twelve (12) drinking water samples were analyzed for Tritium during the report period. Tritium was not detected in any of the eight (8) indicator samples, nor was it detected in any of the four (4) control samples.

Gamma Spectrometry: A total of thirty-six (36) drinking water samples were analyzed by gamma spectrometry during the report period. Gamma emitting radionuclides were not detected in any of the twenty-four (24) indicator samples, nor were they detected in any of the twelve (12) control samples.

Iodine-131: A total of one hundred-fifty-six (156) drinking water samples were analyzed for Iodine-131 (using radiochemical methods) during the report period. Iodine-131 was detected in fifty-eight of one hundred four (58 of 104) indicator samples and forty-two of fifty-two (42 of 52) control samples. Some of the positive results at the downstream location exceeded the positive results from the upstream surface water Control location, but none of these analyses exceeded the reporting level of 2 pico Curie / liter. Also, SINCE all of the liquid effluent discharges during the report period from BVPS did not have detectable Iodine-131, THEN the positive results were not influenced by BVPS operation, and were most likely due to medical diagnostic and treatment procedures from upstream facilities.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

c. Groundwater

Tritium: Although not required by ODCM, a total of six (6) groundwater samples were analyzed for Tritium during the report period. Tritium was not detected in any of the four (4) indicator samples, nor was it detected in any of the two (2) control samples.

Gamma Spectrometry: Although not required by ODCM, a total of six (6) groundwater samples were analyzed by gamma spectrometry during the report period. Gamma emitting radionuclides were not detected in any of the four (4) indicator samples, nor were they detected in any of the two (2) control samples.

d. Precipitation

Tritium: Although not required by ODCM, a total of twelve (12) precipitation samples were analyzed for Tritium during the report period. Tritium was detected in two of eight (2 of 8) indicator samples, but was not detected in any of the four (4) control samples. Some of the positive results at the Cooks Ferry Substation in Shippingport, PA (current range = 182 pico Curie / liter, with an LLD of 133 pico Curie / liter) and the East Liverpool Water Department, in East Liverpool, OH (current range = 790 pico Curie / liter, with an LLD of 143 pico Curie / liter), are greater than the pre-operational level of 300 pico Curie / liter, but is consistent with washout of tritium (from gaseous releases) during precipitation events. Specifically, identification of tritium at this location is not unusual, because the plant discharges tritium in gaseous waste effluents, and washout does occur during precipitation. Also, the liquid tritium activity is less than the tritium discharge data of authorized gaseous effluent releases. All gaseous effluent releases during the report period did not exceed the release limits set forth in the Offsite Dose Calculation Manual.

Gamma Spectrometry: Although not required by ODCM, a total of twelve (12) precipitation samples were analyzed by gamma spectrometry during the report period. Gamma emitting radionuclides were not detected in any of the eight (8) indicator samples, nor were they detected in any of the four (4) control samples.


e. Deviations from Required Sampling and Analysis Schedule: The weekly surface water sample at ATI-Allegheny Ludlum in Midland, PA (Site No. 2.1, 1.43 miles WNW) was not collected for the week of 4/22/08 to 04/29/08. Although this weekly downstream surface water sample was missed, the minimum weekly surface water sampling requirements of ODCM procedure 1/2-ODC-3.03, Attachment Q, Table 3.12-1 were still met. Specifically, SINCE the ODCM only requires one (1) upstream sample and one (1) downstream sample, THEN the minimum requirements were met with the upstream sample from Industry, PA (Site No. 49a, 4.93 miles NE), and the downstream sample from East Liverpool, OH (Site No. 5, 4.90 miles WNW). This condition is documented in SAP Order 200197646-0720.

f. Summary: Data from the water sample analyses demonstrate that BVPS did not contribute a significant increase of radioactivity in the local river, in the drinking water, in the well water, or in the precipitation. The analytical results confirm that the station assessments, prior to authorizing radioactive discharges, are adequate and that the environmental monitoring program is sufficiently sensitive.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Figure 2-14

Environmental Monitoring Locations -
 Ground Water, Surface Water, Drinking Water and Precipitation

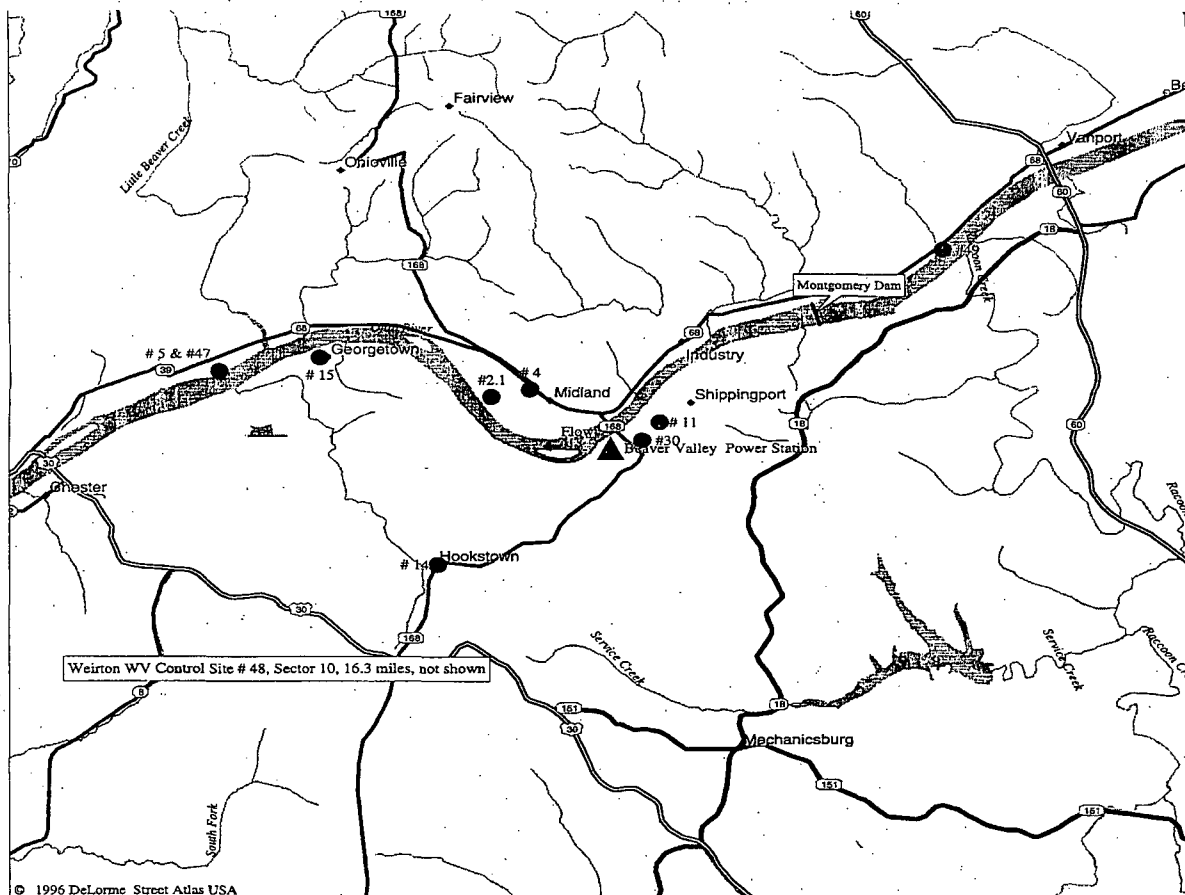


Sample Type	Site No.	Sector	Distance (miles)	Sample Point Description
Drinking Water	4	15-NW	1.26	Midland, PA (Water Department)
	5	14-WNW	4.90	East Liverpool, OH (Water Department)
Surface Water	2.1	14-WNW	1.43	Midland, PA (ATI Allegheny Ludlum)
	5	14-WNW	4.90	East Liverpool, OH (Water Department)
	49a	3-NE	4.93	Industry, PA (Upstream Montgomery Dam)
Ground Water	11	3-NE	0.94	Shippingport, PA
	14a	11-SW	2.61	Hookstown, PA
	15b	14-WNW	3.75	Georgetown, PA
Precipitation	30	4-ENE	0.43	Shippingport, PA (Cook's Ferry Substation)
	47	14-WNW	4.88	East Liverpool, OH (Water Department)
	48	10-SSW	16.40	Weirton WV (Water Tower, Collier Way)

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Figure 2-15


Graph of Annual Average Concentration: Iodine-131 in Surface Water & Drinking Water

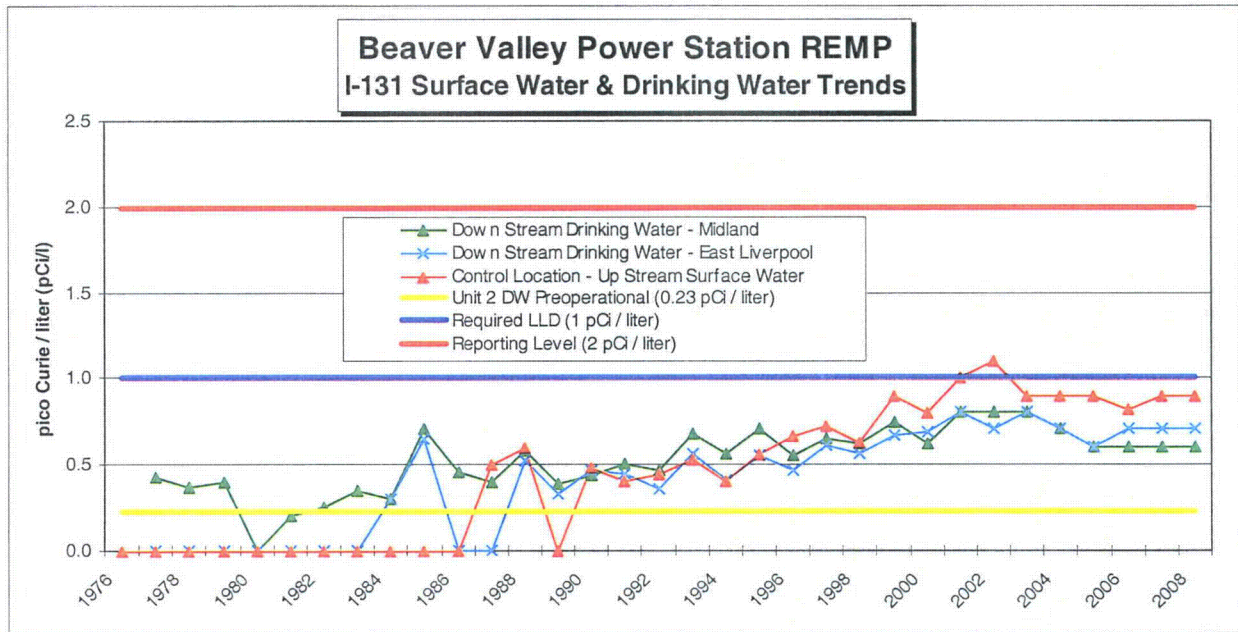

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Figure 2-16


Graph of Annual Average Concentration: Tritium in Surface Water

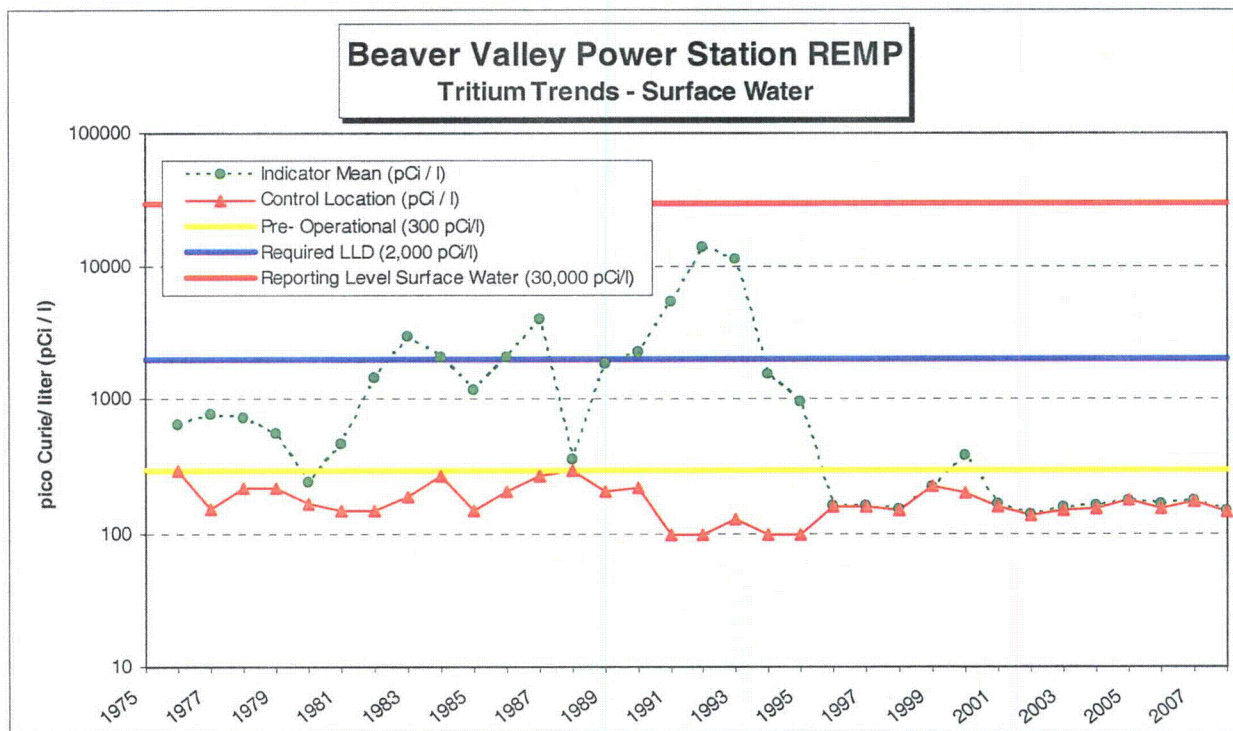

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Figure 2-17


Graph of Annual Average Concentration: Tritium in Ground Water

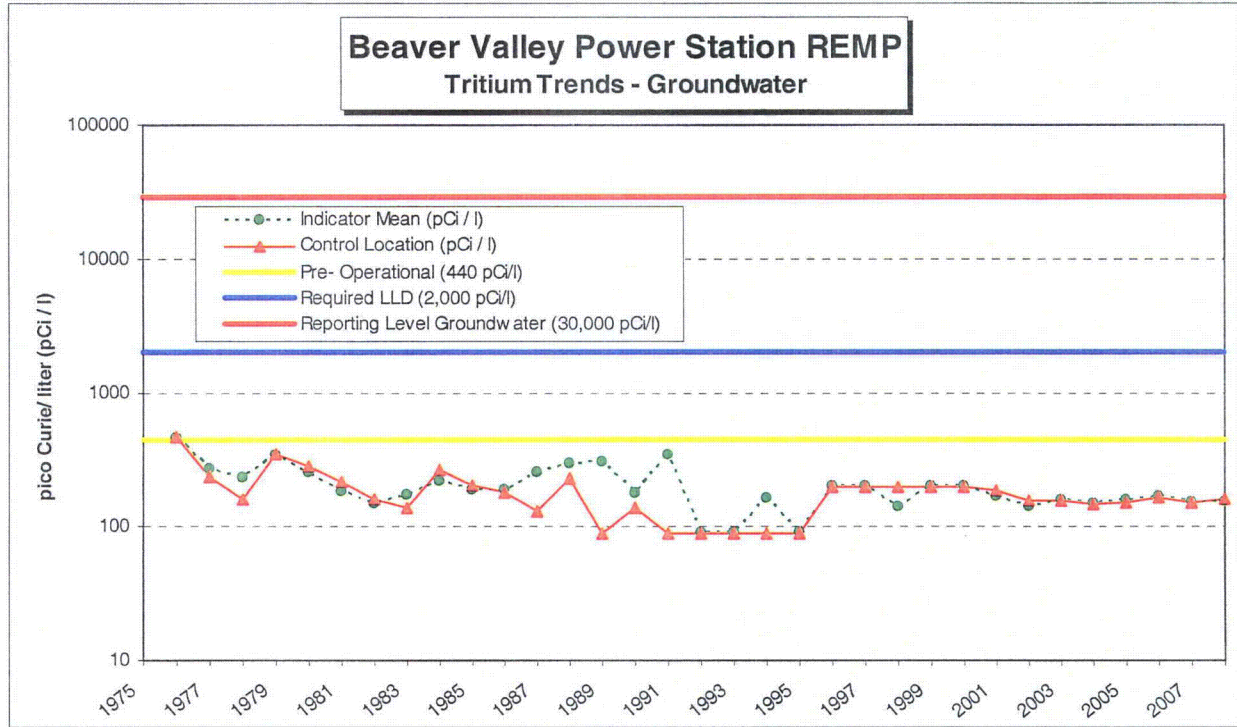

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Figure 2-18

Graph of Annual Average Concentration: Tritium in Drinking Water

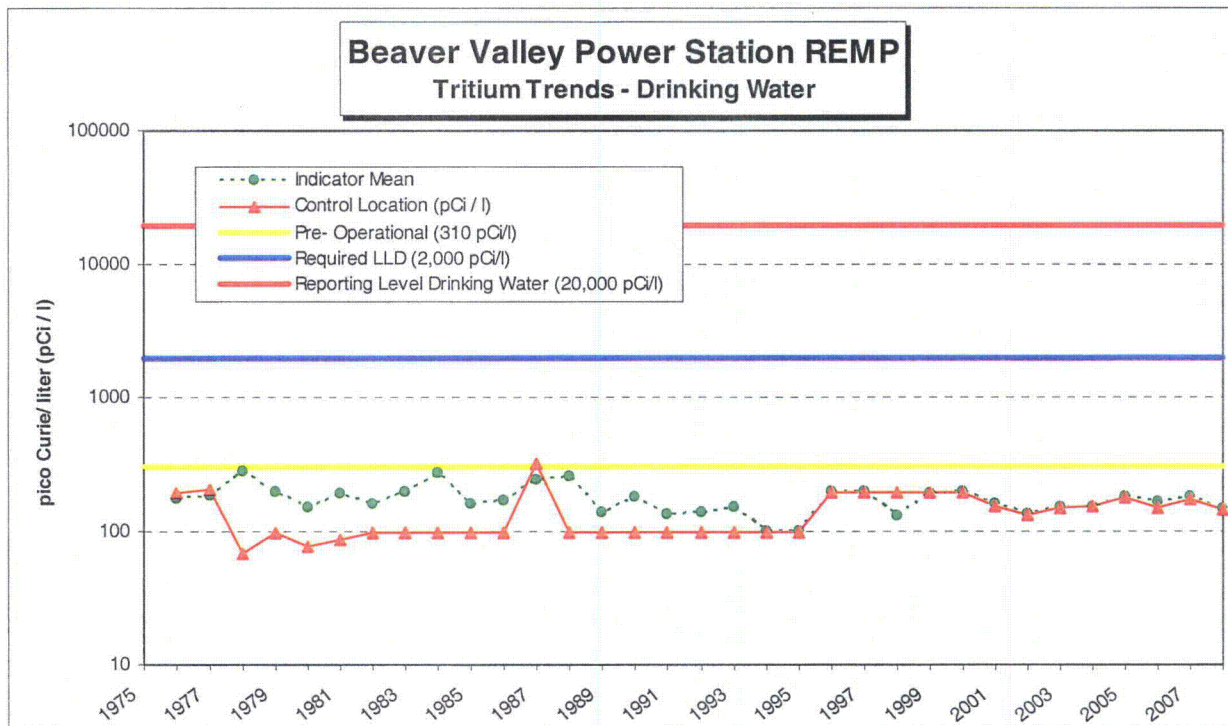

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

I. Estimates of Radiation Dose to Man

1. Pathways to Man - Calculational Models

The radiation doses to man as a result of BVPS operations were calculated for both gaseous and liquid effluent pathways using computer codes for the ARERAS/MIDAS computer system. These computer codes are equivalent to NRC computer codes XOQDOQ2, GASPAR, and LADTAP. Dose factors listed in the ODCM are used to calculate doses from radioactive noble gases in discharge plumes. BVPS effluent data, based on sample analysis were used as the radionuclide activity input.

All liquid and gaseous effluent radionuclides listed in the Annual Radioactive Effluent Release Report were input as source terms to the computer codes.

All batch and continuous gaseous effluent releases were included in the dose assessment calculations. The release activities are based on laboratory analysis. Meteorological data collected by the BVPS Meteorology System was also used as input to the computer codes. Except when more recent or specific data was available, the usage factors were obtained from the BVPS Final Environmental Statements or Regulatory Guide 1.109.

All radioactive liquid effluents are released by batch mode after analysis by gamma spectrometry. Each batch is diluted by cooling tower blowdown water prior to discharge into the Ohio River via the main outfall (River Mile 35.0). The actual data from these analyses are tabulated and used as the radionuclide source term input to the computer code. Except when more recent or specific data was available, the usage factors were obtained from the BVPS Final Environmental Statements or Regulatory Guide 1.109.

The total population doses were evaluated for all liquid and gaseous effluent pathways out to 50 miles. For these evaluations, a total population of ~4 million people was used. An estimate of the populations are listed in the BVPS-2 UFSAR Section 2.1.3.1 for 0-10 miles and Section 2.1.3.2 for 10-50 miles.

2. Results of Calculated Population Dose to Man - Liquid Effluent Releases

During the report period, the calculated dose to the entire population within 50 miles of the plant is presented in Table 2-4 for BVPS liquid effluent releases. Also shown in this table is a comparison to natural radiation exposure.

3. Results of Calculated Population Dose to Man – Gaseous Effluent Releases

During the report period, the calculated dose to the entire population within 50 miles of the plant is presented in Table 2-5 for BVPS airborne effluent releases. Also shown in this table is a comparison to natural radiation exposure. The doses include the contribution of all pathways.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

4. Conclusions

Based upon the estimated dose to individuals from the natural background radiation exposure in Tables 2-4 and 2-5, the incremental increase in total body dose to the 50-mile population from the operation of BVPS - Unit 1 and 2, is less than 0.00005% of the annual background dose.

The calculated doses to the public from the operation of BVPS - Unit 1 and 2, are below ODCM annual limits and resulted in only a small incremental dose to that which area residents already received as a result of natural background. The doses constituted no meaningful risk to the public.

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Table 2-4

**Comparison of Natural Radiation Exposure Versus
 Calculated Population Dose to Man - Liquid Effluent Releases**

<u>TYPICAL DOSE TO INDIVIDUALS</u>		
<u>FROM NATURAL RADIATION EXPOSURE</u> ^(a)		
Ambient Gamma Radiation	=	58 millirem / year
Radionuclides in Body	=	40 millirem / year
Global Fallout	=	< 1 millirem / year
Radon	=	198 millirem / year
Average Individual	=	296 millirem / year
(Total from all sources shown above)		
^(a) National Academy of Sciences, "The Effects on Populations of Exposure to Low Levels of Ionizing Radiation," BEIR Report, 1990		

0-50 mile Population Dose from BVPS Liquid Effluent Releases		
	Man-millirem	Largest Isotope Contributor
Total Dose	402	Tritium
Average Dose (per Individual)	0.0001005	Tritium

Comparison of Individual Dose BVPS Liquid Effluent Releases Versus Natural Background Radiation	
	millirem
BVPS Liquid Effluent Release Dose	0.0001005
Natural Radiation Exposure	296

SECTION 2 – ENVIRONMENTAL MONITORING PROGRAM

Table 2-5

**Comparison of Natural Background Exposure Versus
 Calculated Population Dose to Man – Gaseous Effluent Releases**

<u>TYPICAL DOSE TO INDIVIDUALS</u>	
<u>FROM NATURAL RADIATION EXPOSURE</u> ^(a)	
Ambient Gamma Radiation	= 58 millirem / year
Radionuclides in Body	= 40 millirem / year
Global Fallout	= < 1 millirem / year
Radon	= 198 millirem / year
Average Individual	= 296 millirem / year
(Total from all sources shown above)	
^(b) National Academy of Sciences, "The Effects on Populations of Exposure to Low Levels of Ionizing Radiation," BEIR Report, 1990	

0-50 mile Population Dose from BVPS Gaseous Effluent Releases		
	Man-millirem	Largest Isotope Contributor
Total	144	Tritium
Average (per Individual)	0.0000359	Tritium

Comparison of Individual Dose BVPS Gaseous Effluent Releases Versus Natural Background Radiation	
	millirem
BVPS Gaseous Effluent Release Dose	0.0000359
Natural Radiation Exposure	296

SECTION 3 – LAND USE CENSUS

A. **Land Use Census Overview:** A Land Use Census was conducted September 4 through September 24, 2008 to comply with:

- Offsite Dose Calculation Manual procedure 1/2-ODC-3.03, “*Controls for RETS and REMP Programs*”, Attachment R, Control 3.12.2, and Surveillance Requirement 4.12.2.1
- BVPS REMP procedure 1/2-ENV-04.02, “*Milch Animal Sampling Location Determination & ODCM Procedure 1/2-ODC-3.03, Control 3.12.2 Action Statements a and b Compliance Determination*”

The Land Use census indicated that no changes were required in the current sampling locations, and no changes were required to the methodology used for determination of offsite dose from plant releases. A numerical summary of the Land Use Census results are provided in Table 3-1. The following information is also provided to clarify the Land Use Census as documented in letter NPD3NRE:0542, dated September 29, 2008:

B. **Nearest Residence:**

The current location has not changed since the previous census.
The current location is at 211 Ferry Hill Road, Shippingport, PA (0.406 miles NE).

C. **Nearest Garden >500 sqft:**

The current location has not changed since the previous census.
The current location is at 238 State Route 168, Hookstown, PA (0.760 miles SSW).

D. **Nearest Dairy Cow:**

The current location has not changed since the previous census.
The current location is at the Searight Dairy, 948 McCleary Road, RD 1, Hookstown, PA (2.097 miles SSW).

E. **Nearest Doe Goat:**

The nearest location has changed since the previous census. However, SINCE the new location at 227 Calhoun Road, Aliquippa, PA (3.320 miles SE) cannot provide enough milk for sample analysis, THEN the location of the nearest Doe Goat milked will remain at 289 Calhoun Road, Aliquippa, PA (3.547 miles SE).

F. **Projection for 2009 Dairy Cow Sampling Locations:**

Using a linear regression analysis of deposition parameters (D/Q), Dairy Cow sampling locations were determined to remain at the same locations used in 2008:

- **Searight Dairy**, 948 McCleary Road, RD1, Hookstown, PA (2.097 miles SSW)
- **Halstead Dairy**, 104 Tellish Drive, Hookstown, PA (5.079 miles SSW)
- **Brunton Dairy**, 3681 Ridge Road, Aliquippa, PA (6.158 miles SE)
- **Windsheimer Dairy**, RD 1 Burgettstown, PA (10.476 miles SSW).

SECTION 3 – LAND USE CENSUS

G. Projection for 2009 Doe Goat Sampling Locations:

The linear regression analysis also indicated that there may be up to two (2) Doe Goat sampling location in 2009. The Doe Goat sampling location for 2009 may be as follows:

- **Collins Farm**, 289 Calhoun Road, Aliquippa, PA (3.547 miles, SE).
- **Sullivan Farm**, 198 Wilson Drive, Aliquippa, PA (4.285 miles ESE).

H. D/Q for Milch Animal Locations:

None of the 2008 milch animal sampling locations experienced a >20% increase in D/Q. Therefore, a Special Report per ODCM procedure 1/2-ODC-3.03, Attachment R, Control 3.12.2 Action "a" and/or Action "b" was not required.

I. D/Q for Offsite Dose Determination:

There was no adverse effect on the current ODCM methodology used for offsite dose determination from effluent releases. Specifically, a linear regression analysis of D/Q did not yield any valid locations where the offsite dose could have increased >20% more than the offsite dose previously calculated using current ODCM methodology. Therefore, a Special Report per ODCM procedure 1/2-ODC-3.03, Attachment R, Control 3.12.2 Action "a" and/or Action "b" was not required.

J. D/Q Historical Comparison:

There was no adverse trend in D/Q when comparing 1997 to 2008 data to the ODCM default D/Q values. This validates that there was no adverse effect on the current ODCM methodology used for offsite dose determination from effluent releases. Specifically, the analysis of D/Q did not yield any valid locations where the offsite dose could have increased >20% more than the offsite dose previously calculated using current ODCM methodology. Therefore, a change in ODCM Receptor location and/or a change to meteorology at the current ODCM Receptor location was not required.

SECTION 3 – LAND USE CENSUS

Table 3-1

Location of Nearest Residences, Gardens, Dairy Cows and Doe Goats

SECTOR	RESIDENCES	GARDENS	DAIRY COWS	DOE GOATS
	0 to 5 miles (miles)	0 to 5 miles (miles)	0 to 5 miles (miles)	0 to 5 miles (miles)
N	1.584	None	None	None
NNE	1.661	None	None	None
NE	0.406 (2)	None	None	None
ENE	0.603	1.047	None	None
E	0.429	2.252	None	3.402
ESE	0.476	1.713	None	4.285
SE	1.583	1.802	None (1)	3.320 (2)
SSE	1.102	1.983	None	None
S	1.399	2.276	3.851	None
SSW	0.760	0.760 (2)	2.097 (2)	None
SW	1.453	1.453	None	None
WSW	1.394	2.832	None	None
W	2.204	None	None	None
WNW	2.742	None	None	None
NW	0.885	1.033	None	None
NNW	0.902	2.413	2.442	None

(1) Although there are no Dairy Cows within 5 miles in this sector, a large local dairy located at 6.158 miles is included in the milk sampling program.

(2) Distances shown in Bold print are the nearest location for that receptor.

SECTION 4 - SPLIT SAMPLE PROGRAM and SPIKE SAMPLE INTER-LABORATORY COMPARISON PROGRAM

A. Split Sample Program (Inter-Laboratory Comparison, Part 1 of 2): BVPS participates in a split sample program with the Pennsylvania Department of Environmental Protection (PADEP) in support of their nuclear power plant monitoring program.

- BVPS provided split samples to PADEP throughout the report period. The shared media and number of locations were typically comprised of; milk (1), surface water (3), sediment (1), fish (1), and food crops (2).
- PADEP has co-located continuous air particulate & air iodine sample stations with four (4) of the BVPS locations.
- PADEP has co-located TLDs with twenty-four (24) of the BVPS TLDs.

B. Spike Sample Program (Inter-Laboratory Comparison, Part 2 of 2): BVPS participates in a spike sample program with an Independent Laboratory. This program is used to independently verify sample analyses performed by the BVPS Contractor Laboratory.

- **Acceptance Criteria 1:** The NRC criteria listed in NRC Inspection Procedure 84750, 12/4/90, Inspection Guidance 84750-03 is used as acceptance criteria for comparisons of results of spiked samples between the Contractor Lab and the Independent Lab. These comparisons are performed by dividing the comparison standard (Independent Lab result) by its associated uncertainty to obtain the resolution. The comparison standard value is multiplied by the ratio values obtained from the following table to find the acceptance band for the result to be compared. However, in such cases where the counting precision of the standard yields a resolution of less than 4, a valid comparison is not practical, and therefore, not performed.

NRC Criteria	
Resolution	Ratio
< 4	--
4 - 7	0.50 - 2.00
8 - 15	0.60 - 1.66
16 - 50	0.75 - 1.33
51 - 200	0.80 - 1.25
> 200	0.85 - 1.18

- **Acceptance Criteria 2:** BVPS also has self imposed acceptance criteria. That criteria requires the percent difference between the Contractor Lab Activity and the Independent Lab Calculated Activity to agree by $\pm 20\%$.

SECTION 4 - SPLIT SAMPLE PROGRAM and SPIKE SAMPLE INTER-LABORATORY COMPARISON PROGRAM

Participation in an Inter-Laboratory Comparison Program is required by BVPS Unit 1 and 2 Offsite Dose Calculation Manual procedure 1/2-ODC-3.03 Attachment S Control 3.12.3. For the report period, the requirement was met by the Contractor Lab analyzing NIST traceable spiked samples supplied by an Independent Lab.

During the report period, BVPS used (Environmental, Inc., Midwest Laboratory – Northbrook, IL) as the Contractor Laboratory, and (Analytics – Atlanta, GA) as the Independent Laboratory.

The spiked samples included air particulate filter papers, charcoal cartridges, water samples, and milk samples. The samples were submitted by the Independent Laboratory to the Contractor Laboratory for analysis. The “spiked to” values were used for calculating comparison Acceptance Criteria.

- **Spiked Milk & Water Samples:** The spiked sample results (i.e.; the BVPS criteria) for each calendar quarter are reported in Table 4-1 through Table 4-4, respectively. The following summary is provided:
 - A total of forty-eight (48) gamma spectrometry radionuclide analyses were performed by the Contractor Laboratory on four (4) milk samples.
 - A total of forty-eight (48) gamma spectrometry radionuclide analyses were performed by the Contractor Laboratory on four (4) water samples.
 - A total of four (4) chemical analyses for I-131 were performed by the Contractor Laboratory on four (4) milk samples.
 - A total of four (4) chemical analyses for I-131 analyses were performed by the Contractor Laboratory on four (4) water samples.
 - A total of four (4) tritium analyses were performed by the Contractor Laboratory on four (4) water samples.
 - Comparison of results of the spiked milk and water samples showed acceptable agreement with the NRC acceptance criteria. All one-hundred-eight (108) analyses met the NRC acceptance criteria.
 - Comparison of results of the spiked milk and water samples showed acceptable agreement with BVPS acceptance criteria. All but two (2) of the one-hundred-eight (108) analyses met the BVPS acceptance criteria.

SECTION 4 - SPLIT SAMPLE PROGRAM and SPIKE SAMPLE INTER-LABORATORY COMPARISON PROGRAM

- **Spiked Filter Paper and Charcoal Cartridge Samples:** The spiked sample results for each calendar quarter are also reported in Table 4-1 through Table 4-4, respectively. The following summary is provided:
 - Gross Beta (Cesium-137) analyses were performed by the Contractor Laboratory on two (2) filter paper samples.
 - Iodine-131 analyses were performed by the Contractor Laboratory on two (2) charcoal cartridge samples.
 - Comparison of results of the spiked filter paper and charcoal cartridge samples showed acceptable agreement with the NRC acceptance criteria. All four (4) analyses performed by the Contractor Laboratory met the NRC acceptance criteria.
 - Comparison of results of the spiked filter paper and charcoal cartridge samples showed acceptable agreement with the BVPS acceptance criteria. All four (4) analyses performed by the Contractor Laboratory met the BVPS acceptance criteria.

C. Conclusions

- **Results of Split Sample Program:**

The split sample program is coordinated by the state, and the results are not provided with this report.

- **Results of Spike Sample Program:**

Based on the Inter-Laboratory comparison data, BVPS considers all analyses provided throughout the report period by the Contractor Laboratory to be acceptable with respect to both accuracy and measurement. A comparison of the data, to the BVPS Acceptance Criteria, is provided in the following tables. The two samples that are not within the BVPS Acceptance Criteria are in the same sample type and are for two different sample analyses. Although these sample analyses are not within the BVPS Acceptance Criteria, they are within the NRC Acceptance Criteria. The BVPS acceptance criteria are self imposed and can be considered stringent compared to the NRC acceptance criteria. The first of the two deviations occurred in the second quarter for milk for Sr-90 (-20.89%). The second occurred in the third quarter, also for milk, but for Sr-89 (-21.79%).

**SECTION 4 - SPLIT SAMPLE PROGRAM and SPIKE SAMPLE
 INTER-LABORATORY COMPARISON PROGRAM**

**Table 4-1
 Inter-Laboratory Comparison Program
 Spiked Samples – 1st Quarter**

Sample Date	Sample Type and Identification No.	Sample Analyses	Percent Difference Between Contractor Lab Activity and Independent Lab Calculated Activity (Contr. Lab – Ind. Lab) / Ind. Lab
03/20/2008	Water Ind. Lab: E5862-93 Con. Lab: SPW-1093	Sr-89	-5.84%
		Sr-90	15.75%
		I-131 (Chemical)	4.69%
		I-131	4.83%
		Ce-141	-0.15%
		Cr-51	0.77%
		Cs-134	-7.92%
		Cs-137	2.24%
		Co-58	4.26%
		Mn-54	4.40%
		Fe-59	5.65%
		Zn-65	5.32%
Co-60	-0.05%		
03/20/2008	Water Ind. Lab: E5861-93 Con. Lab: SPW-1092	H-3	3.57%
03/20/2008	Milk Ind. Lab: E5863-93 Con. Lab: SPMI-1094	Sr-89	-4.38%
		Sr-90	-5.43%
		I-131 (Chemical)	-1.67%
		I-131	5.00%
		Ce-141	-0.48%
		Cr-51	1.64%
		Cs-134	-6.24%
		Cs-137	0.62%
		Co-58	2.40%
		Mn-54	5.31%
		Fe-59	1.76%
		Zn-65	6.64%
Co-60	2.16%		
03/20/2008	Filter Paper Ind. Lab: E5864-93 Con. Lab: SPAP-1095	Cs-137 (Gross Beta)	10.81%
03/20/2008	Charcoal Cartridge Ind. Lab: E5865-93 Con. Lab: SPCH-1096	I-131	-8.04%

**SECTION 4 - SPLIT SAMPLE PROGRAM and SPIKE SAMPLE
 INTER-LABORATORY COMPARISON PROGRAM**

Table 4-2

**Inter-Laboratory Comparison Program
 Spiked Samples – 2nd Quarter**

Sample Date	Sample Type and Identification No.	Sample Analyses	Percent Difference Between Contractor Lab Activity and Independent Lab Calculated Activity (Contr. Lab – Ind. Lab) / Ind. Lab
06/19/2008	Water Ind. Lab: E5937-93 Con. Lab: SPW-3057	Sr-89	-0.46%
		Sr-90	17.50%
		I-131 (Chemical)	-5.74%
		I-131	3.75%
		Ce-141	-0.68%
		Cr-51	9.04%
		Cs-134	-5.10%
		Cs-137	0.95%
		Co-58	-2.02%
		Mn-54	6.14%
		Fe-59	5.84%
		Zn-65	5.70%
Co-60	0.49%		
06/19/2008	Water Ind. Lab: E5936-93 Con. Lab: SPW-3056	H-3	1.94%
06/19/2008	Milk Ind. Lab: E5938-93 Con. Lab: SPMI-3058	Sr-89	-5.65%
		Sr-90	-20.89%
		I-131 (Chemical)	-0.56%
		I-131	0.98%
		Ce-141	2.76%
		Cr-51	7.68%
		Cs-134	-6.52%
		Cs-137	1.29%
		Co-58	-1.94%
		Mn-54	5.70%
		Fe-59	6.54%
		Zn-65	5.28%
Co-60	2.31%		

**SECTION 4 - SPLIT SAMPLE PROGRAM and SPIKE SAMPLE
INTER-LABORATORY COMPARISON PROGRAM**

**Table 4-3
Inter-Laboratory Comparison Program
Spiked Samples – 3rd Quarter**

Sample Date	Sample Type and Identification No.	Sample Analyses	Percent Difference Between Contractor Lab Activity and Independent Lab Calculated Activity (Contr. Lab – Ind. Lab) / Ind. Lab
09/18/2008	Water Ind. Lab: E6304-93 Con. Lab: SPW-5026	Sr-89	-3.46%
		Sr-90	9.15%
		I-131 (Chemical)	6.10%
		I-131	1.24%
		Ce-141	6.36%
		Cr-51	5.09%
		Cs-134	-7.40%
		Cs-137	2.71%
		Co-58	0.00%
		Mn-54	7.64%
		Fe-59	6.80%
		Zn-65	1.56%
Co-60	1.03%		
09/18/2008	Water Ind. Lab: E6303-93 Con. Lab: SPW-5025	H-3	3.96%
09/18/2008	Milk Ind. Lab: E6305-93 Con. Lab: SPMI-5027	Sr-89	-21.79%
		Sr-90	-17.27%
		I-131 (Chemical)	1.91%
		I-131	-3.39%
		Ce-141	1.12%
		Cr-51	-2.99%
		Cs-134	-10.65%
		Cs-137	-2.28%
		Co-58	-4.25%
		Mn-54	3.61%
		Fe-59	2.43%
Zn-65	-0.13%		
Co-60	-4.27%		
09/18/2008	Filter Paper Ind. Lab: E6306-93 Con. Lab: SPAP-5028	Cs-137 (Gross Beta)	5.38%
09/18/2008	Charcoal Cartridge Ind. Lab: E6307-93 Con. Lab: SPCH-5029	I-131	-14.75%

**SECTION 4 - SPLIT SAMPLE PROGRAM and SPIKE SAMPLE
 INTER-LABORATORY COMPARISON PROGRAM**

Table 4-4

**Inter-Laboratory Comparison Program
 Spiked Samples – 4th Quarter**

Sample Date	Sample Type and Identification No.	Sample Analyses	Percent Difference Between Contractor Lab Activity and Independent Lab Calculated Activity (Contr. Lab – Ind. Lab) / Ind. Lab
12/11/2008	Water Ind. Lab: E6370-93 Con. Lab: SPW-6982	Sr-89	6.35%
		Sr-90	-0.75%
		I-131 (Chemical)	-5.30%
		I-131	-1.25%
		Ce-141	1.34%
		Cr-51	3.37%
		Cs-134	-8.28%
		Cs-137	0.71%
		Co-58	-3.11%
		Mn-54	0.73%
		Fe-59	4.36%
		Zn-65	2.57%
		Co-60	1.41%
12/11/2008	Water Ind. Lab: E6369-93 Con. Lab: SPW-6981	H-3	4.16%
12/11/2008	Milk Ind. Lab: E6371-93 Con. Lab: SPMI-6983	Sr-89	-11.64%
		Sr-90	-1.59%
		I-131 (Chemical)	-5.26%
		I-131	-1.25%
		Ce-141	1.41%
		Cr-51	-0.65%
		Cs-134	-8.88%
		Cs-137	0.33%
		Co-58	-1.63%
		Mn-54	1.38%
		Fe-59	7.60%
		Zn-65	0.44%
		Co-60	0.83%