



JAMES R. MORRIS
Vice President

Duke Energy Corporation
Catawba Nuclear Station
4800 Concord Road
York, SC 29745

May 11, 2011

803-701-4251
803-701-3221 fax

U.S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, D.C. 20555-0001

Subject: Duke Energy Carolinas, LLC
Catawba Nuclear Station, Units 1 and 2
Docket Nos. 50-413 and 50-414
2010 Annual Radiological Environmental Operating Report

Pursuant to Catawba Nuclear Station Technical Specification 5.6.2 and Selected Licensee Commitment 16.11-16, please find attached the 2010 Annual Radiological Environmental Operating Report. This report covers operation of Catawba Units 1 and 2 during the 2010 calendar year.

Any questions concerning this report should be directed to Toni Pasour at (803) 701-3566.

Sincerely,

James R. Morris

Attachment

IE25
MLR

U.S. Nuclear Regulatory Commission
2010 Annual Radiological Environmental Operating Report
May 11, 2011
Page 2

xc (with attachment):

V. M. McCree
Regional Administrator
U.S. Nuclear Regulatory Commission - Region II
Marquis One Tower
245 Peachtree Center Ave., NE Suite 1200
Atlanta, GA 30303-1257

J. H. Thompson, NRR Project Manager
U.S. Nuclear Regulatory Commission
Office of Nuclear Reactor Regulation
Mail Stop 8 G9A
Washington, D.C. 20555

G. A. Hutto, III, Senior Resident Inspector
U.S. Nuclear Regulatory Commission
Catawba Nuclear Station

Russell Keown, Supervisor
Analytical & Radiological Environmental Services Division
2600 Bull Street
Columbia, SC 29201

Sandra Flemming, Director
Analytical & Radiological Environmental Services Division
8231 Parklane Road
Columbia, SC 29223

Susan E. Jenkins, Manager
Radioactive & Infectious Waste Management
Division of Waste Management
S.C. Department of Health and Environmental Control
2600 Bull Street
Columbia, SC 29201

Tom Knight
Contamination Mitigation Section
Bureau of Land and Waste Management
S.C. Department of Health and Environmental Control
2600 Bull Street
Columbia, SC 29201

Catawba Nuclear Station Units 1 and 2



AREOR

Annual
Radiological Environmental
Operating Report
2010



ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

**DUKE ENERGY CORPORATION
CATAWBA NUCLEAR STATION
Units 1 and 2**

2010



TABLE OF CONTENTS

| | |
|--|------|
| 1.0 Executive Summary | 1-1 |
| 2.0 Introduction | 2-1 |
| 2.1 Site Description and Sample Locations | 2-1 |
| 2.2 Scope and Requirements of the REMP | 2-1 |
| 2.3 Statistical and Calculational Methodology | 2-2 |
| 2.3.1 Estimation of the Mean Value | 2-2 |
| 2.3.2 Lower Level of Detection and Minimum Detectable Activity | 2-3 |
| 2.3.3 Trend Identification | 2-3 |
| 3.0 Interpretation of Results | 3-1 |
| 3.1 Airborne Radioiodine and Particulates | 3-2 |
| 3.2 Drinking Water | 3-5 |
| 3.3 Surface Water | 3-7 |
| 3.4 Ground Water | 3-9 |
| 3.5 Milk | 3-10 |
| 3.6 Broadleaf Vegetation | 3-11 |
| 3.7 Food Products | 3-13 |
| 3.8 Fish | 3-14 |
| 3.9 Shoreline Sediment | 3-17 |
| 3.10 Direct Gamma Radiation | 3-20 |
| 3.10.1 Environmental TLD | 3-20 |
| 3.10.2 ISFSI | 3-20 |
| 3.11 Land Use Census | 3-25 |
| 4.0 Evaluation of Dose | 4-1 |
| 4.1 Dose from Environmental Measurements | 4-1 |
| 4.2 Estimated Dose from Releases | 4-1 |
| 4.3 Comparison of Doses | 4-2 |
| 5.0 Quality Assurance | 5-1 |
| 5.1 Sample Collection | 5-1 |
| 5.2 Sample Analysis | 5-1 |
| 5.3 Dosimetry Analysis | 5-1 |
| 5.4 Laboratory Equipment Quality Assurance | 5-1 |
| 5.4.1 Daily Quality Control | 5-1 |
| 5.4.2 Calibration Verification | 5-1 |
| 5.4.3 Batch Processing | 5-2 |
| 5.5 Duke Energy Intercomparison Program | 5-2 |
| 5.6 ERA Proficiency Testing | 5-2 |
| 5.7 Duke Energy Audits | 5-2 |
| 5.8 U.S. Nuclear Regulatory Commission Inspections | 5-2 |
| 5.9 State of South Carolina Intercomparison Program | 5-3 |
| 5.10 TLD Intercomparison Program | 5-3 |
| 5.10.1 Nuclear Technology Services Intercomparison Program | 5-3 |
| 5.10.2 Internal Crosscheck (Duke Energy) | 5-3 |
| 6.0 References | 6-1 |

Appendices

| | |
|---|------|
| Appendix A: Environmental Sampling and Analysis Procedures | A-1 |
| I. Change of Sampling Procedures | A-2 |
| II. Description of Analysis Procedures | A-2 |
| III. Change of Analysis Procedures | A-3 |
| IV. Sampling and Analysis Procedures | A-3 |
| A.1 Airborne Particulate and Radioiodine | A-3 |
| A.2 Drinking Water | A-3 |
| A.3 Surface Water | A-3 |
| A.4 Ground Water | A-4 |
| A.5 Milk | A-4 |
| A.6 Broadleaf Vegetation | A-4 |
| A.7 Food Products | A-4 |
| A.8 Fish | A-5 |
| A.9 Shoreline Sediment | A-5 |
| A.10 Direct Gamma Radiation (TLD) | A-5 |
| A.11 Annual Land Use Census | A-5 |
| V. Global Positioning System (GPS) Analysis | A-6 |
| Appendix B: Radiological Env. Monitoring Program - Summary of Results | B-1 |
| Air Particulate | B-2 |
| Air Radioiodine | B-3 |
| Drinking Water | B-4 |
| Surface Water | B-5 |
| Ground Water | B-6 |
| Milk | B-7 |
| Broadleaf Vegetation | B-8 |
| Food Products | B-9 |
| Fish | B-10 |
| Shoreline Sediment | B-11 |
| Direct Gamma Radiation (TLD) | B-12 |
| Appendix C: Sampling Deviations and Unavailable Analyses | C-1 |
| C.1 Sampling Deviations | C-2 |
| C.2 Unavailable Analyses | C-3 |
| Appendix D: Analytical Deviations | D-1 |
| Appendix E: Radiological Environmental Monitoring Program Results | E-1 |

LIST OF FIGURES

| | | |
|--------|---|------|
| 2.1-1 | Sampling Locations Map (One Mile Radius) | 2-4 |
| 2.1-2 | Sampling Locations Map (Ten Mile Radius) | 2-5 |
| 3.1 | Concentration of Gross Beta in Air Particulate | 3-2 |
| 3.2 | Concentration of Tritium in Drinking Water | 3-6 |
| 3.3 | Concentration of Tritium in Surface Water | 3-8 |
| 3.6 | Concentration of Cs-137 in Broadleaf Vegetation | 3-11 |
| 3.8-1 | Concentration of Co-58 in Fish | 3-15 |
| 3.8-2 | Concentration of Co-60 in Fish | 3-15 |
| 3.9-1 | Concentration of Co-58 in Shoreline Sediment | 3-17 |
| 3.9-2 | Concentration of Co-60 in Shoreline Sediment | 3-18 |
| 3.10-1 | Direct Gamma Radiation (TLD) Results | 3-21 |
| 3.10-2 | Catawba Inner Ring (TLD) Results | 3-23 |
| 3.10-3 | Catawba Outer Ring (TLD) Results | 3-24 |
| 3.11 | 2010 Land Use Census Map | 3-26 |

LIST OF TABLES

| | | |
|--------|---|------|
| 2.1-A | Radiological Monitoring Program Sampling Locations | 2-6 |
| 2.1-B | Radiological Monitoring Program Sampling Locations (TLD Sites) | 2-7 |
| 2.2-A | Reporting Levels for Radioactivity Concentrations in Environmental Samples | 2-8 |
| 2.2-B | REMP Analysis Frequency | 2-8 |
| 2.2-C | Maximum Values for the Lower Limits of Detection | 2-9 |
| 3.1-A | Mean Concentration of Gross Beta in Air Particulate | 3-3 |
| 3.1-B | Mean Concentration of Air Radioiodine (I-131) | 3-4 |
| 3.2 | Mean Concentrations of Radionuclides in Drinking Water | 3-6 |
| 3.3 | Mean Concentrations of Radionuclides in Surface Water | 3-8 |
| 3.5 | Mean Concentration of Radionuclides in Milk | 3-10 |
| 3.6 | Mean Concentration of Radionuclides in Broadleaf Vegetation | 3-12 |
| 3.7 | Mean Concentration of Radionuclides in Food Products | 3-13 |
| 3.8 | Mean Concentrations of Radionuclides in Fish | 3-16 |
| 3.9 | Mean Concentrations of Radionuclides in Shoreline Sediment | 3-19 |
| 3.10-A | Direct Gamma Radiation (TLD) Results | 3-22 |
| 3.10-B | Direct Gamma Radiation (TLD) Results Inner Ring | 3-23 |
| 3.10-C | Direct Gamma Radiation (TLD) Results Outer Ring | 3-24 |
| 3.11 | Land Use Census Results | 3-25 |
| 4.1-A | 2010 Environmental and Effluent Dose Comparison | 4-3 |
| 4.1-B | Maximum Individual Dose for 2010 based on Environmental Measurements for Catawba Nuclear Station | 4-5 |
| 5.0-A | 2010 Cross-Check Results for EnRad Laboratories | 5-4 |
| 5.0-B | 2010 Environmental Resource Associates Quik™ Response Program | 5-9 |
| 5.0-C | 2010 Environmental Dosimeter Cross-Check Results | 5-11 |

LIST OF ACRONYMS USED IN THIS TEXT *(in alphabetical order)*

| | |
|--------------------|--|
| BW | BiWeekly |
| C | Control |
| CNS | Catawba Nuclear Station |
| DEHNR | Department of Environmental Health and Natural Resources |
| DHEC | Department of Health and Environmental Control |
| EPA | Environmental Protection Agency |
| ERA | Environmental Resource Associates |
| GI-LLI | Gastrointestinal – Lower Large Intestine |
| GPS | Global Positioning System |
| ISFSI | Independent Spent Fuel Storage Installation |
| LLD | Lower Limit of Detection |
| M | Monthly |
| MDA | Minimum Detectable Activity |
| MOA | Memorandum of Agreement |
| mrem | Millirem |
| NIST | National Institute of Standards and Technology |
| NRC | Nuclear Regulatory Commission |
| ODCM | Offsite Dose Calculation Manual |
| pCi/kg | picocurie per kilogram |
| pCi/l | picocurie per liter |
| pCi/m ³ | picocurie per cubic meter |
| PIP | Problem Investigation Program |
| Q | Quarterly |
| REMP | Radiological Environmental Monitoring Program |
| SA | Semiannually |
| SLCs | Selected Licensee Commitments |
| SM | Semimonthly |
| TECH SPECS | Technical Specifications |
| TLD | Thermoluminescent Dosimeter |
| μCi/ml | microcurie per milliliter |
| UFSAR | Updated Final Safety Analysis Report |
| W | Weekly |

1.0 EXECUTIVE SUMMARY

This Annual Radiological Environmental Operating Report describes the Catawba Nuclear Station Radiological Environmental Monitoring Program (REMP), and the program results for the calendar year 2010.

Included are the identification of sampling locations, descriptions of environmental sampling and analysis procedures, comparisons of present environmental radioactivity levels and pre-operational environmental data, comparisons of doses calculated from environmental measurements and effluent data, analysis of trends in environmental radiological data as potentially affected by station operations, and a summary of environmental radiological sampling results. Quality assurance practices, sampling deviations, unavailable samples, and program changes are also discussed.

Sampling activities were conducted as prescribed by Selected Licensee Commitments (SLCs). Required analyses were performed and detection capabilities were met for all collected samples as required by SLCs. Eight-hundred ninety-six samples were analyzed comprising 1,212 test results in order to compile data for the 2010 report. Based on the annual land use census, the current number of sampling sites for Catawba Nuclear Station is sufficient.

Concentrations observed in the environment in 2010 for station related radionuclides were generally within the ranges of concentrations observed in the past. Inspection of data showed that radioactivity concentrations in surface water, drinking water, shoreline sediment, and fish are higher than the activities reported for samples collected prior to the operation of the station. Measured concentrations were not higher than expected, and all positively identified measurements were within limits as specified in SLCs.

Additionally, environmental radiological monitoring data is consistent with effluents introduced into the environment by plant operations. The total body dose estimated to the maximum exposed member of the public as calculated by environmental sampling data, excluding TLD results, was $2.07E-01$ mrem for 2010. It is therefore concluded that station operations has had no significant radiological impact on the health and safety of the public or the environment.



2.0 INTRODUCTION

2.1 SITE DESCRIPTION AND SAMPLE LOCATIONS

Duke Energy Corporation's Catawba Nuclear Station is a two-unit facility located on the shore of Lake Wylie in York County, South Carolina. Each of the two essentially identical units employs a pressurized water reactor nuclear steam supply system furnished by Westinghouse Electric Corporation. Each generating unit is designed to produce a net electrical output of approximately 1145 MWe. Units 1 and 2 achieved initial criticality on January 7, 1985, and May 8, 1986, respectively.

Condenser cooling is accomplished utilizing a closed system incorporating cooling towers, instead of using lake water directly. Liquid effluents are released into Lake Wylie via the station discharge canal and are not accompanied by the large additional dilution water flow associated with "once-through" condenser cooling. This design results in greater radionuclide concentrations in the discharge canal given comparable liquid effluent source terms.

Figures 2.1-1 and 2.1-2 are maps depicting the Thermoluminescent Dosimeter (TLD) monitoring locations and the sampling locations. The location numbers shown on these maps correspond to those listed in Tables 2.1-A and 2.1-B. Figure 2.1-1 comprises all sample locations within a one mile radius of CNS. Figure 2.1-2 comprises all sample locations within a 10 mile radius of CNS.

2.2 SCOPE AND REQUIREMENTS OF THE REMP

An environmental monitoring program has been in effect at Catawba Nuclear Station since 1981, four years prior to operation of Unit 1 in 1985. The preoperational program provides data on the existing environmental radioactivity levels for the site and vicinity which may be used to determine whether increases in environmental levels are attributable to the station. The operational program provides surveillance and backup support of detailed effluent monitoring which is necessary to evaluate the significance, if any, of the contributions to the existing environmental radioactivity levels that result from station operation.

This monitoring program is based on NRC guidance as reflected in the Selected Licensee Commitments Manual, with regard to sample media, sampling locations, sampling frequency and analytical sensitivity requirements. Indicator and control locations were established for comparison purposes to distinguish radioactivity of station origin from natural or other "man-made" environmental radioactivity. The environmental monitoring program also verifies projected and anticipated radionuclide concentrations in the environment and related exposures from releases of radionuclides from Catawba Nuclear Station. This program satisfies the requirements of Section IV.B.2 of Appendix I to 10CFR50 and provides surveillance of all appropriate critical exposure pathways to man and protects vital interests of the company,

public and state and federal agencies concerned with the environment. Reporting levels for activity found in environmental samples are listed in Table 2.2-A. Table 2.2-B lists the REMP analysis and frequency schedule.

The Annual Land Use Census, required by Selected Licensee Commitments, is performed to ensure that changes in the use of areas at or beyond the site boundary are identified and that modifications to the REMP are made if required by changes in land use. This census satisfies the requirements of Section IV.B.3 of Appendix I to 10CFR50. Results are shown in Table 3.11.

Participation in an interlaboratory comparison program as required by Selected Licensee Commitments provides for independent checks on the precision and accuracy of measurements of radioactive material in REMP sample matrices. Such checks are performed as part of the quality assurance program for environmental monitoring in order to demonstrate that the results are valid for the purposes of Section IV.B.2 of Appendix I to 10CFR50. A summary of the results obtained as part of this comparison program are in Section 5 of this annual report.

2.3 STATISTICAL AND CALCULATIONAL METHODOLOGY

2.3.1 ESTIMATION OF THE MEAN VALUE

There was one (1) basic statistical calculation performed on the raw data resulting from the environmental sample analysis program. The calculation involved the determination of the mean value for the indicator and the control samples for each sample medium. The mean is a widely used statistic. This value was used in the reduction of the data generated by the sampling and analysis of the various media in the Radiological Environmental Monitoring Program. "Net activity (or concentration)" is the activity (or concentration) determined to be present in the sample. No "Minimum Detectable Activity", "Lower Limit of Detection", "Less Than Level", or negative activities or concentrations are included in the calculation of the mean. The following equation was used to estimate the mean (reference 6.8):

$$\bar{x} = \frac{\sum_{i=1}^N x_i}{N}$$

Where:

\bar{x} = estimate of the mean,

i = individual sample,

N = total number of samples with a net activity (or concentration),

x_i = net activity (or concentration) for sample i .

2.3.2 LOWER LEVEL OF DETECTION AND MINIMUM DETECTABLE ACTIVITY

The Lower Level of Detection (LLD), and Minimum Detectable Activity (MDA) are used throughout the REMP.

LLD - The LLD, as defined in the Selected Licensee Commitments Manual is the smallest concentration of radioactive material in a sample that will yield a net count, above the system background, that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal. The LLD is an *a priori* lower limit of detection. The actual LLD is dependent upon the standard deviation of the background counting rate, the counting efficiency, the sample size (mass or volume), the radiochemical yield and the radioactive decay of the sample between sample collection and counting. The "required" LLD's for each sample medium and selected radionuclides are given in the Selected Licensee Commitments and are listed in Table 2.2-C.

MDA - The MDA is the net counting rate (sample after subtraction of background) that must be surpassed before a sample is considered to contain a scientifically measurable amount of a radioactive material exceeding background amounts. The MDA is calculated using a sample background and may be thought of as an "actual" LLD for a particular sample measurement.

2.3.3 TREND IDENTIFICATION

One of the purposes of an environmental monitoring program is to determine if there is a buildup of radionuclides in the environment due to the operation of the nuclear station. Visual inspection of tabular or graphical presentations of data (including preoperational) is used to determine if a trend exists. A decrease in a particular radionuclide's concentration in an environmental medium does not indicate that reactor operations are removing radioactivity from the environment but that reactor operations are not adding that radionuclide to the environment in quantities exceeding the preoperational level and that the normal removal processes (radioactive decay, deposition, resuspension, etc.) are influencing the concentration.

Substantial increases or decreases in the amount of a particular radionuclide's release from the nuclear plant will greatly affect the resulting environmental levels; therefore, a knowledge of the release of a radionuclide from the nuclear plant is necessary to completely interpret the trends, or lack of trends, determined from the environmental data. Factors that may affect environmental levels of radionuclides include prevailing weather conditions (periods of drought, solar cycles or heavier than normal precipitation), construction in or around either the nuclear plant or the sampling location, and addition or deletion of other sources of radioactive materials (such as the Chernobyl accident). Some of these factors may be obvious while others are sometimes unknown. Therefore, how trends are identified will include some judgment by plant personnel.

Figure 2.1-1

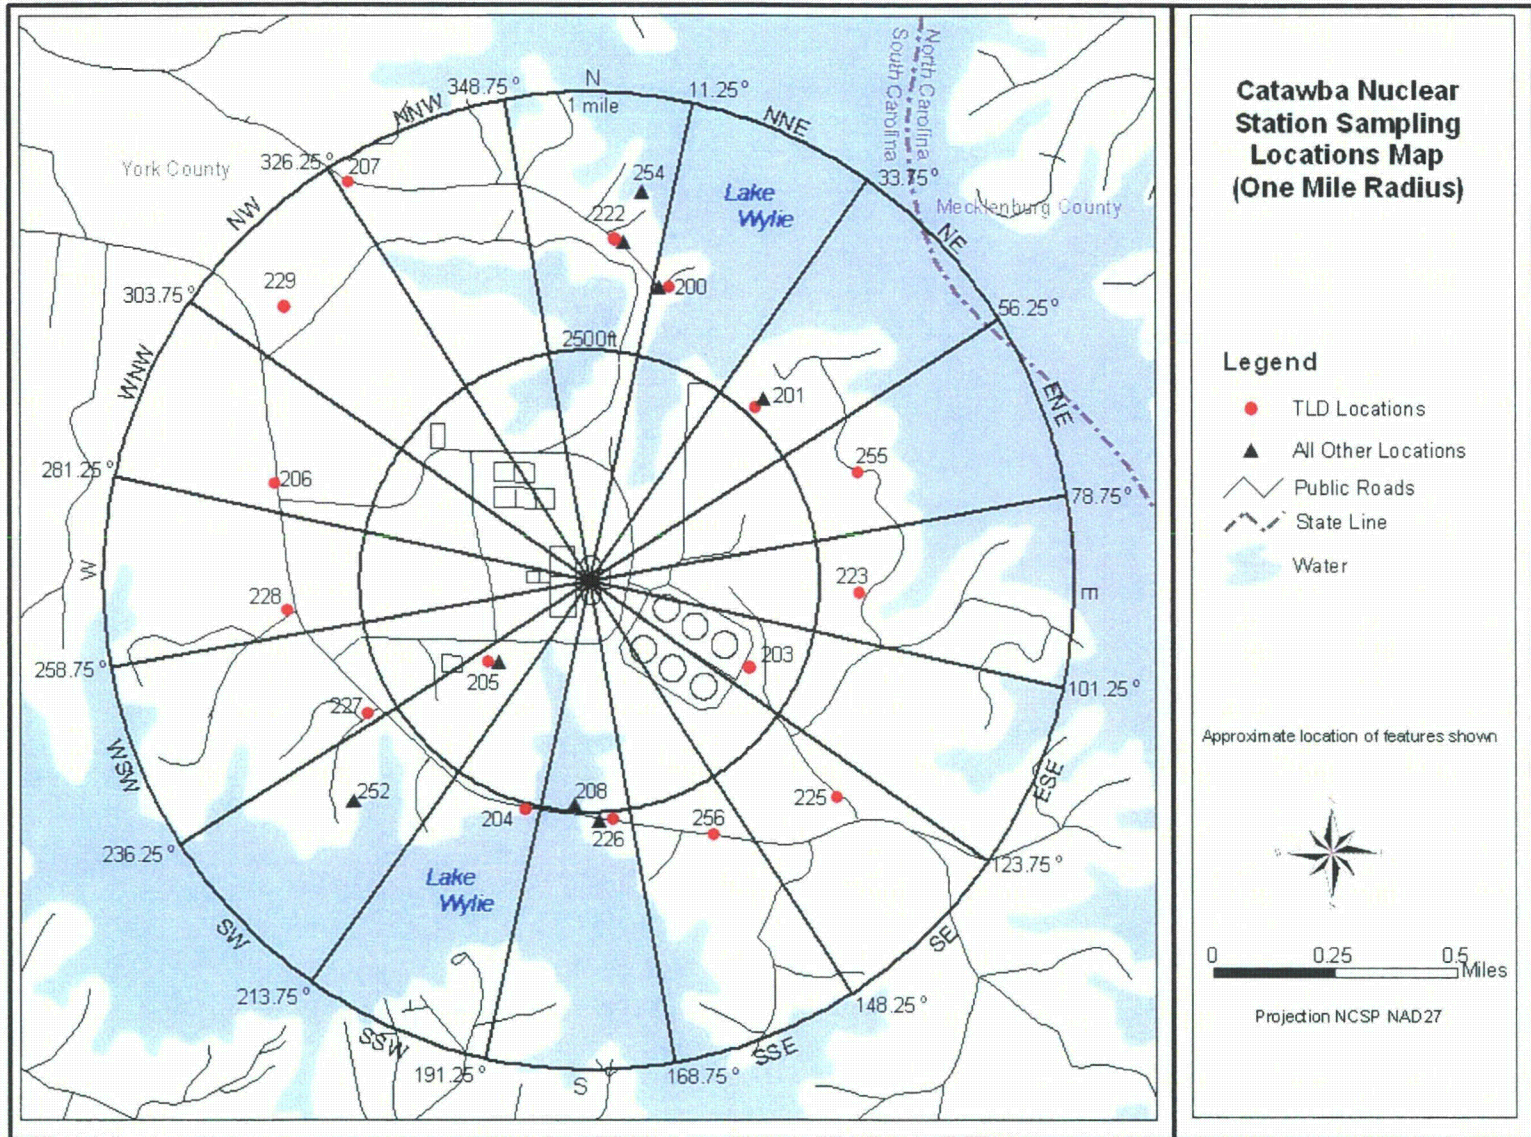


Figure 2.1-2

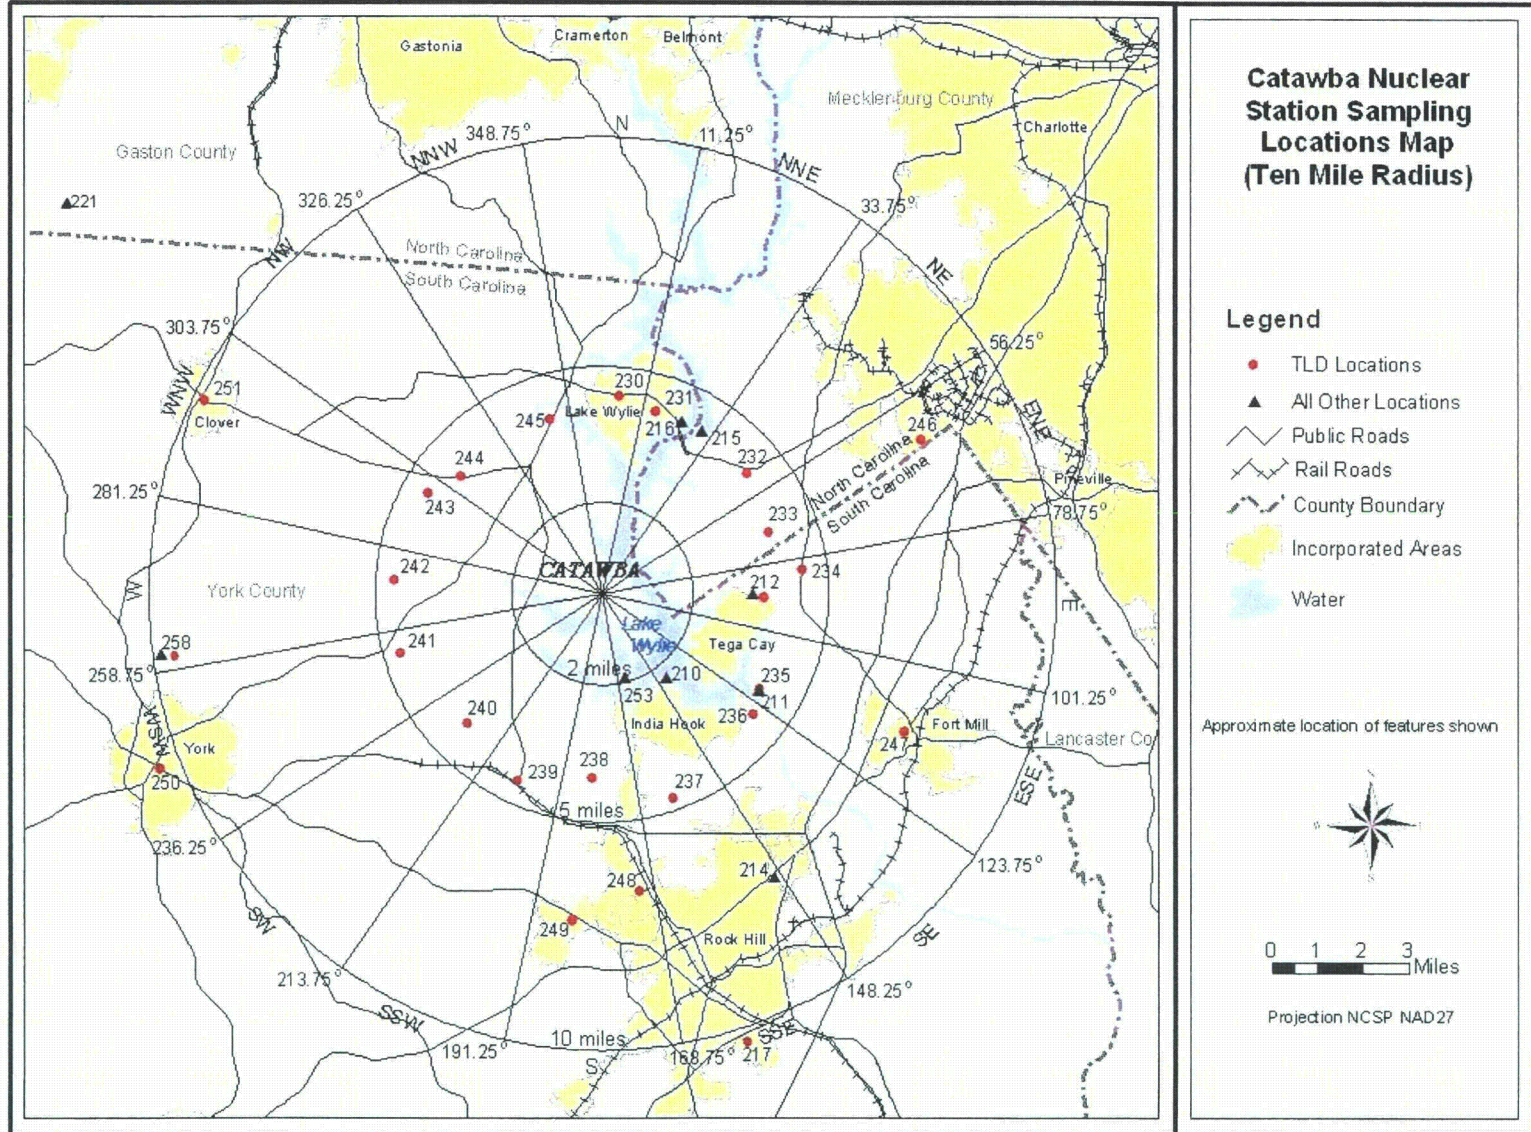


TABLE 2.1-A

**CATAWBA RADIOLOGICAL MONITORING PROGRAM
SAMPLING LOCATIONS**

| W | Weekly | SM | Semimonthly |
|----|----------|----|--------------|
| BW | BiWeekly | Q | Quarterly |
| M | Monthly | SA | Semiannually |
| C | Control | I | Indicator |

| Site # | Measure Type | Location Description* | Air Rad. & Part. | Surface Water | Drinking Water | Shoreline Sediment | Food Products (a) | Fish | Milk | Broad Leaf Veg. (b) | Ground Water |
|--------|--------------|--------------------------------------|------------------|---------------|----------------|--------------------|-------------------|------|------|---------------------|--------------|
| 200 | I | Site Boundary (0.63 mi NNE) | W | | | | | | | M | |
| 201 | I | Site Boundary (0.53 mi NE) | W | | | | | | | M | |
| 205 | I | Site Boundary (0.25 mi SW) | W | | | | | | | | |
| 208 | I | Discharge Canal (0.45 mi S) | | M | | SA | | SA | | | |
| 210 | I | Ebenezer Access (2.31 mi SE) | | | | SA | | | | | |
| 211 | I | Wylie Dam (4.06 mi ESE) | | M | | | | | | | |
| 212 | I | Tega Cay (3.32 mi E) | W | | | | | | | | |
| 214 | I | Rock Hill Water Supply (7.30 mi SSE) | | | M | | | | | | |
| 215 | C | River Pointe - Hwy 49 (4.21 mi NNE) | | M | | SA | | | | | |
| 216 | C | Hwy 49 Bridge (4.19 mi NNE) | | | | | | SA | | | |
| 218 | C | Belmont Water Supply (13.5 mi NNE) | | | M | | | | | | |
| 221 | C | Dairy (14.5 mi NW) | | | | | | | SM | | |
| 222 | I | Site Boundary (0.70 mi N) | | | | | | | | M | |
| 226 | I | Site Boundary (0.48 mi S) | | | | | | | | M | |
| 252 | I | Residence (0.64 mi SW) | | | | | | | | | Q |
| 253 | I | Irrigated Gardens (1.90 mi SSE) | | | | | M(a) | | | | |
| 254 | I | Residence (0.82 mi N) | | | | | | | | | Q |
| 258 | C | Fairhope Road (9.84 mi W) | W | | | | | | | M | |

- (a) During Harvest Season
- (b) When Available

* GPS data reflect approximate accuracy to within 2-5 meters. GPS field measurements were taken as close as possible to the item of interest.

TABLE 2.1-B

**CATAWBA RADIOLOGICAL MONITORING PROGRAM
SAMPLING LOCATIONS (TLD SITES)**

| Table 2.1-B Codes | | | |
|-------------------|------------|----|------------------|
| IR | Inner Ring | OR | Outer Ring |
| C | Control | SI | Special Interest |

| Site # | Measure Type | Location* | Distance (miles) | Sector | Site # | Measure Type | Location* | Distance (miles) | Sector |
|--------|--------------|-------------------------------|------------------|--------|--------|--------------|---------------------------------------|------------------|--------|
| 200 | IR | SITE BOUNDARY | 0.63 | NNE | 234 | OR | WACHOVIA BANK | 4.50 | E |
| 201 | IR | SITE BOUNDARY | 0.53 | NE | 235 | OR | LAKE WYLIE DAM | 4.07 | ESE |
| 203 | IR | SITE BOUNDARY | 0.38 | ESE | 236 | OR | SC WILDLIFE FEDERATION OFFICE | 4.25 | SE |
| 204 | IR | SITE BOUNDARY | 0.48 | SSW | 237 | OR | TWIN LAKES ROAD AND HOMESTEAD ROAD | 4.75 | SSE |
| 205 | IR | SITE BOUNDARY | 0.25 | SW | 238 | OR | PENNINGTON ROAD AND WEST OAK ROAD | 4.02 | S |
| 206 | IR | SITE BOUNDARY | 0.67 | WNW | 239 | OR | CARTER LUMBER COMPANY | 4.49 | SSW |
| 207 | IR | SITE BOUNDARY | 0.95 | NNW | 240 | OR | PARAHAM ROAD | 4.07 | SW |
| 212 | SI | TEGA CAY AIR SITE | 3.32 | E | 241 | OR | CAMPBELL ROAD | 4.58 | WSW |
| 217 | C | OLD ROCK HILL AIR SITE | 10.3 | SSE | 242 | OR | TRANSMISSION TOWER ON PARAHAM ROAD | 4.56 | W |
| 222 | IR | SITE BOUNDARY | 0.71 | N | 243 | OR | KINGSBERRY ROAD | 4.39 | WNW |
| 223 | IR | SITE BOUNDARY | 0.57 | E | 244 | OR | BETHEL ELEMENTARY SCHOOL | 4.02 | NW |
| 225 | IR | SITE BOUNDARY | 0.68 | SE | 245 | OR | CROWDERS CREEK BOAT LANDING | 4.01 | NNW |
| 226 | IR | SITE BOUNDARY | 0.48 | S | 246 | SI | CAROWINDS GUARD HOUSE | 7.87 | ENE |
| 227 | IR | SITE BOUNDARY | 0.52 | WSW | 247 | C | FORT MILL | 7.33 | ESE |
| 228 | IR | SITE BOUNDARY | 0.61 | W | 248 | SI | PIEDMONT MEDICAL CENTER | 6.54 | S |
| 229 | IR | SITE BOUNDARY | 0.84 | NW | 249 | SI | YORK COUNTY OPERATIONS CENTER | 7.17 | S |
| 230 | OR | RIVER HILLS CHURCH | 4.37 | N | 250 | SI | YORK DUKE POWER OFFICE | 10.4 | WSW |
| 231 | OR | RIVER HILLS FRONT ENTRANCE | 4.21 | NNE | 251 | C | CLOVER | 9.72 | WNW |
| 232 | OR | PLEASANT HILL ROAD | 4.18 | NE | 255 | IR | SITE BOUNDARY | 0.61 | ENE |
| 233 | OR | ZOAR ROAD AND THOMAS DRIVE | 3.95 | ENE | 256 | IR | SITE BOUNDARY | 0.58 | SSE |
| | | | | | 258 | SI | FAIRHOPE ROAD | 9.84 | W |

* GPS data reflect approximate accuracy to within 2-5 meters. GPS field measurements were taken as close as possible to the item of interest.

TABLE 2.2-A

**REPORTING LEVELS FOR RADIOACTIVITY
CONCENTRATIONS IN ENVIRONMENTAL SAMPLES**

| Analysis | Water (pCi/liter) | Air Particulates or Gases (pCi/m ³) | Fish (pCi/kg-wet) | Milk (pCi/liter) | Food Products (pCi/kg-wet) |
|-----------|---------------------------|---|----------------------|---------------------|-------------------------------|
| H-3 | 20,000 ^{(a),(b)} | | | | |
| Mn-54 | 1,000 | | 30,000 | | |
| Fe-59 | 400 | | 10,000 | | |
| Co-58 | 1,000 | | 30,000 | | |
| Co-60 | 300 | | 10,000 | | |
| Zn-65 | 300 | | 20,000 | | |
| Zr-Nb-95 | 400 | | | | |
| I-131 | 2 | 0.9 | | 3 | 100 |
| Cs-134 | 30 | 10 | 1,000 | 60 | 1,000 |
| Cs-137 | 50 | 20 | 2,000 | 70 | 2,000 |
| Ba-La-140 | 200 | | | 300 | |

- (a) If no drinking water pathway exists, a value of 30,000 pCi/liter may be used.
- (b) H-3 Reporting level not applicable to surface water

TABLE 2.2-B

REMP ANALYSIS FREQUENCY

| Sample Medium | Analysis Schedule | Gamma Isotopic | Tritium | Low Level I-131 | Gross Beta | TLD |
|----------------------|------------------------|-------------------|---------|--------------------|---------------|-----|
| Air Radioiodine | Weekly | X | | | | |
| Air Particulate | Weekly | X | | | X | |
| Direct Radiation | Quarterly | | | | | X |
| Surface Water | Monthly Composite | X | | | | |
| | Quarterly Composite | | X | | | |
| Drinking Water | Monthly Composite | X | | (a) | X | |
| | Quarterly Composite | | X | | | |
| Ground Water | Quarterly | X | X | | | |
| Shoreline Sediment | Semiannually | X | | | | |
| Milk | Semimonthly | X | | X | | |
| Fish | Semiannually | X | | | | |
| Broadleaf Vegetation | Monthly ^(b) | X | | | | |
| Food Products | Monthly ^(b) | X | | | | |

- (a) Low-level I-131 analysis will be performed if the dose calculated for the consumption of drinking water is > 1 mrem per year. An LLD of 1 pCi/liter will be required for this analysis.
- (b) When Available

TABLE 2.2-C

MAXIMUM VALUES FOR THE LOWER LIMIT OF DETECTION

| Analysis | Water (pCi/liter) | Air Particulates or Gases (pCi/m ³) | Fish (pCi/kg-wet) | Milk (pCi/liter) | Food Products (pCi/kg-wet) | Sediment (pCi/kg-dry) |
|------------|----------------------|---|----------------------|---------------------|-------------------------------|--------------------------|
| Gross Beta | 4 | 0.01 | | | | |
| H-3 | 2000 ^(a) | | | | | |
| Mn-54 | 15 | | 130 | | | |
| Fe-59 | 30 | | 260 | | | |
| Co-58, 60 | 15 | | 130 | | | |
| Zn-65 | 30 | | 260 | | | |
| Zr-Nb-95 | 15 | | | | | |
| I-131 | 1 ^(b) | 0.07 | | 1 | 60 | |
| Cs-134 | 15 | 0.05 | 130 | 15 | 60 | 150 |
| Cs-137 | 18 | 0.06 | 150 | 18 | 80 | 180 |
| Ba-La-140 | 15 | | | 15 | | |

(a) If no drinking water pathway exists, a value of 3000 pCi/liter may be used.

(b) If no drinking water pathway exists, the LLD of gamma isotopic analysis may be used.

3.0 INTERPRETATION OF RESULTS

Review of all 2010 REMP analysis results was performed to identify changes in environmental levels as a result of station operations. The following section depicts and explains the review of these results. Sample data for 2010 was compared to preoperational and historical data. Over the years of operation, analysis and collection changes have taken place that do not allow direct comparisons for some data collected from 1984 (preoperational) through 2010. Summary tables containing 2010 information required by Technical Specification Administrative Control 5.6.2 are located in Appendix B.

Evaluation for significant trends was performed for radionuclides that are listed as required within Selected Licensee Commitments 16.11-13. The radionuclides include: H-3, Mn-54, Fe-59, Co-58, Co-60, Zn-65, Zr-95, Nb-95, I-131, Cs-134, Cs-137, Ba-140 and La-140. Gross beta analysis results were trended for drinking water and gross beta trending for air particulates was initiated in 1996. Other radionuclides detected that are the result of plant operation, but not required for reporting, are trended.

A comparison of annual mean concentrations of effluent-based detected radionuclides to historical results provided trending bases. Frequency of detection and concentrations related to SLC reporting levels (Table 2.2-A) were used as criteria for trending conclusions. All 2010 maximum percentages of reporting levels were well below the 100% action level. The highest value noted during 2010 was 4.97% for H-3 in drinking water.

Selected Licensee Commitment section 16.11-13 addresses actions to be taken if radionuclides other than those required are detected in samples collected. The occurrences of these radionuclides are the result of CNS liquid effluents which contained the radionuclides.

During 1979-1986, all net activity results (sample minus background), both positive and negative were included in calculation of sample mean. A change in the EnRad gamma spectroscopy system on September 1, 1987, decreased the number of measurements yielding detectable low-level activity for indicator and control location samples. It was thought that the method used by the previous system was vulnerable to false-positive results.

All 2010 sample analysis results were reviewed to detect and identify any significant trends. Tables and graphs are used throughout this section to display data from effluent-based radionuclides identified since the system change in late 1987. All negative concentration values were replaced with zero for calculation purposes. Any zero concentrations used in tables or graphs represent activity measurements less than detectable levels.

Review of all 2010 data presented in this section supports the conclusion that there were no significant changes in environmental sample radionuclide concentrations of samples collected and analyzed from CNS site and surrounding areas that were attributable to plant operations.

3.1 AIRBORNE RADIOIODINE AND PARTICULATES

In 2010, 264 radioiodine and particulate samples were analyzed, 211 from four indicator locations and 53 at the control location. Particulate samples were analyzed weekly for gamma and gross beta. Radioiodine samples received a weekly gamma analysis.

Figure 3.1 shows individual sample gross beta results for the indicator location with highest annual mean and the control location samples during 2010. The two sample locations' results are similar in concentration and have varied negligibly since preoperational periods.


There were no detectable gamma emitters identified for particulate filters analyzed during 2010. Table 3.1-A shows the highest indicator annual mean and control location annual mean for gross beta in air particulate.

There was no detectable I-131 in air radioiodine samples analyzed in 2010. Table 3.1-B shows the highest indicator annual mean and control location annual mean for I-131 since 1984 (preoperational period).



K-40 and Be-7 that occur naturally were routinely detected in charcoal cartridges collected during the year. Cs-137 detection on the charcoal cartridge was determined in 1990 to be an active constituent of the charcoal. A similar study was performed in 2001 again yielding this conclusion. Therefore, any Cs-137 activities were not used in any dose calculations in Section 4.0 of this report.

Figure 3.1

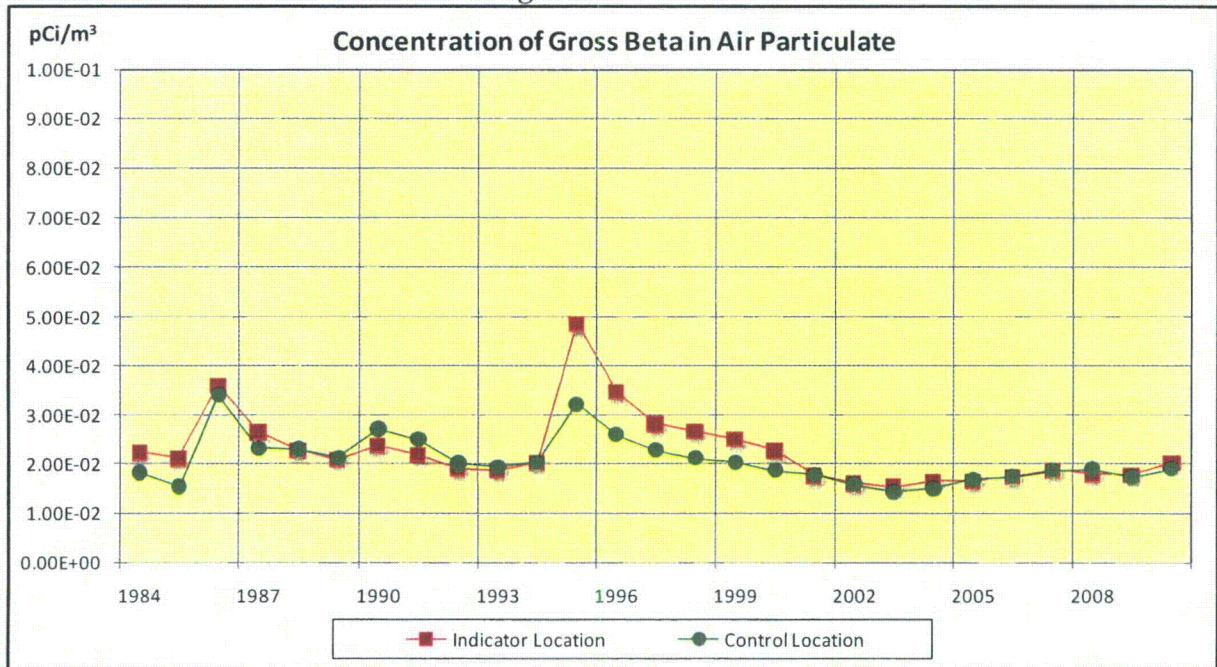

There is no reporting level for gross beta in air particulate

Table 3.1-A Mean Concentration of Gross Beta in Air Particulate

| Year | Indicator Location (pCi/m ³) | Control Location (pCi/m ³) |
|-----------------------|--|--|
| 1984 | 2.25E-2 | 1.82E-2 |
| 1985 | 2.12E-2 | 1.53E-2 |
| 1986 | 3.62E-2 | 3.41E-2 |
| 1987 | 2.67E-2 | 2.32E-2 |
| 1988 | 2.29E-2 | 2.30E-2 |
| 1989 | 2.11E-2 | 2.13E-2 |
| 1990 | 2.39E-2 | 2.72E-2 |
| 1991 | 2.19E-2 | 2.51E-2 |
| 1992 | 1.90E-2 | 2.01E-2 |
| 1993 | 1.87E-2 | 1.94E-2 |
| 1994 | 2.03E-2 | 2.03E-2 |
| 1995 | 4.88E-2 | 3.23E-2 |
| 1996 | 3.49E-2 | 2.60E-2 |
| 1997 | 2.83E-2 | 2.28E-2 |
| 1998 | 2.69E-2 | 2.12E-2 |
| 1999 | 2.53E-2 | 2.04E-2 |
| 2000 | 2.28E-2 | 1.86E-2 |
| 2001 | 1.76E-2 | 1.78E-2 |
| 2002 | 1.60E-2 | 1.57E-2 |
| 2003 | 1.54E-2 | 1.42E-2 |
| 2004 | 1.65E-2 | 1.49E-2 |
| 2005 | 1.66E-2 | 1.68E-2 |
| 2006 | 1.74E-2 | 1.74E-2 |
| 2007 | 1.88E-2 | 1.86E-2 |
| 2008 | 1.80E-2 | 1.90E-2 |
| 2009 | 1.78E-2 | 1.72E-2 |
| Average (2000 - 2009) | 1.77E-2 | 1.70E-2 |
| 2010 | 2.03E-2 | 1.90E-2 |

Table 3.1-B Mean Concentration of Air Radioiodine (I-131)

| Year | Indicator Location (pCi/m ³) | Control Location (pCi/m ³) |
|------|--|--|
| 1984 | 1.30E-3 | 1.46E-2 |
| 1985 | 4.75E-3 | 2.38E-2 |
| 1986 | 1.43E-2 | 1.02E-2 |
| 1987 | 1.38E-2 | 0.00E0 |
| 1988 | 0.00E0 | 0.00E0 |
| 1989 | 0.00E0 | 0.00E0 |
| 1990 | 0.00E0 | 0.00E0 |
| 1991 | 0.00E0 | 0.00E0 |
| 1992 | 0.00E0 | 0.00E0 |
| 1993 | 0.00E0 | 0.00E0 |
| 1994 | 0.00E0 | 0.00E0 |
| 1995 | 0.00E0 | 0.00E0 |
| 1996 | 0.00E0 | 0.00E0 |
| 1997 | 0.00E0 | 0.00E0 |
| 1998 | 0.00E0 | 0.00E0 |
| 1999 | 0.00E0 | 0.00E0 |
| 2000 | 0.00E0 | 0.00E0 |
| 2001 | 0.00E0 | 0.00E0 |
| 2002 | 0.00E0 | 0.00E0 |
| 2003 | 0.00E0 | 0.00E0 |
| 2004 | 0.00E0 | 0.00E0 |
| 2005 | 0.00E0 | 0.00E0 |
| 2006 | 0.00E0 | 0.00E0 |
| 2007 | 0.00E0 | 0.00E0 |
| 2008 | 0.00E0 | 0.00E0 |
| 2009 | 0.00E0 | 0.00E0 |
| 2010 | 0.00E0 | 0.00E0 |

0.00E0 = no detectable measurements

3.2 DRINKING WATER

Gross beta and gamma spectroscopy were performed on 26 drinking water samples. The samples were composited to create 8 quarterly samples that were analyzed for tritium. One indicator location was sampled, along with one control location.

No gamma emitting radionuclides were identified in 2010 drinking water samples. There have been no gamma emitting radionuclides identified in drinking water samples since 1988.

Table 3.2 shows highest annual mean gross beta concentrations for the indicator location and control location since preoperation. The indicator location (downstream of the plant effluent release point) average concentration was 1.84 pCi/l in 2010 and the control location concentration was 1.80 pCi/l. The 2009 indicator mean was 2.07 pCi/l. The table shows that current gross beta levels are not statistically different from preoperational concentrations.

Tritium was detected in the four indicator samples and the four control samples during 2010. The mean indicator tritium concentration for 2010 was 705 pCi/l, 3.53% of reporting level. The mean control tritium concentration for 2010 was 427 pCi/l, 2.14% of reporting level. Figure 3.2 and Table 3.2 display the highest indicator and control location annual mean concentrations for tritium since 1984.

The concentration of tritium in drinking water is affected by releases from the Catawba plant and the McGuire Nuclear Station, located approximately 40 miles upstream of the Catawba plant on the Catawba River.

The dose for consumption of water was less than one mrem per year, historically and for 2010; therefore low-level iodine analysis is not required.

Figure 3.2

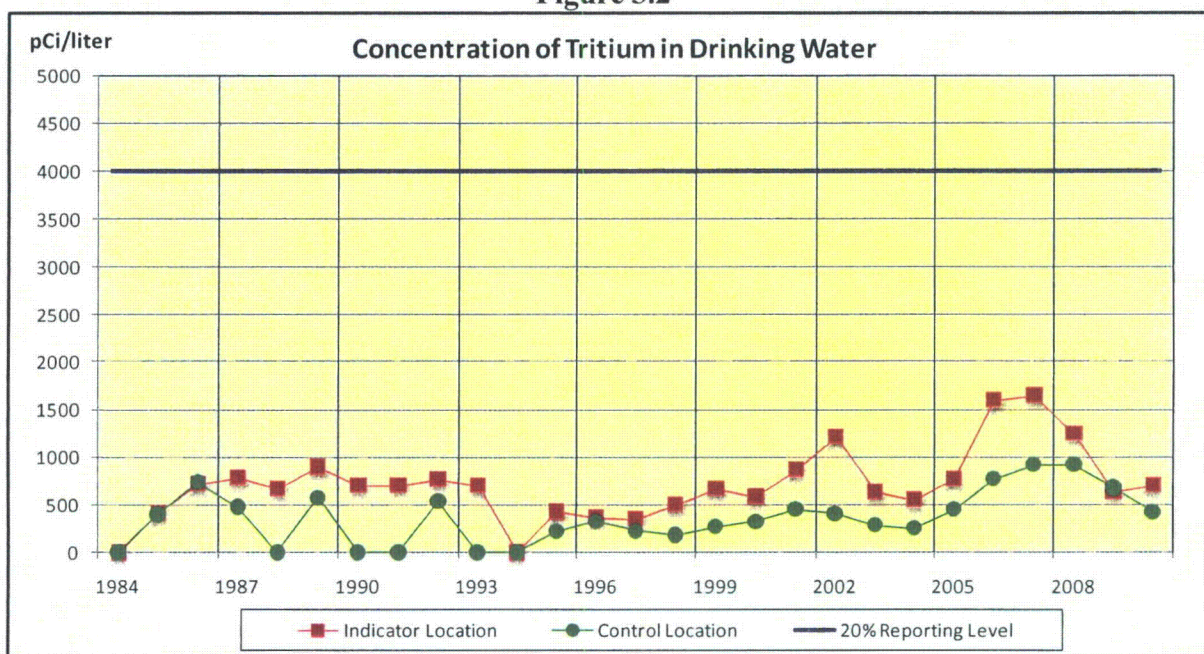


Table 3.2 Mean Concentration of Radionuclides in Drinking Water

| YEAR | Gross Beta (pCi/l) | | Tritium (pCi/l) | |
|------|--------------------|------------------|--------------------|------------------|
| | Indicator Location | Control Location | Indicator Location | Control Location |
| 1984 | 4.72 | 1.83 | 3.10E-2 | 3.10E-2 |
| 1985 | 2.70 | 2.24 | 4.13E2 | 4.00E2 |
| 1986 | 3.11 | 2.26 | 7.23E2 | 7.33E2 |
| 1987 | 3.10 | 2.40 | 7.80E2 | 4.80E2 |
| 1988 | 3.60 | 2.60 | 6.64E2 | 0.00E0 |
| 1989 | 3.60 | 2.90 | 8.91E2 | 5.72E2 |
| 1990 | 4.50 | 3.20 | 7.03E2 | 0.00E0 |
| 1991 | 3.70 | 2.20 | 7.04E2 | 0.00E0 |
| 1992 | 3.20 | 2.40 | 7.65E2 | 5.38E2 |
| 1993 | 3.50 | 2.50 | 7.06E2 | 0.00E0 |
| 1994 | 3.30 | 2.70 | 0.00E0 | 0.00E0 |
| 1995 | 4.80 | 4.50 | 4.28E2 | 2.21E2 |
| 1996 | 3.08 | 3.14 | 3.71E2 | 3.27E2 |
| 1997 | 3.74 | 3.15 | 3.54E2 | 2.28E2 |
| 1998 | 2.51 | 2.44 | 5.07E2 | 1.83E2 |
| 1999 | 3.55 | 2.48 | 6.71E2 | 2.70E2 |
| 2000 | 3.04 | 2.27 | 5.87E2 | 3.26E2 |
| 2001 | 3.49 | 2.30 | 8.66E2 | 4.50E2 |
| 2002 | 3.44 | 2.36 | 1.22E3 | 4.11E2 |
| 2003 | 2.27 | 2.02 | 6.36E2 | 2.88E2 |
| 2004 | 1.88 | 1.69 | 5.47E2 | 2.54E2 |
| 2005 | 2.05 | 1.84 | 7.69E2 | 4.50E2 |
| 2006 | 2.30 | 2.17 | 1.59E3 | 7.70E2 |
| 2007 | 2.34 | 2.21 | 1.65E3 | 9.18E2 |
| 2008 | 2.81 | 2.16 | 1.25E3 | 9.16E2 |
| 2009 | 2.07 | 1.99 | 6.34E2 | 6.81E2 |
| 2010 | 1.84 | 1.80 | 7.05E2 | 4.27E2 |

0.00E0 = no detectable measurements
 1984 - 1986 mean based on all net activity

3.3 SURFACE WATER

A total of 39 monthly surface water samples was analyzed for gamma emitting radionuclides. The samples were composited to create 12 quarterly samples for tritium analysis. Two indicator locations and one control location were sampled. One indicator location (208) is located near the liquid effluent discharge point.


All 2010 indicator location samples contained tritium with an average concentration of 3,970 pCi/l. Indicator Location 208 (Discharge Canal) showed a range of activities from 4,180 to 11,900 pCi/l which had the highest mean concentration of 7,260 pCi/l. Tritium was detected in three of the four control samples during 2010 with an average concentration of 294 pCi/l.

No gamma emitting radionuclides were identified in 2010 drinking water samples. Table 3.3 summarizes the indicator annual means of radionuclides detected since the change in the gamma spectroscopy analysis system in 1987.

Figure 3.3 displays the indicator and control annual means for tritium since 1984. Table 3.3 lists indicator annual means.

The concentration of tritium in surface water is affected by releases from the Catawba plant and the McGuire Nuclear Station, located approximately 40 miles upstream of the Catawba plant on the Catawba River.

Figure 3.3

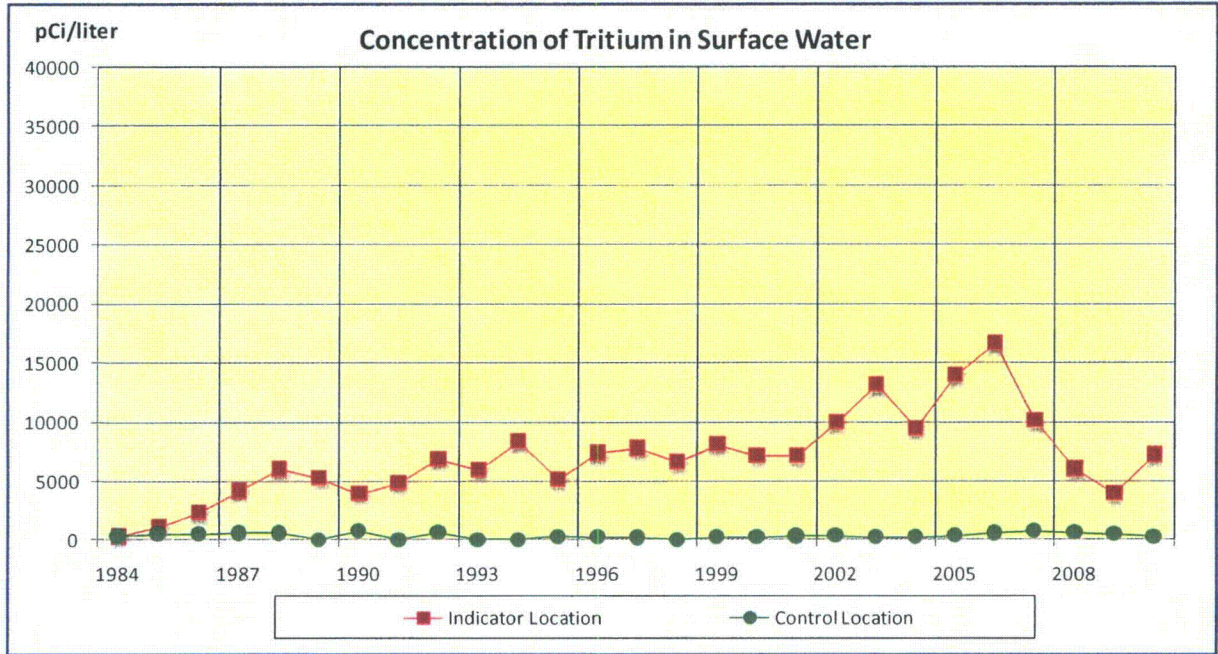

There is no reporting level for tritium in surface water, however, if no drinking water pathway exists, a value of 30,000 pCi/l may be used. A drinking water pathway exists for Catawba Nuclear Station, so this limit does not apply for surface water. See section 3.2 for drinking water results.

Table 3.3 Mean Concentrations of Radionuclides in Surface Water (pCi/l)

| YEAR | Co-58 | Co-60 | Nb-95 | Cs-137 | H-3 Indicator | H-3 Control |
|------|---------|----------|---------|---------|---------------|-------------|
| 1984 | 4.59E-1 | 5.71E-1 | 6.48E-1 | 9.08E-1 | 3.35E2 | 3.18E2 |
| 1985 | 3.46E0 | 4.83E-2 | 2.70E0 | 8.19E-1 | 1.19E3 | 5.05E2 |
| 1986 | 3.10E-1 | -4.12E-2 | 2.05E0 | 4.85E-1 | 2.34E3 | 5.05E2 |
| 1987 | 0.00E0 | 3.10E0 | 4.30E0 | 9.90E0 | 4.17E3 | 6.20E2 |
| 1988 | 9.20E0 | 0.00E0 | 0.00E0 | 0.00E0 | 6.03E3 | 6.07E2 |
| 1989 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 5.27E3 | 0.00E0 |
| 1990 | 6.50E0 | 0.00E0 | 0.00E0 | 0.00E0 | 3.98E3 | 7.73E2 |
| 1991 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 4.87E3 | 0.00E0 |
| 1992 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 6.91E3 | 6.64E2 |
| 1993 | 4.70E0 | 1.80E0 | 0.00E0 | 0.00E0 | 5.98E3 | 0.00E0 |
| 1994 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 8.42E3 | 0.00E0 |
| 1995 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 5.13E3 | 2.89E2 |
| 1996 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 7.36E3 | 2.61E2 |
| 1997 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 7.77E3 | 2.20E2 |
| 1998 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 6.61E3 | 0.00E0 |
| 1999 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 8.13E3 | 2.41E2 |
| 2000 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 7.19E3 | 2.56E2 |
| 2001 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 7.13E3 | 3.28E2 |
| 2002 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 1.00E4 | 3.80E2 |
| 2003 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 1.31E4 | 2.37E2 |
| 2004 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 9.43E3 | 2.60E2 |
| 2005 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 1.40E4 | 3.78E2 |
| 2006 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 1.67E4 | 5.83E2 |
| 2007 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 1.01E4 | 7.82E2 |
| 2008 | 6.80E0 | 1.16E1 | 0.00E0 | 0.00E0 | 6.02E3 | 6.31E2 |
| 2009 | 9.40E0 | 1.06E1 | 0.00E0 | 0.00E0 | 3.93E3 | 5.29E2 |
| 2010 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 7.26E3 | 2.94E2 |

0.00E0 = no detectable measurements 1984 - 1986 mean based on all net activity

3.4 GROUND WATER

A total of five ground water samples was collected and analyzed for gamma emitters and tritium. There are two indicator locations and no control locations. Naturally occurring K-40 was the only radionuclide identified during 2010.

There have been no radionuclides identified in ground water samples since 1988. Only naturally occurring K-40 and Be-7 were noted.

3.5 MILK

A total of 26 milk samples was analyzed by gamma spectroscopy and low level iodine during 2010. There was one control location sampled. No indicator dairies were identified by the 2010 land use census.

There were no gamma emitting radionuclides identified in milk during 2010. Airborne Cs-137 has not been released from the plant since 1992.

Cs-137 was last detected in an indicator sample during 1996. The occurrence of Cs-137 in milk samples has been noted several times since 1984. Cs-137 attributable to past nuclear weapons testing is known to exist in many environmental media at low, highly variable levels.

Table 3.5 lists highest indicator location annual mean and control location annual mean for Cs-137 since the preoperational period. Concentrations are similar for the two sample types. Cs-137 is the only radionuclide, other than K-40 and Be-7, reported in milk samples since 1988.

Table 3.5 Mean Concentration of Radionuclides in Milk

| YEAR | Cs-137 Indicator (pCi/l) | Cs-137 Control (pCi/l) |
|------|--------------------------|------------------------|
| 1984 | 2.95E0 | 2.98E0 |
| 1985 | 2.11E0 | 2.12E0 |
| 1986 | 3.76E0 | 4.54E0 |
| 1987 | 5.00E0 | 5.50E0 |
| 1988 | 3.20E0 | 3.80E0 |
| 1989 | 0.00E0 | 0.00E0 |
| 1990 | 8.00E0 | 6.70E0 |
| 1991 | 0.00E0 | 0.00E0 |
| 1992 | 3.40E0 | 5.00E0 |
| 1993 | 5.00E0 | 0.00E0 |
| 1994 | 2.80E0 | 0.00E0 |
| 1995 | 8.60E0 | 0.00E0 |
| 1996 | 6.05E0 | 0.00E0 |
| 1997 | 0.00E0 | 0.00E0 |
| 1998 | 0.00E0 | 0.00E0 |
| 1999 | 0.00E0 | 0.00E0 |
| 2000 | 0.00E0 | 0.00E0 |
| 2001 | 0.00E0 | 0.00E0 |
| 2002 | 0.00E0 | 0.00E0 |
| 2003 | 0.00E0 | 0.00E0 |
| 2004 | NO INDICATOR LOCATION | 0.00E0 |
| 2005 | NO INDICATOR LOCATION | 0.00E0 |
| 2006 | NO INDICATOR LOCATION | 0.00E0 |
| 2007 | NO INDICATOR LOCATION | 0.00E0 |
| 2008 | NO INDICATOR LOCATION | 0.00E0 |
| 2009 | NO INDICATOR LOCATION | 0.00E0 |
| 2010 | NO INDICATOR LOCATION | 0.00E0 |

0.00E0 = no detectable measurements

1984 - 1986 mean based on all net activity

3.6 BROADLEAF VEGETATION

Gamma spectroscopy was performed on 60 broadleaf vegetation samples during 2010. Four indicator locations and one control location were sampled.

Three of the forty-eight samples collected at indicator locations contained detectable Cs-137 activity. Cs-137 was detected in three of the twelve samples collected at Location 201. The highest concentration detected at Location 201 was 55.8 pCi/kg which is 2.79% of the reporting level. Cs-137 was not detected in any of the twelve control location samples.

Figure 3.6 shows indicator and control annual means for Cs-137 in vegetation since 1984. Table 3.6 lists indicator and annual means. Values shown from 1984 to 2010 show a stable trend for Cs-137 in vegetation.

No airborne Cs-137 has been released from the plant since 1992. Cs-137 attributable to past nuclear weapons testing is known to exist in many environmental media at low and highly variable levels.



K-40 and Be-7 were observed in broadleaf vegetation samples.

Figure 3.6

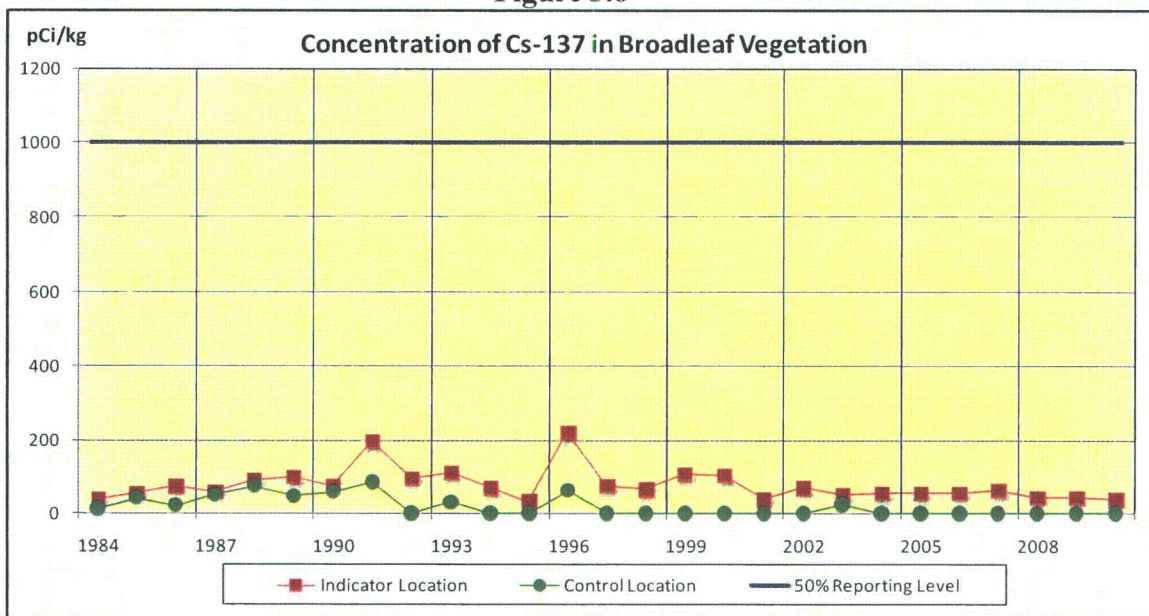


Table 3.6 Mean Concentration of Radionuclides in Broadleaf Vegetation

| YEAR | Cs-137 Indicator (pCi/kg) | Cs-137 Control (pCi/kg) |
|------|---------------------------|-------------------------|
| 1984 | 3.76E1 | 1.30E1 |
| 1985 | 5.48E1 | 4.16E1 |
| 1986 | 7.42E1 | 2.22E1 |
| 1987 | 6.10E1 | 5.10E1 |
| 1988 | 9.10E1 | 7.40E1 |
| 1989 | 1.00E2 | 4.80E1 |
| 1990 | 7.70E1 | 5.80E1 |
| 1991 | 1.98E2 | 8.60E1 |
| 1992 | 9.70E1 | 0.00E0 |
| 1993 | 1.13E2 | 3.20E1 |
| 1994 | 7.00E1 | 0.00E0 |
| 1995 | 3.60E1 | 0.00E0 |
| 1996 | 2.23E2 | 6.22E1 |
| 1997 | 7.57E1 | 0.00E0 |
| 1998 | 6.53E1 | 0.00E0 |
| 1999 | 1.08E2 | 0.00E0 |
| 2000 | 1.04E2 | 0.00E0 |
| 2001 | 3.76E1 | 0.00E0 |
| 2002 | 7.02E1 | 0.00E0 |
| 2003 | 4.96E1 | 2.40E1 |
| 2004 | 5.45E1 | 0.00E0 |
| 2005 | 5.48E1 | 0.00E0 |
| 2006 | 5.79E1 | 0.00E0 |
| 2007 | 6.31E1 | 0.00E0 |
| 2008 | 4.44E1 | 0.00E0 |
| 2009 | 4.25E1 | 0.00E0 |
| 2010 | 3.77E1 | 0.00E0 |

0.00E0 = no detectable measurements
 1984 - 1986 mean based on all net activity

3.7 FOOD PRODUCTS

Collection of food product samples (crops) from an irrigated garden began in 1989. The garden is located on Lake Wylie downstream from CNS, Location 253. During the 2010 growing season, six samples were collected and analyzed for gamma radionuclides. There is no control location for this media type.



Table 3.7 shows Cs-137 indicator location highest annual mean concentrations since 1989.

Table 3.7 Mean Concentration of Radionuclides in Food Products

| YEAR | Cs-137 Indicator (pCi/kg) |
|------|---------------------------|
| 1989 | 0.00E0 |
| 1990 | 0.00E0 |
| 1991 | 0.00E0 |
| 1992 | 0.00E0 |
| 1993 | 2.50E1 |
| 1994 | 0.00E0 |
| 1995 | 0.00E0 |
| 1996 | 0.00E0 |
| 1997 | 0.00E0 |
| 1998 | 0.00E0 |
| 1999 | 0.00E0 |
| 2000 | 0.00E0 |
| 2001 | 0.00E0 |
| 2002 | 0.00E0 |
| 2003 | 0.00E0 |
| 2004 | 0.00E0 |
| 2005 | 0.00E0 |
| 2006 | 0.00E0 |
| 2007 | 0.00E0 |
| 2008 | 0.00E0 |
| 2009 | 0.00E0 |
| 2010 | 0.00E0 |

0.00E0 = no detectable measurements
 There is no control location for Food Products.

3.8 FISH

Gamma spectroscopy was performed on 12 fish samples collected during 2010. One downstream indicator location and one control location were sampled.

Co-58, Co-60, and Cs-137 are normally the predominant radionuclides identified in fish samples. There were no gamma emitting radionuclides identified in any indicator location or control location fish samples during 2010.

Figures 3.8-1 and 3.8-2 are graphs displaying annual mean concentrations for Co-58 and Co-60. Table 3.8 depicts the highest indicator location annual mean for radionuclides detected. In addition, radionuclides identified in fish samples since 1988 have been included in the table. Overall, radionuclides have not shown a significant trend or accumulation.



K-40 was observed in fish samples collected during 2010.

Figure 3.8-1

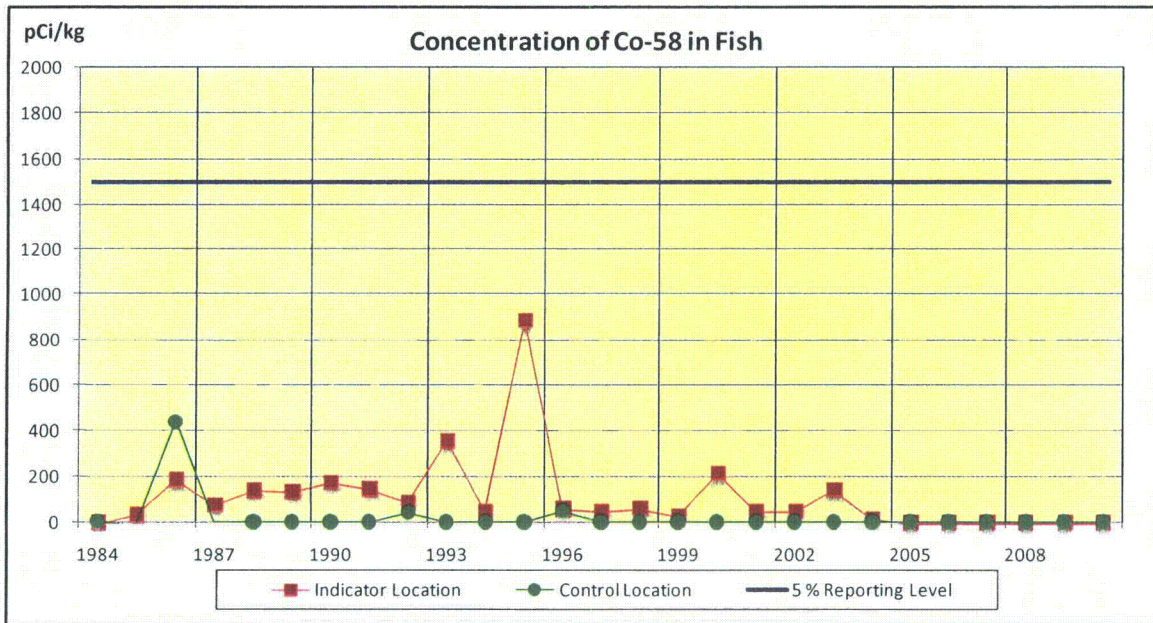


Figure 3.8-2

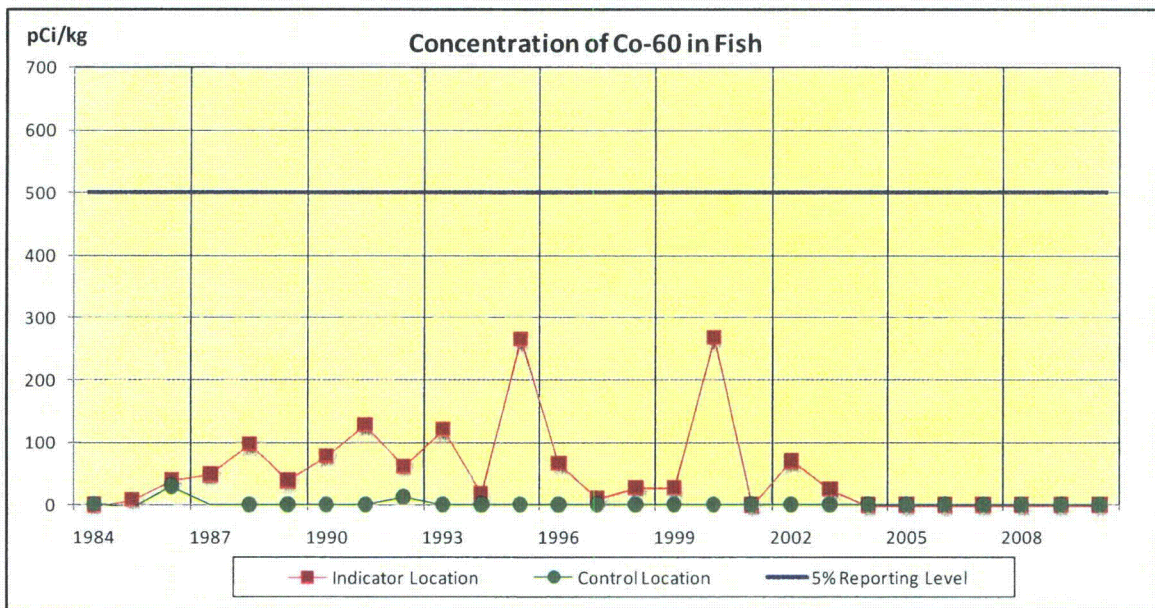


Table 3.8 Mean Concentrations of Radionuclides in Fish (pCi/kg)

| Year | Mn-54 | Co-58 | Co-60 | Cs-134 | Cs-137 | Nb-95 | Fe-59 | Sb-122 | Sb-125 |
|------|---------|--------|---------|---------|--------|---------|--------|--------|--------|
| 1984 | 3.07E0 | 3.00E0 | 6.11E-1 | -5.32E0 | 1.83E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 1985 | 7.68E-1 | 3.40E1 | 9.11E0 | 3.22E0 | 1.28E1 | 5.07E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 1986 | 2.01E1 | 1.86E2 | 4.01E1 | 3.51E1 | 9.29E1 | 0.00E0 | 7.30E0 | 0.00E0 | 0.00E0 |
| 1987 | 7.24E0 | 7.57E1 | 4.81E1 | 3.83E0 | 4.27E1 | 5.40E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 1988 | 2.85E1 | 1.40E2 | 9.70E1 | 1.67E1 | 8.24E1 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 1989 | 8.28E0 | 1.33E2 | 3.83E1 | 1.47E1 | 4.37E1 | 8.58E-1 | 0.00E0 | 0.00E0 | 0.00E0 |
| 1990 | 2.51E1 | 1.75E2 | 7.77E1 | 1.32E1 | 4.66E1 | 3.33E0 | 0.00E0 | 7.00E0 | 9.25E0 |
| 1991 | 3.15E1 | 1.46E2 | 1.29E2 | 1.03E1 | 4.60E1 | 7.90E-1 | 2.30E0 | 0.00E0 | 7.45E0 |
| 1992 | 1.34E1 | 9.02E1 | 6.20E1 | 1.27E1 | 4.61E1 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 1993 | 2.14E1 | 3.58E2 | 1.21E2 | 2.73E0 | 2.56E1 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 1994 | 1.91E0 | 4.75E1 | 1.81E1 | 0.00E0 | 1.75E1 | 0.00E0 | 0.00E0 | 0.00E0 | 1.45E1 |
| 1995 | 5.65E1 | 8.90E2 | 2.66E2 | 0.00E0 | 6.77E1 | 1.38E1 | 0.00E0 | 0.00E0 | 0.00E0 |
| 1996 | 0.00E0 | 5.95E1 | 6.68E1 | 0.00E0 | 3.02E1 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 1997 | 0.00E0 | 4.93E1 | 9.88E0 | 0.00E0 | 2.74E1 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 1998 | 0.00E0 | 6.44E1 | 2.86E1 | 0.00E0 | 1.58E1 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 1999 | 0.00E0 | 3.12E1 | 2.71E1 | 0.00E0 | 1.87E1 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 2000 | 0.00E0 | 2.13E2 | 2.69E2 | 0.00E0 | 1.52E1 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 2001 | 0.00E0 | 4.66E1 | 0.00E0 | 0.00E0 | 2.08E1 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 2002 | 0.00E0 | 5.23E1 | 7.00E1 | 0.00E0 | 1.73E1 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 2003 | 0.00E0 | 1.43E2 | 2.61E1 | 0.00E0 | 1.19E1 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 2004 | 4.92E1 | 1.81E1 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 2005 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 2006 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 1.44E1 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 2007 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 2008 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 2009 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 2010 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |

0.00E0 = no detectable measurements

3.9 SHORELINE SEDIMENT

During 2010, a total of 6 shoreline sediment samples was analyzed, four from two indicator locations and two from the control location.


Co-58 and Co-60 were identified in two samples collected from indicator location 208-1S, which is closest to the plant's liquid effluent release point. Cs-137 was identified in one sample collected from location 208-1S. Naturally occurring K-40 was identified in many of the indicator and control locations. Activity released in plant effluents has decreased since 1996 and as a result decreased activity has been measured in the environment.

The shoreline sediment location with the highest annual mean for all detectable radionuclides was location 208-1S. Co-58 was identified at location 208-1S with an annual mean concentration of 65.6 pCi/kg. Co-60 was identified with an annual mean concentration of 137 pCi/kg. Cs-137 was identified with an annual mean concentration of 25.6 pCi/kg. Naturally occurring K-40 and Be-7 were also identified in samples from this location.

Table 3.9 lists highest indicator location annual mean since 1984. Included in the table are radionuclides that have been identified in shoreline sediment samples since 1988.


Figure 3.9-1 graphically depicts Co-58 annual mean concentrations. Figure 3.9-2 depicts Co-60 annual mean concentrations.

Figure 3.9-1

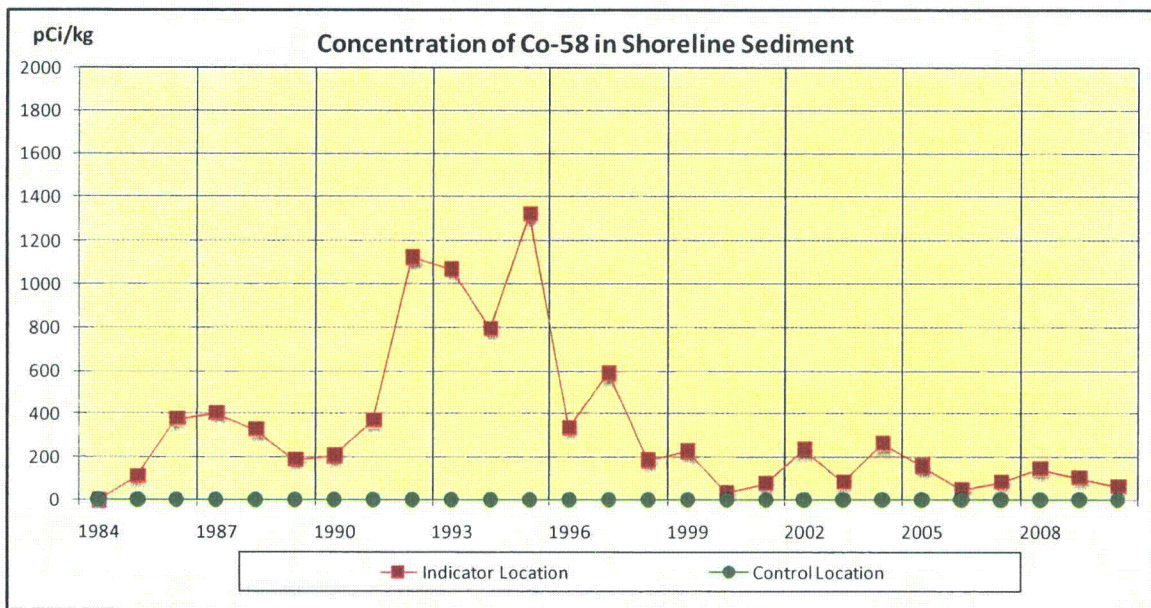

There is no reporting level for Co-58 in Shoreline Sediment

Figure 3.9-2

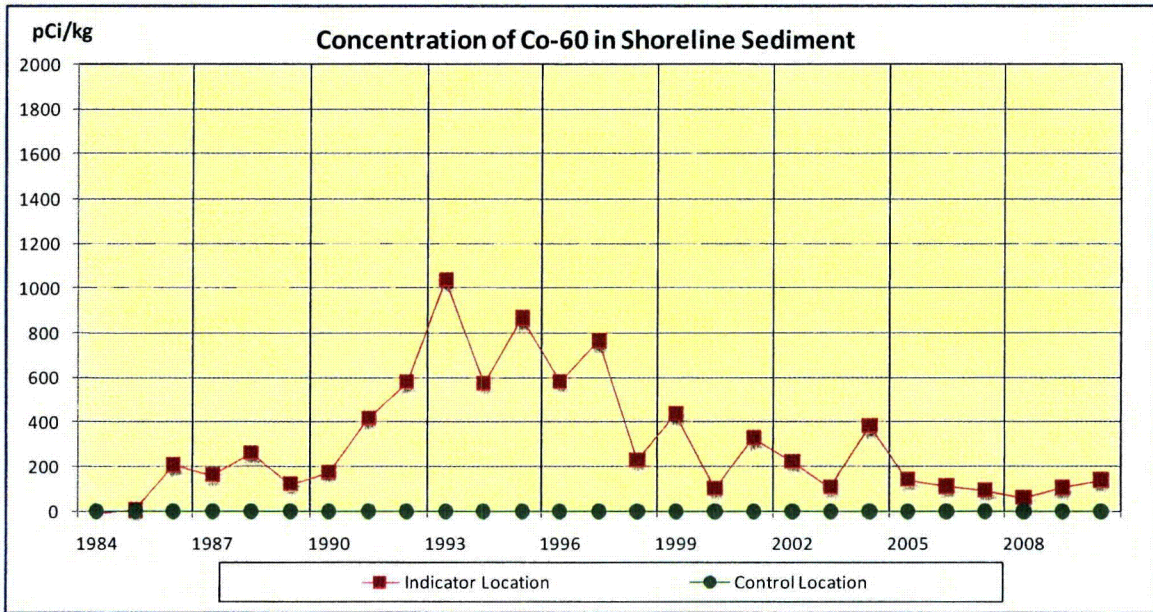

There is no reporting level for Co-60 in Shoreline Sediment

Table 3.9 Mean Concentrations of Radionuclides in Shoreline Sediment (pCi/kg)

| Year | Mn-54 | Co-58 | Co-60 | Nb-95 | Zr-95 | Cs-134 | Cs-137 | Co-57 | Sb-125 |
|------|---------|--------|---------|--------|--------|--------|--------|---------|--------|
| 1984 | 1.03E0 | 4.40E0 | -2.34E0 | 0.00E0 | 0.00E0 | 3.19E1 | 1.07E2 | 0.00E0 | 0.00E0 |
| 1985 | -3.12E0 | 1.16E2 | 5.18E0 | 0.00E0 | 0.00E0 | 2.11E2 | 2.97E2 | 0.00E0 | 0.00E0 |
| 1986 | 1.09E2 | 3.79E2 | 2.05E2 | 0.00E0 | 3.96E1 | 6.50E1 | 1.61E2 | 0.00E0 | 0.00E0 |
| 1987 | 8.83E1 | 4.08E2 | 1.61E2 | 4.22E1 | 0.00E0 | 6.08E1 | 1.26E2 | 0.00E0 | 0.00E0 |
| 1988 | 1.07E2 | 3.29E2 | 2.63E2 | 2.28E1 | 7.54E0 | 2.59E1 | 1.07E2 | 7.65E-1 | 3.68E0 |
| 1989 | 4.58E1 | 1.94E2 | 1.21E2 | 5.02E0 | 0.00E0 | 1.65E1 | 5.77E1 | 0.00E0 | 1.57E1 |
| 1990 | 5.39E1 | 2.08E2 | 1.77E2 | 0.00E0 | 0.00E0 | 1.66E1 | 8.18E1 | 0.00E0 | 7.15E0 |
| 1991 | 8.50E1 | 3.70E2 | 4.19E2 | 5.30E0 | 0.00E0 | 1.82E1 | 8.33E1 | 1.20E0 | 1.50E1 |
| 1992 | 1.17E2 | 1.13E3 | 5.80E2 | 3.50E0 | 0.00E0 | 1.69E1 | 1.07E2 | 3.00E0 | 2.70E1 |
| 1993 | 1.33E2 | 1.07E3 | 1.04E3 | 0.00E0 | 0.00E0 | 2.80E1 | 1.26E2 | 2.47E1 | 2.16E2 |
| 1994 | 4.93E1 | 7.98E2 | 5.73E2 | 0.00E0 | 0.00E0 | 5.67E0 | 1.07E2 | 4.38E0 | 4.60E1 |
| 1995 | 1.02E2 | 1.33E3 | 8.65E2 | 1.13E2 | 0.00E0 | 0.00E0 | 8.50E1 | 3.69E1 | 1.49E2 |
| 1996 | 8.73E1 | 3.39E2 | 5.81E2 | 0.00E0 | 0.00E0 | 0.00E0 | 8.30E1 | 0.00E0 | 1.96E2 |
| 1997 | 6.96E1 | 5.90E2 | 7.64E2 | 0.00E0 | 0.00E0 | 0.00E0 | 1.43E2 | 0.00E0 | 1.76E2 |
| 1998 | 3.07E1 | 1.88E2 | 2.30E2 | 0.00E0 | 0.00E0 | 0.00E0 | 7.11E1 | 0.00E0 | 0.00E0 |
| 1999 | 7.28E1 | 2.29E2 | 4.39E2 | 0.00E0 | 0.00E0 | 0.00E0 | 9.42E1 | 0.00E0 | 1.40E2 |
| 2000 | 0.00E0 | 3.90E1 | 1.03E2 | 0.00E0 | 0.00E0 | 0.00E0 | 4.96E1 | 0.00E0 | 0.00E0 |
| 2001 | 3.86E1 | 8.27E1 | 3.29E2 | 0.00E0 | 0.00E0 | 0.00E0 | 5.58E1 | 0.00E0 | 0.00E0 |
| 2002 | 3.51E1 | 2.41E2 | 2.22E2 | 0.00E0 | 0.00E0 | 0.00E0 | 8.83E1 | 0.00E0 | 0.00E0 |
| 2003 | 2.17E1 | 8.75E1 | 1.08E2 | 0.00E0 | 0.00E0 | 0.00E0 | 2.69E1 | 0.00E0 | 0.00E0 |
| 2004 | 6.60E1 | 2.67E2 | 3.83E2 | 0.00E0 | 0.00E0 | 0.00E0 | 3.79E1 | 0.00E0 | 0.00E0 |
| 2005 | 0.00E0 | 1.61E2 | 1.41E2 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 2006 | 0.00E0 | 5.40E1 | 1.11E2 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 | 0.00E0 |
| 2007 | 0.00E0 | 8.77E1 | 9.46E1 | 0.00E0 | 0.00E0 | 0.00E0 | 6.13E1 | 0.00E0 | 0.00E0 |
| 2008 | 0.00E0 | 1.48E2 | 6.24E1 | 0.00E0 | 0.00E0 | 0.00E0 | 2.57E1 | 0.00E0 | 0.00E0 |
| 2009 | 0.00E0 | 1.10E2 | 1.04E2 | 0.00E0 | 0.00E0 | 0.00E0 | 2.27E1 | 0.00E0 | 0.00E0 |
| 2010 | 0.00E0 | 6.56E1 | 1.37E2 | 0.00E0 | 0.00E0 | 0.00E0 | 2.56E1 | 0.00E0 | 0.00E0 |

0.00E0 = no detectable measurements
 1984 - 1986 mean based on all net activity
 Negative values are calculated as zeroes

3.10 DIRECT GAMMA RADIATION

3.10.1 ENVIRONMENTAL TLD

In 2010, 163 TLDs were analyzed, 151 at indicator locations and 12 at control locations. TLDs are collected and analyzed quarterly. The highest annual mean exposure for an indicator location was 96.0 milliroentgen. The annual mean exposure for the control locations was 57.2 milliroentgen.



Figure 3.10-1 and Table 3.10-A show TLD inner ring (site boundary), outer Ring (4-5 miles), and control location annual averages in milliroentgen per year. Preoperational data and rolling ten year operational data averages are also given. As shown in the graph, inner ring, outer ring, and control data averages historically compare closely. Inner and outer ring averages comprise a number of data points with control averages representing only three locations.

Figures 3.10-2 and 3.10-3 show the TLD mean for each inner and outer ring TLD location from 1986 through 2010.

The calculated total body dose (from gaseous effluents) for 2010 was 2.25E0 mrem, which is 2.76% of the average inner ring TLD values. Therefore, it can be concluded that discharges from the plant had very little impact upon the measured TLD values.

A TLD intercomparison program is conducted as part of the quality assurance program. Results of this program are included in section 5.10.


3.10.2 ISFSI

The Catawba Independent Spent Fuel Storage Installation (ISFSI) is a secured area constructed to provide dry storage for spent nuclear fuel. The principal components of the ISFSI are concrete vertical storage modules that hold stainless steel dry storage canisters containing irradiated fuel assemblies.

The ISFSI is located approximately 300 meters north of the Unit 2 reactor building. TLD results are evaluated quarterly to identify trends and demonstrate compliance with dose and dose rate limits at the ISFSI boundaries, the Owner Control fence north of ISFSI and at the Exclusion Area Boundary in the west sector. Catawba began storage of spent fuel at the ISFSI in 2007. Six storage modules were loaded with spent fuel in 2010 for a total of sixteen modules.

Doses measured by environmental TLDs show little or no change since the current TLD system was implemented.

Figure 3.10-1

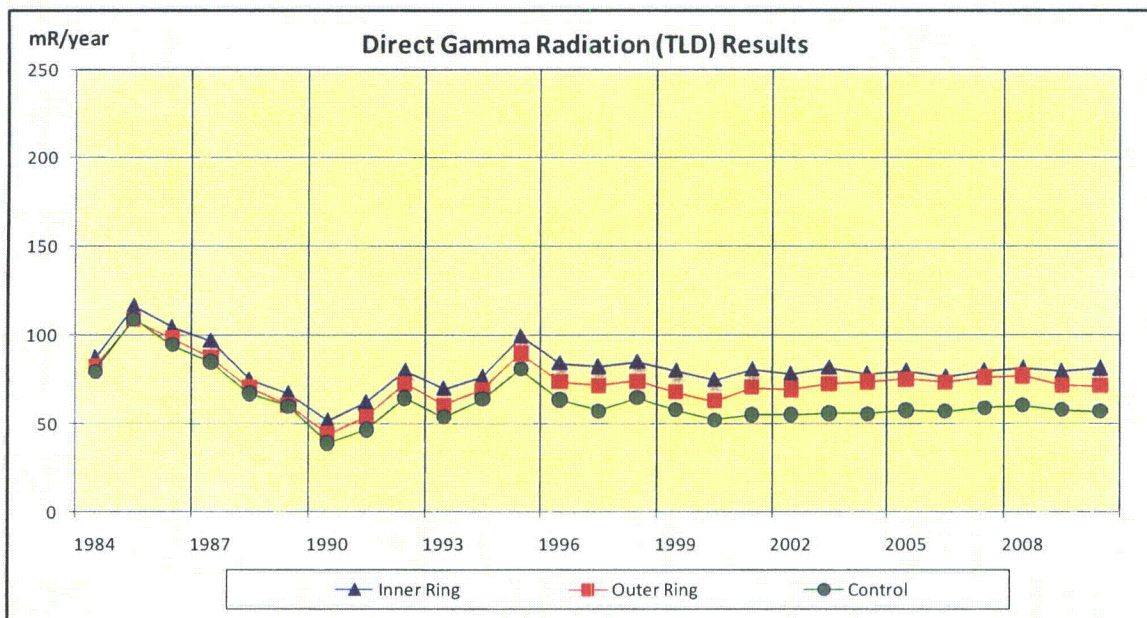

There is no reporting level for Direct Radiation (TLD)

Table 3.10-A Direct Gamma Radiation (TLD) Results

| Year | Inner Ring Average (mR/yr) | Outer Ring Average (mR/yr) | Control Average (mR/yr) |
|-----------------------|-------------------------------|-------------------------------|----------------------------|
| 1984* | 87.5 | 82.6 | 79.3 |
| 1985 | 116.9 | 108.7 | 108.9 |
| 1986 | 104.3 | 98.5 | 94.4 |
| 1987 | 97.0 | 87.4 | 84.7 |
| 1988 | 74.6 | 70.3 | 67.1 |
| 1989 | 67.1 | 60.8 | 60.0 |
| 1990 | 52.0 | 44.5 | 39.1 |
| 1991 | 62.0 | 54.1 | 46.7 |
| 1992 | 80.4 | 72.5 | 64.5 |
| 1993 | 70.3 | 60.9 | 53.6 |
| 1994 | 76.3 | 69.3 | 63.9 |
| 1995 | 99.6 | 89.7 | 80.8 |
| 1996 | 84.3 | 73.9 | 63.6 |
| 1997 | 82.4 | 71.9 | 57.4 |
| 1998 | 85.3 | 74.2 | 64.6 |
| 1999 | 80.0 | 68.1 | 57.8 |
| 2000 | 75.0 | 63.0 | 52.4 |
| 2001 | 81.0 | 70.5 | 55.2 |
| 2002 | 78.8 | 69.5 | 55.2 |
| 2003 | 81.7 | 72.6 | 56.0 |
| 2004 | 78.6 | 73.8 | 55.6 |
| 2005 | 79.8 | 75.2 | 57.7 |
| 2006 | 76.9 | 73.6 | 57.2 |
| 2007 | 80.5 | 76.4 | 59.2 |
| 2008 | 81.5 | 77.1 | 60.4 |
| 2009 | 79.9 | 71.9 | 58.0 |
| Average (2000 – 2009) | 79.4 | 72.4 | 56.7 |
| 2010 | 81.4 | 71.6 | 57.2 |

* Preoperational Data

Figure 3.10-2

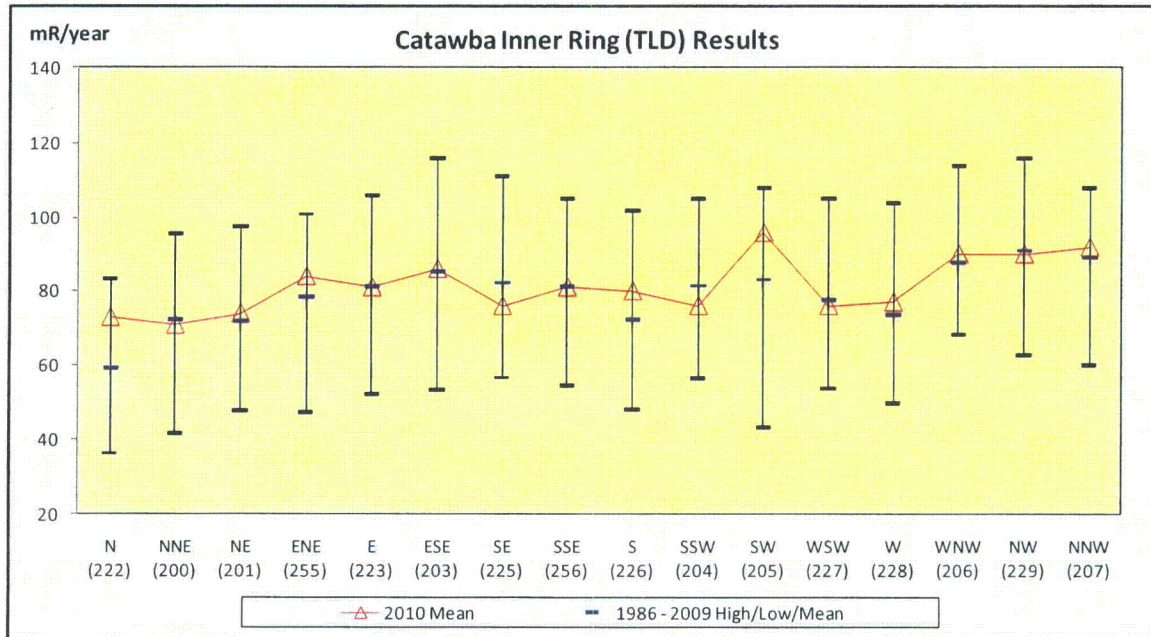


Table 3.10-B Direct Gamma Radiation (TLD) Results Inner Ring

| Sector (Location) | 1986 - 2009 Mean | 1986 - 2009 Low | 1986 - 2009 High | 2010 Mean |
|----------------------|------------------|-----------------|------------------|-----------|
| N (222) | 5.93E+01 | 3.63E+01 | 8.33E+01 | 7.30E+01 |
| NNE (200) | 7.25E+01 | 4.17E+01 | 9.54E+01 | 7.10E+01 |
| NE (201) | 7.21E+01 | 4.75E+01 | 9.76E+01 | 7.40E+01 |
| ENE (255) | 7.83E+01 | 4.74E+01 | 1.01E+02 | 8.40E+01 |
| E (223) | 8.11E+01 | 5.22E+01 | 1.06E+02 | 8.10E+01 |
| ESE (203) | 8.53E+01 | 5.32E+01 | 1.16E+02 | 8.60E+01 |
| SE (225) | 8.22E+01 | 5.66E+01 | 1.11E+02 | 7.60E+01 |
| SSE (256) | 8.11E+01 | 5.45E+01 | 1.05E+02 | 8.10E+01 |
| S (226) | 7.25E+01 | 4.81E+01 | 1.02E+02 | 8.00E+01 |
| SSW (204) | 8.14E+01 | 5.63E+01 | 1.05E+02 | 7.60E+01 |
| SW (205) | 8.30E+01 | 4.33E+01 | 1.08E+02 | 9.60E+01 |
| WSW (227) | 7.76E+01 | 5.37E+01 | 1.05E+02 | 7.60E+01 |
| W (228) | 7.36E+01 | 4.97E+01 | 1.04E+02 | 7.70E+01 |
| WNW (206) | 8.76E+01 | 6.83E+01 | 1.14E+02 | 9.00E+01 |
| NW (229) | 9.10E+01 | 6.27E+01 | 1.16E+02 | 9.00E+01 |
| NNW (207) | 8.90E+01 | 5.99E+01 | 1.08E+02 | 9.20E+01 |

Figure 3.10-3

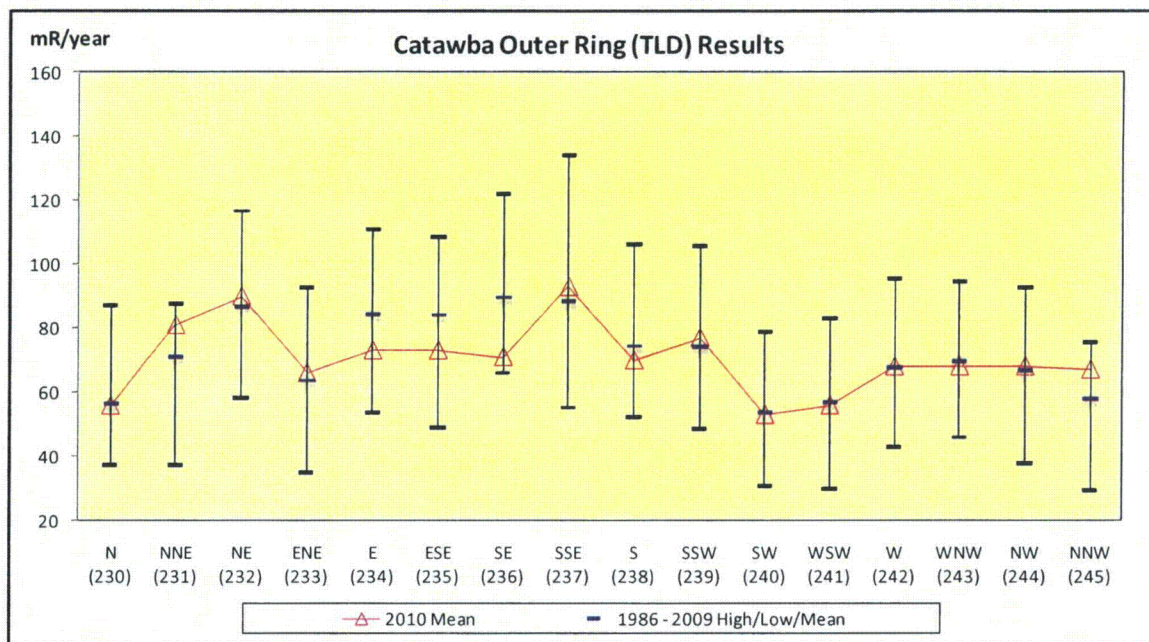


Table 3.10-C Direct Gamma Radiation (TLD) Results Outer Ring

| Sector (Location) | 1986 - 2009 Mean | 1986 - 2009 Low | 1986 - 2009 High | 2010 Mean |
|-------------------|------------------|-----------------|------------------|-----------|
| N (230) | 5.65E+01 | 3.72E+01 | 8.73E+01 | 5.60E+01 |
| NNE (231) | 7.10E+01 | 3.75E+01 | 8.75E+01 | 8.10E+01 |
| NE (232) | 8.70E+01 | 5.85E+01 | 1.17E+02 | 9.00E+01 |
| ENE (233) | 6.38E+01 | 3.50E+01 | 9.27E+01 | 6.60E+01 |
| E (234) | 8.45E+01 | 5.37E+01 | 1.11E+02 | 7.30E+01 |
| ESE (235) | 8.43E+01 | 4.89E+01 | 1.09E+02 | 7.30E+01 |
| SE (236) | 8.99E+01 | 6.60E+01 | 1.22E+02 | 7.10E+01 |
| SSE (237) | 8.87E+01 | 5.53E+01 | 1.34E+02 | 9.30E+01 |
| S (238) | 7.45E+01 | 5.24E+01 | 1.06E+02 | 7.00E+01 |
| SSW (239) | 7.43E+01 | 4.87E+01 | 1.06E+02 | 7.70E+01 |
| SW (240) | 5.39E+01 | 3.10E+01 | 7.87E+01 | 5.30E+01 |
| WSW (241) | 5.69E+01 | 2.99E+01 | 8.29E+01 | 5.60E+01 |
| W (242) | 6.76E+01 | 4.31E+01 | 9.55E+01 | 6.80E+01 |
| WNW (243) | 6.98E+01 | 4.60E+01 | 9.47E+01 | 6.80E+01 |
| NW (244) | 6.67E+01 | 3.78E+01 | 9.26E+01 | 6.80E+01 |
| NNW (245) | 5.81E+01 | 2.95E+01 | 7.55E+01 | 6.70E+01 |

3.11 LAND USE CENSUS

The 2010 Annual Land Use Census was conducted July 14, and July 15, 2010 as required by SLC 16.11-14. Table 3.11 summarizes census results. A map indicating identified locations is shown in Figure 3.11.


During the 2010 census, two nearer residences were identified; no irrigated gardens (superior to existing gardens) or milk locations were identified. The nearest residence is located in the NE sector at 0.56 miles. No environmental program changes were required as a result of the 2010 land use census.

Table 3.11 Catawba 2010 Land Use Census Results

| Sector | | Distance (Miles) | Sector | | Distance (Miles) |
|---------------|----------------------------|-----------------------------|---------------|---------------------|-----------------------------|
| N | Nearest Residence | 0.63 | S | Nearest Residence | 0.63 |
| | Nearest Garden (irrigated) | 1.55 | | Nearest Garden | 1.25 |
| | Nearest Milk Animal | - | | Nearest Milk Animal | - |
| NNE | Nearest Residence | 0.66 | SSW | Nearest Residence | 0.81 |
| | Nearest Garden | 4.39 | | Nearest Garden | 2.04 |
| | Nearest Milk Animal | - | | Nearest Milk Animal | - |
| NE | Nearest Residence | 0.56 | SW | Nearest Residence | 0.63 |
| | Nearest Garden | 0.68 | | Nearest Garden | 2.29 |
| | Nearest Milk Animal | - | | Nearest Milk Animal | - |
| ENE | Nearest Residence | 0.61 | WSW | Nearest Residence | 0.60 |
| | Nearest Garden | 2.84 | | Nearest Garden | 1.10 |
| | Nearest Milk Animal | - | | Nearest Milk Animal | - |
| E | Nearest Residence | 0.65 | W | Nearest Residence | 0.68 |
| | Nearest Garden | 3.51 | | Nearest Garden | 0.96 |
| | Nearest Milk Animal | - | | Nearest Milk Animal | - |
| ESE | Nearest Residence | 0.84 | WNW | Nearest Residence | 1.10 |
| | Nearest Garden | 3.70 | | Nearest Garden | 1.87 |
| | Nearest Milk Animal | - | | Nearest Milk Animal | - |
| SE | Nearest Residence | 0.97 | NW | Nearest Residence | 1.39 |
| | Nearest Garden (irrigated) | 2.55 | | Nearest Garden | 1.54 |
| | Nearest Milk Animal | - | | Nearest Milk Animal | - |
| SSE | Nearest Residence | 0.74 | NNW | Nearest Residence | 0.91 |
| | Nearest Garden | 1.64 | | Nearest Garden | 2.21 |
| | Nearest Milk Animal | - | | Nearest Milk Animal | - |

“-“ indicates no occurrences within the 5 mile radius

Figure 3.11

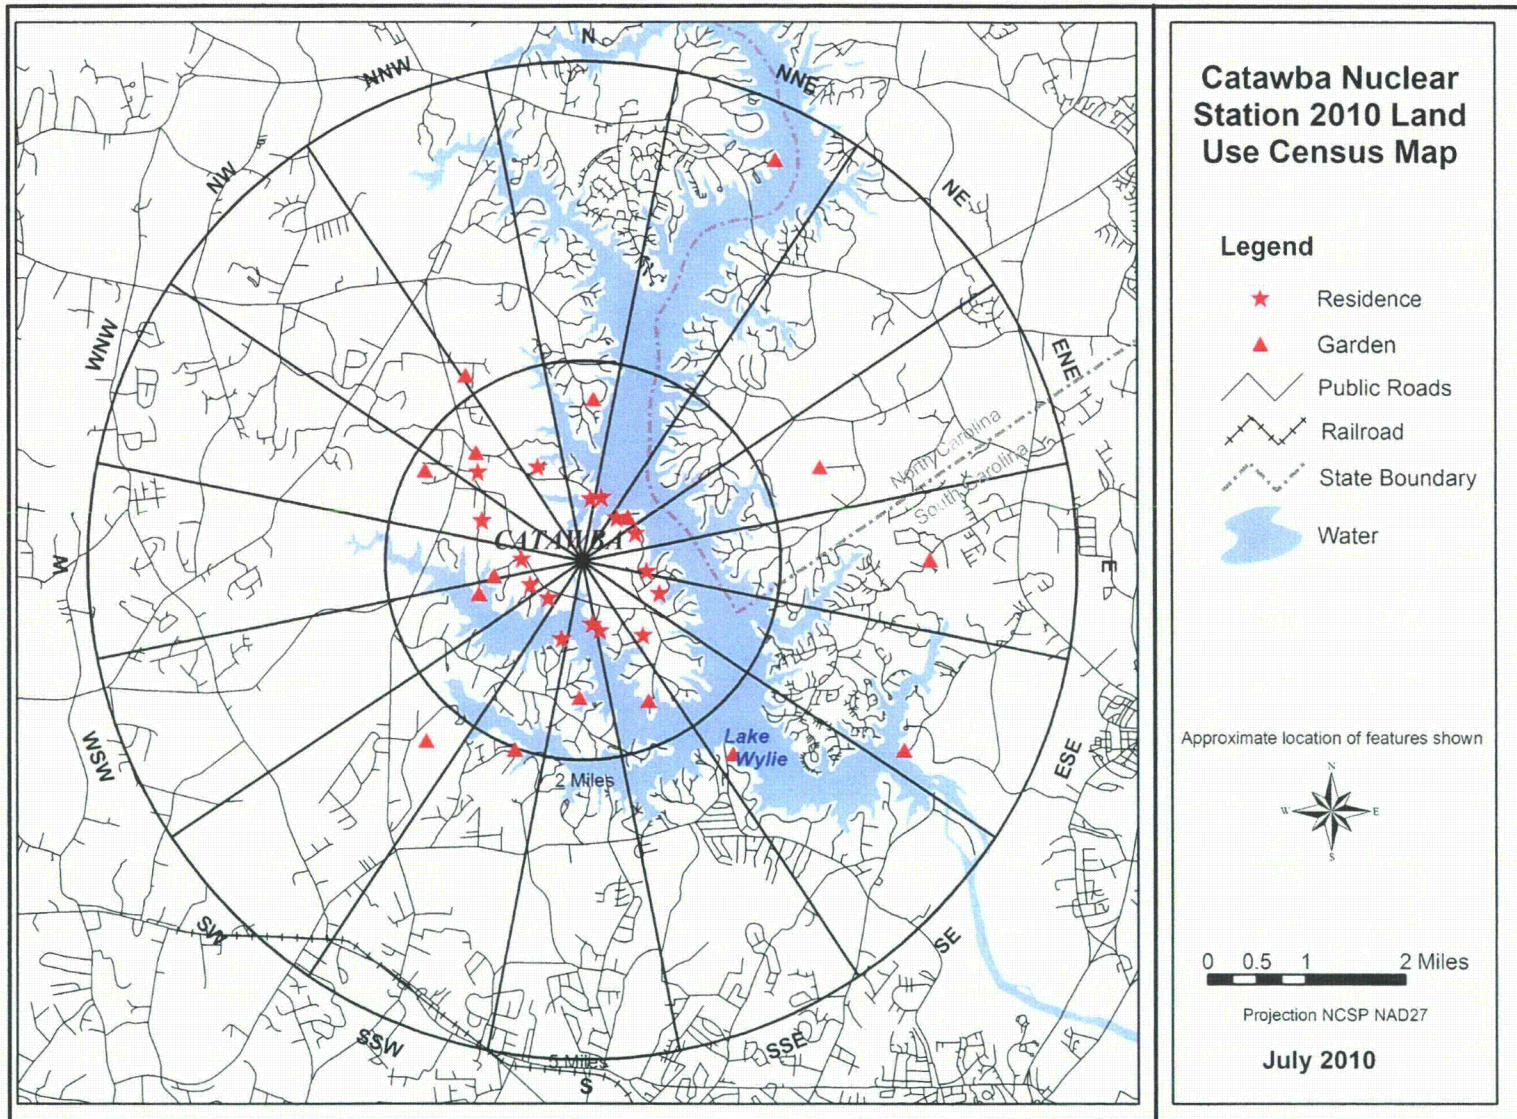

4.0 EVALUATION OF DOSE

4.1 DOSE FROM ENVIRONMENTAL MEASUREMENTS

Annual doses to maximum exposed individuals were estimated based on measured concentrations of radionuclides in 2010 CNS REMP samples. The primary purpose of estimating doses based on sample results is to allow comparison to effluent program dose estimates.

Doses based on sample results were calculated using the methodology and data presented in NRC Regulatory Guide 1.109. Measured radionuclide concentrations, averaged over the entire year for a specific radionuclide, indicator location and sample type, were used to calculate REMP-based doses. Where applicable, average background concentration at the corresponding control location was subtracted. Regulatory Guide 1.109 consumption rates for the maximum exposed individual were used in the calculations. When the guide listed "NO DATA" as the dose factor for a given radionuclide and organ, a dose factor of zero was assumed.

Maximum dose estimates (Highest Annual Mean Concentration) based on broadleaf vegetation, drinking water, fish, and shoreline sediment sample results are reported in Table 4.1-A. The individual critical population and pathway dose calculations are reported in Table 4.1-B.

REMP-based dose estimates are not reported for airborne radioiodine, airborne particulate, milk, or ground water sample types because no radionuclides other than naturally occurring K-40 and Be-7 were detected in the samples. Dose estimates are not reported for surface water because sampled surface water is not considered to be a potable drinking water source although surface water tritium concentrations are used in calculating doses from fish. Exposure estimates based upon REMP TLD results are discussed in Section 3.10.

The maximum environmental organ dose estimate for any single sample type (excluding TLD results) collected during 2010 was $3.21\text{E-}1$ mrem to the maximum exposed child bone from consuming broadleaf vegetation.

4.2 ESTIMATED DOSE FROM RELEASES

Throughout the year, dose estimates were calculated based on actual 2010 liquid and gaseous effluent release data. Effluent-based dose estimates were calculated using the RETDAS computer program which employs methodology and data presented in NRC Regulatory Guide 1.109. These doses are shown in Table 4.1-A along with the corresponding REMP-based dose estimates. Summaries of RETDAS dose calculations are reported in the Annual Radioactive Effluent Release Report (reference 6.6).

The effluent-based liquid release doses are summations of the dose contributions from the drinking water, fish, and shoreline pathways. For iodine, particulate, and tritium exposure the effluent-based gaseous release doses are summations of the dose contributors from ground/plane, inhalation, milk and vegetation pathways.

4.3 COMPARISON OF DOSES

The environmental and effluent dose estimates given in Table 4.1-A agree reasonably well. The similarity of the doses indicate that the radioactivity levels in the environment do not differ significantly from those expected based on effluent measurements and modeling of the environmental exposure pathways. This indicates that effluent program dose estimates are both valid and reasonably conservative.

There are some differences in how effluent and environmental doses are calculated that affect the comparison. Doses calculated from environmental data are conservative because they are based on a mean that includes only samples with a net positive activity versus a mean that includes all sample results (i.e. zero results are not included in the mean). Also, airborne tritium is not measured in environmental samples but is used to calculate effluent doses.

In addition, Catawba began reporting estimated dose from effluent Carbon 14 (C-14). This change came about with the issuing of Regulatory Guide 1.21, Revision 2, Measuring, Evaluating and Reporting Radioactive Material in Liquid and Gaseous Effluents and Solid Waste. A description of this change is found in the 2010 Annual Radiological Effluent Release Report. C-14 is not measured in the environment and therefore, environmental and effluent doses from C-14 cannot be compared directly.

In calculations based on liquid release pathways, drinking water, fish, and shoreline sediment were the predominant dose pathways based on environmental and effluent data. The maximum total organ dose based on 2010 environmental sample results was 3.79E-2 mrem to the child total body. The maximum total organ dose of 1.06E-1 mrem for liquid effluent-based estimates was to the adult GI-LLI.

In calculations based on gaseous release pathways, vegetation was the predominant dose pathway for effluent samples. The maximum total organ dose for gaseous effluent estimates was 4.78E0 mrem to the child bone. Vegetation was the predominant dose pathway for environmental samples. The maximum total organ dose for gaseous environmental estimates was 3.21E-1 mrem to the child bone.

The doses calculated do not exceed 40CFR190 or 10CFR50 dose commitment limits for members of the public. Doses to members of the public attributable to the operation of CNS are being maintained well within regulatory limits.

TABLE 4.1-A

CATAWBA NUCLEAR STATION
2010 ENVIRONMENTAL AND EFFLUENT DOSE COMPARISON

LIQUID RELEASE PATHWAY

| Organ | Environmental or Effluent Data | Critical Age ⁽¹⁾ | Critical Pathway ⁽²⁾ | Location | Maximum Dose ⁽³⁾ (mrem) |
|---------|--------------------------------|-----------------------------|---------------------------------|-------------------|------------------------------------|
| Skin | Environmental | Teen | Shoreline Sediment | 208 (0.45 mi S) | 1.82E-03 |
| Skin | Effluent | Teen | Shoreline Sediment | Discharge Pt. | 9.79E-03 |
| Bone | Environmental | - | - | - | 0.00E+00 |
| Bone | Effluent | Teen | Fish | Discharge Pt. | 2.53E-02 |
| Liver | Environmental | Child | Drinking Water | 214 (7.30 mi SSE) | 3.76E-02 |
| Liver | Effluent | Child | Drinking Water | 7.30 mi SSE | 1.04E-01 |
| T. Body | Environmental | Child | Drinking Water | 214 (7.30 mi SSE) | 3.79E-02 |
| T. Body | Effluent | Child | Drinking Water | 7.30 mi SSE | 8.75E-02 |
| Thyroid | Environmental | Child | Drinking Water | 214 (7.30 mi SSE) | 3.76E-02 |
| Thyroid | Effluent | Child | Drinking Water | 7.30 mi SSE | 8.32E-02 |
| Kidney | Environmental | Child | Drinking Water | 214 (7.30 mi SSE) | 3.76E-02 |
| Kidney | Effluent | Child | Drinking Water | 7.30 mi SSE | 9.00E-02 |
| Lung | Environmental | Child | Drinking Water | 214 (7.30 mi SSE) | 3.76E-02 |
| Lung | Effluent | Child | Drinking Water | 7.30 mi SSE | 8.57E-02 |
| GI-LLI | Environmental | Child | Drinking Water | 214 (7.30 mi SSE) | 3.76E-02 |
| GI-LLI | Effluent | Adult | Drinking Water | 7.30 mi SSE | 1.06E-01 |

- (1) Critical Age is the highest total dose (all pathways) to an age group.
- (2) Critical Pathway is the highest individual dose within the identified Critical Age group.
- (3) Maximum dose is a summation of the fish, drinking water and shoreline sediment pathways.

GASEOUS RELEASE PATHWAY**IODINE, PARTICULATE, and TRITIUM**

| Organ | Environmental or Effluent Data | Critical Age ⁽¹⁾ | Critical Pathway ⁽²⁾ | Location | Maximum Dose ⁽³⁾ (mrem) |
|--------------|---------------------------------------|------------------------------------|--|------------------|---|
| Skin | Environmental | - | - | - | 0.00E+00 |
| Skin | Effluent | All | Ground Plane | 0.5 mi NE | 1.80E-03 |
| Bone | Environmental | Child | Vegetation | 201 (0.53 mi NE) | 3.21E-01 |
| Bone | Effluent | Child | Vegetation | 0.5 mi NE | 4.78E+00 |
| Liver | Environmental | Child | Vegetation | 201 (0.53 mi NE) | 3.07E-01 |
| Liver | Effluent | Child | Vegetation | 0.5 mi NE | 2.25E+00 |
| T. Body | Environmental | Adult | Vegetation | 201 (0.53 mi NE) | 1.72E-01 |
| T. Body | Effluent | Child | Vegetation | 0.5 mi NE | 2.25E+00 |
| Thyroid | Environmental | - | - | - | 0.00E+00 |
| Thyroid | Effluent | Child | Vegetation | 0.5 mi NE | 2.25E+00 |
| Kidney | Environmental | Child | Vegetation | 201 (0.53 mi NE) | 1.00E-01 |
| Kidney | Effluent | Child | Vegetation | 0.5 mi NE | 2.25E+00 |
| Lung | Environmental | Child | Vegetation | 201 (0.53 mi NE) | 3.60E-02 |
| Lung | Effluent | Child | Vegetation | 0.5 mi NE | 2.25E+00 |
| GI-LLI | Environmental | Adult | Vegetation | 201 (0.53 mi NE) | 5.09E-03 |
| GI-LLI | Effluent | Child | Vegetation | 0.5 mi NE | 2.25E+00 |

(1) Critical Age is the highest total dose (all pathways) to an age group.

(2) Critical Pathway is the highest individual dose within the identified Critical Age group.

(3) Maximum dose is a summation of the ground/plane, inhalation, milk and vegetation pathways.

TABLE 4.1-B

Maximum Individual Dose for 2010 based on Environmental Measurements (mrem) for Catawba Nuclear Station

| Age | Sample Medium | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI | Skin |
|---------------|----------------------|----------|----------|----------|----------|----------|----------|----------|----------|
| Infant | Airborne | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| | Drinking Water | 0.00E+00 | 2.83E-02 | 2.83E-02 | 2.83E-02 | 2.83E-02 | 2.83E-02 | 2.83E-02 | 0.00E+00 |
| | Milk | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| | <u>TOTAL</u> | 0.00E+00 | 2.83E-02 | 2.83E-02 | 2.83E-02 | 2.83E-02 | 2.83E-02 | 2.83E-02 | 0.00E+00 |
| Child | Airborne | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| | Drinking Water | 0.00E+00 | 2.88E-02 | 2.88E-02 | 2.88E-02 | 2.88E-02 | 2.88E-02 | 2.88E-02 | 0.00E+00 |
| | Milk | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| | Broadleaf Vegetation | 3.21E-01 | 3.07E-01 | 4.53E-02 | 0.00E+00 | 1.00E-01 | 3.60E-02 | 1.92E-03 | 0.00E+00 |
| | Fish | 0.00E+00 | 8.78E-03 | 8.78E-03 | 8.78E-03 | 8.78E-03 | 8.78E-03 | 8.78E-03 | 0.00E+00 |
| | Shoreline Sediment | 0.00E+00 | 0.00E+00 | 3.24E-04 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 3.81E-04 |
| | <u>TOTAL</u> | 3.21E-01 | 3.45E-01 | 8.32E-02 | 3.76E-02 | 1.38E-01 | 7.36E-02 | 3.95E-02 | 3.81E-04 |
| Teen | Airborne | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| | Drinking Water | 0.00E+00 | 1.50E-02 | 1.50E-02 | 1.50E-02 | 1.50E-02 | 1.50E-02 | 1.50E-02 | 0.00E+00 |
| | Milk | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| | Broadleaf Vegetation | 1.77E-01 | 2.36E-01 | 8.22E-02 | 0.00E+00 | 8.03E-02 | 3.12E-02 | 3.36E-03 | 0.00E+00 |
| | Fish | 0.00E+00 | 1.06E-02 | 1.06E-02 | 1.06E-02 | 1.06E-02 | 1.06E-02 | 1.06E-02 | 0.00E+00 |
| | Shoreline Sediment | 0.00E+00 | 0.00E+00 | 1.55E-03 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 1.82E-03 |
| | <u>TOTAL</u> | 1.77E-01 | 2.62E-01 | 1.09E-01 | 2.56E-02 | 1.06E-01 | 5.68E-02 | 2.90E-02 | 1.82E-03 |
| Adult | Airborne | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| | Drinking Water | 0.00E+00 | 2.13E-02 | 2.13E-02 | 2.13E-02 | 2.13E-02 | 2.13E-02 | 2.13E-02 | 0.00E+00 |
| | Milk | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| | Broadleaf Vegetation | 1.92E-01 | 2.63E-01 | 1.72E-01 | 0.00E+00 | 8.93E-02 | 2.97E-02 | 5.09E-03 | 0.00E+00 |
| | Fish | 0.00E+00 | 1.38E-02 | 1.38E-02 | 1.38E-02 | 1.38E-02 | 1.38E-02 | 1.38E-02 | 0.00E+00 |
| | Shoreline Sediment | 0.00E+00 | 0.00E+00 | 2.78E-04 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 3.27E-04 |
| | <u>TOTAL</u> | 1.92E-01 | 2.98E-01 | 2.07E-01 | 3.51E-02 | 1.24E-01 | 6.48E-02 | 4.02E-02 | 3.27E-04 |

Note: Dose tables are provided for sample media displaying positive nuclide occurrence.

Catawba Nuclear Station
Dose from Drinking Water Pathway for 2010 Data
Maximum Exposed Infant

Infant Dose from Drinking Water Pathway (mrem) = Usage (l) x Dose Factor (mrem/pCi ingested) x Concentration (pCi/l)

Usage (intake in one year) = 330 l

| Radionuclide | <u>Ingestion Dose Factor</u> | | | | | | | <u>Highest Annual Net Mean Concentration</u> | | <u>Dose (mrem)</u> | | | | | | |
|--------------------------|------------------------------|----------|----------|----------|----------|----------|----------|--|---------------|--------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI | Indicator Location | Water (pCi/l) | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Mn-54 | NO DATA | 1.99E-05 | 4.51E-06 | NO DATA | 4.41E-06 | NO DATA | 7.31E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Co-58 | NO DATA | 3.60E-06 | 8.98E-06 | NO DATA | NO DATA | NO DATA | 8.97E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Fe-59 | 3.08E-05 | 5.38E-05 | 2.12E-05 | NO DATA | NO DATA | 1.59E-05 | 2.57E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Co-60 | NO DATA | 1.08E-05 | 2.55E-05 | NO DATA | NO DATA | NO DATA | 2.57E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Zn-65 | 1.84E-05 | 6.31E-05 | 2.91E-05 | NO DATA | 3.06E-05 | NO DATA | 5.33E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Nb-95 | 4.20E-08 | 1.73E-08 | 1.00E-08 | NO DATA | 1.24E-08 | NO DATA | 1.46E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Zr-95 | 2.06E-07 | 5.02E-08 | 3.56E-08 | NO DATA | 5.41E-08 | NO DATA | 2.50E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| I-131 | 3.59E-05 | 4.23E-05 | 1.86E-05 | 1.39E-02 | 4.94E-05 | NO DATA | 1.51E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-134 | 3.77E-04 | 7.03E-04 | 7.10E-05 | NO DATA | 1.81E-04 | 7.42E-05 | 1.91E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-137 | 5.22E-04 | 6.11E-04 | 4.33E-05 | NO DATA | 1.64E-04 | 6.64E-05 | 1.91E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| BaLa-140 | 1.71E-04 | 1.71E-07 | 8.81E-06 | NO DATA | 4.06E-08 | 1.05E-07 | 4.20E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| II-3 | NO DATA | 3.08E-07 | 3.08E-07 | 3.08E-07 | 3.08E-07 | 3.08E-07 | 3.08E-07 | 214 | 278 | 0.00E+00 | 2.83E-02 | 2.83E-02 | 2.83E-02 | 2.83E-02 | 2.83E-02 | 2.83E-02 |
| Dose Commitment (mrem) = | | | | | | | | | | 0.00E+00 | 2.83E-02 | 2.83E-02 | 2.83E-02 | 2.83E-02 | 2.83E-02 | 2.83E-02 |

*Catawba Nuclear Station
Dose from Drinking Water Pathway for 2010 Data
Maximum Exposed Child*

Child Dose from Drinking Water Pathway (mrem) = Usage (l) x Dose Factor (mrem/pCi ingested) x Concentration (pCi/l)

Usage (intake in one year) = 510 l

| Radionuclide | <u>Ingestion Dose Factor</u> | | | | | | | <u>Highest Annual Net Mean Concentration</u> | | <u>Dose (mrem)</u> | | | | | | |
|--------------------------|------------------------------|----------|----------|----------|----------|----------|----------|--|---------------|--------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI | Indicator Location | Water (pCi/l) | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Mn-54 | NO DATA | 1.07E-05 | 2.85E-06 | NO DATA | 3.00E-06 | NO DATA | 8.98E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Co-58 | NO DATA | 1.80E-06 | 5.51E-06 | NO DATA | NO DATA | NO DATA | 1.05E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Fe-59 | 1.65E-05 | 2.67E-05 | 1.33E-05 | NO DATA | NO DATA | 7.74E-06 | 2.78E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| C0-60 | NO DATA | 5.29E-06 | 1.56E-05 | NO DATA | NO DATA | NO DATA | 2.93E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Zn-65 | 1.37E-05 | 3.65E-05 | 2.27E-05 | NO DATA | 2.30E-05 | NO DATA | 6.41E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Nb-95 | 2.25E-08 | 8.76E-09 | 6.26E-09 | NO DATA | 8.23E-09 | NO DATA | 1.62E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Zr-95 | 1.16E-07 | 2.55E-08 | 2.27E-08 | NO DATA | 3.65E-08 | NO DATA | 2.66E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| I-131 | 1.72E-05 | 1.73E-05 | 9.83E-06 | 5.72E-03 | 2.84E-05 | NO DATA | 1.54E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-134 | 2.34E-04 | 3.84E-04 | 8.10E-05 | NO DATA | 1.19E-04 | 4.27E-05 | 2.07E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-137 | 3.27E-04 | 3.13E-04 | 4.62E-05 | NO DATA | 1.02E-04 | 3.67E-05 | 1.96E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| BaLa-140 | 8.31E-05 | 7.28E-08 | 4.85E-06 | NO DATA | 2.37E-08 | 4.34E-08 | 4.21E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| H-3 | NO DATA | 2.03E-07 | 2.03E-07 | 2.03E-07 | 2.03E-07 | 2.03E-07 | 2.03E-07 | 214 | 278 | 0.00E+00 | 2.88E-02 | 2.88E-02 | 2.88E-02 | 2.88E-02 | 2.88E-02 | 2.88E-02 |
| Dose Commitment (mrem) = | | | | | | | | | | 0.00E+00 | 2.88E-02 | 2.88E-02 | 2.88E-02 | 2.88E-02 | 2.88E-02 | 2.88E-02 |

Catawba Nuclear Station
Dose from Broadleaf Vegetation Pathway for 2010 Data
Maximum Exposed Child

Child Dose from Vegetation Pathway (mrem) = Usage (kg) x Dose Factor (mrem/pCi ingested) x Concentration (pCi/kg)

Usage (intake in one year) = 26 kg

| Radionuclide | <u>Ingestion Dose Factor</u> | | | | | | | <u>Highest Annual Net Mean Concentration</u> | | <u>Dose (mrem)</u> | | | | | | |
|--------------------------|------------------------------|----------|----------|----------|----------|----------|----------|--|---------------|--------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI | Indicator Location | Food (pCi/kg) | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| I-131 | 1.72E-05 | 1.73E-05 | 9.83E-06 | 5.72E-03 | 2.84E-05 | NO DATA | 1.54E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-134 | 2.34E-04 | 3.84E-04 | 8.10E-05 | NO DATA | 1.19E-04 | 4.27E-05 | 2.07E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-137 | 3.27E-04 | 3.13E-04 | 4.62E-05 | NO DATA | 1.02E-04 | 3.67E-05 | 1.96E-06 | 201 | 37.7 | 3.21E-01 | 3.07E-01 | 4.53E-02 | 0.00E+00 | 1.00E-01 | 3.60E-02 | 1.92E-03 |
| Dose Commitment (mrem) = | | | | | | | | | | 3.21E-01 | 3.07E-01 | 4.53E-02 | 0.00E+00 | 1.00E-01 | 3.60E-02 | 1.92E-03 |

*Catawba Nuclear Station
Dose from Fish Pathway for 2010 Data
Maximum Exposed Child*

Child Dose from Fish Pathway (mrem) = Usage (kg) x Dose Factor (mrem/pCi ingested) x Concentration (pCi/kg)

H-3 Concentration in Fish = Surface Water pCi/l x Bioaccumulation Factor 0.9 pCi/kg per pCi/l = 6966 pCi/l x 0.9 = 6269 pCi/kg

Usage (intake in one year) = 6.9 kg

| Radionuclide | <u>Ingestion Dose Factor</u> | | | | | | | <u>Highest Annual Net Mean Concentration</u> | | <u>Dose (mrem)</u> | | | | | | |
|--------------------------|------------------------------|----------|----------|----------|----------|----------|----------|--|---------------|--------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI | Indicator Location | Fish (pCi/kg) | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Mn-54 | NO DATA | 1.07E-05 | 2.85E-06 | NO DATA | 3.00E-06 | NO DATA | 8.98E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Co-58 | NO DATA | 1.80E-06 | 5.51E-06 | NO DATA | NO DATA | NO DATA | 1.05E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Fe-59 | 1.65E-05 | 2.67E-05 | 1.33E-05 | NO DATA | NO DATA | 7.74E-06 | 2.78E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| C0-60 | NO DATA | 5.29E-06 | 1.56E-05 | NO DATA | NO DATA | NO DATA | 2.93E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Zn-65 | 1.37E-05 | 3.65E-05 | 2.27E-05 | NO DATA | 2.30E-05 | NO DATA | 6.41E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-134 | 2.34E-04 | 3.84E-04 | 8.10E-05 | NO DATA | 1.19E-04 | 4.27E-05 | 2.07E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-137 | 3.27E-04 | 3.13E-04 | 4.62E-05 | NO DATA | 1.02E-04 | 3.67E-05 | 1.96E-06 | ALL | 0.0 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| H-3 | NO DATA | 2.03E-07 | 2.03E-07 | 2.03E-07 | 2.03E-07 | 2.03E-07 | 2.03E-07 | 208 | 6269 | 0.00E+00 | 8.78E-03 | 8.78E-03 | 8.78E-03 | 8.78E-03 | 8.78E-03 | 8.78E-03 |
| Dose Commitment (mrem) = | | | | | | | | | | 0.00E+00 | 8.78E-03 | 8.78E-03 | 8.78E-03 | 8.78E-03 | 8.78E-03 | 8.78E-03 |

Catawba Nuclear Station
Dose from Shoreline Sediment Pathway for 2010 Data
Maximum Exposed Child

Shoreline Recreation = 14 hr (in one year)
 Shore Width Factor = 0.2
 Sediment Surface Mass = 40 kg/m²

Child Dose from Shoreline Sediment Pathway (mrem) = Shoreline Recreation (hr) x External Dose Factor (mrem/hr per pCi/m²) x Shore Width Factor x Sediment Surface Mass (kg/m²) x Sediment Concentration (pCi/kg)

| Radionuclide | External Dose Factor Standing on Contaminated Ground | | Indicator Location | Highest Annual Net Mean Concentration Sediment (pCi/kg) | Dose | |
|--------------------------|---|----------|-----------------------|--|----------|----------|
| | (mrem/hr per pCi/m ²) | | | | (mrem) | |
| | T. Body | Skin | | | T. Body | Skin |
| Mn-54 | 5.80E-09 | 6.80E-09 | ALL | 0.00 | 0.00E+00 | 0.00E+00 |
| Co-58 | 7.00E-09 | 8.20E-09 | 208-1S | 65.6 | 5.14E-05 | 6.02E-05 |
| Co-60 | 1.70E-08 | 2.00E-08 | 208-1S | 137 | 2.61E-04 | 3.07E-04 |
| Cs-134 | 1.20E-08 | 1.40E-08 | ALL | 0.00 | 0.00E+00 | 0.00E+00 |
| Cs-137 | 4.20E-09 | 4.90E-09 | 208-1S | 25.6 | 1.20E-05 | 1.40E-05 |
| Dose Commitment (mrem) = | | | | | 3.24E-04 | 3.81E-04 |

Catawba Nuclear Station
Dose from Drinking Water Pathway for 2010 Data
Maximum Exposed Teen

Teen Dose from Drinking Water Pathway (mrem) = Usage (l) x Dose Factor (mrem/pCi ingested) x Concentration (pCi/l)

Usage (intake in one year) = 510 l

| Radionuclide | <u>Ingestion Dose Factor</u> | | | | | | | <u>Highest Annual Net Mean Concentration</u> | | <u>Dose (mrem)</u> | | | | | | |
|-------------------------|------------------------------|----------|----------|----------|----------|----------|----------|--|---------------|--------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI | Indicator Location | Water (pCi/l) | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Mn-54 | NO DATA | 5.90E-06 | 1.17E-06 | NO DATA | 1.76E-06 | NO DATA | 1.21E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Co-58 | NO DATA | 9.72E-07 | 2.24E-06 | NO DATA | NO DATA | NO DATA | 1.34E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Fe-59 | 5.87E-06 | 1.37E-05 | 5.29E-06 | NO DATA | NO DATA | 4.32E-06 | 3.24E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Co-60 | NO DATA | 2.81E-06 | 6.33E-06 | NO DATA | NO DATA | NO DATA | 3.66E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Zn-65 | 5.76E-06 | 2.00E-05 | 9.33E-06 | NO DATA | 1.28E-05 | NO DATA | 8.47E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Nb-95 | 8.22E-09 | 4.56E-09 | 2.51E-09 | NO DATA | 4.42E-09 | NO DATA | 1.95E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Zr-95 | 4.12E-08 | 1.30E-08 | 8.94E-09 | NO DATA | 1.91E-08 | NO DATA | 3.00E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| I-131 | 5.85E-06 | 8.19E-06 | 4.40E-06 | 2.39E-03 | 1.41E-05 | NO DATA | 1.62E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-134 | 8.37E-05 | 1.97E-04 | 9.14E-05 | NO DATA | 6.26E-05 | 2.39E-05 | 2.45E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-137 | 1.12E-04 | 1.49E-04 | 5.19E-05 | NO DATA | 5.07E-05 | 1.97E-05 | 2.12E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| BaLa-140 | 2.84E-05 | 3.48E-08 | 1.83E-06 | NO DATA | 1.18E-08 | 2.34E-08 | 4.38E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| H-3 | NO DATA | 1.06E-07 | 1.06E-07 | 1.06E-07 | 1.06E-07 | 1.06E-07 | 1.06E-07 | 214 | 278 | 0.00E+00 | 1.50E-02 | 1.50E-02 | 1.50E-02 | 1.50E-02 | 1.50E-02 | 1.50E-02 |
| Dose Commitment (mrem)= | | | | | | | | | | 0.00E+00 | 1.50E-02 | 1.50E-02 | 1.50E-02 | 1.50E-02 | 1.50E-02 | 1.50E-02 |

Catawba Nuclear Station
Dose from Broadleaf Vegetation Pathway for 2010 Data
Maximum Exposed Teen

Teen Dose from Vegetation Pathway (mrem) = Usage (kg) x Dose Factor (mrem/pCi ingested) x Concentration (pCi/kg)

Usage (intake in one year) = 42 kg

| Radionuclide | <u>Ingestion Dose Factor</u> | | | | | | | <u>Highest Annual Net Mean Concentration</u> | | <u>Dose (mrem)</u> | | | | | | |
|--------------------------|------------------------------|----------|----------|----------|----------|----------|----------|--|---------------|--------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI | Indicator Location | Food (pCi/kg) | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| I-131 | 5.85E-06 | 8.19E-06 | 4.40E-06 | 2.39E-03 | 1.41E-05 | NO DATA | 1.62E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-134 | 8.37E-05 | 1.97E-04 | 9.14E-05 | NO DATA | 6.26E-05 | 2.39E-05 | 2.45E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-137 | 1.12E-04 | 1.49E-04 | 5.19E-05 | NO DATA | 5.07E-05 | 1.97E-05 | 2.12E-06 | 201 | 37.7 | 1.77E-01 | 2.36E-01 | 8.22E-02 | 0.00E+00 | 8.03E-02 | 3.12E-02 | 3.36E-03 |
| Dose Commitment (mrem) = | | | | | | | | | | 1.77E-01 | 2.36E-01 | 8.22E-02 | 0.00E+00 | 8.03E-02 | 3.12E-02 | 3.36E-03 |

*Catawba Nuclear Station
Dose from Fish Pathway for 2010 Data
Maximum Exposed Teen*

Teen Dose from Fish Pathway (mrem) = Usage (kg) x Dose Factor (mrem/pCi ingested) x Concentration (pCi/kg)

H-3 Concentration in Fish = Surface Water pCi/l x Bioaccumulation Factor 0.9 pCi/kg per pCi/l = 6966 pCi/l x 0.9 = 6269 pCi/kg

Usage (intake in one year) = 16 kg

| Radionuclide | <u>Ingestion Dose Factor</u> | | | | | | | <u>Highest Annual Net Mean Concentration</u> | | <u>Dose (mrem)</u> | | | | | | |
|--------------------------|------------------------------|----------|----------|----------|----------|----------|----------|--|----------|--------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI | Location | (pCi/kg) | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Mn-54 | NO DATA | 5.90E-06 | 1.17E-06 | NO DATA | 1.76E-06 | NO DATA | 1.21E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Co-58 | NO DATA | 9.72E-07 | 2.24E-06 | NO DATA | NO DATA | NO DATA | 1.34E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Fe-59 | 5.87E-06 | 1.37E-05 | 5.29E-06 | NO DATA | NO DATA | 4.32E-06 | 3.24E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Co-60 | NO DATA | 2.81E-06 | 6.33E-06 | NO DATA | NO DATA | NO DATA | 3.66E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Zn-65 | 5.76E-06 | 2.00E-05 | 9.33E-06 | NO DATA | 1.28E-05 | NO DATA | 8.47E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-134 | 8.37E-05 | 1.97E-04 | 9.14E-05 | NO DATA | 6.26E-05 | 2.39E-05 | 2.45E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-137 | 1.12E-04 | 1.49E-04 | 5.19E-05 | NO DATA | 5.07E-05 | 1.97E-05 | 2.12E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| H-3 | NO DATA | 1.06E-07 | 1.06E-07 | 1.06E-07 | 1.06E-07 | 1.06E-07 | 1.06E-07 | 208 | 6269 | 0.00E+00 | 1.06E-02 | 1.06E-02 | 1.06E-02 | 1.06E-02 | 1.06E-02 | 1.06E-02 |
| Dose Commitment (mrem) = | | | | | | | | | | 0.00E+00 | 1.06E-02 | 1.06E-02 | 1.06E-02 | 1.06E-02 | 1.06E-02 | 1.06E-02 |

Catawba Nuclear Station
Dose from Shoreline Sediment Pathway for 2010 Data
Maximum Exposed Teen

Shoreline Recreation = 67 hr (in one year)
 Shore Width Factor = 0.2
 Sediment Surface Mass = 40 kg/m²

Teen Dose from Shoreline Sediment Pathway (mrem) = Shoreline Recreation (hr) x External Dose Factor (mrem/hr per pCi/m²) x Shore Width Factor x Sediment Surface Mass (kg/m²) x Sediment Concentration (pCi/kg)

| Radionuclide | External Dose Factor Standing on Contaminated Ground | | Indicator Location | Highest Annual Net Mean Concentration Sediment (pCi/kg) | Dose | |
|--------------------------|---|----------|-----------------------|--|----------|----------|
| | (mrem/hr per pCi/m ²) | | | | (mrem) | |
| | T. Body | Skin | | | T. Body | Skin |
| Mn-54 | 5.80E-09 | 6.80E-09 | ALL | 0.00 | 0.00E+00 | 0.00E+00 |
| Co-58 | 7.00E-09 | 8.20E-09 | 208-1S | 65.6 | 2.46E-04 | 2.88E-04 |
| Co-60 | 1.70E-08 | 2.00E-08 | 208-1S | 137 | 1.25E-03 | 1.47E-03 |
| Cs-134 | 1.20E-08 | 1.40E-08 | ALL | 0.00 | 0.00E+00 | 0.00E+00 |
| Cs-137 | 4.20E-09 | 4.90E-09 | 208-1S | 25.6 | 5.76E-05 | 6.72E-05 |
| Dose Commitment (mrem) = | | | | | 1.55E-03 | 1.82E-03 |

Catawba Nuclear Station
Dose from Drinking Water Pathway for 2010 Data
Maximum Exposed Adult

Adult Dose from Drinking Water Pathway (mrem) = Usage (l) x Dose Factor (mrem/pCi ingested) x Concentration (pCi/l)

Usage (intake in one year) = 730 l

| Radionuclide | <u>Ingestion Dose Factor</u> | | | | | | | <u>Highest Annual Net Mean Concentration</u> | | <u>Dose (mrem)</u> | | | | | | |
|--------------------------|------------------------------|----------|----------|----------|----------|----------|----------|--|---------------|--------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI | Indicator Location | Water (pCi/l) | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Mn-54 | NO DATA | 4.57E-06 | 8.72E-07 | NO DATA | 1.36E-06 | NO DATA | 1.40E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Co-58 | NO DATA | 7.45E-07 | 1.67E-06 | NO DATA | NO DATA | NO DATA | 1.51E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Fe-59 | 4.34E-06 | 1.02E-05 | 3.91E-06 | NO DATA | NO DATA | 2.85E-06 | 3.40E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Co-60 | NO DATA | 2.14E-06 | 4.72E-06 | NO DATA | NO DATA | NO DATA | 4.02E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Zn-65 | 4.84E-06 | 1.54E-05 | 6.96E-06 | NO DATA | 1.03E-05 | NO DATA | 9.70E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Nb-95 | 6.22E-09 | 3.46E-09 | 1.86E-09 | NO DATA | 3.42E-09 | NO DATA | 2.10E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Zr-95 | 3.04E-08 | 9.75E-09 | 6.60E-09 | NO DATA | 1.53E-08 | NO DATA | 3.09E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| I-131 | 4.16E-06 | 5.95E-06 | 3.41E-06 | 1.95E-03 | 1.02E-05 | NO DATA | 1.57E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-134 | 6.22E-05 | 1.48E-04 | 1.21E-04 | NO DATA | 4.79E-05 | 1.59E-05 | 2.59E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-137 | 7.97E-05 | 1.09E-04 | 7.14E-05 | NO DATA | 3.70E-05 | 1.23E-05 | 2.11E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| BaLa-140 | 2.03E-05 | 2.55E-08 | 1.33E-06 | NO DATA | 8.67E-09 | 1.46E-08 | 4.18E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| H-3 | NO DATA | 1.05E-07 | 1.05E-07 | 1.05E-07 | 1.05E-07 | 1.05E-07 | 1.05E-07 | 214 | 278 | 0.00E+00 | 2.13E-02 | 2.13E-02 | 2.13E-02 | 2.13E-02 | 2.13E-02 | 2.13E-02 |
| Dose Commitment (mrem) = | | | | | | | | | | 0.00E+00 | 2.13E-02 | 2.13E-02 | 2.13E-02 | 2.13E-02 | 2.13E-02 | 2.13E-02 |

Catawba Nuclear Station
Dose from Broadleaf Vegetation Pathway for 2010 Data
Maximum Exposed Adult

Adult Dose from Vegetation (mrem) = Usage (kg) x Dose Factor (mrem/pCi ingested) x Concentration (pCi/kg)

Usage (intake in one year) = 64 kg

| Radionuclide | <u>Ingestion Dose Factor</u> | | | | | | | <u>Highest Annual Net Mean Concentration</u> | | <u>Dose (mrem)</u> | | | | | | |
|--------------------------|------------------------------|----------|----------|----------|----------|----------|----------|--|---------------|--------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI | Indicator Location | Food (pCi/kg) | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| | I-131 | 4.16E-06 | 5.95E-06 | 3.41E-06 | 1.95E-03 | 1.02E-05 | NO DATA | 1.57E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-134 | 6.22E-05 | 1.48E-04 | 1.21E-04 | NO DATA | 4.79E-05 | 1.59E-05 | 2.59E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-137 | 7.97E-05 | 1.09E-04 | 7.14E-05 | NO DATA | 3.70E-05 | 1.23E-05 | 2.11E-06 | 201 | 37.7 | 1.92E-01 | 2.63E-01 | 1.72E-01 | 0.00E+00 | 8.93E-02 | 2.97E-02 | 5.09E-03 |
| Dose Commitment (mrem) = | | | | | | | | | | 1.92E-01 | 2.63E-01 | 1.72E-01 | 0.00E+00 | 8.93E-02 | 2.97E-02 | 5.09E-03 |

Catawba Nuclear Station
Dose from Fish Pathway for 2010 Data
Maximum Exposed Adult

Adult Dose from Fish Pathway (mrem) = Usage (kg) x Dose Factor (mrem/pCi ingested) x Concentration (pCi/kg)

H-3 Concentration in Fish = Surface Water pCi/l x Bioaccumulation Factor 0.9 pCi/kg per pCi/l = 6966 pCi/l x 0.9 = 6269 pCi/kg

Usage (intake in one year) = 21 kg

| Radionuclide | <u>Ingestion Dose Factor</u> | | | | | | | <u>Highest Annual Net Mean Concentration</u> | | <u>Dose (mrem)</u> | | | | | | |
|--------------------------|------------------------------|----------|----------|----------|----------|----------|----------|--|----------|--------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI | Location | (pCi/kg) | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Mn-54 | NO DATA | 4.57E-06 | 8.72E-07 | NO DATA | 1.36E-06 | NO DATA | 1.40E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Co-58 | NO DATA | 7.45E-07 | 1.67E-06 | NO DATA | NO DATA | NO DATA | 1.51E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Fe-59 | 4.34E-06 | 1.02E-05 | 3.91E-06 | NO DATA | NO DATA | 2.85E-06 | 3.40E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Co-60 | NO DATA | 2.14E-06 | 4.72E-06 | NO DATA | NO DATA | NO DATA | 4.02E-05 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Zn-65 | 4.84E-06 | 1.54E-05 | 6.96E-06 | NO DATA | 1.03E-05 | NO DATA | 9.70E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-134 | 6.22E-05 | 1.48E-04 | 1.21E-04 | NO DATA | 4.79E-05 | 1.59E-05 | 2.59E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| Cs-137 | 7.97E-05 | 1.09E-04 | 7.14E-05 | NO DATA | 3.70E-05 | 1.23E-05 | 2.11E-06 | ALL | 0.00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 | 0.00E+00 |
| H-3 | NO DATA | 1.05E-07 | 1.05E-07 | 1.05E-07 | 1.05E-07 | 1.05E-07 | 1.05E-07 | 208 | 6269 | 0.00E+00 | 1.38E-02 | 1.38E-02 | 1.38E-02 | 1.38E-02 | 1.38E-02 | 1.38E-02 |
| Dose Commitment (mrem) = | | | | | | | | | | 0.00E+00 | 1.38E-02 | 1.38E-02 | 1.38E-02 | 1.38E-02 | 1.38E-02 | 1.38E-02 |

Catawba Nuclear Station
Dose from Shoreline Sediment Pathway for 2010 Data
Maximum Exposed Adult

Shoreline Recreation = 12 hr (in one year)
 Shore Width Factor = 0.2
 Sediment Surface Mass = 40 kg/m²

Adult Dose from Shoreline Sediment Pathway (mrem) = Shoreline Recreation (hr) x External Dose Factor (mrem/hr per pCi/m²) x Shore Width Factor x Sediment Surface Mass (kg/m²) x Sediment Concentration (pCi/kg)

| Radionuclide | External Dose Factor Standing on Contaminated Ground (mrem/hr per pCi/m ²) | | Highest Annual Net Mean Concentration | | Dose (mrem) | |
|--------------------------|--|----------|--|----------------------|----------------|----------|
| | T. Body | Skin | Indicator Location | Sediment (pCi/kg) | T. Body | Skin |
| Mn-54 | 5.80E-09 | 6.80E-09 | ALL | 0.00 | 0.00E+00 | 0.00E+00 |
| Co-58 | 7.00E-09 | 8.20E-09 | 208-1S | 65.6 | 4.41E-05 | 5.16E-05 |
| Co-60 | 1.70E-08 | 2.00E-08 | 208-1S | 137 | 2.24E-04 | 2.63E-04 |
| Cs-134 | 1.20E-08 | 1.40E-08 | ALL | 0.00 | 0.00E+00 | 0.00E+00 |
| Cs-137 | 4.20E-09 | 4.90E-09 | 208-1S | 25.6 | 1.03E-05 | 1.20E-05 |
| Dose Commitment (mrem) = | | | | | 2.78E-04 | 3.27E-04 |


5.0 QUALITY ASSURANCE

5.1 SAMPLE COLLECTION

EnRad Laboratories, Fisheries, and Aquatic Ecology performed the environmental sample collections as specified by approved sample collection procedures.

5.2 SAMPLE ANALYSIS

EnRad Laboratories performed the environmental sample analyses as specified by approved analysis procedures. EnRad Laboratories is located in Huntersville, North Carolina, at Duke Energy Corporation's Environmental Center.

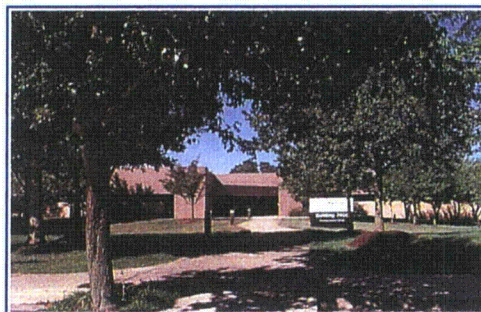

Duke Energy Corporation's
Environmental Center

5.3 DOSIMETRY ANALYSIS

The Radiation Dosimetry and Records group performed environmental dosimetry measurements as specified by approved dosimetry analysis procedures.

5.4 LABORATORY EQUIPMENT QUALITY ASSURANCE

5.4.1 DAILY QUALITY CONTROL

EnRad Laboratories has an internal quality assurance program which monitors each type of instrumentation for reliability and accuracy. Daily quality control checks ensure that instruments are in proper working order and these checks are used to monitor instrument performance.

5.4.2 CALIBRATION VERIFICATION

National Institute of Standards and Technology (NIST) standards that represent counting geometries are analyzed as unknowns at various frequencies ranging from weekly to annually to verify that efficiency calibrations are valid. The frequency is dependent upon instrument use and performance. Investigations are performed and documented should calibration verification data fall out of limits.

5.4.3 BATCH PROCESSING

Method quality control samples are analyzed with sample analyses that are processed in batches. These include gross beta in drinking water and tritium analyses.

5.5 DUKE ENERGY INTERCOMPARISON PROGRAM

EnRad Laboratories participated in the Duke Energy Nuclear Generation Department Intercomparison Program during 2010. Interlaboratory cross-check standards, including, Marinelli beakers, air filters, air cartridges, gross beta on smears, and tritium in water samples were analyzed at various times of the year. A summary of the EnRad Laboratory program results for 2010 is documented in Table 5.0-A.

5.6 ERA PROFICIENCY TESTING

EnRad Laboratories performed method proficiency testing through a program administered by Environmental Resource Associates (ERA) of Arvada, CO. ERA supplied requested method proficiency samples for analysis and nuclide concentration determination. ERA reported proficiency test results to the North Carolina Department of Health and Human Services, North Carolina Public Health Drinking Water Laboratory Certification Program. A summary of these proficiency test data for 2010 is documented in Table 5.0-B.

5.7 DUKE ENERGY AUDITS

The Catawba Nuclear Station Radiological Environmental Monitoring Program was audited by the Quality Assurance Group in 2010. Procedure and sampling equipment enhancements were identified as part of this audit (reference 6.16).

During the McGuire 2010 Quality Assurance audit an item was identified concerning the calibration media used for fish and vegetation. Special tests were performed to confirm that the existing calibration media are acceptable. Additional information is included in Table 5.0-A and reference 6.17.

5.8 U.S. NUCLEAR REGULATORY COMMISSION INSPECTIONS

The Catawba Nuclear Station Radiological Environmental Monitoring Program was not audited by the NRC in 2010. The program was audited by the NRC in 2009 (reference 6.12). No findings were noted in the 2009 report.

5.9 STATE OF SOUTH CAROLINA INTERCOMPARISON PROGRAM

Catawba Nuclear Station routinely participates with the Bureau of Radiological Health of the State's Department of Health and Environmental Control (DHEC) in an intercomparison program. The Memorandum of Agreement (MOA) between SC DHEC and Duke Energy describes the sampling frequency and analysis parameters for drinking water, surface water, milk, fish, vegetation, and shoreline sediment samples collected by EnRad Laboratories. Samples are routinely split with DHEC for intercomparison analysis. DHEC collects air samples near two of the locations sampled for air by CNS. Results of the analyses performed on split and duplicate samples are sent to DHEC.

5.10 TLD INTERCOMPARISON PROGRAM

5.10.1 NUCLEAR TECHNOLOGY SERVICES INTERCOMPARISON PROGRAM

Radiation Dosimetry and Records participates in a quarterly TLD intercomparison program administered by Nuclear Technology Services, Inc. of Roswell, GA. Nuclear Technology Services irradiates environmental dosimeters quarterly and sends them to the Radiation Dosimetry and Records group for analysis of the unknown estimated delivered exposure. A summary of the Nuclear Technology Services Intercomparison Report is documented in Table 5.0-C.

5.10.2 INTERNAL CROSSCHECK (DUKE ENERGY)

Radiation Dosimetry and Records participates in a quarterly TLD intracomparison program administered internally by the Dosimetry Lab. The Dosimetry Lab Staff irradiates environmental dosimeters quarterly and submits them for analysis of the unknown estimated delivered exposure. A summary of the Internal Cross Check (Duke Energy) Result is documented in Table 5.0-C.

TABLE 5.0-A

DUKE ENERGY INTERLABORATORY COMPARISON PROGRAM

2010 CROSS-CHECK RESULTS FOR ENRAD LABORATORIES

Cross-Check samples are normally analyzed a minimum of three times. A status of "3 Pass" indicates that all three analyses yielded results within the designated acceptance range. A status of "1 Pass" indicates that one analysis of the cross check was performed

If applicable, footnote explanations are included following this table.

Gamma in Water 3.5 liters

| Reference Date | Sample I.D. | Nuclide | Acceptance Range pCi/l | Reference Value pCi/l | Mean Reported Value pCi/l | Cross Check Status |
|----------------|-------------|---------|------------------------|-----------------------|---------------------------|--------------------|
| 2/22/2010 | Q101GWR | Co-57 | 0.86 - 1.52 E4 | 1.14 E4 | 1.16 E4 | 3 Pass |
| | | Co-60 | 2.72 - 4.82 E3 | 3.62 E3 | 3.66 E3 | 3 Pass |
| | | Ba-133 | 5.31 - 9.43 E3 | 7.09 E3 | 5.70 E3 | 3 Pass |
| | | Cs-137 | 4.67 - 8.27 E3 | 6.22 E3 | 6.15 E3 | 3 Pass |
| 6/2/2010 | Q102GWSL | Cr-51 | 1.15 - 2.05 E5 | 1.54 E5 | 1.85 E5 | 3 Pass |
| | | Mn-54 | 4.91 - 8.70 E4 | 6.54 E4 | 6.65 E4 | 3 Pass |
| | | Co-58 | 3.10 - 5.49 E4 | 4.13 E4 | 4.37 E4 | 3 Pass |
| | | Fe-59 | 3.79 - 6.72 E4 | 5.05 E4 | 5.87 E4 | 3 Pass |
| | | Co-60 | 5.63 - 9.99 E4 | 7.51 E4 | 7.39 E4 | 3 Pass |
| | | Zn-65 | 6.00 - 10.63 E4 | 7.99 E4 | 8.28 E4 | 3 Pass |
| | | Cs-134 | 3.62 - 6.42 E4 | 4.82 E4 | 4.33 E4 | 3 Pass |
| | | Cs-137 | 4.29 - 7.61 E4 | 5.72 E4 | 5.38 E4 | 3 Pass |
| 9/9/2010 | Q103GWSL | Cr-51 | 1.00 - 1.77 E5 | 1.33 E5 | 1.35 E5 | 3 Pass |
| | | Mn-54 | 4.34 - 7.69 E4 | 5.79 E4 | 6.05 E4 | 3 Pass |
| | | Co-58 | 2.82 - 5.00 E4 | 3.76 E4 | 3.82 E4 | 3 Pass |
| | | Fe-59 | 3.64 - 6.46 E4 | 4.86 E4 | 5.21 E4 | 3 Pass |
| | | Co-60 | 6.13 - 10.86 E4 | 8.17 E4 | 8.38 E4 | 3 Pass |
| | | Zn-65 | 7.44 - 13.19 E4 | 9.92 E4 | 10.43 E4 | 3 Pass |
| | | Cs-134 | 3.35 - 5.94 E4 | 4.47 E4 | 4.13 E4 | 3 Pass |
| | | Cs-137 | 3.38 - 6.00 E4 | 4.51 E4 | 4.45 E4 | 3 Pass |
| | | Ce-141 | 5.41 - 9.59 E4 | 7.21 E4 | 7.37 E4 | 3 Pass |

Gamma in Water 1.0 liter

| Reference Date | Sample I.D. | Nuclide | Acceptance Range pCi/l | Reference Value pCi/l | Mean Reported Value pCi/l | Cross Check Status |
|----------------|-------------|---------|------------------------|-----------------------|---------------------------|--------------------|
| 2/22/2010 | Q101GWR | Co-57 | 0.86 - 1.52 E4 | 1.14 E4 | 1.12 E4 | 3 Pass |
| | | Co-60 | 2.72 - 4.82 E3 | 3.62 E3 | 3.73 E3 | 3 Pass |
| | | Ba-133 | 5.31 - 9.43 E3 | 7.09 E3 | 5.56 E3 | 3 Pass |
| | | Cs-137 | 4.67 - 8.27 E3 | 6.22 E3 | 6.06 E3 | 3 Pass |

Gamma in Water 1.0 liter, continued

| Reference Date | Sample I.D. | Nuclide | Acceptance Range pCi/l | Reference Value pCi/l | Mean Reported Value pCi/l | Cross Check Status |
|----------------|-------------|---------|------------------------|-----------------------|---------------------------|--------------------|
| 6/2/2010 | Q102GWSL | Cr-51 | 1.15 - 2.05 E5 | 1.54 E5 | 1.85 E5 | 2 Pass |
| | | Mn-54 | 4.91 - 8.70 E4 | 6.54 E4 | 6.70 E4 | 2 Pass |
| | | Co-58 | 3.10 - 5.49 E4 | 4.13 E4 | 4.38 E4 | 2 Pass |
| | | Fe-59 | 3.79 - 6.72 E4 | 5.05 E4 | 5.91 E4 | 2 Pass |
| | | Co-60 | 5.63 - 9.99 E4 | 7.51 E4 | 7.44 E4 | 2 Pass |
| | | Zn-65 | 6.00 - 10.63 E4 | 7.99 E4 | 8.35 E4 | 2 Pass |
| | | Cs-134 | 3.62 - 6.42 E4 | 4.82 E4 | 4.25 E4 | 2 Pass |
| | | Cs-137 | 4.29 - 7.61 E4 | 5.72 E4 | 5.39 E4 | 2 Pass |
| | | Ce-141 | 3.66 - 6.49 E4 | 4.88 E4 | 5.69 E4 | 2 Pass |
| 9/9/2010 | Q103GWSL | Cr-51 | 1.00 - 1.77 E5 | 1.33 E5 | 1.33 E5 | 3 Pass |
| | | Mn-54 | 4.34 - 7.69 E4 | 5.79 E4 | 5.98 E4 | 3 Pass |
| | | Co-58 | 2.82 - 5.00 E4 | 3.76 E4 | 3.76 E4 | 3 Pass |
| | | Fe-59 | 3.64 - 6.46 E4 | 4.86 E4 | 5.16 E4 | 3 Pass |
| | | Co-60 | 6.13 - 10.86 E4 | 8.17 E4 | 8.32 E4 | 3 Pass |
| | | Zn-65 | 7.44 - 13.19 E4 | 9.92 E4 | 10.43 E4 | 3 Pass |
| | | Cs-134 | 3.35 - 5.94 E4 | 4.47 E4 | 3.98 E4 | 3 Pass |
| | | Cs-137 | 3.38 - 6.00 E4 | 4.51 E4 | 4.43 E4 | 3 Pass |
| | | Ce-141 | 5.41 - 9.59 E4 | 7.21 E4 | 7.24 E4 | 3 Pass |

Gamma in Water 0.5 liter

| Reference Date | Sample I.D. | Nuclide | Acceptance Range pCi/l | Reference Value pCi/l | Mean Reported Value pCi/l | Cross Check Status |
|----------------|-------------|---------|------------------------|-----------------------|---------------------------|--------------------|
| 2/22/2010 | Q101GWR | Co-57 | 0.86 - 1.52 E4 | 1.14 E4 | 1.12 E4 | 3 Pass |
| | | Co-60 | 2.72 - 4.82 E3 | 3.62 E3 | 3.73 E3 | 3 Pass |
| | | Ba-133 | 5.31 - 9.43 E3 | 7.09 E3 | 5.53 E3 | 3 Pass |
| | | Cs-137 | 4.67 - 8.27 E3 | 6.22 E3 | 6.04 E3 | 3 Pass |
| 6/2/2010 | Q102GWSL | Cr-51 | 1.15 - 2.05 E5 | 1.54 E5 | 1.81 E5 | 3 Pass |
| | | Mn-54 | 4.91 - 8.70 E4 | 6.54 E4 | 6.45 E4 | 3 Pass |
| | | Co-58 | 3.10 - 5.49 E4 | 4.13 E4 | 4.22 E4 | 3 Pass |
| | | Fe-59 | 3.79 - 6.72 E4 | 5.05 E4 | 5.73 E4 | 3 Pass |
| | | Co-60 | 5.63 - 9.99 E4 | 7.51 E4 | 7.24 E4 | 3 Pass |
| | | Zn-65 | 6.00 - 10.63 E4 | 7.99 E4 | 8.10 E4 | 3 Pass |
| | | Cs-134 | 3.62 - 6.42 E4 | 4.82 E4 | 4.10 E4 | 3 Pass |
| | | Cs-137 | 4.29 - 7.61 E4 | 5.72 E4 | 5.17 E4 | 3 Pass |
| | | Ce-141 | 3.66 - 6.49 E4 | 4.88 E4 | 5.46 E4 | 3 Pass |
| 9/9/2010 | Q103GWSL | Cr-51 | 1.00 - 1.77 E5 | 1.33 E5 | 1.26 E5 | 3 Pass |
| | | Mn-54 | 4.34 - 7.69 E4 | 5.79 E4 | 5.55 E4 | 3 Pass |
| | | Co-58 | 2.82 - 5.00 E4 | 3.76 E4 | 3.47 E4 | 3 Pass |
| | | Fe-59 | 3.64 - 6.46 E4 | 4.86 E4 | 4.85 E4 | 3 Pass |
| | | Co-60 | 6.13 - 10.86 E4 | 8.17 E4 | 7.80 E4 | 3 Pass |
| | | Zn-65 | 7.44 - 13.19 E4 | 9.92 E4 | 9.76 E4 | 3 Pass |
| | | Cs-134 | 3.35 - 5.94 E4 | 4.47 E4 | 3.69 E4 | 3 Pass |
| | | Cs-137 | 3.38 - 6.00 E4 | 4.51 E4 | 4.11 E4 | 3 Pass |
| | | Ce-141 | 5.41 - 9.59 E4 | 7.21 E4 | 6.68 E4 | 3 Pass |

Gamma in Water 0.25 liter

| Reference Date | Sample I.D. | Nuclide | Acceptance Range pCi/l | Reference Value pCi/l | Mean Reported Value pCi/l | Cross Check Status |
|----------------|-------------|---------|------------------------|-----------------------|---------------------------|--------------------|
| 2/22/2010 | Q101GWR | Co-57 | 0.86 - 1.52 E4 | 1.14 E4 | 1.09 E4 | 3 Pass |
| | | Co-60 | 2.72 - 4.82 E3 | 3.62 E3 | 3.71 E3 | 3 Pass |
| | | Ba-133 | 5.31 - 9.43 E3 | 7.09 E3 | 5.56 E3 | 3 Pass |
| | | Cs-137 | 4.67 - 8.27 E3 | 6.22 E3 | 5.88 E3 | 3 Pass |
| 6/2/2010 | Q102GWSL | Cr-51 | 1.15 - 2.05 E5 | 1.54 E5 | 1.77 E5 | 3 Pass |
| | | Mn-54 | 4.91 - 8.70 E4 | 6.54 E4 | 6.39 E4 | 3 Pass |
| | | Co-58 | 3.10 - 5.49 E4 | 4.13 E4 | 4.20 E4 | 3 Pass |
| | | Fe-59 | 3.79 - 6.72 E4 | 5.05 E4 | 5.68 E4 | 3 Pass |
| | | Co-60 | 5.63 - 9.99 E4 | 7.51 E4 | 7.21 E4 | 3 Pass |
| | | Zn-65 | 6.00 - 10.63 E4 | 7.99 E4 | 8.09 E4 | 3 Pass |
| | | Cs-134 | 3.62 - 6.42 E4 | 4.82 E4 | 4.09 E4 | 3 Pass |
| | | Cs-137 | 4.29 - 7.61 E4 | 5.72 E4 | 5.19 E4 | 3 Pass |
| 9/9/2010 | Q103GWSL | Cr-51 | 1.00 - 1.77 E5 | 1.33 E5 | 1.35 E5 | 3 Pass |
| | | Mn-54 | 4.34 - 7.69 E4 | 5.79 E4 | 5.90 E4 | 3 Pass |
| | | Co-58 | 2.82 - 5.00 E4 | 3.76 E4 | 3.67 E4 | 3 Pass |
| | | Fe-59 | 3.64 - 6.46 E4 | 4.86 E4 | 5.18 E4 | 3 Pass |
| | | Co-60 | 6.13 - 10.86 E4 | 8.17 E4 | 8.25 E4 | 3 Pass |
| | | Zn-65 | 7.44 - 13.19 E4 | 9.92 E4 | 10.33 E4 | 3 Pass |
| | | Cs-134 | 3.35 - 5.94 E4 | 4.47 E4 | 3.92 E4 | 3 Pass |
| | | Cs-137 | 3.38 - 6.00 E4 | 4.51 E4 | 4.33 E4 | 3 Pass |
| | | Ce-141 | 5.41 - 9.59 E4 | 7.21 E4 | 7.09 E4 | 3 Pass |

Gamma on Filter

| Reference Date | Sample I.D. | Nuclide | Acceptance Range pCi | Reference Value pCi | Mean Reported Value pCi | Cross Check Status |
|----------------|-------------|---------|----------------------|---------------------|-------------------------|--------------------|
| 6/17/2010 | E7153-37 | Cr-51 | 2.46 - 4.36 E2 | 3.28 E2 | 3.76 E2 | 2 Pass |
| | | Mn-54 | 1.23 - 2.18 E2 | 1.64 E2 | 1.65 E2 | 2 Pass |
| | | Co-58 | 7.34 - 13.02 E1 | 9.79 E1 | 9.93 E1 | 2 Pass |
| | | Fe-59 | 0.86 - 1.53 E2 | 1.15 E2 | 1.05 E2 | 2 Pass |
| | | Co-60 | 1.43 - 2.53 E2 | 1.90 E2 | 1.86 E2 | 2 Pass |
| | | Zn-65 | 1.49 - 2.65 E2 | 1.99 E2 | 1.92 E2 | 2 Pass |
| | | Cs-134 | 0.92 - 1.62 E2 | 1.22 E2 | 1.13 E2 | 2 Pass |
| | | Cs-137 | 1.09 - 1.93 E2 | 1.45 E2 | 1.40 E2 | 2 Pass |
| | | Ce-141 | 0.80 - 1.42 E2 | 1.07 E2 | 1.01 E2 | 2 Pass |

Gamma in Soil (Special Testing)*

| Reference Date | Sample I.D. | Nuclide | Acceptance Range pCi/kg | Reference Value pCi/kg | Mean Reported Value pCi/kg | Cross Check Status |
|----------------|-------------|---------|-------------------------|------------------------|----------------------------|------------------------|
| 12/9/2010 | E7380-37 | Cr-51 | 2.60 - 9.98 E2 | 5.09 E2 | 5.85 E2 | 4 Pass |
| | | Mn-54 | 1.01 - 1.78 E2 | 1.34 E2 | 1.42 E2 | 4 Pass |
| | | Co-58 | 0.76 - 1.34 E2 | 1.01 E2 | 0.96 E2 | 1/4 Low ⁽¹⁾ |
| | | Fe-59 | 0.95 - 2.25 E2 | 1.46 E2 | 1.42 E2 | 4 Pass |
| | | Co-60 | 2.52 - 4.47 E2 | 3.36 E2 | 3.27 E2 | 4 Pass |
| | | Zn-65 | 1.46 - 2.58 E2 | 1.94 E2 | 1.97 E2 | 4 Pass |
| | | Cs-134 | 1.31 - 2.33 E2 | 1.75 E2 | 1.54 E2 | 4 Pass |
| | | Cs-137 | 2.24 - 3.96 E2 | 2.98 E2 | 2.89 E2 | 4 Pass |

* INOS Audit 10-15(INOS)(REC)(MNS) 2010, PIP M-10-06597

Gamma in Vegetation (Special Testing)*

| Reference Date | Sample I.D. | Nuclide | Acceptance Range pCi/kg | Reference Value pCi/kg | Mean Reported Value pCi/kg | Cross Check Status |
|----------------|-------------|---------|----------------------------|---------------------------|-------------------------------|--------------------|
| 12/9/2010 | E7381-37 | Cr-51 | 2.36 - 11.11 E2 | 5.12 E2 | 5.10 E2 | 1 Pass |
| | | Mn-54 | 1.01 - 1.78 E2 | 1.34 E2 | 1.51 E2 | 1 Pass |
| | | Co-58 | 0.76 - 1.34 E2 | 1.01 E2 | 1.00 E2 | 1 Pass |
| | | Fe-59 | 0.84 - 2.57 E2 | 1.47 E2 | 1.54 E2 | 1 Pass |
| | | Co-60 | 2.54 - 4.50 E2 | 3.38 E2 | 3.38 E2 | 1 Pass |
| | | Zn-65 | 1.46 - 2.59 E2 | 1.95 E2 | 2.24 E2 | 1 Pass |
| | | Cs-134 | 1.32 - 2.34 E2 | 1.76 E2 | 1.51 E2 | 1 Pass |
| | | Cs-137 | 1.57 - 2.78 E2 | 2.09 E2 | 2.03 E2 | 1 Pass |

* INOS Audit 10-15(INOS)(REC)(MNS) 2010, PIP M-10-06597

Iodine in Milk

| Reference Date | Sample I.D. | Nuclide | Acceptance Range pCi/l | Reference Value pCi/l | Mean Reported Value pCi/l | Cross Check Status |
|----------------|-------------|---------|---------------------------|--------------------------|------------------------------|--------------------|
| 3/2/2010 | Q101LIM1 | I-131 | 2.29 - 4.06 E1 | 3.06 E1 | 2.38 E1 | 1 Pass |
| 3/2/2010 | Q101LIM2 | I-131 | 1.25 - 2.21 E3 | 1.66 E3 | 1.39 E3 | 3 Pass |
| 3/2/2010 | Q101LIM3 | I-131 | 6.27 - 11.13 E3 | 8.37 E3 | 6.44 E3 | 2 Pass |

Iodine on Cartridge

| Reference Date | Sample I.D. | Nuclide | Acceptance Range pCi | Reference Value pCi | Mean Reported Value pCi | Cross Check Status |
|----------------|-------------|---------|-------------------------|------------------------|----------------------------|--------------------|
| 6/17/2010 | E7154-37 | I-131 | 6.01 - 10.65 E1 | 8.01 E1 | 8.39 E1 | 3 Pass |

Tritium in Water

| Reference Date | Sample I.D. | Nuclide | Acceptance Range pCi/l | Reference Value pCi/l | Mean Reported Value pCi/l | Cross Check Status |
|----------------|-------------|---------|---------------------------|--------------------------|------------------------------|--------------------|
| 2/22/2010 | Q101TWS1 | H-3 | 6.68 - 11.84 E5 | 8.91 E5 | 9.00 E5 | 3 Pass |
| 2/22/2010 | Q101TWS2 | H-3 | 0.79 - 1.40 E7 | 1.05 E7 | 1.00 E7 | 3 Pass |
| 11/4/2010 | Q104TWR1 | H-3 | 3.14 - 5.56 E3 | 4.18 E3 | 3.91 E3 | 3 Pass |
| 11/4/2010 | Q104TWR2 | H-3 | 3.40 - 6.02 E4 | 4.53 E4 | 4.26 E4 | 3 Pass |
| 11/4/2010 | Q104TWR3 | H-3 | 4.98 - 8.83 E2 | 6.64 E2 | 6.12 E2 | 3 Pass |

Gross Beta in Water

| Reference Date | Sample I.D. | Nuclide | Acceptance Range pCi/l | Reference Value pCi/l | Mean Reported Value pCi/l | Cross Check Status |
|----------------|-------------|---------|---------------------------|--------------------------|------------------------------|--------------------|
| 11/18/2010 | Q104ABW1 | Cs-137 | 5.43 - 9.63 E1 | 7.24 E1 | 6.79 E1 | 3 Pass |
| 11/18/2010 | Q104ABW2 | Cs-137 | 4.88 - 8.66 E1 | 6.51 E1 | 6.44 E1 | 3 Pass |
| 11/18/2010 | Q104ABW3 | Cs-137 | 1.15 - 2.03 E1 | 1.53 E1 | 1.52 E1 | 3 Pass |

Table 5.0-A Footnote Explanations

- (1) Gamma in Soil (Special Testing), Sample ID E7380-37, Reference Date 12/9/2010
One of four Co-58 results was biased low and outside of the acceptance range (reference 6.18).

TABLE 5.0-B

ENVIRONMENTAL RESOURCE ASSOCIATES (ERA) QUIK™ RESPONSE PROGRAM

2010 PROFICIENCY TEST RESULTS FOR ENRAD LABORATORIES

ERA LABORATORY CODE: D242401

Proficiency test samples are received, prepared, analyzed, and reported to Environmental Resource Associates as described in the "Quik" Response instruction package within the study period. Proficiency test data are reported to ERA for evaluation. ERA reports proficiency test results to the North Carolina Department of Health and Human Services, North Carolina Public Drinking Water Laboratory Certification Program.

If applicable, footnote explanations are included following this data table.

Gamma Emitters in Water

| Reference Date | Sample I.D. | Nuclide | Acceptance Range pCi/l | Reference Value pCi/l | Reported Value pCi/l | Proficiency Check Status |
|----------------|----------------|---------|------------------------|-----------------------|----------------------|--------------------------|
| 4/5/2010 | RAD-81* | Ba-133 | 5.49 - 7.25 E1 | 6.59 E1 | 7.26 E1 | High ⁽¹⁾ |
| | | Cs-134 | 5.84 - 7.88 E1 | 7.16 E1 | 6.74 E1 | Pass |
| | | Cs-137 | 1.31 - 1.63 E2 | 1.46 E2 | 1.33 E2 | Pass |
| | | Co-60 | 7.60 - 9.53 E1 | 8.45 E1 | 8.40 E1 | Pass |
| | | Zn-65 | 1.67 - 2.19 E2 | 1.86 E2 | 1.93 E2 | Pass |
| 1/10/2010 | Quik 120810K** | Ba-133 | 6.10 - 8.02 E1 | 7.29 E1 | 7.75 E1 | Pass |
| | | Cs-134 | 5.15 - 6.97 E1 | 6.34 E1 | 6.18 E1 | Pass |
| | | Cs-137 | 1.08 - 1.34 E2 | 1.20 E2 | 1.14 E2 | Pass |
| | | Co-60 | 8.10 - 10.1 E1 | 9.00 E1 | 9.90 E1 | Pass |
| | | Zn-65 | 1.89 - 2.46 E2 | 2.10 E2 | 2.12 E2 | Pass |

Tritium in Water

| Reference Date | Sample I.D. | Nuclide | Acceptance Range pCi/l | Reference Value pCi/l | Reported Value pCi/l | Proficiency Check Status |
|----------------|----------------|---------|------------------------|-----------------------|----------------------|--------------------------|
| 4/5/2010 | RAD-81* | H-3 | 1.08 - 1.36 E4 | 1.24 E4 | 1.16 E4 | Pass |
| 1/10/2010 | Quik 120810K** | H-3 | 3.16 - 4.10 E3 | 3.72 E3 | 3.58 E3 | Pass |

* ERA study period 4/5/2010 - 5/20/2010, ERA data report issue date 5/26/2010

** ERA study period 12/8/2010 - 3/30/2011, ERA data report issue date 3/30/2010

Table 5.0-B Footnote Explanations

- (1) Gamma Emitters in Water, Sample ID RAD-81, Reference Date 4/5/2010
Reported result for Ba-133 was above the acceptance range limit (reference 6.19).

TABLE 5.0-C

2010 ENVIRONMENTAL DOSIMETER CROSS-CHECK RESULTS

Nuclear Technology Services

| 1st Quarter 2010 | | | | | | 2nd Quarter 2010 | | | | | |
|---------------------------|---------------|----------------|---------------|--------------------|-----------|---------------------------|---------------|----------------|---------------|--------------------|-----------|
| TLD Number | Reported (mR) | Delivered (mR) | Bias (% diff) | Pass/Fail Criteria | Pass/Fail | TLD Number | Reported (mR) | Delivered (mR) | Bias (% diff) | Pass/Fail Criteria | Pass/Fail |
| 102379 | 105.0 | 101.9 | 3.04 | <+/-15% | Pass | 102501 | 71.0 | 73.0 | -2.74 | <+/-15% | Pass |
| 102385 | 103.0 | 101.9 | 1.08 | <+/-15% | Pass | 102013 | 73.0 | 73.0 | 0.00 | <+/-15% | Pass |
| 102403 | 103.0 | 101.9 | 1.08 | <+/-15% | Pass | 100309 | 73.0 | 73.0 | 0.00 | <+/-15% | Pass |
| 102480 | 101.0 | 101.9 | -0.88 | <+/-15% | Pass | 100623 | 70.0 | 73.0 | -4.11 | <+/-15% | Pass |
| 102505 | 103.0 | 101.9 | 1.08 | <+/-15% | Pass | 102060 | 72.0 | 73.0 | -1.37 | <+/-15% | Pass |
| Average Bias (B) | | | 1.08 | | | Average Bias (B) | | | -1.64 | | |
| Standard Deviation (S) | | | 1.39 | | | Standard Deviation (S) | | | 1.79 | | |
| Measure Performance B +S | | | 2.47 | <15% | Pass | Measure Performance B +S | | | 3.43 | <15% | Pass |
| 3rd Quarter 2010 | | | | | | 4th Quarter 2010 | | | | | |
| TLD Number | Reported (mR) | Delivered (mR) | Bias (% diff) | Pass/Fail Criteria | Pass/Fail | TLD Number | Reported (mR) | Delivered (mR) | Bias (% diff) | Pass/Fail Criteria | Pass/Fail |
| 100252 | 56.1 | 55.9 | 0.36 | <+/-15% | Pass | 102367 | 88.0 | 84.0 | 4.76 | <+/-15% | Pass |
| 100403 | 55.2 | 55.9 | -1.25 | <+/-15% | Pass | 102399 | 91.0 | 84.0 | 8.33 | <+/-15% | Pass |
| 101143 | 55.3 | 55.9 | -1.07 | <+/-15% | Pass | 102402 | 87.0 | 84.0 | 3.57 | <+/-15% | Pass |
| 100065 | 54.2 | 55.9 | -3.04 | <+/-15% | Pass | 102480 | 90.0 | 84.0 | 7.14 | <+/-15% | Pass |
| 100054 | 57.2 | 55.9 | 2.33 | <+/-15% | Pass | 102510 | 90.0 | 84.0 | 7.14 | <+/-15% | Pass |
| Average Bias (B) | | | -0.54 | | | Average Bias (B) | | | 6.19 | | |
| Standard Deviation (S) | | | 2.00 | | | Standard Deviation (S) | | | 1.96 | | |
| Measure Performance B +S | | | 2.54 | <15% | Pass | Measure Performance B +S | | | 8.15 | <15% | Pass |

Internal Crosscheck (Duke Energy)

| 1st Quarter 2010 | | | | | | 2nd Quarter 2010 | | | | | |
|---------------------------|---------------|----------------|---------------|--------------------|-----------|---------------------------|---------------|----------------|---------------|--------------------|-----------|
| TLD Number | Reported (mR) | Delivered (mR) | Bias (% diff) | Pass/Fail Criteria | Pass/Fail | TLD Number | Reported (mR) | Delivered (mR) | Bias (% diff) | Pass/Fail Criteria | Pass/Fail |
| 102384 | 21.5 | 22.0 | -2.18 | <+/-15% | Pass | 101183 | 29.2 | 30.0 | -2.60 | <+/-15% | Pass |
| 102399 | 21.4 | 22.0 | -2.82 | <+/-15% | Pass | 100709 | 29.8 | 30.0 | -0.70 | <+/-15% | Pass |
| 102406 | 21.9 | 22.0 | -0.50 | <+/-15% | Pass | 101167 | 29.0 | 30.0 | -3.30 | <+/-15% | Pass |
| 102487 | 20.5 | 22.0 | -6.68 | <+/-15% | Pass | 101290 | 28.2 | 30.0 | -6.07 | <+/-15% | Pass |
| 102260 | 21.1 | 22.0 | -4.27 | <+/-15% | Pass | 100027 | 28.2 | 30.0 | -6.07 | <+/-15% | Pass |
| 102504 | 21.2 | 22.0 | -3.45 | <+/-15% | Pass | 101310 | 28.6 | 30.0 | -4.67 | <+/-15% | Pass |
| 102393 | 20.8 | 22.0 | -5.45 | <+/-15% | Pass | 101189 | 29.6 | 30.0 | -1.33 | <+/-15% | Pass |
| 102261 | 21.2 | 22.0 | -3.68 | <+/-15% | Pass | 101158 | 29.7 | 30.0 | -1.03 | <+/-15% | Pass |
| 102343 | 20.9 | 22.0 | -5.09 | <+/-15% | Pass | 101386 | 31.0 | 30.0 | 3.47 | <+/-15% | Pass |
| 101235 | 21.5 | 22.0 | -2.36 | <+/-15% | Pass | 101398 | 32.4 | 30.0 | 8.03 | <+/-15% | Pass |
| Average Bias (B) | | | -3.65 | | | Average Bias (B) | | | -1.43 | | |
| Standard Deviation (S) | | | 1.81 | | | Standard Deviation (S) | | | 4.38 | | |
| Measure Performance B +S | | | 5.46 | <15% | Pass | Measure Performance B +S | | | 5.81 | <15% | Pass |
| 3rd Quarter 2010 | | | | | | 4th Quarter 2010 | | | | | |
| TLD Number | Reported (mR) | Delivered (mR) | Bias (% diff) | Pass/Fail Criteria | Pass/Fail | TLD Number | Reported (mR) | Delivered (mR) | Bias (% diff) | Pass/Fail Criteria | Pass/Fail |
| 102264 | 96.8 | 100.0 | -3.21 | <+/-15% | Pass | 102301 | 33.1 | 35.0 | -5.46 | <+/-15% | Pass |
| 102406 | 101.4 | 100.0 | 1.41 | <+/-15% | Pass | 102471 | 34.8 | 35.0 | -0.49 | <+/-15% | Pass |
| 102399 | 99.7 | 100.0 | -0.30 | <+/-15% | Pass | 102083 | 33.7 | 35.0 | -3.66 | <+/-15% | Pass |
| 102403 | 97.0 | 100.0 | -2.97 | <+/-15% | Pass | 102442 | 33.4 | 35.0 | -4.60 | <+/-15% | Pass |
| 102480 | 98.8 | 100.0 | -1.17 | <+/-15% | Pass | 102389 | 33.4 | 35.0 | -4.46 | <+/-15% | Pass |
| 102505 | 99.0 | 100.0 | -1.00 | <+/-15% | Pass | 102362 | 33.9 | 35.0 | -3.20 | <+/-15% | Pass |
| 102440 | 95.1 | 100.0 | -4.95 | <+/-15% | Pass | 101413 | 33.4 | 35.0 | -4.66 | <+/-15% | Pass |
| 102479 | 95.7 | 100.0 | -4.33 | <+/-15% | Pass | 102007 | 33.1 | 35.0 | -5.57 | <+/-15% | Pass |
| 101136 | 98.2 | 100.0 | -1.84 | <+/-15% | Pass | 102509 | 34.9 | 35.0 | -0.31 | <+/-15% | Pass |
| 102339 | 95.6 | 100.0 | -4.41 | <+/-15% | Pass | 102058 | 33.2 | 35.0 | -5.23 | <+/-15% | Pass |
| Average Bias (B) | | | -2.28 | | | Average Bias (B) | | | -3.76 | | |
| Standard Deviation (S) | | | 2.05 | | | Standard Deviation (S) | | | 1.92 | | |
| Measure Performance B +S | | | 4.33 | <15% | Pass | Measure Performance B +S | | | 5.68 | <15% | Pass |

6.0 REFERENCES

- 6.1 Catawba Selected License Commitment Report
- 6.2 Catawba Technical Specifications
- 6.3 Catawba Updated Final Safety Analysis Review
- 6.4 Catawba Offsite Dose Calculation Manual
- 6.5 Catawba Annual Environmental Operating Report 1985 - 2009
- 6.6 Catawba Annual Effluent Report 1985 - 2010
- 6.7 Probability and Statistics in Engineering and Management Science, Hines and Montgomery, 1969, pages 287-293.
- 6.8 Practical Statistics for the Physical Sciences, Havilcek and Crain, 1988, pages 83-93.
- 6.9 Nuclear Regulatory Commission Regulatory Guide 1.109, Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purposes of Evaluating Compliance with 10CFR50, Appendix I.
- 6.10 EnRad Laboratories Operating Procedures
- 6.11 RETDAS, Radiological Effluent Tracking and Dose Assessment Software, Canberra Version 3.5.1, DPC Revision #4.0
- 6.12 NRC Integrated Inspection Report 05000413/2009003 and 05000414/2009003
- 6.13 Duke Energy Corporation EnRad Laboratory Charcoal Cartridge Study, performed 2001
- 6.14 Catawba Modifications CN-18103 (Unit 1), CN-28103 (Unit 2)
- 6.15 Nuclear System Directive (NSD) 701, Records Management
- 6.16 Radiological Effluents Controls INOS Audit 10-13(INOS)(REC)(CNS)
- 6.17 Radiological Effluent Controls INOS Audit 10-15(INOS)(REC)(MNS)
- 6.18 Problem Investigation Program Database, V 3.4.1, Duke Energy Company, G-11-00581
- 6.19 Problem Investigation Program Database, V 3.4.1, Duke Energy Company, G-11-00598
- 6.20 Problem Investigation Program Database, V 3.4.1, Duke Energy Company, G-11-01294

APPENDIX A

ENVIRONMENTAL SAMPLING
&
ANALYSIS PROCEDURES

APPENDIX A

ENVIRONMENTAL SAMPLING AND ANALYSIS PROCEDURES

Adherence to established procedures for sampling and analysis of all environmental media at Catawba Nuclear Station was required to ensure compliance with Station Selected Licensee Commitments. Analytical procedures were employed to ensure that Selected Licensee Commitments detection capabilities were achieved.

Environmental sampling and analyses were performed by EnRad Laboratories, Dosimetry and Records, Fisheries and Aquatic Ecology.

This appendix describes the environmental sampling frequencies and analysis procedures by media type.

I. CHANGE OF SAMPLING PROCEDURES

Location 205 (Air Particulate, Air Radioiodine, TLD) distance was updated from 0.23 miles to 0.25 miles as a result of assessment RP-SA-2009-0025 (reference 6.20).

II. DESCRIPTION OF ANALYSIS PROCEDURES

Gamma spectroscopy analyses are performed using high purity germanium gamma detectors and Canberra analytical software. Designated sample volumes are transferred to appropriate counting geometries and analyzed by gamma spectroscopy. Perishable samples such as fish and broadleaf vegetation are ground to achieve a homogeneous mixture. Soils and sediments are dried, sifted to remove foreign objects (rocks, clams, glass, etc.) then transferred to appropriate counting geometry.

Low-level iodine analyses are performed by passing a designated sample aliquot through a pre-weighed amount of ion exchange resin to remove and concentrate any iodine in the aqueous sample (milk). The resin is then dried, mixed thoroughly, and a net resin weight determined before being transferred to appropriate counting geometry and analyzed by gamma spectroscopy.

Tritium analyses are performed quarterly by using low-level environmental liquid scintillation analysis technique on a Packard 2550 liquid scintillation system or Perkin-Elmer 2900TR liquid scintillation system. Tritium samples are distilled and batch processed with a tritium spike and blank to verify instrument performance and sample preparation technique are acceptable.

Gross beta analysis is performed by concentrating a designated aliquot of sample precipitate and analyzing by Tennelec XLB Series 5 gas-flow proportional counters. Samples are batch processed with a blank to ensure sample contamination has not occurred.

III. CHANGE OF ANALYSIS PROCEDURES

No analysis procedures were changed during 2010.

IV. SAMPLING AND ANALYSIS PROCEDURES

A.1 AIRBORNE PARTICULATE AND RADIOIODINE

Airborne particulate and radioiodine samples at each of five locations were composited continuously by means of continuous air samplers. Air particulates were collected on a particulate filter and radioiodines were collected in a charcoal cartridge positioned behind the filter in the sampler. The samplers are designed to operate at a constant flow rate (in order to compensate for any filter loading) and are set to sample approximately 2 cubic feet per minute. Filters and cartridges were collected weekly. A separate weekly gamma analysis was performed on each charcoal cartridge and air particulate. A weekly gross beta analysis was performed on each filter. The continuous composite samples were collected from the locations listed below.

| | | |
|--------------|---|------------------------------|
| Location 200 | = | Site Boundary (0.63 mi. NNE) |
| Location 201 | = | Site Boundary (0.53 mi. NE) |
| Location 205 | = | Site Boundary (0.25 mi. SW) |
| Location 212 | = | Tega Cay (3.32 mi. E) |
| Location 258 | = | Fairhope Road (9.84 mi. W) |

A.2 DRINKING WATER

Monthly composite drinking water samples were collected at each of two locations. A gross beta and gamma analysis was performed on monthly composites. Tritium analysis was performed on the quarterly composites. The composites were collected monthly from the locations listed below.

| | | |
|--------------|---|---------------------------------------|
| Location 214 | = | Rock Hill Water Supply (7.30 mi. SSE) |
| Location 218 | = | Belmont Water Supply (13.5 mi. NNE) |

A.3 SURFACE WATER

Monthly composite samples were collected at each of three locations. A gamma analysis was performed on the monthly composites. Tritium analysis was

performed on the quarterly composites. The composites were collected monthly from the locations listed below.

Location 208 = Discharge Canal (0.45 mi. S)
Location 211 = Wylie Dam (4.06 mi. ESE)
Location 215 = River Pointe - Hwy 49 (4.21 mi. NNE)

A.4 GROUND WATER

Grab samples were collected quarterly from residential wells at each of two locations. A gamma analysis and tritium analysis were performed on each sample. The samples were collected from the locations listed below.

Location 252 = Residence (0.64 mi. SW)
Location 254 = Residence (0.82 mi. N)

A.5 MILK

Biweekly grab samples were collected at one location. A gamma and low-level Iodine-131 analysis was performed on each sample. The biweekly grab samples were collected from the location listed below.

Location 221 = Dairy (14.5 mi. NW)

A.6 BROADLEAF VEGETATION

Monthly samples were collected at each of five locations. A gamma analysis was performed on each sample. The samples were collected from the locations listed below.

Location 200 = Site Boundary (0.63 mi. NNE)
Location 201 = Site Boundary (0.53 mi. NE)
Location 222 = Site Boundary (0.70 mi. N)
Location 226 = Site Boundary (0.48 mi. S)
Location 258 = Fairhope Road (9.84 mi. W)

A.7 FOOD PRODUCTS

Monthly samples were collected when available during the harvest season at one location. A gamma analysis was performed on each sample. The samples were collected from the location listed below.

Location 253 = Irrigated Gardens (1.90 mi. SSE)

A.8 FISH

Semiannual samples were collected at each of two locations. A gamma analysis was performed on the edible portions of each sample. Boney fish (i.e. Sunfish) were prepared whole minus the head and tail portions. The samples were collected from the locations listed below.

Location 208 = Discharge Canal (0.45 mi. S)
Location 216 = Hwy 49 Bridge (4.19 mi. NNE)

A.9 SHORELINE SEDIMENT

Semiannual samples were collected at each of three locations. A gamma analysis was performed on each sample following the drying and removal of rocks and clams. The samples were collected from the locations listed below.

Location 208 = Discharge Canal (0.45 mi. S)
Location 210 = Ebenezer Access (2.31 mi. SE)
Location 215 = River Pointe - Hwy 49 (4.21 mi. NNE)

A.10 DIRECT GAMMA RADIATION (TLD)

Thermoluminescent dosimeters (TLD) were collected quarterly at forty-one locations. A gamma exposure rate was determined for each TLD. TLD locations are listed in Table 2.1-B. The TLDs were placed as indicated below.

- * An inner ring of 16 TLDs, one in each meteorological sector in the general area of the site boundary.
- * An outer ring of 16 TLDs, one in each meteorological sector in the 6 to 8 kilometer range.
- * The remaining TLDs were placed in special interest areas such as population centers, residential areas, schools, and at three control locations.

A.11 ANNUAL LAND USE CENSUS

An Annual Land Use Census was conducted to identify within a distance of 8 kilometers (5.0 miles) from the station, the nearest location from the site boundary in each of the sixteen meteorological sectors, the following:

- * The Nearest Residence
- * The Nearest Garden greater than 50 square meters or 500 square feet

* The Nearest Milk-giving Animal (cow, goat, etc.)

The census was conducted during the growing season from 7/14 to 7/15/2010. Results are shown in Table 3.11. No changes were made to the sampling procedures during 2010 as a result of the 2010 census.

V. **GLOBAL POSITIONING SYSTEM (GPS) ANALYSIS**

The Catawba site centerline used for GPS measurements was referenced from the Catawba Nuclear Station Updated Final Safety Analysis Report (UFSAR), section 2.1.1.1, Specification of Location. Waypoint coordinates used for CNS GPS measurements were latitude 35°-3'-5"N and longitude 81°-4'-10"W. Maps and tables were generated using North American Datum (NAD) 27. Data normally reflect accuracy to within 2 to 5 meters from point of measurement. All GPS field measurements were taken as close as possible to the item of interest. Distances for the locations are displayed using three significant figures.

APPENDIX B

**RADIOLOGICAL
ENVIRONMENTAL MONITORING
PROGRAM**

SUMMARY OF RESULTS

2010

Environmental Radiological Monitoring Program Summary

Facility: Catawba Nuclear Station

Docket No. 50-413,414

Location: York County, South Carolina

Report Period: 01-JAN-2010 to 31-DEC-2010

| Medium or Pathway Sampled | Type and Total Number of Analyses Performed | Lower Limit of Detection (LLD) | All Indicator Locations Mean (Fraction) Range | Location with Highest Annual Mean Name, Distance, Direction | | Control Location Mean (Fraction) Range | No. of Non-Routine Report Meas. |
|---------------------------------------|---|--------------------------------|--|--|---------------------------------------|---|---------------------------------|
| | | | | Location Code | Mean (Fraction) Range | | |
| Air Particulate (pCi/m ³) | | | | | | 258 (9.84 mi W) | |
| | BETA 264 | 1.00E-02 | 1.98E-2 (211/211) 8.86E-3 - 3.83E-2 | 212 (3.32 mi E) | 2.03E-2 (53/53) 1.08E-02 - 3.67E-2 | 1.90E-2 (53/53) 8.59E-3 - 3.73E-2 | 0 |
| | CS-134 264 | 5.00E-02 | 0.00 (0/211) 0.00 - 0.00 | | 0.00 (0/53) 0.00 - 0.00 | 0.00 (0/53) 0.00 - 0.00 | 0 |
| | CS-137 264 | 6.00E-02 | 0.00 (0/211) 0.00 - 0.00 | | 0.00 (0/53) 0.00 - 0.00 | 0.00 (0/53) 0.00 - 0.00 | 0 |
| | I-131 264 | 7.00E-02 | 0.00 (0/211) 0.00 - 0.00 | | 0.00 (0/53) 0.00 - 0.00 | 0.00 (0/53) 0.00 - 0.00 | 0 |

Mean and range based upon detectable measurements only

Fraction of detectable measurements at specified locations is indicated in parentheses, (Fraction)

Zero range indicates no detectable activity measurements

Environmental Radiological Monitoring Program Summary

Facility: Catawba Nuclear Station

Docket No. 50-413,414

Location: York County, South Carolina

Report Period: 01-JAN-2010 to 31-DEC-2010

| Medium or Pathway Sampled | Type and Total Number of | | Lower Limit of Detection (LLD) | All Indicator Locations Mean (Fraction) Range | Location with Highest Annual Mean Name, Distance, Direction | | Control Location Mean (Fraction) Range | No. of Non-Routine Report Meas. |
|---------------------------|--------------------------|-----|--------------------------------|--|--|----------------------------|---|---------------------------------|
| | Analyses Performed | | | | Location Code | Mean (Fraction) Range | | |
| Air Radioiodine (pCi/m3) | | | | | | | 258 (9.84 mi W) | |
| | CS-134 | 264 | 5.00E-02 | 0.00 (0/211) 0.00 - 0.00 | | 0.00 (0/53) 0.00 - 0.00 | 0.00 (0/53) 0.00 - 0.00 | 0 |
| | CS-137 | 264 | 6.00E-02 | 0.00 (0/211) 0.00 - 0.00 | | 0.00 (0/53) 0.00 - 0.00 | 0.00 (0/53) 0.00 - 0.00 | 0 |
| | I-131 | 264 | 7.00E-02 | 0.00 (0/211) 0.00 - 0.00 | | 0.00 (0/53) 0.00 - 0.00 | 0.00 (0/53) 0.00 - 0.00 | 0 |

Mean and range based upon detectable measurements only

Fraction of detectable measurements at specified locations is indicated in parentheses, (Fraction)

Zero range indicates no detectable activity measurements

Environmental Radiological Monitoring Program Summary

Facility: Catawba Nuclear Station

Docket No. 50-413,414

Location: York County, South Carolina

Report Period: 01-JAN-2010 to 31-DEC-2010

| Medium or Pathway Sampled | Type and Total Number of Analyses Performed | Lower Limit of Detection (LLD) | All Indicator Locations Mean (Fraction) Range | Location with Highest Annual Mean Name, Distance, Direction | | Control Location Mean (Fraction) Range | No. of Non-Routine Report Meas. |
|----------------------------|---|--------------------------------|--|---|-----------------------------|---|---------------------------------|
| | | | | Location Code | Mean (Fraction) Range | | |
| Drinking Water (pCi/liter) | | | | | | 218 (13.5 mi NNE) | |
| BALA-140 | 26 | 15 | 0.00 (0/13) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| BETA | 26 | 4 | 1.84 (13/13) 0.82 - 2.87 | 214 (7.30 mi SSE) | 1.84 (13/13) 0.82 - 2.87 | 1.80 (12/13) 1.01 - 2.71 | 0 |
| CO-58 | 26 | 15 | 0.00 (0/13) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| CO-60 | 26 | 15 | 0.00 (0/13) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| CS-134 | 26 | 15 | 0.00 (0/13) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| CS-137 | 26 | 18 | 0.00 (0/13) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| FE-59 | 26 | 30 | 0.00 (0/13) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| H-3 | 8 | 2000 | 705 (4/4) 507 - 993 | 214 (7.30 mi SSE) | 705 (4/4) 507 - 993 | 427 (4/4) 292 - 619 | 0 |
| I-131 | 26 | 15 | 0.00 (0/13) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| MN-54 | 26 | 15 | 0.00 (0/13) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| NB-95 | 26 | 15 | 0.00 (0/13) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| ZN-65 | 26 | 30 | 0.00 (0/13) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| ZR-95 | 26 | 15 | 0.00 (0/13) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |

Mean and range based upon detectable measurements only

Fraction of detectable measurements at specified locations is indicated in parentheses, (Fraction)

Zero range indicates no detectable activity measurements

Environmental Radiological Monitoring Program Summary

Facility: Catawba Nuclear Station

Docket No. 50-413,414

Location: York County, South Carolina

Report Period: 01-JAN-2010 to 31-DEC-2010

| Medium or Pathway Sampled | Type and Total Number of | Lower Limit of Detection | All Indicator Locations | Location with Highest Annual Mean | | Control Location | No. of Non-Routine Report Meas. |
|---------------------------|--------------------------|--------------------------|----------------------------|-----------------------------------|----------------------------|----------------------------|---------------------------------|
| | | | | Name, Distance, Direction | Mean (Fraction) Range | | |
| Unit of Measurement | Analyses Performed | (LLD) | Mean (Fraction) Range | Location Code | Mean (Fraction) Range | Mean (Fraction) Range | |
| Surface Water (pCi/liter) | | | | | | 215 (4.21 mi NNE) | |
| BALA-140 | 39 | 15 | 0.00 (0/26) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| CO-58 | 39 | 15 | 0.00 (0/26) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| CO-60 | 39 | 15 | 0.00 (0/26) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| CS-134 | 39 | 15 | 0.00 (0/26) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| CS-137 | 39 | 18 | 0.00 (0/26) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| FE-59 | 39 | 30 | 0.00 (0/26) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| H-3 | 12 | 2000 | 3970 (8/8) 468 - 11900 | 208 (0.45 mi S) | 7260 (4/4) 4180 - 11900 | 294 (3/4) 221 - 390 | 0 |
| I-131 | 39 | 15 | 0.00 (0/26) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| MN-54 | 39 | 15 | 0.00 (0/26) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| NB-95 | 39 | 15 | 0.00 (0/26) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| ZN-65 | 39 | 30 | 0.00 (0/26) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |
| ZR-95 | 39 | 15 | 0.00 (0/26) 0.00 - 0.00 | | 0.00 (0/13) 0.00 - 0.00 | 0.00 (0/13) 0.00 - 0.00 | 0 |

Mean and range based upon detectable measurements only

Fraction of detectable measurements at specified locations is indicated in parentheses, (Fraction)

Zero range indicates no detectable activity measurements

Environmental Radiological Monitoring Program Summary

Facility: Catawba Nuclear Station

Docket No. 50-413,414

Location: York County, South Carolina

Report Period: 01-JAN-2010 to 31-DEC-2010

| Medium or Pathway Sampled Unit of Measurement | Type and Total Number of Analyses Performed | Lower Limit of Detection (LLD) | All Indicator Locations Mean (Fraction) Range | Location with Highest Annual Mean Name, Distance, Direction | | Control Location Mean (Fraction) Range | No. of Non-Routine Report Meas. |
|--|--|---------------------------------------|--|--|---------------------------|---|---------------------------------|
| | | | | Location Code | Mean (Fraction) Range | | |
| Ground Water (pCi/liter) | | | | NO CONTROL LOCATION | | | |
| BALA-140 | 5 | 15 | 0.00 (0/5) 0.00 - 0.00 | | 0.00 (0/4) 0.00 - 0.00 | 0.00 (0/0) 0.00 - 0.00 | 0 |
| CO-58 | 5 | 15 | 0.00 (0/5) 0.00 - 0.00 | | 0.00 (0/4) 0.00 - 0.00 | 0.00 (0/0) 0.00 - 0.00 | 0 |
| CO-60 | 5 | 15 | 0.00 (0/5) 0.00 - 0.00 | | 0.00 (0/4) 0.00 - 0.00 | 0.00 (0/0) 0.00 - 0.00 | 0 |
| CS-134 | 5 | 15 | 0.00 (0/5) 0.00 - 0.00 | | 0.00 (0/4) 0.00 - 0.00 | 0.00 (0/0) 0.00 - 0.00 | 0 |
| CS-137 | 5 | 18 | 0.00 (0/5) 0.00 - 0.00 | | 0.00 (0/4) 0.00 - 0.00 | 0.00 (0/0) 0.00 - 0.00 | 0 |
| FE-59 | 5 | 30 | 0.00 (0/5) 0.00 - 0.00 | | 0.00 (0/4) 0.00 - 0.00 | 0.00 (0/0) 0.00 - 0.00 | 0 |
| H-3 | 5 | 2000 | 0.00 (0/5) 0.00 - 0.00 | | 0.00 (0/4) 0.00 - 0.00 | 0.00 (0/0) 0.00 - 0.00 | 0 |
| I-131 | 5 | 15 | 0.00 (0/5) 0.00 - 0.00 | | 0.00 (0/4) 0.00 - 0.00 | 0.00 (0/0) 0.00 - 0.00 | 0 |
| MN-54 | 5 | 15 | 0.00 (0/5) 0.00 - 0.00 | | 0.00 (0/4) 0.00 - 0.00 | 0.00 (0/0) 0.00 - 0.00 | 0 |
| NB-95 | 5 | 15 | 0.00 (0/5) 0.00 - 0.00 | | 0.00 (0/4) 0.00 - 0.00 | 0.00 (0/0) 0.00 - 0.00 | 0 |
| ZN-65 | 5 | 30 | 0.00 (0/5) 0.00 - 0.00 | | 0.00 (0/4) 0.00 - 0.00 | 0.00 (0/0) 0.00 - 0.00 | 0 |
| ZR-95 | 5 | 15 | 0.00 (0/5) 0.00 - 0.00 | | 0.00 (0/4) 0.00 - 0.00 | 0.00 (0/0) 0.00 - 0.00 | 0 |

Mean and range based upon detectable measurements only

Fraction of detectable measurements at specified locations is indicated in parentheses, (Fraction)

Zero range indicates no detectable activity measurements

Environmental Radiological Monitoring Program Summary

Facility: Catawba Nuclear Station

Docket No. 50-413,414

Location: York County, South Carolina

Report Period: 01-JAN-2010 to 31-DEC-2010

| Medium or Pathway Sampled | Type and Total Number of Analyses Performed | Lower Limit of Detection (LLD) | All Indicator Locations Mean (Fraction) Range | Location with Highest Annual Mean Name, Distance, Direction | | Control Location Mean (Fraction) Range | No. of Non-Routine Report Meas. |
|---------------------------|---|--------------------------------|--|--|---------------------------|---|---------------------------------|
| | | | | Location Code | Mean (Fraction) Range | | |
| Milk (pCi/liter) | | | NO INDICATOR LOCATION | | | 221 (14.5 mi NW) | |
| | BALA-140 26 | 15 | 0.00 (0/0) 0.00 - 0.00 | | 0.00 (0/0) 0.00 - 0.00 | 0.00 (0/26) 0.00 - 0.00 | 0 |
| | CS-134 26 | 15 | 0.00 (0/0) 0.00 - 0.00 | | 0.00 (0/0) 0.00 - 0.00 | 0.00 (0/26) 0.00 - 0.00 | 0 |
| | CS-137 26 | 18 | 0.00 (0/0) 0.00 - 0.00 | | 0.00 (0/0) 0.00 - 0.00 | 0.00 (0/26) 0.00 - 0.00 | 0 |
| | I-131 26 | 15 | 0.00 (0/0) 0.00 - 0.00 | | 0.00 (0/0) 0.00 - 0.00 | 0.00 (0/26) 0.00 - 0.00 | 0 |
| | LLI-131 26 | 1 | 0.00 (0/0) 0.00 - 0.00 | | 0.00 (0/0) 0.00 - 0.00 | 0.00 (0/26) 0.00 - 0.00 | 0 |

Mean and range based upon detectable measurements only

Fraction of detectable measurements at specified locations is indicated in parentheses, (Fraction)

Zero range indicates no detectable activity measurements

Environmental Radiological Monitoring Program Summary

Facility: Catawba Nuclear Station

Docket No. 50-413,414

Location: York County, South Carolina

Report Period: 01-JAN-2010 to 31-DEC-2010

| Medium or Pathway Sampled | Type and Total Number of | Lower Limit of Detection (LLD) | All Indicator Locations Mean (Fraction) Range | Location with Highest Annual Mean Name, Distance, Direction | | Control Location Mean (Fraction) Range | No. of Non-Routine Report Meas. |
|-----------------------------------|--------------------------|--------------------------------|--|--|-----------------------|---|---------------------------------|
| | | | | Location Code | Mean (Fraction) Range | | |
| Broadleaf Vegetation (pCi/kg-wet) | | | | | | 258 (9.84 mi W) | |
| | CS-134 | 60 | 60 | 0.00 (0/48) 0.00 - 0.00 | | 0.00 (0/12) 0.00 - 0.00 | 0 |
| | CS-137 | 60 | 80 | 37.7 (3/48) 20.6 - 55.8 | 201 (0.53 mi NE) | 37.7 (3/12) 20.6 - 55.8 | 0 |
| | I-131 | 60 | 60 | 0.00 (0/48) 0.00 - 0.00 | | 0.00 (0/12) 0.00 - 0.00 | 0 |
| | | | | | | | |

Mean and range based upon detectable measurements only

Fraction of detectable measurements at specified locations is indicated in parentheses, (Fraction)

Zero range indicates no detectable activity measurements

Environmental Radiological Monitoring Program Summary

Facility: Catawba Nuclear Station

Docket No. 50-413,414

Location: York County, South Carolina

Report Period: 01-JAN-2010 to 31-DEC-2010

| Medium or Pathway Sampled | Type and Total Number of | Lower Limit of Detection (LLD) | All Indicator Locations Mean (Fraction) Range | Location with Highest Annual Mean Name, Distance, Direction | | Control Location Mean (Fraction) Range | No. of Non-Routine Report Meas. |
|----------------------------|--------------------------|--------------------------------|---|--|---------------------------|--|---------------------------------|
| | | | | Location Code | Mean (Fraction) Range | | |
| Food Products (pCi/kg-wet) | | | | NO CONTROL LOCATION | | | |
| | CS-134 | 6 | 60 | 0.00 (0/6) 0.00 - 0.00 | 0.00 (0/6) 0.00 - 0.00 | 0.00 (0/0) 0.00 - 0.00 | 0 |
| | CS-137 | 6 | 80 | 0.00 (0/6) 0.00 - 0.00 | 0.00 (0/6) 0.00 - 0.00 | 0.00 (0/0) 0.00 - 0.00 | 0 |
| | I-131 | 6 | 60 | 0.00 (0/6) 0.00 - 0.00 | 0.00 (0/6) 0.00 - 0.00 | 0.00 (0/0) 0.00 - 0.00 | 0 |

Mean and range based upon detectable measurements only

Fraction of detectable measurements at specified locations is indicated in parentheses, (Fraction)

Zero range indicates no detectable activity measurements

Environmental Radiological Monitoring Program Summary

Facility: Catawba Nuclear Station

Docket No. 50-413,414

Location: York County, South Carolina

Report Period: 01-JAN-2010 to 31-DEC-2010

| Medium or Pathway Sampled Unit of Measurement | Type and Total Number of Analyses Performed | Lower Limit of Detection (LLD) | All Indicator Locations Mean (Fraction) Range | Location with Highest Annual Mean Name, Distance, Direction | | Control Location Mean (Fraction) Range | No. of Non-Routine Report Meas. |
|--|--|---------------------------------------|--|--|---------------------------|---|---------------------------------|
| | | | | Location Code | Mean (Fraction) Range | | |
| Fish (pCi/kg-wet) | | | | | | 216 (4.19 mi NNE) | |
| CO-58 | 12 | 130 | 0.00 (0/6) 0.00 - 0.00 | | 0.00 (0/6) 0.00 (0/6) | 0.00 (0/6) 0.00 - 0.00 | 0 |
| CO-60 | 12 | 130 | 0.00 (0/6) 0.00 - 0.00 | | 0.00 (0/6) 0.00 (0/6) | 0.00 (0/6) 0.00 - 0.00 | 0 |
| CS-134 | 12 | 130 | 0.00 (0/6) 0.00 - 0.00 | | 0.00 (0/6) 0.00 - 0.00 | 0.00 (0/6) 0.00 - 0.00 | 0 |
| CS-137 | 12 | 150 | 0.00 (0/6) 0.00 - 0.00 | | 0.00 (0/6) 0.00 - 0.00 | 0.00 (0/6) 0.00 - 0.00 | 0 |
| FE-59 | 12 | 260 | 0.00 (0/6) 0.00 - 0.00 | | 0.00 (0/6) 0.00 - 0.00 | 0.00 (0/6) 0.00 - 0.00 | 0 |
| MN-54 | 12 | 130 | 0.00 (0/6) 0.00 - 0.00 | | 0.00 (0/6) 0.00 - 0.00 | 0.00 (0/6) 0.00 - 0.00 | 0 |
| ZN-65 | 12 | 260 | 0.00 (0/6) 0.00 - 0.00 | | 0.00 (0/6) 0.00 - 0.00 | 0.00 (0/6) 0.00 - 0.00 | 0 |

Mean and range based upon detectable measurements only

Fraction of detectable measurements at specified locations is indicated in parentheses, (Fraction)

Zero range indicates no detectable activity measurements

Environmental Radiological Monitoring Program Summary

Facility: Catawba Nuclear Station

Docket No. 50-413,414

Location: York County, South Carolina

Report Period: 01-JAN-2010 to 31-DEC-2010

| Medium or Pathway Sampled Unit of Measurement | Type and Total Number of Analyses Performed | Lower Limit of Detection (LLD) | All Indicator Locations Mean (Fraction) Range | Location with Highest Annual Mean Name, Distance, Direction | | Control Location Mean (Fraction) Range | No. of Non-Routine Report Meas. | |
|--|--|---------------------------------------|--|--|-----------------------|---|---------------------------------|---|
| | | | | Location Code | Mean (Fraction) Range | | | |
| Shoreline Sediment (pCi/kg-dry) | | | | | | 215 (4.21 mi NNE) | | |
| | MN-54 | 6 | 0 | 0.00 (0/4) 0.00 - 0.00 | | 0.00 (0/2) 0.00 - 0.00 | | |
| | CO-58 | 6 | 0 | 65.6 (2/4) 63.0 - 68.1 | 208-1S (0.45 mi S) | 65.6 (2/2) 63.0 - 68.1 | 0.00 (0/2) 0.00 - 0.00 | 0 |
| | CO-60 | 6 | 0 | 137 (2/4) 31.5 - 243 | 208-1S (0.45 mi S) | 137 (2/2) 31.5 - 243 | 0.00 (0/2) 0.00 - 0.00 | 0 |
| | CS-134 | 6 | 150 | 0.00 (0/4) 0.00 - 0.00 | | 0.00 (0/2) 0.00 - 0.00 | 0.00 (0/2) 0.00 - 0.00 | 0 |
| | CS-137 | 6 | 180 | 25.6 (1/4) 25.6 - 25.6 | 208-1S (0.45 mi S) | 25.6 (1/2) 25.6 - 25.6 | 0.00 (0/2) 0.00 - 0.00 | 0 |

Mean and range based upon detectable measurements only

Fraction of detectable measurements at specified locations is indicated in parentheses, (Fraction)

Zero range indicates no detectable activity measurements

If LLD is equal to 0.00, then the LLD is not required by Selected Licensee Commitments

Environmental Radiological Monitoring Program Summary

Facility: Catawba Nuclear Station

Docket No. 50-413,414

Location: York County, South Carolina

Report Period: 01-JAN-2010 to 31-DEC-2010

| Medium or Pathway Sampled Unit of Measurement | Type and Total Number of Analyses Performed | Lower Limit of Detection (LLD) | All Indicator Locations Mean (Fraction) Range | Location with Highest Annual Mean Name, Distance, Direction | | Control Location Mean (Fraction) Range | No. of Non-Routine Report Meas. |
|--|--|---------------------------------------|--|--|-----------------------|---|---------------------------------|
| | | | | Location Code | Mean (Fraction) Range | | |
| Direct Radiation TLD (mR/standard quarter) | | | | | | 217 (10.3 mi SSE) | |
| | | | | | | 247 (7.33 mi ESE) | |
| | | | | | | 251 (9.72 mi WNW) | |
| | 163 | 0.00E+00 | 18.8 (151/151) | 205 | 24.0 (4/4) | 14.3 (12/12) | 0 |
| | | | 12.0 - 27.0 | (0.23 mi SW) | 21.0 - 27.0 | 11.0 - 19.0 | |

Mean and range based upon detectable measurements only

Fraction of detectable measurements at specified locations is indicated in parentheses, (Fraction)

Zero range indicates no detectable activity measurements

APPENDIX C

**SAMPLING DEVIATIONS
&
UNAVAILABLE ANALYSES**

APPENDIX C

CATAWBA NUCLEAR STATION SAMPLING DEVIATIONS & UNAVAILABLE ANALYSES

| DEVIATION & UNAVAILABLE REASON CODES | | | |
|--------------------------------------|---------------------------------|----|---|
| BF | Blown Fuse | PO | Power Outage |
| FZ | Sample Frozen | PS | Pump out of service / Undergoing Repair |
| IW | Inclement Weather | SL | Sample Loss/Lost due to Lab Accident |
| LC | Line Clog to Sampler | SM | Motor / Rotor Seized |
| OT | Other | TF | Torn Filter |
| PI | Power Interrupt | VN | Vandalism |
| PM | Preventive Maintenance | CN | Construction |
| WO | Well Unavailable/Out of Service | | |

C.1 SAMPLING DEVIATIONS

Air Particulate and Air Radioiodines

| Location | Scheduled Collection Dates | Actual Collection Dates | Reason Code | Corrective Action |
|----------|----------------------------|-------------------------|-------------|---|
| 258 | 2/16 - 2/23/2010 | 2/16 - 2/18/2010 | PO | Power interruption due to breaker trip. Breaker was reset and normal sampling resumed. |
| 258 | 3/9 - 3/16/2010 | 3/9 - 3/10/2010 | PO | Power interruption due to breaker trip. Work request 77735 initiated to verify electrical supply stability. Breaker reset, normal sampling resumed. |

Surface Water

| | | | | |
|-----|-----------------------------------|-------------------------------------|----|---|
| 215 | 5/4 - 6/2/2010 6/2 - 6/29/2010 | 5/11 - 6/2/2010 6/10 - 6/29/2010 | LC | Intake line clog to sampling equipment. Work request 79212 written. Flow restored 5/11/2010. Second line clog interrupted sampling during subsequent monitoring period. Work request 80216 written. Maintenance increased water flow through intake line. PIP G-10-00819 written. |
|-----|-----------------------------------|-------------------------------------|----|---|

C.2 UNAVAILABLE ANALYSES

Air Particulate and Air Radioiodines

| Location | Scheduled Collection Dates | Reason Code | Corrective Action |
|----------|----------------------------|-------------|--|
| 205 | 5/18 - 5/25/2010 | PO | Power interruption due to surge protector failure. Sampling equipment did not operate to collect sufficient volume for analysis. |

Ground Water

| Location | Scheduled Collection Dates | Reason Code | Corrective Action |
|----------|-----------------------------------|-------------|---|
| 252 | 6/8/2010 9/8/2010 12/7/2010 | WO | Well at this location (residence) is out of service. Residence is vacant and power is not available to operate well pump. PIP G-10-00754 generated. |

TLD

| Location | Scheduled Collection Dates | Reason Code | Corrective Action |
|----------|----------------------------|-------------|--|
| 249 | 6/16 - 9/15/2010 | VN | TLD missing. 4 th quarter 2010 TLD placed in field. |

APPENDIX D

ANALYTICAL DEVIATIONS

No Analytical deviations were incurred for the
2010 Radiological Environmental Monitoring Program