

Docket No: 50-454
50-455

BYRON NUCLEAR GENERATING STATION UNITS 1 and 2

Annual Radiological
Environmental Operating Report

1 January Through 31 December 2012

Prepared By

Teledyne Brown Engineering
Environmental Services



Byron Nuclear Generating Station
Byron, IL 61010

May 2013

Table Of Contents

I. Summary and Conclusions.....	1
II. Introduction	3
A. Objectives of the REMP	3
B. Implementation of the Objectives.....	3
III. Program Description	3
A. Sample Collection	3
B. Sample Analysis.....	6
C. Data Interpretation	6
D. Program Exceptions.....	8
E. Program Changes	9
IV. Results and Discussion	9
A. Aquatic Environment	9
1. Surface Water.....	9
2. Ground Water	10
3. Fish	10
4. Sediment.....	10
B. Atmospheric Environment	11
1. Airborne	11
a. Air Particulates.....	11
b. Airborne Iodine	11
2. Terrestrial.....	12
a. Milk.....	12
b. Vegetation.....	12
C. Ambient Gamma Radiation.....	12
D. Land Use Survey.....	13
E. Errata Data	13
F. Summary of Results – Inter-laboratory Comparison Program	14

Appendices

Appendix A Radiological Environmental Monitoring Report Summary

Tables

Table A-1 Radiological Environmental Monitoring Program Summary for Byron Nuclear Generating Station, 2012

Appendix B Location Designation, Distance & Direction, and Sample Collection & Analytical Methods

Tables

Table B-1 Radiological Environmental Monitoring Program - Sampling Locations, Distance and Direction, Byron Nuclear Generating Station, 2012

Table B-2 Radiological Environmental Monitoring Program - Summary of Sample Collection and Analytical Methods, Byron Nuclear Generating Station, 2012

Figures

Figure B-1 Inner and Outer Ring OSLD Locations of the Byron Nuclear Generating Station, 2012

Figure B-2 Onsite Air Sampling Locations of the Byron Nuclear Generating Station, 2012

Figure B-3 Offsite Air Sampling Locations of the Byron Nuclear Generating Station, 2012

Figure B-4 Ingestion and Waterborne Exposure Pathway Sampling Locations of the Byron Nuclear Generating Station, 2012

Appendix C Data Tables and Figures - Primary Laboratory

Tables

Table C-I.1 Concentrations of Gross Beta in Surface Water Samples Collected in the Vicinity of Byron Nuclear Generating Station, 2012.

Table C-I.2 Concentrations of Tritium in Surface Water Samples Collected in the Vicinity of Byron Nuclear Generating Station, 2012.

Table C-I.3 Concentrations of Gamma Emitters in Surface Water Samples Collected in the Vicinity of Byron Nuclear Generating Station, 2012

Table C-II.1	Concentrations of Tritium in Ground Water Samples Collected in the Vicinity of Byron Nuclear Generating Station, 2012.
Table C-II.2	Concentrations of Gamma Emitters in Ground Water Samples Collected in the Vicinity of Byron Nuclear Generating Station, 2012.
Table C-III.1	Concentrations of Gamma Emitters in Fish Samples Collected in the Vicinity of Byron Nuclear Generating Station, 2012.
Table C-IV.1	Concentrations of Gamma Emitters in Sediment Samples Collected in the Vicinity of Byron Nuclear Generating Station, 2012.
Table C-V.1	Concentrations of Gross Beta in Air Particulate Samples Collected in the Vicinity of Byron Nuclear Generating Station, 2012.
Table C-V.2	Monthly and Yearly Mean Values of Gross Beta Concentrations in Air Particulate Samples Collected in the Vicinity of Byron Nuclear Generating Station, 2012.
Table C-V.3	Concentrations of Gamma Emitters in Air Particulate Samples Collected in the Vicinity of Byron Nuclear Generating Station, 2012.
Table C-VI.1	Concentrations of I-131 in Air Iodine Samples Collected in the Vicinity of Byron Nuclear Generating Station, 2012.
Table C-VII.1	Concentrations of I-131 in Milk Samples Collected in the Vicinity of Byron Nuclear Generating Station, 2012.
Table C-VII.2	Concentrations of Gamma Emitters in Milk Samples Collected in the Vicinity of Byron Nuclear Generating Station, 2012.
Table C-VIII.1	Concentrations of Gamma Emitters in Vegetation Samples Collected in the Vicinity of Byron Nuclear Generating Station, 2012.
Table C-IX.1	Quarterly OSLD Results for Byron Nuclear Generating Station, 2012.
Table C-IX.2	Mean Quarterly OSLD Results for the Inner Ring, Outer Ring, Special Interest, Other and Control Locations for Byron Nuclear Generating Station, 2012.
Table C-IX.3	Summary of the Ambient Dosimetry Program for Byron Nuclear Generating Station, 2012.

Figures

Figure C-1	Surface Water - Gross Beta – Stations BY-12 and BY-29 (C) Collected in the Vicinity of BNGS, 2000 - 2012.
Figure C-2	Surface Water - Tritium – Stations BY-12 and BY-29 (C) Collected in the Vicinity of BNGS, 2000 - 2012.
Figure C-3	Ground Water - Tritium – Stations BY-14-1 and BY-18 Collected in the Vicinity of BNGS, 2000 - 2012.

- Figure C-4 Ground Water - Tritium – Stations BY-18-1 Collected in the Vicinity of BNGS, 2010 - 2012.
- Figure C-5 Ground Water - Tritium – Station BY-32 Collected in the Vicinity of BNGS, 2000 - 2012.
- Figure C-6 Ground Water - Tritium – Station BY-35 and BY-36 Collected in the Vicinity of BNGS, 2006 - 2012.
- Figure C-7 Ground Water - Tritium – Station BY-37 Collected in the Vicinity of BNGS, 2006 - 2012.
- Figure C-8 Air Particulate – Gross Beta – Stations BY-08 (C) and BY-21 Collected in the Vicinity of BNGS, 2000 - 2012.
- Figure C-9 Air Particulate – Gross Beta – Stations BY-22 and BY-23 Collected in the Vicinity of BNGS, 2000 - 2012.
- Figure C-10 Air Particulate – Gross Beta – Station BY-24 Collected in the Vicinity of BNGS, 2000 - 2012.
- Figure C-11 Air Particulate – Gross Beta – Station BY-01 and BY-04 Collected in the Vicinity of BNGS, 2005 - 2012.
- Figure C-12 Air Particulate – Gross Beta – Station BY-06 Collected in the Vicinity of BNGS, 2005 - 2012.

Appendix D Inter-Laboratory Comparison Program

Tables

- Table D-1 Analytics Environmental Radioactivity Cross Check Program
Teledyne Brown Engineering, 2012
- Table D-2 ERA Environmental Radioactivity Cross Check Program
Teledyne Brown Engineering, 2012
- Table D-3 DOE’s Mixed Analyte Performance Evaluation Program (MAPEP)
Teledyne Brown Engineering, 2012

Appendix E Effluent Report

Appendix E-1 Data Tables and Figures

Appendix F Meteorological Data

Intentionally left blank

I. Summary and Conclusions

This report on the Radiological Environmental Monitoring Program conducted for the Byron Nuclear Generating Station (BNGS) by Exelon covers the period 1 January 2012 through 31 December 2012. During that time period, 1,480 analyses were performed on 913 samples. In assessing all the data gathered for this report and comparing these results with preoperational data, it was concluded that the operation of BNGS had no adverse radiological impact on the environment.

Surface water samples were analyzed for concentrations of gross beta, tritium and gamma emitting nuclides. Ground water samples were analyzed for concentrations of tritium and gamma emitting nuclides. Gross beta activities detected were consistent with those detected in previous years. Tritium detected in downstream surface water was well below reportable limits and consistent with expected levels as a result of permitted liquid discharges.

Fish (commercially and/or recreationally important species) and sediment samples were analyzed for concentrations of gamma emitting nuclides. Non-plant produced Cesium-137 activity was detected at both sediment locations. Low levels of Cs-137 are detected occasionally and are consistent with data from previous years and are not a result of plant effluents.

Air particulate samples were analyzed for concentrations of gross beta and gamma emitting nuclides. No fission or activation products were detected.

High sensitivity I-131 analyses were performed on weekly air samples. All results were less than the minimum detectable concentration for I-131.

Cow milk samples were analyzed for concentrations of I-131 and gamma emitting nuclides. All I-131 results were below the minimum detectable activity. No fission or activation products were found.

Food Product samples were analyzed for concentrations of gamma emitting nuclides. No fission or activation products were detected.

Environmental gamma radiation measurements were performed quarterly using Optically Stimulated Luminescence Dosimeters (OSLD). Beginning in 2012, Exelon changed the type of dosimetry used for the Radiological Environmental Monitoring Program (REMP). Optically Stimulated Luminescent Dosimetry were deployed and Thermoluminescent Dosimetry (TLD) were discontinued. This change may result in a step change in readings, up or down, depending on site characteristics. The relative comparison to control locations remains valid. OSLD technology is different than that used in a TLD but has the same purpose (to measure direct radiation).

Intentionally left blank

II. Introduction

Byron Station, a two-unit PWR station, is located about two miles east of the Rock River and approximately three miles southwest of Byron in Ogle County, Illinois. The reactors are designed to have capacities of 1,280 and 1,254 MW gross, respectively. Unit One loaded fuel in November 1984 and went on line February 2, 1985. Unit Two went on line January 9, 1987. The station has been designed to keep releases to the environment at levels below those specified in the codes of federal regulations.

This report covers those analyses performed by Teledyne Brown Engineering (TBE) and Landauer on samples collected during the period 1 January 2012 through 31 December 2012.

A. Objectives of the REMP

The objectives of the REMP are to:

1. Provide data on measurable levels of radiation and radioactive materials in the site environs.
2. Evaluate the relationship between quantities of radioactive material released from the plant and resultant radiation doses to individuals from principal pathways of exposure.

B. Implementation of the Objectives

The implementation of the objectives is accomplished by:

1. Identifying significant exposure pathways.
2. Establishing baseline radiological data of media within those pathways.
3. Continuously monitoring those media before and during Station operation to assess Station radiological effects (if any) on man and the environment.

III. Program Description

A. Sample Collection

Samples for the BNGS REMP were collected for Exelon Nuclear by Environmental Inc. (Midwest Labs). This section describes the general collection methods used by Environmental Inc. to obtain environmental

samples for the BNGS REMP in 2012. Sample locations and descriptions can be found in Table B-1 and Figures B-1 through B-4, Appendix B.

Aquatic Environment

The aquatic environment was evaluated by performing radiological analyses on samples of surface water, ground water, fish and sediment. Two gallon water samples were collected weekly from two surface water locations (BY-12 and BY-29 [Control location]) and quarterly from six ground water locations (BY-14-1, BY-18-1, BY-32, BY-35, BY-36 and BY-37). All samples were collected in new unused plastic bottles, which were rinsed with source water prior to collection. Fish samples comprising the flesh of shorthead redhorse, quillback, freshwater drum and common carp were collected semiannually at two locations, BY-29 (control) and BY-31. Sediment samples composed of recently deposited substrate were collected at two locations semiannually, BY-12 and BY-34 (control).

Atmospheric Environment

The atmospheric environment was evaluated by performing radiological analyses on samples of air particulate, and airborne iodine. Airborne iodine and particulate samples were collected and analyzed weekly at eight locations (BY-01, BY-04, BY-06, BY-08, BY-21, BY-22, BY-23 and BY-24). The control location was BY-08. Airborne iodine and particulate samples were obtained at each location, using a vacuum pump with charcoal and glass fiber filters attached. The pumps were run continuously and sampled air at the rate of approximately one cubic foot per minute. The air filters and air iodine samples were replaced weekly and sent to the laboratory for analysis.

Terrestrial Environment

The terrestrial environment was evaluated by performing radiological analyses on samples of milk and food products. Samples were collected from two locations (BY-20-1 and BY-26-1) monthly from January through April and November through December, and biweekly May through October. Samples were collected from one location (BY-30-1) monthly from January through April and biweekly May through September. The control location was BY-26-1. All samples were collected in new unused two gallon plastic bottles from the bulk tank at each location, preserved with sodium bisulfate and shipped promptly to the laboratory.

Food products were collected annually in August at five locations (BY-Control, BY-Quad 1, BY-Quad 2, BY-Quad 3 and BY-Quad 4). Various types of samples were collected and placed in new unused plastic bags, and sent to the laboratory for analysis.

Ambient Gamma Radiation

Beginning in 2012, Exelon changed the type of dosimetry used for the Radiological Environmental Monitoring Program (REMP). Optically Stimulated Luminescent Dosimetry (OSLD) were deployed and Thermoluminescent Dosimetry (TLD) were discontinued. This change may result in a step change in readings, up or down, depending on site characteristics. The relative comparison to control locations remains valid. OSLD technology is different than that used in a TLD but has the same purpose (to measure direct radiation).

Each location consisted of 2 OSLD sets. The OSLDs were exchanged quarterly and sent to Landauer for analysis. The OSLDs were placed at locations on and around the BNGS Station site as follows:

An inner ring consisting of 16 locations (BY-101, BY-102, BY-103, BY-104, BY-105, BY-106, BY-107, BY-108, BY-109, BY-110, BY-111, BY-112, BY-113, BY-114, BY-115 and BY-116) near and within the site perimeter representing fence post doses (i.e., at locations where the doses will be potentially greater than maximum annual off-site doses) from BNGS releases.

An outer ring consisting of 16 locations (BY-201, BY-202, BY-203, BY-204, BY-205, BY-206, BY-207, BY-208, BY-209, BY-210, BY-211, BY-212, BY-213, BY-214, BY-215 and BY-216) extending to approximately 5 miles from the site designed to measure possible exposures to close-in population.

A special interest set consisting of seven locations (BY-301-1, BY-302-1, BY-309-1, BY-309-2, BY-309-3, BY-309-4 and BY-314-1) to measure possible exposures from on-site storage facilities.

An other set consisting of seven locations (BY-01, BY-04, BY-06, BY-21, BY-22, BY-23 and BY-24) at locations where air samplers are present.

The balance of one location (BY-08) representing the control area.

The specific OSLD locations were determined by the following criteria:

1. The presence of relatively dense population;
2. Site meteorological data taking into account distance and elevation for each of the sixteen–22 1/2 degree sectors around the site, where estimated annual dose from BNGS, if any, would be most significant;

3. On hills free from local obstructions and within sight of the vents (where practical);
4. And near the closest dwelling to the vents in the prevailing downwind direction.

Two OSLDs were placed at each location located at a minimum of five feet above ground level. The OSLDs were exchanged quarterly and sent to Landauer for analysis.

B. Sample Analysis

This section describes the general analytical methodologies used by TBE to analyze the environmental samples for radioactivity for the BNGS REMP in 2012. The analytical procedures used by the laboratory are listed in Table B-2.

In order to achieve the stated objectives, the current program includes the following analyses:

1. Concentrations of beta emitters in surface water and air particulates.
2. Concentrations of gamma emitters in ground and surface water, air particulates, milk, fish, sediment and vegetation.
3. Concentrations of tritium in ground and surface water.
4. Concentrations of I-131 in air and milk.
5. Ambient gamma radiation levels at various site environs.

C. Data Interpretation

The radiological and direct radiation data collected prior to Byron Nuclear Generating Station becoming operational were used as a baseline with which these operational data were compared. For the purpose of this report, Byron Nuclear Generating Station was considered operational at initial criticality. In addition, data were compared to previous years' operational data for consistency and trending. Several factors were important in the interpretation of the data:

1. Lower Limit of Detection and Minimum Detectable Concentration

The lower limit of detection (LLD) was defined as the smallest concentration of radioactive material in a sample that would yield a

net count (above background) that would be detected with only a 5% probability of falsely concluding that a blank observation represents a "real" signal. The LLD was intended as a before-the-fact estimate of a system (including instrumentation, procedure and sample type) and not as an after-the-fact criteria for the presence of activity. All analyses were designed to achieve the required BNGS detection capabilities for environmental sample analysis. The minimum detectable concentration (MDC) is defined above with the exception that the measurement is an after-the-fact estimate of the presence of activity.

2. Net Activity Calculation and Reporting of Results

Net activity for a sample was calculated by subtracting background activity from the sample activity. Since the REMP measures extremely small changes in radioactivity in the environment, background variations may result in sample activity being lower than the background activity effecting a negative number. An MDC was reported in all cases where positive activity was not detected.

Gamma spectroscopy results for each type of sample were grouped as follows:

For surface water, ground water and vegetation twelve nuclides, Mn-54, Co-58, Fe-59, Co-60, Zn-65, Nb-95, Zr-95, I-131, Cs-134, Cs-137, Ba-140 and La-140 were reported.

For fish, sediment, air particulate and milk eleven nuclides, Mn-54, Co-58, Fe-59, Co-60, Zn-65, Nb-95, Zr-95, Cs-134, Cs-137, Ba-140 and La-140 were reported.

Means and standard deviations of the results were calculated. The standard deviations represent the variability of measured results for different samples rather than single analysis uncertainty.

D. Program Exceptions

For 2012 the BNGS REMP had a sample recovery rate in excess of 99%. Sample anomalies and missed samples are listed in the tables below:

Table D-1 LISTING OF SAMPLE ANOMALIES

Sample Type	Location Code	Collection Date	Reason
A/I	BY-21	04/03/12	Low timer reading due to power outage for line repair.
AI	BY-23	05/15/12	Timer would not reset – replaced.
AI	BY-21	06/26/12	Low timer reading due to power outage.
AI	BY-21	07/17/12	Low timer reading due to power outage.
Land Use Census		08/31/12	Schedule deviation – Unable to perform census in Aug due to schedule conflicts(census performed in Sep).
A/I	BY-04	10/23/12	Low timer reading due to power outage from storms.
OSLD	BY-213-4	12/02/12	Dosimeter missing during monthly checks; replaced with spare EX00060316W.

Table D-2 LISTING OF MISSED SAMPLES

Sample Type	Location Code	Collection Date	Reason
SW	BY-12, BY-29	01/03/12	Sample unobtainable due to ice on river.
SW	BY-12, BY-29	01/18/12	Sample unobtainable due to ice on river.
SW	BY-12, BY-29	01/24/12	Sample unobtainable due to ice on river.
SW	BY-12, BY-29	02/14/12	Sample unobtainable due to ice on river.
SW	BY-12, BY-29	12/26/12	Sample unobtainable due to ice on river.

Each program exception was reviewed to understand the causes of the program exception. Sampling and maintenance errors were reviewed with the personnel involved to prevent recurrence. Occasional equipment breakdowns and power outages were unavoidable.

The overall sample recovery rate indicates that the appropriate procedures and equipment are in place to assure reliable program implementation.

E. Program Changes

1. Milk location BY-30-1 was taken out of service due to the milk farmer going out of business.

IV. Results and Discussion

A. Aquatic Environment

1. Surface Water

Samples were taken weekly and composited monthly at two locations (BY-12 and BY-29). Of these locations only BY-12 located downstream, could be affected by Byron Nuclear Generating Station's effluent releases. The following analyses were performed.

Gross Beta

Samples from both locations were analyzed for concentrations of gross beta (Table C-1.1, Appendix C). The values ranged from 2.7 to 12.7 pCi/l. Concentrations detected were consistent with those detected in previous years (Figure C-1, Appendix C).

Tritium

Quarterly composites of weekly collections were analyzed for tritium activity (Table C-1.2, Appendix C). Tritium was detected in two samples. The concentrations were 570 and 2,680 pCi/L (Figure C-2, Appendix C). Tritium detected in downstream surface water was well below reportable limits and consistent with expected levels as a result of permitted liquid discharges.

Gamma Spectrometry

Samples from both locations were analyzed for gamma emitting nuclides (Table C-1.3, Appendix C). No nuclides were detected, and all required LLDs were met.

2. Ground Water

Quarterly grab samples were collected at six locations (BY-14-1, BY-18-1, BY-32, BY-35, BY-36 and BY-37). These locations could be affected by Byron Nuclear Generating Station's effluent releases. The following analyses were performed:

Tritium

Quarterly grab samples from the locations were analyzed for tritium activity (Table C-II.1, Appendix C). No tritium was detected, and the required LLD was met (Figures C-3 through C-7, Appendix C).

Gamma Spectrometry

Samples from all locations were analyzed for gamma emitting nuclides (Table C-II.2 Appendix C). No nuclides were detected, and all required LLDs were met.

3. Fish

Fish samples comprised of shorthead redhorse, quillback, freshwater drum and common carp were collected at two locations (BY-29 and BY-31) semiannually. Location BY-31 could be affected by Byron Nuclear Generating Station's effluent releases. The following analysis was performed:

Gamma Spectrometry

The edible portion of fish samples from both locations was analyzed for gamma emitting nuclides (Table C-III.1, Appendix C). No nuclides were detected, and all required LLDs were met.

4. Sediment

Aquatic sediment samples were collected at two locations (BY-12 and BY-34) semiannually. BY-12, located downstream, could be affected by Byron Nuclear Generating Station's effluent releases. The following analysis was performed:

Gamma Spectrometry

Sediment samples from both locations were analyzed for gamma emitting nuclides (Table C-IV.1, Appendix C). Cesium-137 was detected in two samples. The concentrations were 64 and 196 pCi/L. Concentrations detected were consistent with those

detected in previous years and are not a result of plant effluents. No other nuclides were detected, and all required LLDs were met.

B. Atmospheric Environment

1. Airborne

a. Air Particulates

Continuous air particulate samples were collected from eight locations on a weekly basis. The eight locations were separated into three groups: Nearsite samplers (BY-21, BY-22, BY-23 and BY-24), Far Field samplers between 4 and 10 km of the site (BY-01, BY-04 and BY-06) and the Control sampler between 10 and 30 km from the site (BY-08). The following analyses were performed:

Gross Beta

Weekly samples were analyzed for concentrations of beta emitters (Table C–V.1 and C–V.2, Appendix C). Detectable gross beta activity was observed at all locations. Comparison of results among the three groups aid in determining the effects, if any, resulting from the operation of BNGS. The results from the Nearsite locations (Group I) ranged from 9 to 40 E–3 pCi/m³ with a mean of 20 E–3 pCi/m³. The results from the Far Field locations (Group II) ranged from 9 to 43 E–3 pCi/m³ with a mean of 20 E–3 pCi/m³. The results from the Control location (Group III) ranged from 8 to 44 E–3 pCi/m³ with a mean of 21 E–3 pCi/m³. Comparison of the 2012 air particulate data with previous years data indicate no effects from the operation of BNGS. In addition a comparison of the weekly mean values for 2012 indicate no notable differences among the three groups (Figures C–8 through C-12, Appendix C).

Gamma Spectrometry

Weekly samples were composited quarterly and analyzed for gamma emitting nuclides (Table C–V.3, Appendix C). No nuclides were detected, and all required LLDs were met.

b. Airborne Iodine

Continuous air samples were collected from eight locations (BY-01, BY-04, BY-06, BY-08, BY-21, BY-22, BY-23 and

BY-24) and analyzed weekly for I-131 (Table C–VI.1, Appendix C). All results were less than the minimum detectable concentration for I-131.

2. Terrestrial

a. Milk

Samples were collected from two locations (BY-20-1 and BY-26-1) monthly from January through April and November through December, and biweekly May through October. Samples were collected from one location (BY-30-1) monthly from January through April and biweekly May through September. The following analyses were performed:

Iodine-131

Milk samples from all locations were analyzed for concentrations of I-131 (Table C–VII.1, Appendix C). No nuclides were detected, and all required LLDs were met.

Gamma Spectrometry

Each milk sample was analyzed for concentrations of gamma emitting nuclides (Table C–VII.2, Appendix C). No nuclides were detected, and all required LLDs were met.

b. Vegetation

Vegetation samples were collected at five locations (BY-Control, BY-Quad 1, BY-Quad 2, BY-Quad 3 and BY-Quad 4) when available. Four locations (BY-Quad 1, BY-Quad 2, BY-Quad 3 and BY-Quad 4) could be affected by Byron Nuclear Generating Station's effluent releases. The following analysis was performed:

Gamma Spectrometry

Samples from all locations were analyzed for gamma emitting nuclides (Table C–VIII.1, Appendix C). No nuclides were detected, and all required LLDs were met.

C. Ambient Gamma Radiation

Ambient gamma radiation levels were measured utilizing OSLDs.

Ninety-one OSLD locations were established around the site. Results of OSLD measurements are listed in Tables C–X.1 to C–X.3, Appendix C.

All OSLD measurements were below 27 mR/standard quarter, with a range of 13.0 to 26.6 mR/standard quarter. A comparison of the Inner Ring, Outer Ring, Special Interest, Other and Control Location data indicate that the ambient gamma radiation levels were comparable among the groups.

D. Land Use Survey

A Land Use Survey conducted during September 2012 around the Byron Nuclear Generating Station (BNGS) was performed by Environmental Inc. (Midwest Labs) for Exelon Nuclear to comply with the Byron Nuclear Generating Station’s Offsite Dose Calculation Manual. The purpose of the survey was to document the nearest resident, livestock, and milk producing animals in each of the sixteen 22 ½ degree sectors and garden in each of the four 90 degree quadrants around the site. The results of this survey are summarized below.

Distance in Miles from the BNGS Vent Stacks				
Sector		Residence Miles	Livestock Miles	Milk Farm Miles
A	N	1.2	5.9	12.0
B	NNE	1.6	6.0	-
C	NE	1.1	4.5	-
D	ENE	1.0	3.5	-
E	E	1.2	4.2	-
F	ESE	1.5	1.3	-
G	SE	1.7	1.9	-
H	SSE	0.7	3.2	-
J	S	0.6	0.7	-
K	SSW	0.7	2.7	-
L	SW	0.8	2.0	-
M	WSW	1.6	1.7	4.5
N	W	1.8	3.2	-
P	WNW	1.6	3.5	-
Q	NW	0.9	3.8	-
R	NNW	0.9	1.4	5.0

E. Errata Data

There is no errata data for 2012.

F. Summary of Results – Inter-Laboratory Comparison Program

The primary laboratories analyzed Performance Evaluation (PE) samples of air particulate, air iodine, milk, soil, vegetation and water matrices (Appendix D). The PE samples, supplied by Analytics Inc., Environmental Resource Associates (ERA) and DOE's Mixed Analyte Performance Evaluation Program (MAPEP), were evaluated against the following pre-set acceptance criteria:

1. Analytics Evaluation Criteria

Analytics' evaluation report provides a ratio of laboratory results and Analytics' known value. Since flag values are not assigned by Analytics, TBE-ES evaluates the reported ratios based on internal QC requirements, which are based on the DOE MAPEP criteria.

2. ERA Evaluation Criteria

ERA's evaluation report provides an acceptance range for control and warning limits with associated flag values. ERA's acceptance limits are established per the USEPA, NELAC, state specific PT program requirements or ERA's SOP for the Generation of Performance Acceptance Limits, as applicable. The acceptance limits are either determined by a regression equation specific to each analyte or a fixed percentage limit promulgated under the appropriate regulatory document.

3. DOE Evaluation Criteria

MAPEP's evaluation report provides an acceptance range with associated flag values.

The MAPEP defines three levels of performance: Acceptable (flag = "A"), Acceptable with Warning (flag = "W"), and Not Acceptable (flag = "N"). Performance is considered acceptable when a mean result for the specified analyte is $\pm 20\%$ of the reference value. Performance is acceptable with warning when a mean result falls in the range from $\pm 20\%$ to $\pm 30\%$ of the reference value (i.e., $20\% < \text{bias} < 30\%$). If the bias is greater than 30%, the results are deemed not acceptable.

For the TBE laboratory, 12 out of 18 analytes met the specified acceptance criteria. Six analytes (Co-60, Gross Alpha, Gross Beta, Sr-89, Sr-90 and Zn-65) did not meet the specified acceptance criteria for the following reason:

1. Teledyne Brown Engineering's MAPEP March 2012 Co-60 in soil result of 7.61 Bq/kg was higher than the known value of 1.56 Bq/kg, resulting in a found to known ratio of 4.88 on a sensitivity evaluation. NCR 12-08 was initiated to investigate this failure. No cause could be found for the failure. TBE is monitoring the Co-60 in soil analyses on a case-to-case basis.
2. Teledyne Brown Engineering's MAPEP March 2012 Zn-65 in AP result of 4.19 Bq/sample was higher than the known value of 2.99 Bq/sample, exceeding the upper control limit of 3.89 Bq/sample. NCR 12-08 was initiated to investigate this failure. No cause could be found for the failure and is considered an anomaly specific to the MAPEP sample. The first and second quarter 2012 Analytics AP Zn-65 analyses were acceptable.
3. Teledyne Brown Engineering's MAPEP September 2012 Sr-90 in water result of 19.6 pCi/L was higher than the known value of 12.2 pCi/L, exceeding the upper control limit of 15.9 pCi/L. NCR 12-11 was initiated to investigate this failure. An incorrect aliquot was entered into LIMS. Using the correct aliquot, the result would have fallen within the acceptance range.
4. Teledyne Brown Engineering's ERA May 2012 Gross Alpha in water result of 82.4 pCi/L was higher than the known value of 62.9 pCi/L, which exceeded the upper control limit of 78.0 pCi/L. NCR 12-05 was initiated to investigate this failure. The G-1 detector is slightly biased high for Th-230 based measurements. The G-1 detector is used only for ERA samples. The detector was recalibrated.
5. Teledyne Brown Engineering's ERA November 2012 Gross Beta in water result of 59.3 pCi/L was higher than the known value of 39.2 pCi/L, which exceeded the upper control limit of 46.7 pCi/L. NCR 12-13 was initiated to investigate this failure. The rerun result of 44.8 fell within the control limits. It appears an incorrect aliquot was entered into LIMS.
6. Teledyne Brown Engineering's ERA November 2012 Sr-89 in water result of 46.5 pCi/L was higher than the known value of 39.1 pCi/L, which exceeded the upper control limit of 46.1 pCi/L. NCR 12-13 was initiated to investigate this failure. The found to known ratio was 1.19, which TBE considers acceptable with warning.

The Inter-Laboratory Comparison Program provides evidence of “in control” counting systems and methods, and that the laboratories are producing accurate and reliable data.

APPENDIX A

RADIOLOGICAL ENVIRONMENTAL MONITORING REPORT SUMMARY

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
BYRON NUCLEAR GENERATION STATION, 2012**

Name of Facility: BYRON		DOCKET NUMBER: 50-454 & 50-455							
Location of Facility: BYRON, IL		REPORTING PERIOD: 2012							
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR LOCATIONS		CONTROL LOCATION WITH HIGHEST ANNUAL MEAN (M)		STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
				MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE		
SURFACE WATER (PCU/LITER)	GR-B	24	4	4.6 (11/12) (3.4/6.8)	5.0 (11/12) (2.7/12.7)	5.0 (11/12) (2.7/12.7)	5.0 (11/12) (2.7/12.7)	BY-29 CONTROL BYRON - UPSTREAM 3.0 MILES N OF SITE	0
	H-3	8	200	1625 (2/4) (570/2680)	<LLD	1625 (2/4) (570/2680)	BY-12 INDICATOR OREGON POOL OF ROCK RIVER - DOWNSTREAM 4.5 MILES SSW OF SITE		0
	GAMMA MN-54	24	15	<LLD	<LLD	-			0
	CO-58		15	<LLD	<LLD	-			0
	FE-59		30	<LLD	<LLD	-			0
	CO-60		15	<LLD	<LLD	-			0
	ZN-65		30	<LLD	<LLD	-			0

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
BYRON NUCLEAR GENERATION STATION, 2012**

Name of Facility: BYRON		DOCKET NUMBER: 50-454 & 50-455						
Location of Facility: BYRON, IL		REPORTING PERIOD: 2012						
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR		LOCATION WITH HIGHEST ANNUAL MEAN (M)		NUMBER OF NONROUTINE REPORTED MEASUREMENTS
				LOCATIONS MEAN (M) (F) RANGE	CONTROL LOCATION MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION		
SURFACE WATER (PCI/LITER)	NB-95		15	<LLD	<LLD	-	-	0
	ZR-95		30	<LLD	<LLD	-	-	0
	I-131		15	<LLD	<LLD	-	-	0
	CS-134		15	<LLD	<LLD	-	-	0
	CS-137		18	<LLD	<LLD	-	-	0
	BA-140		60	<LLD	<LLD	-	-	0
	LA-140		15	<LLD	<LLD	-	-	0

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
BYRON NUCLEAR GENERATION STATION, 2012**

Name of Facility: BYRON		DOCKET NUMBER: 50-454 & 50-455									
Location of Facility: BYRON, IL		REPORTING PERIOD: 2012									
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR LOCATIONS		CONTROL LOCATION		LOCATION WITH HIGHEST ANNUAL MEAN (M)		STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
				MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE				
GROUND WATER (PCI/LITER)	H-3	24	200	<LLD	NA	-	NA	-	-		0
	GAMMA MN-54	24	15	<LLD	NA	-	NA	-	-		0
	CO-58		15	<LLD	NA	-	NA	-	-		0
	FE-59		30	<LLD	NA	-	NA	-	-		0
	CO-60		15	<LLD	NA	-	NA	-	-		0
	ZN-65		30	<LLD	NA	-	NA	-	-		0
	NB-95		15	<LLD	NA	-	NA	-	-		0

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
BYRON NUCLEAR GENERATION STATION, 2012**

Name of Facility: BYRON		DOCKET NUMBER: 50-454 & 50-455						
Location of Facility: BYRON, IL		REPORTING PERIOD: 2012						
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR		LOCATION WITH HIGHEST ANNUAL MEAN (M)		NUMBER OF NONROUTINE REPORTED MEASUREMENTS
				LOCATIONS MEAN (M) (F) RANGE	CONTROL MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION		
GROUND WATER (PCI/LITER)	ZR-95		30	<LLD	NA	-		0
	I-131		15	<LLD	NA	-		0
	CS-134		15	<LLD	NA	-		0
	CS-137		18	<LLD	NA	-		0
	BA-140		60	<LLD	NA	-		0
	LA-140		15	<LLD	NA	-		0
FISH (PCI/KG WET)	GAMMA MN-54	8	130	<LLD	<LLD	-		0

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
BYRON NUCLEAR GENERATION STATION, 2012**

Name of Facility: BYRON		DOCKET NUMBER: 50-454 & 50-455									
Location of Facility: BYRON, IL		REPORTING PERIOD: 2012									
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR		CONTROL		LOCATION WITH HIGHEST ANNUAL MEAN (M)		STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
				LOCATIONS MEAN (M) (F) RANGE	LOCATIONS MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE				
FISH (PCI/KG WET)	CO-58		130	<LLD	<LLD	<LLD	-	<LLD	-		0
	FE-59		260	<LLD	<LLD	<LLD	-	<LLD	-		0
	CO-60		130	<LLD	<LLD	<LLD	-	<LLD	-		0
	ZN-65		260	<LLD	<LLD	<LLD	-	<LLD	-		0
	NB-95		NA	<LLD	<LLD	<LLD	-	<LLD	-		0
	ZR-95		NA	<LLD	<LLD	<LLD	-	<LLD	-		0
	CS-134		130	<LLD	<LLD	<LLD	-	<LLD	-		0

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
BYRON NUCLEAR GENERATION STATION, 2012**

Name of Facility: BYRON		DOCKET NUMBER: 50-454 & 50-455									
Location of Facility: BYRON, IL		REPORTING PERIOD: 2012									
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR		CONTROL		LOCATION WITH HIGHEST ANNUAL MEAN (M)		STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
				LOCATIONS MEAN (M) (F) RANGE	LOCATIONS MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE				
FISH (PCI/KG WET)	CS-137		150	<LLD	<LLD	<LLD	-				0
	BA-140		NA	<LLD	<LLD	<LLD	-				0
	LA-140		NA	<LLD	<LLD	<LLD	-				0
SEDIMENT (PCI/KG DRY)	GAMMA MN-54	4	NA	<LLD	<LLD	<LLD	-				0
	CO-58		NA	<LLD	<LLD	<LLD	-				0
	FE-59		NA	<LLD	<LLD	<LLD	-				0
	CO-60		NA	<LLD	<LLD	<LLD	-				0

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
BYRON NUCLEAR GENERATION STATION, 2012**

Name of Facility: BYRON		DOCKET NUMBER: 50-454 & 50-455									
Location of Facility: BYRON, IL		REPORTING PERIOD: 2012									
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR		CONTROL		LOCATION WITH HIGHEST ANNUAL MEAN (M)		STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
				LOCATIONS MEAN (M) (F) RANGE	LOCATIONS MEAN (M) (F) RANGE	LOCATIONS MEAN (M) (F) RANGE	LOCATIONS MEAN (M) (F) RANGE				
SEDIMENT (PCI/KG DRY)	ZN-65		NA	<LLD	<LLD	<LLD	-				0
	NB-95		NA	<LLD	<LLD	<LLD	-				0
	ZR-95		NA	<LLD	<LLD	<LLD	-				0
	CS-134		150	<LLD	<LLD	<LLD	-				0
	CS-137		180	196 (1/2)	64 (1/2)	196 (1/2)				BY-12 INDICATOR OREGON POOL OF ROCK RIVER - DOWNSTREAM 4.5 MILES SSW OF SITE	0
	BA-140		NA	<LLD	<LLD	<LLD	-				0
	LA-140		NA	<LLD	<LLD	<LLD	-				0

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
BYRON NUCLEAR GENERATION STATION, 2012**

Name of Facility: BYRON		DOCKET NUMBER: 50-454 & 50-455									
Location of Facility: BYRON, IL		REPORTING PERIOD: 2012									
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR LOCATIONS		CONTROL LOCATION		LOCATION WITH HIGHEST ANNUAL MEAN (M)		STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
				MEAN (M) (F)	RANGE	MEAN (M) (F)	RANGE	MEAN (M) (F)	RANGE		
AIR PARTICULATE (E-3 PCI/CU.METER)	GR-B	424	10	20 (371/371) (9/43)	21 (53/53) (8/44)	21 (53/53) (8/44)	21 (53/53) (8/44)	21 (53/53) (8/44)	21 (53/53) (8/44)	BY-08 CONTROL LEAF RIVER 6.8 MILES WNW OF SITE	0
	GAMMA MN-54	32	NA	<LLD	<LLD	<LLD	<LLD	-	-		0
	CO-58		NA	<LLD	<LLD	<LLD	<LLD	-	-		0
	FE-59		NA	<LLD	<LLD	<LLD	<LLD	-	-		0
	CO-60		NA	<LLD	<LLD	<LLD	<LLD	-	-		0
	ZN-65		NA	<LLD	<LLD	<LLD	<LLD	-	-		0
	NB-95		NA	<LLD	<LLD	<LLD	<LLD	-	-		0

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
BYRON NUCLEAR GENERATION STATION, 2012**

Name of Facility: BYRON		DOCKET NUMBER: 50-454 & 50-455									
Location of Facility: BYRON, IL		REPORTING PERIOD: 2012									
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR LOCATIONS		CONTROL LOCATION		LOCATION WITH HIGHEST ANNUAL MEAN (M)		STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
				MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE				
AIR PARTICULATE (E-3 PCI/CU.METER)	ZR-95		NA	<LLD	<LLD	<LLD	-				0
	CS-134		150	<LLD	<LLD	<LLD	-				0
	CS-137		180	<LLD	<LLD	<LLD	-				0
	BA-140		NA	<LLD	<LLD	<LLD	-				0
	LA-140		NA	<LLD	<LLD	<LLD	-				0
AIR IODINE (E-3 PCI/CU.METER)	GAMMA I-131	424	70	<LLD	<LLD	<LLD	-				0

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
BYRON NUCLEAR GENERATION STATION, 2012**

Name of Facility: BYRON		DOCKET NUMBER: 50-454 & 50-455							
Location of Facility: BYRON, IL		REPORTING PERIOD: 2012							
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR		LOCATION WITH HIGHEST ANNUAL MEAN (M)		STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
				LOCATIONS MEAN (M) (F) RANGE	CONTROL LOCATION MEAN (M) (F) RANGE				
MILK (PCI/LITER)	I-131	55	1	<LLD	<LLD	-	<LLD		0
	GAMMA MN-54	55	NA	<LLD	<LLD	-	<LLD		0
	CO-58		NA	<LLD	<LLD	-	<LLD		0
	FE-59		NA	<LLD	<LLD	-	<LLD		0
	CO-60		NA	<LLD	<LLD	-	<LLD		0
	ZN-65		NA	<LLD	<LLD	-	<LLD		0
	NB-95		NA	<LLD	<LLD	-	<LLD		0

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
BYRON NUCLEAR GENERATION STATION, 2012**

Name of Facility: BYRON		DOCKET NUMBER: 50-454 & 50-455						
Location of Facility: BYRON, IL		REPORTING PERIOD: 2012						
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR		LOCATION WITH HIGHEST ANNUAL MEAN (M)		NUMBER OF NONROUTINE REPORTED MEASUREMENTS
				LOCATIONS MEAN (M) (F) RANGE	CONTROL MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION		
MILK (PCI/LITER)	ZR-95		NA	<LLD	<LLD	-		0
	CS-134		15	<LLD	<LLD	-		0
	CS-137		18	<LLD	<LLD	-		0
	BA-140		60	<LLD	<LLD	-		0
	LA-140		15	<LLD	<LLD	-		0
VEGETATION (PCI/KG WET)	GAMMA MN-54	10	NA	<LLD	<LLD	-		0

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
BYRON NUCLEAR GENERATION STATION, 2012**

Name of Facility: BYRON		DOCKET NUMBER: 50-454 & 50-455									
Location of Facility: BYRON, IL		REPORTING PERIOD: 2012									
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR		CONTROL		LOCATION WITH HIGHEST ANNUAL MEAN (M)		STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
				LOCATIONS MEAN (M) (F) RANGE	LOCATIONS MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE				
VEGETATION (PCI/KG WET)	CO-58		NA	<LLD	<LLD	<LLD	-	<LLD	-		0
	FE-59		NA	<LLD	<LLD	<LLD	-	<LLD	-		0
	CO-60		NA	<LLD	<LLD	<LLD	-	<LLD	-		0
	ZN-65		NA	<LLD	<LLD	<LLD	-	<LLD	-		0
	NB-95		NA	<LLD	<LLD	<LLD	-	<LLD	-		0
	ZR-95		NA	<LLD	<LLD	<LLD	-	<LLD	-		0
	I-131		60	<LLD	<LLD	<LLD	-	<LLD	-		0

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
BYRON NUCLEAR GENERATION STATION, 2012**

Name of Facility: BYRON		DOCKET NUMBER: 50-454 & 50-455							
Location of Facility: BYRON, IL		REPORTING PERIOD: 2012							
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR LOCATIONS		CONTROL LOCATION WITH HIGHEST ANNUAL MEAN (M)		STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
				MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE		
VEGETATION (PCI/KG WET)	CS-134		60	<LLD	<LLD	<LLD	-		0
	CS-137		80	<LLD	<LLD	<LLD	-		0
	BA-140		NA	<LLD	<LLD	<LLD	-		0
	LA-140		NA	<LLD	<LLD	<LLD	-		0
DIRECT RADIATION (MILLI-ROENTGEN/QTR.)	OSLD-QUARTERLY	364	NA	20.9 (356/356) (13.0/26.6)	17.5 (8/8) (15.5/19.0)	24.5 (4/4) (22.1/26.0)		BY-107-2 INDICATOR 1.4 MILES SE	0

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

Intentionally left blank

APPENDIX B

LOCATION DESIGNATION, DISTANCE & DIRECTION, AND SAMPLE COLLECTION & ANALYTICAL METHODS

TABLE B-1: Radiological Environmental Monitoring Program - Sampling Locations, Distance and Direction, Byron Nuclear Generating Station, 2012

Location	Location Description	Distance & Direction From Site
<u>A. Surface Water</u>		
BY-12	Oregon Pool of Rock River, Downstream	4.5 miles SSW
BY-29	Byron, Upstream (control)	3.0 miles N
<u>B. Ground/Well Water</u>		
BY-14-1	3200 North German Church Road	1.0 miles SSE
BY-18-1	Calhoun	0.7 miles SSW
BY-32	Ron Wolford Well	1.9 miles W
BY-35	Vancko Well	1.9 miles WNW
BY-36	Blanchard Well	0.8 miles NW
BY-37	Alexander Well	2.0 miles WNW
<u>C. Milk</u>		
BY-20-1	Ron Snodgrass Farm	4.8 miles WSW
BY-26-1	Dennis Herbert (control)	12.8 miles N
BY-30-1	Ebert Farm	5.0 miles NNW
<u>D. Air Particulates / Air Iodine</u>		
BY-01	Byron	3.0 miles N
BY-04	Paynes Point	5.0 miles SE
BY-06	Oregon	4.7 miles SSW
BY-08	Leaf River (control)	7.0 miles WNW
BY-21	Byron Nearsite North	0.3 miles N
BY-22	Byron Nearsite Southeast	0.4 miles SE
BY-23	Byron Nearsite South	0.6 miles S
BY-24	Byron Nearsite Southwest	0.7 miles SW
<u>E. Fish</u>		
BY-29	Byron, Upstream (control)	3.0 miles N
BY-31	Byron, Discharge	2.6 miles WNW
<u>F. Sediment</u>		
BY-12	Oregon Pool of Rock River, Downstream	4.6 miles SSW
BY-34	Rock River, Upstream of Discharge (control)	2.6 miles WNW
<u>G. Vegetation</u>		
Quadrant 1	5186 N. Cox Road, Stillman Valley	4.9 miles ENE
Quadrant 2	6402 Brick Road, Oregon	4.8 miles SE
Quadrant 3	2002 Deer Path Road, Oregon	0.9 miles SW
Quadrant 4	4629 Razorville Road, Byron	0.9 miles NW
Control	3933 South Bend Road, New Mulford	10.8 miles NE
<u>H. Environmental Dosimetry - OSLD</u>		
<u>Inner Ring</u>		
BY-101-1 and -2		0.3 miles N
BY-102-1		1.0 miles NNE
BY-102-2		1.0 miles NNE

TABLE B-1: Radiological Environmental Monitoring Program - Sampling Locations, Distance and Direction, Byron Nuclear Generating Station, 2012

Location	Location Description	Distance & Direction From Site
<u>H. Environmental Dosimetry – OSLD (continued)</u>		
<u>Inner Ring</u>		
BY-103-1 and -2		1.7 miles NE
BY-103-3		0.4 miles NE
BY-104-1 and -2		1.4 miles ENE
BY-104-3		0.3 miles ENE
BY-105-1 and -2		1.3 miles E
BY-106-1 and -2		1.4 miles ESE
BY-107-1 and -2		1.4 miles SE
BY-107-3		0.4 miles SE
BY-108-1		0.7 miles SSE
BY-108-2		0.6 miles SSE
BY-109-1 and -2		0.6 miles S
BY-110-1 and -2		0.7 miles SSW
BY-111-3		0.8 miles SW
BY-111-4		0.9 miles SW
BY-112-3 and -4		0.8 miles WSW
BY-113-1 and -2		0.7 miles W
BY-114-1 and -2		0.8 miles WNW
BY-115-1 and -2		1.0 miles NW
BY-116-1 and -2		1.4 miles NNW
BY-116-3		0.9 miles NNW
<u>Outer Ring</u>		
BY-201-3		4.4 miles N
BY-201-4		4.4 miles N
BY-202-1		4.4 miles NNE
BY-202-2		4.8 miles NNE
BY-203-1		4.8 miles NE
BY-203-2		4.7 miles NE
BY-204-1		4.1 miles ENE
BY-204-2		4.0 miles ENE
BY-205-1 and -2		3.8 miles E
BY-206-1		4.0 miles ESE
BY-206-2		4.3 miles ESE
BY-207-1		4.2 miles SE
BY-207-2		3.9 miles SE
BY-208-1		4.0 miles SSE
BY-208-2		3.8 miles SSE
BY-209-1 and -4		4.0 miles S
BY-210-3 and -4		3.9 miles SSW
BY-211-1 and -4		4.9 miles SW
BY-212-1 and -4		4.7 miles WSW
BY-213-1		4.7 miles W
BY-213-4		4.7 miles W
BY-214-1		4.7 miles WNW
BY-214-4		4.6 miles WNW
BY-215-1		4.2 miles NW
BY-215-4		4.2 miles NW
BY-216-1		4.5 miles NNW
BY-216-2		4.7 miles NNW

TABLE B-1: Radiological Environmental Monitoring Program - Sampling Locations, Distance and Direction, Byron Nuclear Generating Station, 2012

Location	Location Description	Distance & Direction From Site
<u>Special Interest</u>		
BY-301-1		0.3 miles N
BY-302-1		0.1 miles NNE
BY-309-1		0.3 miles S
BY-309-2		0.4 miles S
BY-309-3		0.4 miles S
BY-309-4		0.4 miles SSW
BY-314-1		0.3 miles WNW
<u>Other</u>		
BY-01-1 and -2		3.0 miles N
BY-04-1 and -2		5.0 miles SE
BY-06-1 and -2		4.7 miles SSW
BY-21-1 and -2		0.3 miles N
BY-22-1 and -2		0.4 miles SE
BY-23-1 and -2		0.6 miles S
BY-24-1 and -2		0.7 miles SW
<u>Control</u>		
BY-08-1 and -2		7.0 miles WNW

TABLE B-2: Radiological Environmental Monitoring Program – Summary of Sample Collection and Analytical Methods, Byron Nuclear Generating Station, 2012

Sample Medium	Analysis	Sampling Method	Analytical Procedure Number
Surface Water	Gamma Spectroscopy	Monthly composite from weekly grab samples.	TBE, TBE-2007 Gamma emitting radioisotope analysis
Surface Water	Gross Beta	Monthly composite from weekly grab samples.	TBE, TBE-2008 Gross Alpha and/or gross beta activity in various matrices
Surface Water	Tritium	Quarterly composite from weekly grab samples.	TBE, TBE-2011 Tritium analysis in drinking water by liquid scintillation
Ground Water	Gamma Spectroscopy	Quarterly grab samples.	TBE, TBE-2007 Gamma emitting radioisotope analysis
Ground Water	Tritium	Quarterly grab samples.	TBE, TBE-2011 Tritium analysis in drinking water by liquid scintillation
Fish	Gamma Spectroscopy	Semi-annual samples collected via electroshocking or other techniques	TBE-2007 Gamma emitting radioisotope analysis
Sediment	Gamma Spectroscopy	Semi-annual grab samples	TBE, TBE-2007 Gamma emitting radioisotope analysis
Air Particulates	Gross Beta	One-week composite of continuous air sampling through glass fiber filter paper	TBE, TBE-2008 Gross Alpha and/or gross beta activity in various matrices
Air Particulates	Gamma Spectroscopy	Quarterly composite of each station	TBE, TBE-2007 Gamma emitting radioisotope analysis
Air Iodine	Gamma Spectroscopy	One-week composite of continuous air sampling through charcoal filter	TBE, TBE-2007 Gamma emitting radioisotope analysis
Milk	I-131	Bi-weekly grab sample when cows are on pasture. Monthly all other times	TBE, TBE-2012 Radioiodine in various matrices
Milk	Gamma Spectroscopy	Bi-weekly grab sample when cows are on pasture. Monthly all other times	TBE, TBE-2007 Gamma emitting radioisotope analysis
Vegetation	Gamma Spectroscopy	Annual grab samples.	TBE, TBE-2007 Gamma emitting radioisotope analysis
OSLD	Optically Stimulated Luminescence Dosimetry	Quarterly OSLDs comprised of two Al ₂ O ₃ :C Landauer Incorporated elements.	Landauer Incorporated

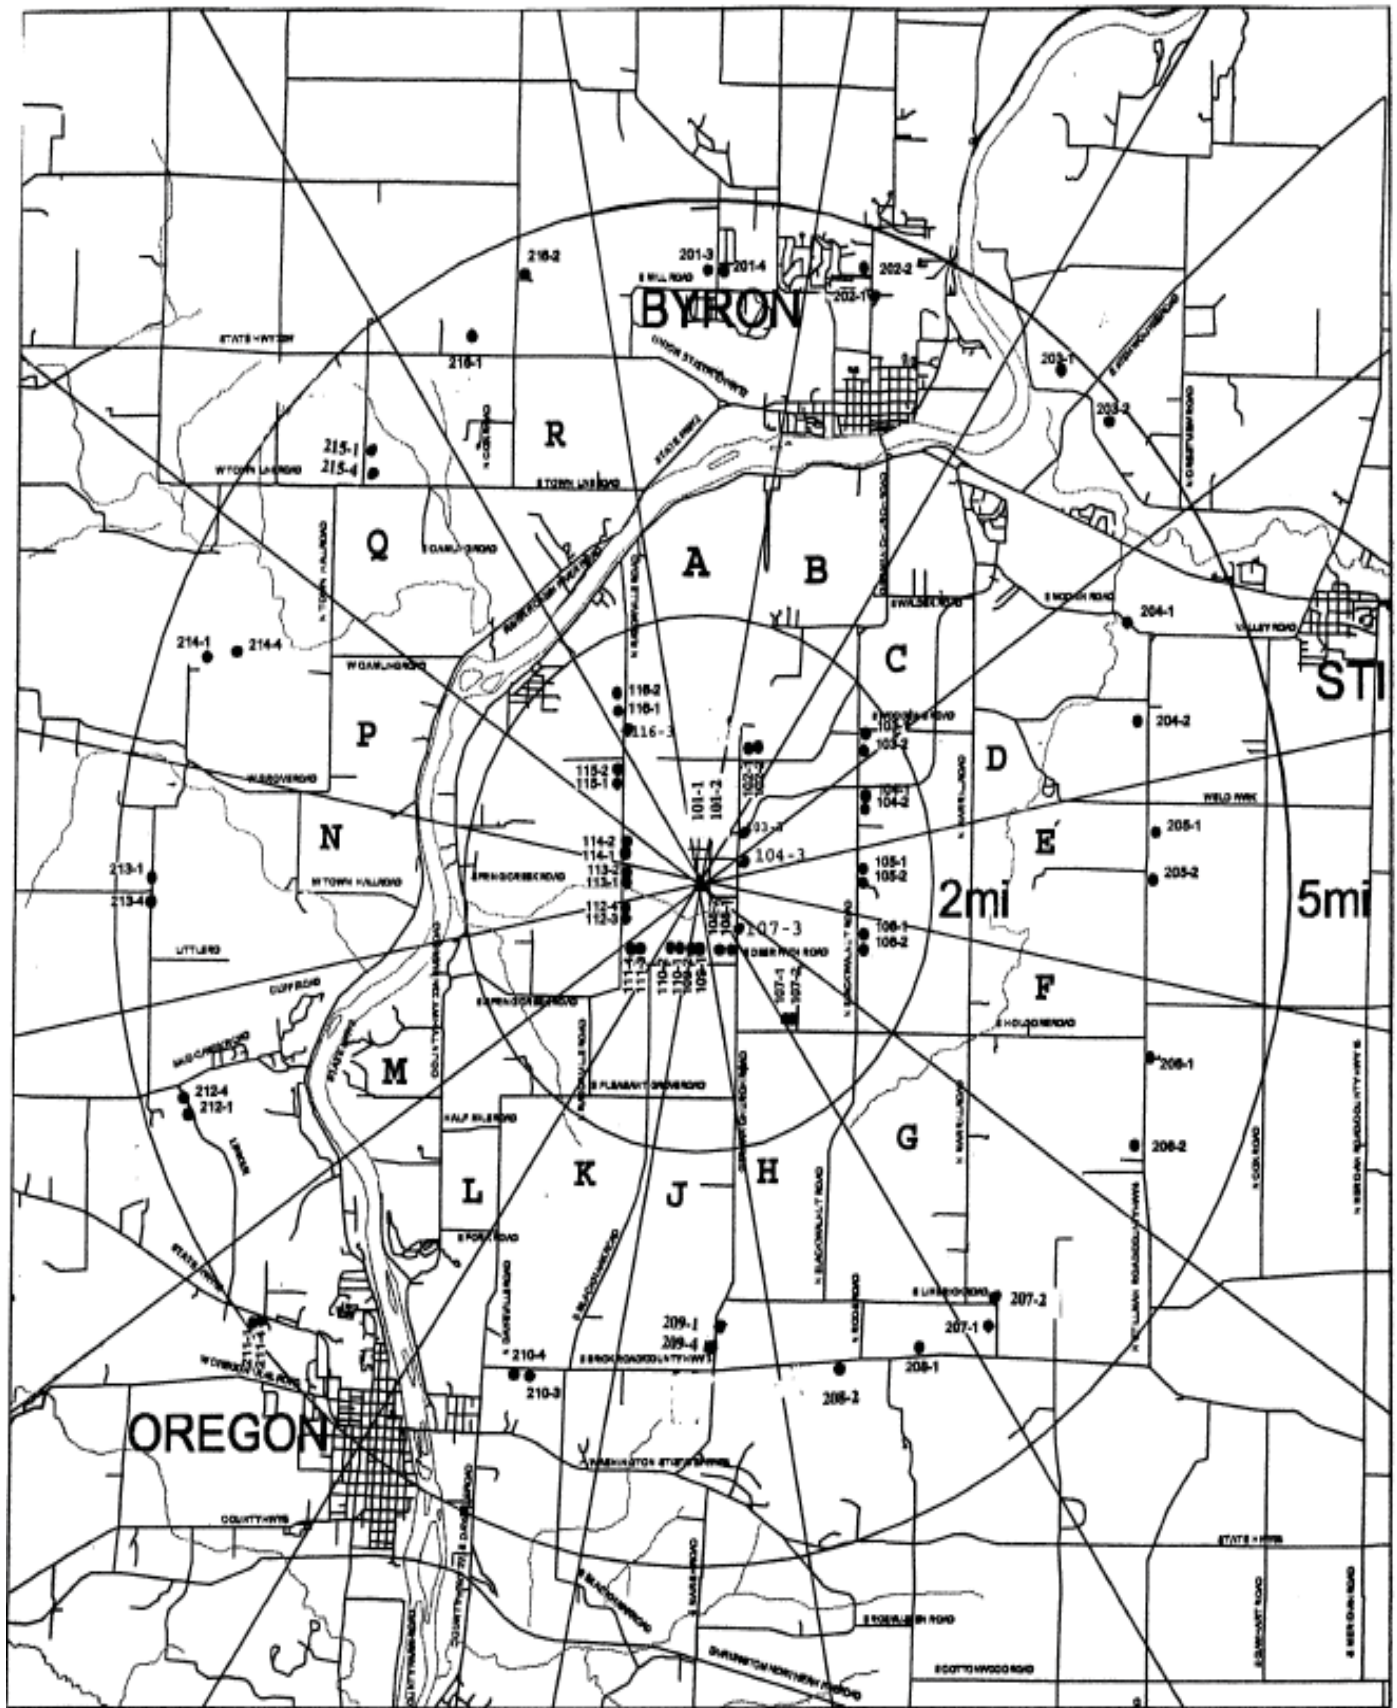


Figure B-1
 Inner and Outer Ring OSLD Locations of the
 Byron Nuclear Generating Station, 2012



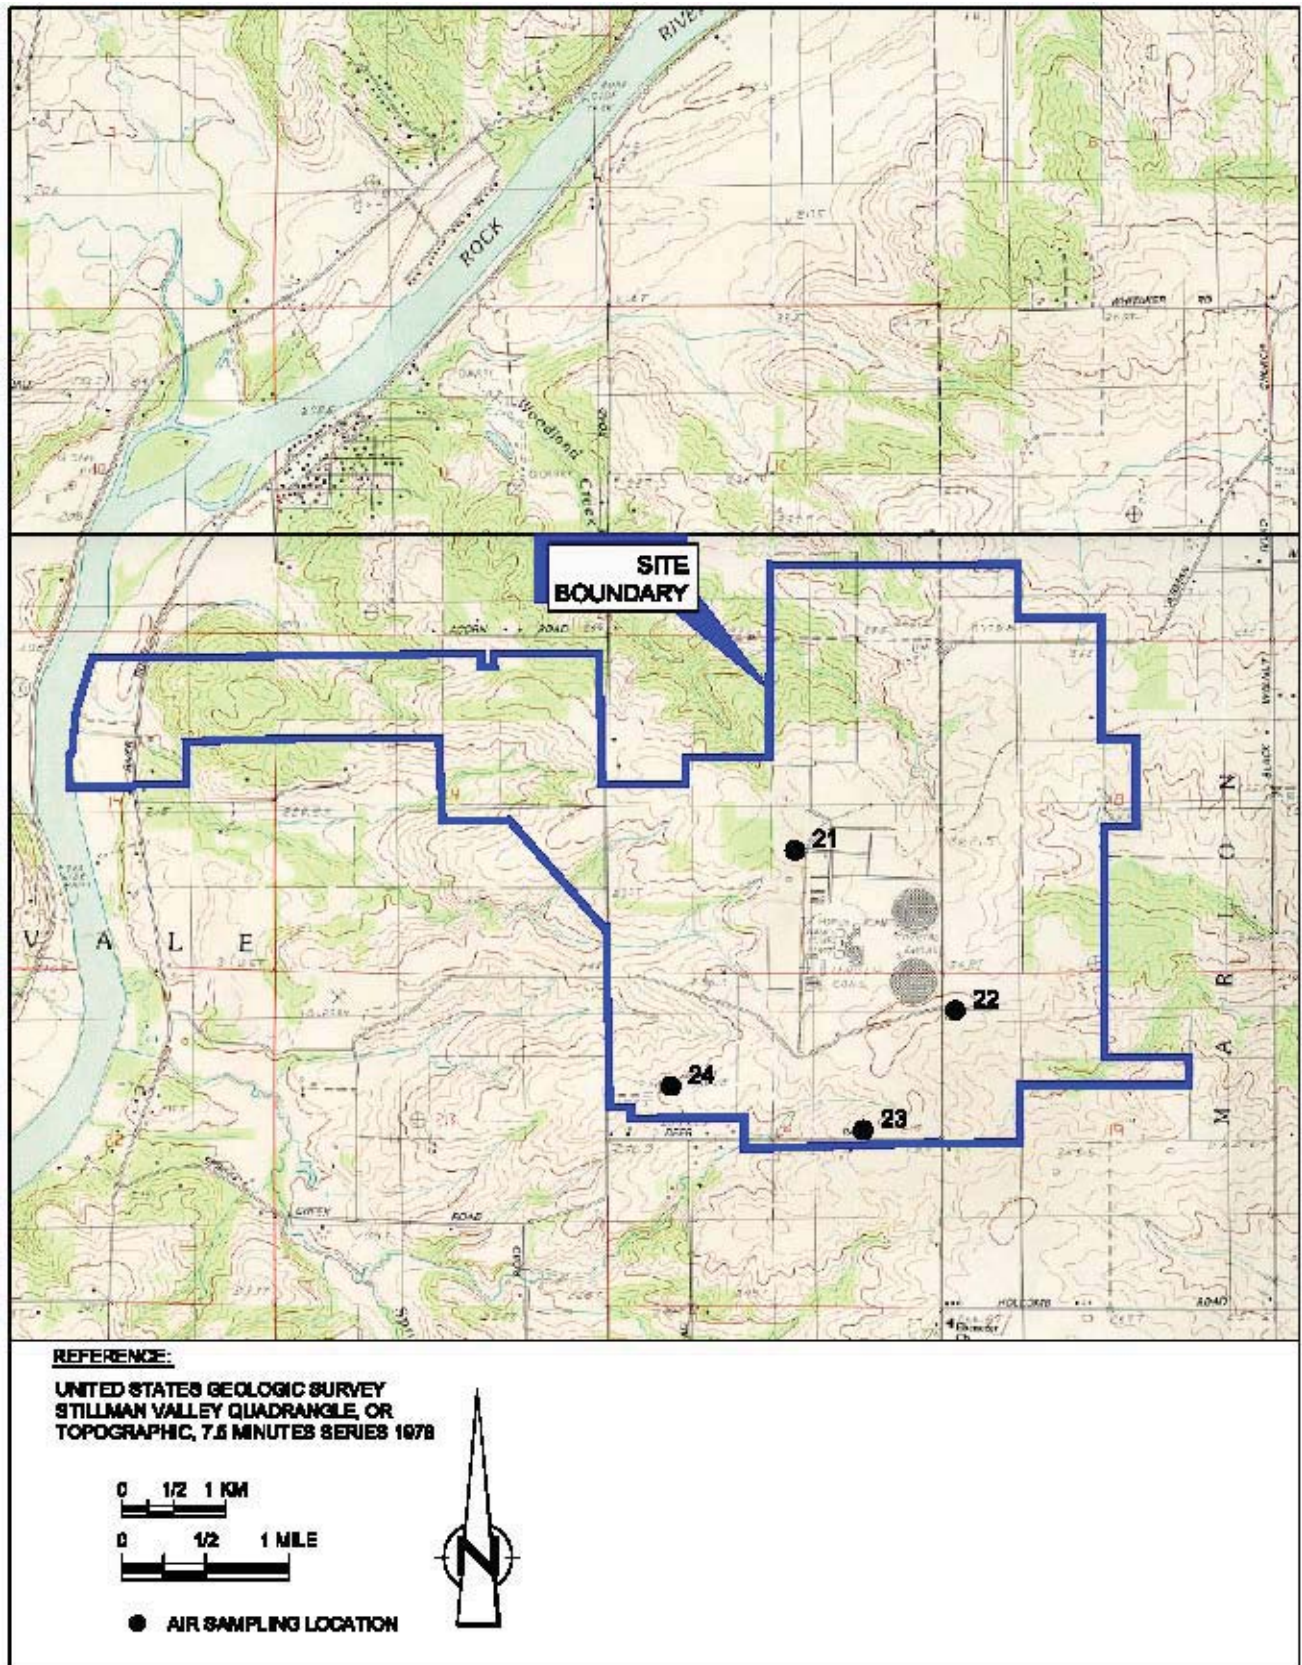


Figure B-2
 Onsite Air Sampling Locations of the
 Byron Nuclear Generating Station, 2012

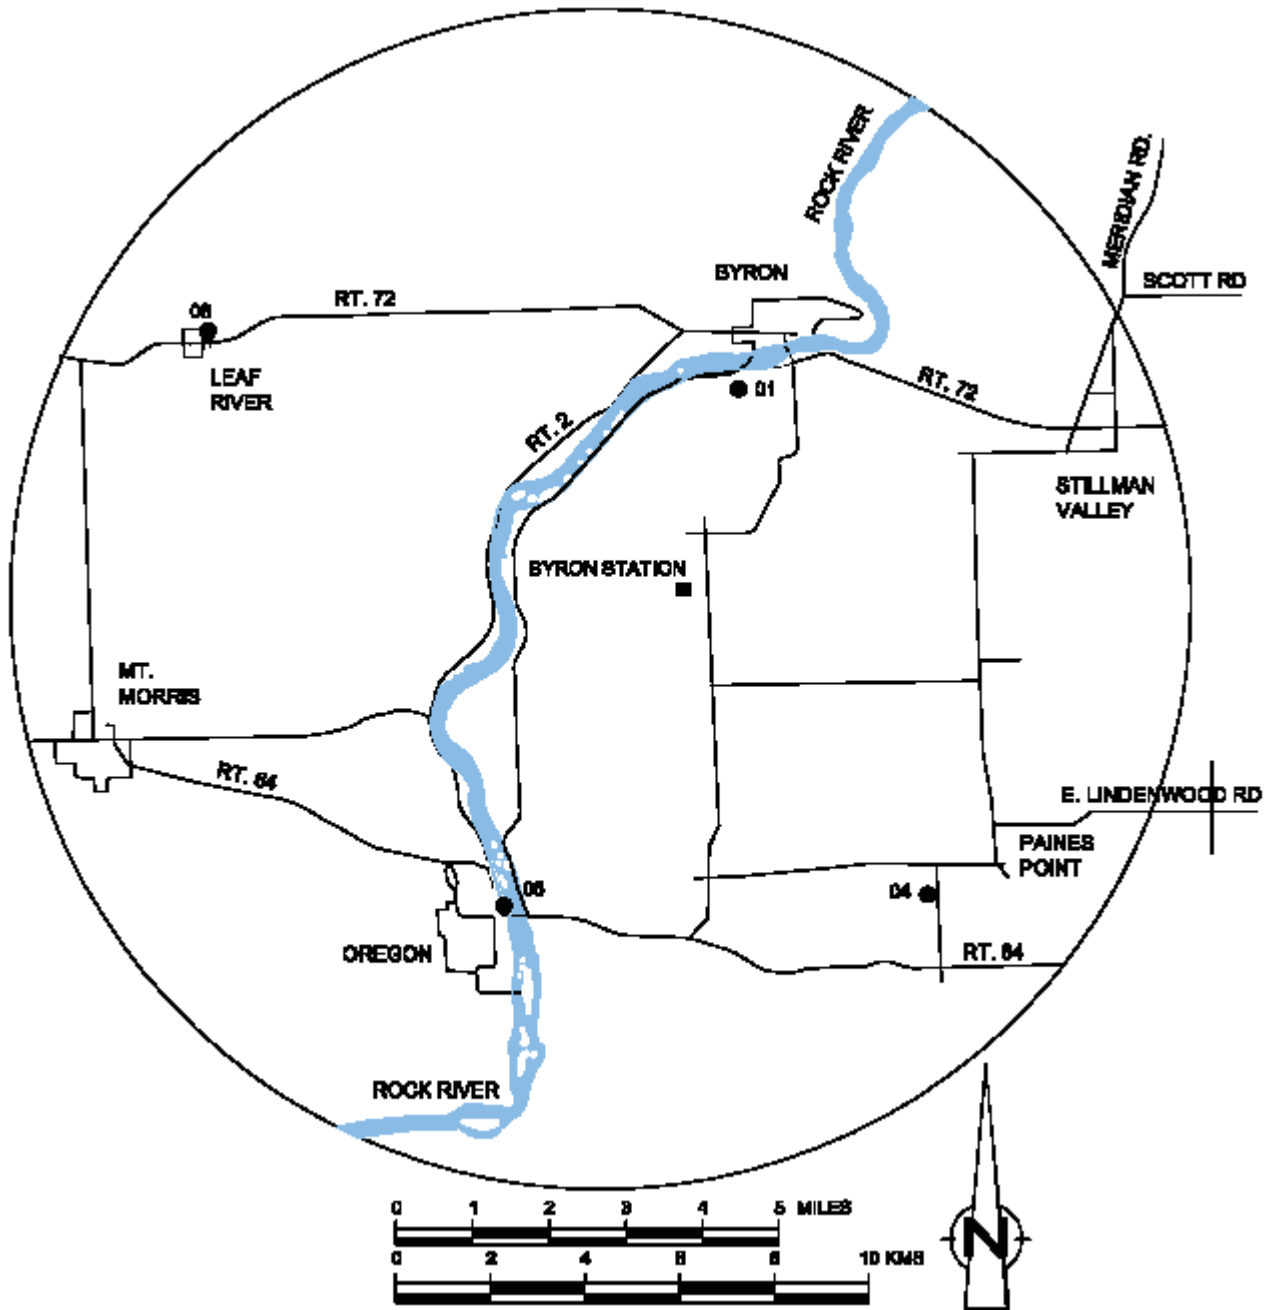

- Air Sampling Location
- Byron Station

Figure B-3
 Offsite Air Sampling Locations of the
 Byron Nuclear Generating Station, 2012

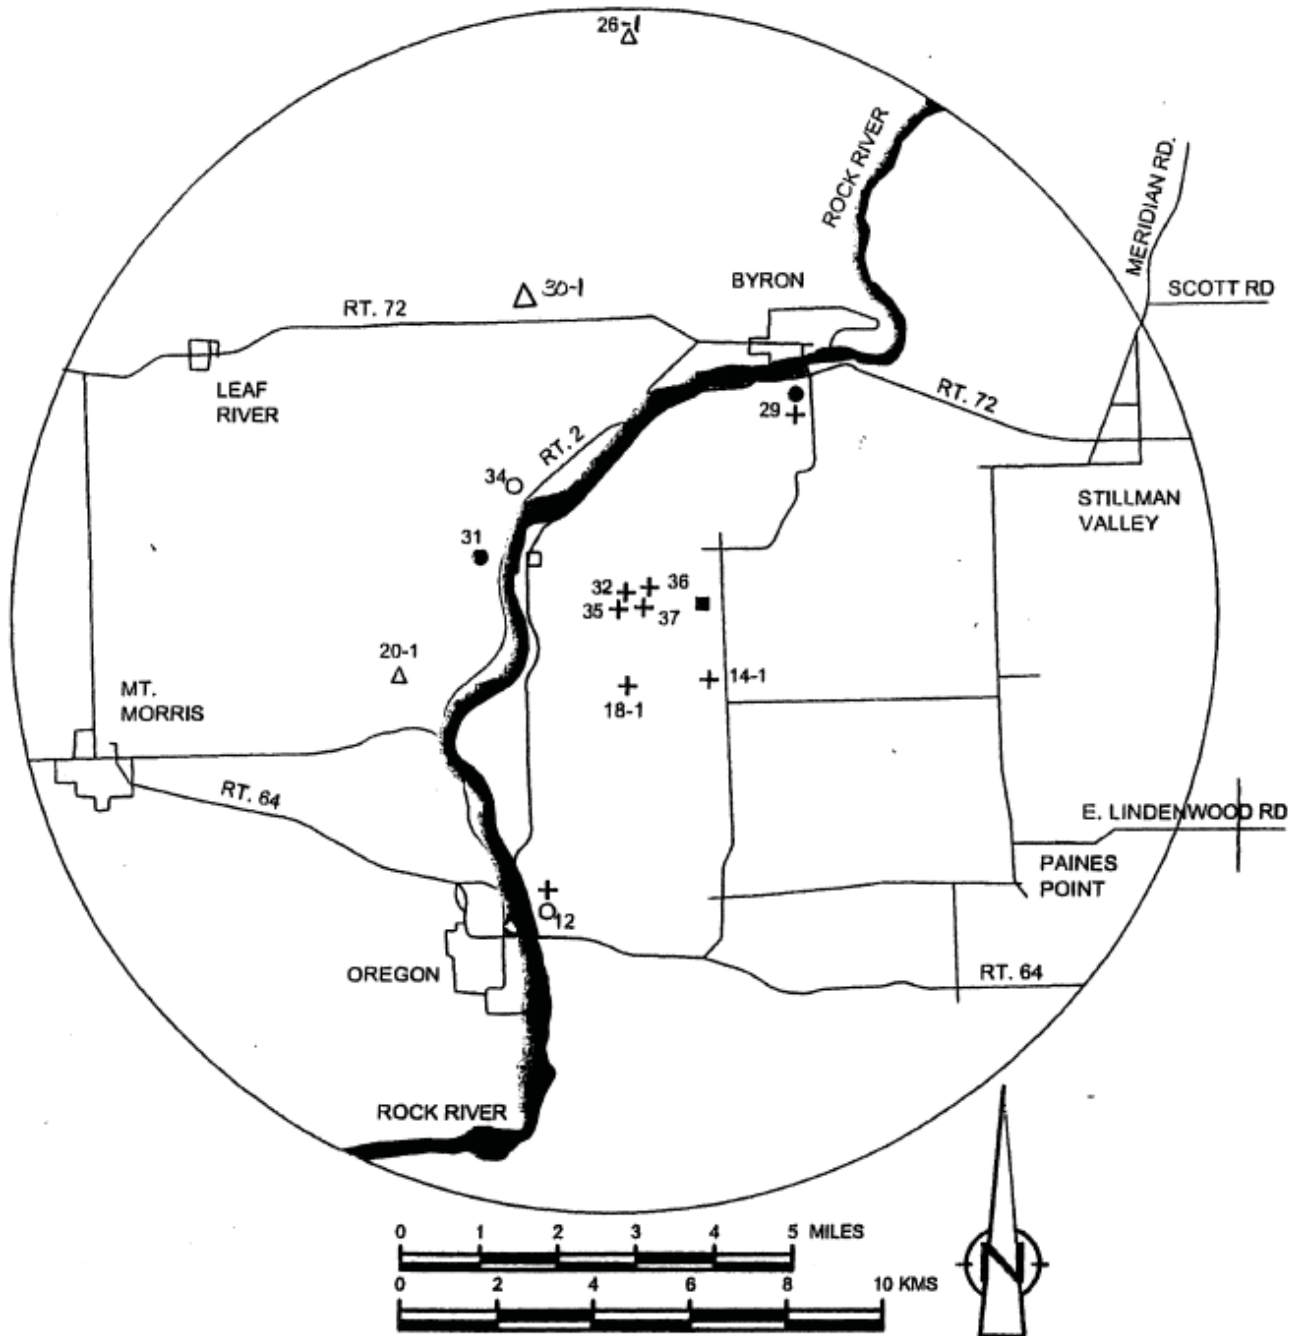

- FISH
- Δ MILK
- SEDIMENT
- + WATER
- BYRON STATION
- PLANT LIQUID DISCHARGE

OFFSITE DOSE CALCULATION MANUAL
BYRON STATION

FIGURE 6-4

INGESTION AND WATERBORNE EXPOSURE
PATHWAY SAMPLE LOCATIONS

Figure B-4
Ingestion and Waterborne Exposure Pathway Sampling Locations
of the Byron Nuclear Generating Station, 2012

APPENDIX C

DATA TABLES AND FIGURES PRIMARY LABORATORY

TABLE C-I.1**CONCENTRATIONS OF GROSS BETA IN SURFACE WATER SAMPLES
COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012**RESULTS IN UNITS OF PCI/LITER \pm 2 SIGMA

COLLECTION PERIOD	BY-12	BY-29
01/10/12 - 01/31/12 (1)	4.0 \pm 1.1 (1)	3.5 \pm 1.1
02/07/12 - 02/28/12 (1)	3.9 \pm 2.0 (1)	12.7 \pm 2.7
03/06/12 - 03/27/12	< 2.3	6.3 \pm 1.7
04/03/12 - 04/24/12	3.9 \pm 1.4	3.1 \pm 1.3
05/01/12 - 05/29/12	4.2 \pm 1.5	2.7 \pm 1.4
06/05/12 - 06/26/12	3.9 \pm 1.5	4.4 \pm 1.5
07/03/12 - 07/31/12	3.4 \pm 1.4	3.7 \pm 1.4
08/07/12 - 08/28/12	3.7 \pm 1.7	3.6 \pm 1.7
09/04/12 - 09/25/12	6.2 \pm 1.6	4.5 \pm 1.5
10/02/12 - 10/30/12	5.7 \pm 1.4	5.9 \pm 1.4
11/06/12 - 11/27/12	5.1 \pm 1.6	5.0 \pm 1.6
12/04/12 - 12/18/12 (1)	6.8 \pm 3.0 (1)	< 2.7
MEAN*	4.6 \pm 2.3	5.0 \pm 5.6

TABLE C-I.2**CONCENTRATIONS OF TRITIUM IN SURFACE WATER SAMPLES
COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012**RESULTS IN UNITS OF PCI/LITER \pm 2 SIGMA

COLLECTION PERIOD	BY-12	BY-29
01/10/12 - 03/27/12	2680 \pm 315	< 165
04/03/12 - 06/26/12	< 147	< 146
07/03/12 - 09/25/12	570 \pm 132	< 160
10/02/12 - 12/18/12	< 178	< 181
MEAN*	1625 \pm 2984	-

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES
(1) SEE PROGRAM EXCEPTIONS SECTION FOR EXPLANATION

TABLE C-1.3 CONCENTRATIONS OF GAMMA EMITTERS IN SURFACE WATER SAMPLES COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012

RESULTS IN UNITS OF PCI/LITER ± 2 SIGMA

SITE	COLLECTION PERIOD	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	I-131	Cs-134	Cs-137	Ba-140	La-140
BY-12	01/10/12 - 01/31/12	< 3	< 4	< 8	< 3	< 7	< 4	< 7	< 15	< 3	< 4	< 29	< 8
	02/07/12 - 02/28/12	< 3	< 3	< 7	< 3	< 6	< 4	< 6	< 15	< 3	< 3	< 26	< 9
	03/06/12 - 03/27/12	< 2	< 2	< 4	< 1	< 3	< 2	< 3	< 7	< 1	< 2	< 13	< 5
	04/03/12 - 04/24/12	< 2	< 2	< 5	< 2	< 3	< 2	< 3	< 7	< 2	< 2	< 15	< 5
	05/01/12 - 05/29/12	< 1	< 2	< 4	< 2	< 3	< 2	< 3	< 9	< 1	< 2	< 16	< 5
	06/05/12 - 06/26/12	< 1	< 1	< 4	< 1	< 3	< 2	< 3	< 14	< 1	< 1	< 21	< 6
	07/03/12 - 07/31/12	< 2	< 2	< 5	< 2	< 4	< 2	< 4	< 12	< 2	< 2	< 21	< 7
	08/07/12 - 08/28/12	< 2	< 2	< 5	< 2	< 4	< 2	< 4	< 9	< 2	< 2	< 18	< 6
	09/04/12 - 09/25/12	< 2	< 2	< 4	< 2	< 3	< 2	< 3	< 14	< 2	< 2	< 21	< 5
	10/02/12 - 10/30/12	< 2	< 2	< 4	< 2	< 3	< 2	< 3	< 11	< 2	< 2	< 20	< 6
	11/06/12 - 11/27/12	< 2	< 2	< 4	< 2	< 3	< 2	< 4	< 10	< 2	< 2	< 17	< 5
	12/04/12 - 12/18/12	< 1	< 2	< 4	< 1	< 3	< 2	< 3	< 13	< 1	< 2	< 19	< 5
MEAN		-	-	-	-	-	-	-	-	-	-	-	-
BY-29	01/10/12 - 01/31/12	< 3	< 4	< 8	< 4	< 8	< 4	< 7	< 15	< 4	< 4	< 28	< 10
	02/07/12 - 02/28/12	< 3	< 3	< 6	< 2	< 5	< 3	< 5	< 13	< 2	< 3	< 24	< 7
	03/06/12 - 03/27/12	< 2	< 2	< 4	< 2	< 3	< 2	< 3	< 6	< 1	< 2	< 14	< 4
	04/03/12 - 04/24/12	< 2	< 2	< 5	< 2	< 4	< 2	< 4	< 9	< 2	< 2	< 18	< 6
	05/01/12 - 05/29/12	< 2	< 2	< 4	< 2	< 4	< 2	< 3	< 11	< 2	< 2	< 18	< 5
	06/05/12 - 06/26/12	< 2	< 2	< 5	< 1	< 3	< 2	< 3	< 15	< 1	< 2	< 22	< 7
	07/03/12 - 07/31/12	< 2	< 2	< 5	< 2	< 4	< 2	< 4	< 14	< 2	< 2	< 22	< 7
	08/07/12 - 08/28/12	< 2	< 2	< 4	< 2	< 4	< 2	< 3	< 9	< 2	< 2	< 17	< 6
	09/04/12 - 09/25/12	< 2	< 2	< 4	< 2	< 4	< 2	< 3	< 14	< 2	< 2	< 21	< 6
	10/02/12 - 10/30/12	< 2	< 2	< 4	< 2	< 3	< 2	< 3	< 11	< 2	< 2	< 17	< 5
	11/06/12 - 11/27/12	< 2	< 2	< 4	< 2	< 4	< 2	< 3	< 8	< 2	< 2	< 15	< 5
	12/04/12 - 12/18/12	< 2	< 2	< 5	< 2	< 4	< 2	< 3	< 12	< 2	< 2	< 21	< 7
MEAN		-	-	-	-	-	-	-	-	-	-	-	

**TABLE C-II.1 CONCENTRATIONS OF TRITIUM IN GROUND WATER SAMPLES
COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012**

RESULTS IN UNITS OF PCI/LITER ± 2 SIGMA

COLLECTION PERIOD	BY-14-1	BY-18-1	BY-32	BY-35	BY-36	BY-37
01/10/12 - 01/10/12	< 169	< 166	< 170	< 167	< 166	< 169
04/10/12 - 04/10/12	< 167	< 167	< 168	< 166	< 166	< 165
07/10/12 - 07/10/12	< 188	< 185	< 182	< 149	< 149	< 147
10/09/12 - 10/09/12	< 164	< 159	< 155	< 178	< 158	< 162
MEAN	-	-	-	-	-	-

TABLE C-II.2 **CONCENTRATIONS OF GAMMA EMITTERS IN GROUND WATER SAMPLES COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012**

RESULTS IN UNITS OF PCI/LITER ± 2 SIGMA

SITE	COLLECTION PERIOD	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	I-131	Cs-134	Cs-137	Ba-140	La-140
BY-14-1	01/10/12 - 01/10/12	< 8	< 7	< 14	< 9	< 18	< 9	< 14	< 11	< 7	< 8	< 33	< 14
	04/10/12 - 04/10/12	< 3	< 3	< 6	< 3	< 7	< 4	< 6	< 5	< 3	< 3	< 13	< 6
	07/10/12 - 07/10/12	< 4	< 5	< 9	< 6	< 10	< 5	< 11	< 10	< 5	< 6	< 27	< 8
	10/09/12 - 10/09/12	< 4	< 4	< 9	< 4	< 10	< 6	< 6	< 8	< 4	< 4	< 21	< 8
MEAN	-	-	-	-	-	-	-	-	-	-	-	-	-
BY-18-1	01/10/12 - 01/10/12	< 6	< 8	< 13	< 7	< 13	< 7	< 11	< 9	< 6	< 7	< 30	< 9
	04/10/12 - 04/10/12	< 4	< 4	< 10	< 4	< 8	< 4	< 7	< 9	< 4	< 4	< 20	< 6
	07/10/12 - 07/10/12	< 5	< 5	< 13	< 5	< 9	< 7	< 9	< 9	< 5	< 6	< 30	< 8
	10/09/12 - 10/09/12	< 6	< 5	< 11	< 5	< 12	< 6	< 10	< 9	< 5	< 5	< 25	< 8
MEAN	-	-	-	-	-	-	-	-	-	-	-	-	-
BY-32	01/10/12 - 01/10/12	< 9	< 8	< 16	< 8	< 13	< 9	< 13	< 13	< 7	< 9	< 27	< 14
	04/10/12 - 04/10/12	< 5	< 5	< 8	< 5	< 8	< 5	< 9	< 7	< 4	< 5	< 22	< 7
	07/10/12 - 07/10/12	< 5	< 6	< 9	< 4	< 9	< 5	< 8	< 9	< 4	< 5	< 21	< 7
	10/09/12 - 10/09/12	< 6	< 6	< 15	< 8	< 11	< 6	< 12	< 12	< 5	< 6	< 29	< 10
MEAN	-	-	-	-	-	-	-	-	-	-	-	-	-
BY-35	01/10/12 - 01/10/12	< 7	< 5	< 12	< 6	< 14	< 5	< 11	< 9	< 6	< 7	< 29	< 8
	04/10/12 - 04/10/12	< 4	< 4	< 8	< 5	< 9	< 4	< 8	< 6	< 4	< 5	< 17	< 6
	07/10/12 - 07/10/12	< 5	< 6	< 9	< 6	< 11	< 6	< 7	< 10	< 5	< 5	< 27	< 8
	10/09/12 - 10/09/12	< 6	< 5	< 9	< 6	< 10	< 6	< 10	< 10	< 5	< 6	< 27	< 9
MEAN	-	-	-	-	-	-	-	-	-	-	-	-	-
BY-36	01/10/12 - 01/10/12	< 7	< 6	< 9	< 7	< 17	< 6	< 12	< 13	< 6	< 6	< 32	< 9
	04/10/12 - 04/10/12	< 4	< 4	< 8	< 4	< 6	< 4	< 7	< 6	< 4	< 4	< 18	< 5
	07/10/12 - 07/10/12	< 6	< 5	< 12	< 5	< 9	< 5	< 9	< 8	< 5	< 5	< 25	< 8
	10/09/12 - 10/09/12	< 5	< 5	< 11	< 6	< 11	< 6	< 10	< 9	< 5	< 5	< 27	< 12
MEAN	-	-	-	-	-	-	-	-	-	-	-	-	-

**TABLE C-II.2
CONCENTRATIONS OF GAMMA EMITTERS IN GROUND WATER SAMPLES
COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012**

RESULTS IN UNITS OF PCI/LITER ± 2 SIGMA

SITE	COLLECTION PERIOD	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	I-131	Cs-134	Cs-137	Ba-140	La-140
BY-37	01/10/12 - 01/10/12	< 5	< 6	< 13	< 9	< 16	< 7	< 11	< 9	< 5	< 9	< 32	< 10
	04/10/12 - 04/10/12	< 3	< 3	< 7	< 3	< 5	< 3	< 4	< 4	< 3	< 3	< 14	< 4
	07/10/12 - 07/10/12	< 5	< 5	< 10	< 5	< 10	< 5	< 9	< 10	< 5	< 5	< 26	< 8
	10/09/12 - 10/09/12	< 5	< 6	< 11	< 5	< 11	< 7	< 10	< 9	< 5	< 6	< 28	< 9
	MEAN	-	-	-	-	-	-	-	-	-	-	-	-

TABLE C-III.1

CONCENTRATIONS OF GAMMA EMITTERS IN FISH SAMPLES
COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012

RESULTS IN UNITS OF PCI/KG WET ± 2 SIGMA

SITE	COLLECTION PERIOD	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
BY-29												
Quillback	05/15/12	< 42	< 45	< 74	< 51	< 92	< 49	< 94	< 44	< 44	< 384	< 95
Shorthead Redhorse	05/15/12	< 50	< 59	< 132	< 43	< 104	< 59	< 121	< 58	< 62	< 438	< 60
Freshwater Drum	10/24/12	< 64	< 69	< 145	< 68	< 136	< 77	< 113	< 61	< 62	< 530	< 146
Shorthead Redhorse	10/24/12	< 59	< 53	< 156	< 53	< 119	< 59	< 113	< 53	< 53	< 431	< 108
	MEAN	-	-	-	-	-	-	-	-	-	-	-
BY-31												
Common Carp	05/15/12	< 50	< 60	< 144	< 67	< 114	< 49	< 107	< 49	< 50	< 423	< 99
Quillback	05/15/12	< 60	< 65	< 138	< 60	< 111	< 55	< 110	< 54	< 53	< 496	< 87
Freshwater Drum	10/24/12	< 76	< 77	< 191	< 66	< 158	< 80	< 155	< 75	< 87	< 635	< 132
Quillback	10/24/12	< 59	< 53	< 127	< 58	< 124	< 61	< 90	< 54	< 62	< 402	< 114
	MEAN	-	-	-	-	-	-	-	-	-	-	-

TABLE C-IV.1 CONCENTRATIONS OF GAMMA EMITTERS IN SEDIMENT SAMPLES COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012

RESULTS IN UNITS OF PCI/KG DRY ± 2 SIGMA

SITE	COLLECTION PERIOD	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
BY-12	05/22/12	< 63	< 57	< 116	< 59	< 115	< 54	< 92	< 45	196 ± 66	< 278	< 93
	10/23/12	< 54	< 45	< 102	< 47	< 93	< 48	< 87	< 46	< 60	< 229	< 60
	MEAN	-	-	-	-	-	-	-	-	-	-	-
BY-34	05/22/12	< 47	< 45	< 85	< 46	< 82	< 42	< 88	< 37	64 ± 43	< 297	< 62
	10/23/12	< 63	< 59	< 116	< 70	< 145	< 75	< 106	< 68	< 84	< 358	< 87
	MEAN	-	-	-	-	-	-	-	-	-	-	-

TABLE C-V.1 CONCENTRATIONS OF GROSS BETA IN AIR PARTICULATE SAMPLES COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012

RESULTS IN UNITS OF E-3 PCI/CU METER ± 2 SIGMA

COLLECTION PERIOD	GROUP I				GROUP II			GROUP III
	BY-21	BY-22	BY-23	BY-24	BY-01	BY-04	BY-06	BY-08
12/27/11 - 01/03/12	19 ± 4	18 ± 4	22 ± 4	23 ± 5	17 ± 4	22 ± 4	21 ± 4	19 ± 4
01/03/12 - 01/10/12	13 ± 5	13 ± 5	12 ± 5	16 ± 5	13 ± 4	12 ± 5	18 ± 5	13 ± 4
01/10/12 - 01/18/12	23 ± 4	16 ± 4	21 ± 4	20 ± 4	15 ± 4	23 ± 4	25 ± 5	24 ± 4
01/18/12 - 01/24/12	23 ± 5	18 ± 5	28 ± 5	18 ± 5	16 ± 4	22 ± 5	20 ± 5	20 ± 5
01/24/12 - 01/31/12	21 ± 5	20 ± 5	25 ± 5	25 ± 5	27 ± 6	24 ± 5	21 ± 5	25 ± 5
01/31/12 - 02/07/12	19 ± 4	21 ± 4	17 ± 4	19 ± 4	22 ± 4	20 ± 4	21 ± 4	21 ± 4
02/07/12 - 02/14/12	15 ± 4	14 ± 4	18 ± 4	17 ± 4	17 ± 4	18 ± 4	19 ± 4	16 ± 4
02/14/12 - 02/21/12	20 ± 5	17 ± 4	17 ± 4	21 ± 5	16 ± 4	19 ± 4	25 ± 5	19 ± 4
02/21/12 - 02/28/12	21 ± 5	20 ± 5	22 ± 5	24 ± 5	15 ± 5	19 ± 5	18 ± 5	20 ± 5
02/28/12 - 03/06/12	18 ± 4	17 ± 4	15 ± 4	15 ± 4	15 ± 4	17 ± 4	13 ± 4	17 ± 4
03/06/12 - 03/13/12	16 ± 4	21 ± 4	19 ± 4	18 ± 4	17 ± 4	19 ± 4	26 ± 5	15 ± 4
03/13/12 - 03/20/12	19 ± 4	17 ± 4	18 ± 4	18 ± 4	15 ± 4	20 ± 4	12 ± 4	18 ± 4
03/20/12 - 03/27/12	18 ± 5	14 ± 5	13 ± 5	17 ± 5	15 ± 5	14 ± 4	14 ± 4	13 ± 4
03/27/12 - 04/03/12 (1)	10 ± 4	12 ± 4	10 ± 4	16 ± 4	10 ± 4	10 ± 4	14 ± 4	8 ± 4
04/03/12 - 04/10/12	14 ± 5	12 ± 4	12 ± 5	11 ± 4	15 ± 5	12 ± 4	17 ± 5	15 ± 5
04/10/12 - 04/17/12	10 ± 4	13 ± 4	13 ± 4	11 ± 4	10 ± 4	16 ± 5	12 ± 4	8 ± 4
04/17/12 - 04/24/12	13 ± 4	16 ± 4	15 ± 4	19 ± 4	16 ± 4	15 ± 4	14 ± 4	16 ± 4
04/24/12 - 05/01/12	16 ± 4	17 ± 4	19 ± 4	16 ± 4	18 ± 4	16 ± 4	22 ± 5	14 ± 4
05/01/12 - 05/08/12	11 ± 4	12 ± 5	10 ± 4	12 ± 4	14 ± 5	11 ± 4	9 ± 4	11 ± 4
05/08/12 - 05/15/12	14 ± 4	15 ± 4	(1) 15 ± 4	15 ± 4	14 ± 4	13 ± 4	15 ± 4	18 ± 4
05/15/12 - 05/22/12	16 ± 4	13 ± 4	16 ± 4	17 ± 4	20 ± 5	18 ± 4	19 ± 4	14 ± 4
05/22/12 - 05/29/12	17 ± 4	14 ± 4	20 ± 5	17 ± 4	17 ± 4	18 ± 4	19 ± 4	12 ± 4
05/29/12 - 06/05/12	13 ± 4	9 ± 4	10 ± 4	10 ± 4	13 ± 4	12 ± 4	11 ± 4	12 ± 4
06/05/12 - 06/12/12	14 ± 4	16 ± 4	18 ± 4	18 ± 4	15 ± 4	14 ± 4	15 ± 4	15 ± 4
06/12/12 - 06/19/12	17 ± 4	14 ± 4	17 ± 4	16 ± 4	17 ± 4	14 ± 4	15 ± 4	22 ± 5
06/19/12 - 06/26/12 (1)	14 ± 4	14 ± 4	11 ± 4	17 ± 4	15 ± 4	10 ± 4	11 ± 4	16 ± 4
06/26/12 - 07/03/12	25 ± 5	26 ± 5	33 ± 6	27 ± 5	28 ± 5	29 ± 5	21 ± 5	28 ± 5
07/03/12 - 07/10/12	18 ± 4	24 ± 5	23 ± 5	17 ± 4	20 ± 4	20 ± 4	23 ± 5	25 ± 5
07/10/12 - 07/17/12 (1)	22 ± 5	26 ± 5	30 ± 5	21 ± 4	24 ± 4	24 ± 5	30 ± 5	31 ± 5
07/17/12 - 07/24/12	10 ± 4	18 ± 5	14 ± 4	19 ± 5	17 ± 5	19 ± 5	15 ± 5	18 ± 5
07/24/12 - 07/31/12	17 ± 4	16 ± 4	20 ± 5	19 ± 4	24 ± 5	19 ± 4	19 ± 4	20 ± 4
07/31/12 - 08/07/12	17 ± 4	19 ± 4	17 ± 4	21 ± 4	22 ± 5	19 ± 4	18 ± 4	24 ± 5
08/07/12 - 08/14/12	17 ± 4	16 ± 4	15 ± 4	18 ± 4	22 ± 4	15 ± 4	19 ± 4	20 ± 4
08/14/12 - 08/21/12	20 ± 4	22 ± 4	18 ± 4	20 ± 4	22 ± 4	14 ± 4	19 ± 4	21 ± 4
08/21/12 - 08/28/12	26 ± 5	28 ± 5	35 ± 6	29 ± 5	31 ± 5	24 ± 5	31 ± 5	31 ± 5
08/28/12 - 09/04/12	24 ± 5	24 ± 5	29 ± 5	24 ± 5	20 ± 5	27 ± 5	26 ± 5	29 ± 5
09/04/12 - 09/11/12	21 ± 5	20 ± 5	20 ± 5	18 ± 5	24 ± 5	22 ± 5	18 ± 5	22 ± 5
09/11/12 - 09/18/12	24 ± 5	19 ± 4	22 ± 5	27 ± 5	26 ± 5	24 ± 5	26 ± 5	27 ± 5
09/18/12 - 09/25/12	16 ± 5	15 ± 5	20 ± 5	16 ± 5	16 ± 4	16 ± 5	18 ± 5	20 ± 5
09/25/12 - 10/02/12	19 ± 5	21 ± 5	26 ± 5	23 ± 5	22 ± 5	24 ± 5	24 ± 5	31 ± 5
10/02/12 - 10/09/12	22 ± 5	20 ± 5	23 ± 5	25 ± 5	21 ± 5	21 ± 5	26 ± 5	25 ± 5
10/09/12 - 10/16/12	17 ± 4	23 ± 5	22 ± 5	21 ± 5	22 ± 5	20 ± 5	19 ± 4	18 ± 4
10/16/12 - 10/23/12	22 ± 4	20 ± 4	24 ± 5	24 ± 5	22 ± 4	(1) 23 ± 4	21 ± 4	22 ± 4
10/23/12 - 10/30/12	18 ± 4	14 ± 4	20 ± 5	22 ± 5	19 ± 5	13 ± 4	13 ± 4	18 ± 5
10/30/12 - 11/06/12	16 ± 4	20 ± 5	17 ± 4	18 ± 4	20 ± 5	16 ± 4	21 ± 5	21 ± 5
11/06/12 - 11/13/12	23 ± 5	22 ± 5	25 ± 5	27 ± 5	22 ± 5	20 ± 5	22 ± 5	21 ± 5
11/13/12 - 11/20/12	37 ± 6	32 ± 5	34 ± 6	39 ± 6	43 ± 6	41 ± 6	40 ± 6	44 ± 6
11/20/12 - 11/27/12	38 ± 5	35 ± 5	38 ± 5	34 ± 5	36 ± 5	34 ± 5	36 ± 5	35 ± 5
11/27/12 - 12/04/12	34 ± 6	38 ± 6	30 ± 6	32 ± 6	37 ± 6	36 ± 6	42 ± 6	37 ± 6
12/04/12 - 12/11/12	23 ± 5	21 ± 5	16 ± 4	17 ± 4	21 ± 5	18 ± 5	20 ± 5	19 ± 5
12/11/12 - 12/18/12	31 ± 5	33 ± 5	28 ± 5	37 ± 5	35 ± 5	35 ± 5	34 ± 5	37 ± 5
12/18/12 - 12/26/12	23 ± 4	23 ± 4	23 ± 4	28 ± 5	28 ± 5	20 ± 4	26 ± 5	24 ± 4
12/26/12 - 01/02/13	35 ± 5	34 ± 5	38 ± 5	40 ± 5	40 ± 5	37 ± 5	36 ± 5	41 ± 6
MEAN*	20 ± 13	19 ± 13	21 ± 14	21 ± 13	21 ± 15	20 ± 14	21 ± 15	21 ± 16

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES

(1) SEE PROGRAM EXCEPTIONS SECTION FOR EXPLANATION

TABLE C-V.2 MONTHLY AND YEARLY MEAN VALUES OF GROSS BETA CONCENTRATIONS IN AIR PARTICULATE SAMPLES COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012
RESULTS IN UNITS OF E-3 PCI/CU METER ± 2 SIGMA

GROUP I - NEARSITE LOCATIONS					GROUP II - FAR FIELD LOCATIONS					GROUP III - CONTROL LOCATIONS				
COLLECTION PERIOD	MIN	MAX	MEAN ± 2SD		COLLECTION PERIOD	MIN	MAX	MEAN ± 2SD		COLLECTION PERIOD	MIN	MAX	MEAN ± 2SD	
12/27/11 - 01/31/12	12	28	20 ± 8		12/27/11 - 01/31/12	12	27	20 ± 9		12/27/11 - 01/31/12	13	25	20 ± 10	
01/31/12 - 02/28/12	14	24	19 ± 6		01/31/12 - 02/28/12	15	25	19 ± 6		01/31/12 - 02/28/12	16	21	19 ± 4	
02/28/12 - 04/03/12	10	21	16 ± 6		02/28/12 - 04/03/12	10	26	16 ± 8		02/28/12 - 04/03/12	8	18	14 ± 8	
04/03/12 - 05/01/12	10	19	14 ± 6		04/03/12 - 05/01/12	10	22	15 ± 7		04/03/12 - 05/01/12	8	16	13 ± 7	
05/01/12 - 05/29/12	10	20	15 ± 5		05/01/12 - 05/29/12	9	20	15 ± 7		05/01/12 - 05/29/12	11	18	14 ± 7	
05/29/12 - 07/03/12	9	33	17 ± 13		05/29/12 - 07/03/12	10	29	16 ± 12		05/29/12 - 07/03/12	12	28	18 ± 13	
07/03/12 - 07/31/12	10	30	20 ± 9		07/03/12 - 07/31/12	15	30	21 ± 8		07/03/12 - 07/31/12	18	31	23 ± 11	
07/31/12 - 09/04/12	15	35	22 ± 11		07/31/12 - 09/04/12	14	31	22 ± 11		07/31/12 - 09/04/12	20	31	25 ± 10	
09/04/12 - 10/02/12	15	27	20 ± 7		09/04/12 - 10/02/12	16	26	21 ± 7		09/04/12 - 10/02/12	20	31	25 ± 10	
10/02/12 - 10/30/12	14	25	21 ± 6		10/02/12 - 10/30/12	13	26	20 ± 8		10/02/12 - 10/30/12	18	25	21 ± 7	
10/30/12 - 12/04/12	16	39	29 ± 16		10/30/12 - 12/04/12	16	43	31 ± 19		10/30/12 - 12/04/12	21	44	32 ± 20	
12/04/12 - 01/02/13	16	40	28 ± 15		12/04/12 - 01/02/13	18	40	29 ± 16		12/04/12 - 01/02/13	19	41	30 ± 21	
12/27/11 - 01/02/13	9	40	20 ± 13		12/27/11 - 01/02/13	9	43	20 ± 14		12/27/11 - 01/02/13	8	44	21 ± 16	

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES

TABLE C-V.3

**CONCENTRATIONS OF GAMMA EMITTERS IN AIR PARTICULATE SAMPLES
COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012**

RESULTS IN UNITS OF E-3 PCI/CU METER ± 2 SIGMA

SITE	COLLECTION PERIOD	Min-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
BY-01	12/27/11 - 04/03/12	< 3	< 4	< 14	< 4	< 6	< 5	< 8	< 3	< 2	< 291	< 64
	04/03/12 - 07/03/12	< 4	< 5	< 17	< 2	< 8	< 5	< 10	< 3	< 2	< 414	< 185
	07/03/12 - 10/02/12	< 4	< 6	< 15	< 2	< 7	< 6	< 10	< 3	< 2	< 1290	< 379
	10/02/12 - 01/02/13	< 3	< 4	< 12	< 2	< 6	< 4	< 6	< 2	< 2	< 305	< 139
	MEAN	-	-	-	-	-	-	-	-	-	-	-
BY-04	12/27/11 - 04/03/12	< 3	< 5	< 11	< 3	< 7	< 5	< 8	< 3	< 2	< 261	< 107
	04/03/12 - 07/03/12	< 3	< 5	< 11	< 3	< 10	< 6	< 8	< 4	< 3	< 491	< 172
	07/03/12 - 10/02/12	< 4	< 5	< 19	< 2	< 11	< 6	< 10	< 3	< 3	< 1147	< 677
	10/02/12 - 01/02/13	< 3	< 5	< 14	< 3	< 7	< 6	< 11	< 3	< 3	< 543	< 194
	MEAN	-	-	-	-	-	-	-	-	-	-	-
BY-06	12/27/11 - 04/03/12	< 3	< 6	< 17	< 3	< 7	< 5	< 9	< 4	< 2	< 375	< 83
	04/03/12 - 07/03/12	< 3	< 5	< 16	< 3	< 9	< 6	< 7	< 3	< 3	< 465	< 186
	07/03/12 - 10/02/12	< 4	< 7	< 22	< 3	< 11	< 9	< 13	< 5	< 4	< 1811	< 594
	10/02/12 - 01/02/13	< 3	< 5	< 12	< 2	< 6	< 5	< 9	< 3	< 2	< 431	< 182
	MEAN	-	-	-	-	-	-	-	-	-	-	-
BY-08	12/27/11 - 04/03/12	< 3	< 5	< 17	< 2	< 7	< 5	< 8	< 3	< 2	< 248	< 147
	04/03/12 - 07/03/12	< 3	< 6	< 17	< 3	< 11	< 6	< 9	< 4	< 3	< 537	< 197
	07/03/12 - 10/02/12	< 3	< 5	< 12	< 2	< 6	< 6	< 10	< 3	< 3	< 827	< 449
	10/02/12 - 01/02/13	< 3	< 4	< 15	< 2	< 5	< 5	< 6	< 2	< 2	< 412	< 176
	MEAN	-	-	-	-	-	-	-	-	-	-	-

TABLE C-V.3

**CONCENTRATIONS OF GAMMA EMITTERS IN AIR PARTICULATE SAMPLES
COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012**

RESULTS IN UNITS OF E-3 PCI/CU METER ± 2 SIGMA

SITE	COLLECTION PERIOD	Min-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
BY-21	12/27/11 - 04/03/12	< 3	< 4	< 13	< 3	< 8	< 5	< 10	< 3	< 2	< 264	< 62
	04/03/12 - 07/03/12	< 2	< 4	< 8	< 2	< 6	< 5	< 9	< 2	< 2	< 337	< 123
	07/03/12 - 10/02/12	< 4	< 6	< 15	< 2	< 9	< 5	< 11	< 3	< 2	< 1021	< 314
	10/02/12 - 01/02/13	< 3	< 4	< 14	< 2	< 8	< 5	< 8	< 3	< 3	< 363	< 148
	MEAN	-	-	-	-	-	-	-	-	-	-	-
BY-22	12/27/11 - 04/03/12	< 3	< 4	< 9	< 2	< 7	< 4	< 6	< 3	< 3	< 254	< 93
	04/03/12 - 07/03/12	< 3	< 5	< 17	< 3	< 8	< 5	< 8	< 4	< 2	< 350	< 156
	07/03/12 - 10/02/12	< 2	< 6	< 21	< 4	< 9	< 5	< 11	< 3	< 2	< 922	< 439
	10/02/12 - 01/02/13	< 2	< 4	< 15	< 2	< 5	< 5	< 6	< 2	< 2	< 335	< 115
	MEAN	-	-	-	-	-	-	-	-	-	-	-
BY-23	12/27/11 - 04/03/12	< 3	< 5	< 16	< 2	< 6	< 5	< 9	< 3	< 3	< 323	< 106
	04/03/12 - 07/03/12	< 3	< 5	< 11	< 2	< 10	< 7	< 8	< 4	< 3	< 472	< 155
	07/03/12 - 10/02/12	< 2	< 4	< 16	< 2	< 9	< 4	< 6	< 3	< 2	< 1062	< 342
	10/02/12 - 01/02/13	< 3	< 4	< 15	< 3	< 8	< 5	< 8	< 3	< 2	< 420	< 206
	MEAN	-	-	-	-	-	-	-	-	-	-	-
BY-24	12/27/11 - 04/03/12	< 3	< 4	< 14	< 2	< 8	< 4	< 9	< 3	< 2	< 270	< 118
	04/03/12 - 07/03/12	< 4	< 7	< 21	< 4	< 9	< 7	< 12	< 4	< 3	< 512	< 121
	07/03/12 - 10/02/12	< 3	< 6	< 18	< 3	< 7	< 7	< 14	< 2	< 2	< 1308	< 400
	10/02/12 - 01/02/13	< 2	< 5	< 15	< 3	< 7	< 5	< 8	< 3	< 2	< 368	< 165
	MEAN	-	-	-	-	-	-	-	-	-	-	-

TABLE C-VI.1 CONCENTRATIONS OF I-131 IN AIR IODINE SAMPLES COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012

RESULTS IN UNITS OF E-3 PCI/CU METER ± 2 SIGMA

COLLECTION PERIOD	GROUP I				GROUP II			GROUP III
	BY-21	BY-22	BY-23	BY-24	BY-01	BY-04	BY-06	BY-08
12/27/11 - 01/03/12	< 53	< 53	< 53	< 52	< 44	< 43	< 44	< 45
01/03/12 - 01/10/12	< 34	< 34	< 34	< 19	< 9	< 10	< 9	< 9
01/10/12 - 01/18/12	< 33	< 33	< 33	< 33	< 33	< 32	< 33	< 32
01/18/12 - 01/24/12	< 29	< 40	< 40	< 40	< 47	< 47	< 47	< 46
01/24/12 - 01/31/12	< 55	< 55	< 54	< 54	< 69	< 68	< 69	< 68
01/31/12 - 02/07/12	< 69	< 33	< 69	< 69	< 45	< 45	< 45	< 46
02/07/12 - 02/14/12	< 66	< 65	< 66	< 66	< 66	< 65	< 66	< 69
02/14/12 - 02/21/12	< 42	< 42	< 18	< 42	< 35	< 36	< 35	< 35
02/21/12 - 02/28/12	< 44	< 44	< 44	< 44	< 52	< 50	< 50	< 51
02/28/12 - 03/06/12	< 59	< 59	< 60	< 33	< 45	< 45	< 46	< 46
03/06/12 - 03/13/12	< 31	< 30	< 31	< 31	< 39	< 38	< 38	< 37
03/13/12 - 03/20/12	< 43	< 43	< 42	< 42	< 38	< 39	< 39	< 38
03/20/12 - 03/27/12	< 48	< 48	< 48	< 48	< 55	< 54	< 54	< 54
03/27/12 - 04/03/12	< 35 (1)	< 34	< 34	< 34	< 45	< 15	< 45	< 46
04/03/12 - 04/10/12	< 52	< 52	< 53	< 53	< 45	< 46	< 47	< 46
04/10/12 - 04/17/12	< 42	< 42	< 42	< 42	< 67	< 67	< 28	< 68
04/17/12 - 04/24/12	< 60	< 60	< 60	< 60	< 41	< 41	< 41	< 40
04/24/12 - 05/01/12	< 34	< 34	< 35	< 35	< 46	< 45	< 46	< 18
05/01/12 - 05/08/12	< 51	< 50	< 51	< 51	< 62	< 64	< 63	< 61
05/08/12 - 05/15/12	< 35	< 27	< 27 (1)	< 27	< 61	< 59	< 60	< 62
05/15/12 - 05/22/12	< 57	< 57	< 56	< 56	< 69	< 67	< 67	< 68
05/22/12 - 05/29/12	< 65	< 65	< 65	< 65	< 59	< 58	< 58	< 59
05/29/12 - 06/05/12	< 66	< 65	< 65	< 65	< 45	< 46	< 46	< 44
06/05/12 - 06/12/12	< 65	< 65	< 28	< 66	< 56	< 55	< 55	< 57
06/12/12 - 06/19/12	< 58	< 58	< 58	< 57	< 59	< 62	< 61	< 59
06/19/12 - 06/26/12	< 62 (1)	< 61	< 61	< 33	< 47	< 46	< 46	< 48
06/26/12 - 07/03/12	< 37	< 37	< 37	< 37	< 49	< 48	< 48	< 47
07/03/12 - 07/10/12	< 42	< 38	< 38	< 38	< 18	< 42	< 42	< 44
07/10/12 - 07/17/12	< 53 (1)	< 49	< 49	< 49	< 65	< 68	< 67	< 64
07/17/12 - 07/24/12	< 52	< 52	< 51	< 51	< 13	< 5	< 13	< 13
07/24/12 - 07/31/12	< 47	< 47	< 47	< 47	< 61	< 62	< 62	< 62
07/31/12 - 08/07/12	< 29	< 29	< 29	< 29	< 49	< 20	< 47	< 48
08/07/12 - 08/14/12	< 43	< 43	< 43	< 43	< 43	< 45	< 45	< 43
08/14/12 - 08/21/12	< 51	< 51	< 50	< 50	< 56	< 54	< 23	< 56
08/21/12 - 08/28/12	< 17	< 17	< 17	< 17	< 24	< 25	< 25	< 24
08/28/12 - 09/04/12	< 51	< 65	< 65	< 65	< 52	< 51	< 52	< 27
09/04/12 - 09/11/12	< 43	< 43	< 43	< 43	< 36	< 37	< 37	< 36
09/11/12 - 09/18/12	< 23	< 42	< 42	< 42	< 57	< 56	< 56	< 58
09/18/12 - 09/25/12	< 64	< 64	< 64	< 63	< 65	< 66	< 67	< 66
09/25/12 - 10/02/12	< 57	< 22	< 58	< 58	< 60	< 59	< 59	< 60
10/02/12 - 10/09/12	< 68	< 67	< 68	< 68	< 56	< 55	< 55	< 55
10/09/12 - 10/16/12	< 57	< 57	< 22	< 57	< 37	< 37	< 36	< 37
10/16/12 - 10/23/12	< 17	< 17	< 17	< 17	< 21	< 22 (1)	< 21	< 20
10/23/12 - 10/30/12	< 69	< 69	< 70	< 25	< 64	< 61	< 63	< 65
10/30/12 - 11/06/12	< 67	< 67	< 67	< 66	< 49	< 51	< 51	< 49
11/06/12 - 11/13/12	< 42	< 42	< 42	< 41	< 24	< 59	< 58	< 59
11/13/12 - 11/20/12	< 24	< 24	< 24	< 25	< 24	< 24	< 24	< 23
11/20/12 - 11/27/12	< 55	< 55	< 55	< 55	< 45	< 18	< 45	< 46
11/27/12 - 12/04/12	< 47	< 47	< 47	< 47	< 43	< 42	< 42	< 43
12/04/12 - 12/11/12	< 47	< 47	< 47	< 47	< 65	< 64	< 36	< 64
12/11/12 - 12/18/12	< 50	< 50	< 49	< 49	< 40	< 41	< 41	< 40
12/18/12 - 12/26/12	< 24	< 24	< 24	< 24	< 32	< 32	< 32	< 32
12/26/12 - 01/02/13	< 46	< 46	< 46	< 46	< 38	< 38	< 38	< 38

MEAN

- - - - - - - - - -

(1) SEE PROGRAM EXCEPTIONS SECTION FOR EXPLANATION

TABLE C-VII.1 CONCENTRATIONS OF I-131 IN MILK SAMPLES COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012

RESULTS IN UNITS OF PCI/LITER \pm 2 SIGMA

COLLECTION PERIOD	CONTROL FARM	INDICATOR FARM	
	BY-26-1	BY-20-1	BY-30-1
01/03/12	< 0.7	< 0.8	< 0.7
02/07/12	< 0.6	< 0.5	< 0.7
03/06/12	< 0.4	< 0.4	< 0.3
04/03/12	< 0.4	< 0.5	< 0.4
05/01/12	< 0.5	< 0.3	< 0.6
05/15/12	< 0.4	< 0.3	< 0.6
05/29/12	< 0.6	< 0.7	< 0.7
06/12/12	< 0.7	< 0.7	< 0.7
06/26/12	< 0.7	< 0.8	< 0.8
07/10/12	< 0.5	< 0.6	< 0.6
07/24/12	< 0.5	< 0.7	< 0.7
08/07/12	< 0.6	< 0.6	< 0.6
08/21/12	< 0.7	< 0.8	< 0.9
09/04/12	< 0.7	< 0.7	< 0.7
09/18/12	< 0.8	< 0.7	< 0.7
10/02/12	< 0.6	< 0.6	(1)
10/16/12	< 0.7	< 0.8	
10/30/12	< 0.7	< 0.6	
11/13/12	< 0.7	< 0.7	
12/04/12	< 0.6	< 0.6	
MEAN	-	-	-

(1) SEE PROGRAM CHANGES SECTION FOR EXPLANATION

TABLE C-VII.2 CONCENTRATIONS OF GAMMA EMITTERS IN MILK SAMPLES COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012

RESULTS IN UNITS OF PCI/LITER ± 2 SIGMA

SITE	COLLECTION PERIOD	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
BY-20-1	01/03/12	< 5	< 5	< 13	< 7	< 12	< 5	< 10	< 5	< 6	< 24	< 8
	02/07/12	< 6	< 5	< 11	< 7	< 10	< 4	< 8	< 5	< 5	< 23	< 7
	03/06/12	< 4	< 4	< 12	< 6	< 11	< 5	< 7	< 4	< 5	< 19	< 8
	04/03/12	< 5	< 5	< 11	< 6	< 10	< 5	< 8	< 4	< 4	< 18	< 6
	05/01/12	< 5	< 4	< 9	< 5	< 10	< 4	< 7	< 4	< 5	< 23	< 9
	05/15/12	< 6	< 4	< 13	< 6	< 14	< 5	< 9	< 4	< 7	< 29	< 8
	05/29/12	< 5	< 6	< 14	< 6	< 11	< 6	< 10	< 5	< 6	< 28	< 8
	06/12/12	< 8	< 10	< 19	< 12	< 24	< 9	< 13	< 8	< 8	< 43	< 13
	06/26/12	< 6	< 6	< 16	< 6	< 14	< 7	< 12	< 6	< 7	< 41	< 10
	07/10/12	< 5	< 5	< 12	< 6	< 12	< 5	< 8	< 5	< 5	< 21	< 7
	07/24/12	< 7	< 6	< 12	< 7	< 13	< 7	< 10	< 5	< 6	< 26	< 10
	08/07/12	< 5	< 6	< 13	< 8	< 14	< 7	< 11	< 6	< 7	< 25	< 11
	08/21/12	< 6	< 6	< 12	< 8	< 12	< 6	< 12	< 6	< 6	< 29	< 9
	09/04/12	< 7	< 9	< 22	< 11	< 19	< 8	< 16	< 6	< 7	< 35	< 11
	09/18/12	< 8	< 8	< 18	< 10	< 14	< 7	< 14	< 7	< 8	< 35	< 13
	10/02/12	< 7	< 7	< 18	< 9	< 15	< 6	< 12	< 7	< 8	< 38	< 8
	10/16/12	< 4	< 4	< 11	< 5	< 10	< 4	< 8	< 4	< 4	< 22	< 7
	10/30/12	< 7	< 7	< 12	< 8	< 15	< 6	< 13	< 6	< 6	< 33	< 9
	11/13/12	< 5	< 4	< 12	< 7	< 11	< 6	< 9	< 5	< 6	< 25	< 7
	12/04/12	< 4	< 4	< 10	< 5	< 10	< 4	< 9	< 4	< 5	< 21	< 6
	MEAN	-	-	-	-	-	-	-	-	-	-	-

TABLE C-VII.2 CONCENTRATIONS OF GAMMA EMITTERS IN MILK SAMPLES COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012

RESULTS IN UNITS OF PCI/LITER ± 2 SIGMA

SITE	COLLECTION PERIOD	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
BY-26-1	01/03/12	< 5	< 7	< 14	< 7	< 12	< 6	< 11	< 5	< 6	< 27	< 9
	02/07/12	< 6	< 7	< 18	< 8	< 17	< 7	< 12	< 6	< 7	< 29	< 9
	03/06/12	< 5	< 5	< 13	< 7	< 13	< 6	< 10	< 5	< 6	< 23	< 8
	04/03/12	< 4	< 4	< 10	< 4	< 10	< 5	< 7	< 4	< 5	< 22	< 5
	05/01/12	< 6	< 5	< 15	< 7	< 15	< 6	< 10	< 5	< 7	< 33	< 10
	05/15/12	< 5	< 5	< 14	< 7	< 10	< 6	< 10	< 5	< 5	< 28	< 8
	05/29/12	< 7	< 8	< 16	< 8	< 14	< 7	< 11	< 7	< 8	< 34	< 7
	06/12/12	< 7	< 7	< 18	< 11	< 17	< 8	< 12	< 7	< 8	< 37	< 10
	06/26/12	< 6	< 8	< 17	< 8	< 14	< 8	< 11	< 7	< 7	< 36	< 11
	07/10/12	< 5	< 5	< 11	< 7	< 13	< 6	< 10	< 5	< 5	< 26	< 6
	07/24/12	< 7	< 8	< 19	< 7	< 12	< 7	< 13	< 6	< 7	< 27	< 12
	08/07/12	< 6	< 7	< 15	< 9	< 19	< 7	< 11	< 5	< 7	< 29	< 10
	08/21/12	< 5	< 6	< 14	< 8	< 12	< 6	< 9	< 5	< 6	< 22	< 7
	09/04/12	< 9	< 8	< 19	< 10	< 19	< 5	< 14	< 8	< 8	< 40	< 12
	09/18/12	< 8	< 8	< 18	< 12	< 19	< 10	< 17	< 8	< 10	< 40	< 14
	10/02/12	< 7	< 6	< 15	< 8	< 15	< 6	< 11	< 6	< 6	< 34	< 10
	10/16/12	< 6	< 6	< 13	< 8	< 13	< 6	< 10	< 5	< 6	< 27	< 7
	10/30/12	< 6	< 6	< 15	< 5	< 14	< 6	< 10	< 6	< 6	< 32	< 13
	11/13/12	< 3	< 5	< 11	< 6	< 13	< 5	< 8	< 4	< 5	< 22	< 6
	12/04/12	< 4	< 4	< 9	< 5	< 9	< 4	< 7	< 3	< 4	< 19	< 6
	MEAN	-	-	-	-	-	-	-	-	-	-	-

TABLE C-VII.2 CONCENTRATIONS OF GAMMA EMITTERS IN MILK SAMPLES COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012

RESULTS IN UNITS OF PCI/LITER ± 2 SIGMA

SITE	COLLECTION PERIOD	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
BY-30-1	01/03/12	< 6	< 6	< 12	< 8	< 15	< 5	< 9	< 5	< 5	< 19	< 8
	02/07/12	< 6	< 8	< 16	< 10	< 19	< 7	< 14	< 7	< 6	< 27	< 8
	03/06/12	< 4	< 5	< 12	< 6	< 10	< 5	< 8	< 4	< 5	< 22	< 8
	04/03/12	< 4	< 4	< 8	< 4	< 8	< 4	< 6	< 3	< 3	< 19	< 6
	05/01/12	< 6	< 6	< 13	< 9	< 16	< 6	< 12	< 7	< 8	< 34	< 12
	05/15/12	< 6	< 5	< 14	< 6	< 11	< 6	< 11	< 5	< 6	< 27	< 9
	05/29/12	< 4	< 4	< 11	< 6	< 12	< 5	< 8	< 5	< 5	< 25	< 7
	06/12/12	< 6	< 9	< 19	< 12	< 22	< 8	< 18	< 7	< 9	< 36	< 13
	06/26/12	< 6	< 5	< 15	< 6	< 13	< 6	< 11	< 6	< 6	< 33	< 6
	07/10/12	< 5	< 5	< 13	< 7	< 12	< 6	< 10	< 5	< 6	< 27	< 9
	07/24/12	< 7	< 6	< 14	< 9	< 16	< 7	< 13	< 6	< 7	< 35	< 13
	08/07/12	< 5	< 5	< 11	< 7	< 13	< 5	< 8	< 5	< 4	< 23	< 6
	08/21/12	< 5	< 5	< 11	< 6	< 11	< 5	< 8	< 4	< 4	< 23	< 6
	09/04/12	< 7	< 7	< 18	< 10	< 20	< 8	< 14	< 7	< 8	< 33	< 12
	09/18/12	< 8	< 7	< 19	< 10	< 17	< 8	< 12	< 6	< 7	< 35	< 11
	10/02/12 (1)	-	-	-	-	-	-	-	-	-	-	-
	10/16/12	-	-	-	-	-	-	-	-	-	-	-
	10/30/12	-	-	-	-	-	-	-	-	-	-	-
	11/13/12	-	-	-	-	-	-	-	-	-	-	-
	12/04/12	-	-	-	-	-	-	-	-	-	-	-
	MEAN	-	-	-	-	-	-	-	-	-	-	-

(1) SEE PROGRAM CHANGES SECTION FOR EXPLANATION

TABLE C-VIII.1

**CONCENTRATIONS OF GAMMA EMITTERS IN VEGETATION SAMPLES
COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012**

RESULTS IN UNITS OF PCI/KG WET ± 2 SIGMA

SITE	COLLECTION PERIOD	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	I-131	Cs-134	Cs-137	Ba-140	La-140
BY-CONTROL													
Cabbage/beet greens	08/27/12	< 12	< 13	< 32	< 14	< 30	< 14	< 20	< 28	< 12	< 14	< 70	< 23
Kohlrabi/beets	08/27/12	< 12	< 14	< 30	< 16	< 29	< 13	< 21	< 31	< 12	< 14	< 76	< 17
MEAN		-	-	-	-	-	-	-	-	-	-	-	-
BY-QUAD 1													
Potatoes	08/27/12	< 15	< 16	< 34	< 16	< 34	< 16	< 27	< 29	< 13	< 15	< 73	< 27
Rhubarb leaves	08/27/12	< 23	< 23	< 55	< 26	< 52	< 25	< 42	< 53	< 23	< 25	< 123	< 44
MEAN		-	-	-	-	-	-	-	-	-	-	-	-
BY-QUAD 2													
Kohlrabi/onions	08/27/12	< 19	< 20	< 47	< 21	< 40	< 23	< 35	< 42	< 17	< 18	< 104	< 29
Rhubarb leaves	08/27/12	< 25	< 25	< 51	< 25	< 51	< 25	< 45	< 58	< 23	< 23	< 152	< 45
MEAN		-	-	-	-	-	-	-	-	-	-	-	-
BY-QUAD 3													
Cabbage	08/27/12	< 18	< 18	< 42	< 24	< 42	< 20	< 33	< 56	< 19	< 21	< 117	< 17
Turnips	08/27/12	< 14	< 13	< 36	< 16	< 33	< 17	< 28	< 34	< 12	< 15	< 73	< 22
MEAN		-	-	-	-	-	-	-	-	-	-	-	-
BY-QUAD 4													
Beet greens	08/27/12	< 17	< 17	< 45	< 23	< 42	< 20	< 35	< 43	< 16	< 20	< 108	< 30
Beets	08/27/12	< 25	< 22	< 50	< 34	< 52	< 24	< 42	< 53	< 24	< 27	< 144	< 32
MEAN		-	-	-	-	-	-	-	-	-	-	-	-

TABLE C-IX.1 QUARTERLY OSLD RESULTS FOR BYRON NUCLEAR GENERATING STATION, 2012

RESULTS IN UNITS OF MREM/QUARTER \pm 2 STANDARD DEVIATIONS

STATION CODE	MEAN \pm 2 S.D.	JAN - MAR	APR - JUN	JUL - SEP	OCT - DEC
BY-01-1	18 \pm 3	16	19	18	18
BY-01-2	17 \pm 5	14	18	18	20
BY-04-1	22 \pm 3	20	22	22	23
BY-04-2	21 \pm 4	18	21	22	22
BY-06-1	16 \pm 3	15	17	18	15
BY-06-2	17 \pm 2	16	18	19	17
BY-08-1	17 \pm 3	16	18	17	19
BY-08-2	18 \pm 3	16	19	18	18
BY-21-1	17 \pm 1	17	18	17	16
BY-21-2	17 \pm 4	20	16	15	17
BY-22-1	22 \pm 5	19	25	22	23
BY-22-2	23 \pm 6	18	25	23	24
BY-23-1	22 \pm 3	20	24	21	23
BY-23-2	21 \pm 5	17	22	22	22
BY-24-1	20 \pm 2	20	22	21	20
BY-24-2	20 \pm 5	16	22	21	21
BY-101-1	16 \pm 4	14	19	16	16
BY-101-2	15 \pm 3	13	17	16	17
BY-102-1	23 \pm 3	21	23	23	24
BY-102-2	23 \pm 4	21	24	22	24
BY-103-1	21 \pm 3	19	22	21	23
BY-103-2	22 \pm 6	17	23	23	23
BY-103-3	21 \pm 3	19	20	22	22
BY-104-1	22 \pm 6	19	26	21	23
BY-104-2	23 \pm 5	20	27	22	24
BY-104-3	21 \pm 5	17	23	21	22
BY-105-1	22 \pm 4	19	24	22	23
BY-105-2	23 \pm 3	21	25	22	24
BY-106-1	22 \pm 3	21	24	21	23
BY-106-2	21 \pm 2	20	22	21	22
BY-107-1	23 \pm 6	19	27	23	23
BY-107-2	25 \pm 3	22	25	26	25
BY-107-3	19 \pm 3	17	20	20	21
BY-108-1	23 \pm 5	20	26	23	23
BY-108-2	21 \pm 3	18	22	22	20
BY-109-1	21 \pm 4	19	23	22	21
BY-109-2	21 \pm 2	20	21	20	22
BY-110-1	20 \pm 3	18	22	20	20
BY-110-2	21 \pm 3	19	22	21	21
BY-111-3	23 \pm 3	21	24	25	24
BY-111-4	22 \pm 5	19	24	21	22
BY-112-3	21 \pm 5	17	22	22	22
BY-112-4	21 \pm 4	20	23	20	21
BY-113-1	22 \pm 4	20	23	24	23
BY-113-2	19 \pm 4	17	19	18	21
BY-114-1	18 \pm 2	17	19	18	19
BY-114-2	21 \pm 4	18	22	21	21
BY-115-1	22 \pm 3	20	23	22	23
BY-115-2	20 \pm 4	17	20	21	21
BY-116-1	19 \pm 3	17	20	20	21
BY-116-2	19 \pm 2	18	20	20	20

TABLE C-IX.1 QUARTERLY OSLD RESULTS FOR BYRON NUCLEAR GENERATING STATION, 2012

RESULTS IN UNITS OF MREM/QUARTER ± 2 STANDARD DEVIATIONS

STATION CODE	MEAN ± 2 S.D.	JAN - MAR	APR - JUN	JUL - SEP	OCT - DEC
BY-116-3	20 ± 2	19	21	20	20
BY-201-3	22 ± 5	19	22	22	24
BY-201-4	22 ± 3	20	24	22	23
BY-202-1	21 ± 6	16	22	23	21
BY-202-2	24 ± 3	21	25	24	24
BY-203-1	17 ± 2	15	17	18	18
BY-203-2	20 ± 3	18	21	20	21
BY-204-1	19 ± 4	17	18	20	20
BY-204-2	23 ± 7	18	26	24	24
BY-205-1	23 ± 4	21	26	24	24
BY-205-2	20 ± 5	16	22	21	21
BY-206-1	21 ± 4	18	22	22	22
BY-206-2	22 ± 6	17	25	23	22
BY-207-1	23 ± 3	21	24	24	24
BY-207-2	21 ± 4	18	22	22	23
BY-208-1	23 ± 5	19	25	24	24
BY-208-2	21 ± 6	17	23	23	23
BY-209-1	23 ± 2	22	24	23	23
BY-209-4	23 ± 3	21	24	22	25
BY-210-3	21 ± 8	15	24	21	22
BY-210-4	21 ± 3	19	22	23	22
BY-211-1	22 ± 4	20	24	23	22
BY-211-4	20 ± 9	14	22	21	22
BY-212-1	23 ± 4	21	26	24	23
BY-212-4	23 ± 2	22	23	23	24
BY-213-1	23 ± 3	21	24	22	23
BY-213-4	22 ± 4	20	24	24	20
BY-214-1	22 ± 2	21	23	21	23
BY-214-4	22 ± 2	20	23	23	22
BY-215-1	22 ± 2	21	22	23	23
BY-215-4	22 ± 4	20	23	23	24
BY-216-1	23 ± 4	21	25	23	24
BY-216-2	22 ± 3	21	24	22	23
BY-301-1	16 ± 3	14	17	15	17
BY-302-1	20 ± 7	15	23	22	21
BY-309-1	20 ± 5	17	19	20	23
BY-309-2	22 ± 4	19	22	22	24
BY-309-3	19 ± 5	16	21	19	20
BY-309-4	18 ± 3	17	19	18	21
BY-314-1	19 ± 2	20	18	18	18

(1) SEE PROGRAM EXCEPTIONS SECTION FOR EXPLANATION

TABLE C-IX.2 MEAN QUARTLY OSLD RESULTS FOR THE INNER RING, OUTER RING, SPECIAL INTEREST, OTHER AND CONTROL LOCATIONS FOR BYRON NUCLEAR GENERATING STATION, 2012

RESULTS IN UNITS OF MREM/QUARTER
2 STANDARD DEVIATIONS OF THE STATION DATA

COLLECTION PERIOD	INNER RING ± 2 S.D.	OUTER RING	SPECIAL INTEREST	OTHER	CONTROL
JAN-MAR	19 ± 4	19 ± 4	17 ± 4	18 ± 4	16 ± 0
APR-JUN	22 ± 5	23 ± 4	20 ± 4	21 ± 6	18 ± 2
JUL-SEP	21 ± 4	22 ± 3	19 ± 5	20 ± 5	18 ± 2
OCT-DEC	22 ± 4	23 ± 3	20 ± 5	20 ± 6	19 ± 1

TABLE C-IX.3 SUMMARY OF THE AMBIENT DOSIMETRY PROGRAM FOR BYRON NUCLEAR GENERATING STATION, 2011

RESULTS IN UNITS OF MREM/QUARTER

LOCATION	SAMPLES ANALYZED	PERIOD MINIMUM	PERIOD MAXIMUM	PERIOD MEAN ± 2 S.D.
INNER RING	144	13	27	21 ± 5
OUTER RING	128	14	26	22 ± 5
SPECIAL INTEREST	28	14	24	19 ± 5
OTHER	56	14	25	20 ± 6
CONTROL	8	16	19	18 ± 3

INNER RING STATIONS - BY-101-1, BY-101-2, BY-102-1, BY-102-2, BY-103-1, BY-103-2, BY-103-3, BY-104-1, BY-104-2, BY-104-3, BY-105-1, BY-105-2, BY-106-1, BY-106-2, BY-107-1, BY-107-2, BY-107-3, BY-108-1, BY-108-2, BY-109-1, BY-109-2, BY-110-1, BY-110-2, BY-111-3, BY-111-4, BY-112-3, BY-112-4, BY-113-1, BY-113-2, BY-114-1, BY-114-2, BY-115-1, BY-115-2, BY-116-1, BY-116-2, BY-116-3

OUTER RING STATIONS - BY-201-3, BY-201-4, BY-202-1, BY-202-2, BY-203-1, BY-203-2, BY-204-1, BY-204-2, BY-205-1, BY-205-2, BY-206-1, BY-206-2, BY-207-1, BY-207-2, BY-208-1, BY-208-2, BY-209-1, BY-209-4, BY-210-3, BY-210-4, BY-211-1, BY-211-4, BY-212-1, BY-212-4, BY-213-1, BY-213-4, BY-214-1, BY-214-4, BY-215-1, BY-215-4, BY-216-1, BY-216-2


SPECIAL INTEREST STATIONS - BY-301-1, BY-302-1, BY-309-1, BY-309-2, BY-309-3, BY-309-4, BY-314-1

OTHER STATIONS - BY-01-1, BY-01-2, BY-04-1, BY-04-2, BY-06-1, BY-06-2, BY-21-1, BY-21-2, BY-22-1, BY-22-2, BY-23-1, BY-23-2, BY-24-1, BY-24-2


CONTROL STATIONS - BY-08-1, BY-08-2

FIGURE C-1 Surface Water - Gross Beta - Station BY-12 and BY-29 (C) Collected in the Vicinity of BNGS, 2000 - 2012

BY-12 Oregon Pool of Rock River, Downstream

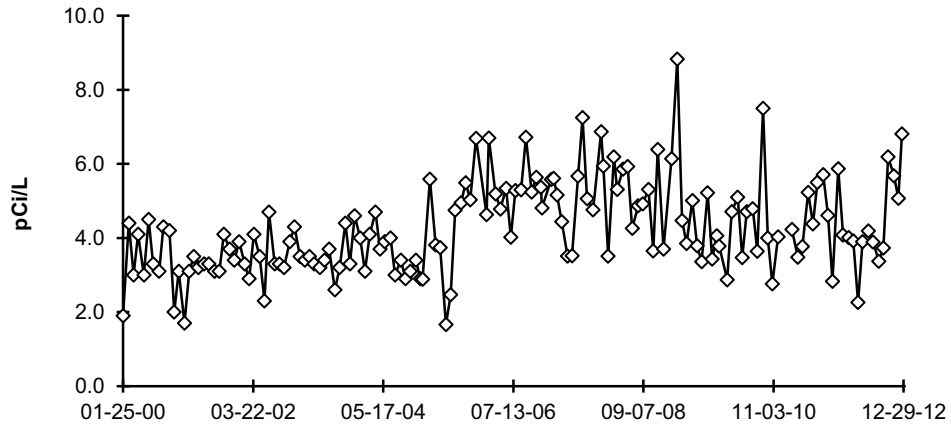


BY-29 (C) Byron, Rock River Upstream

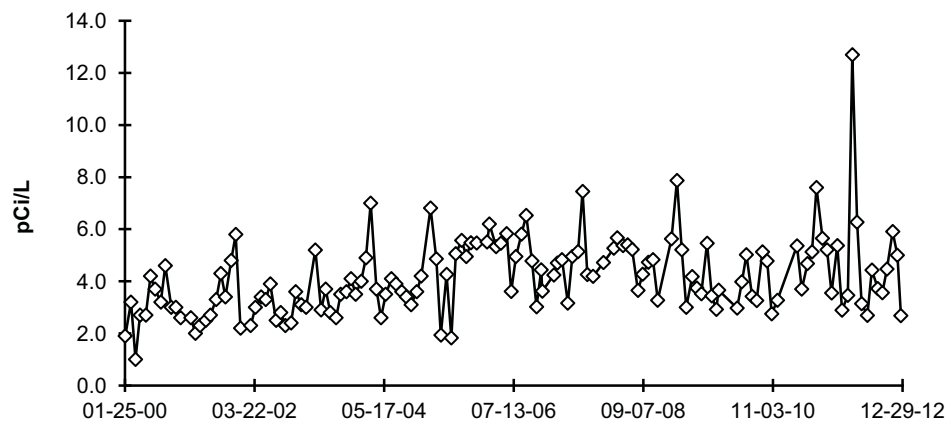


DUE TO VENDOR CHANGE IN 2005, < VALUES ARE LLD VALUES JANUARY THROUGH JUNE 2005 AND MDC VALUES AFTER JUNE 2005

FIGURE C-2 Surface Water - Tritium - Stations BY-12 and BY-29 (C) Collected in the Vicinity of BNGS, 2000 - 2012

BY-12 Oregon Pool of Rock River, Downstream

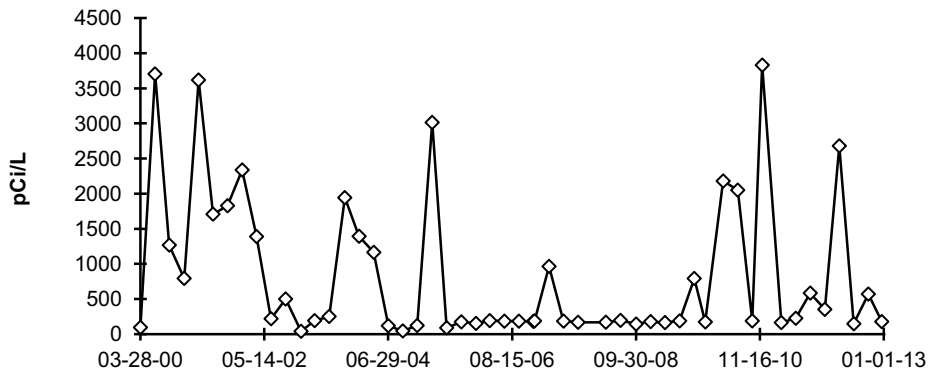

BY-29 (C) Byron, Rock River Upstream

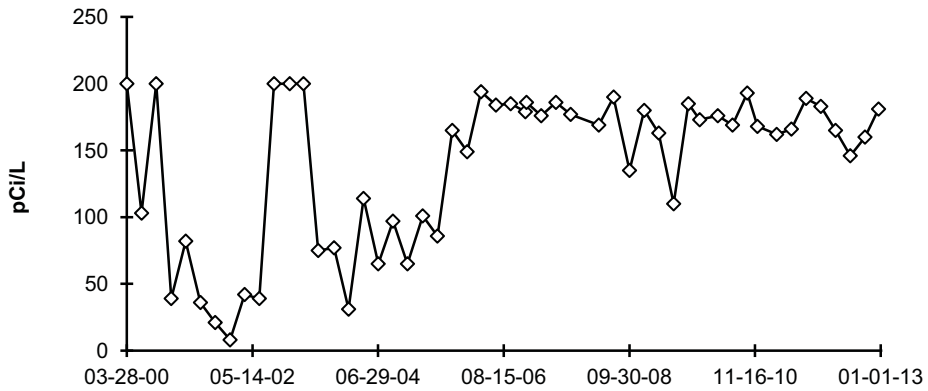


DUE TO VENDOR CHANGE IN 2005, < VALUES ARE LLD VALUES JANUARY THROUGH JUNE 2005 AND MDC VALUES AFTER JUNE 2005


FIGURE C-3

Ground Water - Tritium - Stations BY-14-1 and BY-18 Collected in the Vicinity of BNGS, 2000 - 2012

BY-14-1 3200 N. German Church Road Well

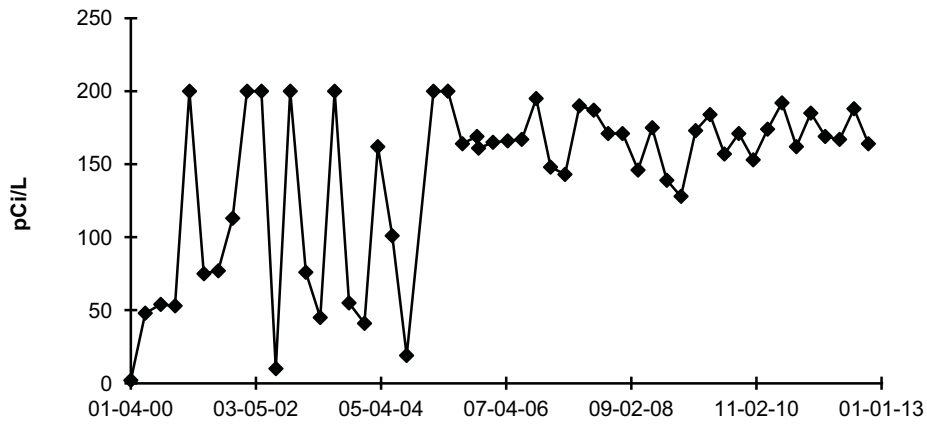

BY-18 McCoy Farmstead Well

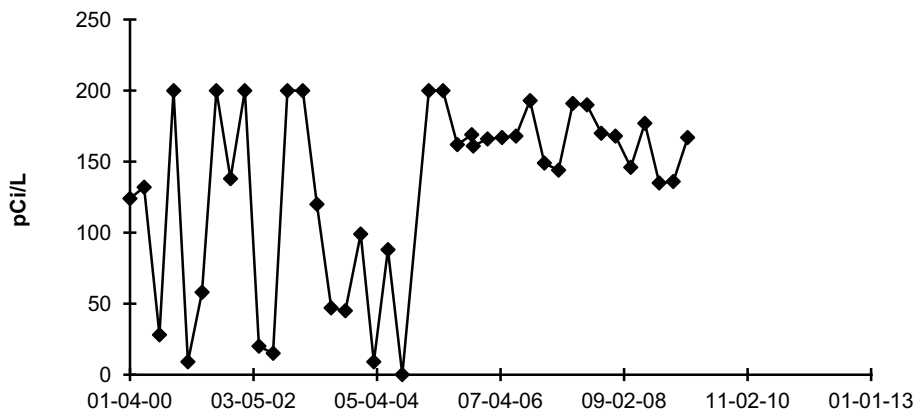

DUE TO VENDOR CHANGE IN 2005, < VALUES ARE LLD VALUES JANUARY THROUGH JUNE 2005 AND MDC VALUES AFTER JUNE 2005

FIGURE C-4
Ground Water - Tritium - Stations BY-18-1
Collected in the Vicinity of BNGS, 2010 - 2012

BY-18-1 Calhoun Well


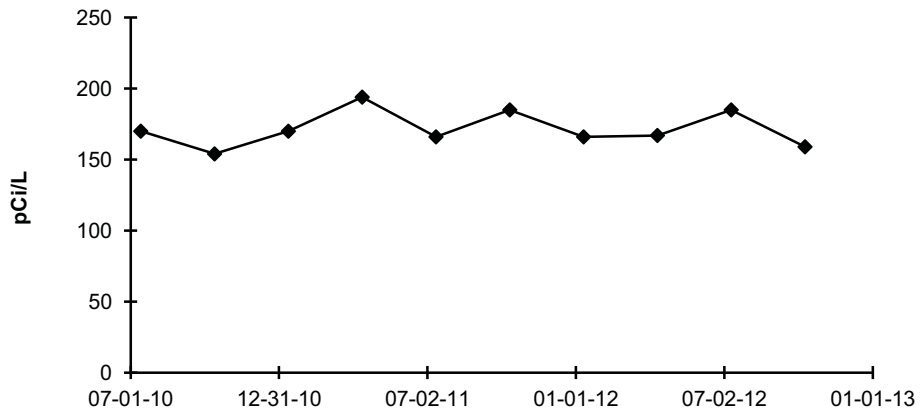


FIGURE C-5
Ground Water - Tritium - Station BY-32
Collected in the Vicinity of BNGS, 2000 - 2012


BY-32 WOLFORD WELL

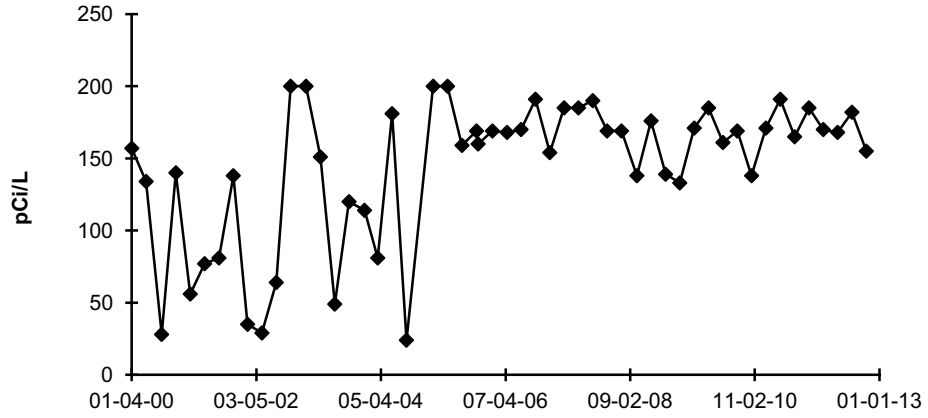

DUE TO VENDOR CHANGE IN 2005, < VALUES ARE LLD VALUES JANUARY THROUGH JUNE 2005 AND MDC VALUES AFTER JUNE 2005

FIGURE C-6
Ground Water - Tritium - Stations BY-35 and BY-36
Collected in the Vicinity of BNGS, 2006 - 2012

BY-35 Vancko Well

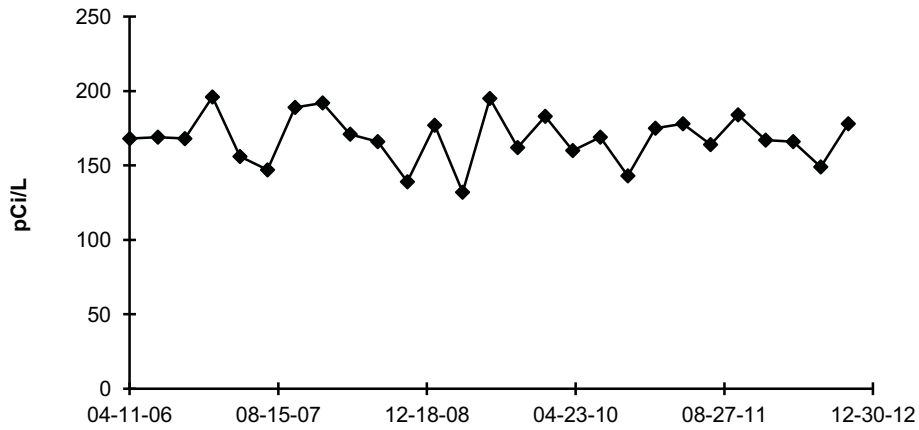

BY-36 Blanchard Well

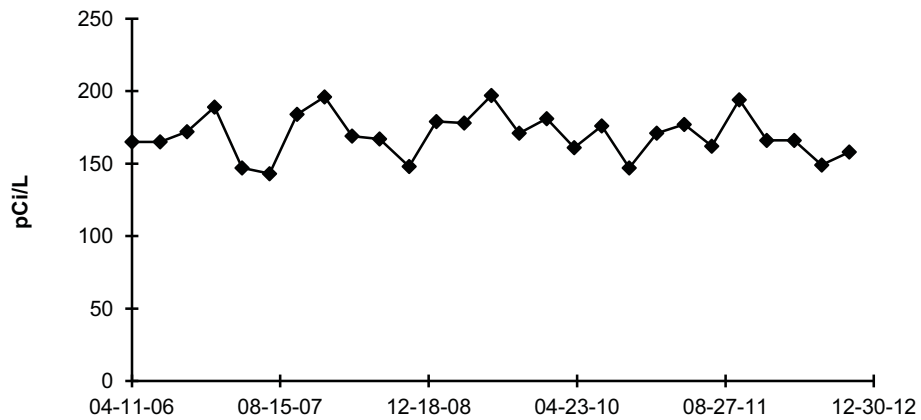


FIGURE C-7
Ground Water - Tritium - Stations BY-37
Collected in the Vicinity of BNGS, 2006 - 2012

BY-37 Alexander Well


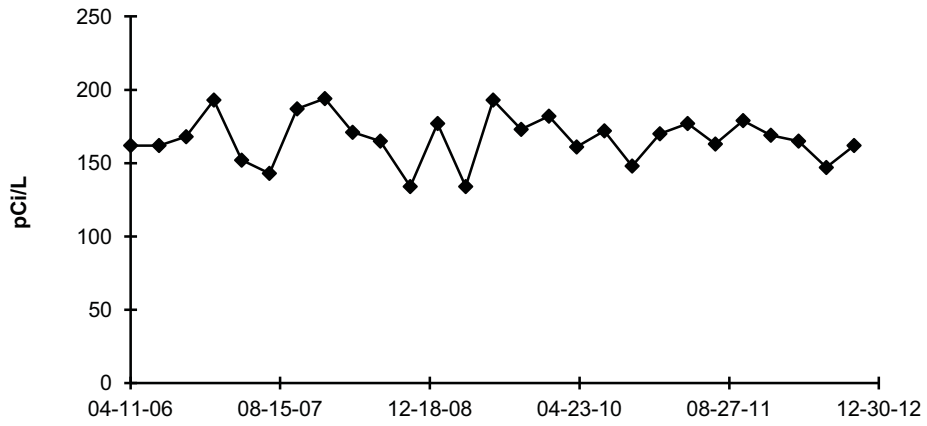


FIGURE C-8
Air Particulates - Gross Beta - Stations BY-08 (C) and
BY-21 Collected in the Vicinity of BNGS, 2000 - 2012

BY-08 (C) Leaf River WNW

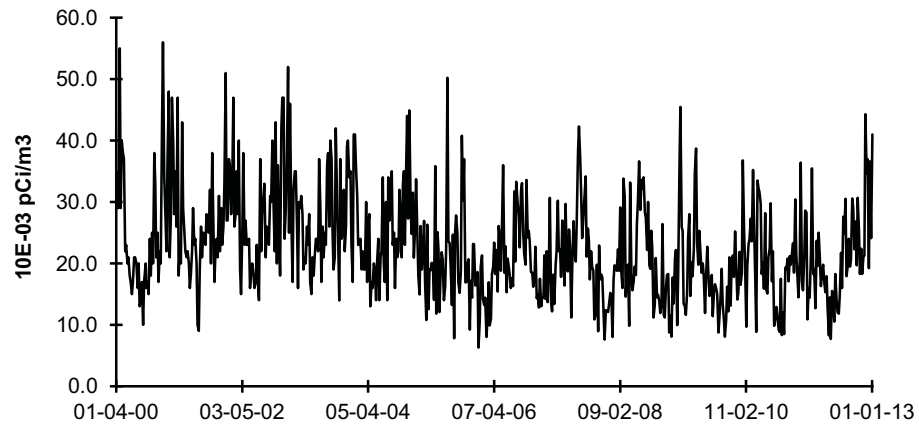

BY-21 Byron Nearsite N


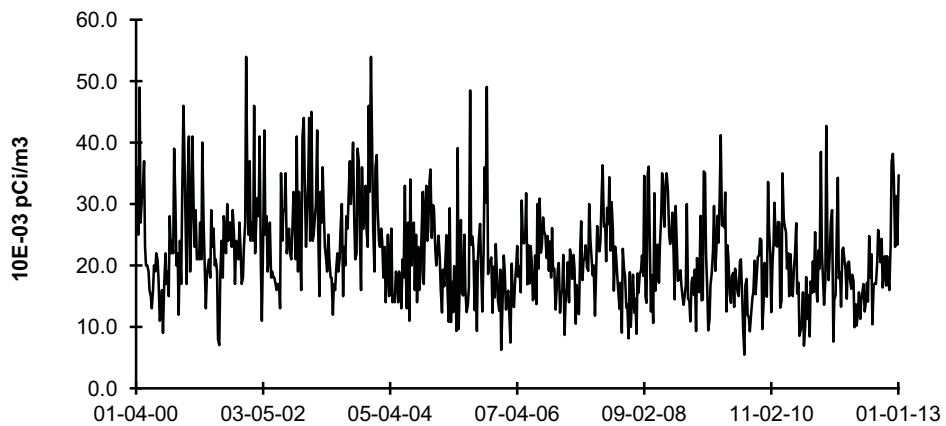


FIGURE C-9
Air Particulates - Gross Beta - Stations BY-22 and
BY-23 Collected in the Vicinity of BNGS, 2000 - 2012

BY-22 Byron Nearsite SE

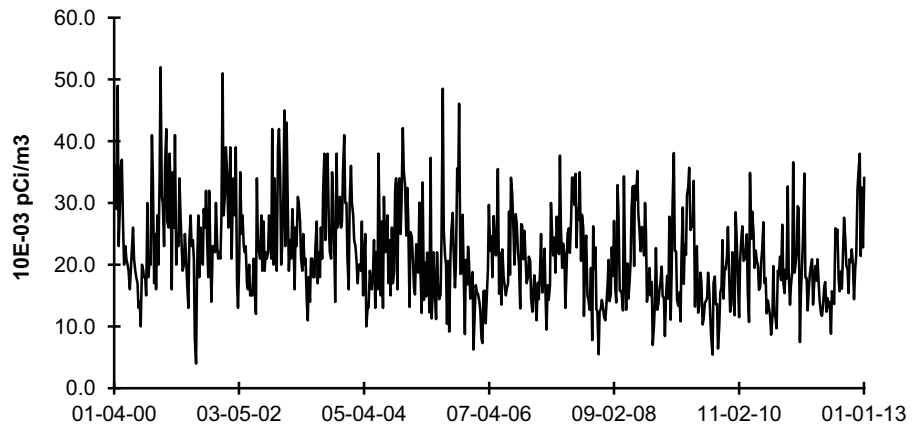

BY-23 Byron Nearsite S

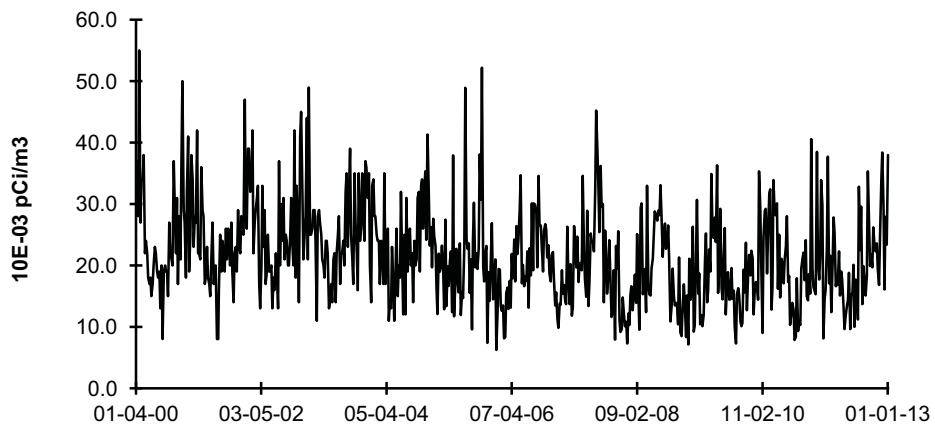


FIGURE C-10
Air Particulates - Gross Beta - Station BY-24
Collected in the Vicinity of BNGS, 2000 - 2012

BY-24 Byron Nearsite SW



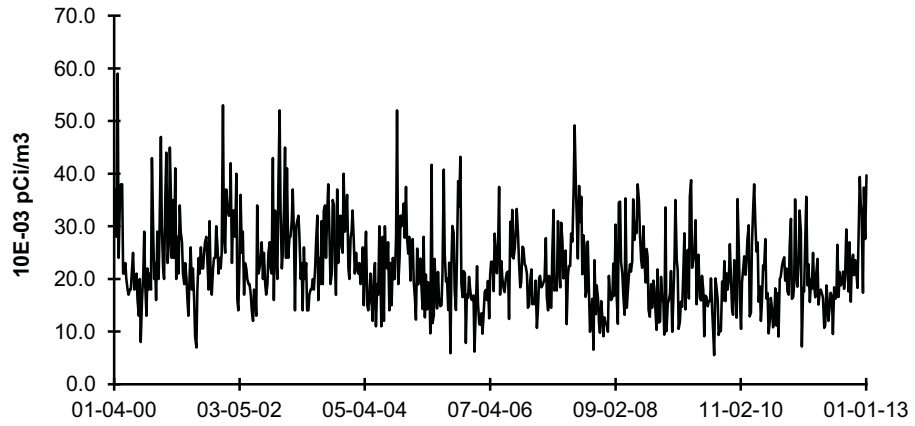


FIGURE C-11
Air Particulates - Gross Beta - Stations BY-01 and
BY-04 Collected in the Vicinity of BNGS, 2005 - 2012

BY-01 Byron N

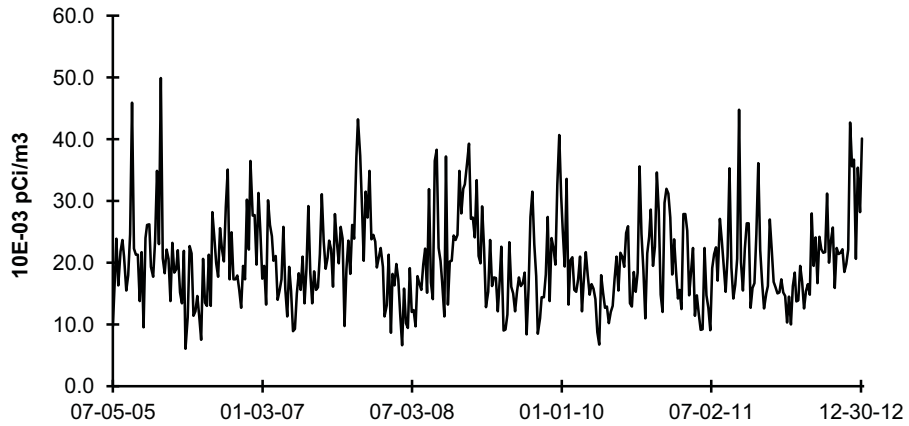


BY-04 Paynes Point SE

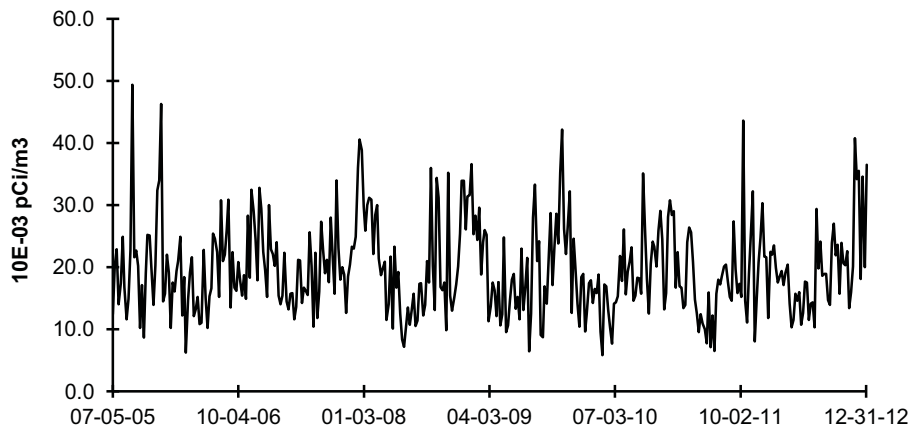

Regular analysis of far field air particulate & gross beta did not take place prior to 2005.

FIGURE C-12
Air Particulates - Gross Beta - Station BY-06
Collected in the Vicinity of BNGS, 2005 - 2012

BY-06 Oregon SSW

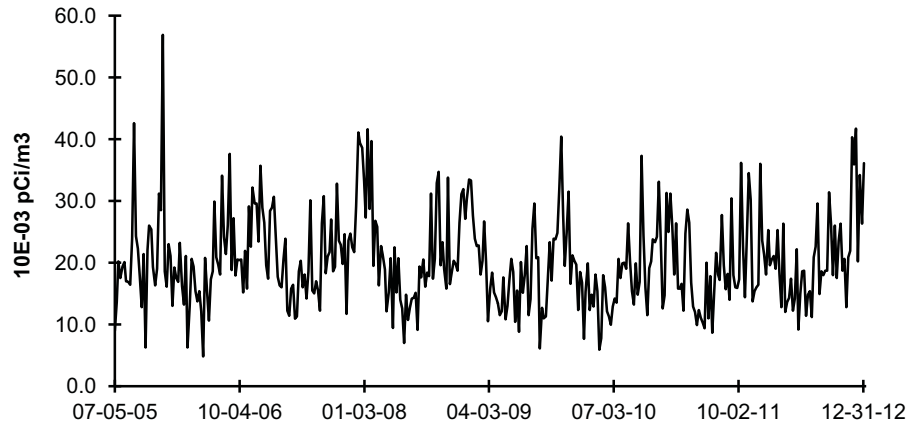

Regular analysis of far field air particulate & gross beta did not take place prior to 2005.

APPENDIX D

INTER-LABORATORY COMPARISON PROGRAM

TABLE D-1

**ANALYTICS ENVIRONMENTAL RADIOACTIVITY CROSS CHECK PROGRAM
TELEDYNE BROWN ENGINEERING, 2012**

(PAGE 1 OF 3)

Month/Year	Identification Number	Matrix	Nuclide	Units	Reported Value (a)	Known Value (b)	Ratio (c) TBE/Analytics	Evaluation (d)			
March 2012	E10066	Milk	Sr-89	pCi/L	101	94.8	1.07	A			
			Sr-90	pCi/L	11.7	13.5	0.87	A			
March 2012	E10067	Milk	I-131	pCi/L	87.5	92.5	0.95	A			
			Ce-141	pCi/L	247	260	0.95	A			
			Cr-51	pCi/L	435	436	1.00	A			
			Cs-134	pCi/L	133	149	0.89	A			
			Cs-137	pCi/L	156	159	0.98	A			
			Co-58	pCi/L	127	132	0.96	A			
			Mn-54	pCi/L	190	195	0.97	A			
			Fe-59	pCi/L	179	168	1.07	A			
			Zn-65	pCi/L	327	333	0.98	A			
			Co-60	pCi/L	274	279	0.98	A			
			March 2012	E10069	AP	Ce-141	pCi	167	164	1.02	A
						Cr-51	pCi	310	276	1.12	A
						Cs-134	pCi	107	94.5	1.13	A
Cs-137	pCi	109				101	1.08	A			
Co-58	pCi	87.6				83.5	1.05	A			
Mn-54	pCi	133				123	1.08	A			
Fe-59	pCi	113				106	1.07	A			
Zn-65	pCi	226				210	1.08	A			
Co-60	pCi	185				176	1.05	A			
March 2012	E10068	Charcoal	I-131	pCi	92.8	94.2	0.99	A			
March 2012	E10070	Water	Fe-55	pCi/L	1800	1570	1.15	A			
June 2012	E10198	Milk	Sr-89	pCi/L	86.1	99.8	0.86	A			
			Sr-90	pCi/L	9.2	12.7	0.72	W			
June 2012	E10199	Milk	I-131	pCi/L	88.9	99.7	0.89	A			
			Ce-141	pCi/L	72.8	82.2	0.89	A			
			Cr-51	pCi/L	394	402	0.98	A			
			Cs-134	pCi/L	159	174	0.91	A			
			Cs-137	pCi/L	206	212	0.97	A			
			Co-58	pCi/L	89.5	92.3	0.97	A			
			Mn-54	pCi/L	129	132	0.98	A			
			Fe-59	pCi/L	129	128	1.01	A			
			Zn-65	pCi/L	193	199	0.97	A			
			Co-60	pCi/L	342	355	0.96	A			
			June 2012	E10201	AP	Ce-141	pCi	73.2	75.1	0.97	A
						Cr-51	pCi	367	366	1.00	A
						Cs-134	pCi	165	159	1.04	A
Cs-137	pCi	205				193	1.06	A			
Co-58	pCi	84.7				84.2	1.01	A			
Mn-54	pCi	118				121	0.98	A			
Fe-59	pCi	125				117	1.07	A			
Zn-65	pCi	181				182	0.99	A			
Co-60	pCi	338				324	1.04	A			
June 2012	E10200	Charcoal	I-131	pCi	101	96.6	1.05	A			

TABLE D-1

**ANALYTICS ENVIRONMENTAL RADIOACTIVITY CROSS CHECK PROGRAM
TELEDYNE BROWN ENGINEERING, 2012**

(PAGE 2 OF 3)

Month/Year	Identification Number	Matrix	Nuclide	Units	Reported Value (a)	Known Value (b)	Ratio (c) TBE/Analytics	Evaluation (d)		
June 2012	E10202	Water	Fe-55	pCi/L	1890	1580	1.20	A		
September 2012	E10296	Milk	Sr-89	pCi/L	106	99.6	1.06	A		
			Sr-90	pCi/L	13.6	16.0	0.85	A		
	E10297	Milk	I-131	pCi/L	89.8	99.6	0.90	A		
			Ce-141	pCi/L	160	164	0.98	A		
			Cr-51	pCi/L	230	248	0.93	A		
			Cs-134	pCi/L	101	108	0.94	A		
			Cs-137	pCi/L	174	174	1.00	A		
			Co-58	pCi/L	97.2	100	0.97	A		
			Mn-54	pCi/L	188	196	0.96	A		
			Fe-59	pCi/L	159	152	1.05	A		
			Zn-65	pCi/L	195	192	1.02	A		
			Co-60	pCi/L	155	152	1.02	A		
			E10299	AP	Ce-141	pCi	145	135	1.07	A
					Cr-51	pCi	219	205	1.07	A
					Cs-134	pCi	94.1	89.4	1.05	A
					Cs-137	pCi	140	144	0.97	A
Co-58	pCi	88.3			83.0	1.06	A			
Mn-54	pCi	173			162	1.07	A			
Fe-59	pCi	136			125	1.09	A			
Zn-65	pCi	165			159	1.04	A			
E10298	Charcoal	I-131	pCi	95.5	97.2	0.98	A			
				133	125	1.06	A			
E10300	Water	Fe-55	pCi/L	1630	1900	0.86	A			
December 2012	E10334	Milk	Sr-89	pCi/L	101	96.6	1.05	A		
			Sr-90	pCi/L	11.3	13.8	0.82	A		
	E10335	Milk	I-131	pCi/L	93.1	90.0	1.03	A		
			Ce-141	pCi/L	52.5	51.0	1.03	A		
			Cr-51	pCi/L	373	348	1.07	A		
			Cs-134	pCi/L	157	165	0.95	A		
			Cs-137	pCi/L	113	117	0.97	A		
			Co-58	pCi/L	94.1	98.5	0.96	A		
			Mn-54	pCi/L	116	116	1.00	A		
			Fe-59	pCi/L	124	116	1.07	A		
			Zn-65	pCi/L	190	186	1.02	A		
			Co-60	pCi/L	172	170	1.01	A		
			E10337A	AP	Ce-141	pCi	51.8	49.6	1.04	A
					Cr-51	pCi	372	338	1.10	A
					Cs-134	pCi	165	161	1.02	A
					Cs-137	pCi	113	114	0.99	A
Co-58	pCi	96.5			95.8	1.01	A			
Mn-54	pCi	118			112	1.05	A			
Fe-59	pCi	105			112	0.94	A			
Zn-65	pCi	166			181	0.92	A			
Co-60	pCi	179	165	1.08	A					

TABLE D-1 ANALYTICS ENVIRONMENTAL RADIOACTIVITY CROSS CHECK PROGRAM
TELEDYNE BROWN ENGINEERING, 2012
(PAGE 3 OF 3)

Month/Year	Identification Number	Matrix	Nuclide	Units	Reported Value (a)	Known Value (b)	Ratio (c) TBE/Analytics	Evaluation (d)
December 2012	E10336	Charcoal	I-131	pCi	73.1	72.7	1.01	A
	E10333	Water	Fe-55	pCi/L	1550	1750	0.89	A

(a) Teledyne Brown Engineering reported result.

(b) The Analytics known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation.

(c) Ratio of Teledyne Brown Engineering to Analytics results.

(d) Analytics evaluation based on TBE internal QC limits: A= Acceptable. Reported result falls within ratio limits of 0.80-1.20. W-Acceptable with warning. Reported result falls within 0.70-0.80 or 1.20-1.30. N = Not Acceptable. Reported result falls outside the ratio limits of < 0.70 and > 1.30.

TABLE D-2

ERA ENVIRONMENTAL RADIOACTIVITY CROSS CHECK PROGRAM
TELEDYNE BROWN ENGINEERING, 2012

(PAGE 1 OF 1)

Month/Year	Identification Number	Media	Nuclide	Units	Reported Value (a)	Known Value (b)	Acceptance Limits	Evaluation (c)		
May 2012	RAD-89	Water	Sr-89	pCi/L	63.4	58.5	46.9 - 66.3	A		
			Sr-90	pCi/L	33.5	37.4	27.4 - 43.1	A		
			Ba-133	pCi/L	89.2	82.3	69.1 - 90.5	A		
			Cs-134	pCi/L	66.5	74.2	60.6 - 81.6	A		
			Cs-137	pCi/L	152	155	140 - 172	A		
			Co-60	pCi/L	73.3	72.9	65.6 - 82.6	A		
			Zn-65	pCi/L	109	105	94.5 - 125	A		
			Gr-A	pCi/L	82.4	62.9	33.0 - 78.0	N (1)		
			Gr-B	pCi/L	43.6	44.2	29.6 - 51.5	A		
			I-131	pCi/L	25.9	27.1	22.5 - 31.9	A		
			H-3	pCi/L	15433	15800	13800 - 17400	A		
			MRAD-16	Filter	Gr-A	pCi/filter	39.5	77.8	26.1 - 121	A
			November, 2012	RAD-91	Water	Sr-89	pCi/L	46.5	39.1	29.7 - 46.1
Sr-90	pCi/L	16.6				20.1	14.4 - 23.8	A		
Ba-133	pCi/L	85.2				84.8	71.3 - 93.3	A		
Cs-134	pCi/L	76.9				76.6	62.6 - 84.3	A		
Cs-137	pCi/L	177				183	165 - 203	A		
Co-60	pCi/L	77.4				78.3	70.5 - 88.5	A		
Zn-65	pCi/L	209				204	184 - 240	A		
Gr-A	pCi/L	50.6				58.6	30.6 - 72.9	A		
Gr-B	pCi/L	59.3				39.2	26.0 - 46.7	N (2)		
I-131	pCi/L	22.9				24.8	20.6 - 29.4	A		
H-3	pCi/L	5020				4890	4190 - 5380	A		
MRAD-17	Filter	Gr-A				pCi/filter	59.6	87.5	29.3 - 136	A

(1) Detector G1 is slightly biased high for Th-230 based measurements used only for ERA Gross Alpha samples. NCR 12-05

(2) The Sr-89 found to known ratio was 1.19, which TBE considers acceptable. It appears the aliquot was entered incorrectly for the Gross Beta NCR 12-13

(a) Teledyne Brown Engineering reported result.

(b) The ERA known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation.

(c) ERA evaluation: A=acceptable. Reported result falls within the Warning Limits. NA=not acceptable. Reported result falls outside of the Control Limits. CE=check for Error. Reported result falls within the Control Limits and outside of the Warning Limit.

TABLE D-3

DOE'S MIXED ANALYTE PERFORMANCE EVALUATION PROGRAM (MAPEP)
TELEDYNE BROWN ENGINEERING, 2012

(PAGE 1 OF 2)

Month/Year	Identification Number	Media	Nuclide	Units	Reported Value (a)	Known Value (b)	Acceptance Range	Evaluation (c)
March 2012	12-MaW26	Water	Cs-134	Bq/L	-0.0045		(1)	A
			Cs-137	Bq/L	37.5	39.9	27.9 - 51.9	A
			Co-57	Bq/L	30.8	32.9	23.0 - 42.8	A
			Co-60	Bq/L	22.4	23.72	16.60 - 30.84	A
			H-3	Bq/L	456	437	306 - 568	A
			Mn-54	Bq/L	31.0	31.8	22.3 - 41.3	A
			K-40	Bq/L	144	142	99 - 185	A
			Sr-90	Bq/L	-0.0084		(1)	A
			Zn-65	Bq/L	-0.369		(1)	A
	12-GrW26	Water	Gr-A	Bq/L	2.06	2.14	0.64 - 3.64	A
			Gr-B	Bq/L	7.48	6.36	3.18 - 9.54	A
	12-MaS26	Soil	Cs-134	Bq/kg	831	828	580 - 1076	A
			Cs-137	Bq/kg	0.145		(1)	A
			Co-57	Bq/kg	1270	1179	825 - 1533	A
			Co-60	Bq/kg	7.61	1.56	(2)	N (3)
			Mn-54	Bq/kg	634	558	391 - 725	A
			K-40	Bq/kg	1690	1491	1044 - 1938	A
			Sr-90	Bq/kg	328	392	274 - 540	A
			Zn-65	Bq/kg	753	642	449 - 835	A
	12-RdF26	AP	Cs-134	Bq/sample	2.31	2.38	1.67 - 3.09	A
			Cs-137	Bq/sample	2.15	1.79	1.25 - 2.33	W
			Co-57	Bq/sample	-0.0701		(1)	A
			Co-60	Bq/sample	2.62	2.182	1.527 - 2.837	W
			Mn-54	Bq/sample	4.13	3.24	2.27 - 4.21	W
			Sr-90	Bq/sample	0.0185		(1)	A
			Zn-65	Bq/sample	4.19	2.99	2.09 - 3.89	N (3)
			12-GrF26	AP	Gr-A	Bq/sample	0.365	1.2
	Gr-B	Bq/sample			2.31	2.4	1.2 - 3.6	A
	12-RdV26	Vegetation	Cs-134	Bq/sample	8.72	8.43	5.90 - 10.96	A
			Cs-137	Bq/sample	0.0424		(1)	A
			Co-57	Bq/sample	15.5	12.0	8.4 - 15.6	W
			Co-60	Bq/sample	6.80	6.05	4.24 - 7.87	A
			Mn-54	Bq/sample	0.0057		(1)	A
Sr-90			Bq/sample	2.24	2.11	1.48 - 2.74	A	
Zn-65			Bq/sample	10.5	8.90	6.23 - 11.57	A	
September 2012	12-MaW27	Water	Cs-134	Bq/L	21.4	23.2	16.2 - 30.2	A
			Cs-137	Bq/L	17.0	16.7	11.7 - 21.7	A
			Co-57	Bq/L	28.7	29.3	20.5 - 38.1	A
			Co-60	Bq/L	0.179		(1)	A
			H-3	Bq/L	387	334	234 - 434	A
			Mn-54	Bq/L	18.1	17.8	12.5 - 23.1	A
			K-40	Bq/L	139	134	94 - 174	A
			Sr-90	Bq/L	19.6	12.2	8.5 - 15.9	N (4)
			Zn-65	Bq/L	27.2	25.9	18.1 - 33.7	A
	12-GrW27	Water	Gr-A	Bq/L	0.966	1.79	0.54 - 3.04	A
			Gr-B	Bq/L	10.0	9.1	4.6 - 13.7	A

TABLE D-3

DOE'S MIXED ANALYTE PERFORMANCE EVALUATION PROGRAM (MAPEP)
TELEDYNE BROWN ENGINEERING, 2012

(PAGE 2 OF 2)

Month/Year	Identification Number	Media	Nuclide	Units	Reported Value (a)	Known Value (b)	Acceptance Range	Evaluation (c)
September 2012	12-MaS27	Soil	Cs-134	Bq/kg	880	939	657 - 1221	A
			Cs-137	Bq/kg	1220	1150	805 - 1495	A
			Co-57	Bq/kg	1330	1316	921 - 1711	A
			Co-60	Bq/kg	552	531	372 - 690	A
			Mn-54	Bq/kg	1000	920	644 - 1196	A
			K-40	Bq/kg	674	632	442 - 822	A
			Sr-90	Bq/kg	528	508	356 - 660	A
			Zn-65	Bq/kg	665	606	424 - 788	A
	12-RdF27	AP	Cs-134	Bq/sample	2.760	2.74	1.92 - 3.56	A
			Cs-137	Bq/sample	0.0415		(1)	A
			Co-57	Bq/sample	2.00	191.00	1.34 - 2.48	A
			Co-60	Bq/sample	1.78	1.728	1.210 - 2.246	A
			Mn-54	Bq/sample	2.40	2.36	1.65 - 3.07	A
			Sr-90	Bq/sample	0.931	1.03	0.72 - 1.34	A
			Zn-65	Bq/sample	-0.688		(1)	A
			12-GrF27	AP	Gr-A	Bq/sample	0.434	0.97
	Gr-B	Bq/sample			1.927	1.92	0.96 - 2.88	A
	12-RdV27	Vegetation	Cs-134	Bq/sample	6.28	6.51	4.56 - 8.46	A
			Cs-137	Bq/sample	4.62	4.38	3.07 - 5.69	A
			Co-57	Bq/sample	6.51	5.66	3.96 - 7.36	A
			Co-60	Bq/sample	5.32	5.12	3.58 - 6.66	A
			Mn-54	Bq/sample	3.59	3.27	2.29 - 4.25	A
			Sr-90	Bq/sample	0.0012		(1)	A
			Zn-65	Bq/sample	-0.046		(1)	A

(1) False positive test.

(2) Sensitivity evaluation

(3) No cause was found for the failed high soil Co-60 sensitivity test or the high Zn-65 in AP, which TBE considers an anomaly. NCR 12-08

(4) Sr-90 in water high due to incorrect aliquot entered in LIMS. 12-11

(a) Teledyne Brown Engineering reported result.

(b) The MAPEP known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation.

(c) DOE/MAPEP evaluation: A=acceptable, W=acceptable with warning, N=not acceptable.

TABLE D-4

**ERA (a) STATISTICAL SUMMARY PROFICIENCY TESTING PROGRAM^a
ENVIRONMENTAL, INC., 2012**

(Page 1 of 1)

Lab Code	Date	Analysis	Concentration (pCi/L)			Acceptance
			Laboratory Result ^b	ERA Result ^c	Control Limits	
ERW-1783	04/09/12	Sr-89	62.2 ± 6.0	58.5	46.9 - 66.3	Pass
ERW-1783	04/09/12	Sr-90	33.7 ± 2.1	37.4	27.4 - 43.1	Pass
ERW-1786	04/09/12	Ba-133	75.7 ± 4.1	82.3	69.1 - 90.5	Pass
ERW-1786	04/09/12	Co-60	71.9 ± 4.0	72.9	65.6 - 82.6	Pass
ERW-1786	04/09/12	Cs-134	70.0 ± 4.3	74.2	60.6 - 81.6	Pass
ERW-1786	04/09/12	Cs-137	151.5 ± 6.1	155.0	140.0 - 172.0	Pass
ERW-1786	04/09/12	Zn-65	108.3 ± 89.0	105.0	94.5 - 125.0	Pass
ERW-1789	04/09/12	Gr. Alpha	55.0 ± 2.4	62.9	33.0 - 78.0	Pass
ERW-1789 ^d	04/09/12	Gr. Beta	76.2 ± 1.8	44.2	29.6 - 51.5	Fail
ERW-1798	04/09/12	H-3	16023 ± 355	15800	13800 - 17400	Pass
ERW-6283	10/05/12	Sr-89	41.5 ± 4.1	39.1	29.7 - 46.1	Pass
ERW-6283	10/05/12	Sr-90	19.7 ± 1.6	20.1	14.4 - 23.8	Pass
ERW-6286	10/05/12	Ba-133	82.7 ± 4.4	84.8	71.3 - 93.3	Pass
ERW-6286	10/05/12	Co-60	77.2 ± 3.7	78.3	70.5 - 88.5	Pass
ERW-6286	10/05/12	Cs-134	74.4 ± 1.5	76.6	62.6 - 84.3	Pass
ERW-6286	10/05/12	Cs-137	183.0 ± 6.2	183.0	165.0 - 203.0	Pass
ERW-6286	10/05/12	Zn-65	211.0 ± 9.9	204.0	184.0 - 240.0	Pass
ERW-6288	10/05/12	Gr. Alpha	47.0 ± 2.3	58.6	30.6 - 72.9	Pass
ERW-6288	10/05/12	Gr. Beta	33.4 ± 1.2	39.2	26.0 - 46.7	Pass
ERW-6290	10/05/12	I-131	23.3 ± 1.0	24.8	20.6 - 29.4	Pass

^a Results obtained by Environmental, Inc., Midwest Laboratory as a participant in the crosscheck program for proficiency testing in drinking water conducted by Environmental Resources Associates (ERA).

^b Unless otherwise indicated, the laboratory result is given as the mean ± standard deviation for three determinations.

^c Results are presented as the known values, expected laboratory precision (1 sigma, 1 determination) and control limits as provided by ERA.

^d Result of reanalysis: 38.3 ± 1.3 pCi/L. Sample dilution problem suspected. A new dilution was prepared.

TABLE D-5

DOE'S MIXED ANALYTE PERFORMANCE EVALUATION PROGRAM (MAPEP)
ENVIRONMENTAL, INC., 2012

(Page 1 of 2)

Lab Code ^d	Date	Analysis	Laboratory result	Concentration ^a		Acceptance
				Known Activity	Control Limits ^c	
STSO-1766	02/01/12	Co-57	1352.10 ± 4.00	1179.00	825.00 - 1533.00	Pass
STSO-1766	02/01/12	Co-60	1.70 ± 0.70	1.56	1.00 - 2.00	Pass
STSO-1766	02/01/12	Cs-134	842.20 ± 4.30	828.00	580.00 - 1076.00	Pass
STSO-1766	02/01/12	Cs-137	0.40 ± 0.90	0.00	0.00 - 1.00	Pass
STSO-1766	02/01/12	K-40	1729.60 ± 22.20	1491.00	1044.00 - 1938.00	Pass
STSO-1766	02/01/12	Mn-54	647.60 ± 4.20	558.00	391.00 - 725.00	Pass
STSO-1766	02/01/12	Sr-90	383.20 ± 15.30	392.00	274.00 - 510.00	Pass
STSO-1766	02/01/12	Zn-65	766.70 ± 6.70	642.00	449.00 - 835.00	Pass
STAP-1772	02/01/12	Co-57	0.010 ± 0.01	0.00	0.000 - 1.00	Pass
STAP-1772	02/01/12	Co-60	2.40 ± 0.08	2.18	1.53 - 2.84	Pass
STAP-1772	02/01/12	Cs-134	2.33 ± 0.13	2.38	1.67 - 3.09	Pass
STAP-1772	02/01/12	Cs-137	2.07 ± 0.10	1.79	1.25 - 2.33	Pass
STAP-1772	02/01/12	Mn-54	3.77 ± 0.14	3.24	2.27 - 4.21	Pass
STAP-1772	02/01/12	Sr-90	-0.010 ± 0.060	0.000	-0.10 - 0.13	Pass
STAP-1772	02/01/12	Zn-65	3.67 ± 0.20	2.99	2.09 - 3.89	Pass
STAP-1773	02/01/12	Gr. Alpha	0.51 ± 0.05	1.20	0.40 - 2.00	Pass
STAP-1773	02/01/12	Gr. Beta	2.75 ± 0.10	2.40	1.20 - 3.60	Pass
STVE-1776	02/01/12	Co-57	14.57 ± 0.28	12.00	8.40 - 15.60	Pass
STVE-1776	02/01/12	Co-60	6.45 ± 0.23	6.05	4.24 - 7.87	Pass
STVE-1776	02/01/12	Cs-134	8.39 ± 0.29	8.43	5.90 - 10.96	Pass
STVE-1776	02/01/12	Cs-137	0.01 ± 0.09	0.00	0.00 - 0.10	Pass
STVE-1776	02/01/12	Mn-54	0.03 ± 0.08	0.00	0.00 - 0.10	Pass
STVE-1776	02/01/12	Zn-65	10.31 ± 0.67	8.90	6.23 - 11.57	Pass
STW-1960	02/01/12	Gr. Alpha	1.68 ± 0.09	2.14	0.64 - 3.64	Pass
STW-1960	02/01/12	Gr. Beta	6.33 ± 0.10	6.36	3.18 - 9.54	Pass
STW-1964	02/01/12	Co-57	33.30 ± 0.40	32.90	23.00 - 42.80	Pass
STW-1964	02/01/12	Co-60	23.20 ± 0.40	23.72	16.60 - 30.84	Pass
STW-1964	02/01/12	Cs-134	0.30 ± 3.00	0.00	0.00 - 1.00	Pass
STW-1964	02/01/12	Cs-137	40.10 ± 0.60	39.90	27.90 - 51.90	Pass
STW-1964	02/01/12	H-3	460.00 ± 12.10	437.00	306.00 - 568.00	Pass
STW-1964	02/01/12	K-40	153.00 ± 4.20	142.00	99.00 - 185.00	Pass
STW-1964	02/01/12	Mn-54	32.70 ± 0.60	31.80	22.30 - 41.30	Pass
STW-1964	02/01/12	Sr-90	0.10 ± 0.20	0.00	0.00 - 1.00	Pass
STW-1964	02/01/12	Zn-65	0.01 ± 0.20	0.00	0.00 - 1.00	Pass

TABLE D-5

DOE'S MIXED ANALYTE PERFORMANCE EVALUATION PROGRAM (MAPEP)
ENVIRONMENTAL, INC., 2012

(Page 2 of 2)

Lab Code ^d	Date	Analysis	Laboratory result	Concentration ^a		Acceptance
				Known Activity	Control Limits ^c	
STSO-5392	08/01/12	Sr-90	483.52 ± 16.47	508.00	356.00 - 660.00	Pass
STSO-5394	08/01/12	Co-57	1528.00 ± 4.10	1316.00	921.00 - 1711.00	Pass
STSO-5394	08/01/12	Co-60	592.00 ± 3.20	531.00	372.00 - 690.00	Pass
STSO-5394	08/01/12	Cs-134	933.60 ± 5.82	939.00	657.00 - 1221.00	Pass
STSO-5394	08/01/12	Cs-137	1319.80 ± 5.50	1150.00	805.00 - 1495.00	Pass
STSO-5394	08/01/12	K-40	737.30 ± 17.70	632.00	442.00 - 822.00	Pass
STSO-5394	08/01/12	Mn-54	1083.20 ± 5.20	920.00	644.00 - 1196.00	Pass
STSO-5394	08/01/12	Zn-65	696.10 ± 7.00	606.00	424.00 - 788.00	Pass
STVE-5395 ^d	08/01/12	Co-57	7.44 ± 0.17	5.66	3.96 - 7.36	Fail
STVE-5395	08/01/12	Co-60	5.90 ± 0.15	5.12	3.58 - 6.66	Pass
STVE-5395	08/01/12	Cs-134	7.40 ± 0.31	6.51	4.56 - 8.46	Pass
STVE-5395	08/01/12	Cs-137	5.45 ± 0.18	4.38	3.07 - 5.69	Pass
STVE-5395	08/01/12	Mn-54	4.06 ± 0.21	3.27	2.29 - 4.25	Pass
STAP-5398	08/01/12	Gr. Alpha	0.41 ± 0.05	0.97	0.29 - 1.65	Pass
STAP-5398	08/01/12	Gr. Beta	2.11 ± 0.09	1.92	0.96 - 2.88	Pass
STAP-5403	08/01/12	Co-57	1.96 ± 0.05	1.91	1.34 - 2.48	Pass
STAP-5403	08/01/12	Co-60	1.76 ± 0.07	1.73	1.21 - 2.25	Pass
STAP-5403	08/01/12	Cs-134	2.74 ± 0.18	2.74	1.92 - 3.56	Pass
STAP-5403	08/01/12	Cs-137	0.00 ± 0.03	0.00	-0.01 - 0.01	Pass
STAP-5403	08/01/12	Mn-54	2.52 ± 0.10	2.36	1.65 - 3.07	Pass
STAP-5403	08/01/12	Zn-65	0.01 ± 0.06	0.00	-0.010 - 0.010	Pass

^a Results are reported in units of Bq/kg (soil), Bq/L (water) or Bq/total sample (filters, vegetation).

^b Laboratory codes as follows: STW (water), STAP (air filter), STSO (soil), STVE (vegetation).

^c MAPEP results are presented as the known values and expected laboratory precision (1 sigma, 1 determination) and control limits as defined by the MAPEP. A known value of "zero" indicates an analysis was included in the testing series as a "false positive". MAPEP does not provide control limits.

^d Result of reanalysis; 6.74 ± 0.15 Bq/sample. Gamma emitters for the vegetation matrix exhibited a high bias, only Co-57 exceeded acceptance limits. Recounted using a geometry more closely matched to the MAPEP sample size.

Intentionally left blank

APPENDIX E

EFFLUENT REPORT

TABLE OF CONTENTS

SUMMARY.....	1
INTRODUCTION	2
1.0. EFFLUENTS.....	3
1.1. Gaseous Effluents to the Atmosphere	3
1.2. Liquids Released to Rock River	3
2.0. SOLID RADIOACTIVE WASTE	4
3.0. DOSE TO MAN.....	4
3.1. Gaseous Effluent Pathways	4
3.1.1. Noble Gases.....	4
3.1.1.1. Gamma Dose Rates.....	4
3.1.1.2. Beta Air and Skin Dose Rate	4
3.1.2. Radioactive Iodine & Particulate	5
3.1.3. Gaseous Total Dose.....	6
3.2. Liquid Effluent Pathways	6
3.3. Total Dose	6
3.4. Assessment of Dose to Member of Public	6
4.0. SITE METEOROLOGY	7

Table of Contents (cont.)

APPENDIX E-1 DATA TABLES AND FIGURES..... E-1.1

 Station Releases

 Table 1.1-1 Gaseous Effluents E-1.2

 Table 1.2-1 Liquid Effluents E-1.4

 Table 3.1-1 Maximum Doses Resulting from Liquid Releases E-1.6

 Table 3.2-1 Maximum Doses Resulting from Airborne Discharges E-1.8

 Table 3.4-1 Maximum Doses Resulting from Airborne Releases Based
 On Concurrent Meteorological Data E-1.12

SUMMARY

Calculations based on gaseous and liquid effluents and meteorological data indicate that public dose due to radioactive material attributable to Byron Station during the period does not exceed regulatory or Offsite Dose Calculation Manual (ODCM) limits.

The Total Effective Dose Equivalent (TEDE) due to licensed activities at Byron Station calculated for the maximum exposed individual for the period is **2.75E-01** mrem. The annual limit on TEDE is 100 mrem.

The assessment of radiation doses to the public is performed in accordance with the ODCM. The results of these analyses confirm that the station is operating in compliance with 10CFR50 Appendix I, 10CFR20 and 40CFR190.

There were no additional operational controls implemented which affected the areas of radiological effluents in 2012.

There were no measurements which exceeded the reporting levels, including any which would not have been attributable to station effluents.

The results of the current radiological environmental monitoring program are approximately the same as those found during the pre-operational studies conducted at Byron Station.

INTRODUCTION

Liquid effluents from Byron Station are released to the Rock River in controlled batches after radioassay of each batch. Gaseous effluents are released to the atmosphere and are calculated on the basis of analyses of weekly grab samples and grab samples of batch releases prior to the release of noble gases as well as continuously collected composite samples of iodine and particulate radioactivity sampled during the course of the year. The results of effluent analyses are summarized on a monthly basis. Airborne concentrations of noble gases, I-131, and particulate radioactivity in offsite areas are calculated using isotopic composition of effluents and meteorological data. C-14 concentration in offsite areas is calculated based on industry-approved methodology for estimation of the amount released and meteorological data.

Environmental monitoring is conducted by sampling at indicator and control (background) locations in the vicinity of Byron Station to measure changes in radiation or radioactivity levels that may be attributable to station operation. If significant changes attributable to Byron Station are measured, these changes are correlated with effluent releases. An environmental monitoring program is conducted which also includes all potential pathways at the site. Gaseous pathways include ground plane (direct), inhalation, vegetation, meat, and milk. Liquid pathways include potable water and freshwater fish. The critical pathway for 2012 gaseous dose was vegetation. The critical pathway for 2012 liquid dose was freshwater fish.

1.0 EFFLUENTS

1.1 Gaseous Effluents to the Atmosphere

Measured concentrations and isotopic composition of noble gases, radioiodine, tritium and particulate radioactivity released to the atmosphere during the year are listed in Table 1.1-1.

A total of $1.98\text{E}+02$ curies of fission and activation gases were released with a maximum average quarterly release rate of $2.51\text{E}+01$ $\mu\text{Ci}/\text{sec}$.

A total of $1.37\text{E}-05$ curies of 1-131 were released during the year with a maximum average quarterly release rate of $1.59\text{E}-06$ $\mu\text{Ci}/\text{sec}$.

A total of $1.13\text{E}-06$ curies were released as airborne particulate matter with a maximum average quarterly release rate of $1.43\text{E}-07$ $\mu\text{Ci}/\text{sec}$.

A total of $8.47\text{E}+00$ curies of other (C-14) radioisotopes were released with a maximum average quarterly release rate of $2.89\text{E}-01$ $\mu\text{Ci}/\text{sec}$.

A total of $5.56\text{E}+01$ curies of tritium were released with a maximum average quarterly release rate of $2.20\text{E}+00$ $\mu\text{Ci}/\text{sec}$.

Gross alpha-emitting radionuclides were below detectable limits.

1.2 Liquids Released to Rock River

A total of $2.60\text{E}+10$ liters of radioactive liquid wastes containing $1.79\text{E}-02$ curies of fission and activation products were discharged with a maximum quarterly average concentration of $1.95\text{E}-09$ $\mu\text{Ci}/\text{ml}$.

A total of $2.68\text{E}+03$ curies of tritium were discharged with a maximum quarterly average concentration of $3.34\text{E}-04$ uCi/ml .

A total of $3.06\text{E}-03$ curies of dissolved and entrained gases were discharged with a maximum quarterly average concentration of $6.88\text{E}-10$ uCi/ml .

Gross alpha-emitting radionuclides were below detectable limits.

Quarterly release totals of principal radionuclides in liquid effluents are given in Table 1.2-1.

2.0 SOLID RADIOACTIVE WASTE

Solid radioactive wastes were shipped by truck. For detail, refer to Byron Station 2012 Annual Radiological Effluent Release Report.

3.0 DOSE TO MAN

3.1 Gaseous Effluent Pathways

Table 3.1-1 summarizes the doses resulting from releases of airborne radioactivity via the different exposure pathways.

3.1.1 Noble Gases

3.1.1.1 Gamma Dose Rates

Offsite Gamma air and whole body dose rates are shown in Table 3.1-1 and were calculated based on measured release rates, isotopic composition of the noble gases, and average meteorological data for the period. Dose rates based on concurrent meteorological data are shown in Table 3.4-1. Based on measured effluents and average meteorological data, the maximum gamma air dose was 1.83E-03 mrad based on measured effluents and average meteorological data, and 4.42E-04 mrad based on measured effluents and concurrent meteorological data. (Table 3.4-1).

3.1.1.2 Beta Air and Skin Dose Rates

The range of beta particles in air is relatively small (on the order of a few meters or less); consequently, plumes of gaseous effluents may be considered "semi-infinite" for purpose of calculating the dose from beta radiation incident on the skin. However, the actual dose to sensitive skin tissues is difficult to calculate due to the effect of the beta particle energies, thickness of inert skin and clothing covering sensitive tissues. For purposes of this report the skin is taken to have a

thickness of 7.0 mg/cm^2 and an occupancy factor of 1.0 is used. The skin dose based on measured effluents and average meteorological data was $2.21\text{E-}04$ mrem, and $1.66\text{E-}03$ mrem based on measured effluents and concurrent meteorological data.

The maximum offsite beta air dose for the year based on measured effluents and average meteorological data was $3.14\text{E-}03$ mrad. The beta air dose based on measured effluents and concurrent meteorological data was $3.08\text{E-}03$ mrad.

3.1.2 Radioactive Iodine & Particulate

The human thyroid exhibits a significant capacity to concentrate ingested or inhaled iodine. I-131 released during routine operation of the station may be made available to man resulting in a dose to the thyroid. C-14 is also included in this category. C-14 exhibits a capacity to concentrate in bone. C-14 is released in gaseous form and is absorbed into vegetation through photosynthesis. The principal pathways of interest for C-14 are the consumption of vegetation by humans and milk from which animals have ingested C-14 through the consumption of vegetation. With the addition of C-14 to plant effluents, human dose in this category is primarily driven by the release of C-14 from the plant.

The hypothetical dose to the maximum exposed individual living near the station via ingestion of milk and vegetation was calculated. The source of milk and vegetation was assumed to be at the nearest site boundary with the cows pastured and vegetation grown from May through October. The maximum dose from radioactive iodine and particulate (including C-14) to any organ was $6.90\text{E-}01$ mrem (child/bone) based on measured effluents and average meteorological data and $8.63\text{E-}01$ mrem based on measured effluents and concurrent meteorological data. The maximum dose from radioactive iodine and particulate (including C-14) to the whole body was $1.41\text{E-}01$ mrem (child) based on measured effluents and average meteorological data and $1.77\text{E-}01$ mrem based on measured effluents and concurrent meteorological data.

3.1.3 Gaseous Total Dose

The maximum total dose from gaseous releases to any organ was 6.90E-01 mrem (child/bone) based on measured effluents and average meteorological data, and 8.63E-01 mrem (child/bone) based on measured effluents and concurrent meteorological data. The maximum total dose from gaseous releases to the whole body was 1.41E-01 mrem (child) based on measured effluents and average meteorological data, and 1.77E-01 mrem (child) based on measured effluents and concurrent meteorological data.

3.2 Liquid Effluent Pathways

The principal pathways through the aquatic environment for potential doses to man from liquid waste are ingestion of potable water and eating aquatic foods. Liquid dose was calculated based on the ingestion of potable water and sport fish. It should be noted, however, there were no communities within 10 km downstream of the plant using the Rock River for drinking water. NRC-developed equations were used to calculate the doses to the whole body, bone, liver, thyroid, kidney, lung, lower GI tract, and skin. Specific parameters for use in the equations are given in the Exelon Offsite Dose Calculation Manual (ODCM). The maximum dose from liquid releases to any organ was 2.75E-01 mrem (adult/gilli). The maximum dose from liquid releases to the whole body was 1.61E-01 mrem (adult).

3.3 Total Dose

The maximum total dose to any organ via both gaseous and liquid effluents to any organ is 7.10E-01 mrem (child/bone). The maximum dose to the whole body via both gaseous and liquid effluents is 2.75E-01 mrem (child).

3.4 Assessment of Dose to Member of Public

Byron Station did not exceed any of the dose limits as shown below based on concurrent or historical meteorological data.

- The RETS limits on dose or dose commitment to a member of the public due to radioactive materials in liquid effluents from each reactor is 1.5 mrem to the whole body or 5 mrem to any organ

during any calendar quarter and 3 mrem to the whole body or 10 mrem to any organ during a calendar year.

- The RETS limits on air dose in noble gases released in gaseous effluents to a member of the public from each reactor is 5 mrad for gamma radiation or 10 mrad for beta radiation during any calendar quarter and 10 mrad for gamma radiation or 20 mrad for beta radiation during a calendar year.
- The RETS limits on dose to a member of the public due to radioactive iodine & particulate with half-lives greater than eight days in gaseous effluents released from each reactor is 7.5 mrem to any organ during any calendar quarter and 15 mrem during a calendar year.
- The 10CFR20 limit on Total Effective Dose Equivalent to individual members of the public is 100 mrem during a calendar year.

4.0 SITE METEOROLOGY

Detailed records of the site meteorological measurements taken during each calendar quarter of the year are maintained by the meteorological vendor, retained on site, and are available upon request. The data are presented as cumulative joint frequency distributions of the wind direction for the 250' level and wind speed class by atmospheric stability class determined from the temperature difference between the 250' and 30' levels. Data recovery for all measurements on the meteorological tower was 99.7% during 2012.

Intentionally left blank

APPENDIX E-1

DATA TABLES AND FIGURES

Table 1.1-1

EFFLUENT AND WASTE DISPOSAL REPORT
 TABLE 1A
 GASEOUS EFFLUENTS - SUMMATION OF ALL RELEASES
 Unit 1

REPORT FOR 2012	Units	QTR 1	QTR 2	QTR 3	QTR 4	YEAR
Fission and Activation Gases						
1. Total Release	Ci	3.89E-01	1.97E+02	4.02E-01	4.08E-02	1.97E+02
2. Avg. Release Rate	uCi/sec	4.95E-02	2.50E+01	5.06E-02	5.13E-03	6.24E+00
Iodine-131						
1. Total Release	Ci	6.54E-07	1.16E-07	4.73E-06	8.27E-09	5.51E-06
2. Avg. Release Rate	uCi/sec	8.32E-08	1.48E-08	5.96E-07	1.04E-09	1.74E-07
Particulates Half Life >= 8 days						
1. Total Release	Ci	(1)	(1)	(1)	(1)	(1)
2. Avg. Release Rate	uCi/sec	(1)	(1)	(1)	(1)	(1)
Others						
1. Total Release	Ci	1.03E+00	1.09E+00	7.91E-01	1.06E+00	3.98E+00
2. Avg. Release Rate	uCi/sec	1.32E-01	1.39E-01	9.95E-02	1.33E-01	1.26E-01
Tritium						
1. Total Release	Ci	7.36E+00	4.47E+00	2.05E+00	3.74E+00	1.76E+01
2. Avg. Release Rate	uCi/sec	9.36E-01	5.68E-01	2.58E-01	4.70E-01	5.57E-01
Gross Alpha Radioactivity						
1. Total Release	Ci	(1)	(1)	(1)	(1)	(1)
2. Avg. Release Rate	uCi/sec	(1)	(1)	(1)	(1)	(1)

(1) Less than minimum detectable activity which meets the lower limit of detection (LLD) requirements of TRM Section 3.11

Table 1.1-1 (cont.)

EFFLUENT AND WASTE DISPOSAL REPORT
 TABLE 1A
 GASEOUS EFFLUENTS - SUMMATION OF ALL RELEASES
 Unit 2

REPORT FOR 2012	Units	QTR 1	QTR 2	QTR 3	QTR 4	YEAR
Fission and Activation Gases						
1. Total Release	Ci	3.91E-01	5.79E-02	2.86E-01	4.31E-02	7.78E-01
2. Avg. Release Rate	uCi/sec	4.98E-02	7.36E-03	3.60E-02	5.42E-03	2.46E-02
Iodine-131						
1. Total Release	Ci	(1)	(1)	7.92E-06	3.03E-07	8.22E-06
2. Avg. Release Rate	uCi/sec	(1)	(1)	9.96E-07	3.82E-08	2.60E-07
Particulates Half Life >= 8 days						
1. Total Release	Ci	1.13E-06	(1)	(1)	(1)	1.13E-06
2. Avg. Release Rate	uCi/sec	1.43E-07	(1)	(1)	(1)	3.56E-08
Others						
1. Total Release	Ci	9.85E-01	1.14E+00	1.13E+00	1.24E+00	4.49E+00
2. Avg. Release Rate	uCi/sec	1.25E-01	1.45E-01	1.42E-01	1.56E-01	1.42E-01
Tritium						
1. Total Release	Ci	9.93E+00	8.79E+00	1.26E+01	6.60E+00	3.80E+01
2. Avg. Release Rate	uCi/sec	1.26E+00	1.12E+00	1.59E+00	8.30E-01	1.20E+00
Gross Alpha Radioactivity						
1. Total Release	Ci	(1)	(1)	(1)	(1)	(1)
2. Avg. Release Rate	uCi/sec	(1)	(1)	(1)	(1)	(1)

(1) Less than minimum detectable activity which meets the lower limit of detection (LLD) requirements of TRM Section 3.11

Table 1.2-1

EFFLUENT AND WASTE DISPOSAL REPORT
 TABLE 2A
 LIQUID EFFLUENTS - SUMMATION OF ALL RELEASES
 Unit 1

REPORT FOR 2012	Units	QTR 1	QTR 2	QTR 3	QTR 4	YEAR
Fission and Activation Products						
1. Total Release	Ci	1.87E-03	2.29E-03	3.12E-03	1.68E-03	8.96E-03
2. Avg. Diluted Conc.	uCi/ml	5.99E-10	6.76E-10	9.74E-10	5.14E-10	6.90E-10
Tritium						
1. Total Release	Ci	5.22E+02	2.16E+02	5.20E+02	7.74E+01	1.34E+03
2. Avg. Diluted Conc.	uCi/ml	1.67E-04	6.39E-05	1.62E-04	2.36E-05	1.03E-04
Dissolved and Entrained Gases						
1. Total Release	Ci	4.21E-04	9.93E-06	1.10E-03	(1)	1.53E-03
2. Avg. Diluted Conc.	uCi/ml	1.35E-10	2.94E-12	3.44E-10	(1)	1.18E-10
Gross Alpha Radioactivity						
1. Total Release	Ci	(1)	(1)	(1)	(1)	(1)
2. Avg. Diluted Conc.	uCi/ml	(1)	(1)	(1)	(1)	(1)
Volume of liquid waste	liters	3.12E+09	3.38E+09	3.20E+09	3.27E+09	1.30E+10

(1) Less than minimum detectable activity which meets the lower limit of detection (LLD) requirements of TRM Section 3.11

Table 1.2-1 (cont.)

EFFLUENT AND WASTE DISPOSAL REPORT
TABLE 2A
LIQUID EFFLUENTS - SUMMATION OF ALL RELEASES
Unit 2

REPORT FOR 2012	Units	QTR 1	QTR 2	QTR 3	QTR 4	YEAR
Fission and Activation Products						
1. Total Release	Ci	1.87E-03	2.29E-03	3.12E-03	1.68E-03	8.96E-03
2. Avg. Diluted Conc.	uCi/ml	5.99E-10	6.76E-10	9.74E-10	5.14E-10	6.90E-10
Tritium						
1. Total Release	Ci	5.22E+02	2.16E+02	5.20E+02	7.74E+01	1.34E+03
2. Avg. Diluted Conc.	uCi/ml	1.67E-04	6.39E-05	1.62E-04	2.36E-05	1.03E-04
Dissolved and Entrained Gases						
1. Total Release	Ci	4.21E-04	9.93E-06	1.10E-03	(1)	1.53E-03
2. Avg. Diluted Conc.	uCi/ml	1.35E-10	2.94E-12	3.44E-10	(1)	1.18E-10
Gross Alpha Radioactivity						
1. Total Release	Ci	(1)	(1)	(1)	(1)	(1)
2. Avg. Diluted Conc.	uCi/ml	(1)	(1)	(1)	(1)	(1)
Volume of liquid waste	liters	3.12E+09	3.38E+09	3.20E+09	3.27E+09	1.30E+10

(1) Less than minimum detectable activity which meets the lower limit of detection (LLD) requirements of TRM Section 3.11

Table 3.1-1

40CFR190 URANIUM FUEL CYCLE DOSE REPORT

LIQUID DOSE SUMMARY

Unit 1 & 2

Report for: 2012
 Release ID: 1 All Liquid Releases
 Liquid Receptor

==== PERIOD DOSE BY ORGAN AND AGE GROUP (mrem) ===== ANNUAL 2012 =====

	Bone	Liver	Thyroid	Kidney	Lung	GI-Lli	Skin	TB
ADULT	1.50E-02	1.62E-01	1.56E-01	1.59E-01	1.56E-01	2.75E-01	0.00E+00	1.61E-01
TEEN	1.56E-02	1.23E-01	1.17E-01	1.18E-01	1.17E-01	2.01E-01	0.00E+00	1.21E-01
CHILD	2.03E-02	1.35E-01	1.30E-01	1.31E-01	1.30E-01	1.60E-01	0.00E+00	1.34E-01
INFANT	1.01E-04	5.76E-02	5.76E-02	5.76E-02	5.76E-02	5.77E-02	0.00E+00	5.77E-02

==== SITE DOSE LIMIT ANALYSIS =====

Period - Limit	Age Group	Organ	Dose (mrem)	Limit (mrem)	Max % of Limit
2012 - Admin. Any Organ	ADULT	GILLI	2.75E-01	7.50E+00	3.67E+00
2012 - Admin. Total Body	ADULT	TBODY	1.61E-01	2.25E+00	7.14E+00
2012 - T.Spec Any Organ	ADULT	GILLI	2.75E-01	1.00E+01	2.75E+00

Critical Pathway: Fresh Water Fish - Sport (FFSP)

Major Contributors (0% or greater to total)

Nuclide	Percentage
H-3	5.64E+01
CR-51	4.81E-02
MN-54	5.50E-01
FE-59	7.99E-02
CO-58	2.02E+00
CO-60	3.45E+00
NI-63	6.77E-02
ZN-65	1.34E-01
ZR-95	1.00E-03
NB-95	3.64E+01
TE-125M	8.08E-01
I-132	2.29E-06
I-133	2.94E-05
CS-134	2.00E-02

2012 - T.Spec Total Body	ADULT	TBODY	1.61E-01	3.00E+00	5.35E+00
--------------------------	-------	-------	----------	----------	----------

Critical Pathway: Fresh Water Fish - Sport (FFSP)

Major Contributors (0% or greater to total)

Nuclide	Percentage
H-3	9.68E+01
CR-51	3.28E-04
MN-54	5.87E-02
FE-59	1.57E-02
CO-58	3.83E-01
CO-60	6.93E-01
NI-63	2.69E-01
ZN-65	1.65E-01

Table 3.1-1 (Cont.)
40CFR190 URANIUM FUEL CYCLE DOSE REPORT

LIQUID DOSE SUMMARY

Unit 1 & 2

Report for: 2012
Release ID: 1 All Liquid Releases
Liquid Receptor

Nuclide	Percentage
-----	-----
ZR-95	3.66E-07
NB-95	5.53E-03
TE-125M	4.65E-02
I-132	7.33E-06
I-133	1.71E-05
CS-134	1.61E+00

Table 3.1-1 (Cont.)
 40CFR190 URANIUM FUEL CYCLE DOSE REPORT

 GASEOUS DOSE SUMMARY

Unit 1 & 2

Report for: 2012
 Unit Range - From: 1 To: 2

Annual - Limit	Age Group	Organ	Dose (mrem)	Limit (mrem)	Max % of Limit
==== I&P DOSE LIMIT ANALYSIS ===== ANNUAL 2012 =====					
2012 - Admin. Any Organ	CHILD	BONE	6.90E-01	1.13E+01	6.13E+00
2012 - Admin. Total Body	CHILD	TBODY	1.41E-01	1.05E+01	1.34E+00
2012 - T.Spc. Any Organ	CHILD	BONE	6.90E-01	1.50E+01	4.60E+00
Receptor: 5 Composite Crit. Receptor - IP					
Distance: 800 (meters) Compass Point: SSE					
Critical Pathway: Vegetation					
Major Contributors (0% or greater to total)					
Nuclide	Percentage				
-----	-----				
H-3	0.00E+00				
C-14	1.00E+02				
CO-58	7.39E-06				
I-131	3.53E-04				
I-132	2.92E-06				
2012 - T.Spc. Total Body	CHILD	TBODY	1.41E-01	1.50E+01	9.40E-01
Receptor: 5 Composite Crit. Receptor - IP					
Distance: 800 (meters) Compass Point: SSE					
Critical Pathway: Vegetation					
Major Contributors (0% or greater to total)					
Nuclide	Percentage				
-----	-----				
H-3	2.22E+00				
C-14	9.78E+01				
CO-58	6.33E-05				
I-131	9.94E-04				
I-132	1.40E-05				

Table 3.1-1 (Cont.)
 40CFR190 URANIUM FUEL CYCLE DOSE REPORT

 GASEOUS DOSE SUMMARY

Unit 1 & 2

Report for: 2012
 Unit Range - From: 1 To: 2

Annual - Limit	Dose (mrad)	Limit (mrad)	Max % of Limit

2012 - Admin. Gamma	1.83E-03	7.50E+00	2.45E-02
2012 - Admin. Beta	3.14E-03	1.50E+01	2.09E-02
2012 - T.Spc. Gamma	1.83E-03	1.00E+01	1.83E-02
Receptor: 4 Composite Crit. Receptor - NG			
Distance: 800 (meters) Compass Point: SSE			
Nuclide	Percentage		

AR-41	1.17E+00		
KR-85M	7.93E-04		
XE-135	2.13E-02		
XE-133M	4.55E-03		
XE-131M	9.70E+01		
XE-133	1.82E+00		
2012 - T.Spc. Beta	3.14E-03	2.00E+01	1.57E-02
Receptor: 4 Composite Crit. Receptor - NG			
Distance: 800 (meters) Compass Point: SSE			
Nuclide	Percentage		

AR-41	5.92E-02		
KR-85M	1.83E-04		
XE-135	3.93E-03		
XE-133M	2.96E-03		
XE-131M	9.92E+01		
XE-133	7.76E-01		

Table 3.1-1 (Cont.)
 40CFR190 URANIUM FUEL CYCLE DOSE REPORT

 Unit 1 & 2

Report for: 2012
 Unit Range - From: 1 To: 2

==== MAXIMUM DOSE ANALYSIS ===== ANNUAL 2012 =====

Dose Type	Age Group	Organ	Dose (mrem)
-----	-----	-----	-----
Any Organ	CHILD	BONE	7.10E-01
Liquid Receptor: 0	Liquid Receptor		
Gaseous Receptor: 5	Composite Crit. Receptor - IP		
Distance: 800 (meters)	Compass Point: SSE		

Liquid Dose: 2.03E-02 % of Total: 2.85E+00
 Critical Pathway: Fresh Water Fish - Sport (FFSP)
 Major Contributors (0% or greater to total)

Nuclide	Percentage
-----	-----
H-3	0.00E+00
CR-51	0.00E+00
MN-54	0.00E+00
FE-59	1.74E-01
CO-58	0.00E+00
CO-60	0.00E+00
NI-63	8.69E+01
ZN-65	8.46E-01
ZR-95	1.86E-05
NB-95	1.74E-01
TE-125M	3.85E+00
I-132	8.24E-05
I-133	3.60E-04
CS-134	8.09E+00

Gaseous Dose: 6.90E-01 % of Total: 9.72E+01
 Critical Pathway: Vegetation (VEG)
 Major Contributors (0% or greater to total)

Nuclide	Percentage
-----	-----
H-3	0.00E+00
C-14	1.00E+02
CO-58	7.39E-06
I-131	3.53E-04
I-132	2.92E-06

Table 3.1-1 (Cont.)
 40CFR190 URANIUM FUEL CYCLE DOSE REPORT

 Unit 1 & 2

=== MAXIMUM DOSE ANALYSIS ===== ANNUAL 2012 =====

Dose Type	Age Group	Organ	Dose (mrem)

Total Body	CHILD	TBODY	2.75E-01
Liquid Receptor: 0	Liquid Receptor		
Gaseous Receptor: 5	Composite Crit. Receptor - IP		
Distance: 800 (meters)	Compass Point: SSE		

Liquid Dose: 1.34E-01 % of Total: 4.86E+01
 Critical Pathway: Fresh Water Fish - Sport (FFSP)
 Major Contributors (0% or greater to total)

Nuclide	Percentage

H-3	9.73E+01
CR-51	4.34E-04
MN-54	7.59E-02
FE-59	2.12E-02
CO-58	5.04E-01
CO-60	9.13E-01
NI-63	4.48E-01
ZN-65	2.13E-01
ZR-95	5.51E-07
NB-95	7.35E-03
TE-125M	7.78E-02
I-132	1.06E-05
I-133	2.55E-05
CS-134	4.25E-01

Gaseous Dose: 1.41E-01 % of Total: 5.13E+01
 Critical Pathway: Vegetation (VEG)
 Major Contributors (0% or greater to total)

Nuclide	Percentage

H-3	2.22E+00
C-14	9.78E+01
CO-58	6.33E-05
I-131	9.94E-04
I-132	1.40E-05

Table 3.4-1

The following are the maximum annual calculated cumulative offsite doses resulting from Byron airborne releases in 2012 based on concurrent meteorological data:

Unit 1:

<u>Dose</u>	<u>Maximum Value</u>	<u>Sector Affected</u>
gamma air ⁽¹⁾	4.360 x 10 ⁻⁴ mrad	North-Northwest
beta air ⁽²⁾	3.070 x 10 ⁻³ mrad	North-Northwest
whole body ⁽³⁾	8.261 x 10 ⁻² mrem	North-Northwest
skin ⁽⁴⁾	1.650 x 10 ⁻³ mrem	North-Northwest
organ ⁽⁵⁾ (child-bone)	4.057 x 10 ⁻¹ mrem	North-Northwest

Unit 1 Compliance Status

10 CFR 50 Appendix I	Yearly Objective		% of Appendix I
gamma air	10.0	mrad0.00	
beta air	20.0	mrad0.02	
whole body	5.0	mrem	1.65
skin	15.0	mrem	0.01
organ	15.0	mrem	2.70

Unit 2:

<u>Dose</u>	<u>Maximum Value</u>	<u>Sector Affected</u>
gamma air ⁽¹⁾	5.870 x 10 ⁻⁶ mrad	North-Northwest
beta air ⁽²⁾	1.190 x 10 ⁻⁵ mrad	North-Northwest
whole body ⁽³⁾	9.440 x 10 ⁻² mrem	North-Northwest
skin ⁽⁴⁾	8.470 x 10 ⁻⁶ mrem	North-Northwest
organ ⁽⁵⁾ (child-bone)	4.565 x 10 ⁻¹ mrem	North-Northwest

Unit 2 Compliance Status

10 CFR 50 Appendix I	Yearly Objective		% of Appendix I
gamma air	10.0	mrad0.00	
beta air	20.0	mrad0.00	
whole body	5.0	mrem	1.89
skin	15.0	mrem	0.00
organ	15.0	mrem	3.04

(1) Gamma Air Dose - GASPAR II, NUREG-0597
 (2) Beta Air Dose - GASPAR II, NUREG-0597
 (3) Whole Body Dose - GASPAR II, NUREG-0597
 (4) Skin Dose - GASPAR II, NUREG-0597
 (5) Inhalation and Food Pathways Dose - GASPAR II, NUREG-0597

Intentionally left blank

APPENDIX F

METEOROLOGICAL DATA

Byron Generating Station

Period of Record: January - March 2012
 Stability Class - Extremely Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	0	0	0	0
SSW	0	0	0	0	0	0	0
SW	0	0	0	0	0	0	0
WSW	0	0	0	0	0	0	0
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	1	0	0	0	0	1
Variable	0	0	0	0	0	0	0
Total	0	1	0	0	0	0	1

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 24

Byron Generating Station

Period of Record: January - March 2012
 Stability Class - Moderately Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	1	0	0	0	1
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	0	0	0	0
SSW	0	0	0	0	0	0	0
SW	0	0	0	0	0	0	0
WSW	0	0	0	0	0	0	0
W	0	0	0	0	0	0	0
WNW	0	1	0	1	0	0	2
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	1	1	1	0	0	3

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 24

Byron Generating Station

Period of Record: January - March 2012
 Stability Class - Slightly Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	3	0	0	0	0	3
NE	0	0	1	0	0	0	1
ENE	0	0	2	0	0	0	2
E	0	0	3	0	0	0	3
ESE	0	0	2	0	0	0	2
SE	0	0	0	1	0	0	1
SSE	0	0	0	0	0	0	0
S	0	0	2	3	2	0	7
SSW	0	0	1	3	0	0	4
SW	0	0	1	1	2	0	4
WSW	0	0	0	0	0	0	0
W	0	0	0	0	3	0	3
WNW	0	0	0	5	0	0	5
NW	0	0	1	8	1	0	10
NNW	0	0	3	0	0	0	3
Variable	0	0	0	0	0	0	0
Total	0	3	16	21	8	0	48

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 24

Byron Generating Station

Period of Record: January - March 2012
 Stability Class - Neutral - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	17	36	5	2	0	60
NNE	2	17	14	1	0	0	34
NE	0	12	21	14	0	0	47
ENE	1	19	20	4	0	0	44
E	5	21	24	0	0	0	50
ESE	3	6	12	2	0	0	23
SE	2	10	16	20	0	0	48
SSE	1	8	37	23	7	0	76
S	0	9	49	37	8	1	104
SSW	1	14	27	19	15	2	78
SW	4	15	29	11	6	0	65
WSW	4	17	38	24	7	3	93
W	6	20	43	48	21	1	139
WNW	1	29	68	46	18	2	164
NW	1	21	48	47	4	0	121
NNW	1	22	23	13	0	0	59
Variable	0	0	0	0	0	0	0
Total	32	257	505	314	88	9	1205

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 24

Byron Generating Station

Period of Record: January - March 2012
 Stability Class - Slightly Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	7	1	0	0	0	8
NNE	3	4	0	0	0	0	7
NE	2	2	3	3	0	0	10
ENE	1	7	6	0	0	0	14
E	4	12	5	1	0	0	22
ESE	3	12	6	9	1	0	31
SE	4	15	16	13	0	0	48
SSE	1	11	59	29	3	0	103
S	5	17	42	28	2	0	94
SSW	6	14	15	15	3	0	53
SW	9	28	20	5	0	0	62
WSW	2	10	26	5	0	0	43
W	9	22	42	9	1	0	83
WNW	5	30	22	2	0	0	59
NW	10	19	8	0	0	0	37
NNW	4	19	5	0	0	0	28
Variable	0	0	0	0	0	0	0
Total	68	229	276	119	10	0	702

Hours of calm in this stability class: 2
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 24

Byron Generating Station

Period of Record: January - March 2012
 Stability Class - Moderately Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	3	0	0	0	0	4
NNE	0	2	0	0	0	0	2
NE	1	1	0	0	0	0	2
ENE	2	0	0	0	0	0	2
E	2	3	0	0	0	0	5
ESE	3	8	4	0	0	0	15
SE	4	14	8	0	0	0	26
SSE	1	13	7	0	0	0	21
S	3	16	5	0	0	0	24
SSW	2	11	4	0	0	0	17
SW	3	4	0	0	0	0	7
WSW	2	2	0	0	0	0	4
W	2	0	0	0	0	0	2
WNW	1	0	0	0	0	0	1
NW	8	4	0	0	0	0	12
NNW	1	1	0	0	0	0	2
Variable	0	0	0	0	0	0	0
Total	36	82	28	0	0	0	146

Hours of calm in this stability class: 1
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 24

Byron Generating Station

Period of Record: January - March 2012
 Stability Class - Extremely Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	0	0	0	0	0	1
NNE	0	0	0	0	0	0	0
NE	0	1	0	0	0	0	1
ENE	0	1	0	0	0	0	1
E	2	1	0	0	0	0	3
ESE	2	2	2	0	0	0	6
SE	2	4	2	0	0	0	8
SSE	1	3	3	0	0	0	7
S	1	7	1	0	0	0	9
SSW	3	0	0	0	0	0	3
SW	1	0	0	0	0	0	1
WSW	1	0	0	0	0	0	1
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	2	1	0	0	0	0	3
NNW	4	0	0	0	0	0	4
Variable	3	0	0	0	0	0	3
Total	23	20	8	0	0	0	51

Hours of calm in this stability class: 1
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 24

Byron Generating Station

Period of Record: January - March 2012
 Stability Class - Extremely Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	0	0	0	0
SSW	0	0	0	0	0	0	0
SW	0	0	0	0	0	0	0
WSW	0	0	0	0	0	0	0
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	1	0	0	0	0	1
Variable	0	0	0	0	0	0	0
Total	0	1	0	0	0	0	1

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 24

Byron Generating Station

Period of Record: January - March 2012
 Stability Class - Moderately Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	1	0	0	1
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	0	0	0	0
SSW	0	0	0	0	0	0	0
SW	0	0	0	0	0	0	0
WSW	0	0	0	0	0	0	0
W	0	0	0	0	0	0	0
WNW	0	1	0	0	1	0	2
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	1	0	1	1	0	3

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 24

Byron Generating Station

Period of Record: January - March 2012
 Stability Class - Slightly Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	1	1	0	0	0	2
NE	0	0	1	0	0	0	1
ENE	0	0	0	2	0	0	2
E	0	0	1	3	0	0	4
ESE	0	0	0	2	0	0	2
SE	0	0	0	0	1	0	1
SSE	0	0	0	0	0	0	0
S	0	0	0	4	1	2	7
SSW	0	0	0	2	2	0	4
SW	0	0	0	2	0	2	4
WSW	0	0	0	0	0	0	0
W	0	0	0	0	0	3	3
WNW	0	0	0	2	2	3	7
NW	0	0	0	2	5	2	9
NNW	0	0	0	2	0	0	2
Variable	0	0	0	0	0	0	0
Total	0	1	3	21	11	12	48

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 24

Byron Generating Station

Period of Record: January - March 2012
 Stability Class - Neutral - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	2	3	26	17	7	2	57
NNE	0	9	11	18	1	0	39
NE	1	4	14	18	10	0	47
ENE	2	9	13	15	6	0	45
E	1	9	24	19	1	0	54
ESE	1	7	7	5	2	1	23
SE	1	5	6	4	13	6	35
SSE	1	4	18	28	24	11	86
S	1	5	16	45	24	11	102
SSW	0	3	21	19	18	18	79
SW	1	8	17	25	9	11	71
WSW	4	5	32	30	14	8	93
W	3	13	31	31	42	14	134
WNW	0	20	31	48	38	21	158
NW	0	7	14	49	46	9	125
NNW	1	10	20	16	10	0	57
Variable	0	0	0	0	0	0	0
Total	19	121	301	387	265	112	1205

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 24

Byron Generating Station

Period of Record: January - March 2012
 Stability Class - Slightly Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	0	5	3	0	0	9
NNE	0	0	2	3	0	0	5
NE	1	1	2	3	2	0	9
ENE	0	3	1	3	3	0	10
E	0	6	12	8	2	0	28
ESE	0	2	10	6	2	8	28
SE	1	0	9	7	14	12	43
SSE	0	0	8	12	38	22	80
S	0	1	8	26	34	22	91
SSW	0	3	11	19	24	10	67
SW	0	1	16	22	17	2	58
WSW	2	2	9	31	11	0	55
W	0	6	18	36	14	1	75
WNW	1	2	16	44	6	0	69
NW	0	5	23	18	0	0	46
NNW	1	4	15	10	1	0	31
Variable	0	0	0	0	0	0	0
Total	7	36	165	251	168	77	704

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 24

Byron Generating Station

Period of Record: January - March 2012
 Stability Class - Moderately Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	2	2	2	0	0	6
NNE	1	0	2	3	0	0	6
NE	0	2	0	0	0	0	2
ENE	1	2	0	0	0	0	3
E	0	3	1	0	0	0	4
ESE	1	5	0	0	1	0	7
SE	0	0	4	10	3	0	17
SSE	0	0	4	3	8	1	16
S	0	3	2	3	1	3	12
SSW	1	1	4	8	8	0	22
SW	0	1	3	13	0	0	17
WSW	0	0	8	4	0	0	12
W	0	0	3	2	0	0	5
WNW	1	0	3	0	0	0	4
NW	0	2	1	1	0	0	4
NNW	1	2	4	2	1	0	10
Variable	0	0	0	0	0	0	0
Total	6	23	41	51	22	4	147

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 24

Byron Generating Station

Period of Record: January - March 2012
 Stability Class - Extremely Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	1	0	0	0	1
NNE	0	0	0	0	0	0	0
NE	2	0	0	0	0	0	2
ENE	0	0	0	0	0	0	0
E	0	1	2	0	0	0	3
ESE	0	3	3	0	1	0	7
SE	0	1	2	1	2	0	6
SSE	0	0	0	5	0	2	7
S	0	0	1	0	0	2	3
SSW	0	0	2	2	4	0	8
SW	0	2	1	1	0	0	4
WSW	0	0	2	0	0	0	2
W	0	1	3	0	0	0	4
WNW	0	1	0	0	0	0	1
NW	0	0	0	0	0	0	0
NNW	0	1	2	1	0	0	4
Variable	0	0	0	0	0	0	0
Total	2	10	19	10	7	4	52

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 24

Byron Generating Station

Period of Record: April - June 2012
 Stability Class - Extremely Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	1	0	0	1
NNE	0	1	1	3	0	0	5
NE	0	0	0	0	0	0	0
ENE	0	2	1	0	0	0	3
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	1	0	0	0	1
S	0	0	2	5	0	1	8
SSW	0	0	7	7	0	0	14
SW	0	0	2	0	0	0	2
WSW	0	0	0	2	0	0	2
W	0	0	1	3	4	0	8
WNW	0	0	0	0	0	0	0
NW	0	0	6	2	0	0	8
NNW	0	0	2	0	0	0	2
Variable	0	0	0	0	0	0	0
Total	0	3	23	23	4	1	54

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

Byron Generating Station

Period of Record: April - June 2012
 Stability Class - Moderately Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	1	4	0	0	0	5
NE	0	0	4	4	0	0	8
ENE	0	2	2	0	0	0	4
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	3	0	0	0	3
SSE	0	0	0	5	0	0	5
S	0	0	4	7	2	1	14
SSW	0	0	3	9	0	0	12
SW	0	0	6	1	1	0	8
WSW	0	0	3	4	0	0	7
W	0	0	1	1	0	0	2
WNW	0	0	2	1	3	0	6
NW	0	0	2	4	0	0	6
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	3	34	36	6	1	80

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

Byron Generating Station

Period of Record: April - June 2012
 Stability Class - Slightly Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	4	5	2	0	0	11
NNE	0	2	8	1	0	0	11
NE	0	0	4	7	0	0	11
ENE	0	3	6	1	0	0	10
E	0	6	6	0	0	0	12
ESE	0	0	0	1	0	0	1
SE	0	0	2	1	0	0	3
SSE	0	1	7	2	0	0	10
S	0	0	10	4	1	1	16
SSW	0	1	7	12	4	0	24
SW	0	1	3	1	0	0	5
WSW	0	6	1	2	0	0	9
W	0	2	6	2	0	1	11
WNW	0	0	6	4	1	0	11
NW	0	2	3	5	0	0	10
NNW	0	3	5	0	0	0	8
Variable	0	0	0	0	0	0	0
Total	0	31	79	45	6	2	163

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

Byron Generating Station

Period of Record: April - June 2012
 Stability Class - Neutral - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	2	20	36	17	0	0	75
NNE	1	11	15	4	0	0	31
NE	4	10	34	15	0	0	63
ENE	6	18	52	5	0	0	81
E	1	31	64	2	0	0	98
ESE	1	10	19	16	1	0	47
SE	1	14	10	2	0	0	27
SSE	0	11	19	14	0	0	44
S	2	9	21	23	4	3	62
SSW	2	18	29	23	6	0	78
SW	2	22	30	12	2	0	68
WSW	3	14	13	7	2	1	40
W	3	19	15	8	3	4	52
WNW	2	12	25	9	2	0	50
NW	2	17	14	5	0	0	38
NNW	1	20	33	3	0	0	57
Variable	1	1	0	0	0	0	2
Total	34	257	429	165	20	8	913

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

Byron Generating Station

Period of Record: April - June 2012
 Stability Class - Slightly Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	3	13	7	0	0	0	23
NNE	4	16	11	0	0	0	31
NE	3	6	12	3	0	0	24
ENE	3	10	16	1	0	0	30
E	16	42	11	0	0	0	69
ESE	0	7	17	3	0	0	27
SE	2	13	23	0	0	0	38
SSE	2	16	46	4	1	0	69
S	4	9	30	7	1	0	51
SSW	1	5	21	18	5	0	50
SW	8	15	2	0	0	0	25
WSW	6	7	3	2	0	0	18
W	10	21	7	0	0	0	38
WNW	3	21	10	0	0	0	34
NW	6	34	8	0	0	0	48
NNW	4	14	6	0	0	0	24
Variable	0	0	0	0	0	0	0
Total	75	249	230	38	7	0	599

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

Byron Generating Station

Period of Record: April - June 2012
 Stability Class - Moderately Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	4	2	1	0	0	0	7
NNE	3	2	0	0	0	0	5
NE	3	2	0	0	0	0	5
ENE	1	3	0	0	0	0	4
E	3	23	0	0	0	0	26
ESE	0	15	14	0	0	0	29
SE	1	22	9	0	0	0	32
SSE	4	19	37	0	0	0	60
S	4	22	0	0	0	0	26
SSW	3	17	0	0	0	0	20
SW	8	2	0	0	0	0	10
WSW	12	3	0	0	0	0	15
W	12	8	0	0	0	0	20
WNW	8	2	0	0	0	0	10
NW	5	5	0	0	0	0	10
NNW	6	4	0	0	0	0	10
Variable	0	0	0	0	0	0	0
Total	77	151	61	0	0	0	289

Hours of calm in this stability class: 1
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

Byron Generating Station

Period of Record: April - June 2012
 Stability Class - Extremely Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	2	1	0	0	0	0	3
NNE	0	0	0	0	0	0	0
NE	2	0	0	0	0	0	2
ENE	1	0	1	0	0	0	2
E	0	1	0	0	0	0	1
ESE	3	4	2	0	0	0	9
SE	0	5	1	0	0	0	6
SSE	2	3	1	0	0	0	6
S	5	2	0	0	0	0	7
SSW	4	2	0	0	0	0	6
SW	3	0	0	0	0	0	3
WSW	6	0	0	0	0	0	6
W	4	0	0	0	0	0	4
WNW	4	0	0	0	0	0	4
NW	12	1	0	0	0	0	13
NNW	2	1	0	0	0	0	3
Variable	2	0	0	0	0	0	2
Total	52	20	5	0	0	0	77

Hours of calm in this stability class: 3
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

Byron Generating Station

Period of Record: April - June 2012
 Stability Class - Extremely Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	1	0	0	1
NNE	0	0	1	2	2	0	5
NE	0	0	0	0	0	0	0
ENE	0	0	2	1	0	0	3
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	1	0	0	1
S	0	0	0	3	4	1	8
SSW	0	0	2	7	5	0	14
SW	0	0	0	2	0	0	2
WSW	0	0	0	0	2	0	2
W	0	0	1	0	4	3	8
WNW	0	0	0	0	0	0	0
NW	0	0	0	7	1	0	8
NNW	0	0	1	1	0	0	2
Variable	0	0	0	0	0	0	0
Total	0	0	7	25	18	4	54

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

Byron Generating Station

Period of Record: April - June 2012
 Stability Class - Moderately Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	5	0	0	0	5
NE	0	0	0	5	2	0	7
ENE	0	0	3	2	0	0	5
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	1	2	0	0	3
SSE	0	0	0	6	0	0	6
S	0	0	0	3	5	4	12
SSW	0	0	0	5	8	0	13
SW	0	0	3	3	0	2	8
WSW	0	0	1	3	3	0	7
W	0	0	2	2	0	0	4
WNW	0	0	1	0	0	3	4
NW	0	0	0	2	1	3	6
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	16	33	19	12	80

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

Byron Generating Station

Period of Record: April - June 2012
 Stability Class - Slightly Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	3	6	1	0	0	10
NNE	0	2	3	3	1	0	9
NE	0	0	4	6	2	0	12
ENE	0	0	6	4	0	0	10
E	0	0	9	4	0	0	13
ESE	0	0	0	0	1	0	1
SE	0	0	1	1	1	0	3
SSE	0	0	3	6	1	0	10
S	0	0	3	7	3	3	16
SSW	0	0	2	10	4	7	23
SW	0	0	5	1	0	1	7
WSW	0	1	5	2	1	0	9
W	0	0	2	4	1	1	8
WNW	0	1	1	5	3	2	12
NW	0	3	4	0	2	3	12
NNW	0	2	1	5	0	0	8
Variable	0	0	0	0	0	0	0
Total	0	12	55	59	20	17	163

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

Byron Generating Station

Period of Record: April - June 2012
 Stability Class - Neutral - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	2	9	21	24	14	0	70
NNE	3	4	10	16	2	0	35
NE	1	10	6	28	16	0	61
ENE	4	7	22	40	5	0	78
E	2	16	31	58	8	0	115
ESE	1	5	9	13	13	2	43
SE	0	5	6	11	3	0	25
SSE	1	3	13	16	6	4	43
S	1	5	8	19	18	11	62
SSW	2	11	15	25	19	9	81
SW	0	8	20	20	15	3	66
WSW	2	7	11	10	5	2	37
W	1	15	17	10	6	8	57
WNW	2	2	19	12	9	1	45
NW	2	7	15	13	6	2	45
NNW	1	8	13	23	3	0	48
Variable	2	0	0	0	0	0	2
Total	27	122	236	338	148	42	913

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

Byron Generating Station

Period of Record: April - June 2012
 Stability Class - Slightly Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	3	7	15	1	0	26
NNE	1	3	7	9	1	0	21
NE	0	4	9	16	8	0	37
ENE	0	4	9	12	4	0	29
E	2	6	22	30	4	0	64
ESE	0	3	5	6	8	0	22
SE	0	3	9	18	19	0	49
SSE	0	2	2	16	22	4	46
S	2	3	1	23	29	2	60
SSW	1	4	3	17	32	9	66
SW	0	2	9	8	1	0	20
WSW	1	1	11	9	2	0	24
W	0	2	9	11	1	0	23
WNW	0	4	15	18	3	0	40
NW	0	3	17	26	2	0	48
NNW	1	1	6	15	1	0	24
Variable	0	0	0	0	0	0	0
Total	8	48	141	249	138	15	599

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

Byron Generating Station

Period of Record: April - June 2012
 Stability Class - Moderately Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	6	4	0	0	10
NNE	0	2	2	6	0	0	10
NE	0	5	0	0	0	0	5
ENE	1	5	0	3	0	0	9
E	0	2	8	3	2	0	15
ESE	0	0	2	10	20	1	33
SE	0	1	3	5	9	0	18
SSE	0	1	3	12	27	1	44
S	0	1	6	11	23	0	41
SSW	0	0	4	18	0	0	22
SW	0	4	6	13	3	0	26
WSW	0	0	6	0	0	0	6
W	0	0	5	5	0	0	10
WNW	1	0	9	5	0	0	15
NW	0	2	11	4	1	0	18
NNW	0	2	4	2	0	0	8
Variable	0	0	0	0	0	0	0
Total	2	25	75	101	85	2	290

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

Byron Generating Station

Period of Record: April - June 2012
 Stability Class - Extremely Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	3	2	0	0	5
NNE	0	0	4	1	1	0	6
NE	0	1	1	0	0	0	2
ENE	0	0	0	0	0	0	0
E	0	0	1	0	0	0	1
ESE	0	2	0	0	0	0	2
SE	0	1	1	3	1	0	6
SSE	0	5	3	5	1	0	14
S	0	1	4	3	1	0	9
SSW	0	0	1	2	0	0	3
SW	0	0	3	3	0	0	6
WSW	0	2	1	0	0	0	3
W	0	1	0	0	0	0	1
WNW	0	0	0	2	0	0	2
NW	0	0	6	4	0	0	10
NNW	0	0	4	6	0	0	10
Variable	0	0	0	0	0	0	0
Total	0	13	32	31	4	0	80

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

Byron Generating Station

Period of Record: July - September 2012
 Stability Class - Extremely Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	1	4	0	0	0	5
NNE	0	2	0	0	0	0	2
NE	0	2	2	0	0	0	4
ENE	0	0	5	0	0	0	5
E	0	0	2	0	0	0	2
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	2	0	1	0	3
SSW	0	0	14	6	0	0	20
SW	0	0	8	1	0	0	9
WSW	0	5	9	0	0	0	14
W	0	3	4	4	0	0	11
WNW	0	2	5	1	0	0	8
NW	0	1	11	0	0	0	12
NNW	0	0	3	0	0	0	3
Variable	0	0	0	0	0	0	0
Total	0	16	69	12	1	0	98

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Byron Generating Station

Period of Record: July - September 2012
 Stability Class - Moderately Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	2	3	0	0	0	5
NNE	0	6	4	0	0	0	10
NE	0	1	1	0	0	0	2
ENE	0	0	0	0	0	0	0
E	0	0	1	0	0	0	1
ESE	0	2	0	0	0	0	2
SE	0	0	1	0	0	0	1
SSE	0	0	1	0	0	0	1
S	0	0	4	2	0	0	6
SSW	0	1	5	1	2	0	9
SW	0	1	9	2	0	0	12
WSW	0	4	8	0	0	0	12
W	0	5	6	0	0	0	11
WNW	0	4	3	0	0	0	7
NW	0	4	4	0	0	0	8
NNW	0	1	1	0	0	0	2
Variable	0	0	0	0	0	0	0
Total	0	31	51	5	2	0	89

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Byron Generating Station

Period of Record: July - September 2012
 Stability Class - Slightly Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	1	6	1	0	0	8
NNE	0	3	1	0	0	0	4
NE	0	1	0	0	0	0	1
ENE	1	0	1	0	0	0	2
E	0	1	0	0	0	0	1
ESE	1	2	0	0	0	0	3
SE	0	0	1	0	0	0	1
SSE	0	2	5	0	0	0	7
S	0	6	4	0	0	0	10
SSW	0	7	6	0	0	0	13
SW	0	4	5	1	0	0	10
WSW	0	9	14	0	0	0	23
W	0	8	2	1	0	0	11
WNW	0	6	5	0	0	0	11
NW	0	6	4	1	0	0	11
NNW	0	3	4	0	0	0	7
Variable	0	0	0	0	0	0	0
Total	2	59	58	4	0	0	123

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Byron Generating Station

Period of Record: July - September 2012
 Stability Class - Neutral - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	2	22	36	10	0	0	70
NNE	3	27	16	1	0	0	47
NE	3	11	18	1	0	0	33
ENE	7	13	15	0	0	0	35
E	6	24	0	0	0	0	30
ESE	3	6	0	0	0	0	9
SE	5	14	0	0	0	0	19
SSE	6	23	5	0	0	0	34
S	0	20	16	1	0	0	37
SSW	2	24	11	0	3	0	40
SW	1	38	12	3	0	0	54
WSW	4	48	15	0	0	0	67
W	8	36	14	0	0	0	58
WNW	8	22	6	0	0	0	36
NW	4	20	25	4	0	0	53
NNW	1	26	17	0	0	0	44
Variable	1	1	0	0	0	0	2
Total	64	375	206	20	3	0	668

Hours of calm in this stability class: 1
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Byron Generating Station

Period of Record: July - September 2012
 Stability Class - Slightly Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	5	20	5	1	0	0	31
NNE	7	16	3	1	0	0	27
NE	4	12	4	0	0	0	20
ENE	3	17	15	0	0	0	35
E	6	20	2	0	0	0	28
ESE	6	8	2	0	0	0	16
SE	7	11	3	0	0	0	21
SSE	5	23	2	0	0	0	30
S	5	18	8	0	0	0	31
SSW	9	18	20	3	0	0	50
SW	8	30	3	1	0	0	42
WSW	13	22	2	0	0	0	37
W	9	13	5	1	0	0	28
WNW	11	14	0	0	0	0	25
NW	12	28	2	1	0	0	43
NNW	4	17	6	0	0	0	27
Variable	0	0	0	0	0	0	0
Total	114	287	82	8	0	0	491

Hours of calm in this stability class: 2
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Byron Generating Station

Period of Record: July - September 2012
 Stability Class - Moderately Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	9	5	0	0	0	0	14
NNE	3	5	0	0	0	0	8
NE	2	3	0	0	0	0	5
ENE	2	7	0	0	0	0	9
E	11	19	2	0	0	0	32
ESE	5	13	0	0	0	0	18
SE	3	22	0	0	0	0	25
SSE	9	48	17	0	0	0	74
S	20	49	9	0	0	0	78
SSW	25	19	0	0	0	0	44
SW	24	10	0	0	0	0	34
WSW	16	2	1	0	0	0	19
W	21	4	0	0	0	0	25
WNW	19	1	0	0	0	0	20
NW	18	4	0	0	0	0	22
NNW	12	4	0	0	0	0	16
Variable	0	0	0	0	0	0	0
Total	199	215	29	0	0	0	443

Hours of calm in this stability class: 11
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Byron Generating Station

Period of Record: July - September 2012
 Stability Class - Extremely Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	4	2	0	0	0	0	6
NNE	2	0	0	0	0	0	2
NE	1	0	0	0	0	0	1
ENE	2	1	0	0	0	0	3
E	8	15	0	0	0	0	23
ESE	3	13	0	0	0	0	16
SE	4	12	1	0	0	0	17
SSE	10	20	1	0	0	0	31
S	29	16	0	0	0	0	45
SSW	17	2	0	0	0	0	19
SW	10	1	0	0	0	0	11
WSW	10	0	0	0	0	0	10
W	12	0	0	0	0	0	12
WNW	16	0	0	0	0	0	16
NW	37	0	0	0	0	0	37
NNW	8	5	0	0	0	0	13
Variable	0	0	0	0	0	0	0
Total	173	87	2	0	0	0	262

Hours of calm in this stability class: 16
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Byron Generating Station

Period of Record: July - September 2012
 Stability Class - Extremely Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	3	0	0	3
NNE	0	0	4	0	0	0	4
NE	0	0	4	0	0	0	4
ENE	0	0	3	2	0	0	5
E	0	0	0	2	0	0	2
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	1	1	0	2	4
SSW	0	0	2	13	4	0	19
SW	0	0	2	6	1	0	9
WSW	0	0	9	5	0	0	14
W	0	2	2	3	4	0	11
WNW	0	1	4	3	1	0	9
NW	0	0	1	9	2	0	12
NNW	0	0	0	2	0	0	2
Variable	0	0	0	0	0	0	0
Total	0	3	32	49	12	2	98

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Byron Generating Station

Period of Record: July - September 2012
 Stability Class - Moderately Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	1	1	2	0	0	4
NNE	0	1	7	1	0	0	9
NE	0	1	2	1	0	0	4
ENE	0	0	0	0	0	0	0
E	0	1	1	0	0	0	2
ESE	0	0	1	0	0	0	1
SE	0	0	0	1	0	0	1
SSE	0	0	1	0	0	0	1
S	0	0	0	4	1	1	6
SSW	0	0	4	3	0	2	9
SW	0	1	4	5	2	0	12
WSW	0	1	4	7	0	0	12
W	0	2	5	4	0	0	11
WNW	0	1	4	0	1	0	6
NW	0	1	5	4	0	0	10
NNW	0	0	0	1	0	0	1
Variable	0	0	0	0	0	0	0
Total	0	10	39	33	4	3	89

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Byron Generating Station

Period of Record: July - September 2012
 Stability Class - Slightly Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	1	4	1	0	6
NNE	0	2	3	0	0	0	5
NE	0	0	1	0	0	0	1
ENE	0	1	0	1	0	0	2
E	0	0	0	0	0	0	0
ESE	0	1	3	0	0	0	4
SE	0	0	0	1	0	0	1
SSE	0	0	6	1	0	0	7
S	0	0	6	3	0	0	9
SSW	0	0	12	4	0	0	16
SW	0	0	6	4	1	0	11
WSW	0	6	12	4	0	0	22
W	0	3	5	1	1	0	10
WNW	0	0	9	1	1	0	11
NW	0	0	6	4	1	0	11
NNW	0	0	6	1	0	0	7
Variable	0	0	0	0	0	0	0
Total	0	13	76	29	5	0	123

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Byron Generating Station

Period of Record: July - September 2012
 Stability Class - Neutral - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	9	15	29	10	0	63
NNE	2	10	19	18	0	1	50
NE	1	4	13	8	5	0	31
ENE	2	10	6	12	10	0	40
E	2	19	9	1	0	0	31
ESE	1	9	7	0	0	0	17
SE	0	8	6	2	0	0	16
SSE	0	11	15	4	0	0	30
S	0	6	17	15	1	0	39
SSW	1	8	17	5	1	3	35
SW	2	19	26	6	4	0	57
WSW	2	18	38	15	0	0	73
W	3	18	21	9	0	0	51
WNW	6	10	16	6	0	0	38
NW	2	11	11	22	7	0	53
NNW	0	11	18	14	1	0	44
Variable	0	1	0	0	0	0	1
Total	24	182	254	166	39	4	669

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Byron Generating Station

Period of Record: July - September 2012
 Stability Class - Slightly Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	5	8	11	0	0	24
NNE	0	4	11	7	0	2	24
NE	0	2	8	13	0	0	23
ENE	2	9	13	15	6	0	45
E	1	6	13	10	0	0	30
ESE	1	4	8	3	2	0	18
SE	0	5	5	4	1	0	15
SSE	2	2	6	11	2	0	23
S	0	0	5	26	7	0	38
SSW	1	3	7	4	13	3	31
SW	1	4	19	25	3	1	53
WSW	0	6	25	8	1	0	40
W	1	5	15	6	1	1	29
WNW	1	6	16	5	0	0	28
NW	1	3	12	22	0	1	39
NNW	0	3	15	13	0	0	31
Variable	0	0	0	0	0	0	0
Total	11	67	186	183	36	8	491

Hours of calm in this stability class: 2
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Byron Generating Station

Period of Record: July - September 2012
 Stability Class - Moderately Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	4	5	3	0	0	12
NNE	1	3	6	2	0	0	12
NE	0	2	5	4	0	0	11
ENE	0	1	11	0	2	0	14
E	0	2	20	6	3	0	31
ESE	0	1	4	9	2	0	16
SE	0	0	9	11	2	0	22
SSE	0	0	6	13	17	1	37
S	0	2	6	12	37	2	59
SSW	0	6	7	30	10	0	53
SW	0	4	13	28	0	0	45
WSW	0	6	21	20	0	0	47
W	0	4	14	6	0	0	24
WNW	0	3	13	1	0	0	17
NW	0	5	12	11	0	0	28
NNW	1	5	14	6	0	0	26
Variable	0	0	0	0	0	0	0
Total	2	48	166	162	73	3	454

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Byron Generating Station

Period of Record: July - September 2012
 Stability Class - Extremely Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	8	13	4	0	0	26
NNE	2	7	4	3	0	0	16
NE	4	5	2	2	0	0	13
ENE	3	1	3	0	0	0	7
E	3	2	7	1	1	0	14
ESE	5	1	2	6	7	0	21
SE	2	2	1	13	1	0	19
SSE	0	1	4	6	4	0	15
S	1	5	5	8	13	0	32
SSW	1	3	12	16	4	0	36
SW	0	4	9	16	0	0	29
WSW	2	2	7	2	0	0	13
W	0	1	4	3	0	0	8
WNW	2	3	3	0	0	0	8
NW	0	2	5	1	0	0	8
NNW	0	2	7	4	0	0	13
Variable	0	0	0	0	0	0	0
Total	26	49	88	85	30	0	278

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Byron Generating Station

Period of Record: October - December 2012
 Stability Class - Extremely Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	2	2	0	3	0	7
NNE	0	0	0	1	0	0	1
NE	0	1	0	0	0	0	1
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	1	0	0	1
SSW	0	0	0	4	0	0	4
SW	0	0	0	0	0	0	0
WSW	0	0	0	0	0	0	0
W	0	0	1	1	0	0	2
WNW	0	0	1	2	0	0	3
NW	0	0	2	0	0	0	2
NNW	0	0	0	0	3	0	3
Variable	0	0	0	0	0	0	0
Total	0	3	6	9	6	0	24

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

Byron Generating Station

Period of Record: October - December 2012
 Stability Class - Moderately Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	1	0	1
NNE	0	2	1	0	0	0	3
NE	0	0	0	0	0	0	0
ENE	0	1	0	0	0	0	1
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	1	0	2	0	3
S	0	0	0	1	0	0	1
SSW	0	0	1	1	0	0	2
SW	0	0	1	2	0	0	3
WSW	0	0	1	2	0	0	3
W	0	0	1	0	0	0	1
WNW	0	0	1	0	0	0	1
NW	0	0	5	0	0	0	5
NNW	0	0	1	0	1	0	2
Variable	0	0	0	0	0	0	0
Total	0	3	13	6	4	0	26

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

Byron Generating Station

Period of Record: October - December 2012
 Stability Class - Slightly Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	3	0	0	0	3
NNE	0	1	1	0	0	0	2
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	2	0	0	0	2
SE	0	0	1	0	0	0	1
SSE	0	0	3	2	0	0	5
S	0	1	1	1	0	0	3
SSW	0	1	0	0	0	0	1
SW	0	0	0	4	0	0	4
WSW	0	0	0	0	0	0	0
W	0	0	0	1	1	0	2
WNW	0	0	6	2	0	0	8
NW	2	2	1	1	0	0	6
NNW	0	1	0	0	0	0	1
Variable	0	0	0	0	0	0	0
Total	2	6	18	11	1	0	38

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

Byron Generating Station

Period of Record: October - December 2012
 Stability Class - Neutral - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	3	27	64	15	0	0	109
NNE	3	17	22	0	0	0	42
NE	4	12	3	1	0	0	20
ENE	2	16	19	7	0	0	44
E	2	26	8	1	0	0	37
ESE	3	10	10	1	0	0	24
SE	2	15	15	1	0	0	33
SSE	2	18	36	9	1	0	66
S	1	22	65	23	8	0	119
SSW	2	12	35	30	5	0	84
SW	4	22	28	9	0	0	63
WSW	3	15	22	6	2	0	48
W	5	20	28	39	6	0	98
WNW	7	27	38	19	10	0	101
NW	8	53	49	27	4	0	141
NNW	2	24	34	5	3	0	68
Variable	0	0	0	0	0	0	0
Total	53	336	476	193	39	0	1097

Hours of calm in this stability class: 2
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

Byron Generating Station

Period of Record: October - December 2012
 Stability Class - Slightly Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	4	20	12	0	0	0	36
NNE	2	2	3	0	0	0	7
NE	6	3	3	0	0	0	12
ENE	3	16	9	2	0	0	30
E	2	19	0	0	0	0	21
ESE	1	7	5	0	0	0	13
SE	1	25	25	4	0	0	55
SSE	2	22	53	9	1	0	87
S	7	25	58	21	1	0	112
SSW	10	14	19	20	0	0	63
SW	9	21	4	5	0	0	39
WSW	5	11	7	0	0	0	23
W	8	29	8	3	1	0	49
WNW	9	39	10	0	0	0	58
NW	8	28	8	0	0	0	44
NNW	8	34	23	2	0	0	67
Variable	0	0	0	0	0	0	0
Total	85	315	247	66	3	0	716

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

Byron Generating Station

Period of Record: October - December 2012
 Stability Class - Moderately Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	9	0	0	0	0	10
NNE	0	2	0	0	0	0	2
NE	0	0	0	0	0	0	0
ENE	5	2	1	0	0	0	8
E	4	13	0	0	0	0	17
ESE	0	7	7	0	0	0	14
SE	1	22	8	0	0	0	31
SSE	0	31	18	0	0	0	49
S	1	29	8	0	0	0	38
SSW	1	9	0	0	0	0	10
SW	1	1	0	0	0	0	2
WSW	6	0	0	0	0	0	6
W	5	6	0	0	0	0	11
WNW	3	1	0	0	0	0	4
NW	5	6	0	0	0	0	11
NNW	6	12	0	0	0	0	18
Variable	0	0	0	0	0	0	0
Total	39	150	42	0	0	0	231

Hours of calm in this stability class: 1
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

Byron Generating Station

Period of Record: October - December 2012
 Stability Class - Extremely Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 30 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	0	0	0	0	0	1
NNE	1	0	0	0	0	0	1
NE	0	0	0	0	0	0	0
ENE	1	0	0	0	0	0	1
E	2	1	0	0	0	0	3
ESE	0	4	3	0	0	0	7
SE	1	11	2	0	0	0	14
SSE	0	8	2	0	0	0	10
S	1	10	0	0	0	0	11
SSW	0	0	0	0	0	0	0
SW	0	0	0	0	0	0	0
WSW	1	0	0	0	0	0	1
W	0	0	0	0	0	0	0
WNW	1	0	0	0	0	0	1
NW	13	0	0	0	0	0	13
NNW	4	1	0	0	0	0	5
Variable	0	0	0	0	0	0	0
Total	26	35	7	0	0	0	68

Hours of calm in this stability class: 2
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

Byron Generating Station

Period of Record: October - December 2012
 Stability Class - Extremely Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	1	3	0	0	2	6
NNE	0	0	0	0	1	1	2
NE	0	0	1	0	0	0	1
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	0	1	0	1
SSW	0	0	0	0	2	2	4
SW	0	0	0	0	0	0	0
WSW	0	0	0	0	0	0	0
W	0	0	1	0	1	0	2
WNW	0	0	1	1	2	0	4
NW	0	0	0	1	0	0	1
NNW	0	0	0	0	0	3	3
Variable	0	0	0	0	0	0	0
Total	0	1	6	2	7	8	24

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

Byron Generating Station

Period of Record: October - December 2012
 Stability Class - Moderately Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	1	1
NNE	0	0	2	0	0	0	2
NE	0	0	1	0	0	0	1
ENE	0	0	0	0	0	0	0
E	0	0	1	0	0	0	1
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	1	2	3
S	0	0	0	0	1	0	1
SSW	0	0	0	1	1	1	3
SW	0	0	0	1	1	0	2
WSW	0	0	0	1	2	0	3
W	0	0	0	1	0	0	1
WNW	0	0	1	0	0	0	1
NW	0	0	0	6	0	1	7
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	5	10	6	5	26

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

Byron Generating Station

Period of Record: October - December 2012
 Stability Class - Slightly Unstable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	2	1	0	0	3
NNE	0	0	2	0	0	0	2
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	1	0	0	0	1
ESE	0	0	1	0	0	0	1
SE	0	0	1	2	0	0	3
SSE	0	0	0	2	0	1	3
S	0	1	0	1	1	0	3
SSW	0	1	0	0	0	0	1
SW	0	0	0	1	3	0	4
WSW	0	0	0	0	0	0	0
W	0	0	0	0	2	0	2
WNW	0	0	1	4	3	0	8
NW	0	1	1	2	0	0	4
NNW	0	2	1	0	0	0	3
Variable	0	0	0	0	0	0	0
Total	0	5	10	13	9	1	38

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

Byron Generating Station

Period of Record: October - December 2012
 Stability Class - Neutral - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	13	31	32	10	0	86
NNE	2	10	19	30	1	0	62
NE	0	5	8	3	0	0	16
ENE	3	7	16	12	10	0	48
E	1	9	17	7	3	0	37
ESE	0	6	12	3	1	0	22
SE	2	5	13	10	1	1	32
SSE	1	4	23	24	12	3	67
S	0	5	50	34	22	10	121
SSW	1	6	17	25	30	7	86
SW	2	9	27	21	9	1	69
WSW	1	3	12	15	9	2	42
W	3	12	20	32	29	4	100
WNW	7	4	33	29	14	11	98
NW	3	21	44	40	17	14	139
NNW	1	14	21	16	0	1	53
Variable	0	0	0	0	0	0	0
Total	27	133	363	333	168	54	1078

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 21
 Hours of missing stability measurements in all stability classes: 3

Byron Generating Station

Period of Record: October - December 2012
 Stability Class - Slightly Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	4	12	24	0	0	41
NNE	1	2	10	13	2	0	28
NE	0	1	2	2	0	0	5
ENE	0	3	6	8	4	1	22
E	1	3	15	9	0	0	28
ESE	0	0	3	6	2	0	11
SE	0	2	5	17	11	4	39
SSE	0	1	10	40	24	8	83
S	0	3	5	23	49	10	90
SSW	0	3	12	25	45	6	91
SW	4	9	15	9	4	3	44
WSW	4	3	10	5	1	0	23
W	0	2	12	20	3	1	38
WNW	3	2	23	27	0	0	55
NW	1	5	26	31	0	0	63
NNW	0	10	3	14	0	0	27
Variable	0	0	0	0	0	0	0
Total	15	53	169	273	145	33	688

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 28
 Hours of missing stability measurements in all stability classes: 3

Byron Generating Station

Period of Record: October - December 2012
 Stability Class - Moderately Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	1	0	12	1	0	15
NNE	1	2	2	6	1	0	12
NE	0	0	4	1	1	0	6
ENE	0	0	1	1	0	0	2
E	0	2	7	5	1	0	15
ESE	0	2	4	2	0	0	8
SE	1	1	2	9	7	0	20
SSE	1	1	0	20	20	1	43
S	0	1	1	26	8	1	37
SSW	0	0	4	19	7	0	30
SW	0	2	2	10	0	0	14
WSW	0	0	2	0	0	0	2
W	1	1	3	0	0	0	5
WNW	0	0	7	1	0	0	8
NW	0	2	0	4	2	0	8
NNW	0	2	4	1	0	0	7
Variable	0	0	0	0	0	0	0
Total	5	17	43	117	48	2	232

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

Byron Generating Station

Period of Record: October - December 2012
 Stability Class - Extremely Stable - 250Ft-30Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	1	2	0	0	3
NNE	0	1	4	2	0	0	7
NE	0	2	3	0	0	0	5
ENE	0	2	0	0	0	0	2
E	0	1	4	2	0	0	7
ESE	0	0	0	1	0	0	1
SE	0	0	0	3	2	0	5
SSE	0	0	0	5	7	0	12
S	0	0	1	5	6	0	12
SSW	0	1	2	4	1	0	8
SW	0	0	2	3	0	0	5
WSW	0	1	0	0	0	0	1
W	0	0	0	0	0	0	0
WNW	0	0	1	0	0	0	1
NW	0	0	0	0	0	0	0
NNW	0	0	0	1	0	0	1
Variable	0	0	0	0	0	0	0
Total	0	8	18	28	16	0	70

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

APPENDIX G

ANNUAL RADIOLOGICAL GROUNDWATER PROTECTION PROGRAM REPORT (ARGPPR)

Docket No: 50-454
50-455

BYRON NUCLEAR GENERATING STATION UNITS 1 and 2

Annual Radiological
Groundwater Protection Program Report

1 January Through 31 December 2012

Prepared By

Teledyne Brown Engineering
Environmental Services



Byron Nuclear Generating Station
Byron, IL 61010

May 2013

Table Of Contents

I. Summary and Conclusions.....	3
II. Introduction	4
A. Objectives of the RGPP	4
B. Implementation of the Objectives.....	5
C. Program Description	6
D. Characteristics of Tritium (H-3).....	6
III. Program Description	7
A. Sample Analysis.....	7
B. Data Interpretation.....	7
C. Background Analysis.....	8
1. Background Concentrations of Tritium.....	9
IV. Results and discussion.....	10
A. Groundwater Results.....	10
B. Drinking Water Well Survey	12
C. Summary of Results – Inter-laboratory Comparison Program.....	12
D. Leaks, Spills, and Releases.....	12
E. Trends	12
F. Investigations.....	13
G. Actions Taken	13

Appendices

Appendix A Location Designation

Tables

Table A-1 Radiological Groundwater Protection Program - Sampling Locations, Distance and Direction, Byron Nuclear Generating Station, 2012

Figures

Figure A-1 Monitoring Well Locations, Byron Nuclear Generating Station, 2012
(Extra wells noted on map are for reference only.)

Appendix B Data Tables

Tables

Table B-I.1 Concentrations of Tritium, Strontium-90, Gross Alpha, and Gross Beta in Groundwater Samples Collected in the Vicinity of Byron Nuclear Generating Station, 2012.

Table B-I.2 Concentrations of Gamma Emitters in Groundwater Samples Collected in the Vicinity of Byron Nuclear Generating Station, 2012.

I. Summary and Conclusions

In 2006, Exelon instituted a comprehensive monitoring program to evaluate the impact of station operations on groundwater in the vicinity of Byron Nuclear Generating Station. The monitoring was conducted in two phases. Phase 1 of the monitoring was part of a comprehensive study initiated by Exelon to determine whether groundwater or surface water at and in the vicinity of Byron Nuclear Generating Station had been adversely impacted by any releases of radionuclides. Phase 1 was conducted by Conestoga Rovers and Associates (CRA) and the conclusions were made available to state and federal regulators as well as the public.

Phase 2 of the RGPP was conducted by Exelon corporate and station personnel to initiate follow up of Phase 1 and begin long-term monitoring at groundwater locations selected during Phase 1. This is the seventh in a series of annual reports on the status of the Radiological Groundwater Protection Program (RGPP) conducted at Byron Nuclear Generating Station. This report covers groundwater samples, collected from the environment, both on and off station property in 2012. During that time period, 103 analyses were performed on 51 samples from 15 locations.

Gamma-emitting radionuclides associated with licensed plant operations were not detected at concentrations greater than their respective Lower Limits of Detection (LLDs) as specified in the Offsite Dose Calculation Manual (ODCM) in any of the groundwater samples tested. In the case of tritium, Exelon specified that its laboratories achieve a lower limit of detection 10 times lower than that required by federal regulation.

In 2012, fifteen (15) Radiological Groundwater Protection Program (RGPP) monitoring wells were sampled. The samples were obtained in March, May, August and October and analyzed for tritium. In addition, a study of gamma, beta and alpha radioisotopes was performed in accordance with Nuclear Energy Institute (NEI) 07-07, Groundwater Protection Initiative, for the samples obtained in May. None of the May samples showed concentrations of radionuclides above what is considered background levels. Three wells contained levels of tritium above the lower limit of detection (LLD) of 200 pCi/L. They were: AR-4 (861 pCi/L in March, 802 pCi/L in May, 872 pCi/L in August, 830 pCi/L in October), AR-7 (234 pCi/L in January) and AR-11 (1,100 pCi/L in March, 1,110 pCi/L in May, 1,210 pCi/L in August, 994 pCi/L in November). Wells AR-4 and AR-11 are near the Circulating Water Blowdown piping, where historical leakage through vacuum breakers was known to have occurred. Both of these wells are showing a slow but gradual decrease in tritium concentration since first sampled in 2006. In May 2012, the area around well AR-7, located just west of the plant structures, was excavated and re-packed with clay-based soil. This well had detected tritium just above the LLD (234 – 291 pCi/L) in 2011/2012 that was

believed to have originated from precipitation recapture of permitted gaseous releases of tritium from the plant that had entered the well during rainfall events as a result of improperly compacted soil around the well during original installation. Tritium has not been detected in this well above the 200 pCi/L LLD since January 2012. The off-site dose consequence from tritium present in wells AR-4 and AR-11 is negligible.

Strontium-90 was not detected in any samples above the LLD of 1 pCi/L.

Gross Alpha and Gross Beta analyses in the dissolved and suspended fractions were performed on groundwater samples during the second sampling in 2012. Gross Alpha (dissolved) was not detected in any of 8 groundwater locations. Gross Alpha (suspended) was detected in 3 of 8 groundwater locations. The concentrations ranged from 1.2 to 4.1 pCi/L. Gross Beta (dissolved) was detected in 7 of 8 groundwater locations. The concentrations ranged from 2.0 to 23.5 pCi/L. Gross Beta (suspended) was detected in 3 of the 8 groundwater locations. The concentrations ranged from 2.4 to 4.0 pCi/L. The concentrations of Gross Alpha and Gross Beta, which are slightly above detectable levels, are considered to be background and are not the result of plant effluents.

Hard-To-Detect analyses were not performed in 2012.

In assessing all the data gathered for this report, it was concluded that the operation of Byron Nuclear Generating Station had no adverse radiological impact on the environment, and there are no known active releases into the groundwater at Byron Nuclear Generating Station.

II. Introduction

The Byron Station, a two-unit PWR station, is located about two miles east of the Rock River and approximately three miles southwest of Byron in Ogle County, Illinois. The reactors are designed to have capacities of 1,280 and 1,254 MW gross, respectively. Unit One loaded fuel in November 1984 and went on line February 2, 1985. Unit Two went on line January 9, 1987.

This report covers those analyses performed by Teledyne Brown Engineering (TBE) on samples collected in 2012.

A. Objectives of the RGPP

The long-term objectives of the RGPP are as follows:

1. Identify suitable locations to monitor and evaluate potential impacts from station operations before significant radiological impact to the environment and potential drinking water sources.

2. Understand the local hydrogeologic regime in the vicinity of the station and maintain up-to-date knowledge of flow patterns on the surface and shallow subsurface.
3. Perform routine water sampling and radiological analysis of water from selected locations.
4. Report new leaks, spills, or other detections with potential radiological significance to stakeholders in a timely manner.
5. Regularly assess analytical results to identify adverse trends.
6. Take necessary corrective actions to protect groundwater resources.

B. Implementation of the Objectives

The objectives identified have been implemented at Byron Nuclear Generating Station as discussed below:

1. Exelon and its consultant identified locations as described in the Phase 1 study. Phase 1 studies were conducted by Conestoga Rovers and Associates (CRA) and the results and conclusions were made available to state and federal regulators as well as the public.
2. The Byron Nuclear Generating Station reports describe the local hydrogeologic regime. Periodically, the flow patterns on the surface and shallow subsurface are updated based on ongoing measurements.
3. Byron Nuclear Generating Station will continue to perform routine sampling and radiological analysis of water from selected locations.
4. Byron Nuclear Generating Station has implemented new procedures to identify and report new leaks, spills, or other detections with potential radiological significance in a timely manner.
5. Byron Nuclear Generating Station staff and consulting hydrogeologist assess analytical results on an ongoing basis to identify adverse trends.

C. Program Description

1. Sample Collection

Sample locations can be found in Table A-1 and Figure A-1, Appendix A.

Groundwater

Samples of water are collected, managed, transported and analyzed in accordance with approved procedures following EPA methods. Only groundwater is collected. Sample locations, sample collection frequencies and analytical frequencies are controlled in accordance with approved station procedures. Contractor and/or station personnel are trained in the collection, preservation management, and shipment of samples, as well as in documentation of sampling events. Analytical laboratories are subject to internal quality assurance programs, industry cross-check programs, as well as nuclear industry audits. Station personnel review and evaluate all analytical data deliverables as data are received.

Analytical data results are reviewed by both station personnel and an independent hydrogeologist for adverse trends or changes to hydrogeologic conditions.

D. Characteristics of Tritium (H-3)

Tritium (chemical symbol H-3) is a radioactive isotope of hydrogen. The most common form of tritium is tritium oxide, which is also called "tritiated water." The chemical properties of tritium are essentially those of ordinary hydrogen.

Tritiated water behaves the same as ordinary water in both the environment and the body. Tritium can be taken into the body by drinking water, breathing air, eating food, or absorption through skin. Once tritium enters the body, it disperses quickly and is uniformly distributed throughout the body. Tritium is excreted primarily through urine with a clearance rate characterized by an effective biological half-life of about 14 days. Within one month or so after ingestion, essentially all tritium is cleared. Organically bound tritium (tritium that is incorporated in organic compounds) can remain in the body for a longer period.

Tritium is produced naturally in the upper atmosphere when cosmic rays strike air molecules. Tritium is also produced during nuclear weapons explosions, as a by-product in reactors producing electricity, and in special

production reactors, where the isotopes lithium-7 and/or boron-10 are activated to produce tritium. Like normal water, tritiated water is colorless and odorless. Tritiated water behaves chemically and physically like non-tritiated water in the subsurface, and therefore tritiated water will travel at the same velocity as the average groundwater velocity.

Tritium has a half-life of approximately 12.3 years. It decays spontaneously to helium-3 (^3He). This radioactive decay releases a beta particle (low-energy electron). The radioactive decay of tritium is the source of the health risk from exposure to tritium. Tritium is one of the least dangerous radionuclides because it emits very weak radiation and leaves the body relatively quickly. Since tritium is almost always found as water, it goes directly into soft tissues and organs. The associated dose to these tissues is generally uniform and is dependent on the water content of the specific tissue.

III. Program Description

A. Sample Analysis

This section describes the general analytical methodologies used by TBE to analyze the environmental samples for radioactivity for the Byron Nuclear Generating Station RGPP in 2012.

In order to achieve the stated objectives, the current program includes the following analyses (as required by procedure):

1. Concentrations of gamma emitters in groundwater.
2. Concentrations of strontium in groundwater.
3. Concentrations of tritium in groundwater.
4. Concentrations of gross alpha and gross beta in groundwater.

B. Data Interpretation

The radiological data collected prior to Byron Nuclear Generating Station becoming operational were used as a baseline with which these operational data were compared. For the purpose of this report, Byron Nuclear Generating Station was considered operational at initial criticality. Several factors were important in the interpretation of the data:

1. Lower Limit of Detection and Minimum Detectable Concentration

The lower limit of detection (LLD) is specified by federal regulation as a minimum sensitivity value that must be achieved routinely by the analytical parameter.

2. Laboratory Measurements Uncertainty

The estimated uncertainty in measurement of tritium in environmental samples is frequently on the order of 50% of the measurement value.

Statistically, the exact value of a measurement is expressed as a range with a stated level of confidence. The convention is to report results with a 95% level of confidence. The uncertainty comes from calibration standards, sample volume or weight measurements, sampling uncertainty and other factors. Exelon reports the uncertainty of a measurement created by statistical process (counting error) as well as all sources of error (Total Propagated Uncertainty or TPU). Each result has two values calculated. Exelon reports the TPU by following the result with plus or minus \pm the estimated sample standard deviation, as TPU, that is obtained by propagating all sources of analytical uncertainty in measurements.

Analytical uncertainties are reported at the 95% confidence level in this report for reporting consistency with the AREOR.

C. Background Analysis

A pre-operational radiological environmental monitoring program (pre-operational REMP) was conducted to establish background radioactivity levels prior to operation of the Station. The environmental media sampled and analyzed during the pre-operational REMP were atmospheric radiation, fall-out, domestic water, surface water, marine life, and foodstuffs. The results of the monitoring were detailed in the report entitled, Environmental Radiological Monitoring for Byron Nuclear Generating Nuclear Power Station, Commonwealth Edison Company, Annual Report 1984, April 1985.

The pre-operational REMP contained analytical results from samples collected from the surface water and groundwater. All groundwater samples listed in the pre-Operational REMP report were <200 pCi/L.

1. Background Concentrations of Tritium

The purpose of the following discussion is to summarize background measurements of tritium in various media performed by others. Additional detail may be found by consulting references (CRA 2006).

a. Tritium Production

Tritium is created in the environment from naturally occurring processes both cosmic and subterranean, as well as from anthropogenic (i.e., man-made) sources. In the upper atmosphere, "Cosmogenic" tritium is produced from the bombardment of stable nuclides and combines with oxygen to form tritiated water, which will then enter the hydrologic cycle. Below ground, "lithogenic" tritium is produced by the bombardment of natural lithium present in crystalline rocks by neutrons produced by the radioactive decay of naturally abundant uranium and thorium. Lithogenic production of tritium is usually negligible compared to other sources due to the limited abundance of lithium in rock. The lithogenic tritium is introduced directly to groundwater.

A major anthropogenic source of tritium and strontium-90 comes from the former atmospheric testing of thermonuclear weapons. Levels of tritium in precipitation increased significantly during the 1950s and early 1960s, and later with additional testing, resulting in the release of significant amounts of tritium to the atmosphere. The Canadian heavy water nuclear power reactors, other commercial power reactors, nuclear research and weapons production continue to influence tritium concentrations in the environment.

b. Precipitation Data

Precipitation samples are routinely collected at stations around the world for the analysis of tritium and other radionuclides. Two publicly available databases that provide tritium concentrations in precipitation are Global Network of Isotopes in Precipitation (GNIP) and USEPA's RadNet database. GNIP provides tritium precipitation concentration data for samples collected world wide from 1960 to 2006. RadNet provides tritium precipitation concentration data for samples collected at stations through out the U.S. from 1960 up to and including 2006. Based on GNIP data for sample stations located in the U.S. Midwest, tritium concentrations

peaked around 1963. This peak, which approached 10,000 pCi/L for some stations, coincided with the atmospheric testing of thermonuclear weapons. Tritium concentrations in surface water showed a sharp decline up until 1975 followed by a gradual decline since that time. Tritium concentrations in Midwest precipitation have typically been below 100 pCi/L since around 1980. Tritium concentrations in wells may still be above the 200 pCi/L detection limit from the external causes described above. Water from previous years and decades is naturally captured in groundwater, so some well water sources today are affected by the surface water from the 1960s that was elevated in tritium.

c. Surface Water Data

Tritium concentrations are routinely measured in large surface water bodies, including Lake Michigan and the Mississippi River. Illinois surface water data were typically less than 100 pCi/L.

The USEPA RadNet surface water data typically has a reported 'Combined Standard Uncertainty' of 35 to 50 pCi/L. According to USEPA, this corresponds to a ± 70 to 100 pCi/L 95% confidence bound on each given measurement. Therefore, the typical background data provided may be subject to measurement uncertainty of approximately ± 70 to 100 pCi/L.

The radio-analytical laboratory is counting tritium results to an Exelon specified LLD of 200 pCi/L. Typically, the lowest positive measurement will be reported within a range of 40 – 240 pCi/L or 140 ± 100 pCi/L. Clearly, these sample results cannot be distinguished as different from background at this concentration.

IV. Results and Discussion

A. Groundwater Results

Groundwater

Samples were collected from on and off-site wells throughout the year in accordance with the station radiological groundwater protection program. Analytical results and anomalies are discussed below.

Tritium

Samples from all locations were analyzed for tritium activity (Table B-I.1, Appendix B). Tritium values ranged from less than the detection limit to 1,210 pCi/L. Outside of the station boundary, tritium concentrations were all less than detection limit (<200 pCi/L). This is based on evaluation of groundwater sample results obtained as part of the Byron Station REMP. In 2012, fifteen (15) Radiological Groundwater Protection Program (RGPP) monitoring wells were sampled. The samples were obtained in March, May, August and October and analyzed for tritium. In addition, a study of gamma, beta and alpha radioisotopes was performed in accordance with Nuclear Energy Institute (NEI) 07-07, Groundwater Protection Initiative, for the samples obtained in May. None of the May samples showed concentrations of radionuclides above what is considered background levels. Three wells contained levels of tritium above the lower limit of detection (LLD) of 200 pCi/L. They were: AR-4 (861 pCi/L in March, 802 pCi/L in May, 872 pCi/L in August, 830 pCi/L in October), AR-7 (234 pCi/L in January) and AR-11 (1,100 pCi/L in March, 1,110 pCi/L in May, 1,210 pCi/L in August, 994 pCi/L in November). Wells AR-4 and AR-11 are near the Circulating Water Blowdown piping, where historical leakage through vacuum breakers was known to have occurred. Both of these wells are showing a slow but gradual decrease in tritium concentration since first sampled in 2006. In May 2012, the area around well AR-7, located just west of the plant structures, was excavated and re-packed with clay-based soil. This well had detected tritium just above the LLD (234 – 291 pCi/L) in 2011/2012 that was believed to have originated from precipitation recapture of permitted gaseous releases of tritium from the plant that had entered the well during rainfall events as a result of improperly compacted soil around the well during original installation. Tritium has not been detected in this well above the 200 pCi/L LLD since January 2012. The tritium detected in groundwater samples has been isolated to the Galena-Platteville aquifer, which is isolated from the deeper regional groundwater aquifer by the semi-confining Glenwood Formation. Groundwater quality data from production wells and monitoring wells at the station located below this aquifer do not indicate concentrations of tritium greater than the LLD of 200 pCi/L. As such, the tritium impact is limited to the Galena-Platteville aquifer.

Strontium

Strontium-90 was not detected in any samples above the LLD of 1 pCi/L.

Gross Alpha and Gross Beta (dissolved and suspended)

Gross Alpha and Gross Beta analyses in the dissolved and suspended fractions were performed on groundwater surface water samples during the second sampling in 2012. Gross Alpha (dissolved) was not detected in any of 8 groundwater locations. Gross Alpha (suspended) was detected in 3 of 8 groundwater locations. The concentrations ranged from 1.2 to 4.1 pCi/L. Gross Beta (dissolved) was detected in 7 of 8 groundwater locations. The concentrations ranged from 2.0 to 23.5 pCi/L. Gross Beta (suspended) was detected in three of the 8 groundwater locations. The concentrations ranged from 2.4 to 4.0 pCi/L. The concentrations of Gross Alpha and Gross Beta, which are slightly above detectable levels, are considered to be background and are not the result of plant effluents.

Gamma Emitters

Naturally occurring K-40 was detected in one sample at a concentration of 203 pCi/L. All other gamma-emitting radionuclides associated with licensed plant operations were not detected at concentrations greater than their respective Lower Limits of Detection (LLDs) in any of the samples during 2012.

Hard-To-Detect

Hard-To-Detect analyses were not performed in 2012.

B. Drinking Water Well Survey

No drinking water well surveys were conducted in 2012.

C. Summary of Results – Inter-Laboratory Comparison Program

Inter-Laboratory Comparison Program results for TBE are presented in the AREOR.

D. Leaks, Spills, and Releases

There are no new previously unidentified leaks or plumes at Byron Station. There were no new leaks, spills or releases at Byron Station in 2012.

E. Trends

Wells AR-4 and AR-11 have shown an overall decrease in tritium concentration since first sampled in 2006.

F. Investigations

There were no investigations that took place in 2012 as a result of groundwater sample results.

G. Actions Taken

1. Compensatory Actions

No compensatory actions were initiated in 2012.

2. Installation of Monitoring Wells

No new monitoring wells were installed in 2012.

3. Actions to Recover/Reverse Plumes

No actions were undertaken to recover/reverse plumes in 2012.

Intentionally left blank

APPENDIX A

LOCATION DESIGNATION

TABLE A-1:

Radiological Groundwater Protection Program - Sampling Locations, Distance and Direction, Byron Nuclear Generating Station, 2012

Site	Site Type	Temporary/Permanent	Distance and Direction
AR-1	Monitoring Well	Permanent	0.36 miles/NNW
AR-10	Monitoring Well	Permanent	0.28 miles/NE
AR-11	Monitoring Well	Permanent	1.36 miles/WNW
AR-2	Monitoring Well	Permanent	0.6 miles/NW
AR-3	Monitoring Well	Permanent	0.8 miles/NW
AR-4	Monitoring Well	Permanent	1.36 miles/WNW
AR-5	Monitoring Well	Permanent	1.92 miles/WNW
AR-6	Monitoring Well	Permanent	2.04 miles/WNW
AR-7	Monitoring Well	Permanent	0.04 miles/W
AR-8	Monitoring Well	Permanent	0.12 miles/S
AR-9	Monitoring Well	Permanent	0.24 miles/E
CAR-1	Monitoring Well	Permanent	2.25 miles/WNW
CAR-2	Monitoring Well	Permanent	1.52 miles/WNW
CAR-3	Monitoring Well	Permanent	0.16 miles/SE
DF-24 (EPA well)	Monitoring Well	Permanent	1.36 miles/WNW
GW-9	Monitoring Well	Permanent	0.9 miles/WNW
MW-1 (EPA well)	Monitoring Well	Permanent	0.6 miles/NW
MW-3 (EPA well)	Monitoring Well	Permanent	0.8 miles/NW
TW-13	Monitoring Well	Permanent	2.3 miles/WNW
TW-14	Monitoring Well	Permanent	2.25 miles/WNW
TW-15	Monitoring Well	Permanent	2.2 miles/WNW
Well 7	Monitoring Well	Permanent	0.4 miles/SE

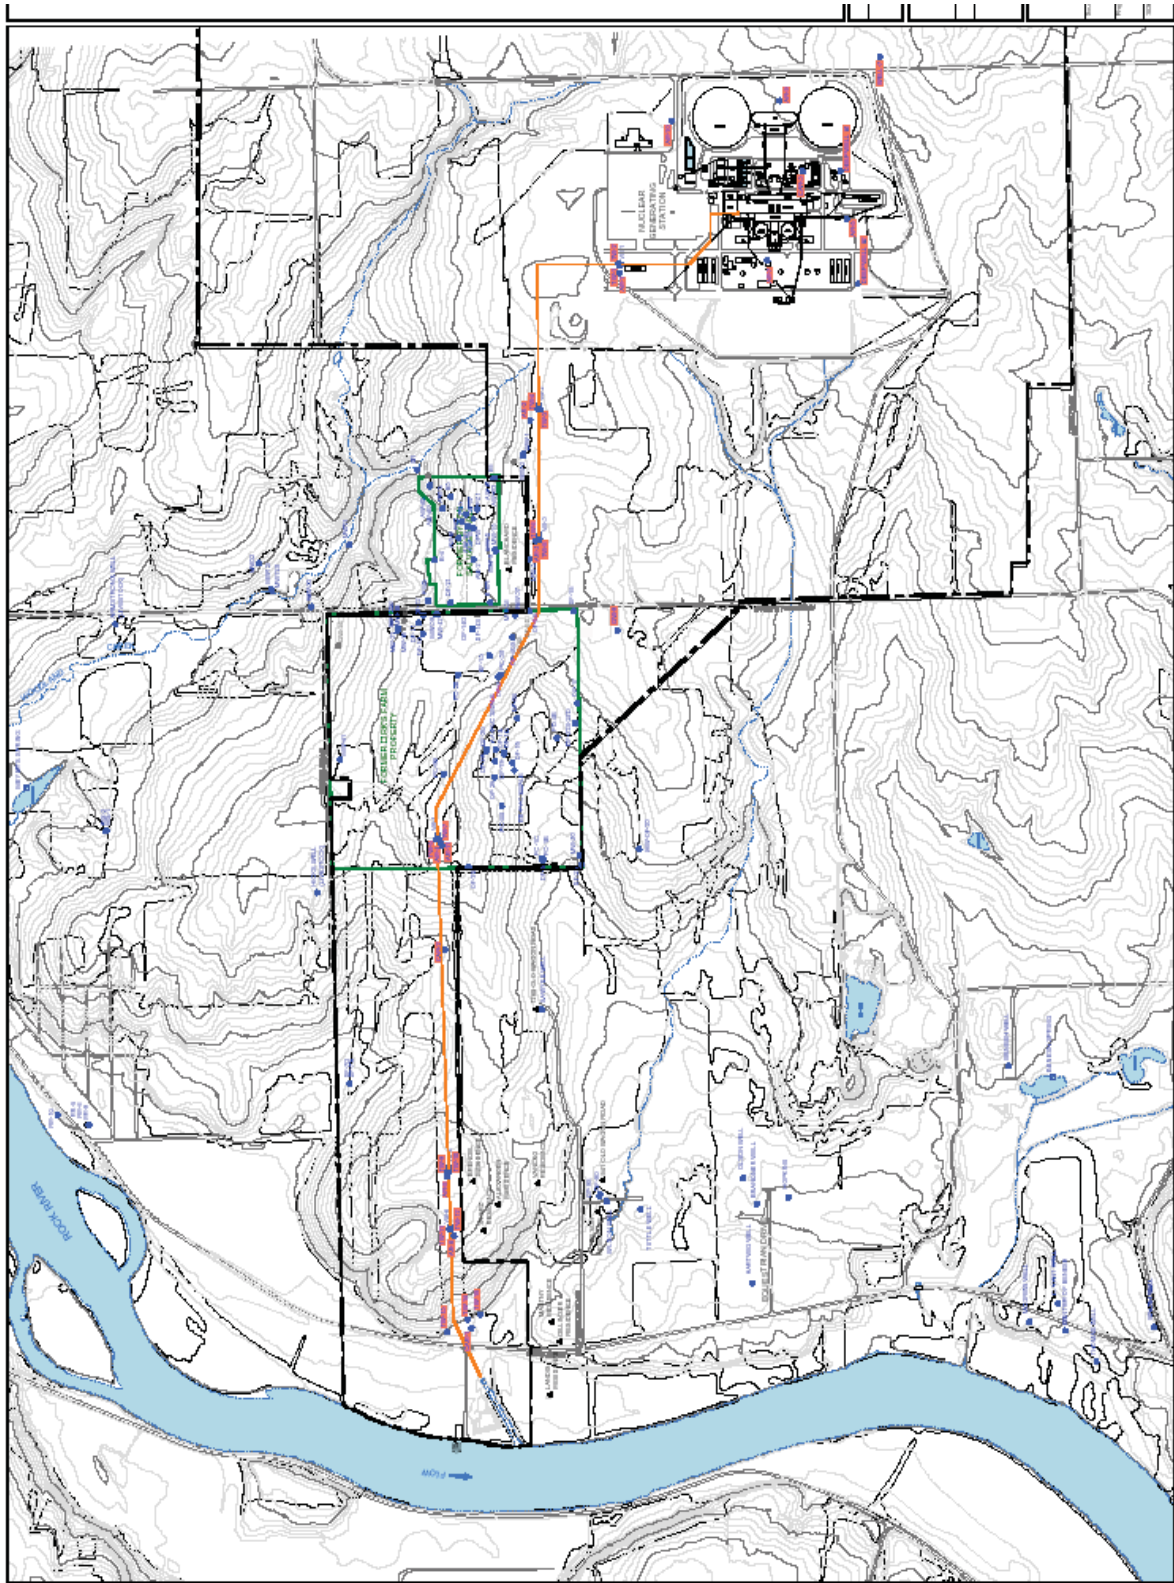


Figure A-1
Monitoring Well Locations, Byron Nuclear Generating Station, 2012

APPENDIX B

DATA TABLES

TABLE B-I.1 CONCENTRATIONS OF TRITIUM, STRONTIUM-90, GROSS ALPHA AND GROSS BETA IN GROUNDWATER SAMPLES COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012

RESULTS IN UNITS OF PCI/LITER \pm 2 SIGMA

SITE	COLLECTION DATE	H-3	SR-90	GR-A (DIS)	GR-A (SUS)	GR-B (DIS)	GR-B (SUS)
AR-1	03/06/12	< 174					
AR-1	05/14/12	< 175	< 0.4	< 0.9	< 0.8	2.6 \pm 1.0	< 1.8
AR-1	08/20/12	< 170					
AR-1	10/16/12	< 173					
AR-10	03/06/12	< 173					
AR-10	05/14/12	< 174	< 0.7	< 4.8	3.0 \pm 1.4	< 7.4	4.0 \pm 2.5
AR-10	08/20/12	< 173					
AR-10	10/16/12	< 172					
AR-11	03/07/12	1100 \pm 170					
AR-11	05/16/12	1110 \pm 166					
AR-11	08/15/12	1210 \pm 194					
AR-11	10/17/12	994 \pm 152					
AR-2	05/16/12	< 169					
AR-2	10/17/12	< 157					
AR-3	03/07/12	< 169					
AR-3	05/16/12	< 172	< 0.7	< 0.7	< 1.2	6.3 \pm 1.2	< 1.7
AR-3	08/15/12	< 193					
AR-3	10/17/12	< 158					
AR-4	03/07/12	861 \pm 148					
AR-4	05/16/12	802 \pm 141	< 0.7	< 1.0	1.2 \pm 0.7	2.0 \pm 1.2	2.4 \pm 1.3
AR-4	08/15/12	872 \pm 174					
AR-4	10/17/12	830 \pm 140					
AR-7	01/06/12	234 \pm 127					
AR-7	03/02/12	< 175					
AR-7	05/14/12	< 200	< 0.5	< 3.5	< 0.8	23.5 \pm 2.1	< 1.8
AR-7	08/20/12 (1)	182 \pm 114					
AR-7	10/16/12 (1)	191 \pm 116					
AR-8	03/06/12	< 171					
AR-8	05/14/12	< 172	< 0.4	< 3.2	4.1 \pm 1.3	7.0 \pm 1.6	2.4 \pm 1.4
AR-8	08/20/12	< 173					
AR-8	10/16/12	< 174					
AR-9	03/06/12	< 172					
AR-9	05/14/12	< 173	< 0.5	< 1.4	< 0.8	2.5 \pm 1.1	< 1.8
AR-9	08/20/12	< 171					
AR-9	10/16/12	< 171					
CAR-1	05/16/12	< 168					
CAR-1	10/17/12	< 159					
CAR-3	03/06/12	< 171					
CAR-3	05/14/12	< 174	< 0.9	< 1.7	< 1.2	4.2 \pm 1.2	< 1.7
CAR-3	08/20/12	< 172					
CAR-3	10/16/12	< 175					

(1) RESULTS GREATER THAN THE MINIMUM DETECTABLE CONCENTRATION (MDC), BUT LESS THAN THE ESTABLISHED LOWER LIMIT OF DETECTION (LLD) OF 200 PCI/L.

TABLE B-I.1 CONCENTRATIONS OF TRITIUM, STRONTIUM-90, GROSS ALPHA AND GROSS BETA IN GROUNDWATER SAMPLES COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATING STATION, 2012

RESULTS IN UNITS OF PCI/LITER \pm 2 SIGMA

SITE	COLLECTION DATE	H-3	SR-90	GR-A (DIS)	GR-A (SUS)	GR-B (DIS)	GR-B (SUS)
DF-24	03/07/12	< 173					
DF-24	05/16/12	< 167					
DF-24	08/15/12	< 194					
DF-24	10/17/12	< 158					
MW-1	05/16/12	< 167					
MW-1	10/17/12	< 160					
MW-3	05/16/12	< 163					
MW-3	10/17/12	< 157					
TW-13	05/16/12	< 164					
TW-13	10/17/12	< 159					

TABLE B-I.2

CONCENTRATIONS OF GAMMA EMITTERS IN GROUNDWATER SAMPLES
COLLECTED IN THE VICINITY OF BYRON NUCLEAR GENERATION STATION, 2012

RESULTS IN UNITS OF PC/LITER ± 2 SIGMA

SITE	COLLECTION DATE	Be-7	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	I-131	Cs-134	Cs-137	Bar-140	La-140
AR-1	05/14/12	< 36	< 26	< 3	< 3	< 8	< 3	< 8	< 4	< 6	< 14	< 3	< 3	< 28	< 8
AR-10	05/14/12	< 29	< 29	< 3	< 3	< 8	< 3	< 7	< 3	< 6	< 11	< 3	< 3	< 25	< 8
AR-11	05/16/12	< 40	< 44	< 4	< 5	< 10	< 4	< 7	< 5	< 9	< 13	< 4	< 4	< 27	< 10
AR-2	05/16/12	< 30	< 59	< 4	< 4	< 7	< 3	< 7	< 4	< 7	< 10	< 4	< 4	< 27	< 8
AR-3	05/16/12	< 40	< 43	< 4	< 5	< 9	< 5	< 8	< 6	< 8	< 14	< 4	< 5	< 30	< 12
AR-4	05/16/12	< 38	< 37	< 5	< 4	< 10	< 4	< 9	< 4	< 7	< 12	< 4	< 5	< 29	< 10
AR-7	05/14/12	< 36	< 70	< 3	< 4	< 9	< 4	< 7	< 4	< 7	< 14	< 3	< 4	< 29	< 11
AR-8	05/14/12	< 33	< 64	< 3	< 3	< 7	< 4	< 6	< 3	< 7	< 12	< 3	< 4	< 26	< 7
AR-9	05/14/12	< 31	< 56	< 3	< 3	< 7	< 3	< 6	< 4	< 6	< 14	< 3	< 4	< 25	< 7
CAR-1	05/16/12	< 43	< 76	< 5	< 4	< 7	< 6	< 10	< 5	< 8	< 12	< 3	< 4	< 32	< 7
CAR-3	05/14/12	< 36	< 24	< 3	< 3	< 7	< 3	< 7	< 4	< 6	< 13	< 3	< 4	< 26	< 7
TW-13	05/16/12	< 36	203 ± 101	< 5	< 5	< 11	< 4	< 8	< 4	< 8	< 13	< 4	< 4	< 28	< 10