

J. Todd Conner  
Site Vice President

DTE Energy Company  
6400 N. Dixie Highway, Newport, MI 48166  
Tel: 734.586.4849 Fax: 734.586.5295  
Email: connerj@dteenergy.com

**DTE Energy**



April 28, 2014  
NRC-14-0032

TS 5.5.1  
TS 5.6.2  
TS 5.6.3

U. S. Nuclear Regulatory Commission  
Attention: Document Control Desk  
Washington D C 20555-0001

Reference: Fermi 2  
NRC Docket No. 50-341  
NRC License No. NPF-43

Subject: Annual Radioactive Effluent Release Report and  
Radiological Environmental Operating Report

In accordance with Technical Specifications (TS) 5.6.2 and 5.6.3, DTE Electric Company hereby submits the Annual Radioactive Effluent Release Report and the Radiological Environmental Operating Report for Fermi 2. Enclosure 1 provides the 2013 Annual Radioactive Effluent Release Report. Enclosure 1 includes a revised copy of the Offsite Dose Calculation Manual (ODCM) as required by TS 5.5.1. Enclosure 2 provides the 2013 Annual Radiological Environmental Operating Report. Both reports cover the time period from January 1 through December 31, 2013.

Should you have any questions regarding these reports, please contact Mr. Richard LaBurn, Manager - Radiation Protection at (734) 586-4974.

Sincerely,

A handwritten signature in black ink, appearing to be 'J. Todd Conner', written over a horizontal line.

Enclosures

cc: NRC Project Manager  
NRC Resident Office  
Reactor Projects Chief, Branch 5, Region III  
Regional Administrator, Region III  
Michigan Public Service Commission,  
Regulated Energy Division (kindscl@michigan.gov)

**ENCLOSURE 1  
To  
NRC-14-0032**

**2013 Annual Radioactive Effluent Release Report**

**Total Pages - 230**

**Enrico Fermi Atomic Power Plant, Unit 2  
NRC Docket No. 50-341  
NRC License No. NPF-43**

**FERMI 2 NUCLEAR POWER PLANT**  
**DTE Electric Company**  
**OPERATING LICENSE NO. NPF - 43**

**Fermi 2 - 2013 Annual  
Radioactive Effluent Release Report**

**for the period of  
January 1, 2013 through December 31, 2013**

Prepared by:

Fermi 2  
Radiological Engineering

<b>Table of Contents</b>	<b>Page</b>
<b>Executive Summary</b>	<b>4</b>
<b>Introduction</b>	<b>5</b>
Noble Gases	5
Iodines and Particulates	5
Tritium	5
Carbon-14	6
Plant Effluent Monitoring	6
Exposure Pathways to People	7
Dose Assessment	7
<b>Radioactive Effluent Monitoring Results</b>	<b>8</b>
<b>Summary of Radioactive Waste Shipments</b>	<b>11</b>
<b>Additional Required Information</b>	<b>12</b>
Appendices	12
ODCM Revisions	12
ODCM Monitors Out of Service	12
Outside Temporary Tanks	12
Major Changes to Radioactive Waste Systems	12
Abnormal Radiological Releases	12
Errata/Corrections to Previous ARERRs	12
<b>Appendix A: Effluent and Radioactive Waste Data</b>	
<b>Appendix B: Ground Water Protection Program Data and Analysis</b>	
<b>Appendix C: Rainwater Data and Analysis</b>	
<b>Appendix D: Meteorological Joint Frequency Distributions</b>	
<b>Appendix E: Revised Offsite Dose Calculation Manual</b>	

<i>List of Tables</i>	<i>Page</i>
<i>Table 1 Fission and Activation Gases (Noble Gases) Summary</i>	<i>8</i>
<i>Table 2 Radioiodines Summary</i>	<i>8</i>
<i>Table 3 Particulates Summary</i>	<i>9</i>
<i>Table 4 Tritium and Carbon-14 Summary</i>	<i>9</i>
<i>Table 5 2013 Gaseous Effluent Dose to Receptor with Highest Single Organ Dose</i>	<i>10</i>
<i>Table 6 Waste Shipped Offsite</i>	<i>11</i>
<i>Table 7 Waste Shipments</i>	<i>11</i>
<i>Table 8 Deep Monitor Well Tritium Analysis Results</i>	<i>B-5</i>
<i>Table 9 Shallow Monitor Well Tritium Analysis Results</i>	<i>B-6</i>
<i>Table 10 Emergent Event Monitor Well Tritium Analysis Results</i>	<i>B-9</i>
<i>Table 11 Rain Water and Storm Water Tritium Analysis Results</i>	<i>C-3</i>

## ***Executive Summary***

This report is published to provide information regarding radioactive effluent monitoring at the Fermi 2 nuclear power plant. The 2013 Annual Radioactive Effluent Release Report covers the period from January 1, 2013 through December 31, 2013.

The Radioactive Effluent Release Report is produced annually, to document plant releases and offsite dose resulting from these releases. The data presented indicate that the operation of Fermi 2 results in offsite radiation exposures that are well below the applicable allowable levels set by the Nuclear Regulatory Commission (NRC) and the Environmental Protection Agency (EPA).

There were no releases of liquid radioactive effluents from Fermi 2 in 2013. Data on releases of radioactive isotopes in gaseous effluents, as well as regulatory limits and sampling methods for these releases, are contained in the body of the report and in Appendix A.

Regulatory limits for radioactive effluents pertain to allowable offsite doses rather than to quantities of radioactivity released. The highest potential single organ dose to a person living offsite due to iodines, particulates, tritium, and carbon-14 released from the plant was calculated to be 0.22 mrem, which is 1.5% of the applicable limit found in 10 CFR Part 50, Appendix I.

During 2013, no direct radiation dose to members of the public beyond the site boundary was attributed to the operation of Fermi 2, based on analysis of readings of thermoluminescent dosimeters (TLD) placed at various locations near the Fermi site. The offsite dose due to effluents is a small fraction of the 40 CFR 190 limits. Therefore, the combined direct radiation and effluent dose due to Fermi 2 was in compliance with 40 CFR 190 in 2013.

Data on radioactivity contained in radioactive waste shipments from Fermi 2 to points offsite are contained in the body of the report and in Appendix A. Appendix B of this report describes the Fermi Integrated Ground Water Protection Program. This program was established as part of the site's commitment to conformance with an industry-wide ground water protection initiative. This appendix also contains the results of 2013 quarterly ground water sampling, from approximately 60 monitor wells around Fermi 2 (ground water sampling has been performed under this program since the fall of 2007). Some of these monitor wells, primarily to the east and south of Fermi 2, have yielded sporadic trace quantities of tritium that have been attributed to the recapture of tritium in precipitation from the plant's monitored gaseous effluent. Appendix C of this report provides data on tritium concentrations in rainwater samples collected onsite which represent this recapture phenomenon (NRC RIS 08-03). Appendix D of this report contains the meteorological joint frequency distribution tables for 2013. The Offsite Dose Calculation Manual (ODCM) was revised in 2013, and the revised ODCM is shown as Appendix E. Additional sections of the report address ODCM required monitors which were out of service for more than 30 days in 2013, major changes in radioactive waste processing, the contents of outside temporary tanks, abnormal releases, and errata to previous years' reports (see page 12).

## ***Introduction***

During the normal operation of a nuclear power plant, most of the fission products are retained within the fuel and fuel cladding. However, small amounts of radioactive fission products and trace amounts of the component and structure surface corrosion products that have been activated are present in the primary coolant water, as well as tritium and carbon-14. The five types of radioactive material released are noble gases, iodines, particulates, tritium, and carbon-14.

### ***Noble Gases***

Some of the fission products released in airborne effluents are radioactive isotopes of noble gases, such as xenon and krypton. These noble gases are released continuously at low levels while the reactor is operating. Noble gas releases to the environment are reduced by plant systems which delay release of these gases from the plant, which allows a portion of the noble gas activity to decay within plant systems prior to release.

Noble gases are biologically and chemically nonreactive and are readily dispersed in the atmosphere. They do not concentrate in humans or other organisms; however, they contribute to human radiation dose by being an external source of radiation exposure to the body.

### ***Iodines and Particulates***

Fermi 2 is required to calculate offsite dose due to releases of iodine-131 and iodine-133, which are radioisotopes of iodine with half lives of 8 days and 1 day, respectively, and particulates with half-lives greater than 8 days in gaseous and liquid effluents, and tritium. The principal radioactive particulates released are fission products (e.g., yttrium-91m and barium-139) and activation products (e.g., cobalt-58 and cobalt-60). Annual releases of these radionuclides are well within industry norms. Factors such as their high chemical reactivity and solubility in water, combined with the high efficiency of gaseous and liquid processing and radioactive waste systems, minimize their discharge.

The main contribution of radioactive iodine to human radiation dose is to the thyroid gland, where the body concentrates iodine. This exposure results from inhalation or ingestion of these iodines. Radioactive cesiums and cobalts, when ingested or inhaled, contribute to radiation exposure of tissues such as the muscle, liver, and intestines. These iodines and particulates are also a source of external radiation exposure if deposited on the ground.

### ***Tritium***

Tritium, a radioactive isotope of hydrogen, is the predominant radionuclide in radioactive gaseous effluents. It is detected at Fermi 2 in ventilation exhaust samples.

### ***Carbon-14***

U.S. nuclear power plants are expected to report releases of carbon-14 (C-14). The releases reported are based on calculations involving the thermal power rating of the unit and 2013 monthly capacity factors. The Fermi 2 UFSAR estimates annual gaseous C-14 releases of 9.88 curies. The calculation performed for this report estimated a total 2013 C-14 release of 12.2 curies.

### ***Plant Effluent Monitoring***

Effluents are strictly monitored to ensure that radioactivity released to the environment is as low as reasonably achievable and does not exceed regulatory limits. Effluent control includes the operation of monitoring systems, in-plant and environmental sampling and analyses programs, quality assurance programs for effluent and environmental programs, and procedures covering all aspects of effluent and environmental monitoring.

The radioactive waste treatment systems at Fermi 2 are designed to collect, process, and/or delay the release of liquid and gaseous wastes that contain radioactivity. For example, the 2.0 and 2.2 minute holdup pipes delay the release of radioactive gases so that radioactive decay can occur prior to release. The offgas system provides additional delay for such gases.

Radioactivity monitoring systems are used to verify that all releases are below regulatory limits. These instruments provide a continuous indication of radioactivity present at the release points. Each instrument is equipped with alarms and indicators in the control room. The alarm setpoints are low enough to ensure that applicable limits will not be exceeded. In some cases, these alarms restrict the release. For example, several alarms cause building ventilation systems to be shut down and/or gaseous releases to be diverted to the standby gas treatment system.

All liquid and gaseous radioactive effluents are evaluated to identify the specific concentrations of radionuclides being released. Sampling and analysis provide a more sensitive and precise method of determining effluent composition than monitoring instruments.

A meteorological tower is located on the Fermi 2 site. It is linked to computers that record the meteorological data. These data are used in calculating dispersion and deposition factors, which are essentially dilution factors between plant release points and points offsite. Coupled with the effluent release data, these factors are used to calculate dose to the public.

Beyond the plant, devices maintained in conjunction with the Radiological Environmental Monitoring Program constantly sample the air in the surrounding environment. Also, frequent samples of other environmental media, such as water and vegetation, are collected to verify that the station radiological effluent program is being appropriately implemented without adverse impact to the surrounding environment.



## ***Exposure Pathways to People***

Radiological exposure pathways define the methods by which people may become exposed to radioactive material. The major pathways of concern are those that could cause the highest calculated radiation dose. These projected pathways are determined from the type and amount of radioactive material released, the environmental transport mechanism, and the use of the environment. The environmental transport mechanism includes consideration of physical factors, such as the hydrological and meteorological characteristics of the area.

An important factor in evaluating the exposure pathways is the use of the environment. This is evaluated in the annual Land Use Census. Many factors are considered, such as the locations of homes, gardens, and milk or meat animals in the area.

The release of radioactive gaseous effluents involves pathways such as external whole body exposure, deposition of radioactive material on plants, deposition on soil, inhalation and ingestion by animals raised for human consumption, and inhalation by humans. The release of radioactive material in liquid effluents involves pathways such as drinking water and fish consumption.

Although radionuclides can reach humans by many different pathways, some result in greater dose than others. The most significant pathway is the exposure pathway that will provide the greatest dose to a population, or to a specific individual. Identification of the most significant pathway depends on the radionuclides involved, the age and diet of the individual, and the location of the individual's residence. Doses delivered to the total body and to specific organs are calculated. The organ receiving the greatest dose is important in determining compliance with dose limits. The standard assumptions used in dose calculation result in conservative dose estimates.

## ***Dose Assessment***

Dose is energy deposited by radiation in an exposed individual. Whole body exposure to radiation involves the exposure of all organs. Most exposures due to external sources of radiation are of this type. Both non-radioactive and radioactive elements can enter the body through inhalation or ingestion. When they do, they are usually not distributed evenly. For example, iodine concentrates in the thyroid gland, cesium collects in muscle and liver tissue, and strontium collects in bone tissue.

The total dose to organs from a given radionuclide depends on the amount of radioactive material present in the organ and the amount of time that the radionuclide remains in the organ. Some radionuclides remain for very short times due to their rapid radioactive decay and/or elimination rate from the body, while other radionuclides may remain in the body for longer periods of time. The form of the radionuclide (soluble vs. insoluble) and the method of uptake also influence residence times in the body.

The maximum dose to the general public in the area surrounding Fermi 2 is calculated for periods of gaseous release and for each liquid release. The dose due to radioactive material released in gaseous effluents is calculated using factors such as the amount of radioactive material released, the concentration beyond the site boundary, the locations of exposure pathways (for example cow milk, goat milk, vegetable gardens and residences), and usage factors (inhalation and food consumption). The dose due to radioactive material released in liquid effluents is calculated using factors such as radionuclide concentrations, the total volume of liquid released, the total volume of dilution water, near field dilution, and usage factors (water and fish consumption). These calculations produce a conservative estimation of the dose.

### ***Radioactive Effluent Monitoring Results***

This section summarizes the results of effluent monitoring and offsite dose calculation for the year 2013. Calculated offsite doses are compared with Nuclear Regulatory Commission limits, and these limits are summarized in Appendix A. Appendix A also contains a detailed discussion of the methods used to determine quantities of radioactivity released in effluents, the types of solid radioactive waste shipped offsite, as well as tables of individual radionuclides released in effluents and shipped as solid radioactive waste. There were no routine or abnormal releases of liquid radioactive effluents from Fermi 2 in 2013. There has not been a routine liquid radioactive discharge from Fermi 2 since 1994.

The data in the following gaseous effluent tables represent continuous and batch releases. In 2013, there were 5 recorded containment purges in which radioactivity was detected. The total time for these purges was 19649 minutes. Based on recorded start and stop times, the shortest of these purges lasted 132 minutes, the longest lasted 13606 minutes, and the average purge length was 3930 minutes. The amounts of radioactivity released in these purges were very small compared with the amounts released in continuous releases.

**Table 1 - Fission and Activation Gases (Noble Gases) Summary**

	<b>Quarter 1</b>	<b>Quarter 2</b>	<b>Quarter 3</b>	<b>Quarter 4</b>
Release (curies)	1.83E+00	3.25E+00	3.76E+00	3.43E+00
Average Release Rate for Period (μCi/sec)	2.35E-01	4.13E-01	4.73E-01	4.31E-01

**Table 2 - Radioiodines Summary**

	<b>Quarter 1</b>	<b>Quarter 2</b>	<b>Quarter 3</b>	<b>Quarter 4</b>
Total I-131 (curies)	2.15E-04	1.55E-04	2.29E-04	3.17E-04
Average Release Rate for Period (μCi/sec)	2.76E-05	1.97E-05	2.88E-05	3.99E-05

**Table 3 - Particulates Summary**

	<b>Quarter 1</b>	<b>Quarter 2</b>	<b>Quarter 3</b>	<b>Quarter 4</b>
Particulates with half lives > 8 days (curies)	6.29E-04	3.94E-03	7.05E-04	1.31E-04
Average Release Rate for Period ( $\mu\text{Ci}/\text{sec}$ )	8.08E-05	5.01E-04	8.87E-05	1.65E-05
Gross Alpha Radioactivity	<1.5E-15* uCi/cc	<1.5E-15* uCi/cc	<1.5E-15* uCi/cc	<1.5E-15* uCi/cc

\*In the above table, the “less than” value in units of microcuries per cubic centimeter ( $\mu\text{Ci}/\text{cc}$ ) is used when no radioactivity was detected and represents the lower limit of detection (LLD) value for a single sample.

**Table 4 - Tritium (H-3) and Carbon-14 (C-14) Summary**

	<b>Quarter 1</b>	<b>Quarter 2</b>	<b>Quarter 3</b>	<b>Quarter 4</b>
Total H-3 Release (curies)	6.28E+01	8.82E+01	4.62E+01	7.25E+01
Average H-3 Release Rate ( $\mu\text{Ci}/\text{sec}$ )	8.07E+00	1.12E+01	5.81E+00	9.12E+00
Total C-14 Release (curies)	2.87E+00	2.47E+00	2.55E+00	4.30E+00
Average C-14 Release Rate ( $\mu\text{Ci}/\text{sec}$ )	3.69E-01	3.14E-01	3.21E-01	5.41E-01

The offsite dose impact of the above releases was evaluated by calculating organ doses to the most highly exposed individual (an adult) living near the plant due to I-131, I-133, H-3, C-14 and particulates with half lives greater than 8 days. The most significant pathways of exposure to this individual have been determined to be inhalation, vegetation ingestion, and direct radiation from material deposited on the ground. The results of this calculation, which employs conservative assumptions, are shown in the following table:

**Table 5**

<b>Organ</b>	<b>2013 Gaseous Effluent Dose to Receptor with Highest Single Organ Dose</b>
<b>Bone</b>	2.20E-01 mrem
<b>Liver</b>	1.16E-01 mrem
<b>Thyroid</b>	1.28E-01 mrem
<b>Kidney</b>	1.15E-01 mrem
<b>Lung</b>	1.16E-01 mrem
<b>GI-LLI</b>	1.17E-01 mrem
<b>Total body</b>	1.16E-01 mrem

The highest single organ dose is 2.20E-01 mrem to the bone. This is 1.5% of the federal limit of 15 mrem specified in 10 CFR 50, Appendix I. (The Fermi 2 Offsite Dose Calculation Manual requires maximum receptor dose calculation for releases of I-131, I-133, H-3, and particulates with half lives greater than 8 days; for these isotopes, the thyroid is the highest dose organ. When C-14 is added, bone becomes the highest dose organ.)

In addition, gamma and beta air dose at the site boundary due to noble gases was calculated. In 2013, gamma air dose was 3.15E-03 mrad, 0.03% of the 10 mrad annual limit; beta air dose in 2013 was 1.43E-03 mrad, 0.007% of the 20 mrad annual limit.

Title 40, Part 190 of the Code of Federal Regulations requires that dose to an individual in the unrestricted area from the uranium fuel cycle, including direct radiation dose, be limited to 25 mrem/year to the total body and 75 mrem/year to the thyroid. During 2013, there was no direct radiation dose attributed to the operation of Fermi 2 beyond the site boundary, based on analysis of offsite TLD readings. Based on Table 5 above, the offsite dose due to effluents is 0.46% and 0.17% of 40 CFR 190 limits for the total body and thyroid, respectively. Therefore, Fermi 2 was in compliance with 40 CFR 190 in 2013.

Potential dose to visitors at Fermi 2 due to all radioactive effluents, including noble gases, was also calculated. The Offsite Dose Calculation Manual (ODCM) considers persons visiting the Fermi 2 Visitors Center (4 hours/year), and persons potentially ice fishing on Lake Erie near the plant (240 hours/year), to be visitors. Using ODCM assumptions about these categories of visitors, the maximum potential dose to a visitor to Fermi 2 in 2013 was 5.20E-03 mrem to the maximally exposed organ (thyroid) and 4.96E-03 mrem to the total body. These doses are below the annual maximum offsite doses due to gaseous effluents shown in Table 5, and are very small fractions of the 100 mrem/year limit for individual members of the public due to licensed operation of the plant provided in 10 CFR 20.1301.

### Summary of Radioactive Waste Shipments

The radioactivity and volume of Fermi 2 solid waste shipped offsite is summarized in the following table:

**Table 6 - Waste Shipped Offsite**

Type of Waste	Units	12 Month Period	Est. total activity error, %
Spent resins, sludges, etc.	m <sup>3</sup> curies	1.12E+02 3.10E+03	± 25
Dry compressible waste, contaminated equipment, etc.	m <sup>3</sup> curies	8.25E+02 4.00E+00	± 25
Irradiated components, control rods, etc.	m <sup>3</sup> curies	0 0	N/A
Other			
Filters	m <sup>3</sup> curies	1.61E+01 4.11E+02	± 25
Water / Other Liquids	m <sup>3</sup> curies	3.44E+01 3.66E-02	± 25

Radioactive solid waste shipments from Fermi 2 in 2013 (to either disposal or to intermediate processors) are summarized in the following table:

**Table 7 – Waste shipments**

Number of shipments	Mode of transportation	Destination
21	Highway	EnergySolutions, Clive, UT
20	Highway	EnergySolutions, Oak Ridge, TN
5	Highway	EnergySolutions, Barnwell, SC

## ***Additional Required Information***

### ***Appendices***

Appendix A, Effluent and Radioactive Waste Data, provides more detailed data on radiological effluents and radioactive waste shipments. Appendix B contains a description of the Fermi 2 Integrated Groundwater Protection Program, 2013 sampling data for this program, and a discussion of sampling results. Appendix C contains data on tritium concentrations in rainwater collected onsite and explains the significance of these data. Appendix D contains meteorological joint frequency distributions of wind speed and wind direction by atmospheric stability class, for all of 2013. Appendix E contains the revised ODCM.

### ***ODCM Revisions***

A revision to the ODCM was issued in April 2013. Appendix E contains the revised ODCM with the changes marked in the margins of the affected pages.

### ***ODCM Monitors Out of Service***

From April 2, 2013 to July 19, 2013, offgas radiation monitor channel B was inoperable due to I&C not being able to complete a required electronic calibration due to procedural problems. The delay of greater than 30 days until return to service was due to a lack of resources and other I&C priorities.

### ***Outside Temporary Tanks***

In 2013 no outside temporary tank exceeded the 10 curie content limit for nuclides other than tritium and dissolved or entrained noble gases.

### ***Major Changes to Radioactive Waste Systems***

There were no major changes to radioactive waste systems in 2013.

### ***Abnormal Radiological Releases***

There were no abnormal radiological releases in 2013.

### ***Errata/Corrections to Previous ARERRs***

No errata for the ARERR for 2012 have been noted.

Appendix A  
Effluent and Radioactive Waste Data

## **Regulatory Limits for Radioactive Effluents**

The Nuclear Regulatory Commission (NRC) limits on liquid and gaseous effluents are incorporated into the Fermi 2 Offsite Dose Calculation Manual. These limits prescribe the maximum doses and dose rates due to radioactive effluents resulting from normal operation of Fermi 2. These limits are described in the following sections.

### **A. Gaseous Effluents**

I. Dose rate due to radioactivity released in gaseous effluents to areas at and beyond the site boundary shall be limited to the following:

a) Noble gases

Less than or equal to 500 mrem/year to the total body.

Less than or equal to 3000 mrem/year to the skin.

b) Iodine-131, iodine-133, tritium, and for all radionuclides in particulate form with half lives greater than 8 days

Less than or equal to 1500 mrem/year to any organ.

II. Air dose due to noble gases to areas at and beyond the site boundary shall be limited to the following:

a) Less than or equal to 5 mrad for gamma radiation

Less than or equal to 10 mrad for beta radiation

- During any calendar quarter

b) Less than or equal to 10 mrad for gamma radiation

Less than or equal to 20 mrad for beta radiation

- During any calendar year



III. Dose to a member of the public from iodine-131, iodine-133, tritium, and all radionuclides in particulate form with half lives greater than 8 days in gaseous effluents released to areas at and beyond the site boundary shall be limited to the following:

- a) Less than or equal to 7.5 mrem to any organ  
- During any calendar quarter
- b) Less than or equal to 15 mrem to any organ  
- During any calendar year

**Note:** The calculated site boundary dose rates for Fermi 2 are based on identification of individual isotopes and on use of dose factors specific to each identified isotope or a highly conservative dose factor. Since individual isotopes are identified, average energy values are not used in these calculations, and therefore are not reported even though their use in these calculations is allowed by Regulatory Guide 1.21.

## **B. Liquid Effluents**

- I. The concentration of radioactive material released in liquid effluents to unrestricted areas shall be limited to ten times the concentrations specified in Title 10 of the Code of Federal Regulations (10 CFR) Part 20 (Standards for Protection Against Radiation), Appendix B, Table 2, Column 2 for radionuclides other than dissolved or entrained noble gases, as required by the Fermi 2 Offsite Dose Calculation Manual. For dissolved or entrained noble gases, the concentration shall be limited to 2E-4 (.0002) microcuries/ml total activity. This limit is based on the Xe-135 air submersion dose limit converted to an equivalent concentration in water as discussed in the International Commission on Radiological Protection (ICRP) Publication 2.
- II. The dose or dose commitment to a member of the public from radioactive materials in liquid effluents released to unrestricted areas shall be limited to the following:
  - a) Less than or equal to 1.5 mrem to the total body  
Less than or equal to 5 mrem to any organ  
- During any calendar quarter
  - b) Less than or equal to 3 mrem to the total body  
Less than or equal to 10 mrem to any organ  
- During any calendar year

As noted previously, Fermi 2 did not perform radioactive liquid releases in 2013.

## **Measurements and Approximations of Total Activity in Radioactive Effluents**

As required by NRC Regulatory Guide 1.21, this section describes the methods used to measure the total radioactivity in effluent releases and to estimate the overall errors associated with these measurements. The effluent monitoring systems are described in Chapter 11.4 of the Fermi 2 Updated Final Safety Analysis Report (UFSAR).

### **A. Gaseous Effluents**

#### ***I. Fission and Activation Gases***

Samples are obtained from each of the six plant radiation monitors which continuously monitor the five ventilation exhaust points. The fission and activation gases are quantified by gamma spectroscopy analysis of periodic samples.

The summary values reported are the sums of all fission and activation gases quantified at all monitored release points.

#### ***II. Radioiodines***

Samples are obtained from each of the six plant radiation monitors which continuously monitor the five ventilation exhaust points. The radioiodines are entrained on charcoal and then quantified by gamma spectroscopy analysis. For each sample, the duration of sampling and continuous flow rate through the charcoal are used in determining the concentration of radioiodines. From the flow rate of the ventilation system, a rate of release can be determined.

The summary values reported are the sums of all radioiodines quantified at all continuously monitored release points.

### ***III. Particulates***

Samples are obtained from each of the six plant effluent radiation monitors which continuously monitor the five ventilation exhaust points. The particulates are collected on a filter and then quantified by gamma spectroscopy analysis.

For each sample, the duration of sampling and the continuous flow rate through the filter are used in determining the concentration of particulates. From the flow rate of the ventilation system, a rate of release can be determined.

Quarterly, the filters from each ventilation release point are composited and then radiochemically separated and analyzed for strontium (Sr)-89/90 and iron (Fe)-55.

The summary values reported are the sums of all particulates quantified at all monitored release points.

### ***IV. Tritium***

Samples are obtained from each of the six plant effluent radiation monitors which continuously monitor the five ventilation exhaust points. The sample is passed through a bottle containing water and the gaseous tritium is collected in this water. Portions of the collecting water are analyzed for tritium using liquid scintillation counting techniques. For each sample, the duration of sample and sample flow rate is used to determine the concentration. From the flow rate of the ventilation system, a release rate can be determined.

In addition to tritium releases from the five ventilation exhaust points, gaseous tritium releases from the Condensate Storage Tank and Condensate Return Tank have been calculated. These releases are due to evaporation of tritiated water in these tanks which is released through tank vents. However this is not a significant release point for tritium, contributing well less than 1% of total tritium releases. These releases were calculated to total 5.06E-02 curies in 2013; adding them to reported tritium releases from the ventilation release points does not change the reported release quantities, which are greater than 10 curies in each quarter and are expressed to three significant digits.

The summary values reported are the sums of all tritium quantified at all monitored release points.

### ***V. Gross Alpha***

The gaseous particulate filters from the six plant effluent radiation monitors are stored for one week to allow for decay of naturally occurring alpha emitters. These filters are then analyzed for gross alpha radioactivity by gas proportional counting, and any such radioactivity found is assumed to be plant related. The quantity of alpha

emitters released can then be determined from sample flow rate, sample duration, and stack flow rate.

The summary values reported are the sums of all alpha emitters quantified at all monitored release points.

### **VI. Carbon-14**

Carbon-14 releases are calculated using a method published by the Electric Power Research Institute in December 2010. Plant rated thermal power and monthly capacity factors were used in the calculation of quarterly releases.

### **B. Liquid Effluents**

The liquid radwaste processing system and the liquid effluent monitoring system are described in the Fermi 2 UFSAR. Fermi 2 did not perform any releases of radioactive liquid effluents in 2013.

### **C. Statistical Measurement Uncertainties**

The statistical uncertainty of the measurements in this section has been calculated and summarized in the following table:

<b>Measurement Type</b>	<b>Sample Type</b>	<b>One Sigma Uncertainty</b>
Fission and Activation Gases	Gaseous	30%
Radioiodines	Gaseous	17%
Particulates	Gaseous	16%
Tritium	Gaseous	25%
Gross Alpha	Gaseous	16%

### **Gaseous Releases by Individual Nuclide**

Values in the following tables which are preceded by the “less than” symbol represent the lower limit of detection (LLD) in units of microcuries per cubic centimeter ( $\mu\text{Ci}/\text{cc}$ ) for individual samples, and indicate that the nuclide in question was not detected in gaseous effluent samples in the indicated quarter of 2013. For quantities of gross alpha radioactivity, tritium, and carbon-14 in gaseous effluents, see Tables 3 and 4 on page 9 of this report.

**A. Particulate Radionuclides (Curies\*)**

<b>Nuclide</b>	<b>Quarter 1</b>	<b>Quarter 2</b>	<b>Quarter 3</b>	<b>Quarter 4</b>
Mn-54	1.59E-04	1.25E-03	2.15E-04	1.16E-05
Co-58	1.10E-04	8.63E-04	1.11E-04	<6.0E-14
Co-60	1.69E-04	1.21E-03	2.06E-04	2.10E-05
Cr-51	<3.0E-13	4.44E-05	<3.0E-13	<3.0E-13
Zn-65	1.84E-05	3.61E-04	1.87E-05	<1.7E-13
Na-24	1.25E-03	6.10E-03	1.13E-03	<3.2E-13
Zn-69m	1.48E-03	6.64E-04	9.33E-04	<2.7E-13
Tc-99m	5.45E-04	3.64E-03	3.67E-04	<3.7E-13
Ba-139	1.98E-01	1.29E-01	1.19E-01	1.00E-01
La-140	1.66E-04	2.32E-04	1.46E-04	1.22E-04
Ba-140	7.22E-05	4.91E-05	2.29E-05	4.35E-05
Y-91m	2.02E-02	3.01E-02	1.27E-02	2.77E-02
Rb-89	4.94E-02	6.99E-02	1.53E-01	1.82E-02
Cs-138	7.43E-02	6.50E-02	7.17E-02	3.45E-02
Mn-56	1.13E-02	4.04E-02	5.16E-03	<1.5E-11
As-76	2.38E-04	1.11E-03	7.38E-05	<1.4E-13
Br-82	<8.6E-14	<8.6E-14	<8.6E-14	2.59E-05
Sr-91	1.17E-03	3.78E-04	5.09E-04	1.66E-04
Sr-92	<8.4E-12	6.99E-04	<8.4E-12	<8.4E-12
Sr-89	6.61E-05	5.99E-05	4.95E-05	3.84E-05
Sr-90	2.63E-06	2.31E-06	2.07E-06	1.99E-06
Fe-55	3.13E-05	9.43E-05	8.03E-05	1.45E-05
Cs-134	<1.5E-14	<1.5E-14	<1.5E-14	<1.5E-14
Cs-137	<1.9E-14	<1.9E-14	<1.9E-14	<1.9E-14
Ce-141	<6.0E-15	<6.0E-15	<6.0E-15	<6.0E-15
Ce-143	<2.4E-13	<2.4E-13	<2.4E-13	<2.4E-13
Ce-144	<7.5E-14	<7.5E-14	<7.5E-14	<7.5E-14
<b>Total</b>	<b>3.59E-01</b>	<b>3.51E-01</b>	<b>3.65E-01</b>	<b>1.81E-01</b>

\*Less than (<) values are in units of uCi/cc.

**B. Noble Gases (Curies\*)**

<b>Nuclide</b>	<b>Quarter 1</b>	<b>Quarter 2</b>	<b>Quarter 3</b>	<b>Quarter 4</b>
Ar-41	4.87E-01	7.51E-01	7.04E-01	7.01E-01
Kr-87	<8.1E-08	<8.1E-08	1.30E-01	<8.1E-08
Kr-88	<1.2E-07	4.73E-01	2.55E-01	2.42E-01
Kr-85m	2.04E-01	5.71E-01	2.96E-01	4.11E-01
Xe-133	8.57E-02	4.15E-01	3.91E-01	9.74E-01
Xe-135	6.26E-02	9.04E-02	9.87E-02	2.00E-01
Xe-135m	2.04E-01	4.53E-01	1.99E-01	4.26E-01
Xe-138	7.90E-01	5.01E-01	1.69E+00	4.85E-01
<b>Total</b>	<b>1.83E+00</b>	<b>3.25E+00</b>	<b>3.76E+00</b>	<b>3.43E+00</b>

**C. Radioiodines (Curies\*)**

<b>Nuclide</b>	<b>Quarter 1</b>	<b>Quarter 2</b>	<b>Quarter 3</b>	<b>Quarter 4</b>
I-131	2.15E-04	1.55E-04	2.29E-04	3.17E-04
I-132	5.23E-04	<6.3E-12	<6.3E-12	<6.3E-12
I-133	1.60E-03	9.53E-04	8.04E-04	1.14E-03
I-134	<7.0E-11	<7.0E-11	<7.0E-11	<7.0E-11
I-135	3.99E-04	1.87E-04	<3.6E-12	<3.6E-12
<b>Total</b>	<b>2.74E-03</b>	<b>1.30E-03</b>	<b>1.03E-03</b>	<b>1.46E-03</b>

\*Less than (<) values are in units of uCi/cc.

**Shipments of Radwaste**

Fermi 2 complies with the extensive federal regulations which govern radioactive waste shipments. Radioactive solid waste shipments from the Fermi 2 site consist of waste generated during water treatment, radioactive trash, irradiated components, etc. Shipment destinations are either a licensed burial site or intermediate processing facilities. Waste shipped to intermediate processing facilities is shipped directly from these facilities to a licensed burial site after processing. The following tables contain estimates of major nuclide composition, by class of waste, of Fermi 2 radwaste shipped offsite in 2013. The waste volumes shown in these tables are the volumes shipped, not the final volumes sent for burial after processing.

**a. Spent resins, sludges, etc.** Waste in this category in 2013 was Class A waste and consisted of spent resins and sludges. Spent resins were shipped in shielded transportation casks (9 Type B, 1 Type A and 10 General Design Bulk Packages), directly to the Clive, UT burial facility. Sludges were packaged in 15 General Design Bulk Packages of various sizes and sent to the EnergySolutions processing facility in Oak Ridge TN. Spent resins were dewatered prior to shipment for disposal. Sludges were either dried or incinerated at the vendor processing facility prior to final disposal. All quantities were determined by measurement.

Spent resins, sludges, etc, (Class A)

Isotope	mCi	Percent
Ag-110m	1.77E+03	5.71E-02
Ba-133	8.65E-03	2.79E-07
Ba-140	1.66E+00	5.35E-05
C-14	1.73E+03	5.58E-02
Ce-144	1.37E+00	4.41E-05
Co-57	1.56E+02	5.03E-03
Co-58	3.49E+03	1.13E-01
Co-60	6.72E+05	2.17E+01
Cr-51	1.96E+02	6.32E-03
Cs-134	1.55E+00	5.00E-05
Cs-137	8.92E+02	2.88E-02
Fe-55	2.07E+06	6.67E+01
Fe-59	5.20E+02	1.68E-02
H-3	2.27E+02	7.32E-03
Hf-181	7.18E-02	2.31E-06
I-129 (LLD)	1.24E+01	N/A
I-131	2.36E+00	7.61E-05
La-140	2.01E+00	6.48E-05
Mn-54	2.69E+05	8.67E+00
Nb-94	2.08E-01	6.71E-06
Nb-95	6.05E+01	1.95E-03
Ni-59	4.58E+01	1.47E-03
Ni-63	1.45E+04	4.67E-01
Pu-238	1.40E-01	4.51E-06
Pu-241	8.35E+00	2.69E-04
Sb-124	5.85E+01	1.89E-03
Sb-125	3.32E+02	1.07E-02
Sn-113	5.97E-01	1.92E-05
Sr-89	1.37E+02	4.42E-03
Sr-90	2.22E+02	7.16E-03
Tc-99	4.40E+01	1.42E-03
Zn-65	6.65E+04	2.14E+00

Zr-95	2.15E+01	6.94E-04
Total Activity	3.10E+06	
Volume Shipped cubic meters	1.12E+02	

**b. Dry compressible waste, contaminated equipment, etc.** Waste in this category in 2013 was Class A waste and shipped in strong tight containers (35 General Design Bulk Packages) of various sizes or within shielded transportation casks (4 General Design Bulk Packages), and was classified as Dry Active Waste (DAW). DAW waste was shipped to an intermediate processor for processing, e.g. compaction or incineration or to Clive UT for direct disposal. All quantities were determined by measurement.

Dry Active Waste (Class A)

Isotope	mCi	%
C-14	3.87E+00	9.67E-02
Co-57	2.42E-03	6.05E-05
Co-58	5.86E+00	1.46E-01
Co-60	1.14E+03	2.85E+01
Cr-51	2.88E+01	7.20E-01
Cs-137	1.92E+01	4.80E-01
Fe-55	2.17E+03	5.42E+01
Fe-59	4.64E+01	1.16E+00
H-3	8.25E+01	2.06E+00
I-129 (LLD)	1.16E+01	N/A
Mn-54	4.34E+02	1.08E+01
Ni-63	2.03E+01	5.07E-01
Sb-124	1.31E+00	3.27E-02
Sb-125	3.58E+00	8.94E-02
Sr-89	1.77E+01	4.42E-01
Sr-90	6.35E-01	1.59E-02
Tc-99	5.26E-03	1.31E-04
Zn-65	2.83E+01	7.07E-01
Total Activity	4.00E+03	
Volume Shipped cubic meters	8.25E+02	

**c. Irradiated components, control rods, etc.** - No waste for this category



**d. Other** – Filters / Water – Filter waste in this category in 2013 was Class A and was shipped in shielded transportation casks (2 Type B and 2 General Design Bulk Packages). Filter waste was shipped to an intermediate processor for processing by dewatering or solidification. Liquid waste in this category in 2013 was shipped in 15 various sizes of general design bulk packages and one tanker to an intermediate processor. Liquid waste was processed by filtration or incineration. All quantities were determined by measurement.

Isotope	mCi	Percent
Am-241	7.94E-04	1.93E-07
Ba-133	8.78E-04	2.14E-07
C-14	5.78E-01	1.41E-04
Co-57	9.84E+00	2.39E-03
Co-58	4.80E+01	1.17E-02
Co-60	3.23E+04	7.86E+00
Cs-134	1.11E-04	2.70E-08
Cs-137	6.47E-01	1.57E-04
Fe-55	3.54E+05	8.61E+01
Fe-59	4.71E+01	1.15E-02
H-3	3.27E+01	7.95E-03
I-129 (LLD)	6.11E-01	N/A
Mn-54	2.31E+04	5.62E+00
Nb-94	5.38E-03	1.31E-06
Ni-59	2.95E+00	7.18E-04
Ni-63	8.70E+02	2.12E-01
Sb-124	7.55E+00	1.84E-03
Tc-99 (LLD)	8.51E-01	N/A
Zn-65	6.50E+02	6.50E+02
Zr-95	2.87E-03	2.87E-03
Total Activity	4.11E+05	
Volume Shipped cubic meters	5.05E+01	

## Appendix B

### Ground Water Protection Program Data and Analysis

## EXECUTIVE SUMMARY

Fermi personnel conclude that the occasional positive tritium sample results in ground water from the shallow monitor wells is not due to a leak from plant systems. Tritium in ground water in the shallow aquifer is the result of washout and recapture of tritium in precipitation that has passed through gaseous effluent from monitored plant systems (NRC RIS 08-03).

## PROGRAM OVERVIEW

Quarterly sampling and gauging of the Fermi 2 Integrated Ground Water Protection Program (IGWPP) monitor wells continued uninterrupted in 2013.

Procedurally, each IGWPP specified monitor well is required to be sampled for tritium and plant-related gamma-emitting radioisotopes each quarter. Furthermore, once per year water from three monitor wells most likely to be contaminated by leaked or spilled material is analyzed for hard-to-detect (HTD) radionuclides (Fe-55, Sr-89, and Sr-90).

Samples analyzed for gamma-emitting radionuclides, as well as HTDs, are counted to environmental lower limits of detection (LLD) for each given radioisotope of interest, with the exception of La-140 and Ba-140 (due to their extremely short half-lives). For tritium there is no required limit of detection, beyond what is prescribed for ground water samples taken as part of the site's Radiological Environmental Monitoring Program (REMP). The REMP Lower Limit of Detection (LLD) is set at 2,000 pCi/L which is 1/10<sup>th</sup> of the EPA's drinking water limit of 20,000 pCi/L. Fermi 2's contract laboratory achieved the required LLD for tritium of 500 pCi/L for all ground-water samples taken during 2013.

In 2013 Fermi personnel continued to take an additional sample split for tritium analysis. These samples were analyzed for the presence of tritium by the Fermi chemistry laboratory. This process ensures more accurate data for shipping the samples to the offsite contract laboratory, but, more importantly, quick determination of abnormally high levels of tritium in site ground water as the result of a leak of tritiated process water.

In 2013 the monitor wells installed at the Enrico Fermi Atomic Power Plant (EF1) were incorporated into the site Integrated Ground Water Protection Program. Most of the EF1 monitor wells were installed to monitor ground water in the vicinity of the facility as part of decommissioning and license termination work. With the EF1 decommissioning project placed back in "passive" SAFSTOR it was deemed logical to incorporate ongoing ground water monitoring into the existing Fermi 2 IGWPP. EF1 monitor wells are designated in the attached tables by the prefix "EFT-". EF1 construction utilized silty-clay fill adjacent to the structures to bring the site up to the final grade. All shallow wells are screened in this material and they typically do not produce much water. Shallow wells are sampled semi-annually because the rates of lateral flow through the silty-clay are quite low. Intermediate and deep monitor wells at EF1 are sampled quarterly.

## RESULTS

**Periodic Sample Events** (Performed quarterly for monitor wells at EF2 and intermediate and deep monitor wells at EF1. Shallow monitor wells at Fermi 1 are sampled semi-annually.)

### **Deep Wells (Table 8)**

Tritium was not detected in any samples from the IGWPP deep monitor wells in 2013.

Plant-related gamma-emitting radioisotopes and hard-to-detect radioisotopes were not detected in any ground-water samples collected from deep monitor wells in 2013.

**Shallow Wells (Table 9)**

Most shallow monitor wells have consistently yielded results indicating that tritium is not present at the detection limit. Of the 30 shallow monitor wells at Fermi 2 that are sampled quarterly and 11 at EF1 that are sampled semi-annually, only samples from four wells produced results with tritium levels above the detection limit. Ground water samples with positive results had tritium activities less than or equal to 1,450 pCi/L (less than 7.25% of the EPA drinking water limit for tritium). The average value for positive results from ground-water samples taken in 2013 as part of the periodic (quarterly) sampling program is 805 pCi/L (Std Dev 396 pCi/L) and this value is 4% of the EPA drinking water limit.

<b>Statistic</b>	<b>Tritium (pCi/L)</b>
Maximum	1,450
Average	805
Minimum	375
Standard Deviation	428

**Emergent Sample Events (Table 10)**

In 2013 Fermi 2 performed several emergent sample events. Emergent sample events may be performed in response to a leak of licensed material, in response to a spill, unusual analytical results in samples taken during the course of periodic sampling, or if station personnel are concerned over the integrity of a system, structure, or component containing licensed material.

The emergent sample events (E-2013-G-01 through E-2013-G-05) were performed in response to the discovery of indications of corrosion found on a spare condensate line associated with the Fermi 2 Condensate Return Tank (CRT). Analytical results from these emergent sample events indicate that this condensate line has not begun to leak. Of all the samples taken to support this emergent monitoring only 13 of the 35 samples taken were positive for tritium.

This monitoring was discontinued after July, 2013, because the condition requiring the monitoring was mitigated.

Emergent sample event E-2013-G-07 was conducted to sample ground water from monitor wells in the vicinity of the EF2 condensate tanks when these monitor wells could not be sampled during the third quarter periodic sample event due to ground water levels being below the monitor well's screened intervals. This latter condition was a consequence of construction activities that required dewatering part of the EF2 site.

The table below shows summary statistics for positive values in samples taken during emergent sample events.

<b>Statistic</b>	<b>Tritium (pCi/L)</b>
Maximum	1,760
Average	807
Minimum	320
Standard Deviation	448

Plant-related gamma-emitting radioisotopes and hard-to-detect radioisotopes were not detected in any ground-water samples collected from shallow monitor wells in 2013.

## DISCUSSION

Results of tritium analysis of ground water sampled in 2013 have shown that ground water from many of the site's wells have never yielded a positive result. In 2013, positive ground water results for tritium ranged from 320 – 1,760 pCi/L. These values are within the range of historic values but higher than the range of values seen in 2012. Furthermore, since the Integrated Ground Water Protection Program was initiated in the Fall of 2007, plant-related gamma isotopes and hard-to-detect isotopes have never been identified in ground-water samples from any of the monitor wells.

If the tritium found in ground water from shallow wells were attributable to a leaking plant system then one would expect the levels to steadily increase over time, especially during the winter when there is, normally, less recharge from surface water. Instead the results from shallow monitor wells show periodic low-level hits for tritium in ground water with no trend. This pattern is more consistent with what one would expect to see if the tritium were attributable to recapture in precipitation. Recapture of tritium emitted from nuclear power plant stacks in precipitation is well documented and these emissions are continuously monitored and reported annually by the utility as part of an approved effluents program. A tritium rain-water washout study performed at the Fermi site revealed that tritium is found in rain water collected at the site. Tritium activity in rain water samples, taken at the site over a period of two months as part of that study, ranged from ca. 400 pCi/L to 5,750 pCi/L. It should be noted that tritium activity in precipitation samples taken during the first five months of 2013 were, on average, significantly higher than normal (see discussion on tritium in rain water in Appendix C of this report). The somewhat higher levels of tritium in seen in ground water samples during 2013 may be a reflection of these higher levels of tritium in precipitation (averages of approximately 2,000 – 3,000 pCi/L for samples collected in first and second quarter of 2013) and is consistent with the interpretation that the tritium seen in ground water at Fermi is due to washout and recapture.

In 2013 emergent sample events were primarily performed to ensure that a spare condensate line from the CRT, that had indications of possible corrosion based on results from a non-destructive evaluation, has not begun to leak. This condensate line exits the CRT into the CRT valve galley where it is routed through a penetration in the concrete wall. The line is completed just outside of the valve galley and therefore risks spilling process water to the environment should the pipe fail. Although the line contains a valve, its condition is unknown so no credit is taken for the valve to be able to prevent the CRT from draining if the line would fail. An evaluation of this circumstance was performed and personnel concluded that if the line failed catastrophically, the CRT would drain and Operations would identify the leak; however, if the line started to leak at a low rate, that leak could only be identified by analyzing ground water from adjacent monitor wells for tritium. To ensure that such a condition did not go undetected, station personnel established an emergent sample routine to ensure the sentinel wells in the vicinity of the CST diked area are sampled monthly (credit was taken for the months when the monitor wells were sampled as part of the quarterly, periodic, sample program). **Based on the results of these samples, there is no indication that condensate leaked from the spare CRT before the spare condensate line was cut out and the penetration capped to mitigate this situation.**

## Data

Table 8: Deep Monitor Well Tritium Analysis Results for Year 2013 (Periodic [Quarterly] Sample Events).

MONITOR WELL	EVENT ID	QA TYPE	LAB ID	PARAMETER	PREFIX	VALUE	UNITS
EF2-07-001D	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.34E+02	PCI/L
EF2-07-001D	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.75E+02	PCI/L
EF2-07-001D	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.51E+02	PCI/L
EF2-07-001D	P-2013-G-Q4				Note 1		
EF2-07-003D	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.11E+02	PCI/L
EF2-07-003D	P-2013-G-Q1	DUPLICATE	GEL	H-3	<	4.17E+02	PCI/L
EF2-07-003D	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.76E+02	PCI/L
EF2-07-003D	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.12E+02	PCI/L
EF2-07-003D	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.34E+02	PCI/L
EF2-07-004D	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.11E+02	PCI/L
EF2-07-004D	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.87E+02	PCI/L
EF2-07-004D	P-2013-G-Q2	DUPLICATE	GEL	H-3	<	3.85E+02	PCI/L
EF2-07-004D	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.10E+02	PCI/L
EF2-07-004D	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.21E+02	PCI/L
EF2-07-006D	P-2013-G-Q1				Note 1		
EF2-07-006D	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.77E+02	PCI/L
EF2-07-006D	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.68E+02	PCI/L
EF2-07-006D	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.20E+02	PCI/L
EF2-07-006D	P-2013-G-Q4	DUPLICATE	GEL	H-3	<	4.19E+02	PCI/L
EF2-07-008D	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.17E+02	PCI/L
EF2-07-008D	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.68E+02	PCI/L
EF2-07-008D	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.12E+02	PCI/L
EF2-07-008D	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.31E+02	PCI/L
EF2-07-009D	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.38E+02	PCI/L
EF2-07-009D	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.84E+02	PCI/L
EF2-07-009D	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.08E+02	PCI/L
EF2-07-009D	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.17E+02	PCI/L
EF2-07-015D	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.71E+02	PCI/L
EF2-07-015D	P-2013-G-Q2	NORMAL	GEL	H-3	<	4.10E+02	PCI/L
EF2-07-015D	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.08E+02	PCI/L
EF2-07-015D	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.74E+02	PCI/L
EF2-07-020D	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.01E+02	PCI/L
EF2-07-020D	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.89E+02	PCI/L
EF2-07-020D	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.09E+02	PCI/L
EF2-07-020D	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.31E+02	PCI/L
EF2-07-029D	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.10E+02	PCI/L
EF2-07-029D	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.68E+02	PCI/L
EF2-07-029D	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.12E+02	PCI/L
EF2-07-029D	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.18E+02	PCI/L
EFT-01D	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.64E+02	PCI/L
EFT-01D	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.74E+02	PCI/L
EFT-02D	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.65E+02	PCI/L
EFT-02D	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.79E+02	PCI/L
EFT-04D	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.63E+02	PCI/L
EFT-04D	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.67E+02	PCI/L
EFT-05D	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.64E+02	PCI/L

**Fermi 2 - 2013 Annual  
Radioactive Effluent Release Report**

EFT-05D	P-2013-G-Q3	DUPLICATE	GEL	H-3	<	4.62E+02	PCI/L
EFT-05D	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.73E+02	PCI/L
EFT-06D	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.59E+02	PCI/L
EFT-06D	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.73E+02	PCI/L
EFT-06D	P-2013-G-Q4	DUPLICATE	GEL	H-3	<	4.71E+02	PCI/L
EFT-11D	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.64E+02	PCI/L
EFT-11D	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.72E+02	PCI/L
EFT-12D	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.67E+02	PCI/L
EFT-12D	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.68E+02	PCI/L

Note 1: Monitor well could not be accessed because well was in construction zone.

Table 9: Shallow Monitor Well Tritium Analysis Results for Year 2013 (Periodic [Quarterly] Sample Events).

MONITOR WELL	EVENT ID	QA TYPE	LAB ID	PARAMETER	PREFIX	VALUE	UNITS
EF2-07-002S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.91E+02	PCI/L
EF2-07-002S	P-2013-G-Q2	NORMAL	GEL	H-3	<	4.06E+02	PCI/L
EF2-07-002S	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.31E+02	PCI/L
EF2-07-002S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.31E+02	PCI/L
EF2-07-003S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.13E+02	PCI/L
EF2-07-003S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.74E+02	PCI/L
EF2-07-003S	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.10E+02	PCI/L
EF2-07-003S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.18E+02	PCI/L
EF2-07-005S	P-2013-G-Q1	NORMAL	GEL	H-3	<	5.68E+02	PCI/L
EF2-07-005S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.83E+02	PCI/L
EF2-07-005S	P-2013-G-Q3				Note 3		
EF2-07-005S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.18E+02	PCI/L
EF2-07-007S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.38E+02	PCI/L
EF2-07-007S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.76E+02	PCI/L
EF2-07-007S	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.67E+02	PCI/L
EF2-07-007S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.20E+02	PCI/L
EF2-07-008S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.16E+02	PCI/L
EF2-07-008S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.76E+02	PCI/L
EF2-07-008S	P-2013-G-Q3				Note 3		
EF2-07-008S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.26E+02	PCI/L
EF2-07-012S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.34E+02	PCI/L
EF2-07-012S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.83E+02	PCI/L
EF2-07-012S	P-2013-G-Q3				Note 3		
EF2-07-012S	P-2013-G-Q4				Note 4		
EF2-07-013S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.07E+02	PCI/L
EF2-07-013S	P-2013-G-Q1	DUPLICATE	GEL	H-3	<	4.12E+02	PCI/L
EF2-07-013S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.89E+02	PCI/L
EF2-07-013S	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.14E+02	PCI/L
EF2-07-013S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.22E+02	PCI/L
EF2-07-014S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.27E+02	PCI/L
EF2-07-014S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.60E+02	PCI/L
EF2-07-014S	P-2013-G-Q2	DUPLICATE	GEL	H-3	<	3.65E+02	PCI/L
EF2-07-014S	P-2013-G-Q3				Note 3		

**Fermi 2 - 2013 Annual  
Radioactive Effluent Release Report**

EF2-07-014S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.25E+02	PCI/L
EF2-07-015S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.72E+02	PCI/L
EF2-07-015S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.57E+02	PCI/L
EF2-07-015S	P-2013-G-Q3				Note 3		
EF2-07-015S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.30E+02	PCI/L
EF2-07-016S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.74E+02	PCI/L
EF2-07-016S	P-2013-G-Q2	NORMAL	GEL	H-3	<	4.09E+02	PCI/L
EF2-07-016S	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.11E+02	PCI/L
EF2-07-016S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.27E+02	PCI/L
EF2-07-016S	P-2013-G-Q4	DUPLICATE	GEL	H-3	<	4.31E+02	PCI/L
EF2-07-017S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.12E+02	PCI/L
EF2-07-017S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.74E+02	PCI/L
EF2-07-017S	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.59E+02	PCI/L
EF2-07-017S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.32E+02	PCI/L
EF2-07-018S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.13E+02	PCI/L
EF2-07-018S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.87E+02	PCI/L
EF2-07-018S	P-2013-G-Q3				Note 3		
EF2-07-018S	P-2013-G-Q4				Note 5		
EF2-07-019S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.34E+02	PCI/L
EF2-07-019S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.71E+02	PCI/L
EF2-07-019S	P-2013-G-Q3				Note 3		
EF2-07-019S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.21E+02	PCI/L
EF2-07-020S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.12E+02	PCI/L
EF2-07-020S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.85E+02	PCI/L
EF2-07-020S	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.13E+02	PCI/L
EF2-07-020S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.14E+02	PCI/L
EF2-07-021S	P-2013-G-Q1				Note 2		
EF2-07-021S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.85E+02	PCI/L
EF2-07-021S	P-2013-G-Q3				Note 3		
EF2-07-021S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.12E+02	PCI/L
EF2-07-022S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.36E+02	PCI/L
EF2-07-022S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.72E+02	PCI/L
EF2-07-022S	P-2013-G-Q3				Note 3		
EF2-07-022S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.42E+02	PCI/L
EF2-07-023S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.14E+02	PCI/L
EF2-07-023S	P-2013-G-Q1	DUPLICATE	GEL	H-3	<	4.31E+02	PCI/L
EF2-07-023S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.64E+02	PCI/L
EF2-07-023S	P-2013-G-Q3				Note 3		
EF2-07-023S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.30E+02	PCI/L
EF2-07-024S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.28E+02	PCI/L
EF2-07-024S	P-2013-G-Q2	NORMAL	GEL	H-3		3.75E+02	PCI/L
EF2-07-024S	P-2013-G-Q2	DUPLICATE	GEL	H-3	<	3.60E+02	PCI/L
EF2-07-024S	P-2013-G-Q3				Note 3		
EF2-07-024S	P-2013-G-Q4	NORMAL	GEL	H-3		5.27E+02	PCI/L
EF2-07-025S	P-2013-G-Q1	NORMAL	GEL	H-3		1.11E+03	PCI/L
EF2-07-025S	P-2013-G-Q2	NORMAL	GEL	H-3		1.45E+03	PCI/L
EF2-07-025S	P-2013-G-Q3				Note 3		
EF2-07-025S	P-2013-G-Q4	NORMAL	GEL	H-3		1.17E+03	PCI/L
EF2-07-026S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.35E+02	PCI/L
EF2-07-026S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.83E+02	PCI/L
EF2-07-026S	P-2013-G-Q3				Note 3		



**Fermi 2 - 2013 Annual  
Radioactive Effluent Release Report**

EF2-07-026S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.30E+02	PCI/L
EF2-07-026S	P-2013-G-Q4	DUPLICATE	GEL	H-3	<	4.27E+02	PCI/L
EF2-07-027S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.35E+02	PCI/L
EF2-07-027S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.86E+02	PCI/L
EF2-07-027S	P-2013-G-Q3				Note 3		
EF2-07-027S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.14E+02	PCI/L
EF2-07-028S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.70E+02	PCI/L
EF2-07-028S	P-2013-G-Q2	NORMAL	GEL	H-3	<	4.11E+02	PCI/L
EF2-07-028S	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.08E+02	PCI/L
EF2-07-028S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.32E+02	PCI/L
EF2-07-029S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.11E02	PCI/L
EF2-07-029S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.72E+02	PCI/L
EF2-07-029S	P-2013-G-Q3				Note 3		
EF2-07-029S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.32E+02	PCI/L
EF2-07-031S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.43E+02	PCI/L
EF2-07-031S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.76E+02	PCI/L
EF2-07-031S	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.11E+02	PCI/L
EF2-07-031S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.17E+02	PCI/L
EFT-01I	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.64E+02	PCI/L
EFT-01I	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.80E+02	PCI/L
EFT-01S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.31E+02	PCI/L
EFT-02S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.66E+02	PCI/L
EFT-04S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.79E+02	PCI/L
EFT-05S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.69E+02	PCI/L
EFT-06S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.76E+02	PCI/L
EFT-07S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.32E+02	PCI/L
EFT-08S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.74E+02	PCI/L
EFT-08SR	P-2013-G-Q4				Note 6		
EFT-09S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.79E+02	PCI/L
EFT-10S	P-2013-G-Q4	NORMAL	GEL	H-3	<	3.92E+02	PCI/L
EFT-11I	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.65E+02	PCI/L
EFT-11I	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.65E+02	PCI/L
EFT-12I	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.69E+02	PCI/L
EFT-12I	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.68E+02	PCI/L
EFT-13I	P-2013-G-Q4				Note 7		
MW-10	P-2013-G-Q1				Note 2		
MW-10	P-2013-G-Q2				Note 2		
MW-10	P-2013-G-Q3				Note 2		
MW-10	P-2013-G-Q4				Note 2		
MW-11	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.35E+02	PCI/L
MW-11	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.78E+02	PCI/L
MW-11	P-2013-G-Q3				Note 3		
MW-11	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.31E+02	PCI/L
MW-18	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.38E+02	PCI/L
MW-18	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.67E+02	PCI/L
MW-18	P-2013-G-Q3				Note 3		
MW-18	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.22E+02	PCI/L
MW-21	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.27E+02	PCI/L
MW-21	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.78E+02	PCI/L
MW-21	P-2013-G-Q3				Note 3		
MW-21	P-2013-G-Q4	NORMAL	GEL	H-3		4.33E+02	PCI/L

**Fermi 2 - 2013 Annual  
Radioactive Effluent Release Report**

MW-9	P-2013-G-Q1				Note 2		
MW-9	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.78E+02	PCI/L
MW-9	P-2013-G-Q3				Note 3		
MW-9	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.30E+02	PCI/L
P-392S	P-2013-G-Q1	NORMAL	GEL	H-3	<	4.71E+02	PCI/L
P-392S	P-2013-G-Q2	NORMAL	GEL	H-3	<	3.86E+02	PCI/L
P-392S	P-2013-G-Q3	NORMAL	GEL	H-3	<	4.12E+02	PCI/L
P-392S	P-2013-G-Q4	NORMAL	GEL	H-3	<	4.31E+02	PCI/L

Note 1: Monitor well could not be accessed because it was in a construction area.

Note 2: Monitor well could not be accessed because it has been buried in gravel/soil due to recent construction.

Note 3: Monitor well could not be sampled due to construction dewatering activities; water level was below well's screened interval.

Note 4: Monitor well could not be obstructed due to temporary obstruction.

Note 5: Monitor well could not be sampled – in a temporary exclusion zone.

Note 6: Monitor well could not be sampled – well was dry.

Note 7: Monitor well could not be sampled – handhold filled with ice.

Table 10: Monitor Well Tritium Analysis Results for Year 2013 (Emergent Sample Events)


MONITOR WELL	EVENT ID	QA TYPE	LAB ID	PARAMETER	PREFIX	VALUE	UNITS
EF2-07-013S	E-2013-G-01	NORMAL	FERMI	H-3		7.86E+02	PCI/L
EF2-07-022S	E-2013-G-01	NORMAL	FERMI	H-3		4.07E+02	PCI/L
EF2-07-023S	E-2013-G-01	NORMAL	FERMI	H-3		3.78E+02	PCI/L
EF2-07-024S	E-2013-G-01	NORMAL	FERMI	H-3		3.78E+02	PCI/L
EF2-07-025S	E-2013-G-01	NORMAL	FERMI	H-3		8.73E+02	PCI/L
EF2-07-026S	E-2013-G-01	NORMAL	FERMI	H-3		3.20E+02	PCI/L
EF2-07-027S	E-2013-G-01	NORMAL	FERMI	H-3		3.49E+02	PCI/L
EF2-07-013S	E-2013-G-02	NORMAL	GEL	H-3	<	3.87E+02	PCI/L
EF2-07-022S	E-2013-G-02	NORMAL	GEL	H-3	<	3.91E+02	PCI/L
EF2-07-023S	E-2013-G-02	NORMAL	GEL	H-3	<	3.92E+02	PCI/L
EF2-07-024S	E-2013-G-02	NORMAL	GEL	H-3	<	3.82E+02	PCI/L
EF2-07-025S	E-2013-G-02	NORMAL	GEL	H-3		1.26E+03	PCI/L
EF2-07-026S	E-2013-G-02	NORMAL	GEL	H-3	<	4.00E+02	PCI/L
EF2-07-027S	E-2013-G-02	NORMAL	GEL	H-3	<	3.88E+02	PCI/L
EF2-07-013S	E-2013-G-03	NORMAL	GEL	H-3	<	3.67E+02	PCI/L
EF2-07-022S	E-2013-G-03	NORMAL	GEL	H-3	<	3.76E+02	PCI/L
EF2-07-023S	E-2013-G-03	NORMAL	GEL	H-3	<	3.73E+02	PCI/L
EF2-07-024S	E-2013-G-03	NORMAL	GEL	H-3	<	3.75E+02	PCI/L
EF2-07-025S	E-2013-G-03	NORMAL	GEL	H-3		1.37E+03	PCI/L
EF2-07-026S	E-2013-G-03	NORMAL	GEL	H-3	<	3.73E+02	PCI/L
EF2-07-027S	E-2013-G-03	NORMAL	GEL	H-3	<	3.73E+02	PCI/L
EF2-07-025S	E-2013-G-04	NORMAL	GEL	H-3		1.76E+03	PCI/L
EF2-07-005S	E-2013-G-05	NORMAL	GEL	H-3	<	3.89E+02	PCI/L
EF2-07-007S	E-2013-G-05	NORMAL	GEL	H-3	<	3.98E+02	PCI/L
EF2-07-013S	E-2013-G-05	NORMAL	GEL	H-3		1.02E+03	PCI/L
EF2-07-019S	E-2013-G-05	NORMAL	GEL	H-3	<	3.95E+02	PCI/L
EF2-07-021S	E-2013-G-05	NORMAL	GEL	H-3	<	3.91E+02	PCI/L

*Fermi 2 - 2013 Annual  
Radioactive Effluent Release Report*

EF2-07-022S	E-2013-G-05	NORMAL	GEL	H-3	<	3.89E+02	PCI/L
EF2-07-023S	E-2013-G-05	NORMAL	GEL	H-3		4.05E+02	PCI/L
EF2-07-024S	E-2013-G-05	NORMAL	GEL	H-3	<	3.93E+02	PCI/L
EF2-07-025S	E-2013-G-05	NORMAL	GEL	H-3		9.15E+02	PCI/L
EF2-07-026S	E-2013-G-05	NORMAL	GEL	H-3	<	3.90E+02	PCI/L
EF2-07-027S	E-2013-G-05	NORMAL	GEL	H-3	<	3.87E+02	PCI/L
EF2-07-013S	E-2013-G-07	NORMAL	GEL	H-3		6.78E+02	PCI/L
EF2-07-022S	E-2013-G-07	NORMAL	GEL	H-3	<	3.27E+02	PCI/L
EF2-07-023S	E-2013-G-07	NORMAL	GEL	H-3	<	3.22E+02	PCI/L
EF2-07-024S	E-2013-G-07	NORMAL	GEL	H-3	<	3.25E+02	PCI/L
EF2-07-025S	E-2013-G-07	NORMAL	GEL	H-3		1.21E+03	PCI/L
EF2-07-026S	E-2013-G-07	NORMAL	GEL	H-3	<	3.23E+02	PCI/L
EF2-07-027S	E-2013-G-07	NORMAL	GEL	H-3	<	3.23E+02	PCI/L



Map of Current Monitor Well Locations (EF1)

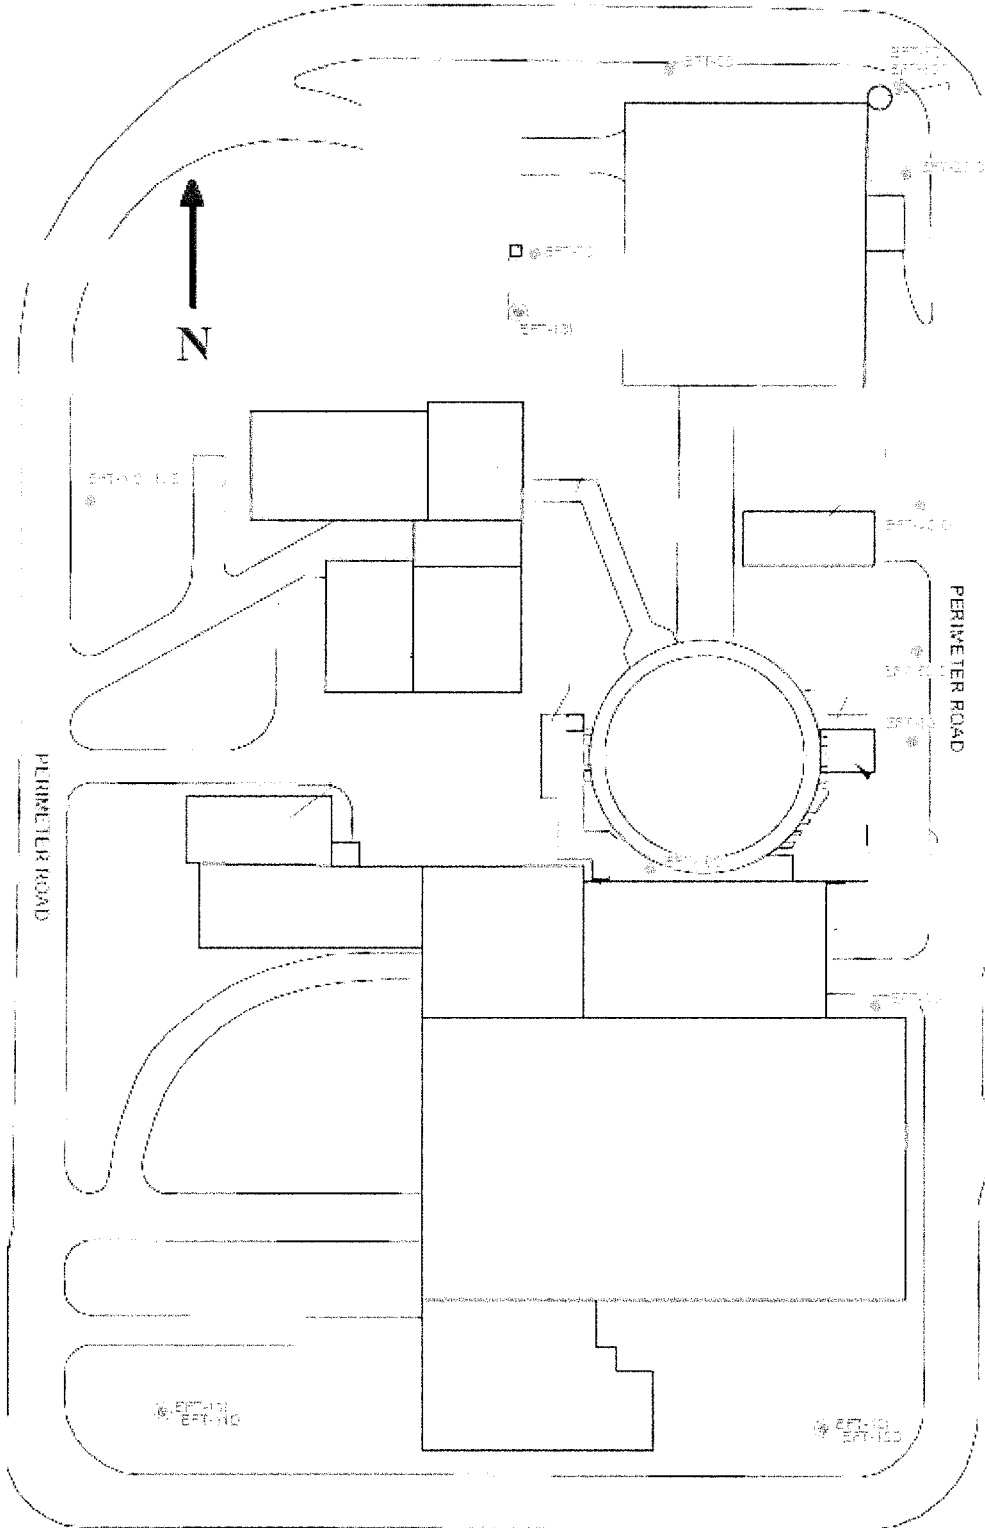

## Appendix C

### Rainwater Data and Analysis

Fermi 2 has documented the phenomenon of rainwater washout of gaseous effluents, in which tritium concentrations above background levels are routinely detected in rainwater samples collected at the site. These positive samples are most often observed in down-wind sectors from the plant. The Nuclear Regulatory Commission has also recognized this phenomenon of recapture of legally released gaseous effluents in NRC Regulatory Issue Summary 2008-03.

Fermi 2 continues to monitor this phenomenon through the collection of rainwater samples and storm-water outfall samples at least once per quarter. These samples are analyzed for tritium to a Lower Limit of Detection (LLD) of 500 pCi/L. The table and map at the end of this appendix show tritium results and collection locations for 2013 rainwater samples. The following general points may be made about these data:

- 1) Higher rainwater tritium levels were detected in down-wind sectors from the plant. This is to be expected based on the prevailing wind direction and the location of the turbine building vent, which is the largest release point and has the lowest elevation. It is also consistent with the occasional detection of tritium in shallow groundwater wells, as mentioned in Appendix B.
- 2) Detection of tritium in rainwater samples is more frequent and at somewhat higher levels than in shallow groundwater wells. This is consistent with the dilution of rainwater tritium prior to its occurrence in groundwater wells.
- 3) Tritium levels seen at the storm-water outfall can be explained by runoff of relatively highly tritiated water from plant roofs (near plant vents).
- 4) Tritium levels in rainwater near the CST can be explained by periodic venting of tritiated water vapor from the CST and CRT (minor release points for tritium).
- 5) With the exception of one precipitation sample taken during the first quarter of 2013 (30,800 pCi/L), all rainwater and storm-water tritium concentrations were less than one fifth of the EPA drinking water limit (20,000 pCi/L).

Table 11 presents 2013 rainwater and storm-water tritium analyses. The designation "<" indicates that tritium in the sample was less than the "Critical Level" for that sample. The Critical Level is the net count rate that must be exceeded before the sample is said to have activity above background. Rainwater and storm-water samples are analyzed by Fermi 2 Chemistry personnel using a Liquid Scintillation Counter. The lab is requested to count these samples to an LLD of 500 pCi/L and all critical levels reported are less than the requested LLD. The CL for each sample is presented in the table. The attached map shows the sample locations for the results reported in Table 11:

Tritium concentration in precipitation samples collected in the first two quarters of 2013 is, on average, higher than the average reported in 2012. This change may be related to

*Fermi 2 - 2013 Annual  
Radioactive Effluent Release Report*

the increase levels of tritium seen in gaseous effluents in 2013, and as a consequence is reflected in the increase in average tritium concentration in ground water at the site.

Table 11: Rain Water and Storm Water Tritium Analysis Results for Year 2013

SAMPLE LOCATION	SAMPLE_ID	SAMPLE DATE	PREFIX	H3 RESULT (pCi/L)	CL (pCi/L)
H3-PR-01	702414	11-Mar-13		2.24E+03	2.04E+02
H3-PR-04	702415	11-Mar-13		1.63E+03	2.04E+02
H3-PR-05	702416	11-Mar-13		1.22E+03	2.04E+02
H3-PR-06	702417	11-Mar-13		1.60E+03	2.04E+02
H3-PR-07	702418	11-Mar-13		9.61E+02	2.04E+02
H3-PR-08	702419	11-Mar-13		2.33E+02	2.04E+02
H3-PR-14	702420	11-Mar-13		3.49E+02	2.04E+02
H3-PR-23	702421	11-Mar-13		8.44E+02	2.04E+02
H3-PR-24	702422	11-Mar-13		8.73E+02	2.04E+02
H3-PR-29	702423	11-Mar-13		8.15E+02	2.04E+02
H3-PR-30	702424	11-Mar-13	<	2.04E+02	2.04E+02
OUTFALL 002	702442	11-Mar-13		1.40E+03	2.04E+02
H3-PR-01	702497	12-Apr-13		2.47E+03	1.79E+02
H3-PR-04	702498	12-Apr-13		1.93E+03	1.79E+02
H3-PR-05	702499	12-Apr-13		1.70E+03	1.79E+02
H3-PR-06	702500	12-Apr-13		3.04E+03	1.79E+02
H3-PR-07	702501	12-Apr-13		1.88E+03	1.79E+02
H3-PR-08	702502	12-Apr-13		3.21E+03	1.79E+02
H3-PR-14	702503	12-Apr-13		9.23E+02	1.79E+02
H3-PR-23	702504	12-Apr-13		3.08E+04	1.79E+02
H3-PR-24	702505	12-Apr-13		2.38E+03	1.79E+02
H3-PR-29	702506	12-Apr-13		3.54E+03	1.79E+02
H3-PR-30	702507	12-Apr-13		1.19E+03	1.79E+02
OUTFALL 002	702508	12-Apr-13		1.43E+03	1.79E+02
H3-PR-01	702597	11-Jun-13		1.20E+03	1.80E+02
H3-PR-04	702598	11-Jun-13		7.79E+02	1.80E+02
H3-PR-05	702599	11-Jun-13		5.69E+02	1.80E+02
H3-PR-06	702600	11-Jun-13		5.39E+02	1.80E+02
H3-PR-07	702601	11-Jun-13		4.79E+02	1.80E+02
H3-PR-08	702602	11-Jun-13		3.00E+02	1.80E+02
H3-PR-14	702603	11-Jun-13		4.79E+02	1.80E+02
H3-PR-23	702604	11-Jun-13		3.89E+02	1.80E+02
H3-PR-24	702605	11-Jun-13	<	1.80E+02	1.80E+02
H3-PR-29	702606	11-Jun-13		3.30E+02	1.80E+02
H3-PR-30	702607	11-Jun-13		7.79E+02	1.80E+02
H3-PR-01	702609	14-Jun-13		8.37E+02	1.79E+02
H3-PR-04	702610	14-Jun-13		2.99E+02	1.79E+02
H3-PR-05	702611	14-Jun-13		3.89E+02	1.79E+02
H3-PR-06	702612	14-Jun-13		3.59E+02	1.79E+02
H3-PR-07	702613	14-Jun-13		3.59E+02	1.79E+02
H3-PR-08	702614	14-Jun-13		5.38E+02	1.79E+02
H3-PR-14	702615	14-Jun-13		2.69E+02	1.79E+02




**Fermi 2 - 2013 Annual  
Radioactive Effluent Release Report**

H3-PR-23	702616	14-Jun-13		1.08E+03	1.79E+02
H3-PR-24	702617	14-Jun-13		3.59E+02	1.79E+02
H3-PR-29	702618	14-Jun-13		9.57E+02	1.79E+02
H3-PR-30	702619	14-Jun-13		7.48E+02	1.79E+02
H3-PR-01	702641	13-Aug-13		9.37E+02	3.22E+02
H3-PR-04	702642	13-Aug-13	<	3.22E+02	3.22E+02
H3-PR-05	702643	13-Aug-13	<	3.22E+02	3.22E+02
H3-PR-06	702644	13-Aug-13	<	3.22E+02	3.22E+02
H3-PR-07	702645	13-Aug-13	<	3.22E+02	3.22E+02
H3-PR-08	702646	13-Aug-13		3.22E+02	3.22E+02
H3-PR-14	702647	13-Aug-13		3.51E+02	3.22E+02
H3-PR-23	702648	13-Aug-13		7.03E+02	3.22E+02
H3-PR-24	702649	13-Aug-13		6.15E+02	3.22E+02
H3-PR-29	702650	13-Aug-13		8.49E+02	3.22E+02
H3-PR-30	702651	13-Aug-13		8.78E+02	3.22E+02
OUTFALL 002	702652	13-Aug-13		5.56E+02	3.22E+02
H3-PR-01	702711				
			Note 1		
H3-PR-04	702712	7-Oct-13		1.33E+03	2.12E+02
H3-PR-05	702713	7-Oct-13		1.39E+03	2.12E+02
H3-PR-06	702714	7-Oct-13		3.02E+02	2.12E+02
H3-PR-07	702715	7-Oct-13		2.72E+02	2.12E+02
H3-PR-08	702716	7-Oct-13	<	2.12E+02	2.12E+02
H3-PR-14	702717	7-Oct-13		5.74E+02	2.12E+02
H3-PR-23	702718	7-Oct-13	<	2.12E+02	2.12E+02
H3-PR-24	702719	7-Oct-13	<	2.12E+02	2.12E+02
H3-PR-29	702720	7-Oct-13	<	2.12E+02	2.12E+02
H3-PR-30	702721	7-Oct-13		4.84E+02	2.12E+02
OUTFALL 002	702722	7-Oct-13		1.63E+03	2.12E+02

Note 1: Not Sampled - sample collector lost in the wind (blown away).

RAIN WATER COLLECTION LOCATIONS

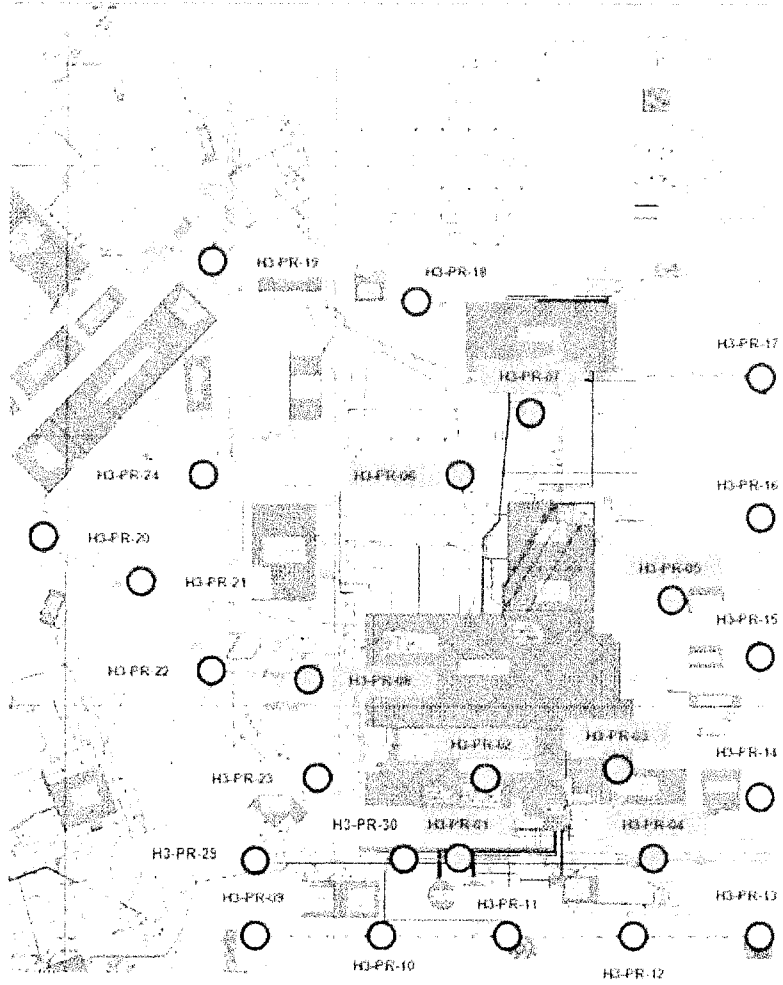

## Appendix D

### Meteorological Joint Frequency Distributions

Wind Speed (MPH)		Stability Class A																
Between		N	NNE	NE	ENE	E	ESE	SE	SSE	S	SSW	SW	WSW	W	WNW	NW	NNW	Total
0.00	0.75	1	0	0	1	0	1	0	0	0	0	1	0	0	0	2	0	6
0.75	2.50	1	1	1	2	1	4	0	0	1	0	4	3	7	6	0	3	34
2.50	4.50	6	11	11	10	15	14	30	14	17	23	18	19	33	33	18	7	279
4.50	6.50	10	8	31	33	43	68	83	51	62	58	36	23	35	41	24	34	640
6.50	8.50	15	10	11	18	33	56	89	52	29	61	59	23	25	55	37	36	609
8.50	11.50	17	8	2	23	43	52	18	9	6	26	63	23	28	67	21	17	423
11.50	14.50	3	0	0	6	18	25	5	1	0	19	14	3	7	7	7	2	117
14.50	18.50	0	0	0	0	4	10	0	0	0	1	3	0	0	0	0	0	18
18.50	23.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
23.50	30.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
30.50	39.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
39.50	42.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
<b>Total:</b>		53	38	56	93	157	230	225	127	115	188	198	94	135	209	109	99	2126

Wind Speed (MPH)		Stability Class B																
Between		N	NNE	NE	ENE	E	ESE	SE	SSE	S	SSW	SW	WSW	W	WNW	NW	NNW	Total
0.00	0.75	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
0.75	2.50	0	2	0	0	0	0	1	0	1	1	0	3	1	2	1	0	12
2.50	4.50	1	3	1	1	3	2	1	2	1	7	2	9	2	6	4	4	49
4.50	6.50	2	1	1	3	0	1	2	4	2	9	9	10	2	3	10	5	64
6.50	8.50	4	1	0	1	3	3	1	1	3	7	12	4	1	3	7	7	58
8.50	11.50	11	2	2	4	2	4	2	1	4	7	11	9	7	9	3	4	82
11.50	14.50	2	0	0	2	1	3	2	0	0	1	3	4	4	0	0	1	23
14.50	18.50	0	0	0	2	0	0	0	0	0	1	1	1	0	0	0	0	5
18.50	23.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
23.50	30.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
30.50	39.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
39.50	42.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
<b>Total:</b>		20	9	4	13	9	13	9	8	11	33	38	40	17	23	25	21	293

Wind Speed (MPH)		Stability Class C																
Between		N	NNE	NE	ENE	E	ESE	SE	SSE	S	SSW	SW	WSW	W	WNW	NW	NNW	Total
0.00	0.75	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
0.75	2.50	0	0	1	0	0	0	0	1	0	0	1	0	2	2	1	1	9
2.50	4.50	0	3	2	0	1	2	3	1	1	4	5	10	1	9	4	1	47
4.50	6.50	4	2	5	2	1	6	7	1	0	5	8	8	3	2	7	7	68
6.50	8.50	5	1	3	1	4	1	7	2	5	3	10	9	7	4	3	1	66
8.50	11.50	3	2	2	3	2	4	0	1	1	6	17	17	3	7	3	9	80
11.50	14.50	1	1	0	1	0	1	0	1	0	3	1	5	3	0	0	2	19
14.50	18.50	0	0	0	7	4	1	0	0	0	2	1	2	0	0	0	0	17
18.50	23.50	0	0	0	0	2	0	0	0	0	0	0	0	0	0	0	0	2
23.50	30.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
30.50	39.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
39.50	42.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
<b>Total:</b>		13	9	13	14	14	15	17	7	7	23	43	51	19	24	18	21	308

Wind Speed (MPH)		Stability Class D																
Between		N	NNE	NE	ENE	E	ESE	SE	SSE	S	SSW	SW	WSW	W	WNW	NW	NNW	Total
0.00	0.75	0	1	1	0	0	0	0	0	1	0	0	0	0	1	0	0	4
0.75	2.50	5	3	4	3	5	0	2	6	10	15	14	25	27	20	12	11	162
2.50	4.50	16	23	14	6	11	6	10	13	22	25	40	110	85	48	32	27	488
4.50	6.50	14	24	43	53	35	43	38	22	36	62	111	101	64	90	72	55	863
6.50	8.50	27	19	51	64	50	51	47	19	32	70	91	94	61	55	29	56	816
8.50	11.50	34	14	41	44	55	43	30	12	18	56	100	83	32	25	28	50	665
11.50	14.50	10	15	17	18	22	13	9	4	4	29	50	33	8	9	0	4	245
14.50	18.50	0	3	1	16	21	9	0	0	1	8	27	3	3	2	0	0	94
18.50	23.50	0	0	0	0	5	0	0	0	0	0	1	0	0	1	0	0	7
23.50	30.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
30.50	39.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
39.50	42.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
<b>Total:</b>		106	102	172	204	204	165	136	76	124	265	434	449	280	251	173	203	3344

Wind Speed (MPH)		Stability Class E																
Between		N	NNE	NE	ENE	E	ESE	SE	SSE	S	SSW	SW	WSW	W	WNW	NW	NNW	Total
0.00	0.75	0	1	1	0	0	1	0	1	0	0	2	2	1	1	0	0	10
0.75	2.50	10	4	8	5	6	3	7	11	15	10	18	45	35	50	34	15	276
2.50	4.50	22	32	17	13	8	6	10	19	41	28	52	67	56	76	106	30	583
4.50	6.50	18	12	18	6	17	14	11	30	60	77	58	22	12	43	33	35	466
6.50	8.50	11	4	5	5	14	15	21	13	26	66	15	1	4	7	3	6	216
8.50	11.50	3	2	0	0	25	10	9	8	37	47	29	5	1	5	0	0	181
11.50	14.50	0	2	0	0	3	1	0	0	11	11	10	4	6	0	0	1	49
14.50	18.50	0	0	0	0	0	0	0	0	0	2	0	1	0	0	0	0	3
18.50	23.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
23.50	30.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
30.50	39.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
39.50	42.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
<b>Total:</b>		64	57	49	29	73	50	58	82	190	241	184	147	115	182	176	87	1784



Wind Speed (MPH)		Stability Class F																
Between		N	NNE	NE	ENE	E	ESE	SE	SSE	S	SSW	SW	WSW	W	WNW	NW	NNW	Total
0.00	0.75	0	1	0	0	0	0	0	1	1	0	1	0	0	0	0	0	4
0.75	2.50	5	7	4	1	2	1	1	6	8	7	13	34	45	47	30	6	217
2.50	4.50	16	5	0	1	1	7	4	17	16	5	20	19	11	32	30	13	197
4.50	6.50	11	1	0	1	3	4	6	8	6	10	1	0	0	0	0	4	55
6.50	8.50	0	0	0	0	4	9	9	6	11	8	1	0	0	0	0	0	48
8.50	11.50	0	0	0	0	7	3	9	10	5	9	2	0	0	0	0	0	45
11.50	14.50	0	0	0	0	4	0	0	1	3	2	0	0	0	0	0	0	10
14.50	18.50	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	1
18.50	23.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
23.50	30.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
30.50	39.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
39.50	42.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
<b>Total:</b>		32	14	4	3	21	24	29	49	51	41	38	53	56	79	60	23	577

Wind Speed (MPH)		Stability Class G																
Between		N	NNE	NE	ENE	E	ESE	SE	SSE	S	SSW	SW	WSW	W	WNW	NW	NNW	Total
0.00	0.75	0	0	0	0	0	0	0	0	0	0	0	0	1	1	0	0	2
0.75	2.50	4	1	3	2	0	3	2	4	0	3	5	8	31	41	22	16	145
2.50	4.50	8	0	0	2	2	16	5	4	7	2	4	7	3	6	9	25	100
4.50	6.50	2	0	0	0	1	6	10	8	2	2	0	0	0	0	0	0	31
6.50	8.50	0	0	0	0	1	3	0	6	1	1	0	0	0	0	0	0	12
8.50	11.50	0	0	0	1	1	3	7	4	0	2	0	0	0	0	0	0	18
11.50	14.50	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	1
14.50	18.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
18.50	23.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
23.50	30.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
30.50	39.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
39.50	42.50	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
<b>Total:</b>		14	1	3	5	6	31	24	26	10	10	9	15	35	48	31	41	309

## Appendix E

### Revised Offsite Dose Calculation Manual

**OFFSITE DOSE CALCULATION MANUAL**

**Pages Revised in Latest Revision**

0-1, 3-20, 3-21, 3-22, 4-3, 5-4, 6-12, 7-4, 7-11, 7-12 and 7-17

**Implementation Plan**

These revisions go into effect upon approval.

4/13

<i>Information and Procedures</i>				
DSN TRM VOL II	Revision 21	Change # 12-022-ODM	DTC TMTRM	File # 1754
IP Code I	Date Approved N/A	Released By N/A	Date Issued 04/08/2013	Recipient 369

**CONTROLLED**

FERMI 2 - TECHNICAL REQUIREMENTS MANUAL

VOLUME II - LIST OF EFFECTIVE PAGES

OFFSITE DOSE CALCULATION MANUAL

<u>Page</u>	<u>Revision</u>	<u>Page</u>	<u>Revision</u>
0-1	21	3-15	13
0-2	13	3-16	13
0-3	13	3-17	13
0-4	13	3-18	14
0-5	13	3-19	13
0-6	13	3-20	21
		3-21	21
1-1	13	3-22	21
1-2	14	3-23	13
		3-24	20
2-1	13	3-25	20
2-2	14	3-26	18
2-3	14	3-27	14
2-4	14	3-28	14
2-5	14	3-29	14
2-6	14	3-30	14
2-7	14	3-31	13
		3-32	18
3-1	13	3-33	18
3-2	14	3-34	13
3-3	14	3-35	18
3-4	15	3-36	13
3-5	13	3-37	18
3-6	20	3-38	13
3-7	14	3-39	13
3-8	14	3-40	13
3-9	13	3-41	13
3-10	18	3-42	13
3-11	13	3-43	13
3-12	13	3-44	20
3-13	19	3-45	13
3-14	13	3-46	13

FERMI 2 - TECHNICAL REQUIREMENTS MANUAL

VOLUME II - LIST OF EFFECTIVE PAGES

OFFSITE DOSE CALCULATION MANUAL

<u>Page</u>	<u>Revision</u>	<u>Page</u>	<u>Revision</u>
4-1	13	6-19	13
4-2	13	6-20	13
4-3	21	6-21	13
4-4	13	6-22	13
4-5	13		
4-6	13		
4-7	13	7-1	13
4-8	13	7-2	18
		7-3	13
5-1	13	7-4	21
5-2	13	7-5	13
5-3	13	7-6	13
5-4	21	7-7	13
5-5	13	7-8	13
		7-9	13
6-1	13	7-10	18
6-2	13	7-11	21
6-3	14	7-12	21
6-4	13	7-13	18
6-5	13	7-14	18
6-6	13	7-15	13
6-7	14	7-16	13
6-8	14	7-17	21
6-9	13	7-18	13
6-10	13	7-19	20
6-11	13	7-20	13
6-12	21	7-21	13
6-13	13	7-22	13
6-14	13	7-23	13
6-15	13	7-24	13
6-16	13	7-25	13
6-17	13	7-26	13
6-18	13		

FERMI 2 - TECHNICAL REQUIREMENTS MANUAL

VOLUME II - LIST OF EFFECTIVE PAGES

OFFSITE DOSE CALCULATION MANUAL

<u>Page</u>	<u>Revision</u>	<u>Page</u>	<u>Revision</u>
7-27	13	9-1	13
7-28	13	9-2	13
7-29	13	9-3	18
7-30	13	9-4	13
7-31	13		
7-32	13	10-1	13
7-33	13	10-2	13
7-34	13	10-3	13
7-35	13	10-4	13
7-36	13	10-5	19
7-37	13	10-6	19
7-38	13	10-7	19
7-39	13	10-8	19
7-40	13	10-9	20
7-41	13	10-10	13
7-42	13	10-11	13
7-43	13	10-12	13
7-44	13	10-13	18
7-45	13	10-14	18
7-46	13	10-15	18
7-47	13		
7-48	13		
7-49	13		
7-50	13		
8-1	13		
8-2	13		
8-3	13		
8-4	13		
8-5	13		
8-6	13		
8-7	13		
8-8	13		
8-9	13		

## TABLE OF CONTENTS

Page	Section	
1-1	1.0	INTRODUCTION
<b>PART I - RADIOLOGICAL EFFLUENT CONTROLS</b>		
2-1	2.0	DEFINITIONS
3-1	3.0	CONTROLS AND SURVEILLANCE REQUIREMENTS
3-2	3/4.0	Controls and Surveillance Requirements Applicability
3-5	3/4.3.7.11	Radioactive Liquid Effluent Monitoring Instrumentation
3-10	3/4.3.7.12	Radioactive Gaseous Effluent Monitoring Instrumentation
3-17	3/4.11.1.1	Liquid Effluents Concentration
3-21	3/4.11.1.2	Liquid Effluents Dose
3-22	3/4.11.1.3	Liquid Waste Treatment
3-23	3/4.11.2.1	Gaseous Effluents Dose Rate
3-27	3/4.11.2.2	Gaseous Effluents Dose - Noble Gases
3-28	3/4.11.2.3	Gaseous Effluents Dose - Iodine-131, Iodine-133, Tritium, and Radionuclides in Particulate Form
3-29	3/4.11.2.4	Offgas Treatment System
3-30	3/4.11.2.5	Ventilation Exhaust Treatment System
3-31	3/4.11.2.8	Venting or Purging
3-32	3/4.11.4	Radioactive Effluents Total Dose
3-33	3/4.12.1	Radiological Environmental Monitoring Program
3-44	3/4.12.2	Land Use Census
3-45	3/4.12.3	Interlaboratory Comparison Program
4-1	4.0	BASES
5-1	5.0	ADMINISTRATIVE CONTROLS
5-2	5.9.1.7	Annual Radiological Environmental Operating Report
5-2	5.9.1.8	Annual Radioactive Effluent Release Report
5-4	5.15	Major Changes to Radioactive Liquid, Gaseous, and Solid Waste Treatment Systems



**TABLE OF CONTENTS (continued)**

<b>Page</b>	<b>Section</b>
<b>PART II - CALCULATIONAL METHODS</b>	
6-1	6.0 LIQUID EFFLUENTS
6-2	6.1 Radiation Monitoring Instrumentation and Controls
6-2	6.1.1 Offsite Dose Calculation Manual (ODCM) 3.3.7.11 Requirement
6-3	6.1.2 Non-ODCM Required Monitor
6-4	6.2 Sampling and Analysis of Liquid Effluents
6-4	6.2.1 BATCH Releases
6-5	6.2.2 CONTINUOUS Releases
6-5	6.3 Liquid Effluent Monitor Setpoints
6-6	6.3.1 Liquid Radwaste Effluent Line Monitor
6-9	6.3.2 Circulating Water Reservoir Decant Line Radiation Monitor (D11-N402)
6-10	6.3.3 Generic, Conservative Alarm Setpoint for D11-N402
6-11	6.3.4 Alarm Setpoint for GSW and RHR System Radiation Monitors
6-11	6.3.5 Alarm Response - Evaluating Actual Release Conditions
6-12	6.3.6 Liquid Radwaste Setpoint Determination With Contaminated Circulating Water Reservoir
6-13	6.4 Contaminated GSW or RHR System - Quantifying and Controlling Releases
6-14	6.5 Liquid Effluent Dose Calculation - 10 CFR 50
6-14	6.5.1 MEMBER OF THE PUBLIC Dose - Liquid Effluents
6-16	6.5.2 Contaminated CWR System - Dose Calculation
6-17	6.6 Liquid Effluent Dose Projections
7-1	7.0 GASEOUS EFFLUENTS
7-2	7.1 Radiation Monitoring Instrumentation and Controls
7-2	7.1.1 Effluent Monitoring - Ventilation System Releases
7-2	7.1.2 Main Condenser Offgas Monitoring
7-3	7.1.3 Reactor Building Ventilation Monitors (Gulf Atomic)
7-3	7.2 Sampling and Analysis of Gaseous Effluents
7-3	7.2.1 Containment PURGE
7-4	7.2.2 Ventilation System Releases

**TABLE OF CONTENTS (continued)**

<u>Page</u>	<u>Section</u>
7-5	7.3 Gaseous Effluent Monitor Setpoint Determination
7-5	7.3.1 Ventilation System Monitors
7-7	7.3.2 Setpoint Determination with No Nuclides Detected
7-7	7.3.3 Gaseous Effluent Alarm Response - Evaluating Actual Release Conditions
7-8	7.4 Primary Containment VENTING and PURGING
7-8	7.4.1 Release Rate Evaluation
7-9	7.4.2 Alarm Setpoint Evaluation
7-10	7.5 Quantifying Releases - Noble Gases
7-10	7.5.1 Sampling Protocol
7-11	7.6 Calculation of Activity Released
7-11	7.7 Site Boundary Dose Rate - Radioiodine and Particulates
7-13	7.8 Noble Gas Effluent Dose Calculations - 10 CFR 50
7-13	7.8.1 UNRESTRICTED AREA Dose - Noble Gases
7-14	7.9 Radioiodine and Particulate Dose Calculations - 10 CFR 50
7-14	7.9.1 UNRESTRICTED AREA Dose - Radioiodine, Particulates, and Tritium
7-16	7.10 Gaseous Effluent Dose Projection
8-1	8.0 SPECIAL DOSE ANALYSES
8-2	8.1 Doses Due to Activities inside the SITE BOUNDARY
8-2	8.2 Doses to MEMBERS OF THE PUBLIC - 40 CFR 190
8-3	8.2.1 Effluent Dose Calculations
8-4	8.2.2 Direct Exposure Dose Determination
8-4	8.2.3 Dose Assessment Based on Radiological Environmental Monitoring Data
9-1	9.0 ASSESSMENT OF LAND USE CENSUS DATA
9-2	9.1 Land Use Census as Required by ODCM 3.12.2
9-4	9.2 Land Use Census to Support Realistic Dose Assessment

TABLE OF CONTENTS (continued)

Page	Section
10-1	10.0 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
10-2	10.1 Sampling Locations
10-2	10.2 Reporting Levels
10-3	10.3 Interlaboratory Comparison Program

TABLES

Page	Table
2-7	2.1 Surveillance Frequency Notation
2-8	2.2 Operational Conditions
3-6	3.3.7.11-1 Radioactive Liquid Effluent Monitoring Instrumentation
3-8	4.3.7.11-1 Radioactive Liquid Effluent Monitoring Instrumentation Surveillance Requirements
3-11	3.3.7.12-1 Radioactive Gaseous Effluent Monitoring Instrumentation
3-14	4.3.7.12-1 Radioactive Gaseous Effluent Monitoring Instrumentation Surveillance Requirements
3-18	4.11.1.1.1-1 Radioactive Liquid Waste Sampling and Analysis Program
3-24	4.11.2.1.2-1 Radioactive Gaseous Waste Sampling and analysis Program
3-35	3.12.1-1 Radiological Environmental Monitoring Program
3-40	3.12.1-2 Reporting Levels for Radioactivity Concentrations in Environmental Samples
3-41	4.12.1-1 Detection Capabilities for Environmental Sample Analysis
6-19	6.0-1 Fermi 2 Site Specific Liquid Ingestion Dose Commitment Factors, A <sub>ij</sub>
6-21	6.0-2 Bioaccumulation Factors (BF <sub>i</sub> )

## TABLE OF CONTENTS (continued)

### TABLES (continued)

Page	Table	
7-17	7.0-1	Values for Evaluating Gaseous Release Rates and Alarm Setpoints
7-18	7.0-2	Dose Factors for Noble Gases
7-19	7.0-3	Controlling Locations, Pathways and Atmospheric Dispersion for Dose Calculations
7-20	7.0-4	Gaseous Effluent Pathway Dose Commitment Factors
8-8	8.0-1	Assumptions for Assessing Doses Due to Activities inside SITE BOUNDARY
8-9	8.0-2	Recommended Exposure Rates in Lieu of Site Specific Data
10-4	10.0-1	Radiological Environmental Monitoring Program, Fermi 2 Sample Locations and Associated Media

### FIGURES

Page	Figure	
3-46	3.0-1	Map Defining Unrestricted Areas and Site Boundary for Radioactive Gaseous and Liquid Effluents
6-22	6.0-1	Liquid Radioactive Effluent Monitoring and Processing Diagram
7-50	7.0-1	Gaseous Radioactive Effluent Monitoring and Ventilation Systems Diagram

END OF SECTION 0.0

**SECTION 1.0**  
**INTRODUCTION**

## 1.0 INTRODUCTION

Part I of the Fermi 2 Offsite Dose Calculation Manual (ODCM), which includes Sections 2.0 through 5.0, contains the controls and surveillance requirements for radioactive effluents and radiological environmental monitoring. It also contains requirements for the Annual Radiological Environmental Operating Report and the Annual Radioactive Effluent Release Report.

This satisfies the requirements for Technical Specification 5.5.1, the Offsite Dose Calculation Manual (ODCM), and Technical Specification 5.5.4, Radioactive Effluent Controls Program.

Part II of the ODCM describes the methodology and parameters used in calculating radioactive liquid and gaseous effluent monitoring instrumentation alarm/trip setpoints, and in calculating liquid and gaseous effluent dose rates and cumulative doses.

The methodology provided in Part II of this manual is acceptable for use in demonstrating compliance with the dose limits for members of the public of 10 CFR 20, the cumulative dose criteria of 10 CFR 50, Appendix I and 40 CFR 190, and the controls in Part I of this manual.

Part II, Section 6.0 of the ODCM describes equipment for monitoring and controlling liquid effluents, sampling requirements, and dose evaluation methods. Section 7.0 provides similar information on gaseous effluent controls, sampling, and dose evaluation. Section 8.0 describes special dose analyses required for compliance with Fermi 2 Offsite Dose Calculation Manual and 40 CFR 190. Section 9.0 describes the role of the annual land use census in identifying the controlling pathways and locations of exposure for assessing potential off-site doses. Section 10.0 describes the Radiological Environmental Monitoring Program.

The ODCM will be maintained at Fermi 2 for use as a listing of radiological effluent controls and surveillance requirements, as well as a reference guide and training document for accepted methodologies and calculations. Changes to the ODCM calculational methodologies and parameters will be made as necessary to ensure reasonable conservatism in keeping with the principles of 10 CFR 50.36a and Appendix I for demonstrating that radioactive effluents are "As Low As Reasonably Achievable."

**NOTE:** Throughout this document words appearing all capitalized denote either definitions specified in the Fermi 2 Controls or common acronyms.

END OF SECTION 1.0

## **SECTION 2.0**

### **DEFINITIONS**

## 2.0 DEFINITIONS

### Term

### Definition

#### ACTIONS

ACTIONS shall be that part of a Specification that prescribes Required Actions to be taken under designated Conditions within specified Completion Times.

#### CHANNEL CALIBRATION

A CHANNEL CALIBRATION shall be the adjustment, as necessary, of the channel output such that it responds within the necessary range and accuracy to known values of the parameter that the channel monitors. A CHANNEL CALIBRATION shall encompass the entire channel including the required sensor, alarm, display, and trip functions, and shall include a CHANNEL FUNCTIONAL TEST. Calibration of instrument channels with resistance temperature detectors (RTD) or thermocouple sensors may consist of an in-place qualitative assessment of sensor behavior and normal calibration of the remaining adjustable devices in the channel. A CHANNEL CALIBRATION may be performed by means of any series of sequential, overlapping, or total channel steps so that the entire channel is calibrated.

#### CHANNEL CHECK

A CHANNEL CHECK shall be the qualitative assessment, by observation, of channel behavior during operation. This determination shall include, where possible, comparison of the channel indication and/or status with other indications and/or status derived from independent instrument channels measuring the same parameter.

#### CHANNEL FUNCTIONAL TEST

A CHANNEL FUNCTIONAL TEST shall be the injection of a simulated or actual signal into the channel as close to the sensor as practicable to verify FUNCTIONAL CAPABILITY, including required alarm, interlock, display, and trip functions, and channel failure trips. A CHANNEL FUNCTIONAL TEST may be performed by means of any series of sequential, overlapping, or total channel steps so that the entire channel is tested.



Term

Definition

**FREQUENCY NOTATION**

The FREQUENCY NOTATION specified for the performance of Surveillance Requirements shall correspond to the intervals defined in Table 2.1.

**FUNCTIONALLY CAPABLE**

A system, subsystem, division, component, or device shall be FUNCTIONALLY CAPABLE or have FUNCTIONAL CAPABILITY when it is capable of performing its specified safety function(s) and when all necessary attendant instrumentation, controls, normal or emergency electrical power, cooling and seal water, lubrication, and other auxiliary equipment that are required for the system, subsystem, division, component, or device to perform its specified safety function(s) are also capable of performing their related support function(s).

**MEMBER(S) OF THE PUBLIC**

MEMBER(S) OF THE PUBLIC means any individual except when that individual is receiving an occupational dose.

**MODE**

A MODE shall correspond to any one inclusive combination of mode switch position, average reactor coolant temperature, and reactor vessel head closure bolt tensioning specified in Table 2.2 with fuel in the reactor vessel.

**MPC**

(Maximum Permissible Concentration in water) For individual nuclides, 10 times the concentration values in 10 CFR Part 20.1001-20.2402, Appendix B, Table 2, Column 2, except for noble gases which are limited to  $2E-4$  uCi/ml total activity concentration. For nuclide mixtures, concentrations for which the sum of individual nuclide concentrations divided by their corresponding individual MPC values equals 1.

**OCCUPATIONAL DOSE**

OCCUPATIONAL DOSE means the dose received by an individual in the course of employment in which the individual's assigned duties involve exposure to radiation and/or to radioactive material from licensed and unlicensed sources of radiation, whether in the possession of the licensee or other person. Occupational dose does not include dose received from background radiation, as a patient from medical practices, from voluntary participation in medical research programs, or as a member of the general public.

Term

Definition

**OFF-GAS  
TREATMENT SYSTEM**

An OFF-GAS TREATMENT SYSTEM is any system designed and installed to reduce radioactive gaseous effluents by collecting reactor coolant system offgases from the reactor coolant and providing for delay or holdup for the purpose of reducing the total radioactivity prior to release to the environment.

**OFFSITE DOSE  
CALCULATIONAL MANUAL**

The OFFSITE DOSE CALCULATION MANUAL (ODCM) shall contain the methodology and parameters used in the calculation of offsite doses resulting from radioactive gaseous and liquid effluent, in the calculation of gaseous and liquid effluent monitoring alarm/trip setpoints, and in the conduct of the radiological environmental monitoring program. The ODCM shall also contain (1) the Radiological Effluent Controls and Radiological Environmental Monitoring Program Controls, and (2) descriptions of the information that should be included in the Annual Radiological Environmental Operating and Annual Radioactive Effluent Reports required by Controls 5.9.1.7 and 5.9.1.8.

**PUBLIC DOSE**

PUBLIC DOSE means the dose received by a member of the public from exposure to radiation and/or radioactive material released by a licensee, or to any other source of radiation under the control of a licensee. It does not include occupational dose or doses received from background radiation, as a patient from medical practices, or from voluntary participation in medical research programs.

**PURGE - PURGING**

PURGE or PURGING is the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration or other operating condition, in such a manner that replacement air or gas is required to purify the confinement.

**RATED THERMAL POWER  
(RTP)**

RTP shall be a total reactor core heat transfer rate to the reactor coolant of 3430 MWt.

**REPORTABLE EVENT**

A REPORTABLE EVENT shall be any of those conditions specified in Section 50.73 to 10 CFR Part 50.

<u>Term</u>	<u>Definition</u>
<b>SITE BOUNDARY</b>	The <b>SITE BOUNDARY</b> shall be that line beyond which the land is neither owned, nor leased, nor otherwise controlled, by the licensee.
<b>SOURCE CHECK</b>	A <b>SOURCE CHECK</b> shall be the qualitative assessment of channel response when the channel sensor is exposed to a radioactive source.
<b>THERMAL POWER</b>	<b>THERMAL POWER</b> shall be the total reactor core heat transfer rate to the reactor coolant.
<b>UNRESTRICTED AREA</b>	The Fermi 2 Energy Center <b>UNRESTRICTED AREA</b> includes all areas outside the site boundary.
<b>VENTILATION EXHAUST TREATMENT SYSTEM</b>	A <b>VENTILATION EXHAUST TREATMENT SYSTEM</b> shall be any system designed and installed to reduce gaseous radioiodine or radioactive material in particulate form in effluents by passing ventilation or vent exhaust gases through charcoal adsorbers and/or HEPA filters for the purpose of removing iodines or particulates from the gaseous exhaust stream prior to the release to the environment. Such a system is not considered to have any effect on noble gas effluents. Engineered Safety Feature (ESF) atmospheric cleanup systems are not considered to be <b>VENTILATION EXHAUST TREATMENT SYSTEM</b> components.
<b>VENTING</b>	<b>VENTING</b> shall be the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration or other operating condition, in such a manner that replacement air or gas is not provided or required during <b>VENTING</b> . Vent, used in system names, does not imply a <b>VENTING</b> process.

**TABLE 2.1**  
**SURVEILLANCE FREQUENCY NOTATION**

NOTATION	FREQUENCY
S .....	At least once per 12 hours.
D .....	At least once per 24 hours.
W .....	At least once per 7 days.
M .....	At least once per 31 days.
Q .....	At least once per 92 days.
SA .....	At least once per 184 days.
A .....	At least once per 366 days.
R .....	At least once per 18 months (550 days).
S/U .....	Prior to each reactor startup.
P .....	Prior to each radioactive release.
N.A. ....	Not applicable.

TABLE 2.2

MODES

MODE	TITLE	REACTOR MODE SWITCH POSITION	AVERAGE REACTOR COOLANT TEMPERATURE (°F)
1	Power Operation	Run	NA
2	Startup	Refuel <sup>(a)</sup> or Startup/Hot Standby	NA
3	Hot Shutdown <sup>(a)</sup>	Shutdown	> 200
4	Cold Shutdown <sup>(a)</sup>	Shutdown	≤ 200
5	Refueling <sup>(b)</sup>	Shutdown or Refuel	NA

(a) All reactor vessel head closure bolts fully tensioned.

(b) One or more reactor vessel head closure bolts less than fully tensioned.

END OF SECTION 2.0

**CTS** TABLE 2.2**OPERATIONAL CONDITIONS**

<b>CONDITION</b>	<b>MODE SWITCH POSITION</b>	<b>AVERAGE REACTOR COOLANT TEMPERATURE</b>
1. POWER OPERATION	Run	Any temperature
2. STARTUP	Startup/Hot Standby	Any temperature
3. HOT SHUTDOWN	Shutdown#, ***	> 200 degrees F
4. COLD SHUTDOWN	Shutdown#, ##, ***	≤ 200 degrees F
5. REFUELING*	Shutdown or refuel**, #	≤ 140 degrees F

---

# The reactor mode switch may be placed in the Run, Startup/Hot Standby, or Refuel position to test the switch interlock functions and related instrumentation provided that the control rods are verified to remain fully inserted by a second licensed operator or other technically qualified member of the unit technical staff.

## The reactor mode switch may be placed in the Refuel position while a single control rod drive is being removed from the reactor pressure vessel per Technical Specification 3.9.10.1.

\* Fuel in the reactor vessel with the vessel head closure bolts less than fully tensioned or with the head removed.

\*\* See Special Test Exceptions 3.10.1 and 3.10.3 of Technical Specifications.

\*\*\* The reactor mode switch may be placed in the Refuel position while a single control rod is being recoupled or withdrawn provided that the one-rod-out interlock is OPERABLE.

**ITS** TABLE 2.2

## MODES

MODE	TITLE	REACTOR MODE SWITCH POSITION	AVERAGE REACTOR COOLANT TEMPERATURE (°F)
1	Power Operation	Run	NA
2	Startup	Refuel <sup>(a)</sup> or Startup/Hot Standby	NA
3	Hot Shutdown <sup>(a)</sup>	Shutdown	> 200
4	Cold Shutdown <sup>(a)</sup>	Shutdown	≤ 200
5	Refueling <sup>(b)</sup>	Shutdown or Refuel	NA

(a) All reactor vessel head closure bolts fully tensioned.

(b) One or more reactor vessel head closure bolts less than fully tensioned.

END OF SECTION 2.0

**SECTION 3.0**  
**CONTROLS**  
**AND**  
**SURVEILLANCE REQUIREMENTS**



## 3/4 CONTROLS AND SURVEILLANCE REQUIREMENTS

### 3/4.0 APPLICABILITY

#### CONTROLS

---

3.0.1 Controls shall be met during the MODES or other specified conditions in the Applicability, except as provided in Control 3.0.2.

3.0.2 Upon discovery of a failure to meet a Control, the Actions shall be met, except as provided in Control 3.0.5.

If the Control is met or is no longer applicable prior to expiration of the specified completion time(s), completion of the Action(s) is not required, unless otherwise stated.

3.0.3 When a Control is not met and the associated ACTIONS are not met, an associated ACTION is not provided, or if directed by the associated ACTIONS, the unit shall be placed in a MODE or other specified condition in which the Control is not applicable. Action shall be initiated within 1 hour to place the unit, as applicable, in:

1. Mode 2 within 7 hours;
2. Mode 3 within 13 hours; and
3. Mode 4 within 37 hours.

Exceptions to this Control are stated in the individual Controls.

Where corrective measures are completed that permit operation in accordance with the Control or ACTIONS, completion of the actions required by Control 3.0.3 is not required.

Control 3.0.3 is only applicable in MODES 1, 2, and 3.

## 3/4.0 APPLICABILITY

### CONTROLS (continued)

---

- 3.0.4 When a Control is not met, entry into a MODE or other specified condition in the Applicability shall not be made except when the associated ACTIONS to be entered permit continued operation in the MODE or other specified condition in the Applicability for an unlimited period of time. This Specification shall not prevent changes in MODES or other specified conditions in the Applicability that are required to comply with ACTIONS or that are part of a shutdown of the unit.

Exceptions to this Control are stated in the individual Controls. These exceptions allow entry into MODES or other specified conditions in the Applicability when the associated ACTIONS to be entered allow unit operation in the MODE or other specified condition in the Applicability only for a limited period of time.

Control 3.0.4 is only applicable for entry into a MODE or other specified condition in the Applicability in MODES 1, 2, and 3.

- 3.0.5 Equipment removed from service or declared not FUNCTIONALLY CAPABLE to comply with ACTIONS may be returned to service under administrative control solely to perform testing required to demonstrate its FUNCTIONAL CAPABILITY or the FUNCTIONAL CAPABILITY of other equipment. This is an exception to Control 3.0.2 for the system returned to service under administrative control to perform the testing required to demonstrate FUNCTIONAL CAPABILITY.

### 3/4.0 APPLICABILITY

#### SURVEILLANCE REQUIREMENTS

4.0.1 Surveillance Requirements shall be met during the MODES or other specified conditions in the Applicability for individual Controls, unless otherwise stated in the Surveillance Requirements. Failure to meet a Surveillance, whether such failure is experienced during the performance of the Surveillance or between performances of the Surveillance, shall be failure to meet the Control. Failure to perform a Surveillance within the specified Frequency shall be failure to meet the Control except as provided in Surveillance Requirement 4.0.3. Surveillances do not have to be performed on equipment which is not FUNCTIONALLY CAPABLE or variables outside specified limits.

4.0.2 The specified Frequency is met if the Surveillance is performed within 1.25 times the interval specified in the Frequency, as measured from the previous performance or as measured from the time a specified condition of the Frequency is met.

For Frequencies specified as "once," the above interval extension does not apply.

If a Completion Time requires periodic performance on a "once per ..." basis, the above Frequency extension applies to each performance after the initial performance.

Exceptions to this Control are stated in the individual Controls.

4.0.3 If it is discovered that a Surveillance was not performed within its specified Frequency, then compliance with the requirement to declare the Control not met may be delayed, from the time of discovery, up to 24 hours or up to the limit of the specified Frequency, whichever is greater. This delay period is permitted to allow performance of the Surveillance. A risk evaluation shall be performed for any Surveillance delayed greater than 24 hours and the risk impact shall be managed.

If the Surveillance is not performed within the delay period, the Control must immediately be declared not met, and the applicable ACTIONS must be entered.

When the Surveillance is performed within the delay period and the Surveillance is not met, the Control must immediately be declared not met, and the applicable ACTIONS must be entered.

4.0.4 Entry into a MODE or other specified condition in the Applicability of a Control shall not be made unless the Control's Surveillances have been met within their specified Frequency. This provision shall not prevent entry into MODES or other specified conditions in the Applicability that are required to comply with ACTIONS or that are part of a shutdown of the unit.

4.0.4 is only applicable for entry into a MODE or other specified condition in the Applicability in MODES 1, 2, and 3.

**ITS** 4.0.3

If it is discovered that a Surveillance was not performed within its specified Frequency, then compliance with the requirement to declare the Control not met may be delayed, from the time of discovery, up to 24 hours or up to the limit of the specified Frequency, whichever is less. This delay period is permitted to allow performance of the Surveillance.

If the Surveillance is not performed within the delay period, the Control must immediately be declared not met, and the applicable ACTIONS must be entered.

When the Surveillance is performed within the delay period and the Surveillance is not met, the Control must immediately be declared not met, and the applicable ACTIONS must be entered.

**CTS** 4.0.4

Entry into an OPERATIONAL CONDITION or other specified applicable condition shall not be made unless the Surveillance Requirement(s) associated with the Control have been performed within the applicable surveillance interval or as otherwise specified. This provision shall not prevent passage through or to OPERATIONAL CONDITIONS as required to comply with ACTION requirements.

**ITS** 4.0.4

Entry into a MODE or other specified condition in the Applicability of a Control shall not be made unless the Control's Surveillances have been met within their specified Frequency. This provision shall not prevent entry into MODES or other specified conditions in the Applicability that are required to comply with ACTIONS or that are part of a shutdown of the unit.

4.0.4 is only applicable for entry into a MODE or other specified condition in the Applicability in MODES 1, 2, and 3.

## **INSTRUMENTATION**

### **RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION**

#### **CONTROLS**

---

3.3.7.11 The radioactive liquid effluent monitoring instrumentation channels shown in Table 3.3.7.11-1 shall be FUNCTIONALLY CAPABLE with their alarm/trip setpoints set to ensure that the limits of Control 3.11.1.1 are not exceeded. The alarm/trip setpoints of these channels shall be determined and adjusted in accordance with the methodology and parameters in the OFFSITE DOSE CALCULATIONAL MANUAL (ODCM).

APPLICABILITY: At all times.

ACTION:

- a. With a radioactive liquid effluent monitoring instrumentation channel alarm/trip setpoint less conservative than required by the above control, immediately suspend the release of radioactive liquid effluents monitored by the affected channel, or declare the channel not FUNCTIONALLY CAPABLE, or change the setpoint so it is acceptably conservative.
- b. With less than the minimum number of radioactive liquid effluent monitoring instrumentation channels FUNCTIONALLY CAPABLE, take the ACTION shown in Table 3.3.7.11-1. Restore the instrumentation which is not FUNCTIONALLY CAPABLE to FUNCTIONALLY CAPABLE status within 30 days and, if unsuccessful, explain why this condition was not corrected in a timely manner in the next Annual Radioactive Effluent Release Report.
- c. The provisions of Controls 3.0.3 and 3.0.4 are not applicable.

#### **SURVEILLANCE REQUIREMENTS**

---

4.3.7.11 Each radioactive liquid effluent monitoring instrumentation channel shall be demonstrated FUNCTIONALLY CAPABLE by performance of the CHANNEL CHECK, CHANNEL CALIBRATION, and CHANNEL FUNCTIONAL TEST operations at the frequencies shown in Table 4.3.7.11-1.

TABLE 3.3.7.11-1

RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION

Instrument	Minimum Channels Functionally Capable	Action
1. GROSS RADIOACTIVITY MONITORS PROVIDING ALARM AND AUTOMATIC TERMINATION OF RELEASE		
a. Liquid Radwaste Effluent Line D11-N007	1	110
2. GROSS RADIOACTIVITY MONITORS PROVIDING ALARM BUT NOT PROVIDING AUTOMATIC TERMINATION OF RELEASE		
a. Circulating Water Reservoir Decant Line D11-N402	1	111
3. FLOW RATE MEASUREMENT DEVICES *		
a. Liquid Radwaste Effluent Line G11-R703	1	112

TABLE NOTATION

\* The circulating water reservoir decant line flow rate monitor has been removed. The flow rate in this decant line is now measured using certified pump performance curves for the circulating water reservoir decant pumps, together with readings from pump discharge pressure gauges and reservoir level indication. The circulating water reservoir decant line flow rate device was deleted from this table; the Liquid Radwaste Effluent Line flow rate device refers to a monitor on the radwaste blowdown line from the Waste Sample Tanks, upstream of the circulating water decant line.

TABLE 3.3.7.11-1 (Continued)

TABLE NOTATIONS

- ACTION 110 - With the number of channels FUNCTIONALLY CAPABLE less than that required by the Minimum Channels FUNCTIONALLY CAPABLE requirement, effluent releases from this pathway may continue provided that prior to initiating a release:
- a. At least two independent samples are analyzed in accordance with Surveillance Requirement 4.11.1.1.1, and
  - b. At least two technically qualified individuals independently verify the release rate calculations and discharge line valving (one technically qualified individual can be the preparer of the calculation, the other independently reviews the release rate calculations to verify accuracy);
- Otherwise, suspend release of radioactive effluents via this pathway.
- ACTION 111 - With the number of channels FUNCTIONALLY CAPABLE less than the Minimum Channels FUNCTIONALLY CAPABLE requirement, radioactive effluent releases via this pathway may continue provided that grab samples are collected and analyzed at least once per 12 hours for gross radioactivity (beta or gamma) at a lower limit of detection of at least  $10^{-7}$  microcurie/ml, for Cs-137. Otherwise, suspend release of radioactive effluents via this pathway. If radioactive effluent releases are not in progress, i.e., if no Waste Sample Tank (or other tank containing radioactive liquid) is being released and the circulating water is not contaminated as shown by the most recent circulating water sample(s), this sampling requirement does not apply.
- ACTION 112 - With the number of channels FUNCTIONALLY CAPABLE less than required by the Minimum Channels FUNCTIONALLY CAPABLE requirement, radioactive effluent releases via this pathway may continue provided the flow rate is estimated at least once per 4 hours during actual releases. Otherwise, suspend release of radioactive effluents via this pathway. If radioactive effluent releases are not in progress, i.e., if no Waste Sample Tank (or other tank containing radioactive liquid) is being released, this requirement does not apply.

TABLE 4.3.7.11-1

RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<i>Instrument</i>	<i>Channel Check</i>	<i>Source Check</i>	<i>Channel Calibration</i>	<i>Channel Functional Test</i>
1. GROSS RADIOACTIVITY MONITORS PROVIDING ALARM AND AUTOMATIC TERMINATION OF RELEASE a. Liquid Radwaste Effluent Line	P	P	R(3)	Q(1) (2)
2. GROSS BETA OR GAMMA RADIOACTIVITY MONITORS PROVIDING ALARM BUT NOT PROVIDING AUTOMATIC TERMINATION OF RELEASE a. Circulating Water Reservoir Decant Line D11-N402	D	M	R(3)	Q(5)
3. FLOW RATE MEASUREMENT DEVICES (4) a. Liquid Radwaste Effluent Line	D(4)	N.A.	R	Q



**TABLE 4.3.7.11-1 (Continued)**

**TABLE NOTATIONS**

- (1) The CHANNEL FUNCTIONAL TEST shall also demonstrate that automatic isolation of this pathway occurs if any of the following conditions exists:
  1. Instrument indicates measured levels above the alarm/trip setpoint.
  2. Circuit failure.
  
- (2) The CHANNEL FUNCTIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exists:
  1. Instrument indicates measured levels above the alarm setpoint.
  2. Circuit failure.
  3. Instrument indicates a downscale failure.
  4. Instrument controls not set in operate mode.
  
- (3) The initial CHANNEL CALIBRATION shall be performed using National Institute of Standards and Technology traceable sources. These standards shall permit calibrating the system over the range of energy and measurement expected during normal operation and anticipated operational occurrences. For subsequent CHANNEL CALIBRATION, sources that have been related to the initial calibration or are National Institute of Standards and Technology traceable shall be used.
  
- (4) CHANNEL CHECK shall consist of verifying indication of flow during periods of release. CHANNEL CHECK shall be made at least once per 24 hours on days on which continuous, periodic, or batch releases are made.
  
- (5) The CHANNEL FUNCTIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exists:
  1. Instrument indicates measured levels above the alarm setpoint.
  2. Circuit failure.
  3. Instrument indicates a downscale failure.

## INSTRUMENTATION

### RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

#### CONTROLS

3.3.7.12 The radioactive gaseous effluent monitoring instrumentation channels shown in Table 3.3.7.12-1 shall be FUNCTIONALLY CAPABLE with their alarm/trip setpoints set to ensure that the limits of Control 3.11.2.1 are not exceeded. The alarm/trip setpoints of these channels, with the exception of the offgas monitoring system, shall be determined and adjusted in accordance with the methodology and parameters in the ODCM.

**APPLICABILITY:**     Actions a and b: As shown in Table 3.3.7.12-1  
                          Actions c and d: At all times

#### **ACTION:**

- a.     With a radioactive gaseous effluent monitoring instrumentation channel alarm/trip setpoint less conservative than required by the above Control, immediately suspend the release of radioactive gaseous effluents monitored by the affected channel, or declare the channel not FUNCTIONALLY CAPABLE, or change the setpoint so it is acceptably conservative.
- b.     With less than the minimum number of radioactive gaseous effluent monitoring instrumentation channels FUNCTIONALLY CAPABLE, take the ACTION shown in Table 3.3.7.12-1.
- c.     Restore radioactive gaseous effluent monitoring instrumentation which is not FUNCTIONALLY CAPABLE to FUNCTIONALLY CAPABLE status within 30 days and, if unsuccessful, explain why this condition was not corrected in a timely manner in the next Annual Radioactive Effluent Release Report.
- d.     The provisions of Controls 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.3.7.12 Each radioactive gaseous effluent monitoring instrumentation channel shall be demonstrated FUNCTIONALLY CAPABLE by performance of the CHANNEL CHECK, CHANNEL CALIBRATION, and CHANNEL FUNCTIONAL TEST operations at the frequencies shown in Table 4.3.7.12-1.

Note: Page content was last changed with ODCM Revision 15.

TABLE 3.3.7.12-1

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

<i>Instrument</i>	<i>Minimum Channels Functionally Capable</i>	<i>Applicability</i>	<i>Action</i>
1. REACTOR BUILDING EXHAUST PLENUM EFFLUENT MONITORING SYSTEM			
a. Low Range Noble Gas Activity Monitor - Providing Alarm	1	*	121
b. Iodine Sampler	1	*	122
c. Particulate Sampler	1	*	122
d. Sampler Flow Rate Monitor	1	*	123
2. OFFGAS MONITORING SYSTEM (At the 2.2 minute delay piping)			
a. Noble Gas Activity Monitor - Providing Alarm	1	**	126
3. STANDBY GAS TREATMENT SYSTEM			
a. Low Range Noble Gas Activity Monitor - Providing Alarm	1	#	125
b. Iodine Sampler	1	#	122
c. Particulate Sampler	1	#	122
d. Sampler Flow Rate Monitor	1	#	123
4. TURBINE BLDG. VENTILATION MONITORING SYSTEM			
a. Low Range Noble Gas Activity Monitor - Providing Alarm	1	*	121
b. Iodine Sampler	1	*	122
c. Particulate Sampler	1	*	122
d. Sampler Flow Rate Monitor	1	*	123

TABLE NOTATIONS

- \* At all times.
- \*\* During operation of the main condenser air ejector.
- # During operation of the standby gas treatment system.

TABLE 3.3.7.12-1 (Continued)

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

<i>Instrument</i>	<i>Minimum Channels Functionally Capable</i>	<i>Applicability</i>	<i>Action</i>
5. RADWASTE BUILDING VENTILATION MONITORING SYSTEM			
a. Low Range Noble Gas Activity Monitor - Providing Alarm	1	*	121
b. Iodine Sampler	1	*	122
c. Particulate Sampler	1	*	122
d. Sampler Flow Rate Monitor	1	*	123
6. ONSITE STORAGE BUILDING VENTILATION EXHAUST RADIATION MONITOR			
a. Low Range Noble Gas Activity Monitor - Providing Alarm	1	*	121
b. Iodine Sampler	1	*	122
c. Particulate Sampler	1	*	122
d. Sampler Flow Rate Monitor	1	*	123

TABLE NOTATIONS

\* At all times.

TABLE 3.3.7.12-1 (Continued)

- ACTION STATEMENTS

- ACTION 121 - With the number of channels FUNCTIONALLY CAPABLE less than required by the Minimum Channels FUNCTIONALLY CAPABLE requirement, effluent releases via this pathway may continue provided grab samples are taken at least once per 9 hours and these samples are analyzed for gross activity within 24 hours, or, if valid monitor indication of noble gas concentration is available, that noble gas concentration readings are recorded at least once per 9 hours. Otherwise, suspend release of radioactive effluents via this pathway.
- ACTION 122 - With the number of channels FUNCTIONALLY CAPABLE one less than required by the Minimum Channels FUNCTIONALLY CAPABLE requirement, effluent releases via this pathway may continue provided that within 8 hours samples are continuously collected with auxiliary sampling equipment as required in Table 4.11.2.1.2-1.
- ACTION 123 - With the number of channels FUNCTIONALLY CAPABLE less than required by the Minimum Channels FUNCTIONALLY CAPABLE requirement, effluent releases via this pathway may continue provided the flow rate is estimated at least once per 9 hours. Otherwise, suspend release of radioactive effluents via this pathway.
- ACTION 124 - Not used.
- ACTION 125 - With the number of channels FUNCTIONALLY CAPABLE less than required by the Minimum Channels FUNCTIONALLY CAPABLE requirement, effluent releases via this pathway may continue provided grab samples are taken at least once per 9 hours and these samples are analyzed for gross activity within 24 hours, or, if valid monitor indication of noble gas concentration is available, that noble gas concentration readings are recorded at least once per 9 hours. Otherwise, suspend release of radioactive effluents via this pathway.
- ACTION 126 - With the number of channels FUNCTIONALLY CAPABLE less than required by the Minimum Channels FUNCTIONALLY CAPABLE requirement, releases via this pathway to the environment may continue provided that:
- a. The offgas system is not bypassed,
  - b. The reactor building exhaust plenum noble gas effluent (downstream) monitor is FUNCTIONALLY CAPABLE, and
  - c. Grab samples are taken at least once per 24 hours and these samples are analyzed for principal emitters within 24 hours with calculation of offgas radioactivity rate.

Otherwise, be in at least HOT STANDBY within 12 hours.

TABLE 4.3.7.12-1

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<i>Instrument</i>	<i>Channel Check</i>	<i>Source Check</i>	<i>Channel Calibration</i>	<i>Channel Functional Test</i>	<i>Modes in Which Surveillance Required</i>
1. REACTOR BUILDING EXHAUST PLENUM					
a. Low Range Noble Gas Activity Monitor - Providing Alarm	D	M	R(2)	Q(1)	*
b. Iodine Sampler	W	N.A.	N.A.	N.A.	*
c. Particulate Sampler	W	N.A.	N.A.	N.A.	*
d. Sampler Flow Rate Monitor	D	N.A.	R	Q	*
2. OFFGAS MONITORING SYSTEM (At the 2.2 minute delay piping)					
a. Noble Gas Activity Monitor	D	M	R(2)	Q(1)	**
3. STANDBY GAS TREATMENT MONITORING SYSTEM					
a. Low Range Noble Gas Activity Monitor	D	M	R(2)	Q(1)	#
b. Iodine Sampler	W	N.A.	N.A.	N.A.	#
c. Particulate Sampler	W	N.A.	N.A.	N.A.	#
d. Sampler Flow Rate Monitor	D	N.A.	R	Q	#
4. TURBINE BLDG. VENTILATION MONITORING SYSTEM					
a. Low Range Noble Gas Activity Monitor	D	M	R(2)	Q(4)	*
b. Iodine Sampler	W	N.A.	N.A.	N.A.	*
c. Particulate Sampler	W	N.A.	N.A.	N.A.	*
d. Sampler Flow Rate Monitor	D	N.A.	R	Q	*

TABLE 4.3.7.12-1 (Continued)

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<i>Instrument</i>	<i>Channel Check</i>	<i>Source Check</i>	<i>Channel Calibration</i>	<i>Channel Functional Test</i>	<i>Modes in Which Surveillance Required</i>
5. RADWASTE BUILDING VENTILATION MONITORING SYSTEM					
a. Low Range Noble Gas Activity Monitor	D	M	R(2)	Q(4)	*
b. Iodine Sampler	W	N.A.	N.A.	N.A.	*
c. Particulate Sampler	W	N.A.	N.A.	N.A.	*
d. Sampler Flow Rate Monitor	D	N.A.	R	Q	*
6. ONSITE STORAGE BUILDING VENTILATION EXHAUST RADIATION MONITOR					
a. Low Range Noble Gas Activity Monitor	D	M	R(2)	Q(1)	*
b. Iodine Sampler	W	N.A.	N.A.	N.A.	*
c. Particulate Sampler	W	N.A.	N.A.	N.A.	*
d. Sampler Flow Rate Monitor	D	N.A.	R	Q	*

**TABLE 4.3.7.12-1 (Continued)**

**TABLE NOTATIONS**

- \* At all times.
- \*\* During operation of the main condenser air ejector.
- # During operation of the standby gas treatment system.
- (1) The CHANNEL FUNCTIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exists:
  - 1. Instrument indicates measured levels above the alarm setpoint.
  - 2. Circuit failure.
  - 3. Instrument indicates a downscale failure.
  - 4. Instrument controls not set in operate mode (alarm or type).
- (2) The initial CHANNEL CALIBRATION shall be performed using National Institute of Standards and Technology traceable sources. These standards shall permit calibrating the system over the range of energy and measurement expected during normal operation and anticipated operational occurrences. For subsequent CHANNEL CALIBRATION, sources that have been related to the initial calibration or are National Institute of Standards and Technology traceable shall be used.
- (3) Not used.
- (4) The CHANNEL FUNCTIONAL TEST shall also demonstrate that automatic isolation occurs on high level and that control room alarm annunciation occurs if any of the following conditions exists:
  - 1. Instrument indicates measured levels above the alarm setpoints.
  - 2. Circuit failure.
  - 3. Instrument indicates a downscale failure.
  - 4. Instrument controls not set in the operate mode (alarm or type).



### **3/4.11 RADIOACTIVE EFFLUENTS**

#### **3/4.11.1 LIQUID EFFLUENTS**

##### **CONCENTRATION**

##### **CONTROLS**

---

- 3.11.1.1 The concentration of radioactive material released in liquid effluents to UNRESTRICTED AREAS (see Figure 3.0-1) shall be limited to ten times the concentration values specified in 10 CFR Part 20, Appendix B, Table 2, Column 2 for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the concentration shall be limited to  $2 \times 10^{-4}$  microcuries/ml total activity.

**APPLICABILITY:** At all times.

##### **ACTION:**

With the concentration of radioactive material released in liquid effluents to UNRESTRICTED AREAS exceeding the above limits, immediately restore the concentration to within the above limits.

##### **SURVEILLANCE REQUIREMENTS**

---

4.11.1.1.1 Radioactive liquid wastes shall be sampled and analyzed according to the sampling and analysis program of Table 4.11.1.1.1-1.

4.11.1.1.2 The results of the radioactivity analyses shall be used in accordance with the methodology and parameters in the ODCM to assure that the concentrations at the point of release are maintained within the limits of Control 3.11.1.1.

TABLE 4.11.1.1.1-1

RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM

Liquid Release Type	Sampling Frequency	Minimum Analysis Frequency	Type of Activity Analysis	Lower Limit of Detection (LLD) <sup>a</sup> (uCi/ml)
A. Batch Release <sup>b</sup> : Waste Sample Tanks (3)	P Each Batch	P Each Batch	Principal Gamma Emitters <sup>c</sup>	$5 \times 10^{-7}$
			I-131	$1 \times 10^{-6}$
			Dissolved and Entrained Gases (Gamma Emitters)	$1 \times 10^{-5}$
	P Each Batch	M Composite <sup>d</sup>	H-3	$1 \times 10^{-5}$
			Gross Alpha	$1 \times 10^{-7}$
P Each Batch	Q Composite <sup>d</sup>	Sr-89, Sr-90	$5 \times 10^{-8}$	
B. Continuous Releases <sup>b</sup> : Circulating Water System (if contaminated)	Wf Grab Sample	Mf Composite <sup>d</sup>	Principal Gamma Emitters <sup>c</sup>	$5 \times 10^{-7}$
			I-131	$1 \times 10^{-6}$
			Dissolved and Entrained Gases (Gamma Emitters)	$1 \times 10^{-5}$
			H-3	$1 \times 10^{-5}$
	NA	Q Composite <sup>d</sup>	Gross Alpha	$1 \times 10^{-7}$
			Sr-89, Sr-90	$5 \times 10^{-8}$
			Fe-55	$1 \times 10^{-6}$

TABLE 4.11.1.1.1-1 (Continued)

TABLE NOTATION

<sup>a</sup>The LLD is defined, for purposes of these controls, as the smallest concentration of radioactive material in a sample that will yield a net count, above system background, that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system, which may include radiochemical separation:

$$LLD = \frac{4.66 \cdot s_b}{E \cdot V \cdot 2.22 \times 10^6 \cdot Y \cdot \exp(-\lambda t)}$$

Where:

LLD is the "a priori" lower limit of detection as defined above, as microcuries per unit mass or volume,

$s_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate, as counts per minute,

E is the counting efficiency, as counts per disintegration,

V is the sample size in units of mass or volume,

$2.22 \times 10^6$  is the number of disintegrations per minute per microcurie,

Y is the fractional radiochemical yield, when applicable,

$\lambda$  is the radioactive decay constant for the particular radionuclide, and

t for plant effluents is the elapsed time between the midpoint of sample collection and time of counting.

Typical values of E, V, Y, and t should be used in the calculation.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement.

<sup>b</sup>A batch release is the discharge of liquid wastes of a discrete volume. Prior to sampling for analyses, each batch shall be isolated, and then thoroughly mixed by a method described in the ODCM to assure representative sampling. Batch liquid discharge may be made from only one tank at a time.

TABLE 4.11.1.1.1-1 (Continued)

TABLE NOTATION

<sup>c</sup>The principal gamma emitters for which the LLD specification applies exclusively are: Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, and Ce-141. Ce-144 shall also be measured, but with an LLD of  $5 \times 10^{-6}$ . This does not mean that only these nuclides are to be considered. Other peaks that are identifiable, together with those of the above nuclides, shall also be analyzed and reported in the Annual Radioactive Effluent Release Report pursuant to Control 5.9.1.8.

14/13

<sup>d</sup>This type of composite sample is a sample composed of aliquots of pre-release samples or grab samples taken during releases, or of aliquots of composite samples so prepared, so as to represent releases taking place over a longer period of time. The volumes of these aliquots should be proportional to the volumes of the releases which they represent.

<sup>e</sup>A continuous release is the discharge of liquid wastes of a nondiscrete volume; e.g., from a volume of a system that has an input flow during the continuous release.

<sup>f</sup>When the circulating water system is first discovered to be contaminated, grab samples may be taken more frequently, and may be analyzed immediately. After the source of the contamination is discovered and isolated, and contamination levels are not increasing, this grab sampling and analysis frequency may be reduced to the schedule specified in the table.

## RADIOACTIVE EFFLUENTS

### LIQUID EFFLUENTS DOSE

#### CONTROLS

3.11.1.2 The dose or dose commitment to a MEMBER OF THE PUBLIC from radioactive materials in liquid effluents released, from each reactor unit, to UNRESTRICTED AREAS (see Figure 3.0-1) shall be limited:

- a. During any calendar quarter to less than or equal to 1.5 mrems to the total body and to less than or equal to 5 mrems to any organ, and
- b. During any calendar year to less than or equal to 3 mrems to the total body and to less than or equal to 10 mrems to any organ.

**APPLICABILITY:** At all times.

#### **ACTION:**

- a. With the calculated dose from the release of radioactive materials in liquid effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days, pursuant to 10 CFR 50.4, a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits. This Special Report shall also include (1) the results of radiological analyses of the drinking water source and (2) the radiological impact on finished drinking water supplies with regard to the requirements of 40 CFR Part 141, Safe Drinking Water Act.\*
- b. The provisions of Controls 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.11.1.2 Cumulative dose contributions from liquid effluents for the current calendar quarter and the current calendar year shall be determined in accordance with the methodology and parameters in the ODCM at least once per 31 days, if radioactive liquid effluent releases have occurred during the period being evaluated.

14/13

\*Applicable only if drinking water supply is taken from the receiving water body within 3 miles of the plant discharge.

## RADIOACTIVE EFFLUENTS

### LIQUID WASTE TREATMENT

#### CONTROLS

3.11.1.3 The liquid radwaste treatment system shall be FUNCTIONALLY CAPABLE and appropriate portions of the system shall be used to reduce the radioactive materials in liquid wastes prior to their discharge when the projected doses due to the liquid effluent, from each reactor unit, to UNRESTRICTED AREAS (see Figure 3.0-1) would exceed 0.06 mrem to the total body or 0.2 mrem to any organ in any 31-day period.

**APPLICABILITY:** At all times.

#### **ACTION:**

- a. With radioactive liquid waste being discharged and in excess of the above limits and any portion of the liquid radwaste treatment system not in operation, prepare and submit to the Commission within 30 days, pursuant to 10 CFR 50.4, a Special Report that includes the following information:
  1. Explanation of why liquid radwaste was being discharged without complete treatment, identification of any equipment or subsystems which are not FUNCTIONALLY CAPABLE, and the reason for the not FUNCTIONALLY CAPABLE status.
  2. Action(s) taken to restore the equipment which is not FUNCTIONALLY CAPABLE to FUNCTIONALLY CAPABLE status, and
  3. Summary description of action(s) taken to prevent a recurrence.
- b. The provisions of Controls 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.11.1.3.1 Doses due to liquid releases from each reactor unit to UNRESTRICTED AREAS shall be projected at least once per 31 days in accordance with the methodology and parameters in the ODCM, if radioactive liquid effluent releases have occurred during the period being evaluated.

4.11.1.3.2 The installed liquid radwaste treatment system shall be demonstrated FUNCTIONALLY CAPABLE by meeting Controls 3.11.1.1 and 3.11.1.2.

14/13

## **RADIOACTIVE EFFLUENTS**

### **3/4.11.2 GASEOUS EFFLUENTS**

#### **DOSE RATE**

#### **CONTROLS**

---

3.11.2.1 The dose rate due to radioactive materials released in gaseous effluents from the site to areas at and beyond the SITE BOUNDARY (see Figure 3.0-1) shall be limited to the following:

- a. For noble gases: Less than or equal to 500 mrem/yr to the total body and less than or equal to 3000 mrem/yr to the skin, and
- b. For iodine-131, iodine-133, tritium, and for all radionuclides in particulate form with half-lives greater than 8 days: Less than or equal to 1500 mrem/yr to any organ.

**APPLICABILITY:** At all times.

#### **ACTION:**

With the dose rate(s) exceeding the above limits, immediately restore the release rate to within the above limit(s).

#### **SURVEILLANCE REQUIREMENTS**

---

4.11.2.1.1 The dose rate due to noble gases in gaseous effluents shall be determined to be within the above limits in accordance with the methodology and parameters in the ODCM.

4.11.2.1.2 The dose rate due to iodine-131, iodine-133, tritium, and all other radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents shall be determined to be within the above limits in accordance with the methodology and parameters in the ODCM by obtaining representative samples and performing analyses in accordance with the sampling and analysis program specified in Table 4.11.2.1.2-1.

TABLE 4.11.2.1.2-1

## RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS PROGRAM

Gaseous Release Type	Sampling Frequency	Minimum Analysis Frequency	Type of Activity Analysis	Lower Limit of Detection (LLD) <sup>a</sup> (uCi/ml)
A. Containment PURGE (Pre Treatment)	pi, sj Each PURGE Grab Sample	pi, sj Each PURGE pi	Principal Gamma Emitters <sup>b</sup> H-3	1 x 10 <sup>-4</sup> 1 x 10 <sup>-6</sup>
B. Reactor Building Exhaust Plenum Standby Gas Treatment System <sup>h</sup>	M <sup>c,e</sup> Grab Sample	M <sup>c</sup> M <sup>c</sup>	Principal Gamma Emitters <sup>b</sup> H-3	1 x 10 <sup>-4</sup> 1 x 10 <sup>-6</sup>
C. Radwaste Building Turbine Building On-Site Storage Facility	M Grab Sample	M M	Principal Gamma Emitters <sup>b</sup> H-3	1 x 10 <sup>-4</sup> 1 x 10 <sup>-6</sup>
D. All Release Types as listed in B and C above.	Continuous <sup>f</sup>	Wg Absorbent Sample	I-131 I-133	1 x 10 <sup>-12</sup> 1 x 10 <sup>-10</sup>
	Continuous <sup>f</sup>	Wg Particulate Sample	Principal Gamma Emitters <sup>b</sup> (I-131, others) Gross Alpha	1 x 10 <sup>-11</sup>
	Continuous <sup>f</sup>	Q Composite Particulate Sample	Sr-89, Sr-90, Fe-55	1 x 10 <sup>-11</sup>
	Continuous <sup>f</sup>	Noble Gas Monitor	Noble Gas Gross Beta or Gamma	1 x 10 <sup>-6</sup>
E. Offgas Vent Pipe	N.A. <sup>k</sup> Grab Sample	N.A. <sup>k</sup>	Principal Gamma Emitters <sup>b</sup>	1 x 10 <sup>-4</sup>



TABLE 4.11.2.1.2-1 (Continued)

TABLE NOTATION

<sup>a</sup>The LLD is defined, for purposes of these controls, as the smallest concentration of radioactive material in a sample that will yield a net count, above system background, that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system, which may include radiochemical separation:

$$LLD = \frac{4.66 \cdot s_b}{E \cdot V \cdot 2.22 \times 10^6 \cdot Y \cdot \exp(-\lambda t)}$$

Where:

LLD is the "a priori" lower limit of detection as defined above, as microcuries per unit mass or volume,

$s_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate, as counts per minute,

E is the counting efficiency, as counts per disintegration,

V is the sample size in units of mass or volume,

$2.22 \times 10^6$  is the number of disintegrations per minute per microcurie,

Y is the fractional radiochemical yield, when applicable,

$\lambda$  is the radioactive decay constant for the particular radionuclide, and

t for plant effluents is the elapsed time between the midpoint of sample collection and time of counting.

Typical values of E, V, Y, and t should be used in the calculation.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement.

<sup>b</sup>The principal gamma emitters for which the LLD specification applies exclusively are the following radionuclides: Kr-87, Kr-88, Xe-133, Xe-133m, Xe-135, Xe-138, Ar-41, Kr-85m, and Xe-135m in noble-gas releases and Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, I-131, Cs-134, Cs-137, Ce-141, and Ce-144 in iodine and particulate releases. This list does not mean that only these nuclides are to be considered. Other gamma peaks that are identifiable, together with those of the above nuclides, shall also be analyzed and reported in the Annual Radioactive Effluent Release Report pursuant to Control 5.9.1.8.

TABLE 4.11.2.1.2-1 (Continued)

TABLE NOTATION

<sup>c</sup>Sampling and analysis shall also be performed following shutdown, startup, or a THERMAL POWER change exceeding 15% of RATED THERMAL POWER within a 1-hour period. This requirement does not apply if the noble gas monitor shows that effluent activity has not increased more than a factor of 3.

<sup>d</sup>Not used.

<sup>e</sup>Tritium grab samples shall be taken at least once per 7 days from the ventilation exhaust from the spent fuel pool area, whenever spent fuel is in the spent fuel pool.

<sup>f</sup>The ratio of the sample flow rate to the sampled stream flow rate shall be known for the time period covered by each dose or dose rate calculation made in accordance with Controls 3.11.2.1, 3.11.2.2, and 3.11.2.3.

<sup>g</sup>Samples shall be changed at least once per 7 days and analyses shall be completed within 48 hours after changing, or after removal from sampler. Sampling shall also be performed at least once per 24 hours for at least 3 days following each shutdown, startup or THERMAL POWER change exceeding 15% of RATED THERMAL POWER in 1 hour, and analyses shall be completed within 48 hours of changing, at any release point at which the noble gas monitor shows that effluent activity has increased more than a factor of 3.

When samples collected for 24 hours are analyzed, the corresponding LLDs may be increased by a factor of 10. When samples collected for periods between 24 hours and 7 days are analyzed, the corresponding LLDs may be increased by a factor equal to the normal weekly sample volume divided by the volume of the sample in question.

<sup>h</sup>Required when the SGTS is in operation.

<sup>i</sup>In MODES 1, 2, 3, and 4, the applicable portion of primary containment shall be sampled and analyzed within 8 hours prior to the start of any PURGING.

<sup>j</sup>In MODES 1, 2, 3, and 4, when the primary containment atmosphere radiation monitoring system is declared not FUNCTIONALLY CAPABLE or is in alarm condition, the applicable portion of primary containment shall be sampled and analyzed within 8 hours prior to the start of any VENTING or PURGING and at least once per 12 hours during VENTING or PURGING through other than SGTS.

<sup>k</sup>Offgas Vent Pipe sampling is performed as directed by Radiation Protection to supplement Reactor Building Exhaust Plenum monthly grab sampling. The Offgas Vent Pipe sample point is upstream of the Reactor Building Exhaust Plenum.

**TABLE 4.11.2.1.2-1 (Continued)**

**TABLE NOTATION**

I In MODES 1, 2, 3, and 4, the applicable portion of primary containment shall be sampled and analyzed within 8 hours prior to the start of any PURGING.

J In MODES 1, 2, 3, and 4, when the primary containment atmosphere radiation monitoring system is declared not FUNCTIONALLY CAPABLE or is in alarm condition, the applicable portion of primary containment shall be sampled and analyzed within 8 hours prior to the start of any VENTING or PURGING and at least once per 12 hours during VENTING or PURGING through other than SGTS.

## RADIOACTIVE EFFLUENTS

### GASEOUS EFFLUENTS DOSE - NOBLE GASES

#### CONTROLS

3.11.2.2 The air dose due to noble gases released in gaseous effluents, from each reactor unit, to areas at and beyond the SITE BOUNDARY (see Figure 3.0-1) shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 5 mrad for gamma radiation and less than or equal to 10 mrad for beta radiation and,
- b. During any calendar year: Less than or equal to 10 mrad for gamma radiation and less than or equal to 20 mrad for beta radiation.

**APPLICABILITY:** At all times.

#### **ACTION:**

With the calculated air dose from radioactive noble gases in gaseous effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days, pursuant to 10 CFR 50.4, a Special Report that identifies the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits.

- b. The provisions of Controls 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.11.2.2 Cumulative dose contributions for the current calendar quarter and current calendar year for noble gases shall be determined in accordance with the methodology and parameters in the ODCM at least once per 31 days.

## **RADIOACTIVE EFFLUENTS**

### **GASEOUS EFFLUENTS**

#### **DOSE - IODINE-131, IODINE-133, TRITIUM, AND RADIONUCLIDES IN PARTICULATE FORM**

#### **CONTROLS**

---

3.11.2.3 The dose to a MEMBER OF THE PUBLIC from iodine-131, iodine-133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents released, from each reactor unit, to areas at and beyond the SITE BOUNDARY (see Figure 3.0-1) shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 7.5 mrem to any organ and,
- b. During any calendar year: Less than or equal to 15 mrem to any organ.

**APPLICABILITY:** At all times.

#### **ACTION:**

- a. With the calculated dose from the release of iodine-131, iodine-133, tritium, and radionuclides in particulate form with half-lives greater than 8 days, in gaseous effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days, pursuant to 10 CFR 50.4, a Special Report that identifies the cause(s) for exceeding the limit and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits.
- b. The provisions of Controls 3.0.3 and 3.0.4 are not applicable.

#### **SURVEILLANCE REQUIREMENTS**

---

4.11.2.3 Cumulative dose contributions for the current calendar quarter and current calendar year for iodine-131, iodine-133, tritium, and radionuclides in particulate form with half-lives greater than 8 days shall be determined in accordance with the methodology and parameters in the ODCM at least once per 31 days.

## RADIOACTIVE EFFLUENTS

### OFF-GAS TREATMENT SYSTEM

#### CONTROLS

3.11.2.4 The OFF-GAS TREATMENT SYSTEM shall be FUNCTIONALLY CAPABLE and shall be in operation.

**APPLICABILITY:** Whenever the main condenser steam jet air ejectors are in operation.

#### **ACTION:**

With the OFF-GAS TREATMENT SYSTEM not FUNCTIONALLY CAPABLE for more than 7 days, prepare and submit to the commission within 30 days, pursuant to 10 CFR 50.4, a Special Report that includes the following information:

1. Identification of the equipment or subsystems which are not FUNCTIONALLY CAPABLE and the reason for the not FUNCTIONALLY CAPABLE status,
  2. Action(s) taken to restore the equipment which is not FUNCTIONALLY CAPABLE to FUNCTIONALLY CAPABLE status, and
  3. Summary description of action(s) taken to prevent a recurrence.
- b. The provisions of Controls 3.0.3 and 3.0.4 are not applicable.
- c. The provisions of Control 4.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.11.2.4 The OFF-GAS TREATMENT SYSTEM shall be demonstrated FUNCTIONALLY CAPABLE by meeting Controls 3.11.2.1, 3.11.2.2, and 3.11.2.3.

## RADIOACTIVE EFFLUENTS

### VENTILATION EXHAUST TREATMENT SYSTEM

#### CONTROLS

3.11.2.5 The VENTILATION EXHAUST TREATMENT SYSTEM as described in the ODCM shall be FUNCTIONALLY CAPABLE and appropriate portions of the system shall be used to reduce radioactive materials in gaseous waste prior to their discharge when the projected doses due to gaseous effluent releases from the site to UNRESTRICTED AREAS (see Figure 3.0-1) would exceed 0.3 mrem to any organ in any 31-day period.

APPLICABILITY: At all times.

#### ACTION:

With radioactive gaseous waste being discharged in excess of the above limits and any portion of the VENTILATION EXHAUST TREATMENT SYSTEM not in operation, prepare and submit to the Commission within 30 days, pursuant to 10 CFR 50.4, a Special Report that includes the following information:

1. Identification of any equipment or subsystems which are not FUNCTIONALLY CAPABLE and the reason for the not FUNCTIONALLY CAPABLE status.
2. Action(s) taken to restore the equipment which is not FUNCTIONALLY CAPABLE to FUNCTIONALLY CAPABLE status, and
3. Summary description of action(s) taken to prevent a recurrence.

b. The provisions of Controls 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.11.2.5.1 Doses due to gaseous releases from the site shall be projected at least once per 31 days in accordance with the methodology and parameters in the ODCM, when any portion of the VENTILATION EXHAUST TREATMENT SYSTEM is not in use.

4.11.2.5.2 The VENTILATION EXHAUST TREATMENT SYSTEM shall be demonstrated FUNCTIONALLY CAPABLE by meeting Controls 3.11.2.1, 3.11.2.2, and 3.11.2.3.

## **RADIOACTIVE EFFLUENTS**

### **VENTING OR PURGING**

#### **CONTROLS**

---

3.11.2.8 VENTING or PURGING of the primary containment shall be through the standby gas treatment system or the reactor building ventilation system.

**APPLICABILITY:** MODES 1, 2, 3, and 4

**ACTION:**

- a. With the requirements of the above control not satisfied, suspend all VENTING or PURGING of the primary containment.
- b. The provision of Controls 3.0.3 and 3.0.4 are not applicable.

#### **SURVEILLANCE REQUIREMENTS**

---

4.11.2.8.1 The applicable portion of primary containment shall be sampled and analyzed per Table 4.11.2.1.2-1 of Control 3.11.2.1 within 8 hours prior to the start of any PURGING.

4.11.2.8.2 If the primary containment radiation monitoring system is not FUNCTIONALLY CAPABLE or is in alarm condition, the applicable portion of primary containment shall be sampled and analyzed per Table 4.11.2.1.2-1 of Control 3.11.2.1 within 8 hours prior to the start of and at least once per 12 hours during VENTING or PURGING of primary containment through other than the standby gas treatment system.

4.11.2.8.3 The primary containment shall be determined to be aligned for VENTING or PURGING through the standby gas treatment system or the reactor building ventilation system within 4 hours prior to start of and at least once per 12 hours during VENTING or PURGING of the containment.

4.11.2.8.4 Prior to use of the vent/purge system through the standby gas treatment system assure that:

- a. Both standby gas treatment system trains are FUNCTIONALLY CAPABLE whenever the vent/purge system is in use, and
- b. Whenever the vent/purge system is in use during MODE 1 or 2 or 3, only one of the standby gas treatment system trains may be used.

4.11.2.8.5 Prior to VENTING or PURGING, assure that at least one of the following monitors is FUNCTIONALLY CAPABLE: the primary containment atmosphere radiation monitor, the reactor building ventilation exhaust radiation monitor (at least one division), or the SPING monitor corresponding to the release path (the reactor building exhaust plenum radiation monitor or the standby gas treatment system radiation monitor, Division 1 or 2).



## RADIOACTIVE EFFLUENTS

### 3/4.11.4 TOTAL DOSE

#### CONTROLS

3.11.4 The annual (calendar year) dose or dose commitment to any member of the public (as defined in 40 CFR Part 190) due to releases of radioactivity and to radiation from uranium fuel cycle sources shall be limited to less than or equal to 25 mrems to the total body or any organ, except the thyroid, which shall be limited to less than or equal to 75 mrems.

**APPLICABILITY:** At all times.

**ACTION:**

- a. With the calculated doses from the release of radioactive materials in liquid or gaseous effluents exceeding twice the limits of Controls 3.11.1.2a., 3.11.1.2b., 3.11.2.2a., 3.11.2.2b., 3.11.2.3a., or 3.11.2.3b., calculations should be made including direct radiation contributions from the reactor units and from outside storage tanks to determine whether the above limits of Control 3.11.4 have been exceeded. If such is the case, prepare and submit to the Commission within 30 days, pursuant to 10 CFR 50.4, a Special Report that defines the corrective action to be taken to reduce subsequent releases to prevent recurrence of exceeding the above limits and includes the schedule for achieving conformance with the above limits. This Special Report, as defined in 10 CFR 20.2203, shall include an analysis that estimates the radiation exposure (dose) to a member of the public from uranium fuel cycle sources, including all effluent pathways and direct radiation, for the calendar year that includes the release(s) covered by this report. It shall also describe levels of radiation and concentrations of radioactive material involved, and the cause of the exposure levels or concentrations. If the estimated dose(s) exceeds the above limits, and if the release condition resulting in violation of 40 CFR Part 190 has not already been corrected, the Special Report shall include a request for a variance in accordance with the provisions of 40 CFR Part 190. Submittal of the report is considered a timely request, and a variance is granted until staff action on the request is complete.
- b. The provisions of Controls 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.11.4.1 Cumulative dose contributions from liquid and gaseous effluents shall be determined in accordance with Controls 4.11.1.2, 4.11.2.2, and 4.11.2.3, and in accordance with the methodology and parameters in the ODCM.

4.11.4.2 Cumulative dose contributions from direct radiation from the reactor units and from outside storage tanks shall be determined in accordance with the methodology and parameters in the ODCM. This requirement is applicable only under conditions set forth in Control 3.11.4, ACTION a.

Note: Page content was last changed with ODCM Revision 16.

## 3/4.12 RADIOLOGICAL ENVIRONMENTAL MONITORING

### 3/4.12.1 MONITORING PROGRAM

#### CONTROLS

---

3.12.1 The radiological environmental monitoring program shall be conducted as specified in Table 3.12.1-1.

**APPLICABILITY:** At all times.

**ACTION:**

- a. With the radiological environmental monitoring program not being conducted as specified in Table 3.12.1-1, prepare and submit to the Commission, in the Annual Radiological Environmental Operating Report required by Control 5.9.1.7, a description of the reasons for not conducting the program as required and the plans for preventing a recurrence.

With the level of radioactivity as the result of plant effluents in an environmental sampling medium at a specified location exceeding the reporting levels of Table 3.12.1-2 when averaged over any calendar quarter, prepare and submit to the Commission within 30 days, pursuant to 10 CFR 50.4, a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions to be taken to reduce radioactive effluents so that the potential annual dose\* to A MEMBER OF THE PUBLIC is less than the calendar year limits of Controls 3.11.1.2, 3.11.2.2, and 3.11.2.3. When more than one of the radionuclides in Table 3.12.1-2 are detected in the sampling medium, this report shall be submitted if:

$$\frac{\text{concentration (1)}}{\text{reporting level (1)}} + \frac{\text{concentration (2)}}{\text{reporting level (2)}} + \dots \geq 1.0$$

- b. When radionuclides other than those in Table 3.12.1-2 are detected and are the result of plant effluents, this report shall be submitted if the potential annual dose\* to A MEMBER OF THE PUBLIC from all radionuclides is equal to or greater than the calendar year limits of Controls 3.11.1.2, 3.11.2.2, and 3.11.2.3. This report is not required if the measured level of radioactivity was not the result of plant effluents; however, in such an event, the condition shall be reported and described in the Annual Radiological Environmental Operating Report pursuant to Control 5.9.1.7.

---

\*The methodology used to estimate the potential annual dose to a MEMBER OF THE PUBLIC shall be indicated in this report.

Note: Page content was last changed with ODCM Revision 16.

## **RADIOLOGICAL ENVIRONMENTAL MONITORING**

### **CONTROLS (Continued)**

---

- c. With milk or fresh leafy vegetable samples unavailable from one or more of the sample locations required by Table 3.12.1-1, identify specific locations for obtaining replacement samples and add them to the radiological environmental monitoring program within 30 days. The specific locations from which samples were unavailable may then be deleted from the monitoring program. Pursuant to Control 5.9.1.8, identify the cause of the unavailability of samples and identify the new location(s) for obtaining replacement samples in the next Annual Radioactive Effluent Release Report pursuant to Control 5.9.1.8 and also include in the report a revised table for the ODCM reflecting the new location(s).
  
- d. The provisions of Controls 3.0.3 and 3.0.4 are not applicable.

### **SURVEILLANCE REQUIREMENTS**

---

4.12.1 The radiological environmental monitoring samples shall be collected pursuant to Table 3.12.1-1 from the specific locations given in the table in the ODCM, and shall be analyzed pursuant to the requirements of Table 3.12.1-1 and the detection capabilities required by Table 4.12.1-1.

TABLE 3.12.1-1

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

Exposure Pathway and/or Sample	Number of Representative Samples and Sample Locations <sup>a</sup>	Sampling and Collection Frequency	Type and Frequency of Analysis
1. DIRECT RADIATION <sup>b</sup>	67 routine monitoring stations, with two or more dosimeters placed as follows: 1) an inner ring of stations in the general area of the SITE BOUNDARY and additional rings at approximately 2, 5, and 10 miles, with a station in at least every other meteorological sector for each ring with the exception of those sectors over Lake Erie. The balance of the stations, 8, should be placed in special interest areas such as population centers, nearby residences, schools, and in 2 or 3 areas to serve as control stations.	Quarterly	Gamma dose quarterly.
2. AIRBORNE Radioiodine and Particulates	<p>Samples from 5 locations.</p> <p>a. 3 samples from close to the 3 SITE BOUNDARY locations, in different sectors, of the highest calculated annual average ground level X/Q.</p> <p>b. 1 sample from the vicinity of a community having the highest calculated annual average ground level X/Q.</p> <p>c. 1 sample from a control location, as for example 15-30 km distant and in the least prevalent wind direction<sup>c</sup>.</p>	Continuous sampler operation with sample collection weekly, or more frequently if required by dust loading.	<p><u>Radioiodine Canister:</u> I-131 analysis weekly.</p> <p><u>Particulate Sampler:</u> Gross beta radioactivity analysis following filter change:<sup>d</sup></p> <p>Gamma isotopic analysis<sup>e</sup> of composite (by location) quarterly.</p>

Note: Page content was last changed with ODCM Revision 15.

TABLE 3.12.1-1 (Continued)

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

<i>Exposure Pathway and/or Sample</i>	<i>Number of Representative Samples and Sample Locations<sup>a</sup></i>	<i>Sampling and Collection Frequency</i>	<i>Type and Frequency of Analysis</i>
<p>3. WATERBORNE</p> <p>a. Surface<sup>f</sup></p> <p>b. Ground</p> <p>c. Drinking</p> <p>d. Sediment from shoreline</p>	<p>a. 1 sample upstream. b. 1 sample downstream.</p> <p>Samples from 1 or 2 sources only if likely to be affected<sup>h</sup>.</p> <p>a. 1 sample of each of 1 to 3 of the nearest water supplies that could be affected by its discharge. b. 1 sample from a control location.</p> <p>1 sample from downstream area with existing or potential recreational value.</p>	<p>Composite sample over 1-month period<sup>g</sup></p> <p>Quarterly</p> <p>Composite sample over 2-week period<sup>g</sup> when I-131 analysis is performed, monthly composite otherwise.</p> <p>Semiannually</p>	<p>Gamma isotopic analysis<sup>e</sup> monthly. Composite for tritium analysis quarterly.</p> <p>Gamma isotopic<sup>e</sup> and tritium analysis quarterly.</p> <p>I-131 analysis on each composite when the dose calculated for the consumption of the water is greater than 1 mrem per year.<sup>i</sup> Composite for gross beta and gamma isotopic analyses<sup>e</sup> monthly. Composite for tritium analysis quarterly.</p> <p>Gamma isotopic analysis<sup>e</sup> semiannually.</p>



**TABLE 3.12.1-1 (Continued)**

**TABLE NOTATIONS**

<sup>a</sup>Specific parameters of distance and direction sector from the centerline of one reactor, and additional description where pertinent, shall be provided for each and every sample location in Table 3.12.1-1 in a table in the ODCM. Refer to NUREG-0133, "Preparation of Radiological Effluent Technical Specifications for Nuclear Power Plants," October 1978, and to Radiological Assessment Branch Technical Position, Revision 1, November 1979. Deviations are permitted from the required sampling schedule if specimens are unobtainable due to hazardous conditions, seasonal unavailability, malfunction of automatic sampling equipment and other legitimate reasons. If specimens are unobtainable due to sampling equipment malfunction, every effort shall be made to complete corrective action prior to the end of the next sampling period. All deviations from the sampling schedule shall be documented in the Annual Radiological Environmental Operating Report pursuant to Control 5.9.1.7. It is recognized that, at times, it may not be possible or practicable to continue to obtain samples of the media of choice at the most desired location or time. In these instances suitable specific alternative media and locations may be chosen for the particular pathway in question and appropriate substitutions made within 30 days in the radiological environmental monitoring program. Pursuant to Control 5.9.1.8, identify the cause of the unavailability of samples for that pathway and identify the new location(s) for obtaining replacement samples in the next Annual Radioactive Effluent Release Report and also include in the report a revised table for the ODCM reflecting the new location(s).

<sup>b</sup>One or more instruments, such as a pressurized ion chamber, for measuring and recording dose rate continuously may be used in place of, or in addition to, integrating dosimeters. For the purpose of this table, a thermoluminescent dosimeter (TLD) is considered to be one phosphor; two or more phosphors in a packet are considered as two or more dosimeters. Film badges shall not be used as dosimeters for measuring direct radiation. The frequency of analysis or readout for TLD systems will depend upon the characteristics of the specific system used and should be selected to obtain optimum dose information with minimal fading.

<sup>c</sup>The purpose of this sample is to obtain background information. If it is not practical to establish control locations in accordance with the distance and wind direction criteria, other sites that have valid background data may be substituted.

<sup>d</sup>Airborne particulate sample filters shall be analyzed for gross beta radioactivity 24 hours or more after sampling to allow for radon and thoron daughter decay. If gross beta activity in air particulate samples is greater than 10 times the yearly mean of control samples, gamma isotopic analysis shall be performed on the individual samples.

<sup>e</sup>Gamma isotopic analysis means the identification and quantification of gamma-emitting radionuclides that may be attributable to the effluents from the facility.

**TABLE 3.12.1-1 (Continued)**

**TABLE NOTATION**

<sup>f</sup>The "upstream sample" shall be taken at a distance beyond significant influence of the discharge. The "downstream" sample shall be taken in an area beyond but near the mixing zone. "Upstream" samples in an estuary must be taken far enough upstream to be beyond the plant influence.

<sup>g</sup>Composite samples should be collected with equipment (or equivalent) which is capable of collecting an aliquot at time intervals that are very short (e.g., hourly) relative to the compositing period (e.g., monthly).

<sup>h</sup>Groundwater samples shall be taken when this source is tapped for drinking or irrigation purposes in areas where the hydraulic gradient or recharge properties are suitable for contamination.

<sup>i</sup>The dose shall be calculated for the maximum organ and age group, using the methodology and parameters in the ODCM.

<sup>j</sup>If harvest occurs more than once a year, sampling shall be performed during each discrete harvest. If harvest occurs continuously, sampling shall be monthly. Attention shall be paid to including samples of tuberous and root food products.



TABLE 3.12.1-2

REPORTING LEVELS FOR RADIOACTIVITY  
CONCENTRATIONS IN ENVIRONMENTAL SAMPLES

Reporting Levels

<i>Analysis</i>	<i>Water (pCi/l)</i>	<i>Airborne Particulate or Gases (pCi/m<sup>3</sup>)</i>	<i>Fish (pCi/kg, wet)</i>	<i>Milk (pCi/l)</i>	<i>Food Products (pCi/kg, wet)</i>
H-3	20,000*				
Mn-54	1,000		30,000		
Fe-59	400		10,000		
Co-58	1,000		30,000		
Co-60	300		10,000		
Zn-65	300		20,000		
Zr-Nb-95	400				
I-131	2	0.9		3	100
Cs-134	30	10	1,000	60	1,000
Cs-137	50	20	2,000	70	2,000
Ba-La-140	200			300	

\* For drinking water samples. This is 40 CFR Part 141 value.

TABLE 4.12.1-1

DETECTION CAPABILITIES FOR ENVIRONMENTAL SAMPLE ANALYSIS <sup>a</sup>

LOWER LIMIT OF DETECTION (LLD)<sup>b,c</sup>

<i>Analysis</i>	<i>Water (pCi/l)</i>	<i>Airborne Particulate or Gases (pCi/m<sup>3</sup>)</i>	<i>Fish (pCi/kg, wet)</i>	<i>Milk (pCi/l)</i>	<i>Food Products (pCi/kg, wet)</i>	<i>Sediment (pCi/kg, dry)</i>
gross beta	4	0.01				
H-3	2000					
Mn-54	15		130			
Fe-59	30		260			
Co-58,60	15		130			
Zn-65	30		260			
Zr-Nb-95	15					
I-131	1 <sup>d</sup>	0.07		1	60	
Cs-134	15	0.05	130	15	60	150
Cs-137	18	0.06	150	18	80	180
Ba-La-140	15			15		

**TABLE 4.12.1-1 (Continued)**

**TABLE NOTATIONS**

<sup>a</sup>This list does not mean that only these nuclides are to be considered. Other peaks that are identifiable, together with those of the above nuclides, shall also be analyzed and reported in the Annual Radiological Environmental Operating Report pursuant to Control 5.9.1.7.

<sup>b</sup>Required detection capabilities for thermoluminescent dosimeters used for environmental measurements are given in Regulatory Guide 4.13.

<sup>c</sup>The LLD is defined, for purposes of these Controls, as the smallest concentration of radioactive material in a sample that will yield a net count, above system background, that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system, which may include radiochemical separation:

$$LLD = \frac{4.66 \cdot s_b}{E \cdot V \cdot 2.22 \cdot Y \cdot \exp(-\lambda t)}$$

Where:

LLD is the "a priori" lower limit of detection as defined above, as picocuries per unit mass or volume,

$s_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate, as counts per minute,

E is the counting efficiency, as counts per disintegration,

V is the sample size in units of mass or volume,

2.22 is the number of disintegrations per minute per picocurie,

Y is the fractional radiochemical yield, when applicable,

$\lambda$  is the radioactive decay constant for the particular radionuclide, and

t for environmental samples is the elapsed time between sample collection, or end of the sample collection period, and time of counting

Typical values of E, V, Y, and t should be used in the calculation.

**TABLE 4.12.1-1 (Continued)**

**TABLE NOTATIONS**

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement. Analyses shall be performed in such a manner that the stated LLDs will be achieved under routine conditions. Occasionally background fluctuations, unavoidable small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLDs unachievable. In such cases, the contributing factors shall be identified and described in the Annual Radiological Environmental Operating Report pursuant to Control 5.9.1.7.

<sup>d</sup>LLD for drinking water samples.

## RADIOLOGICAL ENVIRONMENTAL MONITORING

### 3/4.12.2 LAND USE CENSUS

#### CONTROLS

---

3.12.2 A land use census shall be conducted and shall identify within a distance of 8 km (5 miles) the location in each of the 16 meteorological sectors of the nearest milk animal, the nearest meat animal, the nearest residence and the nearest garden\* of greater than 50 m<sup>2</sup> (500 ft<sup>2</sup>) producing broad leaf vegetation.

**APPLICABILITY:** At all times.

#### ACTION:

- a. With a land use census identifying a location(s) that yields a calculated dose or dose commitment greater than the values currently being calculated in Surveillance Requirement 4.11.2.3, identify the new location(s) in the next Annual Radioactive Effluent Release Report, pursuant to Control 5.9.1.8.
- b. With a land use census identifying a location(s) that yields a calculated dose or dose commitment (via the same exposure pathway) 20% greater than at a location from which samples are currently being obtained in accordance with Control 3.12.1, add the new location(s) to the radiological environmental monitoring program within 30 days. The sampling location(s), excluding the control station location, having the lowest calculated dose or dose commitment(s), via the same exposure pathway, may be deleted from this monitoring program after October 31 of the year in which this land use census was conducted. Pursuant to Control 5.9.1.8, identify the new location(s) in the next Annual Radioactive Effluent Release Report and also include in the report a revised table for the ODCM reflecting the new location(s).
- c. The provisions of Control 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

---

4.12.2 The land use census shall be conducted during the growing season at least once per 12 months using that information that will provide the best results, such as by a door-to-door survey, visual survey, aerial survey, or by consulting local agriculture authorities. The results of the land use census shall be included in the Annual Radiological Environmental Operating Report pursuant to Control 5.9.1.7.

\*Broad leaf vegetation sampling of at least three different kinds of vegetation may be performed at the SITE BOUNDARY in each of two different direction sectors with the highest predicted D/Qs in lieu of the garden census. Controls for broad leaf vegetation sampling in Table 3.12.1-1, Part 4.c, shall be followed, including analysis of control samples.

## **RADIOLOGICAL ENVIRONMENTAL MONITORING**

### **3/4.12.3 INTERLABORATORY COMPARISON PROGRAM**

#### **CONTROLS**

---

3.12.3 Analyses shall be performed on radioactive materials supplied as part of an Interlaboratory Comparison Program which is audited periodically by Fermi 2 Quality Assurance.

**APPLICABILITY:** At all times.

**ACTION:**


- a. With analyses not being performed as required above, report the corrective actions taken to prevent a recurrence to the Commission in the Annual Radiological Environmental Operating Report pursuant to Control 5.9.1.7.
- b. The provisions of Controls 3.0.3 and 3.0.4 are not applicable.

#### **SURVEILLANCE REQUIREMENTS**

---

4.12.3 The Interlaboratory Comparison Program shall be described in the ODCM. A summary of the results obtained as part of the above required Interlaboratory Comparison Program shall be included in the Annual Radiological Environmental Operating Report pursuant to Control 5.9.1.7.

Figure 3.0-1: Map Defining Unrestricted Areas and Site Boundary for Radioactive Gaseous and Liquid Effluents

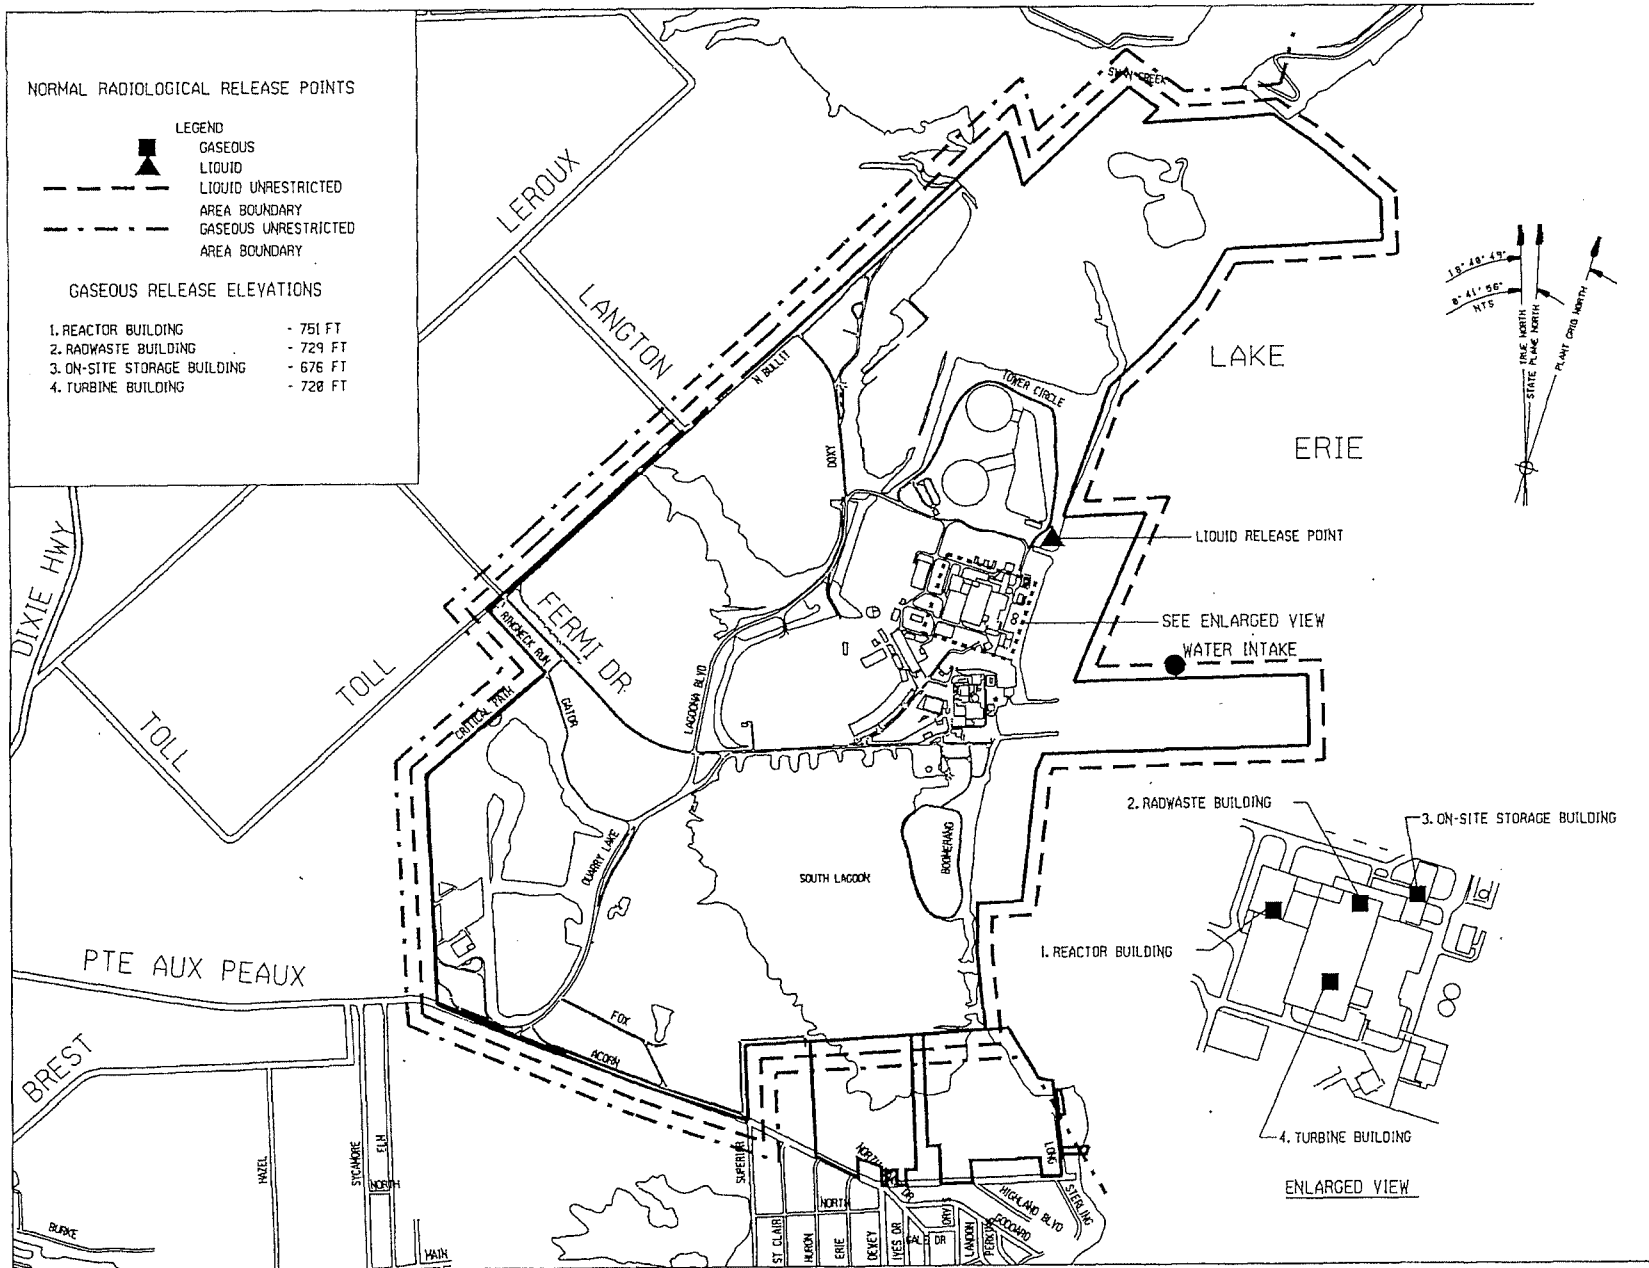

## **SECTION 4.0**

### **BASES**



## INSTRUMENTATION

### BASES

---

#### 3/4.3.7.11 RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION

The radioactive liquid effluent monitoring instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in liquid effluents during actual or potential releases of liquid effluents. The alarm/trip setpoints for these instruments shall be calculated and adjusted in accordance with the methodology and parameters in the ODCM to ensure that the alarm/trip will occur prior to exceeding the limits of 10 CFR Part 20. The FUNCTIONAL CAPABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63, and 64 of Appendix A to 10 CFR Part 50.

#### 3/4.3.7.12 RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

The radioactive gaseous effluent monitoring instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in gaseous effluents during actual or potential releases of gaseous effluents. The alarm/trip setpoints for these instruments shall be calculated and adjusted in accordance with the methodology and parameters in the ODCM utilizing the system design flow rates as specified in the ODCM. This conservative method is used because the Fermi 2 design does not include flow rate measurement devices. This will ensure the alarm/trip will occur prior to exceeding the limits of 10 CFR Part 20. The FUNCTIONAL CAPABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63, and 64 of Appendix A to 10 CFR Part 50.

#### 3/4.11.1 LIQUID EFFLUENTS

##### 3/4.11.1.1 CONCENTRATION

This control is provided to ensure that the concentration of radioactive materials released in liquid waste effluents to UNRESTRICTED AREAS will be less than ten times the concentration levels specified in 10 CFR Part 20, Appendix B, Table 2, Column 2. This limitation provides additional assurance that the levels of radioactive materials in bodies of water in UNRESTRICTED AREAS will result in exposures within (1) the Section II.A design objectives of Appendix I, 10 CFR Part 50, to a MEMBER OF THE PUBLIC and (2) the limits of 10 CFR Part 20.1301 to a MEMBER OF THE PUBLIC. The concentration limit for dissolved or entrained noble gases is based upon the assumption that Xe-135 is the controlling radioisotope and its MPC in air (submersion) was converted to an equivalent concentration in water using the methods described in International Commission on Radiological Protection (ICRP) Publication 2.

The required detection capabilities for radioactive materials in liquid waste samples are tabulated in terms of the lower limits of detection (LLDs). Detailed discussion of the LLD, and other detection limits can be found in HASL Procedure Manual, HASL-300 (revised annually), Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry," Anal. Chem. 40, 586-93 (1968), and Hartwell, J. K., "Detection Limits for Radioanalytical Counting Techniques," Atlantic Richfield Hanford Company Report ARH-SA-215 (June 1975).

## RADIOACTIVE EFFLUENTS

### BASES

---

#### 3/4.11.1.2 DOSE

This control is provided to implement the requirements of Sections II.A, III.A, and IV.A of Appendix I, 10 CFR Part 50. The control implements the guides set forth in Section II.A of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in liquid effluents to UNRESTRICTED AREAS will be kept "as low as is reasonably achievable." Also, for fresh water sites with drinking water supplies that can be potentially affected by plant operations, there is reasonable assurance that the operation of the facility will not result in radionuclide concentrations in the finished drinking water that are in excess of the requirements of 40 CFR Part 141. The dose calculation methodology and parameters in the ODCM implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The equations specified in the ODCM for calculating the doses due to the actual release rates of radioactive materials in liquid effluents are consistent with the methodology provided in NUREG-0133, Preparation of Radiological Effluent Technical Specifications for Nuclear Power Plants, Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.113, "Estimating Aquatic Dispersion of Effluents from Accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I," April 1977.

| 4/13

#### 3/4.11.1.3 LIQUID RADWASTE TREATMENT SYSTEM

The FUNCTIONAL CAPABILITY of the liquid radwaste treatment system ensures that this system will be available for use whenever liquid effluents require treatment prior to their release to the environment. The requirement that the appropriate portions of this system be used, when specified, provides assurance that the releases of radioactive materials in liquid effluents will be kept "as low as is reasonably achievable". This specification implements the requirements of General Design Criterion 60 of Appendix A to 10 CFR Part 50 and the design objective given in Section II.D of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the liquid radwaste treatment system were specified as a suitable fraction of the dose design objectives set forth in Section II.A of Appendix I, 10 CFR Part 50, for liquid effluents.

#### 3/4.11.2 GASEOUS EFFLUENTS

##### 3/4.11.2.1 DOSE RATE

This control is provided to provide reasonable assurance that radioactive material discharged in gaseous effluents will not result in exposure of a MEMBER OF THE PUBLIC in excess of the design objectives of Appendix I to 10 CFR part 50.

| 4/13

## RADIOACTIVE EFFLUENTS

### BASES

---

#### 3/4.11.2.1 DOSE RATE (Continued)

Although this control applies to the SITE BOUNDARY, the occupancy and exposure pathways applicable to a MEMBER OF THE PUBLIC who may at times be within the SITE BOUNDARY will usually be such that such an individual will not receive significantly greater dose due to gaseous effluents than a MEMBER OF THE PUBLIC who remains outside the SITE BOUNDARY. Examples of calculations for such MEMBERS OF THE PUBLIC, with the appropriate occupancy factors, shall be given in the ODCM. The specified dose rate limits restrict, at all times, the dose rates above background to a MEMBER OF THE PUBLIC at or beyond the SITE BOUNDARY to less than or equal to 500 mrems/year to the total body or to less than or equal to 3000 mrems/year to the skin. These dose rate limits also restrict, at all times, the thyroid dose rates above background to a child via the inhalation pathway to less than or equal to 1500 mrems/year.

The required detection capabilities for radioactive materials in gaseous waste samples are tabulated in terms of the lower limits of detection (LLDs). Detailed discussion of the LLD, and other detection limits can be found in HASL Procedures Manual, HASL-300 (revised annually), Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry," Anal. Chem. 40, 586-93 (1968), and Hartwell, J. K., "Detection Limits for Radioanalytical Counting Techniques," Atlantic Richfield Hanford Company Report ARH-SA-215 (June 1975).

#### 3/4.11.2.2 DOSE - NOBLE GASES

This control is provided to implement the requirements of Sections II.B, III.A, and IV.A of Appendix I, 10 CFR Part 50. The control implements the guides set forth in Section II.B of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in gaseous effluents to UNRESTRICTED AREAS will be kept "as low as is reasonably achievable." The Surveillance Requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data such that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The dose calculation methodology and parameters established in the ODCM for calculating the doses due to the actual release rates of radioactive noble gases in gaseous effluents are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water Cooled Reactors," Revision 1, July 1977. The ODCM equations provided for determining the air doses at and beyond the SITE BOUNDARY are based upon the historical average atmospheric conditions.

## RADIOACTIVE EFFLUENTS

### BASES

---

#### 3/4.11.2.3 DOSE - IODINE-131, IODINE-133, TRITIUM, AND RADIONUCLIDES IN PARTICULATE FORM

This control is provided to implement the requirements of Sections II.C, III.A, and IV.A of Appendix I, 10 CFR Part 50. The controls are the guides set forth in Section II.C of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive materials in gaseous effluents to UNRESTRICTED AREAS will be kept "as low as is reasonably achievable." The ODCM calculational methods specified in the Surveillance Requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The ODCM calculational methodology and parameters for calculating the doses due to the actual release rates of the subject materials are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors," Revision 1, July 1977. These equations also provide for determining the actual doses based upon the historical average atmospheric conditions. The release rate controls for iodine-131, iodine-133, tritium, and radionuclides in particulate form with half lives greater than 8 days are dependent upon the existing radionuclide pathways to man, in the areas at and beyond the SITE BOUNDARY. The pathways that were examined in the development of these calculations were: (1) individual inhalation of airborne radionuclides, (2) deposition of radionuclides onto green leafy vegetation with subsequent consumption by man, (3) deposition onto grassy areas where milk animals and meat producing animals graze with consumption of the milk and meat by man, and (4) deposition on the ground with subsequent exposure of man.

#### 3/4.11.2.4 OFF-GAS TREATMENT SYSTEM

The FUNCTIONAL CAPABILITY of the OFF-GAS TREATMENT SYSTEM ensures that the system will be available for use whenever gaseous effluents require treatment prior to release to the environment. The requirement that the appropriate portions of these systems be used, when specified, provides reasonable assurance that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable." This control implements the requirements of General Design Criteria 60 of Appendix A to 10 CFR Part 50, and the design objectives given in Section II.D of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the systems were specified as a suitable fraction of the dose design objectives set forth in Sections II.B and II.C of Appendix I, 10 CFR Part 50, for gaseous effluents.

## RADIOACTIVE EFFLUENTS

### BASES

---

#### 3/4.11.2.5 VENTILATION EXHAUST TREATMENT SYSTEM

The requirement that the appropriate portions of this system be used, when specified, provides reasonable assurance that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable." The specified limits governing the use of appropriate portions of the systems were specified as a suitable fraction of the dose design objectives set forth in Sections II.B and II.C of Appendix I, 10 CFR Part 50, for gaseous effluents.

#### 3/4.11.2.8 VENTING OR PURGING

This control provides reasonable assurance that releases from primary containment purging operations will not exceed the annual dose limits of 10 CFR Part 20 for UNRESTRICTED AREAS.

#### 3/4.11.4 TOTAL DOSE

This control is provided to meet the dose limitations of 40 CFR Part 190 that have been incorporated into 10 CFR Part 20 by 46 FR 18525. The control requires the preparation and submittal of a Special Report whenever the calculated doses from plant generated radioactive effluents and direct radiation exceed 25 mrem to the total body or any organ, except the thyroid, which shall be limited to less than or equal to 75 mrems. For sites containing up to 4 reactors, it is highly unlikely that the resultant dose to a member of the public will exceed the dose limits of 40 CFR Part 190 if the individual reactors remain within twice the dose design objectives of Appendix I, and if direct radiation doses from the reactor units and outside storage tanks are kept small. The Special Report will describe a course of action that should result in the limitation of the annual dose to a member of the public to within the 40 CFR Part 190 limits. For the purpose of the Special Report, it may be assumed that the dose commitment to the member of the public from other than uranium fuel cycle sources is negligible, with the exception that dose contributions from other nuclear fuel cycle facilities at the same site or within a radius of 8 km must be considered. If the dose to any member of the public is estimated to exceed the requirements of 40 CFR Part 190, the Special Report with a request for a variance (provided the release conditions resulting in violation of 40 CFR Part 190 have not already been corrected), in accordance with the provisions of 40 CFR Part 190.11 and 10 CFR Part 20.2203, is considered to be a timely request and fulfills the requirements of 40 CFR Part 190 until NRC staff action is completed. The variance only relates to the limits of 40 CFR Part 190, and does not apply in any way to the other requirements for dose limitation of 10 CFR Part 20, as addressed in Controls 3.11.1.1 and 3.11.2.1. An individual is not considered a member of the public during any period in which he/she is engaged in carrying out any operation that is part of the nuclear fuel cycle.

## RADIOLOGICAL ENVIRONMENTAL MONITORING

### BASES

---

#### 3/4.12.1 MONITORING PROGRAM

The radiological environmental monitoring program required by this control provides representative measurements of radiation and of radioactive materials in those exposure pathways and for those radionuclides that lead to the highest potential radiation exposures of MEMBERS OF THE PUBLIC resulting from the station operation. This monitoring program implements Section IV.B.2 of Appendix I to 10 CFR Part 50 and thereby supplements the radiological effluent monitoring program by verifying that the measureable concentrations of radioactive materials and levels of radiation are not higher than expected on the basis of the effluent measurements and the modeling of the environmental exposure pathways. Guidance for this monitoring program is provided by the Radiological Assessment Branch Technical Position on Environmental Monitoring. The initially specified monitoring program will be effective for at least the first 3 years of commercial operation. Following this period, program changes may be initiated based on operational experience.

The required detection capabilities for environmental sample analyses are tabulated in terms of the lower limits of detection (LLDs). The LLDs required by Table 4.12.1-1 are considered optimum for routine environmental measurements in industrial laboratories. It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement.

Detailed discussion of the LLD, and other detection limits, can be found in HASL Procedure Manual, HASL-300 (revised annually), Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry," Anal. Chem. 40, 586-93 (1968), and Hartwell, J. K., "Detection Limits for Radioanalytical Counting Techniques," Atlantic Richfield Hanford Company Report ARH-SA-215 (June 1975).

#### 3/4.12.2 LAND USE CENSUS

This control is provided to ensure that changes in the use of areas at and beyond the SITE BOUNDARY are identified and that modifications to the radiological environmental monitoring program are made if required by the results of this census. The best information from the door-to-door survey, from aerial survey, from visual survey or from consulting with local agricultural authorities shall be used. This census satisfies the requirements of Section IV.B.3 of Appendix I to 10 CFR Part 50. Restricting the census to gardens of greater than 50 m<sup>2</sup> provides assurance that significant exposure pathways via leafy vegetables will be identified and monitored since a garden of this size is the minimum required to produce the quantity (26 kg/year) of leafy vegetables assumed in Regulatory Guide 1.109 for consumption by a child. To determine this minimum garden size, the following assumptions were made: (1) 20% of the garden was used for growing broad leaf vegetation (i.e., similar to lettuce and cabbage), and (2) a vegetation yield of 2 kg/m<sup>2</sup>.

## **RADIOLOGICAL ENVIRONMENTAL MONITORING**

### **BASES**

---

#### **3/4.12.3 INTERLABORATORY COMPARISON PROGRAM**

The requirement for participation in an Interlaboratory Comparison Program which is audited periodically is provided to ensure that independent checks on the precision and accuracy of the measurements of radioactive material in environmental sample matrices are performed as part of the quality assurance program for environmental monitoring in order to demonstrate that the results are valid for the purposes of Section IV.B.2 of Appendix I to 10 CFR Part 50.

**END OF SECTION 4.0**

**SECTION 5.0**  
**ADMINISTRATIVE CONTROLS**



## ADMINISTRATIVE CONTROLS

### ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

5.9.1.7 Routine Annual Radiological Environmental Operating Reports covering the operation of the unit during the previous calendar year shall be submitted prior to May 1 of each year. The initial report shall be submitted prior to May 1 of the year following initial criticality.

The Annual Radiological Environmental Operating Reports shall include summaries, interpretations, and an analysis of trends of the results of the radiological environmental surveillance activities for the report period, including a comparison as appropriate, with preoperational studies, with operational controls, and with previous environmental surveillance reports, and an assessment of the observed impacts of the plant operation on the environment. The reports shall also include the results of land use censuses required by Control 3.12.2. The Annual Radiological Environmental Operating Reports shall include the results of analysis of all radiological environmental samples and of all environmental radiation measurements taken during the period pursuant to the locations specified in Table 10.0-1 in the ODCM, as well as summarized and tabulated results of these analyses and measurements in the format of the table in the Radiological Assessment Branch Technical Position, Revision 1, November 1979. In the event that some individual results are not available for inclusion with the report, the report shall be submitted noting and explaining the reasons for the missing results. If possible, the missing data shall be submitted as soon as possible in a supplementary report.

The reports shall also include the following: a summary description of the radiological environmental monitoring program; one or more tables covering all sampling locations; the results of licensee participation in the Interlaboratory Comparison Program, required by Control 3.12.3; discussion of all deviations from the sampling schedule of Table 3.12.1-1; and discussion of all analyses in which the LLD required by Table 4.12.1-1 was not achievable.

### ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT\*

5.9.1.8 Routine Annual Radioactive Effluent Release Reports covering the operation of the unit during the previous year of operation shall be submitted prior to May 1 of each year. The period of the first report shall begin with the date of initial criticality.

---

\*A single submittal may be made for a multiple unit station. The submittal should combine those sections that are common to all units at the station; however, for units with separate radwaste systems, the submittal shall specify the releases of radioactive material from each unit.

## ADMINISTRATIVE CONTROLS

### ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT (Continued)

The Annual Radioactive Effluent Release Report shall include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the unit as outlined in Regulatory Guide 1.21, "Measuring, Evaluating, and Reporting Radioactivity in Solid Wastes and Releases of Radioactive Materials in Liquid and Gaseous Effluents from Light-Water-Cooled Nuclear Power Plants," Revision 1, June 1974, with data summarized on a quarterly basis following the format of Appendix B thereof.

The Annual Radioactive Effluent Release Report shall include an annual summary of hourly meteorological data collected over the previous year. This annual summary may be either in the form of an hour-by-hour listing on an electronic medium of wind speed, wind direction, atmospheric stability, and precipitation (if measured), or in the form of joint frequency distributions of wind speed, wind direction, and atmospheric stability.\*\*\* This same report shall include an assessment of the radiation doses due to the radioactive liquid and gaseous effluents released from the unit or station during the previous calendar year. This same report shall also include an assessment of the radiation doses from radioactive liquid and gaseous effluents to MEMBERS OF THE PUBLIC due to their activities inside the SITE BOUNDARY (Figure 3.0-1) during the report period. All assumptions used in making these assessments, i.e., specific activity, exposure time and location, shall be included in these reports. The assessment of radiation doses shall be performed in accordance with the methodology and parameters in the OFFSITE DOSE CALCULATION MANUAL (ODCM).

The Annual Radioactive Effluent Release Report shall also include an assessment of radiation doses to the likely most exposed MEMBER OF THE PUBLIC from reactor releases and other nearby uranium fuel cycle sources, including doses from primary effluent pathways and direct radiation, for the previous calendar year to show conformance with 40 CFR Part 190, Environmental Radiation Protection Standards for Nuclear Power Operation. The assessment of radiation doses shall be performed in accordance with methodology and parameters in the ODCM.

The Annual Radioactive Effluent Release Reports shall include the following information for each class of solid waste (as defined by 10 CFR Part 61) shipped offsite during the report period:

- a. Total volume in all containers,
- b. Total curie quantity (specify whether determined by measurement or estimate),

\*\*\*In lieu of submission with the Annual Radioactive Effluent Release Report, the licensee has the option of retaining this summary of required meteorological data on site in a file that shall be provided to the NRC upon request.

## ADMINISTRATIVE CONTROLS

### ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT (Continued)

- c. Principal radionuclides (specify whether determined by measurement or estimate),
- d. Source of waste and processing employed (e.g., dewatered spent resin, compacted dry waste, evaporator bottoms),
- e. Type of container (e.g., Type A, Type B, General Design Packages), and
- f. Solidification agent or absorbent (e.g., cement, urea formaldehyde).

14/13

The Annual Radioactive Effluent Release Reports shall include a list and description of unplanned releases from the site to UNRESTRICTED AREAS of radioactive materials in gaseous and liquid effluents made during the reporting period.

The Annual Radioactive Effluent Release Reports shall include any changes made during the reporting period to the OFFSITE DOSE CALCULATION MANUAL (ODCM) as described in Technical Specification 5.5.1.3, as well as a listing of new locations for dose calculations and/or environmental monitoring identified by the land use census pursuant to Control 3.12.2.

The Annual Radioactive Effluent Release Reports shall also include the following: an explanation as to why the not FUNCTIONALLY CAPABLE status of liquid or gaseous effluent monitoring instrumentation was not corrected within the time specified in Control 3.3.7.11 or 3.3.7.12, respectively; and description of the events leading to liquid holdup tanks exceeding the limits of Technical Specification 5.5.8.6.

The Annual Radioactive Effluent Release Reports shall include the results of analysis of all onsite groundwater and rainwater sampling and a description of any detected onsite radioactive leaks or spills into groundwater. Any groundwater related events, or groundwater sample results exceeding ODCM REMP reporting thresholds, voluntarily communicated per NEI 07-07, Objective 2.2 shall also be described in these reports (NEI 07-07 Acceptance Criterion 2.4.c).

### 5.15 MAJOR CHANGES TO RADIOACTIVE LIQUID, GASEOUS, AND SOLID WASTE TREATMENT SYSTEMS\*

5.15.1 Licensee-initiated major changes to the radioactive waste systems (liquid, gaseous, and solid):

- a. Shall be reported to the Commission in the Annual Radioactive Effluent Release Report for the period in which the evaluation was reviewed by the OSRO. The discussion of each change shall contain:
  - 1. A summary of the evaluation that led to the determination that the change could be made in accordance with 10 CFR 50.59.
  - 2. Sufficient detailed information to totally support the reason for the change without benefit of additional or supplemental information;

\*Licensees may choose to submit the information called for in this Control as part of the UFSAR revision in accordance with 10 CFR 50.71(e).

## ADMINISTRATIVE CONTROLS

3. A detailed description of the equipment, components, and processes involved and the interfaces with other plant systems;
  4. An evaluation of the change, which shows the predicted releases of radioactive materials in liquid and gaseous effluents and/or quantity of solid waste that differ from those previously predicted in the license application and amendments thereto;
  5. An evaluation of the change, which shows the expected maximum exposures to a MEMBER OF THE PUBLIC in the UNRESTRICTED AREA and to the general population that differ from those previously estimated in the license application and amendments thereto;
  6. A comparison of the predicted releases of radioactive materials, in liquid and gaseous effluents and in solid waste, to the actual releases for the period prior to when the changes are to be made;
  7. An estimate of the exposure to plant operating personnel as a result of the change; and
  8. Documentation of the fact that the change was reviewed and found acceptable by the OSRO.
- b. Shall become effective upon review and acceptance by the OSRO.

**END OF SECTION 5.0**

**SECTION 6.0**  
**LIQUID EFFLUENTS**

## 6.0 LIQUID EFFLUENTS

This section summarizes information on the liquid effluent radiation monitoring instrumentation and controls. More detailed information is provided in the Fermi 2 UFSAR and Fermi 2 design drawings from which this summary was derived. This section also describes the sampling and analysis required by the Offsite Dose Calculation Manual. Methods for calculating alarm setpoints for the liquid effluent monitors are presented. Also, methods for evaluating doses from liquid effluents are provided.

### 6.1 Radiation Monitoring Instrumentation and Controls

This section summarizes the instrumentation and controls monitoring liquid effluents. This discussion focuses on the role of this equipment in assuring compliance with the Offsite Dose Calculation Manual.

#### 6.1.1 Offsite Dose Calculation Manual (ODCM) 3.3.7.11 Requirement

Fermi 2 ODCM 3.3.7.11 prescribes the monitoring required during liquid releases and the backup sampling required when monitors are not FUNCTIONALLY CAPABLE.

The liquid effluent monitoring instrumentation for controlling and monitoring radioactive effluents in accordance with the Fermi 2 ODCM 3.3.7.11 is summarized below:

##### 1. Radiation Alarm - Automatic Release Termination

- a. Liquid Radwaste Effluent Line - The D11-N007 Radiation Monitor on the liquid radwaste effluent line provides the alarm and automatic termination of liquid radioactive material releases prior to exceeding 1 Maximum Permissible Concentration (MPC) at the discharge to Lake Erie, as required by ODCM 3.3.7.11. The monitor is located upstream of the Isolation Valve (G11-F733) on the liquid radwaste discharge line and monitors the concentration of liquid effluent before dilution by the circulating water reservoir (CWR) decant flow.

##### 2. Radiation Alarm (only)

- a. Circulating Water Reservoir (CWR) Decant Line - The CWR Decant Line Radiation Monitor (D11-N402) provides indication of the concentration of radioactive material in the diluted radioactive liquid releases just before discharge to Lake Erie. As required by ODCM 3.3.7.11, the alarm setpoint is established to alarm (only) prior to exceeding one MPC.

### 3. Flow Rate Measuring Devices

- a. Liquid Radwaste Effluent Line - In accordance with ODCM 3.3.7.11, the release rate of liquid radwaste discharges is monitored by G11-R703. This flow rate instrumentation is located on the radwaste discharge line prior to the junction with the CWR decant line.
- b. Circulating Water Reservoir Decant Line - The flow rate measuring device for the CWR decant line has been removed. The flow rate of the CWR decant line is now measured using certified pump performance curves for the CWR decant pumps, together with readings from pump discharge pressure gauges and reservoir level indication.

#### 6.1.2 Non-ODCM Required Monitor

An additional monitor not required by Fermi 2 ODCM is provided by Detroit Edison to reduce the likelihood of an unmonitored release of radioactive liquids.

1. General Service Water - The General Service Water (GSW) Radiation Monitor (D11-N008) provides additional control of potential radioactive effluents. D11-N008 monitors the GSW System prior to discharge into the Main Condenser circulating water discharge line to the Circulating Water Reservoir. Although not an ODCM required monitor, D11-N008 monitors a primary liquid stream in the plant that also discharges to the environment (Lake Erie via the Circulating Water Reservoir). Indication of radioactive material contamination in the GSW System would also indicate potential CWR contamination and the need to control all discharges from the CWR as radioactive effluents.

## 6.2 Sampling and Analysis of Liquid Effluents

The program for sampling and analysis of liquid waste is prescribed in the Fermi 2 Offsite Dose Calculation Manual Table 4.11.1.1.1-1. This table distinguishes two types of liquid releases: a) BATCH releases, defined as discrete volumes, from the Waste Sample Tanks (normally after processing through the radwaste system), and b) CONTINUOUS releases, from the Circulating Water Reservoir (CWR) System, if it becomes contaminated.

Continuous releases from the CWR System are via the CWR decant line to Lake Erie. The CWR System is not expected to become contaminated. Therefore, continuous radioactive material releases are not expected. However, the General Service Water (GSW) and the CWR systems interface with radioactive systems in the plant. Also, the GSW intake is within a few hundred feet of the CWR decant line discharge to Lake Erie. For these reasons, it is prudent to consider the GSW and the CWR a potential source of radioactive effluents and to sample them regularly.

### 6.2.1 BATCH Releases

Fermi 2 ODCM Table 4.11.1.1.1-1 requires that a sample representative of the tank contents be obtained before it is released. The table specifies the following program:

- Prior to sampling, the tank is isolated. The tank level is determined and this value is converted to tank volume. A pump with a known recirculation flow rate is then activated to recirculate tank contents. The pump is allowed to run for at least the time required to recirculate the tank volume twice.
- Prior to each batch release, analysis for principal gamma emitters and dissolved and entrained gases (including all peaks identified by gamma spectroscopy)
- Once per month, analysis of a composite sample of all releases that month for tritium (H-3) and gross alpha activity. (The composite sample is required to be representative of the liquids released and sample quantities of the composite are to be proportional to the quantities of liquid discharged).
- Once per quarter, analysis of a composite sample of all releases that quarter for Strontium (Sr)-89, Sr-90, and Iron (Fe)-55.



### 6.2.2 CONTINUOUS Releases

Fermi 2 ODCM Table 4.11.1.1.1-1 requires that composite samples be collected from the CWR System, if contaminated. The table specifies the following sample analysis:

- Once per month, analysis of a composite sample for principal gamma emitters and for I-131.
- Once per month, analysis of a composite sample for H-3 and gross alpha.
- Once per month, analysis of weekly grab samples (composited) for dissolved and entrained gases (gamma emitters).
- Once per quarter, analysis for Sr-89, -90 and Fe-55.

### 6.3 Liquid Effluent Monitor Setpoints

Offsite Dose Calculation Manual 3.11.1.1 requires that the concentration of liquid radioactive effluents not exceed the unrestricted area MPC at the discharge point to Lake Erie. Dissolved or entrained noble gases in liquid effluents are limited to a concentration of  $2 \text{ E-}04 \text{ } \mu\text{Ci/ml}$ , total noble gas activity. ODCM 3.3.7.11 requires that radiation monitor setpoints be established to alarm prior to exceeding the limits of ODCM 3.11.1.1.

To meet this specification, the alarm setpoints for liquid effluent monitors are determined in accordance with the following equation:

$$SP \leq \frac{CL(DF + RR)}{RR} \quad (6-1)$$

where:

- SP = the setpoint, in  $\mu\text{Ci/ml}$ , of the monitor measuring the radioactivity concentration in the effluent line prior to dilution. The setpoint represents a value which, if exceeded, would result in concentrations exceeding the MPC in the unrestricted area
- CL = the effluent concentration limit (ODCM 3.11.1.1) corresponding to ten times the limits of 10 CFR Part 20.1302.b.2.i at the discharge point in  $\mu\text{Ci/ml}$ , defined in Equation (6-4)

RR = the liquid effluent release rate as measured at the radiation monitor location, in volume per unit time, but in the same units as DF, below

DF = the dilution water flow as measured prior to the release point (Lake Erie) in volume per unit time

At Fermi 2 the available Dilution Water Flow (DF) is essentially constant for a given release, and the waste tank Release Rate (RR) and monitor Setpoint (SP) are set to meet the condition of Equation (6-1) for a given effluent Concentration Limit, CL.

**NOTE:** If no dilution is provided,  $SP \leq CL$ . Also, when DF is large compared to RR, then  $(DF + RR) \approx DF$ , and DF may be used instead of  $(DF + RR)$  as a simplification, as in Equation (6-5).

### 6.3.1 Liquid Radwaste Effluent Line Monitor

The Liquid Radwaste Effluent Line Monitor D11-N007 provides alarm and automatic termination of releases prior to exceeding MPC. As required by ODCM Table 4.11.1.1.1-1 and as discussed in ODCM Section 6.2.1, a sample of the liquid radwaste to be discharged is collected and analyzed by gamma spectroscopy to identify principal gamma emitting radionuclides. From the measured individual radionuclide concentrations, the allowable release rate is determined.

The allowable release rate is inversely proportional to the ratio of the radionuclide concentrations to the MPC values. The ratio of the measured concentration to MPC values is referred to as the "MPC fraction" and is calculated by the equation:

$$MPCF = \sum \frac{C_i}{MPC_i} \quad (6-2)$$

where:

MPCF = fraction of the unrestricted area MPC for a mixture of gamma emitting radionuclides

$C_i$  = concentration of each gamma emitting radionuclide  $i$  measured in each tank prior to release ( $\mu\text{Ci/ml}$ )

$MPC_i$  = unrestricted area most restrictive MPC for each radionuclide  $i$ : ten times the value from 10 CFR Part 20, Appendix B, Table 2, Column 2. For dissolved and entrained noble gases an MPC value of  $2\text{E-}04 \mu\text{Ci/ml}$  may be used, but noble gases need not be included in this calculation.

Including noble gases in Equation (6-2) eliminates the need for a separate evaluation of compliance with the noble gas concentration limit of ODCM 3.11.1.1.

Based on the MPCF, the maximum allowable release rate can be calculated by the following equation:

$$MAX RR \leq \frac{DF}{(MPCF * (1 + BF)) + H3MPCF} * SF \quad (6-3)$$

where:

MAX RR = maximum acceptable waste tank discharge rate (gal/min)  
(Monitor #G11-R703)

DF = dilution flow rate from the CWR decant line, measured as described in ODCM section 6.1.1.3.b.

SF = administrative safety factor to account for variations in monitor response and flow rates. A SF value of 0.5 is suggested because it provides for 100% variation caused by statistical fluctuation and/or errors in measurements.

BF = conservative estimate of the ratio of the MPC fraction of pure beta emitters other than tritium to the gamma MPC fraction (MPCF) (The value 0.10 may be used for BF.)

MPCF = As previously defined by equation (6-2)

H3MPCF = conservative estimate of MPC fraction due to tritium (The value 0.13 may be used for H3MPCF.)

**NOTE:** Equation (6-3) is valid only for MPCF > 1; if the MPCF ≤ 1, the waste tank concentration meets the limits of 10 CFR Part 20 without dilution, and the tank may be discharged at the maximum rate.

If MAX RR as calculated above is greater than the maximum discharge pump capacity, the pump capacity should be used in establishing the actual Release Rate RR for the radwaste discharge. For a Waste Sample Tank, the maximum discharge rate is 50 gallons per minute. This Release Rate RR is monitored in the Radwaste Control Room by G11-R703.

The Concentration Limit (CL) of a liquid radwaste discharge is the same as the effective MPC for the radionuclide mixture of the discharge. Simply, the CL (or effective MPC) represents the equivalent MPC value for a mixture of radionuclides evaluated collectively. The equation for determining CL is:

$$CL = \frac{\sum C_i}{MPCF} \quad (6-4)$$

Based on the Release Rate RR and Dilution Flow DF and by substituting Equation (6-4) for CL in Equation (6-1) and introducing sensitivity factors and factors to account for the presence of pure beta emitters, the alarm setpoint is calculated by the equation:

$$SP \leq \frac{\sum (C_i * SEN_i) * DF * H3F * SF}{MPCF * (1 + BF) * RR} + Bkg \quad (6-5)$$

where:

- SP = setpoint of the radiation monitor counts per second (cps) or counts per minute (cpm)
- $C_i$  = concentration of radionuclide i as measured by gamma spectroscopy ( $\mu\text{Ci/ml}$ )
- $SEN_i$  = monitor sensitivity for radionuclide i based on calibration curve (cps/ $(\mu\text{Ci/ml})$  or cpm/ $(\mu\text{Ci/ml})$ ) or single conservative value for all radionuclides (see below)
- RR = actual release rate of the liquid radwaste discharge (gal/min)
- BF = pure beta factor as defined for Equation (6-3)
- MPCF = MPC fraction as determined by Equation (6-2)
- H3F = correction factor to account for estimated tritium concentration at the discharge point (The value 0.99 may be used.)
- Bkg = background reading of monitor (cps)
- DF = dilution flow rate from the CWR decant line, measured as described in ODCM section 6.1.1.3.b. Also see note preceding Section 6.3.1.
- SF = 1.0 when a single conservative sensitivity value is used; 0.5 when individual nuclide sensitivity factors are used

The sensitivity of Cr-51 determined from the primary calibration sensitivity curves may be used as a single conservative value for  $SEN_i$  above. The Cr-51 sensitivity has been determined to be conservative based on the nuclide mixes which have been seen in actual liquid discharges from Fermi 2. For the D11-N007 monitor, a monitor sensitivity value of 1.0 E6 cps/( $\mu$ Ci/ml) may be used as the single conservative value of  $SEN_i$ .

If no radionuclides are measured by gamma spectroscopy, the alarm setpoint can be established at one half the setpoint of the most recent discharge for which radionuclides were detected by gamma spectroscopy.

Prior to conducting any batch liquid radwaste release, Equation (6-3) is used to determine the allowable release rate in accordance with ODCM 3.11.1.1. Equation (6-5) is used to determine the alarm setpoint in accordance with ODCM 3.3.7.11.

### 6.3.2 Circulating Water Reservoir Decant Line Radiation Monitor (D11-N402)

ODCM 3.3.7.11 requires that the setpoint for the CWR Decant Line Radiation Monitor D11-N402 be established to ensure the radioactive material concentration in the decant line prior to discharge to Lake Erie does not exceed MPC, unrestricted area (ten times 10 CFR 20, Appendix B, Table 2, Column 2 values). The approach for determining the alarm setpoint for the CWR Decant Line Radiation Monitor is the same as presented in Section 6.3.1. However, the CWR Decant Line Radiation Monitor setpoint need not be changed prior to each release. Equation (6-1) remains valid, except that, for the CWR Decant Line Monitor, the dilution flow previously assumed for diluting the BATCH liquid radwaste effluents is now the release rate. There is no additional dilution prior to discharge to Lake Erie. Thus, Equation (6-1) simplifies to:

$$SP \leq CL \tag{6-6}$$

Substituting Equation (6-4) for CL and introducing a safety factor, sensitivity factors, and monitor background, the D11-N402 alarm setpoint can be calculated by the equation:

$$SP \leq \frac{\sum (C_i * SEN_i) * SF}{MPCF} + Bkg \tag{6-7}$$

where:

- SP = setpoint in counts per minute (cpm)
- $C_i$  = concentration of each radionuclide  $i$  in the CWR decant line effluent ( $\mu\text{Ci/ml}$ )
- $\text{SEN}_i$  = monitor sensitivity for nuclide  $i$  based on calibration curve ( $\text{cpm}/(\mu\text{Ci/ml})$ )
- MPCF = MPC fraction as determined by Equation (6-2) with  $C_i$  defined as for Equation (6-7)
- SF = 0.5, administrative safety factor
- Bkg = background reading of monitor (cpm)

Normally, only during periods of batch liquid radwaste discharges will there exist any plant-related radioactive material in the CWR decant line.

### 6.3.3 Generic, Conservative Alarm Setpoint for D11-N402

The D11-N402 setpoint could be adjusted for each BATCH release as is done for the liquid radwaste effluent line monitor. Based on the measured levels of radioactive material in a BATCH liquid release, the alarm setpoint for D11-N402 could be calculated using Equation (6-7). However, during these planned releases, the concentrations will almost always be so low (due to dilution) that the D11-N402 Monitor will not indicate measurable levels. The CWR decant line design flow is 10,000 gpm; and the maximum liquid radwaste release rate is 50 gpm, providing a 200:1 dilution. The radioactive material concentration of BATCH liquid releases is typically in the range of  $10^{-7}$  to  $10^{-4}$   $\mu\text{Ci/ml}$ . With a nominal 200:1 dilution (actual dilution has been greater since in actual releases the decant line flow rate has been about 18,000 gpm), the CWR decant line monitor would monitor diluted activity in the range of  $5 \times 10^{-10}$  to  $5 \times 10^{-7}$   $\mu\text{Ci/ml}$ . D11-N402 Monitor response at these levels would be 0.1 to 100 cpm, depending on the particular radionuclide mixture and corresponding instrument response. These response levels are less than the monitor background levels.

In lieu of routinely adjusting the D11-N402 setpoints, generic, conservative setpoints have been established based on an analysis of nuclides seen in actual liquid discharges and on the primary calibration sensitivity curve.

#### 6.3.4 Alarm Setpoint for GSW and RHR System Radiation Monitors

Levels of radioactive material detectable above background at Radiation Monitor D11-N008 would be one of the first indicators of contamination of the General Service Water (GSW) System and the CWR. Likewise, for the Residual Heat Removal (RHR) System, the D11-N401 A and B Monitors would be one of the first indicators of contamination and subsequent contamination of the CWR. Therefore, to provide early indication and assure prompt attention, the alarm setpoints for these monitors should be established as close to background as possible without incurring a spurious alarm due to background fluctuations. This level is typically around three times background.

If the GSW System or RHR System becomes contaminated, it may become necessary to raise the radiation monitor setpoints. The alarm setpoints should be re-evaluated to provide the CR operator a timely indication of further increasing activity levels in the GSW or RHR System without spurious alarms. The method for this re-evaluation is the same as described above - the alarm setpoint established at three times its current reading. No regulatory limits apply for establishing a maximum value for these alarm setpoints since these monitors are located on plant systems and do not monitor final release points to the environment. However, as a practical matter, upper limits on the alarm setpoints can be evaluated using the methods of ODCM Section 6.3.1 based on the actual system flows, dilution and release paths in effect at the time.

#### 6.3.5 Alarm Response - Evaluating Actual Release Conditions

Normally, liquid release rates are controlled and alarm setpoints are established to ensure that the release does not exceed the concentration limits of ODCM 3.11.1.1 at the discharge to Lake Erie. However, if either Monitor D11-N007 or D11-N402 alarms during a liquid release, it becomes necessary to re-evaluate the release conditions to determine compliance with ODCM 3.11.1.1. Following an alarm, the actual release conditions should be determined. Radioactive material concentrations should be evaluated by sampling the effluent stream or resampling the waste tank. Discharge flow and dilution water flow should be redetermined.

To perform this evaluation, the following equation may be used for all nuclides, or dissolved and entrained noble gases may be evaluated separately from other nuclides using this equation:

$$\left[ \sum \left( \frac{C_i}{MPC_i} \right) * \frac{RR}{DF + RR} * \frac{(1 + BF)}{H3F} \right] \leq 1 \quad (6-8)$$

where:

- $C_i$  = measured concentration of radionuclide i in the effluent stream ( $\mu\text{Ci/ml}$ )
- $\text{MPC}_i$  = the MPC value for radionuclide i: ten times the 10 CFR 20, Appendix B, Table 2, Column 2 value ( $\mu\text{Ci/ml}$ );  $2 \text{ E-}04 \mu\text{Ci/ml}$  for dissolved or entrained noble gases
- $\text{RR}$  = actual release rate of the liquid effluent at the time of the alarm, gpm
- $\text{DF}$  = actual dilution circulating water flow at the time of the release alarm, gpm
- $\text{H3F,BF}$  = as previously defined

**NOTE:** For alarm on D11-N402 (CWR decant line), the Release Rate  $\text{RR}$  is the Dilution Water Flow  $\text{DF}$  and the  $\text{DF}$  term drops out of the equation.

### 6.3.6 Liquid Radwaste Monitor Setpoint Determination with Contaminated Circulating Water Reservoir

In the event the CWR is determined to contain radioactive material, the effective dilution capacity of the CWR is reduced as a function of the MPCF. To determine the available dilution flow capacity the MPCF for the CWR is determined using equation (6-2). The MPCF of the CWR (CWRMPCF in equation 6-9) is used to determine the available dilution flow as follows:

$$\text{CWR Dilution Flow} = \text{CWR Decant Flow Rate (GPM)} * (1 - \text{CWRMPCF})$$

(6-9)

The resulting dilution flow rate is substituted in equation (6-3) to determine the maximum allowable release rate for discharges from the radwaste system. Substituting the available CWR dilution flow from equation (6-9), the Liquid Radwaste Monitor maximum release rate can be determined using equation (6-3).

Once the available dilution flow and maximum allowable release rate have been determined the radwaste monitor setpoint can be determined using equation (6-5).

4/13



#### 6.4 Contaminated GSW or RHR System - Quantifying and Controlling Releases

The GSW Radiation Monitor (D11-N008) provides an indication of contamination of this system. The Monitors D11-N401 A and B perform this function for the RHR System. Also, the CWR Decant Line Radiation Monitor monitors all liquid releases from the plant and would record any release to Lake Erie from either of these systems if contaminated. As discussed in ODCM Section 6.2.2, sampling and analysis of the CWR System is required only if this system is contaminated, as would be indicated by D11-N402 or D11-N008. Nonetheless, periodic samples are collected from the CWR System to verify absence of contamination. Although not required by the ODCM, periodic sampling and analysis of the RHR System is also performed since it also is a potential source of contamination of the CWR and subsequent releases to Lake Erie. If contamination is found, further releases from the applicable system (GSW or RHR) via the CWR decant line must be evaluated and controlled to ensure that releases are maintained ALARA. The following actions will be considered for controlling releases.

- Sampling frequency of the applicable source (GSW or RHR System) and the CWR will be increased until the source of the contamination is found and controlled. This frequency may be relaxed after the source of contamination has been identified and isolated.
- Gamma spectral analysis will be performed on each sample.
- The measured radionuclide concentrations from the gamma spectral analysis will be compared with MPC (Equation 6-2) to ensure releases are within the limits of ODCM 3.11.1.1.
- Based on the measured concentrations, the setpoint for the CWR Decant Line Radiation Monitor (D11-N402) will be determined as specified in Section 6.3.2. If the calculated setpoint based on the measured distribution is greater than the current setpoint (see ODCM Section 6.3.3) no adjustment to the setpoint is required.
- Samples will be composited in accordance with ODCM Table 4.11.1.1.1-1 for monthly analysis for H-3 and gross alpha and for quarterly analysis for Sr-89, 90 and Fe-55.
- Each sample will be considered representative of the releases that have occurred since the previous sample. For each sample (and corresponding release period), the volume of liquid released to the lake will be determined based on the measured CWR decant line cumulative flow.
- From the sample analysis and the calculated volume released, the total radioactive material released will be determined and considered representative of the release period. Cumulative doses will be determined in accordance with ODCM Section 6.5.

## 6.5 Liquid Effluent Dose Calculation - 10 CFR 50

The parameters of the liquid release (or estimated parameters, for a pre-release calculation) may be used to calculate the potential dose to the public from the release (or planned release). The dose calculation provides a conservative method for estimating the impact of radioactive effluents released by Fermi 2 and for comparing that impact against limits set by the NRC in the Fermi 2 ODCM. The limits in the Fermi 2 ODCM are specified as quarterly and calendar year limits. This assures that the average over the year is kept as low as reasonably achievable.

### 6.5.1 MEMBER OF THE PUBLIC Dose - Liquid Effluents

ODCM 3.11.1.2 limits the dose or dose commitment to MEMBERS OF THE PUBLIC from radioactive materials in liquid effluents from Fermi 2 to:

- during any calendar quarter;
  - $\leq 1.5$  mrem to total body
  - $\leq 5.0$  mrem to any organ
  
- during any calendar year;
  - $\leq 3.0$  mrem to total body
  - $\leq 10.0$  mrem to any organ

ODCM 4.11.1.2 requires that quarterly and annual cumulative dose due to liquid effluents be determined at least once per 31 days. The calculation of the potential doses to MEMBERS OF THE PUBLIC is a function of the radioactive material releases to the lake, the subsequent transport and dilution in the exposure pathways, and the resultant individual uptake. At Fermi 2, pre-operational evaluation of radiation exposure pathways indicated that doses from consumption of fish from Lake Erie provided the most conservative estimate of doses from releases of radioactive liquids. However, with the proximity of the water intakes for the City of Monroe and Frenchtown Township, it must be assumed that individuals will consume drinking water as well as fish that might contain radioactivity from discharges into Lake Erie.

Study of the currents in Lake Erie indicates that the current in the Lagoona Beach embayment carries liquid effluents from Fermi 2 north along the coast part of the time and south along the coast part of the time. When the current flows north, liquid effluents are carried away from the drinking water Intakes, so only the fish consumption exposure pathway must be considered. When the current flows south, toward the drinking water Intakes, both fish consumption and drinking water consumption exposure pathways must be considered. To ensure conservatism in the dose modeling, the combined fish and drinking water pathway is used for evaluating the maximum hypothetical dose to a MEMBER OF THE PUBLIC from liquid radioactive effluents. The following calculational methods may be used for determining the dose or dose commitment due to the liquid radioactive effluents from Fermi 2:

$$D_o = \frac{1.67 \text{ E} - 02 * \text{VOL}}{\text{DF} * \text{Z}} * \sum (C_i * A_{io}) \quad (6-10)$$

where:

- $D_o$  = dose or dose commitment to organ o or total body (mrem) due to release of a single tank
- $A_{io}$  = site-specific ingestion dose commitment factor to the total body or any organ o for radionuclide i (mrem/hr per  $\mu\text{Ci/ml}$ )
- $C_i$  = concentration of radionuclide i in undiluted liquid effluent representative of the volume VOL ( $\mu\text{Ci/ml}$ )
- VOL = total volume of liquid effluent released (gal)
- DF = average dilution water flow (CWR decant line) during tank release (gal/min)
- Z = 5, near field dilution factor  
(Derived from Regulatory Guide 1.109, Rev 0)

$$1.67 \text{ E} - 02 = 1 \text{ hr}/60 \text{ min}$$

The site-specific ingestion dose/dose commitment factors ( $A_{io}$ ) represents a composite dose factor for the fish and drinking water pathway. The site-specific dose factor is based on the NRC's generic maximum individual consumption rates. Values of  $A_{io}$  are presented in Table 6-1. They were derived in accordance with guidance of NUREG-0133 from the following equation:

$$A_{io} = 1.14 \text{ E} + 05 \left[ (U_w / D_w) + (U_f * BF_i) \right] DF_i \quad (6-11)$$

where:

- $U_f$  = 21 kg/yr adult fish consumption
- $U_w$  = 730 liters/yr adult water consumption
- $D_w$  = 13.4, additional dilution from the near field to the water intake for Frenchtown Township (Net dilution factor of 67 from discharge point to a point documented in Fermi 2 UFSAR, Chapter 11, which is closer to the discharge point than this drinking water intake)
- $BF_i$  = Bioaccumulation factor for radionuclide i in fish from Table 6.0-2 (pCi/kg per pCi/liter)

DF<sub>i</sub> = dose conversion factor for nuclide i for adults in organ o from Table E-11 of Regulatory Guide 1.109 (mrem/pCi)

$$1.14 \text{ E} + 05 = \frac{10^6 (\text{pCi} / \text{uCi}) * 10^3 (\text{ml} / \text{kg})}{8760 (\text{hr} / \text{yr})}$$

The radionuclides included in the periodic dose assessment required by ODCM 3.11.1.2 are those identified by gamma spectral analysis of the liquid waste samples collected and analyzed per the requirements of ODCM Table 4.11.1.1.1-1. In keeping with the NUREG-0133 guidance, the adult age group represents the maximum exposed individual age group. Evaluation of doses for other age groups is not required for demonstrating compliance with the dose criteria of ODCM 3.11.1.2. The dose analysis for radionuclides requiring radiochemical analysis will be performed after receipt of results of the analysis of the composite samples. In keeping with the required analytical frequencies of ODCM Table 4.11.1.1.1-1, tritium dose analyses will be performed at least monthly; Sr-89, Sr-90 and Fe-55 dose analyses will be performed at least quarterly.

#### 6.5.2 Contaminated CWR System - Dose Calculation

If the CWR System becomes contaminated, releases via the CWR System to Lake Erie must be included in the evaluation of the cumulative dose to a MEMBER OF THE PUBLIC as required by ODCM 3.11.1.2. ODCM Section 6.4 described the methods for quantifying and controlling releases from the CWR System.

For calculating the dose to a MEMBER OF THE PUBLIC, Equation (6-10) remains applicable for releases from the GSW System with the following assumptions:

- DF, Dilution Flow, is set equal to the average CWR decant line flow rate over the release period.
- C<sub>i</sub>, Radionuclide Concentration, is determined as specified in ODCM Section 6.4.
- VOL, Volume Released, is set equal to the total volume of the discharges to Lake Erie via the CWR decant line as specified in Section 6.4.

## 6.6 Liquid Effluent Dose Projections

10 CFR 50.36a requires licensees to maintain and operate the Radwaste System to ensure releases are maintained ALARA. This requirement is implemented through ODCM 3.11.1.3. This section requires that the Liquid Radioactive Waste Processing System be used to reduce the radioactive material levels in the liquid waste prior to release when the projected dose in any 31 day period would exceed:

- 0.06 mrem to the total body, or
- 0.2 mrem to any organ

When the projected doses exceed either of the above limits, the waste must be processed by the Liquid Radwaste System prior to release. This dose criteria for processing is established at one forty eighth of the design objective rate (3 mrem/yr, total body or 10 mrem/yr any organ) in any 31 day period.

The applicable Liquid Waste Processing System for maintaining radioactive material releases ALARA is the Mixed Bed Demineralizers as delineated in Figure 6-1. Alternately, the Waste Evaporator (presented in the Fermi 2 UFSAR, Section 11.2) can be used to meet the NRC ALARA design requirements. It may be used in conjunction with or in lieu of the Mixed Bed Demineralizers to meet the waste processing requirements of ODCM 3.11.1.3.

Each BATCH release of liquid radwaste is evaluated to ensure that cumulative doses are maintained ALARA. In keeping with the requirements of ODCM 3.11.1.3, dose projections are made at least once per 31 days to evaluate the need for additional radwaste processing to ensure future releases are maintained ALARA.

The following equations may be used for the dose projection calculation:

$$D_{tbp} = D_{tb}(31 / d) \tag{6-14}$$

$$D_{max p} = D_{max}(31 / d) \tag{6-15}$$

where:

$D_{tbp}$  = the total body dose projection for the next 31 day period (mrem)

**NOTE:** The reference calendar quarter is normally the current calendar quarter. If there have been liquid releases in the previous quarter but not in the current quarter, the previous quarter should be used as the reference calendar quarter.

$D_{tb}$  = the cumulative total body dose for all releases to date in the reference calendar quarter (normally the current quarter) as determined by equation (6-10) or (6-12) (mrem)

- $D_{maxp}$  = the maximum organ dose projection for the next 31 day period (mrem)
- $D_{max}$  = the cumulative maximum organ dose for all releases to date in the reference calendar quarter as determined by Equation (6-10) or (6-13) (mrem)
- $d$  = the number of days from the beginning of the reference calendar quarter to the date of the dose projection evaluation.
- 31 = the number of days in projection

TABLE 6.0-1

Fermi 2 Site Specific Liquid Ingestion Dose Commitment Factors  
 $A_{iO}$  (mrem/hr per uCi/ml)

Nuclide	Bone	Liver	T Body	Thyroid	Kidney	Lung	GI-LLI
H-3	-	8.78E-1	8.78E-1	8.78E-1	8.78E-1	8.78E-1	8.78E-1
C-14	3.13E+4	6.26E+3	6.26E+3	6.26E+3	6.26E+3	6.26E+3	6.26E+3
Na-24	4.18E+2	4.18E+2	4.18E+2	4.18E+2	4.18E+2	4.18E+2	4.18E+2
P-32	1.39E+6	8.63E+4	5.36E+4	-	-	-	1.56E+5
Cr-51	-	-	1.29E+0	7.70E-1	2.84E-1	1.71E+0	3.24E+2
Mn-54	-	4.40E+3	8.40E+2	-	1.31E+3	-	1.35E+4
Mn-56	-	1.11E+2	1.97E+1	-	1.41E+2	-	3.54E+3
Fe-55	6.75E+2	4.67E+2	1.09E+2	-	-	2.60E+2	2.68E+2
Fe-59	1.07E+3	2.51E+3	9.60E+2	-	-	7.00E+2	8.35E+3
Co-57	-	2.20E+1	3.66E+1	-	-	-	5.59E+2
Co-58	-	9.38E+1	2.10E+2	-	-	-	1.90E+3
Co-60	-	2.69E+2	5.94E+2	-	-	-	5.06E+3
Ni-63	3.19E+4	2.21E+3	1.07E+3	-	-	-	4.62E+2
Ni-65	1.30E+2	1.68E+1	7.69E+0	-	-	-	4.27E+2
Cu-64	-	1.05E+1	4.92E+0	-	2.64E+1	-	8.94E+2
Zn-65	2.32E+4	7.38E+4	3.34E+4	-	4.94E+4	-	4.65E+4
Zn-69	4.94E+1	9.44E+1	6.57E+0	-	6.14E+1	-	1.42E+1
Br-82	-	-	2.28E+3	-	-	-	2.62E+3
-83	-	-	4.07E+1	-	-	-	5.86E+1
-84	-	-	5.27E+1	-	-	-	4.14E-4
Br-85	-	-	2.17E+0	-	-	-	1.01E-15
Rb-86	-	1.01E+5	4.71E+4	-	-	-	1.99E+4
Rb-88	-	2.90E+2	1.54E+2	-	-	-	4.01E-9
Rb-89	-	1.92E+2	1.35E+2	-	-	-	1.12E-11
Sr-89	2.40E+4	-	6.90E+2	-	-	-	3.85E+3
Sr-90	5.91E+5	-	1.45E+5	-	-	-	1.71E+4
Sr-91	4.42E+2	-	1.79E+1	-	-	-	2.11E+3
Sr-92	1.68E+2	-	7.26E+0	-	-	-	3.32E+3
Y-90	6.36E-1	-	1.70E-2	-	-	-	6.74E+3
Y-91m	6.00E-3	-	2.33E-4	-	-	-	1.76E-2
Y-91	9.31E+0	-	2.49E-1	-	-	-	5.13E+3
Y-92	5.58E-2	-	1.63E-3	-	-	-	9.78E+2
Y-93	1.77E-1	-	4.89E-3	-	-	-	5.62E+3
Zr-95	4.29E-1	1.38E-1	9.31E-2	-	2.16E-1	-	5.50E+2
Zr-97	2.37E-2	4.78E-3	2.19E-3	-	7.22E-3	-	1.48E+3
Nb-95	4.47E+2	2.49E+2	1.34E+2	-	2.46E+2	-	1.51E+6
Nb-97	3.75E+0	9.48E-1	3.46E-1	-	1.11E+0	-	3.50E+3
Mo-99	-	1.30E+2	2.47E+1	-	2.94E+2	-	3.01E+2
Tc-99m	1.04E-2	2.94E-2	3.74E-1	-	4.46E-1	1.44E-2	1.74E+1
Tc-101	1.07E-2	1.54E-2	1.51E-1	-	2.78E-1	7.88E-3	4.63E-14

TABLE 6.0-1

Fermi 2 Site Specific Liquid Ingestion Dose Commitment Factors  
 $A_{i0}$  (mrem/hr per uCi/ml)

Nuclide	Bone	Liver	T Body	Thyroid	Kidney	Lung	GI-LLI
Ru-103	5.58E+0	-	2.40E+0	-	2.13E+1	-	6.51E+2
Ru-105	4.64E-1	-	1.83E-1	-	6.00E+0	-	2.84E+2
Ru-106	8.29E+1	-	1.05E+1	-	1.60E+2	-	5.37E+3
Rh-103m	-	-	-	-	-	-	-
Rh-106	-	-	-	-	-	-	-
Ag-110m	1.87E+0	1.73E+0	1.03E+0	-	3.41E+0	-	7.08E+2
Sb-124	2.41E+1	4.56E-1	9.56E+0	5.84E-2	-	1.88E+1	6.84E+2
Sb-125	1.54E+1	1.72E-1	3.66E+0	1.57E-2	-	1.19E+1	1.70E+2
Te-125m	2.58E+3	9.36E+2	3.46E+2	7.77E+2	1.05E+4	-	1.03E+4
Te-127m	6.52E+3	2.33E+3	7.95E+2	1.67E+3	2.65E+4	-	2.19E+4
Te-127	1.06E+2	3.81E+1	2.29E+1	7.86E+1	4.32E+2	-	8.37E+3
Te-129m	1.11E+4	4.13E+3	1.75E+3	3.81E+3	4.63E+4	-	5.58E+4
Te-129	3.03E+1	1.14E+1	7.37E+0	2.32E+1	1.27E+2	-	2.28E+1
Te-131m	1.67E+3	8.15E+2	6.79E+2	1.29E+3	8.26E+3	-	8.10E+4
Te-131	1.90E+1	7.93E+0	5.99E+0	1.56E+1	8.32E+1	-	2.69E+0
Te-132	2.43E+3	1.57E+3	1.47E+3	1.73E+3	1.51E+4	-	7.43E+4
I-130	3.18E+1	9.39E+1	3.71E+1	7.96E+3	1.47E+2	-	8.09E+1
31	1.75E+2	2.51E+2	1.44E+2	8.21E+4	4.30E+2	-	6.61E+1
32	8.55E+0	2.29E+1	8.00E+0	8.00E+2	3.64E+1	-	4.30E+0
I-133	5.98E+1	1.04E+2	3.17E+1	1.53E+4	1.82E+2	-	9.35E+1
I-134	4.46E+0	1.21E+1	4.34E+0	2.10E+2	1.93E+1	-	1.06E-2
I-135	1.87E+1	4.89E+1	1.81E+1	3.22E+3	7.83E+1	-	5.52E+1
Cs-134	2.98E+5	7.10E+5	5.80E+5	-	2.30E+5	7.62E+4	1.24E+4
Cs-136	3.12E+4	1.23E+5	8.87E+4	-	6.86E+4	9.40E+3	1.40E+4
Cs-137	3.82E+5	5.23E+5	3.42E+5	-	1.77E+5	5.90E+4	1.01E+4
Cs-138	2.65E+2	5.23E+2	2.59E+2	-	3.84E+2	3.79E+1	2.23E-3
Ba-139	1.53E+0	1.09E-3	4.48E-2	-	1.02E-3	6.19E-4	2.72E+0
Ba-140	3.20E+2	4.03E-1	2.10E+1	-	1.37E-1	2.30E-1	6.60E+2
Ba-141	7.44E-1	5.62E-4	2.51E-2	-	5.23E-4	3.19E-4	3.50E-10
Ba-142	3.36E-1	3.46E-4	2.12E-2	-	2.92E-4	1.96E-4	4.74E-19
La-140	1.65E-1	8.32E-2	2.23E-2	-	-	-	6.11E+3
La-142	8.46E-3	3.84E-3	9.58E-4	-	-	-	2.81E+1
Ce-141	8.05E-2	5.45E-2	6.18E-3	-	2.53E-2	-	2.08E+2
Ce-143	1.42E-2	1.05E+1	1.16E-3	-	4.62E-3	-	3.92E+2
Ce-144	4.20E+0	1.76E+0	2.25E-1	-	1.04E-0	-	1.42E+3
Pr-143	6.08E-1	2.44E-1	3.01E-2	-	1.41E-1	-	2.66E+3
Pr-144	1.99E-3	8.26E-4	1.01E-4	-	4.66E-4	-	2.86E-10
Nd-147	4.16E-1	4.80E-1	2.87E-2	-	2.81E-1	-	2.31E+3
W-187	2.97E+2	2.48E+2	8.67E+1	-	-	-	8.12E+4
Np-239	3.59E-2	3.53E-3	1.94E-3	-	1.10E-2	-	7.24E+2



TABLE 6.0-2


Bioaccumulation Factors (BF<sub>i</sub>)  
(pCi/kg per pCi/liter)\*

Element	Freshwater Fish
H	9.0E-01
C	4.6E+03
Na	1.0E+02
P	3.0E+03
Cr	2.0E+02
Mn	4.0E+02
Fe	1.0E+02
Co	5.0E+01
Ni	1.0E+02
Cu	5.0E+01
Zn	2.0E+03
Br	4.2E+02
Rb	2.0E+03
Sr	3.0E+01
Y	2.5E+01
Zr	3.3E+00
Nb	3.0E+04
Mo	1.0E+01
Tc	1.5E+01
Ru	1.0E+01
Rh	1.0E+01
Ag	2.3E+00
Sb	1.0E+00
Te	4.0E+02
I	1.5E+01
Cs	2.0E+03
Ba	4.0E+00
La	2.5E+01
Ce	1.0E+00
Pr	2.5E+01
Nd	2.5E+01
W	1.2E+03
Np	1.0E+01

\* Values in this table are taken from Regulatory Guide 1.109 except for phosphorus, which is adapted from NUREG/CR-1336, and silver and antimony, which are taken from UCRL 50564, Rev 1, October 1972.

FIGURE 6.0-1

Liquid Radioactive Effluent Monitoring and Processing Diagram

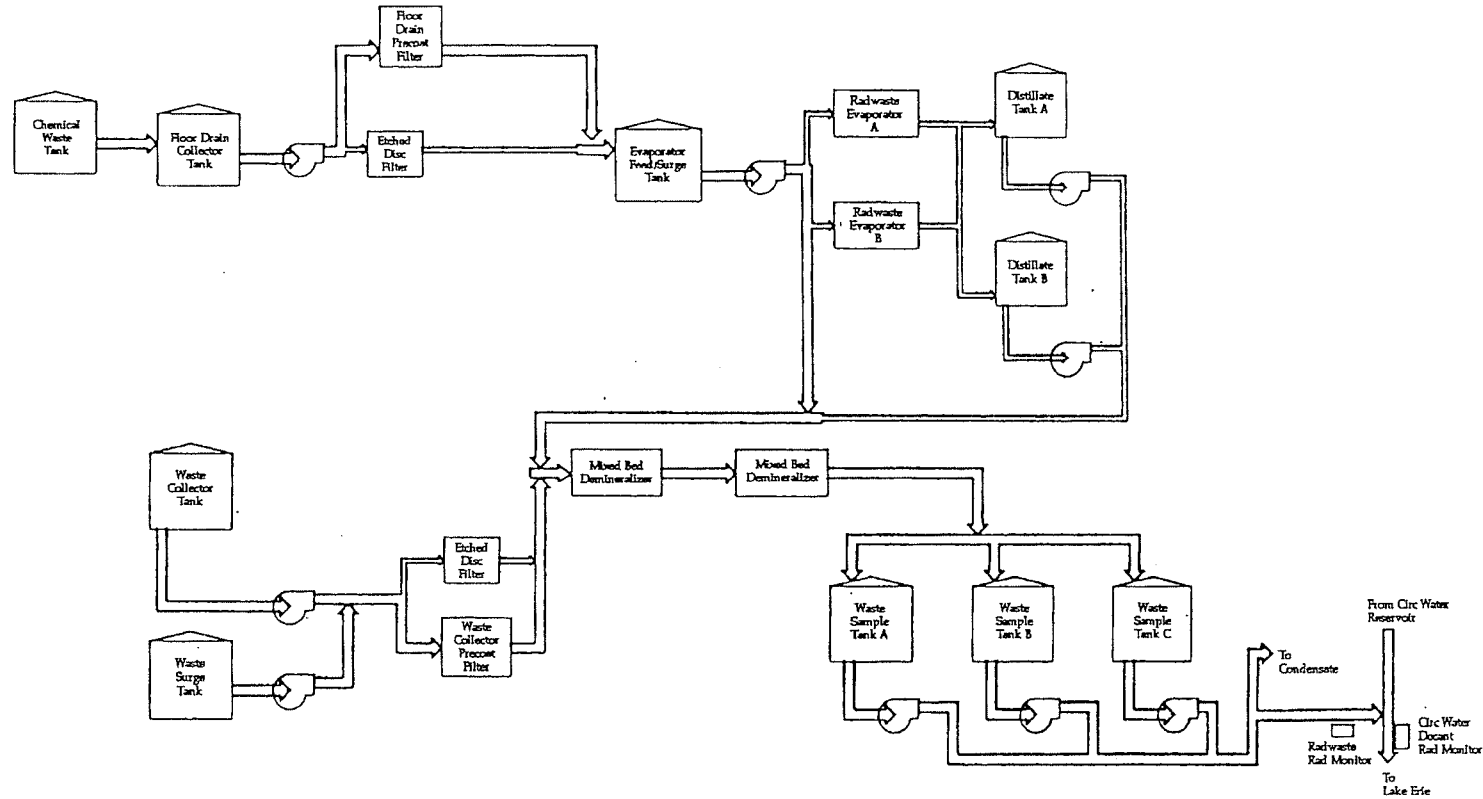

**SECTION 7.0**  
**GASEOUS EFFLUENTS**

## 7.0 GASEOUS EFFLUENTS

### 7.1 Radiation Monitoring Instrumentation and Controls

#### 7.1.1 Effluent Monitoring - Ventilation System Releases

The gaseous effluent monitoring instrumentation required at Fermi 2 for controlling and monitoring radioactive effluents are specified in ODCM 3.3.7.12. The monitoring of each identified gaseous effluent release point must include the following:

- Noble Gas Activity Monitor
- Iodine Sampler (sample cartridge containing charcoal or silver zeolite)
- Particulate Sampler (filter paper)
- Sampler Flow Rate Monitor

Meeting these requirements, a total of six Eberline SPING Monitoring Systems are installed on the five gaseous release points (Onsite Storage Facility, Radwaste Building, Turbine Building, Reactor Building Exhaust Plenum, and Standby Gas Treatment System Division 1 and Division 2). The SPING Monitor outputs are recorded electronically in the SS-1 Control Terminal in the Main Control Room.

In general, a reading exceeding the High alarm setpoint of the SPING Monitors causes an alarm in the Control Room. Fermi 2 ODCM Table 3.3.7.12-1 identifies these alarm functions.

#### 7.1.2 Main Condenser Offgas Monitoring

ODCM Table 3.3.7.12-1 and Technical Requirements Manual Volume 1, section TR 3.3.12, specify monitoring requirements for the Offgas System at the 2.2 minute delay line. The following monitors are required:

- Hydrogen Monitor - used to ensure the hydrogen concentration in the Offgas Treatment System is maintained less than 4% by volume as required by Technical Requirements Manual Volume 1, section TR LCO 3.3.12.
- Noble Gas Activity Monitor - used to ensure the gross activity release rate is maintained within 340 millicuries per second after 30 minute decay as required by Technical Specification 3.7.5.

These two monitors perform safety functions. The Hydrogen Monitor monitors the potential explosive mixtures in the Offgas System. The Noble Gas Monitor monitors the release rate from the main condenser ensuring doses at the exclusion area boundary will not exceed a small fraction of the limits of 10 CFR 100 in the event this effluent is inadvertently discharged directly to the environment bypassing the Offgas Treatment System.

Note: Page content was last changed with ODCM Revision 16.

### 7.1.3 Reactor Building Ventilation Monitors (Gulf Atomic)

The Gulf Atomic Monitors (D11-N408 and 410) on the Reactor Building Ventilation System provide on high radiation levels (above alarm setpoint) initiation of SGTS, isolation of drywell vent/purge, isolation of the RB and Control Center Ventilation Systems and initiation of Control Center recirculation mode ventilation. These monitors and functions are not required by Fermi 2 ODCM but are important in controlling containment venting/purging.

## 7.2 Sampling and Analysis of Gaseous Effluents

The program for sampling and analysis of gaseous waste is prescribed in Fermi 2 ODCM Table 4.11.2.1.2-1. This table distinguishes two types of gaseous releases: (1) containment PURGE, treated as BATCH releases, and (2) discharges from the Reactor Building Exhaust Plenum (including Standby Gas Treatment System (SGTS) when operating), and other building ventilation exhausts, treated as CONTINUOUS releases.

### 7.2.1 Containment PURGE

ODCM Table 4.11.2.1.2-1 requires that samples be collected and analyzed before each primary containment PURGE. Sampling and analysis is required within eight hours before starting a PURGE. ODCM Table 4.11.2.1.2-1 Footnote j and ODCM 4.11.2.8.2 also require that if the purging or venting is through the Reactor Building ventilation, rather than through SGTS, and if the primary containment radiation monitoring system is not FUNCTIONALLY CAPABLE or in alarm condition, sampling and analysis is required within 8 hours prior to and at least once per 12 hours during venting or purging of the primary containment. The required analyses must include principal gamma emitters and, if a pre-vent or pre-purge sample, tritium.

For a planned containment PURGE, the results of the samples and analyses may be used to establish the acceptable release rate and radiation monitor alarm setpoint in accordance with ODCM Sections 7.3 and 7.4. This evaluation may be necessary to ensure compliance with the dose rate limits of ODCM 3.11.2.1. In practice, release flow rates are fairly constant and these calculations are necessary only if a threshold value of nuclide concentration in the primary containment atmosphere is reached. The alarm setpoints of the primary containment atmosphere monitor, the Reactor Building ventilation exhaust monitors, and the Reactor Building and SGTS SPING monitors are set to ensure that release routes are continuously monitored and controlled in accordance with 10 CFR 20 or limits specified in the ODCM.

## 7.2.2 Ventilation System Releases

ODCM Table 4.11.2.1.2-1 requires continuous samples of releases from the RB Exhaust Plenum, Standby Gas Treatment System, Radwaste Building, Turbine Building, and Onsite Storage Facility. The table specifies the following program:

- Once per week, analysis of an adsorbent sample of I-131 and I-133, plus analysis of a particulate sample for principal gamma emitters.
- Once per month, analysis of a composite particulate sample of all releases (by release point) that month for gross alpha activity.
- Once per quarter, analysis of a composite particulate sample of all releases that quarter for Sr-89 and Sr-90.
- Once per month, analysis of a grab sample for principal gamma emitters (noble gases and tritium).
- Analysis of a grab sample for principal gamma emitters (noble gases) from the Offgas Vent Pipe sample lines, as needed to supplement RB Exhaust Plenum sampling. Normally performed monthly in conjunction with RB Exhaust Plenum grab sampling.

ODCM Table 4.11.2.1.2-1 also requires continuous monitoring for noble gases. This requirement is met by the SPING Monitors on each of the plant gaseous release points.

The ODCM requires more frequent sampling and analysis following reactor startup, shutdown, or change in thermal power exceeding 15% within one hour. The ODCM allows an exception to this increased sampling schedule when the applicable SPING noble gas monitor has not increased more than a factor of three.

Grab samples of the Fuel Pool Ventilation Exhaust are required tritium analysis once per seven days whenever spent fuel is in the Spent Fuel Pool. Also, grab samples for tritium are required when either the reactor well or the dryer separator pool is filled. These samples are taken at the Reactor Building Exhaust Plenum and Standby Gas Treatment System (SGTS) when operating.

Gaseous releases of Carbon-14 may be determined by calculation, without the use of sampling. An acceptable calculational method is to determine monthly capacity factor data in units of GWth-month from Reactor Engineering data, then multiply by the ratio of days in the month to days in the year and by the value 5.1 Ci per GWth-year (given in EPRI report 1021106, December 2010) to obtain monthly C-14 releases. Other methods may be used if approved by Radiation Protection Management.

4/13

### 7.3 Gaseous Effluent Monitor Setpoint Determination

#### 7.3.1 Ventilation System Monitors

Per the requirements of ODCM 3.3.7.12, alarm setpoints shall be established for the gaseous effluent monitoring instrumentation to ensure that the release rate of noble gases does not exceed the limits of ODCM 3.11.2.1. This section limits releases to a dose rate at the SITE BOUNDARY of 500 mrem/year to the total body or 3000 mrem/year to the skin. From a grab sample analysis of the applicable release (i.e., grab sample of the primary containment or Ventilation System release), the radiation monitoring alarm setpoints may be established by the following calculational method. The measured radionuclide concentrations and release rate are used to calculate the fraction of the allowable release rate, limited by ODCM 3.11.2.1, by the equation:

$$FRAC = \frac{1.67E+01 * \chi / Q * VF * \sum (C_i * K_i)}{500} \quad (7-1)$$

$$FRAC = \frac{1.67E+01 * \chi / Q * VF * \sum (C_i * [L_i + 1.1M_i])}{3000} \quad (7-2)$$

Where:

- FRAC = fraction of the allowable release rate based on the identified radionuclide concentrations and the release flow rate
- $\chi / Q$  = annual average meteorological dispersion to the controlling site boundary location from Table 7.0-3 (sec/m<sup>3</sup>) or plant procedures
- VF = Ventilation System flow rate for the applicable release point and monitor (liters/minute)
- C<sub>i</sub> = concentration of noble gas radionuclide i at release point as determined by gamma spectral analysis of grab sample (μCi/cc).
- K<sub>i</sub> = total body dose conversion factor for noble gas radionuclide i (mrem/yr per μCi/m<sup>3</sup>, from Table 7.0-2)
- L<sub>i</sub> = beta skin dose conversion factor for noble gas radionuclide i (mrem/yr per μCi/m<sup>3</sup>, from Table 7.0-2)

- $M_i$  = gamma air dose conversion factor for noble gas radionuclide  $i$  (mrad/yr per  $\mu\text{Ci}/\text{m}^3$ , from Table 7.0-2)  
 1.1 = mrem skin dose per mrad gamma air dose (mrem/mrad)  
 500 = total body dose rate limit (mrem/yr)  
 3000 = skin dose rate limit (mrem/yr)  
 $1.67 \text{ E} + 01$  =  $1 \text{ E} + 03$  (cc/liter) \* (1/60) (min/sec)

Based on the more limiting (i.e., higher) value of FRAC as determined above, the alarm setpoints for the applicable monitors may be calculated by the equation:

$$SP \leq \frac{(AF * \sum C_i)}{FRAC} + Bkg \quad (7-3)$$

Where:

- $SP$  = alarm setpoint corresponding to the maximum allowable release rate ( $\mu\text{Ci}/\text{cc}$ )  
 $Bkg$  = background of the monitor ( $\mu\text{Ci}/\text{cc}$ )  
 $AF$  = administrative allocation factor (Table 7.0-1) for the specific monitor and type release, which corresponds to the fraction of the total allowable release rate that is administratively allocated to the individual release points.  
 $C_i$  = concentration of Noble Gas Radionuclide  $i$  as determined by gamma spectral analysis of grab sample ( $\mu\text{Ci}/\text{cc}$ ). Note: If the monitor channel in question was showing a response to the effluent at the time of the grab sample, this response minus background may be used in lieu of the summed grab sample concentrations.



The Allocation Factor (AF) is an administrative control imposed to ensure that combined releases from all release points at Fermi 2 will not exceed the regulatory limits on release rate from the site (i.e., the release rate limits of ODCM 3.11.2.1). From the Fermi 2 design evaluation of gaseous effluents presented in the UFSAR Section 11.3, representative values have been determined for AF. These values are presented in Table 7.0-1. These values may be changed in the future as warranted by operational experience, provided the site releases comply with ODCM 3.11.2.1. In addition to the allocation factor, safety factors which have the effect of lowering the calculated setpoints may be applied. When determining the Noble Gas Monitor calibration constant, the monitor sensitivity for Xe-133 may be used in lieu of the sensitivity values for the individual radionuclides. Because of its lower gamma energy and corresponding monitor response, the Xe-133 sensitivity provides a conservative value for alarm setpoint determination. Alternatively, if the monitor channel in question frequently shows a response to a mix of isotopes whose concentrations can be determined, the calibration constant may be determined from this type of data without reference to primary calibration data.

### 7.3.2 Setpoint Determination with No Nuclides Detected

When noble gas concentrations for a release point cannot be determined from grab samples, there are two options for setpoint determination. First, the setpoint may be set slightly above monitor background (e.g. 2 to 3 times background). This approach may be used when releases are not expected from a particular release point. Second, the equations of Section 7.3.1 may be used with noble gas concentration values based either on UFSAR tables or on values from a release point for which concentrations have been determined (e.g. reactor building exhaust plenum). When this method is used, a safety factor should be used in the setpoint calculation.

### 7.3.3 Gaseous Effluent Alarm Response - Evaluating Actual Release Conditions

The monitor alarm setpoint is used as the primary method for ensuring and demonstrating compliance with the release rate limits of ODCM 3.11.2.1. Not exceeding alarm setpoints constitutes a demonstration that release rates have been maintained within the ODCM limits. When an effluent Noble Gas Monitor exceeds the alarm setpoint, an evaluation of compliance with the release rate limits must be performed using actual release conditions. This evaluation requires collecting a sample of the effluent to establish actual radionuclide concentrations and permit evaluating the monitor response. The following equations may be used for evaluating compliance with the release rate limit of ODCM 3.11.2.1a:

$$D_{th} = 1.67E+01 * \chi / Q * VF * \sum (K_i * C_i) \quad (7-4)$$

$$D_s = 1.67E+01 * \chi / Q * VF * \sum ([L_i + 1.1M_i] * C_i) \quad (7-5)$$

Where:

- $D_{tb}$  = total body dose rate (mrem/yr)
- $D_s$  = skin dose rate (mrem/yr)
- $\chi/Q$  = atmospheric dispersion to the controlling SITE BOUNDARY location ( $\text{sec}/\text{m}^3$ )
- VF = Ventilation System release rate (liters/min)
- $C_i$  = concentration of radionuclide i as measured in the grab sample or as correlated from the SPING Noble Gas Monitor reading ( $\mu\text{Ci}/\text{cc}$ )
- $K_i$  = total body dose conversion factor for noble gas radionuclide i (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ , from Table 7.0-2)
- $L_i$  = beta skin dose conversion factor for noble gas radionuclide i (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ , from Table 7.0-2)
- $M_i$  = gamma air dose conversion factor for noble gas radionuclide i (mrad/yr per  $\mu\text{Ci}/\text{m}^3$ , from Table 7.0-2)
- 1.1 = mrem skin dose per mrad gamma air dose (mrem/mrad)
- $1.67 \text{ E} + 01 = 1 \text{ E} + 03 (\text{cc}/\text{liter}) * (1/60) (\text{min}/\text{sec})$

The above equations may also be used to verify compliance with ODCM 3.11.2.1.a when noble gases are detected in periodic (e.g. monthly) effluent noble gas samples.

## 7.4 Primary Containment VENTING and PURGING

### 7.4.1 Release Rate Evaluation

For primary containment VENTING or PURGING, an evaluation of acceptable release rate may be performed prior to the release. Based on the measured noble gas concentration in the grab sample collected per the requirements of ODCM Table 4.11.2.1.2-1, the allowable release rate from primary containment can be calculated by the following equation:

$$RR_{tb} = \frac{500 * AF}{1.67 + 01 * \chi / Q * \sum (K_i * C_i)} \quad (7-6)$$

or

$$RR_s = \frac{3000 * AF}{1.67E + 01 * \chi / Q * \sum ([L_i + 1.1M_i] * C_i)} \quad (7-7)$$

Where:

- RR<sub>tb</sub> = allowable release rate so as not to exceed a dose rate of 500 mrem/yr, total body (liters/minute)
- RR<sub>s</sub> = allowable release rate so as not to exceed a dose rate of 3000 mrem/yr, skin (liters/minute)
- AF = allocation factor for the applicable release point from Table 7.0-1 (default value is 0.5 for Reactor Building Exhaust Plenum)
- 500 = total body dose rate limit (mrem/yr)
- 3000 = skin dose rate limit (mrem/yr)

The lesser value (RR<sub>tb</sub> or RR<sub>s</sub>) as calculated above may be used for establishing the allowable release rate for primary containment PURGING or VENTING, taking into account the fraction of the allocated release limit already accounted for by continuous releases from the proposed release point. As discussed in section 7.2.1, this evaluation is rarely necessary.

#### 7.4.2 Alarm Setpoint Evaluation

For a primary containment VENTING or PURGING, a re-evaluation of the alarm setpoint may be needed to ensure compliance with the requirements of ODCM 3.3.7.12. For the identified release path (RB Exhaust Plenum or SGTS) and associated effluent Radiation Monitor, the alarm setpoint should be calculated using Equations (7-1), (7-2) and (7-3). In Equations (7-1) and (7-2), the value of the Ventilation Flow VF should be established at the total release flow rate, including the contribution from the PURGE or VENT. If the calculated alarm setpoint is greater than the current setpoint, no adjustments are necessary. As discussed in section 7.2.1, this setpoint evaluation is rarely necessary.

## 7.5 Quantifying Releases - Noble Gases

The determination of doses in the environment from releases is dependent on the mixture of the radioactive material. Also, NRC Regulatory Guide 1.21 requires reporting of individual radionuclides released in gaseous effluents. Therefore, Detroit Edison must determine the quantities of the individual radionuclides released. For noble gases, these quantities must be based on actual noble gas grab samples.

### 7.5.1 Sampling Protocol

As required by ODCM 3.11.2.1, a gas sample is collected at least monthly from each of the five gaseous release points (Reactor Building Exhaust Plenum, Standby Gas Treatment System, Radwaste Building, Turbine Building, and Onsite Storage Facility). As discussed in ODCM Section 7.2.2, this gas sample is analyzed by gamma spectroscopy to identify individual radionuclides (noble gases). Noble gases have been detected almost exclusively in the reactor building effluent.

As necessary to supplement grab sampling at the Reactor Building Exhaust Plenum, samples are taken from the Offgas Vent Pipe sample lines, normally on the same frequency as RB Exhaust Plenum samples. The Offgas Vent Pipe sample point is upstream of the RB Exhaust Plenum and noble gases are more concentrated at this point. Dilution factors are applied to Offgas Vent Pipe noble gas sample concentrations when the same nuclides are detected in both locations so that concentrations detected in RB Exhaust Plenum samples may be compared to concentrations based on Offgas Vent Pipe samples; the more conservative concentration values are used in release calculations.

For containment purges and containment ventings when monitoring is alarming or not FUNCTIONALLY CAPABLE, samples are collected prior to the initiation of the release and, for long releases, periodically throughout the release (see ODCM Section 7.2.1). When detected activity concentrations are above a pre-determined threshold, these samples are evaluated using Equations (7-4) and (7-5), using release rates applicable to the vent/purge condition and taking continuous releases into account, to ensure that the site boundary dose rate limits of ODCM 3.11.2.1 are not exceeded. If the primary containment atmosphere has equilibrated with the reactor building atmosphere, vent/purge sampling and analysis is not required. Such equilibrium with the drywell atmosphere may be considered to be established after at least one of the drywell equipment hatches has been open for 8 hours, and equilibrium with the torus atmosphere may be assumed after at least one torus hatch has been open for 8 hours.

As required by ODCM Table 4.11.2.1.2-1, special samples are required of the RB Exhaust Plenum and SGTS following shutdown, startup or a THERMAL POWER change exceeding 15% within a 1 hour period. Exceptions to this special sampling are allowed as noted previously in ODCM Section 7.2.2.

## 7.6 Calculation of Activity Released

The following equation may be used for determining the release quantities from any release point based on the sample analysis:

$$Q_i = 1.0E + 03 * VF * T * C_i \quad (7-8)$$

Where:

- $Q_i$  = total activity released of radionuclide i ( $\mu\text{Ci}$ )
- $VF$  = Ventilation System release rate (liters/min) -- nominal values are shown in Table 7.0-1. If available, more accurate values, for example reflecting a reduced number of exhaust fans in service, may be used.
- $T$  = total time of release period (min)
- $1.0 E + 03$  = milliliters per liter
- $C_i$  = concentration of radionuclide i as determined by analysis of the sample ( $\mu\text{Ci/cc}$ ). For noble gas grab samples, this value may be corrected for variations during the release period by multiplying by the ratio of the average noble gas monitor reading during the release period to the reading at the time the sample was taken. For iodine and particulate samples, this value should be corrected for decay during the sampling period, for sample line loss if adequate data are available, and for collection efficiency if a significant fraction of the material to be collected passes through the collection media. For all samples, this value should be corrected for decay between sample collection and counting and for decay during counting.

4/13

## 7.7 Site Boundary Dose Rate - Radiiodine and Particulates

ODCM 3.11.2.1.b limits the dose rate to  $\leq 1500$  mrem/yr to any organ for I-131, I-133, tritium and particulates with half lives greater than 8 days. To demonstrate compliance with this limit, an evaluation is performed at a frequency no greater than that corresponding to the sampling and analysis time period (nominally once per 7 days). The following equation may be used in the dose rate evaluation for I-131, I-133, and particulates with half lives greater than 8 days:

$$DR = \sum_r \left( \chi / Q_r * R_{I-131} * VF_r * 16.7 * \sum_i C_{ir} \right) \quad (7-9)$$

14/13

Where:

- DR = total maximum organ dose rate for all release points (mrem/yr)
- $\chi / Q_r$  = atmospheric dispersion factor for release point r to the controlling SITE BOUNDARY location (sec/m<sup>3</sup>) from Table 7-3 or plant procedures
- $R_{I-131}$  = I-131 child thyroid inhalation pathway dose factor (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) from Table 7-4
- $VF_r$  = Average ventilation flow for release point r during release period (liters/min)
- $C_{ir}$  = Concentration of radionuclide i (I-131, I-133, or particulate with half life greater than 8 days) released from release point r during the appropriate release period ( $\mu\text{Ci}/\text{cc}$ )--usually determined by gamma spectral analysis of effluent sample and corrected as described in definition of  $C_i$  in section 7.6
- 16.7 = 1000 cc/liter \* 0.0167 min/sec

Release periods used in Equation (7-9) are the most recent periods evaluated for the different release points, and these periods may not be identical.

Alternatively, the site boundary dose rate may be evaluated using the highest individual isotopic dose factors for all age groups to calculate inhalation and ground plane exposure at the highest dispersion factor location at or beyond the site boundary, as well as vegetation, milk, and meat exposure at the garden, milk, and meat locations with the highest deposition factors. Dose rate due to tritium is currently evaluated by this method, and when tritium has been detected in gaseous effluents during the most recent release period, the tritium dose rate must be added to the result from Equation (7-9) to evaluate compliance with ODCM 3.11.2.1.b.

The dose rate evaluation described above may have to be performed more frequently than once per week in order to meet the requirements of ODCM Table 4.11.2.1.2-1, footnote g: Daily sampling is required following startup, shutdown, or thermal power changes exceeding 15% in one hour if the applicable noble gas effluent monitor reading has increased by a factor of 3.

## 7.8 Noble Gas Effluent Dose Calculations - 10 CFR 50

### 7.8.1 UNRESTRICTED AREA Dose - Noble Gases

ODCM 4.11.2.2 requires that an assessment of releases of noble gases be performed at least once per 31 days to evaluate compliance with the quarterly dose limits of 5 mrad, gamma-air and 10 mrad, beta-air and the calendar year limits 10 mrad, gamma-air and 20 mrad, beta-air. The following equations may be used to calculate the gamma-air and beta-air doses. If noble gases are detected at multiple release points, these equations must be performed for each such release point, and the calculated air doses must be summed.

$$D_{\gamma} = 3.17E-08 * \chi/Q * \sum(M_i * Q_i) \quad (7-10)$$

and

$$D_{\beta} = 3.17E-08 * \chi/Q * \sum(N_i * Q_i) \quad (7-11)$$

Where:

- $D_{\gamma}$  = air dose due to gamma emissions for noble gas radionuclides (mrad)
- $D_{\beta}$  = air dose due to beta emissions for noble gas radionuclides (mrad)
- $\chi/Q$  = atmospheric dispersion to the controlling SITE BOUNDARY location ( $\text{sec}/\text{m}^3$ )
- $Q_i$  = cumulative release of noble gas radionuclide i over the period of interest ( $\mu\text{Ci}$ )
- $M_i$  = air dose factor due to gamma emissions from noble gas radionuclide i ( $\text{mrad}/\text{yr}$  per  $\mu\text{Ci}/\text{m}^3$ , from Table 7.0-2)
- $N_i$  = air dose factor due to beta emissions from noble gas radionuclide i ( $\text{mrad}/\text{yr}$  per  $\mu\text{Ci}/\text{m}^3$ , Table 7.0-2)
- $3.17 E - 08 = 1/3.15 E + 07$  (year/sec)

Note: Page content was last changed with ODCM Revision 15.

## 7.9 Radioiodine and Particulate Dose Calculations - 10 CFR 50

### 7.9.1 UNRESTRICTED AREA Dose - Radioiodine, Particulates, and Tritium

In accordance with requirements of ODCM 4.11.2.3, a periodic assessment (at least once per 31 days) is required to evaluate compliance with the quarterly dose limit of 7.5 mrem and the calendar year limit of 15 mrem to any organ. The following equation may be used to evaluate the maximum organ dose due to releases of I-131, I-133, tritium, and particulates with half-lives greater than 8 days:

$$D_{ao} = \sum_p \sum_r \sum_i (W_r * SF_p * 3.17E-8 * R_{aipo} * Q_{ir}) \quad (7-14)$$

Where:

$D_{ao}$  = dose or dose commitment to Organ o of age group a (identified in Table 7.0-3 or plant procedures)

$W_r$  = atmospheric dispersion parameter for release point r and the residence location identified in Table 7.0-3 or plant procedures. Either:

- a)  $X/Q$ , atmospheric dispersion for inhalation pathway and H-3 and C-14 dose contribution via other pathways ( $\text{sec}/\text{m}^3$ ), or
- b)  $D/Q$ , atmospheric deposition for vegetation, milk and ground plane exposure pathways ( $\text{m}^{-2}$ )

$R_{aipo}$  = dose factor ( $\text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{m}^3$ ) or ( $\text{m}^2 - \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) from Table 7.0-4 for radionuclide i, age group a, pathway p, and organ o as identified in Table 7.0-3 or plant procedures. Values for  $R_{aipo}$  were derived in accordance with the methods described in NUREG-0133. As noted in NUREG-0133 section 5.3.1.3, in the case that the milk animal is a goat, parameter values from Reg Guide 1.109 should be used. For I-131, for example, use of the goat feed/forage consumption rate given in Table E-3 and the stable element transfer factor given in Table E-2 of Reg Guide 1.109 results in grass-goat-milk dose factors which are equivalent to the grass-cow-milk dose factors in Table 7.0-4 multiplied by 1.2.

Note: Page content was last changed with ODCM Revision 15.



$Q_{ir}$  = cumulative release from release point  $r$  over the period of interest (normally one month) for radionuclide  $i$  -- I-131, I-133, tritium or radioactive material in particulate form with half-life greater than 8 days ( $\mu\text{Ci}$ ).

$SF_p$  = annual seasonal correction factor to account for the fraction of the year that the applicable exposure pathway does not exist:

1) For milk and vegetation exposure pathways:

= 0.5 (derived from Reg Guide 1.109, Rev 1. A six month fresh vegetation and grazing season (May through October) limits exposure through this pathway to half the year.

2) For inhalation and ground plane exposure pathways:

= 1.0 (derived from Reg Guide 1.109, Rev 1)

$3.17 \text{ E-}8 = 1 / 3.15 \text{ E}7 \text{ (year/sec)}$

This equation should be used to evaluate organ doses for the individual with the highest potential offsite dose. This calculation is performed monthly and is added to previous results for the quarter and year. The highest quarterly and annual cumulative organ dose totals for this individual should be compared with the limits of ODCM 3.11.2.3.

The residence, age group, and relevant exposure pathways for this individual are listed in Table 7.0-3 and in plant procedures. Plant procedures may provide updated information which differs from Table 7.0-3. This individual is identified from data obtained in the annual Land Use Census (ODCM 3.12.2).

## 7.10 Gaseous Effluent Dose Projection

As with liquid effluents, the Fermi 2 ODCM controls on gaseous effluents require "processing" of gaseous effluents if the projected dose exceeds specified limits. These controls implement the requirements of 10 CFR 50.36a on maintaining and using the appropriate radwaste processing equipment to keep releases ALARA.

ODCM 3.11.2.5 requires that the VENTILATION EXHAUST TREATMENT SYSTEM be used to reduce radioactive material levels prior to discharge when the projected dose exceeds 0.3 mrem to any organ in any 31 day period (i.e., one-quarter of the design objective rate). Figure 7.0-1 presents the gaseous effluent release points and the VENTILATION EXHAUST TREATMENT SYSTEMS applicable for reducing effluents prior to release.

Dose projection is performed at least once per 31 days using the following equation:

$$D_{\max p} = D_{\max} * (31 / d) \quad (7-16)$$

Where:

$D_{\max p}$  = maximum organ dose projection for the next 31 day period (mrem)

**NOTE:** The reference calendar quarter is normally the current calendar quarter. If the dose projection is done in the first month of the quarter and is to be based on dose calculated for the previous quarter, the reference calendar quarter is the previous quarter.

$D_{\max}$  = the cumulative maximum organ dose from the beginning of the reference calendar quarter (normally the current quarter) to the end of the most recently evaluated release period as determined by Equation (7-14) or (7-15) (mrem)

$d$  = number of days from the beginning of the reference calendar quarter to the end of the most recently evaluated release period.

31 = number of days in projection

TABLE 7.0-1

Values for Evaluating Gaseous  
Release Rates and Alarm Setpoints

Release Point	Flow Rate (liter/min)	Allocation Factor (AF)	Allocated Dose Rate Limit (mrem/year)
Reactor Building Exhaust Plenum D11-P280	2.89E6	0.50	T Body = 250 Skin = 1500 Organ = 750
Standby Gas Treatment System Div I D11-P275	1.07E5	0.10	T Body = 50 Skin = 300 Organ = 150
Standby Gas Treatment System Div II D11-P276	1.12E5	0.10	T Body = 50 Skin = 300 Organ = 150
Turbine Building Ventilation D11-P279	8.98E6	0.20	T Body = 100 Skin = 600 Organ = 300
Radwaste Building Ventilation D11-P281	1.01E6	0.02	T Body = 10 Skin = 60 Organ = 30
Onsite Storage Building Ventilation D11-P299	3.06E5	0.02	T Body = 10 Skin = 60 Organ = 30
Reactor Building Ventilation* Gulf Atomic Monitors D11-N408, N410	2.57E6	0.50	T Body = 125 Skin = 750 Organ = 375

1 4/13

1 4/13

1 4/13

\* D11-N408 and N410 will start the SGTS, close the Drywell Purge/Vent Valves, isolate Rx Building Ventilation System, isolate Control Center, and initiate emergency recirculation mode.

TABLE 7.0-2

Dose Factors for Noble Gases\*

Nuclide	Total Body Gamma Dose Factor $K_j$ (mrem/yr per $\mu\text{Ci}/\text{m}^3$ )	Skin Beta Dose Factor $L_j$ (mrem/yr per $\mu\text{Ci}/\text{m}^3$ )	Gamma Air Dose Factor $M_j$ (mrad/yr per $\mu\text{Ci}/\text{m}^3$ )	Beta Air Dose Factor $N_j$ (mrad/yr per $\mu\text{Ci}/\text{m}^3$ )
Kr-83m	7.56E-02	----	1.93E+01	2.88E+02
Kr-85m	1.17E+03	1.46E+03	1.23E+03	1.97E+03
Kr-85	1.61E+01	1.34E+03	1.72E+01	1.95E+03
Kr-87	5.92E+03	9.73E+03	6.17E+03	1.03E+04
Kr-88	1.47E+04	2.37E+03	1.52E+04	2.93E+03
Kr-89	1.66E+04	1.01E+04	1.73E+04	1.06E+04
Kr-90	1.56E+04	7.29E+03	1.63E+04	7.83E+03
Xe-131m	9.15E+01	4.76E+02	1.56E+02	1.11E+03
Xe-133m	2.51E+02	9.94E+02	3.27E+02	1.48E+03
Xe-133	2.94E+02	3.06E+02	3.53E+02	1.05E+03
Xe-135m	3.12E+03	7.11E+02	3.36E+03	7.39E+02
Xe-135	1.81E+03	1.86E+03	1.92E+03	2.46E+03
Xe-137	1.42E+03	1.22E+04	1.51E+03	1.27E+04
Xe-138	8.83E+03	4.13E+03	9.21E+03	4.75E+03
Ar-41	8.84E+03	2.69E+03	9.30E+03	3.28E+03

NOTE:

\* Dose factors taken from NRC Regulatory Guide 1.109

TABLE 7.0-3

**Controlling Locations, Pathways, and Atmospheric  
Dispersion for Dose Calculations\***

ODCM Control	Location	Pathway(s)	Controlling Age Group	$\lambda/Q$ (sec/m <sup>3</sup> )	D/Q (1/m <sup>2</sup> )
3.11.2.1a	site boundary (0.57 mi, NW)	noble gases direct exposure	N/A	RB: 1.25E-6 TB: 5.71E-6 RW: 2.66E-6	N/A
3.11.2.1b	site boundary (0.57 mi, NW)	inhalation	child	RB: 1.25E-6 TB: 5.71E-6 RW: 2.66E-6	N/A
3.11.2.2	site boundary (0.57 mi, NW)	gamma-air beta-air	N/A	RB: 1.25E-6 TB: 5.71E-6 RW: 2.66E-6	N/A
11.2.3	residence (0.71 mi, WNW)	vegetation inhalation, and ground plane	adult	RB: 1.10E-6 TB: 4.02E-6 RW: 1.53E-6	1.59E-8 3.06E-8 1.76E-8

**NOTE:** \*The identified controlling locations and pathways are derived from land use census data and dispersion and deposition factor data tables. The dispersion and deposition factor values listed are conservative values; they represent the highest annual average values seen at that location for a period of several years.

Table 7.0-4  
 Gaseous Effluent Pathway Dose Commitment Factors  
 Raipo, Inhalation Pathway Dose Factors - ADULT  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ )

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T.Body
H-3	-	1.26E+3	1.26E+3	1.26E+3	1.26E+3	1.26E+3	1.26E+3
C-14	1.82E+4	3.41E+3	3.41E+3	3.41E+3	3.41E+3	3.41E+3	3.41E+3
Na-24	1.02E+4	1.02E+4	1.02E+4	1.02E+4	1.02E+4	1.02E+4	1.02E+4
P-32	1.32E+6	7.71E+4	-	-	-	8.64E+4	5.01E+4
Cr-51	-	-	5.95E+1	2.28E+1	1.44E+4	3.32E+3	1.00E+2
Mn-54	-	3.96E+4	-	9.84E+3	1.40E+6	7.74E+4	6.30E+3
Mn-56	-	1.24E+0	-	1.30E+0	9.44E+3	2.02E+4	1.83E-1
Fe-55	2.46E+4	1.70E+4	-	-	7.21E+4	6.03E+3	3.94E+3
Fe-59	1.18E+4	2.78E+4	-	-	1.02E+6	1.88E+5	1.06E+4
Co-57	-	6.92E+2	-	-	3.70E+5	3.14E+4	6.71E+2
Co-58	-	1.58E+3	-	-	9.28E+5	1.06E+5	2.07E+3
Co-60	-	1.15E+4	-	-	5.97E+6	2.85E+5	1.48E+4
Ni-63	4.32E+5	3.14E+4	-	-	1.78E+5	1.34E+4	1.45E+4
Ni-65	1.54E+0	2.10E-1	-	-	5.60E+3	1.23E+4	9.12E-2
Cu-64	-	1.46E+0	-	4.62E+0	6.78E+3	4.90E+4	6.15E-1
Zn-65	3.24E+4	1.03E+5	-	6.90E+4	8.64E+5	5.34E+4	4.66E+4
Zn-69	3.38E-2	6.51E-2	-	4.22E-2	9.20E+2	1.63E+1	4.52E-3
Br-82	-	-	-	-	-	1.04E+4	1.35E+4
Br-83	-	-	-	-	-	2.32E+2	2.41E+2
Br-84	-	-	-	-	-	1.64E-3	3.13E+2
Br-85	-	-	-	-	-	-	1.28E+1
Rb-86	-	1.35E+5	-	-	-	1.66E+4	5.90E+4
Rb-88	-	3.87E+2	-	-	-	3.34E-9	1.93E+2
Rb-89	-	2.56E+2	-	-	-	-	1.70E+2
Sr-89	3.04E+5	-	-	-	1.40E+6	3.50E+5	8.72E+3
Sr-90	9.92E+7	-	-	-	9.60E+6	7.22E+5	6.10E+6
Sr-91	6.19E+1	-	-	-	3.65E+4	1.91E+5	2.50E+0
Sr-92	6.74E+0	-	-	-	1.65E+4	4.30E+4	2.91E-1
Y-90	2.09E+3	-	-	-	1.70E+5	5.06E+5	5.61E+1
Y-91m	2.61E-1	-	-	-	1.92E+3	1.33E+0	1.02E-2
Y-91	4.62E+5	-	-	-	1.70E+6	3.85E+5	1.24E+4
Y-92	1.03E+1	-	-	-	1.57E+4	7.35E+4	3.02E-1
Y-93	9.44E+1	-	-	-	4.85E+4	4.22E+5	2.61E+0
Zr-95	1.07E+5	3.44E+4	-	5.42E+4	1.77E+6	1.50E+5	2.33E+4
Zr-97	9.68E+1	1.96E+1	-	2.97E+1	7.87E+4	5.23E+5	9.04E+0
Nb-95	1.41E+4	7.82E+3	-	7.74E+3	5.05E+5	1.04E+5	4.21E+3
Nb-97	2.22E-1	5.62E-2	-	6.54E-2	2.40E+3	2.42E+2	2.05E-2
Mo-99	-	1.21E+2	-	2.91E+2	9.12E+4	2.48E+5	2.30E+1
Tc-99m	1.03E-3	2.91E-3	-	4.42E-2	7.64E+2	4.16E+3	3.70E-2
Tc-101	4.18E-5	6.02E-5	-	1.08E-3	3.99E+2	-	5.90E-4
Ru-103	1.53E+3	-	-	5.83E+3	5.05E+5	1.10E+5	6.58E+2
Ru-105	7.90E-1	-	-	1.02E+0	1.10E+4	4.82E+4	3.11E-1
Ru-106	6.91E+4	-	-	1.34E+5	9.36E+6	9.12E+5	8.72E+3
Rh-103m	-	-	-	-	-	-	-
Rh-106	-	-	-	-	-	-	-
Ag-110m	1.08E+4	1.00E+4	-	1.97E+4	4.63E+6	3.02E+5	5.94E+3
Sb-124	3.12E+4	5.89E+2	7.55E+1	-	2.48E+6	4.06E+5	1.24E+4
Sb-125	5.34E+4	5.95E+2	5.40E+1	-	1.74E+6	1.01E+5	1.26E+4
Te-125m	3.42E+3	1.58E+3	1.05E+3	1.24E+4	3.14E+5	7.06E+4	4.67E+2
Te-127m	1.26E+4	5.77E+3	3.29E+3	4.58E+4	9.60E+5	1.50E+5	1.57E+3
Te-127	1.40E+0	6.42E-1	1.06E+0	5.10E+0	6.51E+3	5.74E+4	3.10E-1
Te-129m	9.76E+3	4.67E+3	3.44E+3	3.66E+4	1.16E+6	3.83E+5	1.58E+3
Te-129	4.98E-2	2.39E-2	3.90E-2	1.87E-1	1.94E+3	1.57E+2	1.24E-2
Te-131m	6.99E+1	4.36E+1	5.50E+1	3.09E+2	1.40E+5	5.56E+5	2.90E+1
Te-131	1.11E-2	5.95E-3	9.36E-3	4.37E-2	1.39E+3	1.84E+1	3.59E-3
Te-132	2.60E+2	2.15E+2	1.90E+2	1.46E+3	2.88E+5	5.10E+5	1.62E+2
I-130	4.58E+3	1.34E+4	1.14E+6	2.09E+4	-	7.69E+3	5.28E+3
I-131	2.52E+4	3.58E+4	1.19E+7	6.13E+4	-	6.28E+3	2.05E+4
I-132	1.16E+3	3.26E+3	1.14E+5	5.18E+3	-	4.06E+2	1.16E+3
I-133	8.64E+3	1.48E+4	2.15E+6	2.58E+4	-	8.88E+3	4.52E+3

Table 7.0-4  
Gaseous Effluent Pathway Dose Commitment Factors  
Raipo, Inhalation Pathway Dose Factors - ADULT (cont.)  
(mrem/yr per  $\mu\text{Ci}/\text{m}^3$ )

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T. Body
I-134	6.44E+2	1.73E+3	2.98E+4	2.75E+3	-	1.01E+0	6.15E+2
I-135	2.68E+3	6.98E+3	4.48E+5	1.11E+4	-	5.25E+3	2.57E+3
Cs-134	3.73E+5	8.48E+5	-	2.87E+5	9.76E+4	1.04E+4	7.28E+5
Cs-136	3.90E+4	1.46E+5	-	8.56E+4	1.20E+4	1.17E+4	1.10E+5
Cs-137	4.78E+5	6.21E+5	-	2.22E+5	7.52E+4	8.40E+3	4.28E+5
Cs-138	3.31E+2	6.21E+2	-	4.80E+2	4.86E+1	1.86E-3	3.24E+2
Ba-139	9.36E-1	6.66E-4	-	6.22E-4	3.76E+3	8.96E+2	2.74E-2
Ba-140	3.90E+4	4.90E+1	-	1.67E+1	1.27E+6	2.18E+5	2.57E+3
Ba-141	1.00E-1	7.53E-5	-	7.00E-5	1.94E+3	1.16E-7	3.36E-3
Ba-142	2.63E-2	2.70E-5	-	2.29E-5	1.19E+3	-	1.66E-3
La-140	3.44E+2	1.74E+2	-	-	1.36E+5	4.58E+5	4.58E+1
La-142	6.83E-1	3.10E-1	-	-	6.33E+3	2.11E+3	7.72E-2
Ce-141	1.99E+4	1.35E+4	-	6.26E+3	3.62E+5	1.20E+5	1.53E+3
Ce-143	1.86E+2	1.38E+2	-	6.08E+1	7.98E+4	2.26E+5	1.53E+1
Ce-144	3.43E+6	1.43E+6	-	8.48E+5	7.78E+6	8.16E+5	1.84E+5
Pr-143	9.36E+3	3.75E+3	-	2.16E+3	2.81E+5	2.00E+5	4.64E+2
Pr-144	3.01E-2	1.25E-2	-	7.05E-3	1.02E+3	2.15E-8	1.53E-3
Nd-147	5.27E+3	6.10E+3	-	3.56E+3	2.21E+5	1.73E+5	3.65E+2
W-187	8.48E+0	7.08E+0	-	-	2.90E+4	1.55E+5	2.48E+0
Np-239	2.30E+2	2.26E+1	-	7.00E+1	3.76E+4	1.19E+5	1.24E+1

Table 7.0-4  
 Raipo, Inhalation Pathway Dose Factors - TEENAGER  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ )

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T.Body
H-3	-	1.27E+3	1.27E+3	1.27E+3	1.27E+3	1.27E+3	1.27E+3
C-14	2.60E+4	4.87E+3	4.87E+3	4.87E+3	4.87E+3	4.87E+3	4.87E+3
Na-24	1.38E+4	1.38E+4	1.38E+4	1.38E+4	1.38E+4	1.38E+4	1.38E+4
P-32	1.89E+6	1.10E+5	-	-	-	9.28E+4	7.16E+4
Cr-51	-	-	7.50E+1	3.07E+1	2.10E+4	3.00E+3	1.35E+2
Mn-54	-	5.11E+4	-	1.27E+4	1.98E+6	6.68E+4	8.40E+3
Mn-56	-	1.70E+0	-	1.79E+0	1.52E+4	5.74E+4	2.52E-1
Fe-55	3.34E+4	2.38E+4	-	-	1.24E+5	6.39E+3	5.54E+3
Fe-59	1.59E+4	3.70E+4	-	-	1.53E+6	1.78E+5	1.43E+4
Co-57	-	6.92E+2	-	-	5.86E+5	3.14E+4	9.20E+2
Co-58	-	2.07E+3	-	-	1.34E+6	9.52E+4	2.78E+3
Co-60	-	1.51E+4	-	-	8.72E+6	2.59E+5	1.98E+4
Ni-63	5.80E+5	4.34E+4	-	-	3.07E+5	1.42E+4	1.98E+4
Ni-65	2.18E+0	2.93E-1	-	-	9.36E+3	3.67E+4	1.27E-1
Cu-64	-	2.03E+0	-	6.41E+0	1.11E+4	6.14E+4	8.48E-1
Zn-65	3.86E+4	1.34E+5	-	8.64E+4	1.24E+6	4.66E+4	6.24E+4
Zn-69	4.83E-2	9.20E-2	-	6.02E-2	1.58E+3	2.85E+2	6.46E-3
Br-82	-	-	-	-	-	-	1.82E+4
Br-83	-	-	-	-	-	-	3.44E+2
Br-84	-	-	-	-	-	-	4.33E+2
Br-85	-	-	-	-	-	-	1.83E+1
Rb-86	-	1.90E+5	-	-	-	1.77E+4	8.40E+4
Rb-88	-	5.46E+2	-	-	-	2.92E-5	2.72E+2
Rb-89	-	3.52E+2	-	-	-	3.38E-7	2.33E+2
Sr-89	4.34E+5	-	-	-	2.42E+6	3.71E+5	1.25E+4
Sr-90	1.08E+8	-	-	-	1.65E+7	7.65E+5	6.68E+6
Sr-91	8.80E+1	-	-	-	6.07E+4	2.59E+5	3.51E+0
Sr-92	9.52E+0	-	-	-	2.74E+4	1.19E+5	4.06E-1
Y-90	2.98E+3	-	-	-	2.93E+5	5.59E+5	8.00E+1
Y-91m	3.70E-1	-	-	-	3.20E+3	3.02E+1	1.42E-2
Y-91	6.61E+5	-	-	-	2.94E+6	4.09E+5	1.77E+4
Y-92	1.47E+1	-	-	-	2.68E+4	1.65E+5	4.29E-1
Y-93	1.35E+2	-	-	-	8.32E+4	5.79E+5	3.72E+0
Zr-95	1.46E+5	4.58E+4	-	6.74E+4	2.69E+6	1.49E+5	3.15E+4
Zr-97	1.38E+2	2.72E+1	-	4.12E+1	1.30E+5	6.30E+5	1.26E+1
Nb-95	1.86E+4	1.03E+4	-	1.00E+4	7.51E+5	9.68E+4	5.66E+3
Nb-97	3.14E-1	7.78E-2	-	9.12E-2	3.93E+3	2.17E+3	2.84E-2
Mo-99	-	1.69E+2	-	4.11E+2	1.54E+5	2.69E+5	3.22E+1
Tc-99m	1.38E-3	3.86E-3	-	5.76E-2	1.15E+3	6.13E+3	4.99E-2
Tc-101	5.92E-5	8.40E-5	-	1.52E-3	6.67E+2	8.72E-7	8.24E-4
Ru-103	2.10E+3	-	-	7.43E+3	7.83E+5	1.09E+5	8.96E+2
Ru-105	1.12E+0	-	-	1.41E+0	1.82E+4	9.04E+4	4.34E-1
Ru-106	9.84E+4	-	-	1.90E+5	1.61E+7	9.60E+5	1.24E+4
Rh-103m	-	-	-	-	-	-	-
Rh-106	-	-	-	-	-	-	-
Ag-110m	1.38E+4	1.31E+4	-	2.50E+4	6.75E+6	2.73E+5	7.99E+3
Sb-124	4.30E+4	7.94E+2	9.76E+1	-	3.85E+6	3.98E+5	1.68E+4
Sb-125	7.38E+4	8.08E+2	7.04E+1	-	2.74E+6	9.92E+4	1.72E+4
Te-125m	4.88E+3	2.24E+3	1.40E+3	-	5.36E+5	7.50E+4	6.67E+2
Te-127m	1.80E+4	8.16E+3	4.38E+3	6.54E+4	1.66E+6	1.59E+5	2.18E+3
Te-127	2.01E+0	9.12E-1	1.42E+0	7.28E+0	1.12E+4	8.08E+4	4.42E-1
Te-129m	1.39E+4	6.58E+3	4.58E+3	5.19E+4	1.98E+6	4.05E+5	2.25E+3
Te-129	7.10E-2	3.38E-2	5.18E-2	2.66E-1	3.30E+3	1.62E+3	1.76E-2
Te-131m	9.84E+1	6.01E+1	7.25E+1	4.39E+2	2.38E+5	6.21E+5	4.02E+1
Te-131	1.58E-2	8.32E-3	1.24E-2	6.18E-2	2.34E+3	1.51E+1	5.04E-3
Te-132	3.60E+2	2.90E+2	2.46E+2	1.95E+3	4.49E+5	4.63E+5	2.19E+2
I-130	6.24E+3	1.79E+4	1.49E+6	2.75E+4	-	9.12E+3	7.17E+3
I-131	3.54E+4	4.91E+4	1.46E+7	8.40E+4	-	6.49E+3	2.64E+4
I-132	1.59E+3	4.38E+3	1.51E+5	6.92E+3	-	1.27E+3	1.58E+3
I-133	1.22E+4	2.05E+4	2.92E+6	3.59E+4	-	1.03E+4	6.22E+3



Table 7.0-4  
Raipo, Inhalation Pathway Dose Factors - TEENAGER (Cont.)  
(mrem/yr per  $\mu\text{Ci}/\text{m}^3$ )

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T. Body
I-134	8.88E+2	2.32E+3	3.95E+4	3.66E+3	-	2.04E+1	8.40E+2
I-135	3.70E+3	9.44E+3	6.21E+5	1.49E+4	-	6.95E+3	3.49E+3
Cs-134	5.02E+5	1.13E+6	-	3.75E+5	1.46E+5	9.76E+3	5.49E+5
Cs-136	5.15E+4	1.94E+5	-	1.10E+5	1.78E+4	1.09E+4	1.37E+5
Cs-137	6.70E+5	8.48E+5	-	3.04E+5	1.21E+5	8.48E+3	3.11E+5
Cs-138	4.66E+2	8.56E+2	-	6.62E+2	7.87E+1	2.70E-1	4.46E+2
Ba-139	1.34E+0	9.44E-4	-	8.88E-4	6.46E+3	6.45E+3	3.90E-2
Ba-140	5.47E+4	6.70E+1	-	2.28E+1	2.03E+6	2.29E+5	3.52E+3
Ba-141	1.42E-1	1.06E-4	-	9.84E-5	3.29E+3	7.46E-4	4.74E-3
Ba-142	3.70E-2	3.70E-5	-	3.14E-5	1.91E+3	-	2.27E-3
La-140	4.79E+2	2.36E+2	-	-	2.14E+5	4.87E+5	6.26E+1
La-142	9.60E-1	4.25E-1	-	-	1.02E+4	1.20E+4	1.06E-1
Ce-141	2.84E+4	1.90E+4	-	8.88E+3	6.14E+5	1.26E+5	2.17E+3
Ce-143	2.66E+2	1.94E+2	-	8.64E+1	1.30E+5	2.55E+5	2.16E+1
Ce-144	4.89E+6	2.02E+6	-	1.21E+6	1.34E+7	8.64E+5	2.62E+5
Pr-143	1.34E+4	5.31E+3	-	3.09E+3	4.83E+5	2.14E+5	6.62E+2
Pr-144	4.30E-2	1.76E-2	-	1.01E-2	1.75E+3	2.35E-4	2.18E-3
Nd-147	7.86E+3	8.56E+3	-	5.02E+3	3.72E+5	1.82E+5	5.13E+2
W-187	1.20E+1	9.76E+0	-	-	4.74E+4	1.77E+5	3.43E+0
Np-239	3.38E+2	3.19E+1	-	1.00E+2	6.49E+4	1.32E+5	1.77E+1

Table 7.0-4  
Raipo Inhalation Pathway Dose Factors - CHILD  
(mrem/yr per  $\mu\text{Ci}/\text{m}^3$ )

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T.Body
H-3	-	1.12E+3	1.12E+3	1.12E+3	1.12E+3	1.12E+3	1.12E+3
C-14	3.59E+4	6.73E+3	6.73E+3	6.73E+3	6.73E+3	6.73E+3	6.73E+3
Na-24	1.61E+4	1.61E+4	1.61E+4	1.61E+4	1.61E+4	1.61E+4	1.61E+4
P-32	2.60E+6	1.14E+5	-	-	-	4.22E+4	9.88E+4
Cr-51	-	-	8.55E+1	2.43E+1	1.70E+4	1.08E+3	1.54E+2
Mn-54	-	4.29E+4	-	1.00E+4	1.58E+6	2.29E+4	9.51E+3
Mn-56	-	1.66E+0	-	1.67E+0	1.31E+4	1.23E+5	3.12E-1
Fe-55	4.74E+4	2.52E+4	-	-	1.11E+5	2.87E+3	7.77E+3
Fe-59	2.07E+4	3.34E+4	-	-	1.27E+6	7.07E+4	1.67E+4
Co-57	-	9.03E+2	-	-	5.07E+5	1.32E+4	1.07E+3
Co-58	-	1.77E+3	-	-	1.11E+6	3.44E+4	3.16E+3
Co-60	-	1.31E+4	-	-	7.07E+6	9.62E+4	2.26E+4
Ni-63	8.21E+5	4.63E+4	-	-	2.75E+5	6.33E+3	2.80E+4
Ni-65	2.99E+0	2.96E-1	-	-	8.18E+3	8.40E+4	1.64E-1
Cu-64	-	1.99E+0	-	6.03E+0	9.58E+3	3.67E+4	1.07E+0
Zn-65	4.26E+4	1.13E+5	-	7.14E+4	9.95E+5	1.63E+4	7.03E+4
Zn-69	6.70E-2	9.66E-2	-	5.85E-2	1.42E+3	1.02E+4	8.92E-3
Br-82	-	-	-	-	-	-	2.09E+4
Br-83	-	-	-	-	-	-	4.74E+2
Br-84	-	-	-	-	-	-	5.48E+2
Br-85	-	-	-	-	-	-	2.53E+1
Rb-86	-	1.98E+5	-	-	-	7.99E+3	1.14E+5
Rb-88	-	5.62E+2	-	-	-	1.72E+1	3.66E+2
Rb-89	-	3.45E+2	-	-	-	1.89E+0	2.90E+2
Sr-89	5.99E+5	-	-	-	2.16E+6	1.67E+5	1.72E+4
Sr-90	1.01E+8	-	-	-	1.48E+7	3.43E+5	6.44E+6
Sr-91	1.21E+2	-	-	-	5.33E+4	1.74E+5	4.59E+0
Sr-92	1.31E+1	-	-	-	2.40E+4	2.42E+5	5.25E-1
Y-90	4.11E+3	-	-	-	2.62E+5	2.68E+5	1.11E+2
Y-91m	5.07E-1	-	-	-	2.81E+3	1.72E+3	1.84E-2
Y-91	9.14E+5	-	-	-	2.63E+6	1.84E+5	2.44E+4
Y-92	2.04E+1	-	-	-	2.39E+4	2.39E+5	5.81E-1
Y-93	1.86E+2	-	-	-	7.44E+4	3.89E+5	5.11E+0
Zr-95	1.90E+5	4.18E+4	-	5.96E+4	2.23E+6	6.11E+4	3.70E+4
Zr-97	1.88E+2	2.72E+1	-	3.89E+1	1.13E+5	3.51E+5	1.60E+1
Nb-95	2.35E+4	9.18E+3	-	8.62E+3	6.14E+5	3.70E+4	6.55E+3
Nb-97	4.29E-1	7.70E-2	-	8.55E-2	3.42E+3	2.78E+4	3.60E-2
Mo-99	-	1.72E+2	-	3.92E+2	1.35E+5	1.27E+5	4.26E+1
Tc-99m	1.78E-3	3.48E-3	-	5.07E-2	9.51E+2	4.81E+3	5.77E-2
Tc-101	8.10E-5	8.51E-5	-	1.45E-3	5.85E+2	1.63E+1	1.08E-3
Ru-103	2.79E+3	-	-	7.03E+3	6.62E+5	4.48E+4	1.07E+3
Ru-105	1.53E+0	-	-	1.34E+0	1.59E+4	9.95E+4	5.55E-1
Ru-106	1.36E+5	-	-	1.84E+5	1.43E+7	4.29E+5	1.69E+4
Rh-103m	-	-	-	-	-	-	-
Rh-106	-	-	-	-	-	-	-
Ag-110m	1.69E+4	1.14E+4	-	2.12E+4	5.48E+6	1.00E+5	9.14E+3
Sb-124	5.74E+4	7.40E+2	1.26E+2	-	3.24E+6	1.64E+5	2.00E+4
Sb-125	9.84E+4	7.59E+2	9.10E+1	-	2.32E+6	4.03E+4	2.07E+4
Te-125m	6.73E+3	2.33E+3	1.92E+3	-	4.77E+5	3.38E+4	9.14E+2
Te-127m	2.49E+4	8.55E+3	6.07E+3	6.36E+4	1.48E+6	7.14E+4	3.02E+3
Te-127	2.77E+0	9.51E-1	1.96E+0	7.07E+0	1.00E+4	5.62E+4	6.11E-1
Te-129m	1.92E+4	6.85E+3	6.33E+3	5.03E+4	1.76E+6	1.82E+5	3.04E+3
Te-129	9.77E-2	3.50E-2	7.14E-2	2.57E-1	2.93E+3	2.55E+4	2.38E-2
Te-131m	1.34E+2	5.92E+1	9.77E+1	4.00E+2	2.06E+5	3.08E+5	5.07E+1
Te-131	2.17E-2	8.44E-3	1.70E-2	5.88E-2	2.05E+3	1.33E+3	6.59E-3
Te-132	4.81E+2	2.72E+2	3.17E+2	1.77E+3	3.77E+5	1.38E+5	2.63E+2
I-130	8.18E+3	1.64E+4	1.85E+6	2.45E+4	-	5.11E+3	8.44E+3
I-131	4.81E+4	4.81E+4	1.62E+7	7.88E+4	-	2.84E+3	2.73E+4
I-132	2.12E+3	4.07E+3	1.94E+5	6.25E+3	-	3.20E+3	1.88E+3
I-133	1.66E+4	2.03E+4	3.85E+6	3.38E+4	-	5.48E+3	7.70E+3

Table 7.0-4  
 Raipor, Inhalation Pathway Dose Factors - CHILD (Cont.)  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ )

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T. Body
I-134	1.17E+3	2.16E+3	5.07E+4	3.30E+3	-	9.55E+2	9.95E+2
I-135	4.92E+3	8.73E+3	7.92E+5	1.34E+4	-	4.44E+3	4.14E+3
Ca-134	6.51E+5	1.01E+6	-	3.30E+5	1.21E+5	3.85E+3	2.25E+5
Ca-136	6.51E+4	1.71E+5	-	9.55E+4	1.45E+4	4.18E+3	1.16E+5
Ca-137	9.07E+5	8.25E+5	-	2.82E+5	1.04E+5	3.62E+3	1.28E+5
Ca-138	6.33E+2	8.40E+2	-	6.22E+2	6.81E+1	2.70E+2	5.55E+2
Ba-139	1.84E+0	9.84E-4	-	8.62E-4	5.77E+3	5.77E+4	5.37E-2
Ba-140	7.40E+4	6.48E+1	-	2.11E+1	1.74E+6	1.02E+5	4.33E+3
Ba-141	1.96E-1	1.09E-4	-	9.47E-5	2.92E+3	2.75E+2	6.36E-3
Ba-142	5.00E-2	3.60E-5	-	2.91E-5	1.64E+3	2.74E+0	2.79E-3
La-140	6.44E+2	2.25E+2	-	-	1.83E+5	2.26E+5	7.55E+1
La-142	1.30E+0	4.11E-1	-	-	8.70E+3	7.59E+4	1.29E-1
Ce-141	3.92E+4	1.95E+4	-	8.55E+3	5.44E+5	5.66E+4	2.90E+3
Ce-143	3.66E+2	1.99E+2	-	8.36E+1	1.15E+5	1.27E+5	2.87E+1
Ce-144	6.77E+6	2.12E+6	-	1.17E+6	1.20E+7	3.89E+5	3.61E+5
Pr-143	1.85E+4	5.55E+3	-	3.00E+3	4.33E+5	9.73E+4	9.14E+2
Pr-144	5.96E-2	1.85E-2	-	9.77E-3	1.57E+3	1.97E+2	3.00E-3
Nd-147	1.08E+4	8.73E+3	-	4.81E+3	3.28E+5	8.21E+4	6.81E+2
H-187	1.63E+1	9.66E+0	-	-	4.11E+4	9.10E+4	4.33E+0
Np-239	4.66E+2	3.34E+1	-	9.73E+1	5.81E+4	6.40E+4	2.35E+1

Table 7.0-4  
Raipo, Inhalation Pathway Dose Factors - INFANT  
(mrem/yr per  $\mu\text{Ci}/\text{m}^3$ )

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T. Body
H-3	-	6.47E+2	6.47E+2	6.47E+2	6.47E+2	6.47E+2	6.47E+2
C-14	2.65E+4	5.31E+3	5.31E+3	5.31E+3	5.31E+3	5.31E+3	5.31E+3
Na-24	1.06E+4	1.06E+4	1.06E+4	1.06E+4	1.06E+4	1.06E+4	1.06E+4
P-32	2.03E+6	1.12E+5	-	-	-	1.61E+4	7.74E+4
Cr-51	-	-	5.75E+1	1.32E+1	1.28E+4	3.57E+2	8.95E+1
Mn-54	-	2.53E+4	-	4.98E+3	1.00E+6	7.06E+3	4.98E+3
Mn-56	-	1.54E+0	-	1.10E+0	1.25E+4	7.17E+4	2.21E-1
Fe-55	1.97E+4	1.17E+4	-	-	8.69E+4	1.09E+3	3.33E+3
Fe-59	1.36E+4	2.35E+4	-	-	1.02E+6	2.48E+4	9.48E+3
Co-57	-	6.51E+2	-	-	3.79E+5	4.86E+3	6.41E+2
Co-58	-	1.22E+3	-	-	7.77E+5	1.11E+4	1.82E+3
Co-60	-	8.02E+3	-	-	4.51E+6	3.19E+4	1.18E+4
Ni-63	3.39E+5	2.04E+4	-	-	2.09E+5	2.42E+3	1.16E+4
Ni-65	2.39E+0	2.84E-1	-	-	8.12E+3	5.01E+4	1.23E-1
Cu-64	-	1.88E+0	-	3.98E+0	9.30E+3	1.50E+4	7.74E-1
Zn-65	1.93E+4	6.26E+4	-	3.25E+4	6.47E+5	5.14E+4	3.11E+4
Zn-69	5.39E-2	9.67E-2	-	4.02E-2	1.47E+3	1.32E+4	7.18E-3
Br-82	-	-	-	-	-	-	1.33E+4
Br-83	-	-	-	-	-	-	3.81E+2
Br-84	-	-	-	-	-	-	4.00E+2
Br-85	-	-	-	-	-	-	2.04E+1
Rb-86	-	1.90E+5	-	-	-	3.04E+3	8.82E+4
Rb-88	-	5.57E+2	-	-	-	3.39E+2	2.87E+2
Rb-89	-	3.21E+2	-	-	-	6.82E+1	2.06E+2
Sr-89	3.98E+5	-	-	-	2.03E+6	6.40E+4	1.14E+4
Sr-90	4.09E+7	-	-	-	1.12E+7	1.31E+5	2.59E+6
Sr-91	9.56E+1	-	-	-	5.26E+4	7.34E+4	3.46E+0
Sr-92	1.05E+1	-	-	-	2.38E+4	1.40E+5	3.91E-1
Y-90	3.29E+3	-	-	-	2.69E+5	1.04E+5	8.82E+1
Y-91m	4.07E-1	-	-	-	2.79E+3	2.35E+3	1.39E-2
Y-91	5.88E+5	-	-	-	2.45E+6	7.03E+4	1.57E+4
Y-92	1.64E+1	-	-	-	2.45E+4	1.27E+5	4.61E-1
Y-93	1.50E+2	-	-	-	7.64E+4	1.67E+5	4.07E+0
Zr-95	1.15E+5	2.79E+4	-	3.11E+4	1.75E+6	2.17E+4	2.03E+4
Zr-97	1.50E+2	2.56E+1	-	2.59E+1	1.10E+5	1.40E+5	1.17E+1
Nb-95	1.57E+4	6.43E+3	-	4.72E+3	4.79E+5	1.27E+4	3.78E+3
Nb-97	3.42E-1	7.29E-2	-	5.70E-2	3.32E+3	2.69E+4	2.63E-2
Mo-99	-	1.65E+2	-	2.65E+2	1.35E+5	4.87E+4	3.23E+1
Tc-99m	1.40E-3	2.88E-3	-	3.11E-2	8.11E+2	2.03E+3	3.72E-2
Tc-101	6.51E-5	8.23E-5	-	9.79E-4	5.84E+2	8.44E+2	8.12E-4
Ru-103	2.02E+3	-	-	4.24E+3	5.52E+5	1.61E+4	6.79E+2
Ru-105	1.22E+0	-	-	8.99E-1	1.57E+4	4.84E+4	4.10E-1
Ru-106	8.68E+4	-	-	1.07E+5	1.16E+7	1.64E+5	1.09E+4
Rh-103m	-	-	-	-	-	-	-
Rh-106	-	-	-	-	-	-	-
Ag-110m	9.98E+3	7.22E+3	-	1.09E+4	3.67E+6	3.30E+4	5.00E+3
Sb-124	3.79E+4	5.56E+2	1.01E+2	-	2.65E+6	5.91E+4	1.20E+4
Sb-125	5.17E+4	4.77E+2	6.23E+1	-	1.64E+6	1.47E+4	1.09E+4
Te-125m	4.76E+3	1.99E+3	1.62E+3	-	4.47E+5	1.29E+4	6.58E+2
Te-127m	1.67E+4	6.90E+3	4.87E+3	3.75E+4	1.31E+6	2.73E+4	2.07E+3
Te-127	2.23E+0	9.53E-1	1.85E+0	4.86E+0	1.03E+4	2.44E+4	4.89E-1
Te-129m	1.41E+4	6.09E+3	5.47E+3	3.18E+4	1.68E+6	6.90E+4	2.23E+3
Te-129	7.88E-2	3.47E-2	6.75E-2	1.75E-1	3.00E+3	2.63E+4	1.88E-2
Te-131m	1.07E+2	5.50E+1	8.93E+1	2.65E+2	1.99E+5	1.19E+5	3.63E+1
Te-131	1.74E-2	8.22E-3	1.58E-2	3.99E-2	2.06E+3	8.22E+3	5.00E-3
Te-132	3.72E+2	2.37E+2	2.79E+2	1.03E+3	3.40E+5	4.41E+4	1.76E+2
I-130	6.36E+3	1.39E+4	1.60E+6	1.53E+4	-	1.99E+3	5.57E+3
I-131	3.79E+4	4.44E+4	1.48E+7	5.18E+4	-	1.06E+3	1.96E+4
I-132	1.69E+3	3.54E+3	1.69E+5	3.95E+3	-	1.90E+3	1.26E+3
I-133	1.32E+4	1.92E+4	3.56E+6	2.24E+4	-	2.16E+3	5.60E+3

Table 7.0-4  
 Raip<sub>0</sub> Inhalation Pathway Dose Factors - INFANT (Cont.)  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ )

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T. Body
I-134	9.21E+2	1.88E+3	4.45E+4	2.09E+3	-	1.29E+3	6.65E+2
I-135	3.86E+3	7.60E+3	6.96E+5	8.47E+3	-	1.83E+3	2.77E+3
Cs-134	3.96E+5	7.03E+5	-	1.90E+5	7.97E+4	1.33E+3	7.45E+4
Cs-136	4.83E+4	1.35E+5	-	5.64E+4	1.18E+4	1.43E+3	5.29E+4
Cs-137	5.49E+5	6.12E+5	-	1.72E+5	7.13E+4	1.33E+3	4.55E+4
Cs-138	5.05E+2	7.81E+2	-	4.10E+2	6.54E+1	8.76E+2	3.98E+2
Ba-139	1.48E+0	9.84E-4	-	5.92E-4	5.95E+3	5.10E+4	4.30E-2
Ba-140	5.60E+4	5.60E+1	-	1.34E+1	1.60E+6	3.84E+4	2.90E+3
Ba-141	1.57E-1	1.08E-4	-	6.50E-5	2.97E+3	4.75E+3	4.97E-3
Ba-142	3.98E-2	3.30E-5	-	1.90E-5	1.55E+3	6.93E+2	1.96E-3
La-140	5.05E+2	2.00E+2	-	-	1.68E+5	8.48E+4	5.15E+1
La-142	1.03E+0	3.77E-1	-	-	8.22E+3	5.95E+4	9.04E-2
Ce-141	2.77E+4	1.67E+4	-	5.25E+3	5.17E+5	2.16E+4	1.99E+3
Ce-143	2.93E+2	1.93E+2	-	5.64E+1	1.16E+5	4.97E+4	2.21E+1
Ce-144	3.19E+6	1.21E+6	-	5.38E+5	9.84E+6	1.48E+5	1.76E+5
Pr-143	1.40E+4	5.24E+3	-	1.97E+3	4.33E+5	3.72E+4	6.99E+2
Pr-144	4.79E-2	1.85E-2	-	6.72E-3	1.61E+3	4.28E+3	2.41E-3
Nd-147	7.94E+3	8.13E+3	-	3.15E+3	3.22E+5	3.12E+4	5.00E+2
W-187	1.30E+1	9.02E+0	-	-	3.96E+4	3.56E+4	3.12E+0
Np-239	3.71E+2	3.32E+1	-	6.62E+1	5.95E+4	2.49E+4	1.88E+1

Table 7.0-4  
Raipon Grass-Cow-Milk Pathway Dose Factors - ADULT  
(mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T.Body
H-3	-	7.63E+2	7.63E+2	7.63E+2	7.63E+2	7.63E+2	7.63E+2
C-14	3.63E+5	7.26E+4	7.26E+4	7.26E+4	7.26E+4	7.26E+4	7.26E+4
Na-24	2.54E+6	2.54E+6	2.54E+6	2.54E+6	2.54E+6	2.54E+6	2.54E+6
P-32	1.71E+10	1.06E+9	-	-	-	1.92E+9	6.60E+8
Cr-51	-	-	1.71E+4	6.30E+3	3.80E+4	7.20E+6	2.86E+4
Mn-54	-	8.40E+6	-	2.50E+6	-	2.57E+7	1.60E+6
Mn-56	-	4.23E-3	-	5.38E-3	-	1.35E-1	7.51E-4
Fe-55	2.51E+7	1.73E+7	-	-	9.67E+6	9.95E+6	4.04E+6
Fe-59	2.98E+7	7.00E+7	-	-	1.95E+7	2.33E+8	2.68E+7
Co-57	-	1.28E+6	-	-	-	3.25E+7	2.13E+6
Co-58	-	4.72E+6	-	-	-	9.57E+7	1.06E+7
Co-60	-	1.64E+7	-	-	-	3.08E+8	3.62E+7
Ni-63	6.73E+9	4.66E+8	-	-	-	9.73E+7	2.26E+8
Ni-65	3.70E-1	4.81E-2	-	-	-	1.22E+0	2.19E-2
Cu-64	-	2.41E+4	-	6.08E+4	-	2.05E+6	1.13E+4
Zn-65	1.37E+9	4.36E+9	-	2.92E+9	-	2.75E+9	1.97E+9
Zn-69	-	-	-	-	-	-	-
Br-82	-	-	-	-	-	3.72E+7	3.25E+7
Br-83	-	-	-	-	-	1.49E-1	1.03E-1
Br-84	-	-	-	-	-	-	-
Br-85	-	-	-	-	-	-	-
Rb-86	-	2.59E+9	-	-	-	5.11E+8	1.21E+9
Rb-88	-	-	-	-	-	-	-
Rb-89	-	-	-	-	-	-	-
Sr-89	1.45E+9	-	-	-	-	2.33E+8	4.16E+7
Sr-90	4.68E+10	-	-	-	-	1.35E+9	1.15E+10
Sr-91	3.13E+4	-	-	-	-	1.49E+5	1.27E+3
Sr-92	4.89E-1	-	-	-	-	9.68E+0	2.11E-2
Y-90	7.07E+1	-	-	-	-	7.50E+5	1.90E+0
Y-91m	-	-	-	-	-	-	-
Y-91	8.60E+3	-	-	-	-	4.73E+6	2.30E+2
Y-92	5.42E-5	-	-	-	-	9.49E-1	1.58E-6
Y-93	2.33E-1	-	-	-	-	7.39E+3	6.43E-3
Zr-95	9.46E+2	3.03E+2	-	4.76E+2	-	9.62E+5	2.05E+2
Zr-97	4.26E-1	8.59E-2	-	1.30E-1	-	2.66E+4	3.93E-2
Nb-95	8.25E+4	4.59E+4	-	4.54E+4	-	2.79E+8	2.47E+4
Nb-97	-	-	-	-	-	5.47E-9	-
Mo-99	-	2.52E+7	-	5.72E+7	-	5.85E+7	4.80E+6
Tc-99m	3.25E+0	9.19E+0	-	1.40E+2	4.50E+0	5.44E+3	1.17E+2
Tc-101	-	-	-	-	-	-	-
Ru-103	1.02E+3	-	-	3.89E+3	-	1.19E+5	4.39E+2
Ru-105	8.57E-4	-	-	1.11E-2	-	5.24E-1	3.38E-4
Ru-106	2.04E+4	-	-	3.94E+4	-	1.32E+6	2.58E+3
Rh-103m	-	-	-	-	-	-	-
Rh-106	-	-	-	-	-	-	-
Ag-110m	5.83E+7	5.39E+7	-	1.06E+8	-	2.20E+10	3.20E+7
Sb-124	2.57E+7	4.86E+5	6.24E+4	-	2.00E+7	7.31E+8	1.02E+7
Sb-125	2.04E+7	2.28E+5	2.08E+4	-	1.58E+7	2.25E+8	4.86E+6
Te-125m	1.63E+7	5.90E+6	4.90E+6	6.63E+7	-	6.50E+7	2.18E+6
Te-127m	4.58E+7	1.64E+7	1.17E+7	1.86E+8	-	1.54E+8	5.58E+6
Te-127	6.72E+2	2.41E+2	4.98E+2	2.74E+3	-	5.30E+4	1.45E+2
Te-129m	6.04E+7	2.25E+7	2.08E+7	2.52E+8	-	3.04E+8	9.57E+6
Te-129	-	-	-	-	-	-	-
Te-131m	3.61E+5	1.77E+5	2.80E+5	1.79E+6	-	1.75E+7	1.47E+5
Te-131	-	-	-	-	-	-	-
Te-132	2.39E+6	1.55E+6	1.71E+6	1.49E+7	-	7.32E+7	1.45E+6
I-130	4.26E+5	1.26E+6	1.07E+8	1.96E+6	-	1.08E+6	4.96E+5
I-131	2.96E+8	4.24E+8	1.39E+11	7.27E+8	-	1.12E+8	2.43E+8
I-132	1.64E-1	4.37E-1	1.53E+1	6.97E-1	-	8.22E-2	1.53E-1
I-133	3.97E+6	6.90E+6	1.01E+9	1.20E+7	-	6.20E+6	2.10E+6

Table 7.0-4  
 Raipo, Grass-Cow-Milk Pathway Dose Factors - ADULT (CONT.)  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
 ( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T. Body
I-134	-	-	-	-	-	-	-
I-135	1.39E+4	3.63E+4	2.40E+6	5.83E+4	-	4.10E+4	1.34E+4
Ce-134	5.65E+9	1.34E+10	-	4.35E+9	1.44E+9	2.35E+8	1.10E+10
Ce-136	2.61E+8	1.03E+9	-	5.74E+8	7.87E+7	1.17E+8	7.42E+8
Ce-137	7.38E+9	1.01E+10	-	3.43E+9	1.14E+9	1.95E+8	6.61E+9
Ca-138	-	-	-	-	-	-	-
Ba-139	4.70E-8	-	-	-	-	8.34E-8	1.38E-9
Ba-140	2.69E+7	3.38E+4	-	1.15E+4	1.93E+4	5.54E+7	1.76E+6
Ba-141	-	-	-	-	-	-	-
Ba-142	-	-	-	-	-	-	-
La-140	4.49E+0	2.26E+0	-	-	-	1.66E+5	5.97E-1
La-142	-	-	-	-	-	3.03E-8	-
Ce-141	4.84E+3	3.27E+3	-	1.52E+3	-	1.25E+7	3.71E+2
Ce-143	4.19E+1	3.09E+4	-	1.36E+1	-	1.16E+6	3.42E+0
Ce-144	3.58E+5	1.50E+5	-	8.87E+4	-	1.21E+8	1.92E+4
Pr-143	1.59E+2	6.37E+1	-	3.68E+1	-	6.96E+5	7.88E+0
Pr-144	-	-	-	-	-	-	-
Nd-147	9.42E+1	1.09E+2	-	6.37E+1	-	5.23E+5	6.52E+0
W-187	6.56E+3	5.48E+3	-	-	-	1.80E+6	1.92E+3
Np-239	3.66E+0	3.60E-1	-	1.12E+0	-	7.39E+4	1.98E-1

Table 7.0-4  
Raipo, Grass-Cow-Milk Pathway Dose Factors - TEENAGER  
(mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T. Body
H-3	-	9.94E+2	9.94E+2	9.94E+2	9.94E+2	9.94E+2	9.94E+2
C-14	6.70E+5	1.34E+5	1.34E+5	1.34E+5	1.34E+5	1.34E+5	1.34E+5
Na-24	4.44E+6	4.44E+6	4.44E+6	4.44E+6	4.44E+6	4.44E+6	4.44E+6
P-32	3.15E+10	1.95E+9	-	-	-	2.65E+9	1.22E+9
Cr-51	-	-	2.78E+4	1.10E+4	7.13E+4	8.40E+6	5.00E+4
Mn-54	-	1.40E+7	-	4.17E+6	-	2.87E+7	2.78E+6
Mn-56	-	7.51E-3	-	9.50E-3	-	4.94E-1	1.33E-3
Fe-55	4.45E+7	3.16E+7	-	-	2.00E+7	1.37E+7	7.36E+6
Fe-59	5.20E+7	1.21E+8	-	-	3.82E+7	2.87E+8	4.68E+7
Co-57	-	2.25E+6	-	-	-	4.19E+7	3.76E+6
Co-58	-	7.95E+6	-	-	-	1.10E+8	1.83E+7
Co-60	-	2.78E+7	-	-	-	3.62E+8	6.26E+7
Ni-63	1.18E+10	8.35E+8	-	-	-	1.33E+8	4.01E+8
Ni-65	6.78E-1	8.66E-2	-	-	-	4.70E+0	3.94E-2
Cu-64	-	4.29E+4	-	1.09E+5	-	3.33E+6	2.02E+4
Zn-65	2.11E+9	7.31E+9	-	4.68E+9	-	3.10E+9	3.41E+9
Zn-69	-	-	-	-	-	-	-
Br-82	-	-	-	-	-	-	5.64E+7
Br-83	-	-	-	-	-	-	1.91E-1
Br-84	-	-	-	-	-	-	-
Br-85	-	-	-	-	-	-	-
Rb-86	-	4.73E+9	-	-	-	7.00E+8	2.22E+9
Rb-88	-	-	-	-	-	-	-
Rb-89	-	-	-	-	-	-	-
Sr-89	2.67E+9	-	-	-	-	3.18E+8	7.66E+7
Sr-90	6.61E+10	-	-	-	-	1.86E+9	1.63E+10
Sr-91	5.75E+4	-	-	-	-	2.61E+5	2.29E+3
Sr-92	8.95E-1	-	-	-	-	2.28E+1	3.81E-2
Y-90	1.30E+2	-	-	-	-	1.07E+6	3.50E+0
Y-91m	-	-	-	-	-	-	-
Y-91	1.58E+4	-	-	-	-	6.48E+6	4.24E+2
Y-92	1.00E-4	-	-	-	-	2.75E+0	2.90E-6
Y-93	4.30E-1	-	-	-	-	1.31E+4	1.18E-2
Zr-95	1.65E+3	5.22E+2	-	7.67E+2	-	1.20E+6	3.59E+2
Zr-97	7.75E-1	1.53E-1	-	2.32E-1	-	4.15E+4	7.06E-2
Nb-95	1.41E+5	7.80E+4	-	7.57E+4	-	3.34E+8	4.30E+4
Nb-97	-	-	-	-	-	6.34E-8	-
Mo-99	-	4.56E+7	-	1.04E+8	-	8.16E+7	8.69E+6
Tc-99m	5.64E+0	1.57E+1	-	2.34E+2	8.73E+0	1.03E+4	2.04E+2
Tc-101	-	-	-	-	-	-	-
Ru-103	1.81E+3	-	-	6.40E+3	-	1.52E+5	7.75E+2
Ru-105	1.57E-3	-	-	1.97E-2	-	1.26E+0	6.08E-4
Ru-106	3.75E+4	-	-	7.23E+4	-	1.80E+6	4.73E+3
Rh-103m	-	-	-	-	-	-	-
Rh-106	-	-	-	-	-	-	-
Ag-110m	9.63E+7	9.11E+7	-	1.74E+8	-	2.56E+10	5.54E+7
Sb-124	4.59E+7	8.46E+5	1.04E+5	-	4.01E+7	9.25E+8	1.79E+7
Sb-125	3.65E+7	3.99E+5	3.49E+4	-	3.21E+7	2.84E+8	8.54E+6
Te-125m	3.00E+7	1.08E+7	8.39E+6	-	-	8.86E+7	4.02E+6
Te-127m	8.44E+7	2.99E+7	2.01E+7	3.42E+8	-	2.10E+8	1.00E+7
Te-127	1.24E+3	4.41E+2	8.59E+2	5.04E+3	-	9.61E+4	2.68E+2
Te-129m	1.11E+8	4.10E+7	3.57E+7	4.62E+8	-	4.15E+8	1.75E+7
Te-129	-	-	-	1.67E-9	-	2.18E-9	-
Te-131m	6.57E+5	3.15E+5	4.74E+5	3.29E+6	-	2.53E+7	2.63E+5
Te-131	-	-	-	-	-	-	-
Te-132	4.28E+6	2.71E+6	2.86E+6	2.60E+7	-	8.58E+7	2.55E+6
I-130	7.49E+5	2.17E+6	1.77E+8	3.34E+6	-	1.67E+6	8.66E+5
I-131	5.38E+8	7.53E+8	2.20E+11	1.30E+9	-	1.49E+8	4.04E+8
I-132	2.90E-1	7.59E-1	2.56E+1	1.20E+0	-	3.31E-1	2.72E-1
I-133	7.24E+6	1.23E+7	1.72E+9	2.15E+7	-	9.30E+6	3.75E+6



Table 7.0-4  
 Raipo, Grass-Cow Milk-Pathway Dose Factors - TEENAGER (Cont.)  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
 ( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T. Body
I-134	-	-	-	-	-	-	-
I-135	2.47E+4	6.35E+4	4.08E+6	1.00E+5	-	7.03E+4	2.35E+4
Cs-134	9.81E+9	2.31E+10	-	7.34E+9	2.80E+9	2.87E+8	1.07E+10
Cs-136	4.45E+8	1.75E+9	-	9.53E+8	1.50E+8	1.41E+8	1.18E+9
Cs-137	1.34E+10	1.78E+10	-	6.06E+9	2.35E+9	2.53E+8	6.20E+9
Ce-138	-	-	-	-	-	-	-
Ba-139	8.69E-8	-	-	-	-	7.75E-7	2.53E-9
Ba-140	4.85E+7	5.95E+4	-	2.02E+4	4.00E+4	7.49E+7	3.13E+6
Ba-141	-	-	-	-	-	-	-
Ba-142	-	-	-	-	-	-	-
La-140	8.06E+0	3.96E+0	-	-	-	2.27E+5	1.05E+0
La-142	-	-	-	-	-	2.23E-7	-
Ce-141	8.87E+3	5.92E+3	-	2.79E+3	-	1.69E+7	6.81E+2
Ce-143	7.69E+1	5.60E+4	-	2.51E+1	-	1.68E+6	6.25E+0
Ce-144	6.58E+5	2.72E+5	-	1.63E+5	-	1.66E+8	3.54E+4
Pr-143	2.92E+2	1.17E+2	-	6.77E+1	-	9.61E+5	1.45E+1
Pr-144	-	-	-	-	-	-	-
Nd-147	1.81E+2	1.97E+2	-	1.16E+2	-	7.11E+5	1.18E+1
W-187	1.20E+4	9.78E+3	-	-	-	2.65E+6	3.43E+3
Np-239	6.99E+0	6.59E-1	-	2.07E+0	-	1.06E+5	3.66E-1

Table 7.0-4  
 Raipor, Grass-Cow-Milk Pathway Dose Factors - CHILD  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
 ( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T. Body
H-3	-	1.57E+3	1.57E+3	1.57E+3	1.57E+3	1.57E+3	1.57E+3
C-14	1.65E+6	3.29E+5	3.29E+5	3.29E+5	3.29E+5	3.29E+5	3.29E+5
Na-24	9.23E+6	9.23E+6	9.23E+6	9.23E+6	9.23E+6	9.23E+6	9.23E+6
P-32	7.77E+10	3.64E+9	-	-	-	2.15E+9	3.00E+9
Cr-51	-	-	5.66E+4	1.55E+4	1.03E+5	5.41E+6	1.02E+5
Mn-54	-	2.09E+7	-	5.87E+6	-	1.76E+7	5.58E+6
Mn-56	-	1.31E-2	-	1.58E-2	-	1.90E+0	2.95E-3
Fe-55	1.12E+8	5.93E+7	-	-	3.35E+7	1.10E+7	1.84E+7
Fe-59	1.20E+8	1.95E+8	-	-	5.65E+7	2.03E+8	9.71E+7
Co-57	-	3.84E+6	-	-	-	3.14E+7	7.77E+6
Co-58	-	1.21E+7	-	-	-	7.08E+7	3.72E+7
Co-60	-	4.32E+7	-	-	-	2.39E+8	1.27E+8
Ni-63	2.96E+10	1.59E+9	-	-	-	1.07E+8	1.01E+9
Ni-65	1.66E+0	1.56E-1	-	-	-	1.91E+1	9.11E-2
Cu-64	-	7.55E+4	-	1.82E+5	-	3.54E+6	4.56E+4
Zn-65	4.13E+9	1.10E+10	-	6.94E+9	-	1.93E+9	6.85E+9
Zn-69	-	-	-	-	-	2.14E-9	-
Br-82	-	-	-	-	-	-	1.15E+8
Br-83	-	-	-	-	-	-	4.69E-1
Br-84	-	-	-	-	-	-	-
Br-85	-	-	-	-	-	-	-
Rb-86	-	8.77E+9	-	-	-	5.64E+8	5.39E+9
Rb-88	-	-	-	-	-	-	-
Rb-89	-	-	-	-	-	-	-
Sr-89	6.62E+9	-	-	-	-	2.56E+8	1.89E+8
Sr-90	1.12E+11	-	-	-	-	1.51E+9	2.83E+10
Sr-91	1.41E+5	-	-	-	-	3.12E+5	5.33E+3
Sr-92	2.19E+0	-	-	-	-	4.14E+1	8.76E-2
Y-90	3.22E+2	-	-	-	-	9.15E+5	8.61E+0
Y-91m	-	-	-	-	-	-	-
Y-91	3.91E+4	-	-	-	-	5.21E+6	1.04E+3
Y-92	2.46E-4	-	-	-	-	7.10E+0	7.03E-6
Y-93	1.06E+0	-	-	-	-	1.57E+4	2.90E-2
Zr-95	3.84E+3	8.45E+2	-	1.21E+3	-	8.81E+5	7.52E+2
Zr-97	1.89E+0	2.72E-1	-	3.91E-1	-	4.13E+4	1.61E-1
Nb-95	3.18E+5	1.24E+5	-	1.16E+5	-	2.29E+8	8.84E+4
Nb-97	-	-	-	-	-	1.45E-6	-
Mo-99	-	8.29E+7	-	1.77E+8	-	6.86E+7	2.05E+7
Tc-99m	1.29E+1	2.54E+1	-	3.68E+2	1.29E+1	1.44E+4	4.20E+2
Tc-101	-	-	-	-	-	-	-
Ru-103	4.29E+3	-	-	1.08E+4	-	1.11E+5	1.65E+3
Ru-105	3.82E-3	-	-	3.36E-2	-	2.49E+0	1.39E-3
Ru-106	9.24E+4	-	-	1.25E+5	-	1.44E+6	1.15E+4
Rh-103m	-	-	-	-	-	-	-
Rh-106	-	-	-	-	-	-	-
Ag-110m	2.09E+8	1.41E+8	-	2.63E+8	-	1.68E+10	1.13E+8
Sb-124	1.09E+8	1.41E+8	2.40E+5	-	6.03E+7	6.79E+8	3.81E+7
Sb-125	8.70E+7	1.41E+6	8.06E+4	-	4.85E+7	2.08E+8	1.82E+7
Te-125m	7.38E+7	2.00E+7	2.07E+7	-	-	7.12E+7	9.84E+6
Te-127m	2.08E+8	5.60E+7	4.97E+7	5.93E+8	-	1.68E+8	2.47E+7
Te-127	3.06E+3	8.25E+2	2.12E+3	8.71E+3	-	1.20E+5	6.56E+2
Te-129m	2.72E+8	7.61E+7	8.78E+7	8.00E+8	-	3.32E+8	4.23E+7
Te-129	-	-	-	2.87E-9	-	6.12E-8	-
Te-131m	1.60E+6	5.53E+5	1.14E+6	5.35E+6	-	2.24E+7	5.89E+5
Te-131	-	-	-	-	-	-	-
Te-132	1.02E+7	4.52E+6	6.58E+6	4.20E+7	-	4.55E+7	5.46E+6
I-130	1.75E+6	3.54E+6	3.90E+8	5.29E+6	-	1.66E+6	1.82E+6
I-131	1.30E+9	1.31E+9	4.34E+11	2.15E+9	-	1.17E+8	7.46E+8
I-132	6.86E-1	1.26E+0	5.85E+1	1.93E+0	-	1.48E+0	5.80E-1
I-133	1.76E+7	2.18E+7	4.04E+9	3.63E+7	-	8.77E+6	8.23E+6

Table 7.0-4  
 Raipo, Grass-Cow-Milk Pathway Dose Factors - CHILD (CONT.)  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
 ( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T. Body
I-134	-	-	-	-	-	-	-
I-135	5.84E+4	1.05E+5	9.30E+6	1.61E+5	-	8.00E+4	4.97E+4
Cs-134	2.26E+10	3.71E+10	-	1.15E+10	4.13E+9	2.00E+8	7.83E+9
Cs-136	1.00E+9	2.76E+9	-	1.47E+9	2.19E+8	9.70E+7	1.79E+9
Cs-137	3.22E+10	3.09E+10	-	1.01E+10	3.62E+9	1.93E+8	4.55E+9
Cs-138	-	-	-	-	-	-	-
Ba-139	2.14E-7	-	-	-	-	1.23E-5	6.19E-9
Ba-140	1.17E+8	1.03E+5	-	3.34E+4	6.12E+4	5.94E+7	6.84E+6
Ba-141	-	-	-	-	-	-	-
Ba-142	-	-	-	-	-	-	-
La-140	1.93E+1	6.74E+0	-	-	-	1.88E+5	2.27E+0
La-142	-	-	-	-	-	2.51E-6	-
Ce-141	2.19E+4	1.09E+4	-	4.78E+3	-	1.36E+7	1.62E+3
Ce-143	1.89E+2	1.02E+5	-	4.29E+1	-	1.50E+6	1.48E+1
Ce-144	1.62E+6	5.09E+5	-	2.82E+5	-	1.33E+8	8.66E+4
Pr-143	7.23E+2	2.17E+2	-	1.17E+2	-	7.80E+5	3.59E+1
Pr-144	-	-	-	-	-	-	-
Nd-147	4.45E+2	3.60E+2	-	1.98E+2	-	5.71E+5	2.79E+1
W-187	2.91E+4	1.72E+4	-	-	-	2.42E+6	7.73E+3
Np-239	1.72E+1	1.23E+0	-	3.57E+0	-	9.14E+4	8.60E-1

Table 7.0-4  
 Raipo, Grass-Cow-Milk Pathway Dose Factors - INFANT  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
 ( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-ILL	T.Body
H-3	-	2.38E+3	2.38E+3	2.38E+3	2.38E+3	2.38E+3	2.38E+3
C-14	3.23E+6	6.89E+5	6.89E+5	6.89E+5	6.89E+5	6.89E+5	6.89E+5
Na-24	1.61E+7	1.61E+7	1.61E+7	1.61E+7	1.61E+7	1.61E+7	1.61E+7
P-32	1.60E+11	9.42E+9	-	-	-	2.17E+9	6.21E+9
Cr-51	-	-	1.05E+5	2.30E+4	2.05E+5	4.71E+6	1.61E+5
Mn-54	-	3.89E+7	-	8.63E+6	-	1.43E+7	8.83E+6
Mn-56	-	3.21E-2	-	2.76E-2	-	2.91E+0	5.53E-3
Fe-55	1.35E+8	8.72E+7	-	-	4.27E+7	1.11E+7	2.33E+7
Fe-59	2.25E+8	3.93E+8	-	-	1.16E+8	1.88E+8	1.55E+8
Co-57	-	8.95E+6	-	-	-	3.05E+7	1.46E+7
Co-58	-	2.43E+7	-	-	-	6.05E+7	6.06E+7
Co-60	-	8.81E+7	-	-	-	2.10E+8	2.08E+8
Ni-63	3.49E+10	2.16E+9	-	-	-	1.07E+8	1.21E+9
Ni-65	3.51E+0	3.97E-1	-	-	-	3.02E+1	1.81E-1
Cu-64	-	1.88E+5	-	3.17E+5	-	3.85E+6	8.69E+4
Zn-65	5.55E+9	1.90E+10	-	9.23E+9	-	1.61E+10	8.78E+9
Zn-69	-	-	-	-	-	7.36E-9	-
Br-82	-	-	-	-	-	-	1.94E+8
Br-83	-	-	-	-	-	-	9.95E-1
Br-84	-	-	-	-	-	-	-
Br-85	-	-	-	-	-	-	-
Rb-86	-	2.22E+10	-	-	-	5.69E+8	1.10E+10
Rb-88	-	-	-	-	-	-	-
Rb-89	-	-	-	-	-	-	-
Sr-89	1.26E+10	-	-	-	-	2.59E+8	3.61E+8
Sr-90	1.22E+11	-	-	-	-	1.52E+9	3.10E+10
Sr-91	2.94E+5	-	-	-	-	3.48E+5	1.06E+4
Sr-92	4.65E+0	-	-	-	-	5.01E+1	1.73E-1
Y-90	6.80E+2	-	-	-	-	9.39E+5	1.82E+1
Y-91m	-	-	-	-	-	-	-
Y-91	7.33E+4	-	-	-	-	5.26E+6	1.95E+3
Y-92	5.22E-4	-	-	-	-	9.97E+0	1.47E-5
Y-93	2.25E+0	-	-	-	-	1.78E+4	6.13E-2
Zr-95	6.83E+3	1.66E+3	-	1.79E+3	-	8.28E+5	1.18E+3
Zr-97	3.99E+0	6.85E-1	-	6.91E-1	-	4.37E+4	3.13E-1
Nb-95	5.93E+5	2.44E+5	-	1.75E+5	-	2.06E+8	1.41E+5
Nb-97	-	-	-	-	-	3.70E-6	-
Mo-99	-	2.12E+8	-	3.17E+8	-	6.98E+7	4.13E+7
Tc-99m	2.69E+1	5.55E+1	-	5.97E+2	2.90E+1	1.61E+4	7.15E+2
Tc-101	-	-	-	-	-	-	-
Ru-103	8.69E+3	-	-	1.81E+4	-	1.06E+5	2.91E+3
Ru-105	8.06E-3	-	-	5.92E-2	-	3.21E+0	2.71E-3
Ru-106	1.90E+5	-	-	2.25E+5	-	1.44E+6	2.38E+4
Rh-103m	-	-	-	-	-	-	-
Rh-106	-	-	-	-	-	-	-
Ag-110m	3.86E+8	2.82E+8	-	4.03E+8	-	1.46E+10	1.86E+8
Sb-124	2.09E+8	3.08E+6	5.56E+5	-	1.31E+8	6.46E+8	6.49E+7
Sb-125	1.49E+8	1.45E+6	1.87E+5	-	9.38E+7	1.99E+8	3.07E+7
Te-125m	1.51E+8	5.04E+7	5.07E+7	-	-	7.18E+7	2.04E+7
Te-127m	4.21E+8	1.40E+8	1.22E+8	1.04E+9	-	1.70E+8	5.10E+7
Te-127	6.50E+3	2.18E+3	5.29E+3	1.59E+4	-	1.36E+5	1.40E+3
Te-129m	5.59E+8	1.92E+8	2.15E+8	1.40E+9	-	3.34E+8	8.62E+7
Te-129	2.08E-9	-	1.75E-9	5.18E-9	-	1.66E-7	-
Te-131m	3.38E+6	1.36E+6	2.76E+6	9.35E+6	-	2.29E+7	1.12E+6
Te-131	-	-	-	-	-	-	-
Tc-132	2.10E+7	1.04E+7	1.54E+7	6.51E+7	-	3.85E+7	9.72E+6
I-130	3.60E+6	7.92E+6	8.88E+8	8.70E+6	-	1.70E+6	3.18E+6
I-131	2.72E+9	3.21E+9	1.05E+12	3.75E+9	-	1.15E+8	1.41E+9
I-132	1.42E+0	2.89E+0	1.35E+2	3.22E+0	-	2.34E+0	1.03E+0
I-133	3.72E+7	5.41E+7	9.84E+9	6.36E+7	-	9.16E+6	1.58E+7

Table 7.0-4  
 Raipov Grass-Cow-Milk Pathway Dose Factors - INFANT (CONT.)  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
 ( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T. Body
I-134	-	-	1.01E-9	-	-	-	-
I-135	1.21E+5	2.41E+5	2.16E+7	2.69E+5	-	8.74E+4	8.80E+4
Cs-134	3.65E+10	6.80E+10	-	1.75E+10	7.18E+9	1.85E+8	6.87E+9
Cs-136	1.96E+9	5.77E+9	-	2.30E+9	4.70E+8	8.76E+7	2.15E+9
Cs-137	5.15E+10	6.02E+10	-	1.62E+10	6.55E+9	1.88E+8	4.27E+9
Cs-138	-	-	-	-	-	-	-
Ba-139	4.55E-7	-	-	-	-	2.88E-5	1.32E-8
Ba-140	2.41E+8	2.41E+5	-	5.73E+4	1.48E+5	5.92E+7	1.24E+7
Ba-141	-	-	-	-	-	-	-
Ba-142	-	-	-	-	-	-	-
La-140	4.03E+1	1.59E+1	-	-	-	1.87E+5	4.09E+0
La-142	-	-	-	-	-	5.21E-6	-
Ce-141	4.33E+4	2.64E+4	-	8.15E+3	-	1.37E+7	3.11E+3
Ce-143	4.00E+2	2.65E+5	-	7.72E+1	-	1.55E+6	3.02E+1
Ce-144	2.33E+6	9.52E+5	-	3.85E+5	-	1.33E+8	1.30E+5
Pr-143	1.49E+3	5.59E+2	-	2.08E+2	-	7.89E+5	7.41E+1
Pr-144	-	-	-	-	-	-	-
Nd-147	8.82E+2	9.06E+2	-	3.49E+2	-	5.74E+5	5.55E+1
W-187	6.12E+4	4.26E+4	-	-	-	2.50E+6	1.47E+4
Np-239	3.64E+1	3.25E+0	-	6.49E+0	-	9.40E+4	1.84E+0

Table 7.0-4  
 Raipor, Grass-Cow-Meat Pathway Dose Factors - ADULT  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
 ( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T. Body
H-3	-	3.25E+2	3.25E+2	3.25E+2	3.25E+2	3.25E+2	3.25E+2
C-14	3.33E+5	6.66E+4	6.66E+4	6.66E+4	6.66E+4	6.66E+4	6.66E+4
Na-24	1.84E-3	1.84E-3	1.84E-3	1.84E-3	1.84E-3	1.84E-3	1.84E-3
P-32	4.65E+9	2.89E+8	-	-	-	5.23E+8	1.80E+8
Cr-51	-	-	4.22E+3	1.56E+3	9.38E+3	1.78E+6	7.07E+3
Mn-54	-	9.15E+6	-	2.72E+6	-	2.80E+7	1.75E+6
Mn-56	-	-	-	-	-	-	-
Fe-55	2.93E+8	2.02E+8	-	-	1.13E+8	1.16E+8	4.72E+7
Fe-59	2.67E+8	6.27E+8	-	-	1.75E+8	2.09E+9	2.40E+8
Co-57	-	5.64E+6	-	-	-	1.43E+8	9.37E+6
Co-58	-	1.83E+7	-	-	-	3.70E+8	4.10E+7
Co-60	-	7.52E+7	-	-	-	1.41E+9	1.66E+8
Ni-63	1.89E+10	1.31E+9	-	-	-	2.73E+8	6.33E+8
Ni-65	-	-	-	-	-	-	-
Cu-64	-	2.95E-7	-	7.45E-7	-	2.52E-5	1.39E-7
Zn-65	3.56E+8	1.13E+9	-	7.57E+8	-	7.13E+8	5.12E+8
Zn-69	-	-	-	-	-	-	-
Br-82	-	-	-	-	-	1.44E+3	1.26E+3
Br-83	-	-	-	-	-	-	-
Br-84	-	-	-	-	-	-	-
Br-85	-	-	-	-	-	-	-
Rb-86	-	4.87E+8	-	-	-	9.60E+7	2.27E+8
Rb-88	-	-	-	-	-	-	-
Rb-89	-	-	-	-	-	-	-
Sr-89	3.01E+8	-	-	-	-	4.84E+7	8.65E+6
Sr-90	1.24E+10	-	-	-	-	3.59E+8	3.05E+9
Sr-91	-	-	-	-	-	1.38E-9	-
Sr-92	-	-	-	-	-	-	-
Y-90	1.07E+2	-	-	-	-	1.13E+6	2.86E+0
Y-91m	-	-	-	-	-	-	-
Y-91	1.13E+6	-	-	-	-	6.24E+8	3.03E+4
Y-92	-	-	-	-	-	-	-
Y-93	-	-	-	-	-	2.08E-7	-
Zr-95	1.88E+6	6.04E+5	-	9.48E+5	-	1.91E+9	4.09E+5
Zr-97	1.83E-5	3.69E-6	-	5.58E-6	-	1.14E+0	1.69E-6
Nb-95	2.29E+6	1.28E+6	-	1.26E+6	-	7.75E+9	6.86E+5
Nb-97	-	-	-	-	-	-	-
Mo-99	-	1.09E+5	-	2.46E+5	-	2.52E+5	2.07E+4
Tc-99m	-	-	-	-	-	-	-
Tc-101	-	-	-	-	-	-	-
Ru-103	1.06E+8	-	-	4.03E+8	-	1.23E+10	4.55E+7
Ru-105	-	-	-	-	-	-	-
Ru-106	2.80E+9	-	-	5.40E+9	-	1.81E+11	3.54E+8
Rh-103m	-	-	-	-	-	-	-
Rh-106	-	-	-	-	-	-	-
Ag-110m	6.69E+6	6.19E+6	-	1.22E+7	-	2.52E+9	3.67E+6
Sb-124	1.98E+7	3.74E+5	4.80E+4	-	1.54E+7	5.62E+8	7.85E+6
Sb-125	1.91E+7	2.13E+5	1.94E+4	-	1.47E+7	2.10E+8	4.54E+6
Te-125m	3.59E+8	1.30E+8	1.08E+8	1.46E+9	-	1.43E+9	4.81E+7
Te-127m	1.12E+9	3.99E+8	2.85E+8	4.53E+9	-	3.74E+9	1.36E+8
Te-127	-	-	-	1.09E-9	-	2.10E-8	-
Te-129m	1.14E+9	4.27E+8	3.93E+8	4.77E+9	-	5.76E+9	1.81E+8
Te-129	-	-	-	-	-	-	-
Te-131m	4.51E+2	2.21E+2	3.50E+2	2.24E+3	-	2.19E+4	1.84E+2
Te-131	-	-	-	-	-	-	-
Te-132	1.40E+6	9.07E+5	1.00E+6	8.73E+6	-	4.29E+7	8.51E+5
I-130	2.35E-6	6.94E-6	5.88E-4	1.08E-5	-	5.98E-6	2.74E-6
I-131	1.08E+7	1.54E+7	5.05E+9	2.64E+7	-	4.07E+6	8.83E+6
I-132	-	-	-	-	-	-	-
I-133	4.30E-1	7.47E-1	1.10E+2	1.30E+0	-	6.72E-1	2.28E-1

Table 7.0-4  
 Raipor Grass-Cow-Meat Pathway Dose Factors - ADULT (CONT)  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
 ( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T. Body
I-134	-	-	-	-	-	-	-
I-135	-	-	-	-	-	-	-
Cs-134	6.57E+8	1.56E+9	-	5.06E+8	1.68E+8	2.74E+7	1.28E+9
Cs-136	1.18E+7	4.67E+7	-	2.60E+7	3.56E+6	5.30E+6	3.36E+7
Cs-137	8.72E+8	1.19E+9	-	4.05E+8	1.35E+8	2.31E+7	7.81E+8
Cs-138	-	-	-	-	-	-	-
Ba-139	-	-	-	-	-	-	-
Ba-140	2.88E+7	3.61E+4	-	1.23E+4	2.07E+4	5.92E+7	1.89E+6
Ba-141	-	-	-	-	-	-	-
Ba-142	-	-	-	-	-	-	-
La-140	3.60E-2	1.81E-2	-	-	-	1.33E+3	4.79E-3
La-142	-	-	-	-	-	-	-
Ce-141	1.40E+4	9.48E+3	-	4.40E+3	-	3.62E+7	1.08E+3
Ce-143	2.09E-2	1.55E+1	-	6.80E-3	-	5.78E+2	1.71E-3
Ce-144	1.46E+6	6.09E+5	-	3.61E+5	-	4.93E+8	7.83E+4
Pr-143	2.13E+4	8.54E+3	-	4.93E+3	-	9.33E+7	1.06E+3
Pr-144	-	-	-	-	-	-	-
Nd-147	7.08E+3	8.18E+3	-	4.78E+3	-	3.93E+7	4.90E+2
W-187	2.16E-2	1.81E-2	-	-	-	5.92E+0	6.32E-3
Np-239	2.56E-1	2.51E-2	-	7.84E-2	-	5.15E+3	1.39E-2

Table 7.0-4  
 Raipor, Grass-Cow-Meat Pathway Dose Factors - TEENAGER  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
 ( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T.Body
H-3	-	1.94E+2	1.94E+2	1.94E+2	1.94E+2	1.94E+2	1.94E+2
C-14	2.81E+5	5.62E+4	5.62E+4	5.62E+4	5.62E+4	5.62E+4	5.62E+4
Na-24	1.47E-3	1.47E-3	1.47E-3	1.47E-3	1.47E-3	1.47E-3	1.47E-3
P-32	3.93E+9	2.44E+8	-	-	-	3.30E+8	1.52E+8
Cr-51	-	-	3.14E+3	1.24E+3	8.07E+3	9.50E+5	5.65E+3
Mn-54	-	6.98E+6	-	2.08E+6	-	1.43E+7	1.38E+6
Mn-56	-	-	-	-	-	-	-
Fe-55	2.38E+8	1.69E+8	-	-	1.07E+8	7.30E+7	3.93E+7
Fe-59	2.13E+8	4.98E+8	-	-	1.57E+8	1.18E+9	1.92E+8
Co-57	-	4.53E+6	-	-	-	8.45E+7	7.59E+6
Co-58	-	1.41E+7	-	-	-	1.94E+8	3.25E+7
Co-60	-	5.83E+7	-	-	-	7.60E+8	1.31E+8
Ni-63	1.52E+10	1.07E+9	-	-	-	1.71E+8	5.15E+8
Ni-65	-	-	-	-	-	-	-
Cu-64	-	2.41E-7	-	6.10E-7	-	1.87E-5	1.13E-7
Zn-65	2.50E+8	8.69E+8	-	5.56E+8	-	3.68E+8	4.05E+8
Zn-69	-	-	-	-	-	-	-
Br-82	-	-	-	-	-	-	9.98E+2
Br-83	-	-	-	-	-	-	-
Br-84	-	-	-	-	-	-	-
Br-85	-	-	-	-	-	-	-
Rb-86	-	4.06E+8	-	-	-	6.01E+7	1.91E+8
Rb-88	-	-	-	-	-	-	-
Rb-89	-	-	-	-	-	-	-
Sr-89	2.54E+8	-	-	-	-	3.03E+7	7.29E+6
Sr-90	8.05E+9	-	-	-	-	2.26E+8	1.99E+9
Sr-91	-	-	-	-	-	1.10E-9	-
Sr-92	-	-	-	-	-	-	-
Y-90	8.98E+1	-	-	-	-	7.40E+5	2.42E+0
Y-91m	-	-	-	-	-	-	-
Y-91	9.56E+5	-	-	-	-	3.92E+8	2.56E+4
Y-92	-	-	-	-	-	-	-
Y-93	-	-	-	-	-	1.69E-7	-
Zr-95	1.51E+6	4.76E+5	-	6.99E+5	-	1.10E+9	3.27E+5
Zr-97	1.53E-5	3.02E-6	-	4.58E-6	-	8.18E-1	1.39E-6
Nb-95	1.79E+6	9.94E+5	-	9.64E+5	-	4.25E+9	5.47E+5
Nb-97	-	-	-	-	-	-	-
Mo-99	-	8.98E+4	-	2.06E+5	-	1.61E+5	1.71E+4
Tc-99m	-	-	-	-	-	-	-
Tc-101	-	-	-	-	-	-	-
Ru-103	8.60E+7	-	-	3.03E+8	-	7.18E+9	3.68E+7
Ru-105	-	-	-	-	-	-	-
Ru-106	2.36E+9	-	-	4.55E+9	-	1.13E+11	2.97E+8
Rh-103m	-	-	-	-	-	-	-
Rh-106	-	-	-	-	-	-	-
Ag-110m	5.06E+6	4.79E+6	-	9.14E+6	-	1.35E+9	2.91E+6
Sb-124	1.62E+7	2.98E+5	3.67E+4	-	1.41E+7	3.26E+8	6.31E+6
Sb-125	1.56E+7	1.71E+5	1.49E+4	-	1.37E+7	1.22E+8	3.66E+6
Te-125m	3.03E+8	1.09E+8	8.47E+7	-	-	8.94E+8	4.05E+7
Te-127m	9.41E+8	3.34E+8	2.24E+8	3.82E+9	-	2.35E+9	1.12E+8
Te-127	-	-	-	-	-	1.75E-8	-
Te-129m	9.58E+8	3.56E+8	3.09E+8	4.01E+9	-	3.60E+9	1.52E+8
Te-129	-	-	-	-	-	-	-
Te-131m	3.76E+2	1.80E+2	2.71E+2	1.88E+3	-	1.45E+4	1.50E+2
Te-131	-	-	-	-	-	-	-
Te-132	1.15E+6	7.26E+5	7.66E+5	6.97E+6	-	2.30E+7	6.84E+5
I-130	1.89E-6	5.48E-6	4.47E-6	8.44E-6	-	4.21E-6	2.19E-6
I-131	8.95E+6	1.25E+7	3.66E+9	2.16E+7	-	2.48E+6	6.73E+6
I-132	-	-	-	-	-	-	-
I-133	3.59E-1	6.10E-1	8.51E+1	1.07E+0	-	4.61E-1	1.86E-1



Table 7.0-4  
 Raipor, Grass-Cow-Meat Pathway Dose Factors - TEENAGER (CONT.)  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
 ( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T. Body
I-134	-	-	-	-	-	-	-
I-135	-	-	-	-	-	-	-
Cs-134	5.23E+8	1.23E+9	-	3.91E+8	1.49E+8	1.53E+7	5.71E+8
Cs-136	9.22E+6	3.63E+7	-	1.97E+7	3.11E+6	2.92E+6	2.44E+7
Cs-137	7.24E+8	9.63E+8	-	3.28E+8	1.27E+8	1.37E+7	3.36E+8
Cs-138	-	-	-	-	-	-	-
Ba-139	-	-	-	-	-	-	-
Ba-140	2.38E+7	2.91E+4	-	9.88E+3	1.96E+4	3.67E+7	1.53E+6
Ba-141	-	-	-	-	-	-	-
Ba-142	-	-	-	-	-	-	-
La-140	2.96E-2	1.45E-2	-	-	-	8.35E+2	3.87E-3
La-142	-	-	-	-	-	-	-
Ce-141	1.18E+4	7.86E+3	-	3.70E+3	-	2.25E+7	9.03E+2
Ce-143	1.76E-2	1.28E+1	-	5.74E-3	-	3.85E+2	1.43E-3
Ce-144	1.23E+6	5.08E+5	-	3.04E+5	-	3.09E+8	6.60E+4
Pr-143	1.79E+4	7.15E+3	-	4.16E+3	-	5.90E+7	8.92E+2
Pr-144	-	-	-	-	-	-	-
Nd-147	6.24E+3	6.79E+3	-	3.98E+3	-	2.45E+7	4.06E+2
W-187	1.81E-2	1.48E-2	-	-	-	3.99E+0	5.17E-3
Np-239	2.23E-1	2.11E-2	-	6.61E-2	-	3.39E+3	1.17E-2

Table 7.0-4  
 Raipor, Grass-Cow-Meat Pathway Dose Factors - CHILD  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
 ( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T.Body
H-3	-	2.34E+2	2.34E+2	2.34E+2	2.34E+2	2.34E+2	2.34E+2
C-14	5.29E+5	1.06E+5	1.06E+5	1.06E+5	1.06E+5	1.06E+5	1.06E+5
Na-24	2.34E-3	2.34E-3	2.34E-3	2.34E-3	2.34E-3	2.34E-3	2.34E-3
P-32	7.41E+9	3.47E+8	-	-	-	2.05E+8	2.86E+8
Cr-51	-	-	4.89E+3	1.34E+3	8.93E+3	4.67E+5	8.81E+3
Mn-54	-	7.99E+6	-	2.24E+6	-	6.70E+6	2.13E+6
Mn-56	-	-	-	-	-	-	-
Fe-55	4.57E+8	2.42E+8	-	-	1.37E+8	4.49E+7	7.51E+7
Fe-59	3.78E+8	6.12E+8	-	-	1.77E+8	6.37E+8	3.05E+8
Co-57	-	5.92E+6	-	-	-	4.85E+7	1.20E+7
Co-58	-	1.65E+7	-	-	-	9.60E+7	5.04E+7
Co-60	-	6.93E+7	-	-	-	3.84E+8	2.04E+8
Ni-63	2.91E+10	1.56E+9	-	-	-	1.05E+8	9.91E+8
Ni-65	-	-	-	-	-	-	-
Cu-64	-	3.24E-7	-	7.82E-7	-	1.52E-5	1.96E-7
Zn-65	3.75E+8	1.00E+9	-	6.30E+8	-	1.76E+8	6.22E+8
Zn-69	-	-	-	-	-	-	-
Br-82	-	-	-	-	-	-	1.56E+3
Br-83	-	-	-	-	-	-	-
Br-84	-	-	-	-	-	-	-
Br-85	-	-	-	-	-	-	-
Rb-86	-	5.76E+8	-	-	-	3.71E+7	3.54E+8
Rb-88	-	-	-	-	-	-	-
Rb-89	-	-	-	-	-	-	-
Sr-89	4.82E+8	-	-	-	-	1.86E+7	1.38E+7
Sr-90	1.04E+10	-	-	-	-	1.40E+8	2.64E+9
Sr-91	-	-	-	-	-	1.01E-9	-
Sr-92	-	-	-	-	-	-	-
Y-90	1.70E+2	-	-	-	-	4.84E+5	4.55E+0
Y-91m	-	-	-	-	-	-	-
Y-91	1.81E+6	-	-	-	-	2.41E+8	4.83E+4
Y-92	-	-	-	-	-	-	-
Y-93	-	-	-	-	-	1.55E-7	-
Zr-95	2.68E+6	5.89E+5	-	8.43E+5	-	6.14E+8	5.24E+5
Zr-97	2.84E-5	4.10E-6	-	5.89E-6	-	6.21E-1	2.42E-6
Nb-95	3.09E+6	1.20E+6	-	1.13E+6	-	2.23E+9	8.61E+5
Nb-97	-	-	-	-	-	-	-
Mo-99	-	1.25E+5	-	2.67E+5	-	1.03E+5	3.09E+4
Tc-99m	-	-	-	-	-	-	-
Tc-101	-	-	-	-	-	-	-
Ru-103	1.56E+8	-	-	3.92E+8	-	4.02E+9	5.98E+7
Ru-105	-	-	-	-	-	-	-
Ru-106	4.44E+9	-	-	5.99E+9	-	6.90E+10	5.54E+8
Rh-103m	-	-	-	-	-	-	-
Rh-106	-	-	-	-	-	-	-
Ag-110m	8.40E+6	5.67E+6	-	1.06E+7	-	6.75E+8	4.53E+6
Sb-124	2.93E+7	3.80E+5	6.46E+4	-	1.62E+7	1.83E+8	1.03E+7
Sb-125	2.85E+7	2.19E+5	2.64E+4	-	1.59E+7	6.80E+7	5.96E+6
Te-125m	5.69E+8	1.54E+8	1.60E+8	-	-	5.49E+8	7.59E+7
Te-127m	1.77E+9	4.78E+8	4.24E+8	5.06E+9	-	1.44E+9	2.11E+8
Te-127	-	-	-	1.21E-9	-	1.66E-8	-
Te-129m	1.81E+9	5.04E+8	5.82E+8	5.30E+9	-	2.20E+9	2.80E+8
Te-129	-	-	-	-	-	-	-
Te-131m	7.00E+2	2.42E+2	4.98E+2	2.34E+3	-	9.82E+3	2.58E+2
Te-131	-	-	-	-	-	-	-
Te-132	2.09E+6	9.27E+5	1.35E+6	8.60E+6	-	9.33E+6	1.12E+6
I-130	3.39E-6	6.85E-6	7.54E-4	1.02E-5	-	3.20E-6	3.53E-6
I-131	1.66E+7	1.67E+7	5.52E+9	2.74E+7	-	1.49E+6	9.49E+6
I-132	-	-	-	-	-	-	-
I-133	6.68E-1	8.26E-1	1.53E+2	1.38E+0	-	3.33E-1	3.12E-1

Table 7.0-4  
 $R_{aipo}$ , Grass-Cow-Meat Pathway Dose Factors - CHILD (CONT.)  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
 ( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T. Body
I-134	-	-	-	-	-	-	-
I-135	-	-	-	-	-	-	-
Cs-134	9.22E+8	1.51E+9	-	4.69E+8	1.68E+8	8.15E+6	3.19E+8
Cs-136	1.59E+7	4.37E+7	-	2.33E+7	3.47E+6	1.54E+6	2.83E+7
Cs-137	1.33E+9	1.28E+9	-	4.16E+8	1.50E+8	7.99E+6	1.88E+8
Cs-138	-	-	-	-	-	-	-
Ba-139	-	-	-	-	-	-	-
Ba-140	4.39E+7	3.85E+4	-	1.25E+4	2.29E+4	2.22E+7	2.56E+6
Ba-141	-	-	-	-	-	-	-
Ba-142	-	-	-	-	-	-	-
La-140	5.41E-2	1.89E-2	-	-	-	5.27E+2	6.38E-3
La-142	-	-	-	-	-	-	-
Ce-141	2.22E+4	1.11E+4	-	4.84E+3	-	1.38E+7	1.64E+3
Ce-143	3.30E-2	1.79E+1	-	7.51E-3	-	2.62E+2	2.59E-3
Ce-144	2.32E+6	7.26E+5	-	4.02E+5	-	1.89E+8	1.24E+5
Pr-143	3.39E+4	1.02E+4	-	5.51E+3	-	3.66E+7	1.68E+3
Pr-144	-	-	-	-	-	-	-
Nd-147	1.17E+4	9.48E+3	-	5.20E+3	-	1.50E+7	7.34E+2
W-187	3.36E-2	1.99E-2	-	-	-	2.79E+0	8.92E-3
Np-239	4.20E-1	3.02E-2	-	8.73E-2	-	2.23E+3	2.12E-2

Table 7.0-4  
 Raipo, Vegetation Pathway Dose Factors - ADULT  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
 ( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T.Body
H-3	-	2.26E+3	2.26E+3	2.26E+3	2.26E+3	2.26E+3	2.26E+3
C-14	8.97E+5	1.79E+5	1.79E+5	1.79E+5	1.79E+5	1.79E+5	1.79E+5
Na-24	2.76E+5	2.76E+5	2.76E+5	2.76E+5	2.76E+5	2.76E+5	2.76E+5
P-32	1.40E+9	8.73E+7	-	-	-	1.58E+8	5.42E+7
Cr-51	-	-	2.79E+4	1.03E+4	6.19E+4	1.17E+7	4.66E+4
Mn-54	-	3.11E+8	-	9.27E+7	-	9.54E+8	5.94E+7
Mn-56	-	1.61E+1	-	2.04E+1	-	5.13E+2	2.85E+0
Fe-55	2.09E+8	1.45E+8	-	-	8.06E+7	8.29E+7	3.37E+7
Fe-59	1.27E+8	2.99E+8	-	-	8.35E+7	9.96E+8	1.14E+8
Co-57	-	1.17E+7	-	-	-	2.97E+8	1.95E+7
Co-58	-	3.09E+7	-	-	-	6.26E+8	6.92E+7
Co-60	-	1.67E+8	-	-	-	3.14E+9	3.69E+8
Ni-63	1.04E+10	7.21E+8	-	-	-	1.50E+8	3.49E+8
Ni-65	6.15E+1	7.99E+0	-	-	-	2.03E+2	3.65E+0
Cu-64	-	9.27E+3	-	2.34E+4	-	7.90E+5	4.35E+3
Zn-65	3.17E+8	1.01E+9	-	6.75E+8	-	6.36E+8	4.56E+8
Zn-69	8.75E-6	1.67E-5	-	1.09E-5	-	2.51E-6	1.16E-6
Br-82	-	-	-	-	-	1.73E+6	1.51E+6
Br-83	-	-	-	-	-	4.63E+0	3.21E+0
Br-84	-	-	-	-	-	-	-
Br-85	-	-	-	-	-	-	-
Rb-86	-	2.19E+8	-	-	-	4.32E+7	1.02E+8
Rb-88	-	-	-	-	-	-	-
Rb-89	-	-	-	-	-	-	-
Sr-89	9.96E+9	-	-	-	-	1.60E+9	2.86E+8
Sr-90	6.05E+11	-	-	-	-	1.75E+10	1.48E+11
Sr-91	3.20E+5	-	-	-	-	1.52E+6	1.29E+4
Sr-92	4.27E+2	-	-	-	-	8.46E+3	1.85E+1
Y-90	1.33E+4	-	-	-	-	1.41E+8	3.56E+2
Y-91m	5.83E-9	-	-	-	-	1.71E-8	-
Y-91	5.13E+6	-	-	-	-	2.82E+9	1.37E+5
Y-92	9.01E-1	-	-	-	-	1.58E+4	2.63E-2
Y-93	1.74E+2	-	-	-	-	5.52E+6	4.80E+0
Zr-95	1.19E+6	3.81E+5	-	5.97E+5	-	1.21E+9	2.58E+5
Zr-97	3.33E+2	6.73E+1	-	1.02E+2	-	2.08E+7	3.08E+1
Nb-95	1.42E+5	7.91E+4	-	7.81E+4	-	4.80E+8	4.25E+4
Nb-97	2.90E-6	7.34E-7	-	8.56E-7	-	2.71E-3	2.68E-7
Mo-99	-	6.25E+6	-	1.41E+7	-	1.45E+7	1.19E+6
Tc-99m	3.06E+0	8.66E+0	-	1.32E+2	4.24E+0	5.12E+3	1.10E+2
Tc-101	-	-	-	-	-	-	-
Ru-103	4.80E+6	-	-	1.83E+7	-	5.61E+8	2.07E+6
Ru-105	5.39E+1	-	-	6.96E+2	-	3.30E+4	2.13E+1
Ru-106	1.93E+8	-	-	3.72E+8	-	1.25E+10	2.44E+7
Rh-103m	-	-	-	-	-	-	-
Rh-106	-	-	-	-	-	-	-
Ag-110m	1.06E+7	9.76E+6	-	1.92E+7	-	3.98E+9	5.80E+6
Sb-124	1.04E+8	1.96E+6	2.52E+5	-	8.08E+7	2.95E+9	4.11E+7
Sb-125	1.36E+8	1.52E+6	1.39E+5	-	1.05E+8	1.50E+9	3.25E+7
Te-125m	9.66E+7	3.50E+7	2.90E+7	3.93E+8	-	3.86E+8	1.29E+7
Te-127m	3.49E+8	1.25E+8	8.92E+7	1.42E+9	-	1.17E+9	4.26E+7
Te-127	5.76E+3	2.07E+3	4.27E+3	2.35E+4	-	4.54E+5	1.25E+3
Te-129m	2.55E+8	9.50E+7	8.75E+7	1.06E+9	-	1.28E+9	4.03E+7
Te-129	6.65E-4	2.50E-4	5.10E-4	2.79E-3	-	5.02E-4	1.62E-4
Te-131m	9.12E+5	4.46E+5	7.06E+5	4.52E+6	-	4.43E+7	3.72E+5
Te-131	-	-	-	-	-	-	-
Te-132	4.29E+6	2.77E+6	3.06E+6	2.67E+7	-	1.31E+8	2.60E+6
I-130	3.96E+5	1.17E+6	9.90E+7	1.82E+6	-	1.01E+6	4.61E+5
I-131	8.09E+7	1.16E+8	3.79E+10	1.98E+8	-	3.05E+7	6.63E+7
I-132	5.74E+1	1.54E+2	5.38E+3	2.45E+2	-	2.89E+1	5.38E+1
I-133	2.12E+6	3.69E+6	5.42E+8	6.44E+6	-	3.31E+6	1.12E+6

Table 7.0-4  
 Raipor, Vegetation Pathway Dose Factors - ADULT (CONT.)  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
 ( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T.Body
I-134	1.06E-4	2.88E-4	5.00E-3	4.59E-4	-	2.51E-7	1.03E-4
I-135	4.08E+4	1.07E+5	7.04E+6	1.71E+5	-	1.21E+5	3.94E+4
Cs-134	4.66E+9	1.11E+10	-	3.59E+9	1.19E+9	1.94E+8	9.07E+9
Cs-136	4.20E+7	1.66E+8	-	9.24E+7	1.27E+7	1.89E+7	1.19E+8
Cs-137	6.36E+9	8.70E+9	-	2.95E+9	9.81E+8	1.68E+8	5.70E+9
Cs-138	-	-	-	-	-	-	-
Ba-139	2.95E-2	2.10E-5	-	1.96E-5	1.19E-5	5.23E-2	8.64E-4
Ba-140	1.29E+8	1.62E+5	-	5.49E+4	9.25E+4	2.65E+8	8.43E+6
Ba-141	-	-	-	-	-	-	-
Ba-142	-	-	-	-	-	-	-
La-140	1.97E+3	9.92E+2	-	-	-	7.28E+7	2.62E+2
La-142	1.40E-4	6.35E-5	-	-	-	4.64E-1	1.58E-5
Ce-141	1.96E+5	1.33E+5	-	6.17E+4	-	5.08E+8	1.51E+4
Ce-143	1.00E+3	7.42E+5	-	3.26E+2	-	2.77E+7	8.21E+1
Ce-144	3.29E+7	1.38E+7	-	8.16E+6	-	1.11E+10	1.77E+6
Pr-143	6.34E+4	2.54E+4	-	1.47E+4	-	2.78E+8	3.14E+3
Pr-144	-	-	-	-	-	-	-
Nd-147	3.34E+4	3.86E+4	-	2.25E+4	-	1.85E+8	2.31E+3
W-187	3.82E+4	3.19E+4	-	-	-	1.05E+7	1.12E+4
Np-239	1.42E+3	1.40E+2	-	4.37E+2	-	2.87E+7	7.72E+1

Table 7.0-4  
 Raipor Vegetation Pathway Dose Factors - TEENAGER  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
 ( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T.Body
H-3	-	2.59E+3	2.59E+3	2.59E+3	2.59E+3	2.59E+3	2.59E+3
C-14	1.45E+6	2.91E+5	2.91E+5	2.91E+5	2.91E+5	2.91E+5	2.91E+5
Na-24	2.45E+5	2.45E+5	2.45E+5	2.45E+5	2.45E+5	2.45E+5	2.45E+5
P-32	1.61E+9	9.96E+7	-	-	-	1.35E+8	6.23E+7
Cr-51	-	-	3.44E+4	1.36E+4	8.85E+4	1.04E+7	6.20E+6
Mn-54	-	4.52E+8	-	1.35E+8	-	9.27E+8	8.97E+7
Mn-56	-	1.45E+1	-	1.83E+1	-	9.54E+2	2.58E+0
Fe-55	3.25E+8	2.31E+8	-	-	1.46E+8	9.98E+7	5.38E+7
Fe-59	1.81E+8	4.22E+8	-	-	1.33E+8	9.98E+8	1.63E+8
Co-57	-	1.79E+7	-	-	-	3.34E+8	3.00E+7
Co-58	-	4.38E+7	-	-	-	6.04E+8	1.01E+8
Co-60	-	2.49E+8	-	-	-	3.24E+9	5.60E+8
Ni-63	1.61E+10	1.13E+9	-	-	-	1.81E+8	5.45E+8
Ni-65	5.73E+1	7.32E+0	-	-	-	3.97E+2	3.33E+0
Cu-64	-	8.40E+3	-	2.12E+4	-	6.51E+5	3.95E+3
Zn-65	4.24E+8	1.47E+9	-	9.41E+8	-	6.23E+8	6.86E+8
Zn-69	8.19E-6	1.56E-5	-	1.02E-5	-	2.88E-5	1.09E-6
Br-82	-	-	-	-	-	-	1.33E+6
Br-83	-	-	-	-	-	-	3.01E+0
Br-84	-	-	-	-	-	-	-
Br-85	-	-	-	-	-	-	-
Rb-86	-	2.73E+8	-	-	-	4.05E+7	1.28E+8
Rb-88	-	-	-	-	-	-	-
Rb-89	-	-	-	-	-	-	-
Sr-89	1.51E+10	-	-	-	-	1.80E+9	4.33E+8
Sr-90	7.51E+11	-	-	-	-	2.11E+10	1.85E+11
Sr-91	2.99E+5	-	-	-	-	1.36E+6	1.19E+4
Sr-92	3.97E+2	-	-	-	-	1.01E+4	1.69E+1
Y-90	1.24E+4	-	-	-	-	1.02E+8	3.34E+2
Y-91m	5.43E-9	-	-	-	-	2.56E-7	-
Y-91	7.87E+6	-	-	-	-	3.23E+9	2.11E+5
Y-92	8.47E-1	-	-	-	-	2.32E+4	2.45E-2
Y-93	1.63E+2	-	-	-	-	4.98E+6	4.47E+0
Zr-95	1.74E+6	5.49E+5	-	8.07E+5	-	1.27E+9	3.78E+5
Zr-97	3.09E+2	6.11E+1	-	9.26E+1	-	1.65E+7	2.81E+1
Nb-95	1.92E+5	1.06E+5	-	1.03E+5	-	4.55E+8	5.86E+4
Nb-97	2.69E-6	6.67E-7	-	7.80E-7	-	1.59E-2	2.44E-7
Mo-99	-	5.74E+6	-	1.31E+7	-	1.03E+7	1.09E+6
Tc-99m	2.70E+0	7.54E+0	-	1.12E+2	4.19E+0	4.95E+3	9.77E+1
Tc-101	-	-	-	-	-	-	-
Ru-103	6.87E+6	-	-	2.42E+7	-	5.74E+8	2.94E+6
Ru-105	5.00E+1	-	-	6.31E+2	-	4.04E+4	1.94E+1
Ru-106	3.09E+8	-	-	5.97E+8	-	1.48E+10	3.90E+7
Rh-103m	-	-	-	-	-	-	-
Rh-106	-	-	-	-	-	-	-
Ag-110m	1.52E+7	1.44E+7	-	2.74E+7	-	4.04E+9	8.74E+6
Sb-124	1.55E+8	2.85E+6	3.51E+5	-	1.35E+8	3.11E+9	6.03E+7
Sb-125	2.14E+8	2.34E+6	2.04E+5	-	1.88E+8	1.66E+9	5.00E+7
Te-125m	1.48E+8	5.34E+7	4.14E+7	-	-	4.37E+8	1.98E+7
Te-127m	5.51E+8	1.96E+8	1.31E+8	2.24E+9	-	1.37E+9	6.56E+7
Te-127	5.43E+3	1.92E+3	3.74E+3	2.20E+4	-	4.19E+5	1.17E+3
Te-129m	3.67E+8	1.36E+8	1.18E+8	1.54E+9	-	1.38E+9	5.81E+7
Te-129	6.22E-4	2.32E-4	4.45E-4	2.61E-3	-	3.40E-3	1.51E-4
Te-131m	8.44E+5	4.05E+5	6.09E+5	4.22E+6	-	3.25E+7	3.38E+5
Te-131	-	-	-	-	-	-	-
Te-132	3.90E+6	2.47E+6	2.60E+6	2.37E+7	-	7.82E+7	2.32E+6
I-130	3.54E+5	1.02E+6	8.35E+7	1.58E+6	-	7.87E+5	4.09E+5
I-131	7.70E+7	1.08E+8	3.14E+10	1.85E+8	-	2.13E+7	5.79E+7
I-132	5.18E+1	1.36E+2	4.57E+3	2.14E+2	-	5.91E+1	4.87E+1
I-133	1.97E+6	3.34E+6	4.66E+8	5.86E+6	-	2.53E+6	1.02E+6

Table 7.0-4  
 Raipo, Vegetation Pathway Dose Factors - TEENAGER (CONT.)  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
 ( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T. Body
I-134	9.59E-5	2.54E-4	4.24E-3	4.01E-4	-	3.35E-6	9.13E-5
I-135	3.68E+4	9.48E+4	6.10E+6	1.50E+5	-	1.05E+5	3.52E+4
Cs-134	7.09E+9	1.67E+10	-	5.30E+9	2.02E+9	2.08E+8	7.74E+9
Cs-136	4.29E+7	1.69E+8	-	9.19E+7	1.45E+7	1.36E+7	1.13E+8
Cs-137	1.01E+10	1.35E+10	-	4.59E+9	1.78E+9	1.92E+8	4.69E+9
Cs-138	-	-	-	-	-	-	-
Ba-139	2.77E-2	1.95E-5	-	1.84E-5	1.34E-5	2.47E-1	8.08E-4
Ba-140	1.38E+8	1.69E+5	-	5.75E+4	1.14E+5	2.13E+8	8.91E+6
Ba-141	-	-	-	-	-	-	-
Ba-142	-	-	-	-	-	-	-
La-140	1.80E+3	8.84E+2	-	-	-	5.08E+7	2.35E+2
La-142	1.28E-4	5.69E-5	-	-	-	1.73E+0	1.42E-5
Ce-141	2.82E+5	1.88E+5	-	8.86E+4	-	5.38E+8	2.16E+4
Ce-143	9.37E+2	6.82E+5	-	3.06E+2	-	2.05E+7	7.62E+1
Ce-144	5.27E+7	2.18E+7	-	1.30E+7	-	1.33E+10	2.83E+6
Pr-143	7.12E+4	2.84E+4	-	1.65E+4	-	2.34E+8	3.55E+3
Pr-144	-	-	-	-	-	-	-
Nd-147	3.63E+4	3.94E+4	-	2.32E+4	-	1.42E+8	2.36E+3
W-187	3.55E+4	2.90E+4	-	-	-	7.84E+6	1.02E+4
Np-239	1.38E+3	1.30E+2	-	4.09E+2	-	2.10E+7	7.24E+1

Table 7.0-4  
 Raipo, Vegetation Pathway Dose Factors - CHILD  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
 ( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T. Body
H-3	-	4.01E+3	4.01E+3	4.01E+3	4.01E+3	4.01E+3	4.01E+3
C-14	3.50E+6	7.01E+5	7.01E+5	7.01E+5	7.01E+5	7.01E+5	7.01E+5
Na-24	3.83E+5	3.83E+5	3.83E+5	3.83E+5	3.83E+5	3.83E+5	3.83E+5
P-32	3.37E+9	1.58E+8	-	-	-	9.30E+7	1.30E+8
Cr-51	-	-	6.54E+4	1.79E+4	1.19E+5	6.25E+6	1.18E+5
Mn-54	-	6.61E+8	-	1.85E+8	-	5.55E+8	1.76E+8
Mn-56	-	1.90E+1	-	2.29E+1	-	2.75E+3	4.28E+0
Fe-55	8.00E+8	4.24E+8	-	-	2.40E+8	7.86E+7	1.31E+8
Fe-59	4.01E+8	6.49E+8	-	-	1.88E+8	6.76E+8	3.23E+8
Co-57	-	2.99E+7	-	-	-	2.45E+8	6.04E+7
Co-58	-	6.47E+7	-	-	-	3.77E+8	1.98E+8
Co-60	-	3.78E+8	-	-	-	2.10E+9	1.12E+9
Ni-63	3.95E+10	2.11E+9	-	-	-	1.42E+8	1.34E+9
Ni-65	1.05E+2	9.89E+0	-	-	-	1.21E+3	5.77E+0
Cu-64	-	1.11E+4	-	2.68E+4	-	5.20E+5	6.69E+3
Zn-65	8.12E+8	2.16E+9	-	1.36E+9	-	3.80E+8	1.35E+9
Zn-69	1.51E-5	2.18E-5	-	1.32E-5	-	1.38E-3	2.02E-6
Br-82	-	-	-	-	-	-	2.04E+6
Br-83	-	-	-	-	-	-	5.55E+0
Br-84	-	-	-	-	-	-	-
Br-85	-	-	-	-	-	-	-
Rb-86	-	4.52E+8	-	-	-	2.91E+7	2.78E+8
Rb-88	-	-	-	-	-	-	-
Rb-89	-	-	-	-	-	-	-
Sr-89	3.59E+10	-	-	-	-	1.39E+9	1.03E+9
Sr-90	1.24E+12	-	-	-	-	1.67E+10	3.15E+11
Sr-91	5.50E+5	-	-	-	-	1.21E+6	2.08E+4
Sr-92	7.28E+2	-	-	-	-	1.38E+4	2.92E+1
Y-90	2.30E+4	-	-	-	-	6.56E+7	6.17E+2
Y-91m	9.94E-9	-	-	-	-	1.95E-5	-
Y-91	1.87E+7	-	-	-	-	2.49E+9	5.01E+5
Y-92	1.56E+0	-	-	-	-	4.51E+4	4.46E-2
Y-93	3.01E+2	-	-	-	-	4.48E+6	8.25E+0
Zr-95	3.90E+6	8.58E+5	-	1.23E+6	-	8.95E+8	7.64E+5
Zr-97	5.64E+2	8.15E+1	-	1.17E+2	-	1.23E+7	4.81E+1
Nb-95	4.10E+5	1.59E+5	-	1.50E+5	-	2.95E+8	1.14E+5
Nb-97	4.90E-6	8.85E-7	-	9.82E-7	-	2.73E-1	4.13E-7
Mo-99	-	7.83E+6	-	1.67E+7	-	6.48E+6	1.94E+6
Tc-99m	4.65E+0	9.12E+0	-	1.33E+2	4.63E+0	5.19E+3	1.51E+2
Tc-101	-	-	-	-	-	-	-
Ru-103	1.55E+7	-	-	3.89E+7	-	3.99E+8	5.94E+6
Ru-105	9.17E+1	-	-	8.06E+2	-	5.98E+4	3.33E+1
Ru-106	7.45E+8	-	-	1.01E+9	-	1.16E+10	9.30E+7
Rh-103m	-	-	-	-	-	-	-
Rh-106	-	-	-	-	-	-	-
Ag-110m	3.22E+7	2.17E+7	-	4.05E+7	-	2.58E+9	1.74E+7
Sb-124	3.52E+8	4.57E+6	7.78E+5	-	1.96E+8	2.20E+9	1.23E+8
Sb-125	4.99E+8	3.85E+6	4.62E+5	-	2.78E+8	1.19E+9	1.05E+8
Te-125m	3.51E+8	9.50E+7	9.84E+7	-	-	3.38E+8	4.67E+7
Te-127m	1.32E+9	3.56E+8	3.16E+8	3.77E+9	-	1.07E+9	1.57E+8
Te-127	1.00E+4	2.70E+3	6.93E+3	2.85E+4	-	3.91E+5	2.15E+3
Te-129m	8.54E+8	2.39E+8	2.75E+8	2.51E+9	-	1.04E+9	1.33E+8
Te-129	1.15E-3	3.22E-4	8.22E-4	3.37E-3	-	7.17E-2	2.74E-4
Te-131m	1.54E+6	5.33E+5	1.10E+6	5.16E+6	-	2.16E+7	5.68E+5
Te-131	-	-	-	-	-	-	-
Te-132	6.98E+6	3.09E+6	4.50E+6	2.87E+7	-	3.11E+7	3.73E+6
I-130	6.21E+5	1.26E+6	1.38E+8	1.88E+6	-	5.87E+5	6.47E+5
I-131	1.43E+8	1.44E+8	4.76E+10	2.36E+8	-	1.28E+7	8.18E+7
I-132	9.20E+1	1.69E+2	7.84E+3	2.59E+2	-	1.99E+2	7.77E+1
I-133	3.59E+6	4.44E+6	8.25E+8	7.40E+6	-	1.79E+6	1.68E+6



Table 7.0-4  
 Raipor Vegetation Pathway Dose Factors - CHILD (CONT.)  
 (mrem/yr per  $\mu\text{Ci}/\text{m}^3$ ) for H-3 and C-14  
 ( $\text{m}^2 \times \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) for others

Nuclide	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	T.Body
I-134	1.70E-4	3.16E-4	7.28E-3	4.84E-4	-	2.10E-4	1.46E-4
I-135	6.54E+4	1.18E+5	1.04E+7	1.81E+5	-	8.98E+4	5.57E+4
Cs-134	1.60E+10	2.63E+10	-	8.14E+9	2.92E+9	1.42E+8	5.54E+9
Cs-136	8.06E+7	2.22E+8	-	1.18E+8	1.76E+7	7.79E+6	1.43E+8
Cs-137	2.39E+10	2.29E+10	-	7.46E+9	2.68E+9	1.43E+8	3.38E+9
Cs-138	-	-	-	-	-	-	-
Ba-139	5.11E-2	2.73E-5	-	2.38E-5	1.61E-5	2.95E+0	1.48E-3
Ba-140	2.77E+8	2.43E+5	-	7.90E+4	1.45E+5	1.40E+8	1.62E+7
Ba-141	-	-	-	-	-	-	-
Ba-142	-	-	-	-	-	-	-
La-140	3.23E+3	1.13E+3	-	-	-	3.15E+7	3.81E+2
La-142	2.32E-4	7.40E-5	-	-	-	1.47E+1	2.32E-5
Ce-141	1.23E+5	6.14E+4	-	2.69E+4	-	7.66E+7	9.12E+3
Ce-143	1.73E+3	9.36E+5	-	3.93E+2	-	1.37E+7	1.36E+2
Ce-144	1.27E+8	3.98E+7	-	2.21E+7	-	1.04E+10	6.78E+6
Pr-143	1.48E+5	4.46E+4	-	2.41E+4	-	1.60E+8	7.37E+3
Pr-144	-	-	-	-	-	-	-
Nd-147	7.16E+4	5.80E+4	-	3.18E+4	-	9.18E+7	4.49E+3
W-187	6.47E+4	3.83E+4	-	-	-	5.38E+6	1.72E+4
Np-239	2.55E+3	1.83E+2	-	5.30E+2	-	1.36E+7	1.29E+2

Table 7.0-4  
 Raipō Ground Plane Pathway Dose Factors  
 (m<sup>2</sup> x mrem/yr per μCi/sec)


Nuclide	Any Organ
H-3	-
C-14	-
Na-24	1.21E+7
P-32	-
Cr-51	4.68E+6
Mn-54	1.34E+9
Mn-56	9.05E+5
Fe-55	-
Fe-59	2.75E+8
Co-58	3.82E+8
Co-60	2.16E+10
Ni-63	-
Ni-65	2.97E+5
Cu-64	6.09E+5
Zn-65	7.45E+8
Zn-69	-
Br-83	4.89E+3
Br-84	2.03E+5
Br-85	-
Rb-86	8.98E+6
Rb-88	3.29E+4
Rb-89	1.21E+5
Sr-89	2.16E+4
Sr-90	-
Sr-91	2.19E+6
Sr-92	7.77E+5
Y-90	4.48E+3
Y-91m	1.01E+5
Y-91	1.08E+6
Y-92	1.80E+5
Y-93	1.85E+5
Zr-95	2.48E+8
Zr-97	2.94E+6
Nb-95	1.36E+8
Mo-99	4.05E+6
Tc-99m	1.83E+5
Tc-101	2.04E+4
Ru-103	1.09E+8
Ru-105	6.36E+5
Ru-106	4.21E+8
Rh-103m	-
Rh-106	-
Ag-110m	3.47E+9
Te-125m	1.55E+6
Te-127m	9.17E+4
Te-127	3.00E+3
Te-129m	2.00E+7
Te-129	2.60E+4
Te-131m	8.03E+6
Te-131	2.93E+4
Te-132	4.22E+6
I-130	5.53E+6
I-131	1.72E+7
I-132	1.24E+6
I-133	2.47E+6
I-134	4.49E+5
I-135	2.56E+6
Cs-134	6.75E+9
Cs-136	1.49E+8
Cs-137	1.04E+10

Table 7.0-4  
 Raipo, Ground Plane Pathway Dose Factors (CONT.)  
 ( $m^2 \times mrem/yr$  per  $\mu Ci/sec$ )

<u>Nuclide</u>	<u>Any Organ</u>
Cs-138	3.59E+5
Ba-139	1.06E+5
Ba-140	2.05E+7
Ba-141	4.18E+4
Ba-142	4.49E+4
La-140	1.91E+7
La-142	7.36E+5
Ce-141	1.36E+7
Ce-143	2.32E+6
Ce-144	6.95E+7
Pr-143	-
Pr-144	1.83E+3
Nd-147	8.40E+6
W-187	2.36E+6
Np-239	1.71E+6

FIGURE 7.0-1

GASEOUS RADIOACTIVE EFFLUENT MONITORING AND VENTILATION SYSTEMS DIAGRAM

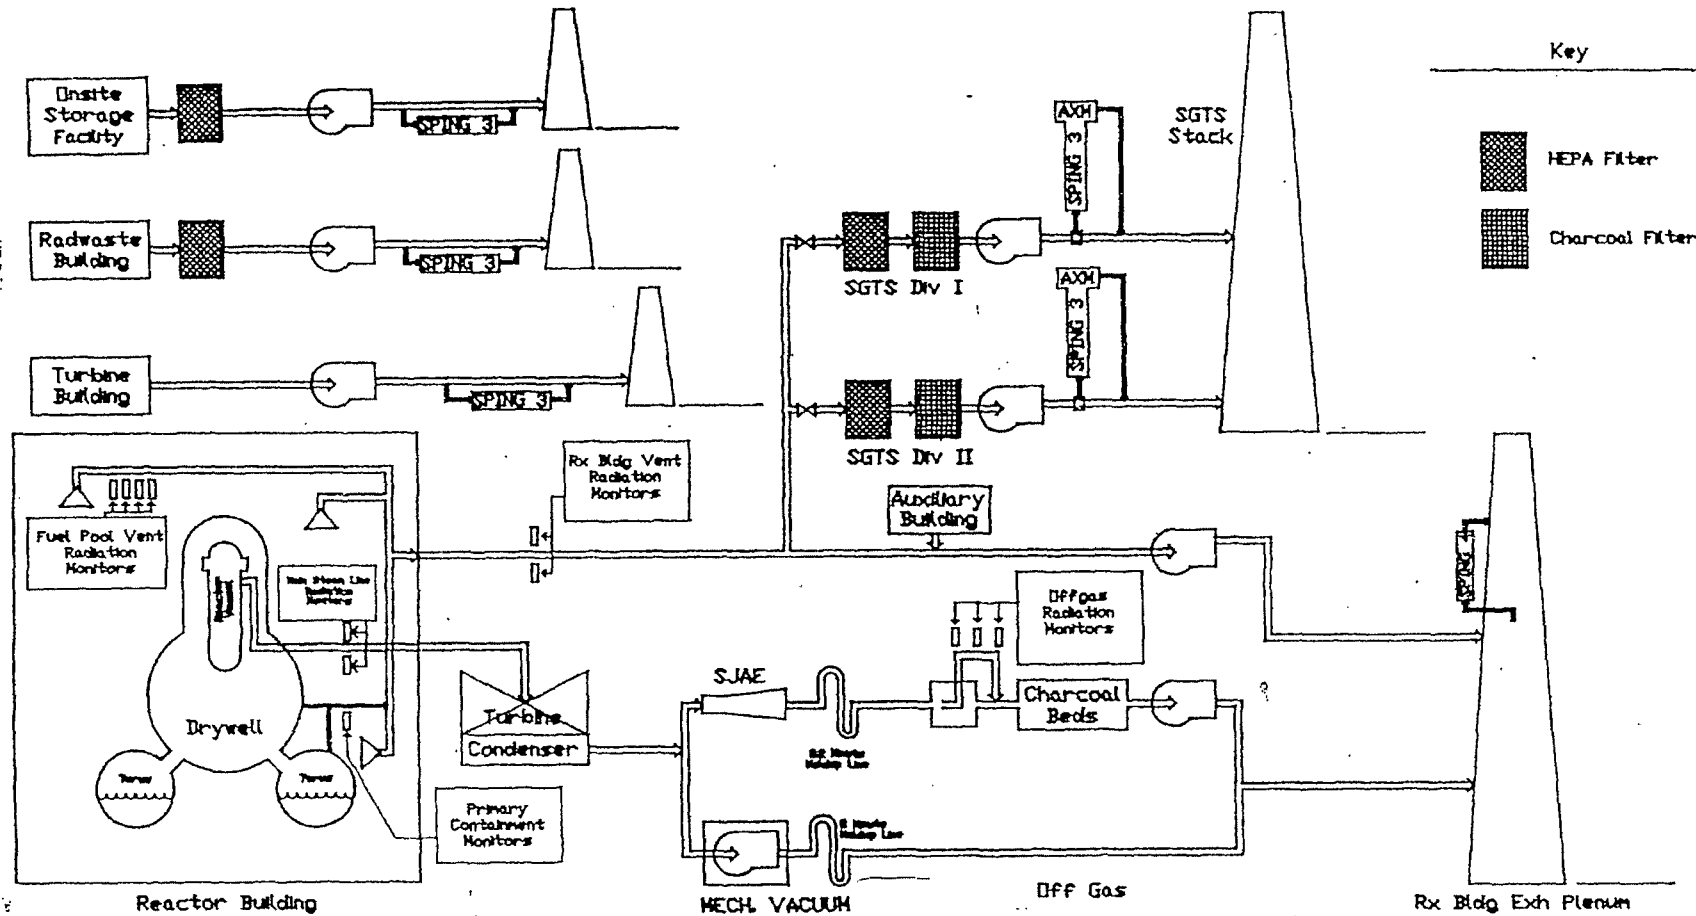

NOTE: The HEPA and charcoal filters identified on the Standby Gas Treatment System (SGTS) are engineered safety features and are not considered Ventilation Exhaust Treatment Systems (VETS). No effluent reduction was credited in the UFSAR 10CFR50 Appendix I evaluation for filters installed in plant ventilation systems. Fermi 2 conforms to 10CFR50 Appendix I without filtration installed.

**SECTION 8.0**  
**SPECIAL DOSE ANALYSIS**

## **8.0 SPECIAL DOSE ANALYSES**

### **8.1 Doses Due to Activities inside the SITE BOUNDARY**

In accordance with ODCM 5.9.1.8, the Annual Radioactive Effluent Release Report submitted prior to May 1 of each year shall include an assessment of radiation doses from radioactive liquid and gaseous effluents to MEMBERS OF THE PUBLIC due to their activities inside the SITE BOUNDARY.

Two locations within the Fermi 2 SITE BOUNDARY are accessible to MEMBERS OF THE PUBLIC for activities unrelated to Detroit Edison operational and support activities. One is the over-water portion of the SITE BOUNDARY due east of the plant. Ice fishermen sometimes fish here during the winter. The other is the Fermi 2 Visitor's Center, outside the protected area (but inside the Owner Controlled Area), approximately 470 meters SSW of the Reactor Building. The Visitor's Center is open to the public and is routinely visited by MEMBERS OF THE PUBLIC, including school tour groups on a frequency of once per year.

Conservative assumptions of locations, exposure times, and exposure pathways for assessing doses from gaseous and liquid effluents due to activities inside the SITE BOUNDARY are presented in Table 8.0-1. The calculational methods presented in ODCM Sections 7.6 and 7.7 may be used for determining the maximum potential dose to a MEMBER OF THE PUBLIC based on the above assumptions. Alternatively, the effluent concentration values of Appendix B, Table 2, of the revised 10 CFR Part 20 may be used to assess dose since these concentrations, if continuously inhaled or ingested, produce a total effective dose equivalent of 50 mrem per year.

The potential dose from the fish pathway to a MEMBER OF THE PUBLIC engaged in ice fishing within the SITE BOUNDARY is accounted for by the modeling presented in ODCM Section 6.5. Therefore, no additional special dose analyses are required for this exposure pathway for reporting in the Annual Radioactive Effluent Release Report.

### **8.2 Doses to MEMBERS OF THE PUBLIC - 40 CFR 190**

The Annual Radioactive Effluent Release Report shall also include an assessment of the radiation dose to the likely most exposed MEMBER OF THE PUBLIC for reactor releases and other nearby uranium fuel cycle sources (including dose contributions from effluents and direct radiation from onsite sources). For the likely most exposed MEMBER OF THE PUBLIC in the vicinity of the Fermi 2 site, the sources of exposure need consider only the radioactive effluents and direct exposure contribution from Fermi 2.

No other fuel cycle facilities contribute significantly to the cumulative dose to a MEMBER OF THE PUBLIC in the immediate vicinity of the site. Davis-Besse is the closest fuel cycle facility located about 20 miles to the SSE. Due to environmental dispersion, any routine releases from Davis-Besse would contribute insignificantly to the potential doses in the vicinity of Fermi 2.

As appropriate for demonstrating/evaluating compliance with the limits of ODCM 3.11.4 (40 CFR 190), the results of the environmental monitoring program may be used to provide data on actual measured levels of radioactive material in the actual pathways of exposure.

### 8.2.1 Effluent Dose Calculations

For purposes of implementing the surveillance requirements of ODCM 3.11.4 and the reporting requirements of ODCM 5.9.1.8, dose calculations for Fermi 2 may be performed using the calculational methods contained within this ODCM and the conservative controlling pathways and locations of Table 7.0-3. Liquid pathway doses may be calculated using Equation (6-10). Doses due to releases of radioiodines, tritium and particulates may be calculated based on Equation (7-14).

The following equations may be used for calculating the doses to MEMBERS OF THE PUBLIC from releases of noble gases. Equation (8-2) is not used for evaluating compliance with 40 CFR Part 190, since this regulation does not address skin dose. If noble gases are being released from more than one point, these equations must be used to evaluate each release point separately, and then the doses must be added to obtain the total noble gas dose.

$$D_{tb} = 3.17 E-08 * X / Q * \sum (K_i * Q_i) \quad (8-1)$$

and

$$D_s = 3.17 E-08 * X / Q * \sum [(L_i + 1.1M_i) * Q_i] \quad (8-2)$$

where:

- $D_{tb}$  = total body dose due to gamma emissions for noble gas radionuclides (mrem)
- $D_s$  = skin dose due to gamma and beta emissions for noble gas radionuclides (mrad)
- $X/Q$  = atmospheric dispersion to the offsite location (sec/m<sup>3</sup>)
- $Q_i$  = cumulative release of noble gas radionuclide i over the period of interest ( $\mu$ Ci)--may be determined according to Equation (7-8)
- $1.67E + 01$  =  $(1E + 03 \text{ ml/liter}) * (1 \text{ min}/60 \text{ sec})$

$K_i$	=	total body dose factor due to gamma emissions from noble gas radionuclide $i$ (mrem/yr per $\mu\text{Ci}/\text{m}^3$ ) (from Table 7.0-2)
$L_i$	=	skin dose factor due to beta emissions from noble gas radionuclide $i$ (mrem/yr per $\mu\text{Ci}/\text{m}^3$ ) (from Table 7.0-2)
$M_i$	=	gamma air dose factor for noble gas radionuclide $i$ (mrad/yr per $\mu\text{Ci}/\text{m}^3$ ) (from Table 7.0-2)
1.1	=	mrem skin dose per mrad gamma air dose (mrem/mrad)
$3.17 \text{ E} - 08$	=	$1/3.15 \text{ E} + 07$ yr/sec

Average annual meteorological dispersion parameters or meteorological conditions concurrent with the release period under evaluation may be used (e.g., quarterly averages or year-specific annual averages).

#### 8.2.2 Direct Exposure Dose Determination

From evaluations performed in the Fermi 2 Environmental Report, Section 5.3.4, the direct exposure to the highest offsite location from the Turbine Building N-16 skyshine dose has been calculated to be approximately 3 mrem/year. The introduction of hydrogen injection at Fermi 2 in 1997 (hydrogen water chemistry) tends to increase direct exposure. Direct exposure to offsite or onsite individuals may be evaluated based on the results of environmental measurements (e.g. area TLD and survey meter data) or by the use of a radiation transport and shielding calculational method. Only during atypical conditions will there exist any potential for significant onsite sources at Fermi 2 that would yield potentially significant offsite doses to a MEMBER OF THE PUBLIC. However, should a situation exist whereby the direct exposure contribution is potentially significant, onsite measurements, offsite measurements and calculational techniques will be used for determination of dose for assessing 40 CFR 190 compliance. The calculational techniques will be identified, reviewed, and approved at that time, and will be included in any report on doses due to such atypical conditions.

#### 8.2.3 Dose Assessment Based on Radiological Environmental Monitoring Data

Normally, the assessment of potential doses to MEMBERS OF THE PUBLIC must be calculated based on the measured radioactive effluents at the plant. The resultant levels of radioactive material in the offsite environment are usually so minute as to be undetectable. The calculational methods presented in this ODCM are used for modeling the transport in the environment and the resultant exposure to offsite individuals.



The results of the radiological environmental monitoring program can provide input into the overall assessment of impact of plant operations and radioactive effluents. With measured levels of plant related radioactive material in principal pathways of exposure, a quantitative assessment of potential exposures can be performed. With the monitoring program not identifying any measurable levels, the data provides a qualitative assessment - a confirmatory demonstration of the negligible impact.

Dose modeling can be simplified into three basic parameters that can be applied in using environmental monitoring data for dose assessment:

$$D = C * U * DF$$

(8-3)

where:

D = dose or dose commitment

C = concentration in the exposure media, such as air concentration for the inhalation pathway, or fish, vegetation or milk concentration for the ingestion pathway

U = individual exposure to the pathway, such as hr/yr for direct exposure, kg/yr for ingestion pathway

DF = dose conversion factor to convert from an exposure or uptake to an individual dose or dose commitment

The applicability of each of these basic modeling parameters to the use of environmental monitoring data for dose assessment is addressed below:

### Concentration - C

The main value of using environmental sampling data to assess potential doses to individuals is that the data represents actual measured levels of radioactive material in the exposure pathways. This eliminates one main uncertainty and the modeling has been removed - the release from the plant and the transport to the environmental exposure medium.

Environmental samples are collected on a routine frequency per the ODCM. To determine the annual average concentration in the environmental medium for use in assessing cumulative dose for the year, an average concentration should be determined based on the sampling frequency and measured levels:

$$\bar{C}_i = \sum (C_i * t) / 365$$

(8-4)

where:

$\bar{C}_i$  = average concentration in the sampling medium for the year

$C_i$  = concentration of each radionuclide  $i$  measured in the individual sampling medium

$t$  = period of time that the measured concentration is considered representative of the sampling medium (typically equal to the sampling frequency; e.g., 7 days for weekly samples, 30 days for monthly samples).

If the concentration in the sampling medium is below the detection capabilities (i.e., less than Lower Limits of Detection (LLD)), a value of zero should be used for  $C_i$  ( $C_i = 0$ ).

### **Exposure - U**

Default Exposure Values (U) as recommended in Regulatory Guide 1.109 are presented in Table 8.0-2. These values should be used only when specific data applicable to the environmental pathway being evaluated is unavailable.

Also, the routine radiological environmental monitoring program is designed to sample/monitor the environmental media that would provide early indications of any measurable levels in the environment but not necessarily levels to which any individual is exposed. For example, sediment samples are collected in the area of the liquid discharge: typically, no individuals are directly exposed. To apply the measured levels of radioactivity in samples that are not directly applicable to exposure to real individuals, the approach recommended is to correlate the location and measured levels to actual locations of exposure.

Hydrological or atmospheric dilution factors can be used to provide reasonable correlations of concentrations (and doses) at other locations. The other alternative is to conservatively assume a hypothetical individual at the sampling location. Doses that are calculated in this manner should be presented as hypothetical and very conservatively determined - actual exposure would be much less. Samples collected from the Monroe water supply intake should be used for estimating the potential drinking water doses. Other water samples collected, such as near field dilution area, are not applicable to this pathway.

### **Dose Factors - DF**

The dose factors are used to convert the intake of the radioactive material to an individual dose commitment. Values of the dose factors are presented in NRC Regulatory Guide 1.109. The use of the RG 1.109 values applicable to the exposure pathway and maximum exposed individual is referenced in Table 8.0-2.

### **Assessment of Direct Exposure Doses from Noble Gases**

Thermoluminescent Dosimeters (TLD) are routinely used to assess the direct exposure component of radiation doses in the environment. However, because routine releases of radioactive material (noble gases) are so low, the resultant direct exposure doses are also very low. A study\* performed for the NRC concluded that it was generally impractical to distinguish any plant contribution to the natural background radiation levels (direct exposure) below around 10 mrem per year. Therefore, for routine releases from nuclear power plants the use of TLD is mainly confirmatory - ensuring actual exposures are within the expected natural background variation.

For releases of noble gases, environmental modeling using plant measured releases and atmospheric transport models as presented in ODCM Sections 7.6 and 8.2.1 represents the best method of assessing potential environmental doses. However, under unusual conditions, direct radiation from noble gas concentrations could be sufficient to cause significant increases in TLD readings; any observed variations in TLD measurements outside the norm should be evaluated.

---

\* NUREG/CR-0711, Evaluation of Methods for the Determination of X- and Gamma-Ray Exposure Attributable to a Nuclear Facility Using Environmental TLD Measurements, Gail dePlanque, June 1979, USNRC.

TABLE 8-1

Assumptions for Assessing Doses Due to  
Activities inside SITE BOUNDARY

	Ice Fishing	Visitor's Center
Distance/ Direction:	470 meters / E	470 meters / SSW
Estimated Exposure Time:	240 hr/yr (20 hr/week over 3 month period)	4 hr/yr (4 hr/visit, 1 visit per year)
Exposure Pathways:	direct exposure from noble gases  inhalation of tritium, iodines, particulates	direct exposure from noble gases  inhalation of tritium, iodines particulates
Meteorological Dispersion:	annual average (as determined for year being evaluated)  6.48E-6 sec/m <sup>3</sup> *	annual average (as determined for year being evaluated)  2.54E-6 sec/m <sup>3</sup> *

---

\* Annual average X/Q values for 1991. These values are shown as examples of the range of values to be expected.

**TABLE 8-2**

**Recommended Exposure Rates in Lieu of  
Site Specific Data\***

<b>Exposure Pathway</b>	<b>Maximum Exposed Age Group</b>	<b>Exposure Rates</b>	<b>Table Reference for Dose Factor from RG 1.109</b>
<b>Liquid Releases</b>			
Fish	Adult	21 kg/y	E-11
Drinking Water	Adult	730 l/y	E-11
Bottom Sediment	Teen	67 h/y	E-6
<b>Atmospheric Releases</b>			
Inhalation	Teen	8,000 m <sup>3</sup> /y	E-8
Direct Exposure	All	6,100 h/y**	N/A
Leafy Vegetables	Child	26 kg/y	E-13
Fruits, Vegetables and Grain	Teen	630 kg/y	E-12
Milk	Infant	330 l/y	E-14

\* Adapted from Regulatory Guide 1.109, Table E-5. This table is not a complete list of exposure rates; other applicable values may be found in Regulatory Guide 1.109.

\*\* Net exposure of 6,100 h/y is based on the total 8760 hours per year adjusted by a 0.7 shielding factor as recommended in Regulatory Guide 1.109.

**END OF SECTION 8.0**

## **SECTION 9.0**

# **ASSESSMENT OF LAND USE CENSUS**

## **9.0 ASSESSMENT OF LAND USE CENSUS DATA**

A Land Use Census (LUC) is conducted annually in the vicinity of the Fermi 2 site. This census fulfills two main purposes: 1) Meet requirements of ODCM 3.12.2 for identifying controlling location/pathway for dose assessment of ODCM 3.11.2.3; and 2) provide data on actual exposure pathways for assessing realistic doses to MEMBERS OF THE PUBLIC.

### **9.1 Land Use Census as Required by ODCM 3.12.2**

As required by ODCM 3.12.2, a land use census shall be conducted during the growing season at least once per twelve months. The purpose of the census is to identify within a 5 mile distance the location in each of the 16 meteorological sectors of all milk producing animals, all meat producing animals, all gardens larger than 500 ft<sup>2</sup> producing broadleaf vegetation, and the closest residence to the plant. The data from the LUC is used for updating the location/pathway for dose assessment and for updating the Radiological Environmental Monitoring Program.

If the census identifies a location/pathway(s) yielding a higher potential dose to a MEMBER OF THE PUBLIC than currently being assessed as required by ODCM 3.11.2.3 (and ODCM Section 7.7 and Table 7.0-3), this new location pathway(s) shall be used for dose assessment. Table 7.0-3 shall be updated to include the currently identified controlling location/pathway(s). Also, if the census identifies a location(s) that yields a calculated potential dose (via the same exposure pathway) 20% greater than a location currently included in the Radiological Environmental Monitoring Program, the new location(s) shall be added to the program within 30 days, unless permission to take samples cannot be obtained from the affected landowner. The sampling location(s), excluding control locations, having the lowest calculated dose may be deleted from the program after October 31 following the current census. As required by ODCM 3.12.2 and 5.9.1.8, the new location/pathway(s) shall be identified in the next Annual Radioactive Effluent Release Report. The following guideline shall be used for assessing the results from the land use census to ensure compliance with ODCM 3.12.2.

#### **9.1.1 Data Compilation**

1. Compile all locations and pathways of exposure as identified by the land use census.
2. From this compiled data, identify any changes from the previous year's census. Identify the current controlling location/pathway (critical receptor) used in ODCM Table 7.0-3. Also, identify any location currently included in the REMP (Table 10-1).

3. Perform relative dose calculations based on actual Fermi 2 gaseous effluent releases for a recent period of reactor operation, using the pathway dose equations of the ODCM. In identifying the critical receptor for Table 7.0-3, all age groups and all pathways relevant to ODCM 3.11.2.3 that may be present at each evaluated location are considered. The critical receptor is assumed to be a member of the age group with the highest calculated dose to the maximally exposed organ due to I-131, I-133, tritium, and particulates with half lives greater than 8 days. Other receptors may have higher doses to other organs than the critical receptor has to those organs.
4. Formulate a listing of locations of high dose significance in descending order of relative dose significance. Include the relative dose significance in the listing.

#### 9.1.3 Program Updates

1. If any receptor is identified with a higher relative dose than the current critical receptor in ODCM Table 7.0-3, this receptor and its associated location and pathways should replace the previously identified critical receptor information in Table 7.0-3.
2. The Land Use Census data should be used to revise the REMP and Section 10.0 of the ODCM in accordance with ODCM 3.12.2, Action Item b.
3. Any changes in either the controlling location/pathway(s) (critical receptor) for the ODCM dose calculations (Section 7.7 and Table 7.0-3) or the REMP (ODCM Section 10.0 and Table 10-1) shall be reported to NRC in accordance with ODCM 3.12.2, Action Items a. and b. and ODCM 5.9.1.8.

**NOTE:** As permitted by footnote to ODCM 3.12.2, broadleaf vegetation sampling may be performed at the SITE BOUNDARY in two locations, in different sectors with highest predicted D/Qs, in lieu of the garden census. Also, for conservatism in dose assessment for compliance with ODCM 3.11.2.3 (see also ODCM Section 7.7 and Table 7.0-3), hypothetical exposure location/pathway(s) and conservative dispersion factors may be assumed (e.g., milk cow at 5 mile location or garden at SITE BOUNDARY in highest D/Q sector). By this approach, the ODCM is not subject to frequent revision as pathways and locations change from year to year. A verification that the hypothetical pathway remains conservative and valid is still required. Also, for NRC reporting, the actual pathways and doses should be reported along with the hypothetical. The reporting of the actual pathway and doses provides a formal documentation of the more realistic dose impact.

Note: Page content was last changed with ODCM Revision 16.



## **9.2 Land Use Census to Support Realistic Dose Assessment**

The LUC provides data needed to support the special dose analyses of the ODCM Section 8.0. Activities inside the SITE BOUNDARY should be periodically reviewed for dose assessment as required by ODCM 5.9.1.8 (see also ODCM Section 8.1). Assessment of realistic doses to MEMBERS OF THE PUBLIC is required by ODCM 3.11.4 for demonstrating compliance with the EPA Environmental Dose Standard, 40 CFR 190 (ODCM Section 8.2).

To support these dose assessments, the LUC shall include use of Lake Erie water on and near the site. The LUC shall include data on Lake Erie use obtained from local and state officials. Reasonable efforts shall be made to identify individual irrigation and potable water users, and industrial and commercial water users whose source is Lake Erie. This data is used to verify the pathways of exposure used in ODCM Section 6.5.

**END OF SECTION 9.0**

**SECTION 10.0**

**RADIOLOGICAL ENVIRONMENTAL  
MONITORING PROGRAM**

## 10.0 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

The Radiological Environmental Monitoring Program (REMP) is conducted in accordance with the requirements of ODCM 3.12.1. The sampling and analysis program described herein was developed to provide representative measurements of radiation and radioactive materials resulting from station operation in the principal pathways of exposure of MEMBERS OF THE PUBLIC. This monitoring program implements Section IV.B.2 of Appendix I to 10 CFR Part 50 and thereby supplements the radiological effluent control program by verifying that the measurable concentrations of radioactive materials and levels of radiation are not higher than expected on the basis of the effluent measurements and the modeling of the environmental exposure pathways. Guidance for the development of this monitoring program is provided by the NRC Radiological Assessment Branch Technical Position on Environmental Monitoring, Revision 1, November 1979.

### 10.1 Sampling Locations

Sampling locations as required by ODCM 3.12.1 are described in Table 10.0-1.

**NOTE:** For purposes of implementing ODCM 3.12.2, sampling locations will be modified as required to reflect the findings of the annual land use census as described in ODCM Section 9.1 and as required by other contingencies (e.g. unavailability of milk from a listed location). Such changes will be documented in plant records and reflected in the next ODCM revision, the next Annual Effluent Release Report, and the next Annual Radiological Environmental Operating Report. Also, if the circumstances of such changes involve a possible change in the maximally exposed individual evaluated for ODCM Control 3.11.2.3, the identity of this individual will be reevaluated.

### 10.2 Reporting Levels

ODCM 3.12.1, Action b, describes criteria for a Special Report to the NRC if levels of plant-related radioactive material, when averaged over a calendar quarter, exceed the prescribed levels of ODCM Table 3.12.1-2. The reporting levels are based on the design objective doses of 10 CFR 50, Appendix I (i.e., the annual limits of ODCM 3.11.1.2, 3.11.2.2 and 3.11.2.3). In other words, levels of radioactive material in the respective sampling medium equal to the prescribed reporting levels are representative of potential annual doses of 3 mrem, total body or 10 mrem, maximum organ from liquid pathways; or 5 mrem, total body, or 15 mrem, maximum organ for the gaseous effluent pathway. These potential doses are modeled on the maximum individual exposure or consumption rates of NRC Regulatory Guide 1.109.

The evaluation of potential doses should be based solely on radioactive material resulting from plant operation. As stated in ODCM 3.12.1, Action b, the report shall also be submitted if radionuclides other than those in ODCM Table 3.12.1-2 are detected (and are a result of plant effluents) and the potential dose exceeds the above annual design objectives. The method described in ODCM Section 8.2.3 may be used for assessing the potential dose and required reporting for radionuclides other than those in ODCM Table 3.12.1-2.

### 10.3 Interlaboratory Comparison Program

A major objective of this program is to assist laboratories involved in environmental radiation measurements to develop and maintain both an intralaboratory and an interlaboratory quality control program. This is accomplished through a laboratory intercomparison study ("cross-check") program involving environmental media and a variety of radionuclides with activities at or near environmental levels.

Simulated environmental samples, containing known amounts of one or more radionuclides, are prepared and routinely distributed to Detroit Edison's contract environmental laboratory, which performs the required analyses. The analysis results are then compared to the known concentrations in the samples. The program thus enables the laboratory to document the precision and accuracy of its radiation data, and identify instrument and procedural problems.

The environmental laboratory is required to participate in an Interlaboratory Comparison Program and to submit QA Program Progress Summary Reports to Detroit Edison on an annual basis. These reports contain performance data summaries on blind spiked analyses, and explanations of deviations from expected results. A summary of the Interlaboratory Comparison Program results obtained is required to be included in the Annual Radiological Environmental Operating Report pursuant to ODCM 5.9.1.7.

Participation in an Interlaboratory Comparison Program ensures that an independent check on the precision and accuracy of the measurements of radioactive material in environmental sample matrices is performed as part of the QA Program for environmental monitoring in order to demonstrate that the results are valid for the purpose of Section IV.B.2 of Appendix I to 10 CFR Part 50.

**TABLE 10.0-1**

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM  
FERMI 2 SAMPLE LOCATIONS AND ASSOCIATED MEDIA**

**KEY**

- |     |     |  |
|-----|-----|--|
| 1 - | T   | TLD Locations (Pg. 10-5 through 10-9)        |
| 2 - | S   | Sediments Locations (Pg. 10-10)              |
| 3 - | F   | Fish Locations (Pg. 10-10)                   |
| 4 - | M   | Milk Locations (Pg. 10-11)                   |
| 5 - | DW  | Drinking Water Locations (Pg. 10-12)         |
| 6 - | SW  | Surface Water Locations (Pg. 10-12)          |
| 7 - | GW  | Ground Water Locations (Pg. 10-12)           |
| 8 - | API | Air Particulate/Iodine Locations (Pg. 10-13) |
| 9 - | FP  | Food Products Locations (Pg. 10-14)          |

TABLE 10.0-1

## Radiological Environmental Monitoring Program, Fermi 2 Sample Locations and Associated Media

## Direct Radiation

<i>Station Number</i>	<i>Meteorological Sector/Azimuth Direction</i>	<i>Distance from Reactor (Approx.)</i>	<i>Description</i>	<i>Media</i>	<i>Frequency</i>
T1	NE/38°	1.3 mi	Estral Beach Pole on Lakeshore, 23 Poles S of Lakeview (Special Area)	Direct Radiation	Q
T2	NNE/22°	1.2 mi	Pole at termination of Brancheau St. (Special Area)	Direct Radiation	Q
T3	N/9°	1.1 mi	Pole, NW Corner of Swan Boat Club Fence (Special Area)	Direct Radiation	Q
T4	NNW/337°	0.6 mi	Site Boundary and Toll Rd, on Site Fence by API #2	Direct Radiation	Q
T5	NW/313°	0.6 mi	Site Boundary and Toll Rd, on Site Fence by API #3	Direct Radiation	Q
T6	WNW/294°	0.6 mi	Site boundary fence at south end of N. Bullit Rd.	Direct Radiation	Q
T7	W/270°	14.0 mi	Pole, at Michigan Gas substation on N. Custer Rd., 0.66 miles W of Doty Rd. (Control)	Direct Radiation	Q
T8	NW/305°	1.9 mi	Pole on Post Rd. near NE Corner of Dixie Hwy. and Post Rd.	Direct Radiation	Q
T9	NNW/334°	1.5 mi	Pole, NW Corner of Trombley and Swan View Road	Direct Radiation	Q
T10	N/6°	2.1 mi	Pole, S Side of Masserant - 2 Poles W of Chinavare	Direct Radiation	Q
T11	NNE/23°	6.2 mi	Pole, NE Corner of Milliman and Jefferson	Direct Radiation	Q
T12	NNE/29°	6.3 mi	Pointe Mouillee Game Area - Field Office, Pole near Tree, N Area of Parking Lot	Direct Radiation	Q
T13	N/356°	4.1 mi	Labo and Dixie Hwy - Pole on SW Corner with Light	Direct Radiation	Q
T14	NNW/337°	4.4 mi	Labo and Brandon - Pole on SE Corner near RR	Direct Radiation	Q

TABLE 10.0-1

## Radiological Environmental Monitoring Program, Fermi 2 Sample Locations and Associated Media

## Direct Radiation

<i>Station Number</i>	<i>Meteorological Sector/Azimuth Direction</i>	<i>Distance from Reactor (Approx.)</i>	<i>Description</i>	<i>Media</i>	<i>Frequency</i>
T15	NW/315°	3.9 mi	Pole, behind building at the corner of Swan Creek and Mill St.	Direct Radiation	Q
T16	WNW/283°	4.9 mi	Pole, SE corner of War and Post Rds.	Direct Radiation	Q
T17	W/271°	4.9 mi	Pole, NE Corner of Nadeau and LaPrad near Mobile Home Park	Direct Radiation	Q
T18	WSW/247°	4.8 mi	Pole, NE Corner of Mentel and Hurd	Direct Radiation	Q
T19	SW/236°	5.2 mi	Fermi siren pole on Waterworks Rd, NE corner of intersection— Sterling State Park Rd Entrance Drive/Waterworks	Direct Radiation	Q
T20	WSW/257°	2.7 mi	Pole, S Side of Williams Rd. - 9 Poles W of Dixie Hwy. (Special Area)	Direct Radiation	Q
T21	WSW/239°	2.7 mi	Pole, N Side of Pearl at Parkview - Woodland Beach (Special Area)	Direct Radiation	Q
T22	S/172°	1.2 mi	Pole, N Side of Pointe Aux Peaux 2 Poles W of Long - Site Boundary	Direct Radiation	Q
T23	SSW/195°	1.1 mi	Pole, S Side of Pointe Aux Peaux - 1 Pole W of Huron next to Vent Pipe - Site Boundary	Direct Radiation	Q
T24	SW/225°	1.2 mi	Fermi Gate along Pointe Aux Peaux Rd.- on fence wire W of Gate - Site Boundary	Direct Radiation	Q
T25	WSW/252°	1.5 mi	Pole, Toll Rd. - 12 Poles S of Fermi Dr.	Direct Radiation	Q
T26	WSW/259°	1.1 mi	Pole, Toll Rd. - 6 Poles S of Fermi Dr.	Direct Radiation	Q
T27	SW/225°	6.8 mi	Pole, NE Corner of McMillan and East Front St. (Special Area)	Direct Radiation	Q
T28	SW/229°	10.7 mi	Pole, N Side of Mortar Creek between Hull and LaPlaisance	Direct Radiation	Q
T29	WSW/237°	10.3 mi	Pole, NE Corner of S Dixie and Albain	Direct Radiation	Q

TABLE 10.0-1

## Radiological Environmental Monitoring Program, Fermi 2 Sample Locations and Associated Media

## Direct Radiation

Station Number	Meteorological Sector/Azimuth Direction	Distance from Reactor (Approx.)	Description	Media	Frequency
T30	WSW/247°	7.8 mi	E Side S end of footbridge, St. Mary's Park corner of Elm and Monroe St. (Special Area)	Direct Radiation	Q
T31	WSW/255°	9.6 mi	1st Pole W of Entrance Drive Milton "Pat" Munson Recreational Reserve - N. Custer Rd. (Control)	Direct Radiation	Q
T32	WNW/295°	10.3 mi	Pole, Corner of Stony Creek and Finzel Rds.	Direct Radiation	Q
T33	NW/317°	9.2 mi	Pole, W Side of Grafton Rd. 1 Pole N of Ash/Grafton Intersection	Direct Radiation	Q
T34	NNW/338°	9.8 mi	Pole, SW Corner of Port Creek and Will-Carleton Rd	Direct Radiation	Q
T35	N/359°	6.9 mi	Pole, S Side of S. Huron River Dr. across from Race St. (Special Area)	Direct Radiation	Q
T36	N/358°	9.1 mi	Pole, NE Corner of Gibraltar and Cahill Rds.	Direct Radiation	Q
T37	NNE/21°	9.8 mi	Pole, S Corner of Adams and Gibraltar (across from Humbug Marina)	Direct Radiation	Q
T38	WNW/294°	1.7 mi	Residence - 6594 N. Dixie Hwy.	Direct Radiation	Q
T39	S/176°	0.3 mi	SE Corner of Protected Area Fence (PAF)	Direct Radiation	Q
T40	S/170°	0.3 mi	Midway along OBA - PAF	Direct Radiation	Q
T41	SSE/161°	0.2 mi	Midway between OBA and Shield Wall - PAF	Direct Radiation	Q
T42	SSE/149°	0.2 mi	Midway along Shield Wall - PAF.	Direct Radiation	Q
T43	SE/131°	0.1 mi	Midway between Shield Wall and Aux Boilers - PAF	Direct Radiation	Q
T44	ESE/109°	0.1 mi	Opposite OSSF Door - PAF	Direct Radiation	Q



TABLE 10.0-1

## Radiological Environmental Monitoring Program, Fermi 2 Sample Locations and Associated Media

## Direct Radiation

<i>Station Number</i>	<i>Meteorological Sector/Azimuth Direction</i>	<i>Distance from Reactor (Approx.)</i>	<i>Description</i>	<i>Media</i>	<i>Frequency</i>
T45	E/86°	0.1 mi	NE Corner - PAF		
T46	ENE/67°	0.2 mi	NE Side Barge Slip - on Fence	Direct Radiation	Q
T47	S/185°	0.1 mi	South of Turbine Bldg. rollup door on PAF	Direct Radiation	Q
T48	SW/235°	0.2 mi	30 ft. from corner of AAP on PAF		
T49	WSW/251°	1.1 mi	Corner of site boundary fence north of NOC along Critical Path Rd.	Direct Radiation	Q
T50	W/270°	0.9 mi	Site boundary fence near main gate by the south Bullit St. sign	Direct Radiation	Q
T51	N/3°	0.4 mi	Site boundary fence north of North Cooling Tower	Direct Radiation	Q
T52	NNE/20°	0.4 mi	Site boundary fence at the corner of Arson and Tower	Direct Radiation	Q
T53	NE/55°	0.2 mi	Site boundary fence east of South Cooling Tower	Direct Radiation	Q
T54	S/189°	0.3 mi	Pole, next to Fermi 2 Visitors Center	Direct Radiation	Q
T55	WSW/251°	3.3 mi	Pole, N side of Nadeau Rd, across from Sodt Elementary School Marquee	Direct Radiation	Q
T56	WSW/255°	4.9 mi	Pole, entrance to Jefferson Middle School on Stony Creek Rd.	Direct Radiation	Q
T57	W/260°	2.7 mi	Pole, north side of Williams Rd. across from Jefferson High School entrance	Direct Radiation	Q
T58	WSW/249°	4.9 mi	Pole, west of Hurd Elementary School Marquee	Direct Radiation	Q
T59	NW/325°	2.6 mi	Pole, north of St. Charles Church entrance on Dixie Hwy.	Direct Radiation	Q
T60	NNW/341°	2.5 mi	1st pole north of North Elementary School entrance on Dixie Hwy.	Direct Radiation	Q

TABLE 10.0-1

## Radiological Environmental Monitoring Program, Fermi 2 Sample Locations and Associated Media

## Direct Radiation

Station Number	Meteorological Sector/Azimuth Direction	Distance from Reactor (Approx.)	Description	Media	Frequency
T61	W/268°	10.1 mi	Pole, SW Corner of Stewart and Raisinville Rds.	Direct Radiation	Q
T62	SW/232°	9.7 mi	Pole, NW Corner of Albain and Hull Rds.	Direct Radiation	Q
T63	WSW/245°	9.6 mi	Pole, Corner of Dunbar and Telegraph Rds.	Direct Radiation	Q
T64	WNW/286°	0.2 mi	W of switchgear yard on PAF	Direct Radiation	Q
T65	NW/322°	0.1 mi	PAF switchgear yard area NW of RHR complex	Direct Radiation	Q
T66	NE/50°	0.1 mi	Behind Bldg. 42 on PAF	Direct Radiation	Q
T67	NNW/338°	0.2 mi	Site boundary fence W of S cooling tower	Direct Radiation	Q
T68	WNW/303°	0.6 mi	Langton Rd seven poles E of Leroux Rd	Direct Radiation	Q
T69	NW/306°	0.8 mi	Langton Rd five poles E of Leroux Rd	Direct Radiation	Q
T70	NNW/333°	1.1 mi	Leroux Rd last pole N of Fermi Dr	Direct Radiation	Q
T71	WNW/300°	1.1 mi	Leroux Rd six poles N of Fermi Dr	Direct Radiation	Q
ISFSI-1	WNW/302.3°	0.175 mi	Center of west ISFSI fence line	Direct Radiation	Q
ISFSI-2	NW/310.2°	0.186 mi	Northwest corner of ISFSI fence	Direct Radiation	Q
ISFSI-3	NW/313.2°	0.166 mi	Center of north ISFSI fence line	Direct Radiation	Q
ISFSI-4	NW/315.6°	0.149 mi	Northeast corner of ISFSI fence	Direct Radiation	Q
ISFSI-5	NW/305.4°	0.140 mi	Center of east ISFSI fence line	Direct Radiation	Q
ISFSI-6	WNW/294.1°	0.136 mi	Southeast corner of ISFSI fence	Direct Radiation	Q
ISFSI-7	WNW/293.0°	0.157 mi	Center of south ISFSI fence line	Direct Radiation	Q
ISFSI-8	WNW/293.0°	0.177 mi	Southwest corner of ISFSI fence	Direct Radiation	Q

TABLE 10.0-1

## Radiological Environmental Monitoring Program, Fermi 2 Sample Locations and Associated Media

## Fish and Sediment

<i>Station Number</i>	<i>Meteorological Sector/Azimuth Direction</i>	<i>Distance from Reactor (Approx.)</i>	<i>Description</i>	<i>Media</i>	<i>Frequency</i>
<b>SEDIMENTS</b>					
S-1	SSE/165°	0.9 mi	Pointe Aux Peaux, Shoreline to 500 ft. offshore sighting directly to Land Base Water Tower	Sediment	SA
S-2	E/81°	0.2 mi	Fermi 2 Discharge, approx. 200 ft. offshore	Sediment	SA
S-3	NE/39°	1.1 mi	Estral Beach, approx. 200 ft. offshore, off North shoreline where Swan Creek and Lake Erie meet	Sediment	SA
S-4	WSW/241°	3.0 mi	Indian Trails Community Beach	Sediment	SA
S-5	NNE/20°	11.7 mi	DECo's Trenton Channel Power Plant intake area (Control)	Sediment	SA
<b>FISH</b>					
F-1	NNE/31°	9.5 mi	Celeron Island (Control)	Fish	SA
F-2	E/86°	0.4 mi	Fermi 2 Discharge (Approx. 1200 ft. offshore)	Fish	SA
F-3	SW/227°	3.5 mi	Breast Bay Area (Control)	Fish	SA

TABLE 10.0-1

## Radiological Environmental Monitoring Program, Fermi 2 Sample Locations and Associated Media

## Milk/Grass

<i>Station Number</i>	<i>Meteorological Sector/Azimuth Direction</i>	<i>Distance from Reactor (Approx.)</i>	<i>Description</i>	<i>Media</i>	<i>Frequency</i>
M-2	NW/319°	5.4 mi	Reaume Farm -2705 E. Labo	Milk	M-SM
M-8	WNW/289°	9.9 mi	Calder Dairy - 9334 Finzel Rd.	Milk	M-SM

TABLE 10.0-1

## Radiological Environmental Monitoring Program, Fermi 2 Sample Locations and Associated Media

## Water

<i>Station Number</i>	<i>Meteorological Sector/Azimuth Direction</i>	<i>Distance from Reactor (Approx.)</i>	<i>Description</i>	<i>Media</i>	<i>Frequency</i>
<b>DRINKING WATER</b>					
DW-1	S/174°	1.1 mi	Monroe Water Station N Side of Pointe Aux Peaux 1/2 Block W of Long Rd.	Drinking Water	M
DW-2	N/8°	18.5 mi	Detroit Water Station, 14700 Moran Rd. Allen Park (Control)	Drinking Water	M
<b>SURFACE WATER</b>					
SW-2	NNE/20°	11.7 mi	DECo's Trenton Channel Power Plant Intake Structure (Screenhouse #1) (Control)	Surface Water	M
SW-3	SSE/160°	0.2 mi	DECo's Fermi 2 General Service Water Intake Structure	Surface Water	M
<b>SITE WELLS</b>					
GW-1	S/175°	0.4 mi	Approx. 100 ft. W of Lake Erie, EF-1 Parking lot Groundwater near gas fired peakers	Groundwater	Q
GW-2	SSW/208°	1.0 mi	4 ft. S of Pointe Aux Peaux (PAP) Rd. Fence 427 ft. W of where PAP crosses over Stony Point's Western Dike	Groundwater	Q
GW-3	SW/226°	1.0 mi	143 ft. W of PAP Rd. Gate, 62 ft. N of PAP Rd. Fence	Groundwater	Q
GW-4	WNW/299°	0.6 mi	42 ft. S of Langton Rd., 8 ft. E of Toll Rd. Fence	Groundwater	Q

TABLE 10.0-1

## Radiological Environmental Monitoring Program, Fermi 2 Sample Locations and Associated Media

## Air Particulate Air Iodine

Station Number	Meteorological Sector/Azimuth Direction	Distance from Reactor (Approx.)	Description	Media	Frequency
API-1	NE/39°	1.4 mi	Estral Beach Pole on Lakeshore, 18 Poles S of Lakeview (Nearest Community with highest $\chi/Q$ )	Radioiodine Particulates	W W
API-2	NNW/337°	0.6 mi	Site Boundary and Toll Road, on Site Fence by T-4	Radioiodine Particulates	W W
API-3	NW/313°	0.6 mi	Site Boundary and Toll Road, on Site Fence by T-5	Radioiodine Particulates	W W
API-4	W/270°	14.0 mi	Pole, at Michigan Gas substation on N. Custer Rd, 0.66 miles W of Doty Rd. (control)	Radioiodine Particulates	W W
API-5	S/188°	1.2 mi	Pole, N corner of Pointe Aux Peaux and Dewey Rd.	Radioiodine Particulates	W W

Note: Page content was last changed with ODCM Revision 16.

TABLE 10.0-1.

Radiological Environmental Monitoring Program, Fermi 2 Sample Locations and Associated Media

Food Products

Station Number	Metereological Sector/Azimuth Direction	Distance from Reactor (Approx)	Description	Media	Frequency
FP-1	NNE/21°	3.8 mi	9501 Turnpike Highway	Food Products	M (when available)
FP-9	W/261°	10.9 mi	4074 North Custer Road	Food Products	M (when available)

Note: Page content was last changed with ODCM Revision 16.

TABLE 10.0-1

Radiological Environmental Monitoring Program, Fermi 2 Sample Locations and Associated Media

Land Use Census Closest Residences

Station Number	Meteorological Sector/Azimuth Direction	Distance from Reactor (Approx)	Description	Media	Frequency
	NE	1.1 mi			
	NNE	1.0 mi			
	N	1.1 mi			
	NNW	1.1 mi			
	NW	1.1 mi			
	WNW	0.7 mi			
	W	1.2 mi			
	WSW	1.6 mi			
	SW	1.3 mi			
	SSW	1.1 mi			
	S	1.0 mi			
	ESE-SSE		Lake Erie		

END OF SECTION 10.0

Note: Page content was last changed with ODCM Revision 16.



**ENCLOSURE 2  
To  
NRC-14-0032**

**2013 Annual Radiological Environmental Operating Report**

**Total Pages - 254**

**Enrico Fermi Atomic Power Plant, Unit 2  
NRC Docket No. 50-341  
NRC License No. NPF-43**

**FERMI 2 NUCLEAR POWER PLANT**

**DTE Electric Company**

**OPERATING LICENSE NO. NPF - 43**

**Fermi 2 - 2013 Annual  
Radiological Environmental Operating Report**

**for the period of  
January 1, 2013 through December 31, 2013**

Prepared by:

Fermi 2  
Radiological Engineering

<b><i>Table of Contents</i></b>	<b><i>Page</i></b>
<b><i>Executive Summary</i></b>	<b><i>1</i></b>
<b><i>Radiological Environmental Monitoring Program Results</i></b>	<b><i>2</i></b>
<i>Direct Radiation Monitoring</i>	<i>2</i>
<i>Thermoluminescent Dosimeters</i>	<i>2</i>
<i>Atmospheric Monitoring</i>	<i>3</i>
<i>Air Sampling</i>	<i>3</i>
<i>Terrestrial Monitoring</i>	<i>6</i>
<i>Milk Sampling</i>	<i>6</i>
<i>Ground-Water Sampling</i>	<i>7</i>
<i>Garden Sampling</i>	<i>8</i>
<i>Aquatic Monitoring</i>	<i>9</i>
<i>Drinking-Water Sampling</i>	<i>9</i>
<i>Surface-Water Sampling</i>	<i>11</i>
<i>Sediment Sampling</i>	<i>12</i>
<i>Fish Sampling</i>	<i>14</i>
<b><i>Land-Use Census</i></b>	<b><i>15</i></b>
<i>2013 Land Use Census Results</i>	<i>16</i>
<b><i>Appendix A</i></b>	
<i>Sampling Locations</i>	<i>A-0</i>
<b><i>Appendix B</i></b>	
<i>Environmental Data Summary</i>	<i>B-0</i>
<b><i>Appendix C</i></b>	
<i>Environmental Data Tables</i>	<i>C-0</i>
<b><i>Appendix D</i></b>	
<i>Environmental Program Exceptions</i>	<i>D-0</i>
<i>Direct Radiation Monitoring</i>	<i>D-1</i>
<i>Atmospheric Monitoring</i>	<i>D-1</i>
<i>Terrestrial Monitoring</i>	<i>D-1</i>
<i>Milk Sampling</i>	<i>D-1</i>
<i>Garden Sampling</i>	<i>D-1</i>
<i>Ground-Water Sampling</i>	<i>D-1</i>
<i>Aquatic Monitoring</i>	<i>D-2</i>
<i>Drinking Water Sampling</i>	<i>D-2</i>
<i>Surface Water Sampling</i>	<i>D-2</i>
<i>Sediment Sampling</i>	<i>D-2</i>
<i>Fish Sampling</i>	<i>D-2</i>
<i>Program Changes</i>	<i>D-2</i>

**Appendix E**

*Interlaboratory Comparison Data, GEL Laboratories'  
Quality Assurance Programs 2013 Annual Quality Assurance Report  
and the Annual Quality Assurance Status Report Environmental Dosimetry Company*

<b>List of Figures</b>	<b>Page</b>
<i>Figure 1 Fermi 2 Annual Average TLD Gamma Exposure</i>	<i>3</i>
<i>Figure 2 Historical Gross Beta and Iodine-131 Activity in Air Samples</i>	<i>5</i>
<i>Figure 3 Fermi 2 Air Particulate Gross Beta for 2013</i>	<i>5</i>
<i>Figure 4 Historical Strontium-90 Activity in Local Milk Samples</i>	<i>7</i>
<i>Figure 5 Historical Gross Beta Activity in Drinking Water Samples</i>	<i>11</i>
<i>Figure 6 Historical Cesium-137 Activity in Sediment Samples</i>	<i>14</i>
<i>Map 1 Sampling Locations By Station Number (within 1 mile)</i>	<i>App.-A</i>
<i>Map 2 Sampling Locations By Station Number (1 to 5 miles)</i>	<i>App.-A</i>
<i>Map 3 Sampling Locations By Station Number (greater than 5 miles)</i>	<i>App.-A</i>

<b>List of Tables</b>	<b>Page</b>
<i>Table 1 2013 Average Gross Beta Concentrations in Air Particulates</i>	<i>4</i>
<i>Table 2 Closest Residences</i>	<i>18</i>
<i>Table 3 Closest Gardens</i>	<i>19</i>
<i>Table 4 Milk Locations</i>	<i>20</i>
<i>Table 5 Closest Meat Locations</i>	<i>21</i>
<i>Table A-1 Direct Radiation Sample Locations</i>	<i>A-1</i>
<i>Table A-2 Air Particulate and Air Iodine Sample Locations</i>	<i>A-7</i>
<i>Table A-3 Milk Sample Locations</i>	<i>A-8</i>
<i>Table A-4 Garden Sample Locations</i>	<i>A-8</i>
<i>Table A-5 Drinking-Water Sample Locations</i>	<i>A-8</i>
<i>Table A-6 Surface-Water Sample Locations</i>	<i>A-9</i>
<i>Table A-7 Ground-Water Sample Locations</i>	<i>A-9</i>
<i>Table A-8 Sediment Sample Locations</i>	<i>A-10</i>
<i>Table A-9 Fish Sample Locations</i>	<i>A-10</i>
<i>Table B-1 Radiological Environmental Monitoring Program Summary</i>	<i>B-1</i>

## *Executive Summary*

This Annual Radiological Environmental Operating Report is a detailed report on the Radiological Environmental Monitoring Program (REMP) conducted at DTE Electric Company's Fermi 2 nuclear power plant from January 1 through December 31, 2013.

Samples collected as part of the REMP program were analyzed by GEL Laboratories, LLC. Radioactivity measurements for these samples are reported in terms of sample concentration or less than the Lab's Minimum Detectable Activity (MDA). The unit of radioactivity used in this report is the picocurie (pCi); a picocurie is one-one trillionth of a Curie (Ci). The unit of direct radiation used in this report is milliroentgen (mR); a milliroentgen is one-one thousandth of a Roentgen (R).

The REMP is divided into four major parts: direct radiation monitoring, atmospheric monitoring, terrestrial monitoring, and aquatic monitoring. The results of 2013 data showed that environmental radioactivity levels have not increased from background radioactivity levels detected prior to the operation of Fermi 2.

Direct radiation measurements were taken at 79 locations using thermoluminescent dosimeters (TLD). The average quarterly exposure was 14.9 mR/standard quarter for indicating locations. This average exposure is equivalent to the ambient radiation levels measured prior to the operation of Fermi 2.

Atmospheric monitoring results for 2013 showed only naturally occurring radioactivity and were consistent with levels measured prior to the operation of Fermi 2. No radioactivity attributable to activities at Fermi 2 was detected greater than the MDA in any atmospheric samples during 2013.

Terrestrial monitoring results for 2013 of milk and leafy garden vegetable samples, showed only naturally occurring radioactivity. Ground water samples did not show any radioactivity above the contract laboratory's MDA. The radioactivity levels detected were consistent with levels measured prior to the operation of Fermi 2. No radioactivity attributable to activities at Fermi 2 was detected greater than the MDA in any terrestrial samples during 2013.

Aquatic monitoring results for 2013 of drinking water, surface water, sediment, and fish, showed only naturally occurring radioactivity or radioactivity associated with fallout from past atmospheric nuclear weapons testing. No radioactivity attributable to activities at Fermi 2 was detected above the MDA in any aquatic samples during 2013.

REMP sampling did not identify any radioactivity above the MDA attributable to the operation of Fermi 2.

## ***Radiological Environmental Monitoring Program Results***

### ***Direct Radiation Monitoring***


Radiation is a normal component of the environment resulting primarily from natural sources, such as cosmic radiation and terrestrial radionuclides, and, to a lesser extent, from manmade sources such as fallout from past nuclear weapons testing. The earth is constantly bombarded by cosmic radiation in the form of high energy gamma rays and particulates. The earth's crust also contains natural radioactive material, such as uranium, thorium, and potassium-40, which contributes to the background radiation. Direct radiation monitoring primarily measures ionizing radiation from these cosmic and terrestrial sources.

### ***Thermoluminescent Dosimeters***

Fermi 2 uses thermoluminescent dosimeters (TLDs) to measure direct gamma radiation in the environment adjacent to Fermi 2. The TLDs are thoroughly tested to comply with NRC Regulatory Guide 4.13 and American National Standards Institute's (ANSI) publication N545-1975. Compliance with these standards assures accurate measurements under varying environmental conditions before the TLDs are placed in the field.

Fermi 2 has 79 TLD locations within a fifteen mile radius of the plant. Of the 79 TLD locations, 26 are located on-site and are not used for comparison with the control locations. These 26 TLDs are affected by Fermi 2's hydrogen water chemistry's sky shine and therefore are not representative of off-site dose. Indicator TLDs are located within a ten mile radius of the plant and control TLDs are located at a distance that is outside the potential influence of the plant. While in the field, TLDs are exposed to background radiation and, if measurable, gaseous effluents and direct radiation from Fermi 2. Environmental TLDs are exchanged and processed on a quarterly basis. TLD data are reported in terms of milliroentgen per standard quarter (mR/std qtr), with a standard quarter being 91 days.

In 2013, the average exposure for TLDs at all off-site indicator locations was 15.0 mR/std qtr ( $\pm 1.81$  1 Std. Dev., N = 164) and for all control locations was 13.5 mR/std qtr ( $\pm 1.31$  1 Std. Dev., N = 12). These exposures are consistent with preoperational and past operational measurements as shown in Figure 1.

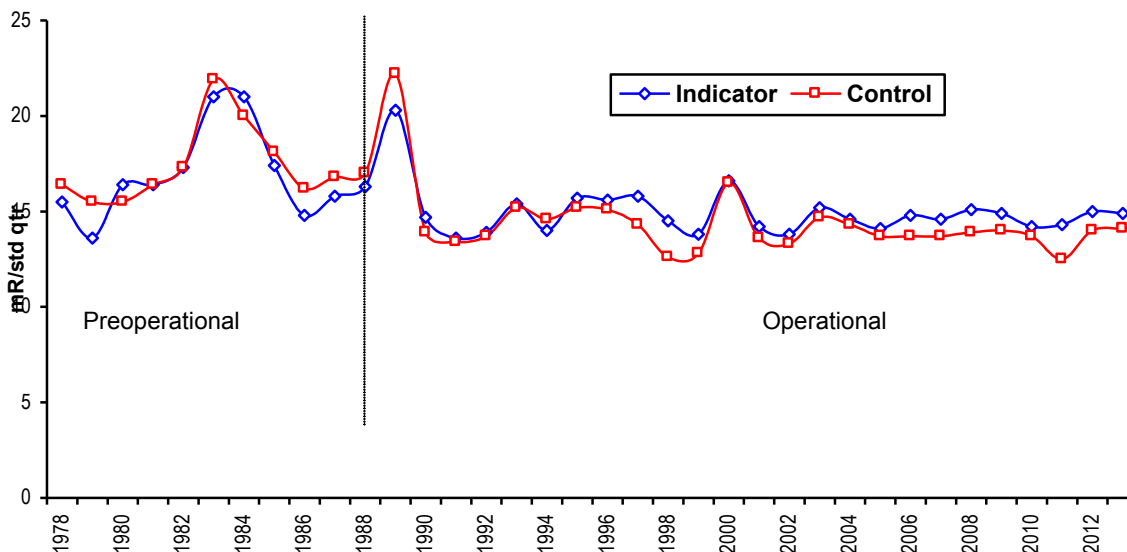

**Figure 1: Fermi 2 Annual Average TLD Gamma Exposure.** The similarity between indicator and control results demonstrates that the operation of Fermi 2 has not caused any abnormal gamma exposure.

### *Atmospheric Monitoring*

A potential exposure pathway to people is via inhalation of airborne radioactive materials. Fermi 2 continuously samples the ambient air surrounding Fermi 2 for radioactivity attributable to the operation of the plant. Atmospheric monitoring began in 1979 during the preoperational program. At each sampling location, a mechanical air sampler is used to draw a continuous volume of air through two filters designed to collect particulates and radioiodines. Air samples are collected weekly and analyzed for gross beta radiation and iodine-131 gamma radiation. The particulate filters for each sampling location are combined on a quarterly basis to form a “composite sample” and are analyzed for gamma emitting radionuclides. There are four indicator sampling locations in downwind sectors which were selected based on an evaluation of the predominant wind directions. The control location is approximately 14 miles west of the plant and is in an upwind sector that is considered to be unaffected by the operation of the plant.

### *Air Sampling*

On October 16, 1980, the People’s Republic of China conducted an atmospheric nuclear weapon test. The fallout from this test was detected in Fermi 2 preoperational environmental air samples in 1981 (see Figure 2). The average gross beta for 1981 was 1.60E-1 pCi/cubic meter for indicator samples and 2.40E-1 pCi/cubic meter for control samples which was a factor of ten times greater than background gross beta. Gamma

spectroscopic analyses of the particulate filters indicated cesium-137, cerium-141, cerium-144, ruthenium-103, ruthenium-106, zirconium-95, niobium-95, manganese-54, and antimony-125 in the atmosphere as a result of this test. In 1986, as shown in Figure 2, there was a slight increase in gross beta activity and a 2.70E-1 pCi/cubic meter “spike” in the iodine-131 activity. These elevated levels in 1986 are attributed to the nuclear accident at Chernobyl on April 26, 1986. For all other years, the iodine-131 activity was below the lower limit of detection (LLD) of 7.0E-2 pCi/cubic meter.

On March 11, 2011, following the Tohoku earthquake and tsunami the Fukushima Daiichi Nuclear Power Plant in Japan, experienced a series of equipment failures, fuel-melt, and releases of radioactivity to the environment.

Within weeks of the accident, US nuclear power plant REMP programs and other monitoring stations detected the radioactivity from Japan mainly in the form of airborne iodine-131.

During the week of April 5, 2011, all five (5) of Fermi's air monitoring stations detected radioactivity greater than the MDA at an average airborne gross beta of 7.12E-2 pCi/cubic meter and 8.12E-2 pCi/cubic meter for iodine-131 due to the accident at Fukushima Daiichi Nuclear Power Plant.

During this monitoring period, 259 particulate air filters and 258 charcoal cartridges were collected and analyzed for gross beta activity and iodine-131 respectively. The average gross beta for indicator samples was 4.09E-2 pCi/cubic meter (Std. Dev. 1.36E-2) and 4.04E-2 pCi/cubic meter (Std. Dev. 1.11E-2) for control samples. None of the charcoal filters collected showed detectable levels of iodine-131 greater than the MDA attributable to the operation of Fermi 2. The following table contains the annual average gross beta results of all five sample locations for 2013.

**Table 1: 2013 Average Gross Beta Concentrations in Air Particulates (pCi/m<sup>3</sup>)**


Station	Description (sector/distance)	Annual Average (Std.Dev., N)
API-1 (I)	Estral Beach (NE/1.4 mi.)	3.80E-2 (1.23E-2, N=52)
API-2 (I)	Site Boundary (NNW/0.6 mi.)	4.29E-2 (1.38E-2, N=52)
API-3 (I)	Site Boundary (NW/0.6 mi.)	4.09E-2 (1.48E-2, N=52)
API-4 (C)	North Custer Rd. (W/14 mi.)	4.04E-2 (1.11E-2, N=52)
API-5 (I)	Site Boundary (S/1.2 mi.)	4.18E-2 (1.31E-2, N=51)

(I) = Indicator Station (C) = Control Station


Sixteen (16) quarterly particulate filter composites were prepared and analyzed for gamma emitting radionuclides. Naturally occurring beryllium-7 was detected in both indicator and control samples and naturally occurring potassium-40 was detected in indicator samples.



In conclusion, the atmospheric monitoring data are consistent with preoperational and prior operational data and show no adverse long-term trends in the environment attributable to operation of Fermi 2 as illustrated in Figures 2 and 3.

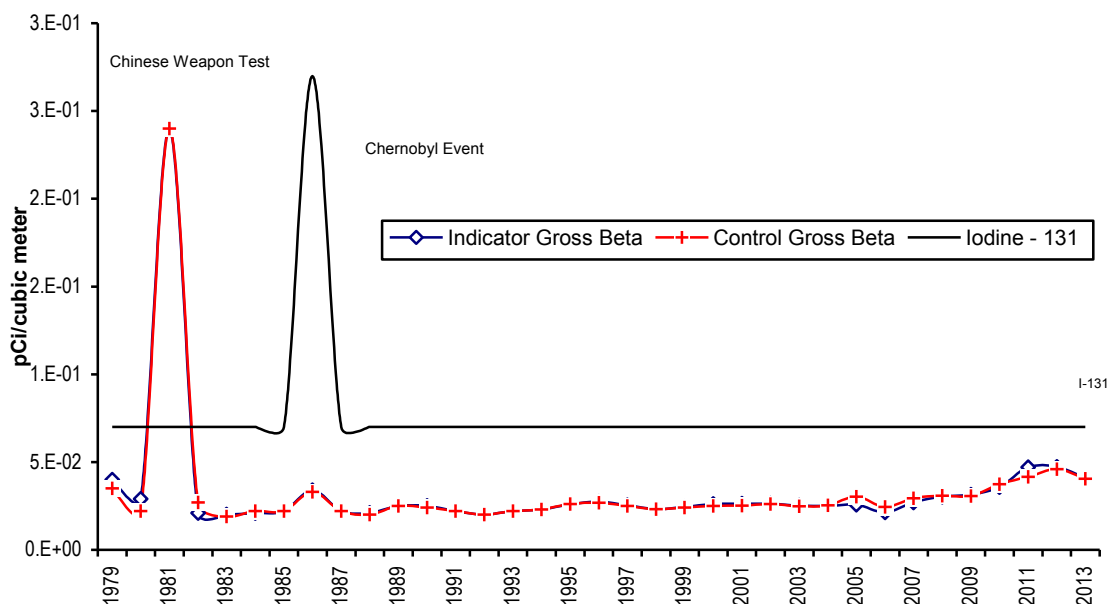

**Figure 2: Historical Gross Beta and Iodine-131 Activity in Air Samples.** The similarity between indicator and control gross beta results demonstrates that the operation of Fermi 2 has had no adverse long-term trends in the environment. The lower limit of detection (LLD) for iodine-131 is 0.07 pCi/cubic meter.

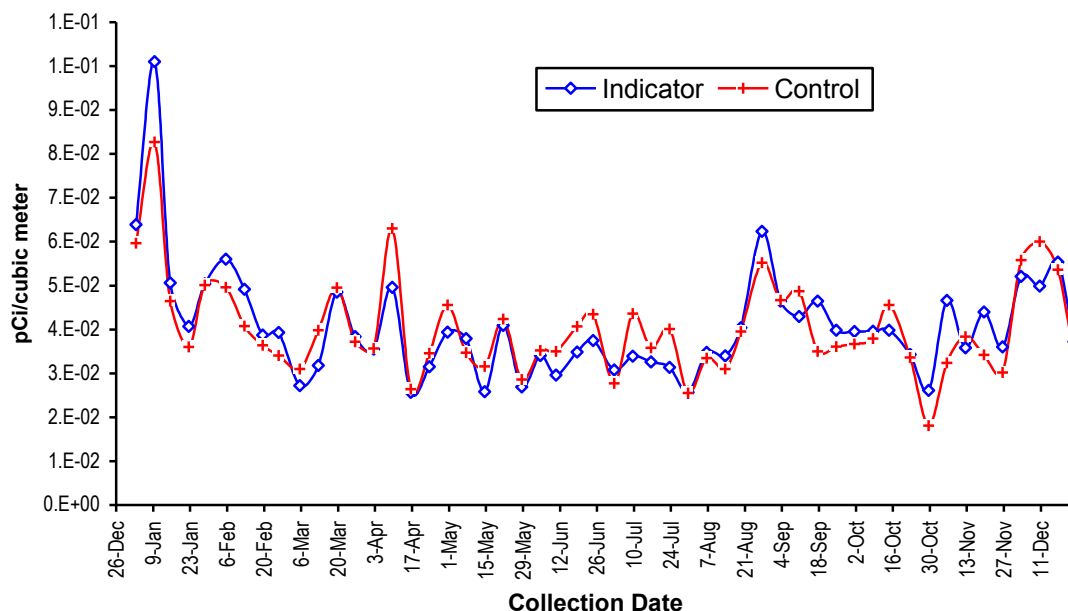

**Figure 3: Fermi 2 Air Particulate Gross Beta for 2013.** The concentration of beta emitting radionuclides in airborne particulates samples was essentially identical at indicator and control locations. Gross beta activity varies throughout the year and is primarily an effect of seasonal precipitation.

## ***Terrestrial Monitoring***

Radionuclides released to the atmosphere may deposit on soil and vegetation, and therefore, may eventually be incorporated into the human food chain. To assess the impact of Fermi 2 operations to humans from the ingestion pathway, samples of milk, green leafy vegetables, and ground water are collected and analyzed for radioactivity. The following sections discuss the type and frequency of terrestrial sampling, analyses performed, and a comparison of 2013 data to previous operational and preoperational data.

### ***Milk Sampling***


A major pathway in the human food chain is the consumption of milk from grazing animals (dairy cows or goats) due to biological concentration and the short turn around time in this pathway. Milk is collected from one indicator location and one control location semimonthly when animals are in the pasture, and monthly when the animals are on stored feed. The milk is analyzed for iodine-131, gamma emitting radionuclides, and strontium-89/90. At times when milk samples are not available, grass samples are collected at both the control milk sample location and the location where milk is not available. Grass samples are analyzed for iodine-131 and other gamma emitting radionuclides. During 2013, no grass samples were scheduled or collected for the REMP.

Milk sampling began in 1979 during the preoperational program. During this time period, milk samples were analyzed for iodine-131 and other gamma emitting radionuclides. Cesium-137 and naturally occurring potassium-40 were the only radionuclides detected in milk samples during the preoperational program. The cesium-137 activity averaged  $3.60\text{E}+00$  pCi/liter and is due to past atmospheric nuclear weapons testing. In 1986, after the nuclear accident at Chernobyl, iodine-131 and cesium-137 were detected in both indicator and control milk samples. The average activity was  $3.70\text{E}+00$  pCi/liter for iodine-131 and  $6.60\text{E}+00$  pCi/liter for cesium-137.

The analysis for strontium-89/90 began in 1988, and strontium-90 is routinely detected in both indicator and control milk samples because of past atmospheric nuclear weapons testing. In 1970, the concentration of strontium-90 in Monroe County milk was  $6.00\text{E}+00$  pCi/liter according to the Michigan Department of Health's "Milk Surveillance," Radiation Data and Reports, Vol. 11-15, 1970-1974. Figure 4 shows the calculated radiological decay curve for the 1970 concentration of strontium-90 and the average concentrations since 1988. This graph illustrates that the inventory of strontium-90 in the local environment is decreasing with time and closely follows the calculated decay curve. This supports the determination that the inventory of strontium-90 in the environment is due to fallout from past atmospheric nuclear weapons testing and not the operation of Fermi 2.

During 2013, thirty six (36) milk samples were collected and analyzed for iodine-131, gamma emitting radionuclides, and strontium-89/90. No iodine-131 or strontium-89/90 was detected greater than the MDA in any of the samples. Although strontium-90 was not detected in any samples above the MDA, the average MDA for strontium-90 in milk in 2013 is reported in Figure 4.

Naturally occurring potassium-40 was detected in both indicator (average 1,413 pCi/L, Std. Dev. 48.7, N=18) and control (average 1,411 pCi/L, Std. Dev. 40.0, N=18) samples.

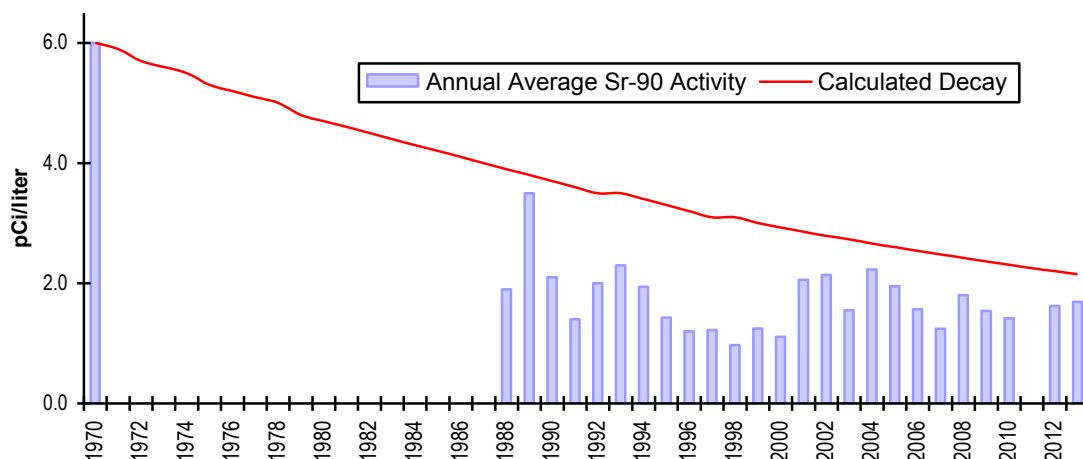

**Figure 4: Historical Strontium-90 Activity in Local Milk Samples.** The concentration of strontium-90 in local milk samples is decreasing with time and is below the calculated decay curve. This supports the fact that strontium-90 in local milk is due to fallout from past atmospheric nuclear weapons testing and not the operation of Fermi 2. Showing average of positive values; if parameter not detected at the Minimum Detectable Activity (MDA) in any samples taken during the monitoring period then the average of the MDA is reported.

### ***Ground-Water Sampling***

In areas not served by municipal water systems, water supplies for domestic use are generally obtained from private wells. The network of private wells presently in use forms the source of water for domestic and livestock purposes in farms and homes west and north of the site. With the construction of new water plants and distribution systems, the water use trend in the area is from ground water (local wells) to surface water (municipal water supply).

Ground water is collected on a quarterly basis from four wells surrounding Fermi 2. The ground water is analyzed for gamma-emitting radionuclides and tritium. Sampling

location GW-4, which is located approximately 0.6 miles west northwest, is designated as the control location because it is up-gradient and is least likely to be affected by the operation of the plant. The other three sampling locations are down-gradient from Fermi 2 and designated as indicator locations.

Ground-water sampling began in 1987, during the operational period of the REMP program. From 1987 to 1996, naturally occurring potassium-40, cesium-137, and tritium were detected in both indicator and control samples. The average concentration was  $7.71\text{E}+00$  pCi/liter for cesium-137 and  $1.50\text{E}+02$  pCi/liter for tritium. The presence of cesium-137 and tritium in ground-water samples is due to fallout from past atmospheric nuclear weapons testing leaching into the soil and becoming incorporated into the ground water. From 1997 to 2008, only naturally occurring potassium-40 activity was detected in ground-water samples.

In 2013, sixteen (16) ground-water samples were collected and analyzed for gamma emitting radionuclides and tritium. During 2013, no radioactivity, greater than the MDA, was detected in any ground-water samples.

### ***Garden Sampling***

Fermi 2 collects samples of broad leaf vegetables from indicator locations identified by the annual Land Use Census. Samples are also collected at a control location that is at a distance and direction which is considered to be unaffected by plant operations. Samples are collected once a month during the growing season (June through September) and are analyzed for gamma-emitting radionuclides.

Vegetable sampling started in 1982. During the preoperational period from 1982 to 1985, only naturally occurring potassium-40 was detected in both indicator and control vegetable samples. During the operational period from 1985 to 1990 and 1994 to 1995, only naturally occurring potassium-40 was detected in both indicator and control vegetable samples. However, in 1991, 1992, and 1993, cesium-137 was detected in one indicator sample each year and had an average concentration of  $1.2\text{E}+01$  pCi/kilogram.

Cesium-137 may become incorporated into plants by either uptake from the soil or direct deposition on foliar surfaces. Since cesium-137 is normally not detected in gaseous effluent samples from Fermi 2, and there have been no recent atmospheric weapons testing or nuclear accidents, the incorporation of cesium-137 by direct deposition is highly unlikely. The most probable source of cesium-137 in vegetable samples is the uptake of previously deposited cesium-137, which has leached into the soil. This cesium activity is attributed to fallout from past atmospheric weapons testing and to the nuclear accident at Chernobyl.

During 2013, twelve (12) vegetable samples were collected and analyzed for gamma emitting radionuclides. No iodine-131 was detected greater than the MDA in vegetable

samples during 2013. The only gamma emitting radionuclides detected were naturally occurring beryllium-7, potassium-40, and thorium 228 in both indicator and control samples. The naturally occurring radionuclide Actinium-228 was found at a very low level of activity (51 pCi/Kg) in one cabbage sample.

Terrestrial monitoring results for 2013 of milk, ground water and leafy garden vegetable samples, showed only naturally occurring radioactivity. The radioactivity levels detected were consistent with levels measured prior to the operation of Fermi 2 and no radioactivity attributable to activities at Fermi 2 was detected greater than the MDA in any terrestrial sample. In conclusion, the terrestrial monitoring data show no adverse trends attributable to emissions from Fermi 2 in the terrestrial environment.

### ***Aquatic Monitoring***

Fermi 2 is located at the West end of Lake Erie. This Great Lake is used as a source for drinking water, as well as for recreational activities such as fishing, swimming, sunbathing, and boating. Because of these uses, Lake Erie and its tributaries are routinely monitored for radioactivity.

The aquatic monitoring portion of the REMP consists of sampling raw municipal drinking water, surface water, lake sediments, and fish for the presence of radioactivity. The following sections discuss the type and frequency of aquatic sampling, analyses performed, and a comparison of 2013 data to previous operational and preoperational data.

### ***Drinking-Water Sampling***


Fermi 2 monitors drinking water at one control location and one indicator location using automatic samplers. The automatic samplers collect drinking water at time intervals that are very short (hourly) relative to the sample collection period (monthly) in order to assure that a representative sample is obtained. Indicator water samples are obtained at the Monroe water intake located approximately 1.1 miles south of the plant. Detroit municipal water is used for the control samples and is obtained at the Allen Park water intake located approximately 18.6 miles north of the plant. Drinking water samples are collected on a monthly basis and analyzed for gross beta, strontium-89/90, and gamma emitting radionuclides. The monthly samples for each location are combined on a quarterly basis and analyzed for tritium activity.

In late 1980, as shown in Figure 5, an atmospheric nuclear weapon test was conducted by the People's Republic of China. As a result of this test, the average gross beta for 1981 was 9.80E+00 pCi/liter for water samples. Figure 5 also shows that, except for the Chinese weapons testing, the historic drinking water sample data are below or slightly above the lower limit of detection (4.00E+00 pCi/liter) required by US Environmental

Protection Agency (USEPA) National Interim Primary Drinking Water regulations. Even during the Chinese weapons testing, the drinking water samples did not exceed the USEPA maximum allowable criteria of  $5.00\text{E}+01$  pCi/liter gross beta. In 1980 and 1983, cesium-137 was detected in drinking water samples at levels ranging from  $5.40\text{E}+00$  pCi/liter to  $1.90\text{E}+01$  pCi/liter. Tritium was also detected during the preoperational program and had an average of  $3.25\text{E}+02$  pCi/liter. The presence of cesium-137 and detectable levels of tritium in these water samples is due to fallout from past atmospheric nuclear weapons testing and naturally occurring tritium.

From 1985 to 2013, the average annual gross beta activity for indicator samples was  $3.92\text{E}+00$  pCi/liter (Std. Dev.  $1.41\text{E}+00$ ) and  $3.25\text{E}+00$  pCi/liter (Std. Dev.  $9.79\text{E}-01$ ) for control samples. The analysis of drinking water for Strontium-89 and Strontium-90 began in 1988 and Strontium-90 has been detected in both indicator and control samples. Tritium was also detected in both indicator and control drinking water samples at times during this time period. The presence of strontium-90 and detectable levels of tritium in these water samples is due to fallout from past atmospheric nuclear weapons testing and naturally occurring tritium and its identification in drinking water samples by the REMP is an indicator of performance of the program.

In 2013, twenty-four (24) drinking water samples were collected and analyzed for gross beta, gamma emitting radionuclides, Strontium-89/90, and tritium. Gross beta activity was not detected in any samples above the MDA (average 3.0 pCi/L). Naturally occurring Potassium-40 was detected in a control sample ( $2.51\text{E}+01$  pCi/L). No Strontium-89 or Strontium-90 activity was detected greater than the MDA in drinking water samples during 2013( average MDA 2.38 pCi/L and 1.70 pCi/L, respectively). Eight (8) quarterly composite drinking water samples were prepared and analyzed for tritium. No tritium activity was detected greater than the MDA (average 385 pCi/L) in drinking water samples during 2013.

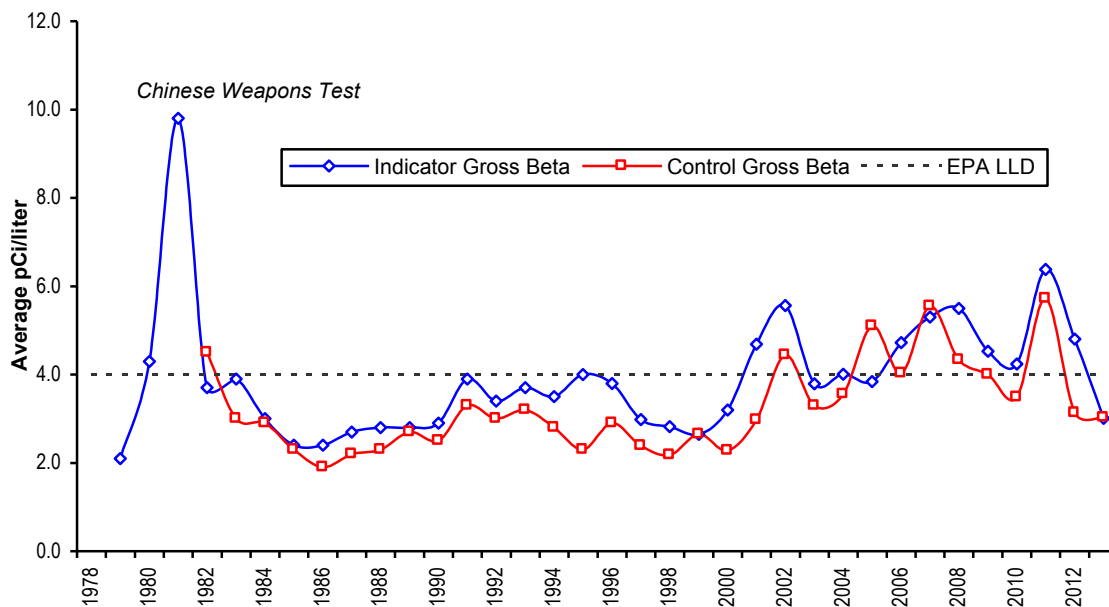

**Figure 5: Historical Gross Beta Activity in Drinking Water Samples.** Since 1982, the annual concentrations of beta emitting radionuclides in drinking water samples collected from indicator locations have been consistent with those from control locations. This shows that Fermi 2 has had no measurable radiological impact on local drinking water. Showing average of positive values, if parameter not detected at the Minimum Detectable Activity (MDA) in any samples taken during the monitoring period then the average of the MDA is reported.

### *Surface-Water Sampling*

Fermi 2 monitors surface water at two locations using automatic samplers. As with drinking water, the automatic samplers collect surface water at time intervals that are very short (hourly) relative to the sample collection period (monthly) in order to assure that a representative sample is obtained. Indicator surface water samples are obtained at the Fermi 2 General Service Water building, located approximately 0.3 miles south southeast from Fermi 2. The control surface water samples are obtained from Trenton Channel Power Plant's cooling water intake on the Detroit River, which is approximately 11.7 miles north northeast of Fermi 2. Surface water samples are collected on a monthly basis and analyzed for strontium-89/90 and gamma emitting radionuclides. The monthly samples for each location are combined on a quarterly basis to form a quarterly composite sample and are analyzed for tritium.

Surface water sampling began in 1979, and the samples were analyzed for gamma emitting radionuclides and tritium. During this preoperational program, no gamma emitting radionuclides, except for naturally occurring potassium-40, were detected. Tritium was detected in both indicator and control samples during this time period and had an average concentration of 3.15E+02 pCi/liter. This tritium activity represents the

background concentration due to naturally occurring tritium and tritium produced during past atmospheric nuclear weapons testing.

From 1985 to 2012, as part of the operational program, surface water samples were analyzed for gamma emitting radionuclides and tritium. The analysis for strontium-89/90 did not begin until 1988, and strontium-90 was detected in both indicator and control samples. In 1990, two indicator samples showed detectable activity for cesium-137 at an average concentration of  $1.20\text{E}+01$  pCi/liter. The presence of cesium-137 and strontium-90 in these water samples is due to fallout from past atmospheric nuclear weapons testing. Tritium was detected in both indicator and control surface water samples during this time period at a concentration of  $2.31\text{E}+02$  pCi/liter. This tritium activity is consistent with background levels measured during the preoperational program.

In 2013, twenty-four (24) surface water samples were collected and analyzed for gamma emitting radionuclides and strontium-89/90. From these samples, eight (8) quarterly composite samples (four samples for indicator locations and four samples for the control location) were prepared and analyzed for tritium. During 2013, the naturally occurring isotopes actinium-228 ( $1.09\text{E}+01$  pCi/L) and thorium-228 ( $4.63\text{E}+00$  pCi/L) were detected in one control sample. Potassium-40 was detected in one indicator sample ( $4.05\text{E}+01$  pCi/L). None of the plant-related isotopes Strontium-89 (average MDA  $2.53\text{E}+00$  pCi/L), strontium-90 (average MDA  $1.71\text{E}+00$  pCi/L), and tritium (average MDA  $3.79\text{E}+02$  pCi/L) were not detected in any surface water samples during the monitoring period.

### ***Sediment Sampling***

Sediments often act as a sink (temporary or permanent) for radionuclides, but they may also become a source, as when they are resuspended during periods of increased turbulence or are dredged and deposited elsewhere. Sediment, in the vicinity of the liquid discharge point, represents the most likely site for accumulation of radionuclides in the aquatic environment, and with long-lived radionuclides, a gradual increase in radioactivity concentration would be expected over time if discharges occur. Sediment, therefore, provides a long-term indication of change that may appear in other sample media (i.e., water and fish samples).

Sediments from five locations are collected from the Lake Erie shoreline and bottom on a semiannual basis (Spring and Fall) and are analyzed for gamma emitting radionuclides and strontium-89/90. Of these five sample locations, one is a control and four are indicator locations. The control sample is collected near the Trenton Channel Power Plant's cooling water intake. The indicator samples are collected at:

- Estral Beach,
- North of the Fermi 2 liquid discharge area,
- Pointe Aux Peaux (shoreline), and
- Indian Trails Community Beach.




During the preoperational monitoring program only samples from indicator locations were analyzed for gamma emitting radionuclides as there was no control location required. Naturally occurring radionuclides were commonly identified in sediment samples from this period; the only manmade radioisotope detected was Cesium-137. For this time period, the average Cesium-137 concentration was 3.27E+02 pCi/kilogram. The presence of Cesium-137 in these sediment samples is due to fallout from past atmospheric nuclear weapons testing.

From 1985 to 2013, Cesium-137(average activity 1.61E+02 pCi/kilogram) and naturally occurring radionuclides were detected in sediment samples. The analysis for strontium-89/90 began in 1988, and strontium-90 has been routinely detected at similar concentrations in both indicator and control samples (average activity 1.90E+02 pCi/kilogram). The presence of Cesium-137 and Strontium-90 in these sediment samples is due to fallout from past atmospheric nuclear weapons testing.

In 1990 and 1991, the Spring samples taken at the Fermi 2 liquid discharge line (location S-2) showed activity for plant related radionuclides (Manganese-54, Cobalt-58, Cobalt-60, and Zinc-65) and was determined to be a result of liquid effluent from Fermi 2. The sample results were well below any regulatory reporting limits and were consistent with the activity released from the plant in liquid effluents as per the approved effluent program. The dose impact was negligible due to these effluents.

In 2013, ten (10) sediment samples were collected and analyzed for gamma emitting radionuclides and Strontium 89/90. Cesium-137 was detected in one control sample (178.5 pCi/Kg) and one indicator sample (125.7 pCi/Kg). The presence of Cesium-137 in sediment samples is due to fallout from past atmospheric nuclear weapons testing. Naturally occurring radionuclides Actinium-228, Beryllium-7, Bismuth-214, Lead-212, Lead-214, Potassium-40, Radium-226, Thallium-208, Thorium-228, and Thorium-230 were also detected in both indicator and control sediment samples during this sampling period. No plant-related radionuclides were identified in any sediment samples taken in 2013.

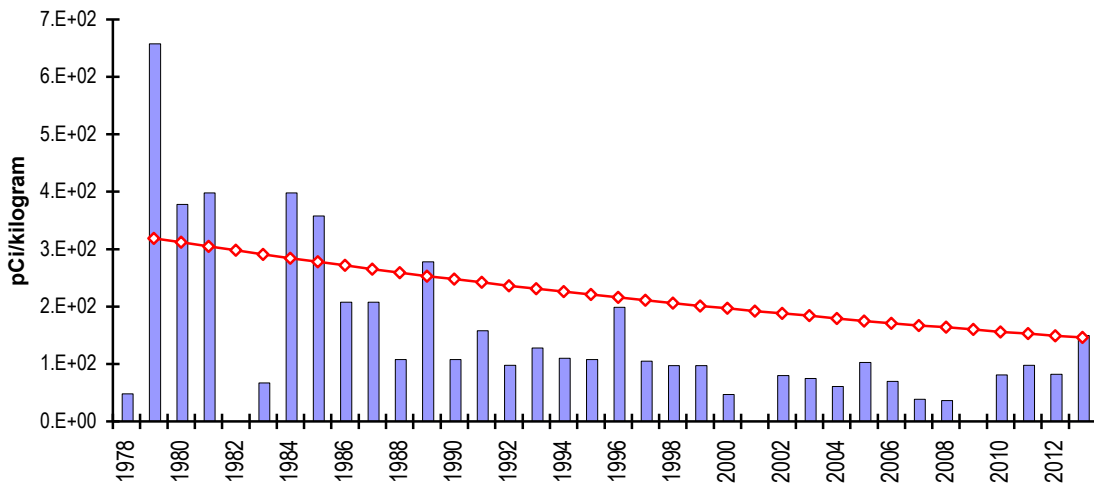

**Figure 6: Historical Cesium-137 Activity in Sediment Samples.** As the calculated trend shows, the concentration of cesium-137 in Lake Erie sediments is decreasing with time. This supports the fact that cesium-137 in Lake Erie sediments is due to fallout from past atmospheric nuclear weapons testing and not the operation of Fermi 2.

Figure 6 shows the historical concentration of Cesium-137 in sediment samples from 1978 to 2013. Using the average pre-operational Cs-137 activity in sediments ( $3.27E+02$  pCi/kilogram, Std Dev  $2.11E+02$ ) as a starting point, the estimated decayed Cs-137 activity is calculated using the half-life of Cs-137 (30.08 years) and a starting year of 1978. This curve has a negative slope which indicates the overall concentration of Cesium-137 in the environment will decrease with time. This trend of decreasing activity of Cs-137 is also seen in the sediment samples taken since 1985. This supports the fact that the inventory of Cesium-137 in the environment is due to fallout from past atmospheric nuclear weapons testing and not from the operation of Fermi 2.

### ***Fish Sampling***

Samples of fish are collected from Lake Erie at three locations on a semiannual basis. There are two control locations and one indicator location. The two control locations are offshore of Celeron Island and in Brest Bay. The indicator location is approximately 1200 feet offshore of the Fermi 2 liquid effluent discharge. Edible portions of the fish are analyzed for gamma emitting radionuclides and strontium-89/90.

During the preoperational program, fish samples were analyzed for gamma emitting radionuclides. Only cesium-137 and naturally occurring potassium-40 were detected during this time period. The average concentration of cesium-137 for indicator samples was  $3.53E+01$  pCi/kilogram and  $4.20E+01$  pCi/kilogram for control samples. The

presence of cesium-137 in these fish samples is due to fallout from past atmospheric nuclear weapons testing.

From 1985 to 2012, cesium-137 and naturally occurring potassium-40 were detected in fish samples. The average cesium-137 concentration for indicator samples was  $3.72\text{E}+01$  pCi/kilogram and  $3.73\text{E}+01$  pCi/kilogram for control samples. The analysis for strontium-89/90 began in 1990, and strontium-90 was routinely detected at similar concentrations in both indicator and control samples. The average strontium-90 concentration for indicator samples was  $3.84\text{E}+01$  pCi/kilogram and  $3.15\text{E}+01$  pCi/kilogram for control samples. The presence of cesium-137 and strontium-90 in these fish samples is due to fallout from past atmospheric nuclear weapons testing.

In 2013, twenty-nine (29) fish samples were collected and analyzed for gamma emitting radionuclides and strontium-89/90. Naturally occurring Potassium-40 (control:  $3.04\text{E}+03$  Std Dev  $3.83\text{E}+02$  pCi/kilogram, indicator:  $2.82\text{E}+03$ , Std Dev  $3.67\text{E}+02$  pCi/kilogram) as well as Cesium-137 (control:  $7.25\text{E}+00$  Std Dev  $1.69\text{E}-01$  pCi/kilogram, indicator:  $5.88\text{E}+00$ , Std Dev  $2.23\text{E}+00$  pCi/kilogram) was detected in both control and indicator fish samples taken in 2013.

Aquatic monitoring results for 2013 of water, sediment, and fish showed only naturally occurring radioactivity and radioactivity associated with fallout from past atmospheric nuclear weapons testing and were consistent with levels measured prior to the operation of Fermi 2. In conclusion, no radioactivity attributable to activities at Fermi 2 was detected greater than the MDA in any aquatic sample during 2013 and no adverse long-term trends are shown in the aquatic monitoring data.

### ***Land-Use Census***

The Land-Use Census is conducted in accordance with the Fermi 2 Offsite Dose Calculation Manual (ODCM), control 3.12.2, and satisfies the requirements of Section IV.B.3 of Appendix I to 10 CFR Part 50. This census identifies changes in the use of unrestricted areas to permit modifications to monitoring programs for evaluating doses to individuals from principal pathways of exposure. The pathways of concern are listed below:

- **Inhalation Pathway** - Internal exposure as a result of breathing radionuclides carried in the air.
- **Ground Exposure Pathway** - External exposure from radionuclides deposited on the ground.
- **Plume Exposure Pathway** - External exposure directly from a plume or cloud of radioactive material.

- **Vegetation Pathway** - Internal exposure as a result of eating vegetables which have absorbed deposited radioactive material or which have absorbed radionuclides through the soil.
- **Milk Pathway** - Internal exposure as a result of drinking milk which may contain radioactive material as a result of dairy animals grazing on a pasture contaminated by radionuclides.
- **Meat Pathway** - Internal exposure as a result of consuming meat which may contain radioactive material as a result of animals grazing on a pasture contaminated by radionuclides.

The Land-Use Census is conducted during the growing season and is used to identify, within a radius of 5 miles, the location of the nearest residences, milk animals, meat animals, and gardens (greater than 50 square meters and containing broad leaf vegetation) in each of 16 meteorological sectors surrounding Fermi 2. Gardens greater than 50 square meters are the minimum size required to produce the quantity (26 kg/year) of leafy vegetables assumed in NRC Regulatory Guide 1.109 for consumption by a child. To determine this minimum garden size, the following assumptions were made: (1) 20% of the garden is used for growing broad leaf vegetation (i.e., lettuce and cabbage); and (2) a vegetation yield of 2 kg/square meter.

### ***2013 Land-Use Census Results***

The Land Use Census is conducted in accordance with ODCM control 3.12.2 and satisfies the requirements of Section IV.B.3 of Appendix I to 10 CFR Part 50. This census identifies changes in the use of unrestricted areas to permit modifications to monitoring programs for evaluating doses to individuals from principal pathways of exposure. The annual Land-Use Census is conducted during the growing season and is used to identify, within a radius of 5 miles, the location of the closest residences, milk animals, meat animals, and gardens in each of the 11 land-based meteorological sectors surrounding Fermi 2.

The 2013 Land-Use Census was performed during the month of August. The 2013 census data were obtained with the use of Global Positioning System (GPS) equipment. These data were compared to the 2012 data to determine any significant changes in the use of the land. The results of the census are tabulated in Tables 2 – 5 of this report.

No changes in the land-use census between 2012 and 2013 were found that would require changing the location of the “maximum exposed individual.” However, there were changes in the location of the closest receptor in the following categories: gardens (vegetation), milk, and meat. The 2013 survey did not provide new information that would alter the previous years’ determination that all milk-animal locations identified

have animals that are pets and any milk produced is not use for human consumption. The “maximum exposed individual” is located in the West-North-West sector and at one time participated in the REMP program. In the past few years this location did not have a garden, but in past a garden has been planted at this location. As with past surveys, this census identified new residential housing construction that shows a continuing trend of converting agricultural land to other uses in the area surrounding Fermi 2.

As stated above, there were no significant changes in the 2013 land use that would require changing the location of the “maximum exposed individual.” For that reason, the location of “maximum exposed individual” remains the same and is described as follows:

<u>Pathway</u>	<u>Sector</u>	<u>Azimuth (degrees)</u>	<u>Distance (miles)</u>	<u>Age Group</u>	<u>Maximum Organ</u>
Ingestion (vegetation)	WNW	302.2	0.71	Adult	Thyroid/ Bone*

\*-For the 10 CFR 50 Appendix I required calculation of dose due to I-131, I-133, H-3, and particulates with half-lives greater than 8 days, the thyroid is the maximum organ. However, if C-14 is added to this dose calculation, bone becomes the maximum organ.

**2013 LAND-USE CENSUS**  
Closest Residences

**Table 2**

Sector	Year	Azimuth (degrees)	Distance (miles)	Change (miles)
N	2012	8.9	1.11	0.00
	2013	8.9	1.11	
NE	2012	34.7	1.10	0.00
	2013	34.7	1.10	
NNE	2012	16.6	1.08	0.00
	2013	16.6	1.08	
NNW	2012	334.9	1.09	0.00
	2013	334.9	1.09	
NW	2012	309.7	1.07	0.00
	2013	309.7	1.07	
S	2012	169.6	1.03	0.00
	2013	169.6	1.03	
SSW	2012	200.1	1.12	0.00
	2013	200.1	1.12	
SW	2012	229.3	1.26	0.00
	2013	229.3	1.26	
W	2012	259.2	1.19	0.00
	2013	259.2	1.19	
WNW(a)	2012	302.3	0.72	-0.01
	2013	302.3	0.71 (b)	
WSW	2012	236.3	1.39	0.00
	2013	236.3	1.39	

(a) = Location of “maximum exposed individual”

(b) = Reported distance (0.72 miles) in previous report an error; residence has not changed.

**2013 LAND-USE CENSUS**  
Closest Gardens

**Table 3**

Sector	Year	Azimuth (degrees)	Distance (miles)	Change (miles)
N	2012	0.1	1.61	
	2013	0.1	1.61	0.00
NE	2012	51.8	1.85	
	2013	37.7	1.93	0.08
NNE	2012	27.9	1.84	
	2013	27.9	1.84	0.00
NNW	2012	327.1	1.41	
	2013	327.1	1.41	0.00
NW	2012	315.5	1.51	
	2013	315.5	1.51	0.00
S	2012	170.0	1.01	
	2013	170.0	1.01	0.00
SSW	2012	192.4	1.44	
	2013	192.4	1.44	0.00
SW	2012	234.7	4.26	
	2013	231.2	1.41	-2.85
W	2012	260.9	1.60	
	2013	260.9	1.60	0.00
WNW	2012	287.5	4.38	
	2013	291.5	4.78	0.40
WSW	2012	245.1	1.79	
	2013	256.5	2.65	0.86

**2013 LAND-USE CENSUS**  
Closest Milk Locations

**Table 4**

Sector	Year	Azimuth (degrees)	Distance (miles)	Change (miles)	Type
N	2012	9.9	4.32		Goat
	2013	9.9	4.32	0.00	Goat
NE	2012	None identified	None identified		
	2013	None identified	None identified		
NNE	2012	None identified	None identified		
	2013	None identified	None identified		
NNW	2012	None identified	None identified		
	2013	344.5	4.7	4.7	Goat
NW	2012	None identified	None identified		
	2013	None identified	None identified		
S	2012	None identified	None identified		
	2013	None identified	None identified		
SSW	2012	None identified	None identified		
	2013	None identified	None identified		
SW	2012	None identified	None identified		
	2013	None identified	None identified		
W	2012	None identified	None identified		
	2013	259.2	1.6	1.6	Goat
WNW	2012	297.4	2.38		Goat
	2013	297.4	2.38	0.00	Goat
WSW	2012	None identified	None identified		
	2013	None identified	None identified		



**2013 LAND-USE CENSUS**  
Closest Meat Locations

**Table 5**

Sector	Year	Azimuth (degrees)	Distance (miles)	Change (miles)	Type
N	2012	None identified	None identified	4.29	Beef
	2013	9.8	4.29		
NE	2012	None identified	None identified		
	2013	None identified	None identified		
NNE	2012	None identified	None identified		
	2013	None identified	None identified		
NNW	2012	338.2	4.36	-0.05	Sheep
	2013	341.9	4.31		Beef
NW	2012	321.4	3.02		Beef
	2013	None identified	None identified		
S	2012	None identified	None identified		
	2013	None identified	None identified		
SSW	2012	None identified	None identified		
	2013	None identified	None identified		
SW	2012	None identified	None identified		
	2013	None identified	None identified		
W	2012	None identified	None identified		
	2013	None identified	None identified		
WNW	2012	287.5	1.65	0.00	Beef
	2013	287.5	1.65		Beef
WSW	2012	None identified	None identified		
	2013	None identified	None identified		

# Appendix A

## Sampling Locations

*Direct Radiation Sample Locations*

**Table A-1**

Station Number	Meteorological Sector/Azimuth (Degrees)	Distance from Reactor (Approx.)	Description	Collection Frequency	Type
T1	NE/38°	1.3 mi.	Estral Beach, Pole on Lakeshore 23 Poles S of Lakeview. (Special Area)	Q	I
T2	NNE/22°	1.2 mi.	Pole at termination of Brancheau St. (Special Area)	Q	I
T3	N/9°	1.1 mi.	Pole, NW corner of Swan Boat Club fence. (Special Area)	Q	I
T4	NNW/337°	0.6 mi.	Site boundary and Toll Rd. on Site fence by API #2.	Q	I
T5	NW/313°	0.6 mi.	Site boundary and Toll Rd. on Site fence by API #3.	Q	I
T6	WNW/294°	0.6 mi.	On Site fence at south end of N. Bullet Rd.	Q	I
T7	W/270°	14.0 mi.	Pole, at Michigan Gas substation on N. Custer Rd., 0.66 miles west of Doty Rd.	Q	C
T8	NW/305°	1.9 mi.	Pole on Post Rd. near NE corner of Dixie Hwy. and Post Rd.	Q	I
T9	NNW/334°	1.5 mi.	Pole, NW corner of Trombley and Swan View Rd.	Q	I
T10	N/6°	2.1 mi.	Pole, S side of Massarant-2 poles W of Chinavare.	Q	I

*I = Indicator*

*C = Control*

*O = On-site*

*Q = Quarterly*

*Direct Radiation Sample Locations (Table A-1 continued)*

Station Number	Meteorological Sector/Azimuth (Degrees)	Distance from Reactor (Approx.)	Description	Collection Frequency	Type
T11	NNE/23°	6.2 mi.	Pole, NE corner of Milliman and Jefferson.	Q	I
T12	NNE/29°	6.3 mi.	Pointe Mouille Game Area Field Office, Pole near tree, N area of parking lot.	Q	I
T13	N/356°	4.1 mi.	Labo and Dixie Hwy. Pole on SW corner with light.	Q	I
T14	NNW/337°	4.4 mi.	Labo and Brandon Pole on SE corner near RR.	Q	I
T15	NW/315°	3.9 mi.	Pole, behind building at the corner of Swan Creek and Mill St.	Q	I
T16	WNW/283°	4.9 mi.	Pole, SE corner of War and Post Rd.	Q	I
T17	W/271°	4.9 mi.	Pole, NE corner of Nadeau and Laprad near mobile home park.	Q	I
T18	WSW/247°	4.8 mi.	Pole, NE corner of Mentel and Hurd Rd.	Q	I
T19	SW/236°	5.2 mi.	Fermi siren pole on Waterworks Rd. NE corner of intersection - Sterling State Park Rd. Entrance Drive/Waterworks.	Q	I
T20	WSW/257°	2.7 mi.	Pole, S side of Williams Rd, 9 poles W of Dixie Hwy. (Special Area)	Q	I
T21	WSW/239°	2.7 mi.	Pole, N side of Pearl at Parkview Woodland Beach. (Special Area)	Q	I

*I = Indicator*

*C = Control*

*O = On-site*

*Q = Quarterly*

*Direct Radiation Sample Locations (Table A-1 continued)*

Station Number	Meteorological Sector/Azimuth (Degrees)	Distance from Reactor (Approx.)	Description	Collection Frequency	Type
T22	S/172°	1.2 mi.	Pole, N side of Pointe Aux Peaux 2 poles W of Long - Site Boundary.	Q	I
T23	SSW/195°	1.1 mi.	Pole, S side of Pointe Aux Peaux 1 pole W of Huron next to Vent Pipe - Site Boundary.	Q	I
T24	SW/225°	1.2 mi.	Fermi Gate along Pointe Aux Peaux Rd. on fence wire W of gate Site Boundary.	Q	I
T25	WSW/252°	1.5 mi.	Pole, Toll Rd. - 12 poles S of Fermi Drive.	Q	I
T26	WSW/259°	1.1 mi.	Pole, Toll Rd. - 6 poles S of Fermi Drive.	Q	I
T27	SW/225°	6.8 mi.	Pole, NE corner of McMillan and East Front St. (Special Area)	Q	I
T28	SW/229°	10.7 mi.	Pole, N side of Mortar Creek between Hull and LaPlaisance.	Q	C
T29	WSW/237°	10.3 mi.	Pole, NE corner of S Dixie and Albain.	Q	C
T30	WSW/247°	7.8 mi.	E side S end of foot bridge, St. Mary's Park corner of Elm and Monroe St. (Special Area)	Q	I
T31	WSW/255°	9.6 mi.	1st pole W of entrance drive Milton "Pat" Munson Recreational Reserve on North Custer Rd.	Q	C

*I = Indicator*

*C = Control*

*O = On-site*

*Q = Quarterly*

*Direct Radiation Sample Locations (Table A-1 continued)*

Station Number	Meteorological Sector/Azimuth (Degrees)	Distance from Reactor (Approx.)	Description	Collection Frequency	Type
T32	WNW/295°	10.3 mi.	Pole, corner of Stony Creek and Finzel Rd.	Q	I
T33	NW/317°	9.2 mi.	Pole, W side of Grafton Rd. 1 pole N of Ash and Grafton intersection.	Q	I
T34	NNW/338°	9.8 mi.	Pole, SW corner of Port Creek and Will-Carleton Rd.	Q	I
T35	N/359°	6.9 mi.	Pole, S Side of S Huron River Dr. across from Race St. (Special Area)	Q	I
T36	N/358°	9.1 mi.	Pole, NE corner of Gibraltar and Cahill Rd.	Q	I
T37	NNE/21°	9.8 mi.	Pole, S corner of Adams and Gibraltar across from Humbug Marina.	Q	I
T38	WNW/294°	1.7 mi.	Residence - 6594 N. Dixie Hwy.	Q	I
T39	S/176°	0.3 mi.	SE corner of Protected Area Fence (PAF).	Q	O
T40	S/170°	0.3 mi.	Midway along OBA - PAF.	Q	O
T41	SSE/161°	0.2 mi.	Midway between OBA and Shield Wall on PAF.	Q	O
T42	SSE/149°	0.2 mi.	Midway along Shield Wall on PAF.	Q	O
T43	SE/131°	0.1 mi.	Midway between Shield Wall and Aux Boilers on PAF.	Q	O
T44	ESE/109°	0.1 mi.	Opposite OSSF door on PAF.	Q	O

*I = Indicator*

*C = Control*

*O = On-site*

*Q = Quarterly*

*Direct Radiation Sample Locations (Table A-1 continued)*

Station Number	Meteorological Sector/Azimuth (Degrees)	Distance from Reactor (Approx.)	Description	Collection Frequency	Type
T45	E/86°	0.1 mi.	NE Corner of PAF.	Q	O
T46	ENE/67°	0.2 mi.	NE side of barge slip on fence.	Q	O
T47	S/185°	0.1 mi.	South of Turbine Bldg. rollup door on PAF.	Q	O
T48	SW/235°	0.2 mi.	30 ft. from corner of AAP on PAF.	Q	O
T49	WSW/251°	1.1 mi.	Corner of Site Boundary fence north of NOC along Critical Path Rd.	Q	I
T50	W/270°	0.9 mi.	Site Boundary fence near main gate by the south Bullet Street sign.	Q	I
T51	N/3°	0.4 mi.	Site Boundary fence north of north Cooling Tower.	Q	O
T52	NNE/20°	0.4 mi.	Site Boundary fence at the corner of Arson and Tower.	Q	O
T53	NE/55°	0.2 mi.	Site Boundary fence east of South Cooling Tower.	Q	O
T54	S/189°	0.3 mi.	Pole next to Fermi 2 Visitors Center.	Q	O
T55	WSW/251°	3.3 mi.	Pole, north side of Nadeau Rd. across from Sodt Elementary School Marquee.	Q	I
T56	WSW/255°	4.9 mi.	Pole, entrance to Jefferson Middle School on Stony Creek Rd.	Q	I

*I = Indicator*

*C = Control*

*O = On-site*

*Q = Quarterly*

*Direct Radiation Sample Locations (Table A-1 continued)*

Station Number	Meteorological Sector/Azimuth (Degrees)	Distance from Reactor (Approx.)	Description	Collection Frequency	Type
T57	W/260°	2.7 mi.	Pole, north side of Williams Rd. across from Jefferson High School entrance.	Q	I
T58	WSW/249°	4.9 mi.	Pole west of Hurd Elementary School Marquee.	Q	I
T59	NW/325°	2.6 mi.	Pole north of St. Charles Church entrance on Dixie Hwy.	Q	I
T60	NNW/341°	2.5 mi.	1st pole north of North Elementary School entrance on Dixie Hwy.	Q	I
T61	W/268°	10.1 mi.	Pole, SW corner of Stewart and Raisinville Rd.	Q	I
T62	SW/232°	9.7 mi.	Pole, NE corner of Albain and Hull Rd.	Q	I
T63	WSW/245°	9.6 mi.	Pole, NE corner of Dunbar and Telegraph Rd.	Q	I
T64	WNW/286°	0.2 mi.	West of switchgear yard on PAF.	Q	O
T65	NW/322°	0.1 mi.	PAF switchgear yard area NW of RHR complex.	Q	O
T66	NE/50°	0.1 mi.	Behind Bldg. 42 on PAF.	Q	O
T67	NNW/338°	0.2 mi.	Site Boundary fence West of South Cooling Tower.	Q	O
T68	WNW/303°	0.6 mi	Langton Rd. seven poles East of Leroux Rd.	Q	I
T69	NW/306°	0.8 mi	Langton Rd. five poles East of Leroux Rd.	Q	I
T70	NNW/333°	1.1 mi	Leroux Rd. last pole North of Fermi Dr.	Q	I
T71	WNW/300°	1.1 mi	Leroux Rd. six poles North of Fermi Dr.	Q	I

*I = Indicator                      C = Control                      O = On-site                      Q = Quarterly*



**Direct Radiation Sample Locations (Table A-1 continued)**

Station Number	Meteorological Sector/Azimuth (Degrees)	Distance from Reactor (Approx.)	Description	Collection Frequency	Type
ISFSI-1	WNW/302.3°	0.175 mi.	Center of west ISFSI fence.	Q	O
ISFSI-2	NW/310.2°	0.186 mi.	NW corner ISFSI fence.	Q	O
ISFSI-3	NW/313.2°	0.166 mi.	Center of north ISFSI fence.	Q	O
ISFSI-4	NW/315.6°	0.149 mi.	NE corner ISFSI fence.	Q	O
ISFSI-5	NW/305.4°	0.140 mi	Center of east ISFSI fence.	Q	O
ISFSI-6	WNW/294.1°	0.136 mi	SE corner ISFSI fence.	Q	O
ISFSI-7	WNW/293.0°	0.157 mi	Center of south ISFSI fence.	Q	O
ISFSI-8	WNW/293°	0.177 mi	SW corner ISFSI fence.	Q	O

*I = Indicator                      C = Control                      O = On-site                      Q = Quarterly*

**Air Particulate and Air Iodine Sample Locations**

**Table A-2**

Station Number	Meteorological Sector/Azimuth (Degrees)	Distance from Reactor (Approx.)	Description	Collection Frequency	Type
API-1	NE/39°	1.4 mi.	Estral Beach Pole on Lakeshore, 18 Poles S of Lakeview (Nearest Community with highest X/Q).	W	I
API-2	NNW/337°	0.6 mi.	Site Boundary and Toll Road, on Site Fence by T-4.	W	I
API-3	NW/313°	0.6 mi.	Site Boundary and Toll Road, on Site Fence by T-5.	W	I
API-4	W/270°	14.0 mi.	Pole, at Michigan Gas substation on N. Custer Rd., 0.66 miles west of Doty Rd.	W	C
API-5	S/188°	1.2 mi.	Pole, N corner of Pointe Aux Peaux and Dewey Rd.	W	I

*I = Indicator                      C = Control                      W = Weekly*

***Milk Sample Locations***

**Table A-3**

Station Number	Meteorological Sector/Azimuth (Degrees)	Distance from Reactor (Approx.)	Description	Collection Frequency	Type
M-2	NW/319°	5.4 mi.	Reaume Farm - 2705 E Labo.	M-SM	I
M-8	WNW/289°	9.9 mi.	Calder Dairy - 9334 Finzel Rd.	M-SM	C

*I = Indicator                      C = Control                      M = Monthly                      SM = Semimonthly*

***Garden Sample Locations***

**Table A-4**

Station Number	Meteorological Sector/Azimuth (Degrees)	Distance from Reactor (Approx.)	Description	Collection Frequency	Type
FP-1	NNE/21°	3.8 mi.	9501 Turnpike Highway.	M	I
FP-9	W/261°	10.9 mi.	4074 North Custer Road.	M	C

*I = Indicator                      C = Control                      M = Monthly (when available)*

***Drinking-Water Sample Locations***

**Table A-5**

Station Number	Meteorological Sector/Azimuth (Degrees)	Distance from Reactor (Approx.)	Description	Collection Frequency	Type
DW-1	S/174°	1.1 mi.	Monroe Water Station N Side of Pointe Aux Peaux 1/2 Block W of Long Rd.	M	I
DW-2	N/8°	18.5 mi.	Detroit Water Station 14700 Moran Rd, Allen Park.	M	C

*I = Indicator                      C = Control                      M = Monthly*

**Surface-Water Sample Locations**

**Table A-6**

Station Number	Meteorological Sector/Azimuth (Degrees)	Distance from Reactor (Approx.)	Description	Collection Frequency	Type
SW-2	NNE/20°	11.7 mi.	DECO's Trenton Channel Power Plant Intake Structure (Screenhouse #1).	M	C
SW-3	SSE/160°	0.2 mi.	DECO's Fermi 2 General Service Water Intake Structure.	M	I

*I = Indicator*

*C = Control*

*M = Monthly*

**Ground-Water Sample Locations**

**Table A-7**

Station Number	Meteorological Sector/Azimuth (Degrees)	Distance from Reactor (Approx.)	Description	Collection Frequency	Type
GW-1	S/175°	0.4 mi.	Approx. 100 ft W of Lake Erie, EF-1 Parking lot near gas fired peakers.	Q	I
GW-2	SSW/208°	1.0 mi.	4 ft S of Pointe Aux Peaux (PAP) Rd. Fence 427 ft W of where PAP crosses over Stony Point's Western Dike.	Q	I
GW-3	SW/226°	1.0 mi.	143 ft W of PAP Rd. Gate, 62 ft N of PAP Rd. Fence.	Q	I
GW-4	WNW/299°	0.6 mi.	42 ft S of Langton Rd, 8 ft E of Toll Rd. Fence.	Q	C

*I = Indicator*

*C = Control*

*Q = Quarterly*

***Sediment Sample Locations***

**Table A-8**

Station Number	Meteorological Sector/Azimuth (Degrees)	Distance from Reactor (Approx.)	Description	Collection Frequency	Type
S-1	SSE/165°	0.9 mi.	Pointe Aux Peaux, Shoreline to 500 ft offshore sighting directly to Land Base Water Tower.	SA	I
S-2	E/81°	0.2 mi.	Fermi 2 Discharge, approx. 200 ft offshore.	SA	I
S-3	NE/39°	1.1 mi.	Estral Beach, approx. 200 ft offshore, off North shoreline where Swan Creek and Lake Erie meet.	SA	I
S-4	WSW/241°	3.0 mi.	Indian Trails Community Beach.	SA	I
S-5	NNE/20°	11.7 mi.	DECo's Trenton Channel Power Plant intake area.	SA	C


*I = Indicator                      C = Control                      SA = Semiannually*

***Fish Sample Locations***

**Table A-9**

Station Number	Meteorological Sector/Azimuth (Degrees)	Distance from Reactor (Approx.)	Description	Collection Frequency	Type
F-1	NNE/31°	9.5 mi.	Near Celeron Island.	SA	C
F-2	E/86°	0.4 mi.	Fermi 2 Discharge (approx. 1200 ft offshore).	SA	I
F-3	SW/227°	3.5 mi.	Brest Bay.	SA	C

*I = Indicator                      C = Control                      SA = Semiannually*

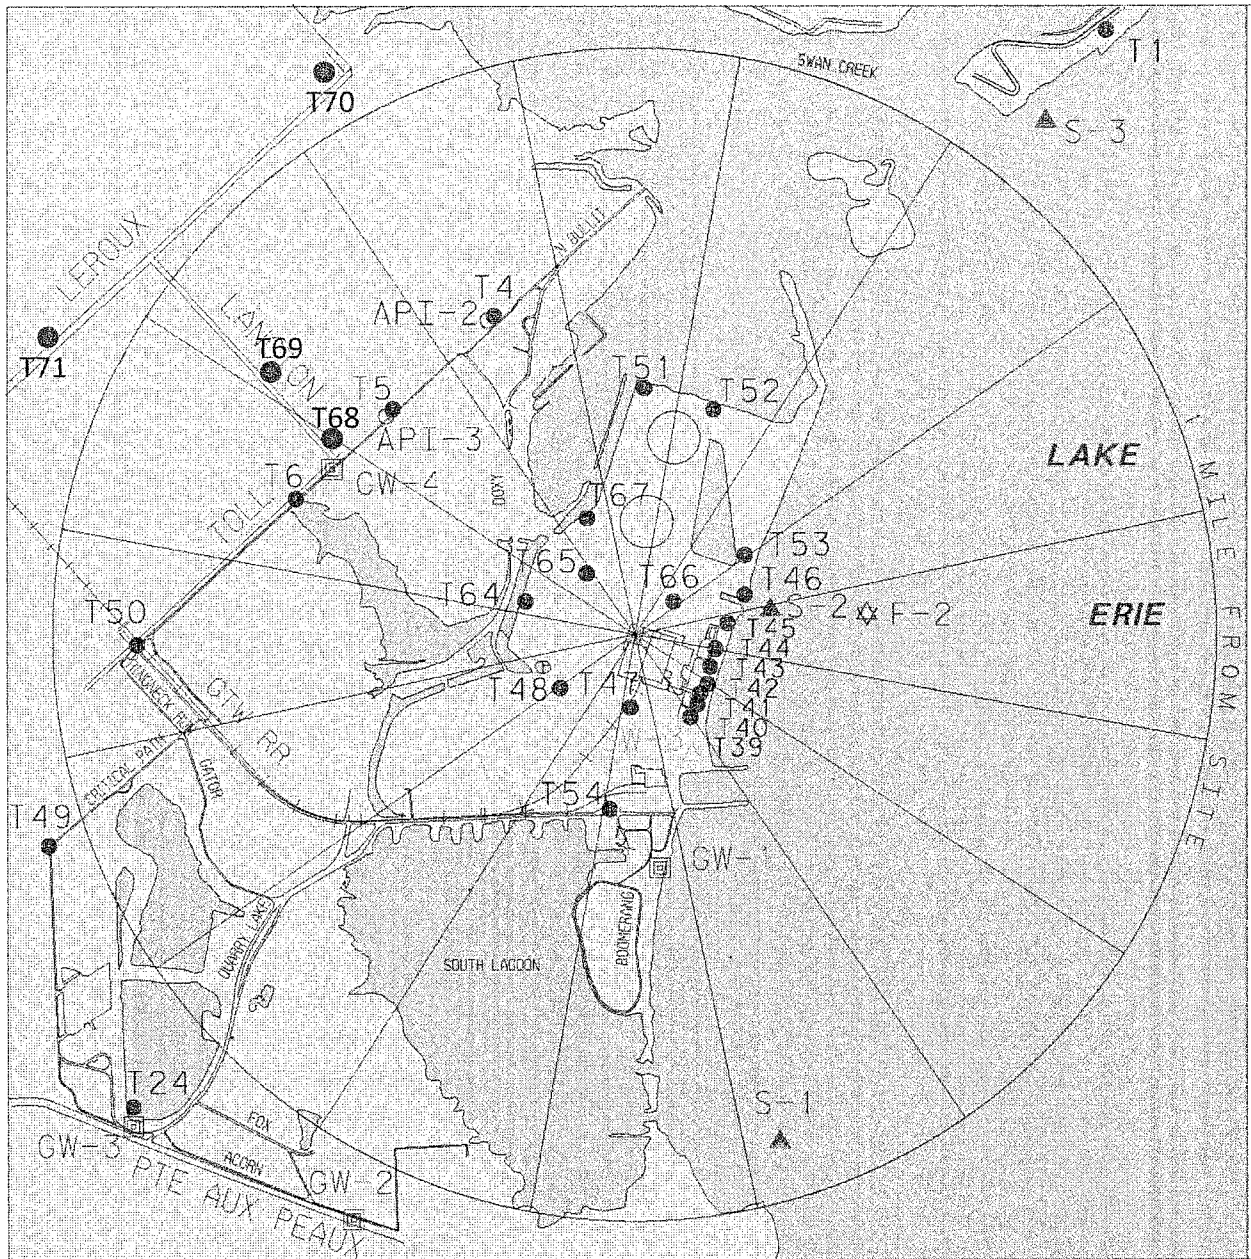


MAP - 1  
 SAMPLING LOCATIONS  
 BY STATION NUMBER  
 WITHIN 1 MILE

LEGEND

- T- DIRECT RADIATION
- API- AIR PARTICULATES/AIR IODINE
- ▲ S- SEDIMENTS
- △ DW/SW- DRINKING WATER/SURFACE WATER
- GW- GROUND WATER
- M- MILK
- ⊗ FP- FOOD PRODUCTS
- ☆ F- FISH




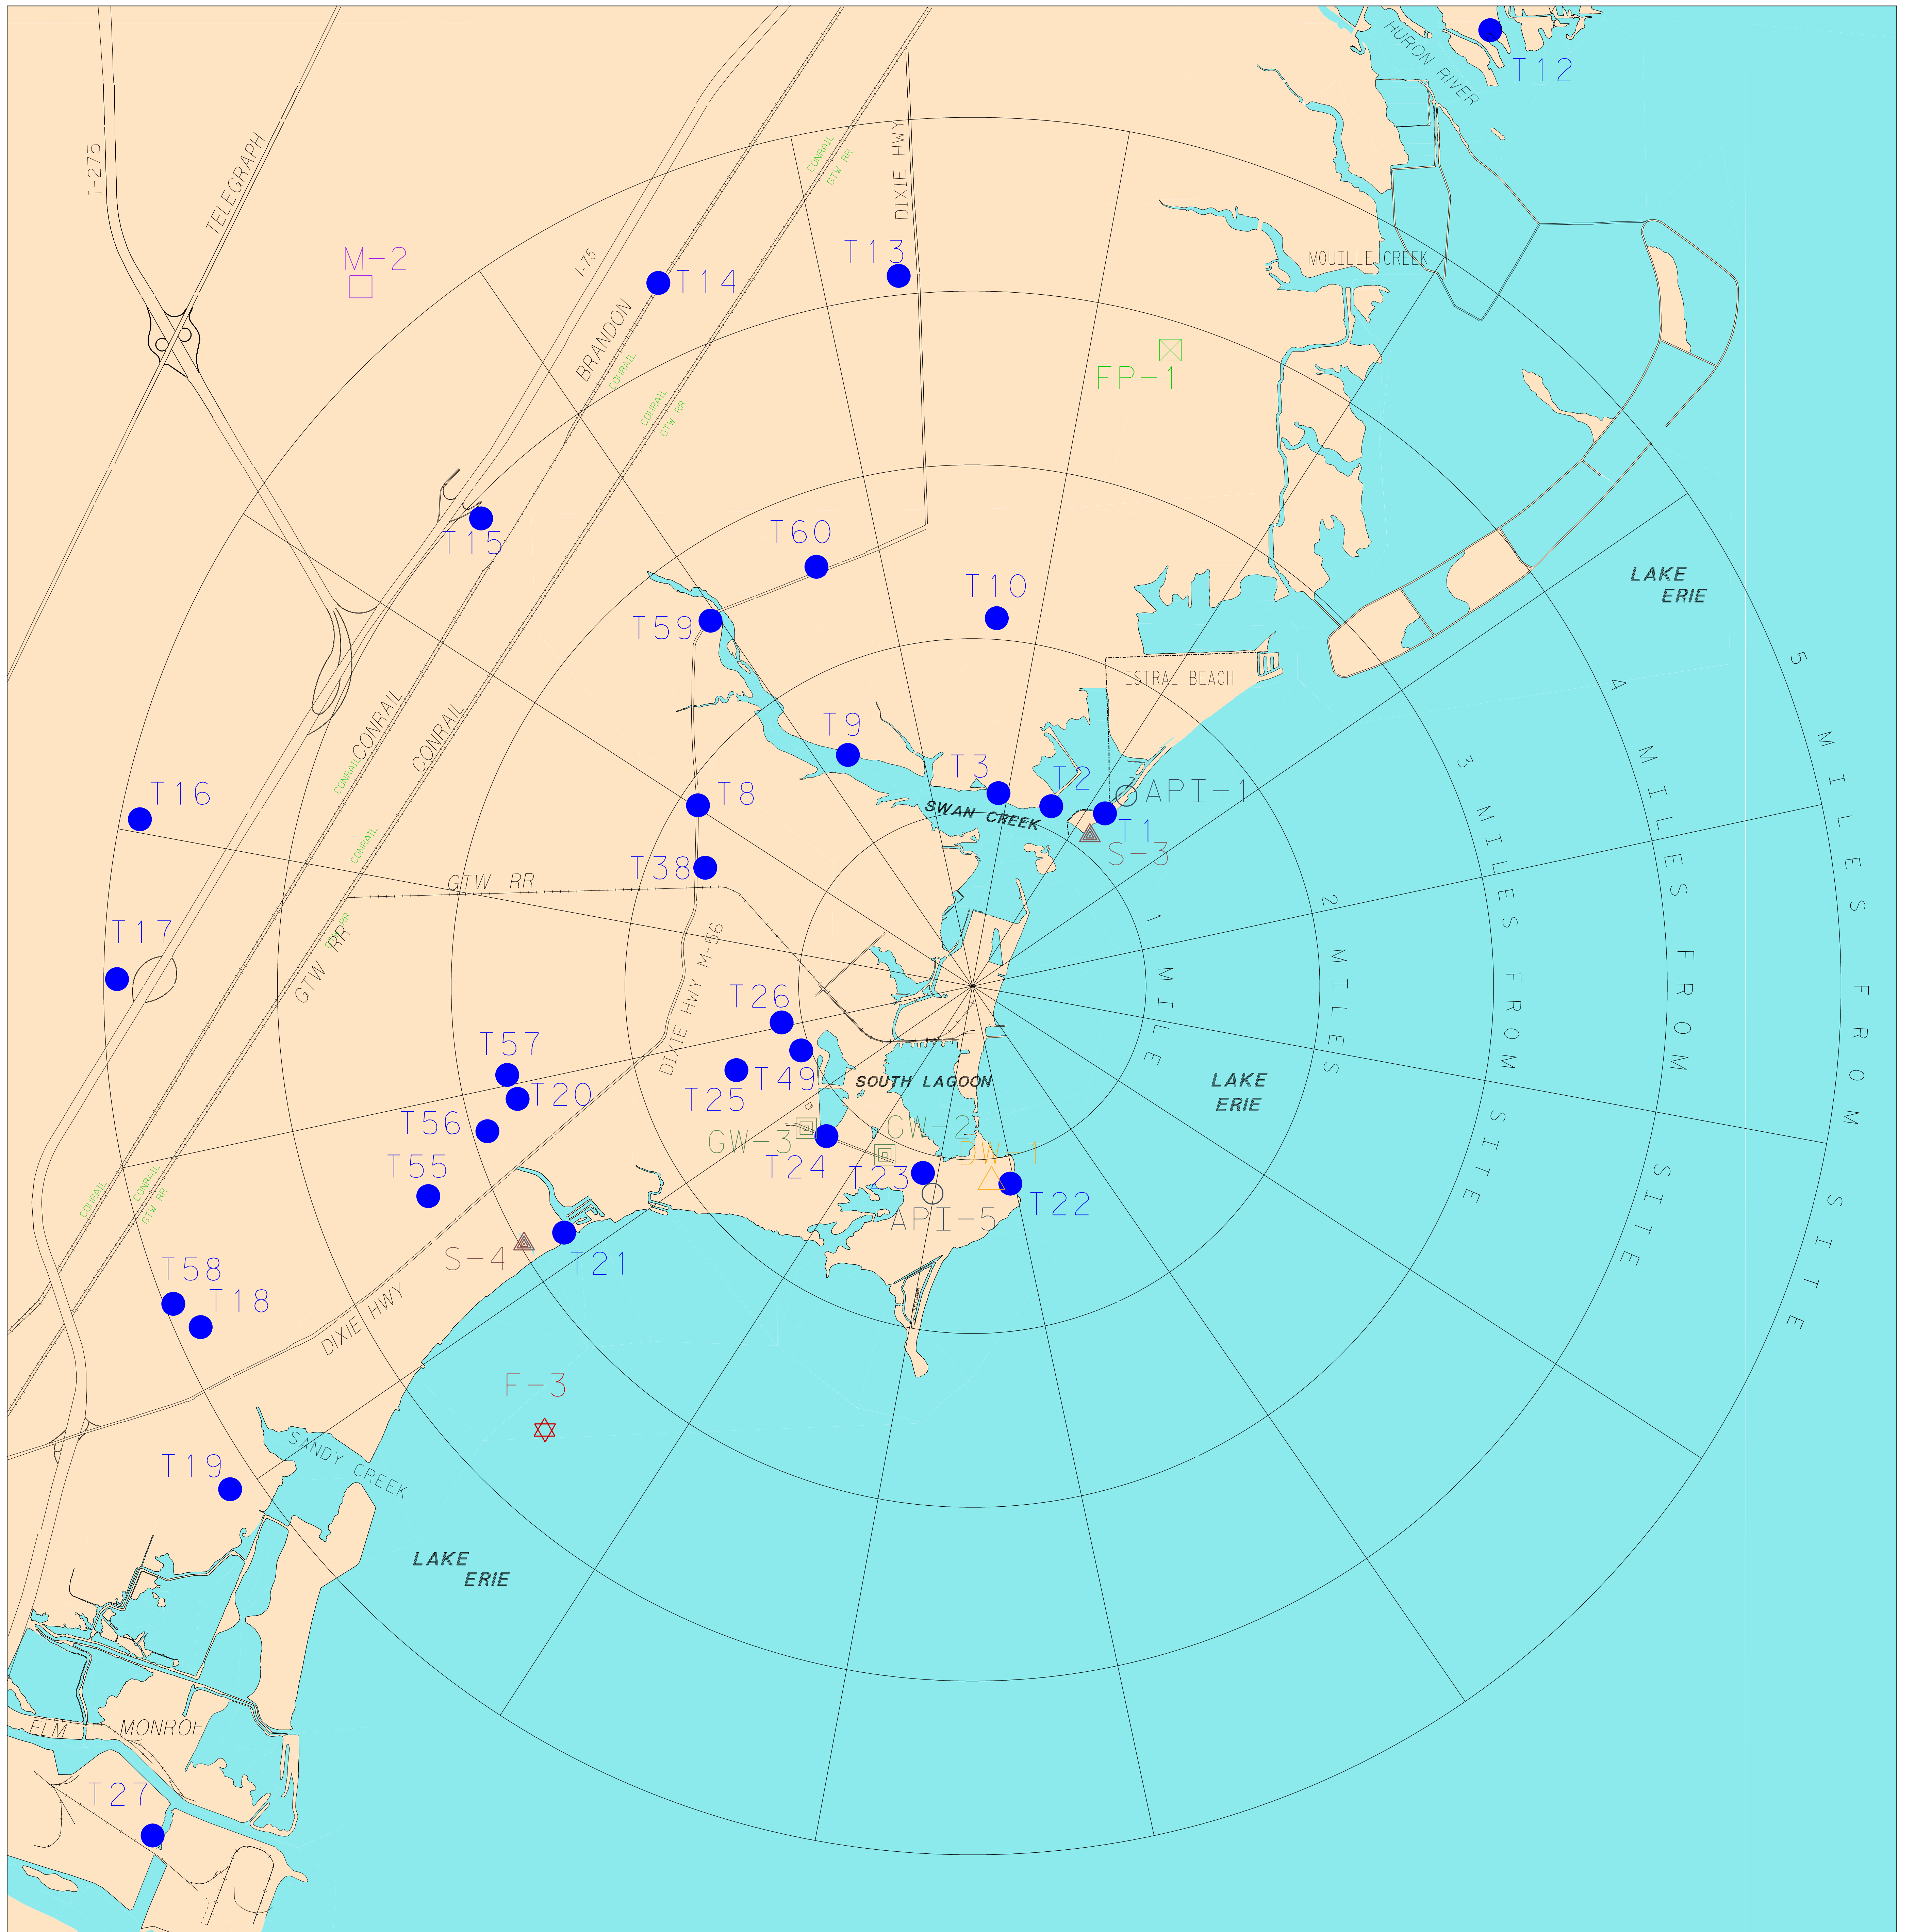


MAP - 2  
 SAMPLING LOCATIONS  
 BY STATION NUMBER  
 (1 TO 5 MILES)

LEGEND

- T- DIRECT RADIATION
- API- AIR PARTICULATES/AIR IODINE
- ▲ S- SEDIMENTS
- △ DW/SW- DRINKING WATER/SURFACE WATER
- GW- GROUND WATER
- M- MILK
- ⊠ FP- FOOD PRODUCTS
- ☆ F- FISH


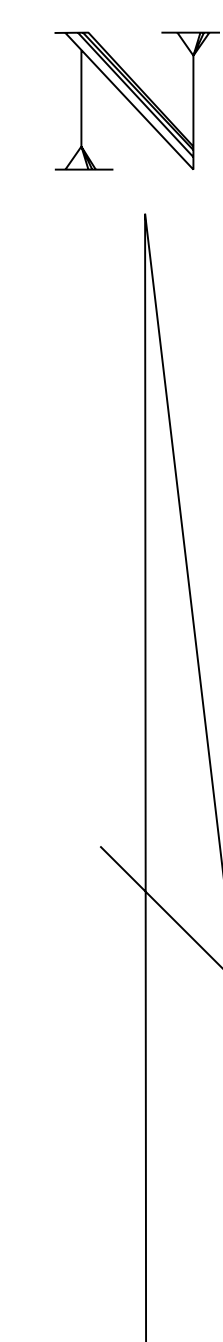


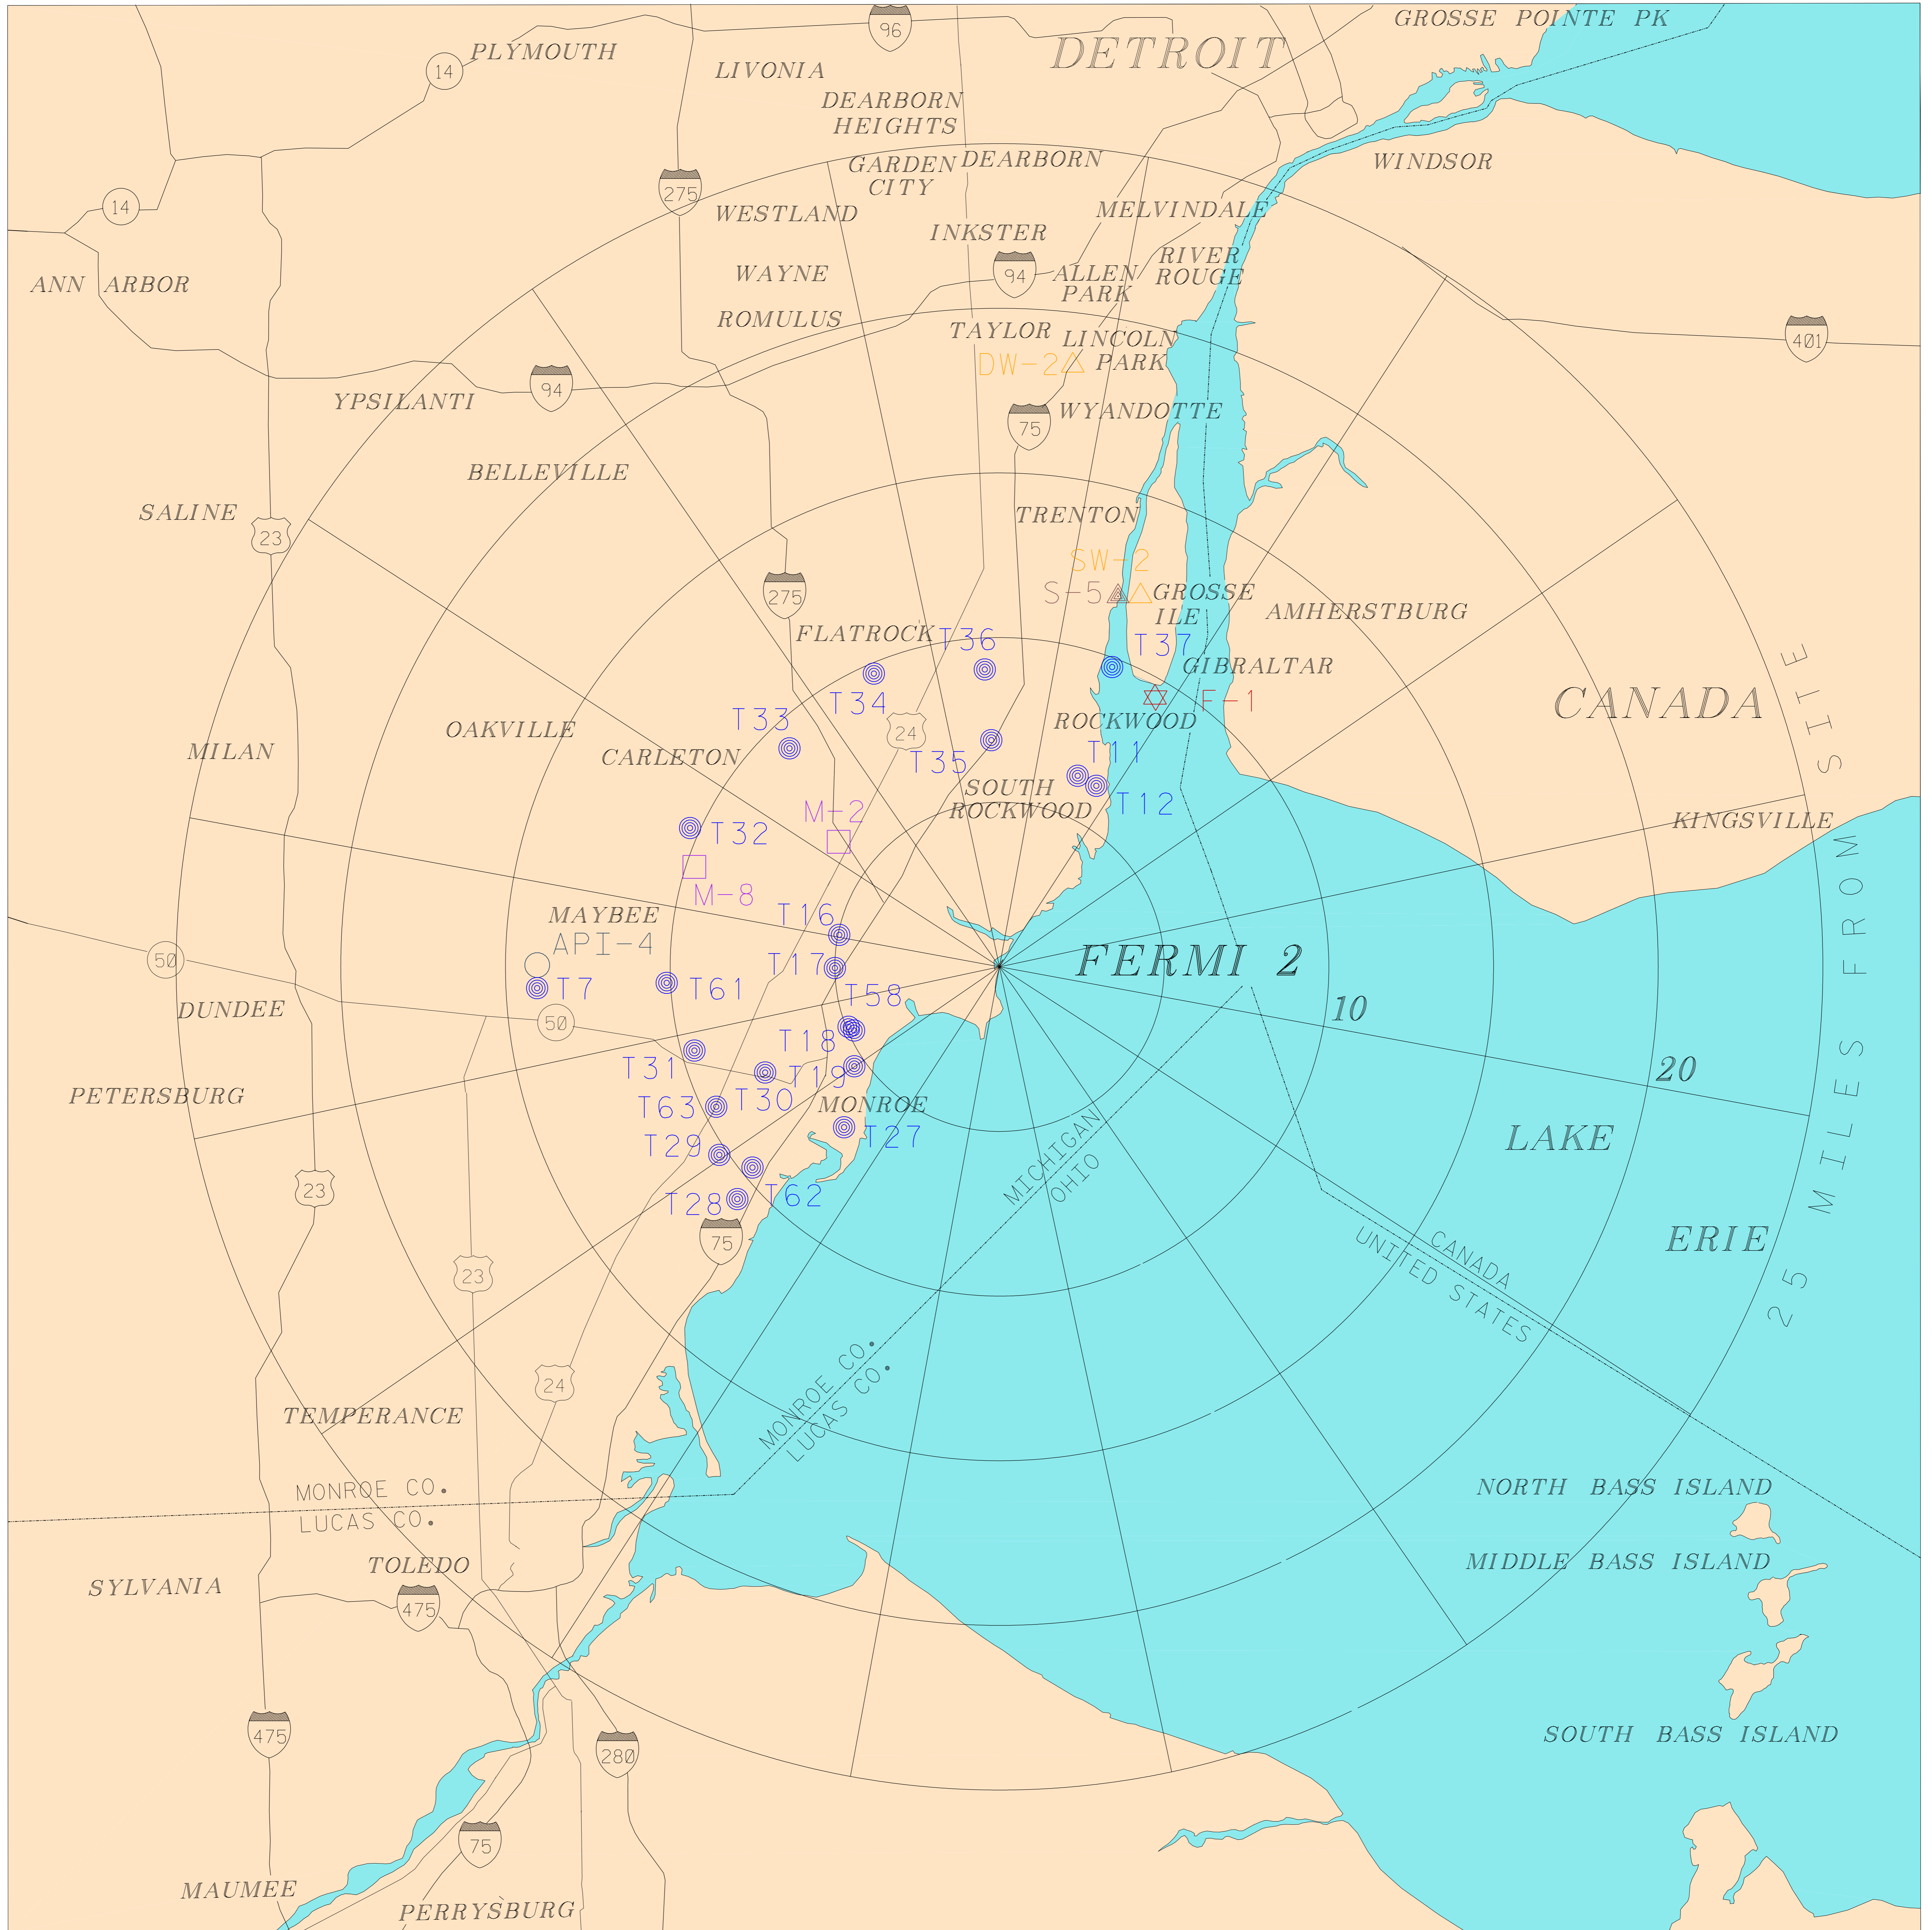

MAP - 3  
 SAMPLING LOCATIONS  
 BY STATION NUMBER  
 (GREATER THAN 5 MILES)

LEGEND

- T- DIRECT RADIATION
- API- AIR PARTICULATES OR AIR IODINE
- ▲ S- SEDIMENTS
- △ DW/SW- DRINKING WATER/SURFACE WATER
- ◻ GW- GROUND WATER
- ◻ M- MILK
- ◻ FP- FOOD PRODUCTS
- ⊠ F- FISH

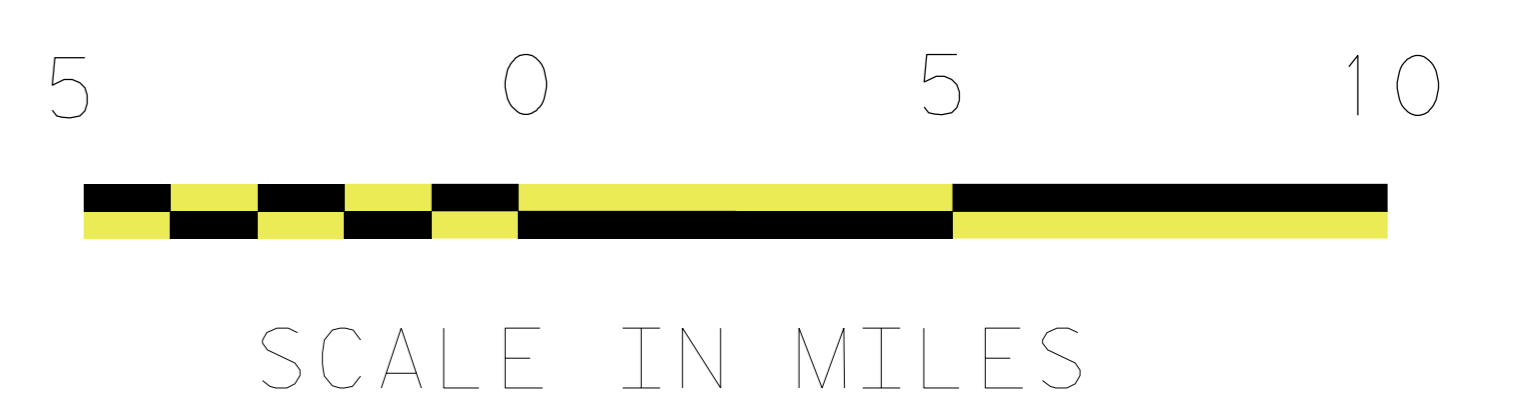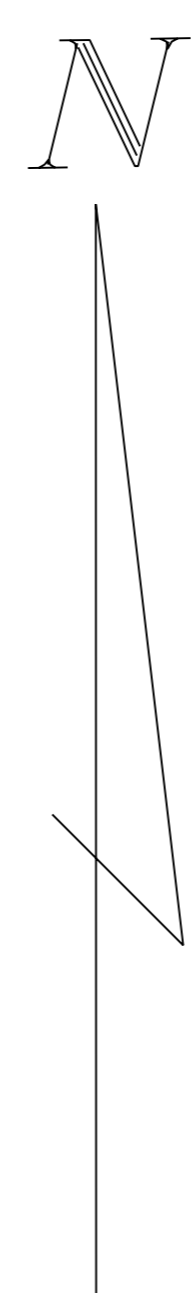

# Appendix B

## Environmental Data Summary



*Fermi 2 – 2013  
Annual Radiological Environmental Operating Report  
Appendix B – Environmental Data Summary*

Table B-1

Radiological Environmental Monitoring Program Summary

Name of Facility: Enrico Fermi Unit 2

Docket No.: 50-341

Reporting Period: January - December 2013

Location of Facility: 30 miles southeast of Detroit, Michigan (Frenchtown Township)

Sample Type (Units)	Type and Number of Analysis	LLD (b)	Indicator Locations Mean and Range (d)	Location with Highest Annual Mean		Control Locations Mean and Range (d)	Number of Non-routine Results (f)
				Location (e)	Mean and Range (d)		
Direct Radiation <i>mR/std qtr (a)</i>	Gamma (TLD) 212	1.0	14.9 (195/196) 11.0 to 20.6	T-49 (Indicator)	19.8 (4/4) 19.0 to 20.6	14.1 (16/16) 11.4 to 16.4	None
Airborne Particulates <i>pCi/cu. m.</i>	Gross Beta 260	1.00E-2	4.09E-2 (207/208) 1.85e-02 to 1.14E-1	API-2 (Indicator)	4.29E-2 (52/52) 2.35E-2 to 9.94E-2	4.04E-2 (52/52) 1.81E-2 to 8.27E-2	None
	Gamma Spec. 20 Be-7	N/A	6.33E-2 (16/16) 4.57E-2 to 8.23E-2	API-2 (Indicator)	7.18E-2 (4/4) 6.45E-2 to 8.15E-2	5.84E-2 (4/4) 3.82E-2 to 7.02E-2	None
	K-40	N/A	1.40E-2 (7/16) 1.01E-2 to 2.17E-2	API-2 (Indicator)	1.59E-2 (2/4) 1.01E-2 to 2.17E-2	1.02E-2 (2/4) 9.61E-3 to 1.09E-2	None
	Mn-54	N/A	<MDA			<MDA	None
	Co-58	N/A	<MDA			<MDA	None
	Fe-59	N/A	<MDA			<MDA	None
	Co-60	N/A	<MDA			<MDA	None
	Zn-65	N/A	<MDA			<MDA	None
	Zr-95	N/A	<MDA			<MDA	None
	Nb-95	N/A	<MDA			<MDA	None
	Ru-103	N/A	<MDA			<MDA	None
	Ru-106	N/A	<MDA			<MDA	None
	Cs-134	5.00E-2	<MDA			<MDA	None
	Cs-137	6.00E-2	<MDA			<MDA	None
	Ba-140	N/A	<MDA			<MDA	None
	La-140	N/A	<MDA			<MDA	None
Ce-141	N/A	<MDA			<MDA	None	
Ce-144	N/A	<MDA			<MDA	None	
Airborne Iodine <i>pCi/cu. m.</i>	I-131 260	7.00E-2	<MDA			<MDA	None

*Fermi 2 – 2013  
Annual Radiological Environmental Operating Report  
Appendix B – Environmental Data Summary*

Table B-1 Radiological Environmental Monitoring Program Summary (cont.)

Name of Facility: Enrico Fermi Unit 2

Docket No.: 50-341

Reporting Period: January - December 2013

Location of Facility: 30 miles southeast of Detroit, Michigan (Frenchtown Township)

Sample Type (Units)	Type and Number of Analysis	LLD (b)	Indicator Locations Mean and Range (d)	Location with Highest Annual Mean		Control Locations Mean and Range (d)	Number of Non-routine Results (f)	
				Location (e)	Mean and Range (d)			
Milk <i>pCi/l</i>	I-131 36	1.00E+0	<MDA	M-2 (Indicator)	1.41E+3 (18/18) 1.31E+3 to 1.49E+3	<MDA	None	
	Sr-89 36	N/A	<MDA			<MDA	None	
	Sr-90	N/A	<MDA			<MDA	None	
	Gamma Spec. 36							
	Be-7	N/A	<MDA			<MDA	None	
	K-40	N/A	1.41E+3 (18/18) 1.31E+3 to 1.49E+3			1.41E+3 (18/18) 1.33E+3 to 1.48E+3	1.41E+3 (18/18) 1.33E+3 to 1.48E+3	None
	Mn-54	N/A	<MDA			<MDA	None	
	Co-58	N/A	<MDA			<MDA	None	
	Fe-59	N/A	<MDA			<MDA	None	
	Co-60	N/A	<MDA			<MDA	None	
	Zn-65	N/A	<MDA			<MDA	None	
	Zr-95	N/A	<MDA			<MDA	None	
	Nb-95	N/A	<MDA			<MDA	None	
	Ru-103	N/A	<MDA			<MDA	None	
	Ru-106	N/A	<MDA			<MDA	None	
	Cs-134	1.50E+1	<MDA			<MDA	None	
	Cs-137	1.80E+1	<MDA			<MDA	None	
	Ba-140	1.50E+1	<MDA			<MDA	None	
	La-140	1.50E+1	<MDA			<MDA	None	
Ce-141	N/A	<MDA	<MDA	None				
Ce-144	N/A	<MDA	<MDA	None				
Vegetation <i>pCi/kg wet</i>	I-131 12	6.00E+1	<MDA	FP-9 (Control)	4.68E+2 (6/6) 2.33E+2 to 1.32E+3	<MDA	None	
	Gamma Spec. 12							
	Be-7	N/A	2.44E+2 (6/6) 1.58E+2 to 3.87E+2			4.68E+2 (6/6) 2.33E+2 to 1.32E+3	4.68E+2 (6/6) 2.33E+2 to 1.32E+3	None
	K-40	N/A	3.33E+3 (6/6) 2.65E+3 to 4.37E+3	FP-9 (Control)	3.80E+3 (6/6) 2.98E+3 to 4.47E+3	3.80E+3 (6/6) 2.98E+3 to 4.47E+3	None	

*Fermi 2 – 2013  
Annual Radiological Environmental Operating Report  
Appendix B – Environmental Data Summary*

Table B-1 Radiological Environmental Monitoring Program Summary (cont.)

Name of Facility: Enrico Fermi Unit 2

Docket No.: 50-341

Reporting Period: January - December 2013

Location of Facility: 30 miles southeast of Detroit, Michigan (Frenchtown Township)

Sample Type (Units)	Type and Number of Analysis	LLD (b)	Indicator Locations Mean and Range (d)	Location with Highest Annual Mean		Control Locations Mean and Range (d)	Number of Non-routine Results (f)
				Location (e)	Mean and Range(d)		
Vegetation (cont.) <i>pCi/kg wet</i>	Mn-54	N/A	<MDA			<MDA	None
	Co-58	N/A	<MDA			<MDA	None
	Fe-59	N/A	<MDA			<MDA	None
	Co-60	N/A	<MDA			<MDA	None
	Zn-65	N/A	<MDA			<MDA	None
	Zr-95	N/A	<MDA			<MDA	None
	Nb-95	N/A	<MDA			<MDA	None
	Ru-103	N/A	<MDA			<MDA	None
	Ru-106	N/A	<MDA			<MDA	None
	Cs-134	6.00E+1	<MDA			<MDA	None
	Cs-137	8.00E+1	<MDA			<MDA	None
	Ba-140	N/A	<MDA			<MDA	None
	La-140	N/A	<MDA			<MDA	None
	Ce-141	N/A	<MDA			<MDA	None
	Ce-144	N/A	<MDA			<MDA	None
Drinking Water <i>pCi/l</i>	Gross Beta 24	4.00E+0	<MDA			<MDA	None
	Sr-89 24	N/A	<MDA			<MDA	None
	Sr-90	N/A	<MDA			<MDA	None
	Gamma Spec. 24						
	Be-7	N/A	<MDA			<MDA	None
	K-40	N/A	<MDA	DW-2 (Control)	2.51E+1 (1/12)	2.51E+1 (1/12)	None
	Cr-51	N/A	<MDA			<MDA	None
	Mn-54	1.50E+1	<MDA			<MDA	None
	Co-58	1.50E+1	<MDA			<MDA	None
	Fe-59	3.00E+1	<MDA			<MDA	None
	Co-60	1.50E+1	<MDA			<MDA	None
	Zn-65	3.00E+1	<MDA			<MDA	None
	Zr-95	1.50E+1	<MDA			<MDA	None
Nb-95	1.50E+1	<MDA			<MDA	None	

*Fermi 2 – 2013  
Annual Radiological Environmental Operating Report  
Appendix B – Environmental Data Summary*

Table B-1 Radiological Environmental Monitoring Program Summary (cont.)

Name of Facility: Enrico Fermi Unit 2

Docket No.: 50-341

Reporting Period: January - December 2013

Location of Facility: 30 miles southeast of Detroit, Michigan (Frenchtown Township)

Sample Type (Units)	Type and Number of Analysis	LLD (b)	Indicator Locations Mean and Range (d)	Location with Highest Annual Mean		Control Locations Mean and Range (d)	Number of Non-routine Results (f)
				Location (e)	Mean and Range (d)		
Drinking Water (cont.) <i>pCi/l</i>	Ru-103	N/A	<MDA			<MDA	None
	Ru-106	N/A	<MDA			<MDA	None
	Cs-134	1.50E+1	<MDA			<MDA	None
	Cs-137	1.80E+1	<MDA			<MDA	None
	Ba-140	1.50E+1	<MDA			<MDA	None
	La-140	1.50E+1	<MDA			<MDA	None
	Ce-141	N/A	<MDA			<MDA	None
	Ce-144	N/A	<MDA			<MDA	None
H-3	8	2.00E+3	<MDA		<MDA	None	
Surface Water <i>pCi/l</i>	Sr-89	24	<MDA			<MDA	None
	Sr-90		<MDA			<MDA	None
	Gamma Spec.	24					
	Be-7		<MDA			<MDA	None
	K-40		4.05E+1 (1/12)	SW-3(Indicator)	4.05+1 (1/12)	<MDA	None
	Cr-51		<MDA			<MDA	None
	Mn-54		1.50E+1			<MDA	None
	Co-58		1.50E+1			<MDA	None
	Fe-59		3.00E+1			<MDA	None
	Co-60		1.50E+1			<MDA	None
	Zn-65		3.00E+1			<MDA	None
	Zr-95		1.50E+1			<MDA	None
	Nb-95		1.50E+1			<MDA	None
	Ru-103		N/A	<MDA		<MDA	None
	Ru-106		N/A	<MDA		<MDA	None
	Cs-134		1.50E+1	<MDA		<MDA	None
	Cs-137		1.80E+1	<MDA		<MDA	None
Ba-140		1.50E+1	<MDA		<MDA	None	
La-140		1.50E+1	<MDA		<MDA	None	
Ce-141		N/A	<MDA		<MDA	None	

*Fermi 2 – 2013  
Annual Radiological Environmental Operating Report  
Appendix B – Environmental Data Summary*

Table B-1 Radiological Environmental Monitoring Program Summary (cont.)

Name of Facility: Enrico Fermi Unit 2

Docket No.: 50-341

Reporting Period: January - December 2013

Location of Facility: 30 miles southeast of Detroit, Michigan (Frenchtown Township)

Sample Type (Units)	Type and Number of Analysis	LLD (b)	Indicator Locations Mean and Range (d)	Location with Highest Annual Mean		Control Locations Mean and Range (d)	Number of Non-routine Results (f)	
				Location (e)	Mean and Range (d)			
Surface Water (cont.) <i>pCi/l</i>	Ce-144 H-3           8	N/A 2.00E+3	<MDA <MDA			<MDA <MDA	None None	
Groundwater <i>pCi/l</i>	Gamma Spec. 16 Be-7 K-40 Cr-51 Mn-54 Co-58 Fe-59 Co-60 Zn-65 Zr-95 Nb-95 Ru-103 Ru-106 Cs-134 Cs-137 Ba-140 La-140 Ce-141 Ce-144 H-3           16	N/A N/A N/A 1.50E+1 1.50E+1 3.00E+1 1.50E+1 3.00E+1 1.50E+1 1.50E+1 N/A N/A 1.50E+1 1.80E+1 1.50E+1 1.50E+1 N/A N/A 2.00E+3	<MDA <MDA <MDA <MDA <MDA <MDA <MDA <MDA <MDA <MDA <MDA <MDA <MDA <MDA <MDA <MDA <MDA <MDA <MDA <MDA					None None
Sediment <i>pCi/kg dry</i>	Sr-89           10 Sr-90 Gamma Spec. 10 Be-7 K-40	N/A N/A N/A N/A	<MDA <MDA <MDA 1.38E+4 (8/8) 7.70E+3 to 2.41E+4	S-5 (Control) S-2 (Indicator)	1.19E+3 (1/2) 2.12E+4 (2/2) 1.83E+4 to 2.41E+4	<MDA <MDA 1.19E+3 (1/2) 1.03E+4 (2/2) 1.75E+3 to 1.48E+4	None None None None	

*Fermi 2 – 2013  
Annual Radiological Environmental Operating Report  
Appendix B – Environmental Data Summary*

Table B-1 Radiological Environmental Monitoring Program Summary (cont.)

Name of Facility: Enrico Fermi Unit 2

Docket No.: 50-341

Reporting Period: January - December 2013

Location of Facility: 30 miles southeast of Detroit, Michigan (Frenchtown Township)

Sample Type (Units)	Type and Number of Analysis	LLD (b)	Indicator Locations Mean and Range (d)	Location with Highest Annual Mean		Control Locations Mean and Range (d)	Number of Non-routine Results (f)	
				Location (e)	Mean and Range (d)			
Sediment (cont.) <i>pCi/kg dry</i>	Mn-54	N/A	<MDA	S-5 (Control)	1.79E+2 (1/2)	<MDA	None	
	Co-58	N/A	<MDA			<MDA	None	
	Fe-59	N/A	<MDA			<MDA	None	
	Co-60	N/A	<MDA			<MDA	None	
	Zn-65	N/A	<MDA			<MDA	None	
	Zr-95	N/A	<MDA			<MDA	None	
	Nb-95	N/A	<MDA			<MDA	None	
	Ru-103	N/A	<MDA			<MDA	None	
	Ru-106	N/A	<MDA			<MDA	None	
	Cs-134	1.50E+2	<MDA			<MDA	None	
	Cs-137	1.80E+2	1.26E+2 (1/8)			1.79E+2 (1/2)	1.79E+2 (1/2)	None
	Ba-140	N/A	<MDA			<MDA	None	
	La-140	N/A	<MDA			<MDA	None	
	Ce-141	N/A	<MDA			<MDA	None	
Ce-144	N/A	<MDA	<MDA	None				
Fish <i>pCi/kg wet</i>	Sr-89 29	N/A	<MDA	F-1 (Control)	3.17E+3 (6/15) 2.50E+3 to 3.66E+3	<MDA	None	
	Sr-90	N/A	<MDA			<MDA	None	
	Gamma Spec. 29					<MDA	None	
	Be-7	N/A	<MDA			<MDA	None	
	K-40	N/A	2.90E+3 (13/14) 2.33E+3 to 3.57E+3			3.04E+3 (15/15) 2.43E+3 to 3.66E+3	None	
	Mn-54	1.30E+2	<MDA			<MDA	None	
	Co-58	1.30E+2	<MDA			<MDA	None	
	Fe-59	2.60E+2	<MDA			<MDA	None	
	Co-60	1.30E+2	<MDA			<MDA	None	
Zn-65	2.60E+2	<MDA	<MDA	None				

Table B-1 Radiological Environmental Monitoring Program Summary (cont.)

Name of Facility: Enrico Fermi Unit 2

Docket No.: 50-341

Reporting Period: January - December 2013

Location of Facility: 30 miles southeast of Detroit, Michigan (Frenchtown Township)

Sample Type (Units)	Type and Number of Analysis	LLD (b)	Indicator Locations Mean and Range (d)	Location with Highest Annual Mean		Control Locations Mean and Range (d)	Number of Non-routine Results (f)
				Location (e)	Mean and Range (d)		
Fish (cont.) <i>pCi/kg wet</i>	Zr-95	N/A	<MDA	F-3 (Control)	7.37E+0 (1/14)	<MDA	None
	Nb-95	N/A	<MDA			<MDA	None
	Ru-103	N/A	<MDA			<MDA	None
	Ru-106	N/A	<MDA			<MDA	None
	Cs-134	1.30E+2	<MDA			<MDA	None
	Cs-137	1.50E+2	6.71E+0 (3/14) 4.93E+0 to 9.85E+0			7.25E+0 (2/14) 7.13E+0 to 7.37E+0	None
	Ba-140	N/A	<MDA			<MDA	None
	La-140	N/A	<MDA			<MDA	None
	Ce-141	N/A	<MDA			<MDA	None
	Ce-144	N/A	<MDA			<MDA	None

(a) Direct Radiation mean and range values are for off-site TLDs

(b) LLD = Fermi 2 ODCM LLD: nominal lower limit of detection based on 4.66 sigma error for background sample.

(c) <MDA = Less than the lab's minimum detectable activity which is less than the LLD.

(d) Mean and range based upon detectable measurements only. Fraction of detectable measurements at specified locations is indicated in parentheses (F).

(e) Locations are specified by Fermi 2 code and are described in Appendix A Sampling Locations.

(f) Non-routine results are those which are reportable according to Fermi 2 ODCM control 3.12.1.

Note: Other nuclides were considered in analysis results, but only those identifiable were reported in addition to ODCM listed nuclides.

## Appendix C

### Environmental Data Tables

*NOTES*

---

**Missed Samples**

- (a) TLD Missing
- (b) Missed sample due to equipment failure

**Laboratory Qualifiers**

- U: Target isotope was analyzed for but not detected above the MDC and LLD.
- UI: Uncertain identification for gamma spectroscopy.
- M: Reported result is less than the LLD and greater than the MDC.
- DL: MDC > LLD

**Results with DL Laboratory Qualifier**

For 2013, all results with a DL (or DLU) qualifier were attributed to Iodine-131 in some fish samples. The contract laboratory used an LLD of 60 pCi/kg for these samples, which was an error on the laboratory's part. Per the Fermi 2 ODCM Table 4.12.1-1, there is no LLD for Iodine-131 in fish. The contract laboratory apparently applied the LLD for "Food" to the "Fish" samples and this error caused the results to be flagged as DL (i.e. Minimum Detectible Activity greater than the required Lower Limit of Detection).



Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Indicator	API-1	02-Jan-13	Charcoal Cartridge	Iodine-131	-2.60E-03	pCi/m3	2.12E-02	0.07	U
Air Monitoring	Indicator	API-2	02-Jan-13	Charcoal Cartridge	Iodine-131	-2.48E-03	pCi/m3	1.36E-02	0.07	U
Air Monitoring	Indicator	API-3	02-Jan-13	Charcoal Cartridge	Iodine-131	-7.45E-04	pCi/m3	2.39E-02	0.07	U
Air Monitoring	Control	API-4	02-Jan-13	Charcoal Cartridge	Iodine-131	-5.59E-03	pCi/m3	1.51E-02	0.07	U
Air Monitoring	Indicator	API-5	02-Jan-13	Charcoal Cartridge	Iodine-131	2.56E-03	pCi/m3	2.00E-02	0.07	U
Air Monitoring	Indicator	API-1	09-Jan-13	Charcoal Cartridge	Iodine-131	8.77E-03	pCi/m3	2.48E-02	0.07	U
Air Monitoring	Indicator	API-2	09-Jan-13	Charcoal Cartridge	Iodine-131	6.99E-03	pCi/m3	1.88E-02	0.07	U
Air Monitoring	Indicator	API-3	09-Jan-13	Charcoal Cartridge	Iodine-131	-4.56E-03	pCi/m3	2.25E-02	0.07	U
Air Monitoring	Control	API-4	09-Jan-13	Charcoal Cartridge	Iodine-131	-5.53E-03	pCi/m3	1.60E-02	0.07	U
Air Monitoring	Indicator	API-5	09-Jan-13	Charcoal Cartridge	Iodine-131	4.33E-03	pCi/m3	2.06E-02	0.07	U
Air Monitoring	Indicator	API-1	15-Jan-13	Charcoal Cartridge	Iodine-131	2.53E-03	pCi/m3	1.18E-02	0.07	U
Air Monitoring	Indicator	API-2	15-Jan-13	Charcoal Cartridge	Iodine-131	5.06E-03	pCi/m3	2.64E-02	0.07	U
Air Monitoring	Indicator	API-3	15-Jan-13	Charcoal Cartridge	Iodine-131	4.53E-04	pCi/m3	1.17E-02	0.07	U
Air Monitoring	Control	API-4	15-Jan-13	Charcoal Cartridge	Iodine-131	-6.47E-03	pCi/m3	1.26E-02	0.07	U
Air Monitoring	Indicator	API-5	15-Jan-13	Charcoal Cartridge	Iodine-131	3.56E-03	pCi/m3	1.27E-02	0.07	U
Air Monitoring	Indicator	API-1	22-Jan-13	Charcoal Cartridge	Iodine-131	-1.27E-02	pCi/m3	2.01E-02	0.07	U
Air Monitoring	Indicator	API-2	22-Jan-13	Charcoal Cartridge	Iodine-131	4.56E-03	pCi/m3	1.96E-02	0.07	U
Air Monitoring	Indicator	API-3	22-Jan-13	Charcoal Cartridge	Iodine-131	6.43E-03	pCi/m3	2.66E-02	0.07	U
Air Monitoring	Control	API-4	22-Jan-13	Charcoal Cartridge	Iodine-131	3.24E-03	pCi/m3	1.95E-02	0.07	U
Air Monitoring	Indicator	API-5	22-Jan-13	Charcoal Cartridge	Iodine-131	-9.31E-04	pCi/m3	1.75E-02	0.07	U
Air Monitoring	Indicator	API-1	28-Jan-13	Charcoal Cartridge	Iodine-131	3.86E-03	pCi/m3	2.84E-02	0.07	U
Air Monitoring	Indicator	API-2	28-Jan-13	Charcoal Cartridge	Iodine-131	-5.55E-04	pCi/m3	3.81E-02	0.07	U
Air Monitoring	Indicator	API-3	28-Jan-13	Charcoal Cartridge	Iodine-131	-1.35E-03	pCi/m3	1.66E-02	0.07	U
Air Monitoring	Control	API-4	28-Jan-13	Charcoal Cartridge	Iodine-131	-3.48E-03	pCi/m3	2.37E-02	0.07	U
Air Monitoring	Indicator	API-5	28-Jan-13	Charcoal Cartridge	Iodine-131	-9.00E-04	pCi/m3	2.37E-02	0.07	U
Air Monitoring	Indicator	API-1	05-Feb-13	Charcoal Cartridge	Iodine-131	-2.82E-03	pCi/m3	2.00E-02	0.07	U
Air Monitoring	Indicator	API-2	05-Feb-13	Charcoal Cartridge	Iodine-131	-1.24E-03	pCi/m3	1.29E-02	0.07	U
Air Monitoring	Indicator	API-3	05-Feb-13	Charcoal Cartridge	Iodine-131	-3.09E-03	pCi/m3	1.62E-02	0.07	U
Air Monitoring	Control	API-4	05-Feb-13	Charcoal Cartridge	Iodine-131	6.20E-03	pCi/m3	2.00E-02	0.07	U
Air Monitoring	Indicator	API-5	05-Feb-13	Charcoal Cartridge	Iodine-131	9.92E-04	pCi/m3	1.92E-02	0.07	U
Air Monitoring	Indicator	API-1	12-Feb-13	Charcoal Cartridge	Iodine-131	-1.32E-03	pCi/m3	2.01E-02	0.07	U
Air Monitoring	Indicator	API-2	12-Feb-13	Charcoal Cartridge	Iodine-131	3.83E-03	pCi/m3	3.47E-02	0.07	U
Air Monitoring	Indicator	API-3	12-Feb-13	Charcoal Cartridge	Iodine-131	2.12E-03	pCi/m3	2.13E-02	0.07	U
Air Monitoring	Control	API-4	12-Feb-13	Charcoal Cartridge	Iodine-131	-8.12E-03	pCi/m3	1.60E-02	0.07	U
Air Monitoring	Indicator	API-5	12-Feb-13	Charcoal Cartridge	Iodine-131	1.60E-02	pCi/m3	2.85E-02	0.07	U
Air Monitoring	Indicator	API-1	19-Feb-13	Charcoal Cartridge	Iodine-131	1.46E-02	pCi/m3	3.27E-02	0.07	U
Air Monitoring	Indicator	API-2	19-Feb-13	Charcoal Cartridge	Iodine-131	1.20E-02	pCi/m3	4.74E-02	0.07	U
Air Monitoring	Indicator	API-3	19-Feb-13	Charcoal Cartridge	Iodine-131	4.90E-04	pCi/m3	2.66E-02	0.07	U
Air Monitoring	Control	API-4	19-Feb-13	Charcoal Cartridge	Iodine-131	7.21E-03	pCi/m3	2.41E-02	0.07	U
Air Monitoring	Indicator	API-5	19-Feb-13	Charcoal Cartridge	Iodine-131	-8.83E-03	pCi/m3	2.66E-02	0.07	U
Air Monitoring	Indicator	API-1	25-Feb-13	Charcoal Cartridge	Iodine-131	3.79E-03	pCi/m3	2.53E-02	0.07	U
Air Monitoring	Indicator	API-2	25-Feb-13	Charcoal Cartridge	Iodine-131	-1.62E-03	pCi/m3	2.87E-02	0.07	U
Air Monitoring	Indicator	API-3	25-Feb-13	Charcoal Cartridge	Iodine-131	7.31E-03	pCi/m3	2.88E-02	0.07	U
Air Monitoring	Control	API-4	25-Feb-13	Charcoal Cartridge	Iodine-131	-2.90E-03	pCi/m3	1.64E-02	0.07	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Indicator	API-5	25-Feb-13	Charcoal Cartridge	Iodine-131	-2.05E-02	pCi/m3	3.89E-02	0.07	U
Air Monitoring	Indicator	API-1	05-Mar-13	Charcoal Cartridge	Iodine-131	-1.31E-03	pCi/m3	1.55E-02	0.07	U
Air Monitoring	Indicator	API-2	05-Mar-13	Charcoal Cartridge	Iodine-131	-1.31E-03	pCi/m3	1.93E-02	0.07	U
Air Monitoring	Indicator	API-3	05-Mar-13	Charcoal Cartridge	Iodine-131	4.26E-05	pCi/m3	1.82E-02	0.07	U
Air Monitoring	Control	API-4	05-Mar-13	Charcoal Cartridge	Iodine-131	1.13E-03	pCi/m3	1.50E-02	0.07	U
Air Monitoring	Indicator	API-5	05-Mar-13	Charcoal Cartridge	Iodine-131	-9.10E-04	pCi/m3	1.79E-02	0.07	U
Air Monitoring	Indicator	API-1	12-Mar-13	Charcoal Cartridge	Iodine-131	5.89E-03	pCi/m3	1.61E-02	0.07	U
Air Monitoring	Indicator	API-2	12-Mar-13	Charcoal Cartridge	Iodine-131	3.16E-03	pCi/m3	2.45E-02	0.07	U
Air Monitoring	Indicator	API-3	12-Mar-13	Charcoal Cartridge	Iodine-131	2.00E-04	pCi/m3	1.98E-02	0.07	U
Air Monitoring	Control	API-4	12-Mar-13	Charcoal Cartridge	Iodine-131	5.59E-03	pCi/m3	1.72E-02	0.07	U
Air Monitoring	Indicator	API-5	12-Mar-13	Charcoal Cartridge	Iodine-131	-6.19E-03	pCi/m3	1.29E-02	0.07	U
Air Monitoring	Indicator	API-1	19-Mar-13	Charcoal Cartridge	Iodine-131	8.04E-03	pCi/m3	2.28E-02	0.07	U
Air Monitoring	Indicator	API-2	19-Mar-13	Charcoal Cartridge	Iodine-131	1.20E-02	pCi/m3	3.63E-02	0.07	U
Air Monitoring	Indicator	API-3	19-Mar-13	Charcoal Cartridge	Iodine-131	1.77E-03	pCi/m3	1.66E-02	0.07	U
Air Monitoring	Control	API-4	19-Mar-13	Charcoal Cartridge	Iodine-131	-3.30E-03	pCi/m3	1.65E-02	0.07	U
Air Monitoring	Indicator	API-5	19-Mar-13	Charcoal Cartridge	Iodine-131	9.43E-03	pCi/m3	1.90E-02	0.07	U
Air Monitoring	Indicator	API-1	26-Mar-13	Charcoal Cartridge	Iodine-131	-3.91E-03	pCi/m3	1.36E-02	0.07	U
Air Monitoring	Indicator	API-2	26-Mar-13	Charcoal Cartridge	Iodine-131	-8.58E-03	pCi/m3	1.06E-02	0.07	U
Air Monitoring	Indicator	API-3	26-Mar-13	Charcoal Cartridge	Iodine-131	-1.03E-02	pCi/m3	2.32E-02	0.07	U
Air Monitoring	Control	API-4	26-Mar-13	Charcoal Cartridge	Iodine-131	2.52E-04	pCi/m3	1.49E-02	0.07	U
Air Monitoring	Indicator	API-5	26-Mar-13	Charcoal Cartridge	Iodine-131	-7.47E-03	pCi/m3	1.64E-02	0.07	U
Air Monitoring	Indicator	API-1	02-Apr-13	Charcoal Cartridge	Iodine-131	2.47E-04	pCi/m3	2.10E-02	0.07	U
Air Monitoring	Indicator	API-2	02-Apr-13	Charcoal Cartridge	Iodine-131	6.82E-03	pCi/m3	1.91E-02	0.07	U
Air Monitoring	Indicator	API-3	02-Apr-13	Charcoal Cartridge	Iodine-131	3.21E-03	pCi/m3	1.84E-02	0.07	U
Air Monitoring	Control	API-4	02-Apr-13	Charcoal Cartridge	Iodine-131	-3.13E-03	pCi/m3	1.88E-02	0.07	U
Air Monitoring	Indicator	API-5	02-Apr-13	Charcoal Cartridge	Iodine-131	-2.86E-03	pCi/m3	1.62E-02	0.07	U
Air Monitoring	Indicator	API-1	09-Apr-13	Charcoal Cartridge	Iodine-131	-2.78E-04	pCi/m3	3.08E-02	0.07	U
Air Monitoring	Indicator	API-2	09-Apr-13	Charcoal Cartridge	Iodine-131	-3.23E-04	pCi/m3	3.28E-02	0.07	U
Air Monitoring	Indicator	API-3	09-Apr-13	Charcoal Cartridge	Iodine-131	4.34E-03	pCi/m3	3.00E-02	0.07	U
Air Monitoring	Control	API-4	09-Apr-13	Charcoal Cartridge	Iodine-131	5.68E-03	pCi/m3	3.30E-02	0.07	U
Air Monitoring	Indicator	API-5	09-Apr-13	Charcoal Cartridge	Iodine-131	-1.17E-02	pCi/m3	2.91E-02	0.07	U
Air Monitoring	Indicator	API-1	16-Apr-13	Charcoal Cartridge	Iodine-131	4.94E-03	pCi/m3	2.80E-02	0.07	U
Air Monitoring	Indicator	API-2	16-Apr-13	Charcoal Cartridge	Iodine-131	1.75E-02	pCi/m3	3.44E-02	0.07	U
Air Monitoring	Indicator	API-3	16-Apr-13	Charcoal Cartridge	Iodine-131	-1.01E-02	pCi/m3	2.25E-02	0.07	U
Air Monitoring	Control	API-4	16-Apr-13	Charcoal Cartridge	Iodine-131	4.06E-03	pCi/m3	4.68E-02	0.07	U
Air Monitoring	Indicator	API-5	16-Apr-13	Charcoal Cartridge	Iodine-131	2.25E-03	pCi/m3	2.66E-02	0.07	U
Air Monitoring	Indicator	API-1	23-Apr-13	Charcoal Cartridge	Iodine-131	-1.09E-03	pCi/m3	1.98E-02	0.07	U
Air Monitoring	Indicator	API-2	23-Apr-13	Charcoal Cartridge	Iodine-131	-9.29E-03	pCi/m3	1.52E-02	0.07	U
Air Monitoring	Indicator	API-3	23-Apr-13	Charcoal Cartridge	Iodine-131	-4.17E-03	pCi/m3	1.86E-02	0.07	U
Air Monitoring	Control	API-4	23-Apr-13	Charcoal Cartridge	Iodine-131	1.88E-02	pCi/m3	3.79E-02	0.07	U
Air Monitoring	Indicator	API-5	23-Apr-13	Charcoal Cartridge	Iodine-131	-3.64E-03	pCi/m3	1.70E-02	0.07	U
Air Monitoring	Indicator	API-1	30-Apr-13	Charcoal Cartridge	Iodine-131	-4.36E-03	pCi/m3	2.10E-02	0.07	U
Air Monitoring	Indicator	API-2	30-Apr-13	Charcoal Cartridge	Iodine-131	4.09E-03	pCi/m3	2.23E-02	0.07	U
Air Monitoring	Indicator	API-3	30-Apr-13	Charcoal Cartridge	Iodine-131	-5.09E-03	pCi/m3	4.03E-02	0.07	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Control	API-4	30-Apr-13	Charcoal Cartridge	Iodine-131	-8.26E-03	pCi/m3	2.19E-02	0.07	U
Air Monitoring	Indicator	API-5	30-Apr-13	Charcoal Cartridge	Iodine-131	1.88E-03	pCi/m3	2.17E-02	0.07	U
Air Monitoring	Indicator	API-1	07-May-13	Charcoal Cartridge	Iodine-131	-2.34E-03	pCi/m3	1.71E-02	0.07	U
Air Monitoring	Indicator	API-2	07-May-13	Charcoal Cartridge	Iodine-131	-4.58E-03	pCi/m3	2.19E-02	0.07	U
Air Monitoring	Indicator	API-3	07-May-13	Charcoal Cartridge	Iodine-131	-3.99E-03	pCi/m3	1.65E-02	0.07	U
Air Monitoring	Control	API-4	07-May-13	Charcoal Cartridge	Iodine-131	5.98E-03	pCi/m3	1.85E-02	0.07	U
Air Monitoring	Indicator	API-5	07-May-13	Charcoal Cartridge	Iodine-131	3.88E-03	pCi/m3	1.57E-02	0.07	U
Air Monitoring	Indicator	API-1	14-May-13	Charcoal Cartridge	Iodine-131	6.60E-03	pCi/m3	2.85E-02	0.07	U
Air Monitoring	Indicator	API-2	14-May-13	Charcoal Cartridge	Iodine-131	-6.44E-03	pCi/m3	2.77E-02	0.07	U
Air Monitoring	Indicator	API-3	14-May-13	Charcoal Cartridge	Iodine-131	6.13E-03	pCi/m3	4.27E-02	0.07	U
Air Monitoring	Control	API-4	14-May-13	Charcoal Cartridge	Iodine-131	3.22E-02	pCi/m3	5.24E-02	0.07	U
Air Monitoring	Indicator	API-5	14-May-13	Charcoal Cartridge				(a)		
Air Monitoring	Indicator	API-1	21-May-13	Charcoal Cartridge	Iodine-131	-6.85E-03	pCi/m3	2.98E-02	0.07	U
Air Monitoring	Indicator	API-2	21-May-13	Charcoal Cartridge	Iodine-131	-7.22E-04	pCi/m3	1.75E-02	0.07	U
Air Monitoring	Indicator	API-3	21-May-13	Charcoal Cartridge	Iodine-131	6.58E-04	pCi/m3	1.77E-02	0.07	U
Air Monitoring	Control	API-4	21-May-13	Charcoal Cartridge	Iodine-131	8.66E-03	pCi/m3	2.23E-02	0.07	U
Air Monitoring	Indicator	API-5	21-May-13	Charcoal Cartridge	Iodine-131	-1.07E-03	pCi/m3	1.04E-02	0.07	U
Air Monitoring	Indicator	API-1	28-May-13	Charcoal Cartridge	Iodine-131	7.84E-03	pCi/m3	2.37E-02	0.07	U
Air Monitoring	Indicator	API-2	28-May-13	Charcoal Cartridge	Iodine-131	1.08E-02	pCi/m3	2.02E-02	0.07	U
Air Monitoring	Indicator	API-3	28-May-13	Charcoal Cartridge	Iodine-131	7.08E-03	pCi/m3	2.74E-02	0.07	U
Air Monitoring	Control	API-4	28-May-13	Charcoal Cartridge	Iodine-131	3.79E-03	pCi/m3	1.75E-02	0.07	U
Air Monitoring	Indicator	API-5	28-May-13	Charcoal Cartridge	Iodine-131	1.71E-03	pCi/m3	2.21E-02	0.07	U
Air Monitoring	Indicator	API-1	04-Jun-13	Charcoal Cartridge	Iodine-131	9.39E-03	pCi/m3	3.75E-02	0.07	U
Air Monitoring	Indicator	API-2	04-Jun-13	Charcoal Cartridge	Iodine-131	-6.01E-03	pCi/m3	2.03E-02	0.07	U
Air Monitoring	Indicator	API-3	04-Jun-13	Charcoal Cartridge	Iodine-131	-5.94E-03	pCi/m3	2.18E-02	0.07	U
Air Monitoring	Control	API-4	04-Jun-13	Charcoal Cartridge	Iodine-131	3.11E-04	pCi/m3	1.62E-02	0.07	U
Air Monitoring	Indicator	API-5	04-Jun-13	Charcoal Cartridge	Iodine-131	2.64E-03	pCi/m3	2.73E-02	0.07	U
Air Monitoring	Indicator	API-1	10-Jun-13	Charcoal Cartridge	Iodine-131	4.25E-03	pCi/m3	3.07E-02	0.07	U
Air Monitoring	Indicator	API-2	10-Jun-13	Charcoal Cartridge	Iodine-131	4.10E-03	pCi/m3	2.32E-02	0.07	U
Air Monitoring	Indicator	API-3	10-Jun-13	Charcoal Cartridge	Iodine-131	-8.73E-03	pCi/m3	2.23E-02	0.07	U
Air Monitoring	Control	API-4	10-Jun-13	Charcoal Cartridge	Iodine-131	-7.34E-03	pCi/m3	2.64E-02	0.07	U
Air Monitoring	Indicator	API-5	10-Jun-13	Charcoal Cartridge	Iodine-131	4.24E-03	pCi/m3	2.97E-02	0.07	U
Air Monitoring	Indicator	API-1	18-Jun-13	Charcoal Cartridge	Iodine-131	-4.29E-03	pCi/m3	1.37E-02	0.07	U
Air Monitoring	Indicator	API-2	18-Jun-13	Charcoal Cartridge	Iodine-131	6.51E-03	pCi/m3	1.92E-02	0.07	U
Air Monitoring	Indicator	API-3	18-Jun-13	Charcoal Cartridge	Iodine-131	1.65E-02	pCi/m3	3.93E-02	0.07	U
Air Monitoring	Control	API-4	18-Jun-13	Charcoal Cartridge	Iodine-131	6.34E-04	pCi/m3	2.26E-02	0.07	U
Air Monitoring	Indicator	API-5	18-Jun-13	Charcoal Cartridge	Iodine-131	1.94E-04	pCi/m3	2.44E-02	0.07	U
Air Monitoring	Indicator	API-1	24-Jun-13	Charcoal Cartridge	Iodine-131	6.51E-03	pCi/m3	2.87E-02	0.07	U
Air Monitoring	Indicator	API-2	24-Jun-13	Charcoal Cartridge	Iodine-131	-1.46E-02	pCi/m3	1.88E-02	0.07	U
Air Monitoring	Indicator	API-3	24-Jun-13	Charcoal Cartridge	Iodine-131	1.62E-03	pCi/m3	1.90E-02	0.07	U
Air Monitoring	Control	API-4	24-Jun-13	Charcoal Cartridge	Iodine-131	7.70E-03	pCi/m3	2.59E-02	0.07	U
Air Monitoring	Indicator	API-5	24-Jun-13	Charcoal Cartridge	Iodine-131	5.85E-03	pCi/m3	2.32E-02	0.07	U
Air Monitoring	Indicator	API-1	02-Jul-13	Charcoal Cartridge	Iodine-131	4.29E-03	pCi/m3	1.95E-02	0.07	U
Air Monitoring	Indicator	API-2	02-Jul-13	Charcoal Cartridge	Iodine-131	-5.53E-03	pCi/m3	1.37E-02	0.07	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Indicator	API-3	02-Jul-13	Charcoal Cartridge	Iodine-131	-2.07E-03	pCi/m3	1.52E-02	0.07	U
Air Monitoring	Control	API-4	02-Jul-13	Charcoal Cartridge	Iodine-131	5.89E-05	pCi/m3	2.61E-02	0.07	U
Air Monitoring	Indicator	API-5	02-Jul-13	Charcoal Cartridge	Iodine-131	-2.78E-03	pCi/m3	1.69E-02	0.07	U
Air Monitoring	Indicator	API-1	09-Jul-13	Charcoal Cartridge	Iodine-131	2.22E-03	pCi/m3	5.78E-02	0.07	U
Air Monitoring	Indicator	API-2	09-Jul-13	Charcoal Cartridge	Iodine-131	1.96E-03	pCi/m3	4.28E-02	0.07	U
Air Monitoring	Indicator	API-3	09-Jul-13	Charcoal Cartridge	Iodine-131	-1.17E-02	pCi/m3	3.49E-02	0.07	U
Air Monitoring	Control	API-4	09-Jul-13	Charcoal Cartridge	Iodine-131	1.16E-02	pCi/m3	3.67E-02	0.07	U
Air Monitoring	Indicator	API-5	09-Jul-13	Charcoal Cartridge	Iodine-131	1.23E-02	pCi/m3	5.82E-02	0.07	U
Air Monitoring	Indicator	API-1	16-Jul-13	Charcoal Cartridge	Iodine-131	1.57E-03	pCi/m3	4.68E-02	0.07	U
Air Monitoring	Indicator	API-2	16-Jul-13	Charcoal Cartridge	Iodine-131	5.46E-03	pCi/m3	4.03E-02	0.07	U
Air Monitoring	Indicator	API-3	16-Jul-13	Charcoal Cartridge	Iodine-131	-2.16E-02	pCi/m3	5.13E-02	0.07	U
Air Monitoring	Control	API-4	16-Jul-13	Charcoal Cartridge	Iodine-131	-6.23E-03	pCi/m3	6.91E-02	0.07	U
Air Monitoring	Indicator	API-5	16-Jul-13	Charcoal Cartridge	Iodine-131	4.05E-03	pCi/m3	6.28E-02	0.07	U
Air Monitoring	Indicator	API-1	23-Jul-13	Charcoal Cartridge	Iodine-131	2.37E-02	pCi/m3	4.10E-02	0.07	U
Air Monitoring	Indicator	API-2	23-Jul-13	Charcoal Cartridge	Iodine-131	-5.64E-03	pCi/m3	2.95E-02	0.07	U
Air Monitoring	Indicator	API-3	23-Jul-13	Charcoal Cartridge	Iodine-131	-4.53E-03	pCi/m3	3.47E-02	0.07	U
Air Monitoring	Control	API-4	23-Jul-13	Charcoal Cartridge	Iodine-131	3.37E-04	pCi/m3	4.12E-02	0.07	U
Air Monitoring	Indicator	API-5	23-Jul-13	Charcoal Cartridge	Iodine-131	1.61E-02	pCi/m3	3.73E-02	0.07	U
Air Monitoring	Indicator	API-1	30-Jul-13	Charcoal Cartridge	Iodine-131	-2.81E-03	pCi/m3	2.69E-02	0.07	U
Air Monitoring	Indicator	API-2	30-Jul-13	Charcoal Cartridge	Iodine-131	-2.83E-03	pCi/m3	2.03E-02	0.07	U
Air Monitoring	Indicator	API-3	30-Jul-13	Charcoal Cartridge	Iodine-131	8.94E-03	pCi/m3	3.46E-02	0.07	U
Air Monitoring	Control	API-4	30-Jul-13	Charcoal Cartridge	Iodine-131	1.59E-02	pCi/m3	5.07E-02	0.07	U
Air Monitoring	Indicator	API-5	30-Jul-13	Charcoal Cartridge	Iodine-131	-1.89E-02	pCi/m3	1.48E-02	0.07	U
Air Monitoring	Indicator	API-1	06-Aug-13	Charcoal Cartridge	Iodine-131	-1.52E-03	pCi/m3	2.17E-02	0.07	U
Air Monitoring	Indicator	API-2	06-Aug-13	Charcoal Cartridge	Iodine-131	-9.19E-04	pCi/m3	1.68E-02	0.07	U
Air Monitoring	Indicator	API-3	06-Aug-13	Charcoal Cartridge	Iodine-131	-1.62E-02	pCi/m3	8.22E-03	0.07	U
Air Monitoring	Control	API-4	06-Aug-13	Charcoal Cartridge	Iodine-131	-1.49E-03	pCi/m3	2.01E-02	0.07	U
Air Monitoring	Indicator	API-5	06-Aug-13	Charcoal Cartridge	Iodine-131	-3.21E-03	pCi/m3	2.04E-02	0.07	U
Air Monitoring	Indicator	API-1	13-Aug-13	Charcoal Cartridge	Iodine-131	-4.25E-04	pCi/m3	2.24E-02	0.07	U
Air Monitoring	Indicator	API-2	13-Aug-13	Charcoal Cartridge	Iodine-131	9.06E-03	pCi/m3	3.55E-02	0.07	U
Air Monitoring	Indicator	API-3	13-Aug-13	Charcoal Cartridge	Iodine-131	3.24E-03	pCi/m3	1.78E-02	0.07	U
Air Monitoring	Control	API-4	13-Aug-13	Charcoal Cartridge	Iodine-131	7.89E-03	pCi/m3	2.09E-02	0.07	U
Air Monitoring	Indicator	API-5	13-Aug-13	Charcoal Cartridge	Iodine-131	-1.14E-02	pCi/m3	1.86E-02	0.07	U
Air Monitoring	Indicator	API-1	19-Aug-13	Charcoal Cartridge	Iodine-131	1.17E-02	pCi/m3	3.70E-02	0.07	U
Air Monitoring	Indicator	API-2	19-Aug-13	Charcoal Cartridge	Iodine-131	-1.21E-02	pCi/m3	2.62E-02	0.07	U
Air Monitoring	Indicator	API-3	19-Aug-13	Charcoal Cartridge	Iodine-131	3.33E-02	pCi/m3	6.96E-02	0.07	U
Air Monitoring	Control	API-4	19-Aug-13	Charcoal Cartridge	Iodine-131	-1.23E-02	pCi/m3	2.99E-02	0.07	U
Air Monitoring	Indicator	API-5	19-Aug-13	Charcoal Cartridge	Iodine-131	7.24E-03	pCi/m3	2.68E-02	0.07	U
Air Monitoring	Indicator	API-1	27-Aug-13	Charcoal Cartridge	Iodine-131	1.58E-02	pCi/m3	2.15E-02	0.07	U
Air Monitoring	Indicator	API-2	27-Aug-13	Charcoal Cartridge	Iodine-131	-7.41E-03	pCi/m3	1.73E-02	0.07	U
Air Monitoring	Indicator	API-3	27-Aug-13	Charcoal Cartridge	Iodine-131	-1.18E-02	pCi/m3	1.16E-02	0.07	U
Air Monitoring	Control	API-4	27-Aug-13	Charcoal Cartridge	Iodine-131	-1.53E-04	pCi/m3	2.00E-02	0.07	U
Air Monitoring	Indicator	API-5	27-Aug-13	Charcoal Cartridge	Iodine-131	1.06E-02	pCi/m3	3.14E-02	0.07	U
Air Monitoring	Indicator	API-1	03-Sep-13	Charcoal Cartridge	Iodine-131	-3.35E-03	pCi/m3	2.23E-02	0.07	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Indicator	API-2	03-Sep-13	Charcoal Cartridge	Iodine-131	1.12E-02	pCi/m3	4.48E-02	0.07	U
Air Monitoring	Indicator	API-3	03-Sep-13	Charcoal Cartridge	Iodine-131	-9.86E-03	pCi/m3	2.08E-02	0.07	U
Air Monitoring	Control	API-4	03-Sep-13	Charcoal Cartridge	Iodine-131	-1.54E-02	pCi/m3	3.22E-02	0.07	U
Air Monitoring	Indicator	API-5	03-Sep-13	Charcoal Cartridge	Iodine-131	3.23E-03	pCi/m3	2.50E-02	0.07	U
Air Monitoring	Indicator	API-1	10-Sep-13	Charcoal Cartridge	Iodine-131	-7.09E-03	pCi/m3	1.90E-02	0.07	U
Air Monitoring	Indicator	API-2	10-Sep-13	Charcoal Cartridge	Iodine-131	3.94E-03	pCi/m3	3.05E-02	0.07	U
Air Monitoring	Indicator	API-3	10-Sep-13	Charcoal Cartridge	Iodine-131	-4.78E-03	pCi/m3	1.87E-02	0.07	U
Air Monitoring	Control	API-4	10-Sep-13	Charcoal Cartridge	Iodine-131	-5.69E-03	pCi/m3	1.59E-02	0.07	U
Air Monitoring	Indicator	API-5	10-Sep-13	Charcoal Cartridge	Iodine-131	1.28E-02	pCi/m3	2.56E-02	0.07	U
Air Monitoring	Indicator	API-1	17-Sep-13	Charcoal Cartridge	Iodine-131	2.73E-03	pCi/m3	5.32E-02	0.07	U
Air Monitoring	Indicator	API-2	17-Sep-13	Charcoal Cartridge	Iodine-131	-1.92E-02	pCi/m3	1.20E-02	0.07	U
Air Monitoring	Indicator	API-3	17-Sep-13	Charcoal Cartridge	Iodine-131	1.60E-03	pCi/m3	2.04E-02	0.07	U
Air Monitoring	Control	API-4	17-Sep-13	Charcoal Cartridge	Iodine-131	-2.77E-03	pCi/m3	2.50E-02	0.07	U
Air Monitoring	Indicator	API-5	17-Sep-13	Charcoal Cartridge	Iodine-131	3.26E-03	pCi/m3	2.85E-02	0.07	U
Air Monitoring	Indicator	API-1	24-Sep-13	Charcoal Cartridge	Iodine-131	9.56E-03	pCi/m3	1.79E-02	0.07	U
Air Monitoring	Indicator	API-2	24-Sep-13	Charcoal Cartridge	Iodine-131	-1.02E-03	pCi/m3	1.49E-02	0.07	U
Air Monitoring	Indicator	API-3	24-Sep-13	Charcoal Cartridge	Iodine-131	3.05E-03	pCi/m3	2.56E-02	0.07	U
Air Monitoring	Control	API-4	24-Sep-13	Charcoal Cartridge	Iodine-131	3.27E-03	pCi/m3	1.52E-02	0.07	U
Air Monitoring	Indicator	API-5	24-Sep-13	Charcoal Cartridge	Iodine-131	-3.26E-03	pCi/m3	1.33E-02	0.07	U
Air Monitoring	Indicator	API-1	01-Oct-13	Charcoal Cartridge	Iodine-131	-3.54E-03	pCi/m3	1.80E-02	0.07	U
Air Monitoring	Indicator	API-2	01-Oct-13	Charcoal Cartridge	Iodine-131	-7.92E-03	pCi/m3	1.82E-02	0.07	U
Air Monitoring	Indicator	API-3	01-Oct-13	Charcoal Cartridge	Iodine-131	2.62E-02	pCi/m3	5.35E-02	0.07	U
Air Monitoring	Control	API-4	01-Oct-13	Charcoal Cartridge	Iodine-131	-1.27E-03	pCi/m3	3.14E-02	0.07	U
Air Monitoring	Indicator	API-5	01-Oct-13	Charcoal Cartridge	Iodine-131	9.78E-03	pCi/m3	2.49E-02	0.07	U
Air Monitoring	Indicator	API-1	08-Oct-13	Charcoal Cartridge	Iodine-131	-5.28E-03	pCi/m3	2.23E-02	0.07	U
Air Monitoring	Indicator	API-2	08-Oct-13	Charcoal Cartridge	Iodine-131	2.39E-03	pCi/m3	2.09E-02	0.07	U
Air Monitoring	Indicator	API-3	08-Oct-13	Charcoal Cartridge	Iodine-131	-2.42E-03	pCi/m3	2.80E-02	0.07	U
Air Monitoring	Control	API-4	08-Oct-13	Charcoal Cartridge	Iodine-131	-5.29E-03	pCi/m3	1.93E-02	0.07	U
Air Monitoring	Indicator	API-5	08-Oct-13	Charcoal Cartridge	Iodine-131	-1.75E-03	pCi/m3	2.22E-02	0.07	U
Air Monitoring	Indicator	API-1	14-Oct-13	Charcoal Cartridge	Iodine-131	2.01E-03	pCi/m3	4.33E-02	0.07	U
Air Monitoring	Indicator	API-2	14-Oct-13	Charcoal Cartridge	Iodine-131	4.94E-03	pCi/m3	3.10E-02	0.07	U
Air Monitoring	Indicator	API-3	14-Oct-13	Charcoal Cartridge	Iodine-131	-1.50E-02	pCi/m3	1.82E-02	0.07	U
Air Monitoring	Control	API-4	14-Oct-13	Charcoal Cartridge	Iodine-131	-4.93E-03	pCi/m3	4.47E-02	0.07	U
Air Monitoring	Indicator	API-5	14-Oct-13	Charcoal Cartridge	Iodine-131	9.78E-03	pCi/m3	3.40E-02	0.07	U
Air Monitoring	Indicator	API-1	22-Oct-13	Charcoal Cartridge	Iodine-131	3.81E-04	pCi/m3	1.37E-02	0.07	U
Air Monitoring	Indicator	API-2	22-Oct-13	Charcoal Cartridge	Iodine-131	-1.06E-02	pCi/m3	1.82E-02	0.07	U
Air Monitoring	Indicator	API-3	22-Oct-13	Charcoal Cartridge	Iodine-131	4.74E-03	pCi/m3	2.75E-02	0.07	U
Air Monitoring	Control	API-4	22-Oct-13	Charcoal Cartridge	Iodine-131	-2.66E-03	pCi/m3	1.52E-02	0.07	U
Air Monitoring	Indicator	API-5	22-Oct-13	Charcoal Cartridge	Iodine-131	-2.73E-04	pCi/m3	1.73E-02	0.07	U
Air Monitoring	Indicator	API-1	29-Oct-13	Charcoal Cartridge	Iodine-131	4.73E-03	pCi/m3	1.44E-02	0.07	U
Air Monitoring	Indicator	API-2	29-Oct-13	Charcoal Cartridge	Iodine-131	4.57E-03	pCi/m3	1.51E-02	0.07	U
Air Monitoring	Indicator	API-3	29-Oct-13	Charcoal Cartridge	Iodine-131	-6.09E-03	pCi/m3	1.91E-02	0.07	U
Air Monitoring	Control	API-4	29-Oct-13	Charcoal Cartridge	Iodine-131	2.15E-03	pCi/m3	3.05E-02	0.07	U
Air Monitoring	Indicator	API-5	29-Oct-13	Charcoal Cartridge	Iodine-131	1.07E-02	pCi/m3	2.99E-02	0.07	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Indicator	API-1	05-Nov-13	Charcoal Cartridge	Iodine-131	-7.22E-04	pCi/m3	1.01E-02	0.07	U
Air Monitoring	Indicator	API-2	05-Nov-13	Charcoal Cartridge	Iodine-131	-3.81E-03	pCi/m3	1.71E-02	0.07	U
Air Monitoring	Indicator	API-3	05-Nov-13	Charcoal Cartridge	Iodine-131	-6.87E-03	pCi/m3	2.18E-02	0.07	U
Air Monitoring	Control	API-4	05-Nov-13	Charcoal Cartridge	Iodine-131	-4.95E-03	pCi/m3	1.22E-02	0.07	U
Air Monitoring	Indicator	API-5	05-Nov-13	Charcoal Cartridge	Iodine-131	-1.97E-03	pCi/m3	1.64E-02	0.07	U
Air Monitoring	Indicator	API-1	12-Nov-13	Charcoal Cartridge	Iodine-131	3.67E-03	pCi/m3	1.52E-02	0.07	U
Air Monitoring	Indicator	API-2	12-Nov-13	Charcoal Cartridge	Iodine-131	9.78E-03	pCi/m3	2.50E-02	0.07	U
Air Monitoring	Indicator	API-3	12-Nov-13	Charcoal Cartridge	Iodine-131	7.80E-03	pCi/m3	2.59E-02	0.07	U
Air Monitoring	Control	API-4	12-Nov-13	Charcoal Cartridge	Iodine-131	-2.41E-03	pCi/m3	2.37E-02	0.07	U
Air Monitoring	Indicator	API-5	12-Nov-13	Charcoal Cartridge	Iodine-131	5.75E-03	pCi/m3	2.40E-02	0.07	U
Air Monitoring	Indicator	API-1	19-Nov-13	Charcoal Cartridge	Iodine-131	1.16E-02	pCi/m3	1.16E-02	0.07	UI
Air Monitoring	Indicator	API-2	19-Nov-13	Charcoal Cartridge	Iodine-131	-5.13E-03	pCi/m3	1.92E-02	0.07	U
Air Monitoring	Indicator	API-3	19-Nov-13	Charcoal Cartridge	Iodine-131	4.51E-03	pCi/m3	2.47E-02	0.07	U
Air Monitoring	Control	API-4	19-Nov-13	Charcoal Cartridge	Iodine-131	1.62E-03	pCi/m3	1.81E-02	0.07	U
Air Monitoring	Indicator	API-5	19-Nov-13	Charcoal Cartridge	Iodine-131	-1.16E-03	pCi/m3	1.77E-02	0.07	U
Air Monitoring	Indicator	API-1	26-Nov-13	Charcoal Cartridge	Iodine-131	1.78E-02	pCi/m3	1.78E-02	0.07	UI
Air Monitoring	Indicator	API-2	26-Nov-13	Charcoal Cartridge	Iodine-131	-4.12E-03	pCi/m3	1.13E-02	0.07	U
Air Monitoring	Indicator	API-3	26-Nov-13	Charcoal Cartridge	Iodine-131	5.98E-03	pCi/m3	2.13E-02	0.07	U
Air Monitoring	Control	API-4	26-Nov-13	Charcoal Cartridge	Iodine-131	8.91E-03	pCi/m3	2.60E-02	0.07	U
Air Monitoring	Indicator	API-5	26-Nov-13	Charcoal Cartridge	Iodine-131	7.88E-03	pCi/m3	2.75E-02	0.07	U
Air Monitoring	Indicator	API-1	03-Dec-13	Charcoal Cartridge	Iodine-131	1.05E-04	pCi/m3	2.34E-02	0.07	U
Air Monitoring	Indicator	API-2	03-Dec-13	Charcoal Cartridge	Iodine-131	1.91E-03	pCi/m3	1.97E-02	0.07	U
Air Monitoring	Indicator	API-3	03-Dec-13	Charcoal Cartridge	Iodine-131	6.51E-03	pCi/m3	3.14E-02	0.07	U
Air Monitoring	Control	API-4	03-Dec-13	Charcoal Cartridge	Iodine-131	-6.82E-03	pCi/m3	1.92E-02	0.07	U
Air Monitoring	Indicator	API-5	03-Dec-13	Charcoal Cartridge	Iodine-131	-7.71E-03	pCi/m3	1.80E-02	0.07	U
Air Monitoring	Indicator	API-1	10-Dec-13	Charcoal Cartridge	Iodine-131	2.45E-03	pCi/m3	3.01E-02	0.07	U
Air Monitoring	Indicator	API-2	10-Dec-13	Charcoal Cartridge	Iodine-131	3.48E-03	pCi/m3	2.49E-02	0.07	U
Air Monitoring	Indicator	API-3	10-Dec-13	Charcoal Cartridge	Iodine-131	-5.21E-03	pCi/m3	2.34E-02	0.07	U
Air Monitoring	Control	API-4	10-Dec-13	Charcoal Cartridge	Iodine-131	-1.63E-02	pCi/m3	2.43E-02	0.07	U
Air Monitoring	Indicator	API-5	10-Dec-13	Charcoal Cartridge	Iodine-131	8.22E-03	pCi/m3	4.75E-02	0.07	U
Air Monitoring	Indicator	API-1	17-Dec-13	Charcoal Cartridge	Iodine-131	-7.01E-03	pCi/m3	2.29E-02	0.07	U
Air Monitoring	Indicator	API-2	17-Dec-13	Charcoal Cartridge	Iodine-131	-3.84E-03	pCi/m3	2.06E-02	0.07	U
Air Monitoring	Indicator	API-3	17-Dec-13	Charcoal Cartridge	Iodine-131	-1.15E-02	pCi/m3	2.18E-02	0.07	U
Air Monitoring	Control	API-4	17-Dec-13	Charcoal Cartridge	Iodine-131	-9.71E-03	pCi/m3	1.82E-02	0.07	U
Air Monitoring	Indicator	API-5	17-Dec-13	Charcoal Cartridge	Iodine-131	1.99E-02	pCi/m3	3.91E-02	0.07	U
Air Monitoring	Indicator	API-1	23-Dec-13	Charcoal Cartridge	Iodine-131	4.25E-03	pCi/m3	2.39E-02	0.07	U
Air Monitoring	Indicator	API-2	23-Dec-13	Charcoal Cartridge	Iodine-131	-6.05E-03	pCi/m3	1.63E-02	0.07	U
Air Monitoring	Indicator	API-3	23-Dec-13	Charcoal Cartridge	Iodine-131	-3.23E-03	pCi/m3	1.69E-02	0.07	U
Air Monitoring	Control	API-4	23-Dec-13	Charcoal Cartridge	Iodine-131	1.28E-02	pCi/m3	3.23E-02	0.07	U
Air Monitoring	Indicator	API-5	23-Dec-13	Charcoal Cartridge	Iodine-131	1.37E-04	pCi/m3	2.53E-02	0.07	U
Air Monitoring	Indicator	API-1	02-Jan-13	Particulate Filter	BETA	6.49E-02	pCi/m3	2.66E-03	0.01	
Air Monitoring	Indicator	API-2	02-Jan-13	Particulate Filter	BETA	6.51E-02	pCi/m3	2.55E-03	0.01	
Air Monitoring	Indicator	API-3	02-Jan-13	Particulate Filter	BETA	6.38E-02	pCi/m3	2.62E-03	0.01	
Air Monitoring	Control	API-4	02-Jan-13	Particulate Filter	BETA	5.97E-02	pCi/m3	2.59E-03	0.01	

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Indicator	API-5	02-Jan-13	Particulate Filter	BETA	6.17E-02	pCi/m3	2.68E-03	0.01	
Air Monitoring	Indicator	API-1	09-Jan-13	Particulate Filter	BETA	8.66E-02	pCi/m3	2.27E-03	0.01	
Air Monitoring	Indicator	API-2	09-Jan-13	Particulate Filter	BETA	9.94E-02	pCi/m3	2.33E-03	0.01	
Air Monitoring	Indicator	API-3	09-Jan-13	Particulate Filter	BETA	1.14E-01	pCi/m3	2.27E-03	0.01	
Air Monitoring	Control	API-4	09-Jan-13	Particulate Filter	BETA	8.27E-02	pCi/m3	2.28E-03	0.01	
Air Monitoring	Indicator	API-5	09-Jan-13	Particulate Filter	BETA	1.03E-01	pCi/m3	2.27E-03	0.01	
Air Monitoring	Indicator	API-1	15-Jan-13	Particulate Filter	BETA	4.70E-02	pCi/m3	2.66E-03	0.01	
Air Monitoring	Indicator	API-2	15-Jan-13	Particulate Filter	BETA	5.43E-02	pCi/m3	2.58E-03	0.01	
Air Monitoring	Indicator	API-3	15-Jan-13	Particulate Filter	BETA	5.19E-02	pCi/m3	2.58E-03	0.01	
Air Monitoring	Control	API-4	15-Jan-13	Particulate Filter	BETA	4.65E-02	pCi/m3	2.65E-03	0.01	
Air Monitoring	Indicator	API-5	15-Jan-13	Particulate Filter	BETA	4.93E-02	pCi/m3	2.66E-03	0.01	
Air Monitoring	Indicator	API-1	22-Jan-13	Particulate Filter	BETA	3.86E-02	pCi/m3	2.42E-03	0.01	
Air Monitoring	Indicator	API-2	22-Jan-13	Particulate Filter	BETA	4.13E-02	pCi/m3	2.50E-03	0.01	
Air Monitoring	Indicator	API-3	22-Jan-13	Particulate Filter	BETA	4.32E-02	pCi/m3	2.50E-03	0.01	
Air Monitoring	Control	API-4	22-Jan-13	Particulate Filter	BETA	3.60E-02	pCi/m3	2.52E-03	0.01	
Air Monitoring	Indicator	API-5	22-Jan-13	Particulate Filter	BETA	3.96E-02	pCi/m3	2.44E-03	0.01	
Air Monitoring	Indicator	API-1	28-Jan-13	Particulate Filter	BETA	3.93E-02	pCi/m3	2.85E-03	0.01	
Air Monitoring	Indicator	API-2	28-Jan-13	Particulate Filter	BETA	5.36E-02	pCi/m3	2.90E-03	0.01	
Air Monitoring	Indicator	API-3	28-Jan-13	Particulate Filter	BETA	4.89E-02	pCi/m3	2.90E-03	0.01	
Air Monitoring	Control	API-4	28-Jan-13	Particulate Filter	BETA	5.01E-02	pCi/m3	2.74E-03	0.01	
Air Monitoring	Indicator	API-5	28-Jan-13	Particulate Filter	BETA	5.97E-02	pCi/m3	2.85E-03	0.01	
Air Monitoring	Indicator	API-1	05-Feb-13	Particulate Filter	BETA	4.79E-02	pCi/m3	2.02E-03	0.01	
Air Monitoring	Indicator	API-2	05-Feb-13	Particulate Filter	BETA	6.17E-02	pCi/m3	2.03E-03	0.01	
Air Monitoring	Indicator	API-3	05-Feb-13	Particulate Filter	BETA	5.64E-02	pCi/m3	2.03E-03	0.01	
Air Monitoring	Control	API-4	05-Feb-13	Particulate Filter	BETA	4.96E-02	pCi/m3	2.03E-03	0.01	
Air Monitoring	Indicator	API-5	05-Feb-13	Particulate Filter	BETA	5.81E-02	pCi/m3	2.02E-03	0.01	
Air Monitoring	Indicator	API-1	12-Feb-13	Particulate Filter	BETA	4.27E-02	pCi/m3	2.40E-03	0.01	
Air Monitoring	Indicator	API-2	12-Feb-13	Particulate Filter	BETA	4.55E-02	pCi/m3	2.39E-03	0.01	
Air Monitoring	Indicator	API-3	12-Feb-13	Particulate Filter	BETA	5.00E-02	pCi/m3	2.39E-03	0.01	
Air Monitoring	Control	API-4	12-Feb-13	Particulate Filter	BETA	4.08E-02	pCi/m3	2.38E-03	0.01	
Air Monitoring	Indicator	API-5	12-Feb-13	Particulate Filter	BETA	5.88E-02	pCi/m3	2.40E-03	0.01	
Air Monitoring	Indicator	API-1	19-Feb-13	Particulate Filter	BETA	4.02E-02	pCi/m3	2.38E-03	0.01	
Air Monitoring	Indicator	API-2	19-Feb-13	Particulate Filter	BETA	3.97E-02	pCi/m3	2.38E-03	0.01	
Air Monitoring	Indicator	API-3	19-Feb-13	Particulate Filter	BETA	3.52E-02	pCi/m3	2.38E-03	0.01	
Air Monitoring	Control	API-4	19-Feb-13	Particulate Filter	BETA	3.64E-02	pCi/m3	2.40E-03	0.01	
Air Monitoring	Indicator	API-5	19-Feb-13	Particulate Filter	BETA	3.97E-02	pCi/m3	2.38E-03	0.01	
Air Monitoring	Indicator	API-1	25-Feb-13	Particulate Filter	BETA	4.64E-02	pCi/m3	2.81E-03	0.01	
Air Monitoring	Indicator	API-2	25-Feb-13	Particulate Filter	BETA	3.48E-02	pCi/m3	2.84E-03	0.01	
Air Monitoring	Indicator	API-3	25-Feb-13	Particulate Filter	BETA	3.81E-02	pCi/m3	2.83E-03	0.01	
Air Monitoring	Control	API-4	25-Feb-13	Particulate Filter	BETA	3.41E-02	pCi/m3	2.82E-03	0.01	
Air Monitoring	Indicator	API-5	25-Feb-13	Particulate Filter	BETA	3.78E-02	pCi/m3	2.83E-03	0.01	
Air Monitoring	Indicator	API-1	05-Mar-13	Particulate Filter	BETA	1.85E-02	pCi/m3	2.06E-03	0.01	
Air Monitoring	Indicator	API-2	05-Mar-13	Particulate Filter	BETA	3.31E-02	pCi/m3	2.05E-03	0.01	
Air Monitoring	Indicator	API-3	05-Mar-13	Particulate Filter	BETA	2.49E-02	pCi/m3	2.05E-03	0.01	

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Control	API-4	05-Mar-13	Particulate Filter	BETA	3.10E-02	pCi/m3	2.05E-03	0.01	
Air Monitoring	Indicator	API-5	05-Mar-13	Particulate Filter	BETA	3.26E-02	pCi/m3	2.07E-03	0.01	
Air Monitoring	Indicator	API-1	12-Mar-13	Particulate Filter	BETA	2.74E-02	pCi/m3	2.62E-03	0.01	
Air Monitoring	Indicator	API-2	12-Mar-13	Particulate Filter	BETA	3.46E-02	pCi/m3	2.64E-03	0.01	
Air Monitoring	Indicator	API-3	12-Mar-13	Particulate Filter	BETA	3.09E-02	pCi/m3	2.64E-03	0.01	
Air Monitoring	Control	API-4	12-Mar-13	Particulate Filter	BETA	3.98E-02	pCi/m3	2.62E-03	0.01	
Air Monitoring	Indicator	API-5	12-Mar-13	Particulate Filter	BETA	3.42E-02	pCi/m3	2.61E-03	0.01	
Air Monitoring	Indicator	API-1	19-Mar-13	Particulate Filter	BETA	4.48E-02	pCi/m3	2.59E-03	0.01	
Air Monitoring	Indicator	API-2	19-Mar-13	Particulate Filter	BETA	4.51E-02	pCi/m3	2.59E-03	0.01	
Air Monitoring	Indicator	API-3	19-Mar-13	Particulate Filter	BETA	5.67E-02	pCi/m3	2.59E-03	0.01	
Air Monitoring	Control	API-4	19-Mar-13	Particulate Filter	BETA	4.95E-02	pCi/m3	2.60E-03	0.01	
Air Monitoring	Indicator	API-5	19-Mar-13	Particulate Filter	BETA	4.75E-02	pCi/m3	2.60E-03	0.01	
Air Monitoring	Indicator	API-1	26-Mar-13	Particulate Filter	BETA	3.54E-02	pCi/m3	2.55E-03	0.01	
Air Monitoring	Indicator	API-2	26-Mar-13	Particulate Filter	BETA	5.18E-02	pCi/m3	2.55E-03	0.01	
Air Monitoring	Indicator	API-3	26-Mar-13	Particulate Filter	BETA	3.66E-02	pCi/m3	2.55E-03	0.01	
Air Monitoring	Control	API-4	26-Mar-13	Particulate Filter	BETA	3.72E-02	pCi/m3	2.55E-03	0.01	
Air Monitoring	Indicator	API-5	26-Mar-13	Particulate Filter	BETA	2.98E-02	pCi/m3	2.54E-03	0.01	
Air Monitoring	Indicator	API-1	02-Apr-13	Particulate Filter	BETA	2.98E-02	pCi/m3	2.55E-03	0.01	
Air Monitoring	Indicator	API-2	02-Apr-13	Particulate Filter	BETA	4.19E-02	pCi/m3	2.55E-03	0.01	
Air Monitoring	Indicator	API-3	02-Apr-13	Particulate Filter	BETA	3.33E-02	pCi/m3	2.55E-03	0.01	
Air Monitoring	Control	API-4	02-Apr-13	Particulate Filter	BETA	3.57E-02	pCi/m3	2.57E-03	0.01	
Air Monitoring	Indicator	API-5	02-Apr-13	Particulate Filter	BETA	3.72E-02	pCi/m3	2.56E-03	0.01	
Air Monitoring	Indicator	API-1	09-Apr-13	Particulate Filter	BETA	3.93E-02	pCi/m3	2.37E-03	0.01	
Air Monitoring	Indicator	API-2	09-Apr-13	Particulate Filter	BETA	6.62E-02	pCi/m3	2.37E-03	0.01	
Air Monitoring	Indicator	API-3	09-Apr-13	Particulate Filter	BETA	4.95E-02	pCi/m3	2.37E-03	0.01	
Air Monitoring	Control	API-4	09-Apr-13	Particulate Filter	BETA	6.30E-02	pCi/m3	2.37E-03	0.01	
Air Monitoring	Indicator	API-5	09-Apr-13	Particulate Filter	BETA	4.33E-02	pCi/m3	2.37E-03	0.01	
Air Monitoring	Indicator	API-1	16-Apr-13	Particulate Filter	BETA	2.32E-02	pCi/m3	2.41E-03	0.01	
Air Monitoring	Indicator	API-2	16-Apr-13	Particulate Filter	BETA	3.22E-02	pCi/m3	2.41E-03	0.01	
Air Monitoring	Indicator	API-3	16-Apr-13	Particulate Filter	BETA	2.08E-02	pCi/m3	2.41E-03	0.01	
Air Monitoring	Control	API-4	16-Apr-13	Particulate Filter	BETA	2.64E-02	pCi/m3	2.40E-03	0.01	
Air Monitoring	Indicator	API-5	16-Apr-13	Particulate Filter	BETA	2.65E-02	pCi/m3	2.41E-03	0.01	
Air Monitoring	Indicator	API-1	23-Apr-13	Particulate Filter	BETA	3.24E-02	pCi/m3	2.42E-03	0.01	
Air Monitoring	Indicator	API-2	23-Apr-13	Particulate Filter	BETA	3.10E-02	pCi/m3	2.42E-03	0.01	
Air Monitoring	Indicator	API-3	23-Apr-13	Particulate Filter	BETA	2.67E-02	pCi/m3	2.42E-03	0.01	
Air Monitoring	Control	API-4	23-Apr-13	Particulate Filter	BETA	3.46E-02	pCi/m3	2.43E-03	0.01	
Air Monitoring	Indicator	API-5	23-Apr-13	Particulate Filter	BETA	3.59E-02	pCi/m3	2.42E-03	0.01	
Air Monitoring	Indicator	API-1	30-Apr-13	Particulate Filter	BETA	3.44E-02	pCi/m3	2.33E-03	0.01	
Air Monitoring	Indicator	API-2	30-Apr-13	Particulate Filter	BETA	4.32E-02	pCi/m3	2.32E-03	0.01	
Air Monitoring	Indicator	API-3	30-Apr-13	Particulate Filter	BETA	4.09E-02	pCi/m3	2.33E-03	0.01	
Air Monitoring	Control	API-4	30-Apr-13	Particulate Filter	BETA	4.56E-02	pCi/m3	2.33E-03	0.01	
Air Monitoring	Indicator	API-5	30-Apr-13	Particulate Filter	BETA	3.92E-02	pCi/m3	2.33E-03	0.01	
Air Monitoring	Indicator	API-1	07-May-13	Particulate Filter	BETA	3.28E-02	pCi/m3	2.30E-03	0.01	
Air Monitoring	Indicator	API-2	07-May-13	Particulate Filter	BETA	4.17E-02	pCi/m3	2.30E-03	0.01	



Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Indicator	API-3	07-May-13	Particulate Filter	BETA	4.21E-02	pCi/m3	2.30E-03	0.01	
Air Monitoring	Control	API-4	07-May-13	Particulate Filter	BETA	3.47E-02	pCi/m3	2.28E-03	0.01	
Air Monitoring	Indicator	API-5	07-May-13	Particulate Filter	BETA	3.51E-02	pCi/m3	2.31E-03	0.01	
Air Monitoring	Indicator	API-1	14-May-13	Particulate Filter	BETA	2.24E-02	pCi/m3	2.31E-03	0.01	
Air Monitoring	Indicator	API-2	14-May-13	Particulate Filter	BETA	2.69E-02	pCi/m3	2.30E-03	0.01	
Air Monitoring	Indicator	API-3	14-May-13	Particulate Filter	BETA	2.82E-02	pCi/m3	2.31E-03	0.01	
Air Monitoring	Control	API-4	14-May-13	Particulate Filter	BETA	3.16E-02	pCi/m3	2.32E-03	0.01	
Air Monitoring	Indicator	API-5	14-May-13	Particulate Filter				(a)		
Air Monitoring	Indicator	API-1	21-May-13	Particulate Filter	BETA	3.59E-02	pCi/m3	2.39E-03	0.01	
Air Monitoring	Indicator	API-2	21-May-13	Particulate Filter	BETA	4.07E-02	pCi/m3	2.37E-03	0.01	
Air Monitoring	Indicator	API-3	21-May-13	Particulate Filter	BETA	4.25E-02	pCi/m3	2.37E-03	0.01	
Air Monitoring	Control	API-4	21-May-13	Particulate Filter	BETA	4.25E-02	pCi/m3	2.37E-03	0.01	
Air Monitoring	Indicator	API-5	21-May-13	Particulate Filter	BETA	4.46E-02	pCi/m3	2.80E-03	0.01	
Air Monitoring	Indicator	API-1	28-May-13	Particulate Filter	BETA	2.83E-02	pCi/m3	2.51E-03	0.01	
Air Monitoring	Indicator	API-2	28-May-13	Particulate Filter	BETA	2.83E-02	pCi/m3	2.51E-03	0.01	
Air Monitoring	Indicator	API-3	28-May-13	Particulate Filter	BETA	2.16E-02	pCi/m3	2.51E-03	0.01	
Air Monitoring	Control	API-4	28-May-13	Particulate Filter	BETA	2.86E-02	pCi/m3	2.51E-03	0.01	
Air Monitoring	Indicator	API-5	28-May-13	Particulate Filter	BETA	2.95E-02	pCi/m3	2.51E-03	0.01	
Air Monitoring	Indicator	API-1	04-Jun-13	Particulate Filter	BETA	2.78E-02	pCi/m3	2.40E-03	0.01	
Air Monitoring	Indicator	API-2	04-Jun-13	Particulate Filter	BETA	3.38E-02	pCi/m3	2.41E-03	0.01	
Air Monitoring	Indicator	API-3	04-Jun-13	Particulate Filter	BETA	3.45E-02	pCi/m3	2.41E-03	0.01	
Air Monitoring	Control	API-4	04-Jun-13	Particulate Filter	BETA	3.52E-02	pCi/m3	2.41E-03	0.01	
Air Monitoring	Indicator	API-5	04-Jun-13	Particulate Filter	BETA	4.05E-02	pCi/m3	2.41E-03	0.01	
Air Monitoring	Indicator	API-1	10-Jun-13	Particulate Filter	BETA	3.40E-02	pCi/m3	2.91E-03	0.01	
Air Monitoring	Indicator	API-2	10-Jun-13	Particulate Filter	BETA	3.03E-02	pCi/m3	2.90E-03	0.01	
Air Monitoring	Indicator	API-3	10-Jun-13	Particulate Filter	BETA	2.42E-02	pCi/m3	2.90E-03	0.01	
Air Monitoring	Control	API-4	10-Jun-13	Particulate Filter	BETA	3.50E-02	pCi/m3	2.92E-03	0.01	
Air Monitoring	Indicator	API-5	10-Jun-13	Particulate Filter	BETA	2.99E-02	pCi/m3	2.89E-03	0.01	
Air Monitoring	Indicator	API-1	18-Jun-13	Particulate Filter	BETA	2.53E-02	pCi/m3	2.18E-03	0.01	
Air Monitoring	Indicator	API-2	18-Jun-13	Particulate Filter	BETA	4.22E-02	pCi/m3	2.18E-03	0.01	
Air Monitoring	Indicator	API-3	18-Jun-13	Particulate Filter	BETA	3.42E-02	pCi/m3	2.18E-03	0.01	
Air Monitoring	Control	API-4	18-Jun-13	Particulate Filter	BETA	4.07E-02	pCi/m3	2.17E-03	0.01	
Air Monitoring	Indicator	API-5	18-Jun-13	Particulate Filter	BETA	3.78E-02	pCi/m3	2.18E-03	0.01	
Air Monitoring	Indicator	API-1	24-Jun-13	Particulate Filter	BETA	3.77E-02	pCi/m3	3.05E-03	0.01	
Air Monitoring	Indicator	API-2	24-Jun-13	Particulate Filter	BETA	3.33E-02	pCi/m3	3.05E-03	0.01	
Air Monitoring	Indicator	API-3	24-Jun-13	Particulate Filter	BETA	3.61E-02	pCi/m3	3.05E-03	0.01	
Air Monitoring	Control	API-4	24-Jun-13	Particulate Filter	BETA	4.35E-02	pCi/m3	3.05E-03	0.01	
Air Monitoring	Indicator	API-5	24-Jun-13	Particulate Filter	BETA	4.31E-02	pCi/m3	3.05E-03	0.01	
Air Monitoring	Indicator	API-1	02-Jul-13	Particulate Filter	BETA	2.90E-02	pCi/m3	2.23E-03	0.01	
Air Monitoring	Indicator	API-2	02-Jul-13	Particulate Filter	BETA	2.65E-02	pCi/m3	2.23E-03	0.01	
Air Monitoring	Indicator	API-3	02-Jul-13	Particulate Filter	BETA	3.37E-02	pCi/m3	2.23E-03	0.01	
Air Monitoring	Control	API-4	02-Jul-13	Particulate Filter	BETA	2.77E-02	pCi/m3	2.24E-03	0.01	
Air Monitoring	Indicator	API-5	02-Jul-13	Particulate Filter	BETA	3.39E-02	pCi/m3	2.22E-03	0.01	
Air Monitoring	Indicator	API-1	09-Jul-13	Particulate Filter	BETA	2.73E-02	pCi/m3	2.54E-03	0.01	

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Indicator	API-2	09-Jul-13	Particulate Filter	BETA	3.91E-02	pCi/m3	2.54E-03	0.01	
Air Monitoring	Indicator	API-3	09-Jul-13	Particulate Filter	BETA	3.50E-02	pCi/m3	2.54E-03	0.01	
Air Monitoring	Control	API-4	09-Jul-13	Particulate Filter	BETA	4.36E-02	pCi/m3	2.52E-03	0.01	
Air Monitoring	Indicator	API-5	09-Jul-13	Particulate Filter	BETA	3.41E-02	pCi/m3	2.53E-03	0.01	
Air Monitoring	Indicator	API-1	16-Jul-13	Particulate Filter	BETA	2.46E-02	pCi/m3	2.40E-03	0.01	
Air Monitoring	Indicator	API-2	16-Jul-13	Particulate Filter	BETA	3.20E-02	pCi/m3	2.40E-03	0.01	
Air Monitoring	Indicator	API-3	16-Jul-13	Particulate Filter	BETA	3.47E-02	pCi/m3	2.39E-03	0.01	
Air Monitoring	Control	API-4	16-Jul-13	Particulate Filter	BETA	3.58E-02	pCi/m3	2.40E-03	0.01	
Air Monitoring	Indicator	API-5	16-Jul-13	Particulate Filter	BETA	3.92E-02	pCi/m3	2.40E-03	0.01	
Air Monitoring	Indicator	API-1	23-Jul-13	Particulate Filter	BETA	3.26E-02	pCi/m3	2.22E-03	0.01	
Air Monitoring	Indicator	API-2	23-Jul-13	Particulate Filter	BETA	2.35E-02	pCi/m3	2.22E-03	0.01	
Air Monitoring	Indicator	API-3	23-Jul-13	Particulate Filter	BETA	3.49E-02	pCi/m3	2.22E-03	0.01	
Air Monitoring	Control	API-4	23-Jul-13	Particulate Filter	BETA	4.01E-02	pCi/m3	2.21E-03	0.01	
Air Monitoring	Indicator	API-5	23-Jul-13	Particulate Filter	BETA	3.49E-02	pCi/m3	2.21E-03	0.01	
Air Monitoring	Indicator	API-1	30-Jul-13	Particulate Filter	BETA	2.03E-02	pCi/m3	2.59E-03	0.01	
Air Monitoring	Indicator	API-2	30-Jul-13	Particulate Filter	BETA	2.75E-02	pCi/m3	2.59E-03	0.01	
Air Monitoring	Indicator	API-3	30-Jul-13	Particulate Filter	BETA	3.08E-02	pCi/m3	2.59E-03	0.01	
Air Monitoring	Control	API-4	30-Jul-13	Particulate Filter	BETA	2.55E-02	pCi/m3	2.59E-03	0.01	
Air Monitoring	Indicator	API-5	30-Jul-13	Particulate Filter	BETA	2.41E-02	pCi/m3	2.59E-03	0.01	
Air Monitoring	Indicator	API-1	06-Aug-13	Particulate Filter	BETA	3.72E-02	pCi/m3	2.59E-03	0.01	
Air Monitoring	Indicator	API-2	06-Aug-13	Particulate Filter	BETA	3.87E-02	pCi/m3	2.60E-03	0.01	
Air Monitoring	Indicator	API-3	06-Aug-13	Particulate Filter	BETA	3.16E-02	pCi/m3	2.60E-03	0.01	
Air Monitoring	Control	API-4	06-Aug-13	Particulate Filter	BETA	3.35E-02	pCi/m3	2.60E-03	0.01	
Air Monitoring	Indicator	API-5	06-Aug-13	Particulate Filter	BETA	3.17E-02	pCi/m3	2.59E-03	0.01	
Air Monitoring	Indicator	API-1	13-Aug-13	Particulate Filter	BETA	3.22E-02	pCi/m3	2.38E-03	0.01	
Air Monitoring	Indicator	API-2	13-Aug-13	Particulate Filter	BETA	3.48E-02	pCi/m3	2.37E-03	0.01	
Air Monitoring	Indicator	API-3	13-Aug-13	Particulate Filter	BETA	3.03E-02	pCi/m3	2.37E-03	0.01	
Air Monitoring	Control	API-4	13-Aug-13	Particulate Filter	BETA	3.10E-02	pCi/m3	2.39E-03	0.01	
Air Monitoring	Indicator	API-5	13-Aug-13	Particulate Filter	BETA	3.88E-02	pCi/m3	2.38E-03	0.01	
Air Monitoring	Indicator	API-1	19-Aug-13	Particulate Filter	BETA	3.58E-02	pCi/m3	2.64E-03	0.01	
Air Monitoring	Indicator	API-2	19-Aug-13	Particulate Filter	BETA	4.37E-02	pCi/m3	2.65E-03	0.01	
Air Monitoring	Indicator	API-3	19-Aug-13	Particulate Filter	BETA	4.20E-02	pCi/m3	2.65E-03	0.01	
Air Monitoring	Control	API-4	19-Aug-13	Particulate Filter	BETA	3.95E-02	pCi/m3	2.62E-03	0.01	
Air Monitoring	Indicator	API-5	19-Aug-13	Particulate Filter	BETA	4.00E-02	pCi/m3	2.64E-03	0.01	
Air Monitoring	Indicator	API-1	27-Aug-13	Particulate Filter	BETA	4.96E-02	pCi/m3	2.00E-03	0.01	
Air Monitoring	Indicator	API-2	27-Aug-13	Particulate Filter	BETA	6.64E-02	pCi/m3	2.00E-03	0.01	
Air Monitoring	Indicator	API-3	27-Aug-13	Particulate Filter	BETA	6.71E-02	pCi/m3	2.00E-03	0.01	
Air Monitoring	Control	API-4	27-Aug-13	Particulate Filter	BETA	5.52E-02	pCi/m3	2.01E-03	0.01	
Air Monitoring	Indicator	API-5	27-Aug-13	Particulate Filter	BETA	6.64E-02	pCi/m3	2.00E-03	0.01	
Air Monitoring	Indicator	API-1	03-Sep-13	Particulate Filter	BETA	4.01E-02	pCi/m3	2.32E-03	0.01	
Air Monitoring	Indicator	API-2	03-Sep-13	Particulate Filter	BETA	5.47E-02	pCi/m3	2.31E-03	0.01	
Air Monitoring	Indicator	API-3	03-Sep-13	Particulate Filter	BETA	4.28E-02	pCi/m3	2.31E-03	0.01	
Air Monitoring	Control	API-4	03-Sep-13	Particulate Filter	BETA	4.67E-02	pCi/m3	2.31E-03	0.01	
Air Monitoring	Indicator	API-5	03-Sep-13	Particulate Filter	BETA	4.83E-02	pCi/m3	2.32E-03	0.01	

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Indicator	API-1	10-Sep-13	Particulate Filter	BETA	3.76E-02	pCi/m3	2.32E-03	0.01	
Air Monitoring	Indicator	API-2	10-Sep-13	Particulate Filter	BETA	4.82E-02	pCi/m3	2.32E-03	0.01	
Air Monitoring	Indicator	API-3	10-Sep-13	Particulate Filter	BETA	3.67E-02	pCi/m3	2.32E-03	0.01	
Air Monitoring	Control	API-4	10-Sep-13	Particulate Filter	BETA	4.87E-02	pCi/m3	2.31E-03	0.01	
Air Monitoring	Indicator	API-5	10-Sep-13	Particulate Filter	BETA	4.94E-02	pCi/m3	2.32E-03	0.01	
Air Monitoring	Indicator	API-1	17-Sep-13	Particulate Filter	BETA	3.85E-02	pCi/m3	2.36E-03	0.01	
Air Monitoring	Indicator	API-2	17-Sep-13	Particulate Filter	BETA	5.07E-02	pCi/m3	2.36E-03	0.01	
Air Monitoring	Indicator	API-3	17-Sep-13	Particulate Filter	BETA	4.49E-02	pCi/m3	2.35E-03	0.01	
Air Monitoring	Control	API-4	17-Sep-13	Particulate Filter	BETA	3.50E-02	pCi/m3	2.36E-03	0.01	
Air Monitoring	Indicator	API-5	17-Sep-13	Particulate Filter	BETA	5.19E-02	pCi/m3	2.36E-03	0.01	
Air Monitoring	Indicator	API-1	24-Sep-13	Particulate Filter	BETA	3.89E-02	pCi/m3	2.50E-03	0.01	
Air Monitoring	Indicator	API-2	24-Sep-13	Particulate Filter	BETA	3.91E-02	pCi/m3	2.51E-03	0.01	
Air Monitoring	Indicator	API-3	24-Sep-13	Particulate Filter	BETA	3.65E-02	pCi/m3	2.50E-03	0.01	
Air Monitoring	Control	API-4	24-Sep-13	Particulate Filter	BETA	3.61E-02	pCi/m3	2.48E-03	0.01	
Air Monitoring	Indicator	API-5	24-Sep-13	Particulate Filter	BETA	4.48E-02	pCi/m3	2.50E-03	0.01	
Air Monitoring	Indicator	API-1	01-Oct-13	Particulate Filter	BETA	4.03E-02	pCi/m3	2.41E-03	0.01	
Air Monitoring	Indicator	API-2	01-Oct-13	Particulate Filter	BETA	3.63E-02	pCi/m3	2.37E-03	0.01	
Air Monitoring	Indicator	API-3	01-Oct-13	Particulate Filter	BETA	4.12E-02	pCi/m3	2.37E-03	0.01	
Air Monitoring	Control	API-4	01-Oct-13	Particulate Filter	BETA	3.67E-02	pCi/m3	2.44E-03	0.01	
Air Monitoring	Indicator	API-5	01-Oct-13	Particulate Filter	BETA	4.02E-02	pCi/m3	2.39E-03	0.01	
Air Monitoring	Indicator	API-1	08-Oct-13	Particulate Filter	BETA	4.42E-02	pCi/m3	2.54E-03	0.01	
Air Monitoring	Indicator	API-2	08-Oct-13	Particulate Filter	BETA	3.59E-02	pCi/m3	2.54E-03	0.01	
Air Monitoring	Indicator	API-3	08-Oct-13	Particulate Filter	BETA	3.52E-02	pCi/m3	2.54E-03	0.01	
Air Monitoring	Control	API-4	08-Oct-13	Particulate Filter	BETA	3.79E-02	pCi/m3	2.54E-03	0.01	
Air Monitoring	Indicator	API-5	08-Oct-13	Particulate Filter	BETA	4.32E-02	pCi/m3	2.54E-03	0.01	
Air Monitoring	Indicator	API-1	14-Oct-13	Particulate Filter	BETA	4.04E-02	pCi/m3	2.98E-03	0.01	
Air Monitoring	Indicator	API-2	14-Oct-13	Particulate Filter	BETA	3.99E-02	pCi/m3	2.98E-03	0.01	
Air Monitoring	Indicator	API-3	14-Oct-13	Particulate Filter	BETA	3.98E-02	pCi/m3	2.98E-03	0.01	
Air Monitoring	Control	API-4	14-Oct-13	Particulate Filter	BETA	4.56E-02	pCi/m3	2.98E-03	0.01	
Air Monitoring	Indicator	API-5	14-Oct-13	Particulate Filter	BETA	3.90E-02	pCi/m3	2.98E-03	0.01	
Air Monitoring	Indicator	API-1	22-Oct-13	Particulate Filter	BETA	2.94E-02	pCi/m3	1.14E-03	0.01	
Air Monitoring	Indicator	API-2	22-Oct-13	Particulate Filter	BETA	3.17E-02	pCi/m3	1.72E-03	0.01	
Air Monitoring	Indicator	API-3	22-Oct-13	Particulate Filter	BETA	3.95E-02	pCi/m3	1.72E-03	0.01	
Air Monitoring	Control	API-4	22-Oct-13	Particulate Filter	BETA	3.36E-02	pCi/m3	1.68E-03	0.01	
Air Monitoring	Indicator	API-5	22-Oct-13	Particulate Filter	BETA	3.67E-02	pCi/m3	1.68E-03	0.01	
Air Monitoring	Indicator	API-1	29-Oct-13	Particulate Filter	BETA	2.02E-02	pCi/m3	1.37E-03	0.01	
Air Monitoring	Indicator	API-2	29-Oct-13	Particulate Filter	BETA	3.17E-02	pCi/m3	2.06E-03	0.01	
Air Monitoring	Indicator	API-3	29-Oct-13	Particulate Filter	BETA	2.76E-02	pCi/m3	2.06E-03	0.01	
Air Monitoring	Control	API-4	29-Oct-13	Particulate Filter	BETA	1.81E-02	pCi/m3	2.05E-03	0.01	
Air Monitoring	Indicator	API-5	29-Oct-13	Particulate Filter	BETA	2.47E-02	pCi/m3	2.06E-03	0.01	
Air Monitoring	Indicator	API-1	05-Nov-13	Particulate Filter	BETA	3.46E-02	pCi/m3	1.21E-03	0.01	
Air Monitoring	Indicator	API-2	05-Nov-13	Particulate Filter	BETA	4.53E-02	pCi/m3	2.12E-03	0.01	
Air Monitoring	Indicator	API-3	05-Nov-13	Particulate Filter	BETA	6.51E-02	pCi/m3	3.35E-03	0.01	
Air Monitoring	Control	API-4	05-Nov-13	Particulate Filter	BETA	3.24E-02	pCi/m3	2.12E-03	0.01	

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Indicator	API-5	05-Nov-13	Particulate Filter	BETA	4.12E-02	pCi/m3	2.12E-03	0.01	
Air Monitoring	Indicator	API-1	12-Nov-13	Particulate Filter	BETA	3.36E-02	pCi/m3	1.17E-03	0.01	
Air Monitoring	Indicator	API-2	12-Nov-13	Particulate Filter	BETA	3.74E-02	pCi/m3	2.10E-03	0.01	
Air Monitoring	Indicator	API-3	12-Nov-13	Particulate Filter	BETA	3.67E-02	pCi/m3	2.10E-03	0.01	
Air Monitoring	Control	API-4	12-Nov-13	Particulate Filter	BETA	3.84E-02	pCi/m3	2.10E-03	0.01	
Air Monitoring	Indicator	API-5	12-Nov-13	Particulate Filter	BETA	3.55E-02	pCi/m3	2.10E-03	0.01	
Air Monitoring	Indicator	API-1	19-Nov-13	Particulate Filter	BETA	6.37E-02	pCi/m3	2.15E-03	0.01	
Air Monitoring	Indicator	API-2	19-Nov-13	Particulate Filter	BETA	4.27E-02	pCi/m3	2.15E-03	0.01	
Air Monitoring	Indicator	API-3	19-Nov-13	Particulate Filter	BETA	3.62E-02	pCi/m3	2.15E-03	0.01	
Air Monitoring	Control	API-4	19-Nov-13	Particulate Filter	BETA	3.42E-02	pCi/m3	2.16E-03	0.01	
Air Monitoring	Indicator	API-5	19-Nov-13	Particulate Filter	BETA	3.33E-02	pCi/m3	2.20E-03	0.01	
Air Monitoring	Indicator	API-1	26-Nov-13	Particulate Filter	BETA	5.69E-02	pCi/m3	1.99E-03	0.01	
Air Monitoring	Indicator	API-2	26-Nov-13	Particulate Filter	BETA	3.06E-02	pCi/m3	1.99E-03	0.01	
Air Monitoring	Indicator	API-3	26-Nov-13	Particulate Filter	BETA	3.08E-02	pCi/m3	1.98E-03	0.01	
Air Monitoring	Control	API-4	26-Nov-13	Particulate Filter	BETA	3.02E-02	pCi/m3	1.98E-03	0.01	
Air Monitoring	Indicator	API-5	26-Nov-13	Particulate Filter	BETA	2.57E-02	pCi/m3	1.94E-03	0.01	
Air Monitoring	Indicator	API-1	03-Dec-13	Particulate Filter	BETA	5.07E-02	pCi/m3	1.88E-03	0.01	
Air Monitoring	Indicator	API-2	03-Dec-13	Particulate Filter	BETA	5.64E-02	pCi/m3	1.88E-03	0.01	
Air Monitoring	Indicator	API-3	03-Dec-13	Particulate Filter	BETA	4.82E-02	pCi/m3	1.88E-03	0.01	
Air Monitoring	Control	API-4	03-Dec-13	Particulate Filter	BETA	5.58E-02	pCi/m3	1.90E-03	0.01	
Air Monitoring	Indicator	API-5	03-Dec-13	Particulate Filter	BETA	5.31E-02	pCi/m3	1.91E-03	0.01	
Air Monitoring	Indicator	API-1	10-Dec-13	Particulate Filter	BETA	4.63E-02	pCi/m3	1.95E-03	0.01	
Air Monitoring	Indicator	API-2	10-Dec-13	Particulate Filter	BETA	6.14E-02	pCi/m3	1.96E-03	0.01	
Air Monitoring	Indicator	API-3	10-Dec-13	Particulate Filter	BETA	4.82E-02	pCi/m3	1.95E-03	0.01	
Air Monitoring	Control	API-4	10-Dec-13	Particulate Filter	BETA	6.01E-02	pCi/m3	1.93E-03	0.01	
Air Monitoring	Indicator	API-5	10-Dec-13	Particulate Filter	BETA	4.38E-02	pCi/m3	1.93E-03	0.01	
Air Monitoring	Indicator	API-1	17-Dec-13	Particulate Filter	BETA	5.29E-02	pCi/m3	1.93E-03	0.01	
Air Monitoring	Indicator	API-2	17-Dec-13	Particulate Filter	BETA	6.41E-02	pCi/m3	1.94E-03	0.01	
Air Monitoring	Indicator	API-3	17-Dec-13	Particulate Filter	BETA	5.23E-02	pCi/m3	1.94E-03	0.01	
Air Monitoring	Control	API-4	17-Dec-13	Particulate Filter	BETA	5.36E-02	pCi/m3	1.94E-03	0.01	
Air Monitoring	Indicator	API-5	17-Dec-13	Particulate Filter	BETA	5.24E-02	pCi/m3	1.99E-03	0.01	
Air Monitoring	Indicator	API-1	23-Dec-13	Particulate Filter	BETA	3.50E-02	pCi/m3	2.26E-03	0.01	
Air Monitoring	Indicator	API-2	23-Dec-13	Particulate Filter	BETA	4.11E-02	pCi/m3	2.26E-03	0.01	
Air Monitoring	Indicator	API-3	23-Dec-13	Particulate Filter	BETA	4.16E-02	pCi/m3	2.26E-03	0.01	
Air Monitoring	Control	API-4	23-Dec-13	Particulate Filter	BETA	3.41E-02	pCi/m3	2.27E-03	0.01	
Air Monitoring	Indicator	API-5	23-Dec-13	Particulate Filter	BETA	3.09E-02	pCi/m3	2.27E-03	0.01	
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Actinium-228	9.41E-04	pCi/m3	1.39E-03		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Antimony-124	8.19E-04	pCi/m3	2.25E-03		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Antimony-125	-4.66E-04	pCi/m3	1.11E-03		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Barium-140	4.76E-03	pCi/m3	2.15E-02		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Beryllium-7	5.04E-02	pCi/m3	6.81E-03		
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Cerium-141	2.00E-04	pCi/m3	1.15E-03		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Cerium-144	1.88E-04	pCi/m3	2.26E-03		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Cesium-134	1.11E-05	pCi/m3	5.80E-04	0.05	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Cesium-137	1.92E-04	pCi/m3	5.85E-04	0.06	U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Chromium-51	2.43E-03	pCi/m3	1.18E-02		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Cobalt-57	1.86E-05	pCi/m3	2.85E-04		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Cobalt-58	1.17E-04	pCi/m3	8.05E-04		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Cobalt-60	-4.47E-05	pCi/m3	6.61E-04		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Iodine-131	2.06E-03	pCi/m3	2.12E-02		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Iron-59	7.51E-04	pCi/m3	2.50E-03		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Lanthanum-140	-3.43E-03	pCi/m3	6.13E-03		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Manganese-54	1.84E-04	pCi/m3	6.26E-04		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Niobium-95	7.63E-05	pCi/m3	8.13E-04		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Potassium-40	1.08E-02	pCi/m3	3.55E-03		
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Ruthenium-103	-5.65E-04	pCi/m3	7.50E-04		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Ruthenium-106	2.97E-03	pCi/m3	5.04E-03		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Selenium-75	8.46E-05	pCi/m3	7.13E-04		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Silver-108m	-9.93E-05	pCi/m3	3.67E-04		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Silver-110m	1.33E-04	pCi/m3	8.16E-04		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Zinc-65	3.21E-04	pCi/m3	1.46E-03		U
Air Monitoring	Indicator	API-1	09-Feb-13	PF Composite	Zirconium-95	1.62E-03	pCi/m3	1.62E-03		UI
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Actinium-228	5.65E-04	pCi/m3	2.62E-03		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Antimony-124	-9.53E-04	pCi/m3	1.59E-03		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Antimony-125	-1.58E-04	pCi/m3	1.23E-03		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Barium-140	-9.42E-04	pCi/m3	1.92E-02		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Beryllium-7	6.45E-02	pCi/m3	6.99E-03		
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Cerium-141	-1.16E-03	pCi/m3	1.46E-03		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Cerium-144	1.22E-03	pCi/m3	2.73E-03		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Cesium-134	2.49E-04	pCi/m3	5.70E-04	0.05	U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Cesium-137	1.12E-04	pCi/m3	5.08E-04	0.06	U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Chromium-51	-5.47E-03	pCi/m3	1.05E-02		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Cobalt-57	-9.30E-05	pCi/m3	3.37E-04		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Cobalt-58	-3.29E-04	pCi/m3	6.72E-04		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Cobalt-60	3.85E-04	pCi/m3	7.17E-04		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Iodine-131	7.90E-03	pCi/m3	2.10E-02		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Iron-59	-3.70E-04	pCi/m3	1.94E-03		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Lanthanum-140	2.28E-03	pCi/m3	9.89E-03		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Manganese-54	-1.76E-04	pCi/m3	6.01E-04		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Niobium-95	3.35E-04	pCi/m3	9.15E-04		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Potassium-40	5.73E-03	pCi/m3	5.73E-03		UI
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Ruthenium-103	-3.46E-04	pCi/m3	9.63E-04		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Ruthenium-106	-1.20E-03	pCi/m3	5.11E-03		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Selenium-75	6.90E-05	pCi/m3	7.93E-04		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Silver-108m	9.52E-05	pCi/m3	4.26E-04		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Silver-110m	2.36E-04	pCi/m3	9.17E-04		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Zinc-65	3.23E-04	pCi/m3	1.50E-03		U
Air Monitoring	Indicator	API-2	09-Feb-13	PF Composite	Zirconium-95	-1.06E-04	pCi/m3	1.37E-03		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Actinium-228	1.36E-03	pCi/m3	3.59E-03		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Antimony-124	9.15E-04	pCi/m3	3.36E-03		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Antimony-125	-8.12E-04	pCi/m3	1.43E-03		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Barium-140	1.12E-02	pCi/m3	2.19E-02		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Beryllium-7	5.59E-02	pCi/m3	8.75E-03		
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Cerium-141	-1.81E-04	pCi/m3	1.47E-03		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Cerium-144	-6.76E-04	pCi/m3	2.29E-03		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Cesium-134	4.97E-04	pCi/m3	8.66E-04	0.05	U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Cesium-137	-1.64E-05	pCi/m3	6.02E-04	0.06	U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Chromium-51	9.06E-03	pCi/m3	1.34E-02		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Cobalt-57	-7.86E-05	pCi/m3	2.84E-04		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Cobalt-58	-2.07E-04	pCi/m3	7.03E-04		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Cobalt-60	-2.97E-04	pCi/m3	7.50E-04		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Iodine-131	-8.42E-03	pCi/m3	2.42E-02		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Iron-59	7.94E-05	pCi/m3	2.26E-03		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Lanthanum-140	3.21E-03	pCi/m3	1.19E-02		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Manganese-54	4.28E-04	pCi/m3	8.97E-04		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Niobium-95	5.84E-05	pCi/m3	9.70E-04		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Potassium-40	1.80E-02	pCi/m3	7.52E-03		
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Ruthenium-103	4.89E-04	pCi/m3	4.89E-04		UI
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Ruthenium-106	-1.47E-03	pCi/m3	4.71E-03		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Selenium-75	1.50E-04	pCi/m3	8.16E-04		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Silver-108m	-1.44E-04	pCi/m3	4.51E-04		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Silver-110m	4.49E-04	pCi/m3	1.03E-03		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Zinc-65	3.76E-04	pCi/m3	1.55E-03		U
Air Monitoring	Indicator	API-3	09-Feb-13	PF Composite	Zirconium-95	2.76E-04	pCi/m3	1.59E-03		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Actinium-228	-5.40E-04	pCi/m3	2.34E-03		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Antimony-124	-8.03E-04	pCi/m3	1.27E-03		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Antimony-125	8.56E-06	pCi/m3	1.48E-03		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Barium-140	4.99E-03	pCi/m3	2.00E-02		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Beryllium-7	6.02E-02	pCi/m3	8.93E-03		
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Cerium-141	-1.05E-04	pCi/m3	1.36E-03		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Cerium-144	-2.19E-04	pCi/m3	2.61E-03		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Cesium-134	2.75E-04	pCi/m3	7.05E-04	0.05	U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Cesium-137	-7.55E-05	pCi/m3	5.31E-04	0.06	U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Chromium-51	-9.58E-04	pCi/m3	1.16E-02		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Cobalt-57	9.91E-05	pCi/m3	3.60E-04		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Cobalt-58	2.40E-04	pCi/m3	8.90E-04		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Cobalt-60	2.38E-04	pCi/m3	7.78E-04		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Iodine-131	-1.11E-02	pCi/m3	2.18E-02		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Iron-59	3.32E-06	pCi/m3	1.85E-03		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Lanthanum-140	-1.19E-03	pCi/m3	9.27E-03		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Manganese-54	7.81E-05	pCi/m3	6.96E-04		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Niobium-95	1.92E-04	pCi/m3	1.06E-03		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Potassium-40	1.09E-02	pCi/m3	4.17E-03		
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Ruthenium-103	4.03E-05	pCi/m3	9.53E-04		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Ruthenium-106	7.57E-04	pCi/m3	5.07E-03		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Selenium-75	-1.13E-04	pCi/m3	8.37E-04		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Silver-108m	6.70E-05	pCi/m3	4.86E-04		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Silver-110m	-4.03E-04	pCi/m3	7.52E-04		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Zinc-65	1.15E-03	pCi/m3	1.88E-03		U
Air Monitoring	Control	API-4	09-Feb-13	PF Composite	Zirconium-95	-5.15E-04	pCi/m3	1.37E-03		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Actinium-228	-1.45E-03	pCi/m3	2.70E-03		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Antimony-124	-5.86E-04	pCi/m3	1.57E-03		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Antimony-125	-3.34E-05	pCi/m3	1.73E-03		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Barium-140	-2.00E-03	pCi/m3	2.07E-02		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Beryllium-7	5.45E-02	pCi/m3	7.56E-03		
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Cerium-141	-4.20E-04	pCi/m3	1.54E-03		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Cerium-144	-7.70E-04	pCi/m3	2.95E-03		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Cesium-134	-2.39E-04	pCi/m3	7.40E-04	0.05	U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Cesium-137	-6.99E-05	pCi/m3	6.25E-04	0.06	U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Chromium-51	5.84E-03	pCi/m3	1.51E-02		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Cobalt-57	2.80E-05	pCi/m3	3.98E-04		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Cobalt-58	2.01E-04	pCi/m3	8.02E-04		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Cobalt-60	3.15E-04	pCi/m3	7.69E-04		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Iodine-131	1.15E-02	pCi/m3	2.97E-02		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Iron-59	-1.68E-03	pCi/m3	2.34E-03		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Lanthanum-140	1.32E-03	pCi/m3	1.04E-02		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Manganese-54	-2.58E-04	pCi/m3	6.46E-04		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Niobium-95	3.42E-04	pCi/m3	1.14E-03		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Potassium-40	5.35E-03	pCi/m3	5.35E-03		UI
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Ruthenium-103	6.75E-04	pCi/m3	1.12E-03		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Ruthenium-106	2.77E-03	pCi/m3	6.31E-03		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Selenium-75	3.26E-04	pCi/m3	1.01E-03		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Silver-108m	6.91E-05	pCi/m3	5.40E-04		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Silver-110m	4.23E-04	pCi/m3	1.13E-03		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Zinc-65	-2.83E-04	pCi/m3	1.64E-03		U
Air Monitoring	Indicator	API-5	09-Feb-13	PF Composite	Zirconium-95	-5.64E-04	pCi/m3	1.71E-03		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Actinium-228	2.23E-04	pCi/m3	3.85E-03		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Antimony-124	1.73E-03	pCi/m3	5.27E-03		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Antimony-125	1.20E-03	pCi/m3	2.21E-03		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Barium-140	-2.79E-02	pCi/m3	1.20E-01		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Beryllium-7	7.32E-02	pCi/m3	1.31E-02		
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Cerium-141	-4.89E-04	pCi/m3	3.90E-03		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Cerium-144	5.41E-04	pCi/m3	4.06E-03		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Cesium-134	-8.38E-05	pCi/m3	7.89E-04	0.05	U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Cesium-137	-2.21E-04	pCi/m3	7.10E-04	0.06	U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Chromium-51	-1.96E-03	pCi/m3	3.53E-02		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Cobalt-57	-2.54E-04	pCi/m3	5.13E-04		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Cobalt-58	1.09E-03	pCi/m3	1.85E-03		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Cobalt-60	-2.40E-04	pCi/m3	7.99E-04		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Iodine-131	1.11E-01	pCi/m3	3.48E-01		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Iron-59	-2.82E-03	pCi/m3	4.82E-03		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Lanthanum-140	1.39E-02	pCi/m3	6.07E-02		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Manganese-54	-9.81E-05	pCi/m3	8.19E-04		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Niobium-95	1.10E-03	pCi/m3	1.10E-03		UI
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Potassium-40	1.36E-02	pCi/m3	5.86E-03		
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Ruthenium-103	1.55E-03	pCi/m3	2.01E-03		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Ruthenium-106	4.68E-04	pCi/m3	8.26E-03		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Selenium-75	1.35E-04	pCi/m3	1.33E-03		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Silver-108m	-9.22E-05	pCi/m3	6.72E-04		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Silver-110m	3.38E-04	pCi/m3	1.39E-03		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Zinc-65	-4.93E-04	pCi/m3	2.36E-03		U
Air Monitoring	Indicator	API-1	24-Jun-13	PF Composite	Zirconium-95	5.46E-05	pCi/m3	3.00E-03		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Actinium-228	4.68E-04	pCi/m3	3.66E-03		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Antimony-124	2.36E-03	pCi/m3	4.93E-03		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Antimony-125	-3.50E-04	pCi/m3	1.63E-03		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Barium-140	-8.51E-03	pCi/m3	1.12E-01		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Beryllium-7	8.15E-02	pCi/m3	1.56E-02		
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Cerium-141	-6.00E-04	pCi/m3	3.09E-03		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Cerium-144	6.06E-04	pCi/m3	3.41E-03		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Cesium-134	1.13E-04	pCi/m3	7.37E-04	0.05	U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Cesium-137	-1.83E-05	pCi/m3	6.49E-04	0.06	U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Chromium-51	1.27E-02	pCi/m3	2.97E-02		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Cobalt-57	2.68E-05	pCi/m3	4.30E-04		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Cobalt-58	6.12E-04	pCi/m3	1.24E-03		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Cobalt-60	3.10E-04	pCi/m3	1.13E-03		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Iodine-131	4.53E-04	pCi/m3	2.86E-01		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Iron-59	1.76E-03	pCi/m3	4.51E-03		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Lanthanum-140	-1.44E-04	pCi/m3	4.03E-02		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Manganese-54	-1.72E-04	pCi/m3	1.01E-03		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Niobium-95	-2.49E-04	pCi/m3	1.67E-03		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Potassium-40	6.50E-03	pCi/m3	6.61E-03		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Ruthenium-103	-5.92E-04	pCi/m3	1.78E-03		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Ruthenium-106	3.45E-03	pCi/m3	8.43E-03		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Selenium-75	3.45E-04	pCi/m3	1.19E-03		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Silver-108m	-1.64E-04	pCi/m3	5.25E-04		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Silver-110m	1.11E-04	pCi/m3	1.43E-03		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Zinc-65	-6.60E-05	pCi/m3	1.54E-03		U
Air Monitoring	Indicator	API-2	24-Jun-13	PF Composite	Zirconium-95	-6.61E-04	pCi/m3	2.75E-03		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Actinium-228	-1.85E-04	pCi/m3	3.67E-03		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Antimony-124	-5.21E-04	pCi/m3	3.19E-03		U



Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Antimony-125	6.39E-04	pCi/m3	2.00E-03		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Barium-140	-1.51E-02	pCi/m3	9.56E-02		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Beryllium-7	8.23E-02	pCi/m3	1.32E-02		
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Cerium-141	-1.62E-03	pCi/m3	2.83E-03		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Cerium-144	2.42E-04	pCi/m3	3.64E-03		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Cesium-134	1.46E-04	pCi/m3	9.73E-04	0.05	U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Cesium-137	-4.44E-05	pCi/m3	8.73E-04	0.06	U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Chromium-51	-1.48E-02	pCi/m3	2.41E-02		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Cobalt-57	-1.50E-04	pCi/m3	4.23E-04		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Cobalt-58	-4.22E-04	pCi/m3	1.17E-03		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Cobalt-60	3.18E-04	pCi/m3	9.42E-04		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Iodine-131	-1.79E-01	pCi/m3	2.63E-01		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Iron-59	3.45E-03	pCi/m3	6.17E-03		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Lanthanum-140	-4.46E-03	pCi/m3	5.42E-02		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Manganese-54	-1.73E-05	pCi/m3	7.96E-04		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Niobium-95	1.07E-04	pCi/m3	1.61E-03		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Potassium-40	9.55E-03	pCi/m3	9.55E-03		UI
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Ruthenium-103	-1.01E-03	pCi/m3	1.72E-03		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Ruthenium-106	-3.01E-03	pCi/m3	6.36E-03		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Selenium-75	-2.00E-04	pCi/m3	1.18E-03		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Silver-108m	1.02E-04	pCi/m3	6.35E-04		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Silver-110m	6.47E-04	pCi/m3	1.29E-03		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Zinc-65	-9.78E-04	pCi/m3	1.37E-03		U
Air Monitoring	Indicator	API-3	24-Jun-13	PF Composite	Zirconium-95	-5.78E-04	pCi/m3	2.76E-03		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Actinium-228	2.55E-03	pCi/m3	7.75E-03		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Antimony-124	2.01E-03	pCi/m3	9.88E-03		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Antimony-125	-1.71E-04	pCi/m3	3.31E-03		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Barium-140	-2.91E-02	pCi/m3	2.33E-01		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Beryllium-7	7.02E-02	pCi/m3	2.85E-02		
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Cerium-141	7.30E-05	pCi/m3	5.41E-03		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Cerium-144	5.93E-04	pCi/m3	6.27E-03		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Cesium-134	-8.83E-04	pCi/m3	1.56E-03	0.05	U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Cesium-137	3.34E-04	pCi/m3	1.75E-03	0.06	U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Chromium-51	2.90E-03	pCi/m3	6.15E-02		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Cobalt-57	-2.17E-05	pCi/m3	7.11E-04		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Cobalt-58	4.49E-04	pCi/m3	3.38E-03		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Cobalt-60	9.70E-04	pCi/m3	2.13E-03		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Iodine-131	1.95E-02	pCi/m3	5.59E-01		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Iron-59	5.44E-04	pCi/m3	8.39E-03		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Lanthanum-140	-1.72E-02	pCi/m3	6.44E-02		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Manganese-54	1.56E-04	pCi/m3	1.78E-03		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Niobium-95	1.33E-03	pCi/m3	2.81E-03		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Potassium-40	-1.95E-03	pCi/m3	2.48E-02		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Ruthenium-103	1.14E-03	pCi/m3	4.22E-03		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Ruthenium-106	1.03E-03	pCi/m3	1.24E-02		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Selenium-75	3.89E-04	pCi/m3	2.19E-03		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Silver-108m	-4.58E-07	pCi/m3	8.42E-04		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Silver-110m	7.62E-04	pCi/m3	2.41E-03		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Zinc-65	5.42E-04	pCi/m3	4.07E-03		U
Air Monitoring	Control	API-4	24-Jun-13	PF Composite	Zirconium-95	6.58E-04	pCi/m3	5.57E-03		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Actinium-228	-1.09E-03	pCi/m3	4.96E-03		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Antimony-124	1.08E-05	pCi/m3	4.47E-03		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Antimony-125	-4.57E-04	pCi/m3	2.92E-03		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Barium-140	1.16E-01	pCi/m3	2.05E-01		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Beryllium-7	7.36E-02	pCi/m3	1.92E-02		
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Cerium-141	-1.57E-03	pCi/m3	4.11E-03		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Cerium-144	3.60E-03	pCi/m3	4.99E-03		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Cesium-134	4.17E-04	pCi/m3	1.47E-03	0.05	U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Cesium-137	3.64E-04	pCi/m3	1.26E-03	0.06	U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Chromium-51	4.10E-02	pCi/m3	5.77E-02		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Cobalt-57	-3.85E-05	pCi/m3	6.37E-04		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Cobalt-58	3.15E-04	pCi/m3	1.91E-03		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Cobalt-60	9.36E-05	pCi/m3	9.35E-04		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Iodine-131	-1.22E-01	pCi/m3	3.62E-01		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Iron-59	1.72E-03	pCi/m3	6.45E-03		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Lanthanum-140	3.06E-02	pCi/m3	6.87E-02		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Manganese-54	-2.20E-05	pCi/m3	1.16E-03		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Niobium-95	-5.47E-04	pCi/m3	1.37E-03		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Potassium-40	7.29E-03	pCi/m3	2.06E-02		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Ruthenium-103	0.00E+00	pCi/m3	0.00E+00		UI
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Ruthenium-106	1.23E-03	pCi/m3	1.03E-02		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Selenium-75	1.34E-03	pCi/m3	2.06E-03		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Silver-108m	-2.00E-04	pCi/m3	7.69E-04		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Silver-110m	-1.01E-05	pCi/m3	1.26E-03		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Zinc-65	-9.86E-04	pCi/m3	2.60E-03		U
Air Monitoring	Indicator	API-5	24-Jun-13	PF Composite	Zirconium-95	-3.90E-04	pCi/m3	3.99E-03		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Actinium-228	-1.23E-03	pCi/m3	4.45E-03		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Antimony-124	2.15E-03	pCi/m3	4.57E-03		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Antimony-125	-1.11E-03	pCi/m3	2.14E-03		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Barium-140	9.09E-03	pCi/m3	2.20E-02		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Beryllium-7	5.49E-02	pCi/m3	1.04E-02		
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Cerium-141	-1.82E-04	pCi/m3	1.63E-03		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Cerium-144	1.87E-03	pCi/m3	3.75E-03		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Cesium-134	7.86E-04	pCi/m3	1.13E-03	0.05	U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Cesium-137	-3.74E-05	pCi/m3	9.52E-04	0.06	U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Chromium-51	4.63E-03	pCi/m3	1.53E-02		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Cobalt-57	1.12E-04	pCi/m3	4.34E-04		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Cobalt-58	1.91E-04	pCi/m3	1.16E-03		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Cobalt-60	4.76E-04	pCi/m3	1.51E-03		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Iodine-131	1.28E-02	pCi/m3	1.28E-02		UI
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Iron-59	-2.69E-04	pCi/m3	2.94E-03		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Lanthanum-140	-3.25E-04	pCi/m3	6.32E-03		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Manganese-54	-5.17E-04	pCi/m3	8.29E-04		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Niobium-95	9.11E-05	pCi/m3	1.27E-03		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Potassium-40	4.94E-03	pCi/m3	4.94E-03		UI
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Ruthenium-103	5.15E-04	pCi/m3	1.61E-03		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Ruthenium-106	-3.84E-03	pCi/m3	7.34E-03		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Selenium-75	-2.74E-04	pCi/m3	1.02E-03		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Silver-108m	2.46E-04	pCi/m3	7.60E-04		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Silver-110m	-8.27E-04	pCi/m3	9.87E-04		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Zinc-65	-1.09E-03	pCi/m3	1.73E-03		U
Air Monitoring	Indicator	API-1	01-Oct-13	PF Composite	Zirconium-95	1.55E-05	pCi/m3	2.37E-03		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Actinium-228	2.09E-03	pCi/m3	2.79E-03		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Antimony-124	-4.83E-04	pCi/m3	1.76E-03		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Antimony-125	4.59E-04	pCi/m3	1.26E-03		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Barium-140	-4.07E-03	pCi/m3	8.92E-03		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Beryllium-7	6.94E-02	pCi/m3	5.11E-03		
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Cerium-141	-3.95E-04	pCi/m3	1.04E-03		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Cerium-144	4.19E-04	pCi/m3	2.52E-03		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Cesium-134	-1.04E-04	pCi/m3	5.49E-04	0.05	U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Cesium-137	2.35E-04	pCi/m3	5.45E-04	0.06	U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Chromium-51	-4.45E-03	pCi/m3	7.20E-03		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Cobalt-57	8.09E-05	pCi/m3	3.21E-04		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Cobalt-58	7.70E-05	pCi/m3	6.44E-04		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Cobalt-60	4.88E-04	pCi/m3	7.04E-04		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Iodine-131	-1.51E-03	pCi/m3	6.91E-03		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Iron-59	3.06E-04	pCi/m3	1.71E-03		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Lanthanum-140	-9.06E-04	pCi/m3	2.82E-03		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Manganese-54	3.83E-05	pCi/m3	5.80E-04		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Niobium-95	-1.31E-04	pCi/m3	6.43E-04		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Potassium-40	1.01E-02	pCi/m3	5.81E-03		
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Ruthenium-103	-7.58E-05	pCi/m3	6.86E-04		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Ruthenium-106	-1.65E-03	pCi/m3	4.50E-03		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Selenium-75	1.25E-04	pCi/m3	6.42E-04		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Silver-108m	-3.64E-05	pCi/m3	3.73E-04		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Silver-110m	8.70E-05	pCi/m3	8.12E-04		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Zinc-65	-4.59E-04	pCi/m3	1.31E-03		U
Air Monitoring	Indicator	API-2	01-Oct-13	PF Composite	Zirconium-95	3.07E-04	pCi/m3	1.31E-03		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Actinium-228	9.87E-04	pCi/m3	2.34E-03		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Antimony-124	-2.90E-04	pCi/m3	9.07E-04		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Antimony-125	3.68E-04	pCi/m3	1.09E-03		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Barium-140	1.13E-03	pCi/m3	8.53E-03		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Beryllium-7	5.54E-02	pCi/m3	5.58E-03		
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Cerium-141	-1.89E-04	pCi/m3	9.12E-04		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Cerium-144	6.14E-04	pCi/m3	2.06E-03		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Cesium-134	1.98E-04	pCi/m3	5.38E-04	0.05	U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Cesium-137	3.01E-04	pCi/m3	5.30E-04	0.06	U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Chromium-51	1.13E-03	pCi/m3	6.96E-03		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Cobalt-57	1.26E-04	pCi/m3	2.38E-04		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Cobalt-58	-2.26E-05	pCi/m3	6.72E-04		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Cobalt-60	1.96E-05	pCi/m3	6.01E-04		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Iodine-131	-3.38E-03	pCi/m3	5.13E-03		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Iron-59	1.15E-04	pCi/m3	1.41E-03		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Lanthanum-140	5.31E-04	pCi/m3	3.44E-03		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Manganese-54	-7.15E-06	pCi/m3	5.19E-04		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Niobium-95	5.93E-05	pCi/m3	5.80E-04		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Potassium-40	1.04E-02	pCi/m3	4.89E-03		
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Ruthenium-103	2.28E-04	pCi/m3	7.32E-04		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Ruthenium-106	-4.07E-05	pCi/m3	4.13E-03		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Selenium-75	-3.29E-05	pCi/m3	5.58E-04		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Silver-108m	-1.63E-04	pCi/m3	3.02E-04		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Silver-110m	-4.49E-04	pCi/m3	4.94E-04		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Zinc-65	-6.90E-05	pCi/m3	1.04E-03		U
Air Monitoring	Indicator	API-3	01-Oct-13	PF Composite	Zirconium-95	1.21E-04	pCi/m3	1.03E-03		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Actinium-228	1.18E-03	pCi/m3	1.61E-03		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Antimony-124	-1.79E-04	pCi/m3	1.54E-03		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Antimony-125	-1.94E-04	pCi/m3	1.20E-03		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Barium-140	-1.07E-03	pCi/m3	9.04E-03		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Beryllium-7	6.52E-02	pCi/m3	5.30E-03		
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Cerium-141	3.93E-04	pCi/m3	1.13E-03		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Cerium-144	4.26E-04	pCi/m3	2.24E-03		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Cesium-134	3.13E-05	pCi/m3	4.93E-04	0.05	U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Cesium-137	8.09E-05	pCi/m3	5.66E-04	0.06	U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Chromium-51	5.90E-03	pCi/m3	8.24E-03		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Cobalt-57	-1.04E-04	pCi/m3	2.69E-04		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Cobalt-58	-1.98E-04	pCi/m3	5.62E-04		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Cobalt-60	-1.63E-04	pCi/m3	5.77E-04		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Iodine-131	4.29E-03	pCi/m3	7.87E-03		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Iron-59	-2.80E-04	pCi/m3	1.54E-03		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Lanthanum-140	-2.13E-03	pCi/m3	3.75E-03		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Manganese-54	-1.06E-04	pCi/m3	4.11E-04		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Niobium-95	3.10E-04	pCi/m3	7.63E-04		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Potassium-40	9.61E-03	pCi/m3	5.06E-03		
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Ruthenium-103	-4.59E-04	pCi/m3	6.66E-04		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Ruthenium-106	1.61E-03	pCi/m3	5.03E-03		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Selenium-75	7.52E-05	pCi/m3	6.34E-04		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Silver-108m	9.35E-05	pCi/m3	4.14E-04		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Silver-110m	5.64E-05	pCi/m3	6.96E-04		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Zinc-65	1.31E-04	pCi/m3	1.22E-03		U
Air Monitoring	Control	API-4	01-Oct-13	PF Composite	Zirconium-95	-4.23E-05	pCi/m3	9.51E-04		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Actinium-228	-5.67E-04	pCi/m3	1.97E-03		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Antimony-124	-2.96E-04	pCi/m3	9.28E-04		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Antimony-125	8.29E-05	pCi/m3	1.17E-03		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Barium-140	3.91E-04	pCi/m3	8.76E-03		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Beryllium-7	6.15E-02	pCi/m3	5.50E-03		
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Cerium-141	3.44E-04	pCi/m3	1.00E-03		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Cerium-144	4.04E-04	pCi/m3	2.22E-03		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Cesium-134	2.65E-04	pCi/m3	6.41E-04	0.05	U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Cesium-137	2.82E-05	pCi/m3	5.92E-04	0.06	U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Chromium-51	-1.92E-03	pCi/m3	7.44E-03		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Cobalt-57	-2.27E-04	pCi/m3	2.43E-04		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Cobalt-58	-1.69E-04	pCi/m3	5.34E-04		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Cobalt-60	1.52E-04	pCi/m3	6.98E-04		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Iodine-131	6.78E-03	pCi/m3	6.78E-03		UI
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Iron-59	-4.50E-04	pCi/m3	1.33E-03		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Lanthanum-140	3.25E-04	pCi/m3	4.27E-03		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Manganese-54	3.30E-04	pCi/m3	6.61E-04		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Niobium-95	3.17E-04	pCi/m3	7.27E-04		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Potassium-40	1.32E-02	pCi/m3	5.66E-03		
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Ruthenium-103	-6.58E-05	pCi/m3	6.20E-04		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Ruthenium-106	-2.88E-04	pCi/m3	4.27E-03		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Selenium-75	-1.03E-04	pCi/m3	5.63E-04		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Silver-108m	-1.45E-04	pCi/m3	3.21E-04		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Silver-110m	3.77E-04	pCi/m3	7.65E-04		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Zinc-65	-4.64E-04	pCi/m3	8.12E-04		U
Air Monitoring	Indicator	API-5	01-Oct-13	PF Composite	Zirconium-95	-4.00E-04	pCi/m3	1.14E-03		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Actinium-228	5.38E-04	pCi/m3	2.74E-03		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Antimony-124	2.51E-04	pCi/m3	2.24E-03		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Antimony-125	-5.72E-05	pCi/m3	1.45E-03		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Barium-140	4.76E-04	pCi/m3	4.80E-03		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Beryllium-7	6.49E-02	pCi/m3	5.64E-03		
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Cerium-141	4.87E-04	pCi/m3	1.05E-03		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Cerium-144	-4.12E-04	pCi/m3	2.11E-03		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Cesium-134	2.27E-04	pCi/m3	8.16E-04	0.05	U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Cesium-137	-1.09E-04	pCi/m3	5.66E-04	0.06	U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Chromium-51	-9.38E-04	pCi/m3	9.05E-03		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Cobalt-57	-1.15E-04	pCi/m3	2.61E-04		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Cobalt-58	2.68E-04	pCi/m3	1.05E-03		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Cobalt-60	-2.04E-04	pCi/m3	5.95E-04		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Iodine-131	1.99E-03	pCi/m3	8.57E-03		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Iron-59	-2.05E-04	pCi/m3	1.98E-03		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Lanthanum-140	4.76E-04	pCi/m3	4.80E-03		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Manganese-54	-1.77E-04	pCi/m3	3.13E-04		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Niobium-95	-1.97E-04	pCi/m3	9.32E-04		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Potassium-40	3.48E-03	pCi/m3	3.48E-03		UI
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Ruthenium-103	-4.25E-05	pCi/m3	8.51E-04		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Ruthenium-106	8.84E-04	pCi/m3	6.44E-03		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Selenium-75	2.45E-05	pCi/m3	6.69E-04		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Silver-108m	2.54E-04	pCi/m3	5.33E-04		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Silver-110m	1.84E-04	pCi/m3	1.11E-03		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Zinc-65	2.34E-04	pCi/m3	1.50E-03		U
Air Monitoring	Indicator	API-1	30-Dec-13	PF Composite	Zirconium-95	-7.87E-04	pCi/m3	1.20E-03		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Actinium-228	-2.23E-04	pCi/m3	3.75E-03		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Antimony-124	4.96E-04	pCi/m3	4.08E-03		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Antimony-125	-9.67E-04	pCi/m3	1.87E-03		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Barium-140	2.53E-03	pCi/m3	7.82E-03		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Beryllium-7	7.18E-02	pCi/m3	8.09E-03		
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Cerium-141	1.52E-03	pCi/m3	1.80E-03		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Cerium-144	1.02E-03	pCi/m3	4.64E-03		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Cesium-134	4.16E-04	pCi/m3	1.03E-03	0.05	U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Cesium-137	-7.45E-05	pCi/m3	6.98E-04	0.06	U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Chromium-51	1.40E-03	pCi/m3	1.47E-02		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Cobalt-57	2.75E-04	pCi/m3	5.59E-04		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Cobalt-58	-1.38E-04	pCi/m3	8.96E-04		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Cobalt-60	-7.05E-04	pCi/m3	1.03E-03		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Iodine-131	-2.95E-03	pCi/m3	1.26E-02		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Iron-59	9.05E-04	pCi/m3	2.82E-03		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Lanthanum-140	2.53E-03	pCi/m3	7.82E-03		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Manganese-54	1.74E-05	pCi/m3	7.89E-04		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Niobium-95	3.26E-04	pCi/m3	1.01E-03		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Potassium-40	2.17E-02	pCi/m3	9.66E-03		
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Ruthenium-103	2.44E-04	pCi/m3	1.38E-03		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Ruthenium-106	-1.47E-03	pCi/m3	6.28E-03		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Selenium-75	-1.07E-04	pCi/m3	1.02E-03		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Silver-108m	1.94E-04	pCi/m3	6.56E-04		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Silver-110m	4.33E-04	pCi/m3	1.21E-03		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Zinc-65	7.82E-05	pCi/m3	1.87E-03		U
Air Monitoring	Indicator	API-2	30-Dec-13	PF Composite	Zirconium-95	4.55E-04	pCi/m3	2.04E-03		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Actinium-228	-1.24E-03	pCi/m3	3.64E-03		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Antimony-124	-8.00E-05	pCi/m3	3.62E-03		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Antimony-125	2.53E-04	pCi/m3	2.67E-03		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Barium-140	-1.92E-03	pCi/m3	5.30E-03		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Beryllium-7	5.35E-02	pCi/m3	8.87E-03		
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Cerium-141	4.04E-04	pCi/m3	1.21E-03		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Cerium-144	-3.05E-03	pCi/m3	3.40E-03		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Cesium-134	1.49E-04	pCi/m3	9.65E-04	0.05	U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Cesium-137	7.28E-05	pCi/m3	9.59E-04	0.06	U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Chromium-51	4.60E-03	pCi/m3	1.71E-02		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Cobalt-57	5.15E-05	pCi/m3	5.65E-04		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Cobalt-58	-1.53E-04	pCi/m3	9.77E-04		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Cobalt-60	2.64E-04	pCi/m3	1.08E-03		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Iodine-131	-3.10E-03	pCi/m3	1.23E-02		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Iron-59	-1.45E-04	pCi/m3	1.87E-03		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Lanthanum-140	-1.92E-03	pCi/m3	5.30E-03		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Manganese-54	-9.78E-05	pCi/m3	8.14E-04		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Niobium-95	-2.55E-04	pCi/m3	1.19E-03		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Potassium-40	1.09E-02	pCi/m3	1.10E-02		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Ruthenium-103	-9.46E-05	pCi/m3	1.42E-03		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Ruthenium-106	1.89E-03	pCi/m3	7.84E-03		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Selenium-75	2.15E-05	pCi/m3	1.14E-03		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Silver-108m	-2.45E-04	pCi/m3	6.86E-04		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Silver-110m	1.29E-05	pCi/m3	1.18E-03		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Zinc-65	-1.62E-04	pCi/m3	1.86E-03		U
Air Monitoring	Indicator	API-3	30-Dec-13	PF Composite	Zirconium-95	9.17E-04	pCi/m3	2.72E-03		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Actinium-228	-7.12E-04	pCi/m3	3.96E-03		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Antimony-124	-1.94E-03	pCi/m3	2.11E-03		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Antimony-125	7.04E-04	pCi/m3	2.10E-03		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Barium-140	1.09E-03	pCi/m3	6.26E-03		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Beryllium-7	3.82E-02	pCi/m3	7.15E-03		
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Cerium-141	6.19E-04	pCi/m3	1.48E-03		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Cerium-144	-7.11E-04	pCi/m3	3.26E-03		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Cesium-134	-4.88E-05	pCi/m3	8.42E-04	0.05	U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Cesium-137	6.49E-05	pCi/m3	6.85E-04	0.06	U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Chromium-51	5.96E-03	pCi/m3	1.28E-02		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Cobalt-57	-1.02E-05	pCi/m3	4.94E-04		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Cobalt-58	-2.82E-05	pCi/m3	1.06E-03		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Cobalt-60	2.70E-05	pCi/m3	9.31E-04		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Iodine-131	6.70E-03	pCi/m3	1.18E-02		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Iron-59	-5.34E-04	pCi/m3	3.01E-03		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Lanthanum-140	1.09E-03	pCi/m3	6.26E-03		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Manganese-54	-1.43E-04	pCi/m3	7.67E-04		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Niobium-95	5.22E-05	pCi/m3	1.12E-03		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Potassium-40	6.82E-03	pCi/m3	6.82E-03		UI
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Ruthenium-103	2.10E-04	pCi/m3	1.14E-03		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Ruthenium-106	4.80E-04	pCi/m3	7.83E-03		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Selenium-75	-3.38E-04	pCi/m3	9.45E-04		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Silver-108m	1.72E-04	pCi/m3	6.46E-04		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Silver-110m	5.40E-05	pCi/m3	1.37E-03		U

*Fermi 2 - 2013*  
*Annual Radiological Environmental Operating Report*  
*Appendix C - Environmental Data Table*

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Zinc-65	3.37E-04	pCi/m3	1.71E-03		U
Air Monitoring	Control	API-4	30-Dec-13	PF Composite	Zirconium-95	1.10E-04	pCi/m3	1.61E-03		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Actinium-228	7.62E-04	pCi/m3	2.99E-03		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Antimony-124	-1.96E-04	pCi/m3	2.44E-03		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Antimony-125	7.77E-04	pCi/m3	1.99E-03		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Barium-140	-1.30E-03	pCi/m3	4.43E-03		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Beryllium-7	4.57E-02	pCi/m3	7.50E-03		
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Cerium-141	3.20E-05	pCi/m3	1.83E-03		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Cerium-144	-2.50E-03	pCi/m3	3.74E-03		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Cesium-134	-6.61E-05	pCi/m3	7.23E-04	0.05	U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Cesium-137	-3.13E-04	pCi/m3	7.94E-04	0.06	U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Chromium-51	9.18E-04	pCi/m3	1.23E-02		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Cobalt-57	-7.64E-05	pCi/m3	5.01E-04		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Cobalt-58	-1.55E-04	pCi/m3	7.15E-04		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Cobalt-60	-1.42E-04	pCi/m3	7.36E-04		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Iodine-131	-2.92E-03	pCi/m3	9.06E-03		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Iron-59	-5.21E-04	pCi/m3	2.22E-03		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Lanthanum-140	-1.30E-03	pCi/m3	4.43E-03		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Manganese-54	1.83E-04	pCi/m3	8.00E-04		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Niobium-95	3.85E-05	pCi/m3	1.00E-03		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Potassium-40	4.18E-03	pCi/m3	7.14E-03		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Ruthenium-103	-5.88E-04	pCi/m3	9.73E-04		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Ruthenium-106	-3.09E-03	pCi/m3	6.61E-03		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Selenium-75	2.97E-04	pCi/m3	1.03E-03		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Silver-108m	-8.92E-05	pCi/m3	6.40E-04		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Silver-110m	6.18E-04	pCi/m3	1.23E-03		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Zinc-65	-7.84E-05	pCi/m3	1.44E-03		U
Air Monitoring	Indicator	API-5	30-Dec-13	PF Composite	Zirconium-95	-6.39E-04	pCi/m3	1.72E-03		U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Actinium-228	1.23E+00	pCi/L	7.02E+00		U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Antimony-124	-3.39E-02	pCi/L	3.99E+00		U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Antimony-125	-2.48E+00	pCi/L	4.47E+00		U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Barium-140	1.04E+00	pCi/L	2.41E+00	15	U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Beryllium-7	3.69E+00	pCi/L	1.42E+01		U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	BETA	3.21E+00	pCi/L	3.78E+00	4	U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Cerium-141	2.75E-01	pCi/L	3.00E+00		U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Cerium-144	6.88E+00	pCi/L	1.25E+01		U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Cesium-134	5.11E-02	pCi/L	1.72E+00	15	U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Cesium-137	-4.12E-02	pCi/L	1.72E+00	18	U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Chromium-51	6.45E+00	pCi/L	1.59E+01		U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Cobalt-57	3.64E-01	pCi/L	1.63E+00		U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Cobalt-58	2.61E-01	pCi/L	1.56E+00	15	U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Cobalt-60	-3.52E-01	pCi/L	1.50E+00	15	U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Iodine-131	-1.15E-01	pCi/L	2.31E+00		U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Iron-59	-1.47E-01	pCi/L	3.07E+00	30	U



*Fermi 2 - 2013*  
*Annual Radiological Environmental Operating Report*  
*Appendix C - Environmental Data Table*

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Lanthanum-140	1.04E+00	pCi/L	2.41E+00	15	U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Manganese-54	-1.14E+00	pCi/L	1.44E+00	15	U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Niobium-95	5.33E-01	pCi/L	1.72E+00	15	U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Potassium-40	6.87E-01	pCi/L	1.73E+01		U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Ruthenium-103	-7.13E-01	pCi/L	1.68E+00		U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Ruthenium-106	-3.76E+00	pCi/L	1.36E+01		U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Selenium-75	2.16E-01	pCi/L	2.30E+00		U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Silver-108m	1.00E-01	pCi/L	1.54E+00		U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Silver-110m	1.40E-01	pCi/L	1.59E+00		U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Strontium-89	-3.91E-01	pCi/L	2.20E+00	10	U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Strontium-90	-4.72E-01	pCi/L	1.76E+00	2	U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Thorium-228	3.02E+00	pCi/L	3.81E+00		U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Zinc-65	-6.83E-01	pCi/L	3.40E+00	30	U
Drinking Water	Indicator	DW-1	28-Jan-13	Composite	Zirconium-95	-1.25E+00	pCi/L	2.82E+00	15	U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Actinium-228	8.70E-01	pCi/L	7.53E+00		U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Antimony-124	7.29E-01	pCi/L	3.99E+00		U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Antimony-125	2.59E+00	pCi/L	5.02E+00		U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Barium-140	6.91E-01	pCi/L	2.25E+00	15	U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Beryllium-7	6.67E+00	pCi/L	1.51E+01		U
Drinking Water	Control	DW-2	28-Jan-13	Composite	BETA	3.55E+00	pCi/L	3.73E+00	4	U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Cerium-141	4.28E-01	pCi/L	2.78E+00		U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Cerium-144	3.91E-02	pCi/L	1.19E+01		U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Cesium-134	1.29E-01	pCi/L	1.94E+00	15	U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Cesium-137	1.42E+00	pCi/L	1.79E+00	18	U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Chromium-51	5.13E+00	pCi/L	1.55E+01		U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Cobalt-57	-8.48E-02	pCi/L	1.50E+00		U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Cobalt-58	-9.91E-01	pCi/L	1.56E+00	15	U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Cobalt-60	1.85E-01	pCi/L	1.77E+00	15	U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Iodine-131	8.97E-01	pCi/L	2.15E+00		U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Iron-59	8.93E-01	pCi/L	3.44E+00	30	U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Lanthanum-140	6.91E-01	pCi/L	2.25E+00	15	U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Manganese-54	-4.31E-01	pCi/L	1.66E+00	15	U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Niobium-95	4.58E-01	pCi/L	1.83E+00	15	U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Potassium-40	-1.34E+01	pCi/L	2.49E+01		U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Ruthenium-103	-5.45E-01	pCi/L	1.69E+00		U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Ruthenium-106	7.47E+00	pCi/L	1.68E+01		U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Selenium-75	-4.58E-04	pCi/L	2.36E+00		U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Silver-108m	3.81E-01	pCi/L	1.59E+00		U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Silver-110m	-7.34E-01	pCi/L	1.60E+00		U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Strontium-89	-1.09E-01	pCi/L	2.42E+00	10	U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Strontium-90	-9.00E-02	pCi/L	1.79E+00	2	U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Thorium-228	-4.84E-01	pCi/L	3.70E+00		U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Zinc-65	3.84E-01	pCi/L	3.50E+00	30	U
Drinking Water	Control	DW-2	28-Jan-13	Composite	Zirconium-95	1.56E+00	pCi/L	3.23E+00	15	U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Actinium-228	-6.89E-01	pCi/L	6.70E+00		U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Antimony-124	1.18E+00	pCi/L	3.94E+00		U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Antimony-125	2.56E-01	pCi/L	4.30E+00		U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Barium-140	-1.42E+00	pCi/L	2.04E+00	15	U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Beryllium-7	5.87E+00	pCi/L	1.42E+01		U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	BETA	2.79E+00	pCi/L	3.39E+00	4	U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Cerium-141	-3.44E-01	pCi/L	2.67E+00		U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Cerium-144	2.46E+00	pCi/L	1.07E+01		U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Cesium-134	5.38E-01	pCi/L	1.71E+00	15	U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Cesium-137	2.91E-01	pCi/L	1.60E+00	18	U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Chromium-51	-2.13E+00	pCi/L	1.40E+01		U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Cobalt-57	6.79E-01	pCi/L	1.39E+00		U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Cobalt-58	-3.81E-01	pCi/L	1.49E+00	15	U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Cobalt-60	-8.29E-01	pCi/L	1.72E+00	15	U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Iodine-131	4.73E-01	pCi/L	2.38E+00		U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Iron-59	-1.05E+00	pCi/L	2.93E+00	30	U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Lanthanum-140	-1.42E+00	pCi/L	2.04E+00	15	U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Manganese-54	-1.59E-01	pCi/L	1.48E+00	15	U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Niobium-95	9.17E-02	pCi/L	1.55E+00	15	U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Potassium-40	1.03E+01	pCi/L	1.45E+01		U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Ruthenium-103	-1.24E+00	pCi/L	1.59E+00		U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Ruthenium-106	-3.79E+00	pCi/L	1.36E+01		U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Selenium-75	1.31E+00	pCi/L	2.10E+00		U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Silver-108m	3.62E-01	pCi/L	1.44E+00		U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Silver-110m	5.66E-01	pCi/L	1.49E+00		U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Strontium-89	-3.60E-01	pCi/L	1.68E+00	10	U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Strontium-90	-7.97E-01	pCi/L	1.43E+00	2	U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Thorium-228	1.50E+00	pCi/L	2.79E+00		U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Zinc-65	-2.54E-01	pCi/L	2.94E+00	30	U
Drinking Water	Indicator	DW-1	25-Feb-13	Composite	Zirconium-95	5.54E-01	pCi/L	2.66E+00	15	U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Actinium-228	-4.50E+00	pCi/L	7.16E+00		U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Antimony-124	-3.93E-01	pCi/L	4.23E+00		U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Antimony-125	4.50E-01	pCi/L	4.55E+00		U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Barium-140	-6.46E-01	pCi/L	2.50E+00	15	U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Beryllium-7	1.05E+00	pCi/L	1.49E+01		U
Drinking Water	Control	DW-2	25-Feb-13	Composite	BETA	7.72E-01	pCi/L	2.24E+00	4	U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Cerium-141	2.15E+00	pCi/L	3.05E+00		U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Cerium-144	3.40E+00	pCi/L	1.27E+01		U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Cesium-134	-9.01E-01	pCi/L	1.70E+00	15	U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Cesium-137	-2.03E-01	pCi/L	1.64E+00	18	U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Chromium-51	-2.80E+00	pCi/L	1.59E+01		U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Cobalt-57	3.44E-01	pCi/L	1.68E+00		U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Cobalt-58	-1.34E+00	pCi/L	1.44E+00	15	U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Cobalt-60	-1.10E-01	pCi/L	1.80E+00	15	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Drinking Water	Control	DW-2	25-Feb-13	Composite	Iodine-131	-3.62E-03	pCi/L	2.72E+00		U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Iron-59	-1.09E+00	pCi/L	3.39E+00	30	U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Lanthanum-140	-6.46E-01	pCi/L	2.50E+00	15	U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Manganese-54	-7.67E-01	pCi/L	1.55E+00	15	U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Niobium-95	1.99E-01	pCi/L	1.76E+00	15	U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Potassium-40	1.47E+01	pCi/L	1.47E+01		UI
Drinking Water	Control	DW-2	25-Feb-13	Composite	Ruthenium-103	2.96E-01	pCi/L	1.71E+00		U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Ruthenium-106	-7.44E+00	pCi/L	1.46E+01		U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Selenium-75	7.37E-01	pCi/L	2.38E+00		U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Silver-108m	-1.56E-01	pCi/L	1.58E+00		U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Silver-110m	-3.00E-01	pCi/L	1.46E+00		U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Strontium-89	1.50E+00	pCi/L	2.48E+00	10	U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Strontium-90	-1.93E-01	pCi/L	1.44E+00	2	U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Thorium-228	2.04E+00	pCi/L	3.81E+00		U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Zinc-65	-2.41E+00	pCi/L	3.31E+00	30	U
Drinking Water	Control	DW-2	25-Feb-13	Composite	Zirconium-95	-7.65E-01	pCi/L	2.94E+00	15	U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Actinium-228	1.28E+00	pCi/L	6.87E+00		U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Antimony-124	9.34E-01	pCi/L	3.97E+00		U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Antimony-125	1.63E+00	pCi/L	4.82E+00		U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Barium-140	-1.28E-01	pCi/L	1.91E+00	15	U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Beryllium-7	1.56E+00	pCi/L	1.37E+01		U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	BETA	9.75E-01	pCi/L	2.79E+00	4	U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Cerium-141	8.86E-01	pCi/L	3.17E+00		U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Cerium-144	5.01E+00	pCi/L	1.27E+01		U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Cesium-134	1.91E+00	pCi/L	1.91E+00	15	UI
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Cesium-137	4.02E-01	pCi/L	1.74E+00	18	U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Chromium-51	-5.90E-01	pCi/L	1.47E+01		U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Cobalt-57	4.40E-02	pCi/L	1.65E+00		U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Cobalt-58	2.63E-01	pCi/L	1.63E+00	15	U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Cobalt-60	-2.29E-01	pCi/L	1.82E+00	15	U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Iodine-131	-6.49E-01	pCi/L	2.09E+00		U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Iron-59	-3.03E-02	pCi/L	3.16E+00	30	U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Lanthanum-140	-1.28E-01	pCi/L	1.91E+00	15	U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Manganese-54	-9.13E-01	pCi/L	1.49E+00	15	U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Niobium-95	-3.95E-02	pCi/L	1.54E+00	15	U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Potassium-40	2.50E+00	pCi/L	2.34E+01		U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Ruthenium-103	-1.19E+00	pCi/L	1.64E+00		U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Ruthenium-106	1.37E-01	pCi/L	1.52E+01		U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Selenium-75	1.56E+00	pCi/L	2.52E+00		U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Silver-108m	4.47E-01	pCi/L	1.56E+00		U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Silver-110m	3.53E-01	pCi/L	1.63E+00		U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Strontium-89	-8.14E-01	pCi/L	1.64E+00	10	U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Strontium-90	-2.51E-01	pCi/L	1.61E+00	2	U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Thorium-228	-1.87E+00	pCi/L	3.63E+00		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Tritium	-1.89E+02	pCi/L	4.94E+02	500	U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Zinc-65	3.76E-01	pCi/L	3.32E+00	30	U
Drinking Water	Indicator	DW-1	26-Mar-13	Composite	Zirconium-95	-3.02E-01	pCi/L	2.68E+00	15	U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Actinium-228	-1.91E-01	pCi/L	7.30E+00		U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Antimony-124	-5.42E-02	pCi/L	3.86E+00		U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Antimony-125	-7.15E-01	pCi/L	4.11E+00		U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Barium-140	1.03E-01	pCi/L	2.19E+00	15	U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Beryllium-7	2.47E-01	pCi/L	1.31E+01		U
Drinking Water	Control	DW-2	26-Mar-13	Composite	BETA	1.91E+00	pCi/L	2.81E+00	4	U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Cerium-141	1.54E+00	pCi/L	2.63E+00		U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Cerium-144	4.57E+00	pCi/L	1.06E+01		U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Cesium-134	3.50E-01	pCi/L	1.76E+00	15	U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Cesium-137	1.32E-01	pCi/L	1.65E+00	18	U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Chromium-51	-3.03E-01	pCi/L	1.27E+01		U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Cobalt-57	-2.28E-01	pCi/L	1.39E+00		U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Cobalt-58	-1.38E-01	pCi/L	1.38E+00	15	U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Cobalt-60	-3.66E-01	pCi/L	1.65E+00	15	U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Iodine-131	2.68E-01	pCi/L	1.95E+00		U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Iron-59	-5.02E-01	pCi/L	2.97E+00	30	U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Lanthanum-140	1.03E-01	pCi/L	2.19E+00	15	U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Manganese-54	1.41E+00	pCi/L	1.41E+00	15	UI
Drinking Water	Control	DW-2	26-Mar-13	Composite	Niobium-95	-2.20E-01	pCi/L	1.64E+00	15	U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Potassium-40	5.84E+00	pCi/L	1.58E+01		U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Ruthenium-103	8.06E-02	pCi/L	1.47E+00		U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Ruthenium-106	-9.07E+00	pCi/L	1.27E+01		U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Selenium-75	-4.78E-03	pCi/L	2.14E+00		U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Silver-108m	3.44E-01	pCi/L	1.39E+00		U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Silver-110m	-7.57E-01	pCi/L	1.38E+00		U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Strontium-89	-2.94E-01	pCi/L	2.04E+00	10	U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Strontium-90	-8.63E-01	pCi/L	1.78E+00	2	U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Thorium-228	7.45E-01	pCi/L	2.73E+00		U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Tritium	9.73E+00	pCi/L	4.42E+02	500	U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Zinc-65	1.62E+00	pCi/L	3.65E+00	30	U
Drinking Water	Control	DW-2	26-Mar-13	Composite	Zirconium-95	-3.57E-01	pCi/L	2.57E+00	15	U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Actinium-228	-1.11E+00	pCi/L	6.72E+00		U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Antimony-124	-7.06E-01	pCi/L	3.56E+00		U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Antimony-125	8.37E-01	pCi/L	4.52E+00		U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Barium-140	-1.49E-01	pCi/L	2.72E+00	15	U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Beryllium-7	-2.00E+00	pCi/L	1.38E+01		U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	BETA	8.56E-01	pCi/L	3.55E+00	4	U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Cerium-141	1.23E-01	pCi/L	3.10E+00		U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Cerium-144	5.90E+00	pCi/L	1.19E+01		U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Cesium-134	-7.99E-02	pCi/L	1.61E+00	15	U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Cesium-137	-1.10E+00	pCi/L	1.59E+00	18	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Chromium-51	-1.37E+00	pCi/L	1.62E+01		U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Cobalt-57	7.97E-01	pCi/L	1.60E+00		U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Cobalt-58	3.21E-01	pCi/L	1.63E+00	15	U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Cobalt-60	-2.25E+00	pCi/L	1.67E+00	15	U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Iodine-131	7.23E-01	pCi/L	2.82E+00		U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Iron-59	6.98E-01	pCi/L	3.12E+00	30	U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Lanthanum-140	-1.49E-01	pCi/L	2.72E+00	15	U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Manganese-54	-2.49E-01	pCi/L	1.52E+00	15	U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Niobium-95	1.19E-01	pCi/L	1.59E+00	15	U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Potassium-40	-4.50E+00	pCi/L	2.21E+01		U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Ruthenium-103	-5.43E-01	pCi/L	1.72E+00		U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Ruthenium-106	5.95E+00	pCi/L	1.44E+01		U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Selenium-75	-4.03E-01	pCi/L	2.29E+00		U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Silver-108m	2.89E-01	pCi/L	1.54E+00		U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Silver-110m	-1.54E-01	pCi/L	1.50E+00		U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Strontium-89	7.92E-01	pCi/L	1.79E+00	10	U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Strontium-90	7.26E-02	pCi/L	1.81E+00	2	U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Thorium-228	1.15E+00	pCi/L	3.12E+00		U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Zinc-65	8.59E-01	pCi/L	3.40E+00	30	U
Drinking Water	Indicator	DW-1	30-Apr-13	Composite	Zirconium-95	-6.57E-01	pCi/L	2.59E+00	15	U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Actinium-228	6.36E+00	pCi/L	6.36E+00		UI
Drinking Water	Control	DW-2	30-Apr-13	Composite	Antimony-124	2.73E+00	pCi/L	4.16E+00		U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Antimony-125	5.68E-01	pCi/L	4.04E+00		U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Barium-140	1.03E-01	pCi/L	2.69E+00	15	U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Beryllium-7	-2.55E+00	pCi/L	1.29E+01		U
Drinking Water	Control	DW-2	30-Apr-13	Composite	BETA	1.81E+00	pCi/L	3.53E+00	4	U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Cerium-141	2.53E-01	pCi/L	2.90E+00		U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Cerium-144	1.03E+00	pCi/L	1.10E+01		U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Cesium-134	7.57E-01	pCi/L	1.76E+00	15	U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Cesium-137	1.15E+00	pCi/L	1.74E+00	18	U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Chromium-51	-9.46E-01	pCi/L	1.46E+01		U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Cobalt-57	6.83E-01	pCi/L	1.45E+00		U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Cobalt-58	-4.89E-01	pCi/L	1.46E+00	15	U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Cobalt-60	-2.30E+00	pCi/L	1.97E+00	15	U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Iodine-131	7.39E-01	pCi/L	2.69E+00		U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Iron-59	5.52E-01	pCi/L	3.00E+00	30	U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Lanthanum-140	1.03E-01	pCi/L	2.69E+00	15	U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Manganese-54	-6.12E-01	pCi/L	1.42E+00	15	U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Niobium-95	-6.25E-01	pCi/L	1.48E+00	15	U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Potassium-40	-7.29E+00	pCi/L	2.01E+01		U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Ruthenium-103	2.23E-01	pCi/L	1.58E+00		U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Ruthenium-106	-2.96E+00	pCi/L	1.33E+01		U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Selenium-75	-1.02E+00	pCi/L	2.03E+00		U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Silver-108m	-7.99E-01	pCi/L	1.31E+00		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Drinking Water	Control	DW-2	30-Apr-13	Composite	Silver-110m	-3.79E-01	pCi/L	1.39E+00		U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Strontium-89	-7.46E-01	pCi/L	2.27E+00	10	U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Strontium-90	5.45E-01	pCi/L	1.79E+00	2	U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Thorium-228	2.67E+00	pCi/L	3.56E+00		U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Zinc-65	-5.93E-01	pCi/L	3.12E+00	30	U
Drinking Water	Control	DW-2	30-Apr-13	Composite	Zirconium-95	2.83E-02	pCi/L	2.66E+00	15	U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Actinium-228	-7.35E+00	pCi/L	1.13E+01		U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Antimony-124	1.81E+00	pCi/L	5.94E+00		U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Antimony-125	7.95E-01	pCi/L	7.95E+00		U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Barium-140	-1.15E+00	pCi/L	3.60E+00	15	U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Beryllium-7	-2.92E+00	pCi/L	2.28E+01		U
Drinking Water	Indicator	DW-1	28-May-13	Composite	BETA	2.32E+00	pCi/L	3.39E+00	4	U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Cerium-141	-1.44E+00	pCi/L	4.73E+00		U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Cerium-144	-1.77E+00	pCi/L	1.82E+01		U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Cesium-134	-9.94E-01	pCi/L	2.66E+00	15	U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Cesium-137	4.59E-01	pCi/L	2.83E+00	18	U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Chromium-51	-9.75E+00	pCi/L	2.50E+01		U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Cobalt-57	4.62E-01	pCi/L	2.51E+00		U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Cobalt-58	2.30E-01	pCi/L	2.90E+00	15	U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Cobalt-60	6.44E-01	pCi/L	3.05E+00	15	U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Iodine-131	-6.17E-01	pCi/L	3.38E+00		U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Iron-59	-3.02E+00	pCi/L	3.93E+00	30	U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Lanthanum-140	-1.15E+00	pCi/L	3.60E+00	15	U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Manganese-54	-5.72E-01	pCi/L	2.23E+00	15	U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Niobium-95	-1.08E+00	pCi/L	2.35E+00	15	U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Potassium-40	-1.25E+01	pCi/L	4.03E+01		U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Ruthenium-103	-6.95E-01	pCi/L	2.62E+00		U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Ruthenium-106	3.85E+00	pCi/L	2.38E+01		U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Selenium-75	-2.20E-01	pCi/L	3.85E+00		U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Silver-108m	-3.48E-01	pCi/L	2.26E+00		U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Silver-110m	-1.81E+00	pCi/L	2.17E+00		U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Strontium-89	-2.12E+00	pCi/L	1.56E+00	10	U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Strontium-90	-8.85E-01	pCi/L	1.62E+00	2	U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Thorium-228	-1.62E+00	pCi/L	5.98E+00		U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Zinc-65	-2.86E+00	pCi/L	5.22E+00	30	U
Drinking Water	Indicator	DW-1	28-May-13	Composite	Zirconium-95	1.15E+00	pCi/L	4.50E+00	15	U
Drinking Water	Control	DW-2	28-May-13	Composite	Actinium-228	5.35E+00	pCi/L	1.60E+01		U
Drinking Water	Control	DW-2	28-May-13	Composite	Antimony-124	1.92E-01	pCi/L	6.88E+00		U
Drinking Water	Control	DW-2	28-May-13	Composite	Antimony-125	1.42E+00	pCi/L	8.29E+00		U
Drinking Water	Control	DW-2	28-May-13	Composite	Barium-140	7.28E-02	pCi/L	4.02E+00	15	U
Drinking Water	Control	DW-2	28-May-13	Composite	Beryllium-7	-2.20E+00	pCi/L	2.20E+01		U
Drinking Water	Control	DW-2	28-May-13	Composite	BETA	-1.65E+00	pCi/L	3.43E+00	4	U
Drinking Water	Control	DW-2	28-May-13	Composite	Cerium-141	-1.41E-01	pCi/L	5.23E+00		U
Drinking Water	Control	DW-2	28-May-13	Composite	Cerium-144	5.24E+00	pCi/L	2.26E+01		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Drinking Water	Control	DW-2	28-May-13	Composite	Cesium-134	-1.12E+00	pCi/L	3.31E+00	15	U
Drinking Water	Control	DW-2	28-May-13	Composite	Cesium-137	-6.56E-01	pCi/L	3.42E+00	18	U
Drinking Water	Control	DW-2	28-May-13	Composite	Chromium-51	1.93E+00	pCi/L	2.86E+01		U
Drinking Water	Control	DW-2	28-May-13	Composite	Cobalt-57	-4.41E-01	pCi/L	2.88E+00		U
Drinking Water	Control	DW-2	28-May-13	Composite	Cobalt-58	-9.37E-01	pCi/L	2.82E+00	15	U
Drinking Water	Control	DW-2	28-May-13	Composite	Cobalt-60	-7.54E-01	pCi/L	2.40E+00	15	U
Drinking Water	Control	DW-2	28-May-13	Composite	Iodine-131	6.52E-01	pCi/L	3.90E+00		U
Drinking Water	Control	DW-2	28-May-13	Composite	Iron-59	2.35E-01	pCi/L	5.72E+00	30	U
Drinking Water	Control	DW-2	28-May-13	Composite	Lanthanum-140	7.28E-02	pCi/L	4.02E+00	15	U
Drinking Water	Control	DW-2	28-May-13	Composite	Manganese-54	1.92E+00	pCi/L	3.49E+00	15	U
Drinking Water	Control	DW-2	28-May-13	Composite	Niobium-95	1.12E+00	pCi/L	2.96E+00	15	U
Drinking Water	Control	DW-2	28-May-13	Composite	Potassium-40	-2.81E+01	pCi/L	3.87E+01		U
Drinking Water	Control	DW-2	28-May-13	Composite	Ruthenium-103	-2.95E-01	pCi/L	2.75E+00		U
Drinking Water	Control	DW-2	28-May-13	Composite	Ruthenium-106	5.45E-01	pCi/L	2.72E+01		U
Drinking Water	Control	DW-2	28-May-13	Composite	Selenium-75	8.61E-01	pCi/L	4.14E+00		U
Drinking Water	Control	DW-2	28-May-13	Composite	Silver-108m	2.86E+00	pCi/L	3.26E+00		U
Drinking Water	Control	DW-2	28-May-13	Composite	Silver-110m	1.68E+00	pCi/L	3.22E+00		U
Drinking Water	Control	DW-2	28-May-13	Composite	Strontium-89	-1.40E+00	pCi/L	1.69E+00	10	U
Drinking Water	Control	DW-2	28-May-13	Composite	Strontium-90	5.74E-02	pCi/L	1.64E+00	2	U
Drinking Water	Control	DW-2	28-May-13	Composite	Thorium-228	2.28E+00	pCi/L	6.93E+00		U
Drinking Water	Control	DW-2	28-May-13	Composite	Zinc-65	4.84E-01	pCi/L	5.44E+00	30	U
Drinking Water	Control	DW-2	28-May-13	Composite	Zirconium-95	1.43E+00	pCi/L	4.89E+00	15	U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Actinium-228	-1.11E+01	pCi/L	8.90E+00		U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Antimony-124	1.15E+00	pCi/L	5.23E+00		U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Antimony-125	5.89E-01	pCi/L	6.02E+00		U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Barium-140	1.49E+00	pCi/L	4.00E+00	15	U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Beryllium-7	-5.35E+00	pCi/L	1.92E+01		U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	BETA	2.85E+00	pCi/L	3.57E+00	4	U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Cerium-141	-2.84E+00	pCi/L	4.20E+00		U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Cerium-144	-1.35E+00	pCi/L	1.49E+01		U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Cesium-134	-1.26E+00	pCi/L	2.29E+00	15	U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Cesium-137	-4.66E-01	pCi/L	2.15E+00	18	U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Chromium-51	4.05E+00	pCi/L	2.12E+01		U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Cobalt-57	-9.75E-01	pCi/L	1.94E+00		U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Cobalt-58	-1.10E-01	pCi/L	2.21E+00	15	U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Cobalt-60	6.14E-01	pCi/L	2.25E+00	15	U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Iodine-131	-8.84E-01	pCi/L	4.10E+00		U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Iron-59	3.15E+00	pCi/L	4.77E+00	30	U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Lanthanum-140	1.49E+00	pCi/L	4.00E+00	15	U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Manganese-54	-6.72E-01	pCi/L	1.88E+00	15	U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Niobium-95	3.40E-01	pCi/L	2.21E+00	15	U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Potassium-40	1.23E+00	pCi/L	3.02E+01		U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Ruthenium-103	-1.55E+00	pCi/L	2.25E+00		U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Ruthenium-106	-9.59E-01	pCi/L	1.92E+01		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Selenium-75	-5.58E-01	pCi/L	3.01E+00		U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Silver-108m	7.96E-01	pCi/L	2.07E+00		U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Silver-110m	-3.53E-01	pCi/L	1.96E+00		U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Strontium-89	2.32E-02	pCi/L	4.11E+00	10	U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Strontium-90	1.29E+00	pCi/L	1.88E+00	2	U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Thorium-228	5.19E-01	pCi/L	5.62E+00		U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Tritium	9.00E+01	pCi/L	3.01E+02	500	U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Zinc-65	-1.83E+00	pCi/L	4.40E+00	30	U
Drinking Water	Indicator	DW-1	24-Jun-13	Composite	Zirconium-95	6.65E-01	pCi/L	4.11E+00	15	U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Actinium-228	-7.03E+00	pCi/L	7.51E+00		U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Antimony-124	2.37E+00	pCi/L	5.25E+00		U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Antimony-125	1.92E+00	pCi/L	5.17E+00		U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Barium-140	1.28E-01	pCi/L	3.30E+00	15	U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Beryllium-7	-3.35E+00	pCi/L	1.43E+01		U
Drinking Water	Control	DW-2	24-Jun-13	Composite	BETA	1.46E+00	pCi/L	2.23E+00	4	U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Cerium-141	9.88E-01	pCi/L	3.23E+00		U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Cerium-144	-7.44E+00	pCi/L	1.21E+01		U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Cesium-134	1.07E+00	pCi/L	2.03E+00	15	U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Cesium-137	1.45E-01	pCi/L	1.73E+00	18	U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Chromium-51	-4.07E+00	pCi/L	1.71E+01		U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Cobalt-57	1.28E-03	pCi/L	1.61E+00		U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Cobalt-58	1.27E+00	pCi/L	1.98E+00	15	U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Cobalt-60	-1.28E-01	pCi/L	1.84E+00	15	U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Iodine-131	8.32E-01	pCi/L	3.34E+00		U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Iron-59	-1.29E+00	pCi/L	3.45E+00	30	U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Lanthanum-140	1.28E-01	pCi/L	3.30E+00	15	U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Manganese-54	7.12E-01	pCi/L	1.89E+00	15	U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Niobium-95	5.80E-01	pCi/L	1.94E+00	15	U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Potassium-40	8.32E+00	pCi/L	1.90E+01		U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Ruthenium-103	-1.87E-01	pCi/L	1.76E+00		U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Ruthenium-106	-6.70E+00	pCi/L	1.53E+01		U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Selenium-75	5.78E-01	pCi/L	2.54E+00		U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Silver-108m	2.55E-01	pCi/L	1.64E+00		U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Silver-110m	-7.40E-01	pCi/L	1.49E+00		U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Strontium-89	-1.28E-01	pCi/L	3.07E+00	10	U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Strontium-90	7.95E-02	pCi/L	1.83E+00	2	U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Thorium-228	2.89E-01	pCi/L	3.69E+00		U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Tritium	-1.74E+01	pCi/L	3.05E+02	500	U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Zinc-65	-2.77E+00	pCi/L	3.10E+00	30	U
Drinking Water	Control	DW-2	24-Jun-13	Composite	Zirconium-95	-6.51E-01	pCi/L	3.13E+00	15	U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Actinium-228	-2.61E+00	pCi/L	1.18E+01		U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Antimony-124	1.72E+00	pCi/L	6.91E+00		U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Antimony-125	9.90E-01	pCi/L	7.78E+00		U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Barium-140	-3.26E-01	pCi/L	4.21E+00	15	U



Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Beryllium-7	-1.20E+00	pCi/L	2.38E+01		U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	BETA	-1.16E-01	pCi/L	2.64E+00	4	U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Cerium-141	-1.68E-01	pCi/L	5.27E+00		U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Cerium-144	8.56E+00	pCi/L	2.02E+01		U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Cesium-134	8.58E-01	pCi/L	3.19E+00	15	U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Cesium-137	1.51E+00	pCi/L	3.20E+00	18	U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Chromium-51	-7.01E+00	pCi/L	2.74E+01		U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Cobalt-57	-1.70E-01	pCi/L	2.52E+00		U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Cobalt-58	4.50E-01	pCi/L	3.30E+00	15	U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Cobalt-60	7.55E-02	pCi/L	2.67E+00	15	U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Iodine-131	-3.08E+00	pCi/L	6.34E+00		U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Iron-59	-2.73E+00	pCi/L	4.71E+00	30	U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Lanthanum-140	-3.26E-01	pCi/L	4.21E+00	15	U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Manganese-54	4.50E-01	pCi/L	2.91E+00	15	U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Niobium-95	-1.58E-01	pCi/L	3.06E+00	15	U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Potassium-40	-3.04E-01	pCi/L	4.04E+01		U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Ruthenium-103	7.05E-01	pCi/L	3.47E+00		U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Ruthenium-106	3.00E+00	pCi/L	2.63E+01		U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Selenium-75	-4.67E-01	pCi/L	4.04E+00		U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Silver-108m	1.48E+00	pCi/L	2.83E+00		U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Silver-110m	-7.82E-01	pCi/L	3.04E+00		U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Strontium-89	2.65E+00	pCi/L	4.02E+00	10	U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Strontium-90	-9.97E-01	pCi/L	1.70E+00	2	U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Thorium-228	2.84E+00	pCi/L	6.47E+00		U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Zinc-65	3.80E-01	pCi/L	5.20E+00	30	U
Drinking Water	Indicator	DW-1	30-Jul-13	Composite	Zirconium-95	-2.25E-02	pCi/L	4.91E+00	15	U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Actinium-228	-7.81E+00	pCi/L	1.07E+01		U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Antimony-124	-1.87E+00	pCi/L	5.25E+00		U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Antimony-125	-4.16E-01	pCi/L	7.82E+00		U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Barium-140	-2.52E+00	pCi/L	4.87E+00	15	U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Beryllium-7	1.02E+01	pCi/L	2.73E+01		U
Drinking Water	Control	DW-2	30-Jul-13	Composite	BETA	-3.04E-01	pCi/L	2.97E+00	4	U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Cerium-141	5.55E-01	pCi/L	5.35E+00		U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Cerium-144	2.57E+00	pCi/L	2.04E+01		U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Cesium-134	-1.74E+00	pCi/L	2.56E+00	15	U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Cesium-137	4.16E-01	pCi/L	2.82E+00	18	U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Chromium-51	8.50E+00	pCi/L	3.07E+01		U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Cobalt-57	-6.36E-01	pCi/L	2.61E+00		U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Cobalt-58	-3.19E-02	pCi/L	2.67E+00	15	U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Cobalt-60	-6.77E-01	pCi/L	2.87E+00	15	U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Iodine-131	2.04E+00	pCi/L	6.10E+00		U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Iron-59	6.08E-01	pCi/L	5.21E+00	30	U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Lanthanum-140	-2.52E+00	pCi/L	4.87E+00	15	U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Manganese-54	7.93E-01	pCi/L	3.18E+00	15	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Drinking Water	Control	DW-2	30-Jul-13	Composite	Niobium-95	1.05E+00	pCi/L	3.12E+00	15	U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Potassium-40	2.16E+01	pCi/L	2.16E+01		UI
Drinking Water	Control	DW-2	30-Jul-13	Composite	Ruthenium-103	-1.10E+00	pCi/L	2.86E+00		U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Ruthenium-106	5.09E+00	pCi/L	2.55E+01		U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Selenium-75	2.29E+00	pCi/L	4.29E+00		U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Silver-108m	1.38E+00	pCi/L	2.74E+00		U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Silver-110m	9.32E-01	pCi/L	2.63E+00		U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Strontium-89	-3.40E-01	pCi/L	2.94E+00	10	U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Strontium-90	3.66E-01	pCi/L	1.77E+00	2	U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Thorium-228	-3.05E+00	pCi/L	6.17E+00		U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Zinc-65	7.28E-02	pCi/L	6.42E+00	30	U
Drinking Water	Control	DW-2	30-Jul-13	Composite	Zirconium-95	3.76E-01	pCi/L	4.80E+00	15	U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Actinium-228	1.48E+00	pCi/L	1.02E+01		U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Antimony-124	-1.02E+00	pCi/L	5.41E+00		U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Antimony-125	4.36E-01	pCi/L	5.99E+00		U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Barium-140	1.95E+00	pCi/L	3.55E+00	15	U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Beryllium-7	4.32E-01	pCi/L	1.85E+01		U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	BETA	1.76E+00	pCi/L	2.07E+00	4	U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Cerium-141	-2.28E+00	pCi/L	3.68E+00		U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Cerium-144	2.16E+00	pCi/L	1.41E+01		U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Cesium-134	-1.99E-01	pCi/L	2.41E+00	15	U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Cesium-137	-6.72E-02	pCi/L	2.44E+00	18	U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Chromium-51	9.28E+00	pCi/L	2.01E+01		U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Cobalt-57	-9.63E-03	pCi/L	1.74E+00		U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Cobalt-58	-4.44E-01	pCi/L	2.14E+00	15	U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Cobalt-60	1.45E+00	pCi/L	2.63E+00	15	U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Iodine-131	-3.72E-01	pCi/L	3.38E+00		U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Iron-59	-8.22E-01	pCi/L	4.41E+00	30	U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Lanthanum-140	1.95E+00	pCi/L	3.55E+00	15	U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Manganese-54	-1.22E-02	pCi/L	2.00E+00	15	U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Niobium-95	-8.84E-01	pCi/L	1.98E+00	15	U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Potassium-40	6.28E+00	pCi/L	2.21E+01		U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Ruthenium-103	-4.40E-01	pCi/L	2.13E+00		U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Ruthenium-106	7.50E+00	pCi/L	2.08E+01		U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Selenium-75	1.72E+00	pCi/L	2.98E+00		U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Silver-108m	-7.31E-01	pCi/L	1.91E+00		U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Silver-110m	-1.12E+00	pCi/L	1.95E+00		U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Strontium-89	-1.27E+00	pCi/L	2.61E+00	10	U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Strontium-90	2.18E-01	pCi/L	1.37E+00	2	U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Thorium-228	1.19E+00	pCi/L	3.94E+00		U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Zinc-65	-3.78E+00	pCi/L	4.21E+00	30	U
Drinking Water	Indicator	DW-1	27-Aug-13	Composite	Zirconium-95	3.99E-02	pCi/L	4.02E+00	15	U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Actinium-228	5.09E-02	pCi/L	9.85E+00		U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Antimony-124	-4.53E-01	pCi/L	6.37E+00		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Drinking Water	Control	DW-2	27-Aug-13	Composite	Antimony-125	-2.12E+00	pCi/L	6.21E+00		U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Barium-140	-7.65E-03	pCi/L	3.04E+00	15	U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Beryllium-7	1.36E+01	pCi/L	1.96E+01		U
Drinking Water	Control	DW-2	27-Aug-13	Composite	BETA	2.10E+00	pCi/L	2.87E+00	4	U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Cerium-141	-1.00E+00	pCi/L	4.36E+00		U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Cerium-144	5.68E+00	pCi/L	1.72E+01		U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Cesium-134	7.16E-01	pCi/L	2.58E+00	15	U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Cesium-137	-4.36E-01	pCi/L	2.35E+00	18	U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Chromium-51	1.98E+00	pCi/L	2.25E+01		U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Cobalt-57	4.39E-01	pCi/L	2.20E+00		U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Cobalt-58	-1.55E+00	pCi/L	1.97E+00	15	U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Cobalt-60	6.99E-02	pCi/L	2.54E+00	15	U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Iodine-131	-7.22E-01	pCi/L	3.70E+00		U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Iron-59	1.08E+00	pCi/L	4.92E+00	30	U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Lanthanum-140	-7.65E-03	pCi/L	3.04E+00	15	U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Manganese-54	1.06E+00	pCi/L	2.44E+00	15	U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Niobium-95	-8.88E-02	pCi/L	2.23E+00	15	U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Potassium-40	4.55E+00	pCi/L	2.03E+01		U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Ruthenium-103	6.97E-01	pCi/L	2.36E+00		U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Ruthenium-106	-1.59E+00	pCi/L	2.19E+01		U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Selenium-75	-9.20E-01	pCi/L	3.18E+00		U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Silver-108m	1.29E+00	pCi/L	2.23E+00		U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Silver-110m	-2.57E-01	pCi/L	2.28E+00		U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Strontium-89	3.95E-01	pCi/L	1.98E+00	10	U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Strontium-90	6.74E-01	pCi/L	1.71E+00	2	U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Thorium-228	1.52E-01	pCi/L	4.52E+00		U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Zinc-65	-2.65E+00	pCi/L	4.41E+00	30	U
Drinking Water	Control	DW-2	27-Aug-13	Composite	Zirconium-95	-3.83E-01	pCi/L	4.26E+00	15	U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Actinium-228	-3.66E+00	pCi/L	6.83E+00		U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Antimony-124	1.34E+00	pCi/L	3.84E+00		U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Antimony-125	8.55E-01	pCi/L	4.28E+00		U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Barium-140	5.34E-01	pCi/L	2.26E+00	15	U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Beryllium-7	-3.37E+00	pCi/L	1.24E+01		U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	BETA	1.40E+00	pCi/L	3.58E+00	4	U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Cerium-141	-4.32E-01	pCi/L	2.61E+00		U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Cerium-144	2.39E+00	pCi/L	1.05E+01		U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Cesium-134	-1.57E-01	pCi/L	1.58E+00	15	U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Cesium-137	-2.98E-01	pCi/L	1.55E+00	18	U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Chromium-51	7.58E+00	pCi/L	1.46E+01		U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Cobalt-57	8.93E-02	pCi/L	1.38E+00		U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Cobalt-58	9.77E-02	pCi/L	1.56E+00	15	U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Cobalt-60	-5.64E-01	pCi/L	1.52E+00	15	U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Iodine-131	6.60E-01	pCi/L	2.18E+00		U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Iron-59	6.38E-01	pCi/L	3.17E+00	30	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Lanthanum-140	5.34E-01	pCi/L	2.26E+00	15	U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Manganese-54	1.56E-01	pCi/L	1.47E+00	15	U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Niobium-95	4.43E-01	pCi/L	1.66E+00	15	U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Potassium-40	3.35E+00	pCi/L	2.28E+01		U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Ruthenium-103	-7.32E-01	pCi/L	1.53E+00		U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Ruthenium-106	1.45E+00	pCi/L	1.45E+01		U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Selenium-75	1.13E-01	pCi/L	2.11E+00		U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Silver-108m	-7.43E-01	pCi/L	1.38E+00		U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Silver-110m	7.59E-02	pCi/L	1.47E+00		U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Strontium-89	-1.68E+00	pCi/L	1.80E+00	10	U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Strontium-90	-4.63E-01	pCi/L	1.65E+00	2	U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Thorium-228	1.31E+00	pCi/L	3.34E+00		U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Tritium	2.61E+02	pCi/L	3.95E+02	500	U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Zinc-65	-2.85E+00	pCi/L	3.03E+00	30	U
Drinking Water	Indicator	DW-1	24-Sep-13	Composite	Zirconium-95	2.60E-01	pCi/L	2.70E+00	15	U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Actinium-228	-3.44E+00	pCi/L	6.57E+00		U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Antimony-124	1.43E+00	pCi/L	3.89E+00		U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Antimony-125	3.49E-01	pCi/L	4.70E+00		U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Barium-140	7.43E-02	pCi/L	2.18E+00	15	U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Beryllium-7	-3.44E+00	pCi/L	1.31E+01		U
Drinking Water	Control	DW-2	24-Sep-13	Composite	BETA	-8.20E-01	pCi/L	3.75E+00	4	U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Cerium-141	1.38E+00	pCi/L	2.95E+00		U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Cerium-144	3.43E+00	pCi/L	1.13E+01		U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Cesium-134	1.20E+00	pCi/L	1.80E+00	15	U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Cesium-137	-5.78E-01	pCi/L	2.19E+00	18	U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Chromium-51	6.98E-01	pCi/L	1.47E+01		U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Cobalt-57	4.74E-02	pCi/L	1.48E+00		U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Cobalt-58	5.36E-01	pCi/L	1.54E+00	15	U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Cobalt-60	4.29E-01	pCi/L	1.72E+00	15	U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Iodine-131	-4.75E-01	pCi/L	2.30E+00		U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Iron-59	-4.11E-01	pCi/L	3.07E+00	30	U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Lanthanum-140	7.43E-02	pCi/L	2.18E+00	15	U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Manganese-54	-3.22E-01	pCi/L	1.47E+00	15	U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Niobium-95	4.52E-01	pCi/L	1.55E+00	15	U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Potassium-40	2.38E+00	pCi/L	1.79E+01		U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Ruthenium-103	4.75E-01	pCi/L	1.63E+00		U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Ruthenium-106	1.28E+00	pCi/L	1.42E+01		U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Selenium-75	3.88E-03	pCi/L	2.31E+00		U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Silver-108m	-3.39E-01	pCi/L	1.45E+00		U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Silver-110m	-2.31E+00	pCi/L	1.52E+00		U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Strontium-89	-9.19E-01	pCi/L	2.62E+00	10	U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Strontium-90	6.67E-02	pCi/L	1.67E+00	2	U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Thorium-228	-5.97E-01	pCi/L	3.59E+00		U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Tritium	-4.36E+01	pCi/L	3.84E+02	500	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Drinking Water	Control	DW-2	24-Sep-13	Composite	Zinc-65	6.41E-01	pCi/L	3.55E+00	30	U
Drinking Water	Control	DW-2	24-Sep-13	Composite	Zirconium-95	-1.83E+00	pCi/L	2.68E+00	15	U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Actinium-228	-3.73E+00	pCi/L	8.29E+00		U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Antimony-124	-1.11E-01	pCi/L	4.62E+00		U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Antimony-125	2.84E+00	pCi/L	5.68E+00		U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Barium-140	1.52E+00	pCi/L	2.98E+00	15	U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Beryllium-7	5.37E+00	pCi/L	1.72E+01		U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	BETA	1.25E+00	pCi/L	2.63E+00	4	U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Cerium-141	8.92E-01	pCi/L	3.43E+00		U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Cerium-144	-5.93E+00	pCi/L	1.33E+01		U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Cesium-134	6.72E-01	pCi/L	2.23E+00	15	U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Cesium-137	-1.98E+00	pCi/L	2.39E+00	18	U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Chromium-51	2.03E+00	pCi/L	1.78E+01		U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Cobalt-57	-1.27E-01	pCi/L	1.71E+00		U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Cobalt-58	3.72E-01	pCi/L	2.04E+00	15	U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Cobalt-60	-2.52E-01	pCi/L	1.81E+00	15	U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Iodine-131	-3.13E+00	pCi/L	2.28E+00		U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Iron-59	-6.96E-01	pCi/L	3.58E+00	30	U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Lanthanum-140	1.52E+00	pCi/L	2.98E+00	15	U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Manganese-54	-1.20E+00	pCi/L	1.73E+00	15	U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Niobium-95	1.22E+00	pCi/L	2.06E+00	15	U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Potassium-40	2.85E+00	pCi/L	2.86E+01		U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Ruthenium-103	-5.85E-01	pCi/L	1.97E+00		U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Ruthenium-106	4.46E+00	pCi/L	1.80E+01		U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Selenium-75	2.29E-01	pCi/L	2.77E+00		U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Silver-108m	5.18E-01	pCi/L	1.97E+00		U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Silver-110m	-1.25E+00	pCi/L	1.85E+00		U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Strontium-89	3.02E-01	pCi/L	1.73E+00	10	U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Strontium-90	8.70E-02	pCi/L	1.79E+00	2	U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Thorium-228	-8.71E-01	pCi/L	4.57E+00		U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Zinc-65	-1.30E+00	pCi/L	4.24E+00	30	U
Drinking Water	Indicator	DW-1	29-Oct-13	Composite	Zirconium-95	4.88E-01	pCi/L	3.47E+00	15	U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Actinium-228	5.12E+00	pCi/L	7.07E+00		U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Antimony-124	-2.67E-01	pCi/L	5.07E+00		U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Antimony-125	-1.58E+00	pCi/L	5.23E+00		U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Barium-140	-1.33E+00	pCi/L	2.51E+00	15	U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Beryllium-7	2.30E+00	pCi/L	1.82E+01		U
Drinking Water	Control	DW-2	29-Oct-13	Composite	BETA	1.63E+00	pCi/L	3.65E+00	4	U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Cerium-141	-1.05E+00	pCi/L	3.03E+00		U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Cerium-144	-1.01E+00	pCi/L	1.31E+01		U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Cesium-134	8.00E-01	pCi/L	2.15E+00	15	U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Cesium-137	4.16E-01	pCi/L	2.11E+00	18	U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Chromium-51	3.20E+00	pCi/L	1.79E+01		U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Cobalt-57	1.03E-02	pCi/L	1.72E+00		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Drinking Water	Control	DW-2	29-Oct-13	Composite	Cobalt-58	1.60E+00	pCi/L	1.80E+00	15	U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Cobalt-60	3.11E-01	pCi/L	2.08E+00	15	U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Iodine-131	-7.07E-01	pCi/L	2.32E+00		U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Iron-59	1.99E+00	pCi/L	3.81E+00	30	U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Lanthanum-140	-1.33E+00	pCi/L	2.51E+00	15	U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Manganese-54	-4.74E-01	pCi/L	1.67E+00	15	U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Niobium-95	7.78E-01	pCi/L	2.11E+00	15	U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Potassium-40	2.51E+01	pCi/L	2.18E+01		
Drinking Water	Control	DW-2	29-Oct-13	Composite	Ruthenium-103	-1.80E+00	pCi/L	1.81E+00		U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Ruthenium-106	-5.98E+00	pCi/L	1.52E+01		U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Selenium-75	-1.58E+00	pCi/L	2.41E+00		U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Silver-108m	-8.18E-01	pCi/L	1.72E+00		U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Silver-110m	-2.37E-01	pCi/L	1.89E+00		U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Strontium-89	-1.46E+00	pCi/L	2.18E+00	10	U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Strontium-90	-4.07E-01	pCi/L	1.75E+00	2	U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Thorium-228	1.70E+00	pCi/L	3.52E+00		U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Zinc-65	-6.55E-01	pCi/L	4.19E+00	30	U
Drinking Water	Control	DW-2	29-Oct-13	Composite	Zirconium-95	-8.73E-01	pCi/L	3.33E+00	15	U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Actinium-228	4.15E-01	pCi/L	7.40E+00		U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Antimony-124	1.24E+00	pCi/L	5.04E+00		U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Antimony-125	9.62E-02	pCi/L	5.39E+00		U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Barium-140	1.19E+00	pCi/L	3.67E+00	15	U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Beryllium-7	6.30E+00	pCi/L	1.81E+01		U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	BETA	1.69E+00	pCi/L	2.11E+00	4	U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Cerium-141	8.55E-01	pCi/L	3.83E+00		U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Cerium-144	-4.16E+00	pCi/L	1.35E+01		U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Cesium-134	-3.01E-01	pCi/L	2.10E+00	15	U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Cesium-137	2.08E-01	pCi/L	2.80E+00	18	U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Chromium-51	-3.87E+00	pCi/L	1.90E+01		U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Cobalt-57	6.13E-02	pCi/L	1.85E+00		U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Cobalt-58	-2.94E-01	pCi/L	2.02E+00	15	U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Cobalt-60	-4.09E-01	pCi/L	1.92E+00	15	U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Iodine-131	-2.19E+00	pCi/L	3.58E+00		U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Iron-59	8.75E-01	pCi/L	3.94E+00	30	U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Lanthanum-140	1.19E+00	pCi/L	3.67E+00	15	U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Manganese-54	7.68E-01	pCi/L	2.12E+00	15	U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Niobium-95	1.47E+00	pCi/L	2.19E+00	15	U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Potassium-40	2.73E+01	pCi/L	2.73E+01		UI
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Ruthenium-103	-7.49E-01	pCi/L	2.15E+00		U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Ruthenium-106	2.77E+00	pCi/L	1.88E+01		U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Selenium-75	7.36E-01	pCi/L	2.83E+00		U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Silver-108m	2.16E-01	pCi/L	1.84E+00		U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Silver-110m	-3.08E+00	pCi/L	1.81E+00		U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Strontium-89	-3.79E+00	pCi/L	2.77E+00	10	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Strontium-90	-1.21E+00	pCi/L	1.86E+00	2	U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Thorium-228	2.65E+00	pCi/L	3.68E+00		U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Zinc-65	-3.30E+00	pCi/L	4.25E+00	30	U
Drinking Water	Indicator	DW-1	26-Nov-13	Composite	Zirconium-95	4.35E-02	pCi/L	3.39E+00	15	U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Actinium-228	-4.27E+00	pCi/L	8.13E+00		U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Antimony-124	1.75E+00	pCi/L	4.48E+00		U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Antimony-125	2.29E+00	pCi/L	5.25E+00		U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Barium-140	6.92E-01	pCi/L	3.47E+00	15	U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Beryllium-7	-5.60E+00	pCi/L	1.65E+01		U
Drinking Water	Control	DW-2	26-Nov-13	Composite	BETA	7.31E-01	pCi/L	2.84E+00	4	U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Cerium-141	-1.24E+00	pCi/L	3.22E+00		U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Cerium-144	-6.10E+00	pCi/L	1.20E+01		U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Cesium-134	2.29E+00	pCi/L	2.29E+00	15	UI
Drinking Water	Control	DW-2	26-Nov-13	Composite	Cesium-137	-8.37E-02	pCi/L	1.87E+00	18	U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Chromium-51	5.58E-01	pCi/L	1.92E+01		U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Cobalt-57	1.44E-01	pCi/L	1.65E+00		U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Cobalt-58	-5.23E-01	pCi/L	1.64E+00	15	U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Cobalt-60	6.00E-01	pCi/L	1.95E+00	15	U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Iodine-131	-6.64E-01	pCi/L	3.53E+00		U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Iron-59	-1.76E+00	pCi/L	3.75E+00	30	U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Lanthanum-140	6.92E-01	pCi/L	3.47E+00	15	U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Manganese-54	4.51E-02	pCi/L	2.02E+00	15	U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Niobium-95	5.27E-01	pCi/L	2.05E+00	15	U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Potassium-40	1.46E+01	pCi/L	1.92E+01		U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Ruthenium-103	-1.17E+00	pCi/L	1.96E+00		U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Ruthenium-106	7.80E-01	pCi/L	1.75E+01		U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Selenium-75	-6.20E-01	pCi/L	2.51E+00		U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Silver-108m	-1.20E-01	pCi/L	1.71E+00		U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Silver-110m	-3.95E-01	pCi/L	1.63E+00		U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Strontium-89	-2.06E+00	pCi/L	2.52E+00	10	U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Strontium-90	9.56E-01	pCi/L	1.87E+00	2	U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Thorium-228	7.50E-01	pCi/L	4.13E+00		U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Zinc-65	5.53E-01	pCi/L	4.14E+00	30	U
Drinking Water	Control	DW-2	26-Nov-13	Composite	Zirconium-95	4.74E-01	pCi/L	3.36E+00	15	U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Actinium-228	-7.61E+00	pCi/L	1.18E+01		U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Antimony-124	-2.02E+00	pCi/L	8.23E+00		U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Antimony-125	-2.90E+00	pCi/L	7.92E+00		U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Barium-140	-1.89E+00	pCi/L	5.13E+00	15	U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Beryllium-7	-1.03E+00	pCi/L	2.65E+01		U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	BETA	1.51E+00	pCi/L	2.61E+00	4	U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Cerium-141	1.56E+00	pCi/L	6.30E+00		U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Cerium-144	-5.01E+00	pCi/L	2.26E+01		U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Cesium-134	1.32E+00	pCi/L	4.04E+00	15	U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Cesium-137	7.57E-01	pCi/L	3.65E+00	18	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Chromium-51	-2.45E+01	pCi/L	2.72E+01		U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Cobalt-57	-1.14E+00	pCi/L	2.99E+00		U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Cobalt-58	-3.77E-01	pCi/L	3.39E+00	15	U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Cobalt-60	2.74E-01	pCi/L	3.71E+00	15	U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Iodine-131	9.83E-01	pCi/L	6.35E+00		U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Iron-59	-1.09E-01	pCi/L	7.45E+00	30	U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Lanthanum-140	-1.89E+00	pCi/L	5.13E+00	15	U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Manganese-54	2.29E+00	pCi/L	3.64E+00	15	U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Niobium-95	-1.80E+00	pCi/L	3.06E+00	15	U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Potassium-40	1.18E+01	pCi/L	3.61E+01		U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Ruthenium-103	6.65E-01	pCi/L	3.70E+00		U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Ruthenium-106	1.99E+01	pCi/L	3.13E+01		U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Selenium-75	-2.29E+00	pCi/L	3.94E+00		U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Silver-108m	2.61E-02	pCi/L	2.88E+00		U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Silver-110m	1.06E+00	pCi/L	3.43E+00		U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Strontium-89	-8.28E-01	pCi/L	2.39E+00	10	U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Strontium-90	5.09E-01	pCi/L	1.74E+00	2	U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Thorium-228	9.22E-01	pCi/L	6.65E+00		U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Tritium	1.75E+02	pCi/L	3.85E+02	500	U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Zinc-65	-3.34E+00	pCi/L	5.57E+00	30	U
Drinking Water	Indicator	DW-1	30-Dec-13	Composite	Zirconium-95	2.24E+00	pCi/L	6.35E+00	15	U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Actinium-228	8.21E+00	pCi/L	2.05E+01		U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Antimony-124	4.80E-01	pCi/L	1.01E+01		U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Antimony-125	-1.85E+00	pCi/L	1.17E+01		U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Barium-140	4.82E-01	pCi/L	7.91E+00	15	U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Beryllium-7	1.01E+01	pCi/L	4.31E+01		U
Drinking Water	Control	DW-2	30-Dec-13	Composite	BETA	1.52E+00	pCi/L	2.28E+00	4	U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Cerium-141	-2.16E+00	pCi/L	8.98E+00		U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Cerium-144	-1.37E+00	pCi/L	3.50E+01		U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Cesium-134	1.03E-02	pCi/L	5.14E+00	15	U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Cesium-137	-2.43E+00	pCi/L	3.65E+00	18	U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Chromium-51	-1.88E+00	pCi/L	4.47E+01		U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Cobalt-57	1.67E+00	pCi/L	4.65E+00		U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Cobalt-58	-1.15E+00	pCi/L	4.20E+00	15	U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Cobalt-60	-8.85E-01	pCi/L	4.45E+00	15	U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Iodine-131	5.00E+00	pCi/L	9.50E+00		U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Iron-59	-1.51E+00	pCi/L	7.83E+00	30	U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Lanthanum-140	4.82E-01	pCi/L	7.91E+00	15	U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Manganese-54	-1.94E+00	pCi/L	3.95E+00	15	U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Niobium-95	7.73E-01	pCi/L	4.42E+00	15	U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Potassium-40	7.89E+00	pCi/L	5.93E+01		U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Ruthenium-103	2.12E-01	pCi/L	5.18E+00		U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Ruthenium-106	1.33E+00	pCi/L	3.97E+01		U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Selenium-75	-2.58E+00	pCi/L	6.22E+00		U



Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Drinking Water	Control	DW-2	30-Dec-13	Composite	Silver-108m	4.37E-02	pCi/L	3.92E+00		U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Silver-110m	-1.01E+00	pCi/L	3.93E+00		U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Strontium-89	5.40E-01	pCi/L	2.74E+00	10	U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Strontium-90	-1.41E-01	pCi/L	1.65E+00	2	U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Thorium-228	2.92E+00	pCi/L	9.98E+00		U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Tritium	7.66E+01	pCi/L	3.74E+02	500	U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Zinc-65	3.61E+00	pCi/L	1.09E+01	30	U
Drinking Water	Control	DW-2	30-Dec-13	Composite	Zirconium-95	6.74E-01	pCi/L	8.08E+00	15	U
Fish	Control	F-1	25-Oct-13	Bass	Actinium-228	-1.13E+01	pCi/kg	1.39E+01		U
Fish	Control	F-1	25-Oct-13	Bass	Antimony-124	-8.14E+00	pCi/kg	1.20E+01		U
Fish	Control	F-1	25-Oct-13	Bass	Antimony-125	-1.09E+00	pCi/kg	8.04E+00		U
Fish	Control	F-1	25-Oct-13	Bass	Barium-140	4.21E+01	pCi/kg	3.87E+02		U
Fish	Control	F-1	25-Oct-13	Bass	Beryllium-7	2.09E+01	pCi/kg	5.44E+01		U
Fish	Control	F-1	25-Oct-13	Bass	Cerium-141	8.29E+00	pCi/kg	1.57E+01		U
Fish	Control	F-1	25-Oct-13	Bass	Cerium-144	-4.72E+00	pCi/kg	1.88E+01		U
Fish	Control	F-1	25-Oct-13	Bass	Cesium-134	1.43E+00	pCi/kg	3.99E+00	60	U
Fish	Control	F-1	25-Oct-13	Bass	Cesium-137	2.94E+00	pCi/kg	2.94E+00	80	UI
Fish	Control	F-1	25-Oct-13	Bass	Chromium-51	-3.31E+01	pCi/kg	1.12E+02		U
Fish	Control	F-1	25-Oct-13	Bass	Cobalt-57	-1.26E-01	pCi/kg	2.46E+00		U
Fish	Control	F-1	25-Oct-13	Bass	Cobalt-58	1.54E+00	pCi/kg	5.67E+00	130	U
Fish	Control	F-1	25-Oct-13	Bass	Cobalt-60	-1.34E-02	pCi/kg	3.54E+00	130	U
Fish	Control	F-1	25-Oct-13	Bass	Iodine-131	-2.49E+02	pCi/kg	8.57E+02	60	DLU
Fish	Control	F-1	25-Oct-13	Bass	Iron-59	2.64E-02	pCi/kg	2.01E+01	260	U
Fish	Control	F-1	25-Oct-13	Bass	Lanthanum-140	-1.24E+01	pCi/kg	1.21E+02		U
Fish	Control	F-1	25-Oct-13	Bass	Manganese-54	-3.75E-02	pCi/kg	3.76E+00	130	U
Fish	Control	F-1	25-Oct-13	Bass	Niobium-95	4.44E+00	pCi/kg	6.25E+00		U
Fish	Control	F-1	25-Oct-13	Bass	Potassium-40	3.55E+03	pCi/kg	2.75E+01		
Fish	Control	F-1	25-Oct-13	Bass	Ruthenium-103	3.87E+00	pCi/kg	8.82E+00		U
Fish	Control	F-1	25-Oct-13	Bass	Ruthenium-106	-1.21E+01	pCi/kg	3.04E+01		U
Fish	Control	F-1	25-Oct-13	Bass	Selenium-75	9.03E-01	pCi/kg	5.20E+00		U
Fish	Control	F-1	25-Oct-13	Bass	Silver-108m	4.88E-01	pCi/kg	2.64E+00		U
Fish	Control	F-1	25-Oct-13	Bass	Silver-110m	3.96E-01	pCi/kg	5.23E+00		U
Fish	Control	F-1	25-Oct-13	Bass	Strontium-89	7.69E+00	pCi/kg	1.39E+02	300	U
Fish	Control	F-1	25-Oct-13	Bass	Strontium-90	-1.45E+01	pCi/kg	1.07E+02	300	U
Fish	Control	F-1	25-Oct-13	Bass	Thorium-228	1.41E-01	pCi/kg	4.83E+00		U
Fish	Control	F-1	25-Oct-13	Bass	Zinc-65	3.16E+00	pCi/kg	9.62E+00	260	U
Fish	Control	F-1	25-Oct-13	Bass	Zirconium-95	2.45E+00	pCi/kg	1.07E+01		U
Fish	Control	F-1	25-Oct-13	Carp	Actinium-228	1.54E+00	pCi/kg	1.33E+01		U
Fish	Control	F-1	25-Oct-13	Carp	Antimony-124	6.82E-01	pCi/kg	1.24E+01		U
Fish	Control	F-1	25-Oct-13	Carp	Antimony-125	4.08E-01	pCi/kg	8.35E+00		U
Fish	Control	F-1	25-Oct-13	Carp	Barium-140	2.95E+02	pCi/kg	4.11E+02		U
Fish	Control	F-1	25-Oct-13	Carp	Beryllium-7	1.81E+01	pCi/kg	5.73E+01		U
Fish	Control	F-1	25-Oct-13	Carp	Cerium-141	-4.90E+00	pCi/kg	1.82E+01		U
Fish	Control	F-1	25-Oct-13	Carp	Cerium-144	-1.01E+01	pCi/kg	2.08E+01		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Fish	Control	F-1	25-Oct-13	Carp	Cesium-134	-8.09E-01	pCi/kg	3.55E+00	60	U
Fish	Control	F-1	25-Oct-13	Carp	Cesium-137	1.09E+00	pCi/kg	3.36E+00	80	U
Fish	Control	F-1	25-Oct-13	Carp	Chromium-51	-6.57E+01	pCi/kg	1.29E+02		U
Fish	Control	F-1	25-Oct-13	Carp	Cobalt-57	1.55E+00	pCi/kg	2.88E+00		U
Fish	Control	F-1	25-Oct-13	Carp	Cobalt-58	-2.58E+00	pCi/kg	5.49E+00	130	U
Fish	Control	F-1	25-Oct-13	Carp	Cobalt-60	1.82E-02	pCi/kg	3.78E+00	130	U
Fish	Control	F-1	25-Oct-13	Carp	Iodine-131	-2.12E+02	pCi/kg	9.21E+02	60	DLU
Fish	Control	F-1	25-Oct-13	Carp	Iron-59	2.98E+00	pCi/kg	1.94E+01	260	U
Fish	Control	F-1	25-Oct-13	Carp	Lanthanum-140	-2.09E+01	pCi/kg	1.18E+02		U
Fish	Control	F-1	25-Oct-13	Carp	Manganese-54	1.33E+00	pCi/kg	3.63E+00	130	U
Fish	Control	F-1	25-Oct-13	Carp	Niobium-95	3.18E+00	pCi/kg	6.12E+00		U
Fish	Control	F-1	25-Oct-13	Carp	Potassium-40	2.92E+03	pCi/kg	3.06E+01		
Fish	Control	F-1	25-Oct-13	Carp	Ruthenium-103	-2.42E+00	pCi/kg	8.69E+00		U
Fish	Control	F-1	25-Oct-13	Carp	Ruthenium-106	-2.29E+00	pCi/kg	3.03E+01		U
Fish	Control	F-1	25-Oct-13	Carp	Selenium-75	1.77E+00	pCi/kg	5.75E+00		U
Fish	Control	F-1	25-Oct-13	Carp	Silver-108m	-4.71E-01	pCi/kg	2.60E+00		U
Fish	Control	F-1	25-Oct-13	Carp	Silver-110m	2.35E-01	pCi/kg	4.92E+00		U
Fish	Control	F-1	25-Oct-13	Carp	Strontium-89	1.14E+01	pCi/kg	1.56E+02	300	U
Fish	Control	F-1	25-Oct-13	Carp	Strontium-90	-1.48E+01	pCi/kg	1.02E+02	300	U
Fish	Control	F-1	25-Oct-13	Carp	Thorium-228	2.09E-01	pCi/kg	5.13E+00		U
Fish	Control	F-1	25-Oct-13	Carp	Zinc-65	-1.49E+00	pCi/kg	9.40E+00	260	U
Fish	Control	F-1	25-Oct-13	Carp	Zirconium-95	1.74E+00	pCi/kg	1.10E+01		U
Fish	Indicator	F-2	21-Nov-13	Carp	Actinium-228	-1.28E+01	pCi/kg	1.26E+01		U
Fish	Indicator	F-2	21-Nov-13	Carp	Antimony-124	4.09E+00	pCi/kg	9.25E+00		U
Fish	Indicator	F-2	21-Nov-13	Carp	Antimony-125	2.45E+00	pCi/kg	7.38E+00		U
Fish	Indicator	F-2	21-Nov-13	Carp	Barium-140	4.40E+01	pCi/kg	8.67E+01		U
Fish	Indicator	F-2	21-Nov-13	Carp	Beryllium-7	9.02E+00	pCi/kg	3.51E+01		U
Fish	Indicator	F-2	21-Nov-13	Carp	Cerium-141	-3.20E+00	pCi/kg	7.69E+00		U
Fish	Indicator	F-2	21-Nov-13	Carp	Cerium-144	7.07E+00	pCi/kg	1.59E+01		U
Fish	Indicator	F-2	21-Nov-13	Carp	Cesium-134	-8.00E-01	pCi/kg	3.33E+00	60	U
Fish	Indicator	F-2	21-Nov-13	Carp	Cesium-137	2.97E+00	pCi/kg	2.97E+00	80	UI
Fish	Indicator	F-2	21-Nov-13	Carp	Chromium-51	-9.77E+00	pCi/kg	5.39E+01		U
Fish	Indicator	F-2	21-Nov-13	Carp	Cobalt-57	9.78E-01	pCi/kg	2.05E+00		U
Fish	Indicator	F-2	21-Nov-13	Carp	Cobalt-58	-5.58E-01	pCi/kg	3.84E+00	130	U
Fish	Indicator	F-2	21-Nov-13	Carp	Cobalt-60	9.27E-01	pCi/kg	3.53E+00	130	U
Fish	Indicator	F-2	21-Nov-13	Carp	Iodine-131	-4.96E+00	pCi/kg	8.03E+01	60	DLU
Fish	Indicator	F-2	21-Nov-13	Carp	Iron-59	-1.18E+00	pCi/kg	1.19E+01	260	U
Fish	Indicator	F-2	21-Nov-13	Carp	Lanthanum-140	-8.54E+00	pCi/kg	2.52E+01		U
Fish	Indicator	F-2	21-Nov-13	Carp	Manganese-54	5.53E-01	pCi/kg	3.27E+00	130	U
Fish	Indicator	F-2	21-Nov-13	Carp	Niobium-95	7.40E-01	pCi/kg	4.22E+00		U
Fish	Indicator	F-2	21-Nov-13	Carp	Potassium-40	2.86E+03	pCi/kg	2.67E+01		
Fish	Indicator	F-2	21-Nov-13	Carp	Ruthenium-103	2.64E+00	pCi/kg	5.02E+00		U
Fish	Indicator	F-2	21-Nov-13	Carp	Ruthenium-106	8.00E+00	pCi/kg	2.69E+01		U
Fish	Indicator	F-2	21-Nov-13	Carp	Selenium-75	-6.20E-03	pCi/kg	4.06E+00		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Fish	Indicator	F-2	21-Nov-13	Carp	Silver-108m	-4.32E-01	pCi/kg	2.25E+00		U
Fish	Indicator	F-2	21-Nov-13	Carp	Silver-110m	6.66E-01	pCi/kg	4.52E+00		U
Fish	Indicator	F-2	21-Nov-13	Carp	Strontium-89	-8.57E+01	pCi/kg	1.23E+02	300	U
Fish	Indicator	F-2	21-Nov-13	Carp	Strontium-90	3.91E+01	pCi/kg	7.94E+01	300	U
Fish	Indicator	F-2	21-Nov-13	Carp	Thorium-228	1.11E+00	pCi/kg	5.17E+00		U
Fish	Indicator	F-2	21-Nov-13	Carp	Zinc-65	-6.21E+00	pCi/kg	8.06E+00	260	U
Fish	Indicator	F-2	21-Nov-13	Carp	Zirconium-95	2.11E+00	pCi/kg	7.70E+00		U
Fish	Control	F-3	08-May-13	Channel Catfish	Actinium-228	2.53E+01	pCi/kg	3.71E+01		U
Fish	Control	F-3	08-May-13	Channel Catfish	Antimony-124	4.55E-01	pCi/kg	2.88E+01		U
Fish	Control	F-3	08-May-13	Channel Catfish	Antimony-125	8.32E+00	pCi/kg	2.34E+01		U
Fish	Control	F-3	08-May-13	Channel Catfish	Barium-140	3.60E+02	pCi/kg	3.60E+02		UI
Fish	Control	F-3	08-May-13	Channel Catfish	Beryllium-7	3.98E+01	pCi/kg	1.25E+02		U
Fish	Control	F-3	08-May-13	Channel Catfish	Cerium-141	2.14E+01	pCi/kg	3.05E+01		U
Fish	Control	F-3	08-May-13	Channel Catfish	Cerium-144	-2.40E+00	pCi/kg	5.31E+01		U
Fish	Control	F-3	08-May-13	Channel Catfish	Cesium-134	1.69E+00	pCi/kg	9.69E+00	60	U
Fish	Control	F-3	08-May-13	Channel Catfish	Cesium-137	2.57E+00	pCi/kg	9.31E+00	80	U
Fish	Control	F-3	08-May-13	Channel Catfish	Chromium-51	3.83E+01	pCi/kg	2.06E+02		U
Fish	Control	F-3	08-May-13	Channel Catfish	Cobalt-57	2.87E+00	pCi/kg	6.90E+00		U
Fish	Control	F-3	08-May-13	Channel Catfish	Cobalt-58	-5.81E+00	pCi/kg	1.12E+01	130	U
Fish	Control	F-3	08-May-13	Channel Catfish	Cobalt-60	8.97E+00	pCi/kg	1.01E+01	130	U
Fish	Control	F-3	08-May-13	Channel Catfish	Iodine-131	2.47E+02	pCi/kg	3.56E+02	60	DL
Fish	Control	F-3	08-May-13	Channel Catfish	Iron-59	-5.42E+00	pCi/kg	3.04E+01	260	U
Fish	Control	F-3	08-May-13	Channel Catfish	Lanthanum-140	4.67E+01	pCi/kg	1.07E+02		U
Fish	Control	F-3	08-May-13	Channel Catfish	Manganese-54	-2.83E+00	pCi/kg	9.22E+00	130	U
Fish	Control	F-3	08-May-13	Channel Catfish	Niobium-95	7.90E-01	pCi/kg	1.30E+01		U
Fish	Control	F-3	08-May-13	Channel Catfish	Potassium-40	2.47E+03	pCi/kg	7.99E+01		
Fish	Control	F-3	08-May-13	Channel Catfish	Ruthenium-103	-5.69E+00	pCi/kg	1.69E+01		U
Fish	Control	F-3	08-May-13	Channel Catfish	Ruthenium-106	-1.96E+01	pCi/kg	8.35E+01		U
Fish	Control	F-3	08-May-13	Channel Catfish	Selenium-75	1.01E+00	pCi/kg	1.43E+01		U
Fish	Control	F-3	08-May-13	Channel Catfish	Silver-108m	1.47E+00	pCi/kg	7.51E+00		U
Fish	Control	F-3	08-May-13	Channel Catfish	Silver-110m	4.73E+00	pCi/kg	1.28E+01		U
Fish	Control	F-3	08-May-13	Channel Catfish	Strontium-89	-2.30E+02	pCi/kg	1.83E+02	300	U
Fish	Control	F-3	08-May-13	Channel Catfish	Strontium-90	1.19E+02	pCi/kg	1.29E+02	300	U
Fish	Control	F-3	08-May-13	Channel Catfish	Thorium-228	1.01E+01	pCi/kg	1.78E+01		U
Fish	Control	F-3	08-May-13	Channel Catfish	Zinc-65	5.80E+00	pCi/kg	2.17E+01	260	U
Fish	Control	F-3	08-May-13	Channel Catfish	Zirconium-95	2.64E+00	pCi/kg	2.31E+01		U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Actinium-228	1.76E+01	pCi/kg	2.30E+01		U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Antimony-124	-1.91E+01	pCi/kg	2.61E+01		U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Antimony-125	-5.52E-01	pCi/kg	1.86E+01		U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Barium-140	7.60E+01	pCi/kg	2.46E+02		U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Beryllium-7	3.99E+01	pCi/kg	9.78E+01		U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Cerium-141	-2.56E+01	pCi/kg	2.27E+01		U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Cerium-144	9.91E+00	pCi/kg	4.30E+01		U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Cesium-134	-6.52E-01	pCi/kg	7.88E+00	60	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Fish	Indicator	F-2	09-May-13	Channel Catfish	Cesium-137	1.86E+00	pCi/kg	7.82E+00	80	U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Chromium-51	-1.94E+01	pCi/kg	1.55E+02		U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Cobalt-57	-1.22E-01	pCi/kg	5.44E+00		U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Cobalt-58	-8.17E-01	pCi/kg	9.41E+00	130	U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Cobalt-60	5.14E-01	pCi/kg	7.92E+00	130	U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Iodine-131	-1.12E+02	pCi/kg	2.72E+02	60	DLU
Fish	Indicator	F-2	09-May-13	Channel Catfish	Iron-59	-8.70E+00	pCi/kg	2.43E+01	260	U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Lanthanum-140	1.59E+01	pCi/kg	8.39E+01		U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Manganese-54	-2.29E+00	pCi/kg	7.22E+00	130	U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Niobium-95	-1.14E+00	pCi/kg	1.17E+01		U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Potassium-40	2.66E+03	pCi/kg	7.06E+01		
Fish	Indicator	F-2	09-May-13	Channel Catfish	Ruthenium-103	5.49E+00	pCi/kg	1.44E+01		U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Ruthenium-106	4.54E+00	pCi/kg	7.12E+01		U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Selenium-75	5.77E-01	pCi/kg	1.10E+01		U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Silver-108m	-1.44E+00	pCi/kg	5.75E+00		U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Silver-110m	-3.99E+00	pCi/kg	1.06E+01		U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Strontium-89	-5.32E+01	pCi/kg	1.25E+02	300	U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Strontium-90	3.13E+01	pCi/kg	9.76E+01	300	U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Thorium-228	3.00E+00	pCi/kg	1.32E+01		U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Zinc-65	-4.52E+00	pCi/kg	1.74E+01	260	U
Fish	Indicator	F-2	09-May-13	Channel Catfish	Zirconium-95	-5.47E+00	pCi/kg	1.77E+01		U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Actinium-228	5.10E+00	pCi/kg	1.50E+01		U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Antimony-124	9.73E-02	pCi/kg	1.47E+01		U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Antimony-125	-3.07E-01	pCi/kg	8.79E+00		U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Barium-140	4.18E+01	pCi/kg	4.15E+02		U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Beryllium-7	-1.04E+01	pCi/kg	5.95E+01		U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Cerium-141	6.43E+00	pCi/kg	1.84E+01		U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Cerium-144	4.58E+00	pCi/kg	2.13E+01		U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Cesium-134	-2.76E+00	pCi/kg	3.94E+00	60	U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Cesium-137	7.53E-01	pCi/kg	3.65E+00	80	U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Chromium-51	5.11E+01	pCi/kg	1.38E+02		U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Cobalt-57	-5.36E-01	pCi/kg	2.81E+00		U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Cobalt-58	2.40E+00	pCi/kg	6.51E+00	130	U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Cobalt-60	-1.20E+00	pCi/kg	3.82E+00	130	U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Iodine-131	-2.24E+02	pCi/kg	1.01E+03	60	DLU
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Iron-59	-9.22E+00	pCi/kg	2.10E+01	260	U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Lanthanum-140	-9.46E+00	pCi/kg	1.39E+02		U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Manganese-54	-6.67E-01	pCi/kg	3.82E+00	130	U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Niobium-95	-5.18E+00	pCi/kg	6.41E+00		U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Potassium-40	3.23E+03	pCi/kg	3.14E+01		
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Ruthenium-103	-5.46E+00	pCi/kg	9.17E+00		U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Ruthenium-106	-7.53E-01	pCi/kg	3.23E+01		U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Selenium-75	1.21E+00	pCi/kg	6.06E+00		U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Silver-108m	2.72E-02	pCi/kg	2.74E+00		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Silver-110m	2.78E+00	pCi/kg	5.74E+00		U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Strontium-89	-2.96E+00	pCi/kg	1.63E+02	300	U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Strontium-90	-2.10E+01	pCi/kg	1.15E+02	300	U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Thorium-228	-2.65E-01	pCi/kg	6.14E+00		U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Zinc-65	-4.47E+00	pCi/kg	1.00E+01	260	U
Fish	Control	F-1	25-Oct-13	Gizzard Shad	Zirconium-95	6.65E+00	pCi/kg	1.21E+01		U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Actinium-228	-1.83E+00	pCi/kg	2.83E+01		U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Antimony-124	-2.79E+00	pCi/kg	2.20E+01		U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Antimony-125	5.44E+00	pCi/kg	1.74E+01		U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Barium-140	1.78E+01	pCi/kg	2.21E+02		U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Beryllium-7	-3.41E+01	pCi/kg	8.34E+01		U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Cerium-141	1.05E+01	pCi/kg	1.88E+01		U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Cerium-144	-1.21E+01	pCi/kg	3.57E+01		U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Cesium-134	-8.07E+00	pCi/kg	7.22E+00	60	U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Cesium-137	6.04E+00	pCi/kg	6.69E+00	80	U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Chromium-51	5.27E+01	pCi/kg	1.46E+02		U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Cobalt-57	1.72E+00	pCi/kg	4.74E+00		U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Cobalt-58	-2.03E+00	pCi/kg	9.01E+00	130	U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Cobalt-60	1.58E+00	pCi/kg	7.44E+00	130	U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Iodine-131	-5.54E+01	pCi/kg	2.54E+02	60	DLU
Fish	Indicator	F-2	09-May-13	Longnose Gar	Iron-59	4.91E+00	pCi/kg	2.44E+01	260	U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Lanthanum-140	1.53E+01	pCi/kg	7.01E+01		U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Manganese-54	8.77E-01	pCi/kg	7.62E+00	130	U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Niobium-95	4.98E+00	pCi/kg	1.01E+01		U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Potassium-40	2.33E+03	pCi/kg	6.21E+01		
Fish	Indicator	F-2	09-May-13	Longnose Gar	Ruthenium-103	-5.20E+00	pCi/kg	1.19E+01		U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Ruthenium-106	-1.48E+01	pCi/kg	6.00E+01		U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Selenium-75	-1.10E+00	pCi/kg	9.17E+00		U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Silver-108m	-1.10E+00	pCi/kg	5.38E+00		U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Silver-110m	1.54E+00	pCi/kg	9.54E+00		U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Strontium-89	-1.31E+01	pCi/kg	2.45E+02	300	U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Strontium-90	-7.79E+00	pCi/kg	9.21E+01	300	U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Thorium-228	-5.17E+00	pCi/kg	1.20E+01		U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Zinc-65	-1.10E+01	pCi/kg	1.52E+01	260	U
Fish	Indicator	F-2	09-May-13	Longnose Gar	Zirconium-95	2.25E+00	pCi/kg	1.66E+01		U
Fish	Indicator	F-2	09-May-13	Rock Bass	Actinium-228	-1.77E+01	pCi/kg	1.31E+02		U
Fish	Indicator	F-2	09-May-13	Rock Bass	Antimony-124	1.91E+01	pCi/kg	9.56E+01		U
Fish	Indicator	F-2	09-May-13	Rock Bass	Antimony-125	-2.17E+01	pCi/kg	6.46E+01		U
Fish	Indicator	F-2	09-May-13	Rock Bass	Barium-140	6.61E+02	pCi/kg	9.36E+02		U
Fish	Indicator	F-2	09-May-13	Rock Bass	Beryllium-7	-1.38E+02	pCi/kg	3.38E+02		U
Fish	Indicator	F-2	09-May-13	Rock Bass	Cerium-141	7.95E+01	pCi/kg	7.95E+01		UI
Fish	Indicator	F-2	09-May-13	Rock Bass	Cerium-144	2.43E+01	pCi/kg	1.45E+02		U
Fish	Indicator	F-2	09-May-13	Rock Bass	Cesium-134	2.20E+01	pCi/kg	3.17E+01	60	U
Fish	Indicator	F-2	09-May-13	Rock Bass	Cesium-137	-6.66E+00	pCi/kg	2.75E+01	80	U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Fish	Indicator	F-2	09-May-13	Rock Bass	Chromium-51	1.81E+01	pCi/kg	5.57E+02		U
Fish	Indicator	F-2	09-May-13	Rock Bass	Cobalt-57	1.85E+00	pCi/kg	1.88E+01		U
Fish	Indicator	F-2	09-May-13	Rock Bass	Cobalt-58	1.57E+01	pCi/kg	3.75E+01	130	U
Fish	Indicator	F-2	09-May-13	Rock Bass	Cobalt-60	7.53E+00	pCi/kg	3.11E+01	130	U
Fish	Indicator	F-2	09-May-13	Rock Bass	Iodine-131	1.74E+02	pCi/kg	1.00E+03	60	DL
Fish	Indicator	F-2	09-May-13	Rock Bass	Iron-59	3.64E+01	pCi/kg	1.03E+02	260	U
Fish	Indicator	F-2	09-May-13	Rock Bass	Lanthanum-140	-3.73E+02	pCi/kg	2.95E+02		U
Fish	Indicator	F-2	09-May-13	Rock Bass	Manganese-54	6.91E+00	pCi/kg	2.99E+01	130	U
Fish	Indicator	F-2	09-May-13	Rock Bass	Niobium-95	6.86E+00	pCi/kg	4.17E+01		U
Fish	Indicator	F-2	09-May-13	Rock Bass	Potassium-40	2.90E+03	pCi/kg	2.77E+02		
Fish	Indicator	F-2	09-May-13	Rock Bass	Ruthenium-103	-2.39E+00	pCi/kg	4.69E+01		U
Fish	Indicator	F-2	09-May-13	Rock Bass	Ruthenium-106	-3.98E+01	pCi/kg	2.46E+02		U
Fish	Indicator	F-2	09-May-13	Rock Bass	Selenium-75	-2.49E+01	pCi/kg	3.75E+01		U
Fish	Indicator	F-2	09-May-13	Rock Bass	Silver-108m	5.16E+00	pCi/kg	2.17E+01		U
Fish	Indicator	F-2	09-May-13	Rock Bass	Silver-110m	5.51E+00	pCi/kg	3.98E+01		U
Fish	Indicator	F-2	09-May-13	Rock Bass	Strontium-89	-1.55E+02	pCi/kg	1.40E+02	300	U
Fish	Indicator	F-2	09-May-13	Rock Bass	Strontium-90	-3.32E+01	pCi/kg	1.05E+02	300	U
Fish	Indicator	F-2	09-May-13	Rock Bass	Thorium-228	1.48E+01	pCi/kg	4.96E+01		U
Fish	Indicator	F-2	09-May-13	Rock Bass	Zinc-65	-2.60E+01	pCi/kg	6.80E+01	260	U
Fish	Indicator	F-2	09-May-13	Rock Bass	Zirconium-95	4.71E+01	pCi/kg	7.02E+01		U
Fish	Control	F-1	16-May-13	Rock Bass	Actinium-228	2.53E+00	pCi/kg	7.72E+01		U
Fish	Control	F-1	16-May-13	Rock Bass	Antimony-124	4.55E+01	pCi/kg	9.79E+01		U
Fish	Control	F-1	16-May-13	Rock Bass	Antimony-125	-1.21E+01	pCi/kg	4.54E+01		U
Fish	Control	F-1	16-May-13	Rock Bass	Barium-140	4.08E+01	pCi/kg	4.47E+02		U
Fish	Control	F-1	16-May-13	Rock Bass	Beryllium-7	5.22E+01	pCi/kg	2.11E+02		U
Fish	Control	F-1	16-May-13	Rock Bass	Cerium-141	3.04E+00	pCi/kg	2.99E+01		U
Fish	Control	F-1	16-May-13	Rock Bass	Cerium-144	-3.81E+00	pCi/kg	6.01E+01		U
Fish	Control	F-1	16-May-13	Rock Bass	Cesium-134	8.22E+00	pCi/kg	2.41E+01	60	U
Fish	Control	F-1	16-May-13	Rock Bass	Cesium-137	3.45E+00	pCi/kg	2.07E+01	80	U
Fish	Control	F-1	16-May-13	Rock Bass	Chromium-51	-1.60E+01	pCi/kg	2.85E+02		U
Fish	Control	F-1	16-May-13	Rock Bass	Cobalt-57	-3.79E+00	pCi/kg	7.38E+00		U
Fish	Control	F-1	16-May-13	Rock Bass	Cobalt-58	-2.41E+00	pCi/kg	2.74E+01	130	U
Fish	Control	F-1	16-May-13	Rock Bass	Cobalt-60	-6.02E+00	pCi/kg	2.59E+01	130	U
Fish	Control	F-1	16-May-13	Rock Bass	Iodine-131	4.79E+01	pCi/kg	3.41E+02	60	DLU
Fish	Control	F-1	16-May-13	Rock Bass	Iron-59	4.12E+01	pCi/kg	8.38E+01	260	U
Fish	Control	F-1	16-May-13	Rock Bass	Lanthanum-140	-1.05E+01	pCi/kg	1.99E+02		U
Fish	Control	F-1	16-May-13	Rock Bass	Manganese-54	5.40E+00	pCi/kg	2.26E+01	130	U
Fish	Control	F-1	16-May-13	Rock Bass	Niobium-95	3.94E+00	pCi/kg	2.81E+01		U
Fish	Control	F-1	16-May-13	Rock Bass	Potassium-40	3.66E+03	pCi/kg	2.24E+02		
Fish	Control	F-1	16-May-13	Rock Bass	Ruthenium-103	-2.37E+01	pCi/kg	2.71E+01		U
Fish	Control	F-1	16-May-13	Rock Bass	Ruthenium-106	3.94E+00	pCi/kg	1.78E+02		U
Fish	Control	F-1	16-May-13	Rock Bass	Selenium-75	-9.33E-01	pCi/kg	2.09E+01		U
Fish	Control	F-1	16-May-13	Rock Bass	Silver-108m	-1.02E+00	pCi/kg	1.50E+01		U
Fish	Control	F-1	16-May-13	Rock Bass	Silver-110m	2.73E+00	pCi/kg	3.26E+01		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Fish	Control	F-1	16-May-13	Rock Bass	Strontium-89	-1.08E+02	pCi/kg	1.72E+02	300	U
Fish	Control	F-1	16-May-13	Rock Bass	Strontium-90	-1.97E+01	pCi/kg	1.02E+02	300	U
Fish	Control	F-1	16-May-13	Rock Bass	Thorium-228	5.32E+00	pCi/kg	2.44E+01		U
Fish	Control	F-1	16-May-13	Rock Bass	Zinc-65	-2.59E+01	pCi/kg	5.14E+01	260	U
Fish	Control	F-1	16-May-13	Rock Bass	Zirconium-95	4.03E-01	pCi/kg	4.99E+01		U
Fish	Indicator	F-2	09-May-13	Shad	Actinium-228	2.40E-01	pCi/kg	1.54E+01		U
Fish	Indicator	F-2	09-May-13	Shad	Antimony-124	9.76E+00	pCi/kg	9.98E+00		U
Fish	Indicator	F-2	09-May-13	Shad	Antimony-125	-1.67E+00	pCi/kg	7.86E+00		U
Fish	Indicator	F-2	09-May-13	Shad	Barium-140	4.47E+00	pCi/kg	1.11E+02		U
Fish	Indicator	F-2	09-May-13	Shad	Beryllium-7	-6.16E+00	pCi/kg	4.12E+01		U
Fish	Indicator	F-2	09-May-13	Shad	Cerium-141	-2.04E+00	pCi/kg	9.99E+00		U
Fish	Indicator	F-2	09-May-13	Shad	Cerium-144	-2.22E+00	pCi/kg	1.88E+01		U
Fish	Indicator	F-2	09-May-13	Shad	Cesium-134	-1.37E+00	pCi/kg	3.64E+00	60	U
Fish	Indicator	F-2	09-May-13	Shad	Cesium-137	1.49E+00	pCi/kg	3.44E+00	80	U
Fish	Indicator	F-2	09-May-13	Shad	Chromium-51	-5.47E+00	pCi/kg	6.97E+01		U
Fish	Indicator	F-2	09-May-13	Shad	Cobalt-57	-7.26E-01	pCi/kg	2.36E+00		U
Fish	Indicator	F-2	09-May-13	Shad	Cobalt-58	-4.18E-01	pCi/kg	4.53E+00	130	U
Fish	Indicator	F-2	09-May-13	Shad	Cobalt-60	1.64E+00	pCi/kg	4.07E+00	130	U
Fish	Indicator	F-2	09-May-13	Shad	Iodine-131	-2.77E+01	pCi/kg	1.23E+02	60	DLU
Fish	Indicator	F-2	09-May-13	Shad	Iron-59	-7.38E+00	pCi/kg	1.46E+01	260	U
Fish	Indicator	F-2	09-May-13	Shad	Lanthanum-140	1.11E+01	pCi/kg	3.86E+01		U
Fish	Indicator	F-2	09-May-13	Shad	Manganese-54	4.24E-01	pCi/kg	3.64E+00	130	U
Fish	Indicator	F-2	09-May-13	Shad	Niobium-95	3.09E+00	pCi/kg	5.21E+00		U
Fish	Indicator	F-2	09-May-13	Shad	Potassium-40	3.13E+03	pCi/kg	3.43E+01		
Fish	Indicator	F-2	09-May-13	Shad	Ruthenium-103	2.57E-01	pCi/kg	6.29E+00		U
Fish	Indicator	F-2	09-May-13	Shad	Ruthenium-106	1.77E+00	pCi/kg	3.21E+01		U
Fish	Indicator	F-2	09-May-13	Shad	Selenium-75	-1.03E+00	pCi/kg	4.74E+00		U
Fish	Indicator	F-2	09-May-13	Shad	Silver-108m	-1.87E-01	pCi/kg	2.68E+00		U
Fish	Indicator	F-2	09-May-13	Shad	Silver-110m	-3.03E+00	pCi/kg	5.22E+00		U
Fish	Indicator	F-2	09-May-13	Shad	Strontium-89	-7.11E+01	pCi/kg	1.31E+02	300	U
Fish	Indicator	F-2	09-May-13	Shad	Strontium-90	-4.20E+01	pCi/kg	8.22E+01	300	U
Fish	Indicator	F-2	09-May-13	Shad	Thorium-228	2.56E+00	pCi/kg	5.17E+00		U
Fish	Indicator	F-2	09-May-13	Shad	Zinc-65	-2.82E+00	pCi/kg	1.00E+01	260	U
Fish	Indicator	F-2	09-May-13	Shad	Zirconium-95	5.78E+00	pCi/kg	9.04E+00		U
Fish	Control	F-3	08-May-13	Silver Bass	Actinium-228	7.96E+00	pCi/kg	1.24E+01		U
Fish	Control	F-3	08-May-13	Silver Bass	Antimony-124	2.63E+00	pCi/kg	9.53E+00		U
Fish	Control	F-3	08-May-13	Silver Bass	Antimony-125	1.79E+00	pCi/kg	7.58E+00		U
Fish	Control	F-3	08-May-13	Silver Bass	Barium-140	-1.12E+02	pCi/kg	1.19E+02		U
Fish	Control	F-3	08-May-13	Silver Bass	Beryllium-7	2.55E+01	pCi/kg	3.94E+01		U
Fish	Control	F-3	08-May-13	Silver Bass	Cerium-141	5.38E+00	pCi/kg	1.07E+01		U
Fish	Control	F-3	08-May-13	Silver Bass	Cerium-144	3.54E+00	pCi/kg	1.79E+01		U
Fish	Control	F-3	08-May-13	Silver Bass	Cesium-134	8.87E-01	pCi/kg	3.24E+00	60	U
Fish	Control	F-3	08-May-13	Silver Bass	Cesium-137	2.91E+00	pCi/kg	2.91E+00	80	UI
Fish	Control	F-3	08-May-13	Silver Bass	Chromium-51	-9.46E+00	pCi/kg	6.91E+01		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Fish	Control	F-3	08-May-13	Silver Bass	Cobalt-57	7.94E-02	pCi/kg	2.33E+00		U
Fish	Control	F-3	08-May-13	Silver Bass	Cobalt-58	-4.78E-01	pCi/kg	4.08E+00	130	U
Fish	Control	F-3	08-May-13	Silver Bass	Cobalt-60	1.87E+00	pCi/kg	3.39E+00	130	U
Fish	Control	F-3	08-May-13	Silver Bass	Iodine-131	1.73E+01	pCi/kg	1.70E+02	60	DLU
Fish	Control	F-3	08-May-13	Silver Bass	Iron-59	3.14E+00	pCi/kg	1.32E+01	260	U
Fish	Control	F-3	08-May-13	Silver Bass	Lanthanum-140	3.84E+00	pCi/kg	3.91E+01		U
Fish	Control	F-3	08-May-13	Silver Bass	Manganese-54	-8.84E-02	pCi/kg	3.11E+00	130	U
Fish	Control	F-3	08-May-13	Silver Bass	Niobium-95	2.47E-01	pCi/kg	4.35E+00		U
Fish	Control	F-3	08-May-13	Silver Bass	Potassium-40	2.75E+03	pCi/kg	2.44E+01		
Fish	Control	F-3	08-May-13	Silver Bass	Ruthenium-103	-1.94E+00	pCi/kg	5.55E+00		U
Fish	Control	F-3	08-May-13	Silver Bass	Ruthenium-106	1.68E+01	pCi/kg	2.86E+01		U
Fish	Control	F-3	08-May-13	Silver Bass	Selenium-75	1.39E+00	pCi/kg	4.52E+00		U
Fish	Control	F-3	08-May-13	Silver Bass	Silver-108m	-1.17E+00	pCi/kg	2.38E+00		U
Fish	Control	F-3	08-May-13	Silver Bass	Silver-110m	-1.06E+00	pCi/kg	4.39E+00		U
Fish	Control	F-3	08-May-13	Silver Bass	Strontium-89	7.25E+01	pCi/kg	1.46E+02	300	U
Fish	Control	F-3	08-May-13	Silver Bass	Strontium-90	1.65E+00	pCi/kg	9.64E+01	300	U
Fish	Control	F-3	08-May-13	Silver Bass	Thorium-228	-5.26E+00	pCi/kg	5.33E+00		U
Fish	Control	F-3	08-May-13	Silver Bass	Zinc-65	-5.86E+00	pCi/kg	7.63E+00	260	U
Fish	Control	F-3	08-May-13	Silver Bass	Zirconium-95	-1.48E+00	pCi/kg	7.59E+00		U
Fish	Indicator	F-2	09-May-13	Silver Bass	Actinium-228	4.81E+00	pCi/kg	1.23E+01		U
Fish	Indicator	F-2	09-May-13	Silver Bass	Antimony-124	4.87E+00	pCi/kg	1.05E+01		U
Fish	Indicator	F-2	09-May-13	Silver Bass	Antimony-125	-2.22E+00	pCi/kg	7.19E+00		U
Fish	Indicator	F-2	09-May-13	Silver Bass	Barium-140	-3.03E+01	pCi/kg	1.23E+02		U
Fish	Indicator	F-2	09-May-13	Silver Bass	Beryllium-7	6.42E+00	pCi/kg	3.87E+01		U
Fish	Indicator	F-2	09-May-13	Silver Bass	Cerium-141	7.98E-01	pCi/kg	9.83E+00		U
Fish	Indicator	F-2	09-May-13	Silver Bass	Cerium-144	1.06E+01	pCi/kg	1.70E+01		U
Fish	Indicator	F-2	09-May-13	Silver Bass	Cesium-134	1.82E+00	pCi/kg	3.28E+00	60	U
Fish	Indicator	F-2	09-May-13	Silver Bass	Cesium-137	2.83E+00	pCi/kg	2.83E+00	80	UI
Fish	Indicator	F-2	09-May-13	Silver Bass	Chromium-51	-3.67E+01	pCi/kg	6.52E+01		U
Fish	Indicator	F-2	09-May-13	Silver Bass	Cobalt-57	7.76E-01	pCi/kg	2.24E+00		U
Fish	Indicator	F-2	09-May-13	Silver Bass	Cobalt-58	-2.02E+00	pCi/kg	4.11E+00	130	U
Fish	Indicator	F-2	09-May-13	Silver Bass	Cobalt-60	7.26E-01	pCi/kg	3.26E+00	130	U
Fish	Indicator	F-2	09-May-13	Silver Bass	Iodine-131	7.28E+01	pCi/kg	1.54E+02	60	DL
Fish	Indicator	F-2	09-May-13	Silver Bass	Iron-59	9.78E+00	pCi/kg	1.31E+01	260	U
Fish	Indicator	F-2	09-May-13	Silver Bass	Lanthanum-140	-1.76E+01	pCi/kg	3.27E+01		U
Fish	Indicator	F-2	09-May-13	Silver Bass	Manganese-54	-6.61E-01	pCi/kg	3.10E+00	130	U
Fish	Indicator	F-2	09-May-13	Silver Bass	Niobium-95	4.23E+00	pCi/kg	4.31E+00		U
Fish	Indicator	F-2	09-May-13	Silver Bass	Potassium-40	2.62E+03	pCi/kg	2.42E+01		
Fish	Indicator	F-2	09-May-13	Silver Bass	Ruthenium-103	3.70E-01	pCi/kg	5.71E+00		U
Fish	Indicator	F-2	09-May-13	Silver Bass	Ruthenium-106	-1.20E+01	pCi/kg	2.62E+01		U
Fish	Indicator	F-2	09-May-13	Silver Bass	Selenium-75	-7.48E-02	pCi/kg	4.30E+00		U
Fish	Indicator	F-2	09-May-13	Silver Bass	Silver-108m	-3.43E-01	pCi/kg	2.42E+00		U
Fish	Indicator	F-2	09-May-13	Silver Bass	Silver-110m	-9.67E-02	pCi/kg	4.38E+00		U
Fish	Indicator	F-2	09-May-13	Silver Bass	Strontium-89	-2.02E+02	pCi/kg	1.53E+02	300	U



Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Fish	Indicator	F-2	09-May-13	Silver Bass	Strontium-90	-7.76E+01	pCi/kg	1.15E+02	300	U
Fish	Indicator	F-2	09-May-13	Silver Bass	Thorium-228	2.37E+00	pCi/kg	5.17E+00		U
Fish	Indicator	F-2	09-May-13	Silver Bass	Zinc-65	2.73E+00	pCi/kg	7.57E+00	260	U
Fish	Indicator	F-2	09-May-13	Silver Bass	Zirconium-95	3.33E+00	pCi/kg	8.10E+00		U
Fish	Control	F-3	22-Nov-13	Silver Bass	Actinium-228	-1.67E+01	pCi/kg	2.87E+01		U
Fish	Control	F-3	22-Nov-13	Silver Bass	Antimony-124	-1.83E-01	pCi/kg	1.99E+01		U
Fish	Control	F-3	22-Nov-13	Silver Bass	Antimony-125	4.01E-01	pCi/kg	1.63E+01		U
Fish	Control	F-3	22-Nov-13	Silver Bass	Barium-140	1.31E+01	pCi/kg	1.71E+02		U
Fish	Control	F-3	22-Nov-13	Silver Bass	Beryllium-7	-1.84E+01	pCi/kg	7.62E+01		U
Fish	Control	F-3	22-Nov-13	Silver Bass	Cerium-141	-2.97E+00	pCi/kg	1.85E+01		U
Fish	Control	F-3	22-Nov-13	Silver Bass	Cerium-144	-1.33E+01	pCi/kg	3.64E+01		U
Fish	Control	F-3	22-Nov-13	Silver Bass	Cesium-134	-4.50E+00	pCi/kg	6.95E+00	60	U
Fish	Control	F-3	22-Nov-13	Silver Bass	Cesium-137	1.78E+00	pCi/kg	6.85E+00	80	U
Fish	Control	F-3	22-Nov-13	Silver Bass	Chromium-51	-1.17E+01	pCi/kg	1.20E+02		U
Fish	Control	F-3	22-Nov-13	Silver Bass	Cobalt-57	-8.62E-01	pCi/kg	4.83E+00		U
Fish	Control	F-3	22-Nov-13	Silver Bass	Cobalt-58	-1.85E+00	pCi/kg	8.42E+00	130	U
Fish	Control	F-3	22-Nov-13	Silver Bass	Cobalt-60	-6.89E-01	pCi/kg	6.82E+00	130	U
Fish	Control	F-3	22-Nov-13	Silver Bass	Iodine-131	4.78E+01	pCi/kg	1.73E+02	60	DLU
Fish	Control	F-3	22-Nov-13	Silver Bass	Iron-59	-9.04E+00	pCi/kg	2.18E+01	260	U
Fish	Control	F-3	22-Nov-13	Silver Bass	Lanthanum-140	9.68E+00	pCi/kg	5.92E+01		U
Fish	Control	F-3	22-Nov-13	Silver Bass	Manganese-54	4.35E-01	pCi/kg	6.70E+00	130	U
Fish	Control	F-3	22-Nov-13	Silver Bass	Niobium-95	7.77E+00	pCi/kg	9.10E+00		U
Fish	Control	F-3	22-Nov-13	Silver Bass	Potassium-40	2.94E+03	pCi/kg	6.32E+01		
Fish	Control	F-3	22-Nov-13	Silver Bass	Ruthenium-103	3.52E+00	pCi/kg	1.12E+01		U
Fish	Control	F-3	22-Nov-13	Silver Bass	Ruthenium-106	-2.71E+01	pCi/kg	5.67E+01		U
Fish	Control	F-3	22-Nov-13	Silver Bass	Selenium-75	-2.68E+00	pCi/kg	9.18E+00		U
Fish	Control	F-3	22-Nov-13	Silver Bass	Silver-108m	-2.91E+00	pCi/kg	5.15E+00		U
Fish	Control	F-3	22-Nov-13	Silver Bass	Silver-110m	-1.56E+00	pCi/kg	9.36E+00		U
Fish	Control	F-3	22-Nov-13	Silver Bass	Strontium-89	-4.22E+01	pCi/kg	1.38E+02	300	U
Fish	Control	F-3	22-Nov-13	Silver Bass	Strontium-90	-1.67E+01	pCi/kg	9.03E+01	300	U
Fish	Control	F-3	22-Nov-13	Silver Bass	Thorium-228	4.32E+00	pCi/kg	1.05E+01		U
Fish	Control	F-3	22-Nov-13	Silver Bass	Zinc-65	-1.64E+00	pCi/kg	1.60E+01	260	U
Fish	Control	F-3	22-Nov-13	Silver Bass	Zirconium-95	1.51E+00	pCi/kg	1.52E+01		U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Actinium-228	3.08E+01	pCi/kg	3.08E+01		UI
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Antimony-124	4.61E+00	pCi/kg	2.34E+01		U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Antimony-125	4.76E+00	pCi/kg	1.89E+01		U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Barium-140	3.30E+01	pCi/kg	2.07E+02		U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Beryllium-7	1.40E+01	pCi/kg	3.32E+01		U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Cerium-141	4.68E+00	pCi/kg	7.80E+00		U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Cerium-144	-1.61E+00	pCi/kg	1.52E+01		U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Cesium-134	1.52E+00	pCi/kg	2.98E+00	60	U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Cesium-137	8.06E-01	pCi/kg	7.49E+00	80	U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Chromium-51	4.97E+01	pCi/kg	1.41E+02		U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Cobalt-57	9.13E-01	pCi/kg	1.98E+00		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Cobalt-58	-1.49E+00	pCi/kg	3.43E+00	130	U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Cobalt-60	4.57E+00	pCi/kg	8.33E+00	130	U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Iodine-131	-4.81E+01	pCi/kg	7.24E+01	60	DLU
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Iron-59	1.11E+00	pCi/kg	1.08E+01	260	U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Lanthanum-140	4.32E+00	pCi/kg	6.76E+01		U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Manganese-54	5.61E-01	pCi/kg	2.86E+00	130	U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Niobium-95	2.89E+00	pCi/kg	3.60E+00		U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Potassium-40	2.60E+03	pCi/kg	2.17E+01		
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Ruthenium-103	2.19E-01	pCi/kg	1.26E+01		U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Ruthenium-106	2.09E+01	pCi/kg	7.08E+01		U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Selenium-75	1.01E+00	pCi/kg	3.72E+00		U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Silver-108m	-4.81E-01	pCi/kg	5.69E+00		U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Silver-110m	1.61E+00	pCi/kg	1.08E+01		U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Strontium-89	-6.40E+01	pCi/kg	1.33E+02	300	U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Strontium-90	5.26E+01	pCi/kg	1.06E+02	300	U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Thorium-228	6.03E+00	pCi/kg	1.36E+01		U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Zinc-65	3.54E-01	pCi/kg	1.89E+01	260	U
Fish	Indicator	F-2	21-Nov-13	Spotted Gar Pike	Zirconium-95	4.21E+00	pCi/kg	6.93E+00		U
Fish	Control	F-3	08-May-13	Walleye	Actinium-228	1.38E+01	pCi/kg	1.38E+01		UI
Fish	Control	F-3	08-May-13	Walleye	Antimony-124	-1.27E-01	pCi/kg	1.02E+01		U
Fish	Control	F-3	08-May-13	Walleye	Antimony-125	-1.09E+00	pCi/kg	8.06E+00		U
Fish	Control	F-3	08-May-13	Walleye	Barium-140	1.53E+01	pCi/kg	1.18E+02		U
Fish	Control	F-3	08-May-13	Walleye	Beryllium-7	-4.09E-01	pCi/kg	4.25E+01		U
Fish	Control	F-3	08-May-13	Walleye	Cerium-141	1.77E+00	pCi/kg	1.06E+01		U
Fish	Control	F-3	08-May-13	Walleye	Cerium-144	-3.94E+00	pCi/kg	1.86E+01		U
Fish	Control	F-3	08-May-13	Walleye	Cesium-134	-1.23E+00	pCi/kg	3.70E+00	60	U
Fish	Control	F-3	08-May-13	Walleye	Cesium-137	7.37E+00	pCi/kg	3.21E+00	80	M
Fish	Control	F-3	08-May-13	Walleye	Chromium-51	2.01E+00	pCi/kg	7.07E+01		U
Fish	Control	F-3	08-May-13	Walleye	Cobalt-57	6.71E-01	pCi/kg	2.43E+00		U
Fish	Control	F-3	08-May-13	Walleye	Cobalt-58	1.39E+00	pCi/kg	4.60E+00	130	U
Fish	Control	F-3	08-May-13	Walleye	Cobalt-60	-2.37E+00	pCi/kg	3.86E+00	130	U
Fish	Control	F-3	08-May-13	Walleye	Iodine-131	6.31E+01	pCi/kg	1.30E+02	60	DL
Fish	Control	F-3	08-May-13	Walleye	Iron-59	2.97E+00	pCi/kg	1.46E+01	260	U
Fish	Control	F-3	08-May-13	Walleye	Lanthanum-140	-1.08E+01	pCi/kg	3.52E+01		U
Fish	Control	F-3	08-May-13	Walleye	Manganese-54	-1.37E+00	pCi/kg	3.26E+00	130	U
Fish	Control	F-3	08-May-13	Walleye	Niobium-95	2.03E+00	pCi/kg	4.99E+00		U
Fish	Control	F-3	08-May-13	Walleye	Potassium-40	3.34E+03	pCi/kg	3.12E+01		
Fish	Control	F-3	08-May-13	Walleye	Ruthenium-103	-8.34E-01	pCi/kg	6.02E+00		U
Fish	Control	F-3	08-May-13	Walleye	Ruthenium-106	-1.91E+01	pCi/kg	3.00E+01		U
Fish	Control	F-3	08-May-13	Walleye	Selenium-75	2.08E+00	pCi/kg	4.80E+00		U
Fish	Control	F-3	08-May-13	Walleye	Silver-108m	6.46E-03	pCi/kg	2.63E+00		U
Fish	Control	F-3	08-May-13	Walleye	Silver-110m	1.18E+00	pCi/kg	5.11E+00		U
Fish	Control	F-3	08-May-13	Walleye	Strontium-89	5.12E+01	pCi/kg	1.39E+02	300	U
Fish	Control	F-3	08-May-13	Walleye	Strontium-90	5.16E+00	pCi/kg	1.13E+02	300	U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Fish	Control	F-3	08-May-13	Walleye	Thorium-228	-2.00E+00	pCi/kg	5.85E+00		U
Fish	Control	F-3	08-May-13	Walleye	Zinc-65	-2.98E+00	pCi/kg	9.19E+00	260	U
Fish	Control	F-3	08-May-13	Walleye	Zirconium-95	2.16E+00	pCi/kg	9.40E+00		U
Fish	Indicator	F-2	09-May-13	Walleye	Actinium-228	5.20E+00	pCi/kg	1.22E+01		U
Fish	Indicator	F-2	09-May-13	Walleye	Antimony-124	-3.90E+00	pCi/kg	8.86E+00		U
Fish	Indicator	F-2	09-May-13	Walleye	Antimony-125	1.45E+00	pCi/kg	8.09E+00		U
Fish	Indicator	F-2	09-May-13	Walleye	Barium-140	2.48E+01	pCi/kg	1.08E+02		U
Fish	Indicator	F-2	09-May-13	Walleye	Beryllium-7	2.70E+00	pCi/kg	4.13E+01		U
Fish	Indicator	F-2	09-May-13	Walleye	Cerium-141	-1.51E+00	pCi/kg	9.67E+00		U
Fish	Indicator	F-2	09-May-13	Walleye	Cerium-144	1.04E+01	pCi/kg	1.82E+01		U
Fish	Indicator	F-2	09-May-13	Walleye	Cesium-134	1.55E+00	pCi/kg	3.68E+00	60	U
Fish	Indicator	F-2	09-May-13	Walleye	Cesium-137	4.93E+00	pCi/kg	3.09E+00	80	M
Fish	Indicator	F-2	09-May-13	Walleye	Chromium-51	2.88E+01	pCi/kg	6.55E+01		U
Fish	Indicator	F-2	09-May-13	Walleye	Cobalt-57	-1.26E+00	pCi/kg	2.32E+00		U
Fish	Indicator	F-2	09-May-13	Walleye	Cobalt-58	-3.19E+00	pCi/kg	4.41E+00	130	U
Fish	Indicator	F-2	09-May-13	Walleye	Cobalt-60	1.44E+00	pCi/kg	3.85E+00	130	U
Fish	Indicator	F-2	09-May-13	Walleye	Iodine-131	-4.91E+01	pCi/kg	1.12E+02	60	DLU
Fish	Indicator	F-2	09-May-13	Walleye	Iron-59	-8.96E-01	pCi/kg	1.39E+01	260	U
Fish	Indicator	F-2	09-May-13	Walleye	Lanthanum-140	-5.77E+00	pCi/kg	3.09E+01		U
Fish	Indicator	F-2	09-May-13	Walleye	Manganese-54	1.72E+00	pCi/kg	3.48E+00	130	U
Fish	Indicator	F-2	09-May-13	Walleye	Niobium-95	-8.06E+00	pCi/kg	4.96E+00		U
Fish	Indicator	F-2	09-May-13	Walleye	Potassium-40	3.14E+03	pCi/kg	2.81E+01		
Fish	Indicator	F-2	09-May-13	Walleye	Ruthenium-103	-8.68E-01	pCi/kg	5.62E+00		U
Fish	Indicator	F-2	09-May-13	Walleye	Ruthenium-106	-1.08E+00	pCi/kg	2.80E+01		U
Fish	Indicator	F-2	09-May-13	Walleye	Selenium-75	-5.80E-01	pCi/kg	4.43E+00		U
Fish	Indicator	F-2	09-May-13	Walleye	Silver-108m	9.08E-02	pCi/kg	2.50E+00		U
Fish	Indicator	F-2	09-May-13	Walleye	Silver-110m	-7.61E-01	pCi/kg	4.98E+00		U
Fish	Indicator	F-2	09-May-13	Walleye	Strontium-89	-5.68E+01	pCi/kg	1.53E+02	300	U
Fish	Indicator	F-2	09-May-13	Walleye	Strontium-90	2.36E+01	pCi/kg	1.03E+02	300	U
Fish	Indicator	F-2	09-May-13	Walleye	Thorium-228	-2.68E+00	pCi/kg	5.18E+00		U
Fish	Indicator	F-2	09-May-13	Walleye	Zinc-65	-9.16E+00	pCi/kg	9.19E+00	260	U
Fish	Indicator	F-2	09-May-13	Walleye	Zirconium-95	2.09E+00	pCi/kg	8.61E+00		U
Fish	Indicator	F-2	21-Nov-13	Walleye	Actinium-228	-2.24E+00	pCi/kg	1.19E+01		U
Fish	Indicator	F-2	21-Nov-13	Walleye	Antimony-124	1.56E+00	pCi/kg	8.66E+00		U
Fish	Indicator	F-2	21-Nov-13	Walleye	Antimony-125	1.20E+00	pCi/kg	7.02E+00		U
Fish	Indicator	F-2	21-Nov-13	Walleye	Barium-140	-3.00E+01	pCi/kg	8.18E+01		U
Fish	Indicator	F-2	21-Nov-13	Walleye	Beryllium-7	-4.96E+00	pCi/kg	3.36E+01		U
Fish	Indicator	F-2	21-Nov-13	Walleye	Cerium-141	6.09E-01	pCi/kg	8.26E+00		U
Fish	Indicator	F-2	21-Nov-13	Walleye	Cerium-144	-1.40E+00	pCi/kg	1.62E+01		U
Fish	Indicator	F-2	21-Nov-13	Walleye	Cesium-134	-1.24E+00	pCi/kg	3.13E+00	60	U
Fish	Indicator	F-2	21-Nov-13	Walleye	Cesium-137	5.36E+00	pCi/kg	2.82E+00	80	M
Fish	Indicator	F-2	21-Nov-13	Walleye	Chromium-51	1.25E+01	pCi/kg	5.46E+01		U
Fish	Indicator	F-2	21-Nov-13	Walleye	Cobalt-57	-5.34E-01	pCi/kg	2.17E+00		U
Fish	Indicator	F-2	21-Nov-13	Walleye	Cobalt-58	-2.31E-01	pCi/kg	3.80E+00	130	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Fish	Indicator	F-2	21-Nov-13	Walleye	Cobalt-60	-1.70E+00	pCi/kg	3.10E+00	130	U
Fish	Indicator	F-2	21-Nov-13	Walleye	Iodine-131	-4.15E+01	pCi/kg	7.79E+01	60	DLU
Fish	Indicator	F-2	21-Nov-13	Walleye	Iron-59	-5.40E-01	pCi/kg	1.17E+01	260	U
Fish	Indicator	F-2	21-Nov-13	Walleye	Lanthanum-140	-6.17E+00	pCi/kg	2.18E+01		U
Fish	Indicator	F-2	21-Nov-13	Walleye	Manganese-54	-8.75E-01	pCi/kg	3.08E+00	130	U
Fish	Indicator	F-2	21-Nov-13	Walleye	Niobium-95	1.00E+00	pCi/kg	4.28E+00		U
Fish	Indicator	F-2	21-Nov-13	Walleye	Potassium-40	3.57E+03	pCi/kg	2.49E+01		
Fish	Indicator	F-2	21-Nov-13	Walleye	Ruthenium-103	-1.06E+00	pCi/kg	4.89E+00		U
Fish	Indicator	F-2	21-Nov-13	Walleye	Ruthenium-106	-1.88E+00	pCi/kg	2.59E+01		U
Fish	Indicator	F-2	21-Nov-13	Walleye	Selenium-75	2.13E+00	pCi/kg	4.10E+00		U
Fish	Indicator	F-2	21-Nov-13	Walleye	Silver-108m	-4.85E-01	pCi/kg	2.26E+00		U
Fish	Indicator	F-2	21-Nov-13	Walleye	Silver-110m	-6.87E-01	pCi/kg	4.30E+00		U
Fish	Indicator	F-2	21-Nov-13	Walleye	Strontium-89	-1.53E+02	pCi/kg	1.22E+02	300	U
Fish	Indicator	F-2	21-Nov-13	Walleye	Strontium-90	-4.09E+01	pCi/kg	9.84E+01	300	U
Fish	Indicator	F-2	21-Nov-13	Walleye	Thorium-228	-6.94E-01	pCi/kg	5.18E+00		U
Fish	Indicator	F-2	21-Nov-13	Walleye	Zinc-65	5.73E+00	pCi/kg	7.88E+00	260	U
Fish	Indicator	F-2	21-Nov-13	Walleye	Zirconium-95	5.70E-01	pCi/kg	7.16E+00		U
Fish	Control	F-3	22-Nov-13	Walleye	Actinium-228	-1.80E+01	pCi/kg	2.98E+01		U
Fish	Control	F-3	22-Nov-13	Walleye	Antimony-124	6.96E+00	pCi/kg	2.21E+01		U
Fish	Control	F-3	22-Nov-13	Walleye	Antimony-125	1.36E+00	pCi/kg	1.81E+01		U
Fish	Control	F-3	22-Nov-13	Walleye	Barium-140	-1.78E+01	pCi/kg	1.91E+02		U
Fish	Control	F-3	22-Nov-13	Walleye	Beryllium-7	-3.59E+01	pCi/kg	8.45E+01		U
Fish	Control	F-3	22-Nov-13	Walleye	Cerium-141	5.82E+00	pCi/kg	1.90E+01		U
Fish	Control	F-3	22-Nov-13	Walleye	Cerium-144	2.99E+01	pCi/kg	4.06E+01		U
Fish	Control	F-3	22-Nov-13	Walleye	Cesium-134	4.67E+00	pCi/kg	7.93E+00	60	U
Fish	Control	F-3	22-Nov-13	Walleye	Cesium-137	2.07E+00	pCi/kg	7.50E+00	80	U
Fish	Control	F-3	22-Nov-13	Walleye	Chromium-51	3.30E+01	pCi/kg	1.43E+02		U
Fish	Control	F-3	22-Nov-13	Walleye	Cobalt-57	-1.06E+00	pCi/kg	4.96E+00		U
Fish	Control	F-3	22-Nov-13	Walleye	Cobalt-58	-6.51E-01	pCi/kg	9.21E+00	130	U
Fish	Control	F-3	22-Nov-13	Walleye	Cobalt-60	-6.14E+00	pCi/kg	7.71E+00	130	U
Fish	Control	F-3	22-Nov-13	Walleye	Iodine-131	1.72E+01	pCi/kg	1.85E+02	60	DLU
Fish	Control	F-3	22-Nov-13	Walleye	Iron-59	-7.12E-01	pCi/kg	2.52E+01	260	U
Fish	Control	F-3	22-Nov-13	Walleye	Lanthanum-140	1.62E+01	pCi/kg	6.21E+01		U
Fish	Control	F-3	22-Nov-13	Walleye	Manganese-54	6.24E-01	pCi/kg	7.37E+00	130	U
Fish	Control	F-3	22-Nov-13	Walleye	Niobium-95	9.33E+00	pCi/kg	1.06E+01		U
Fish	Control	F-3	22-Nov-13	Walleye	Potassium-40	3.19E+03	pCi/kg	5.60E+01		
Fish	Control	F-3	22-Nov-13	Walleye	Ruthenium-103	-3.94E+00	pCi/kg	1.21E+01		U
Fish	Control	F-3	22-Nov-13	Walleye	Ruthenium-106	7.47E+00	pCi/kg	6.56E+01		U
Fish	Control	F-3	22-Nov-13	Walleye	Selenium-75	-7.90E+00	pCi/kg	1.00E+01		U
Fish	Control	F-3	22-Nov-13	Walleye	Silver-108m	1.59E+00	pCi/kg	5.97E+00		U
Fish	Control	F-3	22-Nov-13	Walleye	Silver-110m	-4.83E-01	pCi/kg	1.04E+01		U
Fish	Control	F-3	22-Nov-13	Walleye	Strontium-89	-7.27E+01	pCi/kg	1.09E+02	300	U
Fish	Control	F-3	22-Nov-13	Walleye	Strontium-90	-4.49E+01	pCi/kg	8.70E+01	300	U
Fish	Control	F-3	22-Nov-13	Walleye	Thorium-228	1.63E+00	pCi/kg	1.26E+01		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Fish	Control	F-3	22-Nov-13	Walleye	Zinc-65	-1.49E+01	pCi/kg	1.62E+01	260	U
Fish	Control	F-3	22-Nov-13	Walleye	Zirconium-95	-9.57E-01	pCi/kg	1.75E+01		U
Fish	Control	F-1	16-May-13	White Bass	Actinium-228	-9.09E+00	pCi/kg	1.25E+01		U
Fish	Control	F-1	16-May-13	White Bass	Antimony-124	9.81E-01	pCi/kg	8.04E+00		U
Fish	Control	F-1	16-May-13	White Bass	Antimony-125	2.45E+00	pCi/kg	7.22E+00		U
Fish	Control	F-1	16-May-13	White Bass	Barium-140	-3.75E+01	pCi/kg	6.41E+01		U
Fish	Control	F-1	16-May-13	White Bass	Beryllium-7	-1.29E+01	pCi/kg	3.29E+01		U
Fish	Control	F-1	16-May-13	White Bass	Cerium-141	2.20E+00	pCi/kg	8.08E+00		U
Fish	Control	F-1	16-May-13	White Bass	Cerium-144	-1.46E+00	pCi/kg	1.68E+01		U
Fish	Control	F-1	16-May-13	White Bass	Cesium-134	-9.08E-01	pCi/kg	3.04E+00	60	U
Fish	Control	F-1	16-May-13	White Bass	Cesium-137	7.13E+00	pCi/kg	2.70E+00	80	M
Fish	Control	F-1	16-May-13	White Bass	Chromium-51	-4.37E+00	pCi/kg	5.08E+01		U
Fish	Control	F-1	16-May-13	White Bass	Cobalt-57	7.10E-01	pCi/kg	2.16E+00		U
Fish	Control	F-1	16-May-13	White Bass	Cobalt-58	1.41E+00	pCi/kg	3.73E+00	130	U
Fish	Control	F-1	16-May-13	White Bass	Cobalt-60	-2.76E+00	pCi/kg	3.44E+00	130	U
Fish	Control	F-1	16-May-13	White Bass	Iodine-131	-9.19E+00	pCi/kg	5.92E+01	60	U
Fish	Control	F-1	16-May-13	White Bass	Iron-59	2.46E+00	pCi/kg	1.13E+01	260	U
Fish	Control	F-1	16-May-13	White Bass	Lanthanum-140	5.29E+00	pCi/kg	1.95E+01		U
Fish	Control	F-1	16-May-13	White Bass	Manganese-54	-1.46E+00	pCi/kg	2.98E+00	130	U
Fish	Control	F-1	16-May-13	White Bass	Niobium-95	1.65E+00	pCi/kg	4.10E+00		U
Fish	Control	F-1	16-May-13	White Bass	Potassium-40	3.12E+03	pCi/kg	2.71E+01		
Fish	Control	F-1	16-May-13	White Bass	Ruthenium-103	-1.13E+00	pCi/kg	4.60E+00		U
Fish	Control	F-1	16-May-13	White Bass	Ruthenium-106	7.27E+00	pCi/kg	2.66E+01		U
Fish	Control	F-1	16-May-13	White Bass	Selenium-75	4.12E+00	pCi/kg	4.12E+00		UI
Fish	Control	F-1	16-May-13	White Bass	Silver-108m	-4.95E-01	pCi/kg	2.28E+00		U
Fish	Control	F-1	16-May-13	White Bass	Silver-110m	-9.05E-01	pCi/kg	4.19E+00		U
Fish	Control	F-1	16-May-13	White Bass	Strontium-89	-3.36E+01	pCi/kg	1.69E+02	300	U
Fish	Control	F-1	16-May-13	White Bass	Strontium-90	-4.38E+01	pCi/kg	1.03E+02	300	U
Fish	Control	F-1	16-May-13	White Bass	Thorium-228	-1.75E+00	pCi/kg	4.98E+00		U
Fish	Control	F-1	16-May-13	White Bass	Zinc-65	3.11E+00	pCi/kg	8.21E+00	260	U
Fish	Control	F-1	16-May-13	White Bass	Zirconium-95	1.97E+00	pCi/kg	7.16E+00		U
Fish	Indicator	F-2	21-Nov-13	White Bass	Actinium-228	2.19E+00	pCi/kg	1.33E+01		U
Fish	Indicator	F-2	21-Nov-13	White Bass	Antimony-124	-2.73E+00	pCi/kg	9.68E+00		U
Fish	Indicator	F-2	21-Nov-13	White Bass	Antimony-125	3.23E+00	pCi/kg	8.52E+00		U
Fish	Indicator	F-2	21-Nov-13	White Bass	Barium-140	1.64E+01	pCi/kg	9.45E+01		U
Fish	Indicator	F-2	21-Nov-13	White Bass	Beryllium-7	4.38E+00	pCi/kg	3.97E+01		U
Fish	Indicator	F-2	21-Nov-13	White Bass	Cerium-141	2.07E+00	pCi/kg	9.71E+00		U
Fish	Indicator	F-2	21-Nov-13	White Bass	Cerium-144	1.17E+00	pCi/kg	1.89E+01		U
Fish	Indicator	F-2	21-Nov-13	White Bass	Cesium-134	-1.03E+00	pCi/kg	3.45E+00	60	U
Fish	Indicator	F-2	21-Nov-13	White Bass	Cesium-137	9.85E+00	pCi/kg	3.07E+00	80	M
Fish	Indicator	F-2	21-Nov-13	White Bass	Chromium-51	1.72E+01	pCi/kg	6.38E+01		U
Fish	Indicator	F-2	21-Nov-13	White Bass	Cobalt-57	-7.29E-01	pCi/kg	2.51E+00		U
Fish	Indicator	F-2	21-Nov-13	White Bass	Cobalt-58	1.75E+00	pCi/kg	4.24E+00	130	U
Fish	Indicator	F-2	21-Nov-13	White Bass	Cobalt-60	7.73E-01	pCi/kg	3.95E+00	130	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Fish	Indicator	F-2	21-Nov-13	White Bass	Iodine-131	-6.50E+00	pCi/kg	9.26E+01	60	DLU
Fish	Indicator	F-2	21-Nov-13	White Bass	Iron-59	7.99E+00	pCi/kg	1.34E+01	260	U
Fish	Indicator	F-2	21-Nov-13	White Bass	Lanthanum-140	-2.49E+01	pCi/kg	2.60E+01		U
Fish	Indicator	F-2	21-Nov-13	White Bass	Manganese-54	1.30E+00	pCi/kg	3.45E+00	130	U
Fish	Indicator	F-2	21-Nov-13	White Bass	Niobium-95	3.38E+00	pCi/kg	4.53E+00		U
Fish	Indicator	F-2	21-Nov-13	White Bass	Potassium-40	3.38E+03	pCi/kg	2.82E+01		
Fish	Indicator	F-2	21-Nov-13	White Bass	Ruthenium-103	-1.63E+00	pCi/kg	5.54E+00		U
Fish	Indicator	F-2	21-Nov-13	White Bass	Ruthenium-106	-6.79E+00	pCi/kg	2.92E+01		U
Fish	Indicator	F-2	21-Nov-13	White Bass	Selenium-75	2.58E+00	pCi/kg	4.95E+00		U
Fish	Indicator	F-2	21-Nov-13	White Bass	Silver-108m	9.63E-01	pCi/kg	2.67E+00		U
Fish	Indicator	F-2	21-Nov-13	White Bass	Silver-110m	-1.25E+00	pCi/kg	4.90E+00		U
Fish	Indicator	F-2	21-Nov-13	White Bass	Strontium-89	-4.56E+01	pCi/kg	1.29E+02	300	U
Fish	Indicator	F-2	21-Nov-13	White Bass	Strontium-90	-1.99E+01	pCi/kg	7.82E+01	300	U
Fish	Indicator	F-2	21-Nov-13	White Bass	Thorium-228	-4.80E+00	pCi/kg	5.79E+00		U
Fish	Indicator	F-2	21-Nov-13	White Bass	Zinc-65	-5.41E+00	pCi/kg	8.49E+00	260	U
Fish	Indicator	F-2	21-Nov-13	White Bass	Zirconium-95	1.58E+00	pCi/kg	8.25E+00		U
Fish	Control	F-3	08-May-13	White Perch	Actinium-228	-2.01E+01	pCi/kg	2.82E+01		U
Fish	Control	F-3	08-May-13	White Perch	Antimony-124	6.92E+00	pCi/kg	2.65E+01		U
Fish	Control	F-3	08-May-13	White Perch	Antimony-125	9.68E+00	pCi/kg	1.80E+01		U
Fish	Control	F-3	08-May-13	White Perch	Barium-140	7.72E+01	pCi/kg	2.51E+02		U
Fish	Control	F-3	08-May-13	White Perch	Beryllium-7	-3.36E+01	pCi/kg	8.78E+01		U
Fish	Control	F-3	08-May-13	White Perch	Cerium-141	-1.95E+01	pCi/kg	2.19E+01		U
Fish	Control	F-3	08-May-13	White Perch	Cerium-144	1.21E+00	pCi/kg	3.89E+01		U
Fish	Control	F-3	08-May-13	White Perch	Cesium-134	2.56E-01	pCi/kg	7.27E+00	60	U
Fish	Control	F-3	08-May-13	White Perch	Cesium-137	6.31E+00	pCi/kg	6.58E+00	80	U
Fish	Control	F-3	08-May-13	White Perch	Chromium-51	-4.12E+01	pCi/kg	1.56E+02		U
Fish	Control	F-3	08-May-13	White Perch	Cobalt-57	2.12E+00	pCi/kg	5.02E+00		U
Fish	Control	F-3	08-May-13	White Perch	Cobalt-58	-5.70E-01	pCi/kg	8.93E+00	130	U
Fish	Control	F-3	08-May-13	White Perch	Cobalt-60	3.56E+00	pCi/kg	7.70E+00	130	U
Fish	Control	F-3	08-May-13	White Perch	Iodine-131	1.21E+02	pCi/kg	2.96E+02	60	DL
Fish	Control	F-3	08-May-13	White Perch	Iron-59	1.12E+01	pCi/kg	2.55E+01	260	U
Fish	Control	F-3	08-May-13	White Perch	Lanthanum-140	-2.57E+01	pCi/kg	7.11E+01		U
Fish	Control	F-3	08-May-13	White Perch	Manganese-54	3.80E+00	pCi/kg	7.51E+00	130	U
Fish	Control	F-3	08-May-13	White Perch	Niobium-95	4.86E+00	pCi/kg	1.03E+01		U
Fish	Control	F-3	08-May-13	White Perch	Potassium-40	2.43E+03	pCi/kg	6.79E+01		
Fish	Control	F-3	08-May-13	White Perch	Ruthenium-103	-8.04E+00	pCi/kg	1.22E+01		U
Fish	Control	F-3	08-May-13	White Perch	Ruthenium-106	3.29E+01	pCi/kg	6.18E+01		U
Fish	Control	F-3	08-May-13	White Perch	Selenium-75	5.80E+00	pCi/kg	1.05E+01		U
Fish	Control	F-3	08-May-13	White Perch	Silver-108m	-1.04E+00	pCi/kg	5.71E+00		U
Fish	Control	F-3	08-May-13	White Perch	Silver-110m	-7.47E+00	pCi/kg	9.51E+00		U
Fish	Control	F-3	08-May-13	White Perch	Strontium-89	1.00E+02	pCi/kg	1.51E+02	300	U
Fish	Control	F-3	08-May-13	White Perch	Strontium-90	-3.95E+00	pCi/kg	9.70E+01	300	U
Fish	Control	F-3	08-May-13	White Perch	Thorium-228	9.03E+00	pCi/kg	1.09E+01		U
Fish	Control	F-3	08-May-13	White Perch	Zinc-65	-3.58E+00	pCi/kg	1.69E+01	260	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Fish	Control	F-3	08-May-13	White Perch	Zirconium-95	-4.19E+00	pCi/kg	1.72E+01		U
Fish	Indicator	F-2	09-May-13	White Perch	Actinium-228	-5.08E+01	pCi/kg	5.26E+01		U
Fish	Indicator	F-2	09-May-13	White Perch	Antimony-124	-1.01E+01	pCi/kg	3.98E+01		U
Fish	Indicator	F-2	09-May-13	White Perch	Antimony-125	-1.55E+01	pCi/kg	2.99E+01		U
Fish	Indicator	F-2	09-May-13	White Perch	Barium-140	-9.33E+01	pCi/kg	4.10E+02		U
Fish	Indicator	F-2	09-May-13	White Perch	Beryllium-7	8.31E+01	pCi/kg	1.61E+02		U
Fish	Indicator	F-2	09-May-13	White Perch	Cerium-141	-3.20E+01	pCi/kg	3.24E+01		U
Fish	Indicator	F-2	09-May-13	White Perch	Cerium-144	2.18E+01	pCi/kg	5.70E+01		U
Fish	Indicator	F-2	09-May-13	White Perch	Cesium-134	1.39E+00	pCi/kg	1.48E+01	60	U
Fish	Indicator	F-2	09-May-13	White Perch	Cesium-137	1.67E+00	pCi/kg	1.32E+01	80	U
Fish	Indicator	F-2	09-May-13	White Perch	Chromium-51	-6.49E-01	pCi/kg	2.26E+02		U
Fish	Indicator	F-2	09-May-13	White Perch	Cobalt-57	2.10E+00	pCi/kg	7.12E+00		U
Fish	Indicator	F-2	09-May-13	White Perch	Cobalt-58	-4.80E+00	pCi/kg	1.69E+01	130	U
Fish	Indicator	F-2	09-May-13	White Perch	Cobalt-60	-1.58E+00	pCi/kg	1.32E+01	130	U
Fish	Indicator	F-2	09-May-13	White Perch	Iodine-131	1.56E+02	pCi/kg	4.53E+02	60	DL
Fish	Indicator	F-2	09-May-13	White Perch	Iron-59	6.65E-01	pCi/kg	4.71E+01	260	U
Fish	Indicator	F-2	09-May-13	White Perch	Lanthanum-140	-8.44E+01	pCi/kg	1.29E+02		U
Fish	Indicator	F-2	09-May-13	White Perch	Manganese-54	-6.74E+00	pCi/kg	1.23E+01	130	U
Fish	Indicator	F-2	09-May-13	White Perch	Niobium-95	8.85E+00	pCi/kg	1.87E+01		U
Fish	Indicator	F-2	09-May-13	White Perch	Potassium-40	2.54E+03	pCi/kg	1.19E+02		
Fish	Indicator	F-2	09-May-13	White Perch	Ruthenium-103	-5.32E+00	pCi/kg	2.27E+01		U
Fish	Indicator	F-2	09-May-13	White Perch	Ruthenium-106	2.94E+01	pCi/kg	1.16E+02		U
Fish	Indicator	F-2	09-May-13	White Perch	Selenium-75	8.58E+00	pCi/kg	1.67E+01		U
Fish	Indicator	F-2	09-May-13	White Perch	Silver-108m	-3.10E+00	pCi/kg	9.71E+00		U
Fish	Indicator	F-2	09-May-13	White Perch	Silver-110m	8.64E-02	pCi/kg	1.81E+01		U
Fish	Indicator	F-2	09-May-13	White Perch	Strontium-89	-4.04E+00	pCi/kg	1.31E+02	300	U
Fish	Indicator	F-2	09-May-13	White Perch	Strontium-90	-2.67E+01	pCi/kg	9.44E+01	300	U
Fish	Indicator	F-2	09-May-13	White Perch	Thorium-228	9.15E+00	pCi/kg	1.71E+01		U
Fish	Indicator	F-2	09-May-13	White Perch	Zinc-65	1.15E+00	pCi/kg	3.00E+01	260	U
Fish	Indicator	F-2	09-May-13	White Perch	Zirconium-95	7.48E+00	pCi/kg	3.29E+01		U
Fish	Control	F-1	16-May-13	White Perch	Actinium-228	-9.74E+00	pCi/kg	3.06E+01		U
Fish	Control	F-1	16-May-13	White Perch	Antimony-124	-1.30E+01	pCi/kg	1.84E+01		U
Fish	Control	F-1	16-May-13	White Perch	Antimony-125	-7.12E+00	pCi/kg	1.78E+01		U
Fish	Control	F-1	16-May-13	White Perch	Barium-140	-6.69E+00	pCi/kg	1.68E+02		U
Fish	Control	F-1	16-May-13	White Perch	Beryllium-7	3.65E+00	pCi/kg	9.10E+01		U
Fish	Control	F-1	16-May-13	White Perch	Cerium-141	1.36E+01	pCi/kg	1.94E+01		U
Fish	Control	F-1	16-May-13	White Perch	Cerium-144	-1.13E+01	pCi/kg	3.80E+01		U
Fish	Control	F-1	16-May-13	White Perch	Cesium-134	2.26E+00	pCi/kg	7.98E+00	60	U
Fish	Control	F-1	16-May-13	White Perch	Cesium-137	3.95E+00	pCi/kg	7.50E+00	80	U
Fish	Control	F-1	16-May-13	White Perch	Chromium-51	6.89E+01	pCi/kg	1.28E+02		U
Fish	Control	F-1	16-May-13	White Perch	Cobalt-57	7.42E-01	pCi/kg	5.03E+00		U
Fish	Control	F-1	16-May-13	White Perch	Cobalt-58	1.02E+00	pCi/kg	9.13E+00	130	U
Fish	Control	F-1	16-May-13	White Perch	Cobalt-60	1.71E+00	pCi/kg	7.68E+00	130	U
Fish	Control	F-1	16-May-13	White Perch	Iodine-131	3.23E+01	pCi/kg	1.53E+02	60	DLU

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Fish	Control	F-1	16-May-13	White Perch	Iron-59	8.37E+00	pCi/kg	2.33E+01	260	U
Fish	Control	F-1	16-May-13	White Perch	Lanthanum-140	6.46E+00	pCi/kg	5.07E+01		U
Fish	Control	F-1	16-May-13	White Perch	Manganese-54	2.02E+00	pCi/kg	7.58E+00	130	U
Fish	Control	F-1	16-May-13	White Perch	Niobium-95	7.92E+00	pCi/kg	1.02E+01		U
Fish	Control	F-1	16-May-13	White Perch	Potassium-40	2.50E+03	pCi/kg	6.15E+01		
Fish	Control	F-1	16-May-13	White Perch	Ruthenium-103	-3.43E+00	pCi/kg	1.17E+01		U
Fish	Control	F-1	16-May-13	White Perch	Ruthenium-106	2.93E+01	pCi/kg	6.75E+01		U
Fish	Control	F-1	16-May-13	White Perch	Selenium-75	-3.15E-01	pCi/kg	9.82E+00		U
Fish	Control	F-1	16-May-13	White Perch	Silver-108m	1.02E+00	pCi/kg	6.00E+00		U
Fish	Control	F-1	16-May-13	White Perch	Silver-110m	1.68E+00	pCi/kg	1.04E+01		U
Fish	Control	F-1	16-May-13	White Perch	Strontium-89	-1.70E+02	pCi/kg	1.55E+02	300	U
Fish	Control	F-1	16-May-13	White Perch	Strontium-90	-5.99E+01	pCi/kg	9.58E+01	300	U
Fish	Control	F-1	16-May-13	White Perch	Thorium-228	-1.98E+01	pCi/kg	1.25E+01		U
Fish	Control	F-1	16-May-13	White Perch	Zinc-65	-6.21E+00	pCi/kg	1.67E+01	260	U
Fish	Control	F-1	16-May-13	White Perch	Zirconium-95	6.68E+00	pCi/kg	1.76E+01		U
Fish	Indicator	F-2	21-Nov-13	White Perch	Actinium-228	-1.78E+00	pCi/kg	1.40E+01		U
Fish	Indicator	F-2	21-Nov-13	White Perch	Antimony-124	-4.34E+00	pCi/kg	7.47E+00		U
Fish	Indicator	F-2	21-Nov-13	White Perch	Antimony-125	2.32E+00	pCi/kg	7.78E+00		U
Fish	Indicator	F-2	21-Nov-13	White Perch	Barium-140	-1.40E+01	pCi/kg	8.58E+01		U
Fish	Indicator	F-2	21-Nov-13	White Perch	Beryllium-7	-1.29E+01	pCi/kg	3.79E+01		U
Fish	Indicator	F-2	21-Nov-13	White Perch	Cerium-141	-3.34E-01	pCi/kg	8.88E+00		U
Fish	Indicator	F-2	21-Nov-13	White Perch	Cerium-144	1.50E+00	pCi/kg	1.78E+01		U
Fish	Indicator	F-2	21-Nov-13	White Perch	Cesium-134	6.82E-02	pCi/kg	3.38E+00	60	U
Fish	Indicator	F-2	21-Nov-13	White Perch	Cesium-137	-3.70E-01	pCi/kg	3.96E+00	80	U
Fish	Indicator	F-2	21-Nov-13	White Perch	Chromium-51	-2.03E+00	pCi/kg	6.06E+01		U
Fish	Indicator	F-2	21-Nov-13	White Perch	Cobalt-57	-1.39E-01	pCi/kg	2.30E+00		U
Fish	Indicator	F-2	21-Nov-13	White Perch	Cobalt-58	-4.79E-01	pCi/kg	4.30E+00	130	U
Fish	Indicator	F-2	21-Nov-13	White Perch	Cobalt-60	-1.42E+00	pCi/kg	3.28E+00	130	U
Fish	Indicator	F-2	21-Nov-13	White Perch	Iodine-131	-1.93E+01	pCi/kg	8.47E+01	60	DLU
Fish	Indicator	F-2	21-Nov-13	White Perch	Iron-59	2.83E+00	pCi/kg	1.23E+01	260	U
Fish	Indicator	F-2	21-Nov-13	White Perch	Lanthanum-140	-5.27E+00	pCi/kg	2.38E+01		U
Fish	Indicator	F-2	21-Nov-13	White Perch	Manganese-54	7.39E-01	pCi/kg	3.30E+00	130	U
Fish	Indicator	F-2	21-Nov-13	White Perch	Niobium-95	-3.91E-01	pCi/kg	4.62E+00		U
Fish	Indicator	F-2	21-Nov-13	White Perch	Potassium-40	3.13E+03	pCi/kg	2.94E+01		
Fish	Indicator	F-2	21-Nov-13	White Perch	Ruthenium-103	-2.90E+00	pCi/kg	5.16E+00		U
Fish	Indicator	F-2	21-Nov-13	White Perch	Ruthenium-106	2.44E+00	pCi/kg	2.71E+01		U
Fish	Indicator	F-2	21-Nov-13	White Perch	Selenium-75	6.62E-01	pCi/kg	4.50E+00		U
Fish	Indicator	F-2	21-Nov-13	White Perch	Silver-108m	1.30E-01	pCi/kg	2.48E+00		U
Fish	Indicator	F-2	21-Nov-13	White Perch	Silver-110m	3.81E-01	pCi/kg	4.74E+00		U
Fish	Indicator	F-2	21-Nov-13	White Perch	Strontium-89	-6.55E+01	pCi/kg	1.10E+02	300	U
Fish	Indicator	F-2	21-Nov-13	White Perch	Strontium-90	4.09E+01	pCi/kg	9.46E+01	300	U
Fish	Indicator	F-2	21-Nov-13	White Perch	Thorium-228	2.67E+00	pCi/kg	4.97E+00		U
Fish	Indicator	F-2	21-Nov-13	White Perch	Zinc-65	-1.93E+00	pCi/kg	8.11E+00	260	U
Fish	Indicator	F-2	21-Nov-13	White Perch	Zirconium-95	1.11E+00	pCi/kg	7.85E+00		U



Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Fish	Control	F-3	22-Nov-13	White Perch	Actinium-228	1.40E+00	pCi/kg	1.31E+01		U
Fish	Control	F-3	22-Nov-13	White Perch	Antimony-124	-2.00E-01	pCi/kg	8.85E+00		U
Fish	Control	F-3	22-Nov-13	White Perch	Antimony-125	2.13E+00	pCi/kg	8.37E+00		U
Fish	Control	F-3	22-Nov-13	White Perch	Barium-140	-2.39E+01	pCi/kg	8.88E+01		U
Fish	Control	F-3	22-Nov-13	White Perch	Beryllium-7	-1.34E+01	pCi/kg	3.83E+01		U
Fish	Control	F-3	22-Nov-13	White Perch	Cerium-141	7.53E+00	pCi/kg	9.64E+00		U
Fish	Control	F-3	22-Nov-13	White Perch	Cerium-144	-5.39E+00	pCi/kg	1.91E+01		U
Fish	Control	F-3	22-Nov-13	White Perch	Cesium-134	9.70E-01	pCi/kg	3.59E+00	60	U
Fish	Control	F-3	22-Nov-13	White Perch	Cesium-137	1.47E+00	pCi/kg	3.27E+00	80	U
Fish	Control	F-3	22-Nov-13	White Perch	Chromium-51	-3.26E+01	pCi/kg	6.11E+01		U
Fish	Control	F-3	22-Nov-13	White Perch	Cobalt-57	-5.51E-01	pCi/kg	2.54E+00		U
Fish	Control	F-3	22-Nov-13	White Perch	Cobalt-58	-1.02E-01	pCi/kg	4.21E+00	130	U
Fish	Control	F-3	22-Nov-13	White Perch	Cobalt-60	2.26E-01	pCi/kg	3.57E+00	130	U
Fish	Control	F-3	22-Nov-13	White Perch	Iodine-131	-4.30E+01	pCi/kg	8.18E+01	60	DLU
Fish	Control	F-3	22-Nov-13	White Perch	Iron-59	2.35E+00	pCi/kg	1.23E+01	260	U
Fish	Control	F-3	22-Nov-13	White Perch	Lanthanum-140	-1.15E+00	pCi/kg	2.39E+01		U
Fish	Control	F-3	22-Nov-13	White Perch	Manganese-54	-1.73E+00	pCi/kg	3.12E+00	130	U
Fish	Control	F-3	22-Nov-13	White Perch	Niobium-95	1.18E+00	pCi/kg	4.48E+00		U
Fish	Control	F-3	22-Nov-13	White Perch	Potassium-40	3.38E+03	pCi/kg	3.10E+01		
Fish	Control	F-3	22-Nov-13	White Perch	Ruthenium-103	-2.16E+00	pCi/kg	5.47E+00		U
Fish	Control	F-3	22-Nov-13	White Perch	Ruthenium-106	1.80E+01	pCi/kg	2.95E+01		U
Fish	Control	F-3	22-Nov-13	White Perch	Selenium-75	-1.48E+00	pCi/kg	4.62E+00		U
Fish	Control	F-3	22-Nov-13	White Perch	Silver-108m	-1.31E+00	pCi/kg	2.67E+00		U
Fish	Control	F-3	22-Nov-13	White Perch	Silver-110m	-2.18E+00	pCi/kg	4.54E+00		U
Fish	Control	F-3	22-Nov-13	White Perch	Strontium-89	-9.41E+01	pCi/kg	1.27E+02	300	U
Fish	Control	F-3	22-Nov-13	White Perch	Strontium-90	-3.49E+01	pCi/kg	8.31E+01	300	U
Fish	Control	F-3	22-Nov-13	White Perch	Thorium-228	1.55E+00	pCi/kg	5.98E+00		U
Fish	Control	F-3	22-Nov-13	White Perch	Zinc-65	8.29E-03	pCi/kg	8.34E+00	260	U
Fish	Control	F-3	22-Nov-13	White Perch	Zirconium-95	2.66E+00	pCi/kg	8.13E+00		U
Fish	Indicator	F-2	09-May-13	White Sucker	Actinium-228	1.83E+01	pCi/kg	2.63E+01		U
Fish	Indicator	F-2	09-May-13	White Sucker	Antimony-124	-1.87E+00	pCi/kg	2.22E+01		U
Fish	Indicator	F-2	09-May-13	White Sucker	Antimony-125	9.31E-01	pCi/kg	1.97E+01		U
Fish	Indicator	F-2	09-May-13	White Sucker	Barium-140	1.08E+02	pCi/kg	2.81E+02		U
Fish	Indicator	F-2	09-May-13	White Sucker	Beryllium-7	-8.30E+00	pCi/kg	9.84E+01		U
Fish	Indicator	F-2	09-May-13	White Sucker	Cerium-141	1.22E+01	pCi/kg	2.46E+01		U
Fish	Indicator	F-2	09-May-13	White Sucker	Cerium-144	-1.05E+01	pCi/kg	4.41E+01		U
Fish	Indicator	F-2	09-May-13	White Sucker	Cesium-134	4.23E+00	pCi/kg	8.72E+00	60	U
Fish	Indicator	F-2	09-May-13	White Sucker	Cesium-137	3.04E+00	pCi/kg	8.02E+00	80	U
Fish	Indicator	F-2	09-May-13	White Sucker	Chromium-51	1.08E+01	pCi/kg	1.69E+02		U
Fish	Indicator	F-2	09-May-13	White Sucker	Cobalt-57	8.14E-01	pCi/kg	5.85E+00		U
Fish	Indicator	F-2	09-May-13	White Sucker	Cobalt-58	-1.41E+00	pCi/kg	1.04E+01	130	U
Fish	Indicator	F-2	09-May-13	White Sucker	Cobalt-60	-1.88E-01	pCi/kg	7.40E+00	130	U
Fish	Indicator	F-2	09-May-13	White Sucker	Iodine-131	8.62E+01	pCi/kg	3.04E+02	60	DL
Fish	Indicator	F-2	09-May-13	White Sucker	Iron-59	-3.02E+00	pCi/kg	2.68E+01	260	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Fish	Indicator	F-2	09-May-13	White Sucker	Lanthanum-140	4.48E+00	pCi/kg	8.03E+01		U
Fish	Indicator	F-2	09-May-13	White Sucker	Manganese-54	9.51E-01	pCi/kg	8.12E+00	130	U
Fish	Indicator	F-2	09-May-13	White Sucker	Niobium-95	-6.46E+00	pCi/kg	1.11E+01		U
Fish	Indicator	F-2	09-May-13	White Sucker	Potassium-40	2.86E+03	pCi/kg	6.85E+01		
Fish	Indicator	F-2	09-May-13	White Sucker	Ruthenium-103	4.30E+00	pCi/kg	1.42E+01		U
Fish	Indicator	F-2	09-May-13	White Sucker	Ruthenium-106	7.73E+00	pCi/kg	7.55E+01		U
Fish	Indicator	F-2	09-May-13	White Sucker	Selenium-75	-9.42E+00	pCi/kg	1.17E+01		U
Fish	Indicator	F-2	09-May-13	White Sucker	Silver-108m	-7.12E-01	pCi/kg	6.27E+00		U
Fish	Indicator	F-2	09-May-13	White Sucker	Silver-110m	-3.26E+00	pCi/kg	1.04E+01		U
Fish	Indicator	F-2	09-May-13	White Sucker	Strontium-89	-9.80E+01	pCi/kg	1.30E+02	300	U
Fish	Indicator	F-2	09-May-13	White Sucker	Strontium-90	-4.21E+01	pCi/kg	9.79E+01	300	U
Fish	Indicator	F-2	09-May-13	White Sucker	Thorium-228	5.55E-01	pCi/kg	1.44E+01		U
Fish	Indicator	F-2	09-May-13	White Sucker	Zinc-65	-5.60E+00	pCi/kg	1.73E+01	260	U
Fish	Indicator	F-2	09-May-13	White Sucker	Zirconium-95	4.37E+00	pCi/kg	1.96E+01		U
Fish	Control	F-3	22-Nov-13	White Sucker	Actinium-228	2.40E+01	pCi/kg	5.49E+01		U
Fish	Control	F-3	22-Nov-13	White Sucker	Antimony-124	-1.42E-01	pCi/kg	3.73E+01		U
Fish	Control	F-3	22-Nov-13	White Sucker	Antimony-125	-1.82E+01	pCi/kg	3.22E+01		U
Fish	Control	F-3	22-Nov-13	White Sucker	Barium-140	-1.65E+02	pCi/kg	3.28E+02		U
Fish	Control	F-3	22-Nov-13	White Sucker	Beryllium-7	8.09E+01	pCi/kg	1.59E+02		U
Fish	Control	F-3	22-Nov-13	White Sucker	Cerium-141	-9.67E+00	pCi/kg	3.82E+01		U
Fish	Control	F-3	22-Nov-13	White Sucker	Cerium-144	-1.20E+01	pCi/kg	7.14E+01		U
Fish	Control	F-3	22-Nov-13	White Sucker	Cesium-134	-1.44E+00	pCi/kg	1.32E+01	60	U
Fish	Control	F-3	22-Nov-13	White Sucker	Cesium-137	-2.76E+00	pCi/kg	1.26E+01	80	U
Fish	Control	F-3	22-Nov-13	White Sucker	Chromium-51	4.72E+01	pCi/kg	2.47E+02		U
Fish	Control	F-3	22-Nov-13	White Sucker	Cobalt-57	1.74E-01	pCi/kg	9.28E+00		U
Fish	Control	F-3	22-Nov-13	White Sucker	Cobalt-58	-4.19E+00	pCi/kg	1.58E+01	130	U
Fish	Control	F-3	22-Nov-13	White Sucker	Cobalt-60	-1.46E-01	pCi/kg	1.32E+01	130	U
Fish	Control	F-3	22-Nov-13	White Sucker	Iodine-131	-1.44E+01	pCi/kg	3.34E+02	60	DLU
Fish	Control	F-3	22-Nov-13	White Sucker	Iron-59	9.08E+00	pCi/kg	4.12E+01	260	U
Fish	Control	F-3	22-Nov-13	White Sucker	Lanthanum-140	4.55E+01	pCi/kg	1.16E+02		U
Fish	Control	F-3	22-Nov-13	White Sucker	Manganese-54	1.47E+00	pCi/kg	1.26E+01	130	U
Fish	Control	F-3	22-Nov-13	White Sucker	Niobium-95	1.38E+01	pCi/kg	1.85E+01		U
Fish	Control	F-3	22-Nov-13	White Sucker	Potassium-40	3.23E+03	pCi/kg	1.08E+02		
Fish	Control	F-3	22-Nov-13	White Sucker	Ruthenium-103	8.79E-01	pCi/kg	2.14E+01		U
Fish	Control	F-3	22-Nov-13	White Sucker	Ruthenium-106	-4.55E+01	pCi/kg	1.15E+02		U
Fish	Control	F-3	22-Nov-13	White Sucker	Selenium-75	-8.11E+00	pCi/kg	1.82E+01		U
Fish	Control	F-3	22-Nov-13	White Sucker	Silver-108m	-2.43E+00	pCi/kg	1.05E+01		U
Fish	Control	F-3	22-Nov-13	White Sucker	Silver-110m	-9.57E+00	pCi/kg	1.70E+01		U
Fish	Control	F-3	22-Nov-13	White Sucker	Strontium-89	-9.36E+01	pCi/kg	1.16E+02	300	U
Fish	Control	F-3	22-Nov-13	White Sucker	Strontium-90	-5.47E+01	pCi/kg	8.60E+01	300	U
Fish	Control	F-3	22-Nov-13	White Sucker	Thorium-228	-1.53E+01	pCi/kg	2.55E+01		U
Fish	Control	F-3	22-Nov-13	White Sucker	Zinc-65	6.49E+00	pCi/kg	2.89E+01	260	U
Fish	Control	F-3	22-Nov-13	White Sucker	Zirconium-95	-8.68E+00	pCi/kg	2.89E+01		U
Fish	Control	F-3	08-May-13	Yellow Perch	Actinium-228	4.64E+01	pCi/kg	8.32E+01		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Fish	Control	F-3	08-May-13	Yellow Perch	Antimony-124	-3.84E+01	pCi/kg	8.28E+01		U
Fish	Control	F-3	08-May-13	Yellow Perch	Antimony-125	-1.31E+01	pCi/kg	5.63E+01		U
Fish	Control	F-3	08-May-13	Yellow Perch	Barium-140	3.65E+02	pCi/kg	8.79E+02		U
Fish	Control	F-3	08-May-13	Yellow Perch	Beryllium-7	-6.77E+01	pCi/kg	2.84E+02		U
Fish	Control	F-3	08-May-13	Yellow Perch	Cerium-141	5.78E+00	pCi/kg	6.26E+01		U
Fish	Control	F-3	08-May-13	Yellow Perch	Cerium-144	3.13E+01	pCi/kg	1.14E+02		U
Fish	Control	F-3	08-May-13	Yellow Perch	Cesium-134	7.99E+00	pCi/kg	2.68E+01	60	U
Fish	Control	F-3	08-May-13	Yellow Perch	Cesium-137	1.78E+01	pCi/kg	2.55E+01	80	U
Fish	Control	F-3	08-May-13	Yellow Perch	Chromium-51	-5.62E+02	pCi/kg	4.63E+02		U
Fish	Control	F-3	08-May-13	Yellow Perch	Cobalt-57	9.06E-01	pCi/kg	1.47E+01		U
Fish	Control	F-3	08-May-13	Yellow Perch	Cobalt-58	-1.10E+01	pCi/kg	3.45E+01	130	U
Fish	Control	F-3	08-May-13	Yellow Perch	Cobalt-60	-1.74E+00	pCi/kg	2.90E+01	130	U
Fish	Control	F-3	08-May-13	Yellow Perch	Iodine-131	1.94E+01	pCi/kg	9.48E+02	60	DLU
Fish	Control	F-3	08-May-13	Yellow Perch	Iron-59	-1.60E+01	pCi/kg	9.19E+01	260	U
Fish	Control	F-3	08-May-13	Yellow Perch	Lanthanum-140	-9.00E+01	pCi/kg	3.20E+02		U
Fish	Control	F-3	08-May-13	Yellow Perch	Manganese-54	-1.11E+01	pCi/kg	2.49E+01	130	U
Fish	Control	F-3	08-May-13	Yellow Perch	Niobium-95	5.71E+00	pCi/kg	3.66E+01		U
Fish	Control	F-3	08-May-13	Yellow Perch	Potassium-40	2.94E+03	pCi/kg	2.49E+02		
Fish	Control	F-3	08-May-13	Yellow Perch	Ruthenium-103	1.49E+00	pCi/kg	4.21E+01		U
Fish	Control	F-3	08-May-13	Yellow Perch	Ruthenium-106	9.28E+01	pCi/kg	2.30E+02		U
Fish	Control	F-3	08-May-13	Yellow Perch	Selenium-75	6.23E+00	pCi/kg	3.19E+01		U
Fish	Control	F-3	08-May-13	Yellow Perch	Silver-108m	-5.29E+00	pCi/kg	1.83E+01		U
Fish	Control	F-3	08-May-13	Yellow Perch	Silver-110m	-1.27E+01	pCi/kg	3.66E+01		U
Fish	Control	F-3	08-May-13	Yellow Perch	Strontium-89	-6.34E+01	pCi/kg	1.23E+02	300	U
Fish	Control	F-3	08-May-13	Yellow Perch	Strontium-90	-3.14E+01	pCi/kg	8.48E+01	300	U
Fish	Control	F-3	08-May-13	Yellow Perch	Thorium-228	1.08E+01	pCi/kg	3.41E+01		U
Fish	Control	F-3	08-May-13	Yellow Perch	Zinc-65	2.57E+01	pCi/kg	6.22E+01	260	U
Fish	Control	F-3	08-May-13	Yellow Perch	Zirconium-95	3.00E+01	pCi/kg	6.86E+01		U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Actinium-228	-1.14E+01	pCi/L	9.69E+00		U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Antimony-124	-1.68E+00	pCi/L	4.49E+00		U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Antimony-125	2.68E-01	pCi/L	6.11E+00		U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Barium-140	9.67E-01	pCi/L	3.18E+00	15	U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Beryllium-7	-8.12E+00	pCi/L	1.85E+01		U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Cerium-141	-3.40E+00	pCi/L	3.75E+00		U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Cerium-144	5.26E-01	pCi/L	1.50E+01		U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Cesium-134	6.93E-01	pCi/L	2.41E+00	15	U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Cesium-137	2.24E+00	pCi/L	2.24E+00	18	UI
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Chromium-51	-2.44E+00	pCi/L	1.82E+01		U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Cobalt-57	-7.46E-03	pCi/L	1.94E+00		U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Cobalt-58	-8.99E-01	pCi/L	2.14E+00	15	U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Cobalt-60	2.34E-01	pCi/L	2.14E+00	15	U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Iodine-131	-2.20E-01	pCi/L	2.59E+00		U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Iron-59	-7.42E-01	pCi/L	4.06E+00	30	U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Lanthanum-140	9.67E-01	pCi/L	3.18E+00	15	U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Manganese-54	2.05E-01	pCi/L	2.11E+00	15	U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Niobium-95	2.05E+00	pCi/L	2.05E+00	15	UI
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Potassium-40	1.84E+01	pCi/L	2.15E+01		U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Ruthenium-103	-5.83E-01	pCi/L	2.10E+00		U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Ruthenium-106	-1.05E+01	pCi/L	1.84E+01		U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Selenium-75	-9.21E-02	pCi/L	2.96E+00		U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Silver-108m	7.29E-01	pCi/L	2.00E+00		U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Silver-110m	-6.17E-02	pCi/L	2.03E+00		U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Thorium-228	1.51E+00	pCi/L	3.83E+00		U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Tritium	-1.51E+02	pCi/L	3.71E+02	500	U
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Zinc-65	4.67E+00	pCi/L	4.67E+00	30	UI
Ground Water	Indicator	GW-1	27-Mar-13	Grab	Zirconium-95	8.94E-01	pCi/L	3.90E+00	15	U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Actinium-228	5.46E+00	pCi/L	7.26E+00		U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Antimony-124	-1.55E+00	pCi/L	3.65E+00		U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Antimony-125	4.47E-01	pCi/L	4.85E+00		U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Barium-140	-5.83E-01	pCi/L	2.04E+00	15	U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Beryllium-7	-5.32E+00	pCi/L	1.37E+01		U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Cerium-141	-2.50E+00	pCi/L	3.18E+00		U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Cerium-144	-2.63E+00	pCi/L	1.21E+01		U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Cesium-134	-2.78E-02	pCi/L	1.92E+00	15	U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Cesium-137	2.37E-01	pCi/L	1.74E+00	18	U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Chromium-51	6.36E-01	pCi/L	1.56E+01		U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Cobalt-57	2.80E-01	pCi/L	1.57E+00		U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Cobalt-58	5.96E-01	pCi/L	1.62E+00	15	U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Cobalt-60	-1.22E+00	pCi/L	1.96E+00	15	U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Iodine-131	-1.33E-01	pCi/L	2.11E+00		U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Iron-59	-1.54E+00	pCi/L	3.11E+00	30	U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Lanthanum-140	-5.83E-01	pCi/L	2.04E+00	15	U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Manganese-54	1.43E-01	pCi/L	1.57E+00	15	U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Niobium-95	1.45E+00	pCi/L	1.77E+00	15	U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Potassium-40	3.96E+00	pCi/L	2.49E+01		U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Ruthenium-103	-8.60E-01	pCi/L	1.61E+00		U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Ruthenium-106	1.99E+00	pCi/L	1.57E+01		U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Selenium-75	1.09E+00	pCi/L	2.46E+00		U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Silver-108m	-1.02E+00	pCi/L	1.54E+00		U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Silver-110m	-4.23E-01	pCi/L	1.47E+00		U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Thorium-228	1.21E+00	pCi/L	3.35E+00		U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Tritium	-2.02E+02	pCi/L	3.80E+02	500	U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Zinc-65	6.30E-01	pCi/L	3.44E+00	30	U
Ground Water	Indicator	GW-2	27-Mar-13	Grab	Zirconium-95	3.58E-01	pCi/L	2.83E+00	15	U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Actinium-228	-7.52E-02	pCi/L	6.77E+00		U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Antimony-124	7.00E-01	pCi/L	4.06E+00		U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Antimony-125	4.84E-01	pCi/L	4.97E+00		U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Barium-140	8.21E-01	pCi/L	2.45E+00	15	U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Beryllium-7	7.15E-02	pCi/L	1.40E+01		U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Cerium-141	-3.27E-01	pCi/L	3.37E+00		U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Cerium-144	-7.86E+00	pCi/L	1.25E+01		U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Cesium-134	6.81E-01	pCi/L	1.95E+00	15	U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Cesium-137	-2.16E+00	pCi/L	2.15E+00	18	U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Chromium-51	-7.63E+00	pCi/L	1.56E+01		U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Cobalt-57	1.03E+00	pCi/L	1.77E+00		U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Cobalt-58	-4.95E-01	pCi/L	1.68E+00	15	U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Cobalt-60	-5.49E-01	pCi/L	1.80E+00	15	U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Iodine-131	9.85E-01	pCi/L	2.26E+00		U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Iron-59	-4.14E-01	pCi/L	3.15E+00	30	U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Lanthanum-140	8.21E-01	pCi/L	2.45E+00	15	U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Manganese-54	-4.92E-01	pCi/L	1.65E+00	15	U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Niobium-95	5.97E-01	pCi/L	1.81E+00	15	U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Potassium-40	-7.99E+00	pCi/L	2.31E+01		U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Ruthenium-103	3.01E-02	pCi/L	1.71E+00		U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Ruthenium-106	-5.64E+00	pCi/L	1.43E+01		U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Selenium-75	-2.84E-01	pCi/L	2.49E+00		U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Silver-108m	-3.33E-01	pCi/L	1.53E+00		U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Silver-110m	-2.29E-01	pCi/L	1.58E+00		U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Thorium-228	4.67E-01	pCi/L	3.38E+00		U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Tritium	-1.72E+02	pCi/L	3.78E+02	500	U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Zinc-65	2.23E+00	pCi/L	3.78E+00	30	U
Ground Water	Indicator	GW-3	27-Mar-13	Grab	Zirconium-95	2.49E+00	pCi/L	3.00E+00	15	U
Ground Water	Control	GW-4	27-Mar-13	Grab	Actinium-228	1.77E+00	pCi/L	7.76E+00		U
Ground Water	Control	GW-4	27-Mar-13	Grab	Antimony-124	2.93E-01	pCi/L	4.08E+00		U
Ground Water	Control	GW-4	27-Mar-13	Grab	Antimony-125	-6.36E-02	pCi/L	5.54E+00		U
Ground Water	Control	GW-4	27-Mar-13	Grab	Barium-140	9.17E-01	pCi/L	2.55E+00	15	U
Ground Water	Control	GW-4	27-Mar-13	Grab	Beryllium-7	2.94E+00	pCi/L	1.62E+01		U
Ground Water	Control	GW-4	27-Mar-13	Grab	Cerium-141	-1.46E+00	pCi/L	3.42E+00		U
Ground Water	Control	GW-4	27-Mar-13	Grab	Cerium-144	3.92E+00	pCi/L	1.42E+01		U
Ground Water	Control	GW-4	27-Mar-13	Grab	Cesium-134	5.03E-01	pCi/L	2.03E+00	15	U
Ground Water	Control	GW-4	27-Mar-13	Grab	Cesium-137	-9.15E-01	pCi/L	2.00E+00	18	U
Ground Water	Control	GW-4	27-Mar-13	Grab	Chromium-51	-8.08E+00	pCi/L	1.61E+01		U
Ground Water	Control	GW-4	27-Mar-13	Grab	Cobalt-57	-7.88E-03	pCi/L	1.88E+00		U
Ground Water	Control	GW-4	27-Mar-13	Grab	Cobalt-58	3.06E-01	pCi/L	1.66E+00	15	U
Ground Water	Control	GW-4	27-Mar-13	Grab	Cobalt-60	-5.42E-01	pCi/L	1.91E+00	15	U
Ground Water	Control	GW-4	27-Mar-13	Grab	Iodine-131	-5.13E-01	pCi/L	2.29E+00		U
Ground Water	Control	GW-4	27-Mar-13	Grab	Iron-59	8.75E-01	pCi/L	3.58E+00	30	U
Ground Water	Control	GW-4	27-Mar-13	Grab	Lanthanum-140	9.17E-01	pCi/L	2.55E+00	15	U
Ground Water	Control	GW-4	27-Mar-13	Grab	Manganese-54	-2.71E-01	pCi/L	1.71E+00	15	U
Ground Water	Control	GW-4	27-Mar-13	Grab	Niobium-95	2.32E+00	pCi/L	2.32E+00	15	UI
Ground Water	Control	GW-4	27-Mar-13	Grab	Potassium-40	-2.01E+01	pCi/L	2.31E+01		U
Ground Water	Control	GW-4	27-Mar-13	Grab	Ruthenium-103	-2.95E-01	pCi/L	1.81E+00		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Ground Water	Control	GW-4	27-Mar-13	Grab	Ruthenium-106	-1.00E+01	pCi/L	1.70E+01		U
Ground Water	Control	GW-4	27-Mar-13	Grab	Selenium-75	-1.58E+00	pCi/L	2.66E+00		U
Ground Water	Control	GW-4	27-Mar-13	Grab	Silver-108m	4.63E-01	pCi/L	1.80E+00		U
Ground Water	Control	GW-4	27-Mar-13	Grab	Silver-110m	-1.34E-01	pCi/L	1.73E+00		U
Ground Water	Control	GW-4	27-Mar-13	Grab	Thorium-228	2.49E+00	pCi/L	3.64E+00		U
Ground Water	Control	GW-4	27-Mar-13	Grab	Tritium	-1.40E+02	pCi/L	3.88E+02	500	U
Ground Water	Control	GW-4	27-Mar-13	Grab	Zinc-65	-1.71E+00	pCi/L	3.40E+00	30	U
Ground Water	Control	GW-4	27-Mar-13	Grab	Zirconium-95	-4.09E-01	pCi/L	3.11E+00	15	U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Actinium-228	3.66E+00	pCi/L	7.57E+00		U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Antimony-124	-1.61E+00	pCi/L	3.33E+00		U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Antimony-125	8.63E-01	pCi/L	5.23E+00		U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Barium-140	-9.91E-01	pCi/L	2.82E+00	15	U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Beryllium-7	-1.17E+00	pCi/L	1.60E+01		U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Cerium-141	5.81E-01	pCi/L	3.50E+00		U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Cerium-144	-3.87E+00	pCi/L	1.31E+01		U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Cesium-134	-4.62E-01	pCi/L	1.90E+00	15	U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Cesium-137	-8.24E-01	pCi/L	1.80E+00	18	U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Chromium-51	7.40E+00	pCi/L	1.86E+01		U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Cobalt-57	-6.52E-01	pCi/L	1.70E+00		U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Cobalt-58	2.45E-01	pCi/L	1.75E+00	15	U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Cobalt-60	5.82E-01	pCi/L	1.89E+00	15	U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Iodine-131	-9.07E-01	pCi/L	3.13E+00		U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Iron-59	-8.92E-01	pCi/L	3.58E+00	30	U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Lanthanum-140	-9.91E-01	pCi/L	2.82E+00	15	U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Manganese-54	-9.38E-01	pCi/L	1.61E+00	15	U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Niobium-95	1.20E+00	pCi/L	1.88E+00	15	U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Potassium-40	1.54E+01	pCi/L	2.74E+01		U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Ruthenium-103	1.94E-01	pCi/L	1.87E+00		U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Ruthenium-106	-2.70E+00	pCi/L	1.51E+01		U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Selenium-75	4.26E-01	pCi/L	2.70E+00		U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Silver-108m	1.23E+00	pCi/L	1.67E+00		U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Silver-110m	-5.23E-01	pCi/L	1.67E+00		U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Thorium-228	2.06E+00	pCi/L	3.60E+00		U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Tritium	3.81E+01	pCi/L	4.38E+02	500	U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Zinc-65	2.05E+00	pCi/L	3.54E+00	30	U
Ground Water	Indicator	GW-1	25-Jun-13	Grab	Zirconium-95	-6.93E-01	pCi/L	2.93E+00	15	U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Actinium-228	-3.40E+00	pCi/L	8.93E+00		U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Antimony-124	1.53E+00	pCi/L	5.08E+00		U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Antimony-125	-2.23E+00	pCi/L	5.86E+00		U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Barium-140	-1.64E+00	pCi/L	2.93E+00	15	U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Beryllium-7	-7.71E+00	pCi/L	1.78E+01		U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Cerium-141	-1.51E+00	pCi/L	4.20E+00		U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Cerium-144	-1.03E+00	pCi/L	1.61E+01		U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Cesium-134	8.07E-03	pCi/L	2.25E+00	15	U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Cesium-137	7.10E-01	pCi/L	2.22E+00	18	U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Chromium-51	-2.27E+00	pCi/L	2.10E+01		U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Cobalt-57	4.01E-01	pCi/L	2.10E+00		U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Cobalt-58	-8.66E-01	pCi/L	1.97E+00	15	U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Cobalt-60	4.17E-02	pCi/L	2.17E+00	15	U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Iodine-131	8.94E-01	pCi/L	3.78E+00		U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Iron-59	-6.08E-02	pCi/L	4.16E+00	30	U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Lanthanum-140	-1.64E+00	pCi/L	2.93E+00	15	U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Manganese-54	-9.96E-01	pCi/L	2.08E+00	15	U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Niobium-95	2.69E+00	pCi/L	2.69E+00	15	UI
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Potassium-40	6.08E-01	pCi/L	2.99E+01		U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Ruthenium-103	-8.32E-01	pCi/L	2.15E+00		U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Ruthenium-106	7.83E+00	pCi/L	1.87E+01		U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Selenium-75	-1.44E+00	pCi/L	3.04E+00		U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Silver-108m	-2.33E-01	pCi/L	1.96E+00		U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Silver-110m	4.78E-01	pCi/L	2.00E+00		U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Thorium-228	4.86E-01	pCi/L	4.21E+00		U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Tritium	1.12E+02	pCi/L	4.29E+02	500	U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Zinc-65	-1.15E-01	pCi/L	4.13E+00	30	U
Ground Water	Indicator	GW-2	25-Jun-13	Grab	Zirconium-95	1.30E+00	pCi/L	3.64E+00	15	U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Actinium-228	-3.96E+00	pCi/L	8.36E+00		U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Antimony-124	-1.11E+00	pCi/L	3.99E+00		U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Antimony-125	6.22E-01	pCi/L	5.33E+00		U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Barium-140	-1.26E+00	pCi/L	2.89E+00	15	U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Beryllium-7	4.94E-01	pCi/L	1.70E+01		U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Cerium-141	2.30E+00	pCi/L	4.07E+00		U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Cerium-144	6.53E+00	pCi/L	1.49E+01		U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Cesium-134	-3.24E+00	pCi/L	2.04E+00	15	U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Cesium-137	-1.50E+00	pCi/L	1.83E+00	18	U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Chromium-51	7.60E+00	pCi/L	1.90E+01		U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Cobalt-57	-4.92E-01	pCi/L	1.94E+00		U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Cobalt-58	-3.38E-01	pCi/L	1.85E+00	15	U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Cobalt-60	-6.34E-01	pCi/L	1.84E+00	15	U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Iodine-131	-3.38E-01	pCi/L	3.37E+00		U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Iron-59	-8.53E-01	pCi/L	3.64E+00	30	U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Lanthanum-140	-1.26E+00	pCi/L	2.89E+00	15	U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Manganese-54	-7.27E-01	pCi/L	1.73E+00	15	U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Niobium-95	5.90E-01	pCi/L	2.12E+00	15	U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Potassium-40	8.90E+00	pCi/L	2.08E+01		U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Ruthenium-103	1.12E-01	pCi/L	2.00E+00		U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Ruthenium-106	-3.58E+00	pCi/L	1.66E+01		U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Selenium-75	1.21E-01	pCi/L	2.79E+00		U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Silver-108m	-6.68E-01	pCi/L	1.74E+00		U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Silver-110m	-8.97E-01	pCi/L	1.82E+00		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Thorium-228	2.99E+00	pCi/L	3.78E+00		U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Tritium	-6.09E+01	pCi/L	4.20E+02	500	U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Zinc-65	-1.04E-01	pCi/L	3.80E+00	30	U
Ground Water	Indicator	GW-3	25-Jun-13	Grab	Zirconium-95	1.25E+00	pCi/L	3.45E+00	15	U
Ground Water	Control	GW-4	25-Jun-13	Grab	Actinium-228	-2.08E+00	pCi/L	8.57E+00		U
Ground Water	Control	GW-4	25-Jun-13	Grab	Antimony-124	-1.12E+00	pCi/L	4.66E+00		U
Ground Water	Control	GW-4	25-Jun-13	Grab	Antimony-125	1.28E+00	pCi/L	5.52E+00		U
Ground Water	Control	GW-4	25-Jun-13	Grab	Barium-140	-9.24E-03	pCi/L	3.30E+00	15	U
Ground Water	Control	GW-4	25-Jun-13	Grab	Beryllium-7	-6.83E+00	pCi/L	1.64E+01		U
Ground Water	Control	GW-4	25-Jun-13	Grab	Cerium-141	2.18E+00	pCi/L	3.81E+00		U
Ground Water	Control	GW-4	25-Jun-13	Grab	Cerium-144	7.61E-01	pCi/L	1.40E+01		U
Ground Water	Control	GW-4	25-Jun-13	Grab	Cesium-134	2.32E+00	pCi/L	2.32E+00	15	UI
Ground Water	Control	GW-4	25-Jun-13	Grab	Cesium-137	-1.18E-01	pCi/L	2.01E+00	18	U
Ground Water	Control	GW-4	25-Jun-13	Grab	Chromium-51	5.54E+00	pCi/L	1.92E+01		U
Ground Water	Control	GW-4	25-Jun-13	Grab	Cobalt-57	8.03E-01	pCi/L	1.72E+00		U
Ground Water	Control	GW-4	25-Jun-13	Grab	Cobalt-58	3.98E-01	pCi/L	1.95E+00	15	U
Ground Water	Control	GW-4	25-Jun-13	Grab	Cobalt-60	2.98E-01	pCi/L	2.14E+00	15	U
Ground Water	Control	GW-4	25-Jun-13	Grab	Iodine-131	-9.97E-01	pCi/L	3.32E+00		U
Ground Water	Control	GW-4	25-Jun-13	Grab	Iron-59	-3.22E-01	pCi/L	4.13E+00	30	U
Ground Water	Control	GW-4	25-Jun-13	Grab	Lanthanum-140	-9.24E-03	pCi/L	3.30E+00	15	U
Ground Water	Control	GW-4	25-Jun-13	Grab	Manganese-54	5.79E-01	pCi/L	1.97E+00	15	U
Ground Water	Control	GW-4	25-Jun-13	Grab	Niobium-95	2.88E-01	pCi/L	2.11E+00	15	U
Ground Water	Control	GW-4	25-Jun-13	Grab	Potassium-40	6.56E+00	pCi/L	1.95E+01		U
Ground Water	Control	GW-4	25-Jun-13	Grab	Ruthenium-103	-9.10E-01	pCi/L	1.96E+00		U
Ground Water	Control	GW-4	25-Jun-13	Grab	Ruthenium-106	-1.04E+01	pCi/L	1.59E+01		U
Ground Water	Control	GW-4	25-Jun-13	Grab	Selenium-75	-9.28E-01	pCi/L	2.70E+00		U
Ground Water	Control	GW-4	25-Jun-13	Grab	Silver-108m	-3.79E-01	pCi/L	1.69E+00		U
Ground Water	Control	GW-4	25-Jun-13	Grab	Silver-110m	-7.68E-02	pCi/L	1.82E+00		U
Ground Water	Control	GW-4	25-Jun-13	Grab	Thorium-228	2.70E+00	pCi/L	3.65E+00		U
Ground Water	Control	GW-4	25-Jun-13	Grab	Tritium	1.42E+02	pCi/L	4.46E+02	500	U
Ground Water	Control	GW-4	25-Jun-13	Grab	Zinc-65	-3.39E-01	pCi/L	4.29E+00	30	U
Ground Water	Control	GW-4	25-Jun-13	Grab	Zirconium-95	5.28E-01	pCi/L	3.50E+00	15	U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Actinium-228	-4.38E+00	pCi/L	7.26E+00		U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Antimony-124	1.78E+00	pCi/L	4.02E+00		U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Antimony-125	2.27E-01	pCi/L	4.23E+00		U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Barium-140	-7.31E-01	pCi/L	2.61E+00	15	U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Beryllium-7	-3.20E+00	pCi/L	1.43E+01		U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Cerium-141	4.59E-01	pCi/L	2.97E+00		U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Cerium-144	3.55E+00	pCi/L	1.15E+01		U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Cesium-134	6.06E-01	pCi/L	1.89E+00	15	U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Cesium-137	-4.79E-02	pCi/L	1.82E+00	18	U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Chromium-51	4.85E-01	pCi/L	1.55E+01		U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Cobalt-57	-3.43E-01	pCi/L	1.49E+00		U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Cobalt-58	-2.69E-01	pCi/L	1.58E+00	15	U



Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Cobalt-60	1.93E-01	pCi/L	1.71E+00	15	U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Iodine-131	3.70E-01	pCi/L	2.69E+00		U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Iron-59	3.24E-01	pCi/L	3.23E+00	30	U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Lanthanum-140	-7.31E-01	pCi/L	2.61E+00	15	U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Manganese-54	-3.52E-01	pCi/L	1.60E+00	15	U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Niobium-95	-6.25E-01	pCi/L	1.67E+00	15	U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Potassium-40	-1.81E+00	pCi/L	2.51E+01		U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Ruthenium-103	-8.31E-01	pCi/L	1.79E+00		U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Ruthenium-106	4.91E-01	pCi/L	1.52E+01		U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Selenium-75	3.47E-01	pCi/L	2.29E+00		U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Silver-108m	9.06E-02	pCi/L	1.49E+00		U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Silver-110m	-3.53E-01	pCi/L	1.66E+00		U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Thorium-228	-2.31E+00	pCi/L	3.56E+00		U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Tritium	7.00E+01	pCi/L	3.89E+02	500	U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Zinc-65	9.57E-01	pCi/L	3.50E+00	30	U
Ground Water	Indicator	GW-1	26-Sep-13	Grab	Zirconium-95	-6.03E-01	pCi/L	2.85E+00	15	U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Actinium-228	-6.17E+00	pCi/L	6.83E+00		U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Antimony-124	9.66E-01	pCi/L	4.37E+00		U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Antimony-125	-6.57E-01	pCi/L	4.61E+00		U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Barium-140	-1.45E-01	pCi/L	2.61E+00	15	U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Beryllium-7	1.51E-01	pCi/L	1.53E+01		U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Cerium-141	1.08E-01	pCi/L	3.24E+00		U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Cerium-144	3.71E+00	pCi/L	1.25E+01		U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Cesium-134	-6.33E-02	pCi/L	1.85E+00	15	U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Cesium-137	-9.88E-01	pCi/L	2.27E+00	18	U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Chromium-51	-5.10E+00	pCi/L	1.61E+01		U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Cobalt-57	2.02E-01	pCi/L	1.63E+00		U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Cobalt-58	-2.94E-01	pCi/L	1.60E+00	15	U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Cobalt-60	5.19E-02	pCi/L	1.83E+00	15	U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Iodine-131	-8.30E-02	pCi/L	2.76E+00		U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Iron-59	1.06E+00	pCi/L	3.32E+00	30	U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Lanthanum-140	-1.45E-01	pCi/L	2.61E+00	15	U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Manganese-54	-3.51E-01	pCi/L	1.63E+00	15	U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Niobium-95	3.18E-01	pCi/L	1.80E+00	15	U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Potassium-40	-3.23E-01	pCi/L	2.34E+01		U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Ruthenium-103	-1.14E+00	pCi/L	1.70E+00		U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Ruthenium-106	2.80E+00	pCi/L	1.56E+01		U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Selenium-75	-1.17E-01	pCi/L	2.41E+00		U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Silver-108m	6.82E-01	pCi/L	1.58E+00		U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Silver-110m	-2.47E+00	pCi/L	1.64E+00		U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Thorium-228	9.85E-01	pCi/L	3.24E+00		U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Tritium	9.74E+00	pCi/L	3.84E+02	500	U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Zinc-65	3.13E-01	pCi/L	3.44E+00	30	U
Ground Water	Indicator	GW-2	26-Sep-13	Grab	Zirconium-95	1.72E-02	pCi/L	2.85E+00	15	U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Actinium-228	5.46E+00	pCi/L	6.23E+00		U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Antimony-124	3.54E-01	pCi/L	4.19E+00		U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Antimony-125	-2.70E-01	pCi/L	4.96E+00		U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Barium-140	3.88E-01	pCi/L	2.67E+00	15	U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Beryllium-7	-5.22E-01	pCi/L	1.50E+01		U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Cerium-141	-2.70E+00	pCi/L	3.29E+00		U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Cerium-144	1.97E+00	pCi/L	1.35E+01		U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Cesium-134	-7.02E-02	pCi/L	1.86E+00	15	U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Cesium-137	9.21E-02	pCi/L	1.76E+00	18	U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Chromium-51	-2.19E+00	pCi/L	1.64E+01		U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Cobalt-57	-1.93E-02	pCi/L	1.73E+00		U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Cobalt-58	1.49E-02	pCi/L	1.56E+00	15	U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Cobalt-60	3.79E-01	pCi/L	1.91E+00	15	U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Iodine-131	1.39E+00	pCi/L	3.01E+00		U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Iron-59	1.66E+00	pCi/L	3.54E+00	30	U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Lanthanum-140	3.88E-01	pCi/L	2.67E+00	15	U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Manganese-54	-3.35E-01	pCi/L	1.56E+00	15	U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Niobium-95	3.48E-02	pCi/L	1.77E+00	15	U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Potassium-40	4.60E+00	pCi/L	1.98E+01		U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Ruthenium-103	6.08E-01	pCi/L	1.79E+00		U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Ruthenium-106	2.12E-01	pCi/L	1.52E+01		U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Selenium-75	1.33E+00	pCi/L	2.55E+00		U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Silver-108m	-9.52E-03	pCi/L	1.52E+00		U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Silver-110m	-6.43E-01	pCi/L	1.58E+00		U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Thorium-228	-1.19E-01	pCi/L	3.96E+00		U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Tritium	3.67E+01	pCi/L	3.82E+02	500	U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Zinc-65	-3.75E-01	pCi/L	3.27E+00	30	U
Ground Water	Indicator	GW-3	26-Sep-13	Grab	Zirconium-95	9.46E-01	pCi/L	3.08E+00	15	U
Ground Water	Control	GW-4	26-Sep-13	Grab	Actinium-228	-3.56E+00	pCi/L	6.96E+00		U
Ground Water	Control	GW-4	26-Sep-13	Grab	Antimony-124	-2.34E+00	pCi/L	3.32E+00		U
Ground Water	Control	GW-4	26-Sep-13	Grab	Antimony-125	7.28E-01	pCi/L	4.96E+00		U
Ground Water	Control	GW-4	26-Sep-13	Grab	Barium-140	7.32E-02	pCi/L	2.78E+00	15	U
Ground Water	Control	GW-4	26-Sep-13	Grab	Beryllium-7	3.90E-01	pCi/L	1.53E+01		U
Ground Water	Control	GW-4	26-Sep-13	Grab	Cerium-141	1.31E-01	pCi/L	3.28E+00		U
Ground Water	Control	GW-4	26-Sep-13	Grab	Cerium-144	1.35E+00	pCi/L	1.21E+01		U
Ground Water	Control	GW-4	26-Sep-13	Grab	Cesium-134	-1.19E-01	pCi/L	1.78E+00	15	U
Ground Water	Control	GW-4	26-Sep-13	Grab	Cesium-137	1.06E-01	pCi/L	1.88E+00	18	U
Ground Water	Control	GW-4	26-Sep-13	Grab	Chromium-51	-2.29E+00	pCi/L	1.72E+01		U
Ground Water	Control	GW-4	26-Sep-13	Grab	Cobalt-57	5.33E-01	pCi/L	1.69E+00		U
Ground Water	Control	GW-4	26-Sep-13	Grab	Cobalt-58	8.72E-01	pCi/L	1.82E+00	15	U
Ground Water	Control	GW-4	26-Sep-13	Grab	Cobalt-60	-6.07E-01	pCi/L	1.69E+00	15	U
Ground Water	Control	GW-4	26-Sep-13	Grab	Iodine-131	2.06E-01	pCi/L	2.99E+00		U
Ground Water	Control	GW-4	26-Sep-13	Grab	Iron-59	-5.90E-01	pCi/L	3.25E+00	30	U
Ground Water	Control	GW-4	26-Sep-13	Grab	Lanthanum-140	7.32E-02	pCi/L	2.78E+00	15	U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Ground Water	Control	GW-4	26-Sep-13	Grab	Manganese-54	-5.78E-01	pCi/L	1.54E+00	15	U
Ground Water	Control	GW-4	26-Sep-13	Grab	Niobium-95	3.66E-01	pCi/L	1.92E+00	15	U
Ground Water	Control	GW-4	26-Sep-13	Grab	Potassium-40	1.31E+01	pCi/L	1.68E+01		U
Ground Water	Control	GW-4	26-Sep-13	Grab	Ruthenium-103	-4.60E-01	pCi/L	1.82E+00		U
Ground Water	Control	GW-4	26-Sep-13	Grab	Ruthenium-106	-3.36E+00	pCi/L	1.52E+01		U
Ground Water	Control	GW-4	26-Sep-13	Grab	Selenium-75	3.72E-01	pCi/L	2.41E+00		U
Ground Water	Control	GW-4	26-Sep-13	Grab	Silver-108m	-5.32E-02	pCi/L	1.56E+00		U
Ground Water	Control	GW-4	26-Sep-13	Grab	Silver-110m	1.16E-01	pCi/L	1.54E+00		U
Ground Water	Control	GW-4	26-Sep-13	Grab	Thorium-228	1.08E+00	pCi/L	3.30E+00		U
Ground Water	Control	GW-4	26-Sep-13	Grab	Tritium	6.48E+00	pCi/L	3.85E+02	500	U
Ground Water	Control	GW-4	26-Sep-13	Grab	Zinc-65	6.95E-02	pCi/L	3.42E+00	30	U
Ground Water	Control	GW-4	26-Sep-13	Grab	Zirconium-95	9.60E-01	pCi/L	3.03E+00	15	U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Actinium-228	-8.91E+00	pCi/L	1.48E+01		U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Antimony-124	-3.28E+00	pCi/L	9.99E+00		U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Antimony-125	-4.08E+00	pCi/L	1.01E+01		U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Barium-140	1.44E+00	pCi/L	6.85E+00	15	U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Beryllium-7	-7.32E+00	pCi/L	3.27E+01		U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Cerium-141	1.23E+00	pCi/L	7.63E+00		U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Cerium-144	1.92E+00	pCi/L	2.89E+01		U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Cesium-134	-2.90E-01	pCi/L	3.92E+00	15	U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Cesium-137	9.71E-01	pCi/L	4.18E+00	18	U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Chromium-51	1.02E+01	pCi/L	4.55E+01		U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Cobalt-57	-1.10E+00	pCi/L	3.25E+00		U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Cobalt-58	-1.50E+00	pCi/L	4.43E+00	15	U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Cobalt-60	5.38E-01	pCi/L	4.41E+00	15	U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Iodine-131	3.21E+00	pCi/L	7.05E+00		U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Iron-59	-2.83E+00	pCi/L	8.13E+00	30	U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Lanthanum-140	1.44E+00	pCi/L	6.85E+00	15	U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Manganese-54	2.59E-01	pCi/L	4.05E+00	15	U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Niobium-95	1.93E+00	pCi/L	4.54E+00	15	U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Potassium-40	5.67E+00	pCi/L	5.18E+01		U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Ruthenium-103	-1.98E+00	pCi/L	4.10E+00		U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Ruthenium-106	-5.94E+00	pCi/L	3.93E+01		U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Selenium-75	2.56E+00	pCi/L	5.82E+00		U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Silver-108m	-1.19E+00	pCi/L	3.37E+00		U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Silver-110m	1.51E-01	pCi/L	3.79E+00		U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Thorium-228	5.93E-02	pCi/L	7.47E+00		U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Tritium	1.63E+02	pCi/L	3.84E+02	500	U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Zinc-65	-9.86E-01	pCi/L	7.46E+00	30	U
Ground Water	Indicator	GW-1	27-Dec-13	Grab	Zirconium-95	-8.48E-01	pCi/L	5.85E+00	15	U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Actinium-228	7.63E+00	pCi/L	1.61E+01		U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Antimony-124	-1.55E+00	pCi/L	1.04E+01		U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Antimony-125	-2.40E+00	pCi/L	1.34E+01		U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Barium-140	-4.81E+00	pCi/L	5.05E+00	15	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Beryllium-7	-1.90E+00	pCi/L	4.14E+01		U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Cerium-141	9.04E-01	pCi/L	9.81E+00		U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Cerium-144	8.14E+00	pCi/L	3.62E+01		U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Cesium-134	1.49E+00	pCi/L	5.34E+00	15	U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Cesium-137	-1.42E-01	pCi/L	5.28E+00	18	U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Chromium-51	1.24E+00	pCi/L	4.61E+01		U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Cobalt-57	-5.73E-01	pCi/L	4.49E+00		U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Cobalt-58	1.39E+00	pCi/L	4.75E+00	15	U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Cobalt-60	-9.91E-01	pCi/L	5.13E+00	15	U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Iodine-131	2.10E+00	pCi/L	9.52E+00		U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Iron-59	4.82E-01	pCi/L	1.03E+01	30	U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Lanthanum-140	-4.81E+00	pCi/L	5.05E+00	15	U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Manganese-54	-3.30E+00	pCi/L	4.30E+00	15	U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Niobium-95	6.54E+00	pCi/L	6.54E+00	15	UI
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Potassium-40	-3.01E+01	pCi/L	5.21E+01		U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Ruthenium-103	-1.04E+00	pCi/L	4.98E+00		U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Ruthenium-106	-3.23E+00	pCi/L	4.09E+01		U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Selenium-75	5.43E+00	pCi/L	7.76E+00		U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Silver-108m	-4.47E-01	pCi/L	4.42E+00		U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Silver-110m	-2.69E+00	pCi/L	3.89E+00		U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Thorium-228	7.14E-01	pCi/L	9.43E+00		U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Tritium	1.30E+02	pCi/L	3.76E+02	500	U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Zinc-65	1.22E-01	pCi/L	9.39E+00	30	U
Ground Water	Indicator	GW-2	27-Dec-13	Grab	Zirconium-95	-6.90E-01	pCi/L	8.68E+00	15	U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Actinium-228	3.47E+00	pCi/L	1.90E+01		U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Antimony-124	3.01E+00	pCi/L	1.08E+01		U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Antimony-125	-1.07E+00	pCi/L	1.09E+01		U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Barium-140	-2.98E+00	pCi/L	7.00E+00	15	U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Beryllium-7	1.50E+01	pCi/L	4.36E+01		U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Cerium-141	2.15E+00	pCi/L	8.17E+00		U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Cerium-144	-2.65E+00	pCi/L	2.91E+01		U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Cesium-134	2.50E+00	pCi/L	4.99E+00	15	U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Cesium-137	1.79E+00	pCi/L	5.83E+00	18	U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Chromium-51	1.40E+00	pCi/L	4.05E+01		U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Cobalt-57	-4.04E-01	pCi/L	3.69E+00		U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Cobalt-58	-6.48E-02	pCi/L	4.26E+00	15	U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Cobalt-60	6.01E-01	pCi/L	4.11E+00	15	U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Iodine-131	-1.70E+00	pCi/L	7.50E+00		U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Iron-59	-2.30E-01	pCi/L	7.94E+00	30	U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Lanthanum-140	-2.98E+00	pCi/L	7.00E+00	15	U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Manganese-54	-1.79E+00	pCi/L	3.75E+00	15	U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Niobium-95	2.22E+00	pCi/L	5.43E+00	15	U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Potassium-40	2.86E+01	pCi/L	3.94E+01		U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Ruthenium-103	-6.63E-01	pCi/L	4.33E+00		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Ruthenium-106	-2.19E+01	pCi/L	3.55E+01		U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Selenium-75	2.69E+00	pCi/L	6.46E+00		U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Silver-108m	1.77E+00	pCi/L	4.15E+00		U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Silver-110m	-1.73E-01	pCi/L	3.63E+00		U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Thorium-228	8.42E-01	pCi/L	1.00E+01		U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Tritium	1.70E+02	pCi/L	3.87E+02	500	U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Zinc-65	2.76E+00	pCi/L	9.33E+00	30	U
Ground Water	Indicator	GW-3	27-Dec-13	Grab	Zirconium-95	1.28E+00	pCi/L	7.39E+00	15	U
Ground Water	Control	GW-4	27-Dec-13	Grab	Actinium-228	1.73E+00	pCi/L	1.91E+01		U
Ground Water	Control	GW-4	27-Dec-13	Grab	Antimony-124	2.96E+00	pCi/L	1.02E+01		U
Ground Water	Control	GW-4	27-Dec-13	Grab	Antimony-125	0.00E+00	pCi/L	1.26E+01		U
Ground Water	Control	GW-4	27-Dec-13	Grab	Barium-140	6.38E-01	pCi/L	7.68E+00	15	U
Ground Water	Control	GW-4	27-Dec-13	Grab	Beryllium-7	-6.43E-01	pCi/L	3.98E+01		U
Ground Water	Control	GW-4	27-Dec-13	Grab	Cerium-141	2.06E+00	pCi/L	9.26E+00		U
Ground Water	Control	GW-4	27-Dec-13	Grab	Cerium-144	1.85E+01	pCi/L	3.45E+01		U
Ground Water	Control	GW-4	27-Dec-13	Grab	Cesium-134	-1.90E-01	pCi/L	4.83E+00	15	U
Ground Water	Control	GW-4	27-Dec-13	Grab	Cesium-137	2.95E-01	pCi/L	5.01E+00	18	U
Ground Water	Control	GW-4	27-Dec-13	Grab	Chromium-51	6.12E+00	pCi/L	4.63E+01		U
Ground Water	Control	GW-4	27-Dec-13	Grab	Cobalt-57	-7.82E-02	pCi/L	4.41E+00		U
Ground Water	Control	GW-4	27-Dec-13	Grab	Cobalt-58	-9.03E-01	pCi/L	3.46E+00	15	U
Ground Water	Control	GW-4	27-Dec-13	Grab	Cobalt-60	-8.71E-01	pCi/L	4.32E+00	15	U
Ground Water	Control	GW-4	27-Dec-13	Grab	Iodine-131	-5.33E-01	pCi/L	8.06E+00		U
Ground Water	Control	GW-4	27-Dec-13	Grab	Iron-59	-8.97E-01	pCi/L	9.21E+00	30	U
Ground Water	Control	GW-4	27-Dec-13	Grab	Lanthanum-140	6.38E-01	pCi/L	7.68E+00	15	U
Ground Water	Control	GW-4	27-Dec-13	Grab	Manganese-54	9.05E-01	pCi/L	4.19E+00	15	U
Ground Water	Control	GW-4	27-Dec-13	Grab	Niobium-95	1.36E+00	pCi/L	4.52E+00	15	U
Ground Water	Control	GW-4	27-Dec-13	Grab	Potassium-40	-3.27E+01	pCi/L	5.96E+01		U
Ground Water	Control	GW-4	27-Dec-13	Grab	Ruthenium-103	1.56E-01	pCi/L	4.53E+00		U
Ground Water	Control	GW-4	27-Dec-13	Grab	Ruthenium-106	1.07E+01	pCi/L	3.70E+01		U
Ground Water	Control	GW-4	27-Dec-13	Grab	Selenium-75	-3.40E+00	pCi/L	5.96E+00		U
Ground Water	Control	GW-4	27-Dec-13	Grab	Silver-108m	-1.41E-01	pCi/L	4.06E+00		U
Ground Water	Control	GW-4	27-Dec-13	Grab	Silver-110m	-1.68E+00	pCi/L	3.82E+00		U
Ground Water	Control	GW-4	27-Dec-13	Grab	Thorium-228	8.11E+00	pCi/L	8.75E+00		U
Ground Water	Control	GW-4	27-Dec-13	Grab	Tritium	-2.39E+00	pCi/L	3.90E+02	500	U
Ground Water	Control	GW-4	27-Dec-13	Grab	Zinc-65	9.98E-01	pCi/L	8.69E+00	30	U
Ground Water	Control	GW-4	27-Dec-13	Grab	Zirconium-95	1.10E+00	pCi/L	7.55E+00	15	U
Milk	Indicator	M-2	10-Jan-13	Composite	Actinium-228	1.07E+01	pCi/L	1.38E+01		U
Milk	Indicator	M-2	10-Jan-13	Composite	Antimony-124	1.48E-01	pCi/L	5.51E+00		U
Milk	Indicator	M-2	10-Jan-13	Composite	Antimony-125	-1.42E+00	pCi/L	6.81E+00		U
Milk	Indicator	M-2	10-Jan-13	Composite	Barium-140	7.99E-02	pCi/L	3.67E+00	15	U
Milk	Indicator	M-2	10-Jan-13	Composite	Beryllium-7	-5.59E+00	pCi/L	2.20E+01		U
Milk	Indicator	M-2	10-Jan-13	Composite	Cerium-141	5.63E-01	pCi/L	3.77E+00		U
Milk	Indicator	M-2	10-Jan-13	Composite	Cerium-144	6.47E-01	pCi/L	1.50E+01		U
Milk	Indicator	M-2	10-Jan-13	Composite	Cesium-134	1.14E+00	pCi/L	3.22E+00	15	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Indicator	M-2	10-Jan-13	Composite	Cesium-137	1.79E+00	pCi/L	2.82E+00	18	U
Milk	Indicator	M-2	10-Jan-13	Composite	Chromium-51	-7.25E+00	pCi/L	2.02E+01		U
Milk	Indicator	M-2	10-Jan-13	Composite	Cobalt-57	4.01E-01	pCi/L	1.95E+00		U
Milk	Indicator	M-2	10-Jan-13	Composite	Cobalt-58	-2.15E+00	pCi/L	2.59E+00		U
Milk	Indicator	M-2	10-Jan-13	Composite	Cobalt-60	7.01E-01	pCi/L	3.40E+00		U
Milk	Indicator	M-2	10-Jan-13	Composite	Iodine-131	-4.32E-02	pCi/L	6.48E-01	1	U
Milk	Indicator	M-2	10-Jan-13	Composite	Iron-59	5.38E-01	pCi/L	6.56E+00		U
Milk	Indicator	M-2	10-Jan-13	Composite	Lanthanum-140	7.99E-02	pCi/L	3.67E+00	15	U
Milk	Indicator	M-2	10-Jan-13	Composite	Manganese-54	7.58E-01	pCi/L	2.86E+00		U
Milk	Indicator	M-2	10-Jan-13	Composite	Niobium-95	-3.01E-01	pCi/L	2.72E+00		U
Milk	Indicator	M-2	10-Jan-13	Composite	Potassium-40	1.31E+03	pCi/L	3.19E+01		
Milk	Indicator	M-2	10-Jan-13	Composite	Ruthenium-103	6.13E-01	pCi/L	2.58E+00		U
Milk	Indicator	M-2	10-Jan-13	Composite	Ruthenium-106	-2.41E-01	pCi/L	2.44E+01		U
Milk	Indicator	M-2	10-Jan-13	Composite	Selenium-75	-1.95E-01	pCi/L	3.11E+00		U
Milk	Indicator	M-2	10-Jan-13	Composite	Silver-108m	3.77E-01	pCi/L	2.25E+00		U
Milk	Indicator	M-2	10-Jan-13	Composite	Silver-110m	-2.95E-01	pCi/L	2.36E+00		U
Milk	Indicator	M-2	10-Jan-13	Composite	Strontium-89	3.64E-01	pCi/L	1.96E+00	10	U
Milk	Indicator	M-2	10-Jan-13	Composite	Strontium-90	-3.80E-01	pCi/L	1.68E+00	2	U
Milk	Indicator	M-2	10-Jan-13	Composite	Zinc-65	3.15E-01	pCi/L	7.25E+00		U
Milk	Indicator	M-2	10-Jan-13	Composite	Zirconium-95	-2.40E+00	pCi/L	4.88E+00		U
Milk	Control	M-8	10-Jan-13	Composite	Actinium-228	2.97E+00	pCi/L	9.63E+00		U
Milk	Control	M-8	10-Jan-13	Composite	Antimony-124	-2.41E+00	pCi/L	3.68E+00		U
Milk	Control	M-8	10-Jan-13	Composite	Antimony-125	9.61E-01	pCi/L	5.67E+00		U
Milk	Control	M-8	10-Jan-13	Composite	Barium-140	-6.60E-01	pCi/L	2.10E+00	15	U
Milk	Control	M-8	10-Jan-13	Composite	Beryllium-7	2.24E+00	pCi/L	1.65E+01		U
Milk	Control	M-8	10-Jan-13	Composite	Cerium-141	-5.92E-01	pCi/L	3.44E+00		U
Milk	Control	M-8	10-Jan-13	Composite	Cerium-144	-7.82E-01	pCi/L	1.39E+01		U
Milk	Control	M-8	10-Jan-13	Composite	Cesium-134	8.13E-01	pCi/L	2.32E+00	15	U
Milk	Control	M-8	10-Jan-13	Composite	Cesium-137	2.40E-01	pCi/L	2.19E+00	18	U
Milk	Control	M-8	10-Jan-13	Composite	Chromium-51	-1.37E+01	pCi/L	1.66E+01		U
Milk	Control	M-8	10-Jan-13	Composite	Cobalt-57	3.85E-01	pCi/L	1.89E+00		U
Milk	Control	M-8	10-Jan-13	Composite	Cobalt-58	-4.13E-01	pCi/L	2.04E+00		U
Milk	Control	M-8	10-Jan-13	Composite	Cobalt-60	1.80E-01	pCi/L	2.13E+00		U
Milk	Control	M-8	10-Jan-13	Composite	Iodine-131	-3.01E-01	pCi/L	5.29E-01	1	U
Milk	Control	M-8	10-Jan-13	Composite	Iron-59	1.20E+00	pCi/L	4.84E+00		U
Milk	Control	M-8	10-Jan-13	Composite	Lanthanum-140	-6.60E-01	pCi/L	2.10E+00	15	U
Milk	Control	M-8	10-Jan-13	Composite	Manganese-54	-8.83E-02	pCi/L	2.14E+00		U
Milk	Control	M-8	10-Jan-13	Composite	Niobium-95	-9.59E-01	pCi/L	2.11E+00		U
Milk	Control	M-8	10-Jan-13	Composite	Potassium-40	1.46E+03	pCi/L	1.74E+01		
Milk	Control	M-8	10-Jan-13	Composite	Ruthenium-103	-7.38E-01	pCi/L	1.91E+00		U
Milk	Control	M-8	10-Jan-13	Composite	Ruthenium-106	-3.16E+00	pCi/L	1.79E+01		U
Milk	Control	M-8	10-Jan-13	Composite	Selenium-75	1.73E-01	pCi/L	2.76E+00		U
Milk	Control	M-8	10-Jan-13	Composite	Silver-108m	-9.71E-02	pCi/L	1.86E+00		U
Milk	Control	M-8	10-Jan-13	Composite	Silver-110m	-3.93E-01	pCi/L	1.93E+00		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Control	M-8	10-Jan-13	Composite	Strontium-89	-1.76E+00	pCi/L	2.61E+00	10	U
Milk	Control	M-8	10-Jan-13	Composite	Strontium-90	-1.12E+00	pCi/L	1.77E+00	2	U
Milk	Control	M-8	10-Jan-13	Composite	Zinc-65	-4.63E-01	pCi/L	5.49E+00		U
Milk	Control	M-8	10-Jan-13	Composite	Zirconium-95	-1.23E-01	pCi/L	3.54E+00		U
Milk	Indicator	M-2	14-Feb-13	Composite	Actinium-228	3.89E+00	pCi/L	7.90E+00		U
Milk	Indicator	M-2	14-Feb-13	Composite	Antimony-124	-1.47E+00	pCi/L	3.92E+00		U
Milk	Indicator	M-2	14-Feb-13	Composite	Antimony-125	-3.37E-01	pCi/L	5.18E+00		U
Milk	Indicator	M-2	14-Feb-13	Composite	Barium-140	-6.85E-01	pCi/L	2.03E+00	15	U
Milk	Indicator	M-2	14-Feb-13	Composite	Beryllium-7	8.41E+00	pCi/L	1.69E+01		U
Milk	Indicator	M-2	14-Feb-13	Composite	Cerium-141	1.52E-01	pCi/L	3.21E+00		U
Milk	Indicator	M-2	14-Feb-13	Composite	Cerium-144	3.71E+00	pCi/L	1.42E+01		U
Milk	Indicator	M-2	14-Feb-13	Composite	Cesium-134	1.30E+00	pCi/L	2.20E+00	15	U
Milk	Indicator	M-2	14-Feb-13	Composite	Cesium-137	-7.53E-01	pCi/L	1.96E+00	18	U
Milk	Indicator	M-2	14-Feb-13	Composite	Chromium-51	6.62E-01	pCi/L	1.66E+01		U
Milk	Indicator	M-2	14-Feb-13	Composite	Cobalt-57	-9.85E-01	pCi/L	1.78E+00		U
Milk	Indicator	M-2	14-Feb-13	Composite	Cobalt-58	3.67E-01	pCi/L	1.88E+00		U
Milk	Indicator	M-2	14-Feb-13	Composite	Cobalt-60	-5.43E-01	pCi/L	2.04E+00		U
Milk	Indicator	M-2	14-Feb-13	Composite	Iodine-131	2.20E-02	pCi/L	5.51E-01	1	U
Milk	Indicator	M-2	14-Feb-13	Composite	Iron-59	4.35E-01	pCi/L	4.62E+00		U
Milk	Indicator	M-2	14-Feb-13	Composite	Lanthanum-140	-6.85E-01	pCi/L	2.03E+00	15	U
Milk	Indicator	M-2	14-Feb-13	Composite	Manganese-54	-1.92E-01	pCi/L	1.85E+00		U
Milk	Indicator	M-2	14-Feb-13	Composite	Niobium-95	-7.96E-02	pCi/L	1.79E+00		U
Milk	Indicator	M-2	14-Feb-13	Composite	Potassium-40	1.45E+03	pCi/L	1.85E+01		
Milk	Indicator	M-2	14-Feb-13	Composite	Ruthenium-103	-7.70E-01	pCi/L	1.84E+00		U
Milk	Indicator	M-2	14-Feb-13	Composite	Ruthenium-106	2.46E+00	pCi/L	1.64E+01		U
Milk	Indicator	M-2	14-Feb-13	Composite	Selenium-75	-3.44E-01	pCi/L	2.66E+00		U
Milk	Indicator	M-2	14-Feb-13	Composite	Silver-108m	6.15E-01	pCi/L	1.75E+00		U
Milk	Indicator	M-2	14-Feb-13	Composite	Silver-110m	3.64E-02	pCi/L	1.75E+00		U
Milk	Indicator	M-2	14-Feb-13	Composite	Strontium-89	-8.55E-01	pCi/L	5.11E+00	10	U
Milk	Indicator	M-2	14-Feb-13	Composite	Strontium-90	6.26E-01	pCi/L	1.78E+00	2	U
Milk	Indicator	M-2	14-Feb-13	Composite	Zinc-65	-2.66E+00	pCi/L	4.58E+00		U
Milk	Indicator	M-2	14-Feb-13	Composite	Zirconium-95	8.87E-01	pCi/L	3.49E+00		U
Milk	Control	M-8	14-Feb-13	Composite	Actinium-228	1.17E+00	pCi/L	8.65E+00		U
Milk	Control	M-8	14-Feb-13	Composite	Antimony-124	4.82E-01	pCi/L	3.97E+00		U
Milk	Control	M-8	14-Feb-13	Composite	Antimony-125	1.71E+00	pCi/L	5.50E+00		U
Milk	Control	M-8	14-Feb-13	Composite	Barium-140	4.19E-01	pCi/L	2.33E+00	15	U
Milk	Control	M-8	14-Feb-13	Composite	Beryllium-7	-3.30E+00	pCi/L	1.65E+01		U
Milk	Control	M-8	14-Feb-13	Composite	Cerium-141	1.83E+00	pCi/L	3.24E+00		U
Milk	Control	M-8	14-Feb-13	Composite	Cerium-144	-6.52E-01	pCi/L	1.31E+01		U
Milk	Control	M-8	14-Feb-13	Composite	Cesium-134	-5.60E-01	pCi/L	2.21E+00	15	U
Milk	Control	M-8	14-Feb-13	Composite	Cesium-137	1.65E+00	pCi/L	2.13E+00	18	U
Milk	Control	M-8	14-Feb-13	Composite	Chromium-51	-3.05E+00	pCi/L	1.66E+01		U
Milk	Control	M-8	14-Feb-13	Composite	Cobalt-57	-5.20E-02	pCi/L	1.72E+00		U
Milk	Control	M-8	14-Feb-13	Composite	Cobalt-58	-7.41E-01	pCi/L	1.88E+00		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Control	M-8	14-Feb-13	Composite	Cobalt-60	3.53E-01	pCi/L	2.10E+00		U
Milk	Control	M-8	14-Feb-13	Composite	Iodine-131	2.15E-01	pCi/L	6.10E-01	1	U
Milk	Control	M-8	14-Feb-13	Composite	Iron-59	1.05E+00	pCi/L	4.58E+00		U
Milk	Control	M-8	14-Feb-13	Composite	Lanthanum-140	4.19E-01	pCi/L	2.33E+00	15	U
Milk	Control	M-8	14-Feb-13	Composite	Manganese-54	2.21E-01	pCi/L	2.06E+00		U
Milk	Control	M-8	14-Feb-13	Composite	Niobium-95	-3.11E-01	pCi/L	2.00E+00		U
Milk	Control	M-8	14-Feb-13	Composite	Potassium-40	1.45E+03	pCi/L	1.83E+01		
Milk	Control	M-8	14-Feb-13	Composite	Ruthenium-103	3.64E-01	pCi/L	2.05E+00		U
Milk	Control	M-8	14-Feb-13	Composite	Ruthenium-106	2.50E+00	pCi/L	1.83E+01		U
Milk	Control	M-8	14-Feb-13	Composite	Selenium-75	5.83E-01	pCi/L	2.67E+00		U
Milk	Control	M-8	14-Feb-13	Composite	Silver-108m	3.13E-01	pCi/L	1.79E+00		U
Milk	Control	M-8	14-Feb-13	Composite	Silver-110m	8.48E-01	pCi/L	1.92E+00		U
Milk	Control	M-8	14-Feb-13	Composite	Strontium-89	-2.06E-01	pCi/L	4.44E+00	10	U
Milk	Control	M-8	14-Feb-13	Composite	Strontium-90	-3.32E-01	pCi/L	1.79E+00	2	U
Milk	Control	M-8	14-Feb-13	Composite	Zinc-65	-1.23E+00	pCi/L	4.67E+00		U
Milk	Control	M-8	14-Feb-13	Composite	Zirconium-95	-1.18E+00	pCi/L	3.41E+00		U
Milk	Indicator	M-2	14-Mar-13	Composite	Actinium-228	2.83E+00	pCi/L	7.51E+00		U
Milk	Indicator	M-2	14-Mar-13	Composite	Antimony-124	1.42E+00	pCi/L	3.97E+00		U
Milk	Indicator	M-2	14-Mar-13	Composite	Antimony-125	4.95E-01	pCi/L	4.91E+00		U
Milk	Indicator	M-2	14-Mar-13	Composite	Barium-140	-1.81E-01	pCi/L	1.97E+00	15	U
Milk	Indicator	M-2	14-Mar-13	Composite	Beryllium-7	-3.32E+00	pCi/L	1.48E+01		U
Milk	Indicator	M-2	14-Mar-13	Composite	Cerium-141	6.75E-01	pCi/L	2.89E+00		U
Milk	Indicator	M-2	14-Mar-13	Composite	Cerium-144	6.05E+00	pCi/L	1.17E+01		U
Milk	Indicator	M-2	14-Mar-13	Composite	Cesium-134	4.32E-01	pCi/L	2.21E+00	15	U
Milk	Indicator	M-2	14-Mar-13	Composite	Cesium-137	3.38E-01	pCi/L	1.99E+00	18	U
Milk	Indicator	M-2	14-Mar-13	Composite	Chromium-51	-5.06E+00	pCi/L	1.45E+01		U
Milk	Indicator	M-2	14-Mar-13	Composite	Cobalt-57	-2.96E-01	pCi/L	1.58E+00		U
Milk	Indicator	M-2	14-Mar-13	Composite	Cobalt-58	4.00E-01	pCi/L	1.87E+00		U
Milk	Indicator	M-2	14-Mar-13	Composite	Cobalt-60	-1.59E+00	pCi/L	2.17E+00		U
Milk	Indicator	M-2	14-Mar-13	Composite	Iodine-131	7.25E-03	pCi/L	5.49E-01	1	U
Milk	Indicator	M-2	14-Mar-13	Composite	Iron-59	1.65E-01	pCi/L	4.28E+00		U
Milk	Indicator	M-2	14-Mar-13	Composite	Lanthanum-140	-1.81E-01	pCi/L	1.97E+00	15	U
Milk	Indicator	M-2	14-Mar-13	Composite	Manganese-54	-1.20E+00	pCi/L	1.77E+00		U
Milk	Indicator	M-2	14-Mar-13	Composite	Niobium-95	1.38E+00	pCi/L	1.96E+00		U
Milk	Indicator	M-2	14-Mar-13	Composite	Potassium-40	1.43E+03	pCi/L	1.81E+01		
Milk	Indicator	M-2	14-Mar-13	Composite	Ruthenium-103	-8.07E-01	pCi/L	1.66E+00		U
Milk	Indicator	M-2	14-Mar-13	Composite	Ruthenium-106	-2.08E-01	pCi/L	1.56E+01		U
Milk	Indicator	M-2	14-Mar-13	Composite	Selenium-75	1.93E-01	pCi/L	2.44E+00		U
Milk	Indicator	M-2	14-Mar-13	Composite	Silver-108m	-6.04E-01	pCi/L	1.61E+00		U
Milk	Indicator	M-2	14-Mar-13	Composite	Silver-110m	-6.03E-02	pCi/L	1.77E+00		U
Milk	Indicator	M-2	14-Mar-13	Composite	Strontium-89	2.32E+00	pCi/L	3.29E+00	10	U
Milk	Indicator	M-2	14-Mar-13	Composite	Strontium-90	8.85E-02	pCi/L	1.44E+00	2	U
Milk	Indicator	M-2	14-Mar-13	Composite	Zinc-65	-4.28E-01	pCi/L	4.59E+00		U
Milk	Indicator	M-2	14-Mar-13	Composite	Zirconium-95	7.17E-01	pCi/L	3.46E+00		U



Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Control	M-8	14-Mar-13	Composite	Actinium-228	-3.56E+00	pCi/L	7.95E+00		U
Milk	Control	M-8	14-Mar-13	Composite	Antimony-124	4.55E-01	pCi/L	3.90E+00		U
Milk	Control	M-8	14-Mar-13	Composite	Antimony-125	-2.69E+00	pCi/L	5.02E+00		U
Milk	Control	M-8	14-Mar-13	Composite	Barium-140	-2.83E+00	pCi/L	1.83E+00	15	U
Milk	Control	M-8	14-Mar-13	Composite	Beryllium-7	-6.71E+00	pCi/L	1.53E+01		U
Milk	Control	M-8	14-Mar-13	Composite	Cerium-141	-2.50E+00	pCi/L	3.29E+00		U
Milk	Control	M-8	14-Mar-13	Composite	Cerium-144	2.53E+00	pCi/L	1.37E+01		U
Milk	Control	M-8	14-Mar-13	Composite	Cesium-134	-8.77E-01	pCi/L	2.08E+00	15	U
Milk	Control	M-8	14-Mar-13	Composite	Cesium-137	1.16E-01	pCi/L	2.02E+00	18	U
Milk	Control	M-8	14-Mar-13	Composite	Chromium-51	8.45E-01	pCi/L	1.59E+01		U
Milk	Control	M-8	14-Mar-13	Composite	Cobalt-57	3.61E-02	pCi/L	1.81E+00		U
Milk	Control	M-8	14-Mar-13	Composite	Cobalt-58	-8.21E-01	pCi/L	1.72E+00		U
Milk	Control	M-8	14-Mar-13	Composite	Cobalt-60	3.28E-01	pCi/L	2.21E+00		U
Milk	Control	M-8	14-Mar-13	Composite	Iodine-131	2.30E-01	pCi/L	4.41E-01	1	U
Milk	Control	M-8	14-Mar-13	Composite	Iron-59	-2.90E-01	pCi/L	4.15E+00		U
Milk	Control	M-8	14-Mar-13	Composite	Lanthanum-140	-2.83E+00	pCi/L	1.83E+00	15	U
Milk	Control	M-8	14-Mar-13	Composite	Manganese-54	-5.89E-01	pCi/L	1.94E+00		U
Milk	Control	M-8	14-Mar-13	Composite	Niobium-95	4.21E-01	pCi/L	1.93E+00		U
Milk	Control	M-8	14-Mar-13	Composite	Potassium-40	1.41E+03	pCi/L	1.79E+01		U
Milk	Control	M-8	14-Mar-13	Composite	Ruthenium-103	-9.44E-01	pCi/L	1.73E+00		U
Milk	Control	M-8	14-Mar-13	Composite	Ruthenium-106	5.14E+00	pCi/L	1.72E+01		U
Milk	Control	M-8	14-Mar-13	Composite	Selenium-75	2.01E-02	pCi/L	2.59E+00		U
Milk	Control	M-8	14-Mar-13	Composite	Silver-108m	-3.52E-01	pCi/L	1.70E+00		U
Milk	Control	M-8	14-Mar-13	Composite	Silver-110m	9.88E-02	pCi/L	1.76E+00		U
Milk	Control	M-8	14-Mar-13	Composite	Strontium-89	-6.28E-01	pCi/L	3.25E+00	10	U
Milk	Control	M-8	14-Mar-13	Composite	Strontium-90	-3.05E-02	pCi/L	1.53E+00	2	U
Milk	Control	M-8	14-Mar-13	Composite	Zinc-65	-1.69E+00	pCi/L	4.54E+00		U
Milk	Control	M-8	14-Mar-13	Composite	Zirconium-95	3.52E-01	pCi/L	3.27E+00		U
Milk	Indicator	M-2	11-Apr-13	Composite	Actinium-228	1.36E+01	pCi/L	1.36E+01		UI
Milk	Indicator	M-2	11-Apr-13	Composite	Antimony-124	6.02E-01	pCi/L	6.01E+00		U
Milk	Indicator	M-2	11-Apr-13	Composite	Antimony-125	2.46E+00	pCi/L	7.29E+00		U
Milk	Indicator	M-2	11-Apr-13	Composite	Barium-140	4.55E-02	pCi/L	3.31E+00	15	U
Milk	Indicator	M-2	11-Apr-13	Composite	Beryllium-7	1.45E+00	pCi/L	2.29E+01		U
Milk	Indicator	M-2	11-Apr-13	Composite	Cerium-141	5.27E-02	pCi/L	3.48E+00		U
Milk	Indicator	M-2	11-Apr-13	Composite	Cerium-144	-3.48E+00	pCi/L	1.43E+01		U
Milk	Indicator	M-2	11-Apr-13	Composite	Cesium-134	-1.54E-01	pCi/L	3.48E+00	15	U
Milk	Indicator	M-2	11-Apr-13	Composite	Cesium-137	1.54E+00	pCi/L	2.88E+00	18	U
Milk	Indicator	M-2	11-Apr-13	Composite	Chromium-51	7.47E+00	pCi/L	2.14E+01		U
Milk	Indicator	M-2	11-Apr-13	Composite	Cobalt-57	-3.80E-01	pCi/L	1.78E+00		U
Milk	Indicator	M-2	11-Apr-13	Composite	Cobalt-58	4.00E-01	pCi/L	2.95E+00		U
Milk	Indicator	M-2	11-Apr-13	Composite	Cobalt-60	-1.49E+00	pCi/L	2.94E+00		U
Milk	Indicator	M-2	11-Apr-13	Composite	Iodine-131	3.44E-01	pCi/L	6.50E-01	1	U
Milk	Indicator	M-2	11-Apr-13	Composite	Iron-59	4.21E+00	pCi/L	7.10E+00		U
Milk	Indicator	M-2	11-Apr-13	Composite	Lanthanum-140	4.55E-02	pCi/L	3.31E+00	15	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Indicator	M-2	11-Apr-13	Composite	Manganese-54	7.79E-01	pCi/L	3.08E+00		U
Milk	Indicator	M-2	11-Apr-13	Composite	Niobium-95	5.05E-02	pCi/L	2.91E+00		U
Milk	Indicator	M-2	11-Apr-13	Composite	Potassium-40	1.47E+03	pCi/L	2.22E+01		
Milk	Indicator	M-2	11-Apr-13	Composite	Ruthenium-103	3.00E-01	pCi/L	2.42E+00		U
Milk	Indicator	M-2	11-Apr-13	Composite	Ruthenium-106	1.54E+00	pCi/L	2.62E+01		U
Milk	Indicator	M-2	11-Apr-13	Composite	Selenium-75	2.06E-02	pCi/L	3.12E+00		U
Milk	Indicator	M-2	11-Apr-13	Composite	Silver-108m	6.47E-01	pCi/L	2.35E+00		U
Milk	Indicator	M-2	11-Apr-13	Composite	Silver-110m	1.98E-01	pCi/L	2.68E+00		U
Milk	Indicator	M-2	11-Apr-13	Composite	Strontium-89	-6.24E+00	pCi/L	1.88E+00	10	U
Milk	Indicator	M-2	11-Apr-13	Composite	Strontium-90	8.72E-01	pCi/L	1.72E+00	2	U
Milk	Indicator	M-2	11-Apr-13	Composite	Zinc-65	-1.12E+00	pCi/L	7.52E+00		U
Milk	Indicator	M-2	11-Apr-13	Composite	Zirconium-95	-3.58E-01	pCi/L	4.94E+00		U
Milk	Control	M-8	11-Apr-13	Composite	Actinium-228	1.31E+00	pCi/L	8.91E+00		U
Milk	Control	M-8	11-Apr-13	Composite	Antimony-124	7.91E-01	pCi/L	3.99E+00		U
Milk	Control	M-8	11-Apr-13	Composite	Antimony-125	-7.39E-01	pCi/L	5.07E+00		U
Milk	Control	M-8	11-Apr-13	Composite	Barium-140	1.21E-01	pCi/L	2.38E+00	15	U
Milk	Control	M-8	11-Apr-13	Composite	Beryllium-7	2.46E+00	pCi/L	1.56E+01		U
Milk	Control	M-8	11-Apr-13	Composite	Cerium-141	1.29E+00	pCi/L	3.01E+00		U
Milk	Control	M-8	11-Apr-13	Composite	Cerium-144	3.51E+00	pCi/L	1.23E+01		U
Milk	Control	M-8	11-Apr-13	Composite	Cesium-134	6.59E-01	pCi/L	2.26E+00	15	U
Milk	Control	M-8	11-Apr-13	Composite	Cesium-137	1.28E+00	pCi/L	2.11E+00	18	U
Milk	Control	M-8	11-Apr-13	Composite	Chromium-51	1.01E+01	pCi/L	1.64E+01		U
Milk	Control	M-8	11-Apr-13	Composite	Cobalt-57	5.86E-01	pCi/L	1.67E+00		U
Milk	Control	M-8	11-Apr-13	Composite	Cobalt-58	-4.13E-01	pCi/L	1.89E+00		U
Milk	Control	M-8	11-Apr-13	Composite	Cobalt-60	8.44E-01	pCi/L	2.40E+00		U
Milk	Control	M-8	11-Apr-13	Composite	Iodine-131	9.67E-03	pCi/L	5.63E-01	1	U
Milk	Control	M-8	11-Apr-13	Composite	Iron-59	3.66E-01	pCi/L	4.31E+00		U
Milk	Control	M-8	11-Apr-13	Composite	Lanthanum-140	1.21E-01	pCi/L	2.38E+00	15	U
Milk	Control	M-8	11-Apr-13	Composite	Manganese-54	7.69E-02	pCi/L	2.02E+00		U
Milk	Control	M-8	11-Apr-13	Composite	Niobium-95	7.58E-01	pCi/L	2.02E+00		U
Milk	Control	M-8	11-Apr-13	Composite	Potassium-40	1.42E+03	pCi/L	1.77E+01		
Milk	Control	M-8	11-Apr-13	Composite	Ruthenium-103	4.42E-01	pCi/L	1.84E+00		U
Milk	Control	M-8	11-Apr-13	Composite	Ruthenium-106	2.86E+00	pCi/L	1.73E+01		U
Milk	Control	M-8	11-Apr-13	Composite	Selenium-75	-5.87E-01	pCi/L	2.38E+00		U
Milk	Control	M-8	11-Apr-13	Composite	Silver-108m	5.32E-01	pCi/L	1.74E+00		U
Milk	Control	M-8	11-Apr-13	Composite	Silver-110m	-1.04E+00	pCi/L	1.71E+00		U
Milk	Control	M-8	11-Apr-13	Composite	Strontium-89	-1.52E+00	pCi/L	1.84E+00	10	U
Milk	Control	M-8	11-Apr-13	Composite	Strontium-90	9.12E-01	pCi/L	1.64E+00	2	U
Milk	Control	M-8	11-Apr-13	Composite	Zinc-65	2.28E+00	pCi/L	5.00E+00		U
Milk	Control	M-8	11-Apr-13	Composite	Zirconium-95	-1.07E+00	pCi/L	3.09E+00		U
Milk	Indicator	M-2	09-May-13	Composite	Actinium-228	-5.16E+00	pCi/L	7.90E+00		U
Milk	Indicator	M-2	09-May-13	Composite	Antimony-124	7.83E-01	pCi/L	3.62E+00		U
Milk	Indicator	M-2	09-May-13	Composite	Antimony-125	-7.32E-01	pCi/L	4.75E+00		U
Milk	Indicator	M-2	09-May-13	Composite	Barium-140	1.04E+00	pCi/L	2.13E+00	15	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Indicator	M-2	09-May-13	Composite	Beryllium-7	-4.59E+00	pCi/L	1.50E+01		U
Milk	Indicator	M-2	09-May-13	Composite	Cerium-141	-4.65E-01	pCi/L	3.26E+00		U
Milk	Indicator	M-2	09-May-13	Composite	Cerium-144	-6.11E+00	pCi/L	1.27E+01		U
Milk	Indicator	M-2	09-May-13	Composite	Cesium-134	1.50E-01	pCi/L	2.00E+00	15	U
Milk	Indicator	M-2	09-May-13	Composite	Cesium-137	7.06E-01	pCi/L	1.88E+00	18	U
Milk	Indicator	M-2	09-May-13	Composite	Chromium-51	3.28E+00	pCi/L	1.68E+01		U
Milk	Indicator	M-2	09-May-13	Composite	Cobalt-57	5.39E-01	pCi/L	1.75E+00		U
Milk	Indicator	M-2	09-May-13	Composite	Cobalt-58	8.87E-02	pCi/L	1.82E+00		U
Milk	Indicator	M-2	09-May-13	Composite	Cobalt-60	5.05E-01	pCi/L	2.15E+00		U
Milk	Indicator	M-2	09-May-13	Composite	Iodine-131	1.35E-01	pCi/L	5.59E-01	1	U
Milk	Indicator	M-2	09-May-13	Composite	Iron-59	2.17E+00	pCi/L	4.40E+00		U
Milk	Indicator	M-2	09-May-13	Composite	Lanthanum-140	1.04E+00	pCi/L	2.13E+00	15	U
Milk	Indicator	M-2	09-May-13	Composite	Manganese-54	-1.08E+00	pCi/L	1.71E+00		U
Milk	Indicator	M-2	09-May-13	Composite	Niobium-95	7.74E-01	pCi/L	1.75E+00		U
Milk	Indicator	M-2	09-May-13	Composite	Potassium-40	1.43E+03	pCi/L	1.53E+01		
Milk	Indicator	M-2	09-May-13	Composite	Ruthenium-103	-2.68E-01	pCi/L	1.79E+00		U
Milk	Indicator	M-2	09-May-13	Composite	Ruthenium-106	1.30E+00	pCi/L	1.58E+01		U
Milk	Indicator	M-2	09-May-13	Composite	Selenium-75	3.88E-01	pCi/L	2.56E+00		U
Milk	Indicator	M-2	09-May-13	Composite	Silver-108m	6.86E-01	pCi/L	1.69E+00		U
Milk	Indicator	M-2	09-May-13	Composite	Silver-110m	-1.10E+00	pCi/L	1.59E+00		U
Milk	Indicator	M-2	09-May-13	Composite	Strontium-89	-2.99E+00	pCi/L	3.47E+00	10	U
Milk	Indicator	M-2	09-May-13	Composite	Strontium-90	7.98E-01	pCi/L	1.82E+00	2	U
Milk	Indicator	M-2	09-May-13	Composite	Zinc-65	-2.14E+00	pCi/L	4.34E+00		U
Milk	Indicator	M-2	09-May-13	Composite	Zirconium-95	-2.71E-01	pCi/L	3.01E+00		U
Milk	Control	M-8	09-May-13	Composite	Actinium-228	5.67E+00	pCi/L	8.41E+00		U
Milk	Control	M-8	09-May-13	Composite	Antimony-124	-9.28E-02	pCi/L	4.11E+00		U
Milk	Control	M-8	09-May-13	Composite	Antimony-125	1.55E+00	pCi/L	5.45E+00		U
Milk	Control	M-8	09-May-13	Composite	Barium-140	1.66E-01	pCi/L	2.23E+00	15	U
Milk	Control	M-8	09-May-13	Composite	Beryllium-7	1.46E+00	pCi/L	1.63E+01		U
Milk	Control	M-8	09-May-13	Composite	Cerium-141	5.21E-01	pCi/L	3.54E+00		U
Milk	Control	M-8	09-May-13	Composite	Cerium-144	4.42E+00	pCi/L	1.45E+01		U
Milk	Control	M-8	09-May-13	Composite	Cesium-134	-3.58E-01	pCi/L	2.05E+00	15	U
Milk	Control	M-8	09-May-13	Composite	Cesium-137	2.09E-01	pCi/L	1.92E+00	18	U
Milk	Control	M-8	09-May-13	Composite	Chromium-51	7.80E+00	pCi/L	1.76E+01		U
Milk	Control	M-8	09-May-13	Composite	Cobalt-57	-2.03E-01	pCi/L	1.84E+00		U
Milk	Control	M-8	09-May-13	Composite	Cobalt-58	-2.12E-01	pCi/L	1.85E+00		U
Milk	Control	M-8	09-May-13	Composite	Cobalt-60	8.08E-01	pCi/L	2.29E+00		U
Milk	Control	M-8	09-May-13	Composite	Iodine-131	8.45E-02	pCi/L	5.86E-01	1	U
Milk	Control	M-8	09-May-13	Composite	Iron-59	-1.87E-01	pCi/L	4.27E+00		U
Milk	Control	M-8	09-May-13	Composite	Lanthanum-140	1.66E-01	pCi/L	2.23E+00	15	U
Milk	Control	M-8	09-May-13	Composite	Manganese-54	3.42E-01	pCi/L	1.92E+00		U
Milk	Control	M-8	09-May-13	Composite	Niobium-95	-3.06E-01	pCi/L	1.95E+00		U
Milk	Control	M-8	09-May-13	Composite	Potassium-40	1.48E+03	pCi/L	1.89E+01		
Milk	Control	M-8	09-May-13	Composite	Ruthenium-103	-6.07E-01	pCi/L	1.89E+00		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Control	M-8	09-May-13	Composite	Ruthenium-106	-7.49E+00	pCi/L	1.62E+01		U
Milk	Control	M-8	09-May-13	Composite	Selenium-75	-4.68E-02	pCi/L	2.64E+00		U
Milk	Control	M-8	09-May-13	Composite	Silver-108m	-8.19E-01	pCi/L	1.55E+00		U
Milk	Control	M-8	09-May-13	Composite	Silver-110m	3.96E-01	pCi/L	1.77E+00		U
Milk	Control	M-8	09-May-13	Composite	Strontium-89	-6.02E-01	pCi/L	2.59E+00	10	U
Milk	Control	M-8	09-May-13	Composite	Strontium-90	3.15E-01	pCi/L	1.76E+00	2	U
Milk	Control	M-8	09-May-13	Composite	Zinc-65	-7.56E-01	pCi/L	4.85E+00		U
Milk	Control	M-8	09-May-13	Composite	Zirconium-95	-6.00E-01	pCi/L	3.23E+00		U
Milk	Indicator	M-2	23-May-13	Composite	Actinium-228	-3.60E+00	pCi/L	1.40E+01		U
Milk	Indicator	M-2	23-May-13	Composite	Antimony-124	-3.58E+00	pCi/L	5.43E+00		U
Milk	Indicator	M-2	23-May-13	Composite	Antimony-125	-4.18E-01	pCi/L	6.94E+00		U
Milk	Indicator	M-2	23-May-13	Composite	Barium-140	3.02E+00	pCi/L	4.41E+00	15	U
Milk	Indicator	M-2	23-May-13	Composite	Beryllium-7	-8.87E+00	pCi/L	2.12E+01		U
Milk	Indicator	M-2	23-May-13	Composite	Cerium-141	1.81E+00	pCi/L	4.08E+00		U
Milk	Indicator	M-2	23-May-13	Composite	Cerium-144	-2.49E+00	pCi/L	1.54E+01		U
Milk	Indicator	M-2	23-May-13	Composite	Cesium-134	1.54E-01	pCi/L	3.30E+00	15	U
Milk	Indicator	M-2	23-May-13	Composite	Cesium-137	-5.40E-01	pCi/L	2.92E+00	18	U
Milk	Indicator	M-2	23-May-13	Composite	Chromium-51	-1.08E+01	pCi/L	2.16E+01		U
Milk	Indicator	M-2	23-May-13	Composite	Cobalt-57	-3.93E-01	pCi/L	1.99E+00		U
Milk	Indicator	M-2	23-May-13	Composite	Cobalt-58	-7.04E-01	pCi/L	2.79E+00		U
Milk	Indicator	M-2	23-May-13	Composite	Cobalt-60	1.58E+00	pCi/L	3.64E+00		U
Milk	Indicator	M-2	23-May-13	Composite	Iodine-131	4.85E-02	pCi/L	7.00E-01	1	U
Milk	Indicator	M-2	23-May-13	Composite	Iron-59	-3.82E+00	pCi/L	6.11E+00		U
Milk	Indicator	M-2	23-May-13	Composite	Lanthanum-140	3.02E+00	pCi/L	4.41E+00	15	U
Milk	Indicator	M-2	23-May-13	Composite	Manganese-54	1.42E+00	pCi/L	2.99E+00		U
Milk	Indicator	M-2	23-May-13	Composite	Niobium-95	-2.26E-01	pCi/L	2.80E+00		U
Milk	Indicator	M-2	23-May-13	Composite	Potassium-40	1.41E+03	pCi/L	2.67E+01		
Milk	Indicator	M-2	23-May-13	Composite	Ruthenium-103	-8.57E-01	pCi/L	2.62E+00		U
Milk	Indicator	M-2	23-May-13	Composite	Ruthenium-106	4.43E+00	pCi/L	2.57E+01		U
Milk	Indicator	M-2	23-May-13	Composite	Selenium-75	1.43E+00	pCi/L	3.26E+00		U
Milk	Indicator	M-2	23-May-13	Composite	Silver-108m	1.37E+00	pCi/L	2.38E+00		U
Milk	Indicator	M-2	23-May-13	Composite	Silver-110m	1.29E-01	pCi/L	2.67E+00		U
Milk	Indicator	M-2	23-May-13	Composite	Strontium-89	-2.02E+00	pCi/L	1.95E+00	10	U
Milk	Indicator	M-2	23-May-13	Composite	Strontium-90	1.48E+00	pCi/L	1.78E+00	2	U
Milk	Indicator	M-2	23-May-13	Composite	Zinc-65	-1.03E+00	pCi/L	7.33E+00		U
Milk	Indicator	M-2	23-May-13	Composite	Zirconium-95	3.81E-02	pCi/L	5.08E+00		U
Milk	Control	M-8	23-May-13	Composite	Actinium-228	-3.02E+00	pCi/L	9.69E+00		U
Milk	Control	M-8	23-May-13	Composite	Antimony-124	2.81E-01	pCi/L	4.81E+00		U
Milk	Control	M-8	23-May-13	Composite	Antimony-125	1.52E+00	pCi/L	5.98E+00		U
Milk	Control	M-8	23-May-13	Composite	Barium-140	-7.45E-01	pCi/L	2.89E+00	15	U
Milk	Control	M-8	23-May-13	Composite	Beryllium-7	6.28E-01	pCi/L	1.83E+01		U
Milk	Control	M-8	23-May-13	Composite	Cerium-141	-2.57E+00	pCi/L	3.94E+00		U
Milk	Control	M-8	23-May-13	Composite	Cerium-144	2.41E+00	pCi/L	1.54E+01		U
Milk	Control	M-8	23-May-13	Composite	Cesium-134	-8.30E-02	pCi/L	2.42E+00	15	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Control	M-8	23-May-13	Composite	Cesium-137	1.98E+00	pCi/L	2.46E+00	18	U
Milk	Control	M-8	23-May-13	Composite	Chromium-51	3.79E+00	pCi/L	2.14E+01		U
Milk	Control	M-8	23-May-13	Composite	Cobalt-57	7.19E-01	pCi/L	1.93E+00		U
Milk	Control	M-8	23-May-13	Composite	Cobalt-58	8.58E-01	pCi/L	2.34E+00		U
Milk	Control	M-8	23-May-13	Composite	Cobalt-60	9.97E-01	pCi/L	2.82E+00		U
Milk	Control	M-8	23-May-13	Composite	Iodine-131	-1.63E-01	pCi/L	5.43E-01	1	U
Milk	Control	M-8	23-May-13	Composite	Iron-59	-7.33E-01	pCi/L	5.21E+00		U
Milk	Control	M-8	23-May-13	Composite	Lanthanum-140	-7.45E-01	pCi/L	2.89E+00	15	U
Milk	Control	M-8	23-May-13	Composite	Manganese-54	1.02E+00	pCi/L	2.42E+00		U
Milk	Control	M-8	23-May-13	Composite	Niobium-95	5.80E-01	pCi/L	2.32E+00		U
Milk	Control	M-8	23-May-13	Composite	Potassium-40	1.47E+03	pCi/L	2.15E+01		
Milk	Control	M-8	23-May-13	Composite	Ruthenium-103	-1.08E+00	pCi/L	2.21E+00		U
Milk	Control	M-8	23-May-13	Composite	Ruthenium-106	5.00E+00	pCi/L	2.03E+01		U
Milk	Control	M-8	23-May-13	Composite	Selenium-75	1.41E+00	pCi/L	3.14E+00		U
Milk	Control	M-8	23-May-13	Composite	Silver-108m	-3.58E-01	pCi/L	1.91E+00		U
Milk	Control	M-8	23-May-13	Composite	Silver-110m	-1.42E+00	pCi/L	2.10E+00		U
Milk	Control	M-8	23-May-13	Composite	Strontium-89	3.68E-01	pCi/L	3.58E+00	10	U
Milk	Control	M-8	23-May-13	Composite	Strontium-90	7.92E-01	pCi/L	1.74E+00	2	U
Milk	Control	M-8	23-May-13	Composite	Zinc-65	1.67E-01	pCi/L	5.98E+00		U
Milk	Control	M-8	23-May-13	Composite	Zirconium-95	1.32E-01	pCi/L	3.93E+00		U
Milk	Indicator	M-2	13-Jun-13	Composite	Actinium-228	7.10E+00	pCi/L	1.90E+01		U
Milk	Indicator	M-2	13-Jun-13	Composite	Antimony-124	7.74E-01	pCi/L	9.03E+00		U
Milk	Indicator	M-2	13-Jun-13	Composite	Antimony-125	-4.84E+00	pCi/L	9.73E+00		U
Milk	Indicator	M-2	13-Jun-13	Composite	Barium-140	-2.74E+00	pCi/L	5.14E+00	15	U
Milk	Indicator	M-2	13-Jun-13	Composite	Beryllium-7	8.16E+00	pCi/L	3.31E+01		U
Milk	Indicator	M-2	13-Jun-13	Composite	Cerium-141	-3.94E+00	pCi/L	6.28E+00		U
Milk	Indicator	M-2	13-Jun-13	Composite	Cerium-144	1.57E+00	pCi/L	2.44E+01		U
Milk	Indicator	M-2	13-Jun-13	Composite	Cesium-134	2.75E+00	pCi/L	4.89E+00	15	U
Milk	Indicator	M-2	13-Jun-13	Composite	Cesium-137	5.60E-01	pCi/L	4.09E+00	18	U
Milk	Indicator	M-2	13-Jun-13	Composite	Chromium-51	1.31E+01	pCi/L	3.64E+01		U
Milk	Indicator	M-2	13-Jun-13	Composite	Cobalt-57	2.57E-01	pCi/L	3.27E+00		U
Milk	Indicator	M-2	13-Jun-13	Composite	Cobalt-58	1.94E+00	pCi/L	3.91E+00		U
Milk	Indicator	M-2	13-Jun-13	Composite	Cobalt-60	1.15E+00	pCi/L	4.60E+00		U
Milk	Indicator	M-2	13-Jun-13	Composite	Iodine-131	-1.70E-01	pCi/L	8.60E-01	1	U
Milk	Indicator	M-2	13-Jun-13	Composite	Iron-59	-2.87E+00	pCi/L	8.83E+00		U
Milk	Indicator	M-2	13-Jun-13	Composite	Lanthanum-140	-2.74E+00	pCi/L	5.14E+00	15	U
Milk	Indicator	M-2	13-Jun-13	Composite	Manganese-54	-2.75E-01	pCi/L	4.07E+00		U
Milk	Indicator	M-2	13-Jun-13	Composite	Niobium-95	-3.28E+00	pCi/L	3.94E+00		U
Milk	Indicator	M-2	13-Jun-13	Composite	Potassium-40	1.43E+03	pCi/L	3.24E+01		
Milk	Indicator	M-2	13-Jun-13	Composite	Ruthenium-103	1.45E+00	pCi/L	4.06E+00		U
Milk	Indicator	M-2	13-Jun-13	Composite	Ruthenium-106	-7.61E+00	pCi/L	3.36E+01		U
Milk	Indicator	M-2	13-Jun-13	Composite	Selenium-75	2.22E+00	pCi/L	4.86E+00		U
Milk	Indicator	M-2	13-Jun-13	Composite	Silver-108m	-9.26E-01	pCi/L	3.12E+00		U
Milk	Indicator	M-2	13-Jun-13	Composite	Silver-110m	4.89E-03	pCi/L	3.58E+00		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Indicator	M-2	13-Jun-13	Composite	Strontium-89	-1.25E+00	pCi/L	1.65E+00	10	U
Milk	Indicator	M-2	13-Jun-13	Composite	Strontium-90	1.29E+00	pCi/L	1.69E+00	2	U
Milk	Indicator	M-2	13-Jun-13	Composite	Zinc-65	-8.27E-01	pCi/L	1.01E+01		U
Milk	Indicator	M-2	13-Jun-13	Composite	Zirconium-95	1.20E+00	pCi/L	7.66E+00		U
Milk	Control	M-8	13-Jun-13	Composite	Actinium-228	-5.63E+00	pCi/L	7.99E+00		U
Milk	Control	M-8	13-Jun-13	Composite	Antimony-124	6.07E-01	pCi/L	3.67E+00		U
Milk	Control	M-8	13-Jun-13	Composite	Antimony-125	-8.21E-01	pCi/L	4.81E+00		U
Milk	Control	M-8	13-Jun-13	Composite	Barium-140	5.91E-01	pCi/L	2.66E+00	15	U
Milk	Control	M-8	13-Jun-13	Composite	Beryllium-7	1.22E+00	pCi/L	1.59E+01		U
Milk	Control	M-8	13-Jun-13	Composite	Cerium-141	1.62E+00	pCi/L	3.28E+00		U
Milk	Control	M-8	13-Jun-13	Composite	Cerium-144	-1.34E+00	pCi/L	1.24E+01		U
Milk	Control	M-8	13-Jun-13	Composite	Cesium-134	-6.18E-01	pCi/L	1.95E+00	15	U
Milk	Control	M-8	13-Jun-13	Composite	Cesium-137	6.69E-01	pCi/L	1.87E+00	18	U
Milk	Control	M-8	13-Jun-13	Composite	Chromium-51	3.18E+00	pCi/L	1.71E+01		U
Milk	Control	M-8	13-Jun-13	Composite	Cobalt-57	-2.35E-01	pCi/L	1.59E+00		U
Milk	Control	M-8	13-Jun-13	Composite	Cobalt-58	-5.83E-01	pCi/L	1.86E+00		U
Milk	Control	M-8	13-Jun-13	Composite	Cobalt-60	1.12E-01	pCi/L	2.26E+00		U
Milk	Control	M-8	13-Jun-13	Composite	Iodine-131	3.85E-01	pCi/L	7.85E-01	1	U
Milk	Control	M-8	13-Jun-13	Composite	Iron-59	-1.04E+00	pCi/L	4.13E+00		U
Milk	Control	M-8	13-Jun-13	Composite	Lanthanum-140	5.91E-01	pCi/L	2.66E+00	15	U
Milk	Control	M-8	13-Jun-13	Composite	Manganese-54	-6.19E-01	pCi/L	1.76E+00		U
Milk	Control	M-8	13-Jun-13	Composite	Niobium-95	5.73E-01	pCi/L	1.92E+00		U
Milk	Control	M-8	13-Jun-13	Composite	Potassium-40	1.43E+03	pCi/L	1.79E+01		
Milk	Control	M-8	13-Jun-13	Composite	Ruthenium-103	1.44E-01	pCi/L	1.95E+00		U
Milk	Control	M-8	13-Jun-13	Composite	Ruthenium-106	-3.69E+00	pCi/L	1.64E+01		U
Milk	Control	M-8	13-Jun-13	Composite	Selenium-75	6.47E-01	pCi/L	2.45E+00		U
Milk	Control	M-8	13-Jun-13	Composite	Silver-108m	-2.03E-01	pCi/L	1.61E+00		U
Milk	Control	M-8	13-Jun-13	Composite	Silver-110m	1.57E-01	pCi/L	1.71E+00		U
Milk	Control	M-8	13-Jun-13	Composite	Strontium-89	-2.52E+00	pCi/L	2.33E+00	10	U
Milk	Control	M-8	13-Jun-13	Composite	Strontium-90	-7.50E-01	pCi/L	1.69E+00	2	U
Milk	Control	M-8	13-Jun-13	Composite	Zinc-65	-1.36E+00	pCi/L	4.41E+00		U
Milk	Control	M-8	13-Jun-13	Composite	Zirconium-95	-2.71E-01	pCi/L	3.26E+00		U
Milk	Indicator	M-2	27-Jun-13	Composite	Actinium-228	-7.87E+00	pCi/L	1.24E+01		U
Milk	Indicator	M-2	27-Jun-13	Composite	Antimony-124	2.93E-02	pCi/L	5.23E+00		U
Milk	Indicator	M-2	27-Jun-13	Composite	Antimony-125	-5.43E-01	pCi/L	6.94E+00		U
Milk	Indicator	M-2	27-Jun-13	Composite	Barium-140	1.05E-01	pCi/L	3.19E+00	15	U
Milk	Indicator	M-2	27-Jun-13	Composite	Beryllium-7	2.15E+01	pCi/L	2.15E+01		UI
Milk	Indicator	M-2	27-Jun-13	Composite	Cerium-141	8.60E-01	pCi/L	4.51E+00		U
Milk	Indicator	M-2	27-Jun-13	Composite	Cerium-144	-8.80E+00	pCi/L	1.75E+01		U
Milk	Indicator	M-2	27-Jun-13	Composite	Cesium-134	-5.78E-01	pCi/L	3.07E+00	15	U
Milk	Indicator	M-2	27-Jun-13	Composite	Cesium-137	5.42E-01	pCi/L	2.92E+00	18	U
Milk	Indicator	M-2	27-Jun-13	Composite	Chromium-51	-1.77E+01	pCi/L	2.07E+01		U
Milk	Indicator	M-2	27-Jun-13	Composite	Cobalt-57	1.40E+00	pCi/L	2.45E+00		U
Milk	Indicator	M-2	27-Jun-13	Composite	Cobalt-58	-2.06E-01	pCi/L	2.72E+00		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Indicator	M-2	27-Jun-13	Composite	Cobalt-60	-1.56E+00	pCi/L	2.98E+00		U
Milk	Indicator	M-2	27-Jun-13	Composite	Iodine-131	-2.13E-01	pCi/L	5.55E-01	1	U
Milk	Indicator	M-2	27-Jun-13	Composite	Iron-59	-2.47E-01	pCi/L	6.49E+00		U
Milk	Indicator	M-2	27-Jun-13	Composite	Lanthanum-140	1.05E-01	pCi/L	3.19E+00	15	U
Milk	Indicator	M-2	27-Jun-13	Composite	Manganese-54	2.11E-01	pCi/L	2.81E+00		U
Milk	Indicator	M-2	27-Jun-13	Composite	Niobium-95	1.74E+00	pCi/L	2.74E+00		U
Milk	Indicator	M-2	27-Jun-13	Composite	Potassium-40	1.42E+03	pCi/L	2.65E+01		
Milk	Indicator	M-2	27-Jun-13	Composite	Ruthenium-103	-1.07E+00	pCi/L	2.57E+00		U
Milk	Indicator	M-2	27-Jun-13	Composite	Ruthenium-106	1.85E+00	pCi/L	2.38E+01		U
Milk	Indicator	M-2	27-Jun-13	Composite	Selenium-75	1.11E+00	pCi/L	3.69E+00		U
Milk	Indicator	M-2	27-Jun-13	Composite	Silver-108m	3.15E-01	pCi/L	2.36E+00		U
Milk	Indicator	M-2	27-Jun-13	Composite	Silver-110m	-2.51E-01	pCi/L	2.60E+00		U
Milk	Indicator	M-2	27-Jun-13	Composite	Strontium-89	4.96E+00	pCi/L	6.21E+00	10	U
Milk	Indicator	M-2	27-Jun-13	Composite	Strontium-90	2.14E-01	pCi/L	1.89E+00	2	U
Milk	Indicator	M-2	27-Jun-13	Composite	Zinc-65	-4.97E-01	pCi/L	6.97E+00		U
Milk	Indicator	M-2	27-Jun-13	Composite	Zirconium-95	-5.56E-01	pCi/L	4.28E+00		U
Milk	Control	M-8	27-Jun-13	Composite	Actinium-228	-5.89E+00	pCi/L	1.06E+01		U
Milk	Control	M-8	27-Jun-13	Composite	Antimony-124	4.05E-01	pCi/L	4.65E+00		U
Milk	Control	M-8	27-Jun-13	Composite	Antimony-125	1.83E+00	pCi/L	7.84E+00		U
Milk	Control	M-8	27-Jun-13	Composite	Barium-140	1.38E-01	pCi/L	2.93E+00	15	U
Milk	Control	M-8	27-Jun-13	Composite	Beryllium-7	-5.67E+00	pCi/L	2.17E+01		U
Milk	Control	M-8	27-Jun-13	Composite	Cerium-141	2.09E-01	pCi/L	4.36E+00		U
Milk	Control	M-8	27-Jun-13	Composite	Cerium-144	-4.37E+00	pCi/L	1.84E+01		U
Milk	Control	M-8	27-Jun-13	Composite	Cesium-134	-3.20E-01	pCi/L	2.94E+00	15	U
Milk	Control	M-8	27-Jun-13	Composite	Cesium-137	1.63E+00	pCi/L	2.94E+00	18	U
Milk	Control	M-8	27-Jun-13	Composite	Chromium-51	3.32E+00	pCi/L	2.35E+01		U
Milk	Control	M-8	27-Jun-13	Composite	Cobalt-57	1.04E+00	pCi/L	2.43E+00		U
Milk	Control	M-8	27-Jun-13	Composite	Cobalt-58	-1.69E-01	pCi/L	2.76E+00		U
Milk	Control	M-8	27-Jun-13	Composite	Cobalt-60	6.46E-01	pCi/L	2.75E+00		U
Milk	Control	M-8	27-Jun-13	Composite	Iodine-131	-6.22E-03	pCi/L	5.65E-01	1	U
Milk	Control	M-8	27-Jun-13	Composite	Iron-59	-3.12E-01	pCi/L	5.56E+00		U
Milk	Control	M-8	27-Jun-13	Composite	Lanthanum-140	1.38E-01	pCi/L	2.93E+00	15	U
Milk	Control	M-8	27-Jun-13	Composite	Manganese-54	-5.55E-01	pCi/L	2.82E+00		U
Milk	Control	M-8	27-Jun-13	Composite	Niobium-95	2.55E-01	pCi/L	2.71E+00		U
Milk	Control	M-8	27-Jun-13	Composite	Potassium-40	1.40E+03	pCi/L	2.53E+01		
Milk	Control	M-8	27-Jun-13	Composite	Ruthenium-103	-5.07E-01	pCi/L	2.62E+00		U
Milk	Control	M-8	27-Jun-13	Composite	Ruthenium-106	5.36E+00	pCi/L	2.41E+01		U
Milk	Control	M-8	27-Jun-13	Composite	Selenium-75	-2.44E+00	pCi/L	3.54E+00		U
Milk	Control	M-8	27-Jun-13	Composite	Silver-108m	-1.15E+00	pCi/L	2.60E+00		U
Milk	Control	M-8	27-Jun-13	Composite	Silver-110m	-2.40E+00	pCi/L	2.39E+00		U
Milk	Control	M-8	27-Jun-13	Composite	Strontium-89	1.71E+00	pCi/L	4.46E+00	10	U
Milk	Control	M-8	27-Jun-13	Composite	Strontium-90	4.75E-01	pCi/L	1.89E+00	2	U
Milk	Control	M-8	27-Jun-13	Composite	Zinc-65	-3.05E+00	pCi/L	5.88E+00		U
Milk	Control	M-8	27-Jun-13	Composite	Zirconium-95	8.10E-01	pCi/L	4.80E+00		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Indicator	M-2	11-Jul-13	Composite	Actinium-228	1.74E+00	pCi/L	1.69E+01		U
Milk	Indicator	M-2	11-Jul-13	Composite	Antimony-124	3.48E+00	pCi/L	7.75E+00		U
Milk	Indicator	M-2	11-Jul-13	Composite	Antimony-125	5.91E+00	pCi/L	1.05E+01		U
Milk	Indicator	M-2	11-Jul-13	Composite	Barium-140	-3.88E-01	pCi/L	4.95E+00	15	U
Milk	Indicator	M-2	11-Jul-13	Composite	Beryllium-7	-4.21E+00	pCi/L	3.05E+01		U
Milk	Indicator	M-2	11-Jul-13	Composite	Cerium-141	-6.66E+00	pCi/L	5.88E+00		U
Milk	Indicator	M-2	11-Jul-13	Composite	Cerium-144	9.90E+00	pCi/L	2.46E+01		U
Milk	Indicator	M-2	11-Jul-13	Composite	Cesium-134	5.52E-01	pCi/L	4.28E+00	15	U
Milk	Indicator	M-2	11-Jul-13	Composite	Cesium-137	1.30E-02	pCi/L	3.67E+00	18	U
Milk	Indicator	M-2	11-Jul-13	Composite	Chromium-51	-4.29E+00	pCi/L	3.37E+01		U
Milk	Indicator	M-2	11-Jul-13	Composite	Cobalt-57	-1.12E-01	pCi/L	3.19E+00		U
Milk	Indicator	M-2	11-Jul-13	Composite	Cobalt-58	3.40E-01	pCi/L	3.76E+00		U
Milk	Indicator	M-2	11-Jul-13	Composite	Cobalt-60	-8.46E-01	pCi/L	4.24E+00		U
Milk	Indicator	M-2	11-Jul-13	Composite	Iodine-131	3.68E-02	pCi/L	5.70E-01	1	U
Milk	Indicator	M-2	11-Jul-13	Composite	Iron-59	-2.72E-01	pCi/L	8.53E+00		U
Milk	Indicator	M-2	11-Jul-13	Composite	Lanthanum-140	-3.88E-01	pCi/L	4.95E+00	15	U
Milk	Indicator	M-2	11-Jul-13	Composite	Manganese-54	-6.18E-01	pCi/L	3.62E+00		U
Milk	Indicator	M-2	11-Jul-13	Composite	Niobium-95	1.14E+00	pCi/L	4.00E+00		U
Milk	Indicator	M-2	11-Jul-13	Composite	Potassium-40	1.42E+03	pCi/L	2.76E+01		U
Milk	Indicator	M-2	11-Jul-13	Composite	Ruthenium-103	-7.17E-01	pCi/L	3.35E+00		U
Milk	Indicator	M-2	11-Jul-13	Composite	Ruthenium-106	8.47E-01	pCi/L	3.40E+01		U
Milk	Indicator	M-2	11-Jul-13	Composite	Selenium-75	-1.05E-01	pCi/L	4.81E+00		U
Milk	Indicator	M-2	11-Jul-13	Composite	Silver-108m	-4.33E-01	pCi/L	3.17E+00		U
Milk	Indicator	M-2	11-Jul-13	Composite	Silver-110m	-1.57E+00	pCi/L	3.01E+00		U
Milk	Indicator	M-2	11-Jul-13	Composite	Strontium-89	-2.07E-01	pCi/L	2.39E+00	10	U
Milk	Indicator	M-2	11-Jul-13	Composite	Strontium-90	8.41E-01	pCi/L	1.79E+00	2	U
Milk	Indicator	M-2	11-Jul-13	Composite	Zinc-65	-4.47E+00	pCi/L	7.54E+00		U
Milk	Indicator	M-2	11-Jul-13	Composite	Zirconium-95	-6.58E-01	pCi/L	6.62E+00		U
Milk	Control	M-8	11-Jul-13	Composite	Actinium-228	-9.21E+00	pCi/L	1.36E+01		U
Milk	Control	M-8	11-Jul-13	Composite	Antimony-124	-1.82E+00	pCi/L	5.38E+00		U
Milk	Control	M-8	11-Jul-13	Composite	Antimony-125	2.13E+00	pCi/L	1.04E+01		U
Milk	Control	M-8	11-Jul-13	Composite	Barium-140	-2.33E-01	pCi/L	5.63E+00	15	U
Milk	Control	M-8	11-Jul-13	Composite	Beryllium-7	-4.28E+00	pCi/L	2.77E+01		U
Milk	Control	M-8	11-Jul-13	Composite	Cerium-141	-2.15E+00	pCi/L	6.50E+00		U
Milk	Control	M-8	11-Jul-13	Composite	Cerium-144	4.10E+00	pCi/L	2.56E+01		U
Milk	Control	M-8	11-Jul-13	Composite	Cesium-134	-3.53E-01	pCi/L	3.91E+00	15	U
Milk	Control	M-8	11-Jul-13	Composite	Cesium-137	2.12E+00	pCi/L	4.09E+00	18	U
Milk	Control	M-8	11-Jul-13	Composite	Chromium-51	3.02E+00	pCi/L	3.41E+01		U
Milk	Control	M-8	11-Jul-13	Composite	Cobalt-57	1.78E+00	pCi/L	3.44E+00		U
Milk	Control	M-8	11-Jul-13	Composite	Cobalt-58	-1.52E+00	pCi/L	3.49E+00		U
Milk	Control	M-8	11-Jul-13	Composite	Cobalt-60	-7.91E-01	pCi/L	4.19E+00		U
Milk	Control	M-8	11-Jul-13	Composite	Iodine-131	1.58E-01	pCi/L	6.52E-01	1	U
Milk	Control	M-8	11-Jul-13	Composite	Iron-59	-3.41E+00	pCi/L	7.10E+00		U
Milk	Control	M-8	11-Jul-13	Composite	Lanthanum-140	-2.33E-01	pCi/L	5.63E+00	15	U



*Fermi 2 - 2013*  
*Annual Radiological Environmental Operating Report*  
*Appendix C - Environmental Data Table*

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Control	M-8	11-Jul-13	Composite	Manganese-54	1.75E-01	pCi/L	3.23E+00		U
Milk	Control	M-8	11-Jul-13	Composite	Niobium-95	-6.49E-01	pCi/L	3.39E+00		U
Milk	Control	M-8	11-Jul-13	Composite	Potassium-40	1.37E+03	pCi/L	3.54E+01		
Milk	Control	M-8	11-Jul-13	Composite	Ruthenium-103	-4.53E-01	pCi/L	3.60E+00		U
Milk	Control	M-8	11-Jul-13	Composite	Ruthenium-106	-1.42E+01	pCi/L	2.98E+01		U
Milk	Control	M-8	11-Jul-13	Composite	Selenium-75	-1.54E+00	pCi/L	4.95E+00		U
Milk	Control	M-8	11-Jul-13	Composite	Silver-108m	-7.99E-01	pCi/L	3.02E+00		U
Milk	Control	M-8	11-Jul-13	Composite	Silver-110m	-1.21E+00	pCi/L	3.08E+00		U
Milk	Control	M-8	11-Jul-13	Composite	Strontium-89	1.31E+00	pCi/L	2.16E+00	10	U
Milk	Control	M-8	11-Jul-13	Composite	Strontium-90	-5.41E-01	pCi/L	1.80E+00	2	U
Milk	Control	M-8	11-Jul-13	Composite	Zinc-65	-2.56E+00	pCi/L	6.76E+00		U
Milk	Control	M-8	11-Jul-13	Composite	Zirconium-95	-2.33E+00	pCi/L	6.15E+00		U
Milk	Indicator	M-2	25-Jul-13	Composite	Actinium-228	-7.24E-01	pCi/L	8.42E+00		U
Milk	Indicator	M-2	25-Jul-13	Composite	Antimony-124	-5.29E-01	pCi/L	3.95E+00		U
Milk	Indicator	M-2	25-Jul-13	Composite	Antimony-125	-1.78E+00	pCi/L	5.01E+00		U
Milk	Indicator	M-2	25-Jul-13	Composite	Barium-140	-5.67E-02	pCi/L	2.17E+00	15	U
Milk	Indicator	M-2	25-Jul-13	Composite	Beryllium-7	9.50E-01	pCi/L	1.55E+01		U
Milk	Indicator	M-2	25-Jul-13	Composite	Cerium-141	7.00E-01	pCi/L	2.97E+00		U
Milk	Indicator	M-2	25-Jul-13	Composite	Cerium-144	1.06E+01	pCi/L	1.26E+01		U
Milk	Indicator	M-2	25-Jul-13	Composite	Cesium-134	-1.01E-02	pCi/L	2.16E+00	15	U
Milk	Indicator	M-2	25-Jul-13	Composite	Cesium-137	4.34E-01	pCi/L	2.00E+00	18	U
Milk	Indicator	M-2	25-Jul-13	Composite	Chromium-51	1.59E+00	pCi/L	1.59E+01		U
Milk	Indicator	M-2	25-Jul-13	Composite	Cobalt-57	5.26E-01	pCi/L	1.72E+00		U
Milk	Indicator	M-2	25-Jul-13	Composite	Cobalt-58	4.33E-01	pCi/L	1.95E+00		U
Milk	Indicator	M-2	25-Jul-13	Composite	Cobalt-60	-5.00E-01	pCi/L	2.23E+00		U
Milk	Indicator	M-2	25-Jul-13	Composite	Iodine-131	-3.77E-02	pCi/L	7.05E-01	1	U
Milk	Indicator	M-2	25-Jul-13	Composite	Iron-59	-2.14E+00	pCi/L	4.50E+00		U
Milk	Indicator	M-2	25-Jul-13	Composite	Lanthanum-140	-5.67E-02	pCi/L	2.17E+00	15	U
Milk	Indicator	M-2	25-Jul-13	Composite	Manganese-54	5.86E-01	pCi/L	1.98E+00		U
Milk	Indicator	M-2	25-Jul-13	Composite	Niobium-95	-1.26E+00	pCi/L	1.99E+00		U
Milk	Indicator	M-2	25-Jul-13	Composite	Potassium-40	1.43E+03	pCi/L	1.80E+01		
Milk	Indicator	M-2	25-Jul-13	Composite	Ruthenium-103	-1.20E+00	pCi/L	1.86E+00		U
Milk	Indicator	M-2	25-Jul-13	Composite	Ruthenium-106	6.13E+00	pCi/L	1.80E+01		U
Milk	Indicator	M-2	25-Jul-13	Composite	Selenium-75	-1.86E-01	pCi/L	2.51E+00		U
Milk	Indicator	M-2	25-Jul-13	Composite	Silver-108m	-2.21E-01	pCi/L	1.70E+00		U
Milk	Indicator	M-2	25-Jul-13	Composite	Silver-110m	7.99E-01	pCi/L	1.86E+00		U
Milk	Indicator	M-2	25-Jul-13	Composite	Strontium-89	-2.02E+00	pCi/L	3.35E+00	10	U
Milk	Indicator	M-2	25-Jul-13	Composite	Strontium-90	2.38E-01	pCi/L	1.11E+00	2	U
Milk	Indicator	M-2	25-Jul-13	Composite	Zinc-65	-1.92E+00	pCi/L	4.73E+00		U
Milk	Indicator	M-2	25-Jul-13	Composite	Zirconium-95	1.33E+00	pCi/L	3.43E+00		U
Milk	Control	M-8	25-Jul-13	Composite	Actinium-228	6.69E-01	pCi/L	7.03E+00		U
Milk	Control	M-8	25-Jul-13	Composite	Antimony-124	3.51E-01	pCi/L	3.38E+00		U
Milk	Control	M-8	25-Jul-13	Composite	Antimony-125	7.25E-01	pCi/L	4.23E+00		U
Milk	Control	M-8	25-Jul-13	Composite	Barium-140	-3.92E-01	pCi/L	1.80E+00	15	U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Control	M-8	25-Jul-13	Composite	Beryllium-7	3.60E+00	pCi/L	1.25E+01		U
Milk	Control	M-8	25-Jul-13	Composite	Cerium-141	6.57E-01	pCi/L	2.36E+00		U
Milk	Control	M-8	25-Jul-13	Composite	Cerium-144	3.10E+00	pCi/L	1.04E+01		U
Milk	Control	M-8	25-Jul-13	Composite	Cesium-134	9.15E-01	pCi/L	1.83E+00	15	U
Milk	Control	M-8	25-Jul-13	Composite	Cesium-137	1.36E+00	pCi/L	1.76E+00	18	U
Milk	Control	M-8	25-Jul-13	Composite	Chromium-51	-1.36E+00	pCi/L	1.31E+01		U
Milk	Control	M-8	25-Jul-13	Composite	Cobalt-57	-3.14E-01	pCi/L	1.33E+00		U
Milk	Control	M-8	25-Jul-13	Composite	Cobalt-58	2.61E-01	pCi/L	1.59E+00		U
Milk	Control	M-8	25-Jul-13	Composite	Cobalt-60	-1.93E-01	pCi/L	1.69E+00		U
Milk	Control	M-8	25-Jul-13	Composite	Iodine-131	2.59E-01	pCi/L	8.64E-01	1	U
Milk	Control	M-8	25-Jul-13	Composite	Iron-59	-1.01E+00	pCi/L	3.56E+00		U
Milk	Control	M-8	25-Jul-13	Composite	Lanthanum-140	-3.92E-01	pCi/L	1.80E+00	15	U
Milk	Control	M-8	25-Jul-13	Composite	Manganese-54	1.97E-01	pCi/L	1.57E+00		U
Milk	Control	M-8	25-Jul-13	Composite	Niobium-95	6.00E-01	pCi/L	1.39E+00		U
Milk	Control	M-8	25-Jul-13	Composite	Potassium-40	1.43E+03	pCi/L	1.58E+01		
Milk	Control	M-8	25-Jul-13	Composite	Ruthenium-103	6.66E-02	pCi/L	1.45E+00		U
Milk	Control	M-8	25-Jul-13	Composite	Ruthenium-106	-3.01E-01	pCi/L	1.39E+01		U
Milk	Control	M-8	25-Jul-13	Composite	Selenium-75	-3.77E-01	pCi/L	2.06E+00		U
Milk	Control	M-8	25-Jul-13	Composite	Silver-108m	5.51E-01	pCi/L	1.40E+00		U
Milk	Control	M-8	25-Jul-13	Composite	Silver-110m	-1.10E+00	pCi/L	1.43E+00		U
Milk	Control	M-8	25-Jul-13	Composite	Strontium-89	-1.97E+00	pCi/L	3.01E+00	10	U
Milk	Control	M-8	25-Jul-13	Composite	Strontium-90	1.45E+00	pCi/L	1.71E+00	2	U
Milk	Control	M-8	25-Jul-13	Composite	Zinc-65	3.64E-01	pCi/L	4.07E+00		U
Milk	Control	M-8	25-Jul-13	Composite	Zirconium-95	-3.57E-01	pCi/L	2.52E+00		U
Milk	Indicator	M-2	15-Aug-13	Composite	Actinium-228	5.32E+00	pCi/L	9.75E+00		U
Milk	Indicator	M-2	15-Aug-13	Composite	Antimony-124	-1.72E+00	pCi/L	4.16E+00		U
Milk	Indicator	M-2	15-Aug-13	Composite	Antimony-125	1.45E+00	pCi/L	5.89E+00		U
Milk	Indicator	M-2	15-Aug-13	Composite	Barium-140	-9.70E-01	pCi/L	2.76E+00	15	U
Milk	Indicator	M-2	15-Aug-13	Composite	Beryllium-7	-2.60E+00	pCi/L	1.76E+01		U
Milk	Indicator	M-2	15-Aug-13	Composite	Cerium-141	1.14E+00	pCi/L	3.48E+00		U
Milk	Indicator	M-2	15-Aug-13	Composite	Cerium-144	1.32E+01	pCi/L	1.32E+01		UI
Milk	Indicator	M-2	15-Aug-13	Composite	Cesium-134	4.42E-01	pCi/L	2.39E+00	15	U
Milk	Indicator	M-2	15-Aug-13	Composite	Cesium-137	-9.43E-01	pCi/L	2.00E+00	18	U
Milk	Indicator	M-2	15-Aug-13	Composite	Chromium-51	-7.71E+00	pCi/L	1.91E+01		U
Milk	Indicator	M-2	15-Aug-13	Composite	Cobalt-57	-1.53E+00	pCi/L	1.67E+00		U
Milk	Indicator	M-2	15-Aug-13	Composite	Cobalt-58	-1.35E-01	pCi/L	2.10E+00		U
Milk	Indicator	M-2	15-Aug-13	Composite	Cobalt-60	3.29E-01	pCi/L	2.49E+00		U
Milk	Indicator	M-2	15-Aug-13	Composite	Iodine-131	-2.03E-01	pCi/L	7.30E-01	1	U
Milk	Indicator	M-2	15-Aug-13	Composite	Iron-59	3.30E-01	pCi/L	5.32E+00		U
Milk	Indicator	M-2	15-Aug-13	Composite	Lanthanum-140	-9.70E-01	pCi/L	2.76E+00	15	U
Milk	Indicator	M-2	15-Aug-13	Composite	Manganese-54	4.58E-01	pCi/L	2.09E+00		U
Milk	Indicator	M-2	15-Aug-13	Composite	Niobium-95	-4.25E-01	pCi/L	2.02E+00		U
Milk	Indicator	M-2	15-Aug-13	Composite	Potassium-40	1.36E+03	pCi/L	2.12E+01		
Milk	Indicator	M-2	15-Aug-13	Composite	Ruthenium-103	5.18E-01	pCi/L	2.11E+00		U

*Fermi 2 - 2013*  
*Annual Radiological Environmental Operating Report*  
*Appendix C - Environmental Data Table*

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Indicator	M-2	15-Aug-13	Composite	Ruthenium-106	-9.83E+00	pCi/L	1.78E+01		U
Milk	Indicator	M-2	15-Aug-13	Composite	Selenium-75	1.07E-01	pCi/L	2.73E+00		U
Milk	Indicator	M-2	15-Aug-13	Composite	Silver-108m	-7.03E-01	pCi/L	1.79E+00		U
Milk	Indicator	M-2	15-Aug-13	Composite	Silver-110m	7.79E-01	pCi/L	2.01E+00		U
Milk	Indicator	M-2	15-Aug-13	Composite	Strontium-89	-3.19E-01	pCi/L	2.46E+00	10	U
Milk	Indicator	M-2	15-Aug-13	Composite	Strontium-90	1.47E+00	pCi/L	1.79E+00	2	U
Milk	Indicator	M-2	15-Aug-13	Composite	Zinc-65	-9.94E-01	pCi/L	5.34E+00		U
Milk	Indicator	M-2	15-Aug-13	Composite	Zirconium-95	-3.11E-01	pCi/L	3.85E+00		U
Milk	Control	M-8	15-Aug-13	Composite	Actinium-228	2.74E+00	pCi/L	8.70E+00		U
Milk	Control	M-8	15-Aug-13	Composite	Antimony-124	-2.68E+00	pCi/L	4.04E+00		U
Milk	Control	M-8	15-Aug-13	Composite	Antimony-125	1.13E+00	pCi/L	5.08E+00		U
Milk	Control	M-8	15-Aug-13	Composite	Barium-140	1.18E-01	pCi/L	2.53E+00	15	U
Milk	Control	M-8	15-Aug-13	Composite	Beryllium-7	2.17E+00	pCi/L	1.59E+01		U
Milk	Control	M-8	15-Aug-13	Composite	Cerium-141	-1.61E+00	pCi/L	3.17E+00		U
Milk	Control	M-8	15-Aug-13	Composite	Cerium-144	3.63E+00	pCi/L	1.27E+01		U
Milk	Control	M-8	15-Aug-13	Composite	Cesium-134	-8.39E-02	pCi/L	2.07E+00	15	U
Milk	Control	M-8	15-Aug-13	Composite	Cesium-137	-1.52E+00	pCi/L	2.40E+00	18	U
Milk	Control	M-8	15-Aug-13	Composite	Chromium-51	2.90E+00	pCi/L	1.69E+01		U
Milk	Control	M-8	15-Aug-13	Composite	Cobalt-57	-3.41E-01	pCi/L	1.62E+00		U
Milk	Control	M-8	15-Aug-13	Composite	Cobalt-58	4.60E-01	pCi/L	1.94E+00		U
Milk	Control	M-8	15-Aug-13	Composite	Cobalt-60	2.51E-01	pCi/L	2.20E+00		U
Milk	Control	M-8	15-Aug-13	Composite	Iodine-131	2.65E-01	pCi/L	6.72E-01	1	U
Milk	Control	M-8	15-Aug-13	Composite	Iron-59	1.80E+00	pCi/L	4.80E+00		U
Milk	Control	M-8	15-Aug-13	Composite	Lanthanum-140	1.18E-01	pCi/L	2.53E+00	15	U
Milk	Control	M-8	15-Aug-13	Composite	Manganese-54	-9.15E-01	pCi/L	1.91E+00		U
Milk	Control	M-8	15-Aug-13	Composite	Niobium-95	7.96E-01	pCi/L	1.97E+00		U
Milk	Control	M-8	15-Aug-13	Composite	Potassium-40	1.39E+03	pCi/L	1.67E+01		U
Milk	Control	M-8	15-Aug-13	Composite	Ruthenium-103	-7.14E-01	pCi/L	1.98E+00		U
Milk	Control	M-8	15-Aug-13	Composite	Ruthenium-106	-1.50E+00	pCi/L	1.63E+01		U
Milk	Control	M-8	15-Aug-13	Composite	Selenium-75	-3.83E-01	pCi/L	2.53E+00		U
Milk	Control	M-8	15-Aug-13	Composite	Silver-108m	-1.90E-01	pCi/L	1.60E+00		U
Milk	Control	M-8	15-Aug-13	Composite	Silver-110m	-2.57E+00	pCi/L	1.78E+00		U
Milk	Control	M-8	15-Aug-13	Composite	Strontium-89	1.65E+00	pCi/L	4.21E+00	10	U
Milk	Control	M-8	15-Aug-13	Composite	Strontium-90	3.92E-02	pCi/L	1.88E+00	2	U
Milk	Control	M-8	15-Aug-13	Composite	Zinc-65	1.62E+00	pCi/L	4.94E+00		U
Milk	Control	M-8	15-Aug-13	Composite	Zirconium-95	1.73E+00	pCi/L	3.66E+00		U
Milk	Indicator	M-2	29-Aug-13	Composite	Actinium-228	1.06E+00	pCi/L	1.47E+01		U
Milk	Indicator	M-2	29-Aug-13	Composite	Antimony-124	3.62E+00	pCi/L	7.44E+00		U
Milk	Indicator	M-2	29-Aug-13	Composite	Antimony-125	4.46E+00	pCi/L	9.03E+00		U
Milk	Indicator	M-2	29-Aug-13	Composite	Barium-140	-2.24E+00	pCi/L	3.49E+00	15	U
Milk	Indicator	M-2	29-Aug-13	Composite	Beryllium-7	4.41E+00	pCi/L	2.77E+01		U
Milk	Indicator	M-2	29-Aug-13	Composite	Cerium-141	-2.82E+00	pCi/L	5.09E+00		U
Milk	Indicator	M-2	29-Aug-13	Composite	Cerium-144	2.54E-01	pCi/L	2.12E+01		U
Milk	Indicator	M-2	29-Aug-13	Composite	Cesium-134	2.09E+00	pCi/L	4.15E+00	15	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Indicator	M-2	29-Aug-13	Composite	Cesium-137	1.05E+00	pCi/L	3.75E+00	18	U
Milk	Indicator	M-2	29-Aug-13	Composite	Chromium-51	-5.00E+00	pCi/L	2.81E+01		U
Milk	Indicator	M-2	29-Aug-13	Composite	Cobalt-57	-1.11E+00	pCi/L	2.71E+00		U
Milk	Indicator	M-2	29-Aug-13	Composite	Cobalt-58	-1.58E-01	pCi/L	3.11E+00		U
Milk	Indicator	M-2	29-Aug-13	Composite	Cobalt-60	2.60E+00	pCi/L	4.30E+00		U
Milk	Indicator	M-2	29-Aug-13	Composite	Iodine-131	-2.92E-01	pCi/L	5.90E-01	1	U
Milk	Indicator	M-2	29-Aug-13	Composite	Iron-59	-2.62E+00	pCi/L	7.48E+00		U
Milk	Indicator	M-2	29-Aug-13	Composite	Lanthanum-140	-2.24E+00	pCi/L	3.49E+00	15	U
Milk	Indicator	M-2	29-Aug-13	Composite	Manganese-54	2.84E+00	pCi/L	2.90E+00		U
Milk	Indicator	M-2	29-Aug-13	Composite	Niobium-95	7.98E-02	pCi/L	3.14E+00		U
Milk	Indicator	M-2	29-Aug-13	Composite	Potassium-40	1.38E+03	pCi/L	3.00E+01		
Milk	Indicator	M-2	29-Aug-13	Composite	Ruthenium-103	-1.24E+00	pCi/L	3.03E+00		U
Milk	Indicator	M-2	29-Aug-13	Composite	Ruthenium-106	-1.34E-01	pCi/L	2.79E+01		U
Milk	Indicator	M-2	29-Aug-13	Composite	Selenium-75	1.34E+00	pCi/L	4.46E+00		U
Milk	Indicator	M-2	29-Aug-13	Composite	Silver-108m	4.43E-01	pCi/L	2.95E+00		U
Milk	Indicator	M-2	29-Aug-13	Composite	Silver-110m	-1.75E+00	pCi/L	2.98E+00		U
Milk	Indicator	M-2	29-Aug-13	Composite	Strontium-89	1.33E+00	pCi/L	3.37E+00	10	U
Milk	Indicator	M-2	29-Aug-13	Composite	Strontium-90	4.75E-01	pCi/L	1.84E+00	2	U
Milk	Indicator	M-2	29-Aug-13	Composite	Zinc-65	-1.20E+00	pCi/L	8.24E+00		U
Milk	Indicator	M-2	29-Aug-13	Composite	Zirconium-95	-1.36E+00	pCi/L	5.41E+00		U
Milk	Control	M-8	29-Aug-13	Composite	Actinium-228	3.92E+00	pCi/L	1.56E+01		U
Milk	Control	M-8	29-Aug-13	Composite	Antimony-124	2.48E+00	pCi/L	6.79E+00		U
Milk	Control	M-8	29-Aug-13	Composite	Antimony-125	-1.97E+00	pCi/L	8.33E+00		U
Milk	Control	M-8	29-Aug-13	Composite	Barium-140	1.09E+00	pCi/L	3.84E+00	15	U
Milk	Control	M-8	29-Aug-13	Composite	Beryllium-7	-5.03E+00	pCi/L	2.56E+01		U
Milk	Control	M-8	29-Aug-13	Composite	Cerium-141	-3.44E+00	pCi/L	5.18E+00		U
Milk	Control	M-8	29-Aug-13	Composite	Cerium-144	5.16E+00	pCi/L	2.23E+01		U
Milk	Control	M-8	29-Aug-13	Composite	Cesium-134	-1.41E+00	pCi/L	3.39E+00	15	U
Milk	Control	M-8	29-Aug-13	Composite	Cesium-137	1.90E+00	pCi/L	3.55E+00	18	U
Milk	Control	M-8	29-Aug-13	Composite	Chromium-51	3.09E+00	pCi/L	2.57E+01		U
Milk	Control	M-8	29-Aug-13	Composite	Cobalt-57	-1.80E+00	pCi/L	2.73E+00		U
Milk	Control	M-8	29-Aug-13	Composite	Cobalt-58	2.23E-02	pCi/L	3.18E+00		U
Milk	Control	M-8	29-Aug-13	Composite	Cobalt-60	1.31E+00	pCi/L	4.06E+00		U
Milk	Control	M-8	29-Aug-13	Composite	Iodine-131	1.67E-01	pCi/L	6.84E-01	1	U
Milk	Control	M-8	29-Aug-13	Composite	Iron-59	-2.03E+00	pCi/L	7.11E+00		U
Milk	Control	M-8	29-Aug-13	Composite	Lanthanum-140	1.09E+00	pCi/L	3.84E+00	15	U
Milk	Control	M-8	29-Aug-13	Composite	Manganese-54	4.44E-01	pCi/L	3.07E+00		U
Milk	Control	M-8	29-Aug-13	Composite	Niobium-95	-2.42E-01	pCi/L	3.29E+00		U
Milk	Control	M-8	29-Aug-13	Composite	Potassium-40	1.33E+03	pCi/L	3.40E+01		
Milk	Control	M-8	29-Aug-13	Composite	Ruthenium-103	-1.44E+00	pCi/L	2.77E+00		U
Milk	Control	M-8	29-Aug-13	Composite	Ruthenium-106	-8.87E+00	pCi/L	2.75E+01		U
Milk	Control	M-8	29-Aug-13	Composite	Selenium-75	-4.47E-01	pCi/L	4.27E+00		U
Milk	Control	M-8	29-Aug-13	Composite	Silver-108m	6.50E-01	pCi/L	2.80E+00		U
Milk	Control	M-8	29-Aug-13	Composite	Silver-110m	7.58E-01	pCi/L	3.06E+00		U

*Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table*

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Control	M-8	29-Aug-13	Composite	Strontium-89	-1.69E+00	pCi/L	2.59E+00	10	U
Milk	Control	M-8	29-Aug-13	Composite	Strontium-90	-5.01E-03	pCi/L	1.69E+00	2	U
Milk	Control	M-8	29-Aug-13	Composite	Zinc-65	4.99E+00	pCi/L	8.55E+00		U
Milk	Control	M-8	29-Aug-13	Composite	Zirconium-95	-1.08E+00	pCi/L	5.58E+00		U
Milk	Indicator	M-2	12-Sep-13	Composite	Actinium-228	5.16E-01	pCi/L	8.37E+00		U
Milk	Indicator	M-2	12-Sep-13	Composite	Antimony-124	3.24E-01	pCi/L	3.58E+00		U
Milk	Indicator	M-2	12-Sep-13	Composite	Antimony-125	-3.14E+00	pCi/L	4.42E+00		U
Milk	Indicator	M-2	12-Sep-13	Composite	Barium-140	-4.26E-01	pCi/L	1.96E+00	15	U
Milk	Indicator	M-2	12-Sep-13	Composite	Beryllium-7	-6.45E+00	pCi/L	1.40E+01		U
Milk	Indicator	M-2	12-Sep-13	Composite	Cerium-141	6.02E-01	pCi/L	2.85E+00		U
Milk	Indicator	M-2	12-Sep-13	Composite	Cerium-144	4.76E-01	pCi/L	1.15E+01		U
Milk	Indicator	M-2	12-Sep-13	Composite	Cesium-134	4.63E-01	pCi/L	2.02E+00	15	U
Milk	Indicator	M-2	12-Sep-13	Composite	Cesium-137	5.56E-01	pCi/L	1.83E+00	18	U
Milk	Indicator	M-2	12-Sep-13	Composite	Chromium-51	1.03E+01	pCi/L	1.56E+01		U
Milk	Indicator	M-2	12-Sep-13	Composite	Cobalt-57	1.76E-01	pCi/L	1.48E+00		U
Milk	Indicator	M-2	12-Sep-13	Composite	Cobalt-58	-1.12E+00	pCi/L	1.65E+00		U
Milk	Indicator	M-2	12-Sep-13	Composite	Cobalt-60	2.78E-01	pCi/L	2.12E+00		U
Milk	Indicator	M-2	12-Sep-13	Composite	Iodine-131	-2.84E-01	pCi/L	4.92E-01	1	U
Milk	Indicator	M-2	12-Sep-13	Composite	Iron-59	1.11E+00	pCi/L	4.24E+00		U
Milk	Indicator	M-2	12-Sep-13	Composite	Lanthanum-140	-4.26E-01	pCi/L	1.96E+00	15	U
Milk	Indicator	M-2	12-Sep-13	Composite	Manganese-54	-6.68E-02	pCi/L	1.75E+00		U
Milk	Indicator	M-2	12-Sep-13	Composite	Niobium-95	3.87E-01	pCi/L	1.92E+00		U
Milk	Indicator	M-2	12-Sep-13	Composite	Potassium-40	1.46E+03	pCi/L	1.68E+01		U
Milk	Indicator	M-2	12-Sep-13	Composite	Ruthenium-103	4.69E-01	pCi/L	1.77E+00		U
Milk	Indicator	M-2	12-Sep-13	Composite	Ruthenium-106	3.05E+00	pCi/L	1.64E+01		U
Milk	Indicator	M-2	12-Sep-13	Composite	Selenium-75	1.42E-01	pCi/L	2.25E+00		U
Milk	Indicator	M-2	12-Sep-13	Composite	Silver-108m	-1.34E+00	pCi/L	1.56E+00		U
Milk	Indicator	M-2	12-Sep-13	Composite	Silver-110m	8.47E-01	pCi/L	1.65E+00		U
Milk	Indicator	M-2	12-Sep-13	Composite	Strontium-89	7.81E-01	pCi/L	2.64E+00	10	U
Milk	Indicator	M-2	12-Sep-13	Composite	Strontium-90	-8.90E-01	pCi/L	1.71E+00	2	U
Milk	Indicator	M-2	12-Sep-13	Composite	Zinc-65	-1.05E+00	pCi/L	4.50E+00		U
Milk	Indicator	M-2	12-Sep-13	Composite	Zirconium-95	6.71E-01	pCi/L	3.26E+00		U
Milk	Control	M-8	12-Sep-13	Composite	Actinium-228	7.17E+00	pCi/L	8.30E+00		U
Milk	Control	M-8	12-Sep-13	Composite	Antimony-124	-1.29E-01	pCi/L	3.54E+00		U
Milk	Control	M-8	12-Sep-13	Composite	Antimony-125	1.24E+00	pCi/L	4.58E+00		U
Milk	Control	M-8	12-Sep-13	Composite	Barium-140	8.50E-01	pCi/L	2.09E+00	15	U
Milk	Control	M-8	12-Sep-13	Composite	Beryllium-7	-3.87E+00	pCi/L	1.48E+01		U
Milk	Control	M-8	12-Sep-13	Composite	Cerium-141	9.37E-01	pCi/L	3.18E+00		U
Milk	Control	M-8	12-Sep-13	Composite	Cerium-144	-6.00E+00	pCi/L	1.30E+01		U
Milk	Control	M-8	12-Sep-13	Composite	Cesium-134	7.19E-01	pCi/L	1.92E+00	15	U
Milk	Control	M-8	12-Sep-13	Composite	Cesium-137	-3.06E-01	pCi/L	1.79E+00	18	U
Milk	Control	M-8	12-Sep-13	Composite	Chromium-51	3.36E+00	pCi/L	1.66E+01		U
Milk	Control	M-8	12-Sep-13	Composite	Cobalt-57	5.70E-01	pCi/L	1.74E+00		U
Milk	Control	M-8	12-Sep-13	Composite	Cobalt-58	-3.62E-01	pCi/L	1.74E+00		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Control	M-8	12-Sep-13	Composite	Cobalt-60	5.84E-01	pCi/L	2.06E+00		U
Milk	Control	M-8	12-Sep-13	Composite	Iodine-131	6.51E-02	pCi/L	5.75E-01	1	U
Milk	Control	M-8	12-Sep-13	Composite	Iron-59	-3.10E-01	pCi/L	3.76E+00		U
Milk	Control	M-8	12-Sep-13	Composite	Lanthanum-140	8.50E-01	pCi/L	2.09E+00	15	U
Milk	Control	M-8	12-Sep-13	Composite	Manganese-54	-1.06E+00	pCi/L	1.68E+00		U
Milk	Control	M-8	12-Sep-13	Composite	Niobium-95	-8.41E-01	pCi/L	1.80E+00		U
Milk	Control	M-8	12-Sep-13	Composite	Potassium-40	1.38E+03	pCi/L	1.74E+01		
Milk	Control	M-8	12-Sep-13	Composite	Ruthenium-103	1.53E-01	pCi/L	1.74E+00		U
Milk	Control	M-8	12-Sep-13	Composite	Ruthenium-106	-6.32E+00	pCi/L	1.56E+01		U
Milk	Control	M-8	12-Sep-13	Composite	Selenium-75	6.80E-01	pCi/L	2.56E+00		U
Milk	Control	M-8	12-Sep-13	Composite	Silver-108m	-1.84E-01	pCi/L	1.55E+00		U
Milk	Control	M-8	12-Sep-13	Composite	Silver-110m	8.00E-02	pCi/L	1.61E+00		U
Milk	Control	M-8	12-Sep-13	Composite	Strontium-89	-3.52E+00	pCi/L	2.39E+00	10	U
Milk	Control	M-8	12-Sep-13	Composite	Strontium-90	5.66E-01	pCi/L	1.66E+00	2	U
Milk	Control	M-8	12-Sep-13	Composite	Zinc-65	2.89E+00	pCi/L	4.24E+00		U
Milk	Control	M-8	12-Sep-13	Composite	Zirconium-95	7.70E-01	pCi/L	3.17E+00		U
Milk	Indicator	M-2	26-Sep-13	Composite	Actinium-228	-4.69E+00	pCi/L	1.28E+01		U
Milk	Indicator	M-2	26-Sep-13	Composite	Antimony-124	-4.67E+00	pCi/L	4.42E+00		U
Milk	Indicator	M-2	26-Sep-13	Composite	Antimony-125	3.81E-01	pCi/L	7.41E+00		U
Milk	Indicator	M-2	26-Sep-13	Composite	Barium-140	-3.17E+00	pCi/L	2.96E+00	15	U
Milk	Indicator	M-2	26-Sep-13	Composite	Beryllium-7	-8.58E+00	pCi/L	2.21E+01		U
Milk	Indicator	M-2	26-Sep-13	Composite	Cerium-141	-1.10E+00	pCi/L	4.47E+00		U
Milk	Indicator	M-2	26-Sep-13	Composite	Cerium-144	-9.64E-01	pCi/L	1.86E+01		U
Milk	Indicator	M-2	26-Sep-13	Composite	Cesium-134	-1.30E+00	pCi/L	3.23E+00	15	U
Milk	Indicator	M-2	26-Sep-13	Composite	Cesium-137	7.84E-01	pCi/L	3.04E+00	18	U
Milk	Indicator	M-2	26-Sep-13	Composite	Chromium-51	1.39E+01	pCi/L	2.52E+01		U
Milk	Indicator	M-2	26-Sep-13	Composite	Cobalt-57	9.93E-01	pCi/L	2.45E+00		U
Milk	Indicator	M-2	26-Sep-13	Composite	Cobalt-58	1.98E-01	pCi/L	2.64E+00		U
Milk	Indicator	M-2	26-Sep-13	Composite	Cobalt-60	3.11E-01	pCi/L	3.37E+00		U
Milk	Indicator	M-2	26-Sep-13	Composite	Iodine-131	-2.90E-02	pCi/L	5.70E-01	1	U
Milk	Indicator	M-2	26-Sep-13	Composite	Iron-59	1.07E-01	pCi/L	6.35E+00		U
Milk	Indicator	M-2	26-Sep-13	Composite	Lanthanum-140	-3.17E+00	pCi/L	2.96E+00	15	U
Milk	Indicator	M-2	26-Sep-13	Composite	Manganese-54	-4.86E-01	pCi/L	2.68E+00		U
Milk	Indicator	M-2	26-Sep-13	Composite	Niobium-95	1.54E+00	pCi/L	2.90E+00		U
Milk	Indicator	M-2	26-Sep-13	Composite	Potassium-40	1.38E+03	pCi/L	2.49E+01		
Milk	Indicator	M-2	26-Sep-13	Composite	Ruthenium-103	-1.11E+00	pCi/L	2.52E+00		U
Milk	Indicator	M-2	26-Sep-13	Composite	Ruthenium-106	1.89E+01	pCi/L	2.58E+01		U
Milk	Indicator	M-2	26-Sep-13	Composite	Selenium-75	-1.78E+00	pCi/L	3.63E+00		U
Milk	Indicator	M-2	26-Sep-13	Composite	Silver-108m	2.93E-01	pCi/L	2.39E+00		U
Milk	Indicator	M-2	26-Sep-13	Composite	Silver-110m	-1.04E+00	pCi/L	2.45E+00		U
Milk	Indicator	M-2	26-Sep-13	Composite	Strontium-89	-1.38E+00	pCi/L	2.28E+00	10	U
Milk	Indicator	M-2	26-Sep-13	Composite	Strontium-90	9.68E-01	pCi/L	1.91E+00	2	U
Milk	Indicator	M-2	26-Sep-13	Composite	Zinc-65	-4.03E-01	pCi/L	7.09E+00		U
Milk	Indicator	M-2	26-Sep-13	Composite	Zirconium-95	2.24E+00	pCi/L	5.52E+00		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Control	M-8	26-Sep-13	Composite	Actinium-228	8.27E+00	pCi/L	1.39E+01		U
Milk	Control	M-8	26-Sep-13	Composite	Antimony-124	-1.01E+00	pCi/L	5.38E+00		U
Milk	Control	M-8	26-Sep-13	Composite	Antimony-125	-1.07E+00	pCi/L	7.13E+00		U
Milk	Control	M-8	26-Sep-13	Composite	Barium-140	4.94E-01	pCi/L	3.14E+00	15	U
Milk	Control	M-8	26-Sep-13	Composite	Beryllium-7	8.06E-01	pCi/L	2.22E+01		U
Milk	Control	M-8	26-Sep-13	Composite	Cerium-141	7.39E-01	pCi/L	4.51E+00		U
Milk	Control	M-8	26-Sep-13	Composite	Cerium-144	-6.10E+00	pCi/L	1.83E+01		U
Milk	Control	M-8	26-Sep-13	Composite	Cesium-134	-2.32E-01	pCi/L	3.21E+00	15	U
Milk	Control	M-8	26-Sep-13	Composite	Cesium-137	-1.14E+00	pCi/L	2.74E+00	18	U
Milk	Control	M-8	26-Sep-13	Composite	Chromium-51	4.09E+00	pCi/L	2.37E+01		U
Milk	Control	M-8	26-Sep-13	Composite	Cobalt-57	7.32E-01	pCi/L	2.44E+00		U
Milk	Control	M-8	26-Sep-13	Composite	Cobalt-58	1.62E+00	pCi/L	2.87E+00		U
Milk	Control	M-8	26-Sep-13	Composite	Cobalt-60	3.07E+00	pCi/L	3.36E+00		U
Milk	Control	M-8	26-Sep-13	Composite	Iodine-131	3.73E-01	pCi/L	6.45E-01	1	U
Milk	Control	M-8	26-Sep-13	Composite	Iron-59	-9.77E-01	pCi/L	5.99E+00		U
Milk	Control	M-8	26-Sep-13	Composite	Lanthanum-140	4.94E-01	pCi/L	3.14E+00	15	U
Milk	Control	M-8	26-Sep-13	Composite	Manganese-54	7.52E-01	pCi/L	2.88E+00		U
Milk	Control	M-8	26-Sep-13	Composite	Niobium-95	5.73E-01	pCi/L	2.70E+00		U
Milk	Control	M-8	26-Sep-13	Composite	Potassium-40	1.39E+03	pCi/L	2.39E+01		U
Milk	Control	M-8	26-Sep-13	Composite	Ruthenium-103	-8.96E-01	pCi/L	2.70E+00		U
Milk	Control	M-8	26-Sep-13	Composite	Ruthenium-106	8.59E+00	pCi/L	2.38E+01		U
Milk	Control	M-8	26-Sep-13	Composite	Selenium-75	-1.18E-01	pCi/L	3.52E+00		U
Milk	Control	M-8	26-Sep-13	Composite	Silver-108m	6.83E-02	pCi/L	2.31E+00		U
Milk	Control	M-8	26-Sep-13	Composite	Silver-110m	8.00E-01	pCi/L	2.69E+00		U
Milk	Control	M-8	26-Sep-13	Composite	Strontium-89	-9.39E-01	pCi/L	2.19E+00	10	U
Milk	Control	M-8	26-Sep-13	Composite	Strontium-90	1.47E+00	pCi/L	1.88E+00	2	U
Milk	Control	M-8	26-Sep-13	Composite	Zinc-65	-2.56E+00	pCi/L	6.82E+00		U
Milk	Control	M-8	26-Sep-13	Composite	Zirconium-95	-1.71E+00	pCi/L	4.77E+00		U
Milk	Indicator	M-2	09-Oct-13	Composite	Actinium-228	6.23E+00	pCi/L	1.33E+01		U
Milk	Indicator	M-2	09-Oct-13	Composite	Antimony-124	-4.31E-01	pCi/L	5.68E+00		U
Milk	Indicator	M-2	09-Oct-13	Composite	Antimony-125	8.93E-01	pCi/L	7.40E+00		U
Milk	Indicator	M-2	09-Oct-13	Composite	Barium-140	-1.59E+00	pCi/L	4.01E+00	15	U
Milk	Indicator	M-2	09-Oct-13	Composite	Beryllium-7	1.58E+01	pCi/L	2.33E+01		U
Milk	Indicator	M-2	09-Oct-13	Composite	Cerium-141	1.00E-02	pCi/L	4.45E+00		U
Milk	Indicator	M-2	09-Oct-13	Composite	Cerium-144	-9.31E+00	pCi/L	1.69E+01		U
Milk	Indicator	M-2	09-Oct-13	Composite	Cesium-134	-1.25E+00	pCi/L	3.07E+00	15	U
Milk	Indicator	M-2	09-Oct-13	Composite	Cesium-137	4.83E-02	pCi/L	3.05E+00	18	U
Milk	Indicator	M-2	09-Oct-13	Composite	Chromium-51	-5.51E+00	pCi/L	2.38E+01		U
Milk	Indicator	M-2	09-Oct-13	Composite	Cobalt-57	7.64E-02	pCi/L	2.21E+00		U
Milk	Indicator	M-2	09-Oct-13	Composite	Cobalt-58	-3.53E-01	pCi/L	2.96E+00		U
Milk	Indicator	M-2	09-Oct-13	Composite	Cobalt-60	1.57E+00	pCi/L	3.22E+00		U
Milk	Indicator	M-2	09-Oct-13	Composite	Iodine-131	2.60E-02	pCi/L	6.23E-01	1	U
Milk	Indicator	M-2	09-Oct-13	Composite	Iron-59	1.12E+00	pCi/L	6.25E+00		U
Milk	Indicator	M-2	09-Oct-13	Composite	Lanthanum-140	-1.59E+00	pCi/L	4.01E+00	15	U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Indicator	M-2	09-Oct-13	Composite	Manganese-54	1.26E+00	pCi/L	2.67E+00		U
Milk	Indicator	M-2	09-Oct-13	Composite	Niobium-95	1.72E+00	pCi/L	2.89E+00		U
Milk	Indicator	M-2	09-Oct-13	Composite	Potassium-40	1.49E+03	pCi/L	2.45E+01		
Milk	Indicator	M-2	09-Oct-13	Composite	Ruthenium-103	-1.64E-01	pCi/L	2.77E+00		U
Milk	Indicator	M-2	09-Oct-13	Composite	Ruthenium-106	2.59E+00	pCi/L	2.39E+01		U
Milk	Indicator	M-2	09-Oct-13	Composite	Selenium-75	2.12E-01	pCi/L	3.42E+00		U
Milk	Indicator	M-2	09-Oct-13	Composite	Silver-108m	3.67E-01	pCi/L	2.32E+00		U
Milk	Indicator	M-2	09-Oct-13	Composite	Silver-110m	-7.12E-02	pCi/L	2.66E+00		U
Milk	Indicator	M-2	09-Oct-13	Composite	Strontium-89	-9.32E-01	pCi/L	3.40E+00	10	U
Milk	Indicator	M-2	09-Oct-13	Composite	Strontium-90	1.69E-01	pCi/L	1.89E+00	2	U
Milk	Indicator	M-2	09-Oct-13	Composite	Zinc-65	-5.52E+00	pCi/L	6.85E+00		U
Milk	Indicator	M-2	09-Oct-13	Composite	Zirconium-95	-7.24E-01	pCi/L	4.91E+00		U
Milk	Control	M-8	09-Oct-13	Composite	Actinium-228	-7.77E+00	pCi/L	9.08E+00		U
Milk	Control	M-8	09-Oct-13	Composite	Antimony-124	-3.03E-02	pCi/L	3.82E+00		U
Milk	Control	M-8	09-Oct-13	Composite	Antimony-125	2.73E+00	pCi/L	6.13E+00		U
Milk	Control	M-8	09-Oct-13	Composite	Barium-140	4.44E-01	pCi/L	2.82E+00	15	U
Milk	Control	M-8	09-Oct-13	Composite	Beryllium-7	-3.36E+00	pCi/L	1.79E+01		U
Milk	Control	M-8	09-Oct-13	Composite	Cerium-141	1.53E+00	pCi/L	4.03E+00		U
Milk	Control	M-8	09-Oct-13	Composite	Cerium-144	-7.36E+00	pCi/L	1.49E+01		U
Milk	Control	M-8	09-Oct-13	Composite	Cesium-134	1.09E+00	pCi/L	2.28E+00	15	U
Milk	Control	M-8	09-Oct-13	Composite	Cesium-137	7.90E-01	pCi/L	2.24E+00	18	U
Milk	Control	M-8	09-Oct-13	Composite	Chromium-51	4.39E-01	pCi/L	2.03E+01		U
Milk	Control	M-8	09-Oct-13	Composite	Cobalt-57	3.87E-01	pCi/L	2.03E+00		U
Milk	Control	M-8	09-Oct-13	Composite	Cobalt-58	-7.50E-01	pCi/L	2.09E+00		U
Milk	Control	M-8	09-Oct-13	Composite	Cobalt-60	1.04E-01	pCi/L	2.31E+00		U
Milk	Control	M-8	09-Oct-13	Composite	Iodine-131	3.01E-01	pCi/L	9.81E-01	1	U
Milk	Control	M-8	09-Oct-13	Composite	Iron-59	1.52E+00	pCi/L	4.85E+00		U
Milk	Control	M-8	09-Oct-13	Composite	Lanthanum-140	4.44E-01	pCi/L	2.82E+00	15	U
Milk	Control	M-8	09-Oct-13	Composite	Manganese-54	-3.39E-01	pCi/L	2.08E+00		U
Milk	Control	M-8	09-Oct-13	Composite	Niobium-95	-7.97E-02	pCi/L	2.12E+00		U
Milk	Control	M-8	09-Oct-13	Composite	Potassium-40	1.42E+03	pCi/L	2.00E+01		
Milk	Control	M-8	09-Oct-13	Composite	Ruthenium-103	-8.51E-01	pCi/L	2.08E+00		U
Milk	Control	M-8	09-Oct-13	Composite	Ruthenium-106	-9.77E+00	pCi/L	1.83E+01		U
Milk	Control	M-8	09-Oct-13	Composite	Selenium-75	7.73E-02	pCi/L	3.01E+00		U
Milk	Control	M-8	09-Oct-13	Composite	Silver-108m	1.37E+00	pCi/L	2.08E+00		U
Milk	Control	M-8	09-Oct-13	Composite	Silver-110m	-6.93E-02	pCi/L	2.01E+00		U
Milk	Control	M-8	09-Oct-13	Composite	Strontium-89	1.50E+00	pCi/L	2.73E+00	10	U
Milk	Control	M-8	09-Oct-13	Composite	Strontium-90	-3.74E-01	pCi/L	1.81E+00	2	U
Milk	Control	M-8	09-Oct-13	Composite	Zinc-65	-9.88E-01	pCi/L	5.04E+00		U
Milk	Control	M-8	09-Oct-13	Composite	Zirconium-95	1.65E+00	pCi/L	3.73E+00		U
Milk	Indicator	M-2	31-Oct-13	Composite	Actinium-228	-2.99E+00	pCi/L	8.64E+00		U
Milk	Indicator	M-2	31-Oct-13	Composite	Antimony-124	1.12E+00	pCi/L	3.67E+00		U
Milk	Indicator	M-2	31-Oct-13	Composite	Antimony-125	1.47E-01	pCi/L	5.05E+00		U
Milk	Indicator	M-2	31-Oct-13	Composite	Barium-140	7.58E-01	pCi/L	2.85E+00	15	U



Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Indicator	M-2	31-Oct-13	Composite	Beryllium-7	6.68E-01	pCi/L	1.59E+01		U
Milk	Indicator	M-2	31-Oct-13	Composite	Cerium-141	-1.25E+00	pCi/L	3.12E+00		U
Milk	Indicator	M-2	31-Oct-13	Composite	Cerium-144	-1.83E+00	pCi/L	1.22E+01		U
Milk	Indicator	M-2	31-Oct-13	Composite	Cesium-134	-1.09E+00	pCi/L	2.12E+00	15	U
Milk	Indicator	M-2	31-Oct-13	Composite	Cesium-137	1.84E+00	pCi/L	2.02E+00	18	U
Milk	Indicator	M-2	31-Oct-13	Composite	Chromium-51	9.60E+00	pCi/L	1.50E+01		U
Milk	Indicator	M-2	31-Oct-13	Composite	Cobalt-57	5.61E-01	pCi/L	1.61E+00		U
Milk	Indicator	M-2	31-Oct-13	Composite	Cobalt-58	-1.55E+00	pCi/L	1.90E+00		U
Milk	Indicator	M-2	31-Oct-13	Composite	Cobalt-60	-6.86E-01	pCi/L	2.12E+00		U
Milk	Indicator	M-2	31-Oct-13	Composite	Iodine-131	2.54E-01	pCi/L	7.97E-01	1	U
Milk	Indicator	M-2	31-Oct-13	Composite	Iron-59	3.14E+00	pCi/L	4.46E+00		U
Milk	Indicator	M-2	31-Oct-13	Composite	Lanthanum-140	7.58E-01	pCi/L	2.85E+00	15	U
Milk	Indicator	M-2	31-Oct-13	Composite	Manganese-54	-6.46E-01	pCi/L	1.81E+00		U
Milk	Indicator	M-2	31-Oct-13	Composite	Niobium-95	9.25E-01	pCi/L	2.15E+00		U
Milk	Indicator	M-2	31-Oct-13	Composite	Potassium-40	1.43E+03	pCi/L	1.72E+01		
Milk	Indicator	M-2	31-Oct-13	Composite	Ruthenium-103	8.17E-02	pCi/L	1.86E+00		U
Milk	Indicator	M-2	31-Oct-13	Composite	Ruthenium-106	-4.01E+00	pCi/L	1.72E+01		U
Milk	Indicator	M-2	31-Oct-13	Composite	Selenium-75	1.75E-01	pCi/L	2.43E+00		U
Milk	Indicator	M-2	31-Oct-13	Composite	Silver-108m	-3.75E-01	pCi/L	1.60E+00		U
Milk	Indicator	M-2	31-Oct-13	Composite	Silver-110m	7.46E-01	pCi/L	1.83E+00		U
Milk	Indicator	M-2	31-Oct-13	Composite	Strontium-89	-5.46E-01	pCi/L	4.57E+00	10	U
Milk	Indicator	M-2	31-Oct-13	Composite	Strontium-90	3.62E-01	pCi/L	1.19E+00	2	U
Milk	Indicator	M-2	31-Oct-13	Composite	Zinc-65	-2.23E+00	pCi/L	4.74E+00		U
Milk	Indicator	M-2	31-Oct-13	Composite	Zirconium-95	5.39E-01	pCi/L	3.32E+00		U
Milk	Control	M-8	31-Oct-13	Composite	Actinium-228	-2.25E+00	pCi/L	8.03E+00		U
Milk	Control	M-8	31-Oct-13	Composite	Antimony-124	8.30E-01	pCi/L	3.63E+00		U
Milk	Control	M-8	31-Oct-13	Composite	Antimony-125	-8.59E-01	pCi/L	4.70E+00		U
Milk	Control	M-8	31-Oct-13	Composite	Barium-140	-2.26E-02	pCi/L	2.25E+00	15	U
Milk	Control	M-8	31-Oct-13	Composite	Beryllium-7	-1.78E+00	pCi/L	1.51E+01		U
Milk	Control	M-8	31-Oct-13	Composite	Cerium-141	8.77E-01	pCi/L	3.11E+00		U
Milk	Control	M-8	31-Oct-13	Composite	Cerium-144	-2.91E+00	pCi/L	1.20E+01		U
Milk	Control	M-8	31-Oct-13	Composite	Cesium-134	1.35E+00	pCi/L	1.99E+00	15	U
Milk	Control	M-8	31-Oct-13	Composite	Cesium-137	2.81E-01	pCi/L	1.93E+00	18	U
Milk	Control	M-8	31-Oct-13	Composite	Chromium-51	-2.43E+00	pCi/L	1.63E+01		U
Milk	Control	M-8	31-Oct-13	Composite	Cobalt-57	-6.63E-01	pCi/L	1.52E+00		U
Milk	Control	M-8	31-Oct-13	Composite	Cobalt-58	-4.43E-01	pCi/L	1.77E+00		U
Milk	Control	M-8	31-Oct-13	Composite	Cobalt-60	3.64E-02	pCi/L	2.07E+00		U
Milk	Control	M-8	31-Oct-13	Composite	Iodine-131	-4.94E-02	pCi/L	5.92E-01	1	U
Milk	Control	M-8	31-Oct-13	Composite	Iron-59	-1.72E+00	pCi/L	3.74E+00		U
Milk	Control	M-8	31-Oct-13	Composite	Lanthanum-140	-2.26E-02	pCi/L	2.25E+00	15	U
Milk	Control	M-8	31-Oct-13	Composite	Manganese-54	-1.45E-01	pCi/L	1.81E+00		U
Milk	Control	M-8	31-Oct-13	Composite	Niobium-95	3.95E-01	pCi/L	1.78E+00		U
Milk	Control	M-8	31-Oct-13	Composite	Potassium-40	1.36E+03	pCi/L	1.60E+01		
Milk	Control	M-8	31-Oct-13	Composite	Ruthenium-103	-1.08E-01	pCi/L	1.77E+00		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Control	M-8	31-Oct-13	Composite	Ruthenium-106	6.26E+00	pCi/L	1.67E+01		U
Milk	Control	M-8	31-Oct-13	Composite	Selenium-75	-9.80E-01	pCi/L	2.43E+00		U
Milk	Control	M-8	31-Oct-13	Composite	Silver-108m	1.20E-01	pCi/L	1.64E+00		U
Milk	Control	M-8	31-Oct-13	Composite	Silver-110m	-2.61E-01	pCi/L	1.67E+00		U
Milk	Control	M-8	31-Oct-13	Composite	Strontium-89	-7.06E-01	pCi/L	3.51E+00	10	U
Milk	Control	M-8	31-Oct-13	Composite	Strontium-90	3.33E-01	pCi/L	6.36E-01	2	U
Milk	Control	M-8	31-Oct-13	Composite	Zinc-65	2.38E+00	pCi/L	4.49E+00		U
Milk	Control	M-8	31-Oct-13	Composite	Zirconium-95	-1.26E+00	pCi/L	3.12E+00		U
Milk	Indicator	M-2	15-Nov-13	Composite	Actinium-228	5.17E+00	pCi/L	2.37E+01		U
Milk	Indicator	M-2	15-Nov-13	Composite	Antimony-124	4.39E-01	pCi/L	1.01E+01		U
Milk	Indicator	M-2	15-Nov-13	Composite	Antimony-125	-1.55E+00	pCi/L	1.34E+01		U
Milk	Indicator	M-2	15-Nov-13	Composite	Barium-140	-4.40E-02	pCi/L	5.51E+00	15	U
Milk	Indicator	M-2	15-Nov-13	Composite	Beryllium-7	3.00E+00	pCi/L	3.64E+01		U
Milk	Indicator	M-2	15-Nov-13	Composite	Cerium-141	1.10E+00	pCi/L	8.17E+00		U
Milk	Indicator	M-2	15-Nov-13	Composite	Cerium-144	-9.16E+00	pCi/L	2.95E+01		U
Milk	Indicator	M-2	15-Nov-13	Composite	Cesium-134	9.83E-01	pCi/L	4.92E+00	15	U
Milk	Indicator	M-2	15-Nov-13	Composite	Cesium-137	7.49E-01	pCi/L	4.64E+00	18	U
Milk	Indicator	M-2	15-Nov-13	Composite	Chromium-51	-8.20E-01	pCi/L	4.19E+01		U
Milk	Indicator	M-2	15-Nov-13	Composite	Cobalt-57	2.04E+00	pCi/L	4.02E+00		U
Milk	Indicator	M-2	15-Nov-13	Composite	Cobalt-58	-4.57E-01	pCi/L	4.31E+00		U
Milk	Indicator	M-2	15-Nov-13	Composite	Cobalt-60	-7.82E-02	pCi/L	5.20E+00		U
Milk	Indicator	M-2	15-Nov-13	Composite	Iodine-131	1.48E-01	pCi/L	5.52E-01	1	U
Milk	Indicator	M-2	15-Nov-13	Composite	Iron-59	8.76E-01	pCi/L	1.15E+01		U
Milk	Indicator	M-2	15-Nov-13	Composite	Lanthanum-140	-4.40E-02	pCi/L	5.51E+00	15	U
Milk	Indicator	M-2	15-Nov-13	Composite	Manganese-54	-1.04E-01	pCi/L	4.24E+00		U
Milk	Indicator	M-2	15-Nov-13	Composite	Niobium-95	1.84E+00	pCi/L	5.41E+00		U
Milk	Indicator	M-2	15-Nov-13	Composite	Potassium-40	1.31E+03	pCi/L	4.09E+01		
Milk	Indicator	M-2	15-Nov-13	Composite	Ruthenium-103	-6.30E-01	pCi/L	4.61E+00		U
Milk	Indicator	M-2	15-Nov-13	Composite	Ruthenium-106	-1.28E+01	pCi/L	3.60E+01		U
Milk	Indicator	M-2	15-Nov-13	Composite	Selenium-75	3.15E+00	pCi/L	6.71E+00		U
Milk	Indicator	M-2	15-Nov-13	Composite	Silver-108m	7.87E-01	pCi/L	4.19E+00		U
Milk	Indicator	M-2	15-Nov-13	Composite	Silver-110m	-1.70E+00	pCi/L	4.31E+00		U
Milk	Indicator	M-2	15-Nov-13	Composite	Strontium-89	5.58E-01	pCi/L	3.04E+00	10	U
Milk	Indicator	M-2	15-Nov-13	Composite	Strontium-90	-1.40E+00	pCi/L	1.77E+00	2	U
Milk	Indicator	M-2	15-Nov-13	Composite	Zinc-65	4.96E+00	pCi/L	1.37E+01		U
Milk	Indicator	M-2	15-Nov-13	Composite	Zirconium-95	-1.17E+00	pCi/L	7.77E+00		U
Milk	Control	M-8	15-Nov-13	Composite	Actinium-228	1.33E-01	pCi/L	3.24E+01		U
Milk	Control	M-8	15-Nov-13	Composite	Antimony-124	-1.21E+01	pCi/L	9.62E+00		U
Milk	Control	M-8	15-Nov-13	Composite	Antimony-125	-8.10E+00	pCi/L	1.57E+01		U
Milk	Control	M-8	15-Nov-13	Composite	Barium-140	-3.44E+00	pCi/L	8.80E+00	15	U
Milk	Control	M-8	15-Nov-13	Composite	Beryllium-7	1.45E+01	pCi/L	6.17E+01		U
Milk	Control	M-8	15-Nov-13	Composite	Cerium-141	3.05E+00	pCi/L	1.05E+01		U
Milk	Control	M-8	15-Nov-13	Composite	Cerium-144	5.17E+00	pCi/L	3.95E+01		U
Milk	Control	M-8	15-Nov-13	Composite	Cesium-134	-6.10E-01	pCi/L	6.08E+00	15	U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Control	M-8	15-Nov-13	Composite	Cesium-137	3.90E+00	pCi/L	6.96E+00	18	U
Milk	Control	M-8	15-Nov-13	Composite	Chromium-51	1.22E+00	pCi/L	6.29E+01		U
Milk	Control	M-8	15-Nov-13	Composite	Cobalt-57	-1.41E+00	pCi/L	5.02E+00		U
Milk	Control	M-8	15-Nov-13	Composite	Cobalt-58	2.52E+00	pCi/L	8.06E+00		U
Milk	Control	M-8	15-Nov-13	Composite	Cobalt-60	-2.39E+00	pCi/L	9.50E+00		U
Milk	Control	M-8	15-Nov-13	Composite	Iodine-131	5.62E-02	pCi/L	7.44E-01	1	U
Milk	Control	M-8	15-Nov-13	Composite	Iron-59	6.53E+00	pCi/L	1.73E+01		U
Milk	Control	M-8	15-Nov-13	Composite	Lanthanum-140	-3.44E+00	pCi/L	8.80E+00	15	U
Milk	Control	M-8	15-Nov-13	Composite	Manganese-54	2.61E-01	pCi/L	7.00E+00		U
Milk	Control	M-8	15-Nov-13	Composite	Niobium-95	2.44E+00	pCi/L	7.28E+00		U
Milk	Control	M-8	15-Nov-13	Composite	Potassium-40	1.44E+03	pCi/L	4.57E+01		
Milk	Control	M-8	15-Nov-13	Composite	Ruthenium-103	1.33E+00	pCi/L	7.32E+00		U
Milk	Control	M-8	15-Nov-13	Composite	Ruthenium-106	4.85E+00	pCi/L	5.97E+01		U
Milk	Control	M-8	15-Nov-13	Composite	Selenium-75	-3.28E-01	pCi/L	7.97E+00		U
Milk	Control	M-8	15-Nov-13	Composite	Silver-108m	1.45E+00	pCi/L	6.04E+00		U
Milk	Control	M-8	15-Nov-13	Composite	Silver-110m	-4.21E+00	pCi/L	7.45E+00		U
Milk	Control	M-8	15-Nov-13	Composite	Strontium-89	4.50E-01	pCi/L	2.75E+00	10	U
Milk	Control	M-8	15-Nov-13	Composite	Strontium-90	-4.62E-02	pCi/L	1.75E+00	2	U
Milk	Control	M-8	15-Nov-13	Composite	Zinc-65	-1.19E+00	pCi/L	1.64E+01		U
Milk	Control	M-8	15-Nov-13	Composite	Zirconium-95	4.38E+00	pCi/L	1.28E+01		U
Milk	Indicator	M-2	12-Dec-13	Composite	Actinium-228	-1.68E+00	pCi/L	1.78E+01		U
Milk	Indicator	M-2	12-Dec-13	Composite	Antimony-124	-6.69E-01	pCi/L	7.34E+00		U
Milk	Indicator	M-2	12-Dec-13	Composite	Antimony-125	-5.14E-01	pCi/L	9.29E+00		U
Milk	Indicator	M-2	12-Dec-13	Composite	Barium-140	1.49E+00	pCi/L	4.44E+00	15	U
Milk	Indicator	M-2	12-Dec-13	Composite	Beryllium-7	-2.20E+00	pCi/L	2.83E+01		U
Milk	Indicator	M-2	12-Dec-13	Composite	Cerium-141	1.75E+00	pCi/L	5.88E+00		U
Milk	Indicator	M-2	12-Dec-13	Composite	Cerium-144	8.19E-01	pCi/L	2.48E+01		U
Milk	Indicator	M-2	12-Dec-13	Composite	Cesium-134	-3.82E-01	pCi/L	4.15E+00	15	U
Milk	Indicator	M-2	12-Dec-13	Composite	Cesium-137	-1.77E+00	pCi/L	4.06E+00	18	U
Milk	Indicator	M-2	12-Dec-13	Composite	Chromium-51	-2.75E+00	pCi/L	3.17E+01		U
Milk	Indicator	M-2	12-Dec-13	Composite	Cobalt-57	-6.50E-01	pCi/L	3.23E+00		U
Milk	Indicator	M-2	12-Dec-13	Composite	Cobalt-58	1.71E+00	pCi/L	4.25E+00		U
Milk	Indicator	M-2	12-Dec-13	Composite	Cobalt-60	-6.18E-01	pCi/L	3.67E+00		U
Milk	Indicator	M-2	12-Dec-13	Composite	Iodine-131	1.01E-01	pCi/L	7.16E-01	1	U
Milk	Indicator	M-2	12-Dec-13	Composite	Iron-59	3.33E+00	pCi/L	9.00E+00		U
Milk	Indicator	M-2	12-Dec-13	Composite	Lanthanum-140	1.49E+00	pCi/L	4.44E+00	15	U
Milk	Indicator	M-2	12-Dec-13	Composite	Manganese-54	-1.05E+00	pCi/L	3.55E+00		U
Milk	Indicator	M-2	12-Dec-13	Composite	Niobium-95	1.74E+00	pCi/L	4.05E+00		U
Milk	Indicator	M-2	12-Dec-13	Composite	Potassium-40	1.44E+03	pCi/L	3.50E+01		
Milk	Indicator	M-2	12-Dec-13	Composite	Ruthenium-103	-9.40E-01	pCi/L	3.59E+00		U
Milk	Indicator	M-2	12-Dec-13	Composite	Ruthenium-106	-1.45E+01	pCi/L	3.07E+01		U
Milk	Indicator	M-2	12-Dec-13	Composite	Selenium-75	-2.81E+00	pCi/L	4.65E+00		U
Milk	Indicator	M-2	12-Dec-13	Composite	Silver-108m	1.11E+00	pCi/L	3.53E+00		U
Milk	Indicator	M-2	12-Dec-13	Composite	Silver-110m	8.98E-01	pCi/L	3.92E+00		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Milk	Indicator	M-2	12-Dec-13	Composite	Strontium-89	2.17E+00	pCi/L	3.17E+00	10	U
Milk	Indicator	M-2	12-Dec-13	Composite	Strontium-90	-1.09E-02	pCi/L	1.81E+00	2	U
Milk	Indicator	M-2	12-Dec-13	Composite	Zinc-65	-1.88E+00	pCi/L	8.63E+00		U
Milk	Indicator	M-2	12-Dec-13	Composite	Zirconium-95	-5.19E-01	pCi/L	6.25E+00		U
Milk	Control	M-8	12-Dec-13	Composite	Actinium-228	-1.03E-01	pCi/L	2.03E+01		U
Milk	Control	M-8	12-Dec-13	Composite	Antimony-124	-2.61E+00	pCi/L	8.58E+00		U
Milk	Control	M-8	12-Dec-13	Composite	Antimony-125	-4.72E+00	pCi/L	1.01E+01		U
Milk	Control	M-8	12-Dec-13	Composite	Barium-140	1.42E+00	pCi/L	5.43E+00	15	U
Milk	Control	M-8	12-Dec-13	Composite	Beryllium-7	-6.01E+00	pCi/L	3.28E+01		U
Milk	Control	M-8	12-Dec-13	Composite	Cerium-141	2.22E-01	pCi/L	7.03E+00		U
Milk	Control	M-8	12-Dec-13	Composite	Cerium-144	1.40E+00	pCi/L	2.71E+01		U
Milk	Control	M-8	12-Dec-13	Composite	Cesium-134	-1.40E-02	pCi/L	4.48E+00	15	U
Milk	Control	M-8	12-Dec-13	Composite	Cesium-137	-4.84E-01	pCi/L	4.20E+00	18	U
Milk	Control	M-8	12-Dec-13	Composite	Chromium-51	1.63E+00	pCi/L	3.72E+01		U
Milk	Control	M-8	12-Dec-13	Composite	Cobalt-57	-3.23E-01	pCi/L	3.55E+00		U
Milk	Control	M-8	12-Dec-13	Composite	Cobalt-58	-1.22E+00	pCi/L	3.80E+00		U
Milk	Control	M-8	12-Dec-13	Composite	Cobalt-60	9.46E-01	pCi/L	4.80E+00		U
Milk	Control	M-8	12-Dec-13	Composite	Iodine-131	-1.27E-01	pCi/L	6.30E-01	1	U
Milk	Control	M-8	12-Dec-13	Composite	Iron-59	5.23E+00	pCi/L	1.00E+01		U
Milk	Control	M-8	12-Dec-13	Composite	Lanthanum-140	1.42E+00	pCi/L	5.43E+00	15	U
Milk	Control	M-8	12-Dec-13	Composite	Manganese-54	6.28E-01	pCi/L	4.40E+00		U
Milk	Control	M-8	12-Dec-13	Composite	Niobium-95	1.42E+00	pCi/L	4.42E+00		U
Milk	Control	M-8	12-Dec-13	Composite	Potassium-40	1.38E+03	pCi/L	3.87E+01		
Milk	Control	M-8	12-Dec-13	Composite	Ruthenium-103	6.30E-01	pCi/L	3.94E+00		U
Milk	Control	M-8	12-Dec-13	Composite	Ruthenium-106	-1.70E+01	pCi/L	3.45E+01		U
Milk	Control	M-8	12-Dec-13	Composite	Selenium-75	1.45E+00	pCi/L	5.70E+00		U
Milk	Control	M-8	12-Dec-13	Composite	Silver-108m	1.91E+00	pCi/L	4.07E+00		U
Milk	Control	M-8	12-Dec-13	Composite	Silver-110m	2.68E-01	pCi/L	3.74E+00		U
Milk	Control	M-8	12-Dec-13	Composite	Strontium-89	-2.28E+00	pCi/L	3.67E+00	10	U
Milk	Control	M-8	12-Dec-13	Composite	Strontium-90	1.46E+00	pCi/L	1.76E+00	2	U
Milk	Control	M-8	12-Dec-13	Composite	Zinc-65	-5.30E+00	pCi/L	9.23E+00		U
Milk	Control	M-8	12-Dec-13	Composite	Zirconium-95	-1.11E+00	pCi/L	6.87E+00		U
Sediment	Control	S-5	16-May-13	Grab	Actinium-228	2.29E+02	pCi/kg	1.30E+02		
Sediment	Control	S-5	16-May-13	Grab	Antimony-124	2.58E+01	pCi/kg	9.63E+01		U
Sediment	Control	S-5	16-May-13	Grab	Antimony-125	2.01E+00	pCi/kg	7.61E+01		U
Sediment	Control	S-5	16-May-13	Grab	Barium-140	-4.94E+01	pCi/kg	9.48E+02		U
Sediment	Control	S-5	16-May-13	Grab	Beryllium-7	2.78E+02	pCi/kg	4.61E+02		U
Sediment	Control	S-5	16-May-13	Grab	Bismuth-214	1.95E+02	pCi/kg	6.81E+01		
Sediment	Control	S-5	16-May-13	Grab	Cerium-141	4.50E+01	pCi/kg	8.67E+01		U
Sediment	Control	S-5	16-May-13	Grab	Cerium-144	4.05E+01	pCi/kg	1.56E+02		U
Sediment	Control	S-5	16-May-13	Grab	Cesium-134	6.51E+00	pCi/kg	4.36E+01	150	U
Sediment	Control	S-5	16-May-13	Grab	Cesium-137	3.14E+01	pCi/kg	3.92E+01	180	U
Sediment	Control	S-5	16-May-13	Grab	Chromium-51	-8.35E+01	pCi/kg	5.40E+02		U
Sediment	Control	S-5	16-May-13	Grab	Cobalt-57	1.10E+01	pCi/kg	1.84E+01		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Sediment	Control	S-5	16-May-13	Grab	Cobalt-58	-9.50E+00	pCi/kg	4.34E+01		U
Sediment	Control	S-5	16-May-13	Grab	Cobalt-60	-5.16E+00	pCi/kg	3.20E+01		U
Sediment	Control	S-5	16-May-13	Grab	Iodine-131	-8.00E+01	pCi/kg	1.01E+03		U
Sediment	Control	S-5	16-May-13	Grab	Iron-59	-1.46E+01	pCi/kg	1.10E+02		U
Sediment	Control	S-5	16-May-13	Grab	Lanthanum-140	-2.71E+01	pCi/kg	3.26E+02		U
Sediment	Control	S-5	16-May-13	Grab	Lead-212	2.37E+02	pCi/kg	4.65E+01		
Sediment	Control	S-5	16-May-13	Grab	Lead-214	2.48E+02	pCi/kg	5.86E+01		
Sediment	Control	S-5	16-May-13	Grab	Manganese-54	-1.36E+01	pCi/kg	2.86E+01		U
Sediment	Control	S-5	16-May-13	Grab	Niobium-95	1.25E+00	pCi/kg	4.92E+01		U
Sediment	Control	S-5	16-May-13	Grab	Potassium-40	5.74E+03	pCi/kg	3.36E+02		
Sediment	Control	S-5	16-May-13	Grab	Radium-226	1.95E+02	pCi/kg	6.81E+01		
Sediment	Control	S-5	16-May-13	Grab	Ruthenium-103	1.41E+01	pCi/kg	5.17E+01		U
Sediment	Control	S-5	16-May-13	Grab	Ruthenium-106	-1.68E+02	pCi/kg	2.37E+02		U
Sediment	Control	S-5	16-May-13	Grab	Selenium-75	4.15E+00	pCi/kg	4.02E+01		U
Sediment	Control	S-5	16-May-13	Grab	Silver-108m	-7.63E-01	pCi/kg	2.33E+01		U
Sediment	Control	S-5	16-May-13	Grab	Silver-110m	-1.23E+01	pCi/kg	4.66E+01		U
Sediment	Control	S-5	16-May-13	Grab	Strontium-89	6.48E+01	pCi/kg	2.34E+02	300	U
Sediment	Control	S-5	16-May-13	Grab	Strontium-90	2.82E+00	pCi/kg	2.47E+02	300	U
Sediment	Control	S-5	16-May-13	Grab	Thallium-208	9.60E+01	pCi/kg	3.36E+01		
Sediment	Control	S-5	16-May-13	Grab	Thorium-228	2.37E+02	pCi/kg	4.65E+01		
Sediment	Control	S-5	16-May-13	Grab	Thorium-230	1.95E+02	pCi/kg	6.81E+01		
Sediment	Control	S-5	16-May-13	Grab	Zinc-65	-1.15E+01	pCi/kg	7.57E+01		U
Sediment	Control	S-5	16-May-13	Grab	Zirconium-95	3.99E+00	pCi/kg	8.57E+01		U
Sediment	Indicator	S-1	20-May-13	Grab	Actinium-228	5.84E+02	pCi/kg	1.57E+02		
Sediment	Indicator	S-1	20-May-13	Grab	Antimony-124	1.16E+00	pCi/kg	1.24E+02		U
Sediment	Indicator	S-1	20-May-13	Grab	Antimony-125	-1.95E+01	pCi/kg	1.11E+02		U
Sediment	Indicator	S-1	20-May-13	Grab	Barium-140	1.42E+02	pCi/kg	1.13E+03		U
Sediment	Indicator	S-1	20-May-13	Grab	Beryllium-7	4.20E+01	pCi/kg	5.26E+02		U
Sediment	Indicator	S-1	20-May-13	Grab	Bismuth-214	2.58E+02	pCi/kg	8.75E+01		
Sediment	Indicator	S-1	20-May-13	Grab	Cerium-141	-4.76E+00	pCi/kg	1.13E+02		U
Sediment	Indicator	S-1	20-May-13	Grab	Cerium-144	-9.75E+01	pCi/kg	2.07E+02		U
Sediment	Indicator	S-1	20-May-13	Grab	Cesium-134	4.70E+01	pCi/kg	5.10E+01	150	U
Sediment	Indicator	S-1	20-May-13	Grab	Cesium-137	3.82E+01	pCi/kg	4.98E+01	180	U
Sediment	Indicator	S-1	20-May-13	Grab	Chromium-51	-9.77E+01	pCi/kg	7.66E+02		U
Sediment	Indicator	S-1	20-May-13	Grab	Cobalt-57	1.30E+01	pCi/kg	2.77E+01		U
Sediment	Indicator	S-1	20-May-13	Grab	Cobalt-58	-9.67E+00	pCi/kg	5.51E+01		U
Sediment	Indicator	S-1	20-May-13	Grab	Cobalt-60	1.50E+01	pCi/kg	4.67E+01		U
Sediment	Indicator	S-1	20-May-13	Grab	Iodine-131	4.39E+02	pCi/kg	1.02E+03		U
Sediment	Indicator	S-1	20-May-13	Grab	Iron-59	-1.96E+01	pCi/kg	1.53E+02		U
Sediment	Indicator	S-1	20-May-13	Grab	Lanthanum-140	-1.78E+02	pCi/kg	3.05E+02		U
Sediment	Indicator	S-1	20-May-13	Grab	Lead-212	5.90E+02	pCi/kg	6.41E+01		
Sediment	Indicator	S-1	20-May-13	Grab	Lead-214	4.24E+02	pCi/kg	8.48E+01		
Sediment	Indicator	S-1	20-May-13	Grab	Manganese-54	8.30E+00	pCi/kg	4.90E+01		U
Sediment	Indicator	S-1	20-May-13	Grab	Niobium-95	4.98E+01	pCi/kg	6.69E+01		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Sediment	Indicator	S-1	20-May-13	Grab	Potassium-40	7.70E+03	pCi/kg	3.89E+02		
Sediment	Indicator	S-1	20-May-13	Grab	Radium-226	2.58E+02	pCi/kg	8.75E+01		
Sediment	Indicator	S-1	20-May-13	Grab	Ruthenium-103	-7.25E+00	pCi/kg	6.82E+01		U
Sediment	Indicator	S-1	20-May-13	Grab	Ruthenium-106	6.32E+01	pCi/kg	4.04E+02		U
Sediment	Indicator	S-1	20-May-13	Grab	Selenium-75	2.44E+01	pCi/kg	5.76E+01		U
Sediment	Indicator	S-1	20-May-13	Grab	Silver-108m	-1.91E+00	pCi/kg	3.55E+01		U
Sediment	Indicator	S-1	20-May-13	Grab	Silver-110m	5.74E+01	pCi/kg	6.88E+01		U
Sediment	Indicator	S-1	20-May-13	Grab	Strontium-89	4.64E+01	pCi/kg	2.69E+02	300	U
Sediment	Indicator	S-1	20-May-13	Grab	Strontium-90	5.06E+00	pCi/kg	2.42E+02	300	U
Sediment	Indicator	S-1	20-May-13	Grab	Thallium-208	1.37E+02	pCi/kg	4.15E+01		
Sediment	Indicator	S-1	20-May-13	Grab	Thorium-228	5.90E+02	pCi/kg	6.41E+01		
Sediment	Indicator	S-1	20-May-13	Grab	Thorium-230	2.58E+02	pCi/kg	8.75E+01		
Sediment	Indicator	S-1	20-May-13	Grab	Zinc-65	1.41E+01	pCi/kg	1.07E+02		U
Sediment	Indicator	S-1	20-May-13	Grab	Zirconium-95	1.36E+01	pCi/kg	1.09E+02		U
Sediment	Indicator	S-2	20-May-13	Grab	Actinium-228	8.19E+02	pCi/kg	1.79E+02		
Sediment	Indicator	S-2	20-May-13	Grab	Antimony-124	-2.17E+01	pCi/kg	1.24E+02		U
Sediment	Indicator	S-2	20-May-13	Grab	Antimony-125	4.35E+01	pCi/kg	1.15E+02		U
Sediment	Indicator	S-2	20-May-13	Grab	Barium-140	-1.77E+02	pCi/kg	1.15E+03		U
Sediment	Indicator	S-2	20-May-13	Grab	Beryllium-7	-1.38E+02	pCi/kg	4.80E+02		U
Sediment	Indicator	S-2	20-May-13	Grab	Bismuth-214	5.66E+02	pCi/kg	8.33E+01		
Sediment	Indicator	S-2	20-May-13	Grab	Cerium-141	-4.32E+00	pCi/kg	1.27E+02		U
Sediment	Indicator	S-2	20-May-13	Grab	Cerium-144	2.65E+01	pCi/kg	2.39E+02		U
Sediment	Indicator	S-2	20-May-13	Grab	Cesium-134	6.62E+01	pCi/kg	6.62E+01	150	UI
Sediment	Indicator	S-2	20-May-13	Grab	Cesium-137	-7.07E+00	pCi/kg	4.39E+01	180	U
Sediment	Indicator	S-2	20-May-13	Grab	Chromium-51	5.41E+01	pCi/kg	8.24E+02		U
Sediment	Indicator	S-2	20-May-13	Grab	Cobalt-57	-4.34E+00	pCi/kg	3.23E+01		U
Sediment	Indicator	S-2	20-May-13	Grab	Cobalt-58	1.97E+01	pCi/kg	6.51E+01		U
Sediment	Indicator	S-2	20-May-13	Grab	Cobalt-60	4.95E+00	pCi/kg	4.59E+01		U
Sediment	Indicator	S-2	20-May-13	Grab	Iodine-131	-3.97E+02	pCi/kg	9.59E+02		U
Sediment	Indicator	S-2	20-May-13	Grab	Iron-59	6.48E+01	pCi/kg	1.91E+02		U
Sediment	Indicator	S-2	20-May-13	Grab	Lanthanum-140	2.07E+02	pCi/kg	4.17E+02		U
Sediment	Indicator	S-2	20-May-13	Grab	Lead-212	1.02E+03	pCi/kg	7.30E+01		
Sediment	Indicator	S-2	20-May-13	Grab	Lead-214	8.31E+02	pCi/kg	8.09E+01		
Sediment	Indicator	S-2	20-May-13	Grab	Manganese-54	2.98E+01	pCi/kg	4.87E+01		U
Sediment	Indicator	S-2	20-May-13	Grab	Niobium-95	9.83E+00	pCi/kg	7.70E+01		U
Sediment	Indicator	S-2	20-May-13	Grab	Potassium-40	1.83E+04	pCi/kg	4.68E+02		
Sediment	Indicator	S-2	20-May-13	Grab	Radium-226	5.66E+02	pCi/kg	8.33E+01		
Sediment	Indicator	S-2	20-May-13	Grab	Ruthenium-103	4.17E+00	pCi/kg	7.29E+01		U
Sediment	Indicator	S-2	20-May-13	Grab	Ruthenium-106	-1.92E+02	pCi/kg	3.49E+02		U
Sediment	Indicator	S-2	20-May-13	Grab	Selenium-75	-2.05E+00	pCi/kg	5.94E+01		U
Sediment	Indicator	S-2	20-May-13	Grab	Silver-108m	2.05E+00	pCi/kg	3.54E+01		U
Sediment	Indicator	S-2	20-May-13	Grab	Silver-110m	-1.28E+01	pCi/kg	6.52E+01		U
Sediment	Indicator	S-2	20-May-13	Grab	Strontium-89	-3.97E+02	pCi/kg	2.47E+02	300	U
Sediment	Indicator	S-2	20-May-13	Grab	Strontium-90	-1.44E+02	pCi/kg	2.45E+02	300	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Sediment	Indicator	S-2	20-May-13	Grab	Thallium-208	3.29E+02	pCi/kg	4.08E+01		
Sediment	Indicator	S-2	20-May-13	Grab	Thorium-228	1.02E+03	pCi/kg	7.30E+01		
Sediment	Indicator	S-2	20-May-13	Grab	Thorium-230	5.66E+02	pCi/kg	8.33E+01		
Sediment	Indicator	S-2	20-May-13	Grab	Zinc-65	1.07E+01	pCi/kg	1.24E+02		U
Sediment	Indicator	S-2	20-May-13	Grab	Zirconium-95	4.00E+01	pCi/kg	1.23E+02		U
Sediment	Indicator	S-3	20-May-13	Grab	Actinium-228	2.32E+02	pCi/kg	1.15E+02		
Sediment	Indicator	S-3	20-May-13	Grab	Antimony-124	-9.76E+00	pCi/kg	8.25E+01		U
Sediment	Indicator	S-3	20-May-13	Grab	Antimony-125	-3.62E+01	pCi/kg	6.61E+01		U
Sediment	Indicator	S-3	20-May-13	Grab	Barium-140	-2.69E+02	pCi/kg	8.17E+02		U
Sediment	Indicator	S-3	20-May-13	Grab	Beryllium-7	-2.41E+01	pCi/kg	3.68E+02		U
Sediment	Indicator	S-3	20-May-13	Grab	Bismuth-214	1.16E+02	pCi/kg	1.16E+02		UI
Sediment	Indicator	S-3	20-May-13	Grab	Cerium-141	-1.20E+01	pCi/kg	6.00E+01		U
Sediment	Indicator	S-3	20-May-13	Grab	Cerium-144	-6.39E+00	pCi/kg	1.21E+02		U
Sediment	Indicator	S-3	20-May-13	Grab	Cesium-134	-1.29E+00	pCi/kg	4.09E+01	150	U
Sediment	Indicator	S-3	20-May-13	Grab	Cesium-137	1.62E+01	pCi/kg	4.08E+01	180	U
Sediment	Indicator	S-3	20-May-13	Grab	Chromium-51	9.02E+01	pCi/kg	5.14E+02		U
Sediment	Indicator	S-3	20-May-13	Grab	Cobalt-57	4.77E+00	pCi/kg	1.55E+01		U
Sediment	Indicator	S-3	20-May-13	Grab	Cobalt-58	-1.08E+01	pCi/kg	4.83E+01		U
Sediment	Indicator	S-3	20-May-13	Grab	Cobalt-60	1.11E-01	pCi/kg	4.54E+01		U
Sediment	Indicator	S-3	20-May-13	Grab	Iodine-131	-1.44E+01	pCi/kg	5.93E+02		U
Sediment	Indicator	S-3	20-May-13	Grab	Iron-59	-3.60E+01	pCi/kg	1.35E+02		U
Sediment	Indicator	S-3	20-May-13	Grab	Lanthanum-140	-6.39E+01	pCi/kg	2.23E+02		U
Sediment	Indicator	S-3	20-May-13	Grab	Lead-212	1.62E+02	pCi/kg	4.12E+01		
Sediment	Indicator	S-3	20-May-13	Grab	Lead-214	1.91E+02	pCi/kg	5.47E+01		
Sediment	Indicator	S-3	20-May-13	Grab	Manganese-54	1.09E+01	pCi/kg	4.02E+01		U
Sediment	Indicator	S-3	20-May-13	Grab	Niobium-95	-4.81E-01	pCi/kg	4.84E+01		U
Sediment	Indicator	S-3	20-May-13	Grab	Potassium-40	9.75E+03	pCi/kg	2.88E+02		
Sediment	Indicator	S-3	20-May-13	Grab	Radium-226	1.16E+02	pCi/kg	1.16E+02		UI
Sediment	Indicator	S-3	20-May-13	Grab	Ruthenium-103	1.01E+01	pCi/kg	5.12E+01		U
Sediment	Indicator	S-3	20-May-13	Grab	Ruthenium-106	-1.49E+02	pCi/kg	2.28E+02		U
Sediment	Indicator	S-3	20-May-13	Grab	Selenium-75	5.01E-01	pCi/kg	3.51E+01		U
Sediment	Indicator	S-3	20-May-13	Grab	Silver-108m	-2.39E+00	pCi/kg	2.43E+01		U
Sediment	Indicator	S-3	20-May-13	Grab	Silver-110m	-9.71E+00	pCi/kg	3.48E+01		U
Sediment	Indicator	S-3	20-May-13	Grab	Strontium-89	-3.12E+02	pCi/kg	2.51E+02	300	U
Sediment	Indicator	S-3	20-May-13	Grab	Strontium-90	1.51E+02	pCi/kg	2.42E+02	300	U
Sediment	Indicator	S-3	20-May-13	Grab	Thallium-208	6.54E+01	pCi/kg	2.97E+01		
Sediment	Indicator	S-3	20-May-13	Grab	Thorium-228	1.62E+02	pCi/kg	4.12E+01		
Sediment	Indicator	S-3	20-May-13	Grab	Thorium-230	1.16E+02	pCi/kg	1.16E+02		UI
Sediment	Indicator	S-3	20-May-13	Grab	Zinc-65	-4.06E+01	pCi/kg	1.09E+02		U
Sediment	Indicator	S-3	20-May-13	Grab	Zirconium-95	-1.25E+01	pCi/kg	7.34E+01		U
Sediment	Indicator	S-4	30-May-13	Grab	Actinium-228	4.27E+01	pCi/kg	1.58E+02		U
Sediment	Indicator	S-4	30-May-13	Grab	Antimony-124	1.79E+01	pCi/kg	9.16E+01		U
Sediment	Indicator	S-4	30-May-13	Grab	Antimony-125	-5.82E+00	pCi/kg	6.63E+01		U
Sediment	Indicator	S-4	30-May-13	Grab	Barium-140	-2.57E+00	pCi/kg	4.71E+02		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Sediment	Indicator	S-4	30-May-13	Grab	Beryllium-7	4.08E+01	pCi/kg	3.21E+02		U
Sediment	Indicator	S-4	30-May-13	Grab	Bismuth-214	1.00E+02	pCi/kg	1.00E+02		UI
Sediment	Indicator	S-4	30-May-13	Grab	Cerium-141	7.73E+00	pCi/kg	5.58E+01		U
Sediment	Indicator	S-4	30-May-13	Grab	Cerium-144	-3.55E+01	pCi/kg	1.43E+02		U
Sediment	Indicator	S-4	30-May-13	Grab	Cesium-134	-5.31E+00	pCi/kg	2.96E+01	150	U
Sediment	Indicator	S-4	30-May-13	Grab	Cesium-137	2.51E-01	pCi/kg	2.90E+01	180	U
Sediment	Indicator	S-4	30-May-13	Grab	Chromium-51	4.00E+02	pCi/kg	4.00E+02		UI
Sediment	Indicator	S-4	30-May-13	Grab	Cobalt-57	-4.24E+00	pCi/kg	1.88E+01		U
Sediment	Indicator	S-4	30-May-13	Grab	Cobalt-58	1.58E+01	pCi/kg	3.62E+01		U
Sediment	Indicator	S-4	30-May-13	Grab	Cobalt-60	1.48E+00	pCi/kg	3.20E+01		U
Sediment	Indicator	S-4	30-May-13	Grab	Iodine-131	6.97E+01	pCi/kg	2.97E+02		U
Sediment	Indicator	S-4	30-May-13	Grab	Iron-59	2.40E+01	pCi/kg	1.08E+02		U
Sediment	Indicator	S-4	30-May-13	Grab	Lanthanum-140	3.23E+01	pCi/kg	1.67E+02		U
Sediment	Indicator	S-4	30-May-13	Grab	Lead-212	2.32E+02	pCi/kg	4.20E+01		
Sediment	Indicator	S-4	30-May-13	Grab	Lead-214	2.49E+02	pCi/kg	5.90E+01		
Sediment	Indicator	S-4	30-May-13	Grab	Manganese-54	-6.15E+00	pCi/kg	3.37E+01		U
Sediment	Indicator	S-4	30-May-13	Grab	Niobium-95	-1.23E+01	pCi/kg	3.69E+01		U
Sediment	Indicator	S-4	30-May-13	Grab	Potassium-40	9.48E+03	pCi/kg	3.43E+02		
Sediment	Indicator	S-4	30-May-13	Grab	Radium-226	1.00E+02	pCi/kg	1.00E+02		UI
Sediment	Indicator	S-4	30-May-13	Grab	Ruthenium-103	1.88E+01	pCi/kg	4.53E+01		U
Sediment	Indicator	S-4	30-May-13	Grab	Ruthenium-106	4.89E+01	pCi/kg	2.78E+02		U
Sediment	Indicator	S-4	30-May-13	Grab	Selenium-75	4.96E+00	pCi/kg	3.81E+01		U
Sediment	Indicator	S-4	30-May-13	Grab	Silver-108m	-5.07E+00	pCi/kg	2.22E+01		U
Sediment	Indicator	S-4	30-May-13	Grab	Silver-110m	-9.54E-01	pCi/kg	3.80E+01		U
Sediment	Indicator	S-4	30-May-13	Grab	Strontium-89	-2.40E+02	pCi/kg	2.22E+02	300	U
Sediment	Indicator	S-4	30-May-13	Grab	Strontium-90	-1.90E+02	pCi/kg	2.60E+02	300	U
Sediment	Indicator	S-4	30-May-13	Grab	Thallium-208	9.65E+01	pCi/kg	3.02E+01		
Sediment	Indicator	S-4	30-May-13	Grab	Thorium-228	2.32E+02	pCi/kg	4.20E+01		
Sediment	Indicator	S-4	30-May-13	Grab	Thorium-230	1.00E+02	pCi/kg	1.00E+02		UI
Sediment	Indicator	S-4	30-May-13	Grab	Zinc-65	-2.26E+01	pCi/kg	7.55E+01		U
Sediment	Indicator	S-4	30-May-13	Grab	Zirconium-95	2.97E+01	pCi/kg	7.82E+01		U
Sediment	Control	S-5	25-Oct-13	GRAB	Strontium-89	8.08E+01	pCi/kg	2.33E+02	300	U
Sediment	Control	S-5	25-Oct-13	GRAB	Strontium-90	-9.86E+00	pCi/kg	5.43E+01	300	U
Sediment	Indicator	S-1	25-Nov-13	Grab	Actinium-228	8.43E+02	pCi/kg	1.62E+02		
Sediment	Indicator	S-1	25-Nov-13	Grab	Antimony-124	-1.58E+01	pCi/kg	9.85E+01		U
Sediment	Indicator	S-1	25-Nov-13	Grab	Antimony-125	1.61E+01	pCi/kg	1.12E+02		U
Sediment	Indicator	S-1	25-Nov-13	Grab	Barium-140	8.31E+01	pCi/kg	6.50E+02		U
Sediment	Indicator	S-1	25-Nov-13	Grab	Beryllium-7	-7.80E+01	pCi/kg	4.52E+02		U
Sediment	Indicator	S-1	25-Nov-13	Grab	Bismuth-214	6.31E+02	pCi/kg	8.21E+01		
Sediment	Indicator	S-1	25-Nov-13	Grab	Cerium-141	7.40E+01	pCi/kg	1.08E+02		U
Sediment	Indicator	S-1	25-Nov-13	Grab	Cerium-144	4.95E+01	pCi/kg	2.35E+02		U
Sediment	Indicator	S-1	25-Nov-13	Grab	Cesium-134	5.55E+01	pCi/kg	5.97E+01	150	U
Sediment	Indicator	S-1	25-Nov-13	Grab	Cesium-137	1.26E+02	pCi/kg	4.12E+01	180	M
Sediment	Indicator	S-1	25-Nov-13	Grab	Chromium-51	-2.57E+02	pCi/kg	5.68E+02		U



Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Sediment	Indicator	S-1	25-Nov-13	Grab	Cobalt-57	6.90E+00	pCi/kg	3.10E+01		U
Sediment	Indicator	S-1	25-Nov-13	Grab	Cobalt-58	2.98E+01	pCi/kg	5.55E+01		U
Sediment	Indicator	S-1	25-Nov-13	Grab	Cobalt-60	6.40E+00	pCi/kg	4.16E+01		U
Sediment	Indicator	S-1	25-Nov-13	Grab	Iodine-131	-4.12E+00	pCi/kg	4.22E+02		U
Sediment	Indicator	S-1	25-Nov-13	Grab	Iron-59	-7.17E+01	pCi/kg	1.16E+02		U
Sediment	Indicator	S-1	25-Nov-13	Grab	Lanthanum-140	-2.25E+01	pCi/kg	1.55E+02		U
Sediment	Indicator	S-1	25-Nov-13	Grab	Lead-212	7.10E+02	pCi/kg	6.18E+01		
Sediment	Indicator	S-1	25-Nov-13	Grab	Lead-214	1.99E+02	pCi/kg	1.99E+02		UI
Sediment	Indicator	S-1	25-Nov-13	Grab	Manganese-54	-3.70E+01	pCi/kg	3.94E+01		U
Sediment	Indicator	S-1	25-Nov-13	Grab	Niobium-95	1.58E+01	pCi/kg	6.59E+01		U
Sediment	Indicator	S-1	25-Nov-13	Grab	Potassium-40	1.61E+04	pCi/kg	3.33E+02		
Sediment	Indicator	S-1	25-Nov-13	Grab	Radium-226	6.31E+02	pCi/kg	8.21E+01		
Sediment	Indicator	S-1	25-Nov-13	Grab	Ruthenium-103	1.39E+01	pCi/kg	6.20E+01		U
Sediment	Indicator	S-1	25-Nov-13	Grab	Ruthenium-106	2.34E+02	pCi/kg	4.23E+02		U
Sediment	Indicator	S-1	25-Nov-13	Grab	Selenium-75	-2.31E+01	pCi/kg	5.18E+01		U
Sediment	Indicator	S-1	25-Nov-13	Grab	Silver-108m	-2.04E+00	pCi/kg	3.53E+01		U
Sediment	Indicator	S-1	25-Nov-13	Grab	Silver-110m	-2.72E+01	pCi/kg	5.33E+01		U
Sediment	Indicator	S-1	25-Nov-13	GRAB	Strontium-89	-5.30E+01	pCi/kg	2.13E+02	300	U
Sediment	Indicator	S-1	25-Nov-13	GRAB	Strontium-90	1.95E+01	pCi/kg	5.30E+01	300	U
Sediment	Indicator	S-1	25-Nov-13	Grab	Thallium-208	2.01E+02	pCi/kg	4.36E+01		
Sediment	Indicator	S-1	25-Nov-13	Grab	Thorium-228	7.10E+02	pCi/kg	6.18E+01		
Sediment	Indicator	S-1	25-Nov-13	Grab	Thorium-230	6.31E+02	pCi/kg	8.21E+01		
Sediment	Indicator	S-1	25-Nov-13	Grab	Zinc-65	-3.25E+00	pCi/kg	9.72E+01		U
Sediment	Indicator	S-1	25-Nov-13	Grab	Zirconium-95	3.31E+01	pCi/kg	1.01E+02		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Actinium-228	3.20E+02	pCi/kg	1.34E+02		
Sediment	Indicator	S-4	25-Nov-13	Grab	Antimony-124	-1.76E+01	pCi/kg	7.20E+01		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Antimony-125	2.75E+01	pCi/kg	8.07E+01		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Barium-140	2.13E+01	pCi/kg	5.04E+02		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Beryllium-7	2.36E+01	pCi/kg	3.78E+02		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Bismuth-214	3.79E+02	pCi/kg	6.84E+01		
Sediment	Indicator	S-4	25-Nov-13	Grab	Cerium-141	-8.97E+00	pCi/kg	7.12E+01		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Cerium-144	-6.39E+01	pCi/kg	1.72E+02		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Cesium-134	-1.01E+01	pCi/kg	3.97E+01	150	U
Sediment	Indicator	S-4	25-Nov-13	Grab	Cesium-137	5.74E+00	pCi/kg	3.93E+01	180	U
Sediment	Indicator	S-4	25-Nov-13	Grab	Chromium-51	-1.61E+02	pCi/kg	4.51E+02		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Cobalt-57	-4.72E+00	pCi/kg	2.26E+01		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Cobalt-58	4.90E+00	pCi/kg	3.65E+01		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Cobalt-60	-5.48E+00	pCi/kg	3.27E+01		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Iodine-131	2.65E+01	pCi/kg	3.49E+02		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Iron-59	-2.49E+01	pCi/kg	1.26E+02		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Lanthanum-140	-6.31E+01	pCi/kg	1.14E+02		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Lead-212	2.72E+02	pCi/kg	5.18E+01		
Sediment	Indicator	S-4	25-Nov-13	Grab	Lead-214	3.86E+02	pCi/kg	6.65E+01		
Sediment	Indicator	S-4	25-Nov-13	Grab	Manganese-54	8.06E+00	pCi/kg	4.23E+01		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Sediment	Indicator	S-4	25-Nov-13	Grab	Niobium-95	2.12E+01	pCi/kg	5.25E+01		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Potassium-40	1.25E+04	pCi/kg	3.06E+02		
Sediment	Indicator	S-4	25-Nov-13	Grab	Radium-226	3.79E+02	pCi/kg	6.84E+01		
Sediment	Indicator	S-4	25-Nov-13	Grab	Ruthenium-103	3.86E+01	pCi/kg	4.26E+01		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Ruthenium-106	4.87E+00	pCi/kg	2.95E+02		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Selenium-75	7.04E+00	pCi/kg	4.56E+01		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Silver-108m	1.68E+01	pCi/kg	2.82E+01		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Silver-110m	-4.70E+00	pCi/kg	4.86E+01		U
Sediment	Indicator	S-4	25-Nov-13	GRAB	Strontium-89	6.90E+01	pCi/kg	2.12E+02	300	U
Sediment	Indicator	S-4	25-Nov-13	GRAB	Strontium-90	2.09E+01	pCi/kg	8.49E+01	300	U
Sediment	Indicator	S-4	25-Nov-13	Grab	Thallium-208	7.61E+01	pCi/kg	2.99E+01		
Sediment	Indicator	S-4	25-Nov-13	Grab	Thorium-228	2.72E+02	pCi/kg	5.18E+01		
Sediment	Indicator	S-4	25-Nov-13	Grab	Thorium-230	3.79E+02	pCi/kg	6.84E+01		
Sediment	Indicator	S-4	25-Nov-13	Grab	Zinc-65	-2.52E+01	pCi/kg	9.41E+01		U
Sediment	Indicator	S-4	25-Nov-13	Grab	Zirconium-95	-4.60E+00	pCi/kg	7.49E+01		U
Sediment	Control	S-5	25-Nov-13	Grab	Actinium-228	5.29E+02	pCi/kg	5.29E+02		UI
Sediment	Control	S-5	25-Nov-13	Grab	Antimony-124	-6.76E+01	pCi/kg	1.52E+02		U
Sediment	Control	S-5	25-Nov-13	Grab	Antimony-125	4.47E+01	pCi/kg	1.84E+02		U
Sediment	Control	S-5	25-Nov-13	Grab	Barium-140	2.19E+02	pCi/kg	1.20E+03		U
Sediment	Control	S-5	25-Nov-13	Grab	Beryllium-7	1.19E+03	pCi/kg	7.95E+02		
Sediment	Control	S-5	25-Nov-13	Grab	Bismuth-214	5.40E+02	pCi/kg	1.57E+02		
Sediment	Control	S-5	25-Nov-13	Grab	Cerium-141	8.23E+01	pCi/kg	1.53E+02		U
Sediment	Control	S-5	25-Nov-13	Grab	Cerium-144	1.83E+01	pCi/kg	3.33E+02		U
Sediment	Control	S-5	25-Nov-13	Grab	Cesium-134	2.96E+01	pCi/kg	9.76E+01	150	U
Sediment	Control	S-5	25-Nov-13	Grab	Cesium-137	1.79E+02	pCi/kg	8.01E+01	180	M
Sediment	Control	S-5	25-Nov-13	Grab	Chromium-51	5.45E+02	pCi/kg	1.00E+03		U
Sediment	Control	S-5	25-Nov-13	Grab	Cobalt-57	-1.70E+00	pCi/kg	4.48E+01		U
Sediment	Control	S-5	25-Nov-13	Grab	Cobalt-58	-3.91E+01	pCi/kg	9.30E+01		U
Sediment	Control	S-5	25-Nov-13	Grab	Cobalt-60	-1.28E+01	pCi/kg	7.87E+01		U
Sediment	Control	S-5	25-Nov-13	Grab	Iodine-131	-4.11E+01	pCi/kg	6.65E+02		U
Sediment	Control	S-5	25-Nov-13	Grab	Iron-59	-9.34E+01	pCi/kg	2.06E+02		U
Sediment	Control	S-5	25-Nov-13	Grab	Lanthanum-140	-1.55E+02	pCi/kg	3.42E+02		U
Sediment	Control	S-5	25-Nov-13	Grab	Lead-212	6.32E+02	pCi/kg	1.07E+02		
Sediment	Control	S-5	25-Nov-13	Grab	Lead-214	7.10E+02	pCi/kg	1.47E+02		
Sediment	Control	S-5	25-Nov-13	Grab	Manganese-54	8.58E+00	pCi/kg	8.37E+01		U
Sediment	Control	S-5	25-Nov-13	Grab	Niobium-95	2.24E+00	pCi/kg	9.42E+01		U
Sediment	Control	S-5	25-Nov-13	Grab	Potassium-40	1.48E+04	pCi/kg	7.25E+02		
Sediment	Control	S-5	25-Nov-13	Grab	Radium-226	5.40E+02	pCi/kg	1.57E+02		
Sediment	Control	S-5	25-Nov-13	Grab	Ruthenium-103	7.62E+00	pCi/kg	1.06E+02		U
Sediment	Control	S-5	25-Nov-13	Grab	Ruthenium-106	-1.18E+02	pCi/kg	6.00E+02		U
Sediment	Control	S-5	25-Nov-13	Grab	Selenium-75	2.02E+01	pCi/kg	8.76E+01		U
Sediment	Control	S-5	25-Nov-13	Grab	Silver-108m	-1.24E+01	pCi/kg	5.63E+01		U
Sediment	Control	S-5	25-Nov-13	Grab	Silver-110m	7.94E+00	pCi/kg	1.05E+02		U
Sediment	Control	S-5	25-Nov-13	Grab	Thallium-208	2.36E+02	pCi/kg	6.08E+01		

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Sediment	Control	S-5	25-Nov-13	Grab	Thorium-228	6.32E+02	pCi/kg	1.07E+02		
Sediment	Control	S-5	25-Nov-13	Grab	Thorium-230	5.40E+02	pCi/kg	1.57E+02		
Sediment	Control	S-5	25-Nov-13	Grab	Zinc-65	8.45E+01	pCi/kg	1.92E+02		U
Sediment	Control	S-5	25-Nov-13	Grab	Zirconium-95	9.40E+01	pCi/kg	1.86E+02		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Actinium-228	1.18E+03	pCi/kg	2.05E+02		
Sediment	Indicator	S-2	26-Nov-13	Grab	Antimony-124	7.67E+00	pCi/kg	1.18E+02		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Antimony-125	-8.16E+01	pCi/kg	1.23E+02		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Barium-140	-7.81E+01	pCi/kg	7.26E+02		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Beryllium-7	6.17E+01	pCi/kg	5.22E+02		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Bismuth-214	8.23E+02	pCi/kg	9.07E+01		
Sediment	Indicator	S-2	26-Nov-13	Grab	Cerium-141	-4.35E+00	pCi/kg	1.09E+02		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Cerium-144	-1.27E+02	pCi/kg	2.69E+02		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Cesium-134	3.99E+01	pCi/kg	5.86E+01	150	U
Sediment	Indicator	S-2	26-Nov-13	Grab	Cesium-137	3.97E+01	pCi/kg	5.43E+01	180	U
Sediment	Indicator	S-2	26-Nov-13	Grab	Chromium-51	-2.01E+02	pCi/kg	6.42E+02		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Cobalt-57	-4.17E+00	pCi/kg	3.38E+01		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Cobalt-58	3.52E+01	pCi/kg	5.82E+01		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Cobalt-60	-2.55E+01	pCi/kg	5.16E+01		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Iodine-131	-3.17E+01	pCi/kg	4.38E+02		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Iron-59	6.90E+01	pCi/kg	1.69E+02		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Lanthanum-140	1.93E+01	pCi/kg	1.45E+02		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Lead-212	1.11E+03	pCi/kg	7.69E+01		
Sediment	Indicator	S-2	26-Nov-13	Grab	Lead-214	9.60E+02	pCi/kg	9.87E+01		
Sediment	Indicator	S-2	26-Nov-13	Grab	Manganese-54	3.94E+01	pCi/kg	5.80E+01		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Niobium-95	3.82E+01	pCi/kg	7.08E+01		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Potassium-40	2.41E+04	pCi/kg	3.98E+02		
Sediment	Indicator	S-2	26-Nov-13	Grab	Radium-226	8.23E+02	pCi/kg	9.07E+01		
Sediment	Indicator	S-2	26-Nov-13	Grab	Ruthenium-103	1.44E+01	pCi/kg	7.35E+01		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Ruthenium-106	-2.60E+01	pCi/kg	4.37E+02		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Selenium-75	3.08E+00	pCi/kg	6.89E+01		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Silver-108m	-9.92E+00	pCi/kg	4.18E+01		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Silver-110m	2.84E+01	pCi/kg	7.36E+01		U
Sediment	Indicator	S-2	26-Nov-13	GRAB	Strontium-89	-1.82E+02	pCi/kg	2.45E+02	300	U
Sediment	Indicator	S-2	26-Nov-13	GRAB	Strontium-90	-2.85E+01	pCi/kg	7.19E+01	300	U
Sediment	Indicator	S-2	26-Nov-13	Grab	Thallium-208	2.69E+02	pCi/kg	5.53E+01		
Sediment	Indicator	S-2	26-Nov-13	Grab	Thorium-228	1.11E+03	pCi/kg	7.69E+01		
Sediment	Indicator	S-2	26-Nov-13	Grab	Thorium-230	8.23E+02	pCi/kg	9.07E+01		
Sediment	Indicator	S-2	26-Nov-13	Grab	Zinc-65	3.15E+01	pCi/kg	1.40E+02		U
Sediment	Indicator	S-2	26-Nov-13	Grab	Zirconium-95	7.20E+01	pCi/kg	1.39E+02		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Actinium-228	3.03E+02	pCi/kg	1.23E+02		
Sediment	Indicator	S-3	26-Nov-13	Grab	Antimony-124	-3.09E+01	pCi/kg	3.86E+01		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Antimony-125	1.56E+01	pCi/kg	7.29E+01		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Barium-140	1.90E+02	pCi/kg	4.56E+02		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Beryllium-7	1.80E+00	pCi/kg	3.23E+02		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Sediment	Indicator	S-3	26-Nov-13	Grab	Bismuth-214	9.87E+01	pCi/kg	9.87E+01		UI
Sediment	Indicator	S-3	26-Nov-13	Grab	Cerium-141	3.28E+01	pCi/kg	5.68E+01		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Cerium-144	5.56E+01	pCi/kg	1.43E+02		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Cesium-134	9.47E+00	pCi/kg	3.81E+01	150	U
Sediment	Indicator	S-3	26-Nov-13	Grab	Cesium-137	1.73E+01	pCi/kg	3.68E+01	180	U
Sediment	Indicator	S-3	26-Nov-13	Grab	Chromium-51	-1.89E+01	pCi/kg	3.77E+02		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Cobalt-57	-3.75E+00	pCi/kg	1.77E+01		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Cobalt-58	-6.70E+00	pCi/kg	3.75E+01		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Cobalt-60	-1.21E+01	pCi/kg	3.39E+01		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Iodine-131	4.09E+01	pCi/kg	2.65E+02		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Iron-59	-2.89E+01	pCi/kg	8.83E+01		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Lanthanum-140	1.09E+00	pCi/kg	1.26E+02		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Lead-212	1.89E+02	pCi/kg	4.05E+01		
Sediment	Indicator	S-3	26-Nov-13	Grab	Lead-214	1.57E+02	pCi/kg	5.32E+01		
Sediment	Indicator	S-3	26-Nov-13	Grab	Manganese-54	8.00E+00	pCi/kg	3.55E+01		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Niobium-95	1.05E+01	pCi/kg	4.68E+01		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Potassium-40	1.26E+04	pCi/kg	2.36E+02		
Sediment	Indicator	S-3	26-Nov-13	Grab	Radium-226	9.87E+01	pCi/kg	9.87E+01		UI
Sediment	Indicator	S-3	26-Nov-13	Grab	Ruthenium-103	-1.99E+01	pCi/kg	3.83E+01		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Ruthenium-106	-7.61E+01	pCi/kg	2.81E+02		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Selenium-75	1.86E+01	pCi/kg	3.58E+01		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Silver-108m	-1.38E+01	pCi/kg	2.27E+01		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Silver-110m	-5.02E+00	pCi/kg	5.04E+01		U
Sediment	Indicator	S-3	26-Nov-13	GRAB	Strontium-89	-1.87E+02	pCi/kg	2.19E+02	300	U
Sediment	Indicator	S-3	26-Nov-13	GRAB	Strontium-90	-1.10E+01	pCi/kg	8.49E+01	300	U
Sediment	Indicator	S-3	26-Nov-13	Grab	Thallium-208	3.84E+01	pCi/kg	2.79E+01		
Sediment	Indicator	S-3	26-Nov-13	Grab	Thorium-228	1.89E+02	pCi/kg	4.05E+01		
Sediment	Indicator	S-3	26-Nov-13	Grab	Thorium-230	9.87E+01	pCi/kg	9.87E+01		UI
Sediment	Indicator	S-3	26-Nov-13	Grab	Zinc-65	-6.43E+01	pCi/kg	7.43E+01		U
Sediment	Indicator	S-3	26-Nov-13	Grab	Zirconium-95	-9.98E+00	pCi/kg	7.10E+01		U
Surface Water	Control	SW-2	28-Jan-13	Composite	Actinium-228	1.44E+00	pCi/L	6.59E+00		U
Surface Water	Control	SW-2	28-Jan-13	Composite	Antimony-124	4.88E-01	pCi/L	3.26E+00		U
Surface Water	Control	SW-2	28-Jan-13	Composite	Antimony-125	-1.82E+00	pCi/L	4.40E+00		U
Surface Water	Control	SW-2	28-Jan-13	Composite	Barium-140	4.53E-01	pCi/L	2.09E+00	15	U
Surface Water	Control	SW-2	28-Jan-13	Composite	Beryllium-7	-4.97E+00	pCi/L	1.31E+01		U
Surface Water	Control	SW-2	28-Jan-13	Composite	Cerium-141	2.82E-01	pCi/L	2.61E+00		U
Surface Water	Control	SW-2	28-Jan-13	Composite	Cerium-144	6.02E+00	pCi/L	1.19E+01		U
Surface Water	Control	SW-2	28-Jan-13	Composite	Cesium-134	4.73E-01	pCi/L	1.67E+00	15	U
Surface Water	Control	SW-2	28-Jan-13	Composite	Cesium-137	9.14E-01	pCi/L	1.69E+00	18	U
Surface Water	Control	SW-2	28-Jan-13	Composite	Chromium-51	3.41E-01	pCi/L	1.45E+01		U
Surface Water	Control	SW-2	28-Jan-13	Composite	Cobalt-57	3.38E-01	pCi/L	1.55E+00		U
Surface Water	Control	SW-2	28-Jan-13	Composite	Cobalt-58	-4.76E-01	pCi/L	1.51E+00	15	U
Surface Water	Control	SW-2	28-Jan-13	Composite	Cobalt-60	5.11E-01	pCi/L	1.68E+00	15	U
Surface Water	Control	SW-2	28-Jan-13	Composite	Iodine-131	1.46E-01	pCi/L	2.03E+00		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Surface Water	Control	SW-2	28-Jan-13	Composite	Iron-59	-5.41E-01	pCi/L	2.69E+00	30	U
Surface Water	Control	SW-2	28-Jan-13	Composite	Lanthanum-140	4.53E-01	pCi/L	2.09E+00	15	U
Surface Water	Control	SW-2	28-Jan-13	Composite	Manganese-54	-8.54E-02	pCi/L	1.54E+00	15	U
Surface Water	Control	SW-2	28-Jan-13	Composite	Niobium-95	8.48E-02	pCi/L	1.53E+00	15	U
Surface Water	Control	SW-2	28-Jan-13	Composite	Potassium-40	2.38E+00	pCi/L	1.53E+01		U
Surface Water	Control	SW-2	28-Jan-13	Composite	Ruthenium-103	-9.01E-01	pCi/L	1.55E+00		U
Surface Water	Control	SW-2	28-Jan-13	Composite	Ruthenium-106	-1.42E+00	pCi/L	1.43E+01		U
Surface Water	Control	SW-2	28-Jan-13	Composite	Selenium-75	-4.57E-01	pCi/L	2.25E+00		U
Surface Water	Control	SW-2	28-Jan-13	Composite	Silver-108m	3.39E-01	pCi/L	1.52E+00		U
Surface Water	Control	SW-2	28-Jan-13	Composite	Silver-110m	6.09E-01	pCi/L	1.54E+00		U
Surface Water	Control	SW-2	28-Jan-13	Composite	Strontium-89	-3.98E-01	pCi/L	1.31E+00	10	U
Surface Water	Control	SW-2	28-Jan-13	Composite	Strontium-90	2.92E-01	pCi/L	1.86E+00	2	U
Surface Water	Control	SW-2	28-Jan-13	Composite	Thorium-228	-1.67E+00	pCi/L	3.74E+00		U
Surface Water	Control	SW-2	28-Jan-13	Composite	Zinc-65	1.35E+00	pCi/L	3.66E+00	30	U
Surface Water	Control	SW-2	28-Jan-13	Composite	Zirconium-95	-4.00E-01	pCi/L	2.47E+00	15	U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Actinium-228	5.68E+00	pCi/L	5.68E+00		UI
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Antimony-124	3.74E-01	pCi/L	3.78E+00		U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Antimony-125	-1.26E+00	pCi/L	4.31E+00		U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Barium-140	-1.04E+00	pCi/L	2.11E+00	15	U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Beryllium-7	1.44E+00	pCi/L	1.35E+01		U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Cerium-141	2.41E+00	pCi/L	3.12E+00		U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Cerium-144	2.52E+00	pCi/L	1.27E+01		U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Cesium-134	-1.89E-01	pCi/L	1.74E+00	15	U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Cesium-137	7.27E-01	pCi/L	1.90E+00	18	U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Chromium-51	-5.13E+00	pCi/L	1.48E+01		U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Cobalt-57	6.32E-01	pCi/L	1.69E+00		U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Cobalt-58	-7.93E-02	pCi/L	1.52E+00	15	U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Cobalt-60	-8.64E-01	pCi/L	1.68E+00	15	U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Iodine-131	1.08E+00	pCi/L	2.17E+00		U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Iron-59	8.02E-01	pCi/L	3.12E+00	30	U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Lanthanum-140	-1.04E+00	pCi/L	2.11E+00	15	U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Manganese-54	6.08E-01	pCi/L	1.67E+00	15	U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Niobium-95	8.27E-01	pCi/L	1.72E+00	15	U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Potassium-40	1.39E+00	pCi/L	1.64E+01		U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Ruthenium-103	-1.09E+00	pCi/L	1.62E+00		U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Ruthenium-106	-1.51E+00	pCi/L	1.42E+01		U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Selenium-75	1.78E-01	pCi/L	2.39E+00		U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Silver-108m	9.23E-01	pCi/L	1.59E+00		U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Silver-110m	-6.87E-01	pCi/L	1.60E+00		U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Strontium-89	-8.18E-01	pCi/L	1.42E+00	10	U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Strontium-90	-1.12E+00	pCi/L	1.84E+00	2	U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Thorium-228	2.99E+00	pCi/L	3.25E+00		U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Zinc-65	-5.20E-01	pCi/L	3.35E+00	30	U
Surface Water	Indicator	SW-3	28-Jan-13	Composite	Zirconium-95	-4.98E-01	pCi/L	2.82E+00	15	U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Surface Water	Control	SW-2	25-Feb-13	Composite	Actinium-228	1.43E+00	pCi/L	1.07E+01		U
Surface Water	Control	SW-2	25-Feb-13	Composite	Antimony-124	-1.98E+00	pCi/L	4.91E+00		U
Surface Water	Control	SW-2	25-Feb-13	Composite	Antimony-125	1.72E+00	pCi/L	5.85E+00		U
Surface Water	Control	SW-2	25-Feb-13	Composite	Barium-140	2.86E-01	pCi/L	3.22E+00	15	U
Surface Water	Control	SW-2	25-Feb-13	Composite	Beryllium-7	8.19E+00	pCi/L	1.88E+01		U
Surface Water	Control	SW-2	25-Feb-13	Composite	Cerium-141	-4.95E-01	pCi/L	3.13E+00		U
Surface Water	Control	SW-2	25-Feb-13	Composite	Cerium-144	9.10E-02	pCi/L	1.18E+01		U
Surface Water	Control	SW-2	25-Feb-13	Composite	Cesium-134	1.40E-01	pCi/L	2.61E+00	15	U
Surface Water	Control	SW-2	25-Feb-13	Composite	Cesium-137	-1.68E+00	pCi/L	2.55E+00	18	U
Surface Water	Control	SW-2	25-Feb-13	Composite	Chromium-51	-2.43E+00	pCi/L	1.93E+01		U
Surface Water	Control	SW-2	25-Feb-13	Composite	Cobalt-57	2.10E-01	pCi/L	1.47E+00		U
Surface Water	Control	SW-2	25-Feb-13	Composite	Cobalt-58	1.51E+00	pCi/L	2.53E+00	15	U
Surface Water	Control	SW-2	25-Feb-13	Composite	Cobalt-60	4.68E-01	pCi/L	2.72E+00	15	U
Surface Water	Control	SW-2	25-Feb-13	Composite	Iodine-131	-2.34E-01	pCi/L	3.24E+00		U
Surface Water	Control	SW-2	25-Feb-13	Composite	Iron-59	1.80E+00	pCi/L	5.03E+00	30	U
Surface Water	Control	SW-2	25-Feb-13	Composite	Lanthanum-140	2.86E-01	pCi/L	3.22E+00	15	U
Surface Water	Control	SW-2	25-Feb-13	Composite	Manganese-54	1.63E-01	pCi/L	2.39E+00	15	U
Surface Water	Control	SW-2	25-Feb-13	Composite	Niobium-95	1.24E+00	pCi/L	2.61E+00	15	U
Surface Water	Control	SW-2	25-Feb-13	Composite	Potassium-40	1.38E+01	pCi/L	2.53E+01		U
Surface Water	Control	SW-2	25-Feb-13	Composite	Ruthenium-103	5.75E-02	pCi/L	2.39E+00		U
Surface Water	Control	SW-2	25-Feb-13	Composite	Ruthenium-106	1.50E+00	pCi/L	2.08E+01		U
Surface Water	Control	SW-2	25-Feb-13	Composite	Selenium-75	8.08E-01	pCi/L	2.74E+00		U
Surface Water	Control	SW-2	25-Feb-13	Composite	Silver-108m	2.41E-01	pCi/L	1.90E+00		U
Surface Water	Control	SW-2	25-Feb-13	Composite	Silver-110m	-6.58E-01	pCi/L	2.18E+00		U
Surface Water	Control	SW-2	25-Feb-13	Composite	Strontium-89	1.11E+00	pCi/L	1.37E+00	10	U
Surface Water	Control	SW-2	25-Feb-13	Composite	Strontium-90	-1.77E-01	pCi/L	1.45E+00	2	U
Surface Water	Control	SW-2	25-Feb-13	Composite	Thorium-228	-1.49E+00	pCi/L	4.63E+00		U
Surface Water	Control	SW-2	25-Feb-13	Composite	Zinc-65	-1.00E+00	pCi/L	4.81E+00	30	U
Surface Water	Control	SW-2	25-Feb-13	Composite	Zirconium-95	-7.26E-01	pCi/L	3.90E+00	15	U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Actinium-228	6.29E+00	pCi/L	9.45E+00		U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Antimony-124	-4.29E-01	pCi/L	4.93E+00		U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Antimony-125	-7.56E-01	pCi/L	5.11E+00		U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Barium-140	6.22E-01	pCi/L	3.21E+00	15	U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Beryllium-7	-7.96E+00	pCi/L	1.58E+01		U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Cerium-141	2.16E+00	pCi/L	3.70E+00		U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Cerium-144	-6.36E+00	pCi/L	1.37E+01		U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Cesium-134	1.71E-01	pCi/L	2.08E+00	15	U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Cesium-137	-2.45E-01	pCi/L	1.94E+00	18	U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Chromium-51	-2.04E+00	pCi/L	1.87E+01		U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Cobalt-57	3.63E-01	pCi/L	1.81E+00		U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Cobalt-58	1.93E-01	pCi/L	1.86E+00	15	U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Cobalt-60	1.25E+00	pCi/L	2.20E+00	15	U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Iodine-131	2.10E+00	pCi/L	3.24E+00		U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Iron-59	4.57E-01	pCi/L	3.93E+00	30	U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Lanthanum-140	6.22E-01	pCi/L	3.21E+00	15	U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Manganese-54	-1.84E+00	pCi/L	1.78E+00	15	U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Niobium-95	8.64E-01	pCi/L	2.07E+00	15	U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Potassium-40	-7.81E+00	pCi/L	2.68E+01		U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Ruthenium-103	-1.18E+00	pCi/L	1.96E+00		U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Ruthenium-106	-2.77E+00	pCi/L	1.77E+01		U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Selenium-75	-2.35E-01	pCi/L	2.80E+00		U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Silver-108m	4.77E-01	pCi/L	1.77E+00		U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Silver-110m	8.24E-01	pCi/L	1.91E+00		U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Strontium-89	-4.93E-01	pCi/L	2.14E+00	10	U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Strontium-90	5.60E-01	pCi/L	1.36E+00	2	U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Thorium-228	1.35E+00	pCi/L	3.86E+00		U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Zinc-65	1.33E+00	pCi/L	4.63E+00	30	U
Surface Water	Indicator	SW-3	25-Feb-13	Composite	Zirconium-95	9.02E-01	pCi/L	3.61E+00	15	U
Surface Water	Control	SW-2	26-Mar-13	Composite	Actinium-228	6.29E+00	pCi/L	8.01E+00		U
Surface Water	Control	SW-2	26-Mar-13	Composite	Antimony-124	-3.71E-01	pCi/L	5.69E+00		U
Surface Water	Control	SW-2	26-Mar-13	Composite	Antimony-125	7.13E-01	pCi/L	5.95E+00		U
Surface Water	Control	SW-2	26-Mar-13	Composite	Barium-140	6.74E-01	pCi/L	3.42E+00	15	U
Surface Water	Control	SW-2	26-Mar-13	Composite	Beryllium-7	2.65E+00	pCi/L	1.87E+01		U
Surface Water	Control	SW-2	26-Mar-13	Composite	Cerium-141	1.03E+00	pCi/L	2.87E+00		U
Surface Water	Control	SW-2	26-Mar-13	Composite	Cerium-144	2.98E+00	pCi/L	1.19E+01		U
Surface Water	Control	SW-2	26-Mar-13	Composite	Cesium-134	1.54E-01	pCi/L	2.71E+00	15	U
Surface Water	Control	SW-2	26-Mar-13	Composite	Cesium-137	3.96E-01	pCi/L	2.49E+00	18	U
Surface Water	Control	SW-2	26-Mar-13	Composite	Chromium-51	3.67E+00	pCi/L	1.73E+01		U
Surface Water	Control	SW-2	26-Mar-13	Composite	Cobalt-57	-2.61E-01	pCi/L	1.45E+00		U
Surface Water	Control	SW-2	26-Mar-13	Composite	Cobalt-58	6.69E-01	pCi/L	2.28E+00	15	U
Surface Water	Control	SW-2	26-Mar-13	Composite	Cobalt-60	5.39E-01	pCi/L	2.47E+00	15	U
Surface Water	Control	SW-2	26-Mar-13	Composite	Iodine-131	4.60E-01	pCi/L	2.64E+00		U
Surface Water	Control	SW-2	26-Mar-13	Composite	Iron-59	-2.54E-01	pCi/L	4.72E+00	30	U
Surface Water	Control	SW-2	26-Mar-13	Composite	Lanthanum-140	6.74E-01	pCi/L	3.42E+00	15	U
Surface Water	Control	SW-2	26-Mar-13	Composite	Manganese-54	9.09E-01	pCi/L	2.34E+00	15	U
Surface Water	Control	SW-2	26-Mar-13	Composite	Niobium-95	9.74E-01	pCi/L	2.23E+00	15	U
Surface Water	Control	SW-2	26-Mar-13	Composite	Potassium-40	1.91E+01	pCi/L	2.23E+01		U
Surface Water	Control	SW-2	26-Mar-13	Composite	Ruthenium-103	-3.56E-01	pCi/L	2.07E+00		U
Surface Water	Control	SW-2	26-Mar-13	Composite	Ruthenium-106	2.71E+00	pCi/L	2.15E+01		U
Surface Water	Control	SW-2	26-Mar-13	Composite	Selenium-75	1.53E-01	pCi/L	2.67E+00		U
Surface Water	Control	SW-2	26-Mar-13	Composite	Silver-108m	4.42E-01	pCi/L	1.92E+00		U
Surface Water	Control	SW-2	26-Mar-13	Composite	Silver-110m	-5.00E-01	pCi/L	2.11E+00		U
Surface Water	Control	SW-2	26-Mar-13	Composite	Strontium-89	-1.20E+00	pCi/L	1.36E+00	10	U
Surface Water	Control	SW-2	26-Mar-13	Composite	Strontium-90	6.11E-02	pCi/L	1.60E+00	2	U
Surface Water	Control	SW-2	26-Mar-13	Composite	Thorium-228	-2.24E+00	pCi/L	4.54E+00		U
Surface Water	Control	SW-2	26-Mar-13	Composite	Tritium	-9.66E+01	pCi/L	4.38E+02	500	U
Surface Water	Control	SW-2	26-Mar-13	Composite	Zinc-65	5.11E-01	pCi/L	4.89E+00	30	U
Surface Water	Control	SW-2	26-Mar-13	Composite	Zirconium-95	1.01E-01	pCi/L	3.71E+00	15	U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Actinium-228	2.08E+00	pCi/L	5.11E+00		U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Antimony-124	-4.81E-01	pCi/L	3.48E+00		U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Antimony-125	2.24E+00	pCi/L	4.59E+00		U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Barium-140	-5.08E-02	pCi/L	1.92E+00	15	U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Beryllium-7	6.23E-01	pCi/L	1.39E+01		U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Cerium-141	1.14E+00	pCi/L	2.80E+00		U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Cerium-144	-4.54E+00	pCi/L	1.14E+01		U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Cesium-134	7.82E-01	pCi/L	1.74E+00	15	U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Cesium-137	2.21E-02	pCi/L	1.61E+00	18	U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Chromium-51	-4.34E+00	pCi/L	1.40E+01		U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Cobalt-57	2.48E-01	pCi/L	1.54E+00		U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Cobalt-58	4.99E-01	pCi/L	1.50E+00	15	U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Cobalt-60	7.56E-01	pCi/L	1.65E+00	15	U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Iodine-131	8.87E-02	pCi/L	2.08E+00		U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Iron-59	-5.91E-02	pCi/L	3.00E+00	30	U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Lanthanum-140	-5.08E-02	pCi/L	1.92E+00	15	U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Manganese-54	-2.49E-01	pCi/L	1.48E+00	15	U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Niobium-95	1.27E+00	pCi/L	1.61E+00	15	U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Potassium-40	-3.32E+00	pCi/L	2.38E+01		U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Ruthenium-103	3.12E-01	pCi/L	1.59E+00		U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Ruthenium-106	-4.83E-01	pCi/L	1.39E+01		U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Selenium-75	3.54E-01	pCi/L	2.24E+00		U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Silver-108m	7.52E-01	pCi/L	1.50E+00		U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Silver-110m	-1.14E-01	pCi/L	1.43E+00		U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Strontium-89	8.81E-01	pCi/L	2.48E+00	10	U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Strontium-90	8.84E-01	pCi/L	1.60E+00	2	U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Thorium-228	6.87E-01	pCi/L	3.62E+00		U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Tritium	2.02E+02	pCi/L	4.36E+02	500	U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Zinc-65	1.40E+00	pCi/L	3.13E+00	30	U
Surface Water	Indicator	SW-3	26-Mar-13	Composite	Zirconium-95	2.63E-02	pCi/L	2.76E+00	15	U
Surface Water	Control	SW-2	30-Apr-13	Composite	Actinium-228	-4.58E+00	pCi/L	1.13E+01		U
Surface Water	Control	SW-2	30-Apr-13	Composite	Actinium-228	7.78E+00	pCi/L	7.78E+00		UI
Surface Water	Control	SW-2	30-Apr-13	Composite	Antimony-124	-1.29E+00	pCi/L	6.96E+00		U
Surface Water	Control	SW-2	30-Apr-13	Composite	Antimony-124	4.83E-01	pCi/L	4.18E+00		U
Surface Water	Control	SW-2	30-Apr-13	Composite	Antimony-125	2.68E-01	pCi/L	6.16E+00		U
Surface Water	Control	SW-2	30-Apr-13	Composite	Antimony-125	9.90E-01	pCi/L	4.14E+00		U
Surface Water	Control	SW-2	30-Apr-13	Composite	Barium-140	-8.43E-01	pCi/L	4.26E+00	15	U
Surface Water	Control	SW-2	30-Apr-13	Composite	Barium-140	-2.03E-01	pCi/L	2.85E+00	15	U
Surface Water	Control	SW-2	30-Apr-13	Composite	Beryllium-7	-4.05E-01	pCi/L	1.35E+01		U
Surface Water	Control	SW-2	30-Apr-13	Composite	Cerium-141	-6.70E-01	pCi/L	2.88E+00		U
Surface Water	Control	SW-2	30-Apr-13	Composite	Cerium-144	7.30E-01	pCi/L	1.08E+01		U
Surface Water	Control	SW-2	30-Apr-13	Composite	Cesium-134	3.65E-01	pCi/L	1.77E+00	15	U
Surface Water	Control	SW-2	30-Apr-13	Composite	Cesium-137	-1.50E-01	pCi/L	1.62E+00	18	U
Surface Water	Control	SW-2	30-Apr-13	Composite	Chromium-51	2.93E+00	pCi/L	1.50E+01		U



Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Surface Water	Control	SW-2	30-Apr-13	Composite	Cobalt-57	-5.36E-02	pCi/L	1.43E+00		U
Surface Water	Control	SW-2	30-Apr-13	Composite	Cobalt-58	-3.72E-01	pCi/L	1.52E+00	15	U
Surface Water	Control	SW-2	30-Apr-13	Composite	Cobalt-60	3.25E-01	pCi/L	1.81E+00	15	U
Surface Water	Control	SW-2	30-Apr-13	Composite	Iodine-131	1.46E+00	pCi/L	2.96E+00		U
Surface Water	Control	SW-2	30-Apr-13	Composite	Iron-59	1.82E-01	pCi/L	3.30E+00	30	U
Surface Water	Control	SW-2	30-Apr-13	Composite	Lanthanum-140	-2.03E-01	pCi/L	2.85E+00	15	U
Surface Water	Control	SW-2	30-Apr-13	Composite	Manganese-54	8.33E-01	pCi/L	8.33E-01	15	UI
Surface Water	Control	SW-2	30-Apr-13	Composite	Niobium-95	9.14E-01	pCi/L	1.57E+00	15	U
Surface Water	Control	SW-2	30-Apr-13	Composite	Potassium-40	3.74E+00	pCi/L	2.28E+01		U
Surface Water	Control	SW-2	30-Apr-13	Composite	Ruthenium-103	1.15E-01	pCi/L	1.69E+00		U
Surface Water	Control	SW-2	30-Apr-13	Composite	Ruthenium-106	3.70E+00	pCi/L	1.45E+01		U
Surface Water	Control	SW-2	30-Apr-13	Composite	Selenium-75	-9.40E-01	pCi/L	2.12E+00		U
Surface Water	Control	SW-2	30-Apr-13	Composite	Silver-108m	9.75E-01	pCi/L	1.42E+00		U
Surface Water	Control	SW-2	30-Apr-13	Composite	Silver-110m	-5.32E-01	pCi/L	1.48E+00		U
Surface Water	Control	SW-2	30-Apr-13	Composite	Strontium-89	1.41E+00	pCi/L	4.22E+00	10	U
Surface Water	Control	SW-2	30-Apr-13	Composite	Strontium-90	-8.38E-01	pCi/L	1.68E+00	2	U
Surface Water	Control	SW-2	30-Apr-13	Composite	Thorium-228	4.61E-01	pCi/L	3.77E+00		U
Surface Water	Control	SW-2	30-Apr-13	Composite	Zinc-65	-1.06E+00	pCi/L	3.36E+00	30	U
Surface Water	Control	SW-2	30-Apr-13	Composite	Zirconium-95	7.50E-01	pCi/L	2.84E+00	15	U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Beryllium-7	1.50E+01	pCi/L	2.23E+01		U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Cerium-141	-2.40E+00	pCi/L	3.59E+00		U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Cerium-144	-8.01E+00	pCi/L	1.35E+01		U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Cesium-134	1.80E+00	pCi/L	3.02E+00	15	U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Cesium-137	4.45E-01	pCi/L	2.68E+00	18	U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Chromium-51	-8.27E+00	pCi/L	2.03E+01		U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Cobalt-57	-1.64E-01	pCi/L	1.72E+00		U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Cobalt-58	-4.39E-01	pCi/L	2.29E+00	15	U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Cobalt-60	1.56E-01	pCi/L	2.78E+00	15	U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Iodine-131	1.10E+00	pCi/L	4.05E+00		U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Iron-59	-1.83E+00	pCi/L	4.73E+00	30	U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Lanthanum-140	-8.43E-01	pCi/L	4.26E+00	15	U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Manganese-54	-1.73E+00	pCi/L	2.13E+00	15	U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Niobium-95	4.54E-01	pCi/L	2.50E+00	15	U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Potassium-40	2.41E+01	pCi/L	2.41E+01		UI
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Ruthenium-103	-3.94E-01	pCi/L	2.54E+00		U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Ruthenium-106	3.54E+00	pCi/L	2.03E+01		U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Selenium-75	3.36E-01	pCi/L	2.84E+00		U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Silver-108m	7.86E-01	pCi/L	2.11E+00		U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Silver-110m	6.54E-01	pCi/L	2.36E+00		U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Strontium-89	-1.20E-01	pCi/L	2.00E+00	10	U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Strontium-90	-8.13E-02	pCi/L	1.68E+00	2	U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Thorium-228	2.24E+00	pCi/L	4.28E+00		U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Zinc-65	-3.47E-02	pCi/L	5.35E+00	30	U
Surface Water	Indicator	SW-3	30-Apr-13	Composite	Zirconium-95	-4.23E-01	pCi/L	4.04E+00	15	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Surface Water	Control	SW-2	28-May-13	Composite	Actinium-228	-1.52E+00	pCi/L	1.15E+01		U
Surface Water	Control	SW-2	28-May-13	Composite	Antimony-124	-1.37E+00	pCi/L	5.69E+00		U
Surface Water	Control	SW-2	28-May-13	Composite	Antimony-125	-8.02E-01	pCi/L	6.47E+00		U
Surface Water	Control	SW-2	28-May-13	Composite	Barium-140	-7.65E-01	pCi/L	3.47E+00	15	U
Surface Water	Control	SW-2	28-May-13	Composite	Beryllium-7	1.08E+01	pCi/L	2.36E+01		U
Surface Water	Control	SW-2	28-May-13	Composite	Cerium-141	1.28E+00	pCi/L	4.56E+00		U
Surface Water	Control	SW-2	28-May-13	Composite	Cerium-144	-7.91E-01	pCi/L	1.86E+01		U
Surface Water	Control	SW-2	28-May-13	Composite	Cesium-134	-7.33E-01	pCi/L	2.76E+00	15	U
Surface Water	Control	SW-2	28-May-13	Composite	Cesium-137	-1.40E-01	pCi/L	2.82E+00	18	U
Surface Water	Control	SW-2	28-May-13	Composite	Chromium-51	1.35E+01	pCi/L	2.66E+01		U
Surface Water	Control	SW-2	28-May-13	Composite	Cobalt-57	1.04E-01	pCi/L	2.43E+00		U
Surface Water	Control	SW-2	28-May-13	Composite	Cobalt-58	-6.25E-01	pCi/L	2.41E+00	15	U
Surface Water	Control	SW-2	28-May-13	Composite	Cobalt-60	-6.62E-02	pCi/L	2.97E+00	15	U
Surface Water	Control	SW-2	28-May-13	Composite	Iodine-131	-1.74E-01	pCi/L	3.61E+00		U
Surface Water	Control	SW-2	28-May-13	Composite	Iron-59	-1.11E+00	pCi/L	4.98E+00	30	U
Surface Water	Control	SW-2	28-May-13	Composite	Lanthanum-140	-7.65E-01	pCi/L	3.47E+00	15	U
Surface Water	Control	SW-2	28-May-13	Composite	Manganese-54	-1.34E+00	pCi/L	2.34E+00	15	U
Surface Water	Control	SW-2	28-May-13	Composite	Niobium-95	9.28E-02	pCi/L	2.72E+00	15	U
Surface Water	Control	SW-2	28-May-13	Composite	Potassium-40	-1.07E+01	pCi/L	3.82E+01		U
Surface Water	Control	SW-2	28-May-13	Composite	Ruthenium-103	-1.46E+00	pCi/L	2.48E+00		U
Surface Water	Control	SW-2	28-May-13	Composite	Ruthenium-106	-2.95E+00	pCi/L	2.23E+01		U
Surface Water	Control	SW-2	28-May-13	Composite	Selenium-75	1.94E+00	pCi/L	3.86E+00		U
Surface Water	Control	SW-2	28-May-13	Composite	Silver-108m	3.97E-01	pCi/L	2.33E+00		U
Surface Water	Control	SW-2	28-May-13	Composite	Silver-110m	3.74E-01	pCi/L	2.63E+00		U
Surface Water	Control	SW-2	28-May-13	Composite	Strontium-89	-2.45E-01	pCi/L	2.68E+00	10	U
Surface Water	Control	SW-2	28-May-13	Composite	Strontium-90	3.83E-01	pCi/L	1.77E+00	2	U
Surface Water	Control	SW-2	28-May-13	Composite	Thorium-228	2.79E+00	pCi/L	6.01E+00		U
Surface Water	Control	SW-2	28-May-13	Composite	Zinc-65	3.37E+00	pCi/L	6.15E+00	30	U
Surface Water	Control	SW-2	28-May-13	Composite	Zirconium-95	7.03E-01	pCi/L	4.64E+00	15	U
Surface Water	Indicator	SW-3	28-May-13	Composite	Actinium-228	5.95E+00	pCi/L	1.45E+01		U
Surface Water	Indicator	SW-3	28-May-13	Composite	Antimony-124	-1.42E+00	pCi/L	6.34E+00		U
Surface Water	Indicator	SW-3	28-May-13	Composite	Antimony-125	2.17E+00	pCi/L	8.70E+00		U
Surface Water	Indicator	SW-3	28-May-13	Composite	Barium-140	2.86E+00	pCi/L	4.65E+00	15	U
Surface Water	Indicator	SW-3	28-May-13	Composite	Beryllium-7	4.50E+00	pCi/L	2.69E+01		U
Surface Water	Indicator	SW-3	28-May-13	Composite	Cerium-141	3.80E+00	pCi/L	5.23E+00		U
Surface Water	Indicator	SW-3	28-May-13	Composite	Cerium-144	2.23E+00	pCi/L	2.17E+01		U
Surface Water	Indicator	SW-3	28-May-13	Composite	Cesium-134	1.14E+00	pCi/L	3.27E+00	15	U
Surface Water	Indicator	SW-3	28-May-13	Composite	Cesium-137	7.53E-01	pCi/L	3.90E+00	18	U
Surface Water	Indicator	SW-3	28-May-13	Composite	Chromium-51	-1.25E+00	pCi/L	2.84E+01		U
Surface Water	Indicator	SW-3	28-May-13	Composite	Cobalt-57	-5.30E-01	pCi/L	2.73E+00		U
Surface Water	Indicator	SW-3	28-May-13	Composite	Cobalt-58	-8.97E-01	pCi/L	2.89E+00	15	U
Surface Water	Indicator	SW-3	28-May-13	Composite	Cobalt-60	-1.33E-01	pCi/L	3.12E+00	15	U
Surface Water	Indicator	SW-3	28-May-13	Composite	Iodine-131	-1.29E+00	pCi/L	3.89E+00		U
Surface Water	Indicator	SW-3	28-May-13	Composite	Iron-59	-2.18E-01	pCi/L	5.66E+00	30	U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Surface Water	Indicator	SW-3	28-May-13	Composite	Lanthanum-140	2.86E+00	pCi/L	4.65E+00	15	U
Surface Water	Indicator	SW-3	28-May-13	Composite	Manganese-54	8.20E-01	pCi/L	3.14E+00	15	U
Surface Water	Indicator	SW-3	28-May-13	Composite	Niobium-95	-1.47E+00	pCi/L	2.70E+00	15	U
Surface Water	Indicator	SW-3	28-May-13	Composite	Potassium-40	-2.25E+01	pCi/L	3.92E+01		U
Surface Water	Indicator	SW-3	28-May-13	Composite	Ruthenium-103	-3.89E-01	pCi/L	3.25E+00		U
Surface Water	Indicator	SW-3	28-May-13	Composite	Ruthenium-106	-1.03E+00	pCi/L	2.58E+01		U
Surface Water	Indicator	SW-3	28-May-13	Composite	Selenium-75	2.21E+00	pCi/L	4.03E+00		U
Surface Water	Indicator	SW-3	28-May-13	Composite	Silver-108m	9.99E-01	pCi/L	2.91E+00		U
Surface Water	Indicator	SW-3	28-May-13	Composite	Silver-110m	-3.01E+00	pCi/L	3.00E+00		U
Surface Water	Indicator	SW-3	28-May-13	Composite	Strontium-89	-3.48E-01	pCi/L	3.26E+00	10	U
Surface Water	Indicator	SW-3	28-May-13	Composite	Strontium-90	3.97E-01	pCi/L	1.80E+00	2	U
Surface Water	Indicator	SW-3	28-May-13	Composite	Thorium-228	1.25E+00	pCi/L	6.59E+00		U
Surface Water	Indicator	SW-3	28-May-13	Composite	Zinc-65	-2.80E+00	pCi/L	5.57E+00	30	U
Surface Water	Indicator	SW-3	28-May-13	Composite	Zirconium-95	1.88E+00	pCi/L	5.78E+00	15	U
Surface Water	Control	SW-2	24-Jun-13	Composite	Actinium-228	6.39E-01	pCi/L	6.75E+00		U
Surface Water	Control	SW-2	24-Jun-13	Composite	Antimony-124	2.50E+00	pCi/L	4.95E+00		U
Surface Water	Control	SW-2	24-Jun-13	Composite	Antimony-125	1.80E+00	pCi/L	5.10E+00		U
Surface Water	Control	SW-2	24-Jun-13	Composite	Barium-140	-1.76E-01	pCi/L	3.26E+00	15	U
Surface Water	Control	SW-2	24-Jun-13	Composite	Beryllium-7	-4.19E-01	pCi/L	1.49E+01		U
Surface Water	Control	SW-2	24-Jun-13	Composite	Cerium-141	8.75E-01	pCi/L	2.93E+00		U
Surface Water	Control	SW-2	24-Jun-13	Composite	Cerium-144	3.99E+00	pCi/L	1.23E+01		U
Surface Water	Control	SW-2	24-Jun-13	Composite	Cesium-134	1.30E-01	pCi/L	1.95E+00	15	U
Surface Water	Control	SW-2	24-Jun-13	Composite	Cesium-137	1.03E+00	pCi/L	2.05E+00	18	U
Surface Water	Control	SW-2	24-Jun-13	Composite	Chromium-51	5.18E+00	pCi/L	1.74E+01		U
Surface Water	Control	SW-2	24-Jun-13	Composite	Cobalt-57	-2.64E-01	pCi/L	1.56E+00		U
Surface Water	Control	SW-2	24-Jun-13	Composite	Cobalt-58	-1.09E-01	pCi/L	1.77E+00	15	U
Surface Water	Control	SW-2	24-Jun-13	Composite	Cobalt-60	1.13E-01	pCi/L	1.79E+00	15	U
Surface Water	Control	SW-2	24-Jun-13	Composite	Iodine-131	7.76E-01	pCi/L	3.37E+00		U
Surface Water	Control	SW-2	24-Jun-13	Composite	Iron-59	6.67E-01	pCi/L	3.98E+00	30	U
Surface Water	Control	SW-2	24-Jun-13	Composite	Lanthanum-140	-1.76E-01	pCi/L	3.26E+00	15	U
Surface Water	Control	SW-2	24-Jun-13	Composite	Manganese-54	-1.91E-01	pCi/L	1.89E+00	15	U
Surface Water	Control	SW-2	24-Jun-13	Composite	Niobium-95	-4.44E-01	pCi/L	1.73E+00	15	U
Surface Water	Control	SW-2	24-Jun-13	Composite	Potassium-40	1.07E+01	pCi/L	1.51E+01		U
Surface Water	Control	SW-2	24-Jun-13	Composite	Ruthenium-103	8.87E-01	pCi/L	1.83E+00		U
Surface Water	Control	SW-2	24-Jun-13	Composite	Ruthenium-106	3.19E+00	pCi/L	1.67E+01		U
Surface Water	Control	SW-2	24-Jun-13	Composite	Selenium-75	-2.30E-01	pCi/L	2.45E+00		U
Surface Water	Control	SW-2	24-Jun-13	Composite	Silver-108m	4.17E-01	pCi/L	1.56E+00		U
Surface Water	Control	SW-2	24-Jun-13	Composite	Silver-110m	-1.10E-01	pCi/L	1.76E+00		U
Surface Water	Control	SW-2	24-Jun-13	Composite	Strontium-89	8.62E-01	pCi/L	3.18E+00	10	U
Surface Water	Control	SW-2	24-Jun-13	Composite	Strontium-90	1.57E+00	pCi/L	1.83E+00	2	U
Surface Water	Control	SW-2	24-Jun-13	Composite	Thorium-228	-3.47E+00	pCi/L	3.68E+00		U
Surface Water	Control	SW-2	24-Jun-13	Composite	Tritium	-8.42E+00	pCi/L	2.96E+02	500	U
Surface Water	Control	SW-2	24-Jun-13	Composite	Zinc-65	1.15E+00	pCi/L	3.76E+00	30	U
Surface Water	Control	SW-2	24-Jun-13	Composite	Zirconium-95	9.69E-01	pCi/L	3.39E+00	15	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Actinium-228	5.18E+00	pCi/L	8.73E+00		U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Antimony-124	-5.31E+00	pCi/L	4.66E+00		U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Antimony-125	-1.08E-01	pCi/L	5.50E+00		U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Barium-140	-9.81E-01	pCi/L	3.60E+00	15	U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Beryllium-7	1.22E+00	pCi/L	1.71E+01		U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Cerium-141	-1.26E+00	pCi/L	2.95E+00		U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Cerium-144	5.15E+00	pCi/L	1.17E+01		U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Cesium-134	-1.58E-01	pCi/L	2.45E+00	15	U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Cesium-137	-1.59E-01	pCi/L	2.24E+00	18	U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Chromium-51	-8.24E+00	pCi/L	1.80E+01		U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Cobalt-57	6.15E-01	pCi/L	1.50E+00		U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Cobalt-58	4.73E-01	pCi/L	2.12E+00	15	U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Cobalt-60	1.25E-01	pCi/L	2.37E+00	15	U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Iodine-131	-1.12E+00	pCi/L	3.44E+00		U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Iron-59	8.60E-01	pCi/L	4.69E+00	30	U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Lanthanum-140	-9.81E-01	pCi/L	3.60E+00	15	U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Manganese-54	6.60E-02	pCi/L	2.44E+00	15	U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Niobium-95	-3.40E-01	pCi/L	1.96E+00	15	U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Potassium-40	4.05E+01	pCi/L	2.21E+01		
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Ruthenium-103	7.84E-01	pCi/L	2.31E+00		U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Ruthenium-106	-4.21E+00	pCi/L	1.90E+01		U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Selenium-75	5.19E-01	pCi/L	2.52E+00		U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Silver-108m	-7.25E-01	pCi/L	1.84E+00		U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Silver-110m	6.03E-01	pCi/L	2.12E+00		U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Strontium-89	2.25E+00	pCi/L	3.63E+00	10	U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Strontium-90	7.51E-01	pCi/L	1.83E+00	2	U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Thorium-228	2.11E+00	pCi/L	4.01E+00		U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Tritium	-2.50E+01	pCi/L	2.93E+02	500	U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Zinc-65	-1.43E+00	pCi/L	4.40E+00	30	U
Surface Water	Indicator	SW-3	24-Jun-13	Composite	Zirconium-95	-2.50E+00	pCi/L	3.77E+00	15	U
Surface Water	Control	SW-2	30-Jul-13	Composite	Actinium-228	1.50E+00	pCi/L	9.12E+00		U
Surface Water	Control	SW-2	30-Jul-13	Composite	Antimony-124	1.50E+00	pCi/L	5.80E+00		U
Surface Water	Control	SW-2	30-Jul-13	Composite	Antimony-125	-3.61E-01	pCi/L	5.90E+00		U
Surface Water	Control	SW-2	30-Jul-13	Composite	Barium-140	-2.89E+00	pCi/L	4.72E+00	15	U
Surface Water	Control	SW-2	30-Jul-13	Composite	Beryllium-7	-1.13E+01	pCi/L	1.79E+01		U
Surface Water	Control	SW-2	30-Jul-13	Composite	Cerium-141	-3.78E+00	pCi/L	4.33E+00		U
Surface Water	Control	SW-2	30-Jul-13	Composite	Cerium-144	1.13E+01	pCi/L	1.42E+01		U
Surface Water	Control	SW-2	30-Jul-13	Composite	Cesium-134	1.24E-01	pCi/L	2.27E+00	15	U
Surface Water	Control	SW-2	30-Jul-13	Composite	Cesium-137	1.04E+00	pCi/L	2.18E+00	18	U
Surface Water	Control	SW-2	30-Jul-13	Composite	Chromium-51	9.39E+00	pCi/L	2.48E+01		U
Surface Water	Control	SW-2	30-Jul-13	Composite	Cobalt-57	4.60E-01	pCi/L	1.84E+00		U
Surface Water	Control	SW-2	30-Jul-13	Composite	Cobalt-58	-1.99E-01	pCi/L	2.02E+00	15	U
Surface Water	Control	SW-2	30-Jul-13	Composite	Cobalt-60	-4.76E-01	pCi/L	1.98E+00	15	U
Surface Water	Control	SW-2	30-Jul-13	Composite	Iodine-131	-9.27E-01	pCi/L	6.91E+00		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Surface Water	Control	SW-2	30-Jul-13	Composite	Iron-59	-5.88E-01	pCi/L	4.43E+00	30	U
Surface Water	Control	SW-2	30-Jul-13	Composite	Lanthanum-140	-2.89E+00	pCi/L	4.72E+00	15	U
Surface Water	Control	SW-2	30-Jul-13	Composite	Manganese-54	-1.19E+00	pCi/L	1.90E+00	15	U
Surface Water	Control	SW-2	30-Jul-13	Composite	Niobium-95	4.79E-02	pCi/L	2.26E+00	15	U
Surface Water	Control	SW-2	30-Jul-13	Composite	Potassium-40	-1.23E+01	pCi/L	2.57E+01		U
Surface Water	Control	SW-2	30-Jul-13	Composite	Ruthenium-103	1.35E-02	pCi/L	2.41E+00		U
Surface Water	Control	SW-2	30-Jul-13	Composite	Ruthenium-106	-2.57E+00	pCi/L	1.78E+01		U
Surface Water	Control	SW-2	30-Jul-13	Composite	Selenium-75	1.07E+00	pCi/L	3.10E+00		U
Surface Water	Control	SW-2	30-Jul-13	Composite	Silver-108m	-5.45E-01	pCi/L	1.81E+00		U
Surface Water	Control	SW-2	30-Jul-13	Composite	Silver-110m	9.58E-01	pCi/L	2.08E+00		U
Surface Water	Control	SW-2	30-Jul-13	Composite	Strontium-89	-3.55E+00	pCi/L	3.27E+00	10	U
Surface Water	Control	SW-2	30-Jul-13	Composite	Strontium-90	2.07E-01	pCi/L	1.76E+00	2	U
Surface Water	Control	SW-2	30-Jul-13	Composite	Thorium-228	1.99E+00	pCi/L	4.53E+00		U
Surface Water	Control	SW-2	30-Jul-13	Composite	Zinc-65	-4.33E+00	pCi/L	4.07E+00	30	U
Surface Water	Control	SW-2	30-Jul-13	Composite	Zirconium-95	3.77E+00	pCi/L	4.21E+00	15	U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Actinium-228	1.21E+01	pCi/L	1.21E+01		UI
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Antimony-124	-5.19E+00	pCi/L	4.75E+00		U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Antimony-125	7.44E-01	pCi/L	8.24E+00		U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Barium-140	5.70E-01	pCi/L	5.55E+00	15	U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Beryllium-7	1.48E+01	pCi/L	2.63E+01		U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Cerium-141	-7.29E-01	pCi/L	6.63E+00		U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Cerium-144	2.01E+00	pCi/L	2.27E+01		U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Cesium-134	1.35E+00	pCi/L	3.32E+00	15	U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Cesium-137	2.98E-01	pCi/L	3.13E+00	18	U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Chromium-51	-1.28E+00	pCi/L	3.10E+01		U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Cobalt-57	2.09E-01	pCi/L	2.91E+00		U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Cobalt-58	-1.15E+00	pCi/L	2.07E+00	15	U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Cobalt-60	1.51E+00	pCi/L	3.10E+00	15	U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Iodine-131	1.62E+00	pCi/L	5.87E+00		U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Iron-59	2.45E+00	pCi/L	6.66E+00	30	U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Lanthanum-140	5.70E-01	pCi/L	5.55E+00	15	U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Manganese-54	1.41E+00	pCi/L	3.04E+00	15	U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Niobium-95	-1.85E+00	pCi/L	2.86E+00	15	U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Potassium-40	-3.32E+01	pCi/L	3.63E+01		U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Ruthenium-103	-2.63E+00	pCi/L	3.09E+00		U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Ruthenium-106	-4.87E+00	pCi/L	2.63E+01		U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Selenium-75	1.82E+00	pCi/L	4.36E+00		U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Silver-108m	1.22E+00	pCi/L	2.62E+00		U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Silver-110m	4.72E-04	pCi/L	2.75E+00		U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Strontium-89	-2.70E+00	pCi/L	2.94E+00	10	U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Strontium-90	1.70E+00	pCi/L	1.77E+00	2	U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Thorium-228	-5.08E-01	pCi/L	6.41E+00		U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Zinc-65	-1.48E+00	pCi/L	5.65E+00	30	U
Surface Water	Indicator	SW-3	30-Jul-13	Composite	Zirconium-95	1.34E-01	pCi/L	4.68E+00	15	U

*Fermi 2 - 2013*  
*Annual Radiological Environmental Operating Report*  
*Appendix C - Environmental Data Table*

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Surface Water	Control	SW-2	27-Aug-13	Composite	Actinium-228	1.31E+00	pCi/L	8.97E+00		U
Surface Water	Control	SW-2	27-Aug-13	Composite	Antimony-124	-1.92E+00	pCi/L	4.00E+00		U
Surface Water	Control	SW-2	27-Aug-13	Composite	Antimony-125	6.16E-01	pCi/L	5.49E+00		U
Surface Water	Control	SW-2	27-Aug-13	Composite	Barium-140	5.39E-01	pCi/L	3.20E+00	15	U
Surface Water	Control	SW-2	27-Aug-13	Composite	Beryllium-7	4.75E+00	pCi/L	1.81E+01		U
Surface Water	Control	SW-2	27-Aug-13	Composite	Cerium-141	-7.74E-01	pCi/L	3.47E+00		U
Surface Water	Control	SW-2	27-Aug-13	Composite	Cerium-144	-1.86E+00	pCi/L	1.35E+01		U
Surface Water	Control	SW-2	27-Aug-13	Composite	Cesium-134	7.60E-02	pCi/L	2.27E+00	15	U
Surface Water	Control	SW-2	27-Aug-13	Composite	Cesium-137	2.07E+00	pCi/L	2.19E+00	18	U
Surface Water	Control	SW-2	27-Aug-13	Composite	Chromium-51	2.88E-01	pCi/L	1.85E+01		U
Surface Water	Control	SW-2	27-Aug-13	Composite	Cobalt-57	-7.15E-02	pCi/L	1.75E+00		U
Surface Water	Control	SW-2	27-Aug-13	Composite	Cobalt-58	9.46E-01	pCi/L	2.02E+00	15	U
Surface Water	Control	SW-2	27-Aug-13	Composite	Cobalt-60	-4.77E-01	pCi/L	2.06E+00	15	U
Surface Water	Control	SW-2	27-Aug-13	Composite	Iodine-131	-4.35E-01	pCi/L	2.98E+00		U
Surface Water	Control	SW-2	27-Aug-13	Composite	Iron-59	-2.60E+00	pCi/L	3.93E+00	30	U
Surface Water	Control	SW-2	27-Aug-13	Composite	Lanthanum-140	5.39E-01	pCi/L	3.20E+00	15	U
Surface Water	Control	SW-2	27-Aug-13	Composite	Manganese-54	-9.02E-01	pCi/L	1.75E+00	15	U
Surface Water	Control	SW-2	27-Aug-13	Composite	Niobium-95	8.87E-02	pCi/L	2.03E+00	15	U
Surface Water	Control	SW-2	27-Aug-13	Composite	Potassium-40	-3.57E+00	pCi/L	2.91E+01		U
Surface Water	Control	SW-2	27-Aug-13	Composite	Ruthenium-103	-3.13E-01	pCi/L	2.21E+00		U
Surface Water	Control	SW-2	27-Aug-13	Composite	Ruthenium-106	-2.24E+00	pCi/L	1.70E+01		U
Surface Water	Control	SW-2	27-Aug-13	Composite	Selenium-75	-5.11E-01	pCi/L	2.70E+00		U
Surface Water	Control	SW-2	27-Aug-13	Composite	Silver-108m	7.97E-01	pCi/L	1.84E+00		U
Surface Water	Control	SW-2	27-Aug-13	Composite	Silver-110m	3.70E-02	pCi/L	1.98E+00		U
Surface Water	Control	SW-2	27-Aug-13	Composite	Strontium-89	-1.95E+00	pCi/L	2.69E+00	10	U
Surface Water	Control	SW-2	27-Aug-13	Composite	Strontium-90	4.12E-01	pCi/L	1.71E+00	2	U
Surface Water	Control	SW-2	27-Aug-13	Composite	Thorium-228	1.76E+00	pCi/L	3.66E+00		U
Surface Water	Control	SW-2	27-Aug-13	Composite	Zinc-65	-3.57E+00	pCi/L	3.78E+00	30	U
Surface Water	Control	SW-2	27-Aug-13	Composite	Zirconium-95	-5.99E-01	pCi/L	3.90E+00	15	U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Actinium-228	-6.54E+00	pCi/L	8.56E+00		U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Antimony-124	1.64E-01	pCi/L	4.89E+00		U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Antimony-125	-2.15E+00	pCi/L	5.23E+00		U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Barium-140	-5.39E-01	pCi/L	2.79E+00	15	U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Beryllium-7	2.93E+00	pCi/L	1.74E+01		U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Cerium-141	-1.34E+00	pCi/L	3.23E+00		U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Cerium-144	6.41E+00	pCi/L	1.41E+01		U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Cesium-134	-1.32E-01	pCi/L	2.19E+00	15	U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Cesium-137	1.02E-01	pCi/L	2.20E+00	18	U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Chromium-51	1.94E+00	pCi/L	1.81E+01		U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Cobalt-57	-4.95E-01	pCi/L	1.72E+00		U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Cobalt-58	1.25E+00	pCi/L	1.98E+00	15	U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Cobalt-60	3.39E-01	pCi/L	2.07E+00	15	U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Iodine-131	-5.90E-01	pCi/L	3.02E+00		U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Iron-59	-1.14E-01	pCi/L	3.78E+00	30	U

*Fermi 2 - 2013*  
*Annual Radiological Environmental Operating Report*  
*Appendix C - Environmental Data Table*

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Lanthanum-140	-5.39E-01	pCi/L	2.79E+00	15	U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Manganese-54	-1.02E+00	pCi/L	1.79E+00	15	U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Niobium-95	1.04E+00	pCi/L	2.04E+00	15	U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Potassium-40	5.77E+00	pCi/L	2.07E+01		U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Ruthenium-103	-2.09E-01	pCi/L	1.95E+00		U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Ruthenium-106	5.56E+00	pCi/L	1.78E+01		U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Selenium-75	-2.48E-01	pCi/L	2.68E+00		U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Silver-108m	1.64E-01	pCi/L	1.87E+00		U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Silver-110m	-9.92E-02	pCi/L	1.95E+00		U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Strontium-89	-2.21E+00	pCi/L	2.25E+00	10	U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Strontium-90	5.41E-01	pCi/L	1.60E+00	2	U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Thorium-228	-9.11E-01	pCi/L	4.33E+00		U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Zinc-65	1.79E-01	pCi/L	4.00E+00	30	U
Surface Water	Indicator	SW-3	27-Aug-13	Composite	Zirconium-95	2.54E+00	pCi/L	3.75E+00	15	U
Surface Water	Control	SW-2	24-Sep-13	Composite	Actinium-228	-3.08E+00	pCi/L	6.81E+00		U
Surface Water	Control	SW-2	24-Sep-13	Composite	Antimony-124	1.38E+00	pCi/L	3.71E+00		U
Surface Water	Control	SW-2	24-Sep-13	Composite	Antimony-125	1.62E+00	pCi/L	4.27E+00		U
Surface Water	Control	SW-2	24-Sep-13	Composite	Barium-140	-2.31E+00	pCi/L	2.10E+00	15	U
Surface Water	Control	SW-2	24-Sep-13	Composite	Beryllium-7	-1.69E+00	pCi/L	1.30E+01		U
Surface Water	Control	SW-2	24-Sep-13	Composite	Cerium-141	5.36E-01	pCi/L	2.70E+00		U
Surface Water	Control	SW-2	24-Sep-13	Composite	Cerium-144	-1.08E+00	pCi/L	1.09E+01		U
Surface Water	Control	SW-2	24-Sep-13	Composite	Cesium-134	1.38E+00	pCi/L	1.85E+00	15	U
Surface Water	Control	SW-2	24-Sep-13	Composite	Cesium-137	-6.87E-02	pCi/L	1.71E+00	18	U
Surface Water	Control	SW-2	24-Sep-13	Composite	Chromium-51	3.12E+00	pCi/L	1.38E+01		U
Surface Water	Control	SW-2	24-Sep-13	Composite	Cobalt-57	-3.07E-01	pCi/L	1.37E+00		U
Surface Water	Control	SW-2	24-Sep-13	Composite	Cobalt-58	8.08E-03	pCi/L	1.50E+00	15	U
Surface Water	Control	SW-2	24-Sep-13	Composite	Cobalt-60	3.69E-01	pCi/L	1.60E+00	15	U
Surface Water	Control	SW-2	24-Sep-13	Composite	Iodine-131	1.34E+00	pCi/L	2.00E+00		U
Surface Water	Control	SW-2	24-Sep-13	Composite	Iron-59	1.57E+00	pCi/L	3.22E+00	30	U
Surface Water	Control	SW-2	24-Sep-13	Composite	Lanthanum-140	-2.31E+00	pCi/L	2.10E+00	15	U
Surface Water	Control	SW-2	24-Sep-13	Composite	Manganese-54	-1.24E-01	pCi/L	1.46E+00	15	U
Surface Water	Control	SW-2	24-Sep-13	Composite	Niobium-95	8.80E-01	pCi/L	1.67E+00	15	U
Surface Water	Control	SW-2	24-Sep-13	Composite	Potassium-40	-1.61E+01	pCi/L	2.21E+01		U
Surface Water	Control	SW-2	24-Sep-13	Composite	Ruthenium-103	-1.13E+00	pCi/L	1.44E+00		U
Surface Water	Control	SW-2	24-Sep-13	Composite	Ruthenium-106	2.39E+00	pCi/L	1.46E+01		U
Surface Water	Control	SW-2	24-Sep-13	Composite	Selenium-75	-4.47E-01	pCi/L	2.06E+00		U
Surface Water	Control	SW-2	24-Sep-13	Composite	Silver-108m	8.22E-01	pCi/L	1.48E+00		U
Surface Water	Control	SW-2	24-Sep-13	Composite	Silver-110m	-2.47E-02	pCi/L	1.51E+00		U
Surface Water	Control	SW-2	24-Sep-13	Composite	Strontium-89	-1.32E+00	pCi/L	2.04E+00	10	U
Surface Water	Control	SW-2	24-Sep-13	Composite	Strontium-90	-2.22E-01	pCi/L	1.77E+00	2	U
Surface Water	Control	SW-2	24-Sep-13	Composite	Thorium-228	2.04E+00	pCi/L	3.40E+00		U
Surface Water	Control	SW-2	24-Sep-13	Composite	Tritium	-4.42E+01	pCi/L	4.07E+02	500	U
Surface Water	Control	SW-2	24-Sep-13	Composite	Zinc-65	1.89E-01	pCi/L	3.19E+00	30	U
Surface Water	Control	SW-2	24-Sep-13	Composite	Zirconium-95	-4.35E-01	pCi/L	2.66E+00	15	U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Actinium-228	2.58E+00	pCi/L	7.99E+00		U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Antimony-124	5.65E-01	pCi/L	4.13E+00		U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Antimony-125	1.79E+00	pCi/L	4.87E+00		U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Barium-140	-3.14E-01	pCi/L	2.33E+00	15	U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Beryllium-7	7.12E-02	pCi/L	1.42E+01		U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Cerium-141	5.37E-01	pCi/L	3.13E+00		U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Cerium-144	-5.81E+00	pCi/L	1.23E+01		U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Cesium-134	-3.96E-02	pCi/L	1.87E+00	15	U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Cesium-137	-9.76E-02	pCi/L	1.76E+00	18	U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Chromium-51	7.99E+00	pCi/L	1.62E+01		U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Cobalt-57	6.25E-01	pCi/L	1.66E+00		U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Cobalt-58	-5.54E-01	pCi/L	1.52E+00	15	U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Cobalt-60	-2.29E-01	pCi/L	1.69E+00	15	U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Iodine-131	1.05E+00	pCi/L	2.44E+00		U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Iron-59	2.89E-01	pCi/L	3.44E+00	30	U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Lanthanum-140	-3.14E-01	pCi/L	2.33E+00	15	U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Manganese-54	9.01E-01	pCi/L	1.78E+00	15	U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Niobium-95	1.51E+00	pCi/L	1.77E+00	15	U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Potassium-40	1.58E+01	pCi/L	1.58E+01		UI
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Ruthenium-103	-8.00E-01	pCi/L	1.73E+00		U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Ruthenium-106	1.14E+01	pCi/L	1.57E+01		U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Selenium-75	5.17E-01	pCi/L	2.45E+00		U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Silver-108m	4.88E-01	pCi/L	1.51E+00		U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Silver-110m	-1.30E-01	pCi/L	1.48E+00		U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Strontium-89	-4.58E-01	pCi/L	1.76E+00	10	U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Strontium-90	1.69E-01	pCi/L	1.79E+00	2	U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Thorium-228	6.28E-01	pCi/L	3.73E+00		U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Tritium	-1.35E+02	pCi/L	4.05E+02	500	U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Zinc-65	-3.63E-01	pCi/L	3.21E+00	30	U
Surface Water	Indicator	SW-3	24-Sep-13	Composite	Zirconium-95	-2.65E-01	pCi/L	2.69E+00	15	U
Surface Water	Control	SW-2	29-Oct-13	Composite	Actinium-228	3.52E-01	pCi/L	7.16E+00		U
Surface Water	Control	SW-2	29-Oct-13	Composite	Antimony-124	-7.46E-01	pCi/L	3.86E+00		U
Surface Water	Control	SW-2	29-Oct-13	Composite	Antimony-125	-9.26E-01	pCi/L	5.39E+00		U
Surface Water	Control	SW-2	29-Oct-13	Composite	Barium-140	-8.09E-01	pCi/L	2.38E+00	15	U
Surface Water	Control	SW-2	29-Oct-13	Composite	Beryllium-7	1.34E+01	pCi/L	1.64E+01		U
Surface Water	Control	SW-2	29-Oct-13	Composite	Cerium-141	8.96E-01	pCi/L	3.35E+00		U
Surface Water	Control	SW-2	29-Oct-13	Composite	Cerium-144	-6.11E+00	pCi/L	1.29E+01		U
Surface Water	Control	SW-2	29-Oct-13	Composite	Cesium-134	1.03E+00	pCi/L	2.17E+00	15	U
Surface Water	Control	SW-2	29-Oct-13	Composite	Cesium-137	8.38E-01	pCi/L	2.22E+00	18	U
Surface Water	Control	SW-2	29-Oct-13	Composite	Chromium-51	2.05E+00	pCi/L	1.67E+01		U
Surface Water	Control	SW-2	29-Oct-13	Composite	Cobalt-57	5.50E-01	pCi/L	1.77E+00		U
Surface Water	Control	SW-2	29-Oct-13	Composite	Cobalt-58	2.73E-01	pCi/L	1.82E+00	15	U
Surface Water	Control	SW-2	29-Oct-13	Composite	Cobalt-60	-2.25E+00	pCi/L	1.90E+00	15	U
Surface Water	Control	SW-2	29-Oct-13	Composite	Iodine-131	1.43E+00	pCi/L	2.51E+00		U



Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Surface Water	Control	SW-2	29-Oct-13	Composite	Iron-59	9.33E-01	pCi/L	3.29E+00	30	U
Surface Water	Control	SW-2	29-Oct-13	Composite	Lanthanum-140	-8.09E-01	pCi/L	2.38E+00	15	U
Surface Water	Control	SW-2	29-Oct-13	Composite	Manganese-54	5.44E-01	pCi/L	1.92E+00	15	U
Surface Water	Control	SW-2	29-Oct-13	Composite	Niobium-95	8.90E-01	pCi/L	2.03E+00	15	U
Surface Water	Control	SW-2	29-Oct-13	Composite	Potassium-40	1.12E+01	pCi/L	1.95E+01		U
Surface Water	Control	SW-2	29-Oct-13	Composite	Ruthenium-103	-7.02E-01	pCi/L	1.79E+00		U
Surface Water	Control	SW-2	29-Oct-13	Composite	Ruthenium-106	1.01E+01	pCi/L	1.94E+01		U
Surface Water	Control	SW-2	29-Oct-13	Composite	Selenium-75	-2.64E-01	pCi/L	2.49E+00		U
Surface Water	Control	SW-2	29-Oct-13	Composite	Silver-108m	-9.73E-02	pCi/L	1.78E+00		U
Surface Water	Control	SW-2	29-Oct-13	Composite	Silver-110m	-3.54E-01	pCi/L	1.83E+00		U
Surface Water	Control	SW-2	29-Oct-13	Composite	Strontium-89	-6.67E-02	pCi/L	2.28E+00	10	U
Surface Water	Control	SW-2	29-Oct-13	Composite	Strontium-90	1.75E+00	pCi/L	1.75E+00	2	U
Surface Water	Control	SW-2	29-Oct-13	Composite	Thorium-228	1.62E+00	pCi/L	4.40E+00		U
Surface Water	Control	SW-2	29-Oct-13	Composite	Zinc-65	-1.89E-01	pCi/L	3.60E+00	30	U
Surface Water	Control	SW-2	29-Oct-13	Composite	Zirconium-95	9.94E-01	pCi/L	3.32E+00	15	U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Actinium-228	6.25E+00	pCi/L	8.83E+00		U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Antimony-124	-2.46E+00	pCi/L	3.41E+00		U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Antimony-125	-1.67E+00	pCi/L	5.49E+00		U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Barium-140	4.39E-01	pCi/L	2.61E+00	15	U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Beryllium-7	-1.84E+00	pCi/L	1.63E+01		U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Cerium-141	5.28E-02	pCi/L	3.44E+00		U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Cerium-144	1.57E+00	pCi/L	1.42E+01		U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Cesium-134	-1.34E+00	pCi/L	1.83E+00	15	U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Cesium-137	-4.95E-01	pCi/L	1.91E+00	18	U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Chromium-51	1.42E+01	pCi/L	1.83E+01		U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Cobalt-57	1.61E-01	pCi/L	1.86E+00		U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Cobalt-58	-3.78E-01	pCi/L	1.74E+00	15	U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Cobalt-60	2.05E-01	pCi/L	2.05E+00	15	U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Iodine-131	5.11E-01	pCi/L	2.45E+00		U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Iron-59	1.21E+00	pCi/L	3.42E+00	30	U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Lanthanum-140	4.39E-01	pCi/L	2.61E+00	15	U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Manganese-54	9.97E-01	pCi/L	2.05E+00	15	U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Niobium-95	-1.10E+00	pCi/L	1.80E+00	15	U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Potassium-40	-2.97E+00	pCi/L	2.97E+01		U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Ruthenium-103	-7.05E-01	pCi/L	1.94E+00		U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Ruthenium-106	1.16E+00	pCi/L	1.69E+01		U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Selenium-75	1.04E+00	pCi/L	2.78E+00		U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Silver-108m	-4.34E-01	pCi/L	1.77E+00		U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Silver-110m	2.17E-01	pCi/L	1.76E+00		U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Strontium-89	-1.44E+00	pCi/L	2.23E+00	10	U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Strontium-90	-1.54E-01	pCi/L	1.75E+00	2	U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Thorium-228	1.31E+00	pCi/L	4.58E+00		U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Zinc-65	2.95E+00	pCi/L	3.71E+00	30	U
Surface Water	Indicator	SW-3	29-Oct-13	Composite	Zirconium-95	1.12E+00	pCi/L	3.24E+00	15	U

*Fermi 2 - 2013*  
*Annual Radiological Environmental Operating Report*  
*Appendix C - Environmental Data Table*

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Surface Water	Control	SW-2	26-Nov-13	Composite	Actinium-228	1.09E+01	pCi/L	6.80E+00		
Surface Water	Control	SW-2	26-Nov-13	Composite	Antimony-124	1.44E+00	pCi/L	4.56E+00		U
Surface Water	Control	SW-2	26-Nov-13	Composite	Antimony-125	-1.85E+00	pCi/L	5.30E+00		U
Surface Water	Control	SW-2	26-Nov-13	Composite	Barium-140	1.36E+00	pCi/L	3.58E+00	15	U
Surface Water	Control	SW-2	26-Nov-13	Composite	Beryllium-7	-3.19E+00	pCi/L	1.71E+01		U
Surface Water	Control	SW-2	26-Nov-13	Composite	Cerium-141	-2.56E+00	pCi/L	4.10E+00		U
Surface Water	Control	SW-2	26-Nov-13	Composite	Cerium-144	-3.28E+00	pCi/L	1.36E+01		U
Surface Water	Control	SW-2	26-Nov-13	Composite	Cesium-134	4.33E-01	pCi/L	2.13E+00	15	U
Surface Water	Control	SW-2	26-Nov-13	Composite	Cesium-137	2.44E-01	pCi/L	2.04E+00	18	U
Surface Water	Control	SW-2	26-Nov-13	Composite	Chromium-51	-6.47E+00	pCi/L	1.97E+01		U
Surface Water	Control	SW-2	26-Nov-13	Composite	Cobalt-57	-3.67E-01	pCi/L	1.77E+00		U
Surface Water	Control	SW-2	26-Nov-13	Composite	Cobalt-58	-3.29E-01	pCi/L	1.86E+00	15	U
Surface Water	Control	SW-2	26-Nov-13	Composite	Cobalt-60	5.05E-01	pCi/L	2.11E+00	15	U
Surface Water	Control	SW-2	26-Nov-13	Composite	Iodine-131	1.84E+00	pCi/L	4.09E+00		U
Surface Water	Control	SW-2	26-Nov-13	Composite	Iron-59	-1.26E+00	pCi/L	3.36E+00	30	U
Surface Water	Control	SW-2	26-Nov-13	Composite	Lanthanum-140	1.36E+00	pCi/L	3.58E+00	15	U
Surface Water	Control	SW-2	26-Nov-13	Composite	Manganese-54	-7.52E-01	pCi/L	1.62E+00	15	U
Surface Water	Control	SW-2	26-Nov-13	Composite	Niobium-95	5.48E-01	pCi/L	2.07E+00	15	U
Surface Water	Control	SW-2	26-Nov-13	Composite	Potassium-40	1.13E+01	pCi/L	1.43E+01		U
Surface Water	Control	SW-2	26-Nov-13	Composite	Ruthenium-103	-5.79E-01	pCi/L	2.04E+00		U
Surface Water	Control	SW-2	26-Nov-13	Composite	Ruthenium-106	-3.54E+00	pCi/L	1.67E+01		U
Surface Water	Control	SW-2	26-Nov-13	Composite	Selenium-75	-1.23E+00	pCi/L	2.68E+00		U
Surface Water	Control	SW-2	26-Nov-13	Composite	Silver-108m	-5.36E-01	pCi/L	1.72E+00		U
Surface Water	Control	SW-2	26-Nov-13	Composite	Silver-110m	4.85E-01	pCi/L	1.94E+00		U
Surface Water	Control	SW-2	26-Nov-13	Composite	Strontium-89	-5.01E+00	pCi/L	3.97E+00	10	U
Surface Water	Control	SW-2	26-Nov-13	Composite	Strontium-90	5.91E-01	pCi/L	1.84E+00	2	U
Surface Water	Control	SW-2	26-Nov-13	Composite	Thorium-228	4.64E+00	pCi/L	3.83E+00		
Surface Water	Control	SW-2	26-Nov-13	Composite	Zinc-65	1.01E+00	pCi/L	3.93E+00	30	U
Surface Water	Control	SW-2	26-Nov-13	Composite	Zirconium-95	1.39E-01	pCi/L	3.45E+00	15	U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Actinium-228	-6.79E+00	pCi/L	7.36E+00		U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Antimony-124	5.15E-01	pCi/L	4.19E+00		U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Antimony-125	-1.70E-01	pCi/L	5.01E+00		U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Barium-140	-1.28E+00	pCi/L	3.19E+00	15	U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Beryllium-7	3.06E+00	pCi/L	1.71E+01		U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Cerium-141	-1.71E+00	pCi/L	3.67E+00		U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Cerium-144	6.99E+00	pCi/L	1.33E+01		U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Cesium-134	3.44E-01	pCi/L	2.09E+00	15	U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Cesium-137	1.90E+00	pCi/L	1.93E+00	18	U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Chromium-51	-1.85E-02	pCi/L	1.86E+01		U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Cobalt-57	-7.02E-01	pCi/L	1.63E+00		U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Cobalt-58	9.25E-01	pCi/L	1.88E+00	15	U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Cobalt-60	2.89E-01	pCi/L	1.96E+00	15	U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Iodine-131	-2.74E+00	pCi/L	3.39E+00		U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Iron-59	-1.60E+00	pCi/L	3.52E+00	30	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Lanthanum-140	-1.28E+00	pCi/L	3.19E+00	15	U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Manganese-54	-2.88E-01	pCi/L	1.72E+00	15	U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Niobium-95	1.41E-02	pCi/L	1.85E+00	15	U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Potassium-40	1.24E+00	pCi/L	1.87E+01		U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Ruthenium-103	-4.22E-01	pCi/L	2.00E+00		U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Ruthenium-106	6.03E+00	pCi/L	1.77E+01		U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Selenium-75	-1.07E+00	pCi/L	2.57E+00		U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Silver-108m	5.33E-02	pCi/L	1.71E+00		U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Silver-110m	4.04E-01	pCi/L	1.74E+00		U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Strontium-89	-2.07E+00	pCi/L	4.24E+00	10	U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Strontium-90	4.67E-01	pCi/L	1.86E+00	2	U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Thorium-228	2.51E+00	pCi/L	3.62E+00		U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Zinc-65	5.44E-01	pCi/L	4.12E+00	30	U
Surface Water	Indicator	SW-3	26-Nov-13	Composite	Zirconium-95	-4.10E-01	pCi/L	3.47E+00	15	U
Surface Water	Control	SW-2	30-Dec-13	Composite	Actinium-228	4.74E+00	pCi/L	1.63E+01		U
Surface Water	Control	SW-2	30-Dec-13	Composite	Antimony-124	2.60E+00	pCi/L	8.63E+00		U
Surface Water	Control	SW-2	30-Dec-13	Composite	Antimony-125	4.54E+00	pCi/L	1.03E+01		U
Surface Water	Control	SW-2	30-Dec-13	Composite	Barium-140	-9.82E-01	pCi/L	5.43E+00	15	U
Surface Water	Control	SW-2	30-Dec-13	Composite	Beryllium-7	4.41E-02	pCi/L	3.18E+01		U
Surface Water	Control	SW-2	30-Dec-13	Composite	Cerium-141	4.45E-01	pCi/L	6.37E+00		U
Surface Water	Control	SW-2	30-Dec-13	Composite	Cerium-144	1.00E+01	pCi/L	2.40E+01		U
Surface Water	Control	SW-2	30-Dec-13	Composite	Cesium-134	-1.81E+00	pCi/L	3.82E+00	15	U
Surface Water	Control	SW-2	30-Dec-13	Composite	Cesium-137	7.01E-01	pCi/L	3.89E+00	18	U
Surface Water	Control	SW-2	30-Dec-13	Composite	Chromium-51	3.55E+01	pCi/L	3.69E+01		U
Surface Water	Control	SW-2	30-Dec-13	Composite	Cobalt-57	9.10E-01	pCi/L	3.15E+00		U
Surface Water	Control	SW-2	30-Dec-13	Composite	Cobalt-58	-1.18E+00	pCi/L	3.20E+00	15	U
Surface Water	Control	SW-2	30-Dec-13	Composite	Cobalt-60	-6.31E-01	pCi/L	3.51E+00	15	U
Surface Water	Control	SW-2	30-Dec-13	Composite	Iodine-131	8.52E-01	pCi/L	7.37E+00		U
Surface Water	Control	SW-2	30-Dec-13	Composite	Iron-59	1.19E-01	pCi/L	7.59E+00	30	U
Surface Water	Control	SW-2	30-Dec-13	Composite	Lanthanum-140	-9.82E-01	pCi/L	5.43E+00	15	U
Surface Water	Control	SW-2	30-Dec-13	Composite	Manganese-54	-7.59E-01	pCi/L	3.35E+00	15	U
Surface Water	Control	SW-2	30-Dec-13	Composite	Niobium-95	-3.43E-01	pCi/L	4.09E+00	15	U
Surface Water	Control	SW-2	30-Dec-13	Composite	Potassium-40	-2.21E+01	pCi/L	5.06E+01		U
Surface Water	Control	SW-2	30-Dec-13	Composite	Ruthenium-103	-8.24E-01	pCi/L	3.71E+00		U
Surface Water	Control	SW-2	30-Dec-13	Composite	Ruthenium-106	-1.04E+01	pCi/L	3.02E+01		U
Surface Water	Control	SW-2	30-Dec-13	Composite	Selenium-75	-1.94E+00	pCi/L	4.72E+00		U
Surface Water	Control	SW-2	30-Dec-13	Composite	Silver-108m	2.64E+00	pCi/L	3.78E+00		U
Surface Water	Control	SW-2	30-Dec-13	Composite	Silver-110m	4.02E-01	pCi/L	3.29E+00		U
Surface Water	Control	SW-2	30-Dec-13	Composite	Strontium-89	1.49E+00	pCi/L	2.14E+00	10	U
Surface Water	Control	SW-2	30-Dec-13	Composite	Strontium-90	6.47E-01	pCi/L	1.72E+00	2	U
Surface Water	Control	SW-2	30-Dec-13	Composite	Thorium-228	1.99E+00	pCi/L	6.65E+00		U
Surface Water	Control	SW-2	30-Dec-13	Composite	Tritium	3.46E+01	pCi/L	3.81E+02	500	U
Surface Water	Control	SW-2	30-Dec-13	Composite	Zinc-65	-3.03E+00	pCi/L	7.80E+00	30	U
Surface Water	Control	SW-2	30-Dec-13	Composite	Zirconium-95	-2.62E+00	pCi/L	6.32E+00	15	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Actinium-228	-4.33E-01	pCi/L	1.32E+01		U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Antimony-124	2.85E+00	pCi/L	9.65E+00		U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Antimony-125	3.03E-01	pCi/L	7.65E+00		U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Barium-140	-1.55E+00	pCi/L	4.69E+00	15	U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Beryllium-7	2.58E+00	pCi/L	2.57E+01		U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Cerium-141	4.32E+00	pCi/L	5.69E+00		U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Cerium-144	8.53E+00	pCi/L	2.35E+01		U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Cesium-134	5.20E-01	pCi/L	3.34E+00	15	U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Cesium-137	1.76E+00	pCi/L	3.35E+00	18	U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Chromium-51	-3.12E+00	pCi/L	3.07E+01		U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Cobalt-57	-6.53E-01	pCi/L	2.71E+00		U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Cobalt-58	-4.47E-01	pCi/L	3.20E+00	15	U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Cobalt-60	1.81E-01	pCi/L	3.28E+00	15	U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Iodine-131	3.68E-01	pCi/L	5.73E+00		U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Iron-59	1.30E-01	pCi/L	6.49E+00	30	U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Lanthanum-140	-1.55E+00	pCi/L	4.69E+00	15	U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Manganese-54	4.05E-01	pCi/L	3.13E+00	15	U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Niobium-95	-2.53E-01	pCi/L	3.25E+00	15	U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Potassium-40	2.89E+01	pCi/L	2.89E+01		UI
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Ruthenium-103	-1.69E+00	pCi/L	2.99E+00		U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Ruthenium-106	-3.75E+00	pCi/L	2.88E+01		U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Selenium-75	3.72E+00	pCi/L	4.31E+00		U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Silver-108m	1.42E+00	pCi/L	2.82E+00		U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Silver-110m	2.07E-01	pCi/L	3.06E+00		U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Strontium-89	1.67E+00	pCi/L	2.00E+00	10	U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Strontium-90	-1.85E-01	pCi/L	1.68E+00	2	U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Thorium-228	1.61E+00	pCi/L	7.47E+00		U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Tritium	1.76E+02	pCi/L	3.78E+02	500	U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Zinc-65	1.33E+00	pCi/L	6.75E+00	30	U
Surface Water	Indicator	SW-3	30-Dec-13	Composite	Zirconium-95	-1.69E+00	pCi/L	5.49E+00	15	U
TLD Analysis (Offsite)	Indicator	T01	12-Jan-13	Quarterly	Exposure	1.34E+01	mR/Std Qtr			1
TLD Analysis (Offsite)	Indicator	T02	12-Jan-13	Quarterly	Exposure	1.27E+01	mR/Std Qtr			1
TLD Analysis (Offsite)	Indicator	T03	12-Jan-13	Quarterly	Exposure	1.30E+01	mR/Std Qtr			1
TLD Analysis (Offsite)	Indicator	T04	12-Jan-13	Quarterly	Exposure	1.45E+01	mR/Std Qtr			1
TLD Analysis (Offsite)	Indicator	T05	12-Jan-13	Quarterly	Exposure			(b)		1
TLD Analysis (Offsite)	Indicator	T06	12-Jan-13	Quarterly	Exposure	1.52E+01	mR/Std Qtr			1
TLD Analysis (Offsite)	Control	T07	12-Jan-13	Quarterly	Exposure	1.58E+01	mR/Std Qtr			1
TLD Analysis (Offsite)	Indicator	T08	12-Jan-13	Quarterly	Exposure	1.57E+01	mR/Std Qtr			1
TLD Analysis (Offsite)	Indicator	T09	12-Jan-13	Quarterly	Exposure	1.50E+01	mR/Std Qtr			1
TLD Analysis (Offsite)	Indicator	T10	12-Jan-13	Quarterly	Exposure	1.47E+01	mR/Std Qtr			1
TLD Analysis (Offsite)	Indicator	T11	12-Jan-13	Quarterly	Exposure	1.39E+01	mR/Std Qtr			1
TLD Analysis (Offsite)	Indicator	T12	12-Jan-13	Quarterly	Exposure	1.31E+01	mR/Std Qtr			1
TLD Analysis (Offsite)	Indicator	T13	12-Jan-13	Quarterly	Exposure	1.53E+01	mR/Std Qtr			1
TLD Analysis (Offsite)	Indicator	T14	12-Jan-13	Quarterly	Exposure	1.63E+01	mR/Std Qtr			1

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
TLD Analysis (Offsite)	Indicator	T15	12-Jan-13	Quarterly	Exposure	1.34E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T16	12-Jan-13	Quarterly	Exposure	1.74E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T17	12-Jan-13	Quarterly	Exposure	1.30E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T18	12-Jan-13	Quarterly	Exposure	1.41E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T19	12-Jan-13	Quarterly	Exposure	1.57E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T20	12-Jan-13	Quarterly	Exposure	1.60E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T21	12-Jan-13	Quarterly	Exposure	1.36E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T22	12-Jan-13	Quarterly	Exposure	1.52E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T23	12-Jan-13	Quarterly	Exposure	1.52E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T24	12-Jan-13	Quarterly	Exposure	1.39E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T25	12-Jan-13	Quarterly	Exposure	1.76E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T26	12-Jan-13	Quarterly	Exposure	1.79E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T27	12-Jan-13	Quarterly	Exposure	1.23E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Control	T28	12-Jan-13	Quarterly	Exposure	1.31E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Control	T29	12-Jan-13	Quarterly	Exposure	1.26E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T30	12-Jan-13	Quarterly	Exposure	1.31E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Control	T31	12-Jan-13	Quarterly	Exposure	1.42E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T32	12-Jan-13	Quarterly	Exposure	1.56E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T33	12-Jan-13	Quarterly	Exposure	1.31E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T34	12-Jan-13	Quarterly	Exposure	1.38E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T35	12-Jan-13	Quarterly	Exposure	1.34E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T36	12-Jan-13	Quarterly	Exposure	1.51E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T37	12-Jan-13	Quarterly	Exposure	1.47E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T38	12-Jan-13	Quarterly	Exposure	1.60E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T49	12-Jan-13	Quarterly	Exposure	1.90E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T50	12-Jan-13	Quarterly	Exposure	1.58E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T55	12-Jan-13	Quarterly	Exposure	1.60E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T56	12-Jan-13	Quarterly	Exposure	1.41E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T57	12-Jan-13	Quarterly	Exposure	1.61E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T58	12-Jan-13	Quarterly	Exposure	1.32E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T59	12-Jan-13	Quarterly	Exposure	1.41E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T60	12-Jan-13	Quarterly	Exposure	1.50E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T61	12-Jan-13	Quarterly	Exposure	1.55E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T62	12-Jan-13	Quarterly	Exposure	1.53E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T63	12-Jan-13	Quarterly	Exposure	1.34E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T68	12-Jan-13	Quarterly	Exposure	1.71E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T69	12-Jan-13	Quarterly	Exposure	1.66E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T70	12-Jan-13	Quarterly	Exposure	1.51E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T71	12-Jan-13	Quarterly	Exposure	1.66E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T01	12-Apr-13	Quarterly	Exposure	1.23E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T02	12-Apr-13	Quarterly	Exposure	1.22E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T03	12-Apr-13	Quarterly	Exposure	1.22E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T04	12-Apr-13	Quarterly	Exposure	1.29E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T05	12-Apr-13	Quarterly	Exposure	1.40E+01	mR/Std Qtr		1	

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
TLD Analysis (Offsite)	Indicator	T06	12-Apr-13	Quarterly	Exposure	1.40E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Control	T07	12-Apr-13	Quarterly	Exposure	1.47E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T08	12-Apr-13	Quarterly	Exposure	1.49E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T09	12-Apr-13	Quarterly	Exposure	1.38E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T10	12-Apr-13	Quarterly	Exposure	1.42E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T11	12-Apr-13	Quarterly	Exposure	1.22E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T12	12-Apr-13	Quarterly	Exposure	1.18E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T13	12-Apr-13	Quarterly	Exposure	1.53E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T14	12-Apr-13	Quarterly	Exposure	1.48E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T15	12-Apr-13	Quarterly	Exposure	1.21E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T16	12-Apr-13	Quarterly	Exposure	1.69E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T17	12-Apr-13	Quarterly	Exposure	1.20E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T18	12-Apr-13	Quarterly	Exposure	1.31E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T19	12-Apr-13	Quarterly	Exposure	1.46E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T20	12-Apr-13	Quarterly	Exposure	1.46E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T21	12-Apr-13	Quarterly	Exposure	1.27E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T22	12-Apr-13	Quarterly	Exposure	1.37E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T23	12-Apr-13	Quarterly	Exposure	1.32E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T24	12-Apr-13	Quarterly	Exposure	1.15E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T25	12-Apr-13	Quarterly	Exposure	1.46E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T26	12-Apr-13	Quarterly	Exposure	1.57E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T27	12-Apr-13	Quarterly	Exposure	1.10E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Control	T28	12-Apr-13	Quarterly	Exposure	1.20E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Control	T29	12-Apr-13	Quarterly	Exposure	1.14E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T30	12-Apr-13	Quarterly	Exposure	1.16E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Control	T31	12-Apr-13	Quarterly	Exposure	1.29E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T32	12-Apr-13	Quarterly	Exposure	1.42E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T33	12-Apr-13	Quarterly	Exposure	1.17E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T34	12-Apr-13	Quarterly	Exposure	1.27E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T35	12-Apr-13	Quarterly	Exposure	1.29E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T36	12-Apr-13	Quarterly	Exposure	1.31E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T37	12-Apr-13	Quarterly	Exposure	1.38E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T38	12-Apr-13	Quarterly	Exposure	1.54E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T49	12-Apr-13	Quarterly	Exposure	1.96E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T50	12-Apr-13	Quarterly	Exposure	1.48E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T55	12-Apr-13	Quarterly	Exposure	1.52E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T56	12-Apr-13	Quarterly	Exposure	1.40E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T57	12-Apr-13	Quarterly	Exposure	1.54E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T58	12-Apr-13	Quarterly	Exposure	1.23E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T59	12-Apr-13	Quarterly	Exposure	1.31E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T60	12-Apr-13	Quarterly	Exposure	1.48E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T61	12-Apr-13	Quarterly	Exposure	1.44E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T62	12-Apr-13	Quarterly	Exposure	1.45E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T63	12-Apr-13	Quarterly	Exposure	1.28E+01	mR/Std Qtr		1	

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
TLD Analysis (Offsite)	Indicator	T68	12-Apr-13	Quarterly	Exposure	1.61E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T69	12-Apr-13	Quarterly	Exposure	1.61E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T70	12-Apr-13	Quarterly	Exposure	1.40E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T71	12-Apr-13	Quarterly	Exposure	1.53E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T01	19-Jul-13	Quarterly	Exposure	1.41E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T02	19-Jul-13	Quarterly	Exposure	1.34E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T03	19-Jul-13	Quarterly	Exposure	1.37E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T04	19-Jul-13	Quarterly	Exposure	1.49E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T05	19-Jul-13	Quarterly	Exposure	1.54E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T06	19-Jul-13	Quarterly	Exposure	1.59E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Control	T07	19-Jul-13	Quarterly	Exposure	1.63E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T08	19-Jul-13	Quarterly	Exposure	1.65E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T09	19-Jul-13	Quarterly	Exposure	1.46E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T10	19-Jul-13	Quarterly	Exposure	1.52E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T11	19-Jul-13	Quarterly	Exposure	1.33E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T12	19-Jul-13	Quarterly	Exposure	1.37E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T13	19-Jul-13	Quarterly	Exposure	1.58E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T14	19-Jul-13	Quarterly	Exposure	1.63E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T15	19-Jul-13	Quarterly	Exposure	1.34E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T16	19-Jul-13	Quarterly	Exposure	1.82E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T17	19-Jul-13	Quarterly	Exposure	1.34E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T18	19-Jul-13	Quarterly	Exposure	1.57E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T19	19-Jul-13	Quarterly	Exposure	1.66E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T20	19-Jul-13	Quarterly	Exposure	1.70E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T21	19-Jul-13	Quarterly	Exposure	1.38E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T22	19-Jul-13	Quarterly	Exposure	1.51E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T23	19-Jul-13	Quarterly	Exposure	1.51E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T24	19-Jul-13	Quarterly	Exposure	1.34E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T25	19-Jul-13	Quarterly	Exposure	1.74E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T26	19-Jul-13	Quarterly	Exposure	1.78E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T27	19-Jul-13	Quarterly	Exposure	1.25E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Control	T28	19-Jul-13	Quarterly	Exposure	1.32E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Control	T29	19-Jul-13	Quarterly	Exposure	1.35E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T30	19-Jul-13	Quarterly	Exposure	1.28E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Control	T31	19-Jul-13	Quarterly	Exposure	1.48E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T32	19-Jul-13	Quarterly	Exposure	1.62E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T33	19-Jul-13	Quarterly	Exposure	1.35E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T34	19-Jul-13	Quarterly	Exposure	1.37E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T35	19-Jul-13	Quarterly	Exposure	1.39E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T36	19-Jul-13	Quarterly	Exposure	1.44E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T37	19-Jul-13	Quarterly	Exposure	1.50E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T38	19-Jul-13	Quarterly	Exposure	1.70E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T49	19-Jul-13	Quarterly	Exposure	2.06E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T50	19-Jul-13	Quarterly	Exposure	1.55E+01	mR/Std Qtr		1	

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
TLD Analysis (Offsite)	Indicator	T55	19-Jul-13	Quarterly	Exposure	1.67E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T56	19-Jul-13	Quarterly	Exposure	1.50E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T57	19-Jul-13	Quarterly	Exposure	1.67E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T58	19-Jul-13	Quarterly	Exposure	1.37E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T59	19-Jul-13	Quarterly	Exposure	1.38E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T60	19-Jul-13	Quarterly	Exposure	1.57E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T61	19-Jul-13	Quarterly	Exposure	1.58E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T62	19-Jul-13	Quarterly	Exposure	1.57E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T63	19-Jul-13	Quarterly	Exposure	1.38E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T68	19-Jul-13	Quarterly	Exposure	1.90E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T69	19-Jul-13	Quarterly	Exposure	1.68E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T70	19-Jul-13	Quarterly	Exposure	1.56E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T71	19-Jul-13	Quarterly	Exposure	1.74E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T01	22-Oct-13	Quarterly	Exposure	1.41E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T02	22-Oct-13	Quarterly	Exposure	1.37E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T03	22-Oct-13	Quarterly	Exposure	1.34E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T04	22-Oct-13	Quarterly	Exposure	1.62E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T05	22-Oct-13	Quarterly	Exposure	1.64E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T06	22-Oct-13	Quarterly	Exposure	1.60E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Control	T07	22-Oct-13	Quarterly	Exposure	1.64E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T08	22-Oct-13	Quarterly	Exposure	1.63E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T09	22-Oct-13	Quarterly	Exposure	1.59E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T10	22-Oct-13	Quarterly	Exposure	1.50E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T11	22-Oct-13	Quarterly	Exposure	1.36E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T12	22-Oct-13	Quarterly	Exposure	1.39E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T13	22-Oct-13	Quarterly	Exposure	1.68E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T14	22-Oct-13	Quarterly	Exposure	1.63E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T15	22-Oct-13	Quarterly	Exposure	1.42E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T16	22-Oct-13	Quarterly	Exposure	1.83E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T17	22-Oct-13	Quarterly	Exposure	1.24E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T18	22-Oct-13	Quarterly	Exposure	1.46E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T19	22-Oct-13	Quarterly	Exposure	1.66E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T20	22-Oct-13	Quarterly	Exposure	1.63E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T21	22-Oct-13	Quarterly	Exposure	1.38E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T22	22-Oct-13	Quarterly	Exposure	1.51E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T23	22-Oct-13	Quarterly	Exposure	1.53E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T24	22-Oct-13	Quarterly	Exposure	1.39E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T25	22-Oct-13	Quarterly	Exposure	1.87E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T26	22-Oct-13	Quarterly	Exposure	1.80E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T27	22-Oct-13	Quarterly	Exposure	1.27E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Control	T28	22-Oct-13	Quarterly	Exposure	1.43E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Control	T29	22-Oct-13	Quarterly	Exposure	1.37E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T30	22-Oct-13	Quarterly	Exposure	1.46E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Control	T31	22-Oct-13	Quarterly	Exposure	1.64E+01	mR/Std Qtr		1	



Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
TLD Analysis (Offsite)	Indicator	T32	22-Oct-13	Quarterly	Exposure	1.67E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T33	22-Oct-13	Quarterly	Exposure	1.34E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T34	22-Oct-13	Quarterly	Exposure	1.31E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T35	22-Oct-13	Quarterly	Exposure	1.47E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T36	22-Oct-13	Quarterly	Exposure	1.56E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T37	22-Oct-13	Quarterly	Exposure	1.51E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T38	22-Oct-13	Quarterly	Exposure	1.70E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T49	22-Oct-13	Quarterly	Exposure	1.99E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T50	22-Oct-13	Quarterly	Exposure	1.67E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T55	22-Oct-13	Quarterly	Exposure	1.60E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T56	22-Oct-13	Quarterly	Exposure	1.44E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T57	22-Oct-13	Quarterly	Exposure	1.64E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T58	22-Oct-13	Quarterly	Exposure	1.40E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T59	22-Oct-13	Quarterly	Exposure	1.49E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T60	22-Oct-13	Quarterly	Exposure	1.59E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T61	22-Oct-13	Quarterly	Exposure	1.62E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T62	22-Oct-13	Quarterly	Exposure	1.66E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T63	22-Oct-13	Quarterly	Exposure	1.37E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T68	22-Oct-13	Quarterly	Exposure	1.76E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T69	22-Oct-13	Quarterly	Exposure	1.72E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T70	22-Oct-13	Quarterly	Exposure	1.57E+01	mR/Std Qtr		1	
TLD Analysis (Offsite)	Indicator	T71	22-Oct-13	Quarterly	Exposure	1.79E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T39	12-Jan-13	Quarterly	Exposure	1.44E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T40	12-Jan-13	Quarterly	Exposure	1.50E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T41	12-Jan-13	Quarterly	Exposure	1.77E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T42	12-Jan-13	Quarterly	Exposure	1.79E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T43	12-Jan-13	Quarterly	Exposure	1.99E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T44	12-Jan-13	Quarterly	Exposure	1.73E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T45	12-Jan-13	Quarterly	Exposure	1.42E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T46	12-Jan-13	Quarterly	Exposure	1.43E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T47	12-Jan-13	Quarterly	Exposure	1.97E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T48	12-Jan-13	Quarterly	Exposure	1.59E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T51	12-Jan-13	Quarterly	Exposure	1.16E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T52	12-Jan-13	Quarterly	Exposure	1.35E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T53	12-Jan-13	Quarterly	Exposure	1.42E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T54	12-Jan-13	Quarterly	Exposure	1.28E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T64	12-Jan-13	Quarterly	Exposure	1.29E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T65	12-Jan-13	Quarterly	Exposure	1.38E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T66	12-Jan-13	Quarterly	Exposure	2.16E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T67	12-Jan-13	Quarterly	Exposure	1.41E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T39	12-Apr-13	Quarterly	Exposure	1.36E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T40	12-Apr-13	Quarterly	Exposure	1.26E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T41	12-Apr-13	Quarterly	Exposure	1.64E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T42	12-Apr-13	Quarterly	Exposure	1.52E+01	mR/Std Qtr		1	

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
TLD Analysis (Onsite)	Onsite	T43	12-Apr-13	Quarterly	Exposure	1.76E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T44	12-Apr-13	Quarterly	Exposure	1.64E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T45	12-Apr-13	Quarterly	Exposure	1.26E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T46	12-Apr-13	Quarterly	Exposure	1.29E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T47	12-Apr-13	Quarterly	Exposure	1.78E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T48	12-Apr-13	Quarterly	Exposure	1.62E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T51	12-Apr-13	Quarterly	Exposure	1.03E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T52	12-Apr-13	Quarterly	Exposure	1.24E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T53	12-Apr-13	Quarterly	Exposure	1.36E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T54	12-Apr-13	Quarterly	Exposure	1.16E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T64	12-Apr-13	Quarterly	Exposure	1.21E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T65	12-Apr-13	Quarterly	Exposure	1.25E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T66	12-Apr-13	Quarterly	Exposure	2.07E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T67	12-Apr-13	Quarterly	Exposure	1.19E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T39	19-Jul-13	Quarterly	Exposure	1.57E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T40	19-Jul-13	Quarterly	Exposure	1.48E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T41	19-Jul-13	Quarterly	Exposure	1.99E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T42	19-Jul-13	Quarterly	Exposure	2.02E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T43	19-Jul-13	Quarterly	Exposure	2.16E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T44	19-Jul-13	Quarterly	Exposure	2.01E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T45	19-Jul-13	Quarterly	Exposure	1.57E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T46	19-Jul-13	Quarterly	Exposure	1.45E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T47	19-Jul-13	Quarterly	Exposure	2.25E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T48	19-Jul-13	Quarterly	Exposure	1.89E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T51	19-Jul-13	Quarterly	Exposure	1.10E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T52	19-Jul-13	Quarterly	Exposure	1.29E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T53	19-Jul-13	Quarterly	Exposure	1.48E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T54	19-Jul-13	Quarterly	Exposure	1.31E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T64	19-Jul-13	Quarterly	Exposure	1.32E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T65	19-Jul-13	Quarterly	Exposure	1.40E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T66	19-Jul-13	Quarterly	Exposure	2.59E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T67	19-Jul-13	Quarterly	Exposure	1.24E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T39	22-Oct-13	Quarterly	Exposure	1.87E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T40	22-Oct-13	Quarterly	Exposure	1.79E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T41	22-Oct-13	Quarterly	Exposure	2.63E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T42	22-Oct-13	Quarterly	Exposure	2.53E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T43	22-Oct-13	Quarterly	Exposure	3.00E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T44	22-Oct-13	Quarterly	Exposure			(b)	1	
TLD Analysis (Onsite)	Onsite	T45	22-Oct-13	Quarterly	Exposure	2.02E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T46	22-Oct-13	Quarterly	Exposure	1.81E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T47	22-Oct-13	Quarterly	Exposure	2.84E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T48	22-Oct-13	Quarterly	Exposure	2.18E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T51	22-Oct-13	Quarterly	Exposure	1.22E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T52	22-Oct-13	Quarterly	Exposure	1.37E+01	mR/Std Qtr		1	

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
TLD Analysis (Onsite)	Onsite	T53	22-Oct-13	Quarterly	Exposure	1.63E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T54	22-Oct-13	Quarterly	Exposure	1.32E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T64	22-Oct-13	Quarterly	Exposure	1.40E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T65	22-Oct-13	Quarterly	Exposure	1.57E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T66	22-Oct-13	Quarterly	Exposure	3.57E+01	mR/Std Qtr		1	
TLD Analysis (Onsite)	Onsite	T67	22-Oct-13	Quarterly	Exposure	1.45E+01	mR/Std Qtr		1	
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Actinium-228	-3.04E+01	pCi/kg	3.41E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Antimony-124	-2.76E-01	pCi/kg	1.88E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Antimony-125	7.99E+00	pCi/kg	2.16E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Barium-140	9.10E+00	pCi/kg	3.94E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Beryllium-7	3.17E+02	pCi/kg	6.79E+01		
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Cerium-141	1.18E+01	pCi/kg	1.18E+01		UI
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Cerium-144	1.57E+00	pCi/kg	4.37E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Cesium-134	4.01E+00	pCi/kg	8.91E+00	60	U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Cesium-137	8.46E-01	pCi/kg	7.95E+00	80	U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Chromium-51	3.09E+01	pCi/kg	7.48E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Cobalt-57	1.49E-01	pCi/kg	5.74E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Cobalt-58	-1.43E+00	pCi/kg	8.37E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Cobalt-60	1.59E+00	pCi/kg	9.35E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Iodine-131	-6.64E+00	pCi/kg	1.44E+01	60	U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Iron-59	3.46E+00	pCi/kg	1.82E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Lanthanum-140	-2.12E+00	pCi/kg	1.15E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Manganese-54	6.32E-01	pCi/kg	7.68E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Niobium-95	4.88E+00	pCi/kg	8.31E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Potassium-40	2.64E+03	pCi/kg	7.92E+01		
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Ruthenium-103	3.40E+00	pCi/kg	8.26E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Ruthenium-106	6.08E+00	pCi/kg	7.08E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Selenium-75	-1.81E+00	pCi/kg	9.63E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Silver-108m	-4.30E+00	pCi/kg	6.32E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Silver-110m	-6.01E-01	pCi/kg	1.07E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Thorium-228	8.08E+00	pCi/kg	1.27E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Zinc-65	-5.51E+00	pCi/kg	1.88E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Broccoli	Zirconium-95	-7.32E+00	pCi/kg	1.32E+01		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Actinium-228	-3.02E+01	pCi/kg	2.55E+01		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Antimony-124	-6.50E+00	pCi/kg	1.35E+01		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Antimony-125	-1.24E+00	pCi/kg	1.69E+01		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Barium-140	2.07E+00	pCi/kg	4.13E+01		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Beryllium-7	2.33E+02	pCi/kg	5.41E+01		
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Cerium-141	-1.15E+01	pCi/kg	1.13E+01		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Cerium-144	-1.79E-01	pCi/kg	3.69E+01		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Cesium-134	1.42E+00	pCi/kg	7.29E+00	60	U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Cesium-137	-2.81E+00	pCi/kg	8.42E+00	80	U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Chromium-51	-1.64E+01	pCi/kg	6.49E+01		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Cobalt-57	1.28E-01	pCi/kg	4.86E+00		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Cobalt-58	-3.23E+00	pCi/kg	6.60E+00		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Cobalt-60	5.99E-01	pCi/kg	7.54E+00		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Iodine-131	-8.15E-01	pCi/kg	1.70E+01	60	U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Iron-59	2.33E+00	pCi/kg	1.63E+01		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Lanthanum-140	-1.09E+00	pCi/kg	1.31E+01		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Manganese-54	-5.15E+00	pCi/kg	6.50E+00		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Niobium-95	3.41E+00	pCi/kg	7.35E+00		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Potassium-40	3.85E+03	pCi/kg	6.35E+01		
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Ruthenium-103	3.19E-01	pCi/kg	7.18E+00		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Ruthenium-106	-2.81E+01	pCi/kg	5.66E+01		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Selenium-75	-2.02E+00	pCi/kg	8.28E+00		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Silver-108m	4.34E-01	pCi/kg	5.62E+00		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Silver-110m	-2.07E+00	pCi/kg	8.60E+00		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Thorium-228	-6.19E+00	pCi/kg	1.25E+01		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Zinc-65	-3.41E+00	pCi/kg	1.65E+01		U
Vegetables	Control	FP-9	25-Jul-13	Broccoli	Zirconium-95	-3.69E-01	pCi/kg	1.19E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Actinium-228	8.59E+00	pCi/kg	4.73E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Antimony-124	3.38E+00	pCi/kg	2.12E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Antimony-125	8.15E+00	pCi/kg	2.35E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Barium-140	-8.04E+00	pCi/kg	4.55E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Beryllium-7	1.58E+02	pCi/kg	7.76E+01		
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Cerium-141	-1.49E+00	pCi/kg	1.35E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Cerium-144	-1.25E+00	pCi/kg	5.09E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Cesium-134	8.19E+00	pCi/kg	1.17E+01	60	U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Cesium-137	2.99E+00	pCi/kg	1.03E+01	80	U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Chromium-51	-4.05E+01	pCi/kg	7.49E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Cobalt-57	-3.77E+00	pCi/kg	6.23E+00		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Cobalt-58	2.86E+00	pCi/kg	9.77E+00		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Cobalt-60	1.12E+00	pCi/kg	1.10E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Iodine-131	-4.48E+00	pCi/kg	1.56E+01	60	U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Iron-59	3.77E-01	pCi/kg	2.23E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Lanthanum-140	8.18E+00	pCi/kg	1.68E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Manganese-54	-1.92E+00	pCi/kg	9.18E+00		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Niobium-95	6.21E+00	pCi/kg	1.01E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Potassium-40	4.37E+03	pCi/kg	9.10E+01		
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Ruthenium-103	-3.72E+00	pCi/kg	9.07E+00		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Ruthenium-106	-5.95E+00	pCi/kg	8.47E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Selenium-75	2.95E+00	pCi/kg	1.19E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Silver-108m	2.05E+00	pCi/kg	7.99E+00		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Silver-110m	2.38E+00	pCi/kg	1.27E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Thorium-228	6.02E+00	pCi/kg	1.54E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Zinc-65	-7.80E+00	pCi/kg	2.27E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Brussel Sprouts	Zirconium-95	1.54E+00	pCi/kg	1.65E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Actinium-228	-2.01E+01	pCi/kg	3.09E+01		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Antimony-124	4.89E+00	pCi/kg	1.70E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Antimony-125	1.75E+00	pCi/kg	1.82E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Barium-140	3.93E+00	pCi/kg	4.63E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Beryllium-7	3.87E+02	pCi/kg	6.51E+01		
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Cerium-141	6.18E+00	pCi/kg	1.17E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Cerium-144	1.97E+01	pCi/kg	3.92E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Cesium-134	1.58E+00	pCi/kg	7.40E+00	60	U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Cesium-137	4.93E+00	pCi/kg	7.69E+00	80	U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Chromium-51	-4.54E+01	pCi/kg	6.78E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Cobalt-57	8.23E-01	pCi/kg	5.02E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Cobalt-58	-3.66E-01	pCi/kg	7.02E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Cobalt-60	3.62E+00	pCi/kg	7.59E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Iodine-131	6.08E+00	pCi/kg	1.89E+01	60	U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Iron-59	4.95E+00	pCi/kg	1.70E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Lanthanum-140	7.23E+00	pCi/kg	1.51E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Manganese-54	-3.11E+00	pCi/kg	7.28E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Niobium-95	7.21E+00	pCi/kg	7.21E+00		UI
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Potassium-40	3.20E+03	pCi/kg	6.18E+01		
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Ruthenium-103	-8.03E-01	pCi/kg	7.71E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Ruthenium-106	2.22E+01	pCi/kg	6.48E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Selenium-75	9.43E-02	pCi/kg	8.91E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Silver-108m	-1.06E+00	pCi/kg	5.84E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Silver-110m	-4.84E+00	pCi/kg	9.12E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Thorium-228	5.05E+00	pCi/kg	1.09E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Zinc-65	-7.34E+00	pCi/kg	1.74E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cabbage	Zirconium-95	1.22E+00	pCi/kg	1.30E+01		U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Actinium-228	2.12E+01	pCi/kg	2.12E+01		UI
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Antimony-124	4.56E+00	pCi/kg	1.34E+01		U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Antimony-125	1.07E+00	pCi/kg	1.60E+01		U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Barium-140	5.26E+00	pCi/kg	3.99E+01		U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Beryllium-7	2.44E+02	pCi/kg	5.01E+01		
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Cerium-141	7.06E+00	pCi/kg	1.06E+01		U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Cerium-144	1.55E-02	pCi/kg	3.52E+01		U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Cesium-134	4.73E+00	pCi/kg	7.16E+00	60	U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Cesium-137	6.97E-01	pCi/kg	6.26E+00	80	U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Chromium-51	6.25E+01	pCi/kg	6.25E+01		UI
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Cobalt-57	1.55E+00	pCi/kg	4.67E+00		U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Cobalt-58	6.72E-01	pCi/kg	6.43E+00		U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Cobalt-60	-2.41E+00	pCi/kg	6.98E+00		U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Iodine-131	1.98E+00	pCi/kg	1.66E+01	60	U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Iron-59	-4.67E+00	pCi/kg	1.36E+01		U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Lanthanum-140	-3.20E+00	pCi/kg	1.13E+01		U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Manganese-54	-1.55E+00	pCi/kg	5.91E+00		U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Niobium-95	-2.40E+00	pCi/kg	6.00E+00		U

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Potassium-40	3.86E+03	pCi/kg	5.56E+01		
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Ruthenium-103	2.56E-01	pCi/kg	6.43E+00		U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Ruthenium-106	-1.74E+01	pCi/kg	5.14E+01		U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Selenium-75	-2.16E+00	pCi/kg	7.52E+00		U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Silver-108m	-5.25E-01	pCi/kg	5.15E+00		U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Silver-110m	2.29E+00	pCi/kg	8.53E+00		U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Thorium-228	1.21E+00	pCi/kg	1.04E+01		U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Zinc-65	2.73E+00	pCi/kg	1.48E+01		U
Vegetables	Control	FP-9	25-Jul-13	Cabbage	Zirconium-95	-1.93E+00	pCi/kg	1.12E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Actinium-228	5.09E+01	pCi/kg	3.69E+01		
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Antimony-124	-1.11E+01	pCi/kg	1.82E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Antimony-125	-4.55E+00	pCi/kg	2.61E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Barium-140	1.44E+01	pCi/kg	5.01E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Beryllium-7	2.12E+02	pCi/kg	8.53E+01		
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Cerium-141	1.87E+00	pCi/kg	1.54E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Cerium-144	5.98E+00	pCi/kg	5.87E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Cesium-134	5.25E+00	pCi/kg	1.19E+01	60	U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Cesium-137	-2.71E+00	pCi/kg	1.13E+01	80	U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Chromium-51	-8.67E+00	pCi/kg	8.79E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Cobalt-57	-3.19E+00	pCi/kg	7.60E+00		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Cobalt-58	-1.13E+00	pCi/kg	9.60E+00		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Cobalt-60	3.04E-01	pCi/kg	1.22E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Iodine-131	-8.34E+00	pCi/kg	1.76E+01	60	U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Iron-59	-4.90E+00	pCi/kg	2.21E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Lanthanum-140	-1.20E+00	pCi/kg	1.69E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Manganese-54	-2.67E+00	pCi/kg	1.02E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Niobium-95	-4.15E+00	pCi/kg	1.03E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Potassium-40	3.27E+03	pCi/kg	1.11E+02		
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Ruthenium-103	-3.30E+00	pCi/kg	9.32E+00		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Ruthenium-106	3.44E+01	pCi/kg	9.63E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Selenium-75	-2.25E+00	pCi/kg	1.21E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Silver-108m	1.72E+00	pCi/kg	9.34E+00		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Silver-110m	-7.59E+00	pCi/kg	1.25E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Thorium-228	1.93E+01	pCi/kg	1.82E+01		
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Zinc-65	5.03E+00	pCi/kg	2.60E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Cabbage	Zirconium-95	8.72E-01	pCi/kg	1.93E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Actinium-228	-1.09E+01	pCi/kg	5.59E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Antimony-124	-3.62E+00	pCi/kg	2.54E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Antimony-125	1.04E+00	pCi/kg	2.73E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Barium-140	1.76E+01	pCi/kg	5.68E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Beryllium-7	3.85E+02	pCi/kg	9.76E+01		
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Cerium-141	-6.49E+00	pCi/kg	1.33E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Cerium-144	2.95E+00	pCi/kg	4.70E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Cesium-134	4.43E+00	pCi/kg	1.40E+01	60	U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Cesium-137	1.07E+01	pCi/kg	1.19E+01	80	U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Chromium-51	-5.18E+00	pCi/kg	8.91E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Cobalt-57	2.46E-02	pCi/kg	5.73E+00		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Cobalt-58	-6.40E-01	pCi/kg	1.24E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Cobalt-60	3.30E+00	pCi/kg	1.41E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Iodine-131	-5.06E+00	pCi/kg	1.72E+01	60	U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Iron-59	-6.32E+00	pCi/kg	2.50E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Lanthanum-140	-7.55E+00	pCi/kg	2.00E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Manganese-54	-1.61E+00	pCi/kg	1.09E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Niobium-95	1.70E+00	pCi/kg	1.26E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Potassium-40	2.98E+03	pCi/kg	1.18E+02		
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Ruthenium-103	-3.46E+00	pCi/kg	1.11E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Ruthenium-106	-3.31E+01	pCi/kg	9.50E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Selenium-75	-9.64E-01	pCi/kg	1.26E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Silver-108m	1.56E+00	pCi/kg	9.68E+00		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Silver-110m	6.75E+00	pCi/kg	1.80E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Thorium-228	2.11E+01	pCi/kg	1.50E+01		
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Zinc-65	-5.55E+00	pCi/kg	2.65E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cabbage	Zirconium-95	9.38E+00	pCi/kg	2.27E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Actinium-228	4.09E+00	pCi/kg	2.90E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Antimony-124	2.41E+00	pCi/kg	1.55E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Antimony-125	-3.96E+00	pCi/kg	1.63E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Barium-140	6.01E+00	pCi/kg	4.15E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Beryllium-7	2.19E+02	pCi/kg	5.89E+01		
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Cerium-141	4.35E+00	pCi/kg	1.08E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Cerium-144	-8.15E+00	pCi/kg	3.49E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Cesium-134	-1.98E+00	pCi/kg	6.66E+00	60	U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Cesium-137	6.48E+00	pCi/kg	6.48E+00	80	UI
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Chromium-51	-2.40E+01	pCi/kg	6.23E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Cobalt-57	-2.06E+00	pCi/kg	4.43E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Cobalt-58	1.57E+00	pCi/kg	6.52E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Cobalt-60	-2.34E+00	pCi/kg	7.82E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Iodine-131	2.11E+00	pCi/kg	1.61E+01	60	U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Iron-59	-2.93E+00	pCi/kg	1.52E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Lanthanum-140	-3.16E+00	pCi/kg	1.28E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Manganese-54	1.47E+00	pCi/kg	6.39E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Niobium-95	3.85E+00	pCi/kg	6.87E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Potassium-40	3.01E+03	pCi/kg	5.89E+01		
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Ruthenium-103	-2.67E+00	pCi/kg	6.60E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Ruthenium-106	-4.03E+00	pCi/kg	5.72E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Selenium-75	-4.34E+00	pCi/kg	8.01E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Silver-108m	-2.38E+00	pCi/kg	5.37E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Silver-110m	-3.92E+00	pCi/kg	8.94E+00		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Thorium-228	2.62E+00	pCi/kg	1.21E+01		U

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Zinc-65	-6.30E+00	pCi/kg	1.57E+01		U
Vegetables	Indicator	FP-1	25-Jul-13	Cauliflower	Zirconium-95	5.27E+00	pCi/kg	1.22E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Actinium-228	-3.69E+00	pCi/kg	4.63E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Antimony-124	-3.08E+00	pCi/kg	2.06E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Antimony-125	-1.08E+01	pCi/kg	2.47E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Barium-140	1.30E+00	pCi/kg	5.12E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Beryllium-7	3.38E+02	pCi/kg	8.96E+01		
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Cerium-141	-1.13E+01	pCi/kg	1.56E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Cerium-144	-1.57E+01	pCi/kg	5.23E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Cesium-134	5.38E+00	pCi/kg	1.14E+01	60	U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Cesium-137	-1.08E-02	pCi/kg	1.12E+01	80	U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Chromium-51	1.49E+01	pCi/kg	8.88E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Cobalt-57	3.20E+00	pCi/kg	7.26E+00		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Cobalt-58	3.81E+00	pCi/kg	1.08E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Cobalt-60	2.32E+00	pCi/kg	1.20E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Iodine-131	-8.87E-01	pCi/kg	1.76E+01	60	U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Iron-59	3.48E+00	pCi/kg	2.38E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Lanthanum-140	4.41E+00	pCi/kg	1.66E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Manganese-54	-3.30E+00	pCi/kg	9.74E+00		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Niobium-95	6.23E+00	pCi/kg	1.17E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Potassium-40	3.66E+03	pCi/kg	1.07E+02		
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Ruthenium-103	-7.02E+00	pCi/kg	9.49E+00		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Ruthenium-106	-1.70E+01	pCi/kg	9.03E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Selenium-75	5.39E+00	pCi/kg	1.30E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Silver-108m	-9.38E-01	pCi/kg	8.79E+00		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Silver-110m	4.08E+00	pCi/kg	1.53E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Thorium-228	1.29E+01	pCi/kg	2.02E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Zinc-65	5.32E+00	pCi/kg	2.20E+01		U
Vegetables	Control	FP-9	29-Aug-13	Cauliflower	Zirconium-95	-5.73E+00	pCi/kg	1.79E+01		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Actinium-228	6.38E+00	pCi/kg	2.96E+01		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Antimony-124	-8.17E+00	pCi/kg	1.63E+01		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Antimony-125	1.19E+00	pCi/kg	1.80E+01		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Barium-140	-2.43E+01	pCi/kg	4.80E+01		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Beryllium-7	2.84E+02	pCi/kg	6.06E+01		
Vegetables	Control	FP-9	25-Jul-13	Collards	Cerium-141	6.31E+00	pCi/kg	9.39E+00		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Cerium-144	-5.96E+00	pCi/kg	3.06E+01		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Cesium-134	3.81E+00	pCi/kg	8.90E+00	60	U
Vegetables	Control	FP-9	25-Jul-13	Collards	Cesium-137	-4.07E+00	pCi/kg	7.75E+00	80	U
Vegetables	Control	FP-9	25-Jul-13	Collards	Chromium-51	-1.45E+01	pCi/kg	6.61E+01		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Cobalt-57	-5.74E-01	pCi/kg	3.70E+00		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Cobalt-58	-3.35E+00	pCi/kg	8.10E+00		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Cobalt-60	-8.17E-01	pCi/kg	9.39E+00		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Iodine-131	-3.78E+00	pCi/kg	1.79E+01	60	U
Vegetables	Control	FP-9	25-Jul-13	Collards	Iron-59	6.57E+00	pCi/kg	2.04E+01		U



Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Vegetables	Control	FP-9	25-Jul-13	Collards	Lanthanum-140	4.05E+00	pCi/kg	1.54E+01		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Manganese-54	-2.07E+00	pCi/kg	7.63E+00		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Niobium-95	-1.26E+00	pCi/kg	8.57E+00		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Potassium-40	3.98E+03	pCi/kg	7.42E+01		
Vegetables	Control	FP-9	25-Jul-13	Collards	Ruthenium-103	-1.96E+00	pCi/kg	7.57E+00		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Ruthenium-106	1.07E+01	pCi/kg	6.94E+01		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Selenium-75	-9.21E-01	pCi/kg	7.77E+00		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Silver-108m	-9.86E-01	pCi/kg	5.58E+00		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Silver-110m	-1.56E+00	pCi/kg	1.13E+01		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Thorium-228	-1.89E+00	pCi/kg	1.33E+01		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Zinc-65	-1.66E+01	pCi/kg	1.87E+01		U
Vegetables	Control	FP-9	25-Jul-13	Collards	Zirconium-95	-8.88E+00	pCi/kg	1.40E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Actinium-228	-1.63E+01	pCi/kg	4.20E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Antimony-124	1.04E+01	pCi/kg	2.13E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Antimony-125	1.85E+00	pCi/kg	2.54E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Barium-140	2.64E+01	pCi/kg	4.74E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Beryllium-7	1.69E+02	pCi/kg	8.21E+01		
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Cerium-141	-5.19E+00	pCi/kg	1.41E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Cerium-144	1.62E+01	pCi/kg	5.09E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Cesium-134	4.20E+00	pCi/kg	9.87E+00	60	U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Cesium-137	-6.10E+00	pCi/kg	1.13E+01	80	U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Chromium-51	-1.58E+01	pCi/kg	7.95E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Cobalt-57	-8.27E-01	pCi/kg	6.35E+00		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Cobalt-58	2.09E+00	pCi/kg	9.56E+00		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Cobalt-60	1.66E+00	pCi/kg	1.04E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Iodine-131	-3.05E+00	pCi/kg	1.49E+01	60	U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Iron-59	-5.62E+00	pCi/kg	1.85E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Lanthanum-140	-3.76E+00	pCi/kg	1.30E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Manganese-54	-1.75E+00	pCi/kg	9.03E+00		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Niobium-95	2.56E+00	pCi/kg	9.46E+00		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Potassium-40	3.46E+03	pCi/kg	9.37E+01		
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Ruthenium-103	-2.98E+00	pCi/kg	9.30E+00		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Ruthenium-106	5.12E+00	pCi/kg	8.49E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Selenium-75	-6.23E+00	pCi/kg	1.07E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Silver-108m	-1.83E+00	pCi/kg	8.05E+00		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Silver-110m	3.50E-01	pCi/kg	1.21E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Thorium-228	1.39E+01	pCi/kg	1.45E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Zinc-65	-1.56E+01	pCi/kg	2.15E+01		U
Vegetables	Indicator	FP-1	29-Aug-13	Collards	Zirconium-95	4.11E+00	pCi/kg	1.63E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Actinium-228	3.43E+01	pCi/kg	6.05E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Antimony-124	1.29E+00	pCi/kg	2.94E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Antimony-125	9.94E+00	pCi/kg	4.00E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Barium-140	-2.77E+01	pCi/kg	7.13E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Beryllium-7	1.32E+03	pCi/kg	1.24E+02		

Fermi 2 - 2013  
Annual Radiological Environmental Operating Report  
Appendix C - Environmental Data Table

Medium	Location Category	Location ID	Date	Sample Type	Parameter	Result	Units	MDA	LLD	Lab Qualifier
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Cerium-141	9.62E+00	pCi/kg	2.28E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Cerium-144	3.88E+01	pCi/kg	8.28E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Cesium-134	3.41E+00	pCi/kg	1.53E+01	60	U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Cesium-137	6.34E+00	pCi/kg	1.59E+01	80	U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Chromium-51	4.04E+01	pCi/kg	1.39E+02		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Cobalt-57	4.25E+00	pCi/kg	1.06E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Cobalt-58	-3.42E+00	pCi/kg	1.46E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Cobalt-60	-1.42E+00	pCi/kg	1.36E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Iodine-131	1.12E+01	pCi/kg	2.82E+01	60	U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Iron-59	2.73E+00	pCi/kg	2.82E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Lanthanum-140	-9.47E+00	pCi/kg	1.89E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Manganese-54	-5.13E+00	pCi/kg	1.56E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Niobium-95	-4.03E-01	pCi/kg	1.53E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Potassium-40	4.47E+03	pCi/kg	1.19E+02		
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Ruthenium-103	-5.22E+00	pCi/kg	1.43E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Ruthenium-106	2.58E+01	pCi/kg	1.27E+02		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Selenium-75	-6.00E+00	pCi/kg	1.87E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Silver-108m	-9.25E-01	pCi/kg	1.39E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Silver-110m	-3.26E+00	pCi/kg	1.87E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Thorium-228	1.88E+00	pCi/kg	2.40E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Zinc-65	1.06E+00	pCi/kg	3.04E+01		U
Vegetables	Control	FP-9	29-Aug-13	Horseradish	Zirconium-95	7.69E+00	pCi/kg	2.52E+01		U

## Appendix D

### Environmental Program Exceptions

### ***Environmental Program Exceptions***

On occasions, samples cannot be collected. This can be due to a variety of events, such as equipment malfunction, loss of electrical power, severe weather conditions, or vandalism. In 2012, missed samples were a result of missing field TLDs. The following sections list all missed samples, changes and corrective actions taken during 2012. These missed samples did not have a significant impact on the execution of the REMP.

#### ***Direct Radiation Monitoring***

All TLDs are placed in the field in inconspicuous locations to minimize the loss of TLDs due to vandalism. During 2013, two hundred and sixteen (212) TLDs were placed in the field for the REMP program and all but two (2) TLDs were collected and processed.

- During the first quarter collection T-05, was found missing and was replaced with the next quarter's TLDs.
- During the fourth quarter collection T-44 was found missing and was replaced with the next quarter's TLDs.

#### ***Atmospheric Monitoring***

During 2012, two hundred sixty (260) air samples were placed in the field and all but two collected and processed. There were no changes to the Atmospheric Monitoring program during 2012.

- During the second week of May, 2013, the Air Sampler at API was found out of service so the Particulate Filter (for Gross Beta) and Charcoal Cartridge (for radioiodines) samples were not deemed representative samples and were not be processed. The Air Sampler was repaired and there were no further discrepancies.

#### ***Terrestrial Monitoring - None***

#### ***Milk Sampling - None***

#### ***Garden Sampling - None***

#### ***Groundwater Sampling - None***

*Aquatic Monitoring - None*

*Drinking Water Sampling - None*

*Surface Water Sampling - None*

*Sediment Sampling - None*

*Fish Sampling - None*

*Program Changes - None*

## Appendix E

Interlaboratory Comparison Data  
GEL Laboratories'  
Quality Assurance Programs  
and the  
Annual Quality Assurance Status Report  
Environmental Dosimetry Company

***Interlaboratory Comparison Program for 2013***

In an interlaboratory comparison program, participant laboratories receive from a commerce source, environmental samples of known activity concentration for analysis. After the samples have been analyzed by the laboratory, the manufacturer of the sample reports the known activity concentration of the samples to the laboratory. The laboratory compares its results to the reported concentrations to determine any significant deviations, investigates such deviations if found, and initiates corrective action if necessary. Participation in this program provides assurance that the contract laboratory is capable of meeting accepted criteria for radioactivity analysis. The following is GEL Laboratories' participation in an interlaboratory comparison program and the Annual Quality Assurance Status Report for the Environmental Dosimetry Company.



Laboratories LLC

**2013 ANNUAL QUALITY ASSURANCE REPORT**

**FOR THE**

**RADIOLOGICAL ENVIRONMENTAL  
MONITORING PROGRAM (REMP)**

GEL LABORATORIES, LLC  
P.O. Box 30712, Charleston, SC 29417  
843.556.8171





**2013 ANNUAL QUALITY ASSURANCE REPORT**  
**FOR THE**  
**RADIOLOGICAL ENVIRONMENTAL**  
**MONITORING PROGRAM (REMP)**

Approved By:

Robert L. Pullano  
Director, Quality Systems

March 31, 2014

Date



**TABLE OF CONTENTS**

1. INTRODUCTION.....5

2. QUALITY ASSURANCE PROGRAMS FOR INTER-LABORATORY, INTRA-LABORATORY AND THIRD PARTY CROSS-CHECK.....6

3. QUALITY ASSURANCE PROGRAM FOR INTERNAL AND EXTERNAL AUDITS.....7

4. PERFORMANCE EVALUATION ACCEPTANCE CRITERIA FOR ENVIRONMENTAL SAMPLE ANALYSIS.....8

5. PERFORMANCE EVALUATION SAMPLES .....8

6. QUALITY CONTROL PROGRAM FOR ENVIRONMENTAL SAMPLE ANALYSIS.....8

7. SUMMARY OF DATA RESULTS.....9

8. SUMMARY OF PARTICIPATION IN THE ECKERT & ZIEGLER ANALYTICS ENVIRONMENTAL CROSS-CHECK PROGRAM.....10

9. SUMMARY OF PARTICIPATION IN THE MAPEP MONITORING PROGRAM.....10

10. SUMMARY OF PARTICIPATION IN THE ERA MRAD PT PROGRAM .....10

11. SUMMARY OF PARTICIPATION IN THE ERA PT PROGRAM.....10

12. CORRECTIVE ACTION REQUEST AND REPORT (CARR) .....10

13. REFERENCES.....12



**TABLE OF CONTENTS (CONTINUED)**

**TABLES**

Table 1 2012 Radiological Proficiency Testing Results and Acceptance Criteria .....13

Table 2 2012 Eckert & Ziegler Analytics Performance Evaluation Results .....23

Table 3 2012 Department of Energy Mixed Analyte Performance Evaluation Program (MAPEP) Results.....26

Table 4 2012 ERA Program Performance Evaluation Results .....30

Table 5 2012 ERA Program (MRAD) Performance Evaluation Results .....32

Table 6 REMP Intra-Laboratory Data Summary: Bias and Precision By Matrix..... 46

Table 7 All Radiological Intra-Laboratory Data Summary: Bias and Precision By Matrix..... 48

Table 8 2012 Corrective Action Report Summary..... 54

**FIGURES**

Figure 1 Cobalt-60 Performance Evaluation Results and % Bias .....36

Figure 2 Cesium-137 Performance Evaluation Results and % Bias .....37

Figure 3 Tritium Performance Evaluation Results and % Bias .....38

Figure 4 Strontium-90 Performance Evaluation Results and % Bias .....39

Figure 5 Gross Alpha Performance Evaluation Results and % Bias.....40

Figure 6 Gross Beta Performance Evaluation Results and % Bias .....41

Figure 7 Iodine-131 Performance Evaluation Results and % Bias .....42

Figure 8 Americium-241 Performance Evaluation Results and % Bias .....43

Figure 9 Plutonium-238 Performance Evaluation Results and % Bias .....44



## 2013 ANNUAL QUALITY ASSURANCE REPORT FOR THE RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM (REMP)

### 1. Introduction

GEL Laboratories, LLC (GEL) is a privately owned environmental laboratory dedicated to providing personalized client services of the highest quality. GEL was established as an analytical testing laboratory in 1981. Now a full service lab, our analytical divisions use state of the art equipment and methods to provide a comprehensive array of organic, inorganic, and radiochemical analyses to meet the needs of our clients.

At GEL, quality is emphasized at every level of personnel throughout the company. Management's ongoing commitment to good professional practice and to the quality of our testing services to our customers is demonstrated by their dedication of personnel and resources to develop, implement, assess, and improve our technical and management operations.

The purpose of GEL's quality assurance program is to establish policies, procedures, and processes to meet or exceed the expectations of our clients. To achieve this, all personnel that support these services to our clients are introduced to the program and policies during their initial orientation, and annually thereafter during company-wide training sessions.

GEL's primary goals are to ensure that all measurement data generated are scientifically and legally defensible, of known and acceptable quality per the data quality objectives (DQOs), and thoroughly documented to provide sound support for environmental decisions. In addition, GEL continues to ensure compliance with all contractual requirements, environmental standards, and regulations established by local, state and federal authorities.

GEL administers the QA program in accordance with the Quality Assurance Plan, GL-QS-B-001. Our Quality Systems include all quality assurance (QA) policies and quality control (QC) procedures necessary to plan, implement, and assess the work we perform. GEL's QA Program establishes a quality management system (QMS) that governs all of the activities of our organization.

This report entails the quality assurance program for the proficiency testing and environmental monitoring aspects of GEL for 2013. GEL's QA Program is designed to monitor the quality of analytical processing associated with environmental, radiobioassay, effluent (10 CFR Part 50), and waste (10 CFR Part 61) sample analysis.

This report covers the category of Radiological Environmental Monitoring Program (REMP) and includes:

- Intra-laboratory QC results analyzed during 2013.
- Inter-laboratory QC results analyzed during 2013 where known values were available.



## 2. Quality Assurance Programs for Inter-laboratory, Intra-laboratory and Third Party Cross-Check

In addition to internal and client audits, our laboratory participates in annual performance evaluation studies conducted by independent providers. We routinely participate in the following types of performance audits:

- Proficiency testing and other inter-laboratory comparisons
- Performance requirements necessary to retain Certifications
- Evaluation of recoveries of certified reference and in-house secondary reference materials using statistical process control data.
- Evaluation of relative percent difference between measurements through SPC data.

We also participate in a number of proficiency testing programs for federal and state agencies and as required by contracts. It is our policy that no proficiency evaluation samples be analyzed in any special manner. Our annual performance evaluation participation generally includes a combination of studies that support the following:

- US Environmental Protection Agency Discharge Monitoring Report, Quality Assurance Program (DMR-QA). Annual national program sponsored by EPA for laboratories engaged in the analysis of samples associated with the NPDES monitoring program. Participation is mandatory for all holders of NPDES permits. The permit holder must analyze for all of the parameters listed on the discharge permit. Parameters include general chemistry, metals, BOD/COD, oil and grease, ammonia, nitrates, etc.
- Department of Energy Mixed Analyte Performance Evaluation Program (MAPEP). A semiannual program developed by DOE in support of DOE contractors performing waste analyses. Participation is required for all laboratories that perform environmental analytical measurements in support of environmental management activities. This program includes radioactive isotopes in water, soil, vegetation and air filters.
- ERA's MRAD-Multimedia Radiochemistry Proficiency test program. This program is for labs seeking certification for radionuclides in wastewater and solid waste. The program is conducted in strict compliance with USEPA National Standards for Water Proficiency study.
- ERA's InterLaB RadChem Proficiency Testing Program for radiological analyses. This program completes the process of replacing the USEPA EMSL-LV Nuclear Radiation Assessment Division program discontinued in 1998. Laboratories seeking certification for radionuclide analysis in drinking water also use the study. This program is conducted in strict compliance with the USEPA National Standards for Water Proficiency Testing Studies. This program encompasses Uranium by EPA method 200.8 (for drinking water certification in Utah/Primary NELAP), gamma emitters, Gross Alpha/Beta, Iodine-131, naturally occurring radioactive isotopes, Strontium-89/90, and Tritium.

**2013 ANNUAL QUALITY ASSURANCE REPORT**

- ERA's Water Pollution (WP) biannual program for waste methodologies includes parameters for both organic and inorganic analytes.
- ERA's Water Supply (WS) biannual program for drinking water methodologies includes parameters for organic and inorganic analytes.
- Environmental Cross-Check Program administered by Eckert & Ziegler Analytics, Inc. This program encompasses radionuclides in water, soil, milk, naturally occurring radioactive isotopes in soil and air filters.

GEL procures single-blind performance evaluation samples from Eckert & Ziegler Analytics to verify the analysis of sample matrices processed at GEL. Samples are received on a quarterly basis. GEL's Third-Party Cross-Check Program provides environmental matrices encountered in a typical nuclear utility REMP. The Third-Party Cross-Check Program is intended to meet or exceed the inter-laboratory comparison program requirements discussed in NRC Regulatory Guide 4.15. Once performance evaluation samples have been prepared in accordance with the instructions provided by the PT provider, samples are managed and analyzed in the same manner as environmental samples from GEL's clients.

**3. Quality Assurance Program for Internal and External Audits**

During each annual reporting period, at least one internal assessment of each area of the laboratory is conducted in accordance with the pre-established schedule from Standard Operating Procedure for the Conduct of Quality Audits, GL-QS-E-001. The annual internal audit plan is reviewed for adequacy and includes the scheduled frequency and scope of quality control actions necessary to GEL's QA program. Internal audits are conducted at least annually in accordance with a schedule approved by the Quality Systems Director. Supplier audits are contingent upon the categorization of the supplier, and may or may not be conducted prior to the use of a supplier or subcontractor. Type I suppliers and subcontractors, regardless of how they were initially qualified, are re-evaluated at least once every three years.

In addition, prospective customers audit GEL during pre-contract audits. GEL hosts several external audits each year for both our clients and other programs. These programs include environmental monitoring, waste characterization, and radiobioassay. The following list of programs may audit GEL at least annually or up to every three years depending on the program.

- NELAC, National Environmental Laboratory Accreditation Program
- DOECAP, U.S. Department of Energy Consolidated Audit Program
- DOELAP, U.S. Department of Energy Laboratory Accreditation Program
- DOE QSAS, U.S. Department of Energy, Quality Systems for Analytical Services
- ISO/IEC 17025:2005
- A2LA, American Association for Laboratory Accreditation
- DOD ELAP, US Department of Defense Environmental Accreditation Program
- NUPIC, Nuclear Procurement Issues Committee
- South Carolina Department of Health and Environmental Control (SC DHEC)

The annual radiochemistry laboratory internal audit (13-RAD-001) was conducted in August 2013. Three (3) findings, two (2) observations, and one (1) recommendations resulted from this

assessment. By October, 2013, each finding was closed and appropriate laboratory staff addressed each observation and recommendation.

#### **4. Performance Evaluation Acceptance Criteria for Environmental Sample Analysis**

GEL utilized an acceptance protocol based upon two performance models. For those inter-laboratory programs that already have established performance criteria for bias (i.e., MAPEP, and ERA/ELAP), GEL will utilize the criteria for the specific program. For intra-laboratory or third party quality control programs that do not have a specific acceptance criteria (i.e. the Eckert-Ziegler Analytics Environmental Cross-check Program), results will be evaluated in accordance with GEL's internal acceptance criteria.

#### **5. Performance Evaluation Samples**

Performance Evaluation (PE) results and internal quality control sample results are evaluated in accordance with GEL acceptance criteria. The first criterion concerns bias, which is defined as the deviation of any one result from the known value. The second criterion concerns precision, which deals with the ability of the measurement to be replicated by comparison of an individual result with the mean of all results for a given sample set.

At GEL, we also evaluate our analytical performance on a regular basis through statistical process control (SPC) acceptance criteria. Where feasible, this criterion is applied to both measures of precision and accuracy and is specific to sample matrix. We establish environmental process control limits at least annually.

For Radiochemistry analysis, quality control evaluation is based on static limits rather than those that are statistically derived. Our current process control limits are maintained in GEL's AlphaLIMS. We also measure precision with matrix duplicates and/or matrix spike duplicates. The upper and lower control limits (UCL and LCL respectively) for precision are plus or minus three times the standard deviation from the mean of a series of relative percent differences. The static precision criteria for radiochemical analyses are 0 - 20%, for activity levels exceeding the contract required detection limit (CRDL).

#### **6. Quality Control Program for Environmental Sample Analysis**

GEL's internal QA Program is designed to include QC functions such as instrumentation calibration checks (to insure proper instrument response), blank samples, instrumentation backgrounds, duplicates, as well as overall staff qualification analyses and statistical process controls. Both quality control and qualification analyses samples are used to be as similar as the matrix type of those samples submitted for analysis by the various laboratory clients. These performance test samples (or performance evaluation samples) are either actual sample submitted in duplicate in order to evaluate the precision of laboratory measurements, or fortified blank samples, which have been given a known quantity of a radioisotope that is in the interest to GEL's clients.

Accuracy (or Bias) is measured through laboratory control samples and/or matrix spikes, as well as surrogates and internal standards. The UCLs and LCLs for accuracy are plus or minus three times the standard deviation from the mean of a series of recoveries. The static limit for

**2013 ANNUAL QUALITY ASSURANCE REPORT**

radiochemical analyses is 75 - 125%. Specific instructions for out-of-control situations are provided in the applicable analytical SOP.

GEL's Laboratory Control Standard (LCS) is an aliquot of reagent water or other blank matrix to which known quantities of the method analytes are added in the laboratory. The LCS is analyzed exactly like a sample, and its purpose is to determine whether the methodology is in control, and whether the laboratory is capable of making accurate and precise measurements. Some methods may refer to these samples as Laboratory Fortified Blanks (LFB). The requirement for recovery is between 75 and 125% for radiological analyses excluding drinking water matrix.

$$\text{Bias (\%)} = \frac{(\text{observed concentration})}{(\text{known concentration})} * 100 \%$$

Precision is a data quality indicator of the agreement between measurements of the same property, obtained under similar conditions, and how well they conform to themselves. Precision is usually expressed as standard deviation, variance or range in either absolute or relative (percentage) terms.

GEL's laboratory duplicate (DUP or LCSD) is an aliquot of a sample taken from the same container and processed in the same manner under identical laboratory conditions. The aliquot is analyzed independently from the parent sample and the results are compared to measure precision and accuracy.

If a sample duplicate is analyzed, it will be reported as Relative Percent Difference (RPD). The RPD must be 20 percent or less, if both samples are greater than 5 times the MDC. If both results are less than 5 times MDC, then the RPD must be equal to or less than 100%. If one result is above the MDC and the other is below the MDC, then the RPD can be calculated using the MDC for the result of the one below the MDC. The RPD must be 100% or less. In the situation where both results are above the MDC but one result is greater than 5 times the MDC and the other is less than 5 times the MDC, the RPD must be less than or equal to 20%. If both results are below MDC, then the limits on % RPD are not applicable.

$$\text{Difference (\%)} = \frac{(\text{high duplicate result} - \text{low duplicate result})}{(\text{average of results})} * 100 \%$$

## 7. Summary of Data Results

During 2013, forty-four (44) radioisotopes associated with seven (7) matrix types were analyzed under GEL's Performance Evaluation program in participation with ERA, MAPEP, and Eckert & Ziegler Analytics. Matrix types were representative of client analyses performed during 2012. Of the four hundred twenty-three (423) total results reported, 97% (410 of 423) were found to be acceptable. The list below contains the type of matrix evaluated by GEL.

- Air Filter
- Cartridge
- Water
- Milk
- Soil
- Liquid





- Vegetation

Graphs are provided in Figures 1-9 of this report to allow for the evaluation of trends or biases. These graphs include radioisotopes Cobalt-60, Cesium-137, Tritium, Strontium-90, Gross Alpha, Gross Beta, Iodine-131, Americium-241, and Plutonium-238.

#### **8. Summary of Participation in the Eckert & Ziegler Analytics Environmental Cross-Check Program**

Eckert & Ziegler Analytics provided samples for eighty-nine (89) individual environmental analyses. The accuracy of each result reported to Eckert & Ziegler Analytics, Inc. is measured by the ratio of GEL's result to the known value. All results fell within GEL's acceptance criteria (100%).

#### **9. Summary of Participation in the MAPEP Monitoring Program**

MAPEP Series 27, 28 and 29 were analyzed by the laboratory. Of the one hundred thirty-eight (138) analyses, 96% (133 out of 138) of all results fell within the PT provider's acceptance criteria. Five analytical failures occurred: Uranium-238/235 and Total Uranium in vegetation by ICP/MS, and Uranium-234/233, and Urabuyn-238 by Alpha Spectroscopy.

For the corrective actions associated with MAPEP Series 28, refer to CARR130513-789 which is detailed in Table 8.

#### **10. Summary of Participation in the ERA MRaD PT Program**

The ERA MRaD program provided samples (MRAD-18 and MRAD-19) for one hundred fifty (150) individual environmental analyses. One hundred forty-five (145) of the 150 analyses fell within the PT provider's acceptance criteria (97%). Five analytical failures occurred: Cesium-134, Cesium-137 and Zinc-65 in soil, and Uranium-234 and Total Uranium in vegetation.

For the corrective actions associated with MRAD-18 and MRAD-19, refer to CARR130522-791 and CARR131205-845 which are detailed in Table 8.

#### **11. Summary of Participation in the ERA PT Program**

The ERA program provided samples (RAD-92 and RAD-94) for forty-six (46) individual environmental analyses. Of the 44 analyses, 93% (43 out of 44) of all results fell within the PT provider's acceptance criteria. Two analytical failures occurred: Gross Alpha and Strontium-89 in water.

For the corrective actions associated with RAD-92 refer to corrective actions CARR130826-810 (Table 8).

#### **12. Corrective Action Request and Report (CARR)**

There are two categories of corrective action at GEL. One is corrective action implemented at the analytical and data review level in accordance with the analytical SOP. The other is formal corrective action documented by the Quality Systems Team in accordance with GL-QS-E-002. A



formal corrective action is initiated when a nonconformance reoccurs or is so significant that permanent elimination or prevention of the problem is required. Formal corrective action investigations include root cause analysis.

GEL includes quality requirements in most analytical standard operating procedures to ensure that data are reported only if the quality control criteria are met or the quality control measures that did not meet the acceptance criteria are documented. A formal corrective action is implemented according to GL-QS-E-002 for Conducting Corrective/Preventive Action and Identifying Opportunities for Improvement. Recording and documentation is performed following guidelines stated in GL-QS-E-012 for Client NCR Database Operation.

Any employee at GEL can identify and report a nonconformance and request that corrective action be taken. Any GEL employee can participate on a corrective action team as requested by the QS team or Group Leaders. The steps for conducting corrective action are detailed in GL-QS-E-002. In the event that correctness or validity of the laboratory's test results in doubt, the laboratory will take corrective action. If investigations show that the results have been impacted, affected clients will be informed of the issue in writing within five (5) calendar days of the discovery.

Table 8 provides the status of CARRs for radiological performance testing during 2013. **It has been determined that causes of the failures did not impact any data reported to our clients.**



### 13. References

1. GEL Quality Assurance Plan, GL-QS-B-001
2. GEL Standard Operating Procedure for the Conduct of Quality Audits, GL-QS-E-001
3. GEL Standard Operating Procedure for Conducting Corrective/Preventive Action and Identifying Opportunities for Improvement, GL-QS-E-002
4. GEL Standard Operating Procedure for AlphaLIMS Documentation of Nonconformance Reporting and Dispositioning and Control of Nonconforming Items, GL-QS-E-004
5. GEL Standard Operating Procedure for Handling Proficiency Evaluation Samples, GL-QS-E-013
6. GEL Standard Operating Procedure for Quality Assurance Measurement Calculations and Processes, GL-QS-E-014
7. 40 CFR Part 136 Guidelines Establishing Test Procedures for the Analysis of Pollutants
8. ISO/IEC 17025-2005, General Requirements for the Competence of Testing and Calibration Laboratories
9. ANSI/ASQC E4-1994, Specifications and Guidelines for Quality Systems for Environmental Data Collection and Environmental Technology Programs, American National Standard
10. 2003 NELAC Standard, National Environmental Laboratory Accreditation Program
11. 2009 TNI Standard, The NELAC Institute, National Environmental Accreditation Program
12. MARLAP, Multi-Agency Radiological Laboratory Analytical Protocols
13. 10 CFR Part 21, Reporting of Defects and Noncompliance
14. 10 CFR Part 50 Appendix B, Quality Assurance Criteria for Nuclear Power Plants and Fuel Reprocessing Plants
15. 10 CFR Part 61, Licensing Requirements for Land Disposal and Radioactive Waste
16. NRC REG Guide 4.15 and NRC REG Guide 4.8



TABLE 1  
2013 RADIOLOGICAL PROFICIENCY TESTING RESULTS AND ACCEPTANCE CRITERIA

PT Provider	Quarter / Year	Analytical Date	Sample Number	Sample Media	Unit	Analyte / Nuclide	GEL Value	Known value	Acceptance Range/ Ratio	Evaluation
MAPEP	1st/ 2013	02/27/13	GENE01-13-RdFR1	Filter	Bq/sample	Uranium-234/233	0.0143	0.0155	0.0109-0.0202	Acceptable
MAPEP	1st/ 2013	02/27/13	GENE01-13-RdFR1	Filter	Bq/sample	Uranium-238	0.0999	0.098	0.069-0.127	Acceptable
EZA	4th/2012	02/01/13	E10323	Cartridge	pCi	Iodine-131	7.31E+01	7.29E+01	1.00	Acceptable
EZA	4th/2012	02/01/13	E10324	Milk	pCi/L	Strontium-89	9.18E+01	9.66E+01	0.95	Acceptable
EZA	4th/2012	02/01/13	E10324	Milk	pCi/L	Strontium-90	9.89E+00	1.38E+01	0.72	Acceptable
EZA	4th/2012	02/01/13	E10325	Milk	pCi/L	Iodine-131	9.57E+01	9.00E+01	1.06	Acceptable
EZA	4th/2012	02/01/13	E10325	Milk	pCi/L	Chromium-51	3.67E+02	3.48E+02	1.06	Acceptable
EZA	4th/2012	02/01/13	E10325	Milk	pCi/L	Cesium-134	1.54E+02	1.65E+02	0.93	Acceptable
EZA	4th/2012	02/01/13	E10325	Milk	pCi/L	Cesium-137	1.18E+02	1.17E+02	1.01	Acceptable
EZA	4th/2012	02/01/13	E10325	Milk	pCi/L	Cobalt-58	9.85E+01	9.85E+01	1	Acceptable
EZA	4th/2012	02/01/13	E10325	Milk	pCi/L	Manganese-54	1.16E+02	1.16E+02	1	Acceptable
E	4th/2012	02/01/13	E10325	Milk	pCi/L	Iron-59	1.33E+02	1.16E+02	1.15	Acceptable
EZA	4th/2012	02/01/13	E10325	Milk	pCi/L	Zinc-65	3.19E+02	2.91E+02	1.09	Acceptable
EZA	4th/2012	02/01/13	E10325	Milk	pCi/L	Cobalt-60	1.73E+02	1.70E+02	1.02	Acceptable
EZA	4th/2012	02/01/13	E10325	Milk	pCi/L	Cesium-141	5.38E+01	5.10E+01	1.05	Acceptable
EZA	4th/2012	02/01/13	E10380	Water	pCi/L	Iodine-131	7.47E+01	7.25E+01	1.03	Acceptable
EZA	4th/2012	02/01/13	E10380	Water	pCi/L	Chromium-51	3.81E+02	3.62E+02	1.05	Acceptable
EZA	4th/2012	02/01/13	E10380	Water	pCi/L	Cesium-134	1.57E+02	1.73E+02	0.91	Acceptable
EZA	4th/2012	02/01/13	E10380	Water	pCi/L	Cesium-137	1.25E+02	1.22E+02	1.03	Acceptable
EZA	4th/2012	02/01/13	E10380	Water	pCi/L	Cobalt-58	1.02E+02	1.03E+02	0.99	Acceptable
EZA	4th/2012	02/01/13	E10380	Water	pCi/L	Manganese-54	1.28E+02	1.21E+02	1.06	Acceptable
EZA	4th/2012	02/01/13	E10380	Water	pCi/L	Iron-59	1.38E+02	1.21E+02	1.14	Acceptable
EZA	4th/2012	02/01/13	E10380	Water	pCi/L	Zinc-65	2.13E+02	1.94E+02	1.1	Acceptable
EZA	4th/2012	02/01/13	E10380	Water	pCi/L	Cobalt-60	1.80E+02	1.77E+02	1.01	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Barium-133	55.4	54.4	44.9-60.2	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Cesium-134	27.2	29.9	23.4-32.9	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Cesium-137	74.3	75.3	67.8-85.5	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Cobalt-60	89.0	97.7	87.9-110	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Zinc-65	126	114	103-136	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Gross Alpha	26.0	24.8	12.5-33.0	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Gross Beta	19.4	19.3	11.3-27.5	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Gross Alpha	31.4	24.8	12.5-33.0	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Radium-226	10.4	9.91	7.42-11.6	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Radium-228	4.84	5.22	3.14-6.96	Acceptable
E	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Uranium (Nat)	6.43	5.96	4.47-7.13	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	ug/L	Uranium (Nat) mass	9.59	8.69	6.50-10.4	Acceptable



ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Radium-226	11.60	9.91	7.42-11.6	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Radium-228	5.13	5.22	3.14-6.96	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Uranium (Nat)	5.95	5.96	4.47-7.13	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	ug/L	Uranium (Nat) mass	9.95	8.69	6.50-10.4	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Tritium	1430	1320	1040-1480	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Strontium-89	47.5	48	37.6-55.3	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Strontium-90	35.9	39.8	29.2-45.8	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Strontium-89	42.9	48	37.6-55.3	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Strontium-90	34.6	39.8	29.2-45.8	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Iodine-131	23.6	22.7	18.8-27.0	Acceptable
ERA	1st/ 2013	02/28/13	RAD - 92	Water	pCi/L	Iodine-131	27	22.7	18.8-27.0	Acceptable
EZA	1st/ 2013	04/25/13	E10469	Cartridge	pCi	Iodine-131	9.38E+01	9.27E+01	1.01	Acceptable
EZA	1st/ 2013	04/25/13	E10470	Milk	pCi/L	Strontium-89	1.07E+02	9.97E+01	1.07	Acceptable
EZA	1st/ 2013	04/25/13	E10470	Milk	pCi/L	Strontium-90	1.18E+01	1.10E+01	1.07	Acceptable
EZA	1st/ 2013	04/25/13	E10471	Milk	pCi/L	Iodine-131	3.54E+00	1.67E+00	1.12	Acceptable
EZA	1st/ 2013	04/25/13	E10471	Milk	pCi/L	Cerium-141	2.00E+01	1.87E+01	1.07	Acceptable
EZA	1st/ 2013	04/25/13	E10471	Milk	pCi/L	Chromium-51	5.09E+01	4.72E+01	1.08	Acceptable
EZA	1st/ 2013	04/25/13	E10471	Milk	pCi/L	Cesium-134	2.06E+02	2.14E+02	0.96	Acceptable
EZA	1st/ 2013	04/25/13	E10471	Milk	pCi/L	Cesium-137	2.83E+02	2.66E+02	1.07	Acceptable
EZA	1st/ 2013	04/25/13	E10471	Milk	pCi/L	Cobalt-58	2.19E+02	2.08E+02	1.05	Acceptable
EZA	1st/ 2013	04/25/13	E10471	Milk	pCi/L	Mn-54	2.21E+02	2.08E+02	1.06	Acceptable
EZA	1st/ 2013	04/25/13	E10471	Milk	pCi/L	Iron-59	2.78E+02	2.52E+02	1.1	Acceptable
EZA	1st/ 2013	04/25/13	E10471	Milk	pCi/L	Zinc-65	3.39E+02	3.01E+02	1.13	Acceptable
EZA	1st/ 2013	04/25/13	E10471	Milk	pCi/L	Cobalt-60	4.02E+02	4.00E+02	1.01	Acceptable
EZA	1st/ 2013	04/25/13	E10472	Water	pCi/L	Iodine-131	1.12E+02	9.28E+01	1.21	Acceptable
EZA	1st/ 2013	04/25/13	E10472	Water	pCi/L	Cerium-141	1.88E+02	1.79E+02	1.05	Acceptable
EZA	1st/ 2013	04/25/13	E10472	Water	pCi/L	Chromium-51	4.84E+02	4.52E+02	1.07	Acceptable
EZA	1st/ 2013	04/25/13	E10472	Water	pCi/L	Cesium-134	1.96E+02	2.05E+02	0.96	Acceptable
EZA	1st/ 2013	04/25/13	E10472	Water	pCi/L	Cesium-137	2.71E+02	2.54E+02	1.07	Acceptable
EZA	1st/ 2013	04/25/13	E10472	Water	pCi/L	Cobalt-58	2.03E+02	1.99E+02	1.02	Acceptable
EZA	1st/ 2013	04/25/13	E10472	Water	pCi/L	Mn-54	2.15E+02	1.99E+02	1.08	Acceptable
EZA	1st/ 2013	04/25/13	E10472	Water	pCi/L	Iron-59	2.67E+02	2.41E+02	1.11	Acceptable
EZA	1st/ 2013	04/25/13	E10472	Water	pCi/L	Zinc-65	3.14E+02	2.88E+02	1.09	Acceptable
EZA	1st/ 2013	04/25/13	E10472	Water	pCi/L	Cobalt-60	3.92E+02	3.83E+02	1.02	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-27-GrF28	Filter	Bq/sample	Gross Alpha	0.656	1.20	0.36-2.04	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-27-GrF29	Filter	Bq/sample	Gross Beta	0.954	0.85	0.43-1.28	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Americium-241	118	113	79-147	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Cesium-134	829	887	621-1153	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Cesium-137	623	587	411-763	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Cobalt-57	1.04	0	False Pos Test	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Cobalt-60	737	691	484-898	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Iron-55	-0.380	0	False Pos Test	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Manganese-54	0.760	0	False Pos Test	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Nickel-63	719	670	469-871	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Plutonium-238	0.571	0.52	Sens. Eval.	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Plutonium-	77.70	79.5	55.7-103.4	Acceptable



						239/240				
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Potassium-40	713	625	438-813	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Strontium-90	693.0	628	440-816	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Technetium-99	419.0	444	311-577	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Uranium-234/233	60.0	62.5	43.8-81.3	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Uranium-238	274	281	197-365	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Zinc-65	1130	995	697-1294	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaW28	Water	Bq/L	Americium-241	0.690	0.689	0.428-0.896	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaW28	Water	Bq/L	Cesium-134	21.1	24.4	17.1-31.7	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaW28	Water	Bq/L	Cesium-137	0.10	0.0	False Pos Test	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaW28	Water	Bq/L	Cobalt-57	31.0	30.9	21.6-40.2	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaW28	Water	Bq/L	Cobalt-60	19.4	19.6	13.7-25.4	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaW28	Water	Bq/L	Hydrogen-3	517	507	355-659	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaW28	Water	Bq/L	Iron-55	39.7	44.0	30.8-57.2	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaW28	Water	Bq/L	Manganese-54	28.0	27.4	19.2-35.6	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaW28	Water	Bq/L	Nickel-63	32.9	33.4	23.4-43.4	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaW28	Water	Bq/L	Plutonium-238	0.825	0.884	0.619-1.149	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaW28	Water	Bq/L	Pu-239/240	0.0162	0.0096	Sens. Eval.	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaW28	Water	Bq/L	Potassium-40	-0.471	0	False Pos Test	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaW28	Water	Bq/L	Strontium-90	12.5	10.5	7.4-13.7	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaW28	Water	Bq/L	Technetium-99	12.9	13.1	9.2-17.0	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaW28	Water	Bq/L	Uranium-234/233	0.289	0.315	0.221-0.410	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaW28	Water	Bq/L	Uranium-238	1.81	1.95	1.37-2.54	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-MaW28	Water	Bq/L	Zinc-65	32.8	30.4	21.3-39.5	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-GrW28	Water	Bq/L	Gross Alpha	2.60	2.31	0.69-3.93	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-GrW28	Water	Bq/L	Gross Beta	14.2	13.0	6.5-19.5	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-XaW28	Water	Bq/L	Iodine-129	5.94	6.06	4.24-7.88	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdF28	Filter	ug/sample	Uranium-235	0.036	0.036	0.025-0.047	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdF28	Filter	ug/sample	Uranium-238	18.0	18.6	13.0-24.2	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdF28	Filter	ug/sample	Uranium-Total	17.7	18.6	13.0-24.2	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdF28	Filter	ug/sample	Americium-241	0.106	0.104	0.073-0.135	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Cesium-134	1.75	1.78	1.25-2.31	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Cesium-137	2.71	2.60	1.82-3.38	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Cobalt-57	2.51	2.36	1.65-3.07	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Cobalt-60	0.005	0.00	False Pos Test	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Manganese-54	4.43	4.26	2.98-5.54	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Plutonium-238	0.124	0.127	0.089-0.165	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Pu-239/240	0.118	0.1210	0.085-0.157	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Strontium-90	1.54	1.49	1.04-1.94	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Uranium-234/233	0.0342	0.0318	0.0223-0.0413	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Uranium-238	0.230	0.231	0.162-0.300	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Zinc-65	3.38	3.13	2.19-4.07	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-GrF28	Filter	Bq/sample	Gross Alpha	0.656	1.20	0.36-2.04	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-GrF28	Filter	Bq/sample	Gross Beta	0.95	0.85	0.43-1.28	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Americium-241	0.106	0.104	0.073-0.135	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdV28	Vegetation	ug/sample	Uranium-235	0.0029	0.001	0.0009-0.0017	Not Accept.
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdV28	Vegetation	ug/sample	Uranium-238	0.419	0.180	0.13-0.23	Not Accept.
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdV28	Vegetation	ug/sample	Uranium-Total	0.4219	0.180	0.13-0.23	Not Accept.
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdV28	Vegetation	ug/sample	Americium-241	0.1350	0.140	0.098-0.182	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Cesium-134	0.0525	0.00	False Pos Test	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Cesium-137	7.13	6.87	4.81-8.93	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Cobalt-57	8.86	8.68	6.08-11.28	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Cobalt-60	6.07	5.85	4.10-7.61	Acceptable



MAPEP	2nd/2013	05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Manganese-54	-0.002	0.00	False Pos Test	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Plutonium-238	0.110	0.110	0.077-0.143	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Pu-239/240	0.113	0.123	0.086-0.160	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Strontium-90	1.358	1.64	1.15-2.13	Acceptable
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Uranium-234/233	0.0081	0.0038	Sens. Eval.	Not Accept.
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Uranium-238	0.00489	0.002	Sens. Eval.	Not Accept.
MAPEP	2nd/2013	05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Zinc-65	6.59	6.25	4.38-8.13	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Actinium-228	1500	1240	795-1720	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Americium-241	225	229	134-297	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Bismuth-212	1250	1240	330-1820	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Bismuth-214	4410	3660	2200-5270	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Cesium-134	7850	6370	4160-7650	Not Accept.
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Cesium-137	8070	6120	4690-7870	Not Accept.
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Cobalt-60	10300	7920	5360-10900	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Lead-212	1290	1240	812-1730	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Lead-214	4690	3660	2140-5460	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Manganese-54	<63.4	<1000	0-1000	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Plutonium-238	651	788.00	474-1090	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Plutonium-239	320	366.00	239-506	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Potassium-40	10300	10300	7520-13800	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Strontium-90	6730	8530	3250-13500	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Thorium-234	3290	1900	601-3570	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Zinc-65	1910	1400	1110-1860	Not Accept.
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Strontium-90	6730	8530	3250-13500	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Uranium-234	1210	1920	1170-2460	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Uranium-238	1630	1900	1180-2410	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Soil	pCi/kg	Uranium-Total	2840	3920	2130-5170	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Soil	ug/kg	Uranium-Total(mass)	4150	5710	3150-7180	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Vegetation	pCi/kg	Americium-241	629	553	338-735	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Vegetation	pCi/kg	Cesium-134	1400	1240	797-1610	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Vegetation	pCi/kg	Cesium-137	687	544	394-757	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Vegetation	pCi/kg	Cobalt-60	2410	1920	1320-2680	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Vegetation	pCi/kg	Curium-244	1420	1340	657-2090	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Vegetation	pCi/kg	Manganese-54	<47.4	<300	0.00-300	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Vegetation	pCi/kg	Plutonium-238	2060	1980	1180-2710	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Vegetation	pCi/kg	Plutonium-239	2230	2260	1390-3110	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Vegetation	pCi/kg	Potassium-40	35600	31900	23000-44800	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Vegetation	pCi/kg	Strontium-90	3720	3840	2190-5090	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Vegetation	pCi/kg	Uranium-234	2650	2460	1620-3160	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Vegetation	pCi/kg	Uranium-238	2580	2440	1630-3100	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Vegetation	pCi/kg	Uranium-Total	5361	5010	3390-6230	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Vegetation	ug/kg	Uranium-Total(mass)	7740	7310	4900-9280	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Vegetation	pCi/kg	Zinc-65	1150	878	633-1230	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Filter	pCi/Filter	Americium-241	62.9	66.8	41.2-90.4	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Filter	pCi/Filter	Cesium-134	1080	1110	706-1380	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Filter	pCi/Filter	Cesium-137	971	940	706-1230	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Filter	pCi/Filter	Cobalt-60	217	214	166-267	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Filter	pCi/Filter	Iron-55	224	225	69.8-440	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Filter	pCi/Filter	Manganese-54	<5.27	<50.0	0-50.0	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Filter	pCi/Filter	Plutonium-238	48.0	50.1	34.3-65.9	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Filter	pCi/Filter	Plutonium-239	62.7	65.2	47.2-85.2	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Filter	pCi/Filter	Strontium-90	139	138	67.4-207	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Filter	pCi/Filter	Uranium-234	54.5	59.4	36.8-89.6	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Filter	pCi/Filter	Uranium-238	58.5	58.9	38.1-81.4	Acceptable



ERA	2nd/2013	05/22/13	MRAD-18	Filter	pCi/Filter	Uranium-Total	117	121	67.0-184	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Filter	ug/Filter	Uranium-Total(mass)	176	176	113-248	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Filter	pCi/Filter	Zinc-65	222	199	142-275	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Filter	pCi/Filter	Gross Alpha	55.5	42.3	14.2-65.7	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Filter	pCi/Filter	Gross Beta	31	25.1	15.9-36.6	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Water	pCi/L	Americium-241	118	118	79.5-158	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Water	pCi/L	Cesium-134	1320	1400	1030-1610	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Water	pCi/L	Cesium-137	1900	1880	1600-2250	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Water	pCi/L	Cobalt-60	2370	2270	1970-2660	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Water	pCi/L	Iron-55	812	712	424-966	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Water	pCi/L	Manganese-54	<7.6	<100	0.00-100	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Water	pCi/L	Plutonium-238	91	99	73.1-123	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Water	pCi/L	Plutonium-239	161	185	144-233	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Water	pCi/L	Strontium-90	144	137	89.2-181	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Water	pCi/L	Uranium-234	47.3	48.8	36.7-62.9	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Water	pCi/L	Uranium-238	50.8	48.4	36.9-59.4	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Water	pCi/L	Uranium-Total	98.1	99.5	73.1-129	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Water	ug/L	Uranium-Total(mass)	152	145	116-175	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Water	pCi/L	Zinc-65	428	384	320-484	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Water	pCi/L	Gross Alpha	138.0	130	46.2-201	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Water	pCi/L	Gross Beta	87	78.9	45.2-117	Acceptable
ERA	2nd/2013	05/22/13	MRAD-18	Water	pCi/L	Tritium	13100	12300	8240-17500	Acceptable
EZA	2nd/2013	08/02/13	E10577	Cartridge	pCi	Iodine-131	9.16E+01	8.96E+01	1.02	Acceptable
EZA	2nd/2013	08/02/13	E10578	Milk	pCi/L	Strontium-89	9.27E+01	9.50E+01	0.98	Acceptable
EZA	2nd/2013	08/02/13	E10578	Milk	pCi/L	Strontium-90	1.20E+01	1.70E+01	0.7	Acceptable
EZA	2nd/2013	08/02/13	E10579	Milk	pCi/L	Iodine-131	9.86E+01	9.55E+01	1.03	Acceptable
EZA	2nd/2013	08/02/13	E10579	Milk	pCi/L	Cerium-141	9.44E+01	9.04E+01	1.04	Acceptable
EZA	2nd/2013	08/02/13	E10579	Milk	pCi/L	Chromium-51	2.58E+02	2.50E+02	1.03	Acceptable
EZA	2nd/2013	08/02/13	E10579	Milk	pCi/L	Cesium-134	1.21E+02	1.25E+02	0.97	Acceptable
EZA	2nd/2013	08/02/13	E10579	Milk	pCi/L	Cesium-137	1.49E+02	1.51E+02	0.99	Acceptable
EZA	2nd/2013	08/02/13	E10579	Milk	pCi/L	Cobalt-58	9.44E+01	9.40E+01	1.00	Acceptable
EZA	2nd/2013	08/02/13	E10579	Milk	pCi/L	Manganese-54	1.80E+02	1.72E+02	1.05	Acceptable
EZA	2nd/2013	08/02/13	E10579	Milk	pCi/L	Iron-59	1.36E+02	1.20E+02	1.14	Acceptable
EZA	2nd/2013	08/02/13	E10579	Milk	pCi/L	Zinc-65	2.39E+02	2.17E+02	1.10	Acceptable
EZA	2nd/2013	08/02/13	E10579	Milk	pCi/L	Cobalt-60	1.77E+02	1.75E+02	1.01	Acceptable
EZA	2nd/2013	08/02/13	E10178	Water	pCi/L	Iodine-131	9.33E+01	9.54E+01	0.98	Acceptable
EZA	2nd/2013	08/02/13	E10178	Water	pCi/L	Cerium-141	1.15E+02	1.10E+02	1.04	Acceptable
EZA	2nd/2013	08/02/13	E10178	Water	pCi/L	Chromium-51	3.40E+02	3.06E+02	1.11	Acceptable
EZA	2nd/2013	08/02/13	E10178	Water	pCi/L	Cesium-134	1.48E+02	1.53E+02	0.97	Acceptable
EZA	2nd/2013	08/02/13	E10178	Water	pCi/L	Cesium-137	1.83E+02	1.84E+02	0.99	Acceptable
EZA	2nd/2013	08/02/13	E10178	Water	pCi/L	Cobalt-58	1.13E+02	1.15E+02	0.99	Acceptable
EZA	2nd/2013	08/02/13	E10178	Water	pCi/L	Manganese-54	2.09E+02	2.10E+02	1.00	Acceptable
EZA	2nd/2013	08/02/13	E10178	Water	pCi/L	Iron-59	1.51E+02	1.46E+02	1.03	Acceptable
EZA	2nd/2013	08/02/13	E10178	Water	pCi/L	Zinc-65	2.86E+02	2.65E+02	1.08	Acceptable
EZA	2nd/2013	08/02/13	E10178	Water	pCi/L	Cobalt-60	2.25E+02	2.14E+02	1.05	Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Barium-133	76.4	740.5	62.4-82.0	Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Cesium-134	68.7	72.4	59.1-79.6	Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Cesium-137	154	155	140-172	Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Cobalt-60	85.3	82.3	74.1-92.9	Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Zinc-65	297	260	234-304	Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Gross Alpha	74.3	57.1	29.8-71.2	Not



	2013									Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Gross Beta	34.3	41.8	27.9-49.2	Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Gross Alpha	67.7	57.1	29.8-71.2	Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Radium-226	16.9	17.2	12.8-19.7	Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Radium-226	17	17.2	12.8-19.7	Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Radium-228	3.53	3.86	2.18-5.4	Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Uranium (Nat)	20.4	21.4	17.1-24.1	Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	ug/L	Uranium (Nat) mass	30.4	31.2	25.0-35.2	Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Radium-226	14.6	17.2	12.8-19.7	Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Uranium (Nat)	21.6	21.4	17.1-24.1	Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	ug/L	Uranium (Nat) mass	33.7	31.2	25-35.2	Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Tritium	12500	13300	11600-14600	Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Strontium-89	48.9	36.5	27.4-43.4	Not Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Strontium-90	14.3	19.8	14.1-23.4	Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Strontium-89	44.3	36.5	27.4-43.4	Not Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Strontium-90	17.3	19.8	14.1-23.4	Acceptable
ERA	3rd / 2013	08/22/13	RAD - 94	Water	pCi/L	Iodine-131	26.1	24.3	20.2-28.8	Acceptable
ERA	3rd/2013	08/22/13	RAD - 94	Water	pCi/L	Iodine-131	23.3	24.3	20.2-28.8	Acceptable
EZA	3rd/2013	10/25/13	E10625	Cartridge	pCi	Iodine-131	8.57E+01	7.96E+01	1.08	Acceptable
EZA	3rd/2013	10/25/13	E10626	Milk	pCi/L	Strontium-89	9.33E+01	9.60E+01	0.97	Acceptable
EZA	3rd/2013	10/25/13	E10626	Milk	pCi/L	Strontium-90	1.09E+01	1.32E+01	0.83	Acceptable
EZA	3rd/2013	10/25/13	E10627	Milk	pCi/L	Iodine-131	1.00E+02	9.83E+01	1.02	Acceptable
EZA	3rd/2013	10/25/13	E10627	Milk	pCi/L	Chromium-51	3.09E+02	2.77E+02	1.11	Acceptable
EZA	3rd/2013	10/25/13	E10627	Milk	pCi/L	Cesium-134	1.46E+02	1.72E+02	0.85	Acceptable
EZA	3rd/2013	10/25/13	E10627	Milk	pCi/L	Cesium-137	1.33E+02	1.31E+02	1.02	Acceptable
EZA	3rd/2013	10/25/13	E10627	Milk	pCi/L	Cobalt-58	1.04E+02	1.08E+02	0.97	Acceptable
EZA	3rd/2013	10/25/13	E10627	Milk	pCi/L	Manganese-54	1.44E+02	1.39E+02	1.04	Acceptable
EZA	3rd/2013	10/25/13	E10627	Milk	pCi/L	Iron-59	1.43E+02	1.30E+02	1.1	Acceptable
EZA	3rd/2013	10/25/13	E10627	Milk	pCi/L	Zinc-65	2.86E+02	2.66E+02	1.07	Acceptable
EZA	3rd/2013	10/25/13	E10627	Milk	pCi/L	Cobalt-60	2.01E+02	1.96E+02	1.03	Acceptable
EZA	3rd/2013	10/25/13	E10628	Water	pCi/L	Iodine-131	1.01E+02	9.79E+01	1.03	Acceptable
EZA	3rd/2013	10/25/13	E10628	Water	pCi/L	Chromium-51	2.80E+02	2.51E+02	1.12	Acceptable
EZA	3rd/2013	10/25/13	E10628	Water	pCi/L	Cesium-134	1.42E+02	1.56E+02	0.91	Acceptable
EZA	3rd/2013	10/25/13	E10628	Water	pCi/L	Cesium-137	1.19E+02	1.18E+02	1.01	Acceptable
EZA	3rd/2013	10/25/13	E10628	Water	pCi/L	Cobalt-58	9.80E+01	9.73E+01	1.01	Acceptable
EZA	3rd/2013	10/25/13	E10628	Water	pCi/L	Manganese-54	1.29E+02	1.25E+02	1.03	Acceptable
EZA	3rd/2013	10/25/13	E10628	Water	pCi/L	Iron-59	1.23E+02	1.18E+02	1.04	Acceptable
EZA	3rd/2013	10/25/13	E10628	Water	pCi/L	Zinc-65	2.62E+02	2.41E+02	1.09	Acceptable
EZA	3rd/2013	10/25/13	E10628	Water	pCi/L	Cobalt-60	1.87E+02	1.77E+02	1.06	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-GrF29	Filter	Bq/sample	Gross Alpha	1.090	0.900	0.3-1.5	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-GrF29	Filter	Bq/sample	Gross Beta	1.730	1.630	0.82-2.45	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Americium-241	0.00	0	False Pos Test	Acceptable



MAPEP	4th/2013	11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Cesium-134	1090	1172	820-1524	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Cesium-137	1010	977	684-1270	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Cobalt-57	0.0	0	False Pos Test	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Cobalt-60	462.00	451.00	316-586	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Iron-55	887	820	574-1066	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Manganese-54	692	674	472-876	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Nickel-63	525.0	571	400-742	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Plutonium-238	60.8	62	43.1-80.0	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Plutonium-239/240	1.33	0.4	Sens. Eval.	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Potassium-40	638	633	443-823	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Strontium-90	458.0	460	322-598	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Technetium-99	0.0	0	False Pos Test	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Uranium-234/233	26.1	30	21.0-39.0	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Uranium-238	30.0	34	23.8-44.2	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Zinc-65	0.0	0	False Pos Test	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaW29	Water	Bq/L	Americium-241	0.0001	0.000	False Pos Test	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaW29	Water	Bq/L	Cesium-134	27.20	30.0	21.0-39.0	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaW29	Water	Bq/L	Cesium-137	31.8	31.6	22.1-41.1	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaW29	Water	Bq/L	Cobalt-57	0	0.0	False Pos Test	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaW29	Water	Bq/L	Cobalt-60	23.60	23.6	16.51-30.65	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaW29	Water	Bq/L	Hydrogen-3	-3.5	0	False Pos Test	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaW29	Water	Bq/L	Iron-55	53.00	53.3	37.3-69.3	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaW29	Water	Bq/L	Manganese-54	-0.009	0.0	False Pos Test	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaW29	Water	Bq/L	Nickel-63	27.7	26.4	18.5-34.3	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaW29	Water	Bq/L	Plutonium-238	1.070	1.216	0.851-1.581	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaW29	Water	Bq/L	Plutonium-239/240	0.907	0.996	0.697-1.295	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaW29	Water	Bq/L	Potassium-40	0.339	0	False Pos Test	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaW29	Water	Bq/L	Strontium-90	6.65	7.22	5.05-9.39	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaW29	Water	Bq/L	Technetium-99	15.4	16.20	11.3-21.1	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaW29	Water	Bq/L	Uranium-234/233	0.065	0.07	Sens. Eval.	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaW29	Water	Bq/L	Uranium-238	0.031	0.034	Sens. Eval.	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaW29	Water	Bq/L	Zinc-65	36.500	34.60	24.2-45.0	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-MaW29	Water	Bq/L	Gross Alpha	0.793	0.701	0.201-1.192	Acceptable



MAPEP	4th/2013	11/12/13	MAPEP-13-MaW29	Water	Bq/L	Gross Beta	6.220	5.94	2.97-8.91	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdF29	Filter	ug/sample	Uranium-235	0.034	0.032	0.0227-0.0421	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdF29	Filter	ug/sample	Uranium-238	15.8	16.5	11.6-21.5	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdF29	Filter	ug/sample	Uranium-Total	15.80	16.5	11.6-21.5	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdF29	Filter	ug/sample	Americium-241	0.0002	0.000	False Pos Test	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdF29	Filter	Bq/sample	Cesium-134	-0.0016	0.00	False Pos Test	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdF29	Filter	Bq/sample	Cesium-137	3.010	2.70	1.9-3.5	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdF29	Filter	Bq/sample	Cobalt-57	3.530	3.40	2.4-4.4	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdF29	Filter	Bq/sample	Cobalt-60	2.440	2.30	1.6-3.0	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdF29	Filter	Bq/sample	Manganese-54	3.720	3.50	2.5-4.6	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdF29	Filter	Bq/sample	Plutonium-238	0.128	0.124	0.087-0.161	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdF29	Filter	Bq/sample	Plutonium-239/240	0.092	0.0920	0.064-0.12	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdF29	Filter	Bq/sample	Strontium-90	1.690	1.81	1.27-2.35	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdF29	Filter	Bq/sample	Uranium-234/233	0.027	0.0292	0.0204-0.038	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdF29	Filter	Bq/sample	Uranium-238	0.020	0.021	0.144-0.267	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdF29	Filter	Bq/sample	Zinc-65	3.050	2.70	1.9-3.5	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdV29	Vegetation	Bq/sample	Americium-241	0.226	0.19	0.135-0.251	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdV29	Vegetation	Bq/sample	Cesium-134	4.750	5.20	3.64-6.67	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdV29	Vegetation	Bq/sample	Cesium-137	6.910	6.60	4.62-8.58	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdV29	Vegetation	Bq/sample	Cobalt-57	-0.002	0.00	False Pos Test	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdV29	Vegetation	Bq/sample	Cobalt-60	0.008	0.00	False Pos Test	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdV29	Vegetation	Bq/sample	Manganese-54	7.980	7.88	5.52-10.24	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdV29	Vegetation	Bq/sample	Plutonium-238	0.001	0.001	Sens. Eval.	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdV29	Vegetation	Bq/sample	Plutonium-239/240	0.1510	0.171	0.120-0.222	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdV29	Vegetation	Bq/sample	Strontium-90	2.330	2.32	1.62-3.02	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdV29	Vegetation	Bq/sample	Uranium-234/233	0.046	0.047	0.0326-0.0606	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdV29	Vegetation	Bq/sample	Uranium-238	0.332	0.324	0.227-0.421	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-RdV29	Vegetation	Bq/sample	Zinc-65	2.850	2.63	1.84-3.42	Acceptable
MAPEP	4th/2013	11/12/13	MAPEP-13-XaW29	Water	Bq/L	Iodine-129	3.62	3.79	2.65-4.93	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Soil	pCi/kg	Actinium-228	1200	1240	795-1720	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Soil	pCi/kg	Americium-241	186	164	95.9-213	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Soil	pCi/kg	Bismuth-212	1760	1220	325-1790	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Soil	pCi/kg	Bismuth-214	4350	3740	2250-5380	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Soil	pCi/kg	Cesium-134	2690	2820	1840-3390	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Soil	pCi/kg	Cesium-137	3960	4130	3160-5310	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Soil	pCi/kg	Cobalt-60	5490	5680	3840-7820	Acceptable



ERA	4th/2013	11/26/13	MRAD-19	Soil	pCi/kg	Lead-212	1260	1220	799-1700	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Soil	pCi/kg	Lead-214	4700	3740	2180-5580	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Soil	pCi/kg	Manganese-54	<55.2	<1000	0-1000	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Soil	pCi/kg	Plutonium-238	576	658	396-908	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Soil	pCi/kg	Plutonium-239	400	397	260-548	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Soil	pCi/kg	Potassium-40	11200	12400	9080-16700	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Soil	pCi/kg	Strontium-90	8220	6860	2620-10800	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Soil	pCi/kg	Thorium-234	2870	3080	974-5790	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Soil	pCi/kg	Zinc-65	3400	3160	2520-4200	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Soil	pCi/kg	Uranium-234	2870	3080	974-5790	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Soil	pCi/kg	Uranium-238	2979	3080	1910-3910	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Soil	pCi/kg	Uranium-Total	6870	6320	3430-8340	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Soil	ug/kg	Uranium-Total(mass)	8460	9220	5080-11600	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Vegetation	pCi/kg	Americium-241	3800	3630	2220-4830	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Vegetation	pCi/kg	Cesium-134	907	859	552-1120	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Vegetation	pCi/kg	Cesium-137	1220	1030	747-1430	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Vegetation	pCi/kg	Cobalt-60	2100	1880	1300-2630	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Vegetation	pCi/kg	Curium-244	1230	1250	612-1950	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Vegetation	pCi/kg	Manganese-54	<53.3	<300	0-300	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Vegetation	pCi/kg	Plutonium-238	1280	1290	769-1770	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Vegetation	pCi/kg	Plutonium-239	2580	2770	1700-3810	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Vegetation	pCi/kg	Potassium-40	33600	33900	24500-47600	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Vegetation	pCi/kg	Strontium-90	5870	6360	3630-8430	Acceptable
EF	4th/2013	11/26/13	MRAD-19	Vegetation	pCi/kg	Uranium-234	674	654	430-840	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Vegetation	pCi/kg	Uranium-234	1050	654	430-840	Not Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Vegetation	pCi/kg	Uranium-238	655	648	432-823	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Vegetation	pCi/kg	Uranium-Total	1364	1330	901-1660	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Vegetation	pCi/kg	Uranium-Total	1773	1330	901-1660	Not Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Vegetation	ug/kg	Uranium-Total(mass)	1960	1940	1300-2460	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Vegetation	pCi/kg	Zinc-65	1990	1540	1110-2160	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Filter	pCi/Filter	Americium-241	75.2	66.4	40.9-89.9	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Filter	pCi/Filter	Cesium-134	845	868.0	552-1080	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Filter	pCi/Filter	Cesium-137	641	602	452-791	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Filter	pCi/Filter	Cobalt-60	534	494	382-617	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Filter	pCi/Filter	Iron-55	466	389.0	121-760	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Filter	pCi/Filter	Manganese-54	<3.9	<50	0.00-50.0	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Filter	ug/Filter	Plutonium-238	72.8	68.5	46.9-90.1	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Filter	pCi/Filter	Plutonium-239	56.5	53.4	42.4-93.1	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Filter	pCi/Filter	Strontium-90	130	125	61.1-187	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Filter	pCi/Filter	Uranium-234	56	87	35.6-86.6	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Filter	pCi/Filter	Uranium-238	58	56.90	36.8-78.7	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Filter	pCi/Filter	Uranium-Total	116	117	64.8-178	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Filter	ug/Filter	Uranium-Total(mass)	172	171	109-241	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Filter	pCi/Filter	Zinc-65	514	419	300-578	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Filter	ug/Filter	Uranium-Total(mass)	169	171	109-241	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Filter	ug/Filter	Uranium-Total(mass)	150	171	109-241	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Filter	pCi/Filter	Gross Alpha	100	83	27.8-129	Acceptable
E'	4th/2013	11/26/13	MRAD-19	Filter	pCi/Filter	Gross Beta	65.7	56.3	35.6-82.2	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Americium-241	126	126	84.9-169	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Cesium-134	2060.0	2180	1600-2510	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Cesium-137	2730	2760	2340-3310	Acceptable



ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Cobalt-60	1960	1890	1640-2210	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Iron-55	721	689	411-935	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Manganese-54	<7.24	<100	0.00-100	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Plutonium-238	133	138	102-172	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Plutonium-239	98.7	109	84.6-137	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Strontium-90	726	788	513-1040	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Uranium-234	93	99	74.3-128	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Uranium-238	93	98.00	74.7-120	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Uranium-Total	186	201	148-260	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	ug/L	Uranium-Total(mass)	278	294	234-355	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Zinc-65	1560	1370	1140-1730	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Gross Alpha	105.0	97	34.3-150	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Gross Beta	78.8	84.5	48.4-125	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Tritium	8740	9150	6130-13000	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Uranium-234	92.4	98.9	74.3-128	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Uranium-238	96.1	98.0	74.7-120	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Uranium-Total	193	201	148-260	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	ug/L	Uranium-Total(mass)	288	294	234-355	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Uranium-234	95.2	98.9	74.3-128	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Uranium-238	115	98.00	74.7-120	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	pCi/L	Uranium-Total	215	201	148-260	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	ug/L	Uranium-Total(mass)	344	294	234-355	Acceptable
ERA	4th/2013	11/26/13	MRAD-19	Water	ug/L	Uranium-Total(mass)	258	294	234-355	Acceptable



2013 ANNUAL QUALITY ASSURANCE REPORT

TABLE 2

2013 ECKERT & ZIEGLER ANALYTICS PERFORMANCE EVALUATION RESULTS

Report Date	Sample Number	Sample Media	Unit	Analyte / Nuclide	GEL Value	Known value	Acceptance Range/ Ratio	Evaluation
02/01/13	E10323	Cartridge	pCi	Iodine-131	7.31E+01	7.29E+01	1.00	Acceptable
02/01/13	E10324	Milk	pCi/L	Strontium-89	9.18E+01	9.66E+01	0.95	Acceptable
02/01/13	E10324	Milk	pCi/L	Strontium-90	9.89E+00	1.38E+01	0.72	Acceptable
02/01/13	E10325	Milk	pCi/L	Iodine-131	9.57E+01	9.00E+01	1.06	Acceptable
02/01/13	E10325	Milk	pCi/L	Chromium-51	3.67E+02	3.48E+02	1.06	Acceptable
02/01/13	E10325	Milk	pCi/L	Cesium-134	1.54E+02	1.65E+02	0.93	Acceptable
02/01/13	E10325	Milk	pCi/L	Cesium-137	1.18E+02	1.17E+02	1.01	Acceptable
02/01/13	E10325	Milk	pCi/L	Cobalt-58	9.85E+01	9.85E+01	1	Acceptable
02/01/13	E10325	Milk	pCi/L	Manganese-54	1.16E+02	1.16E+02	1	Acceptable
02/01/13	E10325	Milk	pCi/L	Iron-59	1.33E+02	1.16E+02	1.15	Acceptable
02/01/13	E10325	Milk	pCi/L	Zinc-65	3.19E+02	2.91E+02	1.09	Acceptable
02/01/13	E10325	Milk	pCi/L	Cobalt-60	1.73E+02	1.70E+02	1.02	Acceptable
02/01/13	E10325	Milk	pCi/L	Cesium-141	5.38E+01	5.10E+01	1.05	Acceptable
02/01/13	E10380	Water	pCi/L	Iodine-131	7.47E+01	7.25E+01	1.03	Acceptable
02/01/13	E10380	Water	pCi/L	Chromium-51	3.81E+02	3.62E+02	1.05	Acceptable
02/01/13	E10380	Water	pCi/L	Cesium-134	1.57E+02	1.73E+02	0.91	Acceptable
02/01/13	E10380	Water	pCi/L	Cesium-137	1.25E+02	1.22E+02	1.03	Acceptable
02/01/13	E10380	Water	pCi/L	Cobalt-58	1.02E+02	1.03E+02	0.99	Acceptable
02/01/13	E10380	Water	pCi/L	Manganese-54	1.28E+02	1.21E+02	1.06	Acceptable
02/01/13	E10380	Water	pCi/L	Iron-59	1.38E+02	1.21E+02	1.14	Acceptable
02/01/13	E10380	Water	pCi/L	Zinc-65	2.13E+02	1.94E+02	1.1	Acceptable
02/01/13	E10380	Water	pCi/L	Cobalt-60	1.80E+02	1.77E+02	1.01	Acceptable
04/25/13	E10469	Cartridge	pCi	Iodine-131	9.38E+01	9.27E+01	1.01	Acceptable
04/25/13	E10470	Milk	pCi/L	Strontium-89	1.07E+02	9.97E+01	1.07	Acceptable
04/25/13	E10470	Milk	pCi/L	Strontium-90	1.18E+01	1.10E+01	1.07	Acceptable
04/25/13	E10471	Milk	pCi/L	Iodine-131	1.12E+02	1.00E+02	1.12	Acceptable
04/25/13	E10471	Milk	pCi/L	Cerium-141	2.00E+01	1.87E+01	1.07	Acceptable
04/25/13	E10471	Milk	pCi/L	Cr-51	5.09E+01	4.72E+01	1.08	Acceptable
04/25/13	E10471	Milk	pCi/L	Cesium-134	2.06E+02	2.14E+02	0.96	Acceptable
04/25/13	E10471	Milk	pCi/L	Cesium-137	2.83E+02	2.66E+02	1.07	Acceptable
04/25/13	E10471	Milk	pCi/L	Cobalt-58	2.19E+02	2.08E+02	1.05	Acceptable
04/25/13	E10471	Milk	pCi/L	Mn-54	2.21E+02	2.08E+02	1.06	Acceptable
04/25/13	E10471	Milk	pCi/L	Iron-59	2.78E+02	2.52E+02	1.1	Acceptable
04/25/13	E10471	Milk	pCi/L	Zinc-65	3.39E+02	3.01E+02	1.13	Acceptable
04/25/13	E10471	Milk	pCi/L	Cobalt-60	4.02E+02	4.00E+02	1.01	Acceptable
04/25/13	E10472	Water	pCi/L	Iodine-131	1.12E+02	9.28E+01	1.21	Acceptable
04/25/13	E10472	Water	pCi/L	Cerium-141	1.88E+02	1.79E+02	1.05	Acceptable
04/25/13	E10472	Water	pCi/L	Cr-51	4.84E+02	4.52E+02	1.07	Acceptable



2013 ANNUAL QUALITY ASSURANCE REPORT

04/25/13	E10472	Water	pCi/L	Cesium-134	1.96E+02	2.05E+02	0.96	Acceptable
04/25/13	E10472	Water	pCi/L	Cesium-137	2.71E+02	2.54E+02	1.07	Acceptable
04/25/13	E10472	Water	pCi/L	Cobalt-58	2.03E+02	1.99E+02	1.02	Acceptable
04/25/13	E10472	Water	pCi/L	Mn-54	2.15E+02	1.99E+02	1.08	Acceptable
04/25/13	E10472	Water	pCi/L	Iron-59	2.67E+02	2.41E+02	1.11	Acceptable
04/25/13	E10472	Water	pCi/L	Zinc-65	3.14E+02	2.88E+02	1.09	Acceptable
04/25/13	E10472	Water	pCi/L	Cobalt-60	3.92E+02	3.83E+02	1.02	Acceptable
08/02/13	E10577	Cartridge	pCi	Iodine-131	9.16E+01	8.96E+01	1.02	Acceptable
08/02/13	E10578	Milk	pCi/L	Strontium-89	9.27E+01	9.50E+01	0.98	Acceptable
08/02/13	E10578	Milk	pCi/L	Strontium-90	1.20E+01	1.70E+01	0.7	Acceptable
08/02/13	E10579	Milk	pCi/L	Iodine-131	9.86E+01	9.55E+01	1.03	Acceptable
08/02/13	E10579	Milk	pCi/L	Cerium-141	9.44E+01	9.04E+01	1.04	Acceptable
08/02/13	E10579	Milk	pCi/L	Chromium-51	2.58E+02	2.50E+02	1.03	Acceptable
08/02/13	E10579	Milk	pCi/L	Cesium-134	1.21E+02	1.25E+02	0.97	Acceptable
08/02/13	E10579	Milk	pCi/L	Cesium-137	1.49E+02	1.51E+02	0.99	Acceptable
08/02/13	E10579	Milk	pCi/L	Cobalt-58	9.44E+01	9.40E+01	1.00	Acceptable
08/02/13	E10579	Milk	pCi/L	Manganese-54	1.80E+02	1.72E+02	1.05	Acceptable
08/02/13	E10579	Milk	pCi/L	Iron-59	1.36E+02	1.20E+02	1.14	Acceptable
08/02/13	E10579	Milk	pCi/L	Zinc-65	2.39E+02	2.17E+02	1.10	Acceptable
08/02/13	E10579	Milk	pCi/L	Cobalt-60	1.77E+01	1.75E+02	1.01	Acceptable
08/02/13	E10178	Water	pCi/L	Iodine-131	9.33E+01	9.54E+01	0.98	Acceptable
08/02/13	E10178	Water	pCi/L	Cerium-141	1.15E+02	1.10E+02	1.04	Acceptable
08/02/13	E10178	Water	pCi/L	Chromium-51	3.40E+02	3.06E+02	1.11	Acceptable
08/02/13	E10178	Water	pCi/L	Cesium-134	1.48E+02	1.53E+02	0.97	Acceptable
08/02/13	E10178	Water	pCi/L	Cesium-137	1.83E+02	1.84E+02	0.99	Acceptable
08/02/13	E10178	Water	pCi/L	Cobalt-58	1.13E+02	1.15E+02	0.99	Acceptable
08/02/13	E10178	Water	pCi/L	Manganese-54	2.09E+02	2.10E+02	1.00	Acceptable
08/02/13	E10178	Water	pCi/L	Iron-59	1.51E+02	1.46E+02	1.03	Acceptable
08/02/13	E10178	Water	pCi/L	Zinc-65	2.86E+02	2.65E+02	1.08	Acceptable
08/02/13	E10178	Water	pCi/L	Cobalt-60	2.25E+02	2.14E+02	1.05	Acceptable
10/25/13	E10625	Cartridge	pCi	Iodine-131	8.57E+01	7.96E+01	1.08	Acceptable
10/25/13	E10626	Milk	pCi/L	Strontium-89	9.33E+01	9.60E+01	0.97	Acceptable
10/25/13	E10626	Milk	pCi/L	Strontium-90	1.09E+01	1.32E+01	0.83	Acceptable
10/25/13	E10627	Milk	pCi/L	Iodine-131	1.00E+02	9.83E+01	1.02	Acceptable
10/25/13	E10627	Milk	pCi/L	Chromium-51	3.09E+02	2.77E+02	1.11	Acceptable
10/25/13	E10627	Milk	pCi/L	Cesium-134	1.46E+02	1.72E+02	0.85	Acceptable
10/25/13	E10627	Milk	pCi/L	Cesium-137	1.33E+02	1.31E+02	1.02	Acceptable
10/25/13	E10627	Milk	pCi/L	Cobalt-58	1.04E+02	1.08E+02	0.97	Acceptable
10/25/13	E10627	Milk	pCi/L	Manganese-54	1.44E+02	1.39E+02	1.04	Acceptable
10/25/13	E10627	Milk	pCi/L	Iron-59	1.43E+02	1.30E+02	1.1	Acceptable
10/25/13	E10627	Milk	pCi/L	Zinc-65	2.86E+02	2.66E+02	1.07	Acceptable
10/25/13	E10627	Milk	pCi/L	Cobalt-60	2.01E+02	1.96E+02	1.03	Acceptable
10/25/13	E10628	Water	pCi/L	Iodine-131	1.01E+02	9.79E+01	1.03	Acceptable
10/25/13	E10628	Water	pCi/L	Chromium-51	2.80E+02	2.51E+02	1.12	Acceptable



2013 ANNUAL QUALITY ASSURANCE REPORT

10/25/13	E10628	Water	pCi/L	Cesium-134	1.42E+02	1.56E+02	0.91	Acceptable
10/25/13	E10628	Water	pCi/L	Cesium-137	1.19E+02	1.18E+02	1.01	Acceptable
10/25/13	E10628	Water	pCi/L	Cobalt-58	9.80E+01	9.73E+01	1.01	Acceptable
10/25/13	E10628	Water	pCi/L	Manganese-54	1.29E+02	1.25E+02	1.05	Acceptable
10/25/13	E10628	Water	pCi/L	Iron-59	1.23E+02	1.18E+02	1.04	Acceptable
10/25/13	E10628	Water	pCi/L	Zinc-65	2.62E+02	2.41E+02	1.09	Acceptable
10/25/13	E10628	Water	pCi/L	Cobalt-60	1.87E+02	1.77E+02	1.06	Acceptable



TABLE 3  
2013 DEPARTMENT OF ENERGY MIXED ANALYTE PERFORMANCE EVALUATION PROGRAM  
(MAPEP) RESULTS

Report Date	Sample Number	Sample Media	Unit	Analyte / Nuclide	GEL Value	Known value	Acceptance Range/ Ratio	Evaluation
02/27/13	GENE01-27-RdFR1	Filter	Bq/sample	U-234/233	0.0143	0.0155	0.0109-0.0202	Acceptable
02/27/13	GENE01-27-RdFR1	Filter	Bq/sample	Uranium-238	0.0999	0.098	0.069-0.127	Acceptable
05/13/13	MAPEP-13-GrF28	Filter	Bq/sample	Gross Alpha	0.656	1.20	0.36-2.04	Acceptable
05/13/13	MAPEP-13-GrF28	Filter	Bq/sample	Gross Beta	0.954	0.85	0.43-1.28	Acceptable
05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Americium-241	118	113	79-147	Acceptable
05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Cesium-134	829	887	621-1153	Acceptable
05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Cesium-137	623	587	411-763	Acceptable
05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Cobalt-57	1.04	0	False Pos Test	Acceptable
05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Cobalt-60	737	691	484-898	Acceptable
05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Iron-55	-0.380	0	False Pos Test	Acceptable
05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Manganese-54	0.760	0	False Pos Test	Acceptable
05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Nickel-63	719	670	469-871	Acceptable
05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Plutonium-238	0.571	0.52	Sens. Eval.	Acceptabl
05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Plutonium-239/240	77.70	79.5	55.7-103.4	Acceptable
05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Potassium-40	713	625	438-813	Acceptable
05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Strontium-90	693.0	628	440-816	Acceptable
05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Technetium-99	419.0	444	311-577	Acceptable
05/13/13	MAPEP-13-MaS28	Soil	mg/kg	U-234/233	60.0	62.5	43.8-81.3	Acceptable
05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Uranium-238	274	281	197-365	Acceptable
05/13/13	MAPEP-13-MaS28	Soil	mg/kg	Zinc-65	1130	995	697-1294	Acceptable
05/13/13	MAPEP-13-MaW28	Water	Bq/L	Am-241	0.690	0.689	0.428-0.896	Acceptable
05/13/13	MAPEP-13-MaW28	Water	Bq/L	Cesium-134	21.1	24.4	17.1-31.7	Acceptable
05/13/13	MAPEP-13-MaW28	Water	Bq/L	Cesium-137	0.10	0.0	False Pos Test	Acceptable
05/13/13	MAPEP-13-MaW28	Water	Bq/L	Cobalt-57	31.0	30.9	21.6-40.2	Acceptable
05/13/13	MAPEP-13-MaW28	Water	Bq/L	Cobalt-60	19.4	19.6	13.7-25.4	Acceptable
05/13/13	MAPEP-13-MaW28	Water	Bq/L	Hydrogen-3	517	507	355-659	Acceptable
05/13/13	MAPEP-13-MaW28	Water	Bq/L	Iron-55	39.7	44.0	30.8-57.2	Acceptable
05/13/13	MAPEP-13-MaW28	Water	Bq/L	Manganese-54	28.0	27.4	19.2-35.6	Acceptable
05/13/13	MAPEP-13-MaW28	Water	Bq/L	Nickel-63	32.9	33.4	23.4-43.4	Acceptable
05/13/13	MAPEP-13-MaW28	Water	Bq/L	Plutonium-238	0.825	0.884	0.619-1.149	Acceptable
05/13/13	MAPEP-13-MaW28	Water	Bq/L	Pu-239/240	0.0162	0.0096	Sens. Eval.	Acceptable
05/13/13	MAPEP-13-MaW28	Water	Bq/L	Potassium-40	-0.471	0	False Pos Test	Acceptable
05/13/13	MAPEP-13-MaW28	Water	Bq/L	Strontium-90	12.5	10.5	7.4-13.7	Acceptable
05/13/13	MAPEP-13-MaW28	Water	Bq/L	Technetium-99	12.9	13.1	9.2-17.0	Acceptable
05/13/13	MAPEP-13-MaW28	Water	Bq/L	U-234/233	0.289	0.315	0.221-0.410	Acceptabl
05/13/13	MAPEP-13-MaW28	Water	Bq/L	Uranium-238	1.81	1.95	1.37-2.54	Acceptable
05/13/13	MAPEP-13-MaW28	Water	Bq/L	Zinc-65	32.8	30.4	21.3-39.5	Acceptable



2013 ANNUAL QUALITY ASSURANCE REPORT

05/13/13	MAPEP-13-GrW28	Water	Bq/L	Gross Alpha	2.60	2.31	0.69-3.93	Acceptable
05/13/13	MAPEP-13-GrW28	Water	Bq/L	Gross Beta	14.2	13.0	6.5-19.5	Acceptable
05/13/13	MAPEP-13-XaW28	Water	Bq/L	Iodine-129	5.94	6.06	4.24-7.88	Acceptable
05/13/13	MAPEP-13-RdF28	Filter	ug/sample	Uranium-235	0.036	0.036	0.025-0.047	Acceptable
05/13/13	MAPEP-13-RdF28	Filter	ug/sample	Uranium-238	18.0	18.6	13.0-24.2	Acceptable
05/13/13	MAPEP-13-RdF28	Filter	ug/sample	Uranium-Total	17.7	18.6	13.0-24.2	Acceptable
05/13/13	MAPEP-13-RdF28	Filter	ug/sample	Americium-241	0.106	0.104	0.073-0.135	Acceptable
05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Cesium-134	1.75	1.78	1.25-2.31	Acceptable
05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Cesium-137	2.71	2.60	1.82-3.38	Acceptable
05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Cobalt-57	2.51	2.36	1.65-3.07	Acceptable
05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Cobalt-60	0.005	0.00	False Pos Test	Acceptable
05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Manganese-54	4.43	4.26	2.98-5.54	Acceptable
05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Plutonium-238	0.124	0.127	0.089-0.165	Acceptable
05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Pu-239/240	0.118	0.1210	0.085-0.157	Acceptable
05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Strontium-90	1.54	1.49	1.04-1.94	Acceptable
05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	U-234/233	0.0342	0.0318	0.0223-0.0413	Acceptable
05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Uranium-238	0.230	0.231	0.162-0.300	Acceptable
05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Zinc-65	3.38	3.13	2.19-4.07	Acceptable
05/13/13	MAPEP-13-GrF28	Filter	Bq/sample	Gross Alpha	0.656	1.20	0.36-2.04	Acceptable
05/13/13	MAPEP-13-GrF28	Filter	Bq/sample	Gross Beta	0.95	0.85	0.43-1.28	Acceptable
05/13/13	MAPEP-13-RdF28	Filter	Bq/sample	Americium-241	0.106	0.104	0.073-0.135	Acceptable
05/13/13	MAPEP-13-RdV28	Vegetation	ug/sample	Uranium-235	0.0029	0.001	0.0009-0.0017	Not Accept.
05/13/13	MAPEP-13-RdV28	Vegetation	ug/sample	Uranium-238	0.419	0.180	0.13-0.23	Not Accept.
05/13/13	MAPEP-13-RdV28	Vegetation	ug/sample	Uranium-Total	0.4219	0.180	0.13-0.23	Not Accept.
05/13/13	MAPEP-13-RdV28	Vegetation	ug/sample	Americium-241	0.1350	0.140	0.098-0.182	Acceptable
05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Cesium-134	0.0525	0.00	False Pos Test	Acceptable
05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Cesium-137	7.13	6.87	4.81-8.93	Acceptable
05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Cobalt-57	8.86	8.68	6.08-11.28	Acceptable
05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Cobalt-60	6.07	5.85	4.10-7.61	Acceptable
05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Manganese-54	-0.002	0.00	False Pos Test	Acceptable
05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Plutonium-238	0.110	0.110	0.077-0.143	Acceptable
05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Pu-239/240	0.113	0.123	0.086-0.160	Acceptable
05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Strontium-90	1.358	1.64	1.15-2.13	Acceptable
05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	U-234/233	0.0081	0.0038	Sens. Eval.	Not Accept.
05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Uranium-238	0.00489	0.002	Sens. Eval.	Not Accept.
05/13/13	MAPEP-13-RdV28	Vegetation	Bq/sample	Zinc-65	6.59	6.25	4.38-8.13	Acceptable
11/12/13	MAPEP-13-GrF29	Filter	Bq/sample	Gross Alpha	1.090	0.900	0.3-1.5	Acceptable
11/12/13	MAPEP-13-GrF29	Filter	Bq/sample	Gross Beta	1.730	1.630	0.82-2.45	Acceptable
11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Americium-241	0.00	0	False Pos Test	Acceptable
11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Cesium-134	1090	1172	820-1524	Acceptable
11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Cesium-137	1010	977	684-1270	Acceptable
11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Cobalt-57	0.0	0	False Pos Test	Acceptable
11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Cobalt-60	462.00	451.00	316-586	Acceptable
11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Iron-55	887	820	574-1066	Acceptable



11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Manganese-54	692	674	472-876	Acceptable
11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Nickel-63	525.0	571	400-742	Acceptable
11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Plutonium-238	60.8	62	43.1-80.0	Acceptable
11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Plutonium-239/240	1.33	0.4	Sens. Eval.	Acceptable
11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Potassium-40	638	633	443-823	Acceptable
11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Strontium-90	458.0	460	322-598	Acceptable
11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Technetium-99	0.0	0	False Pos Test	Acceptable
11/12/13	MAPEP-13-MaS29	Soil	mg/kg	U-234/233	26.1	30	21.0-39.0	Acceptable
11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Uranium-238	30.0	34	23.8-44.2	Acceptable
11/12/13	MAPEP-13-MaS29	Soil	mg/kg	Zinc-65	0.0	0	False Pos Test	Acceptable
11/12/13	MAPEP-13-MaW29	Water	Bq/L	Americium-241	0.0001	0.000	False Pos Test	Acceptable
11/12/13	MAPEP-13-MaW29	Water	Bq/L	Cesium-134	27.20	30.0	21.0-39.0	Acceptable
11/12/13	MAPEP-13-MaW29	Water	Bq/L	Cesium-137	31.8	31.6	22.1-41.1	Acceptable
11/12/13	MAPEP-13-MaW29	Water	Bq/L	Cobalt-57	0	0.0	False Pos Test	Acceptable
11/12/13	MAPEP-13-MaW29	Water	Bq/L	Cobalt-60	23.60	23.6	16.51-30.65	Acceptable
11/12/13	MAPEP-13-MaW29	Water	Bq/L	Hydrogen-3	-3.5	0	False Pos Test	Acceptable
11/12/13	MAPEP-13-MaW29	Water	Bq/L	Iron-55	53.00	53.3	37.3-69.3	Acceptable
11/12/13	MAPEP-13-MaW29	Water	Bq/L	Manganese-54	-0.009	0.0	False Pos Test	Acceptable
11/12/13	MAPEP-13-MaW29	Water	Bq/L	Nickel-63	27.7	26.4	18.5-34.3	Acceptable
11/12/13	MAPEP-13-MaW29	Water	Bq/L	Plutonium-238	1.070	1.216	0.851-1.581	Acceptable
11/12/13	MAPEP-13-MaW29	Water	Bq/L	Plutonium-239/240	0.907	0.996	0.697-1.295	Acceptable
11/12/13	MAPEP-13-MaW29	Water	Bq/L	Potassium-40	0.339	0	False Pos Test	Acceptable
11/12/13	MAPEP-13-MaW29	Water	Bq/L	Strontium-90	6.65	7.22	5.05-9.39	Acceptable
11/12/13	MAPEP-13-MaW29	Water	Bq/L	Technetium-99	15.4	16.20	11.3-21.1	Acceptable
11/12/13	MAPEP-13-MaW29	Water	Bq/L	Uranium-234/233	0.065	0.07	Sens. Eval.	Acceptable
11/12/13	MAPEP-13-MaW29	Water	Bq/L	Uranium-238	0.031	0.034	Sens. Eval.	Acceptable
11/12/13	MAPEP-13-MaW29	Water	Bq/L	Zinc-65	36.500	34.60	24.2-45.0	Acceptable
11/12/13	MAPEP-13-MaW29	Water	Bq/L	Gross Alpha	0.793	0.701	0.201-1.192	Acceptable
11/12/13	MAPEP-13-MaW29	Water	Bq/L	Gross Beta	6.220	5.94	2.97-8.91	Acceptable
11/12/13	MAPEP-13-RdF29	Filter	ug/sample	Uranium-235	0.034	0.032	0.0227-0.0421	Acceptable
11/12/13	MAPEP-13-RdF29	Filter	ug/sample	Uranium-238	15.8	16.5	11.6-21.5	Acceptable
11/12/13	MAPEP-13-RdF29	Filter	ug/sample	Uranium-Total	15.80	16.5	11.6-21.5	Acceptable
11/12/13	MAPEP-13-RdF29	Filter	ug/sample	Americium-241	0.0002	0.000	False Pos Test	Acceptable
11/12/13	MAPEP-13-RdF29	Filter	Bq/sample	Cesium-134	-0.0016	0.00	False Pos Test	Acceptable
11/12/13	MAPEP-13-RdF29	Filter	Bq/sample	Cesium-137	3.010	2.70	1.9-3.5	Acceptable
11/12/13	MAPEP-13-RdF29	Filter	Bq/sample	Cobalt-57	3.530	3.40	2.4-4.4	Acceptable
11/12/13	MAPEP-13-RdF29	Filter	Bq/sample	Cobalt-60	2.440	2.30	1.6-3.0	Acceptable
11/12/13	MAPEP-13-RdF29	Filter	Bq/sample	Manganese-54	3.720	3.50	2.5-4.6	Acceptable
11/12/13	MAPEP-13-RdF29	Filter	Bq/sample	Plutonium-238	0.128	0.124	0.087-0.161	Acceptable
11/12/13	MAPEP-13-RdF29	Filter	Bq/sample	Plutonium-239/240	0.092	0.0920	0.064-0.12	Acceptable
11/12/13	MAPEP-13-RdF29	Filter	Bq/sample	Strontium-90	1.690	1.81	1.27-2.35	Acceptable





2013 ANNUAL QUALITY ASSURANCE REPORT

TABLE 4  
2013 ERA PROGRAM PERFORMANCE EVALUATION RESULTS

Report Date	Sample Number	Sample Media	Unit	Analyte / Nuclide	GEL Value	Known value	Acceptance Range/ Ratio	Evaluation
02/28/13	RAD - 92	Water	pCi/L	Barium-133	55.4	54.4	44.9-60.2	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Cesium-134	27.2	29.9	23.4-32.9	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Cesium-137	74.3	75.3	67.8-85.5	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Cobalt-60	89.0	97.7	87.9-110	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Zinc-65	126	114	103-136	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Gross Alpha	26.0	24.8	12.5-33.0	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Gross Beta	19.4	19.3	11.3-27.5	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Gross Alpha	31.4	24.8	12.5-33.0	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Radium-226	10.4	9.91	7.42-11.6	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Radium-228	4.84	5.22	3.14-6.96	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Uranium (Nat)	6.43	5.96	4.47-7.13	Acceptable
02/28/13	RAD - 92	Water	ug/L	Uranium (Nat) mass	9.59	8.69	6.50-10.4	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Radium-226	11.60	9.91	7.42-11.6	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Radium-228	5.13	5.22	3.14-6.96	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Uranium (Nat)	5.95	5.96	4.47-7.13	Acceptable
02/28/13	RAD - 92	Water	ug/L	Uranium (Nat) mass	9.95	8.69	6.50-10.4	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Tritium	1430	1320	1040-1480	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Strontium-89	47.5	48	37.6-55.3	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Strontium-90	35.9	39.8	29.2-45.8	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Strontium-89	42.9	48	37.6-55.3	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Strontium-90	34.6	39.8	29.2-45.8	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Iodine-131	23.6	22.7	18.8-27.0	Acceptable
02/28/13	RAD - 92	Water	pCi/L	Iodine-131	27	22.7	18.8-27.0	Acceptable
08/22/13	RAD - 94	Water	pCi/L	Barium-133	76.4	740.5	62.4-82.0	Acceptable
08/22/13	RAD - 94	Water	pCi/L	Cesium-134	68.7	72.4	59.1-79.6	Acceptable
08/22/13	RAD - 94	Water	pCi/L	Cesium-137	154	155	140-172	Acceptable
08/22/13	RAD - 94	Water	pCi/L	Cobalt-60	85.3	82.3	74.1-92.9	Acceptable
08/22/13	RAD - 94	Water	pCi/L	Zinc-65	297	260	234-304	Acceptable
08/22/13	RAD - 94	Water	pCi/L	Gross Alpha	74.3	57.1	29.8-71.2	Not Acceptable
08/22/13	RAD - 94	Water	pCi/L	Gross Beta	34.3	41.8	27.9-49.2	Acceptable
08/22/13	RAD - 94	Water	pCi/L	Gross Alpha	67.7	57.1	29.8-71.2	Acceptable
08/22/13	RAD - 94	Water	pCi/L	Radium-226	16.9	17.2	12.8-19.7	Acceptable
08/22/13	RAD - 94	Water	pCi/L	Radium-226	17	17.2	12.8-19.7	Acceptable
08/22/13	RAD - 94	Water	pCi/L	Radium-228	3.53	3.86	2.18-5.4	Acceptable
08/22/13	RAD - 94	Water	pCi/L	Uranium (Nat)	20.4	21.4	17.1-24.1	Acceptable
08/22/13	RAD - 94	Water	ug/L	Uranium (Nat) mass	30.4	31.2	25.0-35.2	Acceptable
08/22/13	RAD - 94	Water	pCi/L	Radium-226	14.6	17.2	12.8-19.7	Acceptable
08/22/13	RAD - 94	Water	pCi/L	Uranium (Nat)	21.6	21.4	17.1-24.1	Acceptable
08/22/13	RAD - 94	Water	ug/L	Uranium (Nat) mass	33.7	31.2	25-35.2	Acceptable
08/22/13	RAD - 94	Water	pCi/L	Tritium	12500	13300	11600-14600	Acceptable



08/22/13	RAD - 94	Water	pCi/L	Strontium-89	48.9	36.5	27.4-43.4	Not Acceptable
08/22/13	RAD - 94	Water	pCi/L	Strontium-90	14.3	19.8	14.1-23.4	Acceptable
08/22/13	RAD - 94	Water	pCi/L	Strontium-89	44.3	36.5	27.4-43.4	Not Acceptable
08/22/13	RAD - 94	Water	pCi/L	Strontium-90	17.3	19.8	14.1-23.4	Acceptable
08/22/13	RAD - 94	Water	pCi/L	Iodine-131	26.1	24.3	20.2-28.8	Acceptable
08/22/13	RAD - 94	Water	pCi/L	Iodine-131	23.3	24.3	20.2-28.8	Acceptable



## 2013 ANNUAL QUALITY ASSURANCE REPORT

TABLE 5  
2013 ERA PROGRAM (MRAD) PERFORMANCE EVALUATION RESULTS

Report Date	Sample Number	Sample Media	Unit	Analyte / Nuclide	GEL Value	Known value	Acceptance Range/ Ratio	Evaluation
05/22/13	MRAD-18	Soil	pCi/kg	Actinium-228	1500	1240	795-1720	Acceptable
05/22/13	MRAD-18	Soil	pCi/kg	Americium-241	225	229	134-297	Acceptable
05/22/13	MRAD-18	Soil	pCi/kg	Bismuth-212	1250	1240	330-1820	Acceptable
05/22/13	MRAD-18	Soil	pCi/kg	Bismuth-214	4410	3660	2200-5270	Acceptable
05/22/13	MRAD-18	Soil	pCi/kg	Cesium-134	7850	6370	4160-7650	Not Accept.
05/22/13	MRAD-18	Soil	pCi/kg	Cesium-137	8070	6120	4690-7870	Not Accept.
05/22/13	MRAD-18	Soil	pCi/kg	Cobalt-60	10300	7920	5360-10900	Acceptable
05/22/13	MRAD-18	Soil	pCi/kg	Lead-212	1290	1240	812-1730	Acceptable
05/22/13	MRAD-18	Soil	pCi/kg	Lead-214	4690	3660	2140-5460	Acceptable
05/22/13	MRAD-18	Soil	pCi/kg	Manganese-54	<63.4	<1000	0-1000	Acceptable
05/22/13	MRAD-18	Soil	pCi/kg	Plutonium-238	651	788.00	474-1090	Acceptable
05/22/13	MRAD-18	Soil	pCi/kg	Plutonium-239	320	366.00	239-506	Acceptable
05/22/13	MRAD-18	Soil	pCi/kg	Potassium-40	10300	10300	7520-13800	Acceptable
05/22/13	MRAD-18	Soil	pCi/kg	Strontium-90	6730	8530	3250-13500	Acceptable
05/22/13	MRAD-18	Soil	pCi/kg	Thorium-234	3290	1900	601-3570	Acceptable
05/22/13	MRAD-18	Soil	pCi/kg	Zinc-65	1910	1400	1110-1860	Not Accept.
05/22/13	MRAD-18	Soil	pCi/kg	Strontium-90	6730	8530	3250-13500	Acceptable
05/22/13	MRAD-18	Soil	pCi/kg	Uranium-234	1210	1920	1170-2460	Acceptable
05/22/13	MRAD-18	Soil	pCi/kg	Uranium-238	1630	1900	1180-2410	Acceptable
05/22/13	MRAD-18	Soil	pCi/kg	Uranium-Total	2840	3920	2130-5170	Acceptable
05/22/13	MRAD-18	Soil	ug/kg	Uranium-Total(mass)	4150	5710	3150-7180	Acceptable
05/22/13	MRAD-18	Vegetation	pCi/kg	Am-241	629	553	338-735	Acceptable
05/22/13	MRAD-18	Vegetation	pCi/kg	Cesium-134	1400	1240	797-1610	Acceptable
05/22/13	MRAD-18	Vegetation	pCi/kg	Cesium-137	687	544	394-757	Acceptable
05/22/13	MRAD-18	Vegetation	pCi/kg	Cobalt-60	2410	1920	1320-2680	Acceptable
05/22/13	MRAD-18	Vegetation	pCi/kg	Curium-244	1420	1340	657-2090	Acceptable
05/22/13	MRAD-18	Vegetation	pCi/kg	Manganese-54	<47.4	<300	0.00-300	Acceptable
05/22/13	MRAD-18	Vegetation	pCi/kg	Plutonium-238	2060	1980	1180-2710	Acceptable
05/22/13	MRAD-18	Vegetation	pCi/kg	Plutonium-239	2230	2260	1390-3110	Acceptable
05/22/13	MRAD-18	Vegetation	pCi/kg	Potassium-40	35600	31900	23000-44800	Acceptable
05/22/13	MRAD-18	Vegetation	pCi/kg	Strontium-90	3720	3840	2190-5090	Acceptable
05/22/13	MRAD-18	Vegetation	pCi/kg	Uranium-234	2650	2460	1620-3160	Acceptable
05/22/13	MRAD-18	Vegetation	pCi/kg	Uranium-238	2580	2440	1630-3100	Acceptable
05/22/13	MRAD-18	Vegetation	pCi/kg	Uranium-Total	5361	5010	3390-6230	Acceptable
05/22/13	MRAD-18	Vegetation	ug/kg	Uranium-Total(mass)	7740	7310	4900-9280	Acceptable
05/22/13	MRAD-18	Vegetation	pCi/kg	Zinc-65	1150	878	633-1230	Acceptable
05/22/13	MRAD-18	Filter	pCi/Filter	Americium-241	62.9	66.8	41.2-90.4	Acceptable
05/22/13	MRAD-18	Filter	pCi/Filter	Cesium-134	1080	1110	706-1380	Acceptable
05/22/13	MRAD-18	Filter	pCi/Filter	Cesium-137	971	940	706-1230	Acceptable
05/22/13	MRAD-18	Filter	pCi/Filter	Cobalt-60	217	214	166-267	Acceptable
05/22/13	MRAD-18	Filter	pCi/Filter	Iron-55	224	225	69.8-440	Acceptable
05/22/13	MRAD-18	Filter	pCi/Filter	Manganese-54	<5.27	<50.0	0-50.0	Acceptable



2013 ANNUAL QUALITY ASSURANCE REPORT

05/22/13	MRAD-18	Filter	pCi/Filter	Plutonium-238	48.0	50.1	34.3-65.9	Acceptable
05/22/13	MRAD-18	Filter	pCi/Filter	Plutonium-239	62.7	65.2	47.2-85.2	Acceptable
05/22/13	MRAD-18	Filter	pCi/Filter	Strontium-90	139	138	67.4-207	Acceptable
05/22/13	MRAD-18	Filter	pCi/Filter	Uranium-234	54.5	59.4	36.8-89.6	Acceptable
05/22/13	MRAD-18	Filter	pCi/Filter	Uranium-238	58.5	58.9	38.1-81.4	Acceptable
05/22/13	MRAD-18	Filter	pCi/Filter	Uranium-Total	117	121	67.0-184	Acceptable
05/22/13	MRAD-18	Filter	ug/Filter	Uranium-Total(mass)	176	176	113-248	Acceptable
05/22/13	MRAD-18	Filter	pCi/Filter	Zinc-65	222	199	142-275	Acceptable
05/22/13	MRAD-18	Filter	pCi/Filter	Gross Alpha	55.5	42.3	14.2-65.7	Acceptable
05/22/13	MRAD-18	Filter	pCi/Filter	Gross Beta	31	25.1	15.9-36.6	Acceptable
05/22/13	MRAD-18	Water	pCi/L	Americium-241	118	118	79.5-158	Acceptable
05/22/13	MRAD-18	Water	pCi/L	Cesium-134	1320	1400	1030-1610	Acceptable
05/22/13	MRAD-18	Water	pCi/L	Cesium-137	1900	1880	1600-2250	Acceptable
05/22/13	MRAD-18	Water	pCi/L	Cobalt-60	2370	2270	1970-2660	Acceptable
05/22/13	MRAD-18	Water	pCi/L	Iron-55	812	712	424-966	Acceptable
05/22/13	MRAD-18	Water	pCi/L	Manganese-54	<7.6	<100	0.00-100	Acceptable
05/22/13	MRAD-18	Water	pCi/L	Plutonium-238	91	99	73.1-123	Acceptable
05/22/13	MRAD-18	Water	pCi/L	Plutonium-239	161	185	144-233	Acceptable
05/22/13	MRAD-18	Water	pCi/L	Strontium-90	144	137	89.2-181	Acceptable
05/22/13	MRAD-18	Water	pCi/L	Uranium-234	47.3	48.8	36.7-62.9	Acceptable
05/22/13	MRAD-18	Water	pCi/L	Uranium-238	50.8	48.4	36.9-59.4	Acceptable
05/22/13	MRAD-18	Water	pCi/L	Uranium-Total	98.1	99.5	73.1-129	Acceptable
05/22/13	MRAD-18	Water	ug/L	Uranium-Total(mass)	152	145	116-175	Acceptable
05/22/13	MRAD-18	Water	pCi/L	Zinc-65	428	384	320-484	Acceptable
05/22/13	MRAD-18	Water	pCi/L	Gross Alpha	138.0	130	46.2-201	Acceptable
05/22/13	MRAD-18	Water	pCi/L	Gross Beta	87	78.9	45.2-117	Acceptable
05/22/13	MRAD-18	Water	pCi/L	Tritium	13100	12300	8240-17500	Acceptable
11/26/13	MRAD-19	Soil	pCi/kg	Actinium-228	1200	1240	795-1720	Acceptable
11/26/13	MRAD-19	Soil	pCi/kg	Americium-241	186	164	95.9-213	Acceptable
11/26/13	MRAD-19	Soil	pCi/kg	Bismuth-212	1760	1220	325-1790	Acceptable
11/26/13	MRAD-19	Soil	pCi/kg	Bismuth-214	4350	3740	2250-5380	Acceptable
11/26/13	MRAD-19	Soil	pCi/kg	Cesium-134	2690	2820	1840-3390	Acceptable
11/26/13	MRAD-19	Soil	pCi/kg	Cesium-137	3960	4130	3160-5310	Acceptable
11/26/13	MRAD-19	Soil	pCi/kg	Cobalt-60	5490	5680	3840-7820	Acceptable
11/26/13	MRAD-19	Soil	pCi/kg	Lead-212	1260	1220	799-1700	Acceptable
11/26/13	MRAD-19	Soil	pCi/kg	Lead-214	4700	3740	2180-5580	Acceptable
11/26/13	MRAD-19	Soil	pCi/kg	Manganese-54	<55.2	<1000	0-1000	Acceptable
11/26/13	MRAD-19	Soil	pCi/kg	Plutonium-238	576	658	396-908	Acceptable
11/26/13	MRAD-19	Soil	pCi/kg	Plutonium-239	400	397	260-548	Acceptable
11/26/13	MRAD-19	Soil	pCi/kg	Potassium-40	11200	12400	9080-16700	Acceptable
11/26/13	MRAD-19	Soil	pCi/kg	Strontium-90	8220	6860	2620-10800	Acceptable
11/26/13	MRAD-19	Soil	pCi/kg	Thorium-234	2870	3080	974-5790	Acceptable
11/26/13	MRAD-19	Soil	pCi/kg	Zinc-65	3400	3160	2520-4200	Acceptable
11/26/13	MRAD-19	Soil	pCi/kg	Uranium-234	2870	3080	974-5790	Acceptable
11/26/13	MRAD-19	Soil	pCi/kg	Uranium-238	2979	3080	1910-3910	Acceptable
11/26/13	MRAD-19	Soil	pCi/kg	Uranium-Total	6870	6320	3430-8340	Acceptable
11/26/13	MRAD-19	Soil	ug/kg	Uranium-Total(mass)	8460	9220	5080-11600	Acceptable





2013 ANNUAL QUALITY ASSURANCE REPORT

11/26/13	MRAD-19	Vegetation	pCi/kg	Am-241	3800	3630	2220-4830	Acceptable
11/26/13	MRAD-19	Vegetation	pCi/kg	Cesium-134	907	859	552-1120	Acceptable
11/26/13	MRAD-19	Vegetation	pCi/kg	Cesium-137	1220	1030	747-1430	Acceptable
11/26/13	MRAD-19	Vegetation	pCi/kg	Cobalt-60	2100	1880	1300-2630	Acceptable
11/26/13	MRAD-19	Vegetation	pCi/kg	Curium-244	1230	1250	612-1950	Acceptable
11/26/13	MRAD-19	Vegetation	pCi/kg	Manganese-54	<53.3	<300	0-300	Acceptable
11/26/13	MRAD-19	Vegetation	pCi/kg	Plutonium-238	1280	1290	769-1770	Acceptable
11/26/13	MRAD-19	Vegetation	pCi/kg	Plutonium-239	2580	2770	1700-3810	Acceptable
11/26/13	MRAD-19	Vegetation	pCi/kg	Potassium-40	33600	33900	24500-47600	Acceptable
11/26/13	MRAD-19	Vegetation	pCi/kg	Strontium-90	5870	6360	3630-8430	Acceptable
11/26/13	MRAD-19	Vegetation	pCi/kg	Uranium-234	674	654	430-840	Acceptable
11/26/13	MRAD-19	Vegetation	pCi/kg	Uranium-234	1050	654	430-840	Not Acceptable
11/26/13	MRAD-19	Vegetation	pCi/kg	Uranium-238	655	648	432-823	Acceptable
11/26/13	MRAD-19	Vegetation	pCi/kg	Uranium-Total	1364	1330	901-1660	Acceptable
11/26/13	MRAD-19	Vegetation	pCi/kg	Uranium-Total	1773	1330	901-1660	Not Acceptable
11/26/13	MRAD-19	Vegetation	ug/kg	Uranium-Total(mass)	1960	1940	1300-2460	Acceptable
11/26/13	MRAD-19	Vegetation	pCi/kg	Zinc-65	1990	1540	1110-2160	Acceptable
11/26/13	MRAD-19	Filter	pCi/Filter	Americium-241	75.2	66.4	40.9-89.9	Acceptable
11/26/13	MRAD-19	Filter	pCi/Filter	Cesium-134	845	868.0	552-1080	Acceptable
11/26/13	MRAD-19	Filter	pCi/Filter	Cesium-137	641	602	452-791	Acceptable
11/26/13	MRAD-19	Filter	pCi/Filter	Cobalt-60	534	494	382-617	Acceptable
11/26/13	MRAD-19	Filter	pCi/Filter	Iron-55	466	389.0	121-760	Acceptable
11/26/13	MRAD-19	Filter	pCi/Filter	Manganese-54	<3.9	<50	0.00-50.0	Acceptable
11/26/13	MRAD-19	Filter	ug/Filter	Plutonium-238	72.8	68.5	46.9-90.1	Acceptable
11/26/13	MRAD-19	Filter	pCi/Filter	Plutonium-239	56.5	53.4	42.4-93.1	Acceptable
11/26/13	MRAD-19	Filter	pCi/Filter	Strontium-90	130	125	61.1-187	Acceptable
11/26/13	MRAD-19	Filter	pCi/Filter	Uranium-234	56	87	35.6-86.6	Acceptable
11/26/13	MRAD-19	Filter	pCi/Filter	Uranium-238	58	56.90	36.8-78.7	Acceptable
11/26/13	MRAD-19	Filter	pCi/Filter	Uranium-Total	116	117	64.8-178	Acceptable
11/26/13	MRAD-19	Filter	ug/Filter	Uranium-Total(mass)	172	171	109-241	Acceptable
11/26/13	MRAD-19	Filter	pCi/Filter	Zinc-65	514	419	300-578	Acceptable
11/26/13	MRAD-19	Filter	ug/Filter	Uranium-Total(mass)	169	171	109-241	Acceptable
11/26/13	MRAD-19	Filter	ug/Filter	Uranium-Total(mass)	150	171	109-241	Acceptable
11/26/13	MRAD-19	Filter	pCi/Filter	Gross Alpha	100	83	27.8-129	Acceptable
11/26/13	MRAD-19	Filter	pCi/Filter	Gross Beta	65.7	56.3	35.6-82.2	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Americium-241	126	126	84.9-169	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Cesium-134	2060	2180	1600-2510	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Cesium-137	2730	2760	2340-3310	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Cobalt-60	1960	1890	1640-2210	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Iron-55	721	689	411-935	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Manganese-54	<7.24	<100	0.00-100	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Plutonium-238	133	138	102-172	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Plutonium-239	98.7	109	84.6-137	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Strontium-90	726	788	513-1040	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Uranium-234	93	99	74.3-128	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Uranium-238	93	98.00	74.7-120	Acceptable



2013 ANNUAL QUALITY ASSURANCE REPORT

11/26/13	MRAD-19	Water	pCi/L	Uranium-Total	186	201	148-260	Acceptable
11/26/13	MRAD-19	Water	ug/L	Uranium-Total(mass)	278	294	234-355	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Zinc-65	1560	1370	1140-1730	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Gross Alpha	105.0	97	34.3-150	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Gross Beta	78.8	84.5	48.4-125	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Tritium	8740	9150	6130-13000	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Uranium-234	92.4	98.9	74.3-128	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Uranium-238	96.1	98.0	74.7-120	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Uranium-Total	193	201	148-260	Acceptable
11/26/13	MRAD-19	Water	ug/L	Uranium-Total(mass)	288	294	234-355	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Uranium-234	95.2	98.9	74.3-128	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Uranium-238	115	98.00	74.7-120	Acceptable
11/26/13	MRAD-19	Water	pCi/L	Uranium-Total	215	201	148-260	Acceptable
11/26/13	MRAD-19	Water	ug/L	Uranium-Total(mass)	344	294	234-355	Acceptable
11/26/13	MRAD-19	Water	ug/L	Uranium-Total(mass)	258	294	234-355	Acceptable

FIGURE 1

COBALT-60 PERFORMANCE EVALUATION RESULTS AND % BIAS

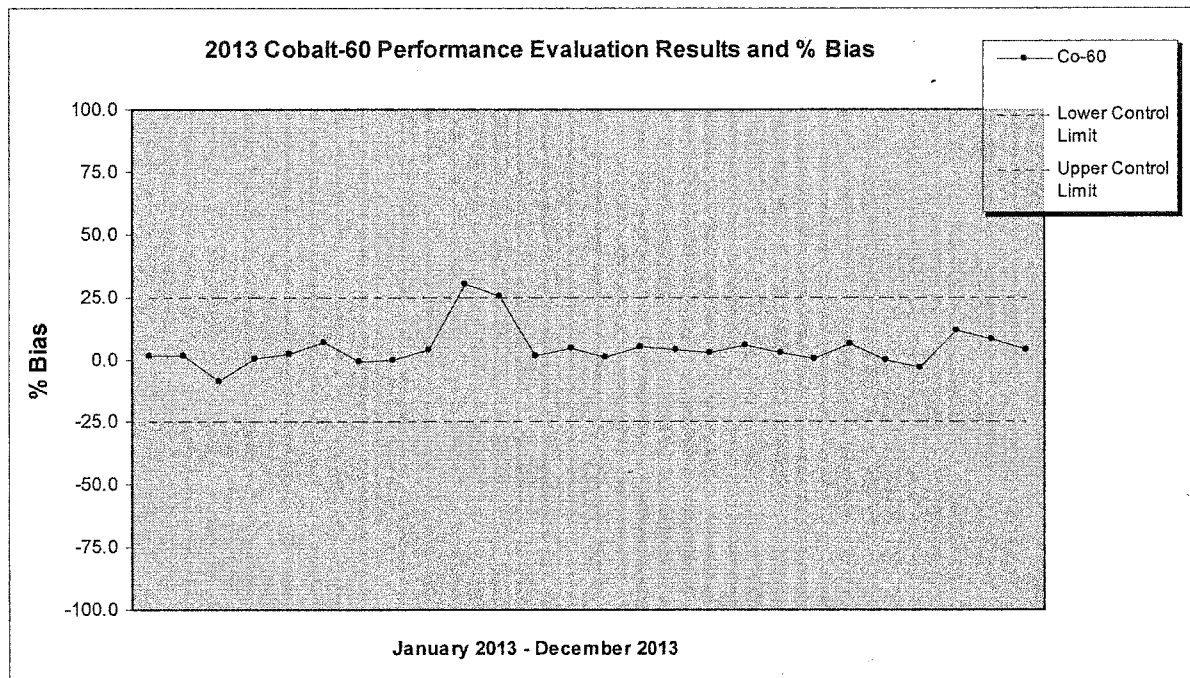


FIGURE 2

CESIUM-137 PERFORMANCE EVALUATION RESULTS AND % BIAS

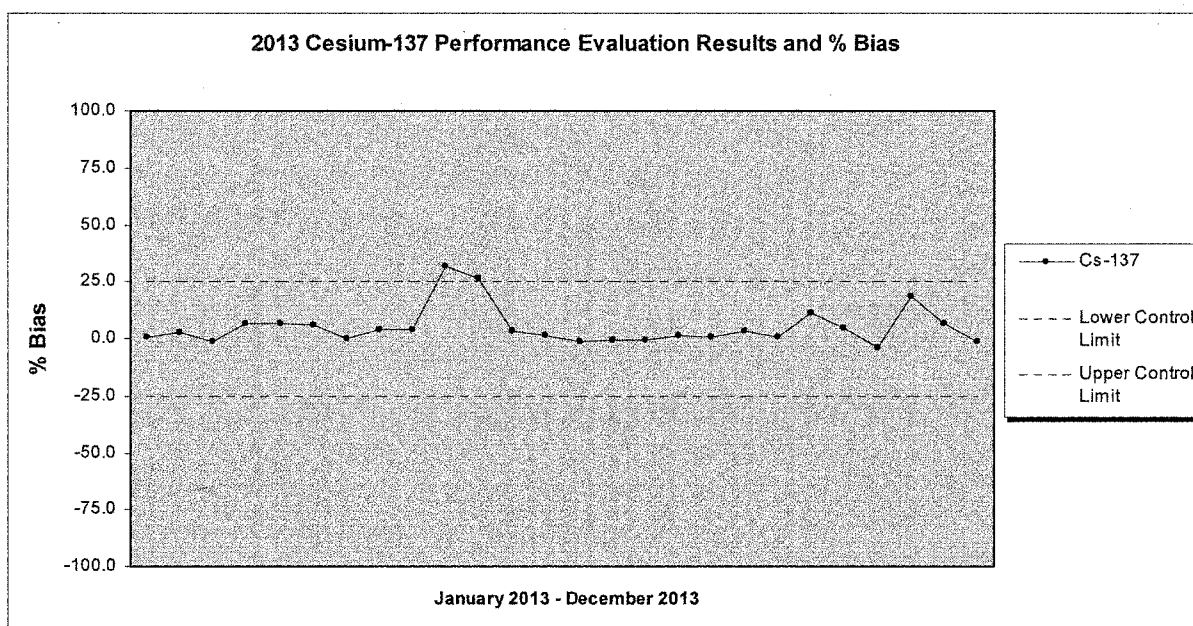


FIGURE 3

## TRITIUM PERFORMANCE EVALUATION RESULTS AND % BIAS

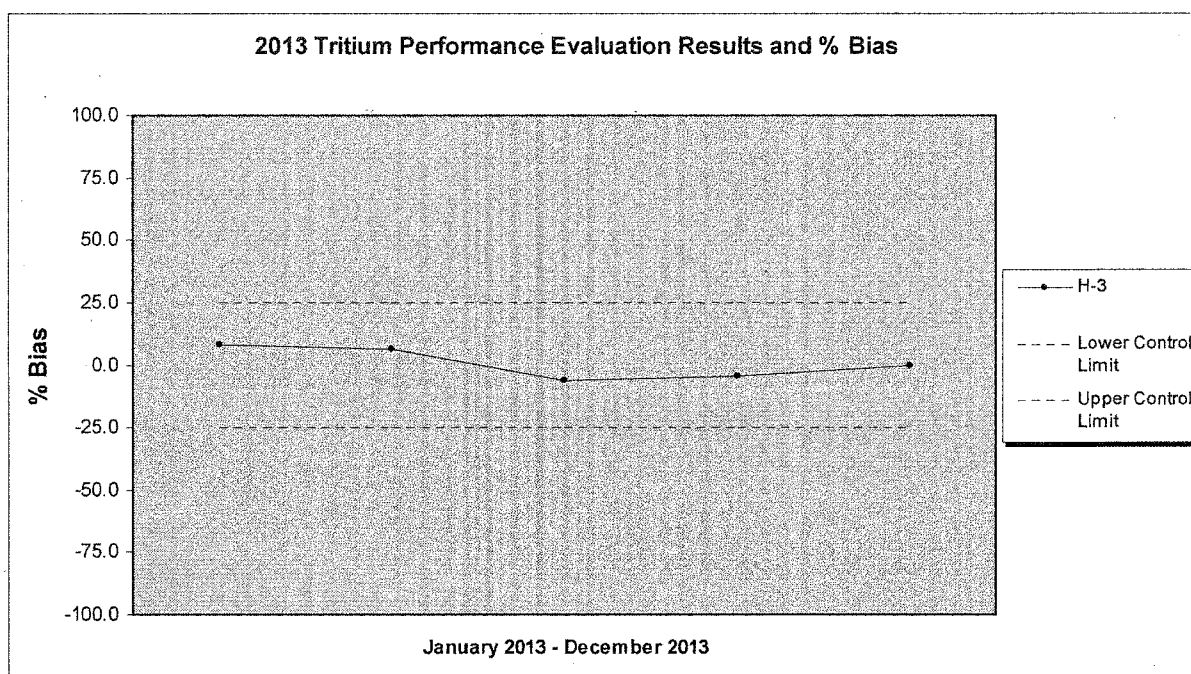


FIGURE 4

STRONTIUM-90 PERFORMANCE EVALUATION RESULTS AND % BIAS

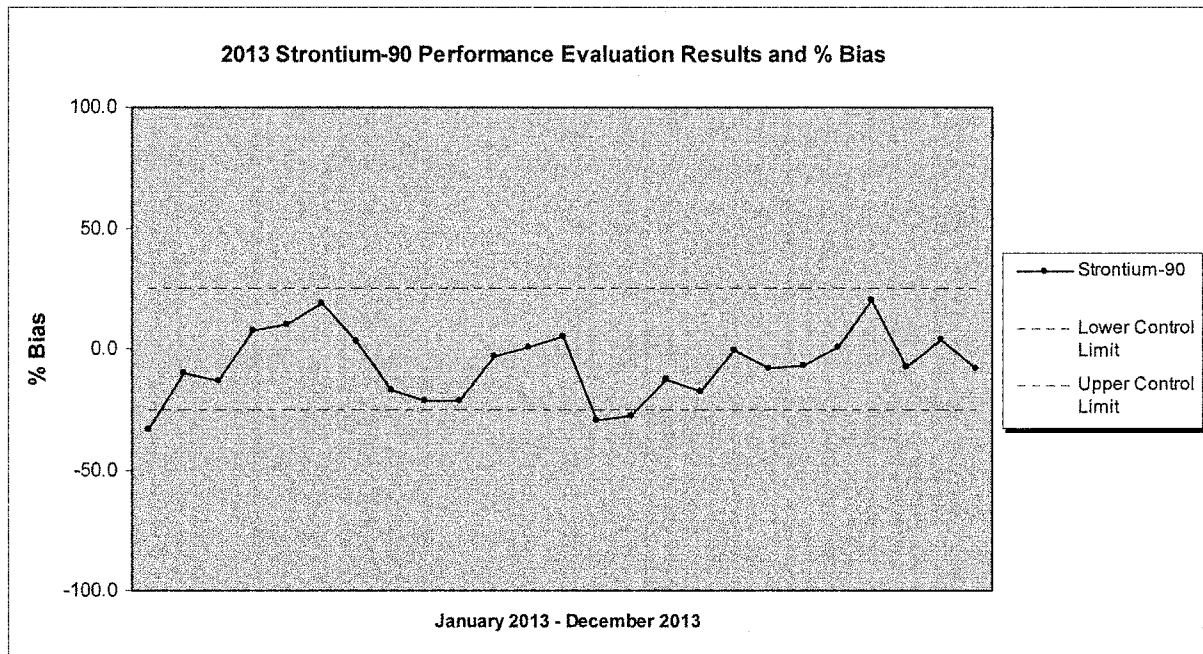


FIGURE 5

GROSS ALPHA PERFORMANCE EVALUATION RESULTS AND % BIAS

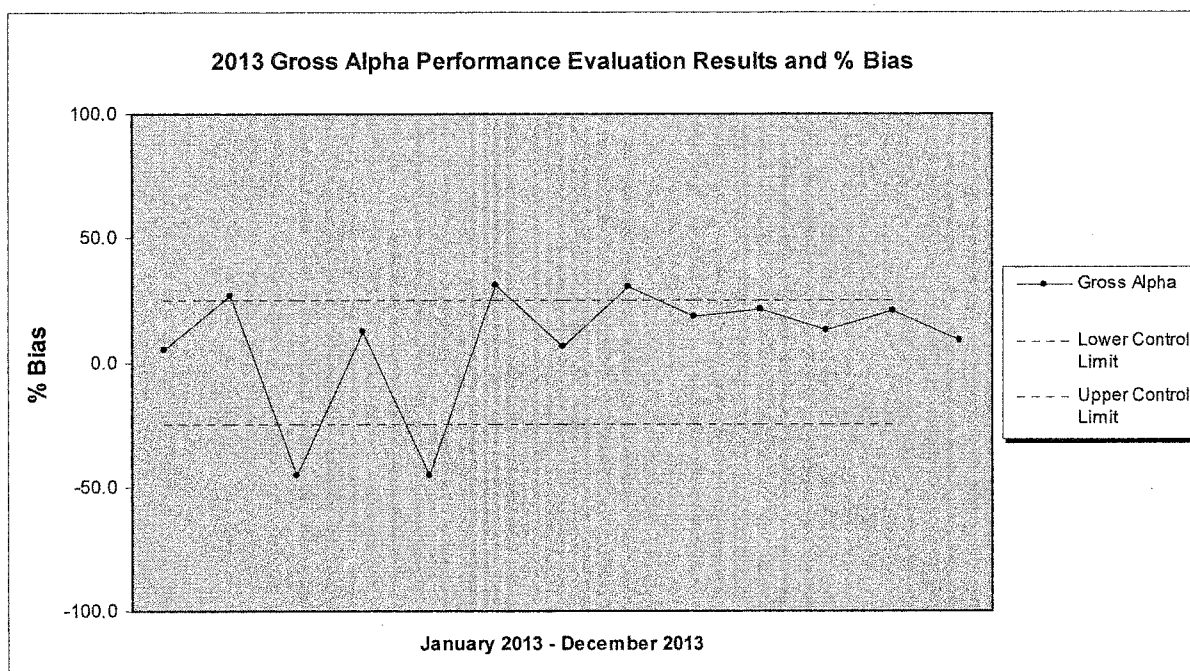


FIGURE 6

GROSS BETA PERFORMANCE EVALUATION RESULTS AND % BIAS

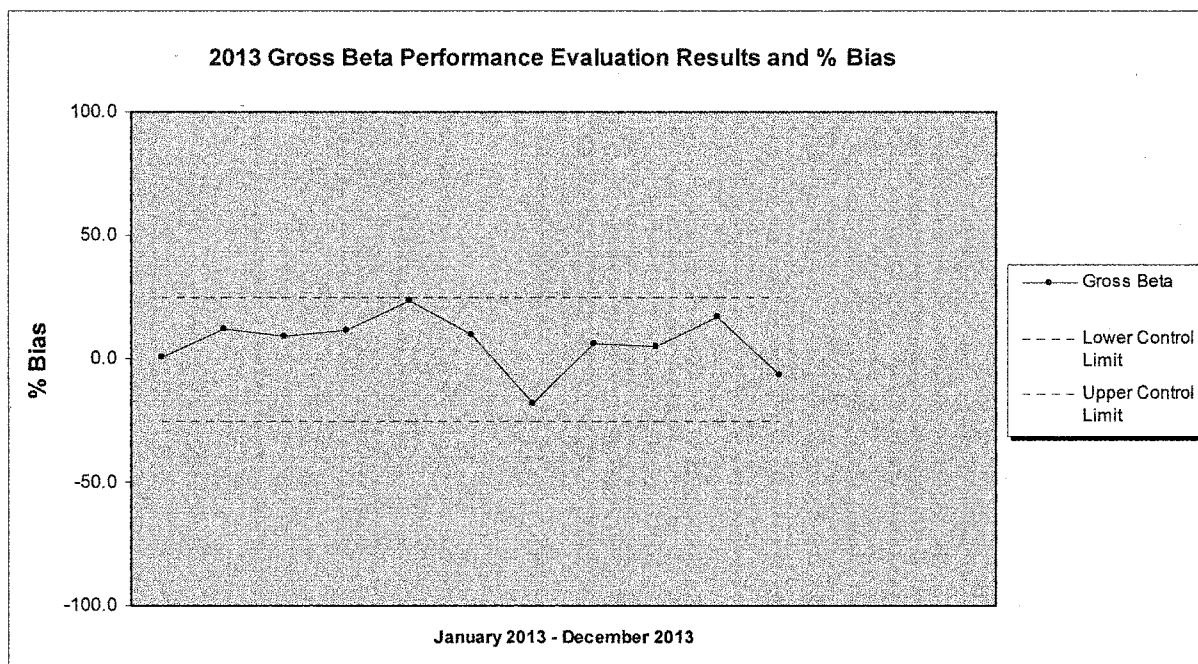




FIGURE 7

## IODINE-131 PERFORMANCE EVALUATION RESULTS AND % BIAS

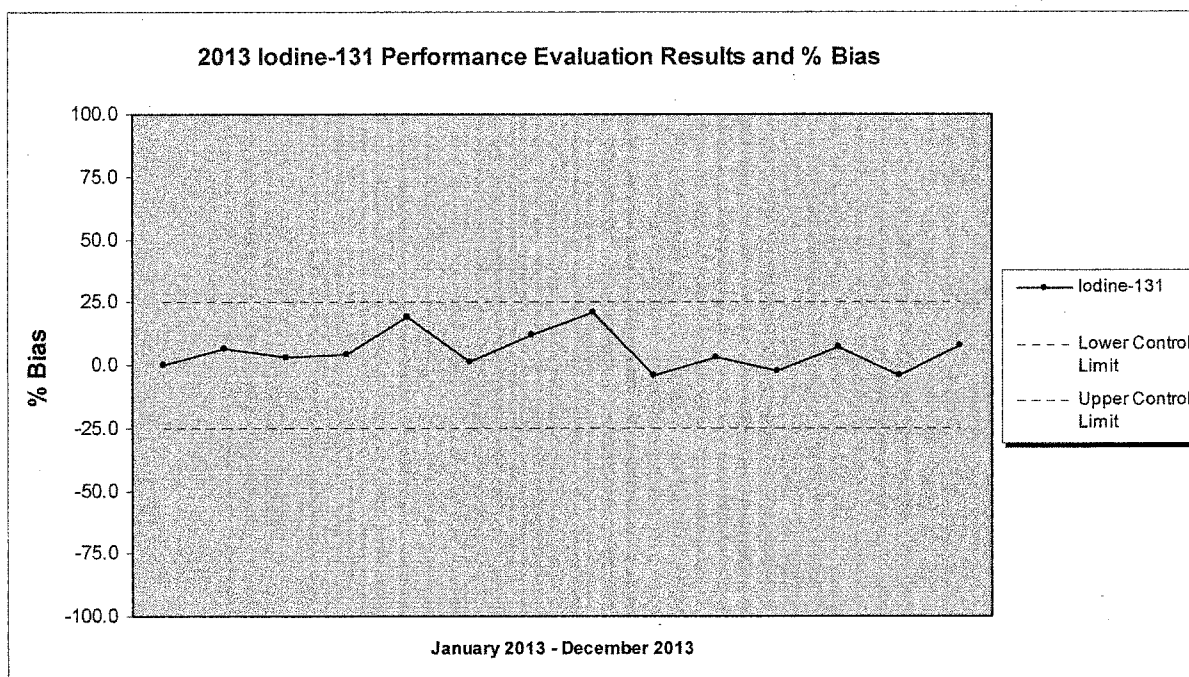


FIGURE 8

AMERICIUM-241 PERFORMANCE EVALUATION RESULTS AND % BIAS

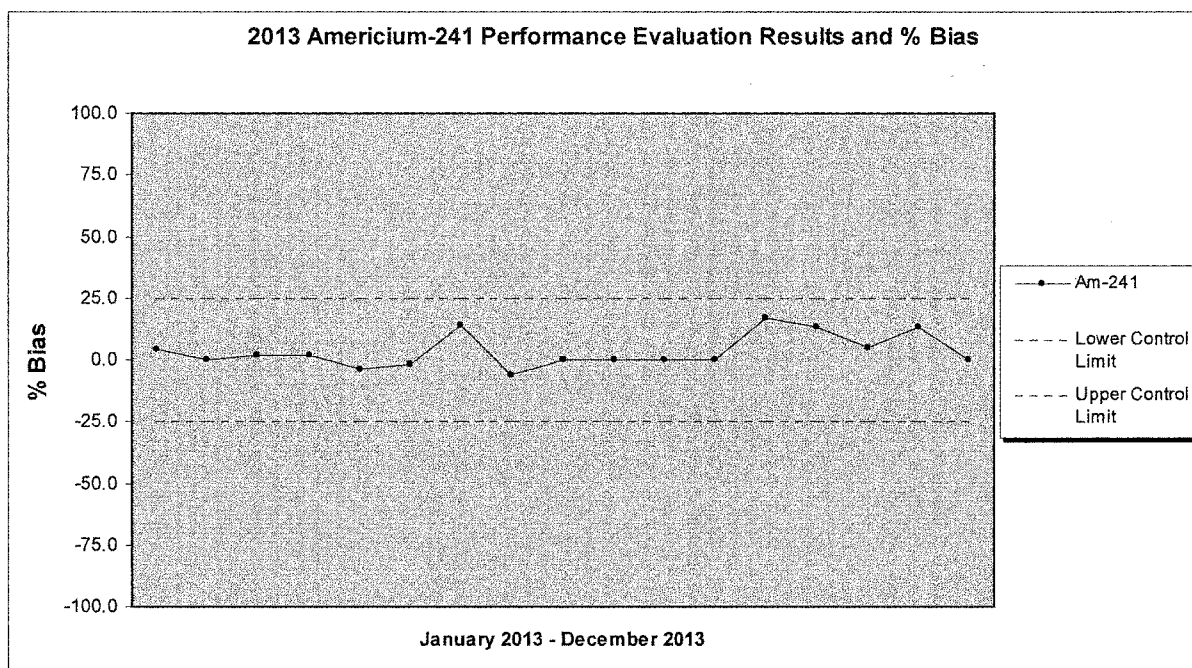


FIGURE 9

PLUTONIUM-238 PERFORMANCE EVALUATION RESULTS AND % BIAS

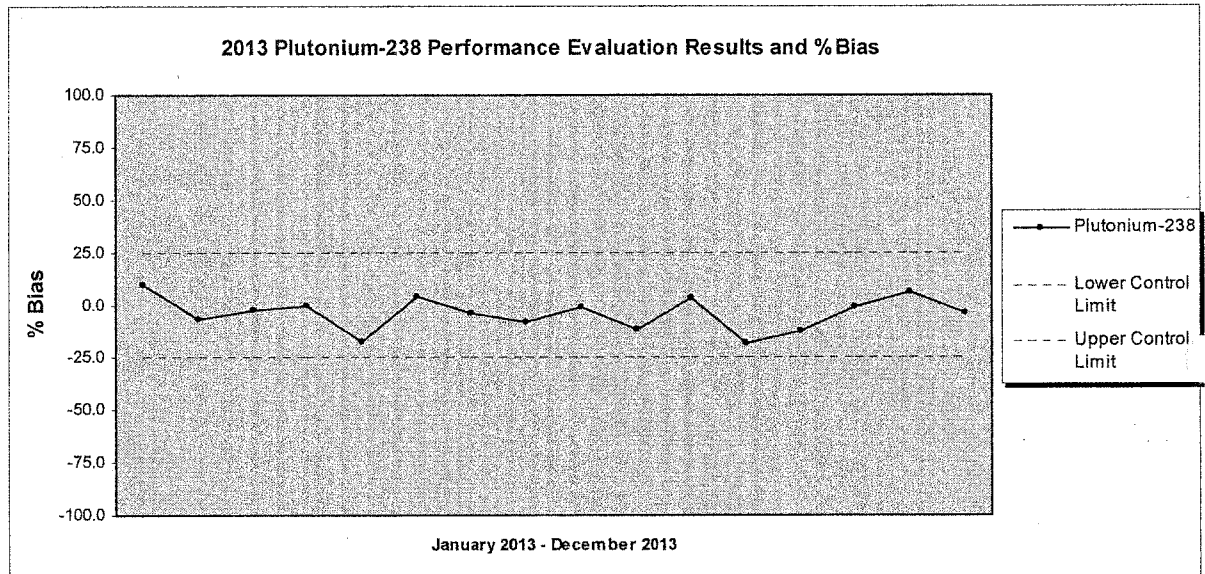




TABLE 6

## REMP INTRA-LABORATORY DATA SUMMARY: BIAS AND PRECISION BY MATRIX

REMP 2013	Bias Criteria (+ / - 25%)		Precision Criteria (Note 1)	
	WITHIN CRITERIA	OUTSIDE CRITERIA	WITHIN CRITERIA	OUTSIDE CRITERIA
<b>MILK</b>				
Gamma Iodine-131	41	0	131	0
Gas Flow Sr 2nd count	46	0	49	0
Gas Flow Total Strontium	35	0	35	0
Gamma Spec Liquid RAD A-013 with Ba, La	61	0	120	0
<b>SOLID</b>				
LSC Iron-55	5	0	5	0
Gamma Spec Solid RAD A-013	28	0	31	0
LSC Nickel 63	5	0	5	0
Gas Flow Sr 2nd count	4	0	4	0
Gas Flow Total Strontium	8	0	8	0
Gamma Spec Solid RAD A-013 with Ba, La	7	0	10	0
Gamma Spec Solid RAD A-013 with Iodine	6	0	7	0
<b>FILTER</b>				
Gamma Spec Filter RAD A-013	4	0	4	0
Gas Flow Sr 2nd Count	5	0	5	0
Alpha Spec Am241Curium	3	0	3	0
Gas Flow Total Strontium	3	0	3	0
Gross A & B	526	0	527	0
Gamma Spec Filter	45	0	51	0
<b>LIQUID</b>				
Alpha Spec Uranium	8	0	9	0
Tritium	336	0	337	0
Plutonium	1	0	1	0
LSC Iron-55	40	0	42	0
LSC Nickel 63	41	0	43	0
Gamma Spec Liquid RAD A-013	7	0	7	0
Gamma Iodine-131	33	0	33	0
Alpha Spec Plutonium	10	0	10	0
Gas Flow Sr 2nd count	20	0	20	0
Alpha Spec Am241 Curium	17	0	17	0
Gas Flow Total Strontium	161	0	163	0
Gross Alpha Non Vol Beta	102	0	104	0
Gamma Spec Liquid RAD A-013 with Ba, La	129	0	209	0
Gamma Spec Liquid RAD A-013 with Iodine	56	0	85	0
<b>TISSUE</b>				



2013 ANNUAL QUALITY ASSURANCE REPORT

Gamma Spec Solid RAD A-013	45	0	48	0
LSC Nickel 63	2	0	2	0
Gas Flow Sr 2nd count	10	0	10	0
Gas Flow Total Strontium	17	0	17	0
Gamma Spec Solid RAD A-013 with Ba, La	6	0	5	0
Gamma Spec Solid RAD A-013 with Iodine	17	0	17	0
<b>SEA WATER</b>				
LSC Iron-55	2	0	2	0
LSC Nickel 63	2	0	2	0
Gas Flow Total Strontium	1	0	1	0
Gross Alpha Non Vol Beta	1	0	1	0
Gamma Spec Liquid RAD A-013 with Iodine	1	0	1	0
<b>VEGETATION</b>				
Gas Flow Sr 2nd count	9	0	9	0
Gamma Spec Solid RAD A-013 with Iodine	91	0	93	0
<b>AIR CHARCOAL</b>				
Gamma Iodine 131 RAD A-013	623	0	645	0
Carbon-14 (Ascarite/Soda Lime Filter per Liter)	46	0	47	0
<b>DRINKING WATER</b>				
Tritium	51	0	52	0
LSC Iron-55	24	0	22	0
LSC Nickel 63	23	0	21	0
Gamma Iodine-131	38	0	38	0
Gas Flow Sr 2nd count	16	0	16	0
Gas Flow Total Strontium	31	0	31	0
Gross Alpha Non Vol Beta	103	0	103	0
Gamma Spec Liquid RAD A-013 with Ba, La	44	0	98	0
<b>Total</b>	<b>2996</b>		<b>3359</b>	

Note 1: The RPD must be 20 percent or less, if both samples are greater than 5 times the MDC. If both results are less than 5 times MDC, then the RPD must be equal to or less than 100%. If one result is above the MDC and the other is below the MDC, then the RPD can be calculated using the MDC for the result of the one below the MDC. The RPD must be 100% or less. In the situation where both results are above the MDC but one result is greater than 5 times the MDC and the other is less than 5 times the MDC, the RPD must be less than or equal to 20%. If both results are below MDC, then the limits on % RPD are not applicable.



TABLE 7  
ALL RADIOLOGICAL INTRA-LABORATORY DATA SUMMARY:  
BIAS AND PRECISION BY MATRIX

ENVIRONMENTAL 2013	Bias Criteria (+ / - 25%)		Precision Criteria (Note 1)	
	WITHIN CRITERIA	OUTSIDE CRITERIA	WITHIN CRITERIA	OUTSIDE CRITERIA
<b>MILK</b>				
Gamma Spec Liquid RAD A-013	8	0	8	0
Gamma Iodine-129	1	0	1	0
Gamma Iodine-131	41	0	131	0
Gas Flow Sr 2nd count	50	0	51	0
Gas Flow Strontium 90	10	0	10	0
Gas Flow Total Strontium	35	0	35	0
Gamma Spec Liquid RAD A-013 with Ba, La	61	0	120	0
Gamma Spec Liquid RAD A-013 with Iodine	5	0	3	0
<b>SOLID</b>				
Gas Flow Radium 228	29	0	29	0
Tritium	266	0	312	0
Carbon-14	136	0	227	0
LSC Iron-55	146	0	165	0
Alpha Spec Polonium Solid	19	0	22	0
Gamma Nickel 59 RAD A-022	138	0	157	0
LSC Chlorine-36 in Solids	8	0	13	0
Gamma Spec Ra226 RAD A-013	35	0	42	0
Gamma Spec Solid RAD A-013	701	0	893	0
LSC Nickel 63	176	0	201	0
LSC Plutonium	223	0	245	0
Technetium-99	309	0	339	0
Gamma Spec Liquid RAD A-013	4	0	4	0
ICP-MS Technetium-99 in Soil	75	0	74	0
LSC Selenium 79	5	0	5	0
Total Activity,	2	0	3	0
Tritium	5	0	5	0
Alpha Spec Am243	33	0	42	0
Gamma Iodine-129	172	0	199	0
Gas Flow Lead 210	18	0	19	0
Total Uranium KPA	10	0	18	0
Alpha Spec Uranium	278	0	380	0
LSC Promethium 147	4	0	4	0
LSC, Rapid Strontium 89 and 90	106	0	120	0
Alpha Spec Thorium	207	0	288	0
Gas Flow Radium 228	2	0	2	0
ICP-MS Uranium-233, 234 in Solid	6	0	5	0



2013 ANNUAL QUALITY ASSURANCE REPORT

Alpha Spec Plutonium	242	0	263	0
ICP-MS Technetium-99 Prep in Soil	78	0	74	0
LSC Calcium 45	2	0	2	0
Alpha Spec Neptunium	234	0	256	0
Alpha Spec Plutonium	157	0	195	0
Alpha Spec Radium 226	7	0	8	0
Gamma Spec Solid with Ra226, Ra228	5	0	6	0
Gas Flow Sr 2nd count	15	0	18	0
Gas Flow Strontium 90	187	0	207	0
Gas Flow Total Radium	1	0	1	0
Lucas Cell Radium 226	71	0	93	0
Total Activity Screen	10	0	13	0
Alpha Spec Am241 Curium	292	0	336	0
Alpha Spec Total Uranium	5	0	6	0
Gas Flow Total Strontium	40	0	44	0
Gross Alpha Non Vol Beta	3	0	3	0
ICP-MS Uranium-233, 234 Prep in Solid	5	0	5	0
ICP-MS Uranium-235, 236, 238 in Solid	7	0	8	0
Alpha Spec Polonium Solid	6	0	4	0
Gamma Spec Solid RAD A-013 with Ba, La	7	0	10	0
Gamma Spec Solid RAD A-013 with Iodine	6	0	7	0
Gamma Spec Solid RAD A-013 (pCi/Sample)	0	0	2	0
Tritium	3	0	3	0
ICP-MS Uranium-234, 235, 236, 238 in Solid	245	0	234	0
ICP-MS Uranium-235, 236, 238 Prep in Solid	5	0	5	0
Gross Alpha/Beta	297	0	405	0
Gross Alpha/Beta (Americium Calibration) Solid	0	0	1	0
ICP-MS Uranium-234, 235, 236, 238 Prep in Solid	122	0	115	0
Lucas Cell Radium 226 by DOE HASL 300 Ra-04 Solid	2	0	2	0
<b>FILTER</b>				
Alpha Spec Uranium	18	0	24	0
Alpha Spec Polonium	0	0	54	0
Gamma I-131, filter	4	0	4	0
LSC Plutonium Filter	143	0	169	3
Tritium	134	0	201	0
Carbon-14	82	0	140	0
Nickel-63	0	0	4	0
LSC Iron-55	147	0	161	0
Gamma Nickel 59 RAD A-022	140	0	159	0
Gamma Iodine 131 RAD A-013	2	0	2	0



## 2013 ANNUAL QUALITY ASSURANCE REPORT

LSC Nickel 63	138	0	162	0
Technetium-99	103	0	137	0
Gamma Spec Filter RAD A-013	195	0	245	0
Alphaspec Np Filter per Liter	30	0	42	0
Alphaspec Pu Filter per Liter	14	0	29	0
Gamma Iodine-125	13	0	0	0
Gamma Iodine-129	114	0	127	0
Gross Alpha/Beta	0	0	1	0
Alpha Spec Am243	13	0	42	0
Gas Flow Lead 210	0	0	4	0
LSC Plutonium Filter per Liter	36	0	43	0
Total Uranium KPA	11	0	18	0
Alpha Spec Uranium	83	0	114	0
LSC, Rapid Strontium 89 and 90	144	0	168	0
Alpha Spec Thorium	45	0	57	0
Gas Flow Radium 228	0	0	2	0
Alpha Spec Plutonium	107	0	123	0
Alpha Spec Neptunium	112	0	129	0
Alpha Spec Plutonium	142	0	183	0
Alpha Spec Polonium,(Filter/Liter)	0	0	10	0
Alpha Spec Radium 226	0	0	1	0
Gas Flow Sr 2nd Count	93	0	101	0
Gas Flow Strontium 90	59	0	78	0
Gas Flow Total Radium	0	0	4	0
Lucas Cell Radium-226	0	0	2	0
Alpha Spec Am241Curium	157	0	198	0
Gas Flow Total Strontium	5	0	5	0
Total Activity in Filter,	0	0	7	0
Alphaspec Am241 Curium Filter per Liter	33	0	42	0
Tritium	106	0	108	0
Gamma Spec Filter RAD A-013 Direct Count	7	0	8	0
Carbon-14	44	0	44	0
Direct Count-Gross Alpha/Beta	72	0	0	0
Gross Alpha/Beta	74	0	81	0
ICP-MS Uranium-234, 235, 236, 238 in Filter	8	0	4	0
Alpha Spec U	31	0	60	0
Gross A & B	639	0	584	0
LSC Iron-55	39	0	51	0
Technetium-99	37	0	55	0
Gas Flow Sr-90	29	0	35	0
LSC Nickel 63	37	0	44	0
Carbon-14 (Ascarite/Soda Lime Filter per Liter)	2	0	2	0
Gas Flow Pb-210	25	0	46	0
Gas Flow Ra-228	24	0	35	0





## 2013 ANNUAL QUALITY ASSURANCE REPORT

Gamma Iodine 129	47	0	47	0
ICP-MS Uranium-234, 235, 236, 238 Prep in Filter	6	0	3	0
Gamma Spec Filter	142	0	163	0
Lucas Cell Ra-226	32	0	47	0
Alpha Spec Thorium	27	0	46	0
<b>LIQUID</b>				
Alpha Spec Uranium	418	0	607	0
Alpha Spec Polonium	2	0	3	0
Electrolytic Tritium	19	0	29	0
Tritium	1415	0	1503	0
Tritium by Combustion	1	0	1	0
Carbon-14	181	0	204	0
Plutonium	81	0	89	0
Chlorine-36 in Liquids	2	0	3	0
Iodine-131	6	0	3	0
LSC Iron-55	290	0	347	0
Gamma Nickel 59 RAD A-022	29	0	33	0
Gamma Iodine 131 RAD A-013	3	0	3	0
Gamma Radium 228 RAD A-013	1	0	1	0
LSC Nickel 63	328	0	370	0
LSC Radon 222	5	0	12	0
Technetium-99	303	0	365	0
Gamma Spec Liquid RAD A-013	874	0	875	0
Alpha Spec Total U RAD A-011	0	0	2	0
LSC Selenium 79	1	0	1	0
Total Activity,	6	0	6	0
Alpha Spec Am243	12	0	20	0
Gamma Iodine-129	84	0	117	0
Gamma Iodine-131	33	0	33	0
ICP-MS Technetium-99 in Water	5	0	28	0
Gas Flow Lead 210	83	0	94	0
Total Uranium KPA	96	0	226	2
LSC Promethium 147	3	0	3	0
LSC, Rapid Strontium 89 and 90	15	0	15	0
Alpha Spec Thorium	205	0	278	0
Gas Flow Radium 228	244	0	318	0
Gas Flow Radium 228	36	0	35	0
Gas Flow Radium 228	1	0	1	0
Alpha Spec Plutonium	317	0	436	0
Alpha Spec Neptunium	110	0	127	0
Alpha Spec Plutonium	61	0	86	0
Alpha Spec Radium 226	0	0	1	0
Gas Flow Sr 2nd count	283	0	316	0
Gas Flow Strontium 90	499	0	568	0
Gas Flow Strontium 90	2	0	2	0
Gas Flow Total Radium	92	0	129	0
ICP-MS Technetium-99 Prep in Water	5	0	28	0



ICP-MS Uranium-233, 234 in Liquid	1	0	1	0
Lucas Cell Radium 226	372	0	487	0
Lucas Cell Radium-226	17	0	21	0
Total Activity Screen	3	0	3	0
Chlorine-36 in Liquids	4	0	10	0
Alpha Spec Am241 Curium	307	0	405	0
Gas Flow Total Strontium	231	0	241	0
Gross Alpha Non Vol Beta	1313	0	1554	0
LSC Phosphorus-32	2	0	2	0
Lucas Cell Radium 226 by Method Ra-04	3	0	3	0
ICP-MS Uranium-233, 234 Prep in Liquid	1	0	1	0
Tritium in Drinking Water by EPA 906.0	11	0	14	0
Gamma Spec Liquid RAD A-013 with Ba, La	131	0	211	0
Gamma Spec Liquid RAD A-013 with Iodine	159	0	205	0
Gas Flow Strontium 89 & 90	6	0	0	0
ICP-MS Uranium-235, 236, 238 in Liquid	2	0	2	0
Gas Flow Total Alpha Radium	13	0	11	0
Gross Alpha Co-precipitation	7	0	9	0
ICP-MS Uranium-235, 236, 238 Prep in Liquid	1	0	1	0
ICP-MS Uranium-234, 235, 236, 238 in Liquid	22	0	98	0
Gross Alpha Beta (Americium Calibration) Liquid	16	0	21	0
ICP-MS Uranium-234, 235, 236, 238 Prep in Liquid	14	0	51	0
Alpha/Beta (Americium Calibration) Drinking Water	5	0	4	0
<b>TISSUE</b>				
Carbon-14	2	0	2	0
LSC Iron-55	3	0	3	0
Gamma Nickel 59 RAD A-022	2	0	2	0
Gamma Spec Solid RAD A-013	71	0	79	0
LSC Nickel 63	4	0	4	0
LSC Plutonium	1	0	1	0
Technetium-99	2	0	2	0
Tritium	1	0	1	0
Gamma Iodine-129	2	0	2	0
Gas Flow Lead 210	2	0	2	0
Alpha Spec Uranium	5	0	5	0
Alpha Spec Thorium	2	0	2	0
Alpha Spec Plutonium	10	0	10	0
Alpha Spec Neptunium	4	0	4	0
Alpha Spec Plutonium	2	0	2	0
Gas Flow Sr 2nd count	10	0	10	0



Gas Flow Strontium 90	20	0	23	0
Alpha Spec Am241 Curium	9	0	9	0
Gas Flow Total Strontium	19	0	19	0
Gamma Spec Solid RAD A-013 with Ba, La	6	0	5	0
Gamma Spec Solid RAD A-013 with Iodine	17	0	17	0
Gross Alpha/Beta	2	0	2	0
<b>SEA WATER</b>				
LSC Iron-55	2	0	2	0
LSC Nickel 63	2	0	2	0
Gas Flow Total Strontium	1	0	1	0
Gross Alpha Non Vol Beta	1	0	1	0
Gamma Spec Liquid RAD A-013 with Iodine	1	0	1	0
<b>VEGETATION</b>				
Gamma Nickel 59 RAD A-022	3	0	3	0
Gamma Spec Solid RAD A-013	31	0	31	0
LSC Nickel 63	3	0	3	0
LSC Plutonium	1	0	1	0
Technetium-99	6	0	6	0
Tritium	9	0	9	0
Gamma Iodine-129	1	0	1	0
Gas Flow Lead 210	8	0	7	0
Total Uranium KPA	4	0	4	0
Alpha Spec Uranium	23	0	21	0
Alpha Spec Thorium	7	0	7	0
Alpha Spec Plutonium	15	0	12	0
Alpha Spec Neptunium	1	0	1	0
Alpha Spec Plutonium	1	0	1	0
Gas Flow Sr 2nd count	9	0	9	0
Gas Flow Strontium 90	19	0	18	0
Gas Flow Total Radium	2	0	3	0
Alpha Spec Am241 Curium	11	0	8	0
Gamma Spec Solid RAD A-013 with Iodine	91	0	93	0
Gamma Spec Solid RAD A-013 (pCi/Sample)	5	0	3	0
Alpha Spec Am241 (pCi/Sample)	3	0	2	0
ICP-MS Uranium-234, 235, 236, 238 in Solid	9	0	7	0
Alpha Spec Uranium	1	0	17	0
Gross Alpha/Beta	4	0	4	0
Alpha Spec Plutonium	2	0	2	0
Gas Flow Strontium 90	4	0	2	0
ICP-MS Uranium-234, 235, 236, 238 Prep in Solid	7	0	5	0
<b>AIR CHARCOAL</b>				
Gamma Iodine 131 RAD A-013	623	0	645	0



2013 ANNUAL QUALITY ASSURANCE REPORT

Gamma Iodine-129	0	0	1	0
Carbon-14 (Ascarite/Soda Lime Filter per Liter)	89	0	88	0
<b>DRINKING WATER</b>				
Alpha Spec Uranium	7	0	8	0
Tritium	51	0	52	0
Iodine-131	1	0	2	0
LSC Iron-55	24	0	22	0
LSC Nickel 63	23	0	21	0
LSC Radon 222	96	0	96	0
Gamma Spec Liquid RAD A-013	24	0	24	0
Total Activity,	2	0	2	0
Gamma Iodine-129	2	0	2	0
Gamma Iodine-131	38	0	38	0
Total Uranium KPA	15	0	28	0
Gas Flow Radium 228	42	0	42	0
Alpha Spec Plutonium	6	0	6	0
Gas Flow Sr 2nd count	16	0	16	0
Gas Flow Strontium 90	25	0	24	0
Lucas Cell Radium-226	58	6	78	0
Alpha Spec Am241 Curium	6	0	6	0
Gas Flow Total Strontium	31	0	31	0
Gross Alpha Non Vol Beta	343	0	287	0
Tritium in Drinking Water by EPA 906.0	37	0	34	0
Gamma Spec Liquid RAD A-013 with Ba, La	44	0	98	0
Gas Flow Strontium 89 & 90	20	0	13	0
Gas Flow Total Alpha Radium	1	0	1	0
Gross Alpha Co-precipitation	105	0	87	0
Alpha/Beta (Americium Calibration) Drinking Water	13	0	13	0
ECLS-R-GA NJ 48 Hr Rapid Gross Alpha	8	0	8	0
<b>Total</b>	<b>20148</b>		<b>23892</b>	

Note 1: The RPD must be 20 percent or less, if both samples are greater than 5 times the MDC. If both results are less than 5 times MDC, then the RPD must be equal to or less than 100%. If one result is above the MDC and the other is below the MDC, then the RPD can be calculated using the MDC for the result of the one below the MDC. The RPD must be 100% or less. In the situation where both results are above the MDC but one result is greater than 5 times the MDC and the other is less than 5 times the MDC, the RPD must be less than or equal to 20%. If both results are below MDC, then the limits on % RPD are not applicable.



TABLE 8  
2013 CORRECTIVE ACTION REPORT SUMMARY

CORRECTIVE ACTION ID# & PE FAILURE	DISPOSITION
<p><b>CARR130513-789</b></p> <p>ISO Documentation of PT Failures in MAPEP-13-RdV28 for Uranium in Vegetation by ICP/MS and Alpha Spec</p>	<p><b>Root Cause Analysis of MAPEP-13-RdV28 Uranium-234/233, Uranium-235, Uranium-238 and Total Uranium</b></p> <p>Following reviews of our process and data and conversations with personnel from the affected laboratories, it was determined that all failures were due to an analyst error during sample preparation. Glass instead of Teflon beakers were used during the sample digestion which contained Hydrofluoric (HF) acid. Per Standard Operating Procedure (SOP) GL-RAD-A-015 section 11.2.4, the sample should have been transferred to a Teflon beaker. In this instance, this step was omitted. The digestion was performed in glass beakers so trace amounts of Uranium were leached from the glass into the sample, resulting in high bias in the results. Normal procedure dictates that glass is not used when using HF in the digestion process due to the presence of natural Uranium in the glassware.</p> <p>In order to prove that this was an isolated incident and that our overall process is in control a series of digestions were performed in the glass beakers to confirm our conclusion.</p> <ul style="list-style-type: none"> <li>• HCL /HNO<sub>3</sub> only digestion - Uranium was not detected.</li> <li>• HCL, HNO<sub>3</sub>, and HF digestion - Enough Uranium activity was detected to account for the high bias (as many as 70 counts in a 16 hour and 40 minute count).</li> <li>• HF only digestion - Results similar to HCL, HNO<sub>3</sub>, and HF were observed</li> </ul> <p><b>A second PT was successfully analyzed for this matrix.</b></p>
<p><b>CARR130522-791</b></p> <p>ISO Documentation of PT Failures in -MRAD-18 for Cesium-134, Cesium-137 and Zinc-65 in Soil</p>	<p>Following a review of our processes, the data and conversations with personnel from the affected laboratories, it was determined that our normal procedure for preparing soil samples is not sufficient for this soil matrix. Per the Standard Operating Procedure (SOP) GL-RAD-A-021, the sample was</p>



dried, homogenized, and passed through a 28 mesh sieve. However, approximately 20-30% of the sample consists of particles greater than the 28 mesh sieve size. These larger particles were not affected by our normal homogenization process. In accordance with the SOP, the larger particles were removed prior to preparing the container for gamma counting.

Upon receipt of the graded report, the following steps were taken to prove that this was an isolated incident and that our overall process is in control.

1. A recount of the initially prepared sample performed and confirmed the originally reported results.
2. A new container was then prepared from the original sample but omitting the preparation step and counted. This produced acceptable results.
3. A second sample was prepared per the SOP; however, only a portion of the sample was removed during the sieving steps. This sample produced similar high biased results.

An aliquot of the sample was then pulverized prior to gamma counting. This approach also produced acceptable results.

**Permanent Corrective/Preventive Actions or Improvements :**

In the future, these samples will be pulverized to ensure that all the material passes through the 28 mesh sieve; thus, eliminating the need to remove any of the original sample. A comment has been added to the set-up for the solid matrix.

**A second PT was successfully analyzed for this matrix.**



**CARR130826-810**

For Failures of RAD-94 for Gross Alpha/Bea and Strontium 89/90 in Water

**Root Cause Analysis of Gross Alpha**

After a review of the data, an apparent reason for this discrepancy could not be determined. The following steps were taken to prove that this high bias was an isolated occurrence and that our overall process is within control.

1. The batch quality control samples were reviewed and found to be compliant. The LCS recovered at 110%. While the recovery is slightly elevated, it is well within the 80%-120% acceptance range.
2. Laboratory control data were also reviewed for trends. None were noted.
3. The instrument calibrations were reviewed for positive biases that could have attributed to this failure. None were noted.
4. Two sample duplicates were also prepared and counted along with the reported result. Both results fell within the method's acceptance range for duplicate. One of the results also fell within the acceptance range of the study.
5. **The original sample was also recounted and the results fell within the acceptance range.**

**Root Cause Analysis of Strontium-89 (Sr-89)  
LAB PBMS A-004**

After a review of the data, an apparent reason for this discrepancy could not be determined. The following steps were taken to prove that this high bias was an isolated occurrence and that our overall process is within control.

1. The batch quality control samples were reviewed and found to be compliant. The LCS recovered at 98.1%.
2. Laboratory control data were also reviewed for trends. None were noted.
3. The instrument calibrations were reviewed for positive biases that could have attributed to this failure. None were noted.
4. Sample duplicates were also prepared and counted along with the reported result. Duplicate results fell within the acceptance range of the study.

**Root Cause Analysis of Strontium-89 (Sr-89)  
EPA 905.0**

After a review of the data, an apparent reason for this discrepancy could not be determined. The following steps were taken to prove that this high bias was an isolated



occurrence and that our overall process is within control.

1. The batch quality control samples were reviewed and found to be compliant. The LCS recovered at 102%.
2. Laboratory control data were also reviewed for trends. None was noted.
3. The instrument calibrations were reviewed for positive biases that could have attributed to this failure. None were noted.
4. Sample duplicates were also prepared and counted along with the reported result. All results fell within the method's acceptance range for duplicates.

**Permanent Corrective/Preventive Actions or Improvements:**

**Gross Alpha**

The laboratory must assume an unidentified random error caused the high bias because all quality control criteria were met for the batch. The lab will continue to monitor the recoveries of this radionuclide to ensure that there are no issues.

**Strontium-89 (Sr-89)  
LAB PBMS A-004 and EPA 905.0**

To summarize our efforts (including the initial result), the laboratory had 3 analysts, two different methods, processed with 2 calibrations and two separate Y carriers used in the analysis of this sample and only one acceptable result for Sr-89. All LCS results have met acceptance criteria. This leads the laboratory to conclude that there is possibly an error in the original make-up of the PT sample. The instructions list stable Sr and Y as being included but they are not at levels greater than are normally listed so we suspect that the make up of the sample was the cause. The laboratory will continue to monitor the recoveries from these two methods to ensure that there are no issues.





<p><b>CARR131205-845</b></p> <p>For failures of MRAD-19 for Uranium-234 and Total Uranium in Vegetation</p>	<p><b>Root Cause Analysis</b></p> <p>These elevated results were obtained following our routine procedure. The reported result for U-234 was less than the MDA and had a elevated uncertainty. This high U-234 result also attributed to the high Total-U result.</p> <p>Upon receipt of the graded report, the following steps were taken to prove that this was an isolated incident and that our overall process is in control.</p> <ul style="list-style-type: none"><li>• A recount of the initially prepared sample performed and confirmed the originally reported results.</li><li>• The sample was reanalyzed using a larger aliquot and results that fell within the acceptance range were achieved.</li></ul> <p><b>Permanent Corrective/Preventive Actions or Improvements</b></p> <p>In the future when the result is below the MDA and are not compatible with other analytical technologies, the laboratory will attempt to use a larger sample aliquot with hopes of achieve a result above the MDA or with a lower uncertainty. If the matrix and larger sample size do not provide useable data, the results may not be report.</p>
---	---

**ENVIRONMENTAL DOSIMETRY COMPANY**

**ANNUAL QUALITY ASSURANCE STATUS REPORT**

**January - December 2013**

Prepared By: James R. Sirois Jr

Date: 3/19/14

Approved By: Paul Stapf

Date: 3/19/14

**Environmental Dosimetry Company  
10 Ashton Lane  
Sterling, MA 01564**

## TABLE OF CONTENTS

	<u>Page</u>
LIST OF TABLES .....	iii
EXECUTIVE SUMMARY.....	iv
I. INTRODUCTION.....	1
A. QC Program.....	1
B. QA Program.....	1
II. PERFORMANCE EVALUATION CRITERIA.....	1
A. Acceptance Criteria for Internal Evaluations.....	1
B. QC Investigation Criteria and Result Reporting.....	3
C. Reporting of Environmental Dosimetry Results to EDC Customers.....	3
III. DATA SUMMARY FOR ISSUANCE PERIOD JANUARY-DECEMBER 2013 .....	3
A. General Discussion.....	3
B. Result Trending .....	4
IV. STATUS OF EDC CONDITION REPORTS (CR) .....	4
V. STATUS OF AUDITS/ASSESSMENTS.....	4
A. Internal.....	4
B. External .....	4
VI. PROCEDURES AND MANUALS REVISED DURING JANUARY - DECEMBER 2013...	4
VII. CONCLUSION AND RECOMMENDATIONS .....	4
VIII. REFERENCES.....	4
APPENDIX A           DOSIMETRY QUALITY CONTROL TRENDING GRAPHS	

## LIST OF TABLES

	<u>Page</u>
1. Percentage of Individual Analyses Which Passed EDC Internal Criteria, January - December 2013	5
2. Mean Dosimeter Analyses (n=6), January - December 2013	5
3. Summary of Independent QC Results for 2013	5

## EXECUTIVE SUMMARY

Routine quality control (QC) testing was performed for dosimeters issued by the Environmental Dosimetry Company (EDC) .

During this annual period, 100% (72/72) of the individual dosimeters, evaluated against the EDC internal performance acceptance criteria (high-energy photons only), met the criterion for accuracy and 100% (72/72) met the criterion for precision (Table 1). In addition, 100% (12/12) of the dosimeter sets evaluated against the internal tolerance limits met EDC acceptance criteria (Table 2) and 100% (6/6) of independent testing passed the performance criteria (Table 3). Trending graphs, which evaluate performance statistic for high-energy photon irradiations and co-located stations are given in Appendix A.

One internal assessment was performed in 2013. There were no findings.

## I. INTRODUCTION

The TLD systems at the Environmental Dosimetry Company (EDC) are calibrated and operated to ensure consistent and accurate evaluation of TLDs. The quality of the dosimetric results reported to EDC clients is ensured by in-house performance testing and independent performance testing by EDC clients, and both internal and client directed program assessments.

The purpose of the dosimetry quality assurance program is to provide performance documentation of the routine processing of EDC dosimeters. Performance testing provides a statistical measure of the bias and precision of dosimetry processing against a reliable standard, which in turn points out any trends or performance changes. Two programs are used:

### A. QC Program

Dosimetry quality control tests are performed on EDC Panasonic 814 Environmental dosimeters. These tests include: (1) the in-house testing program coordinated by the EDC QA Officer and (2) independent test perform by EDC clients. In-house test are performed using six pairs of 814 dosimeters, a pair is reported as an individual result and six pairs are reported as the mean result. Results of these tests are described in this report.

Excluded from this report are instrumentation checks. Although instrumentation checks represent an important aspect of the quality assurance program, they are not included as process checks in this report. Instrumentation checks represent between 5-10% of the TLDs processed.

### B. QA Program

An internal assessment of dosimetry activities is conducted annually by the Quality Assurance Officer (Reference 1). The purpose of the assessment is to review procedures, results, materials or components to identify opportunities to improve or enhance processes and/or services.

## II. PERFORMANCE EVALUATION CRITERIA

### A. Acceptance Criteria for Internal Evaluations

#### 1. Bias

For each dosimeter tested, the measure of bias is the percent deviation of the reported result relative to the delivered exposure. The percent deviation relative to the delivered exposure is calculated as follows:

$$\frac{H'_i - H_i}{H_i} 100$$

where:

$H'_i$  = the corresponding reported exposure for the  $i^{\text{th}}$  dosimeter (i.e., the reported exposure)

$H_i$  = the exposure delivered to the  $i^{\text{th}}$  irradiated dosimeter (i.e., the delivered exposure)

## 2. Mean Bias

For each group of test dosimeters, the mean bias is the average percent deviation of the reported result relative to the delivered exposure. The mean percent deviation relative to the delivered exposure is calculated as follows:

$$\sum \left( \frac{H'_i - H_i}{H_i} \right) 100 \left( \frac{1}{n} \right)$$

where:

$H'_i$  = the corresponding reported exposure for the  $i^{\text{th}}$  dosimeter (i.e., the reported exposure)

$H_i$  = the exposure delivered to the  $i^{\text{th}}$  irradiated test dosimeter (i.e., the delivered exposure)

$n$  = the number of dosimeters in the test group

## 3. Precision

For a group of test dosimeters irradiated to a given exposure, the measure of precision is the percent deviation of individual results relative to the mean reported exposure. At least two values are required for the determination of precision. The measure of precision for the  $i^{\text{th}}$  dosimeter is:

$$\left( \frac{H'_i - \bar{H}}{\bar{H}} \right) 100$$

where:

$H'_i$  = the reported exposure for the  $i^{\text{th}}$  dosimeter (i.e., the reported exposure)

$\bar{H}$  = the mean reported exposure; i.e.,  $\bar{H} = \sum H'_i \left( \frac{1}{n} \right)$

$n$  = the number of dosimeters in the test group

## 4. EDC Internal Tolerance Limits

All evaluation criteria are taken from the "EDC Quality System Manual," (Reference 2). These criteria are only applied to individual test dosimeters irradiated with high-energy photons (Cs-137) and are as follows for Panasonic Environmental dosimeters:  $\pm 15\%$  for bias and  $\pm 12.8\%$  for precision.

B. QC Investigation Criteria and Result Reporting

EDC Quality System Manual (Reference 2) specifies when an investigation is required due to a QC analysis that has failed the EDC bias criteria. The criteria are as follows:

1. No investigation is necessary when an individual QC result falls outside the QC performance criteria for accuracy.
2. Investigations are initiated when the mean of a QC processing batch is outside the performance criterion for bias.

C. Reporting of Environmental Dosimetry Results to EDC Customers

1. All results are to be reported in a timely fashion.
2. If the QA Officer determines that an investigation is required for a process, the results shall be issued as normal. If the QC results, prompting the investigation, have a mean bias from the known of greater than  $\pm 20\%$ , the results shall be issued with a note indicating that they may be updated in the future, pending resolution of a QA issue.
3. Environmental dosimetry results do not require updating if the investigation has shown that the mean bias between the original results and the corrected results, based on applicable correction factors from the investigation, does not exceed  $\pm 20\%$ .

III. DATA SUMMARY FOR ISSUANCE PERIOD JANUARY-DECEMBER 2013

A. General Discussion

Results of performance tests conducted are summarized and discussed in the following sections. Summaries of the performance tests for the reporting period are given in Tables 1 through 3 and Figures 1 through 4.

Table 1 provides a summary of individual dosimeter results evaluated against the EDC internal acceptance criteria for high-energy photons only. During this period, 100% (72/72) of the individual dosimeters, evaluated against these criteria met the tolerance limits for accuracy and 100% (72/72) met the criterion for precision. A graphical interpretation is provided in Figures 1 and 2.

Table 2 provides the Bias + Standard deviation results for each group (N=6) of dosimeters evaluated against the internal tolerance criteria. Overall, 100% (12/12) of the dosimeter sets evaluated against the internal tolerance performance criteria met these criteria. A graphical interpretation is provided in Figures 3

Table 3 presents the independent blind spike results for dosimeters processed during this annual period. All results passed the performance acceptance criterion. Figure 4 is a graphical interpretation of Seabrook Station blind co-located station results.



B. Result Trending

One of the main benefits of performing quality control tests on a routine basis is to identify trends or performance changes. The results of the Panasonic environmental dosimeter performance tests are presented in Appendix A. The results are evaluated against each of the performance criteria listed in Section II, namely: individual dosimeter accuracy, individual dosimeter precision, and mean bias.

All of the results presented in Appendix A are plotted sequentially by processing date.

IV. STATUS OF EDC CONDITION REPORTS (CR)

No condition reports were issued during this annual period.

V. STATUS OF AUDITS/ASSESSMENTS

A. Internal

EDC Internal Quality Assurance Assessment was conducted during the fourth quarter 2013. There were not any findings as a result of this assessment.

B. External

No external assessments were conducted in 2013.

VI. PROCEDURES AND MANUALS REVISED DURING JANUARY - DECEMBER 2013

No procedures or manuals were revised in 2013.

VII. CONCLUSION AND RECOMMENDATIONS

The quality control evaluations continue to indicate the dosimetry processing programs at the EDC satisfy the criteria specified in the Quality System Manual. The EDC demonstrated the ability to meet all applicable acceptance criteria.

VIII. REFERENCES

1. EDC Quality Control and Audit Assessment Schedule, 2013.
2. EDC Manual 1, Quality System Manual, Rev. 3, August 1, 2012.

**TABLE 1**

**PERCENTAGE OF INDIVIDUAL DOSIMETERS THAT PASSED EDC INTERNAL CRITERIA  
JANUARY – DECEMBER 2013<sup>(1), (2)</sup>**

Dosimeter Type	Number Tested	% Passed Bias Criteria	% Passed Precision Criteria
Panasonic Environmental	72	100	100

<sup>(1)</sup>This table summarizes results of tests conducted by EDC.

<sup>(2)</sup>Environmental dosimeter results are free in air.

**TABLE 2**

**MEAN DOSIMETER ANALYSES (N=6)  
JANUARY – DECEMBER 2013<sup>(1), (2)</sup>**

Process Date	Mean Bias %	Standard Deviation %	Tolerance Limit +/-15%
4/22/2013	4.1	1.9	Pass
4/24/2013	4.5	1.2	Pass
5/23/2013	-1.1	1.9	Pass
7/24/2013	0.8	1.0	Pass
8/4/2013	-1.1	1.6	Pass
8/6/2013	0.1	2.3	Pass
10/31/2013	1.5	1.2	Pass
11/10/2013	0.1	1.7	Pass
11/15/2013	-1.8	1.0	Pass
1/27/2014	3.7	2.3	Pass
1/31/2014	2.6	0.9	Pass
2/5/2014	0.7	0.6	Pass

<sup>(1)</sup>This table summarizes results of tests conducted by EDC for TLDs issued in 2013.

<sup>(2)</sup>Environmental dosimeter results are free in air.

**TABLE 3**

**SUMMARY OF INDEPENDENT DOSIMETER TESTING  
JANUARY – DECEMBER 2013<sup>(1), (2)</sup>**

Issuance Period	Client	Mean Bias %	Standard Deviation %	Pass / Fail
2 <sup>nd</sup> Qtr. 2013	Millstone	0.7	1.5	Pass
2 <sup>nd</sup> Qtr. 2013	Seabrook	-2.3	2.7	Pass
3 <sup>rd</sup> Qtr. 2013	Millstone	-4.7	4.0	Pass
4 <sup>th</sup> Qtr. 2013	Seabrook	-0.9	0.9	Pass

<sup>(1)</sup>Performance criteria are +/- 30%.


<sup>(2)</sup>Blind spike irradiations using Cs-137

APPENDIX A


DOSIMETRY QUALITY CONTROL TRENDING GRAPHS

ISSUE PERIOD JANUARY - DECEMBER 2013


INDIVIDUAL ACCURACY ENVIRONMENTAL  
FIGURE 1

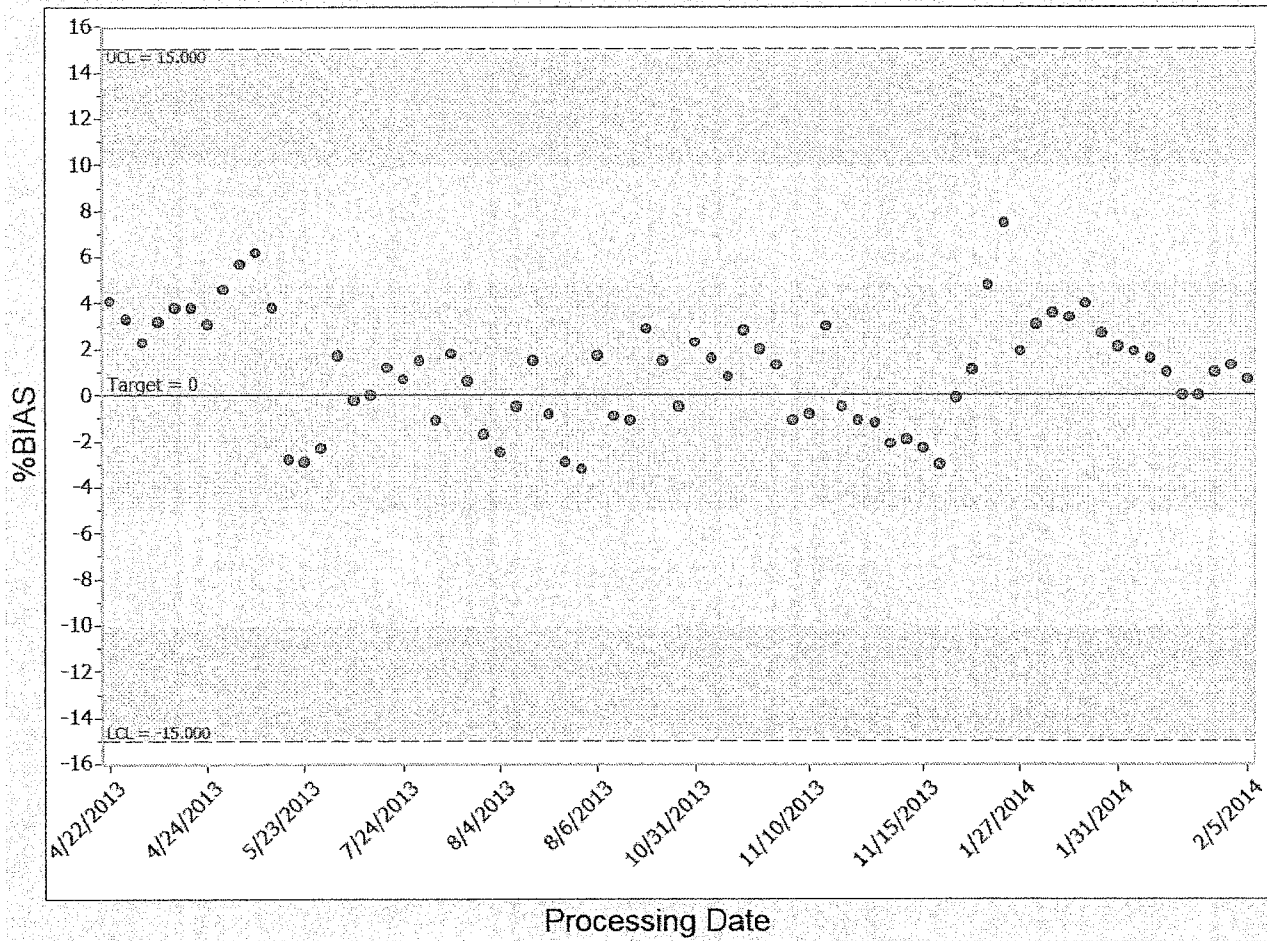

INDIVIDUAL PRECISION ENVIRONMENTAL  
FIGURE 2

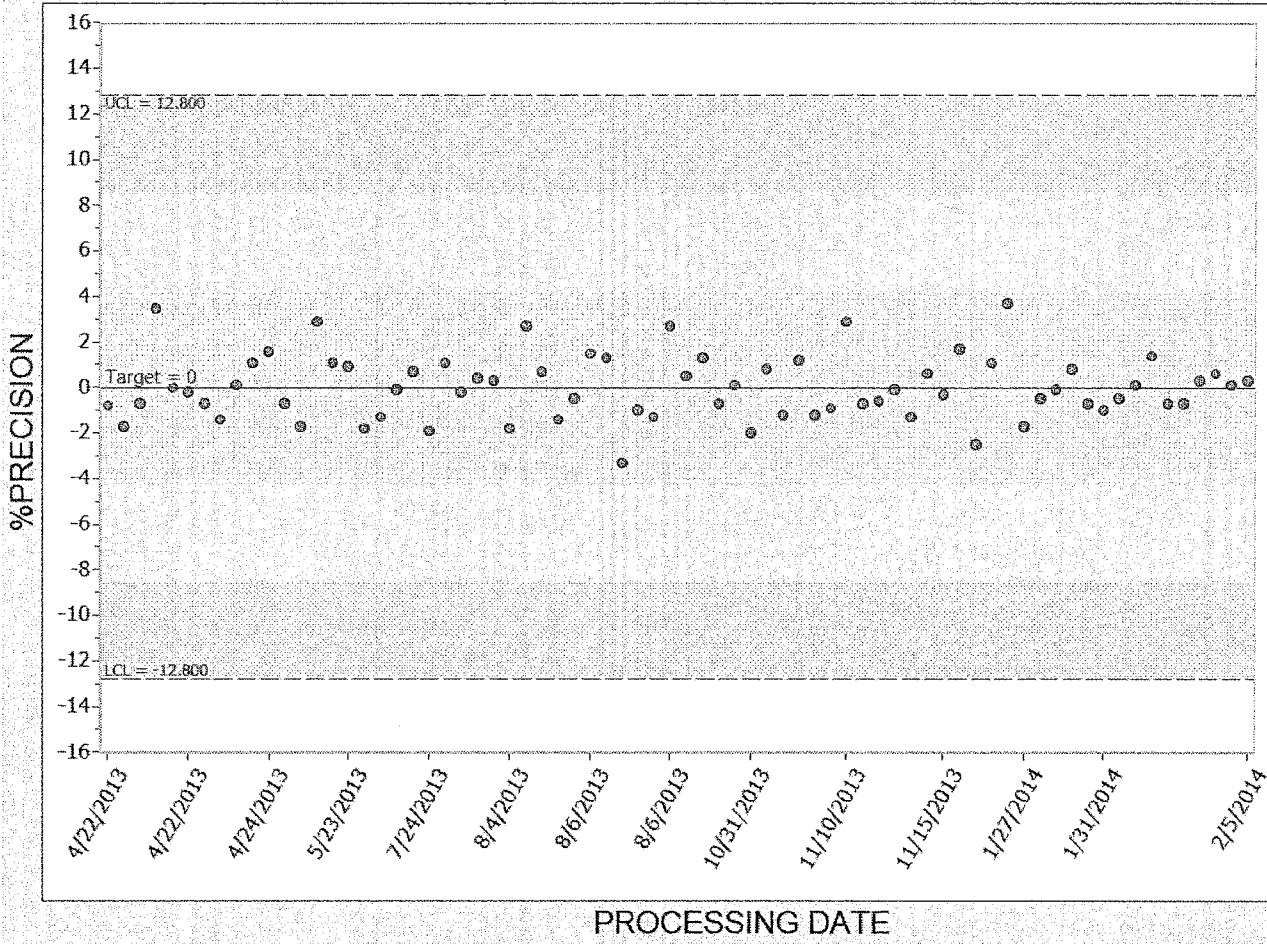

MEAN ACCURACY ENVIRONMENTAL  
FIGURE 3

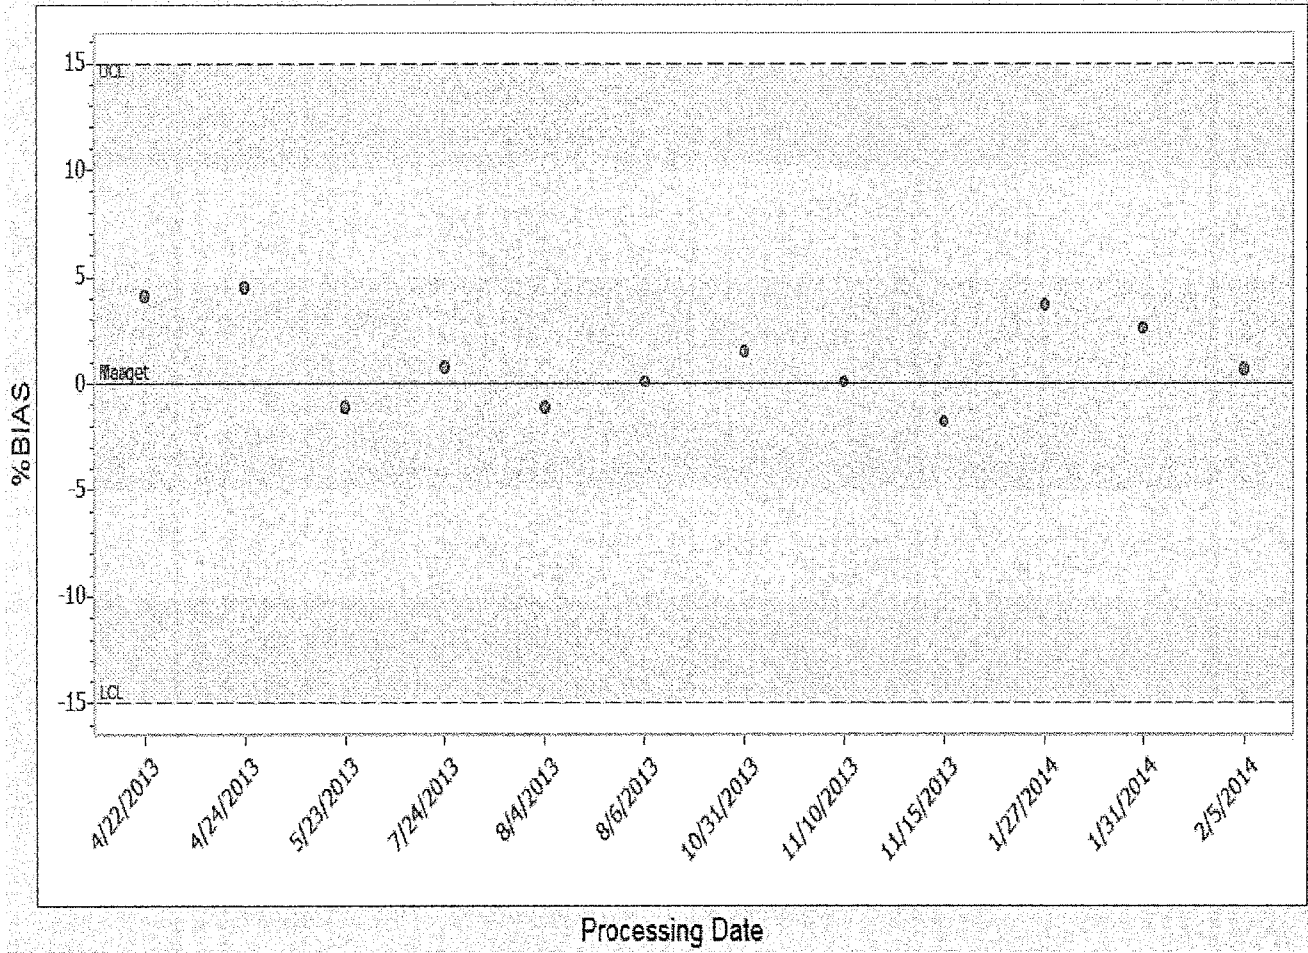

# SEABROOK CO-LOCATE ACCURACY FIGURE 4

