

Susquehanna Steam Electric Station

Units 1 & 2

Radioactive Effluent Release Report

2013
Annual
Report



PPL Susquehanna, LLC
Berwick, PA
April 2014


Attachment 1 to PLA-7163

**Radioactive Effluent Release Report
for SSES Units 1 and 2**

**RADIOACTIVE EFFLUENT
RELEASE REPORT**


REPORT PERIOD: 01/01/13 - 12/31/13

Prepared by:




Francis J. Hickey
Health Physicist

Reviewed by:



Daniel W. Miller
Chemistry Support Supervisor

Approved by:



Dominic R. D'Angelo
Manager – Plant Chemistry / Environmental

**PPL Susquehanna, LLC
769 Salem Blvd.
Berwick, Pennsylvania 18603**

TABLE OF CONTENTS

<u>SECTION</u>	<u>PAGE</u>
1. Introduction, Summary and Supplemental Information	1-1
2. Effluent and Waste Disposal Data	2-1
3. Meteorological Data and Dispersion Estimates	3-1
4. Dose Measurements and Assessments	4-1
5. Changes to the Offsite Dose Calculation Manual (ODCM), Technical Requirements Manual (TRM) and the Solid Radioactive Waste Process Control Program	5-1
6. Miscellaneous Technical Requirements Manual (TRM), FSAR, 40CFR190 and NEI Groundwater Protection Initiative Reporting	6-1
7. Corrections to Previous Radioactive Effluent Release Reports	7-1
8. Effluent from Systems Classified as Insignificant Effluent Pathways	8-1
 Appendix A ODCM/TRM	

LIST OF TABLES

	<u>PAGE</u>	
Table 1-1	Technical Requirement Limits	1-10
Table 2-1	Airborne Effluent – Summation of All Releases	2-4
Table 2-2	Airborne Effluent – Radionuclides Released	2-5
Table 2-3	Waterborne Effluent – Summation of All Releases	2-8
Table 2-4	Waterborne Effluent – Radionuclides Released	2-9
Table 2-5	Estimated Total Errors Associated with Effluents Measurements	2-12
Table 2-6	Waste Disposition	2-15
Table 2-7	CFS Backwash Media – Class A HIC (Pyrolysis)	2-16
Table 2-8	CFS Filters – Class A HIC (Pyrolysis)	2-17
Table 2-9	Cartridge Filters – Class A HIC (Overfilled)	2-18
Table 2-10	Condensate Demineralizer/Radwaste Demineralizer - Class A HIC (Pyrolysis)	2-19
Table 2-11	Contaminated Waste Oil – Class A Fuel Blending for Co-Generation	2-20
Table 2-12	Liquid Radwaste Filter Media – Class A HIC (Pyrolysis)	2-21
Table 2-13	Processed DAW – Class A HIC (Overfilled)	2-22
Table 2-14	Processed DAW – Class A Strong Tight Container (Compacted)	2-23

LIST OF TABLES (cont.)**PAGE**

Table 3-1	Meteorological Data Recovery for 2013	3-3
Table 3-2	Joint Frequency Distribution of Wind Speed and Wind Direction 10m versus Delta Temperature 60-10m for the Period of January 1, 2013 through December 31, 2013	3-4
Table 3-3	Joint Frequency Distribution of Wind Speed and Wind Direction 60m versus Delta Temperature 60-10m for the Period of January 1, 2013 through December 31, 2013	3-12
Table 3-4	2013 SSES Annual Relative Concentrations No Decay, Undepleted X/Q (sec/m ³)	3-20
Table 3-5	2013 SSES Annual Relative Concentrations 2.26-Day Decay, Undepleted X/Q (sec/m ³)	3-21
Table 3-6	2013 SSES Annual Relative Concentrations 8-Day Decay, Depleted X/Q (sec/m ³)	3-22
Table 3-7	2013 SSES Annual Relative Deposition (D/Q meters ⁻²)	3-23
Table 3-8	2013 Atmospheric Dispersion Estimates for RETDAS Input at Selected Locations	3-24
Table 4-1	Site-Specific Parameters Used for RETDAS Calculations (Danville Receiver) for 2013	4-2
Table 4-2	Summary of Maximum Individual Doses to Members of the Public Data Period: 1/1/13 to 12/31/13	4-5
Table 4-3	Calculated Collective Doses to Members of the Public Within the Riverlands/Energy Information Center Complex Data Period: 1/1/13 to 12/31/13	4-6
Table 4-4	Summary of Maximum Individual Doses from Airborne Effluent	4-6
Table 6-1	NEI Ground Water Protection Initiative Reporting	6-4
Table 8-1	Annual Release from Systems Classified as Insignificant Effluent Pathways	8-3

LIST OF FIGURES

	<u>PAGE</u>
Figure 1-1 Airborne Effluent Release Points	1-6
Figure 1-2 Waterborne Effluent Pathway	1-7
Figure 2-1 Susquehanna River Monthly Average Flow Rates Data Period: 2013	2-10
Figure 2-2 Monthly Liquid Radwaste Discharge Totals	2-11
Figure 3-1 2013 Annual Wind Rose 10M Level - Primary Tower	3-26
Figure 3-2 2013 Annual Wind Rose 60M Level - Primary Tower	3-27
Figure 3-3 Pasquill Stability Class Prevalences Data Period: 2013	3-28
Figure 4-1 Airborne-Dose Calculation Locations	4-7
Figure 6-1 SSES Tritium Effluent Releases	6-5

SECTION 1

INTRODUCTION, SUMMARY AND SUPPLEMENTAL INFORMATION

INTRODUCTION

The submittal of the 2013 Radioactive Effluent Release Report is in accordance with PPL Susquehanna, LLC Tech Spec. 5.6.3. The enclosed information is consistent with the objectives outlined in the Offsite Dose Calculation Manual (ODCM) and Process Control Program (PCP). The 2013 Radioactive Effluent Release Report is in conformance with 10CFR50.36a and 10CFR50, Appendix I, Section IV.B.1.

PPL Susquehanna, LLC is located in Salem Township, Luzerne County, Pennsylvania. It is on the west bank of the Susquehanna River, 8 km northeast of Berwick. The station consists of two boiling water reactor generating units. Each unit has completed an Extended Power Uprate process which has increased licensed thermal power from 3489 MWt (megawatt thermal) to 3952 MWt. Unit-1 completed the power uprate in 2010 and Unit 2 completed the power uprate in 2011. The reactor and generating units were supplied by General Electric, while the Bechtel Corporation served as architect-engineer and constructor.

Construction of the Station began in the early 1970s. Fuel load began in Unit 1 in July of 1982. Initial criticality was achieved in the Unit 1 reactor on September 10, 1982. The reactor reached 100% power for the first time on February 4, 1983. Commercial operation of Unit 1 was declared on June 8, 1983. Initial criticality of Unit 2 occurred on May 8, 1984. Unit 2 was declared commercial on February 12, 1985.

Airborne effluents are released from the Station via five rooftop vents on the reactor building (see Figure 1-1). Continuous sampling for particulates and iodines is performed at each vent as well as continuous monitoring for noble gases. A program of periodic sampling and analysis for tritium and noble gases along with periodic analysis of particulate and iodine samples is conducted as specified in the plant Technical Requirements. All waterborne effluents are released in batch mode and are sampled and analyzed prior to release. Waterborne effluents from the site are released into the cooling tower blowdown line for dilution prior to release to the Susquehanna River (see Figure 1-2). Blowdown line flow rates are at least 5,000 gpm during periods of liquid radwaste release. The diluted effluent is introduced to the river by way of a perforated diffuser pipe placed on the river bed. The diffuser serves to mix the station discharge with the main flow of the river.

This report presents a summary of the quantities of radioactive materials which were released from the Station during the period from January 1, 2013 to December 31, 2013. In addition, this report serves as a medium for notifying the US Nuclear Regulatory Commission staff of changes to the ODCM, PCP and documentation of any exceptions to the effluent monitoring program which must be reported per Technical Requirements.

Airborne and waterborne radioactive effluent releases to the environment during the report period were sampled and analyzed in accordance with the Technical

Requirements. All radioactive effluent releases were within the concentration and release limits specified in the Technical Requirements. Calculations and terms utilized in this report are those outlined in the ODCM.

Section 1 contains supplemental information pertaining to effluents from the Susquehanna plant. Included are regulatory limits (Table 1-1), sampling and analysis methods, characterization of the number and duration of batch and abnormal releases and a brief summary of the applicable year's effluents.

Section 2 contains effluent and waste disposal data for the report period. Table 2-1 contains a summation of all airborne releases, grouped into the radionuclide categories of gases, particulates, iodines, and tritium. Average release rates are presented and compared to the applicable limits. Table 2-2 presents the activity totals of specific radionuclides in airborne effluents.

Waterborne effluents are summarized in Table 2-3. Average diluted concentrations are presented and compared to the applicable limits. Table 2-4 presents the release quantities of specific radionuclides in waterborne effluents over the report period. Figures 2-1 and 2-2 present the Susquehanna River Monthly Average Flow Rates for 2013 and the Monthly Liquid Radwaste Discharge Totals for 2013, respectively.

Table 2-5 contains estimates of the errors associated with the measurements involved in quantifying effluents. Sampling errors, counting errors, and errors associated with determining effluent flow rates and volumes all contribute to the total error of effluent measurements. Error estimates are presented for each category of radionuclide detected in airborne and waterborne effluents and solid wastes during the report period (Error Analysis of the Radioactive Effluent Sampling and Analysis Program at the SSES, Hydro Nuclear Services; 1985).

Tables 2-7 through 2-14 present a characterization of the solid radioactive waste shipped offsite during the report period. An estimate of major nuclide composition is presented for each waste type. Also included are the volumes and curie contents associated with each type of solid waste. The number of waste shipments from the site transported directly for burial or disposal are listed in Table 2-6.

Section 3 presents meteorological data for 2013, including data recovery, joint frequency distribution of wind speed and direction, stability class distribution, and atmospheric dispersion estimates for selected locations.

Section 4 of this report contains an assessment of the calculated doses attributed to the reported radiological effluents for the calendar year. The Radioactive Effluent Tracking and Dose Assessment Software (RETDAS) computer code was used for calculation of doses from waterborne effluents. Site-specific parameters used in the calculations for the Danville receiver are shown in Table 4-1. The RETDAS code was also used for calculation of doses from airborne effluents. The calculated doses and direct radiation estimates can be used to estimate the doses to maximally exposed members of the

public. Table 4-2 summarizes maximum calculated doses to members of the public from airborne and waterborne effluents. Table 4-3 presents calculated collective doses to members of the public within the Riverlands/Energy Information Center Complex. Table 4-4 summarizes the calculated doses for residences and other occupied areas within the site boundary and the nearest dairy. Additionally, Section 4 includes a description of the methodology used in the calculation and resultant dose impact of Carbon-14 released from the station.

Section 5 of this report documents changes to the Offsite Dose Calculation Manual, Technical Requirements Manual and the Solid Radioactive Waste Process Control Program.

Section 6 presents a listing of cases (if any) in which airborne or waterborne effluent monitoring instrumentation was declared inoperable and was not restored to operability within the time period specified in Technical Requirements 3.11.1.4, 3.11.1.5 and 3.11.2.6 Action Statements. In addition, this section presents issues (if any) with the collection of milk or fresh leafy vegetables per Technical Requirement 3.11.4.1 and changes due to the land use census per Technical Requirement 3.11.4.2. Section 6 also includes reporting associated with the Nuclear Energy Institute (NEI) Groundwater Protection Initiative.

Section 7 contains corrections (if any) to previous Radioactive Effluent Release Reports.

Section 8 contains information on effluent and offsite dose from the systems classified as insignificant effluent pathways.

SUMMARY


During 2013 there were two hundred ten (210) liquid batch releases resulting in a total release volume of approximately three million (3,000,000) gallons. The total number of liquid batch releases and total volume released in 2013 was higher than the corresponding values for 2012 (180 releases resulting in 2,322,000 gallons released in 2012) primarily due to multiple outage periods on both Units. The predominant radionuclide released in liquid effluents during 2013 was tritium. Approximately eighty one (81) curies of tritium were released in liquid effluents in 2013, compared to seventy five (75) curies released in 2012. When compared with all radionuclides released in liquid effluents in 2013, Co-60 was the main contributor to the resultant offsite dose. Consistent with previous years, the offsite dose from liquid releases in 2013 was less than one percent (1%) of the annual limits for both organ and whole body dose.

In 2010, an industry initiative (supported by EPRI and NEI) was established to evaluate and report Carbon-14 (C-14) in the Annual Radioactive Effluent Release Report. The initiative is rooted in Regulatory Guide 1.21, Revision 2, "Measuring, Evaluating, and Reporting Radioactive Material in Liquid and Gaseous Effluents and Solid Waste", in that the NRC has recommended that U.S. nuclear power plants evaluate whether C-14 is a "principal radionuclide", and if so, report the amount of C-14 released. The C-14 reported as released from the Susquehanna station in 2013 is calculated based on samples taken from each units Offgas system in October 2012, specifically the Offgas post-treatment sample stream. Approximately 42 Curies of C-14 were released in gaseous effluents in 2013. See section 4 for additional details on C-14 released in airborne effluents.

Historically, tritium has been the predominant radionuclide (both in Curies and resultant offsite dose) released in gaseous effluents from the Susquehanna station. Approximately one (1) curie of tritium was released in gaseous effluents in 2013 compared to seven (7) curies in 2012. The resultant maximum offsite organ dose due to gaseous effluents from Unit-1 for 2013 was 4.06E-3 mrem, which is 0.03% of the per unit annual limit of fifteen (15) mrem. The resultant maximum offsite organ dose due to gaseous effluents from Unit-2 for 2013 was 1.19E-2 mrem, which is 0.08% of the per unit annual limit of fifteen (15) mrem. The maximum offsite dose from gaseous effluents in 2013 is less than the maximum offsite dose from gaseous effluents in 2012.

FIGURE 1-2

WATERBORNE EFFLUENT PATHWAY

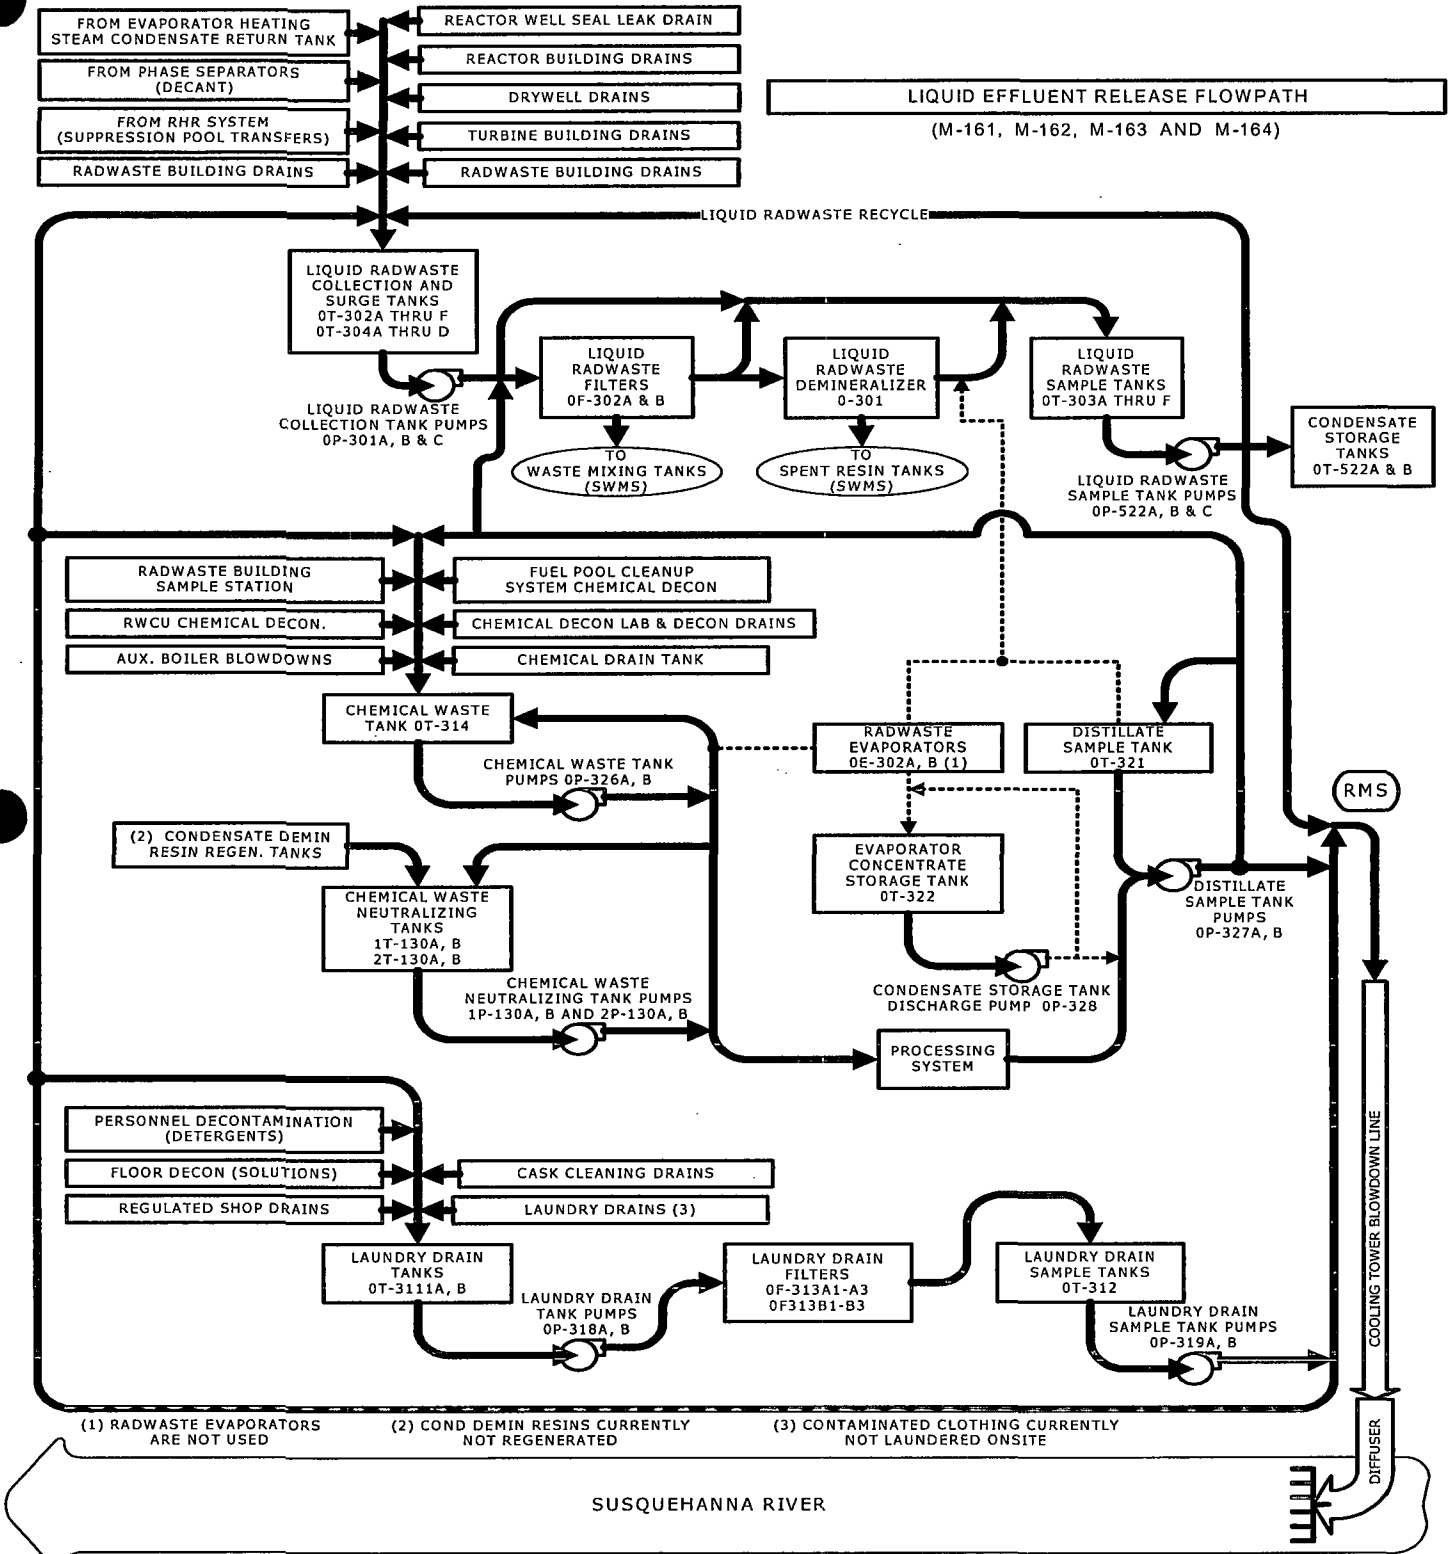

SUPPLEMENTAL INFORMATION

1. Regulatory Limits

Technical Requirements 3.11.1 and 3.11.2 outline requirements for release of radioactive liquid and gaseous effluents, respectively. Concentration of radioactive materials released in liquid effluents and resulting dose are limited in unrestricted areas. Dose and dose rate due to radioactive materials released in gaseous effluents are limited in areas at or beyond the site boundary. Technical Requirement limits are listed in Table 1-1.

2. Maximum Permissible Concentrations in Waterborne Effluents

The concentration of radioactive material released in liquid effluents to unrestricted areas is limited to 10 times the concentrations specified in 10 CFR Part 20 Appendix B Table 2, Column 2, for radionuclides other than dissolved or entrained noble gases.

For dissolved or entrained noble gases, the concentration is limited to $2.0E-04$ $\mu\text{Ci/ml}$ total activity (TRO 3.11.1.1).

3. Average Energy of Fission and Activation Gas

The Calculation of Noble Gas Effluent Average Energies E-Bar Beta and Gamma for 2013 resulted in an Annual E-Bar Beta value of $3.16E-1$ MeV and E-Bar Gamma value of $6.01E-1$ MeV.

4. Measurements and Approximations of Total Radioactivity

Analyses of specific radionuclides in effluent samples are used to evaluate the radioactive composition and concentration of effluents.

5. Methods of Quantifying Effluents

- a. **Fission and Activation Gases:** Gas samples are routinely collected monthly and analyzed with a high resolution (HPGE) detector system which incorporates a data reduction program to determine radionuclide composition in terms of specific activity. Data from the continuous vent monitors are used to determine the average concentration of noble gases. The high resolution (HPGE) isotopic scan is used to convert the continuous vent monitor activity to actual activity based on the determined nuclide mixture. The vent and sample flow rates are continuously monitored and the average flow rates for each vent are used to calculate the total activity released in a given time period. When the continuous monitors are out of service, manual grab samples are taken from each vent once every eight hours (once every four

hours for the standby gas treatment vent when standby gas treatment system is in service).

- b. **Iodines**: Iodine is continuously collected on charcoal or silver zeolite cartridges via an isokinetic sampling assembly in each vent. Filters are normally exchanged once per week and analyzed on a high resolution (HPGE) system. The daily average flow rates for the vents and sample pumps are averaged for the duration of the sampling period and a ratio of vent flow rate to sample flow rate is determined. The ratio is used to determine the total activity of each isotope released during the time period in question. When the continuous samplers are out of service, iodine is continuously collected from alternate sampling ports available on the sample lines or directly from the affected rooftop vent(s).
- c. **Particulates**: Particulates are continuously collected via an isokinetic sampling assembly in each vent. Filters are normally exchanged once per week and analyzed on a high resolution (HPGE) system. Flow rate corrections are performed as for iodines. When the continuous samplers are out of service, particulates are continuously collected from alternate sampling ports available on the sample lines or directly from the affected rooftop vent(s).
- d. **Tritium**: Airborne tritium is collected monthly via bubbler sampler. The sample is collected for one hour at a flow rate of approximately 1000 cc/min. Tritium activity in the bubbler sample is determined by liquid scintillation counting. The liquid sample tritium concentration is then converted to air concentration by volume proportion.
- e. **Waterborne Effluents**: Each tank of liquid radwaste is sampled and analyzed for principal gamma emitters prior to release. Each sample tank is recirculated for a sufficient amount of time prior to sampling to ensure that a representative sample is obtained. Samples are analyzed on a high resolution (HPGE) system and release permits are generated based on the values obtained from the isotopic analysis and the most recent values for tritium, gross alpha, iron-55, and strontium-89 and -90. An aliquot based on release volume is saved and added to monthly and quarterly composite containers. The monthly tritium analysis is done in-house. A monthly composite is sent to a vendor laboratory for gross alpha analysis. A quarterly composite is sent to a vendor laboratory for iron-55, strontium-89 and-90 analyses.

The concentration of each radionuclide in each batch is multiplied by the volume of the batch to determine the total quantity of each nuclide released in each batch. The isotopic totals for each batch are summed to determine the total source term for the report period.

TABLE 1-1

TECHNICAL REQUIREMENT LIMITS

A. NOBLE GASES:

1. ≤ 500 mrem/year - TOTAL BODY
 ≤ 3000 mrem/year - SKIN
 - instantaneous dose rate limit at and beyond the site boundary (TRO 3.11.2.1.I)
2. ≤ 5 mrad - AIR GAMMA
 ≤ 10 mrad - AIR BETA
 - quarterly air dose limits per reactor unit at and beyond the site boundary (TRO 3.11.2.2a)
3. ≤ 10 mrad - AIR GAMMA
 ≤ 20 mrad - AIR BETA
 - annual air dose limits per reactor unit at and beyond the site boundary (TRO 3.11.2.2.b)

B. AIRBORNE I-131, I-133, TRITIUM, PARTICULATES WITH HALF-LIVES > 8 DAYS:

1. ≤ 1500 mrem/year - ORGAN (inhalation pathways only)
 - instantaneous dose rate limit at and beyond the site boundary (TRO 3.11.2.1.II.A)
2. ≤ 7.5 mrem - ORGAN
 - quarterly dose limit per reactor unit at and beyond the site boundary (TRO 3.11.2.3.a)
3. ≤ 15 mrem - ORGAN
 - annual dose limit per reactor unit at and beyond the site boundary (TRO 3.11.2.3.b)

C. LIQUID EFFLUENTS:

1. ≤ 1.5 mrem - TOTAL BODY
 ≤ 5.0 mrem - ORGAN
- quarterly dose limits per unit (TRO 3.11.1.2.a)
2. ≤ 3.0 mrem - TOTAL BODY
 ≤ 10.0 mrem - ORGAN
- annual dose limits per unit (TRO 3.11.1.2.b)

D. AIRBORNE EFFLUENT: BASES FOR PERCENT OF APPLICABLE LIMIT VALUES IN TABLE 2-1

Fission and Activation Gases

Derived release rate limits based on the Technical Requirement (TRO 3.11.2.1.1.A and B) limits of 500 mrem/yr to the total body and 3000 mrem/yr to the skin were calculated (PPL calculation EC-ENVR-1041 Rev. 2) from the expected mix of noble gas radionuclides presented in Attachment A of ODCM-QA-003, Effluent Monitor Setpoints. The lower limit of $1.00\text{E}+06$ $\mu\text{Ci}/\text{min}$ ($1.67\text{E}+04$ $\mu\text{Ci}/\text{sec}$) based on total body dose rate is used.

Iodine-131

A derived release rate limit for I-131 based on the Technical Requirement (TRO 3.11.2.1.II.A) limit of 1500 mrem/yr from I-131, I-133, tritium and particulates with half-lives greater than 8 days was calculated (PPL calculation EC-ENVR-1041 Rev. 2) based on the ratio of the expected annual release quantities of I-131 and I-133 provided in Attachment E of ODCM-QA-004, Airborne Effluent Dose Calculations. The limit is $1.04\text{E}+02$ $\mu\text{Ci}/\text{min}$ I-131 ($1.73\text{E}+00$ $\mu\text{Ci}/\text{sec}$).

Particulates

A derived release rate limit for particulate activity other than iodines based on the Technical Requirement (TRO 3.11.2.1.II.A) limit of 1500 mrem/yr from I-131, I-133, tritium and particulates with half-lives greater than 8 days was calculated (PPL calculation EC-ENVR-1041 Rev. 2) based on the expected annual release quantities of particulate radionuclides provided in Attachment E of ODCM-QA-004, Airborne Effluent Dose Calculations. The limit is $3.02\text{E}+03$ $\mu\text{Ci}/\text{min}$ ($5.03\text{E}+01$ $\mu\text{Ci}/\text{sec}$).

Tritium

A derived release rate was calculated based on the 10 CFR 20, Appendix B, Table 2, Column 1, Effluent Concentration Limit for tritium ($1.0\text{E-}07$ $\mu\text{Ci/cc}$) to unrestricted areas. A relative concentration of $4.1\text{E-}05$ sec/m^3 was assumed (PPL calculation EC-ENVR-1040). The limit is $1.46\text{E+}05$ $\mu\text{Ci/min}$ ($2.44\text{E+}03$ $\mu\text{Ci/sec}$).

Radionuclide Fractional Summation

The sum of the percents of applicable limits for particulates, iodine and tritium must be less than 100%.

E. WATERBORNE EFFLUENT: BASES FOR PERCENT OF APPLICABLE LIMIT VALUES IN TABLE 2-3

Fission and Activation Products

Concentrations of fission and activation products in liquid effluent from radwaste effluent are determined for each batch prior to release. Each isotope concentration is compared to ten times the 10CFR20 Appendix B, Table 2, Column 2 Effluent Concentration Values (TRO 3.11.1.1).

Tritium

Liquid effluent quarterly tritium concentrations are compared to ten times the 10 CFR 20 Appendix B, Table 2, Column 2, Effluent Concentration value of $1.0\text{E-}03$ $\mu\text{Ci/ml}$ to unrestricted areas.

Dissolved and Entrained Gases

Liquid effluent concentrations for dissolved and entrained gases are compared to the limiting value for total noble gas activity of $2.0\text{E-}04$ $\mu\text{Ci/ml}$ (TRO 3.11.1.1).

Radionuclide Fractional Summation

The sum of the percents of applicable limits for fission and activation products, tritium and dissolved and entrained gases must be less than 100%.

SECTION 2
EFFLUENT AND WASTE DISPOSAL DATA

Airborne Effluents

Summaries of the radionuclide total curie activities and average release rates are included in Tables 2-1 and 2-2. Carbon-14 (C-14) activity released is not included in Tables 2-1 or 2-2. See Section 4 for additional details on the calculation of C-14 released in 2013 from the Susquehanna station. If a radionuclide was not detected, zero activity was used for that isotope in dose calculations and the activity is listed as "<MDC" (less than the minimum detectable concentration) in Tables 2-1 and 2-2. <MDC indicates that no activity was positively detected in any sample when samples were analyzed with techniques which achieved the required Lower Limits of Detection (LLD) as specified in the Technical Requirement (TRO) Table 3.11.2.1-1, Radioactive Gaseous Effluent Sampling and Analysis Program. In all cases, the measurement laboratory MDCs were at or below the LLD levels required by Technical Requirements. The following are typical measurement laboratory MDCs.

Typical MDCs

<u>Radionuclide</u>	<u>MDC (µCi/cc)</u>
Kr-87	4.3 E-08
Kr-88	4.6 E-08
Xe-133	3.0 E-08
Xe-133m	1.1 E-07
Xe-135	1.5 E-08
Xe-135m	8.0 E-08
Xe-138	1.5 E-07
Mn-54	2.9 E-13
Fe-59	2.8 E-13
Co-58	1.8 E-13
Co-60	3.8 E-13
Zn-65	1.0 E-13
Mo-99	1.0 E-12
Cs-134	2.4 E-13
Cs-137	1.1 E-13
Ce-141	1.0 E-13
Ce-144	5.0 E-13
I-131	4.4 E-14
Sr-89	1.1 E-13
Sr-90	1.3 E-14
H-3	1.5 E-08
Gross Alpha	2.3 E-14

Batch Releases

1. Number of Batch Releases:	0
2. Total Time Period for Batch Release:	NA
3. Maximum Time Period for a Batch Release:	NA
4. Average Time Period for a Batch Release:	NA
5. Minimum Time Period for a Batch Release:	NA

Abnormal Releases

1. Number of Releases	1*
2. Total Activity Released	NA

*On September 15, 2013 at 00:08, a High alarm occurred on the Standby Gas Treatment (SBGT) system vent low range noble gas detector channel. The Unit-2 primary containment (drywell) was being purged at the time of the High alarm. The Unit-2 drywell purge was secured at 00:20 and the SBGT system was shutdown at 00:41. The High alarm did not result in entry into the Emergency Plan (no E-Plan release rate thresholds exceeded).

Unit-2 primary containment prior to purge samples did not identify any noble gas activity above analysis detection levels. There were no SBGT system vent samples or Unit-2 drywell samples obtained during the period of time when the SBGT system vent low range noble gas detector readings were elevated (to evaluate/determine a possible airborne effluent release source term). SBGT vent low range noble gas detector release rate data (associated with the alarm period) indicates a gradual increase then a decrease in the release rate, which is indicative of an airborne release and not an electronic or detector spike.

The radioactive source term assumed released on September 15, 2013 during the period of time when the low range noble gas detector readings were elevated is included in Tables 2-1 and 2-2. Resultant offsite dose due to the release on September 15, 2013 is included in the applicable tables in Section 4. Additional details regarding the SBGT vent release on September 15, 2013 are included in Condition Report No. 1747707.

TABLE 2-1

AIRBORNE EFFLUENT - SUMMATION OF ALL RELEASES

A. Fission and Activation Gas	Unit	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
Total Release	Ci	<MDC	<MDC	8.12E+00	6.13E+00
Average Release Rate for Period	μCi/sec	0	0	1.02E+00	7.72E-01
Percent of Applicable Limit (1.67E+04 μCi/sec)	%	0	0	6.11E-03	4.62E-03

B. Iodines

Total I-131	Ci	<MDC	<MDC	<MDC	<MDC
Average Release Rate for Period	μCi/sec	0	0	0	0
Percent of Applicable Limit (1.73E+00 μCi/sec)	%	0	0	0	0

C. Particulate

Particulate with Half-Life >8 Days	Ci	<MDC	2.84E-04	2.50E-05	2.31E-06
Average Release Rate for Period	μCi/sec	0	3.61E-05	3.14E-06	2.90E-07
Percent of Applicable Limit (5.03E+01 μCi/sec)	%	0	7.18E-05	6.25E-06	5.78E-07
Gross Alpha Radioactivity	Ci	<MDC	<MDC	<MDC	<MDC

D. Tritium

Total Release	Ci	1.05E+00	7.72E-02	<MDC	1.03E-01
Average Release Rate for Period	μCi/sec	1.35E-01	9.82E-03	0	1.29E-02
Percent of Applicable Limit (2.44E+03 μCi/sec)	%	5.52E-03	4.03E-04	0	5.30E-04

E. Radionuclide Fractional Summation

Sum of Percent of Applicable Limit During Period for B, C and D (Limit = 100%)	%	0.01	<0.01	<0.01	0.01
--	---	------	-------	-------	------

TABLE 2-2

AIRBORNE EFFLUENT - RADIONUCLIDES RELEASED

Nuclides Released	Unit	Releases in Continuous Mode			
		First Quarter	Second Quarter	Third Quarter	Fourth Quarter
A. Fission and Activation Gases					
N-13	Ci	<MDC	<MDC	<MDC	<MDC
Ar-41	Ci	<MDC	<MDC	<MDC	5.52E+00
Kr-85	Ci	<MDC	<MDC	<MDC	<MDC
Kr-85m	Ci	<MDC	<MDC	7.01E-02	2.55E-01
Kr-87	Ci	<MDC	<MDC	7.48E-07	<MDC
Kr-88	Ci	<MDC	<MDC	1.25E-02	1.46E-01
Kr-89	Ci	<MDC	<MDC	<MDC	<MDC
Xe-133	Ci	<MDC	<MDC	4.31E+00	2.11E-01
Xe-135	Ci	<MDC	<MDC	3.73E+00	<MDC
Xe-135m	Ci	<MDC	<MDC	<MDC	<MDC
Xe-137	Ci	<MDC	<MDC	<MDC	<MDC
Xe-138	Ci	<MDC	<MDC	<MDC	<MDC
Total for Period	Ci	0	0	8.12E+00	6.13E+00
B. Iodines					
I-131	Ci	<MDC	<MDC	<MDC	<MDC
I-133	Ci	<MDC	<MDC	<MDC	<MDC
I-135	Ci	<MDC	<MDC	<MDC	<MDC
Total for Period	Ci	0	0	0	0
C. Particulate					
Cr-51	Ci	<MDC	1.59E-04	<MDC	<MDC
Mn-54	Ci	<MDC	6.99E-06	<MDC	<MDC
Fe-59	Ci	<MDC	<MDC	<MDC	<MDC
Co-57	Ci	<MDC	<MDC	<MDC	<MDC
Co-58	Ci	<MDC	2.44E-05	1.40E-05	<MDC
Co-60	Ci	<MDC	9.38E-05	1.10E-05	2.31E-06
Zn-65	Ci	<MDC	<MDC	<MDC	<MDC
Sr-89	Ci	<MDC	<MDC	<MDC	<MDC
Sr-90	Ci	<MDC	<MDC	<MDC	<MDC
Cs-134	Ci	<MDC	<MDC	<MDC	<MDC
Cs-137	Ci	<MDC	<MDC	<MDC	<MDC
Ce-141	Ci	<MDC	<MDC	<MDC	<MDC
Ce-144	Ci	<MDC	<MDC	<MDC	<MDC
Nb-95	Ci	<MDC	<MDC	<MDC	<MDC
Ba-La-140	Ci	<MDC	<MDC	<MDC	<MDC
Total for Period	Ci	0	2.84E-04	2.50E-05	2.31E-06

Waterborne Effluents

Summaries of the radionuclide total curie activities, average diluted concentrations, and percent of applicable Technical Requirement limits are included in Tables 2-3 and 2-4.

<u>Batch Releases*</u>	<u>Qtr. 1</u>	<u>Qtr. 2</u>	<u>Qtr. 3</u>	<u>Qtr. 4</u>	<u>Annual</u>
1. Number of Batch Releases	26	93	61	30	210
2. Total Time Period for Batch Releases	2.52E+03	1.95E+04	1.37E+04	3.52E+03	3.92E+04
3. Maximum Time Period for a Batch Release	2.87E+02	3.46E+02	3.39E+02	3.00E+02	3.46E+02
4. Average Time Period for a Batch Release	9.68E+01	2.09E+02	2.24E+02	1.17E+02	1.87E+02
5. Minimum Time Period for a Batch Release	3.10E+01	3.10E+01	3.20E+01	3.50E+01	3.10E+01
6. Average Cooling Tower Blowdown Flow Rate During Periods of Release	9.68E+03	1.34E+04	1.43E+04	9.29E+03	1.31E+04
7. Susquehanna River Flow Rate	8.62E+06	8.12E+06	7.43E+06	8.63E+06	8.20E+06

*Units of time and flow are expressed in minutes and gallons per minute (gpm), respectively.

If a radionuclide was not detected, zero activity was used for that isotope in dose calculations and the activity is listed as "<MDC" (less than the minimum detectable concentration) in Tables 2-3 and 2-4. <MDC indicates that no activity was positively detected in any sample when samples were analyzed with techniques which achieved the required Lower Limits of Detection (LLD) as specified in the Technical Requirement 3.11.1.1-1, Radioactive Liquid Waste Sampling and Analysis Program. In all cases, the measurement laboratory MDCs were at or below the LLD levels required by Technical Requirements. The following are typical measurement laboratory MDCs.

<u>Radionuclide</u>	<u>MDC (µCi/ml)</u>
Mn-54	4.5 E-08
Fe-59	5.0 E-08
Co-58	4.0 E-08
Co-60	5.4 E-08
Zn-65	4.9 E-08
Mo-99	1.7 E-07
I-131	2.0 E-08
Cs-134	2.2 E-08
Cs-137	2.6 E-08
Ce-141	3.2 E-08
Ce-144	1.3 E-07
Sr-89	4.4 E-08
Sr-90	1.6 E-08
Fe-55	8.2 E-07
H-3	3.6 E-06
Gross Alpha	3.7 E-09

Abnormal Releases

1.	Number of releases	0	0	0	0
2.	Volume Released (Gallons)	N/A	N/A	N/A	N/A
3.	Total Activity Released (Ci)	N/A	N/A	N/A	N/A

TABLE 2-3

WATERBORNE EFFLUENT - SUMMATION OF ALL RELEASES

	Unit	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
A. Fission and Activation Products					
1. Total Release (excluding: Tritium, Ent. Gases, Alpha)	Ci	2.93E-04	6.92E-02	4.91E-03	2.87E-04
2. Average Diluted Concentration During Period	µCi/ml	3.18E-09	6.98E-08	6.64E-09	2.33E-09
3. Sum of Average Diluted C _n /L _n Ratio During Period	Unitless	6.53E-05	8.67E-04	1.16E-04	6.40E-05
4. Percent of Applicable Limit (Ratio < 1.0)	%	0.007	0.09	0.01	0.006
B. Tritium					
1. Total Release	Ci	5.65E+00	4.18E+01	2.47E+01	9.11E+00
2. Average Diluted Concentration During Period	µCi/ml	6.13E-05	4.22E-05	3.33E-05	7.36E-05
3. Percent of Applicable Limit (1.0E-2 µCi/ml)	%	0.61	0.42	0.33	0.74
C. Dissolved and Entrained Gases					
1. Total Release	Ci	<MDC	4.14E-06	6.25E-06	<MDC
2. Average Diluted Concentration During Period	µCi/ml	0.00E+00	4.18E-12	8.45E-12	0.00E+00
3. Percent of Applicable Limit (2.0E-4 µCi/ml)	%	0.00E+00	2.09E-06	4.23E-06	0.00E+00
D. Radionuclide Fractional Summation					
1. Sum of Percent of Applicable Limit During Period for A, B and C (Limit = 100%)	%	0.62	0.51	0.34	0.75
E. Gross Alpha Radioactivity					
1. Total Release	Ci	<MDC	<MDC	<MDC	<MDC
F. Volume of Water Released (Prior to Dilution)					
	Gallons	1.81E+05	1.50E+06	1.06E+06	2.55E+05
	Liters	6.85E+05	5.69E+06	4.00E+06	9.65E+05
G. Volume of Dilution Water Used During Period of Release					
	Gallons	2.42E+07	2.60E+08	1.94E+08	3.25E+07
	Liters	9.15E+07	9.85E+08	7.36E+08	1.23E+08
H. Volume of Dilution Water Used Over Entire Period					
	Gallons	1.32E+09	1.46E+09	1.88E+09	1.52E+09
	Liters	5.01E+09	5.52E+09	7.13E+09	5.74E+09

TABLE 2-4

WATERBORNE EFFLUENT - RADIONUCLIDES RELEASED

Nuclides Released	Unit	Releases in Batch Mode			
		First Quarter	Second Quarter	Third Quarter	Fourth Quarter
A. Fission and Activation Products					
Ag-110m	Ci	<MDC	1.51E-05	<MDC	<MDC
Cr-51	Ci	4.10E-05	2.81E-02	1.21E-03	<MDC
Mn-54	Ci	5.75E-05	8.68E-03	8.00E-04	5.47E-05
Fe-55	Ci	<MDC	<MDC	<MDC	<MDC
Co-58	Ci	2.35E-05	5.90E-03	4.25E-04	6.85E-07
Fe-59	Ci	<MDC	2.26E-03	4.39E-05	<MDC
Co-60	Ci	1.71E-04	2.21E-02	2.38E-03	2.31E-04
Zn-65	Ci	<MDC	1.41E-03	5.23E-05	1.00E-06
Sr-89	Ci	<MDC	<MDC	<MDC	<MDC
Sr-90	Ci	<MDC	<MDC	<MDC	<MDC
Nb-95	Ci	<MDC	1.41E-04	<MDC	<MDC
Br-82	Ci	<MDC	3.23E-07	<MDC	<MDC
Nb-97	Ci	<MDC	2.28E-05	<MDC	<MDC
I-132	Ci	2.04E-07	<MDC	<MDC	<MDC
Te-134	Ci	<MDC	1.17E-06	<MDC	<MDC
Cs-137	Ci	<MDC	1.76E-06	<MDC	<MDC
Sb-124	Ci	<MDC	1.26E-04	<MDC	<MDC
Ta-182	Ci	<MDC	4.34E-04	<MDC	<MDC
U-235	Ci	<MDC	3.22E-06	<MDC	<MDC
Total for Period	Ci	2.93E-04	6.92E-02	4.91E-03	2.87E-04
B. Tritium					
Total for Period	Ci	5.65E+00	4.18E+01	2.47E+01	9.11E+00
C. Dissolved and Entrained Gases					
Ar-41	Ci	<MDC	4.14E-06	<MDC	<MDC
Kr-85	Ci	<MDC	<MDC	<MDC	<MDC
Kr-85m	Ci	<MDC	<MDC	<MDC	<MDC
Kr-87	Ci	<MDC	<MDC	<MDC	<MDC
Kr-88	Ci	<MDC	<MDC	<MDC	<MDC
Xe-131m	Ci	<MDC	<MDC	<MDC	<MDC
Xe-133m	Ci	<MDC	<MDC	<MDC	<MDC
Xe-133	Ci	<MDC	<MDC	<MDC	<MDC
Xe-135m	Ci	<MDC	<MDC	<MDC	<MDC
Xe-135	Ci	<MDC	<MDC	6.25E-06	<MDC
Total for Period	Ci	0	4.14E-06	6.25E-06	0

Figure 2-1

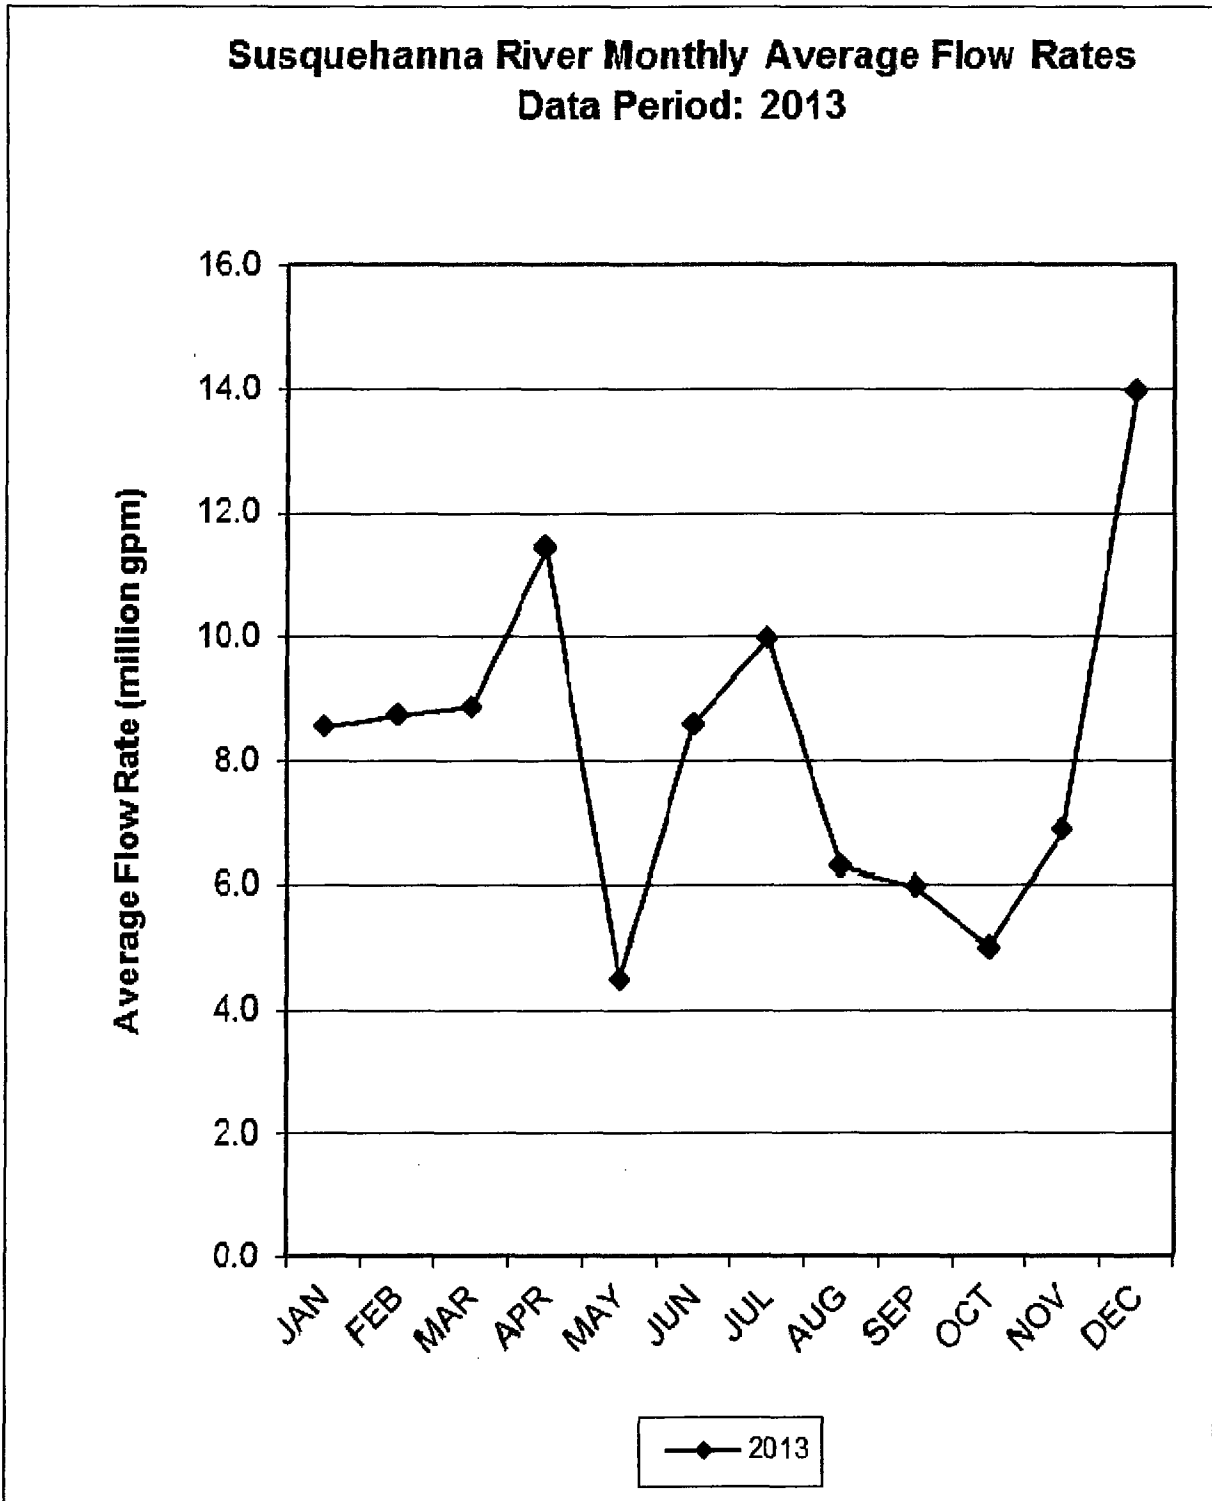


Figure 2-2
Monthly Liquid Radwaste Discharge Totals

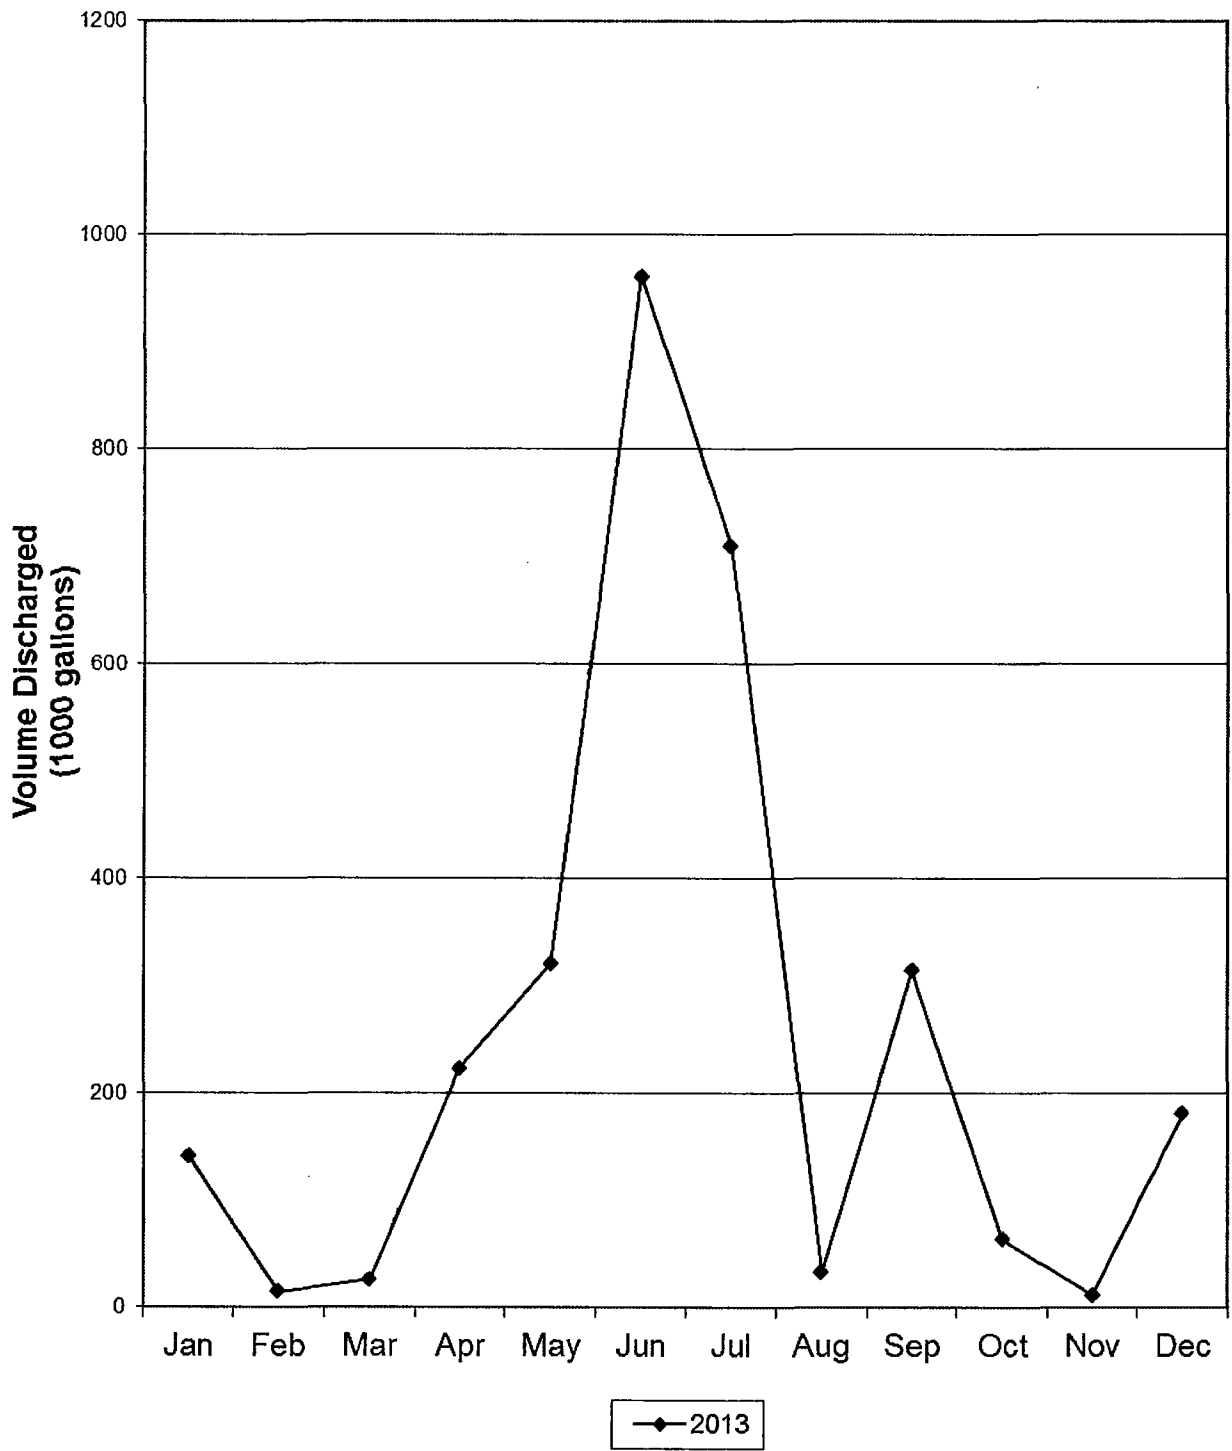


TABLE 2-5

ESTIMATED TOTAL ERRORS ASSOCIATED WITH
EFFLUENTS MEASUREMENTS

<u>MEASUREMENT</u>	<u>ESTIMATED TOTAL ERROR</u>
1. Airborne Effluents	
a. Fission and Activation Gases	15.9%
b. I-131	13.3%
c. Particulates (incl. Gross Alpha)	15.8%
d. Tritium	13.6%
2. Waterborne Effluents	
a. Fission and Activation Products	5.0%
b. Tritium	3.3%
c. Dissolved and Entrained Gases	8.4%
d. Gross Alpha Activity	6.0%
e. Volume of Waste Released (Prior to Dilution)	5.0%
f. Volume of Dilution Water Used During Period	15.0%
	<u>ESTIMATED MAXIMUM MEASUREMENT ERROR</u>
3. Solid Wastes	
a. CFS Backwash Media-Class A HIC (Pyrolysis)	±25%
b. CFS Filters-Class A HIC (Pyrolysis)	±25%
c. Cartridge Filters- Class A HIC (Overfilled)	±25%
d. Condensate Demineralizer / Radwaste Demineralizer Class A HIC (Pyrolysis)	±25%
e. Contaminated Waste Oil – Class A Fuel Blending for Co-Generation	±25%
f. Liquid Radwaste Filter Media – Class A HIC (Pyrolysis)	±25%
g. Processed DAW – Class A HIC (Overfilled)	±25%
h. Processed DAW – Class A Strong Tight Container (Compacted)	±25%

SUSQUEHANNA STEAM ELECTRIC STATION
RADIOACTIVE WASTE REPORT
RADIOACTIVE EFFLUENT RELEASE REPORT
SOLID RADIOACTIVE WASTE


DATA PERIOD: JANUARY 1, 2013 – DECEMBER 31, 2013

PREPARED BY:



MICHAEL C. MICCA
HEALTH PHYSICIST

APPROVED BY:



ROBIN RODRIGUEZ-GILROY
RADIOLOGICAL OPERATIONS SUPERVISOR

REPORT NOTES

1. All activities reported in Milli-Curies (mCi) unless otherwise noted.
2. Reported activities, as indicated with the (<) sign, are comprised in whole or part of MDL values.
3. Estimated maximum measurement error is $\pm 25\%$.

TABLE 2-6

WASTE DISPOSITION

Data Period: January 1, 2013 - December 31, 2013

A. SOLID WASTE SHIPPED OFF-SITE FOR BURIAL OR DISPOSAL

<u>Number of Shipments</u>	<u>Mode of Transportation</u>	<u>Destination</u>
----------------------------	-------------------------------	--------------------

NONE

B. IRRADIATED FUEL SHIPMENTS

<u>Number of Shipments</u>	<u>Mode of Transportation</u>	<u>Destination</u>
----------------------------	-------------------------------	--------------------

NONE

NOTE: The number of shipments listed in A include only the shipments from PPL Susquehanna, LLC to a disposal site. It does not include shipments made to or from volume reduction vendors.

Table 2-7

Annual Waste Release Summary Report

Year: 2013

Class: A Volume Reduction Vendor: Yes
 Source: CFS Backwash Media
 Container: HIC (High Integrity Container)
 Process: Pyrolysis

Nuclides	Activity (mCi)	% of Total
C-14	1.500E-01	0.00 %
CO-58	4.430E+01	0.22 %
CO-60	4.880E+03	24.58 %
CS-137	1.050E+00	0.01 %
CU-64	5.180E-16	0.00 %
FE-55	1.420E+04	71.53 %
H-3	3.400E+01	0.17 %
I-129	1.150E-01	0.00 %
MN-54	3.730E+02	1.88 %
NI-63	2.080E+02	1.05 %
TC-99	5.950E-01	0.00 %
ZN-65	1.100E+02	0.55 %

Total Activity (Ci)	19.851	100.00 %
Container Volume	33.570 ft3	0.951 m3

Table 2-8

Annual Waste Release Summary Report

Year: 2013

Class: A Volume Reduction Vendor: Yes
 Source: CFS Filters
 Container: HIC (High Integrity Container)
 Process: Pyrolysis

Nuclides	Activity (mCi)	% of Total
C-14	9.890E-01	0.00 %
CO-58	5.130E+01	0.06 %
CO-60	1.989E+04	25.04 %
CS-137	4.380E+00	0.01 %
FE-55	5.630E+04	70.87 %
H-3	3.910E+01	0.05 %
I-129	6.450E-01	0.00 %
MN-54	1.765E+03	2.22 %
NI-63	8.700E+02	1.10 %
TC-99	2.980E+00	0.00 %
ZN-65	5.190E+02	0.65 %

Total Activity (Ci)	79.443	100.00 %
Container Volume	150.060 ft3	4.249 m3

Table 2-9

Annual Waste Release Summary Report

Year: 2013

Class: A Volume Reduction Vendor: Yes
 Source: Cartridge Filters
 Container: HIC (High Integrity Container)
 Process: Overfilled

Nuclides	Activity (mCi)	% of Total
-----	-----	-----
C-14	6.640E-02	0.00 %
CO-58	2.760E+00	0.01 %
CO-60	6.020E+03	19.52 %
CR-51	2.720E-01	0.00 %
CS-137	1.400E-01	0.00 %
FE-55	2.410E+04	78.16 %
H-3	1.110E+00	0.00 %
I-129	1.920E-03	0.00 %
MN-54	1.840E+02	0.60 %
NB-95	2.610E-01	0.00 %
NI-63	3.200E+02	1.04 %
SB-125	1.790E+02	0.58 %
TC-99	1.060E-02	0.00 %
ZN-65	2.460E+01	0.08 %
ZR-95	2.850E+00	0.01 %
-----	-----	-----
Total Activity (Ci)	30.835	100.00 %
Container Volume	43.420 ft3	1.230 m3

Table 2-11.

Annual Waste Release Summary Report

Year: 2013
 Class: A Volume Reduction Vendor: Yes
 Source: Contaminated Waste Oil
 Container: None
 Process: Fuel Blending for Co-Generation

Nuclides	Activity (mCi)	% of Total
-----	-----	-----
C-14	< 3.120E-03	0.01 %
CO-58	8.160E-03	0.04 %
CO-60	1.160E+00	5.54 %
CR-51	1.410E-01	0.67 %
CS-137	6.320E-03	0.03 %
FE-55	1.070E+00	5.11 %
FE-59	1.430E-02	0.07 %
H-3	1.820E+01	86.98 %
I-129	< 3.070E-03	0.01 %
MN-54	7.930E-03	0.04 %
NB-95	9.670E-02	0.46 %
NI-63	2.320E-02	0.11 %
SB-125	1.190E-01	0.57 %
TC-99	< 8.470E-03	0.04 %
ZN-65	8.020E-03	0.04 %
ZR-95	5.520E-02	0.26 %
-----	-----	-----
Total Activity (Ci)	0.021	100.00 %
Container Volume	0.000 ft3	0.000 m3

Table 2-12

Annual Waste Release Summary Report

Year: 2013

Class: A Volume Reduction Vendor: Yes
Source: Liquid Radwaste Filter Media
Container: HIC (High Integrity Container)
Process: Pyrolysis

Nuclides	Activity (mCi)	% of Total
-----	-----	-----
C-14	3.330E-01	0.01 %
CO-58	1.550E+02	2.51 %
CO-60	1.800E+03	29.12 %
CR-51	3.000E+01	0.49 %
CS-137	6.690E-01	0.01 %
FE-55	3.610E+03	58.41 %
FE-59	5.160E+00	0.08 %
H-3	2.020E+01	0.33 %
I-129	5.410E-02	0.00 %
MN-54	3.770E+02	6.10 %
NB-95	3.690E+00	0.06 %
NI-63	7.800E+01	1.26 %
SR-90	1.320E-01	0.00 %
TC-99	2.170E-01	0.00 %
ZN-65	9.500E+01	1.54 %
ZR-95	5.190E+00	0.08 %
-----	-----	-----
Total Activity (Ci)	6.181	100.00 %
Container Volume	10.970 ft3	0.311 m3

Table 2-13

Annual Waste Release Summary Report

Year: 2013
 Class: A Volume Reduction Vendor: Yes
 Source: Processed DAW
 Container: HIC (High Integrity Container)
 Process: Overfilled

Nuclides	Activity (mCi)	% of Total
C-14	3.330E-01	0.01 %
CO-58	5.257E+00	0.23 %
CO-60	1.130E+03	48.97 %
CR-51	2.180E-03	0.00 %
CS-137	4.652E-01	0.02 %
FE-55	9.355E+02	40.53 %
FE-59	5.730E-04	0.00 %
H-3	1.071E-01	0.00 %
HF-181	5.300E-06	0.00 %
I-129	4.870E-06	0.00 %
MN-54	1.181E+02	5.12 %
NB-95	3.580E-04	0.00 %
NI-63	3.301E+01	1.43 %
SB-124	1.380E-05	0.00 %
SR-89	7.920E-03	0.00 %
SR-90	1.072E-02	0.00 %
TA-182	3.030E-04	0.00 %
TC-99	1.580E-05	0.00 %
ZN-65	8.491E+01	3.68 %
ZR-95	6.970E-04	0.00 %

Total Activity (Ci)	2.308	100.00 %
Container Volume	22.920 ft3	0.649 m3

Table 2-14

Annual Waste Release Summary Report

Year: 2013
Class: A Volume Reduction Vendor: Yes
 Source: Processed DAW
 Container: Strong Tight Container
 Process: Compacted

Nuclides	Activity (mCi)	% of Total
-----	-----	-----
C-14	9.936E-03	0.00 %
CO-58	3.771E+02	1.74 %
CO-60	9.057E+03	41.83 %
CR-51	8.317E+02	3.84 %
CS-137	1.096E+01	0.05 %
FE-55	9.250E+03	42.72 %
FE-59	8.568E+01	0.40 %
H-3	5.800E+01	0.27 %
I-129	1.674E-02	0.00 %
MN-54	1.189E+03	5.49 %
NB-95	8.530E+01	0.39 %
NI-59	8.000E-02	0.00 %
NI-63	2.065E+02	0.95 %
SB-125	1.235E+02	0.57 %
SN-125	2.117E-03	0.00 %
SR-90	9.013E-02	0.00 %
TC-99	5.701E-02	0.00 %
ZN-65	3.255E+02	1.50 %
ZR-95	5.252E+01	0.24 %
-----	-----	-----
Total Activity (Ci)	21.654	100.00 %
Container Volume	5323.000 ft3	150.733 m3

SECTION 3

METEOROLOGICAL DATA AND DISPERSION ESTIMATES

METEOROLOGY AND DISPERSION DATA

Meteorological data have been collected at the PPL Susquehanna, LLC site since the early 1970s. At the present time, the meteorological system is based on a 300-foot high tower located approximately 1,000 feet to the southeast of the plant. Wind sensors are mounted at the 10m and 60m elevations on this tower. Vertical temperature differential is measured with redundant sensor pairs between the 10m and 60m levels. Sigma theta (the standard deviation of horizontal wind direction) is calculated from wind direction at both levels. Dew point and ambient temperature sensors are present at the 10m level. Precipitation is measured at ground level.

A back-up meteorological tower was erected in 1982. It is a 10m tower providing alternate measurements of wind speed, wind direction, and sigma theta. A 10m downriver meteorological tower is also available. This tower measures wind speed, wind direction, sigma theta, temperature and dew point.

Meteorological data are transmitted to the plant Control Room, Technical Support Center, Emergency Operations Facility for emergency response availability, and ABSG Consulting, Inc. ABSG Consulting, Inc., located in Rockville, Maryland, provides meteorological consulting services to PPL Susquehanna, LLC.

Regulatory Guide 1.23 (Safety Guide 23) requires at least 90% data recovery for meteorological instrumentation. During 2013, all meteorological instrumentation met the 90% data recovery requirement. Table 3-1 lists the percent valid data recovery values for the parameters monitored as part of the PPL Susquehanna Meteorological Monitoring Program.

Dispersion modeling for effluents from normal operation is done using the MIDAS system XDCALC program, a straight-line Gaussian plume model designed to estimate average relative concentration. The model was developed in accordance with Regulatory Guide 1.111. For periods when the wind speed is calm, the actual wind direction that last occurred is used.

XDCALC and the XQINTR program that interpolates X/Q values to exact locations both use terrain correction factors to account for the temporal and spatial variations in the airflow in the region. A straight-line trajectory model assumes that a constant mean wind transports and diffuses effluents in the direction of airflow at the release point within the entire region of interest. The terrain correction factors were taken from FSAR Table 2.3-128.

Tables 3-2 and 3-3 provide the joint frequency distribution of wind speed and direction (as a function of delta temperature) at the 10 and 60 meter elevations of the primary meteorological tower. Table 3-4 lists no decay, undepleted X/Q values at various distances from the site. Table 3-5 lists 2.26 day decay, undepleted X/Q values at various distances from the site. Table 3-6 lists 8-day decay, depleted X/Q values at various distances from the site and Table 3-7 is a listing of D/Q (relative deposition) values at various distances from the site.

TABLE 3-1

METEOROLOGICAL DATA RECOVERY FOR 2013

Parameter	Percent Valid Data Recovery
Wind Speed 10m - Primary (1)	99.7
Wind Speed 60m - Primary	99.7
Wind Speed 10m - Backup (2)	99.9
Wind Speed 10m - Downriver (3)	99.9
Wind Direction 10m - Primary	99.7
Wind Direction 60m - Primary	99.8
Wind Direction 10m - Backup	99.9
Wind Direction 10m - Downriver	100.0
Temperature 10m - Primary	100.0
Dew Point 10m - Primary	100.0
Delta Temperature 60m - Primary	99.6
Sigma Theta 10m - Primary	99.9
Sigma Theta 60m - Primary	99.9
Sigma Theta 10m - Backup	100.0
Sigma Theta 10m - Downriver	99.8
Precipitation - Primary	100.0
Composite Parameters	
Wind Speed and Direction 10m, Delta Temperature 60-10m	99.5
Wind Speed and Direction 60m, Delta Temperature 60-10m	99.6
(1) SSES "Primary" meteorological tower	
(2) SSES "Backup" meteorological tower	
(3) SSES "Downriver" meteorological tower	

TABLE 3-2

SSES JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND WIND DIRECTION 10m VERSUS DELTA TEMPERATURE 60-10m FOR THE PERIOD OF JANUARY 1, 2013 THROUGH DECEMBER 31, 2013

Joint Frequency Distribution

Hours at Each Wind Speed and Direction

Total Period
 Period of Record = 1/1/2013 00:00 - 12/31/2013 23:00
 Elevation: Speed: 10_SPD Direction: 10_WD Lapse: DT60-10A
 Stability Class A Delta Temperature Extremely Unstable

<u>Wind Direction</u>	<u>Wind Speed (mph)</u>						<u>Total</u>
	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>> 25</u>	
N	0	0	0	0	0	0	0
NNE	0	0	2	0	0	0	2
NE	0	1	0	0	0	0	1
ENE	1	2	0	0	0	0	3
E	6	1	0	0	0	0	7
ESE	0	2	1	0	0	0	3
SE	2	0	6	0	0	0	8
SSE	0	1	1	0	0	0	2
S	0	0	6	2	0	0	8
SSW	0	3	7	1	0	0	11
SW	1	5	19	0	0	0	25
WSW	0	1	3	0	0	0	4
W	0	1	0	0	0	0	1
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Total	10	17	45	3	0	0	75

Calm Hours not Included above for :	Total Period	0
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	42
Valid Hours for this Stability Class for:	Total Period	75
Total Hours for Period		8760

**TABLE 3-2
(Continued)**

SSES JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND WIND DIRECTION 10m VERSUS DELTA TEMPERATURE 60-10m FOR THE PERIOD OF JANUARY 1, 2013 THROUGH DECEMBER 31, 2013 (Continued)

Joint Frequency Distribution

Hours at Each Wind Speed and Direction

Total Period
 1/1/2013 00:00 - 12/31/2013 23:00
 Elevation: Speed: 10_SPD Direction: 10_WD Lapse: DT60-10A
 Stability Class B Delta Temperature Moderately Unstable

<u>Wind Direction</u>	<u>Wind Speed (mph)</u>						<u>Total</u>
	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	
N	0	2	4	0	0	0	6
NNE	0	9	3	0	0	0	12
NE	0	15	1	0	0	0	16
ENE	0	4	0	0	0	0	4
E	1	0	0	0	0	0	1
ESE	2	1	5	0	0	0	8
SE	1	8	1	0	0	0	10
SSE	0	1	6	0	0	0	7
S	0	3	11	0	0	0	14
SSW	1	8	6	0	0	0	15
SW	0	18	31	3	0	0	52
WSW	0	7	22	1	0	0	30
W	0	3	1	0	0	0	4
WNW	0	0	1	0	0	0	1
NW	0	0	0	0	0	0	0
NNW	0	1	3	1	0	0	5
Total	5	80	95	5	0	0	185

Calm Hours not Included above for :	Total Period	0
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	42
Valid Hours for this Stability Class for:	Total Period	185
Total Hours for Period		8760

**TABLE 3-2
(Continued)**

**SSES JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND WIND
DIRECTION 10m VERSUS DELTA TEMPERATURE 60-10m FOR THE PERIOD OF
JANUARY 1, 2013 THROUGH DECEMBER 31, 2013 (Continued)**

Joint Frequency Distribution

Hours at Each Wind Speed and Direction

Total Period
 Period of Record = 1/1/2013 00:00 - 12/31/2013 23:00
 Elevation: Speed: 10_SPD Direction: 10_WD Lapse: DT60-10A
 Stability Class C Delta Temperature Slightly Unstable

<u>Wind Direction</u>	<u>Wind Speed (mph)</u>						<u>Total</u>
	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	
N	0	7	10	0	0	0	17
NNE	0	17	4	0	0	0	21
NE	6	22	2	0	0	0	30
ENE	1	9	0	0	0	0	10
E	6	3	2	0	0	0	11
ESE	0	5	0	0	0	0	5
SE	0	21	3	0	0	0	24
SSE	0	14	4	0	0	0	18
S	1	6	9	1	0	0	17
SSW	2	25	7	1	0	0	35
SW	1	48	61	5	0	0	115
WSW	2	22	37	9	0	0	70
W	0	9	9	0	0	0	18
WNW	0	3	5	0	0	0	8
NW	0	4	7	6	0	0	17
NNW	0	4	4	4	0	0	12
Total	19	219	164	26	0	0	428

Calm Hours not Included above for :	Total Period	0
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	42
Valid Hours for this Stability Class for:	Total Period	428
Total Hours for Period		8760

**TABLE 3-2
(Continued)**

SSES JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND WIND DIRECTION 10m VERSUS DELTA TEMPERATURE 60-10m FOR THE PERIOD OF JANUARY 1, 2013 THROUGH DECEMBER 31, 2013 (Continued)

Joint Frequency Distribution

Hours at Each Wind Speed and Direction

<u>Wind Direction</u>	<u>Wind Speed (mph)</u>						<u>Total</u>	
	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>> 25</u>		
N	22	160	159	4	0	0	345	
NNE	61	156	45	1	0	0	263	
NE	90	194	22	2	0	0	308	
ENE	107	85	12	2	0	0	206	
E	105	54	7	0	0	0	166	
ESE	108	48	9	0	0	0	165	
SE	71	91	13	0	0	0	175	
SSE	76	122	23	3	0	0	224	
S	105	149	54	7	0	0	315	
SSW	78	211	33	1	0	0	323	
SW	68	280	212	16	0	0	576	
WSW	34	125	180	70	7	0	416	
W	11	84	133	30	0	0	258	
WNW	6	52	92	14	0	0	164	
NW	4	63	154	44	0	0	265	
NNW	13	104	181	21	0	0	319	
Total	959	1978	1329	215	7	0	4488	
Calm Hours not Included above for :							Total Period	0
Variable Direction Hours for:							Total Period	0
Invalid Hours for:							Total Period	42
Valid Hours for this Stability Class for:							Total Period	4488
Total Hours for Period								8760

**TABLE 3-2
(Continued)**

**SSES JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND WIND
DIRECTION 10m VERSUS DELTA TEMPERATURE 60-10m FOR THE PERIOD OF
JANUARY 1, 2013 THROUGH DECEMBER 31, 2013 (Continued)**

Joint Frequency Distribution

Hours at Each Wind Speed and Direction

		Total Period						
Period of Record =		1/1/2013 00:00 - 12/31/2013 23:00						
Elevation:	Speed: 10_SPD	Direction: 10_WD		Lapse: DT60-10A				
Stability Class	E	Delta Temperature		Slightly Stable				
		Wind Speed (mph)						
<u>Wind Direction</u>	<u>1-4</u>	<u>4-8</u>	<u>8-13</u>	<u>13-19</u>	<u>19-25</u>	<u>≥ 25</u>	<u>Total</u>	
N	18	44	1	0	0	0	63	
NNE	56	64	4	0	0	0	124	
NE	154	54	2	0	0	0	210	
ENE	231	29	1	0	0	0	261	
E	199	1	0	0	0	0	200	
ESE	106	4	1	0	0	0	111	
SE	127	9	0	0	0	0	136	
SSE	112	33	5	0	0	0	150	
S	138	106	13	4	0	0	261	
SSW	91	152	13	2	0	0	258	
SW	55	111	20	1	0	0	187	
WSW	11	36	8	1	0	0	56	
W	11	11	1	0	0	0	23	
WNW	8	11	0	0	0	0	19	
NW	2	14	0	0	0	0	16	
NNW	3	15	2	0	0	0	20	
Total	1322	694	71	8	0	0	2095	
Calm Hours not Included above for :		Total Period					0	
Variable Direction Hours for:		Total Period					0	
Invalid Hours for:		Total Period					42	
Valid Hours for this Stability Class for:		Total Period					2095	
Total Hours for Period							8760	

**TABLE 3-2
(Continued)**

**SSES JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND WIND
DIRECTION 10m VERSUS DELTA TEMPERATURE 60-10m FOR THE PERIOD OF
JANUARY 1, 2013 THROUGH DECEMBER 31, 2013 (Continued)**

Joint Frequency Distribution

Hours at Each Wind Speed and Direction

Total Period
 1/1/2013 00:00 - 12/31/2013 23:00
 Elevation: Speed: 10_SPD Direction: 10_WD Lapse: DT60-10A
 Stability Class F Delta Temperature Moderately Stable

<u>Wind Direction</u>	<u>Wind Speed (mph)</u>						<u>Total</u>
	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	
N	2	2	0	0	0	0	4
NNE	20	2	0	0	0	0	22
NE	104	10	0	0	0	0	114
ENE	388	24	0	0	0	0	412
E	211	1	0	0	0	0	212
ESE	48	0	0	0	0	0	48
SE	34	0	0	0	0	0	34
SSE	27	3	0	0	0	0	30
S	28	3	0	0	0	0	31
SSW	15	5	1	0	0	0	21
SW	2	4	1	0	0	0	7
WSW	0	0	0	0	0	0	0
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	1	1	0	0	0	0	2
Total	861	55	2	0	0	0	937

Calm Hours not Included above for :	Total Period	0
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	42
Valid Hours for this Stability Class for:	Total Period	937
Total Hours for Period		8760

**TABLE 3-2
(Continued)**

**SSES JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND WIND
DIRECTION 10m VERSUS DELTA TEMPERATURE 60-10m FOR THE PERIOD OF
JANUARY 1, 2013 THROUGH DECEMBER 31, 2013 (Continued)**

Joint Frequency Distribution

Hours at Each Wind Speed and Direction

Total Period
 1/1/2013 00:00 - 12/31/2013 23:00
 Elevation: Speed: 10_SPD Direction: 10_WD Lapse: DT60-10A
 Stability Class G Delta Temperature Extremely Stable

<u>Wind Direction</u>	<u>Wind Speed (mph)</u>						<u>Total</u>
	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	
N	1	0	0	0	0	0	1
NNE	8	2	0	0	0	0	10
NE	57	8	0	0	0	0	65
ENE	283	14	0	0	0	0	297
E	85	0	0	0	0	0	85
ESE	21	0	0	0	0	0	21
SE	18	0	0	0	0	0	18
SSE	3	0	0	0	0	0	3
S	4	0	0	0	0	0	4
SSW	2	0	0	0	0	0	2
SW	0	1	0	0	0	0	1
WSW	2	0	0	0	0	0	2
W	1	0	0	0	0	0	1
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Total	485	25	0	0	0	0	510

Calm Hours not Included above for :	Total Period	0
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	42
Valid Hours for this Stability Class for:	Total Period	510
Total Hours for Period		8760

**TABLE 3-2
(Continued)**

SSES JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND WIND DIRECTION 10m VERSUS DELTA TEMPERATURE 60-10m FOR THE PERIOD OF JANUARY 1, 2013 THROUGH DECEMBER 31, 2013 (Continued)

Joint Frequency Distribution

Hours at Each Wind Speed and Direction

Summary of All Stability Classes

	Total Period
Period of Record =	1/1/2013 00:00 - 12/31/2013 23:00
Elevation: Speed: 10_SPD	Direction: 10_WD Lapse: DT60-10A

Delta Temperature

Wind Speed (mph)

<u>Wind Direction</u>	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	<u>Total</u>
N	43	215	174	4	0	0	436
NNE	145	250	58	1	0	0	454
NE	411	304	27	2	0	0	744
ENE	1011	167	13	2	0	0	1193
E	613	60	9	0	0	0	682
ESE	285	60	16	0	0	0	361
SE	253	129	23	0	0	0	405
SSE	218	174	39	3	0	0	434
S	276	267	93	14	0	0	650
SSW	189	404	67	5	0	0	665
SW	127	467	344	25	0	0	963
WSW	49	191	250	81	7	0	578
W	23	108	144	30	0	0	305
WNW	14	66	98	14	0	0	192
NW	6	81	161	50	0	0	298
NNW	17	125	190	26	0	0	358
Total	3680	3068	1706	257	7	0	8718

Calm Hours not Included above for :	Total Period	0
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	42
Valid Hours for this Stability Class for:	Total Period	8718
Total Hours for Period		8760

TABLE 3-3

SSES JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND WIND DIRECTION 60m VERSUS DELTA TEMPERATURE 60-10m FOR THE PERIOD OF JANUARY 1, 2013 THROUGH DECEMBER 31, 2013

Joint Frequency Distribution

Hours at Each Wind Speed and Direction

Total Period
 1/1/2013 00:00 - 12/31/2013 23:00
 Period of Record =
 Elevation: Speed: 60_SPD Direction: 60_WD Lapse: DT60-10A
 Stability Class A Delta Temperature Extremely Unstable

<u>Wind Direction</u>	<u>Wind Speed (mph)</u>						<u>Total</u>
	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	
N	0	0	2	0	0	0	2
NNE	1	0	1	0	0	0	2
NE	0	1	1	0	0	0	2
ENE	5	1	0	0	0	0	6
E	1	0	1	0	0	0	2
ESE	1	1	2	1	0	0	5
SE	0	0	4	1	0	0	5
SSE	1	0	1	0	0	0	2
S	0	0	0	4	3	0	7
SSW	1	1	4	1	2	0	9
SW	0	4	14	12	0	0	30
WSW	0	1	0	2	0	0	3
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Total	10	9	30	21	5	0	75

Calm Hours not Included above for :	Total Period	0
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	39
Valid Hours for this Stability Class for:	Total Period	75
Total Hours for Period		8760

**TABLE 3-3
(Continued)**

**SSES JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND WIND
DIRECTION 60m VERSUS DELTA TEMPERATURE 60-10m FOR THE PERIOD OF
JANUARY 1, 2013 THROUGH DECEMBER 31, 2013 (Continued)**

Joint Frequency Distribution

Hours at Each Wind Speed and Direction

Total Period
 1/1/2013 00:00 - 12/31/2013 23:00
 Elevation: Speed: 60_SPD Direction: 60_WD Lapse: DT60-10A
 Stability Class B Delta Temperature Moderately Unstable

<u>Wind Direction</u>	<u>Wind Speed (mph)</u>						<u>Total</u>
	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	
N	0	1	7	0	0	0	8
NNE	0	6	13	0	0	0	19
NE	1	5	3	0	0	0	9
ENE	1	1	0	0	0	0	2
E	1	0	0	0	0	0	1
ESE	0	2	2	4	0	0	8
SE	1	2	6	1	0	0	10
SSE	1	0	3	2	0	0	6
S	0	0	5	6	0	0	11
SSW	0	2	8	4	2	0	16
SW	0	7	37	15	1	0	60
WSW	0	2	12	13	0	0	27
W	0	0	1	0	0	0	1
WNW	0	0	0	0	0	0	0
NW	0	1	1	2	0	0	4
NNW	0	0	2	1	0	0	3
Total	5	29	100	48	3	0	185

Calm Hours not Included above for :	Total Period	0
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	39
Valid Hours for this Stability Class for:	Total Period	185
Total Hours for Period		8760

**TABLE 3-3
(Continued)**

**SSES JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND WIND
DIRECTION 60m VERSUS DELTA TEMPERATURE 60-10m FOR THE PERIOD OF
JANUARY 1, 2013 THROUGH DECEMBER 31, 2013 (Continued)**

Joint Frequency Distribution

Hours at Each Wind Speed and Direction

Total Period
 Period of Record = 1/1/2013 00:00 - 12/31/2013 23:00
 Elevation: Speed: 60_SPD Direction: 60_WD Lapse: DT60-10A
 Stability Class C Delta Temperature Slightly Unstable

<u>Wind Direction</u>	<u>Wind Speed (mph)</u>						<u>Total</u>
	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	
N	0	4	13	0	0	0	17
NNE	2	12	18	2	0	0	34
NE	5	12	5	0	0	0	22
ENE	3	6	1	0	0	0	10
E	0	2	2	0	0	0	4
ESE	0	6	2	0	0	0	8
SE	0	6	17	1	0	0	24
SSE	0	2	7	3	0	0	12
S	2	1	10	4	1	0	18
SSW	1	7	19	4	1	0	32
SW	0	15	77	31	2	1	126
WSW	0	8	35	24	5	0	72
W	0	2	7	5	0	0	14
WNW	0	3	1	3	0	0	7
NW	0	2	6	10	2	0	20
NNW	0	1	3	4	0	0	8
Total	13	89	223	91	11	1	428

Calm Hours not Included above for :	Total Period	0
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	39
Valid Hours for this Stability Class for:	Total Period	428
Total Hours for Period		8760

**TABLE 3-3
(Continued)**

SSES JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND WIND DIRECTION 60m VERSUS DELTA TEMPERATURE 60-10m FOR THE PERIOD OF JANUARY 1, 2013 THROUGH DECEMBER 31, 2013 (Continued)

Joint Frequency Distribution

Hours at Each Wind Speed and Direction

<u>Wind Direction</u>	<u>Wind Speed (mph)</u>						<u>Total</u>	
	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>		
N	22	79	132	38	0	0	271	
NNE	60	130	120	31	4	0	345	
NE	67	91	62	9	1	0	230	
ENE	50	55	24	7	0	0	136	
E	45	36	39	8	1	0	129	
ESE	29	43	30	6	0	0	108	
SE	23	55	73	10	0	0	161	
SSE	29	57	66	13	4	0	169	
S	52	62	80	44	10	1	249	
SSW	51	128	76	45	8	1	309	
SW	35	202	268	119	8	2	634	
WSW	13	94	196	229	64	10	606	
W	5	27	132	123	11	1	299	
WNW	3	19	89	75	8	0	194	
NW	1	38	179	80	7	0	305	
NNW	5	51	202	85	2	0	345	
Total	490	1167	1768	922	128	15	4490	
Calm Hours not Included above for :							Total Period	0
Variable Direction Hours for:							Total Period	0
Invalid Hours for:							Total Period	39
Valid Hours for this Stability Class for:							Total Period	4490
Total Hours for Period								8760

**TABLE 3-3
(Continued)**

SSES JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND WIND DIRECTION 60m VERSUS DELTA TEMPERATURE 60-10m FOR THE PERIOD OF JANUARY 1, 2013 THROUGH DECEMBER 31, 2013 (Continued)

Joint Frequency Distribution

Hours at Each Wind Speed and Direction

Total Period
 1/1/2013 00:00 - 12/31/2013 23:00
 Elevation: Speed: 60_SPD Direction: 60_WD Lapse: DT60-10A
 Stability Class E Delta Temperature Slightly Stable

<u>Wind Direction</u>	<u>Wind Speed (mph)</u>						<u>Total</u>
	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	
N	27	96	16	1	0	0	140
NNE	67	175	57	4	0	0	303
NE	88	55	17	3	0	0	163
ENE	56	30	5	0	0	0	91
E	43	22	3	3	0	0	71
ESE	38	16	2	0	0	0	56
SE	48	30	17	0	0	0	95
SSE	30	42	23	6	1	0	102
S	34	48	59	18	4	4	167
SSW	35	99	99	18	6	0	257
SW	27	117	165	22	3	1	335
WSW	16	33	75	39	1	0	164
W	6	22	13	0	0	0	41
WNW	4	15	9	0	0	0	28
NW	4	22	15	1	0	0	42
NNW	8	19	14	0	0	0	41
Total	531	841	589	115	15	5	2096

Calm Hours not Included above for :	Total Period	0
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	39
Valid Hours for this Stability Class for:	Total Period	2096
Total Hours for Period		8760

**TABLE 3-3
(Continued)**

**SSES JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND WIND
DIRECTION 60m VERSUS DELTA TEMPERATURE 60-10m FOR THE PERIOD OF
JANUARY 1, 2013 THROUGH DECEMBER 31, 2013 (Continued)**

Joint Frequency Distribution

Hours at Each Wind Speed and Direction

Period of Record =	Total Period
Elevation: Speed: 60_SPD	1/1/2013 00:00 - 12/31/2013 23:00
Stability Class F	Direction: 60_WD Lapse: DT60-10A
	Delta Temperature Moderately Stable

<u>Wind Direction</u>	<u>Wind Speed (mph)</u>						<u>Total</u>
	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	
N	17	128	4	0	0	0	149
NNE	73	202	4	0	0	0	279
NE	78	43	2	0	0	0	123
ENE	43	11	0	0	0	0	54
E	27	5	0	0	0	0	32
ESE	25	5	0	0	0	0	30
SE	36	7	0	0	0	0	43
SSE	21	9	0	0	0	0	30
S	18	27	2	0	0	0	47
SSW	11	30	12	0	1	0	54
SW	7	30	20	0	0	0	57
WSW	4	4	8	4	0	0	20
W	1	3	0	0	0	0	4
WNW	1	1	0	0	0	0	2
NW	4	1	1	0	0	0	6
NNW	1	4	2	0	0	0	7
Total	367	510	55	4	1	0	937
Calm Hours not Included above for :							Total Period 0
Variable Direction Hours for:							Total Period 0
Invalid Hours for:							Total Period 39
Valid Hours for this Stability Class for:							Total Period 937
Total Hours for Period							8760

**TABLE 3-3
(Continued)**

**SSES JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND WIND
DIRECTION 60m VERSUS DELTA TEMPERATURE 60-10m FOR THE PERIOD OF
JANUARY 1, 2013 THROUGH DECEMBER 31, 2013 (Continued)**

Joint Frequency Distribution

Hours at Each Wind Speed and Direction

Total Period
 1/1/2013 00:00 - 12/31/2013 23:00
 Elevation: Speed: 60_SPD Direction: 60_WD Lapse: DT60-10A
 Stability Class G Delta Temperature Extremely Stable

<u>Wind Direction</u>	<u>Wind Speed (mph)</u>						<u>Total</u>	
	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>> 25</u>		
N	12	75	0	0	0	0	87	
NNE	34	125	1	0	0	0	160	
NE	37	36	1	0	0	0	74	
ENE	29	7	1	0	0	0	37	
E	12	6	1	0	0	0	19	
ESE	15	2	0	0	0	0	17	
SE	14	4	0	0	0	0	18	
SSE	8	7	0	0	0	0	15	
S	9	7	2	0	0	0	18	
SSW	4	18	5	0	0	0	27	
SW	2	12	10	0	0	0	24	
WSW	1	2	1	1	0	0	5	
W	2	0	0	0	0	0	2	
WNW	1	0	0	0	0	0	1	
NW	2	2	0	0	0	0	4	
NNW	0	2	0	0	0	0	2	
Total	182	305	22	1	0	0	510	
Calm Hours not Included above for :							Total Period	0
Variable Direction Hours for:							Total Period	0
Invalid Hours for:							Total Period	39
Valid Hours for this Stability Class for:							Total Period	510
Total Hours for Period								8760

**TABLE 3-3
(Continued)**

SSES JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND WIND DIRECTION 60m VERSUS DELTA TEMPERATURE 60-10m FOR THE PERIOD OF JANUARY 1, 2013 THROUGH DECEMBER 31, 2013 (Continued)

Joint Frequency Distribution

Hours at Each Wind Speed and Direction

Summary of All Stability Classes

Total Period

Period of Record = 1/1/2013 00:00 - 12/31/2013 23:00
 Elevation: Speed: 60_SPD Direction: 60_WD Lapse: DT60-10A

Delta Temperature

<u>Wind Direction</u>	<u>Wind Speed (mph)</u>						<u>Total</u>
	<u>1 - 4</u>	<u>4 - 8</u>	<u>8 - 13</u>	<u>13 - 19</u>	<u>19 - 25</u>	<u>≥ 25</u>	
N	78	383	174	39	0	0	674
NNE	237	650	214	37	4	0	1142
NE	276	243	91	12	1	0	623
ENE	187	111	31	7	0	0	336
E	129	71	46	11	1	0	258
ESE	108	75	38	11	0	0	232
SE	122	104	117	13	0	0	356
SSE	90	117	100	24	5	0	336
S	115	145	158	76	18	5	517
SSW	103	285	223	72	20	1	704
SW	71	387	591	199	14	4	1266
WSW	34	144	327	312	70	10	897
W	14	54	153	128	11	1	361
WNW	9	38	99	78	8	0	232
NW	11	66	202	93	9	0	381
NNW	14	77	223	90	2	0	406
Total	1598	2950	2787	1202	163	21	8721

Calm Hours not Included above for :	Total Period	0
Variable Direction Hours for:	Total Period	0
Invalid Hours for:	Total Period	39
Valid Hours for this Stability Class for:	Total Period	8721
Total Hours for Period		8760

TABLE 3-4

2013 SSES Annual Relative Concentrations - No Decay, Undepleted X/Q (sec/m³)

Miles										
Direction From	0 - 1	1 - 2	2 - 3	3 - 4	4 - 5	5 - 10	10 - 20	20 - 30	30 - 40	40 - 50
N	3.60E-06	6.73E-07	2.76E-07	1.44E-07	9.13E-08	3.31E-08	8.79E-09	4.17E-09	2.58E-09	1.80E-09
NNE	5.59E-06	1.10E-06	4.91E-07	2.64E-07	1.70E-07	6.28E-08	1.71E-08	8.39E-09	5.31E-09	3.79E-09
NE	1.36E-05	2.57E-06	1.16E-06	6.57E-07	4.34E-07	1.70E-07	5.11E-08	2.56E-08	1.64E-08	1.19E-08
ENE	3.76E-05	7.03E-06	3.43E-06	2.03E-06	1.35E-06	5.32E-07	1.54E-07	7.48E-08	4.84E-08	3.55E-08
E	2.07E-05	3.80E-06	1.68E-06	9.53E-07	6.36E-07	2.58E-07	8.16E-08	4.13E-08	2.67E-08	1.95E-08
ESE	9.89E-06	1.92E-06	8.60E-07	4.77E-07	3.15E-07	1.26E-07	3.45E-08	1.51E-08	9.62E-09	6.93E-09
SE	1.06E-05	2.09E-06	9.49E-07	5.34E-07	3.54E-07	1.44E-07	3.61E-08	1.33E-08	8.49E-09	6.11E-09
SSE	8.31E-06	1.64E-06	7.19E-07	3.99E-07	2.66E-07	1.13E-07	2.91E-08	1.03E-08	6.54E-09	4.66E-09
S	7.63E-06	1.62E-06	7.81E-07	4.48E-07	3.05E-07	1.40E-07	3.81E-08	1.30E-08	8.21E-09	5.84E-09
SSW	7.97E-06	1.61E-06	7.32E-07	4.11E-07	2.71E-07	1.11E-07	2.85E-08	1.07E-08	6.76E-09	4.79E-09
SW	6.88E-06	1.38E-06	6.48E-07	3.67E-07	2.44E-07	1.05E-07	2.65E-08	8.76E-09	5.46E-09	3.83E-09
WSW	3.95E-06	7.50E-07	3.46E-07	2.02E-07	1.38E-07	6.43E-08	1.98E-08	7.32E-09	3.71E-09	2.02E-09
W	1.81E-06	3.37E-07	1.44E-07	7.90E-08	5.16E-08	2.10E-08	5.61E-09	2.25E-09	1.39E-09	9.61E-10
WNW	1.26E-06	2.31E-07	9.21E-08	4.80E-08	3.05E-08	1.12E-08	3.01E-09	1.41E-09	8.69E-10	6.00E-10
NW	1.68E-06	3.07E-07	1.21E-07	6.10E-08	3.84E-08	1.36E-08	3.46E-09	1.60E-09	9.76E-09	6.66E-10
NNW	2.38E-06	4.40E-07	1.84E-07	9.69E-08	6.05E-08	2.06E-08	4.99E-09	2.32E-09	1.42E-09	9.73E-09

TABLE 3-5

2013 SSES Annual Relative Concentrations - 2.26-Day Decay, Undepleted X/Q (sec/m³)

Miles										
Direction From	0 - 1	1 - 2	2 - 3	3 - 4	4 - 5	5 - 10	10 - 20	20 - 30	30 - 40	40 - 50
N	3.59E-06	6.70E-07	2.74E-07	1.42E-07	9.01E-08	3.23E-08	8.37E-09	3.84E-09	2.30E-09	1.55E-09
NNE	5.57E-06	1.10E-06	4.86E-07	2.60E-07	1.67E-07	6.07E-08	1.60E-08	7.49E-09	4.53E-09	3.08E-09
NE	1.36E-05	2.55E-06	1.15E-06	6.45E-07	4.24E-07	1.64E-07	4.72E-08	2.24E-08	1.36E-08	9.37E-09
ENE	3.75E-05	6.97E-06	3.38E-06	1.99E-06	1.32E-06	5.10E-07	1.42E-07	6.49E-08	3.97E-08	2.75E-08
E	2.07E-05	3.76E-06	1.66E-06	9.31E-07	6.18E-07	2.46E-07	7.39E-08	3.50E-08	2.12E-08	1.45E-08
ESE	9.86E-06	1.90E-06	8.45E-07	4.66E-07	3.06E-07	1.20E-07	3.12E-08	1.27E-08	7.57E-09	5.09E-09
SE	1.06E-05	2.07E-06	9.35E-07	5.23E-07	3.45E-07	1.38E-07	3.28E-08	1.14E-08	6.81E-09	4.61E-09
SSE	8.29E-06	1.62E-06	7.09E-07	3.92E-07	2.60E-07	1.09E-07	2.69E-08	9.02E-09	5.42E-09	3.66E-09
S	7.61E-06	1.61E-06	7.72E-07	4.41E-07	2.99E-07	1.35E-07	3.56E-08	1.16E-08	7.00E-09	4.76E-09
SSW	7.96E-06	1.60E-06	7.25E-07	4.05E-07	2.66E-07	1.08E-07	2.69E-08	9.74E-09	5.91E-09	4.03E-09
SW	6.87E-06	1.38E-06	6.43E-07	3.63E-07	2.41E-07	1.03E-07	2.53E-08	8.11E-09	4.90E-09	3.33E-09
WSW	3.94E-06	7.47E-07	3.43E-07	2.00E-07	1.36E-07	6.29E-08	1.89E-08	6.81E-09	3.36E-09	1.77E-09
W	1.80E-06	3.36E-07	1.43E-07	7.82E-08	5.10E-08	2.05E-08	5.35E-09	2.07E-09	1.24E-09	8.30E-10
WNW	1.26E-06	2.30E-07	9.15E-08	4.75E-08	3.02E-08	1.10E-08	2.89E-09	1.32E-09	7.87E-10	5.28E-10
NW	1.68E-06	3.06E-07	1.20E-07	6.06E-08	3.81E-08	1.34E-08	3.36E-09	1.53E-09	9.12E-10	6.10E-10
NNW	2.37E-06	4.39E-07	1.83E-07	9.62E-08	5.99E-08	2.03E-08	4.81E-09	2.18E-09	1.30E-09	8.70E-10

TABLE 3-6

2013 SSES Annual Relative Concentrations - 8-Day Decay, Depleted X/Q (sec/m3)

Miles										
Direction From	0 - 1	1 - 2	2 - 3	3 - 4	4 - 5	5 - 10	10 - 20	20 - 30	30 - 40	40 - 50
N	3.29E-06	5.71E-07	2.23E-07	1.11E-07	6.85E-08	2.31E-08	5.43E-09	2.25E-09	1.25E-09	7.92E-10
NNE	5.10E-06	9.34E-07	3.97E-07	2.04E-07	1.27E-07	4.36E-08	1.05E-08	4.49E-09	2.54E-09	1.64E-09
NE	1.25E-05	2.17E-06	9.41E-07	5.08E-07	3.24E-07	1.18E-07	3.13E-08	1.36E-08	7.81E-09	5.12E-09
ENE	3.43E-05	5.95E-06	2.77E-06	1.57E-06	1.01E-06	3.69E-07	9.43E-08	3.97E-08	2.29E-08	1.52E-08
E	1.89E-05	3.22E-06	1.36E-06	7.36E-07	4.75E-07	1.78E-07	4.97E-08	2.18E-08	1.25E-08	8.23E-09
ESE	9.03E-06	1.62E-06	6.94E-07	3.69E-07	2.35E-07	8.71E-08	2.10E-08	7.93E-09	4.50E-09	2.92E-09
SE	9.70E-06	1.77E-06	7.66E-07	4.13E-07	2.65E-07	9.99E-08	2.20E-08	7.03E-09	3.99E-09	2.59E-09
SSE	7.59E-06	1.38E-06	5.81E-07	3.08E-07	1.99E-07	7.85E-08	1.78E-08	5.49E-09	3.10E-09	2.00E-09
S	6.97E-06	1.37E-06	6.31E-07	3.47E-07	2.29E-07	9.73E-08	2.34E-08	6.94E-09	3.93E-09	2.53E-09
SSW	7.28E-06	1.36E-06	5.92E-07	3.18E-07	2.03E-07	7.74E-08	1.75E-08	5.76E-09	3.26E-09	2.10E-09
SW	6.29E-06	1.17E-06	5.24E-07	2.85E-07	1.83E-07	7.35E-08	1.64E-08	4.73E-09	2.65E-09	1.69E-09
WSW	3.61E-06	6.35E-07	2.80E-07	1.57E-07	1.03E-07	4.48E-08	1.22E-08	3.96E-09	1.81E-09	8.92E-10
W	1.65E-06	2.86E-07	1.17E-07	6.12E-08	3.87E-08	1.46E-08	3.46E-09	1.21E-09	6.71E-10	4.23E-10
WNW	1.15E-06	1.96E-07	7.46E-08	3.72E-08	2.29E-08	7.81E-09	1.86E-09	7.65E-10	4.23E-10	2.66E-10
NW	1.53E-06	2.60E-07	9.78E-08	4.74E-08	2.88E-08	9.47E-09	2.15E-09	8.74E-10	4.79E-10	2.99E-10
NNW	2.17E-06	3.73E-07	1.49E-07	7.52E-08	4.54E-08	1.44E-08	3.09E-09	1.26E-09	6.94E-10	4.33E-10

TABLE 3-7

2013 SSES Annual Relative Concentrations - D/Q (m⁻²)

Miles										
Direction From	0 - 1	1 - 2	2 - 3	3 - 4	4 - 5	5 - 10	10 - 20	20 - 30	30 - 40	40 - 50
N	2.50E-08	3.69E-09	1.51E-09	7.17E-10	4.24E-10	1.34E-10	3.21E-11	1.18E-11	6.32E-12	3.97E-12
NNE	2.44E-08	3.79E-09	1.64E-09	7.81E-10	4.60E-10	1.43E-10	3.34E-11	1.23E-11	6.56E-12	4.12E-12
NE	3.74E-08	5.65E-09	2.41E-09	1.17E-09	6.93E-10	2.23E-10	5.47E-11	2.01E-11	1.08E-11	6.76E-12
ENE	6.39E-08	9.93E-09	4.42E-09	2.16E-09	1.28E-09	4.04E-10	9.21E-11	3.23E-11	1.72E-11	1.08E-11
E	3.54E-08	5.18E-09	2.11E-09	1.01E-09	6.01E-10	1.98E-10	5.02E-11	1.85E-11	9.86E-12	6.19E-12
ESE	2.16E-08	3.27E-09	1.39E-09	6.73E-10	4.02E-10	1.33E-10	3.03E-11	9.78E-12	5.22E-12	3.28E-12
SE	2.90E-08	4.40E-09	1.92E-09	9.49E-10	5.70E-10	1.93E-10	4.01E-11	1.10E-11	5.85E-12	3.68E-12
SSE	2.94E-08	4.39E-09	1.87E-09	9.24E-10	5.63E-10	2.02E-10	4.42E-11	1.18E-11	6.27E-12	3.94E-12
S	3.16E-08	5.07E-09	2.38E-09	1.22E-09	7.62E-10	2.95E-10	6.88E-11	1.77E-11	9.42E-12	5.92E-12
SSW	3.87E-08	5.92E-09	2.66E-09	1.35E-09	8.14E-10	2.84E-10	6.31E-11	1.80E-11	9.61E-12	6.04E-12
SW	5.06E-08	8.03E-09	3.78E-09	1.96E-09	1.21E-09	4.54E-10	1.03E-10	2.61E-11	1.39E-11	8.76E-12
WSW	3.46E-08	5.34E-09	2.49E-09	1.33E-09	8.48E-10	3.50E-10	9.84E-11	2.84E-11	1.25E-11	6.11E-12
W	1.53E-08	2.29E-09	9.92E-10	4.95E-10	3.02E-10	1.08E-10	2.64E-11	8.26E-12	4.41E-12	2.77E-12
WNW	1.07E-08	1.54E-09	6.22E-10	2.97E-10	1.76E-10	5.72E-11	1.41E-11	5.20E-12	2.78E-12	1.74E-12
NW	1.79E-08	2.62E-09	1.05E-09	4.89E-10	2.89E-10	9.17E-11	2.20E-11	8.10E-12	4.32E-12	2.72E-12
NNW	2.17E-08	3.23E-09	1.36E-09	6.59E-10	3.86E-10	1.18E-10	2.65E-11	9.75E-12	5.20E-12	3.27E-12

TABLE 3-8

**2013 ATMOSPHERIC DISPERSION ESTIMATES
FOR RETDAS INPUT AT SELECTED LOCATIONS**

AFFECTED SECTOR	LOCATION	MILES	X/Q ⁽¹⁾	X/Q DEC ⁽²⁾	X/Q DEC+ DEP ⁽³⁾	DEPOSITION ⁽⁴⁾
11/SW	Maximum (X/Q) Site Boundary	0.61	1.01E-05	1.00E-05	9.08E-06	2.66E-08
9/S	Closest (X/Q) Site Boundary	0.38	5.46E-06	5.46E-06	5.09E-06	4.04E-08
12 / WSW	Maximum (X/Q) Residence	1.3	8.75E-06	8.68E-06	7.48E-06	1.27E-08
16 / NNW	Maximum (D/Q) Residence	0.6	6.34E-06	6.32E-06	5.72E-06	2.14E-08
7 / SE	Maximum (D/Q) Garden	0.6	1.27E-06	1.26E-06	1.14E-06	1.30E-08
12 / WSW	Maximum (D/Q) Dairy	1.7	5.90E-06	5.84E-06	4.94E-06	8.15E-09
12 / WSW	Maximum (D/Q) Meat Producer	1.7	5.90E-06	5.84E-06	4.94E-06	8.15E-09
3 / NE	Riverlands / EIC	0.7	4.21E-06	4.20E-06	3.76E-06	2.88E-08
12 / WSW	Tower's Club	0.5	3.75E-05	3.74E-05	3.43E-05	6.38E-08

NEAREST RESIDENCE WITHIN A 5-MILE RADIUS BY SECTOR

SECTOR NUMBER	AFFECTED SECTOR	NAME	MILES	X/Q	X/Q DEC	X/Q DEC +DEP	DEPOSITION
1	N	H. Burd	1.3	1.99E-06	1.97E-06	1.70E-06	6.34E-09
2	NNE	E. Ashbridge III	1	2.90E-06	2.89E-06	2.53E-06	1.19E-08
3	NE	W. Tuggle	0.9	2.92E-06	2.91E-06	2.56E-06	1.89E-08
4	ENE	R. Ditkosky/T. Davis	2.1	4.50E-07	4.47E-07	3.70E-07	3.23E-09
5	E	L. Kozlowski	1.4	3.75E-07	3.73E-07	3.19E-07	2.59E-09
6	ESE	R. Panetta	0.5	1.26E-06	1.25E-06	1.15E-06	1.07E-08
7	SE	J. Futoma	0.5	1.68E-06	1.68E-06	1.53E-06	1.79E-08
8	SSE	M. Naunczek	0.6	1.79E-06	1.79E-06	1.62E-06	1.58E-08
9	S	S. Slusser	1	1.25E-06	1.25E-06	1.09E-06	7.48E-09
10	SSW	S. Molnar	0.9	2.34E-06	2.33E-06	2.06E-06	9.01E-09
11	SW	F. Michael	1.5	2.57E-06	2.55E-06	2.17E-06	5.65E-09
12	WSW	F. Michael	1.3	8.75E-06	8.68E-06	7.48E-06	1.27E-08
13	W	F. Hummel	1.2	5.37E-06	5.32E-06	4.61E-06	7.65E-09
14	WNW	J. Confer	1.1	3.05E-06	3.03E-06	2.64E-06	5.57E-09
15	NW	C. McGraw, Jr.	0.8	5.26E-06	5.29E-06	4.68E-06	1.29E-08
16	NNW	G. John	0.6	6.34E-06	6.32E-06	5.72E-06	2.14E-08

NEAREST GARDEN WITHIN A 5-MILE RADIUS BY SECTOR

SECTOR NUMBER	AFFECTED SECTOR	NAME	MILES	X/Q	X/Q DEC	X/Q DEC +DEP	DEPOSITION
1	N	B. J. Wojcik	3.2	5.19E-07	5.12E-07	4.07E-07	1.46E-09
2	NNE	R. Chapin	2.3	8.32E-07	8.24E-07	6.78E-07	3.03E-09
3	NE	M. Welch	2.7	5.69E-07	5.64E-07	4.56E-07	3.25E-09
4	ENE	G. Dennis	2.4	3.68E-07	3.65E-07	2.99E-07	2.65E-09
5	E	W. Daily	1.8	2.49E-07	2.48E-07	2.08E-07	1.70E-09
6	ESE	B. Hoffman	3.1	6.07E-08	6.02E-08	4.78E-08	3.87E-10
7	SE	T. Scholl	0.6	1.27E-06	1.26E-06	1.14E-06	1.30E-08
8	SSE	H. Roinick	2.9	1.39E-07	1.38E-07	1.10E-07	9.89E-10
9	S	T. Sternich	2.7	2.37E-07	2.35E-07	1.90E-07	1.28E-09
10	SSW	S. Bodnar	1.3	1.53E-06	1.53E-06	1.32E-06	5.53E-09
11	SW	R. Broody	1.9	1.78E-06	1.76E-06	1.48E-06	3.81E-09
12	WSW	F. Michael	1.3	8.75E-06	8.68E-06	7.48E-06	1.27E-08
13	W	R. White	2.0	2.40E-06	2.37E-06	1.98E-06	3.12E-09
14	WNW	P. Moskaluk	1.3	2.38E-06	2.36E-06	2.03E-06	4.18E-09
15	NW	T. Dawson	0.9	4.45E-06	4.42E-06	3.90E-06	1.06E08
16	NNW	P. Culver	4	3.22E-07	3.15E-07	2.44E-07	7.10E-10

**TABLE 3-8
(Continued)**

**NEAREST ANIMAL RAISED FOR MEAT CONSUMPTION
WITHIN A 5-MILE RADIUS BY SECTOR**

SECTOR NUMBER	AFFECTED SECTOR	NAME	MILES	X/Q	X/Q DEC	X/Q DEC+DEP	DEPOSITION
2	NNE	R. Chapin	2.3	8.32E-07	8.24E-07	6.78E-07	3.03E-09
4	ENE	G. Dennis	2.4	3.68E-07	3.65E-07	2.99E-07	2.65E-09
5	E	J. Bloss	4.5	5.16E-08	5.09E-08	3.87E-08	3.02E-10
10	SSW	K. Davis	14	1.95E-08	1.83E-08	1.21E-08	3.86E-11
12	WSW	T. & M. Berger	1.7	5.90E-06	5.84E-06	4.94E-06	8.15E-09
15	NW	T. Dawson	0.9	4.45E-06	4.42E-06	3.90E-06	1.06E-08

ALL DAIRY LOCATIONS


SECTOR NUMBER	AFFECTED SECTOR	NAME	MILES	X/Q	X/Q DEC	X/Q DEC+DEP	DEPOSITION
5	E	W. Bloss	4.5	5.16E-08	5.09E-08	3.87E-08	3.02E-10
10	SSW	K. Davis	14	1.95E-08	1.83E-08	1.21E-08	3.86E-11
12	WSW	T. & M. Berger	1.7	5.90E-06	5.84E-06	4.94E-06	8.15E-09
13	W	J. & N. Dent	5	5.28E-07	5.10E-07	3.88E-07	4.77E-10

1	X/Q	RELATIVE CONCENTRATION (SEC/M ³)
2	X/Q DEC	DECAYED AND UNDEPLETED, HALF-LIFE 2.26 DAYS (SEC/M ³)
3	X/Q DEC+DEP	DECAYED AND DEPLETED, HALF-LIFE 8 DAYS (SEC/M ³)
4	DEPOSITION	RELATIVE DEPOSITION RATE (1/M ²)

FIGURE 3-1

2013 ANNUAL WIND ROSE 10M LEVEL – PRIMARY TOWER

Run Date: 1/21/2014 9:13:25 AM

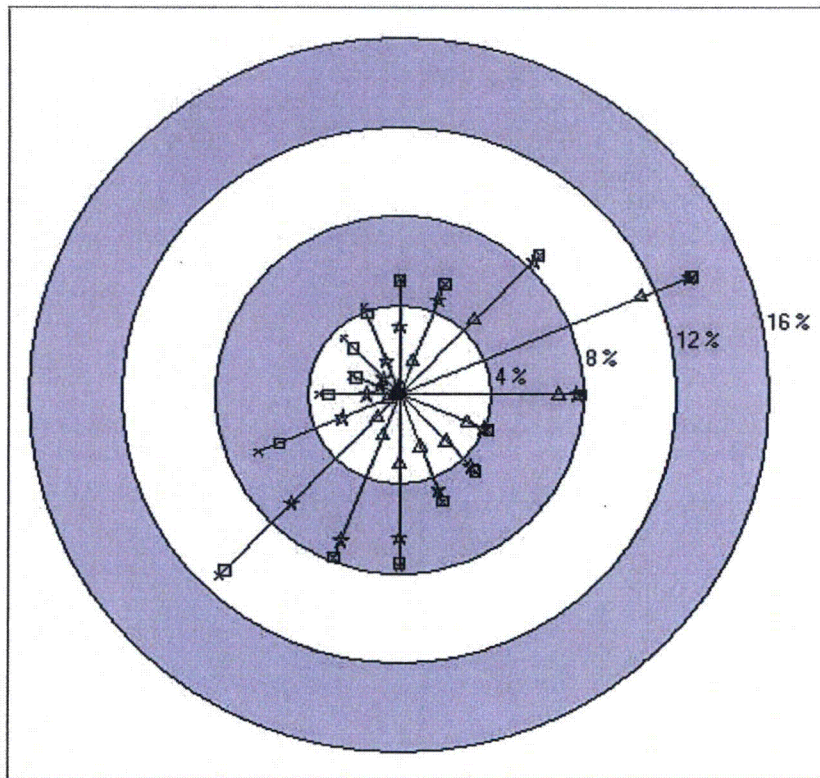

WIND ROSE

(WINDS FROM)
N



0.00% PERCENT CALMS
(NOT INCLUDED IN PLOT)

Start Date: 1/1/2013 00:00

End Date: 12/31/2013 23:00

Sensors Selected

10_SPD
10_WD

Legend


- △ WIND SPEED LESS THAN 3.5 MPH
- ☆ WIND SPEED LESS THAN 7.5 MPH
- WIND SPEED LESS THAN 12.5 MPH
- * WIND SPEED GREATER THAN 12.5 MPH

This wind rose displays the frequency of hourly average wind direction from a given sector. In 2013, the predominant wind direction occurred 13.7 % of the time from the ENE sector. The average wind speed was 5.2 mph and the average wind speed for the predominant sector (ENE) was 2.8 mph. The sector with the highest average wind speed was NW (9.4 mph).

FIGURE 3-2

2013 ANNUAL WIND ROSE 60M LEVEL – PRIMARY TOWER

Run Date: 1/21/2014 9:14:00 AM

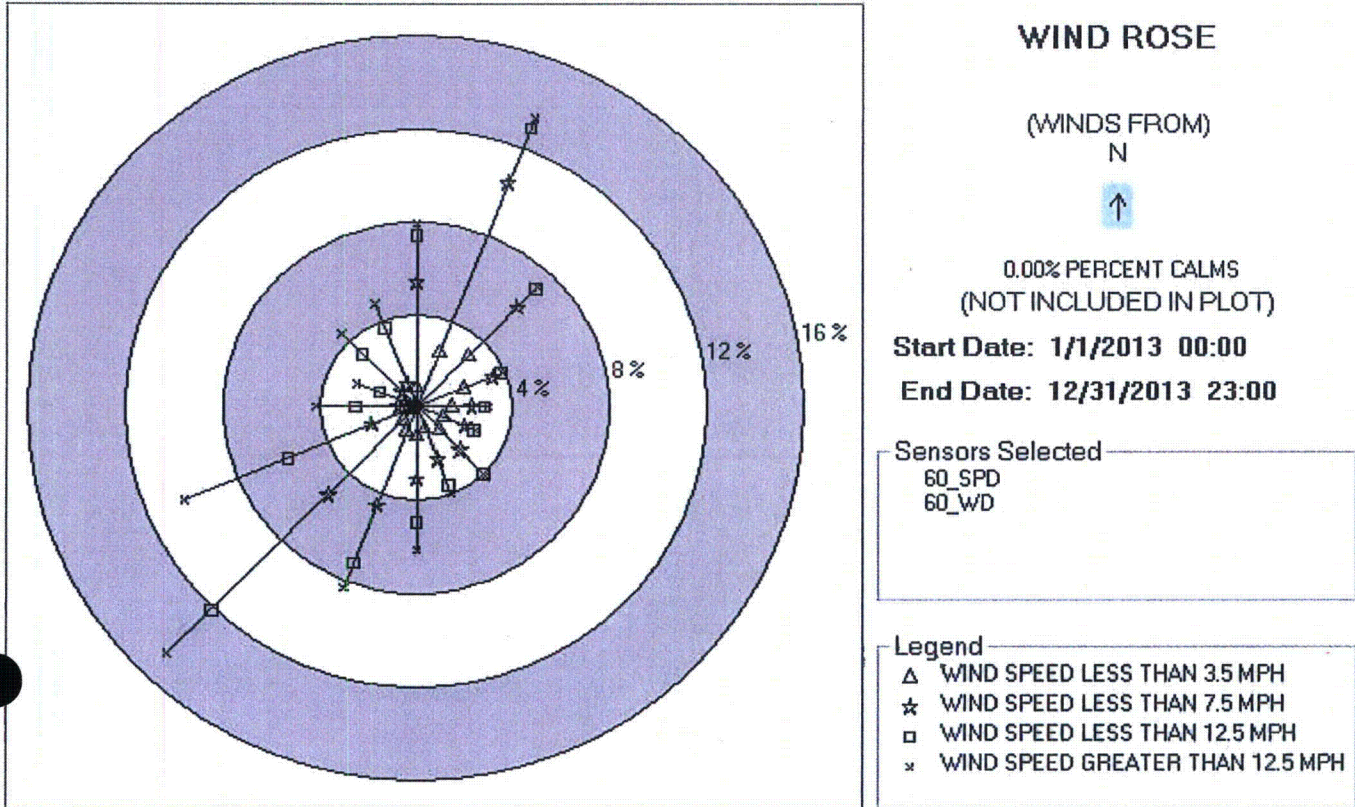


This wind rose displays the frequency of hourly average wind direction from a given sector. In 2013, the predominant wind direction occurred 14.5 % of the time from the SW sector. The average wind speed was 7.9 mph and the average wind speed for the predominant sector (SW) was 9.1 mph. The sector with the highest average wind speed was WSW (11.9 mph.).

FIGURE 3-3

PASQUIL STABILITY CLASS PREVALENCES DATA
Period: 2013

Joint Frequency Distributions at 10 Meters
Wind Speed and Direction 10M vs. Delta Temperature 60-10M
(Based on 8,760 Valid Hours)

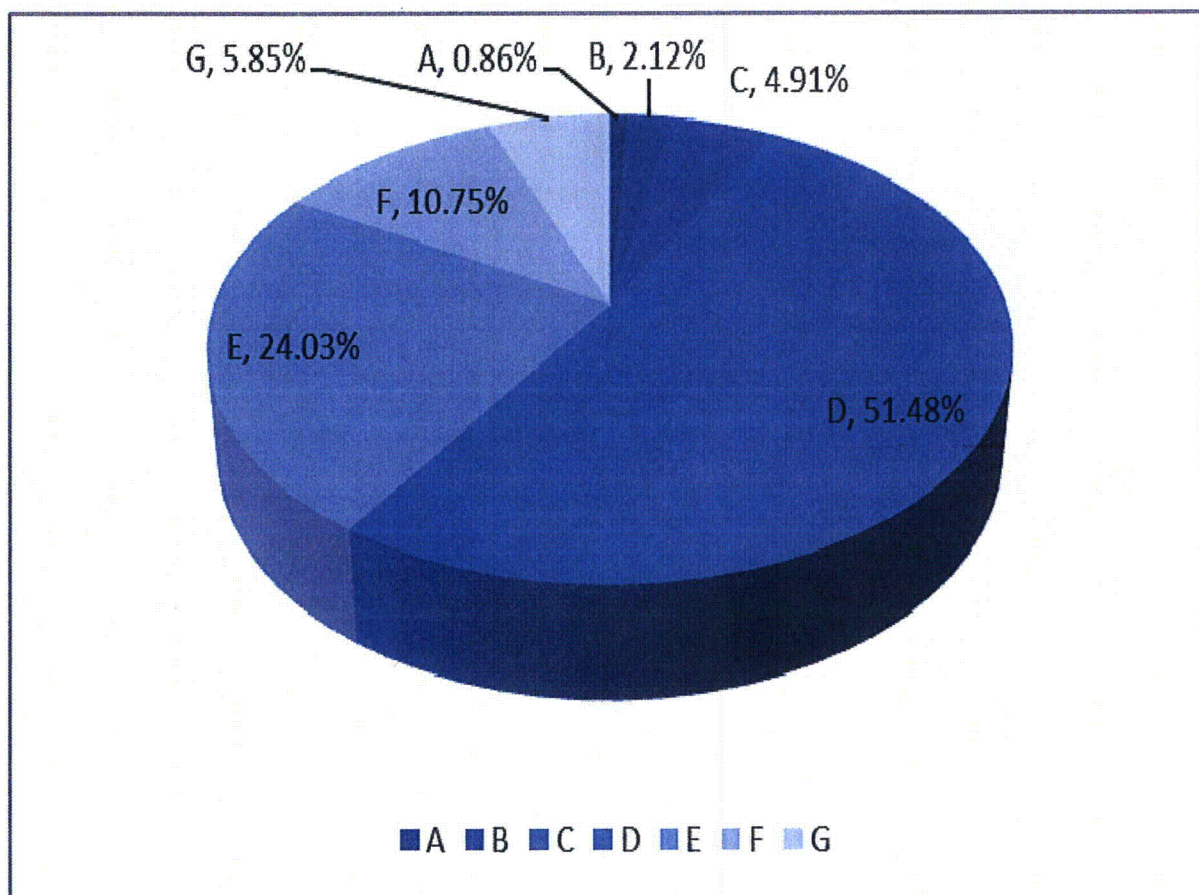

SECTION 4
DOSE MEASUREMENTS AND ASSESSMENTS

Radiological Impact on Man

Sampling and analysis of airborne and waterborne effluents were performed in accordance with the frequencies, types of analysis, and Lower Limit of Detection (LLD) outlined in the PPL Susquehanna, LLC Technical Requirements Manual.

Radioactive material was detected in some of the airborne and waterborne effluent samples analyzed. Dose calculations using measured and calculated effluent activity levels, meteorological data from the current reporting period and average river flow dilution factors resulted in estimated doses to individuals at levels below 10 CFR 20 and 10 CFR 50, Appendix I limits. Direct radiation resulting from plant operation (reported in the 2013 Annual Radiological Environmental Operating Report) contributed a maximum of 7.23E-1 mrem (measured at location 9S2 and based on an occupancy time by a member of the public of 20 hours per quarter) at the Protected Area Boundary south of the plant. Based on airborne effluent sample data, the maximum organ (including thyroid)/total body dose is 1.58E-2 mrem (CHILD, LUNG Table 4-4). The maximum organ/total body dose from all liquid effluent is 1.72E-2 mrem (ADULT, GILLI Table 4-2). Conservatively adding the maximum organ/total body dose from liquid and gaseous effluent and the maximum total body dose determined from direct radiation results in a dose of 7.56E-1 mrem, which is 3.0% of the 40CFR190 limit of 25 mrem to total body/organ (except thyroid) and 1.0% of the 40CFR190 limit of 75 mrem to the thyroid.

Doses to a maximally exposed member of the public from waterborne effluents are calculated for fish ingestion and shoreline exposure at the plant outfall, and drinking water ingestion at Danville, PA. Site specific parameters used in the calculations for the Danville receiver, specific for actual average blowdown and river level for the entire year are shown in Table 4-1.

TABLE 4-1
SITE-SPECIFIC PARAMETERS USED FOR RETDAS CALCULATIONS
(DANVILLE RECEIVER)
FOR 2013

PARAMETER	ENTIRE YEAR
Cooling Tower Blowdown (CFS)	26.2
Average Net River Level (ft.)	7.8
Dilution Factor at Danville ⁽¹⁾	757
Transit time to Danville (hr.) ⁽¹⁾	17.9

⁽¹⁾From ODCM-QA-005, Att. E

Summaries of maximum individual doses resulting from airborne and waterborne radioactive effluent releases from each unit are given in Table 4-2. Meteorological data from Section 3 were used to calculate the dose from airborne effluents.

The Radioactive Effluent Release Report includes an assessment of the radiation dose from radioactive effluents to members of the public within the site boundary. Within the Site Boundary there are several areas frequented by members of the public. There are no significant exposure pathways from waterborne effluents in these areas. Doses from airborne effluent are calculated for members of the public for the following locations: Riverlands Energy Information Center, the Towers Club, and residence with the maximum X/Q value; the garden, dairy and meat producing farm with the maximum D/Q value; and the site boundary with the maximum X/Q value. Summaries of the calculated maximum doses within the site boundary and selected locations beyond the site boundary resulting from airborne effluents are presented in Table 4-4. The above referenced locations are shown on Figure 4-1.

In the area comprising the Riverlands recreation area, which surrounds the Energy Information Center, three pathways of radiation exposure can be identified: plume, ground, and inhalation. There are no significant exposure pathways from waterborne effluents in this area. There are approximately 100,000 visitors to the Riverlands/Energy Information Center complex each year. For dose calculations, it is assumed the visitor stays in the area for one hour. The calculated dose rate and collective dose for visitors to the Riverlands/Energy Information Center during 2013 are shown on Table 4-3.

Use of the RETDAS code yields calculated doses for the Riverlands area for the report period. These doses assume an occupancy factor of 100% for a member of the public during 2013. These calculated dose values are shown on Table 4-4.

In Regulatory Guide 1.21, Revision 2, "Measuring, Evaluating, and Reporting Radioactive Material in Liquid and Gaseous Effluents and Solid Waste", the NRC has recommended that U.S. nuclear power plants evaluate whether Carbon-14 (C-14) is a "principal radionuclide", and if so, report the amount of C-14 released. Radioactive effluent releases of C-14 have not increased but the decline in releases of other radionuclides has resulted in C-14 possibly becoming more prominent, specifically in airborne effluents. This regulatory guidance has led to an industry initiative to evaluate and report C-14 in the Annual Radioactive Effluent Release Report.

Information for C-14 dose impact is included as supplemental information in this report. Reportable values for dose impact do not include C-14 contribution. C-14, with a half-life of 5730 years, is a naturally occurring isotope of carbon produced by cosmic ray interactions in the atmosphere. Nuclear weapons testing in the 1950s and 1960s significantly increased the amount of C-14 in the atmosphere. C-14 is also produced in commercial nuclear reactors, but the amounts produced are much less than those produced naturally or from weapons testing.

In December 2010 the Electric Power Research Institute (EPRI) published Report 1021106, "Estimation of Carbon-14 in Nuclear Power Plant Gaseous Effluents", which provides conservative technical guidance to support the calculation of C-14 released in radioactive effluents. In a BWR the majority of C-14 is generated in the reactor core by neutron activation of reactor coolant, specifically $^{17}\text{O}(n,\alpha)^{14}\text{C}$. Thus C-14 generation is directly proportional to reactor power. As documented in the EPRI report (for a BWR), approximately 99% of the C-14 produced in the reactor core is discharged as gaseous effluent (primarily as CO_2) through the offgas system. The remaining 1% is released in the form of solid radwaste. There is minimal (<1%) C-14 released in the liquid effluent pathway.

In October of 2012 PPL Susquehanna, in conjunction with an offsite lab, performed sampling and analysis for airborne effluent C-14 released from the station via each units offgas system.

Since both Susquehanna units are essentially identical in reactor design, a single value for the C-14 release rate (in the CO_2 form from the offgas system sample results) is used in the calculation of C-14 released from each unit. The release rate value is corrected to 100% power then scaled to the fraction of full power year for each unit. The fraction of a full power year is calculated as the Effective Full Power Days for the year in question divided by 365 to get the fraction of effective vs full year operation.

Based on the above outlined methodology, approximately 42 Curies of C-14 were released in gaseous effluents in 2013.

The airborne effluent pathway with the highest offsite dose potential (for C-14 releases) is the vegetation ingestion pathway. The maximum expected annual dose from C-14 released from Susquehanna Unit-1 ($3.39\text{E-}1$ mrem) and Unit-2 ($3.13\text{E-}1$ mrem) has been calculated based on methodology in Regulatory Guide 1.109 and includes site specific parameters (e.g., nearest garden with highest X/Q value, producing both broad leaf and non-broad leaf vegetation). The maximum organ dose from airborne effluent C-14 released from the Susquehanna station in 2013 is well below the 10CFR50, Appendix I, ALARA design objective (i.e., 15 mrem/yr per unit). The annual dose to the maximally exposed individual from all gaseous releases of C-14 (calculated by the above referenced methodology) is $6.52\text{E-}1$ mrem to the critical organ (bone) and $1.30\text{E-}1$ mrem to the total body.

Conservatively adding the maximum dose (calculated based on liquid and gaseous effluent sample results combined with direct radiation results) referenced on page 4-2 to the maximum dose due to the calculated release of C-14 ($6.52\text{E-}1$ mrem, CHILD, BONE) bounds the dose that any member of the public receives from station operations to 1.41 mrem, which is 6% of the 40CFR190 limit of 25 mrem to total body/organ (except thyroid) and 2% of the 40CFR190 limit of 75 mrem to the thyroid.

TABLE 4-2

SUMMARY OF MAXIMUM INDIVIDUAL DOSES
TO MEMBERS OF THE PUBLIC ⁽⁴⁾
DATA PERIOD: 1/1/13 TO 12/31/13

UNIT	EFFLUENT	AGE GROUP	APPLICABLE ORGAN	ESTIMATED MAXIMUM DOSE (MREM/MRAD)	LOCATION		PERCENT OF LIMIT	LIMIT (MREM/MRAD) ⁽²⁾
					DIST (MILES)	AFFECTED SECTOR		
1	Liquid ⁽¹⁾	Teen	Total Body	2.74E-03	(3)		0.10	3
1	Liquid ⁽¹⁾	Adult	GILLI	8.60E-03	(3)		0.10	10
1	Noble Gas	N/A	Air Dose (Gamma-MRAD)	0	0.5	WSW	0	10
1	Noble Gas	N/A	Air Dose (Beta-MRAD)	0	0.5	WSW	0	20
1	Airborne Iodine, Tritium and Particulates	Child	Lung	4.06E-03	0.5	WSW	0.03	15
2	Liquid ⁽¹⁾	Teen	Total Body	2.74E-03	(3)		0.10	3
2	Liquid ⁽¹⁾	Adult	GILLI	8.60E-03	(3)		0.10	10
2	Noble Gas	N/A	Air Dose (Gamma-MRAD)	7.47E-02	0.5	WSW	0.75	10
2	Noble Gas	N/A	Air Dose (Beta-MRAD)	3.94E-02	0.5	WSW	0.20	20
2	Airborne Iodine, Tritium and Particulates	Child	Lung	1.19E-02	0.5	WSW	0.08	15

⁽¹⁾Estimated dose is based on a site total activity release equally divided between Unit 1 and Unit 2.

⁽²⁾10 CFR 50, Appendix I limits are in terms of mrad or mrem/reactor-year for airborne and waterborne effluent from each unit.

⁽³⁾Doses from liquid effluent are estimated from fish ingestion and shoreline exposure at the site outfall and from the drinking water pathway at Danville, PA.

⁽⁴⁾Dose due to calculated release of C-14 not included.

TABLE 4-3

**CALCULATED COLLECTIVE DOSES TO MEMBERS OF THE PUBLIC WITHIN THE
RIVERLANDS/ENERGY INFORMATION CENTER COMPLEX
DATA PERIOD: 1/1/13 TO 12/31/13**

EFFLUENT	AGE GROUP	APPLICABLE ORGAN	DOSE RATE⁽¹⁾ (MREM/HR)	COLLECTIVE DOSE⁽²⁾ (PERSON-REM)
Noble Gas	N/A	Total Body	9.59E-07	9.59E-05
Noble Gas	N/A	Skin	5.05E-07	5.05E-05
Iodine, Tritium and Particulates ⁽³⁾	Child	GI-LLI	4.05E-07	4.05E-05

⁽¹⁾Estimated dose and dose rate is based on annual site total activity release.

⁽²⁾Collective dose is based on 100,000 person-hours.

⁽³⁾Dose due to calculated release of C-14 not included.

TABLE 4-4


SUMMARY OF MAXIMUM INDIVIDUAL DOSES FROM AIRBORNE EFFLUENT

LOCATION	PATHWAY	MAXIMUM TOTAL BODY DOSE (MREM)		MAXIMUM ORGAN DOSE (MREM)		MAXIMUM THYROID DOSE (MREM)	
1. Maximum site boundary X/Q	Total (All)	4.83E-03	(CHILD)	4.96E-03	(CHILD, GI-LLI)	4.69E-03	(CHILD)
2. Maximum D/Q Garden	Total (All)	1.37E-03	(CHILD)	1.43E-03	(CHILD,GI-LLI)	1.30E-03	(CHILD)
3. Maximum D/Q Dairy + Maximum D/Q Meat	Total (All)	2.24E-03	(CHILD)	2.35E-03	(CHILD, LUNG)	2.19E-03	(CHILD)
4. Tower's Club	Total (All)	1.52E-02	(CHILD)	1.58E-02	(CHILD, LUNG)	1.48E-02	(CHILD)
5. Riverland/EIC	Total (All)	3.42E-03	(CHILD)	3.55E-03	(CHILD, LUNG)	3.26E-03	(CHILD)
6. Maximum X/Q Residence	Total (All)	3.37E-03	(CHILD)	3.52E-03	(CHILD, LUNG)	3.30E-03	(CHILD)

Note: The doses shown above are based on 100% occupancy at the indicated locations. They are based on a composite of all pathways resulting in a total dose to the maximally exposed individual due to airborne effluents from both Unit-1 and Unit-2 operations. Dose due to calculated release of C-14 not included.

FIGURE 4-1

AIRBORNE-DOSE CALCULATION LOCATIONS

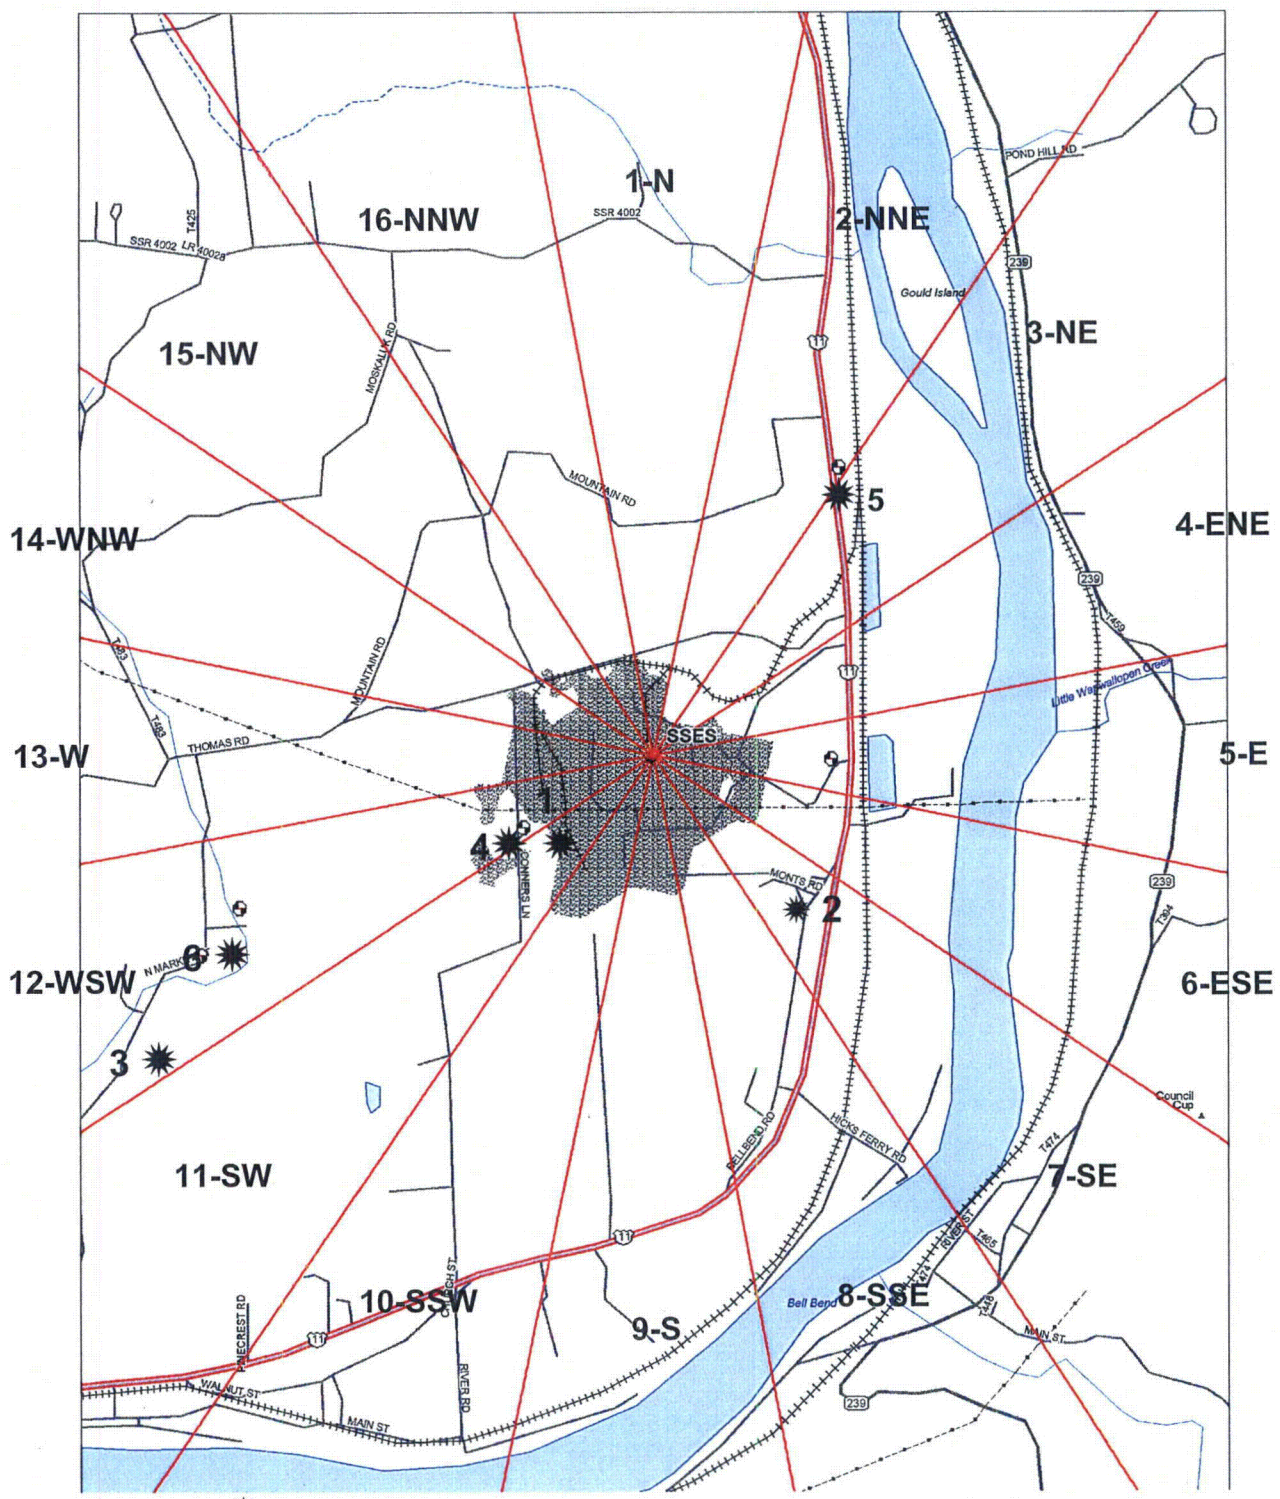

★ Indicates airborne-dose calculation location per Table 4-4

SECTION 5

***CHANGES TO THE OFFSITE DOSE CALCULATION MANUAL (ODCM),
TECHNICAL REQUIREMENTS MANUAL (TRM)
AND THE SOLID RADIOACTIVE WASTE PROCESS CONTROL PROGRAM***

CHANGES TO THE OFFSITE DOSE CALCULATION MANUAL

The PPL Susquehanna, LLC ODCM consists of nine (9) individual procedures.

ODCM-QA-002, ODCM Review and Revision Control, was revised in 2013. Revision 5 was issued December 9, 2013. The revision: 1) Updated various position titles; 2) Deleted extraneous verbiage and guidance which was not needed or required and 3) Included miscellaneous typographical corrections.

ODCM-QA-008, Radiological Environmental Monitoring Program, was revised in 2013. Revision 16 was issued October 31, 2013. The revision: 1) Deleted dairy farm location 10D3 (C. K. Drasher Farm) due to the owner was no longer in the dairy farm business; 2) Added Food Product locations 8C1 (Pumpkin Hill Farm), 10B5 (S. Bodnar Garden) and 15G1 (Dancing Hen Farm) to support broadleaf vegetation sampling in response to the loss of dairy farm location 10D3; 3) Clarified guidance for when milk samples are not available; 4) Updated REMP sample maps to correspond with the above referenced changes; 5) Updated procedure to include guidance that it is not always feasible to obtain samples from the most desirable locations for a particular pathway or media and that appropriate substitutions should be selected and added to the REMP sampling program within 30 days and 6) Added Reference to NUREG 1302, Offsite Dose Calculation Manual Guidance: "Standard Radiological Effluent Controls for Boiling Water Reactors," April 1991, to support item 5 above.

CHANGES TO THE TECHNICAL REQUIREMENTS MANUAL

Section 3.11 and 3.6.1 of the Unit-1 and Unit-2 Technical Requirements Manual (TRM) by reference are part of the ODCM. The following limits and requirements are contained in Section 3.11: liquid and gaseous effluent dose limits, liquid and gaseous effluent treatment system operability criteria (based on effluent dose), liquid and gaseous effluent treatment system operability criteria and the conduct of the Radiological Environmental Monitoring Program. Section 3.6.1 contains requirements for venting or purging of primary containment.

Sections 3.11.2.5 and B3.11.2.5 of the Unit 1 and Unit 2 TRM were revised on June 18, 2013. The revision added surveillance requirement TRS 3.11.2.5.3 to perform required HVAC filter testing in accordance with the Filter Testing Program. The changes to B3.11.2.5 include the types of testing performed and which filters are tested.

Section B3.11.4.1 of the Unit-1 and Unit-2 TRM was revised on May 29, 2013. The revision deleted reference to the "TLD" type dosimeter. The TLD type dosimeter used at Susquehanna for the Radiological Environmental Monitoring Program (REMP) was replaced with an "Optically Stimulated Luminescence" (OSL) type dosimeter. The proposed change removes any reference and discussion associated with a specific type of dosimeter used in the REMP.

PROCESS CONTROL PROGRAM CHANGES

The following changes were made to the Process Control Program and implementing procedures during 2013. None of the changes reduce the overall conformance of the solidified waste product to existing criteria for solid wastes. All changes were reviewed and approved by PORC (as necessary) as documented on the attached summary of procedure changes. The following procedures were changed:

NDAP-QA-0646	SOLID RADIOACTIVE WASTE PROCESS CONTROL PROGRAM
WM-RP-230	RECEIPT, USE, STORAGE AND SHIPMENT OF CHEM NUCLEAR HIGH INTEGRITY CONTAINERS
CH-TP-055	SOLID RADWASTE 10CFR61 CORRELATION FACTOR DETERMINATION – SAMPLE PREPARATION AND COLLECTION
WM-PS-155	10CFR61 SAMPLE SHIPPING AND CORRELATION FACTOR DETERMINATION
WM-PS-160	RAD WASTE CURIE CALCULATIONS
WM-RP-012	HANDLING AND USE OF STEEL LINERS AND HIGH INTEGRITY CONTAINERS

NDAP-QA-0646 continues to fully implement the requirements and intent of the following:

1. Section 11.4 and 13.5 of the FSAR
2. Section 3.7.4 of the Technical Requirements Manual
3. 10 CFR 20, 10 CFR 61, 10 CFR 71, 49 CFR 100-177, and 40 CFR 261

Compliance with all applicable regulatory requirements listed above continues to be met as the result of these changes to the program. These changes to the Process Control Program will not reduce the overall conformance of the solidified waste product to existing criteria for solid wastes.

PROCEDURE REVISION SUMMARIES

NDAP-QA-0646 SOLID RADIOACTIVE WASTE PROCESS CONTROL PROGRAM

1. Corrected procedure reference in Step 6.7.3 from Attachment E to Attachment D.
This is a resolution for CRA 1669160.

WM-RP-230 RECEIPT, USE, STORAGE AND SHIPMENT OF CHEM NUCLEAR HIGH INTEGRITY CONTAINERS

This procedure was cancelled.

CH-TP-055 SOLID RADWASTE 10CFR61 CORRELATION FACTOR DETERMINATION – SAMPLE PREPARATION AND COLLECTION

- 1) Corrected typo in title per CR 1715426.
- 2) Removed step 5.1.2.h.
- 3) Clarified step 5.1.3.
- 4) Split step 5.1.7 into two steps.

WM-PS-155 10CFR61 SAMPLE SHIPPING AND CORRELATION FACTOR DETERMINATION

1. The following corrections are resolutions for CRA 1669160:
Corrected procedure reference in step 6.1.1 from section 3.5.1 to 3.6.1.
Corrected procedure reference in step 6.1.2 from section 3.5.2 to 3.6.2.
Corrected procedure reference in step 6.9.4 from Pa-241 to Pu-241.

WM-PS-160 RAD WASTE CURIE CALCULATIONS

1. Corrected procedure reference in step 1.3 from WM-RP-250 to WM-PS-250.
This is a resolution for CRA 1669160.
2. Added Procedure Revision Summary page.

WM-RP-012 HANDLING AND USE OF STEEL LINERS AND HIGH INTEGRITY CONTAINERS

1. Added Reference, CRA 1679370. Clarifies that the use of containers/liners for Class a Waste, including reusable liners are non-Quality and can be purchased as such.
2. High Integrity Containers and Class B and C waste containers will continue to be classified as Quality.
3. Revise checklist for Steel Liner Inspection (Attachment B), does not require a Quality Control (QA) sign off.

SECTION 6

**MISCELLANEOUS TECHNICAL REQUIREMENTS MANUAL (TRM),
FSAR, 40CFR190 AND NEI GROUNDWATER PROTECTION INITIATIVE
REPORTING**

1. TRM Action 3.11.1.4.F.2 required the reporting of Liquid Radwaste Effluent Monitoring Instrumentation inoperability not corrected in a timely manner.

The Liquid Radwaste Discharge Radiation Monitor was declared inoperable at 0112 on 6/12/13 (requiring entry into TRO 3.11.1.4 Condition B) due to high detector background and problems with the sample pump tripping on flow. Multiple attempts were made to return the monitor to service but problems were discovered with the sample pump, discharge valve and the sample flow switch. Replacement parts were ordered to make the needed repairs. TRO 3.11.1.4 Condition F was entered at 0113 on 7/13/13 due to exceeding the 30 day return to service requirement of TRO 3.11.1.4 Condition B. The Liquid Radwaste Discharge Radiation Monitor was repaired and declared operable at 1355 on 7/15/13.

2. TRM Action 3.11.1.5.C.1 requires the reporting of Radioactive Liquid Process Effluent Monitoring Instrumentation inoperability not corrected in a timely manner, or if required sampling/analysis was not performed during the inoperable period.

On 5/10/13 at 0330 the Unit-2 Service Water Radiation Monitor was declared inoperable and TRO 3.11.1.5 Condition B was entered. Additionally, TRO 3.11.1.5 was in affect for the Unit-2A and B RHR Service Water Radiation Monitors. TRO 3.11.1.5 Required Action B.1.2 requires sampling and analysis once every 8 hours when the associated pathway is in-service. Per TRO 3.11.1.5 Required Action B.1.2, a Unit-2 Service Water sample was due on 5/13/13 at 0530. Due to miscommunication between Chemistry and Operations, the Unit-2 Service Water sample which was required on 5/13/13 at 0530 was not obtained/analyzed until 0830 on 5/13/13.

3. TRM Action 3.11.2.6.K requires an explanation for Radioactive Gaseous Effluent Monitoring Instrumentation required actions and completion times not met.

None to report for 2013.

4. TRM Action 3.11.4.1.F.2 requires reporting the cause of the unavailability of milk or fresh leafy vegetable samples and identify the new locations for obtaining replacements.

On 6/3/13 a milk sample was unavailable from the Drasher Farm (location 10D3, 3.5 miles SSW) due to owners had discontinued dairy farming. Location 10D3 was one of the three indicator milk sampling locations required by TRM Table 3.11.4.1-1. No alternate milk sampling indicator locations remain (who would participate in the REMP) within a 5 mile radius of the station. In response to the loss of milk sampling location 10D3, broadleaf

vegetation sampling was initiated (within 30 days of loss of milk sample location) at indicator locations, Pumpkin Hill Farm (8C1, 2.9 miles SSE) and control location, Dancing Hen Farm (15G1, 11.4 miles NW). Additionally, broadleaf sampling was initiated at indicator location Steve Bodnar Garden (10B5, 1.3 miles SSW) in August 2013.

5. TRM Action 3.11.4.2.A requires reporting when land use census identifies a new location which yields a calculated dose or dose commitment greater than the values currently being calculated in Requirement 3.11.2.3 (Gaseous Effluent Dose due to Iodine, Tritium, and Radionuclides in Particulate Form).

None to report for 2013.

6. TRM Action 3.11.4.2.B requires reporting when land use census identifies locations that yield a calculated dose or dose commitment (via the same exposure pathway) 20 percent greater than at a location from which samples are currently being obtained in accordance with Requirement 3.11.4.1 (Radiological Environmental Monitoring Program).

None to report for 2013.

7. The limits outlined in 40CFR190.10 (Environmental Standards for the Uranium Fuel Cycle-Standards for Normal Operations) were not exceeded by station operations during 2013. Refer to Section 2 and Section 4 for specific values.

8. FSAR Section 11.6.11 requires the reporting of airborne radioactivity detected in the Low Level Radwaste Holding Facility.

Only naturally occurring airborne radioactivity was detected above analysis MDC's in air samples from the Low Level Radwaste Holding Facility during 2013.

9. The PPL Susquehanna station has implemented an Action Plan in response to the NEI Initiative on Groundwater Protection. Part of the Action Plan includes the assessment of the current groundwater monitoring program. Groundwater is sampled and analyzed quarterly as part of the Radiological Environmental Monitoring Program (REMP). REMP groundwater sampling locations are defined in ODCM-QA-008 Attachment G. In August 2006, additional groundwater sampling was initiated at locations which are not listed in the ODCM. The additional locations are three manholes which collect water from a perimeter drain system. The perimeter drain system consists of perforated piping installed just above the footing along the exterior base of the vertical walls of the reactor, turbine and radwaste buildings. Outlined in Table 6-1 are the tritium analysis results from sampling of the perimeter drain system. No nuclear by-product gamma emitting radionuclides were identified

above analysis MDC's for the perimeter drain samples in 2013. The tritium results reported in Table 6-1 did not exceed any Reporting Level thresholds in the PPL Susquehanna Technical Requirements Manual or any reporting criteria established in response to the NEI Groundwater Protection Initiative. Figure 6-1 is a trend graph of airborne and waterborne effluent tritium releases from the PPL Susquehanna Station starting in 1982.

TABLE 6-1


NEI Ground Water Protection Initiative Reporting

Perimeter Drain Sampling Results: 2013

<u>Manhole FD-1</u> (7S9 - E of U2 CST)		<u>Manhole FD-2</u> (16S3- NW corner of RW Bldg.)		<u>Manhole FD-3</u> (9S3 - I/S RCA @ U2 HP Cont. Pt. Closet)	
<u>Date</u>	<u>Tritium (pCi/liter)</u>	<u>Tritium (pCi/liter)</u>	<u>Tritium (pCi/liter)</u>	<u>Tritium (pCi/liter)</u>	<u>Tritium (pCi/liter)</u>
02/14/2013	236	249	249	184	184
05/20/2013	213	183	183	191	191
08/19/2013	218	153	153	<MDC	<MDC
11/18/2013	203	248	248	179	179

<MDC = Less than Minimum Detectable Concentration

Figure 6-1

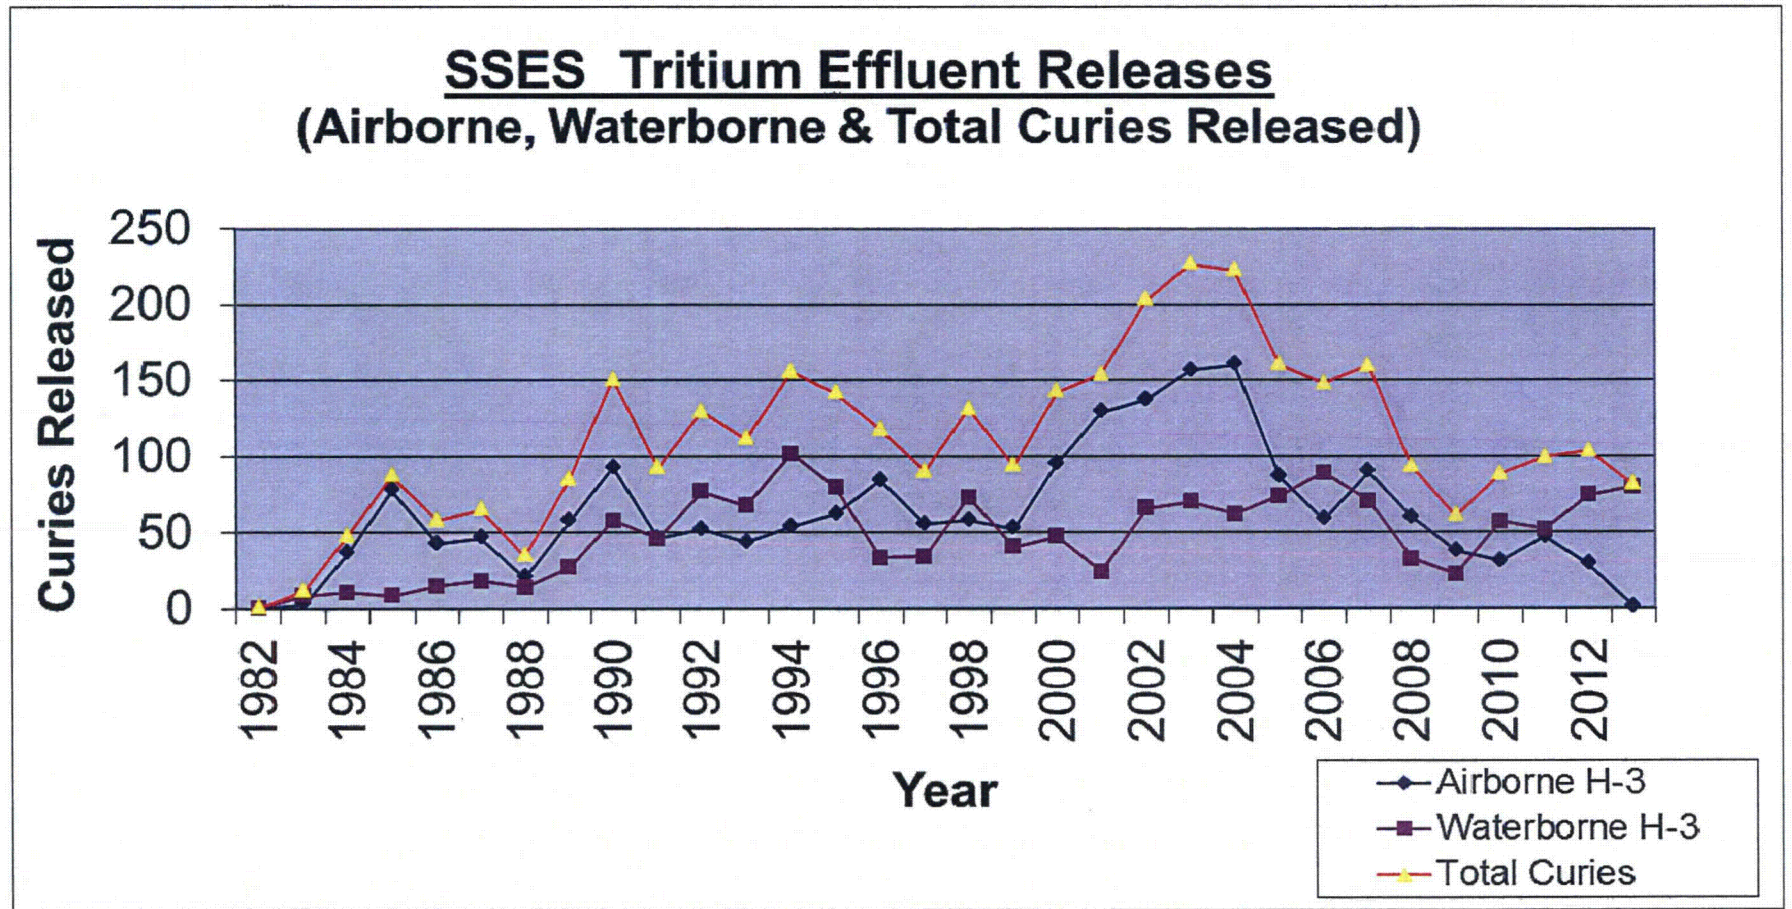

SECTION 7

**CORRECTIONS TO PREVIOUS
RADIOACTIVE EFFLUENT RELEASE REPORTS**

**CORRECTIONS TO PREVIOUS
RADIOACTIVE EFFLUENT RELEASE REPORTS**

No corrections to previous Radioactive Effluent Release Reports are submitted for this report period.

SECTION 8

***EFFLUENT FROM SYSTEMS CLASSIFIED AS
INSIGNIFICANT EFFLUENT PATHWAYS***

EFFLUENT FROM SYSTEMS CLASSIFIED AS INSIGNIFICANT EFFLUENT PATHWAYS

Insignificant Effluent Pathways are: 1) evaporation from the Unit 1 and Unit 2 Condensate Storage Tanks (CST's); 2) evaporation from the common Refueling Water Storage Tank (RWST); 3) gaseous effluent from the Hydrogen Seal Oil, Main Turbine and RFPT lubrication oil mist eliminators which vent to the turbine building roofs.

These pathways are not continuously monitored. The CSTs and RWST are sampled monthly to determine the concentration of radionuclides present in these tanks. Tritium analysis on these samples is performed quarterly. Airborne release to the environment from the tanks is estimated based on conservative estimates of the evaporation rates from each of the tanks using a modified method established within Chapter 7 of EPA AP-42. A conservative carry-over fraction of radionuclides from the water to the evaporated liquid is then assumed. Airborne release to the environment from the demisters assumes the average moisture (condensate) concentration of the lubrication oil as measured via sampling during 2013. The calculation also assumes immediate removal of 100% of the water by the oil mist eliminators as it passes through the turbines.

The annual release of tritium, iodines and particulates with half-lives greater than 8 days was calculated based on the conservative assumptions outlined above. The calculated releases are shown in Table 8-1. All nuclides, except for tritium, released from insignificant effluent pathways are negligible compared to the airborne release data shown in Tables 2-1 and 2-2. The maximum dose to the public from a release of 0.97 Ci of tritium is calculated to be $8.05E-3$ mrem (child). This is a fraction of the maximum dose from airborne effluent reported in Section 4.

TABLE 8-1**ANNUAL RELEASE FROM SYSTEMS CLASSIFIED AS
INSIGNIFICANT EFFLUENT PATHWAYS**

<u>Nuclide</u>	<u>RWST</u> (Ci)	U1-CST and Main Turbine/RFPT <u>Lube Oil Systems</u> (Ci)	U2-CST and Main Turbine/RFPT <u>Lube Oil Systems</u> (Ci)	<u>Total</u> (Ci)
H-3	3.23E-02	4.77E-01	4.62E-01	9.71E-01
Cr-51	7.01E-10	0.00E+00	0.00E+00	7.01E-10
Mn-54	1.27E-09	8.07E-08	3.92E-07	4.74E-07
Co-60	3.34E-08	3.13E-07	4.05E-07	7.52E-07
Co-58	1.28E-09	6.62E-08	3.57E-07	4.24E-07
Zn-65	0.00E+00	1.14E-08	1.29E-08	2.43E-08
Xe-135	0.00E+00	4.20E-07	0.00E+00	4.20E-07