

VIRGINIA ELECTRIC AND POWER COMPANY  
RICHMOND, VIRGINIA 23261

April 10, 2015

United States Nuclear Regulatory Commission  
Attention: Document Control Desk  
Washington, D. C. 20555


Serial No. 15-177  
NAPS/JHL  
Docket Nos. 50-338/339  
72-16  
72-56  
License Nos. NPF-4/7  
SNM-2507

**VIRGINIA ELECTRIC AND POWER COMPANY (DOMINION)**  
**NORTH ANNA POWER STATION UNIT NOS. 1 AND 2**  
**INDEPENDENT SPENT FUEL STORAGE INSTALLATION (ISFSI)**  
**ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT**

In accordance with North Anna Units 1 and 2 Technical Specification 5.6.2 and the North Anna Independent Spent Fuel Storage Installation Technical Specification 5.5.2, enclosed is the 2014 Annual Radiological Environmental Operating Report. The Radiological Environmental Operating Report provides the details associated with the Radiological Environmental Monitoring Program.

If you have any questions or require additional information, please contact Page Kemp at (540) 894-2295.

Very truly yours,



Gerald T. Bischof  
Site Vice President

Enclosure

Commitments made in this letter: None

NMSS26  
NMSS

Serial No. 15-177  
NAPS Annual Radiological  
Environmental Operating Report

cc: U. S. Nuclear Regulatory Commission  
Region II  
Marquis One Tower  
245 Peachtree Center Ave., NE Suite 1200  
Atlanta, Georgia 30303-1257

Director, Nuclear Material Safety and Safeguards  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555

NRC Senior Resident Inspector  
North Anna Power Station

*Dominion*  
*North Anna Power Station*  
*Radiological Environmental Monitoring Program*  
*January 1, 2014 to December 31, 2014*

*Prepared by*  
**Dominion, North Anna Power Station**

***Annual Radiological Environmental Operating Report***

***North Anna Power Station***

***January 1, 2014 to December 31, 2014***


***Prepared by:***



**Leonard E. Oakes**

**Supervisor Radiological Analysis and Instrumentation  
Dominion North Anna Power Station**


***Reviewed by:***



**Aziz A. Maly**

**Supervisor Health Physics Technical Services  
Dominion North Anna Power Station**

***Approved by:***

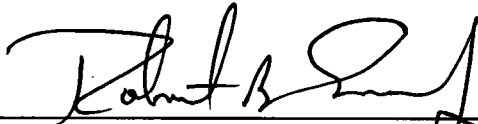

**Robert B. Evans, Jr.**

**Manager Radiological Protection and Chemistry  
Dominion North Anna Power Station**

## *Table of Contents*

1. EXECUTIVE SUMMARY.....	4
2. PROGRAM DESCRIPTION.....	7
2.1 Introduction.....	7
2.2 Sampling and Analysis Program.....	8
3. ANALYTICAL RESULTS.....	22
3.1 Summary of Results.....	22
3.2 Analytical Results of 2014 REMP Samples.....	32
4. DISCUSSION OF RESULTS.....	60
4.1 Gamma Exposure Rate.....	60
4.2 Airborne Gross Beta.....	62
4.3 Airborne Radioiodine.....	64
4.4 Air Particulate Gamma.....	64
4.5 Air Particulate Strontium.....	64
4.6 Soil.....	64
4.7 Precipitation.....	64
4.8 Cow Milk.....	65
4.9 Food Products and Vegetation.....	65
4.10 Well Water.....	66
4.11 River Water.....	66
4.12 Surface Water.....	67
4.13 Bottom Sediment.....	68
4.14 Shoreline Soil.....	69
4.15 Fish.....	70
5. PROGRAM EXCEPTIONS.....	71
REFERENCES.....	72
APPENDICES.....	73
APPENDIX A: LAND USE CENSUS.....	74
APPENDIX B: SUMMARY OF INTERLABORATORY COMPARISONS.....	77

## 1. EXECUTIVE SUMMARY

This document is a detailed report of the 2014 North Anna Nuclear Power Station Radiological Environmental Monitoring Program (REMP). It is submitted in accordance with North Anna Unit 1 and 2 Technical Specification 5.6.2 and North Anna Independent Spent Fuel Storage Installation (ISFSI) Technical Specification 5.5.2. Radioactivity levels from January 1 through December 31, 2014, in water, silt, shoreline sediment, milk, aquatic biota, food products, vegetation, and direct exposure pathways have been analyzed, evaluated and summarized. The REMP is designed to confirm that radiological effluent releases are As Low As Reasonably Achievable (ALARA), no undue environmental effects occur and the health and safety of the public are protected. The program also detects any unexpected environmental processes that could allow radiation accumulations in the environment or food pathway chains.

Radiation and radioactivity in the environment is monitored within a 25-mile radius of the station. North Anna Power Station personnel collect a variety of samples within this area. A number of sampling locations for each medium are selected using available meteorological, land use, and water use data. Two types of samples are obtained. Control samples are collected from areas that are beyond the measurable influence of North Anna Power Station or any other nuclear facility. These samples are used as reference data. Normal background radiation levels, or radiation present due to causes other than North Anna Power Station, can be compared to the environment surrounding the station. Indicator samples are the second sample type obtained. These samples show how much radiation is contributed to the environment by the station. Indicator samples are taken from areas close to the station where any station contribution will be at the highest concentration.

Prior to station operation, samples were collected and analyzed to determine the amount of radioactivity present in the area. The resulting values are used as a "pre-operational baseline." Analysis results from the indicator samples are compared to both current control sample values and the pre-operational baseline to determine if changes in radioactivity levels are attributable to station operations, or causes such as the Chernobyl accident, Fukushima Daiichi or natural variation.

Global Dosimetry Solutions provided thermoluminescent dosimetry (TLD) services and Teledyne Brown Engineering Environmental Services provided radioanalytical services. Participation in an Interlaboratory Comparison Program provides an independent check of sample measurement precision and accuracy. Typically, radioactivity levels in the environment are so low that analysis values frequently fall below the minimum detection limits of state-of-the-art measurement methods.

Because of this, the Nuclear Regulatory Commission (NRC) requires that equipment used for radiological environmental monitoring must be able to detect specified minimum Lower Limits of Detection (LLDs). This ensures that analyses are as accurate as possible. The NRC also mandates a reporting level for certain radionuclides. Licensed nuclear facilities must report the radionuclide activities in those environmental samples that are equal to or greater than the specified reporting level. Environmental radiation levels are sometimes referred to as a percent of the reporting level.

Analytical results are reported for all possible radiation exposure pathways to man. These pathways include airborne, water, aquatic, terrestrial, and direct radiation exposure. The airborne exposure pathway includes radioactive airborne iodine and particulates, and precipitation. The 2014 airborne results were similar to previous years. Fallout or natural radioactivity levels remained at levels consistent with past years' results.

Water and aquatic exposure pathway samples include precipitation, surface, river and well water, silt and shoreline sediments, and fish. The average tritium activity in surface water for 2014 was 2630 pCi/liter. No other plant related isotopes were reported in any surface or river water. River water collected from the North Anna River, 5.8 miles downstream of the site had an average tritium level of 2870 pCi/liter. No plant related isotopes were detected in quarterly precipitation samples. Silt samples indicated the presence of naturally occurring potassium-40 and thorium and uranium decay daughters at levels consistent with the natural background. No plant related isotope was identified in any sample. Shoreline soil, which may provide a direct exposure pathway, indicated the presence of potassium-40 and thorium and uranium decay daughters also at levels consistent with natural levels. No plant related isotope was detected in the indicator or control locations in shoreline soil. No plant related isotope was detected in fish samples from either Lake Anna or the control location, Lake Orange.

Soil samples, which are collected every three years from twelve stations, were not collected in 2014.

The terrestrial exposure pathway includes milk and food/vegetation products. No plant related radioisotope was detected in any milk samples. Naturally occurring beryllium-7, potassium-40 and radionuclides associated with the uranium and thorium series were detected at environmental levels consistent with historical data. No plant related isotope was detected in any vegetation sample. Low levels of Cs-137 have been detected intermittently in past years.

The direct exposure pathway measures environmental radiation doses by use of thermoluminescent dosimeters (TLDs). TLD results have remained essentially constant over the years.

During 2014, as in previous years, operation of the North Anna Power Station and the Independent Spent Fuel Storage Installation (ISFSI) created no adverse environmental effects or health hazards. The maximum total body dose calculated for a hypothetical individual at the station site boundary due to liquid and gaseous effluents released from the station during 2014 was 0.39 millirem. For reference, this dose may be compared to the 620 millirem average annual exposure to every person in the United States from natural and man-made sources. Natural background sources in the environment provide approximately 50% of radiation exposure to man, while medical uses provide approximately 48%. By comparison, nuclear power contributes less than 0.1%. These results demonstrate not only compliance with federal and state regulations but also demonstrate the adequacy of radioactive effluent control at North Anna Power Station.



## **2. PROGRAM DESCRIPTION**

### ***2.1 Introduction***

This report documents the 2014 North Anna Power Station operational Radiological Environmental Monitoring Program (REMP).

The North Anna Power Station of Virginia Electric and Power Company (Dominion) is located on Lake Anna in Mineral, Virginia, approximately 35 miles southwest of Fredericksburg, Virginia. The site consists of two units, each with a pressurized water reactor (PWR) nuclear steam supply system and turbine generator furnished by Westinghouse Electric Corporation. Each unit has a gross electrical output of 1029 megawatts electric (MWe). Unit 1 achieved commercial operation on June 6, 1978 and Unit 2 on December 14, 1980. An independent spent fuel storage facility was licensed for dry cask storage of spent fuel in 1998.

The United States Nuclear Regulatory Commission (USNRC) regulations require that nuclear power plants be designed, constructed, and operated to keep levels of radioactive material in effluents to unrestricted areas as low as reasonably achievable (ALARA). To ensure these criteria are met, the operating license for North Anna Power Station includes Technical Specifications, which address the release of radioactive effluents. In-plant monitoring is used to ensure release limits are not exceeded. As a precaution against unexpected or undefined environmental processes which might allow undue accumulation of radioactivity in the environment, a program for monitoring the plant environs is also included in the North Anna Power Station Offsite Dose Calculation Manual (ODCM).

North Anna Power Station is responsible for collecting the various indicator and control environmental samples. Global Dosimetry Solutions is utilized for processing the TLDs. Teledyne Brown Engineering Environmental Services (TBE) is utilized for sample analyses. The results of the analyses are used to determine if changes in radioactivity levels may be attributable to station operations. Measured values are compared with control levels, which vary with time due to external events, such as cosmic ray bombardment, nuclear weapons test fallout and seasonal variations of naturally occurring radioisotopes. Data collected prior to station operation is used to indicate the degree of natural variation to be expected. The pre-operational data is compared with data collected during the operational phase to assist in evaluating any radiological impact of station operation.

Occasionally samples of environmental media show the presence of man-made isotopes. As a method of referencing the measured radionuclide concentrations in the sample media to a dose consequence to man, the data is compared to the

reporting level concentrations listed in the USNRC Regulatory Guide 4.8 and North Anna's ODCM. These concentrations are based upon the annual dose commitment recommended by 10CFR50, Appendix I, to meet the criterion of "As Low As Is Reasonably Achievable".

This report documents the results of the Radiological Environmental Monitoring Program for 2014 and satisfies the following objectives of the program:

- To provide measurements of radiation and of radioactive materials in those exposure pathways and for those radionuclides that lead to the highest potential radiation exposure of the maximum exposed member of the public resulting from station operations.
- To supplement the radiological effluent monitoring program by verifying that radioactive effluents are within allowable limits.
- To identify changes in radioactivity in the environment.
- To verify that station operations have no detrimental effect on the health and safety of the public.

## ***2.2 Sampling and Analysis Program***

Table 2-1 summarizes the 2014 sampling program for North Anna Power Station. All samples listed in Table 2-1 are taken at indicator locations except those labeled "control." The North Anna Radiological Monitoring Locations maps denote sample locations for North Anna Power Station. The locations are color coded to designate sample types. Table 2-2 summarizes the analysis program conducted by TBE for North Anna Power Station during the year 2014.

**TABLE 2-1**  
**North Anna Power Station – 2014**  
**RADIOLOGICAL SAMPLING STATION**  
**DISTANCE AND DIRECTION FROM UNIT NO. 1**

Sample Media	Location	Station	Distance	Direction	Degrees	Collection	Remarks
						Frequency	
Environmental	NAPS Sewage Treatment Plant	01	0.20	NE	42°	Quarterly & Annually	
Thermoluminescent Dosimetry (TLD)	Fredericks Hall	02	5.30	SSW	203°	Quarterly & Annually	
	Mineral, Va	03	7.10	WSW	243°	Quarterly & Annually	
	Wares Crossroads	04	5.10	WNW	287°	Quarterly & Annually	
	Route 752	05	4.20	NNE	20°	Quarterly & Annually	
	Sturgeon's Creek Marina	05A	2.04	N	11°	Quarterly & Annually	
	Levy, VA	06	4.70	ESE	115°	Quarterly & Annually	
	Bumpass, VA	07	7.30	SSE	167°	Quarterly & Annually	
	End of Route 685	21	1.00	WNW	301°	Quarterly & Annually	
	Route 700	22	1.00	WSW	242°	Quarterly & Annually	
	"Aspen Hills"	23	0.93	SSE	158°	Quarterly & Annually	
	Orange, VA	24	22.00	NW	325°	Quarterly & Annually	Control
	Bearing Cooling Tower	N-1/33	0.06	N	10°	Quarterly	
	Sturgeon's Creek Marina	N-2/34	2.04	N	11°	Quarterly	
	Parking Lot "C" (on-site)	NNE-3/35	0.24	NNE	32°	Quarterly	
	Good Hope Church	NNE-4/36	3.77	NNE	25°	Quarterly	
	Parking Lot "B"	NE-5/37	0.20	NE	42°	Quarterly	
	Lake Anna Marina (Bogg's Dr)	NE-6/38	1.46	NE	34°	Quarterly	
	Weather Tower Fence	ENE-7/39	0.36	ENE	74°	Quarterly	
	Route 689	ENE-8/40	2.43	ENE	65°	Quarterly	
	Near Training Facility	E-9/41	0.30	E	91°	Quarterly	
	"Morning Glory Hill"	E-10/42	2.85	E	93°	Quarterly	
	Island Dike	ESE-11/43	0.12	ESE	103°	Quarterly	
	Route 622	ESE-12/44	4.70	ESE	115°	Quarterly	
	DVP Biology Lab	SE-13/45	0.64	SE	138°	Quarterly	
	Route 701 (Dam Entrance)	SE-14/46	5.88	SE	137°	Quarterly	
	"Aspen Hills"	SSE-15/47	0.93	SSE	158°	Quarterly	
	Elk Creek	SSE-16/48	2.33	SSE	165°	Quarterly	
	NAPS Access Rd.	S-17/49	0.36	S	173°	Quarterly	

**TABLE 2-1**  
**North Anna Power Station – 2014**  
**RADIOLOGICAL SAMPLING STATION**  
**DISTANCE AND DIRECTION FROM UNIT NO. 1**

Sample Media	Location	Station	Distance	Direction	Degrees	Collection	Remarks
						Frequency	
<b>Environmental</b>	Elk Creek Church	S-18/50	1.55	S	178°	Quarterly	
<b>Thermoluminescent Dosimetry (TLD)</b>	NAPS Access Rd.	SSW-19/51	0.24	SSW	197°	Quarterly	
	Route 618	SSW-20/52	5.30	SSW	205°	Quarterly	
	500kv Tower	SW-21/53	0.60	SW	218°	Quarterly	
	Route 700	SW-22/54	3.96	SW	232°	Quarterly	
	NAPS Radio Tower	WSW-23/55	0.38	WSW	237°	Quarterly	
	Route 700 (Exclusion Boundary)	WSW-24/56	1.00	WSW	242°	Quarterly	
	South Gate Switchyard	W-25/57	0.32	W	279°	Quarterly	
	Route 685	W-26/58	1.55	W	274°	Quarterly	
	End of Route 685	WNW-27/59	1.00	WNW	301°	Quarterly	
	Route 685	WNW-28/60	1.40	WNW	303°	Quarterly	
	North Gate - Laydown Area	NW-29/61	0.52	NW	321°	Quarterly	
	Lake Anna Campground	NW-30/62	2.54	NW	319°	Quarterly	
	#1/#2 Intake	NNW-31/63	0.07	NNW	349°	Quarterly	
	Route 208	NNW-32/64	2.21	NNW	344°	Quarterly	
	Bumpass Post Office	C-1/2	7.30	SSE	167°	Quarterly	
	Orange, VA	C-3/4	22.00	NW	325°	Quarterly	Control
	Mineral, VA	C-5/6	7.10	WSW	243°	Quarterly	
	Louisa, VA	C-7/8	11.54	WSW	257°	Quarterly	Control
<b>Airborne Particulate and Radioiodine</b>	NAPS Sewage Treatment Plant	01	0.20	NE	42°	Weekly	
	Biology Lab	01A	0.64	SE	138°	Weekly	
	Mineral, VA	03	7.10	WSW	243°	Weekly	
	Wares Crossroads	04	5.10	WNW	287°	Weekly	
	Route 752	05	4.20	NNE	20°	Weekly	
	Sturgeon's Creek Marina	05A	2.04	N	11°	Weekly	
	Levy, VA	06	4.70	ESE	115°	Weekly	
	Bumpass, VA	07	7.30	SSE	167°	Weekly	

**TABLE 2-1**  
**North Anna Power Station – 2014**  
**RADIOLOGICAL SAMPLING STATION**  
**DISTANCE AND DIRECTION FROM UNIT NO. 1**

Sample Media	Location	Station	Distance	Direction	Collection		Remarks
					Degrees	Frequency	
Airborne Particulate and Radioiodine	End of Route 685	21	1.00	WNW	301°	Weekly	
	Route 700	22	1.00	WSW	242°	Weekly	
	"Aspen Hills"	23	0.93	SSE	158°	Weekly	
	Orange, VA	24	22.00	NW	325°	Weekly	Control
Surface Water	Waste Heat Treatment Facility (Second Cooling Lagoon)	08	3.37	SSE	148°	Monthly	
	Lake Anna (upstream) (Route 669 Bridge)	09A	12.90	WNW	295°	Monthly	Control
River Water	North Anna River (downstream)	11	5.80	SE	128°	Monthly	
Ground Water (Well Water)	Biology Lab	01A	0.64	SE	138°	Quarterly	
Precipitation	Biology Lab	01A	0.64	SE	138°	Monthly	
Aquatic Sediment	Waste Heat Treatment Facility (Second Cooling Lagoon)	08	3.37	SSE	148°	Semi-Annually	
	Lake Anna (upstream) (Route 669 Bridge)	09A	12.90	WNW	295°	Semi-Annually	Control
	North Anna River (downstream)	11	5.80	SE	128°	Semi-Annually	
Shoreline Soil	Waste Heat Treatment Facility (Second Cooling Lagoon)	08	3.37	SSE	148°	Semi-Annually	
Soil	NAPS Sewage Treatment Plant	01	0.20	NE	42°	Once/3 years	
	Fredericks Hall	02	5.30	SSW	203°	Once/3 years	
	Mineral, VA	03	7.10	WSW	243°	Once/3 years	
	Wares Crossroads	04	5.10	WNW	287°	Once/3 years	

**TABLE 2-1**  
**North Anna Power Station – 2014**  
**RADIOLOGICAL SAMPLING STATION**  
**DISTANCE AND DIRECTION FROM UNIT NO. 1**

Sample Media	Location	Station	Distance	Direction	Degrees	Collection	Remarks
						Frequency	
Soil	Route 752	05	4.20	NNE	20°	Once/3 years	
	Sturgeon's Creek Marina	05A	2.04	N	11°	Once/3 years	
	Levy, VA	06	4.70	ESE	115°	Once/3 years	
	Bumpass, VA	07	7.30	SSE	167°	Once/3 years	
	End of Route 685	21	1.00	WNW	301°	Once/3 years	
	Route 700 (Exclusion Boundary)	22	1.00	WSW	242°	Once/3 years	
	"Aspen Hills"	23	0.93	SSE	158°	Once/3 years	
	Orange, VA	24	22.00	NW	325°	Once/3 years	Control
Milk	Lakeside Dairy	12A	7.50	NW	310°	Monthly	
Fish	Waste Heat Treatment Facility (Second Cooling Lagoon)	08	3.37	SSE	148°	Semi-Annually	
	Lake Orange	25	16.5	NW	312°	Semi-Annually	Control
Food Products (Vegetation)	Stagecoach Road	14B	1.22	NNE	40°	Monthly if available or at harvest	
	Route 614	15	1.37	SE	133°	Monthly if available or at harvest	
	Route 629/522	16	12.60	NW	314°	Monthly if available or at harvest	Control
	Aspen Hills	23	0.93	SSE	158°	Monthly if available or at harvest	
	"Historic Lane"	26	1.15	S	172°	Monthly if available or at harvest	

**TABLE 2-2**  
**North Anna Power Station**  
**SAMPLE ANALYSIS PROGRAM**

<b>SAMPLE MEDIA</b>	<b>FREQUENCY</b>	<b>ANALYSIS</b>	<b>LLD</b>	<b>REPORT UNITS</b>
<b>Thermoluminescent Dosimetry (TLD)</b>				
(84 TLDs)	Quarterly	Gamma Dose	2 mR±2mR	mR/std. Month
(12 TLDs)	Annually	Gamma Dose	2 mR±2mR	mR/std. Month
<b>Airborne Radioiodine</b>	Weekly	I-131	0.07	pCi/m <sup>3</sup>
<b>Airborne Particulate</b>	Weekly	Gross Beta	0.01	pCi/m <sup>3</sup>
	Quarterly (a)	Gamma Isotopic		pCi/m <sup>3</sup>
		Cs-134	0.05	
		Cs-137	0.06	
	2 <sup>nd</sup> Quarter Composite	Sr-89	(b)	pCi/m <sup>3</sup>
		Sr-90	(b)	
<b>Surface Water</b>	Monthly	I-131	1(c)	pCi/L
		Gamma Isotopic		pCi/L
		Mn-54	15	
		Fe-59	30	
		Co-58	15	
		Co-60	15	
		Zn-65	30	
		Zr-95	30	
		Nb-95	15	
		Cs-134	15	
		Cs-137	18	
		Ba-140	60	
		La-140	15	
	Quarterly(a)	Tritium (H-3)	2000	pCi/L
	2 <sup>nd</sup> Quarter Composite	Sr-89	(b)	pCi/L
		Sr-90	(b)	
<b>River Water</b>	Monthly	I-131	1(c)	pCi/L
		Gamma Isotopic		pCi/L
		Mn-54	15	
		Fe-59	30	
		Co-58	15	
		Co-60	15	
		Zn-65	30	
		Zr-95	30	
		Nb-95	15	
		Cs-134	15	
		Cs-137	18	
		Ba-140	60	

\*LLDs indicate those levels to which environmental samples are required to be analyzed. Actual analysis of samples may be lower than the listed values.

(a) Quarterly composite of each location's samples are used for the required analysis

(b) There are no required LLDs for Sr-89/90

(c) LLD for non-drinking water is 10 pCi/liter

(d) LLD applied are those for water samples. However, since this is a semi-annual composite no LLD is applied for these nuclides due to their short half-lives.

**TABLE 2-2**  
**North Anna Power Station**  
**SAMPLE ANALYSIS PROGRAM**

<b>SAMPLE MEDIA</b>	<b>FREQUENCY</b>	<b>ANALYSIS</b>	<b>LLD</b>	<b>REPORT UNITS</b>
<b>River Water</b>	Quarterly(a)	La-140	15	
	2 <sup>nd</sup> Quarter	Tritium (H-3)	2000	pCi/L
	Composite	Sr-89	(b)	pCi/L
		Sr-90	(b)	
<b>Ground Water (Well Water)</b>	Quarterly	Gamma Isotopic		pCi/L
		Mn-54	15	
		Fe-59	30	
		Co-58	15	
		Co-60	15	
		Zn-65	30	
		Zr-95	30	
		Nb-95	15	
		I-131	10(c)	
		Cs-134	15	
		Cs-137	18	
		Ba-140	60	
		La-140	15	
		Quarterly(a)	Tritium (H-3)	2000
	2 <sup>nd</sup> Quarter	Sr-89	(b)	pCi/L
	Sr-90	(b)		
<b>Aquatic Sediment</b>	Semi-Annually	Gamma Isotopic		pCi/kg (dry)
		Cs-134	150	
		Cs-137	180	
	Annually	Sr-89	(b)	pCi/kg (dry)
		Sr-90	(b)	
<b>Precipitation</b>	Monthly	Gross Beta	4	pCi/L
	Semi-Annual	Gamma Isotopic		pCi/L
	Composite	Mn-54	15	
		Fe-59	30	
		Co-58	15	
		Co-60	15	
		Zn-65	30	
		Zr-95	30	
		Nb-95	15	
		I-131 <sup>(d)</sup>		
		Cs-134	15	
		Cs-137	18	
		Ba-140 <sup>(d)</sup>		
La-140 <sup>(d)</sup>				
<b>Shoreline Soil</b>	Semi-Annually	Gamma Isotopic		pCi/kg (dry)
		Cs-134	150	
		Cs-137	180	

\*LLDs indicate those levels to which environmental samples are required to be analyzed. Actual analysis of samples may be lower than the listed values.

(a) Quarterly composite of each location's samples are used for the required analysis

(b) There are no required LLDs for Sr-89/90

(c) LLD for non-drinking water is 10 pCi/liter

(d) LLD applied are those for water samples. However, since this is a semi-annual composite no LLD is applied for these nuclides due to their short half-lives.



**TABLE 2-2**  
**North Anna Power Station**  
**SAMPLE ANALYSIS PROGRAM**

<b>SAMPLE MEDIA</b>	<b>FREQUENCY</b>	<b>ANALYSIS</b>	<b>LLD</b>	<b>REPORT UNITS</b>	
<b>Soil</b>	Annually	Sr-89	(b)	pCi/kg (dry)	
		Sr-90	(b)		
	Once per 3 years	Gamma Isotopic			pCi/kg (dry)
		Cs-134	150		
		Cs-137	180		
<b>Milk</b>	Monthly	Sr-89	(b)	pCi/kg (dry)	
		Sr-90	(b)		
	Monthly	I-131	1	pCi/L	
		Gamma Isotopic			
		Cs-134	15		
		Cs-137	18		
		Ba-140	60		
		La-140	15		
	Quarterly	Sr-89	(b)	pCi/L	
		Sr-90	(b)		
<b>Fish</b>	Semi-Annually	Gamma Isotopic		pCi/kg (wet)	
		Mn-54	130		
		Fe-59	260		
		Co-58	130		
		Co-60	130		
		Zn-65	260		
		Cs-134	130		
		Cs-137	150		
<b>Food Products (Broadleaf Vegetation)</b>	Monthly, if available, or at harvest	Gamma Isotopic		pCi/kg (wet)	
		Cs-134	60		
		Cs-137	80		
		I-131	60		


\*LLDs indicate those levels to which environmental samples are required to be analyzed. Actual analysis of samples may be lower than the listed values.

- (a) Quarterly composite of each location's samples are used for the required analysis
- (b) There are no required LLDs for Sr-89/90
- (c) LLD for non-drinking water is 10 pCi/liter
- (d) LLD applied are those for water samples. However, since this is a semi-annual composite no LLD is applied for these nuclides due to their short half-lives.

**Legend For The North Anna Power Station  
Environmental Monitoring Stations Overview Maps**


Map Designation	Environmental Station Identification	Map Designation	Environmental Station Identification
1 (a)	01,NE-5/37	7/8	C-7/8
1A	01A,SE-13/45	1/33	N-1/33
2 (a)	02,SSW-20/52	31/63	NNW-31/63
3 (a)	03,C-5/6	29/61	NW-29/61
4 (a)	04	3/35	NNE-3/35
5 (a)	05	7/39	ENE-7/39
5A (a)	05A,N-2/34	9/41	E-9/41
6 (a)	06,ESE-12/44	11/43	ESE-11/43
7 (a)	07, C-1/2	17/49	S-17/49
8	08-Water, Fish, Sediment, Shoreline Soil	19/51 21/53	SSW-19/51 SW-21/53
9A	09A-Water sample, Sediment	23/55	WSW-23/55
11	11-River Water, Sediment		
12A	12A-Milk	25/57	W-25/57
14B	14B-Vegetation	16/48	SSE-16/48
15	15-Vegetation	14/46	SE-14/46
16	16-Vegetation	22/54	SW-22/54
21 (a)	21,WNW-27/59	26/58	W-26/58
22 (a)	22,WSW-24/56	28/60	WNW-28/60
23 (a)	23-SSE-15/47,Vegetation	32/64	NNW-32/64
24 (a)(b)	24,C-3/4	8/40	ENE-8/40
25 (c)	25-Fish	4/36	NNE-4/36
26	26-Vegetation	10/42	E-10/42

(a) Indicates air sample station, annual and quarterly TLD, Triennial soil.  
 (b) In Orange  
 (c) In Lake Orange

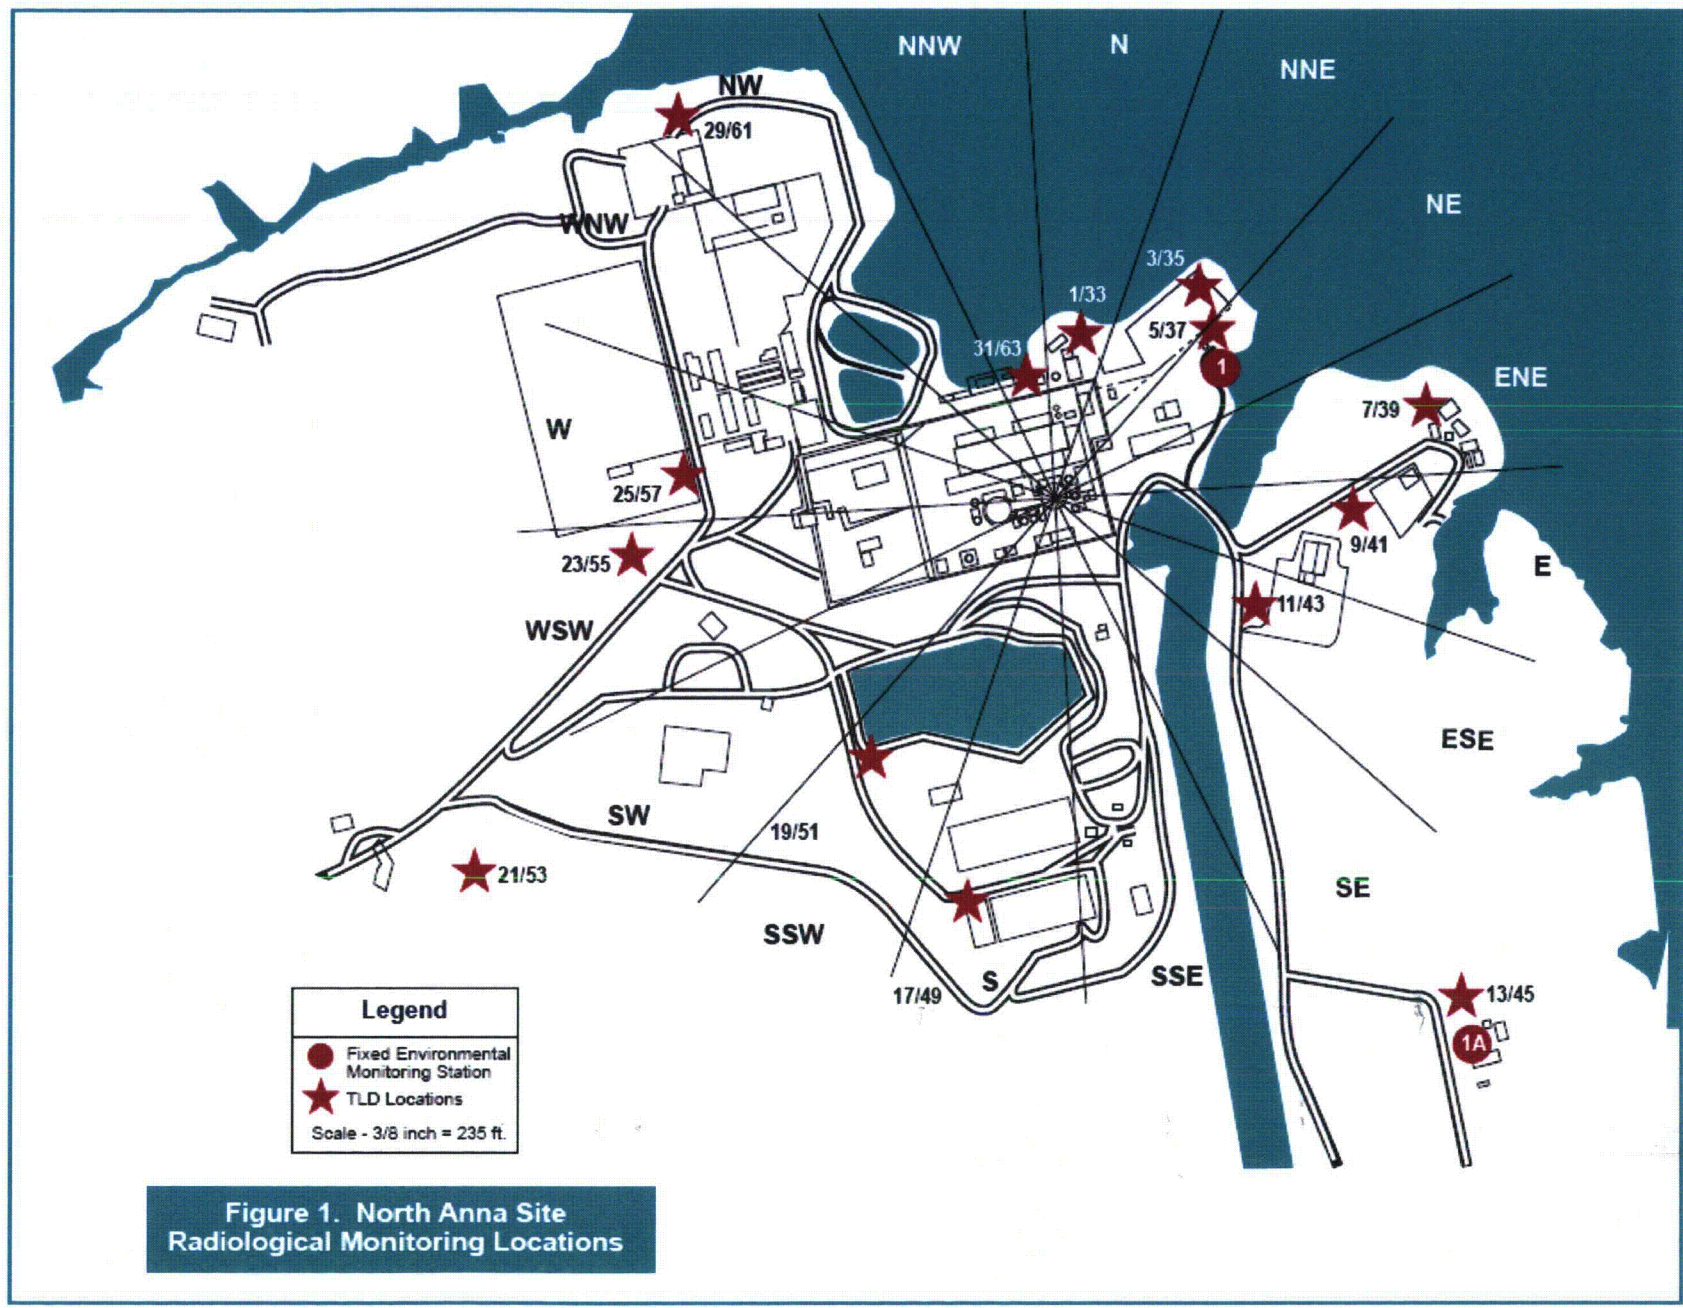






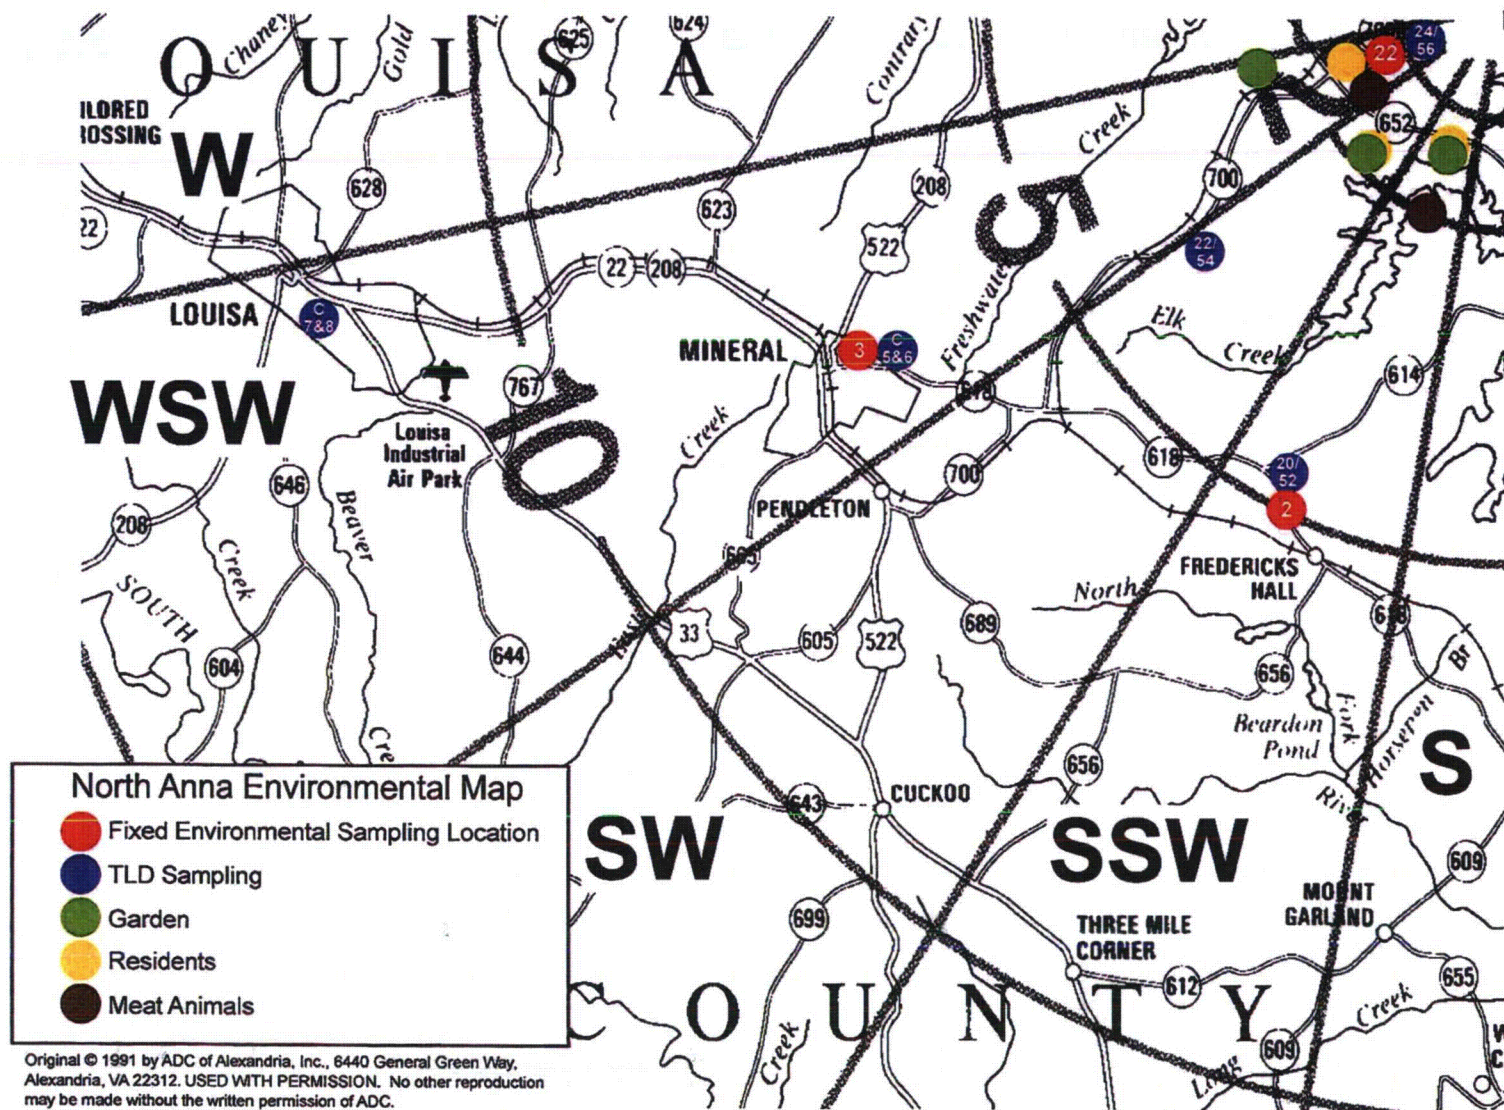

CB3283D

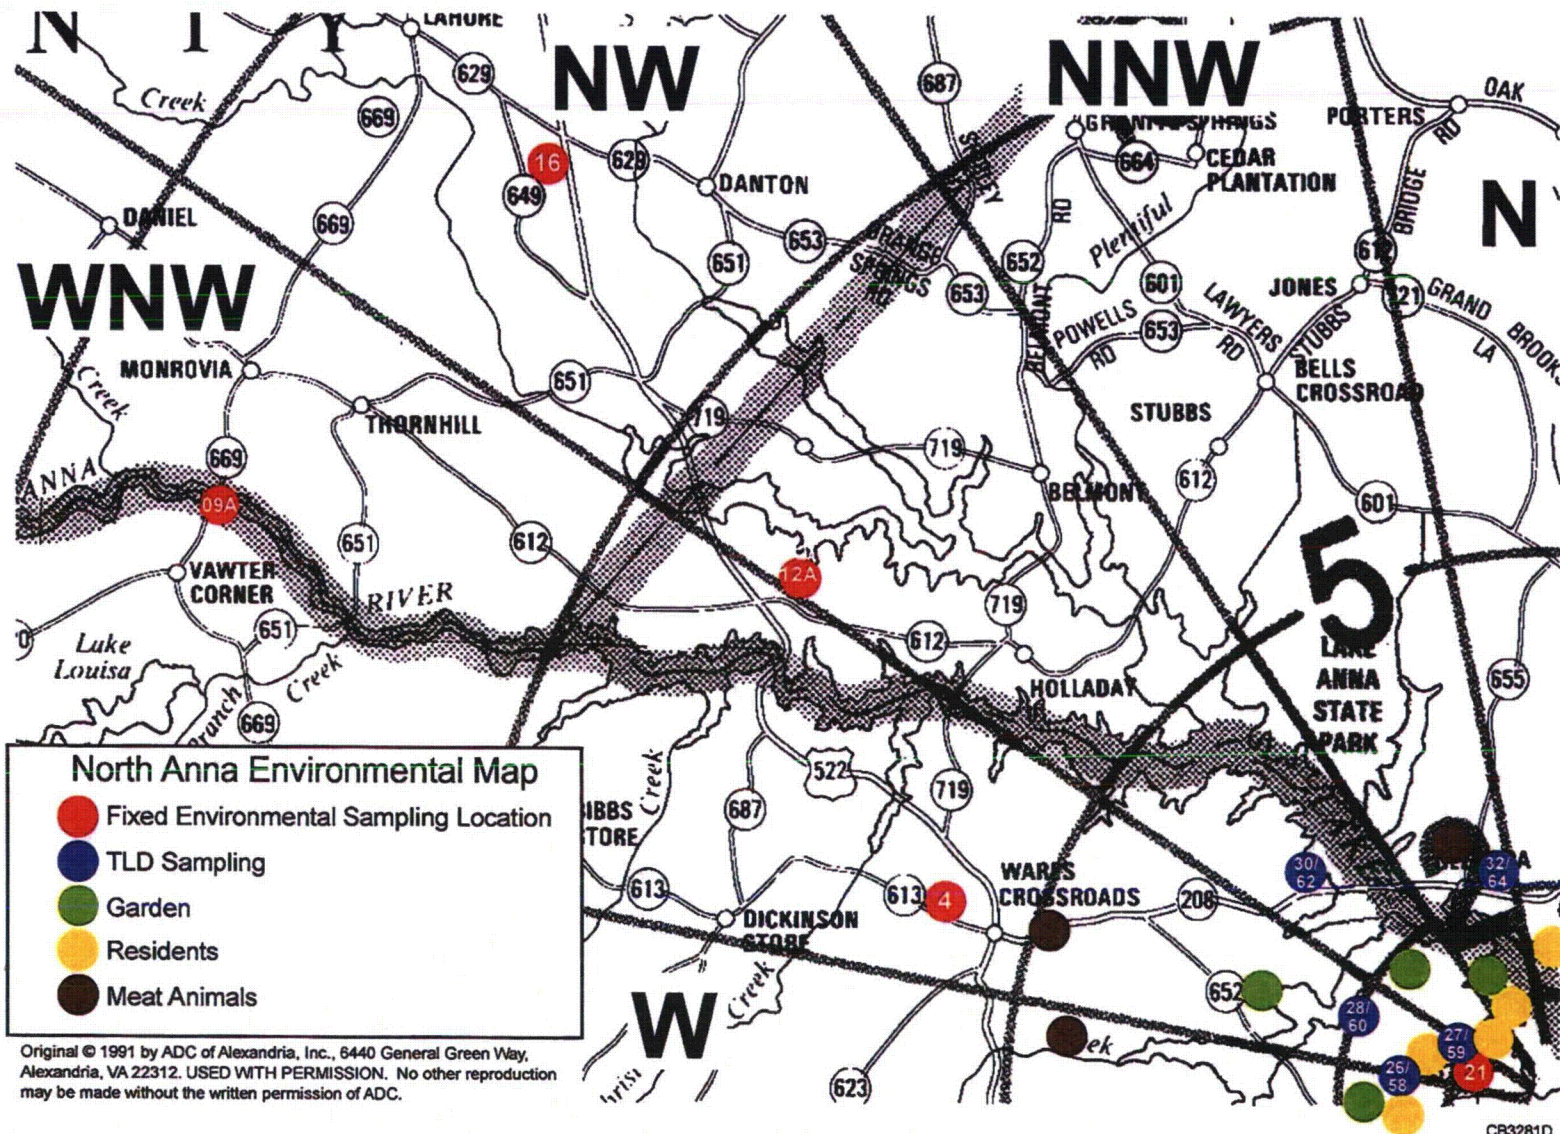

CB3281D

### 3. ANALYTICAL RESULTS

#### *3.1 Summary of Results*

In accordance with the North Anna Offsite Dose Calculation Manual (ODCM), a summary table of the analytical results has been prepared and is presented in Table 3-1. This data is presented in accordance with the format of the USNRC Branch Technical Position, "Acceptable Radiological Environmental Monitoring Program", Rev. 1, November 1979. The LLD listed value is taken from the ODCM. For radioanalytic analyses, the values listed in the columns indicated as "Mean/Range" include any results above the Minimum Detectable Concentration, MDC. Results are considered true positives when the measured value exceeds both the MDC and the  $2\sigma$  error. For TLDs the mean and range include all values.

A more detailed analysis of the data is given in Section 4 where a discussion of the variations in the data explains many aspects that are not evident in the Summary Table because of the basic limitation of data summaries.



Table 3-1

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY**

North Anna Nuclear Power Station, Louisa County, Virginia – 2014

Docket No. 50-338/339

Page 1 of 9

Medium or Pathway Sampled (Unit)	Analysis		LLD <sup>(1)</sup> (pCi/unit)	All Indicator Locations	Indicator Location with Highest Mean			Control Location	Non-routine Reported Measurements
	Type	Total No.		Mean Range	Name	Distance Direction	Mean Range	Mean Range	
<b>Direct Radiation</b> (mR/std. Month) (Sector TLDs)	Gamma Dose	256	2	4.0(256/256) (1.3-8.0)	29/61	0.52 mi. NW	7.1(8/8) (5.6-7.6)	3.15(16/16)* (2.6-3.7)	0
<b>Direct Radiation</b> (mR/std. Month) (Pre-operational TLDs)	Gamma Dose	32	2	2.4(16/16) (1.6-3.4)	C-1/2	11.54 mi. WSW	2.7 (8/8) (2.2-3.4)	3.15(16/16)* (2.6-3.7)	0
<b>Direct Radiation</b> (mR/std. Month) (Emergency Sector TLDs)	Gamma Dose	40	2	4.9(40/40) (3.0-8.2)	EPSP-09/10	0.37 mi. ENE	7.1(8/8) (6.2-8.2)	3.15(16/16)* (2.6-3.7)	0
<b>Direct Radiation</b> (mR/std. month) (Environmental TLDs)	Gamma Dose	48	2	3.2(44/44) (1.6-5.8)	23	0.93 mi. SSE	5.0(4/4) (4.3-5.8)	2.7(4/4) (2.5-3.1)	0
<b>Direct Radiation</b> (mR/std. Month) (Annual TLDs)	Gamma Dose	12	2	2.9(11/11) (2.0-4.1)	06	4.70 mi. ESE	4.1(1/1) (4.1)	2.8(1/1) (2.8)	0
<b>Airborne Particulates</b> (1E-03 pCi/m <sup>3</sup> )	Gross Beta	676	0.01	15.4(619/624) (6.75-29.8)	23	0.93 mi. SSE	17.4(52/52) (10.6-28.5)	16.2(52/52) (10.4-27.2)	0
<b>Air Iodine</b> (pCi/m <sup>3</sup> )	I-131	676	0.07	(0/624)	N/A	N/A.	N/A	N/A	0
<b>Airborne Particulates</b> (1E-03 pCi/m <sup>3</sup> )	Gamma	52							
	Be-7	52	-	116(48/48) (83.9-164)	01	0.2 mi. NE	129(4/4) (116-135)	131(4/4) (119-151)	0
	Cs-134	52	0.05	(0/48)	N/A	N/A	N/A	(0/4)	0

(1) mR/std month for TLDs

\* C-3/4, -7/8 used as control locations

**Table 3-1**

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY**

North Anna Nuclear Power Station, Louisa County, Virginia – 2014

Docket No. 50-338/339

Page 2 of 9

Medium or Pathway Sampled (Unit)	Analysis		LLD (pCi/unit)	All Indicator Locations	Indicator Location with Highest Mean			Control Location	Non-routine Reported Measurements
	Type	Total No.		Mean Range	Name	Distance Direction	Mean Range	Mean Range	
Airborne Particulates (1E-03 pCi/m <sup>3</sup> )	Cs-137	52	0.06	(0/48)	N/A	N/A	N/A	(0/4)	0
	Sr-89	13	-	(0/12)	N/A	N/A	N/A	(0/1)	0
	Sr-90	13	-	(0/12)	N/A	N/A	N/A	(0/1)	0
Soil* (pCi/Kg) (dry)	Triennial								
	Gamma	12							
	K-40	12	-	N/A	N/A	N/A	N/A	N/A	0
	Cs-134	12	150	N/A	N/A	N/A	N/A	N/A	0
	Cs-137	12	180	N/A	N/A	N/A	N/A	N/A	0
	Ra-226	12	-	N/A	N/A	N/A	N/A	N/A	0
	Th-228	12	-	N/A	N/A	N/A	N/A	N/A	0
	Th-232	12	-	N/A	N/A	N/A	N/A	N/A	0
	Sr-89	12	-	N/A	N/A	N/A	N/A	N/A	0
	Sr-90	12	-	N/A	N/A	N/A	N/A	N/A	0
Precipitation (pCi/liter)	Monthly								
	Gross Beta	12	4	3.46(10/12) (1.64-11.2)	01A	0.64 mi. SE	3.46(9/12) (1.64-11.2)	N/A	0
	H-3	2	2000	(0/2)	N/A	N/A	N/A	N/A	0
	Semiannual Gamma	2							
	Be-7	2	-	(0/2)	01A	N/A	N/A	N/A	0
	Mn-54	2	15	(0/2)	N/A	N/A	N/A	N/A	0
	Fe-59	2	30	(0/2)	N/A	N/A	N/A	N/A	0
Co-58	2	15	(0/2)	N/A	N/A	N/A	N/A	0	

\* Soil Samples required triennially. Samples not obtained in 2014..

**Table 3-1**

***RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY***

North Anna Nuclear Power Station, Louisa County, Virginia – 2014

Docket No. 50-338/339

Page 3 of 9

Medium or Pathway Sampled (Unit)	Analysis		LLD (pCi/unit)	All Indicator Locations	Indicator Location with Highest Mean			Control Location	Non-routine Reported Measurements
	Type	Total No.		Mean Range	Name	Distance Direction	Mean Range	Mean Range	
Precipitation (pCi/liter)	Co-60	2	15	(0/2)	N/A	N/A	N/A	N/A	0
	Zn-65	2	30	(0/2)	N/A	N/A	N/A	N/A	0
	Zr-95	2	30	(0/2)	N/A	N/A	N/A	N/A	0
	Nb-95	2	15	(0/2)	N/A	N/A	N/A	N/A	0
	I-131	2	10	(0/2)	N/A	N/A	N/A	N/A	0
	Cs-134	2	15	(0/2)	N/A	N/A	N/A	N/A	0
	Cs-137	2	18	(0/2)	N/A	N/A	N/A	N/A	0
	Ba-140	2	-	(0/2)	N/A	N/A	N/A	N/A	0
	La-140	2	-	(0/2)	N/A	N/A	N/A	N/A	0
	Th-228	2	-	(0/2)	N/A	N/A	N/A	N/A	0

**Table 3-1**

***RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY***

North Anna Nuclear Power Station, Louisa County, Virginia – 2014

Docket No. 50-338/339

Page 4 of 9

Medium or Pathway Sampled (Unit)	Analysis		LLD (pCi/unit)	All Indicator Locations	Indicator Location with Highest Mean			Control Location	Non-routine Reported Measurements
	Type	Total No.		Mean Range	Name	Distance Direction	Mean Range	Mean Range	
Milk (pCi/liter)	Gamma	12							
	K-40	12	-	1340(12/12) (1210-1460)	12A	7.50 mi. NW	1340(12/12) (1210-1460)	N/A	0
	I-131	12	1	(0/12)	N/A	N/A.	N/A	N/A	0
	Cs-137	12	18	(0/12)	N/A	N/A	N/A	N/A	0
	Ba-140	12	60	(0/12)	N/A	N/A	N/A	N/A	0
	La-140	12	15	(0/12)	N/A	N/A	N/A	N/A	0
	Sr-89 (Quarterly)	4	-	(0/4)	N/A	N/A	N/A	N/A	0
	Sr-90 (Quarterly)	4	-	(0/4)	N/A	N/A	N/A	N/A	0

**Table 3-1**

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY**

North Anna Nuclear Power Station, Louisa County, Virginia – 2014

Docket No. 50-338/339

Page 5 of 9

Medium or Pathway Sampled (Unit)	Analysis		LLD (pCi/unit)	All Indicator Locations	Indicator Location with Highest Mean			Control Location	Non-routine Reported Measurements
	Type	Total No.		Mean Range	Name	Distance Direction	Mean Range	Mean Range	
<b>Food Vegetation</b> (pCi/kg) (wet)	Gamma	35							
	Be-7	35	-	1320(24/24) (343-3160)	15	1.37mi SE	1520(6/6) (487-3160)	1330(6/6) (681-2450)	0
	K-40	35	-	6280(24/24) (3830-8800)	14B	1.22mi NNE	7220(6/6) (4910-8300)	6110(6/6) (5920-8360)	0
	I-131	35	60	(0/24)	N/A	N/A	N/A	(0/6)	0
	Cs-134	35	60	(0/24)	N/A	N/A	N/A	(0/6)	0
	Cs-137	35	80	(0/24)	N/A	N/A	N/A	(0/6)	0
<b>Ground Well Water</b> (pCi/liter)	Tritium	4	2000	(0/4)	N/A	N/A	N/A	N/A	0
	Gamma	4							
	Mn-54	4	15	(0/4)	N/A	N/A	N/A	N/A	0
	Fe-59	4	30	(0/4)	N/A	N/A	N/A	N/A	0
	Co-58	4	15	(0/4)	N/A	N/A	N/A	N/A	0
	Co-60	4	15	(0/4)	N/A	N/A	N/A	N/A	0
	Zn-65	4	30	(0/4)	N/A	N/A	N/A	N/A	0
	Zr-95	4	30	(0/4)	N/A	N/A	N/A	N/A	0
	Nb-95	4	15	(0/4)	N/A	N/A	N/A	N/A	0
I-131	4	10	(0/4)	N/A	N/A	N/A	N/A	0	

Table 3-1

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY**

North Anna Nuclear Power Station, Louisa County, Virginia – 2014

Docket No. 50-338/339

Page 6 of 9

Medium or Pathway Sampled (Unit)	Analysis		LLD (pCi/unit)	All Indicator Locations	Indicator Location with Highest Mean			Control Location	Non-routine
	Type	Total No.		Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measurements
Ground Well Water (pCi/liter)	Cs-134	4	15	(0/4)	N/A	N/A	N/A	N/A	0
	Cs-137	4	18	(0/4)	N/A	N/A	N/A	N/A	0
	Ba-140	4	60	(0/4)	N/A	N/A	N/A	N/A	0
	La-140	4	15	(0/4)	N/A	N/A	N/A	N/A	0
	Sr-89	1	-	(0/1)	N/A	N/A	N/A	N/A	0
	Sr-90	1	-	(0/1)	N/A	N/A	N/A	N/A	0
River Water (pCi/liter)	Tritium	4	2000	2870(4/4) (2430-3050)	11	5.80 mi. SE	2870(4/4) (2430-3050)	(0/4)*	0
	Gamma	12							
	Mn-54	12	15	(0/12)	N/A	N/A	N/A	(0/12)*	0
	Fe-59	12	30	(0/12)	N/A	N/A	N/A	(0/12)*	0
	Co-58	12	15	(0/12)	N/A	N/A	N/A	(0/12)*	0
	Co-60	12	15	(0/12)	N/A	N/A	N/A	(0/12)*	0
	Zn-65	12	30	(0/12)	N/A	N/A	N/A	(0/12)*	0
	Zr-95	12	30	(0/12)	N/A	N/A	N/A	(0/12)*	0
	Nb-95	12	15	(0/12)	N/A	N/A	N/A	(0/12)*	0
	I-131	12	1	(0/12)	N/A	N/A	N/A	(0/12)*	0
	Cs-134	12	15	(0/12)	N/A	N/A	N/A	(0/12)*	0
	Cs-137	12	18	(0/12)	N/A	N/A	N/A	(0/12)*	0

\*Results of surface water taken at Location 09A used as control value for river water

**Table 3-1**

***RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY***

North Anna Nuclear Power Station, Louisa County, Virginia – 2014

Docket No. 50-338/339

Page 7 of 9

Medium or Pathway Sampled (Unit)	Analysis		LLD (pCi/unit)	All Indicator Locations	Indicator Location with Highest Mean			Control Location	Non-routine
	Type	Total No.		Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measurements
River Water (pCi/liter)	Ba-140	12	60	(0/12)	N/A	N/A	N/A	(0/12)*	0
	La-140	12	15	(0/12)	N/A	N/A	N/A	(0/12)*	0
	Sr-89	1	-	(0/1)	N/A	N/A	N/A	(0/1)*	0
	Sr-90	1	-	(0/1)	N/A	N/A	N/A	(0/1)*	0
Surface Water (pCi/L)	Tritium	8	2000	2630(3/4) (1810-3070)	08	3.37 mi. SSE	2630(4/4) (1810-3070)	(0/4)	0
	Gamma	24							
	Mn-54	24	15	(0/12)	N/A	N/A	N/A	(0/12)	0
	Fe-59	24	30	(0/12)	N/A	N/A	N/A	(0/12)	0
	Co-58	24	15	(0/12)	N/A	N/A	N/A	(0/12)	0
	Co-60	24	15	(0/12)	N/A	N/A	N/A	(0/12)	0
	Zn-65	24	30	(0/12)	N/A	N/A	N/A	(0/12)	0
	Zr-95	24	30	(0/12)	N/A	N/A	N/A	(0/12)	0
	Nb-95	24	30	(0/12)	N/A	N/A	N/A	(0/12)	0
	I-131	24	1	(0/12)	N/A	N/A	N/A	(0/12)	0
	Cs-134	24	15	(0/12)	N/A	N/A	N/A	(0/12)	0
	Cs-137	24	18	(0/12)	N/A	N/A	N/A	(0/12)	0
	Ba-140	24	60	(0/12)	N/A	N/A	N/A	(0/12)	0
	La-140	24	15	(0/12)	N/A	N/A	N/A	(0/12)	0

\*Results of surface water taken at Location 09A used as control value for river water

**Table 3-1**

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY**

North Anna Nuclear Power Station, Louisa County, Virginia – 2014

Docket No. 50-338/339

Page 8 of 9

Medium or Pathway Sampled (Unit)	Analysis		LLD (pCi/unit)	All Indicator Locations	Indicator Location with Highest Mean			Control Location	Non- routine
	Type	Total No.		Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measure- ments
Surface Water (pCi/liter)	Sr-89	1	-	(0/1)	N/A	N/A	N/A	(0/1)	0
	Sr-90	1	-	(0/1)	N/A	N/A	N/A	(0/1)	0
Sediment Silt (pCi/kg)	Gamma	6	-						
	K-40	6	-	12100 (4/4) (2340-16000)	11	5.80 mi. SE	22550 (2/2) (18300- 26800)	30800(2/2) (27800-33800)	0
	Cs-134	6	150	(0/4)	N/A	N/A	N/A	(0/2) (176)	0
	Cs-137	6	180	(0/4)	N/A	N/A	N/A	112(1/2) (112)	0
	Ra-226	6	-	2530(4/4) (2370-2690)	11	5.80 mi. SE	2530(2/2) (2370-2690)	1970(1/2) (1970)	0
	Th-228	6	-	766(4/4) (98.5-1840)	11	5.80 mi. SE	1430(2/2) (1020-1840)	764(2/2) (448-1080)	0
	Th-232	6	-	1425 (2/4) (1120-1730)	11	5.80 mi. SE	1425(2/2) (1120-1730)	642(2/2) (414-869)	0
	(Annually)								
	Sr-89	3	-	(0/2)	N/A	N/A	N/A	(0/1)	0
	Sr-90	3	-	(0/2)	N/A	N/A	N/A	(0/1)	0
Shoreline Soil (pCi/kg) (dry)	Gamma	2	-						
	K-40	2	-	1028.5(2/2) (527-1530)	08	3.37 mi. SSE	1028.5(2/2) (527-1530)	N/A	0
	Cs-134	2	150	(0/2)	N/A	NA	(0/2)	N/A	0
	Cs-137	2	180	(0/2)	N/A	NA	(0/2)	N/A	0
	Ra-226	2	-	(0/2)	N/A	N/A	(0/2)	N/A	0



**Table 3-1**

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY**

North Anna Nuclear Power Station, Louisa County, Virginia – 2014

Docket No. 50-338/339

Page 9 of 9

Medium or Pathway Sampled (Unit)	Analysis		LLD (pCi/unit)	All Indicator Locations	Indicator Location with Highest Mean			Control Location	Non- routine
	Type	Total No.		Mean Range	Name	Distance Direction	Mean Range	Mean Range	Reported Measure- ments
<b>Shoreline Soil</b>									
(pCi/kg) (dry)									
	Th-228	2	-	148(2/2) (147-149)	08	3.37 mi. SSE	148(2/2) (147-149)	N/A	0
	Th-232	2	-	265 (1/2) (265)	08	3.37 mi. SSE	265(1/2) (265)	N/A	0
	(Annually) Sr-89	1	-	(0/1)	N/A	NA	N/A	N/A	0
	Sr-90	1	-	(0/1)	N/A	NA	N/A	N/A	0
	Gamma	8							
<b>Fish</b>									
(pCi/kg) (wet)									
	K-40	8	-	1725(4/4) (1400-1960)	8	3.37 mi. SSE	1725(4/4) (1400-1960)	1930(4/4) (1370-2410)	0
	Mn-54	8	130	(0/4)	N/A	NA	N/A	(0/4)	0
	Fe-59	8	260	(0/4)	N/A	NA	N/A	(0/4)	0
	Co-58	8	130	(0/4)	N/A	NA	N/A	(0/4)	0
	Co-60	8	130	(0/4)	N/A	NA	N/A	(0/4)	0
	Zn-65	8	260	(0/4)	N/A	NA	N/A	(0/4)	0
	Cs-134	8	130	(0/4)	N/A	NA	N/A	(0/4)	0
	Cs-137	8	150	(0/4)	N/A	NA	N/A	(0/4)	0

### 3.2 Analytical Results of 2014 REMP Samples

Radiological analyses of environmental media characteristically approach and frequently fall below the detection limits of state-of-the-art measurement methods. The data reported in the following tables are strictly counting statistics. The reported error is two times the standard deviation ( $2\sigma$ ) of the net activity. Unless otherwise noted, the overall error (counting, sample size, chemistry, errors, etc.) is estimated to be 2 to 5 times that listed. Results are considered true positives when the measured value exceeds both the MDC and the  $2\sigma$  error.

Because of counting statistics, negative values, zeros and numbers below the Minimum Detectable Level (MDL) are statistically valid pieces of data<sup>1</sup>. For clarity of this report only detectable results are presented. TBE's analytical methods meet the Lower Limit of Detection (LLD) requirements given in Table 2 of the USNRC Branch Technical Position, "An Acceptable Radiological Environmental Monitoring Program", (November 1979, Revision 1) and the North Anna ODCM.

Data are given according to sample type as indicated below.

1. Gamma Exposure Rate
2. Air Particulates, Gross Beta Radioactivity
3. Air Particulates, Weekly I-131
4. Air Particulates, Quantitative Gamma Spectra
5. Air Particulate Strontium
6. Soil
7. Precipitation
8. Cow Milk
9. Food Products and Vegetation
10. Well Water
11. River Water
12. Surface Water
13. Bottom Sediment/Silt
14. Shoreline Soil
15. Fish

---

<sup>1</sup> Analytical results are handled as recommended by HASL ("*Reporting of Analytical Results from HASL*," letter by Leo B. Higginbotham) and NUREG/CR-4007 (Sept. 1984).

**TABLE 3-2**  
**DIRECT RADIATION MEASUREMENTS - SECTOR QUARTERLY TLD RESULTS**  
 mR/Std. Month (30.4 days) ± 2 Sigma

Station	First Quarter	Second Quarter	Third Quarter	Fourth Quarter	Quarterly*	
	3/26/2014	3/26/2014 6/24/2014	6/24/2014 9/30/2014	9/30/2014 12/30/2014	Average	+/- 2 s.d.
N-1	5.1	4.6	4.5	4.2	4.6	+/- 0.9
N-33	5.0	4.2	3.9	4.9		
N-2	3.4	3.0	3.1	2.4	2.9	+/- 0.7
N-34	3.1	2.9	2.5	2.4		
NNE-3	6.4	6.1	6.2	7.2	6.6	+/- 1.3
NNE-35	7.6	5.7	6.7	7.2		
NNE-4	4.4	3.3	3.7	3.6	3.8	+/- 0.8
NNE-36	3.7	3.8	4.4	3.6		
NE-5	4.3	4.1	3.6	4.1	4.4	+/- 1.2
NE-37	5.3	4.4	5.2	3.9		
NE-6	3.0	2.8	3.5	3.2	3.0	+/- 0.5
NE-38	2.9	3.1	2.8	2.7		
ENE-7	4.9	4.9	5.3	4.3	5.0	+/- 1.0
ENE-39	4.4	5.6	4.7	5.6		
ENE-8	2.2	3.0	2.9	2.0	2.4	+/- 0.9
ENE-40	2.0	2.5	2.5	1.8		
E-9	4.9	4.6	5.1	5.0	4.7	+/- 0.8
E-41	4.0	4.1	5.0	4.6		
E-10	4.0	3.9	4.6	4.9	4.3	+/- 0.9
E-42	3.7	4.1	4.6	4.6		
ESE-11	3.5	4.0	4.3	3.6	3.6	+/- 1.1
ESE-43	2.9	3.2	4.4	3.1		
ESE-12	3.3	4.6	3.7	4.6	4.1	+/- 1.1
ESE-44	4.0	4.8	4.4	3.6		
SE-13	3.8	3.8	4.2	4.0	4.1	+/- 0.8
SE-45	4.8	3.7	4.4	3.7		
SE-14	5.9	5.2	6.1	6.2	6.0	+/- 1.1
SE-46	6.2	5.5	5.8	7.0		
SSE-15	5.3	4.3	4.9	4.3	4.6	+/- 0.8
SSE-47	4.9	4.2	4.9	4.2		
SSE-16	2.1	2.5	2.7	2.4	2.5	+/- 0.5
SSE-48	2.2	2.8	2.7	2.3		

\*Average of collocated TLDs.

**TABLE 3-2**  
**DIRECT RADIATION MEASUREMENTS - SECTOR QUARTERLY TLD RESULTS**  
 mR/Std. Month (30.4 days) ± 2 Sigma

Station	First Quarter	Second Quarter	Third Quarter	Fourth Quarter	Quarterly* Average +/- 2 s.d.	
	12/31/2013 3/26/2014	3/26/2014 6/24/2014	6/24/2014 9/30/2014	9/30/2014 12/30/2014		
S-17	4.6	4.9	3.5	4.0	4.3 +/-	1.3
S-49	5.4	3.5	4.3	4.3		
S-18	1.9	2.1	2.2	2.9	2.1 +/-	0.7
S-50	1.8	2.1	2.1	1.9		
SSW-19	5.7	5.6	6.1	5.9	5.9 +/-	1.0
SSW-51	7.0	5.4	6.1	5.6		
SSW-20	1.9	1.8	2.4	2.0	2.0 +/-	0.4
SSW-52	1.8	2.1	1.9	1.9		
SW-21	6.5	4.6	3.9	4.4	4.5 +/-	1.8
SW-53	4.0	4.7	4.2	3.5		
SW-22	3.4	3.8	4.4	3.5	4.0 +/-	1.1
SW-54	4.6	4.3	4.8	3.4		
WSW-23	4.5	3.6	4.2	5.0	4.2 +/-	1.1
WSW-55	4.9	4.0	4.1	3.6		
WSW-24	3.8	4.4	4.1	3.6	4.1 +/-	0.7
WSW-56	4.4	3.8	4.6	4.3		
W-25	6.5	7.2	6.7	7.7	7.0 +/-	0.8
W-57	7.2	7.3	6.8	6.8		
W-26	2.2	3.6	2.8	2.5	2.7 +/-	0.9
W-58	2.4	2.5	3.0	2.3		
WNW-27	2.7	3.0	3.8	3.2	2.9 +/-	1.1
WNW-59	2.4	3.2	2.2	2.5		
WNW-28	3.3	2.4	3.1	2.4	3.0 +/-	0.9
WNW-60	3.5	2.6	3.4	3.0		
NW-29	7.3	5.6	7.2	7.6	7.1 +/-	1.4
NW-61	6.7	7.1	7.4	8.0		
NW-30	1.6	1.7	1.3	1.6	1.7 +/-	0.6
NW-62	1.7	2.0	2.2	1.4		
NNW-31	3.1	2.9	3.0	4.1	3.3 +/-	0.9
NNW-63	3.1	3.6	3.0	3.8		
NNW-32	4.1	3.1	3.8	3.8	3.7 +/-	0.7
NNW-64	4.1	3.6	3.8	3.4		
Mean					4.0 +/-	1.5

\*Average of collocated TLDs.

**TABLE 3-2**  
**DIRECT RADIATION MEASUREMENTS - SECTOR QUARTERLY TLD RESULTS**  
**mR/Std. Month (30.4 days) ± 2 Sigma**

Station	First Quarter	Second Quarter	Third Quarter	Fourth Quarter	Quarterly* Average +/- 2 s.d.	
	12/31/2013 3/26/2014	3/26/2014 6/24/2014	6/24/2014 9/30/2014	9/30/2014 12/30/2014		
C-1	2.4	2.8	3.1	2.4	2.7	+/- 0.9
C-2	3.2	2.3	3.4	2.2		
C-3**	2.7	2.8	3.2	2.6	3.0	+/- 0.7
C-4**	3.4	2.9	3.5	2.6		
C-5	1.7	2.2	2.3	1.7	2.1	+/- 0.9
C-6	2.8	1.8	2.6	1.6		
C-7**	3.2	3.2	3.1	3.5	3.3	+/- 0.5
C-8**	3.7	3.0	3.6	3.0		
					2.4	+/- 1.1
					3.1	+/- 0.7
EP SA-01***	4.4	3.9	4.3	4.3	4.2	+/- 0.5
EP SA-02***	4.0	3.9	4.6	4.0		
EP SF-03***	4.5	3.0	4.1	4.6	3.8	+/- 1.2
EP SF-04***	4.1	3.3	3.8	3.3		
EP SR-05***	5.7	5.5	5.0	4.9	5.4	+/- 0.9
EP SR-06***	6.3	5.3	5.6	5.2		
EP SJ-07***	3.7	3.9	4.1	3.3	3.7	+/- 1.0
EP SJ-08***	4.6	3.3	3.2	3.2		
EP SP-09***	7.3	7.0	7.2	7.9	7.1	+/- 1.4
EP SP-10***	8.2	6.2	6.3	7.0		
Mean					4.9	+/- 2.8

\*Average of collocated TLDs.

\*\* Control Station

\*\*\* Emergency Plan TLDs.

**TABLE 3-2  
DIRECT RADIATION MEASUREMENTS - SECTOR QUARTERLY TLD RESULTS  
mR/Std. Month (30.4 days) ± 2 Sigma**

Station	First Quarter	Second Quarter	Third Quarter	Fourth Quarter	Quarterly		Annual TLD	
	12/31/2013 3/26/2014	3/26/2014 6/24/2014	6/24/2014 9/30/2014	9/30/2014 12/30/2014	Average	+/- 2 s.d.		
STA-01	3.8	4.2	4.0	4.0	4.0	+/- 0.3	4.0	
STA-02	2.1	2.2	2.4	1.6	2.1	+/- 0.7	2.3	
STA-03	1.7	2.7	2.5	1.7	2.2	+/- 1.1	2.4	
STA-04	2.2	2.8	2.0	2.1	2.3	+/- 0.7	2.0	
STA-05	3.3	2.9	3.2	2.2	2.9	+/- 1.0	2.9	
STA-05A	2.1	3.4	3.0	3.2	2.9	+/- 1.1	2.2	
STA-06	4.1	4.3	4.4	4.3	4.3	+/- 0.3	4.1	
STA-07	3.1	2.6	3.2	3.1	3.0	+/- 0.5	2.6	
STA-21	2.7	2.7	3.1	2.2	2.7	+/- 0.7	2.5	
STA-22	5.0	3.8	4.3	4.4	4.4	+/- 1.0	3.4	
STA-23	5.3	4.5	5.8	4.3	5.0	+/- 1.4	3.8	
STA-24*	2.5	2.7	3.1	2.5	2.7	+/- 0.3	2.8	
		Mean - Indicator Locations			3.2	+/- 1.0	2.9	+/- 1.5

\*Control

**Table 3-3**  
**Air Particulate**  
**Gross Beta Radioactivity**  
 $[10^{-3} \text{ pCi/m}^3]$

Period	Station		Station		Station		Station		Station		Station		Station		Station						
Ending	01		02		03		04		05		06		07								
01/08/14	2.27E+01	+/-	3.22E+00	1.29E+01	+/-	2.36E+00	1.32E+01	+/-	2.44E+00	1.55E+01	+/-	2.53E+00	1.51E+01	+/-	2.49E+00	1.73E+01	+/-	2.60E+00	1.40E+01	+/-	2.43E+00
01/14/14	2.05E+01	+/-	3.46E+00	1.26E+01	+/-	3.03E+00	1.64E+01	+/-	3.25E+00	1.76E+01	+/-	3.30E+00	1.56E+01	+/-	3.20E+00	1.58E+01	+/-	3.21E+00	1.93E+01	+/-	3.39E+00
01/21/14	1.45E+01	+/-	2.78E+00	1.39E+01	+/-	2.75E+00	1.47E+01	+/-	2.79E+00	1.50E+01	+/-	2.81E+00	1.48E+01	+/-	2.80E+00	1.96E+01	+/-	3.04E+00	1.19E+01	+/-	2.64E+00
01/28/14	1.37E+01	+/-	2.63E+00	1.49E+01	+/-	2.69E+00	1.12E+01	+/-	2.48E+00	1.69E+01	+/-	2.80E+00	1.58E+01	+/-	2.74E+00	1.63E+01	+/-	2.77E+00	1.59E+01	+/-	2.75E+00
02/04/14	2.15E+01	+/-	3.18E+00	1.55E+01	+/-	2.88E+00	1.79E+01	+/-	3.00E+00	1.69E+01	+/-	2.95E+00	1.91E+01	+/-	3.06E+00	1.30E+01	+/-	2.75E+00	2.08E+01	+/-	3.14E+00
02/11/14	2.50E+01	+/-	3.30E+00	2.44E+01	+/-	3.28E+00	2.50E+01	+/-	3.31E+00	2.98E+01	+/-	3.51E+00	2.61E+01	+/-	3.36E+00	2.84E+01	+/-	3.45E+00	2.56E+01	+/-	3.33E+00
02/18/14	2.01E+01	+/-	3.05E+00	1.63E+01	+/-	2.88E+00	2.18E+01	+/-	3.12E+00	2.61E+01	+/-	3.37E+00	1.85E+01	+/-	2.70E+00	2.58E+01	+/-	3.32E+00	2.24E+01	+/-	3.17E+00
02/26/14	1.31E+01	+/-	2.35E+00	1.16E+01	+/-	2.25E+00	1.08E+01	+/-	2.22E+00	9.82E+00	+/-	2.13E+00	1.36E+01	+/-	2.38E+00	1.32E+01	+/-	2.35E+00	1.21E+01	+/-	2.28E+00
03/05/14	1.36E+01	+/-	2.82E+00	2.25E+01	+/-	3.25E+00	1.88E+01	+/-	3.08E+00	2.71E+01	+/-	3.45E+00	1.71E+01	+/-	3.00E+00	2.71E+01	+/-	3.45E+00	2.40E+01	+/-	3.32E+00
03/12/14	*	<	*	1.86E+01	+/-	3.08E+00	1.68E+01	+/-	2.99E+00	2.25E+01	+/-	3.27E+00	1.46E+01	+/-	2.87E+00	1.63E+01	+/-	2.96E+00	1.92E+01	+/-	3.11E+00
03/19/14	*	<	*	1.37E+01	+/-	2.74E+00	1.48E+01	+/-	2.76E+00	1.59E+01	+/-	2.87E+00	1.29E+01	+/-	2.68E+00	1.26E+01	+/-	2.67E+00	1.31E+01	+/-	2.71E+00
03/26/14	1.36E+01	<	2.80E+00	1.27E+01	+/-	2.69E+00	1.47E+01	+/-	2.87E+00	1.51E+01	+/-	2.78E+00	1.24E+01	+/-	2.67E+00	9.68E+00	+/-	2.50E+00	1.28E+01	+/-	2.69E+00
04/02/14	1.55E+01	+/-	2.80E+00	1.31E+01	+/-	2.70E+00	1.09E+01	+/-	2.67E+00	1.76E+01	+/-	2.97E+00	1.09E+01	+/-	2.60E+00	1.43E+01	+/-	2.78E+00	1.12E+01	+/-	2.60E+00
04/08/14	1.21E+01	+/-	2.88E+00	1.25E+01	+/-	2.92E+00	1.09E+01	+/-	2.82E+00	1.40E+01	+/-	3.01E+00	1.17E+01	+/-	2.87E+00	1.01E+01	+/-	2.77E+00	1.32E+01	+/-	2.96E+00
04/16/14	1.37E+01	+/-	2.50E+00	1.44E+01	+/-	2.53E+00	1.31E+01	+/-	2.47E+00	1.52E+01	+/-	2.57E+00	1.38E+01	+/-	2.50E+00	1.33E+01	+/-	2.47E+00	1.22E+01	+/-	2.41E+00
04/22/14	1.98E+01	+/-	3.23E+00	1.09E+01	+/-	2.71E+00	1.62E+01	+/-	3.03E+00	1.65E+01	+/-	3.05E+00	1.02E+01	+/-	2.67E+00	1.91E+01	+/-	3.20E+00	1.95E+01	+/-	3.22E+00
04/29/14	1.12E+01	+/-	2.46E+00	1.19E+01	+/-	2.47E+00	1.39E+01	+/-	2.56E+00	1.73E+01	+/-	2.78E+00	*	<	*	1.48E+01	+/-	2.64E+00	1.15E+01	+/-	2.45E+00
05/06/14	1.06E+01	+/-	2.46E+00	1.09E+01	+/-	2.51E+00	7.65E+00	+/-	2.35E+00	9.20E+00	+/-	2.42E+00	1.27E+01	+/-	2.63E+00	9.00E+00	+/-	2.46E+00	1.15E+01	+/-	2.55E+00
05/13/14	1.68E+01	<	2.86E+01	1.89E+01	+/-	2.97E+00	1.12E+01	+/-	2.55E+00	1.72E+01	+/-	2.88E+00	1.24E+01	+/-	2.61E+00	2.09E+01	+/-	3.07E+00	2.26E+01	+/-	3.16E+00
05/21/14	1.35E+01	+/-	2.38E+00	1.48E+01	+/-	2.45E+00	1.08E+01	+/-	2.21E+00	1.76E+01	+/-	2.60E+00	1.51E+01	+/-	2.46E+00	1.16E+01	+/-	2.26E+00	1.66E+01	+/-	2.55E+00
05/27/14	1.47E+01	+/-	3.06E+00	1.41E+01	+/-	3.03E+00	1.25E+01	+/-	2.93E+00	1.25E+01	+/-	2.93E+00	1.11E+01	+/-	2.85E+00	1.36E+01	+/-	3.00E+00	1.76E+01	+/-	3.23E+00
06/04/14	7.98E+00	+/-	2.23E+00	1.01E+01	+/-	2.35E+00	8.88E+00	+/-	2.28E+00	1.03E+01	+/-	2.36E+00	1.02E+01	+/-	2.35E+00	8.70E+00	+/-	2.27E+00	1.38E+01	+/-	2.54E+00
06/10/14	1.30E+01	+/-	3.07E+00	9.71E+00	+/-	2.72E+00	1.30E+01	+/-	2.93E+00	1.54E+01	+/-	3.07E+00	1.17E+01	+/-	2.85E+00	1.51E+01	+/-	3.05E+00	1.62E+01	+/-	3.10E+00
06/18/14	1.52E+01	+/-	2.50E+00	1.23E+01	+/-	2.36E+00	1.14E+01	+/-	2.29E+00	1.54E+01	+/-	2.51E+00	1.34E+01	+/-	2.40E+00	9.02E+00	+/-	2.17E+00		<	3.01E+00
06/24/14	1.36E+01	+/-	2.93E+00	1.18E+01	+/-	2.88E+00	1.30E+01	+/-	2.93E+00	1.61E+01	+/-	3.11E+00	1.54E+01	+/-	3.07E+00	1.42E+01	+/-	2.99E+00	1.20E+01	+/-	2.92E+00
07/01/14	1.49E+01	+/-	2.71E+00	1.09E+01	+/-	2.46E+00	1.24E+01	+/-	2.53E+00	1.58E+01	+/-	2.73E+00	1.85E+01	+/-	2.87E+00	1.76E+01	+/-	2.83E+00	1.65E+01	+/-	2.78E+00

\* Sample not obtained due to sampler not operating

**Table 3-3**  
**Air Particulate**  
**Gross Beta Radioactivity**  
 $[10^{-3} \text{ pCi/m}^3]$

Period Ending	Station 21		Station 22		Station 23		Station 24*		Station 01A		Station 05A							
01/08/14	1.65E+01	+/-	2.57E+00	1.46E+01	+/-	2.48E+00	1.95E+01	+/-	2.69E+00	1.48E+01	+/-	2.51E+00	1.76E+01	+/-	2.58E+00	1.93E+01	+/-	2.71E+00
01/14/14	1.51E+01	+/-	3.18E+00	1.22E+01	+/-	3.02E+00	1.66E+01	+/-	3.25E+00	1.44E+01	+/-	3.13E+00	1.53E+01	+/-	3.18E+00	1.74E+01	+/-	3.29E+00
01/21/14	1.41E+01	+/-	2.76E+00	1.22E+01	+/-	2.66E+00	1.45E+01	+/-	2.78E+00	1.36E+01	+/-	2.74E+00	9.71E+00	+/-	2.51E+00	1.56E+01	+/-	2.84E+00
01/28/14	1.50E+01	+/-	2.69E+00	1.98E+01	+/-	2.94E+00	1.67E+01	+/-	2.79E+00	1.13E+01	+/-	2.48E+00	1.39E+01	+/-	2.64E+00	1.42E+01	+/-	2.66E+00
02/04/14	1.56E+01	+/-	2.88E+00	1.75E+01	+/-	2.98E+00	1.70E+01	+/-	2.96E+00	1.68E+01	+/-	2.94E+00	2.03E+01	+/-	3.12E+00	1.77E+01	+/-	2.99E+00
02/11/14	2.24E+01	+/-	3.18E+00	2.21E+01	+/-	3.17E+00	2.73E+01	+/-	3.40E+00	2.68E+01	+/-	3.38E+00	2.36E+01	+/-	3.24E+00	2.32E+01	+/-	3.22E+00
02/18/14	1.64E+01	+/-	2.87E+00	2.00E+01	+/-	3.06E+00	2.44E+01	+/-	3.25E+00	2.24E+01	+/-	3.17E+00	1.84E+01	+/-	2.97E+00	2.06E+01	+/-	3.07E+00
02/26/14	1.17E+01	+/-	2.26E+00	1.43E+01	+/-	2.40E+00	1.25E+01	+/-	2.31E+00	1.24E+01	+/-	2.31E+00	9.77E+00	+/-	2.15E+00	1.22E+01	+/-	2.30E+00
03/05/14	2.14E+01	+/-	3.20E+00	2.23E+01	+/-	3.24E+00	2.79E+01	+/-	3.48E+00	2.53E+01	+/-	3.37E+00	2.04E+01	+/-	3.15E+00	1.68E+01	+/-	2.98E+00
03/12/14	1.78E+01	+/-	3.04E+00	1.72E+01	+/-	3.01E+00	1.93E+01	+/-	3.11E+00	2.02E+01	+/-	3.15E+00	1.77E+01	+/-	3.03E+00	1.93E+01	+/-	3.11E+00
03/19/14	1.26E+01	+/-	2.67E+00	1.32E+01	+/-	2.70E+00	1.77E+01	+/-	2.95E+00	1.18E+01	+/-	2.63E+00	1.11E+01	+/-	2.58E+00	1.19E+01	+/-	2.62E+00
03/26/14	1.15E+01	+/-	2.59E+00	1.61E+01	+/-	2.86E+00	1.80E+01	+/-	2.98E+00	1.55E+01	+/-	2.80E+00	1.49E+01	+/-	2.86E+00	1.34E+01	+/-	2.72E+00
04/02/14	1.27E+01	+/-	2.71E+00	1.51E+01	+/-	2.84E+00	1.46E+01	+/-	2.78E+00	1.63E+01	+/-	2.94E+00	1.52E+01	+/-	2.78E+00	1.10E+01	+/-	2.61E+00
04/08/14	1.10E+01	+/-	2.83E+00	1.32E+01	+/-	2.96E+00	1.39E+01	+/-	3.00E+00	1.21E+01	+/-	2.90E+00	1.30E+01	+/-	2.94E+00	1.35E+01	+/-	2.98E+00
04/16/14	1.39E+01	+/-	2.51E+00	1.40E+01	+/-	2.51E+00	1.47E+01	+/-	2.55E+00	1.48E+01	+/-	2.55E+00	1.53E+01	+/-	2.58E+00	1.20E+01	+/-	2.40E+00
04/22/14	1.40E+01	+/-	2.90E+00	1.67E+01	+/-	3.06E+00	2.14E+01	+/-	3.32E+00	1.83E+01	+/-	3.15E+00	2.03E+01	+/-	3.26E+00	1.92E+01	+/-	3.21E+00
04/29/14	1.15E+01	+/-	2.43E+00	1.37E+01	+/-	2.56E+00	1.51E+01	+/-	2.68E+00	1.40E+01	+/-	2.55E+00	1.04E+01	+/-	2.41E+00	8.17E+00	+/-	2.21E+00
05/06/14	6.78E+00	+/-	2.24E+00	9.21E+00	+/-	2.44E+00	1.16E+01	+/-	2.58E+00	1.17E+01	+/-	2.61E+00	1.06E+01	+/-	2.46E+00	9.70E+00	+/-	2.46E+00
05/13/14	1.56E+01	+/-	2.80E+00	1.74E+01	+/-	2.90E+00	2.40E+01	+/-	3.22E+00	2.09E+01	+/-	3.08E+00	2.04E+01	+/-	3.04E+00	1.59E+01	+/-	2.81E+00
05/21/14	1.49E+01	+/-	2.45E+00	1.58E+01	+/-	2.50E+00	1.25E+01	+/-	2.32E+00	1.04E+01	+/-	2.21E+00	1.71E+01	+/-	2.68E+00	1.17E+01	+/-	2.27E+00
05/27/14	1.57E+01	+/-	3.12E+00	1.52E+01	+/-	3.09E+00	1.91E+01	+/-	3.31E+00	1.81E+01	+/-	3.25E+00	1.71E+01	+/-	3.20E+00	1.32E+01	+/-	2.97E+00
06/04/14	8.49E+00	+/-	2.26E+00	8.88E+00	+/-	2.28E+00	1.21E+01	+/-	2.46E+00	1.13E+01	+/-	2.41E+00	1.12E+01	+/-	2.41E+00	6.75E+00	+/-	2.16E+00
06/10/14	9.45E+00	+/-	2.72E+00	1.36E+01	+/-	2.96E+00	1.55E+01	+/-	3.05E+00	1.36E+01	+/-	2.96E+00	1.37E+01	+/-	2.95E+00	1.25E+01	+/-	2.90E+00
06/18/14	1.32E+01	+/-	2.39E+00	1.07E+01	+/-	2.25E+00	1.23E+01	+/-	2.35E+00	1.34E+01	+/-	2.40E+00	1.16E+01	+/-	2.31E+00	1.18E+01	+/-	2.31E+00
06/24/14	1.08E+01	+/-	2.79E+00	1.52E+01	+/-	3.06E+00	1.45E+01	+/-	3.02E+00	1.90E+01	+/-	3.27E+00	1.60E+01	+/-	3.07E+00	1.65E+01	+/-	3.31E+00
07/01/14	1.54E+01	+/-	2.70E+00	1.47E+01	+/-	2.66E+00	1.62E+01	+/-	2.76E+00	1.78E+01	+/-	2.83E+00	1.73E+01	+/-	2.83E+00	1.34E+01	+/-	2.60E+00

\* Control Station



**Table 3-3**  
**Air Particulate**  
**Gross Beta Radioactivity**  
**[10<sup>-3</sup> pCi/m<sup>3</sup>]**

Period	Station		Station		Station		Station		Station		Station		Station		
Ending	01	02	03	04	05	06	07								
07/09/14	1.36E+01 +/-	2.54E+00	1.10E+01 +/-	2.41E+00	1.13E+01 +/-	2.43E+00	1.16E+01 +/-	2.45E+00	1.29E+01 +/-	2.52E+00	1.28E+01 +/-	2.51E+00	1.23E+01 +/-	2.48E+00	
07/15/14	2.06E+01 +/-	3.34E+00	2.18E+01 +/-	3.40E+00	2.31E+01 +/-	3.46E+00	2.64E+01 +/-	3.61E+00	2.10E+01 +/-	3.35E+00	2.28E+01 +/-	3.44E+00	2.18E+01 +/-	3.40E+00	
07/22/14	8.50E+00 +/-	2.36E+00	1.33E+01 +/-	2.65E+00	1.10E+01 +/-	2.51E+00	1.46E+01 +/-	2.72E+00	1.29E+01 +/-	2.62E+00	9.91E+00 +/-	2.44E+00	1.27E+01 +/-	2.61E+00	
07/29/14	1.60E+01 +/-	2.90E+00	1.19E+01 +/-	2.68E+00	1.21E+01 +/-	2.70E+00	1.74E+01 +/-	3.01E+00	1.23E+01 +/-	2.71E+00	1.55E+01 +/-	2.90E+00	1.46E+01 +/-	2.83E+00	
08/06/14	1.32E+01 +/-	2.57E+00	1.29E+01 +/-	2.50E+00	1.25E+01 +/-	2.48E+00	1.53E+01 +/-	2.64E+00	1.69E+01 +/-	2.70E+00	1.29E+01 +/-	2.50E+00	1.68E+01 +/-	2.70E+00	
08/14/14	1.84E+01 +/-	2.72E+00	1.72E+01 +/-	2.66E+00	1.62E+01 +/-	2.62E+00	1.99E+01 +/-	2.78E+00	1.79E+01 +/-	2.69E+00	2.02E+01 +/-	2.80E+00	1.53E+01 +/-	2.57E+00	
08/19/14	1.67E+01 +/-	3.75E+00	1.88E+01 +/-	3.87E+00	1.53E+01 +/-	3.67E+00	2.08E+01 +/-	3.98E+00	1.96E+01 +/-	3.92E+00	2.23E+01 +/-	4.07E+00	2.11E+01 +/-	4.00E+00	
08/26/14	1.53E+01 +/-	2.76E+00	1.26E+01 +/-	2.61E+00	1.11E+01 +/-	2.52E+00	1.54E+01 +/-	2.76E+00	1.38E+01 +/-	2.67E+00	1.48E+01 +/-	2.73E+00	1.31E+01 +/-	2.64E+00	
09/02/14	1.55E+01 +/-	2.76E+00	1.49E+01 +/-	2.73E+00	1.25E+01 +/-	2.60E+00	1.34E+01 +/-	2.65E+00	1.68E+01 +/-	2.83E+00	8.58E+00 +/-	2.37E+00	1.56E+01 +/-	2.77E+00	
09/09/14	1.00E+01 +/-	2.78E+00	1.00E+01 +/-	2.74E+00	9.25E+00 +/-	2.66E+00	1.32E+01 +/-	2.90E+00	1.34E+01 +/-	2.90E+00	1.16E+01 +/-	2.81E+00	9.17E+00 +/-	2.69E+00	
09/16/14	9.37E+00 +/-	2.44E+00	1.15E+01 +/-	2.57E+00	1.05E+01 +/-	2.51E+00	1.20E+01 +/-	2.60E+00	1.27E+01 +/-	2.64E+00	8.20E+00 +/-	2.37E+00	1.03E+01 +/-	2.50E+00	
09/23/14	1.95E+01 +/-	2.95E+00	2.13E+01 +/-	3.05E+00	2.15E+01 +/-	3.06E+00	2.62E+01 +/-	3.27E+00	1.54E+01 +/-	2.75E+00	*	<	*	1.94E+01 +/-	2.96E+00
09/30/14	1.11E+01 +/-	2.65E+00	1.28E+01 +/-	2.72E+00	1.48E+01 +/-	2.78E+00	1.71E+01 +/-	2.92E+00	1.40E+01 +/-	2.78E+00	1.82E+01 +/-	3.00E+00	1.19E+01 +/-	2.67E+00	
10/07/14	2.14E+01 +/-	3.02E+00	5.33E+00 +/-	2.08E+00	1.59E+01 +/-	2.79E+00	2.04E+01 +/-	3.00E+00	2.03E+01 +/-	2.99E+00	2.72E+01 +/-	3.31E+00	1.95E+01 +/-	2.94E+00	
10/14/14	1.75E+01 +/-	2.84E+00	1.79E+01 +/-	2.91E+00	1.71E+01 +/-	2.89E+00	1.91E+01 +/-	2.97E+00	2.01E+01 +/-	3.02E+00	2.32E+01 +/-	3.16E+00	1.57E+01 +/-	2.78E+00	
10/21/14	9.43E+00 +/-	2.34E+00	9.17E+00 +/-	2.32E+00	1.06E+01 +/-	2.40E+00	8.42E+00 +/-	2.27E+00	1.14E+01 +/-	2.45E+00	1.06E+01 +/-	2.41E+00	1.12E+01 +/-	2.45E+00	
10/28/14	9.83E+00 +/-	2.35E+00	1.15E+01 +/-	2.43E+00	1.28E+01 +/-	2.55E+00	8.99E+00 +/-	2.31E+00	1.52E+01 +/-	2.68E+00	1.51E+01 +/-	2.67E+00	1.27E+01 +/-	2.53E+00	
11/05/14	2.10E+01 +/-	2.93E+00	1.99E+01 +/-	2.87E+00	1.87E+01 +/-	2.80E+00	1.82E+01 +/-	2.78E+00	1.13E+01 +/-	2.42E+00	1.78E+01 +/-	2.76E+00	1.97E+01 +/-	2.86E+00	
11/12/14	1.46E+01 +/-	2.84E+00	1.72E+01 +/-	2.98E+00	1.52E+01 +/-	2.88E+00	1.35E+01 +/-	2.79E+00	9.80E+00 +/-	2.59E+00	1.56E+01 +/-	2.90E+00	1.54E+01 +/-	2.90E+00	
11/18/14	1.01E+01 +/-	3.10E+00	8.46E+00 +/-	2.90E+00	1.39E+01 +/-	3.21E+00	9.46E+00 +/-	2.99E+00	7.93E+00 +/-	2.86E+00	6.96E+00 +/-	2.80E+00	9.61E+00 +/-	2.97E+00	
11/26/14	2.06E+01 +/-	2.78E+00	2.03E+01 +/-	2.79E+00	1.84E+01 +/-	2.64E+00	2.15E+01 +/-	2.81E+00	1.63E+01 +/-	2.59E+00	1.75E+01 +/-	2.65E+00	1.36E+01 +/-	2.46E+00	
12/02/14	1.79E+01 +/-	3.20E+00	1.52E+01 +/-	3.08E+00	1.66E+01 +/-	3.26E+00	1.78E+01 +/-	3.26E+00	1.57E+01 +/-	3.13E+00	1.63E+01 +/-	3.16E+00	1.29E+01 +/-	2.95E+00	
12/09/14	2.23E+01 +/-	3.05E+00	1.55E+01 +/-	2.71E+00	2.18E+01 +/-	3.03E+00	1.80E+01 +/-	2.84E+00	1.55E+01 +/-	2.71E+00	1.64E+01 +/-	2.76E+00	9.83E+00 +/-	2.38E+00	
12/16/14	1.86E+01 +/-	2.96E+00	1.14E+01 +/-	2.57E+00	1.76E+01 +/-	2.90E+00	1.87E+01 +/-	2.96E+00	1.75E+01 +/-	2.89E+00	1.38E+01 +/-	2.70E+00	1.62E+01 +/-	2.83E+00	
12/23/14	1.60E+01 +/-	2.76E+00	1.44E+01 +/-	2.67E+00	1.49E+01 +/-	2.70E+00	1.94E+01 +/-	2.94E+00	1.36E+01 +/-	2.63E+00	1.53E+01 +/-	2.72E+00	1.36E+01 +/-	2.63E+00	
12/30/14	1.54E+01 +/-	2.81E+00	1.16E+01 +/-	2.63E+00	1.62E+01 +/-	2.89E+00	1.19E+01 +/-	2.65E+00	1.30E+01 +/-	2.71E+00	1.34E+01 +/-	2.72E+00	1.39E+01 +/-	2.75E+00	
<b>MEAN</b>	<b>1.547E+01 +/-</b>	<b>3.35E+00</b>	<b>1.41E+01 +/-</b>	<b>2.74E+00</b>	<b>1.45E+01 +/-</b>	<b>2.77E+00</b>	<b>1.67E+01 +/-</b>	<b>2.88E+00</b>	<b>1.47E+01 +/-</b>	<b>2.77E+00</b>	<b>1.56E+01 +/-</b>	<b>2.82E+00</b>	<b>1.54E+01 +/-</b>	<b>2.82E+00</b>	

\* Sample not obtained due to sampler not operating

**Table 3-3**  
**Air Particulate**  
**Gross Beta Radioactivity**  
**[10<sup>-3</sup> pCi/m<sup>3</sup>]**

Period	Station		Station		Station		Station		Station		Station							
Ending	21		22		23		24**		01A		05A							
07/09/14	1.19E+01	+/-	2.47E+00	1.24E+01	+/-	2.49E+00	1.41E+01	+/-	2.57E+00	1.27E+01	+/-	2.51E+00	1.25E+01	+/-	2.48E+00	1.17E+01	+/-	2.46E+00
07/15/14	2.08E+01	+/-	3.34E+00	1.95E+01	+/-	3.27E+00	2.42E+01	+/-	3.53E+00	1.80E+01	+/-	3.19E+00	2.21E+01	+/-	3.42E+00	2.08E+01	+/-	3.34E+00
07/22/14	1.04E+01	+/-	2.48E+00	1.42E+01	+/-	2.69E+00	1.12E+01	+/-	2.52E+00	1.37E+01	+/-	2.67E+00	1.26E+01	+/-	2.60E+00	1.20E+01	+/-	2.57E+00
07/29/14	1.62E+01	+/-	2.91E+00	1.39E+01	+/-	2.80E+00	1.81E+01	+/-	3.01E+00	1.38E+01	+/-	2.79E+00	1.46E+01	+/-	2.83E+00	1.27E+01	+/-	2.77E+00
08/06/14	1.39E+01	+/-	2.55E+00	1.31E+01	+/-	2.51E+00	1.61E+01	+/-	2.66E+00	1.19E+01	+/-	2.44E+00	1.52E+01	+/-	2.67E+00	1.31E+01	+/-	2.51E+00
08/14/14	1.30E+01	+/-	2.45E+00	1.78E+01	+/-	2.69E+00	1.70E+01	+/-	2.65E+00	1.51E+01	+/-	2.56E+00	2.04E+01	+/-	2.82E+00	1.46E+01	+/-	2.53E+00
08/19/14	1.72E+01	+/-	3.78E+00	1.95E+01	+/-	3.91E+00	1.73E+01	+/-	3.79E+00	1.96E+01	+/-	3.93E+00	3.26E+01	+/-	4.14E+00	1.54E+01	+/-	3.68E+00
08/26/14	1.26E+01	+/-	2.61E+00	1.51E+01	+/-	2.74E+00	1.53E+01	+/-	2.75E+00	1.11E+01	+/-	2.52E+00	1.53E+01	+/-	2.75E+00	1.44E+01	+/-	2.70E+00
09/02/14	1.53E+01	+/-	2.76E+00	1.41E+01	+/-	2.69E+00	1.96E+01	+/-	2.97E+00	1.63E+01	+/-	2.81E+00	1.18E+01	+/-	2.56E+00	1.31E+01	+/-	2.64E+00
09/09/14	1.24E+01	+/-	2.83E+00	9.57E+00	+/-	2.68E+00	1.29E+01	+/-	2.91E+00	1.11E+01	+/-	2.74E+00	1.19E+01	+/-	2.87E+00	8.14E+00	+/-	2.61E+00
09/16/14	1.38E+01	+/-	2.70E+00	1.08E+01	+/-	2.53E+00	1.28E+01	+/-	2.63E+00	1.27E+01	+/-	2.64E+00	1.02E+01	+/-	2.49E+00	1.97E+01	+/-	3.00E+00
09/23/14	2.50E+01	+/-	3.21E+00	2.11E+01	+/-	3.03E+00	2.85E+01	+/-	3.39E+00	2.72E+01	+/-	3.32E+00	2.71E+01	+/-	3.31E+00	2.41E+01	+/-	3.18E+00
09/30/14	1.32E+01	+/-	2.74E+00	1.47E+01	+/-	2.82E+00	1.48E+01	+/-	2.82E+00	1.44E+01	+/-	2.80E+00	1.43E+01	+/-	2.82E+00	1.18E+01	+/-	2.66E+00
10/07/14	1.65E+01	+/-	2.77E+00	1.73E+01	+/-	2.82E+00	2.32E+01	+/-	3.12E+00	2.43E+01	+/-	3.18E+00	1.91E+01	+/-	2.90E+00	1.47E+01	+/-	2.68E+00
10/14/14	1.97E+01	+/-	3.03E+00	1.60E+01	+/-	2.83E+00	2.36E+01	+/-	3.15E+00	1.72E+01	+/-	2.91E+00	1.82E+01	+/-	2.88E+00	1.81E+01	+/-	2.93E+00
10/21/14	5.91E+00	+/-	2.10E+00	1.12E+01	+/-	2.45E+00	1.30E+01	+/-	2.56E+00	1.18E+01	+/-	2.48E+00		<	2.70E+00	1.06E+01	+/-	2.40E+00
10/28/14	1.29E+01	+/-	2.55E+00	1.32E+01	+/-	2.57E+00	1.51E+01	+/-	2.67E+00	1.36E+01	+/-	2.59E+00	*	<	*	1.27E+01	+/-	2.54E+00
11/05/14	2.12E+01	+/-	2.92E+00	1.92E+01	+/-	2.82E+00	1.85E+01	+/-	2.80E+00	1.94E+01	+/-	2.83E+00	1.83E+01	+/-	2.80E+00	1.57E+01	+/-	2.65E+00
11/12/14	1.89E+01	+/-	3.07E+00	1.57E+01	+/-	2.91E+00	2.25E+01	+/-	3.23E+00	1.73E+01	+/-	2.99E+00	1.76E+01	+/-	2.99E+00	1.30E+01	+/-	2.77E+00
11/18/14	1.06E+01	+/-	3.02E+00	1.07E+01	+/-	3.03E+00	1.23E+01	+/-	3.13E+00	1.18E+01	+/-	3.08E+00	7.63E+00	+/-	2.95E+00	1.03E+01	+/-	3.01E+00
11/26/14	2.14E+01	+/-	2.82E+00	2.35E+01	+/-	2.91E+00	2.51E+01	+/-	3.01E+00	2.36E+01	+/-	2.90E+00	2.02E+01	+/-	2.76E+00	2.11E+01	+/-	2.81E+00
12/02/14	1.41E+01	+/-	3.06E+00	1.55E+01	+/-	3.14E+00	1.66E+01	+/-	3.15E+00	1.80E+01	+/-	3.31E+00	1.11E+01	+/-	2.81E+00	1.28E+01	+/-	2.96E+00
12/09/14	1.99E+01	+/-	2.94E+00	1.83E+01	+/-	2.86E+00	2.15E+01	+/-	3.01E+00	2.38E+01	+/-	3.13E+00	2.25E+01	+/-	3.06E+00	1.76E+01	+/-	2.82E+00
12/16/14	1.54E+01	+/-	2.79E+00	1.82E+01	+/-	2.93E+00	1.49E+01	+/-	2.77E+00	1.99E+01	+/-	3.02E+00	1.93E+01	+/-	2.99E+00	1.43E+01	+/-	2.73E+00
12/23/14	1.57E+01	+/-	2.75E+00	1.61E+01	+/-	2.77E+00	1.06E+01	+/-	2.46E+00	1.70E+01	+/-	2.81E+00	1.38E+01	+/-	2.64E+00	1.50E+01	+/-	2.71E+00
12/30/14	1.26E+01	+/-	2.70E+00	1.22E+01	+/-	2.68E+00	1.46E+01	+/-	2.79E+00	1.08E+01	+/-	2.59E+00	8.86E+00	+/-	2.46E+00	1.30E+01	+/-	2.71E+00
<b>MEAN</b>	1.47E+01	+/-	2.77E+00	1.53E+01	+/-	2.81E+00	1.74E+01	+/-	2.91E+00	1.62E+01	+/-	2.86E+00	1.60E+01	+/-	2.84E+00	1.46E+01	+/-	2.77E+00
															<b>Mean - All Indicator Locations</b>	1.54E+01	+/-	2.85E+00

\* Sample not obtained due to sampler not operating.

\*\* Control Station

**Table 3-4**  
**Airborne Iodine**  
**I-131**  
**[10<sup>-3</sup> pCi/m<sup>3</sup>]**

Period Ending	Station 01	Station 02	Station 03	Station 04	Station 05	Station 06	Station 07
01/08/14	< 5.60E+01	< 4.64E+01	< 4.80E+01	< 4.71E+01	< 3.64E+01	< 3.61E+01	< 3.60E+01
01/14/14	< 1.57E+01	< 4.05E+01	< 4.06E+01	< 4.05E+01	< 4.05E+01	< 3.17E+01	< 3.17E+01
01/21/14	< 3.93E+01	< 3.93E+01	< 3.93E+01	< 3.93E+01	< 4.24E+01	< 4.24E+01	< 4.24E+01
01/28/14	< 1.57E+01	< 3.72E+01	< 3.70E+01	< 3.72E+01	< 3.72E+01	< 3.54E+01	< 3.54E+01
02/04/14	< 3.92E+01	< 1.65E+01	< 3.91E+01	< 3.92E+01	< 3.86E+01	< 3.86E+01	< 3.86E+01
02/11/14	< 3.01E+01	< 3.01E+01	< 3.01E+01	< 3.01E+01	< 3.26E+01	< 3.26E+01	< 3.26E+01
02/18/14	< 4.11E+01	< 4.15E+01	< 4.09E+01	< 4.18E+01	< 3.63E+01	< 3.65E+01	< 3.66E+01
02/26/14	< 1.01E+01	< 2.59E+01	< 2.63E+01	< 2.57E+01	< 2.61E+01	< 2.56E+01	< 2.55E+01
03/05/14	< 4.20E+01	< 4.20E+01	< 4.20E+01	< 4.20E+01	< 4.69E+01	< 4.69E+01	< 4.69E+01
03/12/14	* < *	< 2.47E+01	< 2.47E+01	< 2.47E+01	< 2.47E+01	< 3.91E+00	< 2.53E+01
03/19/14	* < *	< 3.03E+01	< 2.98E+01	< 3.05E+01	< 3.01E+01	< 2.96E+01	< 2.97E+01
03/26/14	< 1.62E+01	< 4.07E+01	< 4.20E+01	< 3.96E+01	< 4.05E+01	< 5.07E+01	< 5.07E+01
04/02/14	< 1.08E+01	< 2.82E+01	< 2.95E+01	< 2.87E+01	< 2.85E+01	< 2.88E+01	< 2.87E+01
04/08/14	< 2.26E+01	< 3.82E+01	< 3.82E+01	< 3.82E+01	< 3.82E+01	< 4.15E+01	< 4.15E+01
04/16/14	< 3.54E+01	< 2.10E+01	< 3.54E+01	< 3.53E+01	< 3.53E+01	< 3.87E+01	< 3.87E+01
04/22/14	< 1.97E+01	< 5.06E+01	< 5.04E+01	< 5.06E+01	< 5.06E+01	< 6.42E+01	< 6.42E+01
04/29/14	< 5.70E+01	< 5.59E+01	< 2.13E+01	< 5.57E+01	* < *	< 5.56E+01	< 5.98E+01
05/06/14	< 1.22E+01	< 3.21E+01	< 3.28E+01	< 3.23E+01	< 3.24E+01	< 2.69E+01	< 2.68E+01
05/13/14	< 2.75E+01	< 2.75E+01	< 2.77E+01	< 1.07E+01	< 2.76E+01	< 3.40E+01	< 3.40E+01
05/21/14	< 9.93E+00	< 2.56E+01	< 2.55E+01	< 2.55E+01	< 2.55E+01	< 2.69E+01	< 2.69E+01
05/27/14	< 3.41E+01	< 3.41E+01	< 3.40E+01	< 3.41E+01	< 1.13E+01	< 2.69E+01	< 2.69E+01
06/04/14	< 3.43E+01	< 3.43E+01	< 3.43E+01	< 3.43E+01	< 3.94E+01	< 3.94E+01	< 3.94E+01
06/10/14	< 3.00E+01	< 2.81E+01	< 2.82E+01	< 2.82E+01	< 3.73E+01	< 1.56E+01	< 3.73E+01
06/18/14	< 1.47E+01	< 3.51E+01	< 3.48E+01	< 3.48E+01	< 3.48E+01	< 3.58E+01	< 4.25E+01
06/24/14	< 4.14E+01	< 4.27E+01	< 4.21E+01	< 4.22E+01	< 3.86E+01	< 3.84E+01	< 1.66E+01
07/01/14	< 1.34E+01	< 3.41E+01	< 3.39E+01	< 3.40E+01	< 3.40E+01	< 3.18E+01	< 3.18E+01

\* Sample not obtained due to sampler not operating

**Table 3-4**  
**Airborne Iodine**  
**I-131**  
**[10<sup>-3</sup> pCi/m<sup>3</sup>]**

Period Ending	Station 21	Station 22	Station 23	Station 24*	Station 01A	Station 05A
01/08/14	< 1.53E+01	< 3.65E+01	< 4.06E+01	< 4.19E+01	< 4.02E+01	< 4.13E+01
01/14/14	< 3.18E+01	< 3.18E+01	< 3.33E+01	< 3.33E+01	< 3.33E+01	< 3.33E+01
01/21/14	< 4.24E+01	< 1.42E+01	< 3.39E+01	< 3.40E+01	< 3.39E+01	< 3.39E+01
01/28/14	< 3.53E+01	< 3.53E+01	< 4.00E+01	< 3.99E+01	< 4.00E+01	< 4.00E+01
02/04/14	< 3.85E+01	< 4.26E+01	< 1.51E+01	< 4.26E+01	< 4.27E+01	< 4.27E+01
02/11/14	< 3.26E+01	< 1.28E+01	< 3.05E+01	< 3.05E+01	< 3.05E+01	< 3.05E+01
02/18/14	< 3.66E+01	< 3.83E+01	< 3.81E+01	< 1.60E+01	< 3.81E+01	< 3.79E+01
02/26/14	< 2.56E+01	< 2.54E+01	< 2.39E+01	< 2.39E+01	< 2.39E+01	< 2.40E+01
03/05/14	< 4.69E+01	< 3.40E+01	< 3.40E+01	< 3.40E+01	< 1.42E+01	< 3.40E+01
03/12/14	< 2.53E+01	< 2.53E+01	< 2.53E+01	< 2.57E+01	< 2.57E+01	< 2.57E+01
03/19/14	< 2.96E+01	< 2.48E+01	< 2.48E+01	< 2.48E+01	< 2.48E+01	< 1.03E+01
03/26/14	< 5.01E+01	< 5.01E+01	< 4.47E+01	< 4.36E+01	< 4.57E+01	< 4.46E+01
04/02/14	< 2.91E+01	< 2.90E+01	< 2.85E+01	< 2.95E+01	< 2.81E+01	< 2.90E+01
04/08/14	< 4.16E+01	< 4.16E+01	< 3.67E+01	< 3.70E+01	< 3.67E+01	< 3.69E+01
04/16/14	< 3.87E+01	< 3.87E+01	< 3.39E+01	< 3.38E+01	< 3.39E+01	< 3.38E+01
04/22/14	< 6.40E+01	< 6.40E+01	< 4.84E+01	< 4.82E+01	< 4.84E+01	< 4.84E+01
04/29/14	< 5.91E+01	< 5.92E+01	< 6.06E+01	< 6.38E+01	< 6.65E+01	< 6.47E+01
05/06/14	< 2.64E+01	< 2.71E+01	< 3.69E+01	< 3.73E+01	< 3.58E+01	< 3.68E+01
05/13/14	< 3.42E+01	< 3.42E+01	< 3.87E+01	< 3.88E+01	< 3.87E+01	< 3.88E+01
05/21/14	< 2.68E+01	< 2.68E+01	< 2.64E+01	< 2.67E+01	< 2.80E+01	< 2.63E+01
05/27/14	< 2.68E+01	< 2.68E+01	< 3.77E+01	< 3.77E+01	< 3.77E+01	< 3.77E+01
06/04/14	< 3.93E+01	< 1.04E+01	< 2.49E+01	< 2.48E+01	< 2.49E+01	< 2.49E+01
06/10/14	< 3.76E+01	< 3.73E+01	< 3.80E+01	< 3.83E+01	< 3.89E+01	< 3.83E+01
06/18/14	< 3.53E+01	< 3.53E+01	< 2.61E+01	< 2.59E+01	< 2.61E+01	< 2.59E+01
06/24/14	< 3.86E+01	< 3.87E+01	< 5.38E+01	< 5.36E+01	< 5.29E+01	< 5.36E+01
07/01/14	< 3.16E+01	< 3.16E+01	< 3.05E+01	< 3.03E+01	< 3.07E+01	< 3.03E+01

\* Control Station

**Table 3-4**  
**Airborne Iodine**  
**I-131**  
**[10<sup>-3</sup> pCi/m<sup>3</sup>]**

Period Ending	Station 01	Station 02	Station 03	Station 04	Station 05	Station 06	Station 07
07/09/14	< 4.87E+01	< 4.89E+01	< 4.90E+01	< 4.90E+01	< 5.57E+01	< 5.55E+01	< 5.55E+01
07/15/14	< 2.44E+01	< 6.25E+01	< 6.24E+01	< 6.23E+01	< 6.23E+01	< 6.63E+01	< 6.64E+01
07/22/14	< 5.18E+01	< 5.18E+01	< 5.18E+01	< 5.18E+01	< 5.16E+01	< 5.16E+01	< 5.16E+01
07/29/14	< 6.01E+01	< 6.01E+01	< 6.02E+01	< 6.13E+01	< 6.51E+01	< 5.52E+01	< 5.51E+01
08/06/14	< 2.43E+01	< 2.37E+01	< 2.36E+01	< 2.39E+01	< 2.70E+01	< 2.70E+01	< 2.70E+01
08/14/14	< 3.11E+01	< 3.11E+01	< 3.12E+01	< 3.08E+01	< 3.96E+01	< 3.96E+01	< 3.97E+01
08/19/14	< 5.43E+01	< 5.43E+01	< 5.43E+01	< 5.43E+01	< 6.34E+01	< 3.64E+01	< 3.64E+01
08/26/14	< 1.98E+01	< 5.10E+01	< 5.10E+01	< 5.10E+01	< 5.10E+01	< 4.91E+01	< 4.91E+01
09/02/14	< 6.09E+01	< 6.09E+01	< 6.09E+01	< 6.09E+01	< 6.49E+01	< 6.49E+01	< 6.49E+01
09/09/14	< 1.70E+01	< 4.30E+01	< 4.22E+01	< 4.29E+01	< 4.26E+01	< 3.70E+01	< 3.71E+00
09/16/14	< 3.09E+01	< 3.09E+01	< 3.08E+01	< 3.10E+01	< 1.75E+01	< 1.75E+01	< 1.75E+01
09/23/14	< 2.51E+01	< 6.50E+01	< 6.50E+01	< 6.47E+01	< 6.49E+01	*	< 6.85E+01
09/30/14	< 2.10E+01	< 5.35E+01	< 5.25E+01	< 5.30E+01	< 5.35E+01	< 6.44E+01	< 6.44E+01
10/07/14	< 1.88E+01	< 4.89E+01	< 4.99E+01	< 4.94E+01	< 4.90E+01	< 5.28E+01	< 5.28E+01
10/14/14	< 1.58E+01	< 6.30E+00	< 1.65E+01	< 1.62E+01	< 1.63E+01	< 1.84E+01	< 1.83E+01
10/21/14	< 9.73E+00	< 2.50E+01	< 2.49E+01	< 2.49E+01	< 2.49E+01	< 2.80E+01	< 2.80E+01
10/28/14	< 3.21E+01	< 3.21E+01	< 3.23E+01	< 3.23E+01	< 3.14E+01	< 3.14E+01	< 3.14E+01
11/05/14	< 1.44E+01	< 3.42E+01	< 3.40E+01	< 3.41E+01	< 3.41E+01	< 2.73E+01	< 2.73E+01
11/12/14	< 2.25E+01	< 2.27E+01	< 8.82E+00	< 2.27E+01	< 2.27E+01	< 1.24E+01	< 2.96E+01
11/18/14	< 2.69E+01	< 2.57E+01	< 9.96E+00	< 2.60E+01	< 2.57E+01	< 1.22E+01	< 2.91E+01
11/26/14	< 2.18E+01	< 4.99E+01	< 4.84E+01	< 4.89E+01	< 4.97E+01	< 1.67E+01	< 4.74E+01
12/02/14	< 2.21E+01	< 5.77E+01	< 6.04E+01	< 5.86E+01	< 5.83E+01	< 2.73E+01	< 6.48E+01
12/09/14	< 6.87E+00	< 1.96E+01	< 1.96E+01	< 1.96E+01	< 1.96E+01	< 1.26E+01	< 2.44E+01
12/16/14	< 4.10E+00	< 1.05E+01	< 1.05E+01	< 1.05E+01	< 1.05E+01	< 4.43E+00	< 1.06E+01
12/23/14	< 2.73E+01	< 2.73E+01	< 2.73E+01	< 1.06E+01	< 2.73E+01	< 6.02E+01	< 6.02E+01
12/30/14	< 1.95E+01	< 1.97E+01	< 1.98E+01	< 1.98E+01	< 8.77E+00	< 2.03E+01	< 2.03E+01
Mean	#DIV/0! +/- 1.67E+01	#DIV/0! +/- 3.32E+01	#DIV/0! +/- 3.39E+01	#DIV/0! +/- 3.35E+01	#DIV/0! +/- 3.34E+01	#DIV/0! +/- 3.52E+01	#DIV/0! +/- 3.51E+01

\* Sample not obtained due to sampler not operating.

**Table 3-4**  
**Airborne Iodine**  
**I-131**  
**[10<sup>-3</sup> pCi/m<sup>3</sup>]**

Period Ending	Station 21	Station 22	Station 23	Station 24**	Station 01A	Station 05A
07/09/14	< 2.34E+01	< 5.57E+01	< 5.83E+01	< 5.86E+01	< 5.83E+01	< 5.86E+01
07/15/14	< 6.63E+01	< 6.63E+01	< 5.39E+01	< 5.36E+01	< 5.39E+01	< 5.35E+01
07/22/14	< 5.16E+01	< 2.21E+01	< 5.27E+01	< 5.27E+01	< 5.27E+01	< 5.27E+01
07/29/14	< 5.52E+01	< 5.52E+01	< 5.51E+01	< 5.52E+01	< 5.51E+01	< 2.36E+01
08/06/14	< 2.69E+01	< 2.67E+01	< 1.12E+01	< 2.66E+01	< 2.74E+01	< 2.67E+01
08/14/14	< 3.98E+01	< 3.32E+01	< 3.31E+01	< 1.17E+01	< 3.31E+01	< 3.31E+01
08/19/14	< 6.33E+01	< 5.38E+01	< 5.39E+01	< 5.41E+01	< 2.26E+01	< 5.39E+01
08/26/14	< 4.91E+01	< 4.91E+01	< 5.05E+01	< 5.05E+01	< 5.05E+01	< 5.05E+01
09/02/14	< 6.49E+01	< 4.52E+01	< 4.52E+01	< 4.52E+01	< 1.90E+01	< 4.52E+01
09/09/14	< 3.66E+01	< 3.67E+01	< 4.72E+01	< 4.56E+01	< 4.75E+01	< 4.62E+01
09/16/14	< 1.76E+01	< 3.38E+01	< 3.37E+01	< 3.39E+01	< 3.38E+01	< 1.42E+01
09/23/14	< 6.82E+01	< 6.83E+01	< 6.69E+01	< 6.66E+01	< 6.65E+01	< 6.66E+01
09/30/14	< 6.45E+01	< 6.45E+01	< 6.18E+01	< 6.18E+01	< 6.23E+01	< 6.18E+01
10/07/14	< 5.27E+01	< 5.28E+01	< 5.51E+01	< 5.52E+01	< 5.47E+01	< 5.52E+01
10/14/14	< 1.86E+01	< 1.86E+01	< 1.73E+01	< 1.80E+01	< 1.72E+01	< 1.77E+01
10/21/14	< 2.79E+01	< 2.79E+01	< 3.01E+01	< 3.00E+01	< 3.01E+01	< 3.00E+01
10/28/14	< 3.15E+01	< 3.73E+01	< 3.70E+01	< 3.72E+01	* < *	< 1.56E+01
11/05/14	< 2.72E+01	< 2.72E+01	< 2.64E+01	< 2.62E+01	< 2.64E+01	< 2.63E+01
11/12/14	< 2.96E+01	< 2.96E+01	< 2.95E+01	< 1.55E+01	< 2.83E+01	< 2.85E+01
11/18/14	< 2.91E+01	< 2.91E+01	< 2.92E+01	< 3.39E+01	< 3.55E+01	< 3.41E+01
11/26/14	< 4.68E+01	< 4.68E+01	< 4.77E+01	< 5.09E+01	< 5.11E+01	< 5.15E+01
12/02/14	< 6.60E+01	< 6.60E+01	< 6.43E+01	< 4.59E+01	< 4.40E+01	< 4.50E+01
12/09/14	< 2.44E+01	< 2.44E+01	< 2.43E+01	< 1.57E+01	< 1.57E+01	< 1.57E+01
12/16/14	< 1.06E+01	< 1.06E+01	< 1.06E+01	< 1.20E+01	< 1.21E+01	< 1.20E+01
12/23/14	< 6.01E+01	< 6.01E+01	< 5.11E+01	< 5.10E+01	< 5.11E+01	< 5.11E+01
12/30/14	< 2.05E+01	< 2.05E+01	< 2.10E+01	< 2.12E+01	< 2.09E+01	< 2.11E+01
MEAN	#DIV/0! +/- 3.54E+01	#DIV/0! +/- 3.53E+01	#DIV/0! +/- 3.26E+01	#DIV/0! +/- 3.33E+01	#DIV/0! +/- 3.29E+01	#DIV/0! +/- 3.30E+01
				Indicator Locations Mean		#DIV/0! +/- 3.25E+01

\* Sample not obtained due to sampler not operating.

\*\* Control Station

**Table 3-5**  
**Airborne Particulate**  
**Gamma Spectra**  
 $[10^{-3} \text{ pCi/m}^3]$

							Quarter 1
Sampling Location	Be-7		Cs-134*	Cs-137*			
01	1.32E+02	+/- 3.32E+01	< 1.81E+00	< 1.77E+00			
01A	1.28E+02	+/- 2.22E+01	< 1.06E+00	< 1.08E+00			
02	1.20E+02	+/- 2.13E+01	< 1.04E+00	< 1.12E+00			
03	1.22E+02	+/- 2.00E+01	< 1.18E+00	< 9.24E-01			
04	1.58E+02	+/- 2.50E+01	< 1.27E+00	< 1.21E+00			
05	1.19E+02	+/- 2.50E+01	< 1.35E+00	< 1.38E+00			
05A	1.12E+02	+/- 1.85E+01	< 1.03E+00	< 9.68E-01			
06	1.37E+02	+/- 2.56E+01	< 1.26E+00	< 1.34E+00			
07	1.23E+02	+/- 2.38E+01	< 1.27E+00	< 1.01E+00			
21	1.11E+02	+/- 2.67E+01	< 1.65E+00	< 1.88E+00			
22	1.38E+02	+/- 3.39E+01	< 1.59E+00	< 1.37E+00			
23	1.26E+02	+/- 3.27E+01	< 1.96E+00	< 1.81E+00			
24	1.51E+02	+/- 2.67E+01	< 1.96E+00	< 1.78E+00			

							Quarter 2
Sampling Location	Be-7		Cs-134*	Cs-137*	Sr-89	Sr-90	
01	1.32E+02	+/- 2.21E+01	< 1.06E+00	< 8.70E-01	< 5.62E+00	< 2.79E+00	
01A	1.22E+02	+/- 3.32E+01	< 1.57E+00	< 1.62E+00	< 7.39E+00	< 1.74E+00	
02	1.26E+02	+/- 2.40E+01	< 1.52E+00	< 1.09E+00	< 5.58E+00	< 2.37E+00	
03	1.64E+02	+/- 3.56E+01	< 1.89E+00	< 1.39E+00	< 8.10E+00	< 3.68E+00	
04	1.20E+02	+/- 2.09E+01	< 1.06E+00	< 1.00E+00	< 6.86E+00	< 4.33E+00	
05	1.28E+02	+/- 2.87E+01	< 1.32E+00	< 1.12E+00	< 7.95E+00	< 3.54E+00	
05A	1.07E+02	+/- 2.44E+01	< 1.37E+00	< 1.26E+00	< 9.29E+00	< 2.05E+00	
06	1.15E+02	+/- 2.26E+01	< 1.19E+00	< 1.31E+00	< 6.78E+00	< 2.71E+00	
07	1.26E+02	+/- 2.11E+01	< 1.07E+00	< 7.29E-01	< 5.34E+00	< 2.43E+00	
21	1.27E+02	+/- 2.81E+01	< 1.60E+00	< 1.58E+00	< 5.47E+00	< 2.89E+00	
22	1.48E+02	+/- 2.53E+01	< 1.15E+00	< 1.07E+00	< 7.88E+00	< 2.80E+00	
23	1.10E+02	+/- 2.71E+01	< 1.11E+00	< 1.09E+00	< 5.73E+00	< 2.53E+00	
24**	1.26E+02	+/- 2.23E+01	< 1.13E+00	< 9.29E-01	< 7.02E+00	< 2.22E+00	

\* LLD identified in the ODCM

\*\* Control Station

**Table 3-5**  
**Airborne Particulate**  
**Gamma Spectra**  
 $[10^{-3} \text{ pCi/m}^3]$

page  
2 of 2

Quarter 3

Sampling Location	Be-7		Cs-134*	Cs-137*
01	1.35E+02	+/- 2.41E+01	< 1.04E+00	< 9.01E-01
01A	1.12E+02	+/- 2.46E+01	< 1.08E+00	< 1.09E+00
02	8.50E+01	+/- 1.87E+01	< 1.24E+00	< 9.77E-01
03	1.10E+02	+/- 2.34E+01	< 5.68E-01	< 6.42E-01
04	9.76E+01	+/- 1.83E+01	< 1.01E+00	< 9.73E-01
05	9.50E+01	+/- 2.87E+01	< 1.74E+00	< 1.56E+00
05A	9.79E+01	+/- 2.50E+01	< 1.48E+00	< 1.03E+00
06	1.07E+02	+/- 2.50E+01	< 1.71E+00	< 1.16E+00
07	1.08E+02	+/- 2.61E+01	< 6.87E-01	< 8.22E-01
21	1.12E+02	+/- 2.48E+01	< 1.25E+00	< 1.16E+00
22	1.26E+02	+/- 3.75E+01	< 1.89E+00	< 1.82E+00
23	1.04E+02	+/- 2.44E+01	< 1.21E+00	< 1.24E+00
24*	1.19E+02	+/- 3.31E+01	< 2.34E+00	< 1.41E+00

MEAN

Sampling Location	Be-7		Cs-134*	Cs-137*	MEAN Be-7	
01	1.16E+02	+/- 3.02E+01	< 1.33E+00	< 1.31E+00	1.29E+02	+/- 2.74E+01
01A	9.61E+01	+/- 3.08E+01	< 1.71E+00	< 1.78E+00	1.15E+02	+/- 2.77E+01
02	8.65E+01	+/- 2.08E+01	< 1.49E+00	< 1.10E+00	1.04E+02	+/- 2.12E+01
03	1.21E+02	+/- 2.78E+01	< 2.00E+00	< 1.62E+00	1.29E+02	+/- 2.67E+01
04	1.28E+02	+/- 2.60E+01	< 9.88E-01	< 1.06E+00	1.26E+02	+/- 2.26E+01
05	1.08E+02	+/- 2.64E+01	< 1.98E+00	< 1.45E+00	1.13E+02	+/- 2.72E+01
05A	9.19E+01	+/- 2.06E+01	< 1.04E+00	< 8.85E-01	1.02E+02	+/- 2.21E+01
06	9.17E+01	+/- 2.09E+01	< 1.14E+00	< 8.84E-01	1.13E+02	+/- 2.35E+01
07	1.02E+02	+/- 2.09E+01	< 1.21E+00	< 1.35E+00	1.15E+02	+/- 2.30E+01
21	8.39E+01	+/- 2.45E+01	< 1.10E+00	< 1.19E+00	1.08E+02	+/- 2.60E+01
22	9.71E+01	+/- 2.32E+01	< 1.27E+00	< 9.59E-01	1.27E+02	+/- 3.00E+01
23	8.95E+01	+/- 2.19E+01	< 1.13E+00	< 9.19E-01	1.07E+02	+/- 2.65E+01
24**	1.29E+02	+/- 3.24E+01	< 1.67E+00	< 1.79E+00	1.31E+02	+/- 2.86E+01
Mean of All Indicator Location:					1.16E+02	+/- 2.53E+01

Quarter 4

\* LLD Identified in ODCM

\*\* Control Station



**Table 3-6**  
Soil  
[pCi/kg]

## Triennial Soil Samples Not Required in 2014

**Table 3-7**  
**Precipitation**  
**Gross Beta**  
**[pCi/L]**

page  
1 of 2

Sampling Date	Gross Beta		H-3		Rainfall (inches)
01/28/14	1.12E+01	+/- 1.80E+00	< 7.75E+02		2.99
02/26/14	2.32E+00	+/- 1.32E+00	< 8.85E+02		2.64
03/26/14	5.00E+00	+/- 1.23E+00	< 1.09E+03		2.04
04/29/14		< 1.54E+00	< 1.40E+03		4.58
05/27/14		< 1.32E+00	< 1.16E+03		6.76
06/24/14	2.01E+00	+/- 1.07E+00	< 6.96E+02		6.78
07/29/14	2.44E+00	+/- 1.17E+00	< 1.38E+03		3.84
08/26/14	3.09E+00	+/- 2.07E+00	< 1.57E+03		2.31
09/30/14	2.42E+00	+/- 1.11E+00	< 1.86E+03		0.86
10/28/14	1.64E+00	+/- 1.11E+00	< 1.29E+03		3.35
11/26/14	2.40E+00	+/- 1.12E+00	< 1.44E+03		2.26
12/30/14	2.05E+00	+/- 1.05E+00	< 1.69E+03		3.50
Mean	3.46E+00	+/- 1.41E+00	< 1.27E+03	Total	41.91

**Table 3-7**  
**Precipitation**  
**Gamma Spectra**  
**[pCi/L]**

Sampling Location	Be-7	Mn-54	Fe-59	Co-58	Co-60
01A					
06/24/14	< 3.41E+01	< 7.72E-01	< 1.15E+01	< 2.46E+00	< 8.53E-01
12/30/14	< 4.23E+01	< 1.18E+00	< 9.03E+00	< 2.69E+00	< 1.27E+00
	Zn-65 *	Zr-95	Nb-95	Cs-134	Cs-137
01A					
06/24/14	< 2.10E+00	< 4.95E+00	< 2.87E+00	< 6.58E-01	< 7.33E-01
12/30/14	< 2.37E+00	< 5.77E+00	< 3.31E+00	< 9.70E-01	< 1.08E+00
	Ba-140	La-140	I-131	Th-228	
01A					
06/24/14	< 5.62E+03	< 1.60E+03	< 1.89E+05	< 1.32E+00	
12/30/14	< 2.15E+03	< 7.63E+02	< 2.94E+04	< 2.51E+00	

MEAN

Sampling Location	Be-7	Mn-54	Fe-59	Co-58	Co-60
01A					
01A	Zn-65	Zr-95	Nb-95	Cs-134	Cs-137
01A	Ba-140	La-140	I-131	Th-228	

\* No mean values. All results were <MDA

**Table 3-8**  
**Milk**  
**Gamma Spectra & Strontium**  
**[pCi/L]**

Sampling Date	K-40		Sr-89	Sr-90	I-131*	Cs-134*	Cs-137*	Ba-140*	Station 12A La-140*
01/21/14	1.33E+03	+/- 1.33E+02	[a]	[a]	< 7.92E-01	< 4.62E+00	< 5.12E+00	< 4.14E+01	< 1.36E+01
02/18/14	1.41E+03	+/- 1.27E+02	[a]	[a]	< 8.65E-01	< 4.06E+00	< 5.34E+00	< 2.33E+01	< 7.75E+00
03/19/14	1.39E+03	+/- 7.66E+01	< 3.25E+00	< 8.42E-01	< 9.63E-01	< 1.63E+00	< 2.05E+00	< 1.69E+01	< 5.82E+00
04/16/14	1.39E+03	+/- 1.46E+02	[a]	[a]	< 7.50E-01	< 5.24E+00	< 6.58E+00	< 2.95E+01	< 9.53E+00
05/21/14	1.37E+03	+/- 1.54E+02	[a]	[a]	< 1.00E+00	< 6.13E+00	< 6.42E+00	< 3.63E+01	< 1.21E+01
06/18/14	1.21E+03	+/- 1.64E+02	< 3.31E+00	< 8.19E-01	< 8.13E-01	< 7.73E+00	< 7.64E+00	< 3.47E+01	< 1.06E+01
07/15/14	1.35E+03	+/- 1.53E+02	[a]	[a]	< 7.65E-01	< 8.45E+00	< 8.84E+00	< 4.03E+01	< 1.01E+01
08/19/14	1.23E+03	+/- 1.66E+02	[a]	[a]	< 8.19E-01	< 6.68E+00	< 7.36E+00	< 3.95E+01	< 1.22E+01
09/16/14	1.25E+03	+/- 1.59E+02	< 2.79E+00	< 1.47E+00	< 7.24E-01	< 6.42E+00	< 6.94E+00	< 2.80E+01	< 1.09E+01
10/21/14	1.41E+03	+/- 4.79E+01	[a]	[a]	< 8.53E-01	< 2.49E+00	< 2.52E+00	< 2.45E+01	< 6.39E+00
11/12/14	1.26E+03	+/- 1.98E+02	[a]	[a]	< 9.78E-01	< 7.62E+00	< 7.05E+00	< 3.56E+01	< 8.42E+00
12/16/14	1.46E+03	+/- 1.40E+02	< 3.79E+00	< 1.04E+00	< 9.71E-01	< 5.09E+00	< 6.65E+00	< 4.64E+01	< 1.37E+01
Sta. Mean	1.34E+03	+/- 1.39E+02							

\* LLD identified in ODCM

[a] Sr-89/90 analyses performed on the last monthly sample of each quarter.

**Table 3-9**  
**Food and Vegetation**  
**Gamma Spectra**  

[pCi/kg]

Sampling Location	Sampling Date	Be-7		K-40		I-131*	Cs-134*	Cs-137*
14B	05/13/14	1.17E+03	+/- 2.45E+02	6.74E+03	+/- 5.23E+02	< 3.87E+01	< 2.57E+01	< 2.84E+01
	06/10/14	8.34E+02	+/- 2.76E+02	6.44E+03	+/- 5.44E+02	< 5.64E+01	< 2.70E+01	< 2.72E+01
	07/09/14	9.57E+02	+/- 3.82E+02	8.36E+03	+/- 1.03E+03	< 2.69E+01	< 4.43E+01	< 4.42E+01
	08/14/14	1.19E+03	+/- 4.22E+02	5.92E+03	+/- 8.01E+02	< 4.17E+01	< 3.87E+01	< 3.88E+01
	09/10/13	5.64E+02	+/- 2.18E+02	8.30E+03	+/- 5.60E+02	< 2.49E+01	< 2.34E+01	< 2.46E+01
	10/14/14	1.42E+03	+/- 1.86E+02	7.56E+03	+/- 4.86E+02	< 2.59E+01	< 1.93E+01	< 2.26E+01
	Mean	1.02E+03	+/- 2.88E+02	7.22E+03	+/- 6.57E+02	+/-	+/-	+/-
Sampling Location	Sampling Date	Be-7		K-40		I-131*	Cs-134*	Cs-137*
15	05/13/14	5.80E+02	+/- 1.21E+02	6.54E+03	+/- 3.45E+02	< 3.99E+01	< 1.29E+01	< 1.44E+01
	06/10/14	7.43E+02	+/- 2.44E+02	4.85E+03	+/- 4.93E+02	< 5.26E+01	< 2.24E+01	< 2.39E+01
	07/09/14	4.87E+02	+/- 4.31E+02	6.31E+03	+/- 9.46E+02	< 3.04E+01	< 4.24E+01	< 3.76E+01
	08/14/14	2.68E+03	+/- 5.57E+02	7.39E+03	+/- 1.02E+03	< 4.11E+01	< 2.81E+01	< 3.29E+01
	09/10/13	1.47E+03	+/- 4.11E+02	6.74E+03	+/- 9.14E+02	< 2.81E+01	< 4.16E+01	< 4.69E+01
	10/14/14	3.16E+03	+/- 2.86E+02	5.08E+03	+/- 5.24E+02	< 2.47E+01	< 2.60E+01	< 2.73E+01
	Mean	1.52E+03	+/- 3.42E+02	6.15E+03	+/- 7.07E+02	+/-	+/-	+/-
Sampling Location	Sampling Date	Be-7		K-40		I-131*	Cs-134*	Cs-137*
16**	05/13/14	1.30E+03	+/- 1.53E+02	7.12E+03	+/- 3.85E+02	< 3.58E+01	< 1.61E+01	< 1.76E+01
	06/10/14		< 2.70E+02	5.18E+03	+/- 5.50E+02	< 4.60E+01	< 2.37E+01	< 2.72E+01
	07/09/14	7.28E+02	+/- 5.30E+02	2.91E+03	+/- 8.97E+02	< 3.30E+01	< 5.30E+01	< 5.59E+01
	08/14/14	1.47E+03	+/- 3.84E+02	6.15E+03	+/- 9.36E+02	< 3.26E+01	< 3.11E+01	< 2.95E+01
	09/10/13	6.81E+02	+/- 3.06E+02	1.04E+04	+/- 1.10E+03	< 2.95E+01	< 4.65E+01	< 4.98E+01
	10/14/14	2.45E+03	+/- 2.23E+02	9.85E+03	+/- 4.47E+02	< 2.80E+01	< 1.92E+01	< 2.02E+01
	Mean	1.33E+03	+/- 3.11E+02	6.94E+03	+/- 7.19E+02	+/-	+/-	+/-

\* LLD identified in ODCM

\*\* Control Station

**Table 3-9**  
**Food and Vegetation**  
**Gamma Spectra**  

[pCi/kg]

Sampling Location	Sampling Date	Be-7		K-40		I-131*		Cs-134*	Cs-137*	
23	05/13/14	7.69E+02	+/-	2.22E+02	7.86E+03	+/-	5.22E+02	< 4.15E+01	< 2.65E+01	< 2.91E+01
	06/10/14	1.26E+03	+/-	3.42E+02	5.27E+03	+/-	6.21E+02	< 3.68E+01	< 3.04E+01	< 3.07E+01
	07/09/14	8.85E+02	+/-	4.63E+02	5.43E+03	+/-	9.53E+02	< 4.15E+01	< 5.39E+01	< 5.36E+01
	08/14/14	1.80E+03	+/-	3.82E+02	3.83E+03	+/-	7.65E+02	< 3.62E+01	< 2.22E+01	< 2.48E+01
	09/10/13	2.22E+03	+/-	3.83E+02	8.80E+03	+/-	8.90E+02	< 2.67E+01	< 4.24E+01	< 4.86E+01
	10/14/14	1.38E+03	+/-	1.14E+02	5.68E+03	+/-	2.72E+02	< 2.90E+01	< 1.22E+01	< 1.23E+01
	<b>Mean</b>		1.39E+03	+/-	3.18E+02	6.15E+03	+/-	6.71E+02	+/-	+/-
Sampling Location	Sampling Date	Be-7		K-40		I-131*		Cs-134*	Cs-137*	
26	05/13/14	3.43E+02	+/-	2.17E+02	7.44E+03	+/-	4.08E+02	< 5.16E+01	< 8.68E+00	< 1.03E+01
	06/10/14	4.84E+02	+/-	2.57E+02	4.49E+03	+/-	6.89E+02	< 4.19E+01	< 2.78E+01	< 2.97E+01
	07/09/14	1.40E+03	+/-	4.52E+02	6.63E+03	+/-	1.08E+03	< 3.80E+01	< 4.26E+01	< 5.46E+01
	08/14/14	2.67E+03	+/-	4.91E+02	5.92E+03	+/-	8.99E+02	< 3.59E+01	< 2.62E+01	< 2.87E+01
	09/10/13	1.21E+03	+/-	2.64E+02	4.41E+03	+/-	5.20E+02	< 2.57E+01	< 2.76E+01	< 3.00E+01
	10/14/14	1.93E+03	+/-	1.60E+02	4.70E+03	+/-	3.39E+02	< 3.33E+01	< 1.66E+01	< 1.82E+01
	<b>Mean</b>		1.34E+03	+/-	3.07E+02	5.60E+03	+/-	6.56E+02	+/-	+/-
<b>Indicator locations</b>		1.32E+03	+/-	3.14E+02	6.28E+03	+/-	6.73E+02	+/-	+/-	+/-

\* LLD identified in ODCM

**Table 3-10**  
**Well Water**  
**Gamma Spectra, Strontium, and Tritium**  
**[pCi/L]**

Sampling Date	Station 01A								
	H-3	Sr-89	Sr-90	Mn-54	Fe-59	Co-58	Co-60	Zn-65	
03/26/14	< 1.13E+03	[a]	[a]	< 4.68E+00	< 8.32E+00	< 4.31E+00	< 4.81E+00	< 7.63E+00	
06/24/14	< 6.87E+02	< 1.79E+00	< 7.59E-01	< 4.27E+00	< 8.60E+00	< 4.92E+00	< 3.99E+00	< 1.04E+01	
09/30/14	< 1.85E+03	[a]	[a]	< 2.54E+00	< 4.38E+00	< 2.13E+00	< 1.40E+00	< 5.31E+00	
12/31/14	< 1.09E+03	[a]	[a]	< 4.34E+00	< 9.74E+00	< 4.41E+00	< 5.86E+00	< 8.60E+00	

Mean

Sampling Date								
	Zr-95	Nb-95	I-131	Cs-134	Cs-137	Ba-140	La-140	
03/26/14	< 9.37E+00	< 4.87E+00	< 6.58E-01	< 3.35E+00	< 4.89E+00	< 3.30E+01	< 1.44E+01	
06/24/14	< 9.56E+00	< 5.39E+00	< 5.33E-01	< 7.44E+00	< 5.73E+00	< 2.53E+01	< 5.51E+00	
09/30/14	< 3.28E+00	< 2.22E+00	< 6.12E-01	< 2.06E+00	< 2.13E+00	< 1.50E+01	< 4.82E+00	
12/31/14	< 8.38E+00	< 4.52E+00	< 7.80E-01	< 5.09E+00	< 5.22E+00	< 2.52E+01	< 8.56E+00	

Mean

[a] Sr-89/90 analyses performed on the second quarter sample.

**Table 3-11**  
**River Water**  
**Gamma Spectra, Strontium, and Tritium**  
**[pCi/L]**

Sampling Date	H-3	Sr-89	Sr-90	Mn-54*	Fe-59*	Co-58*	Co-60*	Station 11 Zn-65*
01/14/14	[a]	[b]	[b]	< 3.79E+00	< 9.31E+00	< 3.94E+00	< 3.86E+00	< 8.08E+00
02/11/14	[a]	[b]	[b]	< 3.34E+00	< 8.08E+00	< 3.46E+00	< 3.93E+00	< 7.06E+00
03/12/14	3.00E+03 +/- 1.23E+03	[b]	[b]	< 4.40E+00	< 1.32E+01	< 6.66E+00	< 5.80E+00	< 1.19E+01
04/15/14	[a]	[b]	[b]	< 4.25E+00	< 1.23E+01	< 4.97E+00	< 5.20E+00	< 1.05E+01
05/12/14	[a]	[b]	[b]	< 4.98E+00	< 7.05E+00	< 4.33E+00	< 3.63E+00	< 9.17E+00
06/17/14	3.05E+03 +/- 9.35E+02	< 4.29E+00	< 9.23E-01	< 4.28E+00	< 8.31E+00	< 3.90E+00	< 3.74E+00	< 7.37E+00
07/15/14	[a]	[b]	[b]	< 4.54E+00	< 9.98E+00	< 5.09E+00	< 5.74E+00	< 1.10E+01
08/11/14	[a]	[b]	[b]	< 4.81E+00	< 8.13E+00	< 3.84E+00	< 4.98E+00	< 8.68E+00
09/16/14	2.99E+03 +/- 1.69E+03	[b]	[b]	< 6.45E+00	< 1.20E+01	< 6.60E+00	< 6.19E+00	< 1.15E+01
10/15/14	[a]	[b]	[b]	< 3.03E+00	< 8.20E+00	< 3.35E+00	< 3.58E+00	< 6.27E+00
11/12/14	[a]	[b]	[b]	< 4.61E+00	< 9.34E+00	< 4.82E+00	< 4.48E+00	< 8.91E+00
12/16/14	2.43E+03 +/- 1.30E+03	[b]	[b]	< 3.07E+00	< 7.54E+00	< 3.00E+00	< 3.29E+00	< 5.60E+00
MEAN	2.87E+03 +/- 1.29E+03	+/-	+/-	+/-	+/-	+/-	+/-	+/-

Sampling Date	Nb-95*	Zr-95*	I-131*	Cs-134*	Cs-137*	Ba-140*	La-140*
01/14/14	< 7.48E+00	< 4.85E+00	< 7.57E-01	< 3.59E+00	< 4.01E+00	< 4.69E+01	< 1.46E+01
02/11/14	< 6.92E+00	< 3.64E+00	< 5.05E-01	< 3.57E+00	< 4.03E+00	< 1.97E+01	< 5.31E+00
03/12/14	< 9.61E+00	< 7.03E+00	< 6.43E-01	< 5.95E+00	< 6.61E+00	< 2.52E+01	< 8.42E+00
04/15/14	< 8.89E+00	< 5.01E+00	< 6.59E-01	< 4.50E+00	< 4.82E+00	< 3.29E+01	< 1.40E+01
05/12/14	< 9.19E+00	< 5.23E+00	< 5.50E-01	< 4.54E+00	< 5.13E+00	< 2.20E+01	< 6.30E+00
06/17/14	< 7.37E+00	< 4.18E+00	< 4.73E-01	< 3.86E+00	< 4.57E+00	< 1.96E+01	< 5.27E+00
07/15/14	< 8.74E+00	< 6.07E+00	< 7.68E-01	< 4.68E+00	< 5.03E+00	< 2.69E+01	< 7.01E+00
08/11/14	< 8.53E+00	< 3.91E+00	< 5.77E-01	< 4.07E+00	< 4.05E+00	< 2.35E+01	< 8.29E+00
09/16/14	< 9.51E+00	< 5.54E+00	< 4.99E-01	< 5.39E+00	< 5.66E+00	< 3.17E+01	< 1.19E+01
10/15/14	< 6.26E+00	< 3.19E+00	< 1.25E+00	< 3.17E+00	< 3.44E+00	< 2.06E+01	< 6.10E+00
11/12/14	< 8.10E+00	< 4.96E+00	< 4.91E-01	< 4.55E+00	< 5.03E+00	< 2.03E+01	< 7.01E+00
12/16/14	< 6.07E+00	< 3.23E+00	< 3.08E-01	< 2.80E+00	< 3.18E+00	< 2.05E+01	< 9.84E+00
MEAN	+/-		+/-	+/-	+/-	+/-	+/-

\* LLD identified in ODCM [a] Tritium analyses on quarterly composite. [b] Sr-89/90 performed annually on 2<sup>nd</sup> quarter composite sample.

I-131 LLD of 1 pCi/L not met on 10/15/14 sample due to delay in sample arriving at laboratory for analysis.



**Table 3-12**  
**Surface Water**  
**Gamma Spectra, Strontium, Tritium**  
**[pCi/L]**

Sampling Date	Station 08								
	H-3*	Sr-89	Sr-90	Mn-54*	Fe-59*	Co-58*	Co-60*	Zn-65*	
01/14/14	[a]	[b]	[b]	< 3.77E+00	< 1.09E+01	< 4.91E+00	< 3.64E+00	< 8.61E+00	
02/11/14	[a]	[b]	[b]	< 3.54E+00	< 7.42E+00	< 3.15E+00	< 5.19E+00	< 7.16E+00	
03/12/14	3.07E+03 +/- 1.22E+03	[b]	[b]	< 4.61E+00	< 1.12E+01	< 5.35E+00	< 4.95E+00	< 1.25E+01	
04/15/14	[a]	[b]	[b]	< 5.48E+00	< 1.09E+01	< 6.28E+00	< 5.56E+00	< 1.15E+01	
05/12/14	[a]	[b]	[b]	< 2.91E+00	< 6.59E+00	< 3.46E+00	< 3.63E+00	< 6.27E+00	
06/17/14	1.81E+03 +/- 8.15E+02	< 4.67E+00	< 8.48E-01	< 2.91E+00	< 6.02E+00	< 2.66E+00	< 2.97E+00	< 5.46E+00	
07/15/14	[a]	[b]	[b]	< 3.62E+00	< 7.87E+00	< 3.34E+00	< 4.20E+00	< 7.77E+00	
08/11/14	[a]	[b]	[b]	< 3.22E+00	< 5.71E+00	< 2.88E+00	< 3.77E+00	< 6.19E+00	
09/16/14	< 1.89E+03	[b]	[b]	< 5.26E+00	< 1.14E+01	< 5.70E+00	< 5.30E+00	< 8.66E+00	
10/15/14	[a]	[b]	[b]	< 2.90E+00	< 6.88E+00	< 2.81E+00	< 2.72E+00	< 5.36E+00	
11/12/14	[a]	[b]	[b]	< 3.21E+00	< 7.32E+00	< 3.66E+00	< 2.74E+00	< 6.87E+00	
12/16/14	3.00E+03 +/- 1.35E+03	[b]	[b]	< 2.45E+00	< 5.31E+00	< 2.74E+00	< 2.14E+00	< 4.20E+00	
Mean	2.63E+03 +/- 1.32E+03	+/-	+/-	+/-	+/-	+/-	+/-	+/-	

Sampling Date	Station 08							
	Zr-95*	Nb-95*	I-131*	Cs-134*	Cs-137*	Ba-140*	La-140*	
01/14/14	< 8.02E+00	< 5.08E+00	< 6.72E-01	< 3.99E+00	< 4.55E+00	< 4.82E+01	< 1.47E+01	
02/11/14	< 6.53E+00	< 3.27E+00	< 5.32E-01	< 3.70E+00	< 3.60E+00	< 1.79E+01	< 5.14E+00	
03/12/14	< 9.43E+00	< 6.02E+00	< 6.59E-01	< 5.55E+00	< 5.55E+00	< 2.77E+01	< 9.45E+00	
04/15/14	< 9.13E+00	< 5.51E+00	< 6.62E-01	< 4.90E+00	< 4.85E+00	< 2.95E+01	< 1.15E+01	
05/12/14	< 5.54E+00	< 3.43E+00	< 5.68E-01	< 3.21E+00	< 3.35E+00	< 1.58E+01	< 5.11E+00	
06/17/14	< 5.59E+00	< 3.19E+00	< 4.65E-01	< 2.67E+00	< 2.92E+00	< 1.37E+01	< 4.96E+00	
07/15/14	< 6.64E+00	< 4.38E+00	< 5.99E-01	< 4.06E+00	< 3.88E+00	< 1.94E+01	< 5.68E+00	
08/11/14	< 4.49E+00	< 3.69E+00	< 6.59E-01	< 3.07E+00	< 3.59E+00	< 1.57E+01	< 4.58E+00	
09/16/14	< 1.14E+01	< 5.42E+00	< 4.84E-01	< 4.64E+00	< 5.11E+00	< 2.93E+01	< 8.24E+00	
10/15/14	< 5.42E+00	< 2.87E+00	< 6.23E-01	< 2.79E+00	< 2.91E+00	< 1.79E+01	< 6.33E+00	
11/12/14	< 5.12E+00	< 3.64E+00	< 5.49E-01	< 3.06E+00	< 3.69E+00	< 1.62E+01	< 5.53E+00	
12/16/14	< 4.22E+00	< 2.91E+00	< 4.69E-01	< 2.30E+00	< 2.60E+00	< 1.88E+01	< 4.62E+00	
Mean	+/-	+/-	+/-	+/-	+/-	+/-	+/-	

\* LLD identified in ODCM

[a] Tritium analyses on quarterly composite.

[b] Sr-89/90 performed annually on 2<sup>nd</sup> quarter composite sample.

**Table 3-12**  
**Surface Water**  
**Gamma Spectra, Strontium, Tritium**  
**[pCi/L]**

Station 09A								
Sampling Date	H-3*	Sr-89	Sr-90	Mn-54*	Fe-59*	Co-58*	Co-60*	Zn-65*
01/14/14	[a]	[b]	[b]	< 3.54E+00	< 9.10E+00	< 4.34E+00	< 3.92E+00	< 7.84E+00
02/11/14	[a]	[b]	[b]	< 3.50E+00	< 7.81E+00	< 3.91E+00	< 4.20E+00	< 7.32E+00
03/12/14	< 1.40E+03	[b]	[b]	< 5.03E+00	< 1.13E+01	< 5.79E+00	< 9.78E+00	< 1.08E+01
04/15/14	[a]	[b]	[b]	< 4.83E+00	< 1.26E+01	< 5.45E+00	< 5.44E+00	< 9.75E+00
05/12/14	[a]	[b]	[b]	< 3.80E+00	< 8.06E+00	< 4.39E+00	< 4.26E+00	< 8.03E+00
06/17/14	< 9.78E+02	< 4.36E+00	< 8.81E-01	< 4.42E+00	< 1.03E+01	< 4.52E+00	< 4.65E+00	< 6.78E+00
07/15/14	[a]	[b]	[b]	< 4.20E+00	< 1.07E+01	< 4.26E+00	< 5.57E+00	< 1.04E+01
08/11/14	[a]	[b]	[b]	< 4.64E+00	< 8.00E+00	< 5.39E+00	< 3.96E+00	< 9.07E+00
09/16/14	< 1.89E+03	[b]	[b]	< 5.32E+00	< 1.13E+01	< 4.74E+00	< 4.61E+00	< 9.76E+00
10/15/14	[a]	[b]	[b]	< 3.32E+00	< 7.50E+00	< 3.24E+00	< 2.93E+00	< 5.64E+00
11/12/14	[a]	[b]	[b]	< 5.51E+00	< 1.05E+01	< 5.85E+00	< 4.24E+00	< 1.32E+01
12/16/14	< 1.69E+03	[b]	[b]	< 3.53E+00	< 7.45E+00	< 2.97E+00	< 3.23E+00	< 6.12E+00
MEAN	+/-	+/-	+/-	+/-	+/-	+/-	+/-	+/-

Sampling Date	Zr-95*	Nb-95*	I-131*	Cs-134*	Cs-137*	Ba-140*	La-140*
01/14/14	< 7.43E+00	< 4.53E+00	< 8.14E-01	< 3.23E+00	< 3.69E+00	< 4.48E+01	< 1.48E+01
02/11/14	< 6.65E+00	< 4.16E+00	< 4.93E-01	< 3.85E+00	< 3.59E+00	< 1.86E+01	< 6.68E+00
03/12/14	< 9.94E+00	< 5.20E+00	< 6.39E-01	< 5.15E+00	< 6.30E+00	< 2.41E+01	< 8.20E+00
04/15/14	< 1.13E+01	< 4.93E+00	< 5.43E-01	< 5.10E+00	< 4.50E+00	< 3.76E+01	< 1.12E+01
05/12/14	< 6.77E+00	< 4.25E+00	< 5.25E-01	< 3.58E+00	< 4.31E+00	< 1.85E+01	< 7.07E+00
06/17/14	< 7.93E+00	< 5.69E+00	< 5.85E-01	< 4.39E+00	< 5.06E+00	< 1.90E+01	< 7.64E+00
07/15/14	< 1.00E+01	< 5.74E+00	< 5.61E-01	< 5.01E+00	< 5.93E+00	< 2.51E+01	< 6.38E+00
08/11/14	< 7.08E+00	< 4.69E+00	< 5.95E-01	< 3.82E+00	< 4.06E+00	< 2.22E+01	< 9.72E+00
09/16/14	< 8.85E+00	< 5.24E+00	< 5.54E-01	< 4.73E+00	< 4.70E+00	< 2.29E+01	< 8.60E+00
10/15/14	< 5.72E+00	< 3.46E+00	< 7.80E-01	< 3.36E+00	< 3.03E+00	< 2.26E+01	< 6.14E+00
11/12/14	< 1.04E+01	< 5.80E+00	< 6.45E-01	< 6.45E+00	< 5.84E+00	< 2.74E+01	< 9.21E+00
12/16/14	< 5.89E+00	< 3.32E+00	< 5.01E-01	< 2.95E+00	< 3.28E+00	< 2.43E+01	< 6.76E+00
MEAN	+/-	+/-	+/-	+/-	+/-	+/-	+/-

\* LLD identified in ODCM

[a] Tritium analyses on quarterly composite.

[b] Sr-89/90 performed annually on 2<sup>nd</sup> quarter composite sample.

**Table 3-13**  
**Sediment Silt**  
**Gamma Spectra, and Strontium**  
**[pCi/Kg]**

page  
1 of 1

Sample Date	Sr-89	Sr-90	K-40	Cs-134*	Cs-137*
<b>4/15/2014</b>					
Station 08	[a]	[a]	1.29E+03 +/- 4.78E+02	< 5.04E+01	< 4.69E+01
Station 09A**	[a]	[a]	2.78E+04 +/- 1.73E+03	< 6.30E+01	< 7.47E+01
Station 11	[a]	[a]	1.83E+04 +/- 1.60E+03	< 6.59E+01	< 7.63E+01
			Ra-226	Th-228	Th-232
<b>4/15/2014</b>					
Station 08			< 1.10E+03	9.85E+01 +/- 7.55E+01	< 1.98E+02
Station 09A**			1.97E+03 +/- 1.60E+03	1.08E+03 +/- 1.14E+02	8.69E+02 +/- 1.91E+02
Station 11			2.37E+03 +/- 1.40E+03	1.84E+03 +/- 1.22E+02	1.73E+03 +/- 2.01E+02
Sample Date	Sr-89	Sr-90	K-40	Cs-134*	Cs-137*
<b>10/15/2014</b>					
Station 08	< 1.80E+02	< 3.06E+01	1.87E+03 +/- 6.23E+02	< 3.31E+01	< 3.42E+01
Station 09A**	< 1.87E+02	< 2.86E+01	3.38E+04 +/- 1.86E+03	< 5.00E+01	< 5.54E+01
Station 11	< 1.87E+02	< 3.55E+01	2.68E+04 +/- 1.49E+03	< 4.85E+01	< 6.13E+01
			Ra-226	Th-228	Th-232
<b>10/15/2014</b>					
Station 08			< 9.43E+02	1.05E+02 +/- 5.91E+01	< 1.25E+02
Station 09A**			< 9.19E+02	4.48E+02 +/- 6.33E+01	4.14E+02 +/- 1.18E+02
Station 11			2.69E+03 +/- 1.05E+03	1.02E+03 +/- 8.16E+01	1.12E+03 +/- 1.26E+02
			MEAN		
	Sr-89	Sr-90	K-40	Cs-134*	Cs-137*
Indicator	+/-	+/-	1.21E+04 +/- 1.05E+03	+/-	+/-
Control	+/-	+/-	3.08E+04 +/- 1.80E+03	+/-	+/-
			Ra-226	Th-228	Th-232
Indicator			2.53E+03 +/- 1.13E+03	7.66E+02 +/- 8.46E+01	1.43E+03 +/- 1.63E+02
Control			1.97E+03 +/- 1.60E+03	7.64E+02 +/- 8.87E+01	6.42E+02 +/- 1.55E+02

\* LLD identified in ODCM

\*\* Control Station

[a] Sr-89/90 analyses performed annually.

**Table 3-14**  
**Shoreline Soil**  
**Gamma Spectra, and Strontium**  
**[pCi/Kg]**

Sample Date	Sr-89	Sr-90	K-40	Cs-134*	Cs-137*
<u>4/24/2014</u>					
Station 08	[a]	[a]	1.53E+03 +/- 5.54E+02	< 4.99E+01	< 5.96E+01
			Ra-226	Th-228	Th-232
			< 1.20E+03	1.49E+02 +/- 9.63E+01	2.65E+02 +/- 9.05E+01
Sample Date	Sr-89	Sr-90	K-40	Cs-134*	Cs-137*
<u>10/15/2014</u>					
Station 08	< 1.82E+02	< 3.70E+01	5.27E+02 +/- 5.31E+02	< 4.80E+01	< 5.45E+01
			Ra-226	Th-228	Th-232
			< 1.26E+03	1.47E+02 +/- 7.41E+01	< 1.98E+02
			MEAN		
	Sr-89	Sr-90	K-40	Cs-134*	Cs-137*
	+/-	+/-	1.03E+03 +/- 5.43E+02	+/-	+/-
			Ra-226	Th-228	Th-232
			+/-	1.48E+02 +/- 8.52E+01	2.65E+02 +/- 1.44E+02

\* LLD identified in ODCM

[a] Sr-89/90 analyses performed annually.

**Table 3-15**  
**Fish**  
**Gamma Spectra**  
**[pCi/Kg]**

										Fish [a]
										Station 08
Sampling Date	K-40		Mn-54*	Fe-59*	Co-58*	Co-60*	Zn-65*	Cs-134*	Cs-137*	
04/16/14	1.96E+03	+/- 1.08E+03	< 9.49E+01	< 2.34E+02	< 8.59E+01	< 8.72E+01	< 1.77E+02	< 8.81E+01	< 9.55E+01	
10/16/14	1.96E+03	+/- 8.77E+02	< 8.03E+01	< 1.46E+02	< 8.86E+01	< 8.63E+01	< 1.44E+02	< 6.82E+01	< 8.24E+01	

										Station 25**
Sampling Date	K-40		Mn-54*	Fe-59*	Co-58*	Co-60*	Zn-65*	Cs-134*	Cs-137*	
04/16/14	2.41E+03	+/- 7.84E+02	< 5.90E+01	< 1.36E+02	< 5.52E+01	< 6.45E+01	< 1.29E+02	< 5.37E+01	< 4.80E+01	
10/16/14	1.37E+03	+/- 8.41E+02	< 9.53E+01	< 1.84E+02	< 1.08E+02	< 9.41E+01	< 1.64E+02	< 8.16E+01	< 8.77E+01	

										catfish [b]
										Station 08
Sampling Date	K-40		Mn-54*	Fe-59*	Co-58*	Co-60*	Zn-65*	Cs-134*	Cs-137*	
04/16/14	1.58E+03	+/- 6.19E+02	< 6.24E+01	< 1.44E+02	< 6.22E+01	< 7.78E+01	< 1.28E+02	< 5.18E+01	< 7.27E+01	
10/16/14	1.40E+03	+/- 6.94E+02	< 6.79E+01	< 2.06E+02	< 5.82E+01	< 8.24E+01	< 1.35E+02	< 6.39E+01	< 6.73E+01	

										Station 25**
Sampling Date	K-40		Mn-54*	Fe-59*	Co-58*	Co-60*	Zn-65*	Cs-134*	Cs-137*	
04/16/14	1.58E+03	+/- 1.02E+03	< 6.72E+01	< 1.21E+02	< 7.66E+01	< 7.13E+01	< 1.05E+02	< 6.32E+01	< 6.61E+01	
10/16/14	2.35E+03	+/- 1.27E+03	< 6.61E+01	< 2.28E+02	< 1.18E+02	< 4.61E+01	< 2.36E+02	< 8.31E+01	< 1.12E+02	

Mean 1.73E+03 +/- 8.98E+02  
Indicator 1.73E+03 +/- 8.18E+02  
Control 1.93E+03 +/- 9.79E+02

\* LLD identified in ODCM

\*\* Control Station

[a] Non-bottom dwelling species of gamefish.

[b] Bottom dwelling species of fish.

## DISCUSSION OF RESULTS

Data from the radiological analyses of environmental media collected during 2014 and tabulated in Section 3, are discussed below. Except for TLDs, Teledyne Brown Engineering analyzed all samples throughout the year. The procedures and specifications followed for these analyses are as required in the TBE quality assurance manuals and laboratory procedures. In addition to internal quality control measurements performed by each laboratory, they also participate in an Interlaboratory Comparison Program. Participation in this program ensures that independent checks on the precision and accuracy of the measurements of radioactive material in environmental samples are performed. The results of the Interlaboratory Comparison Programs are provided in Appendix B.

The predominant radioactivity detected throughout 2014 was that from external sources, such as fallout from nuclear weapons tests and naturally occurring radionuclides. Naturally occurring nuclides such as Be-7, K-40, Th-228 and Th-232 were detected in numerous samples. Th-228 & Th-232 results were variable and are generally at levels higher than plant related radionuclides.


The following is a discussion and summary of the results of the environmental measurements taken during the 2014 reporting period.

### ***4.1 Gamma Exposure Rate***

A thermoluminescent dosimeter (TLD) is an inorganic crystal used to detect ambient radiation. TLDs are placed in two concentric rings around the station. The inner ring is located at the site boundary, and the outer ring is located at approximately five miles from the station. TLDs are also placed in special interest areas, such as population areas and nearby residences. Additional TLDs serve as controls. Ambient radiation comes from naturally occurring radioisotopes in the air and soil, radiation from cosmic origin, fallout from nuclear weapons testing, station effluents and direct radiation from the station.

The results of the analyses are presented in Table 3-2. Figure 4-1 shows the historical trend of TLD exposure rate measurements. Control and indicator averages indicate a steady relationship. Two dosimeters made of CaF and LiF sensitive elements are deployed at each sampling location. These TLDs replaced the previously used CaSO<sub>4</sub>:Dy in Teflon TLDs in January 2001. The

dose with the replacement TLDs is lower than that of the previously used TLDs. This will continue to be monitored.

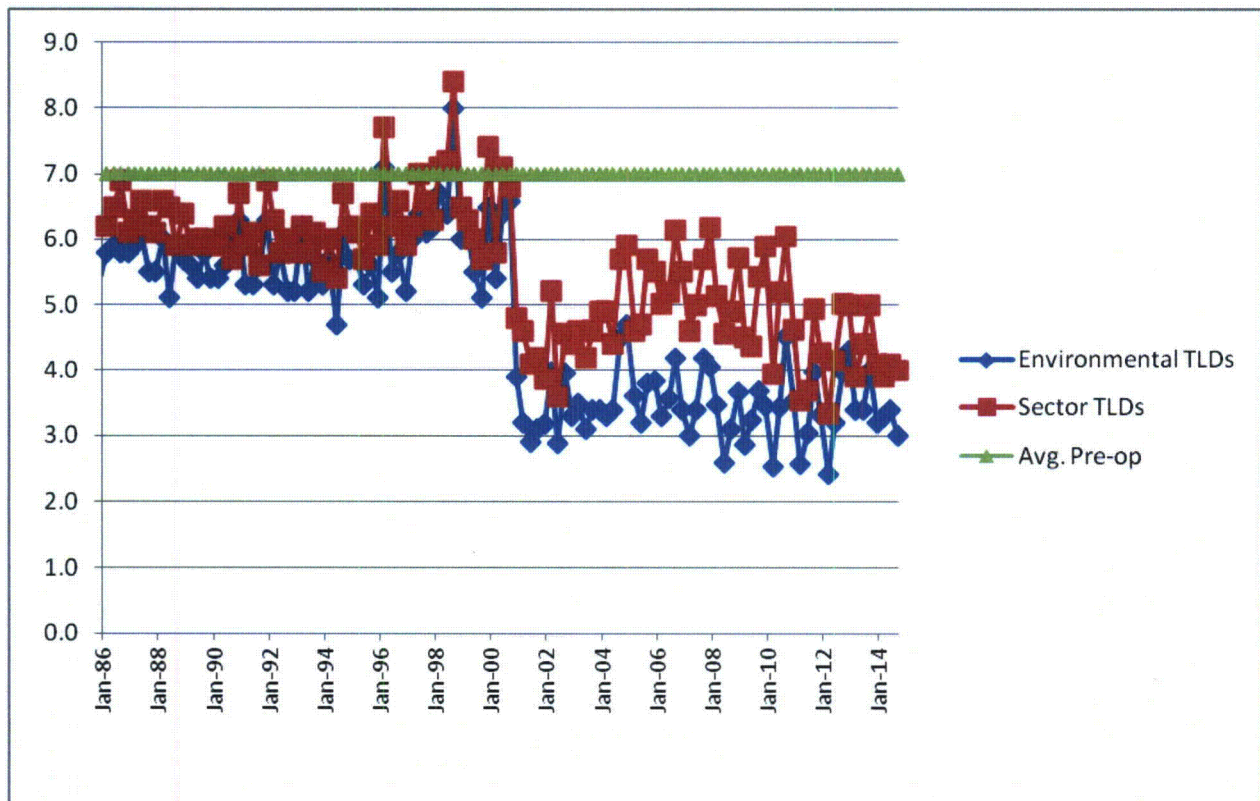

**Figure 4-1 TLD (mrem/Standard Month)**

Sector TLDs are deployed quarterly at thirty-two locations in the environs of the North Anna site. Two badges are placed at each location. A self assessment of the Offsite Dose Calculation Manual environmental program requirements was conducted during this reporting period. It was identified that outer ring sector TLDs in the SE, SSW and WSW sectors are located at distances greater than the 5 mile distance required by the Offsite Dose Calculation Manual with sector TLDs located at 5.88 miles, 5.3 miles and 7.1 miles respectively. A subsequent evaluation found that these three TLD locations either deviate less than twenty percent from the distance requirement where the sector is mostly covered by water or the TLD is placed at a combined TLD / Air sample location. It was determined that these locations meet the intent of the environmental program and that having these TLDs at their current locations in no way jeopardizes public health and safety. Therefore, it was concluded that these current TLD locations are acceptable and no TLDs need be relocated .


The average level of these 32 sector TLD locations (two badges at each location) was 4.0 mR/standard month with a range of 1.3 to 8.0 mR/standard month. The highest quarterly average reading for any single location was obtained at location NW-29/61. This value was 7.1 mR/standard month. This location is on site on the north gate of the construction side laydown area. Quarterly and annual TLDs are also located at twelve environmental air sampling stations. For the eleven indicator locations within 10 miles of the station the average quarterly reading was 3.2 mR/standard month with a range of 1.6 to 5.8 mR/standard month. The average annual reading for these locations was 2.9 mR/standard month with a range from 2.0 to 4.1 mR/standard month. The control location showed a quarterly average of 2.7 mR/standard month with a range of 2.5 to 3.1 mR/standard month. Its annual reading was 2.8 mR/standard month. 10 emergency sector TLDs, which are all located onsite had a quarterly average of 4.9 mR/standard month with EPSP-9/10 having the highest quarterly average of 7.1 mR/standard month. Eight other TLDs, designated C-1 thru C-8, which were pre-operational controls, were collected quarterly from four locations. Stations C-3/4 and C-7/8 are designated controls. These had a quarterly average of 3.15, while Station C-1/2 and C-5/6 had a quarterly average of 2.4 mR/standard month with a range of 1.6 to 3.4 mR/standard month. During the pre-operational period (starting in 1977) the doses were measured between 4.3 and 8.8 mR/standard month.

#### ***4.2 Airborne Gross Beta***


Results of the weekly gross beta analyses are presented in Table 3-3. A review of the historical plot in Figure 4-2, indicates gross beta activity levels have remained relatively unchanged. The drop indicated in 2009 may be a function of a return to the vendor used from 1988 until 2001. This will be monitored in the future to see if this is in fact the case. Inner and outer ring monitoring locations continue to show no significant variation in measured activities (see Figure 4-3). This indicates that any station contribution is not measurable.

Gross beta activity found during the pre-operational and early operating period of North Anna Power Station was higher because of nuclear weapons testing. During that time, nearly 740 nuclear weapons were tested worldwide. In 1985 weapons testing ceased, and with the exception of the Chernobyl accident in 1986, airborne gross beta results have remained steady. During the preoperational period of July 1, 1974 through March 31, 1978 gross beta activities ranged from a low of 0.005 pCi/m<sup>3</sup> to a high of 0.75 pCi/m<sup>3</sup>.



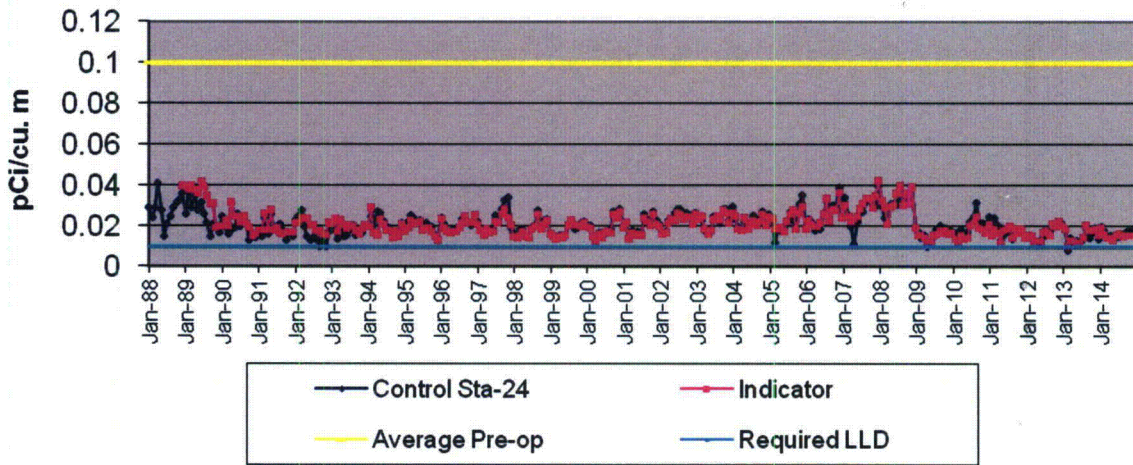

**Figure 4-2 Historical Gross Beta in Air Particulates**

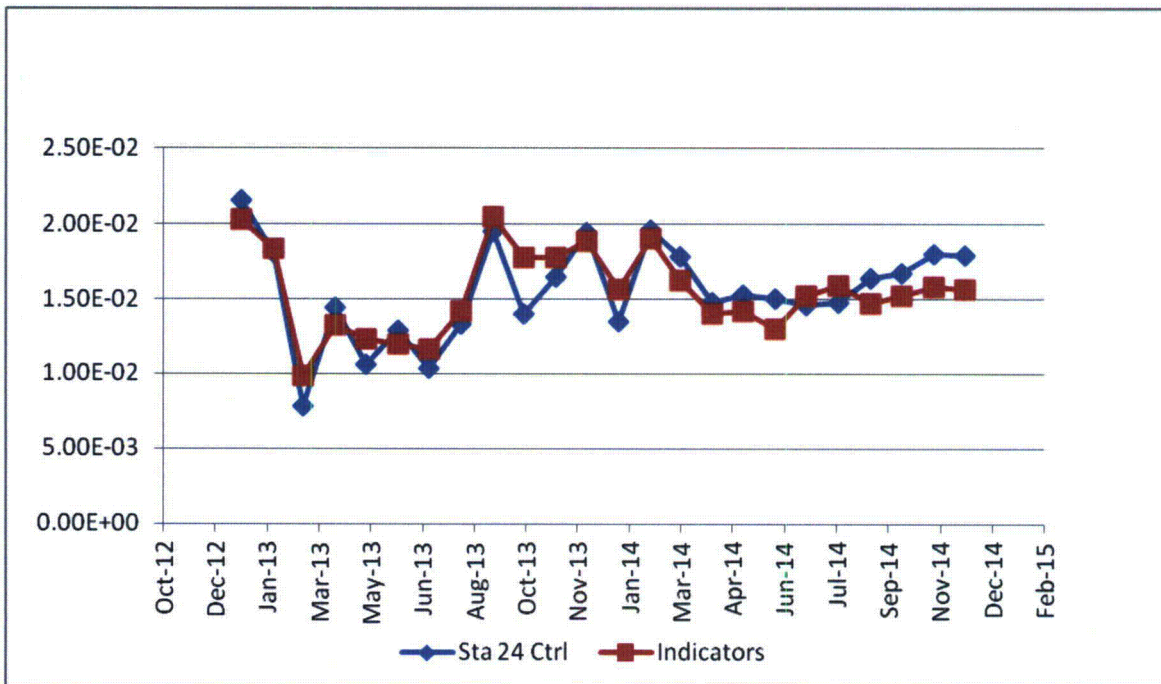

**Figure 4-3 2014 Gross Beta in Air Particulates (pCi/m<sup>3</sup>)**

### ***4.3 Airborne Radioiodine***

Charcoal cartridges are used to collect airborne radioiodine. Once a week the samples are collected and analyzed. The results of the analyses are presented in Table 3-4. These results are similar to pre-operational data and the results of samples taken prior to and after the 1986 accident in the Soviet Union at Chernobyl and the effect of the Fukushima Daiichi event.

### ***4.4 Air Particulate Gamma***

The air particulate filters that are utilized for the weekly gross beta analyses are composited by location and analyzed quarterly by gamma spectroscopy. The results are listed in Table 3-5. The results indicate the presence of naturally occurring Be-7, which is produced by cosmic processes. Examination of pre-operational data indicates comparable measurements of Be-7, as would be expected. The results of these analyses indicate the lack of station effects on the environment.

### ***4.5 Air Particulate Strontium***

Strontium-89 and 90 analyses are performed on the second quarter composites of air particulate filters from all monitoring stations. There has been no detection of these fission products at any of the indicator or control stations in recent years.

### ***4.6 Soil***

Soil samples, which are collected every three years from twelve stations, were not collected in 2014.

### ***4.7 Precipitation***

A sample of rain water was collected monthly at on-site station 01A and analyzed for gross beta activity and H-3. The results are presented in Table 3-7. Twelve precipitation samples were obtained in 2014. Semi-annual composites are prepared and analyzed for gamma emitting isotopes in accordance with program requirements. No plant related isotopes were reported in any precipitation water sample at the indicator location. Naturally occurring

gamma emitting radioisotopes were detected. No positive H-3 result was reported. During the pre-operational period gross beta activity in rain water was expressed in nCi per square meter of the collector surface, thus a direct comparison cannot be made to the 2014 period. During the pre-operational period, tritium was measured in over half of the few quarterly composites made. This tritium activity ranged from 100 to 330 pCi/liter.

#### ***4.8 Cow Milk***

Analysis of milk samples is generally the most sensitive indicator of fission product existence in the terrestrial environment. This pathway also shows measurable amounts of nuclear weapons testing fallout. Therefore, this media needs to be evaluated very carefully when trying to determine if there is any plant effect.

Analysis results for cow milk are contained in Table 3-8. No sample indicated positive results. Gamma spectroscopy did not detect the presence of any isotopes related to the operation of North Anna. In years past, Cs-137 has been detected sporadically. These occurrences were attributed to residual global fallout from past atmospheric weapons testing. Naturally occurring K-40 was detected in all samples.

Once each quarter a sample from the collection station is analyzed for strontium-89 and strontium-90. Neither Sr-89 nor Sr-90 was detected. Sr-90 has been observed in the past. Pre-operational levels of 2.2 to 5.4 pCi/liter were measured for Sr-90. There has been a long-term activity trend for Sr-90 showing a continuous decline. It should be noted that strontium-90 is not a part of station effluents. Its detection is the product of nuclear weapons testing fallout. This conclusion can be made based upon the fact that Sr-89 and Sr-90 have not been detected in gaseous effluents released from the station in many years, and the trend of consistent declining levels since the pre-operational period.

#### ***4.9 Food Products and Vegetation***

Food/vegetation samples were collected from five locations and analyzed by gamma spectroscopy. The results of the analyses are presented in Table 3-9. Low levels of Cs-137, attributable to fallout, have been seen periodically in vegetation samples. As expected, naturally occurring potassium-40 and cosmogenic beryllium-7 were detected in most samples, and thorium-228 and other natural products, including Bi-214, were detected in some samples. No

plant related isotopes were identified in any Vegetation sample during 2014.


#### ***4.10 Well Water***

Water was sampled quarterly from the onsite well at the metrology laboratory. These samples were analyzed for gamma radiation and for tritium. The second quarter sample was analyzed by vendor for Sr-89, Sr-90, H-3, I-131, and gamma emitters. The results of these analyses are presented in Table 3-10. No plant related isotopes were detected. No gamma emitting isotopes were detected during the pre-operational period.

#### ***4.11 River Water***

Samples of water from the North Anna River were collected monthly. The analyses are presented in Table 3-11. All monthly samples are analyzed by gamma spectroscopy. The monthly samples are composited quarterly and analyzed for tritium. Additionally, the second quarter samples are analyzed for strontium-89 and strontium-90 in accordance with program requirements. There has been no detection of these fission products at any of the indicator or control stations in recent years.

No gamma emitting radioisotopes were positively identified in any of the samples. There was no measured activity of strontium-89 or strontium-90. Tritium was measured in all four samples with an average annual concentration of 2870 pCi/liter and a range of 2430 to 3050 pCi/liter. These levels are comparable to those observed in previous years, see Figure 4-4. No river water samples were collected during the pre-operational period.

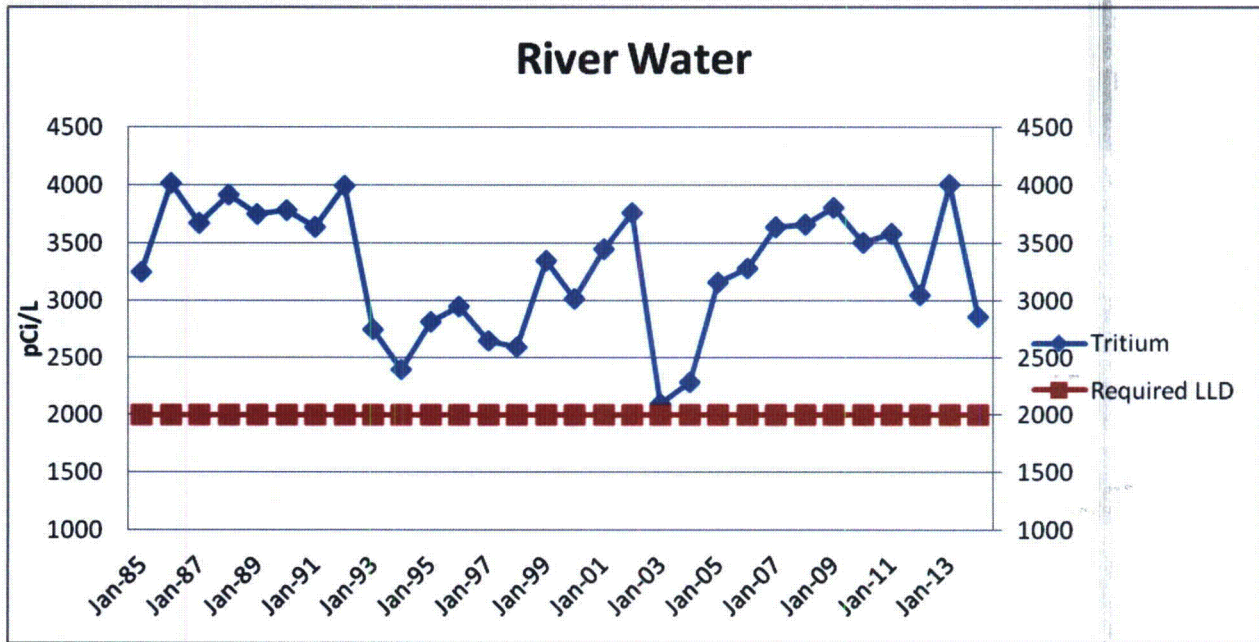


*Figure 4-4 Tritium in River water*

#### 4.12 Surface Water

Samples of surface water were collected monthly from two stations, an indicator station located at the discharge lagoon and a control station located 12.9 miles WNW. The samples were analyzed by gamma spectroscopy and for iodine-131 by radiochemical separation. A quarterly composite from each station was prepared and analyzed for tritium. Additionally, the second quarter samples are analyzed for strontium-89 and strontium-90. There has been no positive indication of these fission products at any of the indicator or control stations in recent years. The results are presented in Table 3-12.

No non-naturally occurring gamma emitting radioisotopes, including iodine were detected in any of the samples. No tritium was detected at the control location. The average level of tritium activity at the indicator station was 2630 pCi/liter with a range of 1810 to 3070 pCi/liter. Levels of tritium have increased since 1978 when the average level was below 300 pCi/liter. Levels measured at the indicator location (Station 8) are comparable to those measured since 1986, see Figure 4-5. During the pre-operational period tritium was measured in several samples with concentrations between 90 and 250 pCi/liter.

Figure 4.5 Tritium in Surface Water

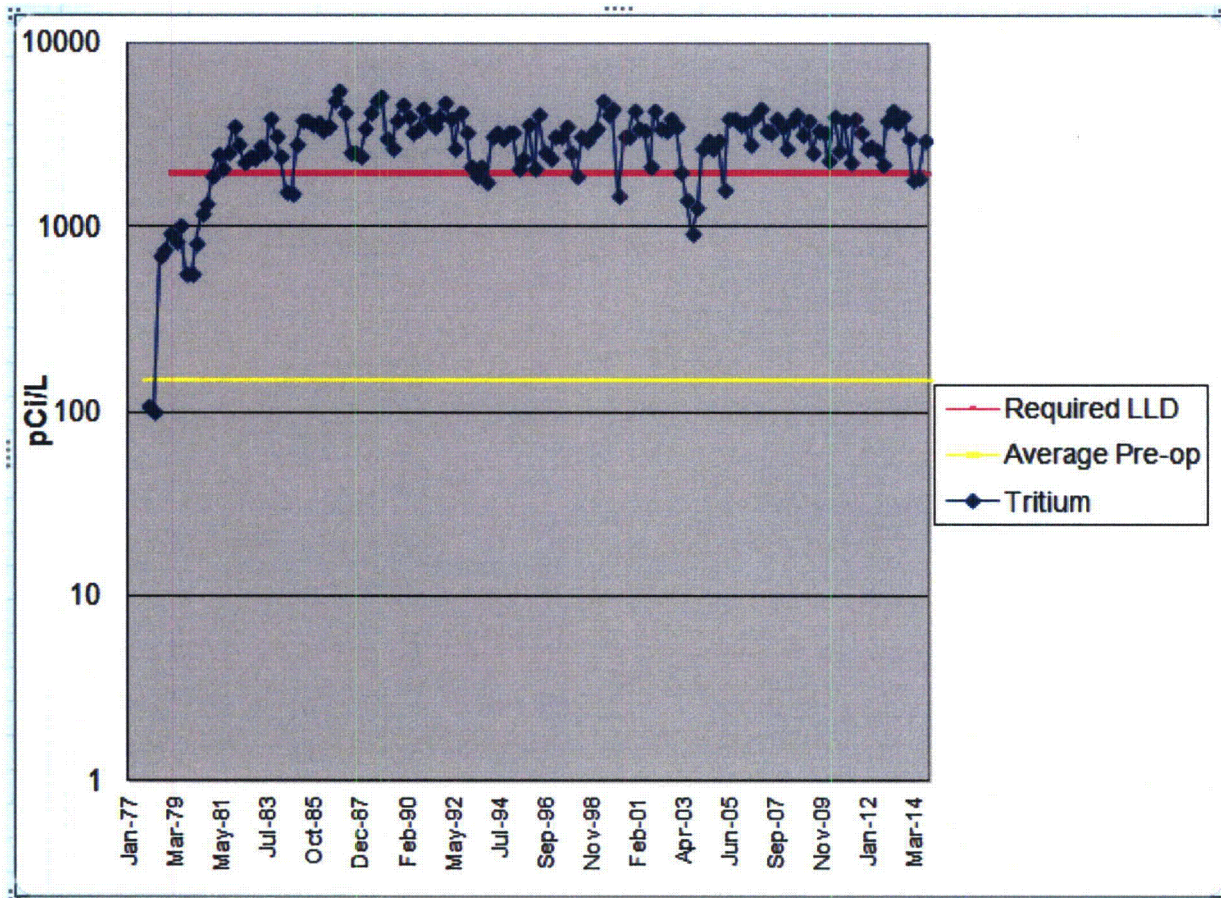

### 4.13 Bottom Sediment

Bottom sediment or silt is sampled to evaluate any buildup of radionuclides in the environment due to the operation of the station. Buildup of radionuclides in bottom sediment could indirectly lead to increasing radioactivity levels in fish.

Sediment samples were collected during March and October from each of three locations and were analyzed by gamma spectroscopy. The October samples were analyzed for strontium-89 and strontium-90. The results are presented in Table 3-13.

No plant related isotopes were detected in 2014. The detection of Cs-137 in bottom sediment is historically common with positive indications usually

apparent in both indicator and control samples. The detection of Cs-137 is the result of accumulation and runoff into the lake of residual weapons testing fallout; its global presence has been well documented. During the pre-operational period sediment samples were also analyzed by gamma spectroscopy. Figure 4-6 shows the historical trend of Cs-137 in sediments.

Neither Strontium-89 nor Strontium-90 was detected in any samples of aquatic sediment/silt in 2014. Strontium-90 has been detected occasionally in the past at both the indicator and control locations and is attributable to fallout from past bomb tests. A number of naturally occurring radioisotopes were detected in these samples at background levels.

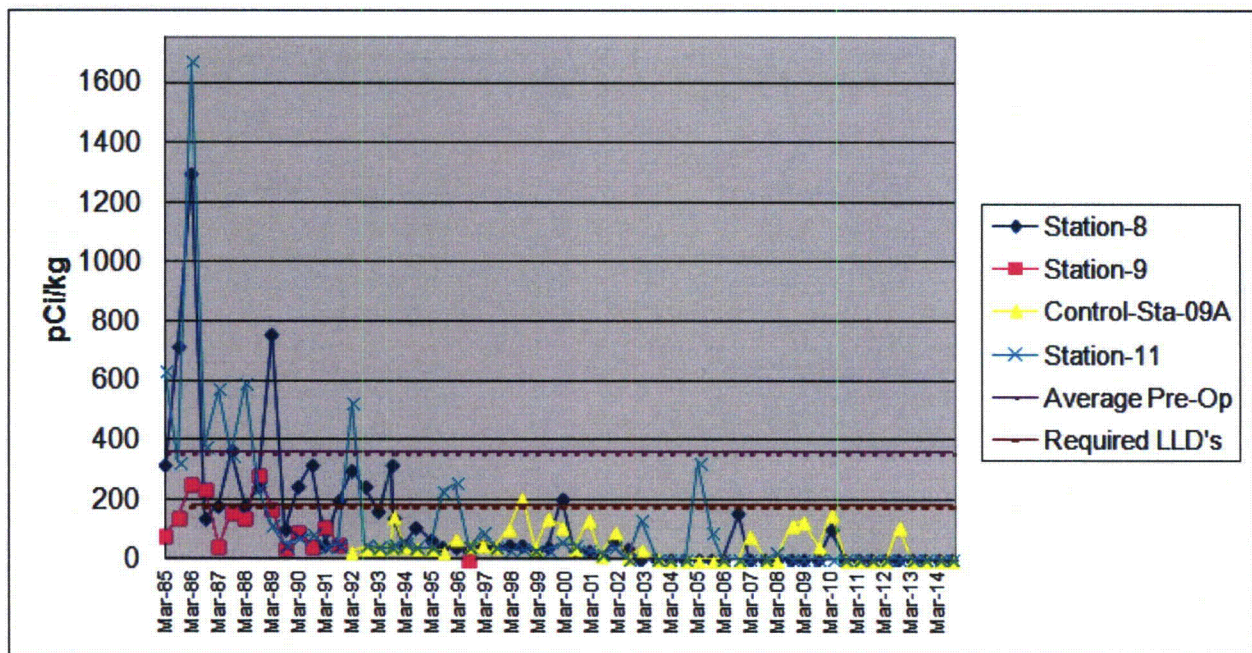


Figure 4-6 Cs-137 in Sediment/Silt

#### 4.14 Shoreline Soil

Shoreline soil/sediment, unlike bottom sediment, may provide a direct dose to humans. Buildup of radioisotopes along the shoreline may provide a source of direct exposure for those using the area for commercial and recreational uses. Samples of shoreline soil were collected in April and October from indicator station 08. The samples were analyzed by gamma spectroscopy. The October sample was analyzed for strontium-89 and strontium-90. The results are presented in Table 3-14.

Naturally occurring radioisotopes were detected at concentrations equivalent to normal background activities. No plant related isotopes were detected in any indicator samples analyzed. Strontium-90 is often detected in this media, however as discussed previously, the presence of Sr-90 and Cs-137 is attributed to accumulation of residual global fallout from past atmospheric weapons testing.

#### ***4.15 Fish***

Four sample sets of fish, two from Lake Anna and two from the control station, Lake Orange, were collected during 2014 and analyzed by gamma spectroscopy. Each sample set consisted of a sample of game species and a sample of bottom-dwelling species, which were analyzed separately. The results are presented in Table 3-15. Naturally occurring K-40 was detected in all samples. No plant related isotopes were detected. Cs-137 was measured in pre-operational environmental fish samples.



## 5. PROGRAM EXCEPTIONS

### REMP Exceptions for Scheduled Sampling and Analysis during 2014 – North Anna

Location	Description	Date of Sampling	Reason(s) for Loss/Exception
14B,15,16,23, 26	Vegetation	01/14/14	Seasonal unavailability
14B,15,16,23, 26	Vegetation	02/11/14	Seasonal unavailability
14B,15,16,23, 26	Vegetation	03/12/14	Seasonal unavailability
STA 1	*AP/Char	03/12/14	Sampler not running/ replaced. Minimum volume not met.
STA 1	*AP/Char	03/19/14	Sampler not running/ replaced. Minimum Volume not met.
14B,15,16,23, 26	Vegetation	04/08/14	Seasonal unavailability
STA 5	*AP/Char	04/29/14	Sampler not running/ replaced. Minimum volume not met.
STA 6	*AP/Char	09/23/14	Sampler not running/ replaced. Minimum volume not met.
STA 01A	*AP/Char	10/28/14	Sampler not running/ replaced. Minimum volume not met.
14B,15,16,23, 26	Vegetation	11/12/14	Seasonal unavailability
14B,15,16,23, 26	Vegetation	12/09/14	Seasonal unavailability

\*AP/Char denotes an air particulate and charcoal sampling station.

## REFERENCES

### References

Dominion, North Anna Power Station Technical Specifications, Units 1 and 2.

Dominion, North Anna Power Station Independent Spent Fuel Storage Installation Technical Specifications.

Dominion, Station Administrative Procedure, VPAP-2103N, "Offsite Dose Calculation Manual".

Virginia Electric and Power Company, North Anna Technical Procedure, HP-3051.010, "Radiological Environmental Monitoring Program".

Title 10 Code of Federal Regulation, Part 50 (10CFR50), "Domestic Licensing of Production and Utilization Facilities".

United States Nuclear Regulatory Commission Regulatory Guide 1.109, Rev. 1, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10CFR50, Appendix I", October, 1977.

United States Nuclear Regulatory Commission, Regulatory Guide 4.8 "Environmental Technical Specifications for Nuclear Power Plants", December 1975.

USNRC Branch Technical Position, "Acceptable Radiological Environmental Monitoring Program", Rev. 1, November 1979.

NUREG 0472, "Radiological Effluent Technical Specifications for PWRs", Rev. 3, March 1982.

HASL-300, Environmental Measurements Laboratory, "EML Procedures Manual," 27<sup>th</sup> Edition, Volume 1, February 1992.

NUREG/CR-4007, "Lower Limit of Detection: Definition and Elaboration of a Proposed Position for Radiological Effluent and Environmental Measurements," September 1984.

## **APPENDICES**

APPENDIX A: LAND USE CENSUS

Year 2014

**LAND USE CENSUS**  
**North Anna Power Station**  
**Louisa County, Virginia**

January 1 to December 31, 2014

<i>Direction</i>	<i>Distance (miles)</i>					
	<i>Nearest Site Boundary</i>	<i>Nearest Resident</i>	<i>Nearest Garden (&gt; 50m<sup>2</sup>)</i>	<i>Nearest Meat Animal</i>	<i>Nearest Milch Cow</i>	<i>Nearest Milch Goat</i>
<i>N</i>	0.9	1.3	1.78	2.9	<i>NONE</i>	<i>NONE</i>
<i>NNE</i>	0.9	0.9	1.22	3.1	<i>NONE</i>	<i>NONE</i>
<i>NE</i>	0.8	0.9	1.6	1.6	<i>NONE</i>	<i>NONE</i>
<i>ENE</i>	0.8	2.37	2.4	2.65	<i>NONE</i>	<i>NONE</i>
<i>E</i>	0.8	1.3	2.04	3.5	<i>NONE</i>	<i>NONE</i>
<i>ESE</i>	0.9	1.7	1.7	<i>NONE</i>	<i>NONE</i>	<i>NONE</i>
<i>SE</i>	0.9	1.4	1.54	1.4	<i>NONE</i>	<i>NONE</i>
<i>SSE</i>	0.9	1.0	1.0	1.6	<i>NONE</i>	<i>NONE</i>
<i>S</i>	0.9	1.03	1.02	2.0	<i>NONE</i>	<i>NONE</i>
<i>SSW</i>	1	127	1.33	2.0	<i>NONE</i>	<i>NONE</i>
<i>SW</i>	1.1	1.65	1.65	<i>NONE</i>	<i>NONE</i>	<i>NONE</i>
<i>WSW</i>	1.1	1.62	2.22	1.62	<i>NONE</i>	<i>NONE</i>
<i>W</i>	1.1	1.5	1.93	4.4	<i>NONE</i>	<i>NONE</i>
<i>WNW</i>	1	1.1	2.67	4.98	<i>NONE</i>	<i>NONE</i>
<i>NW</i>	1	1.0	1.96	<i>NONE</i>	<i>NONE</i>	<i>NONE</i>
<i>NNW</i>	0.9	1.0	1.22	2.3	<i>NONE</i>	<i>NONE</i>

2013 to 2014 Land Use Census Changes			
Nearest	Direction	2013 Distance	2014 Distance
Resident	NONE		
Site Boundary	NONE		
Garden	WSW	2.36	2.22
	WNW	2.59	2.67
Meat Animal	NONE		
Milch Cow	NONE		
Milch Goat	NONE		

## APPENDIX B: SUMMARY OF INTERLABORATORY COMPARISONS

YEAR 2014

### INTRODUCTION

This appendix covers the Intercomparison Program of the Teledyne Brown Engineering – Environmental Services as required by technical specifications for the Radiological Environmental Monitoring Program (REMP). TBE uses QA/QC samples provided by Eckert & Zeigler Analytics, Inc, DOE's Mixed Analyte Performance Evaluation Program (MAPEP) and Environmental Resource Associates, (ERA) to monitor the quality of analytical processing associated with the REMP. The suite of samples is designed to be comparable with the pre-1996 US EPA Interlaboratory Cross-Check Program in terms of sample number, matrices, and nuclides. This includes:

E & Z Analytics:

Milk for gamma emitters, Iodine-131, Fe-55, Sr-89 and Sr-90 analyses once per quarter.

Air particulate for gamma emitters once per quarter

Charcoal for I-131 once per quarter

ERA

Water for tritium, gamma, Iodine-131, Sr-89, Sr-90, gross alpha and beta during the 2<sup>nd</sup> and 4<sup>th</sup> quarters.

Water for natural uranium during the 2<sup>nd</sup> quarter

DOE

Water and soil for gamma, Iodine-131, U-233/234, U-238, transuranics, tritium, Fe-55, Ni-63, Sr-90 and Tc-99 analyses during the 1<sup>st</sup> quarter.

Water for gross alpha and beta during the 1<sup>st</sup> and 3<sup>rd</sup> quarters.

Air particulates and vegetation for gamma, Iodine-131, U-233/234, U-238, transuranics, Sr-90 analyses during the 1<sup>st</sup> and 3<sup>rd</sup> quarters.

Air filter for gross alpha and beta analyses during the 1<sup>st</sup> and 3<sup>rd</sup> quarters.



## RESULTS

Interlaboratory comparison program results are evaluated using TBE's criterion. Any sample analysis result that does not pass the criteria is investigated by TBE. Nonconformance Reports were generated and corrective actions taken as a result of this program.

For the TBE laboratory, 163 out of 169 analyses performed met the specified acceptance criteria. Six analyses (Ni-63, K-40 and I-131 in water, and two Sr-90s and one Gross Alpha in AP samples) did not meet the specified acceptance criteria for the following reasons:

1. Teledyne Brown Engineering's MAPEP March 2014 Ni-63 in water result of  $32.7 \pm 1.69$  Bq/L was overlooked when reporting the data but would have passed the acceptance range of 23.9 – 44.2 Bq/L.
2. Teledyne Brown Engineering's MAPEP March 2014 K-40 in water result of  $1.63 \pm 2.49$  Bq/L was overlooked when reporting the data but would have passed the false positive test. NCR 14-04
3. Teledyne Brown Engineering's ERA November 2014 I-131 in water result of 15.8 pCi/L was lower than the known value of 20.3 pCi/L, failing below the lower acceptance limit of 16.8. The result was evaluated as failed with a found to known ratio of 0.778. No cause could be found for the slightly low result. All ERA I-131 evaluations since 2004 have been acceptable. NCR 14-08
4. Teledyne Brown Engineering's MAPEP March 2014 Sr-90 in AP result of 0.822 Bq/sample was lower than the known value of 1.18 Bq/sample, failing below the lower acceptance limit of 0.83 Bq/sample. The rerun result was still low, but fell within the lower acceptance range of 0.836. The rerun result was statistically the same number as the original result. No cause could be found for the slightly low results. NCR 14-04

5. Teledyne Brown Engineering's MAPEP September 2014 Sr-90 in AP result of 0.310 Bq/sample was lower than the known value of 0.703 Bq/sample. The gravimetric yield of 117% was very high (we normally see yields of 60% to 70 %) and could account for the low activity. NCR 14-09
  
6. Teledyne Brown Engineering's MAPEP September 2014 Gr-Alpha in AP result of 0.153 Bq/sample was lower than the known value of 0.53 Bq/sample. The AP sample was counted on the wrong side. The AP was flipped over and recounted with acceptable results. NCR 14-09

A summary of TBE's results is provided in the tables on the following pages for the required sample matrix types and isotopic distribution. Delineated in the table for each of the media/analysis combinations, are: the specific radionuclide; its result; analytical date; the known values supplied by the providers; pass or fail criteria.

**ANALYTICS ENVIRONMENTAL RADIOACTIVITY CROSS CHECK PROGRAM  
TELEDYNE BROWN ENGINEERING ENVIRONMENTAL SERVICES**

(PAGE 1 OF 3)

Month/Year	Identification Number	Matrix	Nuclide	Units	Reported Value (a)	Known Value (b)	Ratio (c) TBE/Analytics	Evaluation (d)			
March 2014	E10854	Milk	Sr-89	pCi/L	95.1	91.7	1.04	A			
			Sr-90	pCi/L	10.9	15.1	0.72	W			
March 2014	E10855	Milk	I-131	pCi/L	96.6	98.5	0.98	A			
			Ce-141	pCi/L	112	119	0.94	A			
			Cr-51	pCi/L	449	491	0.91	A			
			Cs-134	pCi/L	186	210	0.89	A			
			Cs-137	pCi/L	250	253	0.99	A			
			Co-58	pCi/L	248	268	0.93	A			
			Mn-54	pCi/L	292	297	0.98	A			
			Fe-59	pCi/L	230	219	1.05	A			
			Zn-65	pCi/L	312	323	0.97	A			
			Co-60	pCi/L	321	337	0.95	A			
			March 2014	E10857	AP	Ce-141	pCi	53.0	53.9	0.98	A
						Cr-51	pCi	232	223	1.04	A
						Cs-134	pCi	100	95.3	1.05	A
						Cs-137	pCi	122	115	1.06	A
Co-58	pCi	122				121	1.01	A			
Mn-54	pCi	135				135	1.00	A			
Fe-59	pCi	111				99.3	1.12	A			
Zn-65	pCi	140				147	0.95	A			
March 2014	E10856	Charcoal	I-131	pCi	74.1	76.4	0.97	A			
			Co-60	pCi	187	153	1.22	W			
March 2014	E10858	Water	Fe-55	pCi/L	2090	1760	1.19	A			
June 2014	E10913	Milk	Sr-89	pCi/L	85.9	91.3	0.94	A			
			Sr-90	pCi/L	13.8	14.5	0.95	A			
June 2014	E10914	Milk	I-131	pCi/L	86.5	90.9	0.95	A			
			Ce-141	pCi/L	111	124	0.90	A			
			Cr-51	pCi/L	255	253	1.01	A			
			Cs-134	pCi/L	147	162	0.91	A			
			Cs-137	pCi/L	123	120	1.03	A			
			Co-58	pCi/L	105	112	0.94	A			
			Mn-54	pCi/L	155	156	0.99	A			
			Fe-59	pCi/L	106	102	1.04	A			
			Zn-65	pCi/L	251	252	1.00	A			
			Co-60	pCi/L	218	224	0.97	A			
June 2014	E10916	AP	Ce-141	pCi	95.1	92.6	1.03	A			
			Cr-51	pCi	215	190	1.13	A			
			Cs-134	pCi	122	122	1.00	A			
			Cs-137	pCi	95.1	89.8	1.06	A			
			Co-58	pCi	88.7	84.1	1.05	A			

		Mn-54	pCi	115	116	0.99	A
		Fe-59	pCi	72.6	76.7	0.95	A
		Zn-65	pCi	193	189	1.02	A
		Co-60	pCi	179	168	1.07	A
E10915	Charcoal	I-131	pCi	85.6	85.2	1.00	A

**ANALYTICS ENVIRONMENTAL RADIOACTIVITY CROSS CHECK PROGRAM  
TELEDYNE BROWN ENGINEERING ENVIRONMENTAL SERVICES**

(PAGE 2 OF 3)

Month/Year	Identification			Units	Reported	Known	Ratio (c)	Evaluation (d)
	Number	Matrix	Nuclide		Value (a)	Value (b)	TBE/Analytics	
June 2014	E10917	Water	Fe-55	pCi/L	1680	1810	0.93	A
September 2014	E10946	Milk	Sr-89	pCi/L	90.7	96.9	0.94	A
			Sr-90	pCi/L	14.0	16.4	0.85	A
	E10947	Milk	I-131	pCi/L	92.0	97.6	0.94	A
			Ce-141	pCi/L	117	126	0.93	A
			Cr-51	pCi/L	281	288	0.98	A
			Cs-134	pCi/L	141	158	0.89	A
			Cs-137	pCi/L	186	193	0.96	A
			Co-58	pCi/L	137	143	0.96	A
			Mn-54	pCi/L	138	142	0.97	A
			Fe-59	pCi/L	162	158	1.03	A
			Zn-65	pCi/L	75.2	73.0	1.03	A
			Co-60	pCi/L	286	297	0.96	A
				E10949	AP	Ce-141	pCi	97.8
Cr-51	pCi	212				188	1.13	A
Cs-134	pCi	106				103	1.03	A
Cs-137	pCi	131				126	1.04	A
Co-58	pCi	85.7				93.0	0.92	A
Mn-54	pCi	92.8				92.3	1.01	A
Fe-59	pCi	113				103	1.10	A
Zn-65	pCi	53.2				47.5	1.12	A
		Co-60	pCi	202	193	1.05	A	
	E10948	Charcoal	I-131	pCi	83.9	89.8	0.93	A
	E10950	Water	Fe-55	pCi/L	2010	1720	1.17	A
	E10951	Soil	Ce-141	pCi/g	0.208	0.186	1.12	A
			Cr-51	pCi/g	0.398	0.425	0.94	A
			Cs-134	pCi/g	0.216	0.233	0.93	A
			Cs-137	pCi/g	0.398	0.365	1.09	A
			Co-58	pCi/g	0.197	0.211	0.93	A

			Mn-54	pCi/g	0.242	0.209	1.16	A
			Fe-59	pCi/g	0.238	0.233	1.02	A
			Zn-65	pCi/g	0.117	0.108	1.08	A
			Co-60	pCi/g	0.447	0.438	1.02	A
December 2014	E11078	Milk	Sr-89	pCi/L	85.7	95.7	0.90	A
			Sr-90	pCi/L	12.9	15.6	0.83	A
	E11079	Milk	I-131	pCi/L	85.9	95.1	0.90	A
Ce-141			pCi/L	205	219	0.94	A	
Cr-51			pCi/L	402	406	0.99	A	
Cs-134			pCi/L	156	164	0.95	A	
Cs-137			pCi/L	194	198	0.98	A	
Co-58			pCi/L	122	130	0.94	A	
Mn-54			pCi/L	220	225	0.98	A	
Fe-59			pCi/L	183	175	1.05	A	
Zn-65			pCi/L	287	297	0.97	A	
Co-60			pCi/L	224	235	0.95	A	

**ANALYTICS ENVIRONMENTAL RADIOACTIVITY CROSS CHECK PROGRAM**  
**TELEDYNE BROWN ENGINEERING ENVIRONMENTAL SERVICES**  
(PAGE 3 OF 3)

Month/Year	Identification Number	Matrix	Nuclide	Units	Reported Value (a)	Known Value (b)	Ratio (c) TBE/Analytics	Evaluation (d)
December 2014	E11081	AP	Ce-141	pCi	96.4	102	0.95	A
			Cr-51	pCi	171	190	0.90	A
			Cs-134	pCi	73.1	76.9	0.95	A
			Cs-137	pCi	99.0	92.6	1.07	A
			Co-58	pCi	57.5	60.8	0.95	A
			Mn-54	pCi	107	105	1.02	A
			Fe-59	pCi	74.2	81.6	0.91	A
			Zn-65	pCi	144	139	1.04	A
			Co-60	pCi	114	110	1.04	A
				E11080	Charcoal	I-131	pCi	93.5
	E11082	Water	Fe-55	pCi/L	1760	1970	0.89	A

(a) Teledyne Brown Engineering reported result.

(b) The Analytics known value is equal to 100% of the parameter present in the standard as determined by gravimetric, and/or volumetric measurements made during standard preparation.

(c) Ratio of Teledyne Brown Engineering to Analytics results.

(d) Analytics evaluation based on TBE internal QC limits: A= Acceptable, reported result falls within ratio limits of 0.80-1.20.

W=Acceptable with warning, reported result falls within 0.70-0.80 or 1.20-1.30. N = Not Acceptable, reported result falls outside the ratio limits of < 0.70 and > 1.30.

**DOE's MIXED ANALYTE PERFORMANCE EVALUATION PROGRAM (MAPEP)**  
**TELEDYNE BROWN ENGINEERING ENVIRONMENTAL SERVICES**  
(PAGE 1 OF 2)

Month/Year	Identification		Nuclide*	Units	Reported	Known	Acceptance	Evaluation (c)
	Number	Media			Value (a)	Value (b)	Range	
March 2014	14-MaW30	Water	Am-241	Bq/L	0.764	0.720	0.504 - 0.936	A
			Cs-134	Bq/L	20.7	23.1	16.2 - 30.0	A
			Cs-137	Bq/L	28.0	28.9	20.2 - 37.6	A
			Co-57	Bq/L	26.5	27.5	19.3 - 35.8	A
			Co-60	Bq/L	15.6	16.0	11.2 - 20.8	A
			H-3**	Bq/L	NR	321	225 - 417	N (3)
			Mn-54	Bq/L	13.5	13.9	9.7 - 18.1	A
			Ni-63	Bq/L	NR	34.0	23.8 - 44.2	N (3)
			Pu-238	Bq/L	0.911	0.828	0.580 - 1.076	
			Pu-239/240	Bq/L	0.751	0.676	0.473 - 0.879	
			K-40	Bq/L	NR		(1)	N (3)
			Sr-90**	Bq/L	NR	8.51	5.96 - 11.06	N (3)
			U-234/233**	Bq/L	NR	0.225	0.158 - 0.293	N (3)
			U-238**	Bq/L	NR	1.45	1.02 - 1.89	N (3)
			Zn-65	Bq/L	-0.201		(1)	A
	14-MaS30	Soil	Cs-134	Bq/kg	2.02		(1)	A
			Cs-137	Bq/kg	1300	1238	867 - 1609	A
			Co-57	Bq/kg	1069	966	676 - 1256	A
			Co-60	Bq/kg	1.32	1.22	(2)	A
			Mn-54	Bq/kg	1510	1430	1001 - 1859	A
			K-40	Bq/kg	669	622	435 - 809	A
			Sr-90	Bq/kg	4.14		(1)	A
			Zn-65	Bq/kg	763	695	487 - 904	A
				14-RdF30	AP	Cs-134**	Bq/sample	NR
Cs-137**	Bq/sample	NR				1.76	1.23 - 2.29	N (3)
Co-57**	Bq/sample	NR					(1)	N (3)
Co-60**	Bq/sample	NR				1.39	0.97 - 1.81	N (3)
Mn-54**	Bq/sample	NR					(1)	N (3)
Sr-90	Bq/sample	0.8220				1.18	0.83 - 1.53	N (3)
Zn-65**	Bq/sample	NR					(1)	N (3)
	14-GrF30	AP	Gr-A	Bq/sample	0.606	1.77	0.53 - 3.01	A
			Gr-B	Bq/sample	0.7507	0.77	0.39 - 1.16	A
	14-RdV30	Vegetation	Cs-134	Bq/sample	5.96	6.04	4.23 - 7.85	A
			Cs-137	Bq/sample	5.06	4.74	3.32 - 6.16	A
			Co-57	Bq/sample	11.8	10.1	7.1 - 13.1	A
			Co-60	Bq/sample	7.34	6.93	4.85 - 9.01	A
			Mn-54	Bq/sample	8.95	8.62	6.03 - 11.21	A
			Sr-90	Bq/sample	1.23	1.46	1.02 - 1.90	A
			Zn-65	Bq/sample	8.91	7.86	5.50 - 10.22	A

**DOE's MIXED ANALYTE PERFORMANCE EVALUATION PROGRAM (MAPEP)**  
**TELEDYNE BROWN ENGINEERING ENVIRONMENTAL SERVICES**  
**(PAGE 2 OF 2)**

Month/Year	Identification				Reported	Known	Acceptance	Evaluation (c)		
	Number	Media	Nuclide*	Units	Value (a)	Value (b)	Range			
September 2014	14-MaW31	Water	Am-241	Bq/L	0.705	0.88	0.62 - 1.14	A		
			Cs-134***	Bq/L	NR		(1)	N (4)		
			Cs-137***	Bq/L	NR	18.4	12.9 - 23.9	N (4)		
			Co-57***	Bq/L	NR	24.7	17.3 - 32.1	N (4)		
			Co-60***	Bq/L	NR	12.4	8.7 - 16.1	N (4)		
			Mn-54***	Bq/L	NR	14.0	9.8 - 18.2	N (4)		
			Ni-63	Bq/L	24.07	24.6	17.2 - 32.0	A		
			Pu-238	Bq/L	0.591	0.618	0.433 - 0.803	A		
			Pu-239/240	Bq/L	0.0153	0.0048	(2)	A		
			K-40***	Bq/L	NR	161	113 - 209	N (4)		
			Zn-65***	Bq/L	NR	10.9	7.6 - 14.2	N (4)		
			14-MaS31	Soil	Cs-134***	Bq/kg	NR	622	435 - 809	N (4)
					Cs-137***	Bq/kg	NR		(1)	N (4)
					Co-57***	Bq/kg	NR	1116	781 - 1451	N (4)
					Co-60***	Bq/kg	NR	779	545 - 1013	N (4)
Mn-54***	Bq/kg	NR			1009	706 - 1312	N (4)			
K-40***	Bq/kg	NR			824	577 - 1071	N (4)			
Sr-90	Bq/kg	694			858	601 - 1115	A			
Zn-65***	Bq/kg	NR			541	379 - 703	N (3)			
14-RdF31	AP	Sr-90	Bq/sample	0.310	0.703	0.492 - 0.914	N (4)			
14-GrF31	AP	Gr-A	Bq/sample	0.153	0.53	0.16 - 0.90	N (4)			
		Gr-B	Bq/sample	0.977	1.06	0.53 - 1.59	A			
September 2014	14-RdV31	Vegetation	Cs-134	Bq/sample	7.31	7.38	5.17 - 9.59	A		
			Cs-137	Bq/sample	8.93	8.14	5.70 - 10.58	A		
			Co-57	Bq/sample	10.8	9.2	6.4 - 12.0	A		
			Co-60	Bq/sample	6.31	6.11	4.28 - 7.94	A		
			Mn-54	Bq/sample	7.76	7.10	4.97 - 9.23	A		
			Sr-90	Bq/sample	0.738	0.85	0.60 - 1.11	A		
			Zn-65	Bq/sample	7.16	6.42	4.49 - 8.35	A		



\* The MAPEP cross check isotope list has been reduced due to duplication of effort or analysis not being performed for clients.  
\*\* Starting 3Q14, these nuclides will no longer be part of the TBE cross check program due to duplication of effort or analysis not being performed for clients. MAPEP evaluates non-reported analyses as failed if they were reported in the previous series.

\*\*\* All future gamma cross check samples for these isotopes will be provided by Analytics.

(1) *False positive test.*

(2) *Sensitivity evaluation*

(3) **Water, Ni-63** overlooked when reporting, but the result of 32.7 +/- 1.69 would have passed the acceptance criteria. NCR 14-04

**Water**, the non-detected **K-40** was overlooked when reporting, but would have passed the false positive test. NCR 14-04

**AP, Sr-90** rerun was within the low range of the acceptance criteria. The original and rerun results were statistically the same. No cause could be identified for the slightly low Sr-90 activity. NCR 14-04

For non reported (NR) analyses, MAPEP evaluates as failed if they were reported in the previous series. NCR 14-04

(4) **AP, Sr-90** gravimetric yield was very high at 117%. Could indicate larger than normal amounts of calcium in the AP. A second fuming HNO<sub>3</sub> separation would be required to remove the excess calcium; The Gross Alpha AP was counted on the wrong side. NCR 14-09

**AP, Gr-Beta** was counted on the wrong side. When flipped over and recounted the results were acceptable. NCR 14-09

For non reported (NR) analyses, MAPEP evaluates as failed if they were reported in the previous series. NCR 14-09

(a) *Teledyne Brown Engineering reported result.*

(b) *The MAPEP known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation.*

(c) *DOE/MAPEP evaluation: A=acceptable, W=acceptable with warning, N=not acceptable.*

**ERA ENVIRONMENTAL RADIOACTIVITY CROSS CHECK PROGRAM  
TELEDYNE BROWN ENGINEERING ENVIRONMENTAL SERVICES**

(PAGE 1 OF 1)

Month/Year	Identification				Reported	Known	Acceptance	Evaluation (c)			
	Number	Media	Nuclide	Units	Value (a)	Value (b)	Limits				
May 2014	RAD-97	Water	Sr-89	pCi/L	38.25	36.7	27.5 - 43.6	A			
			Sr-90	pCi/L	24.65	26.5	19.2 - 30.9	A			
			Ba-133	pCi/L	89.1	87.9	74.0 - 96.7	A			
			Cs-134	pCi/L	45.55	44.3	35.5 - 48.7	A			
			Cs-137	pCi/L	91.15	89.1	80.2 - 101	A			
			Co-60	pCi/L	65.10	64.2	57.8 - 73.1	A			
			Zn-65	pCi/L	244	235	212 - 275	A			
			Gr-A	pCi/L	45.65	61.0	31.9 - 75.8	A			
			Gr-B	pCi/L	27.95	33.0	21.4 - 40.7	A			
			I-131	pCi/L	23.75	25.7	21.3 - 30.3	A			
			U-Nat	pCi/L	9.61	10.2	7.95 - 11.8	A			
			H-3	pCi/L	8435	8770	7610 - 9650	A			
				MRAD-20	Filter	Gr-A	pCi/filter	28.0	46.0	15.4 - 71.4	A
			November 2014	RAD-99	Water	Sr-89	pCi/L	30.4	31.4	22.8 - 38.1	A
Sr-90	pCi/L	18.6				21.8	15.6 - 25.7	A			
Ba-133	pCi/L	46.8				49.1	40.3 - 54.5	A			
Cs-134	pCi/L	88.0				89.8	73.7 - 98.8	A			
Cs-137	pCi/L	99.0				98.8	88.9 - 111	A			
Co-60	pCi/L	92.5				92.1	82.9 - 104	A			
Zn-65	pCi/L	325				310	279 - 362	A			
Gr-A	pCi/L	29.9				37.6	19.4 - 48.1	A			
Gr-B	pCi/L	27.5				27.4	17.3 - 35.3	A			
I-131	pCi/L	15.8				20.3	16.8 - 24.4	N (1)			
U-Nat	pCi/L	5.74				5.80	4.34 - 6.96	A			
H-3	pCi/L	6255				6880	5940 - 7570	A			
	MRAD-21	Filter				Gr-A	pCi/filter	27.3	36.9	12.4 - 57.3	A

(1) The **Iodine-131** was evaluated as failed with a ratio of 0.778. No cause could be found for the slightly low activity. TBE would evaluate this as acceptable with warning. A rerun was not possible due to I-131 decay. All ERA Iodine-131 evaluations since 2004 have been acceptable. NCR 14-08

(a) Teledyne Brown Engineering reported result.

(b) The ERA known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation.

(c) ERA evaluation: A=acceptable. Reported result falls within the Warning Limits. N=not acceptable. Reported result falls outside of the Control Limits. CE=check for Error. Reported result falls within the Control Limits and outside of the Warning Limit.