



**MAY 11 2014**

L-PI-15-039  
TS 5.6.2  
ISFSI TS 5.2

U S Nuclear Regulatory Commission  
ATTN: Document Control Desk  
Washington, DC 20555-0001

Prairie Island Nuclear Generating Plant  
Units 1 and 2  
Dockets 50-282 and 50-306  
Renewed License Nos. DPR-42 and DPR-60

Prairie Island Independent Spent  
Fuel Storage Installation  
Docket 72-10  
Materials License No. SNM-2506

2014 Annual Radiological Environmental Monitoring Program (REMP) Report

Pursuant to Prairie Island Nuclear Generating Plant (PINGP) Technical Specification (TS) 5.6.2, Appendix A, to Renewed Operating Licenses DPR-42 and DPR-60, and Prairie Island Independent Spent Fuel Storage Installation Technical Specification (ISFSI TS) 5.2, Appendix A, to Materials License SNM-2506, Northern States Power Company, a Minnesota corporation, doing business as Xcel Energy (hereafter "NSPM"), submits one copy of the Annual Radiological Environmental Monitoring Program report for the period January 1, 2014, through December 31, 2014, as Enclosure 1.

Summary of Commitments

This letter contains no new commitment and no revision to any existing commitment.

Kevin Davison  
Site Vice President, Prairie Island Nuclear Generating Plant  
Northern States Power Company - Minnesota

Enclosure

cc: Regional Administrator, USNRC, Region III  
Project Manager, Prairie Island Nuclear Generating Plant, USNRC, NRR  
NRC Resident Inspector, Prairie Island Nuclear Generating Plant  
Billy Dickson, USNRC, Region III  
Director of NMSS, USNRC  
Department of Health, State of Minnesota  
PI Dakota Community Environmental Coordinator

NMSS26  
IE25

**ENCLOSURE 1**

Annual Report to the United States Nuclear Regulatory Commission

Radiological Environmental Monitoring Program

January 1 to December 31, 2014

73 pages follow



XCEL ENERGY CORPORATION  
PRAIRIE ISLAND NUCLEAR GENERATING PLANT  
ANNUAL REPORT  
to the  
UNITED STATES NUCLEAR REGULATORY COMMISSION

Radiological Environmental Monitoring Program

January 1 to December 31, 2014

Docket No. 50-282	License No. DPR-42
50-306	DPR-60
ISFSI	
Docket No.72-10	SNM-2506

Prepared under Contract by

ENVIRONMENTAL, Inc.  
MIDWEST LABORATORY

Project No. 8010

Approved:

---

Bronia Grob, M.S.  
Laboratory Manager

## PREFACE

The staff of Environmental, Inc., Midwest Laboratory was responsible for the acquisition of data presented in this report. Samples were collected by members of the staff of the Prairie Island Nuclear Generating Plant, operated by Northern States Power Co. –Minnesota, for XCEL Energy Corporation. The report was prepared by Environmental, Inc., Midwest Laboratory.

## TABLE OF CONTENTS

<u>Section</u>	<u>Page</u>
Preface .....	ii
List of Tables .....	iv
List of Figures .....	v
1.0 INTRODUCTION .....	1
2.0 SUMMARY .....	2
3.0 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM (REMP) .....	3
3.1 Program Design and Data Interpretation.....	3
3.2 Program Description.....	4
3.3 Program Execution.....	5
3.4 Laboratory Procedures.....	6
3.5 Program Modifications.....	6
3.6 Land Use Census.....	6
4.0 RESULTS AND DISCUSSION .....	7
4.1 Atmospheric Nuclear Detonations and Nuclear Accidents.....	7
4.2 Summary of Preoperational Data .....	7
4.3 Program Findings .....	8
5.0 FIGURES AND TABLES .....	12
6.0 REFERENCES CITED .....	24
<u>APPENDICES</u>	
A Interlaboratory Comparison Program Results .....	A-1
Attachment A, Acceptance Criteria for "Spiked" Samples.....	A-2
B Data Reporting Conventions .....	B-1
C Maximum Permissible Concentrations of Radioactivity in Air and Water Above Background in Unrestricted Areas .....	C-1
D Sampling Location Maps .....	D-1
E Special Well and Surface Water Samples .....	E-1

## LIST OF TABLES

<u>No.</u>	<u>Title</u>	<u>Page</u>
5.1	Sample Collection and Analysis Program.....	15
5.2	Sampling Locations.....	16
5.3	Missed Collections and Analyses .....	19
5.4	Radiological Environmental Monitoring Program Summary.....	20

In addition, the following tables can be found in the Appendices:

### Appendix A

A-1	Environmental Resources Associates, Crosscheck Program Results.....	A1-1
A-2	Program Results; (TLDs) .....	A2-1
A-3	In-house "Spiked" Samples .....	A3-1
A-4	In-house "Blank" Samples.....	A4-1
A-5	In-house "Duplicate" Samples.....	A5-1
A-6	Department of Energy MAPEP comparison results.....	A6-1
A-7	Environmental Resources Associates, Crosscheck Program Results (EML study replacement).....	A7-1

### Appendix C

C-1	Maximum Permissible Concentrations of Radioactivity in Air and Water Above Natural Background in Unrestricted Areas .....	C-2
-----	--	-----

### Appendix E

E-4.1	Sample collection and analysis program .....	E-5
E-4.2	Sampling locations .....	E-6
E-4.3	REMP Summary .....	E-8
E-4.4	REMP Complete Data Tables.....	E-9
E-4.5	Supplementary Data Tables .....	E-13

LIST OF FIGURES

<u>No.</u>	<u>Title</u>	<u>Page</u>
5.1	Offsite Ambient Radiation (TLDs), average of inner and outer ring indicator locations versus control .....	13
5.2	Airborne Particulates; analysis for gross beta, average mean of all indicator locations (P-2,3,4,6,7) versus control location (P-1) .....	14

MAPS

<u>Appendix D</u>	<u>Title</u>	<u>Page</u>
	TLD locations within a one mile radius .....	D-2
	TLD locations, Controls .....	D-3
	TLD locations, surrounding the ISFSI Area .....	D-3
	TLD locations within a five mile radius .....	D-4
	REMP sampling points within a one mile radius .....	D-5
	REMP sampling points within a five mile radius .....	D-6
	REMP sampling points, Control locations .....	D-7
<u>Appendix E</u>		
	Groundwater Monitoring Well locations .....	E-15

## 1.0 INTRODUCTION

This report summarizes and interprets results of the Radiological Environmental Monitoring Program (REMP) conducted by Environmental, Inc., Midwest Laboratory at the Prairie Island Nuclear Generating Plant, Red Wing, Minnesota, during the period January - December, 2014. This program monitors the levels of radioactivity in the air, terrestrial, and aquatic environments in order to assess the impact of the plant on its surroundings.

Tabulations of the individual analyses made during the year are not included in this report. These data are included in a reference document (Environmental, Inc., Midwest Laboratory, 2014b available at Prairie Island Nuclear Generating Plant.

Prairie Island Nuclear Generating Plant is located on the Mississippi River in Goodhue County, Minnesota, owned by Xcel Energy Corporation and operated by Northern States Power Co.-Minnesota. The plant has two 575 MWe pressurized water reactors. Unit 1 achieved initial criticality on 1 December 1973. Commercial operation at full power began on 16 December 1973. Unit 2 achieved initial criticality on 17 December 1974. Commercial operation at full power began on 21 December 1974.



## 2.0 SUMMARY

The Radiological Environmental Monitoring Program (REMP) required by the U.S. Nuclear Regulatory Commission (NRC) Offsite Dose Calculation Manual for the Prairie Island Nuclear Generating Plant and the Independent Spent Fuel Storage Installation (ISFSI) is described. Results for 2014 are summarized and discussed.

Program findings show background levels of radioactivity in the environmental samples collected in the vicinity of the Prairie Island Nuclear Generating Plant.

### 3.0 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM (REMP)

#### 3.1 Program Design and Data Interpretation

The purpose of the Radiological Environmental Monitoring Program (REMP) at the Prairie Island Nuclear Generating Plant is to assess the impact of the plant on its environment. For this purpose, samples are collected from the air, terrestrial, and aquatic environments and analyzed for radioactive content. In addition, ambient gamma radiation levels are monitored by thermoluminescent dosimeters (TLDs).

Sources of environmental radiation include the following:

- (1) Natural background radiation arising from cosmic rays and primordial radionuclides;
- (2) Fallout from atmospheric nuclear detonations;
- (3) Releases from nuclear power plants;
- (4) Industrial and medical radioactive waste; and
- (5) Fallout from nuclear accidents.

In interpreting the data, effects due to the plant must be distinguished from those due to other sources.

A major interpretive aid in assessment of these effects is the design of the monitoring program at the Prairie Island Plant which is based on the indicator-control concept. Most types of samples are collected both at indicator locations (nearby, downwind, or downstream) and at control locations (distant, upwind, or upstream). A plant effect would be indicated if the radiation level at an indicator location was significantly larger than that at the control location. The difference would have to be greater than could be accounted for by typical fluctuations in radiation levels arising from other sources.

An additional interpretive technique involves analyses for specific radionuclides present in the environmental samples collected from the plant site. The plant's monitoring program includes analyses for tritium and iodine-131. Most samples are analyzed for gamma-emitting isotopes with results for the following groups quantified: zirconium-95, cesium-137, cerium-144, beryllium-7, and potassium-40. The first three gamma-emitting isotopes were selected as radiological impact indicators because of the different characteristic proportions in which they appear in the fission product mix produced by a nuclear reactor and that produced by a nuclear detonation. Each of the three isotopes is produced in roughly equivalent amounts by a reactor: each constitutes about 10% of the total activity of fission products 10 days after reactor shutdown. On the other hand, 10 days after a nuclear explosion, the contributions of zirconium-95, cerium-144, and cesium-137 to the activity of the resulting debris are in the approximate ratio 4:1:0.03 (Eisenbud, 1963). Beryllium-7 is of cosmogenic origin and potassium-40 is a naturally-occurring isotope. They were chosen as calibration monitors and should not be considered radiological impact indicators.

The other group quantified consists of niobium-95, ruthenium-103 and -106, cesium-134, barium-lanthanum-140, and cerium-141. These isotopes are released in small quantities by nuclear power plants, but to date their major source of injection into the general environment has been atmospheric nuclear testing. Nuclides of the final group, manganese-54, iron-59, cobalt-58 and -60, and zinc-65, are activation products and arise from activation of corrosion products. They are typical components of a nuclear power plant's effluents, but are not produced in significant quantities by nuclear detonations.

### 3.1 Program Design and Data Interpretation (continued)

Other means of distinguishing sources of environmental radiation are employed in interpreting the data. Current radiation levels are compared with previous levels, including those measured before the Plant became operational. Results of the plant's monitoring program can be related to those obtained in other parts of the world. Finally, results can be related to events known to cause elevated levels of radiation in the environment, e.g., atmospheric nuclear detonations.

### 3.2 Program Description

The sampling and analysis schedule for the radiological environmental monitoring program at Prairie Island is summarized in Table 5.1 and briefly reviewed below. Table 5.2 defines the sampling location codes used in Table 5.1 and specifies for each location its type (indicator or control) and its distance, direction, and sector relative to the reactor site or ISFSI facility, as appropriate. To assure that sampling is carried out in a reproducible manner, detailed sampling procedures have been prescribed (Prairie Island Nuclear Generating Plant, 2014). Maps of fixed sampling locations are included in Appendix D.

To monitor the airborne environment, air is sampled by continuous pumping at six stations, four site boundary indicators (P-2, P-3, P-4 and P-7), located in the highest calculated D/Q sectors, one community indicator (P-6), and one control (P-1). The particulates are collected on membrane filters, airborne iodine is trapped by activated charcoal. Particulate filters are analyzed for gross beta activity and charcoal filters for iodine-131. Quarterly composites of particulate filters from each location are analyzed for gamma emitting isotopes.

Offsite ambient gamma radiation is monitored at thirty-four locations, using  $\text{CaSO}_4:\text{Dy}$  dosimeters with four sensitive areas at each location: ten in an inner ring in the general area of the site boundary, fifteen in the outer ring within a 4-5 mile radius, eight at special interest locations, and one control location, 11.1 miles distant from the plant. They are replaced and measured quarterly.

Ambient gamma radiation is monitored at the Independent Spent Fuel Storage Installation (ISFSI) Facility by twenty  $\text{CaSO}_4:\text{Dy}$  dosimeters. Twelve dosimeters are located inside of the earthen berm in direct line of sight from the storage casks and eight dosimeters are located outside of the earthen berm. They are replaced and measured quarterly.

Milk samples are collected monthly from three farms (two indicators and one control) and analyzed for iodine-131 and gamma-emitting isotopes. The milk is collected biweekly during the growing season (May - October), because the milk animals may be on pasture.

For additional monitoring of the terrestrial environment, green leafy vegetables (cabbage) are collected annually from the highest D/Q garden and a control location (P-38), and analyzed for gamma-emitting isotopes, including iodine-131. Corn is collected annually only if fields are irrigated with river water and analyzed for gamma-emitting isotopes. Well water and ground water are collected quarterly from four locations near the plant and analyzed for tritium and gamma-emitting isotopes.

River water is collected weekly at two locations, one upstream of the plant (P-5) and one downstream (P-6, Lock and Dam No.3). Monthly composites are analyzed for gamma-emitting isotopes. Quarterly composites are analyzed for tritium.

### 3.2 Program Description (continued)

Drinking water is collected weekly from the City of Red Wing well. Monthly composites are analyzed for gross beta, iodine-131, and gamma-emitting isotopes. Quarterly composites are analyzed for tritium.

The aquatic environment is also monitored by semi-annual upstream and downstream collections of fish, periphyton or invertebrates, and bottom sediments. Shoreline sediment is collected semi-annually from one location. All samples are analyzed for gamma-emitting isotopes.

### 3.3 Program Execution

The Program was executed as described in the preceding section with the following exceptions:

(1) Airborne Particulates / Airborne Iodine:

A partial sample was collected from location P-02 for the week ending January 29, 2014. Sampler runtime was approximately 45 hours. No air particulate / air iodine sample was available from location P-04 for the week ending February 20, 2014. The location was inaccessible due to snow. The February 27, 2014 samples from P-04 were for a two-week period. A partial sample was collected from location P-01 for the week ending April 30, 2014. Sampler runtime was approximately 108 hours.

(2) Milk:

There were no samples collected 05/13/14 from location P-18. The farm is no longer a dairy farm. There was no milk collected 12/16/14 at location P-37. The farm has temporarily suspended milking operations.

(3) TLD:

TLD's from location P-01A and P-10A were collected three days early due to potential flooding.

Deviations from the program are summarized in Table 5.3.

### 3.4 Laboratory Procedures

The iodine-131 analyses in milk and drinking water were made using a sensitive radiochemical procedure which involves separation of the iodine using an ion-exchange method, solvent extraction and subsequent beta counting.

Gamma-spectroscopic analyses are performed using high-purity germanium (HPGe) detectors. Levels of iodine-131 in cabbage and natural vegetation and concentrations of airborne iodine-131 in charcoal samples were determined by gamma spectroscopy.

Tritium concentrations are determined by liquid scintillation.

Analytical Procedures used by Environmental, Inc. are on file and are available for inspection. Procedures are based on those prescribed by the Health and Safety Laboratory of the U.S. Dep't of Energy, Edition 28, 1997, U.S. Environmental Protection Agency for Measurement of Radioactivity in Drinking Water, 1980, and the U.S. Environmental Protection Agency, EERF, Radiochemical Procedures Manual, 1984.

Environmental, Inc., Midwest Laboratory has a comprehensive quality control/quality assurance program designed to assure the reliability of data obtained. Details of the QA Program are presented elsewhere (Environmental, Inc., Midwest Laboratory, 2012). The QA Program includes participation in Interlaboratory Comparison (crosscheck) Programs. Results obtained in the crosscheck programs are presented in Appendix A.

### 3.5 Program Modifications

None.

### 3.6 Land Use Census

In accordance with the Prairie Island Nuclear Generating Plant Offsite Dose Calculation Manual, H4, (ODCM) a land use census is conducted in order to identify the location of the nearest milk animal, the nearest residence, and the nearest garden of greater than 500 ft<sup>2</sup> producing fresh leafy vegetables in each of the 16 meteorological sectors within a distance of 5 miles. This census is conducted at least once per 12 months between the dates of May 1 and October 31. If new locations yield a calculated dose or dose equivalent (via the same exposure pathway) twenty percent greater than the required locations per the ODCM, then the new locations are added to the radiological environmental monitoring program within 30 days, and sampling locations having lower calculated doses or a lower dose commitment may be deleted from this monitoring program after October 31 of the year in which the land use census was conducted.

This land use census insures the updating of the radiological environmental monitoring program should sampling locations change within the 5 mile radius from the plant.

The Land Use Census was completed in October, 2014. There were no changes to any of the highest D/Q locations for garden sites, or nearest residence. The nearest milk animal changed from P-18 to P-37 following the suspension of milking operations at P-18.

No downstream irrigation of corn was discovered within 5 miles of the Prairie Island Plant. Therefore, no corn samples were collected for analysis.

## 4.0 RESULTS AND DISCUSSION

All scheduled collections and analyses were made except those listed in Table 5.3.

The results are summarized in Table 5.4 in a format recommended by the Nuclear Regulatory Commission in Regulatory Guide 4.8. For each type of analysis of each sampled medium, this table lists the mean and range for all indicator locations and for all control locations. The locations with the highest mean and range are also shown.

### 4.1 Atmospheric Nuclear Detonations and Nuclear Accidents

There were no reported accidents involving significant release to the environment at nuclear reactor facilities in 2014. The Fukushima Daiichi nuclear accident occurred March 11, 2011.

There were no reported atmospheric nuclear tests in 2014. The last reported test was conducted on October 16, 1980 by the People's Republic of China.

### 4.2 Summary of Preoperational Data

The following constitutes a summary of preoperational studies conducted at the Prairie Island Nuclear Power Plant during the years 1970 to 1973, to determine background levels expected in the environment, and provided, where applicable, as a means for comparison with present day levels. Strict comparisons, however, are difficult, since background levels of radiation were much higher in these years due to radioactive fallout from the atmosphere. Gross beta measurements in fallout declined yearly from a level of 12,167 pCi/ m<sup>3</sup> to 1,020 pCi/ m<sup>3</sup>, and these declining values are reflected throughout the various media tested.

In the air environment, ambient gamma radiation (TLDs) averaged 9.4 mR/4 weeks during pre-operational studies. Gross beta in air particulates declined from levels of 0.38 to 0.037 pCi/m<sup>3</sup>. Average present day levels have stabilized at around 0.025 pCi/m<sup>3</sup>. Airborne radioiodine remained below detection levels.

In the terrestrial environment of 1970 to 1973, milk, agricultural crops, and soil were monitored. In milk samples, low levels of Cs-137, I-131, and Sr-90 were detected. Cs-137 levels declined from 16.5 to 8.6 pCi/L. Present day measurements for both Cs-137 and I-131 are below detection levels. Agricultural crop measurements averaged 57.7 pCi/g for gross beta and 0.47 pCi/g for Cs-137. Gross beta measured in soil averaged 52 pCi/g.

The aqueous environment was monitored by testing of river, well and lake waters, bottom sediments, fish, aquatic vegetation and periphyton. Specific location comparison of drinking, river and well water concentrations for tritium and gross beta are not possible. However, tritium background levels, measured at eight separate locations, declined steadily from an average concentration of 1020 pCi/L to 490 pCi/L. Present day environmental levels of tritium measure below a detection limit of approximately 160 pCi/L. Values for gross beta, measured from 1970 to 1973, averaged 9.9 pCi/L in downstream Mississippi River water, 8.2 pCi/L for well water, and 11.0 pCi/L for lake water. Gamma emitters were below the lower limit of detection (LLD). In bottom sediments, gross beta background levels were determined at 51.0 pCi/g. Cs-137 activity during preoperational studies in 1973 measured 0.25 pCi/g upstream and 0.21 pCi/g downstream. The lower levels occasionally observed today can still be attributed to residual activity from atmospheric fallout. Gross beta in fish, measured in both flesh and skeletal samples, averaged 7.3 and 11.7 pCi/g, respectively. Gross beta background levels in aquatic vegetation, algae and periphyton samples measured 76.0 pCi/g, 46.0 pCi/g, and 13.6 pCi/g, respectively.

#### 4.3 Program Findings

Results obtained show background levels of radioactivity in the environmental samples collected in the vicinity of the Prairie Island Nuclear Generating Plant.

##### Ambient Radiation (TLDs)

Ambient radiation was measured in the general area of the site boundary, at the outer ring 4 - 5 mi. distant from the Plant, at special interest areas and at one control location. The means ranged from 14.9 mR/91 days at inner ring locations to 15.7 mR/91 days at outer ring locations. The mean at special interest locations was 14.1 mR/91 days and 16.2 mR/91 days at the control location. Dose rates measured at the inner and outer ring and the control locations were comparable to 2013 dose rates and slightly lower than those observed from 1998 through 2012. The results are tabulated below. No plant effect on ambient gamma radiation measurements was indicated (Figure 5-1).

Year	Average (Inner and Outer Rings)	Control	Year	Average (Inner and Outer Rings)	Control
1999	16.6	17.5	2007	17.5	17.7
2000	17.0	17.1	2008	16.9	17.1
2001	16.8	17.2	2009	15.9	16.3
2002	17.4	16.9	2010	16.0	16.0
2003	16.2	16.0	2011	15.7	15.7
2004	17.6	17.6	2012	16.5	16.2
2005	16.8	16.3	2013	15.1	16.0
2006	16.6	16.6	2014	15.3	16.2

Ambient gamma radiation as measured by thermoluminescent dosimetry.  
Average quarterly dose rates (mR/91 days).

##### ISFSI Facility Operations Monitoring

Ambient radiation was measured inside the ISFSI earth berm, outside the ISFSI earth berm and at two special locations between the plant ISFSI and the Prairie Island Indian Community. The mean dose rates averaged 135.0 mR/91 days inside the ISFSI earth berm and 20.8 mR/91 days outside the ISFSI earth berm. Three additional casks were placed on the ISFSI pad in 2014, a total of thirty-eight loaded casks remain. The higher levels inside the earth berm are expected, due to the loaded spent fuel casks being in direct line-of-sight of the TLDs.

Ambient radiation levels measured outside the earth berm show a slight increase as compared to other offsite dose rates around the plant. The cumulative average of the two special Prairie Island Indian Community TLDs measured 13.2 and 13.5 mR/91 days. Although the skyshine neutron dose rates are not directly measured, the neutron levels measured next to the casks are below the levels predicted in the ISFSI SAR Report, Table 7A-4, "TN-40 Dose Rates at Short Distances". Therefore, the skyshine dose rates at farther distances from the casks should be at or below the calculated dose rates. No spent fuel storage effect on offsite ambient gamma radiation was indicated (Fig. 5-1).

### Airborne Particulates

Typically, the highest averages for gross beta occur during the months of January and December, and the first and fourth quarters, as in 1996 through 2006, and also in 2008 through 2010. The elevated activity observed in 2007 was attributed to construction activity in the area, an increase in dust and consequent heavier particulate filter loading.

Average annual gross beta concentrations in airborne particulates were 0.026 pCi/m<sup>3</sup> for both the indicators and the control location and similar to levels observed from 1999 through 2006 and 2008 to 2013. The results are tabulated below.

<u>Year</u>	<u>Average of Indicators</u>	<u>Control</u>
<u>Concentration (pCi/ m<sup>3</sup>)</u>		
1999	0.024	0.022
2000	0.025	0.025
2001	0.023	0.023
2002	0.028	0.023
2003	0.027	0.025
2004	0.025	0.026
2005	0.027	0.025
2006	0.026	0.025
2007	0.037	0.031
2008	0.028	0.027
2009	0.029	0.029
2010	0.025	0.025
2011	0.026	0.027
2012	0.031	0.032
2013	0.027	0.028
2014	0.026	0.026

Average annual gross beta concentrations in airborne particulates.

Gamma spectroscopic analysis of quarterly composites of air particulate filters yielded similar results for indicator and control locations. Beryllium-7, which is produced continuously in the upper atmosphere by cosmic radiation (Arnold and Al-Salih, 1955) was detected in all samples, with an average activity of 0.064 pCi/m<sup>3</sup> for indicator locations and 0.069 pCi/m<sup>3</sup> at the control locations. All other isotopes were below the lower limit of detection.

There was no indication of a plant effect.

### Airborne Iodine

Weekly levels of airborne iodine-131 were below the lower limit of detection (LLD) of 0.03 pCi/m<sup>3</sup> in all samples. There was no indication of a plant effect.



### Milk

Iodine-131 results were below a detection limit of 0.5 pCi/L in all samples.

Cs-137 results were below 5 pCi/L in all samples. No other gamma-emitting isotopes, except naturally occurring potassium-40, were detected in any milk sample. In general, radiocontaminants from cattlefeed are not found in milk, due to the selective metabolism of the cow. The common exceptions are isotopes of potassium, cesium, strontium, barium, and iodine (National Center for Radiological Health, 1968).

In summary, the data for 2014 show no radiological effects of the plant operation.

### Drinking Water

In drinking water from the City of Red Wing well, tritium activity measured below a detection limit of 177 pCi/L for all samples.

Gross beta concentrations averaged 11.5 pCi/L throughout the year, ranging from 6.1–18.1 pCi/L. These concentrations are consistent with levels observed from 1998 through 2013. The most likely contribution is the relatively high levels of naturally-occurring radium. Gamma spectroscopy indicates the presence of lead and bismuth isotopes, which are daughters of the radium decay chain. There is no indication from the 2014 data of any effect of plant operation.

<u>Year</u>		Gross Beta (pCi/L)
1999		5.3
2000		10.1
2001		8.3
2002		8.7
2003		9.9
2004		9.8
2005		11.5
2006		13.4
2007		11.6
2008		11.6
2009		11.4
2010		11.7
2011		12.4
2012		11.8
2013		12.2
2014		11.5

Average annual concentrations; Gross beta in drinking water.

### River Water

All river water samples measured below an LLD level of 179 pCi/L.

Gamma-emitting isotopes were below detection limits in all samples.

In summary, the data for 2014 show no radiological effects from the plant operation.

### Well Water

Water samples tested from the control well, P-43 (Peterson Farm) and from four indicator wells (P-8, Community Center, P-6, Lock and Dam No. 3, P-9, Plant Well No. 2 and P-24, Suter Farm ) showed no tritium detected above a detection limit of 172 pCi/L. Gamma-emitting isotopes were below detection limits in all samples.

In summary, well water data for 2014 show no radiological effects of the plant operation.

### Crops

Two samples of broadleaf vegetation, cabbage leaves, were collected in August, 2014 and analyzed for gamma-emitting isotopes, including iodine-131. The I-131 level was below 0.017 pCi/g wet weight in all samples. With exceptions for naturally-occurring beryllium-7 and potassium-40, all other gamma-emitting isotopes were below their respective detection limits. There was no indication of a plant effect.

Field sampling personnel conducted an annual land use survey and found no river water taken for irrigation into fields within 5 miles downstream from the Prairie Island Plant. The collection and analysis of corn samples was not required.

### Fish

Fish were collected in May and September, 2014 and analyzed for gamma emitting isotopes. Only naturally-occurring potassium-40 was detected, and there was no significant difference between upstream and downstream results. There was no indication of a plant effect.

### Aquatic Insects or Periphyton

Aquatic insects (invertebrates) or periphyton were collected in July and September, 2014 and analyzed for gamma-emitting isotopes. All gamma-emitting isotopes measured below detection limits. There was no indication of any plant effect.

### Bottom and Shoreline Sediments

Upstream and downstream bottom sediments and downstream recreational area shoreline sediments were sampled in July, September and October, 2014 and analyzed for gamma-emitting isotopes. The only gamma-emitting isotope detected was naturally-occurring potassium-40.

There was no indication of a plant effect.

## 5.0 FIGURES AND TABLES

Figure 5-1. Offsite Ambient Radiation (TLDs); average of inner and outer ring indicator locations versus control location.

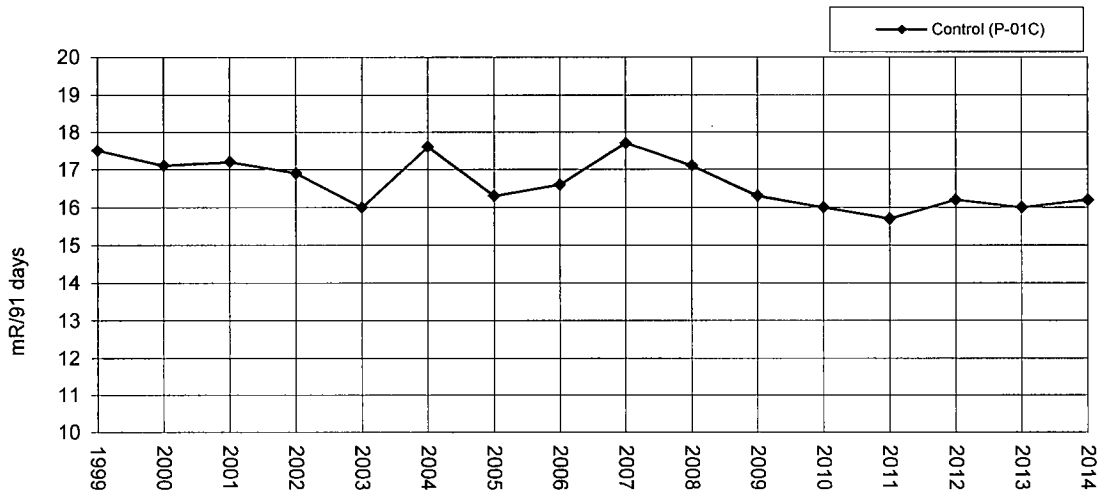
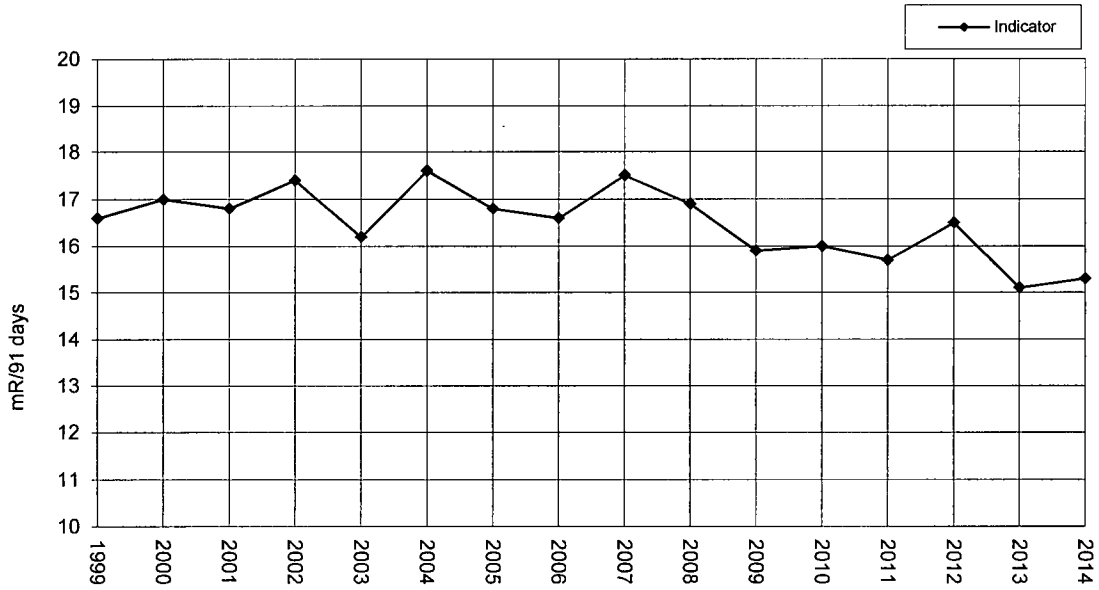


Figure 5-2. Airborne Particulates; analysis for gross beta, average mean of all indicator locations versus control location.

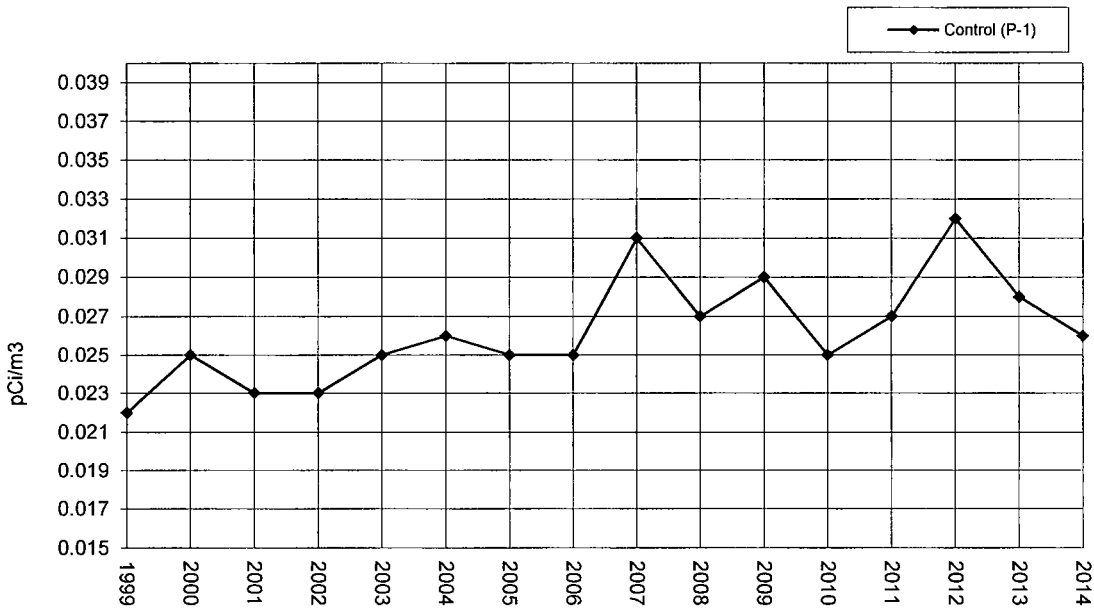


Table 5.1. Sample collection and analysis program, Prairie Island Nuclear Generating Plant.

Medium	Location		Collection Type and Frequency <sup>d</sup>	Analysis Type and Frequency <sup>c</sup>
	No.	Codes (and Type) <sup>a</sup>		
Ambient radiation (TLD's)	54	P-01A - P-10A P-01B - P-15B P-01S - P-08S P-01IA - P-08IA P-01IB - P-08IB P-01IX- P-04IX, P-01C	C/Q	Ambient gamma
Airborne Particulates	5	P-1(C), P-2, P-3, P-4, P-6, P-7	C/W	GB, GS (QC of each location)
Airborne Iodine	5	P-1(C), P-2, P-3, P-4, P-6, P-7	C/W	I-131
Milk	4	P-18, P-37, P-43 (C)	G/M <sup>d</sup>	I-131, GS
River water	2	P-5(C), P-6	G/W	GS(MC), H-3(QC)
Drinking water	1	P-11	G/W	GB(MC), I-131(MC) GS (MC), H-3 (QC)
Well water	5	P-6, P-8, P-9, P-24, P-43 (C)	G/Q	H-3, GS
Edible cultivated crops - leafy green vegetables	3	P-28, P-38(C), P-45	G/A	GS (I-131)
Fish (one species, edible portion)	2	P-19(C), P-13	G/SA	GS
Periphyton or invertebrates	2	P-40(C), P-6	G/SA	GS
Bottom sediment	2	P-20(C), P-6	G/SA	GS
Shoreline sediment	1	P-12	G/SA	GS

<sup>a</sup> Location codes are defined in Table D-2. Control stations are indicated by (C). All other stations are indicators.

<sup>b</sup> Collection type is coded as follows: C/ = continuous, G/ = grab. Collection frequency is coded as follows:  
W= weekly, M = monthly, Q = quarterly, SA = semiannually, A = annually.

<sup>c</sup> Analysis type is coded as follows: GB = gross beta, GS = gamma spectroscopy, H-3 = tritium, I-131 = iodine-131.  
Analysis frequency is coded as follows: MC = monthly composite, QC = quarterly composite.

<sup>d</sup> Milk is collected biweekly during the grazing season (May - October).

Table 5.2. Sampling locations, Prairie Island Nuclear Generating Plant.

Code	Type <sup>a</sup>	Collection Site	Sample Type <sup>b</sup>	Distance and Direction from Reactor
P-1	C	Air Station P-1	AP, AI	11.8 mi @ 316°/NNW
P-2		Air Station P-2	AP, AI	0.5 mi @ 294°/WNW
P-3		Air Station P-3	AP, AI	0.8 mi @ 313°/NW
P-4		Air Station P-4	AP, AI	0.4 mi @ 359°/N
P-5	C	Upstream of Plant	RW	1.8 mi @ 11°/N
P-6		Lock and Dam #3 & Air Station P-6	AP, AI, RW WW, BS, BO <sup>c</sup>	1.6 mi @ 129°/SE
P-7		Air Station P-7	AP, AI	0.5 mi @ 271°/W
P-8		Community Center	WW	1.0 mi @ 321°/WNW
P-9		Plant Well #2	WW	0.3 mi @ 306°/NW
P-11		Red Wing Service Center	DW	3.3 mi @ 158°/SSE
P-12		Downstream of Plant	SS	3.0 mi @ 116°/ESE
P-13		Downstream of Plant	F <sup>c</sup>	3.5 mi @ 113°/ESE
P-18		Christiansen Farm	M	3.8 mi @ 88°/E
P-19	C	Upstream of Plant	F <sup>c</sup>	1.3 mi @ 0°/N
P-20	C	Upstream of Plant	BS	0.9 mi @ 45°/NE
P-24		Suter Residence	WW	0.6 mi @ 158°/SSE
P-28		Allyn Residence	VE	1.0 mi @ 152°/SSE
P-37		Welsch Farm	M	4.1 mi @ 87°/E
P-38	C	Cain Residence	VE	14.2 mi @ 359°/N
P-40	C	Upstream of Plant	BO <sup>c</sup>	0.4 mi @ 0°/N
P-43	C	Peterson Farm	M, WW	13.9 mi. @ 355°/N
P-45		Glazier Residence	VE	0.6 mi. @ 341°/NNW
<b><u>General Area of the Site Boundary</u></b>				
P-01A		Property Line	TLD	0.4 mi @ 359°/N
P-02A		Property Line	TLD	0.3 mi @ 10°/N
P-03A		Property Line	TLD	0.5 mi @ 183°/S
P-04A		Property Line	TLD	0.4 mi @ 204°/SWW
P-05A		Property Line	TLD	0.4 mi @ 225°/SW
P-06A		Property Line	TLD	0.4 mi @ 249°/WSW
P-07A		Property Line	TLD	0.4 mi @ 268°/W
P-08A		Property Line	TLD	0.4 mi @ 291°/WNW
P-09A		Property Line	TLD	0.7 mi @ 317°/NW
P-10A		Property Line	TLD	0.5 mi @ 333°/NNW

Table 5.2. Sampling locations, Prairie Island Nuclear Generating Plant (continued).

Code	Type <sup>a</sup>	Collection Site	Sample Type <sup>d</sup>	Distance and Direction from Reactor
<b><u>Approximately 4 to 5 miles Distant from the Plant</u></b>				
P-01B		Thomas Killian Residence	TLD	4.7 mi @ 355°/N
P-02B		Roy Kinneman Residence	TLD	4.8 mi @ 17°/NNE
P-03B		Wayne Anderson Farm	TLD	4.9 mi @ 46°/NE
P-04B		Nelson Drive (Road)	TLD	4.2 mi @ 61°/ENE
P-05B		County Road E and Coulee	TLD	4.2 mi @ 102°/ESE
P-06B		William Hauschiblt Residence	TLD	4.4 mi @ 112°/ESE
P-07B		Red Wing Public Works	TLD	4.7 mi @ 140°/SE
P-08B		David Wnuk Residence	TLD	4.1 mi @ 165°/SSE
P-09B		Highway 19 South	TLD	4.2 mi @ 187°/S
P-10B		Cannondale Farm	TLD	4.9 mi @ 200°/SSW
P-11B		Wallace Weberg Farm	TLD	4.5 mi @ 221°/SW
P-12B		Ray Gergen Farm	TLD	4.6 mi @ 251°/WSW
P-13B		Thomas O'Rourke Farm	TLD	4.4 mi @ 270°/W
P-14B		David J. Anderson Farm	TLD	4.9 mi @ 306°/NW
P-15B		Holst Farms	TLD	3.8 mi @ 345°/NNW
<b><u>Special Interest Locations</u></b>				
P-01S		Federal Lock & Dam #3	TLD	1.6 mi @ 129°/SE
P-02S		Charles Suter Residence	TLD	0.5 mi @ 155°/SSE
P-03S		Carl Gustafson Farm	TLD	2.2 mi @ 173°/S
P-04S		Richard Burt Residence	TLD	2.0 mi @ 202°/SSW
P-05S		Kinney Store	TLD	2.0 mi @ 270°/W
P-06S		Earl Flynn Farm	TLD	2.5 mi @ 299°/WNW
P-07S		Indian Community	TLD	0.7 mi @ 271°/W
P-08S		Indian Community	TLD	0.7 mi @ 287°/NWW
P-01C	C	Robert Kinneman Farm	TLD	11.1 mi @ 331°/NNW



Table 5.2. Sampling locations, Prairie Island Nuclear Generating Plant (continued).

Code	Type <sup>a</sup>	Collection Site	Sample Type <sup>d</sup>	Distance and Direction from ISFSI Center.
<u>ISFSI Area Inside Earth Berm</u>				
P-01IA		ISFSI Nuisance Fence	TLD	190° @ 45°/NE
P-02IA		ISFSI Nuisance Fence	TLD	360° @ 82°/E
P-03IA		ISFSI Nuisance Fence	TLD	370° @ 100°/E
P-04IA		ISFSI Nuisance Fence	TLD	200° @ 134°/SE
P-05IA		ISFSI Nuisance Fence	TLD	180° @ 219°/SW
P-06IA		ISFSI Nuisance Fence	TLD	320° @ 258°/WSW
P-07IA		ISFSI Nuisance Fence	TLD	320° @ 281°/WNW
P-08IA		ISFSI Nuisance Fence	TLD	190° @ 318°/NW
P-01IX		ISFSI Nuisance Fence	TLD	140° @ 180°/S
P-02IX		ISFSI Nuisance Fence	TLD	310° @ 270°/W
P-03IX		ISFSI Nuisance Fence	TLD	140° @ 0°/N
P-04IX		ISFSI Nuisance Fence	TLD	360° @ 90°/E
<u>ISFSI Area Outside Earth Berm</u>				
P-01IB		ISFSI Berm Area	TLD	340° @ 3°/N
P-02IB		ISFSI Berm Area	TLD	380° @ 28°/NNE
P-03IB		ISFSI Berm Area	TLD	560° @ 85°/E
P-04IB		ISFSI Berm Area	TLD	590° @ 165°/SSE
P-05IB		ISFSI Berm Area	TLD	690° @ 186°/S
P-06IB		ISFSI Berm Area	TLD	720° @ 201°/SSW
P-07IB		ISFSI Berm Area	TLD	610° @ 271°/W
P-08IB		ISFSI Berm Area	TLD	360° @ 332°/NNW

<sup>a</sup> "C" denotes control location. All other locations are indicators.

<sup>b</sup> Sample Codes:

AP	Airborne particulates	F	Fish
AI	Airborne iodine	M	Milk
BS	Bottom (river) sediments	SS	Shoreline Sediments
BO	Bottom organisms (periphyton or macroinvertebrates)	SW	Surface Water
		VE	Vegetation/vegetables
DW	Drinking water	WW	Well water

<sup>c</sup> Distance and direction data for fish and bottom organisms are approximate since availability of sample specimen may vary at any one location.

**Table 5.3. Missed collections and analyses at the Prairie Island Nuclear Generating Plant.**

All required samples were collected and analyzed as scheduled with the following exceptions:

Sample Type	Analysis	Location	Collection Date or Period	Reason for not conducting REMP as required	Plans for Preventing Recurrence
AP/AI	Beta, I-131	P-2	1/29/2014	Blown fuse on pump.	Pump replaced.
AP/AI	Beta, I-131	P-4	2/20/2014	Location inaccessible due to snow.	None required.
AP/AI	Beta, I-131	P-1	4/30/2014	Blown fuse on pump.	Pump replaced.
MI	Gamma, I-131	P-18	5/13/2014	Farm is no longer a dairy farm.	None required.
TLD	Gamma	P-01A, P-10A	06/23/14	Samples collected three days early due to potential flooding.	None required.
MI	Gamma, I-131	P-37	12/16/2014	Welsch Farm has temporarily suspended milking operations.	None required.

Table 5.4 Radiological Environmental Monitoring Program Summary

Name of Facility	<u>Prairie Island Nuclear Power Station</u>	Docket No.	<u>50-282, 50-306</u>
Location of Facility	<u>Goodhue, Minnesota</u>	Reporting Period	<u>January-December, 2014</u>
	(County, State)		

Sample Type (Units)	Type and Number of Analyses <sup>a</sup>	LLD <sup>b</sup>	Indicator Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Location with Highest Annual Mean		Control Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Number Non-Routine Results <sup>e</sup>
				Location <sup>d</sup>	Mean (F) <sup>c</sup> Range <sup>c</sup>		
<b>Direct Radiation</b>							
TLD (Inner Ring, Area at Site Boundary) mR/91 days)	Gamma 40	3.0	14.9 (40/40) ( 11.8-19.6)	P-05A 0.4 mi @ 225° /SW	16.6 (4/4) (14.8-19.6)	(See Control below.)	0
TLD (Outer Ring, 4-5 mi. distant) mR/91 days)	Gamma 60	3.0	15.7 (60/60) ( 11.8-20.2)	P-04B, Nelson Dr., 4.2 mi @ 61° /ENE	18.8 (4/4) (16.7-20.2)	(See Control below.)	0
TLD (Special Interest Areas) mR/91 days)	Gamma 32	3.0	14.1 (32/32) ( 11.5-18.3)	P-04S, Burt Residence, 2.0 mi @ 202°/SSW	16.3 (4/4) (15.1-18.3)	(See Control below.)	0
TLD (Control) mR/91 days)	Gamma 4	3.0	None	P-01C, Robert Kinneman 11.1 mi @ 331° /NNW	16.2 (4/4) (14.7-19.7)	16.2 (4/4) (14.7-19.7)	0
<b>Airborne Pathway</b>							
Airborne Particulates (pCi/m <sup>3</sup> )	GB 311	0.005	0.026 (259/259) (0.008-0.053)	P-03, Air Station 0.8 mi @ 313° /NW	0.026 (52 /52) (0.010-0.051)	0.026 (52/52) (0.010-0.052)	0
	GS 24	0.015	0.064 (20/20) (0.041-0.095)	P-01, Air Station 11.8 mi @ 316° /NNW	0.069 (4/4) (0.043-0.086)	0.069 (4/4) (0.043-0.086)	0
	Mn-54	0.0008	< LLD	-	-	< LLD	0
	Co-58	0.0008	< LLD	-	-	< LLD	0
	Co-60	0.0008	< LLD	-	-	< LLD	0
	Zn-65	0.0015	< LLD	-	-	< LLD	0
	Zr-Nb-95	0.0011	< LLD	-	-	< LLD	0
	Ru-103	0.0011	< LLD	-	-	< LLD	0
	Ru-106	0.0065	< LLD	-	-	< LLD	0
	Cs-134	0.0007	< LLD	-	-	< LLD	0
	Cs-137	0.0008	< LLD	-	-	< LLD	0
	Ba-La-140	0.0035	< LLD	-	-	< LLD	0
	Ce-141	0.0015	< LLD	-	-	< LLD	0
	Ce-144	0.0042	< LLD	-	-	< LLD	0
Airborne Iodine (pCi/m <sup>3</sup> )	I-131 311	0.030	< LLD	-	-	< LLD	0

Table 5.4 Radiological Environmental Monitoring Program Summary

Name of Facility	<u>Prairie Island Nuclear Power Station</u>	Docket No.	<u>50-282, 50-306</u>
Location of Facility	<u>Goodhue, Minnesota</u> ( County, State )	Reporting Period	<u>January-December, 2014</u>

Sample Type (Units)	Type and Number of Analyses <sup>a</sup>	LLD <sup>b</sup>	Indicator Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Location with Highest Annual Mean		Control Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Number Non-Routine Results <sup>e</sup>
				Location <sup>d</sup>	Mean (F) <sup>c</sup> Range <sup>c</sup>		
<b>Terrestrial Pathway</b>							
Milk (pCi/L)	I-131 39	0.5	< LLD	-	-	< LLD	0
	GS 39						
	K-40 200		1378 (21/21) (1294-1521)	P-43 (C), Peterson Farm 13.9 mi @ 355° /N	1424 (18 /18) (1318-1511)	1424 (18/18) (1318-1511)	0
	Cs-134 5		< LLD	-	-	< LLD	0
	Cs-137 5		< LLD	-	-	< LLD	0
	Ba-La-140 5		< LLD	-	-	< LLD	0
Crops - Cabbage (pCi/gwet)	I-131 2	0.017	< LLD	-	-	< LLD	0
Well Water (pCi/L)	H-3 20	172	< LLD	-	-	< LLD	0
	GS 20						
	Mn-54 10		< LLD	-	-	< LLD	0
	Fe-59 30		< LLD	-	-	< LLD	0
	Co-58 10		< LLD	-	-	< LLD	0
	Co-60 10		< LLD	-	-	< LLD	0
	Zn-65 30		< LLD	-	-	< LLD	0
	Zr-Nb-95 15		< LLD	-	-	< LLD	0
	Cs-134 10		< LLD	-	-	< LLD	0
	Cs-137 10		< LLD	-	-	< LLD	0
	Ba-La-140 15		< LLD	-	-	< LLD	0
Ce-144 38		< LLD	-	-	< LLD	0	

Table 5.4 Radiological Environmental Monitoring Program Summary

Name of Facility Prairie Island Nuclear Power Station Docket No. 50-282, 50-306  
 Location of Facility Goodhue, Minnesota Reporting Period January-December, 2014  
 (County, State)

Sample Type (Units)	Type and Number of Analyses <sup>a</sup>	LLD <sup>b</sup>	Indicator Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Location with Highest Annual Mean		Control Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Number Non-Routine Results <sup>e</sup>
				Location <sup>d</sup>	Mean (F) <sup>c</sup> Range <sup>c</sup>		
<b>Waterborne Pathway</b>							
Drinking Water (pCi/L)	GB 12	1.0	11.5 (12/12) (6.1-18.1)	P-11, Red Wing S.C. 3.3 mi @ 158° /SSE	11.5 (12/12) (6.1-18.1)	None	0
	I-131 12	1.0	< LLD	-	-	None	0
	H-3 4	177	< LLD	-	-	None	0
	GS 12						
	Mn-54	10	< LLD	-	-	None	0
	Fe-59	30	< LLD	-	-	None	0
	Co-58	10	< LLD	-	-	None	0
	Co-60	10	< LLD	-	-	None	0
	Zn-65	30	< LLD	-	-	None	0
	Zr-Nb-95	15	< LLD	-	-	None	0
	Cs-134	10	< LLD	-	-	None	0
	Cs-137	10	< LLD	-	-	None	0
	Ba-La-140	15	< LLD	-	-	None	0
Ce-144	43	< LLD	-	-	None	0	
River Water (pCi/L)	H-3 8	179	< LLD	-	-	< LLD	0
	GS 24						
	Mn-54	10	< LLD	-	-	< LLD	0
	Fe-59	30	< LLD	-	-	< LLD	0
	Co-58	10	< LLD	-	-	< LLD	0
	Co-60	10	< LLD	-	-	< LLD	0
	Zn-65	30	< LLD	-	-	< LLD	0
	Zr-Nb-95	15	< LLD	-	-	< LLD	0
	Cs-134	10	< LLD	-	-	< LLD	0
	Cs-137	10	< LLD	-	-	< LLD	0
	Ba-La-140	15	< LLD	-	-	< LLD	0
Ce-144	27	< LLD	-	-	< LLD	0	
Fish (pCi/g wet)	GS 6						
	K-40	0.10	2.92 (6/6) (2.54-3.36)	P-19, Upstream 1.3 mi @ 0°/N	3.04 (6/6) (2.82-3.37)	3.04 (6/6) (2.82-3.37)	0
	Mn-54	0.03	< LLD	-	-	< LLD	0
	Fe-59	0.15	< LLD	-	-	< LLD	0
	Co-58	0.03	< LLD	-	-	< LLD	0
	Co-60	0.022	< LLD	-	-	< LLD	0
	Zn-65	0.049	< LLD	-	-	< LLD	0
	Zr-Nb-95	0.099	< LLD	-	-	< LLD	0
	Cs-134	0.022	< LLD	-	-	< LLD	0
	Cs-137	0.022	< LLD	-	-	< LLD	0
Ba-La-140	1.97	< LLD	-	-	< LLD	0	

Table 5.4 Radiological Environmental Monitoring Program Summary

Name of Facility	<u>Prairie Island Nuclear Power Station</u>	Docket No.	<u>50-282, 50-306</u>
Location of Facility	<u>Goodhue, Minnesota</u>	Reporting Period	<u>January-December, 2014</u>
	( County, State )		

Sample Type (Units)	Type and Number of Analyses <sup>a</sup>	LLD <sup>b</sup>	Indicator Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Location with Highest Annual Mean		Control Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Number Non-Routine Results <sup>e</sup>
				Location <sup>d</sup>	Mean (F) <sup>c</sup> Range <sup>c</sup>		
<b>Waterborne Pathway</b>							
Invertebrates (pCi/g wet)	GS 4						
	Be-7	1.04	< LLD	-	-	< LLD	0
	K-40	0.98	< LLD	-	-	< LLD	0
	Mn-54	0.058	< LLD	-	-	< LLD	0
	Co-58	0.089	< LLD	-	-	< LLD	0
	Co-60	0.048	< LLD	-	-	< LLD	0
	Zn-65	0.13	< LLD	-	-	< LLD	0
	Zr-Nb-95	0.24	< LLD	-	-	< LLD	0
	Ru-103	0.17	< LLD	-	-	< LLD	0
	Ru-106	0.42	< LLD	-	-	< LLD	0
	Cs-134	0.048	< LLD	-	-	< LLD	0
	Cs-137	0.057	< LLD	-	-	< LLD	0
	Ba-La-140	2.98	< LLD	-	-	< LLD	0
	Ce-141	0.35	< LLD	-	-	< LLD	0
Ce-144	0.29	< LLD	-	-	< LLD	0	
Bottom and Shoreline Sediments (pCi/g dry)	GS 6						
	Be-7	0.35	< LLD	-	-	< LLD	0
	K-40	0.10	8.10 (4/4) (6.87-9.35)	P-26, Lock & Dam No. 3 1.6 mi @ 129°SE	9.24 (2/2) (9.13-9.35)	9.18 (2/2) (9.00-9.36)	0
	Mn-54	0.017	< LLD	-	-	< LLD	0
	Co-58	0.021	< LLD	-	-	< LLD	0
	Co-60	0.016	< LLD	-	-	< LLD	0
	Zn-65	0.047	< LLD	-	-	< LLD	0
	Zr-Nb-95	0.036	< LLD	-	-	< LLD	0
	Ru-103	0.032	< LLD	-	-	< LLD	0
	Ru-106	0.11	< LLD	-	-	< LLD	0
	Cs-134	0.012	< LLD	-	-	< LLD	0
	Cs-137	0.017	< LLD	-	-	< LLD	0
	Ba-La-140	0.24	< LLD	-	-	< LLD	0
	Ce-141	0.08	< LLD	-	-	< LLD	0
Ce-144	0.11	< LLD	-	-	< LLD	0	

<sup>a</sup> GB = gross beta, GS = gamma scan.

<sup>b</sup> LLD = nominal lower limit of detection based on a 4.66 sigma counting error for background sample.

<sup>c</sup> Mean and range are based on detectable measurements only. Fraction of detectable measurements at specified locations is indicated in parentheses (F).

<sup>d</sup> Locations are specified: (1) by name, and/or station code and (2) by distance (miles) and direction relative to reactor site.

<sup>e</sup> Non-routine results are those which exceed ten times the control station value. If no control station value is available, the result is considered non-routine if it exceeds ten times the typical preoperational value for the medium or location.

## 6.0 REFERENCES CITED

- Arnold, J. R. and H. A. Al-Salih. 1955. Beryllium-7 Produced by Cosmic Rays. *Science* 121: 451-453.
- Eisenbud, M. 1963. *Environmental Radioactivity*, McGraw-Hill, New York, New York, pp. 213, 275 and 276.
- Environmental, Inc., Midwest Laboratory.
- \_\_\_\_\_ 2001a through 2014a. Radiation Environmental Monitoring for Monticello Nuclear Generating Plant, Complete Analysis Data Tables, January-December, 2000 through 2014.
- \_\_\_\_\_ 2001b through 2014b. Radiation Environmental Monitoring for Prairie Island Nuclear Generating Plant, Complete Analysis Data Tables, January - December, 2000 through 2014.
- \_\_\_\_\_ 1984a to 2000a. (formerly Teledyne Brown Engineering Environmental Services, Midwest Laboratory) Radiation Environmental Monitoring for Monticello Nuclear Generating Plant, Complete Analysis Data Tables, January - December, 1983 through 1999.
- \_\_\_\_\_ 1984b to 2000b. (formerly Teledyne Brown Engineering Environmental Services, Midwest Laboratory) Radiation Environmental Monitoring for Prairie Island Nuclear Generating Plant, Complete Analysis Data Tables, January - December, 1983 through 1999.
- \_\_\_\_\_ 1979a to 1983a. (formerly Hazleton Environmental Sciences Corporation) Radiation Environmental Monitoring for Monticello Nuclear Generating Plant, Complete Analysis Data Tables, January - December, 1978 through 1982.
- \_\_\_\_\_ 1979b to 1983b. (formerly Hazleton Environmental Sciences Corporation) Radiation Environmental Monitoring for Prairie Island Nuclear Generating Plant, Complete Analysis Data Tables, January - December, 1978 through 1982.
- \_\_\_\_\_ 2012. Quality Assurance Program Manual, Rev. 3, 14 November 2012.
- \_\_\_\_\_ 2009. Quality Control Procedures Manual, Rev. 2, 08 July 2009.
- \_\_\_\_\_ 2009. Quality Control Program, Rev. 2, 12 November 2009.
- Gold, S., H. W. Barkhau, B. Shlein, and B. Kahn, 1964. Measurement of Naturally Occurring Radionuclides in Air, in the Natural Environment, University of Chicago Press, Chicago, Illinois, 369-382.
- National Center for Radiological Health, 1968. *Radiological Health and Data Reports*, Vol. 9, No. 12, 730-746.
- Northern States Power Company.
- \_\_\_\_\_ 1972 through 1974. Prairie Island Nuclear Generating Plant, Environmental Monitoring and Ecological Studies Program, January 1, 1971 to December 31, 1971, 1972, 1973. Minneapolis, Minnesota.
- \_\_\_\_\_ 1979 to 2008. *Prairie Island Nuclear Generating Plant, Annual Radiation Environmental Monitoring Report to the U.S. Nuclear Regulatory Commission*, January 1 to December 31, 1978 through 2007. Minneapolis, Minnesota.
- Prairie Island Nuclear Generating Plant, 2013. *Radiological Environmental Monitoring for Prairie Island Nuclear Generating Plant, Radiation Protection Implementing Procedures*, 4700 series.
- U.S. Dep't of Energy 1997 HASL-300, Edition 28, Procedures Manual, Environmental Measurements Laboratory, New York, NY.

## 6.0 REFERENCES CITED (continued)

U.S. Environmental Protection Agency .

\_\_\_\_\_ 1980. Prescribed Procedures for Measurement of Radioactivity in Drinking Water, Cincinnati, Ohio (EPA-600/4-80-032).

\_\_\_\_\_ 1984. Eastern Environmental Radiation Facility, Radiochemistry Procedures Manual, Montgomery, Alabama (EPA-520/5-84-006).

\_\_\_\_\_ 2012. RadNet, formerly Environmental Radiation Ambient Monitoring System, Gross Beta in Air, Gross Beta in Drinking Water (MN) 1981– 2009.

Wilson, D. W., G. M. Ward and J. E. Johnson. 1969. In Environmental Contamination by Radioactive Materials, International Atomic Energy Agency. p.125.

Xcel Energy Corporation.

\_\_\_\_\_ 2009 to 2014. Monticello Nuclear Generating Plant, Annual Radiological Environmental Monitoring Report to the U.S. Nuclear Regulatory Commission, January 1 to December 31, 2008 through 2013. Minneapolis, Minnesota.

\_\_\_\_\_ 2009 to 2014. Prairie Island Nuclear Generating Plant, Annual Radiological Environmental Monitoring Report to the U.S. Nuclear Regulatory Commission, January 1 to December 31, 2008 through 2013. Minneapolis, Minnesota.





## APPENDIX A

### INTERLABORATORY COMPARISON PROGRAM RESULTS

**NOTE:** Environmental Inc., Midwest Laboratory participates in intercomparison studies administered by Environmental Resources Associates, and serves as a replacement for studies conducted previously by the U.S. EPA Environmental Monitoring Systems Laboratory, Las Vegas, Nevada. Results are reported in Appendix A. TLD Intercomparison results, in-house spikes, blanks, duplicates and mixed analyte performance evaluation program results are also reported. Appendix A is updated four times a year; the complete Appendix is included in March, June, September and December monthly progress reports only.

January, 2014 through December, 2014

## Appendix A

### Interlaboratory Comparison Program Results

Environmental, Inc., Midwest Laboratory has participated in interlaboratory comparison (crosscheck) programs since the formulation of its quality control program in December 1971. These programs are operated by agencies which supply environmental type samples containing concentrations of radionuclides known to the issuing agency but not to participant laboratories. The purpose of such a program is to provide an independent check on a laboratory's analytical procedures and to alert it of any possible problems.

Participant laboratories measure the concentration of specified radionuclides and report them to the issuing agency. Several months later, the agency reports the known values to the participant laboratories and specifies control limits. Results consistently higher or lower than the known values or outside the control limits indicate a need to check the instruments or procedures used.

Results in Table A-1 were obtained through participation in the environmental sample crosscheck program administered by Environmental Resources Associates, serving as a replacement for studies conducted previously by the U.S. EPA Environmental Monitoring Systems Laboratory, Las Vegas, Nevada.

Table A-2 lists results for thermoluminescent dosimeters (TLDs), via International Intercomparison of Environmental Dosimeters, when available, and internal laboratory testing.

Table A-3 lists results of the analyses on in-house "spiked" samples for the past twelve months. All samples are prepared using NIST traceable sources. Data for previous years available upon request.

Table A-4 lists results of the analyses on in-house "blank" samples for the past twelve months. Data for previous years available upon request.

Table A-5 lists REMP specific analytical results from the in-house "duplicate" program for the past twelve months. Acceptance is based on the difference of the results being less than the sum of the errors. Complete analytical data for duplicate analyses is available upon request.

The results in Table A-6 were obtained through participation in the Mixed Analyte Performance Evaluation Program.

Results in Table A-7 were obtained through participation in the environmental sample crosscheck program administered by Environmental Resources Associates, serving as a replacement for studies conducted previously by the Environmental Measurement Laboratory Quality Assessment Program (EML).

Attachment A lists the laboratory precision at the 1 sigma level for various analyses. The acceptance criteria in Table A-3 is set at  $\pm 2$  sigma.

Out-of-limit results are explained directly below the result.

Attachment A

ACCEPTANCE CRITERIA FOR "SPIKED" SAMPLES

LABORATORY PRECISION: ONE STANDARD DEVIATION VALUES FOR VARIOUS ANALYSES<sup>a</sup>

<u>Analysis</u>	<u>Level</u>	<u>One standard deviation for single determination</u>
Gamma Emitters	5 to 100 pCi/liter or kg > 100 pCi/liter or kg	5.0 pCi/liter 5% of known value
Strontium-89 <sup>b</sup>	5 to 50 pCi/liter or kg > 50 pCi/liter or kg	5.0 pCi/liter 10% of known value
Strontium-90 <sup>b</sup>	2 to 30 pCi/liter or kg > 30 pCi/liter or kg	5.0 pCi/liter 10% of known value
Potassium-40	≥ 0.1 g/liter or kg	5% of known value
Gross alpha	≤ 20 pCi/liter > 20 pCi/liter	5.0 pCi/liter 25% of known value
Gross beta	≤ 100 pCi/liter > 100 pCi/liter	5.0 pCi/liter 5% of known value
Tritium	≤ 4,000 pCi/liter > 4,000 pCi/liter	± 1σ = 169.85 x (known) <sup>0.0933</sup> 10% of known value
Radium-226,-228	≥ 0.1 pCi/liter	15% of known value
Plutonium	≥ 0.1 pCi/liter, gram, or sample	10% of known value
Iodine-131, Iodine-129 <sup>b</sup>	≤ 55 pCi/liter > 55 pCi/liter	6 pCi/liter 10% of known value
Uranium-238, Nickel-63 <sup>b</sup> Technetium-99 <sup>b</sup>	≤ 35 pCi/liter > 35 pCi/liter	6 pCi/liter 15% of known value
Iron-55 <sup>b</sup>	50 to 100 pCi/liter > 100 pCi/liter	10 pCi/liter 10% of known value
Other Analyses <sup>b</sup>	---	20% of known value

<sup>a</sup> From EPA publication, "Environmental Radioactivity Laboratory Intercomparison Studies Program, Fiscal Year, 1981-1982, EPA-600/4-81-004.

<sup>b</sup> Laboratory limit.

TABLE A-1. Interlaboratory Comparison Crosscheck program, Environmental Resource Associates (ERA)<sup>a</sup>.

Lab Code	Date	Analysis	Concentration (pCi/L)			Acceptance
			Laboratory Result <sup>b</sup>	ERA Result <sup>c</sup>	Control Limits	
ERW-1384	4/7/2014	Sr-89	40.29 ± 5.76	36.70	27.50 ± 43.60	Pass
ERW-1384	4/7/2014	Sr-90	24.08 ± 2.35	26.50	19.20 ± 30.90	Pass
ERW-1385	4/7/2014	Ba-133	78.23 ± 3.93	87.90	74.00 ± 96.70	Pass
ERW-1385	4/7/2014	Co-60	62.75 ± 3.53	64.20	57.80 ± 73.10	Pass
ERW-1385	4/7/2014	Cs-134	44.97 ± 3.99	44.30	35.50 ± 48.70	Pass
ERW-1385	4/7/2014	Cs-137	88.54 ± 4.93	89.10	80.20 ± 101.00	Pass
ERW-1385	4/7/2014	Zn-65	249.1 ± 10.4	235.0	212.0 - 275.0	Pass
ERW-1388	4/7/2014	Gr. Alpha	56.70 ± 2.47	61.00	31.90 ± 75.80	Pass
ERW-1388	4/7/2014	Gr. Beta	32.10 ± 1.20	33.00	21.40 ± 40.70	Pass
ERW-1391	4/7/2014	I-131	25.52 ± 1.12	25.70	21.30 ± 30.30	Pass
ERW-1394	4/7/2014	Ra-226	12.30 ± 0.61	12.40	9.26 ± 14.30	Pass
ERW-1394	4/7/2014	Ra-228	5.08 ± 1.16	4.26	2.46 ± 5.86	Pass
ERW-1394	4/7/2014	Uranium	10.76 ± 0.74	10.20	7.95 ± 11.80	Pass
ERW-1397	4/7/2014	H-3	8982 ± 279	8770	7610 - 9650	Pass
ERW-5382	10/6/2014	Sr-89	29.40 ± 5.32	31.40	22.80 ± 38.10	Pass
ERW-5382	10/6/2014	Sr-90	19.19 ± 1.85	21.80	15.60 ± 25.70	Pass
ERW-5385	10/6/2014	Ba-133	43.54 ± 4.54	49.10	40.30 ± 54.50	Pass
ERW-5385	10/6/2014	Cs-134	81.95 ± 7.49	89.80	73.70 ± 98.80	Pass
ERW-5385	10/6/2014	Cs-137	95.76 ± 5.50	98.80	88.90 ± 111.00	Pass
ERW-5385	10/6/2014	Co-60	90.25 ± 2.77	92.10	82.90 ± 104.00	Pass
ERW-5385	10/6/2014	Zn-65	327.4 ± 23.3	310.0	279.0 - 362.0	Pass
ERW-5388	10/6/2014	Gr. Alpha	30.88 ± 8.05	37.60	19.40 ± 46.10	Pass
ERW-5388	10/6/2014	G. Beta	20.47 ± 4.75	27.40	17.30 ± 35.30	Pass
ERW-5392	10/6/2014	I-131	19.58 ± 2.35	20.30	16.80 ± 24.40	Pass
ERW-5394	10/6/2014	Ra-226	15.10 ± 1.81	14.70	11.00 ± 16.90	Pass
ERW-5394	10/6/2014	Ra-228	4.42 ± 0.86	4.31	2.50 ± 5.92	Pass
ERW-5394	10/6/2014	Uranium	5.51 ± 0.37	5.80	4.34 ± 6.96	Pass
ERW-5397	10/6/2014	H-3	6876 ± 383	6880	5940 - 7570	Pass

<sup>a</sup> Results obtained by Environmental, Inc., Midwest Laboratory as a participant in the crosscheck program for proficiency testing in drinking water conducted by Environmental Resources Associates (ERA).

<sup>b</sup> Unless otherwise indicated, the laboratory result is given as the mean ± standard deviation for three determinations.

<sup>c</sup> Results are presented as the known values, expected laboratory precision (1 sigma, 1 determination) and control limits as provided by ERA.

TABLE A-2. Thermoluminescent Dosimetry, (TLD, CaSO<sub>4</sub>: Dy Cards).

Lab Code	Date	Description	Known Value	mR		Acceptance
				Lab Result $\pm 2$ sigma	Control Limits	
<u>Environmental, Inc.</u>						
2014-1	5/15/2014	50 cm.	26.83	34.43 $\pm$ 3.76	18.78 - 34.88	Pass
2014-1	5/15/2014	60 cm.	18.63	22.20 $\pm$ 1.16	13.04 - 24.22	Pass
2014-1	5/15/2014	70 cm.	13.69	14.74 $\pm$ 0.80	9.58 - 17.80	Pass
2014-1	5/15/2014	75 cm.	11.93	12.68 $\pm$ 1.05	8.35 - 15.51	Pass
2014-1	5/15/2014	80 cm.	10.48	11.81 $\pm$ 0.91	7.34 - 13.62	Pass
2014-1	5/15/2014	90 cm.	8.28	7.72 $\pm$ 0.71	5.80 - 10.76	Pass
2014-1	5/15/2014	100 cm.	6.71	6.46 $\pm$ 0.71	4.70 - 8.72	Pass
2014-1	5/15/2014	110 cm.	5.54	5.25 $\pm$ 1.03	3.88 - 7.20	Pass
2014-1	5/15/2014	120 cm.	4.66	4.76 $\pm$ 0.48	3.26 - 6.06	Pass
2014-1	5/15/2014	135 cm.	3.68	2.87 $\pm$ 0.46	2.58 - 4.78	Pass
2014-1	5/15/2014	150 cm.	2.98	2.30 $\pm$ 0.15	2.09 - 3.87	Pass
2014-1	5/15/2014	165 cm.	2.46	2.09 $\pm$ 0.28	1.72 - 3.20	Pass
2014-1	5/15/2014	180 cm.	2.07	1.75 $\pm$ 0.21	1.45 - 2.69	Pass
<u>Environmental, Inc.</u>						
2014-2	12/9/2014	30 cm.	77.04	84.03 $\pm$ 8.47	53.90 - 100.20	Pass
2014-2	12/9/2014	30 cm.	77.04	83.74 $\pm$ 12.02	53.90 - 100.20	Pass
2014-2	12/9/2014	60 cm.	19.26	20.39 $\pm$ 2.37	13.50 - 25.00	Pass
2014-2	12/9/2014	60 cm.	19.26	20.33 $\pm$ 1.19	13.50 - 25.00	Pass
2014-2	12/9/2014	120 cm.	4.82	5.15 $\pm$ 0.20	3.40 - 6.30	Pass
2014-2	12/9/2014	120 cm.	4.82	5.20 $\pm$ 0.45	3.40 - 6.30	Pass
2014-2	12/9/2014	150 cm.	3.08	3.84 $\pm$ 0.61	2.20 - 4.00	Pass
2014-2	12/9/2014	150 cm.	3.08	3.17 $\pm$ 0.38	2.20 - 4.00	Pass
2014-2	12/9/2014	150 cm.	3.08	3.31 $\pm$ 0.32	2.00 - 4.00	Pass
2014-2	12/9/2014	180 cm.	2.14	2.27 $\pm$ 0.51	1.50 - 2.80	Pass
2014-2	12/9/2014	180 cm.	2.14	2.23 $\pm$ 0.12	1.50 - 2.80	Pass
2014-2	12/9/2014	180 cm.	2.14	2.74 $\pm$ 0.48	1.50 - 2.80	Pass
2014-2	12/9/2014	180 cm.	2.14	1.97 $\pm$ 0.41	1.50 - 2.80	Pass

TABLE A-3. In-House "Spiked" Samples

Lab Code <sup>b</sup>	Date	Analysis	Concentration (pCi/L) <sup>a</sup>			Acceptance
			Laboratory results 2s, n=1 <sup>c</sup>	Known Activity	Control Limits <sup>d</sup>	
SPW-1011	1/13/2014	Ra-228	35.47 ± 2.55	30.85	21.60 - 40.11	Pass
SPAP-103	1/13/2014	Gr. Beta	43.91 ± 0.34	44.82	26.89 - 62.75	Pass
SPAP-105	1/13/2014	Cs-134	2.46 ± 0.67	2.82	1.69 - 3.95	Pass
SPAP-105	1/13/2014	Cs-137	102.4 ± 2.7	99.9	89.9 - 109.9	Pass
SPW-107	1/13/2014	H-3	62,380 ± 707	62,246	49,797 - 74,695	Pass
SPW-129	1/15/2014	Cs-134	69.90 ± 3.71	78.00	68.00 - 88.00	Pass
SPW-129	1/15/2014	Cs-137	84.36 ± 7.06	75.77	65.77 - 85.77	Pass
SPW-129	1/15/2014	Sr-90	39.48 ± 1.52	39.20	31.36 - 47.04	Pass
SPW-130	1/15/2014	Ni-63	255.8 ± 3.8	204.0	142.8 - 265.2	Pass
SPW-133	1/15/2014	C-14	3153 ± 15	4737	2842 - 6632	Pass
SPMI-135	1/15/2014	Cs-134	76.80 ± 4.04	78.00	68.00 - 88.00	Pass
SPMI-135	1/15/2014	Cs-137	80.44 ± 6.63	75.80	65.80 - 85.80	Pass
W-12014	1/20/2014	Gr. Alpha	19.69 ± 0.41	20.00	10.00 - 30.00	Pass
W-12014	1/20/2014	Gr. Beta	30.35 ± 0.33	30.90	20.90 - 40.90	Pass
SPW-297	1/29/2014	Tc-99	104.2 ± 1.7	107.8	75.5 - 140.2	Pass
SPW-657	2/25/2014	Ra-226	15.84 ± 0.45	16.70	11.69 - 21.71	Pass
SPW-1127	3/26/2014	U-238	43.28 ± 2.56	41.72	29.20 - 54.24	Pass
SPW-1917	3/28/2014	Pu-238	27.37 ± 2.13	23.80	14.28 - 33.32	Pass
SPW-1786	4/25/2014	Tc-99	531.1 ± 8.7	539.15	377.41 - 700.90	Pass
SPW-2168	5/21/2014	Cs-134	70.90 ± 5.81	69.50	59.50 - 79.50	Pass
SPW-2168	5/21/2014	Cs-137	79.72 ± 6.49	75.17	65.17 - 85.17	Pass
SPW-2168	5/21/2014	Sr-89	83.35 ± 5.05	72.85	58.28 - 87.42	Pass
SPW-2168	5/21/2014	Sr-90	33.37 ± 1.52	38.87	31.10 - 46.64	Pass
SPMI-2170	5/21/2014	Cs-134	64.15 ± 4.93	69.50	59.50 - 79.50	Pass
SPMI-2170	5/21/2014	Cs-137	76.21 ± 6.91	75.17	65.17 - 85.17	Pass
SPMI-2170	5/21/2014	Sr-89	65.82 ± 4.89	72.85	58.28 - 87.42	Pass
SPMI-2170	5/21/2014	Sr-90	40.90 ± 1.59	38.87	31.10 - 46.64	Pass
SPW-2792	6/18/2014	U-238	44.80 ± 1.54	41.70	29.19 - 54.21	Pass
SPW-2796	6/18/2014	C-14	3495 ± 9	4,737	2,842 - 6632	Pass
WW-2836	6/30/2014	Co-60	131.8 ± 6.9	140.90	126.81 - 154.99	Pass
WW-2836	6/30/2014	Cs-137	143.8 ± 9.1	145.60	131.04 - 160.16	Pass
WW-2836	6/30/2014	H-3	6220 ± 238	6,361	5,089 - 7633	Pass

TABLE A-3. In-House "Spiked" Samples

Lab Code <sup>b</sup>	Date	Analysis	Concentration (pCi/L) <sup>a</sup>			Acceptance
			Laboratory results 2s, n=1 <sup>c</sup>	Known Activity	Control Limits <sup>d</sup>	
SPW-3486	7/17/2014	Fe-55	2211 ± 72	2319	1855 - 2783	Pass
SPW-080714	8/7/2014	Gr. Alpha	18.42 ± 0.40	20.10	10.05 - 30.15	Pass
SPW-080714	8/7/2014	Gr. Beta	31.70 ± 0.40	32.40	22.40 - 42.40	Pass
SPW-081214	8/12/2014	Pu-238	22.59 ± 2.15	22.70	18.16 - 27.24	Pass
SPW-4093	8/13/2014	I-131(G)	59.95 ± 6.17	59.62	49.62 - 69.62	Pass
SPW-4093	8/13/2014	Sr-90	39.46 ± 1.55	38.65	28.65 - 48.65	Pass
SPW-4093	8/13/2014	Sr-89	105.5 ± 4.9	115.0	92.0 - 149.5	Pass
SPMI-4095	8/13/2014	I-131(G)	59.92 ± 6.17	59.62	49.62 - 69.62	Pass
SPMI-4095	8/13/2014	I-131	60.05 ± 0.72	59.62	47.70 - 71.54	Pass
SPW-4104	8/13/2014	Ni-63	200.1 ± 3.4	203.2	142.2 - 264.1	Pass
SPW-4106	8/13/2014	H-3	59,597 ± 695	60,261	48209 - 72313	Pass
SPW-4108	8/13/2014	Cs-134	2.45 ± 0.81	2.32	0.00 - 12.32	Pass
SPW-4108	8/13/2014	Cs-137	90.20 ± 3.74	98.56	88.56 - 108.56	Pass
SPAP-4110	8/13/2014	Gr. Beta	43.65 ± 0.11	44.19	34.19 - 54.19	Pass
SPF-4112	8/13/2014	I-131	2.64 ± 0.38	2.86	0.00 - 12.86	Pass
SPF-4112	8/13/2014	Cs-134	0.91 ± 0.03	1.03	0.00 - 11.03	Pass
SPF-4112	8/13/2014	Cs-137	2.61 ± 0.06	2.39	0.00 - 12.39	Pass
SPW-081414	8/14/2014	H-3	14,663 ± 788	17,700	14160 - 21240	Pass
W081614	8/16/2014	Ra-226	14.30 ± 0.37	16.70	11.69 - 21.71	Pass
W082614	8/26/2014	Ra-228	27.18 ± 2.13	30.49	20.49 - 40.49	Pass
SPW-090414	9/4/2014	Gr. Alpha	17.85 ± 0.39	20.10	10.05 - 30.15	Pass
SPW-090414	9/4/2014	Gr. Beta	30.03 ± 0.33	30.90	20.90 - 40.90	Pass
SPW-5124	9/29/2014	Ra-228	32.93 ± 2.38	31.94	21.94 - 41.94	Pass
W100714	10/7/2014	Gr. Alpha	18.56 ± 0.40	20.10	10.05 - 30.15	Pass
W100714	10/7/2014	Gr. Beta	27.71 ± 0.32	30.90	20.90 - 40.90	Pass
W111014	11/10/2014	Gr. Alpha	17.84 ± 0.38	20.10	10.05 - 30.15	Pass
W111014	11/10/2014	Gr. Beta	30.12 ± 0.33	30.90	20.90 - 40.90	Pass
W112514	11/25/2014	Ra-226	16.63 ± 0.41	16.70	11.69 - 21.71	Pass
W120814	12/8/2014	Gr. Alpha	19.29 ± 0.41	20.10	10.05 - 30.15	Pass
W120814	12/8/2014	Gr. Beta	27.93 ± 0.32	30.90	20.90 - 40.90	Pass
SPW-7149	12/26/2014	Ni-63	217.53 ± 3.25	203.10	142.17 - 264.03	Pass

<sup>a</sup> Liquid sample results are reported in pCi/Liter, air filters (pCi/m<sup>3</sup>), charcoal (pCi/charcoal canister), and solid samples (pCi/kg).

<sup>b</sup> Laboratory codes : W (Water), MI (milk), AP (air filter), SO (soil), VE (vegetation), CH (charcoal canister), F (fish), U (urine).

<sup>c</sup> Results are based on single determinations.

<sup>d</sup> Control limits are established from the precision values listed in Attachment A of this report, adjusted to ± 2s.

NOTE: For fish, Jello is used for the spike matrix. For vegetation, cabbage is used for the spike matrix.

TABLE A-4. In-House "Blank" Samples

Lab Code	Sample Type	Date	Analysis <sup>b</sup>	Concentration (pCi/L) <sup>a</sup>		Acceptance Criteria (4.66 $\sigma$ )
				Laboratory results (4.66 $\sigma$ )		
				LLD	Activity <sup>c</sup>	
SPW-1001	Water	1/13/2014	Ra-228	0.74	0.39 $\pm$ 0.39	2
SPAP-102	Air Particulate	1/13/2014	Gr. Beta	0.003	0.015 $\pm$ 0.003	0.01
SPAP-104	Air Particulate	1/13/2014	Cs-134	0.006	0.005 $\pm$ 0.005	0.05
SPAP-104	Air Particulate	1/13/2014	Cs-137	0.004	-0.002 $\pm$ 0.005	0.05
SPW-106	Water	1/13/2014	H-3	151.0	115.0 $\pm$ 97.0	200
SPW-128	Water	1/15/2014	Cs-134	2.85	0.59 $\pm$ 1.46	10
SPW-128	Water	1/15/2014	Cs-137	2.52	0.68 $\pm$ 1.64	10
SPW-128	Water	1/15/2014	Sr-90	0.61	0.74 $\pm$ 0.36	1
SPW-130	Water	1/15/2014	Ni-63	10.85	1.57 $\pm$ 6.60	20
SPW-133	Water	1/15/2014	C-14	13.51	3.10 $\pm$ 8.27	200
SPMI-134	Milk	1/15/2014	Cs-134	4.43	0.14 $\pm$ 2.46	10
SPMI-134	Milk	1/15/2014	Cs-137	1.92	-2.07 $\pm$ 2.48	10
W-12014	Water	1/20/2014	Gr. Alpha	0.48	-0.31 $\pm$ 0.31	2
W-12014	Water	1/20/2014	Gr. Beta	0.78	-0.24 $\pm$ 0.54	4
SPW-297	Water	1/29/2014	Tc-99	5.63	-4.42 $\pm$ 3.34	10
SPW-656	Water	2/25/2014	Ra-226	0.03	0.01 $\pm$ 0.02	1
SPW-1126	Water	3/26/2014	U-238	0.13	0.08 $\pm$ 0.12	1
SPW-1127	Water	3/26/2014	U-233/234	0.13	0.11 $\pm$ 0.13	1
SPW-1127	Water	3/26/2014	U-238	0.00	0.08 $\pm$ 0.12	1
SPW-1917	Water	3/28/2014	Pu-238	0.02	0.01 $\pm$ 0.01	1
SPW-1785	Water	4/25/2014	Tc-99	5.61	-4.33 $\pm$ 3.33	10
SPW-1831	Water	4/30/2014	I-131	0.21	0.07 $\pm$ 0.12	0.5
SPW-2167	Water	5/21/2014	Cs-134	2.29	-0.79 $\pm$ 1.35	10
SPW-2167	Water	5/21/2014	Cs-137	2.46	0.36 $\pm$ 1.48	10
SPW-2167	Water	5/21/2014	I-131(G)	2.77	0.25 $\pm$ 1.53	20
SPW-2167	Water	5/21/2014	Sr-89	0.81	0.01 $\pm$ 0.62	5
SPW-2167	Water	5/21/2014	Sr-90	0.52	0.03 $\pm$ 0.24	1
SPMI-2169	Milk	5/21/2014	Cs-134	4.45	-0.55 $\pm$ 2.39	10
SPMI-2169	Milk	5/21/2014	Cs-137	3.91	-0.52 $\pm$ 2.60	10
SPMI-2169	Milk	5/21/2014	I-131(G)	4.31	2.57 $\pm$ 2.21	20
SPMI-2169	Milk	5/21/2014	Sr-89	0.98	-0.02 $\pm$ 0.83	5
SPMI-2169	Milk	5/21/2014	Sr-90	0.61	0.35 $\pm$ 0.32	1
SPW-2793	Water	6/18/2014	U-238	0.08	0.02 $\pm$ 0.06	1



TABLE A-4. In-House "Blank" Samples

Lab Code	Sample Type	Date	Analysis <sup>b</sup>	Concentration (pCi/L) <sup>a</sup>		
				Laboratory results (4.66σ)		Acceptance Criteria (4.66 σ)
				LLD	Activity <sup>c</sup>	
SPW-3485	Water	7/17/2014	Fe-55	597.6	10.3 ± 363.3	1000
SPW-4092	Water	8/13/2014	I-131(G)	3.59	0.91 ± 1.95	20
SPW-4092	Water	8/13/2014	Cs-134	3.71	-0.31 ± 1.77	10
SPW-4092	Water	8/13/2014	Cs-137	2.71	-2.20 ± 1.98	10
SPW-4092	Water	8/13/2014	Sr-89	0.89	0.11 ± 0.63	5
SPW-4092	Water	8/13/2014	Sr-90	0.52	-0.05 ± 0.23	1
SPMI-4094	Milk	8/13/2014	I-131	0.35	0.03 ± 0.20	0.5
SPMI-4094	Milk	8/13/2014	I-131(G)	4.50	-0.41 ± 2.44	20
SPMI-4094	Milk	8/13/2014	Cs-134	4.30	-0.84 ± 2.02	10
SPMI-4094	Milk	8/13/2014	Cs-137	3.45	0.96 ± 2.51	10
SPMI-4094	Milk	8/13/2014	Sr-89	0.80	-0.19 ± 0.79	5
SPMI-4094	Milk	8/13/2014	Sr-90	0.47	0.71 ± 0.30	1
SPW-4103	Water	8/13/2014	Ni-63	0.12	0.02 ± 0.07	20
SPW-4105	Water	8/13/2014	H-3	138.1	104.1 ± 78.1	200
SPW-4107	Water	8/13/2014	I-131(G)	3.21	-3.68 ± 1.33	20
SPW-4107	Water	8/13/2014	Cs-134	2.72	-0.62 ± 1.49	10
SPW-4107	Water	8/13/2014	Cs-137	2.56	0.75 ± 1.62	10
SPAP-4109	Air Particulate	8/13/2014	Gr. Beta	0.004	-0.003 ± 0.00	0.01
SPF-4111	Fish	8/13/2014	Cs-134	0.01	0.00 ± 0.01	100
SPF-4111	Fish	8/13/2014	Cs-137	0.01	-0.01 ± 0.01	100
SPF-4111	Fish	8/13/2014	Co-60	0.01	0.00 ± 0.01	100
W-081614	Water	8/16/2014	Ra-226	0.04	0.05 ± 0.03	1
W-082614	Water	8/16/2014	Ra-228	0.62	0.29 ± 0.40	2
W-092314	Water	9/23/2014	Ra-226	0.02	0.04 ± 0.02	1
W-5123	Water	9/29/2014	Ra-228	0.70	0.43 ± 0.38	2
W-100714	Water	10/7/2014	Gr. Alpha	0.39	0.04 ± 0.28	2
W-100714	Water	10/7/2014	Gr. Beta	0.76	-0.06 ± 0.53	4
W-111014	Water	11/10/2014	Gr. Alpha	0.39	0.01 ± 0.28	2
W-111014	Water	11/10/2014	Gr. Beta	0.75	-0.25 ± 0.52	4
W-112514	Water	11/25/2014	Ra-226	0.05	0.02 ± 0.03	2
W-120814	Water	12/8/2014	Gr. Alpha	0.42	0.04 ± 0.30	2
W-120814	Water	12/8/2014	Gr. Beta	0.74	-0.42 ± 0.51	4
SPW-7148	Water	12/26/2014	Ni-63	10.80	-1.80 ± 6.50	20

<sup>a</sup> Liquid sample results are reported in pCi/Liter, air filters (pCi/m<sup>3</sup>), charcoal (pCi/charcoal canister), and solid samples (pCi/kg).

<sup>b</sup> I-131(G); iodine-131 as analyzed by gamma spectroscopy.

<sup>c</sup> Activity reported is a net activity result.

TABLE A-5. In-House "Duplicate" Samples

Lab Code	Date	Analysis	Concentration (pCi/L) <sup>a</sup>			Acceptance
			First Result	Second Result	Averaged Result	
AP-7829, 7830	1/2/2014	Be-7	0.08 ± 0.02	0.06 ± 0.01	0.07 ± 0.01	Pass
AP-7913, 7914	1/2/2014	Be-7	0.07 ± 0.01	0.06 ± 0.01	0.06 ± 0.01	Pass
AP-7871, 7872	1/3/2014	Be-7	0.05 ± 0.02	0.06 ± 0.01	0.06 ± 0.01	Pass
S-43, 44	1/9/2014	K-40	19.28 ± 0.57	19.24 ± 0.57	19.26 ± 0.40	Pass
SG-64, 65	1/9/2014	Gr. Alpha	686.08 ± 69.97	642.46 ± 65.59	664.27 ± 47.95	Pass
SG-64, 65	1/9/2014	Ra-226	97.30 ± 9.78	92.20 ± 9.27	94.75 ± 6.74	Pass
SG-64, 65	1/9/2014	Ra-228	91.90 ± 9.30	97.10 ± 9.87	94.50 ± 6.78	Pass
S-136, 137	1/13/2014	Be-7	14.90 ± 0.39	14.88 ± 0.38	14.89 ± 0.27	Pass
S-136, 137	1/13/2014	K-40	3.29 ± 0.36	3.93 ± 0.36	3.61 ± 0.25	Pass
WW-220, 221	1/13/2014	H-3	231.85 ± 80.45	273.46 ± 82.47	252.66 ± 57.60	Pass
WW-262, 263	1/21/2014	H-3	294.80 ± 89.80	265.00 ± 88.47	279.90 ± 63.03	Pass
WW-346, 347	1/24/2014	H-3	934.97 ± 118.47	965.59 ± 119.52	950.28 ± 84.14	Pass
SWU-367, 368	1/29/2014	Gr. Beta	0.74 ± 0.38	1.31 ± 0.42	1.02 ± 0.28	Pass
F-409, 410	2/2/2014	Cs-137	0.05 ± 0.02	0.05 ± 0.02	0.05 ± 0.01	Pass
F-409, 410	2/2/2014	Gr. Beta	3.60 ± 0.07	3.72 ± 0.07	3.66 ± 0.05	Pass
AP-7829, 7830	1/2/2014	Be-7	0.08 ± 0.02	0.06 ± 0.01	0.07 ± 0.01	Pass
AP-7913, 7914	1/2/2014	Be-7	0.07 ± 0.01	0.06 ± 0.01	0.06 ± 0.01	Pass
AP-7871, 7872	1/3/2014	Be-7	0.05 ± 0.02	0.06 ± 0.01	0.06 ± 0.01	Pass
S-43, 44	1/9/2014	K-40	19.28 ± 0.57	19.24 ± 0.57	19.26 ± 0.40	Pass
SG-64, 65	1/9/2014	Gr. Alpha	686.08 ± 69.97	642.46 ± 65.59	664.27 ± 47.95	Pass
SG-64, 65	1/9/2014	Ra-226	97.30 ± 9.78	92.20 ± 9.27	94.75 ± 6.74	Pass
SG-64, 65	1/9/2014	Ra-228	91.90 ± 9.30	97.10 ± 9.87	94.50 ± 6.78	Pass
S-136, 137	1/13/2014	Be-7	14.90 ± 0.39	14.88 ± 0.38	14.89 ± 0.27	Pass
S-136, 137	1/13/2014	K-40	3.29 ± 0.36	3.93 ± 0.36	3.61 ± 0.25	Pass
WW-220, 221	1/13/2014	H-3	231.85 ± 80.45	273.46 ± 82.47	252.66 ± 57.60	Pass
WW-262, 263	1/21/2014	H-3	294.80 ± 89.80	265.00 ± 88.47	279.90 ± 63.03	Pass
WW-346, 347	1/24/2014	H-3	934.97 ± 118.47	965.59 ± 119.52	950.28 ± 84.14	Pass
SWU-367, 368	1/29/2014	Gr. Beta	0.74 ± 0.38	1.31 ± 0.42	1.02 ± 0.28	Pass
F-409, 410	2/2/2014	Cs-137	0.05 ± 0.02	0.05 ± 0.02	0.05 ± 0.01	Pass
F-409, 410	2/2/2014	Gr. Beta	3.60 ± 0.07	3.72 ± 0.07	3.66 ± 0.05	Pass
WW-491, 492	2/6/2014	H-3	474.00 ± 101.10	583.10 ± 105.30	528.55 ± 72.99	Pass
WW-575, 576	2/13/2014	H-3	196.69 ± 82.94	154.68 ± 80.89	175.69 ± 57.93	Pass
W-617, 618	2/14/2014	H-3	526.29 ± 97.65	579.51 ± 99.77	552.90 ± 69.80	Pass
SWU-743, 744	2/25/2014	Gr. Beta	1.61 ± 0.65	1.73 ± 0.71	1.67 ± 0.48	Pass
S-700, 701	2/26/2014	K-40	21.32 ± 0.64	21.15 ± 0.59	21.24 ± 0.44	Pass
S-806, 807	3/4/2014	K-40	24.79 ± 0.57	24.17 ± 0.59	24.48 ± 0.41	Pass
SG-928, 929	3/11/2014	Ac-228	6.78 ± 0.34	6.94 ± 0.35	6.86 ± 0.24	Pass
SG-928, 929	3/11/2014	Bi-214	5.32 ± 0.20	5.34 ± 0.22	5.33 ± 0.15	Pass
SG-928, 929	3/11/2014	K-40	4.79 ± 0.80	6.24 ± 1.01	5.52 ± 0.64	Pass
SG-928, 929	3/11/2014	Pb-212	2.70 ± 0.09	2.75 ± 0.09	2.73 ± 0.06	Pass
SG-928, 929	3/11/2014	Pb-214	5.39 ± 0.17	5.53 ± 0.17	5.46 ± 0.12	Pass
SG-928, 929	3/11/2014	Th-228	6.10 ± 2.07	4.76 ± 1.93	5.43 ± 1.42	Pass
SG-928, 929	3/11/2014	Tl-208	0.92 ± 0.06	0.91 ± 0.06	0.92 ± 0.04	Pass

TABLE A-5. In-House "Duplicate" Samples

Lab Code	Date	Analysis	Concentration (pCi/L) <sup>a</sup>			Acceptance
			First Result	Second Result	Averaged Result	
S-2119, 2120	3/12/2014	Ac-228	0.76 ± 0.20	0.73 ± 0.21	0.75 ± 0.15	Pass
S-2119, 2120	3/12/2014	Cs-137	0.13 ± 0.05	0.11 ± 0.05	0.12 ± 0.04	Pass
S-2119, 2120	3/12/2014	K-40	17.48 ± 1.48	18.39 ± 1.53	17.94 ± 1.06	Pass
S-2119, 2120	3/12/2014	Pb-214	0.73 ± 0.18	0.63 ± 0.12	0.68 ± 0.11	Pass
F-1594, 1595	3/16/2014	Cs-137	0.02 ± 0.01	0.03 ± 0.02	0.03 ± 0.01	Pass
SO-1115, 1116	3/18/2014	Cs-137	0.06 ± 0.01	0.06 ± 0.00	0.06 ± 0.00	Pass
SO-1115, 1116	3/18/2014	Gr. Beta	23.30 ± 2.10	24.40 ± 2.20	23.85 ± 1.52	Pass
SO-1115, 1116	3/18/2014	K-40	12.63 ± 0.18	12.84 ± 0.15	12.74 ± 0.12	Pass
SO-1115, 1116	3/18/2014	U-233/4	0.11 ± 0.02	0.12 ± 0.02	0.12 ± 0.01	Pass
SO-1115, 1116	3/18/2014	U-238	0.13 ± 0.02	0.14 ± 0.02	0.14 ± 0.01	Pass
S-1033, 1034	3/19/2014	Ac-228	0.99 ± 0.20	1.13 ± 0.26	1.06 ± 0.16	Pass
S-1033, 1034	3/19/2014	Bi-214	1.02 ± 0.18	0.98 ± 0.16	1.00 ± 0.12	Pass
S-1033, 1034	3/19/2014	Cs-137	0.15 ± 0.04	0.14 ± 0.04	0.15 ± 0.03	Pass
S-1033, 1034	3/19/2014	K-40	15.39 ± 1.19	15.13 ± 1.19	15.26 ± 0.84	Pass
S-1033, 1034	3/19/2014	Pb-214	1.09 ± 0.13	0.88 ± 0.17	0.99 ± 0.11	Pass
S-1033, 1034	3/19/2014	Tl-208	0.36 ± 0.05	0.31 ± 0.05	0.34 ± 0.04	Pass
W-1094, 1095	3/23/2014	Ra-226	0.30 ± 0.20	0.70 ± 0.20	0.50 ± 0.14	Pass
W-1094, 1095	3/23/2014	Ra-228	1.10 ± 0.79	1.13 ± 0.86	1.12 ± 0.58	Pass
AP-1197, 1198	3/27/2014	Be-7	0.17 ± 0.08	0.14 ± 0.08	0.15 ± 0.05	Pass
AP-1698, 1699	3/31/2014	Be-7	0.06 ± 0.02	0.07 ± 0.02	0.07 ± 0.01	Pass
E-1218, 1219	4/1/2014	Gr. Beta	1.57 ± 0.04	1.57 ± 0.04	1.57 ± 0.03	Pass
E-1218, 1219	4/1/2014	K-40	1.26 ± 0.14	1.31 ± 0.18	1.29 ± 0.11	Pass
SWU-1260, 1261	4/1/2014	Gr. Beta	2.81 ± 0.51	2.94 ± 0.50	2.88 ± 0.36	Pass
AP-1615, 1616	4/1/2014	Be-7	0.07 ± 0.01	0.07 ± 0.02	0.07 ± 0.01	Pass
AP-1657, 1658	4/2/2014	Be-7	0.07 ± 0.01	0.08 ± 0.01	0.07 ± 0.01	Pass
AP-1804, 1805	4/3/2014	Be-7	0.05 ± 0.02	0.06 ± 0.01	0.06 ± 0.01	Pass
P-1489, 1490	4/7/2014	H-3	582.31 ± 101.85	505.07 ± 98.72	543.69 ± 70.92	Pass
BS-1531, 1532	4/16/2014	K-40	0.51 ± 0.19	0.58 ± 0.23	0.54 ± 0.15	Pass
S-1909, 1910	4/22/2014	K-40	14.71 ± 0.54	14.78 ± 0.53	14.75 ± 0.38	Pass
SWU-1867, 1868	4/29/2014	Gr. Beta	2.28 ± 0.40	1.67 ± 0.35	1.98 ± 0.27	Pass
AP-1930, 1931	5/1/2014	Be-7	0.16 ± 0.09	0.19 ± 0.11	0.17 ± 0.07	Pass
SL-1888, 1889	5/1/2014	Be-7	0.80 ± 0.04	0.76 ± 0.08	0.78 ± 0.05	Pass
SL-1888, 1889	5/1/2014	Cs-137	0.01 ± 0.00	0.01 ± 0.00	0.01 ± 0.00	Pass
SL-1888, 1889	5/1/2014	Gr. Beta	11.57 ± 0.72	12.67 ± 0.78	12.12 ± 0.53	Pass
SL-1888, 1889	5/1/2014	K-40	1.04 ± 0.05	1.00 ± 0.09	1.02 ± 0.05	Pass
SO-1972, 1973	5/1/2014	Cs-137	0.12 ± 0.03	0.10 ± 0.02	0.11 ± 0.02	Pass
SO-1972, 1973	5/1/2014	Gr. Alpha	7.51 ± 3.24	9.09 ± 3.63	8.30 ± 2.43	Pass
SO-1972, 1973	5/1/2014	Gr. Beta	29.89 ± 3.25	31.42 ± 3.04	30.66 ± 2.23	Pass
SO-1972, 1973	5/1/2014	K-40	20.45 ± 0.85	20.88 ± 0.76	20.66 ± 0.57	Pass
W-617, 618	5/8/2014	H-3	175.13 ± 83.82	177.17 ± 83.92	176.15 ± 59.31	Pass
AP-2077, 2078	5/8/2014	Be-7	0.23 ± 0.11	0.18 ± 0.11	0.20 ± 0.08	Pass

TABLE A-5. In-House "Duplicate" Samples

Lab Code	Date	Analysis	Concentration (pCi/L) <sup>a</sup>			Acceptance
			First Result	Second Result	Averaged Result	
S-2205, 2206	5/15/2014	Be-7	0.50 ± 0.19	0.70 ± 0.18	0.60 ± 0.13	Pass
S-2205, 2206	5/15/2014	K-40	33.60 ± 0.79	33.52 ± 0.70	33.56 ± 0.53	Pass
VE-2184, 2185	5/19/2014	Be-7	0.62 ± 0.18	0.53 ± 0.17	0.58 ± 0.12	Pass
VE-2184, 2185	5/19/2014	K-40	5.30 ± 0.44	5.14 ± 0.44	5.22 ± 0.31	Pass
DW-50102, 50103	5/20/2014	Ra-226	7.07 ± 0.76	8.31 ± 0.90	7.69 ± 0.59	Pass
DW-50102, 50103	5/20/2014	Ra-228	5.44 ± 0.85	6.02 ± 0.67	5.73 ± 0.54	Pass
SW-2226, 2227	5/21/2014	H-3	14318.00 ± 347.00	14350.00 ± 347.00	14334.00 ± 245.37	Pass
DW-50087, 50088	5/21/2014	Gr. Alpha	1.76 ± 1.09	2.67 ± 1.01	2.22 ± 0.74	Pass
DW-50090, 50091	5/21/2014	Ra-226	0.61 ± 0.09	0.47 ± 0.09	0.54 ± 0.06	Pass
DW-50090, 50091	5/21/2014	Ra-228	0.97 ± 0.41	1.26 ± 0.52	1.12 ± 0.33	Pass
DW-50098, 50099	5/21/2014	Gr. Alpha	13.04 ± 1.36	10.76 ± 1.26	11.90 ± 0.93	Pass
AP-2289, 2290	5/22/2014	Be-7	0.14 ± 0.08	0.24 ± 0.10	0.19 ± 0.06	Pass
PM-3174, 3175	5/28/2014	K-40	30.68 ± 1.30	32.64 ± 1.24	31.66 ± 0.90	Pass
G-2415, 2416	6/2/2014	Be-7	0.73 ± 0.16	0.62 ± 0.28	0.68 ± 0.16	Pass
G-2415, 2416	6/2/2014	Gr. Beta	5.89 ± 0.09	5.90 ± 0.09	5.89 ± 0.06	Pass
G-2415, 2416	6/2/2014	K-40	5.30 ± 0.49	5.19 ± 0.65	5.25 ± 0.41	Pass
WW-2541, 2542	6/4/2014	H-3	5107.00 ± 223.00	5029.00 ± 222.00	5068.00 ± 157.33	Pass
SW-2817, 2818	6/16/2014	H-3	13303.00 ± 336.00	13130.00 ± 334.00	13216.50 ± 236.88	Pass
SS-2943, 2944	6/24/2014	K-40	11.49 ± 0.79	11.81 ± 0.70	11.65 ± 0.53	Pass
S-3048, 3049	6/27/2014	K-40	42.51 ± 1.31	40.04 ± 1.39	41.28 ± 0.95	Pass
SWT-3216, 3217	7/1/2014	Gr. Beta	2.27 ± 0.94	2.53 ± 1.05	2.40 ± 0.70	Pass
AP-3699,3700	7/3/2014	Be-7	0.06 ± 0.01	0.07 ± 0.02	0.07 ± 0.01	Pass
S-3300, 3301	7/8/2014	K-40	4.85 ± 0.97	5.91 ± 1.17	5.38 ± 0.76	Pass
S-3300, 3301	7/8/2014	Ac-228	10.23 ± 0.43	10.18 ± 0.32	10.21 ± 0.27	Pass
S-3300, 3301	7/8/2014	Ra-226	70.14 ± 2.37	72.01 ± 2.38	71.08 ± 1.68	Pass
VE-3237,3238	7/8/2014	K-40	2.54 ± 0.27	2.63 ± 0.24	2.59 ± 0.18	Pass
CF-3384,3385	7/14/2014	K-40	11.10 ± 0.58	10.69 ± 0.60	10.90 ± 0.42	Pass
S-3447,3448	7/16/2014	K-40	19.63 ± 0.64	21.03 ± 0.96	20.33 ± 0.58	Pass
WW-3573,3574	7/18/2014	H-3	381.58 ± 85.76	401.30 ± 86.67	391.44 ± 60.96	Pass
VE-3594,3595	7/22/2014	K-40	3.04 ± 0.19	3.21 ± 0.15	3.13 ± 0.12	Pass
WW-3762,3763	7/25/2014	H-3	315.47 ± 87.02	327.30 ± 87.56	321.39 ± 61.72	Pass
SWT-3867, 3868	7/29/2014	Gr. Beta	1.10 ± 0.53	1.51 ± 0.58	1.31 ± 0.39	Pass
S-3804, 3805	7/30/2014	Ac-228	0.67 ± 0.11	0.61 ± 0.10	0.64 ± 0.07	Pass
S-3804, 3805	7/30/2014	Pb-214	0.56 ± 0.05	0.51 ± 0.04	0.54 ± 0.03	Pass
LW-3931, 3932	7/31/2014	Gr. Beta	1.04 ± 0.40	0.95 ± 0.41	1.00 ± 0.29	Pass

TABLE A-5. In-House "Duplicate" Samples

Lab Code	Date	Analysis	Concentration (pCi/L) <sup>a</sup>			Acceptance
			First Result	Second Result	Averaged Result	
G-3952,3953	8/4/2014	K-40	5.42 ± 0.42	5.35 ± 0.34	5.38 ± 0.27	Pass
G-3952,3953	8/4/2014	Be-7	1.29 ± 0.19	1.24 ± 0.16	1.27 ± 0.13	Pass
G-3952,3953	8/4/2014	Gr. Beta	8.53 ± 0.20	8.63 ± 0.20	8.58 ± 0.14	Pass
G-3952,3953	8/4/2014	H-3	140.16 ± 93.50	127.25 ± 92.99	133.70 ± 65.94	Pass
WW-4036, 4037	8/5/2014	H-3	190.60 ± 82.60	164.70 ± 81.30	177.65 ± 57.95	Pass
VE-4204,4205	8/11/2014	K-40	6.28 ± 0.38	6.60 ± 0.37	6.44 ± 0.27	Pass
WW-4394,4395	8/13/2014	H-3	1540.26 ± 136.52	1499.15 ± 135.43	1519.71 ± 96.15	Pass
VE-4183,4184	8/14/2014	K-40	5.70 ± 0.41	5.73 ± 0.34	5.72 ± 0.27	Pass
AV-4455, 4456	8/22/2014	Be-7	286.67 ± 102.30	251.99 ± 98.94	269.33 ± 71.16	Pass
AV-4455, 4456	8/22/2014	K-40	2547.90 ± 255.70	2201.40 ± 203.90	2374.65 ± 163.52	Pass
WW-4500, 4501	8/26/2014	H-3	347.00 ± 100.00	321.00 ± 98.00	334.00 ± 70.01	Pass
AP-090214A/B	9/2/2014	Gr. Beta	0.03 ± 0.04	0.03 ± 0.04	0.03 ± 0.00	Pass
SG-5089, 5090	9/19/2014	Ac-228	8.26 ± 0.63	9.48 ± 0.68	8.87 ± 0.46	Pass
SG-5089, 5090	9/19/2014	Bi-214	4.71 ± 0.29	4.41 ± 0.31	4.56 ± 0.21	Pass
SG-5194,5	10/1/2014	Gr. Alpha	276.20 ± 9.51	258.60 ± 9.26	267.40 ± 6.64	Pass
SG-5194,5	10/1/2014	Pb-214	43.56 ± 0.73	43.94 ± 0.78	43.75 ± 0.53	Pass
SG-5194,5	10/1/2014	Ac-228	59.90 ± 1.37	62.80 ± 1.73	61.35 ± 1.10	Pass
S-5632,3	10/8/2014	K-40	19.28 ± 0.88	17.94 ± 0.89	18.61 ± 0.63	Pass
S-5632,3	10/8/2014	Cs-137	0.15 ± 0.03	0.13 ± 0.03	0.14 ± 0.02	Pass
S-5632,3	10/8/2014	Tl-208	0.32 ± 0.03	0.34 ± 0.03	0.33 ± 0.02	Pass
S-5632,3	10/8/2014	Pb-212	0.92 ± 0.05	0.92 ± 0.05	0.92 ± 0.03	Pass
S-5632,3	10/8/2014	Pb-214	1.25 ± 0.08	1.09 ± 0.09	1.17 ± 0.06	Pass
S-5632,3	10/8/2014	Bi-212	1.25 ± 0.29	1.34 ± 0.47	1.29 ± 0.27	Pass
S-5632,3	10/8/2014	Ac-228	1.08 ± 0.14	1.10 ± 0.14	1.09 ± 0.10	Pass
DW-50243,4	10/13/2014	Gr. Alpha	2.99 ± 0.94	4.98 ± 1.17	3.99 ± 0.75	Pass
AP-101414A/B	10/14/2014	Gr. Beta	0.02 ± 0.00	0.02 ± 0.00	0.02 ± 0.00	Pass
SG-5590,1	10/15/2014	Pb-214	80.30 ± 8.08	73.40 ± 7.51	76.85 ± 5.52	Pass
SG-5590,1	10/15/2014	Ac-228	64.50 ± 1.87	62.80 ± 1.15	63.65 ± 1.10	Pass
DW-50251,2	10/16/2014	Ra-226	0.55 ± 0.13	0.32 ± 0.10	0.44 ± 0.08	Pass
U-5842,3	10/20/2014	H-3	7376 ± 949	7342 ± 947	7359 ± 670	Pass
CF-6074,5	10/21/2014	H-3	7509 ± 283	7969 ± 291	7739 ± 203	Pass
CF-6074,5	10/21/2014	K-40	3.09 ± 0.31	3.30 ± 0.38	3.20 ± 0.25	Pass

TABLE A-5. In-House "Duplicate" Samples

Lab Code	Date	Analysis	Concentration (pCi/L) <sup>a</sup>			Acceptance
			First Result	Second Result	Averaged Result	
VE-6269,70	11/3/2014	K-40	6.25 ± 0.54	6.56 ± 0.49	6.41 ± 0.36	Pass
VE-6269,70	11/3/2014	Be-7	0.81 ± 0.28	0.74 ± 0.18	0.77 ± 0.17	Pass
SO-6500,1	11/5/2014	Sr-90	0.07 ± 0.03	0.07 ± 0.02	0.07 ± 0.02	Pass
SO-6500,1	11/5/2014	Gr. Alpha	11.77 ± 1.73	12.18 ± 1.62	11.98 ± 1.19	Pass
SO-6500,1	11/5/2014	Gr. Beta	26.69 ± 1.62	24.19 ± 1.13	25.44 ± 0.99	Pass
SO-6500,1	11/5/2014	U-233/4	0.14 ± 0.04	0.14 ± 0.05	0.14 ± 0.03	Pass
SO-6500,1	11/5/2014	U-238	0.18 ± 0.05	0.13 ± 0.04	0.15 ± 0.03	Pass
SO-6500,1	11/5/2014	Th-228	0.47 ± 0.11	0.34 ± 0.06	0.41 ± 0.06	Pass
SO-6500,1	11/5/2014	Th-230	0.38 ± 0.07	0.29 ± 0.05	0.34 ± 0.04	Pass
SO-6500,1	11/5/2014	Th-232	0.41 ± 0.08	0.41 ± 0.06	0.41 ± 0.05	Pass
SO-6500,1	11/5/2014	Bi-214	0.75 ± 0.02	0.78 ± 0.02	0.77 ± 0.01	Pass
SO-6500,1	11/5/2014	Pb-214	0.78 ± 0.08	0.86 ± 0.09	0.82 ± 0.06	Pass
SO-6500,1	11/5/2014	Ac-228	1.02 ± 0.11	1.13 ± 0.13	1.08 ± 0.09	Pass
SO-6500,1	11/5/2014	Cs-137	0.40 ± 0.01	0.39 ± 0.01	0.39 ± 0.01	Pass
DW-50262,3	11/10/2014	Gr. Alpha	8.95 ± 1.26	7.84 ± 1.24	8.40 ± 0.88	Pass
DW-50264,5	11/10/2014	Ra-226	3.89 ± 0.24	3.71 ± 0.20	3.80 ± 0.16	Pass
DW-50264,5	11/10/2014	Ra-228	2.96 ± 0.63	2.33 ± 0.59	2.65 ± 0.43	Pass
AP-120214A/B	12/2/2014	Gr. Beta	0.03 ± 0.00	0.03 ± 0.00	0.03 ± 0.00	Pass
AP-120814A/B	12/8/2014	Gr. Beta	0.03 ± 0.01	0.03 ± 0.01	0.03 ± 0.00	Pass
SG-7068,9	12/19/2014	Pb-214	4.27 ± 0.23	4.38 ± 0.33	4.33 ± 0.20	Pass
SG-7068,9	12/19/2014	Ac-228	2.72 ± 0.36	3.27 ± 0.49	3.00 ± 0.30	Pass
S-7152,3	12/25/2014	K-40	20.83 ± 0.88	20.16 ± 0.62	20.49 ± 0.54	Pass

TABLE A-6. Department of Energy's Mixed Analyte Performance Evaluation Program (MAPEP).

Lab Code <sup>b</sup>	Date	Analysis	Laboratory result	Concentration <sup>a</sup>		Acceptance
				Known Activity	Control Limits <sup>c</sup>	
MAW-1140	2/1/2014	Gr. Alpha	0.77 ± 0.06	0.85	0.26 - 1.44	Pass
MAW-1140	2/1/2014	Gr. Beta	4.31 ± 0.08	4.19	2.10 - 6.29	Pass
MAW-1142	2/1/2014	I-129	-0.01 ± 8.00	0.00	NA	Pass
MAW-1184	2/1/2014	Fe-55	0.40 ± 3.20	0.00	-0.01 - 2.00	Pass
MAW-1184	2/1/2014	H-3	345.10 ± 10.60	321.00	225.00 - 417.00	Pass
MAW-1184	2/1/2014	Ni-63	32.40 ± 3.20	34.00	23.80 - 44.20	Pass
MAW-1184 <sup>f</sup>	2/1/2014	Pu-238	1.28 ± 0.12	0.83	0.58 - 1.08	Fail
MAW-1184 <sup>f</sup>	2/1/2014	Pu-239/240	0.91 ± 0.10	0.68	0.47 - 0.88	Fail
MAW-1184	2/1/2014	Sr-90	7.00 ± 0.70	8.51	5.96 - 11.06	Pass
MAW-1184	2/1/2014	Tc-99	8.10 ± 0.60	10.30	7.20 - 13.40	Pass
MAW-1184	2/1/2014	U-233/234	0.20 ± 0.07	0.23	0.16 - 0.29	Pass
MAW-1184	2/1/2014	U-238	1.25 ± 0.18	1.45	1.02 - 1.89	Pass
MAW-1184	2/1/2014	Co-57	27.86 ± 0.38	27.50	19.30 - 35.80	Pass
MAW-1184	2/1/2014	Co-60	15.99 ± 0.27	16.00	11.20 - 20.80	Pass
MAW-1184	2/1/2014	Cs-134	21.85 ± 0.54	23.10	16.20 - 30.00	Pass
MAW-1184	2/1/2014	Cs-137	28.74 ± 0.49	28.90	20.20 - 37.60	Pass
MAW-1184	2/1/2014	K-40	1.80 ± 2.00	0.00	0.00 - 10.00	Pass
MAW-1184	2/1/2014	Mn-54	14.06 ± 0.40	13.90	9.70 - 18.10	Pass
MAW-1184	2/1/2014	Zn-65	0.00 ± 0.19	0.00	-0.01 - 0.00	Pass
MAVE-1148	2/1/2014	Co-57	11.63 ± 0.19	10.10	7.10 - 13.10	Pass
MAVE-1148	2/1/2014	Co-60	7.28 ± 0.18	6.93	4.85 - 9.01	Pass
MAVE-1148	2/1/2014	Cs-134	6.29 ± 0.29	6.04	4.23 - 7.85	Pass
MAVE-1148	2/1/2014	Cs-137	5.18 ± 0.20	4.74	3.32 - 6.16	Pass
MAVE-1148	2/1/2014	Mn-54	9.22 ± 0.26	8.62	6.03 - 11.21	Pass
MAVE-1148	2/1/2014	Zn-65	8.59 ± 0.40	7.86	5.50 - 10.22	Pass
MAAP-1151	2/1/2014	Am-241	0.09 ± 0.02	0.09	0.06 - 0.12	Pass
MAAP-1151 <sup>d</sup>	2/1/2014	Co-57	1.60 ± 0.05	0.00	NA	Fail
MAAP-1151	2/1/2014	Co-60	1.38 ± 0.08	1.39	0.97 - 1.81	Pass
MAAP-1151	2/1/2014	Cs-134	1.75 ± 0.11	1.91	1.34 - 2.48	Pass
MAAP-1151	2/1/2014	Cs-137	1.81 ± 0.10	1.76	1.23 - 2.29	Pass
MAAP-1151	2/1/2014	Mn-54	0.01 ± 0.03	0.00	NA	Pass
MAAP-1151 <sup>f</sup>	2/1/2014	Pu-238	0.08 ± 0.02	0.00	NA	Fail
MAAP-1151	2/1/2014	Pu-239/240	0.10 ± 0.02	0.08	0.05 - 0.10	Pass
MAAP-1151	2/1/2014	Zn-65	-0.24 ± 0.09	0.00	-0.50 - 1.00	Pass

TABLE A-6. Department of Energy's Mixed Analyte Performance Evaluation Program (MAPEP).

Lab Code <sup>b</sup>	Date	Analysis	Laboratory result	Concentration <sup>a</sup>		Acceptance
				Known Activity	Control Limits <sup>c</sup>	
MAAP-1151	2/1/2014	U-233/234	0.03 ± 0.01	0.02	0.01 - 0.03	Pass
MAAP-1151	2/1/2014	U-238	0.13 ± 0.02	0.13	0.09 - 0.17	Pass
MAAP-1151	2/1/2014	Sr-90	1.11 ± 0.14	1.18	0.83 - 1.53	Pass
MAAP-1154	2/1/2014	Gr. Alpha	0.56 ± 0.06	1.77	0.53 - 3.01	Pass
MAAP-1154	2/1/2014	Gr. Beta	0.98 ± 0.06	0.77	0.39 - 1.16	Pass
MASO-1146	2/1/2014	Co-57	1064.50 ± 3.60	966.00	676.00 - 1256.00	Pass
MASO-1146	2/1/2014	Co-60	1.70 ± 0.50	1.22	NA <sup>e</sup>	Pass
MASO-1146 <sup>g</sup>	2/1/2014	Cs-134	6.10 ± 1.80	0.00	NA	Fail
MASO-1146	2/1/2014	Cs-137	1364.30 ± 5.30	1238.00	867.00 - 1609.00	Pass
MASO-1146	2/1/2014	K-40	728.90 ± 15.90	622.00	435.00 - 809.00	Pass
MASO-1146	2/1/2014	Mn-54	1588.00 ± 6.00	1430.00	1001.00 - 1859.00	Pass
MASO-1146	2/1/2014	Zn-65	763.50 ± 6.80	695.00	487.00 - 904.00	Pass
MASO-1146	2/1/2014	Am-241	68.20 ± 9.00	68.00	47.60 - 88.40	Pass
MASO-1146	2/1/2014	Ni-63	4.80 ± 15.30	0.00	NA	Pass
MASO-1146 <sup>f</sup>	2/1/2014	Pu-238	140.60 ± 15.50	96.00	67.00 - 125.00	Fail
MASO-1146 <sup>f</sup>	2/1/2014	Pu-239/240	102.00 ± 13.10	76.80	53.80 - 99.80	Fail
MASO-1146	2/1/2014	Sr-90	1.23 ± 1.37	0.00	NA	Pass
MASO-1146	2/1/2014	Tc-99	-0.30 ± 12.00	0.00	NA	Pass
MASO-1146 <sup>h</sup>	2/1/2014	U-233/234	22.90 ± 3.00	81.00	57.00 - 105.00	Fail
MASO-1146 <sup>h</sup>	2/1/2014	U-238	32.00 ± 3.60	83.00	58.00 - 108.00	Fail
MASO-4439	8/1/2014	Am-241	65.90 ± 6.70	85.50	59.90 - 111.20	Pass
MASO-4439	8/1/2014	Ni-63	771.62 ± 23.29	980.00	686.00 - 1274.00	Pass
MASO-4439	8/1/2014	Pu-239/240	55.63 ± 5.81	58.60	41.00 - 76.20	Pass
MASO-4439	8/1/2014	Sr-90	778.34 ± 17.82	858.00	601.00 - 1115.00	Pass
MASO-4439	8/1/2014	Tc-99	458.20 ± 9.20	589.00	412.00 - 766.00	Pass
MASO-4439	8/1/2014	Cs-134	520.60 ± 7.09	622.00	435.00 - 809.00	Pass
MASO-4439	8/1/2014	Co-57	1135.00 ± 7.40	1116.00	781.00 - 1451.00	Pass
MASO-4439	8/1/2014	Co-60	768.20 ± 7.70	779.00	545.00 - 1013.00	Pass
MASO-4439	8/1/2014	Mn-54	1050.70 ± 12.60	1009.00	706.00 - 1312.00	Pass
MASO-4439	8/1/2014	Zn-65	407.89 ± 15.03	541.00	379.00 - 703.00	Pass
MAW-4431	8/1/2014	Am-241	0.79 ± 0.08	0.88	0.62 - 1.14	Pass
MAW-4431	8/1/2014	Cs-137	18.62 ± 0.54	18.40	12.90 - 23.90	Pass
MAW-4431	8/1/2014	Co-57	24.85 ± 0.42	24.70	17.30 - 32.10	Pass
MAW-4431	8/1/2014	Co-60	12.27 ± 0.38	12.40	8.70 - 16.10	Pass
MAW-4431	8/1/2014	H-3	207.20 ± 10.60	208.00	146.00 - 270.00	Pass
MAW-4431 <sup>i</sup>	8/1/2014	Fe-55	55.10 ± 14.80	31.50	22.10 - 41.00	Fail
MAW-4431	8/1/2014	Mn-54	14.36 ± 0.53	14.00	9.80 - 18.20	Pass
MAW-4431	8/1/2014	Zn-65	11.46 ± 0.78	10.90	7.60 - 14.20	Pass



TABLE A-6. Department of Energy's Mixed Analyte Performance Evaluation Program (MAPEP).

Lab Code <sup>b</sup>	Date	Analysis	Laboratory result	Concentration <sup>a</sup>		Acceptance
				Known Activity	Control Limits <sup>c</sup>	
MAW-4431	8/1/2014	Tc-99	6.10 ± 0.50	6.99	4.89 - 9.09	Pass
MAW-4431	8/1/2014	Pu-238	0.59 ± 0.07	0.62	0.43 - 0.80	Pass
MAW-4431	8/1/2014	U-233/234	0.22 ± 0.04	0.21	0.14 - 0.27	Pass
MAW-4431	8/1/2014	U-238	1.25 ± 0.10	1.42	0.99 - 1.85	Pass
MAW-4493	8/1/2014	Gr. Alpha	0.93 ± 0.07	1.40	0.42 - 2.38	Pass
MAW-4493	8/1/2014	Gr. Beta	6.31 ± 1.35	6.50	3.25 - 9.75	Pass
MAAP-4433	8/1/2014	Am-241	0.06 ± 0.02	0.07	0.05 - 0.09	Pass
MAAP-4433	8/1/2014	Pu-238	0.10 ± 0.03	0.11	0.08 - 0.14	Pass
MAAP-4433	8/1/2014	Pu-239/240	0.04 ± 0.02	0.05	0.03 - 0.06	Pass
MAAP-4433	8/1/2014	Sr-90	0.74 ± 0.10	0.70	0.49 - 0.91	Pass
MAAP-4433	8/1/2014	U-233/234	0.03 ± 0.01	0.04	0.03 - 0.05	Pass
MAAP-4433	8/1/2014	U-238	0.21 ± 0.03	0.25	0.18 - 0.33	Pass
MAAP-4444	8/1/2014	Sr-89	7.82 ± 0.52	9.40	6.60 - 12.20	Pass
MAAP-4444	8/1/2014	Sr-90	0.76 ± 0.10	0.76	0.53 - 0.99	Pass
MAVE-4436	8/1/2014	Cs-134	7.49 ± 0.18	7.38	5.17 - 9.59	Pass
MAVE-4436	8/1/2014	Co-57	11.20 ± 0.19	9.20	6.40 - 12.00	Pass
MAVE-4436	8/1/2014	Co-60	6.84 ± 0.17	6.11	4.28 - 7.94	Pass
MAVE-4436	8/1/2014	Mn-54	8.11 ± 0.26	7.11	4.97 - 9.23	Pass
MAVE-4436	8/1/2014	Zn-65	7.76 ± 0.43	6.42	4.49 - 8.35	Pass

<sup>a</sup> Results are reported in units of Bq/kg (soil), Bq/L (water) or Bq/total sample (filters, vegetation).

<sup>b</sup> Laboratory codes as follows: MAW (water), MAAP (air filter), MASO (soil), MAVI (vegetation).

<sup>c</sup> MAPEP results are presented as the known values and expected laboratory precision (1 sigma, 1 determination) and control limits as defined by the MAPEP. A known value of "zero" indicates an analysis was included in the testing series as a "false positive". MAPEP does not provide control limits.

<sup>d</sup> Interference from Eu-152 resulted in misidentification of Co-57.

<sup>e</sup> Provided in the series for "sensitivity evaluation": MAPEP does not provide control limits.

<sup>f</sup> The high bias on the plutonium crosscheck samples was traced to contamination from a newly purchased standard.

The results of reanalysis with replacement tracer purchased from NIST:

MAW-1184	Pu-238	0.68 ± 0.10	Bq / L
MAW-1184	Pu-239/240	0.66 ± 0.10	Bq / L
MASO-1146	Pu-238	95.15 ± 8.98	Bq / kg
MASO-1146	Pu-239/240	67.21 ± 7.54	Bq / kg

Insufficient sample remained to reanalyze the Air filter sample(MAAP-1151). High bias results due to same contaminated tracer

<sup>g</sup> False positive test. Long sample counting time lead to interference from naturaling occurring Bi-214 in sample matrix with a close spectral energy.

<sup>h</sup> 80% of participating laboratories were outside the acceptable range.

Parallel reanalysis was run on ERA spiked sample with acceptable results.

<sup>i</sup> Result of reanalysis Fe-55 32.63 ± 16.30 Bq / L

TABLE A-7. Interlaboratory Comparison Crosscheck program, Environmental Resource Associates (ERA)<sup>a</sup>.

Lab Code <sup>b</sup>	Date	Analysis	Concentration (pCi/L) <sup>b</sup>		Control Limits	Acceptance
			Laboratory Result <sup>c</sup>	ERA Result <sup>d</sup>		
ERAP-1044	3/17/2014	Am-241	54.2 ± 3.0	59.7	36.8 - 80.8	Pass
ERAP-1044	3/17/2014	Co-60	1177.9 ± 14.3	1120.0	867.0 - 1400.0	Pass
ERAP-1044	3/17/2014	Cs-134	1010.5 ± 15.8	1010.0	643.0 - 1250.0	Pass
ERAP-1044	3/17/2014	Cs-137	938.3 ± 45.7	828.0	622.0 - 1090.0	Pass
ERAP-1044	3/17/2014	Fe-55	142.3 ± 87.3	240.0	74.4 - 469.0	Pass
ERAP-1044	3/17/2014	Gr. Alpha	52.3 ± 0.5	46.0	15.4 - 71.4	Pass
ERAP-1044	3/17/2014	Gr. Beta	64.4 ± 2.6	53.8	34.0 - 78.4	Pass
ERAP-1044	3/17/2014	Mn-54	< 4.9	0.0	NA	Pass
ERAP-1044	3/17/2014	Pu-238	63.0 ± 2.6	56.3	38.6 - 74.0	Pass
ERAP-1044	3/17/2014	Pu-239/240	52.8 ± 1.9	48.6	35.2 - 63.5	Pass
ERAP-1044	3/17/2014	Sr-90	81.4 ± 1.6	78.9	38.6 - 118.0	Pass
ERAP-1044	3/17/2014	U-233/234	30.4 ± 1.7	36.4	22.6 - 54.9	Pass
ERAP-1044	3/17/2014	U-238	30.4 ± 1.4	36.1	23.3 - 49.9	Pass
ERAP-1044	3/17/2014	Uranium	62.0 ± 3.5	74.3	41.1 - 113.0	Pass
ERAP-1044	3/17/2014	Zn-65	852.2 ± 26.1	667.0	478.0 - 921.0	Pass
ERSO-1050	3/17/2014	Am-241	426.6 ± 155.5	399.0	233.0 - 518.0	Pass
ERSO-1050	3/17/2014	Ac-228	1260.0 ± 107.0	1240.0	795.0 - 1720.0	Pass
ERSO-1050	3/17/2014	Bi-212	1331.9 ± 309.7	1240.0	330.0 - 1820.0	Pass
ERSO-1050	3/17/2014	Bi-214	1804.5 ± 50.4	1960.0	1180.0 - 2820.0	Pass
ERSO-1050	3/17/2014	Co-60	6738.8 ± 167.6	6830.0	4620.0 - 9400.0	Pass
ERSO-1050	3/17/2014	Cs-134	3262.9 ± 108.8	3390.0	2220.0 - 4070.0	Pass
ERSO-1050	3/17/2014	Cs-137	8538.6 ± 55.0	8490.0	6510.0 - 10900.0	Pass
ERSO-1050	3/17/2014	K-40	11241.3 ± 296.6	10500.0	7660.0 - 14100.0	Pass
ERSO-1050	3/17/2014	Mn-54	< 21.6	0.0	NA	Pass
ERSO-1050	3/17/2014	Pb-212	1119.6 ± 26.1	1240.0	812.0 - 1730.0	Pass
ERSO-1050	3/17/2014	Pb-214	1861.7 ± 54.9	2070.0	1210.0 - 3090.0	Pass
ERSO-1050 <sup>e</sup>	3/17/2014	Pu-238	1085.5 ± 167.7	578.0	348.0 - 797.0	Fail
ERSO-1050 <sup>e</sup>	3/17/2014	Pu-239/240	681.6 ± 128.6	471.0	308.0 - 651.0	Fail
ERSO-1050	3/17/2014	Sr-90	2338.0 ± 144.0	2780.0	1060.0 - 4390.0	Pass
ERSO-1050	3/17/2014	Th-234	3474.9 ± 226.0	3360.0	1060.0 - 6320.0	Pass
ERSO-1050	3/17/2014	U-233/234	3319.5 ± 250.2	2780.0	1060.0 - 4390.0	Pass
ERSO-1050	3/17/2014	U-238	3375.6 ± 252.6	3360.0	2080.0 - 4260.0	Pass
ERSO-1050	3/17/2014	Uranium	6810.6 ± 551.1	6910.0	3750.0 - 9120.0	Pass
ERSO-1050	3/17/2014	Zn-65	5968.0 ± 226.1	5400.0	4300.0 - 7180.0	Pass

TABLE A-7. Interlaboratory Comparison Crosscheck program, Environmental Resource Associates (ERA)<sup>a</sup>.

Lab Code <sup>b</sup>	Date	Analysis	Concentration (pCi/L) <sup>b</sup>			Acceptance
			Laboratory Result <sup>c</sup>	ERA Result <sup>d</sup>	Control Limits	
ERVE-1051	3/17/2014	Am-241	1532.0 ± 149.5	1490.0	911.0 - 1980.0	Pass
ERVE-1051	3/17/2014	Cm-244	519.8 ± 94.6	516.0	253.0 - 804.0	Pass
ERVE-1051	3/17/2014	Co-60	981.2 ± 41.8	926.0	639.0 - 1290.0	Pass
ERVE-1051	3/17/2014	Cs-134	701.4 ± 58.6	646.0	415.0 - 839.0	Pass
ERVE-1051	3/17/2014	Cs-137	961.9 ± 46.3	880.0	638.0 - 1220.0	Pass
ERVE-1051	3/17/2014	K-40	32789.7 ± 758.2	31900.0	23000.0 - 44800.0	Pass
ERVE-1051	3/17/2014	Mn-54	< 25.9	0.0	NA	Pass
ERVE-1051	3/17/2014	Pu-238	2724.1 ± 259.4	2110.0	1260.0 - 2890.0	Pass
ERVE-1051	3/17/2014	Pu-239/240	4361.4 ± 323.4	3740.0	2300.0 - 5150.0	Pass
ERVE-1051	3/17/2014	Sr-90	2405.7 ± 263.2	2580.0	1470.0 - 3420.0	Pass
ERVE-1051	3/17/2014	U-233/234	1612.2 ± 162.0	1760.0	1160.0 - 2260.0	Pass
ERVE-1051	3/17/2014	U-238	1574.3 ± 159.6	1750.0	1170.0 - 2220.0	Pass
ERVE-1051	3/17/2014	Uranium	3255.4 ± 356.7	3580.0	2430.0 - 4460.0	Pass
ERVE-1051	3/17/2014	Zn-65	1124.1 ± 101.2	919.0	663.0 - 1290.0	Pass
ERW-1054	3/17/2014	Am-241	104.6 ± 3.4	114.0	76.8 - 153.0	Pass
ERW-1054	3/17/2014	Co-60	1195.2 ± 18.9	1270.0	1100.0 - 1490.0	Pass
ERW-1054	3/17/2014	Cs-134	1474.9 ± 47.5	1660.0	1220.0 - 1910.0	Pass
ERW-1054	3/17/2014	Cs-137	2591.0 ± 23.4	2690.0	2280.0 - 3220.0	Pass
ERW-1054	3/17/2014	Mn-54	< 4.3	0.0	NA	Pass
ERW-1054	3/17/2014	Pu-238	54.1 ± 3.6	44.1	32.6 - 54.9	Pass
ERW-1054	3/17/2014	Pu-239/240	185.9 ± 17.6	160.0	124.0 - 202.0	Pass
ERW-1054	3/17/2014	U-233/234	74.8 ± 6.3	82.4	61.9 - 106.0	Pass
ERW-1054	3/17/2014	U-238	76.4 ± 7.8	81.8	62.4 - 100.0	Pass
ERW-1054	3/17/2014	Uranium	154.3 ± 14.6	168.0	123.0 - 217.0	Pass
ERW-1054	3/17/2014	Zn-65	1818.5 ± 56.4	1800.0	1500.0 - 2270.0	Pass
ERW-1055 <sup>f</sup>	3/17/2014	Fe-55	636.3 ± 176.0	1200.0	716.0 - 1630.0	Fail
ERW-1055	3/17/2014	Gr. Alpha	120.9 ± 3.5	133.0	47.2 - 206.0	Pass
ERW-1055	3/17/2014	Gr. Beta	141.6 ± 2.3	174.0	99.6 - 258.0	Pass
ERW-1055	3/17/2014	Sr-90	873.9 ± 56.9	890.0	580.0 - 1180.0	Pass
ERW-1060	3/17/2014	H-3	5818.0 ± 230.0	5580.0	3740.0 - 7960.0	Pass

<sup>a</sup> Results obtained by Environmental, Inc., Midwest Laboratory as a participant in the crosscheck program for proficiency testing administered by Environmental Resources Associates, serving as a replacement for studies conducted previously by the Environmental Measurements Laboratory Quality Assessment Program (EML).

<sup>b</sup> Laboratory codes as follows: ERW (water), ERAP (air filter), ERSO (soil), ERVE (vegetation). Results are reported in units of pCi/L, except for air filters (pCi/Filter), vegetation and soil (pCi/kg).

<sup>c</sup> Unless otherwise indicated, the laboratory result is given as the mean ± standard deviation for three determinations.

<sup>d</sup> Results are presented as the known values, expected laboratory precision (1 sigma, 1 determination) and control limits as provided by ERA. A known value of "zero" indicates an analysis was included in the testing series as a "false positive". Control limits are not provided.

<sup>e</sup> The high bias on the plutonium crosscheck samples was traced to contamination from a newly purchased standard.

The results of reanalysis with replacement tracer purchased from NIST:

ERSO-1050	Pu-238	634.7 ± 98.50	Bq / kg
ERSO-1050	Pu-239/240	451.8 ± 82.80	Bq / kg

<sup>f</sup> An error in the efficiency calculation was found. The result of recalculation was 932 pCi/L.

The sample was repeated, result of reanalysis, 1066 pCi/L.

## APPENDIX B. DATA REPORTING CONVENTIONS

---

### Data Reporting Conventions

1.0. All activities, except gross alpha and gross beta, are decay corrected to collection time or the end of the collection period.

### 2.0. Single Measurements

Each single measurement is reported as follows:  $x \pm s$   
where:  $x$  = value of the measurement;  
 $s$  =  $2\sigma$  counting uncertainty (corresponding to the 95% confidence level).

In cases where the activity is less than the lower limit of detection  $L$ , it is reported as:  $< L$ ,  
where  $L$  = the lower limit of detection based on  $4.66\sigma$  uncertainty for a background sample.

### 3.0. Duplicate analyses

If duplicate analyses are reported, the convention is as follows. :

- 3.1 Individual results: For two analysis results;  $x_1 \pm s_1$  and  $x_2 \pm s_2$   
Reported result:  $x \pm s$ ; where  $x = (1/2)(x_1 + x_2)$  and  $s = (1/2)\sqrt{s_1^2 + s_2^2}$
- 3.2. Individual results:  $< L_1, < L_2$  Reported result:  $< L$ , where  $L$  = lower of  $L_1$  and  $L_2$
- 3.3. Individual results:  $x \pm s, < L$  Reported result:  $x \pm s$  if  $x \geq L$ ;  $< L$  otherwise.

### 4.0. Computation of Averages and Standard Deviations

4.1 Averages and standard deviations listed in the tables are computed from all of the individual measurements over the period averaged; for example, an annual standard deviation would not be the average of quarterly standard deviations. The average and standard deviation "s" of a set of  $n$  numbers  $x_1, x_2, \dots, x_n$  are defined as follows:

$$\bar{x} = \frac{1}{n} \sum x \quad s = \sqrt{\frac{\sum (x - \bar{x})^2}{n-1}}$$

4.2 Values below the highest lower limit of detection are not included in the average.

4.3 If all values in the averaging group are less than the highest LLD, the highest LLD is reported.

4.4 If all but one of the values are less than the highest LLD, the single value  $x$  and associated two sigma error is reported.

4.5 In rounding off, the following rules are followed:

- 4.5.1. If the number following those to be retained is less than 5, the number is dropped, and the retained numbers are kept unchanged. As an example, 11.443 is rounded off to 11.44.
- 4.5.2. If the number following those to be retained is equal to or greater than 5, the number is dropped and the last retained number is raised by 1. As an example, 11.445 is rounded off to 11.45.

APPENDIX C

Table C-1. Maximum permissible concentrations of radioactivity in air and water above natural background in unrestricted areas<sup>a</sup>.

	Air (pCi/m <sup>3</sup> )	Water (pCi/L)	
Gross alpha	1 x 10 <sup>-3</sup>	Strontium-89	8,000
Gross beta	1	Strontium-90	500
Iodine-131 <sup>b</sup>	2.8 x 10 <sup>-1</sup>	Cesium-137	1,000
		Barium-140	8,000
		Iodine-131	1,000
		Potassium-40 <sup>c</sup>	4,000
		Gross alpha	2
		Gross beta	10
		Tritium	1 x 10 <sup>6</sup>


- <sup>a</sup> Taken from Table 2 of Appendix B to Code of Federal Regulations Title 10, Part 20, and appropriate footnotes. Concentrations may be averaged over a period not greater than one year.
- <sup>b</sup> Value adjusted by a factor of 700 to reduce the dose resulting from the air-grass-cow-milk-child pathway.
- <sup>c</sup> A natural radionuclide.

APPENDIX D


Sample Collection and Analysis Program



### TLD LOCATIONS

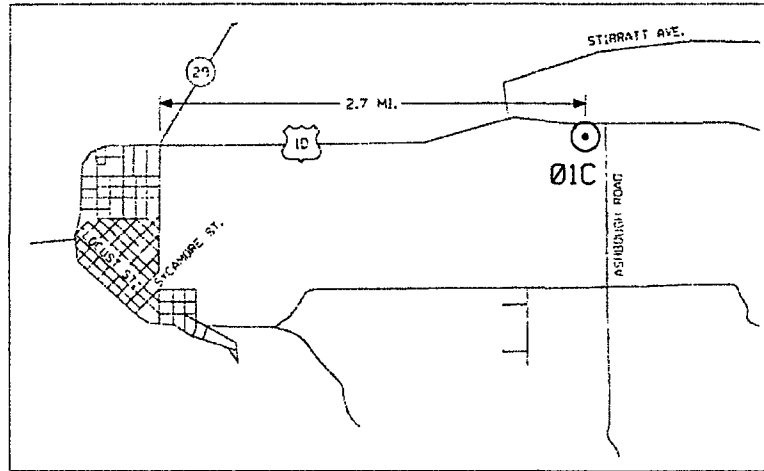

### CONTROL POINTS PRESCOTT, WISCONSIN

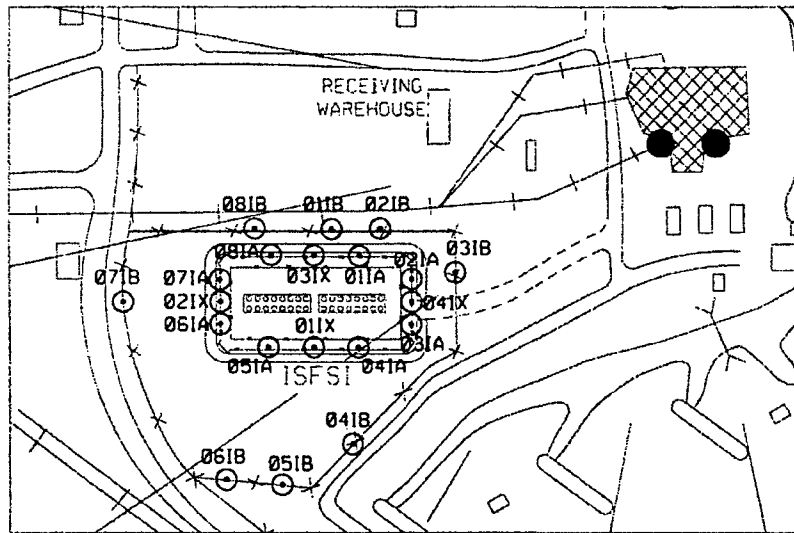


### ISFSI AREA TLD LOCATIONS

### MONITORING LEGEND:

⊙ PRAIRIE ISLAND TLD POINTS




TLD LOCATIONS  
FIVE MILE RADIUS

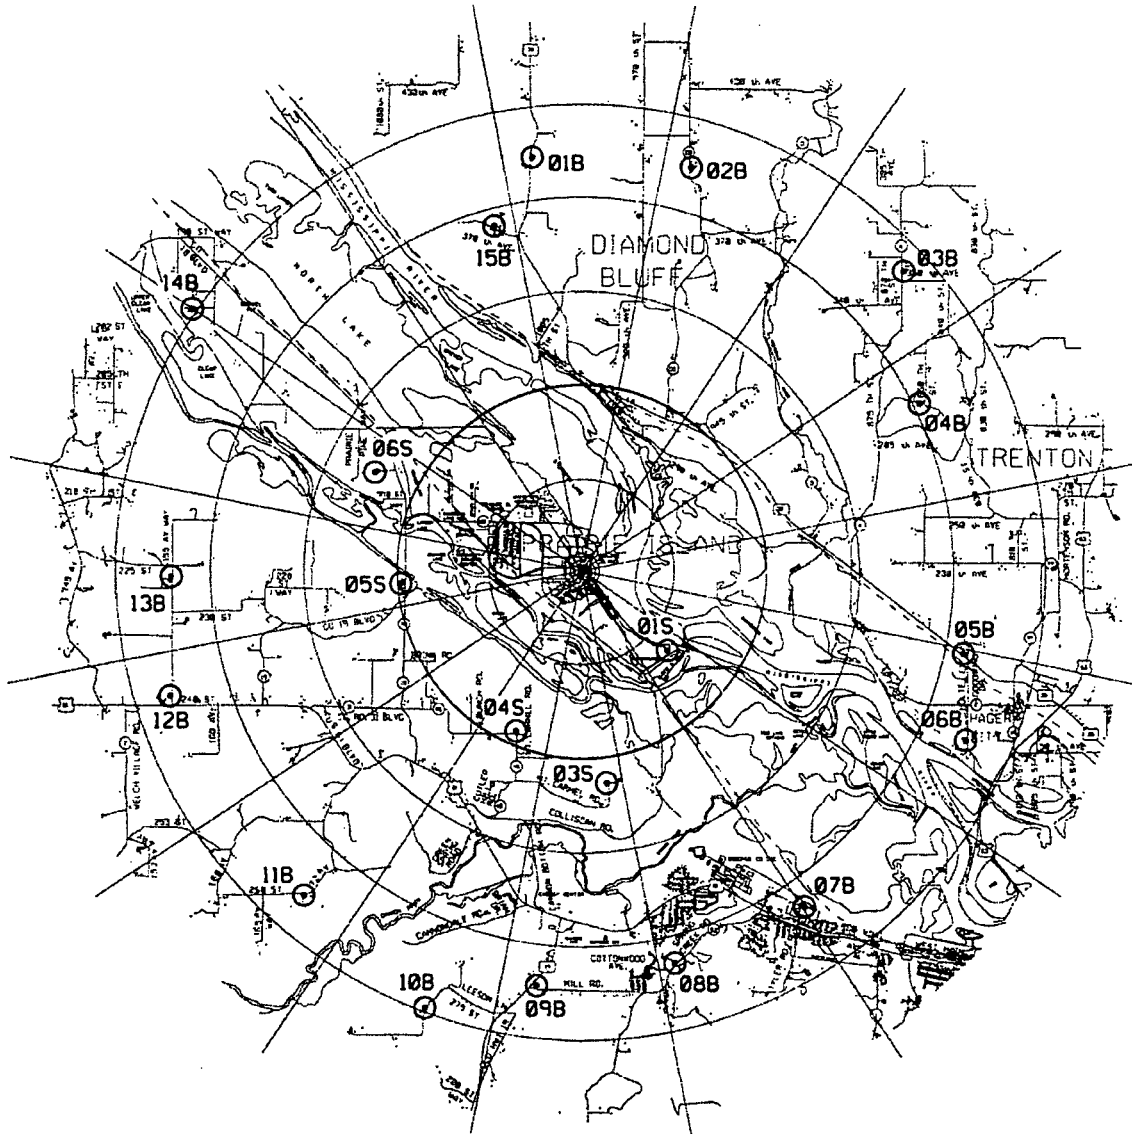

MONITORING LEGEND:

⊙ PRAIRIE ISLAND TLD POINTS

# ENVIRONMENTAL SAMPLING POINTS ONE MILE RADIUS

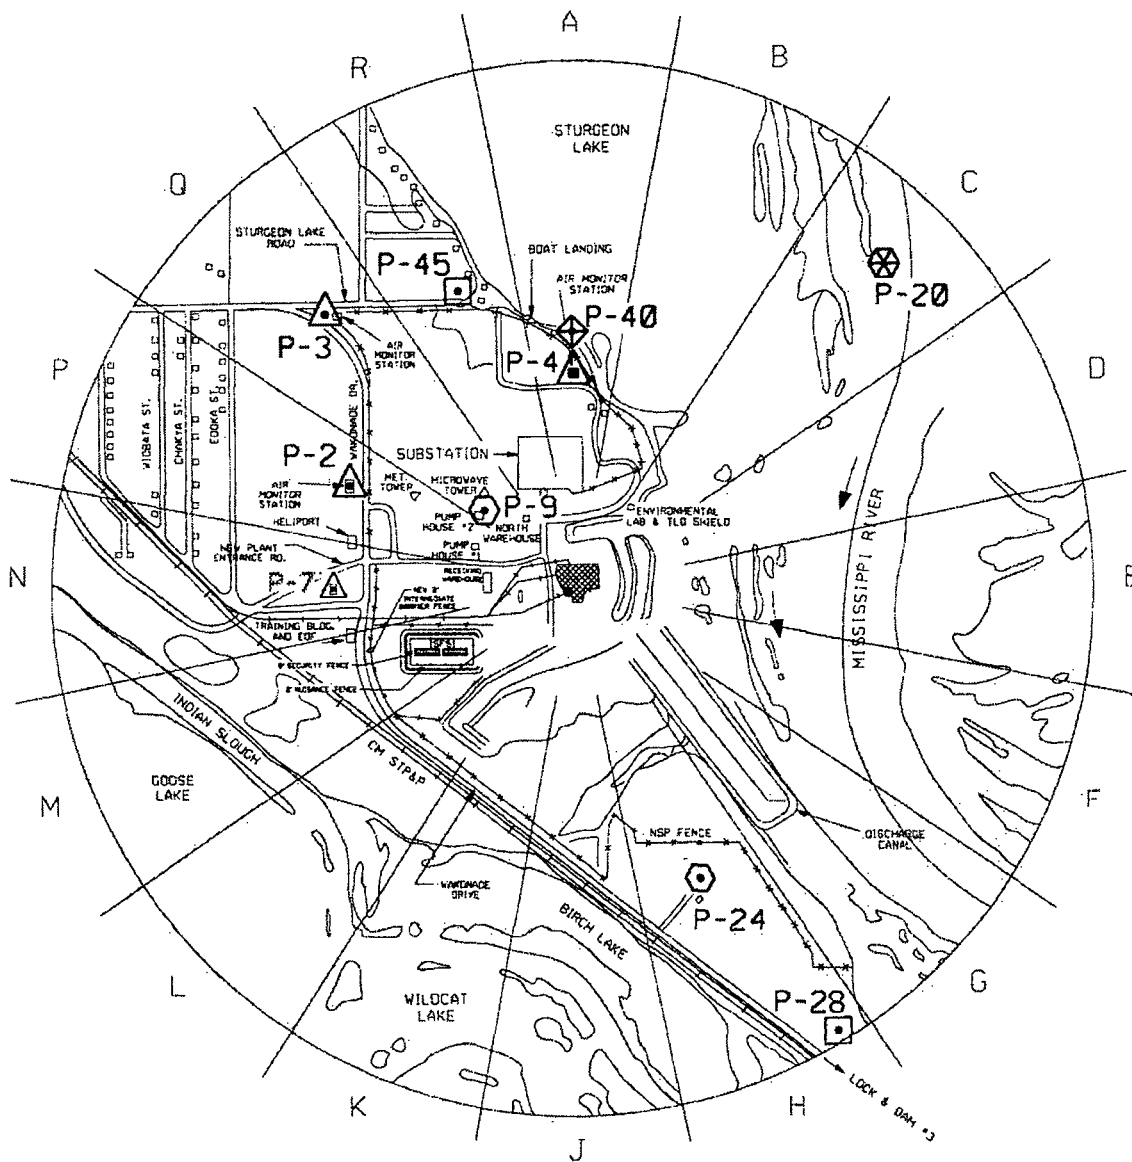


**PLANT AREA ENLARGED PLAN [1.00 MILE RADIUS]  
[NO SCALE]**

### MONITORING LEGEND

- |   |   |
|---|---|
| <p>◆ MILK SAMPLING POINT ID NUMBERS<br/>P-18, P-37, P-43</p>                      | <p>⊠ FISH SAMPLING POINT ID NUMBERS<br/>P-13, P-19</p>          |
| <p>▲ AIR SAMPLING POINT ID NUMBERS<br/>P-1, P-2, P-3, P-4, P-6, P-7</p>           | <p>◊ INVERTEBRATES POINT ID NUMBERS<br/>P-6, P-40</p>           |
| <p>⬡ WATER SAMPLING POINT ID NUMBERS<br/>P-5, P-6, P-8, P-9, P-11, P-24, P-43</p> | <p>⊠ SEDIMENT SAMPLING POINT ID NUMBERS<br/>P-6, P-12, P-20</p> |
| <p>◻ VEGETATION / VEGETABLES ID NUMBERS<br/>P-28, P-38, P-45</p>                  |   |


ENVIRONMENTAL SAMPLING POINTS  
FIVE MILE RADIUS

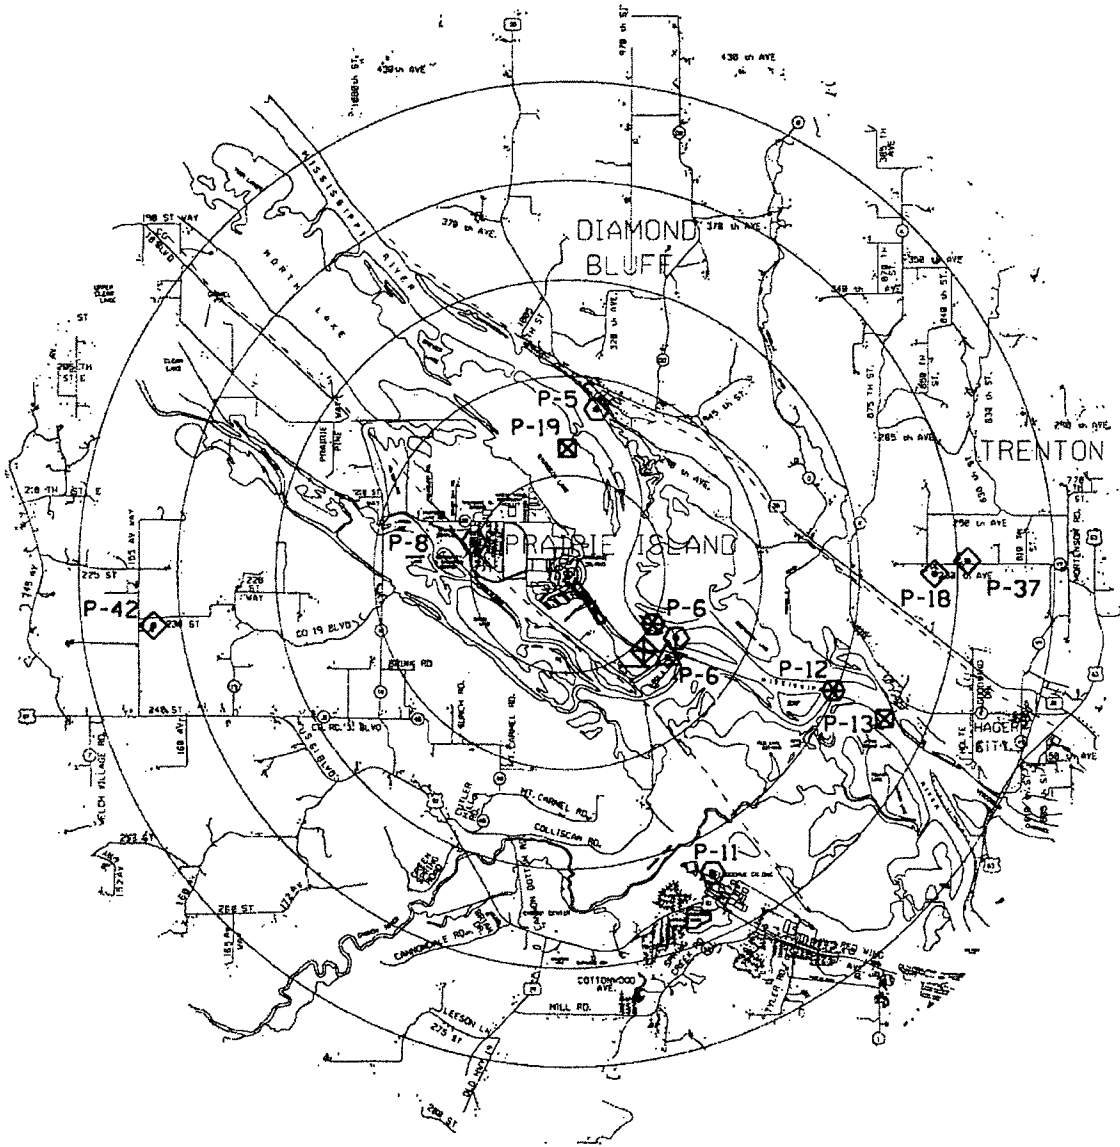

**MONITORING LEGEND**

- |  |   |
|--|---|
| <ul style="list-style-type: none"> <li>◆ MILK SAMPLING POINT ID NUMBERS<br/>P-18, P-37, P-42, P-43</li> <li>▲ AIR SAMPLING POINT ID NUMBERS<br/>P-1, P-2, P-3, P-4, P-6, P-7</li> <li>○ WATER SAMPLING POINT ID NUMBERS<br/>P-5, P-6, P-8, P-9, P-11, P-24, P-43</li> <li>□ VEGETATION / VEGETABLES ID NUMBERS<br/>P-28, P-38, P-45</li> </ul> | <ul style="list-style-type: none"> <li>⊠ FISH SAMPLING POINT ID NUMBERS<br/>P-13, P-19</li> <li>◇ INVERTEBRATES POINT ID NUMBERS<br/>P-6, P-40</li> <li>⊗ SEDIMENT SAMPLING POINT ID NUMBERS<br/>P-6, P-12, P-20</li> </ul> |
|--|---|

## ENVIRONMENTAL SAMPLING POINTS

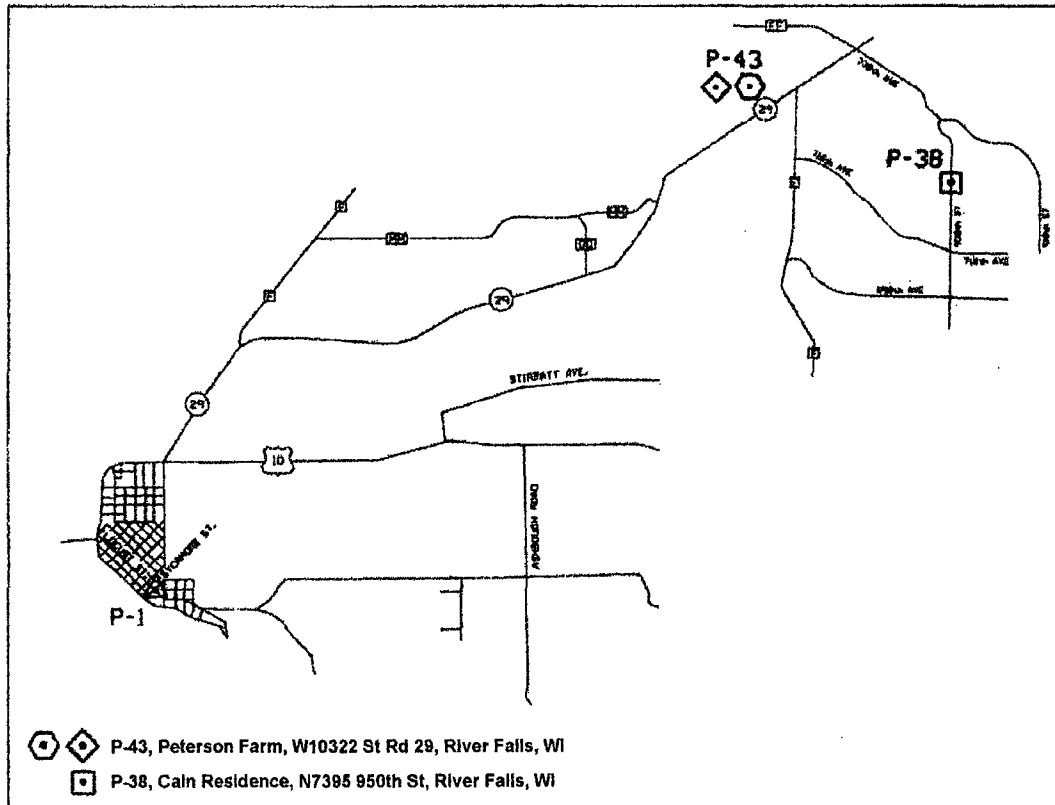

### MONITORING LEGEND

- MILK SAMPLING POINT ID NUMBERS  
 P-18, P-37, P-41, P-42, P-43
- ▲ AIR SAMPLING POINT ID NUMBERS  
 P-1, P-2, P-3, P-4, P-6, P-7
- WATER SAMPLING POINT ID NUMBERS  
 P-6, P-6, P-8, P-9, P-11, P-43
- VEGETATION / VEGETABLES ID NUMBERS  
 P-28, P-38, P-46

APPENDIX E

Special Well and  
Surface Water Samples

## 1.0 INTRODUCTION

This appendix to the Radiation Environmental Monitoring Program Annual Report to the United States Nuclear Regulatory Commission summarizes and interprets results of the special well and surface water samples taken at the Prairie Island Nuclear Generating Plant, Red Wing, Minnesota, during the period January - December, 2014. This supplemental special sampling program was established in December of 1989 when higher than expected levels of tritium were detected in a nearby residence well sample.

Tabulations of the special sampling program individual analyses made during the year are included in this appendix. A summary table of tritium analyses is also included in this appendix.

## 2.0 SUMMARY

This special sampling program was established following the detection of tritium in a residence well water sample south of the PINGP during 1989. This program is described and the results for 2014 are summarized and discussed.

Program findings for 2014 detected low levels of tritium in nearby residence wells, ground water, surface samples, and storage tanks at or near the expected natural background levels with the exception of ground water sample well MW-8, January area snow samples S-6 and S-9, and the December septic sample. The 2014 sample results (except for MW-8, S-6, S-9, and the septic system) ranged from <19 pCi/L to 324 pCi/L. Sample well MW-8 ranged from 60 pCi/L to 388 pCi/L. Snow sample S-6 was 465 pCi/L, snow sample S-9 was 595 pCi/L. The December septic system sample was 764 pCi/L. All tritium results are far below the Environmental Protection Agency's drinking water standard of 20,000 pCi/L and present no harm to any members of the public.

None of the water samples monitored for gamma-emitting isotopes showed any activity greater than the LLD.

### 3.0 Special Tritium Sampling Program

#### 3.1 Program Design and Data Interpretation

The purpose of this sampling program is to assess the impact of any tritium leaching into the environment (ground water system) from the PINGP. For this purpose, special water samples are collected and analyzed for tritium content.

#### 3.2 Program Description

The sampling and analysis schedule for the special water sampling program is summarized in Table E-4.1 and briefly reviewed below. Table E-4.2 defines the additional sample locations and codes for the special water sampling program.

Special well, tank, and surface water samples were collected quarterly (spring, summer, fall) at seven locations, quarterly at one location, monthly at six locations, semi-annually at five locations, and annually at thirty-six locations. The Peterson (P-43) and Hanson (SW-1) farm wells are used as control locations for these special samples.

To detect low levels of tritium at or below natural background levels, analyses of the samples have been contracted to a laboratory (University of Waterloo Laboratories) capable of detecting tritium concentrations down to 19 pCi/L. Waterloo Laboratories report tritium analyses results in Tritium Units (1 TU = 3.2 pCi/L). The tritium results in this report are indicated in pCi/L.

#### 3.3 Program Execution

The special water sampling was executed as described in the preceding section.

#### 3.4 Program Modifications

Changes to the program in 2014 include:

- samples were taken from monitoring wells P-10, MW-7, and MW-8 and snow from S-6, S-7, S-8, S-9, and P-43 and were sent to Environmental Incorporated for analysis for hard-to-detect nuclides in accordance with American Nuclear Insurers recommendation
- sample location P-8 was renamed P-8 Post-treat to differentiate it from a new sample location named P-8 Pre-treat (the pre-treat sample is taken prior to any water treatment, the post-treat sample is taken after treatment using chlorine, fluoride and hydrous manganese oxide in a greensand pressure filter)
- sample location PIIC-29 was added to provide a control location for the PI Indian Community samples
- sample locations PIIC-02, PIIC-03, PIIC-19, PIIC-20, PIIC-21, PIIC-23, PIIC-24, and PIIC-27 were eliminated because they were determined to be duplicate samples of the PI Indian Community community water system that is sampled at location P8 Pre-treat and P8 Post-treat

### 3.5 Results and Discussion

Results show tritium in well water and ground water samples at or near expected natural background levels except the MW-8 ground water sample well. Table E-4.4 provides the complete data table of results for each period and sampling location.

The tritium level annual averages have shown a downward trend since the special sampling began in 1989.

Except for sample well MW-8, the 2014 sample results are within the range of expected background tritium levels in shallow ground water and surface water due to tritium concentrations measured in precipitation. Sampling points in North America have shown tritium concentrations in precipitation ranging from 5 pCi/L to 157 pCi/L (Environmental Isotope Data No. 10; World Survey of Isotope Concentration in Precipitation (1988-1991)).

The higher level results at the Suter residence and Birch Lake in 1989 were possibly due to seepage from the PINGP discharge canal water into the ground water. This is thought to occur due to the elevation difference between the Vermillion River and the discharge canal. The Suter residence is located between the discharge canal and Birch Lake, which connects to the Vermillion River. The PINGP discharge canal piping was lengthened during 1991, so that liquid discharges from the plant are released near the end of the discharge canal, diffused and discharged to the Mississippi River. In 1992, the underground liquid discharge pipe from the plant to the discharge canal piping was replaced with a double walled leak detectable piping system. This year's sample results continue to indicate that these modifications have eliminated the suspected radioactive effluent flow into the local ground water.

The elevated tritium levels in sample well MW-8 in 2014 may be due to prior leakage from the PINGP liquid radwaste discharge pipe, discharge of turbine building sump water into the landlocked area, or discharge of heating steam condensate from the main warehouse in 1978/1979. The liquid radwaste discharge pipe was replaced in 1992 and the discharge to the landlocked area has been terminated, the last discharge took place on 11/14/09. The main warehouse heating system was repaired in 1979. The heating steam system was not used in the outer plant buildings during the 2014 – 2015 heating season.

The elevated tritium levels in January snow samples S-6 and S-9 are likely due to recapture of tritium vented from the plant that is entrained in precipitation. This phenomenon has been noted at other nuclear plants (see J.T. Harris, et al, "Tritium Recapture Behavior at a Nuclear Power Reactor Due to Airborne Releases, Health Physics Journal, August 2008, Volume 95, number 2.).

The elevated tritium level in the December septic system sample is still under investigation. Septic system samples in March and April of 2015 have also shown elevated tritium levels.

None of the water samples monitored for gamma-emitting isotopes showed any activity greater than the LLD.



Table E-4.1. Sample collection and analysis program for special well, storage tank, and surface water samples, Prairie Island Nuclear Generating Plant, 2014.

Medium	No.	Location codes and type <sup>a</sup>	Collection type and frequency <sup>b</sup>	Analysis type <sup>c</sup>
Well water Annual	23	P-8 post-treat, P-8 pre-treat, REMP P-6, PIIC-22, PIIC-26, PIIC-28, PIIC-29, P-7, P-11, PZ-1, PZ-2, PZ-4, PZ-5, PZ-7, MW-6, P-26, P-30, SW-3, SW-4, SW-5, SW-6, SW-7, P-9	G/A	H-3
Well water quarterly	1	P-24D	G/Q	H-3
Well water quarterly'	7	P-2, P-3, P-5, P-6, PZ-8, MW-4, MW-5	G/Q'	H-3
Well water monthly	5	P-43(C), SW-1(C), MW-7, MW-8, P-10	G/M	H-3
Surface water	8	S-1, S-2, S-3, S-4, S-5, S-6, S-7, P-31	G/A <sup>d</sup>	H-3
Storage Tank	5	11 CST, 21 CST, 22 CST, U1/2 Demin Hdr	G/S	H-3
Storage Tank	1	Septic System	G/M	H-3
Snow	5	S-6, S-7, S-8, S-9, P-43(C)	G/A	H-3

<sup>a</sup> Location codes are defined in table D-4.2. Control Stations are indicated by (C). All other stations are indicators.

<sup>b</sup> Collection type is codes as follows: G/ = grab. Collection frequency is coded as follows: M = monthly; Q = quarterly; Q' = quarterly (spring, summer, and fall), S = semiannually; A = annually.

<sup>c</sup> Analysis type is coded as follows: H-3 = tritium.

<sup>d</sup> Location S-6 and S-7 are sampled semi-annually.

Table E-4.2. Sampling locations for special well, storage tank, and surface water samples, Prairie Island Nuclear Generating Plant, 2014.

Code	Collection site	Type of sample <sup>a</sup>	Distance and direction from reactor
P-8	PI Community well post treat	WW	1.0 mi. @ 321°/WNW
P-8	PI Community well pre treat	WW	1.0 mi. @ 321°/WNW
REMP P-6	Lock & Dam #3 well	WW	1.6 mi. @ 129°/SE
PIIC-22	1773 Buffalo Slough Rd	WW	1 mi. @ 315°/NW
PIIC-26	1771 Buffalo Slough Rd	WW	1 mi. @ 315°/NW
PIIC-28	1960 Larson Lane	WW	1.5 mi @ 288°/WNW
PIIC-29	Buffalo Project	WW	4.3 mi @ 302°/WNW
P-24D	Suter residence	WW	0.6 mi. @ 158°/SSE
P-43	Peterson Farm (Control)	WW	13.9 mi. @ 355°/N
SW-1	Hanson Farm (Control)	WW	2.2 mi. @ 315°/NW
P-2	Sample well	WW	See map
P-3	Sample well	WW	See map
P-5	Sample well	WW	See map
P-6	Sample well	WW	See map
P-7	Sample well	WW	See map
P-10	Sample well	WW	See map
P-11	Sample well	WW	See map
PZ-1	Sample well	WW	See map
PZ-2	Sample well	WW	See map
PZ-4	Sample well	WW	See map
PZ-5	Sample well	WW	See map
PZ-7	Sample well	WW	See map
PZ-8	Sample well	WW	See map
MW-4	Sample well	WW	See map
MW-5	Sample well	WW	See map
MW-6	Sample well	WW	See map
MW-7	Sample well	WW	See map
MW-8	Sample well	WW	See map
P-26	PITC well	WW	0.4 mi. @ 258°/WSW
P-30	Environ lab well	WW	0.2 mi. @ 32°/NNE

Table E-4.2. Sampling locations for special well, storage tank, and surface water samples, Prairie Island Nuclear Generating Plant, 2014 (continued).

Code	Collection site	Type of sample <sup>a</sup>	Distance and direction from reactor
SW-3	Cooling Tower pump	WW	See map
SW-4	New Admin Bldg	WW	0.05 mi. @ 315°/NW
SW-5	Plant Screenhouse well	WW	0.05 mi. @ 0°/N
SW-6	Restroom Trailer well	WW	0.2 mi @ 310°/NW
SW-7	Distribution Center	WW	0.35 mi @ 271°/W
P-9	Plant well # 2	WW	0.3 mi. @ 306°/NW
S-1	Upstream Miss. River	SW	See map
S-2	Recirc/Intake canal	SW	See map
S-3	Cooling water canal	SW	See map
S-4	Discharge Canal (end)	SW	See map
S-5	Mid Discharge Canal	SW	See map
S-6	Roof Stormwater Runoff (also snow)	SW	0.05 mi. @ 0°/N
S-7	Parking Lot Stormwater (also snow)	SW	0.3 mi @ 306°/NW
S-8	P-10 area snow	SW	See map
S-9	MW-7/8 area snow	SW	See map
P-31	Birch Lake Seepage	SW	0.69 mi. @ 172°/S
11 CST	Storage Tank	ST	Turbine Building
21 CST	Storage Tank	ST	Turbine Building
22 CST	Storage Tank	ST	Turbine Building
Unit 1/2 demin hdr	Storage Tank	ST	Turbine Building
Septic System	Storage Tank	ST	Outside #1 Warehouse
Warehouse Septic	Storage Tank	ST	Outside #1 Warehouse
D5 Vault	Concrete Vault	ST	Outside Turbine Bldg

<sup>a</sup> Sample codes: WW = Well water; SW = Surface Water; ST = Storage Tank.

Table E-4.3 Radiation Environmental Monitoring Program Summary: Special well, storage tank, and surface water samples.

Name of Facility Prairie Island Nuclear Power Station Docket No. 50-282, 50-306  
 Location of Facility Goodhue, Minnesota Reporting Period January – December, 2014  
 (County, State)

Sample Type (Units)	Type and Number of Analyses <sup>a</sup>		LLD <sup>b</sup>	Indicator Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Location with Highest Annual Mean		Control Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Number Non-Routine Results <sup>e</sup>
					Location <sup>d</sup>	Mean (F) <sup>c</sup> Range <sup>c</sup>		
Offsite Well Water (pCi/L)	H-3	13	19	33 (5/13) (28-43)	PIIC-22	43 (1/1) (43)	(See Control Below)	0
Onsite Well Water (pCi/L)	H-3	74	19	114 (59/74) (23-388)	MW-8	267 (12/12) (60-388)	(See Control Below)	3
Onsite Surface Water (pCi/L)	H-3	17	19	133 (12/17) (23-595)	S-9	595 (1/1) (595)	(See Control Below)	2
Onsite Storage Tank (pCi/L)	H-3	19	19	137 (17/19) (27-764)	Septic System	189 (11/12) (27-764)	(See Control Below)	1
Control (offsite well water)	H-3	25	19	none	P-43	35 (4/13) (23-50)	34 (5/25) (23-50)	0

<sup>a</sup> H-3 = tritium

<sup>b</sup> LLD = Nominal lower limit of detection based on 4.66 sigma error for background sample. Value shown is lowest for the period.

<sup>c</sup> Mean and range are based on detectable measurements only. Fraction of detectable measurements at specified locations is indicated in parentheses (F).

<sup>d</sup> Locations are specified by code.

<sup>e</sup> Non-routine results are those which exceed ten times the control station value.

Table E-4.4 Radiological Environmental Monitoring Program , Complete Data Table, 2014.

	SAMPLE DATES	JAN 2014	FEB 2014	MAR 2014	APR 2014	MAY 2014	JUN 2014	JUL 2014	AUG 2014	SEP 2014	OCT 2014	NOV 2014	DEC 2014
CODE	SAMPLE LOCATIONS	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L
	OFFSITE WELLS												
P-8 Post-treat	PI Comm. Well								<19				<19
P-8 Pre-treat	PI Comm. Well												<19
REMP P-6	Lock & Dam #3 well									28			
PIIC-22	1773 Buffalo Slough Rd												43
PIIC-26	1771 Buffalo Slough Rd												38
PIIC-28	1960 Larson Lane												<19
PIIC-29	Buffalo Project												<19
P-24D	Suter residence	28			<19			28	<19		<19		
P-43	Peterson Farm(Control	31/23* *snow	<19	<19	<19	<19	<19	<19	<19	50	37	<19	<19
SW-1	Hanson Farm (Control)	<19	<19	<19	<19	<19	<19	<19	<19	<19	28	<19	<19

Table E-4.4 Radiological Environmental Monitoring Program , Complete Data Table, 2014 (continued).

	SAMPLE DATES	JAN 2014	FEB 2014	MAR 2014	APR 2014	MAY 2014	JUN 2014	JUL 2014	AUG 2014	SEP 2014	OCT 2014	NOV 2014	DEC 2014
CODE	SAMPLE LOCATIONS	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L
	ONSITE WELLS												
P-2	Sample well				73			92			40		
P-3	Sample well				<19			23			34		
P-5	Sample well				89			110			117		
P-6	Sample well				<19			<19			<19		
P-7	Sample well							40					
P-10	Sample well	138	79	60	60	54	110	160	97	102	118	172	207
P-11	Sample well							56					
PZ-1	Sample well								<19				
PZ-2	Sample well							39					
PZ-4	Sample well							46					
PZ-5	Sample well							60					
PZ-7	Sample well							61					
PZ-8	Sample well				<19			49			<19		
MW-4	Sample well				32				24		31		
MW-5	Sample well					<19		81			158		
MW-6	Sample well							226				<19	
MW-7	Sample well	26	69	62	43	40	27	43	118	53	60	25	<19
MW-8	Sample well	388	60	346	257	299	347	274	90	285	277	269	316
P-26	PITC well								<19				
P-30	Env. lab well								<19				
SW-3	CT pump								43				
P-9	Plant well # 2								<19				
SW-4	New Admin									26			
SW-5	Plnt Scrnhs									34			
SW-6	Restroom Trailer								<19				
SW-7	Dist Center								<19				

Table E-4.4 Radiological Environmental Monitoring Program , Complete Data Table, 2014 (continued).

	SAMPLE DATES	JAN 2014	FEB 2014	MAR 2014	APR 2014	MAY 2014	JUN 2014	JUL 2014	AUG 2014	SEP 2014	OCT 2014	NOV 2014	DEC 2014
CODE	SAMPLE LOCATIONS	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L
	ONSITE SURFACE WATER												
S-1	Mississippi River upstream								29				
S-2	Recirculation/Intake canal								41				
S-3	Cooling water canal								<19				
S-4	Discharge Canal (end)								33				
S-5	Discharge Canal (midway)								23				
S-6	Stormwater runoff	465*			57					<19	26		
S-7	Parking Lot runoff	227*			<19					<19	32		
S-8	P-10 area snow	46*											
S-9	MW-7/8 area snow	595*											
P-31	Birch Lake Seepage								23			<19	

\* snow samples

Table E-4.4 Radiological Environmental Monitoring Program , Complete Data Table, 2014 (continued).

	SAMPLE DATES	JAN 2014	FEB 2014	MAR 2014	APR 2014	MAY 2014	JUN 2014	JUL 2014	AUG 2014	SEP 2014	OCT 2014	NOV 2014	DEC 2014
CODE	SAMPLE LOCATIONS	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L	pCi/L
	ONSITE STORAGE TANKS												
11 CST	Storage tank			36									
21 CST	Storage tank			29									
22 CST	Storage tank			31									
U1/U2 Demin Header	Storage tank			33/77									<19/39
Septic System	Storage tank	91	63	<19	84	324	120	137	98	27	277	98	764



Table E-4.5. Supplementary Data Tables.

Results of the analyses for iron-55, nickel-63, strontium-90, isotopic plutonium, americium-241 and isotopic curium on five samples.

Location	P-10 Snow	Peterson Snow	MW-7/8 Snow	OAB Snow	Parking Lot Snow
Collection Date	01-13-14	01-15-14	01-13-14	01-13-14	01-15-14
Lab Code	PXW-275	PXW-276	PXW-277	PXW-278	PXW-279

Isotope	Concentration ( $\mu\text{Ci/mL}$ )				
Fe-55	< 7.4 E-07	< 7.6 E-07	< 7.3 E-07	< 7.4 E-07	< 7.4 E-07
Ni-63	< 1.1 E-08	< 1.2 E-08	< 1.1 E-08	< 1.2 E-08	< 1.2 E-08
Sr-90	< 4.5 E-10	< 4.5 E-10	< 5.2 E-10	< 5.5 E-10	< 5.5 E-10
Pu-238	< 1.8 E-10	< 1.4 E-10	< 7.3 E-11	< 1.2 E-10	< 1.7 E-10
Pu-239/240	< 7.2 E-11	< 7.8 E-11	< 7.3 E-11	< 1.7 E-10	< 6.7 E-11
Am-241	< 9.2 E-11	< 8.8 E-11	< 8.6 E-11	< 1.7 E-10	< 1.5 E-10
Cm-242	< 9.2 E-11	< 8.8 E-11	< 5.0 E-11	< 9.6 E-11	< 5.0 E-11
Cm-243/244	< 5.3 E-11	< 1.5 E-10	< 5.0 E-11	< 9.6 E-11	< 8.7 E-11

The error given is the probable counting error at 95% confidence level. Less than (<), value is based on a 4.66 sigma counting error for the background sample.

Table E-4.5. Supplementary Data Tables.(continued)


Results of the analyses for iron-55, nickel-63, strontium-90, isotopic plutonium, americium-241 and isotopic curium on three samples.

Location	P-10	MW-7	MW-8
Collection Date	05-15-14	05-15-14	06-09-14
Lab Code	PXW-2194	PXW-2195	PXW-3551

Isotope	Concentration ( $\mu\text{Ci}/\text{mL}$ )		
Fe-55	< 7.9 E-07	< 8.5 E-07	< 6.9 E-07
Ni-63	< 1.5 E-07	< 1.5 E-07	< 1.4 E-07
Sr-90	< 4.4 E-10	< 5.0 E-10	< 5.0 E-10
Pu-238	< 3.6 E-10	< 2.8 E-10	< 9.0 E-11
Pu-239/240	< 1.6 E-10	< 1.6 E-10	< 5.2 E-11
Am-241	< 1.1 E-10	< 1.4 E-10	< 1.1 E-10
Cm-242	< 1.1 E-10	< 1.4 E-10	< 1.6 E-10
Cm-243/244	< 1.1 E-10	< 1.0 E-10	< 2.2 E-10

The error given is the probable counting error at 95% confidence level. Less than (<), value is based on a 4.66 sigma counting error for the background sample.

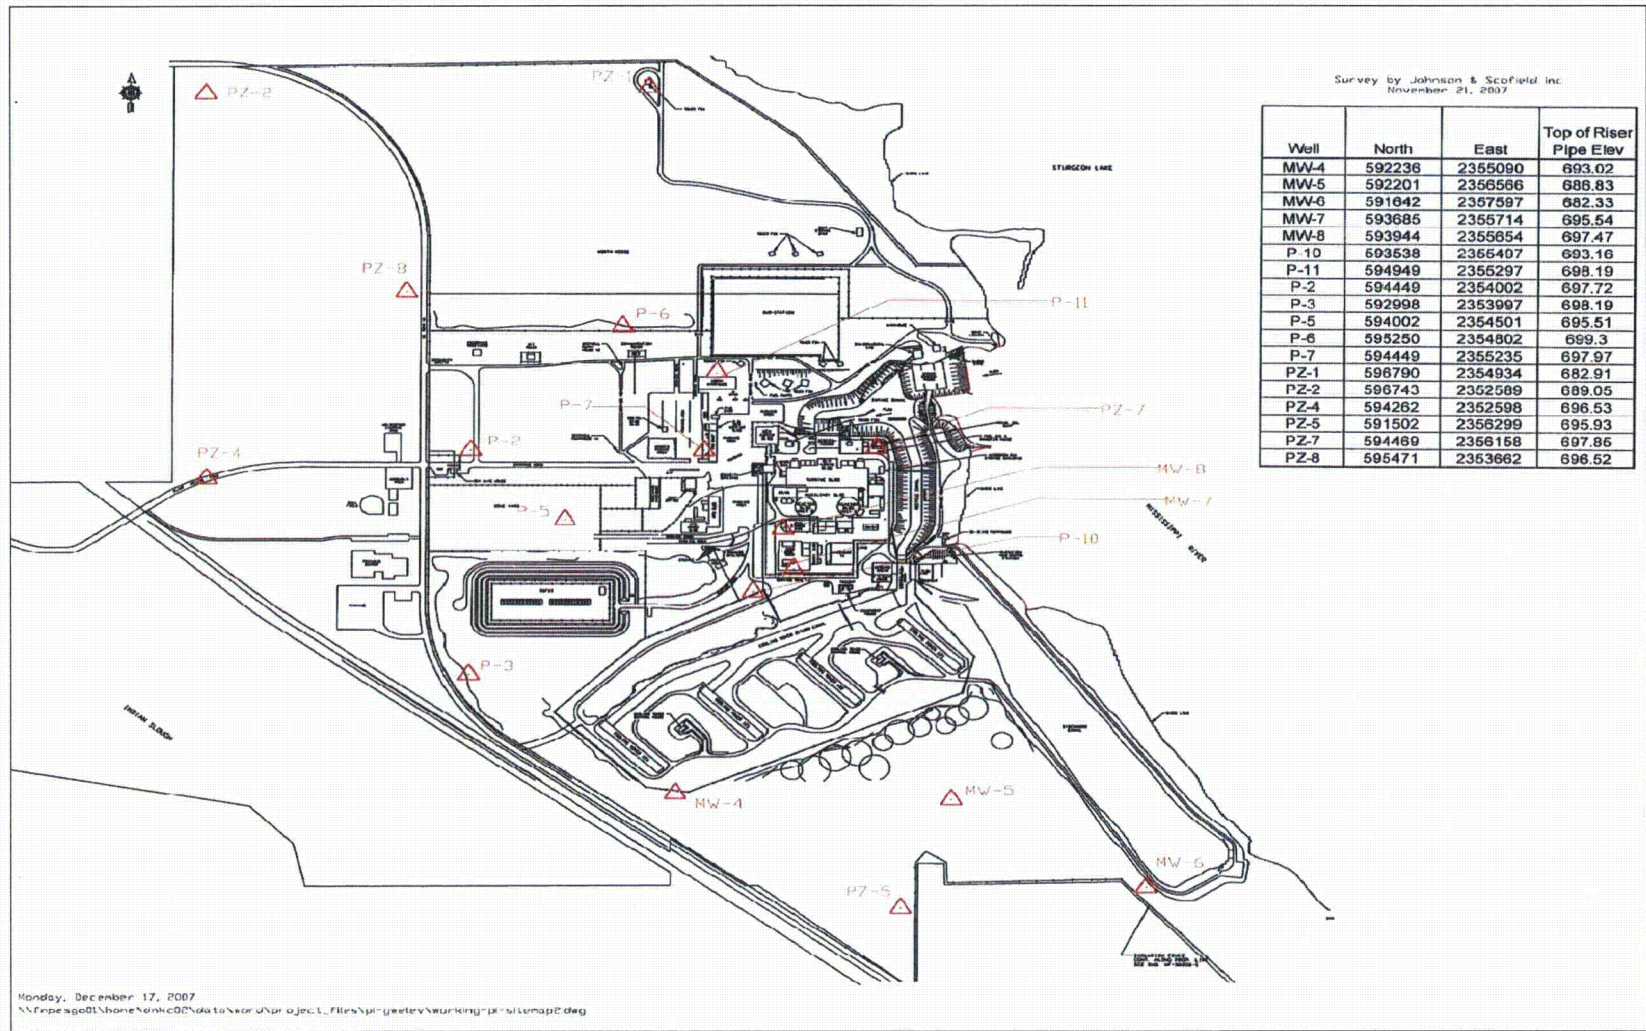

Groundwater Monitoring Well Locations