



Crystal River Nuclear Plant  
15760 W. Power Line Street  
Crystal River, FL 34428

Docket 50-302  
Operating License No. DPR-72

ITS 5.7.1.1(b)  
ODCM 6.6

May 5, 2015  
3F0515-03

U.S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Washington, DC 20555-0001

Subject: Crystal River Unit 3 – 2014 Annual Radiological Environmental Operating Report

Dear Sir:

Duke Energy Florida, Inc. hereby provides the 2014 Annual Radiological Environmental Operating Report for Crystal River Unit 3 (CR-3) in accordance with the CR-3 Improved Technical Specifications (ITS), Section 5.7.1.1(b) and Section 6.6 of the Offsite Dose Calculation Manual (ODCM). The data provided in the attached report is consistent with the objectives outlined in the ODCM and includes all radiological environmental samples taken during the report period from January 1, 2014 through December 31, 2014.

This letter establishes no new regulatory commitments.

If you have any questions regarding this submittal, please contact Mr. Phil Rose, Lead Engineer, Nuclear Regulatory Affairs, at (352) 563-4883.

Sincerely,

Blair P. Wunderly  
Plant Manager  
Crystal River Nuclear Plant

BPW/ff

Attachment: 2014 Annual Radiological Environmental Operating Report

xc: NRR Project Manager  
Regional Administrator, Region I

IE25  
NRR

**DUKE ENERGY FLORIDA, INC.**

**DOCKET NUMBER 50 - 302 / LICENSE NUMBER DPR - 72**

**ATTACHMENT**

**2014 ANNUAL RADIOLOGICAL ENVIRONMENTAL  
OPERATING REPORT**

# **ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT**

**2014**



**DUKE ENERGY FLORIDA, INC.**

**CRYSTAL RIVER UNIT 3**

Prepared By: Rudy Pinner 04/07/2015  
Sr. Scientist

## TABLE OF CONTENTS

Introduction .....	ii
I. Summary Description of the Radiological Environmental Monitoring Program.....	1
II. Land-Use Census .....	11
III. Interlaboratory Comparison Program.....	12
IV. Analytical Results.....	14
A. Airborne Pathway .....	14
Statistical Summary.....	15
B. Direct Radiation .....	26
Statistical Summary.....	27
C. Waterborne Pathway .....	30
1. Seawater .....	30
Statistical Summary .....	33
2. Ground Water.....	30
Statistical Summary .....	37
3. Site Ground Water .....	30
Statistical Summary .....	40
4. Site Ground Water Non-REMP .....	31
Statistical Summary .....	62
5. Drinking Water .....	31
Statistical Summary .....	67
6. Shoreline Sediment.....	31
Statistical Summary .....	70
7. Site Settling Ponds .....	32
Site Settling Pond Supplemental Data.....	73
8. NEI 07-07 Evaluation .....	32
D. Ingestion Pathway .....	74
1. Carnivorous Fish.....	74
Statistical Summary .....	76
2. Oysters.....	74
Statistical Summary .....	79
3. Broad Leaf Vegetation .....	74
Statistical Summary .....	82
4. Watermelon and Citrus .....	75
Statistical Summary .....	86

## INTRODUCTION

This report is submitted as required by Technical Specification 5.7.1.1(b) to the Crystal River Facility Operating License No. DPR-72, and Section 6.6 of the Offsite Dose Calculation Manual.

The following information is required to be included in this report:

- Data Summaries
- Interpretations
- Unachievable LLDs
- An analysis of trends
- An assessment of any observed impact of plant operation on the environment

NOTE: If harmful effects or evidence of irreversible damage are detected by the monitoring, the report shall provide an analysis of the problem and a planned course of action to correct it.

- Summarized and tabulated results of all radiological environmental samples taken during the report period, in the format of Radiological Assessment Branch Technical Position, Revision 1, November, 1979.

NOTE: If some results are not available for inclusion, the report shall note and explain the reason for the missing results. The missing results shall be submitted as soon as possible in a supplementary report.

- A summary description of the Radiological Environmental Monitoring Program.
- A map of all sampling locations keyed to a table giving distances and directions from the reactor.
- Land-use census results.
- Interlaboratory Comparison Program results.
- A discussion of airborne sample station availability.
- Results of any unplanned release or spill of radioactive material that could have the potential to contaminate the groundwater as reported to maintain compliance with the groundwater protection initiative (NEI 07-07).

## **Additional Information**

On February 5, 2013, Duke Energy announced that a decision has been made to permanently retire Crystal River Unit 3. The decision was made due to the high cost of repair and risk associated with repairing the containment building's delaminated concrete wall. The company is working to develop a comprehensive decommissioning plan and intends to place the facility in SAFSTOR for the immediate future and eventual dismantling. The plant staff (called decommissioning transition organization) is working to shutdown and abandon as many systems as possible, by removing energy sources, lubrications, greases, electrical, and system fluids to prepare the unit for SAFSTOR and eventual dismantlement.

## I. SUMMARY DESCRIPTION OF THE RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

The analytical results of the Crystal River Unit 3 (CR-3) operational Radiological Environmental Monitoring Program (REMP) for 2014 are contained in this report. The operational program began on January 1, 1977 just prior to initial criticality, which was achieved on January 14, 1977.

Sampling of the facility environs is performed by the State of Florida Department of Health, Bureau of Radiation Control. The State also performs the required analyses, participates in the Interlaboratory Comparison Program, and performs the annual land-use census. Prior to 1990, the program was split between the Department of Health and the University of Florida. The transition to the State performing all of the program's sampling and analyses in 1990 is evident in several of the trend graphs, most notably oysters and carnivorous fish, and is due to the State using less sensitive measurement techniques for several of the pathways which were formerly evaluated by the University of Florida.

Sample station locations are given in Table I-1 and Figures I-2, I-3, I-4, and I-5. Sample frequency and analysis type may be determined from Table I-2. Figure I-1 illustrates the relevant exposure pathways. Regarding waterborne pathways, the groundwater area of the Crystal River site is too saline to be used as a source of drinking water, hence there is no credible drinking water uptake pathway. Additionally, the Florida aquifer groundwater flows in a west-southwest direction across the site toward the Gulf of Mexico and since the locale of the site is along the coast, there is no downstream public impact regarding groundwater.

Except for air sample gross beta results and direct radiation measurements, most of the analytical results are below the lower limit of detection (LLD) of the sample. Sample LLDs are generally much lower than the required "a priori" LLD. When measurable results are reported, the values are also usually less than the required "a priori" LLD.

In 2011 there were positively measured results of iodine and cesium airborne concentrations during the period of March 22 through April 12<sup>th</sup> for almost all sampling stations including the control station. These measurements are a direct result of the earthquake and tsunami event at the Dai-ichi, Fukushima nuclear plants following the March 11, 2011 Tohoku event in Japan. These measurements are not related to Crystal River Unit 3 activities. The Japanese event also affected broad leaf vegetation sample media throughout the year as long-lived radionuclides (Cs-137) were released at Fukushima multiple times. The vegetation measurements in 2014 are still affected by the Fukushima event due to the long-lived radionuclides deposited. The vegetation control sample station located in Orlando, FL. is also experiencing similar Cs-137 deposition on the broad leaf sample media.

The results of the 2014 REMP have been compared to previous years' results. This comparison, in part illustrated by the trend graphs of Section IV, shows no evidence of consistent long-term increasing trends in any of the sample media. However, radioactive material is routinely quantified in sediment samples which are taken in the discharge canal near the liquid release discharge point. In general, these results verify the effectiveness of in-plant measures for controlling radioactive releases.

Trend graphs illustrate the mean measured concentration of a particular radionuclide for the year. When measurable results are not obtained, the highest sample LLD is plotted. LLD and measured values are plotted on the same line to best illustrate any trend. As shown on each graph's legend, any measured value is noted by a text box, unless all values trended are measured values for that particular parameter.

Statistical summary pages are provided for each medium or pathway. Measured values are reported in terms of a mean and range. In addition, the number of measured values versus samples obtained is reported. For example, in the following entry;

15 (249/256)  
(4 - 35)

the "All Indicator Locations" column would be interpreted as indicating a mean measured value of 15, with measured values ranging from 4 to 35. (249/256) means that out of 256 samples, 249 were measured values.

TABLE I-1

## DUKE ENERGY FLORIDA, INC. - CR3 - 2014

SAMPLE STATION LOCATIONS

SAMPLE MEDIA	STATION ID	DIRECTION	APPROX. DISTANCE (Miles)
TLD – on-site	C60	N	0.88
	C61	NNE	0.92
	C62	NE	1.17
	C63	ENE	0.87
	C64	E	0.80
	C65	ESE	0.33
	C66	SE	0.36
	C67	SSE	0.33
	C68	S	0.27
	C69	SSW	0.31
	C41	SW	0.43
	C70	WSW	0.74
	C71	WNW	0.58
	C72	NW	0.30
	C73	NNW	0.74
	C27	W	0.41
	TLD – off-site	C18	N
C03		NNE	4.89
C04		NE	5.95
C74		ENE	5.13
C75		E	3.99
C76		ESE	5.61
C08		SE	5.66
C77		SSE	3.39
C09		S	3.23
C78		WSW	4.59
C14G		W	2.53
C01		NW	4.8
C79		NNW	4.97
C47-Control		ESE	78
C07*		ESE	7.67
C40*		E	3.48
C46*		N	0.37

\*TLDs not required by ODCM. Deployed at air sample locations.

**TABLE I-1 (CONT'D)**  
**DUKE ENERGY FLORIDA, INC. - CR3 - 2014**

**SAMPLE STATION LOCATIONS**

SAMPLE MEDIA	STATION ID	DIRECTION	DISTANCE (Miles)
AIR	C07	ESE	7.7
	C18	N	5.3
	C40	E	3.5
	C41	SW	0.4
	C46	N	0.4
	C47-Control	ESE	78
SEAWATER	C14H	NW	0.1
	C14G	W	2.5
	C13-Control	WSW	4.6
GROUND WATER	C40-Control	E	3.6
SITE GROUND WATER	CR3-2	E	0.1
	CR3-4	SSE	0.086
	CR3-5	SSW	0.051
	CR3-6S	W	0.038
	CR3-6D	W	0.038
	CR3-7	WNW	0.060
	CR3-8	WNW	0.073
	CR3-9	NW	0.1
	CR3-10	NNE	0.1
	DRINKING WATER	C07-Control	ESE
C10-Control		ESE	6.0
C18-Control		N	5.3
SHORELINE SEDIMENT	C09-Control	S	3.2
	C14H	NW	0.1
	C14M	W	1.2
	C14G	W	2.5
FISH & OYSTERS	C29	W	2.5
	C30-Control	WSW	3.4
BROAD LEAF VEGETATION	C48A	N	0.4
	C48B	ENE	0.9
	C47-Control	ESE	78
WATERMELON	C04	NE	6.0
CITRUS	C19	ENE	9.6



**TABLE I-2**  
**DUKE ENERGY FLORIDA, INC. - CR3 - 2014**  
**SAMPLING AND ANALYSIS PROGRAM**

SAMPLE MEDIA	# OF STATIONS	FREQUENCY	ANALYSIS	LLD <sup>1</sup>	
TLD	33*	Quarterly	γ Dose	---	
Air Iodine	6	Weekly	I-131	0.07 <sup>9</sup> pCi/m <sup>3</sup>	
Air Particulate	6	Weekly	Gross β	0.01	
		Quarterly	γ Spec :	Cs-134	0.05 <sup>e</sup>
			Cs-137	0.06 <sup>e</sup>	
Seawater	3	Monthly	Tritium	2000 <sup>b</sup> pCi/L	
		Monthly	γ Spec :	Mn-54	15
				Fe-59	30
				Co-58	15
				Co-60	15
				Zn-65	30
				Zr-Nb-95	15 <sup>c</sup>
				I-131	1 <sup>f</sup>
				Cs-134	15
				Cs-137	18
				Ba-La-140	15 <sup>c</sup>
Ground Water	1	Semiannual	Tritium	2000 <sup>b</sup> pCi/L	
		Semiannual	γ Spec :	<sup>2</sup>	<sup>2</sup>
Site Ground Water <sup>6</sup>	9	Quarterly	Tritium	2000 <sup>b</sup> pCi/L	
		Quarterly	γ Spec :	<sup>2</sup>	<sup>2</sup>
Drinking Water	3	Quarterly	Tritium	2000 <sup>b</sup> pCi/L	
		Quarterly	γ Spec :	<sup>2</sup>	<sup>2</sup>
Shoreline Sediment	4	Semiannual	γ Spec :	Cs-134	150 pCi/kg
				Cs-137	180

\*Includes 3 stations which are not required by the ODCM

<sup>1</sup>The maximum "a priori" LLD

<sup>2</sup>Same as Seawater γ Spec

<sup>6</sup>Additional 2 stations reported that are not required by the ODCM

<sup>b</sup>LLD for drinking water. If no drinking water pathway exists, a value of 3000 pCi/L may be used

<sup>c</sup>The specified LLD is for an equilibrium mixture of parent and daughter nuclides which contain 15 pCi/L of the parent nuclide

<sup>e</sup>LLDs apply only to quarterly composite gamma spectral analysis, not to analyses of single particulate filters

<sup>f</sup>LLD for drinking water. If no drinking water pathway exists, the LLD of the gamma isotopic analysis may be used

<sup>9</sup>LLD for I-131 applies to a single weekly filter

**TABLE I-2 (Cont'd)**  
**DUKE ENERGY FLORIDA, INC. - CR3 - 2014**  
**SAMPLING AND ANALYSIS PROGRAM**

SAMPLE MEDIA	# OF STATIONS	FREQUENCY	ANALYSIS	LLD <sup>1</sup>	
Carnivorous Fish and Oysters	2	Quarterly	γ Spec :	Mn-54	130 pCi/kg
				Fe-59	260
				Co-58	130
				Co-60	130
				Zn-65	260
				Cs-134	130
				Cs-137	150
Broad Leaf Vegetation	3	Monthly <sup>3</sup>	γ Spec :	I-131	60 pCi/kg
				Cs-134	60
				Cs-137	80
Watermelon	1	Annual <sup>4</sup>	γ Spec :	<sup>5</sup>	5
Citrus	1	Annual <sup>4</sup>	γ Spec :	<sup>5</sup>	5

<sup>1</sup>The maximum "a priori" LLD  
<sup>3</sup>When available  
<sup>4</sup>During harvest  
<sup>5</sup>Same as broad leaf vegetation

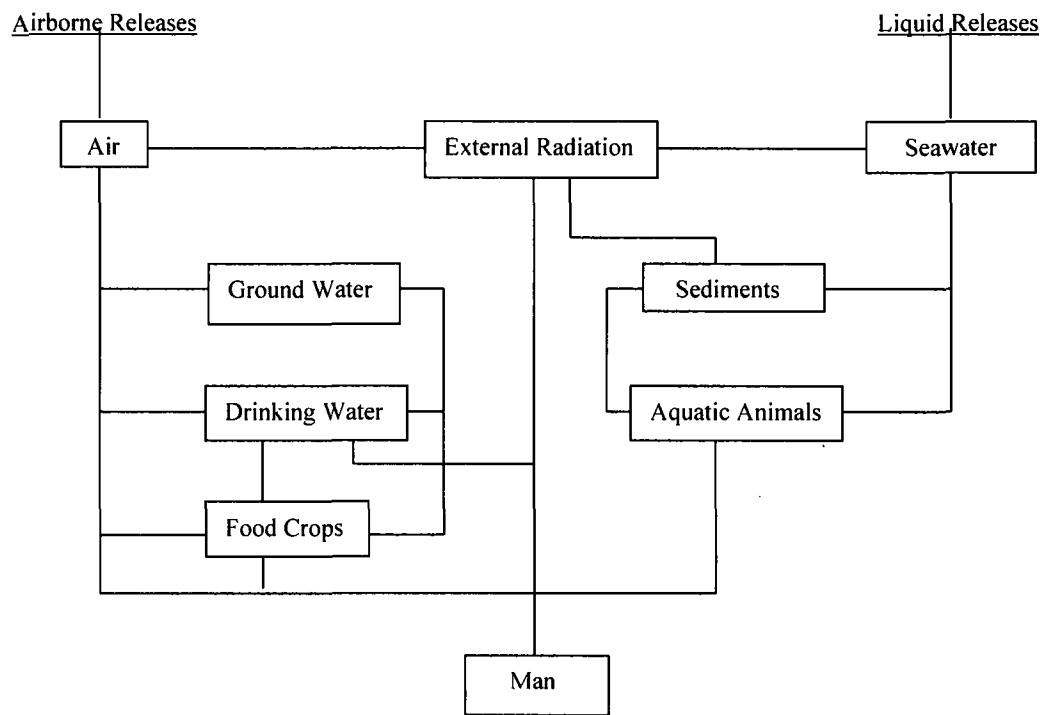


FIGURE I-1: Environmental Media and Exposure Pathways

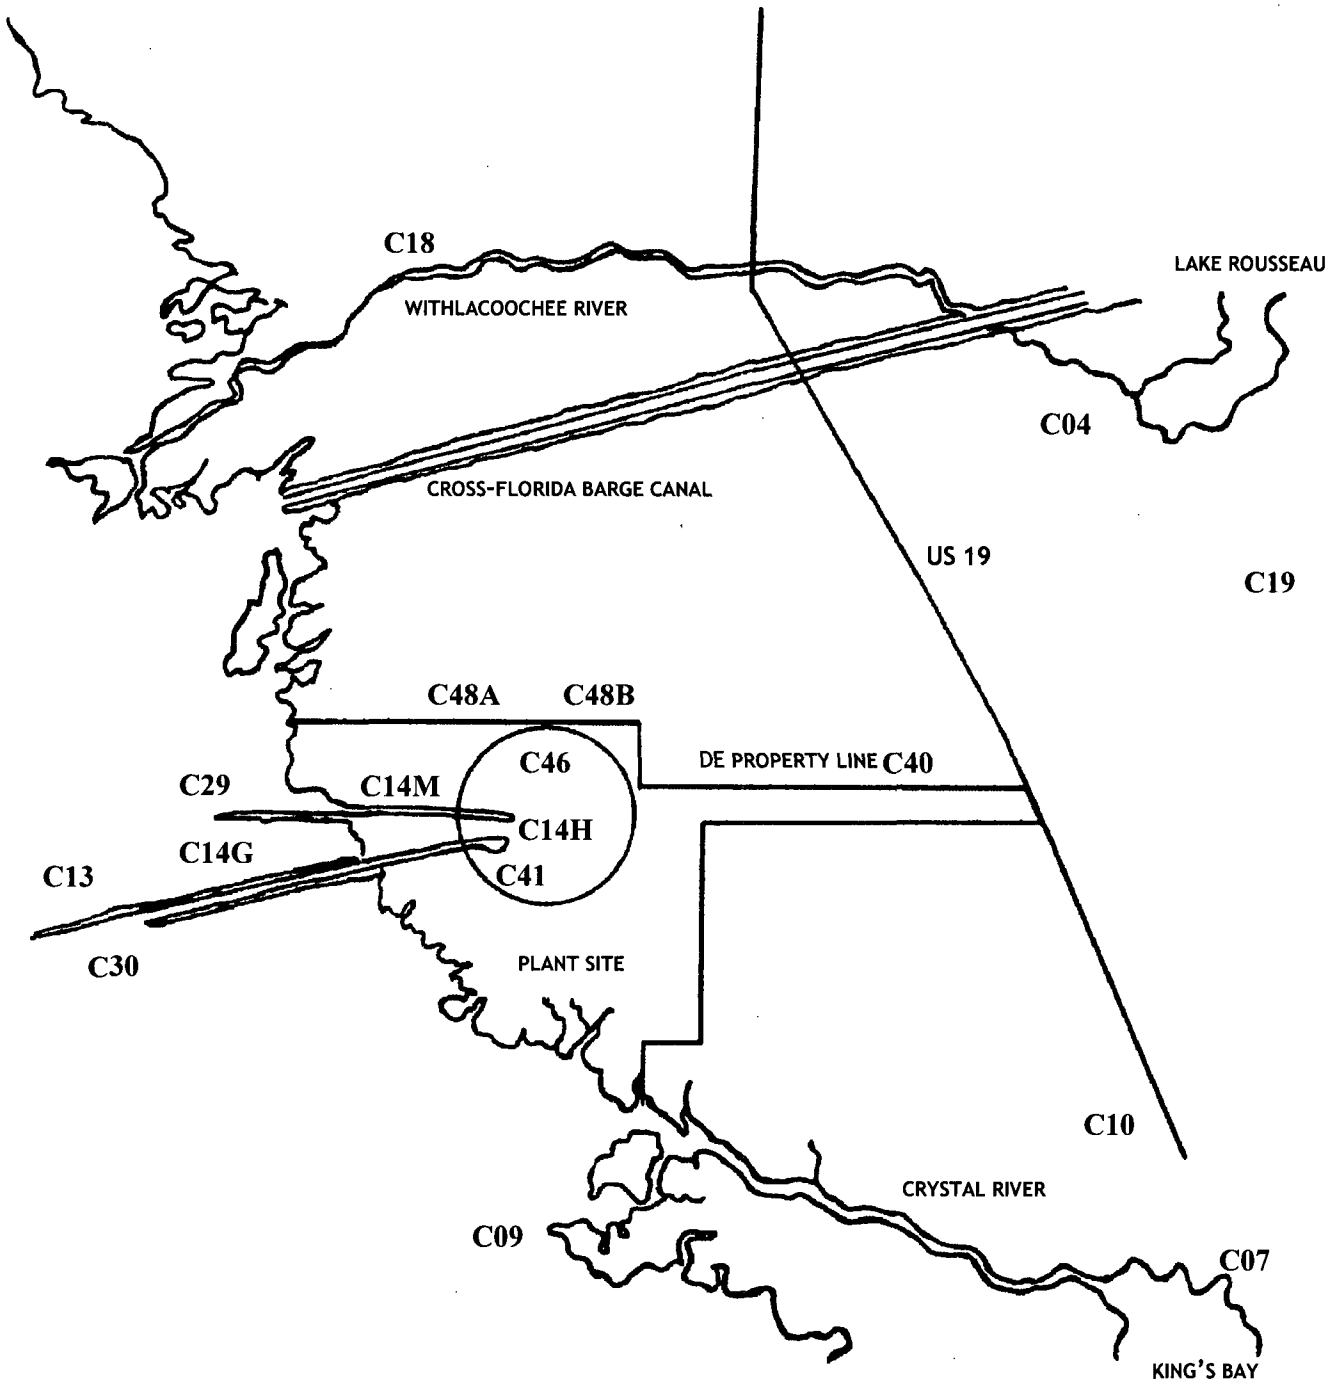
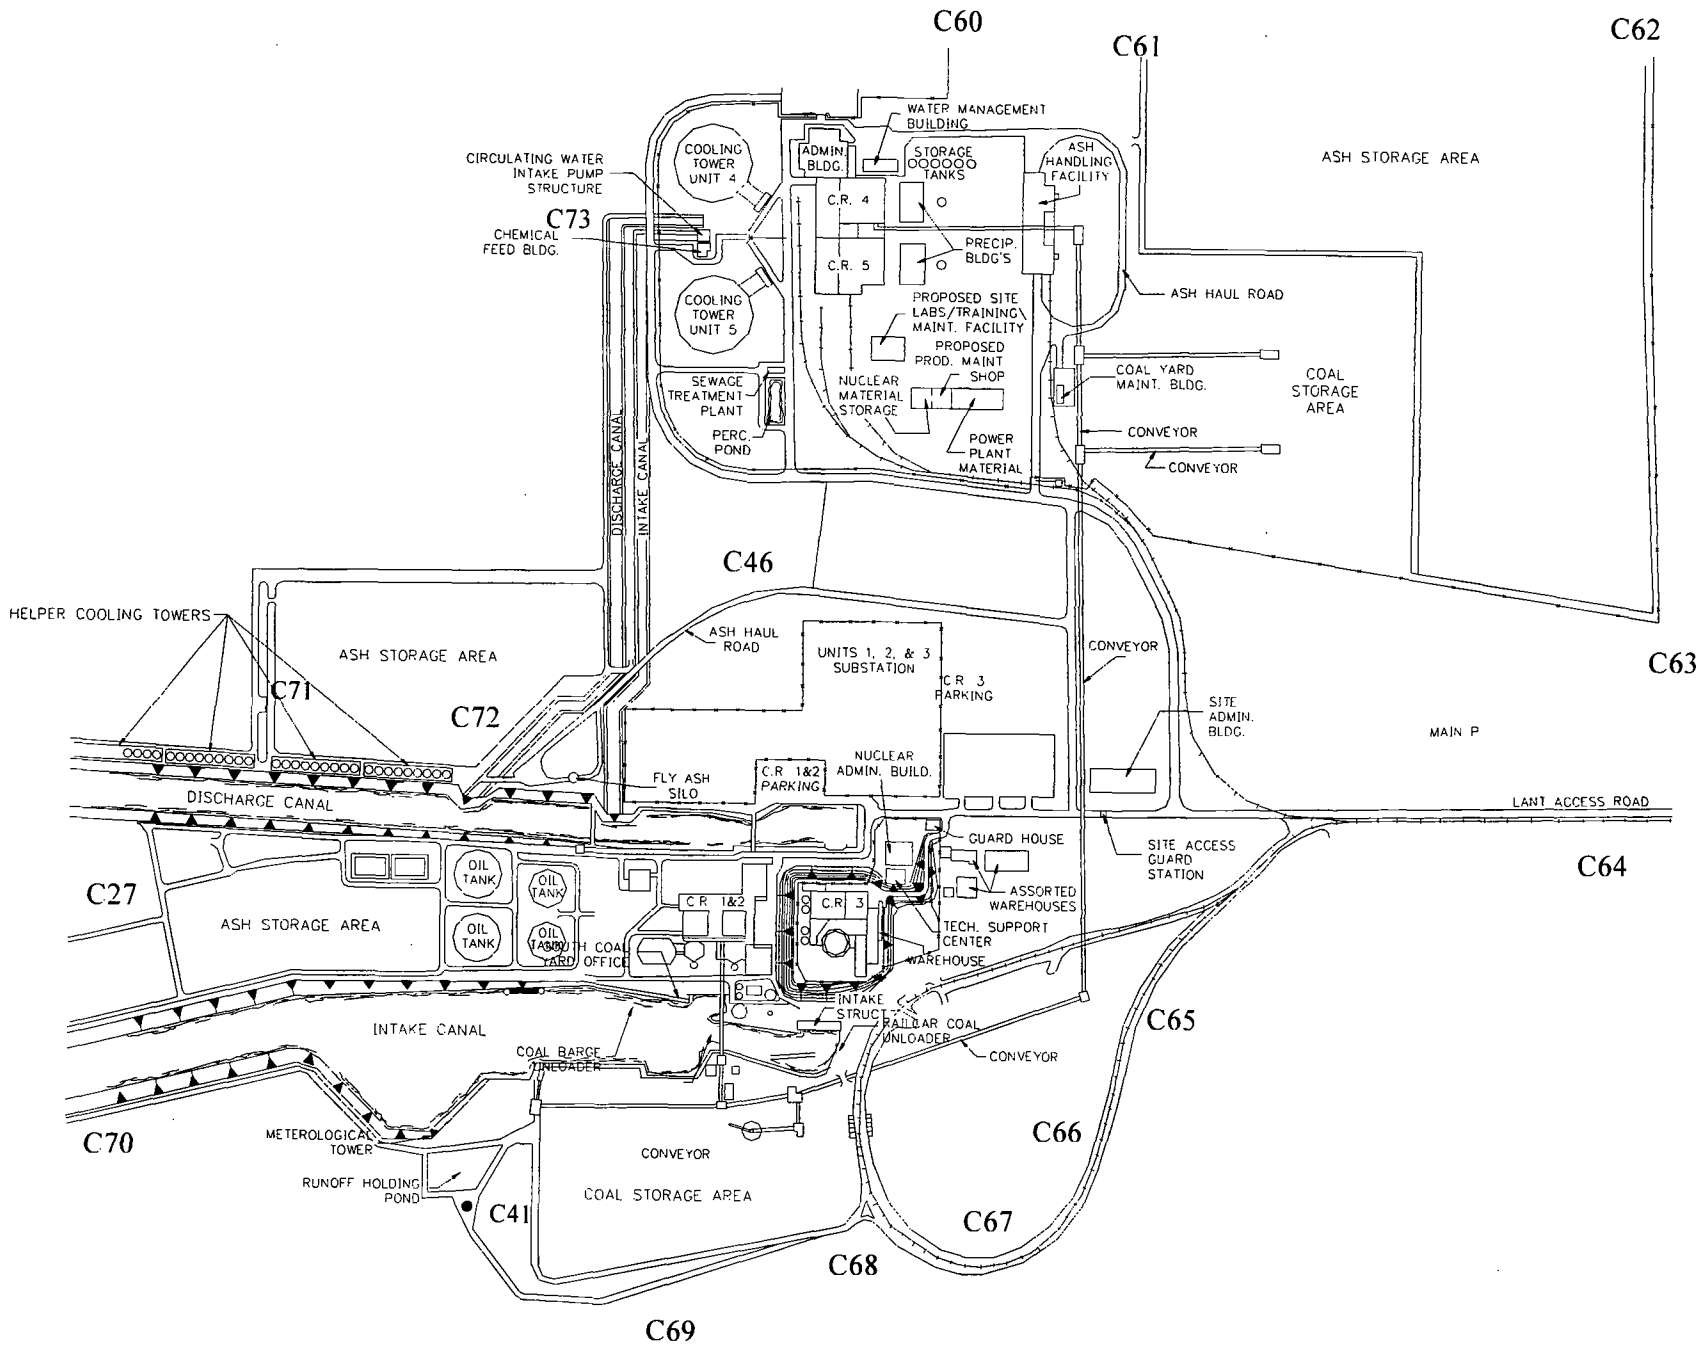


FIGURE I-2: Environmental Monitoring Sample Stations (non-TLDs)

FIGURE I-3: Environmental Monitoring TLD Locations (on site)

8




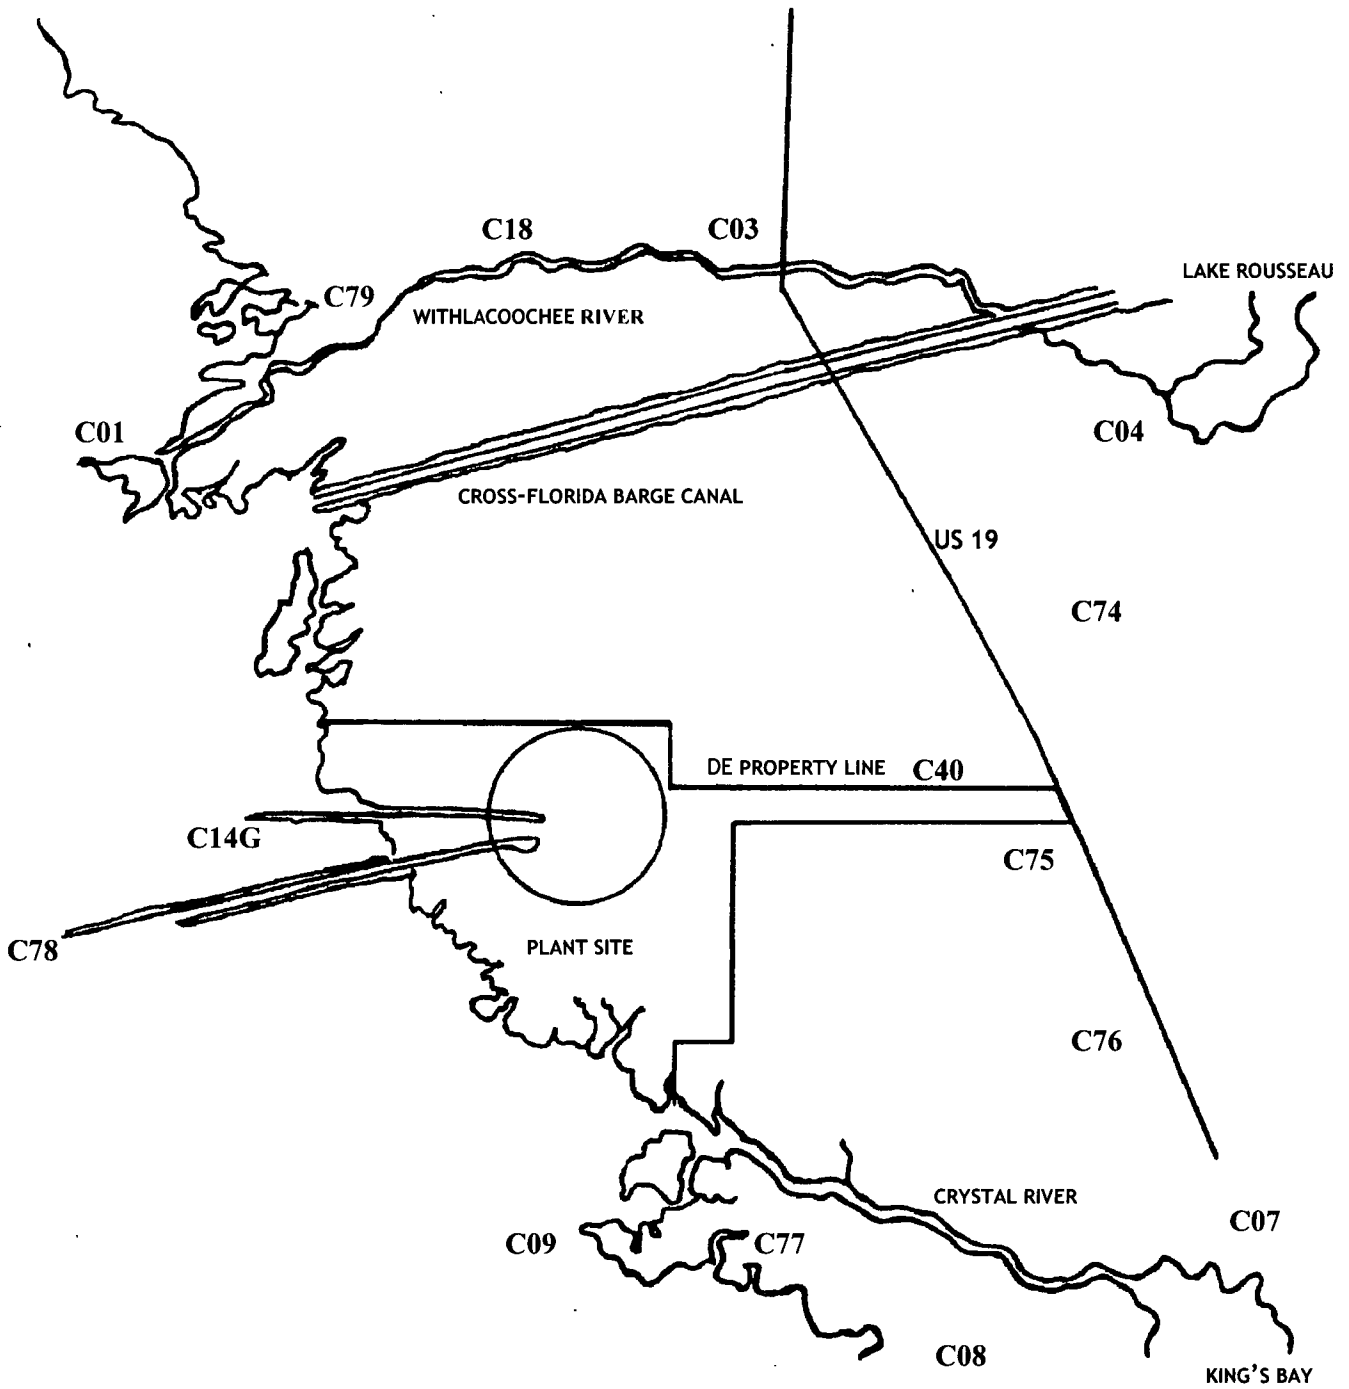


FIGURE I-4: Environmental Monitoring TLD Locations (off site)

Figure I-5: CR3 Groundwater Monitoring Well Locations  
Deep Wells Are Also Installed at #'s 1, 3, 6

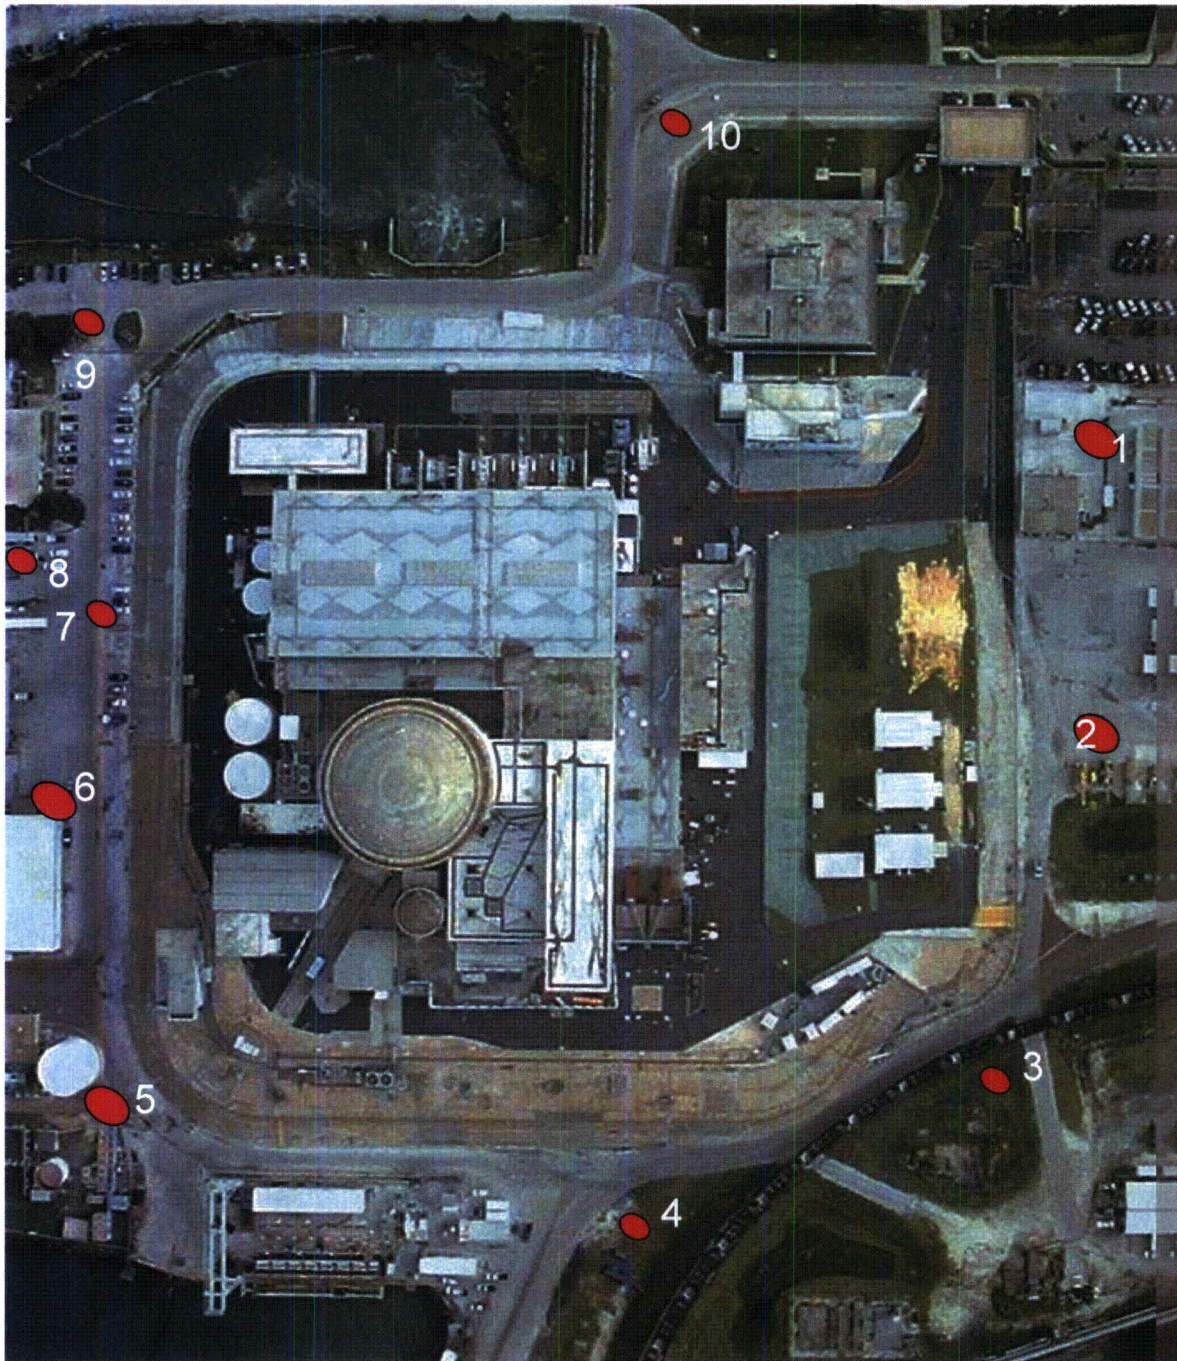

**II. LAND-USE CENSUS**

A 2014 land-use census was conducted during June through August. The purpose of this census is to identify the nearest residences, vegetable gardens, and potential milk-producing animals within a five mile radius of the nuclear plant. The distance in miles and bearing in degrees for each receptor type in each of the sixteen sectors is summarized below.

SECTOR	NEAREST RESIDENCE	NEAREST GARDEN (A)	NEAREST MILK ANIMAL
N	4.5 @ 2°	*	*
NNE	4.6 @ 15°	*	*
NE	3.8 @ 54°	5.0 @15°	*
ENE	3.4 @ 60°	*	*
E	2.4 @ 92°	*	*
ESE	4.2 @ 102°	*	*
SE	4.9 @ 133°	*	*
SSE	3.5 @ 149°	*	*
S	*	*	*
SSW	*	*	*
SW	*	*	*
WSW	*	*	*
W	*	*	*
WNW	*	*	*
NW	4.8 @ 321°	*	*
NNW	4.6 @ 339°	*	*

(A) - Only gardens with an estimated total area of 500 square feet, or more, and producing green leafy vegetables are considered.

\* No suitable sites were located within 5 miles.



### III. FLORIDA DEPARTMENT OF HEALTH - INTERLABORATORY COMPARISON PROGRAM DATA

The EPA crosscheck program ceased operation at the end of 1998. To meet the requirements for a crosscheck program, the Florida Department of Health participates in the Department of Energy's Mixed-Analyte Performance Evaluation Program (MAPEP). The following units are used for each of the four media:

Air Filters: Bq/sample  
 Soil: Bq/Kg  
 Vegetation: Bq/sample  
 Water: Bq/L

Analytical performance is based on historical analytical capabilities for individual analyte/matrix pairs. Acceptable performance is designated by an "A". Acceptable with warning is designated by a "W". Performance which is not acceptable is designated by an "N".

#### Results for February 2014:

Media	Nuclide	Result	% Bias	Acceptance Range	Flag
Air	Cs-134	1.89	-0.7	1.34 – 2.48	A
Air	Cs-137	1.93	9.7	1.23 – 2.29	A
Air	Co-60	1.38	-0.9	0.97 – 1.81	A
Air	Am-241	3.6	15.0	2.19 – 4.07	A
Soil	Co-57	1014.51	5.0	676 – 1256	A
Soil	Mn-54	1516.81	6.1	1001 – 1859	A
Soil	Zn-65	774.16	11.4	487 – 904	A
Soil	Cs-137	1301.3	5.1	867 – 1609	A
Vegetation	Co-57	9.39	-7.1	7.10 – 13.10	A
Vegetation	Co-60	6.04	-12.9	4.85 – 9.01	A
Vegetation	Cs-137	4.23	-10.8	3.32 – 6.16	A
Vegetation	Cs-134	4.83	-20.1	4.23 – 7.84	W
Vegetation	Zn-65	7.16	-9.0	5.50 – 10.22	A
Water	H-3	346	7.8	225 – 417	A
Water	Mn-54	15.53	13.9	9.7 – 18.1	A
Water	Cs-137	32.22	11.5	20.2 – 37.6	A
Water	Co-57	28.94	5.2	19.3 – 35.8	A
Water	Co-60	17.24	7.8	11.2 – 20.8	A
Water	Cs-134	25.31	9.6	16.2 – 30.0	A

Note: Warning flag on vegetation media comparison due to the MAPEP soil geometry is different than the Florida Department of Health (FDOH) vegetation sample container utilized at the Florida nuclear power plants. The MAPEP soil container is smaller than the FDOH vegetation sample container.

FLORIDA DEPARTMENT OF HEALTH - INTERLABORATORY COMPARISON PROGRAM DATA, cont'd

Results for August 2014:

Media	Nuclide	Result	% Bias	Acceptance Range	Flag
Air	Cs-134	0.930	-3.1	0.67 – 1.25	A
Air	Cs-137	1.274	6.2	0.84 – 1.56	A
Air	Mn-54	0.852	13.6	0.53 – 0.98	A
Air	Co-57	1.41	-1.4	1.00 – 1.86	A
Air	Co-60	1.143	3.9	0.77 – 1.43	A
Air	Zn-65	0.86	13.2	0.53 – 0.99	A
Soil	Mn-54	1010	0.1	706 – 1312	A
Soil	Co-60	736.67	-5.4	545 – 1013	A
Soil	Co-57	1120.0	0.4	781 – 1415	A
Soil	Zn-65	559.33	3.4	379 – 703	A
Soil	Cs-134	628.59	1.1	435 – 809	A
Vegetation	Co-57	9.54	3.7	6.4 – 12.0	A
Vegetation	Mn-54	7.923	11.6	4.97 – 9.23	A
Vegetation	Zn-65	7.01	9.1	4.49 – 8.35	A
Vegetation	Cs-134	8.988	21.8	5.17 – 9.59	W
Vegetation	Cs-137	9.423	15.8	5.70 – 10.58	A
Vegetation	Co-60	6.283	2.8	4.28 – 7.94	A
Water	Co-60	13.20	6.5	8.7 – 16.1	A
Water	Mn-54	15.273	9.1	9.8 – 18.2	A
Water	Cs-137	19.99	8.6	12.9 – 23.9	A
Water	Zn-65	12.58	15.4	7.6 – 14.2	A
Water	H-3	226.12	8.7	146 – 270	A

Note: Warning flag on vegetation media comparison due to the MAPEP soil geometry is different than the Florida Department of Health (FDOH) vegetation sample container utilized at the Florida nuclear power plants. The MAPEP soil container is smaller than the FDOH vegetation sample container.

#### IV-A. AIRBORNE PATHWAY

Air samples are taken at five locations in the vicinity of the plant. The control location (station C-47) is 78 miles ESE of the plant, at the Department of Health, State Bureau of Radiation Control in Orlando.

Table IV-A.1 provides a statistical summary of the analytical results for 311 gross beta samples and 311 iodine samples.

Tables IV-A.2 and IV-A.3 provide the results for each weekly air sample.

In 2014, three hundred eleven particulate samples were analyzed for gross beta activity, all of which had measurable activity. The average indicator concentration was 18 pCi/1000 m<sup>3</sup> with a range of 3 to 38 pCi/1000 m<sup>3</sup>. The average indicator concentration since 1996 was in the range of 14 to 20 pCi/1000 m<sup>3</sup>. The control location concentration for 2014 averaged 16 pCi/1000 m<sup>3</sup>, with a range of 7 to 30 pCi/1000 m<sup>3</sup>.

In 2014, three hundred eleven samples were analyzed for iodine activity, with none having measurable activity. The highest iodine LLD was 0.04 pCi/m<sup>3</sup>. There were no anomalies with the iodine samples for the year. Note that given the long shut down time since CR3 has operated (>5 years) there is no longer an iodine source term due to radioactive decay.

Quarterly composite data are summarized in Table IV-A.4. In 2014, measurable quantities of cesium were not identified in any particulate filter sample. The highest cesium LLD was 1.6 pCi/1000 m<sup>3</sup> for cesium 137.

The 2014 airborne sample data is comparable with previous year's sample data with exception of samples collected in 2011 during the March and April time frame where airborne particulate and iodine samples were affected by the Fukushima earthquake and tsunami event that occurred on March 11, 2011. Those sample data were thoroughly discussed in the 2011 Annual Radiological Environmental Operating Report submitted for Crystal River Unit 3.

There was one instance of a non-collected airborne sample (particulate & charcoal) at station C41 for the year 2014, due to a vacuum hose quick-connect coupler that was not fully mated, which resulted in little or no sample being collected for the week ending 6/23/2014. Additionally, there was one other instance of air sampler partial run times as follows:

1. In June, station C07 was down for 131.3 hours due to a failed air sample pump.

The remaining 4 sample stations were in service 100% of the time, with exception of filter changes and air pump/gas meter replacements. The yearly percentages of down times for the 2 stations are as follows:

C41	1.92%
C07	1.50%

The air sample station's down times are documented in the plant Corrective Action Program (CAP) under Condition Reports (CRs) 697914 and 697027.

TABLE IV-A.1

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

CRYSTAL RIVER UNIT 3

DOCKET NO. 50-302

CITRUS COUNTY, FLORIDA

JANUARY 1 TO DECEMBER 31, 2014

MEDIUM OR PATHWAY SAMPLED (UNITS)	ANALYSIS AND TOTAL NUMBER OF ANALYSES PERFORMED	LOWER LIMIT OF DETECTION (LLD) <sup>1</sup>	ALL INDICATOR LOCATIONS		LOCATION WITH HIGHEST MEAN		CONTROL LOCATION		NUMBER OF NONROUTINE REPORTED MEASUREMENTS
			MEAN RANGE	NAME	MEAN RANGE	MEAN RANGE	DISTANCE & BEARING		
AIRBORNE IODINE (pCi/m <sup>3</sup> )	γ Spec 311 I-131	0.04	<LLD	--	<LLD	<LLD		0	
AIRBORNE PARTICULATES (pCi/1000m <sup>3</sup> for Gross β, pCi/1000m <sup>3</sup> for γ Spec)	Gross β 311 γ Spec 24 Cs-134 Cs-137	4.0 1.5 1.6	18 (259/259) (3-38) <LLD <LLD	C40 3.6 @ 90° -- --	22 (52/52) (4-86) -- --	16 (52/52) (7-30) <LLD <LLD		0 0 0	

<sup>1</sup>The "a priori" LLD which meets or exceeds the requirements of Table 2-9 of the CR-3 ODCM.

**TABLE IV-A.2**  
**DUKE ENERGY FLORIDA, INC. - CR3 - 2014**  
**pCi/m<sup>3</sup> IODINE - 131 IN AIR**

<u>Collection Date</u>	<u>SAMPLE SITE</u>					
	<u>C07</u>	<u>C18</u>	<u>C40</u>	<u>C41</u>	<u>C46</u>	<u>C47</u>
06-Jan-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.04
13-Jan-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
21-Jan-14	<0.02	<0.02	<0.02	<0.02	<0.02	<0.02
27-Jan-14	<0.04	<0.04	<0.04	<0.04	<0.04	<0.04
03-Feb-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
11-Feb-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
18-Feb-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
24-Feb-14	<0.04	<0.04	<0.04	<0.04	<0.04	<0.04
03-Mar-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
11-Mar-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
18-Mar-14	<0.03	<0.03	<0.03	<0.04	<0.04	<0.03
24-Mar-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03

**TABLE IV-A.2 (Cont'd)**  
**DUKE ENERGY FLORIDA, INC. - CR3 - 2014**  
**pCi/m<sup>3</sup> IODINE - 131 IN AIR**

Collection Date	SAMPLE SITE					
	C07	C18	C40	C41	C46	C47
01-Apr-14	<0.04	<0.03	<0.04	<0.04	<0.04	<0.04
08-Apr-14	<0.04	<0.04	<0.04	<0.04	<0.04	<0.04
15-Apr-14	<0.02	<0.02	<0.02	<0.02	<0.02	<0.02
23-Apr-14	<0.02	<0.02	<0.02	<0.02	<0.02	<0.02
29-Apr-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
06-May-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
13-May-14	<0.03	<0.03	<0.03	<0.04	<0.04	<0.04
19-May-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
27-May-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
03-Jun-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
10-Jun-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
17-Jun-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
23-Jun-14	<0.22(A)	<0.03	<0.02	<0.02(B)	<0.02	<0.03

(A) Pump failed and was replaced. Estimated run time 8.1 out of 139.4 hours. Reference Condition Report 697027.

(B) Vacuum tubing quick connect coupler disconnected; little or no sample collected. Reference Condition Report 697914.

**TABLE IV-A.2 (Cont'd)**  
**DUKE ENERGY FLORIDA, INC. - CR3 - 2014**  
**pCi/m<sup>3</sup> IODINE - 131 IN AIR**

<u>Collection Date</u>	<u>SAMPLE SITE</u>					
	<u>C07</u>	<u>C18</u>	<u>C40</u>	<u>C41</u>	<u>C46</u>	<u>C47</u>
01-Jul-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.02
08-Jul-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
15-Jul-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
22-Jul-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
29-Jul-14	<0.04	<0.03	<0.03	<0.03	<0.03	<0.03
05-Aug-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
12-Aug-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
19-Aug-14	<0.04	<0.03	<0.03	<0.03	<0.03	<0.04
26-Aug-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
02-Sep-14	<0.04	<0.03	<0.03	<0.03	<0.03	<0.04
09-Sep-14	<0.04	<0.03	<0.03	<0.03	<0.03	<0.03
16-Sep-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
23-Sep-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03

**TABLE IV-A.2 (Cont'd)**  
**DUKE ENERGY FLORIDA, INC. - CR3 - 2014**  
**pCi/m<sup>3</sup> IODINE - 131 IN AIR**

<u>Collection Date</u>	<u>SAMPLE SITE</u>					
	<u>C07</u>	<u>C18</u>	<u>C40</u>	<u>C41</u>	<u>C46</u>	<u>C47</u>
07-Oct-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
14-Oct-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
21-Oct-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
27-Oct-14	<0.04	<0.04	<0.04	<0.04	<0.04	<0.03
03-Nov-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
10-Nov-14	<0.04	<0.04	<0.04	<0.04	<0.04	<0.04
17-Nov-14	<0.04	<0.04	<0.04	<0.04	<0.04	<0.04
24-Nov-14	<0.02	<0.02	<0.02	<0.02	<0.02	<0.02
01-Dec-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
08-Dec-14	<0.03	<0.03	<0.04	<0.03	<0.04	<0.04
16-Dec-14	<0.03	<0.03	<0.03	<0.04	<0.03	<0.03
22-Dec-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03
29-Dec-14	<0.03	<0.03	<0.03	<0.03	<0.03	<0.04



**TABLE IV-A.3**  
**DUKE ENERGY FLORIDA, INC. - CR3 - 2014**  
**pCi/1000m<sup>3</sup> GROSS B IN AIR**

Collection Date	SAMPLE SITE					
	C07	C18	C40	C41	C46	C47
06-Jan-14	18	19	20	16	14	17
13-Jan-14	13	16	23	15	12	18
21-Jan-14	13	11	14	12	9	10
27-Jan-14	20	17	19	19	23	20
03-Feb-14	11	10	12	13	10	10
11-Feb-14(A)	40	30	107	32	32	39
18-Feb-14	17	18	21	16	19	18
24-Feb-14	17	11	15	16	10	12
03-Mar-14	15	18	18	14	16	17
11-Mar-14	16	19	34	14	14	14
18-Mar-14	12	16	12	14	13	14
24-Mar-14	14	19	17	16	20	19
Average:	17	17	26	16	16	17

(A) Sample results are elevated for this week due to samples being counted without the normal 3 day decay time as samples ran an extra day and were counted the following day. This sample set is considered an outlier and are not included in the average values calculated.

**TABLE IV-A.3 (Cont'd)**  
**DUKE ENERGY FLORIDA, INC. - CR3 - 2014**  
**pCi/1000m<sup>3</sup> GROSS B IN AIR**

Collection Date	SAMPLE SITE					
	C07	C18	C40	C41	C46	C47
01-Apr-14	21	17	22	18	19	18
08-Apr-14	26	25	17	26	18	25
15-Apr-14	17	20	15	16	13	17
23-Apr-14	7	7	19	8	8	8
29-Apr-14	19	17	18	17	17	16
06-May-14	10	18	16	15	17	13
13-May-14	22	23	24	21	25	12
19-May-14	13	17	11	14	13	16
27-May-14	23	21	22	17	25	20
03-Jun-14	15	12	17	15	18	14
10-Jun-14	14	16	18	10	15	14
17-Jun-14	15	15	24	16	13	16
23-Jun-14	<113(A)	11	14	<5(B)	15	14
Average	24	17	18	15	17	16

(A) Pump failed and was replaced. Estimated run time 8.1 out of 139.4 hours. Reference Condition Report 697027.

(B) Vacuum tubing quick connect coupler disconnected; little or no sample collected. Reference Condition Report 697914. These sample sets are considered outliers and are not included in the average calculated values.

**TABLE IV-A.3 (Cont'd)**  
**DUKE ENERGY FLORIDA, INC. - CR3 - 2014**  
**pCi/1000m<sup>3</sup> GROSS & IN AIR**

Collection Date	SAMPLE SITE					
	C07	C18	C40	C41	C46	C47
01-Jul-14	25	44	86	26	30	20
08-Jul-14	14	19	14	13	12	13
15-Jul-14	12	13	16	9	10	12
22-Jul-14	8	10	12	10	16	13
29-Jul-14	15	15	17	18	16	12
05-Aug-14	16	16	19	10	15	14
12-Aug-14	16	15	16	13	21	12
19-Aug-14	12	19	25	12	13	13
26-Aug-14	20	11	20	14	17	25
02-Sep-14	12	11	11	18	11	17
09-Sep-14	13	9	9	6	11	14
16-Sep-14	12	10	10	11	14	3
23-Sep-14	13	18	9	12	11	11
29-Sep-14	9	8	13	11	10	7
Average	14	16	20	13	15	13

**TABLE IV-A.3 (Cont'd)**  
**DUKE ENERGY FLORIDA, INC. - CR3 - 2014**  
**pCi/1000m<sup>3</sup> GROSS  $\beta$  IN AIR**


Collection Date	SAMPLE SITE					
	C07	C18	C40	C41	C46	C47
07-Oct-14	18	21	27	18	17	15
14-Oct-14	31	38	57	19	24	31
21-Oct-14	23	30	43	21	27	20
27-Oct-14	39	43	62	25	40	27
03-Nov-14	19	16	17	18	18	19
10-Nov-14	26	23	27	22	19	22
17-Nov-14	35	38	32	33	26	30
24-Nov-14	16	21	20	12	15	14
01-Dec-14	11	12	12	11	7	12
08-Dec-14	8	5	4	5	9	8
16-Dec-14	30	28	32	22	27	29
22-Dec-14	24	16	32	23	26	25
29-Dec-14	17	14	22	13	11	20
Average	23	23	30	19	20	21

TABLE IV-A.4

## DUKE ENERGY FLORIDA, INC. - CR3 - 2014

pCi/1000m<sup>3</sup>  $\gamma$  EMITTERS IN QUARTERLY COMPOSITES OF AIR PARTICULATES

STATION	NUCLIDE	FIRST QUARTER	SECOND QUARTER	THIRD QUARTER	FOURTH QUARTER
C07	Be-7	80	155	92	125
	K-40	<15	<15	<12	<22
	Cs-134	<1.1	<1.1	<1.2	<1.1
	Cs-137	<0.9	<0.8	<1.0	<1.2
C18	Be-7	117	141	71	112
	K-40	<15	<21	<17	<16
	Cs-134	<1.3	<1.3	<1.3	<1.0
	Cs-137	<0.9	<1.2	<1.3	<1.1
C40	Be-7	88	139	66	106
	K-40	<23	<22	<17	<16
	Cs-134	<1.3	<1.4	<1.2	<1.0
	Cs-137	<1.1	<1.4	<1.4	<0.9
C41	Be-7	111	141	82	113
	K-40	<13	<25	<10	<12
	Cs-134	<1.3	<1.5	<1.0	<0.9
	CS-137	<1.1	<1.6	<0.8	<0.8
C46	Be-7	81	148	81	121
	K-40	<16	<17	<22	<15
	Cs-134	<1.2	<1.4	<1.3	<1.0
	Cs-137	<1.1	<1.1	<1.4	<1.0
C47	Be-7	99	136	77	108
	K-40	<21	<13	<21	<13
	Cs-134	<1.4	<1.2	<1.3	<1.1
	Cs-137	<1.5	<1.1	<1.2	<0.9

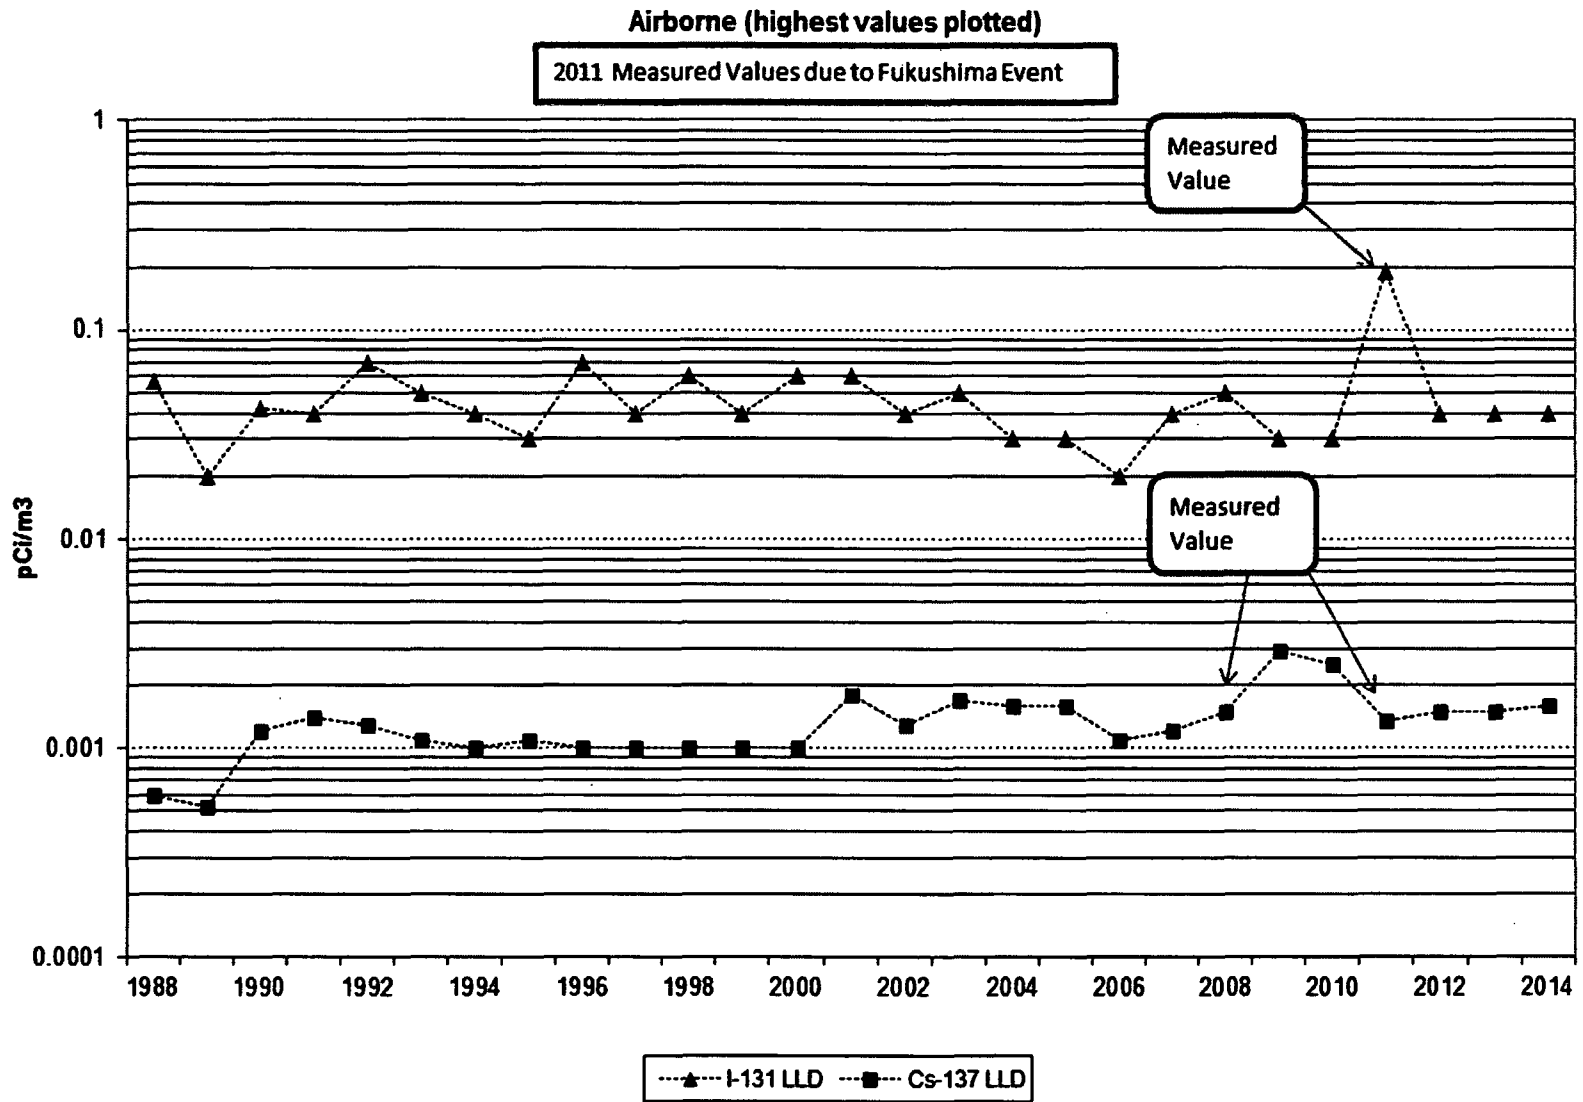

#### IV-B. DIRECT RADIATION

Direct radiation measurements (using TLDs) were taken at thirty-three locations surrounding the plant, including one control location 78 miles from the site. One-hundred and thirty-two TLDs were collected during 2014.

Table IV-B provides a statistical summary of the analytical results for 132 TLDs sampled throughout the year.

Table IV-B.1 provides the results of the individual TLD measurements.

The highest average on-site dose was 55 mrem/yr at station C71 (WNW at 3600 feet). Station C71 was relocated in 1992 due to construction of the helper cooling towers on the former site. The new location has a higher background radiation level due to being closer to the storage pond for Units 4 & 5 fly ash, which produces a higher external radiation component than normal levels of natural background. The second highest average on-site dose was 44 mrem/yr at station C61 (NNE at 4752 feet near the north fly ash storage area).

The highest average off-site dose was 38 mrem/yr at station C40 (east at 3.5 miles). The control station (C47) average dose was 34 mrem/yr. The average for all stations (except control) was 35 mrem/yr for 2014, 37 mrem/yr for 2013, and 41 mrem/yr for 2012. Direct radiation results are similar to previous years and show no change of significance. There is, however, a slight decreasing trend of average dose for all stations (except control) as seen by the trend chart at the end of this section of the report. An item of note that may be associated with this condition is the fact that the Florida Department of Health (which deploys, collects, and reads TLDs for the Crystal River Site) has recently (in 2012) changed their method of calibrating TLD Element Correction Factors (ECFs). The decreasing trend results have been evaluated by the DOH and the TLD reader vendor. The DOH's calibration methods have been found to be technically sound and quality control checks performed on the TLD reader system are well within the established limits. TLD results will continue to be trended and evaluated as more data becomes available. Testing is on-going to help ascertain the exact cause of the decreasing trend. Additionally a plan is in place to change out all of the CR3 TLDs with new TLDs in 2015 as it is felt that the decreasing trend readings may be a function of age-related conditions of the TLDs. Most all of the environmental TLDs deployed at the Crystal River site are approximately 20 years old.

This TLD trend has been documented in CR-3's corrective action program under condition report 684849.

There were no missing or unanalyzed TLDs during this evaluation period.

TABLE IV-B

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

CRYSTAL RIVER UNIT 3

DOCKET NO. 50-302

CITRUS COUNTY, FLORIDA

JANUARY 1 TO DECEMBER 31, 2014

MEDIUM OR PATHWAY SAMPLED (UNITS)	ANALYSIS AND TOTAL NUMBER OF ANALYSES PERFORMED	LOWER LIMIT OF DETECTION (LLD)	<u>ALL INDICATOR LOCATIONS</u> MEAN RANGE	<u>LOCATION WITH HIGHEST MEAN</u> NAME DISTANCE & BEARING	MEAN RANGE	CONTROL LOCATION MEAN RANGE	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
DIRECT RADIATION (mrem/yr)	γ DOSE, 132	15	35 (128/128) (25 - 68)	C71 0.6 @ 296°	55 (4/4) (52 - 59)	34 (4/4) (31 - 37)	0



TABLE IV-B.1


DUKE ENERGY FLORIDA, INC. - CR-3 - 2014

mrem/yr  $\gamma$  Dose

TLD STATION	Quarter	1	2	3	4
CO1		27	29	28	25
CO3		27	32	30	26
CO4		27	28	29	25
CO7*		26	27	28	47
CO8		26	30	28	35
C09		27	27	28	26
C14G		34	35	34	33
C18		30	32	32	28
C27		41	39	42	37
C40*		38	39	40	33
C41		35	37	38	32
C46*		34	36	37	31
C47 (CONTROL)		34	37	35	31
C60		33	39	37	30
C61		36	38	68	32
C62		41	40	41	36
C63		35	41	37	35
C64		34	35	34	29
C65		40	42	43	39
C66		36	39	38	35
C67		38	38	38	37
C68		36	38	37	35
C69		39	39	39	37
C70		37	42	41	36
C71		54	53	59	52
C72		40	39	42	50
C73		36	35	35	33
C74		25	30	27	25
C75		33	35	35	32
C76		30	32	32	29
C77		30	32	31	31
C78		28	29	27	27
C79		30	33	30	30

\*TLDs not required by the ODCM.

### Direct Radiation

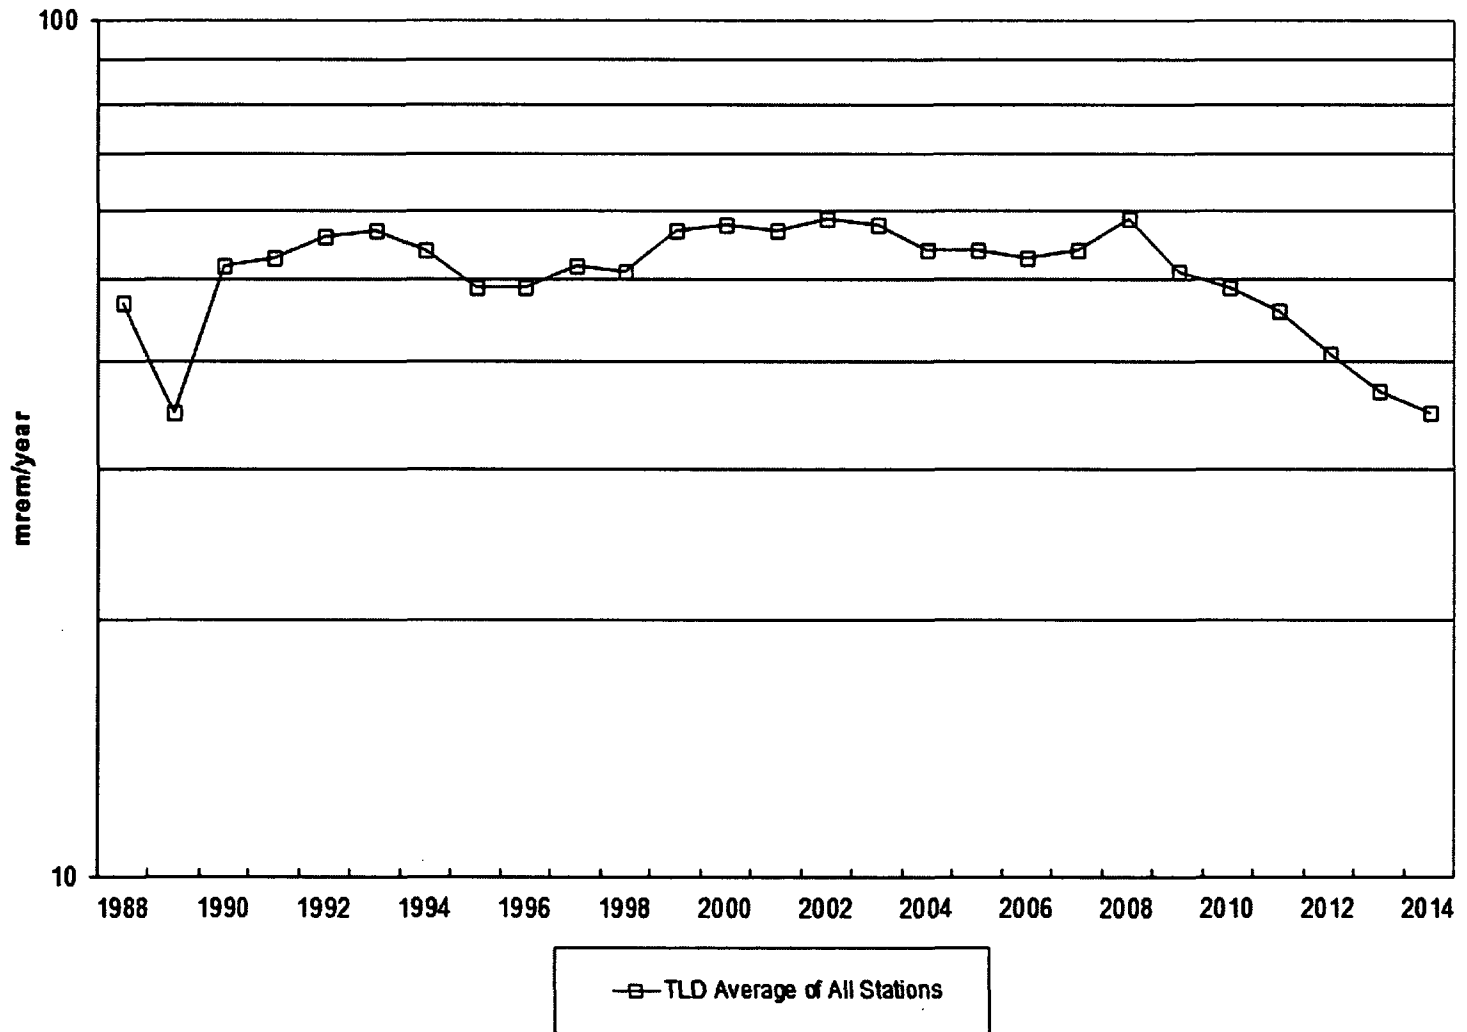

#### IV-C. WATERBORNE PATHWAY

To evaluate the waterborne pathway, samples are taken of seawater, ground water, drinking water, and shoreline sediment.

1. Monthly seawater grab samples are taken at two locations in the discharge canal (C14G and C14H) and at one control location (C13) near the mouth of the intake canal.  
In 2014, of twenty-four indicator samples, six had measurable tritium at an average concentration of 107 pCi/L, with a range of 84 to 139 pCi/L. These values were statistically positive measurements but are below the measured LLD for this sample media and are of no dose consequence. The sample with the highest concentration of tritium was obtained in January at station C14H near the beginning of the discharge canal. The seawater tritium activity is consistent with the concentration of tritium in the liquid waste stream and the release times of waste tanks. CR-3 was in the Decommissioning Transition Organization preparing the station for SAFSTOR configuration at the time of sampling with reduced dilution due to no circulating water pumps running. Plant raw water pumps were providing the dilution flow. In 2014 there were no control station samples with measurable tritium concentrations.

In 2013, five of twenty four indicator samples contained measurable tritium with an average concentration of 162 pCi/L. The 2013 control station samples had no samples with measurable tritium concentrations.

Gamma spectral analysis was performed on thirty-six samples, none of which showed measurable amounts of the gamma emitters of interest.

Table IV-C.1 provides a statistical summary of the seawater tritium and gamma spectroscopy results.

Table IV-C.1.a provides the results of the monthly samples.

2. Semiannual ground water samples are taken at one location, station C40, located approximately 3.5 miles east of CR-3. Gamma spectral and tritium analyses are performed on both samples.  
In 2014, all results were less than the detection limits. Since plant startup, all results, except for the results of one 1985 tritium analysis, have been less than LLD. The required sensitivity for measuring tritium in ground water is 2000 pCi/L. Analysis of ground water in the vicinity of CR-3 is done at a sensitivity of approximately 150 pCi/L for tritium and less than 10 pCi/L for select gamma emitters.

Table IV-C.2 provides a statistical summary of the groundwater tritium and gamma spectroscopy results.

Table IV-C.2.a provides the results of the semi-annual samples.

3. Quarterly site ground water samples are taken at thirteen locations surrounding the perimeter of the CR-3 protected area. Periodically five of these ground water wells have shown indications of very low levels of tritium on the west-southwest side of the plant. It is believed that this tritium is the result of a leak in the Station Drain Tank (SDT-1) to the settling pond discharge line that occurred in 1998. This discharge line has recently been leak tested and it is leak free. There are no other known leaking plant components. In 2014 the wells that have shown measurable amounts of tritium range from 88 to 427 pCi/L. These wells have been sampled additionally on a monthly basis to develop trend data. This increased sampling information is shown as supplemental data. Other than well #5, the sporadic positively measured data collected from the wells is statistically positive, but are statistical minor fluctuations around the lower limit of detection and are of no dose consequence. Along with these wells, two other wells that are not presently part of the REMP have been sampled that are on either side (north and south) of the plant settling ponds (percolation ponds). In 2014 these two wells are showing measurable amounts of tritium in the range of 87 to 144 pCi/L, which are a result of plant discharges from the SDT-1. These discharges are being minimized through operational focus. The positively measured tritium values are below the reporting criteria of the ODCM and the NEI 07-07 Ground Water Protection Initiative Guidelines. There have been no measurable amounts of gamma emitting radionuclides in any of these wells. There have been no measurable amounts of hard-to-detect (HTD) radionuclides in any of these wells with exception of trace levels of gross alpha, which is expected, given the naturally occurring limestone strata that surrounds the Florida aquifer. It should be noted that site ground water flows in a west-southwest direction toward the Gulf of Mexico. This flow was re-verified in 2006 with a new ground water flow study performed by a certified hydro-geologist as part of the NEI Ground Water Protection Initiative. In 2012 another groundwater flow study was performed to evaluate groundwater flow post installation of CR Units 4 & 5 clean air scrubber system. This scrubber system utilizes significant groundwater from the Florida aquifer. The flow study confirmed that the groundwater

flow, and direction of flow, has not been altered due to the installation and operation of the clean air scrubber system.

Additionally, the groundwater at the CR3 site is too saline for use as a potable water source, hence there is no drinking water uptake pathway at the Crystal River site.

Table IV-C.3. provides a statistical summary of the groundwater tritium and gamma spectroscopy results.

Table IV-C.3.a.1 provides the results of the quarterly samples.

Table IV-C.3.a.2 provides the results of the monthly supplemental samples.

4. Monthly non-REMP required well samples were collected as discussed in item #3 above. Two wells were sampled. These two wells are located on the north side and the south side of the site percolation ponds. The information is discussed above. Both of these wells showed no measurable amounts of any other radionuclides of interest. The tritium concentration in these wells, discussed in item #3 above, have decreased significantly due to a focused reduction in the number of discharges from the station drain tank (SDT-1) to the site settling ponds (percolation ponds).

Table IV-C.4 provides a statistical summary of the groundwater tritium and gamma spectroscopy results.

Table IV-C.4.a. provides the results of the monthly supplemental non-REMP required samples.

5. Quarterly drinking water samples are drawn from three locations: the Crystal River City Hall (C07), the Days Inn Motel (C10), and the Yankeetown City Well (C18). All samples were collected and analyzed for gamma emitters and tritium.

In 2014, none of the samples yielded measurable activities of tritium or the required gamma emitters. The measurement sensitivity for drinking water samples are the same as those for ground water samples.

Since the beginning of sampling, the drinking water samples have not had any other positive-measured radionuclides of interest detected.

Table IV-C.5 provides a statistical summary of the drinking water tritium and gamma spectroscopy results.

Table IV-C.5.a provides the results of the quarterly samples.

6. Semiannual shoreline sediment samples are taken at three indicator locations in the discharge canal (C14H, C14M, C14G) and one control location (C09) at Fort Island Gulf Beach. The plant discharge canal is the primary liquid effluent release pathway from CR-3.

In 2014, of the six indicator samples, four had measurable amounts of cesium-137 with an average concentration of 23 pCi/kg and a range of 11 to 57 pCi/kg. There were five shoreline sediment samples with measurable amounts of cobalt-60 with a concentration range of 7 to 47 pCi/kg.

In 2013 two samples had measurable amounts of cesium-137 with an average of 8.5 pCi/kg and a range of 8 to 9 pCi/kg. There were no samples with measurable amounts of cobalt-60 in any of the shoreline sediment samples.

In 2012 three samples had measurable amounts of cesium-137 with an average of 28 pCi/kg and a range of 19 to 35 pCi/kg. Also there were three samples with measurable amounts of cobalt-60 with a concentration range of 14 to 24 pCi/kg.

In 2011 the average cesium-137 concentration at the indicator locations was 28 pCi/kg.

In 2010, the average cesium-137 concentration at the indicator locations was 19 pCi/kg.

In 2009, the average cesium-137 concentration at the indicator locations was 24 pCi/kg.

The average cobalt-60 concentration at the indicator locations ranged from 24 to 389 pCi/kg from 1998 through 2008.

#### IV-C. WATERBORNE PATHWAY Cont'd

The 2014 shoreline sediment results are similar to previous years' results with exception of there being a slight increase in the number of samples with measurable cobalt-60 in the sediment samples. The increase in the number of samples containing cobalt-60 may be related to processing all of the plant fluids as part of the decommissioning effort in order to reach the SAFSTOR configuration. None of the samples taken at Fort Island Gulf Beach, the control location station C09, indicated measurable amounts of cobalt or cesium.

Table IV-C.6 provides a statistical summary of the shoreline sediment gamma spectroscopy results.

Table IV-C.6.a provides the results of the semi-annual samples.

#### 7. Additional samples taken in 2014 but not required by the ODCM: Site Settling Ponds

Annual sediment samples were collected at four locations in the site settling ponds. Cs-137 was detected in one of the four samples with a concentration of 7 pCi/kg. There were no measurable amounts of Co-60 or Cs-134 in any of the samples.

Annual surface water samples were collected at two locations in the site settling ponds. The tritium concentration was < LLD of 148 pCi/L in both samples. All of the pond surface water samples showed no measurable amounts of any other radionuclides of interest.

Table IV-C.7 provides the results of the settling pond samples.

#### 8. There were no unmonitored spills or releases of radioactive material in 2014 that could have the potential to contaminate the ground water per the guidelines of the Nuclear Energy Institute Ground Water Protection Initiative – Final Guidance Document 07-07. As such, there were no communiqués issued to state, local, or regulatory agencies.

State and local governmental officials have been updated regarding the status of the groundwater monitoring program at the Crystal River site per the requirements of the NEI 07-07 Guidelines.

TABLE IV-C.1

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

CRYSTAL RIVER UNIT 3

DOCKET NO. 50-302

CITRUS COUNTY, FLORIDA

JANUARY 1 TO DECEMBER 31, 2014

MEDIUM OR PATHWAY SAMPLED (UNITS)	ANALYSIS AND TOTAL NUMBER OF ANALYSES PERFORMED	LOWER LIMIT OF DETECTION (LLD) <sup>1</sup>	ALL INDICATOR LOCATIONS MEAN RANGE	LOCATION WITH HIGHEST MEAN NAME DISTANCE & BEARING	MEAN MEAN RANGE	CONTROL LOCATION MEAN RANGE	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
SEAWATER (pCi/L)	<u>Tritium, 36</u>	153	107(6/24) (84-139)	C14H 0.1 @ 0°	116 (3/12) (103-139)	<LLD	0
	<u>γ Spec, 36</u>						
	Mn-54	5	<LLD	--	--	<LLD	0
	Fe-59	10	<LLD	--	--	<LLD	0
	Co-58	5	<LLD	--	--	<LLD	0
	Co-60	7	<LLD	--	--	<LLD	0
	Zn-65	11	<LLD	--	--	<LLD	0
	Zr-Nb-95	9	<LLD	--	--	<LLD	0
	I-131	8	<LLD	--	--	<LLD	0
	Cs-134	5	<LLD	--	--	<LLD	0
	Cs-137	6	<LLD	--	--	<LLD	0
	Ba-La-140	14	<LLD	--	--	<LLD	0

<sup>1</sup>The "a priori" LLD which meets or exceeds the requirements of Table 2-9 of the CR-3 ODCM.

**TABLE IV-C.1.a**  
**DUKE ENERGY FLORIDA, INC. - CR3 - 2014**  
**pCi/L  $\gamma$  EMITTERS AND TRITIUM IN SEAWATER**

STATION	MONTH	H-3	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Zr-Nb-95	I-131	Cs-134	Cs-137	Ba-La-140	
C13	JAN	<143	298±31	<5	<5	<10	<7	<12	<8	<7	<5	<5	<8	
	FEB	<136	257±18	<3	<3	<5	<4	<6	<4	<3	<2	<3	<7	
	MAR	<134	208±24	<5	<4	<8	<6	<8	<7	<5	<4	<5	<13	
	APR	<141	186±18	<3	<3	<6	<3	<6	<5	<4	<3	<3	<4	
	MAY	<138	159±16	<3	<3	<5	<3	<6	<4	<3	<3	<3	<9	
	JUN	<140	225±20	<3	<4	<7	<5	<7	<5	<4	<3	<3	<4	<10
	JUL	<146	217±19	<3	<3	<6	<3	<6	<5	<3	<3	<3	<3	<5
	AUG	<139	210±20	<3	<2	<6	<3	<7	<4	<3	<3	<3	<3	<10
	SEP	<143	169±18	<2	<3	<6	<3	<6	<5	<3	<3	<3	<3	<7
	OCT	<148	221±28	<4	<5	<11	<7	<11	<9	<6	<5	<6	<6	<9
	NOV	<141	165±19	<3	<3	<5	<3	<6	<5	<3	<3	<3	<3	<10
	DEC	<146	263±15	<2	<2	<3	<2	<4	<3	<2	<2	<2	<2	<5
C14G	JAN	<143	203±19	<3	<3	<6	<3	<7	<6	<4	<2	<3	<4	
	FEB	<136	211±19	<3	<3	<7	<3	<6	<5	<4	<3	<3	<4	
	MAR	87±30	212±19	<3	<3	<6	<3	<6	<4	<3	<3	<3	<10	
	APR	123±27	155±16	<3	<3	<6	<3	<7	<6	<5	<3	<3	<4	
	MAY	84±26	129±15	<3	<2	<6	<3	<5	<4	<3	<2	<3	<8	
	JUN	<135	237±15	<2	<2	<5	<3	<5	<4	<3	<2	<3	<6	
	JUL	<146	177±19	<3	<3	<6	<3	<6	<4	<3	<3	<3	<3	<7
	AUG	<139	115±16	<3	<3	<7	<3	<6	<5	<3	<3	<3	<3	<11
	SEP	<143	203±25	<5	<5	<10	<6	<11	<9	<6	<5	<5	<5	<12
	OCT	<148	151±23	<5	<5	<10	<7	<11	<8	<7	<5	<5	<5	<7
	NOV	<140	212±20	<2	<3	<6	<3	<7	<4	<3	<3	<3	<3	<10
	DEC	<146	176±19	<3	<3	<7	<3	<6	<5	<4	<3	<3	<4	<11

TABLE IV-C.1a (CONT'D)

## DUKE ENERGY FLORIDA, INC. - CR3 - 2014

pCi/L  $\gamma$  EMITTERS AND TRITIUM IN SEAWATER

STATION	MONTH	H-3	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Zr-Nb-95	I-131	Cs-134	Cs-137	Ba-La-140
C14H	JAN	139±26	248±29	<5	<4	<10	<6	<11	<8	<8	<5	<5	<8
	FEB	<136	96±16	<3	<3	<6	<3	<6	<5	<3	<3	<3	<10
	MAR	106±31	169±22	<5	<4	<10	<7	<10	<8	<5	<5	<5	<14
	APR	<141	123±15	<3	<3	<7	<3	<6	<4	<4	<3	<3	<5
	MAY	103±26	136±16	<3	<3	<6	<3	<6	<5	<3	<3	<3	<7
	JUN	<135	215±20	<3	<3	<7	<3	<7	<4	<3	<3	<3	<10
	JUL	<146	119±15	<3	<3	<5	<3	<6	<4	<4	<3	<3	<7
	AUG	<139	171±19	<3	<3	<6	<3	<6	<5	<3	<3	<2	<10
	SEP	<143	150±17	<3	<3	<6	<3	<7	<5	<4	<3	<4	<6
	OCT	<148	165±24	<5	<5	<9	<7	<10	<9	<7	<4	<6	<10
	NOV	<153	212±22	<4	<3	<8	<6	<8	<6	<4	<4	<4	<14
	DEC	<146	246±17	<2	<2	<6	<4	<5	<4	<3	<3	<3	<7



# Seawater

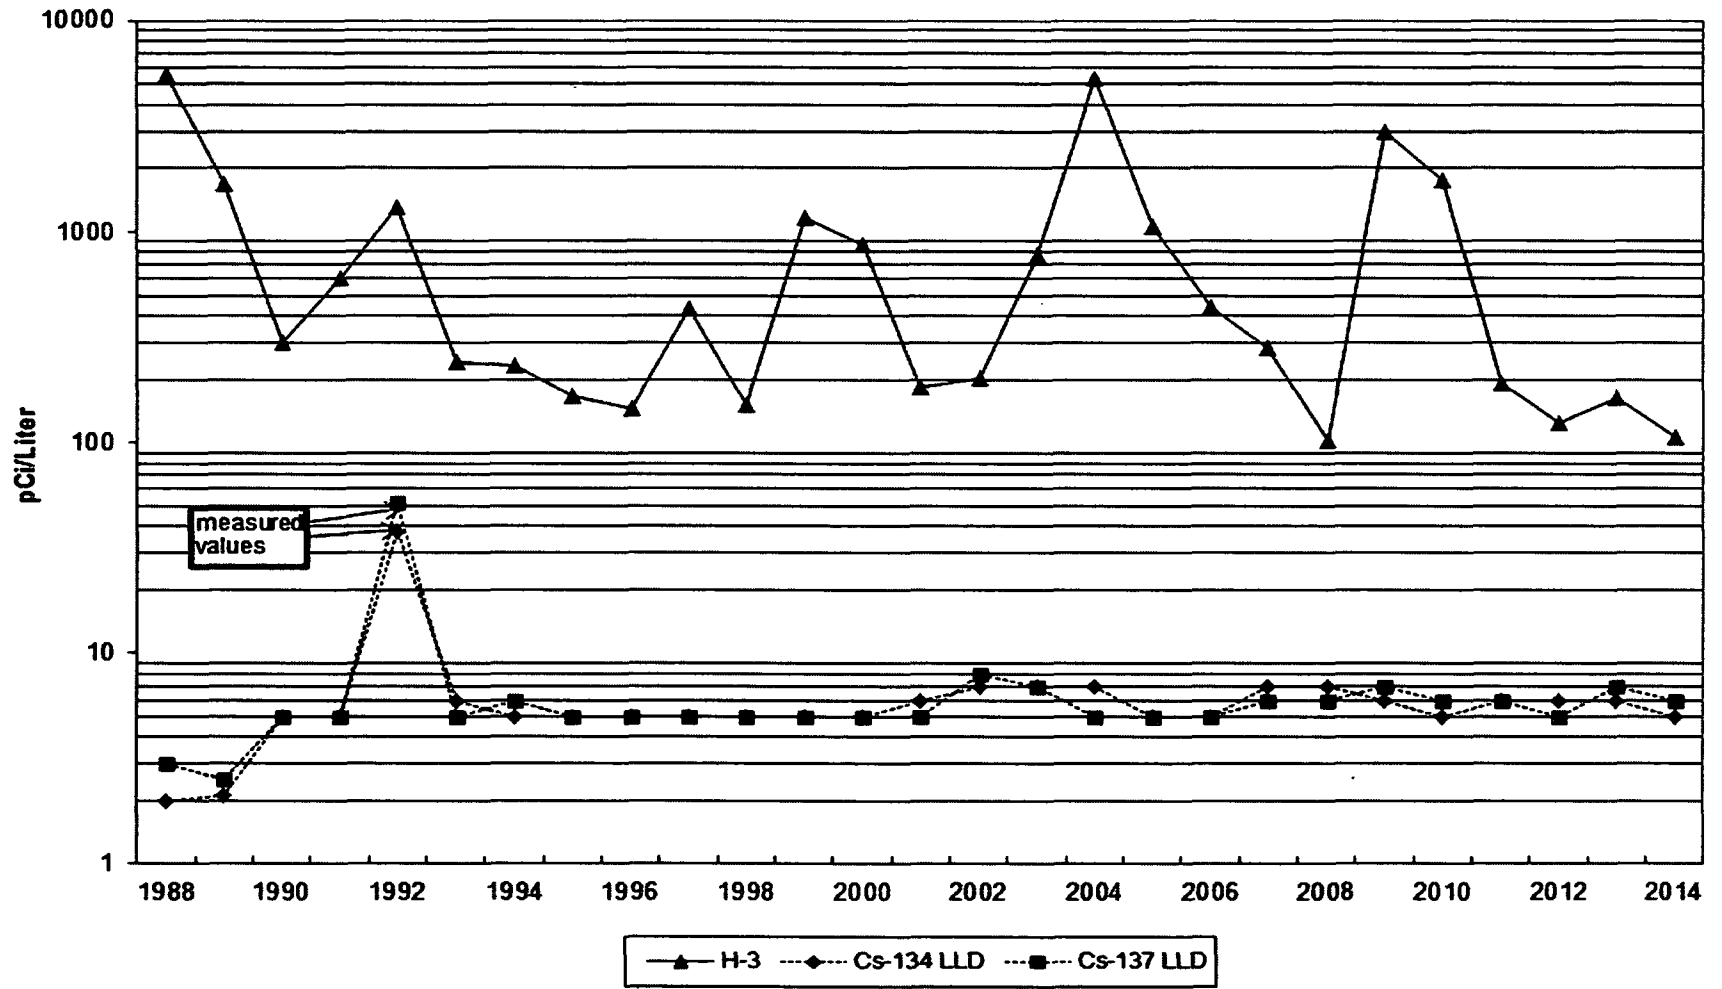


TABLE IV-C.2

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

CRYSTAL RIVER UNIT 3

DOCKET NO. 50-302

CITRUS COUNTY, FLORIDA

JANUARY 1 TO DECEMBER 31, 2014

MEDIUM OR PATHWAY SAMPLED (UNITS)	ANALYSIS AND TOTAL NUMBER OF ANALYSES PERFORMED	LOWER LIMIT OF DETECTION (LLD) <sup>1</sup>	ALL INDICATOR LOCATIONS	LOCATION WITH HIGHEST MEAN		CONTROL LOCATION MEAN RANGE	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
			MEAN RANGE	NAME	MEAN RANGE		
GROUND WATER <sup>2</sup> (pCi/L)	<u>Tritium, 2</u>	155	<LLD	--	--	<LLD	0
	<u>γ Spec, 2</u>						
	Mn-54	3	<LLD	--	--	<LLD	0
	Fe-59	7	<LLD	--	--	<LLD	0
	Co-58	3	<LLD	--	--	<LLD	0
	Co-60	4	<LLD	--	--	<LLD	0
	Zn-65	8	<LLD	--	--	<LLD	0
	Zr-Nb-95	6	<LLD	--	--	<LLD	0
	I-131	4	<LLD	--	--	<LLD	0
	Cs-134	3	<LLD	--	--	<LLD	0
	Cs-137	3	<LLD	--	--	<LLD	0
Ba-La-140	12	<LLD	--	--	<LLD	0	

<sup>1</sup>The "a priori" LLD which meets or exceeds the requirements of Table 2-9 of the CR-3 ODCM.

<sup>2</sup>There is no drinking water uptake pathway at the Crystal River site.

TABLE IV-C.2.a

DUKE ENERGY FLORIDA, INC. - CR3 - 2014

pCi/L  $\gamma$  EMITTERS AND TRITIUM IN GROUND WATER

STATION	NUCLIDE	FIRST HALF	SECOND HALF
C40	H-3	<134	<155
	Mn-54	<2	<3
	Fe-59	<4	<7
	Co-58	<2	<3
	Co-60	<3	<4
	Zn-65	<4	<8
	Zr-Nb-95	<4	<6
	I-131	<2	<4
	Cs-134	<2	<3
	Cs-137	<2	<3
	Ba-La-140	<5	<12
	K-40	<26	<39

### Semi-Annual Ground Water

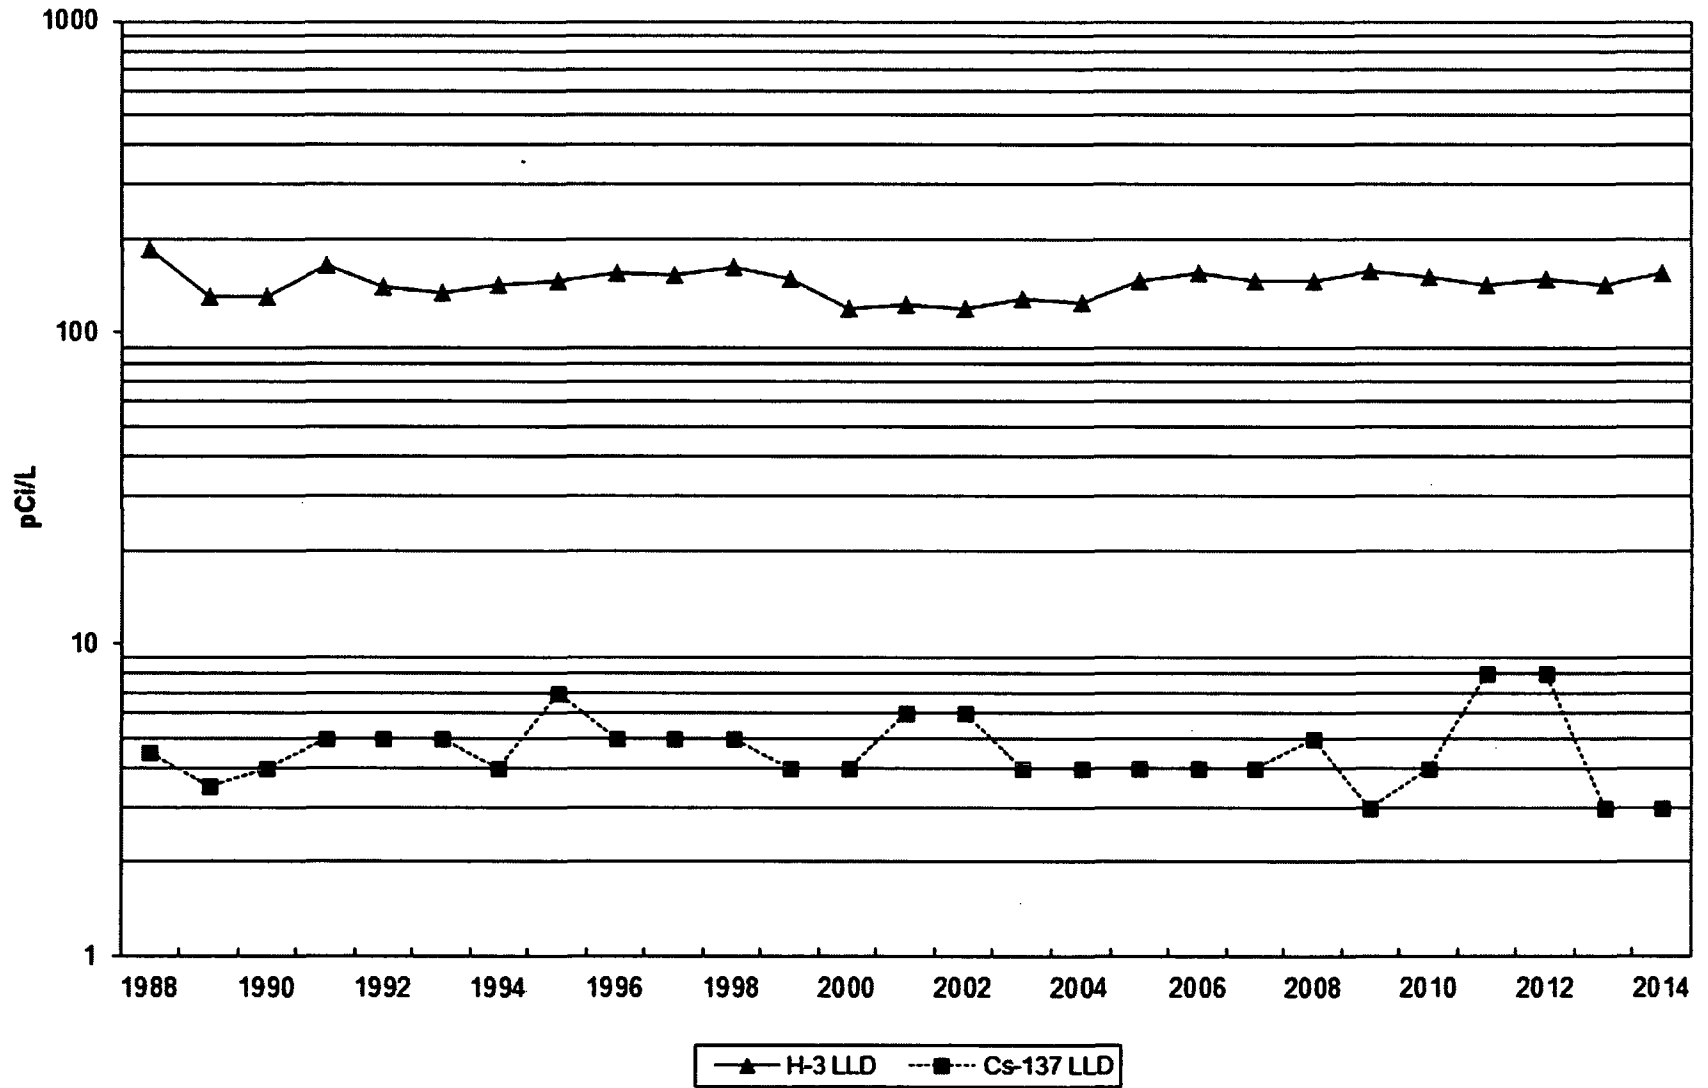


TABLE IV-C.3

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

CRYSTAL RIVER UNIT 3

DOCKET NO. 50-302

CITRUS COUNTY, FLORIDA

JANUARY 1 TO DECEMBER 31, 2014

MEDIUM OR PATHWAY SAMPLED (UNITS)	ANALYSIS AND TOTAL (NUMBER) <sup>2</sup> OF ANALYSES PERFORMED	LOWER LIMIT OF DETECTION (LLD) <sup>1</sup>	ALL INDICATOR LOCATIONS	LOCATION WITH HIGHEST MEAN		CONTROL LOCATION MEAN RANGE	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
			MEAN RANGE	NAME DISTANCE & BEARING	MEAN RANGE		
CR3 SITE GROUND WATER (pCi/L)	Tritium 92	153	210 (39/92) (88-427)	CR3-5 0.051 mi.@225°	364(12/12) (300-427)	CR3-2 145(1/4) (LLD-145)	0
	<u>γ Spec 92</u>						
	Mn-54	6	<LLD	--	--	<LLD	0
	Fe-59	12	<LLD	--	--	<LLD	0
	Co-58	6	<LLD	--	--	<LLD	0
	Co-60	8	<LLD	--	--	<LLD	0
	Zn-65	15	<LLD	--	--	<LLD	0
	Zr-Nb-95	11	<LLD	--	--	<LLD	0
	I-131	10	<LLD	--	--	<LLD	0
	Cs-134	6	<LLD	--	--	<LLD	0
	Cs-137	7	<LLD	--	--	<LLD	0
	Ba-La-140	15	<LLD	--	--	<LLD	0

<sup>1</sup>The "a priori" LLD which meets or exceeds the requirements of Table 2-9 of the CR-3 ODCM.

<sup>2</sup>Includes extra samples collected for data trending.

TABLE IV-C.3.a.1

DUKE ENERGY FLORIDA, INC. - CR3 - 2014

pCi/L  $\gamma$  EMITTERS AND TRITIUM IN CR3 SITE GROUND WATER

STATION	DATE	H-3	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Zn-Nb-95	I-131	Cs-134	Cs-137	Ba-La-140
CR3-1D	01-13	<135	<37	<3	<3	<5	<3	<6	<4	<3	<3	<3	<7
	04-02	<141	<42	<3	<3	<6	<3	<8	<5	<5	<3	<3	<5
	07-03	<146	<43	<3	<3	<6	<2	<7	<5	<6	<3	<3	<5
	10-14	176±49	<52	<3	<3	<7	<3	<7	<6	<5	<3	<4	<7
CR3-1S	01-13	<135	<47	<4	<3	<7	<5	<8	<7	<5	<4	<4	<14
	04-02	<139	<45	<3	<3	<7	<2	<6	<5	<5	<3	<3	<5
	07-03	<146	<73	<4	<5	<10	<7	<9	<8	<9	<4	<5	<8
	10-14	181±49	<36	<3	<3	<6	<3	<6	<5	<4	<3	<3	<8
CR3-2	01-13	<135	<43	<4	<4	<6	<4	<7	<6	<5	<3	<4	<14
	04-02	<141	<35	<3	<3	<7	<3	<8	<6	<6	<3	<4	<6
	07-03	<146	<41	<3	<3	<6	<3	<7	<5	<5	<3	<3	<5
	10-14	145±48	<79	<6	<6	<10	<7	<11	<10	<7	<5	<7	<12

TABLE IV-C.3.a.1

DUKE ENERGY FLORIDA, INC. - CR3 – 2014

pCi/L  $\gamma$  EMITTERS AND TRITIUM IN CR3 SITE GROUND WATER

STATION	DATE	H-3	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Zn-Nb-95	I-131	Cs-134	Cs-137	Ba-La-140
CR3-3D	01-13	<135	<37	<3	<2	<4	<3	<5	<4	<3	<3	<3	<5
	04-02	<141	<40	<3	<3	<7	<3	<7	<6	<5	<3	<3	<5
	07-03	<146	<54	<3	<3	<7	<3	<7	<6	<5	<3	<3	<5
	10-14	<141	<54	<3	<3	<6	<3	<7	<5	<4	<3	<4	<10
CR3-3S	01-13	<135	<39	<3	<3	<6	<3	<5	<5	<3	<3	<3	<11
	04-02	<139	<76	<5	<5	<10	<7	<11	<9	<10	<5	<5	<7
	07-03	<146	<39	<3	<3	<6	<3	<5	<5	<4	<2	<3	<4
	10-21	<141	<33	<2	<2	<4	<3	<5	<4	<3	<2	<3	<6
CR3-4	01-13	<135	<28	<2	<2	<4	<2	<4	<4	<3	<2	<2	<6
	04-02	<141	<39	<3	<3	<7	<3	<6	<5	<5	<3	<3	<5
	07-03	<146	<68	<5	<5	<11	<7	<9	<11	<8	<5	<5	<8
	10-21	<145	<43	<4	<3	<6	<4	<9	<6	<4	<4	<4	<10

TABLE IV-C.3.a.1

DUKE ENERGY FLORIDA, INC. - CR3 - 2014

pCi/L  $\gamma$  EMITTERS AND TRITIUM IN CR3 SITE GROUND WATER

STATION	DATE	H-3	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Zn-Nb-95	I-131	Cs-134	Cs-137	Ba-La-140
CR3-5	01-07	372±52	<45	<3	<3	<7	<4	<8	<6	<4	<3	<3	<8
	04-02	350±52	<78	<5	<5	<11	<7	<10	<9	<9	<5	<5	<8
	07-03	415±54	<82	<5	<6	<10	<7	<9	<8	<9	<5	<6	<8
	10-08	336±53	32±15	<5	<6	<11	<7	<12	<8	<7	<6	<6	<8
CR3-6S	01-07	<143	<50	<3	<3	<6	<3	<7	<5	<4	<3	<3	<8
	04-02	<141	<80	<5	<4	<10	<7	<10	<9	<8	<5	<5	<7
	07-03	<146	<72	<5	<5	<11	<7	<12	<9	<9	<5	<6	<7
	10-06	<148	<48	<4	<3	<7	<3	<8	<5	<4	<3	<3	<6
CR3-6D	01-13	<135	183±13	<36	<3	<3	<5	<4	<5	<4	<3	<3	<3
	04-02	147±46	174±25	<69	<5	<6	<8	<7	<12	<10	<9	<5	<6
	07-03	<146	197±25	<61	<5	<5	<11	<8	<11	<9	<9	<5	<6
	10-14	119±52	170±12	<35	<2	<2	<4	<2	<5	<3	<3	<2	<2



TABLE IV-C.3.a.1(cont'd)

DUKE ENERGY FLORIDA, INC. - CR3 - 2014

pCi/L  $\gamma$  EMITTERS AND TRITIUM IN CR3 SITE GROUND WATER

STATION	DATE	H-3	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Zn-Nb-95	I-131	Cs-134	Cs-137	Ba-La-140
CR3-7	01-07	120±46	<41	<3	<4	<6	<3	<6	<5	<4	<3	<3	<6
	04-02	166±47	<77	<5	<4	<10	<6	<10	<10	<9	<6	<6	<8
	07-03	<149	<78	<5	<4	<11	<7	<11	<10	<8	<5	<5	<8
	10-06	114±28	<42	<3	<3	<7	<3	<8	<5	<4	<3	<3	<6
CR3-8	01-07	<143	<78	<6	<6	<11	<8	<15	<9	<8	<6	<6	<11
	04-02	111±26	<53	<3	<3	<7	<4	<8	<6	<6	<3	<4	<6
	07-03	153±48	<44	<3	<3	<7	<3	<6	<6	<6	<3	<3	<5
	10-06	114±28	18±8	<3	<3	<7	<3	<8	<6	<5	<3	<4	<6
CR3-9	01-07	<143	<48	<3	<3	<6	<3	<7	<6	<4	<3	<3	<7
	04-02	<139	<17	<3	<3	<7	<3	<7	<5	<6	<3	<3	<6
	07-03	<146	<46	<3	<3	<6	<3	<7	<6	<5	<3	<3	<5
	10-06	<148	<47	<3	<3	<7	<3	<7	<5	<4	<3	<3	<5

TABLE IV-C.3.a.1(cont'd)

DUKE ENERGY FLORIDA, INC. - CR3 - 2014

pCi/L  $\gamma$  EMITTERS AND TRITIUM IN CR3 SITE GROUND WATER

STATION	DATE	H-3	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Zn-Nb-95	I-131	Cs-134	Cs-137	Ba-La-140
CR3-10	01-13	<135	<37	<3	<3	<6	<3	<6	<5	<3	<3	<3	<9
	04-02	<142	<34	<3	<3	<6	<3	<6	<5	<5	<3	<3	<5
	07-03	<146	<42	<3	<3	<7	<3	<7	<6	<5	<3	<3	<4
	10-14	<145	<44	<4	<3	<8	<3	<8	<5	<4	<4	<4	<9

TABLE IV-C.3.a.2

DUKE ENERGY FLORIDA, INC. - CR3 - 2014

pCi/L  $\gamma$  EMITTERS AND TRITIUM IN CR3 SITE GROUND WATER (SUPPLEMENTAL DATA)

STATION	DATE	H-3	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Zn-Nb-95	I-131	Cs-134	Cs-137	Ba-La-140
CR3-5	02-07	404±52	<81	<5	<5	<11	<7	<12	<9	<9	<5	<6	<8
	03-06	389±50	<55	<4	<4	<7	<4	<7	<7	<5	<4	<4	<15
	05-08	329±50	50±13	<3	<4	<8	<5	<9	<7	<5	<4	<4	<13
	06-05	385±51	<83	<5	<5	<11	<7	<10	<10	<8	<5	<6	<6
	08-06	319±50	30±9	<3	<3	<5	<4	<6	<6	<4	<3	<4	<8
	09-04	427±54	<84	<5	<4	<9	<7	<9	<9	<8	<5	<6	<9
	11-07	339±51	<84	<5	<5	<10	<7	<12	<8	<9	<6	<6	<9
	12-04	300±50	<83	<5	<4	<11	<7	<11	<9	<9	<5	<6	<9
CR3-6S	02-07	127±45	<88	<5	<5	<10	<7	<11	<8	<8	<5	<6	<8
	03-06	<133	<50	<4	<3	<7	<4	<8	<7	<4	<4	<4	<13
	05-08	<138	28±12	<4	<4	<7	<5	<9	<7	<5	<4	<5	<11
	06-05	<146	20±10	<3	<3	<7	<4	<7	<5	<4	<3	<4	<6
	08-06	154±46	<46	<3	<3	<8	<3	<8	<6	<4	<3	<4	<11
	09-04	<148	<77	<5	<5	<8	<7	<10	<8	<8	<5	<5	<7
	11-07	<140	<69	<6	<5	<11	<7	<12	<10	<8	<5	<6	<9
	12-04	<130	<59	<4	<4	<7	<5	<8	<7	<5	<4	<5	<15

TABLE IV-C.3.a.2(cont'd)

## DUKE ENERGY FLORIDA, INC. - CR3 - 2014

pCi/L  $\gamma$  EMITTERS AND TRITIUM IN CR3 SITE GROUND WATER (SUPPLEMENTAL DATA)

STATION	DATE	H-3	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Zn-Nb-95	I-131	Cs-134	Cs-137	Ba-La-140
CR3-7	02-07	143±45	<39	<3	<4	<7	<3	<7	<5	<5	<3	<3	<6
	03-06	137±44	<47	<3	<3	<7	<5	<7	<6	<4	<3	<4	<12
	05-08	88±26	<38	<4	<4	<7	<3	<7	<6	<4	<3	<3	<13
	06-05	133±45	<40	<3	<2	<6	<3	<6	<5	<4	<3	<3	<5
	08-06	<139	33±15	<4	<5	<12	<7	<11	<8	<6	<5	<6	<12
	09-04	131±27	<80	<5	<5	<8	<7	<11	<10	<7	<5	<5	<7
	11-07	<153	<71	<5	<4	<10	<6	<11	<8	<8	<5	<6	<6
	12-04	143±28	<48	<3	<3	<7	<4	<9	<5	<4	<4	<3	<10
CR3-8	02-07	122±45	22±8	<3	<4	<8	<4	<8	<5	<5	<4	<4	<7
	03-06	217±46	<48	<3	<4	<7	<4	<8	<7	<4	<4	<4	<14
	05-08	193±47	<52	<4	<4	<8	<5	<8	<7	<5	<4	<4	<10
	06-05	137±45	<81	<5	<5	<11	<7	<11	<10	<9	<5	<6	<7
	08-06	117±27	30±16	<5	<5	<12	<8	<13	<9	<7	<6	<6	<12
	09-04	136±47	<41	<3	<3	<6	<3	<7	<5	<5	<3	<3	<5
	11-07	<153	<86	<5	<6	<12	<8	<12	<10	<9	<5	<7	<11
	12-04	138±28	<50	<4	<4	<8	<4	<10	<6	<5	<4	<4	<13

TABLE IV-C.3.a.2(cont'd)


DUKE ENERGY FLORIDA, INC. - CR3 - 2014

pCi/L  $\gamma$  EMITTERS AND TRITIUM IN CR3 SITE GROUND WATER (SUPPLEMENTAL DATA)

STATION	DATE	H-3	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Zn-Nb-95	I-131	Cs-134	Cs-137	Ba-La-140
CR3-9	02-07	<136	<49	<3	<3	<6	<4	<7	<6	<5	<3	<3	<5
	03-06	<133	30±10	<3	<3	<6	<4	<7	<5	<4	<3	<4	<8
	05-08	<138	<47	<3	<3	<6	<4	<8	<5	<4	<3	<3	<12
	06-05	<139	<41	<2	<2	<5	<3	<6	<5	<3	<3	<3	<6
	08-06	<139	<49	<3	<3	<6	<3	<7	<5	<4	<3	<3	<7
	09-04	<144	<45	<3	<3	<6	<3	<6	<5	<5	<3	<3	<5
	11-07	<141	<51	<3	<3	<7	<4	<7	<6	<5	<3	<4	<6
	12-04	<140	<46	<3	<3	<6	<3	<8	<6	<4	<4	<3	<13


### Tritium Measurement GW Well # CR3-1S

All results are < LLD unless noted

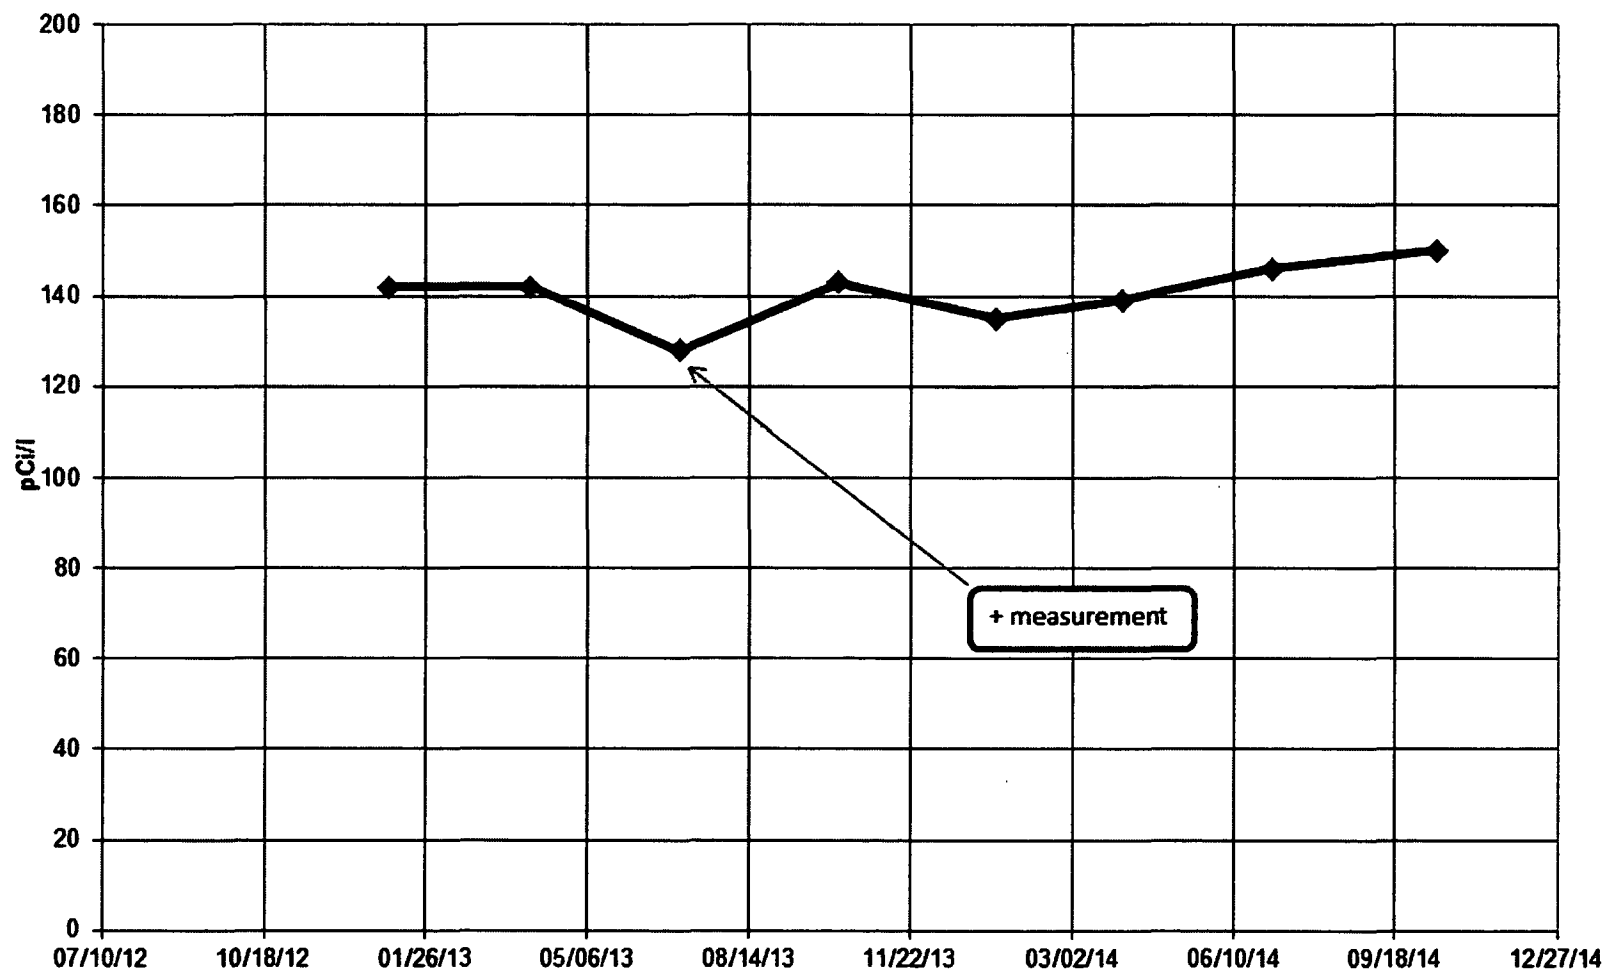


### Tritium Measurement GW Well # CR3-1D

All results are < LLD unless noted

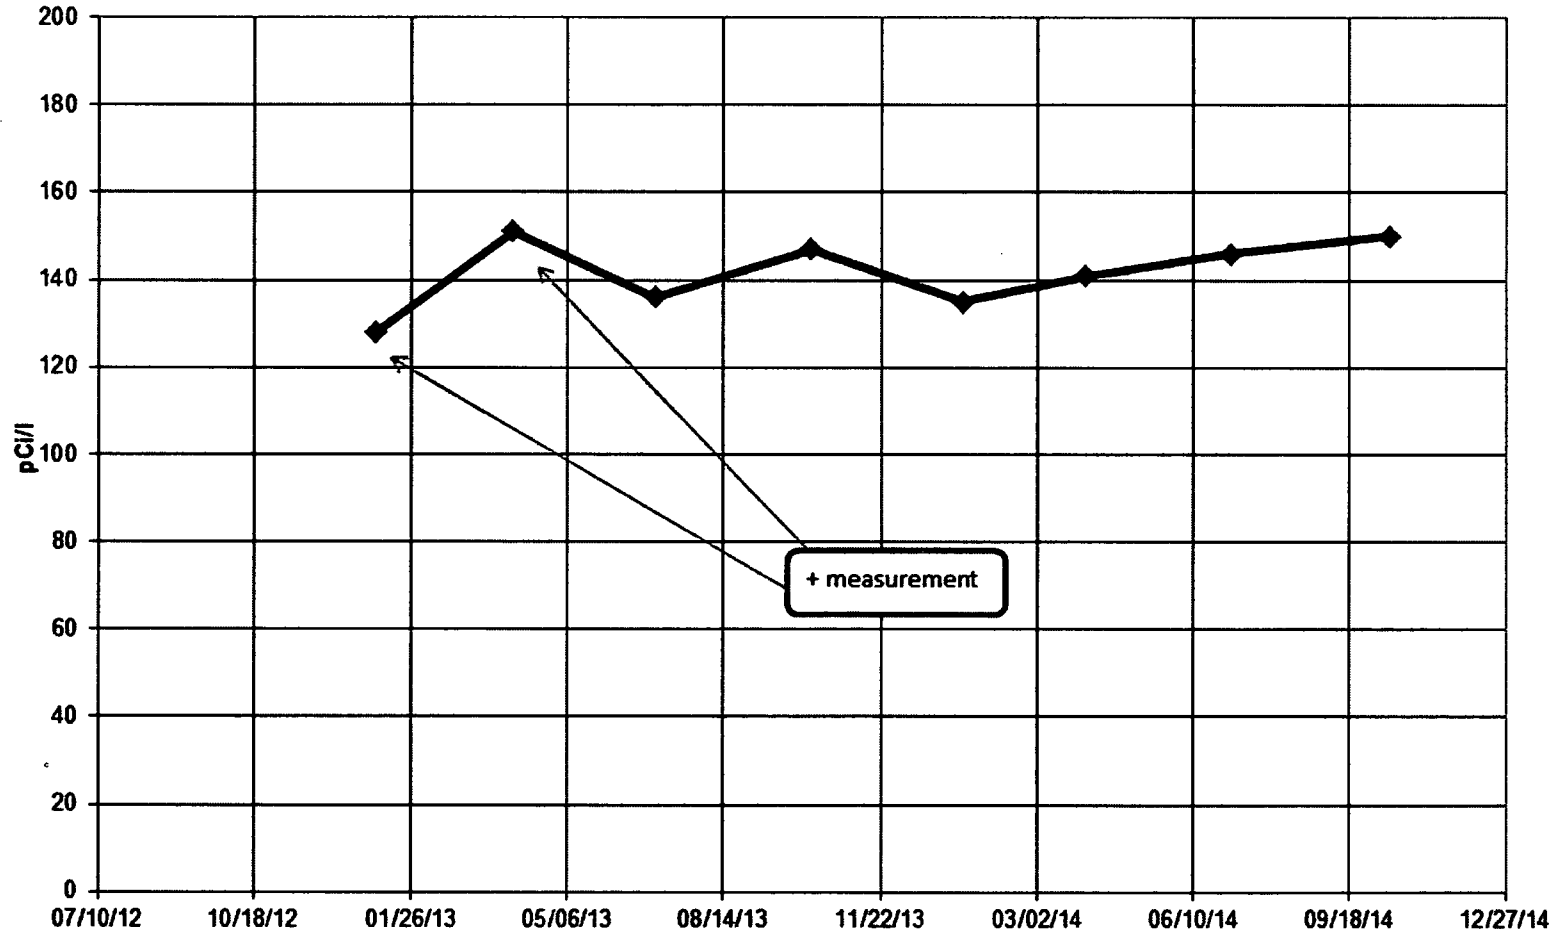

### Tritium Measurement GW Well # CR3-2


All results are < LLD unless noted

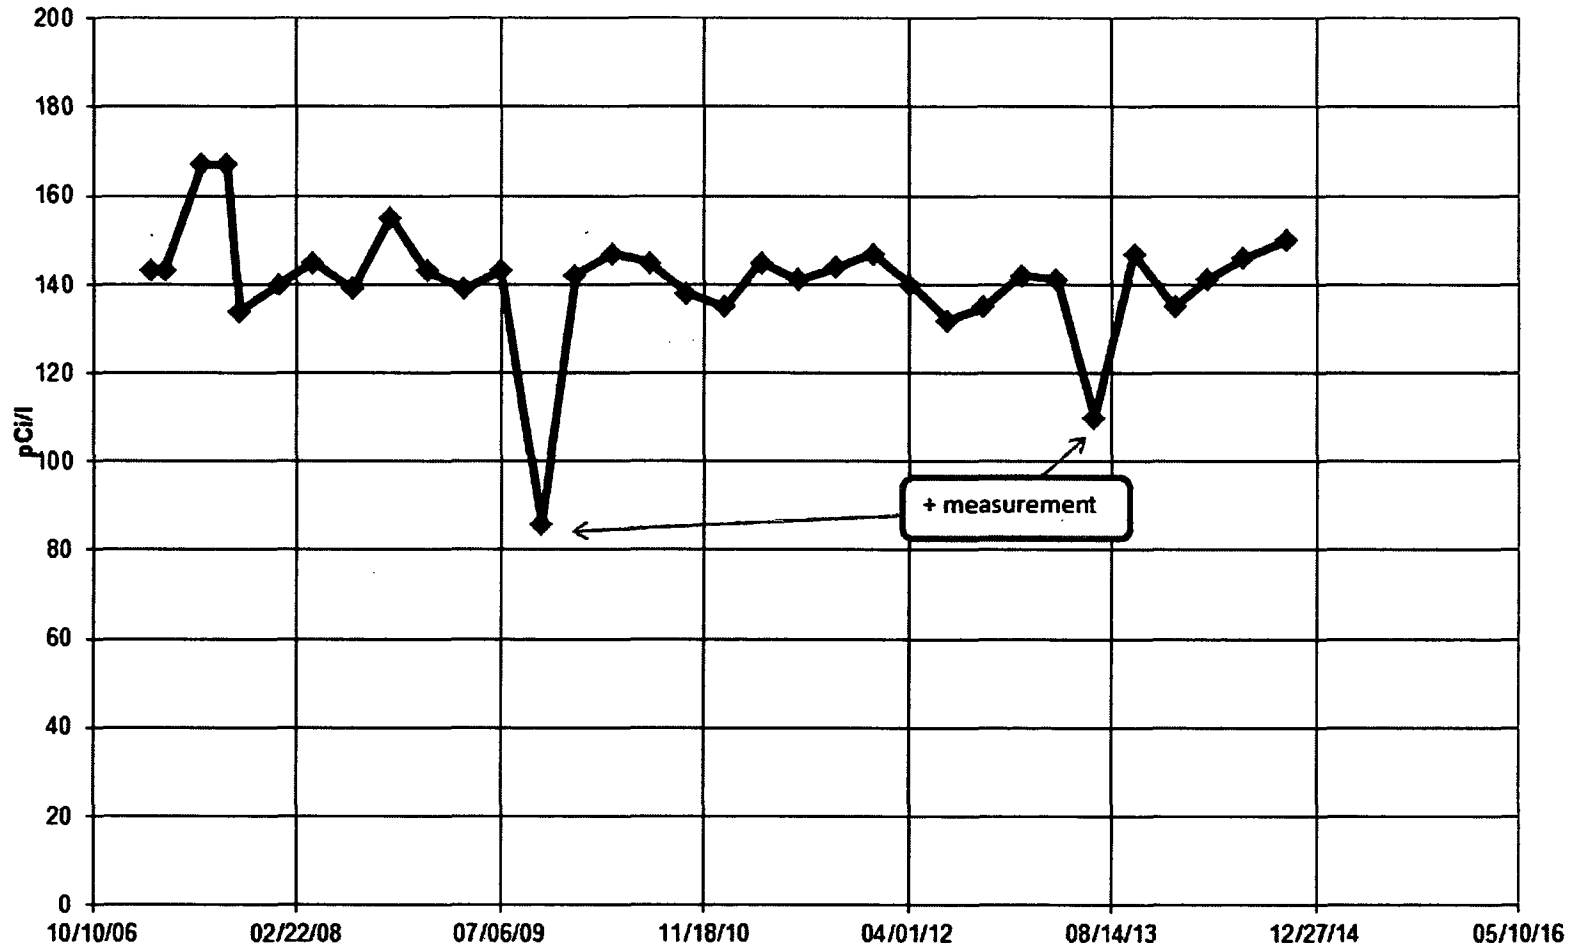




### Tritium Measurement GW Well # CR3-3S

All results are < LLD unless noted

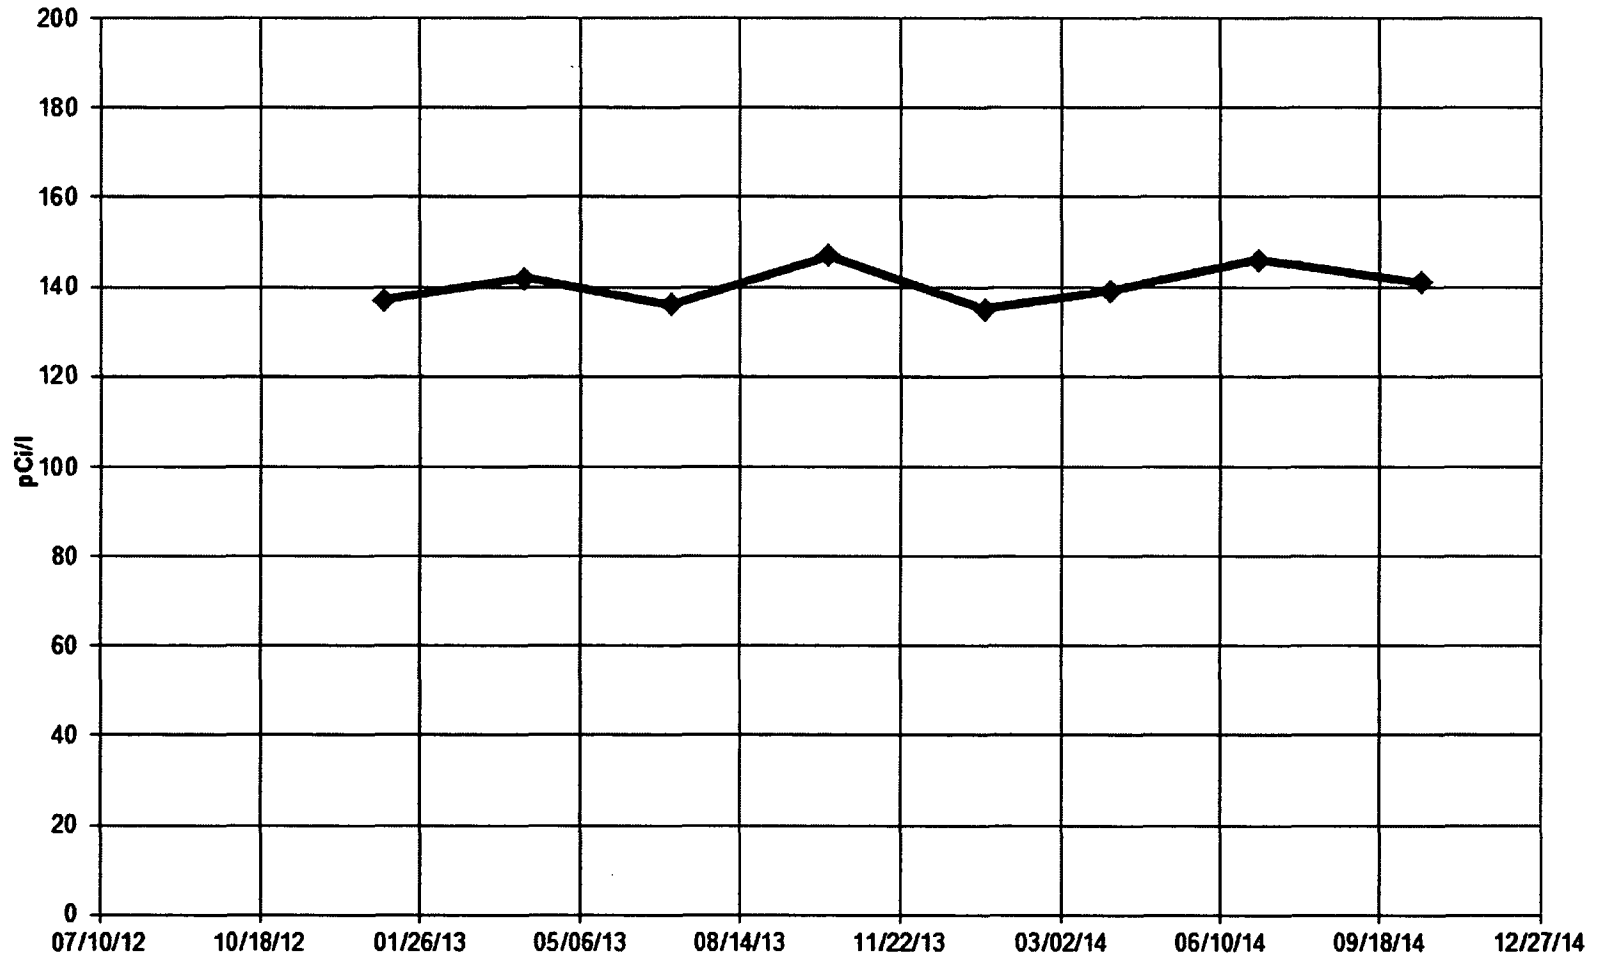


### Tritium Measurement GW Well # CR3-3D

All results are < LLD unless noted

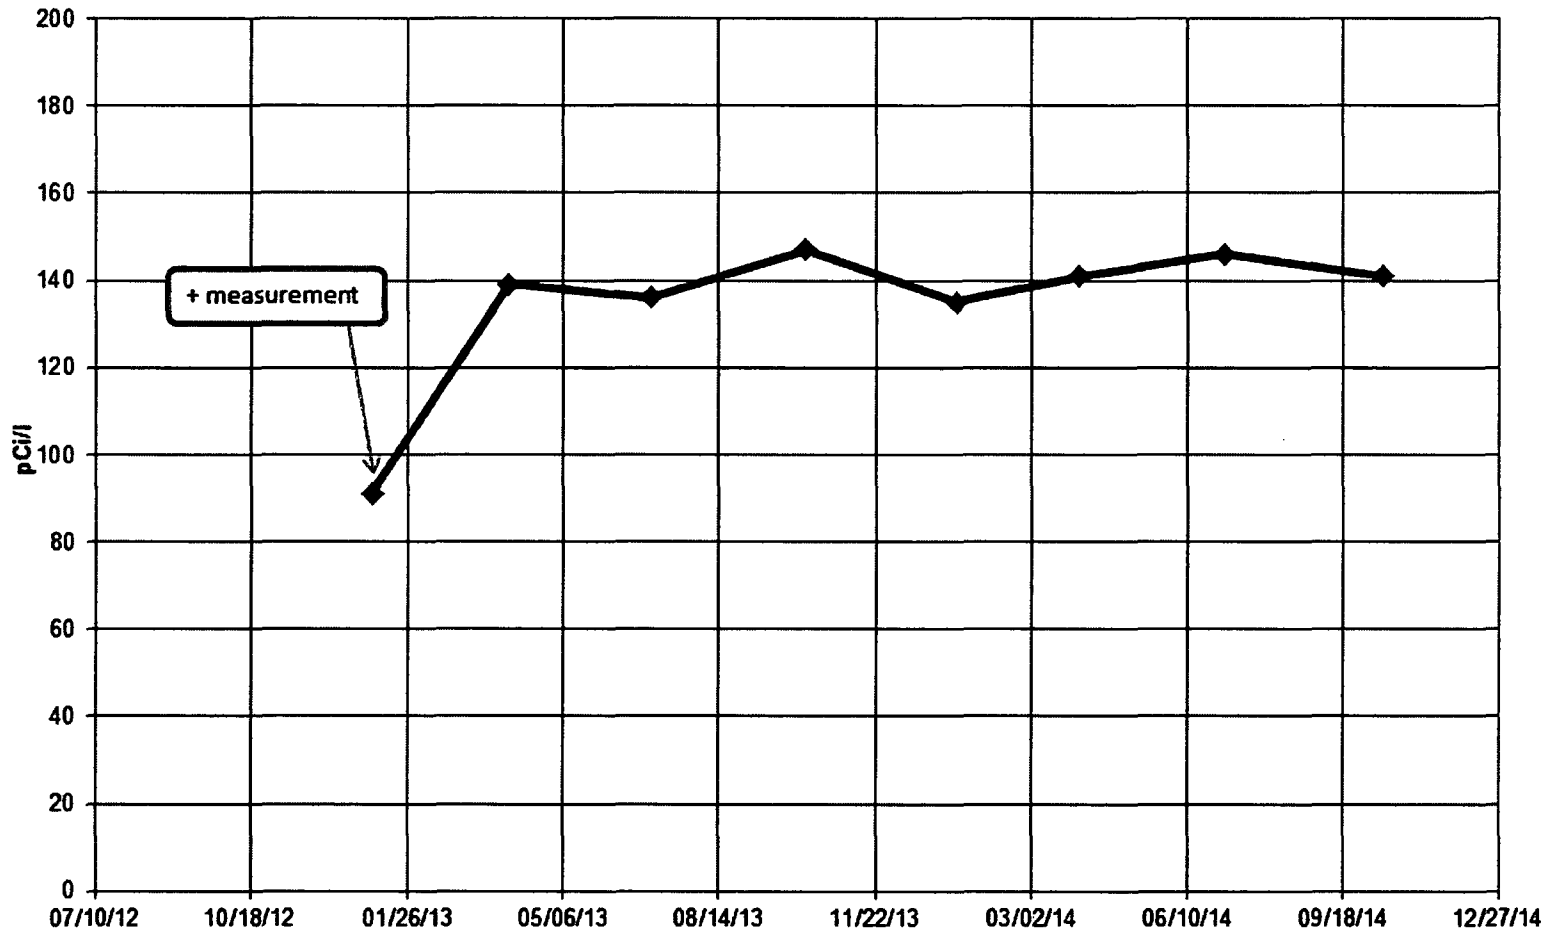


### Tritium Measurement GW Well # CR3-4

All results are < LLD unless noted

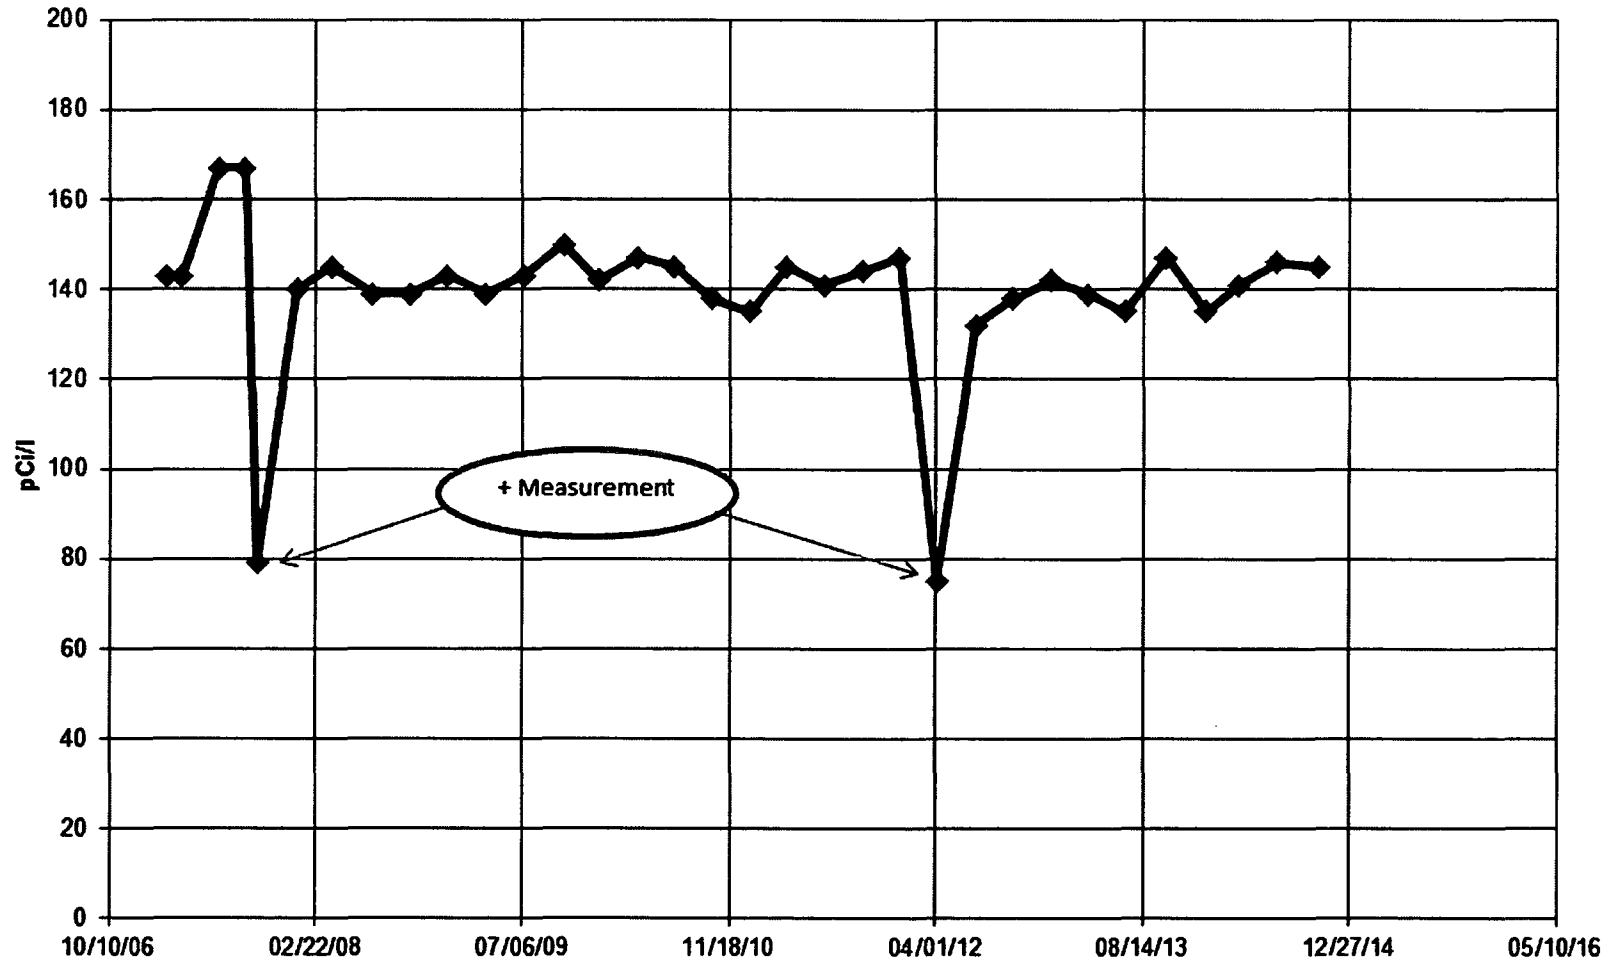


### Tritium Measurement GW Well # CR3-5

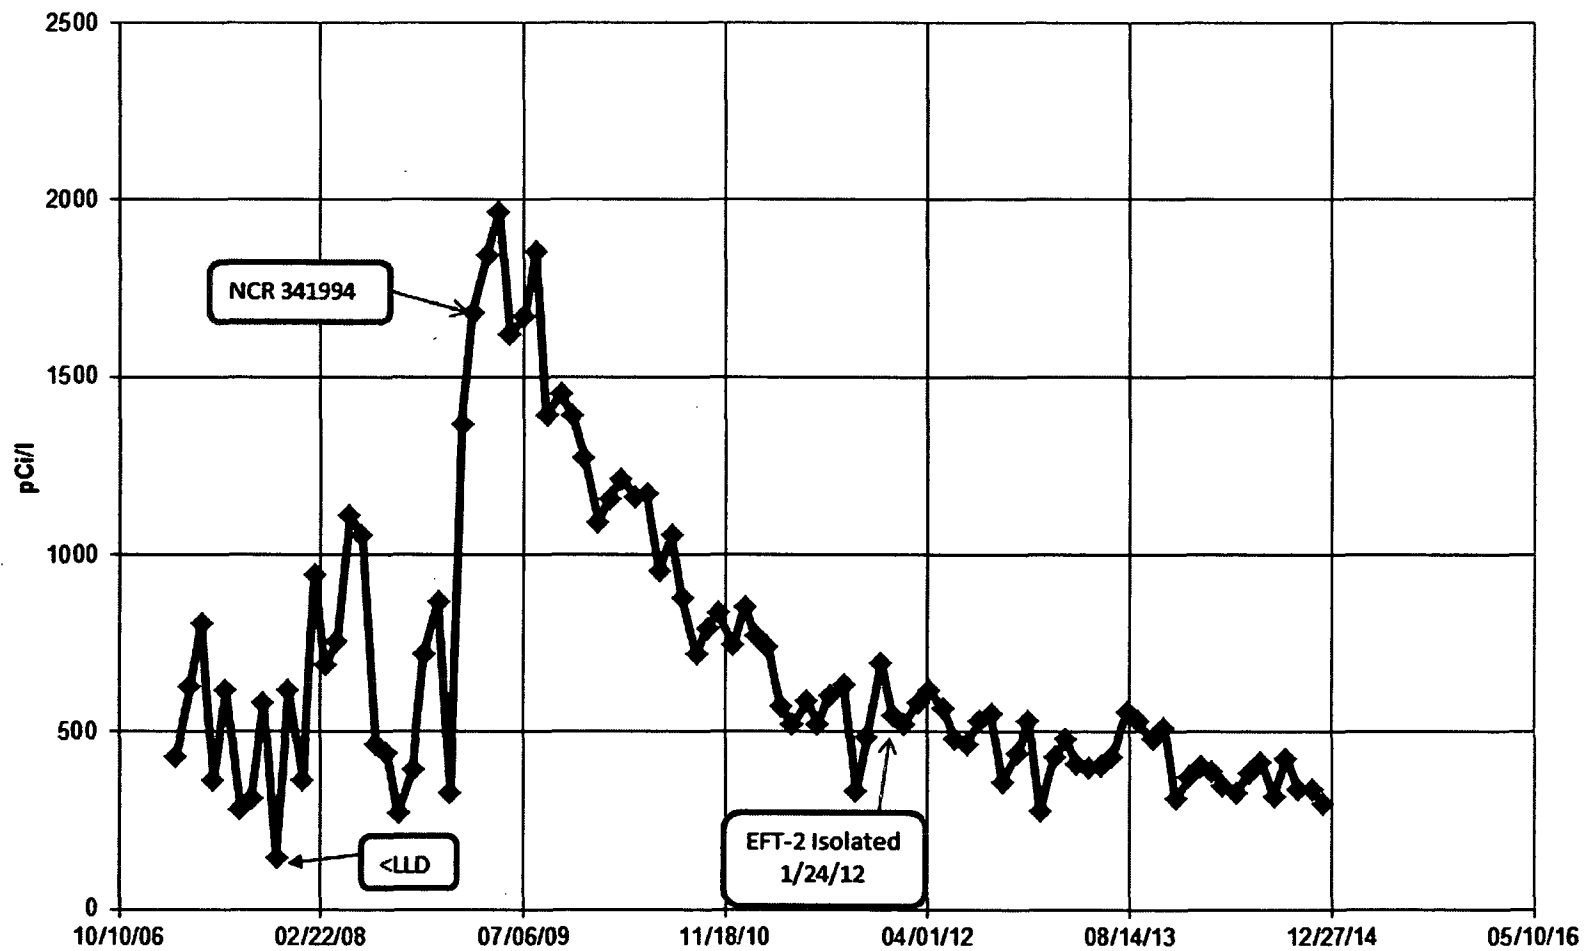


### Tritium Measurement GW Well # CR3-6S

All results are < LLD unless noted

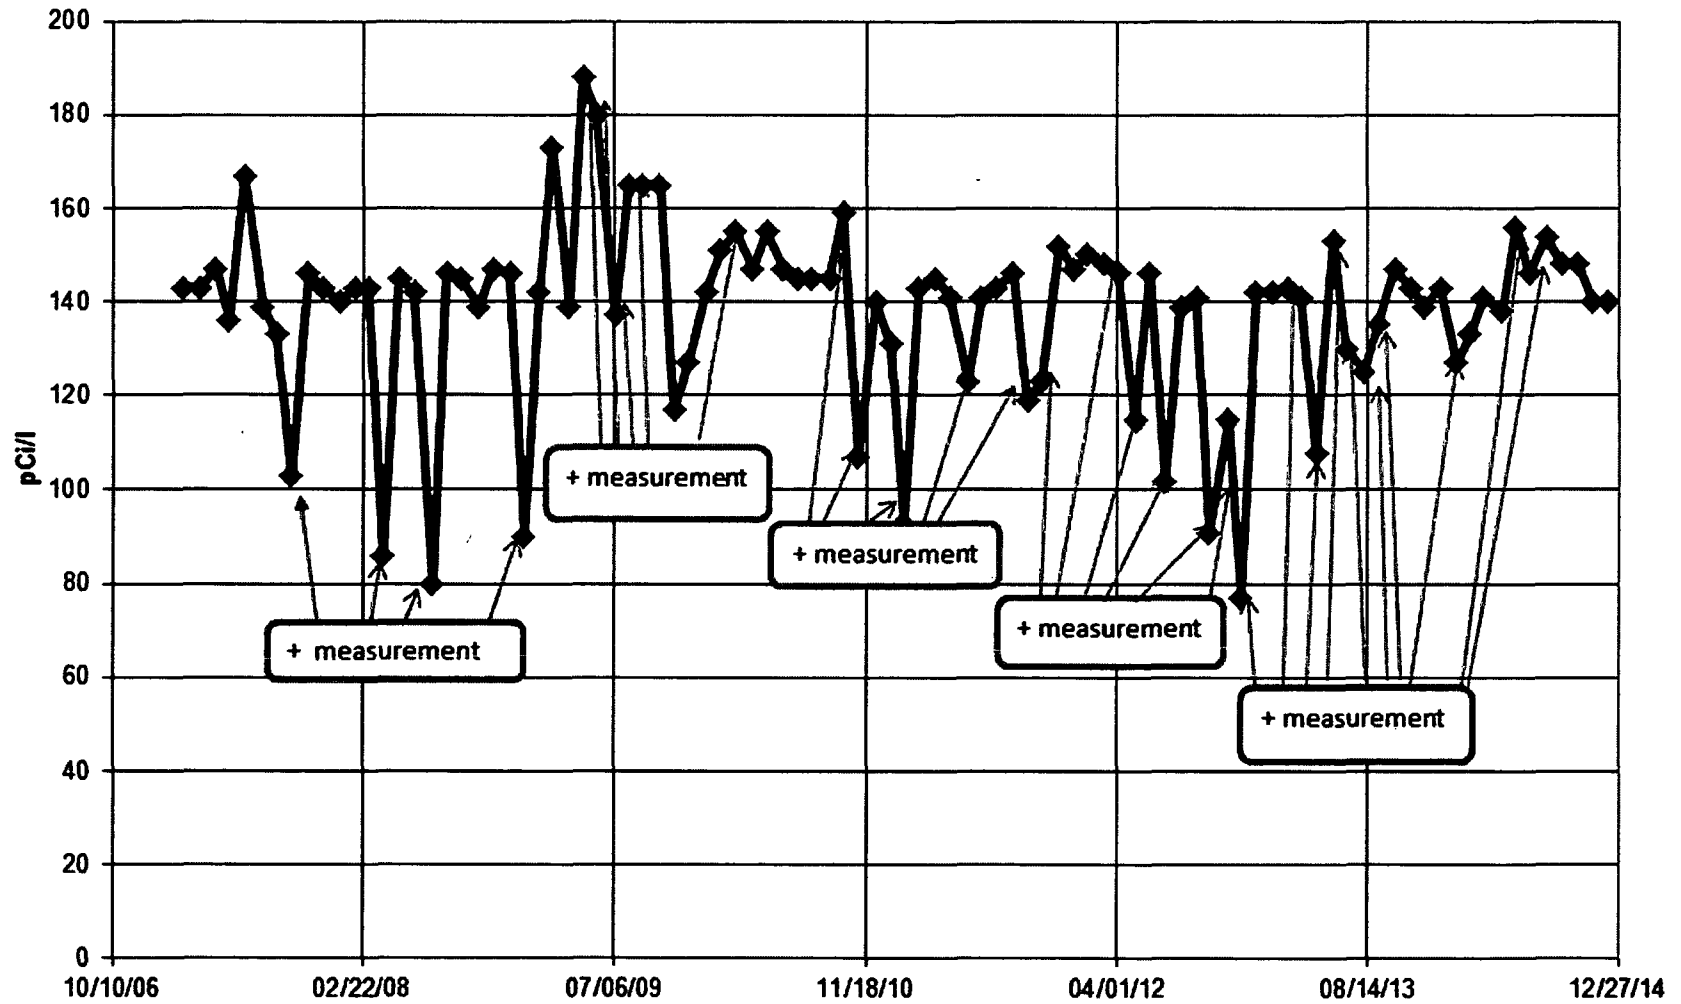


### Tritium Measurements GW Well # CR3-6D


All results are < LLD unless noted

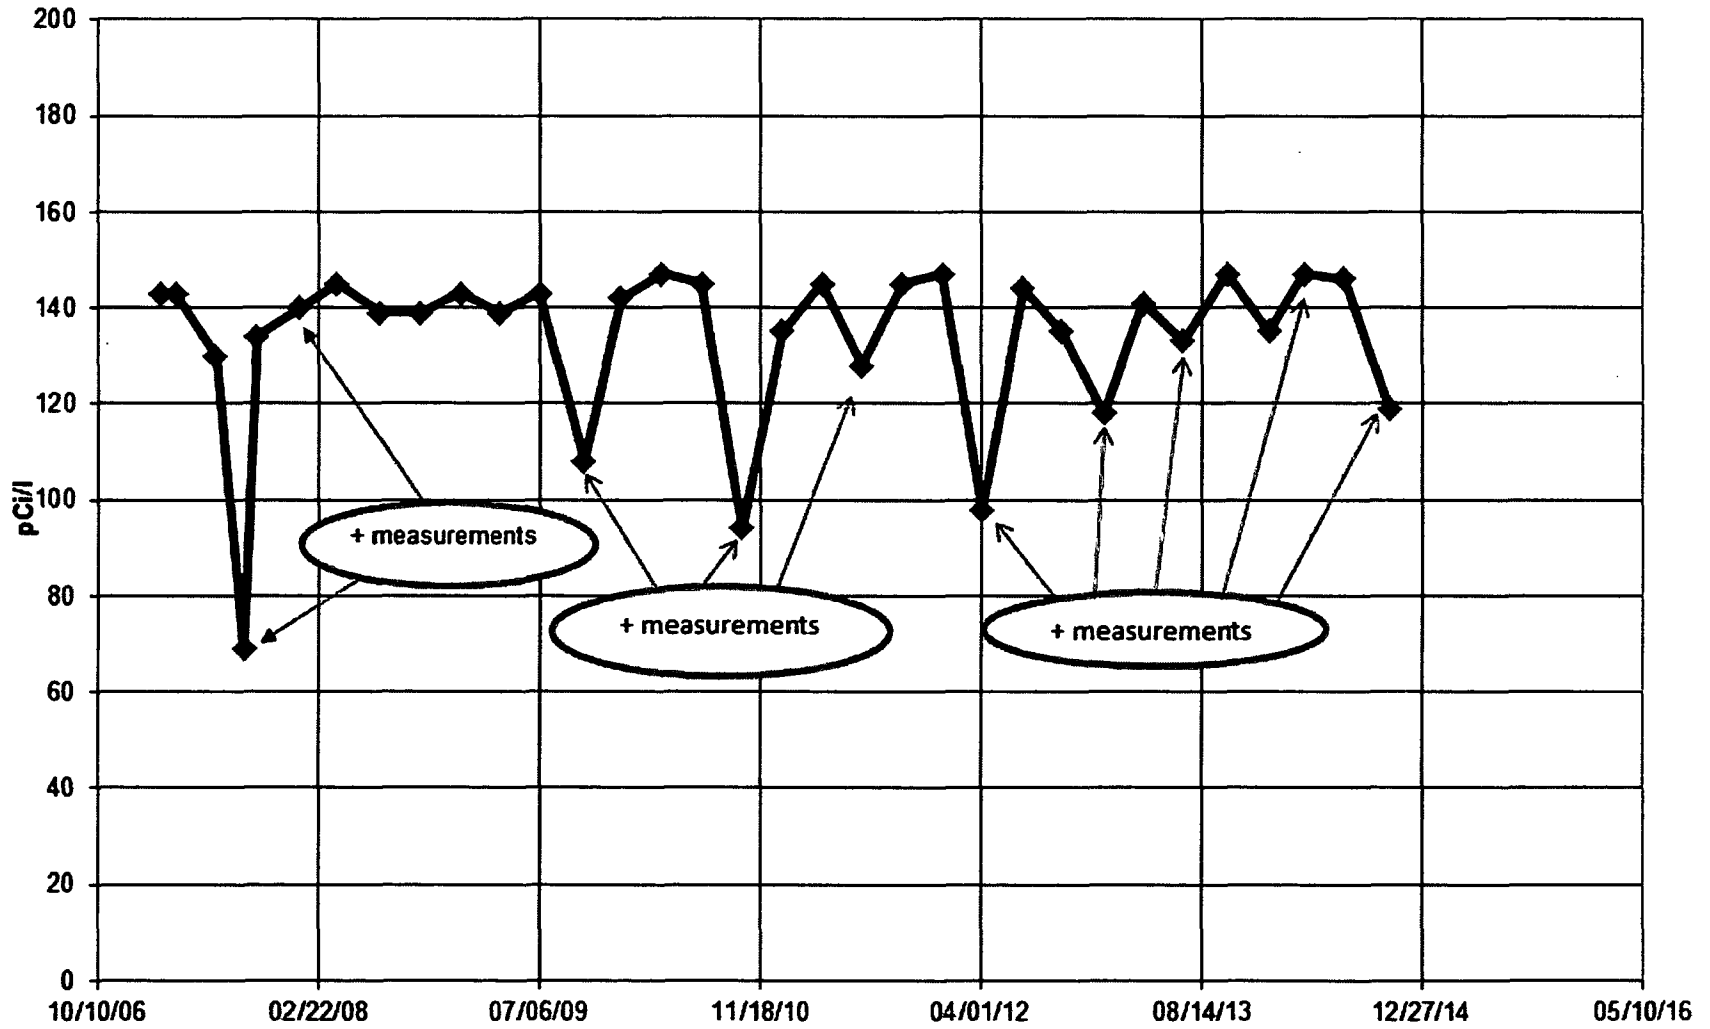

### Tritium Measurements GW Well # CR3-7

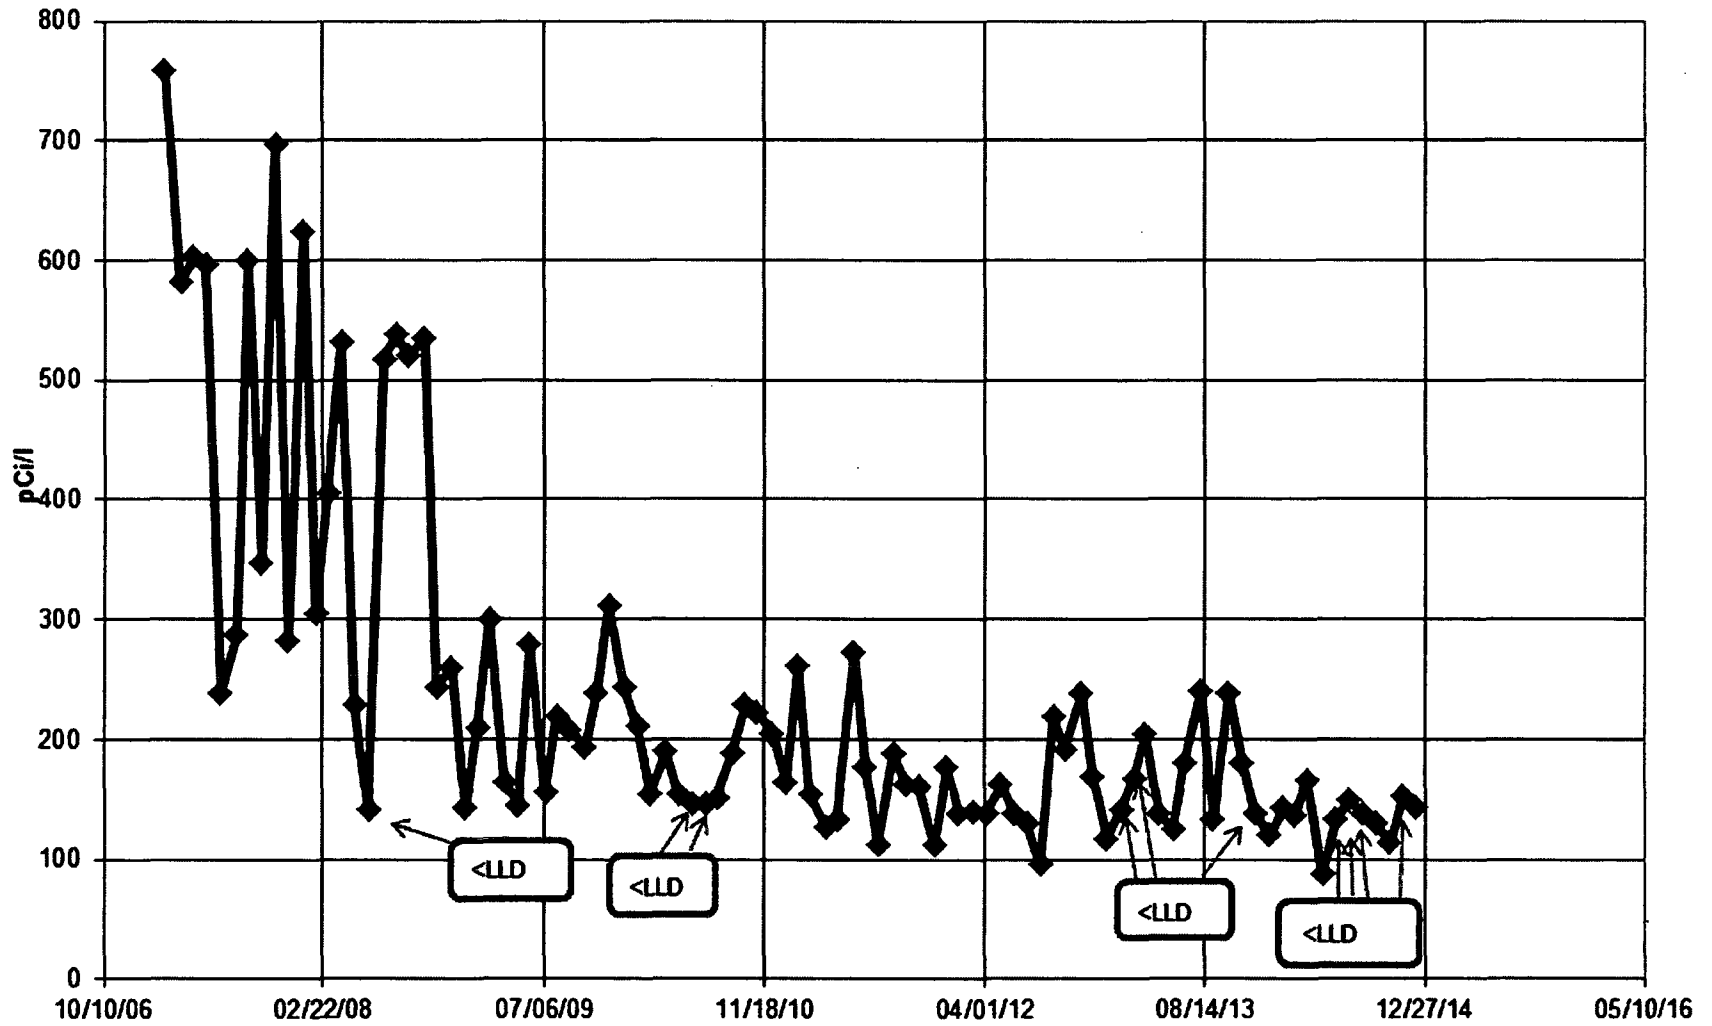


### Tritium Measurements GW Well # CR3-8

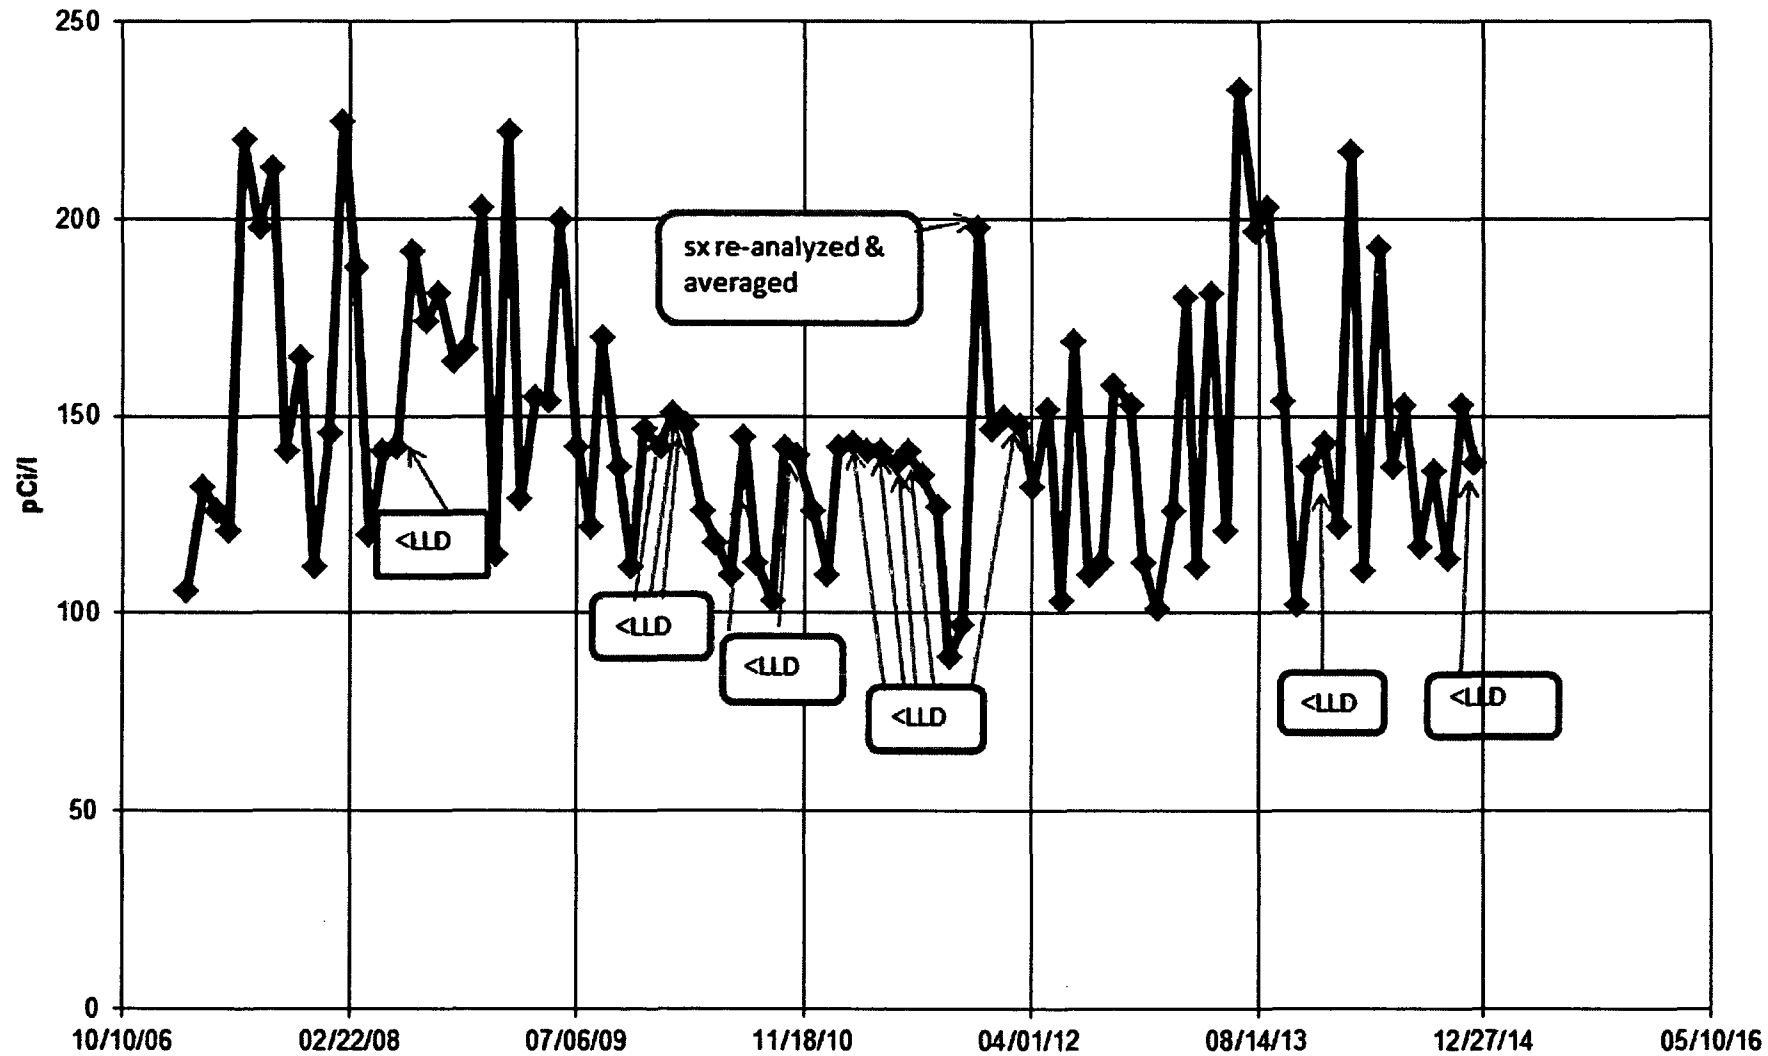



### Tritium Measurements GW Well # CR3-9

All results are < LLD unless noted

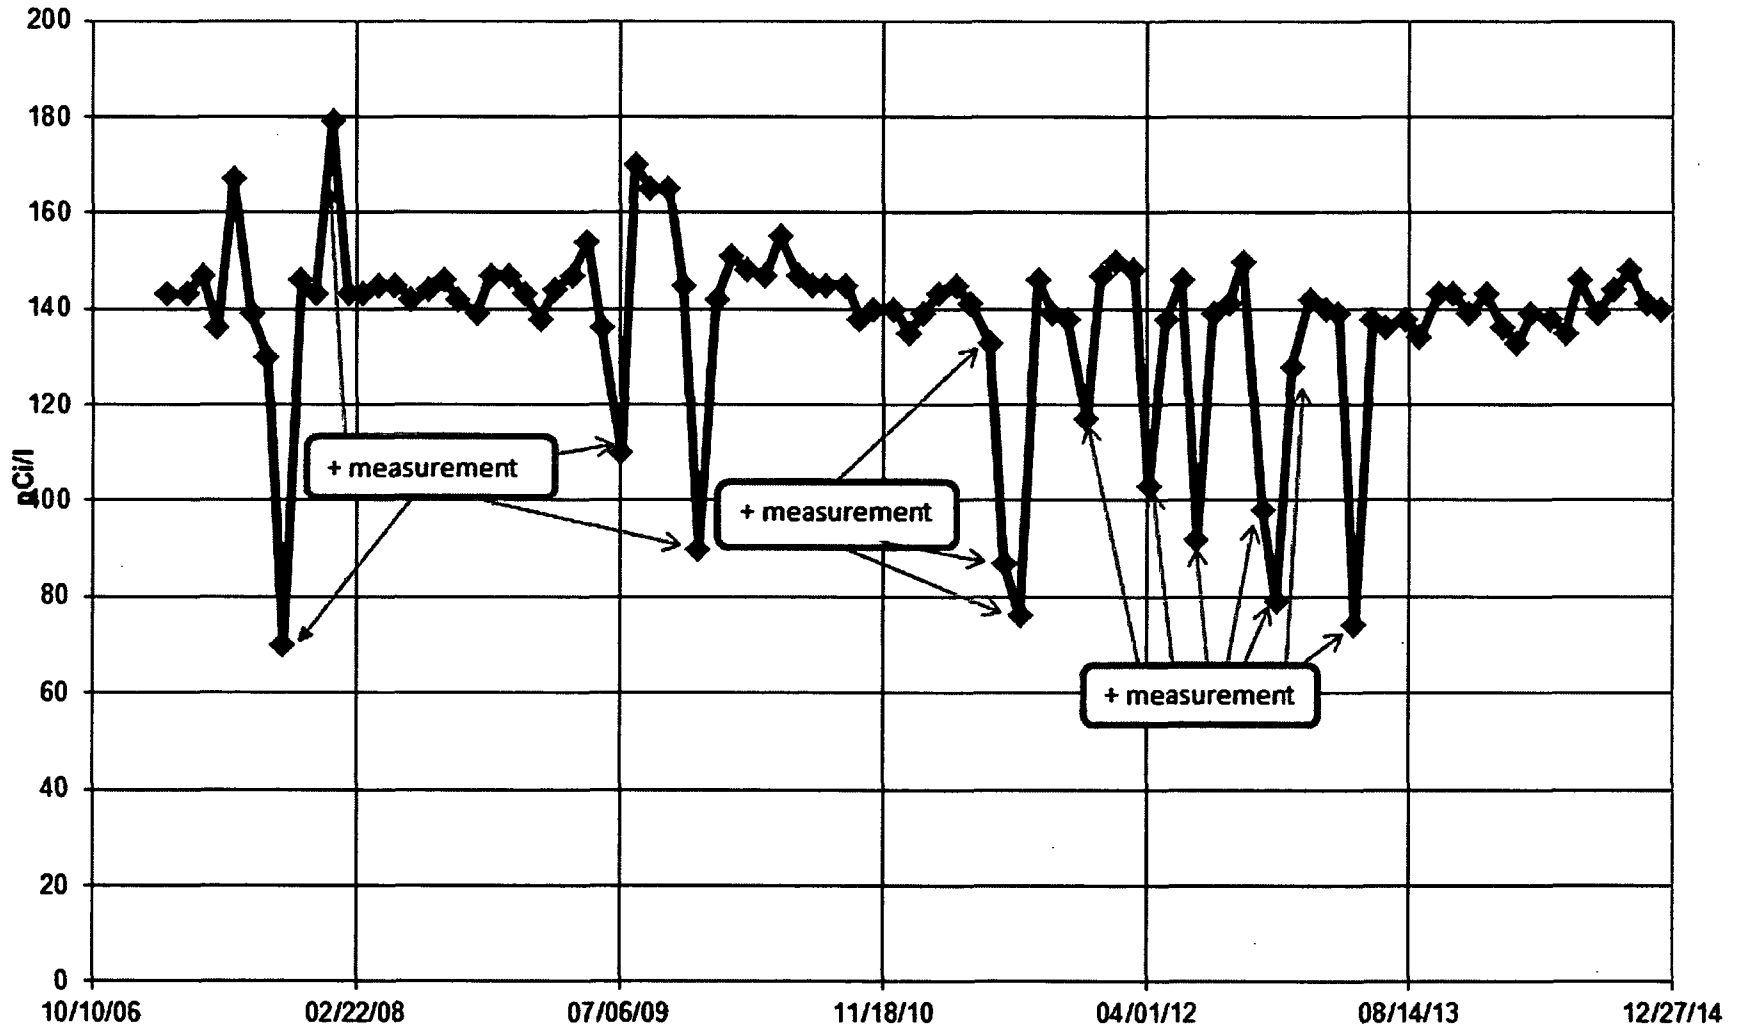

### Tritium Measurements GW Well # CR3-10

All results are < LLD unless noted

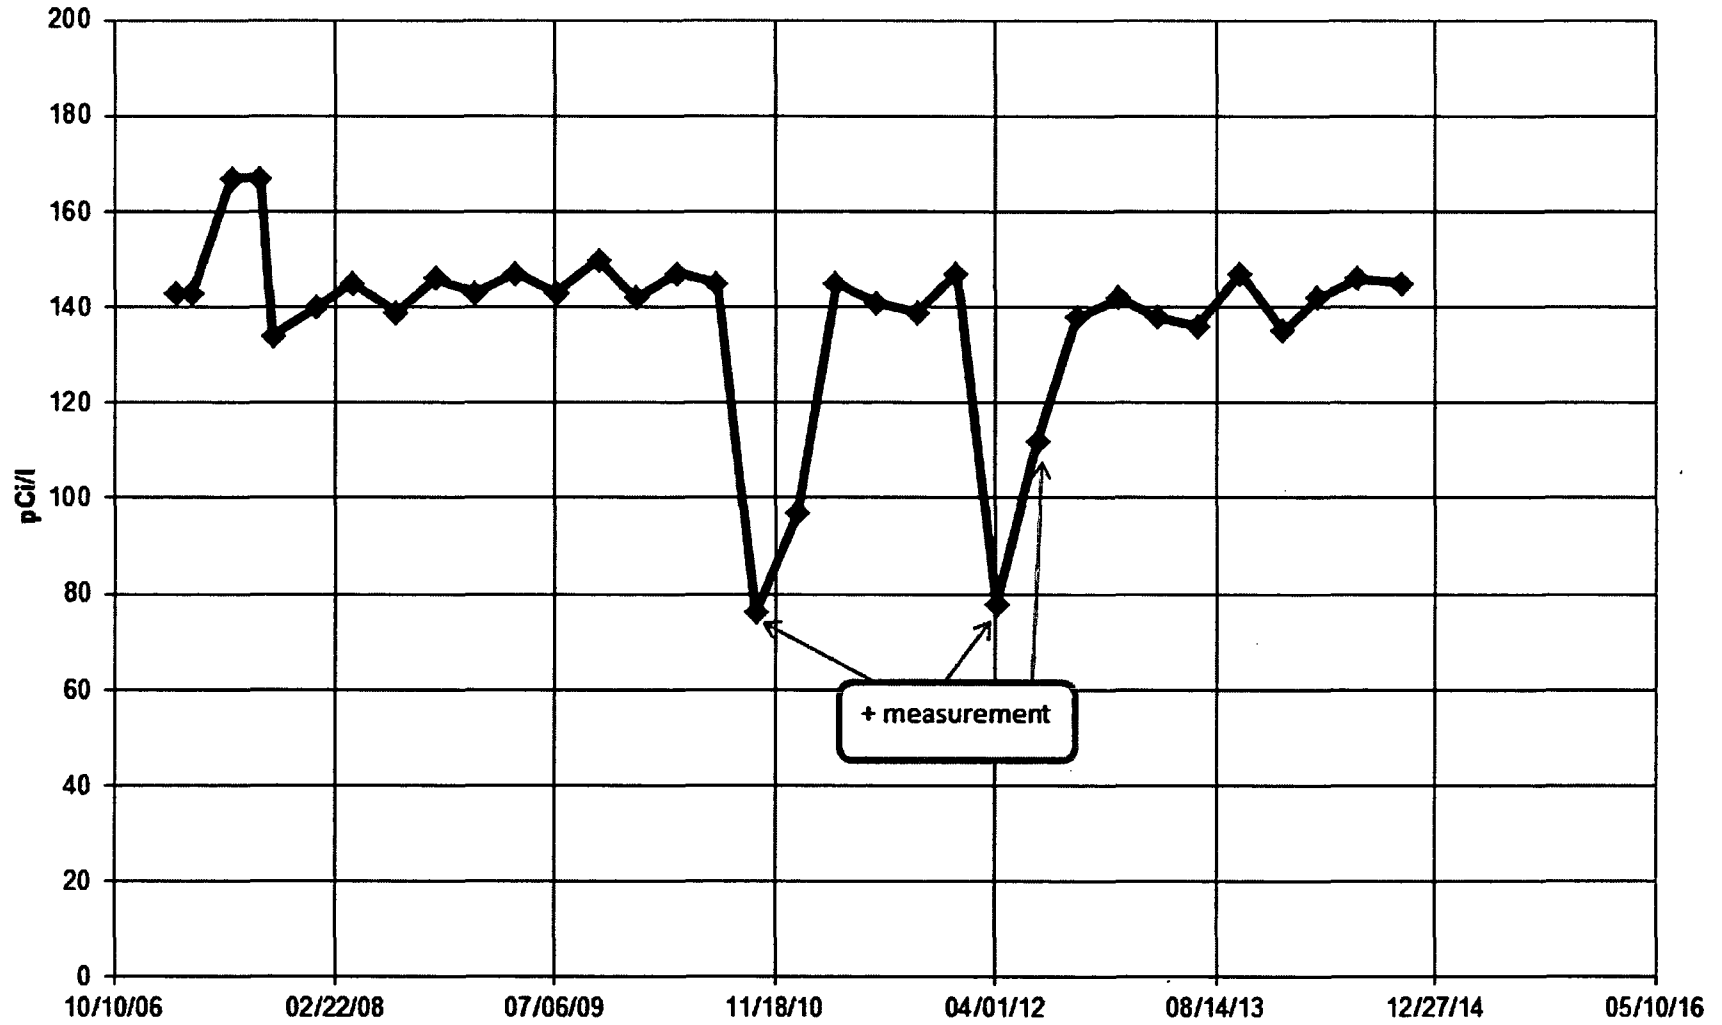


TABLE IV-C.4

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

CRYSTAL RIVER UNIT 3

DOCKET NO. 50-302

CITRUS COUNTY, FLORIDA

JANUARY 1 TO DECEMBER 31, 2014

MEDIUM OR PATHWAY SAMPLED (UNITS)	ANALYSIS AND TOTAL NUMBER OF ANALYSES PERFORMED	LOWER LIMIT OF DETECTION (LLD) <sup>1</sup>	ALL INDICATOR LOCATIONS	LOCATION WITH HIGHEST MEAN		CONTROL LOCATION MEAN RANGE	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
			MEAN RANGE	NAME	MEAN RANGE		
*CR3 SITE GROUND WATER (pCi/L) *	Tritium 24	149	109 (3/24) (87-144)	MWC-IF2	116 (2/12) (87-144)	CR3-2 (<LLD-145)	0
	<u>γ Spec 24</u>			0.30 mi. @266°			
	Mn-54	6	<LLD	-	-	<LLD	0
	Fe-59	10	<LLD	-	-	<LLD	0
	Co-58	6	<LLD	-	-	<LLD	0
	Co-60	8	<LLD	-	-	<LLD	0
	Zn-65	12	<LLD	-	-	<LLD	0
	Zr-Nb-95	11	<LLD	-	-	<LLD	0
	I-131	9	<LLD	-	-	<LLD	0
	Cs-134	6	<LLD	-	-	<LLD	0
	Cs-137	7	<LLD	-	-	<LLD	0
Ba-La-140	13	<LLD	-	-	<LLD	0	

<sup>1</sup>The "a priori" LLD which meets or exceeds the requirements of Table 2-9 of the CR-3 ODCM.

\*Non-REMP required samples

TABLE IV-C.4.a

## DUKE ENERGY FLORIDA, INC. - CR3 - 2014

pCi/L  $\gamma$  EMITTERS AND TRITIUM IN CR3 SITE GROUND WATER (SUPPLEMENTAL DATA)

STATION	DATE	H-3	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Zn-Nb-95	I-131	Cs-134	Cs-137	Ba-La-140
MWC-27*	01-07	<143	<39	<3	<3	<6	<3	<8	<6	<4	<3	<3	<7
	02-07	<136	<43	<3	<3	<6	<3	<7	<5	<5	<4	<4	<6
	03-06	<133	<26	<2	<2	<4	<2	<4	<4	<3	<2	<2	<5
	04-02	<141	<43	<3	<4	<7	<3	<7	<5	<6	<3	<3	<5
	05-08	<138	<44	<4	<4	<6	<4	<8	<6	<5	<4	<7	<12
	06-05	<135	<44	<3	<3	<7	<3	<6	<5	<5	<3	<3	<5
	07-03	<146	<41	<3	<3	<7	<3	<7	<5	<6	<3	<3	<5
	08-06	<139	<50	<4	<4	<8	<4	<9	<6	<5	<4	<4	<8
	09-04	<144	<39	<3	<3	<6	<3	<6	<6	<5	<3	<3	<5
	10-06	<148	<50	<3	<4	<7	<3	<9	<6	<5	<3	<4	<6
	11-07	<141	<42	<3	<3	<7	<3	<8	<6	<6	<3	<4	<6
	12-04	97±27	<47	<3	<3	<7	<3	<7	<6	<5	<3	<4	<5

\*= These wells are not officially included in the REMP and are located on either side (north and south) of the site percolation ponds.

TABLE IV-C.4.a(cont'd)


DUKE ENERGY FLORIDA, INC. - CR3 - 2014

pCi/L  $\gamma$  EMITTERS AND TRITIUM IN CR3 SITE GROUND WATER (SUPPLEMENTAL DATA)

STATION	DATE	H-3	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Zn-Nb-95	I-131	Cs-134	Cs-137	Ba-La-140
MWC-IF2*	01-07	<143	<47	<3	<3	<7	<3	<7	<6	<5	<3	<3	<6
	02-07	<135	<76	<6	<6	<10	<8	<12	<11	<9	<6	<6	<10
	03-06	<133	<41	<3	<3	<6	<3	<6	<5	<3	<3	<3	<9
	04-02	144±46	<51	<3	<3	<6	<3	<7	<5	<5	<3	<3	<6
	05-08	<138	<43	<3	<4	<7	<4	<7	<6	<4	<3	<4	<13
	06-05	<135	<28	<2	<2	<4	<2	<5	<3	<3	<2	<2	<5
	07-03	<146	<75	<5	<4	<9	<7	<8	<9	<8	<5	<6	<8
	08-06	<149	<45	<3	<3	<7	<3	<8	<6	<4	<3	<4	<8
	09-04	<144	<42	<3	<3	<6	<3	<6	<5	<5	<3	<3	<5
	10-06	<148	<51	<3	<3	<7	<3	<6	<6	<5	<3	<3	<5
	11-07	<140	<44	<3	<3	<5	<3	<7	<6	<6	<3	<3	<6
	12-04	87±27	<28	<2	<2	<4	<2	<4	<3	<2	<2	<2	<7

\*= These wells are not officially included in the REMP and are located on either side (north and south) of the site percolation ponds.

### Tritium Measurements GW Well # MWC-27

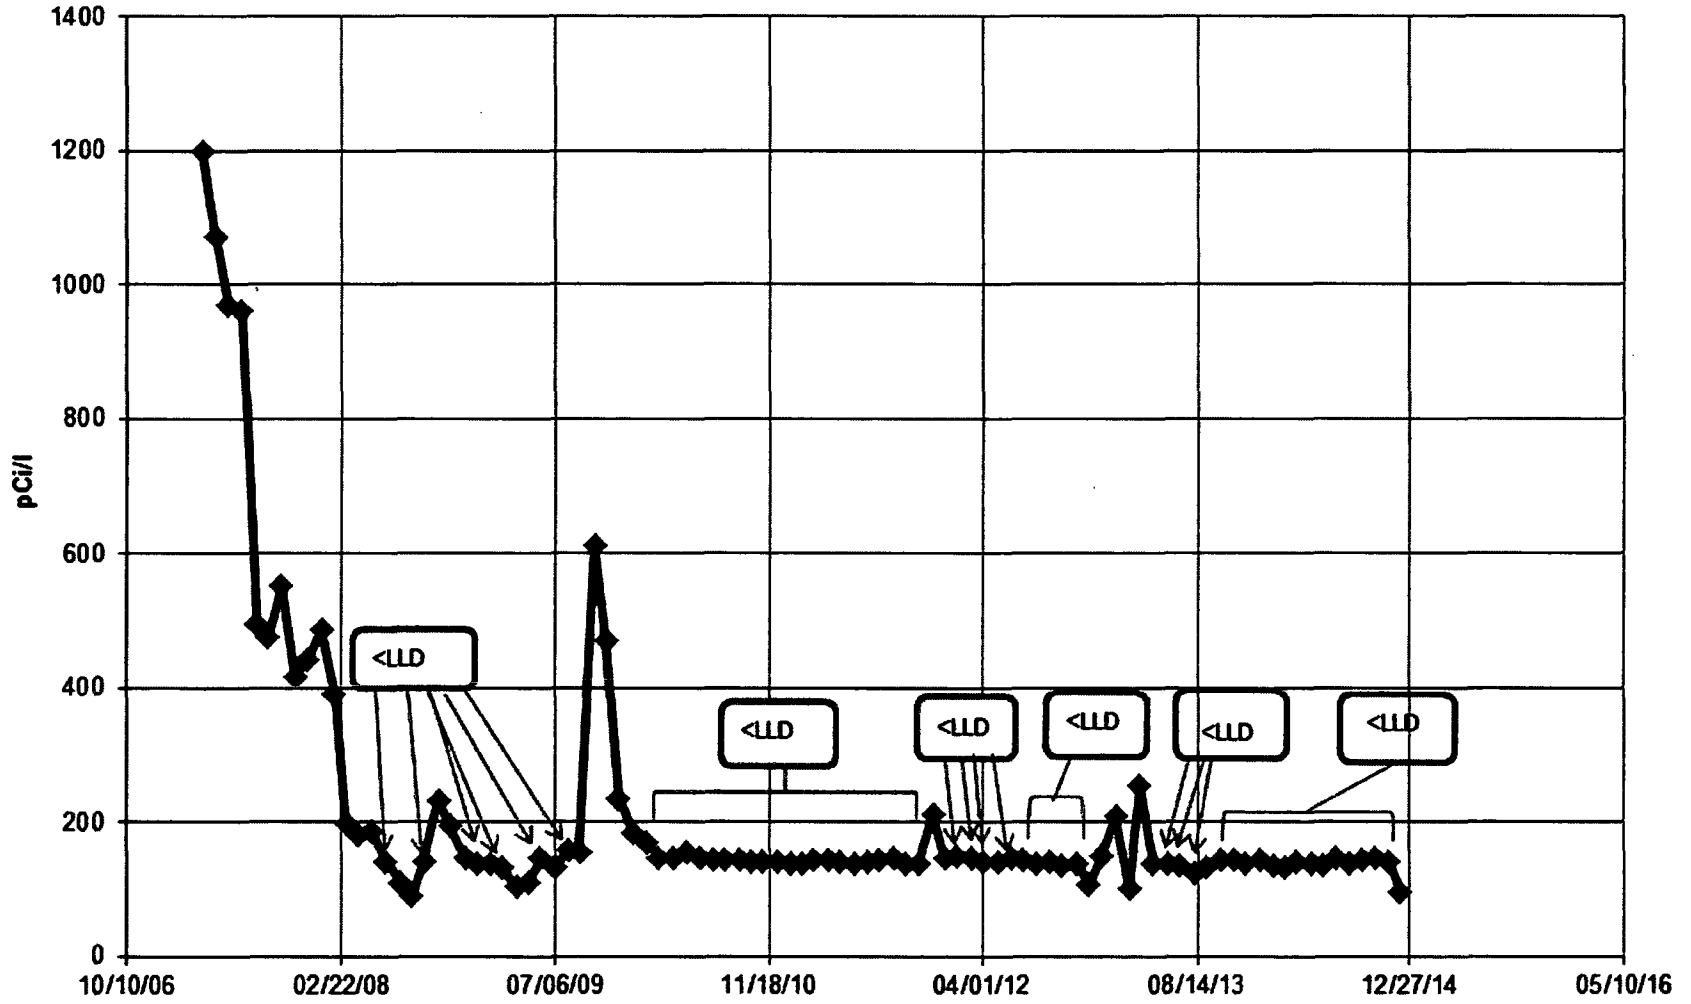

### Tritium Measurements GW Well # MWC-IF2

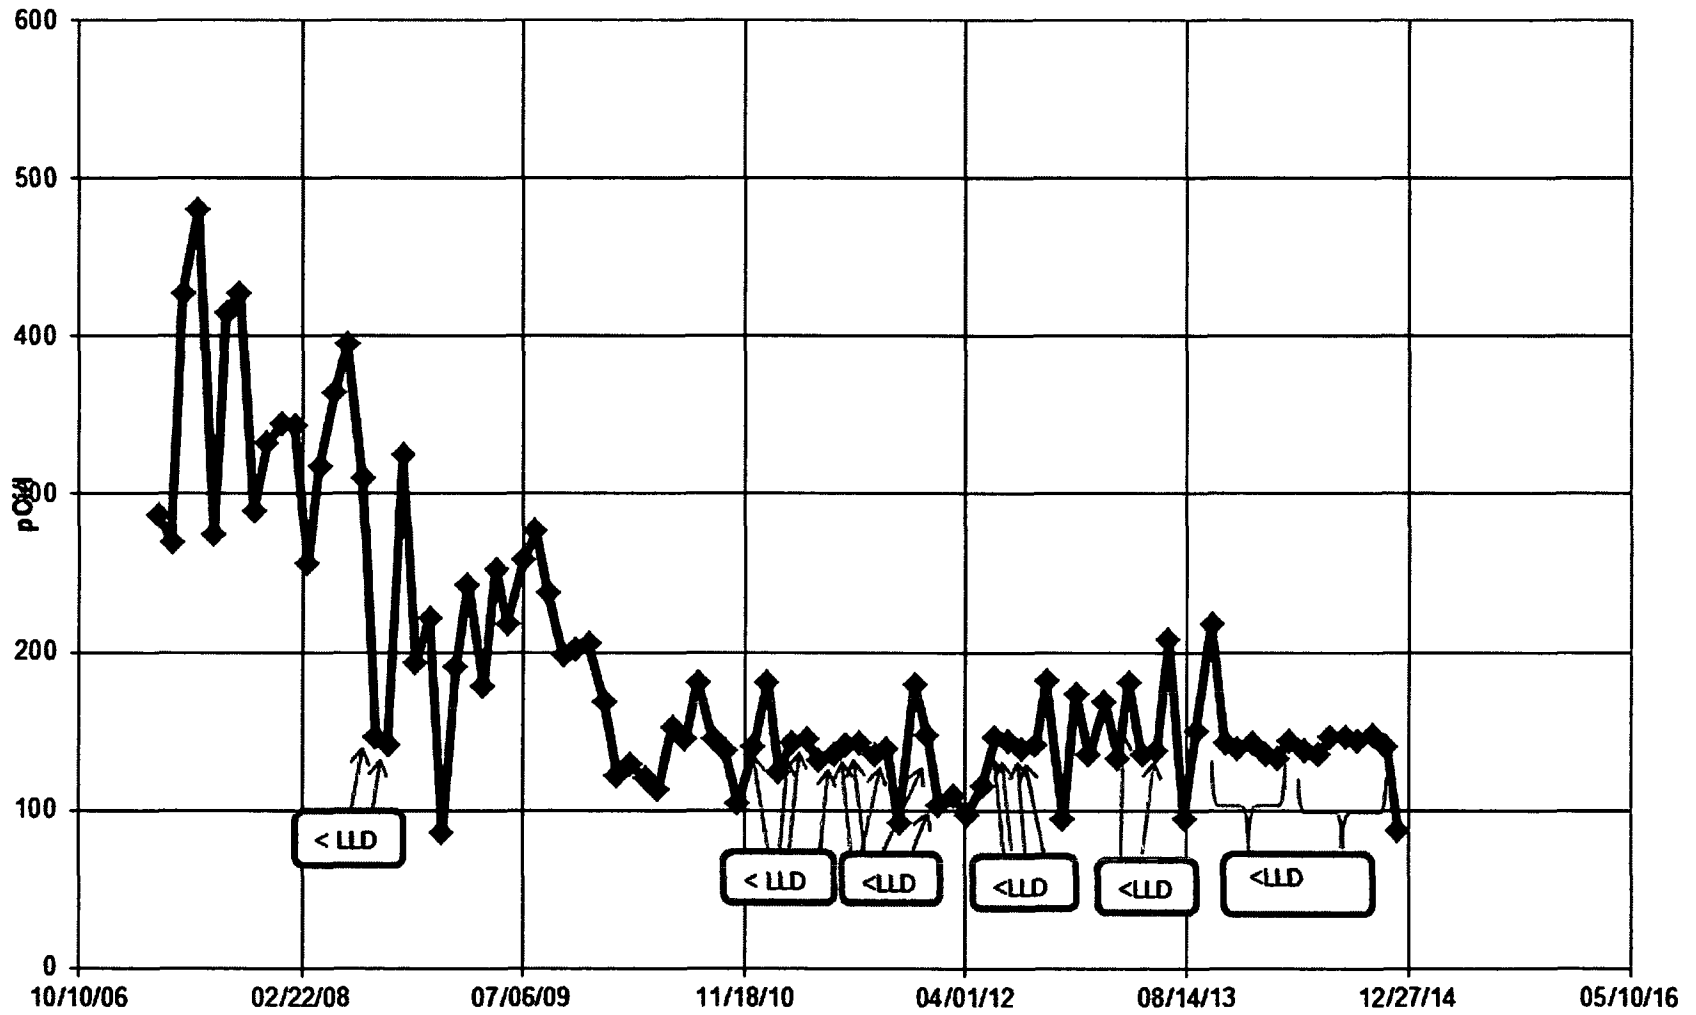






TABLE IV-C.5.a

DUKE ENERGY FLORIDA, INC. - CR3 - 2014

pCi/L  $\gamma$  EMITTERS AND TRITIUM IN DRINKING WATER

STATION	DATE	H-3	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Zn-Nb-95	I-131	Cs-134	Cs-137	Ba-La-140
C07	01-06	<143	<64	<4	<4	<8	<6	<9	<8	<6	<4	<6	<11
	04-08	<139	<37	<3	<3	<5	<3	<6	<5	<3	<3	<3	<9
	07-15	<146	<34	<3	<3	<5	<3	<6	<5	<3	<3	<3	<9
	10-14	<145	<69	<4	<4	<11	<7	<10	<8	<6	<5	<6	<11
C10	01-06	<143	<36	<3	<3	<6	<3	<6	<4	<4	<3	<3	<6
	04-08	<141	<24	<2	<2	<4	<2	<5	<4	<2	<2	<2	<7
	07-15	<146	<63	<4	<4	<8	<6	<10	<8	<6	<4	<5	<10
	10-14	<145	<39	<3	<2	<5	<3	<6	<5	<4	<3	<3	<7
C18	01-06	<143	<79	<5	<5	<10	<7	<10	<9	<7	<5	<6	<8
	04-08	<139	<55	<4	<3	<7	<5	<8	<5	<4	<3	<4	<12
	07-15	<146	<63	<4	<5	<11	<7	<9	<7	<6	<5	<6	<10
	10-14	<145	<66	<5	<4	<9	<7	<10	<8	<6	<5	<6	<10

### Quarterly Drinking Water

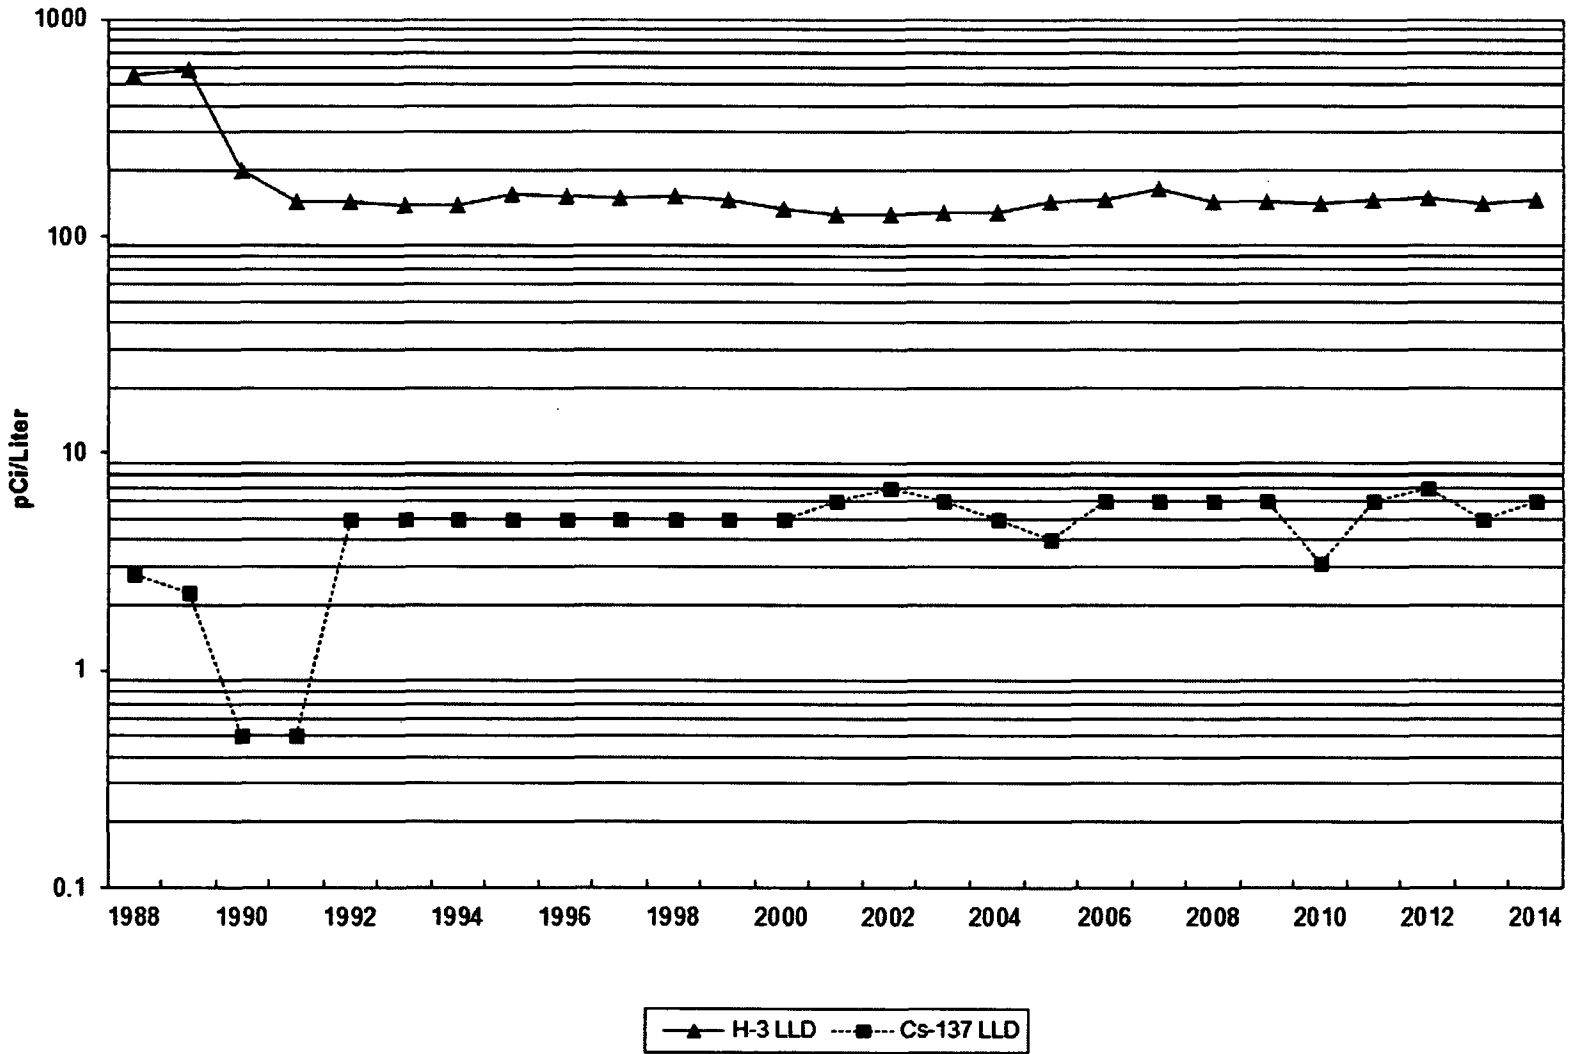


TABLE IV-C.6

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

CRYSTAL RIVER UNIT 3

DOCKET NO. 50-302

CITRUS COUNTY, FLORIDA

JANUARY 1 TO DECEMBER 31, 2014

MEDIUM OR PATHWAY SAMPLED (UNITS)	ANALYSIS AND TOTAL NUMBER OF ANALYSES PERFORMED	LOWER LIMIT OF DETECTION (LLD) <sup>1</sup>	ALL INDICATOR LOCATIONS MEAN RANGE	LOCATION WITH HIGHEST MEAN		CONTROL LOCATION MEAN RANGE	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
				NAME	MEAN RANGE		
SHORELINE SEDIMENT (pCi/kg)	γ Spec 8						
	Cs-134	13	<LLD	—	—	<LLD	0
	Cs-137	15	23 (4/6) (11-57)	C14M 1.2 mi. @ 270°	34 (2/2) (11-57)	<LLD	0


<sup>1</sup>The "a priori" LLD which meets or exceeds the requirements of Table 2-9 of the CR-3 ODCM.

**TABLE IV-C.6.a**  
**DUKE ENERGY FLORIDA, INC. - CR3 - 2014**  
**pCi/kg  $\gamma$  EMITTERS IN SHORELINE SEDIMENT**

STATION	PERIOD	Co-58	Co-60	Cs-134	Cs-137	K-40	Ra-226
C09	First Half	<8	<11	<9	<10	39±23	339±47
	Second Half	<7	<6	<7	<7	203±29	421±35
C14H	First Half	<13	9±2	<13	11±3	705±58	638±259
	Second Half	<8	10±1	<7	<9	354±34	634±45
C14M	First Half	<10	26±2	<9	11±3	1359±74	961±153
	Second Half	<13	47±3	<12	57±4	1422±78	2141±106
C14G	First Half	<13	7±2	<12	<15	315±43	1657±101
	Second Half	<10	<13	<9	11±2	<178	1947±95

C09 is the control station at Ft. Island Beach. C14H, C14M, & C14G are discharge canal stations.

### Shoreline Sediment

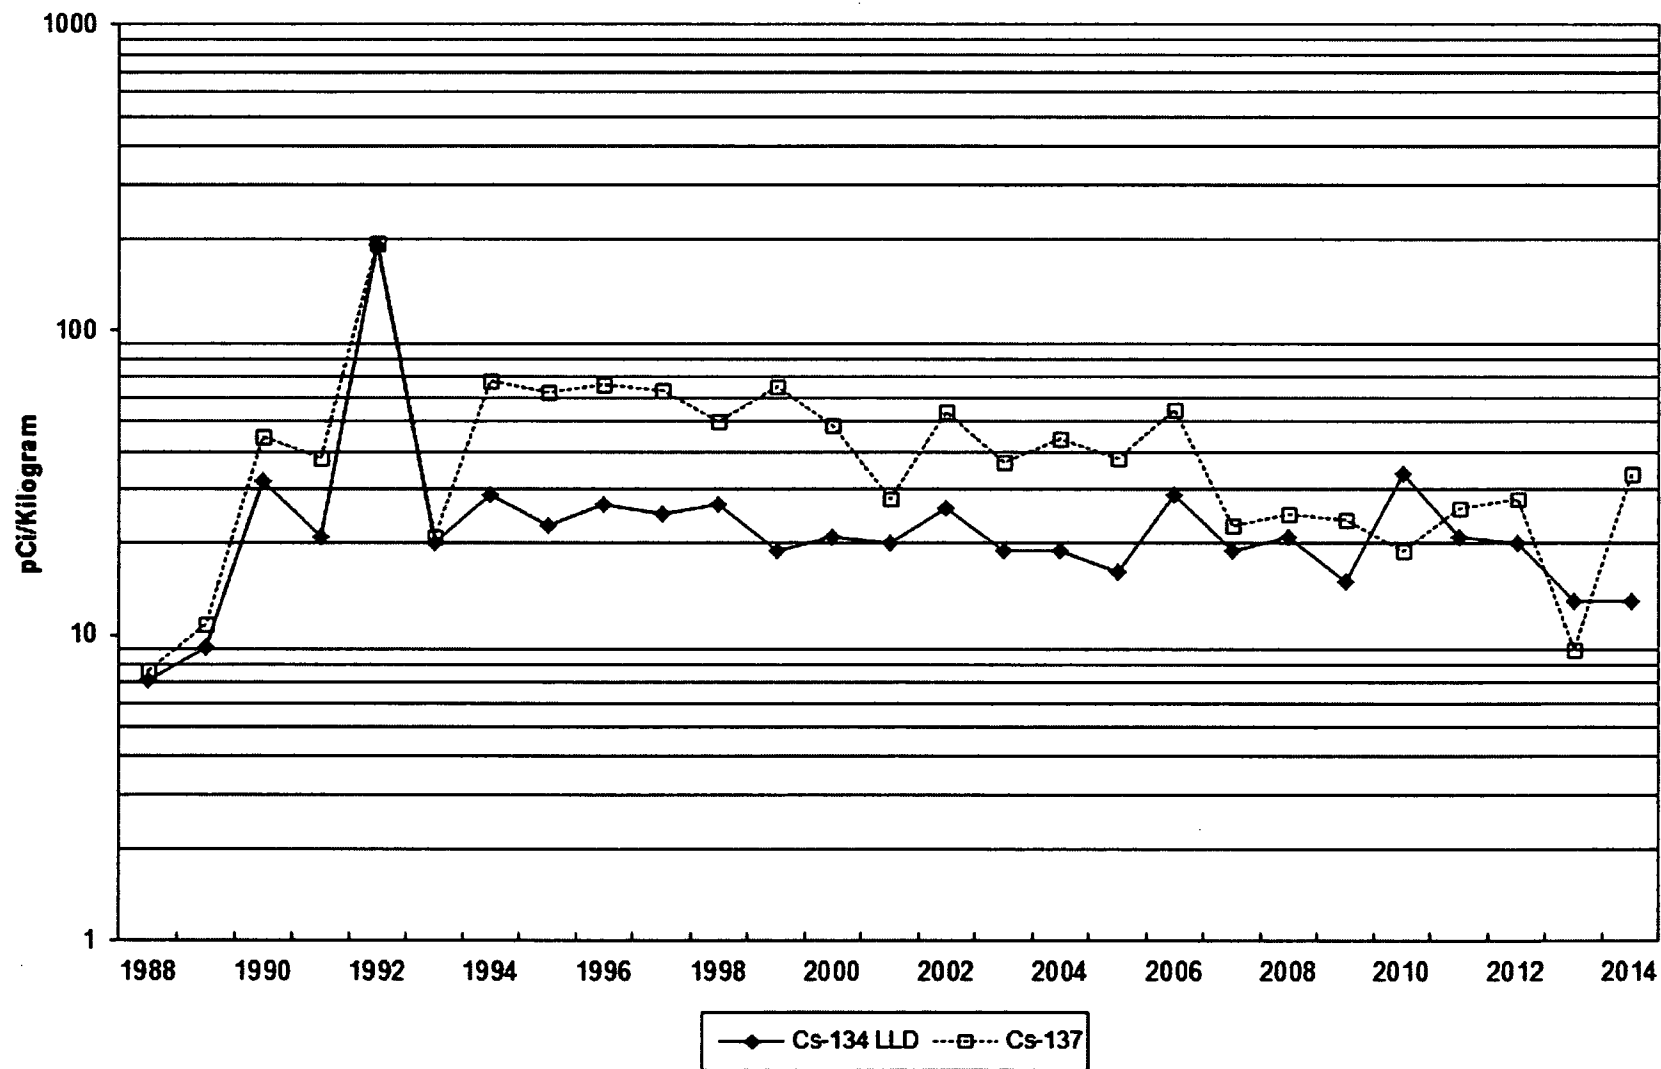

**TABLE IV-C.7 SUPPLEMENTAL DATA  
DUKE ENERGY FLORIDA, INC. - CR3 - 2014**

**pCi/L  $\gamma$  EMITTERS AND TRITIUM IN SITE SETTLING PONDS SURFACE WATER**

STATION	MONTH	H-3	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Zr-Nb-95	I-131	Cs-134	Cs-137	Ba-La-140
31NE	DEC	<148	<38	<3	<2	<5	<4	<6	<5	<3	<3	<3	<6
32NE	DEC	<148	<33	<3	<3	<5	<4	<5	<5	<3	<3	<3	<5

**pCi/kg  $\gamma$  EMITTERS IN SITE SETTLING PONDS SEDIMENT**

STATION	MONTH	Co-58	Co-60	Cs-134	Cs-137	K-40	Ra-226
31NE	DEC	<11	<13	<10	<14	561 $\pm$ 52	1202 $\pm$ 83
31NW	DEC	<15	<16	<14	7 $\pm$ 3	1533 $\pm$ 86	2701 $\pm$ 135
32NE	DEC	<5	<5	<6	<8	<98	425 $\pm$ 34
32NW	DEC	<9	<11	<10	<13	213 $\pm$ 33	513 $\pm$ 60

#### IV-D. INGESTION PATHWAY

To evaluate the ingestion pathway, samples are taken of fish, oysters, broad leaf vegetation, citrus, and watermelon.

1. Quarterly carnivorous fish samples were taken at two locations: C29 at the end of the discharge canal, and C30, the control location, near the mouth of the intake canal. In 2014, none of the required radionuclides were found in measurable quantities. The highest cesium-137 LLD for station C29 was 37 pCi/kg. Naturally occurring potassium-40 was quantified in all eight samples at an average concentration of 2440 pCi/kg.

In 2013, none of the radionuclides of interest were identified in measurable quantities.

In 2012, none of the radionuclides of interest were identified in measurable quantities.

In 2011, none of the radionuclides of interest were identified in measurable quantities.

In 2010, none of the radionuclides of interest were identified in measurable quantities.

Table IV-D.1 provides a statistical summary of the carnivorous fish gamma spectroscopy results.

Table IV-D.1.a provides the results of the quarterly samples.

2. Quarterly oyster samples were taken at the same locations as fish samples, C29 and C30. In 2014, none of the required radionuclides were found in measurable quantities. Additionally, silver-110m was found in one sample at location C29 with a concentration of 35 pCi/kg.

In 2013, none of the required radionuclides were found in measurable quantities. Additionally, silver-110m was not quantified in any sample.

In 2012, of the isotopes required to be evaluated, one sample from station C29 indicated measurable amounts of cesium-137 at a concentration of 22 pCi/L. This value was statistically positive, but is in the range of the analytical LLD. Also, silver-110m was not quantified in any sample.

In 2011, silver-110m was quantified in two samples at C29 with an average concentration of 19 pCi/kg and a range of 14 to 23 pCi/kg. There were no other radionuclides of interest identified in any oyster samples in 2011.

In 2010, silver-110m was not quantified in any oyster samples collected. There were no other radionuclides of interest identified in any oyster samples in 2010.

Table IV-D.2 provides a statistical summary of the oyster gamma spectroscopy results.

Table IV-D.2.a provides the results of the quarterly samples.

3. Monthly broad leaf vegetation samples were taken at two indicator locations, C48A and C48B, and one control location, C47.

In 2014, sixteen of twenty four indicator samples had measurable amounts of cesium-137 with an average concentration of 53 pCi/kg and a range of 4 to 159 pCi/kg. The control station (C47) located in Orlando, FL also had measurable amounts of cesium-137. In 10 of 12 control station samples there were measurable amounts of cesium-137 with an average concentration of 43 pCi/kg and a range of 17 to 71 pCi/kg. The cesium-137 values are similar in concentration as compared to samples collected in 2013 which experienced radionuclide deposition as a result of the Fukushima earthquake event in 2011 and are not a result of the operation of CR3.

In 2013, fifteen of twenty four indicator samples had measurable amounts of cesium-137 with an average concentration of 75 pCi/kg and a range of 5 to 147 pCi/kg. The control station (C47) located in Orlando, FL also had measurable amounts of cesium-137. In twelve of twelve control

station samples there were measurable amounts of cesium-137 at an average concentration of 86 pCi/kg and a range of 14 to 258 pCi/kg. The cesium-137 values are similar in concentration as compared to samples collected in 2012 which experienced radionuclide deposition as a result of the Fukushima earthquake event and are not a result of the operation of CR3.

In 2012, thirteen of twenty four indicator samples had measurable amounts of cesium-137 with an average concentration of 86 pCi/kg and a range of 18 to 172 pCi/kg. The control station (C47) located in Orlando, FL also had measurable amounts of cesium-137. In eight of twelve control station samples there were measurable amounts of cesium-137 at an average concentration of 57 pCi/kg and a range of 16 to 201 pCi/kg. The cesium-137 values are similar in concentration as compared to samples collected in 2011 which experienced radionuclide deposition as a result of the Fukushima earthquake event and are not a result of the operation of CR3.

In 2011, eighteen of twenty four indicator samples had measurable amounts of cesium-137 with an average concentration of 76 pCi/kg and a range of 6 to 233 pCi/kg. Two of twenty four indicator samples also had measurable amounts of iodine-131 with an average of 232 pCi/kg and a range of 195-269 pCi/kg. The control station also had measurable amounts of iodine-131 and cesium-137. In seven of twenty one control station samples, there was measurable I-131 at an average concentration of 324 pCi/kg and a range of 13-1397 pCi/kg. In seventeen of twenty one control station samples there was measurable cesium-137 at an average concentration of 61 pCi/kg and a range of 7 to 182 pCi/kg. Nine extra control samples were collected at the Orlando station location. These positive-measured radionuclides were a result of the Fukushima earthquake and tsunami event that occurred in 2011 and were not from the operation of CR3.

In 2010, five of twenty-four indicator samples had measurable amounts of cesium-137 with an average concentration of 66 pCi/kg and a range of 9 to 153 pCi/kg. This is higher than the levels found in 2009, but lower than in 2007 and 2008. It is believed the 2007 and 2008 spike was due to possible collection of wire grass mixed into the sample, which has a greater uptake rate of cesium as compared to other broad-leafed media. Additionally in 2010, eight of twelve control station samples had measurable amounts of cesium-137 with an average concentration of 21 pCi/kg and a range of 9 to 31 pCi/kg. During 2009 due to construction activities at the Crystal River Unit 4 & 5 site, the area where broad leaf vegetation was being collected at station C48A was removed. A new location in the same north sector was located near the air sample station C46. During 2010, also due to construction activities at the Crystal River Units 4 & 5 site, the area where broadleaf vegetation was being collected at station C48B became inaccessible. A new location in the ENE sector was located near the transmission power line corridor right of way, just NE of the mariculture center. This sector has the same D/Q value as the N and NNE sectors and is allowed by the ODCM.

Table IV-D.3 provides a statistical summary of the broad leaf vegetation gamma spectroscopy results.

Table IV-D.3.a provides the results of the monthly samples.

4. In 2014 watermelon samples were collected at station C04. None of the required radionuclides were found in measurable quantities. Citrus samples (oranges and grapefruit) were collected at station C19. None of the required radionuclides were found in measurable quantities in the citrus samples with exception of Cs-137 (in grapefruit) at a concentration of 4 pCi/kg. It is not unusual to periodically see Cs-137 in citrus samples due to widespread deposition of Cs-137 from fallout due to past weapons testing and more recent from the Fukushima earthquake and tsunami event that occurred in 2011.

In 2013 watermelon samples were collected at station C04. None of the required radionuclides were found in measurable quantities. Citrus samples were taken at station C19. None of the required radionuclides were found in measurable quantities in the citrus samples with exception of Cs-137 at a concentration of 86 pCi/kg. It is not unusual to periodically see Cs-137 in citrus samples due to widespread deposition of Cs-137 from fallout due to past weapons testing.

In 2012 one watermelon sample was collected at station C04. This sample had no measurable quantities of radionuclides of interest. Citrus samples were taken at station C19. There were no measurable quantities of radionuclides of interest in the citrus samples.



In 2011 two watermelon samples were collected at station C04. One sample had a measurable amount of cesium-137 at a concentration of 14 pCi/kg. All other radionuclides of interest were < LLD. Citrus samples were taken at station C19. There were no measurable quantities of radionuclides of interest in the citrus samples.

In 2010 watermelon samples were collected at station C04. None of the required radionuclides were found in measurable quantities. Citrus samples were taken at station C19. None of the required radionuclides were found in measurable quantities in the citrus samples with exception of Cs-137 at a concentration of 71 pCi/kg.

In 2008 and again in 2009, there were no watermelon samples available at station C04. In these 2 years, due to crop rotation, there were no locally grown watermelons found in any areas nearby the facility and no local commercial harvest performed.

Table IV-D.4 provides a statistical summary of the watermelon and citrus gamma spectroscopy results.

Table IV-D.4.a provides the results of the semi-annual samples.

TABLE IV-D.1

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

CRYSTAL RIVER UNIT 3

DOCKET NO. 50-302

CITRUS COUNTY, FLORIDA

JANUARY 1 TO DECEMBER 31, 2014

MEDIUM OR PATHWAY SAMPLED (UNITS)	ANALYSIS AND TOTAL NUMBER OF ANALYSES PERFORMED	LOWER LIMIT OF DETECTION (LLD) <sup>1</sup>	ALL INDICATOR LOCATIONS	LOCATION WITH HIGHEST MEAN		CONTROL LOCATION MEAN RANGE	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
			MEAN RANGE	NAME	MEAN RANGE		
CARNIVOROUS FISH (pCi/kg)	γ Spec 8						
	Mn-54	34	<LLD	-	-	<LLD	0
	Fe-59	114	<LLD	-	-	<LLD	0
	Co-58	41	<LLD	-	-	<LLD	0
	Co-60	41	<LLD	-	-	<LLD	0
	Zn-65	61	<LLD	-	-	<LLD	0
	Cs-134	30	<LLD	-	-	<LLD	0
	Cs-137	33	<LLD	-	-	<LLD	0

<sup>1</sup>The "a priori" LLD which meets or exceeds the requirements of Table 2-9 of the CR-3 ODCM.

TABLE IV-D.1.a

DUKE ENERGY FLORIDA, INC. - CR3 - 2014

pCi/kg  $\gamma$  EMITTERS IN CARNIVOROUS FISH

STATION	QUARTER	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Cs-134	Cs-137	K-40
C29	1	<19	<18	<39	<15	<49	<24	<23	2979±173
	2	<15	<16	<36	<26	<34	<17	<19	2652±156
	3	<18	<17	<44	<18	<49	<23	<21	1924±151
	4	<27	<28	<51	<40	<60	<27	<30	1941±188
C30	1	<34	<41	<114	<41	<55	<30	<29	2395±211
	2	<26	<28	<66	<42	<63	<28	<31	2318±209
	3	<27	<26	<55	<33	<52	<29	<30	2599±217
	4	<24	<23	<54	<39	<61	<27	<33	2714±220

# Carnivorous Fish

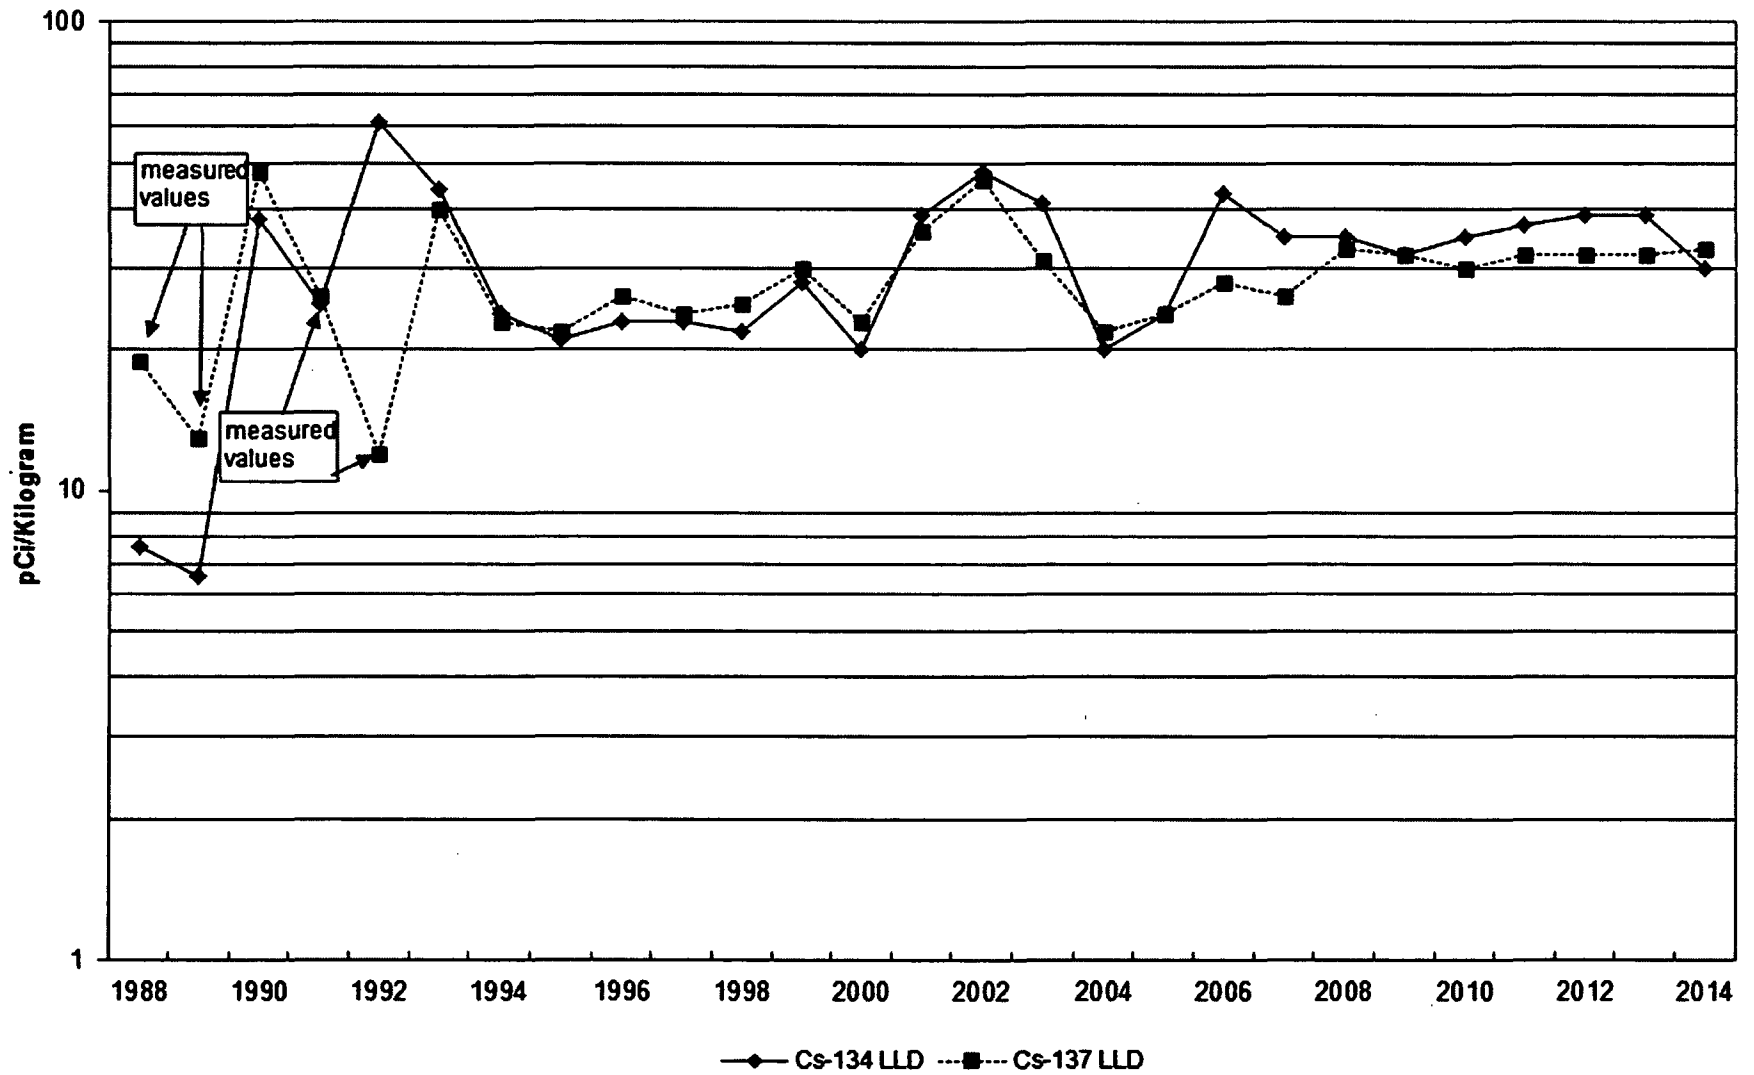


TABLE IV-D.2

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

CRYSTAL RIVER UNIT 3

DOCKET NO. 50-302

CITRUS COUNTY, FLORIDA

JANUARY 1 TO DECEMBER 31, 2014

MEDIUM OR PATHWAY SAMPLED (UNITS)	ANALYSIS AND TOTAL NUMBER OF ANALYSES PERFORMED	LOWER LIMIT OF DETECTION (LLD) <sup>1</sup>	ALL INDICATOR LOCATIONS MEAN RANGE	LOCATION WITH HIGHEST MEAN NAME DISTANCE & BEARING	MEAN RANGE	CONTROL LOCATION MEAN RANGE	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
OYSTERS (pCi/kg)	γ Spec 8						
	Mn-54	21	<LLD	-	-	<LLD	0
	Fe-59	50	<LLD	-	-	<LLD	0
	Co-58	22	<LLD	-	-	<LLD	0
	Co-60	25	<LLD	-	-	<LLD	0
	Zn-65	47	<LLD	-	-	<LLD	0
	Cs-134	23	<LLD	-	-	<LLD	0
	Cs-137	22	<LLD	-	-	<LLD	0

<sup>1</sup>The "a priori" LLD which meets or exceeds the requirements of Table 2-9 of the CR-3 ODCM.

**TABLE IV-D.2.a**  
**DUKE ENERGY FLORIDA, INC. - CR3 - 2014**

**pCi/kg  $\gamma$  EMITTERS IN OYSTERS**

STATION	QUARTER	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Cs-134	Cs-137	K-40
C29	1	<18	<19	<40	<21	<38	<20	<19	1023±101
	2	<11	<12	<26	<11	<25	<12	<14	945±69
	3	<20	<21	<40	<19	<45	<21	<22	540±83
	4	<19	<20	<41	<21	<46	<19	<22	1356±128
C30	1	<20	<17	<38	<17	<47	<20	<22	858±96
	2	<15	<17	<35	<25	<32	<17	<12	698±82
	3	<19	<19	<43	<18	<38	<23	<19	419±78
	4	<21	<22	<50	<19	<37	<22	<20	623±97

# Oysters

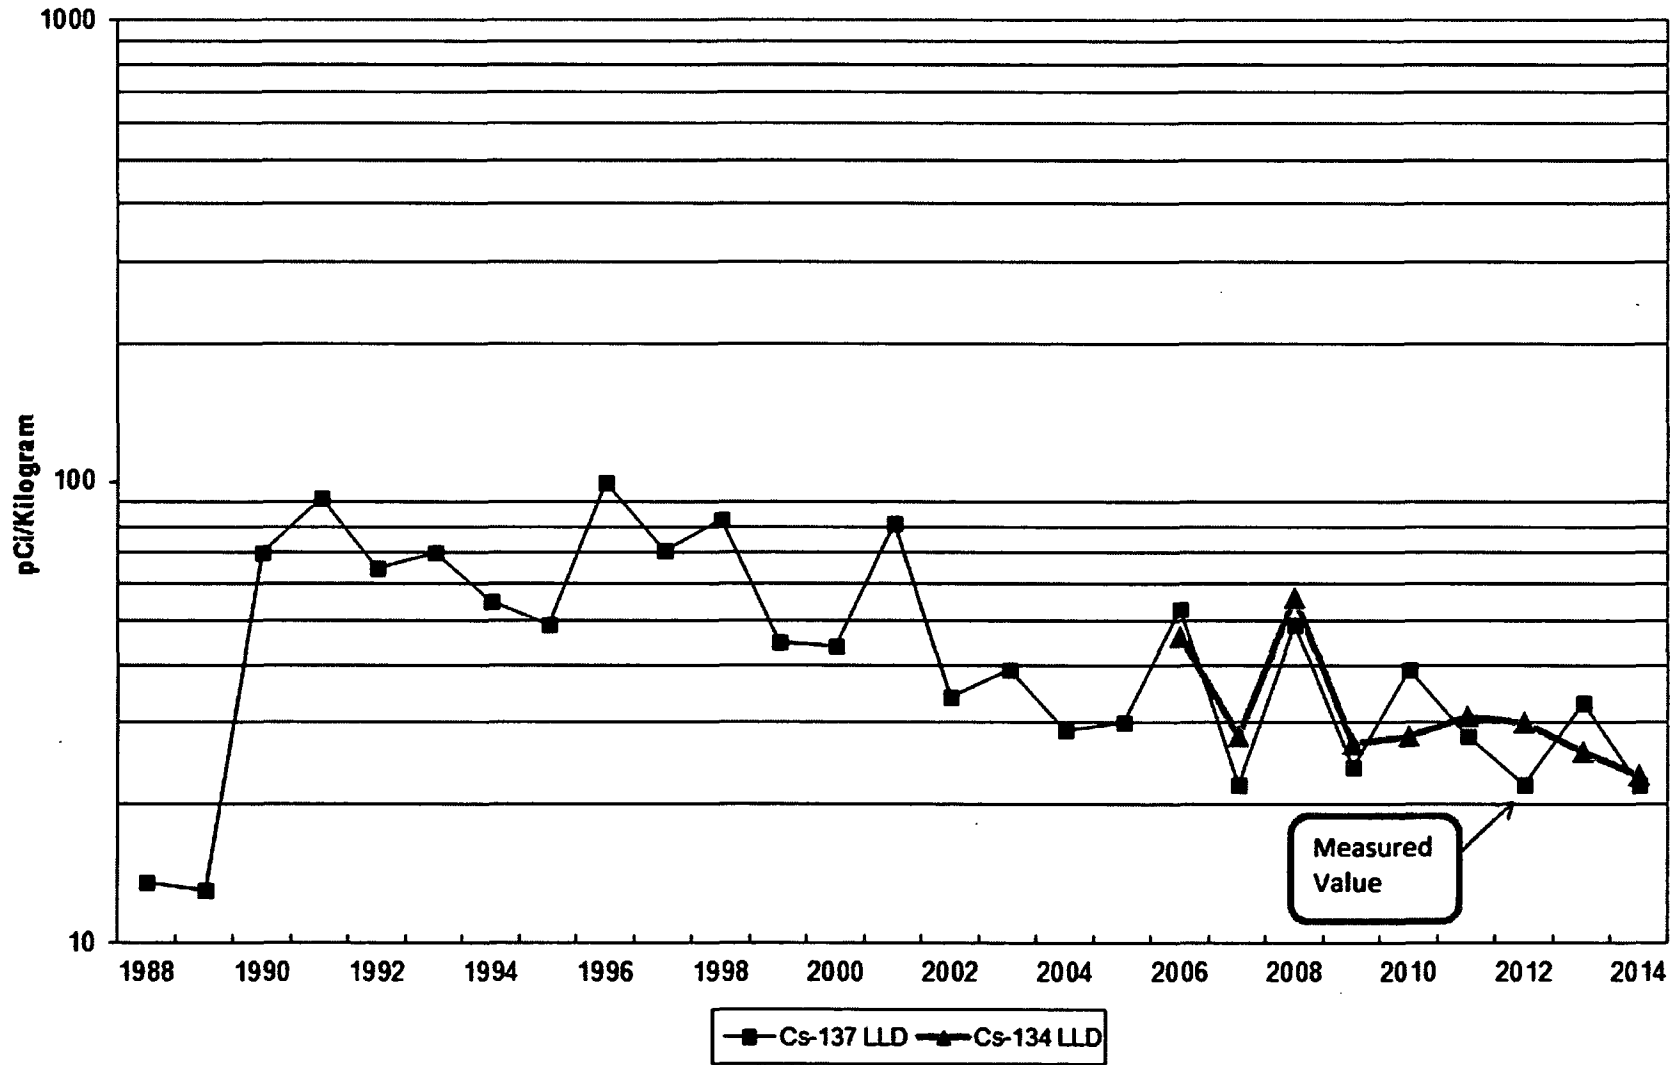


TABLE IV-D.3

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

CRYSTAL RIVER UNIT 3

DOCKET NO. 50-302

CITRUS COUNTY, FLORIDA

JANUARY 1 TO DECEMBER 31, 2014

MEDIUM OR PATHWAY SAMPLED (UNITS)	ANALYSIS AND TOTAL NUMBER OF ANALYSES PERFORMED	LOWER LIMIT OF DETECTION (LLD) <sup>1</sup>	ALL INDICATOR LOCATIONS MEAN RANGE	LOCATION WITH HIGHEST MEAN NAME DISTANCE & BEARING	MEAN RANGE	CONTROL LOCATION MEAN RANGE	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
BROAD LEAF VEGETATION (pCi/kg)	γ Spec 36						
	I-131	22	<LLD	-	-	<LLD	0
	Cs-134	15	<LLD	-	-	<LLD	0
	Cs-137 <sup>2</sup>	18	53 (16/24) (4-159)	C48B 0.9 @ 73°	68(12/12) (22-159)	43 (10/12) (17-71)	0

<sup>1</sup>The "a priori" LLD which meets or exceeds the requirements of Table 2-9 of the CR-3 ODCM.

<sup>2</sup>The elevated Cs-137 values are not associated with the operation of CR3 and are a direct result of the Fukushima earthquake and tsunami event that occurred in 2011.



TABLE IV-D.3.a

## DUKE ENERGY FLORIDA, INC. - CR3 - 2014

pCi/kg OF  $\gamma$  EMITTERS IN BROAD LEAF VEGETATION

STATION	MONTH	I-131	Cs-134	Cs-137	K-40
C47	JAN	<16	<14	35±4	2288±133
	FEB	<8	<8	55±4	2523±116
	MAR	<9	<9	17±2	3090±135
	APR	<22	<13	19±4	3523±166
	MAY	<14	<12	28±4	2480±137
	JUN	<16	<10	71±5	2217±113
	JUL	<18	<16	<18	1832±123
	AUG	<15	<12	65±5	1580±104
	SEP	<9	<7	28±3	1735±89
	OCT	<16	<12	44±5	2467±137
	NOV	<15	<13	69±6	2212±133
	DEC	<16	<13	<18	3419±172
C48A	JAN	<9	<8	<11	1692±92
	FEB	<9	<9	4±1	1635±88
	MAR	<14	<12	<16	2027±115
	APR	<18	<15	<16	4246±195
	MAY	<14	<14	<17	3165±161
	JUN	<9	<7	<9	2712±116
	JUL	<16	<13	<16	2953±157
	AUG	<6	<6	7±1	2942±113
	SEP	<16	<12	<16	2371±132
	OCT	<14	<13	14±3	2236±128
	NOV	<9	<9	6±2	2153±111
	DEC	<10	<8	<10	1492±76

**TABLE IV-D.3.a (CONT'D)**  
**DUKE ENERGY FLORIDA, INC. - CR3 - 2014**  
**pCi/kg OF  $\gamma$  EMITTERS IN BROAD LEAF VEGETATION**

STATION	MONTH	I-131	Cs-134	Cs-137	K-40
C48B	JAN	<18	<13	93±7	1708±115
	FEB	<15	<14	70±6	1698±114
	MAR	<9	<10	159±7	2976±137
	APR	<19	<15	52±6	2605±148
	MAY	<16	<13	83±7	3210±166
	JUN	<15	<12	88±6	3190±144
	JUL	<17	<14	71±6	2644±151
	AUG	<9	<9	29±3	2049±103
	SEP	<10	<7	27±3	2161±109
	OCT	<14	<14	52±5	1825±117
	NOV	<15	<14	68±6	2576±147
	DEC	<11	<9	22±2	1282±81

The elevated Cs-137 values are a direct result of the Fukushima earthquake and tsunami event that occurred in 2011 and are not associated with CR-3 operation.

# Broad Leaf Vegetation

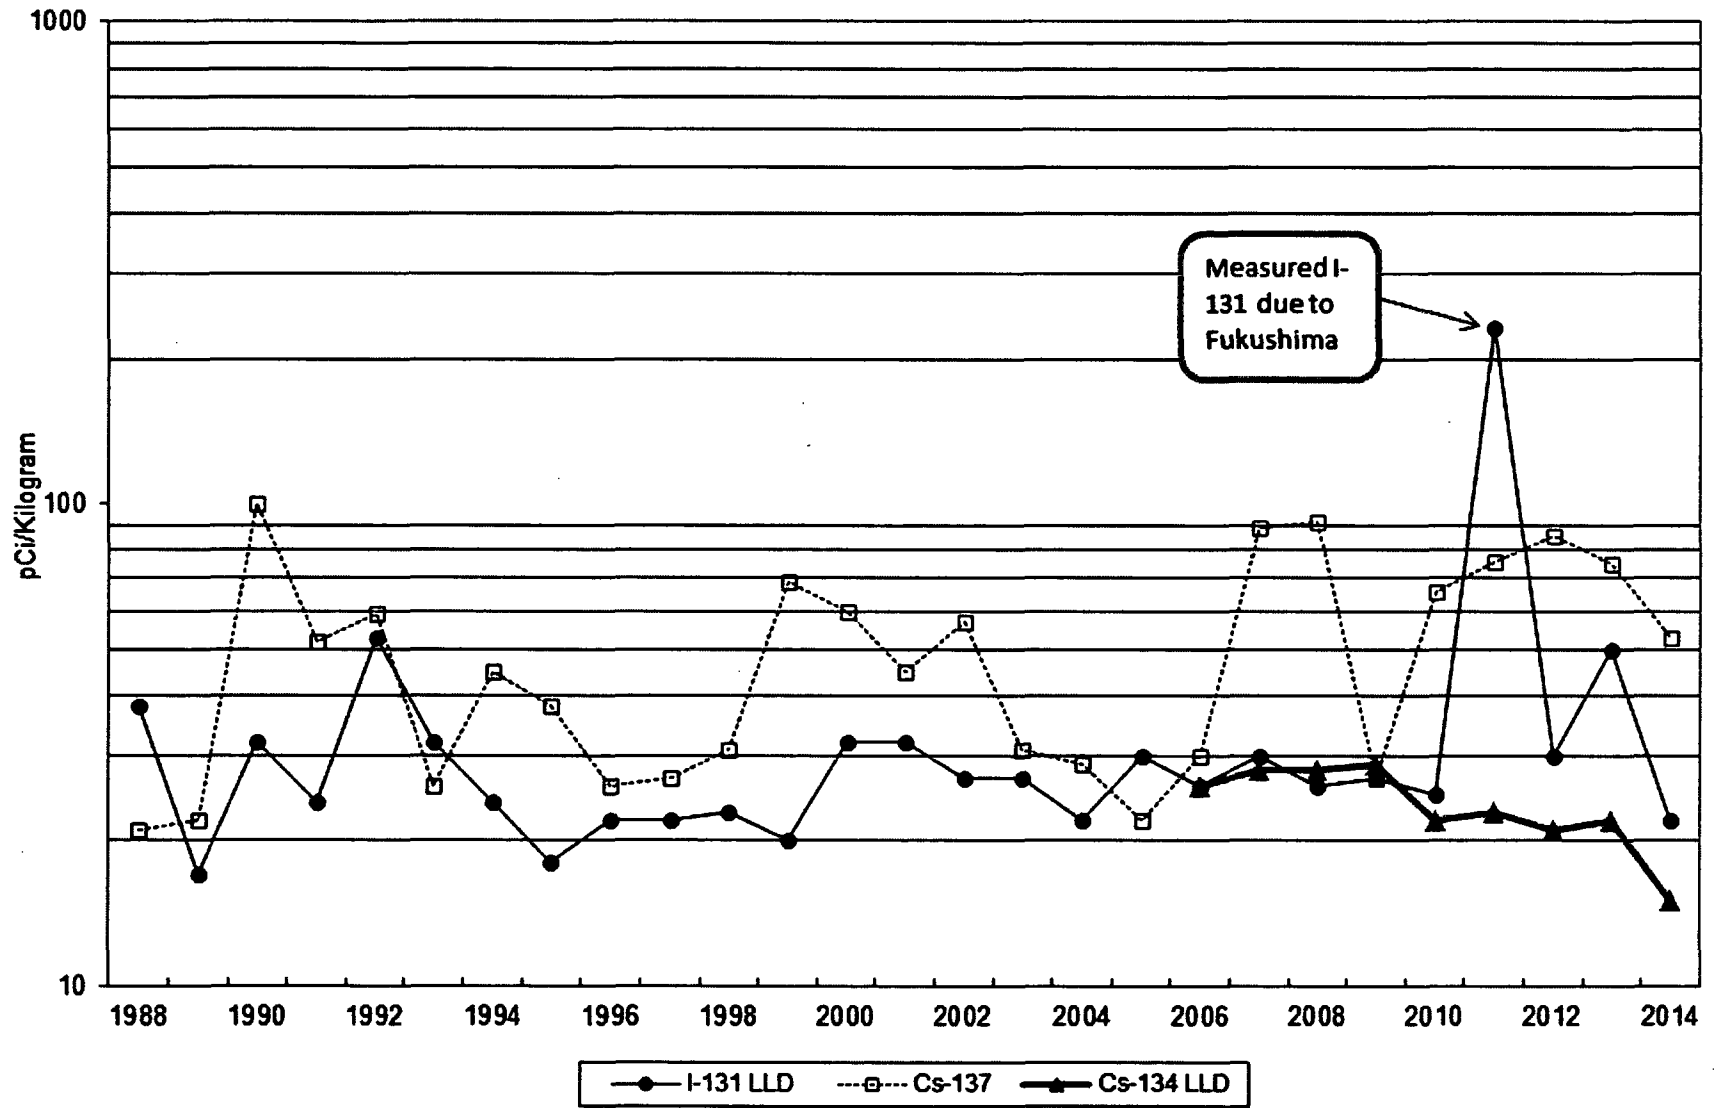


TABLE IV-D.4

## RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

CRYSTAL RIVER UNIT 3

DOCKET NO. 50-302

CITRUS COUNTY, FLORIDA

JANUARY 1 TO DECEMBER 31, 2014

MEDIUM OR PATHWAY SAMPLED (UNITS)	ANALYSIS AND TOTAL NUMBER OF ANALYSES PERFORMED	LOWER LIMIT OF DETECTION (LLD) <sup>1</sup>	ALL INDICATOR LOCATIONS	LOCATION WITH HIGHEST MEAN		CONTROL LOCATION MEAN RANGE	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
			MEAN RANGE	NAME DISTANCE & BEARING	MEAN RANGE		
WATERMELON (pCi/kg)	γ Spec 1						
	I-131	4	< LLD	-	-	None	0
	Cs-134	4	< LLD	-	-	None	0
	Cs-137	4	< LLD	-	-	None	0
CITRUS (pCi/kg)	γ Spec 2						
	I-131	6	<LLD	-	-	None	0
	Cs-134	6	<LLD	-	-	None	0
	Cs-137	4	4(1/2) (4)	C19 9.6 mi. @ 30°	4(1/2) (4)	None	0

<sup>1</sup>The "a priori" LLD which meets or exceeds the requirements of Table 2-9 of the CR-3 ODCM.

TABLE IV-D.4.a

DUKE ENERGY FLORIDA, INC. - CR3 - 2014

pCi/kg OF  $\gamma$  EMITTERS IN WATERMELON AND CITRUS

STATION	MONTH	I-131	Cs-134	Cs-137	K-40
C04 – Watermelon	June	<4	<4	<4	1380±65
C19 – Citrus (Oranges)	February	<4	<3	<4	1381±60
C19 – Citrus (Grapefruit)	February	<6	<6	4±1	1469±71