



LaSalle County Station
2601 North 21st Road
Marseilles, IL 61341
815-415-2000 Telephone
www.exeloncorp.com

RA21-031

10 CFR 50 Appendix I

May 13, 2021

U. S. Nuclear Regulatory Commission
Attention: Document Control Desk
Washington, D.C. 20555

LaSalle County Station, Units 1 and 2
Renewed Facility Operating License Nos. NPF-11 and NPF-18
NRC Docket Nos. 50-373 and 50-374

Subject: 2020 Annual Radiological Environmental Operating Report

Enclosed is the Exelon Generation Company, LLC, 2020 Annual Radiological Environmental Operating Report for LaSalle County Station, submitted in accordance with Technical Specifications 5.6.2, "Annual Radiological Environmental Operating Report." The enclosed report contains the results of groundwater monitoring conducted in accordance with Exelon's Radiological Groundwater Protection Program, which is a voluntary program implemented in 2006. This information is being reported in accordance with a nuclear industry initiative.

There are no regulatory commitments in this letter. Should you have any questions concerning this report, please contact Mr. Daniel Mearhoff, Regulatory Assurance Manager, at (815) 415-2800.

Respectfully,

A handwritten signature in blue ink, appearing to read "John J. Washko".

John J. Washko
Site Vice President
LaSalle County Station

Enclosure: LaSalle County Station Units 1 and 2 Annual Radiological Environmental Operating Report 1 January through 31 December 2020

cc: Regional Administrator - NRC Region III
NRC Senior Resident Inspector - LaSalle County Station

Docket No: 50-373
50-374

LASALLE COUNTY STATION UNITS 1 and 2

Annual Radiological
Environmental Operating Report

1 January through 31 December 2020

Prepared By
Teledyne Brown Engineering
Environmental Services



LaSalle County Station
Marseilles, IL 61341

May 2021

Intentionally left blank

Table Of Contents

I. Summary and Conclusions	1
II. Introduction.....	2
A. Objectives of the REMP.....	2
B. Implementation of the Objectives	2
III. Program Description.....	3
A. Sample Collection.....	3
B. Sample Analysis	5
C. Data Interpretation	5
D. Program Exceptions	6
E. Program Changes	8
IV. Results and Discussion	9
A. Aquatic Environment	9
1. Surface Water	9
2. Ground/Well Water	9
3. Fish	10
4. Sediment.....	10
B. Atmospheric Environment	10
1. Airborne	10
a. Air Particulates.....	10
b. Airborne Iodine.....	11
2. Terrestrial.....	11
a. Milk.....	11
b. Food Products.....	12
c. Vegetation	12
C. Ambient Gamma Radiation	12
D. Land Use Census.....	12
E. Errata Data	13
F. Summary of Results – Inter-laboratory Comparison Program.....	13

Appendices

Appendix A Radiological Environmental Monitoring Report Annual Summary

Tables

Table A-1 Radiological Environmental Monitoring Program Annual Summary for the LaSalle County Station, 2020

Appendix B Location Designation, Distance & Direction, and Sample Collection & Analytical Methods

Tables

Table B-1 Radiological Environmental Monitoring Program - Sampling Locations, Distance and Direction, LaSalle County Station, 2020

Table B-2 Radiological Environmental Monitoring Program - Summary of Sample Collection and Analytical Methods, LaSalle County Station, 2020

Figures

Figure B-1 Inner Ring OSLD Locations of the LaSalle County Station, 2020

Figure B-2 Outer Ring OSLD Locations and Fixed Air Sampling Locations of the LaSalle County Station, 2020

Figure B-3 Ingestion and Waterborne Exposure Pathway Sample Locations of the LaSalle County Station, 2020

Appendix C Data Tables and Figures - Primary Laboratory

Tables

Table C-I.1 Concentrations of Gross Beta in Surface Water Samples Collected in the Vicinity of LaSalle County Station, 2020

Table C-I.2 Concentrations of Tritium in Surface Water Samples Collected in the Vicinity of LaSalle County Station, 2020

Table C-I.3 Concentrations of Gamma Emitters in Surface Water Samples Collected in the Vicinity of LaSalle County Station, 2020

Table C-II.1 Concentrations of Tritium in Ground/Well Water Samples Collected in the Vicinity of LaSalle County Station, 2020

Table C-II.2 Concentrations of Gamma Emitters in Ground/Well Water Samples Collected in the Vicinity of LaSalle County Station, 2020

Table C-III.1	Concentrations of Gamma Emitters in Fish Samples Collected in the Vicinity of LaSalle County Station, 2020
Table C-IV.1	Concentrations of Gamma Emitters in Sediment Samples Collected in the Vicinity of LaSalle County Station, 2020
Table C-V.1	Concentrations of Gross Beta in Air Particulate Samples Collected in the Vicinity of LaSalle County Station, 2020
Table C-V.2	Monthly and Yearly Mean Values of Gross Beta Concentrations in Air Particulate Samples Collected in the Vicinity of LaSalle County Station, 2020
Table C-V.3	Concentrations of Gamma Emitters in Air Particulate Samples Collected in the Vicinity of LaSalle County Station, 2020
Table C-VI.1	Concentrations of I-131 in Air Iodine Samples Collected in the Vicinity of LaSalle County Station, 2020
Table C-VII.1	Concentrations of I-131 in Milk Samples Collected in the Vicinity of LaSalle County Station, 2020
Table C-VII.2	Concentrations of Gamma Emitters in Milk Samples Collected in the Vicinity of LaSalle County Station, 2020
Table C-VIII.1	Concentrations of Gamma Emitters in Food Product Samples Collected in the Vicinity of LaSalle County Station, 2020
Table C-VIII.2	Concentrations of Gamma Emitters in Vegetation Samples Collected in the Vicinity of LaSalle County Station, 2020
Table C-IX.1	Quarterly DLR Results for LaSalle County Station, 2020

Figures

Figure C-1	Surface Water - Gross Beta – Stations L-21 (C) and L-40 Collected in the Vicinity of LSCS, 2005 - 2020
Figure C-2	Surface Water - Tritium – Stations L-21 (C) and L-40 Collected in the Vicinity of LSCS, 2005 - 2020
Figure C-3	Air Particulate - Gross Beta – Stations L-01 and L-03 Collected in the Vicinity of LSCS, 2005 - 2020
Figure C-4	Air Particulate - Gross Beta – Stations L-05 and L-06 Collected in the Vicinity of LSCS, 2005 - 2020
Figure C-5	Air Particulate - Gross Beta – Station L-10 (C) Collected in the Vicinity of LSCS, 2005 - 2020
Figure C-6	Air Particulate - Gross Beta – Stations L-04 and L-07 Collected in the Vicinity of LSCS, 2005 – 2020
Figure C-7	Air Particulate - Gross Beta – Stations L-08 and L-11 Collected in the Vicinity of LSCS, 2005 - 2020
Figure C-8	Air Particulate - Gross Beta – Station L-11A Collected in the Vicinity of LSCS, 2016 - 2020

Appendix D Inter-Laboratory Comparison Program

Tables

Table D-1 Analytics Environmental Radioactivity Cross Check Program
Teledyne Brown Engineering Environmental Services, 2020

Table D-2 DOE's Mixed Analyte Performance Evaluation Program (MAPEP)
Teledyne Brown Engineering Environmental Services, 2020

Table D-3 ERA Environmental Radioactivity Cross Check Program
Teledyne Brown Engineering Environmental Services, 2020

Appendix E Effluent Data

Appendix F Meteorological Data

Appendix G Errata Data

Appendix H Annual Radiological Groundwater Protection Program Report
(ARGPPR)

I. Summary and Conclusions

This report on the Radiological Environmental Monitoring Program conducted for the LaSalle County Station (LSCS) by Exelon covers the period 1 January 2020 through 31 December 2020. During that time period, 1,325 analyses were performed on 1,226 samples. In assessing all the data gathered for this report and comparing these results with preoperational data, it was concluded that the operation of LSCS had no adverse radiological impact on the environment.

Surface water samples were analyzed for concentrations of gross beta, tritium and gamma-emitting nuclides. Ground/well water samples were analyzed for concentrations of tritium and gamma-emitting nuclides. No fission or activation products were detected. Gross beta and tritium activities detected were consistent with those detected in previous years.

Commercially and recreationally important fish species were sampled and analyzed for concentrations of gamma-emitting nuclides. No fission or activation products were detected in fish.

Sediment samples were analyzed for concentrations of gamma-emitting nuclides. No fission or activation products were detected.

Air particulate samples were analyzed for concentrations of gross beta and gamma-emitting nuclides. No fission or activation products were detected.

High sensitivity iodine-131 (I-131) analyses were performed on weekly air samples. All results were less than the minimum detectable activity for I-131.

Cow milk samples were analyzed for concentrations of I-131 and gamma-emitting nuclides. All I-131 results were below the minimum detectable activity. Concentrations of naturally-occurring potassium-40 (K-40) were consistent with those detected in previous years. No fission or activation products were found. All nuclides were below the minimum detectable activity.

Food product samples were analyzed for concentrations of gamma-emitting nuclides. No fission or activation products were detected.

Vegetation samples were analyzed for concentrations of gamma-emitting nuclides. No fission or activation products were detected.

Environmental gamma radiation measurements were performed quarterly using Optically Stimulated Luminescence Dosimeters (OSLD) for the Radiological Environmental Monitoring Program (REMP). The results from the environmental gamma radiation monitoring program were consistent with those detected in previous years.

II. Introduction

The LaSalle County Station (LSCS), consists of two boiling water reactors, each rated for 3,546 MWt. Both units are owned and operated by Exelon Corporation and are located in LaSalle County, Illinois. Unit 1 went critical on 16 March 1982. Unit 2 went critical on 02 December 1983. The site is located in northern Illinois, approximately 75 miles southwest of Chicago, Illinois.

A Radiological Environmental Monitoring Program (REMP) for LSCS was initiated in 1982 (the preoperational period for most media covers the periods 1 January 1979 through 26 December 1981 and was summarized in a separate report.). This report covers those analyses performed by Teledyne Brown Engineering (TBE) and Landauer on samples collected during the period 1 January 2020 through 31 December 2020.

A. Objectives of the REMP

The objectives of the REMP are to:

1. Provide data on measurable levels of radiation and radioactive materials in the site environs.
2. Evaluate the relationship between quantities of radioactive material released from the plant and resultant radiation doses to individuals from principal pathways of exposure.

B. Implementation of the Objectives

The implementation of the objectives is accomplished by:

1. Identifying significant exposure pathways.
2. Establishing baseline radiological data of media within those pathways.
3. Continuously monitoring those media before and during Station operation to assess Station radiological effects (if any) on man and the environment.

III. Program Description

A. Sample Collection

Samples for the LSCS REMP were collected for Exelon Nuclear by Environmental Inc. (Midwest Labs). This section describes the general collection methods used by Environmental Inc. (Midwest Labs) to obtain environmental samples for the LSCS REMP in 2020. Sample locations and descriptions can be found in Tables B-1 and B-2, and Figures B-1 through B-3, Appendix B.

Aquatic Environment

The aquatic environment was evaluated by performing radiological analyses on samples of surface water, ground/well water, fish, and sediment. Two gallon water samples were collected weekly from two surface water locations (L-21 and L-40) and composited for monthly and quarterly required analyses. Control location was L-21. Two ground/well water locations (L-27 and L-28) were also grab sampled quarterly. All samples were collected via grab sample. The samples were then transferred to new unused plastic containers. Both the grab container and the sample containers were rinsed with source water prior to actual sample collection. Fish samples were collected semiannually at three locations, L-34, L-35 and L-36 (Control). Sediment samples composed of recently deposited substrate were collected at three locations semiannually, L-21 (Control), L-40 and L-41.

Atmospheric Environment

The atmospheric environment was evaluated by performing radiological analyses on samples of airborne particulate and iodine. Airborne particulate and iodine samples were collected and analyzed weekly at nine locations (L-01, L-03, L-04, L-05, L-06, L-07, L-08, L-10, and L-11A). The control location was L-10. Airborne particulate and iodine samples were obtained at each location, using a vacuum pump to pull air through a glass fiber particulate filter and iodine cartridge. The pumps were run continuously and sampled air at the rate of approximately one cubic foot per minute. The particulate filters and iodine cartridges were replaced weekly and sent to the laboratory for analysis.

Terrestrial Environment

The terrestrial environment was evaluated by performing radiological analyses on samples of milk and food product. Samples are typically collected biweekly at one milk location (L-42) from May through September, and monthly from December through April. The control location was L-42. All samples, when available, were collected in new unused two gallon plastic bottles from the bulk tank at each location, preserved with sodium bisulfite, and shipped promptly to the laboratory.

Food products were collected during the growing season at five locations (L-Quad Control, L-Quad 1, L-Quad 2, L-Quad 3 and L-Quad 4). The control location was L-Quad Control. Various types of samples were collected and placed in new unused plastic bags and sent to the laboratory for analysis.

Vegetation samples were collected monthly during the growing season from May through October at three locations (L-Veg C, L-ESE1, and L-ESE2). The control location was L-Veg C and was located in the lowest deposition sector (ENE sector) surrounding LaSalle. Various vegetation samples were also collected in the highest deposition sector (ESE sector) surrounding LaSalle. The samples were collected and placed in new unused plastic bags and sent to the laboratory for analysis.

Ambient Gamma Radiation

Beginning in the first quarter of 2012, Exelon changed the type of dosimetry used for the Radiological Environmental Monitoring Program (REMP). Optically Stimulated Luminescent Dosimetry (OSLD) were deployed and Thermo-luminescent Dosimetry (TLD) were discontinued. This change may cause step changes in readings, up or down, depending on site characteristics. However, the relative comparison to control locations remains valid. OSLD technology is different than that used in a TLD but has the same purpose (to measure direct radiation).

Each location consisted of 2 OSLD sets. The OSLDs were exchanged quarterly and sent to Landauer for analysis. The OSLD locations were placed on and around the LSCS site as follows:

An inner ring consisting of 16 locations (L-101, L-102, L-103, L-104, L-105, L-106, L-107, L-108, L-109, L-110, L-111B, L-112, L-113A, L-114, L-115 and L-116) near and within the site perimeter representing fence post doses (i.e., at locations where the doses will be potentially greater than maximum annual off-site doses from LSCS releases).

An outer ring consisting of 17 locations (L-201, L-202, L-203, L-204, L-205A, L-205B, L-206, L-207, L-208, L-209, L-210, L-211, L-212, L-213, L-214, L-215 and L-216) extending to approximately 5 miles from the site designed to measure possible exposures to nearby population.

An other set consisting of eight locations (L-01, L-03, L-04, L-05, L-06, L-07, L-08, and L-11A).

The balance of one location (L-10) representing the control area.

The specific OSLD locations were determined by the following criteria:

1. The presence of relatively dense population;
2. Site meteorological data taking into account distance and elevation for

each of the sixteen 22 ½ degree sectors around the site, where estimated annual dose from LSCS, if any, would be most significant;

3. On hills free from local obstructions and within sight of the vents (where practical);
4. And near the closest dwelling to the vents in the prevailing downwind direction.

(Two OSLDs were placed at each location approximately six feet above ground level.)

B. Sample Analysis

This section describes the general analytical methodologies used by Environmental Inc. (Midwest Labs) and TBE to collect and analyze, respectively, the environmental samples for radioactivity for the LSCS REMP in 2020. The analytical procedures used by the laboratory are listed in Table B-2.

In order to achieve the stated objectives, the current program includes the following analyses:

1. Concentrations of beta emitters in surface water and air particulates
2. Concentrations of gamma emitters in ground/well and surface water, air particulates, milk, fish, sediment and vegetation
3. Concentrations of tritium in ground/well and surface water
4. Concentrations of I-131 in air and milk
5. Ambient gamma radiation levels at various site environs

C. Data Interpretation

The radiological and direct radiation data collected prior to LaSalle County Station becoming operational were used as a baseline with which these operational data were compared. For the purpose of this report, LaSalle County Station was considered operational at initial criticality. In addition, data were compared to previous years' operational data for consistency and trending. Several factors were important in the interpretation of the data:

1. Lower Limit of Detection and Minimum Detectable Concentration

The lower limit of detection (LLD) is defined as the smallest concentration of radioactive material in a sample that would yield a net count (above background) that would be detected with only a 5% probability of falsely concluding that a blank observation represents a "real" signal. The LLD is intended as a before the fact (a priori) estimate of a system (including instrumentation, procedure and sample type) and not as an after the fact (a posteriori) criteria for the presence of activity. All analyses were designed to achieve the required LSCS

detection capabilities for environmental sample analysis.

The minimum detectable concentration (MDC) is defined above with the exception that the measurement is an after the fact estimate of the presence of activity.

2. Net Activity Calculation and Reporting of Results

Net activity for a sample was calculated by subtracting background activity from the sample activity. Since the REMP measures extremely small changes in radioactivity in the environment, background variations may result in sample activity being lower than the background activity effecting a negative number. An MDC was reported in all cases where positive activity was not detected.

Gamma spectroscopy results for each type of sample were grouped as follows:

For surface water, food products, and vegetation: 12 nuclides including Mn-54, Co-58, Fe-59, Co-60, Zn-65, Zr-95, Nb-95, I-131, Cs-134, Cs-137, Ba-140, and La-140 were reported.

For ground/well water, fish, sediment, air particulate and milk: 11 nuclides including Mn-54, Co-58, Fe-59, Co-60, Zn-65, Zr-95, Nb-95, Cs-134, Cs-137, Ba-140, and La-140 were reported.

Means and standard deviations of the results were calculated. The standard deviations represent the variability of measured results for different samples rather than single analysis uncertainty.

D. Program Exceptions

For 2020, the LSCS REMP had a sample recovery rate of 98.1%. Sample anomalies and missed samples are listed in the following tables:

Table D-1 LISTING OF SAMPLE ANOMALIES

Sample Type	Location Code	Collection Date	Reason
AP/AI	L-05	01/23/20	Lower reading of 155.0 hrs, possibly due to a power outage. NOTE: during the collection on 01/30/20, the timer indicated 167.8 hrs; normal reading for the 7 days collection period.
AP/AI	L-05	02/20/20	Timer indicates approximately 8 hrs less than expected for the 7 days collection period. Possible power outage. NOTE: during the collection on 02/27/20, the timer indicated 168.1 hrs; normal reading for the 7 days collection period.
AP/AI	L-07	05/28/20	Low reading of 85.5 hrs during a 7 days collection period, possibly due to a power outage. NOTE: later determined the cause as a timer failure.

Table D-1 LISTING OF SAMPLE ANOMALIES (cont'd)

Sample Type	Location Code	Collection Date	Reason
AP/AI	L-07	06/03/20	Low reading of 78.3 hrs during a 6 days collection period. Cause determined to be a faulty timer. Unable to exchange the timer in field; pump replaced. Running time determined based on the installation/ collection times to be 144.1 hrs.
AP/AI	L-08	07/23/20	Low reading of 68.6 hrs due to a fuse failure. Fuse replaced, pump back to normal operation. NOTE: during the 07/29/20 collection, the timer indicated 144.9 hrs; normal reading for the 6 days collection period.
AP/AI	L-01	08/13/20	Timer indicates approximately 9.2 hrs less than expected for the collection period due to a power outage caused by severe winds and storms in the area.
AP/AI	L-05	08/13/20	Timer indicates approximately 9.2 hrs less than expected for the collection period due to a power outage caused by severe winds and storms in the area.
AP/AI	L-05	08/13/20	Timer indicates approximately 7.1 hrs less than expected for the collection period due to a power outage caused by severe winds and storms in the area.
AP/AI	L-06	08/13/20	Timer indicates approximately 8.8 hrs less than expected for the collection period due to a power outage caused by severe winds and storms in the area.
AP/AI	L-07	08/13/20	Timer indicates approximately 27 hrs less than expected for the collection period due to a power outage caused by severe winds and storms in the area.
AP/AI	L-08	08/13/20	Timer indicates approximately 4 hrs less than expected for the collection period due to a power outage caused by severe winds and storms in the area.
AP/AI	L-10	08/13/20	Timer indicates approximately 20 hrs less than expected for the collection period due to a power outage caused by severe winds and storms in the area.
AP/AI	L-11A	08/13/20	Timer indicates approximately 9 hrs less than expected for the collection period due to a power outage caused by severe winds and storms in the area.
OSLD	L-03-1 L-03-2	08/13/20 08/20/20	Unable to check the OSLD samples; access road blocked by downed power lines.
AP/AI	L-03	08/27/20	Sample collected after 3 weeks' run, after the access road reopened. Station informed; samples decided to be valid for testing.
AP/AI	L-03	09/03/20	Sample collected one day later than the whole batch due to inaccessibility of the location.
AP/AI	L-11A	09/02/20	Timer indicates approximately 20 hrs less than expected for the collection period possibly due to a power outage. NOTE: during the 09/10/20 collection, the timer indicated 168.9 hrs; normal reading for the 8 days collection period.
AP/AI	L-11A	10/22/20	Pump found not running; timer indicated 131.9 hrs. Pump exchanged.
AP/AI	L-11A	12/23/20	Unable to read the run time due to the timer's failure; filter consistent with the estimated running time. Timer exchanged.

Table D-2 LISTING OF MISSED SAMPLES

Sample Type	Location Code	Collection Date	Reason
SW	L-40	03/19/20	No sample; location closed due to a national health emergency.
AP/AI	L-03	04/16/20	Pump found not running, with cord partially disconnected. Timer indicated 25 hrs. The cord and socket refastened and sealed with tape, pump reset and observed working well. Filter appears very light. Station informed; samples discarded.
SW	L-21 L-40	April, 2020	Original sample lost in transit on 05/04/20. Sample recomposited and sent on 07/08/20. Unable to reach required LLD.
AP/AI	L-03	08/13/20 08/20/20	Station inaccessible due to the road being blocked by a downed power line. Samples not collected.
OSLD	L-209-1	09/30/20	Sample found on the ground. One OSLD missing; premises searched unsuccessfully.
MI	L-42	12/30/20	Unable to collect milk; farmer stopped milking cows before calving season.
AP/AI	L-01	12/30/20	No power at the station due to a downed wire. Station notified.

Each program exception has been reviewed to understand the causes of the program exception. Occasional equipment breakdowns and power outages were unavoidable.

The overall sample recovery rate indicates that the appropriate procedures and equipment are in place to assure reliable program implementation.

E. Program Changes

There were no program changes in 2020.

IV. Results and Discussion

A. Aquatic Environment

1. Surface Water

Samples were taken weekly and composited monthly at two locations (L-21 and L-40). Of these locations only L-40 located downstream, could be affected by LaSalle's effluent releases. The following analyses were performed:

Gross Beta

Samples from all locations were analyzed for concentrations of gross beta (Table C-I.1, Appendix C). Gross beta was detected in 24 out of 24 samples with a range of 3.0 to 10.7 pCi/L. Concentrations detected were consistent with those detected in previous years (Figure C-1, Appendix C). The required LLD was met for all samples.

Tritium

Quarterly composites of weekly collections were analyzed for tritium activity (Table C-I.2, Appendix C). Tritium was detected in 1 of 8 samples with a concentration of 257 pCi/L. Concentrations detected were consistent with those detected in previous years (Figure C-2, Appendix C).

Gamma Spectrometry

Samples from both locations were analyzed for gamma-emitting nuclides (Table C-I.3, Appendix C). No nuclides were detected, and all required LLDs were met.

2. Ground/Well Water

Quarterly grab samples were collected at two locations (L-27 and L-28). Wells 4, 5 and 6 are associated with L-28. L-27 and L-28 Well 6 could be affected by LaSalle's effluent releases. The following analyses were performed:

Tritium

Quarterly grab samples from the locations were analyzed for tritium activity (Table C-II.1, Appendix C). No tritium was detected and the contractually-required 200 pCi/L LLDs were met.

Gamma Spectrometry

Samples from all locations were analyzed for gamma-emitting nuclides (Table C-II.2, Appendix C). No nuclides were detected, and all required LLDs were met.

3. Fish

Fish samples were collected at three locations (L-34, L-35 and L-36) semiannually. Locations L-34 and L-35 could be affected by LaSalle's effluent releases. The following analysis was performed:

Gamma Spectrometry

The edible portion of fish samples from both locations was analyzed for gamma-emitting nuclides (Table C–III.1, Appendix C). Naturally-occurring K-40 was found at all stations and ranged from 2,607 to 3,568 pCi/kg wet. No fission or activation products were found.

4. Sediment

Aquatic sediment samples were collected at three locations (L-21, L-40 and L-41) semiannually. Location L-21 is located upstream and is not affected by LaSalle's liquid effluent releases. Locations L-40 and L-41, located downstream, could be affected by LaSalle's effluent releases. The following analysis was performed:

Gamma Spectrometry

Sediment samples from the three locations were analyzed for gamma-emitting nuclides (Table C–IV.1, Appendix C). Naturally- occurring Be-7 was found at two stations with concentrations ranging from 1,172 to 3,268 pCi/L. Naturally- occurring K-40 was found at all stations and ranged from 5,569 to 19,170 pCi/kg dry. No fission or activation products were found.

B. Atmospheric Environment

1. Airborne

a. Air Particulates

Continuous air particulate samples were collected from nine locations on a weekly basis. The nine locations were separated into four groups: Group I (onsite) represents locations within the LSCS site boundary (L-03 and L-05), Group II (near-site) represents the locations near the LSCS site (L-01 and L-06), Group III (far-field) represents the locations at an intermediate distance from LSCS (L-04, L-07, L-08, and L-11A) and Group IV (control) represents the control location at a remote distance (L-10). The following analyses were performed:

Gross Beta

Weekly samples were analyzed for concentrations of beta emitters (Table C–V.1 and C–V.2, Appendix C). Detectable gross beta activity was observed at all locations. Comparison of results

among the four groups aid in determining the effects, if any, resulting from the operation of LSCS. The results from the onsite locations (Group I) ranged from 6 to 31E-3 pCi/m³ with a mean of 16E-3 pCi/m³. The results from the near-site location (Group II) ranged from 6 to 32E-3 pCi/m³ with a mean of 16E-3 pCi/m³. The results from the far-field locations (Group III) ranged from 6 to 35E-3 pCi/m³ with a mean of 17E-3 pCi/m³. The results from the control location (Group IV) ranged from 9 to 36E-3 pCi/m³ with a mean of 17E-3 pCi/m³. Comparison of the 2020 air particulate data with previous year's data indicate no effects from the operation of LSCS (Figures C-3 through C-8, Appendix C). In addition, comparisons of the weekly mean values for 2020 indicate no notable differences among the four groups.

Gamma Spectrometry

Weekly samples were composited quarterly and analyzed for gamma-emitting nuclides (Table C-V.3, Appendix C). Naturally-occurring Be-7, due to cosmic ray activity, was detected in 36 of 36 samples. These values ranged from 57 to 171 E-3 pCi/m³. All other nuclides were less than the MDC.

b. Airborne Iodine

Continuous air samples were collected from ten locations (L-01, L-03, L-04, L-05, L-06, L-07, L-08, L-10, and L-11A) and analyzed weekly for I-131 (Table C-VI.1, Appendix C). No I-131 was detected.

2. Terrestrial

a. Milk

Samples were collected from one location (L-42) biweekly May through October and monthly December through April. The following analyses were performed:

Iodine-131

Milk samples from the location were analyzed for concentrations of I-131 (Table C-VII.1, Appendix C). I-131 was not detected, and the required LLDs were met.

Gamma Spectrometry

Milk samples were analyzed for concentrations of gamma-emitting nuclides (Table C-VII.2, Appendix C). Naturally-occurring K-40 activity was found in all milk samples and ranged from 800 to 1,319 pCi/l. No other nuclides were detected, and all required LLDs were met.

b. Food Products

Food product samples were collected at four locations (L-Quad 1, L-Quad 2, L-Quad 3 and L-Quad 4) when available. All locations could be affected by LaSalle's effluent releases. The following analysis was performed:

Gamma Spectrometry

Samples from all available locations were analyzed for gamma-emitting nuclides (Table C-VIII.1, Appendix C). No nuclides were detected, and all required LLDs were met.

c. Vegetation

Vegetation samples were collected monthly during the growing season from May through October at three locations (L-Veg C, L-ESE-1, and L-ESE-2). The control location was L-Veg C and was located in the lowest deposition sector (ENE sector) surrounding LaSalle. Various vegetation samples were also collected in the highest deposition sector (ESE sector) surrounding LaSalle. The following analyses were performed:

Gamma Spectrometry

Samples from all available locations were analyzed for gamma-emitting nuclides (Table C-VIII.2, Appendix C). No nuclides were detected, and all required LLDs were met.

C. Ambient Gamma Radiation

Ambient gamma radiation levels were measured utilizing Optically Stimulated Luminescence Dosimeters (OSLD). Forty-two OSLD locations were established around the site. Results of OSLD measurements are listed in Tables C-IX.1, Appendix C.

All OSLD measurements were at or below 24 mrem/quarter, with a range of 5.9 to 23.5 mrem/quarter. A comparison of the Normalized Annual Dose to the Baseline Background and Minimum Differential Dose indicates that there is no evidence of dose which could be attributed to facility-related direct radiation.

D. Land Use Census

A Land Use Census conducted August 26, 2020, around the LaSalle County Station (LSCS) was performed by Environmental Inc. (Midwest Labs) for Exelon Nuclear to comply with Radiological Effluent Control 12.5.2 of the LaSalle's Offsite Dose Calculation Manual. The purpose of the survey was to document the nearest resident and milk producing animal in each of the sixteen 22 ½ degree sectors around the site within 10 km (6.2 miles). The distance and direction of all locations from the LSCS reactor

buildings were positioned using Global Positioning System (GPS) technology. Since there were no milk animals within 10 km of LSCS, beef cows were identified. There were no changes required to the LSCS REMP as a result of this survey. The results of this survey are summarized below:

Distance in Miles from the LSCS Reactor Buildings				
Sector		Residence Miles	Livestock Miles	Milk Farm Miles
A	N	3.9	4.0	-
B	NNE	1.6	1.7	-
C	NE	2.1	3.5	-
D	ENE	3.3	4.6	-
E	E	3.2	-	14.2
F	ESE	1.4	-	-
G	SE	1.7	5.1	-
H	SSE	1.8	4.7	-
J	S	1.5	1.5	-
K	SSW	0.7	-	-
L	SW	1.0	5.8	-
M	WSW	1.5	-	-
N	W	1.7	3.0	-
P	WNW	0.9	3.0	-
Q	NW	1.7	3.3	-
R	NNW	1.7	4.5	-

E. Errata Data

There is no errata data for 2020.

F. Summary of Results – Inter-Laboratory Comparison Program

The TBE Laboratory analyzed Performance Evaluation (PE) samples of air particulate, air iodine, milk, soil, vegetation, and water matrices for various analytes. The PE samples supplied by Analytics Inc., Environmental Resource Associates (ERA) and Department of Energy (DOE) Mixed Analyte Performance Evaluation Program (MAPEP), were evaluated against the following pre-set acceptance criteria:

1. Analytics Evaluation Criteria

Analytics' evaluation report provides a ratio of TBE's result and Analytics' known value. Since flag values are not assigned by Analytics, TBE evaluates the reported ratios based on internal QC requirements based on the DOE MAPEP criteria.

2. ERA Evaluation Criteria

ERA's evaluation report provides an acceptance range for control and warning limits with associated flag values. ERA's acceptance

limits are established per the USEPA, National Environmental Laboratory Accreditation Conference (NELAC), state-specific Performance Testing (PT) program requirements or ERA's SOP for the Generation of Performance Acceptance Limits, as applicable. The acceptance limits are either determined by a regression equation specific to each analyte or a fixed percentage limit promulgated under the appropriate regulatory document.

3. DOE Evaluation Criteria

MAPEP's evaluation report provides an acceptance range with associated flag values. MAPEP defines three levels of performance:

- Acceptable (flag = "A") - result within $\pm 20\%$ of the reference value
- Acceptable with Warning (flag = "W") - result falls in the $\pm 20\%$ to $\pm 30\%$ of the reference value
- Not Acceptable (flag = "N") - bias is greater than 30% of the reference value

Note: The Department of Energy (DOE) Mixed Analyte Performance Evaluation Program (MAPEP) samples are created to mimic conditions found at DOE sites which do not resemble typical environmental samples obtained at commercial nuclear power facilities.

For the TBE laboratory, 126 out of 133 analyses performed met the specified acceptance criteria. Seven analyses did not meet the specified acceptance criteria for the following reasons and were addressed through the TBE Corrective Action Program. A summary is found below:

1. The MAPEP February 2020 AP U-233/234 and U-238 results were evaluated as *Not Acceptable*. The reported value for U-233/234 was 0.0416 ± 0.0102 Bq/sample and the known result was 0.075 Bq/sample (acceptance range 0.053 - 0.098). The reported value for U-238 was 0.0388 ± 0.00991 Bq/sample and the known result was 0.078 Bq/sample (acceptance range 0.055 - 0.101). This sample was run as the workgroup duplicate and had RPD's of 10.4% (U-234) and 11.7% (U-238). After the known results were obtained, the sample was relogged. The filter was completely digested with tracer added originally; the R1 results were almost identical. It was concluded that the recorded tracer amount was actually double, causing the results to be skewed. Lab worksheets have been modified to verify actual tracer amount vs. LIMS data. TBE changed vendors for this cross-check to ERA MRAD during the 2nd half of 2020. Results were acceptable at 97.8% for U-234 and 106% for U-238. (NCR 20-13)

2. The Analytics September 2020 milk Sr-89 result was evaluated as *Not Acceptable*. The reported value was 62.8 pCi/L and the known result was 95.4 (66%). All QC data was reviewed and there were no anomalies. This was the first failure for milk Sr-89 since 2013 and there have only been 3 upper/lower boundary warnings since that time. It is believed that there may have been some Sr-89 loss during sample prep. The December 2020 result was at 92% of the known. (NCR 20-19)
3. The ERA October 2020 water I-131 result was evaluated as *Not Acceptable*. The reported value was 22.9 pCi/L and the known result was 28.2 (acceptance range 23.5 - 33.1). The reported result was 81% of the known, which passes TBE QC criteria. This was the first failure for water I-131. (NCR 20-17)
4. The ERA October 2020 water Gross Alpha and Gross Beta results were evaluated as *Not Acceptable*. The reported/acceptable values and ranges are as follows:

	<u>Reported</u>	<u>Known</u>	<u>Range</u>
Gross Alpha	40.0	26.2	13.3 - 34.7
Gross Beta	47.5	69.1	48.0 - 76.0

All QC data was reviewed with no anomalies and a cause for failure could not be determined. This was the first failure for water Gross Beta. A Quick Response follow-up cross-check was analyzed as soon as possible with acceptable results at 96.8% for Gross Alpha and 102% for Gross Beta. (NCR 20-18)

5. The MAPEP August 2020 soil Ni-63 result was evaluated as *Not Acceptable*. The reported value was 438 ± 21.1 Bq/kg and the known result was 980 Bq/kg (acceptance range 686 - 1274). It is believed that some Ni-63 loss occurred during the sample prep step. (NCR 20-20)

The Inter-Laboratory Comparison Program provides evidence of “in control” counting systems and methods, and that the laboratories are producing accurate and reliable data.

Intentionally left blank

APPENDIX A

RADIOLOGICAL ENVIRONMENTAL MONITORING REPORT ANNUAL SUMMARY

Intentionally left blank

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
THE LASALLE COUNTY STATION, 2020**

NAME OF FACILITY:		LASALLE COUNTY STATION		DOCKET NUMBER: 50-373 & 50-374					
LOCATION OF FACILITY:		MARSEILLES, IL		REPORTING PERIOD: 2020					
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSES PERFORMED	NUMBER OF ANALYSES PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR LOCATIONS MEAN (M) (F) RANGE	CONTROL LOCATION MEAN (M) (F) RANGE	LOCATION WITH HIGHEST ANNUAL MEAN (M) MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS	
SURFACE WATER (PC/LITER)	GR-B	24	4	7.7 (12/12) 4.6 - 10.7	7 (12/12) 3.0 - 10.0	7.7 (12/12) 4.6 - 10.7	L-40 INDICATOR ILLINOIS RIVER - DOWNSTREAM 5.2 MILES NNW OF SITE	0	
		H-3	8	200	<LLD	257 (1/4)	257 (1/4)	L-21 CONTROL ILLINOIS RIVER AT SENECA - UPSTREAM 4.0 MILES NE OF SITE	0
			GAMMA	24		<LLD	<LLD	-	-
	MN-54	15			<LLD	<LLD	-		0
	CO-58	15			<LLD	<LLD	-		0
	FE-59	30			<LLD	<LLD	-		0
	CO-60	15			<LLD	<LLD	-		0
	ZN-65	30			<LLD	<LLD	-		0
	NB-95	15			<LLD	<LLD	-		0
	ZR-95	30			<LLD	<LLD	-		0
	I-131	15			<LLD	<LLD	-		0
	CS-134	15			<LLD	<LLD	-		0
	CS-137	18		<LLD	<LLD	-		0	
	BA-140	60		<LLD	<LLD	-		0	
	LA-140	15		<LLD	<LLD	-		0	
GROUND WATER (PC/LITER)	H-3	12	200	<LLD	<LLD	-		0	
		GAMMA	12		<LLD	<LLD	-		0
	MN-54		15		<LLD	<LLD	-		0
	CO-58		15		<LLD	<LLD	-		0
	FE-59		30		<LLD	<LLD	-		0
	CO-60		15		<LLD	<LLD	-		0
	ZN-65		30		<LLD	<LLD	-		0
	NB-95		15		<LLD	<LLD	-		0
	ZR-95		30		<LLD	<LLD	-		0
	CS-134		15		<LLD	<LLD	-		0
	CS-137		18		<LLD	<LLD	-		0
	BA-140		60		<LLD	<LLD	-		0
	LA-140		15		<LLD	<LLD	-		0

(M) The Mean Values are calculated using the positive values (values ≥ MDC). (F) Fraction of detectable measurement are indicated in parentheses.

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
THE LASALLE COUNTY STATION, 2020**

NAME OF FACILITY:		LASALLE COUNTY STATION		DOCKET NUMBER: 50-373 & 50-374				
LOCATION OF FACILITY:		MARSEILLES, IL		REPORTING PERIOD: 2020				
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSES PERFORMED	NUMBER OF ANALYSES PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR LOCATIONS MEAN (M) (F) RANGE	CONTROL LOCATION MEAN (M) (F) RANGE	LOCATION WITH HIGHEST ANNUAL MEAN (M) MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
FISH (PC/KG WET)	GAMMA	12						
	MN-54		130	<LLD	<LLD	-		0
	CO-58		130	<LLD	<LLD	-		0
	FE-59		260	<LLD	<LLD	-		0
	CO-60		130	<LLD	<LLD	-		0
	ZN-65		260	<LLD	<LLD	-		0
	NB-95		NA	<LLD	<LLD	-		0
	ZR-95		NA	<LLD	<LLD	-		0
	CS-134		130	<LLD	<LLD	-		0
	CS-137		150	<LLD	<LLD	-		0
	BA-140		NA	<LLD	<LLD	-		0
	LA-140		NA	<LLD	<LLD	-		0
SEDIMENT (PC/KG DRY)	GAMMA	6						
	MN-54		NA	<LLD	<LLD	-		0
	CO-58		NA	<LLD	<LLD	-		0
	FE-59		NA	<LLD	<LLD	-		0
	CO-60		NA	<LLD	<LLD	-		0
	ZN-65		NA	<LLD	<LLD	-		0
	NB-95		NA	<LLD	<LLD	-		0
	ZR-95		NA	<LLD	<LLD	-		0
	CS-134		150	<LLD	<LLD	-		0
	CS-137		180	<LLD	<LLD	-		0
	BA-140		NA	<LLD	<LLD	-		0
	LA-140		NA	<LLD	<LLD	-		0
AIR PARTICULATE (E-3 PC/CU.METER)	GR-B	464	10	17 (411/412)	17 (52/52) 9 - 36	17 (52/52) 7 - 30	L-07 INDICATOR SENECA 5.2 MILES NNE OF SITE	0
AIR PARTICULATE (E-3 PC/CU.METER)	GAMMA	36	NA	<LLD	<LLD	-		0

(M) The Mean Values are calculated using the positive values (values ≥ MDC). (F) Fraction of detectable measurement are indicated in parentheses.

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
THE LASALLE COUNTY STATION, 2020**

NAME OF FACILITY: LOCATION OF FACILITY:		LASALLE COUNTY STATION MARSEILLES, IL		DOCKET NUMBER: REPORTING PERIOD:		50-373 & 50-374 2020				
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSES PERFORMED	NUMBER OF ANALYSES PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR LOCATIONS MEAN (M) (F) RANGE	CONTROL LOCATION MEAN (M) (F) RANGE	LOCATION WITH HIGHEST ANNUAL MEAN (M)	STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS		
AIR IODINE (E-3 PCI/CU.METER)	GAMMA	I-131	464	70	CO-58	<LLD	-		0	
					FE-59	<LLD	-		0	
					CO-60	<LLD	-		0	
					ZN-65	<LLD	-		0	
					NB-95	<LLD	-		0	
					ZR-95	<LLD	-		0	
					CS-134	<LLD	50	-		0
					CS-137	<LLD	60	-		0
					BA-140	<LLD	NA	-		0
					LA-140	<LLD	NA	-		0
MILK (PCI/LITER)	GAMMA	I-131	19	1	CO-58	<LLD	-		0	
					FE-59	<LLD	-		0	
					CO-60	<LLD	-		0	
					ZN-65	<LLD	-		0	
					NB-95	<LLD	-		0	
					ZR-95	<LLD	-		0	
					CS-134	<LLD	15	-		0
					CS-137	<LLD	18	-		0
					BA-140	<LLD	60	-		0
					LA-140	<LLD	15	-		0
FOOD PRODUCTS (PCI/KG WET)	GAMMA	I-131	12	NA	CO-58	<LLD	-		0	
					FE-59	<LLD	-		0	
					CO-60	<LLD	-		0	
					ZN-65	<LLD	-		0	
					NB-95	<LLD	-		0	
					ZR-95	<LLD	-		0	
					CS-134	<LLD	15	-		0
					CS-137	<LLD	18	-		0
					BA-140	<LLD	60	-		0
					LA-140	<LLD	15	-		0

(M) The Mean Values are calculated using the positive values (values ≥ MDC). (F) Fraction of detectable measurement are indicated in parentheses.

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
THE LASALLE COUNTY STATION, 2020**

NAME OF FACILITY:		LASALLE COUNTY STATION		DOCKET NUMBER:		50-373 & 50-374		
LOCATION OF FACILITY:		MARSEILLES, IL		REPORTING PERIOD:		2020		
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSES PERFORMED	NUMBER OF ANALYSES PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR LOCATIONS MEAN (M) (F) RANGE	CONTROL LOCATION MEAN (M) (F) RANGE	LOCATION WITH HIGHEST ANNUAL MEAN (M) MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
	CO-58		NA	<LLD	<LLD	-		0
	FE-59		NA	<LLD	<LLD	-		0
	CO-60		NA	<LLD	<LLD	-		0
	ZN-65		NA	<LLD	<LLD	-		0
	NB-95		NA	<LLD	<LLD	-		0
	ZR-95		NA	<LLD	<LLD	-		0
	I-131		60	<LLD	<LLD	-		0
	CS-134		60	<LLD	<LLD	-		0
	CS-137		80	<LLD	<LLD	-		0
	BA-140		NA	<LLD	<LLD	-		0
	LA-140		NA	<LLD	<LLD	-		0
VEGETATION (PCI/KG WET)	GAMMA	46						
	MN-54		NA	<LLD	<LLD	-		0
	CO-58		NA	<LLD	<LLD	-		0
	FE-59		NA	<LLD	<LLD	-		0
	CO-60		NA	<LLD	<LLD	-		0
	ZN-65		NA	<LLD	<LLD	-		0
	NB-95		NA	<LLD	<LLD	-		0
	ZR-95		NA	<LLD	<LLD	-		0
	I-131		60	<LLD	<LLD	-		0
	CS-134		60	<LLD	<LLD	-		0
	CS-137		80	<LLD	<LLD	-		0
	BA-140		NA	<LLD	<LLD	-		0
	LA-140		NA	<LLD	<LLD	-		0
DIRECT RADIATION (MILLI-ROENTGEN/QR.)	OSLD-QUARTERLY	167	NA	16.8 (163/163)	14.4 (4/4)	19.1 (4/4)	L-210 INDICATOR	0
				5.9 - 23.5	6.7 - 20.0	10.4 - 23.5	3.3 MILES SW	

(M) The Mean Values are calculated using the positive values (values ≥ MDC). (F) Fraction of detectable measurement are indicated in parentheses.

APPENDIX B

LOCATION DESIGNATION, DISTANCE & DIRECTION, AND SAMPLE COLLECTION & ANALYTICAL METHODS

Intentionally left blank

TABLE B-1:

Radiological Environmental Monitoring Program - Sampling Locations,
Distance and Direction, LaSalle County Station, 2020

Location	Location Description	Distance & Direction From Site
<u>A. Surface Water</u>		
L-21	Illinois River at Seneca, Upstream (control)	4.0 miles NE
L-40	Illinois River, Downstream (indicator)	5.2 miles NNW
<u>B. Ground/Well Water</u>		
L-27	LSCS Onsite Well (indicator)	0 miles at station
L-28-W4	Marseilles Well (control)	7.0 miles NNW
L-28-W5	Marseilles Well (control)	6.7 miles NNW
L-28-W6	Marseilles Well (indicator)	4.1 miles N
<u>C. Milk - bi-weekly / monthly</u>		
L-42	Biros Farm (control)	14.2 miles E
<u>D. Air Particulates / Air Iodine</u>		
L-01	Nearsite 1 (indicator)	1.5 miles NNW
L-03	Onsite 3 (indicator)	1.0 miles ENE
L-04	Rte. 170 (indicator)	3.2 miles E
L-05	Onsite 5 (indicator)	0.3 miles ESE
L-06	Nearsite 6 (indicator)	0.4 miles W
L-07	Seneca (indicator)	5.2 miles NNE
L-08	Marseilles (indicator)	6.0 miles NNW
L-10	Streator (control)	13.5 miles SW
L-11A	Ransom (indicator)	6.0 miles S
<u>E. Fish</u>		
L-34	LaSalle Cooling Lake (indicator)	2.0 miles E
L-35	Marseilles Pool of Illinois River, Downstream (indicator)	6.5 miles NNW
L-36	Illinois River, Upstream of Discharge (control)	4.3 miles NE
<u>F. Sediment</u>		
L-21	Illinois River at Seneca, Upstream (control)	4.0 miles NE
L-40	Illinois River, Downstream (indicator)	5.2 miles NNW
L-41	Illinois River, Downstream (indicator)	4.6 miles N
<u>G. Food Products</u>		
Quadrant 1	171 Valley View, Seneca IL	5.2 miles NE
Quadrant 1	281 E. Lincoln, Seneca IL	5.1 miles NE
Quadrant 2	106 W. Thomas, Ransom, IL	6.0 miles S
Quadrant 2	205 W. Plumb, Ransom IL	5.3 miles S
Quadrant 3	1814 E. 25 th Rd., Ransom IL	3.5 miles SW
Quadrant 4	2507 N. 2553 Rd., Marseilles IL	4.3 miles NNW
Control	Biros Farm	14.2 miles E
<u>H. Vegetation</u>		
L-Veg C	Control	9.5 miles ENE
L-ESE 1	Indicator	1.5 miles ESE
L-ESE 2	Indicator	6.0 miles ESE

TABLE B-1:

Radiological Environmental Monitoring Program - Sampling Locations,
Distance and Direction, LaSalle County Station, 2020

Location	Location Description	Distance & Direction From Site
<u>I. Environmental Dosimetry - OSLD</u>		
<u>Inner Ring</u>		
L-101-1 and -2		0.5 miles N
L-102-1 and -2		0.6 miles NNE
L-103-1 and -2		0.7 miles NE
L-104-1 and -2		0.8 miles ENE
L-105-1 and -2		0.7 miles E
L-106-1 and -2		1.4 miles ESE
L-107-1 and -2		0.8 miles SE
L-108-1 and -2		0.5 miles SSE
L-109-1 and -2		0.6 miles S
L-110-1 and -2		0.6 miles SSW
L-111b-1 and -2		0.8 miles SW
L-112-1 and -2		0.9 miles WSW
L-113a-1 and -2		0.8 miles W
L-114-1 and -2		0.9 miles WNW
L-115-1 and -2		0.7 miles NW
L-116-1 and -2		0.6 miles NNW
<u>Outer Ring</u>		
L-201-3 and -4		4.0 miles N
L-202-3 and -4		3.6 miles NNE
L-203-1 and -2		4.0 miles NE
L-204-1 and -2		3.2 miles ENE
L-205A-1 and -2		3.2 miles ESE
L-205B-3 and -4		5.1 miles E
L-206-1 and -2		4.3 miles SE
L-207-1 and -2		4.5 miles SSE
L-208-1 and -2		4.5 miles S
L-209-1 and -2		4.0 miles SSW
L-210-1 and -2		3.3 miles SW
L-211-1 and -2		4.5 miles WSW
L-212-1 and -2		4.0 miles W
L-213-3 and -4		4.9 miles W
L-214-3 and -4		5.1 miles WNW
L-215-3 and -4		5.0 miles NW
L-216-3 and -4		5.0 miles NNW
<u>Other</u>		
L-01-1 and -2	Nearsite 1 (indicator)	1.5 miles NNW
L-03-1 and -2	Onsite 3 (indicator)	1.0 miles ENE
L-04-1 and -2	Rte. 170 (indicator)	3.2 miles E
L-05-1 and -2	Onsite 5 (indicator)	0.3 miles ESE
L-06-1 and -2	Nearsite 6 (indicator)	0.4 miles W
L-07-1 and -2	Seneca (indicator)	5.2 miles NNE
L-08-1 and -2	Marseilles (indicator)	6.0 miles NNW
L-11A-1 and -2	Ransom (indicator)	6.0 miles S
<u>Control and Special Interest</u>		
L-10-1 and -2	Streator	13.5 miles SW

TABLE B-2: Radiological Environmental Monitoring Program – Summary of Sample Collection and Analytical Methods, LaSalle County Station, 2020

Sample Medium	Analysis	Sampling Method	Analytical Procedure Number
Surface Water	Gamma Spectroscopy	Monthly composite from weekly grab samples.	TBE, TBE-2007 Gamma-Emitting Radioisotope Analysis
Surface Water	Gross Beta	Monthly composite from weekly grab samples.	TBE, TBE-2008 Gross Alpha and/or Gross Beta Activity in Various Matrices
Surface Water	Tritium	Quarterly composite from weekly grab samples.	TBE, TBE-2011 Tritium Analysis in Drinking Water by Liquid Scintillation
Ground/Well Water	Gamma Spectroscopy	Quarterly grab samples.	TBE, TBE-2007 Gamma-Emitting Radioisotope Analysis
Ground/Well Water	Tritium	Quarterly grab samples.	TBE, TBE-2011 Tritium Analysis in Drinking Water by Liquid Scintillation
Fish	Gamma Spectroscopy	Semi-annual samples collected via electroshocking or other techniques	TBE-2007 Gamma-Emitting Radioisotope Analysis
Sediment	Gamma Spectroscopy	Semi-annual grab samples	TBE, TBE-2007 Gamma-Emitting Radioisotope Analysis
Air Particulates	Gross Beta	One-week composite of continuous air sampling through glass fiber filter paper	TBE, TBE-2008 Gross Alpha and/or Gross Beta Activity in Various Matrices
Air Particulates	Gamma Spectroscopy	Quarterly composite of each station	TBE, TBE-2007 Gamma-Emitting Radioisotope Analysis
Air Iodine	Gamma Spectroscopy	Bi-weekly composite of continuous air sampling through charcoal filter	TBE, TBE-2007 Gamma-Emitting Radioisotope Analysis
Milk	I-131	Bi-weekly grab sample when cows are on pasture. Monthly all other times	TBE, TBE-2012 Radioiodine in Various Matrices
Milk	Gamma Spectroscopy	Bi-weekly grab sample when cows are on pasture. Monthly all other times	TBE, TBE-2007 Gamma-Emitting Radioisotope Analysis
Food Products	Gamma Spectroscopy	Annual grab samples.	TBE, TBE-2007 Gamma-Emitting Radioisotope Analysis
Vegetation	Gamma Spectroscopy	Monthly grab samples during growing season	TBE, TBE-2007 Gamma-Emitting Radioisotope Analysis
OSLD	Optically Stimulated Luminescence Dosimetry	Quarterly OSLDs comprised of two Al ₂ O ₃ :C Landauer Incorporated elements.	Landauer Incorporated



Figure B-1
Inner Ring OSRD Locations
of the LaSalle County Station, 2020

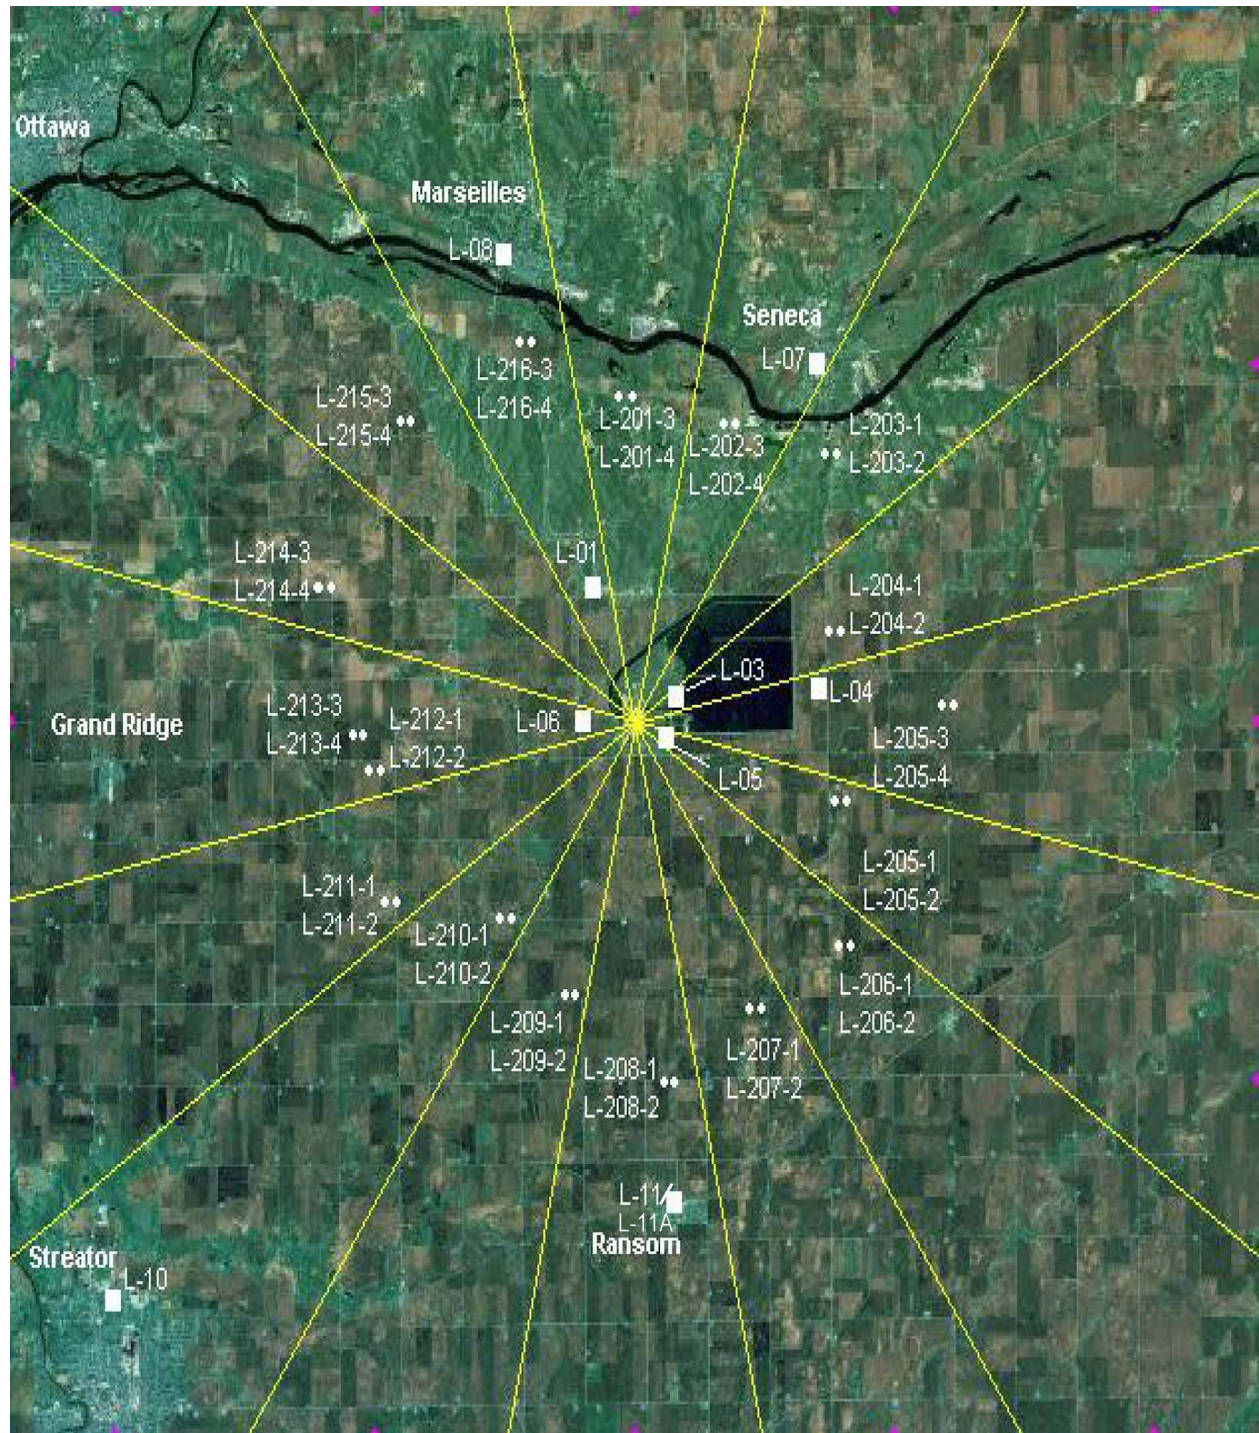


Figure B-2
 Outer Ring OSLD Locations and Fixed Air Sampling Locations
 of the LaSalle County Station, 2020

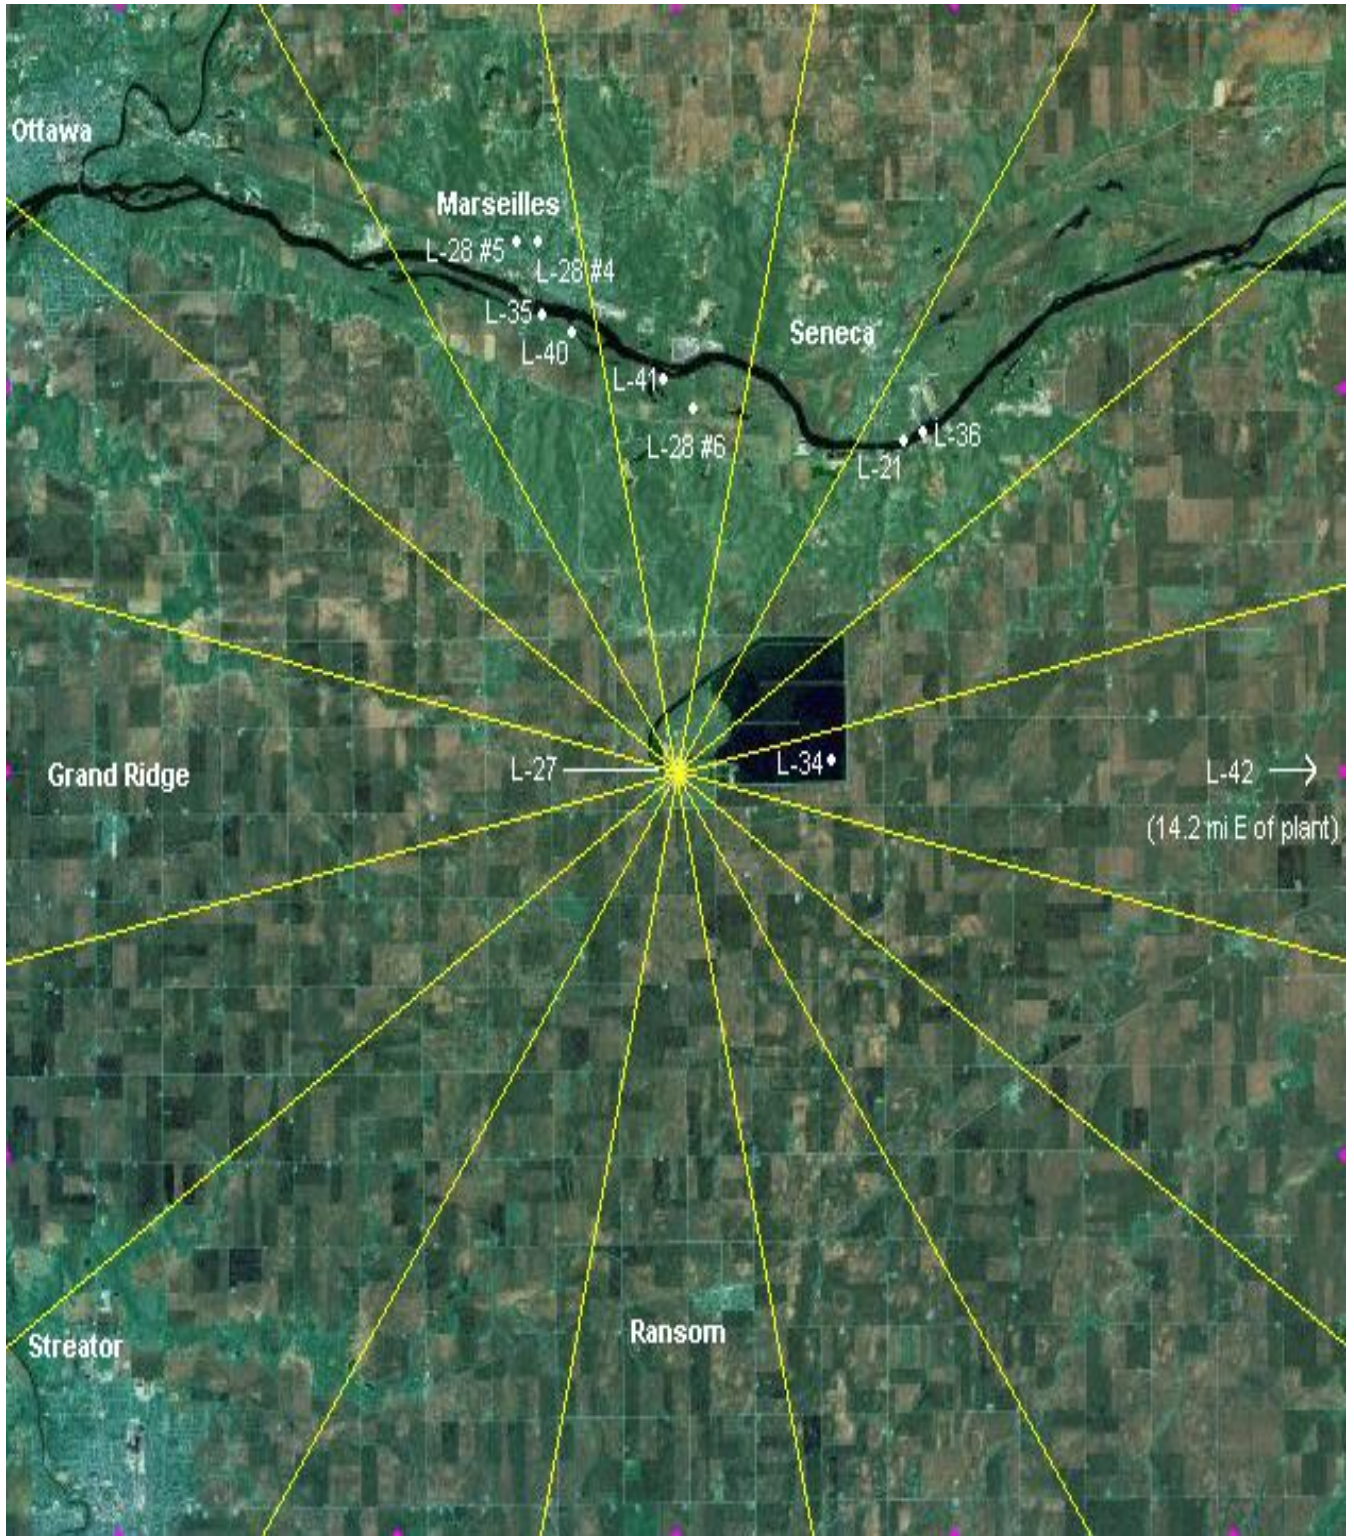


Figure B-3
 Ingestion and Waterborne Exposure Pathway Sample Locations
 of the LaSalle County Station, 2020



APPENDIX C

DATA TABLES AND FIGURES

Intentionally left blank

**Table C-I.1 CONCENTRATIONS OF GROSS BETA IN SURFACE WATER SAMPLES
COLLECTED IN THE VICINITY OF LASALLE COUNTY STATION, 2020**
RESULTS IN UNITS OF PCI/LITER \pm 2 SIGMA

COLLECTION		
PERIOD	L-21	L-40
01/02/20 - 01/30/20	5.6 \pm 2.0	5.1 \pm 2.0
02/05/20 - 02/27/20	3.3 \pm 2.2	4.6 \pm 2.3
03/04/20 - 03/26/20	8.9 \pm 2.7	7.3 \pm 2.6
04/01/20 - 04/30/20	7.5 \pm 2.8	10.0 \pm 2.8
05/06/20 - 05/28/20	3.0 \pm 1.9	6.1 \pm 2.3
06/03/20 - 06/25/20	8.6 \pm 2.5	7.2 \pm 2.4
07/01/20 - 07/29/20	5.7 \pm 2.0	7.1 \pm 2.1
08/05/20 - 08/27/20	6.4 \pm 2.2	7.7 \pm 2.3
09/02/20 - 09/30/20	9.1 \pm 2.4	10.3 \pm 2.5
10/07/20 - 10/29/20	7.6 \pm 2.3	8.1 \pm 2.3
11/04/20 - 11/25/20	10.0 \pm 2.5	10.7 \pm 2.5
12/02/20 - 12/30/20	8.7 \pm 2.2	8.5 \pm 2.3
(1) MEAN \pm 2 STD DEV	7.0 \pm 4.5	7.7 \pm 3.9

**Table C-I.2 CONCENTRATIONS OF TRITIUM IN SURFACE WATER SAMPLES
COLLECTED IN THE VICINITY OF LASALLE COUNTY STATION, 2020**
RESULTS IN UNITS OF PCI/LITER \pm 2 SIGMA

COLLECTION		
PERIOD	L-21	L-40
01/02/20 - 03/26/20	< 195	< 195
04/01/20 - 06/25/20	< 189	< 190
07/01/20 - 09/30/20	< 187	< 188
10/07/20 - 12/30/20	257 \pm 123	< 180
(1) MEAN \pm 2 STD DEV	257 \pm 0	-

(1) THE MEAN AND TWO STANDARD DEVIATION ARE CALCULATED USING THE POSITIVE VALUES (VALUES \geq MDC)

**CONCENTRATIONS OF GAMMA EMITTERS IN SURFACE WATER SAMPLES
COLLECTED IN THE VICINITY OF LASALLE COUNTY STATION, 2020**

Table C-1.3

RESULTS IN UNITS OF PCI/LITER ± 2 SIGMA

SITE	COLLECTION PERIOD	RESULTS IN UNITS OF PCI/LITER ± 2 SIGMA												
		Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	I-131	Cs-134	Cs-137	Ba-140	La-140	
L-21	01/02/20 - 01/30/20	< 2	< 2	< 4	< 2	< 3	< 2	< 3	< 9	< 2	< 2	< 16	< 5	
	02/05/20 - 02/27/20	< 2	< 3	< 5	< 3	< 5	< 3	< 4	< 9	< 3	< 2	< 20	< 7	
	03/04/20 - 03/26/20	< 2	< 2	< 5	< 2	< 4	< 2	< 4	< 9	< 2	< 2	< 17	< 6	
	04/01/20 - 04/30/20	< 2	< 3	< 9	< 2	< 3	< 3	< 6	< 2048	< 2	< 2	< 461	< 151	
	05/06/20 - 05/28/20	< 2	< 2	< 5	< 2	< 4	< 2	< 4	< 7	< 2	< 2	< 14	< 5	
	06/03/20 - 06/25/20	< 2	< 3	< 6	< 2	< 5	< 3	< 5	< 9	< 3	< 3	< 19	< 7	
	07/01/20 - 07/29/20	< 2	< 2	< 5	< 2	< 4	< 2	< 4	< 13	< 2	< 2	< 22	< 7	
	08/05/20 - 08/27/20	< 4	< 4	< 8	< 4	< 9	< 4	< 8	< 15	< 4	< 4	< 30	< 11	
	09/02/20 - 09/30/20	< 2	< 2	< 4	< 2	< 4	< 2	< 3	< 9	< 2	< 2	< 16	< 5	
	10/07/20 - 10/29/20	< 2	< 2	< 4	< 2	< 4	< 2	< 3	< 7	< 2	< 2	< 14	< 5	
	11/04/20 - 11/25/20	< 2	< 2	< 4	< 2	< 4	< 2	< 3	< 8	< 2	< 2	< 14	< 5	
	12/02/20 - 12/30/20	< 2	< 2	< 5	< 2	< 4	< 2	< 4	< 10	< 2	< 2	< 17	< 6	
		MEAN	-	-	-	-	-	-	-	-	-	-	-	-
	L-40	01/02/20 - 01/30/20	< 1	< 2	< 4	< 2	< 3	< 2	< 3	< 8	< 2	< 2	< 15	< 5
02/05/20 - 02/27/20		< 3	< 3	< 6	< 3	< 5	< 3	< 5	< 11	< 3	< 3	< 22	< 7	
03/04/20 - 03/26/20		< 3	< 3	< 6	< 2	< 5	< 3	< 5	< 11	< 3	< 3	< 21	< 7	
04/01/20 - 04/30/20		< 2	< 3	< 11	< 2	< 4	< 4	< 7	< 2374	< 2	< 2	< 520	< 170	
05/06/20 - 05/28/20		< 2	< 2	< 5	< 2	< 4	< 2	< 4	< 8	< 2	< 2	< 17	< 5	
06/03/20 - 06/25/20		< 3	< 3	< 7	< 3	< 6	< 4	< 5	< 11	< 3	< 3	< 21	< 7	
07/01/20 - 07/29/20		< 2	< 2	< 5	< 2	< 4	< 2	< 4	< 12	< 2	< 2	< 20	< 7	
08/05/20 - 08/27/20		< 4	< 4	< 8	< 4	< 6	< 3	< 7	< 15	< 4	< 4	< 29	< 9	
09/02/20 - 09/30/20		< 1	< 2	< 4	< 2	< 3	< 2	< 3	< 9	< 2	< 2	< 16	< 5	
10/07/20 - 10/29/20		< 2	< 2	< 5	< 2	< 4	< 3	< 4	< 8	< 3	< 2	< 17	< 6	
11/04/20 - 11/25/20		< 2	< 2	< 5	< 2	< 4	< 2	< 3	< 8	< 2	< 2	< 16	< 5	
12/02/20 - 12/30/20		< 2	< 2	< 5	< 2	< 4	< 2	< 4	< 11	< 2	< 2	< 21	< 6	
		MEAN	-	-	-	-	-	-	-	-	-	-	-	-

BOLD = Client-required detection limits not met due to age of sample at time of analysis

**Table C-II.1 CONCENTRATIONS OF TRITIUM IN GROUND/WELL WATER SAMPLES
COLLECTED IN THE VICINITY OF LASALLE COUNTY STATION, 2020**
RESULTS IN UNITS OF PCI/LITER \pm 2 SIGMA

COLLECTION PERIOD	L-27	L-28-W4	L-28-W5	L-28-W6
01/09/20 - 01/09/20	< 177		< 179	< 179
04/08/20 - 04/08/20	< 190			
05/28/20 - 05/28/20		< 181		< 181
07/08/20 - 07/08/20	< 190		< 188	< 186
10/07/20 - 10/07/20	< 184	< 187		< 186
<i>MEAN</i>	-	-	-	-

Table C-II.2 CONCENTRATIONS OF GAMMA EMITTERS IN GROUNDWELL WATER SAMPLES COLLECTED IN THE VICINITY OF LASALLE COUNTY STATION, 2020

RESULTS IN UNITS OF PCI/LITER ± 2 SIGMA

SITE	COLLECTION PERIOD	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
L-27	01/09/20 - 01/09/20	< 7	< 7	< 15	< 7	< 13	< 8	< 13	< 8	< 6	< 29	< 12
	04/08/20 - 04/08/20	< 8	< 6	< 15	< 7	< 21	< 8	< 15	< 6	< 8	< 37	< 14
	07/08/20 - 07/08/20	< 6	< 7	< 14	< 8	< 14	< 7	< 10	< 7	< 6	< 32	< 9
	10/07/20 - 10/07/20	< 10	< 6	< 15	< 10	< 18	< 9	< 13	< 9	< 8	< 32	< 11
	MEAN	-	-	-	-	-	-	-	-	-	-	-
L-28-W4	05/28/20 - 05/28/20	< 8	< 5	< 16	< 9	< 12	< 7	< 14	< 9	< 8	< 29	< 12
	10/07/20 - 10/07/20	< 6	< 6	< 13	< 7	< 13	< 7	< 10	< 7	< 6	< 30	< 12
	MEAN	-	-	-	-	-	-	-	-	-	-	-
L-28-W5	01/09/20 - 01/09/20	< 6	< 7	< 13	< 7	< 15	< 9	< 13	< 5	< 8	< 32	< 8
	07/08/20 - 07/08/20	< 5	< 5	< 13	< 5	< 11	< 7	< 11	< 6	< 7	< 32	< 11
	MEAN	-	-	-	-	-	-	-	-	-	-	-
L-28-W6	01/09/20 - 01/09/20	< 8	< 8	< 17	< 8	< 16	< 7	< 12	< 8	< 9	< 32	< 14
	05/28/20 - 05/28/20	< 6	< 6	< 11	< 7	< 12	< 6	< 11	< 7	< 6	< 30	< 10
	07/08/20 - 07/08/20	< 7	< 6	< 11	< 6	< 12	< 5	< 8	< 6	< 5	< 28	< 10
	10/07/20 - 10/07/20	< 6	< 6	< 13	< 8	< 10	< 6	< 11	< 8	< 7	< 35	< 12
	MEAN	-	-	-	-	-	-	-	-	-	-	-

Table C-III.1

**CONCENTRATIONS OF GAMMA EMITTERS IN FISH SAMPLES COLLECTED
IN THE VICINITY OF LASALLE COUNTY STATION, 2020
RESULTS IN UNITS OF PCI/KG WET ± 2 SIGMA**

SITE	COLLECTION PERIOD	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
L-34 Channel Catfish Largemouth Bass Largemouth Bass Channel Catfish	05/12/20	< 53	< 43	< 101	< 46	< 86	< 41	< 98	< 48	< 50	< 268	< 76
	05/12/20	< 32	< 27	< 70	< 34	< 72	< 28	< 59	< 30	< 36	< 157	< 56
	10/07/20	< 55	< 48	< 118	< 42	< 111	< 46	< 84	< 49	< 48	< 213	< 51
	10/07/20	< 40	< 47	< 93	< 52	< 97	< 37	< 74	< 55	< 44	< 242	< 82
	MEAN	-	-	-	-	-	-	-	-	-	-	-
L-35 Channel Catfish Freshwater Drum Channel Catfish Smallmouth Buffalo	05/12/20	< 80	< 63	< 136	< 54	< 118	< 69	< 115	< 77	< 76	< 430	< 114
	05/12/20	< 42	< 37	< 86	< 41	< 79	< 43	< 66	< 42	< 42	< 205	< 69
	10/07/20	< 47	< 45	< 92	< 40	< 86	< 54	< 88	< 54	< 41	< 242	< 79
	10/07/20	< 56	< 63	< 121	< 71	< 134	< 73	< 93	< 72	< 66	< 311	< 120
	MEAN	-	-	-	-	-	-	-	-	-	-	-
L-36 Freshwater Drum Smallmouth Buffalo Channel Catfish Smallmouth Bass	05/12/20	< 39	< 36	< 85	< 51	< 88	< 41	< 71	< 39	< 43	< 209	< 66
	05/12/20	< 44	< 46	< 109	< 45	< 91	< 54	< 84	< 48	< 55	< 268	< 82
	10/07/20	< 64	< 64	< 146	< 72	< 147	< 69	< 91	< 79	< 64	< 273	< 61
	10/07/20	< 43	< 50	< 94	< 42	< 91	< 48	< 111	< 44	< 51	< 252	< 65
	MEAN	-	-	-	-	-	-	-	-	-	-	-

Table C-IV.1

**CONCENTRATIONS OF GAMMA EMITTERS IN SEDIMENT SAMPLES
COLLECTED IN THE VICINITY OF LASALLE COUNTY STATION, 2020**

RESULTS IN UNITS OF PCI/KG DRY ± 2 SIGMA

SITE	COLLECTION PERIOD		Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
L-21	06/08/20		< 99	< 60	< 167	< 85	< 242	< 115	< 123	< 103	< 133	< 330	< 123
	10/13/20		< 76	< 89	< 173	< 102	< 165	< 92	< 161	< 101	< 90	< 384	< 86
	MEAN		-	-	-	-	-	-	-	-	-	-	-
L-40	06/08/20		< 85	< 88	< 185	< 97	< 217	< 83	< 125	< 98	< 98	< 313	< 89
	10/13/20		< 42	< 46	< 106	< 43	< 100	< 53	< 69	< 48	< 45	< 228	< 65
	MEAN		-	-	-	-	-	-	-	-	-	-	-
L-41	06/08/20		< 51	< 49	< 114	< 52	< 122	< 55	< 85	< 43	< 61	< 205	< 48
	10/13/20		< 45	< 35	< 97	< 49	< 111	< 51	< 84	< 56	< 41	< 206	< 56
	MEAN		-	-	-	-	-	-	-	-	-	-	-

Table C-V.1

**CONCENTRATIONS OF GROSS BETA IN AIR PARTICULATE SAMPLES
COLLECTED IN THE VICINITY OF LASALLE COUNTY STATION, 2020
RESULTS IN UNITS OF E-3 PCI/CU METER ± 2 SIGMA**

COLLECTION PERIOD	GROUP I		GROUP II		GROUP III			GROUP IV	
	L-03	L-05	L-01	L-06	L-04	L-07	L-08	L-11A	L-10
01/02/20 - 01/09/20	13 ± 4	13 ± 4	12 ± 4	14 ± 4	13 ± 4	15 ± 4	13 ± 4	11 ± 4	15 ± 4
01/09/20 - 01/16/20	16 ± 4	15 ± 4	15 ± 4	16 ± 4	14 ± 4	19 ± 4	14 ± 4	20 ± 4	12 ± 4
01/16/20 - 01/23/20	23 ± 5	22 ± 5	17 ± 4	20 ± 5	18 ± 4	26 ± 5	19 ± 4	21 ± 5	21 ± 5
01/23/20 - 01/30/20	13 ± 4	14 ± 4	11 ± 4	15 ± 4	17 ± 4	13 ± 4	16 ± 4	15 ± 4	11 ± 4
01/30/20 - 02/05/20	10 ± 4	10 ± 4	10 ± 4	7 ± 4	7 ± 4	14 ± 5	8 ± 4	8 ± 4	11 ± 4
02/05/20 - 02/13/20	11 ± 3	12 ± 3	11 ± 3	10 ± 3	12 ± 3	12 ± 3	14 ± 3	11 ± 3	15 ± 4
02/13/20 - 02/20/20	15 ± 5	13 ± 4	10 ± 4	11 ± 4	14 ± 5	13 ± 4	9 ± 4	14 ± 4	13 ± 4
02/20/20 - 02/27/20	21 ± 4	21 ± 4	18 ± 4	26 ± 5	22 ± 5	21 ± 5	30 ± 5	23 ± 5	21 ± 4
02/27/20 - 03/04/20	11 ± 4	12 ± 4	17 ± 5	11 ± 4	16 ± 5	17 ± 5	10 ± 4	14 ± 4	12 ± 4
03/04/20 - 03/12/20	16 ± 4	15 ± 4	13 ± 4	16 ± 4	15 ± 4	12 ± 4	16 ± 4	14 ± 4	13 ± 4
03/12/20 - 03/19/20	12 ± 3	13 ± 3	10 ± 3	15 ± 3	11 ± 3	12 ± 3	14 ± 3	12 ± 3	11 ± 3
03/19/20 - 03/26/20	11 ± 4	8 ± 4	11 ± 4	12 ± 4	10 ± 4	9 ± 4	12 ± 4	8 ± 4	13 ± 5
03/26/20 - 04/01/20	8 ± 4	12 ± 4	9 ± 4	11 ± 5	11 ± 5	12 ± 5	9 ± 4	8 ± 4	9 ± 4
04/01/20 - 04/08/20	10 ± 4	13 ± 4	14 ± 4	16 ± 4	13 ± 4	11 ± 4	13 ± 4	14 ± 4	13 ± 4
04/08/20 - 04/16/20	(1)	15 ± 3	17 ± 4	16 ± 3	19 ± 4	18 ± 4	18 ± 4	13 ± 3	16 ± 3
04/16/20 - 04/23/20	16 ± 4	9 ± 4	12 ± 4	15 ± 4	15 ± 4	15 ± 4	11 ± 4	13 ± 4	17 ± 4
04/23/20 - 04/30/20	13 ± 4	11 ± 4	13 ± 4	15 ± 4	14 ± 4	12 ± 4	13 ± 4	14 ± 4	16 ± 4
04/30/20 - 05/06/20	8 ± 4	6 ± 4	6 ± 4	8 ± 4	7 ± 4	7 ± 4	< 6	7 ± 4	9 ± 4
05/06/20 - 05/14/20	10 ± 3	9 ± 3	10 ± 3	11 ± 3	12 ± 4	8 ± 3	10 ± 3	10 ± 3	10 ± 3
05/14/20 - 05/21/20	8 ± 4	9 ± 4	9 ± 4	9 ± 4	9 ± 4	6 ± 4	9 ± 4	9 ± 4	10 ± 4
05/21/20 - 05/28/20	10 ± 4	11 ± 4	7 ± 3	10 ± 4	9 ± 3	17 ± 7	9 ± 3	9 ± 4	9 ± 4
05/28/20 - 06/03/20	9 ± 4	8 ± 4	8 ± 4	10 ± 4	7 ± 4	11 ± 4	9 ± 4	11 ± 4	12 ± 4
06/03/20 - 06/11/20	16 ± 4	16 ± 4	15 ± 4	12 ± 3	15 ± 4	13 ± 4	11 ± 3	13 ± 4	14 ± 4
06/11/20 - 06/18/20	17 ± 5	15 ± 4	16 ± 4	17 ± 4	17 ± 5	13 ± 4	13 ± 4	14 ± 4	18 ± 5
06/18/20 - 06/25/20	19 ± 5	20 ± 5	22 ± 5	20 ± 4	22 ± 5	16 ± 4	22 ± 5	21 ± 5	21 ± 4
06/25/20 - 07/01/20	13 ± 5	15 ± 5	9 ± 4	12 ± 4	18 ± 5	12 ± 4	13 ± 5	11 ± 4	12 ± 5
07/01/20 - 07/08/20	17 ± 4	18 ± 4	25 ± 5	20 ± 4	24 ± 5	23 ± 4	24 ± 5	19 ± 4	21 ± 4
07/08/20 - 07/16/20	20 ± 4	21 ± 4	16 ± 4	18 ± 4	18 ± 4	21 ± 4	21 ± 4	20 ± 4	15 ± 4
07/16/20 - 07/23/20	24 ± 5	17 ± 4	15 ± 4	19 ± 8	17 ± 4	17 ± 4	19 ± 4	18 ± 4	19 ± 4
07/23/20 - 07/29/20	14 ± 4	12 ± 4	11 ± 4	14 ± 4	8 ± 4	14 ± 4	13 ± 4	9 ± 4	11 ± 4
07/29/20 - 08/05/20	13 ± 4	12 ± 4	13 ± 4	15 ± 4	12 ± 4	13 ± 4	16 ± 4	14 ± 4	11 ± 4
08/05/20 - 08/13/20	18 ± 2	27 ± 5	17 ± 4	22 ± 4	26 ± 4	24 ± 5	21 ± 4	22 ± 4	26 ± 5
08/13/20 - 08/20/20	(1)	17 ± 4	20 ± 4	22 ± 4	22 ± 4	20 ± 4	21 ± 4	19 ± 4	19 ± 4
08/20/20 - 08/27/20	(1)	23 ± 5	25 ± 5	30 ± 5	24 ± 5	29 ± 5	26 ± 5	23 ± 5	27 ± 5
08/27/20 - 09/02/20	24 ± 5	20 ± 5	21 ± 5	20 ± 5	18 ± 5	20 ± 5	21 ± 5	19 ± 5	17 ± 5
09/02/20 - 09/10/20	11 ± 4	9 ± 3	12 ± 3	11 ± 3	13 ± 3	13 ± 3	13 ± 3	15 ± 4	16 ± 4
09/10/20 - 09/17/20	16 ± 4	15 ± 4	16 ± 4	13 ± 4	16 ± 4	20 ± 4	15 ± 4	14 ± 4	20 ± 4
09/17/20 - 09/24/20	27 ± 5	25 ± 5	22 ± 4	23 ± 5	28 ± 5	27 ± 5	25 ± 5	17 ± 4	27 ± 5
09/24/20 - 09/30/20	14 ± 5	17 ± 5	13 ± 5	15 ± 5	13 ± 5	18 ± 5	15 ± 5	16 ± 5	13 ± 5
09/30/20 - 10/07/20	14 ± 4	16 ± 4	14 ± 4	15 ± 4	15 ± 4	14 ± 4	13 ± 4	15 ± 4	12 ± 4
10/07/20 - 10/15/20	19 ± 4	20 ± 4	19 ± 4	21 ± 4	23 ± 4	24 ± 5	23 ± 4	18 ± 4	29 ± 5
10/15/20 - 10/22/20	20 ± 5	17 ± 5	21 ± 5	15 ± 4	14 ± 5	19 ± 5	19 ± 5	17 ± 6	16 ± 5
10/22/20 - 10/29/20	21 ± 4	16 ± 4	20 ± 4	21 ± 4	18 ± 4	18 ± 4	15 ± 4	16 ± 4	17 ± 4
10/29/20 - 11/04/20	25 ± 6	29 ± 6	23 ± 5	26 ± 5	27 ± 6	29 ± 6	25 ± 5	21 ± 5	22 ± 5
11/04/20 - 11/12/20	19 ± 4	20 ± 4	23 ± 4	25 ± 4	19 ± 4	21 ± 4	26 ± 4	20 ± 4	20 ± 4
11/12/20 - 11/19/20	21 ± 4	18 ± 4	20 ± 4	18 ± 4	19 ± 4	20 ± 4	22 ± 4	25 ± 5	23 ± 4
11/19/20 - 11/25/20	21 ± 5	21 ± 5	25 ± 5	22 ± 5	20 ± 5	24 ± 5	29 ± 5	25 ± 5	22 ± 5
11/25/20 - 12/02/20	18 ± 4	15 ± 4	17 ± 4	14 ± 4	15 ± 4	18 ± 4	16 ± 4	13 ± 4	16 ± 4
12/02/20 - 12/10/20	31 ± 5	30 ± 5	32 ± 5	32 ± 5	35 ± 5	30 ± 5	29 ± 5	35 ± 5	36 ± 5
12/10/20 - 12/17/20	20 ± 5	19 ± 4	22 ± 5	23 ± 4	20 ± 5	27 ± 5	23 ± 5	22 ± 5	23 ± 5
12/17/20 - 12/23/20	31 ± 6	26 ± 5	27 ± 5	30 ± 5	26 ± 5	30 ± 5	29 ± 5	32 ± 5	30 ± 6
12/23/20 - 12/30/20	17 ± 5	13 ± 4	(1)	11 ± 4	13 ± 4	14 ± 4	16 ± 4	15 ± 4	15 ± 4
(2) MEAN ± 2 STD DEV	16 ± 11	16 ± 11	16 ± 12	17 ± 12	17 ± 12	17 ± 12	17 ± 12	16 ± 12	17 ± 12

(1) SEE PROGRAM EXCEPTIONS SECTION FOR EXPLANATION

(2) THE MEAN AND TWO STANDARD DEVIATION ARE CALCULATED USING THE POSITIVE VALUES (VALUES ≥ MDC)

Table C-V.2

**MONTHLY AND YEARLY MEAN VALUES OF GROSS BETA CONCENTRATIONS IN AIR
PARTICULATE SAMPLES COLLECTED IN THE VICINITY OF LASALLE COUNTY STATION, 2020**
RESULTS IN UNITS OF E-3 PC/UCU METER ± 2 SIGMA

GROUP I - ONSITE LOCATIONS				GROUP II - NEAR-SITE LOCATIONS				GROUP III - FAR-FIELD LOCATIONS				GROUP IV - CONTROL LOCATION			
COLLECTION PERIOD	MIN MAX	MEAN ± 2SD		COLLECTION PERIOD	MIN MAX	MEAN ± 2SD		COLLECTION PERIOD	MIN MAX	MEAN ± 2SD		COLLECTION PERIOD	MIN MAX	MEAN ± 2SD	
01/02/20 - 01/30/20	13 23	16 ± 8		01/02/20 - 01/30/20	11 20	15 ± 5		01/02/20 - 01/30/20	11 26	16 ± 8		01/02/20 - 01/30/20	11 21	15 ± 9	
01/30/20 - 02/27/20	10 21	14 ± 9		01/30/20 - 02/27/20	7 26	13 ± 12		01/30/20 - 02/27/20	7 30	14 ± 13		01/30/20 - 02/27/20	11 21	15 ± 8	
02/27/20 - 04/01/20	8 16	12 ± 5		02/27/20 - 04/01/20	9 17	12 ± 5		02/27/20 - 04/01/20	8 17	12 ± 5		02/27/20 - 04/01/20	9 13	12 ± 3	
04/01/20 - 04/30/20	9 16	12 ± 5		04/01/20 - 04/30/20	12 17	15 ± 4		04/01/20 - 04/30/20	11 19	14 ± 5		04/01/20 - 04/30/20	13 17	15 ± 4	
04/30/20 - 06/03/20	6 11	9 ± 3		04/30/20 - 06/03/20	6 11	9 ± 3		04/30/20 - 06/03/20	6 17	9 ± 5		04/30/20 - 06/03/20	9 12	10 ± 3	
06/03/20 - 07/01/20	13 20	16 ± 4		06/03/20 - 07/01/20	9 22	15 ± 8		06/03/20 - 07/01/20	11 22	15 ± 8		06/03/20 - 07/01/20	12 21	16 ± 8	
07/01/20 - 07/29/20	12 24	18 ± 8		07/01/20 - 07/29/20	11 25	17 ± 8		07/01/20 - 07/29/20	8 24	18 ± 10		07/01/20 - 07/29/20	11 21	17 ± 9	
07/29/20 - 09/02/20	12 27	19 ± 10		07/29/20 - 09/02/20	13 30	21 ± 10		07/29/20 - 09/02/20	12 29	20 ± 9		07/29/20 - 09/02/20	11 27	20 ± 13	
09/02/20 - 09/30/20	9 27	17 ± 13		09/02/20 - 09/30/20	11 23	16 ± 9		09/02/20 - 09/30/20	13 28	17 ± 10		09/02/20 - 09/30/20	13 27	19 ± 12	
09/30/20 - 10/29/20	14 21	18 ± 5		09/30/20 - 10/29/20	14 21	18 ± 6		09/30/20 - 10/29/20	13 24	18 ± 7		09/30/20 - 10/29/20	12 29	19 ± 14	
10/29/20 - 12/02/20	15 29	21 ± 8		10/29/20 - 12/02/20	14 26	21 ± 8		10/29/20 - 12/02/20	13 29	22 ± 9		10/29/20 - 12/02/20	16 23	21 ± 5	
12/02/20 - 12/30/20	13 31	23 ± 14		12/02/20 - 12/30/20	11 32	26 ± 15		12/02/20 - 12/30/20	13 35	25 ± 15		12/02/20 - 12/30/20	15 36	26 ± 18	
01/02/20 - 12/30/20	6 31	16 ± 11		01/02/20 - 12/30/20	6 32	16 ± 12		01/02/20 - 12/30/20	6 35	17 ± 12		01/02/20 - 12/30/20	9 36	17 ± 12	

Table C-V.3

CONCENTRATIONS OF GAMMA EMITTERS IN AIR PARTICULATE SAMPLES
COLLECTED IN THE VICINITY OF LASALLE COUNTY STATION, 2020

RESULTS IN UNITS OF E-3 PCI/CU METER ± 2 SIGMA

SITE	COLLECTION PERIOD	RESULTS IN UNITS OF E-3 PCI/CU METER ± 2 SIGMA										
		Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
L-01	01/02/20 - 04/01/20	< 4	< 5	< 13	< 4	< 8	< 6	< 11	< 4	< 3	< 231	< 94
	04/01/20 - 07/01/20	< 2	< 3	< 10	< 2	< 4	< 3	< 5	< 2	< 2	< 141	< 46
	07/01/20 - 09/30/20	< 2	< 4	< 12	< 2	< 4	< 3	< 6	< 2	< 1	< 153	< 104
	09/30/20 - 12/23/20	< 3	< 4	< 10	< 2	< 7	< 3	< 7	< 2	< 2	< 189	< 89
	MEAN	-	-	-	-	-	-	-	-	-	-	-
L-03	01/02/20 - 04/01/20	< 3	< 3	< 6	< 2	< 7	< 3	< 7	< 3	< 2	< 180	< 75
	04/01/20 - 07/01/20	< 2	< 4	< 6	< 3	< 6	< 4	< 6	< 2	< 3	< 164	< 81
	07/01/20 - 09/30/20	< 3	< 4	< 16	< 3	< 6	< 5	< 7	< 3	< 2	< 412	< 83
	09/30/20 - 12/30/20	< 2	< 4	< 9	< 3	< 5	< 3	< 6	< 2	< 2	< 92	< 50
	MEAN	-	-	-	-	-	-	-	-	-	-	-
L-04	01/02/20 - 04/01/20	< 3	< 3	< 11	< 3	< 4	< 4	< 6	< 2	< 2	< 120	< 29
	04/01/20 - 07/01/20	< 3	< 4	< 11	< 3	< 5	< 5	< 7	< 3	< 2	< 190	< 76
	07/01/20 - 09/30/20	< 3	< 5	< 14	< 2	< 7	< 6	< 9	< 3	< 2	< 254	< 133
	09/30/20 - 12/30/20	< 3	< 4	< 11	< 3	< 7	< 4	< 7	< 4	< 3	< 158	< 72
	MEAN	-	-	-	-	-	-	-	-	-	-	-
L-05	01/02/20 - 04/01/20	< 2	< 3	< 12	< 3	< 7	< 4	< 6	< 2	< 2	< 105	< 45
	04/01/20 - 07/01/20	< 2	< 4	< 12	< 2	< 5	< 2	< 5	< 2	< 2	< 112	< 55
	07/01/20 - 09/30/20	< 3	< 3	< 15	< 2	< 5	< 4	< 8	< 2	< 2	< 283	< 139
	09/30/20 - 12/30/20	< 4	< 6	< 18	< 5	< 11	< 6	< 10	< 4	< 4	< 290	< 94
	MEAN	-	-	-	-	-	-	-	-	-	-	-
L-06	01/02/20 - 04/01/20	< 2	< 3	< 10	< 1	< 6	< 4	< 5	< 2	< 1	< 141	< 84
	04/01/20 - 07/01/20	< 3	< 5	< 13	< 3	< 7	< 4	< 6	< 2	< 2	< 177	< 91
	07/01/20 - 09/30/20	< 4	< 6	< 22	< 3	< 10	< 6	< 12	< 4	< 4	< 403	< 186
	09/30/20 - 12/30/20	< 3	< 3	< 13	< 2	< 6	< 4	< 7	< 3	< 2	< 166	< 50
	MEAN	-	-	-	-	-	-	-	-	-	-	-

Table C-V.3

CONCENTRATIONS OF GAMMA EMITTERS IN AIR PARTICULATE SAMPLES
COLLECTED IN THE VICINITY OF LASALLE COUNTY STATION, 2020

RESULTS IN UNITS OF E-3 PCI/CU METER ± 2 SIGMA

SITE	COLLECTION PERIOD	RESULTS IN UNITS OF E-3 PCI/CU METER ± 2 SIGMA										
		Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
L-07	01/02/20 - 04/01/20	< 3	< 4	< 10	< 2	< 5	< 5	< 8	< 3	< 2	< 183	< 59
	04/01/20 - 07/01/20	< 2	< 3	< 13	< 1	< 5	< 3	< 6	< 2	< 2	< 162	< 70
	07/01/20 - 09/30/20	< 3	< 5	< 10	< 3	< 8	< 4	< 8	< 3	< 3	< 251	< 112
	09/30/20 - 12/30/20	< 2	< 2	< 4	< 1	< 5	< 3	< 5	< 2	< 2	< 128	< 51
	MEAN	-	-	-	-	-	-	-	-	-	-	-
L-08	01/02/20 - 04/01/20	< 2	< 3	< 5	< 1	< 5	< 4	< 5	< 2	< 2	< 124	< 65
	04/01/20 - 07/01/20	< 3	< 4	< 11	< 2	< 7	< 5	< 7	< 3	< 3	< 163	< 35
	07/01/20 - 09/30/20	< 2	< 3	< 11	< 1	< 7	< 4	< 6	< 1	< 2	< 253	< 94
	09/30/20 - 12/30/20	< 3	< 5	< 14	< 3	< 6	< 4	< 8	< 2	< 2	< 168	< 70
	MEAN	-	-	-	-	-	-	-	-	-	-	-
L-10	01/02/20 - 04/01/20	< 3	< 3	< 11	< 3	< 8	< 4	< 6	< 3	< 2	< 174	< 41
	04/01/20 - 07/01/20	< 4	< 7	< 18	< 4	< 10	< 6	< 11	< 4	< 4	< 286	< 138
	07/01/20 - 09/30/20	< 2	< 2	< 9	< 1	< 6	< 4	< 5	< 2	< 2	< 214	< 70
	09/30/20 - 12/30/20	< 4	< 6	< 17	< 5	< 9	< 5	< 10	< 4	< 3	< 230	< 133
	MEAN	-	-	-	-	-	-	-	-	-	-	-
L-11A	01/02/20 - 04/01/20	< 4	< 7	< 18	< 5	< 10	< 6	< 11	< 5	< 4	< 234	< 98
	04/01/20 - 07/01/20	< 2	< 2	< 7	< 1	< 6	< 3	< 6	< 2	< 2	< 158	< 52
	07/01/20 - 09/30/20	< 2	< 3	< 11	< 2	< 7	< 4	< 6	< 3	< 1	< 215	< 68
	09/30/20 - 12/30/20	< 2	< 2	< 9	< 2	< 4	< 3	< 5	< 2	< 2	< 175	< 57
	MEAN	-	-	-	-	-	-	-	-	-	-	-

Table C-VI.1

**CONCENTRATIONS OF I-131 IN AIR IODINE SAMPLES
COLLECTED IN THE VICINITY OF LASALLE COUNTY STATION, 2020**
RESULTS IN UNITS OF E-3 PCI/CU METER \pm 2 SIGMA

COLLECTION PERIOD	GROUP I		GROUP II		GROUP III			GROUP IV	
	L-03	L-05	L-01	L-06	L-04	L-07	L-08	L-11A	L-10
01/02/20 - 01/09/20	< 19	< 22	< 22	< 22	< 21	< 28	< 28	< 29	< 27
01/09/20 - 01/16/20	< 27	< 26	< 26	< 26	< 23	< 29	< 29	< 29	< 28
01/16/20 - 01/23/20	< 37	< 33	< 37	< 39	< 37	< 59	< 57	< 58	< 56
01/23/20 - 01/30/20	< 27	< 26	< 27	< 44	< 27	< 44	< 38	< 45	< 42
01/30/20 - 02/05/20	< 26	< 30	< 30	< 31	< 31	< 41	< 41	< 40	< 38
02/05/20 - 02/13/20	< 40	< 40	< 39	< 40	< 34	< 39	< 39	< 38	< 39
02/13/20 - 02/20/20	< 30	< 30	< 29	< 39	< 30	< 39	< 38	< 37	< 24
02/20/20 - 02/27/20	< 31	< 31	< 31	< 27	< 33	< 23	< 23	< 23	< 22
02/27/20 - 03/04/20	< 62	< 60	< 62	< 63	< 27	< 56	< 49	< 57	< 54
03/04/20 - 03/12/20	< 37	< 36	< 36	< 31	< 37	< 66	< 65	< 66	< 64
03/12/20 - 03/19/20	< 36	< 40	< 41	< 41	< 42	< 38	< 36	< 37	< 35
03/19/20 - 03/26/20	< 50	< 23	< 48	< 49	< 49	< 46	< 46	< 46	< 46
03/26/20 - 04/01/20	< 34	< 38	< 39	< 28	< 18	< 19	< 28	< 29	< 28
04/01/20 - 04/08/20	< 13	< 27	< 26	< 27	< 27	< 34	< 34	< 35	< 34
04/08/20 - 04/16/20	(1)	< 45	< 45	< 22	< 49	< 47	< 45	< 46	< 45
04/16/20 - 04/23/20	< 22	< 44	< 45	< 44	< 45	< 50	< 50	< 49	< 48
04/23/20 - 04/30/20	< 43	< 41	< 39	< 52	< 43	< 26	< 53	< 55	< 54
04/30/20 - 05/06/20	< 28	< 45	< 47	< 47	< 49	< 65	< 28	< 65	< 64
05/06/20 - 05/14/20	< 15	< 25	< 25	< 25	< 26	< 29	< 30	< 30	< 30
05/14/20 - 05/21/20	< 26	< 46	< 43	< 43	< 45	< 66	< 66	< 68	< 66
05/21/20 - 05/28/20	< 14	< 14	< 14	< 48	< 8	< 54	< 48	< 50	< 49
05/28/20 - 06/03/20	< 47	< 45	< 47	< 39	< 45	< 40	< 40	< 23	< 40
06/03/20 - 06/11/20	< 38	< 37	< 37	< 41	< 36	< 43	< 23	< 42	< 42
06/11/20 - 06/18/20	< 40	< 38	< 39	< 31	< 39	< 32	< 31	< 32	< 13
06/18/20 - 06/25/20	< 62	< 60	< 25	< 58	< 62	< 43	< 28	< 44	< 43
06/25/20 - 07/01/20	< 33	< 31	< 33	< 18	< 34	< 51	< 51	< 52	< 51
07/01/20 - 07/08/20	< 49	< 48	< 46	< 25	< 44	< 37	< 37	< 39	< 38
07/08/20 - 07/16/20	< 31	< 31	< 31	< 30	< 13	< 20	< 20	< 20	< 20
07/16/20 - 07/23/20	< 43	< 42	< 41	< 66	< 42	< 54	< 55	< 56	< 56
07/23/20 - 07/29/20	< 42	< 43	< 41	< 41	< 17	< 27	< 64	< 68	< 64
07/29/20 - 08/05/20	< 54	< 53	< 54	< 25	< 56	< 55	< 56	< 57	< 55
08/05/20 - 08/13/20	< 16	< 21	< 40	< 39	< 39	< 24	< 43	< 47	< 48
08/13/20 - 08/20/20	(1)	< 49	< 48	< 47	< 49	< 47	< 47	< 31	< 47
08/20/20 - 08/27/20	(1)	< 10	< 23	< 23	< 24	< 65	< 65	< 29	< 66
08/27/20 - 09/02/20	< 61	< 64	< 66	< 43	< 28	< 44	< 44	< 21	< 44
09/02/20 - 09/10/20	< 25	< 47	< 46	< 22	< 46	< 9	< 22	< 22	< 22
09/10/20 - 09/17/20	< 58	< 25	< 58	< 58	< 59	< 32	< 32	< 32	< 32
09/17/20 - 09/24/20	< 23	< 46	< 45	< 46	< 44	< 44	< 44	< 42	< 43
09/24/20 - 09/30/20	< 35	< 35	< 36	< 34	< 25	< 41	< 42	< 43	< 42
09/30/20 - 10/07/20	< 43	< 44	< 42	< 35	< 41	< 36	< 36	< 16	< 36
10/07/20 - 10/15/20	< 42	< 42	< 42	< 42	< 22	< 59	< 59	< 59	< 28
10/15/20 - 10/22/20	< 30	< 30	< 30	< 28	< 13	< 65	< 65	< 35	< 66
10/22/20 - 10/29/20	< 28	< 65	< 65	< 28	< 65	< 28	< 29	< 11	< 29
10/29/20 - 11/04/20	< 66	< 26	< 63	< 64	< 67	< 29	< 29	< 29	< 29
11/04/20 - 11/12/20	< 45	< 31	< 45	< 44	< 45	< 42	< 42	< 42	< 42
11/12/20 - 11/19/20	< 23	< 47	< 47	< 41	< 46	< 43	< 43	< 19	< 42
11/19/20 - 11/25/20	< 68	< 65	< 67	< 26	< 67	< 67	< 67	< 67	< 29
11/25/20 - 12/02/20	< 51	< 49	< 50	< 44	< 51	< 46	< 23	< 45	< 46
12/02/20 - 12/10/20	< 54	< 23	< 55	< 53	< 54	< 43	< 42	< 42	< 42
12/10/20 - 12/17/20	< 25	< 50	< 51	< 47	< 51	< 43	< 44	< 42	< 44
12/17/20 - 12/23/20	< 49	< 48	< 48	< 54	< 49	< 56	< 56	< 53	< 29
12/23/20 - 12/30/20	< 26	< 55	(1)	< 55	< 58	< 58	< 56	< 54	< 57
MEAN	-	-	-	-	-	-	-	-	-

(1) SEE PROGRAM EXCEPTIONS SECTION FOR EXPLANATION

**Table C-VII.1 CONCENTRATIONS OF I-131 IN MILK SAMPLES COLLECTED
IN THE VICINITY OF LASALLE COUNTY STATION, 2020**
RESULTS IN UNITS OF PCI/LITER \pm 2 SIGMA

COLLECTION PERIOD	CONTROL FARM L-42
01/02/20	< 0.6
02/06/20	< 0.7
03/04/20	< 0.9
04/01/20	< 0.5
05/01/20	< 0.7
05/06/20	< 0.9
05/21/20	< 0.9
06/03/20	< 0.9
06/18/20	< 0.9
07/01/20	< 0.7
07/16/20	< 0.9
07/29/20	< 0.7
08/13/20	< 0.9
08/27/20	< 0.9
09/10/20	< 0.9
09/24/20	< 0.9
10/07/20	< 0.8
10/22/20	< 0.8
11/04/20	< 0.9
12/05/20	(1)
MEAN	-

(1) SEE PROGRAM EXCEPTIONS SECTION FOR EXPLANATION

Table C-VII.2 **CONCENTRATIONS OF GAMMA EMITTERS IN MILK SAMPLES COLLECTED**
IN THE VICINITY OF LASALLE COUNTY STATION, 2020

RESULTS IN UNITS OF PCI/LITER ± 2 SIGMA

COLLECTION		Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
SITE	PERIOD											
L-42	01/02/20	< 8	< 8	< 18	< 8	< 17	< 8	< 14	< 9	< 8	< 30	< 7
	02/06/20	< 7	< 7	< 11	< 7	< 15	< 6	< 10	< 7	< 6	< 22	< 10
	03/04/20	< 8	< 7	< 19	< 8	< 17	< 8	< 13	< 10	< 9	< 38	< 11
	04/01/20	< 4	< 4	< 9	< 5	< 10	< 5	< 8	< 5	< 5	< 18	< 6
	05/01/20	< 5	< 7	< 17	< 8	< 13	< 6	< 13	< 8	< 8	< 30	< 10
	05/06/20	< 8	< 8	< 17	< 11	< 17	< 9	< 16	< 8	< 9	< 33	< 12
	05/21/20	< 7	< 8	< 22	< 6	< 18	< 8	< 14	< 7	< 8	< 36	< 12
	06/03/20	< 8	< 7	< 18	< 9	< 20	< 9	< 11	< 9	< 8	< 33	< 13
	06/18/20	< 8	< 8	< 20	< 8	< 20	< 8	< 12	< 9	< 8	< 33	< 9
	07/01/20	< 6	< 6	< 14	< 11	< 13	< 7	< 12	< 7	< 6	< 25	< 7
	07/16/20	< 7	< 10	< 15	< 8	< 20	< 9	< 13	< 10	< 8	< 35	< 8
	07/29/20	< 7	< 9	< 13	< 10	< 17	< 8	< 16	< 10	< 8	< 39	< 10
	08/13/20	< 8	< 7	< 16	< 10	< 19	< 9	< 15	< 8	< 7	< 43	< 10
	08/27/20	< 6	< 9	< 21	< 6	< 19	< 7	< 15	< 8	< 7	< 35	< 9
	09/10/20	< 8	< 8	< 12	< 7	< 15	< 8	< 12	< 8	< 7	< 25	< 11
	09/24/20	< 9	< 8	< 21	< 7	< 22	< 8	< 14	< 10	< 8	< 38	< 12
	10/07/20	< 9	< 9	< 16	< 10	< 17	< 9	< 15	< 9	< 10	< 34	< 11
	10/22/20	< 8	< 8	< 19	< 8	< 21	< 8	< 13	< 10	< 9	< 30	< 11
	11/04/20	< 5	< 6	< 11	< 6	< 13	< 6	< 10	< 7	< 6	< 26	< 8
	12/05/20 (1)											
	MEAN	-	-	-	-	-	-	-	-	-	-	-

(1) SEE PROGRAM EXCEPTIONS SECTION FOR EXPLANATION

Table C-VIII.1 **CONCENTRATIONS OF GAMMA EMITTERS IN FOOD PRODUCT SAMPLES**
COLLECTED IN THE VICINITY OF LASALLE COUNTY STATION, 2020
 RESULTS IN UNITS OF PCI/KG WET ± 2 SIGMA

SITE	COLLECTION PERIOD	RESULTS IN UNITS OF PCI/KG WET ± 2 SIGMA											
		Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	I-131	Cs-134	Cs-137	Ba-140	La-140
L-QUAD 1													
Sweet Potatoes	09/02/20	< 26	< 26	< 66	< 27	< 68	< 26	< 51	< 49	< 32	< 28	< 141	< 42
Sweet Potato Leaves	09/02/20	< 30	< 26	< 54	< 26	< 66	< 32	< 40	< 56	< 34	< 32	< 128	< 24
	MEAN	-	-	-	-	-	-	-	-	-	-	-	-
L-QUAD 2													
Red Cabbage	07/16/20	< 31	< 33	< 81	< 48	< 68	< 43	< 72	< 44	< 39	< 43	< 136	< 49
Green Cabbage	07/16/20	< 41	< 37	< 76	< 42	< 61	< 37	< 71	< 57	< 40	< 41	< 154	< 57
Horseradish	07/23/20	< 43	< 30	< 68	< 39	< 81	< 37	< 58	< 57	< 56	< 55	< 163	< 40
Horseradish Roots	07/23/20	< 41	< 38	< 96	< 40	< 69	< 39	< 69	< 52	< 45	< 38	< 152	< 36
	MEAN	-	-	-	-	-	-	-	-	-	-	-	-
L-QUAD 3													
Beet Greens	07/29/20	< 33	< 35	< 65	< 27	< 85	< 30	< 70	< 47	< 32	< 35	< 146	< 43
Red Beets	07/29/20	< 33	< 37	< 82	< 34	< 68	< 33	< 59	< 44	< 39	< 34	< 147	< 52
Potatoes	07/29/20	< 17	< 16	< 45	< 19	< 39	< 17	< 32	< 23	< 20	< 16	< 68	< 23
Red Beets	07/29/20	< 8	< 8	< 21	< 8	< 17	< 8	< 15	< 33	< 8	< 8	< 68	< 20
	MEAN	-	-	-	-	-	-	-	-	-	-	-	-
L-QUAD 4													
Cabbage	07/01/20	< 25	< 24	< 51	< 30	< 53	< 25	< 46	< 39	< 28	< 27	< 119	< 37
Onions	07/01/20	< 29	< 34	< 63	< 30	< 67	< 33	< 46	< 52	< 29	< 30	< 154	< 47
	MEAN	-	-	-	-	-	-	-	-	-	-	-	-

Table C-VIII.2

**CONCENTRATIONS OF GAMMA EMITTERS IN VEGETATION SAMPLES
COLLECTED IN THE VICINITY OF LASALLE COUNTY STATION, 2020**
RESULTS IN UNITS OF PCI/KG WET ± 2 SIGMA

SITE	COLLECTION PERIOD	CONCENTRATIONS OF GAMMA EMITTERS IN VEGETATION SAMPLES												
		Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	I-131	Cs-134	Cs-137	Ba-140	La-140	
L-VEG C														
Mayapple	05/21/20	< 23	< 21	< 39	< 23	< 50	< 23	< 35	< 31	< 22	< 24	< 103	< 34	
Red Clover	05/21/20	< 25	< 26	< 58	< 29	< 55	< 23	< 44	< 40	< 30	< 29	< 116	< 32	
Catalpa Tree Leaves	06/18/20	< 33	< 36	< 70	< 38	< 79	< 40	< 59	< 54	< 37	< 34	< 154	< 48	
Red Clover	06/18/20	< 37	< 33	< 79	< 43	< 96	< 31	< 70	< 58	< 39	< 45	< 187	< 50	
Red Clover	07/16/20	< 16	< 16	< 37	< 18	< 37	< 18	< 30	< 24	< 19	< 17	< 70	< 18	
Catalpa Tree Leaves	07/16/20	< 21	< 20	< 40	< 20	< 45	< 20	< 33	< 28	< 22	< 22	< 84	< 25	
Collard Greens	07/29/20	< 26	< 36	< 80	< 40	< 68	< 37	< 60	< 45	< 39	< 33	< 157	< 39	
Cabbage	07/29/20	< 40	< 40	< 96	< 44	< 72	< 41	< 76	< 56	< 46	< 38	< 161	< 27	
Swiss/Green Chards	07/29/20	< 40	< 34	< 84	< 37	< 88	< 31	< 56	< 50	< 38	< 40	< 145	< 46	
Dandelion	08/20/20	< 26	< 28	< 53	< 28	< 53	< 26	< 44	< 35	< 26	< 26	< 110	< 30	
Mayapple	08/20/20	< 36	< 37	< 68	< 38	< 77	< 36	< 59	< 51	< 40	< 37	< 160	< 45	
Milkweed	08/20/20	< 23	< 21	< 45	< 23	< 50	< 23	< 35	< 33	< 23	< 23	< 98	< 23	
Cabbage	08/27/20	< 48	< 29	< 72	< 60	< 112	< 50	< 62	< 59	< 51	< 41	< 179	< 39	
Tomatoes	09/02/20	< 19	< 24	< 64	< 32	< 36	< 24	< 43	< 41	< 33	< 22	< 130	< 38	
Milkweed	09/17/20	< 38	< 32	< 65	< 37	< 89	< 38	< 68	< 56	< 37	< 34	< 161	< 52	
Dandelion	09/17/20	< 47	< 47	< 108	< 48	< 118	< 59	< 74	< 57	< 55	< 54	< 250	< 80	
White Snakeroot	09/17/20	< 33	< 31	< 61	< 31	< 62	< 27	< 47	< 44	< 33	< 31	< 159	< 42	
Potatoes	09/30/20	< 24	< 39	< 66	< 30	< 80	< 38	< 60	< 45	< 24	< 33	< 125	< 32	
Velvet Leaves	10/15/20	< 18	< 17	< 36	< 18	< 37	< 19	< 33	< 29	< 18	< 18	< 84	< 27	
Dandelion	10/15/20	< 21	< 19	< 40	< 22	< 43	< 19	< 32	< 27	< 21	< 20	< 84	< 26	
MEAN		-	-	-	-	-	-	-	-	-	-	-	-	
L-ESE-1														
Red Clover	05/21/20	< 20	< 23	< 50	< 24	< 52	< 23	< 42	< 34	< 29	< 24	< 106	< 28	
Dandelion	05/21/20	< 29	< 26	< 58	< 29	< 62	< 30	< 54	< 48	< 33	< 29	< 138	< 39	
Red Clover	06/18/20	< 37	< 43	< 84	< 44	< 86	< 38	< 64	< 57	< 44	< 39	< 174	< 45	
Dandelion	06/18/20	< 32	< 29	< 76	< 33	< 70	< 35	< 60	< 52	< 38	< 34	< 148	< 47	
Soy Leaves	07/16/20	< 21	< 21	< 42	< 24	< 45	< 21	< 36	< 33	< 22	< 23	< 95	< 30	
Red Clover	07/16/20	< 34	< 33	< 84	< 34	< 70	< 41	< 60	< 57	< 41	< 41	< 164	< 50	
Red Clover	08/20/20	< 19	< 18	< 41	< 20	< 41	< 19	< 30	< 24	< 20	< 19	< 74	< 25	
Dandelion	08/20/20	< 16	< 15	< 32	< 18	< 35	< 14	< 26	< 20	< 16	< 16	< 62	< 19	
Soy Leaves	09/17/20	< 36	< 37	< 82	< 38	< 70	< 36	< 67	< 57	< 42	< 41	< 176	< 44	
Dandelion	09/17/20	< 40	< 41	< 68	< 38	< 83	< 45	< 61	< 53	< 34	< 44	< 164	< 63	
Clover	10/15/20	< 18	< 20	< 38	< 21	< 40	< 21	< 33	< 29	< 20	< 20	< 91	< 27	
Dandelion	10/15/20	< 36	< 23	< 79	< 36	< 77	< 35	< 52	< 49	< 38	< 30	< 137	< 43	
MEAN		-	-	-	-	-	-	-	-	-	-	-	-	
L-ESE-2														
Red Clover	05/21/20	< 24	< 22	< 43	< 30	< 58	< 26	< 41	< 37	< 31	< 26	< 123	< 45	
Dandelion	05/21/20	< 25	< 26	< 56	< 27	< 58	< 26	< 42	< 41	< 27	< 27	< 120	< 40	
Dock Plant	05/21/20	< 33	< 34	< 64	< 36	< 64	< 32	< 44	< 46	< 30	< 27	< 120	< 39	
Red Clover	06/18/20	< 48	< 38	< 90	< 53	< 95	< 39	< 79	< 54	< 55	< 52	< 163	< 27	
Dandelion	06/18/20	< 37	< 37	< 66	< 36	< 68	< 42	< 69	< 57	< 40	< 40	< 171	< 47	
Broadleaved Plantain	07/16/20	< 17	< 17	< 32	< 19	< 31	< 16	< 32	< 24	< 19	< 18	< 73	< 25	
Dandelion	07/16/20	< 19	< 17	< 37	< 18	< 40	< 19	< 32	< 26	< 21	< 19	< 77	< 21	
Dandelion	08/20/20	< 14	< 13	< 30	< 15	< 28	< 13	< 24	< 19	< 15	< 14	< 59	< 17	
Plantage	08/20/20	< 14	< 14	< 31	< 15	< 32	< 15	< 24	< 21	< 16	< 16	< 64	< 18	
Soy Leaved	08/20/20	< 22	< 21	< 43	< 21	< 44	< 22	< 34	< 29	< 22	< 20	< 84	< 25	
Dandelion	09/17/20	< 48	< 38	< 85	< 41	< 87	< 48	< 61	< 55	< 52	< 45	< 161	< 54	
Clover	09/17/20	< 39	< 38	< 84	< 41	< 87	< 48	< 62	< 56	< 47	< 44	< 166	< 57	
Dandelion	10/15/20	< 37	< 42	< 95	< 48	< 96	< 43	< 68	< 53	< 44	< 44	< 191	< 47	
Clover	10/15/20	< 34	< 33	< 60	< 41	< 74	< 34	< 57	< 54	< 37	< 32	< 154	< 48	
MEAN		-	-	-	-	-	-	-	-	-	-	-	-	

Table C-IX.1

QUARTERLY DLR RESULTS FOR LASALLE COUNTY STATION, 2020

Location	Location Qtrly Baseline, B _Q (mrem)	B _Q + MDD _Q	2020 Normalized Net Dose, M _{QX} (mrem/std. Qtr.)				Normalized Annual Dose, M _A (mrem/yr)	B _A ⁽¹⁾	B _A + MDD _A ⁽²⁾	Annual Facility Dose, F _A (mrem)	Annual Facility Dose, F _A >10 mrem
			1	2	3	4					
L-01	13.3	22.0	9.8	16.4	20.8	21.8	68.8	53.1	87.3	ND	No
L-03	11.9	20.6	8.9	15.9	20.4	20.2	65.4	45.3	79.5	ND	No
L-04	12	20.7	8.8	15.8	19.5	21.4	65.5	45.6	79.8	ND	No
L-05	11.7	20.4	8.2	15.1	20.6	20.8	64.7	46.8	81.0	ND	No
L-06	13.2	21.9	9.0	16.4	21.0	21.6	68.0	53.0	87.2	ND	No
L-07	12.9	21.6	8.3	15.9	21.5	21.4	67.1	51.5	85.7	ND	No
L-08	12.5	21.2	8.3	15.4	20.0	20.2	63.9	50.1	84.3	ND	No
L-10	10	18.7	6.6	13.1	17.9	20.0	57.6	39.8	74.0	ND	No
L-101	13.3	22.0	9.9	16.7	22.3	22.4	71.3	50.4	84.6	ND	No
L-102	14.9	23.6	10.6	17.6	22.6	23.5	74.4	59.5	93.7	ND	No
L-103	12.3	21.0	9.2	16.1	21.3	20.6	67.2	49.2	83.4	ND	No
L-104	11.6	20.3	8.2	14.9	19.4	20.7	63.3	46.3	80.5	ND	No
L-105	13.3	22.0	9.6	15.6	21.1	22.0	68.2	53.2	87.4	ND	No
L-106	12.3	21.0	10.0	15.4	20.7	20.7	66.8	49.2	83.4	ND	No
L-107	12.8	21.5	9.5	16.9	21.8	22.7	70.9	51.2	85.4	ND	No
L-108	11.1	19.8	10.1	15.8	21.4	21.3	68.5	44.3	78.5	ND	No
L-109	12.9	21.6	8.8	14.8	21.7	21.1	66.4	51.6	85.8	ND	No
L-110	12.4	21.1	9.1	16.7	20.1	21.3	67.2	49.7	83.9	ND	No
L-111B	13.1	21.8	9.0	16.5	20.3	20.9	66.8	52.3	86.5	ND	No
L-112	12.4	21.1	8.8	15.4	21.1	21.2	66.4	49.6	83.8	ND	No
L-113A	13.8	22.5	11.6	17.7	22.4	22.1	73.8	55.2	89.4	ND	No
L-114	13.1	21.8	9.0	16.1	22.3	20.7	68.1	50.0	84.2	ND	No
L-115	11.2	19.9	8.3	14.8	22.3	20.4	65.8	44.8	79.0	ND	No
L-116	11.2	19.9	9.0	14.6	18.7	21.8	64.2	44.8	79.0	ND	No
L-11A	10.3	19.0	7.5	15.4	20.6	19.4	62.9	41.2	75.4	ND	No
L-201	11	19.7	5.9	12.0	17.1	18.0	52.9	43.8	78.0	ND	No
L-202	10.2	18.9	7.2	12.6	19.0	18.1	57.0	40.9	75.1	ND	No
L-203	12.8	21.5	8.8	15.4	21.6	20.9	66.7	51.1	85.3	ND	No
L-204	13.3	22.0	9.9	16.4	22.5	22.1	71.0	50.7	84.9	ND	No
L-205A	12.2	20.9	9.2	16.0	20.7	21.1	67.1	48.8	83.0	ND	No
L-205B	12	20.7	9.3	15.4	20.3	20.6	65.6	45.7	79.9	ND	No
L-206	12.9	21.6	9.1	17.1	21.3	20.3	67.7	51.6	85.8	ND	No
L-207	12.1	20.8	8.9	17.0	20.7	20.8	67.4	48.5	82.7	ND	No
L-208	13.1	21.8	9.9	17.5	23.0	22.6	73.1	44.6	78.8	ND	No
L-209	12.4	21.1	10.0	16.7	(3)	20.3	46.9	47.2	81.4	ND	No
L-210	13.7	22.4	10.4	20.2	22.2	23.5	76.2	51.9	86.1	ND	No
L-211	13.5	22.2	8.7	16.7	22.2	21.8	69.4	54.1	88.3	ND	No
L-212	13.3	22.0	9.6	17.1	21.3	21.8	69.7	50.5	84.7	ND	No
L-213	11.5	20.2	8.6	15.1	19.4	20.7	63.8	41.6	75.8	ND	No
L-214	11.9	20.6	9.0	15.5	20.8	21.2	66.5	47.6	81.8	ND	No
L-215	13.6	22.3	10.3	17.1	21.7	22.0	71.1	54.4	88.6	ND	No
L-216	13.4	22.1	9.3	16.4	20.8	22.2	68.7	53.5	87.7	ND	No


⁽¹⁾ **Baseline background dose (B_A):** The estimated mean background radiation dose at each field monitoring location annually based on historical measurements, excluding any dose contribution from the monitored facility

⁽²⁾ **Minimum differential dose (MDD_A):** The smallest amount of facility related dose at each monitored location annually above the baseline background dose that can be reliably detected by an environmental dosimetry system

⁽³⁾ SEE PROGRAM EXCEPTIONS SECTION FOR EXPLANATION

FIGURE C-1
Surface Water - Gross Beta - Stations L-21 (C) and L-40
Collected in the Vicinity of LSCS, 2005 - 2020

L-21 (C) Illinois River at Seneca

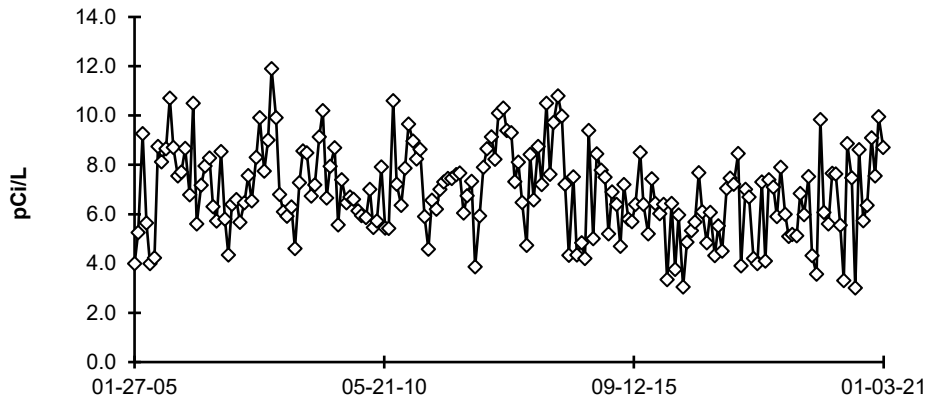

L-40 Illinois River Downstream


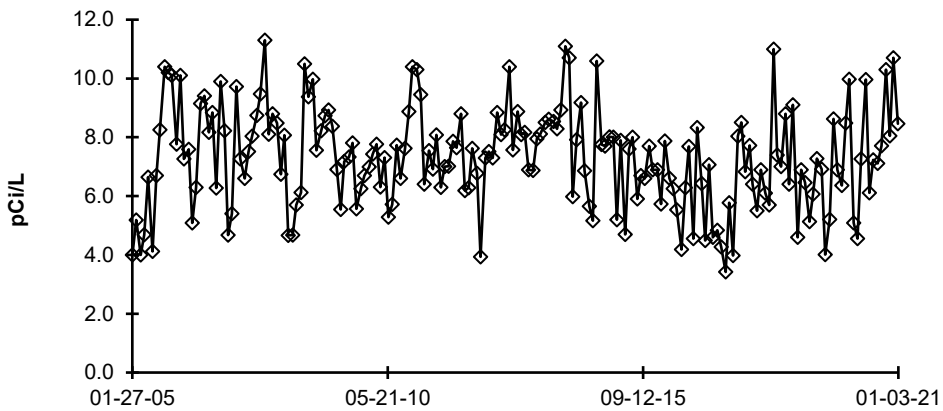


FIGURE C-2
Surface Water - Tritium - Stations L-21 (C) and L-40
Collected in the Vicinity of LSCS, 2005 - 2020

L-21 Illinois River at Seneca

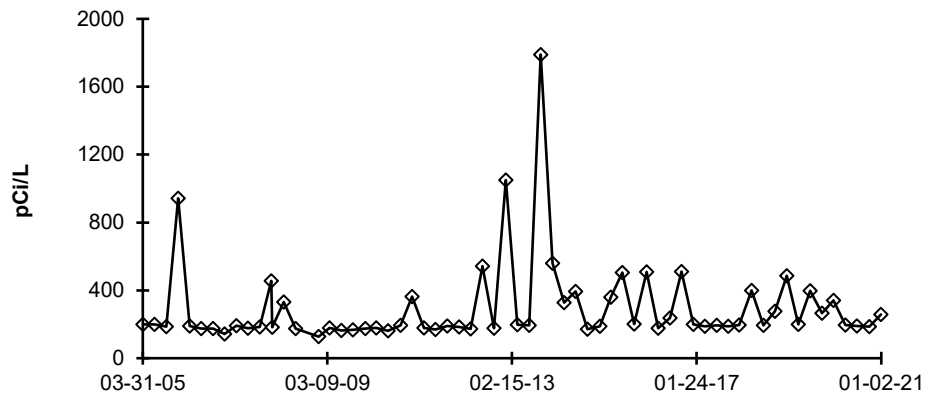

L-40 Illinois River Downstream


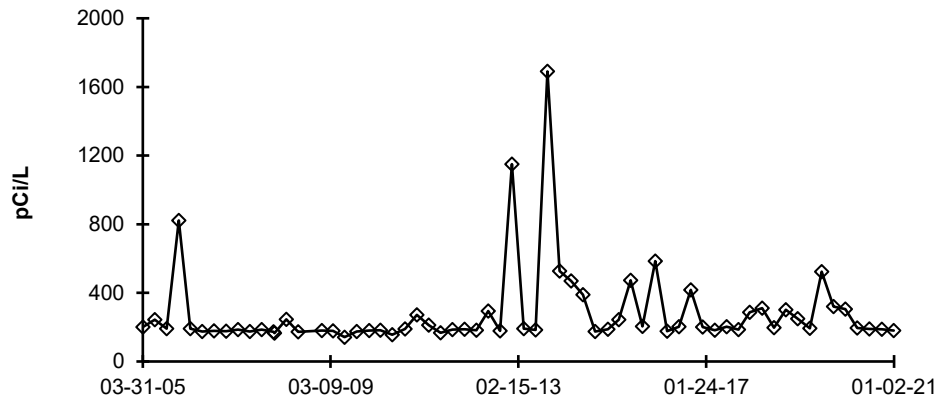


FIGURE C-3
Air Particulate - Gross Beta - Stations L-01 and L-03
Collected in the Vicinity of LSCS, 2005 - 2020

L-01 Nearsite No. 1

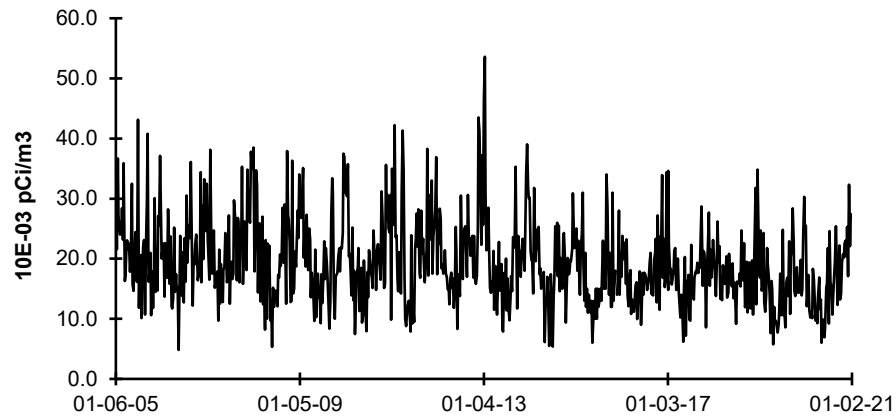

L-03 Onsite No. 3


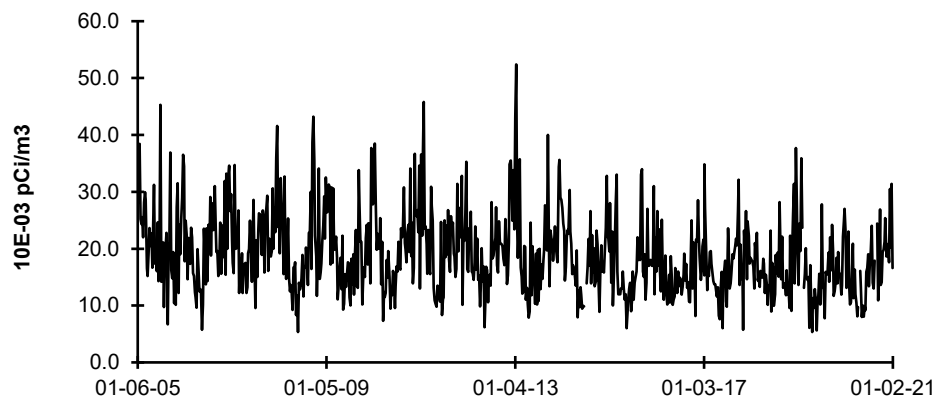


FIGURE C-4
Air Particulate - Gross Beta - Stations L-05 and L-06
Collected in the Vicinity of LSCS, 2005 - 2020

L-05 Onsite No. 5

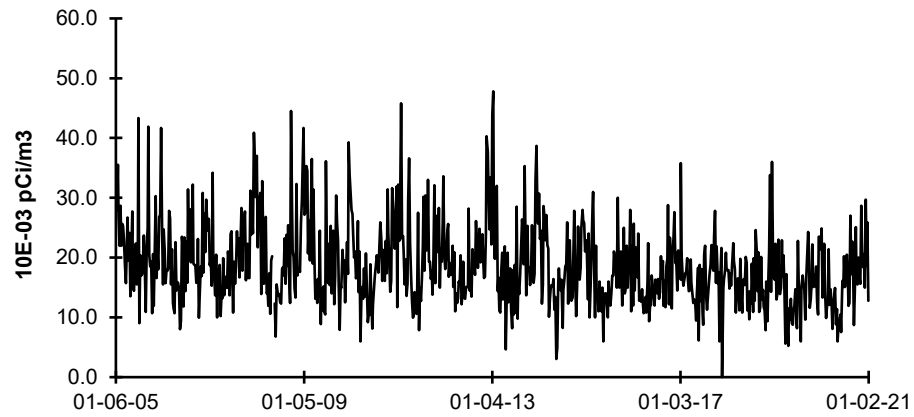

L-06 Nearsite No. 6

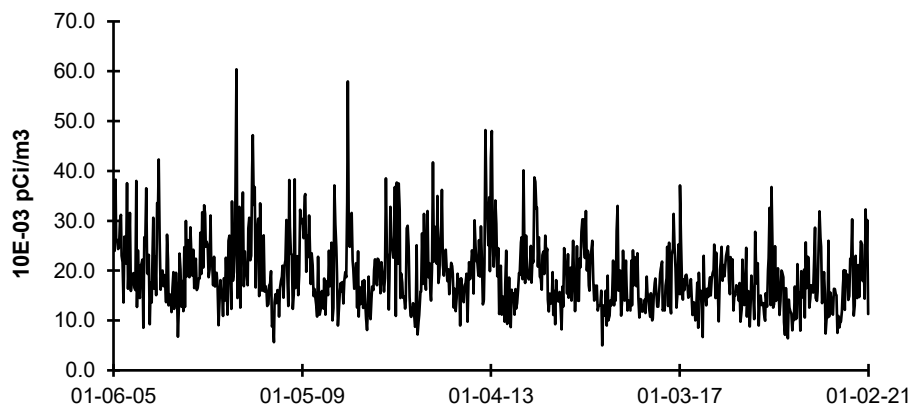


FIGURE C-5
Air Particulate - Gross Beta - Station L-10 (C)
Collected in the Vicinity of LSCS, 2005 - 2020

L-10 (C) Streator


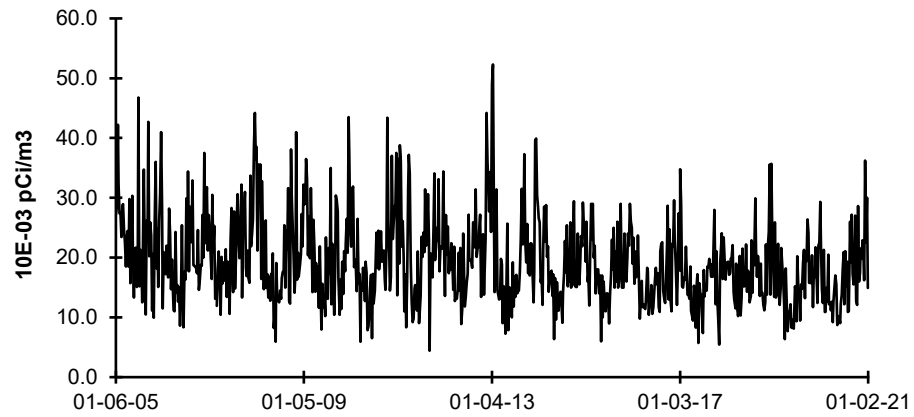


FIGURE C-6
Air Particulate - Gross Beta - Stations L-04 and L-07
Collected in the Vicinity of LSCS, 2005 - 2020

L-04 Rte. 170

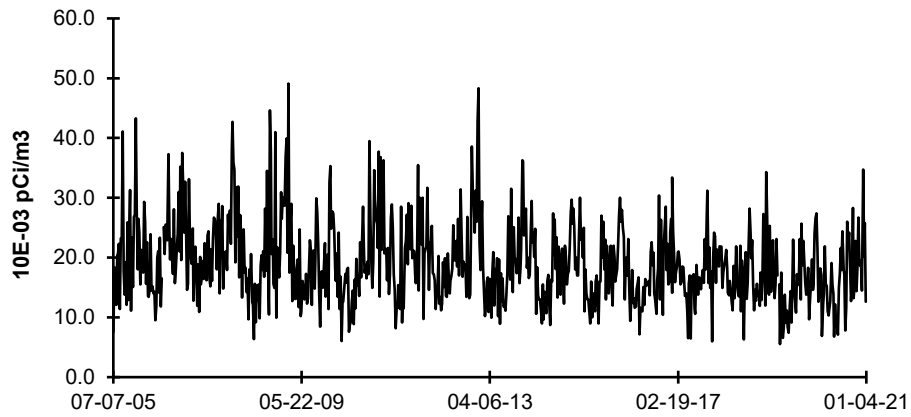

L-07 Seneca



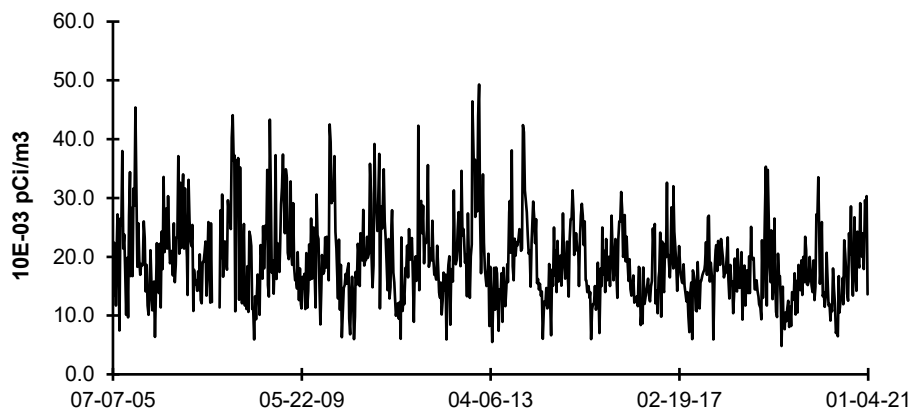


FIGURE C-7
Air Particulate - Gross Beta - Stations L-08 and L-11
Collected in the Vicinity of LSCS, 2005 - 2020

L-08 Marseilles

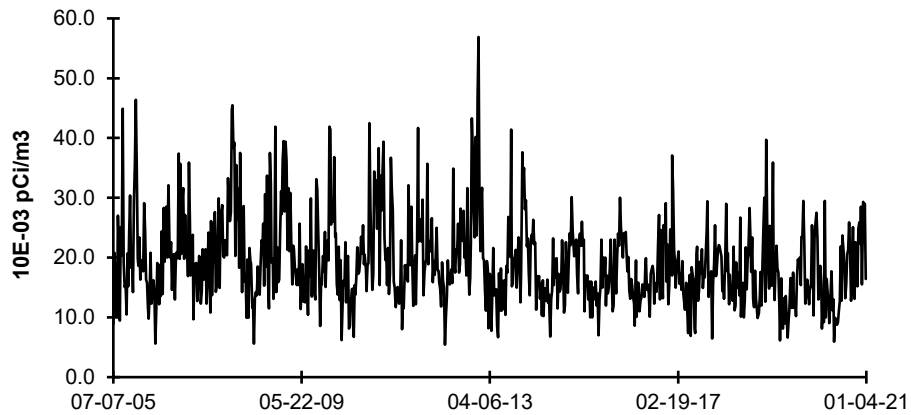


L-11 Ransom (1)

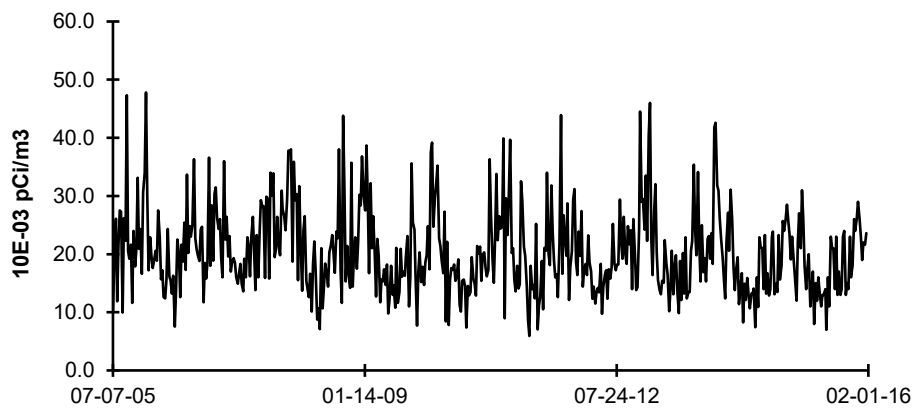

(1) Air monitoring station L-11 was retired on 01/21/16

FIGURE C-8
Air Particulate - Gross Beta - Station L-11A
Collected in the Vicinity of LSCS, 2016 - 2020

L-11A Ransom (1)

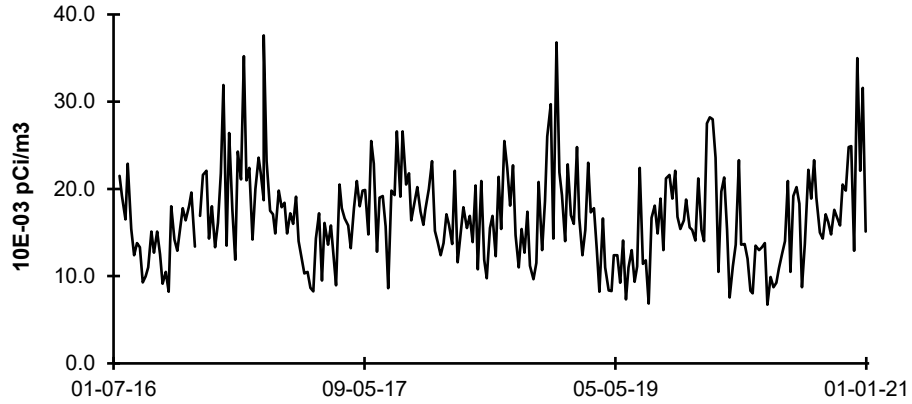

(1) Air monitoring station L-11A was placed in service on 01/14/16

APPENDIX D

INTER-LABORATORY COMPARISON PROGRAM

Intentionally left blank

**Analytics Environmental Radioactivity Cross Check Program
Teledyne Brown Engineering Environmental Services**

Table D-1

Month/Year	Identification Number	Matrix	Nuclide	Units	TBE Value	Known Value ^(a)	Ratio of TBE to Known Result	Evaluation ^(b)
September 2020	E13247	Milk	Sr-89	pCi/L	62.8	95.4	0.66	N ⁽¹⁾
			Sr-90	pCi/L	12.0	12.8	0.94	A
	E13248	Milk	Ce-141	pCi/L	156	150	1.04	A
			Co-58	pCi/L	172	180	0.96	A
			Co-60	pCi/L	369	379	0.97	A
			Cr-51	pCi/L	372	372	1.00	A
			Cs-134	pCi/L	171	200	0.85	A
			Cs-137	pCi/L	241	250	0.96	A
			Fe-59	pCi/L	217	200	1.08	A
			I-131	pCi/L	84.6	95.0	0.89	A
			Mn-54	pCi/L	175	180	0.97	A
			Zn-65	pCi/L	252	270	0.93	A
				E13249	Charcoal	I-131	pCi	70.2
	E13250	AP	Ce-141	pCi	101	101	1.00	A
			Co-58	pCi	111	120	0.92	A
			Co-60	pCi	249	254	0.98	A
			Cr-51	pCi	287	249	1.15	A
			Cs-134	pCi	114	134	0.85	A
			Cs-137	pCi	159	168	0.95	A
			Fe-59	pCi	127	134	0.95	A
			Mn-54	pCi	114	121	0.94	A
	E13251	Soil	Ce-141	pCi/g	0.241	0.191	1.26	W
Co-58			pCi/g	0.211	0.228	0.93	A	
Co-60			pCi/g	0.466	0.481	0.97	A	
Cr-51			pCi/g	0.450	0.472	0.95	A	
Cs-134			pCi/g	0.273	0.254	1.07	A	
Cs-137			pCi/g	0.370	0.390	0.95	A	
Fe-59			pCi/g	0.233	0.254	0.92	A	
Mn-54			pCi/g	0.217	0.229	0.95	A	
	E13252	AP	Sr-89	pCi	79.9	100.0	0.80	A
Sr-90			pCi	12.1	13.4	0.90	A	

(a) The Analytics known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation

(b) Analytics evaluation based on TBE internal QC limits:

A = Acceptable - reported result falls within ratio limits of 0.80-1.20

W = Acceptable with warning - reported result falls within 0.70-0.80 or 1.20-1.30

N = Not Acceptable - reported result falls outside the ratio limits of < 0.70 and > 1.30

(1) See **NCR 20-19**

**Analytics Environmental Radioactivity Cross Check Program
Teledyne Brown Engineering Environmental Services**

Table D-1

Month/Year	Identification Number	Matrix	Nuclide	Units	TBE Value	Known Value ^(a)	Ratio of TBE to Known Result	Evaluation ^(b)
December 2020	E13254	Milk	Sr-89	pCi/L	82.2	89.7	0.92	A
			Sr-90	pCi/L	12.4	13.0	0.96	A
	E13255	Milk	Ce-141	pCi/L	91.1	100	0.91	A
			Co-58	pCi/L	77.5	84.3	0.92	A
			Co-60	pCi/L	147	152	0.97	A
			Cr-51	pCi/L	259	253	1.02	A
			Cs-134	pCi/L	97.1	108	0.90	A
			Cs-137	pCi/L	117	127	0.92	A
			Fe-59	pCi/L	114	112	1.02	A
			I-131	pCi/L	84.3	91.9	0.92	A
			Mn-54	pCi/L	137	143	0.96	A
			Zn-65	pCi/L	175	190	0.92	A
				E13256	Charcoal	I-131	pCi	70.2
	E13257A	AP	Ce-141	pCi	67.4	74.6	0.90	A
			Co-58	pCi	57.9	62.9	0.92	A
			Co-60	pCi	108	113	0.95	A
			Cr-51	pCi	162	189	0.86	A
			Cs-134	pCi	68.1	80.4	0.85	A
			Cs-137	pCi	82.4	95.0	0.87	A
			Fe-59	pCi	80.5	83.7	0.96	A
			Mn-54	pCi	102	107	0.95	A
	E13258	Soil	Ce-141	pCi/g	0.167	0.170	0.98	A
			Co-58	pCi/g	0.125	0.143	0.87	A
			Co-60	pCi/g	0.245	0.257	0.95	A
			Cr-51	pCi/g	0.393	0.429	0.92	A
			Cs-134	pCi/g	0.147	0.183	0.80	A
			Cs-137	pCi/g	0.260	0.288	0.90	A
			Fe-59	pCi/g	0.199	0.190	1.05	A
			Mn-54	pCi/g	0.229	0.243	0.94	A
	E13259	AP	Sr-89	pCi	85.0	78.6	1.08	A
			Sr-90	pCi	13.1	11.4	1.15	A

(a) The Analytics known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation

(b) Analytics evaluation based on TBE internal QC limits:

A = Acceptable - reported result falls within ratio limits of 0.80-1.20

W = Acceptable with warning - reported result falls within 0.70-0.80 or 1.20-1.30

N = Not Acceptable - reported result falls outside the ratio limits of < 0.70 and > 1.30

DOE's Mixed Analyte Performance Evaluation Program (MAPEP)
Teledyne Brown Engineering Environmental Services

Table D-2

Month/Year	Identification Number	Matrix	Nuclide	Units	TBE Value	Known Value ^(a)	Acceptance Range	Evaluation ^(b)
February 2020	20-GrF42	AP	Gross Alpha	Bq/sample	0.676	1.24	0.37 - 2.11	A
			Gross Beta	Bq/sample	2.03	2.00	1.00 - 3.00	A
	20-MaS42	Soil	Ni-63	Bq/kg	0.01		(1)	A
			Sr-90	Bq/kg	348	340	238 - 442	A
	20-MaW42	Water	Ni-63	Bq/L	11.6	11.1	7.8 - 14.4	A
			Pu-238	Bq/L	0.926	0.94	0.66 - 1.22	A
			Pu-239/240	Bq/L	0.712	0.737	0.516 - 0.958	A
	20-RdF42	AP	U-234/233	Bq/sample	0.0416	0.075	0.053 - 0.098	N ⁽³⁾
			U-238	Bq/sample	0.0388	0.078	0.055 - 0.101	N ⁽³⁾
	20-RdV42	Vegetation	Cs-134	Bq/sample	3.23	3.82	2.67 - 4.97	A
			Cs-137	Bq/sample	2.64	2.77	1.94 - 3.60	A
			Co-57	Bq/sample	0.0281		(1)	A
			Co-60	Bq/sample	2.62	2.79	1.95 - 3.63	A
			Mn-54	Bq/sample	4.3	4.58	3.21 - 5.95	A
			Sr-90	Bq/sample	0.396	0.492	0.344 - 0.640	A
			Zn-65	Bq/sample	3.93	3.79	2.65 - 4.93	A
August 2020	20-GrF43	AP	Gross Alpha	Bq/sample	0.267	0.528	0.158 - 0.898	A
			Gross Beta	Bq/sample	0.939	0.915	0.458 - 1.373	A
	20-MaS43	Soil	Ni-63	Bq/kg	438	980	686 - 1274	N ⁽⁴⁾
			Tc-99	Bq/kg	1.11		(1)	A
	20-MaW43	Water	Ni-63	Bq/L	0.175		(1)	A
			Tc-99	Bq/L	8.8	9.4	6.6 - 12.2	A
	20-RdV43	Vegetation	Cs-134	Bq/sample	3.635	4.94	3.46 - 6.42	W
			Cs-137	Bq/sample	0.0341		(1)	A
			Co-57	Bq/sample	5.855	6.67	4.67 - 8.67	W
			Co-60	Bq/sample	3.122	4.13	2.89 - 5.37	W
			Mn-54	Bq/sample	4.524	5.84	4.09 - 7.59	A
			Sr-90	Bq/sample	1.01	1.39	0.97 - 1.81	W
	Zn-65	Bq/sample	4.706	6.38	4.47 - 8.29	W		

(a) The MAPEP known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation

(b) DOE/MAPEP evaluation:

A = Acceptable - reported result falls within ratio limits of 0.80-1.20

W = Acceptable with warning - reported result falls within 0.70-0.80 or 1.20-1.30

N = Not Acceptable - reported result falls outside the ratio limits of < 0.70 and > 1.30

(1) False positive test

(2) Sensitivity evaluation

(3) See **NCR 20-13**

(4) See **NCR 20-20**

**ERA Environmental Radioactivity Cross Check Program
Teledyne Brown Engineering Environmental Services**

Table D-3

Month/Year	Identification Number	Matrix	Nuclide	Units	TBE Value	Known Value ^(a)	Acceptance Limits	Evaluation ^(b)
March 2020	MRAD-32	Water	Am-241	pCi/L	52.5	45.3	31.1 - 57.9	A
			Fe-55	pCi/L	155	152	89.3 - 221	A
			Pu-238	pCi/L	34.0	36.4	21.9 - 47.2	A
			Pu-239	pCi/L	30.9	33.6	20.8 - 41.4	A
April 2020	RAD-121	Water	Ba-133	pCi/L	41.8	41.8	34.0 - 46.7	A
			Cs-134	pCi/L	42.9	46.3	37.1 - 50.9	A
			Cs-137	pCi/L	226	234	211 - 259	A
			Co-60	pCi/L	52.4	50.3	45.3 - 57.9	A
			Zn-65	pCi/L	83.3	86.8	78.1 - 104	A
			GR-A	pCi/L	20.1	23.6	11.9 - 31.6	A
			GR-B	pCi/L	45.6	60.5	41.7 - 67.2	A
			U-Nat	pCi/L	18.45	18.6	14.9 - 20.9	A
			H-3	pCi/L	14200	14100	12300 - 15500	A
			Sr-89	pCi/L	58.0	60.1	48.3 - 67.9	A
			Sr-90	pCi/L	34.1	44.7	33.0 - 51.2	A
I-131	pCi/L	27.4	28.9	24.1 - 33.8	A			
September 2020	MRAD-33	Soil	Sr-90	pCi/Kg	4360	4980	1550 - 7760	A
			AP	Fe-55	pCi/Filter	189	407	149 - 649
		Water	U-234	pCi/Filter	17.9	18.3	13.6 - 21.4	A
			U-238	pCi/Filter	19.1	18.1	13.7 - 21.6	A
			Am-241	pCi/L	160	176	121 - 225	A
			Fe-55	pCi/L	299	298	175 - 433	A
			Pu-238	pCi/L	200	191	115 - 247	A
			Pu-239	pCi/L	105	100	61.9 - 123	A
October 2020	RAD-123	Water	Ba-133	pCi/L	37.1	37.0	29.8 - 41.6	A
			Cs-134	pCi/L	50.6	52.7	42.5 - 58.0	A
			Cs-137	pCi/L	131	131	118 - 146	A
			Co-60	pCi/L	62.9	60.5	54.4 - 69.1	A
			Zn-65	pCi/L	167	162	146 - 191	A
			GR-A	pCi/L	40.0	26.2	13.3 - 34.7	N ⁽¹⁾
			GR-B	pCi/L	47.5	69.1	48.0 - 76.0	N ⁽¹⁾
			U-Nat	pCi/L	17.2	20.3	16.3 - 22.7	A
			H-3	pCi/L	23800	23200	20,300 - 25,500	A
			Sr-89	pCi/L	41.1	43.3	33.4 - 50.5	A
			Sr-90	pCi/L	28.5	30.2	22.0 - 35.0	A
I-131	pCi/L	22.9	28.2	23.5 - 33.1	N ⁽²⁾			
November 2020	QR111920K	Water	GR-A	pCi/L	50.7	52.4	27.3 - 65.6	A
			GR-B	pCi/L	24.9	24.3	15.0 - 32.3	A

(a) The ERA known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation.

(b) ERA evaluation:

A = Acceptable - Reported value falls within the Acceptance Limits

N = Not Acceptable - Reported value falls outside of the Acceptance Limits

(1) See **NCR 20-18**

(2) See **NCR 20-17**

APPENDIX E

EFFLUENT DATA

Intentionally left blank

Introduction

LaSalle County Station, a two-unit BWR, is located near Marseilles, Illinois in LaSalle County, 3.5 miles south of the Illinois River. Both units are rated at 3546 MWt. Unit 1 loaded fuel in March 1982. Unit 2 loaded fuel in late December 1983. The Station is designed to keep releases to the environment at levels below those specified in the regulations.

Liquid effluents, although no longer batch released from LaSalle County Station, were designed to be released to the Illinois River in controlled batches after radioassay of each batch. Gaseous effluents are released to the atmosphere after delay allowing time for short-lived (noble) gases to decay. Releases to the atmosphere are sampled and analyzed on a routine basis. The gaseous effluent samples are analyzed for particulate, iodine, noble gas, and tritium activity. The particulate and iodine sample results are obtained from continuously collected composite samples. The noble gas and tritium sample results are obtained from routine grab samples. The results of effluent analyses are summarized on a monthly basis and reported to the Nuclear Regulatory Commission as required per Technical Specifications. Airborne concentrations of noble gases, tritium, I-131, and particulate radioactivity in offsite areas are calculated using effluent and meteorological data.

Environmental monitoring is conducted by sampling at indicator and control (background) locations in the vicinity of LaSalle County Station to measure changes in radiation or radioactivity levels that may be attributable to station operations. If significant changes attributable to LaSalle County Station are measured, these changes are correlated with effluent releases. External gamma radiation exposure from noble gases and internal dose from I-131 in milk are the critical pathways at this site; however, an environmental monitoring program is conducted which also includes these and many other pathways which are less significant in terms of radiation protection.

Summary

Gaseous effluents for the period contributed to only a small fraction of the LaSalle County Station Radiological Effluent Controls Limits. Liquid effluents had no contribution to offsite dose, as no liquid batch radioactive discharges were conducted. Calculations of environmental concentrations based on effluent, Illinois River flow, and meteorological data for the period indicate that consumption by the public of radionuclides attributable to LaSalle County Station does not exceed regulatory limits.

Radiation exposure from radionuclides released to the atmosphere represented the critical pathway for the period with a maximum individual total dose estimated to be 1.61E-03 mrem for the year, where a shielding factor of 0.7 and an occupancy factor of 0.95 are assumed for the nearest resident. The assessment of radiation doses is performed in accordance with the Offsite Dose Calculation Manual (ODCM), specifically, a comparison of preoperational studies with operational controls or with previous environmental surveillance reports and an assessment of the observed impacts of the plant operation on the environment. Control locations are basis for "preoperational data." The results of analysis confirm that the station is operating in compliance with 10 CFR 50 Appendix I, 10 CFR 20 and 40 CFR 190.

1.0 Effluents

1.1 Gaseous Effluents to the Atmosphere

Measured concentrations of noble gases, radioiodine, and particulate radioactivity released to the atmosphere during the year, are listed in Table 1.1-1. A total of $2.50\text{E}+02$ curies of fission and activation gases were released with an average release rate of $7.89\text{E}+00$ $\mu\text{Ci}/\text{sec}$.

A total of $8.79\text{E}-03$ curies of I-131 were released during the year with an average release rate of $2.79\text{E}-04$ $\mu\text{Ci}/\text{sec}$.

A total of $2.63\text{E}-04$ curies of beta-gamma emitters were released as airborne particulate matter with an average release rate of $8.30\text{E}-06$ $\mu\text{Ci}/\text{sec}$. Alpha-emitting radionuclides were below the lower limit of detection (LLD). Carbon-14 released in 2020 was calculated separately with a total of $3.50\text{E}+01$ curies released.

A total of $8.63\text{E}+01$ curies of tritium were released with an average release rate of $1.11\text{E}+00$ $\mu\text{Ci}/\text{sec}$.

1.2 Liquids Released to Illinois River

There were no liquid batch releases in 2020. Continuous release path activity was below applicable Lower Limits of Detection.

2.0 Solid Radioactive Waste

Solid radioactive wastes were shipped by truck to a disposal facility or to a waste processor. For further detail, refer the LaSalle 2020 Annual Radioactive Effluent Release Report (ARERR). This report was submitted to the USNRC by the required date of May 1st, 2021.

3.0 Dose To Man

3.1 Gaseous Effluent Pathways

Table 3.1-1 summarizes the doses resulting from releases of airborne radioactivity via the different exposure pathways.

3.1.1 Noble Gases

3.1.1.1 Gamma Dose Rates

Unit 1 and Unit 2 gaseous releases at LaSalle County Station are reported as Unit 1 releases due to a single station vent stack (SVS) release point. Offsite Gamma air and whole body dose rates are shown in Table 3.1-1 and were calculated based on measured release rates, isotopic composition of the noble gases and average meteorological data for the period. Doses based on concurrent meteorological data are shown in Table 3.4-1. Based on measured effluents and meteorological data, the maximum total body dose to an individual would be $1.61\text{E}-03$ mrem

(Table 3.1-1) for the year, with an occupancy factor of 0.95 and a shielding factor of 0.7 included. The maximum total body dose based on measured effluents and concurrent meteorological data would be $1.11\text{E-}02$ mrem (Table 3.4-1).

The maximum gamma air dose was $2.42\text{E-}03$ mrad from Table 3.1-1, and the maximum gamma air dose from concurrent meteorological data was $2.36\text{E-}04$ mrad (Table 3.4-1).

3.1.1.2 Beta Air and Skin Dose Rates

The range of beta particles in air is relatively small (on the order of a few meters or less); consequently, plumes of gaseous effluents may be considered "infinite" for purpose of calculating the dose from beta radiation incident on the skin. However, the actual dose to sensitive skin tissues is difficult to calculate due to the effect of the beta particle energies, thickness of inert skin and clothing covering sensitive tissues. For purposes of this report the skin is taken to have a thickness of 7.0 mg/cm^2 and an occupancy factor of 1.0 is used. The skin dose (from beta and gamma radiation) for the year was $2.73\text{E-}03$ mrem from Table 3.1-1, and the skin dose from concurrent meteorological data was $4.00\text{E-}04$ mrem (Table 3.4-1).

The maximum offsite beta dose for the year was $1.37\text{E-}04$ mrad from Table 3.1-1, and the maximum offsite beta dose from concurrent meteorological data was $1.03\text{E-}04$ mrad (Table 3.4-1).

3.1.2 Radioactive Iodine

The human thyroid exhibits a significant capacity to concentrate ingested or inhaled iodine. The radioiodine, I-131, released during routing operation of the plant, may be made available to man resulting in a dose to the thyroid. The principal pathway of interest for this radionuclide is ingestion of radioiodine in milk.

3.1.2.1 Dose to Thyroid

The hypothetical thyroid dose to a maximum exposed individual living near the station via ingestion of milk was calculated. The radionuclide considered was I-131 and the source of milk was taken to be the nearest dairy farm with the cows pastured from May through October. The maximum thyroid dose due to I-131 was $4.88\text{E-}02$ mrem for the year.

3.2 Liquid Effluent Pathways

The three principal pathways through the aquatic environment for potential

doses to man from liquid waste are ingestion of potable water, eating aquatic foods, and exposure while on the shoreline. Not all of these pathways are significant or applicable at a given time but a reasonable approximation of the dose can be made by adjusting the dose formula for season of the year or type and degree of use of the aquatic environment. NRC developed equations* were used to calculate the doses to the whole body, lower gastro-intestinal tracts, thyroid, bone and skin; specific parameters for use in the equations are given in the Offsite Dose Calculation Manual. The maximum whole body dose was 0.00E+00 mrem and organ dose was 0.00E+00 for the year mrem (Table 3.2-1).

3.3 Assessment of Dose to Member of Public

During the period January to December 2020, LaSalle County Station did not exceed these limits as shown in Table 3.1-1 and Table 3.2-1 (based on annual average meteorological data), and as shown in Table 3.3-1:

- The Radiological Effluent Technical Standards (RETS) limits on dose or dose commitment to an individual due to radioactive materials in liquid effluents from each reactor unit (1.5 mrem to the whole body or 5 mrem to any organ during any calendar year; 3 mrem to the whole body or 10 mrem to any organ during the calendar year).
- The RETS limits on air dose in noble gases released in gaseous effluents to a member of the public from each reactor unit (5 mrad for gamma radiation or 10 mrad for beta radiation during any calendar quarter; 10 mrad for gamma radiation or 20 mrad for beta radiation during a calendar year).
- The RETS limits on dose to a member of the public due to iodine-131, iodine-133, tritium and radionuclides in particulate form with half-lives greater than eight days in gaseous effluents released from each reactor unit (7.5 mrem to any organ during any calendar quarter; 15 mrem to any organ during any calendar year).
- The 10 CFR 20 limit on Total Effective Dose Equivalent to individual members of the public (100 mrem).

4.0 Site Meteorology

A summary of the site meteorological measurements taken during each calendar quarter of the year is given in Appendix F. The data are presented as cumulative joint frequency distributions of the wind direction for the 375' level and wind speed class by atmospheric stability class determined from the temperature difference between the 375' and 33' levels. Data recovery for these measurements was 99.8% during 2020.

*Nuclear Regulatory Commission, Regulatory Guide 1.109 (Rev. 1)

APPENDIX E-1

DATA TABLES AND FIGURES

Intentionally left blank

Table 1.1-1

LASALLE COUNTY NUCLEAR POWER STATION
EFFLUENT AND WASTE DISPOSAL ANNUAL REPORT (2020)
UNIT 1 AND UNIT 2
DOCKET NUMBERS 50-373 AND 50-374
GASEOUS EFFLUENTS SUMMATION OF ALL RELEASES

A. Fission & Activation Gases	Unit	Quarter 1	Quarter 2	Quarter 3	Quarter4	Est. Total Error %
1. Total Release	Ci	1.18E+02	7.58E+01	3.28E+01	2.30E+01	2.50E+01
2. Average release rate for the period	μCi/sec	1.50E+01	9.62E+00	4.16E+00	2.92E+00	
3. Percent of ODCM limit	%	*	*	*	*	

B. Iodine						
1. Total Iodine – 131	Ci	2.59E-03	2.12E-03	2.30E-03	1.78E-03	1.50E+01
2. Average release rate for the period	μCi/sec	3.28E-04	2.69E-04	2.92E-04	2.26E-04	
3. Percent of ODCM limit	%	*	*	*	*	

C. Particulates						
1. Particulates with half-lives > 8 days	Ci	6.86E-05	1.52E-04	4.20E-05	<LLD	3.50E+01
2. Average release rate for the period	μCi/sec	8.73E-06	1.93E-05	5.28E-06	N/A	
3. Percent of ODCM limit	%	*	*	*	*	

D. Tritium						
1. Total Release	Ci	1.36E+01	1.90E+01	1.69E+01	3.68E+01	1.50E+01
2. Average release rate for the period	μCi/sec	1.73E+00	2.41E+00	2.14E+00	4.67E+00	
3. Percent of ODCM limit	%	*	*	*	*	

E. Gross Alpha						
1. Total Release	Ci	<LLD	<LLD	<LLD	<LLD	N/A
2. Average release rate for the period	μCi/sec	<LLD	<LLD	<LLD	<LLD	
3. Percent of ODCM limit	%	*	*	*	*	

F. Carbon-14						
1. Total Release	Ci	8.30E+00	8.79E+00	9.02E+00	8.93E+00	
2. Average release rate for the period	μCi/sec	1.06E+00	1.11E+00	1.14E+00	1.13E+00	
3. Percent of ODCM limit	%	*	*	*	*	

"*" This information is contained in the Radiological Impact on Man section of the report.

"<" Indicates activity of sample is less than LLD given in μCi/ml

The LaSalle County Nuclear Power Station maximum expected annual dose from Carbon-14 has been calculated using the maximum gross thermal capacity at full power operation. The resultant bounding doses are based upon site specific assumptions of source term.

Table 1.2-1
LASALLE COUNTY NUCLEAR POWER STATION
EFFLUENT AND WASTE DISPOSAL ANNUAL REPORT (2020)
LIQUID RELEASES
UNIT 1 AND UNIT 2
SUMMATION OF ALL LIQUID RELEASES

A. Fission & Activation Products	Unit	Quarter 1	Quarter 2	Quarter 3	Quarter4	Est. Total Error %
1. Total Release (not including tritium, gases & alpha)	Ci	<LLD	<LLD	<LLD	<LLD	N/A
2. Average diluted concentration during period	μCi/mL	<LLD	<LLD	<LLD	<LLD	
3. Percent of applicable limit	%	*	*	*	*	

B. Tritium						
1. Total Release	Ci	<LLD	<LLD	<LLD	<LLD	N/A
2. Average diluted concentration during period	μCi/mL	<LLD	<LLD	<LLD	<LLD	
3. Percent of applicable limit	%	*	*	*	*	

C. Dissolved & Entrained Gases						
1. Total Release	Ci	<LLD	<LLD	<LLD	<LLD	N/A
2. Average diluted concentration during period	μCi/mL	<LLD	<LLD	<LLD	<LLD	
3. Percent of applicable limit	%	*	*	*	*	

D. Gross Alpha Activity						
1. Total Release	Ci	<LLD	<LLD	<LLD	<LLD	N/A
2. Average release rate for the period	μCi/mL	<LLD	<LLD	<LLD	<LLD	
3. Percent of ODCM limit	%	*	*	*	*	

E. Volume of Waste Released (prior to dilution)	Liters	0.00E+00	0.00E+00	0.00E+00	0.00E+00
--	--------	----------	----------	----------	----------

F. Volume of Dilution Water Used During Period	Liters	0.00E+00	0.00E+00	0.00E+00	0.00E+00
---	--------	----------	----------	----------	----------

"*" This information is contained in the Radiological Impact on Man section of the report.

"<" Indicates activity of sample is less than LLD given in μCi/ml

Table 2.1-1

LASALLE COUNTY NUCLEAR POWER STATION
SOLID WASTE ANNUAL REPORT (2020)

Table 2.1-1 deliberately deleted. For solid waste disposal detail, refer to the LaSalle County Station 2020 Annual Radiological Effluent Release Report (ARERR).

Table 3.1-1

LASALLE COUNTY NUCLEAR POWER STATION
 EFFLUENT AND WASTE DISPOSAL ANNUAL REPORT (2020)
 RADIOLOGICAL IMPACT ON MAN
 MAXIMUM DOSES RESULTING FROM GASEOUS RELEASES AND COMPLIANCE STATUS

All Age Groups	Quarterly Limit	Units	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Annual Limit	Annual
Gamma Air	5.00E+00 % of Limit	mRad %	1.27E-03 2.53E-02	7.88E-04 1.58E-02	1.24E-04 2.49E-03	2.36E-04 4.73E-03	1.00E+01 %	2.42E-03 2.42E-02
Beta Air	1.00E+01 % of Limit	mRad %	6.38E-05 6.38E-04	4.17E-05 4.17E-04	1.78E-05 1.78E-04	1.38E-05 1.38E-04	2.00E+01 %	1.37E-04 6.86E-04
NG Total Body	2.50E+00 % of Limit	mRem %	8.46E-04 3.38E-02	5.26E-04 2.10E-02	8.34E-05 3.34E-03	1.58E-04 6.31E-03	5.00E+00 %	1.61E-03 3.22E-02
NG Skin	7.50E+00 % of Limit	mRem %	1.43E-03 1.90E-02	8.88E-04 1.18E-02	1.47E-04 1.95E-03	2.68E-04 3.57E-03	1.50E+01	2.73E-03 1.82E-02
NING Organ Infant Thyroid	7.50E+00 % of Limit	mRem %	1.39E-02 1.85E-01	1.19E-02 1.58E-01	1.28E-02 1.71E-01	1.03E-02 1.37E-01	1.50E+01 %	4.887E-02 3.258E-01

The LaSalle County Nuclear Power Station maximum expected annual dose from Carbon-14 has been calculated using the maximum gross thermal capacity at full power operation. The resultant bounding doses are based upon site specific assumptions of source term.

Table 3.2-1

LASALLE COUNTY NUCLEAR POWER STATION
EFFLUENT AND WASTE DISPOSAL ANNUAL REPORT (2020)
RADIOLOGICAL IMPACT ON MAN
MAXIMUM DOSES RESULTING FROM LIQUID RELEASES AND COMPLIANCE STATUS

Infant Receptor	Quarterly Limit	Units	1st Quarter	% of Limit	2nd Quarter	% of Limit	3rd Quarter	% of Limit	4th Quarter	% of Limit	Annual Limit	% of Limit
10CFR50 Appendix I compliance												
Total Body	1.50E+00	mRem	0.00E+00	0.00	0.00E+00	0.00	0.00E+00	0.00	0.00E+00	0.00	3.00E+00	0.00
Organ	5.00E+00	mRem	0.00E+00	0.00	0.00E+00	0.00	0.00E+00	0.00	0.00E+00	0.00	1.00E+01	0.00
40CFR141 compliance (nearest public drinking water)												
Total Body		mRem	0.00E+00		0.00E+00		0.00E+00		0.00E+00		4.00E+00	0.00
Organ		mRem	0.00E+00		0.00E+00		0.00E+00		0.00E+00		4.00E+00	0.00
Child Receptor												
10CFR50 Appendix I compliance												
Total Body	1.50E+00	mRem	0.00E+00	0.00	0.00E+00	0.00	0.00E+00	0.00	0.00E+00	0.00	3.00E+00	0.00
Organ	5.00E+00	mRem	0.00E+00	0.00	0.00E+00	0.00	0.00E+00	0.00	0.00E+00	0.00	1.00E+01	0.00
40CFR141 compliance (nearest public drinking water)												
Total Body		mRem	0.00E+00		0.00E+00		0.00E+00		0.00E+00		4.00E+00	0.00
Organ		mRem	0.00E+00		0.00E+00		0.00E+00		0.00E+00		4.00E+00	0.00
Teenager Receptor												
10CFR50 Appendix I compliance												
Total Body	1.50E+00	mRem	0.00E+00	0.00	0.00E+00	0.00	0.00E+00	0.00	0.00E+00	0.00	3.00E+00	0.00
Organ	5.00E+00	mRem	0.00E+00	0.00	0.00E+00	0.00	0.00E+00	0.00	0.00E+00	0.00	1.00E+01	0.00
40CFR141 compliance (nearest public drinking water)												
Total Body		mRem	0.00E+00		0.00E+00		0.00E+00		0.00E+00		4.00E+00	0.00
Organ		mRem	0.00E+00		0.00E+00		0.00E+00		0.00E+00		4.00E+00	0.00
Adult Receptor												
10CFR50 Appendix I compliance												
Total Body	1.50E+00	mRem	0.00E+00	0.00	0.00E+00	0.00	0.00E+00	0.00	0.00E+00	0.00	3.00E+00	0.00
Organ	5.00E+00	mRem	0.00E+00	0.00	0.00E+00	0.00	0.00E+00	0.00	0.00E+00	0.00	1.00E+01	0.00
40CFR141 compliance (nearest public drinking water)												
Total Body		mRem	0.00E+00		0.00E+00		0.00E+00		0.00E+00		4.00E+00	0.00
Organ		mRem	0.00E+00		0.00E+00		0.00E+00		0.00E+00		4.00E+00	0.00

Table 3.3-1

LASALLE COUNTY NUCLEAR POWER STATION
EFFLUENT AND WASTE DISPOSAL ANNUAL REPORT (2020)
RADIOLOGICAL IMPACT ON MAN
MAXIMUM DOSES RESULTING FROM RELEASES AND COMPLIANCE STATUS

10CFR20 / 40CFR190 Compliance

	1 st Quarter Dose (mRem)	2 nd Quarter Dose (mRem)	3 rd Quarter Dose (mRem)	4 th Quarter Dose (mRem)	Annual Dose (mRem)	Annual Limit (mRem/yr)	% Annual Limit
Unit 1							
40CFR190 Compliance							
U1 D ^{Ex}	8.30E-02	1.03E-01	9.68E-02	4.37E-02	3.26E-01	25	1.30
10CFR20 Compliance							
U1 D ^{Tot}	9.68E-02	1.15E-01	1.10E-01	5.40E-02	3.75E-01	100	0.37
40CFR190 Compliance							
Bone	6.50E-03	7.13E-03	7.31E-03	7.23E-03	2.82E-02	25	0.11
Liver	1.43E-03	1.56E-03	1.60E-03	1.58E-03	6.18E-03	25	0.02
Thyroid	1.39E-02	1.19E-02	1.28E-02	1.03E-02	4.88E-02	75	0.07
Kidney	1.44E-03	1.57E-03	1.61E-03	1.59E-03	6.20E-03	25	0.02
Lung	1.39E-03	1.53E-03	1.57E-03	1.56E-03	6.04E-03	25	0.02
GI-LLI	1.39E-03	1.53E-03	1.57E-03	1.56E-03	6.05E-03	25	0.02
Unit 2							
40CFR190 Compliance							
U2 D ^{Ex}	9.80E-02	9.68E-02	9.63E-02	6.94E-02	3.60E-01	25	1.44
10CFR20 Compliance							
U2 D ^{Tot}	9.80E-02	9.68E-02	9.63E-02	6.94E-02	3.60E-01	100	0.36
40CFR190 Compliance							
Bone	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	25	0.00
Liver	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	25	0.00
Thyroid	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	75	0.00
Kidney	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	25	0.00
Lung	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	25	0.00
GI-LLI	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	25	0.00

Table 3.4-1

LASALLE COUNTY NUCLEAR POWER STATION
EFFLUENT AND WASTE DISPOSAL ANNUAL REPORT (2020)
RADIOLOGICAL IMPACT ON MAN
MAXIMUM DOSES RESULTING FROM AIRBORNE RELEASES
BASED ON CONCURRENT METEOROLOGICAL DATA

Doses Resulting From Airborne Releases

The following are the maximum annual calculated cumulative offsite doses resulting from LaSalle County Station airborne releases:

LaSalle County Generating Station:

<u>Dose</u>	<u>Maximum Value</u>	<u>Sector Affected</u>
gamma air ⁽¹⁾	2.360 E-04 mrad	East-Northeast
beta air ⁽²⁾	1.030 E-04 mrad	East- Northeast
whole body ⁽³⁾	1.110 E-02 mrem	East- Northeast
skin ⁽⁴⁾	4.000 E-04 mrem	East- Northeast
organ ⁽⁵⁾ (infant-thyroid)	1.730 E-01 mrem	East-Southeast

Compliance Status

10 CFR 50 Appendix I	Yearly Objective	% of Appendix I
gamma air	10.0 mrad	0.00
beta air	20.0 mrad	0.00
whole body	5.0 mrem	0.32
skin	15.0 mrem	0.00
organ	15.0 mrem	2.85

-
- (1) Gamma Air Dose – GASPAR II, NUREG-0597
 - (2) Beta Air Dose – GASPAR II, NUREG-0597
 - (3) Whole Body Dose – GASPAR II, NUREG-0597
 - (4) Skin Dose – GASPAR II, NUREG-0597
 - (5) Inhalation and Food Pathways Dose – GASPAR II, NUREG-0597

Intentionally left blank

APPENDIX F

METEOROLOGICAL DATA

Intentionally left blank

LaSalle County Generating Station

Period of Record: January - March 2020
 Stability Class - Extremely Unstable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	1	3	0	0	4
SSW	0	0	0	0	1	0	1
SW	0	0	0	1	0	0	1
WSW	0	0	0	0	0	0	0
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	1	4	1	0	6

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

LaSalle County Generating Station

Period of Record: January - March 2020
 Stability Class - Moderately Unstable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	2	0	0	2
SSW	0	0	0	2	2	0	4
SW	0	0	3	9	0	1	13
WSW	0	0	1	0	0	0	1
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	4	13	2	1	20

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

LaSalle County Generating Station

Period of Record: January - March 2020
 Stability Class - Slightly Unstable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	2	0	0	2
SSW	0	0	0	2	2	0	4
SW	0	0	3	9	0	1	13
WSW	0	0	1	0	0	0	1
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	4	13	2	1	20

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

LaSalle County Generating Station

Period of Record: January - March 2020
 Stability Class - Neutral - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	2	18	54	21	0	0	95
NNE	0	15	63	31	0	0	109
NE	0	9	21	17	0	0	47
ENE	1	3	22	13	0	0	39
E	1	3	17	11	3	0	35
ESE	0	2	7	12	2	1	24
SE	2	5	12	8	3	0	30
SSE	6	8	16	10	2	1	43
S	2	12	13	14	7	0	48
SSW	4	10	12	15	8	1	50
SW	2	11	8	13	1	0	35
WSW	3	19	27	5	1	6	61
W	4	20	43	42	12	3	124
WNW	0	28	53	43	34	1	159
NW	0	18	30	29	2	0	79
NNW	2	20	63	45	15	4	149
Variable	0	0	0	0	0	0	0
Total	29	201	461	329	90	17	1127

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

LaSalle County Generating Station

Period of Record: January - March 2020
 Stability Class - Slightly Stable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	2	11	0	0	0	0	13
NNE	0	6	4	0	0	0	10
NE	1	1	13	3	0	0	18
ENE	0	3	21	5	0	0	29
E	2	18	55	9	0	0	84
ESE	1	8	14	12	0	0	35
SE	2	15	9	8	2	0	36
SSE	0	19	8	8	4	0	39
S	3	12	18	25	14	0	72
SSW	5	7	11	32	26	1	82
SW	2	11	13	23	10	1	60
WSW	1	12	27	8	7	1	56
W	1	13	26	16	7	14	77
WNW	2	16	35	15	12	7	87
NW	0	5	17	0	0	0	22
NNW	2	6	4	0	0	0	12
Variable	0	0	0	0	0	0	0
Total	24	163	275	164	82	24	732

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

LaSalle County Generating Station

Period of Record: January - March 2020
 Stability Class - Moderately Stable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	2	11	0	0	0	0	13
NNE	0	6	4	0	0	0	10
NE	1	1	13	3	0	0	18
ENE	0	3	21	5	0	0	29
E	2	18	55	9	0	0	84
ESE	1	8	14	12	0	0	35
SE	2	15	9	8	2	0	36
SSE	0	19	8	8	4	0	39
S	3	12	18	25	14	0	72
SSW	5	7	11	32	26	1	82
SW	2	11	13	23	10	1	60
WSW	1	12	27	8	7	1	56
W	1	13	26	16	7	14	77
WNW	2	16	35	15	12	7	87
NW	0	5	17	0	0	0	22
NNW	2	6	4	0	0	0	12
Variable	0	0	0	0	0	0	0
Total	24	163	275	164	82	24	732

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

LaSalle County Generating Station

Period of Record: January - March 2020
 Stability Class - Extremely Stable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	2	11	0	0	0	0	13
NNE	0	6	4	0	0	0	10
NE	1	1	13	3	0	0	18
ENE	0	3	21	5	0	0	29
E	2	18	55	9	0	0	84
ESE	1	8	14	12	0	0	35
SE	2	15	9	8	2	0	36
SSE	0	19	8	8	4	0	39
S	3	12	18	25	14	0	72
SSW	5	7	11	32	26	1	82
SW	2	11	13	23	10	1	60
WSW	1	12	27	8	7	1	56
W	1	13	26	16	7	14	77
WNW	2	16	35	15	12	7	87
NW	0	5	17	0	0	0	22
NNW	2	6	4	0	0	0	12
Variable	0	0	0	0	0	0	0
Total	24	163	275	164	82	24	732

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

LaSalle County Generating Station

Period of Record: January - March 2020
 Stability Class - Extremely Unstable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	0	0	0	0
SSW	0	0	0	1	0	0	1
SW	0	0	0	0	0	0	0
WSW	0	0	0	0	0	0	0
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	0	1	0	0	1

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

LaSalle County Generating Station

Period of Record: January - March 2020
 Stability Class - Moderately Unstable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	0	0	0	0
SSW	0	0	0	0	0	0	0
SW	0	0	0	0	0	0	0
WSW	0	0	0	0	0	0	0
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	0	0	0	0	0

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

LaSalle County Generating Station

Period of Record: January - March 2020
 Stability Class - Slightly Unstable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	2	1	0	3
SSW	0	0	0	0	0	2	2
SW	0	0	0	3	0	0	3
WSW	0	0	0	0	0	0	0
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	0	5	1	2	8

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

LaSalle County Generating Station

Period of Record: January - March 2020
 Stability Class - Neutral - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	15	27	41	21	1	106
NNE	1	4	19	45	55	5	129
NE	2	3	9	41	15	0	70
ENE	2	2	9	25	11	0	49
E	0	1	12	21	5	3	42
ESE	0	4	10	12	16	4	46
SE	1	5	5	8	10	2	31
SSE	1	6	6	20	12	5	50
S	2	10	13	18	12	13	68
SSW	1	7	10	8	16	19	61
SW	1	6	16	8	14	7	52
WSW	1	7	23	19	5	9	64
W	3	11	20	42	35	14	125
WNW	1	7	27	21	35	30	121
NW	0	14	63	39	43	15	174
NNW	0	7	23	43	24	18	115
Variable	0	0	0	0	0	0	0
Total	17	109	292	411	329	145	1303

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 1
 Hours of missing stability measurements in all stability classes: 5

LaSalle County Generating Station

Period of Record: January - March 2020
 Stability Class - Slightly Stable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	3	3	0	6
NNE	1	1	3	1	1	0	7
NE	0	2	3	3	3	0	11
ENE	0	0	2	9	7	0	18
E	0	1	3	27	4	1	36
ESE	0	1	6	23	12	6	48
SE	2	2	9	11	15	3	42
SSE	1	7	12	3	3	6	32
S	0	7	21	14	17	28	87
SSW	2	6	7	15	14	55	99
SW	1	1	11	9	16	32	70
WSW	1	3	5	18	12	9	48
W	3	3	8	26	6	13	59
WNW	1	4	9	17	10	46	87
NW	0	2	20	26	6	4	58
NNW	0	4	5	7	3	0	19
Variable	0	0	0	0	0	0	0
Total	12	44	124	212	132	203	727

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

LaSalle County Generating Station

Period of Record: January - March 2020
 Stability Class - Moderately Stable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	1	2	1	2	0	7
NNE	0	2	0	0	0	0	2
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	1	0	6	0	0	7
SE	0	0	4	5	0	0	9
SSE	0	0	0	5	2	0	7
S	0	0	1	4	7	7	19
SSW	0	0	0	1	3	6	10
SW	0	1	9	5	6	1	22
WSW	0	0	2	4	3	1	10
W	0	0	4	3	7	0	14
WNW	0	0	3	4	2	1	10
NW	0	1	6	2	1	0	10
NNW	0	1	1	0	0	0	2
Variable	0	0	0	0	0	0	0
Total	1	7	32	40	33	16	129

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

LaSalle County Generating Station

Period of Record: January - March 2020
 Stability Class - Extremely Stable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	1	1
S	0	0	0	0	0	1	1
SSW	0	0	0	0	0	0	0
SW	0	1	2	1	0	0	4
WSW	0	0	0	3	0	0	3
W	0	1	0	0	0	0	1
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	2	2	4	0	2	10

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 5

LaSalle County Generating Station

Period of Record: April - June 2020

Stability Class - Extremely Unstable - 200Ft-33Ft Delta-T (F)

Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	1	0	0	0	1
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	1	0	1
S	0	0	0	1	0	0	1
SSW	0	0	2	0	0	0	2
SW	0	0	1	2	4	0	7
WSW	0	0	0	0	1	0	1
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	4	3	6	0	13

Hours of calm in this stability class: 0

Hours of missing wind measurements in this stability class: 0

Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: April - June 2020

Stability Class - Moderately Unstable - 200Ft-33Ft Delta-T (F)

Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	2	0	0	2
NNE	0	0	0	1	0	0	1
NE	0	0	5	1	0	0	6
ENE	0	0	5	2	0	0	7
E	0	0	3	2	0	0	5
ESE	0	0	1	0	0	0	1
SE	0	0	0	2	1	0	3
SSE	0	0	0	0	3	0	3
S	0	0	0	2	0	0	2
SSW	0	0	0	3	1	0	4
SW	0	0	3	6	1	0	10
WSW	0	0	5	4	5	0	14
W	0	0	4	9	0	0	13
WNW	0	0	0	11	3	0	14
NW	0	0	0	0	0	0	0
NNW	0	0	0	1	1	0	2
Variable	0	0	0	0	0	0	0
Total	0	0	26	46	15	0	87

Hours of calm in this stability class: 0

Hours of missing wind measurements in this stability class: 0

Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: April - June 2020
 Stability Class - Slightly Unstable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	1	1	0	0	2
NNE	0	1	2	0	0	0	3
NE	0	1	7	1	0	0	9
ENE	0	1	4	3	0	0	8
E	0	0	6	5	0	0	11
ESE	0	0	2	3	0	1	6
SE	0	1	7	4	1	0	13
SSE	0	0	5	7	3	0	15
S	0	0	8	2	0	0	10
SSW	0	1	11	3	2	0	17
SW	0	5	8	5	0	1	19
WSW	0	1	8	4	3	0	16
W	0	5	13	7	4	0	29
WNW	0	1	7	11	3	0	22
NW	0	2	2	7	1	0	12
NNW	0	1	3	5	0	0	9
Variable	0	0	0	0	0	0	0
Total	0	20	94	68	17	2	201

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: April - June 2020
 Stability Class - Neutral - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	18	27	2	1	0	49
NNE	0	24	40	11	0	0	75
NE	0	11	45	28	0	0	84
ENE	0	13	16	31	0	0	60
E	0	7	26	21	0	0	54
ESE	0	6	14	16	2	1	39
SE	1	15	27	5	3	3	54
SSE	0	9	18	19	8	1	55
S	2	15	20	9	2	1	49
SSW	2	12	17	7	4	0	42
SW	0	8	19	7	9	1	44
WSW	3	14	16	8	5	1	47
W	0	12	26	11	11	2	62
WNW	1	14	34	27	14	9	99
NW	0	7	17	12	13	2	51
NNW	0	10	36	33	15	3	97
Variable	0	0	0	0	0	0	0
Total	10	195	398	247	87	24	961

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: April - June 2020
 Stability Class - Slightly Stable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	2	12	7	0	0	0	21
NNE	0	5	6	0	0	0	11
NE	1	3	3	0	0	0	7
ENE	0	5	21	5	0	0	31
E	2	15	36	3	0	0	56
ESE	1	5	11	4	0	0	21
SE	3	12	3	1	0	0	19
SSE	5	14	14	6	0	0	39
S	1	9	12	8	1	0	31
SSW	2	14	15	14	2	1	48
SW	2	5	17	25	2	1	52
WSW	1	10	24	15	0	0	50
W	5	10	25	10	0	0	50
WNW	1	10	14	18	1	1	45
NW	2	7	6	2	0	0	17
NNW	1	6	11	0	0	0	18
Variable	0	0	0	0	0	0	0
Total	29	142	225	111	6	3	516

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: April - June 2020
 Stability Class - Moderately Stable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	1	0	0	0	0	1
NE	0	1	0	0	0	0	1
ENE	0	3	2	0	0	0	5
E	2	21	16	0	0	0	39
ESE	1	15	10	0	0	0	26
SE	0	9	12	0	0	0	21
SSE	1	16	9	0	0	0	26
S	1	10	0	2	0	0	13
SSW	0	10	7	11	0	0	28
SW	2	10	9	4	0	0	25
WSW	1	12	20	1	0	0	34
W	1	12	28	0	0	0	41
WNW	0	18	3	0	0	0	21
NW	2	0	0	0	0	0	2
NNW	1	3	0	0	0	0	4
Variable	0	0	0	0	0	0	0
Total	12	141	116	18	0	0	287

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: April - June 2020
 Stability Class - Extremely Stable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	1	0	0	0	0	1
E	0	10	4	0	0	0	14
ESE	0	16	3	0	0	0	19
SE	1	14	3	0	0	0	18
SSE	0	18	1	0	0	0	19
S	0	8	2	0	0	0	10
SSW	0	3	3	0	0	0	6
SW	0	4	2	0	0	0	6
WSW	0	5	5	0	0	0	10
W	1	3	4	0	0	0	8
WNW	0	3	0	0	0	0	3
NW	2	0	0	0	0	0	2
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	4	85	27	0	0	0	116

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: April - June 2020

Stability Class - Extremely Unstable - 375Ft-33Ft Delta-T (F)

Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	0	0	0	0
SSW	0	0	0	0	0	0	0
SW	0	0	0	0	0	0	0
WSW	0	0	0	0	0	0	0
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	0	0	0	0	0

Hours of calm in this stability class: 0

Hours of missing wind measurements in this stability class: 0

Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: April - June 2020

Stability Class - Moderately Unstable - 375Ft-33Ft Delta-T (F)

Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	1	0	0	0	1
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	0	0	0	0
SSW	0	0	0	0	0	0	0
SW	0	0	0	0	0	2	2
WSW	0	0	0	0	0	0	0
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	1	0	0	2	3

Hours of calm in this stability class: 0

Hours of missing wind measurements in this stability class: 0

Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: April - June 2020
 Stability Class - Slightly Unstable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	3	1	4
NNE	0	0	0	0	2	0	2
NE	0	0	2	2	1	0	5
ENE	0	0	0	4	1	0	5
E	0	0	1	3	0	0	4
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	2	0	2
SSE	0	0	1	0	1	1	3
S	0	0	0	0	1	0	1
SSW	0	0	1	0	2	0	3
SW	0	0	1	3	3	2	9
WSW	0	0	0	1	2	1	4
W	0	0	0	2	1	0	3
WNW	0	0	0	3	1	0	4
NW	0	0	0	0	1	0	1
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	6	18	21	5	50

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: April - June 2020
 Stability Class - Neutral - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	10	16	21	5	5	57
NNE	0	7	13	23	19	7	69
NE	0	9	16	39	27	0	91
ENE	0	14	10	32	38	1	95
E	0	3	14	39	17	1	74
ESE	0	5	11	19	7	0	42
SE	1	12	28	13	12	4	70
SSE	0	13	16	28	19	8	84
S	0	7	19	26	15	4	71
SSW	5	10	16	26	5	11	73
SW	0	8	16	22	9	12	67
WSW	1	6	24	24	12	8	75
W	0	12	16	25	13	13	79
WNW	1	11	15	42	27	20	116
NW	0	6	21	40	25	26	118
NNW	0	2	12	37	19	17	87
Variable	0	0	0	0	0	0	0
Total	8	135	263	456	269	137	1268

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: April - June 2020
 Stability Class - Slightly Stable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	1	5	6	12	1	25
NNE	0	1	7	5	0	0	13
NE	0	2	5	4	0	0	11
ENE	0	1	4	14	3	0	22
E	0	0	7	22	8	0	37
ESE	0	1	7	24	11	0	43
SE	0	5	11	11	16	1	44
SSE	1	5	6	13	7	4	36
S	0	4	7	16	10	6	43
SSW	1	3	11	13	6	14	48
SW	0	6	14	21	20	22	83
WSW	0	1	10	15	11	7	44
W	1	2	14	21	27	5	70
WNW	0	3	7	27	14	10	61
NW	1	4	12	18	9	7	51
NNW	1	4	3	5	0	1	14
Variable	0	0	0	0	0	0	0
Total	5	43	130	235	154	78	645

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: April - June 2020
 Stability Class - Moderately Stable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	2	0	0	2
NE	0	1	1	0	0	0	2
ENE	0	0	0	0	0	0	0
E	0	2	0	6	0	0	8
ESE	0	0	3	5	3	0	11
SE	1	1	7	27	7	0	43
SSE	0	1	2	12	6	0	21
S	0	6	5	6	0	0	17
SSW	0	1	5	9	3	3	21
SW	0	2	8	4	1	1	16
WSW	1	0	6	2	0	0	9
W	0	2	1	5	12	0	20
WNW	1	0	2	2	8	3	16
NW	0	1	4	4	0	0	9
NNW	0	2	0	3	0	0	5
Variable	0	0	0	0	0	0	0
Total	3	19	44	87	40	7	200

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: April - June 2020
 Stability Class - Extremely Stable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	3	1	0	0	4
SSE	0	0	0	6	0	0	6
S	0	0	0	2	0	0	2
SSW	0	0	0	1	1	0	2
SW	0	0	0	0	0	0	0
WSW	0	0	0	0	0	0	0
W	0	0	1	0	0	0	1
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	4	10	1	0	15

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: July - September 2020
 Stability Class - Extremely Unstable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	1	0	0	0	1
SSW	0	0	3	0	0	0	3
SW	0	0	5	3	1	0	9
WSW	0	1	5	2	0	0	8
W	0	0	3	0	0	0	3
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	1	17	5	1	0	24

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

LaSalle County Generating Station

Period of Record: July - September 2020
 Stability Class - Moderately Unstable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	5	0	0	0	5
E	0	0	1	0	0	0	1
ESE	0	0	2	0	0	0	2
SE	0	0	0	0	0	0	0
SSE	0	2	3	2	0	0	7
S	0	3	5	5	0	0	13
SSW	0	3	19	0	0	0	22
SW	0	3	6	4	0	0	13
WSW	0	5	12	3	1	0	21
W	0	5	8	3	0	0	16
WNW	0	1	0	5	0	0	6
NW	0	0	0	2	0	0	2
NNW	0	0	0	1	0	0	1
Variable	0	0	0	0	0	0	0
Total	0	22	61	25	1	0	109

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

LaSalle County Generating Station

Period of Record: July - September 2020
 Stability Class - Slightly Unstable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	1	2	0	0	0	3
NNE	0	2	1	0	0	0	3
NE	0	8	4	0	0	0	12
ENE	0	2	8	2	0	0	12
E	0	6	7	0	0	0	13
ESE	0	3	2	0	0	0	5
SE	0	2	2	4	0	0	8
SSE	0	7	6	0	0	0	13
S	0	6	14	1	0	0	21
SSW	0	3	10	1	0	0	14
SW	0	9	11	0	0	0	20
WSW	1	5	10	1	1	0	18
W	0	10	11	1	0	0	22
WNW	0	4	7	4	1	0	16
NW	0	2	6	6	0	0	14
NNW	0	2	1	3	0	0	6
Variable	0	0	0	0	0	0	0
Total	1	72	102	23	2	0	200

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

LaSalle County Generating Station

Period of Record: July - September 2020
 Stability Class - Neutral - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	29	32	5	0	0	66
NNE	1	32	34	2	0	0	69
NE	1	14	34	7	0	0	56
ENE	1	17	34	7	0	0	59
E	2	30	20	2	0	0	54
ESE	0	16	8	3	0	0	27
SE	2	9	14	1	0	0	26
SSE	2	22	19	0	0	0	43
S	2	10	24	9	1	0	46
SSW	1	18	19	4	0	0	42
SW	0	11	25	1	0	0	37
WSW	1	14	19	6	0	0	40
W	1	22	19	4	3	0	49
WNW	0	3	19	10	2	2	36
NW	1	8	16	10	2	1	38
NNW	0	11	47	9	0	1	68
Variable	0	0	0	0	0	0	0
Total	15	266	383	80	8	4	756

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

LaSalle County Generating Station

Period of Record: July - September 2020
 Stability Class - Slightly Stable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	29	6	0	0	0	36
NNE	2	14	11	0	0	0	27
NE	2	12	7	0	0	0	21
ENE	1	9	17	1	0	0	28
E	0	25	12	0	0	0	37
ESE	1	9	3	0	0	0	13
SE	5	6	4	0	0	0	15
SSE	2	13	5	1	0	0	21
S	3	15	5	4	0	0	27
SSW	2	17	26	12	0	0	57
SW	4	15	26	17	0	0	62
WSW	2	8	8	3	0	0	21
W	1	10	21	0	3	0	35
WNW	0	15	6	0	0	0	21
NW	1	2	16	0	0	0	19
NNW	1	12	10	1	0	0	24
Variable	0	0	0	0	0	0	0
Total	28	211	183	39	3	0	464

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

LaSalle County Generating Station

Period of Record: July - September 2020
 Stability Class - Moderately Stable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	8	1	0	0	0	10
NNE	2	10	0	0	0	0	12
NE	1	1	0	0	0	0	2
ENE	2	7	0	0	0	0	9
E	3	29	4	0	0	0	36
ESE	0	17	0	0	0	0	17
SE	2	9	0	0	0	0	11
SSE	3	12	1	0	0	0	16
S	2	26	3	0	0	0	31
SSW	0	27	7	0	0	0	34
SW	1	16	22	0	0	0	39
WSW	2	14	9	0	0	0	25
W	1	18	6	0	0	0	25
WNW	0	14	3	0	0	0	17
NW	0	4	0	0	0	0	4
NNW	1	9	2	0	0	0	12
Variable	0	0	0	0	0	0	0
Total	21	221	58	0	0	0	300

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

LaSalle County Generating Station

Period of Record: July - September 2020
 Stability Class - Extremely Stable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	1	0	0	0	0	0	1
E	0	16	0	0	0	0	16
ESE	0	28	2	0	0	0	30
SE	2	22	2	0	0	0	26
SSE	2	35	8	0	0	0	45
S	2	41	5	0	0	0	48
SSW	0	49	7	0	0	0	56
SW	0	35	31	0	0	0	66
WSW	1	19	12	0	0	0	32
W	1	20	1	0	0	0	22
WNW	0	7	0	0	0	0	7
NW	2	0	0	0	0	0	2
NNW	0	4	0	0	0	0	4
Variable	0	0	0	0	0	0	0
Total	11	276	68	0	0	0	355

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

LaSalle County Generating Station

Period of Record: July - September 2020
 Stability Class - Extremely Unstable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	0	0	0	0
SSW	0	0	0	0	0	0	0
SW	0	0	0	0	0	0	0
WSW	0	0	0	0	0	0	0
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	0	0	0	0	0

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

LaSalle County Generating Station

Period of Record: July - September 2020
 Stability Class - Moderately Unstable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	0	0	0	0
SSW	0	0	0	0	0	0	0
SW	0	0	0	0	0	0	0
WSW	0	0	0	1	0	0	1
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	0	1	0	0	1

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

LaSalle County Generating Station

Period of Record: July - September 2020
 Stability Class - Slightly Unstable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	2	1	0	0	3
E	0	0	0	0	0	0	0
ESE	0	0	1	1	0	0	2
SE	0	0	0	0	0	0	0
SSE	0	0	0	2	0	0	2
S	0	0	0	2	1	0	3
SSW	0	0	6	2	0	0	8
SW	0	0	3	4	1	0	8
WSW	0	0	3	3	0	0	6
W	0	1	7	0	0	0	8
WNW	0	0	1	1	0	0	2
NW	0	0	0	2	2	0	4
NNW	0	0	0	2	0	0	2
Variable	0	0	0	0	0	0	0
Total	0	1	23	20	4	0	48

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

LaSalle County Generating Station

Period of Record: July - September 2020
 Stability Class - Neutral - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	17	23	24	0	0	64
NNE	1	23	21	17	11	0	73
NE	0	12	9	48	12	2	83
ENE	1	20	11	40	9	2	83
E	2	17	38	9	2	0	68
ESE	0	15	12	8	0	0	35
SE	1	10	6	13	1	0	31
SSE	2	11	31	6	1	0	51
S	0	13	28	22	7	1	71
SSW	0	15	24	34	4	4	81
SW	0	13	27	29	7	3	79
WSW	1	10	34	17	8	1	71
W	1	20	32	20	2	3	78
WNW	0	14	17	19	8	6	64
NW	0	7	15	23	17	4	66
NNW	0	3	30	23	4	1	61
Variable	0	0	0	0	0	0	0
Total	9	220	358	352	93	27	1059

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

LaSalle County Generating Station

Period of Record: July - September 2020
 Stability Class - Slightly Stable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	3	6	15	7	1	32
NNE	2	4	14	9	7	0	36
NE	1	7	6	11	8	0	33
ENE	1	7	24	13	2	0	47
E	0	4	31	19	3	0	57
ESE	0	4	17	9	2	0	32
SE	1	3	1	12	2	0	19
SSE	0	7	6	3	1	0	17
S	0	6	13	12	4	2	37
SSW	2	0	19	23	19	9	72
SW	1	3	23	22	20	13	82
WSW	1	3	6	17	8	3	38
W	2	3	11	15	2	5	38
WNW	0	1	2	21	1	0	25
NW	0	3	7	12	4	0	26
NNW	1	4	5	9	9	2	30
Variable	0	0	0	0	0	0	0
Total	12	62	191	222	99	35	621

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

LaSalle County Generating Station

Period of Record: July - September 2020
 Stability Class - Moderately Stable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	2	0	3	0	0	6
NNE	0	3	4	1	0	0	8
NE	1	2	1	1	0	0	5
ENE	2	0	4	1	0	0	7
E	0	1	5	8	0	0	14
ESE	0	2	9	20	2	0	33
SE	0	0	5	13	1	0	19
SSE	0	0	12	12	2	3	29
S	0	0	18	19	5	1	43
SSW	0	3	20	24	6	0	53
SW	0	2	34	30	10	3	79
WSW	1	1	13	11	18	1	45
W	0	2	6	13	1	0	22
WNW	1	1	8	7	1	0	18
NW	0	1	8	18	2	0	29
NNW	2	3	1	10	0	0	16
Variable	0	0	0	0	0	0	0
Total	8	23	148	191	48	8	426

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

LaSalle County Generating Station

Period of Record: July - September 2020
 Stability Class - Extremely Stable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	1	0	0	0	0	0	1
E	0	0	0	0	0	0	0
ESE	0	0	1	3	1	0	5
SE	0	0	1	5	6	1	13
SSE	0	0	0	6	4	0	10
S	0	0	1	2	4	0	7
SSW	0	0	1	6	0	0	7
SW	0	0	1	4	0	0	5
WSW	0	0	0	0	0	0	0
W	0	0	1	2	0	0	3
WNW	0	0	1	0	0	0	1
NW	0	0	0	1	0	0	1
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	1	0	7	29	15	1	53

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

LaSalle County Generating Station

Period of Record: October - December 2020
 Stability Class - Extremely Unstable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	1	0	0	1
SSW	0	0	0	0	2	0	2
SW	0	0	0	0	0	0	0
WSW	0	0	0	0	0	0	0
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	0	1	2	0	3

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: October - December 2020
 Stability Class - Moderately Unstable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	3	5	0	8
SSW	0	0	1	1	3	1	6
SW	0	0	0	2	0	0	2
WSW	0	0	0	1	0	0	1
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	1	7	8	1	17

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: October - December 2020
 Stability Class - Slightly Unstable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	1	0	0	0	1
SSE	0	0	0	0	0	0	0
S	0	0	3	2	4	0	9
SSW	0	1	1	8	4	4	18
SW	0	0	2	4	2	0	8
WSW	0	0	5	5	0	0	10
W	0	0	0	6	1	0	7
WNW	0	0	1	2	3	0	6
NW	0	0	0	0	1	0	1
NNW	0	0	1	0	0	0	1
Variable	0	0	0	0	0	0	0
Total	0	1	14	27	15	4	61

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: October - December 2020
 Stability Class - Neutral - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	4	51	35	10	0	0	100
NNE	0	28	32	3	0	0	63
NE	2	5	16	10	1	0	34
ENE	1	9	21	19	2	0	52
E	1	8	15	10	0	0	34
ESE	0	5	7	2	1	0	15
SE	2	2	5	13	1	0	23
SSE	0	2	4	14	9	0	29
S	0	4	6	10	12	6	38
SSW	0	6	15	19	4	7	51
SW	1	7	21	22	1	4	56
WSW	3	12	24	15	1	1	56
W	0	19	35	25	13	15	107
WNW	3	19	53	64	17	2	158
NW	1	18	39	29	3	2	92
NNW	4	19	58	52	6	0	139
Variable	0	0	0	0	0	0	0
Total	22	214	386	317	71	37	1047

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: October - December 2020
 Stability Class - Slightly Stable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	2	20	9	0	0	0	31
NNE	1	4	2	0	0	0	7
NE	1	0	2	0	0	0	3
ENE	1	2	5	1	0	0	9
E	1	4	11	3	0	0	19
ESE	0	1	6	2	2	1	12
SE	1	3	4	9	2	0	19
SSE	0	8	8	8	11	0	35
S	0	1	11	21	19	0	52
SSW	0	3	21	37	16	2	79
SW	1	6	15	29	8	1	60
WSW	1	3	11	21	2	1	39
W	0	7	24	10	11	8	60
WNW	2	22	22	8	9	9	72
NW	0	10	16	0	0	0	26
NNW	0	5	3	0	0	0	8
Variable	0	0	0	0	0	0	0
Total	11	99	170	149	80	22	531

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: October - December 2020
 Stability Class - Moderately Stable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	11	0	0	0	0	12
NNE	2	1	1	0	0	0	4
NE	1	0	0	0	0	0	1
ENE	0	1	0	0	0	0	1
E	1	3	7	0	0	0	11
ESE	2	6	3	0	0	0	11
SE	0	15	9	0	0	0	24
SSE	0	1	10	3	0	0	14
S	1	8	12	4	0	0	25
SSW	0	14	13	14	2	0	43
SW	0	8	6	19	0	0	33
WSW	0	7	18	11	0	0	36
W	0	14	24	3	0	0	41
WNW	0	16	15	1	0	0	32
NW	1	7	2	0	0	0	10
NNW	0	7	3	0	0	0	10
Variable	0	0	0	0	0	0	0
Total	9	119	123	55	2	0	308

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: October - December 2020
 Stability Class - Extremely Stable - 200Ft-33Ft Delta-T (F)
 Winds Measured at 33 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	1	0	0	0	0	1
ENE	0	0	0	0	0	0	0
E	0	6	3	0	0	0	9
ESE	0	4	5	0	0	0	9
SE	1	11	6	0	0	0	18
SSE	0	14	16	0	0	0	30
S	0	12	16	1	0	0	29
SSW	0	14	29	11	0	0	54
SW	1	4	17	7	1	0	30
WSW	0	4	20	6	0	0	30
W	0	12	4	0	0	0	16
WNW	0	5	1	0	0	0	6
NW	3	1	0	0	0	0	4
NNW	0	2	0	0	0	0	2
Variable	0	0	0	0	0	0	0
Total	5	90	117	25	1	0	238

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: October - December 2020

Stability Class - Extremely Unstable - 375Ft-33Ft Delta-T (F)

Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	0	0	0	0
SSW	0	0	0	0	0	0	0
SW	0	0	0	0	0	0	0
WSW	0	0	0	0	0	0	0
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	0	0	0	0	0

Hours of calm in this stability class: 0

Hours of missing wind measurements in this stability class: 0

Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: October - December 2020
 Stability Class - Moderately Unstable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	0	0	0	0
SSW	0	0	0	0	0	1	1
SW	0	0	0	0	0	0	0
WSW	0	0	0	0	0	0	0
W	0	0	0	0	0	1	1
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	1	1
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	0	0	0	3	3

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: October - December 2020
 Stability Class - Slightly Unstable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0
S	0	0	0	1	0	3	4
SSW	0	0	0	1	0	2	3
SW	0	0	0	0	0	0	0
WSW	0	0	0	0	0	0	0
W	0	0	0	0	0	0	0
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	2	2
NNW	0	0	0	0	0	0	0
Variable	0	0	0	0	0	0	0
Total	0	0	0	2	0	7	9

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: October - December 2020
 Stability Class - Neutral - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	13	33	34	16	4	100
NNE	1	10	34	14	6	0	65
NE	1	5	8	28	9	7	58
ENE	0	5	9	32	12	3	61
E	0	5	7	17	4	0	33
ESE	0	5	4	4	3	4	20
SE	0	3	2	2	12	2	21
SSE	0	1	3	9	10	9	32
S	1	3	6	10	12	32	64
SSW	0	2	5	17	21	31	76
SW	1	4	15	33	10	7	70
WSW	2	6	14	36	9	6	73
W	1	7	25	25	19	34	111
WNW	1	11	21	52	39	39	163
NW	2	11	33	55	31	11	143
NNW	1	10	25	34	19	13	102
Variable	0	0	0	0	0	0	0

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

LaSalle County Generating Station

Period of Record: October - December 2020
 Stability Class - Slightly Stable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	2	1	5	18	4	0	30
NNE	0	5	4	3	4	0	16
NE	1	0	7	2	2	0	12
ENE	0	0	3	2	0	0	5
E	1	0	3	6	7	0	17
ESE	0	2	2	7	4	0	15
SE	1	2	2	12	4	3	24
SSE	1	1	3	8	12	10	35
S	0	0	4	6	12	46	68
SSW	0	4	6	4	15	53	82
SW	0	5	13	11	21	49	99
WSW	1	3	7	11	18	18	58
W	1	4	1	15	20	10	51
WNW	0	2	12	22	13	16	65
NW	1	1	13	22	12	1	50
NNW	0	2	5	20	1	0	28
Variable	0	0	0	0	0	0	0
Total	9	32	90	169	149	206	655

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: October - December 2020
 Stability Class - Moderately Stable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	2	1	3	0	6
NNE	0	0	2	1	0	0	3
NE	0	2	1	3	0	1	7
ENE	0	1	3	1	0	0	5
E	0	1	2	0	0	0	3
ESE	0	0	1	0	5	1	7
SE	0	1	1	3	4	3	12
SSE	0	2	3	4	7	4	20
S	0	0	9	7	15	1	32
SSW	1	1	3	5	7	14	31
SW	0	3	8	1	11	18	41
WSW	0	1	1	10	6	13	31
W	0	0	1	5	2	3	11
WNW	0	1	4	8	8	0	21
NW	0	0	0	14	9	0	23
NNW	0	1	2	6	1	0	10
Variable	0	0	0	0	0	0	0
Total	1	14	43	69	78	58	263

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

LaSalle County Generating Station

Period of Record: October - December 2020
 Stability Class - Extremely Stable - 375Ft-33Ft Delta-T (F)
 Winds Measured at 375 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	1	0	1	0	0	2
E	0	0	0	1	0	0	1
ESE	0	0	1	1	0	0	2
SE	0	0	0	2	4	1	7
SSE	0	0	1	6	1	1	9
S	0	0	0	1	7	3	11
SSW	0	0	2	1	1	0	4
SW	0	0	2	6	7	0	15
WSW	0	0	2	5	3	0	10
W	0	0	1	5	4	1	11
WNW	0	1	2	2	0	0	5
NW	0	0	3	1	0	0	4
NNW	1	0	0	0	0	0	1
Variable	0	0	0	0	0	0	0
Total	1	2	14	32	27	6	82

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 3

APPENDIX G

ERRATA DATA

Intentionally left blank

There is no errata data for 2020.

Intentionally left blank

APPENDIX H

ANNUAL RADIOLOGICAL GROUNDWATER PROTECTION PROGRAM REPORT (ARGPPR)

Intentionally left blank

Docket No: 50-373
50-374

LASALLE COUNTY STATION UNITS 1 and 2

Annual Radiological
Groundwater Protection Program Report

1 January through 31 December 2020

Prepared By
Teledyne Brown Engineering
Environmental Services



LaSalle County Station
Marseilles, IL 61341

May 2021

Intentionally left blank

Table Of Contents

I. Summary and Conclusions	1
II. Introduction	3
A. Objectives of the RGPP	3
B. Implementation of the Objectives	3
C. Program Description.....	4
D. Characteristics of Tritium (H-3).....	4
III. Program Description.....	6
A. Sample Analysis.....	6
B. Data Interpretation	6
C. Background Analysis	7
1. Background Concentrations of Tritium.....	7
IV. Results and Discussion.....	10
A. Groundwater Results	10
B. Surface Water Results	11
C. Drinking Water Well Survey	11
D. Summary of Results – Inter-laboratory Comparison Program	11
E. Leaks, Spills, and Releases.....	11
F. Trends.....	11
G. Investigations.....	12
H. Actions Taken	12

Appendices

Appendix A Location Designation

Tables

Table A-1 LaSalle County Station Groundwater Monitoring Sample Point List, 2020

Figures

Figure A-1 LaSalle County Station Map of Groundwater Monitoring Sampling Locations, 2020

Appendix B Data Tables

Tables

Table B-I.1 Concentrations of Tritium, Strontium, Gross Alpha, and Gross Beta in Groundwater Samples Collected in the Vicinity of LaSalle County Station, 2020

Table B-I.2 Concentrations of Gamma Emitters in Groundwater Samples Collected in the Vicinity of LaSalle County Station, 2020

Table B-I.3 Concentrations of Hard-to-Detects in Groundwater Samples Collected as Part of the Radiological Groundwater Protection Program, LaSalle County Station, 2020

I. Summary and Conclusions

In 2006, Exelon instituted a comprehensive program to evaluate the impact of station operations on groundwater and surface water in the vicinity of LaSalle County Station. This evaluation involved numerous station personnel and contractor support personnel. Following baseline sampling and subsequent recommendations, LaSalle's Radiological Groundwater Protection Program (RGPP) program now consists of the four surface water and twenty groundwater well sampling locations. The results for LaSalle's RGPP sampling efforts in 2020 are included in this report.

This is the twelfth in a series of annual reports on the status of the RGPP conducted at LaSalle County Station. This report covers groundwater and surface water samples, collected from the environment, both on and off station property in 2020. During that time period, 237 analyses were performed on 47 samples from 19 groundwater locations. The monitoring was conducted by station personnel.

In assessing all the data gathered for this report, it was concluded that the operation of LaSalle County Station had no adverse radiological impact on the environment, and there are no known active releases into the groundwater at LaSalle County Station.

Strontium-89 (Sr-89) and strontium-90 (Sr-90) were not detected in any groundwater samples during 2020.

No gamma-emitting radionuclides attributable to licensed plant operations were detected in any of the groundwater or surface water samples.

In the case of tritium, Exelon specified that its laboratories achieve a lower limit of detection (LLD) 100 times lower than that required by federal regulation. The United States Environmental Protection Agency (USEPA) drinking water standard (and the Nuclear Regulatory Commission Reporting Limit) is 20,000 pCi/L.

Tritium levels were detected at concentrations greater than the LLD of 200 pCi/L in 17 of 47 groundwater samples analyzed. The tritium concentrations ranged from <LLD to 5,620 ± 617 pCi/L. The elevated tritium levels (>200 pCi/L) being observed in groundwater are associated with the U1 CY tank leak that occurred in the June/July 2010 timeframe, as documented in the Station's 10 CFR 50.75(g) report.

Gross alpha and gross beta analyses in the dissolved and suspended fractions were performed on groundwater samples throughout the year in 2020. Gross alpha (dissolved) was detected in 2 of 13 samples affecting 2 of 12 groundwater locations analyzed. The concentrations ranged from 1.1 to 11.6 pCi/L. Gross alpha (suspended) was detected in 3 of 13 samples affecting 3 of 12 groundwater locations analyzed. The concentrations ranged from 2.8 to 4.1 pCi/L.

Gross beta (dissolved) was detected in 9 of 13 samples affecting 7 of 12 groundwater locations analyzed. The concentrations ranged from 2.6 to 12.2 pCi/L. Gross beta (suspended) was detected in 6 of 13 samples affecting 6 of 12

groundwater locations analyzed. The concentrations ranged from 1.6 to 14.7 pCi/L.

Hard-to-detect analyses were performed on 12 of the groundwater sampling locations in accordance with the LaSalle RGPP and to aid in establishing background levels. The analyses included Fe-55, Ni-63, Am-241, Cm-242, Cm-243/244, Pu-238, Pu-239/240, U-234, U-235, and U-238. The isotopes of U-234 and U-238 were detected in 5 samples of each, affecting 3 of 12 groundwater locations. The U-234 concentrations ranged from 0.19 to 1.05 pCi/L. The U-238 concentrations ranged from 0.19 to 0.89 pCi/L. U-234 and U-238 are commonly found in groundwater at low concentrations due to the naturally-occurring Radium (Uranium) Decay Series.

II. Introduction

The LaSalle County Station (LSCS), consisting of two boiling water reactors, each rated for 3,546 MWt, owned and operated by Exelon Corporation, is located in LaSalle County, Illinois. Unit 1 went critical on March 16, 1982. Unit 2 went critical on December 2, 1983. The site is located in northern Illinois, approximately 75 miles southwest of Chicago, Illinois.

This report covers those analyses performed by Teledyne Brown Engineering (TBE) on samples collected in 2020.

A. Objectives of the RGPP

The long-term objectives of the RGPP are as follows:

1. Identify suitable locations to monitor and evaluate potential impacts from station operations before significant radiological impact to the environment and potential drinking water sources.
2. Understand the local hydrogeologic regime in the vicinity of the station and maintain up-to-date knowledge of flow patterns on the surface and shallow subsurface.
3. Perform routine water sampling and radiological analysis of water from selected locations.
4. Report new leaks, spills, or other detections with potential radiological significance to stakeholders in a timely manner.
5. Regularly assess analytical results to identify adverse trends.
6. Take necessary corrective actions to protect groundwater resources.

B. Implementation of the Objectives

The objectives identified have been implemented at LaSalle County Station as discussed below:

1. Exelon and its consultant identified locations as described in the 2006 Phase 1 study. Phase 1 studies were conducted by Conestoga Rovers and Associates (CRA) and the results and conclusions were made available to state and federal regulators.
2. The LaSalle County Station reports describe the local hydrogeologic regime. Periodically, the flow patterns on the surface and shallow subsurface are updated based on ongoing measurements.
3. LaSalle County Station will continue to perform routine sampling and radiological analysis of water from selected locations.
4. LaSalle County Station has implemented procedures to identify and report new leaks, spills, or other detections with potential radiological significance in a timely manner.

5. LaSalle County Station staff and consulting hydrogeologist assess analytical results on an ongoing basis to identify adverse trends.

C. Program Description

1. Sample Collection

Sample locations can be found in Figure A-1, Appendix A.

Groundwater and Surface Water

Samples of water are collected, managed, transported and analyzed in accordance with approved procedures following EPA methods. Both groundwater and surface samples water are collected. Sample locations, sample collection frequencies and analytical frequencies are controlled in accordance with approved station procedures. Contractor and/or station personnel are trained in the collection, preservation management, and shipment of samples, as well as in documentation of sampling events. Analytical laboratories are subject to internal quality assurance programs, industry cross-check programs, as well as nuclear industry audits. Station personnel review and evaluate all analytical data deliverables as data are received.

Analytical data results are reviewed by both station personnel and an independent hydrogeologist for adverse trends or changes to hydrogeologic conditions.

D. Characteristics of Tritium (H-3)

Tritium (chemical symbol H-3) is a radioactive isotope of hydrogen. The most common form of tritium is tritium oxide, which is also called "tritiated water." The chemical properties of tritium are essentially those of ordinary hydrogen.

Tritiated water behaves the same as ordinary water in both the environment and the body. Tritium can be taken into the body by drinking water, breathing air, eating food, or absorption through skin. Once tritium enters the body, it disperses quickly and is uniformly distributed throughout the body. Tritium is excreted primarily through urine with a clearance rate characterized by an effective biological half-life of about 14 days. Within one month or so after ingestion, essentially all tritium is cleared. Organically bound tritium (tritium that is incorporated in organic compounds) can remain in the body for a longer period.

Tritium is produced naturally in the upper atmosphere when cosmic rays strike air molecules. Tritium is also produced during nuclear weapons explosions, as a by-product in reactors producing electricity, and in special production reactors, where the isotopes lithium-7 and/or boron-10 are activated to produce tritium. Like normal water, tritiated water is colorless and odorless. Tritiated water behaves chemically and physically like non-

tritiated water in the subsurface, and therefore tritiated water will travel at the same velocity as the average groundwater velocity.

Tritium has a half-life of approximately 12.3 years. It decays spontaneously to helium-3 (^3He). This radioactive decay releases a beta particle (low-energy electron). The radioactive decay of tritium is the source of the health risk from exposure to tritium. Tritium is one of the least dangerous radionuclides because it emits very weak radiation and leaves the body relatively quickly. Since tritium is almost always found as water, it goes directly into soft tissues and organs. The associated dose to these tissues is generally uniform and is dependent on the water content of the specific tissue.

III. Program Description

A. Sample Analysis

This section describes the general analytical methodologies used by TBE to analyze the environmental samples for radioactivity for the LaSalle County Station RGPP in 2020. Sample and analysis and frequency is based upon well location, assessed risk and site hydrogeology as described in the RGPP.

In order to achieve the stated objectives, the current program includes the following analyses:

1. Concentrations of gamma emitters in groundwater
2. Concentrations of strontium in groundwater
3. Concentrations of tritium in groundwater
4. Concentrations of gross alpha (dissolved and suspended) and gross beta (dissolved and suspended) in groundwater
5. Concentrations of Am-241 in groundwater
6. Concentrations of Cm-242 and Cm-243/244 in groundwater
7. Concentrations of Pu-238 and PU-239/240 in groundwater
8. Concentrations of U-234, U-235 and U-238 in groundwater
9. Concentrations of Fe-55 in groundwater
10. Concentrations of Ni-63 in groundwater

B. Data Interpretation

The radiological data collected prior to LaSalle County Station becoming operational were used as a baseline with which these operational data were compared. For the purpose of this report, LaSalle County Station was considered operational at initial criticality. Several factors were important in the interpretation of the data:

1. Lower Limit of Detection and Minimum Detectable Concentration

The lower limit of detection (LLD) is specified by federal regulation as a minimum sensitivity value that must be achieved routinely by the analytical parameter.

2. Laboratory Measurements Uncertainty

The estimated uncertainty in measurement of tritium in environmental samples is frequently on the order of 50% of the measurement value.

Statistically, the exact value of a measurement is expressed as a range with a stated level of confidence. The convention is to report results with a 95% level of confidence. The uncertainty comes from calibration

standards, sample volume or weight measurements, sampling uncertainty and other factors. Exelon reports the uncertainty of a measurement created by statistical process (counting error) as well as all sources of error (Total Propagated Uncertainty or TPU). Each result has two values calculated. Exelon reports the TPU by following the result with plus or minus \pm the estimated sample standard deviation, as TPU, that is obtained by propagating all sources of analytical uncertainty in measurements.

Analytical uncertainties are reported at the 95% confidence level in this report for reporting consistency with the AREOR.

C. Background Analysis

A pre-operational radiological environmental monitoring program (pre-operational REMP) was conducted to establish background radioactivity levels prior to operation of the Station. The environmental media sampled and analyzed during the pre-operational REMP were atmospheric radiation, fall-out, domestic water, surface water, precipitation, marine life, and foodstuffs. The results of the monitoring were detailed in the report entitled, Environmental Radiological Monitoring for LaSalle County Nuclear Power Station, Commonwealth Edison Company, Annual Reports for the years 1979 and 1981. The pre-operational REMP contained analytical results from samples collected from the surface water and groundwater.

1. Background Concentrations of Tritium

The purpose of the following discussion is to summarize background measurements of tritium in various media performed by others. Additional detail may be found by consulting references (CRA 2006).

a. Tritium Production

Tritium is created in the environment from naturally occurring processes both cosmic and subterranean, as well as from anthropogenic (i.e., man-made) sources. In the upper atmosphere, "Cosmogenic" tritium is produced from the bombardment of stable nuclides and combines with oxygen to form tritiated water, which will then enter the hydrologic cycle. Below ground, "lithogenic" tritium is produced by the bombardment of natural lithium present in crystalline rocks by neutrons produced by the radioactive decay of naturally abundant uranium and thorium. Lithogenic production of tritium is usually negligible compared to other sources due to the limited abundance of lithium in rock. The lithogenic tritium is introduced directly to groundwater.

A major anthropogenic source of tritium and strontium-90 comes from the former atmospheric testing of thermonuclear weapons. Levels of tritium in precipitation increased significantly during the 1950s and early 1960s, and later with additional testing, resulting in

the release of significant amounts of tritium to the atmosphere. The Canadian heavy water nuclear power reactors, other commercial power reactors, nuclear research and weapons production continue to influence tritium concentrations in the environment.

b. Precipitation Data

Precipitation samples are routinely collected at stations around the world for the analysis of tritium and other radionuclides. Two publicly available databases that provide tritium concentrations in precipitation are Global Network of Isotopes in Precipitation (GNIP) and USEPA's RadNet database. GNIP provides tritium precipitation concentration data for samples collected worldwide from 1960 to 2006. RadNet provides tritium precipitation concentration data for samples collected at stations throughout the U.S. from 1960 up to and including 2006. Based on GNIP data for sample stations located in the U.S. Midwest, tritium concentrations peaked around 1963. This peak, which approached 10,000 pCi/L for some stations, coincided with the atmospheric testing of thermonuclear weapons.

Tritium concentrations in surface water showed a sharp decline up until 1975 followed by a gradual decline since that time. Tritium concentrations in Midwest precipitation have typically been below 100 pCi/L since around 1980. LaSalle's 1979 or 1981 pre-operational REMP showed precipitation tritium concentrations >300 pCi/L. Tritium concentrations in wells may still be above the 200 pCi/L detection limit from the external causes described above. Water from previous years and decades is naturally captured in groundwater, so some well water sources today are affected by the surface water from the 1960s that was elevated in tritium.

c. Surface Water Data

Tritium concentrations are routinely measured in large surface water bodies, including Lake Michigan and the Mississippi River. Illinois surface water data were typically less than 100 pCi/L. Illinois River H-3 results have shown >200 pCi/L, as evidenced in LaSalle's REMP program sample results. This is attributable to releases from Braidwood and Dresden upstream.

The USEPA RadNet surface water data typically has a reported 'Combined Standard Uncertainty' of 35 to 50 pCi/L. According to USEPA, this corresponds to a ± 70 to 100 pCi/L 95% confidence bound on each given measurement. Therefore, the typical background data provided may be subject to measurement uncertainty of approximately ± 70 to 100 pCi/L.

The radio-analytical laboratory is counting tritium results to an Exelon specified LLD of 200 pCi/L. Typically, the lowest positive

measurement will be reported within a range of 40 – 240 pCi/L or 140 ± 100 pCi/L. Clearly, these sample results cannot be distinguished as different from background at this concentration.

IV. Results and Discussion

A. Groundwater Results

Samples were collected from onsite wells throughout the year in accordance with the station radiological groundwater protection program. Analytical results and anomalies are discussed below.

Tritium

Samples from 19 locations were analyzed for tritium activity. Tritium values ranged from <LLD to 5,620 pCi/L. The highest tritium activity was found at well TW-LS-118S. Based on the hydrogeological study conducted at LaSalle, there is no feasible pathway into a drinking water supply. Based on established aquifer flow paths the location most representative of potential offsite release into groundwater was also less than the detection limit. (Table B-I.1, Appendix B)

Strontium

A total of 18 samples from 15 groundwater locations were analyzed for Sr-89 and Sr-90. The results were less than the required detection limit of 10 pCi/L for Sr-89 and less than the required detection limit of 1.0 pCi/liter for Sr-90. (Table B-I.1, Appendix B)

Gross Alpha and Gross Beta (dissolved and suspended)

Gross alpha and gross beta analyses in the dissolved and suspended fractions were performed on groundwater samples throughout the year in 2020. Gross alpha (dissolved) was detected in 2 of 13 samples affecting 2 of 12 groundwater locations analyzed. The concentrations ranged from 1.1 to 11.6 pCi/L. Gross alpha (suspended) was detected in 3 of 13 samples affecting 3 of 12 groundwater locations analyzed. The concentrations ranged from 2.8 to 4.1 pCi/L.

Gross beta (dissolved) was detected in 9 of 13 samples affecting 7 of 12 groundwater locations analyzed. The concentrations ranged from 2.6 to 12.2 pCi/L. Gross beta (suspended) was detected in 6 of 13 samples affecting 6 of 12 groundwater locations analyzed. The concentrations ranged from 1.6 to 14.7 pCi/L.

These concentrations of gross alpha and gross beta, which are slightly above detectable levels, are considered to be background and are not the result of plant effluents. (Table B-I.1, Appendix B)

Gamma Emitters

No gamma emitting nuclides were detected in any of the samples analyzed. (Table B-I.2, Appendix B)

Hard-To-Detect

Hard-to-detect analyses were performed on 12 of the groundwater sampling locations in accordance with the LaSalle RGPP and to aid in establishing background levels. The analyses included Fe-55, Ni-63, Am-241, Cm-242, Cm-243/244, Pu-238, Pu-239/240, U-234, U-235, and U-238. U-234 was detected in 5 of 7 samples, affecting 4 of 5 groundwater locations. U-234 concentrations ranged from 0.19 to 1.05 pCi/L. U-238 was detected in 5 of 7 samples, affecting 4 of 5 groundwater locations. U-238 concentrations ranged from 0.19 to 0.89 pCi/L. U-234 and U-238 are commonly found in groundwater at low concentrations due to the naturally-occurring Radium (Uranium) Decay Series. The concentrations of U-234 and U-238 discussed above are considered to be background and are not the result of plant effluents. (Table B-1.3, Appendix B)

All other hard-to-detect nuclides were not detected at concentrations greater than their respective minimum detectable concentrations.

B. Surface Water Results

No surface water samples were collected in 2020.

C. Drinking Water Well Survey

A drinking water well survey was conducted during the summer 2006 by CRA (CRA 2006) around the LaSalle County Station. This survey concluded that no residents in the vicinity of the plant utilize the shallow water aquifer as a drinking water supply. Site hydrological studies of aquifer flow and permeation rates from the shallow aquifer to the deep aquifer concluded that there is no feasible dose receptor via a ground water pathway at LaSalle.

D. Summary of Results – Inter-Laboratory Comparison Program

Inter-Laboratory Comparison Program results for TBE and Environmental Inc. (Midwest Labs) are presented in the AREOR.

E. Leaks, Spills, and Releases

There were no new leaks identified at LaSalle Station during the reporting period.

F. Trends

Analysis results from samples continue to be trended in order to assess impact to groundwater at LaSalle Station. There were no new leaks identified in the reporting period. Sample data from the plume arising from the historic 2010 U1 CY tank leak is being trended per the LaSalle RGPP. The plume had been dispersing with groundwater flow, and extraction wells have been installed to provide additional control of the plume migration (see Section H.3. below). Currently, no tritium has migrated offsite, and tritium migration offsite is not expected.

G. Investigations

No new investigations were carried out during the reporting period.

H. Actions Taken

1. Compensatory Actions

No compensatory actions were taken during the reporting period.

2. Installation of Monitoring Wells

No new monitoring wells have been installed during the reporting period.

3. Actions to Recover/Reverse Plumes

Two (2) extraction wells (RW-LS-100S and RW-LS-101S) were installed to control the migration of the tritium plume near U1 CY tank. RW-LS-100S became operational in October 2012. RW-LS-101S became operational in April 2014.

APPENDIX A

LOCATION DESIGNATION

Intentionally left blank

TABLE A-1 LaSalle County Station Groundwater Monitoring Sample Point List, 2020

Site	Site Type
HP-2	Monitoring Well
HP-5	Monitoring Well
HP-7	Monitoring Well
HP-10	Monitoring Well
MW-LS-101S	Monitoring Well
MW-LS-102S	Monitoring Well
MW-LS-103S	Monitoring Well
MW-LS-104S	Monitoring Well
MW-LS-105S	Monitoring Well
MW-LS-106S	Monitoring Well
MW-LS-107S	Monitoring Well
MW-LS-108S	Monitoring Well
MW-LS-109S	Monitoring Well
MW-LS-110S	Monitoring Well
MW-LS-111S	Monitoring Well
MW-LS-112S	Monitoring Well
MW-LS-113S	Monitoring Well
RW-LS-100S	Extraction Well
RW-LS-101S	Extraction Well
SW-LS-101	Surface Water
SW-LS-102	Surface Water
SW-LS-103	Surface Water
SW-LS-106	Surface Water
TW-LS-114S	Monitoring Well
TW-LS-115S	Monitoring Well
TW-LS-116S	Monitoring Well
TW-LS-117S	Monitoring Well
TW-LS-118S	Monitoring Well
TW-LS-119S	Monitoring Well
TW-LS-120S	Monitoring Well
TW-LS-121S	Monitoring Well

APPENDIX B

DATA TABLES

Intentionally left blank

TABLE B-I.1

**CONCENTRATIONS OF TRITIUM, STRONTIUM, GROSS ALPHA
AND GROSS BETA IN GROUNDWATER SAMPLES COLLECTED
IN THE VICINITY OF LASALLE COUNTY STATION, 2020**
RESULTS IN UNITS OF PCI/LITER \pm 2 SIGMA

SITE	COLLECTION		H-3	Sr-89	Sr-90	Gr-A (Dis)	Gr-A (Sus)	Gr-B (Dis)	Gr-B (Sus)
	DATE								
HP-2	08/10/20	< 183	< 7.0	< 0.6	< 0.8	< 1.0		4.3 \pm 1.0	< 1.4
HP-5	08/11/20	< 185	< 9.5	< 0.9	< 0.6	< 0.9		4.1 \pm 1.2	< 1.4
HP-7	03/20/20	< 156							
HP-7	08/10/20	< 181	< 7.1	< 0.7	< 0.6	< 0.9		5.6 \pm 1.2	1.6 \pm 1.0
HP-7	10/30/20	< 157							
HP-10	08/10/20	< 185	< 6.3	< 0.8	< 0.6		2.8 \pm 1.2	2.9 \pm 1.1	3.0 \pm 1.2
MW-LS-104S	03/20/20	1530 \pm 209							
MW-LS-104S	08/10/20	1940 \pm 258	< 7.8	< 0.9	< 0.6	< 0.9	< 1.7		1.6 \pm 1.0
MW-LS-104S	10/27/20	1470 \pm 203	< 6.7	< 0.8	< 0.8	< 0.6	< 1.3		< 1.6
MW-LS-105S	03/20/20	< 156							
MW-LS-105S	08/10/20	< 185	< 8.8	< 0.7		1.1 \pm 0.7	3.7 \pm 1.8	2.6 \pm 0.9	14.7 \pm 2.1
MW-LS-105S	10/27/20	< 154							
MW-LS-106S	08/11/20	< 187							
MW-LS-107S	03/20/20	< 156							
MW-LS-107S	08/11/20	< 184	< 7.4	< 0.9	< 4.7		4.1 \pm 2.0	7.5 \pm 2.4	5.8 \pm 2.0
MW-LS-107S	10/27/20	< 157							
MW-LS-111S	08/11/20	< 183	< 3.9	< 0.9		11.6 \pm 4.7	< 2.3	12.2 \pm 3.2	14.0 \pm 3.3
OIL SEPARATOR	03/20/20	< 189							
OIL SEPARATOR	08/10/20	< 183							
OIL SEPARATOR	10/27/20	< 154							
RW-LS-100S	03/20/20	1540 \pm 209							
RW-LS-100S	08/10/20	1840 \pm 246	< 5.9	< 0.6					
RW-LS-100S	10/27/20	1500 \pm 205	< 4.7	< 0.8	< 1.0	< 0.6		3.6 \pm 0.9	< 1.6
RW-LS-101S	03/20/20	1530 \pm 209							
RW-LS-101S	08/10/20	1370 \pm 203	< 9.8	< 0.7					
RW-LS-101S	10/27/20	921 \pm 154	< 6.2	< 0.9	< 0.8	< 0.6		4.2 \pm 0.9	< 1.6
TW-LS-114S	03/20/20	< 154							
TW-LS-114S	08/10/20	< 181							
TW-LS-114S	10/27/20	< 154							
TW-LS-116S	03/20/20	4310 \pm 481							
TW-LS-116S	08/10/20	4590 \pm 517							
TW-LS-116S	08/10/20	4090 \pm 466							
TW-LS-116S	10/27/20	4240 \pm 474	< 6.3	< 0.9	< 0.9	< 0.6	< 1.4		< 1.6
TW-LS-117S	03/20/20	< 160							
TW-LS-117S	08/10/20	< 184							
TW-LS-117S	10/27/20	< 153	< 9.5	< 0.9					
TW-LS-118S	03/20/20	4040 \pm 452							
TW-LS-118S	08/10/20	5360 \pm 592							
TW-LS-118S	08/10/20	5620 \pm 617							
TW-LS-118S	10/27/20	3270 \pm 380	< 7.5	< 0.8	< 0.7	< 0.6	< 1.0		< 1.6
TW-LS-119S	03/20/20	< 154							
TW-LS-119S	08/10/20	< 183							
TW-LS-119S	10/27/20	< 153	< 8.0	< 0.9					
TW-LS-120S	03/20/20	< 184							
TW-LS-120S	08/10/20	< 189							
TW-LS-120S	10/27/20	< 155	< 8.2	< 0.9					
TW-LS-121S	08/10/20	< 186							

TABLE B-I.2 **CONCENTRATIONS OF GAMMA EMITTERS IN GROUNDWATER**
SAMPLES COLLECTED IN THE VICINITY OF LASALLE COUNTY STATION, 2020
 RESULTS IN UNITS OF PC/LITER ± 2 SIGMA

SITE	COLLECTION DATE	RESULTS IN UNITS OF PC/LITER ± 2 SIGMA													
		Be-7	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	I-131	Cs-134	Cs-137	Ba-140	La-140
HP-2	08/10/20	< 17	< 15	< 2	< 2	< 4	< 2	< 3	< 2	< 3	< 7	< 2	< 13	< 4	
HP-5	08/11/20	< 15	< 14	< 2	< 3	< 3	< 1	< 3	< 2	< 6	< 2	< 1	< 12	< 4	
HP-7	08/10/20	< 17	< 17	< 2	< 4	< 2	< 2	< 4	< 2	< 7	< 2	< 2	< 14	< 5	
HP-10	08/10/20	< 14	< 15	< 2	< 4	< 2	< 2	< 3	< 2	< 6	< 2	< 2	< 13	< 4	
MW-LS-104S	08/10/20	< 19	< 18	< 2	< 4	< 2	< 2	< 4	< 2	< 6	< 2	< 2	< 15	< 5	
MW-LS-104S	10/27/20	< 18	< 16	< 2	< 4	< 2	< 2	< 4	< 2	< 6	< 2	< 2	< 13	< 4	
MW-LS-105S	08/10/20	< 17	< 16	< 2	< 4	< 2	< 2	< 4	< 2	< 6	< 2	< 2	< 14	< 4	
MW-LS-106S	08/11/20	< 16	< 36	< 2	< 4	< 2	< 2	< 3	< 2	< 6	< 2	< 2	< 13	< 4	
MW-LS-107S	08/11/20	< 16	< 31	< 2	< 4	< 2	< 2	< 3	< 2	< 6	< 2	< 2	< 13	< 4	
MW-LS-111S	08/11/20	< 20	< 17	< 2	< 4	< 2	< 2	< 4	< 2	< 7	< 2	< 2	< 15	< 5	
RW-LS-100S	08/10/20	< 16	< 29	< 2	< 4	< 2	< 2	< 3	< 2	< 6	< 2	< 2	< 14	< 5	
RW-LS-100S	10/27/20	< 17	< 19	< 2	< 4	< 2	< 2	< 4	< 2	< 6	< 2	< 2	< 13	< 4	
RW-LS-101S	08/10/20	< 17	< 30	< 2	< 5	< 2	< 2	< 4	< 2	< 7	< 2	< 2	< 14	< 6	
RW-LS-101S	10/27/20	< 14	< 16	< 2	< 3	< 2	< 2	< 3	< 2	< 5	< 2	< 2	< 11	< 4	
TW-LS-116S	10/27/20	< 17	37 ± 25	< 2	< 4	< 2	< 2	< 3	< 2	< 6	< 2	< 2	< 12	< 4	
TW-LS-118S	10/27/20	< 16	< 30	< 2	< 4	< 2	< 2	< 3	< 2	< 6	< 2	< 2	< 12	< 4	

TABLE B-I.3 CONCENTRATIONS OF HARD-TO-DETECTS IN GROUNDWATER SAMPLES COLLECTED AS PART OF THE GROUNDWATER PROTECTION PROGRAM, LASALLE COUNTY STATION, 2020
RESULTS IN UNITS OF PCI/LITER ± 2 SIGMA

SITE	COLLECTION		Am-241	Cm-242	Cm-243/244	Pu-238	Pu-239/240	U-234	U-235	U-238	Fe-55	Ni-63
	DATE											
HP-2	08/10/20										< 55	< 4.4
HP-5	08/10/20										< 65	< 4.2
HP-7	08/10/20										< 100	< 4.6
HP-10	08/10/20										< 86	< 4.4
MW-LS-104S	08/10/20	< 0.09	< 0.02	< 0.07	< 0.04	< 0.06	0.65 ± 0.29	< 0.04	< 0.04	0.52 ± 0.25	< 53	< 4.4
MW-LS-104S	10/27/20	< 0.05	< 0.02	< 0.09	< 0.16	< 0.13	1.05 ± 0.28	< 0.11	< 0.11	0.89 ± 0.26	< 105	< 4.8
MW-LS-105S	08/10/20										< 135	< 4.7
MW-LS-107S	08/11/20										< 75	< 4.1
MW-LS-111S	08/11/20										< 158	< 4.2
RW-LS-100S	08/10/20	< 0.18	< 0.05	< 0.05	< 0.12	< 0.17	< 0.05	< 0.09	< 0.09	< 0.02	< 69	< 4.7
RW-LS-100S	10/27/20	< 0.06	< 0.03	< 0.06	< 0.17	< 0.13	0.19 ± 0.13	< 0.10	< 0.10	0.19 ± 0.12	< 96	< 4.5
RW-LS-101S	08/10/20	< 0.08	< 0.02	< 0.02	< 0.09	< 0.09	0.28 ± 0.13	< 0.08	< 0.08	0.25 ± 0.12	< 113	< 4.1
RW-LS-101S	10/27/20	< 0.05	< 0.03	< 0.05	< 0.03	< 0.06	0.50 ± 0.21	< 0.20	< 0.20	0.33 ± 0.16	< 74	< 4.2
TW-LS-116S	10/27/20										< 55	< 4.9
TW-LS-118S	10/27/20	< 0.04	< 0.02	< 0.08	< 0.14	< 0.08	< 0.15	< 0.15	< 0.15	< 0.12	< 78	< 4.9

Intentionally left blank