

VIRGINIA ELECTRIC AND POWER COMPANY
RICHMOND, VIRGINIA 23261

April 28, 2023

United States Nuclear Regulatory Commission
Attention: Document Control Desk
Washington, DC 20555-0001

Serial No. 23-066
S&L/SCN R0
Docket Nos. 50-280
50-281
72-2
72-55
License Nos. DPR-32
DPR-37
SNM-2501

VIRGINIA ELECTRIC AND POWER COMPANY
SURRY POWER STATION UNITS 1 AND 2
2022 ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

Surry Units 1 and 2 Technical Specification 6.6.B.2 requires the submittal of an Annual Radiological Environmental Operating Report (AREOR) for Surry Power Station. Surry Independent Spent Fuel Storage Installation (ISFSI) Technical Specification Appendix C, Item 1.3.1 requires that the Surry ISFSI be included in the environmental monitoring for Surry Power Station. Accordingly, enclosed is the Surry Power Station AREOR for the period of January 1, 2022 through December 31, 2022, which includes environmental monitoring for the Surry ISFSI.

If you have any further questions, please contact William Terry at 757-365-2010.

Sincerely,


Cathy Brady
Director Safety & Licensing
Surry Power Station

Attachment

Commitments made in this letter: None

Serial No. 23-066
Docket Nos.: 50-280
50-281
72-2
72-55

cc: U. S. Nuclear Regulatory Commission Region II
Marquis One Tower
245 Peachtree Center Ave., NE Suite 1200
Atlanta, Georgia 30303-1257

Director, Nuclear Material Safety and Safeguards
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555-0001

NRC Senior Resident Inspector
Surry Power Station

Director, Virginia Health Department
Division of Radiological Health
109 Governor Street, Room 730
Richmond, Virginia 23219

Serial No. 23-066
Docket Nos.: 50-280
50-281
72-2
72-55

ATTACHMENT


2022 Annual Radiological Environmental Operating Report

**SURRY POWER STATION UNITS 1 AND 2
VIRGINIA ELECTRIC AND POWER COMPANY**

Dominion Energy
Surry Power Station
Radiological Environmental Monitoring Program
January 1, 2022 to December 31, 2022

**Annual Radiological Environmental Operating Report
Surry Power Station**


January 1, 2022 to December 31, 2022

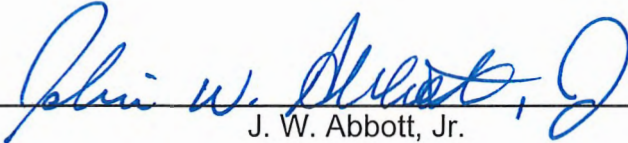Prepared by: 


J. W. Abbott, Jr.
Health Physicist

Reviewed by: 

R. Schau
Supervisor Radiological Analysis

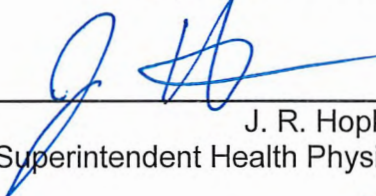Reviewed by: 

J. R. Hopkins
Superintendent Health Physics Technical Services

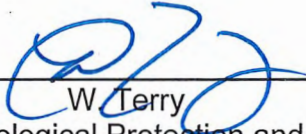Approved by: 

W. Terry
Manager Radiological Protection and Chemistry

Table of Contents

| | |
|--|-----|
| PREFACE | 4 |
| 1. EXECUTIVE SUMMARY | 5 |
| 2. PROGRAM DESCRIPTION | 7 |
| 2.1 Introduction | 7 |
| 2.2 Sampling and Analysis Program | 8 |
| 3. ANALYTICAL RESULTS | 20 |
| 3.1 Summary of Results | 20 |
| 3.2 Analytical Results of 2021 REMP Samples | 277 |
| 4. DISCUSSION OF RESULTS | 47 |
| 4.1 Gamma Exposure Rate | 48 |
| 4.2 Airborne Gross Beta | 48 |
| 4.3 Airborne Radioiodine | 50 |
| 4.4 Air Particulate Gamma | 50 |
| 4.5 Animal Milk | 50 |
| 4.6 Food Products | 51 |
| 4.7 Well Water | 51 |
| 4.8 River Water | 51 |
| 4.9 Silt | 52 |
| 4.10 Shoreline Sediment | 54 |
| 4.11 Fish | 54 |
| 4.12 Oysters | 54 |
| 4.13 Clams | 54 |
| 4.14 Crabs | 54 |
| 5. PROGRAM EXCEPTIONS | 55 |
| 6. CONCLUSIONS | 56 |
| REFERENCES | 58 |
| APPENDICES | 60 |
| APPENDIX A: LAND USE CENSUS | 61 |
| APPENDIX B: SUMMARY OF INTERLABORATORY COMPARISONS | 63 |

PREFACE

This report is submitted as required by Technical Specification 6.6.B.2, Annual Radiological Environment Operating Report, for Surry, Units 1 and 2, Virginia Electric and Power Company Docket Nos. 50-280 and 50-281, and the Surry Independent Spent Fuel Storage Installation (ISFSI) Technical Specifications, Appendix C, Item 1.3.1.

1. EXECUTIVE SUMMARY

This document is a detailed report of the 2022 Surry Power Station Radiological Environmental Monitoring Program (REMP). Radioactivity levels from January 1 through December 31, 2022, in air, water, silt, shoreline sediment, milk, aquatic biota, food products and direct exposure pathways have been analyzed, evaluated, and summarized. The REMP is designed to confirm that radiological effluent releases are As Low As (is) Reasonably Achievable (ALARA), no undue environmental effects occur, and the health and safety of the public are protected. The program also detects any unexpected environmental processes that could allow radiation accumulations in the environment or food pathway chains.

Radiation and radioactivity in the environment are monitored within a 20-mile radius of the station. Surry Power Station personnel collect a variety of samples within this area. Several sampling locations for each medium are selected using available meteorological, land use, and water use data. Two types of samples are obtained. The first type, control samples, is collected from areas that are beyond the measurable influence of Surry Power Station or any other nuclear facility. These samples represent normal background radiation levels. Background radiation levels can be compared to the environment surrounding the station. Indicator samples are the second sample type obtained. These samples show how much radiation is contributed to the environment by the station.

Prior to station operation, samples were collected and analyzed to determine the amount of radioactivity present in the area. The resulting values are used as a "pre-operational baseline." Analysis results from the indicator samples are compared to control sample values and the pre-operational baseline to determine if changes in radioactivity levels are attributable to station operations, or natural variation, or other causes such as the Chernobyl and Fukushima Daiichi accidents that released radioactive material to the environment.

Teledyne Brown Engineering, Inc. (TBE) provides radioanalyses for this program and Mirion Technologies provides thermoluminescent dosimetry (TLD) services. Participation in an Interlaboratory Comparison Program provides an independent check of sample measurement precision and accuracy. Typically, radioactivity levels in the environment are so low that analysis values frequently fall below the minimum detection limits of state-of-the-art measurement methods. Because of this, the United States Nuclear Regulatory Commission (USNRC) requires that equipment used for radiological environmental monitoring must be able to detect specified minimum Lower Limits of Detection (LLDs). This ensures that analyses are as accurate as possible. The USNRC also mandates a reporting level for radionuclides. Licensed nuclear facilities must report the radionuclide activities in those environmental samples that are equal to or greater than the specified reporting level. Environmental radiation levels are sometimes referred to as a percent of the reporting level.

Analytical results are reported for all possible radiation exposure pathways to man. These pathways include airborne, aquatic, terrestrial and direct radiation exposure. The airborne exposure pathway includes radioactive airborne iodine and particulates. The 2022 airborne results were comparable to previous years. No station related radioactivity was detected. Natural radioactivity levels remained at levels consistent with past years' results. Aquatic exposure pathway samples include well and river water, silt and shoreline sediments, crabs, fish, clams, and oysters. Naturally occurring radionuclides such as beryllium-7, potassium-40, radium-226, actinium-228, thorium-228, and thorium-232 were detected at average environmental levels. No man-made radionuclides were detected in well water. This trend is consistent throughout the operational environmental monitoring program. No man-made radionuclides were detected in river water. Silt samples indicated the presence of cesium-137 and naturally occurring radionuclides. Cesium-137 concentrations were present in indicator location samples at nominal background levels. No other man-made radionuclides were detected. These background levels are attributable to fallout from historic weapons testing and nuclear accidents such as Chernobyl. Naturally occurring beryllium-7, potassium-40, radium-226, actinium-228, thorium-228, and thorium-232 were detected at average environmental levels. Shoreline sediment, which may provide a direct exposure pathway, contained no station related radionuclides. Naturally occurring radionuclides potassium-40, thorium-228, and thorium-232 were detected at average environmental levels. The terrestrial exposure pathway includes milk and food products. Iodine-131 was not detected in any 2022 milk samples and has not been detected in milk prior to or since the 1986 Chernobyl accident. Strontium-90 was detected in milk and this activity is attributable to past atmospheric nuclear weapons testing. No other man-made radionuclides were detected in milk samples. Consistent with historical data, naturally occurring potassium-40 was detected in milk. No man-made radionuclides were detected in food product samples. Only naturally occurring potassium-40 was detected. Environmental radiation dose is measured in the direct exposure pathway using TLDs. The TLD results are reported in accordance with ANSI/HPS N13.37-2014 methodology. These results have remained relatively constant over the years.

During 2022, as in previous years, the operation of Surry Power Station has created no adverse environmental effects or health hazards. The maximum total body dose calculated for a hypothetical individual at the station site boundary due to liquid and gaseous effluents released from the station during 2022 was 0.034 millirem. For reference, this dose may be compared to the 620 millirem average annual exposure to every person in the United States from natural and man-made sources. Natural sources in the environment provide approximately 50% of radiation exposure to man, while nuclear power contributes less than 0.1%. These results demonstrate compliance with federal and state regulations and demonstrate the adequacy of radioactive effluent controls at Surry Power Station.

2. PROGRAM DESCRIPTION

2.1 Introduction

This report documents the 2022 Surry Power Station Operational Radiological Environmental Monitoring Program (REMP). Dominion Energy's Surry Power Station is located on the Gravel Neck peninsula adjacent to the James River, approximately 25 miles upstream of the Chesapeake Bay. The site consists of two units, each with a pressurized water reactor (PWR) nuclear steam supply system and turbine generator furnished by Westinghouse Electric Corporation. Each unit was designed with a nominal gross electrical output of 910 megawatts electric (MWe). Unit 1 achieved commercial operation on December 22, 1972, and Unit 2 on May 1, 1973.

The United States Nuclear Regulatory Commission regulations (10CFR50.34a) require that nuclear power plants be designed, constructed, and operated to keep levels of radioactive material in effluents to unrestricted areas As Low As (is) Reasonably Achievable. To ensure these criteria are met, the operating license for Surry Power Station includes Technical Specifications that address the release of radioactive effluents. In-plant monitoring is used to ensure that these release limits are not exceeded. As a precaution against unexpected or undefined environmental processes, which might allow undue accumulation of radioactivity in the environment, a program for monitoring the station environs is also included in Surry Power Station Technical Specifications.

Dominion personnel are responsible for collecting the various indicator and control environmental samples. Mirion Technologies is responsible for processing the TLDs. Teledyne Brown Engineering is responsible for sample analyses. The results of the analyses are used to determine if changes in radioactivity levels may be attributable to station operations. Measured values are compared with control values, which vary with time due to external events, such as cosmic ray bombardment, nuclear weapons test fallout and seasonal variations of naturally occurring radionuclides. Data collected prior to station operation is used to indicate the degree of natural variation to be expected. This pre-operational data is compared with data collected during the operational phase to assist in evaluating any radiological impact of station operation.

Occasionally, samples of environmental media may show the presence of man-made radionuclides. As a method of referencing the measured radionuclide concentrations in the sample media to a dose consequence to man, the data is compared to the reporting level concentrations listed in the USNRC Regulatory Guide 4.8, "Environmental Technical Specifications for Nuclear Power Plants", (December, 1975) and VPAP-2103S, Offsite Dose Calculation Manual (Surry). These concentrations are based upon the annual dose commitment recommended by 10CFR50, Appendix I, to meet the criterion of "As Low As (is) Reasonably Achievable."

This report documents the results of the REMP for 2022 and satisfies the following objectives of the program:

- To provide measurements of radiation and of radioactive materials in those exposure pathways and for those radionuclides that lead to the highest potential radiation exposure of the maximum exposed member of the public resulting from station operations.
- To supplement the radiological effluent monitoring program by verifying radioactive effluents are within allowable limits.
- To identify changes in radioactivity in the environment.
- To verify that station operations have no detrimental effect on the health and safety of the public.

2.2 Sampling and Analysis Program

Table 2-1 summarizes the 2022 sampling program for Surry Power Station. All samples listed in Table 2-1 are taken at indicator locations except those labeled "control location." Dominion Energy personnel collect all samples listed in Table 2-1.

Table 2-2 summarizes the analysis program conducted by Teledyne Brown Engineering and Mirion Technologies for Surry Power Station. All samples, except for TLDs, are shipped to Teledyne Brown Engineering, located in Knoxville, TN, for analysis. The TLDs are shipped to Mirion Technologies, located in Irvine, CA, for processing.

The Surry Radiological Monitoring Locations map (Figures 1 – 5) denote sample locations for Surry Power Station. The locations are color coded to designate sample types.

Table 2-1
SURRY - 2022
RADIOLOGICAL SAMPLING STATIONS
DISTANCE AND DIRECTION FROM UNIT NO. 1

| Sample Media | Location | Station | Distance | | | Collection | | Remarks |
|-------------------------------|-------------------------|---------|----------|-----------|---------|------------|---|---------|
| | | | Miles | Direction | Degrees | Frequency | | |
| Environmental TLDs | Control | (00) | - | - | - | Quarterly | Onsite (Stored in lead shield outside the protected area) | |
| | West North West | (02) | 0.2 | WNW | 293° | Quarterly | Site Boundary | |
| | Surry Station Discharge | (03) | 0.4 | NW | 321° | Quarterly | Site Boundary | |
| | North North West | (04) | 0.2 | NNW | 329° | Quarterly | Site Boundary | |
| | North | (05) | 0.3 | N | 4° | Quarterly | Site Boundary | |
| | North North East | (06) | 0.3 | NNE | 28° | Quarterly | Site Boundary | |
| | North East | (07) | 0.3 | NE | 44° | Quarterly | Site Boundary | |
| | East North East | (08) | 0.4 | ENE | 67° | Quarterly | Site Boundary | |
| | East | (09) | 0.3 | E | 89° | Quarterly | Site Boundary | |
| | West | (10) | 0.1 | W | 271° | Quarterly | Site Boundary | |
| | West South West | (11) | 0.4 | WSW | 252° | Quarterly | Site Boundary | |
| | South West | (12) | 0.3 | SW | 228° | Quarterly | Site Boundary | |
| | South South West | (13) | 0.3 | SSW | 201° | Quarterly | Site Boundary | |
| | South | (14) | 0.4 | S | 182° | Quarterly | Site Boundary | |
| | South South East | (15) | 0.6 | SSE | 157° | Quarterly | Site Boundary | |
| | South East | (16) | 0.9 | SE | 135° | Quarterly | Site Boundary | |
| | Station Intake | (18) | 1.6 | ESE | 115° | Quarterly | Site Boundary | |
| | Hog Island Reserve | (19) | 2.0 | NNE | 26° | Quarterly | Near Resident | |
| | Bacon's Castle | (20) | 4.5 | SSW | 202° | Quarterly | Apx. 5 miles | |
| | Route 633 | (21) | 4.9 | SW | 227° | Quarterly | Apx. 5 miles | |
| | Alliance | (22) | 5.1 | WSW | 247° | Quarterly | Apx. 5 miles | |
| | Surry | (23) | 7.7 | WSW | 256° | Quarterly | Population Center | |
| | Route 636 and 637 | (24) | 4.0 | W | 270° | Quarterly | Apx. 5 miles | |
| | Scotland Wharf | (25) | 5.0 | WNW | 284° | Quarterly | Apx. 5 miles | |
| | Jamestown | (26) | 6.3 | NW | 308° | Quarterly | Apx. 5 miles | |
| | Colonial Parkway | (27) | 3.8 | NNW | 333° | Quarterly | Apx. 5 miles | |
| | Route 617 and 618 | (28) | 4.9 | NNW | 340° | Quarterly | Apx. 5 miles | |
| | Kingsmill | (29) | 4.6 | N | 2° | Quarterly | Apx. 5 miles | |
| | Williamsburg | (30) | 7.8 | N | 0° | Quarterly | Population Center | |
| | Kingsmill North | (31) | 5.5 | NNE | 12° | Quarterly | Apx. 5 miles | |
| | Budweiser | (32) | 5.8 | NNE | 27° | Quarterly | Population Center | |
| | Water Plant | (33) | 5.0 | NE | 46° | Quarterly | Apx. 5 miles | |

Table 2-1
 SURRY - 2022
 RADIOLOGICAL SAMPLING STATIONS
 DISTANCE AND DIRECTION FROM UNIT NO. 1

| Sample Media | Location | Station | Distance | | Degrees | Collection Frequency | Remarks |
|-------------------------------------|-------------------------|---------|----------|-----------|-----------|----------------------|---|
| | | | Miles | Direction | | | |
| Environmental TLDs | BASF | (34) | 5.1 | ENE | 70° | Quarterly | Apx. 5 miles |
| | Lee Hall | (35) | 7.1 | ENE | 75° | Quarterly | Population Center |
| | Goose Island | (36) | 5.1 | E | 90° | Quarterly | Apx. 5 miles |
| | Fort Eustis | (37) | 4.9 | ESE | 104° | Quarterly | Apx. 5 miles |
| | Newport News | (38) | 19.3 | SE | 130° | Quarterly | Population Center |
| | James River Bridge | (39) | 17.1 | SE | 142° | Quarterly | Control Location |
| | Benn's Church | (40) | 17.0 | SSE | 159° | Quarterly | Control Location |
| | Smithfield | (41) | 13.4 | SSE | 167° | Quarterly | Control Location |
| | Rushmere | (42) | 5.3 | SSE | 156° | Quarterly | Apx. 5 miles |
| Route 628 | (43) | 5.1 | S | 177° | Quarterly | Apx. 5 miles | |
| Air Charcoal and Particulate | Surry Station | (SS) | 0.3 | NNE | 18° | Weekly | Site boundary location with highest D/Q |
| | Hog Island Reserve | (HIR) | 2.0 | NNE | 26° | Weekly | |
| | Bacon's Castle | (BC) | 4.5 | SSW | 202° | Weekly | |
| | Alliance | (ALL) | 5.1 | WSW | 247° | Weekly | |
| | Colonial Parkway | (CP) | 3.8 | NNW | 333° | Weekly | |
| | BASF | (BASF) | 5.1 | ENE | 70° | Weekly | |
| | Fort Eustis | (FE) | 4.9 | ESE | 104° | Weekly | |
| | Newport News | (NN) | 19.3 | SE | 130° | Weekly | |
| River Water | Surry Station Discharge | (SD) | 0.4 | NW | 323° | Monthly | Control Location |
| | Scotland Wharf | (SW) | 4.9 | WNW | 284° | Monthly | |
| Well Water | Surry Station | (SS) | 0.1 | SW | 227° | Quarterly | Onsite |
| | Hog Island Reserve | (HIR) | 2.0 | NNE | 28° | Quarterly | |
| | Construction Site | (CS) | 0.3 | E | 87° | Quarterly | |
| Shoreline Sediment | Hog Island Reserve | (HIR) | 0.6 | N | 7° | Semi-Annually | Control Location |
| | Chickahominy River | (CHIC) | 11.2 | WNW | 301° | Semi-Annually | |
| Silt | Chickahominy River | (CHIC) | 11.2 | WNW | 300° | Semi-Annually | Control Location |
| | Surry Station Discharge | (SD) | 0.5 | NW | 315° | Semi-Annually | |
| | Surry Station Intake | (SI) | 1.8 | ESE | 112° | Semi-Annually | |

Table 2-1
 SURRY - 2022
 RADIOLOGICAL SAMPLING STATIONS
 DISTANCE AND DIRECTION FROM UNIT NO. 1

| Sample Media | Location | Station | Distance | | | Collection | | Remarks |
|--|-------------------------|---------|----------|-----------|---------|---------------|------------------|---------|
| | | | Miles | Direction | Degrees | Frequency | | |
| Milk | Colonial Parkway | (CP) | 3.7 | NNW | 336° | Monthly | | |
| | Beachy Farm | (BF) | 12.0 | SW | 220° | Monthly | Control Location | |
| | Epps | (EPPS) | 4.8 | SSW | 200° | Monthly | | |
| Oysters | Point of Shoals | (POS) | 6.4 | SSE | 157° | Semi-Annually | | |
| | Mulberry Point | (MP) | 4.9 | ESE | 124° | Semi-Annually | | |
| | Swash Hole Island | (SHI) | 6.8 | SE | 128° | Semi-Annually | | |
| Clams | Chickahominy River | (CHIC) | 11.2 | WNW | 300° | Semi-Annually | Control Location | |
| | Surry Station Discharge | (SD) | 1.3 | NNW | 341° | Semi-Annually | | |
| | Jamestown Island | (JI) | 3.9 | NW | 324° | Semi-Annually | | |
| Fish | Surry Station Discharge | (SD) | 1.3 | NNW | 341° | Semi-Annually | | |
| Crabs | Surry Station Discharge | (SD) | 1.3 | NNW | 341° | Annually | | |
| Crops (Corn, Peanuts, Soybeans) | Brock's Farm | (BROCK) | 3.8 | S | 183° | Annually | | |
| | Slade's Farm | (SLADE) | 3.2 | S | 179° | Annually | | |

Table 2-2
SURRY - 2022
SAMPLE ANALYSIS PROGRAM

Pg. 1 of 3

| SAMPLE MEDIA | FREQUENCY | ANALYSIS | LLD* | REPORT UNITS |
|--|---------------------------------------|-----------------|-------------|---------------------|
| Thermoluminescent Dosimetry (TLD) | Quarterly | Gamma Dose | 6 | mR/Std. Quarter |
| Air Iodine | Weekly | I-131 | 0.07 | pCi/m ³ |
| Air Particulate | Weekly | Gross Beta | 0.01 | pCi/m ³ |
| | Quarterly (a) | Gamma Isotopic | | pCi/m ³ |
| | | Cs-134 | 0.05 | |
| | | Cs-137 | 0.06 | |
| River Water | Quarterly Composite of monthly sample | Tritium (H-3) | 2000 | pCi/L |
| | Monthly | I-131 | 10 | pCi/L |
| | | Gamma Isotopic | | pCi/L |
| | | Mn-54 | 15 | |
| | | Fe-59 | 30 | |
| | | Co-58 | 15 | |
| | | Co-60 | 15 | |
| | | Zn-65 | 30 | |
| | | Zr-95 | 30 | |
| | | Nb-95 | 15 | |
| | | Cs-134 | 15 | |
| | | Cs-137 | 18 | |
| | | Ba-140 | 60 | |
| | | La-140 | 15 | |
| Well Water | Quarterly | Tritium (H-3) | 2000 | pCi/L |
| | | I-131 | 1 | |
| | | Gamma Isotopic | | pCi/L |
| | | Mn-54 | 15 | |
| | | Fe-59 | 30 | |
| | | Co-58 | 15 | |
| | | Co-60 | 15 | |
| | | Zn-65 | 30 | |
| | | Zr-95 | 30 | |
| | | Nb-95 | 15 | |
| | | Cs-134 | 15 | |
| | | Cs-137 | 18 | |
| | | Ba-140 | 60 | |
| | | La-140 | 15 | |

Footnotes located at end of table.

Table 2-2
SURRY - 2022
SAMPLE ANALYSIS PROGRAM

Pg. 2 of 3

| SAMPLE MEDIA | FREQUENCY | ANALYSIS | LLD* | REPORT UNITS | | |
|---------------------------|--|-----------------|---------------|---------------------|-----|--------------|
| Shoreline Sediment | Semi-Annually | Gamma Isotopic | | pCi/kg - dry | | |
| | | Cs-134 | 150 | | | |
| | | Cs-137 | 180 | | | |
| Silt | Semi-Annually | Gamma Isotopic | | pCi/kg - dry | | |
| | | Cs-134 | 150 | | | |
| | | Cs-137 | 180 | | | |
| Milk | Monthly | I-131 | 1 | pCi/L | | |
| | | Gamma Isotopic | | pCi/L | | |
| | | Cs-134 | 15 | | | |
| | | Cs-137 | 18 | | | |
| | | Ba-140 | 60 | | | |
| | Quarterly Composite of CP monthly sample | Sr-89 | NA | pCi/L | | |
| | | Sr-90 | NA | | | |
| | | Oysters | Semi-Annually | Gamma Isotopic | | pCi/kg - wet |
| | | | | Mn-54 | 130 | |
| | | | | Fe-59 | 260 | |
| Co-58 | 130 | | | | | |
| Co-60 | 130 | | | | | |
| Zn-65 | 260 | | | | | |
| Cs-134 | 130 | | | | | |
| Cs-137 | 150 | | | | | |
| Clams | Semi-Annually | Gamma Isotopic | | pCi/kg - wet | | |
| | | Mn-54 | 130 | | | |
| | | Fe-59 | 260 | | | |
| | | Co-58 | 130 | | | |
| | | Co-60 | 130 | | | |
| | | Zn-65 | 260 | | | |
| | | Cs-134 | 130 | | | |
| | | Cs-137 | 150 | | | |
| Crabs | Annually | Gamma Isotopic | | pCi/kg - wet | | |
| | | Mn-54 | 130 | | | |
| | | Fe-59 | 260 | | | |
| | | Co-58 | 130 | | | |
| | | Co-60 | 130 | | | |
| | | Zn-65 | 260 | | | |
| | | Cs-134 | 130 | | | |
| | | Cs-137 | 150 | | | |

Footnotes located at end of table.

Table 2-2
 SURRY - 2022
 SAMPLE ANALYSIS PROGRAM

Pg. 3 of 3


| SAMPLE MEDIA | FREQUENCY | ANALYSIS | LLD* | REPORT UNITS |
|----------------------|------------------|-----------------|-------------|---------------------|
| Fish | Semi-Annually | Gamma Isotopic | | pCi/kg - wet |
| | | Mn-54 | 130 | |
| | | Fe-59 | 260 | |
| | | Co-58 | 130 | |
| | | Co-60 | 130 | |
| | | Zn-65 | 260 | |
| | | Cs-134 | 130 | |
| | | Cs-137 | 150 | |
| Food Products | Annually | Gamma Isotopic | | pCi/kg - wet |
| | | I-131 | 60 | |
| | | Cs-134 | 60 | |
| | | Cs-137 | 80 | |

Note: This table is not a complete listing of nuclides that can be detected and reported. Other peaks that are measurable and identifiable, together with the above nuclides, are also identified and reported.


* LLD is the Lower Limit of Detection as defined and required in the USNRC Branch Technical Position on an Acceptable Radiological Environmental Monitoring Program, Revision 1, November 1979.

LLDs indicate those concentrations to which environmental samples are required to be analyzed. Actual analysis of samples may be lower than these listed values.


- (a) Quarterly composites of each location's weekly air particulate samples are analyzed for gamma emitters. NA None assigned.

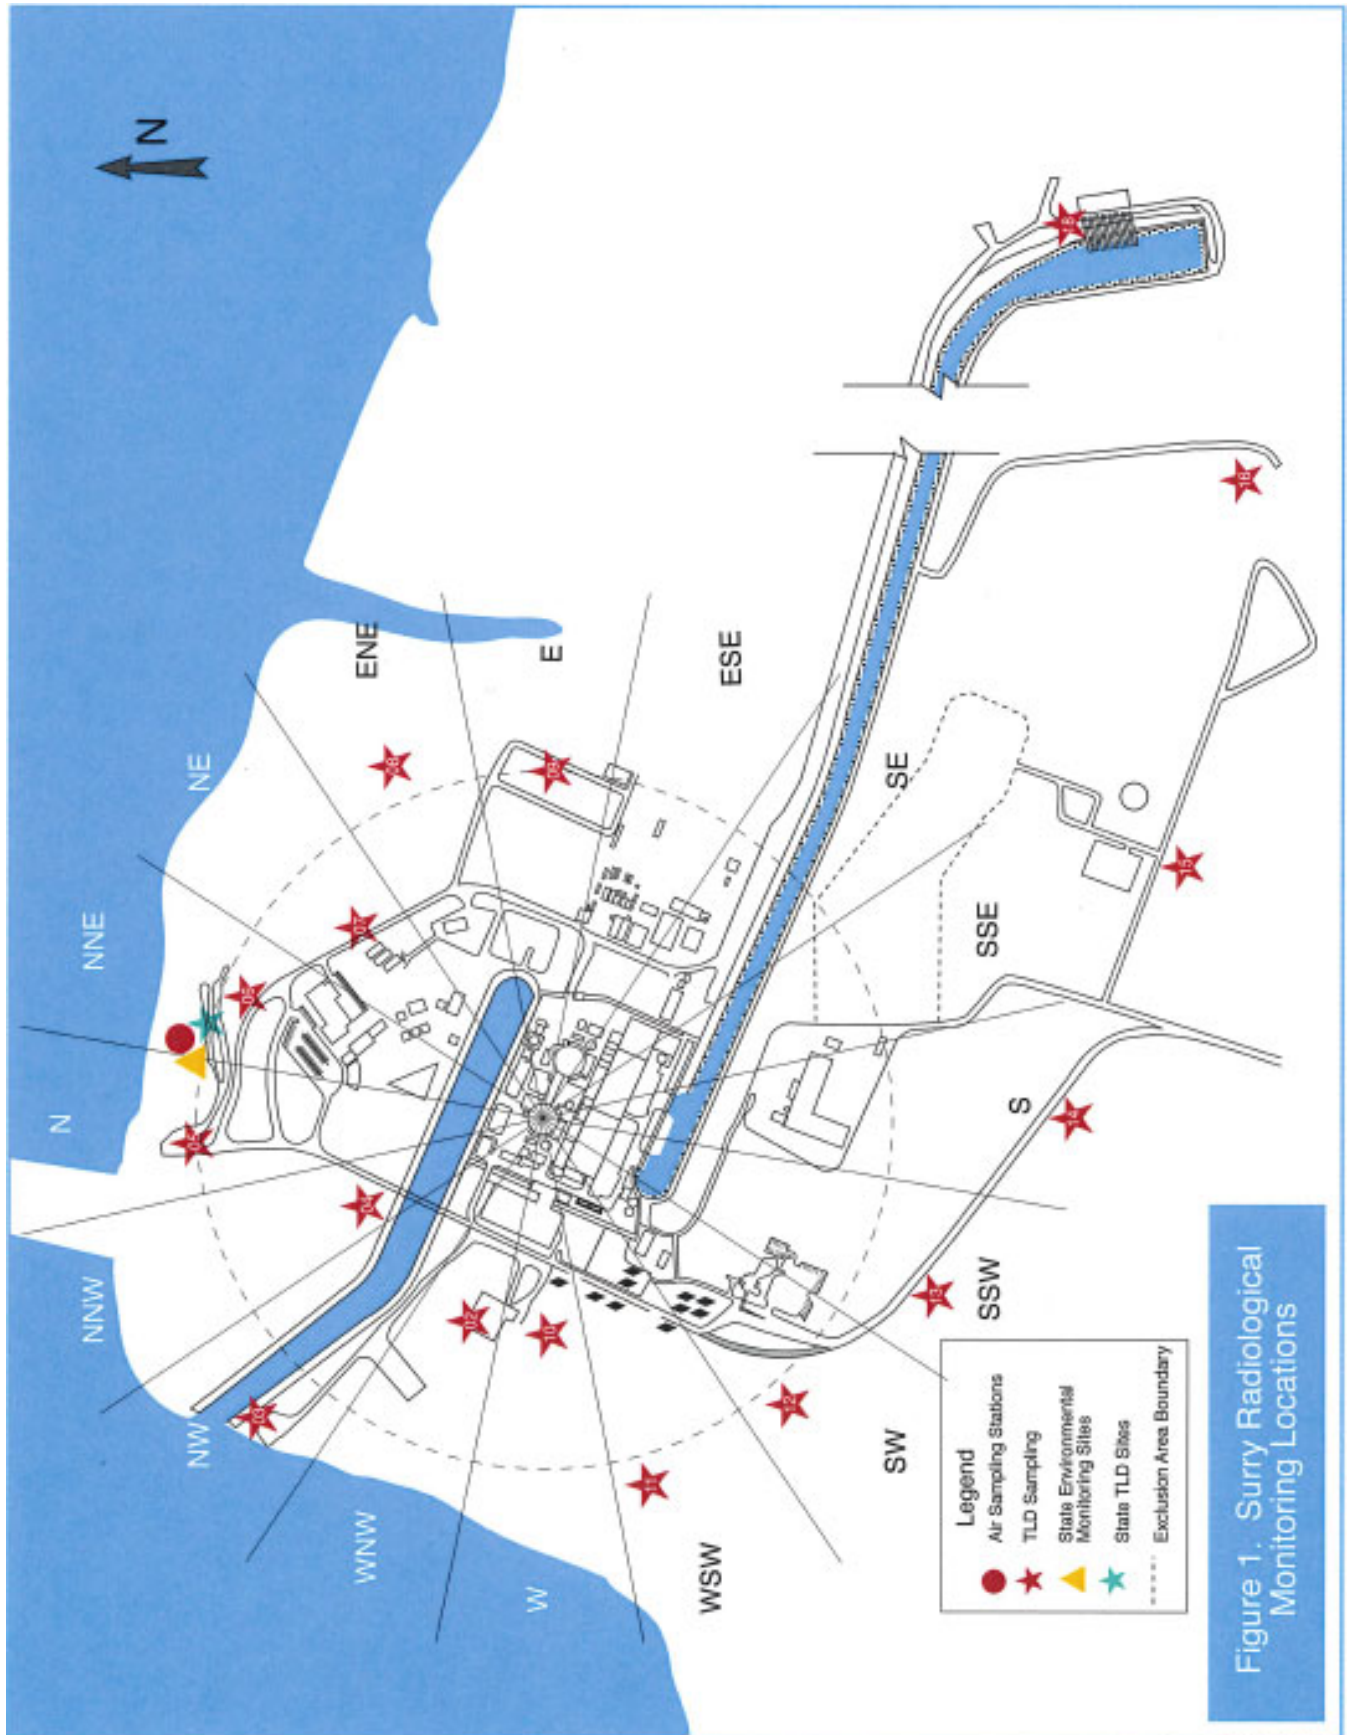


Graphics No. SV645F

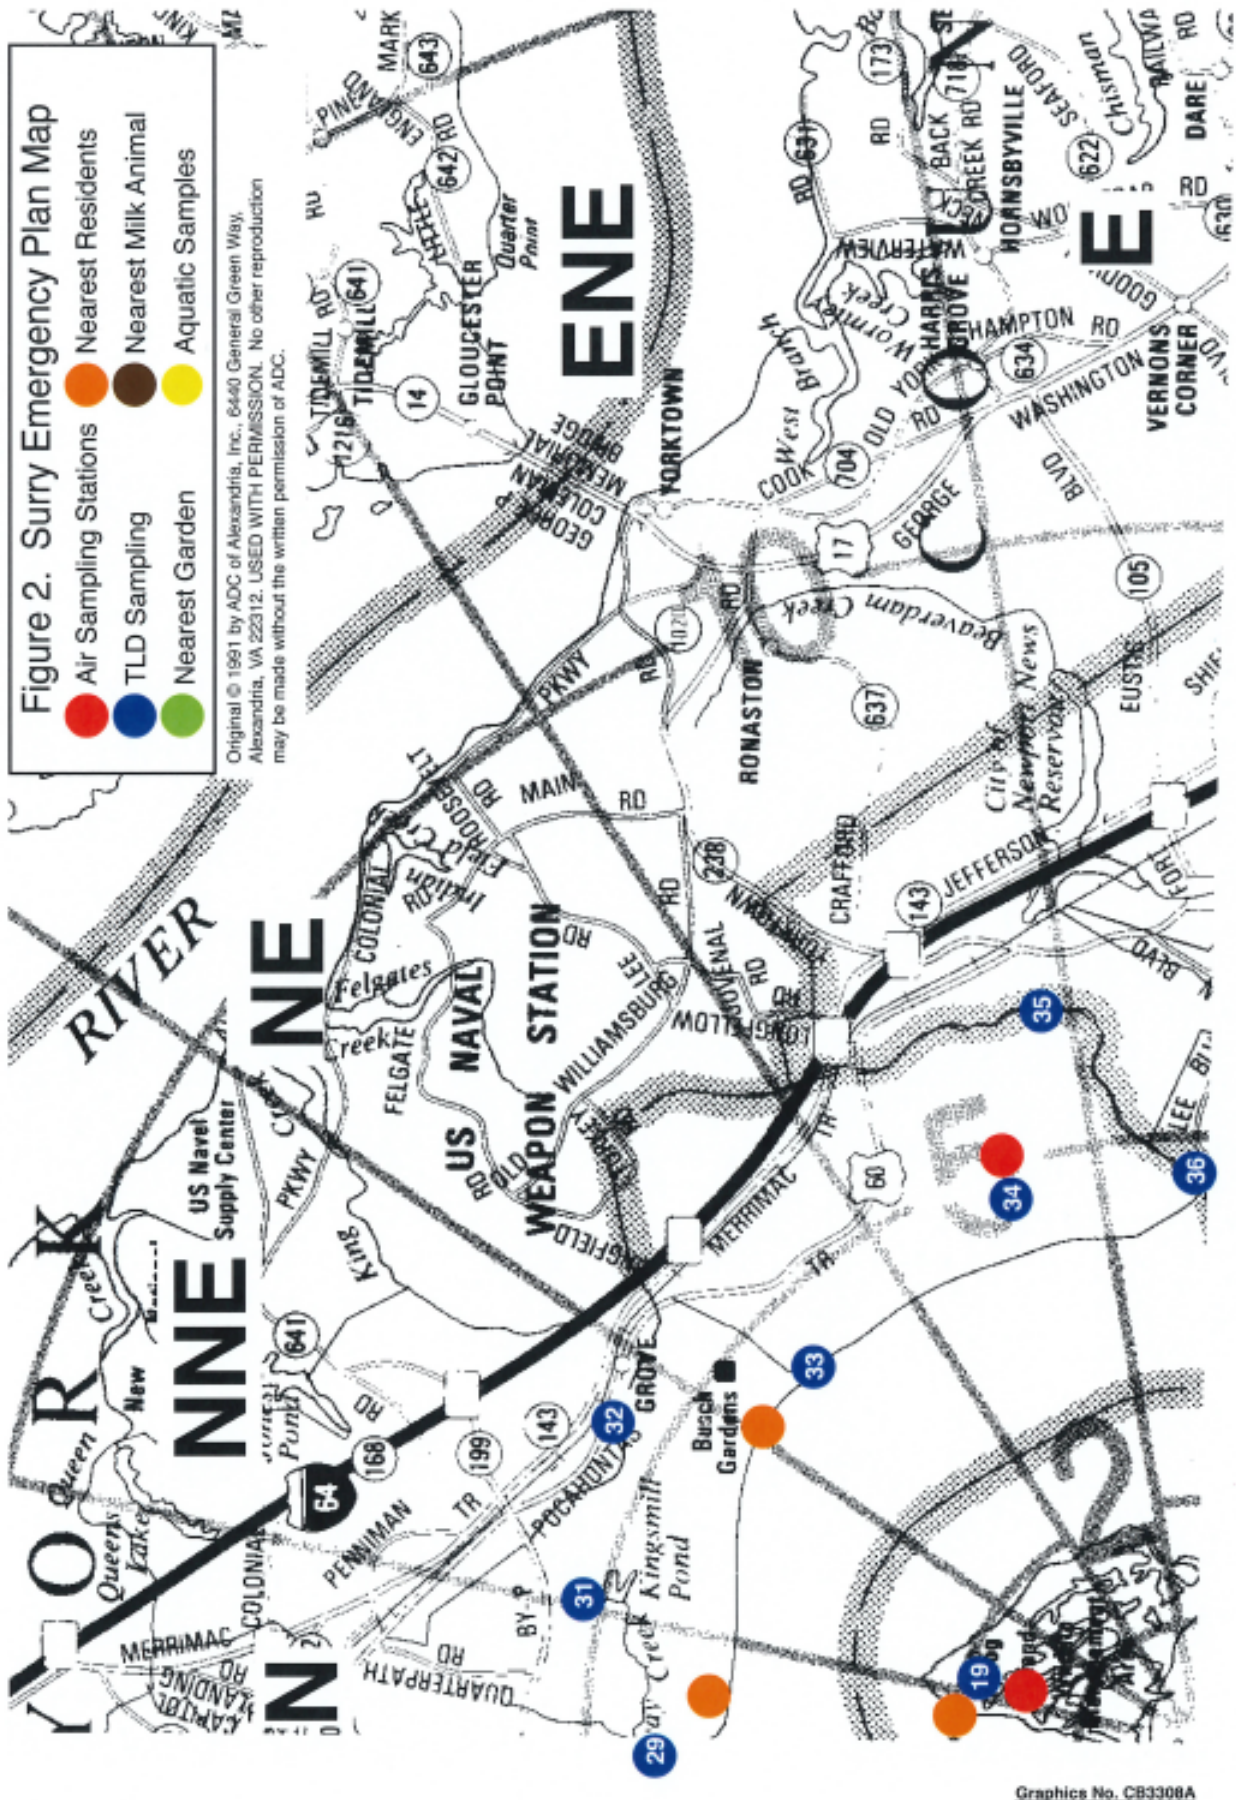


Graphics No. CB3308A

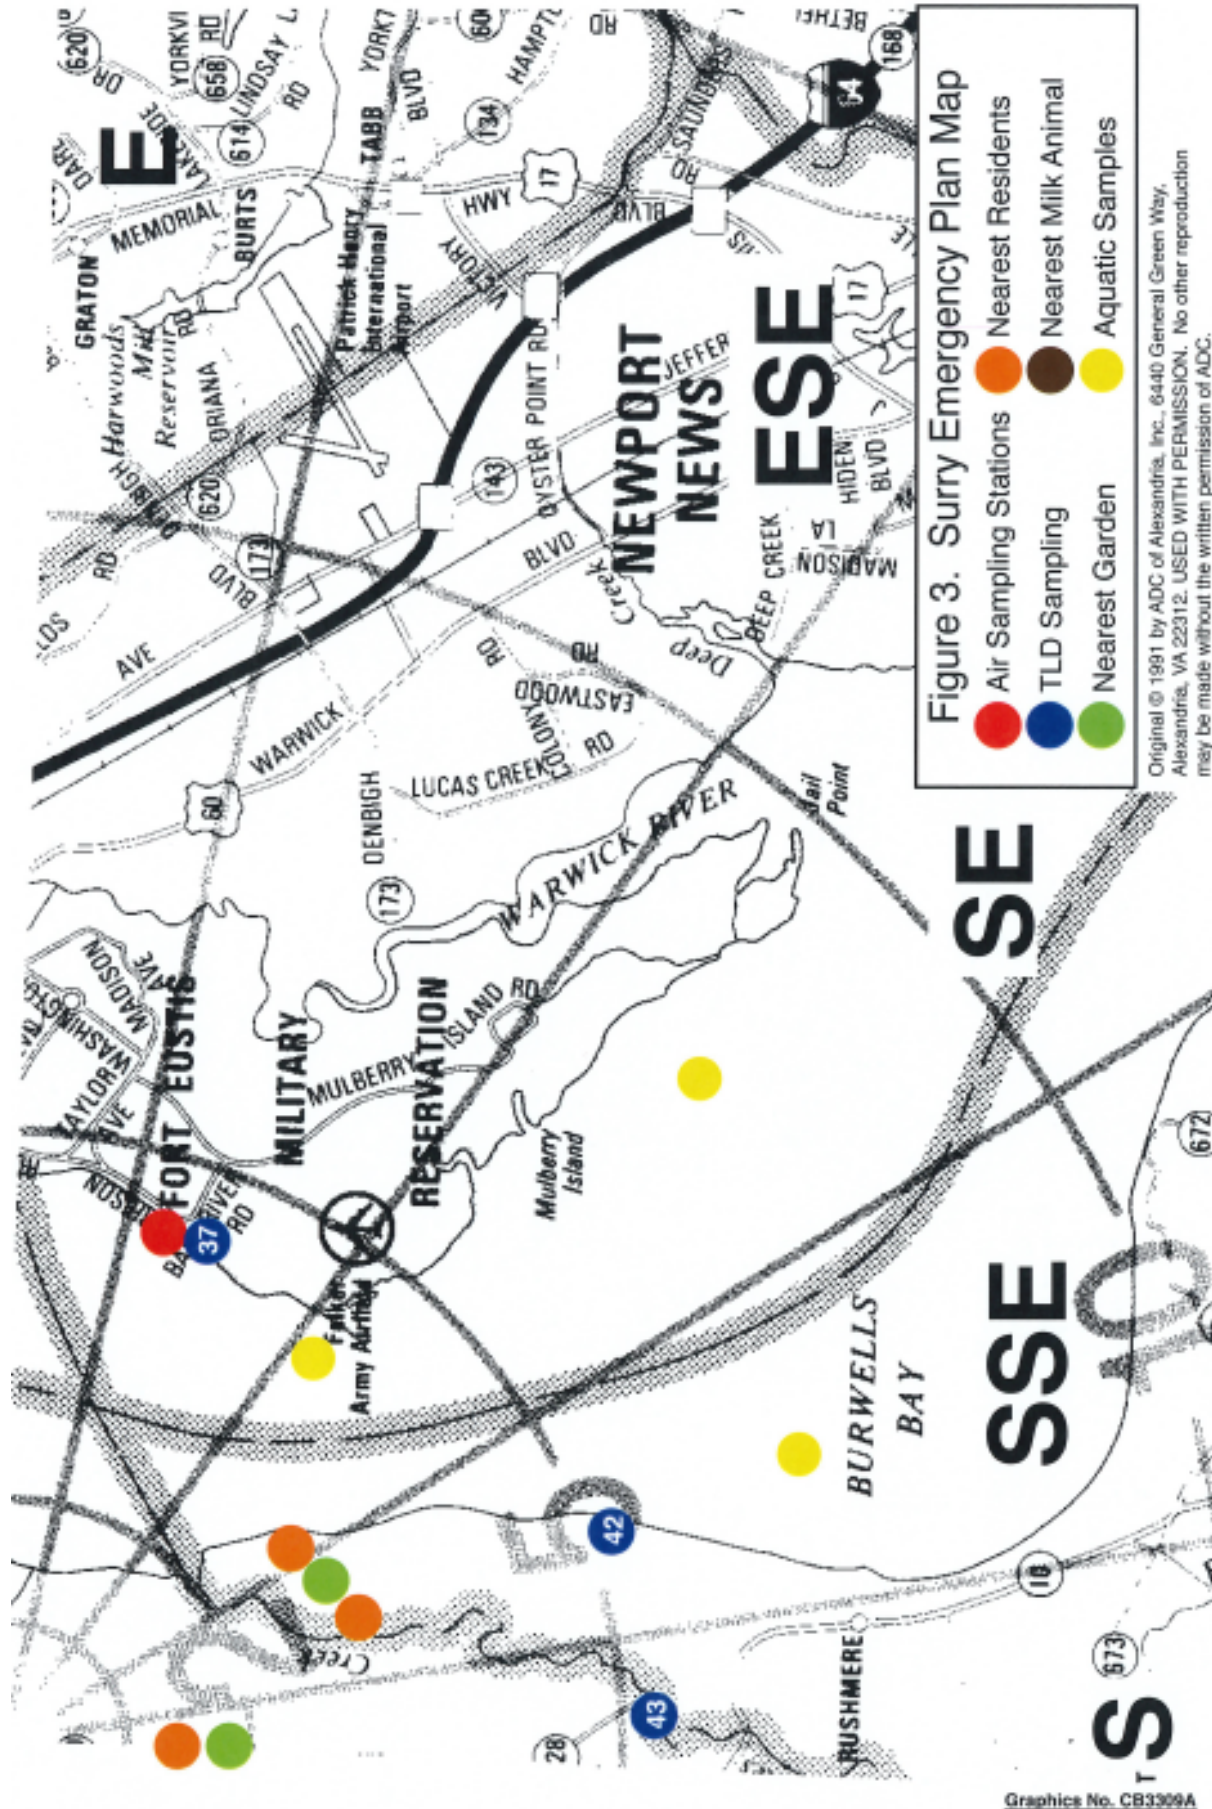

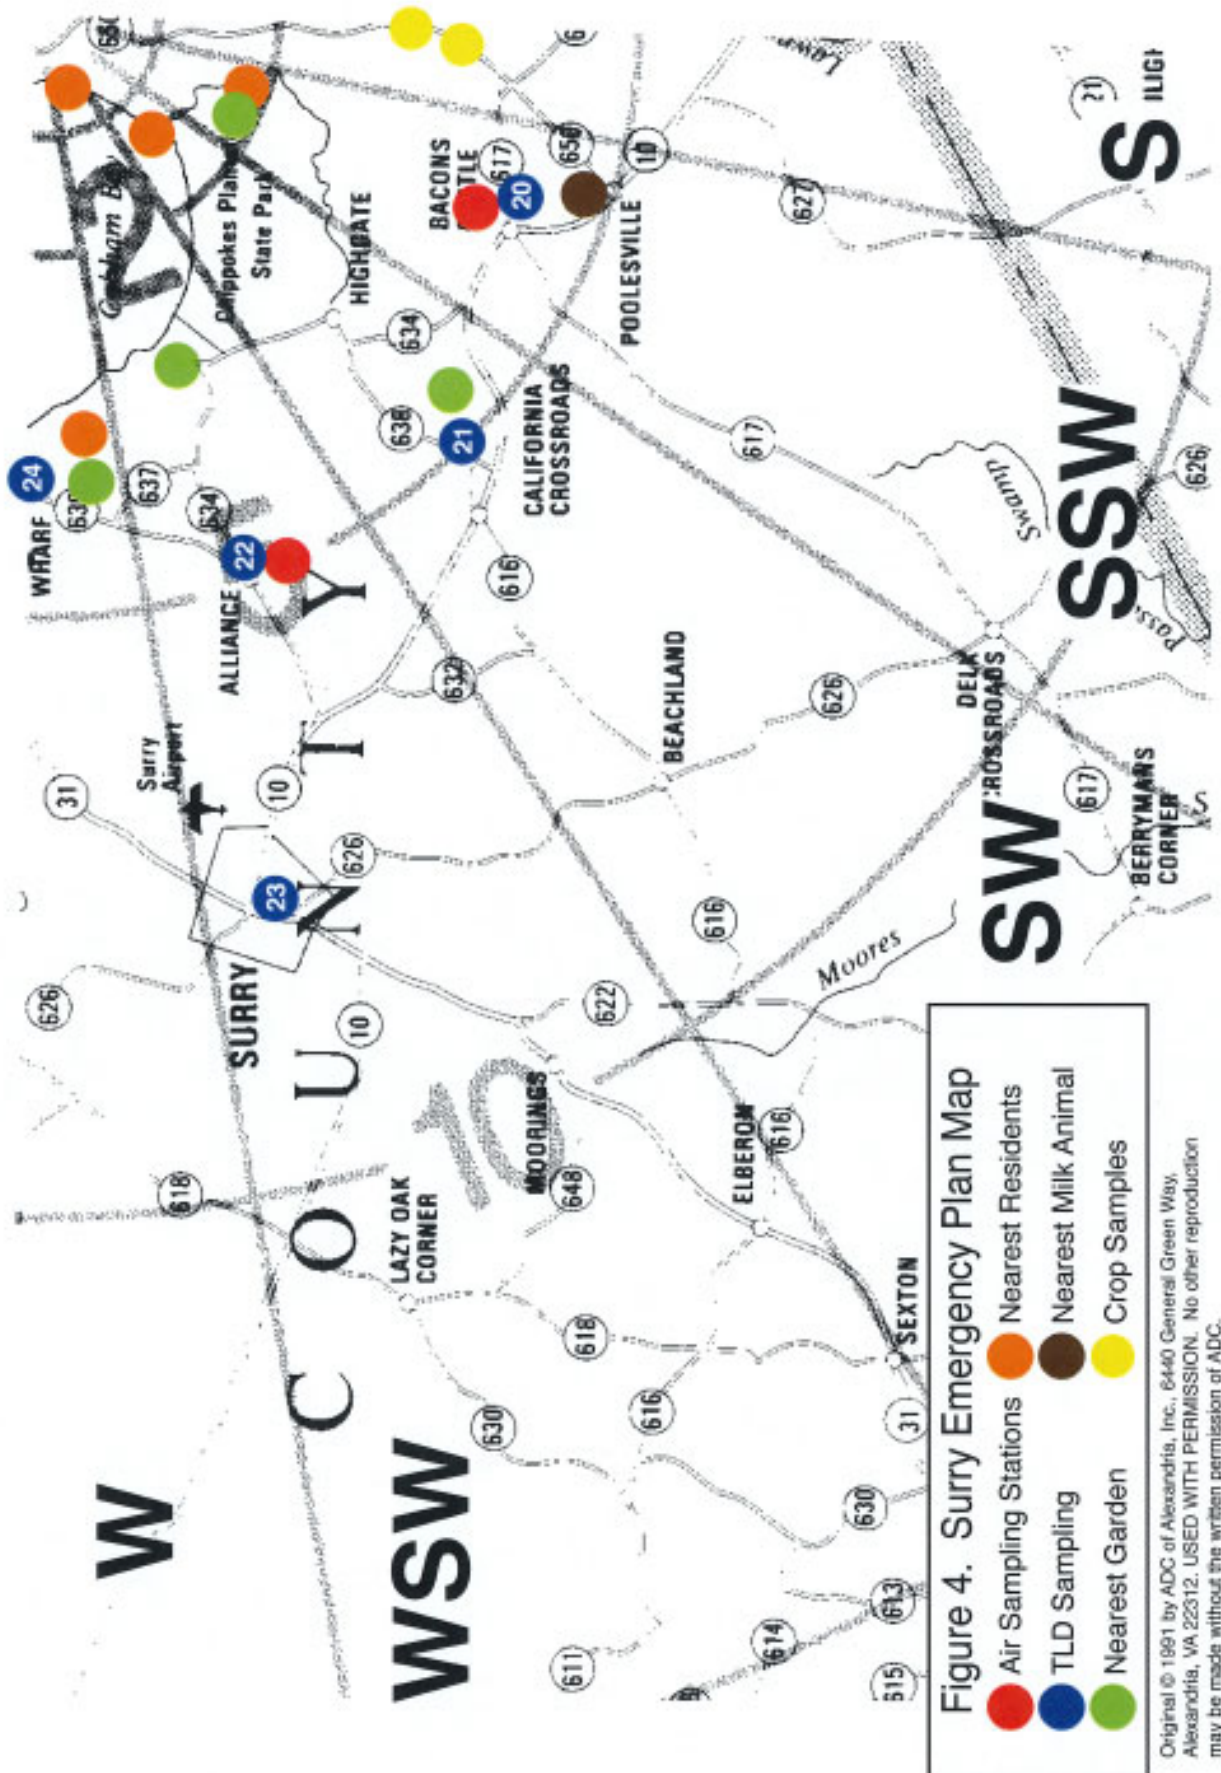

Graphics No. CB3310A

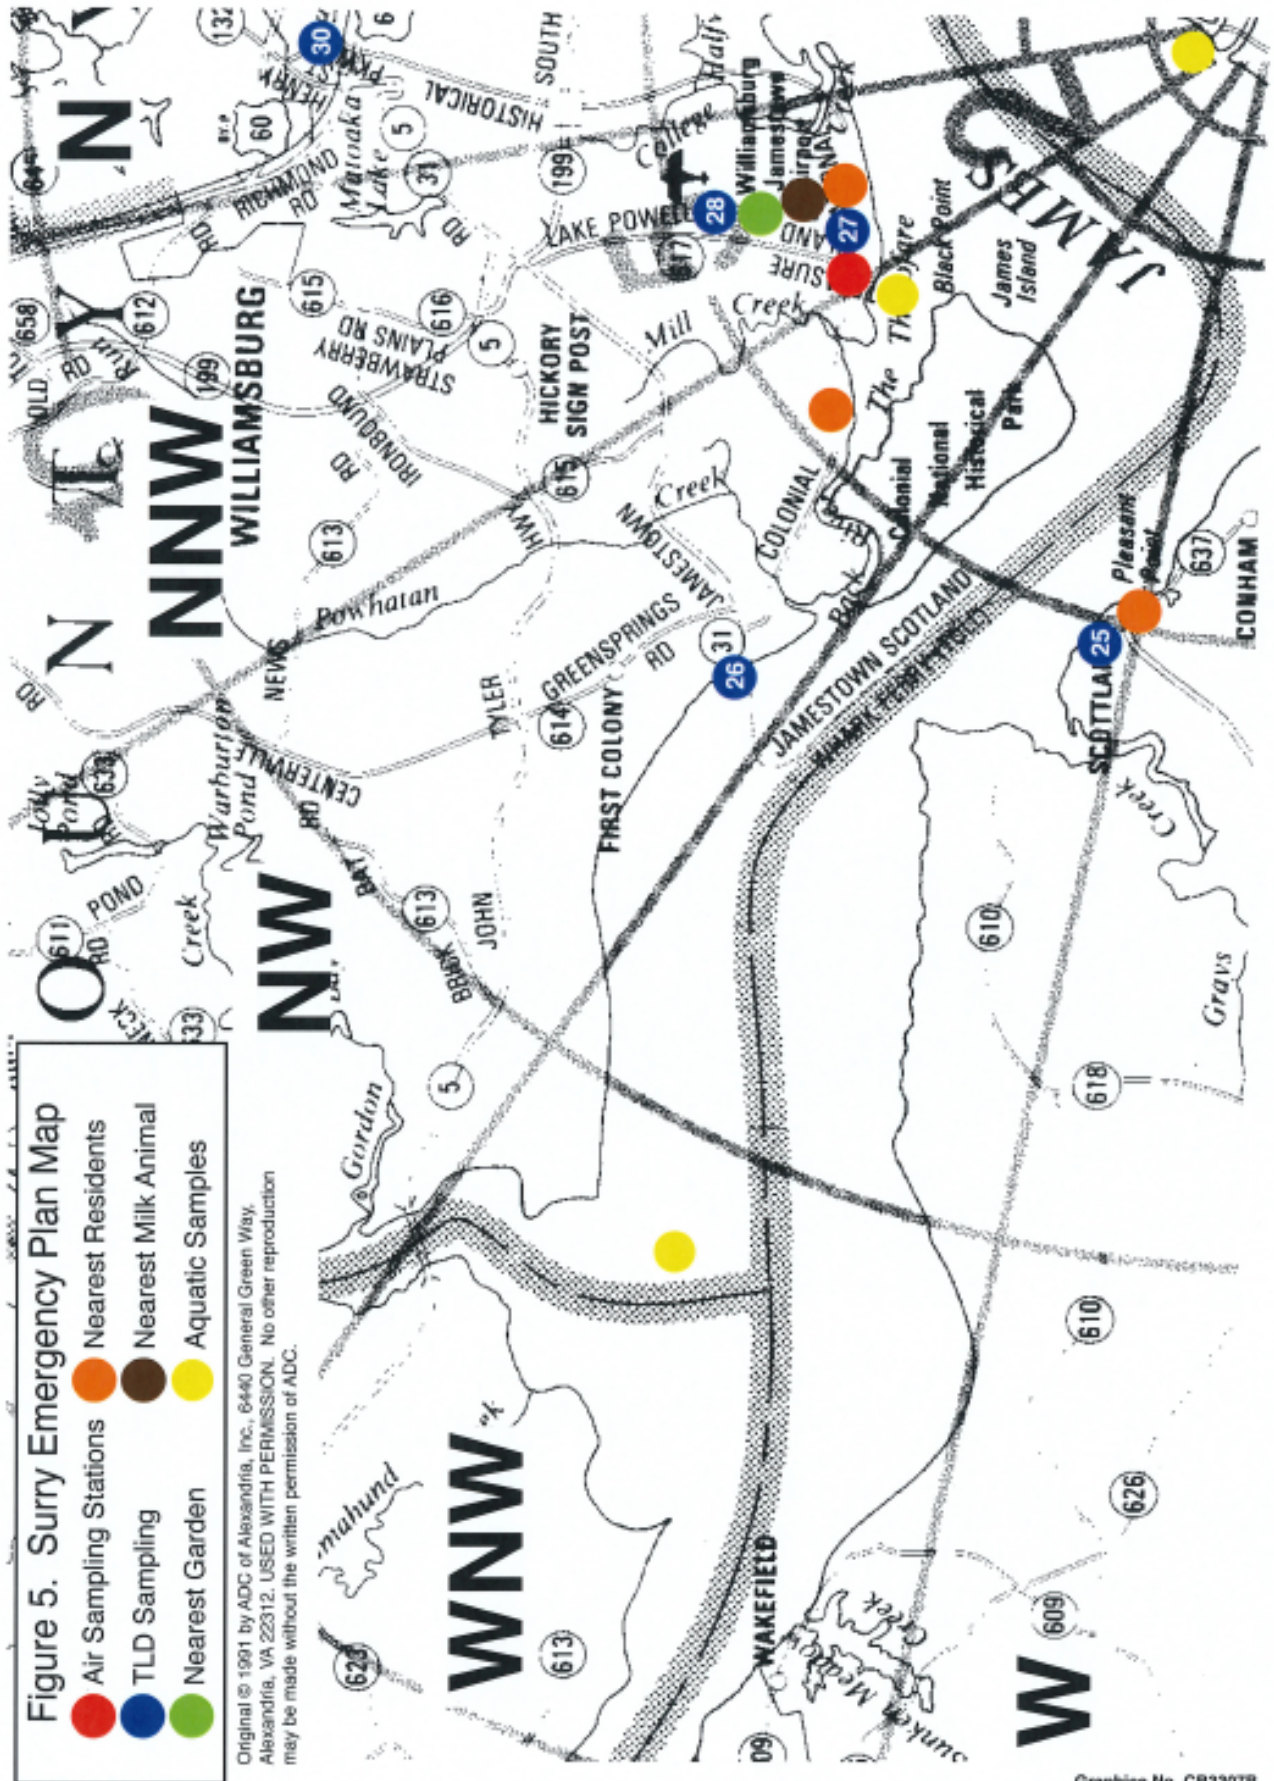

3. ANALYTICAL RESULTS

3.1 Summary of Results

In accordance with the Surry Offsite Dose Calculation Manual (ODCM), a summary table of the analytical results has been prepared and is presented in Table 3-1. This data is presented in accordance with the format of the USNRC Branch Technical Position, "Acceptable Radiological Environmental Monitoring Program", Revision 1, November 1979. A more detailed analysis of the data is provided in Section 4.

TABLE 3-1: RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY
 SURRY NUCLEAR POWER STATION
 Docket No. 50-280-281

| Medium or Pathway Sampled (Units) | Analysis Type | Total Number | LLD | Indicator Locations | Location with Highest Mean | | | Control Locations | Number of Nonroutine Reported Measurements |
|--|-------------------|--------------|-----|---|----------------------------|------------------------------|---|---|--|
| | | | | Mean (Range) | Number | Distance Direction | Mean (Range) | Mean (Range) | |
| Direct Radiation <i>TLD (mR/Std. Month)</i> | Gamma Dose | 164 | 2 | 17.0 (152/152) (10.7-25.3) | STA-9 | 0.3 mi E | 24.2 (4/4) (22.8-25.3) | 18.8 (12/12) (15.8-24.7) | 0 |
| Air Particulate <i>(1e⁻³ pCi/m³)</i> | Gross Beta | 424 | 10 | 16.0 (371/371) (2.34-29.7) | BC | 4.5 mi. SSW | 17.8 (53/53) (8.47-27.7) | 15.6 (53/53) (7.55-25) | 0 |
| | GAMMA | 32 | | | | | | | |
| | Cs-134 | 32 | 50 | <LLD | N/A | | <LLD | <LLD | 0 |
| | Cs-137 | 32 | 60 | <LLD | N/A | | <LLD | <LLD | 0 |
| | Be-7 | 32 | | 143 (28/28) (105-216) | BC | 4.5 mi. SSW | 176 (4/4) (140-216) | 136 (4/4) (125-145) | 0 |
| Air Iodine <i>(1e⁻³ pCi/m³)</i> | I-131 | 424 | 70 | <LLD | N/A | | <LLD | <LLD | 0 |
| Milk <i>(pCi/Liter)</i> | SR-89 | 4 | 5 | <LLD | N/A | | <LLD | NA | 0 |
| | SR-90 | 4 | 1 | 1.73 (4/4) (1.40-2.07) | CP | 3.7 mi. NNW | 1.73 (4/4) (1.4-2.07) | NA | 0 |
| | GAMMA | 36 | | | | | | | |
| | Cs-134 | 36 | 15 | <LLD | N/A | | <LLD | <LLD | 0 |
| | Cs-137 | 36 | 18 | <LLD | N/A | | <LLD | <LLD | 0 |
| | Ba-140 | 36 | 60 | <LLD | N/A | | <LLD | <LLD | 0 |
| | La-140 | 36 | 15 | <LLD | N/A | | <LLD | <LLD | 0 |
| | I-131 | 36 | 1 | <LLD | N/A | | <LLD | <LLD | 0 |
| | K-40 | 36 | | 1143 (24/24) (632-1398) | CP | 3.7 mi. NNW | 1227 (12/12) (1126-1398) | 1132 (12/12) (857-1293) | 0 |
| Food Products <i>(pCi/kg wet)</i> | GAMMA | 3 | | | | | | | |
| | Cs-134 | 3 | 60 | <LLD | N/A | | <LLD | N/A | 0 |

TABLE 3-1: RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY
 SURRY NUCLEAR POWER STATION
 Docket No. 50-280-281

| Medium or Pathway Sampled (Units) | Analysis Type | Total Number | LLD | Indicator Locations | Location with Highest Mean | | | Control Locations | Number of Nonroutine Reported Measurements |
|--|---------------|--------------|------|--|----------------------------|----------------------------|--|-------------------|--|
| | | | | Mean (Range) | Number | Distance Direction | Mean (Range) | Mean (Range) | |
| Food Products (cont'd) <i>(pCi/kg wet)</i> | Cs-137 | 3 | 80 | <LLD | N/A | | <LLD | N/A | 0 |
| | I-131 | 3 | 60 | <LLD | N/A | | <LLD | N/A | 0 |
| | K-40 | 3 | | 9757 (3/3) (3554-20190) | SLADE | 3.2 mi. S | 20190 (1/1) (20190-20190) | NA | 0 |
| Well Water <i>(pCi/Liter)</i> | H-3 | 12 | 2000 | <LLD | N/A | | <LLD | N/A | 0 |
| | GAMMA | 12 | | | | | | | |
| | Mn-54 | 12 | 15 | <LLD | N/A | | <LLD | N/A | 0 |
| | Co-58 | 12 | 15 | <LLD | N/A | | <LLD | N/A | 0 |
| | Fe-59 | 12 | 30 | <LLD | N/A | | <LLD | N/A | 0 |
| | Co-60 | 12 | 15 | <LLD | N/A | | <LLD | N/A | 0 |
| | Zn-65 | 12 | 30 | <LLD | N/A | | <LLD | N/A | 0 |
| | Nb-95 | 12 | 15 | <LLD | N/A | | <LLD | N/A | 0 |
| | Zr-95 | 12 | 30 | <LLD | N/A | | <LLD | N/A | 0 |
| | I-131 | 12 | 1 | <LLD | N/A | | <LLD | N/A | 0 |
| | Cs-134 | 12 | 15 | <LLD | N/A | | <LLD | N/A | 0 |
| | Cs-137 | 12 | 18 | <LLD | N/A | | <LLD | N/A | 0 |
| | Ba-140 | 12 | 60 | <LLD | N/A | | <LLD | N/A | 0 |
| | La-140 | 12 | 15 | <LLD | N/A | | <LLD | N/A | 0 |

TABLE 3-1: RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY
 SURRY NUCLEAR POWER STATION
 Docket No. 50-280-281

| Medium or Pathway Sampled (Units) | Analysis Type | Total Number | LLD | Indicator Locations | Location with Highest Mean | | | Control Locations | Number of Nonroutine Reported Measurements |
|---|---------------|--------------|------|----------------------------------|----------------------------|-----------------------|----------------------------------|------------------------------------|--|
| | | | | Mean (Range) | Number | Distance Direction | Mean (Range) | Mean (Range) | |
| River Water <i>(pCi/Liter)</i> | H-3 | 8 | 2000 | <LLD | N/A | | <LLD | <LLD | 0 |
| <hr/> | | | | | | | | | |
| | GAMMA | 24 | | | | | | | |
| | Mn-54 | 24 | 15 | <LLD | N/A | | <LLD | <LLD | 0 |
| | Co-58 | 24 | 15 | <LLD | N/A | | <LLD | <LLD | 0 |
| | Fe-59 | 24 | 30 | <LLD | N/A | | <LLD | <LLD | 0 |
| | Co-60 | 24 | 15 | <LLD | N/A | | <LLD | <LLD | 0 |
| | Zn-65 | 24 | 30 | <LLD | N/A | | <LLD | <LLD | 0 |
| | Nb-95 | 24 | 15 | <LLD | N/A | | <LLD | <LLD | 0 |
| | Zr-95 | 24 | 30 | <LLD | N/A | | <LLD | <LLD | 0 |
| | I-131 | 24 | 10 | <LLD | N/A | | <LLD | <LLD | 0 |
| | Cs-134 | 24 | 15 | <LLD | N/A | | <LLD | <LLD | 0 |
| | Cs-137 | 24 | 18 | <LLD | N/A | | <LLD | <LLD | 0 |
| | Ba-140 | 24 | 60 | <LLD | N/A | | <LLD | <LLD | 0 |
| | La-140 | 24 | 15 | <LLD | N/A | | <LLD | <LLD | 0 |
| | K-40 | 24 | | 154 (7/12) (87.5-246) | SD | 0.4 mi. NW | 154 (7/12) (87.5-246) | 72.6 (2/12) (60.7-84.6) | 0 |
| <hr/> | | | | | | | | | |
| Sediment Silt <i>(pCi/kg dry)</i> | GAMMA | 6 | | | | | | | |
| | CS-134 | 6 | 150 | <LLD | N/A | | <LLD | <LLD | 0 |

TABLE 3-1: RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY
 SURRY NUCLEAR POWER STATION
 Docket No. 50-280-281

| Medium or Pathway Sampled (Units) | Analysis Type | Total Number | LLD | Indicator Locations | Location with Highest Mean | | | Control Locations | Number of Nonroutine Reported Measurements |
|--|---------------|--------------|-----|--|----------------------------|-------------------------------|--|--|--|
| | | | | Mean (Range) | Number | Distance Direction | Mean (Range) | Mean (Range) | |
| Sediment Silt (cont'd) <i>(pCi/kg dry)</i> | Cs-137 | 6 | 180 | 109 (2/4) (96.1-123) | SI | 1.8 mi. ESE | 123 (1/2) (123-123) | <LLD | 0 |
| | K-40 | 6 | | 14245 (4/4) (10410-18520) | CHIC | 11.2 mi. WNW | 14720 (2/2) (12380-17060) | 14720 (2/2) (12380-17060) | 0 |
| | Ra-226 | 6 | | 2084 (4/4) (1126-2731) | CHIC | 11.2 mi. WNW | 2811 (2/2) (2304-3317) | 2811 (2/2) (2304-3317) | 0 |
| | Ac-228 | 6 | | 805 (2/4) (706-903) | CHIC | 11.2 mi. WNW | 1141 (2/2) (966-1315) | 1141 (2/2) (966-1315) | 0 |
| | Th-228 | 6 | | 1064 (4/4) (721-1273) | CHIC | 11.2 mi. WNW | 1206 (2/2) (979-1433) | 1206 (2/2) (979-1433) | 0 |
| | Th-232 | 6 | | 1051 (4/4) (787-1308) | CHIC | 11.2 mi. WNW | 1082 (2/2) (810-1353) | 1082 (2/2) (810-1353) | 0 |
| | BE-7 | 6 | | 1050 (1/4) (1050-1050) | SD | 0.5 mi. NW | 1050 (1/4) (1050-1050) | <LLD | 0 |
| Shoreline Sediment <i>(pCi/kg dry)</i> | GAMMA | 4 | | | | | | | |
| | CS-134 | 4 | 150 | <LLD | N/A | | <LLD | <LLD | 0 |
| | CS-137 | 4 | 180 | <LLD | N/A | | <LLD | <LLD | 0 |
| | K-40 | 4 | | 6363 (2/2) (6036-6690) | HIR | 0.6 mi. N | 6363 (2/2) (6036-6690) | 2030 (2/2) (1620-2439) | 0 |
| | Th-228 | 4 | | 164 (2/2) (73.6-254) | HIR | 0.6 mi. N | 164 (2/2) (73.6-254) | 103 (2/2) (97.9-109) | 0 |
| | Th-232 | 4 | | 244 (1/2) (244-244) | HIR | 0.6 mi. N | 244 (1/2) (244-244) | <LLD | 0 |
| Fish <i>(pCi/kg wet)</i> | GAMMA | 4 | | | | | | | |
| | Mn-54 | 4 | 130 | <LLD | N/A | | <LLD | N/A | 0 |
| | Co-58 | 4 | 130 | <LLD | N/A | | <LLD | N/A | 0 |
| | Fe-59 | 4 | 260 | <LLD | N/A | | <LLD | N/A | 0 |
| | Co-60 | 4 | 130 | <LLD | N/A | | <LLD | N/A | 0 |
| | Zn-65 | 4 | 260 | <LLD | N/A | | <LLD | N/A | 0 |

TABLE 3-1: RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY
 SURRY NUCLEAR POWER STATION
 Docket No. 50-280-281

| Medium or Pathway Sampled (Units) | Analysis Type | Total Number | LLD | Indicator Locations | Location with Highest Mean | | | Control Locations | Number of Nonroutine Reported Measurements |
|---|---------------|--------------|------|---|----------------------------|--------------------|---|-------------------|--|
| | | | | Mean (Range) | Number | Distance Direction | Mean (Range) | Mean (Range) | |
| Fish (cont'd) <i>(pCi/kg wet)</i> | Cs-134 | 4 | 130 | <LLD | N/A | | <LLD | N/A | 0 |
| | Cs-137 | 4 | 150 | <LLD | N/A | | <LLD | N/A | 0 |
| | K-40 | 4 | | 2042 (4/4) (1610-2585) | SD | 1.3 mi. NNW | 2042 (4/4) (1610-2585) | NA | 0 |
| Oysters <i>(pCi/kg wet)</i> | GAMMA | 6 | | | | | | | |
| | Mn-54 | 6 | 130 | <LLD | N/A | | <LLD | N/A | 0 |
| | Co-58 | 6 | 130 | <LLD | N/A | | <LLD | N/A | 0 |
| | Fe-59 | 6 | 260 | <LLD | N/A | | <LLD | N/A | 0 |
| | Co-60 | 6 | 130 | <LLD | N/A | | <LLD | N/A | 0 |
| | Zn-65 | 6 | 260 | <LLD | N/A | | <LLD | N/A | 0 |
| | Cs-134 | 6 | 130 | <LLD | N/A | | <LLD | N/A | 0 |
| | Cs-137 | 6 | 150 | <LLD | N/A | | <LLD | N/A | 0 |
| | K-40 | 6 | | 430 (1/2) (430-430) | SHI | 6.8 mi. SE | 430 (1/2) (430-430) | N/A | 0 |
| Clams <i>(pCi/kg wet)</i> | GAMMA | 6 | | | | | | | |
| | Mn-54 | 6 | 130 | <LLD | N/A | | <LLD | <LLD | 0 |
| | Co-58 | 6 | 130 | <LLD | N/A | | <LLD | <LLD | 0 |
| | Fe-59 | 6 | 260 | <LLD | N/A | | <LLD | <LLD | 0 |
| | Co-60 | 6 | 130 | <LLD | N/A | | <LLD | <LLD | 0 |
| Zn-65 | 6 | 260 | <LLD | N/A | | <LLD | <LLD | 0 | |

TABLE 3-1: RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY
 SURRY NUCLEAR POWER STATION
 Docket No. 50-280-281

| Medium or Pathway Sampled (Units) | Analysis Type | Total Number | LLD | Indicator Locations | Location with Highest Mean | | | Control Locations | Number of Nonroutine Reported Measurements |
|--|---------------|--------------|-----|---|----------------------------|------------------------------|---|--------------------------------------|--|
| | | | | Mean (Range) | Number | Distance Direction | Mean (Range) | Mean (Range) | |
| Clams (cont'd) <i>(pCi/kg wet)</i> | Cs-134 | 6 | 130 | <LLD | N/A | | <LLD | <LLD | 0 |
| | Cs-137 | 6 | 150 | <LLD | N/A | | <LLD | <LLD | 0 |
| | K-40 | 6 | | 419 (2/4) (324-515) | J1 | 3.9 mi. NW | 515 (1/2) (515-515) | 414 (1/2) (414-414) | 0 |
| Crabs <i>(pCi/kg wet)</i> | GAMMA | 1 | | | | | | | |
| | Mn-54 | 1 | 130 | <LLD | N/A | | <LLD | N/A | 0 |
| | Co-58 | 1 | 130 | <LLD | N/A | | <LLD | N/A | 0 |
| | Fe-59 | 1 | 260 | <LLD | N/A | | <LLD | N/A | 0 |
| | Co-60 | 1 | 130 | <LLD | N/A | | <LLD | N/A | 0 |
| | Zn-65 | 1 | 260 | <LLD | N/A | | <LLD | N/A | 0 |
| | Cs-134 | 1 | 130 | <LLD | N/A | | <LLD | N/A | 0 |
| | Cs-137 | 1 | 150 | <LLD | N/A | | <LLD | N/A | 0 |
| | K-40 | 1 | | 1097 (1/1) (1097-1097) | SD | 1.3 mi. NNW | 1097 (1/1) (1097-1097) | NA | 0 |

3.2 Analytical Results of 2022 REMP Samples

Radiological analyses of environmental media characteristically approach and frequently fall below the detection limits of state-of-the-art measurement methods. The reported error is two times the standard deviation (2σ) of the net activity. Unless otherwise noted, the overall error (counting, sample size, chemistry, errors, etc.) is estimated to be 2 to 5 times that listed. Results are considered positive when the measured value exceeds 2σ uncertainty, unless otherwise noted. MDC is noted in the footnote in several tables. The term <MDC means the value is less than its Minimum Detectable Concentration and is therefore, not considered a positive value or result. Positive values or results are indicated by **bold** text.

Teledyne Brown Engineering analytical methods meet the Lower Limit of Detection (LLD) requirements given in Table 2 of the USNRC Branch Technical Position, "An Acceptable Radiological Environmental Monitoring Program", (November 1979, Revision 1) and the Surry ODCM.

Data are given according to sample type as indicated below.

1. Gamma Exposure Rate
2. Air Particulates, Weekly Gross Beta Radioactivity
3. Air Particulates, Weekly I-131
4. Air Particulates, Quarterly Gamma Spectroscopy
5. Animal Milk
6. Food Products
7. Well Water
8. River Water
9. Silt
10. Shoreline Sediment
11. Fish
12. Oysters
13. Clams
14. Crabs

TABLE 3-2
GAMMA EXPOSURE RATE
(mR/Std. Month) ± 2 Sigma

$MDD_Q = 3 \times \sigma_Q = 3 \times 1.0 = 3 (5)$

Note: If $MDD_Q < 5$ mR, THEN MDD_Q rounded to 5 mR (ANSI N13.37)

$MDD_A = 3 \times \sigma_A = 3 \times 2.8 = 8.8 (10)$

Note: If $MDD_A < 10$ mR, THEN MDD_A rounded to 10 mR (ANSI N13.37)

| Monitoring Location | Quarterly Baseline, B_Q | Normalized Quarterly Monitoring Data, M_Q (mrem per standard quarter) | | | | Quarterly Facility Dose ^a $F_Q = M_Q - B_Q$ (mrem) | | | | Annual Baseline | Annual Monitoring Data | Annual Facility Dose ^b |
|---------------------|---------------------------|--|------|------|------|--|----|----|----|-----------------|------------------------|-----------------------------------|
| | Baseline, (mrem) | 1 | 2 | 3 | 4 | 1 | 2 | 3 | 4 | B_A (mrem) | M_A (mrem) | $F_A = M_A - B_A$ (mrem) |
| | | | | | | | | | | | | |
| 2 | 19.8 | 20.0 | 15.8 | 20.2 | 22.0 | ND | ND | ND | ND | 79.2 | 78.0 | ND |
| 3 | 19.2 | 19.5 | 19.4 | 19.2 | 20.9 | ND | ND | ND | ND | 76.9 | 78.9 | ND |
| 4 | 17.9 | 17.9 | 18.5 | 19.2 | 20.1 | ND | ND | ND | ND | 71.7 | 75.7 | ND |
| 5 | 19.0 | 16.5 | 19.1 | 19.8 | 19.4 | ND | ND | ND | ND | 76.0 | 74.8 | ND |
| 6 | 18.4 | 18.1 | 18.8 | 19.2 | 18.6 | ND | ND | ND | ND | 73.8 | 74.8 | ND |
| 7 | 18.7 | 18.4 | 19.4 | 18.9 | 19.7 | ND | ND | ND | ND | 74.6 | 76.5 | ND |
| 8 | 17.0 | 17.5 | 18.2 | 18.0 | 19.0 | ND | ND | ND | ND | 68.4 | 72.7 | ND |
| 9 | 23.2 | 22.8 | 24.4 | 24.1 | 25.3 | ND | ND | ND | ND | 92.8 | 96.5 | ND |
| 10 | 18.1 | 17.6 | 18.2 | 18.0 | 20.5 | ND | ND | ND | ND | 72.5 | 74.2 | ND |
| 11 | 16.1 | 16.3 | 15.8 | 16.8 | 17.5 | ND | ND | ND | ND | 64.2 | 66.4 | ND |
| 12 | 16.6 | 16.2 | 17.6 | 17.1 | 18.3 | ND | ND | ND | ND | 66.4 | 69.2 | ND |
| 13 | 18.6 | 18.8 | 20.3 | 18.9 | 19.7 | ND | ND | ND | ND | 74.5 | 77.7 | ND |
| 14 | 17.9 | 17.7 | 20.0 | 18.3 | 19.0 | ND | ND | ND | ND | 71.6 | 75.0 | ND |
| 15 | 18.5 | 18.0 | 18.5 | 18.6 | 20.9 | ND | ND | ND | ND | 74.1 | 76.0 | ND |
| 16 | 17.0 | 16.7 | 18.5 | 18.0 | 17.9 | ND | ND | ND | ND | 67.7 | 71.1 | ND |
| 18 | 14.5 | 14.4 | 16.1 | 15.3 | 16.4 | ND | ND | ND | ND | 58.0 | 62.3 | ND |
| 19 | 15.5 | 16.0 | 16.7 | 16.8 | 16.8 | ND | ND | ND | ND | 62.1 | 66.3 | ND |
| 20 | 14.3 | 14.1 | 13.5 | 14.1 | 14.2 | ND | ND | ND | ND | 57.4 | 55.9 | ND |
| 21 | 15.1 | 15.4 | 14.7 | 16.5 | 15.3 | ND | ND | ND | ND | 60.5 | 61.8 | ND |
| 22 | 13.2 | 13.1 | 10.9 | 13.7 | 13.5 | ND | ND | ND | ND | 52.7 | 51.2 | ND |
| 23 | 18.1 | 18.6 | 13.8 | 18.0 | 20.1 | ND | ND | ND | ND | 72.3 | 70.5 | ND |
| 24 | 14.8 | 14.6 | 12.9 | 15.8 | 16.0 | ND | ND | ND | ND | 59.2 | 59.4 | ND |
| 25 | 18.1 | 17.9 | 15.3 | 17.7 | 19.4 | ND | ND | ND | ND | 72.3 | 70.2 | ND |
| 26 | 15.7 | 15.0 | 14.1 | 15.9 | 16.0 | ND | ND | ND | ND | 62.9 | 61.0 | ND |
| 27 | 14.7 | 14.2 | 13.8 | 17.1 | 15.7 | ND | ND | ND | ND | 58.7 | 60.7 | ND |
| 28 | 14.2 | 14.6 | 13.2 | 14.3 | 14.2 | ND | ND | ND | ND | 56.8 | 56.3 | ND |
| 29 | 13.2 | 13.3 | 12.3 | 13.7 | 13.8 | ND | ND | ND | ND | 52.9 | 53.2 | ND |
| 30 | 14.4 | 14.1 | 13.8 | 14.6 | 15.3 | ND | ND | ND | ND | 57.7 | 57.9 | ND |
| 31 | 12.3 | 12.2 | 10.7 | 12.5 | 13.1 | ND | ND | ND | ND | 49.2 | 48.5 | ND |
| 32 | 15.2 | 13.9 | 12.9 | 14.0 | 14.2 | ND | ND | ND | ND | 60.7 | 55.0 | ND |
| 33 | 14.2 | 15.5 | 14.1 | 16.8 | 17.2 | ND | ND | ND | ND | 57.1 | 63.6 | ND |
| 34 | 16.0 | 16.1 | 16.9 | 18.0 | 16.8 | ND | ND | ND | ND | 64.1 | 67.8 | ND |
| 35 | 18.6 | 19.5 | 17.2 | 19.5 | 20.5 | ND | ND | ND | ND | 74.4 | 76.7 | ND |
| 36 | 18.6 | 18.6 | 20.0 | 19.2 | 20.5 | ND | ND | ND | ND | 74.4 | 78.3 | ND |
| 37 | 15.4 | 15.6 | 17.2 | 17.1 | 16.8 | ND | ND | ND | ND | 61.7 | 66.7 | ND |
| 38 | 20.9 | 17.7 | 18.5 | 18.0 | 18.6 | ND | ND | ND | ND | 83.6 | 72.8 | ND |
| 39C | 14.9 | 16.5 | 15.9 | 15.8 | 16.0 | ND | ND | ND | ND | 59.7 | 64.3 | ND |
| 40C | 16.2 | 15.9 | 19.4 | 16.5 | 17.2 | ND | ND | ND | ND | 64.7 | 68.9 | ND |
| 41C | 21.8 | 21.7 | 24.7 | 22.8 | 23.1 | ND | ND | ND | ND | 87.3 | 92.3 | ND |
| 42 | 16.4 | 15.9 | 16.7 | 16.8 | 17.5 | ND | ND | ND | ND | 65.5 | 66.9 | ND |
| 43 | 14.3 | 14.4 | 16.4 | 15.2 | 15.3 | ND | ND | ND | ND | 57.3 | 61.4 | ND |

^aND = Not detected, where $M_Q < (B_Q + MDD_Q)$

^bND = Not detected, where $M_A < (B_A + MDD_A)$

d = Damaged TLDs; m = Missing TLDs; v = Vendor reports TLD not received.

N/A = Missing or Damaged TLD Reading Not Available for Calculation.

Note: Table formatted in accordance with ANSI/HPS N13.37-2014, Environmental Dosimetry Criteria for system Design and Implementation.

TABLE 3-3
AIR PARTICULATES
GROSS BETA RADIOACTIVITY
(1.0E⁻³ pCi/m³ ± 2 Sigma)

| SAMPLING LOCATIONS | | | | | | | | |
|---------------------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|
| COLLECTION DATE | SS | HIR | BC | ALL | CP | BASF | FE | NN-C |
| January 4 | 12.1 ± 2.57 | 13.4 ± 2.64 | 17.6 ± 2.86 | 12.7 ± 2.66 | 13.9 ± 2.67 | 14.8 ± 2.70 | 16.2 ± 2.85 | 13.2 ± 2.63 |
| January 11 | 22.1 ± 3.29 | 21.1 ± 3.22 | 25.5 ± 3.45 | 18.1 ± 3.05 | 17.4 ± 2.95 | 21.7 ± 3.16 | 23.4 ± 3.32 | 19.7 ± 3.08 |
| January 18 | 15.5 ± 2.89 | 20.0 ± 3.12 | 21.0 ± 3.24 | 19.9 ± 3.22 | 16.8 ± 3.01 | 22.3 ± 3.27 | 20.7 ± 3.27 | 16.3 ± 2.97 |
| January 25 | 21.0 ± 3.22 | 24.2 ± 3.37 | 22.8 ± 3.34 | 23.5 ± 3.40 | 19.1 ± 3.09 | 21.3 ± 3.19 | 18.7 ± 3.15 | 20.3 ± 3.16 |
| February 1 | 15.9 ± 3.10 | 19.3 ± 3.25 | 21.4 ± 3.32 | 19.8 ± 3.28 | 18.5 ± 3.14 | 18.4 ± 3.12 | 19.1 ± 3.24 | 14.3 ± 2.89 |
| February 8 | 13.3 ± 2.80 | 10.0 ± 2.59 | 15.9 ± 2.95 | 11.9 ± 2.78 | 11.4 ± 2.65 | 12.7 ± 2.72 | 11.0 ± 2.71 | 11.9 ± 2.70 |
| February 15 | 18.8 ± 3.00 | 19.8 ± 3.04 | 20.3 ± 3.09 | 20.2 ± 3.07 | 19.4 ± 3.01 | 19.9 ± 3.03 | 22.8 ± 3.27 | 20.1 ± 3.11 |
| February 22 | 13.5 ± 2.70 | 17.5 ± 2.91 | 18.9 ± 3.07 | 15.3 ± 2.98 | 15.9 ± 2.91 | 13.7 ± 2.77 | 18.6 ± 3.08 | 14.4 ± 2.77 |
| March 1 | 11.3 ± 2.88 | 13.8 ± 3.01 | 15.3 ± 3.06 | 16.1 ± 3.12 | 14.1 ± 2.93 | 16.0 ± 3.01 | 15.5 ± 3.11 | 13.9 ± 2.93 |
| March 8 | 18.7 ± 2.95 | 19.9 ± 3.00 | 23.9 ± 3.24 | 22.1 ± 3.27 | 19.5 ± 3.06 | 20.5 ± 3.10 | 23.4 ± 3.34 | 19.5 ± 3.05 |
| March 15 | 9.26 ± 2.78 | 9.37 ± 2.75 | 8.47 ± 2.74 | 10.0 ± 2.81 | 7.37 ± 2.58 | 7.55 ± 2.57 | 11.5 ± 2.89 | 10.0 ± 2.73 |
| March 22 | 10.5 ± 2.47 | 12.9 ± 2.62 | 13.6 ± 2.73 | 13.0 ± 2.73 | 11.9 ± 2.60 | 13.8 ± 2.70 | 14.8 ± 2.85 | 11.9 ± 2.61 |
| March 29 | 11.6 ± 2.71 | 11.2 ± 2.67 | 14.9 ± 2.85 | 12.6 ± 2.76 | 11.7 ± 2.64 | 13.5 ± 2.74 | 14.8 ± 2.88 | 12.5 ± 2.69 |
| Qtr. Avg. ± 2 s.d. | 15.1 ± 8.50 | 16.6 ± 9.82 | 18.5 ± 9.90 | 16.9 ± 8.74 | 15.3 ± 7.86 | 16.8 ± 9.20 | 17.9 ± 8.70 | 15.4 ± 7.36 |
| April 5 | 12.0 ± 2.83 | 12.7 ± 2.85 | 14.4 ± 2.97 | 12.3 ± 2.89 | 14.1 ± 2.91 | 11.7 ± 2.78 | 13.3 ± 2.95 | 12.5 ± 2.83 |
| April 12 | 6.84 ± 2.44 | 8.86 ± 2.55 | 9.33 ± 2.61 | 9.81 ± 2.69 | 7.14 ± 2.45 | 8.91 ± 2.54 | 8.74 ± 2.62 | 9.16 ± 2.58 |
| April 19 | 9.92 ± 2.36 | 13.1 ± 2.54 | 14.8 ± 2.75 | 13.3 ± 2.68 | 13.5 ± 2.65 | 15.4 ± 2.74 | 15.9 ± 2.85 | 14.8 ± 2.69 |
| April 25 | 17.7 ± 3.44 | 17.5 ± 3.41 | 21.0 ± 3.58 | 18.5 ± 3.49 | 20.7 ± 3.54 | 21.3 ± 3.56 | 21.3 ± 3.68 | 16.8 ± 3.38 |
| May 3 | 15.2 ± 2.74 | 17.3 ± 2.82 | 21.0 ± 2.98 | 18.4 ± 2.89 | 20.0 ± 2.89 | 22.0 ± 2.98 | 21.8 ± 3.02 | 22.1 ± 2.98 |
| May 10 | 10.5 ± 2.73 | 7.29 ± 2.44 | 12.6 ± 2.86 | 10.1 ± 2.74 | 7.76 ± 2.53 | 11.4 ± 2.75 | 11.4 ± 2.83 | 9.50 ± 2.64 |
| May 17 | 9.63 ± 2.43 | 10.6 ± 2.53 | 11.9 ± 2.60 | 7.68 ± 2.39 | 10.3 ± 2.50 | 10.1 ± 2.47 | 8.27 ± 2.43 | 9.87 ± 2.48 |
| May 24 | 17.7 ± 3.07 | 17.4 ± 3.03 | 19.1 ± 3.13 | 15.8 ± 3.01 | 18.7 ± 3.02 | 19.7 ± 3.05 | 18.3 ± 3.07 | 17.5 ± 2.95 |
| May 31 | 13.6 ± 2.80 | 10.9 ± 2.62 | 11.6 ± 2.69 | 10.0 ± 2.68 | 10.4 ± 2.63 | 11.4 ± 2.68 | 13.5 ± 2.88 | 13.1 ± 2.79 |
| June 7 | 20.9 ± 3.10 | 17.3 ± 2.90 | 19.9 ± 3.09 | 20.4 ± 3.12 | 18.0 ± 2.92 | 20.6 ± 3.05 | 22.1 ± 3.21 | 19.9 ± 3.01 |
| June 13 | 14.9 ± 3.31 | 11.4 ± 3.07 | 13.3 ± 3.23 | 10.9 ± 3.13 | 11.8 ± 3.10 | 2.34 ± 2.42 B | 12.3 ± 3.21 | 12.0 ± 3.10 |
| June 21 | 10.8 ± 2.45 | 9.76 ± 2.35 | 12.9 ± 2.55 | 11.6 ± 2.51 | 10.2 ± 2.37 | 9.09 ± 2.28 | 13.9 ± 2.65 | 8.64 ± 2.28 |
| June 28 | 12.5 ± 2.57 | 9.03 ± 2.32 | 11.1 ± 2.48 | 8.08 ± 2.30 | 9.72 ± 2.42 | 11.6 ± 2.47 | 12.6 ± 2.61 | 11.1 ± 2.45 |
| Qtr. Avg. ± 2 s.d. | 13.3 ± 7.86 | 12.6 ± 7.36 | 14.8 ± 8.06 | 12.8 ± 8.34 | 13.3 ± 9.36 | 13.5 ± 11.8 | 14.9 ± 9.40 | 13.6 ± 8.64 |

B = Visual inspection indicated very little particulate material on filter.

TABLE 3-3
AIR PARTICULATES
GROSS BETA RADIOACTIVITY
(1.0E⁻³ pCi/m³ ± 2 Sigma)

| SAMPLING LOCATIONS | | | | | | | | |
|---------------------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|
| COLLECTION DATE | SS | HIR | BC | ALL | CP | BASF | FE | NN-C |
| July 5 | 10.6 ± 3.03 | 7.65 ± 2.82 | 11.5 ± 3.07 | 8.13 ± 2.92 | 9.48 ± 2.97 | 8.14 ± 2.81 | 12.7 ± 3.16 | 9.35 ± 2.87 |
| July 12 | 13.9 ± 2.98 | 11.4 ± 2.78 | 11.7 ± 2.78 | 11.8 ± 2.79 | 12.5 ± 2.77 | 12.8 ± 2.76 | 12.7 ± 2.85 | 10.5 ± 2.66 |
| July 19 | 17.0 ± 2.96 | 13.9 ± 2.76 | 16.7 ± 3.01 | 15.2 ± 2.99 | 14.7 ± 2.88 | 14.3 ± 2.84 | 18.8 ± 3.17 | 14.3 ± 2.87 |
| July 26 | 21.6 ± 3.12 | 13.9 ± 2.67 | 18.9 ± 3.01 | 16.0 ± 2.91 | 19.2 ± 3.01 | 16.7 ± 2.83 | 18.2 ± 3.01 | 18.1 ± 2.93 |
| August 2 | 12.0 ± 2.99 | 10.3 ± 2.85 | 12.2 ± 2.96 | 14.6 ± 3.62 | 11.6 ± 2.80 | 13.7 ± 2.88 | 12.6 ± 2.94 | 11.3 ± 2.79 |
| August 9 | 13.7 ± 2.52 | 11.4 ± 2.35 | 15.4 ± 2.67 | 12.6 ± 2.51 | 12.3 ± 2.46 | 11.8 ± 2.40 | 13.8 ± 2.62 | 14.4 ± 2.59 |
| August 15 | 16.8 ± 3.21 | 13.2 ± 2.96 | 18.0 ± 3.19 | 14.3 ± 2.98 | 12.6 ± 2.87 | 15.1 ± 3.00 | 15.6 ± 3.09 | 13.3 ± 2.91 |
| August 23 | 17.2 ± 2.76 | 12.0 ± 2.46 | 18.1 ± 2.80 | 13.3 ± 2.55 | 14.7 ± 2.61 | 14.3 ± 2.55 | 13.3 ± 2.59 | 15.0 ± 2.59 |
| August 29 | 27.4 ± 3.88 | 19.2 ± 3.43 | 27.7 ± 3.88 | 26.0 ± 3.78 | 25.4 ± 3.77 | 28.1 ± 3.82 | 29.7 ± 4.02 | 21.5 ± 3.53 |
| September 6 | 20.7 ± 2.79 | 11.4 ± 2.26 | 19.4 ± 2.71 | 15.7 ± 2.50 | 16.0 ± 2.50 | 17.0 ± 2.53 | 17.1 ± 2.62 | 16.6 ± 2.53 |
| September 13 | 12.1 ± 2.56 | 12.2 ± 2.53 | 13.9 ± 2.66 | 8.98 ± 2.37 | 12.2 ± 2.55 | 13.1 ± 2.57 | 11.8 ± 2.57 | 12.2 ± 2.53 |
| September 20 | 25.8 ± 3.28 | 18.0 ± 2.86 | 26.4 ± 3.35 | 21.2 ± 3.14 | 22.3 ± 3.13 | 20.8 ± 3.02 | 22.9 ± 3.21 | 20.8 ± 3.09 |
| September 26 | 28.0 ± 3.87 | 19.9 ± 3.44 | 26.6 ± 3.75 | 24.8 ± 3.69 | 24.8 ± 3.64 | 28.9 ± 3.77 | 24.6 ± 3.67 | 25.0 ± 3.60 |
| Qtr. Avg. ± 2 s.d. | 17.9 ± 11.8 | 13.4 ± 7.20 | 18.2 ± 11.3 | 15.6 ± 10.9 | 16.0 ± 10.5 | 16.5 ± 12.2 | 17.2 ± 11.1 | 15.6 ± 9.34 |
| October 5 | 13.2 ± 2.17 | 12.3 ± 2.10 | 13.3 ± 2.21 | 9.94 ± 2.03 | 7.59 ± 1.86 | 11.1 ± 2.05 | 10.7 ± 2.09 | 11.3 ± 2.07 |
| October 11 | 16.2 ± 3.23 | 12.5 ± 2.97 | 17.9 ± 3.24 | 16.7 ± 3.19 | 16.1 ± 3.10 | 14.2 ± 2.98 | 16.2 ± 3.17 | 18.7 ± 3.23 |
| October 18 | 25.6 ± 3.39 | 20.0 ± 3.08 | 25.8 ± 3.47 | 18.5 ± 3.10 | 21.3 ± 3.17 | 22.4 ± 3.25 | 23.9 ± 3.37 | 24.6 ± 3.33 |
| October 25 | 13.8 ± 2.77 | 11.1 ± 2.57 | 16.3 ± 2.90 | 16.9 ± 2.97 | 12.9 ± 2.68 | 14.2 ± 2.77 | 15.8 ± 2.90 | 12.8 ± 2.66 |
| November 1 | 9.54 ± 2.60 | 7.67 ± 2.44 | 9.03 ± 2.56 | 7.35 ± 2.48 | 8.03 ± 2.46 | 8.32 ± 2.49 | 8.75 ± 2.57 | 7.55 ± 2.44 |
| November 8 | 17.5 ± 2.93 | 15.6 ± 2.80 | 16.5 ± 2.88 | 16.0 ± 2.91 | 16.8 ± 2.88 | 16.2 ± 2.86 | 17.5 ± 2.97 | 17.6 ± 2.93 |
| November 15 | 13.5 ± 2.62 | 9.37 ± 2.33 | 9.65 ± 2.39 | 9.21 ± 2.39 | 11.6 ± 2.48 | 11.7 ± 2.49 | 9.22 ± 2.38 | 10.7 ± 2.43 |
| November 22 | 22.0 ± 3.17 | 15.7 ± 2.81 | 25.5 ± 3.33 | 20.6 ± 3.12 | 19.7 ± 3.02 | 20.8 ± 3.08 | 19.2 ± 3.06 | 22.0 ± 3.14 |
| November 29 | 26.8 ± 3.41 | 19.1 ± 3.00 | 27.7 ± 3.44 | 20.2 ± 3.15 | 23.1 ± 3.25 | 26.7 ± 3.46 | 28.6 ± 3.59 | 23.6 ± 3.31 |
| December 6 | 25.3 ± 3.38 | 16.5 ± 2.92 | 26.4 ± 3.43 | 21.0 ± 3.23 | 19.6 ± 3.09 | 23.6 ± 3.30 | 23.3 ± 3.33 | 22.4 ± 3.23 |
| December 13 | 18.4 ± 2.90 | 14.3 ± 2.64 | 20.4 ± 2.99 | 17.4 ± 2.88 | 18.2 ± 2.86 | 18.3 ± 2.89 | 23.3 ± 3.19 | 20.6 ± 2.99 |
| December 20 | 20.5 ± 3.05 | 16.5 ± 2.81 | 21.1 ± 3.03 | 17.2 ± 2.84 | 17.6 ± 2.80 | 19.8 ± 2.91 | 25.9 ± 3.26 | 19.6 ± 2.84 |
| December 27 | 20.3 ± 2.83 | 17.7 ± 2.66 | 25.0 ± 3.04 | 16.8 ± 2.63 | 18.8 ± 2.71 | 22.5 ± 2.93 | 27.2 ± 3.24 | 19.4 ± 2.80 |
| January 3 | 16.0 ± 2.81 | 13.7 ± 2.65 | 19.5 ± 2.99 | 17.9 ± 2.94 | 17.4 ± 2.86 | 20.0 ± 3.00 | 17.7 ± 2.94 | 21.2 ± 3.04 |
| Qtr. Avg. ± 2 s.d. | 18.4 ± 10.6 | 14.5 ± 7.08 | 19.9 ± 11.8 | 16.3 ± 8.02 | 16.8 ± 8.06 | 18.1 ± 10.2 | 19.5 ± 12.3 | 18.1 ± 10.3 |
| Ann. Avg. ± 2 s.d. | 16.3 ± 10.5 | 14.2 ± 8.14 | 17.8 ± 10.8 | 15.3 ± 9.36 | 15.2 ± 9.32 | 16.2 ± 11.1 | 17.3 ± 10.8 | 15.7 ± 9.36 |

TABLE 3-4
AIRBORNE IODINE
 (1.0E⁻³ pCi/m³ ± 2 Sigma)

| Sampling Stations | | | | | | | | |
|-------------------|--------------|--------------|--------------|--------------|--------------|--------------|--------------|--------------|
| COLLECTION DATE | SS | HIR | BC | ALL | CP | BASF | FE | NN-C |
| January 4 | 1.75 ± 24.4 | 1.74 ± 24.3 | 1.73 ± 24.2 | 1.82 ± 25.4 | 12.4 ± 15.5 | 12.3 ± 15.3 | 12.7 ± 15.9 | 12.4 ± 15.4 |
| January 11 | -5.78 ± 16.8 | -5.72 ± 16.6 | -5.74 ± 16.7 | -5.74 ± 16.7 | -4.11 ± 15.2 | -4.07 ± 15.1 | -4.22 ± 15.6 | -4.10 ± 15.2 |
| January 18 | -4.16 ± 6.03 | -4.15 ± 6.01 | -4.33 ± 6.27 | -4.39 ± 6.37 | 2.84 ± 9.73 | 1.36 ± 4.66 | 2.91 ± 10.0 | 2.81 ± 9.62 |
| January 25 | -1.23 ± 8.98 | -1.22 ± 8.95 | -1.26 ± 9.23 | -1.28 ± 9.34 | 9.68 ± 11.6 | 9.58 ± 11.5 | 9.99 ± 12.0 | 9.65 ± 11.6 |
| February 1 | 0.54 ± 19.4 | 0.53 ± 19.2 | 0.53 ± 19.0 | 0.54 ± 19.3 | -12.1 ± 38.7 | -12.0 ± 38.2 | -12.5 ± 39.8 | -11.9 ± 38.0 |
| February 8 | -0.36 ± 11.2 | -0.35 ± 11.0 | -0.36 ± 11.2 | -0.36 ± 11.4 | -8.28 ± 12.2 | -8.25 ± 12.2 | -8.63 ± 12.8 | -8.31 ± 12.3 |
| February 15 | -1.49 ± 7.99 | -1.48 ± 7.94 | -1.49 ± 8.00 | -1.47 ± 7.88 | 5.09 ± 10.3 | 5.10 ± 10.3 | 5.32 ± 10.7 | 5.26 ± 10.6 |
| February 22 | -7.90 ± 10.1 | -6.57 ± 8.41 | -8.29 ± 10.6 | -8.61 ± 11.0 | -21.5 ± 17.7 | -21.3 ± 17.5 | -21.6 ± 17.8 | -20.9 ± 17.2 |
| March 1 | 9.15 ± 11.9 | 9.06 ± 11.8 | 9.05 ± 11.8 | 9.07 ± 11.8 | 0.92 ± 11.2 | 0.91 ± 11.1 | 0.95 ± 11.7 | 0.92 ± 11.2 |
| March 8 | -2.48 ± 11.4 | -1.17 ± 5.35 | -2.52 ± 11.5 | -2.68 ± 12.2 | 2.82 ± 14.5 | 2.79 ± 14.4 | 2.92 ± 15.1 | 2.79 ± 14.4 |
| March 15 | 8.61 ± 10.9 | 8.48 ± 10.8 | 8.66 ± 11.0 | 8.61 ± 10.9 | -1.96 ± 11.3 | -1.95 ± 11.2 | -2.02 ± 11.6 | -1.94 ± 11.1 |
| March 22 | -3.69 ± 10.7 | -3.67 ± 10.6 | -3.84 ± 11.1 | -3.91 ± 11.3 | 6.07 ± 11.2 | 6.03 ± 11.2 | 6.28 ± 11.6 | 6.05 ± 11.2 |
| March 29 | 2.94 ± 14.7 | 2.91 ± 14.6 | 2.88 ± 14.4 | 2.94 ± 14.7 | -7.76 ± 11.8 | -7.69 ± 11.7 | -7.95 ± 12.1 | -7.69 ± 11.7 |
| April 5 | 3.16 ± 10.9 | 3.13 ± 10.8 | 3.17 ± 10.9 | 3.21 ± 11.0 | 0.90 ± 12.2 | 0.90 ± 12.1 | 0.93 ± 12.6 | 0.90 ± 12.1 |
| April 12 | 3.61 ± 11.5 | 3.57 ± 11.3 | 3.63 ± 11.5 | 3.71 ± 11.7 | 3.59 ± 9.34 | 3.54 ± 9.22 | 3.70 ± 9.64 | 2.99 ± 7.79 |
| April 19 | 5.47 ± 12.5 | 5.42 ± 12.4 | 5.84 ± 13.3 | 5.91 ± 13.5 | -2.34 ± 9.82 | -2.31 ± 9.71 | -2.39 ± 10.1 | -2.27 ± 9.53 |
| April 25 | -6.72 ± 15.0 | -6.66 ± 14.9 | -6.75 ± 15.1 | -6.87 ± 15.3 | 2.56 ± 18.3 | 2.54 ± 18.2 | 2.66 ± 19.0 | 2.59 ± 18.5 |
| May 3 | 2.94 ± 10.2 | 2.89 ± 10.1 | 2.88 ± 10.0 | 2.93 ± 10.2 | -0.07 ± 8.36 | -0.07 ± 8.33 | -0.07 ± 8.53 | -0.07 ± 8.26 |
| May 10 | -2.53 ± 12.2 | -2.39 ± 11.6 | -2.55 ± 12.3 | -2.57 ± 12.5 | -2.35 ± 20.1 | -2.35 ± 20.1 | -2.44 ± 20.9 | -2.34 ± 20.0 |
| May 17 | 7.68 ± 17.5 | 7.76 ± 17.7 | 7.77 ± 17.7 | 8.11 ± 18.5 | -5.59 ± 19.1 | -5.54 ± 19.0 | -5.76 ± 19.7 | -5.57 ± 19.1 |
| May 24 | -3.28 ± 12.1 | -3.25 ± 12.0 | -3.25 ± 12.0 | -3.37 ± 12.5 | 6.72 ± 14.0 | 6.65 ± 13.9 | 6.92 ± 14.5 | 6.67 ± 13.9 |
| May 31 | 6.25 ± 19.4 | 6.19 ± 19.1 | 6.26 ± 19.4 | 6.58 ± 20.4 | 4.02 ± 23.7 | 1.67 ± 9.85 | 4.13 ± 24.4 | 4.00 ± 23.6 |
| June 7 | -4.72 ± 17.1 | -4.70 ± 17.0 | -4.85 ± 17.5 | -4.90 ± 17.7 | 4.80 ± 21.6 | 4.76 ± 21.5 | 4.96 ± 22.4 | 4.75 ± 21.4 |
| June 13 | 4.92 ± 20.3 | 4.87 ± 20.1 | 5.04 ± 20.8 | 2.34 ± 9.64 | 4.95 ± 20.4 | 14.4 ± 33.2 | 15.0 ± 34.7 | 14.4 ± 33.3 |
| June 21 | 7.26 ± 17.0 | 7.14 ± 16.7 | 7.35 ± 17.2 | 7.50 ± 17.6 | 6.06 ± 21.0 | 5.96 ± 20.6 | 6.29 ± 21.8 | 6.04 ± 20.9 |
| June 28 | -6.56 ± 18.7 | -6.43 ± 18.4 | -6.66 ± 19.0 | -6.75 ± 19.3 | -9.50 ± 11.7 | -9.08 ± 11.2 | -9.50 ± 11.7 | -4.35 ± 5.36 |

TABLE 3-4
AIRBORNE IODINE
 (1.0E⁻³ pCi/m³ ± 2 Sigma)

| Sampling Stations | | | | | | | | |
|-------------------|--------------|--------------|--------------|--------------|----------------------|----------------------|----------------------|----------------------|
| COLLECTION DATE | SS | HIR | BC | ALL | CP | BASF | FE | NN-C |
| July 5 | -6.31 ± 10.1 | -6.18 ± 9.85 | -6.42 ± 10.2 | -6.50 ± 10.4 | 5.39 ± 9.39 | 5.18 ± 9.03 | 5.42 ± 9.43 | 5.15 ± 8.98 |
| July 12 | -12.3 ± 17.6 | -12.0 ± 17.1 | -12.0 ± 17.1 | -12.0 ± 17.2 | 12.9 ± 14.6 | 5.34 ± 6.05 | 13.3 ± 15.1 | 12.9 ± 14.6 |
| July 19 | 1.14 ± 23.4 | 1.12 ± 23.0 | 1.18 ± 24.2 | 1.21 ± 24.9 | -18.8 ± 23.3 | -18.6 ± 23.0 | -19.4 ± 24.0 | -18.8 ± 23.4 |
| July 26 | -1.94 ± 11.8 | -1.90 ± 11.6 | -1.99 ± 12.2 | -2.07 ± 12.6 | -3.04 ± 11.6 | -2.97 ± 11.3 | -3.11 ± 11.8 | -3.00 ± 11.4 |
| August 2 | -2.14 ± 9.04 | -2.10 ± 8.88 | -2.11 ± 8.90 | -2.61 ± 11.0 | 10.6 ± 8.53 A | 8.74 ± 7.05 A | 11.0 ± 8.86 A | 10.6 ± 8.51 A |
| August 9 | -9.74 ± 18.4 | -9.55 ± 18.1 | -10.1 ± 19.1 | -10.1 ± 19.1 | 4.89 ± 11.1 | 4.78 ± 10.8 | 5.05 ± 11.4 | 4.85 ± 11.0 |
| August 15 | 0.14 ± 14.2 | 0.14 ± 14.0 | 0.14 ± 13.8 | 0.14 ± 13.8 | 5.33 ± 11.6 | 5.26 ± 11.5 | 5.41 ± 11.8 | 5.27 ± 11.5 |
| August 23 | 0.38 ± 9.38 | 0.37 ± 9.21 | 0.37 ± 9.35 | 0.37 ± 9.32 | 0.76 ± 15.4 | 0.75 ± 15.0 | 0.78 ± 15.7 | 0.75 ± 15.0 |
| August 29 | 2.56 ± 8.75 | 3.76 ± 12.8 | 3.82 ± 13.0 | 3.78 ± 12.9 | 3.79 ± 12.9 | -0.57 ± 5.63 | -1.31 ± 13.0 | -1.25 ± 12.4 |
| September 6 | -1.03 ± 25.3 | -1.01 ± 24.8 | -1.02 ± 25.1 | -1.01 ± 24.7 | 11.1 ± 22.5 | 10.9 ± 22.1 | 11.5 ± 23.2 | 11.0 ± 22.2 |
| September 13 | -5.97 ± 20.3 | -5.87 ± 20.0 | -5.95 ± 20.2 | -5.98 ± 20.3 | 3.94 ± 16.7 | 3.87 ± 16.4 | 4.04 ± 17.1 | 3.86 ± 16.3 |
| September 20 | -0.51 ± 10.7 | -0.49 ± 10.4 | -0.52 ± 11.0 | -0.53 ± 11.1 | 3.15 ± 13.2 | 1.30 ± 5.41 | 3.21 ± 13.4 | 3.16 ± 13.2 |
| September 26 | -5.98 ± 15.0 | -5.90 ± 14.8 | -5.90 ± 14.8 | -5.96 ± 14.9 | 5.68 ± 17.3 | 5.55 ± 16.9 | 5.76 ± 17.5 | 5.55 ± 16.9 |
| October 5 | -5.92 ± 9.27 | -2.44 ± 3.82 | -6.05 ± 9.47 | -6.14 ± 9.61 | -2.58 ± 7.57 | -2.53 ± 7.43 | -2.65 ± 7.76 | -2.55 ± 7.47 |
| October 11 | 6.00 ± 7.93 | 14.0 ± 18.6 | 13.7 ± 18.1 | 13.9 ± 18.4 | 13.5 ± 17.9 | 5.85 ± 28.4 | 6.08 ± 29.5 | 5.87 ± 28.5 |
| October 18 | -6.87 ± 15.2 | -6.70 ± 14.8 | -6.99 ± 15.5 | -6.96 ± 15.4 | 4.82 ± 18.0 | 4.87 ± 18.2 | 4.99 ± 18.7 | 4.81 ± 18.0 |
| October 25 | -11.2 ± 17.9 | -4.58 ± 7.34 | -11.1 ± 17.8 | -11.3 ± 18.1 | 7.50 ± 19.6 | 7.53 ± 19.7 | 7.69 ± 20.1 | 3.09 ± 8.06 |
| November 1 | 12.4 ± 22.7 | 12.1 ± 22.1 | 12.3 ± 22.5 | 12.4 ± 22.6 | 6.98 ± 9.78 | 16.7 ± 23.4 | 17.1 ± 24.0 | 16.6 ± 23.2 |
| November 8 | 6.24 ± 21.5 | 6.15 ± 21.2 | 6.25 ± 21.5 | 6.39 ± 22.0 | -6.16 ± 22.6 | -6.18 ± 22.7 | -6.31 ± 23.2 | -2.57 ± 9.44 |
| November 15 | 8.95 ± 18.6 | 8.75 ± 18.2 | 8.93 ± 18.5 | 9.09 ± 18.9 | 4.78 ± 16.4 | 4.79 ± 16.4 | 4.89 ± 16.7 | 4.75 ± 16.3 |
| November 22 | 0.19 ± 15.4 | 0.18 ± 15.1 | 0.18 ± 15.3 | 0.19 ± 15.4 | 1.72 ± 11.9 | 2.59 ± 17.8 | 2.66 ± 18.3 | 2.58 ± 17.7 |
| November 29 | 10.2 ± 10.7 | 9.93 ± 10.4 | 10.2 ± 10.6 | 10.4 ± 10.9 | 0.06 ± 14.8 | 0.06 ± 15.1 | 0.06 ± 15.4 | 0.03 ± 6.32 |
| December 6 | -8.93 ± 20.0 | -8.77 ± 19.7 | -8.96 ± 20.1 | -9.15 ± 20.5 | 17.7 ± 24.8 | 17.9 ± 25.1 | 18.3 ± 25.7 | 17.8 ± 25.0 |
| December 13 | -4.11 ± 22.7 | -4.01 ± 22.2 | -4.09 ± 22.6 | -4.19 ± 23.2 | -2.58 ± 11.1 | -2.62 ± 11.3 | -2.69 ± 11.6 | -1.33 ± 5.74 |
| December 20 | 5.66 ± 12.5 | 5.59 ± 12.4 | 5.52 ± 12.2 | 5.57 ± 12.3 | 2.96 ± 12.7 | 2.96 ± 12.7 | 3.03 ± 13.0 | 1.91 ± 8.21 |
| December 27 | 0.62 ± 12.9 | 0.61 ± 12.7 | 0.60 ± 12.5 | 0.61 ± 12.7 | -2.33 ± 6.62 | -5.62 ± 16.0 | -5.87 ± 16.7 | -5.73 ± 16.3 |
| January 3 | 6.23 ± 12.0 | 6.13 ± 11.8 | 6.12 ± 11.8 | 6.23 ± 12.0 | -4.25 ± 12.2 | -4.28 ± 12.3 | -4.42 ± 12.7 | -4.26 ± 12.2 |

A= <MDC

TABLE 3-5
AIR PARTICULATES
GAMMA EMITTER CONCENTRATIONS
(1.0E⁻³ pCi/m³ ± 2 Sigma)

| SAMPLING LOCATIONS | Nuclide | 1st Quarter | 2nd Quarter | 3rd Quarter | 4th Quarter | Avg. ± 2 s.d. |
|---------------------------|----------------|--------------------|--------------------|--------------------|----------------------|----------------------|
| SS | Cs-134 | 0.32 ± 0.93 | 0.25 ± 0.81 | 0.17 ± 0.75 | -0.39 ± 0.65 | |
| | Cs-137 | 0.01 ± 0.69 | -0.46 ± 0.50 | -0.02 ± 0.66 | -0.18 ± 0.66 | |
| | Be-7 | 126 ± 30.7 | 179 ± 23.1 | 160 ± 28.5 | 116 ± 19.8 | |
| HIR | Cs-134 | -0.37 ± 0.93 | -0.85 ± 0.71 | 0.29 ± 1.11 | -0.35 ± 0.68 | |
| | Cs-137 | -0.60 ± 0.78 | 0.35 ± 0.66 | 0.06 ± 0.78 | 0.43 ± 0.57 | |
| | Be-7 | 127 ± 33.9 | 140 ± 25.2 | 132 ± 28.2 | 107 ± 18.2 | |
| BC | Cs-134 | -0.08 ± 0.82 | 0.62 ± 0.92 | -0.56 ± 0.80 | -0.33 ± 1.10 | |
| | Cs-137 | -0.49 ± 0.57 | 0.24 ± 1.03 | 0.00 ± 0.72 | 0.50 ± 0.78 | |
| | Be-7 | 174 ± 27.2 | 216 ± 31.3 | 173 ± 25.9 | 140 ± 26.8 | |
| ALL | Cs-134 | -0.03 ± 0.58 | 0.03 ± 0.81 | 0.08 ± 0.61 | 0.23 ± 0.96 | |
| | Cs-137 | -0.15 ± 0.51 | -0.39 ± 0.61 | 0.52 ± 0.69 | -0.55 ± 0.81 | |
| | Be-7 | 140 ± 23.7 | 147 ± 24.7 | 139 ± 26.6 | 111 ± 23.4 | |
| CP | Cs-134 | -0.12 ± 0.69 | 0.13 ± 0.93 | -0.17 ± 0.58 | -0.15 ± 0.69 | |
| | Cs-137 | 0.03 ± 0.66 | -0.15 ± 0.73 | 0.08 ± 0.63 | -0.38 ± 0.58 | |
| | Be-7 | 139 ± 25.3 | 160 ± 24.6 | 141 ± 26.5 | 111 ± 23.8 | |
| BASF | Cs-134 | -0.68 ± 0.92 | -0.36 ± 0.89 | -0.23 ± 0.75 | -0.41 ± 0.66 | |
| | Cs-137 | 0.07 ± 0.81 | 0.16 ± 0.75 | 0.23 ± 0.64 | 0.48 ± 0.47 A | |
| | Be-7 | 147 ± 24.5 | 164 ± 25.9 | 127 ± 26.0 | 105 ± 21.1 | |
| FE | Cs-134 | -0.51 ± 0.82 | -0.33 ± 0.81 | -0.30 ± 0.44 | -0.17 ± 0.61 | |
| | Cs-137 | 0.14 ± 0.74 | -0.23 ± 0.64 | 0.08 ± 0.48 | -0.03 ± 0.56 | |
| | Be-7 | 156 ± 29.9 | 160 ± 30.1 | 167 ± 27.0 | 115 ± 21.3 | |
| NN-C | Cs-134 | -0.36 ± 0.84 | 0.16 ± 0.64 | -0.09 ± 1.18 | -0.18 ± 0.98 | |
| | Cs-137 | 0.67 ± 0.69 | 0.20 ± 0.60 | 0.54 ± 0.84 | 0.83 ± 0.97 | |
| | Be-7 | 131 ± 27.7 | 145 ± 22.1 | 144 ± 35.3 | 125 ± 24.1 | |

A= <MDC

TABLE 3-6
MILK
GAMMA EMMITER AND STRONTIUM CONCENTRATIONS
 (pCi/Liter ± 2 Sigma)

| NUCLIDE | EPPS | *COLONIAL PARKWAY | BEACHY FARM-C |
|------------------------|----------------------|----------------------|----------------------|
| <u>JANUARY</u> | | | |
| Cs-134 | -1.15 ± 5.17 | 0.68 ± 5.15 | -1.46 ± 4.42 |
| Cs-137 | -0.13 ± 4.43 | -0.37 ± 5.24 | -0.40 ± 4.99 |
| Ba-140 | 7.73 ± 16.9 | 8.33 ± 22.6 | 19.3 ± 22.5 |
| La-140 | -1.95 ± 4.53 | -3.50 ± 8.15 | 0.15 ± 5.90 |
| I-131 | 0.22 ± 0.41 | -0.04 ± 0.49 | 0.17 ± 0.48 |
| K-40 | 1339 ± 204 | 1181 ± 172 | 1158 ± 174 |
| <u>FEBRUARY</u> | | | |
| Cs-134 | 2.85 ± 4.84 | 2.69 ± 4.45 | 1.60 ± 5.24 |
| Cs-137 | -1.12 ± 4.09 | 3.68 ± 4.90 | -3.66 ± 4.94 |
| Ba-140 | 8.88 ± 14.6 | -5.09 ± 17.1 | 7.18 ± 18.7 |
| La-140 | 1.14 ± 5.25 | -0.56 ± 4.76 | 2.31 ± 5.73 |
| I-131 | 0.26 ± 0.48 | 0.54 ± 0.54 | 0.26 ± 0.50 |
| K-40 | 1179 ± 157 | 1132 ± 186 | 1102 ± 173 |
| <u>MARCH</u> | | | |
| Cs-134 | 0.80 ± 5.17 | 1.11 ± 4.93 | 1.51 ± 5.21 |
| Cs-137 | 3.76 ± 4.78 | 3.03 ± 4.39 | -1.49 ± 5.16 |
| Ba-140 | 8.01 ± 18.2 | 8.22 ± 15.2 | -3.08 ± 18.0 |
| La-140 | -1.72 ± 4.80 | 3.32 ± 4.23 | -0.07 ± 5.05 |
| I-131 | -0.17 ± 0.47 | 0.23 ± 0.49 | -0.14 ± 0.46 |
| K-40 | 1082 ± 182 | 1398 ± 170 | 1142 ± 212 |
| Sr-89 | | 2.32 ± 2.83 | |
| Sr-90 | | 2.07 ± 0.71 | |
| <u>APRIL</u> | | | |
| Cs-134 | -3.05 ± 4.94 | -2.66 ± 5.03 | 0.18 ± 4.78 |
| Cs-137 | -0.25 ± 4.62 | -0.78 ± 4.85 | 3.17 ± 4.74 |
| Ba-140 | -1.33 ± 14.8 | -1.77 ± 18.4 | 5.67 ± 15.9 |
| La-140 | -0.95 ± 4.39 | 0.39 ± 4.86 | -0.41 ± 4.92 |
| I-131 | -0.36 ± 0.47 | 0.25 ± 0.55 | -0.05 ± 0.47 |
| K-40 | 1252 ± 181 | 1217 ± 179 | 1199 ± 194 |
| <u>MAY</u> | | | |
| Cs-134 | -2.69 ± 5.86 | 2.61 ± 5.59 | 4.62 ± 4.53 A |
| Cs-137 | 6.89 ± 5.53 A | -2.34 ± 4.55 | 0.54 ± 4.53 |
| Ba-140 | 1.39 ± 18.2 | 1.14 ± 15.6 | 4.72 ± 14.9 |
| La-140 | 0.54 ± 6.13 | 0.41 ± 4.55 | -2.05 ± 4.87 |
| I-131 | 0.28 ± 0.42 | -0.42 ± 0.41 | 0.22 ± 0.49 |
| K-40 | 985 ± 170 | 1352 ± 194 | 1293 ± 160 |

*Sr-89/90 analysis performed quarterly on location Colonial Parkway only.

A= <MDC

TABLE 3-6
MILK
GAMMA EMMITER AND STRONTIUM CONCENTRATIONS
 (pCi/Liter ± 2 Sigma)

| NUCLIDE | EPPS | *COLONIAL PARKWAY | BEACHY FARM-C |
|-------------------------|-------------------|----------------------|----------------------|
| <u>JUNE</u> | | | |
| Cs-134 | 0.69 ± 4.44 | 2.91 ± 6.57 | 3.93 ± 4.99 |
| Cs-137 | 0.99 ± 4.41 | -0.47 ± 6.03 | -0.10 ± 4.84 |
| Ba-140 | -0.44 ± 19.6 | -0.80 ± 23.7 | -6.58 ± 19.2 |
| La-140 | -2.26 ± 6.61 | 2.20 ± 5.68 | -3.43 ± 5.55 |
| I-131 | -0.05 ± 0.47 | 0.01 ± 0.43 | 0.14 ± 0.48 |
| K-40 | 1154 ± 167 | 1254 ± 209 | 1238 ± 148 |
| Sr-89 | | 2.14 ± 2.57 | |
| Sr-90 | | 1.40 ± 0.65 | |
| <u>JULY</u> | | | |
| Cs-134 | -0.28 ± 4.83 | -0.65 ± 3.94 | 1.59 ± 4.32 |
| Cs-137 | 0.47 ± 5.19 | -3.27 ± 3.56 | 1.26 ± 4.46 |
| Ba-140 | 8.80 ± 18.0 | -3.08 ± 19.4 | 1.60 ± 14.6 |
| La-140 | -0.49 ± 5.44 | 0.95 ± 6.96 | 0.20 ± 5.30 |
| I-131 | -0.20 ± 0.44 | 0.11 ± 0.37 | -0.11 ± 0.52 |
| K-40 | 1099 ± 166 | 1126 ± 158 | 1100 ± 154 |
| <u>AUGUST</u> | | | |
| Cs-134 | 2.32 ± 3.92 | -3.37 ± 4.16 | -0.63 ± 3.73 |
| Cs-137 | 0.95 ± 4.05 | -3.59 ± 3.83 | 0.49 ± 3.36 |
| Ba-140 | -1.92 ± 16.5 | 1.88 ± 17.5 | 1.36 ± 15.0 |
| La-140 | -3.49 ± 4.82 | 0.73 ± 5.40 | -5.82 ± 4.73 |
| I-131 | -0.31 ± 0.44 | 0.01 ± 0.41 | -0.71 ± 0.43 |
| K-40 | 1060 ± 130 | 1298 ± 149 | 1245 ± 125 |
| <u>SEPTEMBER</u> | | | |
| Cs-134 | -1.16 ± 4.82 | -1.63 ± 5.07 | -4.37 ± 4.42 |
| Cs-137 | 4.23 ± 5.08 | 1.72 ± 5.17 | 5.99 ± 4.55 A |
| Ba-140 | 13.4 ± 23.1 | 3.75 ± 24.4 | -5.48 ± 21.6 |
| La-140 | 2.95 ± 6.93 | -5.88 ± 7.11 | 4.48 ± 6.08 |
| I-131 | 0.13 ± 0.50 | 0.53 ± 0.48 A | -0.20 ± 0.43 |
| K-40 | 1208 ± 153 | 1151 ± 185 | 1100 ± 168 |
| Sr-89 | | 3.34 ± 2.32 A | |
| Sr-90 | | 1.64 ± 0.55 | |
| <u>OCTOBER</u> | | | |
| Cs-134 | -0.74 ± 4.73 | 1.54 ± 4.98 | -0.72 ± 4.52 |
| Cs-137 | 2.98 ± 4.53 | -3.71 ± 5.23 | -1.05 ± 3.78 |
| Ba-140 | 11.8 ± 18.4 | 1.20 ± 23.3 | -1.06 ± 18.1 |
| La-140 | 3.28 ± 6.75 | -1.29 ± 5.59 | -2.86 ± 6.08 |
| I-131 | 0.56 ± 0.57 | 0.21 ± 0.48 | 0.38 ± 0.47 |
| K-40 | 825 ± 166 | 1126 ± 166 | 900 ± 147 |

*Sr-89/90 analysis performed quarterly on location Colonial Parkway only.

A= <MDC

TABLE 3-6
MILK
GAMMA EMMITER AND STRONTIUM CONCENTRATIONS
 (pCi/Liter ± 2 Sigma)

| NUCLIDE | EPPS | *COLONIAL PARKWAY | BEACHY FARM-C |
|------------------------|----------------------|------------------------------|--------------------------|
| <u>NOVEMBER</u> | | | |
| Cs-134 | 8.05 ± 4.97 A | -0.61 ± 5.68 | -2.68 ± 3.94 |
| Cs-137 | -2.55 ± 4.66 | 3.08 ± 4.94 | -0.13 ± 4.52 |
| Ba-140 | -26.9 ± 20.0 | 7.23 ± 20.7 | 0.86 ± 15.8 |
| La-140 | -0.28 ± 5.83 | -3.24 ± 7.80 | 1.55 ± 4.28 |
| I-131 | -0.05 ± 0.52 | 0.23 ± 0.45 | 0.29 ± 0.48 |
| K-40 | 888 ± 145 | 1301 ± 201 | 857 ± 136 |
| <u>DECEMBER</u> | | | |
| Cs-134 | -0.93 ± 5.25 | -3.86 ± 5.72 | 2.55 ± 5.01 |
| Cs-137 | -3.17 ± 5.07 | -1.16 ± 5.92 | 0.98 ± 4.95 |
| Ba-140 | -0.56 ± 19.6 | -13.2 ± 21.3 | 12.5 ± 18.7 |
| La-140 | 0.68 ± 5.57 | 2.99 ± 4.50 | 1.35 ± 5.31 |
| I-131 | 0.05 ± 0.49 | 0.07 ± 0.48 | -0.55 ± 0.50 |
| K-40 | 632 ± 176 | 1182 ± 197 | 1244 ± 183 |
| Sr-89 | | -0.05 ± 2.27 | |
| Sr-90 | | 1.81 ± 0.82 | |

*Sr-89/90 analysis performed quarterly on location Colonial Parkway only.
A= <MDC

TABLE 3-7
FOOD PRODUCTS
GAMMA EMITTER CONCENTRATIONS
 (pCi/kg (wet) ± 2 Sigma)

| SAMPLING LOCATIONS | COLLECTION DATE | SAMPLE TYPE | NUCLIDE | | | |
|--------------------|-----------------|-------------|---------------|--------------|--------------|--------------|
| | | | Cs-134 | Cs-137 | I-131 | K-40 |
| BROCK FARM | 11/15/2022 | CORN | 1.24 ± 12.3 | -8.35 ± 11.6 | 4.77 ± 16.0 | 3554 ± 462 |
| | 11/15/2022 | PEANUTS | 21.7 ± 16.3 A | 7.16 ± 14.2 | -2.02 ± 23.6 | 5527 ± 636 |
| SLADE FARM | 11/15/2022 | SOYBEANS | -2.36 ± 20.1 | 8.37 ± 17.6 | -15.4 ± 23.2 | 20190 ± 1136 |

A= <MDC

**TABLE 3-8
 WELL WATER
 GAMMA EMMITER AND TRITIUM CONCENTRATIONS
 (pCi/Liter ± 2 Sigma)**

| SAMPLING LOCATIONS | COLLECTION DATE | NUCLIDE | | | | |
|--------------------|-----------------|----------------------|----------------------|----------------------|----------------------|----------------------|
| SS | | Mn-54 | Co-58 | Fe-59 | Co-60 | Zn-65 |
| | 3/1/2022 | 0.11 ± 3.60 | 1.69 ± 3.00 | 2.82 ± 6.88 | -2.66 ± 2.85 | -11.8 ± 8.22 |
| | 6/15/2022 | -0.58 ± 3.23 | -0.01 ± 2.98 | 0.60 ± 5.52 | 5.18 ± 4.13 A | -0.58 ± 6.22 |
| | 9/13/2022 | 0.15 ± 2.70 | 0.16 ± 3.91 | 5.20 ± 6.48 | 1.32 ± 3.91 | -8.23 ± 8.11 |
| | 12/13/2022 | -0.76 ± 3.20 | 0.11 ± 3.49 | -0.20 ± 6.94 | 0.78 ± 4.33 | -1.21 ± 7.34 |
| | | Nb-95 | Zr-95 | I-131 | Cs-134 | Cs-137 |
| | 3/1/2022 | 3.35 ± 3.43 | 2.67 ± 6.29 | -0.56 ± 0.44 | 1.85 ± 3.51 | -2.11 ± 3.45 |
| | 6/15/2022 | 1.41 ± 2.88 | -0.63 ± 4.88 | 0.01 ± 0.49 | 0.33 ± 3.66 | 1.39 ± 3.07 |
| | 9/13/2022 | -0.19 ± 3.54 | 2.18 ± 5.72 | 0.71 ± 0.59 A | 0.15 ± 4.22 | 3.73 ± 3.30 A |
| | 12/13/2022 | 0.58 ± 3.16 | -0.14 ± 6.04 | -0.03 ± 0.47 | -0.92 ± 3.39 | -2.63 ± 3.44 |
| | | Ba-140 | La-140 | H-3 | | |
| | 3/1/2022 | -8.36 ± 13.8 | 0.58 ± 4.30 | 102 ± 583 | | |
| | 6/15/2022 | 6.65 ± 11.7 | 0.37 ± 3.18 | 343 ± 572 | | |
| | 9/13/2022 | 11.4 ± 15.2 | 0.95 ± 4.41 | 6.36 ± 554 | | |
| | 12/13/2022 | -2.81 ± 10.1 | -0.47 ± 5.58 | 25.3 ± 626 | | |
| | HIR | | Mn-54 | Co-58 | Fe-59 | Co-60 |
| 3/1/2022 | | 1.74 ± 3.17 | 0.95 ± 2.68 | -4.95 ± 6.69 | 0.29 ± 3.51 | -0.75 ± 7.40 |
| 6/15/2022 | | -1.65 ± 3.41 | 1.70 ± 2.82 | -1.48 ± 5.52 | 6.25 ± 3.57 A | -5.82 ± 6.89 |
| 9/13/2022 | | 1.79 ± 3.68 | -3.23 ± 3.31 | 1.93 ± 9.63 | 0.19 ± 3.38 | 1.67 ± 7.81 |
| 12/13/2022 | | 1.58 ± 3.92 | -0.96 ± 3.67 | 0.27 ± 6.62 | -1.33 ± 3.39 | 0.43 ± 9.42 |
| | | Nb-95 | Zr-95 | I-131 | Cs-134 | Cs-137 |
| 3/1/2022 | | 0.08 ± 2.96 | 2.47 ± 5.60 | -0.29 ± 0.46 | -0.79 ± 3.53 | -0.05 ± 3.36 |
| 6/15/2022 | | 1.32 ± 3.05 | 6.05 ± 4.43 A | 0.31 ± 0.49 | 2.00 ± 3.70 | 0.47 ± 2.82 |
| 9/13/2022 | | -1.03 ± 3.78 | -1.21 ± 5.50 | 0.07 ± 0.51 | 1.52 ± 3.63 | -0.34 ± 4.09 |
| 12/13/2022 | | 0.56 ± 3.78 | 1.44 ± 5.90 | 0.61 ± 0.56 A | 1.24 ± 3.08 | -0.16 ± 3.68 |
| | | Ba-140 | La-140 | H-3 | | |
| 3/1/2022 | | 7.08 ± 12.4 | 2.49 ± 4.08 | 210 ± 590 | | |
| 6/15/2022 | | 0.42 ± 10.9 | -1.48 ± 3.71 | 190 ± 560 | | |
| 9/13/2022 | | 9.44 ± 16.8 | -0.02 ± 4.47 | 57.2 ± 558 | | |
| 12/13/2022 | | 13.7 ± 15.3 | -5.32 ± 4.55 | -253 ± 607 | | |
| TC | | | Mn-54 | Co-58 | Fe-59 | Co-60 |
| | 3/1/2022 | 0.25 ± 3.14 | 0.07 ± 3.10 | 1.18 ± 6.24 | -1.91 ± 3.30 | -9.52 ± 7.02 |
| | 6/15/2022 | 0.55 ± 3.25 | -0.71 ± 3.87 | 2.39 ± 8.24 | 3.65 ± 4.29 | -6.07 ± 8.89 |
| | 9/13/2022 | 0.13 ± 3.65 | -1.48 ± 3.69 | 1.09 ± 6.54 | 3.11 ± 4.24 | -14.3 ± 7.95 |
| | 12/13/2022 | 0.45 ± 4.00 | 0.33 ± 3.86 | 5.07 ± 8.54 | -0.01 ± 3.27 | -7.43 ± 9.77 |
| | | Nb-95 | Zr-95 | I-131 | Cs-134 | Cs-137 |
| | 3/1/2022 | -2.21 ± 3.06 | 2.10 ± 5.40 | 0.17 ± 0.51 | 1.52 ± 3.70 | -0.89 ± 3.25 |
| | 6/15/2022 | 2.98 ± 3.17 | -0.21 ± 5.56 | 0.28 ± 0.56 | -1.35 ± 3.91 | -3.93 ± 3.67 |
| | 9/13/2022 | 1.13 ± 3.77 | -1.27 ± 6.41 | 0.63 ± 0.50 A | -0.11 ± 4.03 | -3.20 ± 4.03 |
| | 12/13/2022 | 4.68 ± 4.12 A | -3.61 ± 7.12 | 0.44 ± 0.49 | -3.94 ± 3.92 | 1.92 ± 4.11 |
| | | Ba-140 | La-140 | H-3 | | |
| | 3/1/2022 | 9.90 ± 12.6 | 0.44 ± 3.74 | 76.2 ± 580 | | |
| | 6/15/2022 | 8.52 ± 13.2 | -1.73 ± 4.15 | 12.7 ± 547 | | |
| | 9/13/2022 | -5.09 ± 15.0 | 1.08 ± 5.09 | -38.2 ± 551 | | |
| | 12/13/2022 | 0.02 ± 15.2 | 2.16 ± 4.98 | 133 ± 633 | | |

A= <MDC

**TABLE 3-9
 RIVER WATER
 GAMMA EMITTER AND TRITIUM CONCENTRATIONS
 (pCi/Liter ± 2 Sigma)**

| SAMPLING LOCATIONS | COLLECTION DATE | NUCLIDE | | | | | |
|--------------------|-----------------|--------------|--------------|--------------|---------------|--------------|---------------|
| | | Mn-54 | Co-58 | Fe-59 | Co-60 | Zn-65 | |
| SD | 1/4/2022 | 0.80 ± 2.69 | -1.11 ± 2.60 | -1.24 ± 3.61 | -2.57 ± 2.64 | -0.28 ± 4.38 | |
| | 2/1/2022 | -0.95 ± 2.61 | 2.16 ± 3.24 | 0.01 ± 5.76 | -1.70 ± 3.31 | -11.8 ± 8.65 | |
| | 3/1/2022 | -4.95 ± 4.67 | 0.77 ± 4.55 | -2.85 ± 6.75 | -0.53 ± 3.41 | -12.9 ± 11.2 | |
| | 4/5/2022 | 0.33 ± 1.92 | 0.41 ± 2.04 | 1.00 ± 4.01 | -1.62 ± 2.10 | 0.07 ± 3.86 | |
| | 5/3/2022 | -0.32 ± 3.50 | -0.39 ± 3.14 | 0.54 ± 7.71 | -1.87 ± 3.95 | -7.77 ± 9.29 | |
| | 6/7/2022 | 0.82 ± 3.61 | -1.49 ± 3.53 | -0.75 ± 6.50 | 0.62 ± 4.08 | -11.6 ± 8.69 | |
| | 7/12/2022 | -0.81 ± 3.19 | 0.33 ± 3.37 | -0.29 ± 8.27 | 2.35 ± 4.50 | -2.00 ± 7.87 | |
| | 8/2/2022 | -1.08 ± 2.40 | -0.31 ± 2.56 | -3.06 ± 5.15 | 1.07 ± 2.80 | -6.29 ± 6.11 | |
| | 9/6/2022 | 0.94 ± 2.97 | -1.90 ± 3.09 | 1.71 ± 6.91 | 1.56 ± 3.04 | -2.64 ± 8.21 | |
| | 10/11/2022 | -0.33 ± 1.49 | 0.89 ± 1.51 | -0.04 ± 2.97 | 0.40 ± 1.56 | -6.08 ± 3.24 | |
| | 11/1/2022 | -0.10 ± 3.16 | -1.72 ± 2.84 | 3.40 ± 7.66 | 3.55 ± 3.23 A | -15.9 ± 8.26 | |
| | 12/6/2022 | 0.48 ± 3.90 | -0.31 ± 4.01 | -4.34 ± 8.85 | -4.33 ± 4.61 | -3.41 ± 11.0 | |
| | | | Nb-95 | Zr-95 | I-131 | Cs-134 | Cs-137 |
| | | 1/4/2022 | 0.82 ± 1.83 | 0.13 ± 4.07 | 2.76 ± 4.07 | 1.33 ± 2.73 | 2.98 ± 2.86 A |
| | 2/1/2022 | -1.02 ± 3.58 | -3.04 ± 4.69 | -2.65 ± 3.64 | 1.48 ± 3.19 | 2.67 ± 3.17 | |
| | 3/1/2022 | 0.14 ± 3.99 | 1.50 ± 7.07 | 1.42 ± 5.00 | 0.99 ± 4.26 | -1.06 ± 4.81 | |
| | 4/5/2022 | -0.32 ± 1.83 | 1.18 ± 3.14 | -0.62 ± 2.82 | 0.36 ± 2.14 | -0.04 ± 2.14 | |
| | 5/3/2022 | -1.53 ± 4.28 | -3.80 ± 6.87 | 0.02 ± 4.14 | -3.50 ± 4.81 | -0.14 ± 3.65 | |
| | 6/7/2022 | -0.89 ± 3.99 | 0.89 ± 6.95 | -2.64 ± 5.74 | -2.81 ± 4.40 | -2.44 ± 2.98 | |
| | 7/12/2022 | -1.33 ± 3.74 | 4.99 ± 6.02 | 2.56 ± 5.36 | -2.84 ± 3.87 | -0.05 ± 3.73 | |
| | 8/2/2022 | -0.25 ± 2.63 | -4.07 ± 5.34 | -0.80 ± 4.45 | 0.88 ± 2.94 | 0.27 ± 2.75 | |
| | 9/6/2022 | 1.58 ± 3.41 | 1.97 ± 5.61 | 0.05 ± 5.70 | -0.55 ± 3.48 | -0.51 ± 3.73 | |
| | 10/11/2022 | 0.81 ± 1.54 | -1.29 ± 2.55 | 0.84 ± 2.03 | 0.65 ± 1.76 | 1.32 ± 1.55 | |
| | 11/1/2022 | 0.84 ± 3.64 | -1.48 ± 5.68 | -3.68 ± 4.97 | 2.71 ± 3.44 | 1.55 ± 3.10 | |
| | 12/6/2022 | 0.65 ± 4.20 | -0.89 ± 6.23 | -0.58 ± 5.21 | -2.98 ± 4.44 | -0.39 ± 4.86 | |
| | | Ba-140 | La-140 | H-3 | K-40 | | |
| | 1/4/2022 | -1.23 ± 12.7 | 0.52 ± 3.69 | | 142 ± 58.3 | | |
| | 2/1/2022 | -7.26 ± 13.4 | -2.59 ± 4.45 | | | | |
| | 3/1/2022 | -6.71 ± 14.1 | -0.04 ± 3.66 | 180 ± 594 | | | |
| | 4/5/2022 | 2.17 ± 8.42 | -0.30 ± 2.67 | | | | |
| | 5/3/2022 | 7.65 ± 14.1 | -1.89 ± 5.51 | | | | |
| | 6/7/2022 | -13.5 ± 16.3 | 2.59 ± 5.72 | -103 ± 605 | | | |
| | 7/12/2022 | -0.35 ± 15.6 | 0.82 ± 6.67 | | 168 ± 90.7 | | |
| | 8/2/2022 | 1.23 ± 12.6 | -1.39 ± 4.06 | | 120 ± 59.5 | | |
| | 9/6/2022 | -0.33 ± 15.8 | -6.61 ± 5.30 | -212 ± 558 | 179 ± 75.8 | | |
| | 10/11/2022 | 0.42 ± 6.37 | -0.56 ± 2.03 | | 137 ± 39.5 | | |
| | 11/1/2022 | -2.90 ± 14.9 | -0.61 ± 5.47 | | 246 ± 76.8 | | |
| | 12/6/2022 | -4.71 ± 17.2 | -0.63 ± 5.01 | 230 ± 621 | 87.5 ± 83.9 | | |

A= <MDC

**TABLE 3-9
 RIVER WATER
 GAMMA EMITTER AND TRITIUM CONCENTRATIONS
 (pCi/Liter ± 2 Sigma)**

| SAMPLING LOCATIONS | COLLECTION DATE | NUCLIDE | | | | |
|--------------------|-----------------|---------------|--------------|--------------|---------------|--------------|
| | | Mn-54 | Co-58 | Fe-59 | Co-60 | Zn-65 |
| SW-C | 1/4/2022 | 0.78 ± 3.18 | 2.37 ± 3.42 | -0.33 ± 7.30 | 1.85 ± 3.16 | -2.98 ± 6.84 |
| | 2/1/2022 | 0.53 ± 3.30 | -1.75 ± 3.04 | -6.69 ± 6.76 | -2.51 ± 3.51 | -3.37 ± 6.45 |
| | 3/1/2022 | -0.21 ± 3.48 | -3.85 ± 3.99 | -3.07 ± 9.00 | -1.17 ± 4.33 | -3.85 ± 11.0 |
| | 4/5/2022 | -1.08 ± 2.63 | -0.26 ± 2.68 | -0.96 ± 5.62 | 1.48 ± 2.78 | -2.20 ± 5.37 |
| | 5/3/2022 | 0.90 ± 3.25 | 1.60 ± 3.54 | 0.89 ± 6.96 | -0.79 ± 3.94 | -5.46 ± 7.82 |
| | 6/7/2022 | -0.12 ± 3.10 | 1.43 ± 3.46 | 0.21 ± 6.57 | -0.57 ± 4.10 | -4.45 ± 7.03 |
| | 7/12/2022 | 1.50 ± 3.13 | 0.66 ± 2.74 | -3.87 ± 5.17 | 2.51 ± 3.97 | -6.19 ± 6.29 |
| | 8/2/2022 | -1.14 ± 2.71 | 0.15 ± 2.52 | 0.77 ± 5.47 | 2.74 ± 2.98 | 1.40 ± 6.17 |
| | 9/6/2022 | 1.43 ± 3.45 | -0.70 ± 3.15 | 0.80 ± 7.45 | 0.38 ± 4.10 | 0.68 ± 7.20 |
| | 10/11/2022 | -0.23 ± 1.35 | 0.95 ± 1.33 | -0.02 ± 2.71 | 0.10 ± 1.48 | -1.91 ± 2.81 |
| | 11/1/2022 | 2.37 ± 2.97 | 1.37 ± 3.20 | -1.49 ± 6.44 | 4.82 ± 3.62 A | -10.9 ± 8.28 |
| | 12/6/2022 | 1.48 ± 3.98 | 1.04 ± 3.43 | 2.62 ± 7.84 | 0.82 ± 3.54 | -6.15 ± 9.71 |
| | | Nb-95 | Zr-95 | I-131 | Cs-134 | Cs-137 |
| | 1/4/2022 | 2.54 ± 3.81 | 2.93 ± 6.20 | 0.02 ± 5.63 | -5.27 ± 3.84 | 2.45 ± 3.67 |
| | 2/1/2022 | -0.34 ± 2.99 | 4.24 ± 5.77 | 0.07 ± 3.49 | 1.03 ± 4.00 | -2.49 ± 3.43 |
| | 3/1/2022 | -1.32 ± 3.79 | 4.83 ± 6.92 | -1.90 ± 4.12 | -2.32 ± 4.17 | -0.21 ± 3.38 |
| | 4/5/2022 | 1.66 ± 2.77 | -1.02 ± 5.09 | -0.51 ± 4.36 | -0.04 ± 2.87 | -1.05 ± 2.60 |
| | 5/3/2022 | 0.00 ± 0.00 | -1.20 ± 6.13 | 0.91 ± 3.77 | -0.19 ± 3.74 | -1.84 ± 3.74 |
| | 6/7/2022 | -1.04 ± 3.40 | 0.89 ± 6.16 | -0.41 ± 5.25 | 0.35 ± 3.91 | 1.97 ± 3.27 |
| | 7/12/2022 | -0.69 ± 3.57 | 1.34 ± 6.23 | -1.69 ± 5.34 | -0.31 ± 3.65 | 3.18 ± 3.57 |
| | 8/2/2022 | 0.03 ± 3.16 | -1.00 ± 5.05 | -0.79 ± 4.68 | -1.57 ± 2.99 | 1.03 ± 2.98 |
| | 9/6/2022 | -2.86 ± 3.18 | -1.67 ± 6.42 | 1.85 ± 5.23 | -1.76 ± 3.20 | -1.22 ± 3.11 |
| | 10/11/2022 | 0.37 ± 1.36 | 0.16 ± 2.24 | -0.28 ± 1.64 | 1.21 ± 1.40 | -0.14 ± 1.28 |
| | 11/1/2022 | -0.01 ± 3.72 | -6.01 ± 5.61 | 3.07 ± 4.36 | 1.93 ± 3.28 | -2.08 ± 3.53 |
| | 12/6/2022 | -1.44 ± 3.43 | 4.97 ± 6.95 | 0.55 ± 3.98 | 0.64 ± 3.30 | 0.59 ± 3.67 |
| | | Ba-140 | La-140 | H-3 | K-40 | |
| | 1/4/2022 | 5.33 ± 15.7 | 0.47 ± 4.58 | | | |
| | 2/1/2022 | 0.76 ± 12.8 | 0.02 ± 4.40 | | | |
| | 3/1/2022 | 16.4 ± 14.0 A | 2.08 ± 4.57 | -96.1 ± 572 | | |
| | 4/5/2022 | 9.88 ± 13.3 | 1.16 ± 4.41 | | | |
| | 5/3/2022 | 2.42 ± 13.5 | 0.70 ± 5.31 | | | |
| | 6/7/2022 | -0.63 ± 16.2 | -2.25 ± 4.44 | -199 ± 598 | | |
| | 7/12/2022 | -6.60 ± 14.4 | 3.15 ± 5.40 | | | |
| | 8/2/2022 | 0.35 ± 11.1 | 2.33 ± 4.75 | | 60.7 ± 58.0 | |
| | 9/6/2022 | -4.02 ± 14.0 | -0.69 ± 5.23 | 109 ± 582 | | |
| | 10/11/2022 | -4.11 ± 5.13 | -0.03 ± 1.71 | | 84.6 ± 29.1 | |
| | 11/1/2022 | -1.80 ± 14.7 | -0.61 ± 5.00 | | | |
| | 12/6/2022 | 0.70 ± 14.1 | 0.59 ± 5.08 | 378 ± 612 | | |

A= <MDC

TABLE 3-10
SEDIMENT SILT
GAMMA EMITTER CONCENTRATIONS
 (pCi/kg (dry) ± 2 Sigma)

| SAMPLING LOCATIONS | COLLECTION DATE | NUCLIDE | | | |
|--------------------|-----------------|---------------|---------------|---------------|---------------|
| | | Cs-134 | Cs-137 | K-40 | Th-228 |
| SD | 3/2/2022 | 46.1 ± 48.5 | 105 ± 54.2 A | 14260 ± 1792 | 1273 ± 149 |
| | 9/28/2022 | 34.0 ± 35.8 | 96.1 ± 50.7 | 13790 ± 1169 | 999 ± 86.2 |
| | | Th-232 | Ra-226 | Be-7 | Ac-228 |
| | 3/2/2022 | 1178 ± 238 | 2731 ± 1463 | | 903 ± 537 |
| | 9/28/2022 | 931 ± 149 | 1126 ± 1067 | 1050 ± 366 | 706 ± 351 |
| | | | | | |
| SI | 3/2/2022 | 6.95 ± 47.2 | 123 ± 94.7 | 18520 ± 1653 | 1265 ± 156 |
| | 9/27/2022 | 18.0 ± 38.9 | 80.8 ± 40.0 B | 10410 ± 1079 | 721 ± 106 |
| | | Th-232 | Ra-226 | | |
| | 3/2/2022 | 1308 ± 179 | 2432 ± 1369 | | |
| | 9/27/2022 | 787 ± 137 | 2045 ± 1216 | | |
| | | | | | |
| CHIC-C | 3/11/2022 | 88.5 ± 69.7 A | 48.1 ± 68.7 | 17060 ± 2058 | 1433 ± 167 |
| | 9/28/2022 | 58.3 ± 34.3 A | 46.0 ± 33.4 A | 12380 ± 927 | 979 ± 69.2 |
| | | Th-232 | Ra-226 | Ac-228 | |
| | 3/11/2022 | 1353 ± 277 | 3317 ± 1465 | 1315 ± 305 | |
| | 9/28/2022 | 810 ± 159 | 2304 ± 932 | 966 ± 176 | |
| | | | | | |

A= <MDC

B= The analyte was not detected. Peak not identified, but forced activity concentration exceeds MDC and 2 sigma.

TABLE 3-11
SHORELINE SEDIMENT
GAMMA EMITTER CONCENTRATIONS
 (pCi/kg (dry) ± 2 Sigma)

| SAMPLING LOCATIONS | COLLECTION DATE | NUCLIDE | | | | |
|--------------------|-----------------|---------------|---------------|-------------|---------------|---------------|
| | | <u>Cs-134</u> | <u>Cs-137</u> | <u>K-40</u> | <u>Th-228</u> | <u>Th-232</u> |
| HIR | 2/8/2022 | 11.2 ± 22.5 | -16.0 ± 21.2 | 6690 ± 806 | 73.6 ± 43.4 | |
| | 8/9/2022 | 18.6 ± 21.7 | -2.02 ± 19.0 | 6036 ± 682 | 254 ± 67.2 | 244 ± 77 |
| CHIC-C | 2/8/2022 | 11.4 ± 26.8 | 8.97 ± 21.7 | 2439 ± 613 | 109 ± 49.2 | |
| | 8/9/2022 | -22.0 ± 23.9 | 7.91 ± 22.2 | 1620 ± 508 | 97.9 ± 56.7 | |

TABLE 3-12
FISH
GAMMA EMITTER CONCENTRATIONS
(pCi/kg (wet) ± 2 Sigma)

| SAMPLING LOCATION | COLLECTION DATE | FISH TYPE | NUCLIDE | | | | |
|-------------------|-----------------|-------------|--------------|--------------|----------------------|-------------------|------|
| | | | Mn-54 | Co-58 | Fe-59 | Co-60 | |
| SD | 4/21/2022 | Catfish | -0.79 ± 22.7 | 3.43 ± 25.1 | -15.1 ± 50.5 | 18.3 ± 27.9 | |
| | 4/21/2022 | Gamefish | -12.3 ± 26.1 | -38.9 ± 28.1 | -15.3 ± 46.2 | 0.67 ± 30.0 | |
| | 10/12/2022 | Catfish | 7.55 ± 49.9 | -29.0 ± 56.5 | -33.7 ± 142 | 31.3 ± 56.3 | |
| | 10/12/2022 | Gamefish | 26.9 ± 40.0 | -12.4 ± 59.1 | -97.5 ± 113 | 22.3 ± 53.3 | |
| | | | | Zn-65 | Cs-134 | Cs-137 | K-40 |
| | 4/21/2022 | Catfish | 6.26 ± 60.2 | 8.00 ± 26.8 | 20.0 ± 26.9 | 1610 ± 589 | |
| | 4/21/2022 | Gamefish | -14.7 ± 53.7 | -11.0 ± 28.3 | -1.82 ± 27.4 | 1919 ± 596 | |
| | 10/12/2022 | Catfish | -97.5 ± 124 | 14.3 ± 51.7 | 65.3 ± 45.2 A | 2585 ± 888 | |
| 10/12/2022 | Gamefish | -99.0 ± 111 | 21.9 ± 48.3 | 25.7 ± 37.1 | 2052 ± 1087 | | |

A= <MDC

TABLE 3-13
OYSTERS
GAMMA EMITTER CONCENTRATIONS
(pCi/kg (wet) ± 2 Sigma)

| SAMPLING LOCATIONS | COLLECTION DATE | NUCLIDE | | | |
|--------------------|-----------------|------------------------------|-------------------------------|-------------------------------|---------------------------------|
| POS | 3/8/2022 | Mn-54 7.50 ± 14.1 | Co-58 1.37 ± 15.8 | Fe-59 -3.31 ± 38.0 | Co-60 11.8 ± 14.4 |
| | 9/27/2022 | -1.95 ± 20.0 | -9.02 ± 21.4 | 9.52 ± 46.4 | 35.6 ± 19.6 A |
| | 3/8/2022 | Zn-65 -35.2 ± 34.5 | Cs-134 -4.56 ± 14.8 | Cs-137 11.5 ± 14.9 | K-40 303 ± 266 |
| | 9/27/2022 | -38.0 ± 44.2 | 1.36 ± 22.1 | 11.5 ± 20.1 | |
| | 3/8/2022 | Mn-54 -11.7 ± 16.1 | Co-58 13.0 ± 20.1 | Fe-59 10.4 ± 48.0 | Co-60 3.80 ± 17.0 |
| | 9/27/2022 | -2.32 ± 16.7 | -8.87 ± 18.2 | 6.60 ± 42.0 | 4.47 ± 17.7 |
| MP | 3/8/2022 | Zn-65 -6.06 ± 37.2 | Cs-134 0.07 ± 17.6 | Cs-137 -13.4 ± 16.5 | |
| | 9/27/2022 | 2.81 ± 41.1 | 3.39 ± 15.8 | -3.60 ± 18.1 | |
| | 3/8/2022 | Mn-54 3.01 ± 16.3 | Co-58 2.89 ± 19.5 | Fe-59 -8.99 ± 46.9 | Co-60 -6.75 ± 16.3 |
| | 9/28/2022 | -19.7 ± 15.4 | -3.96 ± 16.9 | 15.4 ± 39.8 | -20.2 ± 19.4 |
| | 3/8/2022 | Zn-65 -65.9 ± 41.7 | Cs-134 -1.59 ± 16.2 | Cs-137 -11.0 ± 16.6 | K-40 430 ± 241 |
| | 9/28/2022 | -12.9 ± 35.3 | 17.1 ± 17.1 | 3.96 ± 17.2 | |
| SHI | | | | | |

A= <MDC

TABLE 3-14
CLAMS
GAMMA EMITTER CONCENTRATIONS
(pCi/kg (wet) ± 2 Sigma)

| SAMPLING LOCATIONS | COLLECTION DATE | NUCLIDE | | | |
|--------------------|-----------------|------------------------------|-------------------------------|-------------------------------|------------------------------|
| JI | 3/1/2022 | <u>Mn-54</u> 10.2 ± 17.2 | <u>Co-58</u> -13.5 ± 20.2 | <u>Fe-59</u> 38.4 ± 47.1 | <u>Co-60</u> -5.99 ± 15.8 |
| | 9/28/2022 | -3.60 ± 22.3 | -3.20 ± 24.0 | -19.1 ± 54.5 | 5.69 ± 20.5 |
| | 3/1/2022 | <u>Zn-65</u> 2.71 ± 36.6 | <u>Cs-134</u> 3.16 ± 17.9 | <u>Cs-137</u> -0.41 ± 16.0 | <u>K-40</u> |
| | 9/28/2022 | -36.8 ± 49.3 | -12.7 ± 22.8 | 3.31 ± 22.5 | 515 ± 481 |
| | 3/2/2022 | <u>Mn-54</u> -5.55 ± 13.0 | <u>Co-58</u> -18.6 ± 16.1 | <u>Fe-59</u> 1.07 ± 38.0 | <u>Co-60</u> -4.73 ± 14.0 |
| | 9/28/2022 | 4.46 ± 36.0 | -18.6 ± 36.1 | 30.7 ± 74.7 | -9.06 ± 28.8 |
| SD | 3/2/2022 | <u>Zn-65</u> -27.9 ± 31.5 | <u>Cs-134</u> -2.97 ± 15.1 | <u>Cs-137</u> -1.35 ± 13.6 | <u>K-40</u> 324 ± 275 |
| | 9/28/2022 | -55.4 ± 67.6 | 7.52 ± 32.2 | 15.5 ± 30.9 | |
| | 3/11/2022 | <u>Mn-54</u> 0.62 ± 17.8 | <u>Co-58</u> -24.5 ± 19.1 | <u>Fe-59</u> -7.17 ± 35.4 | <u>Co-60</u> -2.45 ± 14.8 |
| | 9/28/2022 | 20.6 ± 25.4 | 21.2 ± 31.6 | -39.8 ± 43.4 | 8.12 ± 32.7 |
| CHIC-C | 3/11/2022 | <u>Zn-65</u> -58.9 ± 36.1 | <u>Cs-134</u> 7.84 ± 15.9 | <u>Cs-137</u> -9.25 ± 15.9 | <u>K-40</u> 414 ± 349 |
| | 9/28/2022 | -5.10 ± 64.6 | -0.98 ± 29.6 | -11.4 ± 33.8 | |

TABLE 3-15
CRABS
GAMMA EMITTER CONCENTRATIONS
 (pCi/kg (wet) ± 2 Sigma)

| SAMPLING LOCATIONS | COLLECTION DATE | NUCLIDE | | | |
|--------------------|-----------------|------------------------------|-------------------------------|-------------------------------|------------------------------|
| SD | 6/15/2022 | <u>Mn-54</u> 8.22 ± 36.6 | <u>Co-58</u> -13.7 ± 37.8 | <u>Fe-59</u> 2.64 ± 78.9 | <u>Co-60</u> -1.04 ± 32.7 |
| | 6/15/2022 | <u>Zn-65</u> -85.6 ± 57.5 | <u>Cs-134</u> -0.35 ± 38.8 | <u>Cs-137</u> -15.6 ± 31.4 | <u>K-40</u> 1097 ± 616 |

4. DISCUSSION OF RESULTS

Data from the radiological analyses of environmental media collected during 2022 and tabulated in Section 3, are discussed below. The procedures and specifications followed in the laboratory for these analyses are as required in the Teledyne Brown Engineering quality assurance manuals and laboratory procedures. In addition to internal quality control measures performed by the laboratories, they also participate in an Interlaboratory Comparison Program. Participation in this program ensures that independent checks on the precision and accuracy of the measurements of radioactive material in environmental samples are performed. The results of the Interlaboratory Comparison Program are provided in Appendix B.

The predominant radioactivity detected throughout 2022 was from external sources, such as fallout from nuclear weapons tests (cesium-137) and naturally occurring radionuclides. Naturally occurring nuclides, such as beryllium-7, radium-226, actinium-228, thorium-228, thorium-232 and potassium-40, were detected in numerous samples.

The following is a discussion and summary of the results of the environmental measurements taken during the 2022 reporting period.

4.1 Gamma Exposure Rate

A thermoluminescent dosimeter (TLD) is an inorganic crystal used to detect ambient radiation. These TLDs are made of CaF and LiF compounds and are specifically designed for environmental monitoring. Three TLDs are deployed at each sampling location. TLDs are placed in two concentric rings around the station. The inner ring is in the vicinity of the site boundary, and the outer ring is located at approximately five miles from the station. TLDs are also placed in special interest areas, such as population centers and nearby residences. Additional TLDs serve as controls. Ambient radiation comes from naturally occurring radioisotopes in the air and soil, radiation from cosmic origin, fallout from nuclear weapons testing, station effluents and direct radiation from the station.


The results of the TLD analyses are presented in Table 3-2. There was no detectable external dose to members of the public from Surry Power Station in 2022. The results of the TLD analyses shown in Table 3-2 comply with Section 7 of ANSI/HPS N13.37-2014 to ensure accurate environmental results. The long-term integrity of each field monitoring location is accomplished by a thorough, documented evaluation of the location for changes that could impact data quality in accordance with Section 7.1 of the ANSI Standard. Since off-site processing of TLDs is used, extraneous dose received prior to and after removal from the field is quantified in compliance with Section 7.2 of the ANSI Standard. Data analysis for Table 3-2 was performed in accordance with Section 7.3 of the ANSI Standard. This includes normalizing results to a standard 91-day quarterly monitoring period, determination of the baseline background dose for each monitoring location and determination of the smallest facility-related dose that can be detected above the baseline background.

4.2 Airborne Gross Beta


Air is continuously sampled by passing through glass fiber particulate filters. The filters collect airborne particulate radionuclides. These samples are collected weekly and analyzed for gross beta activity. Results of the weekly gross beta analyses are presented in Table 3-3. The analysis results from the control and indicator locations continue to show no significant variation in measured activities. Refer to Figures 4.1 and 4.2 for details. Data presented in these figures indicate that any contribution from station related activities is not measurable.

Gross beta activity found during the pre-operational and early operating period of Surry Power Station was higher because of nuclear weapons testing. During that time, nearly 740 nuclear weapons were tested worldwide. In 1985 weapons testing ceased, and except for the Chernobyl accident in 1986, airborne gross beta results have remained steady.

**Figure 4-1:
2022 GROSS BETA IN AIR PARTICULATES**

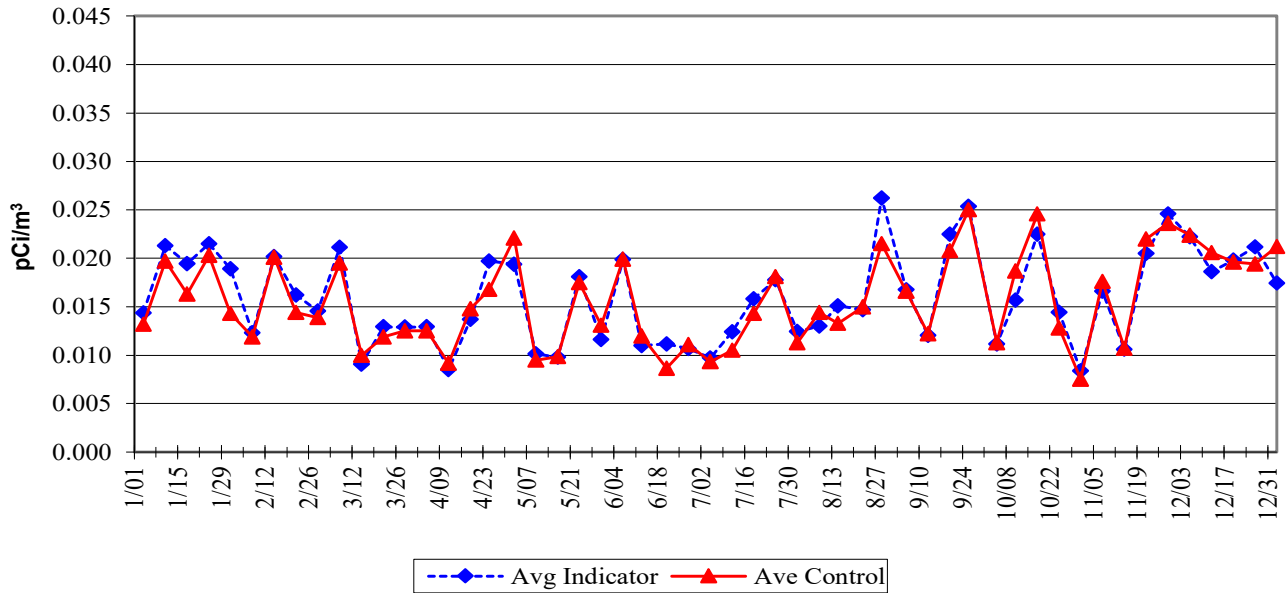

**Figure 4-2:
GROSS BETA IN AIR PARTICULATES
10 YEAR HISTORICAL TREND**

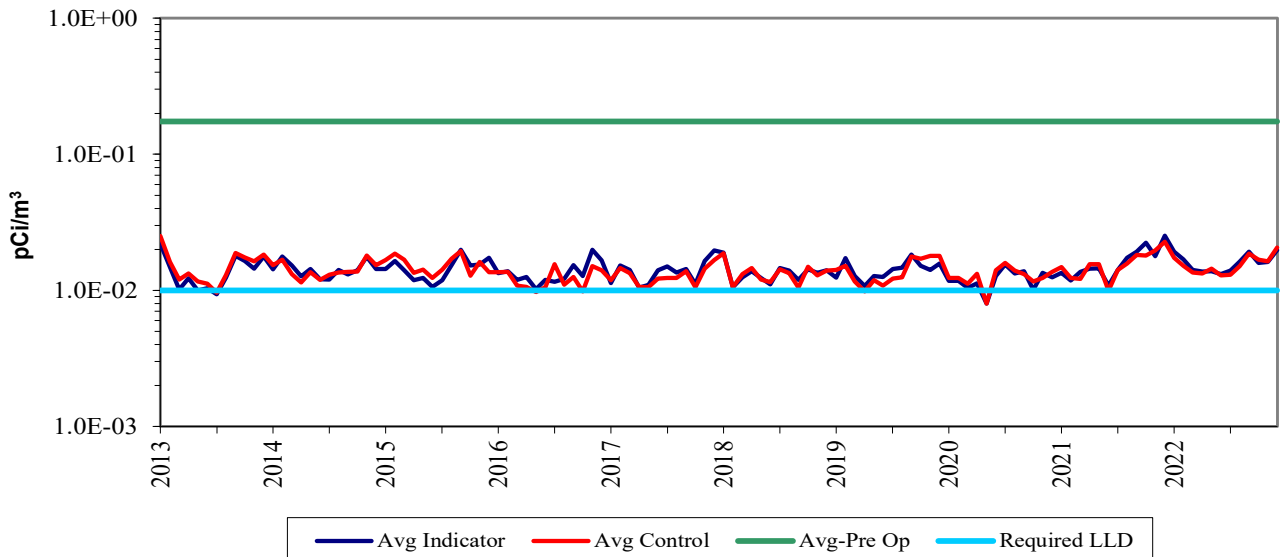

4.3 Airborne Radioiodine

Air is also continuously sampled for radioiodine by passing air through a charcoal cartridge. Weekly, the charcoal cartridge samples are collected and analyzed. The results of the analyses are presented in Table 3-4. All results are below the lower limit of detection. No positive iodine-131 was detected in air samples in 2022.

4.4 Air Particulate Gamma

The air particulate filters from the weekly gross beta analyses are composited by location and analyzed quarterly by gamma spectroscopy. The analysis results are listed in Table 3-5. The results indicate the presence of naturally occurring beryllium-7, which is produced by cosmic processes. No man-made radionuclides were identified. These analyses confirm there are no effects from station effluents.

4.5 Animal Milk

Analysis of milk samples is generally the most sensitive indicator of fission product existence in the terrestrial environment. This, in combination with the significant human consumption of milk, results in this pathway often being the most critical as it relates to station radiological effluents. This pathway also shows measurable amounts of nuclear weapons testing fallout. Therefore, this media needs to be carefully evaluated when determining the effects from station effluents.

Results of gamma spectroscopy indicate no detectable station related radioactivity was identified in milk samples in 2022. Only naturally occurring potassium-40 was detected. The analysis results are presented in Table 3-6.

At the request of the Commonwealth of Virginia, a quarterly composite sample is prepared from the monthly milk samples from the Colonial Parkway collection station. The composite samples are analyzed for strontium-89 and strontium-90. Strontium-89 was not detected in the four composite samples analyzed. Strontium-90 was detected in all four composite samples, with an average concentration of 1.73 pCi/L. Strontium-90 is not a component of station radiological effluents and is a product of nuclear weapons testing fallout.

4.6 Food Products

Three food product samples (corn, peanuts, and soybeans) were collected and analyzed by gamma spectroscopy. The analysis results are presented in Table 3-7. Only naturally occurring potassium-40 was detected in all samples. No station related radioactivity was detected in this pathway.

4.7 Well Water

Well water is not considered to be affected by station operations because there are no discharges made to this pathway. However, Surry Power Station monitors well water quarterly at three indicator locations. Well water samples are analyzed for gamma radiation and tritium. The results are presented in Table 3-8. No positive tritium or station related radioactivity was detected in 2022. Historically, during the pre-operational period, no gamma emitting isotopes were detected.

4.8 River Water

Samples of the James River water are collected monthly and the results are presented in Table 3-9. All samples are analyzed by gamma spectroscopy. The monthly samples are also composited and analyzed for tritium on a quarterly basis. No positive tritium or station related radioactivity was detected in this pathway in 2022. Only naturally occurring potassium-40 was detected. No station related radioactivity was detected.

4.9 Silt

Silt is sampled to evaluate the buildup of radionuclides in the environment due to the operation of the station. Sampling of this pathway provides a good indication of the dispersion effects of effluents to the river. The accumulation of radionuclides in silt could indirectly increase the radioactivity levels in clams, oysters, crabs, and fish.


Samples of silt are collected from three locations: one upstream, one downstream of the station and one in the dredge area of the station intake. The station intake silt sample was added in 2017 to provide data for future station intake dredging operations. The results of the gamma spectroscopy analyses are presented in Table 3-10. Naturally occurring beryllium-7, potassium-40, radium-226, actinium-228, thorium-228, and thorium-232 were detected. Historically, cobalt-60 has been detected in samples obtained from the station discharge indicator location. Cobalt-60 has not been detected since 2003. A trend of cesium-137 and cobalt-60 concentrations is graphed and presented in Figures 4-3 and 4-4. For three decades, the general concentration for cesium-137 has continued to decrease. This trend is the calculated average of the semi-annual analysis results.

The presence of cesium-137 in indicator location, Station Intake, and control location, Chickahominy, is indicative of the accumulation, through runoff, of cesium-137 into the James River from residual weapons testing fallout. Samples collected from the James River, during the pre-operational period, indicated the presence of cesium-137. The pre-operational average cesium-137 concentration is indicated in Figure 4-4.

The Station Intake indicator sample was added to the REMP in 2017. The additional sample is collected in the dredge channel area at the station intake. The dredge channel is approximately 150' wide and 1750' in length. This location was added to support future station intake channel dredging operations. The trend of cesium-137 concentration in silt in the station intake dredge channel is procedurally monitored and evaluated.


The Station Intake dredge channel, with a cesium-137 concentration of 123 pCi/kg, was the highest indicator location for the silt pathway in 2022. This concentration remains consistent with aquatic sediment samples collected in control locations of the James River.

**Figure 4-3:
COBALT-60 IN SILT**

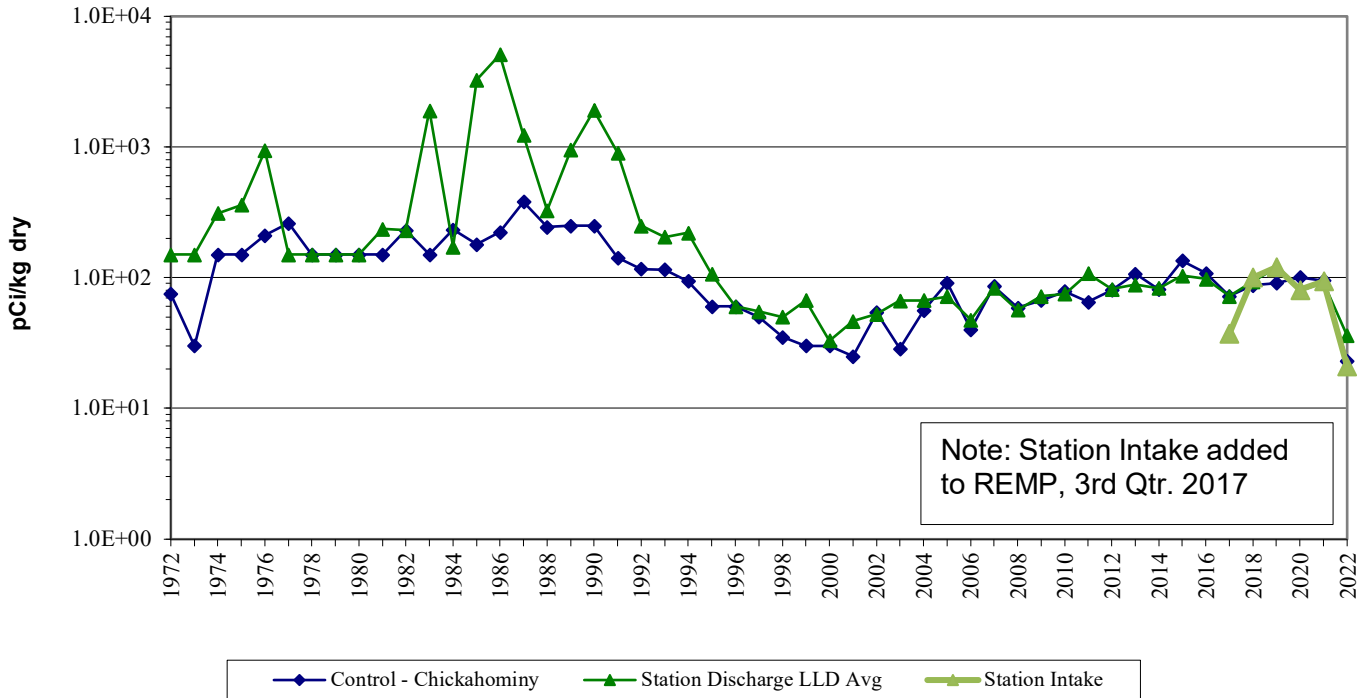

Chickahominy had detectable activity in 1982 and 1984 through 1994. Other years were less than minimum detectable activity (MDA). Station Discharge was <MDA activity 1996 through 1998 and 2004 through 2022.

**Figure 4-4:
CESIUM-137 IN SILT**

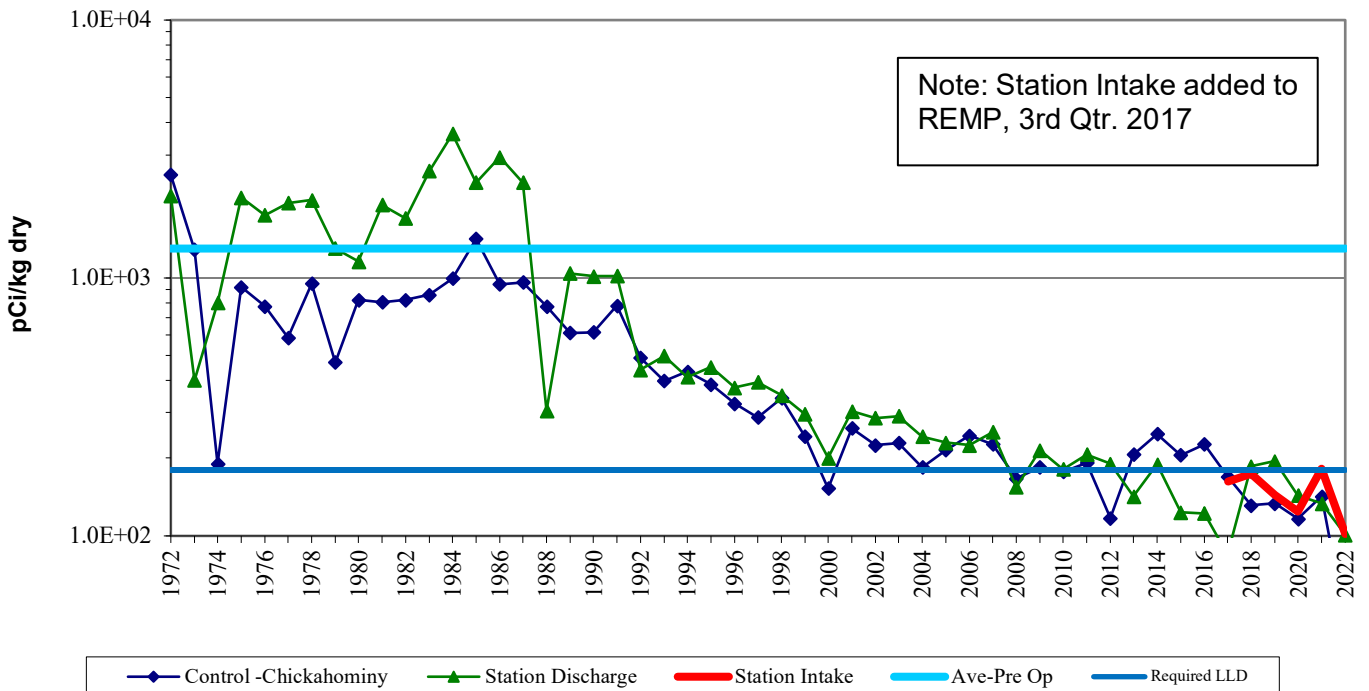

4.10 Shoreline Sediment

Shoreline sediment, unlike river silt, may provide a direct dose to humans. A buildup of radionuclides along the shoreline may provide a source of direct exposure for those utilizing the area for commercial and recreational uses. The analysis results for this pathway are presented in Table 3-11.

The naturally occurring radionuclides potassium-40, thorium-228, and thorium-232 were detected at concentrations equivalent to normal background activities. There were no radionuclides attributable to the operation of the station detected in shoreline sediment samples.

4.11 Fish

The radioactivity measured in fish sampled from the Station Discharge Canal and analyzed by gamma spectroscopy is presented in Table 3-12. The 2022 analysis results are similar to those seen over the last decade. Only naturally occurring potassium-40 was detected. No radionuclides attributable to the operation of the station were detected in fish samples.

4.12 Oysters

The results of the gamma spectroscopy analyses in oyster samples are presented in Table 3-13. No gamma emitting radionuclides attributable to the operation of the station were detected in oysters sampled in 2022. Only naturally occurring potassium-40 was detected. No station related radioactivity has been detected in this media since 1991.

4.13 Clams

The results of the gamma spectroscopy analyses in clam samples are presented in Table 3-14. No gamma emitting radionuclides attributable to the operation of the station were detected in clams sampled in 2022. Only naturally occurring potassium-40 was detected.

4.14 Crabs

The annual crab sample was collected from the Station Discharge and analyzed by gamma spectroscopy. The analysis results are presented in Table 3-15. Other than naturally occurring potassium-40, no other gamma emitting radionuclides related to station effluents were detected in this media. This is consistent with pre-operational data and data collected over the past decade.

5. PROGRAM EXCEPTIONS

There was one exception to the REMP sampling schedule in 2022.

The exception is detailed below:

1. Groundwater monitoring well, 1-PL-PIEZ-P29, was not sampled in accordance with the sampling frequency of the Groundwater Protection Program (HP-3051.020). A temporary fence line, to support a scheduled refueling outage, was assembled directly above the monitoring well location, rendering the well inaccessible. A condition report (CR1218426) was submitted to document the condition and track sample collection (CA11471265). Following the refueling outage, the temporary fence was removed. The sample for 1-PL-PIEZ-P29 was collected on 01-26-2023 and shipped offsite for analysis.

6. CONCLUSIONS

The 2022 Radiological Environmental Monitoring Program analysis results for Surry Power Station are recorded in Section 3 and discussed in Section 4 of this document. This section provides a conclusion of each listed pathway.

- **Direct Radiation Exposure Pathway** - No detectable external dose to members of the public was attributable to the operation of Surry Power Station in 2022.
- **Airborne Exposure Pathway** – Radioiodine analyses of charcoal cartridge samples indicated that no positive activity was detected. Quarterly, the gamma isotopic analysis of the composite particulate samples identified beryllium-7, which is naturally occurring. All indicator locations for air particulate gross beta concentrations trend well with the control locations. The effluent data, reviewed for the period of interest, concluded the station contribution is not measurable.
- **Milk** - Milk samples are an important indicator measuring the effect of radioactive iodine and radionuclides in airborne releases. No positive cesium-137 nor iodine-131 activity was detected in any of the thirty-six samples. Naturally occurring potassium-40 was detected in this pathway at levels similar to historical values.. Strontium-90 was detected in each of the quarterly composite samples with an average concentration of 1.73 pCi/L. Strontium-90 is not a component of station effluents, but rather, a product of nuclear weapons testing fallout.
- **Food Products** – Only naturally occurring potassium-40 was detected in all three food product samples. Historically, cesium-137 had occasionally been detected in these samples and is attributable to global fallout from past nuclear weapons testing. In 2022, no positive cesium-137 activity was detected in food product samples.
- **Well Water** - Well water samples were analyzed for gamma emitting radionuclides and tritium. Well water sample analysis results indicate no radioactivity was attributable to the operation of the station.
- **River Water** - River water samples were analyzed for gamma emitting radionuclides and tritium. Only naturally occurring potassium-40 was detected. No positive tritium activity was detected. River water sample analysis results indicate no radioactivity was attributable to the operation of the station.

- **Silt** – No radioactivity attributable to the operation of the station was detected in the control location. Only naturally occurring potassium-40, radium-226, thonium-228, thorium-232, and actinium-228 were detected.

The indicator sample with the highest concentration of cesium-137 during 2022 is the station intake sample, with a concentration of 123 pCi/kg. This concentration is consistent with aquatic sediment samples collected in control locations of the James River. Naturally occurring beryllium-7, potassium-40, radium-226, thonium-228, thorium-232, and actinium-228 were detected.

- **Shoreline Sediment** - No radionuclides attributable to the operation of Surry Power Station was detected in any of the shoreline sediment samples. Naturally occurring potassium-40, thorium-228, and thorium-232 were detected at concentrations equivalent to normal background activities.

Aquatic Biota

- **Fish** – Other than naturally occurring potassium-40, no other positive gamma emitting radionuclides were detected in any of the fish samples.
- **Oysters** – Other than naturally occurring potassium-40, no other positive gamma emitting radionuclides were detected in any of the oyster samples.
- **Clams** - Other than naturally occurring potassium-40, no other positive gamma emitting radionuclides were detected in any of the clam samples.
- **Crabs** – Other than naturally occurring potassium-40, no other positive gamma emitting radionuclides were detected in any of the crab samples.

REFERENCES

References

1. NUREG-0472, "Radiological Effluent Technical Specifications for PWRs", Draft Rev. 3, March 1982.
2. United States Nuclear Regulatory Commission, Regulatory Guide 1.109, Rev. 1, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10CFR50, Appendix I", October 1977.
3. United States Nuclear Regulatory Commission, Regulatory Guide 4.8, "Environmental Technical Specifications for Nuclear Power Plants", December 1975.
4. United States Nuclear Regulatory Commission Branch Technical Position, "Acceptable Radiological Environmental Monitoring Program", Rev. 1, November 1979.
5. Dominion, Station Administrative Procedure, VPAP-2103S, "Offsite Dose Calculation Manual (Surry)".
6. Virginia Electric and Power Company, Surry Power Station Technical Specifications, Units 1 and 2.
7. HASL-300, Environmental Measurements Laboratory, "EML Procedures Manual," 27th Edition, Volume 1, February 1992.
8. NUREG/CR-4007, "Lower Limit of Detection: Definition and Elaboration of a Proposed Position for Radiological Effluent and Environmental Measurements," September 1984.
9. NCRP Report No. 160, "Ionizing Radiation Exposure of the Population of the United States," March 2009.
10. Position paper on "Implementation of ANSI/HPS N13.37-2014 Environmental Dosimetry Criteria at Surry Power Station", November 2016 by John M. Sukosky, CHP.

APPENDICES

APPENDIX A: LAND USE CENSUS

Year 2022

| Sector | Direction | Nearest Resident | Nearest Garden ** | Nearest Cow | Nearest Goat |
|--------|-----------|------------------|-------------------|-------------|--------------|
| A | N | 4.1 @ 10° | (a) | (a) | (a) |
| B | NNE | 1.9 @ 32° | (a) | (a) | (a) |
| C | NE | 4.7 @ 35° | (a) | (a) | (a) |
| D | ENE | (a) | (a) | (a) | (a) |
| E | E | (a) | (a) | (a) | (a) |
| F | ESE | (a) | (a) | (a) | (a) |
| G | SE | 2.8 @ 142° | (a) | (a) | (a) |
| H | SSE | 2.7 @ 158° | 2.7 @ 158° | (a) | (a) |
| J | S | 1.7 @ 181° | 2.0 @ 183° | (a) | (a) |
| K | SSW | 1.9 @ 192° | 1.9 @ 192° | 4.8 @ 200° | (a) |
| L | SW | 2.3 @ 218° | 4.7 @ 228° | (a) | (a) |
| M | WSW | 0.4 @ 244° | 3.6 @ 245° | (a) | (a) |
| N | W | 3.1 @ 260° | 3.4 @ 260° | (a) | (a) |
| P | WNW | 4.9 @ 283° | (a) | (a) | (a) |
| Q | NW | 4.6 @ 321° | (a) | (a) | (a) |
| R | NNW | 3.8 @ 338° | 4.4 @ 334° | 3.7 @ 336° | (a) |

* Locations are listed by miles and degrees heading relative to true north from center of Unit 1 Containment.

** Area greater than 50 m² and contains broadleaf vegetation.

(a) None

APPENDIX B: SUMMARY OF INTERLABORATORY COMPARISONS

Year 2022

Summary of Results – Inter-laboratory Comparison Program (ICP)

The TBE Laboratory analyzed Performance Evaluation (PE) samples of air particulate (AP), air iodine, milk, soil, vegetation, and water matrices for various analytes. The PE samples supplied by Analytics Inc., Environmental Resource Associates (ERA) and Department of Energy (DOE) Mixed Analyte Performance Evaluation Program (MAPEP), were evaluated against the following pre-set acceptance criteria:

A. Analytics Evaluation Criteria

Analytics' evaluation report provides a ratio of TBE's result and Analytics' known value. Since flag values are not assigned by Analytics, TBE evaluates the reported ratios based on internal QC requirements based on the DOE MAPEP criteria.

B. ERA Evaluation Criteria

ERA's evaluation report provides an acceptance range for control and warning limits with associated flag values. ERA's acceptance limits are established per the US EPA, National Environmental Laboratory Accreditation Conference (NELAC), state-specific Performance Testing (PT) program requirements or ERA's SOP for the Generation of Performance Acceptance Limits, as applicable. The acceptance limits are either determined by a regression equation specific to each analyte or a fixed percentage limit promulgated under the appropriate regulatory document.

C. DOE Evaluation Criteria

MAPEP's evaluation report provides an acceptance range with associated flag values. MAPEP defines three levels of performance:

- Acceptable (flag = "A") - result within $\pm 20\%$ of the reference value
- Acceptable with Warning (flag = "W") - result falls in the $\pm 20\%$ to $\pm 30\%$ of the reference value
- Not Acceptable (flag = "N") - bias is greater than 30% of the reference value

Note: The Department of Energy (DOE) Mixed Analyte Performance Evaluation Program (MAPEP) samples are created to mimic conditions found at DOE sites which do not resemble typical environmental samples obtained at commercial nuclear power facilities.

For the TBE laboratory, 142 out of 150 analyses performed met the specified acceptance criteria. Eight analyses did not meet the specified acceptance criteria and were addressed through the TBE Corrective Action Program. *NOTE: Two analyses (soil for Tc-99 and U-238) that did not meet acceptance criteria was performed for TBE information and is not on the list of required ICP analyses. A summary is found below:*

1. The Analytics March 2022 AP Ce-141 result was evaluated as *Not Acceptable*. The reported value for Ce-141 was 60.9 pCi and the known result was 42.0 pCi/L (1.45 ratio of reported result vs. known; TBE's internal acceptance range is 0.70 - 1.30). This sample was used as the workgroup duplicate with a result of 45.7 (109% of known) and was also counted on a different detector with a result of 50.9 (121% of known). This was TBE's first failure for AP Ce-141. (NCR 22-04)
2. The MAPEP February 2022 Urine U-234 & U-238 results were evaluated as *Not Acceptable*. TBE's reported values of 0.142 and 0.0254 were above the known upper ranges of 0.0096 and 0.0134 respectively for U-234 and U-238. These spiked values

were below TBE's typical MDC for urine client samples. The samples were re-prepped using a larger sample aliquot and counted for 60 hours as opposed to 48 hours. The recount results were 0.00732 for U-234 and 0.0119 for U-238 (both within acceptable range). MAPEP urine samples will be flagged to use a larger sample aliquot and counting time than typical client samples. MAPEP did not include any urine cross-check samples in August. (NCR 22-05)

3. The ERA MRAD September 2022 AP Pu-238 was evaluated as *Not Acceptable*. The reported value was 38.8 pCi and the known result was 29.9 (acceptance range 22.6 – 36.7). The AP filter was cut in half prior to digestion (shared with Fe-55) but should have been completely digested together and aliquotted afterwards like typical client samples. This is the first failure for AP Pu-238. (NCR 22-19)
4. The ERA October 2022 water Uranium result was evaluated as *Not Acceptable*. The reported value was 10.54 pCi/L and the known was 8.53 (acceptance range 6.60 – 9.88) or 124% of the known (acceptable for TBE QC). The 2-sigma error was 3.2, placing the reported result well within the acceptable range. This sample was used as the workgroup duplicate with a result of 8.2 +/- 2.9 pCi/L (also within the acceptable range). All other QA was reviewed with no anomalies. (NCR 22-20)
5. The Analytics AP Co-60 result was evaluated as *Not Acceptable*. The reported value was 207 pCi and the known was 147 (141% of the known). TBE's internal QC acceptance is 70 - 130%. All QA was reviewed with no anomalies. This sample was used as the workgroup duplicate and counted on a different detector with a result of 167 pCi (114% of the known). This is the first failure for AP Co-60 – average result ratio compared to the known is 109%. (NCR 22-21)
6. The MAPEP August 2022 water Tc-99 result was evaluated as *Not Acceptable*. The reported value was 1.86 +/- 0.414 Bq/L for this "false positive" test. The evaluation of the submitted result to the 3 times the uncertainty indicated a slight positive. This sample was used as the workgroup duplicate with a result of 0.88 +/- 0.374 Bq/L. All QC was reviewed, and no anomalies found. This is the first unacceptable since the resumption of reporting water Tc-99 for the 3rd quarter of 2020. TBE to known ratios have ranged from 94-109% during this time. (NCR 22-22)

The Inter-Laboratory Comparison Program provides evidence of "in control" counting systems and methods, and that the laboratories are producing accurate and reliable data.

**Analytics Environmental Radioactivity Cross Check Program
Teledyne Brown Engineering Environmental Services**

Table D.1

| Month/Year | Identification Number | Matrix | Nuclide | Units | TBE Reported Value | Known Value ^(a) | Ratio of TBE to Analytics Result | Evaluation ^(b) | | |
|------------|-----------------------|--------|---------|----------|--------------------|----------------------------|----------------------------------|---------------------------|------|------------------|
| March 2022 | E13706 | Milk | Sr-89 | pCi/L | 80.3 | 96.8 | 0.83 | A | | |
| | | | Sr-90 | pCi/L | 12.7 | 12.6 | 1.01 | A | | |
| | E13707 | Milk | Ce-141 | pCi/L | 62.3 | 65 | 0.96 | A | | |
| | | | Co-58 | pCi/L | 158 | 164 | 0.96 | A | | |
| | | | Co-60 | pCi/L | 286 | 302 | 0.95 | A | | |
| | | | Cr-51 | pCi/L | 314 | 339 | 0.93 | A | | |
| | | | Cs-134 | pCi/L | 155 | 182 | 0.85 | A | | |
| | | | Cs-137 | pCi/L | 210 | 223 | 0.94 | A | | |
| | | | Fe-59 | pCi/L | 211 | 185 | 1.14 | A | | |
| | | | I-131 | pCi/L | 88.0 | 96.7 | 0.91 | A | | |
| | | | Mn-54 | pCi/L | 169 | 164 | 1.03 | A | | |
| | | | Zn-65 | pCi/L | 238 | 246 | 0.97 | A | | |
| | | | E13708 | Charcoal | I-131 | pCi | 79.9 | 87.1 | 0.92 | A |
| | | | E13709 | AP | Ce-141 | pCi | 60.9 | 42.0 | 1.45 | N ⁽¹⁾ |
| Co-58 | pCi | 118 | | | 107 | 1.11 | A | | | |
| Co-60 | pCi | 218 | | | 196 | 1.11 | A | | | |
| Cr-51 | pCi | 251 | | | 221 | 1.14 | A | | | |
| Cs-134 | pCi | 129 | | | 118 | 1.09 | A | | | |
| Cs-137 | pCi | 156 | | | 145.0 | 1.07 | A | | | |
| Fe-59 | pCi | 124 | | | 120.0 | 1.03 | A | | | |
| Mn-54 | pCi | 120 | | | 107 | 1.12 | A | | | |
| Zn-65 | pCi | 162 | 160 | 1.01 | A | | | | | |
| E13710 | Soil | Ce-141 | pCi/g | 0.123 | 0.103 | 1.19 | A | | | |
| | | Co-58 | pCi/g | 0.254 | 0.263 | 0.97 | A | | | |
| | | Co-60 | pCi/g | 0.493 | 0.483 | 1.02 | A | | | |
| | | Cr-51 | pCi/g | 0.603 | 0.543 | 1.11 | A | | | |
| | | Cs-134 | pCi/g | 0.268 | 0.292 | 0.92 | A | | | |
| | | Cs-137 | pCi/g | 0.399 | 0.431 | 0.93 | A | | | |
| | | Fe-59 | pCi/g | 0.320 | 0.296 | 1.08 | A | | | |
| | | Mn-54 | pCi/g | 0.263 | 0.263 | 1.00 | A | | | |
| | | Zn-65 | pCi/g | 0.407 | 0.395 | 1.03 | A | | | |
| E13711 | AP | Sr-89 | pCi | 83.2 | 97.4 | 0.85 | A | | | |
| | | Sr-90 | pCi | 12.7 | 12.7 | 1.00 | A | | | |

(a) The Analytics known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation

(b) Analytics evaluation based on TBE internal QC limits:

A = Acceptable - reported result falls within ratio limits of 0.80-1.20

W = Acceptable with warning - reported result falls within 0.70-0.80 or 1.20-1.30

N = Not Acceptable - reported result falls outside the ratio limits of < 0.70 and > 1.30

**Analytics Environmental Radioactivity Cross Check Program
Teledyne Brown Engineering Environmental Services**

Table D.1

| Month/Year | Identification Number | Matrix | Nuclide | Units | TBE Reported Value | Known Value ^(a) | Ratio of TBE to Analytics Result | Evaluation ^(b) | | | |
|----------------|-----------------------|--------|----------------|----------|--------------------|----------------------------|----------------------------------|---------------------------|------|------|---|
| September 2022 | E13712 | Milk | Sr-89 | pCi/L | 71.1 | 89.1 | 0.80 | A | | | |
| | | | Sr-90 | pCi/L | 12.0 | 13.6 | 0.88 | A | | | |
| September 2022 | E13713 | Milk | Ce-141 | pCi/L | 148 | 161 | 0.92 | A | | | |
| | | | Co-58 | pCi/L | 178 | 189 | 0.94 | A | | | |
| | | | Co-60 | pCi/L | 229 | 260 | 0.88 | A | | | |
| | | | Cr-51 | pCi/L | 486 | 456 | 1.07 | A | | | |
| | | | Cs-134 | pCi/L | 220 | 252 | 0.87 | A | | | |
| | | | Cs-137 | pCi/L | 203 | 222 | 0.92 | A | | | |
| | | | Fe-59 | pCi/L | 174 | 173 | 1.01 | A | | | |
| | | | I-131 | pCi/L | 75.9 | 94.2 | 0.81 | A | | | |
| | | | Mn-54 | pCi/L | 269 | 282 | 0.95 | A | | | |
| | | | Zn-65 | pCi/L | 364 | 373 | 0.97 | A | | | |
| | | | E13714 | Charcoal | I-131 | pCi | 81.4 | 83.6 | 0.97 | A | |
| | | | September 2022 | E13715 | AP | Ce-141 | pCi | 102 | 91 | 1.12 | A |
| | | | | | | Co-58 | pCi | 118 | 107 | 1.11 | A |
| Co-60 | pCi | 207 | | | | 147 | 1.41 | N ⁽²⁾ | | | |
| Cr-51 | pCi | 310 | | | | 257 | 1.21 | W | | | |
| Cs-134 | pCi | 148 | | | | 142 | 1.04 | A | | | |
| Cs-137 | pCi | 137 | | | | 125 | 1.10 | A | | | |
| Fe-59 | pCi | 115 | | | | 98 | 1.18 | A | | | |
| Mn-54 | pCi | 168 | | | | 159 | 1.05 | A | | | |
| Zn-65 | pCi | 240 | 211 | 1.14 | A | | | | | | |
| September 2022 | E13716 | Soil | Ce-141 | pCi/g | 0.288 | 0.284 | 1.01 | A | | | |
| | | | Co-58 | pCi/g | 0.320 | 0.334 | 0.96 | A | | | |
| | | | Co-60 | pCi/g | 0.445 | 0.459 | 0.97 | A | | | |
| | | | Cr-51 | pCi/g | 0.883 | 0.805 | 1.10 | A | | | |
| | | | Cs-134 | pCi/g | 0.410 | 0.446 | 0.92 | A | | | |
| | | | Cs-137 | pCi/g | 0.447 | 0.465 | 0.96 | A | | | |
| | | | Fe-59 | pCi/g | 0.314 | 0.305 | 1.03 | A | | | |
| | | | Mn-54 | pCi/g | 0.489 | 0.499 | 0.98 | A | | | |
| | | | Zn-65 | pCi/g | 0.666 | 0.660 | 1.01 | A | | | |
| September 2022 | E13717 | AP | Sr-89 | pCi | 87.5 | 98.3 | 0.89 | A | | | |
| | | | Sr-90 | pCi | 12.6 | 15.0 | 0.84 | A | | | |

(a) The Analytics known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation

(b) Analytics evaluation based on TBE internal QC limits:

A = Acceptable - reported result falls within ratio limits of 0.80-1.20

W = Acceptable with warning - reported result falls within 0.70-0.80 or 1.20-1.30

N = Not Acceptable - reported result falls outside the ratio limits of < 0.70 and > 1.30

DOE's Mixed Analyte Performance Evaluation Program (MAPEP)
Teledyne Brown Engineering Environmental Services

| Month/Year | Identification Number | Matrix | Nuclide | Units | TBE Reported Value | Known Value ^(a) | Acceptance Range | Evaluation ^(b) |
|---------------|-----------------------|------------|-------------|-----------|--------------------|----------------------------|------------------|---------------------------|
| February 2022 | 22-GrF46 | AP | Gross Alpha | Bq/sample | 0.402 | 1.20 | 0.36 - 2.04 | A |
| | | | Gross Beta | Bq/sample | 0.669 | 0.68 | 0.341 - 1.022 | A |
| | 22-MaS46 | Soil | Ni-63 | Bq/kg | 645 | 780 | 546 - 1014 | A |
| | | | Tc-99 | Bq/kg | 526 | 778 | 545 - 1011 | N ⁽³⁾ |
| | 22-MaSU46 | Urine | Cs-134 | Bq/L | 1.67 | 1.77 | 1.24 - 2.30 | A |
| | | | Cs-137 | Bq/L | 1.50 | 1.56 | 1.09 - 2.03 | A |
| | | | Co-57 | Bq/L | 4.93 | 5.39 | 3.77 - 7.01 | A |
| | | | Co-60 | Bq/L | 2.13 | 2.06 | 1.44 - 2.68 | A |
| | | | Mn-54 | Bq/L | 4.83 | 5.08 | 3.56 - 6.60 | A |
| | | | U-234 | Bq/L | 0.142 | 0.0074 | 0.0052 - 0.0096 | N ⁽⁴⁾ |
| | | | U-238 | Bq/L | 0.0254 | 0.0103 | 0.0072 - 0.0134 | N ⁽⁴⁾ |
| | | | Zn-65 | Bq/L | 4.71 | 4.48 | 3.14 - 5.82 | A |
| | 22-MaW46 | Water | Ni-63 | Bq/L | 28.6 | 34.0 | 23.8 - 44.2 | A |
| | | | Tc-99 | Bq/L | 8.59 | 7.90 | 5.5 - 10.3 | A |
| | 22-RdV46 | Vegetation | Cs-134 | Bq/sample | 6.61 | 7.61 | 5.33 - 9.89 | A |
| | | | Cs-137 | Bq/sample | 1.50 | 1.52 | 1.06 - 1.98 | A |
| | | | Co-57 | Bq/sample | 5.11 | 5.09 | 3.56 - 6.62 | A |
| | | | Co-60 | Bq/sample | 0.0162 | | (1) | A |
| | | | Mn-54 | Bq/sample | 2.42 | 2.59 | 1.81 - 3.37 | A |
| | | | Sr-90 | Bq/sample | 0.684 | 0.789 | 0.552 - 1.026 | A |
| Zn-65 | | | Bq/sample | 1.44 | 1.47 | 1.03 - 1.91 | A | |
| | | | | | | | | |
| August 2022 | 22-MaS47 | Soil | Ni-63 | Bq/kg | 14.6 | | (1) | A |
| | | | Tc-99 | Bq/kg | 994 | 1000 | 700 - 1300 | A |
| | 22-MaW47 | Water | Ni-63 | Bq/L | 24.4 | 32.9 | 23.0 - 42.8 | A |
| | | | Tc-99 | Bq/L | 1.9 | | (1) | N ⁽⁵⁾ |
| | 25-RdV47 | Vegetation | Cs-134 | Bq/sample | 0.032 | | (1) | A |
| | | | Cs-137 | Bq/sample | 0.891 | 1.08 | 0.758 - 1.408 | A |
| | | | Co-57 | Bq/sample | 0.006 | | (1) | A |
| | | | Co-60 | Bq/sample | 4.04 | 4.62 | 3.23 - 6.01 | A |
| | | | Mn-54 | Bq/sample | 2.01 | 2.43 | 1.70 - 3.16 | A |
| | | | Sr-90 | Bq/sample | 1.25 | 1.60 | 1.12 - 2.08 | W |
| | Zn-65 | Bq/sample | 6.16 | 7.49 | 5.24 - 9.74 | A | | |

(a) The MAPEP known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation

(b) DOE/MAPEP evaluation:

A = Acceptable - reported result falls within ratio limits of 0.80-1.20

W = Acceptable with warning - reported result falls within 0.70-0.80 or 1.20-1.30

N = Not Acceptable - reported result falls outside the ratio limits of < 0.70 and > 1.30

(1) False positive test

(2) Sensitivity evaluation

(3) Tc-99 soil cross-checks done for TBE information only - not required

(4) See NCR 22-05

**ERA Environmental Radioactivity Cross Check Program
Teledyne Brown Engineering Environmental Services**

| Month/Year | Identification Number | Matrix | Nuclide | Units | TBE Reported Value | Known Value ^(a) | Acceptance Limits | Evaluation ^(b) | | | |
|----------------|-----------------------|------------|------------|------------|--------------------|----------------------------|-------------------|---------------------------|-------------|------------|---|
| March 2022 | MRAD-36 | Water | Am-241 | pCi/L | 68.3 | 74.6 | 51.2 - 95.4 | A | | | |
| | | | Fe-55 | pCi/L | 797 | 1140 | 670 - 1660 | A | | | |
| | | | Pu-238 | pCi/L | 146 | 147 | 88.4 - 190 | A | | | |
| | | | Pu-239 | pCi/L | 69.9 | 71.9 | 44.5 - 88.6 | A | | | |
| | | Soil | Sr-90 | pCi/kg | 8050 | 6720 | 2090 - 10500 | A | | | |
| | | | AP | Fe-55 | pCi/filter | 148 | 127 | 46.4 - 203 | A | | |
| | | Pu-238 | | pCi/filter | 29.9 | 29.6 | 22.3 - 36.4 | A | | | |
| | | Pu-239 | | pCi/filter | 51.6 | 49.7 | 37.2 - 60.0 | A | | | |
| | | U-234 | | pCi/filter | 59.9 | 67.3 | 49.9 - 78.9 | A | | | |
| | | U-238 | | pCi/filter | 59.0 | 66.7 | 50.4 - 79.6 | A | | | |
| | | GR-A | | pCi/filter | 95.6 | 94.2 | 49.2 - 155 | A | | | |
| | | GR-B | pCi/filter | 71.2 | 66.8 | 40.5 - 101 | A | | | | |
| | | April 2022 | RAD-129 | Water | Ba-133 | pCi/L | 61.7 | 62.9 | 52.3 - 69.2 | A | |
| | | | | | Cs-134 | pCi/L | 80.9 | 81.6 | 68.8 - 89.8 | A | |
| Cs-137 | pCi/L | | | | 37.4 | 36.6 | 32.1 - 43.3 | A | | | |
| Co-60 | pCi/L | | | | 103 | 97.4 | 87.7 - 109 | A | | | |
| Zn-65 | pCi/L | | | | 318 | 302 | 272 - 353 | A | | | |
| GR-A | pCi/L | | | | 26.9 | 20.8 | 10.4 - 28.3 | A | | | |
| GR-B | pCi/L | | | | 49.7 | 51.0 | 34.7 - 58.1 | A | | | |
| U-Nat | pCi/L | | | | 56.3 | 68.9 | 56.3 - 75.8 | A | | | |
| H-3 | pCi/L | | | | 17,000 | 18,100 | 15,800 - 19,000 | A | | | |
| Sr-89 | pCi/L | | | | 65.3 | 67.9 | 55.3 - 76.1 | A | | | |
| Sr-90 | pCi/L | | | | 42.1 | 42.7 | 31.5 - 49.0 | A | | | |
| I-131 | pCi/L | | | | 25.7 | 26.2 | 21.8 - 30.9 | A | | | |
| September 2022 | MRAD-37 | | | | Water | Am-241 | pCi/L | 111 | 96.2 | 66.0 - 123 | A |
| | | | | | | Fe-55 | pCi/L | 850 | 926 | 544 - 1350 | A |
| | | Pu-238 | pCi/L | 62.1 | | 52.6 | 31.6 - 68.2 | A | | | |
| | | Pu-239 | pCi/L | 139.5 | | 117 | 72.5 - 144 | A | | | |
| | | Soil | Sr-90 | pCi/kg | 3350 | 6270 | 1950 - 9770 | A | | | |
| | | | U-234 | pCi/kg | 1684 | 3350 | 1570 - 4390 | A | | | |
| | | | U-238 | pCi/kg | 1658 | 3320 | 1820 - 4460 | N ⁽²⁾ | | | |
| | | AP | Fe-55 | pCi/filter | 71.9 | 122 | 44.5 - 195 | A | | | |
| | | | Pu-238 | pCi/filter | 38.8 | 29.9 | 22.6 - 36.7 | N ⁽¹⁾ | | | |
| | | | Pu-239 | pCi/filter | 14.5 | 13.0 | 9.73 - 15.7 | A | | | |
| | | | U-234 | pCi/filter | 78.0 | 71.5 | 53.0 - 83.8 | A | | | |
| | | | U-238 | pCi/filter | 79.7 | 70.9 | 53.5 - 84.6 | A | | | |
| | | | GR-A | pCi/filter | 62.8 | 55.5 | 29.0 - 91.4 | A | | | |
| | | | GR-B | pCi/filter | 70.9 | 64.8 | 39.3 - 97.9 | A | | | |
| October 2022 | RAD-131 | Water | Ba-133 | pCi/L | 76.2 | 79.4 | 66.6 - 87.3 | A | | | |
| | | | Cs-134 | pCi/L | 28.0 | 30.5 | 23.9 - 33.6 | A | | | |
| | | | Cs-137 | pCi/L | 202 | 212 | 191 - 235 | A | | | |
| | | | Co-60 | pCi/L | 52.4 | 51.4 | 46.3 - 59.1 | A | | | |
| | | | Zn-65 | pCi/L | 216 | 216 | 194 - 253 | A | | | |
| | | | GR-A | pCi/L | 19.7 | 16.9 | 8.28 - 23.7 | A | | | |
| | | | GR-B | pCi/L | 49.8 | 53.0 | 36.1 - 60.0 | A | | | |
| | | | U-Nat | pCi/L | 10.54 | 8.53 | 6.60 - 9.88 | N ⁽³⁾ | | | |
| | | | H-3 | pCi/L | 13,900 | 15,100 | 13,200 - 16,600 | A | | | |
| | | | Sr-89 | pCi/L | 59.7 | 64.5 | 52.3 - 72.5 | A | | | |
| | | | Sr-90 | pCi/L | 32.9 | 37.3 | 27.4 - 43.0 | A | | | |
| | | | I-131 | pCi/L | 26.9 | 24.4 | 20.2 - 28.9 | A | | | |

(a) The ERA known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation.

(b) ERA evaluation:

A = Acceptable - Reported value falls within the Acceptance Limits

N = Not Acceptable - Reported value falls outside of the Acceptance Limits

(1) See **NCR 22-19**

(2) U soil cross-checks done for TBE information only - not required

(3) See **NCR 22-20**